

<b>DOCKETED</b>	
<b>Docket Number:</b>	09-AFC-03C
<b>Project Title:</b>	MARIPOSA ENERGY PROJECT - Compliance
<b>TN #:</b>	269470
<b>Document Title:</b>	Mariposa Energy (Diamond Generation) Comments - Mariposa (#G1015) 2026 Q1 QCR
<b>Description:</b>	N/A
<b>Filer:</b>	System
<b>Organization:</b>	Mariposa Energy (Diamond Generation)
<b>Submitter Role:</b>	Public
<b>Submission Date:</b>	4/13/2026 3:37:41 PM
<b>Docketed Date:</b>	4/13/2026

*Comment Received From: Mariposa Energy (Diamond Generation)*  
*Submitted On: 4/13/2026*  
*Docket Number: 09-AFC-03C*

**Mariposa (#G1015) 2026 Q1 QCR**

*Additional submitted attachment is included below.*



# Mariposa

## Energy Project

April 9, 2026

Anwar Ali  
Compliance Project Manager  
California Energy Commission  
Siting, Transmission, & Environmental Protection (“STEP”) Division  
1516 Ninth Street, MS-2000  
Sacramento, CA 95814

Reference: Mariposa Energy, LLC (09-AFC-3C) Compliance with Air Quality Conditions of Certification (CEC #G1015)

Subject: CEC Condition of Certification AQ-SC8:  
Quarterly Compliance Report for Quarter-Ending March 31, 2026

Dear Mr. Ali,

To demonstrate ongoing compliance with the California Energy Commission (“CEC”) and Bay Area Air Quality Management District (“BAAQMD”) regulations, Mariposa Energy, LLC (previously Mariposa Energy Project) is submitting its Quarterly Compliance Report (“QCR”) including Attachment 1, “Compliance Summary”, for quarter-ending March 31, 2026. As required, a copy of the report is also being sent to the BAAQMD. This QCR is being submitted to satisfy the requirements of:

- CEC - Mariposa Energy Project “Commission Decision”, (Docket No. 09-AFC-3) – Cond. AQ-SC8.
- BAAQMD - Permit to Operate, Plant #19730, Condition #24955, Part 33.
- United States Environmental Protection Agency, Code of Federal regulations, Title 40, Part 60, Subpart KKKK, Section 4375 (40 CFR 60.4375).

The QCR contains the following attachments:

Attachment 1: Compliance Summary: Table identifying each condition relevant to the QCR, operational limits, compliance status (including supporting data), and reference location within the QCR.

Attachment 2: Condition AQ-11 Monthly Natural Gas Fuel Analyses: Monthly analytical results for natural gas analysis as provided by the natural gas supplier (Pacific Gas and Electric) to demonstrate compliance with the natural gas sulfur content limit, as required by AQ-11.

Attachment 3: Condition AQ-12 Heat Input Limits: 1-hr for all CTGs Report: Report demonstrating compliance with maximum 1-hr heat input for combustion turbine generator (CTG) Unit 600 (S-1), Unit 700 (S-2), Unit 800 (S-3), and Unit 900 (S-4).


- Attachment 4: Condition AQ-13 Heat Input Limits: Daily Maximums for all CTGs Report: Report demonstrating compliance with daily total heat input for CTG Unit 600 (S-1), Unit 700 (S-2), Unit 800 (S-3), and Unit 900 (S-4), Condition AQ-14 Heat Input Limit: Rolling 12-Month combined CTG Heat Input Report: Report demonstrating compliance with annual (rolling 12-month) combined heat input limit to CTG Units 600 (S-1), 700 (S-2), 800 (S-3), and 900 (S-4), and Condition AQ-15a/b Operating Hour Limits: Rolling 12-Month individual and combined CTG Hours Report: Report demonstrating compliance with annual (rolling 12-month) individual and combined hours of operation limits for CTG Units 600 (S-1), 700 (S-2), 800 (S-3), and 900 (S-4).
- Attachment 5: Condition AQ-16 SCR/Oxidation Catalyst Operation Report: Report demonstrating the CTG Units 600 (S-1), 700 (S-2), 800 (S-3), and 900 (S-4) emissions are abated by properly operating SCR and Oxidation Catalyst systems.
- Attachment 6: Condition AQ-17a/b NO<sub>x</sub> Emissions Limits: Hourly Mass Rate and Hourly Average Concentration Report: Report of hourly (rolling 60-minute) NO<sub>x</sub> concentrations and emissions from CTG Units 600 (S-1), 700 (S-2), 800 (S-3), and 900 (S-4), Condition AQ-17c/d CO Emission Limits: Hourly Mass Rate/Rolling 3-Hr Concentration Report: Report demonstrating compliance with hourly (rolling 60-minute) CO mass emissions and rolling 3-hour CO concentrations from CTG Units 600 (S-1), 700 (S-2), 800 (S-3), and 900 (S-4), Condition AQ-17e NH<sub>3</sub> Emission Limits: Rolling 3-Hr Slip Calculation Report: Report demonstrating compliance with rolling 3-hr ammonia emission concentration limit as calculated by source test-derived correlation as required by AQ-25, and Condition AQ-17f/g Hourly Mass Emission Limits: POC & SO<sub>2</sub> Report: Report demonstrating compliance with hourly POC and SO<sub>2</sub> emission limits for Combustion Turbine Generator (CTG) units 600 (S-1), 700 (S-2), 800 (S-3), and 900 (S-4).
- Attachment 7: Condition AQ-18 Startup and Shutdown Emission Limits Report: Report of startup and shutdown emissions for CTG Units 600 (S-1), 700 (S-2), 800 (S-3), and 900 (S-4).
- Attachment 8: Condition AQ-19 Daily Emission Limits: NO<sub>x</sub>, CO, POC, and SO<sub>2</sub> Emissions Report: Report demonstrating compliance with daily NO<sub>x</sub>, CO, POC and SO<sub>2</sub> limits for all CTG units combined.
- Attachment 9: Condition AQ-20 Cumulative Rolling 12-month CTG Emissions: NO<sub>x</sub>, CO, POC, PM<sub>10</sub>, SO<sub>2</sub> Emissions Report: Report demonstrating compliance with consecutive 12-month NO<sub>x</sub>, CO, POC, PM<sub>10</sub> and SO<sub>2</sub> limits for all CTG units combined, and Condition AQ-31 Facility SAM 12-month Tons Limit Emissions Report: Report demonstrating compliance with consecutive 12-month sulfuric acid emissions limit for all CTG units combined.
- Attachment 10: Exceedances / Violations
- Attachment 11: Condition AQ-38 40 CFR Part 72.9(c)(1) SO<sub>2</sub> Allowances and 40 CFR Part 75 CEM Requirements Report: Report demonstrating compliance with Condition AQ-38 requiring holding of SO<sub>2</sub> allowances and compliance with CEM requirements of 40 CFR Part 75.

Attachment 12: Conditions AQ-39, AQ-40 S-6 Emergency Fire Pump Operation Report (BAAQMD Condition 22850, parts 1 & 2): Report demonstrating compliance with specified IC engine operating limitations.

Attachment 13: Condition AQ-41 S-6 Emergency Fire Pump Totalizing Meter Report (BAAQMD Condition 22850, part 3): Photographic record demonstrating the installation and use of hour-meter for tracking engine operation.

If you have any questions regarding this submittal, please contact Wayne Forsyth by email at [w.forsyth@dgc-us.com](mailto:w.forsyth@dgc-us.com) or phone (213) 473-0093, or Jason Smith by email at [j.smith@dgc-ops.com](mailto:j.smith@dgc-ops.com) or phone (925) 666-5409.

Best regards,

A handwritten signature in black ink, appearing to read 'Jason Smith', with a large, stylized flourish at the end.

Jason Smith  
EH&S Coordinator  
Mariposa Energy, LLC

cc: Davis Zhu (BAAQMD)

**Attachment 1**

**Compliance Summary**

Mariposa Energy, LLC

## Quarterly Compliance Report

Quarter Ending March 31, 2026

# Mariposa Energy, LLC

## Quarterly Compliance Report

### Quarter Ending March 31, 2026

This report documents compliance with the California Energy Commission's Conditions of Certification AQ-SC8 and Bay Area Air Quality Management District Permit condition 24955

Attached are summaries of relevant permit conditions and compliance status as well as the required documentation.

**Attachment 1:** Compliance Summary

**Attachment 2:** Condition AQ-11 Monthly Natural Gas Sulfur Content - PGE

**Attachment 3:** Condition AQ-12 Heat Input Limits: 1-hr Maximums for all CTGs Report

**Attachment 4:** Condition AQ-13 Heat Input Limits: Daily Maximums for all CTGs Report, Condition AQ-14 Heat Input Limit: Rolling 12-Month combined CTG Heat Input and Condition AQ-15a/b Operating Hour Limits: Rolling 12-Month Individual and Combined CTG Hours Report

**Attachment 5:** Condition AQ-16 SCR/Oxidation Catalyst Operation Report

**Attachment 6:** Condition AQ-17a/b NOx Emission Limits: Hourly mass rate and hourly average concentration Report, Condition AQ-17c/d CO Emission Limits: Hourly Mass Rate/Rolling 3-Hr Concentration Report, Condition AQ-17e NH3 Emission Limits: Rolling 3-Hr Slip Calculation Report and Condition AQ-17f/g Hourly Mass Emission Limits: POC & SO2 Report

**Attachment 7:** Condition AQ-18 Startup and Shutdown Emission Limits Report

**Attachment 8:** Condition AQ-19 Daily Emission Limits: NOx, CO, POC, SO2 Emissions Report

**Attachment 9:** Condition AQ-20 Cumulative Rolling 12-month CTG Emissions: NOx, CO, POC, PM10, SO2 Emissions Report and Condition AQ-31 Facility SAM 12-month Tons Limit Emissions Report

**Attachment 10:** Exceedances / Violations

**Attachment 11:** Condition AQ-38 40 CFR Part 72.9(c)(1) SO2 Allowances and 40 CFR Part 75 CEM Requirements Report

**Attachment 12:** Conditions AQ-39, AQ-40 S-6 Emergency Fire Pump Operation Report (BAAQMD Condition 24955, parts 1 & 2)

**Attachment 13:** Condition AQ-41 S-6 Emergency Fire Pump Totalizing Meter Report (BAAQMD Condition 22850, part 3)

Mariposa Energy, LLC  
CEC Quarterly Air Compliance Report

**COMPLIANCE SUMMARY**

Condition	Condition Description	Verification or Limit	Status	Section
AQ-11	Fire the Gas Turbines (S-1, S-2, S-3, and S-4) exclusively on PUC-regulated natural gas with a <b>maximum sulfur content</b> of 1 grain per 100 standard cubic feet.	<b>1 grain sulfur per 100 scf.</b> The result of the natural gas fuel sulfur monitoring data and other fuel sulfur content data are to be submitted to District and CEC in the Quarterly Report.	<u><b>Sulfur Content</b></u> (gr/100 scf) January 2026: 0.22 February 2026: 0.23 March 2026: 0.24 <b>In Compliance</b>	Attachment 2
AQ-12	Hourly <b>Heat input rate to each Gas Turbine</b> (S-1, S-2, S-3, and S-4).	<b>500 MMBtu (HHV)/hr per turbine.</b>	<u><b>Maximum MMBtu/hr</b></u> S-1: 462 S-2: 469 S-3: 465 S-4: 451 <b>In Compliance</b>	Attachment 3
AQ-13	Daily <b>heat input rate to each Gas Turbine</b> (S-1, S-2, S-3, and S-4).	<b>12,000 MMBtu (HHV)/day per turbine.</b>	<u><b>Maximum MMBtu/day</b></u> S-1: 6017 S-2: 6117 S-3: 6039 S-4: 4654 <b>In Compliance</b>	Attachment 4
AQ-14	Combined <b>annual cumulative heat input rate for the gas turbines</b> (S-1 + S-2 + S-3 + S-4).	<b>8,128,900 MMBtu (HHV) per year (combined cumulative).</b>	<u><b>MMBTU/yr (12-mo)</b></u> Ending 1/2026: 321,442 Ending 2/2026: 221,033 Ending 3/2026: 257894 <b>In Compliance</b>	Attachment 4
AQ-15a	Maximum annual hours of operation per turbine.	<b>5,200 hours per year per turbine.</b>	<u><b>Maximum Hr/yr</b></u> S-1: 235 (1/2026) S-2: 215 (1/2026) S-3: 237 (1/2026) S-4: 186 (1/2026) <b>In Compliance</b>	Attachment 4
AQ-15b	Combined annual hours of operation for the gas turbines (S-1 + S-2 + S-3 + S-4).	<b>16,900 hours per year total – four units combined turbine hours of operation.</b>	<u><b>Combined Hours/yr</b></u> 12 mo Ending 1/26: 872 12 mo Ending 2/26: 601 12 mo Ending 3/26: 713 <b>In Compliance</b>	Attachment 4

Mariposa Energy, LLC  
CEC Quarterly Air Compliance Report

**COMPLIANCE SUMMARY**

Condition	Condition Description	Verification or Limit	Status	Section
AQ-16	The owner/operator shall ensure that each Gas Turbine (S-1, S-2, S-3, S-4) is abated by the properly operated and properly maintained Selective Catalytic Reduction (SCR) System A-2, A-4, A-6, or A-8 and Oxidation Catalyst System A-1, A-3, A-5, or A-7 whenever fuel is combusted at those sources and the corresponding SCR catalyst bed (A-2, A-4, A-6 or A-8) has reached minimum operating temperature.	The owner/operator shall make the site <b>available for inspection</b> by representatives of the District, ARB, and the Commission upon request. A summary of significant operation and maintenance events and monitoring records shall be included in the quarterly operation report.	<b>In Compliance</b>	Attachment 5
AQ-17	The owner/operator shall ensure that the Gas Turbines (S-1, S-2, S-3, S-4) comply with requirements (a) through (i). Requirements (a) through (f) do not apply during a gas turbine start-up, and shutdown.			
	a. <b>Hourly Nitrogen Oxide mass emissions limit</b> (calculated as NO <sub>2</sub> ), per turbine unit basis, after abatement.	4.4 lb/hr maximum (as NO <sub>2</sub> ), from each turbine exhaust point, after abatement.	<u>Max NOx lb/hr:</u> S-1: 4.0 S-2: 4.0 S-3: 3.9 S-4: 4.1 <b>In Compliance</b>	Attachment 6
	b. <b>Hourly average Nitrogen Oxide emission concentration</b> limit, per turbine.	2.5 ppmv maximum (as NO <sub>2</sub> ), dry, corrected to 15% O <sub>2</sub> , averaged over any 1-hour period.	<u>Max NOx, ppmvd @ 15%O<sub>2</sub>:</u> S-1: 2.4 S-2: 2.3 S-3: 2.3 S-4: 2.4 <b>In Compliance</b>	Attachment 6
	c. <b>Hourly Carbon Monoxide mass emissions</b> limit, per turbine basis, after abatement.	2.14 lb/hr CO maximum, from each turbine exhaust point.	<u>Max CO lb/hr:</u> S-1: 1.9 S-2: 2.0 S-3: 1.9 S-4: 0.7 <b>In Compliance</b>	Attachment 6
	d. <b>Rolling 3-hour average Carbon Monoxide emission concentration</b> per turbine basis, after abatement.	2.0 ppmv CO (maximum), dry, corrected to 15% O <sub>2</sub> , averaged over any rolling 3-hour period.	<u>Max CO, ppmvd @ 15% O<sub>2</sub>:</u> S-1: 1.8 S-2: 1.8 S-3: 1.8 S-4: 0.7 <b>In Compliance</b>	Attachment 6

Mariposa Energy, LLC  
CEC Quarterly Air Compliance Report

**COMPLIANCE SUMMARY**

Condition	Condition Description	Verification or Limit	Status	Section
AQ-17 cont'd	e. <b>Rolling 3-hour average Ammonia (NH<sub>3</sub>) emission concentrations</b> , per turbine unit basis, after abatement systems.	<b>5 ppmv, dry, corrected to 15% O<sub>2</sub></b> , averaged over any rolling 3-hour period. Verified by the continuous recording of the ammonia injection rate to each SCR System A-2, A-4, A-6, and A-8. The correlation between the gas turbine heat input rates, A-2, A-4, A-6, and A-8 SCR System ammonia injection rates, and corresponding ammonia emission concentration at emission points P-1, P-2, P-3 and P-4 shall be determined in accordance with AQ-25 or a District approved alternative method.	<b>Max NH<sub>3</sub>, ppmvd @ 15% O<sub>2</sub>:</b> S-1: 3.8 S-2: 3.2 S-3: 3.0 S-4: 3.4 <b>In Compliance</b>	Attachment 6
	f. <b>Hourly Precursor Organic Compound (POC) mass emissions limit</b> (as CH <sub>4</sub> ), per turbine unit basis.	<b>0.612 lb/hr</b> maximum (as CH <sub>4</sub> ), from each turbine exhaust point.	<b>Max POC lb/hr:</b> S-1: 0.3 S-2: 0.3 S-3: 0.3 S-4: 0.3 <b>In Compliance</b>	Attachment 6
	g. <b>Hourly Sulfur dioxide (SO<sub>2</sub>) mass emissions limit</b> , per turbine unit basis, after abatement.	<b>1.347 lb/hr</b> maximum (as SO <sub>2</sub> ) from each turbine exhaust point.	<b>Max SO<sub>2</sub> lb/hr:</b> S-1: 0.7 S-2: 0.3 S-3: 0.3 S-4: 0.3 <b>In Compliance</b>	Attachment 6
AQ-18	<b>Maximum startup emissions of NO<sub>x</sub></b> (as NO <sub>2</sub> ), CO, and POC (as CH <sub>4</sub> ) (lb/startup).	NO <sub>x</sub> (NO <sub>2</sub> ): <b>14.2 lb/startup</b>	<b>Max NO<sub>x</sub> Startup Emissions, lb</b> S-1: 6.85 S-2: 5.43 S-3: 6.36 S-4: 7.95 <b>In Compliance</b>	Attachment 7

Mariposa Energy, LLC  
CEC Quarterly Air Compliance Report

**COMPLIANCE SUMMARY**

Condition	Condition Description	Verification or Limit	Status	Section
AQ-18 cont'd		CO: <b>14.1 lb/startup</b>	<u>Max CO Startup Emissions, lb</u> S-1: 1.54 S-2: 1.74 S-3: 1.70 S-4: 1.10 <b>In Compliance</b>	Attachment 7
		POC (as CH <sub>4</sub> ): <b>1.1 lb/startup</b>	<u>Max POC Startup Emissions, lb</u> S-1: 0.1 S-2: 0.1 S-3: 0.1 S-4: 0.0 <b>In Compliance</b>	Attachment 7
	Maximum hourly emissions of NO <sub>x</sub> (as NO <sub>2</sub> ), CO, and POC (as CH <sub>4</sub> ) <u>with startup</u> .	NO <sub>x</sub> (NO <sub>2</sub> ): <b>18.5 lb/hour</b>	<u>Max NO<sub>x</sub> Emissions, lb/hr</u> S-1: 9.3 S-2: 6.8 S-3: 8.2 S-4: 9.8 <b>In Compliance</b>	Attachment 6
		CO: <b>17.3 lb/hour</b>	<u>Max CO Emissions, lb/hr</u> S-1: 2.6 S-2: 2.7 S-3: 3.2 S-4: 1.3 <b>In Compliance</b>	Attachment 6
		POC (as CH <sub>4</sub> ): <b>1.4 lb/hour</b>	<u>Max POC Emissions lb/hr</u> S-1: 0.3 S-2: 0.3 S-3: 0.3 S-4: 0.3 <b>In Compliance</b>	Attachment 6

Mariposa Energy, LLC  
CEC Quarterly Air Compliance Report

**COMPLIANCE SUMMARY**

Condition	Condition Description	Verification or Limit	Status	Section
AQ-18 cont'd	Maximum shutdown emissions of NO <sub>x</sub> (as NO <sub>2</sub> ), CO, and POC (as CH <sub>4</sub> ) (lb/shutdown).	NO <sub>x</sub> (NO <sub>2</sub> ): <b>3.2 lb/shutdown</b>	<u>Max Shutdown Emissions, lb</u> S-1: 1.90 S-2: 0.73 S-3: 1.25 S-4: 1.22 <b>In Compliance</b>	Attachment 7
		CO: <b>2.7 lb/shutdown</b>	<u>Max Shutdown Emissions, lb</u> S-1: 0.15 S-2: 0.21 S-3: 0.19 S-4: 0.00 <b>In Compliance</b>	Attachment 7
		POC (as CH <sub>4</sub> ): <b>0.12 lb/shutdown</b>	<u>Max Shutdown Emissions lb</u> S-1: 0.01 S-2: 0.00 S-3: 0.00 S-4: 0.01 <b>In Compliance</b>	Attachment 7
AQ-19	<b>Calendar day Cumulative combined emission limits</b> from the Gas Turbines (S-1 + S-2 + S-3 + S-4), including emissions generated during gas turbine start-ups, shutdowns and testing.			
	a. Maximum daily NO <sub>x</sub> (as NO <sub>2</sub> ) emissions.	NO <sub>x</sub> (as NO <sub>2</sub> ): <b>1100 lb/day</b>	Max lb/day NO <sub>x</sub> : 204	Attachment 8
	b. Maximum daily CO emissions.	CO: <b>934 lb/day</b>	Max lb/day CO: 81	
	c. Maximum daily POC emissions.	POC (as CH <sub>4</sub> ): <b>95 lb/day</b>	Max lb/day POC: 16	
d. Maximum daily SO <sub>2</sub> emissions.	SO <sub>2</sub> : <b>130 lb/day</b>	Max lb/day SO <sub>2</sub> : 19 <b>In Compliance</b>		
AQ-20	<b>Cumulative combined annual</b> (any consecutive twelve-month period) <b>emissions</b> from the Gas Turbines (S-1 + S-2 + S-3 + S-4):			
	a. Maximum annual NO <sub>x</sub> (as NO <sub>2</sub> ) emissions.	NO <sub>x</sub> (as NO <sub>2</sub> ): <b>45.6 ton/year</b>	<u>Cumulative Ton/Yr</u> Ending 1/31/2026: 1.8 Ending 2/28/2026: 1.3 Ending 3/31/2026: 1.5 <b>In Compliance</b>	Attachment 9

Mariposa Energy, LLC  
CEC Quarterly Air Compliance Report

**COMPLIANCE SUMMARY**

Condition	Condition Description	Verification or Limit	Status	Section
<b>AQ-20 cont'd</b>	b. Maximum annual CO emissions.	CO: <b>27.2 ton/year</b>	Ending 1/31/2026: 0.7 Ending 2/28/2026: 0.5 Ending 3/31/2026: 0.5 <b>In Compliance</b>	Attachment 9
	c. Maximum annual POC (as CH <sub>4</sub> ) emissions.	POC (as CH <sub>4</sub> ): <b>5.6 ton/year</b>	Ending 1/31/2026: 0.1 Ending 2/28/2026: 0.1 Ending 3/31/2026: 0.1 <b>In Compliance</b>	Attachment 9
	d. Maximum annual PM <sub>10</sub> emissions.  Emissions of PM <sub>10</sub> from each gas turbine shall be calculated by multiplying turbine fuel usage times an emission factor determined by source testing of the turbine conducted in accordance with Part 26. The emission factor for each turbine shall be based on the average of the emissions rates observed during the 4 most recent source tests on that turbine (or, prior to the completion of 4 source tests on a turbine, on the average of the emission rates observed during all source tests on the turbine).	PM <sub>10</sub> : <b>18.6 ton/year</b>	Ending 1/31/2026: 0.2 Ending 2/28/2026: 0.1 Ending 3/31/2026: 0.1  <b>In Compliance</b>	Attachment 9
	e. Maximum annual SO <sub>2</sub> emissions.	SO <sub>2</sub> : <b>2.9 ton/year</b>	Ending 1/31/2026: 0.1 Ending 2/28/2026: 0.1 Ending 3/31/2026: 0.1  <b>In Compliance</b>	Attachment 9
<b>AQ-31</b>	Cumulative combined annual Sulfuric Acid Mist (SAM) emissions. (Any consecutive 12-month period) emissions from the gas turbines (S-1 + S-2 + S-3 + S-4).	<b>7.0-ton</b> Sulfuric Acid Mist in any consecutive 12-month.	<b><u>Cumulative Ton/Year</u></b> Ending 1/31/2026: 0.1 Ending 2/28/2026: 0.1 Ending 3/31/2026: 0.1 <b>In Compliance</b>	Attachment 9

Mariposa Energy, LLC  
CEC Quarterly Air Compliance Report

**COMPLIANCE SUMMARY**

Condition	Condition Description	Verification or Limit	Status	Section
AQ-35	The owner/operator of the MEP shall notify the District and the CEC CPM of any violations of these permit conditions. Notification shall be submitted in a timely manner, in accordance with all applicable District Rules, Regulations, and the Manual of Procedures. Notwithstanding the notification and reporting requirements given in any District Rule, Regulation, or the Manual of Procedures, the owner/operator shall submit written notification (facsimile is acceptable) to the Enforcement Division within 96 hours of the violation of any permit condition.	A summary of significant operation and maintenance events and monitoring records shall be included in the quarterly operation report.	No violations of any permit conditions requiring District and CEC notification were found during the 1st Quarter of 2026  <b>In Compliance</b>	Attachment 10
AQ-38	The owner/operator shall ensure that the MEP complies with the requirement to hold SO <sub>2</sub> allowances in 40 CFR 72.9c(1) and the continuous emission monitoring requirements of 40 CFR Part 75.	The project owner shall submit to the CPM and District the results of audits of the monitoring system demonstrating compliance with this condition as part of the quarterly operation report.	Attachment 11 provides the CAMD Balance Report (2/10/2026) for SO <sub>2</sub> allowances as well as the 1Q 2026 Monthly CEMS Reports summary pages as submitted to BAAQMD. <b>In Compliance</b>	Attachment 11
AQ-39	<b>Cumulative combined annual (any consecutive twelve-month period) operating hours for reliability-related testing of S-6 Emergency Standby Diesel Fire Pump Engine:</b>			
	The owner/operator shall not exceed 50 hours per year per engine for reliability-related testing.	A summary of significant operation and maintenance events and monitoring records shall be included in the quarterly operation report.	Ending 1/31/2026: 27.0 Ending 2/28/2026: 27.1 Ending 3/31/2026: 27.1  <b>In Compliance</b>	Attachment 12

Mariposa Energy, LLC  
CEC Quarterly Air Compliance Report

**COMPLIANCE SUMMARY**

Condition	Condition Description	Verification or Limit	Status	Section
AQ-40	<p><b>S-6 Emergency Standby Diesel Fire Pump Engine cumulative combined annual (any consecutive twelve-month period) total operating hours, including mitigation of emergency conditions, emissions and reliability testing:</b></p> <p>The owner/operator shall operate each emergency standby engine only for the following purposes: to mitigate emergency conditions, for emission testing to demonstrate compliance with a District, State, or Federal emission limit, or for reliability-related activities (maintenance and other testing, but excluding emission testing). Operation while mitigating emergency conditions or while emission testing to show compliance with District, State or Federal emissions limits is not limited.</p>	<p>A summary of significant operation and maintenance events and monitoring records shall be included in the quarterly operation report.</p>	<p><b>S-6</b></p> <p><u>12-Mo Hrs Ending 1/31/26:</u> Total Hrs Operated: 27.0 Hrs Op as allowed: 27.0</p> <p><u>12-Mo Hrs Ending 2/28/26:</u> Total Hrs Operated: 27.1 Hrs Op as allowed: 27.1</p> <p><u>12-Mo Hrs Ending 3/31/26:</u> Total Hrs Operated: 27.1 Hrs Op as allowed: 27.1</p> <p><b>In Compliance</b></p>	Attachment 12
AQ-41	<p><b>S-6 Emergency Standby Diesel Fire Pump Engine Non-Resettable Totalizing Hour Meter</b></p> <p>The owner/operator shall operate each emergency standby engine only when a non-resettable totalizing meter (with a minimum display capability of 9,999 hours) that measures the hours of operation for the engines is installed, operated and properly maintained.</p>	<p>The project owner shall make the site available for inspection by representatives of the District, ARB and the Commission. The project owner shall include a photograph of each totalizing meter in the quarterly operation report.</p>	<p>A photograph of each totalizing meter is included in the quarterly compliance report.</p> <p><b>In Compliance</b></p>	Attachment 13

**Attachment 2**

**Monthly Natural Gas Sulfur Content – PGE**

[Subscription Services](#)[Contact Us / Weekend on Call](#)[Rates and Tariffs](#)[About CGT](#)[Products](#)[Tools & Services](#)[Operations](#)[Reference Library](#)[INSIDetracc Login](#)[Gas Quality Information](#)[Therm Factor Heating Values](#)[Sulfur Information](#)[Gas System Sulfur Survey Results](#)

Jump to:

[2021 - 2026](#)[2016 - 2020](#)[2011 - 2015](#)[2006 - 2010](#)

# 2021 - 2026

## 2026

Date	Total Sulfur Maximum		Total Sulfur Average all sites	
	PPMv	gr/100 scf	PPMv	gr/100 scf
<b>2026</b>				
First Quarter	4.1	0.24	3.0	0.18
First Quarter - January	3.8	0.22	3.2	0.19
First Quarter - February	3.8	0.23	3.0	0.18
First Quarter - March	4.1	0.24	2.8	0.17

**Attachment 3**

**Condition AQ-12: Heat Input Report – Max 1-hour**

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
January 1, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
January 2, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
January 3, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
January 4, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
January 5, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
January 6, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
January 7, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
January 8, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
January 9, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
January 10, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
January 11, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
January 12, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
January 13, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
January 14, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	8.5	0.10	8.5	0.10
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	Down	0.00	Down	0.00	Down	0.00	8.5	0.10	8.5	0.10

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
January 15, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	8.1	0.10	Down	0.00	Down	0.00	8.1	0.10
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	7.0	0.08	Down	0.00	7.0	0.08
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	Down	0.00	8.1	0.10	7.0	0.08	Down	0.00	15.1	0.18

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
January 16, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	6.8	0.08	Down	0.00	Down	0.00	Down	0.00	6.8	0.08
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	6.8	0.08	Down	0.00	Down	0.00	Down	0.00	6.8	0.08

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
January 17, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
January 18, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
January 19, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
January 20, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
January 21, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
January 22, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
January 23, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
January 24, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	13.4	0.07	13.5	0.07	13.4	0.07	13.5	0.07	53.8	0.28
23	352.8	1.00	340.8	1.00	368.8	1.00	355.0	1.00	1417.4	4.00
Daily Total	366.2	1.07	354.3	1.07	382.2	1.07	368.5	1.07	1471.2	4.28

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
January 25, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	440.5	1.00	462.2	1.00	449.0	1.00	406.2	1.00	1757.9	4.00
01	454.2	1.00	461.0	1.00	458.3	1.00	450.7	1.00	1824.2	4.00
02	455.5	1.00	462.1	1.00	459.6	1.00	238.1	0.63	1615.3	3.63
03	454.9	1.00	461.2	1.00	458.6	1.00	<b>Down</b>	0.00	1374.7	3.00
04	453.7	1.00	460.1	1.00	456.9	1.00	35.4	0.12	1406.1	3.12
05	453.9	1.00	461.0	1.00	458.1	1.00	397.8	1.00	1770.8	4.00
06	455.2	1.00	462.8	1.00	459.8	1.00	421.8	1.00	1799.6	4.00
07	396.6	1.00	401.7	1.00	372.7	1.00	368.9	1.00	1539.9	4.00
08	12.1	0.12	11.5	0.12	12.6	0.12	12.1	0.12	48.3	0.48
09	<b>Down</b>	0.00	<b>Down</b>	0.00	<b>Down</b>	0.00	<b>Down</b>	0.00	<b>Down</b>	0.00
10	<b>Down</b>	0.00	<b>Down</b>	0.00	<b>Down</b>	0.00	<b>Down</b>	0.00	<b>Down</b>	0.00
11	<b>Down</b>	0.00	<b>Down</b>	0.00	<b>Down</b>	0.00	<b>Down</b>	0.00	<b>Down</b>	0.00
12	<b>Down</b>	0.00	<b>Down</b>	0.00	<b>Down</b>	0.00	<b>Down</b>	0.00	<b>Down</b>	0.00
13	<b>Down</b>	0.00	<b>Down</b>	0.00	<b>Down</b>	0.00	<b>Down</b>	0.00	<b>Down</b>	0.00
14	<b>Down</b>	0.00	<b>Down</b>	0.00	<b>Down</b>	0.00	<b>Down</b>	0.00	<b>Down</b>	0.00
15	<b>Down</b>	0.00	<b>Down</b>	0.00	<b>Down</b>	0.00	<b>Down</b>	0.00	<b>Down</b>	0.00
16	247.7	0.57	250.8	0.57	247.6	0.57	229.1	0.57	975.2	2.28
17	461.8	1.00	469.0	1.00	464.0	1.00	433.6	1.00	1828.4	4.00
18	451.3	1.00	458.3	1.00	452.9	1.00	433.9	1.00	1796.4	4.00
19	452.7	1.00	457.4	1.00	454.7	1.00	436.8	1.00	1801.6	4.00
20	454.0	1.00	459.9	1.00	457.3	1.00	434.8	1.00	1806.0	4.00
21	372.4	0.92	377.7	0.92	376.6	0.92	354.8	0.92	1481.5	3.68
22	<b>Down</b>	0.00	<b>Down</b>	0.00	<b>Down</b>	0.00	<b>Down</b>	0.00	<b>Down</b>	0.00
23	<b>Down</b>	0.00	<b>Down</b>	0.00	<b>Down</b>	0.00	<b>Down</b>	0.00	<b>Down</b>	0.00
Daily Total	6016.5	13.61	6116.7	13.61	6038.7	13.61	4654.0	11.36	22825.9	52.19

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
January 26, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	361.2	0.82	366.3	0.82	363.6	0.82	347.7	0.82	1438.8	3.28
07	453.1	1.00	454.0	1.00	457.3	1.00	429.9	1.00	1794.3	4.00
08	127.7	0.38	134.5	0.40	141.3	0.40	139.7	0.42	543.2	1.60
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	15.7	0.07	16.0	0.07	15.3	0.07	13.6	0.07	60.6	0.28
18	450.5	1.00	465.4	1.00	463.9	1.00	381.5	1.00	1761.3	4.00
19	450.0	1.00	465.8	1.00	464.5	1.00	419.6	1.00	1799.9	4.00
20	451.1	1.00	460.8	1.00	464.8	1.00	422.4	1.00	1799.1	4.00
21	449.6	1.00	457.8	1.00	464.2	1.00	421.9	1.00	1793.5	4.00
22	257.7	0.67	276.4	0.70	285.4	0.72	264.0	0.72	1083.5	2.81
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	3016.6	6.94	3097.0	6.99	3120.3	7.01	2840.3	7.03	12074.2	27.97

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
January 27, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	237.8	0.55	239.4	0.55	237.9	0.55	202.2	0.55	917.3	2.20
19	456.2	1.00	460.9	1.00	458.6	1.00	425.1	1.00	1800.8	4.00
20	456.0	1.00	461.6	1.00	459.1	1.00	427.5	1.00	1804.2	4.00
21	455.9	1.00	461.5	1.00	459.8	1.00	429.3	1.00	1806.5	4.00
22	175.9	0.48	147.8	0.42	154.2	0.43	148.1	0.43	626.0	1.76
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	1781.8	4.03	1771.2	3.97	1769.6	3.98	1632.2	3.98	6954.8	15.96

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
January 28, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
January 29, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
January 30, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
January 31, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
February 1, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
February 2, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
February 3, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	29.5	0.17	29.5	0.17
20	Down	0.00	Down	0.00	Down	0.00	2.5	0.02	2.5	0.02
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	Down	0.00	Down	0.00	Down	0.00	32.0	0.19	32.0	0.19

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
February 4, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
February 5, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
February 6, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	344.8	0.80	Down	0.00	349.4	0.80	303.0	0.80	997.2	2.40
07	248.0	0.65	Down	0.00	257.3	0.67	231.8	0.67	737.1	1.99
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	592.8	1.45	Down	0.00	606.7	1.47	534.8	1.47	1734.3	4.39

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
February 7, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
February 8, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
February 9, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
February 10, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
February 11, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
February 12, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
February 13, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
February 14, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
February 15, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
February 16, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
February 17, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	10.1	0.05	Down	0.00	Down	0.00	Down	0.00	10.1	0.05
16	286.9	1.00	Down	0.00	Down	0.00	Down	0.00	286.9	1.00
17	406.5	1.00	Down	0.00	Down	0.00	Down	0.00	406.5	1.00
18	328.0	1.00	Down	0.00	Down	0.00	Down	0.00	328.0	1.00
19	16.1	0.13	Down	0.00	Down	0.00	Down	0.00	16.1	0.13
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	1047.6	3.18	Down	0.00	Down	0.00	Down	0.00	1047.6	3.18

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
February 18, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	13.6	0.07	Down	0.00	Down	0.00	13.6	0.07
16	Down	0.00	290.3	1.00	Down	0.00	Down	0.00	290.3	1.00
17	Down	0.00	395.7	1.00	Down	0.00	Down	0.00	395.7	1.00
18	Down	0.00	345.1	1.00	Down	0.00	Down	0.00	345.1	1.00
19	Down	0.00	6.9	0.08	Down	0.00	Down	0.00	6.9	0.08
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	Down	0.00	1051.6	3.15	Down	0.00	Down	0.00	1051.6	3.15

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
February 19, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	13.7	0.07	Down	0.00	13.7	0.07
16	Down	0.00	Down	0.00	297.1	1.00	Down	0.00	297.1	1.00
17	Down	0.00	Down	0.00	378.5	1.00	Down	0.00	378.5	1.00
18	Down	0.00	Down	0.00	279.6	1.00	Down	0.00	279.6	1.00
19	Down	0.00	Down	0.00	282.3	1.00	Down	0.00	282.3	1.00
20	Down	0.00	Down	0.00	13.8	0.12	Down	0.00	13.8	0.12
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	Down	0.00	Down	0.00	1265.0	4.19	Down	0.00	1265.0	4.19

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
February 20, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	71.1	0.28	71.1	0.28
16	13.1	0.07	13.1	0.07	Down	0.00	278.0	1.00	304.2	1.14
17	268.9	1.00	273.5	1.00	Down	0.00	353.4	1.00	895.8	3.00
18	294.8	1.00	299.1	1.00	Down	0.00	371.7	1.00	965.6	3.00
19	276.0	1.00	282.1	1.00	Down	0.00	405.2	1.00	963.3	3.00
20	13.4	0.12	14.8	0.13	Down	0.00	407.5	1.00	435.7	1.25
21	Down	0.00	Down	0.00	Down	0.00	64.1	0.28	64.1	0.28
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	866.2	3.19	882.6	3.20	Down	0.00	1951.0	5.56	3699.8	11.95

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
February 21, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
February 22, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
February 23, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
February 24, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
February 25, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
February 26, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
February 27, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
February 28, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
March 1, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
March 2, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	8.3	0.05	Down	0.00	Down	0.00	Down	0.00	8.3	0.05
12	273.5	1.00	Down	0.00	Down	0.00	Down	0.00	273.5	1.00
13	276.4	1.00	Down	0.00	Down	0.00	Down	0.00	276.4	1.00
14	277.8	1.00	Down	0.00	Down	0.00	Down	0.00	277.8	1.00
15	280.2	1.00	Down	0.00	Down	0.00	Down	0.00	280.2	1.00
16	282.8	1.00	Down	0.00	Down	0.00	Down	0.00	282.8	1.00
17	278.8	1.00	Down	0.00	Down	0.00	Down	0.00	278.8	1.00
18	21.6	0.15	Down	0.00	Down	0.00	Down	0.00	21.6	0.15
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	1699.4	6.20	Down	0.00	Down	0.00	Down	0.00	1699.4	6.20

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
March 3, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	8.7	0.05	Down	0.00	Down	0.00	Down	0.00	8.7	0.05
08	390.0	1.00	Down	0.00	Down	0.00	Down	0.00	390.0	1.00
09	390.4	1.00	Down	0.00	Down	0.00	Down	0.00	390.4	1.00
10	390.8	1.00	Down	0.00	Down	0.00	Down	0.00	390.8	1.00
11	392.0	1.00	Down	0.00	Down	0.00	Down	0.00	392.0	1.00
12	393.5	1.00	Down	0.00	Down	0.00	Down	0.00	393.5	1.00
13	392.3	1.00	Down	0.00	Down	0.00	Down	0.00	392.3	1.00
14	392.9	1.00	Down	0.00	Down	0.00	Down	0.00	392.9	1.00
15	391.0	1.00	Down	0.00	Down	0.00	Down	0.00	391.0	1.00
16	394.8	1.00	Down	0.00	Down	0.00	Down	0.00	394.8	1.00
17	392.6	1.00	Down	0.00	Down	0.00	Down	0.00	392.6	1.00
18	24.9	0.15	Down	0.00	Down	0.00	Down	0.00	24.9	0.15
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	3953.9	10.20	Down	0.00	Down	0.00	Down	0.00	3953.9	10.20

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
March 4, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	8.8	0.05	Down	0.00	Down	0.00	8.8	0.05
12	Down	0.00	279.5	1.00	Down	0.00	Down	0.00	279.5	1.00
13	Down	0.00	280.4	1.00	Down	0.00	Down	0.00	280.4	1.00
14	Down	0.00	279.0	1.00	Down	0.00	Down	0.00	279.0	1.00
15	Down	0.00	279.1	1.00	Down	0.00	Down	0.00	279.1	1.00
16	8.3	0.05	317.6	1.00	8.1	0.05	Down	0.00	334.0	1.10
17	258.3	1.00	288.2	1.00	262.7	1.00	Down	0.00	809.2	3.00
18	20.3	0.15	21.5	0.15	21.2	0.15	Down	0.00	63.0	0.45
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	286.9	1.20	1754.1	6.20	292.0	1.20	Down	0.00	2333.0	8.60

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
March 5, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	8.6	0.05	Down	0.00	Down	0.00	8.6	0.05
08	Down	0.00	392.3	1.00	Down	0.00	Down	0.00	392.3	1.00
09	Down	0.00	395.5	1.00	Down	0.00	Down	0.00	395.5	1.00
10	Down	0.00	397.0	1.00	Down	0.00	Down	0.00	397.0	1.00
11	Down	0.00	397.7	1.00	Down	0.00	Down	0.00	397.7	1.00
12	Down	0.00	398.2	1.00	Down	0.00	Down	0.00	398.2	1.00
13	Down	0.00	397.4	1.00	Down	0.00	Down	0.00	397.4	1.00
14	Down	0.00	398.1	1.00	Down	0.00	Down	0.00	398.1	1.00
15	Down	0.00	394.6	1.00	Down	0.00	Down	0.00	394.6	1.00
16	Down	0.00	399.2	1.00	Down	0.00	Down	0.00	399.2	1.00
17	Down	0.00	391.6	1.00	Down	0.00	Down	0.00	391.6	1.00
18	Down	0.00	24.5	0.15	Down	0.00	Down	0.00	24.5	0.15
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	Down	0.00	3994.7	10.20	Down	0.00	Down	0.00	3994.7	10.20

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
March 6, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	8.7	0.05	8.7	0.05
12	Down	0.00	Down	0.00	Down	0.00	270.7	1.00	270.7	1.00
13	Down	0.00	Down	0.00	Down	0.00	271.1	1.00	271.1	1.00
14	Down	0.00	Down	0.00	Down	0.00	271.5	1.00	271.5	1.00
15	Down	0.00	Down	0.00	Down	0.00	275.7	1.00	275.7	1.00
16	Down	0.00	Down	0.00	8.8	0.05	307.6	1.00	316.4	1.05
17	Down	0.00	Down	0.00	267.3	1.00	266.9	1.00	534.2	2.00
18	Down	0.00	Down	0.00	21.2	0.15	21.2	0.15	42.4	0.30
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	Down	0.00	Down	0.00	297.3	1.20	1693.4	6.20	1990.7	7.40

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
March 7, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
March 8, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
March 9, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	9.7	0.05	9.7	0.05
07	Down	0.00	Down	0.00	Down	0.00	359.6	1.00	359.6	1.00
08	Down	0.00	Down	0.00	Down	0.00	408.1	1.00	408.1	1.00
09	Down	0.00	Down	0.00	Down	0.00	409.0	1.00	409.0	1.00
10	Down	0.00	Down	0.00	Down	0.00	409.3	1.00	409.3	1.00
11	Down	0.00	Down	0.00	Down	0.00	409.3	1.00	409.3	1.00
12	Down	0.00	Down	0.00	Down	0.00	409.8	1.00	409.8	1.00
13	Down	0.00	Down	0.00	Down	0.00	407.3	1.00	407.3	1.00
14	Down	0.00	Down	0.00	Down	0.00	408.1	1.00	408.1	1.00
15	Down	0.00	Down	0.00	Down	0.00	408.9	1.00	408.9	1.00
16	Down	0.00	Down	0.00	Down	0.00	413.3	1.00	413.3	1.00
17	Down	0.00	Down	0.00	Down	0.00	115.3	0.37	115.3	0.37
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	Down	0.00	Down	0.00	Down	0.00	4167.7	10.42	4167.7	10.42

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
March 10, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	9.1	0.05	9.0	0.05	Down	0.00	18.1	0.10
07	Down	0.00	264.5	1.00	263.4	1.00	Down	0.00	527.9	2.00
08	Down	0.00	264.8	1.00	263.8	1.00	Down	0.00	528.6	2.00
09	Down	0.00	266.2	1.00	265.4	1.00	Down	0.00	531.6	2.00
10	Down	0.00	87.6	0.40	265.8	1.00	Down	0.00	353.4	1.40
11	Down	0.00	Down	0.00	279.9	1.00	Down	0.00	279.9	1.00
12	Down	0.00	Down	0.00	285.3	1.00	Down	0.00	285.3	1.00
13	Down	0.00	Down	0.00	282.5	1.00	Down	0.00	282.5	1.00
14	Down	0.00	Down	0.00	285.6	1.00	Down	0.00	285.6	1.00
15	Down	0.00	Down	0.00	284.0	1.00	Down	0.00	284.0	1.00
16	Down	0.00	Down	0.00	286.2	1.00	Down	0.00	286.2	1.00
17	Down	0.00	Down	0.00	22.0	0.15	Down	0.00	22.0	0.15
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	Down	0.00	892.2	3.45	2792.9	10.20	Down	0.00	3685.1	13.65

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
March 11, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	9.1	0.05	Down	0.00	9.1	0.05
11	Down	0.00	Down	0.00	288.3	1.00	Down	0.00	288.3	1.00
12	Down	0.00	Down	0.00	290.6	1.00	Down	0.00	290.6	1.00
13	Down	0.00	Down	0.00	291.3	1.00	Down	0.00	291.3	1.00
14	Down	0.00	Down	0.00	292.1	1.00	Down	0.00	292.1	1.00
15	Down	0.00	Down	0.00	293.4	1.00	Down	0.00	293.4	1.00
16	Down	0.00	Down	0.00	294.2	1.00	Down	0.00	294.2	1.00
17	Down	0.00	Down	0.00	22.3	0.15	Down	0.00	22.3	0.15
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	Down	0.00	Down	0.00	1781.3	6.20	Down	0.00	1781.3	6.20

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
March 12, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	4.9	0.03	Down	0.00	4.9	0.03
07	Down	0.00	Down	0.00	399.7	1.00	Down	0.00	399.7	1.00
08	Down	0.00	Down	0.00	401.8	1.00	Down	0.00	401.8	1.00
09	Down	0.00	Down	0.00	403.4	1.00	Down	0.00	403.4	1.00
10	Down	0.00	Down	0.00	407.2	1.00	Down	0.00	407.2	1.00
11	Down	0.00	Down	0.00	409.8	1.00	Down	0.00	409.8	1.00
12	Down	0.00	Down	0.00	409.2	1.00	Down	0.00	409.2	1.00
13	Down	0.00	Down	0.00	408.6	1.00	Down	0.00	408.6	1.00
14	Down	0.00	Down	0.00	407.0	1.00	Down	0.00	407.0	1.00
15	Down	0.00	Down	0.00	408.5	1.00	Down	0.00	408.5	1.00
16	Down	0.00	Down	0.00	411.7	1.00	Down	0.00	411.7	1.00
17	Down	0.00	Down	0.00	21.8	0.15	Down	0.00	21.8	0.15
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	Down	0.00	Down	0.00	4093.6	10.18	Down	0.00	4093.6	10.18

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
March 13, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	8.6	0.05	Down	0.00	8.6	0.05
07	Down	0.00	Down	0.00	396.4	1.00	Down	0.00	396.4	1.00
08	Down	0.00	Down	0.00	408.0	1.00	Down	0.00	408.0	1.00
09	Down	0.00	Down	0.00	408.9	1.00	Down	0.00	408.9	1.00
10	Down	0.00	Down	0.00	409.7	1.00	Down	0.00	409.7	1.00
11	Down	0.00	Down	0.00	410.6	1.00	Down	0.00	410.6	1.00
12	142.8	0.55	Down	0.00	350.5	1.00	Down	0.00	493.3	1.55
13	155.9	0.65	Down	0.00	159.0	0.65	Down	0.00	314.9	1.30
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	298.7	1.20	Down	0.00	2551.7	6.70	Down	0.00	2850.4	7.90

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
March 14, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
March 15, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
March 16, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
March 17, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
March 18, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
March 19, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	122.1	0.47	124.2	0.47	124.4	0.47	123.4	0.47	494.1	1.88
18	272.2	1.00	276.7	1.00	277.5	1.00	274.5	1.00	1100.9	4.00
19	15.8	0.13	16.7	0.13	16.5	0.13	16.3	0.13	65.3	0.52
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	410.1	1.60	417.6	1.60	418.4	1.60	414.2	1.60	1660.3	6.40

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
March 20, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
March 21, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	64.0	0.25	65.3	0.25	64.9	0.25	63.6	0.25	257.8	1.00
12	228.3	0.90	229.2	0.90	229.0	0.90	224.6	0.90	911.1	3.60
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	292.3	1.15	294.5	1.15	293.9	1.15	288.2	1.15	1168.9	4.60

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
March 22, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
March 23, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	245.8	0.80	251.1	0.80	250.3	0.80	221.4	0.80	968.6	3.20
14	84.1	0.38	89.9	0.40	89.6	0.40	86.8	0.40	350.4	1.58
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	329.9	1.18	341.0	1.20	339.9	1.20	308.2	1.20	1319.0	4.78

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
March 24, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
March 25, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
March 26, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
March 27, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
March 28, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	5.5	0.03	5.7	0.03	5.3	0.03	5.5	0.03	22.0	0.12
22	415.0	1.00	425.6	1.00	411.4	1.00	367.0	1.00	1619.0	4.00
23	448.6	1.00	455.6	1.00	410.6	1.00	414.2	1.00	1729.0	4.00
Daily Total	869.1	2.03	886.9	2.03	827.3	2.03	786.7	2.03	3370.0	8.12

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
March 29, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	273.3	1.00	277.2	1.00	274.0	1.00	274.8	1.00	1099.3	4.00
01	259.2	1.00	263.1	1.00	262.6	1.00	260.3	1.00	1045.2	4.00
02	311.8	1.00	292.5	1.00	144.0	0.62	257.9	1.00	1006.2	3.62
03	299.2	1.00	298.7	1.00	135.7	0.55	256.4	1.00	990.0	3.55
04	251.3	1.00	255.9	1.00	257.6	1.00	256.6	1.00	1021.4	4.00
05	254.7	1.00	259.0	1.00	260.8	1.00	260.2	1.00	1034.7	4.00
06	257.6	1.00	261.9	1.00	261.8	1.00	261.6	1.00	1042.9	4.00
07	261.2	1.00	265.8	1.00	263.8	1.00	263.6	1.00	1054.4	4.00
08	258.8	1.00	262.9	1.00	261.0	1.00	260.9	1.00	1043.6	4.00
09	23.1	0.17	24.9	0.17	25.3	0.17	25.2	0.17	98.5	0.68
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	2450.2	9.17	2461.9	9.17	2146.6	8.34	2377.5	9.17	9436.2	35.85

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
March 30, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00

**Mariposa Energy**  
Byron California  
**Facility Daily Operations Report**  
March 31, 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Hour	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
00	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Daily Total	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00

**Attachment 4**  
**Condition AQ-13: Heat Input Report – Daily**  
**Condition AQ-14 Heat Input Limit:**  
**Rolling 12-Month Combined CTG Heat Input Report**  
**and**  
**Condition AQ-15a/b Operating Hour Limits:**  
**Rolling 12-Month Individual and Combined CTG Hours Report**

**Mariposa Energy**  
Byron California  
**Facility Monthly Operations Report**  
January - 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900      Unit Op Hours - 16,900

---

Day	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	8.5	0.10	8.5	0.10
15	Down	0.00	8.1	0.10	7.0	0.08	Down	0.00	15.1	0.18
16	6.8	0.08	Down	0.00	Down	0.00	Down	0.00	6.8	0.08
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
24	366.2	1.07	354.3	1.07	382.2	1.07	368.5	1.07	1471.2	4.28
25	6016.5	13.61	6116.7	13.61	6038.7	13.61	4654.0	11.36	22825.9	52.19
26	3016.6	6.94	3097.0	6.99	3120.3	7.01	2840.3	7.03	12074.2	27.97
27	1781.8	4.03	1771.2	3.97	1769.6	3.98	1632.2	3.98	6954.8	15.96
28	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
29	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
30	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
31	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Monthly Total	11187.9	25.7	11347.3	25.7	11317.8	25.8	9503.5	23.5	43356.5	100.76
12-Month Rolling	89463.6	234.6	78933.4	214.6	90520.9	237.1	62523.6	185.9	321441.5	871.7

# Mariposa Energy

Byron California

## Facility Monthly Operations Report

February - 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900                      Unit Op Hours - 16,900

---

Day	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
03	Down	0.00	Down	0.00	Down	0.00	32.0	0.19	32.0	0.19
04	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
05	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
06	592.8	1.45	Down	0.00	606.7	1.47	534.8	1.47	1734.3	4.39
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
10	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
11	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
12	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
13	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	1047.6	3.18	Down	0.00	Down	0.00	Down	0.00	1047.6	3.18
18	Down	0.00	1051.6	3.15	Down	0.00	Down	0.00	1051.6	3.15
19	Down	0.00	Down	0.00	1265.0	4.19	Down	0.00	1265.0	4.19
20	866.2	3.19	882.6	3.20	Down	0.00	1951.0	5.56	3699.8	11.95
21	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
24	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
25	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
26	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
27	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
28	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Monthly Total	2506.6	7.8	1934.2	6.4	1871.7	5.7	2517.8	7.2	8830.3	27.05
12-Month Rolling	62495.6	164.9	59394.9	159.9	59053.7	155.0	40089.0	121.6	221033.2	601.0

**Mariposa Energy**  
Byron California  
**Facility Monthly Operations Report**  
March - 2026

---

**Facility 12-Month Rolling Operational Limits**  
Heat Input mmBtu - 8,128,900      Unit Op Hours - 16,900

---

Day	Unit 600		Unit 700		Unit 800		Unit 900		Facility Totals	
	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours	Heat Input mmBtu	Unit Op Hours
01	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
02	1699.4	6.20	Down	0.00	Down	0.00	Down	0.00	1699.4	6.20
03	3953.9	10.20	Down	0.00	Down	0.00	Down	0.00	3953.9	10.20
04	286.9	1.20	1754.1	6.20	292.0	1.20	Down	0.00	2333.0	8.60
05	Down	0.00	3994.7	10.20	Down	0.00	Down	0.00	3994.7	10.20
06	Down	0.00	Down	0.00	297.3	1.20	1693.4	6.20	1990.7	7.40
07	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
08	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
09	Down	0.00	Down	0.00	Down	0.00	4167.7	10.42	4167.7	10.42
10	Down	0.00	892.2	3.45	2792.9	10.20	Down	0.00	3685.1	13.65
11	Down	0.00	Down	0.00	1781.3	6.20	Down	0.00	1781.3	6.20
12	Down	0.00	Down	0.00	4093.6	10.18	Down	0.00	4093.6	10.18
13	298.7	1.20	Down	0.00	2551.7	6.70	Down	0.00	2850.4	7.90
14	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
15	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
16	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
17	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
18	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
19	410.1	1.60	417.6	1.60	418.4	1.60	414.2	1.60	1660.3	6.40
20	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
21	292.3	1.15	294.5	1.15	293.9	1.15	288.2	1.15	1168.9	4.60
22	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
23	329.9	1.18	341.0	1.20	339.9	1.20	308.2	1.20	1319.0	4.78
24	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
25	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
26	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
27	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
28	869.1	2.03	886.9	2.03	827.3	2.03	786.7	2.03	3370.0	8.12
29	2450.2	9.17	2461.9	9.17	2146.6	8.34	2377.5	9.17	9436.2	35.85
30	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
31	Down	0.00	Down	0.00	Down	0.00	Down	0.00	Down	0.00
Monthly Total	10590.5	33.9	11042.9	35.0	15834.9	50.0	10035.9	31.8	47504.2	150.70
12-Month Rolling	69936.2	186.8	67685.2	184.7	71811.7	194.9	48460.5	147.0	257893.6	713.0

**Attachment 5**

**Condition AQ-16: SCR/Oxidation Catalyst Operation Report**

## Condition AQ-16: SCR/Oxidation Catalyst Operation Report

Permit to Operate Condition 24955 part 16 (AQ-16) states:

*The owner/operator shall ensure that each Gas Turbine (S-1, S-2, S-3, S-4) is abated by the properly operated and properly maintained Selective Catalytic Reduction (SCR) System A-2, A-4, A-6 or A-8 and. Oxidation Catalyst System A-1, A-3, A-5, or A-7 whenever fuel is combusted at those sources and the corresponding SCR catalyst bed (A-2, A-4, A-6 or A-8) has reached minimum operating temperature.*

The emission reports presented in Attachments 7, 8, 12, and 13 demonstrate that the gas turbines are operating properly as abated by the Catalytic Reduction (SCR) System A-2, A-4, A-6 or A-8 and Oxidation Catalyst System A-1, A-3, A-5, or A-7 and demonstrate compliance with Condition 24955 parts AQ-17a, 17b, 17c, 17d, 19, and 20.

Demonstration of operation above the minimum catalyst bed temperature is demonstrated by compliance with BAAQMD ATC Condition 24955, parts AQ-17a, 17b, 17c, 17d, 19, and 20.

**Attachment 6**

**Condition AQ-17a/b NO<sub>x</sub> Emission Limits:**

**Hourly Mass Rate and Hourly Average  
Concentration Report**

**Condition AQ-17c/d CO Emission Limits:**

**Hourly Mass Rate/Rolling 3-Hr Concentration Report**

**Condition AQ-17e NH<sub>3</sub> Emission Limits:**

**Rolling 3-Hr Slip Calculation Report**

**Condition AQ-17f/g Hourly Mass Emission Limits:**

**POC & SO<sub>2</sub> Report**

**Mariposa Energy**  
Byron California  
**Unit 600 Monthly BAAQMD Emissions Report**  
January - 2026

Day	Hourly Emission Limits						3-Hour Rolling Emission Limit			
	Max 1-Hr Norm Ops NOx lbs	Max 1-Hr SU/SD NOx lbs	Max 1-Hr Norm Ops NOx ppm @15% O2	Max 1-Hr Norm Ops CO lbs	Max 1-Hr SU/SD CO lbs	Max 3-Hr Rolling Norm Ops CO ppm @15% O2	Max 3-Hr Rolling Norm Ops NH3 Slip ppm @15% O2	Max 1-Hr Norm Ops POC lbs	Max 1-Hr SU/SD POC lbs	Max 1-Hr SO2 lbs
01/01/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/02/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/03/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/04/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/05/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/06/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/07/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/08/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/09/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/10/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/11/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/12/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/13/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/14/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/15/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/16/2026	N/A	1.5	0.0	N/A	1.1	N/A	Down	0.0	0.0	0.0
01/17/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/18/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/19/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/20/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/21/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/22/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/23/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/24/2026	2.6	5.1	1.9	1.1	1.6	1.4	NSD	0.3	0.3	0.5
01/25/2026	4.0	5.4	2.4	1.9	2.0	1.8	3.7	0.3	0.3	0.7
01/26/2026	4.0	6.6	2.4	1.9	2.6	1.8	3.3	0.3	0.3	0.6
01/27/2026	4.0	5.7	2.4	1.9	2.1	1.8	2.4	0.3	0.2	0.6
01/28/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/29/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/30/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/31/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
Monthly Max	4.0	6.6	2.4	1.9	2.6	1.8	3.7	0.3	0.3	0.7

**Mariposa Energy**  
Byron California  
**Unit 600 Monthly BAAQMD Emissions Report**  
February - 2026

Day	Hourly Emission Limits						3-Hour Rolling Emission Limit			
	Max 1-Hr Norm Ops NOx lbs	Max 1-Hr SU/SD NOx lbs	Max 1-Hr Norm Ops NOx ppm @15% O2	Max 1-Hr Norm Ops CO lbs	Max 1-Hr SU/SD CO lbs	Max 3-Hr Rolling Norm Ops CO ppm @15% O2	Max 3-Hr Rolling Norm Ops NH3 Slip ppm @15% O2	Max 1-Hr Norm Ops POC lbs	Max 1-Hr SU/SD POC lbs	Max 1-Hr SO2 lbs
02/01/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/02/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/03/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/04/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/05/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/06/2026	1.9	9.3	1.2	0.9	2.3	1.8	NSD	0.2	0.2	0.5
02/07/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/08/2026	N/A	Down	DMaint	N/A	Down	N/A	DMaint	Down	Down	Down
02/09/2026	N/A	Down	DMaint	N/A	Down	N/A	DMaint	Down	Down	Down
02/10/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/11/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/12/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/13/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/14/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/15/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/16/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/17/2026	3.3	4.0	2.2	1.6	1.0	1.7	3.1	0.3	0.2	0.6
02/18/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/19/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/20/2026	2.4	3.8	2.2	1.2	1.7	1.7	2.8	0.2	0.2	0.4
02/21/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/22/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/23/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/24/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/25/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/26/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/27/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/28/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
Monthly Max	3.3	9.3	2.2	1.6	2.3	1.8	3.1	0.3	0.2	0.6

**Mariposa Energy**  
Byron California  
**Unit 600 Monthly BAAQMD Emissions Report**  
March - 2026

Day	Hourly Emission Limits						3-Hour Rolling Emission Limit			
	Max 1-Hr Norm Ops NOx lbs	Max 1-Hr SU/SD NOx lbs	Max 1-Hr Norm Ops NOx ppm @15% O2	Max 1-Hr Norm Ops CO lbs	Max 1-Hr SU/SD CO lbs	Max 3-Hr Rolling Norm Ops CO ppm @15% O2	Max 3-Hr Rolling Norm Ops NH3 Slip ppm @15% O2	Max 1-Hr Norm Ops POC lbs	Max 1-Hr SU/SD POC lbs	Max 1-Hr SO2 lbs
03/01/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/02/2026	2.3	4.0	2.2	1.1	1.4	1.8	3.0	0.2	0.2	0.4
03/03/2026	3.2	4.9	2.2	1.6	1.5	1.8	3.7	0.3	0.3	0.6
03/04/2026	1.5	3.7	1.5	0.7	1.4	1.8	NSD	0.2	0.2	0.4
03/05/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/06/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/07/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/08/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/09/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/10/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/11/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/12/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/13/2026	1.2	3.9	1.2	0.5	1.5	1.7	NSD	0.1	0.1	0.2
03/14/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/15/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/16/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/17/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/18/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/19/2026	2.2	4.7	2.2	1.1	0.9	1.6	1.0	0.2	0.1	0.4
03/20/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/21/2026	1.6	4.6	1.6	0.9	1.5	1.7	NSD	0.2	0.2	0.3
03/22/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/23/2026	1.2	5.8	1.2	0.4	1.1	1.7	NSD	0.2	0.2	0.3
03/24/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/25/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/26/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/27/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/28/2026	3.9	5.9	2.4	1.8	1.7	1.6	NSD	0.3	0.3	0.6
03/29/2026	2.6	0.9	2.3	1.1	0.1	1.8	3.8	0.2	0.0	0.4
03/30/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/31/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
Monthly Max	3.9	5.9	2.4	1.8	1.7	1.8	3.8	0.3	0.3	0.6

**Mariposa Energy**  
Byron California  
**Unit 700 Monthly BAAQMD Emissions Report**  
January - 2026

Day	Hourly Emission Limits						3-Hour Rolling Emission Limit			
	Max 1-Hr Norm Ops NOx lbs	Max 1-Hr SU/SD NOx lbs	Max 1-Hr Norm Ops NOx ppm @15% O2	Max 1-Hr Norm Ops CO lbs	Max 1-Hr SU/SD CO lbs	Max 3-Hr Rolling Norm Ops CO ppm @15% O2	Max 3-Hr Rolling Norm Ops NH3 Slip ppm @15% O2	Max 1-Hr Norm Ops POC lbs	Max 1-Hr SU/SD POC lbs	Max 1-Hr SO2 lbs
01/01/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/02/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/03/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/04/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/05/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/06/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/07/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/08/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/09/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/10/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/11/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/12/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/13/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/14/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/15/2026	N/A	1.7	0.0	N/A	1.4	N/A	Down	0.0	0.0	0.0
01/16/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/17/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/18/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/19/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/20/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/21/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/22/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/23/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/24/2026	2.3	5.0	1.6	0.9	1.7	1.5	NSD	0.2	0.2	0.2
01/25/2026	4.0	4.7	2.3	2.0	2.2	1.8	3.1	0.3	0.3	0.3
01/26/2026	3.8	6.8	2.3	1.9	2.7	1.8	2.9	0.3	0.3	0.3
01/27/2026	3.6	5.6	2.2	1.9	2.1	1.8	2.1	0.3	0.2	0.3
01/28/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/29/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/30/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/31/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
Monthly Max	4.0	6.8	2.3	2.0	2.7	1.8	3.1	0.3	0.3	0.3

**Mariposa Energy**  
Byron California  
**Unit 700 Monthly BAAQMD Emissions Report**  
February - 2026

Day	Hourly Emission Limits						3-Hour Rolling Emission Limit			
	Max 1-Hr Norm Ops NOx lbs	Max 1-Hr SU/SD NOx lbs	Max 1-Hr Norm Ops NOx ppm @15% O2	Max 1-Hr Norm Ops CO lbs	Max 1-Hr SU/SD CO lbs	Max 3-Hr Rolling Norm Ops CO ppm @15% O2	Max 3-Hr Rolling Norm Ops NH3 Slip ppm @15% O2	Max 1-Hr Norm Ops POC lbs	Max 1-Hr SU/SD POC lbs	Max 1-Hr SO2 lbs
02/01/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/02/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/03/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/04/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/05/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/06/2026	N/A	Down	DMaint	N/A	Down	N/A	DMaint	Down	Down	Down
02/07/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/08/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/09/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/10/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/11/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/12/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/13/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/14/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/15/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/16/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/17/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/18/2026	2.9	4.1	2.0	1.5	2.1	1.8	2.5	0.3	0.2	0.2
02/19/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/20/2026	2.4	4.0	2.2	1.1	1.9	1.6	2.2	0.2	0.2	0.2
02/21/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/22/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/23/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/24/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/25/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/26/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/27/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/28/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
Monthly Max	2.9	4.1	2.2	1.5	2.1	1.8	2.5	0.3	0.2	0.2

**Mariposa Energy**  
Byron California  
**Unit 700 Monthly BAAQMD Emissions Report**  
March - 2026

Day	Hourly Emission Limits						3-Hour Rolling Emission Limit			
	Max 1-Hr Norm Ops NOx lbs	Max 1-Hr SU/SD NOx lbs	Max 1-Hr Norm Ops NOx ppm @15% O2	Max 1-Hr Norm Ops CO lbs	Max 1-Hr SU/SD CO lbs	Max 3-Hr Rolling Norm Ops CO ppm @15% O2	Max 3-Hr Rolling Norm Ops NH3 Slip ppm @15% O2	Max 1-Hr Norm Ops POC lbs	Max 1-Hr SU/SD POC lbs	Max 1-Hr SO2 lbs
03/01/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/02/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/03/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/04/2026	2.0	3.9	1.8	1.2	1.4	1.6	2.8	0.2	0.2	0.2
03/05/2026	3.2	5.1	2.2	1.5	1.5	1.7	3.1	0.3	0.3	0.2
03/06/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/07/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/08/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/09/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/10/2026	2.2	3.9	2.2	1.0	1.3	1.7	1.8	0.2	0.2	0.2
03/11/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/12/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/13/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/14/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/15/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/16/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/17/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/18/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/19/2026	2.2	4.3	2.1	1.0	0.9	1.7	0.8	0.2	0.1	0.2
03/20/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/21/2026	1.5	4.7	1.5	0.8	1.6	1.7	NSD	0.2	0.2	0.1
03/22/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/23/2026	1.3	5.5	1.2	0.6	1.3	1.7	NSD	0.2	0.2	0.2
03/24/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/25/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/26/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/27/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/28/2026	3.9	6.1	2.3	1.9	1.8	1.8	NSD	0.3	0.3	0.3
03/29/2026	2.2	0.8	2.1	1.1	0.1	1.8	3.2	0.2	0.0	0.2
03/30/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/31/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
Monthly Max	3.9	6.1	2.3	1.9	1.8	1.8	3.2	0.3	0.3	0.3

**Mariposa Energy**  
Byron California  
**Unit 800 Monthly BAAQMD Emissions Report**  
January - 2026

Day	Hourly Emission Limits						3-Hour Rolling Emission Limit			
	Max 1-Hr Norm Ops NOx lbs	Max 1-Hr SU/SD NOx lbs	Max 1-Hr Norm Ops NOx ppm @15% O2	Max 1-Hr Norm Ops CO lbs	Max 1-Hr SU/SD CO lbs	Max 3-Hr Rolling Norm Ops CO ppm @15% O2	Max 3-Hr Rolling Norm Ops NH3 Slip ppm @15% O2	Max 1-Hr Norm Ops POC lbs	Max 1-Hr SU/SD POC lbs	Max 1-Hr SO2 lbs
01/01/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/02/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/03/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/04/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/05/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/06/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/07/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/08/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/09/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/10/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/11/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/12/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/13/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/14/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/15/2026	N/A	1.5	0.0	N/A	0.4	N/A	Down	0.0	0.0	0.0
01/16/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/17/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/18/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/19/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/20/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/21/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/22/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/23/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/24/2026	2.7	6.6	1.8	1.1	1.8	1.7	NSD	0.3	0.3	0.2
01/25/2026	3.8	5.4	2.3	1.9	2.2	1.8	2.6	0.3	0.3	0.3
01/26/2026	3.9	6.6	2.3	1.9	3.0	1.8	2.2	0.3	0.3	0.3
01/27/2026	3.8	7.2	2.2	1.8	2.5	1.8	2.2	0.3	0.2	0.3
01/28/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/29/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/30/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/31/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
Monthly Max	3.9	7.2	2.3	1.9	3.0	1.8	2.6	0.3	0.3	0.3

**Mariposa Energy**  
Byron California  
**Unit 800 Monthly BAAQMD Emissions Report**  
February - 2026

Day	Hourly Emission Limits						3-Hour Rolling Emission Limit			
	Max 1-Hr Norm Ops NOx lbs	Max 1-Hr SU/SD NOx lbs	Max 1-Hr Norm Ops NOx ppm @15% O2	Max 1-Hr Norm Ops CO lbs	Max 1-Hr SU/SD CO lbs	Max 3-Hr Rolling Norm Ops CO ppm @15% O2	Max 3-Hr Rolling Norm Ops NH3 Slip ppm @15% O2	Max 1-Hr Norm Ops POC lbs	Max 1-Hr SU/SD POC lbs	Max 1-Hr SO2 lbs
02/01/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/02/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/03/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/04/2026	N/A	Down	DMaint	N/A	Down	N/A	DMaint	Down	Down	Down
02/05/2026	N/A	Down	DMaint	N/A	Down	N/A	DMaint	Down	Down	Down
02/06/2026	1.7	8.2	1.0	1.0	3.2	1.8	NSD	0.3	0.3	0.2
02/07/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/08/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/09/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/10/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/11/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/12/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/13/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/14/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/15/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/16/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/17/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/18/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/19/2026	2.7	5.0	2.1	1.5	1.7	1.8	Maint	0.3	0.2	0.2
02/20/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/21/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/22/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/23/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/24/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/25/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/26/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/27/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/28/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
Monthly Max	2.7	8.2	2.1	1.5	3.2	1.8	NSD	0.3	0.3	0.2

**Mariposa Energy**  
Byron California  
**Unit 800 Monthly BAAQMD Emissions Report**  
March - 2026

Day	Hourly Emission Limits						3-Hour Rolling Emission Limit			
	Max 1-Hr Norm Ops NOx lbs	Max 1-Hr SU/SD NOx lbs	Max 1-Hr Norm Ops NOx ppm @15% O2	Max 1-Hr Norm Ops CO lbs	Max 1-Hr SU/SD CO lbs	Max 3-Hr Rolling Norm Ops CO ppm @15% O2	Max 3-Hr Rolling Norm Ops NH3 Slip ppm @15% O2	Max 1-Hr Norm Ops POC lbs	Max 1-Hr SU/SD POC lbs	Max 1-Hr SO2 lbs
03/01/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/02/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/03/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/04/2026	1.6	5.2	1.4	0.9	1.8	1.5	NSD	0.2	0.2	0.2
03/05/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/06/2026	1.0	4.7	1.0	0.8	1.5	1.6	NSD	0.2	0.2	0.2
03/07/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/08/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/09/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/10/2026	2.0	4.9	2.0	1.0	1.4	1.8	2.5	0.2	0.2	0.2
03/11/2026	1.7	4.8	1.6	1.0	1.3	1.5	2.6	0.2	0.2	0.2
03/12/2026	3.1	6.1	2.1	1.6	1.5	1.7	2.6	0.3	0.3	0.3
03/13/2026	2.7	6.0	1.8	1.6	1.6	1.7	2.7	0.3	0.3	0.3
03/14/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/15/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/16/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/17/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/18/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/19/2026	2.2	5.0	2.2	1.0	1.0	1.6	0.6	0.2	0.1	0.2
03/20/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/21/2026	1.6	5.6	1.5	0.9	1.7	1.7	NSD	0.2	0.2	0.1
03/22/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/23/2026	1.4	6.6	1.3	0.5	1.2	1.7	NSD	0.2	0.2	0.2
03/24/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/25/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/26/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/27/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/28/2026	3.5	7.3	2.3	1.7	1.8	1.7	NSD	0.3	0.3	0.3
03/29/2026	2.1	3.2	2.2	1.1	0.6	1.8	3.0	0.2	0.1	0.2
03/30/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/31/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
Monthly Max	3.5	7.3	2.3	1.7	1.8	1.8	3.0	0.3	0.3	0.3

**Mariposa Energy**  
Byron California  
**Unit 900 Monthly BAAQMD Emissions Report**  
January - 2026

Day	Hourly Emission Limits						3-Hour Rolling Emission Limit			
	Max 1-Hr Norm Ops NOx lbs	Max 1-Hr SU/SD NOx lbs	Max 1-Hr Norm Ops NOx ppm @15% O2	Max 1-Hr Norm Ops CO lbs	Max 1-Hr SU/SD CO lbs	Max 3-Hr Rolling Norm Ops CO ppm @15% O2	Max 3-Hr Rolling Norm Ops NH3 Slip ppm @15% O2	Max 1-Hr Norm Ops POC lbs	Max 1-Hr SU/SD POC lbs	Max 1-Hr SO2 lbs
01/01/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/02/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/03/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/04/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/05/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/06/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/07/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/08/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/09/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/10/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/11/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/12/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/13/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/14/2026	N/A	1.9	0.0	N/A	1.0	N/A	Down	0.0	0.0	0.0
01/15/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/16/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/17/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/18/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/19/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/20/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/21/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/22/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/23/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/24/2026	2.6	4.6	1.9	0.3	0.9	0.4	NSD	0.3	0.3	0.2
01/25/2026	4.1	4.6	2.4	0.7	1.0	0.7	3.1	0.3	0.3	0.3
01/26/2026	3.7	5.8	2.4	0.5	0.8	0.7	2.9	0.3	0.3	0.3
01/27/2026	3.6	4.5	2.3	0.4	0.8	0.4	3.1	0.3	0.1	0.3
01/28/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/29/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/30/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
01/31/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
Monthly Max	4.1	5.8	2.4	0.7	1.0	0.7	3.1	0.3	0.3	0.3

**Mariposa Energy**  
Byron California  
**Unit 900 Monthly BAAQMD Emissions Report**  
February - 2026

Day	Hourly Emission Limits						3-Hour Rolling Emission Limit			
	Max 1-Hr Norm Ops NOx lbs	Max 1-Hr SU/SD NOx lbs	Max 1-Hr Norm Ops NOx ppm @15% O2	Max 1-Hr Norm Ops CO lbs	Max 1-Hr SU/SD CO lbs	Max 3-Hr Rolling Norm Ops CO ppm @15% O2	Max 3-Hr Rolling Norm Ops NH3 Slip ppm @15% O2	Max 1-Hr Norm Ops POC lbs	Max 1-Hr SU/SD POC lbs	Max 1-Hr SO2 lbs
02/01/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/02/2026	N/A	Down	DMaint	N/A	Down	N/A	DMaint	Down	Down	Down
02/03/2026	N/A	3.4	0.0	N/A	1.0	N/A	NSD	0.0	0.0	0.0
02/04/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/05/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/06/2026	1.9	9.8	1.4	0.1	1.3	0.4	NSD	0.2	0.2	0.2
02/07/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/08/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/09/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/10/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/11/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/12/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/13/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/14/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/15/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/16/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/17/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/18/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/19/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/20/2026	3.5	7.3	2.4	0.5	0.1	0.5	3.3	0.3	0.2	0.2
02/21/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/22/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/23/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/24/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/25/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/26/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/27/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
02/28/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
Monthly Max	3.5	9.8	2.4	0.5	1.3	0.5	3.3	0.3	0.2	0.2

**Mariposa Energy**  
Byron California  
**Unit 900 Monthly BAAQMD Emissions Report**  
March - 2026

Day	Hourly Emission Limits						3-Hour Rolling Emission Limit			
	Max 1-Hr Norm Ops NOx lbs	Max 1-Hr SU/SD NOx lbs	Max 1-Hr Norm Ops NOx ppm @15% O2	Max 1-Hr Norm Ops CO lbs	Max 1-Hr SU/SD CO lbs	Max 3-Hr Rolling Norm Ops CO ppm @15% O2	Max 3-Hr Rolling Norm Ops NH3 Slip ppm @15% O2	Max 1-Hr Norm Ops POC lbs	Max 1-Hr SU/SD POC lbs	Max 1-Hr SO2 lbs
03/01/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/02/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/03/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/04/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/05/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/06/2026	2.2	3.6	2.2	0.3	0.7	0.5	3.1	0.2	0.2	0.2
03/07/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/08/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/09/2026	3.3	4.5	2.2	0.5	0.7	0.4	3.4	0.3	0.3	0.3
03/10/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/11/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/12/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/13/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/14/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/15/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/16/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/17/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/18/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/19/2026	2.0	4.9	2.0	0.1	0.3	0.1	1.1	0.2	0.1	0.2
03/20/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/21/2026	1.5	5.3	1.5	0.0	0.7	0.1	NSD	0.2	0.2	0.1
03/22/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/23/2026	1.2	4.2	1.2	0.0	0.2	0.1	NSD	0.2	0.2	0.1
03/24/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/25/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/26/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/27/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/28/2026	3.5	4.7	2.3	0.7	0.5	0.5	NSD	0.3	0.3	0.3
03/29/2026	2.2	0.9	2.1	0.3	0.0	0.6	2.9	0.2	0.0	0.2
03/30/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
03/31/2026	N/A	Down	Down	N/A	Down	N/A	Down	Down	Down	Down
Monthly Max	3.5	5.3	2.3	0.7	0.7	0.6	3.4	0.3	0.3	0.3

**Attachment 7**

**Condition AQ-18 Startup and Shutdown Emission Limits Report**

# Events

Mariposa Energy  
for 1/1/2026 thru 3/31/2026

## Limits

Unit 600: NOx lbs/Startup Event	14.2	Unit 700: CO lbs/Startup Event	14.1	Unit 800: POC lbs/Startup Event	1.1
Unit 600: NOx lbs/Shutdown Event	3.2	Unit 700: CO lbs/Shutdown Event	2.7	Unit 800: POC lbs/Shutdown Event	0.12
Unit 600: CO lbs/Startup Event	14.1	Unit 700: POC lbs/Startup Event	1.1	Unit 900: NOx lbs/Startup Event	14.2
Unit 600: CO lbs/Shutdown Event	2.7	Unit 700: POC lbs/Shutdown Event	0.12	Unit 900: NOx lbs/Shutdown Event	3.2
Unit 600: POC lbs/Startup Event	1.1	Unit 800: NOx lbs/Startup Event	14.2	Unit 900: CO lbs/Startup Event	14.1
Unit 600: POC lbs/Shutdown Event	0.12	Unit 800: NOx lbs/Shutdown Event	3.2	Unit 900: CO lbs/Shutdown Event	2.7
Unit 700: NOx lbs/Startup Event	14.2	Unit 800: CO lbs/Startup Event	14.1	Unit 900: POC lbs/Startup Event	1.1
Unit 700: NOx lbs/Shutdown Event	3.2	Unit 800: CO lbs/Shutdown Event	2.7	Unit 900: POC lbs/Shutdown Event	0.12

Parameter	Start	End	Duration	NOx Lbs	CO Lbs	POC Lbs
Unit 900 Startup	1/14/2026 2:30 PM	2:35 PM	0:06	1.8	1.1	0
Unit 700 Startup	1/15/2026 12:39 PM	12:44 PM	0:06	1.65	1.42	0
Unit 800 Startup	1/15/2026 4:35 PM	4:39 PM	0:05	1.57	0.39	0
Unit 600 Startup	1/16/2026 1:06 PM	1:10 PM	0:05	1.47	1.13	0
Unit 600 Startup	1/24/2026 10:56 PM	11:15 PM	0:20	4.31	1.54	0
Unit 700 Startup	1/24/2026 10:56 PM	11:21 PM	0:26	4.37	1.74	0
Unit 800 Startup	1/24/2026 10:56 PM	11:16 PM	0:21	5.65	1.7	0
Unit 900 Startup	1/24/2026 10:56 PM	11:13 PM	0:18	3.82	0.62	0
Unit 900 Shutdown	1/25/2026 2:25 AM	2:37 AM	0:13	Invalid	Invalid	0
Unit 900 Startup	1/25/2026 4:53 AM	5:04 AM	0:12	3.08	0.24	0
Unit 600 Shutdown	1/25/2026 8:01 AM	8:06 AM	0:06	0.19	0.06	0
Unit 700 Shutdown	1/25/2026 8:01 AM	8:06 AM	0:06	0.09	0.07	0
Unit 800 Shutdown	1/25/2026 8:01 AM	8:06 AM	0:06	0.12	0.1	0
Unit 900 Shutdown	1/25/2026 8:04 AM	8:06 AM	0:03	0.31	0	0
Unit 600 Startup	1/25/2026 4:26 PM	4:38 PM	0:13	3.87	0.86	0.1
Unit 700 Startup	1/25/2026 4:26 PM	4:36 PM	0:11	3.15	0.86	0.1
Unit 800 Startup	1/25/2026 4:26 PM	4:36 PM	0:11	4.13	0.95	0.1

Parameter	Start	End	Duration	NOx Lbs	CO Lbs	POC Lbs
Unit 900 Startup	1/25/2026 4:26 PM	4:35 PM	0:10	2.86	0.43	0
Unit 600 Shutdown	1/25/2026 9:47 PM	9:54 PM	0:08	0.59	0.1	0
Unit 800 Shutdown	1/25/2026 9:47 PM	9:54 PM	0:08	0.56	0.15	0
Unit 700 Shutdown	1/25/2026 9:49 PM	9:54 PM	0:06	0.34	0.13	0
Unit 900 Shutdown	1/25/2026 9:50 PM	9:54 PM	0:05	0.77	0	0
Unit 600 Startup	1/26/2026 6:11 AM	6:21 AM	0:11	3.88	0.88	0.1
Unit 700 Startup	1/26/2026 6:11 AM	6:21 AM	0:11	3.45	0.91	0.1
Unit 800 Startup	1/26/2026 6:11 AM	6:22 AM	0:12	4.55	1.12	0.1
Unit 900 Startup	1/26/2026 6:11 AM	6:20 AM	0:10	2.86	0.37	0
Unit 600 Shutdown	1/26/2026 8:17 AM	8:22 AM	0:06	0.46	0.06	0
Unit 700 Shutdown	1/26/2026 8:18 AM	8:23 AM	0:06	0.26	0.07	0
Unit 800 Shutdown	1/26/2026 8:19 AM	8:23 AM	0:05	0.21	0.07	0
Unit 900 Shutdown	1/26/2026 8:21 AM	8:24 AM	0:04	0.69	0	0
Unit 600 Startup	1/26/2026 5:56 PM	6:10 PM	0:15	4.93	1.04	0.1
Unit 700 Startup	1/26/2026 5:56 PM	6:12 PM	0:17	5.43	1.09	0.1
Unit 900 Startup	1/26/2026 5:56 PM	6:12 PM	0:17	3.13	0.4	0
Unit 800 Startup	1/26/2026 5:57 PM	6:10 PM	0:14	5.31	0.38	0.1
Unit 700 Shutdown	1/26/2026 10:33 PM	10:41 PM	0:09	0.72	0.14	0
Unit 600 Shutdown	1/26/2026 10:34 PM	10:39 PM	0:06	0.67	0.08	0
Unit 800 Shutdown	1/26/2026 10:34 PM	10:42 PM	0:09	1.25	0.18	0
Unit 900 Shutdown	1/26/2026 10:36 PM	10:42 PM	0:07	1.22	0	0
Unit 600 Startup	1/27/2026 6:27 PM	6:37 PM	0:11	3.92	0.86	0.1
Unit 700 Startup	1/27/2026 6:27 PM	6:39 PM	0:13	3.86	0.89	0.1
Unit 800 Startup	1/27/2026 6:27 PM	6:42 PM	0:16	5.8	1.3	0.1
Unit 900 Startup	1/27/2026 6:27 PM	6:36 PM	0:10	3.01	0.41	0
Unit 600 Shutdown	1/27/2026 10:19 PM	10:28 PM	0:10	1.9	0.15	0.01
Unit 700 Shutdown	1/27/2026 10:19 PM	10:24 PM	0:06	0.13	0.08	0

Parameter	Start	End	Duration	NOx Lbs	CO Lbs	POC Lbs
Unit 800 Shutdown	1/27/2026 10:20 PM	10:25 PM	0:06	0.13	0.1	0
Unit 900 Shutdown	1/27/2026 10:21 PM	10:25 PM	0:05	0.56	0	0
Unit 900 Startup	2/3/2026 7:50 PM	8:00 PM	0:11	3.45	0.72	0
Unit 600 Startup	2/6/2026 6:12 AM	6:27 AM	0:16	6.85	0.91	0.1
Unit 800 Startup	2/6/2026 6:12 AM	6:28 AM	0:17	6.36	1.42	0.1
Unit 900 Startup	2/6/2026 6:12 AM	6:33 AM	0:22	7.95	0.62	0
Unit 800 Shutdown	2/6/2026 7:31 AM	7:39 AM	0:09	0.27	0.19	0
Unit 600 Shutdown	2/6/2026 7:34 AM	7:38 AM	0:05	0.14	0.05	0
Unit 900 Shutdown	2/6/2026 7:36 AM	7:39 AM	0:04	0.7	0	0
Unit 600 Startup	2/17/2026 3:57 PM	4:08 PM	0:12	3.47	0.6	0
Unit 600 Shutdown	2/17/2026 7:02 PM	7:07 PM	0:06	0.27	0.06	0
Unit 700 Startup	2/18/2026 3:56 PM	4:11 PM	0:16	3.71	1.71	0
Unit 700 Shutdown	2/18/2026 6:51 PM	7:04 PM	0:14	0.73	0.21	0
Unit 800 Startup	2/19/2026 3:56 PM	4:13 PM	0:18	4.73	1.44	0
Unit 800 Shutdown	2/19/2026 8:02 PM	8:06 PM	0:05	0.82	0.07	0
Unit 900 Startup	2/20/2026 3:43 PM	4:00 PM	0:18	7.19	0.09	0
Unit 600 Startup	2/20/2026 4:56 PM	5:08 PM	0:13	3.59	1.28	0
Unit 700 Startup	2/20/2026 4:56 PM	5:10 PM	0:15	3.7	1.48	0
Unit 700 Shutdown	2/20/2026 8:01 PM	8:07 PM	0:07	0.6	0.1	0
Unit 600 Shutdown	2/20/2026 8:02 PM	8:06 PM	0:05	0.61	0.05	0
Unit 900 Shutdown	2/20/2026 9:13 PM	9:16 PM	0:04	0.19	0	0
Unit 600 Startup	3/2/2026 11:57 AM	12:08 PM	0:12	3.44	1.24	0
Unit 600 Shutdown	3/2/2026 6:04 PM	6:08 PM	0:05	0.35	0.05	0
Unit 600 Startup	3/3/2026 7:57 AM	8:07 AM	0:11	3.69	1.3	0
Unit 600 Shutdown	3/3/2026 6:02 PM	6:08 PM	0:07	0.34	0.08	0
Unit 700 Startup	3/4/2026 11:57 AM	12:09 PM	0:13	3.55	1.28	0
Unit 600 Startup	3/4/2026 4:57 PM	5:08 PM	0:12	3.32	1.14	0

Parameter	Start	End	Duration	NOx Lbs	CO Lbs	POC Lbs
Unit 800 Startup	3/4/2026 4:57 PM	5:11 PM	0:15	4.64	1.61	0
Unit 700 Shutdown	3/4/2026 6:03 PM	6:08 PM	0:06	0.23	0.14	0
Unit 800 Shutdown	3/4/2026 6:03 PM	6:08 PM	0:06	0.12	0.09	0
Unit 600 Shutdown	3/4/2026 6:04 PM	6:08 PM	0:05	0.12	0.05	0
Unit 700 Startup	3/5/2026 7:57 AM	8:08 AM	0:12	3.88	1.31	0
Unit 700 Shutdown	3/5/2026 6:04 PM	6:08 PM	0:05	0.13	0.07	0
Unit 900 Startup	3/6/2026 11:57 AM	12:08 PM	0:12	2.96	0.52	0
Unit 800 Startup	3/6/2026 4:57 PM	5:16 PM	0:20	4.73	1.5	0
Unit 800 Shutdown	3/6/2026 6:03 PM	6:08 PM	0:06	0.12	0.08	0
Unit 900 Shutdown	3/6/2026 6:05 PM	6:08 PM	0:04	0.2	0	0
Unit 900 Startup	3/9/2026 6:57 AM	7:06 AM	0:10	3.13	0.48	0
Unit 900 Shutdown	3/9/2026 5:19 PM	5:21 PM	0:03	0.42	0	0
Unit 700 Startup	3/10/2026 6:57 AM	7:09 AM	0:13	3.2	1.21	0
Unit 800 Startup	3/10/2026 6:57 AM	7:12 AM	0:16	4.4	1.29	0
Unit 700 Shutdown	3/10/2026 10:18 AM	10:23 AM	0:06	0.56	0.1	0
Unit 800 Shutdown	3/10/2026 5:03 PM	5:08 PM	0:06	0.3	0.09	0
Unit 800 Startup	3/11/2026 10:57 AM	11:10 AM	0:14	4.75	1.21	0
Unit 800 Shutdown	3/11/2026 5:03 PM	5:08 PM	0:06	0.83	0.09	0
Unit 800 Startup	3/12/2026 6:58 AM	7:08 AM	0:11	4.73	0.72	0
Unit 800 Shutdown	3/12/2026 5:03 PM	5:08 PM	0:06	0.49	0.09	0
Unit 800 Startup	3/13/2026 6:57 AM	7:09 AM	0:13	4.59	1.26	0
Unit 600 Startup	3/13/2026 12:27 PM	12:39 PM	0:13	3.19	0.86	0
Unit 600 Shutdown	3/13/2026 1:33 PM	1:38 PM	0:06	0.89	0.06	0
Unit 800 Shutdown	3/13/2026 1:33 PM	1:38 PM	0:06	0.77	0.09	0
Unit 600 Startup	3/19/2026 5:32 PM	5:44 PM	0:13	4.11	0.6	0
Unit 700 Startup	3/19/2026 5:32 PM	5:45 PM	0:14	3.83	0.64	0
Unit 800 Startup	3/19/2026 5:32 PM	5:45 PM	0:14	4.49	0.65	0

Parameter	Start	End	Duration	NOx Lbs	CO Lbs	POC Lbs
Unit 900 Startup	3/19/2026 5:32 PM	5:46 PM	0:15	4.39	0.22	0
Unit 600 Shutdown	3/19/2026 7:02 PM	7:07 PM	0:06	0.1	0.06	0
Unit 700 Shutdown	3/19/2026 7:02 PM	7:07 PM	0:06	0.11	0.1	0
Unit 800 Shutdown	3/19/2026 7:02 PM	7:07 PM	0:06	0.09	0.1	0
Unit 900 Shutdown	3/19/2026 7:05 PM	7:07 PM	0:03	0.04	0	0
Unit 600 Startup	3/21/2026 11:45 AM	11:59 AM	0:15	4.52	1.07	0
Unit 700 Startup	3/21/2026 11:45 AM	12:00 PM	0:16	4.63	1.27	0
Unit 800 Startup	3/21/2026 11:45 AM	12:00 PM	0:16	5.48	1.29	0
Unit 900 Startup	3/21/2026 11:45 AM	12:01 PM	0:17	5.28	0.49	0
Unit 600 Shutdown	3/21/2026 12:48 PM	12:53 PM	0:06	0.16	0.06	0
Unit 700 Shutdown	3/21/2026 12:48 PM	12:53 PM	0:06	0.2	0.1	0
Unit 800 Shutdown	3/21/2026 12:48 PM	12:53 PM	0:06	0.13	0.1	0
Unit 900 Shutdown	3/21/2026 12:51 PM	12:53 PM	0:03	0.44	0	0
Unit 600 Startup	3/23/2026 1:12 PM	1:24 PM	0:13	4.34	0.53	0
Unit 700 Startup	3/23/2026 1:12 PM	1:22 PM	0:11	4.05	0.62	0.1
Unit 800 Startup	3/23/2026 1:12 PM	1:22 PM	0:11	5.06	0.56	0.1
Unit 900 Startup	3/23/2026 1:12 PM	1:22 PM	0:11	2.93	0.16	0
Unit 700 Shutdown	3/23/2026 2:18 PM	2:23 PM	0:06	0.72	0.1	0
Unit 800 Shutdown	3/23/2026 2:18 PM	2:23 PM	0:06	0.57	0.09	0
Unit 600 Shutdown	3/23/2026 2:19 PM	2:22 PM	0:04	0.6	0.04	0
Unit 900 Shutdown	3/23/2026 2:20 PM	2:23 PM	0:04	0.73	0	0
Unit 600 Startup	3/28/2026 9:58 PM	10:08 PM	0:11	3.6	0.39	0
Unit 700 Startup	3/28/2026 9:58 PM	10:15 PM	0:18	4.17	0.64	0
Unit 800 Startup	3/28/2026 9:58 PM	10:13 PM	0:16	4.94	0.58	0
Unit 900 Startup	3/28/2026 9:58 PM	10:11 PM	0:14	3.26	0.13	0
Unit 800 Startup	3/29/2026 3:28 AM	3:39 AM	0:12	2.91	0.16	0
Unit 700 Shutdown	3/29/2026 9:03 AM	9:09 AM	0:07	0.64	0.11	0

Parameter	Start	End	Duration	NOx Lbs	CO Lbs	POC Lbs
Unit 600 Shutdown	3/29/2026 9:04 AM	9:09 AM	0:06	0.78	0.06	0
Unit 800 Shutdown	3/29/2026 9:04 AM	9:09 AM	0:06	0.56	0.08	0
Unit 900 Shutdown	3/29/2026 9:06 AM	9:09 AM	0:04	0.79	0	0
Total (128 Events)			21:20	301.08	64.18	1.61

**Attachment 8**

**Condition AQ-19 Daily Emission Limits:  
NOx, CO, POC, SO2 Emissions Report**

**Mariposa Energy**  
Byron California  
**Facility Monthly Mass Emissions Report**  
January - 2026

#####						Facility 12-Month Rolling Emission Limits					
NOx lbs - 1,100	SO2 lbs - 130	NOx tons - 45.6	POC tons - 5.6	Formaldehyde lbs- 3,725.26							
CO lbs - 934	POC lbs - 95	CO tons - 27.2	PM10 tons - 18.6	PAHs lbs - 1.063							
		SO2 tons - 2.9	Benzene lbs - 107.94	SAM tons - 7							

Day	NOx lbs	CO lbs	NH3 Slip lbs	60-SO2 lbs	75-SO2 lbs	POC lbs	PM10 lbs	Benzene lbs	Formaldehyde lbs	PAHs lbs	SAM lbs
01	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down
02	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down
03	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down
04	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down
05	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down
06	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down
07	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down
08	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down
09	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down
10	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down
11	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down
12	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down
13	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down
14	1.87	1.00	Down	0.01	0.00	0.01	0.01	0.00	0.00	0.0000	0.01
15	3.24	1.79	Down	0.01	0.00	0.01	0.02	0.00	0.00	0.0000	0.02
16	1.46	1.10	Down	0.01	0.00	0.00	0.01	0.00	0.00	0.0000	0.00
17	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down
18	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down
19	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down
20	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down
21	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down
22	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down
23	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down
24	30.62	11.20	4.93	1.17	0.80	1.04	1.68	0.00	0.00	0.0000	1.04
25	204.29	80.45	85.98	18.55	14.50	15.98	26.34	0.00	0.00	0.0000	15.90
26	138.37	49.11	45.73	9.65	7.50	8.49	13.89	0.00	0.00	0.0000	8.47
27	70.66	23.83	21.53	5.63	4.70	4.87	8.01	0.00	0.00	0.0000	4.86
28	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down
29	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down
30	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down
31	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down
Monthly Total	450.5	168.5	158.17	35.03	27.50	30.4	50.0	0.00	0.00	0.000	30.30
12-Month Rolling	1.8 tons	0.7 tons	0.6 tons	0.1 tons	0.1 tons	0.1 tons	0.2 tons	0.00 lbs	0.00 lbs	0.000 lbs	0.1 tons

**Mariposa Energy**  
Byron California  
**Facility Monthly Mass Emissions Report**  
February - 2026

#####							Facility 12-Month Rolling Emission Limits				
NOx lbs - 1,100	SO2 lbs - 130	NOx tons - 45.6	POC tons - 5.6	Formaldehyde lbs- 3,725.26							
CO lbs - 934	POC lbs - 95	CO tons - 27.2	PM10 tons - 18.6	PAHs lbs - 1.063							
		SO2 tons - 2.9	Benzene lbs - 107.94	SAM tons - 7							

Day	NOx lbs	CO lbs	NH3 Slip lbs	60-SO2 lbs	75-SO2 lbs	POC lbs	PM10 lbs	Benzene lbs	Formaldehyde lbs	PAHs lbs	SAM lbs
01	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down
02	DMaint	DMaint	DMaint	Down	Down	Down	Down	Down	Down	Down	Down
03	3.45	0.99	0.17	0.02	0.00	0.02	0.03	0.00	0.00	0.0000	0.02
04	DMaint	DMaint	DMaint	Down	Down	Down	Down	Down	Down	Down	Down
05	DMaint	DMaint	DMaint	Down	Down	Down	Down	Down	Down	Down	Down
06	35.67	9.23	7.85	1.50	0.90	1.23	2.04	0.00	0.00	0.0000	1.22
07	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down
08	DMaint	DMaint	DMaint	Down	Down	Down	Down	Down	Down	Down	Down
09	DMaint	DMaint	DMaint	Down	Down	Down	Down	Down	Down	Down	Down
10	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down
11	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down
12	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down
13	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down
14	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down
15	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down
16	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down
17	11.64	4.44	4.57	1.46	0.60	0.73	1.25	0.00	0.00	0.0000	0.52
18	11.56	6.00	3.89	0.63	0.60	0.73	1.16	0.00	0.00	0.0000	0.73
19	12.85	5.10	2.83	0.77	0.80	0.89	1.53	0.00	0.00	0.0000	1.01
20	41.47	10.74	12.90	2.91	2.30	2.59	4.17	0.00	0.00	0.0000	2.62
21	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down
22	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down
23	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down
24	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down
25	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down
26	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down
27	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down
28	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down
Monthly Total	116.6	36.5	32.21	7.29	5.20	6.2	10.2	0.00	0.00	0.000	6.12
12-Month Rolling	1.3 tons	0.5 tons	0.4 tons	0.1 tons	0.1 tons	0.1 tons	0.1 tons	0.00 lbs	0.00 lbs	0.000 lbs	0.1 tons

**Mariposa Energy**  
Byron California  
**Facility Monthly Mass Emissions Report**  
March - 2026

#####						Facility 12-Month Rolling Emission Limits					
NOx lbs - 1,100	SO2 lbs - 130	NOx tons - 45.6	POC tons - 5.6	Formaldehyde lbs- 3,725.26							
CO lbs - 934	POC lbs - 95	CO tons - 27.2	PM10 tons - 18.6	PAHs lbs - 1.063							
		SO2 tons - 2.9	Benzene lbs - 107.94	SAM tons - 7							

Day	NOx lbs	CO lbs	NH3 Slip lbs	60-SO2 lbs	75-SO2 lbs	POC lbs	PM10 lbs	Benzene lbs	Formaldehyde lbs	PAHs lbs	SAM lbs
01	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down
02	17.00	7.59	6.34	2.38	1.20	1.20	2.04	0.00	0.00	0.0000	0.85
03	35.09	17.02	18.87	5.54	2.00	2.76	4.74	0.00	0.00	0.0000	2.00
04	29.39	13.18	8.02	1.64	1.60	1.66	2.64	0.00	0.00	0.0000	1.63
05	32.78	15.49	15.68	2.42	2.00	2.81	4.41	0.00	0.00	0.0000	2.81
06	22.35	5.13	7.86	1.19	1.40	1.42	2.22	0.00	0.00	0.0000	1.61
07	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down
08	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down
09	36.13	2.45	17.93	2.52	2.10	2.95	4.59	0.00	0.00	0.0000	3.36
10	32.87	16.18	10.83	2.22	2.60	2.61	4.34	0.00	0.00	0.0000	2.88
11	17.55	7.35	5.83	1.07	1.20	1.25	2.14	0.00	0.00	0.0000	1.42
12	33.99	15.43	13.29	2.46	2.00	2.88	4.91	0.00	0.00	0.0000	3.29
13	31.66	12.97	9.79	1.97	1.50	2.02	3.42	0.00	0.00	0.0000	2.21
14	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down
15	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down
16	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down
17	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down
18	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down
19	28.58	6.83	5.41	1.34	1.20	1.13	1.92	0.00	0.00	0.0000	1.15
20	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down
21	27.72	8.37	4.10	0.95	1.10	0.83	1.34	0.00	0.00	0.0000	0.82
22	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down
23	26.88	4.77	4.97	1.05	0.80	0.93	1.53	0.00	0.00	0.0000	0.92
24	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down
25	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down
26	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down
27	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down
28	44.76	12.70	14.13	2.72	1.90	2.35	3.89	0.00	0.00	0.0000	2.33
29	77.26	28.40	36.67	7.66	7.00	6.56	10.84	0.00	0.00	0.0000	6.60
30	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down
31	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down	Down
Monthly Total	494.0	173.9	179.72	37.13	29.60	33.4	55.0	0.00	0.00	0.000	33.88
12-Month Rolling	1.5 tons	0.5 tons	0.5 tons	0.1 tons	0.1 tons	0.1 tons	0.1 tons	0.00 lbs	0.00 lbs	0.000 lbs	0.1 tons

**Attachment 9**

**Condition AQ-20 Cumulative Rolling 12-month CTG Emissions:  
NOx, CO, POC, PM10, SO2 Emissions Report**

**And**

**Condition AQ-31 Sulfuric Acid Emissions Report**

# Mariposa Energy

Byron California

## Facility 12-Month Rolling Report

March 2026 12-Month Rolling

**Facility 12-Month Rolling Operational Limits**

Unit Op Hours - 16,900  
Heat Input mmBtu - 8,128,900

**Facility 12-Month Rolling Emission Limits**

NOx tons - 45.6      POC tons - 5.6      Formaldehyde lbs - 3,725.26  
CO tons - 27.2      PM10 tons - 18.6      PAHs lbs - 1.063  
SO2 tons - 2.9      Benzene lbs - 107.94      SAM tons - 7

Month	Op Hours	Op Time	12MRT Op Time	Fuel Flow kscf	Heat Input mmBtu	12MRT Heat Input mmBtu	MWH	NOx lbs	CO lbs	75 SO2 lbs	YTM 75 SO2 lbs	60 SO2 lbs	POC lbs	PM10 lbs	Benzene lbs	Formaldehyde lbs	PAHs lbs	SAM lbs	12MRT NOx tons	12MRT CO tons	12MRT SO2 tons	12MRT POC tons	12MRT PM10 tons	12MRT Benzene lbs	12MRT Formaldehyde lbs	12MRT PAHs lbs	12MRT SAM tons	YTM CO2 tons	YTM CO2e Metric Tons
Apr 2025	50	50.33	2006.0	15022.7	15788.7	758450.1	1554.3	246.8	77.0	10.40	105.20	12.99	11.1	18.4	0.00	0.00	0.000	11.01	3.9	1.4	0.3	0.3	0.4	0.00	0.00	0.000	0.3	9377.5	8516.0
May 2025	108	108.45	2021.4	35947.3	37636.1	767893.4	3831.7	469.6	160.9	24.50	129.70	30.99	26.3	43.4	0.00	0.00	0.000	26.09	4.0	1.5	0.3	0.3	0.4	0.00	0.00	0.000	0.3	11614.3	10547.3
Jun 2025	51	50.64	1941.2	17009.8	17859.9	732497.5	1815.8	208.7	85.5	11.30	141.00	15.88	12.5	20.8	0.00	0.00	0.000	11.66	3.8	1.4	0.3	0.3	0.4	0.00	0.00	0.000	0.2	12675.5	11511.0
Jul 2025	14	14.43	1486.4	5517.5	5810.1	546163.6	606.9	74.5	27.6	3.50	144.50	5.60	4.1	6.9	0.00	0.00	0.000	3.80	2.9	1.1	0.2	0.2	0.3	0.00	0.00	0.000	0.2	13020.5	11824.3
Aug 2025	104	104.37	1414.9	38486.3	40602.6	510897.3	4161.5	474.8	177.6	26.00	170.50	32.83	28.5	46.7	0.00	0.00	0.000	28.19	2.8	1.1	0.2	0.2	0.3	0.00	0.00	0.000	0.2	15433.4	14015.3
Sep 2025	79	78.78	1313.6	29735.7	31133.4	469692.7	3230.1	343.9	125.3	20.20	190.70	26.04	21.9	36.0	0.00	0.00	0.000	21.22	2.6	1.0	0.2	0.2	0.3	0.00	0.00	0.000	0.2	17283.7	15695.5
Oct 2025	0	0.34	1057.3	27.7	29.0	366652.0	0.1	5.7	4.3	0.00	190.70	0.02	0.0	0.0	0.00	0.00	0.000	0.03	2.1	0.8	0.2	0.1	0.2	0.00	0.00	0.000	0.1	17285.4	15697.0
Nov 2025	24	24.07	928.3	8142.0	8540.7	322399.8	866.2	115.0	34.4	5.50	196.20	6.58	6.0	9.8	0.00	0.00	0.000	6.18	1.9	0.7	0.1	0.1	0.2	0.00	0.00	0.000	0.1	17793.0	16157.9
Dec 2025	3	3.06	847.2	763.3	802.1	300202.6	76.0	12.3	3.8	0.50	196.70	0.48	0.6	0.9	0.00	0.00	0.000	0.55	1.7	0.6	0.1	0.1	0.2	0.00	0.00	0.000	0.1	17840.7	16201.3
Jan 2026	101	100.76	871.7	41018.6	43356.5	321441.5	4590.9	450.5	168.5	27.50	27.50	35.03	30.4	50.0	0.00	0.00	0.000	30.30	1.8	0.7	0.1	0.1	0.2	0.00	0.00	0.000	0.1	2576.9	2340.2
Feb 2026	27	27.05	601.0	8386.2	8830.3	221033.2	893.0	116.6	36.5	5.20	32.70	7.29	6.2	10.2	0.00	0.00	0.000	6.12	1.3	0.5	0.1	0.1	0.1	0.00	0.00	0.000	0.1	3102.2	2817.3
Mar 2026	151	150.70	713.0	45328.4	47504.2	257893.6	4763.0	494.0	173.9	29.60	62.30	37.13	33.4	55.0	0.00	0.00	0.000	33.88	1.5	0.5	0.1	0.1	0.1	0.00	0.00	0.000	0.1	5925.9	5381.5

**Attachment 10**

**Exceedances / Violations**

## **Attachment 10**

Mariposa Energy has had no exceedances or violations during Q1 2026.

## **Attachment 11**

**Condition AQ-38 40 CFR Part 72.9(c)(1) SO<sub>2</sub> Allowances  
And 40 CFR Part 75 CEM Requirements Report**

✓ Draft Compliance has executed.

- Mariposa Energy Project (057483FACLY)

### Compliance Accounts

<input type="checkbox"/>	Account Number	Account Name	State	Allowances Held	Total User Specified Allowances for Deduction (optional)	Emissions (tons)	Excess Emissions	Compliance Status	Compliance Run Date	Last Updated By	Last Updated Date
<input type="checkbox"/>	057483FACLY	Mariposa Energy Project	CA	2	0	0	0	Draft	02/10/2026 01:05:38 PM	Forsyth, Wayne	02/10/2026 01:05:38 PM

Showing 1 to 1 of 1 entries

First page

Previous page

1

Next page

Last page

[Download Report \(CSV\)](#)

[Why can't I run final compliance?](#)

[Run Draft Compliance](#)

**Attachment 12**

**Conditions AQ-39, AQ-40  
S-6 Emergency Fire Pump Operation Report  
(BAAQMD Condition 24955, parts 1 & 2)**

**Conditions AQ-39 and AQ-40, S-6 Emergency Standby Diesel Fire Pump Engine Operation Report**

**S-6 Diesel Fire Pump Driver Operation Log**

**Engine Model:** JU6H-UFADM8 (Clark Fire Pump Engine Model Designation)  
 6068HFC28A,B,C (John Deere Engine Model Designation)

**Year: 2011 Model Year** EPA Engine Family: BJDXL06.8120

**Size: 175 BHP** Fuel Type: CARB Diesel

**Facility: Mariposa Energy Center, BAAQMD Plant 19730 (B9730)**

**Source No: 6**

Location: Diesel Fire Pump Room, Mariposa Energy

Summary					
Year	Months	Stop Timer Reading	Start Timer Reading	Total Actual Maintenance and Testing Hours	12-Month Running Total Hours
2025	January	324.3	322.3	2.0	27.8
2025	February	326.7	324.3	2.4	27.7
2025	March	329.2	326.7	2.5	28.1
2025	April	331.2	329.2	2.0	27.6
2025	May	333.2	331.2	2.0	27.6
2025	June	335.2	333.2	2.0	27.1
2025	July	337.7	335.7	2.0	27.1
2025	August	340.1	337.7	2.4	27.5
2025	September	342.7	340.1	2.6	28.1
2025	October	344.8	342.7	2.1	27.0
2025	November	346.8	344.8	2.0	27.0
2025	December	349.3	346.8	2.5	27.0
2026	January	351.3	349.3	2.0	27.0
2026	February	353.8	351.3	2.5	27.1
2026	March	356.3	353.8	2.5	27.1

**Attachment 13**

**Conditions AQ-39, AQ-40  
Condition AQ-41 S-6 Emergency Fire Pump Totalizing Meter Report (BAAQMD  
Condition 22850, part 3)**

## Attachment 13 S-6 Emergency Fire Pump Totalizing Meter Report


To demonstrate compliance with CEC Condition AQ-41 (BAAQMD Condition 22850, Part 3), the following photographs are provided as evidence of compliance.



S-6 Emergency Fire Pump



S-6 Control Unit

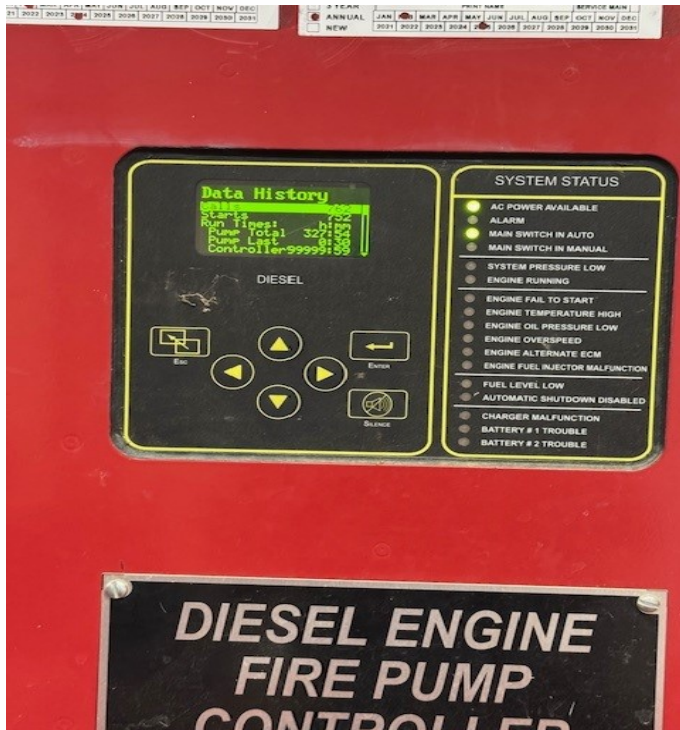

S-6 Controller, Showing Fire Pump Operating Hours



S-6 Fire Pump Engine Hours