

## DOCKETED


<b>Docket Number:</b>	07-AFC-06C
<b>Project Title:</b>	Carlsbad Energy Center - Compliance
<b>TN #:</b>	204013
<b>Document Title:</b>	Licensed CECP Exhibit 207 -- CAISO 2007 Integration of Renewable Resources
<b>Description:</b>	For Official Notice -- CAISO 2007 (California Independent System Operator). Integration of Renewable Resources, November 2007; received into evidence on 2/1/2010
<b>Filer:</b>	Mike Monasmith
<b>Organization:</b>	California Energy Commission
<b>Submitter Role:</b>	Commission Staff
<b>Submission Date:</b>	3/30/2015 8:53:33 PM
<b>Docketed Date:</b>	4/1/2015



# California ISO

Your Link to Power

California Independent System Operator

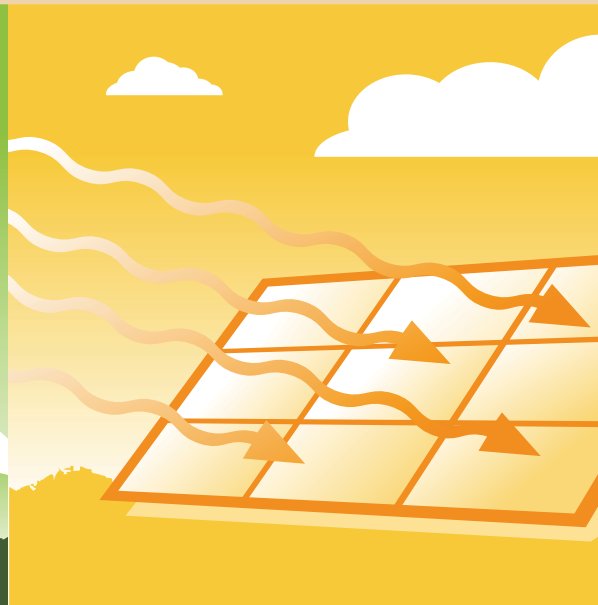

## Integration of Renewable Resources

November 2007

Transmission and operating issues  
and recommendations for integrating  
renewable resources on the California ISO-controlled Grid



## Members of the Renewables Workgroup

*California Independent System Operator Corporation*

### *Principal Investigators*

Clyde Loutan  
David Hawkins

### *Contributors*

Jim Blatchford  
Phillip de Mello  
Gary DeShazo  
Dana Dukes  
Don Fuller  
Vishnu N. Jetmalani  
David Le  
Suzanne Stone  
Justin Wong  
Yi Zhang  
Songzhe Zhu

### *GE Energy Consulting*

Kara Clark  
Robert D'aquila  
Nicholas Miller

### *Pacific Northwest National Laboratory*

Jian Ma  
Yuri Makarov

### *AWS Truewind*

Mike Brower

---

The California ISO also wishes to acknowledge the many reviewers of the report for their valuable comments and suggestions.

---

The California Independent System Operator Corporation (California ISO) is a not-for-profit public benefit corporation formed in 1997 when the state restructured its electricity industry. It is the impartial link between power plants and the utilities and load-serving entities that provide electricity to almost 80 percent of California consumers, about 30 million people. The California ISO is responsible for the operation of 25,526 circuit-miles of long-distance, high voltage power lines that deliver electricity throughout most of California (California Grid) and between adjacent balancing authorities, neighboring states, Canada and northern Mexico. In 2006, the California ISO delivered 249.2 million megawatts hours of electricity and had a peak demand of 50,270 megawatts. The California ISO's principle objective is to ensure the reliability of the California Grid, while fostering a low-cost wholesale marketplace for electrical generation and related services in California. The California ISO operates pursuant to its Tariff filed with the Federal Energy Regulatory Commission. A five-member Board of Governors oversees the California ISO. Members are appointed by the governor, with consideration of recommendations from stakeholders, and are confirmed by the California State Senate.

---

© 2007 CALIFORNIA INDEPENDENT SYSTEM OPERATOR CORPORATION





## Letter from the CEO

Current policies demonstrate that California is at the forefront of advancing renewable resource development. In the next few years, the state requires that electricity providers serve 20 percent of their retail load from renewable resources. Statewide, greenhouse gas emissions will also be reduced to 1990 levels by 2020. At the same time, California recognizes the importance of maintaining reliable electric service for consumers, which is primarily the responsibility of the California Independent System Operator Corporation (California ISO).

Consistent with that responsibility, the Renewables Portfolio Standard (RPS) and other environmental policies, the California ISO is proud to assist in meeting the state's objectives. The California ISO has taken several important programmatic steps related to transmission interconnections for remote resources such as renewables, market policies to facilitate successful integration of renewable resources, and enhancement of demand response opportunities consistent with state and federal priorities. These policies, however, have not addressed the reliability issues associated with the large increase in intermittent renewable generation that is expected in the next several years.

Earlier this year, the California ISO conducted an engineering study to assess the feasibility of maintaining reliable and high-quality electric service under the 20 percent RPS, with an understanding of where to focus ongoing analytic and implementation efforts. The "Integration of Renewable Resources" describes the California ISO's analytic approach to the issue, the conclusions of the related engineering studies, and the recommendations for achieving successful implementation of the state's 20 percent RPS. It is important to note what this study does not address the more challenging higher RPS targets. Higher targets are expected to present significantly greater operating challenges that cannot be evaluated by a simple straight line extrapolation from this study's conclusions.

The good news is that this study shows the feasibility of maintaining reliable electric service with the expected level of intermittent renewable resources associated with the current 20 percent RPS, *provided* that existing generation remains available to provide back-up generation and essential reliability services. The cautionary news is the "*provided*" part of our conclusion. Regulatory actions under active consideration threaten the economic viability of much of this essential generation. Moreover, current regulatory policies assigning high on-peak availability factors to intermittent generation will eliminate the theoretical — but not the real — need for the essential generation currently provided by existing power plants, and regulators may be unwilling to support sufficient forward procurement of generation. Furthermore, the model used for this study is based on the technical specifications and capabilities of the generation fleet, but does not reflect contractual or other regulatory constraints that are not known to the California ISO.

(continues next page)







The study shows the additional operating requirements and products needed to support the implementation of the 20 percent RPS. Further detailed engineering analysis, coordinated with generation and transmission owners, is needed to refine the assumptions, develop cost estimates and establish a full implementation plan. This is all currently being evaluated. We look forward to working with state policy makers, market participants, and other interested parties to ensure that we have a clear understanding of these and other critical issues in order to help policy makers find the most effective means of achieving important policy objectives in a way that is consistent with maintaining the reliability and quality of electric service in California.


Yakout Mansour  
California ISO President & CEO





## Table of Contents

<b>Executive Summary</b> .....	<b>1</b>
Transmission Plan for Renewable Resources .....	2
Analysis of Operating Issues.....	6
Analysis of Forecasting Issues .....	9
Use of Storage Technology with Wind Generation .....	9
Summary.....	10
<b>Chapter 1 - Background</b> .....	<b>13</b>
1.1. Wind Generation Fundamentals.....	14
1.2. Other Key Factors .....	15
1.3. Renewables Portfolio Standard Goals.....	16
<b>Chapter 2 – Assessment of the California Energy Commission’s Intermittency     Analysis Project Final Report</b> .....	<b>19</b>
2.1. Generation Resources Adequacy .....	20
2.2. Transmission Infrastructure .....	21
2.3. Renewable Generation Technology, Policy and Practice.....	21
2.4. New Wind Resource Areas .....	21
2.5. Operations Analysis of Intermittent Generation .....	22
2.6. Conclusion.....	22
<b>Chapter 3 - Transmission Plans for Interconnection of Renewables</b> .....	<b>23</b>
3.1. Assumptions and Study Methodology.....	24
3.2. Conclusions .....	26
3.3. Recommendations .....	27
3.4. Wind Plant Representation in the Power Flow.....	28
3.5. Dynamic Modeling Discussion.....	28
3.6. Transient Stability Characteristics of Wind Turbine Technologies .....	29
3.7. Fault Disturbance List .....	30
3.8. Performance Criteria .....	31
3.9. Wind Turbine Trips .....	33
3.10. Frequency Response .....	35
3.11. Power Swings.....	36
3.12. Summary of Baseline Performance .....	36
3.13. WTG Technology Sensitivity Cases .....	37
3.14. Dynamic Reactive Compensation Sensitivity Cases .....	40






3.15. Post-Transient Studies .....	42
3.16. Generator Interconnection Standards .....	47
3.17. WECC Low Voltage Ride Through Standard (LVRT) .....	48
<b>Chapter 4 – Forecasting Issues .....</b>	<b>49</b>
4.1. Market Operations – Day-Ahead Time Frame .....	49
4.2. California ISO Day-Ahead Load Forecast .....	50
4.3. Day-Ahead Scheduling Process .....	50
4.4. Hour-Ahead Load Forecast Error .....	51
4.5. Hour-Ahead Energy Scheduling Process .....	52
4.6. Five-Minute Load Forecast Error .....	53
4.7. Residual Unit Commitment (RUC) .....	54
4.8. Wind Resource Forecast .....	55
4.9. Hour-Ahead Energy Forecast for Wind Generators .....	55
<b>Chapter 5 – Operations Issues: Impacts of Wind Generation on California ISO’s</b>	
<b>Ramping, Regulation and Load Following Requirements Under MRTU</b> .57	
5.1. Assumptions .....	57
5.2. Study Methodology .....	58
5.3. Conclusions .....	59
5.4. Recommendations .....	60
5.5. Day-Ahead Forecast and Scheduling Process .....	62
5.6. Wind vs. Actual Load on a Typical Hot Day .....	63
5.7. Multi-Hour Seasonal Ramping Requirement .....	65
5.8. California ISO Scheduling and Load Balancing Processes .....	72
5.9. Sensitivity with 5% Wind Forecast Error .....	78
5.10. Regulating Requirements .....	78
5.11. Over-Generation Conditions .....	82
<b>Chapter 6 – PIRP II Enhancements .....</b>	<b>89</b>
<b>Chapter 7 - Storage Technology .....</b>	<b>91</b>
7.1. Benefits of Storage Technology .....	93
7.2. Pump Storage and the Need for Three Pump Operation at Helms .....	94
7.3. Sodium Sulfur (NAS) Batteries for Energy Time-shifting and Renewable Generation Support .....	95
7.4. Use of Flywheel Technology for Additional Regulation .....	96
7.5. New Storage Technologies .....	97





7.6. Conclusion.....	100
7.7. Recommendations .....	100
<b>Chapter 8 - National Experience .....</b>	<b>103</b>
8.1. Major U.S. Studies on Renewables.....	103
8.2. Western Regional Coordination of Strategies on Renewables .....	104
8.3. Northwest Wind Integration Action Plan .....	104
<b>Chapter 9 - International Experience .....</b>	<b>107</b>
9.1. Spain .....	107
9.2. Germany .....	108
9.3. Ireland.....	109
9.4. Denmark.....	109
9.5. Canada.....	110
9.6. Conclusions .....	111
<b>Chapter 10 – Conclusions and Recommendations .....</b>	<b>113</b>
Task 1. Develop New Ramp Forecast and Planning Tool for Real-Time Operations	114
Task 2. Over-generation Problems.....	115
Task 3. Improve Accuracy of Day-Ahead Energy Forecasts for Wind Generators ..	116
Task 4. Improve Accuracy of Same Day Energy Forecasts for Wind Generators....	117
Task 5. Develop New Graphical Displays for Real-Time Operators .....	118
Task 6. Link Renewables Forecast with MRTU .....	118
Task 7. Scheduling/Managing Imports and Exports of Renewables .....	119
Task 8. Impact on Resource Adequacy.....	120
Task 9. Modeling of Wind Generation Facilities.....	120
Task 10. Changes to PIRP II for Hour-Ahead Forecast and Scheduling .....	120
<b>Glossary of Acronyms .....</b>	<b>121</b>
<b>Appendices .....</b>	<b>123</b>
<i>Appendix A – Study Results - Load Following Capacity, Ramp Rate and Ramp Duration</i>	
<i>Appendix B – Study Methodology</i>	
<i>Appendix C – Load Forecasting Error Analysis</i>	
<i>Appendix D – Wind Generation Forecast for the 20% RPS</i>	
<i>Appendix E – Wind Forecast Error</i>	
<i>Appendix F – Wind Turbine Generator Modeling</i>	
<i>Appendix G – Tehachapi Transmission Plan</i>	
<i>Appendix H – Transient Stability Plots</i>	
<b>References .....</b>	<b>123</b>







## Executive Summary

California is a national leader in the development of renewable resources as it positions itself at the forefront of diversifying resources and reducing greenhouse gases. Currently, 6,000 megawatts (MWs) of installed renewable resources<sup>1</sup> including wind, solar, geothermal, biomass and small hydroelectric generation help to “green the grid”. These resources delivered more than 21 million megawatt hours of energy to California electric customers in 2006. This represents 11% of the total energy required to serve load in the California Independent System Operator Corporation (California ISO or CAISO) controlled Grid. To further develop environmentally friendly power, the state of California enacted a 20% Renewables Portfolio Standard (RPS). This statute requires each retail seller of energy to deliver sufficient energy from renewable resources to serve 20% of retail load by December 31, 2010. As a national leader in developing new initiatives to facilitate renewable development, California ISO initiated this study to help policy makers understand the unique requirements that are necessary to ensure that the operation and design of the transmission grid fully supports this renewable standard.

The California ISO has implemented two significant initiatives to facilitate the development and integration of renewable resources. First, in 2002, the California ISO put into place its Participating Intermittent Resource Program (PIRP) to better integrate wind generators into its Hour-Ahead markets. This program was a major breakthrough, in that it provides an opportunity to forecast and schedule energy production from intermittent generating resources. It enables wind generators to participate in the California ISO markets without being penalized for the inherent intermittency of wind generation. Second, in 2006 the California ISO led a new initiative with the FERC called the Remote Resource Interconnection Program. The program provides a mechanism for transmission upgrades that support renewable resources and permit construction of transmission to renewable energy resources that are located in areas that are remote from the existing transmission network.

This Report is another major initiative by the California ISO that addresses the transmission and operational impacts of interconnecting a major increase in the amount of renewable resources to the power grid. The report analyzes the issues, documents the results, and recommends steps that should be implemented to reliably integrate the planned intermittent resources. The Report builds on other integration studies, especially the CEC’s Intermittency Analysis Project Final Report published in July 2007, by adding significant new analysis and in-depth study of operational issues that can be expected from the increase in intermittent generating resources.

---

<sup>1</sup> This figure of 6,000 MW and the analysis that follows from this figure only include energy production from renewable resources located in the California ISO controlled Grid, and therefore does not reflect renewable energy imported from adjacent balancing authorities. Figures provided by the CEC, CPUC and IOU’s may be higher than the amount stated above because such figures may also include the above referenced imports.





The California ISO is collaboratively working with load serving entities, state and federal regulators, industry experts, adjacent balancing authorities and the owners/developers of renewable resources to identify integration challenges and solutions. Because California has large quantities of renewable resources already on-line, a significant amount of historical data is available to accurately model and forecast future performance of the various types of renewable resources. Small hydroelectric, biomass and geothermal generation are more predictable resources, and the integration of these resources into both the markets and operations do not present significant problems. Concentrated solar is an intermittent resource, but the amount of generation from this resource is still small, so it does not result in significant integration issues. The amount of concentrated solar generation is expected to increase to more than 1,000 MW by the 20% RPS date but the amount of this resource will still be substantially less than the increase in the amount of wind generation and no serious operating issues are expected with solar generation.

New wind generating facilities are the fastest renewable resource to install and interconnect to the power grid. Wind generation, however, presents the largest operational challenges. Wind generation energy production is extremely variable, and in California, it often produces its highest energy output when the demand for power is at a low point. During some periods of the year, wind generation is hard to forecast because it does not follow a predictable day-to-day production pattern. Therefore, the focus of this Report is on the transmission and operating issues associated with the addition of more than 4,000 MW of new wind generation in the California ISO controlled Grid.

A majority of the new wind generation facilities will be built in the Tehachapi region in Southern California. During the summer months, the Tehachapi area has a pattern of maximum wind generation at night, a ramp down of energy production during the morning load pick up period, and a ramp up of generation in the evening. Integration of large amounts of wind generation is technically feasible, but there are transmission, operating and forecasting challenges. This Report discusses these integration issues and, more importantly, the proposed solutions and recommendations to facilitate renewables integration in California and the West.

## Transmission Plan for Renewable Resources

The largest increase in renewable energy resources to meet the 20% RPS will be from wind generation, and the majority of this new wind generation will be installed in the Tehachapi Wind Resource area. The Tehachapi Transmission project was reviewed in detail to reassess the adequacy of the voltage controls, transient stability and post-transient voltage performance of the system. Standard transmission planning tools were used to assess the transient stability performance, voltage stability and reactive margin of the system with the addition of various levels of wind generation planned for the Tehachapi area. The objective was to assess the overall performance of the interconnected transmission system over a broad range of load, wind generation levels and wind turbine assumptions. The California ISO Regional Transmission Department and GE Energy Consulting performed a joint transmission analysis of the Tehachapi Transmission Project.







The primary objectives of the transmission system analysis were as follows:

1. Evaluate transient stability and post-transient voltage performance of the California ISO controlled Grid with increased levels of wind generation in the Tehachapi area.
2. Evaluate the post-transient voltage stability performance (Q-V analysis) of the California ISO-controlled Grid with increased levels of wind generation in the Tehachapi area.
3. Evaluate wind plant functional characteristics that are necessary to achieve acceptable static and dynamic performance of the California ISO controlled Grid.
4. Determine any needed improvements to the Grid to achieve acceptable performance with increased levels of wind generation and other renewable energy resources.

The modeling of the transmission system focused on a 20% renewable energy requirement, which includes a total of 4,200 MW of wind generation in the Tehachapi area. The model also included all the proposed new transmission facilities as described in Appendix G.

The Western Electricity Coordinating Council (WECC) 2010 Heavy Summer peak load and 2012 Light Spring load system conditions with 4,200 MW of total wind generation were modeled in the Tehachapi area. These base cases were selected because they represented extreme on-peak and off-peak operating conditions and the Heavy summer case had been used in previous joint studies with SCE.


For each seasonal condition, the following three wind generation scenarios were analyzed:

1. Full wind, where all Tehachapi area wind turbine generators are on-line, operating at rated MW
2. Low wind, where all Tehachapi area wind turbine generators are on-line, operating at 25% of rated MW
3. No wind, where all Tehachapi area wind turbine generators are off-line

For each scenario, the baseline analysis was performed assuming that all new wind plants would be Type 3<sup>2</sup> doubly fed wind turbine generators. The existing wind plants in the Tehachapi area were modeled as Type 1 conventional induction generators. A total of 25 contingencies (11 Category B and 14 Category C)<sup>3</sup> were simulated for each of the seasonal wind generation scenarios. Finally, several sensitivity studies were performed by varying the mix of wind turbine generator types based on the actual installations of new wind plants in the U.S. in 2006 (i.e., 10% Type 1 induction generator, 20% Type 3 doubly fed with power factor control, 50% Type 3 doubly fed with fast voltage regulation and 20% Type 4 full converter induction generators).

<sup>2</sup> The four types of wind generators are described in detail in Appendix F. Briefly; Type 1 is a conventional fixed speed induction generator that operates synchronized to the power grid. It typically consumes VARS and does not meet Low Voltage Ride Through standards. Type 2 is similar to a Type 1 unit, but it uses a wound rotor induction generator with variable rotor resistance. Type 3 is a doubly-fed induction generator that is synchronized to the power grid, but uses a feedback loop that enables it to produce VARS. It meets Low Voltage Ride Through standards. Type 4 is similar to Type 3 and it has a full converter interface.

<sup>3</sup> Category B is the loss of a single element, while Category C refers to events resulting in the loss of two or more (multiple) elements.







### *Conclusions from the Transmission Planning Study*

The study concluded that the Tehachapi transmission plan is sound, and there are no serious transient stability or post-transient voltage stability problems. It does, however, point out the need to address some very important issues:

1. All new wind generation units must have the capability to meet the WECC requirements of  $\pm 0.95$  power factor. This reactive capability is essential for adequate voltage control.
2. The proposed Tehachapi Transmission Project can support up to 4,200 MW of wind generation in the Tehachapi area, provided that the new wind plants adhere to the WECC Low Voltage Ride Through (LVRT) criteria.

The existing Type 1 wind generators in Tehachapi do not meet this standard, and the studies show these units will trip off-line following a short circuit problem in the area. Type 3 and 4 wind generators meet the LVRT standard, and they will survive a short circuit event.

3. Dynamic reactive capability for all new wind generation facilities is essential. The California ISO should consider requiring that a minimum portion of the required power factor range be dynamic for each new wind park. Additional analyses will need to be performed to determine the minimum requirements for the dynamic range.
4. The California ISO's role is to ensure all new generation facilities meet the interconnection standards. Although the California ISO does not have the tariff authority to require all new wind generation to be Type 3 or Type 4 units, it can require that any new Type 1 or Type 2 units must have sufficient static and dynamic reactive resources to meet the interconnection standards.<sup>4</sup>
5. The bulk power system performed satisfactorily in both the transient and post-transient states with 4,200 MW total wind generating capacity in the Tehachapi area.
6. The frequency response of the Western Interconnection is not affected by the new wind generation within the California ISO controlled Grid.
7. A sensitivity analysis study shows that system performance is acceptable with either all Type 3 doubly fed wind turbine generators or with a mix of wind turbine generator technologies for the new wind plants. The pessimistic test scenario with 100% Type 1 wind plants with no dynamic reactive capability shows an unacceptable response. This suggests that wind plants with some dynamic reactive capability are necessary to ensure system stability. Therefore, if the dynamic reactive capability is not inherent in the wind turbine generator, it may need to be added to the wind plant.

<sup>4</sup> Clarifying statement added in response to comments from SCE. Generator Interconnection standards are specified in Section 25 of the California ISO Tariff and the Standard Large Generator Interconnection Procedures (LGIP) and the California ISO Tariff Appendix W.





8. Based on the transient stability study results, the bulk system (500 and 230 kV) shunt capacitors and Static VAR Compensation (SVC) for dynamic voltage support proposed in the Tehachapi Transmission Project appear to be conservative for the level of wind generation and the system conditions/outages considered in this study. The SVC sensitivity analysis shows that the proposed SVCs were not necessary to achieve acceptable transient stability performance with a likely mix of wind turbine generator technologies.
9. The sensitivity analysis shows that the proposed SVCs were not sufficient to achieve acceptable dynamic performance if all of the new wind plants were modeled with 100% Type 1 wind turbine generators and had no dynamic reactive capability. This is a pessimistic assumption since the majority of the new wind plants that were installed in the U.S. in 2006 were of Types 3 and 4, which are capable of providing dynamic reactive support.
10. With adequate dynamic reactive capability and reasonable assumptions of wind plant operation, system transient stability performance is acceptable with fewer capacitors (and possibly smaller/fewer SVCs). This suggests that wind plants with some dynamic reactive capability may reduce or eliminate the need for dynamic reactive devices on the transmission system. Dynamic reactive power supplied close to where it is needed (e.g., at the Type 1 wind turbine generator terminals) will be more effective than the dynamic reactive power at a remote location for the potential problems identified in this transient stability analysis. This will require further analysis to determine the optimal size and location for the dynamic reactive support.
11. The post-transient analysis indicated that the grid performance met applicable WECC planning standards, specifically the post-transient voltage deviation and voltage stability reactive margins. Adequate reactive margins at critical 500 and 230 kV buses were observed for critical contingencies, varying between 950 MVAR and 3,400 MVAR for 500 kV buses and between 600 MVAR and 1,300 MVAR for 230 kV buses.
12. The post-transient analysis also indicated that the proposed transmission system to accommodate the additional new wind generation in the Tehachapi area may be highly compensated with the addition of mechanically switched shunt capacitors. The nose point in the resulting Q-V curves for critical 500 kV buses under critical contingencies was observed to be high in the 0.95 – 1.0 per unit voltage range. Further analysis will be needed to optimize the proposed reactive supports and to evaluate if series compensation would be required to help lower the nose point in the Q-V analysis for critical buses under critical contingencies.

### ***Recommendations Based on the Transmission Planning Study Results***

1. All new wind generation plants must meet WECC LVRT requirements.
2. All new wind plants should be Type 3 or Type 4 generators that are capable of providing dynamic reactive support to help the transmission grid meet applicable WECC transient stability performance standards and to prevent potential tripping due to low voltages. In





the event that some of the new wind plants are of Type 1 or 2 with no dynamic reactive capability, the generator owner must provide sufficient reactive resources to meet the Low Voltage Ride Through standards and voltage control standard. Additional studies may be required to verify the generator has provided appropriate additional external dynamic reactive support to meet the interconnection standards.

3. Re-evaluate the optimal location and size for the dynamic reactive support (i.e., SVCs) that were proposed in the Tehachapi Transmission Project plan.
4. Analyze the best solution for improving the nose point of the Q-V analysis for critical 500 kV buses under critical contingency conditions. Potential solutions include the use of series compensation and reduction of proposed shunt compensation.

## Analysis of Operating Issues

The operational analysis focused on integrating a total of approximately 6,700 MW of wind generation (~ 2,600 MW existing and ~ 4,100 MW new). The California ISO and Pacific Northwest National Lab jointly performed the analysis on the California ISO-controlled Grid.

The primary objective of the Operating Issues study was to determine the following:

- The magnitude of hourly overall ramping requirements
- Load following capacity and ramping requirements
- Regulation capacity and ramping requirements
- Over-generation issues and potential solutions

The wind generation impact analysis methodology is based on a model of the California ISO's actual scheduling, Real-Time dispatch, and regulation processes and timelines. Minute-to-minute variations and statistical interactions of the system parameters involved in these processes are depicted with sufficient details to provide a robust and accurate assessment of the additional capacity, ramping and ramp duration requirements that the California ISO Automatic Generation Control (AGC) and load following Automated Dispatch System (ADS) systems will be facing when the additional renewable resources have been added to the system to meet the 20% RPS.

## *Conclusions from the Operating Issues Study*

1. Integrating 20% renewables in the California electric power system is operationally feasible, however, changes to operating practices will be required (see Recommendations).
2. The 20% renewables is expected to increase the 3-hour morning ramp by 926 MW to 1,529 MW and the 3-hour evening ramp by 427 MW to 984 MW depending on the season.





3. The California ISO regulation capacity requirements will increase by 170 MW to 250 MW for “Up Regulation” and 100 MW to 500 MW for “Down Regulation”. The amount of increase varies with the season and hour. The fact that this increase in regulation requirements is 10 times larger than in previous studies is due to a detailed model that more accurately represents the time lags in the Automated Dispatch System and in generator response to dispatch commands.
4. The California ISO regulation ramping requirements for the 20% RPS is expected to increase by about  $\pm 15$  to  $\pm 25$  MW/min. These increases will affect AGC ramps up to 5-minutes long.
5. The California ISO will also require a significant increase in the supplemental energy stack to meet intra-hour load following needs. The increase is explained by the fact that the Hour-Ahead wind generation forecast error (standard deviation is evaluated as 7% to 9% of the total installed wind generation capacity) becomes comparable with the Hour-Ahead load forecast error (standard deviation is 600 MW to 900 MW). The increase in the use of supplemental energy could potentially increase the 10-minute Real-Time market clearing prices.
6. The California ISO maximum load following ramping requirements for the 20% RPS is expected to increase by about  $\pm 30$  to  $\pm 40$  MW/min. These increases will affect ADS ramps up to 20-30 minutes long.
7. The California ISO current generating resources seem adequate to meet the anticipated ramping requirements for load following and regulation. However, during drought conditions or low hydro years, regulating response could be slow due to the reliance of thermal units with slower ramp rates. Depending on system load, additional units may have to be committed on-line to meet regulation needs.

### ***Recommendations from the Operating Issues Study***

1. Implement a state-of-the-art wind forecasting service for all wind generator energy production within the California ISO controlled Grid. This includes Day-Ahead, Hour-Ahead and Real-Time wind generation forecasts. These forecasts will be crucial for the unit commitment, scheduling and dispatch processes in the Day-Ahead, Hour-Ahead and Real-Time time frames.
2. Incorporate the Day-Ahead and Hour-Ahead wind generation forecasts (block energy schedules) into the California ISO’s and SCs’ scheduling processes. The Day-Ahead and Hour-Ahead schedules must be based on the forecast wind generation values.
3. Integrate the Real-Time wind generation forecast (average wind generation for 5-minute dispatch intervals) with the Real-Time unit commitment and MRTU dispatching applications.
4. Develop a new ramp forecasting tool to help system operators anticipate large energy ramps, both up and down, on the system. The longer the lead time for forecasting a large ramp, the more options the operators have to mitigate the impact of the ramp.





5. Change the California ISO generator interconnection standards to require compliance of all intermittent resources (grid connected wind generation and solar generation)<sup>5</sup> with the interconnection rules established for the Participating Intermittent Resources Program. These rules include Real-Time meteorological data and telemetry systems to communicate the 4-second meteorological and production data from wind parks to the California ISO. This data needs to be integrated into the California ISO's forecasting software.
6. Implement a procedure where the California ISO dispatcher can send dispatch notices to wind generation operators and require them to implement pro-rata cuts in their energy production. During over-generation periods, when dispatchable generation plants are already operating at their minimum levels, the California ISO needs to have an ability to curtail wind generation on an as needed basis.
7. Analyze the impact of solar power intermittency with load and wind generation intermittency.
8. Evaluate technological changes that can facilitate the integration of large amounts of intermittent resources. For example, evaluate the benefits of participating in a wider-area arrangement like ACE sharing or Wide Area Energy Management system.<sup>6</sup>
9. Study the impact that additional cycling (additional start ups) and associated wear-and-tear issues; dispatches below the maximum unit capacity; and associated additional costs and environmental impacts will have on conventional generation due to the integration of large amounts of intermittent resources. The California ISO will consider whether improvements can be made to its Scheduling, Real-Time Dispatch and Regulation systems that will minimize the impacts on conventional units.
10. Encourage the development of new energy storage technology that facilitates the storage of off peak wind generation energy for delivery during on-peak periods.
11. Include changes in Resource Adequacy standard to require more generation with faster and more durable ramping capabilities that will be required to meet future ramp requirements.<sup>7</sup>
12. Include changes in Resource Adequacy standard to require additional quick start units that will be required to accommodate Hour-Ahead forecast errors and intra-hour wind variations.

<sup>5</sup> Specific reference to wind generation and solar added in response to comment from MWD.

<sup>6</sup> Principles of the Wide Area Energy Management system are currently under design at PNNL. The project is sponsored by BPA. The California ISO is a participant in this project.

<sup>7</sup> The California ISO is currently participating in a CEC-sponsored project with PNNL and ORNL on the value of fast regulation resources.







## Analysis of Forecasting Issues

The California ISO's Market Redesign and Technology Upgrade (MRTU)<sup>8</sup> is expected to help in mitigating ramping problems associated with large amounts of wind generation provided that Day-Ahead and Hour-Ahead wind forecasts are integrated into MRTU. There are occasional problems of too much generation on-line on light load days when wind and hydro generation are at maximum production levels. These high levels of production combined with other generation that must also be on-line results in an over-generation problem. One of the important results from the MRTU Day-Ahead Integrated Forward Market (IFM) will be the creation of feasible generation schedules for the next operating day. The IFM requires accurate Day-Ahead wind generation forecasts as a key input to the RUC process. The goal is to make sure that the right amount of generation is committed to be on-line for the next day operation. Good Day-Ahead market decisions will minimize the start-up of fossil fueled generation that will not be needed when large amounts of wind generation shows up. Better Day-Ahead schedules will decrease the over-generation problems as load and generation will be more closely matched.

Another market issue is the procurement of optimum quantities of Ancillary Services in the Day-Ahead Market. The amount of regulation services needed is expected to increase by 200 to 500 MW, especially for some hours and seasons. Wind variability and unpredictability is much larger in January through April, so the California ISO will need to procure more "Up Regulation" in these months.

The amount of energy and number of bids in the Supplemental Energy Market will need to increase with the additional amounts of wind generation. The additional energy required will be as much as +800 MW (INC bids) and -1,000 MW (DEC bids). This may result in more price volatility in the Real-Time Energy Market due to the large variability of wind generation in certain hours and seasons.

## Use of Storage Technology with Wind Generation

Additional storage capability would be of considerable benefit with the integration of large amounts of renewables, especially intermittent resources. Storage systems shift some of the off-peak energy production to deliver at peak periods. Some storage, such as high-speed flywheel systems, can provide regulation services and frequency control. Storage can also help with ramping issues by quickly absorbing excess energy when wind generation ramps up, and it can deliver energy when wind generation ramps down.

"Storage devices such as batteries can be located anywhere on the grid (and can be moved) to support the dual needs of integrating intermittent renewables and mitigating congestion. Mitigating congestion includes deferring or eliminating the need for transmission upgrades near the renewables generation, and for transmission and distribution upgrades near the loads."<sup>9</sup>

<sup>8</sup> MRTU is a comprehensive program that enhances grid reliability and fixes flaws in the California ISO markets. It keeps California compatible with market designs that are working throughout North America and replaces aging technology with modern computer systems that keep pace with the dynamic needs of California's energy industry. The program is scheduled for implementation March 31, 2008.

<sup>9</sup> Quotation from comments provided by Edward G. Cazalet, Megawatt Storage Farms, Inc.





A proven and deployed storage technology is hydro pump storage. The 1,200 MW Helms pump storage facility<sup>10</sup> that is owned and operated by PG&E is the largest storage facility on the system. The facility can provide regulation services when it is in the generating mode but not in the pumping mode. This plant could be used in combination with Tehachapi wind generation, if the transmission facilities to the Gregg substation are upgraded. This would facilitate the transmission of the Tehachapi energy to the Helms Pump Storage plant, and it would enable the use of the third pump at the plant to store more energy from renewables for more hours per year.

Major R&D projects are underway to develop new storage technology. One example is production of hydrogen with the use of carbon nanotube technology for storage of the hydrogen gas. Other projects include the testing of the Vanadium Redox Battery (VRB) flow battery and the potential use of compressed air storage. A test of a 100 kVA high-speed flywheel was successfully concluded earlier this year, and a 20 MVA flywheel system could be commercially deployed in a year. Lithium-Ion battery storage has been successfully deployed. All of the other storage technologies appear to be a number of years in the future before they are commercially available.


### *Recommendations for Implementing Storage Technology*

1. Initiate a California ISO project for storage technology with the goal of removing technical and economic barriers to the deployment of the technology.
2. Hold stakeholder meetings and workshops to explore market mechanisms for financially compensating storage facilities for the benefits they could provide such as regulation services, other ancillary services, transmission loading relief and voltage support. This is in addition to their ability to shift off-peak energy production to energy delivery on-peak.

### **Summary**

1. The planned \$1.8 billion of transmission upgrades for the Tehachapi area are sufficient to support up to 4,200 MW of new renewable resources.
2. New wind generation resources should be Type 3 or Type 4 units as the installation of more Type 1 units in Tehachapi has a negative impact on the reliability of the system.
3. All new generating facilities, including new wind generation facilities, must meet the California ISO Interconnection Standards, provide 4-second operating data and be prepared to act on dispatch notices from the California ISO Operations.
4. Integrating 20% renewables in the current generation mix is achievable; however, several market integration and operational changes are required.
5. Transient stability studies indicated that the new Tehachapi wind generation with Type 3 or Type 4 units, meets WECC LVRT as well as the WECC transient stability standard.

<sup>10</sup> The Helms pump storage facility is rated for 1,200 MW in the generating mode and 900 MW in the pump mode.





6. Some of the existing Tehachapi wind generation (Type 1 Units) trips off-line for three phase 500 kV faults in the local area under the full wind scenario.
7. Post-transient governor power flow analysis results indicate that the WECC standards are met.
8. A state-of-the-art wind forecasting service is necessary in the Day-Ahead time frame to minimize errors in the unit commitment process. The accuracy of Day-Ahead load and wind generation forecasts will affect the market clearing prices and unit commitment costs.
9. Approximately 800 mW/hr of generating capacity and ramping capability will be required to meet multi-hour ramps during the morning load increase coupled with declining wind generation. Operations will need to be able to quickly ramp down dispatchable resources during the evening load drop-off and accommodate increases in wind generation.
10. The amount of regulation required will significantly increase with large amount of new wind generation.
11. The size of the supplemental energy stack must significantly increase to meet intra-hour load following needs.
12. The California ISO must have the ability to curtail wind generation during over-generation conditions.
13. Short start units must be available to accommodate Hour-Ahead forecast errors and intra-hour wind variations. The quantity of short start units that will be needed requires additional analysis and modeling.









## Chapter 1 - Background

The purpose of this Report is to ensure the successful integration of 20% renewable resources with the planning, and operation of the power grid. The Renewables Workgroup combined the talents and resources within Planning and Infrastructure Development (P&ID), Grid Operations, Market Operations, Information Technology and External Affairs and representatives from General Electric, Pacific Northwest National Laboratory and AWS Truewind. It also involved coordination and collaboration with IOUs, wind generator owner/operators, Scheduling Coordinators, the CEC, industry experts and adjacent balancing authority operators.

The scope of this Report is primarily to provide a detailed focus on Transmission Planning and Operating Issues and secondarily, to focus on forecasting issues and use of storage technology. The goal is to identify any voltage control problems, transient stability performance issues and transmission loading issues. One of the primary drivers behind this Report is to ensure that any transmission control devices (SVCs, reactors, capacitors, etc.) needed to achieve the 20% RPS are ordered as soon as possible.

Chapter 10 of the Report addresses conclusions and implementation tasks going forward. These tasks will focus on the remaining Operational Issues and Forecasting Issues. This includes the need for better Day-Ahead forecasting and use of this information for Day-Ahead Unit Commitment decisions. It also covers technical and forecasting issues on the import of renewables.

### California - Home to Diverse Wind Resources





## 1.1. Wind Generation Fundamentals

To address wind generation and integration issues, it is useful to have a common understanding of some fundamental facts.

### *1.1.1. Wind generation is an energy resource and not a peaking capacity resource.*

The role of wind generation is to displace fossil fuel generation resources, to help the state meet greenhouse gas initiatives and carbon reductions, and to reduce the exposure to volatile natural gas prices. Utilities purchase the power output from wind generators to meet their RPS requirements, and to back down the power required from the more expensive gas fired power plants. Because wind is an intermittent resource, California can not depend on wind generation energy production to meet the peak loads during the summer peak load days. The wind typically does not blow on the hottest day of the year, so the wind generation production is usually less than 10% of its nameplate capacity at the time of the summer peak load.

### *1.1.2. Wind generation, solar generation and system load are all quite variable.*

The variability of any one of these elements may be offset by the other or they can be additive and increase the total variability on the system. To accommodate this increase in variability, the California ISO needs increased flexibility from other resources such as hydro generation, dispatchable pump loads, energy storage systems, and fast ramping and fast starting fossil fuel generation resources. The portfolio of future California resources must reflect this need for very flexible generation resources to assist with the integration of large amounts of intermittent resources. This required increased flexibility will be one of the cost drivers for integration of renewables.

### *1.1.3. The size of the balancing authority matters.*

The larger the balancing authority, the more diversified the resource areas, and the larger the benefits of aggregation. Production from geographically dispersed resources typically have much different meteorological conditions, so they do not all move up and down together. The larger the amount of aggregation, the greater the reduction in variability and the easier it is to forecast the total renewables energy production.

### *1.1.4. The cost and complexity of wind integration starts low.*

The variability of wind generation energy production from a small number of units is usually much less than the variability of system load changes. The system operator is accustomed to dealing with daily load forecast errors, changes in hourly load forecasts and the unpredictability of loads. As the amount of wind generation in an area increases, it will reach a point where its variability is greater than the variability of load. As wind generation further increases, the amount of variability will increase non-linearly. This study focused on the 20% RPS. An increase of the RPS to 33% could more than double the integration problems and costs.





### ***1.1.5. Forecast of wind generation energy production — both Day-Ahead and Hour-Ahead — is an essential integration strategy.***

Wind generation energy production is not typically scheduled in the Day-Ahead Market. The forecast for wind generation energy production is a very important component in deciding what other generation should be scheduled for the next day. If 3,000 MW of wind is forecast for the next day, it is inefficient and costly to start up fossil fuel generation that will not be needed. The CEC IAP study and other wind integration studies have pointed out the critical importance of Day-Ahead wind generation forecasts. The Day-Ahead Wind forecast does not have to be 100% accurate to achieve substantial benefits.

## **1.2. Other Key Factors**

### ***1.2.1. Large ramps will be an issue.***

There will be periods where wind energy production rapidly declines while simultaneously the load is rapidly increasing. Energy ramps as high as 3,000 MW per hour or larger can occur between 0700 and 1000 hours. Fast ramping generation, such as hydro units, will be essential for the California ISO to keep up with the fast energy changes. There will be other periods, particularly in the winter months, where large pacific storms will impact the wind parks and their energy production will rapidly ramp up to full output. The solution will be the development of new ramp forecasting tools to help the grid operators.

### ***1.2.2. Planning and managing transmission for renewables is a key strategy.***

Renewable resources can be built much faster than the required transmission upgrades can be designed, approved and built. New transmission and transmission upgrades are essential to link these locational constrained renewable facilities to the backbone power grid. New strategies are needed to manage the congestion on the transmission network to facilitate the maximum delivery of renewable energy to customer loads.

### ***1.2.3. Coordination with neighboring balancing authorities will be a key to success.***

For California to meet the 20% RPS, the California ISO will need to import some of the renewable energy from adjacent balancing authorities. New rules and procedures will be needed to lower the barriers for import and export of intermittent resources between balancing authorities. Coordinated transmission plans as well as coordinated energy scheduling and operating practices will be the keys to success.





### 1.3. Renewables Portfolio Standard Goals

#### 1.3.1. Twenty Percent (20%) Renewable Resources — 2007 to 2013

Energy from renewable resources is expected to increase by 130% in the next 5 years. This large increase is driven by the state’s Renewables Portfolio Standard (RPS), which requires the IOUs to serve 20% of their customers’ load from renewable resources. The CEC’s forecast of the renewable mix for the 20% RPS is shown in Figure 1-1 below:

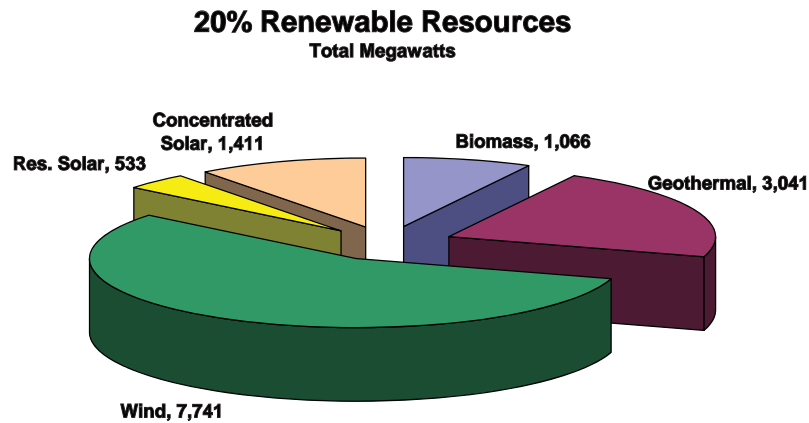


Figure 1-1: CEC Renewable Resources Forecast for 20% RPS

The expected increase in energy renewable resources is as follows:

Table 1-1: CEC Renewables Forecast

Resource	Existing MW	Forecast Additions MW	20% Renewables MW
Biomass	845	221	1,066
Geothermal	1,977	1,064	3,041
Wind	2,706	5,035	7,741
Residential Solar	Unknown	533	533
Concentrated Solar Power	465	946	1,411
<b>Total</b>	<b>5,993</b>	<b>7,799</b>	<b>13,792</b>

The California ISO interconnection queue for renewable resources through the year 2013 contains 14,116 MW of wind generation and 11,264 MW of solar generation. It is not anticipated that all the generation in the interconnection queue will be built by 2013, so the California ISO studies and the CEC studies have scaled back the amount of new renewables generation to the numbers shown in Table 1-1 above. The transmission and operating plans and recommendations contained in this report are based on the scaled back amount of renewables that are forecast to be installed to meet the 20% RPS.





### 1.3.2. Thirty-Three Percent (33%) Renewable Resources

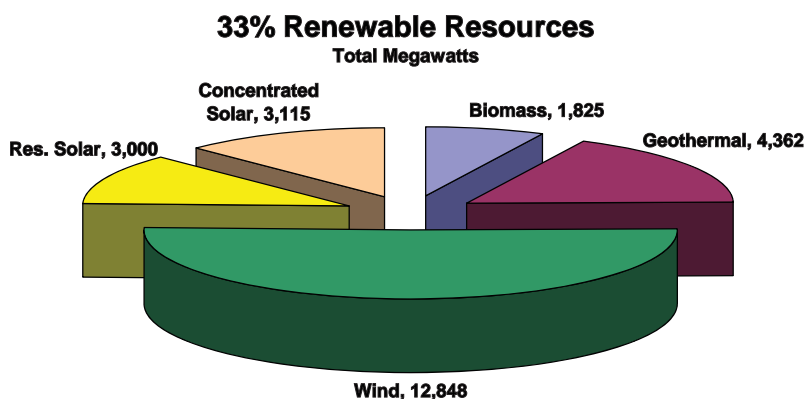


Figure 1-2: CEC Renewable Resources Forecast for 33% RPS

Table 1-2: CEC Forecast for 33% Renewable Resources

Resource	Existing MW	Forecast Additions MW	Total MW
	<u>2006</u>	<u>2020</u>	<u>2020</u>
Biomass	845	980	1,825
Geothermal	1,977	2,385	4,362
High Wind	2,706	9,961	12,667
Low Wind	0	181	181
Res. Solar	Unknown	3,000	3,000
CSP	465	2,650	3,115
<b>Total</b>	<b>5,993</b>	<b>19,157</b>	<b>25,150</b>

The CEC IAP study for 2020 used 12,700 MW of wind and 6,000 MW of solar generation, which is consistent with the numbers in Table 1-2 above from their August 15, 2006 IAP workshop. The 33% RPS goal requires dramatic increases in solar generation as well as wind generation. Many of the most productive wind generation sites will be developed by 2020 or earlier, so solar generation will have to play an increasing role to achieve the 33% RPS goal. The capacity value of the renewable resources typically is 20% to 37% of the nameplate rating of the facility. The capacity factor<sup>11</sup> of 30% means that for every 100 MW of installed nameplate capacity, the facility is only capable of delivering 30% to the total energy potential of the resource on an annual basis. The exceptions are biomass and geothermal resources, which have capacity values of 89% and 90% respectively. Therefore, to increase the amount of energy from renewable resources from 20% to 33% requires approximately a doubling of the installed capacity of the renewable resources.

*Note: This California ISO report on the integration of renewables covers only the 20% RPS requirement and does not include an analysis of the 33% goal. The transmission requirements and operational issues to meet the 33% RPS will need to be addressed in a future study.*

<sup>11</sup> Capacity Factor = actual energy production per year/Nameplate MW \* 8760 hours per year.









## Chapter 2 – Assessment of the California Energy Commission’s Intermittency Analysis Project Final Report

The California Energy Commission sponsored the Intermittency Analysis Project (IAP) in 2006 to study the integration of all renewable resources to meet the state’s requirement of 20% of energy from renewables by 2010 and the goal of 33% of energy from renewables by 2020. A public workshop was held on February 13, 2007 where the results of this project were presented. The California ISO met with the consulting team after the workshop to discuss their findings. This included a discussion of the study methodology, the assumptions used in the study, and the results and conclusions in the draft report. The California ISO provided detailed technical comments on the results presented at the workshop and recommended additional study work be done.

The Final CEC IAP Report was released in late July 2007. This report is an excellent document with contributions from many experts and technical consultants. It provides a thorough analysis of many of the integration issues. The report concludes that the 20% renewables requirement can be achieved, but numerous things must be done to ensure success. It would be erroneous to conclude that there are no serious integration problems. In fact, today’s operating data with less than 3,000 MW of wind generation have already revealed some operating issues. The addition of 4,500 MW to 6,000 MW of new wind generation will only exacerbate these issues. The California ISO has worked with the CEC consulting team to correct some of the modeling assumptions to ensure the results produced are useful to the California ISO and all the participants in the renewables program.

One issue identified in the draft CEC IAP report that was released in May, 2007 was potential transmission and operating problems under light load conditions. If both hydro generation and wind generation are at maximum energy production and the system load is very low (less than 20,000 MW), there is a good chance the California ISO will have an over-generation condition. There were also unanswered questions about the stability of the system and the potential for serious transmission voltage control problems during these conditions. To address these issues, the California ISO and GE Energy, under the California ISO’s direction, jointly performed transient and post-transient system analysis to determine the ability of the system to withstand disturbances and faults during off-peak periods. In addition, contractual and regulatory constraints on the operation of the system were considered in order to address additional mitigation measures. These studies were conducted during summer 2007 and are the basis for a substantial portion of this California ISO report on the integration of renewables.

The Final CEC IAP Report released in July 2007 brings together many different pieces of work that have been done over the past several years. Its emphasis is on ALL forms of renewable resources, not just wind generation. It looks at various scenarios for the increase in the amount of







renewable generation resources to uncover potential system problems. It examines transmission issues, operating issues, wind generation forecast strategies, wind turbine technologies and modeling of wind generation, and provides a review of the international experience with the integration of renewable resources. This comprehensive report on the integration of renewable resources will be nationally and internationally recognized as the standard of excellence for renewables integration studies.

The IAP report concludes that the electric system can successfully integrate the amount of renewable resources required to meet the 20% RPS and even the 33% goal if the many recommendations described in the report are adopted. Three issues are key:

1. Major new transmission facilities and upgrades of existing transmission will be required for the 20% RPS and especially to accommodate the 33% RPS goal.
2. Extensive changes will be required in the type of new generation built in the state: new units must have greater operating flexibility to start up and shut down without long delays; they must be able to operate at lower minimum loading levels; and they must have faster ramping capability and regulation capability.
3. Curtailment of some wind generation may occasionally be required, particularly during periods of minimum system load, high wind generation production, low conventional hydro generation flexibility and a lack of ability to export to excess wind generation to other areas.

## 2.1. Generation Resources Adequacy

The IAP report has a series of important conclusions about future generation procurements and power exchange agreements. It emphasizes the critical importance of much greater flexibility in generator schedules and operational characteristics such as fast ramping, both up and down, and the ability to operate over a wide range of production levels.

The report concludes that the current practice of block hourly import and export schedules between balancing authorities may have to be altered to more frequent updates in schedules to accommodate the variability of renewable resources. This change may take some time to implement on a WECC-wide basis, but it could be tested and implemented between any areas that wanted to make the change.

The CEC IAP report also concludes that the increase in the amount of regulation capability required "is relatively modest (20 MW)." The California ISO disagrees with this conclusion and a major portion of the California ISO's report describes a new methodology for calculating the amount of regulation required. This new methodology more accurately reflects the operational characteristics of the Automatic Generation Control (AGC) and the automatic Supplemental Energy dispatches required to rebalance the system every 5 minutes.





## 2.2. Transmission Infrastructure

The IAP report correctly concludes that “Significant transmission investments are necessary to meet the 20% and 33% renewable goals.” The 33% RPS case requires “128 new or upgraded transmission line segments” to meet load growth requirements as well as upgrades required to accommodate the new generation resources. The estimated transmission and substation costs are \$6.4 billion plus land and right of way costs. All of these transmission expansion estimates are based on scenarios of where new renewable resources might be built and how many megawatts of capacity would be located at each site. The California ISO and the transmission utilities will have to develop detailed transmission plans to accommodate the proposed generation resources that have submitted interconnection applications.

## 2.3. Renewable Generation Technology, Policy and Practice

The California ISO agrees with the conclusion that wind and solar energy forecast will be very important to the success of the renewables program. If the energy production from renewables cannot be forecasted and scheduled, then the value of renewables to displace fossil fueled generation is greatly diminished. The California ISO is looking forward to working with the CEC to develop the best possible forecasting tools to facilitate the integration of the renewable resources into the market schedules and operations.

The new wind turbine technology and solar technology overcome many of the operating limitations of the older technology. New storage technology and transmission congestion monitoring technology may significantly increase the amount of renewable resources that can be accommodated on the system. The increased availability of pump storage facilities (3 pump operation at Helms) can provide needed night time load to accommodate the increased amount of off-peak wind generation. New storage technologies should also be encouraged and tested within the state.

Regulatory policies that present barriers to the successful development of renewable resources must be identified and eliminated wherever possible. An example is the WECC scheduling practice of doing block hour interchange schedules. The transfer of energy from intermittent resources such as wind generation will vary substantially over a one-hour period. If the WECC scheduling process was changed to allow 30 minute interchange schedules between balancing authorities for moving wind generation energy, then it will be easier to schedule the energy, and it would reduce the regulation burden between balancing authorities.<sup>12</sup>


The IAP report also correctly identifies that while operational flexibility of both loads and generation resources is highly desirable from a grid operations perspective, it may not be at all attractive to generation resources and schedulers. Market incentives may be required to secure the flexibility needed to operate the system with large amounts of intermittent resources.

## 2.4. New Wind Resource Areas

One of the key roles for the CEC is the identification of geographic areas within the state that have high potential value for location of renewable resources. The California ISO’s strategy

---

<sup>12</sup> A barrier example was added in response to comment from SDG&E.





for transmission development for location constrained resources is dependent on the CEC's identification of potential areas with significant wind, solar and geothermal energy resources. The February 2007 IAP report "Characterizing New Wind Resources in California" is a good example of the research work that should be done to identify energy resource areas.

## 2.5. Operations Analysis of Intermittent Generation

The Operations Analysis report by the GE Energy Consulting team provides a very extensive analysis of the operational challenges from large amounts of intermittent resources. They have shown the combined effects of load variability, wind variability and solar variability. It is very encouraging to see how the combination of wind and solar together can reduce the variability of the entire fleet of intermittent resources. The results should be to encourage the continued R&D efforts on solar technology to drive down the cost of this technology and increase the opportunities for its deployment. This California ISO Report uses the GE Energy Consulting team's report as the basis for the more detailed analysis performed. The CEC IAP report on the operational issues has been extensively reviewed at the California ISO as it reveals the operational challenges the California ISO will have to mitigate for the reliable operation of the grid with large amounts of intermittent resources.

## 2.6. Conclusion

The California ISO applauds the leadership of the CEC in undertaking the IAP study to assess the transmission infrastructure and services needed to accommodate the levels of renewable resources required by the state's policy goals.





## Chapter 3 - Transmission Plans for Interconnection of Renewables

This chapter focuses on the addition of 3,540 MW of wind generation in the Tehachapi area. The Tehachapi area is located at the southern end of the San Joaquin Valley in the mountainous region between Bakersfield and Mohave, and it has the largest potential for the development of wind generation in California. As wind generation matured over recent years, so too have requirements for specific performance characteristics of wind plants. The grid performance of individual wind turbine generators and wind plants has changed, and is substantially affected by the wind turbine technology. With large MW and penetration levels, wind generation performance is expected to be similar to that of other generating resources. New wind generators typically meet low voltage ride through standards, voltage control, and other large generator interconnection standards. Consequently, the history of relatively poor grid behavior due to old wind generation technology is not representative of new wind generation.

Interconnection requirements are still evolving, and new WECC and FERC requirements for wind plant performance have been created. These requirements, which must be satisfied by new wind plants in the California ISO-controlled Grid, are expected to relieve some of the problematic behavior of older wind plants. Throughout the work presented in this report, analysis is based on the addition of wind generation that is, at least, compliant with the minimum performance standards currently in effect.

The analyses were conducted jointly between the California ISO and General Electric and entailed traditional power flow, transient stability and post-transient voltage stability analysis to assess the overall impact of renewables integration on the performance of the interconnected transmission grid over a broad range of load and wind turbine technology assumptions. The primary objectives of the studies were to determine compliance with the WECC reliability standards for transient and post-transient conditions. In addition, the studies also evaluated whether the new and existing wind plants meet the Low Voltage Ride Through (LVRT) standards and remain on-line during fault conditions.

The primary objectives of the transmission system analysis were as follows:

1. Evaluate transient stability and post-transient voltage performance of the California ISO controlled Grid with increased levels of wind generation in the Tehachapi area.
2. Evaluate the post-transient voltage stability performance (Q-V analysis) of the California ISO controlled Grid with increased levels of wind generation in the Tehachapi area. The evaluation is based on applicable WECC/NERC planning standards on voltage support and reactive power and the WECC voltage stability assessment methodology.





3. Evaluate wind plant functional characteristics that are necessary to achieve acceptable static and dynamic performance of the California ISO controlled Grid.
4. Determine any needed improvements to the Grid to achieve acceptable performance with increased levels of wind generation and other renewable energy resources.


### 3.1. Assumptions and Study Methodology

All studies were performed using the WECC 2010 Heavy Summer peak load and the WECC 2012 Light Spring load system conditions with 4,200 MW of total wind generation modeled in the Tehachapi area. These cases were validated in previous studies and they are representative of heavy summer loads and light spring load conditions. Appendix G addresses the transmission planning process and studies performed to determine the transmission infrastructure and reactive requirements required to accommodate up to 4,372 MW of overall generation in Tehachapi.

#### 3.1.1. Assumptions

- All transmission upgrades outlined in Appendix G, Table G-1 were modeled in both base cases.
- Existing Tehachapi wind generation: 722 MW (mostly connected to Tehachapi 66 kV system) were modeled as WECC Type 1 fixed speed conventional induction generator.
- Total new generation for the Tehachapi Transmission Project is 4,372 MW, of which 3,540 MW is new wind generation and 832 MW is composed of combined cycle and gas turbine.
- No dynamic switching of any shunt capacitors was included in the transient stability analysis.
- Reactive support modeled in the studies:
  - The existing reactive resources for the Tehachapi area were modeled with 317 MVAR voltage-controlled shunt capacitors and 500 MVAR fixed shunt capacitors.
  - The proposed new reactive resources were 700 MVAR of voltage-controlled shunt capacitors, 917 MVAR of fixed shunt capacitors and two Static VAR Compensators totaling 800 MVAR (one at Antelope and the other at Vincent 500 kV Substations).
- 1,300 MVAR fixed shunt capacitors were modeled at wind plants.

**2010 Heavy Summer Peak Load Conditions** – 2010 Heavy Summer Peak Load with 1-in-10 year heat wave demand for Southern California and corresponding peak load in Northern California. Three variations of the Tehachapi wind generation level were studied: 1) wind generation energy production at nameplate capacity, with 474 MVAR of 230 kV shunt capacitors in the Tehachapi area were turned off due to bus voltage greater than 1.05 per unit leaving 869





MVAR in service; 2) wind generation at 25% of rated nameplate capacity, with all 230 kV shunt capacitors in the Tehachapi area turned off; and, 3) wind generation plants off-line, with all 230 kV shunt capacitors in the Tehachapi area turned off. For the studies, all new WTGs were set to regulate terminal voltage to 1.03 per unit. The studies were conducted using the following assumptions:

Table 3-1: Study Assumptions for 2010 Heavy Summer

	<b>Summer 2010 Peak Base Case MW</b>
COI (Path 66) (N to S)	4,284
Path 15 (N to S)	617
Path 26 (N to S)	4,000
PDCI (N to S)	2,000
West of Borah (E to W)	912
Bridger West (E to W)	1,951

**2012 Light Spring Load Conditions** – Light Spring Load conditions with heavy south to north flows on Path 15. Similar to the Summer studies, three variations of the Tehachapi wind generation level were studied: 1) wind generation energy production at nameplate capacity; 2) wind generation at 25% of rated nameplate capacity with all 230 kV shunt capacitors in the Tehachapi area turned off; and, 3) wind generation plants off-line with all 230 kV shunt capacitors in the Tehachapi area turned off. The studies were conducted using the following assumptions:

Table 3-2: Study Assumptions for 2012 Light Spring


	<b>Spring Off-Peak MW</b>
COI (Path 66) S to N	3,542
Path 15 (S to N)	5,400
Path 26 (S to N)	1,583
PDCI (S to N)	2,200
West of Borah (E to W)	1,256
Bridger West (E to W)	2,000

The baseline analysis for all studies was performed assuming that all new wind plants would be equipped with the WECC Type 3 doubly fed wind turbine generators. The existing wind plants in the Tehachapi area were modeled as WECC Type 1 conventional induction generators. A total of 25 contingencies (11 Category B<sup>13</sup> and 14 Category C<sup>14</sup>) were simulated for each of the seasonal wind generation scenarios. The simulation consists of time-domain simulation following the disturbances to evaluate the system transient stability performance and governor power flow to evaluate the post-transient steady state performance.

Finally, several sensitivity studies were performed by varying the mix of the WTG technologies of the new plants based on the actual installations of new wind plants in 2006 (i.e., 10% Type 1 induction generator, 20% Type 3 doubly fed with power factor control, 50% Type 3 doubly fed with fast voltage regulation and 20% Type 4 full converter induction generators.

<sup>13</sup> Category B is the loss of a single element.

<sup>14</sup> Category C is event(s) resulting in the loss of two or more (multiple) elements.







## 3.2. Conclusions

1. With the support of the proposed Tehachapi Transmission Project, 4,200 MW of wind generation in the Tehachapi area can be integrated to the system without causing any transient stability concerns, providing that the wind plants adhere to the WECC LVRT criteria and have some dynamic reactive capability.
2. The dynamics of the bulk power system are not significantly affected by high levels of wind generation (4,200 MW total) in the Tehachapi area. Both transient stability and system damping are satisfactory.
3. The addition of 3,500 MW of Tehachapi wind generation, on the Western Interconnection with more than 100 GW of total generation at light load, has little impact on the frequency response following loss of major generation units (i.e., two Palo Verde nuclear generating units).
4. Dynamic reactive capability at wind plants is required to meet the WECC transient dip performance criteria. Some types of wind turbine technologies include dynamic reactive capability while other types do not (i.e., WECC Types 3 and 4 do provide dynamic reactive capability, while Type 1 does not). Without adequate dynamic reactive capability, wind plants can be expected to trip following major system faults. Voltage dips and spikes, in violation of the WECC criteria, can be expected if a significant number of wind plants connect to the grid without dynamic reactive capabilities.
5. Dynamic reactive capability at wind plants is necessary to ensure system stability. Technology sensitivity analysis shows that system performance is acceptable with either all Type 3 doubly fed WTGs or with a mix of WTG technologies for the new wind plants. The pessimistic test scenario with 100% Type 1 wind plants with no dynamic reactive capability shows an unacceptable response. Therefore, if the dynamic reactive capability is not inherent in the WTG, it must be added to the wind plant.
6. The California ISO may consider requiring that a minimum portion of the required power factor range be dynamic for each new plant. Additional analyses will need to be performed to determine the minimum requirements for the dynamic range.
7. Based on the transient stability and post-transient study results, the bulk system (500 and 230 kV) shunt capacitors and SVCs proposed in the Tehachapi Transmission Project appear to be conservative for the level of wind generation and the system conditions/outages considered in this study. The SVC sensitivity analysis shows that the proposed SVCs were not necessary to achieve acceptable transient stability performance with a likely mix of WTG technologies. With adequate dynamic reactive capability and reasonable assumptions of wind plant operation, system transient stability and post-transient performance is acceptable with fewer capacitors (and possibly smaller/fewer SVCs). This suggests that wind plants with some dynamic reactive capability may reduce or eliminate the need for dynamic reactive devices on the transmission system. Dynamic reactive power supplied close to where it is needed (e.g., at the Type 1 WTG terminals) will be more effective than the dynamic reactive power at a remote location for the potential problems identified in this transient stability analysis. This will require





further analysis to determine the optimal size and location for the dynamic reactive support.

8. The sensitivity analysis shows that the proposed SVCs were not sufficient to achieve acceptable dynamic performance if all of the new wind plants were modeled with 100% Type 1 WTGs and had no dynamic reactive capability. This is a pessimistic assumption, since the majority of the new wind plants that were installed in the U.S. in 2006 were of Types 3 and 4, which provide dynamic reactive support.
9. The post-transient analysis indicated that the grid performance met applicable WECC planning standards, specifically, the post-transient voltage deviation and voltage stability reactive margins. Adequate reactive margins at critical 500 kV and 230 kV buses were observed for critical contingencies, varying between 950 MVAR and 3,400 MVAR for 500 kV buses and between 600 MVAR and 1,300 MVAR for 230 kV buses.
10. The post-transient analysis also indicated that the proposed transmission system to accommodate the additional new wind generation in the Tehachapi area may be highly compensated with the addition of new shunt capacitors. The voltage nose point in the resulting Q-V curves for critical 500 kV buses under critical contingencies is high in the 0.95 – 1.0 p.u. voltage range. Further studies will be required to optimize the coordination between dynamic and static shunt reactive supports and to evaluate if series compensation would be required to help lower the nose point in the Q-V analysis for critical buses under critical contingencies (i.e., tripping of one SONGS unit while the other unit was already out of service in the power flow case).

### 3.3. Recommendations

1. The new wind plants need to comply with the WECC LVRT requirements.
2. The majority of additional new wind plants need to be of WECC Types 3 or 4 for producing dynamic reactive support to help the transmission grid meet applicable WECC transient stability performance standards and to avoid wind generators tripping due to low voltage conditions. In the event that the new wind plants are of Type 1 or 2 with no dynamic reactive capability, additional studies will be required to determine the appropriate amount of external dynamic reactive support at these wind plants.
3. The reactive support that was proposed as part of the Tehachapi Transmission Project may need to be re-evaluated to determine the optimal location and size for the dynamic reactive support (i.e., SVCs).
4. Additional analysis will be needed to determine potential solutions for improving the nose point for critical 500 kV buses under critical contingency conditions. Potential solutions for improving the voltage nose point include the use of series compensation and reduction of proposed shunt compensation.







### 3.4. Wind Plant Representation in the Power Flow

Since wind plants normally consist of a large number of individual WTGs, the modeling of the plant for load flow analysis could be simple or could consist of a detailed representation of each WTG and the collector system. The simpler model shown in Figure 3-1 is adequate for most bulk transmission system studies. This model consists of a single WTG and unit transformer with MVA ratings equal to  $N$  times the individual device ratings, where  $N$  is the number of WTGs in the wind plant (or those considered to be on-line for study purposes). An equivalent impedance to reflect the aggregate impact of the collector system can be included together with the substation step-up transformer(s). The total charging capacitance of the collector system can also be included. The charging capacitance can be significant since underground cables are often used for the collector system. A third alternative is to model several groups of WTGs, each represented by a single model, with a simplified representation of the collector system. The wind plants included in this study use both of these equivalent modeling approaches.

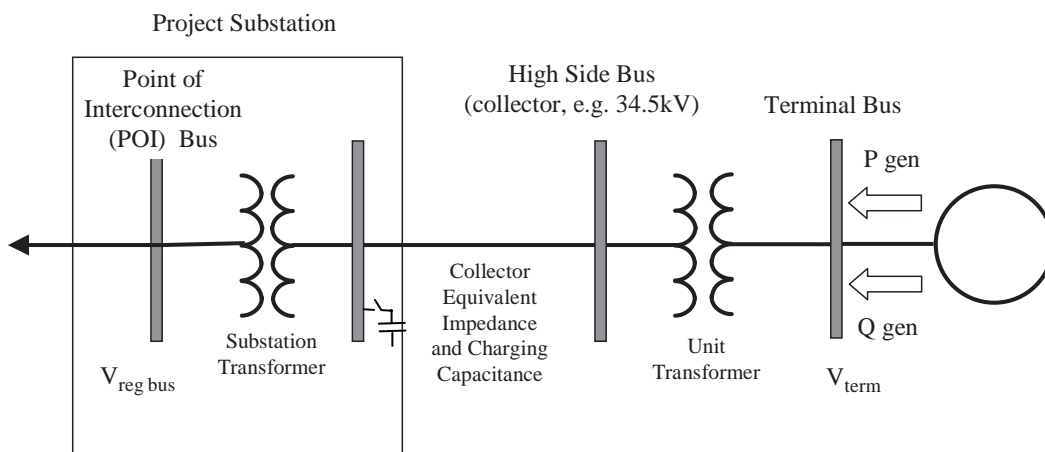


Figure 3-1: Wind Plant Equivalent Model

From an analysis perspective, it is important to understand that the aggregate WTG behaves like a conventional generator connected to a voltage control (PV) bus in the power flow analysis. The generator real power ( $P_{gen}$ ) and reactive capability ( $Q_{max}$  and  $Q_{min}$ ) are input to reflect the aggregate WTG capability. Typical collector system voltages are at distribution levels (typically 12.5 kV or 34.5 kV) from where a suitable sized substation transformer is used to connect to the grid. Some of the wind plant models in this study include shunt capacitors on the collector side of the substation transformer, as illustrated in Figure 3-1. These capacitors replace or augment reactive capability from the WTGs, so that the power factor requirement of the grid code is met.

### 3.5. Dynamic Modeling Discussion

As noted above, wind generation technology has evolved rapidly in recent years. Dynamic modeling of wind generation, particularly newer technology WTGs, is a challenge for the industry. The Western Electricity Coordinating Council (WECC) Modeling & Validation Work





Group (MVWG) convened a Wind Generator Modeling Group (WGMG) in 2005 to address the challenge. The charter of that group is to “develop a small set of generic (non-vendor specific), non-proprietary, positive-sequence power flow and dynamic models suitable for representation of all commercial, utility-scale WTG technologies in large scale simulations.” The models are suitable for typical transmission planning and system impact studies. All of the current commercially available utility scale wind turbines can be grouped into four basic topologies based on how they interface with the grid. The notation that the workgroup adopted, which is gaining industry acceptance, is as follows:

Type 1 – conventional induction generator

Type 2 – wound rotor induction generator with variable rotor resistance

Type 3 – doubly-fed induction generator

Type 4 – full converter interface

Simple schematics of these four topologies are shown in Appendix F (again, courtesy of the WECC WGMG). Dynamic simulations performed have been based on available industry data and current state-of-the-art models of these different generators.


Type 1 machines operate in a very narrow speed range, and always consume reactive power during operation. The reactive power consumption is a function of active power production and grid conditions, and it cannot be controlled. Consequently, both the reactive power consumption of the generator and the reactive power requirements of the grid must be supplied by additional equipment – usually switched shunt capacitors.

Type 2 machines have wider speed variation and tend to exhibit slower active power fluctuations than Type 1 machines, but have similar reactive power characteristics. Under load, the machines consume reactive power equal to approximately half of the MW output.

Type 3 and Type 4 machines use substantial power electronics to provide wider speed range and finer control of active power production. The power electronics also inherently provide the ability to produce or consume reactive power. It is largely controllable independent from the active power production. In this regard, these machines resemble conventional synchronous generators with excitation systems and automatic voltage regulators (AVR). The details of performance are different between manufacturers. Generally, wind plants with Type 3 or Type 4 generators have the ability to provide relatively fast voltage or power factor control. The ways in which each manufacturer controls and coordinates the reactive power production and balance differs. The great majority of wind generation built in the U.S. in 2006 was of Type 3 or 4.

### 3.6. Transient Stability Characteristics of Wind Turbine Technologies

The transient stability behavior of the various WTG technologies can be substantially different. Outages that cause deep voltage dips can be problematic for Type 1 plants. A severe voltage dip may cause the induction generators to speed up and eventually pull out of their torque-speed





characteristics. This causes them to trip. This response is similar to an induction motor stalling and tripping following a system fault. The risk of tripping is a function of machine characteristics, initial wind power, grid stiffness and dynamic reactive power supply. This type of trip is not a violation of LVRT requirements, as the unit tripping occurs after the fault is cleared. It should be noted that the existing Type 1 plants may or may not have LVRT capability. Therefore, it is possible that the existing plants would trip sooner than these simulations indicate. In cases with new Type 1 plants, they must be LVRT compliant, but they may still trip due to this over speed behavior.

Since Type 3 and Type 4 machines are variable speed, these machines are not limited by conventional transient stability angular constraints. These machines cannot lose local angular stability like a synchronous machine, although it is possible for grid separation to occur. The variable speed controls tend to make this type of wind generator largely unsusceptible to low frequency grid oscillations as well.

### 3.7. Fault Disturbance List

Twenty-five line faults, generation trips and Pacific DC Intertie (HVDC) outages were studied for the two system conditions (Heavy Summer and Light Spring) and three wind conditions (full, low and no wind). The implementation of two of the faults (Midway-Vincent 500 kV double line outage and the HVDC) varied depending on system conditions. Specifically, the generation special protection scheme associated with the Midway-Vincent 500 kV double line outage was only implemented under Heavy Summer conditions. Under those same conditions, the HVDC fault included the tripping of northwest generation appropriate for the north-to-south direction of flow on the HVDC line. Light Spring conditions, the HVDC fault included the tripping of northwest load appropriate for south-to-north flow.

Table 3-3: Contingency Description

<b>Outage</b>	<b>Description</b>
Diablo-g2	Loss of 2 Diablo Canyon Generators.
IPP-bipolar	Loss of IPP bipole with north to south flows.
Lugo-Mira Loma-dlo-12slg	1-phase, 12 cycle fault at Lugo 500 kV. Loss of 2 Lugo-Mira Loma 500 kV lines.
Lugo-Vincent-dlo	3-phase, 4-cycle fault at Lugo 500 kV. Loss of 2 Lugo-Vincent 500 kV lines.
Lugo-Vincent-slo	3-phase, 4-cycle fault at Lugo 500 kV. Loss of 1 Lugo-Vincent 500 kV lines.
Midway-Vincent-dlo-SPS	3-phase, 4-cycle fault at Midway 500 kV. Loss of Midway-Vincent 500 kV lines; SPS generation trip.
Midway-Vincent-dlo-no SPS	3-phase, 4-cycle fault at Midway 500 kV. Loss of Midway-Vincent 500 kV lines.
Palo Verde-g2	Loss of 2 Palo Verde generators.






PDCI-NS-bipolar	Loss of PDCI Bipole with north to south flows.
PDCI-SN-bipolar	Loss of PDCI Bipole with south to north flows.
Palo Verde-Devers-slo	3-phase, 4-cycle fault at Palo Verde 500 kV. Loss of Palo Verde-Devers 500 kV line.
SONGS-g1-svc	Loss of 1 SONGS generator.
Sub.1-Antelope-slo	3-phase, 4-cycle fault at Tehachapi Sub. 1 500 kV. Loss of Tehachapi Sub. 1-Antelope 500 kV line.
Sub.1-Sub.5-slo	3-phase, 4-cycle fault at Tehachapi Sub. 1 500 kV. Loss of Tehachapi Sub. 1-Sub. 5 500 kV line.
Sub. 5-Midway-slo	3-phase, 4-cycle fault at Tehachapi Sub. 5 500 kV. Loss of Tehachapi Sub. 5-Midway 500 kV line.
Sub. 5-South-dlo	3-phase, 4-cycle fault at Tehachapi Sub. 5 500 kV. Loss of Sub. 5-Antelope and Sub. 5-Vincent 500 kV lines.
Vincent-Antelope-dlo	3-phase, 4-cycle fault at Vincent 500 kV. Loss of 2 Vincent-Antelope 500 kV lines.
Vincent-Antelope-slo	3-phase, 4-cycle fault at Vincent 500 kV. Loss of 1 Vincent-Antelope 500 kV line.
Vincent-Mesa230-dlo	3-phase, 4-cycle fault at Vincent 230 kV. Loss of 2 Vincent-Mesa Cal 230 kV lines.
Vincent-Mesa230-slo	3-phase, 4-cycle fault at Vincent 230 kV. Loss of 1 Vincent-Mesa Cal 230 kV line.
Vincent-North-dlo	3-phase, 4-cycle fault at Vincent 500 kV. Loss of Vincent-Antelope-Sub. 5 500 kV lines.
Vincent-Rio Hondo-dlo	3-phase, 4-cycle fault at Vincent 230 kV. Loss of 2 Vincent-Rio Hondo 230 kV lines.
Vincent-Rio Hondo-slo	3-phase, 4-cycle fault at Vincent 230 kV. Loss of 1 Vincent-Rio Hondo 230 kV line.
Imperial Valley-Windfarms-slo	3-phase, 4-cycle fault at Imperial Valley 500 kV. Loss of Imperial Valley-Windfarms 500 kV line.
Windfarms-Miguel-slo	3-phase, 4-cycle fault at Windfarms 500 kV. Loss of Windfarms-Miguel 500 kV line.

### 3.8. Performance Criteria

System performance was evaluated based on “WECC Planning standards, WECC Disturbance-Performance Allowable Effects on Other Systems.” In particular, voltage and frequency dips violating the WECC criteria at load buses were identified. Tripped wind turbine generators and new wind turbines within 90% of LVRT were also identified. The following specific performance tests conform to the WECC LVRT standard and were run on all simulations:

- Identify load-bus voltage dips exceeding 20% for more than 20 cycles for n-1 contingencies.





- Identify load-bus voltage dips exceeding 20% for more than 40 cycles for n-2 contingencies.
- Identify load-bus frequency dips below 59.6 Hz for more than 6 cycles.
- Identify new WTGs with 15% or greater voltage dip for 2.41 seconds.
- Identify new WTGs with 45% or greater voltage dip for 1.56 seconds.
- Identify new WTGs with 65% or greater voltage dip for 0.99 seconds.
- Identify new WTGs with 80% or greater voltage dip for 0.14 seconds.
- Identify new WTGs with 85% or greater voltage dip. This corresponds to the original FERC Order 661A minimum voltage recommendation.
- Identify new WTGs with 25% or greater voltage rise for 0.09 seconds.
- Identify all tripped generators.

### ***3.8.1. Transient Stability Performance***

Baseline simulations modeled all new wind projects with WECC Type 3 WTGs (doubly-fed induction generator). Existing wind farms in the Tehachapi area were all modeled with WECC Type 1 WTGs (induction generators).

Twenty-five single line, double line, generation trip and HVDC outages were studied for the two system conditions (Heavy Summer and Light Spring) and three wind conditions (full, low and no wind). In particular, voltage and frequency dips violating the WECC criteria at load buses in California were identified. Tripped wind turbine generators were also identified.

A discussion of system performance with high concentrations of new wind generation follows.

### ***3.8.2. WECC 20% Voltage Dip Criteria***

The Vincent-Antelope 500 kV single line outage was the only Category B outage that caused a voltage dip below 20% for more than 20 cycles at a load bus. The violation only occurred at the Cal Cement 66 kV bus under Light Spring conditions with full wind output. The bus voltage dipped to 38% and was below 20% for 21 cycles. This bus is located close to the existing Tehachapi wind parks. The low voltage dip and slow recovery is primarily caused by the response of the existing Type 1 induction generator wind turbines.

None of the WECC Category C outages caused voltage dips greater than 20% for more than 40 cycles.







### 3.9. Wind Turbine Trips

While there was only one outage that caused a WECC 20% voltage dip criteria violation at a load bus, several outages caused deep prolonged voltage dips at and around existing wind plants. Trips only occurred for full wind conditions, with all wind plants at 100% MW output. Only existing wind plants (WECC Type 1, induction generators) tripped. Under the base modeling assumption that all new units are WECC Type 3, the new units were able to ride through all faults and generation outages without tripping. Figure 3-2 shows bus voltages for the Vincent-Antelope 500 kV single line outage fault for the Light Spring condition. This case had 270 MW of wind generation tripped for the full wind condition, and was the only case to cause WECC voltage dip violations. The top two plots show the Breeze and Cal Cement 66 kV load bus voltages. Under full wind, the voltage at Breeze recovers just within the WECC 20% voltage dip criteria, remaining below 20% for 20 cycles. The Cal Cement bus fails the criteria with a dip below 20% for 21 cycles. For low wind and no wind conditions, the voltage recovery meets the WECC criteria.


The middle two plots show the Tehachapi Sub. 1 500 kV and 230 kV bus voltages. The 500 kV voltage dips during the fault, but recovers to its initial value in about 0.5 seconds. Upon fault clearing, the 230 kV bus voltages settle below 0.8 per unit. At 0.5 seconds after the fault, several existing Type 1 wind plants begin to trip. Within a few tenths of a second, all 270 MW of wind turbines tripped. This caused an over-voltage condition on the 230 kV bus. With low wind and no wind, the 230 kV voltages recover within 0.5 seconds, and there are no wind turbine trips.


The last two plots show the TehachMM and Eastwind 570 volt bus voltages. These show the lack of voltage recovery of Type 1 wind plants following the fault under full wind condition. The voltage dip causes the induction generators to speed up and eventually pull out of their torque-speed characteristics. This increases the reactive power consumption of the induction generators and keeps voltage throughout the area depressed. The poor voltage recovery is made worse by the relatively weak 66 kV transmission system connecting the existing wind plants.

This is not an LVRT issue, since the units are able to ride through the fault. Rather, it is a fast voltage collapse caused by the induction generators on a weakened transmission system with a lack of dynamic reactive support. This is the same phenomenon as the fast voltage collapse caused by induction motors stalling.

For the simulations in this study, the Type 1 units are tripped based on an under-voltage function (voltage less than 0.85 per unit for more than 0.5 seconds). The actual protective function tripping an induction generator under these conditions could be under-voltage, over-speed or over-current. The timing of a trip could range from fractions of a second to several seconds. The longer the trip time, the greater the potential of a cascading event whereby additional wind turbines and customer loads are tripped. The extent of generation and load loss cannot be accurately predicted through simulations.

Figure 3-2 shows that the behavior of the older, existing wind plants is poor. As noted previously, the behavior of these machines is they trip from under-voltage but their performance is not exactly captured by the model. Details of the behavior are likely to be different. However, the





most important observation from this case comes from comparison to the new wind plants, as shown in Figure 3-3.

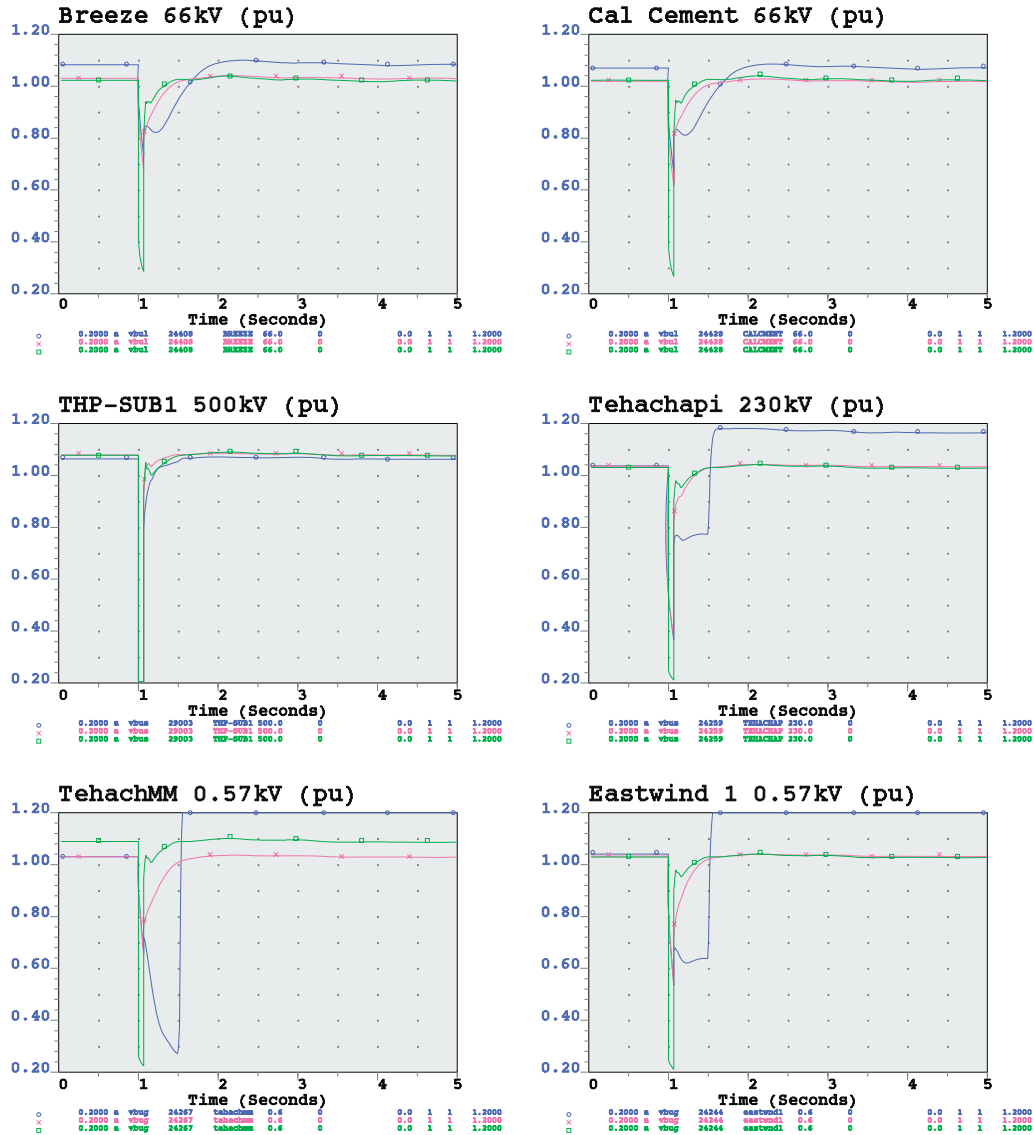


Figure 3-2: Bus Voltages Near Existing Wind Plants Following the Vincent-Antelope (SLO) for 2012 Light Spring – Full Wind, 25% Wind and No Wind Conditions

Figure 3-3 shows a plot of representative 230 kV bus voltages near new WECC Type 3 wind plants. The terminal voltages of the new wind plants recover within 0.25 seconds of fault clearing. The voltage recovery is actually faster with the wind turbines on-line (full wind and low wind) than off-line (no wind). This is due to the dynamic voltage support of the Type 3 doubly-fed induction generators. The good behavior of the new plants is largely decoupled from the poor behavior of the existing wind plants.






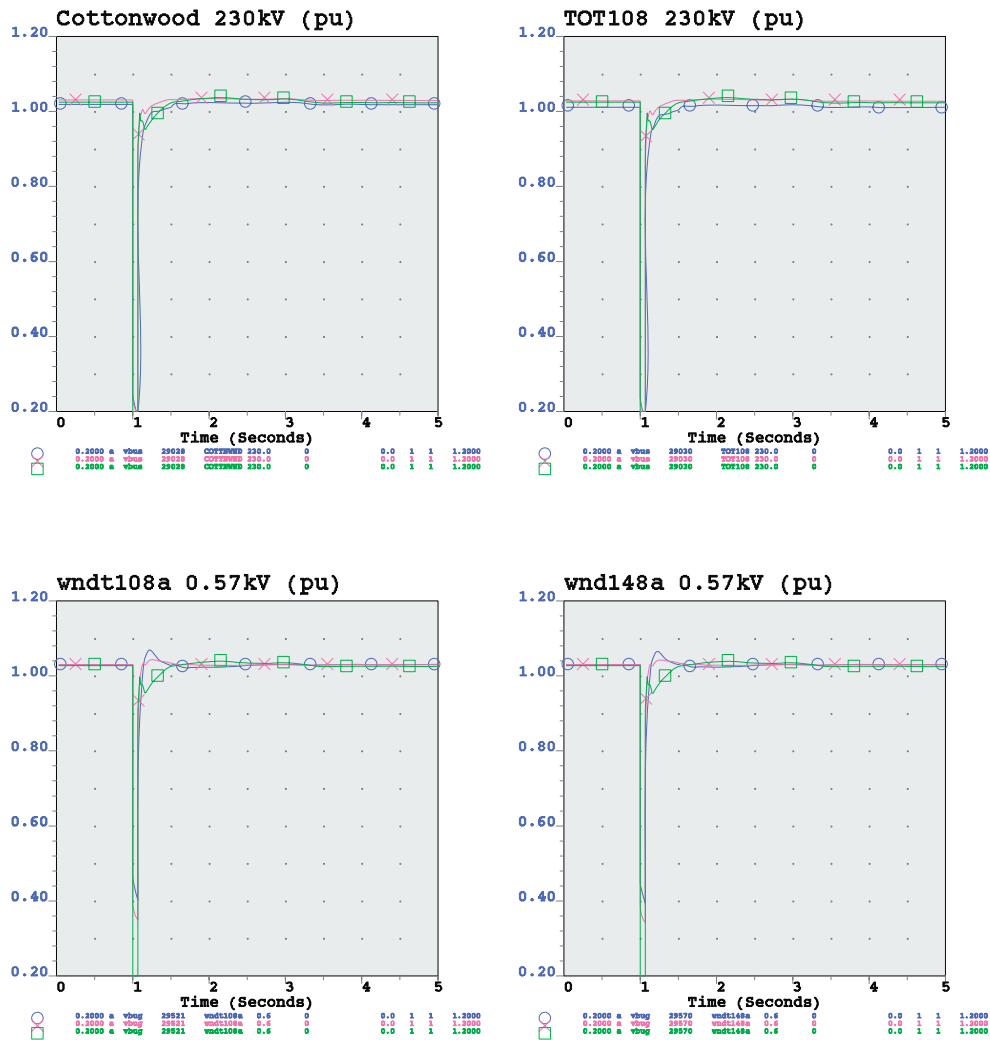


Figure 3-3: Bus Voltages Near New Wind Plants Following the Vincent-Antelope (SLO) for 2012 Light Spring, Full Wind, Low Wind and No Wind Conditions

As noted above, none of the outages tested caused new Type 3 doubly fed wind plants to trip. Furthermore, none of the new Type 3 wind plants came within 90% of the LVRT trip points.

### 3.10. Frequency Response

None of the contingencies resulted in WECC frequency dip violations. Furthermore, there was no measurable difference in the system frequency between the full wind, low wind and no wind cases for the generation trip contingencies. A comparison of the three wind conditions is shown in Figure 3-4 for the loss of two Palo Verde generators for the Light Spring conditions. The plot shows Antelope 500 kV bus voltage and frequency, Antelope SVC output, a 230 kV bus voltage near a new wind plant, Path 26 power flow and San Onofre real power output. The





full wind (blue), low wind (red) and no wind (green) cases are all shown.

The frequency at Antelope dips to about 59.7 Hz and begins to recover within about 8 seconds of the generation trip. The Antelope frequency is improved slightly with the higher level of wind generation. The Path 26 power flow and San Onofre power output are all nearly identical for the three wind conditions.

### 3.11. Power Swings

The plots in Figure 3-4 show very little difference in power swings on Path 26 or San Onofre power output for the different wind scenarios. This is consistent with results from all the generation and HVDC trip scenarios. The addition of about 3,500 MW of new wind generation in Tehachapi and the associated redispatch of existing generation with more than 100 GW of total generation in the Western Interconnection does not affect power swings on the California ISO system.

### 3.12. Summary of Baseline Performance

The baseline analysis modeled all new wind projects with the WECC Type 3 WTGs (double-fed induction generators) and the existing wind plants with the WECC Type 1 WTGs (induction generators). Under this assumption, the new wind plants do not cause performance problems on the California ISO controlled Grid. The LVRT requires the wind plants to remain on-line following major grid disturbances. The dynamic voltage support provided by the Type 3 machines improves the system voltage recovery after fault clearing.

An additional factor that contributes to the performance of the new wind generation is the transmission interconnection points. The new wind projects are connected to strong 230 kV Substations with sufficient transmission capacity to withstand nearby faults.

The new wind turbines have very little impact on power swings or the California ISO interface flows. The frequency response following the loss of large thermal generation is not affected by the additional wind generation.

The existing Type 1 wind plants do not have dynamic voltage control ability. On the contrary, they degrade voltage recovery following nearby faults. While the units may be able to ride through transmission system faults, they may not be able to remain on-line. Their poor voltage recovery could lead to a localized voltage collapse and the loss of several hundred MWs of existing wind generation. The weak 66 kV system that many of the existing wind plants are connected to compounds this problem.




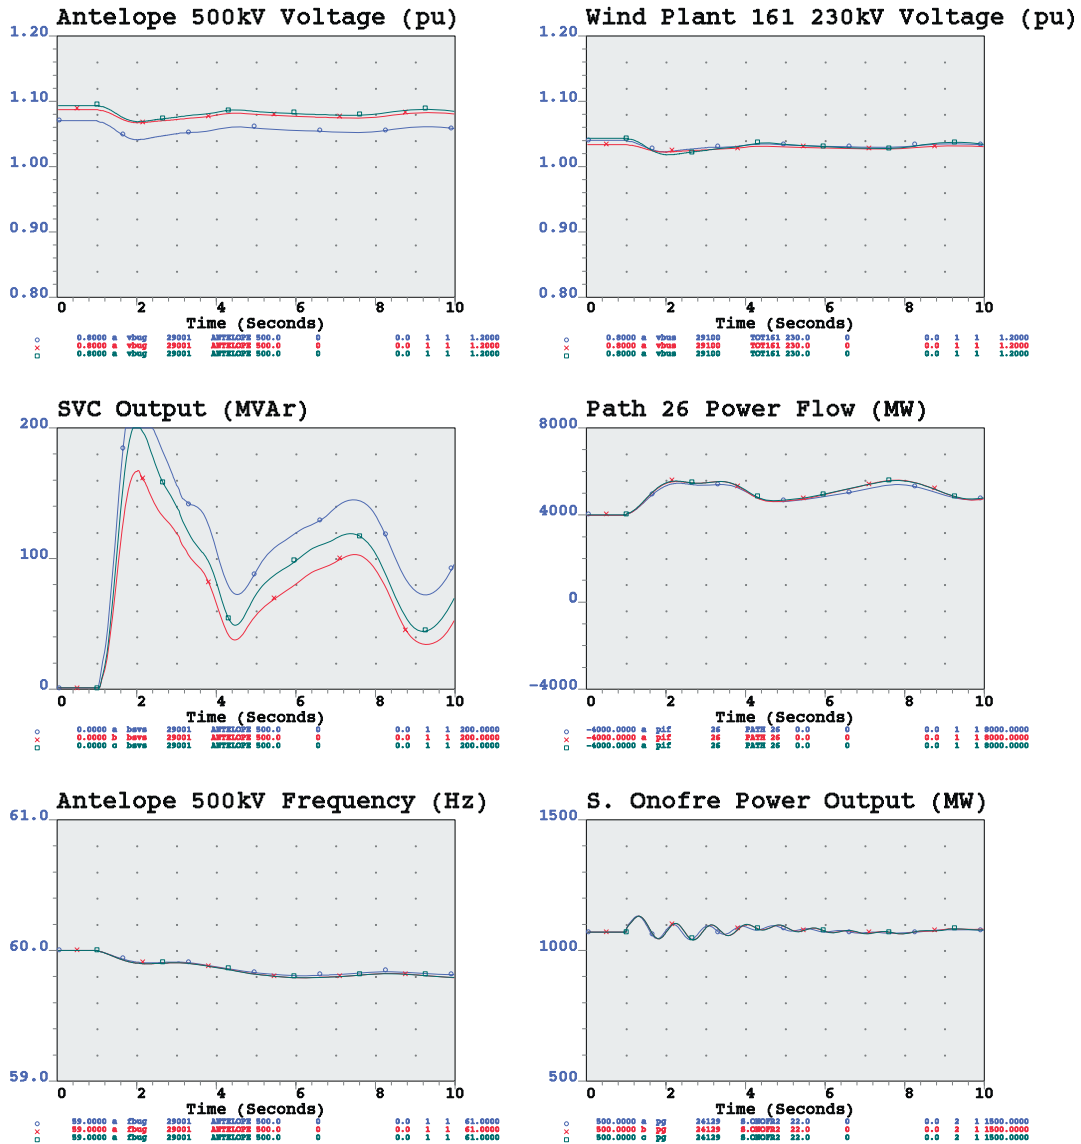


Figure 3-4: System Performance Overview, Loss of Two Palo Verde Generators, 2012 Light Spring Load (Blue-Full Wind; Red-Low Wind; Green-No Wind)

### 3.13. WTG Technology Sensitivity Cases

The sensitivity of power system performance to WTG technology was tested for the most severe faults identified in the baseline analysis.

- Vincent-Antelope 500 kV double line outage
- Midway-Vincent 500 kV double line outage
- Sub. 5-South double line outage
- Loss of 2 Palo Verde generators





Both the Heavy Summer and Light Spring conditions were evaluated with all new and existing wind plants at full output.

As noted above, the baseline analysis was performed assuming all new wind plants would use Type 3 doubly fed WTGs. Two additional scenarios were evaluated. The first assumed a mix of WTG technologies in the new plants, as follows:

- 10% Type 1 induction generator
- 20% Type 3 doubly fed with power factor control
- 50% Type 3 doubly fed with fast voltage regulation
- 20% Type 4 full converter

This mix was based on the technology distribution of the wind plants or individual WTGs installed within the U.S. in 2006.

The second scenario assumed all new wind plants would use Type 1 induction generator WTGs. Given the 2006 technology distribution, this is a pessimistic scenario.

A comparison of system performance for the three WTG technology scenarios is shown in Figure 3-5. The Vincent-Antelope 500 kV double line outage was applied to the Light Spring conditions with full wind plant output. The black line represents the baseline performance with 100% Type 3 doubly fed wind plants, the red line represents the mixed WTG technology scenario, and the green line represents the 100% Type 1 induction generator scenario.


System response with all new wind plants using Type 3 doubly fed WTGs meets WECC voltage and frequency criteria, and results in the loss of 270 MW of existing Type 1 induction generator wind plants. System response with the mix of WTG technologies in the new wind plants also results in the loss of 270 MW of existing Type 1 wind plants. System response with all new wind plants using Type 1 WTGs was unacceptable. Approximately 4,000 MW of Type 1 wind plants, both old and new, tripped during the simulation.

System performance is acceptable with all Type 3 doubly fed WTGs in the new wind plants. System performance is also acceptable with the mix of WTG technologies in the new wind plants, but the fault recovery is slightly slower. Thus, the wind plants with dynamic VAR capability (i.e., Type 3 doubly fed and Type 4 full converter) support those without such capability. As noted above, the new Type 1 induction generator wind plants in this analysis are WECC LVRT criteria compliant but do not have any dynamic VAR range. Thus, the pessimistic test scenario with 100% Type 1 wind plants with no dynamic VAR capability showed an unacceptable response. This sensitivity analysis suggests that some dynamic VAR capability may be necessary to ensure system stability. Therefore, if the dynamic VAR capability is not inherent in the WTG, it may need to be added to the wind plan or to the local transmission system.







Antelope 500kV Voltage (pu)

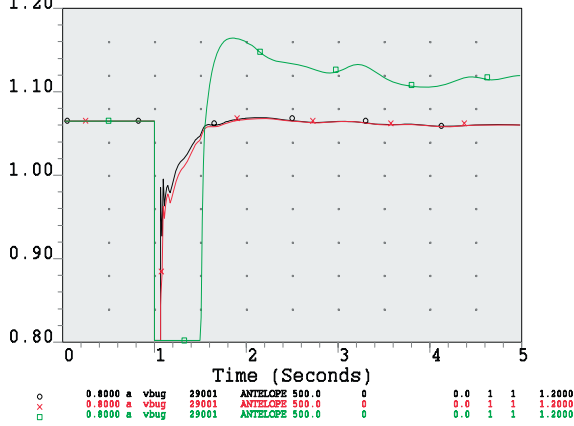


Wind Plant 161 230kV Voltage (pu)

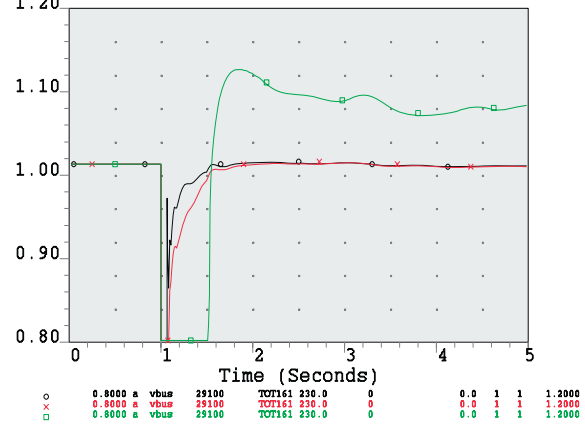


Antelope 500kV SVC Output (MVar)

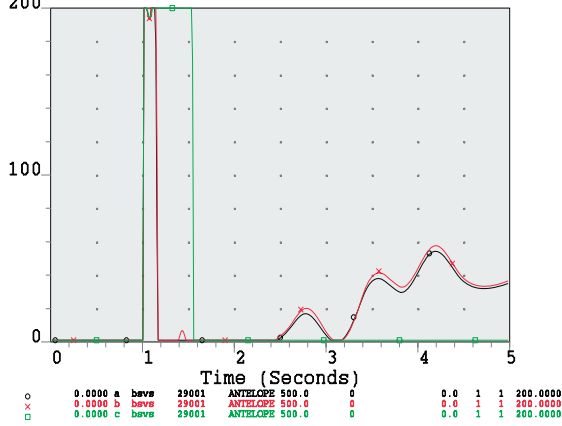

Path 26 Power Flow (MW)

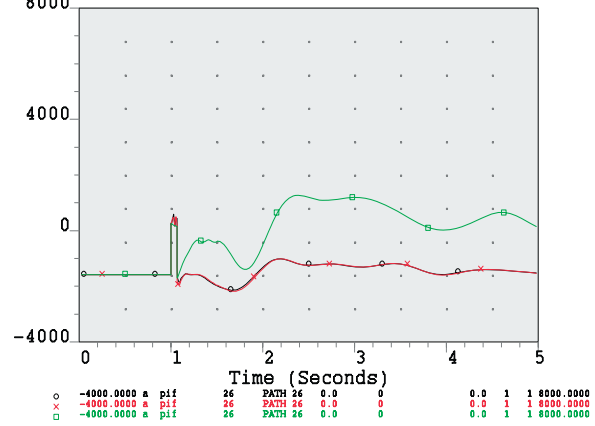

Antelope 500kV Frequency (Hz)

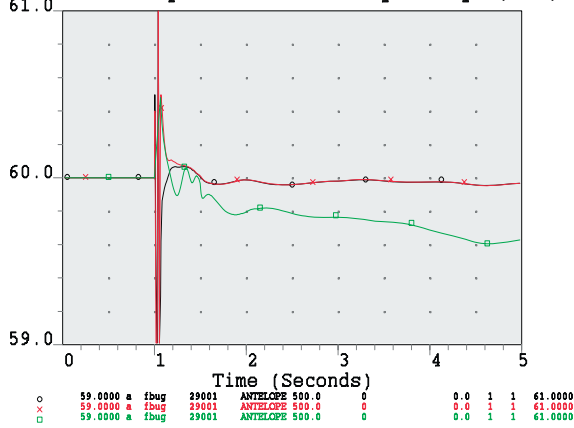

S. Onofre Power Output (MW)


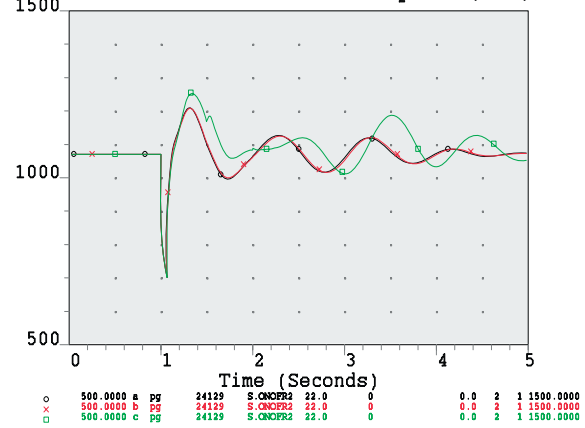


Figure 3-5: System Performance Overview, Vincent-Antelope 500 kV Double Line Outage, 2012 Light Spring Load, Full Wind Plant Output (Black-100% Type 3 Doubly Fed; Red-Mixed Technology; Green-100% Type 1 Induction Generator)





### 3.14. Dynamic Reactive Compensation Sensitivity Cases

While analyzing the baseline simulation results, it was observed that the Antelope and Vincent SVCs were not providing much reactive power to the system after fault clearing. Rather, the SVCs were providing reactive power during the fault and then again several seconds after the fault. Therefore, an evaluation of SVC response was also performed. The sensitivity analysis evaluated the Heavy Summer conditions for the following most severe faults identified in the baseline analysis:

- Vincent-Antelope 500 kV double line outage
- Midway-Vincent 500 kV double line outage
- Sub. 5-South 500 kV double line outage

All wind plants were at full power output, with mixed WTG technologies in the new wind plants and Type 1 induction generator WTGs in the existing wind plants.

A comparison of system performance for three SVC scenarios is shown in Figure 3-6. The Vincent-Antelope 500 kV double line outage was applied to the system with full wind plant output. The black line represents the baseline performance with the 200 MVAR Antelope and 600 MVAR Vincent 500 kV SVC model as provided, the red line represents performance with modified dynamic SVC models at both locations, and the green line represents performance with neither SVC in service.

The modified dynamic model of the Antelope SVC provides more reactive power post-fault than the original model. As a result, the immediate post-fault voltage on the Antelope 500 kV bus is increased by about 2%. System response with both SVCs out of service is nearly identical to that with the original SVC model. The WECC voltage and frequency criteria were met, and the total loss of existing Type 1 induction generator wind plants was unchanged.


This analysis shows that the SVCs were not necessary to achieve acceptable performance with a likely mix of WTG technologies. If the SVCs are needed for other reasons, the dynamic models should be tuned to achieve better SVC response.

This analysis also shows that the SVCs were not sufficient to achieve acceptable performance with 100% Type 1 WTGs and no dynamic reactive capability in the new wind plants. This suggests that wind plants with some dynamic VAR capability will reduce or eliminate the need for dynamic reactive devices on the transmission system. Reactive power supplied close (e.g., at a wind plant Substation) to where it is needed (e.g., at the Type 1 WTG terminals) will be more effective than reactive power at a remote location for the potential problems identified in this transient stability analysis.







Antelope 500kV Voltage (pu)

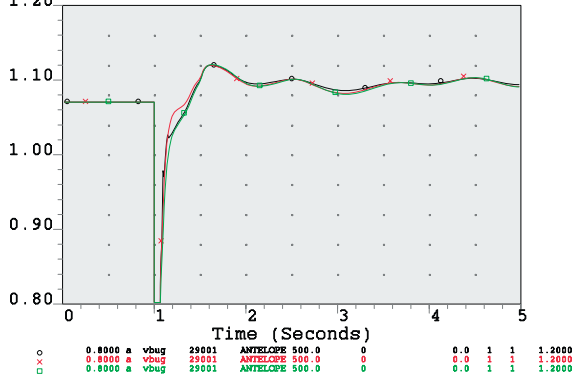


Wind Plant 161 230kV Voltage (pu)

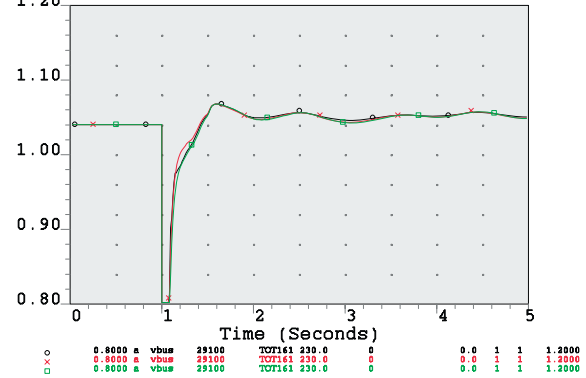


Antelope 500kV SVC Output (MVar)

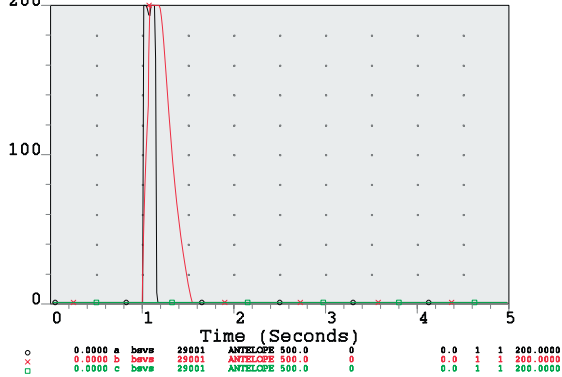

Path 26 Power Flow (MW)

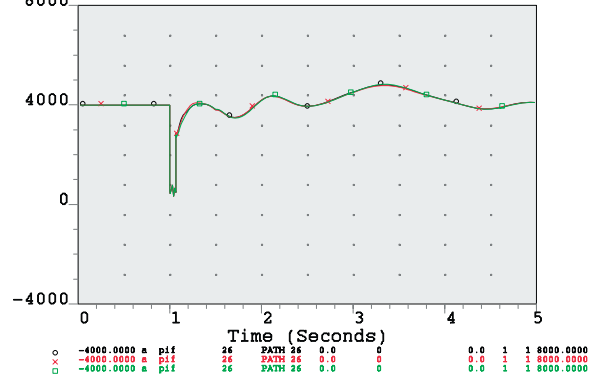

Antelope 500kV Frequency (Hz)

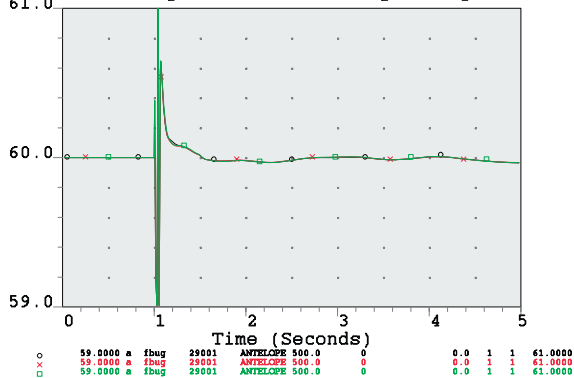

S. Onofre Power Output (MW)


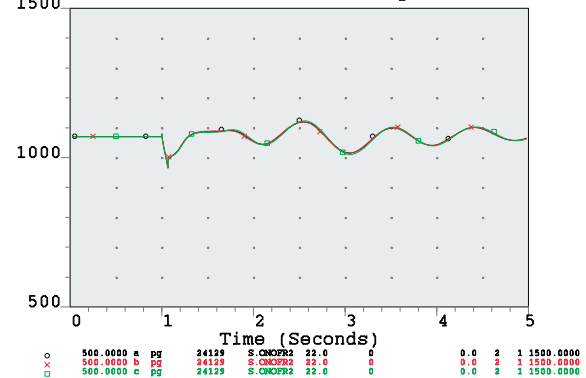


Figure 3-6: System Performance Overview, Vincent-Antelope 500 kV Double Line Outage, 2010 Heavy Summer Load, Full Wind Plant Output, Mixed Technology (Black-Nominal SVCs; Red-Modified SVCs; Green-No SVCs)







### 3.15. Post-Transient Studies

Post-transient governor power flow studies were performed to evaluate the following:

- Post-transient voltage deviation analysis under three Tehachapi wind generation levels (i.e., full wind, low wind with 25% of nameplate capacity, and no wind) for both the 2010 Heavy Summer load and the 2012 Light Spring load conditions;
- Voltage stability assessment through Q-V analysis to determine reactive margin at key bus voltages under various critical contingencies.

#### *3.15.1. Post-transient voltage deviation analysis*

Post-transient governor power flow analyses were performed for the following 23 contingencies:

1. Palo Verde – Devers 500 kV single line outage
2. Vincent – Rio Hondo 230 kV single line outage
3. Sub. 5 (aka Whirl Wind) – Midway 500 kV single line outage
4. Vincent – Antelope 500 kV double line outage
5. Lugo – Mira Loma 500 kV double line outage
6. Vincent – Rio Hondo 230 kV double line outage
7. Vincent – Mira Loma 500 kV single line outage
8. Sub. 1 (aka Wind Hub) – Antelope 500 kV single line outage
9. Vincent – Antelope 500 kV single line outage
10. Vincent – Mesa 230 kV single line outage
11. Diablo G-2 (two nuclear units) outage
12. Vincent – North 500 kV double line outage (i.e., Vincent – Antelope & Vincent – Sub. 5 500 kV lines)
13. Vincent – Mesa 230 kV double line outage
14. Lugo – Vincent 500 kV double line outage





15. Sub. 1 – Sub. 5 500 kV single line outage
16. Lugo – Vincent 500 kV single line outage
17. Sub. 5 – South 500 kV double line outage (i.e., Sub. 5 – Antelope & Sub. 5 – Vincent 500 kV lines)
18. Midway – Vincent 500 kV double line outage (#1 & 2-500 kV lines)
19. Imperial Valley – Miguel 500 kV single line outage
20. Intermountain Power Project DC (IPPDC) bipolar outage
21. Palo Verde G-2 (two nuclear units) outage
22. Pacific DC Intertie (PDCI) bipolar outage
23. SONGS G -1-1 (one SONGS out of service initially, followed by the second unit outage)

### ***3.15.2. Voltage stability (Q-V) analysis***

Q-V analysis was performed for all critical 23 contingencies to determine the following:

1. Whether the integration of 4,200 MW wind generation meet applicable WECC planning standards by having positive reactive margin at key monitored buses under critical contingencies;
2. Whether the proposed reactive support provides satisfactory voltage performance (i.e., nose point voltage) under critical contingencies;
3. Whether additional analyses will be required to determine the optimal reactive support to meet the WECC voltage stability planning standards and to achieve better voltage performance (i.e., nose point) under Q-V analysis.

The buses monitored are located within PG&E and SCE systems near the Tehachapi wind plants: Midway 500 kV, Vincent 500 kV, Sub. 1 500 kV, Antelope 230 kV and High Wind 230 kV. In addition, major load bus such as Mira Loma 500 kV and major switching station such as Lugo 500 kV were also evaluated. To determine the available reactive margin at a specific bus, a fictitious synchronous condenser with a reactive range of  $\pm 3,000$  MVAR<sup>15</sup> was modeled, with scheduled voltage reduced automatically, by using a program, in small increment until voltage collapse is expected. A system voltage is unstable if the bus voltage magnitude decreases as the reactive power injection is increased.

<sup>15</sup> This range can be changed for higher value for the Q-V analysis. The higher range requires more computation time.






Following is the summary of the Q-V study results:<sup>16</sup>

1. The post-transient analysis study results indicate that the grid performance meets applicable WECC planning standards on voltage stability. Adequate reactive margins at critical 500 and 230 kV buses were observed for critical contingencies, varying between 950 MVAR and more than 3,000 MVAR for 500 kV buses and between 600 MVAR and 1,300 MVAR for 230 kV buses.
2. The Q-V plots from the Heavy Summer load scenario (shown in Figure 3-7) indicate that the full-wind generation level corresponds to the least amount of available reactive margin. This condition is likely caused by a high level of power transfer (approximately 6,300 MW) between the Tehachapi wind plants and imports from PG&E (via Path 26, which is the Midway-Vincent 500 kV intertie between PG&E and SCE systems), and the load centers in the L.A. basin. On the other hand, with partial wind generation output (i.e., 25% of nameplate capacity), the resultant reactive margin is better than the scenario where there is no wind generation. This indicates that better reactive margin performance, under the partial wind generation scenario, is contributed by the new wind turbines providing reactive support to the system under critical contingencies.
3. The Q-V analysis for the Heavy Summer load conditions indicate that the proposed transmission system to accommodate the additional new wind generation in the Tehachapi area may be highly compensated with the addition of new shunt capacitors. This is shown on the Q-V plots with high voltage nose points for various 500 kV buses under critical contingencies in the range of 0.95 – 1.0 p.u. voltage. Further analysis will be needed to optimize the additional reactive supports and to evaluate if series compensation would be required to help lower the voltage nose point in the Q-V analysis. See Figure 3-8.
4. For the analysis of the Heavy Summer load conditions, the new wind farms in the Tehachapi area were studied with the assumption that there would be no reactive consumptions at the wind plants. To accomplish this, the terminal voltage at the wind farms were scheduled higher (i.e., typical set point was 1.03 p.u. for many of these wind plants) to provide reactive support and to maintain power factor close to unity at its terminal voltage. If the plant's terminal voltage was inadvertently scheduled lower, then it may trigger the plant to absorb reactive power. Consequently, this will affect the Q-V analysis results as this may show higher voltage nose point due to the utilization of additional shunt capacitors at the point of interconnection to maintain a minimum 0.95 power factor.
5. The study results for the Light Spring load scenario for three generation levels from the Tehachapi wind farms indicate that WECC voltage stability standards are met. The voltage performance is also satisfactory, with nose point below operating voltage. On some of the Q-V plots where the lines are flat out at -3,000 MVAR, the cause is due to the maximum set point at -3,000 MVAR for the fictitious synchronous condensers. See Figure 3-8.

<sup>16</sup> The results shown for the SONGS G-1-1 as the critical contingency for the Heavy Summer load and Midway – Vincent 500kV double line outage for the Light Spring load conditions





## Post-Transient Voltage Stability Analysis

### 2010 Heavy Summer (G-2 - Loss of Two Songs Units)


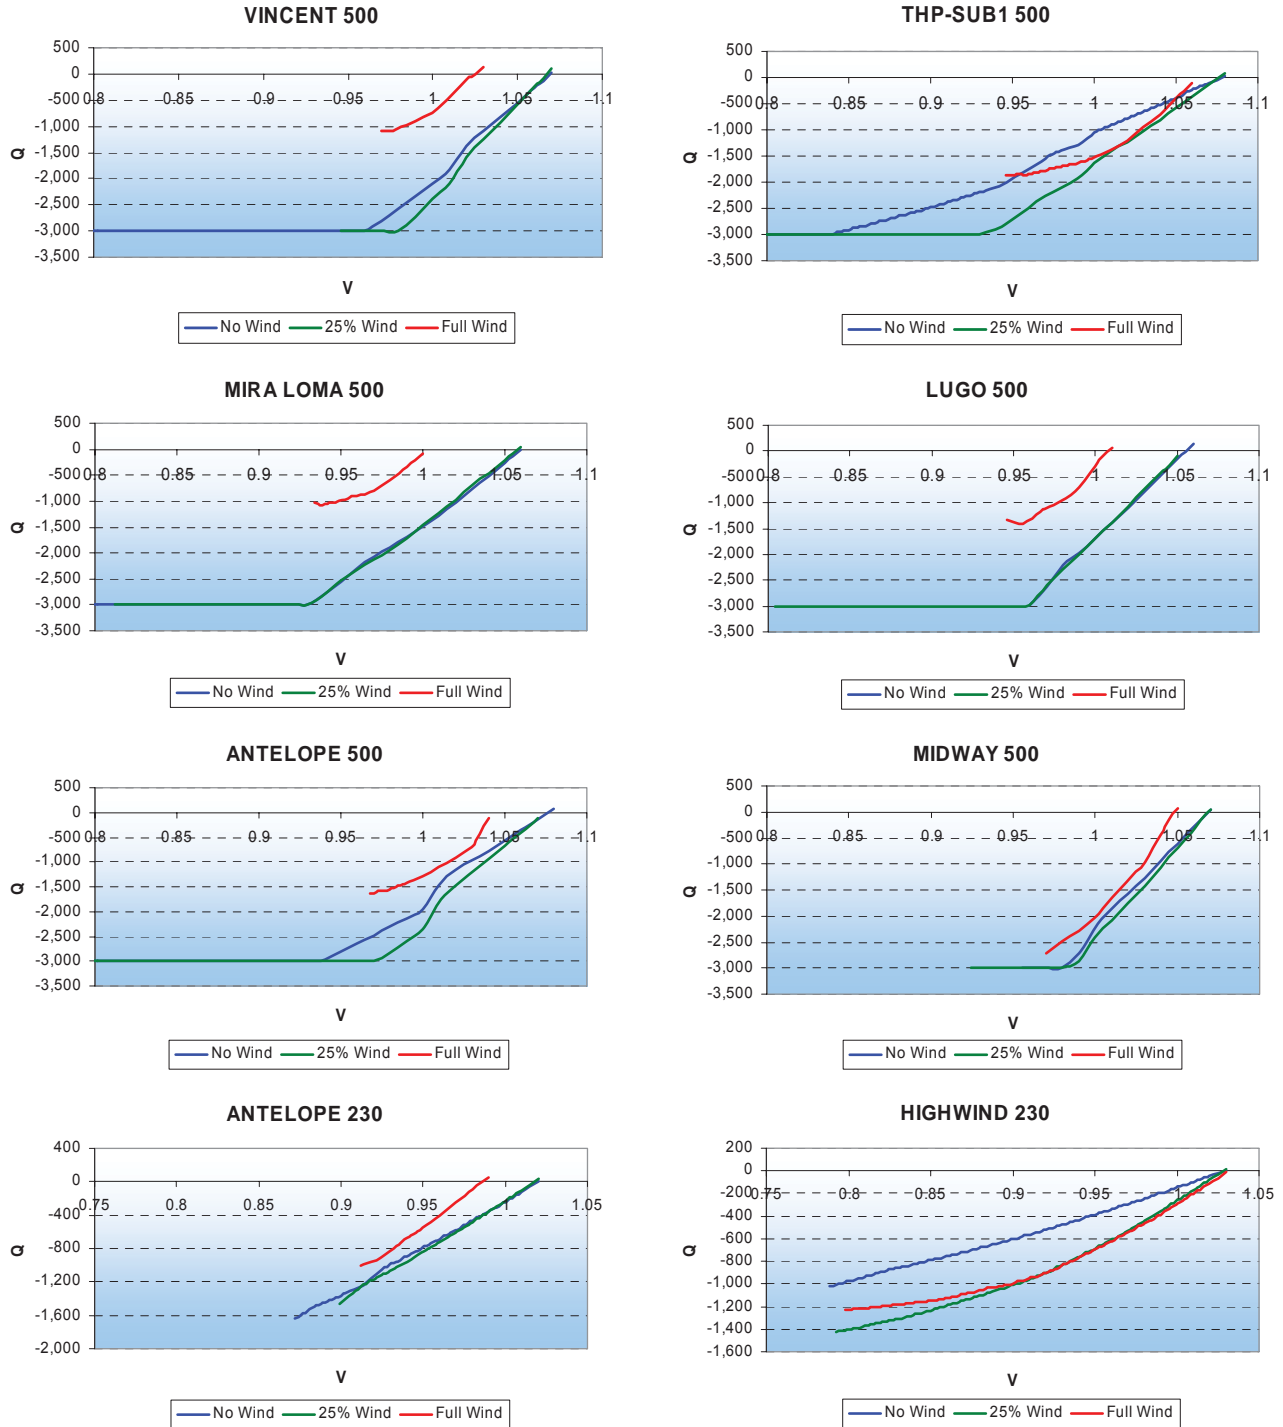


Figure 3-7: 2010 Heavy Summer (G-2 - Loss of Two Songs Units)

Note: The maximum set-point for the Q-V plots where set at -3000 MVAR.





## Post-Transient Voltage Stability Analysis 2012 Light Spring (Midway-Vincent DLO)

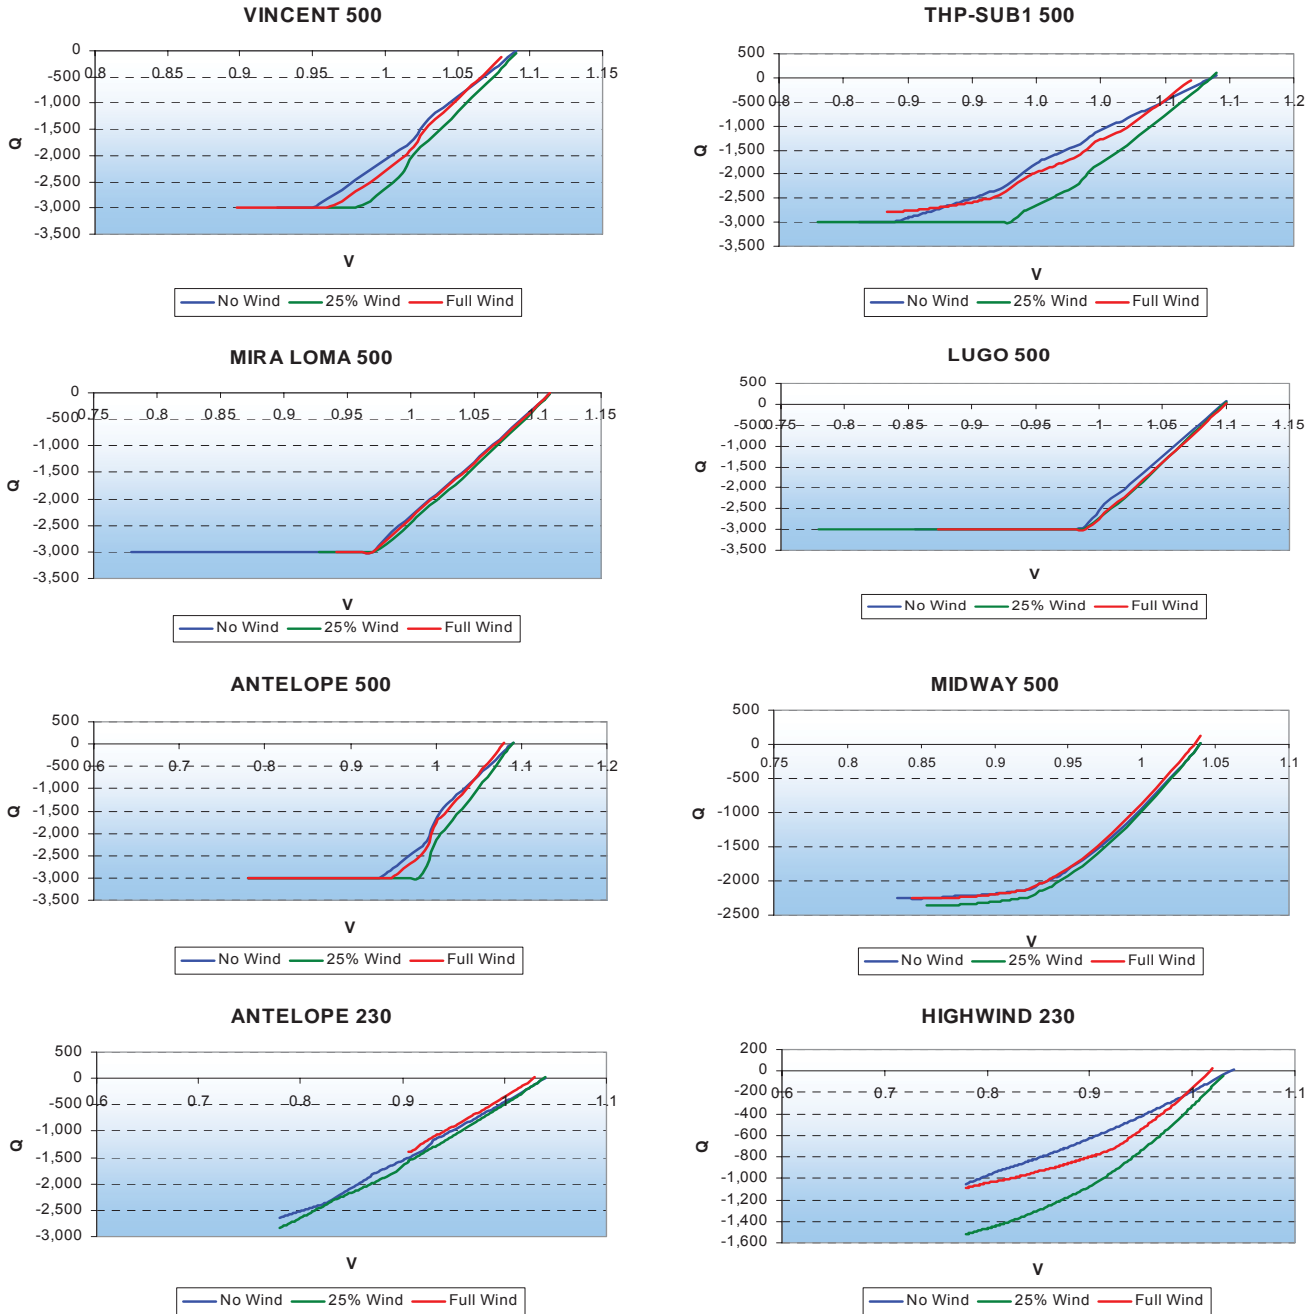


Figure 3-8: 2012 Light Spring (Midway-Vincent DLO)

Note: The maximum set-point for the Q-V plots where set at -3000 MVAR.





### 3.16. Generator Interconnection Standards

In the last two years, there has been a substantial increase of proposed renewable projects in the California ISO generator interconnection queue, mostly due to California's RPS goals. The total renewable capacity in the queue almost doubled from 5,717 MW in January 2006 to 10,994 MW in January 2007, and tripled in the first half of 2007 to 32,719 MW. History indicates that less than half of this capacity will actually come on-line. Projects included in the queue represent both real projects with financing, site control and purchase power agreements as well as speculative projects that many never come to fruition. Under FERC rules, these extremely different projects must be treated the same. Moreover, if a project leaves the queue at any point in time, every project behind it requires complete restudy, which adds further complication and delays of interconnection.

To improve the legitimacy of the queue and increase the success rate, some changes to the FERC-mandated Large Generator Interconnection Process should be considered, including the following:

- Require all applicants to prove absolute site control prior to being assigned a queue position.
- Only allow projects with commercial on-line dates within 5 years (or other time frame) be allowed in the queue.
- Require higher deposits with LGIP applications and at each study phase.
- Force grouping/clustering of projects in same localized areas.
- Require strict valid technical data requirements with interconnection request.
- Require a third party to perform economic reality checks.
- Allow the ability to move forward projects in the LGIP study process that are proposed in known transmission rich areas and have no system impacts.
- Allow the California ISO tighter control of study timelines with possible penalties for PTOs/California ISO/Generators for missing deadlines.
- Remove the 3-year commercial on-line date (COD) extension option from the LGIP process or require system upgrade payments in accordance with original COD.
- Require wind developers to submit technical data per the LGIP in the same way as other developers. Currently, FERC Order 661 allows wind developers to have 6 months to submit technical data. This impedes study progress on projects behind the wind project(s) in the queue.

It is understood that these proposed changes to LGIP would have to be developed through a





formal stakeholder process and ultimately filed with FERC for approval, and this could prove to be a lengthy process. The length of this process will likely be less if the CPUC and other state agencies participate in this process and support these reforms.

### **3.17. WECC Low Voltage Ride Through Standard (LVRT)**

On May 22, 2007, the WECC Wind Generation Task Force (WTF) published a white paper on the proposed WECC LVRT Standard. Titled “The Technical Basis for the New WECC Voltage Ride-Through (VRT) Standard”, the paper proposes bringing the WECC LVRT standard in line with FERC Order No. 661-A, which specifies the unit must be able to handle zero volts for 9 cycles. The goal is to modify the existing WECC LVRT Standard that was approved by the WECC Board in April 2006. The paper presents arguments for numerous requirements that should be improved in the new proposed standard. Please refer to Appendix F.







## Chapter 4 – Forecasting Issues

### 4.1. Market Operations – Day-Ahead Time Frame

The California ISO Day-Ahead (DA) load forecast is calculated by utilizing neural-network forecasting software. Multiple weather forecasting data sources are used to determine the weather forecast. To ensure the average load forecast error is minimized, the California ISO continuously monitors and revises its weather forecast and subsequently its load forecast. Load Serving Entities (LSEs) also forecast their hourly load demand, which they use to schedule energy demand in the California ISO's DA market. Like all forecasts, there are scheduling errors associated with the LSEs' DA scheduled load and the actual load. In addition to the California ISO load forecasting errors and the LSEs' scheduling errors, uncertainties are also introduced in the DA scheduling process because intermittent resources are not required to submit DA schedules.

Currently, uncertainty associated with forecasting the output levels of intermittent resources in the DA time frame do not pose any reliability concerns because the actual wind generation output is typically less than 1,100 MW. As shown in Figure 4-1, with the 20% RPS build out, wind generation may peak as high as 6,000 MW, and production levels could exceed 2,000 MW for approximately 50% of the year. A lack of DA forecasts for this amount of wind generation could result in significant reliability issues.


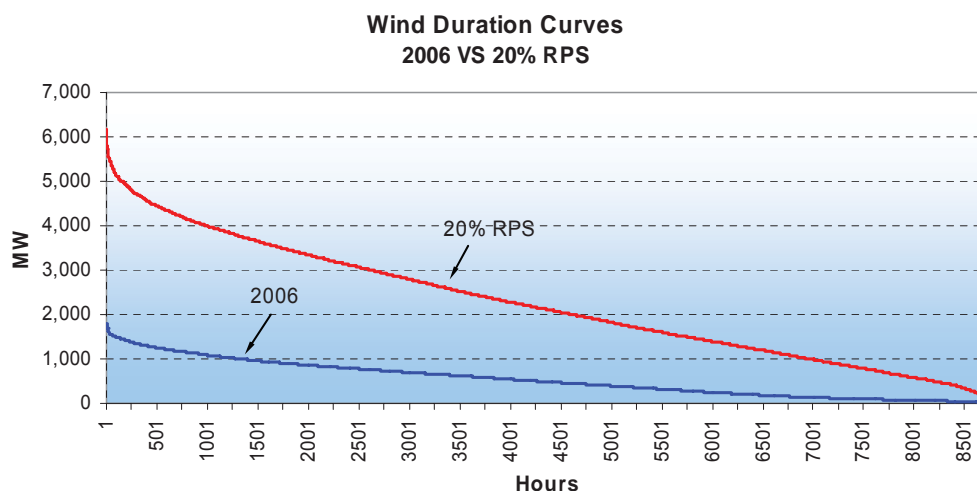


Figure 4-1: Actual Wind Generation for 2006 vs. Expected Wind Generation to Meet the 20% RPS

As more and more intermittent resources become operational, the existing uncertainties and operational challenges in the DA time frame are expected to become more serious. The risk associated with the expected uncertainties in the DA time frame could result in insufficient resources committed through the Residual Unit Commitment (RUC) Process to meet next day hourly demand.





These challenges are expected to increase with a total of 6,688 MW of installed wind resources to meet the 20% RPS goal.

## 4.2. California ISO Day-Ahead Load Forecast

The California ISO utilizes an Automated Load Forecast System (ALFS) to calculate its DA hourly forecast demand approximately 14 hours prior to the next operating day. As shown in Figure 4-2, for 2006, the DA hourly forecast error was greater than 1,000 MW approximately 10% of the time and similarly, the forecast error was less than -1,000 MW approximately 10% of the time. For the hours when the load forecast is deficient, the California ISO makes up this difference by committing resources through its Real-Time Unit Commitment process.

If the scheduled California ISO demand exceeds the California ISO forecast, the RUC process may identify the need to de-commit resources, but the RUC process does not automatically de-commit a resource scheduled in the Integrated Forward Market. The California ISO operator may communicate the need for de-commitment of resources with affected market participants if the scheduled California ISO demand exceeds the California ISO forecast during the Hour-Ahead Scheduling Process (HASP).

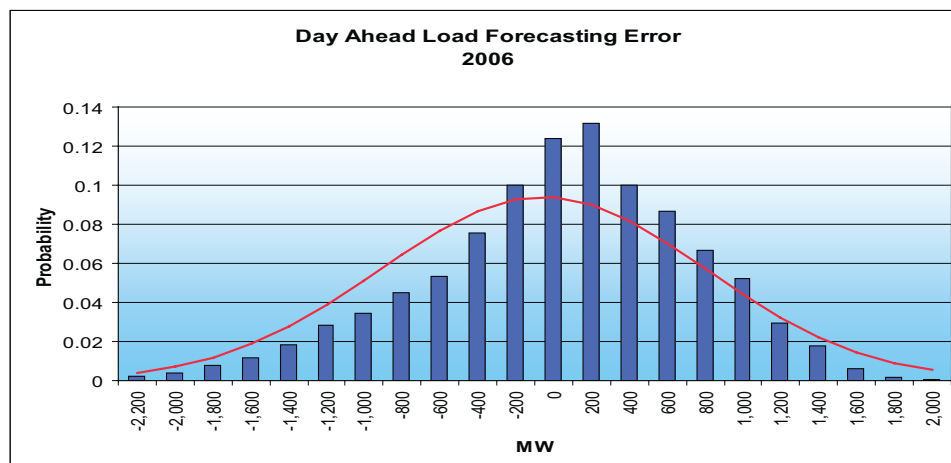


Figure 4-2: California ISO DA Load Forecast Error

## 4.3. Day-Ahead Scheduling Process

Load Serving Entities (LSEs) schedule energy (including the 20-minute ramps between hours) in the DA time frame to meet their forecast load as block energy schedules. The DA market closes at 1000 hours and results are published by 1300 hours the day preceding the operating day. The DA scheduling errors based on the 2006 summer months averages approximately 355 MW higher than the actual load. As shown in Figure 4-3, the Day-Ahead scheduling error mimics a normal truncated distribution curve with a standard deviation of approximately 1,700 MW. In the DA time frame, for summer 2006, there was a probability of 8% that the scheduling errors were less than -2,000 MW and a probability of 19% that they were greater than 2,000 MW. This scheduling error is assumed to be about the same when the 20% RPS target is





met. The under-scheduling difference is procured through the California ISO's Residual Unit Commitment (RUC) process and takes into consideration load forecast errors and estimated generation output from wind resources. As stated above, forecasting the wind generation in the DA does not pose a reliability concern today; however, forecasting wind generation to meet the 20% RPS goal is crucial in committing non-wind resources in the DA time frame.

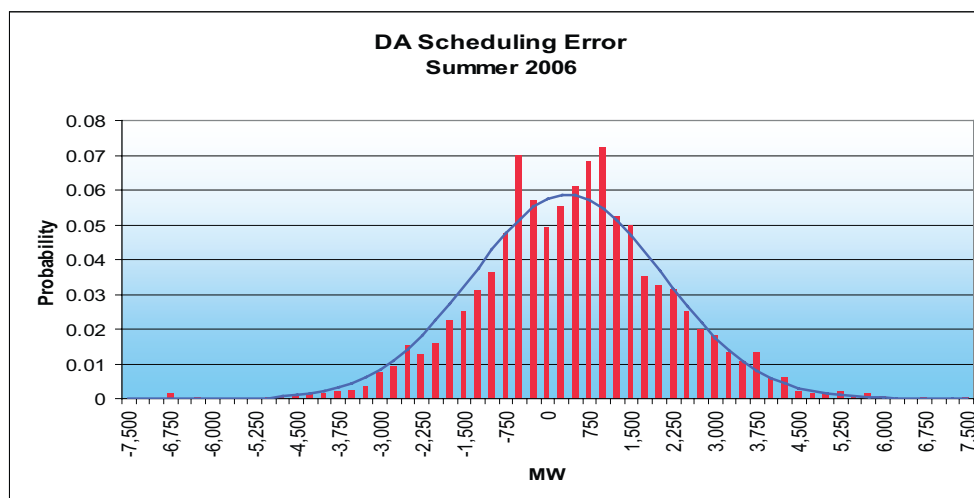


Figure 4-3: Day-Ahead Load Scheduling Error

#### 4.4. Hour-Ahead Load Forecast Error

As mentioned previously, the California ISO forecast load is calculated by the Automated Load Forecast System (ALFS). ALFS calculates the California ISO forecast demand for several different time frames. The Hour-Ahead forecast is calculated about two-hours prior to the operating hour and subsequent half-hour forecasts are calculated for the remainder of the operating day. This process is repeated before each operating hour and each subsequent half-hour forecast is modified.

The Hour-Ahead forecast error is simply the difference between the Hour-Ahead forecast and the average hourly actual demand (excluding pump loads) for a particular operating hour. The Hour-Ahead forecast error is typically higher at higher load levels and is therefore more pronounced during the summer months. As shown in Table 4-1, during summer, the Hour-Ahead load forecast error for 2006 was between -2,657 MW and 2,103 MW with a standard deviation of approximately 900 MW. Overall, for 2006 the Hour-Ahead load forecast error was found to have a mean absolute percent error (MAPE) of 2% of actual load when averaged over a one month period. Refer to Appendix C for more details.

For this study, it was assumed that the statistical characteristics of the Hour-Ahead forecast error observed in 2006 would be the same in future years, although loads would be higher and errors tend to be higher at higher load levels. It was assumed that forecast techniques would improve over the years to compensate for errors at higher load levels.






Table 4-1: Summary of Hour-Ahead Forecast Demand Error (Actual Load – Forecast Load)

Season	Average (MW)	Min (MW)	Max (MW)	Standard Deviation (MW)	Autocorrelation <sup>17</sup>
Winter	-35	-3,849	1,519	652	0.69
Spring	-24	-2,101	1,931	601	0.73
Summer	-130	-3,771	2,446	900	0.89
Fall	-69	-2,628	2,081	687	0.83

Figure 4-4 shows the actual forecast errors (blue bars) compared to the theoretical error normal distribution (red line) for the summer months. Typically, during the summer months, load forecast errors tend to be the highest and were greater than 800 MW and less than -800 MW for approximately 23% of the time. Forecast errors for the other seasons can also be represented by truncated normal distribution functions.

Hour Ahead Load Forecast Error  
Summer - 2006

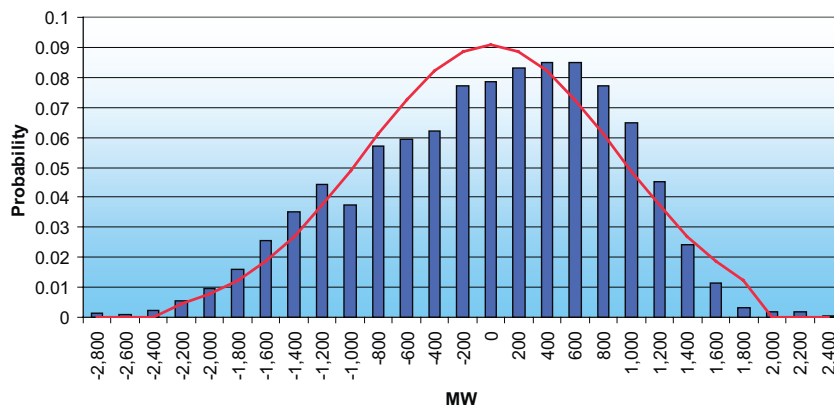



Figure 4-4: Summer Load Error Distributions vs. Theoretical Load Error Distributions

#### 4.5. Hour-Ahead Energy Scheduling Process

With the implementation of MRTU, the California ISO will run the Hour-Ahead Scheduling Process (HASP) to lock in changes to schedules 75-minutes before the actual operating hour starts. In the actual operating day, the schedules for the wind generators in the PIRP program will also be locked in at the 75-minute point. HASP will provide 15-minute advisory schedules for internal resources and gives the California ISO the opportunity to deal with potential over-generation or under-generation conditions.

As shown in Figure 4-5, the one-hour (1hr) block energy schedule includes 20-minute ramps

<sup>17</sup> Autocorrelation values lie between  $\pm 1$  and depend on the number of observations, the standard deviation of the observations, the sample mean and the current and next observation. A value of 1 indicates that the next value has a very strong positive dependence on the previous value, while a value of -1 indicates that the next value has a strong negative dependence on the previous value. An autocorrelation value of 0 indicates that the current value gives no indication of what the next value will be.





between the hours. Since the actual load varies moment to moment during the hour, the average load could be greater than or less than the hourly schedules. Under-generation would be handled through Real-Time Unit Commitment (RTUC) or Short-Term Unit Commitment (STUC<sup>18</sup>) by committing short start and fast start units if it's anticipated that resources would be deficient.

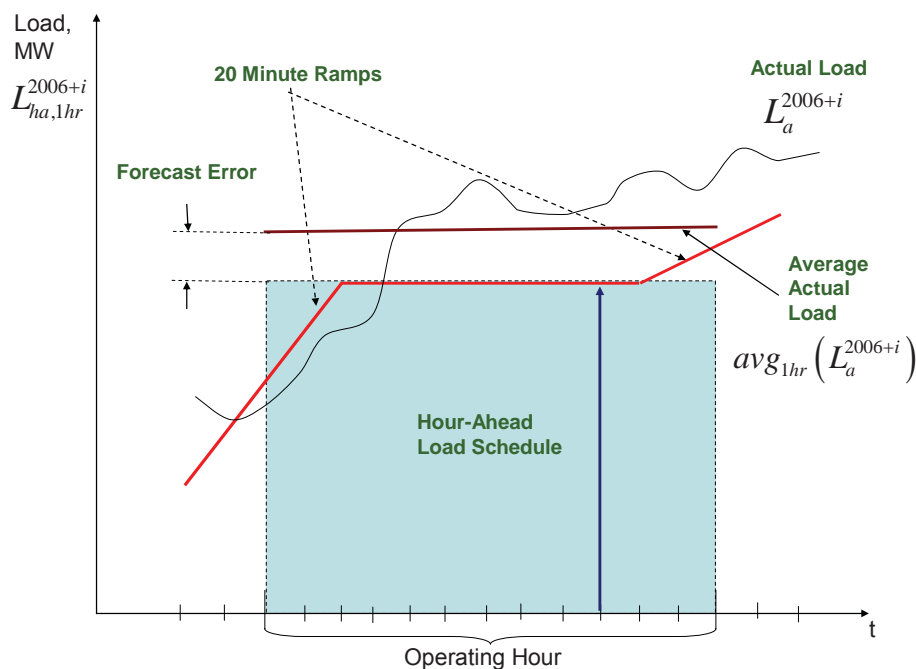


Figure 4-5: California ISO Simulated Hour-Ahead Load Schedule (Red Line) with Ramps


RTUC is a market process for committing resources and awarding additional Ancillary Services from internal resources at 15-minute intervals. The RTUC function runs every 15 minutes and looks ahead up to seven 15-minute intervals to ensure there is sufficient capacity to meet demand.

Should an over-generation condition continue in Real-Time, the Real-Time Market (RTM) will dispatch resources down using economic bids to the extent possible to relieve the over-generation condition. If the use of economic bids is insufficient, then supply curtailment will be performed in accordance with Section 34.10.2 of the California ISO Tariff.

#### 4.6. Five-Minute Load Forecast Error

In the California ISO's Real-Time Market Systems, another forecasting tool called the Very Short-Term Load Predictor (VSTLP) utilizes the latest ALFS Half-Hour forecast and the most recent generation output from the State Estimator to forecast a 15-minute Demand Forecast and a 5-minute forecast. The 15-minute forecast is used by the Real-Time Unit Commitment

<sup>18</sup> STUC is a reliability function for committing short and fast start units to meet the California ISO forecast demand. The STUC function is performed hourly, in conjunction with RTUC and looks ahead three hours beyond the trading hour at 15-minute intervals.






(RTUC) and the 5-minute forecast is used by Real-Time Economic Dispatch. Under MRTU, all forecast demand would include transmission losses, but pump loads would be excluded because they are scheduled.

This 5-minute forecast is run about 10-minutes before the operating interval and consists of a block of power for that time. As shown in Figure 4-6, the 5-minute load forecast error ranged from  $\pm 349$  MW. The mean absolute error over the month was 0.29% and the average error over a one month interval was 1.2 MW. One standard deviation of 5-minute load forecast error is 98 MW.

**Five Minute Load Forecast Error  
Mid-March through Mid-April 2006**

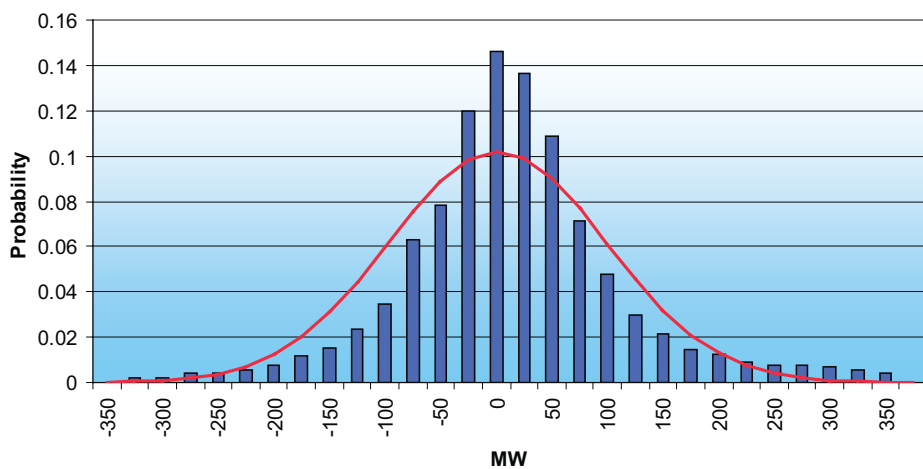

*Figure 4-6. Comparison of 5-minute Load Forecast Error and Theoretical Error Distribution*

The autocorrelation from mid-March through mid-April was 0.61 indicating that the next 5-minute interval has a positive dependence on the previous 5-minute error. The Real-Time load forecast is the average 5-minute load forecast that includes 5-minute ramps between the dispatch intervals.

#### 4.7. Residual Unit Commitment (RUC)

The California ISO adjusts the hourly generation forecast either up or down for the expected wind generation. To the extent that the scheduled quantity for a wind resource in the DA is less than the quantity forecast by the California ISO, the California ISO makes a supply side adjustment in RUC by using the California ISO forecast quantity for the wind resource as the expected delivered quantity. To the extent that the scheduled quantity for a wind resource is greater than the quantity forecast by the California ISO, the California ISO makes a demand side adjustment equal to the difference between the DA schedule and the California ISO forecast quantity.

As more and more wind resources are installed, estimating the total wind output in the DA time frame creates a challenge. One of the tasks addressed in Chapter 10 of this Report is the competitive procurement of a DA Wind Generation Forecast Service that can provide the California ISO with an accurate DA wind generation forecast.





## 4.8. Wind Resource Forecast

Wind resources are not required to bid or schedule in the California ISO DA Market. However, when bids are scheduled in the DA Market, the ultimate quantity scheduled from the wind resource differs from the California ISO forecast deliveries from the wind resource. The California ISO uses a neural network forecasting service/software to forecast deliveries from wind resources based on the relevant forecast weather parameters that affect the output of the wind resource. The California ISO monitors and tunes forecast parameters on an ongoing basis to reduce intermittent forecast errors.

## 4.9. Hour-Ahead Energy Forecast for Wind Generators


The California ISO currently uses an outside service to forecast the Hour-Ahead energy production from wind generation facilities that are in the Participating Intermittent Resources Program (PIRP). The amount of wind generation in PIRP is 685 MW, which is about 25% of the total wind generation installed on the system. It is expected that the new wind generation projects in the California ISO controlled Grid will participate in the California ISO PIRP program where the Hour-Ahead forecast would be available as a PIRP requirement. The California ISO contract with the Forecast Service Provider is to provide hourly wind generation energy forecasts that have a monthly deviation of less than 12%. The hourly forecasts are actually created nearly 3 hours before the actual operating hour, so the forecast data can be used to schedule the energy in the existing Hour-Ahead market.

MRTU will shorten the PIRP scheduling process to 75 minutes before the operating hour. This should result in greater accuracy for the Hour-Ahead forecasts and schedules. Changes in the forecast methodology and the structure of the PIRP program are being considered as a task to be implemented under Chapter 10 of this Report.

An issue paper is also being developed to integrate solar (PV and Concentrated) into PIRP. The goal is to have the solar integration policy completed by early 2008.





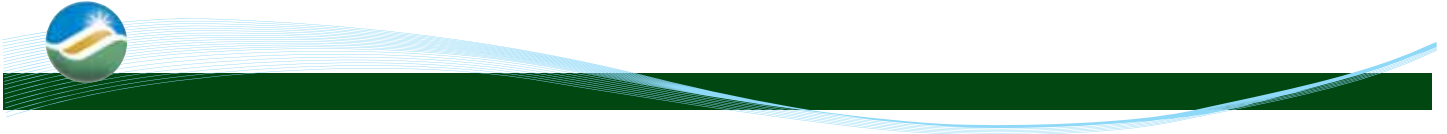



## Chapter 5 – Operations Issues: Impacts of Wind Generation on the California ISO’s Ramping, Regulation and Load Following Requirements Under MRTU


This chapter primarily focuses on wind resources to meet California’s RPS goal of 20% renewables in its generation mix. Small hydro, biomass and geothermal generation are very predictable resources, and their integration into the California ISO market and production levels are not anticipated to cause any operational problems. Also, since it is anticipated that less than 1,000 MW of solar resource additions would be completed by this time frame, no integration issues are envisioned. However, the integration of large amounts of wind resources into the California ISO generation mix is expected to create operating challenges because wind production is a function of wind speed and it is not dispatchable.

Wind generation output varies significantly during the course of any given day, and there is no predictable day-to-day generation pattern. One major challenge to system operators is the availability and accuracy of Day-Ahead and Hour-Ahead wind generation forecasts to ensure sufficient units are committed in the Day-Ahead and Real-Time markets for the next operating day. The California ISO also anticipates facing daily challenges to ensure adequate non-intermittent resources are available to meet multi-hour ramps to accommodate changes in system load and wind generation. These challenges are compounded when combined with large hourly ramp changes on the interties and hourly generation scheduling changes. The following analysis investigates the overall system performance under the California ISO Market Redesign and Technology Upgrade (MRTU) design and operating timelines.

The installed wind capacity in the five existing wind parks located within the California ISO-controlled Grid is approximately 2,648 MW (Solano - 327 MW, Altamont - 954 MW, Pacheco - 21 MW, Tehachapi - 722 MW and San Geronio - 624 MW). Although the California ISO interconnection queue for renewable resources through 2013 contains in excess of 14,000 MW of wind resources, this study assumes only an additional 3,540 MW would be installed in the Tehachapi area and an additional 500 MW would be installed in the Solano wind park for an overall total of 6,688 MW of wind generation. Major transmission upgrades must be built to accommodate these generation additions. These required transmission upgrades have already been approved by the California ISO Board of Governors and the respective Participating Transmission Owners.

### 5.1. Assumptions

Determining the expected ramping, load following and regulation requirements to meet the 20% goal is a function of statistical minute-to-minute actual wind generation and the determination





of statistical errors associated with the California ISO load and wind forecast methodologies in the Day-Ahead, Hour-Ahead and Real-Time time frames. The major data sources and study assumptions are as follows:

1. The expected hourly wind production data was developed by AWS Truewind. The minute-to-minute variability was developed by the California ISO and AWS Truewind. The methodology used is outlined in Appendix B.
2. The overall load increase is consistent with the CEC's forecast energy growth for the state and is assumed to be 1.5% per year for the California ISO-controlled Grid.
3. The energy produced by wind resources varies as a function of wind speed.
4. The effects of wind generation on the interconnection frequency are neglected.
5. All new wind generation additions within the California ISO-controlled Grid will participate in the Participating Intermittent Resources Program (PIRP), and therefore they will be provided with a centralized Day-Ahead and Hour-Ahead forecast service.
6. The Hour-Ahead load and wind generation energy forecasts are provided — at the latest — 120 minutes before the beginning of the next operating hour.
7. The Real-Time 5-minute load forecasts are provided 7.5 minutes before the actual beginning of a 5-minute dispatch interval (or 10 minutes before the middle point of this interval).
8. Real-time telemetry from the wind resources are sent to the California ISO on a 4-second basis, similar to non-intermittent resources.
9. Pump storage is **not** considered as a part of the actual load and the load forecast. It is considered as a scheduled resource. The impact of small pumps is included in system load since they are not scheduled.

## 5.2. Study Methodology

The methodology developed to analyze the wind generation effect is based on a mathematical model of the California ISO's actual scheduling, Real-Time dispatch, and regulation processes and their timelines. Minute-to-minute variations and statistical interactions of the system parameters involved in these processes are depicted with sufficient details to provide a robust and accurate assessment of the additional capacity, ramping and ramp duration requirements that the California ISO regulation (AGC) and load following (ADS) systems will be facing when the 20% RPS is achieved.

In order to represent the California ISO's Hour-Ahead scheduling process, the probability distributions of the total California ISO load forecast and total California ISO wind generation





forecast errors<sup>19</sup> were studied for the year 2006. Refer to Appendices C & E. It has been found that these errors have a close normal probability distribution with negligible average forecast error and significant autocorrelation between the subsequent forecasts. The wind generation forecast statistical parameters were discussed with and approved by AWS Truwind Company for each season of a year. A special truncated normal distribution random generator with controllable standard deviation and autocorrelation was designed to simulate the sequences of random forecast errors for each study season. The Hour-Ahead schedules for the system load and wind generation were created for each operating hour based on the actual predicted load and wind generation curves as well as the simulated Hour-Ahead forecast errors. Twenty-minute ramps were added between the subsequent operating hours.

In order to simulate the Real-Time dispatch process, the Real-Time load forecast error was also analyzed and simulated similarly to the Hour-Ahead load forecast. The randomly generated error was subtracted from the actual 5-minute averages of the system load to simulate the Real-Time load schedules. Five-minute ramps were added to the simulated load schedule curves. The Real-Time wind generation curves were modeled by applying the persistence model. This model assumed that the wind generation within each 5-minute dispatch interval would be the same as it was 8 minutes before the beginning of this interval.<sup>20</sup>

The load-only impact on regulation was considered as the minute-to-minute difference between the simulated Real-Time load schedule and the actual load.

The wind generation impact on regulation was simulated in three steps. First, the difference between the actual wind generation and the simulated wind generation schedule was evaluated for every minute. Second, the combined impact of the system load and wind generation on regulation was simulated as the difference between the load-only impact curve and wind generation impact curve. This approach fully depicts the statistical interactions between the load and wind generation unscheduled changes. Third, the additional impact of wind was calculated as the difference between the combined impact and the load-only impact.

The load-only and combined load and wind generation impact curves were analyzed using the swinging door algorithm<sup>21</sup> to calculate the ramp and ramp duration requirements for each minute in the study season. Please refer to Appendix A for a detail description of the algorithm.


### 5.3. Conclusions

1. Integrating 20% renewables in the California ISO-controlled Grid is operationally feasible; however, several additions to the operational practice will be required (see Recommendations for details). Without these recommended changes, there may be significant effects on the market clearing prices and unit commitment costs.

<sup>19</sup> An assumption was that a comprehensive Hour-Ahead wind generation forecast would be available for the California ISO, Scheduling Coordinators and IOUs and that it would be incorporated in the Hour-Ahead scheduling processes. It is expected that the new wind generation projects in California will participate in the California ISO PIRP program where the Hour-Ahead forecast would be available as a PIRP requirement.

<sup>20</sup> This means that the Real-Time wind generation forecast is not available.

<sup>21</sup> The swinging door algorithm helped to build a meaningful sequence of ramps needed to provide an adequate regulation service. The algorithm is based on a user-specified tolerance of following the ramps.





2. The 20% renewables requirement is expected to increase the 3-hour morning ramp by 926 MW to 1,529 MW and the 3-hour evening ramp by 427 MW to 984 MW depending on the season. (Refer to Table 5-1.)
3. The California ISO regulation capacity requirements will increase noticeably during certain hour ranges. The increase is explained by increasing inaccuracy of the persistence model used in this study for the Real-Time wind generation forecast, which reflects the current approach used by the California ISO's Real-Time Dispatch. Table 5-5 summarizes the study results (maximum expected values) based on an Hour-Ahead wind generation forecast error of 7% to 9% depending on the season. Regulation capacity requirements decrease with better wind forecasts.
4. The California ISO regulation ramping requirements to meet the 20% RPS is expected to increase by about  $\pm 10$  to  $\pm 25$  MW/min. These increases will affect AGC ramps up to five-minutes long. (Refer to Table 5-6.)
5. The California ISO would also require a significant increase in the supplemental energy stack to meet intra-hour load following needs. The increase is explained by the fact that the Hour-Ahead wind generation forecast error (standard deviation is evaluated as 7-9% of the total installed wind generation capacity) becomes comparable with the Hour-Ahead load forecast error (standard deviation is 600-900 MW). These load following capacity requirements decrease with better wind forecast. Please refer to Table 5-4 for a comparison of load following capacity requirements when a 5% wind forecast error is used.
6. The California ISO maximum load following ramping requirements to meet the 20% RPS is expected to increase by about  $\pm 30$  to  $\pm 40$  MW/min. These increases will affect ADS ramps up to 20-30 minutes long. (Refer to Table 5-3.)

#### 5.4. Recommendations

1. Implement a state-of-the-art wind forecast service for all wind generator energy production within the California ISO-controlled Grid. This includes Day-Ahead, Hour-Ahead and Real-Time wind generation forecasts. These forecasts will be crucial for the unit commitment, scheduling and dispatch processes in the Day-Ahead, Hour-Ahead and Real-Time time frames.
2. Incorporate the Day-Ahead and Hour-Ahead wind generation forecasts (block energy schedules) into the California ISO's and the SCs' scheduling processes. The Day-Ahead and Hour-Ahead schedules must be based on the forecast wind generation values.
3. Integrate the Real-Time wind generation forecast (average wind generation for 5-minute dispatch intervals) with the Real-Time unit commitment and MRTU dispatching applications.
4. Develop a new ramp forecasting tool to help system operators anticipate large energy ramps — both up and down — on the system. The longer the lead time for forecasting





a large ramp, the more options the operators have to mitigate the impact of the ramp. One of the proposed tasks under Chapter 10 of this Report addresses the creation of the ramp forecasting tool.

5. Change the California ISO generator interconnection standards to require compliance of all intermittent resources with the interconnection rules established for the PIRP. These rules include installing meteorological towers and DPG telemetry systems to communicate the 4-second meteorological and production data from wind parks to the California ISO. This data needs to be integrated into the California ISO's forecasting software.
6. Implement a procedure where the California ISO dispatcher can send dispatch notices to wind generation operators and require them to implement pro-rata cuts in their energy production. During over-generation periods, when dispatchable generation plants are already operating at their minimum levels, the California ISO needs to have an ability to curtail wind generation on an as-needed basis.
7. Analyze the impact of solar power intermittency with load and wind generation intermittency.
8. Evaluate technological changes that can facilitate the integration of large amounts of intermittent resources. For example, evaluate the benefits of participating in a wider-area arrangement like ACE sharing or Wide Area Energy Management system.<sup>22</sup>
9. Study the impact that additional cycling (additional start ups) and associated wear-and-tear issues; dispatches below the maximum unit capacity; and associated additional costs and environmental impacts on conventional generation due to the integration of large amounts of intermittent resources. Address whether improvements can be made to the California ISO's Scheduling, Real-Time Dispatch and Regulation systems that will minimize the impacts on conventional units.
10. Encourage the development of new energy storage technology that facilitates the storage of off peak wind generation energy for delivery during on-peak periods.
11. Include changes in Resource Adequacy standard to require more generation with faster and more durable ramping capabilities that will be required to meet future ramp requirements.<sup>23</sup>
12. Include changes in Resource Adequacy standard to require additional quick start units that will be required to accommodate Hour-Ahead forecast errors and intra-hour wind variations.

<sup>22</sup> Principles of the Wide Area Energy Management system are currently under design at Pacific Northwest National Laboratory (PNNL). The project is sponsored by Bonneville Power Administration. The California ISO is a participant in this project.

<sup>23</sup> The California ISO is currently participating in a California Energy Commission sponsored project with PNNL and Oak Ridge National Laboratory on the value of fast regulation resources.







## 5.5. Day-Ahead Forecast and Scheduling Process

Day-Ahead (DA) load forecast errors coupled with DA wind generation forecast errors can have a significant impact on the Residual Unit Commitment process. This problem could get worse since wind resources are not required to bid in the DA market. The major risk of forecast errors in the Day-Ahead time frame is that insufficient resources will be committed to meet the next day's load. Additional work that needs to be done is outlined in chapter 10.

### 5.5.1. Day-Ahead load forecast

The Day-Ahead hourly load forecast is calculated approximately 14 hours before the start of the operating day. Based on 2006 data, the Day-Ahead forecast errors can vary from  $\pm 3,000$  MW with a standard deviation of 858 MW.

With the exception of pump loads, which are scheduled, the California ISO peak load demand is proportional to temperature. Historical load and temperature data for several weather stations within the California ISO-controlled Grid are shown in Figure 5-1. As the average temperature in the California ISO-controlled Grid exceeds 100° F, the load forecast varies significantly for each degree change in average temperature. When the average temperature is above 100° F, a forecast error of one degree could result in the California ISO load forecast potentially being understated or overstated by approximately 980 MW (Southern California Edison 490 MW/°F; Pacific Gas & Electric 399 MW/°F and San Diego Gas & Electric 91 MW/°F.)

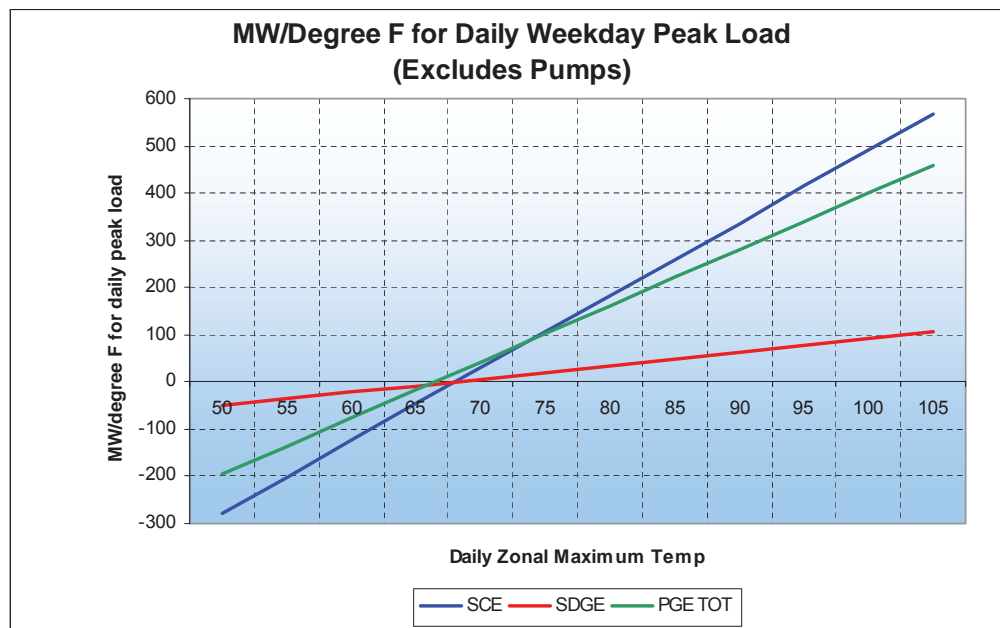


Figure 5-1: Temperature vs. Peak Load Variation







### **5.5.2. Wind generation Day-Ahead forecast and schedules**

Wind resources are not required to bid or schedule in the California ISO Day-Ahead Market (DAM). However, when bids are scheduled in the DAM, the quantity scheduled typically differs from the California ISO forecast deliveries. To meet the 20% RPS, with the installed capacity of wind generation at about 6,688 MW, the DAM could clear at significantly lower levels for next day operation based on self schedules and economic bids from Scheduling Coordinators, which may or may not include wind generation forecast.

To minimize DA forecast errors, the California ISO is preparing a bid specification for procurement of a Day-Ahead wind generation forecast service. An RFP is slated to be released in the fall of 2007 and a service provider chosen by the end of the year.


### **5.5.3. Day-Ahead Market**

Bidding into the DAM is closed at 1000 hours and results are published by 1300 hours on the day preceding the operating day. Scheduling Coordinators (SCs) submit bids (for supply and demand) for each resource to be used in the DAM. Ancillary Service (AS) bids are also submitted in the DAM, which is optimized in conjunction with energy bids to minimize the total bid cost of clearing congestion, balancing energy supply and demand, and reserving AS. Additionally, in the DAM, the California ISO runs a Residual Unit Commitment Program (RUC) to ensure that sufficient capacity is committed, on-line and available for dispatch in Real-Time to meet the California ISO forecast for each trading hour of the operating day.

While RUC commits resource capacity from long start and short start units to meet California ISO forecast of demand, RUC does not automatically de-commit resources in cases where the DA schedules exceed the load forecast. When more generation is anticipated than load, exceptional dispatches may be necessary to resolve over-generation conditions. Such actions may require de-committing resources. Should over-generation conditions propagate into Real-Time and dispatchable generators are already operating at their minimum levels, the California ISO needs to have the ability to curtail wind generation, as necessary, to maintain reliability.

## **5.6. Wind vs. Actual Load on a Typical Hot Day**

Typically, during the summer, wind generation peaks when the total system load is low and is at its lowest production levels when the total system load is high. Figure 5-2, shows the variation of average hourly wind generation and the actual wind generation (red dots) at the time of the daily system peak load during the week with the hottest average temperatures within the California ISO-controlled Grid in 2006.



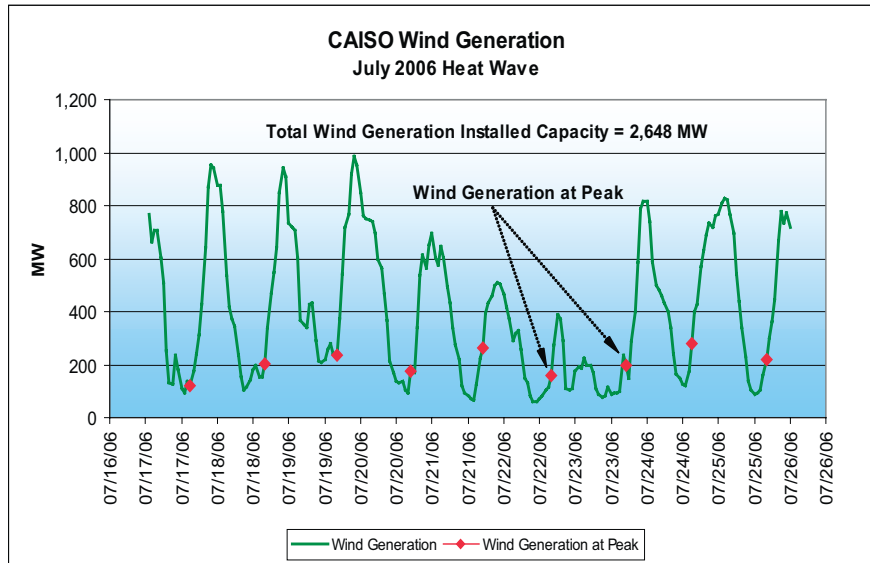


Figure 5-2: California ISO Wind Generation during the 2006 Heat Wave

Although the daily summer pattern “high load and low wind” is predictable, the actual hourly wind generation output can vary significantly from one day to the next. Figure 5-3 shows the actual wind generation for May 2006 compared to the expected wind generation to meet the 20% RPS. As shown, the hourly generation varied significantly in 2006, and without dependable wind generation forecasts, it’s difficult to predict the expected wind generation in any given hour. For example, to meet the 20% RPS, the wind generation is expected to vary between 1,400 MW and 6,000 MW during hour ending 19.


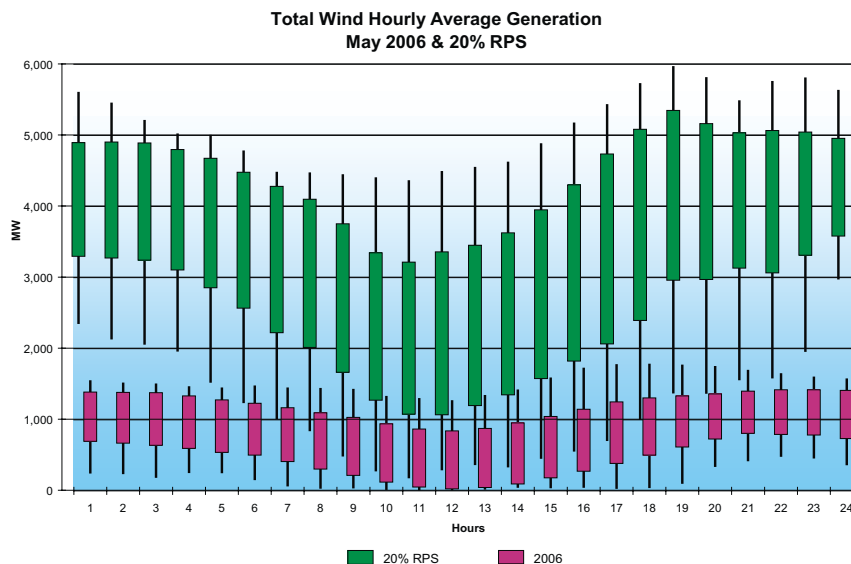


Figure 5-3: Actual 2006 Hourly Wind Generation vs. Expected 20% RPS Hourly Wind Generation

Note: The colored bars represent one standard deviation from the mean. The top of each vertical line shows the hourly maximum and the bottom shows the minimum expected generation for that hour.





## 5.7. Multi-Hour Seasonal Ramping Requirement

With an expected installed wind generating capacity of 6,688 MW, the minute-to-minute and hourly variability on the system is expected to increase significantly. Both the California ISO load demand and wind generation characteristics vary by season. In 2005 and 2006, the maximum wind production occurred in late spring (May) followed by the first month of the summer (June). By the time the 20% RPS is met, a combination of load increase in the morning hours and a decrease in wind production during Hour Ending (HE) 8 through HE10 in the summer months could result in the need to commit about 12,664 MW of capacity in the Day-Ahead Market or have adequate short start<sup>24</sup> and fast start<sup>25</sup> resources available to commit in Real-Time. Similarly, a combination of load drop-off in the evening hours and an increase in wind production during HE22 through HE24 could result in the need to curtail about 13,500 MW of generation over a 3-hour period.

### 5.7.1. Spring months

During the spring months (March, April and May), the California ISO load characteristic has a unique shape that shows two daily peaks, one occurring around HE13 and the second around HE21. Figure 5-4 shows the average hourly system load, average wind generation and solar generation during the course of a typical day. As shown, the total wind generation starts decreasing after midnight and reaches its minimum production level around midday, just as the system experiences the first peak of the day. Beginning around HE13, the wind generation starts ramping up while system load typically drops off.


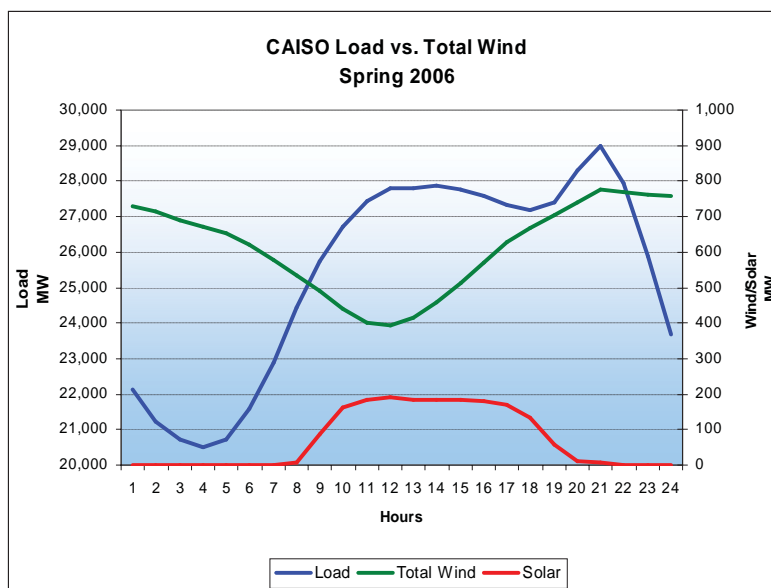


Figure 5-4: Actual System Load, Wind Generation and Solar Generation for Spring

<sup>24</sup> Short Start: Generating units that have a cycle time less than 5 hours (start-up time plus minimum run time is less than 5 hours), have a start-up time less than two hours and can be fully optimized with respect to this cycle time

<sup>25</sup> Fast Start: Start-up time is within the time horizon for any given RTUC (from 60 to 105 minutes).





As system load increases towards the second peak of the day, wind generation helps in offsetting some of the energy required to meet the increase in load. As system load begins dropping after the daily peak, wind is typically at its highest generation level. During the 2006 spring months, the average hourly wind generation peaked at about 775 MW.

As shown in Figure 5-5, the maximum hourly deviations occurred during HE19 and varied from -225 MW to 340 MW. After full build out, the actual generation level is expected to vary between 125 MW and 5,950 MW. The largest hourly deviation is still expected to occur during HE19 and can vary from -1,150 MW to 1,480 MW, which coincides with the system load increase and the increase in wind generation.

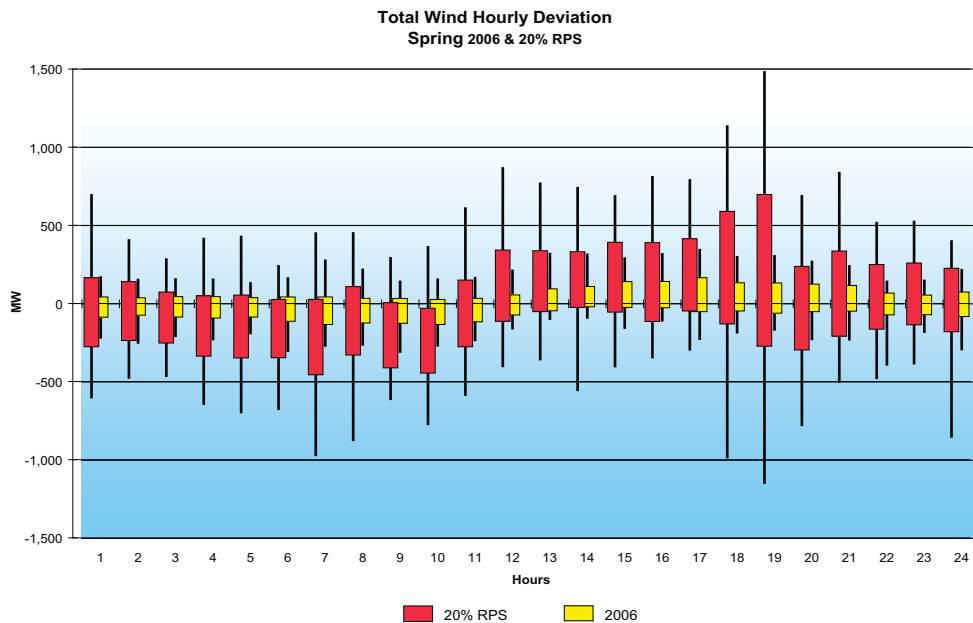


Figure 5-5: Spring 2006 Actual Hourly Variations vs. Expected Hourly Deviation with 20% RPS Integration

Note: The colored bars represent one standard deviation from the mean. The top of each vertical line shows the hourly maximum and the bottom shows the minimum generation for that hour.

### 5.7.2. Spring — morning and evening multi-hour ramps

During the 2006 spring months, the maximum morning load buildup from HE7 through HE9 was approximately 6,170 MW, while the maximum wind generation decreased by approximately 690 MW. Figure 5-6 shows the maximum increase/decrease for each of the hours in the 3-hour ramps. It is expected that with the 20% RPS, the morning load buildup would increase to approximately 6,847 MW. During this same three-hour window, wind generation is expected to decrease by about 1,646 MW, which would result in the need to increase generation by approximately 8,493 MW. This increase in resources would have to be committed in either the Day-Ahead Unit Commitment process or through the Real-Time Unit Commitment process. Any deficiency would have to be met through load following and regulation.



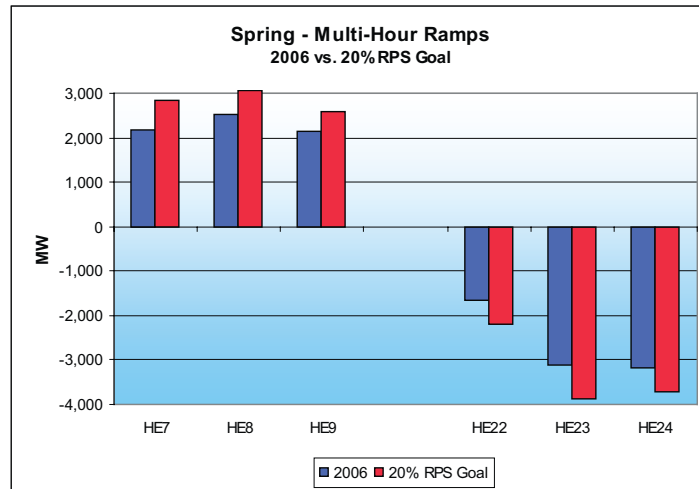


Figure 5-6: Actual Net Hourly Ramps

During the evening hours (HE22 through HE24), the system load typically decreases while wind generation is at its highest of the day. In 2006, the maximum reduction in load was about 7,660 MW, while the maximum increase in wind generation was about 301 MW. With the 20% RPS build out, the total system load is expected to decrease by about 8,502 MW during these three hours and wind generation could increase by about 1,286 MW. These changes in load and wind generation could require decreasing non-wind resources by about 9,788 MW.

### 5.7.3. Summer months

The California ISO load typically peaks during the summer months (June, July and August). Likewise, the peak production level from wind generation is also highest during the summer months. Unfortunately, the highest load demand periods coincide with low levels of wind production, and low levels of load demand coincide with maximum levels of wind production.


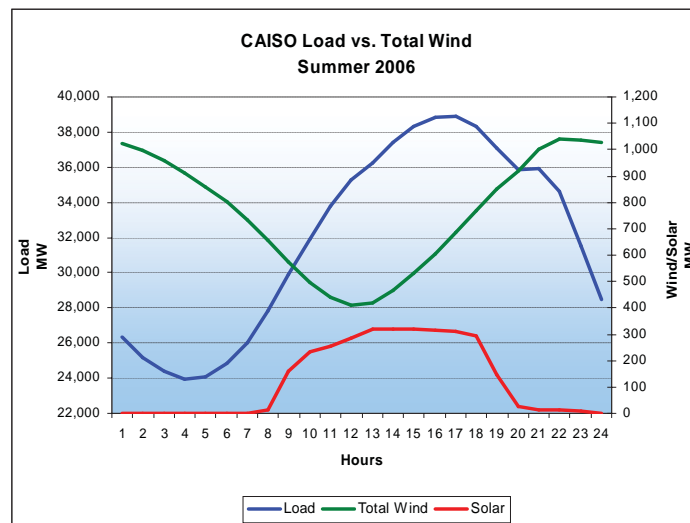


Figure 5-7: Actual System Load, Wind Generation and Solar Generation for Summer 2006





As shown in Figure 5-7, the maximum load variations are more noticeable during the summer months. The daily load cycle reaches a minimum around HE4 and peaks around HE17. After the peak demand of the day is realized, load gradually decreases, while wind production continues to increase up to about HE22 and remains more or less constant through midnight. After midnight, wind production gradually decreases and reaches its lowest level of production around midday. Although small in capacity, the solar generation profile coincided with that of load and could be beneficial in alleviating some of the expected ramping concerns as more of California's RPS goals are met with the integration of solar resources.

During the 2006 summer months, maximum wind generation occurred between HE20 through HE24 and averaged about 1,100 MW, while the minimum levels occurred around midday and averaged approximately 400 MW. This pattern is expected to continue. After the 20% RPS build out, it is expected that the hourly variations would be between -1,140 MW and 1,820 MW with a standard deviation of approximately 390 MW.

#### 5.7.4. Summer — morning and evening multi-hour ramps

During the 2006 summer months, the maximum morning load buildup (HE8 through HE10) increased by approximately 9,509 MW, while the maximum reduction in wind production was approximately 582 MW, an overall increase of about 10,091 MW. Figure 5-8 below, shows the net average increase for each operating hour within the three-hour ramps. It is expected that the 20% RPS build out would result in the maximum morning load buildup increasing to approximately 10,553 MW, while wind generation is expected to decrease by about 2,111 MW for a net increase of approximately 12,664 MW.

During HE22 through HE24, the system load typically decreases. In 2006, the maximum load reduction was 10,179 MW, while the maximum increase in wind generation was about 411 MW. It is expected that the maximum system load could decrease by about 11,297 MW during these three hours and wind generation could increase by about 838 MW. Overall, it is expected that the California ISO needs to be able to run back generation to the extent of 12,135 MW during these three hours.

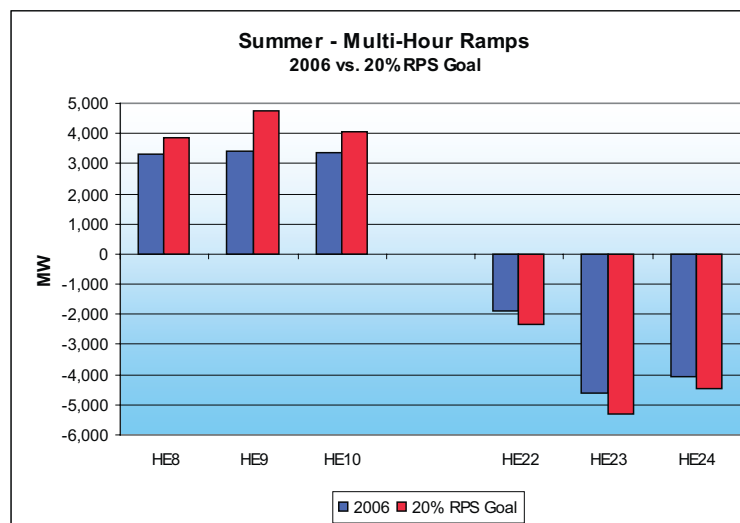


Figure 5-8: Actual Net Hourly Ramps







### 5.7.5. Fall months

During the fall months (September, October & November), the load profile looks similar to the summer profile in that it has one distinct peak, which occurs around HE 20. The peak load demand in the fall months averaged about 65% of the summer peak. In the fall, wind production levels show a significant decrease from the levels observed during summer. As shown in Figure 5-9 below, the daily load cycle reaches a minimum around HE4 and peaks around HE20. The daily peaks typically coincide with the increase in wind production. However, as load drops off after the daily peak, the wind generation levels continue to increase through midnight. During the fall 2006, the maximum wind generation occurred between HE20 through HE24 and averaged about 575 MW or 22% of installed wind capacity. This pattern is expected to continue, except the peak levels of production could be as high as 5,100 MW with the 20% RPS build out. In 2006, actual wind production varied from almost zero to about 1,500 MW. It is expected that the hourly variations would be between -860 MW and 1,290 MW with a standard deviation of approximately 400 MW.

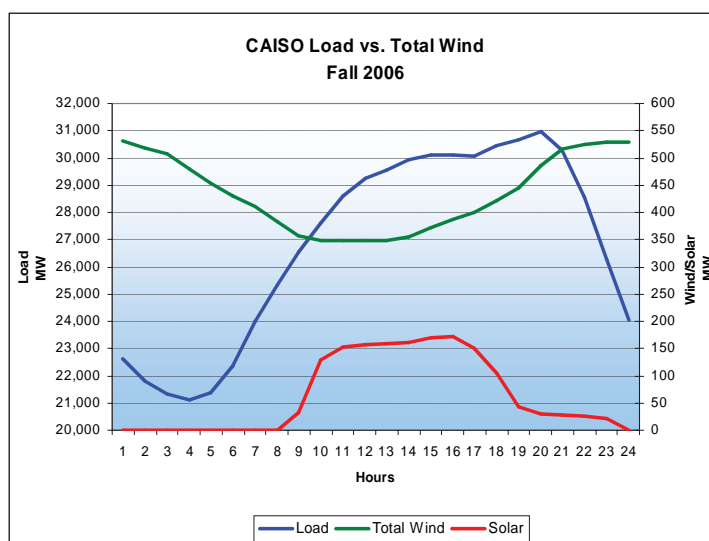



Figure 5-9: Actual System Load, Wind Generation and Solar Generation for Fall 2006

### 5.7.6. Fall — morning and evening multi-hour ramps

During the 2006 fall months, the largest morning load buildup typically occurs between HE7 and HE9 and the maximum increase was approximately 6,759 MW. The maximum decrease in wind generation was about 471 MW during this time. Figure 5-10, shows the net average increase for each operating hour within the three-hour ramps. After the 20% RPS build out, the maximum morning load buildup could increase to approximately 7,501 MW. Wind generation is expected to decrease by about 1,494 MW, for a net increase of approximately 8,995 MW. During the 2006 evening hours (HE22 through HE24), the maximum decrease in system load was 11,213 MW, while the maximum increase in wind generation was about 298 MW. After the 20% RPS build out, the maximum reduction in load could be about 12,445 MW, while the maximum increase in wind production could be about 1,038 MW during the evening hours. It is expected that the California ISO needs to be able to run back generation to the extent of 13,483 MW during these three hours.





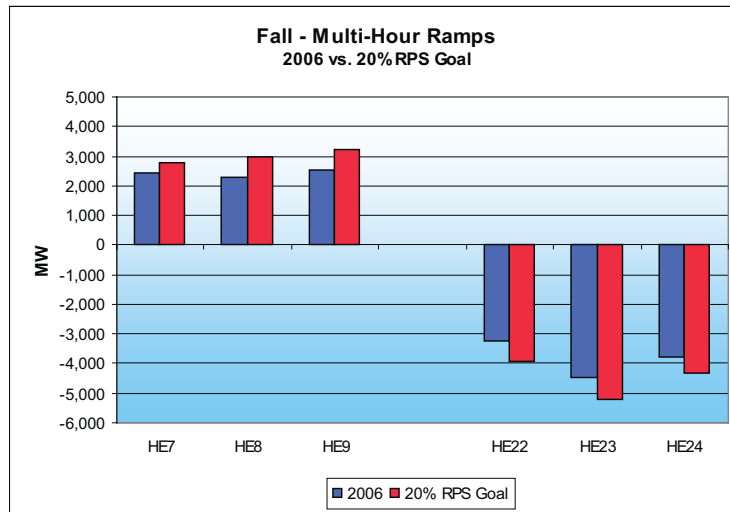


Figure 5-10: Actual Net Hourly Ramps

### 5.7.7. Winter months

During the winter months (December, January & February), the load profile looks similar to the spring in that it has two distinct peaks, one occurring around midday and the second occurring around HE19. Like the spring and fall months, the peak load demand in winter typically averages about 60% to 70% of the summer peak demand. As shown in Figure 5-11, the wind production level is the lowest during the winter months, but also follows the typical pattern whereby the peak generation occurs around midnight and the minimum generation occurs around HE10. During the 2006 winter months, the maximum wind generation occurred between HE20 through HE24 and averaged about 325 MW or 12.5% of installed capacity. This pattern is expected to continue with the build out, except the peak levels of production could be as high as 4,460 MW. It is expected that the hourly variations would be between -1,425 MW and 790 MW with a standard deviation of approximately 340 MW.

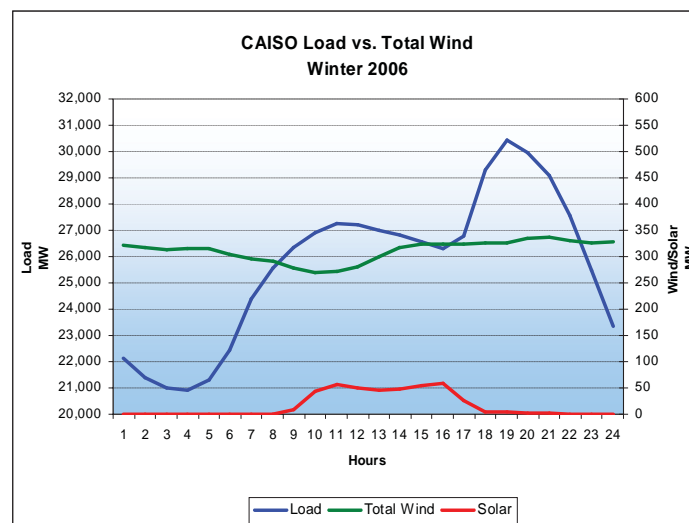


Figure 5-11: Actual System Load, Wind Generation and Solar Generation for Winter 2006





### 5.7.8. Winter — morning and evening multi-hour ramps

During the 2006 winter months, the maximum morning load buildup (HE6 through HE8) was approximately 6,609 MW, while the maximum wind reduction was about 370 MW. Figure 5-12, shows the net average increase/decrease for each operating hour. After the 20% RPS build out, the morning load buildup is expected to increase to about 7,335 MW, while the maximum wind reduction could be about 1,296 MW. During the 2006 evening hours (HE22 through HE24), the maximum system load reduction was about 7,589 MW. The increase in wind generation during this time was about 267 MW. To meet the 20% RPS, the total system load could decrease by about 8,423 MW and the wind production could increase by about 870 MW during these three hours. Overall, it is expected that the California ISO needs to be able to curtail generation to the extent of 9,293 MW between HE22 through HE24.

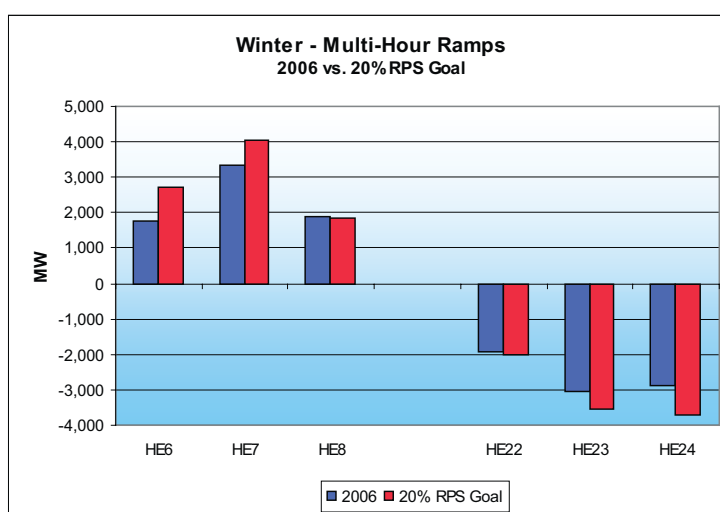


Figure 5-12: Actual Net Hourly Ramps


### 5.7.9. Summary of multiple hour ramp requirements

Table 5-1 shows the increase in the three-hour morning and three-hour evening ramps between 2006 and after the 20% RPS build out. The “Change due to intermittency” column only shows the increase due to wind variability between the two time frames.

Table 5-1: Summary of Multi-Hour Ramps

Seasons	2006 Morning Ramps MW	20% RPS Expected Morning Ramps MW	Change due to Intermittency MW	2006 Evening Ramps MW	20% RPS Expected Evening Ramps MW	Change due to Intermittency MW
Spring	6,860	8,494	955	7,962	9,788	984
Summer	10,090	12,664	1,529	10,589	12,135	427
Fall	7,229	8,995	1,023	11,511	13,483	740
Winter	6,979	8,631	926	7,856	9,293	603

Note: Morning Ramps – Spring & Fall: HE7 through HE9; Summer: HE8 through HE10; and Winter: HE6 through HE8. Evening Ramps – All seasons: HE22 through HE24





## 5.8. California ISO Scheduling and Load Balancing Processes

Wind generation impact analysis methodology is based on a mathematical model of the actual California ISO's scheduling, Real-Time dispatch, and regulating processes and their timelines. In order to model the scheduling process, the probability distributions of the total California ISO load forecast errors and total California ISO wind generation forecast errors are necessary inputs to the model.

Figure 5-13 illustrates how the generators in the California ISO-controlled Grid are scheduled and dispatched. Day-Ahead load forecasts are calculated approximately 14 hours prior to the next operating day.

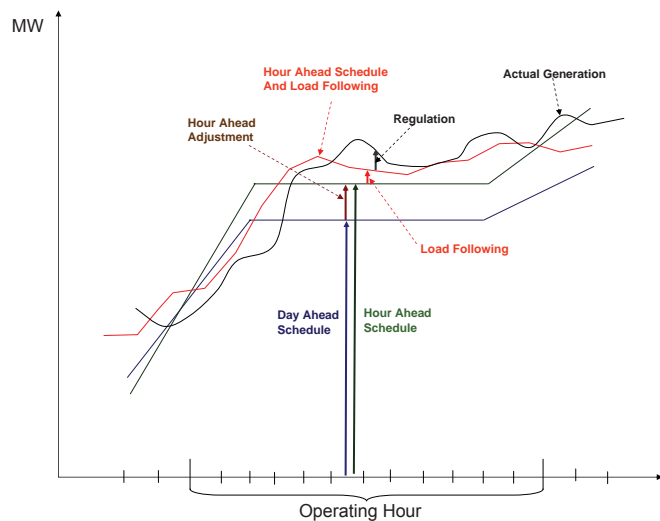


Figure 5-13: California ISO-controlled Grid Scheduling Process

Hour-Ahead load forecasts are block energy hourly schedules including the 20-minute ramps between the hours. Hour-Ahead schedules are provided 75 minutes before the actual beginning of an operating hour. The load forecast used for the Hour-Ahead scheduling process is provided 2 hours before the beginning of an operating hour. Refer to Appendix B. The difference between the Day-Ahead and Hour-Ahead schedules constitute the required generation adjustment, which is done through the California ISO's Short Term Unit Commitment and Real-Time Unit Commitment software applications. The California ISO runs its Real-Time Economic Dispatch program every 5 minutes to meet the forecast of the imbalance requirement between generation and load. This is shown in Figure 5-13 as the area below the red line and the Hour-Ahead schedule and is labeled as "Load Following." The area between the load following and the actual generation is met through regulating reserve, which is dispatched through Automatic Generation Control. A detailed description of the dispatch of regulating reserve is provided under section 5.10. "Regulating Requirement."





### 5.8.1. Real-Time Dispatch — load following

Real-Time dispatch or load following<sup>26</sup> is automatically conducted by the California ISO’s MRTU applications using 15-minute intervals for Real-Time Unit Commitment and 5-minute intervals for Real-Time Economic Dispatch. Load following is not a FERC-defined Ancillary Service. Generally, the objective of a Real-Time Market (RTM) is system balancing and load following on a forward-looking basis, above and beyond the normal function of the Automatic Generation Control (AGC). Since the RTM is forward-looking, AGC is mainly a control rather than an energy service. As AGC units depart from their Dispatch Operating Point (DOP) responding to frequency and net interchange deviations, they temporarily supply or consume balancing energy. The Real-Time Economic Dispatch function dispatches ahead of AGC, while AGC resolves shorter term imbalances. The California ISO buys or sells balancing energy at regular intervals from or to resources that participate in the RTM, allowing AGC units to move closer to their DOPs.

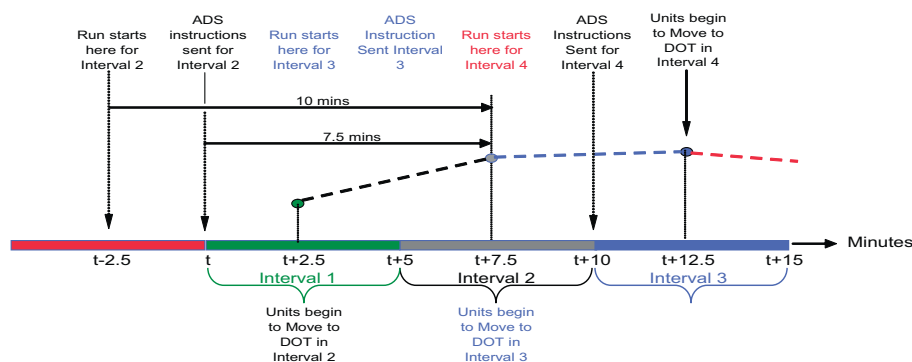



Figure 5-14: MRTU Timeline for 5-Minute Dispatch

As shown in Figure 5-14, the Real-Time Economic Dispatch software normally runs every 5-minutes starting at approximately 7.5 minutes prior to the midpoint of the next dispatch interval and produces a Dispatch Instruction for energy for the next dispatch interval and advisory Dispatch instructions are issued for as many as 13 future dispatch intervals over the RTD optimization time-horizon of 65 minutes. The generation dispatch for the next operating interval is referred to as instructed deviation from schedules caused by Real-Time energy dispatch. Generation and load information used for this dispatch interval is at least 10-minutes old. Generating units start to move 2.5-minutes before the interval begins and are expected to reach their dispatch operating point in 5-minutes. During this 5-minute interval, all deviations are met by regulation.

### 5.8.2. Load following requirements

Although the morning load buildup is steadily increasing during the morning hours, the actual ramping requirement for Real-Time operation varies in both the positive and negative directions for any given hour. This is due to many factors, including the hourly block generation and load

<sup>26</sup> Load following is an instructed deviation from schedule caused by the Real-Time (or supplemental) energy dispatch. The desired changes of generation are determined in Real-Time for each 5-minute dispatch interval 7.5 minutes before the actual beginning of the interval.





schedules submitted in the California ISO market systems. The forecast load for any hour is actually the forecast for mid-hour, while most generators are expected to be at their scheduled operating points 10-minutes into the operating hour.

Generating units are typically moved over a 20-minute ramping period between hours to meet their next hourly schedules. Economics, ramp rates and actual operating conditions dictate which units are moved to meet their next hour's schedules. While some generators are dispatched to meet their next hour's schedules, other generators may have to be curtailed on a 5-minute basis through the California ISO's Real-Time Economic Dispatch system to maintain a balance between generation and 5-minute load forecast. The blue shaded area in Figure 5-15 below shows the load following requirements based on 5-minute Real-Time Economic Dispatch.

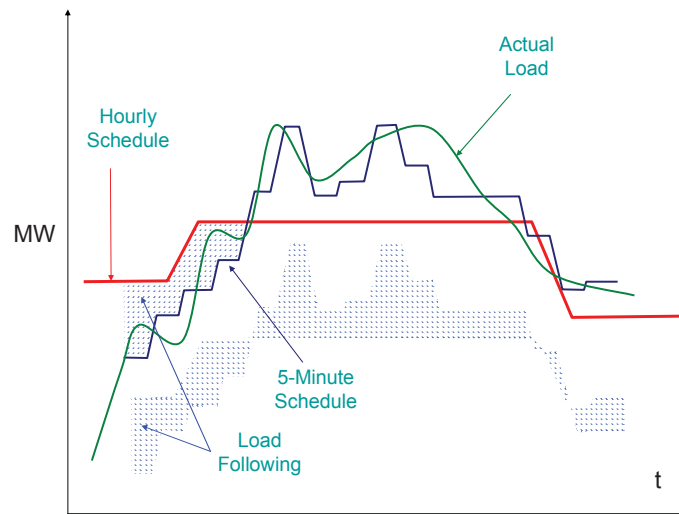



Figure 5-15: Load Following Requirement Shown as Blue Shaded Area

### 5.8.3. Load following capacity requirements

Seasonal simulation results for load following capacity requirements, ramping requirements and ramp duration are shown in Figures 5-16, 5-17 and 5-18 respectively. As shown in Figure 5-16, the California ISO would require a significant increase in the supplemental energy stack to meet intra-hour load following needs. The increase is explained by the fact that the Hour-Ahead wind generation forecast error (standard deviation is evaluated as 7% to 9% of the total installed wind generation capacity) becomes comparable with the Hour-Ahead load forecast error (standard deviation is 600 MW to 900 MW). Figure 5-16 also shows the load following capacity requirements for all hours of a typical summer day. Refer to Appendix B.

The green line represents the minimum and maximum load following capacity requirements due only to wind for 2006. The red line shows the requirement due solely to wind to meet the 20% RPS. As shown, the maximum upward capacity requirement of 3,500 MW occurs during HE3 and HE11. Also, the maximum downward capacity requirement of 3,450 MW occurs during HE24. The hourly upward increase is simply the difference between the top of the red arrow and the top of the green arrow for each hour. The maximum upward increase of 800 MW occurs during HE3 (3,500-2,700). The maximum downward increase of 600 MW (3,050-2,450) occurred in HE22.



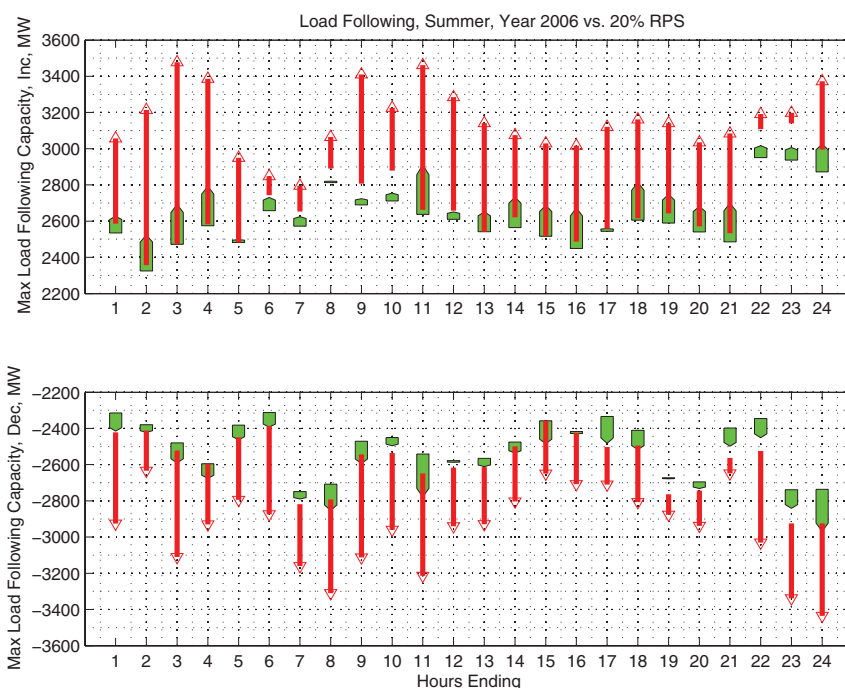


Figure 5-16: Load Following Capacity Requirement

#### 5.8.4. Load following ramping requirement

Figure 5-17 shows the hourly load following ramping requirements due to wind to meet the 20% RPS (red arrow) compared to wind only for 2006 (green arrow). It is expected that the maximum upward load following ramping requirements will increase by 40 MW/min. (HE23: 210-170). Similarly, the maximum downward load following ramping requirements will increase by 40 MW/min (HE9:180-140).

#### 5.8.5. Existing ramping capability


There is currently about 12,651 MW of capacity certified for Ancillary Services (AS) within the California ISO. The ramp rates of these resources range between 2.25 MW/min. to 187.7 MW/min. Only 7,521 MW of this capacity have ramp rates of 10 MW/min. or greater. Hydro units account for 4,700 MW of the AS capacity with ramp rates of 10 MW/min. or greater, while thermal resources account for the remaining 2,821 MW.

Currently, there is about 7,141 MW of capacity certified to provide regulation with ramp rates greater than 10 MW/min. Hydro facilities account for 4,700 MW of this capacity; however, only five of these hydro facilities (2,788 MW) have ramp rates greater than 100 MW/min. The remaining 2,441 MW of regulation capacity are from thermal capacity, which has ramp rates between 10 and 31 MW/min.

Based on the regulation requirements shown in Table 5-5, the current generation mix seems adequate to meet the anticipated regulation needs. However, during droughts or low hydro years, regulation response could be slow due to the reliance on thermal units with slower ramp rates. Depending on system load, additional units may have to be committed on-line to







meet regulation needs, especially during the summer months. With the current advancements in storage technology, faster ramping devices such as flywheels may be an alternative to committing additional resources to meet regulation requirements in drought years.

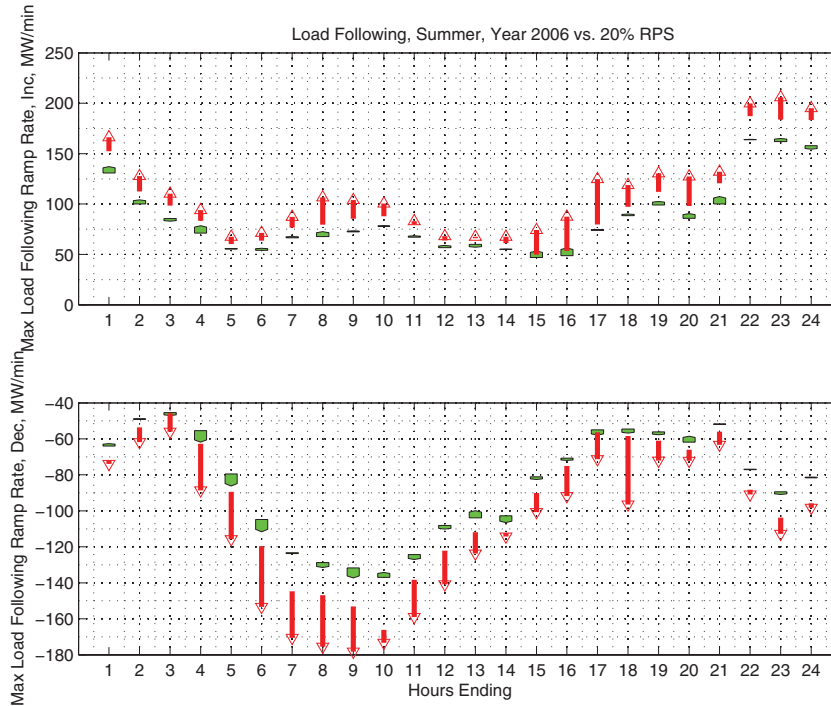


Figure 5-17: Load Following Ramping Requirement

### 5.8.6. Load following ramp duration

As shown in Figure 5-18, the upward ramp duration is required for approximately 30 minutes, while the downward ramp duration will be required for approximately 20 minutes. Overall, the upward load following capacity needs to be about 3,500 MW, and resources within the supplemental stack should be able to ramp up at a rate of about 80 MW/min. for approximately 30 minutes. Similarly, in the downward direction, the resources should be able to ramp down at a rate of approximately 175 MW/min. for at least 20 minutes. Refer to Appendix A for graphs showing the capacity, ramps and ramp duration for all seasons.





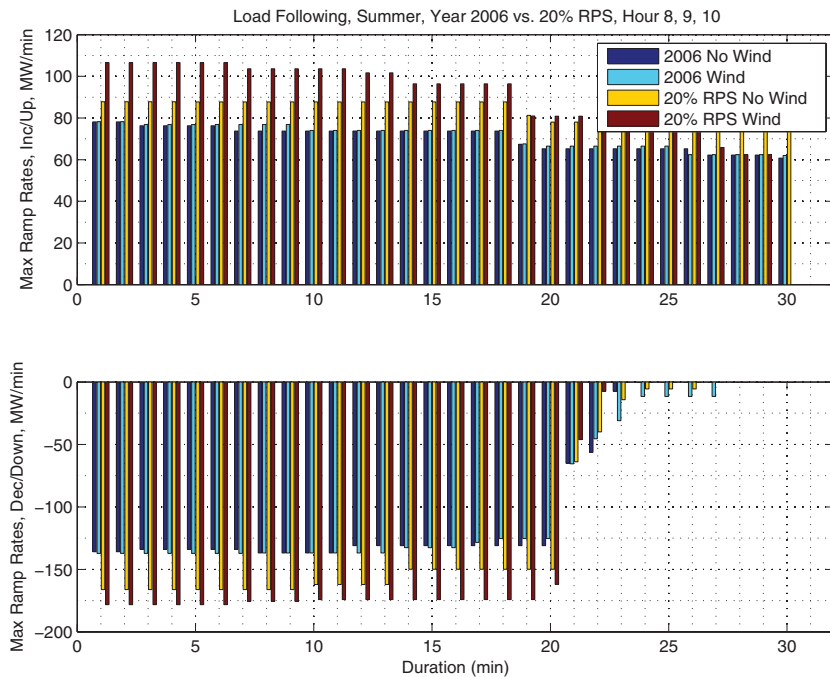


Figure 5-18: Load Following Ramp Duration

### 5.8.7. Study result summary

As shown in Table 5-2, the California ISO will require a significant increase in the supplemental energy stack to meet intra-hour load following needs. The increase is explained by the fact that the Hour-Ahead wind generation forecast error (with a standard deviation of 7% to 9% of the total installed wind generation capacity) becomes comparable with the Hour-Ahead load forecast error (with a standard deviation of 600 MW to 900 MW).

Table 5-2: Summary of Load Following Capacity

Season	Max Load Following (Inc) MW	Max Load Following (Dec) MW	Max Hourly Increase (Inc) MW	Max Hourly Increase (Dec) MW
Spring	2,850	-3,000	+800	-500
Summer	3,470	-3,430	+800	-600
Fall	3,080	-3,200	+750	-900
Winter	2,850	-3,050	+700	-750

The California ISO maximum load following ramping requirements to meet the 20% RPS is expected to increase by about  $\pm 30$  to  $\pm 40$  MW/min. These increases will affect ADS ramps up to 20-30 minutes long.





Table 5-3: Summary of Load Following Ramps

Season	Max Load Following Ramp Up MW/min	Max Load Following Ramp Down MW/min
Spring	+35	-30
Summer	+40	-40
Fall	+40	-30
Winter	+30	-40

## 5.9. Sensitivity with 5% Wind Forecast Error

Holding all other assumptions constant, a sensitivity with the Hour-Ahead wind generation forecast error with a standard deviation of 5% of the total installed wind generation capacity was evaluated. A summary of the load following sensitivity is set forth in Table 5-4 below.

Table 5-4: Summary of Load Following Capacity (5% Error)

Season	INC 7%-9%	INC 5%	Reduction MW	Reduction %	DEC 7%-9%	DEC 5%	Reduction MW	Reduction %
Spring	2,850	2,450	400	14.0%	-3,000	-2,550	-450	-15.0%
Summer	3,470	3,320	150	4.3%	-3,430	-3,280	-150	-4.4%
Fall	3,080	2,550	530	17.2%	-3,200	-2,600	-600	-18.8%
Winter	2,850	2,660	190	6.7%	-3,050	-2,700	-350	-11.5%

## 5.10. Regulating Requirements


The California ISO maintains sufficient generating capacity under automatic generation control (AGC<sup>27</sup>) to continuously balance its generation and interchange schedules to its Real-Time Load. This generating capacity under AGC is referred to as regulating reserve.<sup>28</sup> The WECC does not specify a regulating margin based on load levels but requires adherence to the NERC's Control Performance Criteria.

The California ISO does not dispatch regulating reserve based on its energy bid curve price, but automatically dispatches regulation through AGC every four seconds to meet moment-to-moment fluctuations in customer load demand and to correct for the unintended fluctuations in generation. Regulation is wholly based on the resource's effectiveness to maintain system-scheduled frequency and to maintain scheduled flows between balancing authorities while taking into consideration the resource's operating constraints. To the extent that a resource is moved away from its Dispatch Operating Point (DOP) by AGC (i.e., it is not awarded imbalance energy); the market clearing software assumes that the resource is brought back to its DOP in the next market interval. In doing so, the net energy delivery from the unit, both above and below its DOP, averaged over time, to zero.

To meet the NERC's Control Performance Criteria, the California ISO typically procures  $\pm 350$  MW of regulating reserve (approximately 1 to 1.5% of load) on a given day. On days with high load demand, additional regulation is procured. Although the regulation dispatch is conducted every four seconds, the regulation margin has to be adequate to meet deviations within a 5-minute dispatch interval.

<sup>27</sup> The WECC defines AGC as equipment that automatically adjusts a control area's generation from a central location to maintain its interchange schedule plus frequency bias.

<sup>28</sup> The WECC defines regulating reserve as sufficient spinning reserve, immediately responsive to automatic generation control (AGC), to provide sufficient regulating margin to allow the control area to meet NERC's Control Performance Criteria.



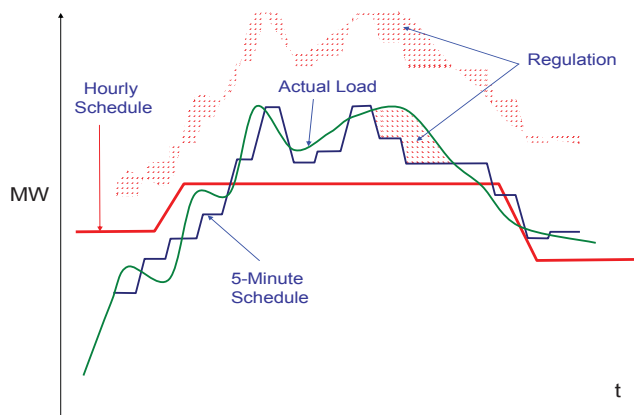



Figure 5-19: Regulation Requirement Shown as the Red Shaded Area

As stated in section 5.8.1, ADS instructions are issued approximately 7.5 minutes in advance of the desired operating interval leaving approximately 5 minutes for units to move to their desired operating point. As shown in Figure 5-19, during this 5-minute time frame, deviation from generation schedules is compensated with regulation, which is dispatched through Automatic Generation Control (AGC) within the California ISO's Energy Management System (EMS). Regulation is not dispatched by the California ISO's Real-Time Market System.

### 5.10.1. Regulation capacity requirements

With increased wind generation the California ISO regulation capacity requirements would increase noticeably during certain hour ranges. The increase is explained by increasing inaccuracy of the persistence model used in this study for the Real-Time wind generation forecast (this model reflects the current approach implicitly used by the California ISO's Real-Time Dispatch). Appendix B outlines the study methodology used to evaluate the regulation requirements due to wind generation.

As shown in Figure 5-20, the maximum upward regulation capacity requirement of 480 MW occurs during HE9, while the maximum downward capacity requirement of -750 MW occurs during HE18. The hourly upward increase is simply the difference between the top of the red arrow and the top of the green arrow for each hour. The hourly upward increase is simply the difference between the top of the red arrow and the top of the green arrow for each hour. The maximum increase of 230 MW occurs during HE9 (480 MW-250 MW). The maximum downward increase of 500 MW (750 MW-250 MW) occurred in HE18.



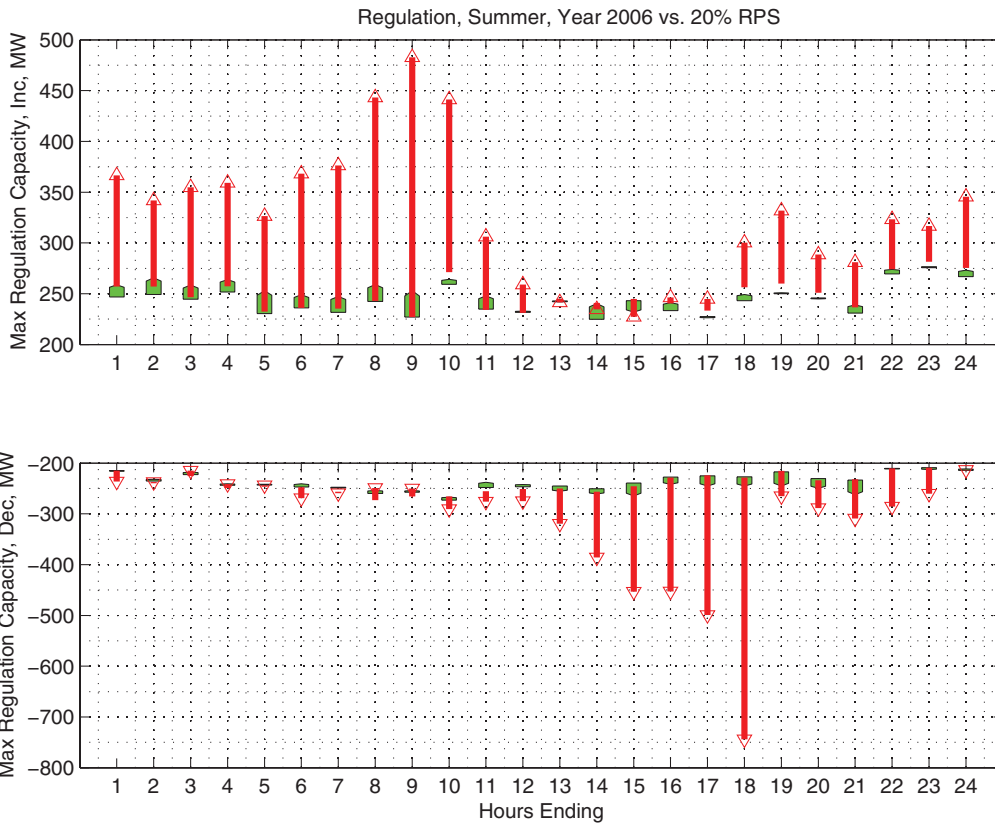



Figure 5-20: Maximum Regulation Capacity

### 5.10.2. Regulation ramping requirements

Figure 5-21 shows the hourly regulation ramping requirements due to the addition of only wind. It is expected that the maximum upward regulation ramping requirements to meet the 20% RPS will increase by 10 MW/min (HE10: 140 MW/min-130 MW/min). The maximum downward regulation requirement is expected to increase by 18 MW/min (HE10:115 MW/min - 97 MW/min). This is not expected to create any operational concerns because it falls within the ramping capability of the existing units. The regulation ramp duration is expected to increase by about  $\pm 10$  to  $\pm 25$  MW/min. and could last for about 5 minutes. For further information see Appendix A.



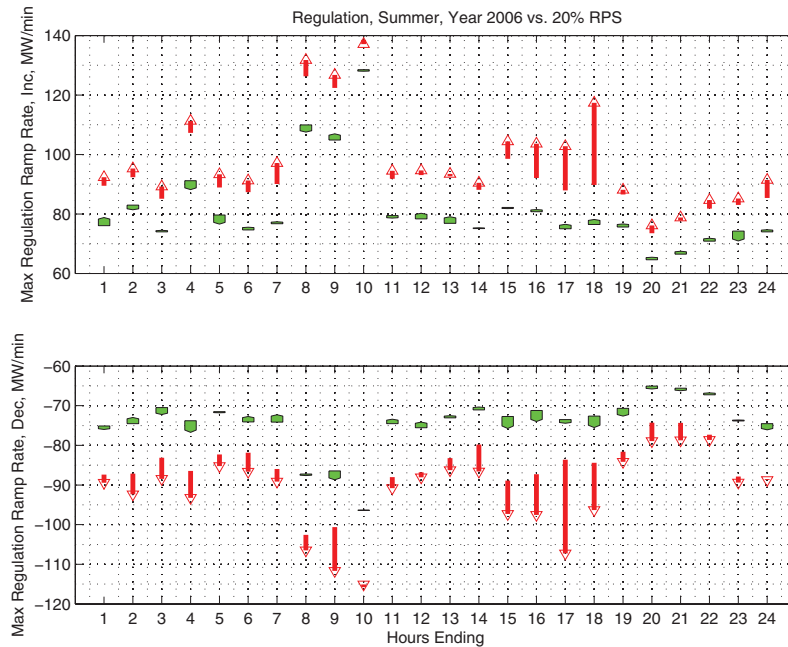


Figure 5-21: Regulation Ramp Rate

### 5.10.3. Regulation ramping duration

As shown in Figure 5-22, both the upward and downward ramp durations are required for about 5 minutes. Overall, the upward regulating capacity needs to be about 480 MW, and resources within the supplemental stack should be able to ramp up at a rate of about 80 MW/min. for at least 5 minutes. Similarly, in the downward direction, the regulating capacity needs to be about -750 MW, and resources should be able to ramp down at a rate of approximately 80 MW/min. for at least 5 minutes. Refer to Appendix A for plots showing the load following and regulation capacity, ramps and ramp duration for all seasons.


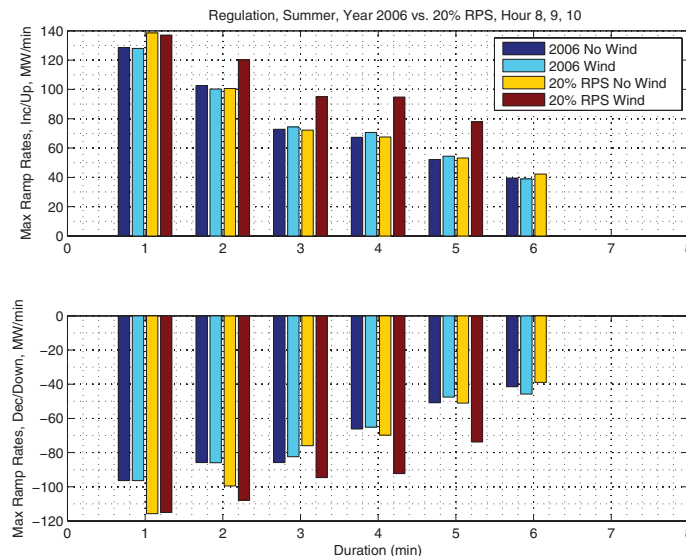


Figure 5-22: Regulation Ramp Duration





#### 5.10.4. Regulation study result summary

The California ISO regulation capacity requirements would increase noticeably during certain hours. The increase is explained by increasing inaccuracy of the persistence model used in this study for the Real-Time wind generation forecast. Table 5-5 summarizes the maximum expected values.

Table 5-5: Summary of Regulation Capacity

<b>Season</b>	<b>Max Regulation Up MW</b>	<b>Max Regulation Down MW</b>	<b>Max Hourly Increase (Up) MW</b>	<b>Max Hourly Increase (Down) MW</b>
Spring	+510	-550	+240 (HE18)	-300 (HE18)
Summer	+480	-750	+230 (HE09)	-500 (HE18)
Fall	+400	-525	+170 (HE06, HE18)	-275 (HE18)
Winter	+475	-370	+250 (HE18)	-100 (HE10)

To meet the 20% RPS, the California ISO regulation ramping requirements will increase by about  $\pm 20$  to 35 MW/min. (see Table 5-6). These increases will affect AGC ramps up to 5 minutes long.

Table 5-6: Summary of Regulation Ramps

<b>Seasons</b>	<b>Max Regulation Ramp Up MW/min</b>	<b>Max Regulation Ramp Down MW/min</b>
<b>Spring</b>	+20	-25
<b>Summer</b>	+10	-18
<b>Fall</b>	+25	-20
<b>Winter</b>	+15	-15

#### 5.11. Over-Generation Conditions

One of the concerns of grid operators about wind generation is that its energy can show up unexpectedly causing an imbalance between load and generation. Whenever there is an imbalance between generation and load, the California ISO's Automatic Generation Control (AGC) system sends control signals to units on regulation to move to different operating points in order to correct the imbalance. During over-generation conditions, regulating units are moved to the bottom of their regulating range and the Real-Time Economic Dispatch System drives units with decremental (DEC) bids to their minimum operating points. At times, operators may run out of DEC bids and have to go out of market to drive the units down further or command units to shut down.

Over-generation occurs whenever there is still more generation than load and the operators cannot move generators to lower the level of production. The controllable generation and imports are at their minimum levels or are shut down, exports are maximized and the total net generation production still exceeds the system load. The Real-Time energy prices typically go negative and the California ISO, at times, literally pays adjacent balancing authorities to take the excess energy.





This condition is most likely to occur if the following circumstances are present:

- Light spring load conditions with loads around 22,000 MW or less
- All the nuclear plants on-line and at maximum production
- Hydro generation at high production levels due to rapid snow melt in the mountains
- Long start thermal units on-line and operating at their minimum levels because they are required for future operating hours
- Other generation in a regulatory “Must Take” status or required for local reliability reasons
- Wind generation at high production levels

Figure 5-23 below helps to illustrate the over-generation problem:

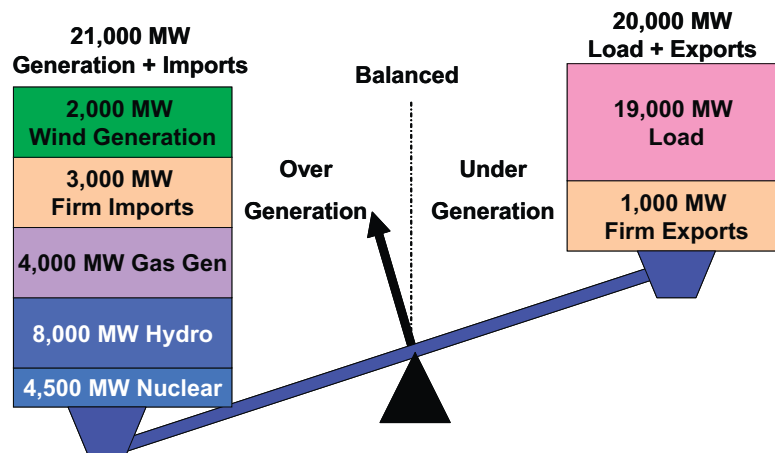


Figure 5-23: Over-Generation

In addition, the problem is exacerbated by, the lack of an accurate Day-Ahead forecast of wind generation energy production and the lack of a system to check and verify the feasibility of next day schedules. Even if some portion of the wind generation energy is scheduled in the Hour-Ahead market, it may be too late to correct the mismatches between load and generation schedules. The SCs help by attempting to sell the excess energy to other entities within the interconnection. The over-generation problem finally gets resolved, but the operators may incur several NERC Control Performance Standard violations in the process.

The CEC 2007 IAP Final Report identified over-generation as a potential problem during light load conditions. The minimum operating points for many of the generators in the California ISO market database do not always match the operator’s experience with the unit’s actual minimum operating levels due to environmental, economic and operating constraints of the plants.







### 5.11.1. 2006-2007 Over-generation analysis

In 2006, there were 45 hours of over-generation problems on 20 different days, and in 2007, there were six reports from January through May 2007. All of the incidents identified a problem with a mismatch or generation schedules with forecast loads. Although wind production levels played a very small role in over-generation problems in 2006 and 2007, it is anticipated that high levels of wind generation after the 20% RPS build out could cause operational challenges during light load conditions.

Example of a typical log entry for over-generation:

“05/06/2007 - 0615 Real -Time Over-Generation”

“Description: “Real-time over-generation condition for HE 0700”

*Details:* “For hour(s) ending 07, the California ISO has determined over-generation in the amount(s) of 500 MW. The California ISO may be invoking other steps in its over-generation procedure G-202, including, but not limited to, purchasing Out-Of-Market (OOM) decremental energy for this hour. Scheduling Coordinators should contact the California ISO Generation Dispatcher if they desire to provide OOM decremental energy for this period. To the extent that Scheduling Coordinators do not respond to this California ISO notice of over-generation, the California ISO may invoke other steps in the over-generation procedure G-202, including but not limited to pro-rata reductions and mandatory generation reductions.”

An example of over-generation with a clear correlation to wind generation energy production occurred in April 2006 for HE13 through HE19. At around 1130 hours, the wind generation ramped up from 600 MW to more than 1,000 MW in approximately one hour. The operator declared a 500 MW over-generation condition and the ACE remained high during this period. This event occurred on a light load day as the system load was in the 23,000 ± 500MW range at the time.

Figure 5-24 shows the wind generation production for that day and the corresponding ACE. Figure 5-25 shows the Real-Time prices for the same day, which were negative for a significant portion of the over-generation period.

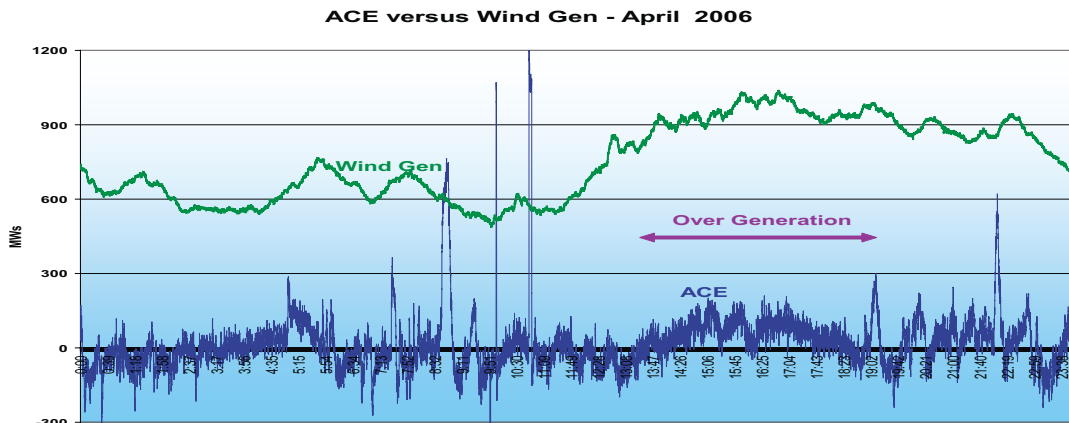


Figure 5-24: ACE versus Wind Generation





**April 15, 2006 - Real-Time Prices**

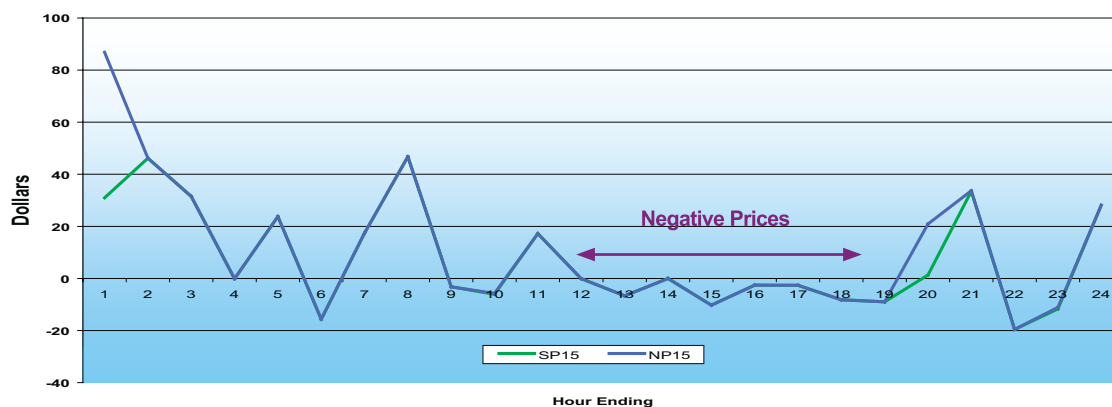


Figure 5-25: Real-Time Prices During Over-Generation Conditions


During the 2006 spring months (March, April & May), there were 208 hours when the California ISO load was less than 20,000 MW. The minimum amount of load (minus wind generation) recorded in 2006 was 18,070 MW. Table 5-7, shows a summary of the minimum generation that was on-line during light conditions.

Table 5-7: Minimum Generation Levels by Technology During Light Load

Generation/Load	Production Level Spring 2006 (MW)
Nuclear	4,528
Minimum "Must Take" such as QFs	2,400
Minimum Geysers	650
Minimum Thermal	1,000
Minimum Hydro	3,700
Minimum Interchange	2,880
<b>Total Generation plus Interchange</b>	<b>15,158</b>
Minimum Load	18,070
<b>Difference</b>	<b>2,912</b>

Based on the minimum generation levels shown in Table 5-7, assuming conditions remain the same with the build out, the maximum amount of wind generation that could be accommodated would be about 2,912 MW.

The critical components for over-generation appear to be maximum hydro generation, maximum wind generation, low system load, all nuclear plants on-line, heavy imports on the ties and other generation required to be on-line due to operating constraints. Under these conditions, over-generation is likely. Light loads and high wind generation is not a good gauge for over-generation. It is therefore difficult to predict the number of hours wind generation would have to be curtailed in 2010, during light load conditions, without accurate Day-Ahead wind forecast. This problem is exacerbated during favorable hydro conditions or when SCs have already made commitments in the forward markets to purchase inexpensive imports.





The fact that the California ISO had 45 hours of over-generation in 2006 with the current level of wind generation on the system leads to the conclusion that over-generation problems can be expected in the future when there is 3,000+ MW of wind generation. Whether wind is the cause or other factors are the cause, the California ISO will need to take action to reduce the amount of generation on the system when this occurs. This will include sending dispatch notices to wind generation facilities for their operators to take action to reduce their generation at the wind facilities. The California ISO recognizes the state's resource loading order, which places renewable resources low on the list for pro-rata cuts, but the California ISO may occasionally have to implement such cuts to ensure the reliability of the system.


### ***5.11.2. Over-Generation in the MRTU environment***

Under the new MRTU Integrated Forward Market (IFM), over-generation is managed as part of the IFM Unit Commitment process. The IFM ensures that the scheduled supply for each trading hour equals the quantity of scheduled demand. Wind generation energy does not have to be scheduled in the Day-Ahead market, but the SCs may elect to schedule some of the energy. After the Day-Ahead Market closes, the California ISO runs the Residual Unit Commitment (RUC) process to ensure sufficient generation will be on-line the next day to meet reliability requirements. If more energy supply is scheduled than the California ISO forecast demand for the next day, then the RUC process may identify the need to de-commit resources. One key input before the RUC process is initiated will be a Day-Ahead forecast for wind energy production. The RUC process should not identify the need for additional generation if there is a good chance that the generation will not be needed due to forecast wind generation energy production.

The RUC does not automatically de-commit a resource scheduled in the IFM. The California ISO operator may communicate the need for de-commitment of resources with affected market participants. If the Day-Ahead wind generation forecast is reasonably accurate, the potential over-generation problems can be resolved and feasible energy production schedules created for the next operating day.

In the actual operating day, the California ISO runs the Hour-Ahead Scheduling Process (HASP) that is used to lock in changes to schedules 75 minutes before the actual operating hour starts. The schedules for the wind generators in the PIRP program will be locked in at the 75 minute point. HASP provides the California ISO the opportunity to deal with over-generation by economically clearing an export bid in HASP in order to avoid manual intervention to decrease generation in Real-Time. If the over-generation condition continues in Real-Time, the Real-Time Market (RTM) attempts to dispatch resources down using economic bids to the extent possible to relieve the over-generation condition. If use of economic bids is insufficient, then supply curtailment is performed in accordance with Section 34.10.2 of the California ISO tariff.

Lastly, exceptional dispatches may be necessary to resolve the over-generation condition. The RUC solution identifies to the California ISO operator the resources that may need to be considered for de-commitment. The California ISO operator reviews and assesses the results prior to making any manual de-commitment decisions. The RTM applications use the latest information on hand about resource availability and network status; in fact, the optimal dispatch is initialized at the SE solution that is provided by the Energy Management System (EMS).





### 5.11.3. *Conclusions and recommendations about over-generation*

- Over-generation does occur with the existing amount of wind generation, but it is a relatively rare occurrence.
- The lack of good Day-Ahead wind generation forecasts contributes to the problem. Without good forecasts, other generation resources and imports on the ties may be over scheduled. This mismatch of energy production schedules with forecast loads is a key part of the problem.
- The addition of large amounts of wind generation facilities to meet the 20% RPS will exacerbate the problem. The fact that this problem is already visible with the amount of installed wind generation today means that this will become a much more serious problem as the amount of wind generation doubles and triples in the near future.
- The MRTU Integrated Forward Market should help mitigate the problem once it goes live in 2008 as it will ensure the generation schedules match the load forecast. Accurate Day-Ahead wind generation forecasts will be a key component for the Day-Ahead RUC process.
- As pointed out in the CEC IAP report, the wind generation operators should be prepared to curtail some wind generation production for up to 100 hours per year to mitigate serious over-generation conditions in the future. The amount of renewable energy that will be lost is expected to be small. The hourly pro-rata cuts will probably be less than 500 MW. Curtailment of some wind generation energy production for a few hours per year may be the practical solution to address over-generation.
- The California ISO must work with the wind generator operators to ensure procedures, protocols and communication facilities are in place so dispatch commands can be communicated to the wind plant operators.
- Additional storage capability on the system would help to mitigate both over-generation and large ramp conditions. For example, upgrading the transmission system to the Fresno area would allow frequent use of the third pump at the Helms Pump Storage plant. The third pump adds 300 MW of additional load to the system, which could help to absorb the increased wind generation at night and during light load periods.
- There must be continuing exploration of other storage technologies and off-peak loads that can be combined with the wind generation production. The plug-in hybrid vehicle projects underway at both SCE and PG&E as plug-in hybrids could ultimately add significant night time load to the system.








## Chapter 6 – PIRP II Enhancements

In 2003, the California ISO created the Participating Intermittent Resource Program (PIRP) to lower a perceived barrier to wind generation participation in the California ISO markets and Real-Time operations. PIRP allows intermittent resources to schedule energy in the Hour-Ahead Market without incurring imbalance charges when the delivered energy differs from the scheduled amount. Participating Intermittent Resources that schedule in accordance with the Hour-Ahead forecast provided by the forecast vendor will not receive imbalance energy charges for deviations across a 10-minute settlement interval. Instead the megawatt deviations from a Participating Intermittent Resource will be netted across a calendar month and settled at a weighted-average price. With an unbiased, state-of-the-art forecast, the expected net deviation should be somewhat low.

The success of the PIRP is dependent on the accuracy of the forecast provided to the wind plant SC by a Forecast Service Provider (FSP) 2 hours and 45 minutes before the operating hour (the Hour-Ahead [HA] forecast). The HA forecast requires Real-Time data from each wind plant site, and the forecast accuracy is dependent on the quality of data from that plant. Unfortunately, the original implementation of the PIRP application did not anticipate the California ISO's need to check the data<sup>29</sup> quality from each of the wind plants and the need for the California ISO to report data problems to the wind plant operators. The need for an errant data feedback system became more obvious as more wind plants were brought on-line and into the program. An informal manual e-mail system was established to fill the feedback gap with the FSP doing the data quality checks. Although this improved the data quality, it included serious delays in the reporting of bad data as the data checking was too far downstream in the process. Delays of several days or longer were not uncommon to identify and correct communication problems, missing data and bad data from devices at the various wind plant.

In 2006, the California ISO started work on major upgrades to the PIRP to fix this problem and add other system features. The PIRP II project included major enhancements to the PIRP application software to detect bad data and to automatically report problems in a timely manner to the wind plant operators. The primary objective was to provide the wind plants SCs with timely information regarding their participation in PIRP without manual intervention. Information provided to the wind plants SCs give immediate errant data feedback when the wind plant retrieves their HA forecast, thus eliminating the need for a manual feedback system. With the added visibility to errant data that PIRP II provides, the California ISO is now performing a study to determine the following: the different types of errant data; the cause of the errant data, the responsiveness of the PIRs to the notifications of errant data; and what corrective action can be taken to improve the forecast accuracy in the future.

<sup>29</sup> Errant data is when the PIRP application has determined that for one or more reasons, the Resource's Met/Gen data is either unavailable or is not passing one of the many data quality validations.





The PIRP II also addressed issues such as future scalability; added an internal PIRP administrator console for ease of managing users, resources and application configuration settings; improved audit capability of data the FSP provided to the California ISO; and provided safeguards for the speedy recovery of the PIRP database should a loss of data occur.

The new PIRP II system went into operation at the California ISO in May 2007.







## Chapter 7 - Storage Technology

**B**attery storage and pump hydro storage systems have been around for many years, so the concept of energy storage is not new. Large pump storage facilities have been proven to be very effective in shifting large quantities of low cost off-peak energy production to delivery during high cost on-peak energy periods. However, large pump hydro storage facilities are quite costly, and there are very few locations where they can be built. Battery storage systems are also relatively costly and have limited amounts of energy storage.

New types of energy storage technologies are needed that can help with the integration of large amounts of renewables and energy from intermittent resources. R&D efforts have accelerated over the past several years to develop and test new storage systems. Several types of systems are being evaluated as potential new storage technology, and in this chapter, the following are discussed: Hydrogen, compressed air, closed loop pump hydro storage, flywheel systems, super capacitors and flow batteries.

A number of problems with new storage technology must be overcome in order for the technology to be competitive. These problems include the following:

- The capital costs are quite high for new storage facilities – typically \$1 million to \$1.5 million per MW of capacity.
- The efficiency of new systems is still low. Efficiency numbers are not typically available, but they appear to be less than 75% for many of the technologies. This means that 25% or more of the energy supplied to these system is not recovered. Some technologies have losses due to pump operation, some have compressor loads and others have inverter losses. The efficiency of the high speed flywheels is better than most of the new technologies as they are in the 80% to 90% range. Their losses are due to the power electronics of the inverters and not due to losses in the flywheel itself.
- Storage systems are a net negative system device. They look more like a load than a generator. Their preferred operating point will be zero or slightly negative as they consume power from the grid to perform their storage function. When they are absorbing power from the grid, they are essentially buying power at the Real-Time energy price. When they are supplying power, they would be selling power at the Real-Time energy price. One question will be whether there should be a special tariff for storage systems.
- The amount of energy storage capability of these systems is typically quite limited. Batteries and high speed flywheels can deliver their rated output for 10 to 15 minutes. Flow batteries, hydrogen storage and compressed air systems can probably deliver energy for an hour or two, but so far have not demonstrated they could delivery energy





for ten hours or longer. The sodium-sulfur (NAS) battery developed in Japan, delivers 7 to 8 hours of stored energy at installations currently up to 12 MW of capacity.

- There are not good economic models or operating data on the various technologies to prove they make a good business case.
- To encourage commercial investment in new storage technologies, the first deployments may need investment tax credits similar to those enjoyed by the wind generators for the past several years.
- The first commercial deployments of new storage technology will probably need some type of a grid services performance contract to share the financial risk. This will help the owner/operator obtain financial backing for the new venture and provide a chance to validate the business economics of the system. Part of the services they provide could still be market based and part could be contract performance based, similar to RMR contracts.
- The DOE and the CEC investments in storage technology R&D projects are critical for the development of these new technologies. The results of the R&D projects should be published to provide the data required for commercialization.
- The California ISO needs to continue to develop new methodologies for dispatching different types of storage systems. The traditional AGC signal sent to hydro generation for regulation services is probably not going to work for storage systems like flywheels that need lots of charge and discharge cycles per hour. The response of high energy capacity NAS battery systems to AGC signals is yet to be demonstrated.
- Based on the industry feedback to the California ISO on the LEAPS project, it is clear that the California ISO should not be the owner/operator of large hydro pump storage facilities. This may also be true for other types of storage technology. Should all storage facilities be independently owned and their services market based or should some of them be owned and operated by the transmission operators?
- Storage facilities can provide a number of benefits that will help with the integration of large amounts of renewable resources. Storage provides a mechanism for saving off peak energy production from wind generation and delivering the energy during on-peak periods. Some storage technologies can also provide ancillary services such as regulation and contingency reserves and reactive power for voltage support. The major barrier for construction of new storage facilities is not the technology but the absence of market mechanisms that recognize the value of the storage facilities and financially compensate them for the services and benefits they can provide. The California ISO will participate with the IOUs, stakeholders and potential providers of storage technology to design market products that properly compensate storage facilities for the benefits they can provide.<sup>30</sup>

---

<sup>30</sup> Response to comment from Ed Cazalet, Megawatt Storage Farms, Inc.





## 7.1. Benefits of Storage Technology

### 7.1.1. Mitigates over-generation problems

Dispatchable loads and energy storage systems can add significant flexibility to the operation of the power grid. They can often respond in a few seconds to commands to absorb energy. Each type of technology has its unique response rate, some in one second and others within a few minutes, but all can quickly connect to the system and ramp up to add load to the system. For example, large pump storage plants can be switched from generation mode to pumping mode within approximately 15 minutes. The addition of up to 500 MW of new storage capability to the system, with the ability to respond to the California ISO dispatch commands, would add major flexibility for the operators to deal with over-generation problems. Load could be added to the system either by the storage owner/operator as a market participant or by dispatch notice from the California ISO to rebalance the system.

A second issue is the need to increase the amount of off-peak load on the system that could take advantage of the off-peak energy production from wind generation. An example would be the dispatch of major state pumping load to increase or decrease system load as the wind generation production increases and decreases. Another example is the potential growth in load from plug-in hybrid vehicles. If feasible these changes could provide system load that is matched with the off-peak energy production from renewables.

### 7.1.2. Mitigates large ramps

Storage systems can quickly supply energy to the system when needed and help with the mitigation of large load and/or wind generation energy ramps. The CEC IAP report identified the fact that the California ISO will have to deal with energy ramps of several thousand megawatts per hour during some periods. Short-term ramps that often occur at the top of the hour can be another challenge. Storage systems that can quickly inject power into the system or add a block of load could mitigate some of the ramp problems and allow other resources to be dispatched and catch-up with the ramp. Flywheel systems, for example, can ramp up to full output in approximately one second and hold that level of production for 10 to 15 minutes. Hydro units and pump storage units all have fast ramp rates and can usually sustain the maximum level of production for several hours or longer. A portfolio of fast responding units like hydro and storage facilities in combination with other units that can move through large ranges of output will enhance the integration of large amounts of renewable resources.

Storage technology has the advantage of not using fossil fuel, so storage facilities do not directly contribute to greenhouse gas production. If the energy in storage comes from renewable resources, they are simply storing the green energy and delivering it back to the system when it is needed. If load is ramping up as wind is ramping down, storage can provide the added energy to mitigate the resulting net energy ramp.

### 7.1.3. Provides Ancillary Services

As discussed earlier in this report, an increase in the amount of wind generation will require





increases in the amount of regulation and load following capability. Flywheel and NAS battery systems are ideally suited to provide some of the added regulation. Both technologies can provide up to 40 MW of regulation services and eliminate the need to move fossil fuel units up and down a few megawatts at a time. Hydro, pump storage and fossil fuel units will still be needed for large ACE deviations and macro AGC control.

Hydro generation and pump storage are excellent sources for the required system operating reserves as they can provide this capacity without the use of fossil fuel. They can be synchronized to the system and be ready to produce substantial energy on demand. A pump storage plant like Helms Pump Storage Facility can provide 600 MW or more of operating reserves and rapidly ramp up its output if required due to the loss of a large unit on the system.

#### ***7.1.4. Provides reactive energy for voltage support and, could reduce the need for RMR units***

Storage technology typically uses some other medium to store the electrical energy. This can be a rotating mass, water, chemical, compressed air, hydrogen or something other than storage of electrons. Most of these systems require some type of generator and an inverter to create 60 Hz synchronized power that is delivered back to the grid. If the systems have an inverter, this device can deliver reactive power as well as real power, which means the systems can help to support the voltage in that area. It is also possible to locate these devices in a warehouse or near a load center, which means they can provide reactive power to support the voltage in a transmission constrained area. Storage technology devices could compete with Reliability Must Run (RMR) generators to provide reactive power, dynamic VARs and voltage support.


#### ***7.1.5. Shift energy from off-peak to on-peak delivery***

One value of large storage systems is the ability to absorb energy during off-peak periods and then deliver the energy to the system at peak periods. If the wholesale price differential between off-peak and on-peak periods is large, then the storage technology can be economically justified.

All storage systems are net-negative devices, which mean there is some loss of energy in the systems. If the device has a “round-trip” efficiency of 75%, then for every 100 MWh of energy input into the storage device, only 75 MWh of energy is recovered and returned to the grid. Therefore, the price differential between off-peak and on-peak energy would need to be 1.33 to 1 or greater to make a profit with the storage system for shifting of energy. If the on-peak/off-peak price differential is small, then the owner/operators of storage technology need to sell additional services such as regulation or operating reserve capacity to supplement the profit stream for the technology.

## **7.2. Pump Storage and the Need for Three Pump Operation at Helms**

Pump storage is a proven storage technology. It has been around for many years, and California is fortunate to have a number of pump storage facilities. One of the largest facilities is the Helms Pump Storage Facility that was built in the early 1980s with three units. Each unit





is rated at 400 MW in generation mode and 310 MW in pumping mode for a total of 1,200 MW generating mode and approximately -900 MW pumping mode. The pump motors are non-variable speed motors, so the load operation is rather stepwise as shown in Figure 7-1 as the units come on and off in 300 MW steps. When a pump is tripped, it actually moves the frequency of the Western Interconnection enough to trigger the system frequency alarm.

A sort of the hourly energy data shows the amount of time for the various pumping modes at the plant.


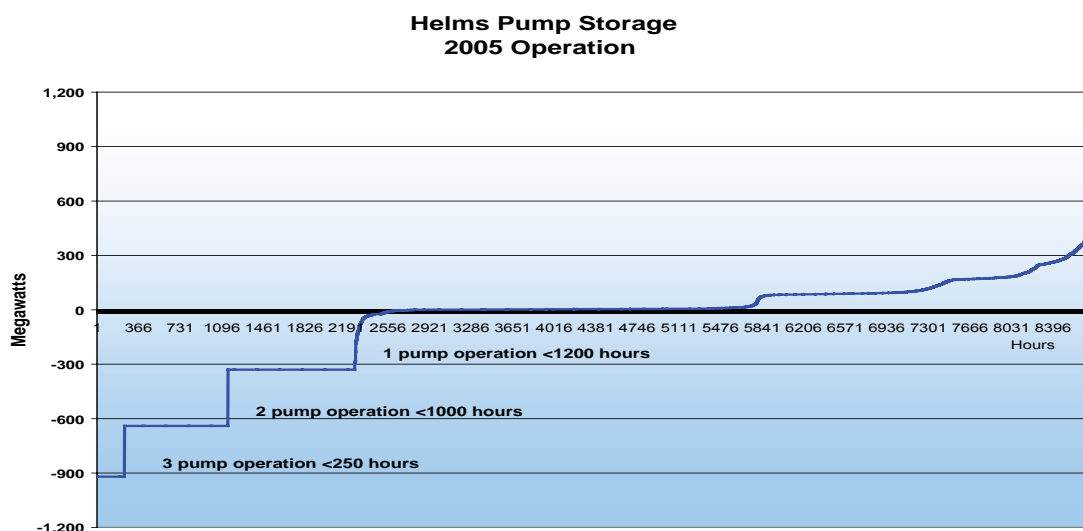


Figure 7-1: Helms Pump Storage Operation in 2005

The simultaneous operation of all three pumps at Helms is currently limited by transmission constraints in the Fresno area. The fact that three pumps are on less than 3% of the total time per year will become a more serious problem as the amount of wind generation on the system increases. An additional 300 MW load at Helms due to three pump operation instead of only one or two pumps during off-peak periods would add a valuable sink for the excess off-peak wind generation. PG&E has proposed a transmission upgrade plan for the Fresno/Helms area that would enable three pump operations for many additional hours per year. The new plan will also move the energy from the wind farms in Tehachapi to the Helms facility. Both the GE studies and the California ISO studies have shown that operation of three pumps at Helms will help to mitigate the potential future over-generation problems.

### 7.3. Sodium Sulfur (NAS) Batteries for Energy Time-shifting and Renewable Generation support

The development of NAS battery technology in Japan during the 1980s was because of the need for responsive, large capacity energy storage (e.g., multiple 10 MW blocks with 8 hours storage) distributed within metropolitan areas as an alternative to distant pumped hydro. NAS





batteries are in the early stages of introduction to U.S. and global markets. Over 200 MW of NAS capacity have been deployed in Japan at installations up to 12 MW, each with nominal energy storage of 7 hours at rated power. American Electric Power (AEP) started operation of the first 1 MW unit in the U.S. in June 2006, and recently announced plans to acquire an additional 6 MW. Several other projects are under development in the U.S., including at California utilities.

To date, the most frequent application in Japan has been off-peak to on-peak energy delivery (also known as time-shifting or peak-shaving). However, recent emphasis on wind generation deployment to meet the Kyoto protocol has stimulated development of large systems for combined time-shifting and wind stabilization, brought on by a combination of Japanese geography and the usual diurnal mismatch between peak wind generation and peak load. Because premium wind resources are remote from load centers and separated by complex terrain in Japan, wind patterns are turbulent, and wind developers are required to stabilize output before connecting to the grid. Also, Japan has a large fraction of base-load nuclear power with few generation resources to provide off-peak load-following.

NAS installations will suppress short-term wind power fluctuations (similar to those associated with regulation control on U.S. grids), and time-shift off-peak generation to on-peak loads. Accordingly, the NAS installation appears to the grid as dispatchable load during off-peak intervals and as dispatchable generation during on-peak intervals. A 34 MW NAS installation rated at 245 MWh storage is under construction at Rokkasho Village in Northern Japan. Operation is scheduled for April 2008.

NAS battery applications in U.S. markets include combinations of regulation control, load-following; T&D upgrade deferral, time-shift renewables generation and reliability enhancement.


#### **7.4. Use of Flywheel Technology for Additional Regulation**

The CEC funded a field test in 2005-6 for a 100 KVA high-speed flywheel system in San Ramon on the California ISO-controlled Grid. The California ISO sent ACE signals to the unit to verify the unit's ability to provide regulation and frequency control services to the grid. This test was successfully concluded in early 2007. The system was highly reliable and met all the California ISO's performance standards.

The next step is the potential commercial installation of a 20 MVA flywheel system on the California ISO-controlled Grid and for the flywheel system to provide regulation services. A proposed 20 MVA Beacon Power high speed flywheel system is shown in the pictures on the next page:





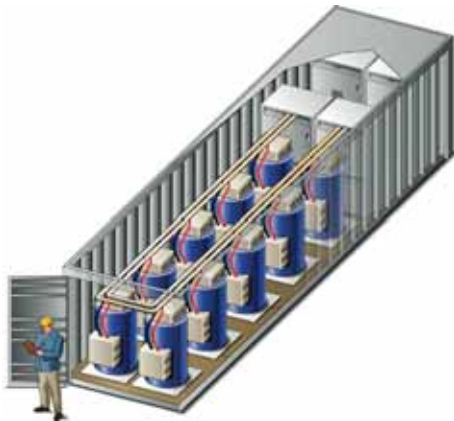

KEMA was asked to evaluate the environmental impact of using flywheel technology for regulation services versus a conventional fossil fired power plant. Their report concluded "that flywheel-based frequency regulation can be expected to produce significantly less CO<sub>2</sub> for all three regions (of the country) and all the generation technologies, as well as less NO<sub>x</sub> and SO<sub>2</sub> emission for all technologies in the California ISO region....When the flywheel system was compared against "peaker" plants for the same fossil generation technologies, the emissions advantages of the flywheel system were even greater."<sup>31</sup>

The flywheel system has a very fast dynamic response rate and can switch from full charge to full discharge in one second. This fast response rate and ramp rate make it an ideal technology for frequency and ACE regulation. The high availability of the system and high efficiency make it an excellent candidate for commercial deployment of the system. As new wind generation is added to the system and the amount of required regulation services increases, a 20 MW or 40 MW flywheel systems may be the best environmental choice for meeting the regulation needs.


## 7.5. New Storage Technologies

### 7.5.1. Hydrogen storage

Hydrogen storage is now being proposed as the answer to the need for new storage capability. It has the advantage of being easy to make as electrolysis is a tried and true method for separating water into hydrogen and oxygen molecules. The energy can be recovered by either using a fuel cell to recombine the hydrogen and oxygen or the hydrogen can be used as fuel in a steam boiler or combustion engine.

On May 8, 2006, DOE, NREL and Xcel Energy signed a two-year cooperative agreement for a "wind to hydrogen" research, development and demonstration project. The research will examine hydrogen production from wind power and the electric grid. The hydrogen will be produced through electrolysis (i.e., splitting water into hydrogen and oxygen using electricity from wind turbines). For storage, a new onsite facility will compress the hydrogen into containers. Later,

<sup>31</sup> "Emissions Comparison for a 20 MW Flywheel-based Frequency Regulation Power Plant", KEMA Project:BPCC.0003.001 January 8, 2007 Final Report.







the hydrogen will be used to generate electricity either through an internal combustion engine or via a fuel cell. Xcel and NREL are each paying part of the two million budget for the project. The project commenced operation in December 2006 and operational results are to be released soon.

The main problem with hydrogen is storage. If hydrogen is compressed and stored in a high pressure tank, a lot of energy is required to compress it to 5,000 PSI, and a very large tank is required to hold a significant amount of hydrogen gas. This significantly lowers the efficiency of the process and makes hydrogen uneconomical for large amounts of storage. Cooling hydrogen to very low temperatures will reduce the volume of storage, but this makes the process even more uneconomical. New carbon nanotube technology has been proposed as a storage medium for hydrogen, and research on this technology is underway. "Carbon nanotubes are microscopic tubes of carbon, two nanometers (billionths of a meter) across, that store hydrogen in microscopic pores on the tubes and within the tube structures. Similar to metal hydrides in their mechanism for storing and releasing hydrogen, the advantage of carbon nanotubes is the amount of hydrogen they are able to store. Carbon nanotubes are capable of storing anywhere from 4.2% to 65% of their own weight in hydrogen."<sup>32</sup>

The US Department of Energy has stated that carbon materials need to have a storage capacity of 6.5% of their own body weight to be practical for transportation uses. Carbon nanotubes and their hydrogen storage capacity are still in the research and development stage. Research on this promising technology has focused on improving manufacturing techniques and reducing costs as carbon nanotubes move towards commercialization.

The DOE is sponsoring a major research project on hydrogen storage technology. The May 8, 2006 the DOE press release described a two-year DOE-sponsored research project to be performed for NREL and XCEL energy to evaluate the use of hydrogen storage in combination with wind generation. The field test facility was dedicated in December 2006. It is recommended that representatives from the California ISO, the CEC and the California utilities do a joint review of this DOE project.

The California ISO is a participant in a BPA sponsored research project on the use of storage technology to mitigate the changes to Area Control Error (ACE) in the two areas due to wind generation.<sup>33</sup> This is a joint project with Pacific Northwest National Labs (PNNL). The concept is to determine the portion of the ACE in each of the two balancing authorities that is being driven by the changes in wind generation. Next, combine the two ACE terms into a net ACE, then use high speed storage such as a flywheel system to dampen the change to the two systems. If wind is ramping up in one system and down in the other, the net change may be small and the interconnection frequency is not really being affected by the aggregate change in wind generation energy in the two areas. Obviously there are transmission constraints that have to be included in the new control system design. The final report on this concept is due by the end of 2007.

<sup>32</sup> [http://www.fuelcellstore.com/information/hydrogen\\_storage.html](http://www.fuelcellstore.com/information/hydrogen_storage.html)

<sup>33</sup> "Wide-Area Energy Storage and Management System to Balance Intermittent Resources in the Bonneville Power Administration and California ISO Control Areas", BPA 00028087 / PNNL 52946.





### 7.5.2. Compressed air storage

Compressed air storage technology has been used in Iowa with some success. They took advantage of a large underground aquifer for the compressed air storage reservoir. A 1.5 MW wind turbine is used to both compress the air and inject it into the aquifer and for recovery of the energy that is fed back into the grid. To make much of a difference, there would need to be 50 or more of these units.

The CEC has contracted with EPRI for a Compressed Air Study for California to determine if the many abandoned gas and/or oil wells in the state could be used for compressed air storage. The report on this study is scheduled for release later this year

### 7.5.3. Flow batteries

Flow batteries create energy storage by using large tanks of a rechargeable electrolyte. The three types of flow batteries are zinc-bromine, vanadium redox that uses sulfuric acid, and sodium-bromide.


Flow batteries have low energy density, but they offer high capacity and independent power and energy ratings. Vanadium Redox Battery (VRB) installations offer up to 500 kW, 10 hrs (5 MWh). In 1991, Meidisha unveiled a 1 MW/4MWh ZnBr battery, and numerous multi-kWh ZnBr batteries have been built and tested over the years. So far, only relatively small flow battery systems have been installed in the U.S. The electrolytic material used in these systems is quite corrosive and environmentally challenging to site and permit.

A flow battery system is being proposed for the Santa Rita Jail in California. This project is a partnership with the jail, PG&E, Chevron Energy Solutions and VRB Power Systems. The objective is to develop a Microgrid demonstration project that includes a VRB flow battery. This project proposal was submitted to the DOE for funding in July 2007.

“The proposed Micro Grid Project includes the installation of a 1.5 MW VRB flow battery at the jail with six hours of storage capacity for a battery rating of 9 MWh capacity, a static transfer switch, and a generation monitoring and control system (e.g., CERTS). This environmentally-friendly battery, in combination with the existing fuel cell and PV systems, will have the capability of following the jail’s electrical load and would provide sufficient generation capacity to provide approximately eight hours of the jail’s full power needs. This will be accomplished without having to start the jail’s diesel generators, thus reducing emissions. The jail’s peak utility demand in 2006 was 2.3 MW when the fuel cell was not in service. With the fuel cell in service, the peak utility demand would be about 1.3 megawatts.”<sup>34</sup>

The California ISO has agreed to be an advisor on the Santa Rita Jail project if it is funded by the DOE.

<sup>34</sup> VRB project proposal “Santa Rita Jail AC Micro Grid System Demonstration Project Summary - June 21, 2007.





#### **7.5.4. Super capacitors**

Super capacitors or electrochemical capacitors, possess swift charge and discharge capabilities. More powerful than batteries, they can be cycled tens of thousands of times. Those with energy densities under 20 kWh/m<sup>3</sup> have been successfully developed, and work is underway to expand the effectiveness of larger units.

#### **7.5.5. Plug in Hybrid Vehicle-to-Grid (PHVG)**

The idea of using the batteries of electric vehicles as an energy storage resource -- a concept called Vehicle to Grid (V2G) -- is still in its infancy, but may have potential as a quick-response, high-value service to balance fluctuations in load. Some experts predict that by connecting enough vehicles to the grid and transmitting power back and forth as needed, utilities could one day save billions per year.

#### **7.5.6. Lithium-Ion battery storage**

Lithium-Ion batteries have been successfully used in Japan for large amounts of electric energy storage. Their experience with a 34 MW NAS Battery System for the 51 MW Rokkasho Wind Park was reported at the EESAT 2007 Conference that was held in San Francisco, September 28. Lithium-Ion batteries have high power density and appear to be cost-effective for use with intermittent renewable resources.

### **7.6. Conclusion**

The intent of this chapter is to highlight some of the current work in progress in the area of storage technology. The California ISO and the utilities need to work with the DOE and the CEC to follow the research in storage technology and to provide opportunities for testing and evaluating new storage technology in California. Storage will play an important role in California in the successful integration of large amounts of renewable energy in the future.

Storage facilities can provide a number of benefits that will help with the integration of large amounts of renewable resources. Storage provides a mechanism for saving off-peak energy production from wind generation and delivering the energy during on-peak periods. Some storage technologies can also provide Ancillary Services such as regulation and contingency reserves and reactive power for voltage support. The major barrier for construction of new storage facilities is not the technology but the absence of market mechanisms that recognize the value of the storage facilities and financially compensate the owners for the services and benefits they can provide. The California ISO plans to work with the IOUs, stakeholders, and potential providers of storage technology to design market products that properly compensate owners of storage facilities for the benefits they can provide.

### **7.7. Recommendations**

- Initiate a California ISO project for storage technology with the goal of removing technical and economic barriers to the deployment of the technology.





- Hold stakeholder meetings and workshops to explore market mechanisms for financially compensating owners of storage facilities for the benefits they could provide such as regulation services, other Ancillary Services, transmission loading relief and voltage support. This is in addition to their ability to shift off-peak energy production to energy delivery on-peak.
- Work with the CEC and the DOE and the IOUs on evaluating storage technology and participate in field tests of the various technologies as appropriate.







## Chapter 8 - National Experience

There have been numerous wind integration studies in the U.S., and some common themes have emerged from the published reports. Utilities that have some hydro generation resources can more easily accommodate the variability of wind generation. When the wind generation is high, the hydro systems can be backed down to accommodate the wind generation energy. The water is conserved behind the dams, and this essentially stores the renewable energy for delivery during times when the wind is not blowing. There are constraints on hydro systems; however, as a prescribed amount of water release is often mandated for fish, agricultural and environmental reasons. Utilities that depend on the fast ramping hydro systems for regulation lose some of the regulation capability if the units are forced down to minimum energy production levels to make room for the wind generation.

Utilities that have all their units scheduled on a block hourly basis and have a limited amount of regulation capability will also experience some difficulty in handling large amounts of intermittent energy production from wind generation. The combined variability of both load and wind generation can result in major system control problems if there is a limited amount of regulation available and the scheduled hourly energy production from other generating units cannot be changed. For example, coal fired generating plants do not change production levels easily and typically are not used to supply regulation services. Systems like ISOs and RTOs with market structures that enable them to redispatch units on a 5 to 15 minute basis will have a much easier time rebalancing as wind generation production levels change.

### 8.1. Major U.S. Studies on Renewables

#### *8.1.1. Minnesota Wind Integration Study – 2006*

This study evaluated the reliability and cost impact associated with increasing installed wind generation to 15%, 20% and 25% to serve customer load in Minnesota by the year 2020. Projected increase of wind generation is 4,500 MW. Four balancing authorities were included in the study – Xcel Energy, Great River Energy, Minnesota Power and Otter Tail Power. The study concluded that they could accommodate up to 25% (5,700 MW) of energy from wind generation resources without significant reliability and transmission congestion issues. They will need to increase the amount of regulation capacity by up to 20 MW, and their incremental operating reserve costs increase by \$0.11 per MWh for the 20% wind generation case. Their total wind integration operating cost range for up to 25% wind energy delivered to their customers is less than \$4.50 per MWh of wind generation.





### **8.1.2. New York State**

The state commissioned a study on the impact of 3,300 MW of wind generation (10% of the New York State peak load). The results of this comprehensive study were published in 2005, and the report has been a model for how to do renewable integration studies. GE Energy was the consultant for this study. The results pointed out the importance of interconnection rules that require wind generation to meet Low Voltage Ride Through standards and voltage regulation criteria. The study also highlighted the importance of a reasonably accurate Day-Ahead wind generation forecast for scheduling of other generation resources and unit commitment. The financial impact of this forecast was very significant (millions of dollars annually) to the customers in New York if no wind generation forecast was available and generating units started that were not needed. The study also showed that the amount of additional regulation capacity needed was less than 40 MW, and no additional spinning reserves were needed.

## **8.2. Western Regional Coordination of Strategies on Renewables**

BPA and the California ISO have agreed to work together on issues of common interest related to integration of renewables. Particular emphasis is on policy setting with regard to wind development. There is already cooperation and collaboration on technical issues, but more needs to be done to shape policy issues on renewables in the West.

Key strategic issues should include sharing of information on generator interconnection queues and forecast imports and exports of renewables between balancing authorities. This would facilitate improved transmission planning so the energy can be moved between areas with minimum congestion issues.

A second issue is the need for common and consistent interconnection agreement language so wind generators and other renewables will receive common treatment in all areas. This working group can create a template for interconnection agreements with wind generation that combines the best features from each company.

## **8.3. Northwest Wind Integration Action Plan**

The Pacific Northwest Wind Integration Plan was published in March 2007. This report was a major collaborative effort of all the Pacific Northwest utilities with BPA one of the leaders of the effort. A summary of this report follows.

### ***8.3.1. There are no fundamental technical barriers to operating 6,000 megawatts of wind in the Pacific Northwest.***

There is a range of estimated costs associated with integrating wind into the Northwest power system. When wind energy is added to a utility system, its natural variability and uncertainty is combined with the natural variability and uncertainty of loads. As a result, there is an increase in the need for system flexibility required to maintain utility system balance and reliability. The cost of wind integration starts low, particularly when integrating with a hydro power system that has substantial flexibility, and then rises as increasing amounts of wind are added. Locating







wind resources in geographically diverse areas can help reduce costs. Ultimately, costs plateau at the cost of integrating wind with natural gas power plants.

The preliminary cost estimates for integrating 6,000 MW of wind power are based upon existing levels of system flexibility. Load growth and other competing uses for that flexibility, and possible further constraints on system operations, will diminish the supply and increase the cost of wind integration services.

With increasing amounts of wind, there will likely be times when large, unexpected changes in wind output (so-called “ramping events”) coincide with periods of limited hydro flexibility. Initial analyses indicate that these will be low probability events, but if other sources of flexibility are not available at the same time, system operators will need to limit wind output for brief periods in order to maintain reliability. The Federal Energy Regulatory Commission now requires wind plant operators to help maintain system reliability. Northwest utilities and wind developers are collaborating to implement the requirement in a mutually-satisfactory and cost-effective manner.

### ***8.3.2. Wind energy is providing value to Northwest electricity consumers, but the Northwest will still need other resources to meet peak loads.***

The fundamental value of wind to a utility’s portfolio is its ability to provide energy to displace fossil fuel consumption, limit exposure to uncertain and volatile fuel prices, and hedge against greenhouse gas control costs. Because wind is primarily an energy resource with relatively little contribution to meeting system peak requirements, the Northwest will need to build other resources with greater capacity value to meet growing peak loads.

### ***8.3.3. In the short-term, there is available transmission capacity to integrate additional wind resources – but this is not expected to last for long.***

New transmission will be needed to support growing loads and resource additions and can facilitate the opening up of new areas for wind development, helping to diversify wind production. This diversity helps smooth variability and therefore lowers the cost of wind integration. Because of the limited contribution of wind to meeting system peak requirements, traditional models for transmission development and marketing should be altered to achieve greater economic efficiency. A more economical and efficient approach for a resource such as wind is to provide a mix of firm, non-firm and conditional firm transmission that achieves a balance between the cost of transmission capacity and the value of delivered wind energy. Cooperation among transmission planners, regulators, utilities and the wind development community is essential to create a workable model for planning, financing and marketing transmission for wind energy.





***8.3.4. The major portion of wind integration costs are due to the need for additional flexible resources to balance loads and resources in Real-Time in order to accommodate wind variability.***

Balancing authority operators must have sufficient flexible generating capacity or load management options available to accommodate load and wind variability to ensure that reliable service will be maintained. There should also be provisions for equitable recovery of the associated costs.

***8.3.5. Steps can be taken to increase integration capability and lower integration costs.***

The cost of wind integration services can be reduced through four general types of actions: 1) developing more cooperation between regional utilities to spread the variability of wind more broadly; 2) developing markets that will reward entities that choose to market their surplus flexibility; 3) making more low-cost flexibility available, such as that provided by hydroelectric resources; and, 4) development and application of new flexible technologies. Achieving these goals will require coordinated actions similar to those required to establish the Pacific Northwest Coordination Agreement of the Columbia River Treaty. Fortunately, the region has a long history of forging cooperative agreements designed to increase the size of the pie for all regional consumers. These agreements can provide a model for what will be needed over the next several years to address wind integration issues.





## Chapter 9 - International Experience

The experiences from Europe and other countries with significant amounts of wind generation and other renewables can provide some valuable insights on the issues and solutions that could be adopted in California. Island systems, such as Ireland and Australia, have greater challenges with larger amounts of wind generation than countries that are part of a large interconnected system like Spain and Germany. The CEC IAP report included a section "Review of International Experience Integrating Variable Renewable Energy Generation". This report and additional information from company web sites, presentations at various conferences and published papers are the sources for the material in this chapter.

### 9.1. Spain<sup>35</sup>

While the European countries have led the electric industry with the development of wind, Spain (the second largest wind producer in Europe<sup>36</sup>) has been contending with issues on a scale equivalent to the California ISO. In 1996, Spain had 164 MW of installed wind generation. As of November 2006, the country had more than 11,000 MW of installed capacity on a 43,700 MW peak system. By 2010, it is anticipated that Spain will have more than 20,155 MW of installed wind generation on their grid.


The large amount of integration of wind generation prompted the Spanish TSO Red Eléctrica de España, S.A. (REE) to develop a three-pronged strategy focusing on sophisticated wind forecasting tools, wind farm connection standards and dispatchability of the wind farms.

#### 9.1.1. Spain's forecasting tools

Wind producers in Spain are entitled to deliver electricity to the grid via the wholesale market or a distributor, as long as it is technically possible. In either case, the wind parks are required to provide a wind forecast to REE. With the large amount of variable wind energy production being placed into the electrical system, a more precise forecast regimen was required. In 2002, REE started to develop an hourly forecasting system that delivered forecasts up to 48 hours in advance. Using data from the wind parks for the various areas throughout the peninsula, REE was able to create and use a high quality forecast system that could focus on any size region within the country. REE was able to reduce their 48 hour percent mean relative error from almost 40% in 2005 to approximately 26% in 2006. For both years, the percent mean relative error for the less than 5 hour look ahead was less than 15%. They have achieved these values by applying a continuous improvement process to the forecast system.

<sup>35</sup> Adapted from "Large integration of wind power: the Spanish experience, Juan M Rodriguez-Garcia, Tomás Dominguez, Juan F, Alonso and Luis Imaz. IEEE PES 2007 Tampa FL

<sup>36</sup> energyBiz August 2007





### ***9.1.2. Spain's wind park connection standards***

Spain has recognized the potential problem of large amounts of wind integration in regard to stability conditions under system faults.

In accordance with Spain's technical standards for interconnection, it was mandatory to install three instantaneous minimum voltage relays between the phases in the connection of the wind park. The relays must provide for instantaneous disconnection of the park when voltage drops below 85% of the average value between the phases. Studies were carried out to show the importance of a minimum voltage protection system and system stability. The original studies showed that there was little problem with a short circuit when a small amount of wind production was on-line. But if a short circuit occurred on a day with high wind production, obviously the amount of power being disconnected would result in a serious loss of generation, which would greatly increase the risk to grid integrity.

Looking at this threat to grid integrity, REE undertook a transient stability study of the response of wind energy to fault-caused voltage dips in order to determine the maximum wind production of the Iberian Power System in peak and off peak conditions. The result of the study defined the voltage ride-through requirements and the permissible active and reactive consumption values during voltage dip situations.

### ***9.1.3. Dispatchability of the wind parks in Spain***

Because of the large integration of wind, REE determined that two important operational issues needed to be addressed to guarantee the integrity of the grid. The issues are as follows:

- The current condition and Real-Time data of the wind facilities
- How to coordinate the dispatch of wind generation to match system conditions

REE established a Wind Generation Control Center (WGCC) that was integrated with their Control Center. The WGCC is a dedicated desk that is available 24 hours a day, 7 days a week and is responsible for collecting and providing the Real-Time data on the wind facilities to the Control Center, and in turn, providing the dispatch instruction from the Control Center to the wind parks.

## **9.2. Germany**

Germany currently has more than 20 GW<sup>37</sup> of installed wind generation capacity and they expect to have 36 GW installed by 2015<sup>38</sup>. The majority of the wind generation facilities are in northern Germany, although some wind facilities are spread throughout the country. The four German transmission system operators (TSO) must take all the energy produced by the wind generators, and they all share the balancing error in accordance to their market share.

<sup>37</sup> CEC PIER Project Report, April 2007, "Review of International Experience Integrating Variable Renewable Energy Generation", page 1

<sup>38</sup> "Integrating Wind Energy into Public Power Supply Systems – Germany State of the Art" by Reinhard Mackensen, Bernhard Lange, Florian Schlogl; Institut für Solare Energieversorgungstechnik e.V.





Therefore, the TSO with the largest amount of wind generation capacity does not have to do all the rebalancing of the system based on the wind generation variability in its area.

Wind power forecasts are essential to their operation. They forecast wind energy production 72 hours in advance for setting up their energy schedules, and then use short-term forecasts up to 8 hours in advance of Real-Time operating decisions. The TSOs communicate the data from the wind generation facilities every 15 minutes and update the 72 hour wind generation forecast twice a day. They do not receive data from all the wind farms, so they use modeling and scaling methods to fill in the missing data.


Germany does not use “Net Metering” as is used in the U.S. for wind generation that is installed on the grid. This means they separately meter the energy production from wind generation, and they pay a premium for renewable energy that fits the load profile. The price differential between what load is charged and what the generation from renewables is paid may be significant. For example, load may be charged \$0.10 per kWh and wind generation paid as much as \$0.40 per kWh if the wind energy production coincides with the peak load period. The German Renewable Energies Act grants a fixed feed-in tariff for each kWh produced by Renewable Energy Sources<sup>(4)</sup>.

### 9.3. Ireland

As of June 2005, ESB National Grid for Ireland had 383 MW of wind generation connected to the grid and 575 MW of additional wind generation planned. Ireland is an island system, and they cannot lean on a large interconnected grid to help them with the integration of large amounts of wind generation. To ensure they can continue to operate the grid reliably, they have performed in-depth studies on the impact of large amounts of wind generation on their system. In July 2004, they published their interconnection standard document WFPS1 (Wind Farm Power Station Grid Code Provisions). This document describes their Low Voltage Ride Through, voltage control and frequency response requirements. They are particularly concerned with frequency issues and how to limit ramp changes from wind parks. They also recognize that wind generation is an intermittent resource and cannot be counted on to meet peak load demands. They have concluded that they need an additional 85 MW of fossil fueled generation (operating reserves) for every 100 MW of wind generation to ensure they have sufficient generation to meet their load. Ireland represents one extreme in the issues associated with integration of large amounts of wind generation on the grid.

### 9.4. Denmark

Denmark currently has more than 2,000 MW of installed wind generation capacity. Its goal is to increase the amount of wind generation to 5,500 MW, which is equivalent to 50% of the total electric demand for Denmark. Most of the current generation capacity is from small units that are less than one MW each. The units are widely distributed throughout the country, with the largest concentration in western Denmark. Many of the wind generators are connected to the distribution system rather than to the transmission grid. The goal is to replace many of these small turbines with new larger units over the next five years. Denmark can handle the large amount of wind generation because of its transmission ties to Norway, Sweden and Germany. Hydro systems in the Nordel Pool provide much of the regulation required as well as providing





operating reserves to Denmark. The 15 minute variability of the wind generation production is relatively small at approximately 8%, which enables them to forecast and schedule wind energy on an hourly basis. The one lesson learned from Denmark is the value of having strong ties to neighboring areas, especially those with a lot of hydro generation, to mitigate the intermittence of energy production from large amounts of wind generation.

## 9.5. Canada

### 9.5.1. BC Hydro

BC Hydro currently has 11,000 MW of generating capacity of which 90% is from hydro generation. It does not currently have any installed wind generation capacity but British Columbia Transmission Company (BCTC) currently has 700 MW of wind generation in its interconnection queue. The northwestern coastal area of British Columbia has a lot of potential wind generation, but BCTC will have to build some major new transmission to this area before it can be developed. The long-range energy plan for the province is to develop wind generation to meet its load growth and to export significant quantities of the renewable energy to the western area of the U.S., especially California.

### 9.5.2. Ontario's Independent Electricity System Operator (IESO)

IESO currently has 400 MW of installed wind generation capacity. IESO commissioned a wind integration study by AWS and GE to assess the impact of 1,300 MW of wind generation on their system. Their study concluded that Ontario has significant wind generation potential and it could provide more energy in the winter than in the summer. Wind generation forecasting is critical for reliable operations as the amount of wind generation capacity increases. IESO also concluded they can handle up to 5,000 MW of wind generation without a serious impact on their operations. This is on a system with 33,100 MW of installed generation capacity, of which 23% is hydro giving them the needed operational flexibility. They also do extensive interconnection analyses for each proposed wind generator to verify the voltage control and transient stability requirements and the potential need for Special Protection Schemes.

### 9.5.3. Manitoba Hydro (Manitoba)

Manitoba is a predominately hydro generation system with more than 5,000 MW of hydro generation capability. As a 95% hydro system, they can use the hydro resources to store wind generation production in off-peak periods and then deliver it at on-peak periods. They currently have less than 100 MW of wind generation, but expect to add 300 MW in the next several years. They calculate their wind integration cost at between \$0.05/kWh and \$0.06/kWh. Their business strategy is to export most of this wind generation to U.S. utilities in the Midwest that need to buy renewable energy to meet their state's RPS goals. Manitoba's strategy clearly shows the value of hydro generation resources for storing and shaping an intermittent resource such as wind generation and delivering it to meet daily peak loads.







#### ***9.5.4. Alberta Electric System Operator (AESO)***


AESO has 443 MW of wind generation out of 13,223 MW of installed generation capacity. Of this total, 81% is gas or coal-fired units, with only 899 MW of hydro generation. They have established a 900 MW ceiling for wind generation at this time, but have applications for 3,800 MW of new wind generation capacity. They have elected to limit the amount of wind generation until they have completed additional studies on the impact of large amounts of wind generation on their system. They are concerned about how their system will be able to meet the large ramps typically associated with large amounts of wind generation. They also have some major transmission planning work to do to move the renewable energy from the generation sites to the load centers.

#### ***9.5.5. Hydro Quebec***


Hydro Quebec's generation resources are 92% hydro (32,000 MW) with wind generation of 322 MW. Obviously, with this much hydro generation, the intermittence of wind generation is not an issue. Hydro Quebec's goal is to have 4,000 MW of wind generation installed by 2015 and then to maintain a 10% wind/hydro generation ratio. They are concerned that their traditional hydro schedules to serve their load will have to change. They are focused on better forecasting tools and improved modeling of the wind generation facilities.

### **9.6. Conclusions**

There are significant lessons that can be learned and strategies that can be adopted based on the experiences of these international transmission operators. The California ISO needs to learn more about Germany's technique for sharing the system balancing requirement between the four TSOs. Spain has made significant progress in forecasting their wind energy production and has implemented strict interconnection rules. Ireland has implemented ramp limits to mitigate the problem with large ramps from wind generation resources. Canadian utilities have the advantage of having significant hydro generation resources that will reduce their integration problems, and some of their tools and strategies should be adopted where feasible.










## Chapter 10 – Conclusions and Recommendations

This report describes many conclusions and recommendations made by the Renewables Workgroup. The key conclusions and recommendations are:

1. It is essential that the new transmission facilities planned for the Tehachapi area be permitted and built on schedule. These transmission upgrades are essential for the interconnection of all new generation planned for this area and for the delivery of the renewable energy to serve customer loads.
2. The amount of regulation resources, fast ramping resources and load following or supplemental energy dispatches will significantly increase due to the additional intermittent resources planned to meet the 20% RPS.
3. Accurate Day-Ahead and Hour-Ahead forecasts of wind and solar generation energy are essential for reliable operation of the power grid and for decisions on procurement of the optimum amount of regulation resources and operating reserves. Linkage of wind and solar generation forecasts with MRTU will provide more accurate Day-Ahead generation schedules which will help to reduce dispatch notices to fossil fueled units for hours when they are not needed. It will also help to reduce over-generation problems due to load and generation schedule mismatches.
4. Deployment of additional storage facilities would significantly enhance the integration of renewables. New storage technology can provide some of the fast ramping and additional regulation resources that will be required. They can also provide reactive power for voltage support and, depending on their location, they can mitigate transmission congestion and line overloads. Large storage facilities can absorb off-peak energy production from wind generation resources and deliver the energy during peak load hours. Storage facilities have the added advantage of being “green” resources as they do not directly contribute any greenhouse gases.
5. The California ISO must continue to monitor other studies and reported experiences on integration of renewables. While each area has some unique characteristics due to their geographic, topological, and metrological circumstances, the California ISO can also learn from the experiences of these other areas. Also, the European countries have installed substantially more wind generation resources than all of the United States and the experiences gained by these countries can greatly benefit the California ISO.

The California ISO is committed to the successful and reliable integration of renewable resources. The integration of renewables is being escalated to a formal project status in 2008 and a new Project Manager will be selected to lead this effort. One of the first tasks for the new project team will be to prioritize what work has to be done and to identify the resources required and create a detailed project schedule. An additional key question is the need for a study of the impact of a 33% RPS.





The Renewables Workgroup has identified the following list of tasks and questions that it recommends be addressed to meet the 20% RPS.

### **Task 1. Develop New Ramp Forecast and Planning Tool for Real-Time Operations**

The output from wind and solar generation can change dramatically, both up or down, in a very short period of time. These rapid changes pose a significant challenge to system reliability and to the grid operator who must meet NERC and WECC Reliability Performance Standards. Better forecast and planning mechanisms, especially on a micro-climate basis, will enable the California ISO to mitigate the operational problems that otherwise arise from rapid swings in generation or load, both up and down. The purpose of this task is to use that information and the answers to the questions below to develop a new ramp forecast and ramp planning tool for Real-Time operations. The goal is to have a prototype of the tool ready in 2008 for testing and evaluation. The production version of the tool must be ready in 2009 to coincide with the expansion of wind and solar generation installed on the system.

Key questions are:

1. How can ramps be accurately forecast? What are the best forecast sources and what meteorological data is required? Does Weather Bank provide sufficient forecast information with sufficient geographical granularity, or does the California ISO need additional data and another forecast service?
2. Does the California ISO need to have a person "on shift" to assess weather patterns and forecast ramps due to intermittent renewable resources?
3. Does the California ISO need a Doppler radar system in major wind-generation areas (e.g., Tehachapi) to see approaching weather fronts? Would Sound Detection and Ranging (SODAR) be more cost effective? What has been the experience of others in detecting major weather fronts?
4. Who needs the ramp data? Real Time operations? SCs? Wind generator operators? Others?
5. How far in advance does the California ISO need to forecast ramps? A few hours? Day-Ahead?
6. How should the ramp information be made available to Real-Time operations? What is the impact on EMS? Plant Information (PI) Displays? Other?
7. What are the specifications for a Ramp Planning Tool to assist the operators in anticipating the dispatch notices that will be required to either start quick-start units or to shut down units?





### ***Task 1.1. Ramp Mitigation Strategies***

What are the optimum strategies for mitigating large ramps? Not all ramps are bad. A ramp up of solar energy in the morning period when the wind generation energy is ramping down could result in a net ramp that is very manageable. Ramp ups of energy production during the morning “load pull” could be very helpful. Therefore, an important consideration is to determine during which periods of the year and which hours of the day action needs to be taken to mitigate a large ramp up or large ramp down.

Key questions are:

1. What are the criteria for initiating ramp mitigation actions?
2. Some balancing authority ask wind generators to limit their “ramp up” production to a specific number of megawatts/minute. Is this a practical strategy? Could that strategy also be applied in the downward direction by advance curtailment of wind generation in anticipation of the decreasing wind so that a sudden downward ramp could be avoided? How would the California ISO decide what is the ramp limit? How would this information be sent to the wind generator operators? How would the ramp limits be allocated between all the different wind farms?
3. Is there a transmission limitation criterion that should also be considered such that the California ISO would have a different limitation for various areas of the system (e.g., SP 15 versus NP 15, areas west of Devers, south of Tehachapi, etc.) and what would be the justification for this difference?
4. Are there other strategies that could be used to mitigate the impact of ramps? Use of hydro resources, pump storage or other types of storage to rapidly ramp up or down for smoothing the ACE? Should the California ISO pursue the use of mid-hour intertie schedule changes? Should these be translated into one or more market products?
5. What will the dispatch notices look like for the other generators if the California ISO does not have a ramp mitigation strategy and what is their expected response?

### **Task 2. Over-Generation Problems**

This Report describes the over-generation problem in some detail. Wind generation areas such as the Tehachapi characteristically produce maximum energy at night when loads are low. In the spring, when California has maximum hydro generation conditions due to snow melt in the Sierra, the wind generation production is often at its maximum. At times, this results in over-generation condition even with the limited amount of wind generation currently installed in the area. As the amount of installed wind generation capacity rapidly increases in the next several years, the over-generation problem will grow. The purpose of this task is to review the existing procedure for handling over-generation conditions and determine if it needs to be modified to implement pro-rata cuts for wind generation production.





Key questions are:

1. Does procurement of additional regulation solve the problem?
2. Are accurate  $P_{\min}$  numbers available for all generation resources?
3. How many megawatts of "Must Take" generation are on the system?
4. If the California ISO sends dispatch notices to wind generators to curtail some production, what is the time lag that should be expected between the sending of the notices and the reduction of wind generation production?
5. Are there operators at the wind plants on a 24/7 basis to respond to the dispatch notices?
6. Is the estimated amount of wind generation curtailment (800 MW for less than 100 hours per year) accurate, and what are the consequences for doing these pro-rata cuts?
7. How much of the problem is solved by MRTU?

### **Task 3. Improve Accuracy of Day-Ahead Energy Forecasts for Wind Generators**

The California ISO needs accurate Day-Ahead forecasts on the amount of wind generation energy production that can be expected for each hour of the next day. This information is an essential component in the decisions about the procurement of resources to meet demand as well as decisions about operating reserves and regulation resources and the dispatch notices for generator start-up. Previous studies (NYISO) have shown that savings of \$100 million a year are possible by having a reasonably accurate Day-Ahead forecast of wind generation energy production. The purpose of this task is to procure a wind generation forecast service that can provide the most accurate forecasts possible for use in the MRTU Day-Ahead Market.

#### ***Task 3.1. Assess the accuracy of current Day-Ahead forecasting technology.***

Review the accuracy of the Day-Ahead forecasts supplied by AWS Truewind for each of the wind generation areas. Review the accuracy of Day-Ahead forecasts for other balancing authorities such as ERCOT in Texas, NYISO and BPA. Review the accuracy and adequacy of the metrological data for each of the wind parks. Assess whether the forecast data or the forecast models or both are the source for any inaccuracies in the Day-Ahead wind energy forecast for each wind park.

#### ***Task 3.2. Research new Day-Ahead forecasting tools.***

Review the CEC-sponsored research on forecasting tools that was published in June 2006. The research team included EPRI, AWS Truewind and UC Davis. They explored the accuracy of different types of wind generation forecast models. The preliminary conclusion was that





the research team had made a significant breakthrough in improving the accuracy of both 5-7 Hour-Ahead forecasts and Day-Ahead forecasts. Additional work is needed to validate the results with a prototype-forecast tool. The results from this task are to produce a set of recommendations for the scope of work for any additional research that is needed so they can create a final specification for a commercial grade Day-Ahead forecasting tool.

### ***Task 3.3. Move forward with the acquisition of a Day-Ahead forecasting service.***


Develop a Request for Proposal for a Day-Ahead wind generation forecasting service. The forecast should include total energy production from all wind generation facilities and the forecast energy production from wind generation areas. The ideal forecast would also have a breakdown by generators in the PIRP program. If the decision is to use two or more forecast services, then the recommendation must include the expected benefit of using more than one supplier and how the multiple forecasts should be combined into a final forecast for the MRTU Day-Ahead Market.

## **Task 4. Improve Accuracy of Same Day Energy Forecasts for Wind Generators**

MRTU will require the PIRP generators to enter their forecast energy in the Hour-Ahead Scheduling Process (HASP). The current PIRP wind generation scheduling process requires a wind generation forecast nearly 3 hours in advance of the Real-Time operating hour. Under the MRTU HASP program, the time frame is shortened to 75 minutes before the start of the Real-Time operating hour. This much shorter lead time means that an advanced persistence forecast program may be as accurate, if not more accurate, than other more sophisticated forecast models such as neural network programs. The purpose of this task is to explore all options for improving the same-day hourly forecasts for both PIRP and non-PIRP wind generators and to consider whether the PIRP program should be changed under MRTU. If the program is to be changed, this will probably require a tariff filing.

Key questions are:

1. If a persistence model is the best option for 75 minute forecasts/schedules, should the wind generators do their own forecast? Does the California ISO need a commercial forecasting service going forward or could it do the forecasts internally?
2. How much in advance of the HASP scheduling point can the SCs for the wind generators forecast energy production so they can sell the uncommitted energy? Is this an issue?
3. The California ISO needs a 5-hour forecast, which is used to make market and reliability decisions on dispatch instructions to quick start units. Obviously, if the energy from wind generators will be below the original Day-Ahead forecast and energy schedule, the California ISO will need additional energy in the operating hour. If there are insufficient reserves and supplemental energy available to fill in the deficiency, then the California ISO must call upon quick start units to start up and provide the needed energy. If there







is an excess of energy forecast, there is still time for SCs to find buyers for the excess energy and set up the exports for the Real-Time operating hour. The California ISO will also have sufficient time to look ahead and plan alternate strategies for the Real-Time operating hour. Does this argue for retention of a commercial forecast service as persistence forecasts cannot provide an accurate 5 hour forecast?

4. Should the California ISO use the same forecast tools for this 5-Hour-Ahead forecast that it uses for the Day-Ahead forecast or is a different tool needed?
5. What are the operational and maintenance related concerns for maintaining two forecast tools? Does the California ISO maintain two separate forecast tools, and if so, when should it switch from one to the other?

### **Task 5. Develop New Graphical Displays for Real-Time Operators**

PI displays can tell the operators what wind generation energy production is at that moment but they do not include the forecast of what wind will do in the next new minutes or hours. With forecasts for five or more wind park areas, there is both local data and aggregate data. The aggregate data and ramp forecast data impact the generation dispatcher the most. The transmission dispatcher is more affected by the local generation and the amount of energy that will flow on the transmission networks. The CEC has offered to fund some research work on this question, so this task may involve developing a detailed scope of work to secure the funding. They may identify some experts/consultants who could help the California ISO research and prototype the best man/machine interface for display of this information for the operators. The purpose of this task is to develop prototype displays for Real-Time operations that show actual energy production and forecast energy production of wind generation.

Key questions are:

1. How far in advance does the forecast energy production need to be for the operators? Minutes? 15 minutes? 1 hour? 2 hours? 5 hours?
2. How should the wind generation forecast production information be supplied to the Real-Time operating personnel?
3. Does the California ISO need graphical displays and if so, how should these displays look?
4. Is it important to see weather data for these areas as well as the actual energy production and forecast production?
5. What decisions are affected by knowing the forecast energy production?

### **Task 6. Link Renewables Forecast with MRTU**

Once the Day-Ahead and same day forecast tools have been validated, the next question is how to link this information with MRTU. The forecast wind generation will be a key ingredient





for the RUC process. The purpose of this task is to document what the information flow process should be and to test how it will be used in the RUC process.

**Key questions are:**

1. How should the forecast information be provided and who will use it?
2. Will the forecast information be used by the SCs for Day-Ahead schedules?
3. Which MRTU systems will be affected if any?
4. What is the flow of information, what decisions will result and how will the information be used in settlements?
5. What reports will need to be generated?

## **Task 7. Scheduling/Managing Imports and Exports of Renewables**

California may not have enough locations for new wind generation and other renewable resources within the state for the IOUs to meet their RPS obligation. The IOUs are considering imports of wind generation from Oregon, Nevada and other western states. The purpose of this task is to establish the rules and procedures for facilitating these imports.

**Key questions are:**

1. Should imports of intermittent resources be dynamically scheduled?
2. Who will have the obligation for shaping and firming?
3. Are there limitations on how much intermittent energy can be accepted? Is the amount of regulation in southern California one of these limitations?
4. Is there anything special the California ISO should do for scheduling and tagging imports and exports of renewables?
5. Should the tolerance band be changed for dynamic schedules?
6. Should the California ISO request the sending balancing authority to share some of the regulation burden?
7. Should the SC that is buying the non-shaped energy be charged for the additional regulation burden? If so, how will the associated cost be determined?

During periods when the California ISO has over-generation conditions, it is definitely interested in exporting some of this excess energy. Whatever rules and procedures it imposes for imports will probably apply for exports, so it needs to make sure there are no unfair burdens on imports and exports.





### **Task 8. Impact on Resource Adequacy**

Develop new models and scenarios to determine the “best fit” generation portfolio for integration of large amounts of renewables. How many MW of short start units will be required? What additional generation and storage facilities will be needed? How can this information be shaped to help guide the CPUC RA requirements?

### **Task 9. Modeling of Wind Generation Facilities**

The current power flow and transient stability models stop at the point of interconnection of the wind farm. The actual performance of the wind generators and the sub-transmission collector systems is ignored. Other countries, such as Ireland, have found it essential to include actual models of the wind generators in their power system studies. The California ISO requested the CEC fund a new R&D study that improves the modeling of these facilities. This project has been approved and the kickoff meeting was held in August 2007. The purpose of this task is to recognize the commitment of California ISO resources to the technical and project advisory groups for this R&D project. The results will be new models that can be used in the transmission planning tools such as transient stability programs.

### **Task 10. Changes to PIRP II for Hour-Ahead Forecast and Scheduling**

Add solar generation resources to PIRP. Develop new forecast models for concentrated solar resources so they can be included in the PIRP program.





## Glossary of Acronyms

ACE	-	Area Control Error
ADS	-	Automatic Dispatch Signal
AGC	-	Automatic Generation Control
ALFS	-	Automated Load Forecasting System
AVR	-	Automatic Voltage Regulator
BPA	-	Bonneville Power Administration
CAISO	-	California Independent System Operator
CEC	-	California Energy Commission
CPUC	-	California Public Utilities Commission
DAM	-	Day-Ahead Market
DFIG	-	Doubly Fed Induction Generator
DOE	-	Department of Energy
DOP	-	Dispatch Operating Point
DPG	-	Data Processing Gateway
EMS	-	Energy Management System
EPRI	-	Electric Power Research Institute
FERC	-	Federal Energy Regulatory Commission
HASP	-	Hour-Ahead Scheduling Process
HVDC	-	High Voltage Direct Current
IAP	-	Intermittency Analysis Project
IFM	-	Integrated Forward Market
IOU	-	Investor Owned Utilities
LFE	-	Load Forecast Error





LGIP	-	Large Generator Interconnection Procedures
LSE	-	Load Serving Entity
LVRT	-	Low Voltage Ride Through
MRTU	-	Market Redesign and Technology Upgrade
MVWG	-	Modeling and Validation Workgroup
NERC	-	North American Electric Reliability Corporation
PDCI	-	Pacific Direct Current Intertie
PG&E	-	Pacific Gas and Electric Company
PIR	-	Participating Intermittent Resource
PIRP	-	Participating Intermittent Resources Program
PNNL	-	Pacific Northwest National Lab
RMR	-	Reliability Must-Run
RPS	-	Renewables Portfolio Standard
RTED	-	Real-Time Economic Dispatch
RTM	-	Real Time Market
RTUC	-	Real-Time Unit Commitment
RUC	-	Residual Unit Commitment
SCE	-	Southern California Edison
SCUC	-	Security Constraint Unit Commitment
SDG&E	-	San Diego Gas and Electric Company
STUC	-	Short-Term Unit Commitment
SVC	-	Static Voltage Compensation
VRB	-	Vanadium Redox Battery
VSTLP	-	Very Short Term Load Predictor
WECC	-	Western Electricity Coordinating Council
WGMG	-	Wind Generator Modeling Group
WTG	-	Wind Turbine Generator





## Appendices

- Appendix A – Study Results
- Appendix B – Study Methodology
- Appendix C – Load Forecasting Error Analysis
- Appendix D – Wind Generation Forecast for the 20% RPS
- Appendix E – Wind Forecast Error
- Appendix F – Wind Generation Turbine Modeling
- Appendix G – Tehachapi Transmission Plan
- Appendix H – Transient Stability Plots

## References

1. CPUC Report, November 1, 2005 “Achieving a 33% Renewable Energy”, by The Center for Resource Solutions Team.
2. CEC PIER August 15, 2006 workshop on Intermittency Analysis Project: 2010 (1\_YEN-NAKAFUJI\_PORTER\_2006-08-15.pdf).
3. “Impact of Past, Present and Future Wind Turbine Technologies on Transmission System Operation and Performance” CEC PIER Project Report; May 2006 CEC-500-2006-050.














## Appendix A – Study Result

### Spring: Load Following Capacity, Ramp Rate and Ramp Duration






The green arrow represents 2006. The red arrow shows the expected 20% RPS increase due to wind only. The tail of the arrows corresponds to no wind.

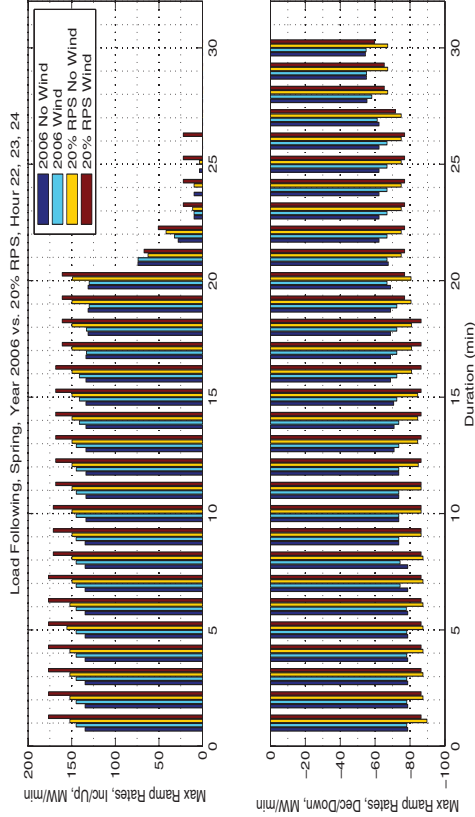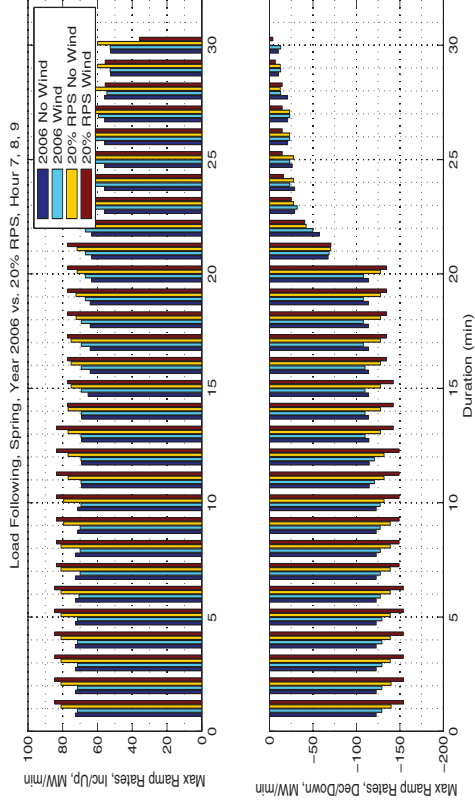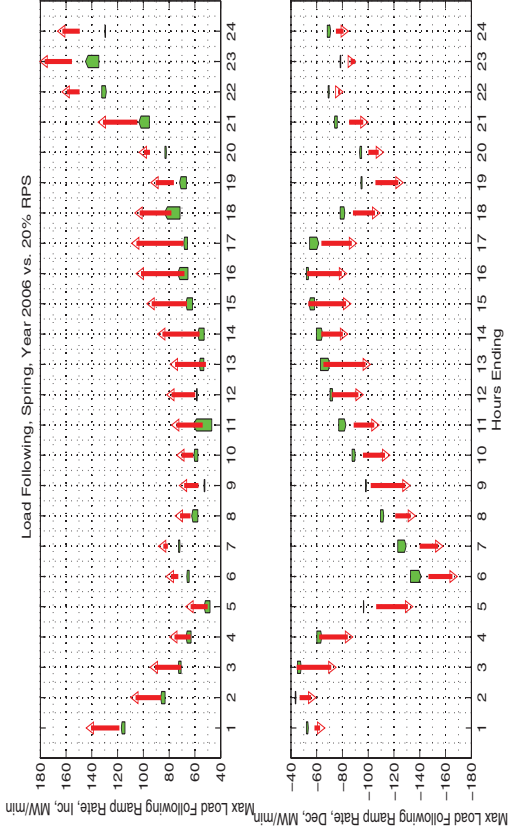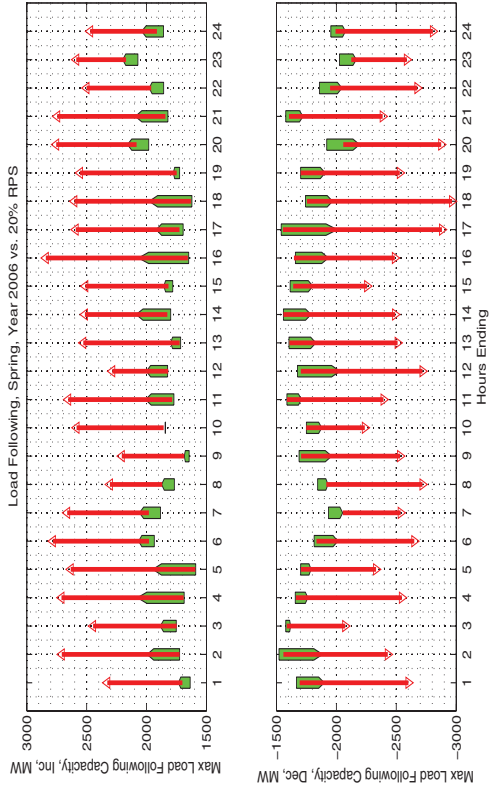



### Spring: Regulation Capacity, Ramp Rate and Ramp Duration





The green arrow represents 2006. The red arrow shows the expected 20% RPS increase due to wind only. The tail of the arrows corresponds to no wind.

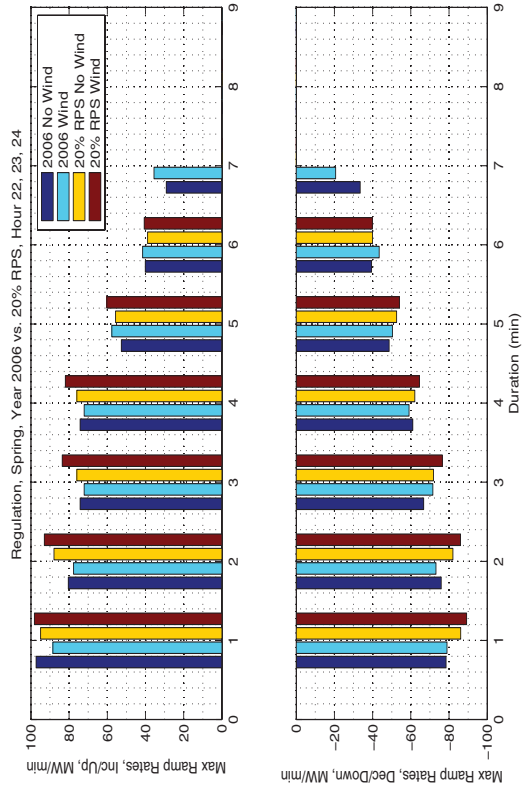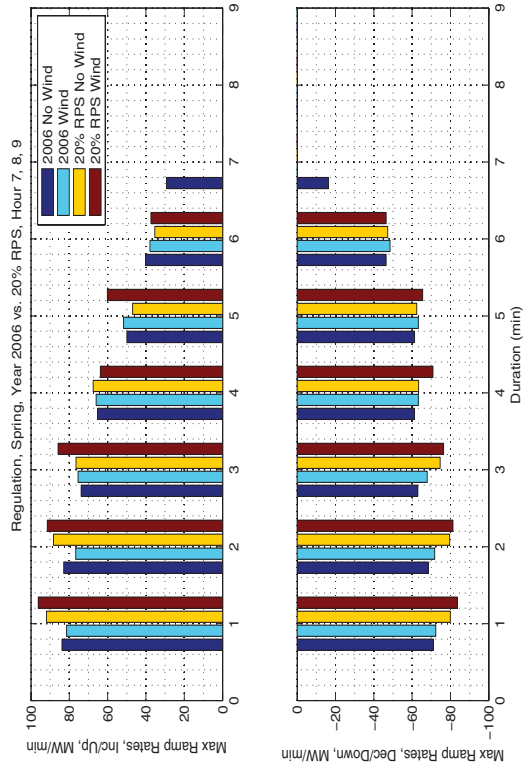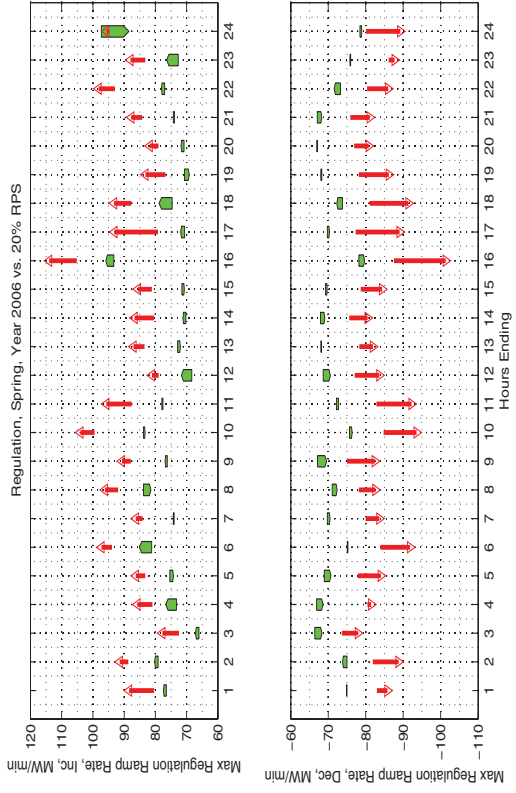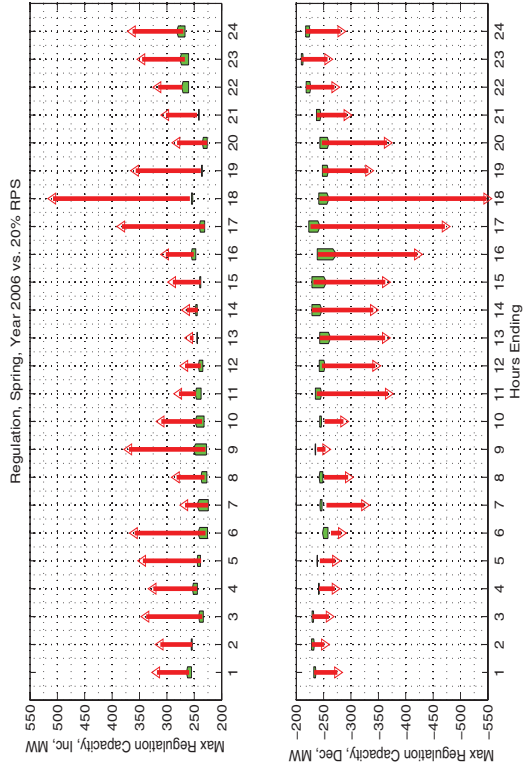



### Summer: Load Following Capacity, Ramp Rate and Ramp Duration





The green arrow represents 2006. The red arrow shows the expected 20% RPS increase due to wind only. The tail of the arrows corresponds to no wind.

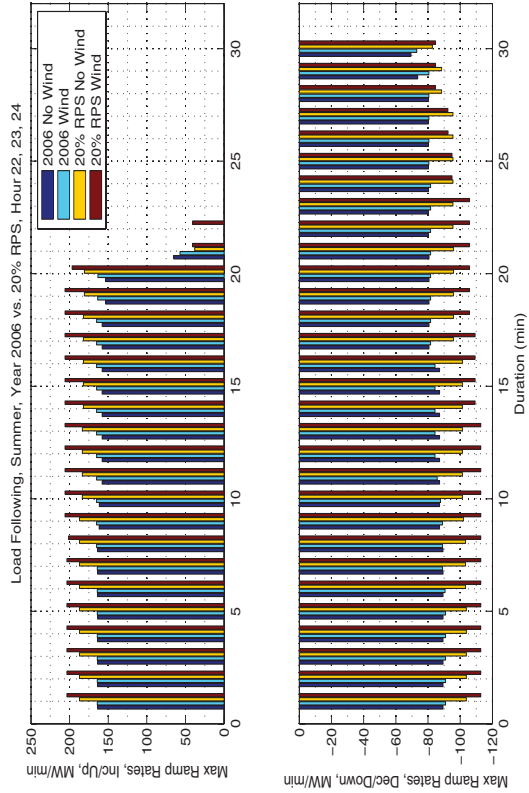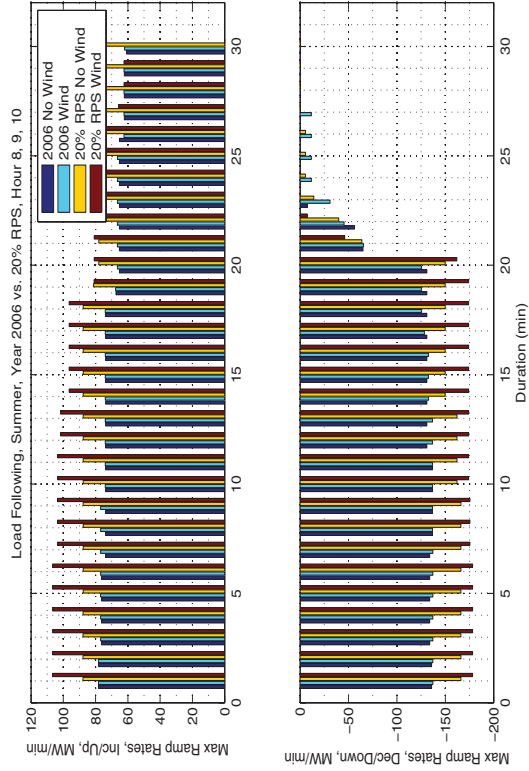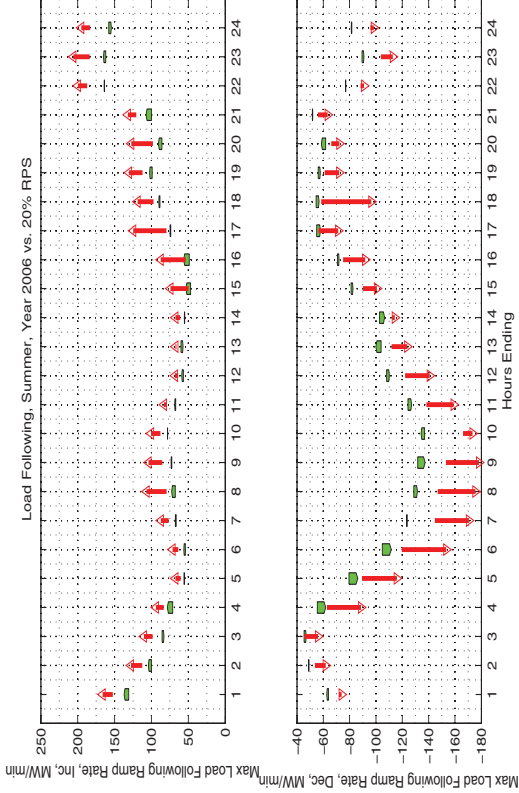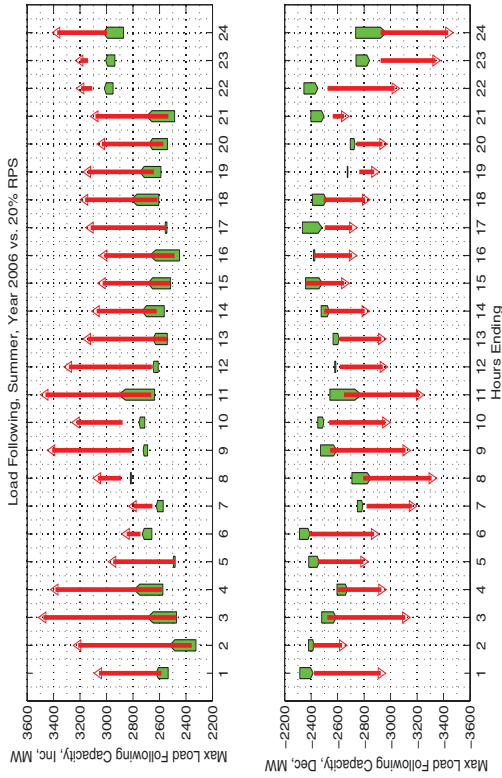



### Summer: Regulation Capacity, Ramp Rate and Ramp Duration






The green arrow represents 2006. The red arrow shows the expected 20% RPS increase due to wind only. The tail of the arrows corresponds to no wind.

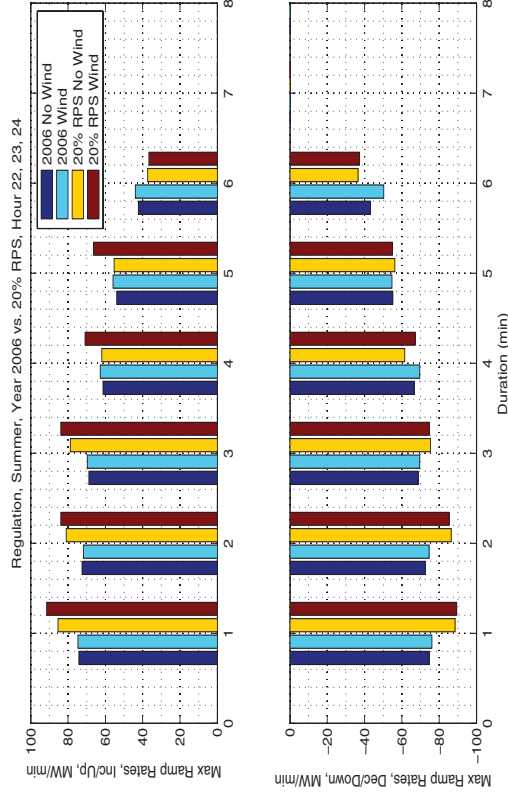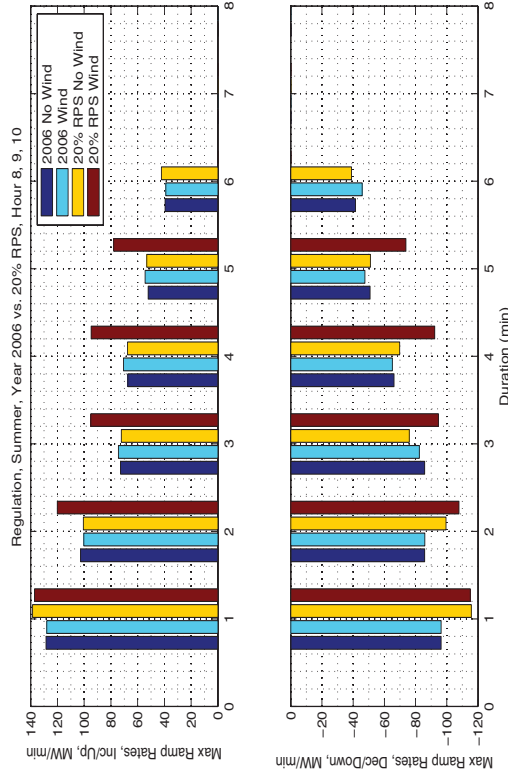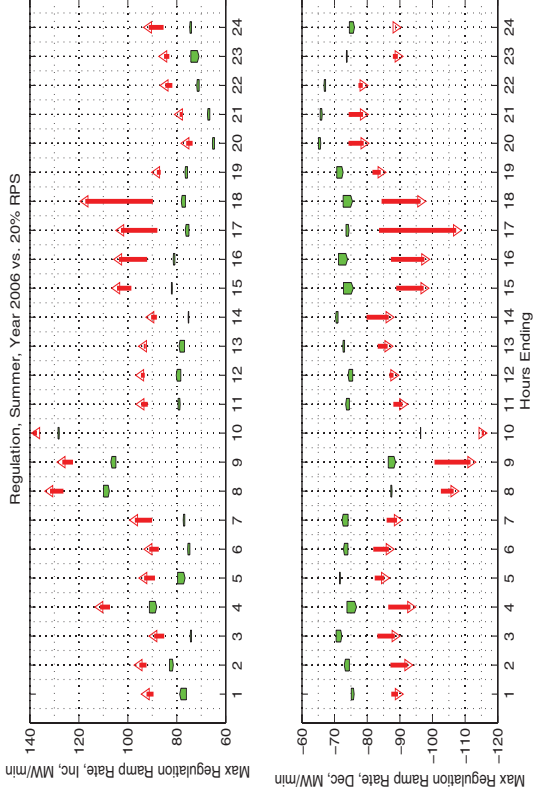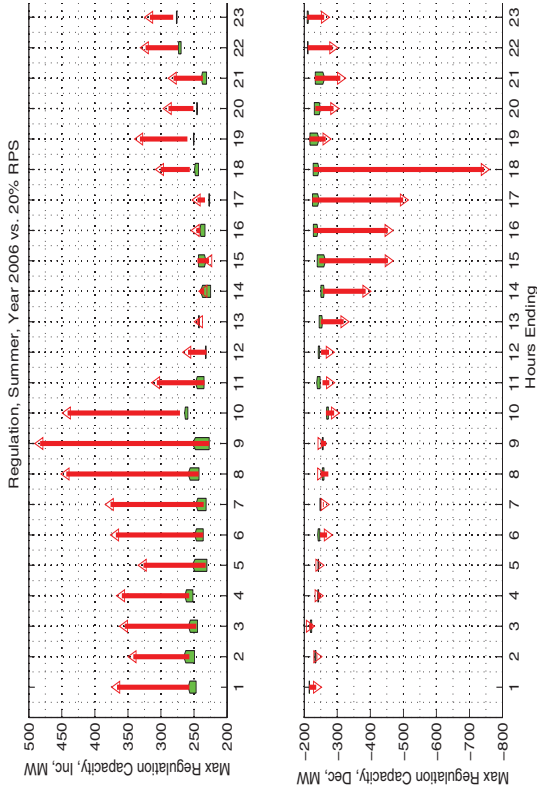



### Fall: Load Following Capacity, Ramp Rate and Ramp Duration

The green arrow represents 2006. The red arrow shows the expected 20% RPS increase due to wind only. The tail of the arrows corresponds to no wind.


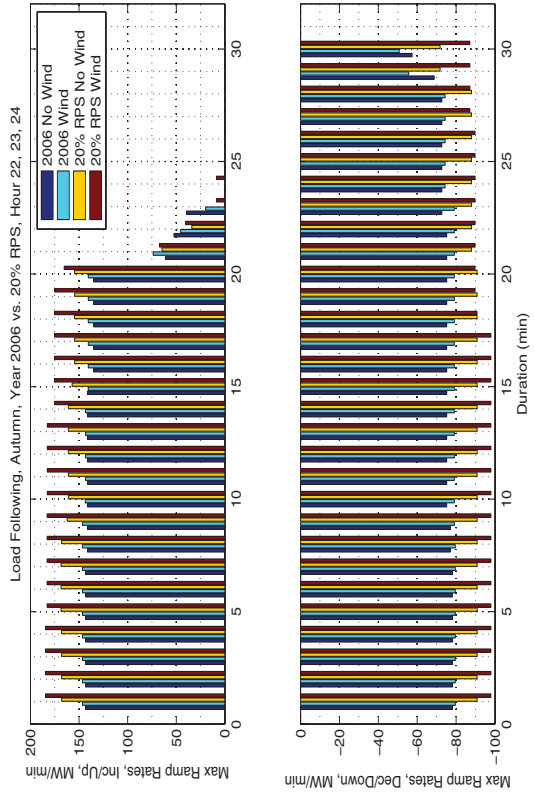
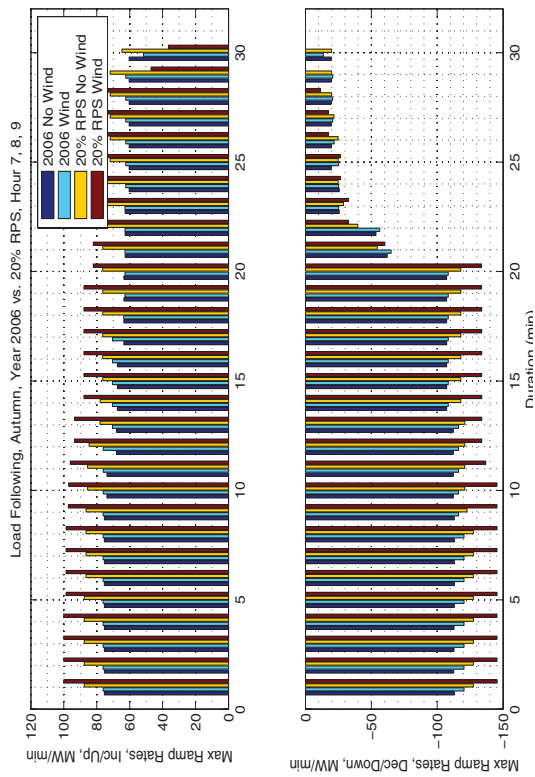
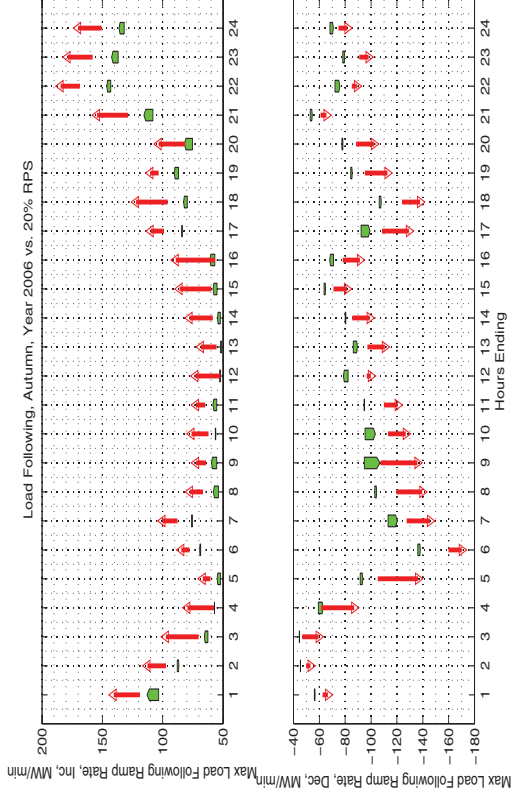
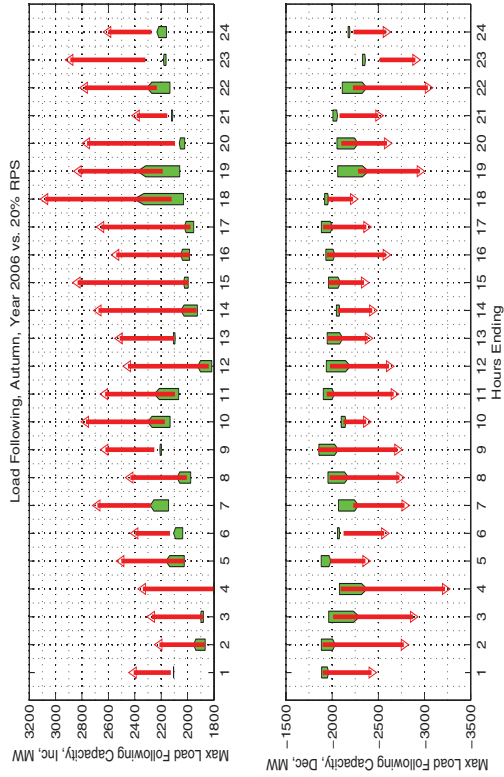






### Fall: Regulation Capacity, Ramp Rate and Ramp Duration

The green arrow represents 2006. The red arrow shows the expected 20% RPS increase due to wind only. The tail of the arrows corresponds to no wind.


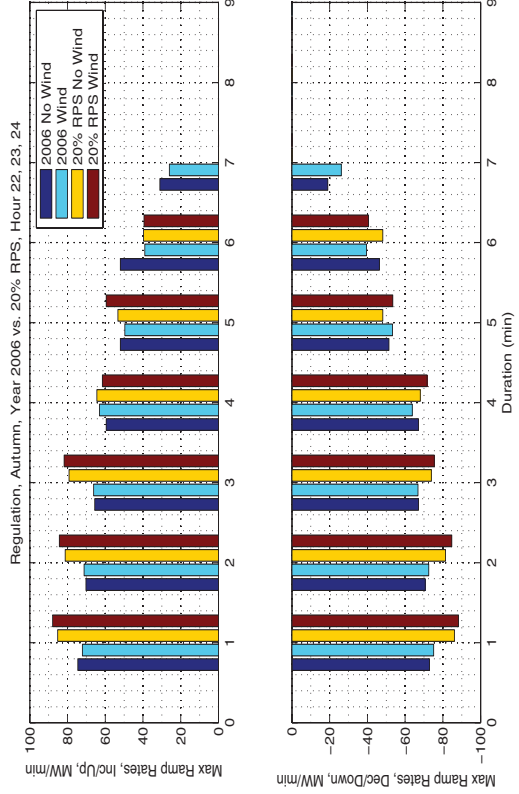
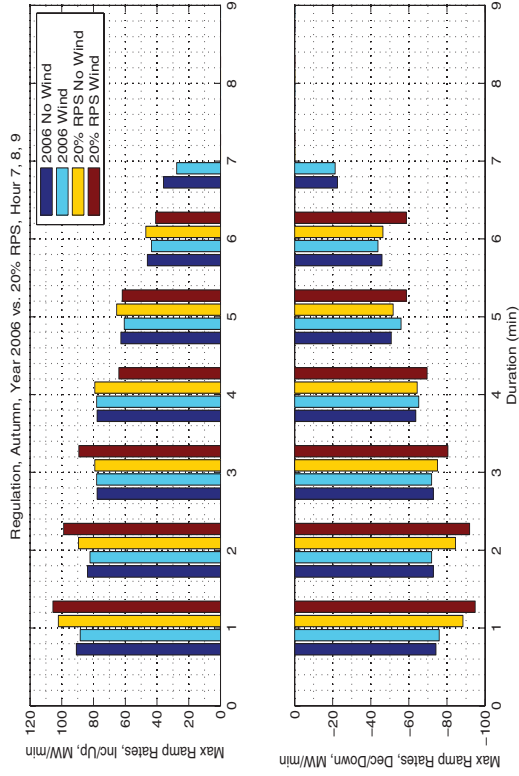
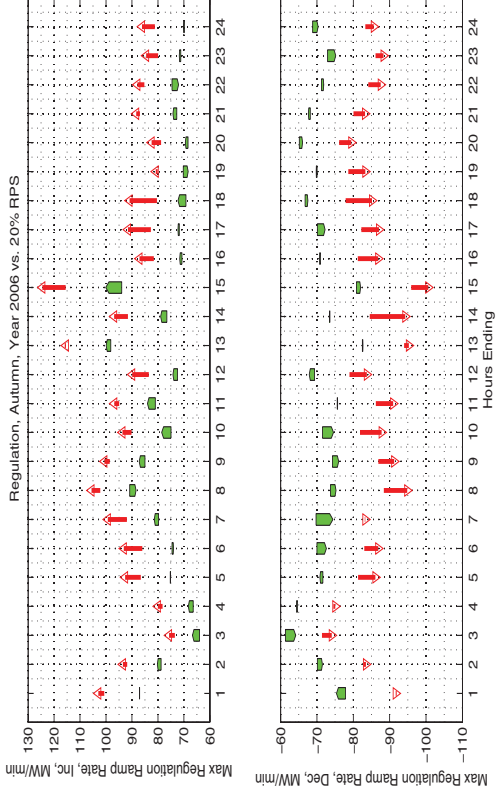
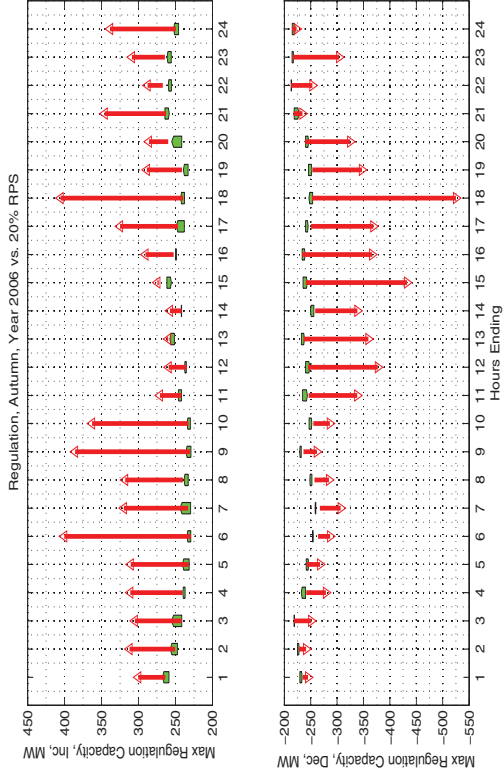






### Winter: Load Following Capacity, Ramp Rate and Ramp Duration






The green arrow represents 2006. The red arrow shows the expected 20% RPS increase due to wind only. The tail of the arrows corresponds to no wind.

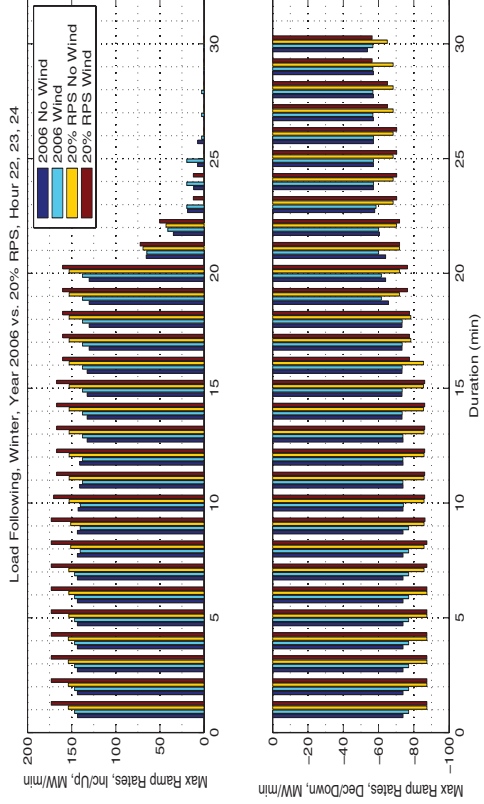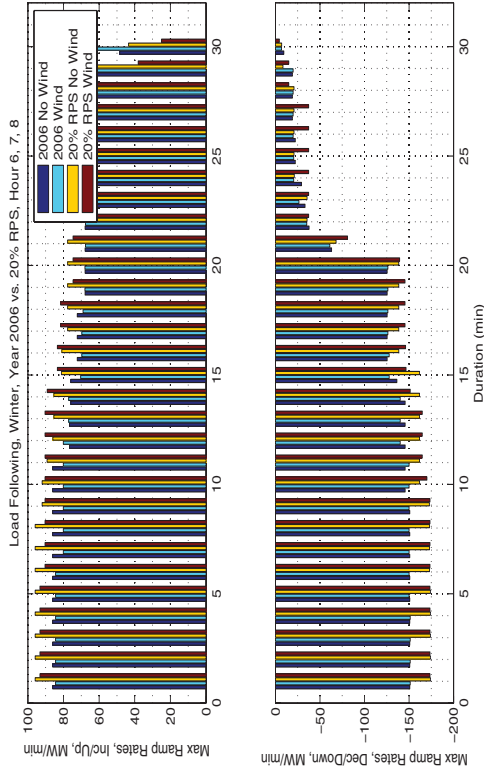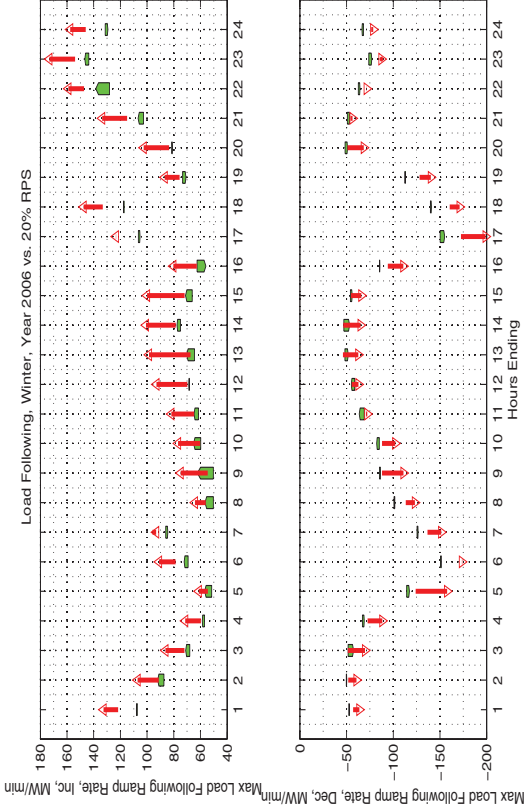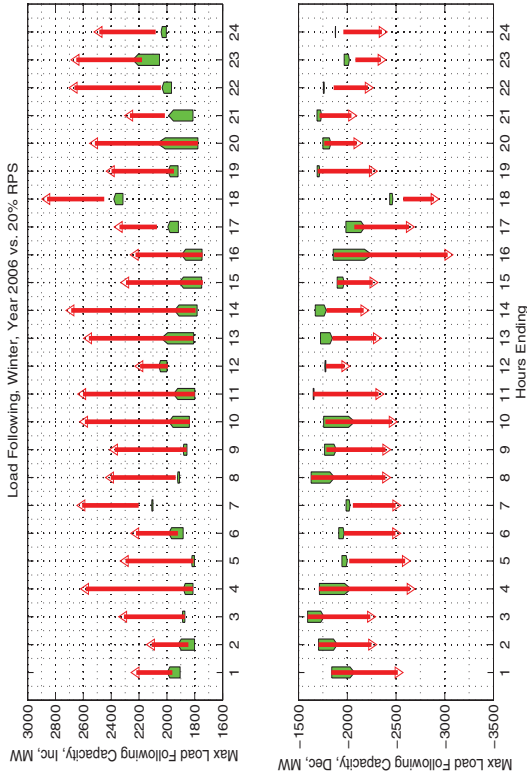



## Winter: Regulation Capacity, Ramp Rate and Ramp Duration

The green arrow represents 2006. The red arrow shows the expected 20% RPS increase due to wind only. The tail of the arrows corresponds to no wind.

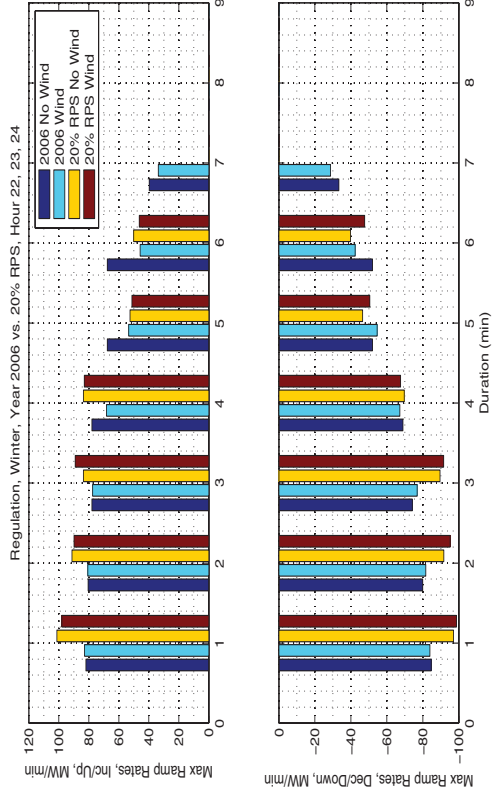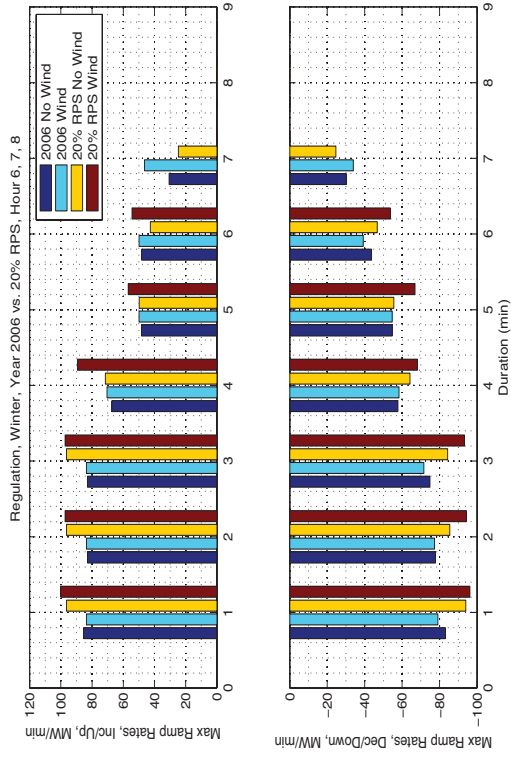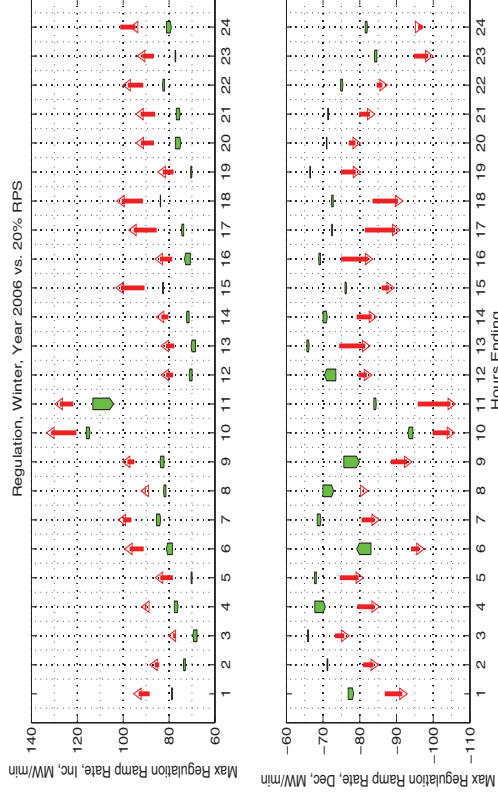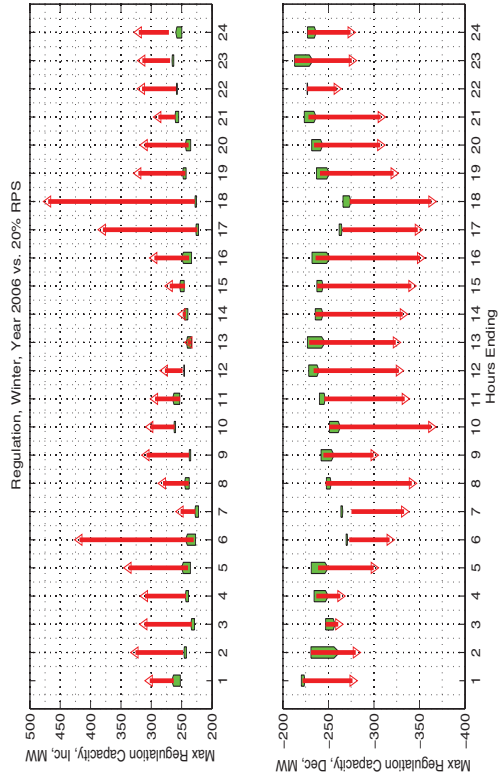




## Appendix B — Study Methodology

### Methodology to Evaluate the Impacts of Wind Generation on California ISO's Regulation and Load Following Requirements Under MRTU

Clyde Loutan (California ISO Project Lead), Phillip de Mello (California ISO/University of California, Davis), Yuri Makarov (Principal Consultant, Battelle), Jian Ma (Battelle/University of Queensland), Shuai Lu, (Battelle)

#### 1. Assumptions

- 1.1. The impact of wind generation on the interconnection frequency is neglected.
- 1.2. Within the studied future periods, the hour-ahead hourly energy forecasts for all wind generation regions will be available at the California ISO.
- 1.3. The hour-ahead load and wind generation energy forecasts are provided at the latest 120 minutes before the actual beginning of an operating hour.
- 1.4. The real-time 5-minute load forecasts are provided 7.5 minutes before the actual beginning of a 5-minute dispatch interval (or 10 minutes before the middle point of this interval).
- 1.5. The load forecast errors are unbiased (i.e., they have a negligible average).
- 1.6. The load and wind forecast errors are random variables distributed according to the truncated normal distribution with certain autocorrelation between the subsequent forecast errors.
- 1.7. The MW load forecast error after the 20% RPS build out will have the same distribution as it had in 2006.
- 1.8. Within the studied future periods, the real-time wind generation forecasts (7.5 minutes before a 5-minute dispatch interval) will not be incorporated into the California ISO MRTU Real-Time Unit Commitment/Real-Time Dispatch systems.
- 1.9. Wind generation forecasts are not biased over a season.
- 1.10. Wind generation schedules are based solely on the corresponding hour-ahead wind generation forecasts that are assumed to be available for the California ISO/IOU scheduling process.
- 1.11. Pump storage is not considered as a part of the actual load and the load forecast. It is considered as a scheduled resource. The impact of small pumps that are not scheduled and are included into the actual load is neglected.





## 2. California ISO Scheduling and Real-Time Basics and Timelines

### 2.1. Generators' Schedules

Figure B-1 illustrates how the generators in the California ISO-controlled Grid are scheduled and dispatched.

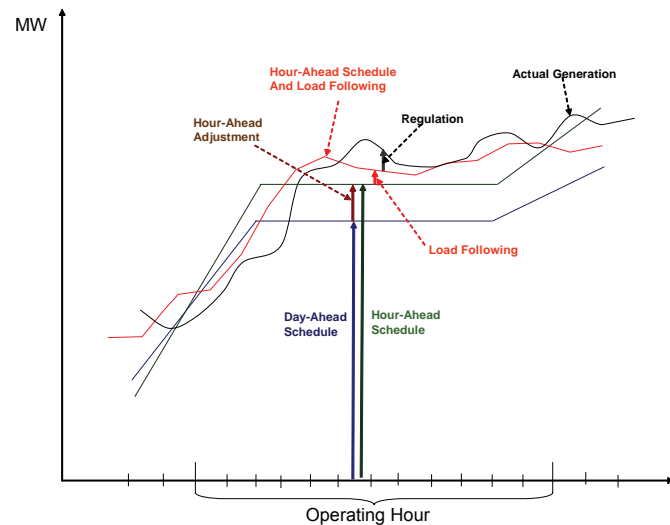


Figure B-1: California ISO-controlled Grid Scheduling Process

Hour-ahead schedules are block energy hourly schedules including the 20-minute ramps between the hours — Figure B-2. They are provided 75 minutes before the actual beginning of an operating hour. The load forecast used for the hour-ahead scheduling process is provided 2 hours before the beginning of an operating hour. The difference between the day-ahead and hour-ahead schedules constitute the required generation adjustment. California ISO facilitates the adjustment bids and the market.

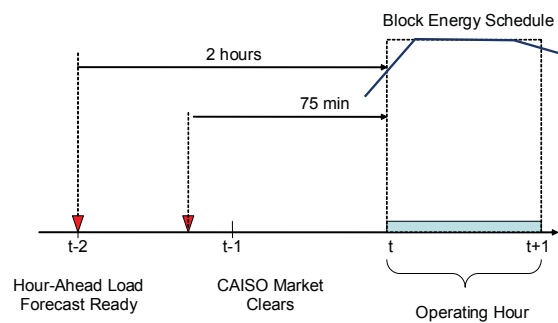


Figure B-2: California ISO Hour-Ahead Timeline





Load Following is an instructed deviation from schedule caused by the real-time (or supplemental) energy dispatch. The desired changes of generation are determined in real-time for each 5-minute dispatch interval 7.5 minutes before the actual beginning of the interval. System information used for that purpose (including real-time forecasts) is dated back approximately 7.5 minutes before the beginning of the interval.

## 2.2. Real-Time Dispatch and Regulation

The Real-Time Dispatch (also referred to as Load Following or Supplemental Energy Dispatch) is automatically conducted by the California ISO's MRTU applications using 15-minute intervals for Real-Time Unit Commitment and 5-minute intervals for Real-Time Economic Dispatch. The timeline for this process is shown in Figure B-3<sup>1</sup>

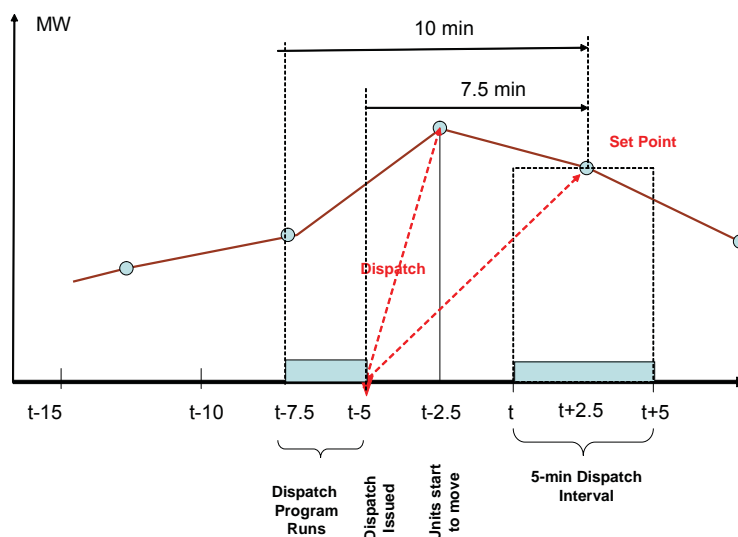



Figure B-3: California ISO Real-Time Dispatch Timeline

The desired changes of generation are determined in real-time for each 5-minute dispatch interval 5 minutes before the actual beginning of the interval. System information used for that purpose is dated back 7.5 minutes before the beginning of the interval. Units start to move toward the new set point 2.5 minutes before the interval begins. They are required to reach the set point in the middle of the interval (2.5 minutes after its beginning). The units may ramp by sequential segments, that is, the ramp is not necessarily constant.

The Very Short-Term Load Predictor (VSTLP) program provides an average load forecast for the interval  $[t, t + 5]$  7.5 minutes before the beginning of the interval or 10 minutes before the middle point of this interval. The VSTLP program uses EMS data to generate the forecast. This program also has an option to use the Automated Load Forecasting System (ALFS) output.

A similar timeline (forecast provided 7.5 minutes before the beginning of a 5-minute interval) can be adopted for the future wind generation forecast.

<sup>1</sup> California ISO MRTU Training Document, Version 10.0.





### 2.3. Load Forecast Model

Refer to Appendix C for the methodology used to analyze load forecast errors.

### 2.4. Wind Generation Forecast Model

The hour-ahead wind generation forecast is assumed to be a part of the future California ISO/IOU scheduling system.<sup>2</sup> Without such a forecast system, the California ISO load following requirements would become very significant after the 20% RPS build out. It is assumed that the wind generation forecast error is distributed according to the Truncated Normal Distribution (TND) law. Based on the assessment conducted by the AWS Truewind Company<sup>3</sup>, the total 2-hours ahead wind energy forecast will have the following characteristics as shown in Table B-1.

Table B-1: Estimated Hour-Ahead Wind Generation Forecast Characteristics

	Average	Min	Max	Standard Deviation	Autocorrelation
Winter	0.00	-0.36	0.31	0.07	0.61
Spring	0.00	-0.43	0.31	0.09	0.71
Summer	0.00	-0.32	0.31	0.08	0.65
Fall	0.00	-0.32	0.40	0.08	0.59

## 3. Simulation of Future Scenarios and Data Set Generation

The study year is approximately 2013 with the full Tehachapi built out vs. the year 2006/2007.

### 3.1. Actual Load

For a future study year 2006 + i, the annual actual load curve can be simulated as the year 2006 load multiplied by the i-th power of the annual load growth factor:

$$L_a^{2006+i} = (1 + \gamma)^i \times L_a^{2006} \quad (3.1)$$


The actual 1-minute resolution load data is used for this study. The annual load growth factor is 1.5%.

### 3.2. Hour-Ahead Load Schedule Model

The scheduled load is the 1-hour (1hr) block energy schedule that includes 20-minute ramps between the hours. Please refer to Figure B-4.

<sup>2</sup> The assumption is that all new wind generation additions in California will participate in the PIRP program, and therefore they will be provided with a centralized day-ahead and hour-ahead forecast service.

<sup>3</sup> The estimated data was provided by AWS Truewind and processed by Phillip de Mello.





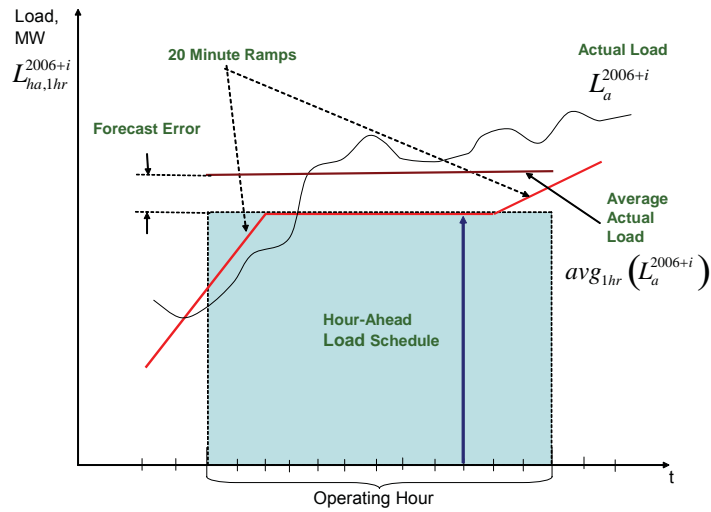


Figure B-4: CAISO Simulated Hour-Ahead Load Schedule (red line)

It can be calculated based on the load forecast error using the following approach:

The hour-ahead (ha) load schedule  $L_{ha,1hr}^{2006+i}$  can be simulated based on the projected actual load


(3.1) and the expected load forecast error  $\epsilon_{L,ha}$ :

$$L_{ha,1hr}^{2006+i} = \mathfrak{R}_{20} \left\{ avg_{1hr} L_a^{2006+i} - \epsilon_{L,ha} \right\} \quad (3.2)$$

Operator  $\mathfrak{R}_{20}$  adds 20 minute ramps to the block energy load schedule.

The error can be simulated using a random number generator based on the statistical characteristics of the load forecast error (derived from 2006-2007 data).

The suggested probability distribution for the load forecast error is a doubly truncated normal distribution shown in Figure B-5. The truncated distribution helps to eliminate “tails” of the normal distribution, which would correspond to some unrealistically significant forecast errors.



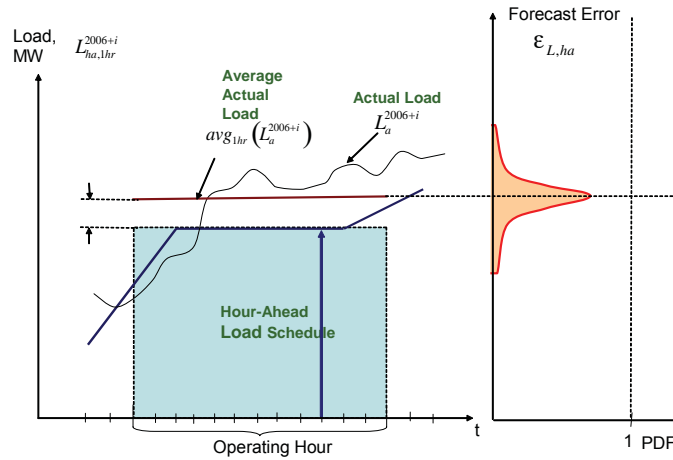


Figure B-5: Probability Density Function (PDF) of the Load Forecast Function (red line)

Based on these specified values, a random number generator will be used to generate values of  $\epsilon_{L,ha}$ . For each operating hour, the random values of  $\epsilon_{L,ha}$  will be substituted into to produce the simulated hour-ahead load schedule. It is assumed that the load error distribution is *unbiased* for  $PDF_N(\epsilon)$ , that is  $\epsilon_0 = 0$ , and  $\epsilon_{L,ha}^{\min}, \epsilon_{L,ha}^{\max}$  correspond to the minimum and maximum forecast errors specified for this study. These values are set to the following values ( $L_{ha,1hr}^{2006+i}$  is the year (coinciding with the full build out) hour-ahead scheduled load, and  $L_a^{2006+i}$  is the actual load at the same hour).

$$L_{ha,1hr}^{2006+i} = \Re \{ avg_{1hr} L_a^{2006+i} - \epsilon_{L,ha} \}, \epsilon_{L,ha}^{\min} \leq \epsilon_{L,ha} \leq \epsilon_{L,ha}^{\max} \quad (3.3)$$

$$\epsilon_{L,ha}^{\max} = 3\sigma_{L,ha}$$

$$\epsilon_{L,ha}^{\min} = -3\sigma_{L,ha}$$

### 3.3. Real-Time Load Forecast

The real-time load forecast is the average 5-minute load forecast that includes 5-minute ramps between the dispatch intervals. Please refer to Figure B-6.



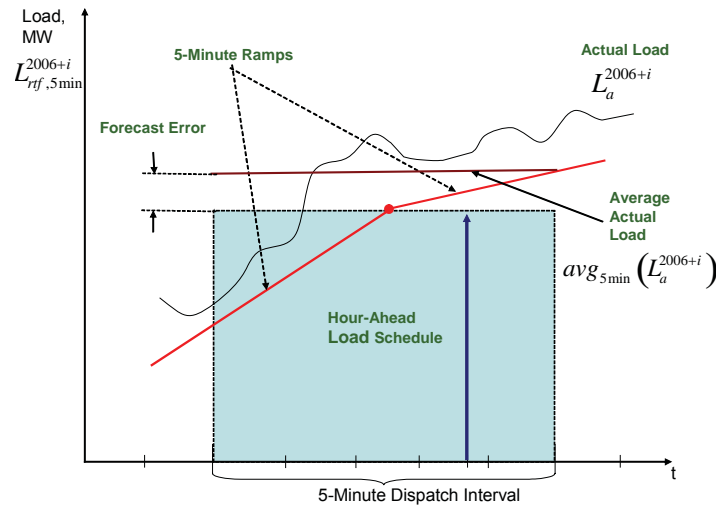



Figure B-6: California ISO Simulated Real-Time Load Forecast (red line)

It can be calculated based on the load forecast error using the following approach.

The real-time load forecast  $L_{rf,5min}^{2006+i}$  can be simulated based on the projected actual load (3.1) and the expected load forecast error  $\epsilon_{L,rf}$ :

$$L_{rf,5min}^{2006+i} = \mathfrak{R}_5 \left\{ avg_{5min} L_a^{2006+i} - \epsilon_{L,rf} \right\} \quad (3.4)$$

Operator  $\mathfrak{R}_5$  adds 5-minute ramps to the block energy load schedule.

The error can be simulated using a random number generator based on the statistical characteristics of the real-time load forecast error (derived from 2006-2007 data). The suggested probability distribution for the real-time load forecast error is an unbiased doubly truncated normal distribution. The values of  $\epsilon_{L,rf}^{\min}$  and  $\epsilon_{L,rf}^{\max}$  are set to plus/minus  $3\sigma_{L,rf}$ . The standard deviation of the hour-ahead load forecast error is  $\sigma_{L,rf}$ .

Based on these specified values, a random number generator will be used to generate values of  $\epsilon_{L,rf}$ . For each operating hour, the random values of  $\epsilon_{L,rf}$  will be substituted into (3.5) to produce the simulated real-time load forecast.

$$\begin{aligned} L_{rf,5min}^{2006+i} &= \mathfrak{R} \left\{ avg_{5min} L_a^{2006+i} - \epsilon_{L,rf} \right\}, \epsilon_{L,rf}^{\min} \leq \epsilon_{L,rf} \leq \epsilon_{L,rf}^{\max} \\ \epsilon_{L,rf}^{\max} &= 3\sigma_{L,rf} \\ \epsilon_{L,rf}^{\min} &= -3\sigma_{L,rf} \end{aligned} \quad (3.5)$$





### 3.4. Actual Wind Generation Model

Refer to Appendix D for the methodology used to scale the expected wind generation to meet the 20% RPS build out time frame.

### 3.5. Wind Generation Hour-Ahead Scheduling Model

Wind generation hour-ahead schedules can be simulated using the wind generation model described in Appendix E and wind generation forecast error model described below. Similar to the load hour-ahead schedule and real-time load forecast models, the wind generation schedules and forecasts can be simulated for the hour-ahead scheduling and real-time dispatch time horizons as follow:

Wind generation schedule model  $G_{ha,1hr}^w$  for the real-time scheduling process (hourly block energy forecast schedule) is as follows:

$$G_{ha,1hr}^{w,2006+i} = \mathfrak{R}_{20} \left\{ avg_{1hr} \left( G_a^{w,2006+i} \right) - \varepsilon_{w,ha} \cdot CAP^{w,2006+i} \right\} \quad (3.6)$$

The wind generation forecast error is expressed in % of the WG capacity  $CAP^{w,2006+i}$ .

Operator  $\mathfrak{R}_{20} \{ \dots \}$  adds 20-minute ramps between the hours;  $\varepsilon_{w,ha}$  is the simulated hour-ahead wind generation forecast error. This error is generated with the help of *unbiased* TND random number generator. The TND has the following characteristics:

- o Parameters  $\varepsilon_{w,ha}^{\min}$ ,  $\varepsilon_{w,ha}^{\max}$  correspond to the minimum and maximum total California ISO wind generation forecast errors specified for the TND. These values are set to plus/minus 3 standard deviation of the hour-ahead wind generation forecast error  $\sigma_{w,ha}$ .
- o The standard deviation and autocorrelation of the hour-ahead wind generation forecast error  $\sigma_{w,ha}$  is set to the seasonal values provided in Table B-1.





$$\begin{aligned}
 G_{ha,1hr}^{w,2006+i} &= avg_{1hr} G_a^{w,2006+i} - \varepsilon_{w,ha} \cdot CAP^{w,2006+i}, \quad \varepsilon_{w,ha}^{\min} \leq \varepsilon_{w,ha} \leq \varepsilon_{w,ha}^{\max} \\
 \varepsilon_{w,ha}^{\max} &= \\
 &\begin{cases} 3\sigma_{w,ha}, & \text{if } (avg_{1hr} G_a^{w,2006+i} - 3\sigma_{w,ha} \cdot CAP^{w,2006+i}) > 0, \\ avg_{1hr} G_a^{w,2006+i}, & \text{if } (avg_{1hr} G_a^{w,2006+i} - 3\sigma_{w,ha} \cdot CAP^{w,2006+i}) \leq 0. \end{cases} \\
 \varepsilon_{w,ha}^{\min} &= \\
 &\begin{cases} -3\sigma_{w,ha}, & \text{if } (avg_{1hr} G_a^{w,2006+i} + 3\sigma_{w,ha} \cdot CAP^{w,2006+i}) < CAP^{w,2006+i}, \\ avg_{1hr} G_a^{w,2006+i} - CAP^{w,2006+i}, & \text{if } (avg_{1hr} G_a^{w,2006+i} + 3\sigma_{w,ha} \cdot CAP^{w,2006+i}) \geq CAP^{w,2006+i}. \end{cases}
 \end{aligned} \tag{3.7}$$

The truncation process is based on the following rules.

The real-time wind generation forecast is not provided or included in the real-time dispatch process. It is assumed that the naïve persistence model is implicitly used. Practically this means that for a 5-minute dispatch interval  $[t, t + 5]$ , the implicit real-time wind generation forecast

$G_{rf,5min}^{w,2006+i}$  is assumed to be equal to the actual wind generation at the moment  $t - 8$ :

$$G_{rf,5min}^{w,2006+i} [t, t + 5] = G_a^w [t - 8] \tag{3.8}$$

## 4. Assessment of Regulation and Load Following Impacts

NERC Operating Manual<sup>4</sup> considers regulation and load following requirements as parts of the operating reserve and gives the following definitions for these terms:

**Regulation:** The provision of generation and load response capability, including capacity, energy, and maneuverability, that responds to automatic controls issued by the Balancing Authority. The regulation reliability objective is to “follow minute-to-minute differences between resources and demand.”

**Load Following:** The provision of generation and load response capability, including capacity, energy, and maneuverability, that is dispatched within a scheduling period by the Balancing Authority. The load following reliability objective is to “follow resource and demand imbalances occurring within a scheduling period.”

### 4.1. Expressing Regulation and Load Following Requirements Using Simplified ACE Equation

The California ISO’s control objective is to minimize its ACE to the extent sufficient to comply with the NERC Control Performance Standards. Therefore, the “ideal” regulation/load following signal

<sup>4</sup> “NERC Operating Manual”, June 15, 2006.





is the signal that opposes deviations of ACE from zero when it exceeds a certain threshold:

$$\begin{aligned}
 -ACE &= -(I_a - I_s) + \underbrace{10B(F_a - F_s)}_{\text{Neglected}} \\
 &\approx G_s - L_s - G_a + L_a \rightarrow \min
 \end{aligned} \tag{4.1}$$

The generation component of the ACE equation can be represented as follows:

$$G_s = G_{ha} + G_{ha}^w, G_a = G_s + \Delta G^{lf} + \Delta G^r + \Delta G^w + \Delta G^{ud} \tag{4.2}$$

where  $ha$  - denotes the hour-ahead generation schedule;  $lf$  - denotes instructed deviations from the hour-ahead schedule caused by generators involved in the load following process;  $r$  - denotes instructed deviations caused by generators involved in the regulation process;  $\Delta G^{lf}$  and  $\Delta G^r$  - is the deviation of the regulation and load following units from their base points;  $\Delta G^w$  - is the deviation of the wind generators from their schedule (wind generation real-time schedule forecast error); and  $\Delta G^{ud}$  is the total deviation of generators from the dispatched instructions.  $\Delta G^{ud}$  will be simulated similarly to the load forecast error (random number generator based on TND).

The total deviation of generators from dispatch instructions,

$$\Delta G^{ud} = G_a - G_{ha} \tag{4.3}$$

for the conventional units that are not involved in regulation and load following.

We will also introduce the following notations:

$$\begin{aligned}
 \Delta G^w &= G_a^w - G_{ha}^w, \\
 \Delta L &= L_a - L_{ha}
 \end{aligned} \tag{4.4}$$

Since the control objective is  $ACE \rightarrow 0$ , we can rewrite as

$$\Delta G^{lf} + \Delta G^r = \Delta L - \Delta G^w - \Delta G^{ud} \tag{4.5}$$

where  $\Delta L$  - is the deviation of the actual load from its real-time scheduled value (= load forecast error).

NOTE 1: Equation is written for instantaneous values of  $\Delta L$ ,  $\Delta G^w$  and  $\Delta G^{ud}$ . Therefore, the statistical interaction between the load forecast error and the wind generation forecast error is fully preserved in.

NOTE 2: The load and wind generation errors can vary depending on the wind generation penetration level in the California ISO system and the accuracy of the load forecast compared to the accuracy of the wind generation forecast. Since the percent wind generation forecast error







is more significant than the percent load forecast error, the former may have a considerable impact on  $\Delta G^{lf} + \Delta G^r$ .

#### 4.2. “Would Be” Regulation Requirement Without Wind Generation

Wind generation would have no impact on regulation and load following requirements if

$$\Delta G^w = 0 \quad (4.6)$$

By substituting (4.6) into (4.5),

$$\Delta G^{rlf} = \Delta G^{lf} + \Delta G^r = \Delta L - \Delta G^{ud} \quad (4.7)$$

#### 4.3. Regulation and Load Following Assessment

This procedure can be used to separate regulation from load following based on short-term forecasts of the system total load and total wind generation.

The schedule/forecast based approach uses the short-term forecasts of wind generation and load,  $G_{rf,5min}^{w,y}$  and  $L_{rf,5min}^y$ . In this case, the following formulas can be used:

$$\begin{aligned} \Delta G^r(m) &= L_a^y(m) - G_a^{w,y}(m) - L_{rf,5min}^y(m) + G_{rf,5min}^{w,y}(m), \\ \Delta G^{lf}(m) &= L_{rf,5min}^y(m) - G_{rf,5min}^{w,y}(m) - L_{ha,1hr}^y(m) + G_{ha,1hr}^{w,y}(m) \end{aligned} \quad (4.8)$$

Figure B-7 illustrates the idea of separating regulation from load following based on short-term forecasts.

**Load Following** is understood as the difference between the hourly energy schedule including 20-minute ramps<sup>5</sup> (shown as the red line) and the short-term 5-minute forecast/schedule and applied “limited ramping capability” function (blue line). This difference is also shown as the green area below the curves.

**Regulation** is interpreted as the difference between the actual California ISO generation requirement and the short-term 5-minute forecast/schedule and applied “limited ramping capability” function (green and blue lines correspondingly). In Figure B-7 it is also shown separately as the tan area.

<sup>5</sup> IMPORTANT NOTE: The actual California ISO real-time dispatch process is based on the actual generation, but not the real-time schedules (Source: Tong Wu, June 7, 2007). The scheduled generation used in the proposed procedure is based on the Assumptions, Section 1.



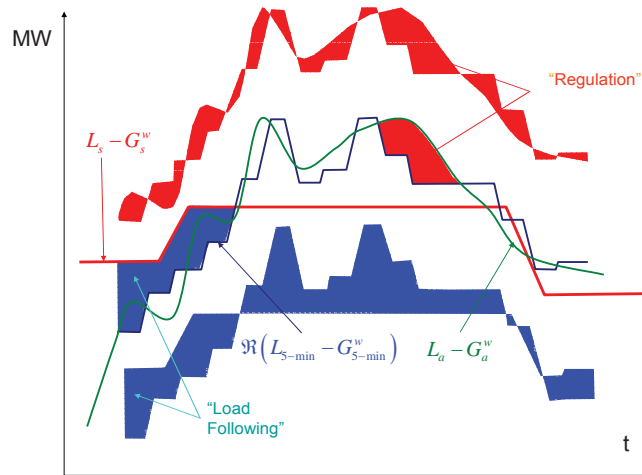


Figure B-7: Separation of Regulation from Load Following Based on Simulated Hour-Ahead Schedule

## 5. Assessment of Ramping Requirements

The regulating unit ramping capability can directly influence the required regulation and load following capacity. If the ramping capability is insufficient, more units and more capacity must be involved in regulation to follow the ramps. That is why the additional ramping requirements caused by wind generation should be studied and quantified.

The required ramping capability can be derived from the shape of the regulation/load following curve  $\Delta G^{rf}$ . This derivation needs to be done in a scientific way. We propose to use the “swinging door”<sup>6</sup> algorithm for this purpose. This is a proven technical solution implemented in the PI Historian and widely used to compress and store time dependent datasets.

Figure B-8 demonstrates the idea of the “swinging door” approach. A point is classified as a “turning point” whenever — for the next point in the sequence — any intermediate point falls out of the admissible accuracy range  $\pm \epsilon_{\Delta G}$ . For instance, for point 3, one can see that point 2 stays inside the window *abcd*. For point 4, both points 2 and 3 stay within the window *abef*. But for point 5, point 4 goes beyond the door, and therefore point 4 is marked as a turning point.

<sup>6</sup> D.C. Barr, “The Use of a Data Historian to Extend Plant Life”, Life management of power plants, 12-14 December 1994, Conference Publication No. 401.0 IEE 1994.



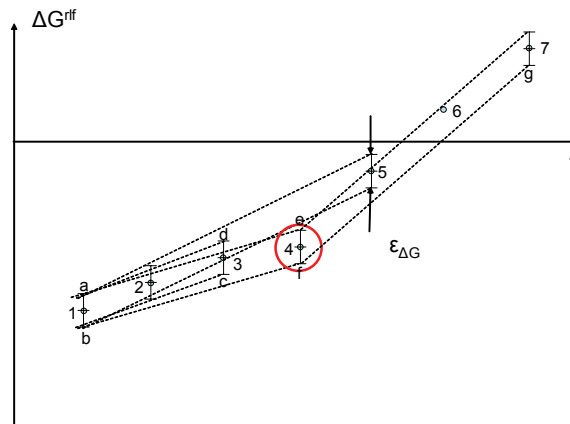


Figure B-8: "Swinging Door" Algorithm - Concept

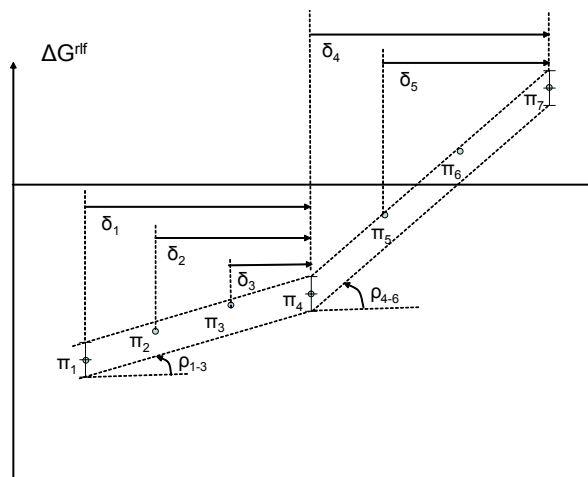


Figure B-9: "Swinging Door" Algorithm – Obtaining Regulation, Ramps and Their Duration

Based on this analysis, we conclude that points 1, 2 and 3 correspond to the different magnitudes of the regulation signal,  $\pi_1, \pi_2$  and  $\pi_3$ , whereas the ramping requirement at all these points is the same,  $\rho_{1-3}$ . The swinging door algorithm also helps to determine the ramp duration  $\delta$ .

## 6. Concurrent Statistical Analysis of the Regulation and Load Following Requirements

As discussed previously, the regulation capacity and ramping requirements are inherently related. Insufficient ramping capability could cause additional capacity requirements.





In this document, we propose a concurrent consideration of the regulation and load following capacity, ramping and ramp duration requirements.

For the regulation/load following requirement curve  $\Delta G^{rlf}$ , we can apply the “swinging door” algorithm and determine the sequences of its magnitudes and ramps,  $\pi_1, \pi_2, \dots$ ,  $\rho_1, \rho_2, \dots$ , and  $\delta_1, \delta_2, \dots$ . The triads  $(\pi_i, \rho_i, \delta_i)$  can be used to populate the three-dimensional space of these parameters – see Figure B-10.

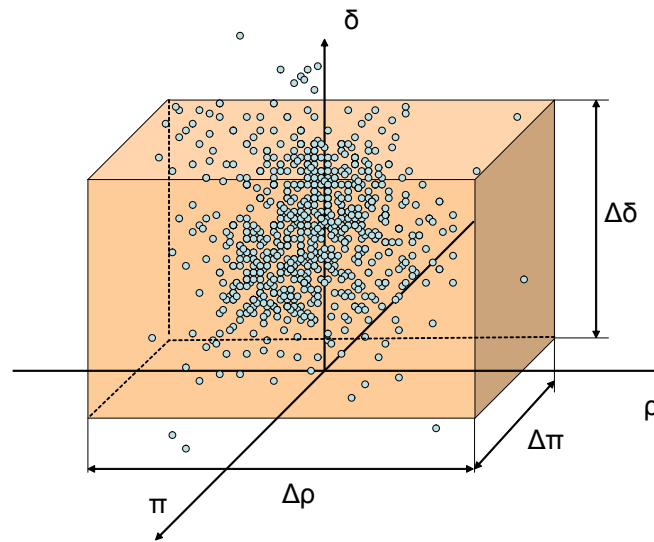


Figure B-10: Concurrent Consideration of the Capacity, Ramping and Duration Requirements

For given ranges of these three parameters,  $\Delta\pi, \Delta\rho$  and  $\Delta\delta$ , a box can be plotted in this space, so that some triads are inside the box ( $N_{in}$ ), and some are outside ( $N_{out}$ ). This approach helps to determine the probability of being outside the box

$$P_{out} = \frac{N_{out}}{N_{out} + N_{in}}$$

If a point lays outside the box, the regulation/load following requirements are not met at this point. We will require that this probability must be below certain minimum probability,  $P_{min}$ . The task is to find the position of the wall of the probability box that corresponds to a given  $P_{min}$ .





## Appendix C — Load Forecast Error Analysis

### 1. Load Forecast

The California ISO forecast demand is calculated by the Automated Load Forecasting System (ALFS). ALFS calculates the California ISO forecast demand for several different time frames. The day-ahead forecast is calculated approximately 14 hours before the operating day, while the hour-ahead forecast is calculated about two hours prior to the operating hour, and subsequent half-hour forecasts are calculated for the remainder of the operating day. This process is repeated before each operating hour and each subsequent half-hour forecast is modified. Each of the half-hour forecasts for the remainder of the operating day is used by the Security Constrained Unit Commitment program so that short start units could be committed if it's anticipated that resources would be deficient.


In the California ISO's Real-Time Market Systems, another forecasting tool called the Very Short-Term Load Predictor (VSTLP) utilizes the latest ALFS half-hour forecast and the most recent generation output from the State Estimator to forecast a 15-minute demand forecast, which is used by the Real-Time Unit Commitment (RTUC) and a 5-minute forecast which is used by Real-Time Economic Dispatch. Under MRTU, all forecast demand would include transmission losses, but would exclude pump loads.

#### 1.1. Load Forecast Error

In order to assess the expected forecast error to meet the 20% RPS goal, it was decided to ascertain the actual forecast errors observed in 2006. For this study, the seasonal forecast errors for 2006 are assumed to be the same as after the build out, although some may argue that forecast errors would be higher at higher load levels. The reason for assuming the forecast errors would be about the same as they are now is the expectation that forecast errors would be reduced with improved forecasting techniques and additional weather information.

The forecast demand errors were characterized for three time frames, the hour-ahead, half-hour and 5-minute forecasts. For each time frame, the forecast error was determined by taking the difference between the forecast demand for that time frame and the actual average demand for the corresponding period. The maximum, minimum, average and standard deviation were calculated on the error for each time frame. The probabilities of error magnitudes were then calculated by comparing the number of occurrences in error magnitude ranges to the total number of occurrences. The probability density function can be approximated using a truncated normal distribution that is defined by using the mean and standard deviation for the forecast error for the different seasons. Refer to Figure C-1.

The truncated normal distribution is very similar to a normal distribution, but differs in that its extremities are bounded or truncated. The truncated normal distribution is more practical for load forecasting data because it is not expected that the forecast error would exceed certain limits. The formula for the truncated normal distribution used in this study is given below:





$$PDF_{TND}(\epsilon) = \begin{cases} 0, & -\infty \leq \epsilon < \epsilon_{\min} \\ \frac{PDF_N(\epsilon)}{\int_{\epsilon_{\min}}^{\epsilon_{\max}} PDF_N(\epsilon) d\epsilon}, & \epsilon_{\min} \leq \epsilon \leq \epsilon_{\max} \\ 0, & \epsilon_{\max} \leq \epsilon \leq +\infty \end{cases}$$

$$PDF_N(\epsilon) = \frac{1}{\sqrt{2\pi\sigma^2}} e^{-\frac{1}{2}\left(\frac{\epsilon - \epsilon_0}{\sigma}\right)^2}, \quad -\infty \leq \epsilon \leq +\infty$$

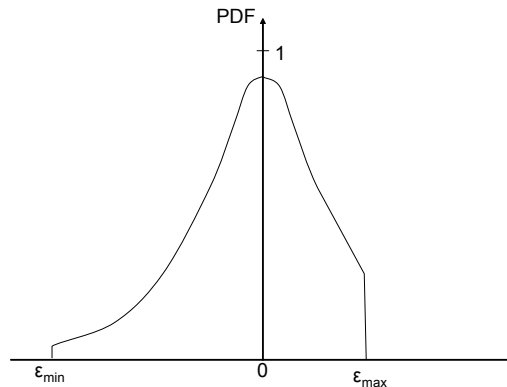


Figure C-1: Unbiased Truncated Normal Distribution

Additionally, the autocorrelation coefficient ( $R$ ) was calculated to see if the forecast errors are time dependent (i.e., is the forecast load typically under-forecast or over-forecast for certain time periods?). The autocorrelation depends on the number of observations, the standard deviation of the observations, the sample mean and the current and next observation. Autocorrelation has values between -1 and 1. A value of 1 indicates that the next value has a very strong positive dependence on the previous value, while a value of -1 indicates that the next value has a strong negative dependence on the previous value. An autocorrelation value of 0 indicates that the current value gives no indication of what the next value will be.

$$R = \frac{1}{(n-1)\sigma^2} \sum_{i=1}^{n-1} (X_i - \mu)(X_{i+1} - \mu)$$

Where:  $n$  is the number of occurrences  
 $X$  is the value of the error at that time  
 $\mu$  is the average value of the error  
 $\sigma$  is the standard deviation of the error





## 2. Hour-Ahead Forecast

Currently, and prior to MRTU implementation, the hour-ahead forecast error is simply the difference between the hour-ahead forecast and the average hourly actual demand (including pump loads) for a particular operating hour. For 2006, the hour-ahead forecast was found to have a mean absolute error (MAE) of 2% of actual load.

$$MAE = \frac{1}{N} \sum \frac{|Actual - Forecast|}{Actual} \times 100$$

The raw forecast error data was filtered through a two-step process to remove bad data points: 1) errors in excess of 50% of actual load were removed, and 2) errors greater than 3 standard deviations from the mean were removed if there were data errors or problems on the grid.

Table C-1 summarizes the minimum, maximum, average, standard deviation and autocorrelation of the hour-ahead load forecast errors for the different seasons.

Table C-1: Summary of Hour-Ahead-Load Forecast Error (Actual Load – Forecast Load)

Season	Average (MW)	Min (MW)	Max (MW)	Standard Deviation (MW)	Autocorrelation
Winter	-35.2	-3,849	1,519	652	0.69
Spring	-24.1	-2,101	1,931	601	0.73
Summer	-130.4	-3,771	2,446	900	0.89
Fall	-69.2	-2,628	2,081	687	0.83

Figure C-2a, C-2b, C-2c & C-2d show the seasonal comparisons of the theoretical load error distribution (red line) to actual load error distributions (blue bars). During the spring, fall and winter months, the forecast errors typically mimic a truncated normal distribution function. As shown in Figure C-2b, during the 2006 summer months, the load forecast error was typically on the high side or was greater than 800 MW for approximately 23% of the time. Much of this high forecast was due to the number of days the average temperature exceeded 100 degrees F within the California ISO-controlled Grid.

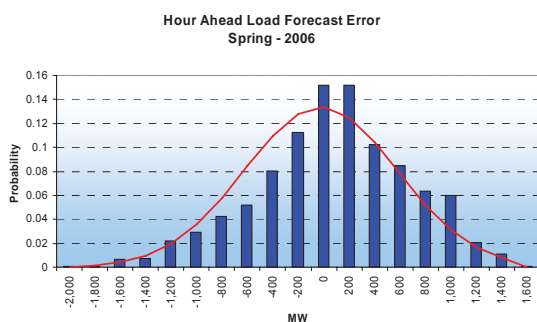


Figure C-2a: Spring Load Forecast Error

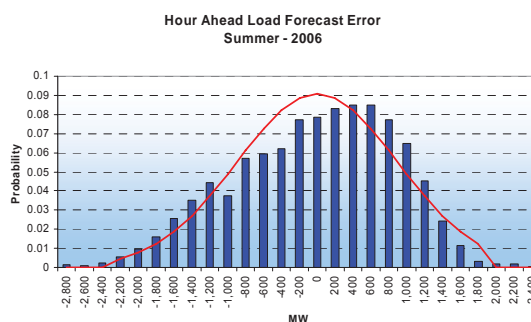



Figure C-2b: Summer Load Forecast Error





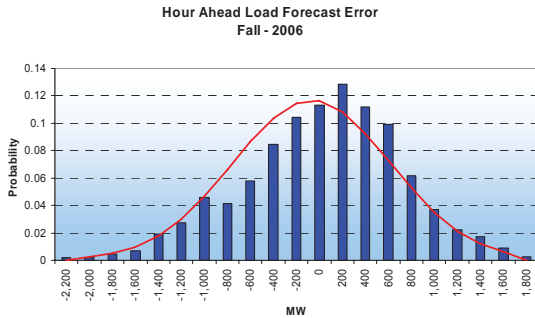



Figure C-2c: Fall Load Forecast Error

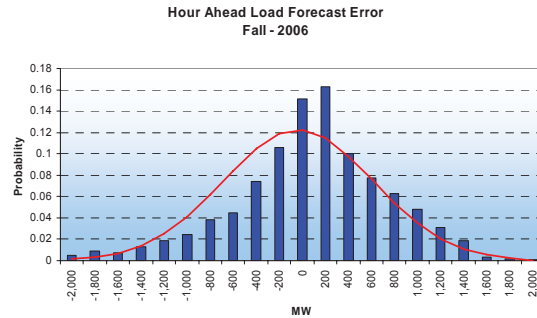


Figure C-2d: Winter Load Forecast Error

### 3. Half-Hour Forecast

The half-hour forecasts are similar to the hour-ahead forecasts except they provide a more granular view of the operating hour in question. Once again, the load data was extracted from the PI database, with the difference that it is half-hour averages rather than hourly averages. The time period used was January through June of 2007. Half-hour forecast errors were not evaluated by season because of missing data. Additionally, the half-hour load forecast does not include pumping load, so pump loads were removed from the actual half-hour load data for the comparison. The mean absolute error for the half-hour forecast was found to be 0.77%. Table C-2 below shows the minimum, maximum, average, standard deviation and autocorrelation of the half-hour forecast error.

Table C-2: Summary of Half-Hour Load Forecast Error

Average (MW)	Min (MW)	Max (MW)	Standard Deviation (MW)	Autocorrelation
-8.90	-1370	1520	258	0.89

As shown in Figure C-3, the half-hour load forecast error is significantly smaller than the hour-ahead forecast error. For the first half of 2007, the forecast error was greater than 500 MW approximately 5% of the time.





**Half-Hour Load Forecast Error  
January through June 2007**

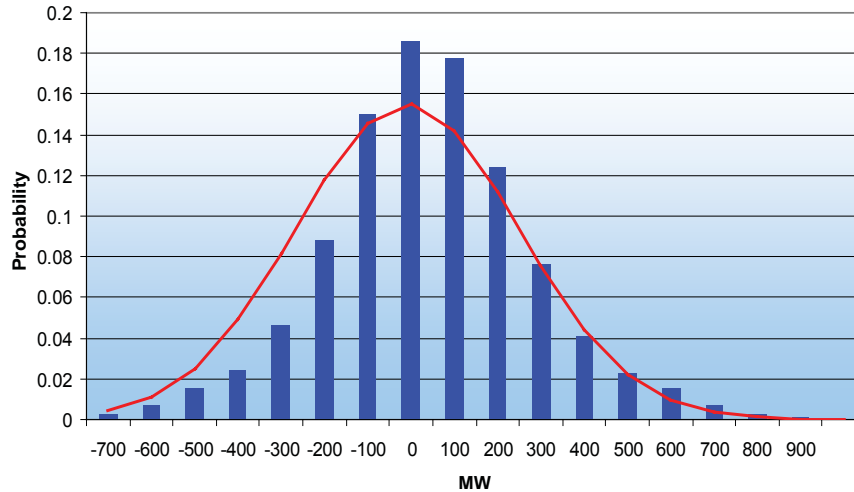


Figure C-3: Comparison of Half-Hour Load Forecast Error with Theoretical Distribution


#### 4. 5-Minute Forecast (real-time forecast)


The 5-minute load forecast is calculated by the California ISO’s VSTLP application, which is based on neural network training. It uses 5-minute averages of actual load data (including pump load) generated from the State Estimator for the last 13 months as input. The VSTLP produces a load forecast for each 5-minute dispatch interval in the Real-Time Market time horizon. This 5-minute forecast is run about 10-minutes before the operating interval and consists of a block of power for that time. Variation within that 5-minute interval is made up with regulation. The 5-minute load data and the 5-minute load forecasts were extracted from the SI UP database. The mean absolute error of the 5-minute load forecast is 0.29%. Table C-3 below shows the minimum, maximum, average, standard deviation and autocorrelation of the 5-minute forecast error.

Table C-3: Summary of 5-Minute Load Forecast Error

Average (MW)	Min (MW)	Max (MW)	Standard Deviation (MW)	Autocorrelation
1.15	-349	349	98	0.61

Figure C-4 shows the 5-minute load forecast error for one month of data (mid-March through mid-April) is less than 100 MW for almost 85% of the time.





### 5-Minute Load Forecast Error Mid-March through Mid-April 2006

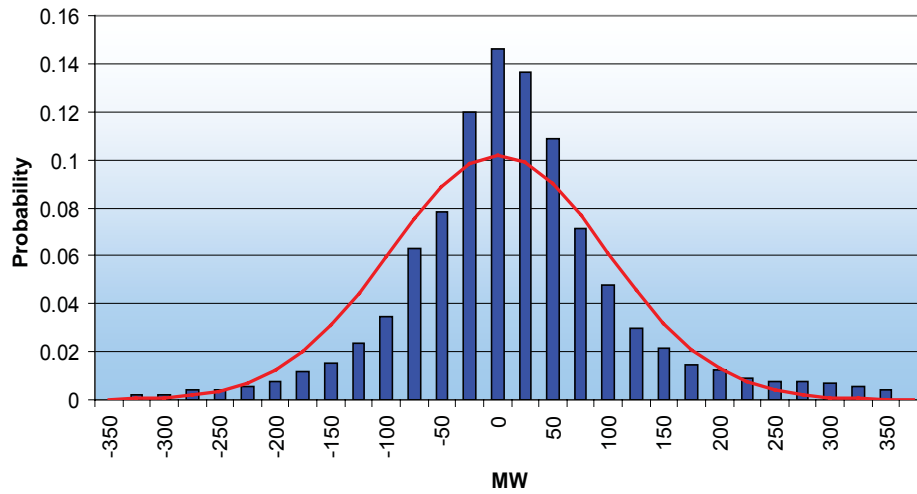


Figure C-4: Comparison of 5-Minute Load Forecast Error and Theoretical Error Distribution





## Appendix D — Wind Generation Forecast for the 20% RPS

### 1. Scaling Wind for the 20% RPS

Creating a realistic wind forecast dataset is one of the most important steps in analyzing the wind variability to meet the 20% RPS. Simply scaling the 2006 actual wind production by the ratio of the expected capacity to the current capacity fails to take into account any local weather variation within a resource area. This methodology would also neglect any benefits of aggregation, which will reduce overall variability. The following approach describes the methodology used to create a reasonable dataset of future wind generation based on the realized 2006 wind production, which remedies some of the problems with direct scaling.

The 20% RPS energy production and minute-to-minute variability were calculated separately. The reason for calculating the expected production separately stems from the fact that wind energy production and variability during short time intervals are often driven by separate phenomenon. For the analysis and based on the California ISO's generation interconnection queue, three new wind parks totaling 3,540 MW were assumed to be located in the Tehachapi area and a new 500 MW wind park located in the Solano area. The other existing wind parks were assumed to remain the same as 2006.

### 2. Energy Production

The 20% RPS hourly energy production data for the Tehachapi and Solano regions were provided by AWS Truewind. The data is the same as that used in the CEC IAP study, except that it omits facilities that are not likely to be constructed by the 2013 timeframe, which is when the 20% RPS build out is scheduled to be completed. AWS Truewind generated the expected wind production data using actual production data from January 2002 through December 2004 combined with their atmospheric simulation models to create wind speeds for the resource areas. AWS Truewind then extracted production values based on the resource area conditions with local corrections for each site and the expected power curve.<sup>7</sup> The AWS Truewind initial dataset is composed of hourly block energy forecasts for each of the existing and expected wind parks in the Tehachapi and Solano areas as shown in Figure D-1. As shown in Figure D-2, 20-minute linear inter-hour ramps were added to this original dataset to smooth the overall shape, and to prevent changes between hours from introducing artificial variation. Figure D-1 shows sample energy production data with the inter-hour ramps added.

<sup>7</sup> "Intermittency Analysis Project: Characterizing New Wind Resources in California" PIER Interim Project Report. California Energy Commission. CEC-500-2007-014. February 2007.

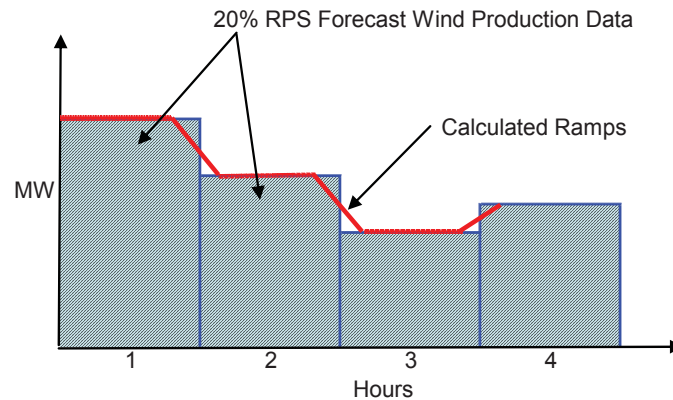


Figure D-1: Expected Wind Energy Production With Linear Ramps

### 3. Minute-to-Minute Variability

The minute-to-minute variability is the actual minute-to-minute variation observed from the existing wind production in the various resource areas for 2006. The minute-to-minute variations are defined as the 1-minute deviation from a 60-minute centered moving average. Using a centered moving average takes out the longer term trends in the wind production (i.e., ramping up in the evening or down in the morning). A 60-minute average was used to closely match the energy given as hourly blocks. Figure D-2 shows a sample of wind production and a comparison between the hourly average and the moving average. Since the 20% RPS energy production values are not based on the 2006 wind production data, it can at times have opposite inter-hour trends. These opposite trends could exacerbate the variability if it were taken from fixed hourly averages of 2006 data and then combined directly onto the expected production. Figure D-3 shows how the inter-hour trends in energy can be different between the two datasets.

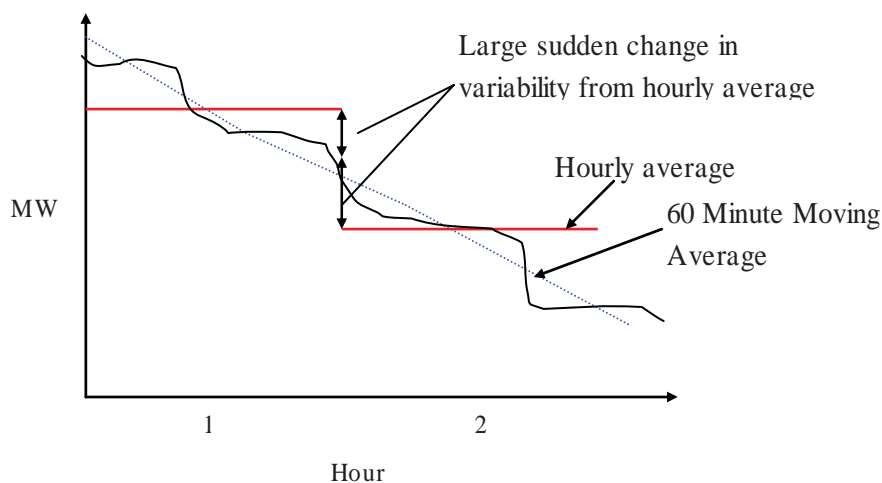


Figure D-2: Sample Wind Production with Hourly Average and Moving Average



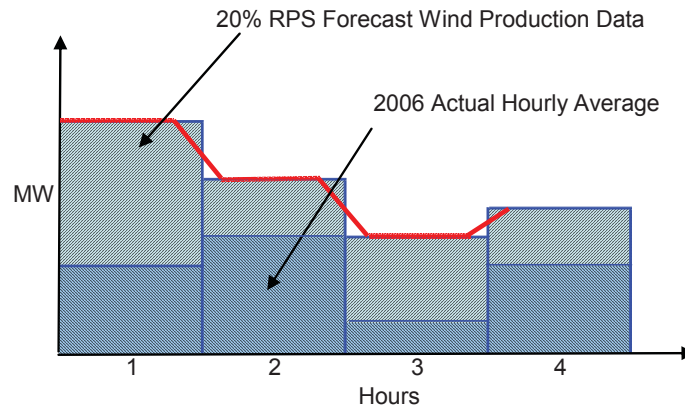



Figure D-3: Possible Average Wind Generation Pattern

The variability was then scaled up assuming that new wind farms would have similar levels of variability and that short-term variations would be completely uncorrelated.

Figure D-4 shows the correlation coefficient of short-term fluctuations of Solano and Tehachapi wind parks, and shows there is no significant correlation. Figure D-5 shows the correlation coefficient of short-term fluctuations of the two wind parks in Tehachapi. The correlation coefficient is a measure of the extent that two variables are changing together. It is bounded between 1 and -1. If it has a value of 1, the two variables always change together in the same direction, if it has a value of -1, they change in opposite directions. If the correlation coefficient is 0, the two variables vary completely independently of each other. The equation for the correlation coefficient is shown below.

$$\text{Correlation} = \frac{\sum_{i=1}^N (X - \mu_X)(Y - \mu_Y)}{(N-1)\sigma_X\sigma_Y}$$





**Solano- Tehachapi Hourly Correlation Wind Variability  
May 2006**

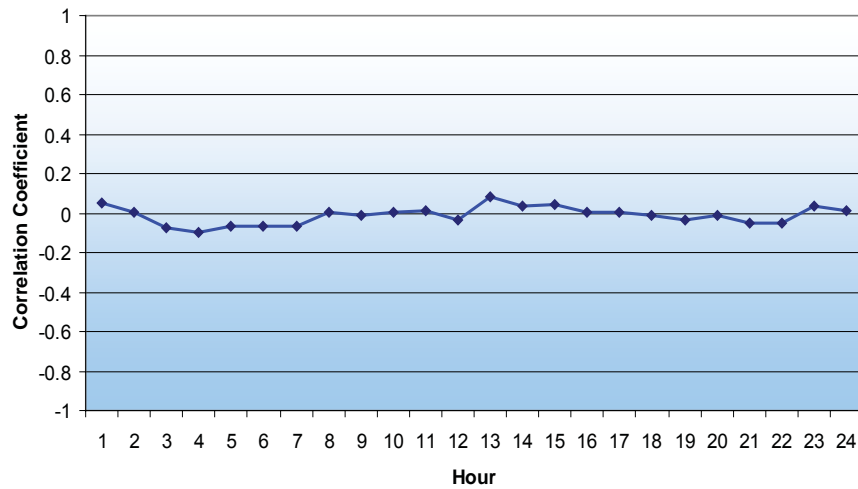


Figure D-4: Correlation of Short-Term Variations of Two Wind Parks in Tehachapi Resource Area

**Hourly Correlation of Wind Variability of Two Tehachapi Wind Parks  
May 2006**

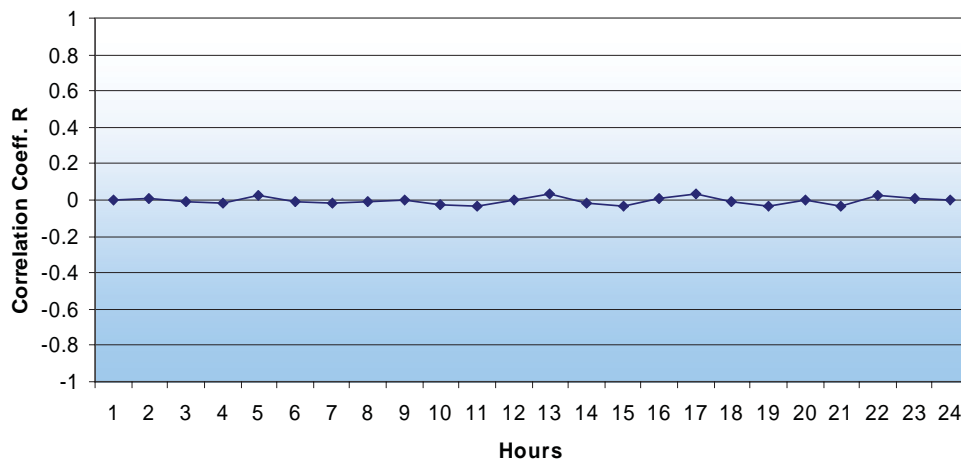



Figure D-5: Correlation of Short-Term Variations of Two Wind Parks in Tehachapi Resource Area

Since the variability of the parks is independent, the standard deviations are added together as the square root of the sum of the squares. The scale factor  $\gamma$  is then determined by calculating the expected standard deviation and dividing that by the current standard deviation:

$$\gamma = \frac{\sqrt{\frac{MW_{2010}}{MW_{2006}} \sigma^2}}{\sigma} = \sqrt{\frac{MW_{2010}}{MW_{2006}}}$$








The minute-to-minute variation is then multiplied by this scaling factor for each minute to get the expected variability. The variability from one of the newer wind park and the wind parks connected to the Vincent substation were analyzed separately. These two wind parks were used in the analysis because real-time telemetry from these sites are updated and sent to the California ISO every 4 seconds. The newer wind park (60 MW) is made up of newer wind turbines, and it is assumed that future additions will behave similarly to the turbines installed at this park. Thus, the scaling was split so that the newer wind park minute-to-minute variability was scaled such that it represents 75% of the expected Tehachapi addition. The Vincent substation variability was scaled to represent the remaining 25%. The scaled variabilities were added together minute-by-minute to give the total Tehachapi distribution. A similar method was used in the Solano area. For the Solano area, the two newest wind parks analyzed. Since both of these parks have relatively new wind turbine technology, an equal weight (50%) was placed on the variability of each. Finally, the energy component and the 1-minute variability were added together to give the 1-minute wind production values.







## Appendix E — Wind Forecast Error

The 2-hour ahead wind forecast error was analyzed in order to give an estimate of the types of errors one could expect in the 2013 time frame which coincides with the build out of the 20% RPS goal. The wind forecast error is defined as a percentage of total installed wind park capacity and is calculated by taking the difference between the actual and forecast production for a given hour divided by the plants' capacity. The dataset used was provided by AWS Truewind, which provided the forecast error for June 2006 through May 2007. The statistics for the forecast error were also calculated for each time frame and are summarized in Table E-1. In addition to the seasonal statistics, the mean absolute percent error (MAPE) was also calculated to be 5.94% for the entire time period.

$$\varepsilon = \frac{\text{Actual} - \text{Forecast}}{\text{Capacity}}$$

$$\text{MAPE} = \frac{1}{N} \sum_{i=1}^{i=N} |\varepsilon_i|$$

Additionally, the autocorrelation error ( $R$ ) was calculated to see if the forecast errors are time dependent (i.e., is the forecast wind generation typically under-forecast or over-forecast for certain time periods?) The autocorrelation depends on the number of observations, the standard deviation of the observations, the sample mean and the current and next observation. Autocorrelation has values between -1 and 1. A value of 1 indicates that the next value has a very strong positive dependence on the previous value, while a value of -1 indicates that the next value has a strong negative dependence on the previous value. An autocorrelation value of 0 indicates that the current value gives no indication of what the next value will be.

$$R = \frac{1}{(n-1)\sigma^2} \sum_{i=1}^{n-1} (X_i - \mu)(X_{i+1} - \mu)$$

Where:  $n$  is the number of occurrences

$X$  is the value of the error at that time


$\mu$  is the average value of the error

$\sigma$  is the standard deviation of the error

Table E-1: Summary of Wind Forecast Error

	Average	Minimum	Maximum	Standard Deviation	Autocorrelation
Winter	0.00	-0.36	0.31	0.07	0.61
Spring	0.00	-0.43	0.31	0.09	0.71
Summer	0.00	-0.32	0.31	0.08	0.65
Fall	0.00	-0.32	0.40	0.08	0.59

Finally, the statistical distribution of the forecast error was analyzed. It was compared to a truncated normal distribution. The truncated normal distribution is very similar to a normal distribution, but differs in that its extremities are bounded or truncated. The truncated normal distribution is more practical for real datasets that cannot have infinite values. For example,







we would not expect the wind forecast error to exceed the plant capacity. It is a piecewise function, ensuring that there is no chance of a value occurring outside the bounds, which is rescaled by the normal distribution to give an area under the curve of 1. The formula for the truncated normal distribution is given below.

$$PDF_{TND}(\epsilon) = \begin{cases} 0, & -\infty \leq \epsilon < \epsilon_{\min} \\ \frac{PDF_N(\epsilon)}{\int_{\epsilon_{\min}}^{\epsilon_{\max}} PDF_N(\epsilon) d\epsilon}, & \epsilon_{\min} \leq \epsilon \leq \epsilon_{\max} \\ 0, & \epsilon_{\max} \leq \epsilon \leq +\infty \end{cases}$$

$$PDF_N(\epsilon) = \frac{1}{\sqrt{2\pi\sigma^2}} e^{-\frac{1}{2}\left(\frac{\epsilon-\epsilon_0}{\sigma}\right)^2}, \quad -\infty \leq \epsilon \leq +\infty$$

The truncated normal distribution is a good fit for the data as shown in the following Figures E-1a, E-1b, E-1c & E-1d.

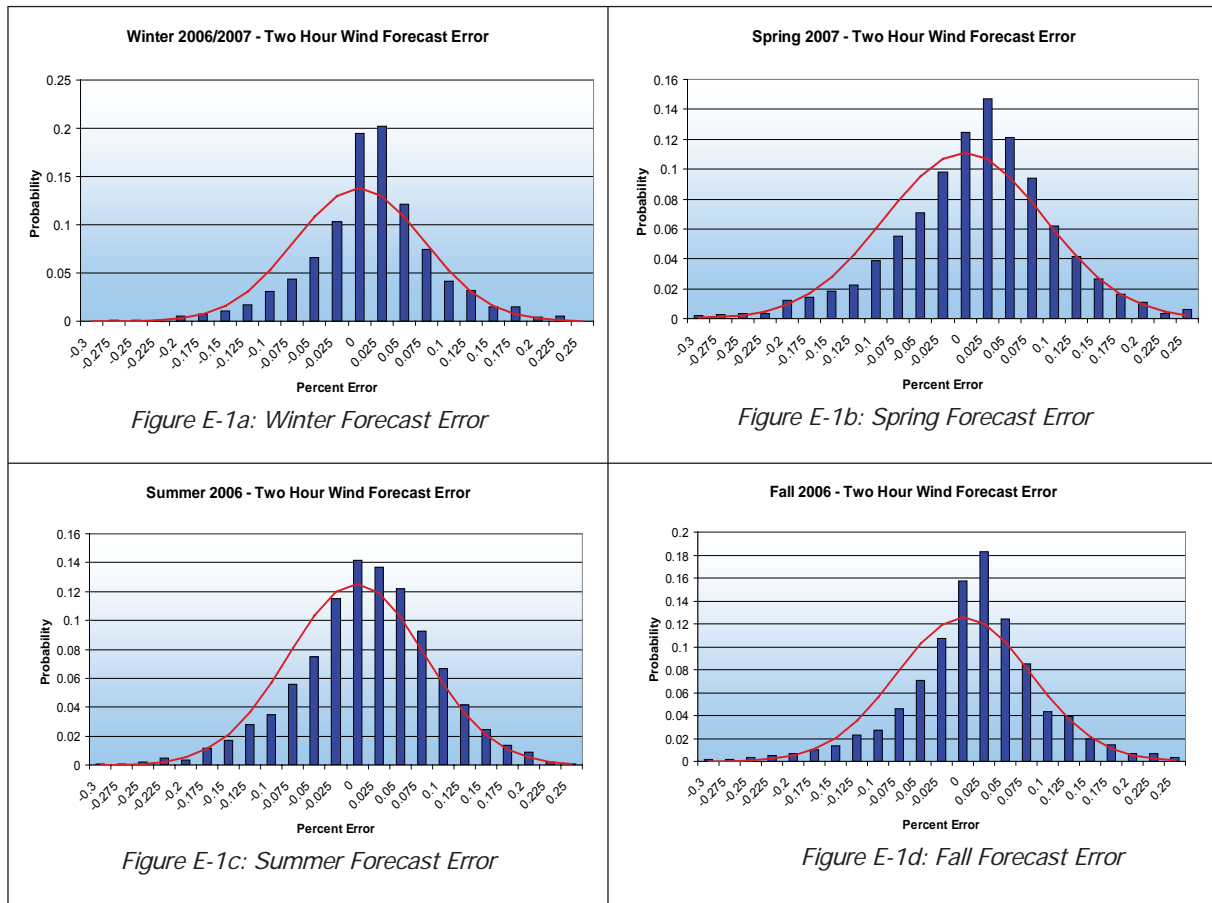



## Appendix F Wind Turbine Generator Modeling

### 1. Power Flow Model

The modeling of a wind plant for load flow analysis is simple. Wind plants normally consist of a large number of individual wind turbine generators (WTGs). The wind plant model may consist of a detailed representation of each WTG and the collector system. Alternatively, the simpler model shown in Figure F-1 is adequate for most bulk transmission system studies. This model consists of a single WTG and unit transformer with MVA ratings equal to  $N$  times the individual device ratings, where  $N$  is the number of WTGs in the wind plant (or those considered to be online for study purposes). An equivalent impedance to reflect the aggregate impact of the collector system can be included together with the substation step-up transformer(s). The total charging capacitance of the collector system can also be included. The charging capacitance can be significant since underground cables are often used for the collector system. A third alternative is to model several groups of WTGs, each represented by a single model, with a simplified representation of the collector system. The wind plants included in this study use both of these equivalent modeling approaches.


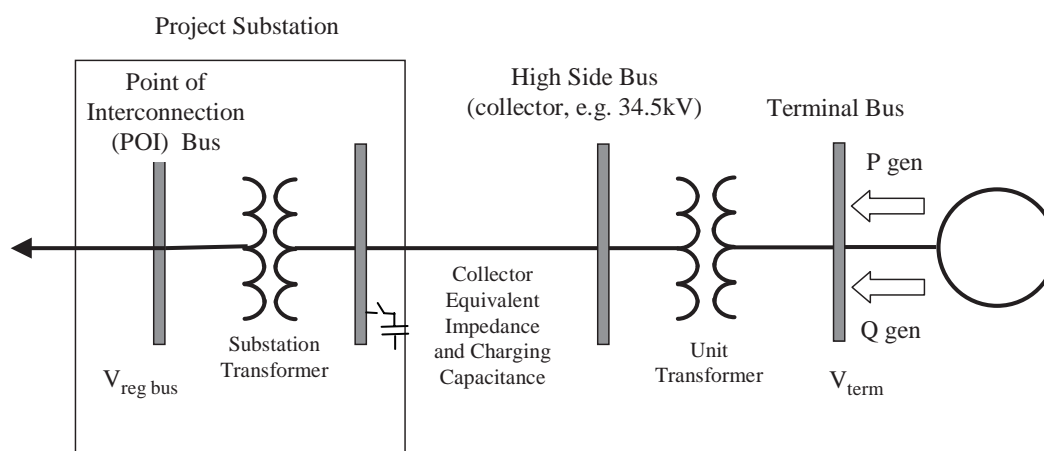


Figure F-1: Wind Plant Equivalent Model

From an analysis perspective, it is important to understand that the aggregate WTG behaves like a conventional generator connected to a (PV) bus in the power flow analysis. The generator  $P_{gen}$ ,  $Q_{max}$  and  $Q_{min}$  are input to reflect the aggregate WTG capability. Typical collector system voltages are at distribution levels (12.5 kV or 34.5 kV are common). The substation transformer is suitably rated for the number of WTGs. Some of the wind plant models in this study include shunt capacitors on the collector side of the substation transformer, as illustrated in Figure F-1. These capacitors replace or augment reactive capability from the WTGs, so that the power factor requirement of the grid code is met.





## 2. Dynamic Model

### 2.1. WECC Standard Models

Dynamic modeling of wind generation, particularly newer technology WTGs, is a challenge for the industry. The Western Electricity Coordinating Council (WECC) Modeling & Validation Work Group (MVWG) convened a Wind Generator Modeling Group (WGMG) in 2005 to address the challenge. The charter of that group is to “develop a small set of generic (non-vendor specific), non-proprietary, positive-sequence power flow and dynamic models suitable for representation of all commercial, utility-scale WTG technologies in large scale simulations.” The models are suitable for typical transmission planning and system impact studies. All of the current commercially available utility scale wind turbines can be grouped into four basic topologies based on how they interface with the grid. The notation that the WG adopted, which is gaining industry acceptance, is as follows:

Type 1 – conventional induction generator

Type 2 – wound rotor induction generator with variable rotor resistance

Type 3 – doubly-fed induction generator

Type 4 – full converter interface

Simple schematics of these four topologies are shown in Figure F-2.

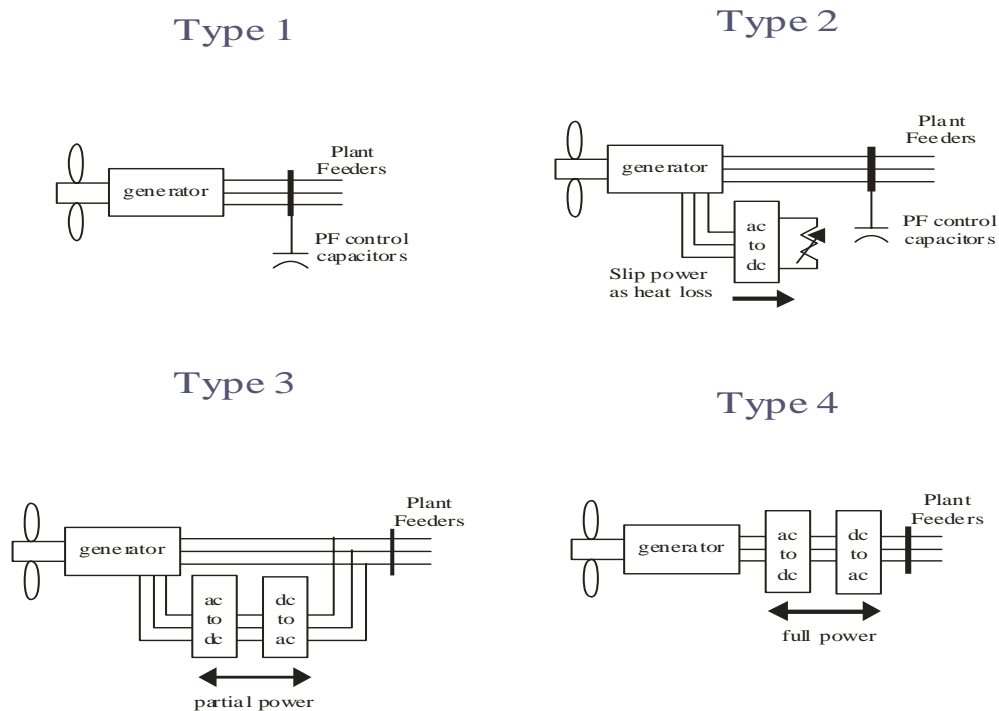


Figure F-2: WECC Standard Wind Turbine Model Types





## 2.2. GE PSLF WTG Models


From a system perspective, there are some important differences between these four types of WTGs. The GE PSLF user’s manuals include different sets of default control models that can be used to build dynamic models of WTGs for transmission planning studies. Table F-1 lists the GE PSLF model names and the corresponding components of the WTG, proposed in GE WTG Modeling Version 3.3. The detailed control block diagrams are also shown in the GE PSLF user’s manuals.

Table F-1: GE PSLF Control Models for WTG

Type of WTG	PSLF Model Name	WTG Component	Explanation
Type 1	motor1	Induction generator	This is an induction machine represented in load flow working case as a generator.
Type 2	genwri	Conventional-technology wound rotor induction (WRI) machine	This needs to be used with an external field resistor.
	exwtg1	External field resistor for the WRI	Normally, the resistor is electronically controlled (with a PWM IGBT circuit). The function of this control is to provide a much more steady power output from the wind turbine.
	wndtrb	Wind Turbine Model	Provides a simple representation of a complex electro-mechanical system to extract as much power from the available wind as possible without exceeding the rating of the equipment.
Type 3 (Note: GE has published different versions of Type 3 modeling using the same model names)	gewtg	Generator/Converter	This is equivalent to the generator and the field converter and provides the interface between the WTG and the network.
	exwtge	Electrical (Converter) Control Model	This dictates the active and reactive power to be delivered to the system based on inputs from the turbine mode and from the supervisory Var controller.
	wndtge	Wind Turbine and Turbine Control Model	This provides a simplified representation of the relevant controls and mechanical dynamics of the wind turbine.

## 2.3. Reactive Power Characteristics

Type 1 machines operate in a very narrow speed range, and always consume reactive power during operation. The reactive power consumption is a function of active power production and grid conditions, and it cannot be controlled. Consequently, both the reactive power consumption of the generator *and* the reactive power requirements of the grid, must be supplied by additional equipment — usually switched shunt capacitors.







Type 2 machines have wider speed variation and tend to exhibit slower active power fluctuations than type 1 machines, but have similar reactive power characteristics. Under load, the machines consume reactive power equal to approximately half of the MW output.

Type 3 and Type 4 machines use substantial power electronics to provide wider speed range and finer control of active power production. The power electronics also inherently provide the ability to produce or consume reactive power. It is largely controllable independent from the active power production. In this regard, these machines resemble conventional synchronous generators with excitation systems and automatic voltage regulators (AVR). The details of performance are different between manufacturers. Generally, wind plants with Type 3 or Type 4 generators have the ability to provide relatively fast voltage or power factor control. The ways in which each manufacturer controls and coordinates the reactive power production and balance differs. The great majority of wind generation built in the U.S. last year was of Type 3 or 4.





## 2.4. Low Voltage Ride-Through (LVRT)

Figure F-3 shows the WECC LVRT performance requirements and the PSLF implementation used in this study. For Type 3 and Type 4 WTGs, the ability to tolerate severe low voltages is primarily an issue of control and toughening of the power electronics necessary for operation of the wind turbines. For Type 1 and Type 2 machines, LVRT capability is derived from increased robustness of auxiliaries and contactors. It is important to recognize that LVRT capability and compliance is specific to voltage deviations during and immediately following grid faults and disturbances. LVRT compliance does not guarantee that wind plants will remain stable following severe upsets.

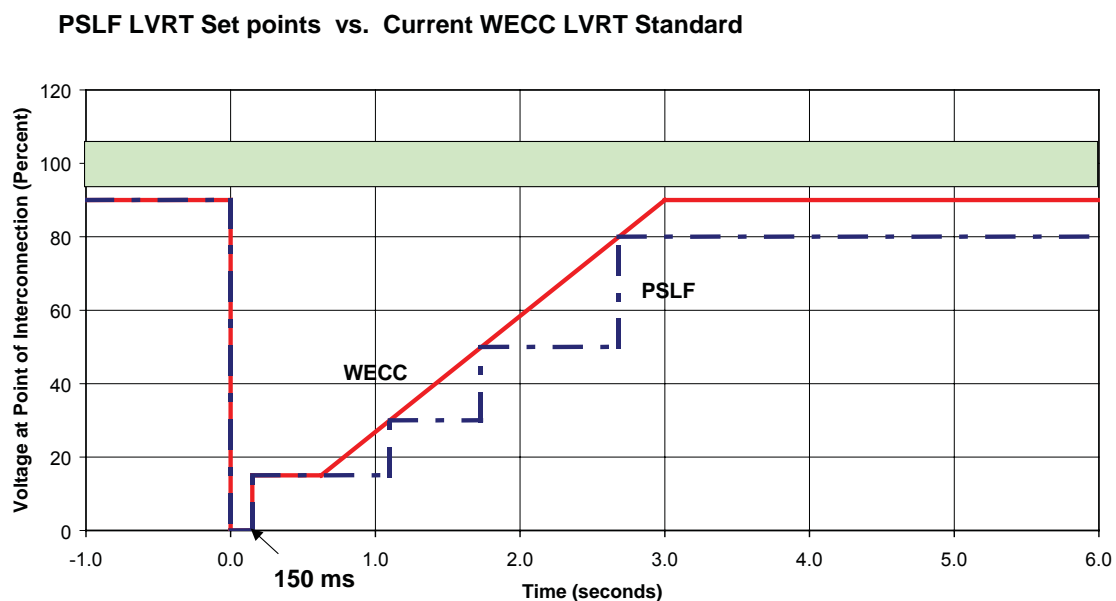



Figure F-3: LVRT Requirements and Modeling

## 3. Generator Protection Model

WTGs may be tripped for voltages and frequency values that exceed specified thresholds for specified time durations. Both the voltage and frequency trips should typically include a circuit breaker time of 0.15 seconds. In particular, the low voltage tripping will be set to meet LVRT requirements. WTGs from different manufacturers may have different protection models.

GE PSLF has provided methods to simulate the protection model for Types 2, 3 and 4 of WTG models.

Note: For the GE 1.5 MW WTG, the measurement point of the generator protection is the terminals of the generator. For the GE 3.6 MW WTG, the measurement point is at the high side of the unit step-up transformer.





### 3.1. Use Generator/Converter Model in Version 3.3 WTG Model

Table F-2 illustrates the GE PSLF variables corresponding to the “gewtg” control model for the Type 3 WTG model provided in GE WTG model Version 3.3. The LVRT settings used in this study are also listed in Table F-2.

Table F-2: Voltage Trip Level Setting in “gewtg” Model of GE WTG Model Version 3.3

EPCL Variable	Tripping Level	Description
dVtrp1	-0.15	Delta voltage trip level, p.u.
dVtrp2	-0.25	Delta voltage trip level, p.u.
dVtrp3	-1.0	Delta voltage trip level, p.u.
dVtrp4	0.1	Delta voltage trip level, p.u.
dVtrp5	0.15	Delta voltage trip level, p.u.
dVtrp6	0.3	Delta voltage trip level, p.u.
dTtrp1	10	Voltage trip time, sec. (10 for no tripping)
dTtrp2	0.15	Voltage trip time, sec.
dTtrp3	0.01	Voltage trip time, sec.
dTtrp4	1.0	Voltage trip time, sec.
dTtrp5	0.1	Voltage trip time, sec.
dTtrp6	0.02	Voltage trip time, sec.

### 3.2. Use User-defined Model in Version 3.4 WTG Model

In GE PSLF WTG model Version 3.4, the WTG protection relay can be modeled through a standard user-written EPCL. Generator protection model (*gpwtg.p*) is available in GE PSLF for modeling voltage and frequency tripping. WTG from different manufacturers can be modeled using different EPCL protection models. The user-defined protection model can be used for both Types 2 and 3 WTGs.

The voltage trip levels are similar to those shown in Table F-2. The typical frequency trip levels and durations based on specifications for a 60 Hz, 1.5 MW unit are shown in Table F-3.

Table F-3: Typical WTG Generator/Converter Frequency Trip Levels and Times (for 60 Hz. systems)

f (Hz.)	freq. [p.u.]	Time [sec]
57.5	0.96	30
56.5	0.94	.02
61.5	1.025	31
62.5	1.04	.02





## Appendix G Tehachapi Transmission Plan

California's largest potential for the development of wind generation is the Tehachapi area, which lies at the southern end of the San Joaquin Valley in the mountainous region between Bakersfield and Mohave. It is expected that at a minimum, 4,350 MW of wind generators could be installed in this area. As a result, the Tehachapi Collaborative Study Group (TCSG) was formed in 2004 to create a comprehensive transmission development plan for the phased expansion of transmission capabilities in the Tehachapi area. The California Public Utilities Commission (CPUC) staff coordinated the TCSG, while Southern California Edison Company (SCE) sponsored the project pursuant to the terms of the California ISO's Large Generator Interconnection Procedures.


The first report from the TCSG was issued to the CPUC in March 2005. In that report, the TCSG identified a number of alternatives for the transmission infrastructure and recommended further study be conducted in order to select the best expansion plan. A second report was issued in April 2006, which narrowed and refined the transmission infrastructure alternatives submitted in the first report. The second report also recommended that in order to facilitate completion of the planning process further, detailed technical studies of the alternatives were to be performed by the California ISO.

The California ISO studied the Tehachapi Transmission Project as part of its California ISO South Regional Transmission Plan for 2006 (CSRTP-2006) in full collaboration with SCE and other CSRTP-2006 participants. The studies were "clustered", which allowed the California ISO to collectively assess the system impacts of a group of interconnection requests, rather than evaluate each potential generation facility individually. By "clustering" the interconnection request, a least-cost solution for the transmission infrastructure was determined to interconnect up to 4,350 MW of planned generation projects in the Tehachapi area to the California ISO-controlled grid. This transmission expansion plan was approved by the California ISO Board in January 2007.

### 1. Benefits of the Tehachapi Transmission Project

The benefits of the Tehachapi Transmission Project as approved by the California ISO Board in January 2007, are as follows:

1. The Tehachapi Transmission Project is the least-cost solution that reliably interconnects 4,350 MW of generating resources in the Tehachapi area.
2. The Tehachapi Transmission Project also addresses the reliability needs of the California ISO-controlled grid due to projected load growth in the Antelope Valley area and helps to address South of Lugo (SOL) transmission constraints — an ongoing source of reliability concern for the Los Angeles (LA) Basin.
3. The Tehachapi Transmission Project facilitates the ability of California utilities to comply with the state-mandated Renewables Portfolio Standard (RPS) by providing access to planned renewable resources in the Tehachapi Wind Resource Area (TWRA)





4. The Tehachapi Transmission Project is expected to provide economic benefits to the California ISO ratepayers, primarily by offering access to wind and other efficient generating resources under development in TWRA.
5. The Tehachapi Transmission Project makes it possible to expand the transfer capability of Path 26 in the near future with a low-cost upgrade of PG&E's portion of Midway-Vincent Line 3.
6. The Tehachapi Transmission Project will be used by other projects in the generation queue beyond the start date of the CSRTP-2006 for low-cost interconnection to the California ISO Controlled Grid.
7. Although the detailed planning has not yet been performed, the Tehachapi Transmission Project lays the groundwork for the integration of large amounts of planned geothermal, solar and wind generation in Inyo and northern San Bernardino counties with potential future 500 kV additions from the Wind Hub Substation (one of the Tehachapi Transmission Project's substations) to the Kramer Substation.

The Tehachapi Transmission Project will accommodate all targeted generation projects in the Tehachapi Area Generator queue. However, sufficient flexibility is built into the rollout of the Tehachapi Transmission Project to reasonably respond to changes in the magnitude and the location of generation resources in the area.





## 2. Project Description and Schedule

Figure G-1 depicts the major components of the Tehachapi Transmission Project at full build out in 2013, while Table G-1 sets forth the schedule for the rollout of the major components. Due to the expansive nature of the Tehachapi Transmission Project, the components of this infrastructure will be developed and put into service over a 5-year period starting in 2008. The addition of each component allows increased access to generation and ensures compliance with reliability standards given projected load growth in the area. This schedule is intended to be flexible and subject to change in response to actual wind generation development in the TWRA.

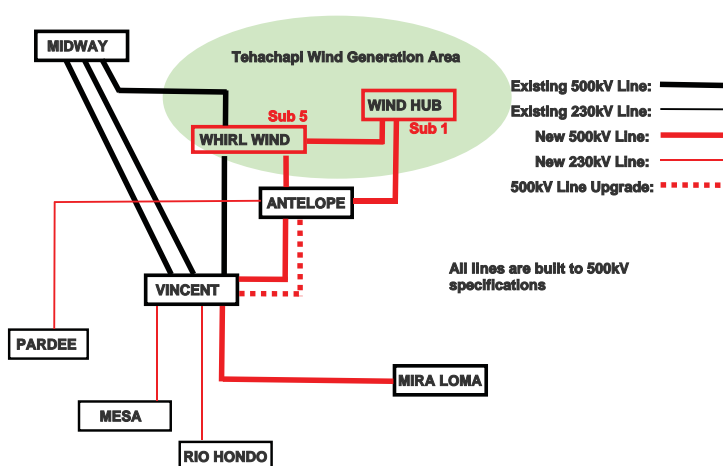


Figure G-1: Proposed Transmission Upgrades

## 3. New or Upgraded Substations

Three new substations would be constructed and used as collector stations for the wind farms in the TWRA: Wind Hub, Whirl Wind and High Wind Substations. The first two of the three new substations are part of the network component of the overall plan of service. The cost of the third substation (High Wind) is the responsibility of the wind developers and not included in the Tehachapi Transmission Project plan.

*Wind Hub 500/230/66 kV* will include up to four 500/230 kV transformer banks, four breaker-and-half 500 kV bus positions, six initial breaker-and-half 230 kV bus positions, static voltage support devices, and dynamic voltage support if necessary. Additional equipment will be added as wind generation develops in the region.

*Whirl Wind 500/230 kV* will include up to two 500/230 kV transformer banks, four breaker-and-half 500 kV bus positions, three initial breaker-and-half 230 kV bus positions, static voltage support devices and dynamic voltage support if necessary. It also includes loop in of Midway-Vincent #3 line to connect the substation to the grid. Additional equipment will be added as wind generation develops in the region.





#### 4. Upgrades to Existing Substations

- The Pardee 230/66 kV substation will be upgraded by outfitting existing 230 kV line position.
- The existing Mira Loma 500/230/66 kV substation will be upgraded by outfitting existing 500 kV line position.
- The existing 230/66 kV Antelope Substation will be expanded to include a new 500 kV switchyard, additional 230 kV line positions and static and dynamic voltage support.
- The existing 500/230 kV Vincent Substation will be expanded to include additional 500 kV and 230 kV line positions, additional static and dynamic voltage support and additional 500/230 kV bank capacity.
- The Mesa 230/66 kV substation will be upgraded by outfitting existing 230 kV line position.
- The Gould 230/66 kV substation will be upgraded by outfitting existing 230 kV line position.







## 5. New or Upgraded Transmission Lines

- New 25.6-mile 500 kV transmission line between Antelope and Pardee substations initially operated at 230 kV. This line is also known as Phase 1-Segment 1 of the original Antelope Transmission Project. Construction to 500 kV specifications with initial operation at 230 kV is required to maximize the capability of limited transmission corridors and minimize environmental impacts associated with multiple 230 kV lines and/or multiple teardown and rebuild activities. Actual operation of 500 kV will be determined by the amount of generation build out in the system and changes to system conditions.
- New 25.6-mile 500 kV transmission line between Wind Hub and Antelope substations. This line is also known as Phase 1-Segment 3 of the original Antelope Transmission Project and will initially operate at 230 kV.
- Two new 500 kV transmission lines between Antelope and Vincent substations. The initial 500 kV transmission line will be approximately 21 miles, built on new right-of-way, mostly adjacent to the existing right-of-way. This line is also known as the Phase 1-Segment 2 of the original Antelope Transmission Project and will initially operate at 230 kV. This new transmission line is primarily required to meet the reliability needs of the California ISO-controlled Grid due to projected load growth in Antelope Valley. The second 500 kV transmission line will be approximately 18 miles, built on existing right-of-way, replacing the existing Antelope-Vincent and Antelope-Mesa 230 kV transmission lines. This transmission line will also be initially operated at 230 kV.
- New 75-mile 500 kV transmission line between Vincent and Mira Loma substations. This transmission line is required to eliminate the South of Lugo transmission constraints, which have been a source of ongoing reliability concern for the L.A. basin, especially in light of projected load growth in the Mira Loma area, and is planned to go into service by the 2012 time frame. This line will utilize the existing Vincent-Rio Hondo No. 2 230 kV transmission line (portion already built to 500 kV standards), a portion of the existing Antelope-Mesa 230 kV South of Vincent, portions of existing idle 230 kV transmission line segments, and portions of new construction between the Mesa area and Mira Loma area. Between Vincent and the northern boundary of the City of Duarte (adjacent to Angeles National Forest), the transmission line will be constructed as single-circuit 500 kV specifications. From this point to the Mira Loma area, the transmission line will be constructed as double circuit 500 kV specifications to maximize the capability of limited corridors and to minimize environmental impacts associated with multiple 230 kV lines and/or multiple tear-down and rebuild activities.
- New 32.5-mile 500/230 kV transmission line between Vincent and Rio Hondo is required to replace the existing Vincent-Rio Hondo No.2 230 kV transmission line that was utilized for the new Vincent-Mira Loma 500 kV transmission line. This line will utilize a portion of the existing Antelope-Mesa 230 kV transmission line and will be built to 500 kV specifications to maximize capability of limited transmission corridors, avoid waste and minimize environmental impacts associated with multiple 230 kV transmission lines and/or multiple tear-down and rebuild activities. As discussed above, such construction





standard will allow for a future low cost upgrade to 500 kV operation.

- New 14-mile 500 kV transmission line between proposed Whirl Wind and the upgraded Antelope substations.
- New 42-mile 500/230 kV transmission line between Vincent and Mesa substations. Between Vincent and the Gould substation areas, this line will be built to 500 kV specifications to maximize capability of limited transmission corridors and minimize environmental impacts associated with multiple 230 kV transmission lines and/or multiple tear-down and rebuild activities and to allow for future low cost upgrade to 500 kV operation.


*Table G-1: Tehachapi Transmission Project Plan of Services*

<b>Major Transmission Facilities</b>	<b>Planned In-Service Date</b>
Antelope – Pardee 230 kV Line (500 kV specifications) & Antelope Substation expansion	Dec. 2008
Antelope – Vincent 230 kV Line #1 (500 kV specifications)	Mar. 2009
Wind Hub Substation	Mar. 2009
Antelope – Wind Hub (also known as Substation 1) 230 kV Line (500 kV specifications)	Mar. 2009
Antelope – Vincent 230 kV Line #2 (500 kV specifications)	Mar. 2011
Low Wind 500/230 kV Substation (also known as Substation 5) with Loop in of Midway – Vincent #3 500 kV line	Aug. 2011
Antelope – Whirl Wind 500kV line	Aug. 2011
Wind Hub Substation 500 kV upgrade	Mar. 2011
Antelope Substation 500 kV upgrade	Mar. 2011
Vincent Substation 500 kV & 220 kV upgrade	Sep. 2011
Whirl Wind – Wind Hub 500 kV line	Oct. 2011
Replacement of Vincent – Rio Hondo No. 2 230kV line	Nov. 2011
Vincent – Mira Loma 500 kV line	Apr. 2012
Vincent – Mesa 500/220 kV line and Mesa Substation work	Nov. 2013

## 6. List of Reactive Devices Required in the Tehachapi Area

In order to support 4,350 MW of generation in the Tehachapi area, a significant amount of reactive devices would be required. So far, studies done using a summer peak scenario identified the requirement for 2,000 MVARS of static shunt capacitors and 600 MVARS of SVC.





### ***6.1 Static MVAR Requirement — 2,000 MVARs***

- Vincent 500kV 400 MVAR shunt
- Antelope 500kV 400 MVAR shunt
- Sub. 5 (Whirl Wind) 500 kV 2x200 MVAR shunt
- Sub. 5 (Whirl Wind) 230 kV 2x100 MVAR shunt
- Sub. 1 (Wind Hub) 500 kV 2x200 MVAR shunt
- Sub. 1 (Wind Hub) 230 kV 2x100 MVAR shunt


### ***6.2 Dynamic MVAR Requirement — 800 MVARs***

- Vincent 500 kV 600 MVAR SVC
- Antelope 500 kV 200 MVAR SVC





Tehachapi Transmission Project Plan of Service (Routes shown are for illustration purposes only)

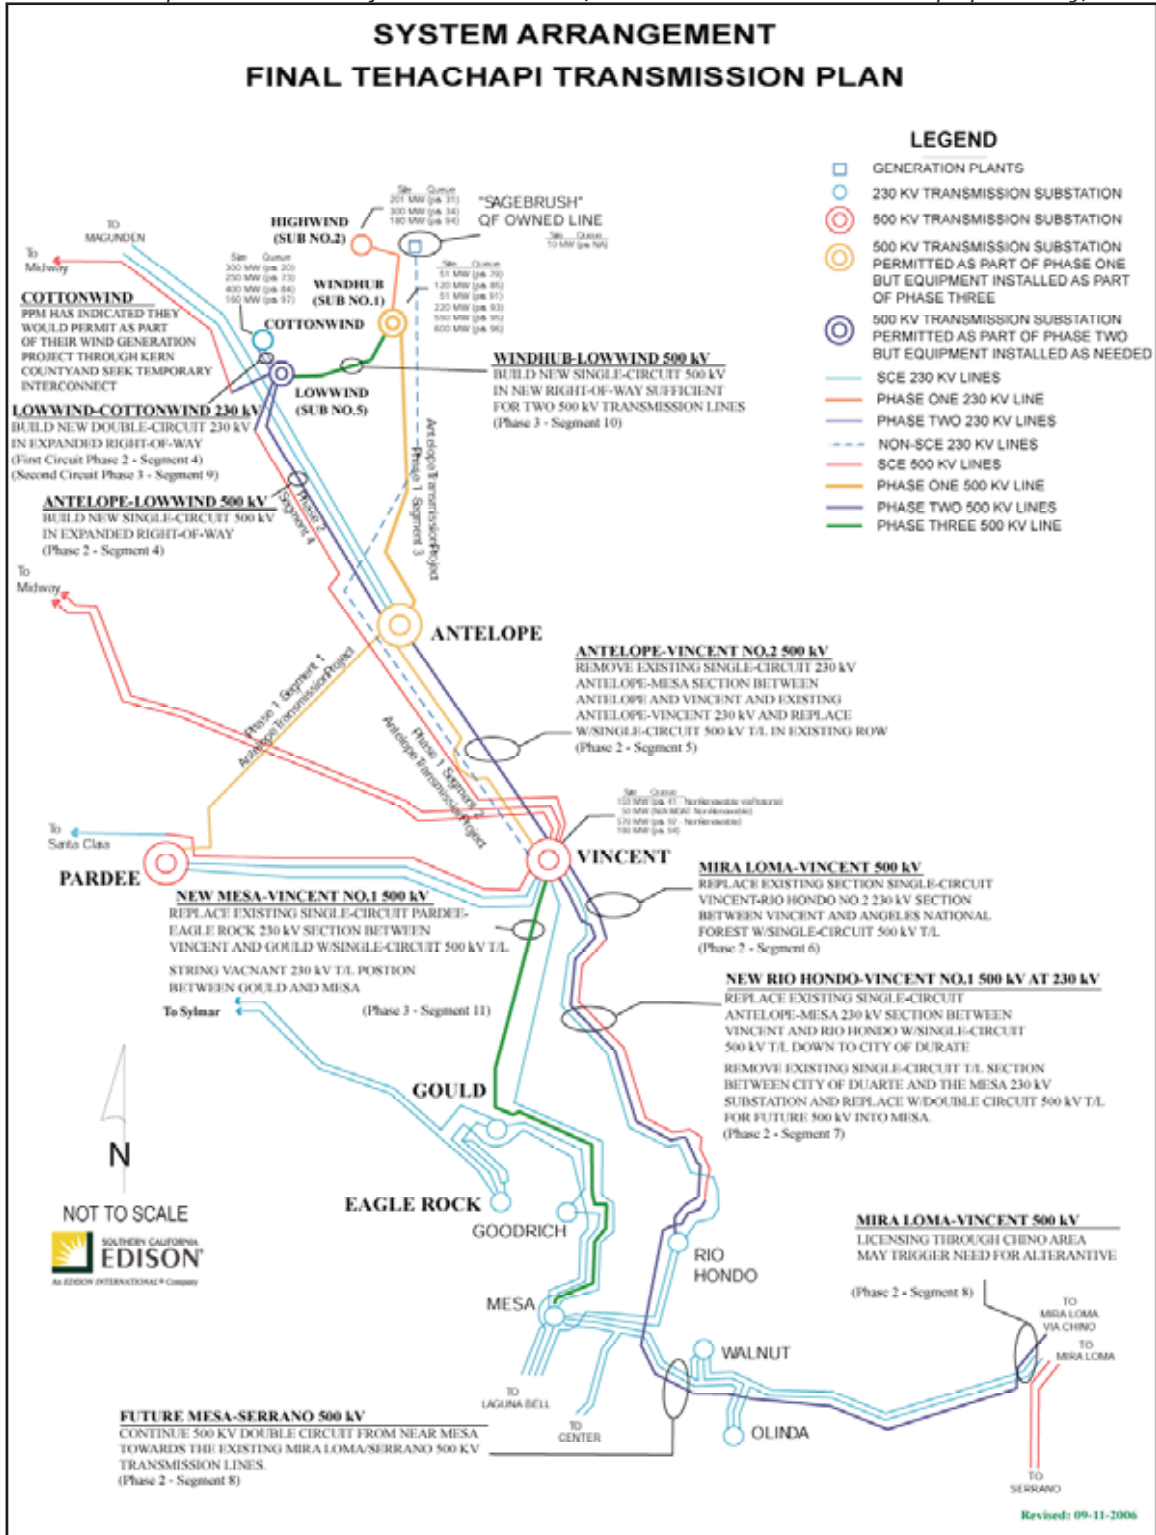



## Appendix H — Transient Stability Plots

As stated in Chapter 3, one of the primary objectives of the transmission system analysis was to evaluate the transient stability performance of the California ISO-controlled Grid with an increased level of wind generation in the Tehachapi area.

The baseline analysis for all studies was performed assuming that all new wind plants would be equipped with the WECC Type 3 doubly fed wind turbine generators. The existing wind plants in the Tehachapi area were modeled as WECC Type 1 conventional induction generators. A total of 25 contingencies (11 Category B<sup>1</sup> and 14 Category C<sup>2</sup>) were simulated for each of the seasonal wind generation scenarios and three wind conditions (full, low and no wind). In addition, several sensitivity studies were performed by varying the mix of the WTG technologies of the new plants based on the actual installations of new wind plants in the U.S. in 2006. The simulation consists of time-domain simulation following the disturbances to evaluate the system transient stability performance of the Grid based on “WECC Planning Standards, WECC Disturbance-Performance Allowable Effects on Other Systems.”

The following plots are self explanatory and show six of the contingencies studied:

1. Heavy Summer: Loss of two Midway-Vincent 500 kV lines. 3-phase, 4-cycle fault at Midway 500 kV substation. Blue: Full wind, Red: Low wind and Green: No wind. (Refer to H-2 to H-9).
2. Heavy Summer: Loss of two Palo Verde generators. Blue: Full wind, Red: Low wind and Green: No wind. (Refer to H-10 to H-17).
3. Heavy Summer: Loss of the PDCI bipolar with north to south flows. Blue: Full wind, Red: Low wind and Green: No wind. (Refer to H-18 to H-25).
4. Heavy Summer: Sensitivity of system performance to WTG technology for the Midway-Vincent double line outage. 3-phase, 4-cycle fault at Midway 500 kV substation. Blue: Type 3 doubly fed induction generators, Red: Mixed technology and Green: Type 1 induction generators. (Refer to H-26 to H-33).
5. Light Spring: Loss of two Lugo-Vincent 500 kV lines. 3-phase, 4-cycle fault at Lugo 500 kV substation. Blue: Full wind, Red: Low wind and Green: No wind. (Refer to H-34 to H-41).
6. Light Spring: Loss of two Midway-Vincent 500 kV lines. 3-phase, 4-cycle fault at Midway 500 kV substation. Blue: Full wind, Red: Low wind and Green: No wind. (Refer to H-42 to H-49).

<sup>1</sup> Category B is the loss of a single element.









<sup>2</sup> Category C is event(s) resulting in the loss of two or more (multiple) elements.





### 500kV Voltages


Full Wind, Lo Wind, No Wind for Fault: 2010hs-Midway-Vincent-dlo-SPS

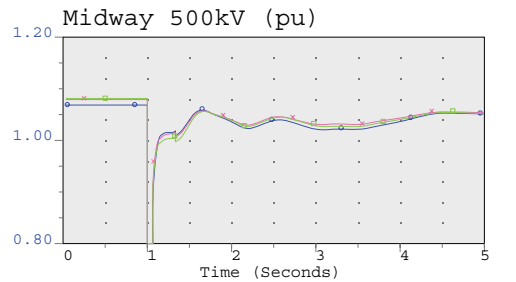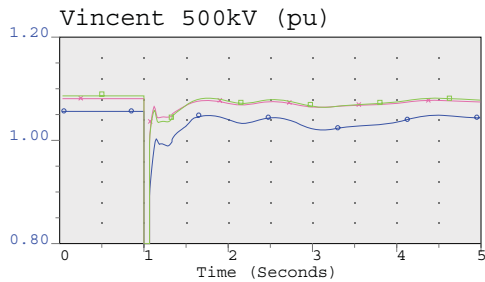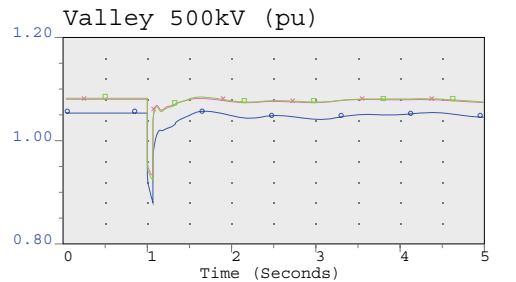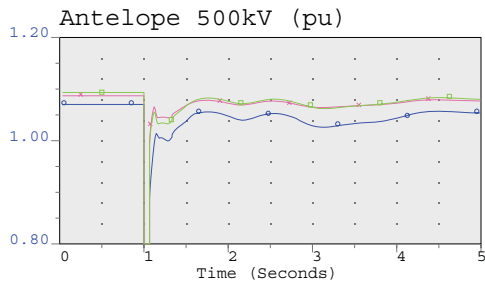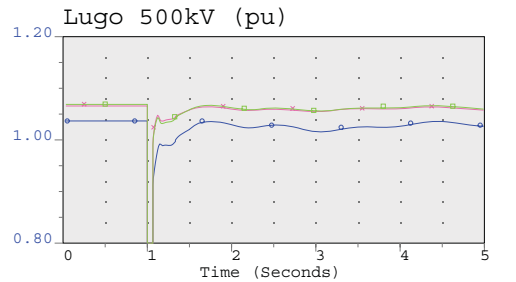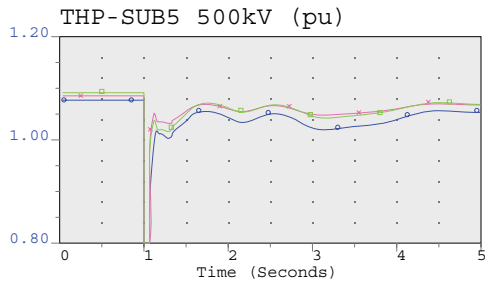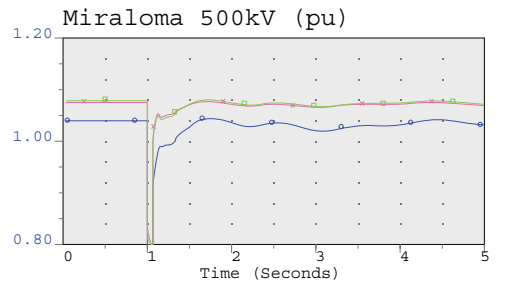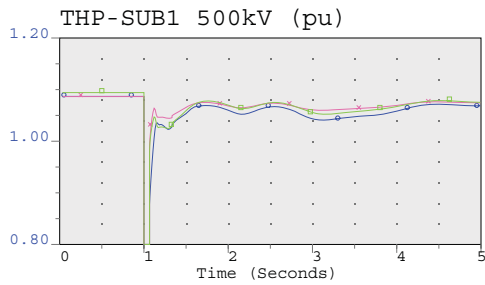



2010 HEAVY SUMMER POWER FLOW CASE  
 SUNRISE + TEHACHAPI PROJECTS - JULY 3, 2007  
 CAISO & GE COLLABORATIVE WIND STUDY  
 UPDATED NEW & EXISTING TEHACHAPI WIND GENERATION  
 3 phase 4 cycle fault at Midway  
 Loss of 2 Midway - Vincent Lines  
 No SPS

a:2010hs-FullWind-Midway-Vincent-dlo-SPS.chf  
 b:2010hs-LoWind-Midway-Vincent-dlo-SPS.chf  
 c:2010hs-NoWind-Midway-Vincent-dlo-SPS.chf


d:\projects\caiso  
 Wed Aug 22 11:21:14 2007





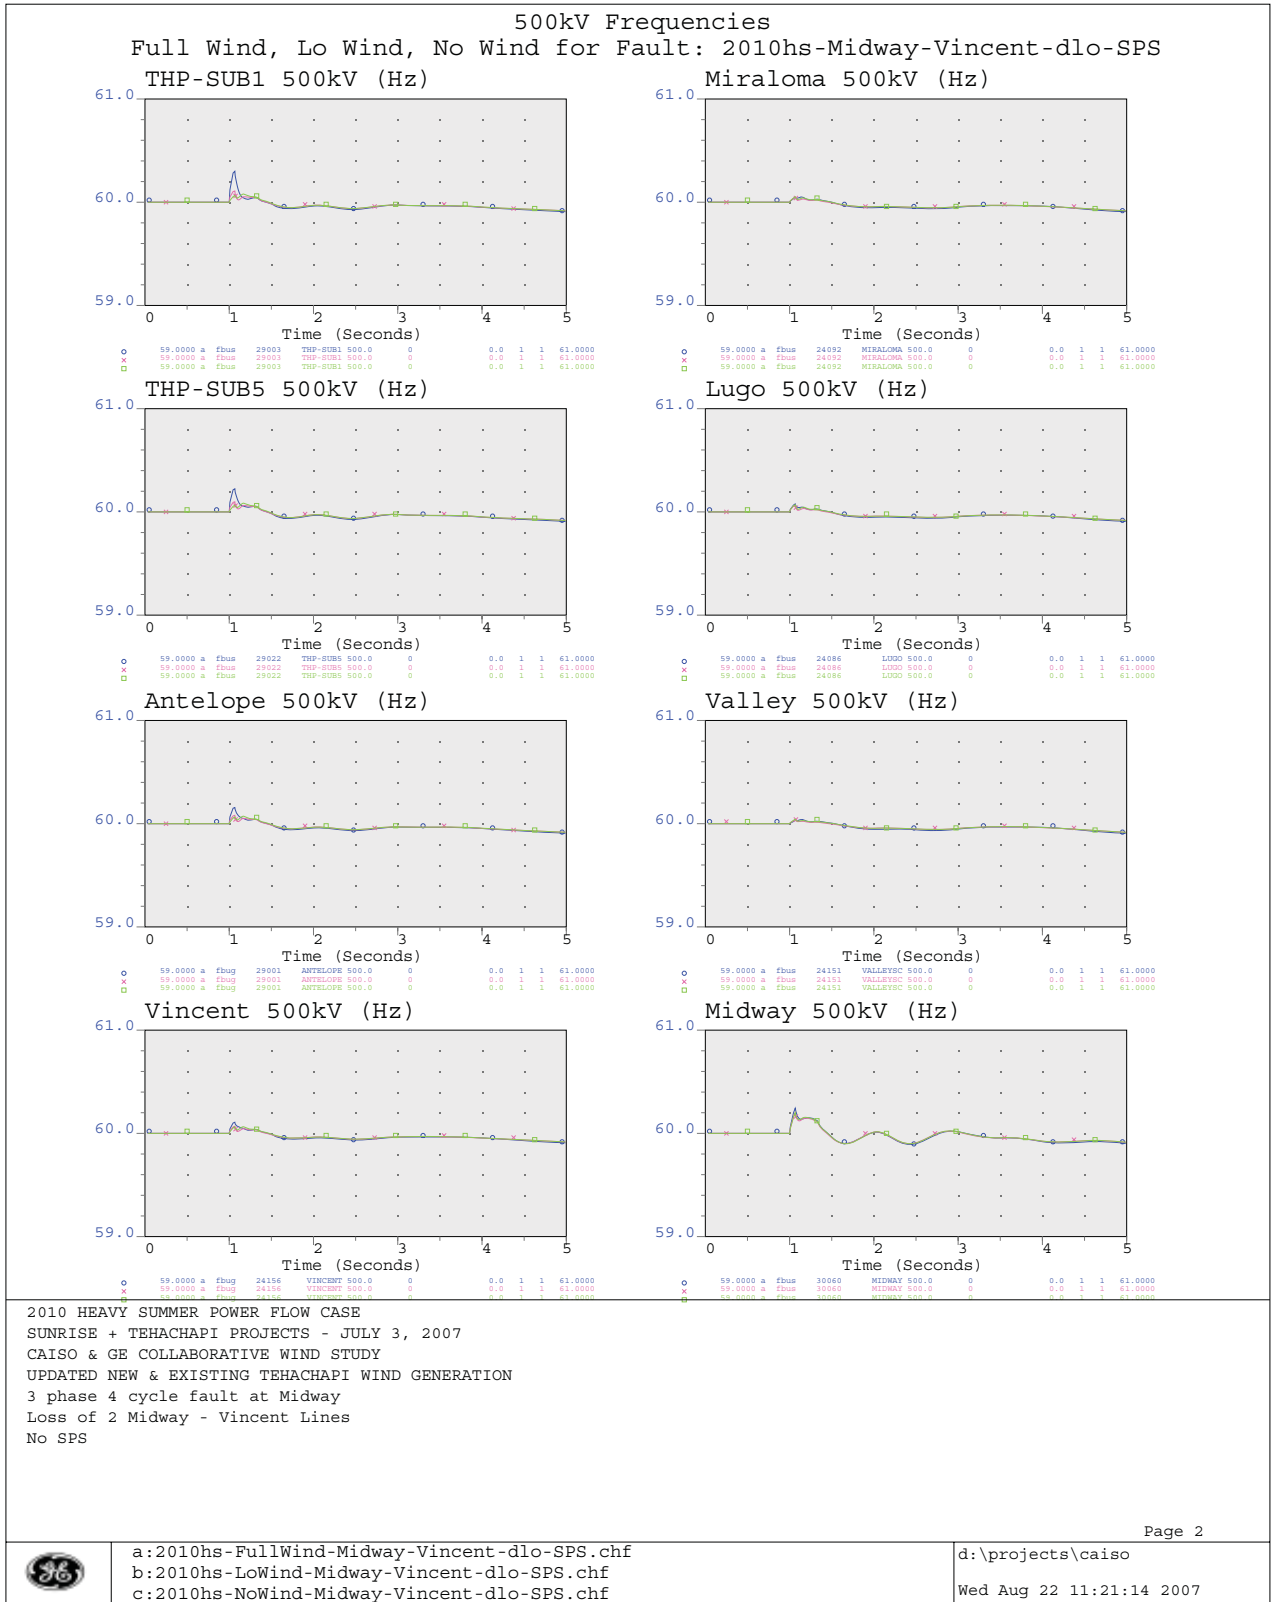



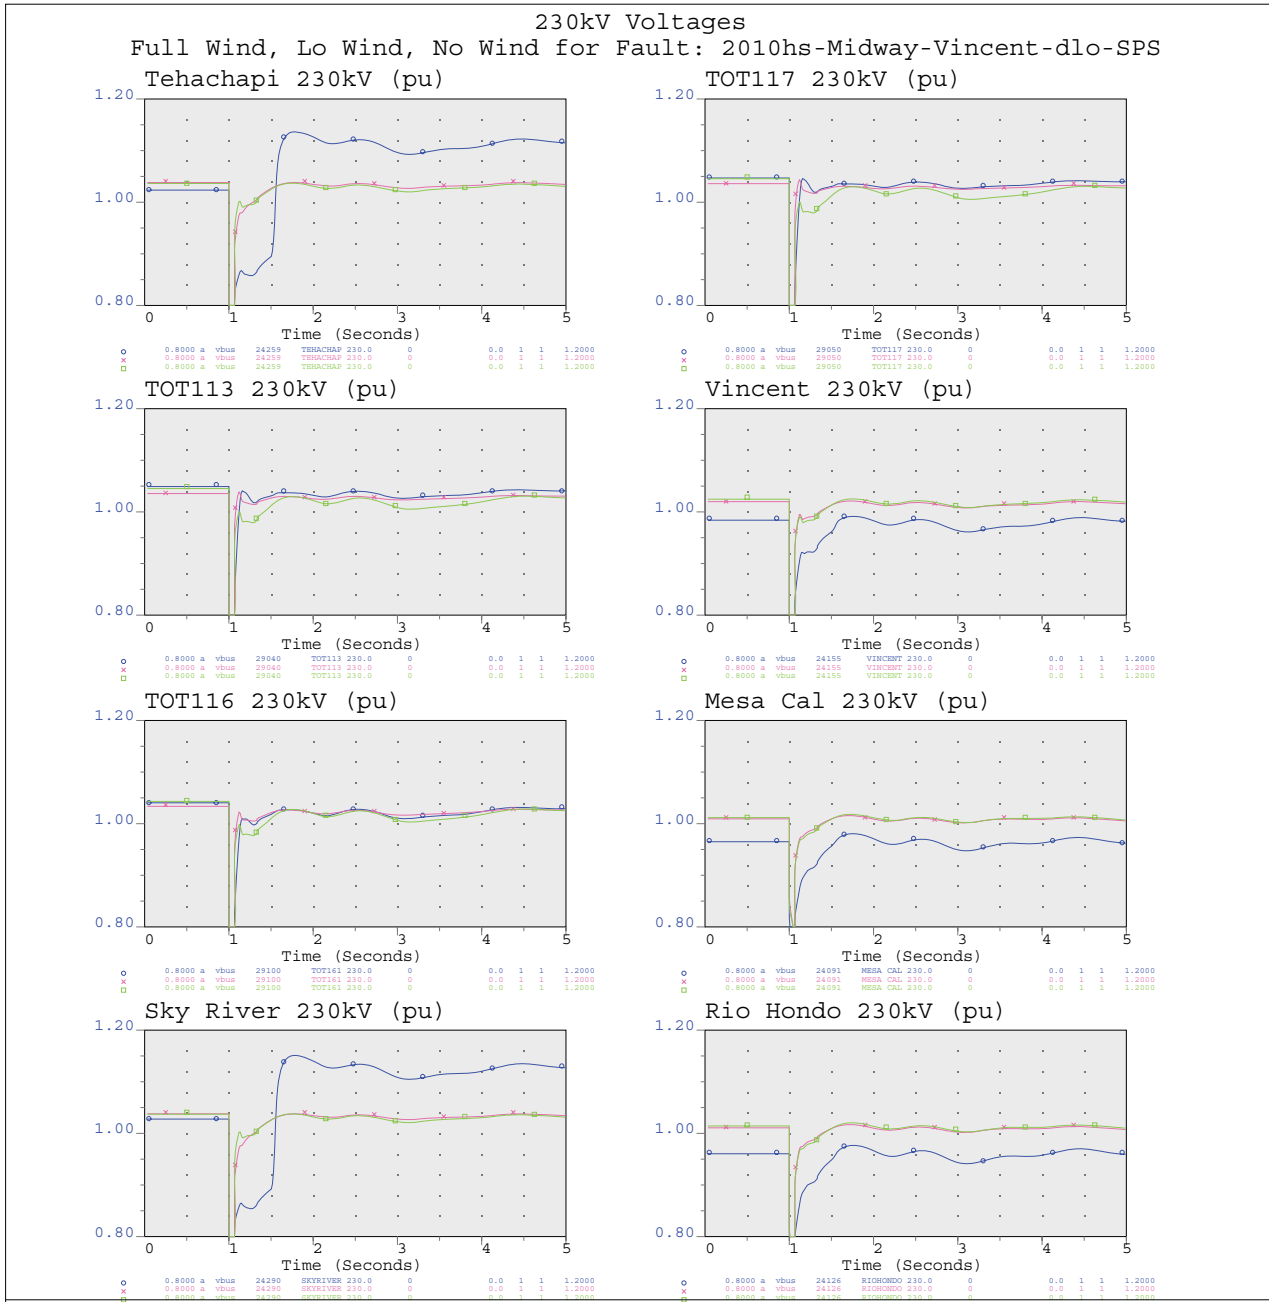




2010 HEAVY SUMMER POWER FLOW CASE  
 SUNRISE + TEHACHAPI PROJECTS - JULY 3, 2007  
 CAISO & GE COLLABORATIVE WIND STUDY  
 UPDATED NEW & EXISTING TEHACHAPI WIND GENERATION  
 3 phase 4 cycle fault at Midway  
 Loss of 2 Midway - Vincent Lines  
 No SPS



a:2010hs-FullWind-Midway-Vincent-dlo-SPS.chf  
 b:2010hs-LoWind-Midway-Vincent-dlo-SPS.chf  
 c:2010hs-NoWind-Midway-Vincent-dlo-SPS.chf







d:\projects\caiso  
 Wed Aug 22 11:21:14 2007



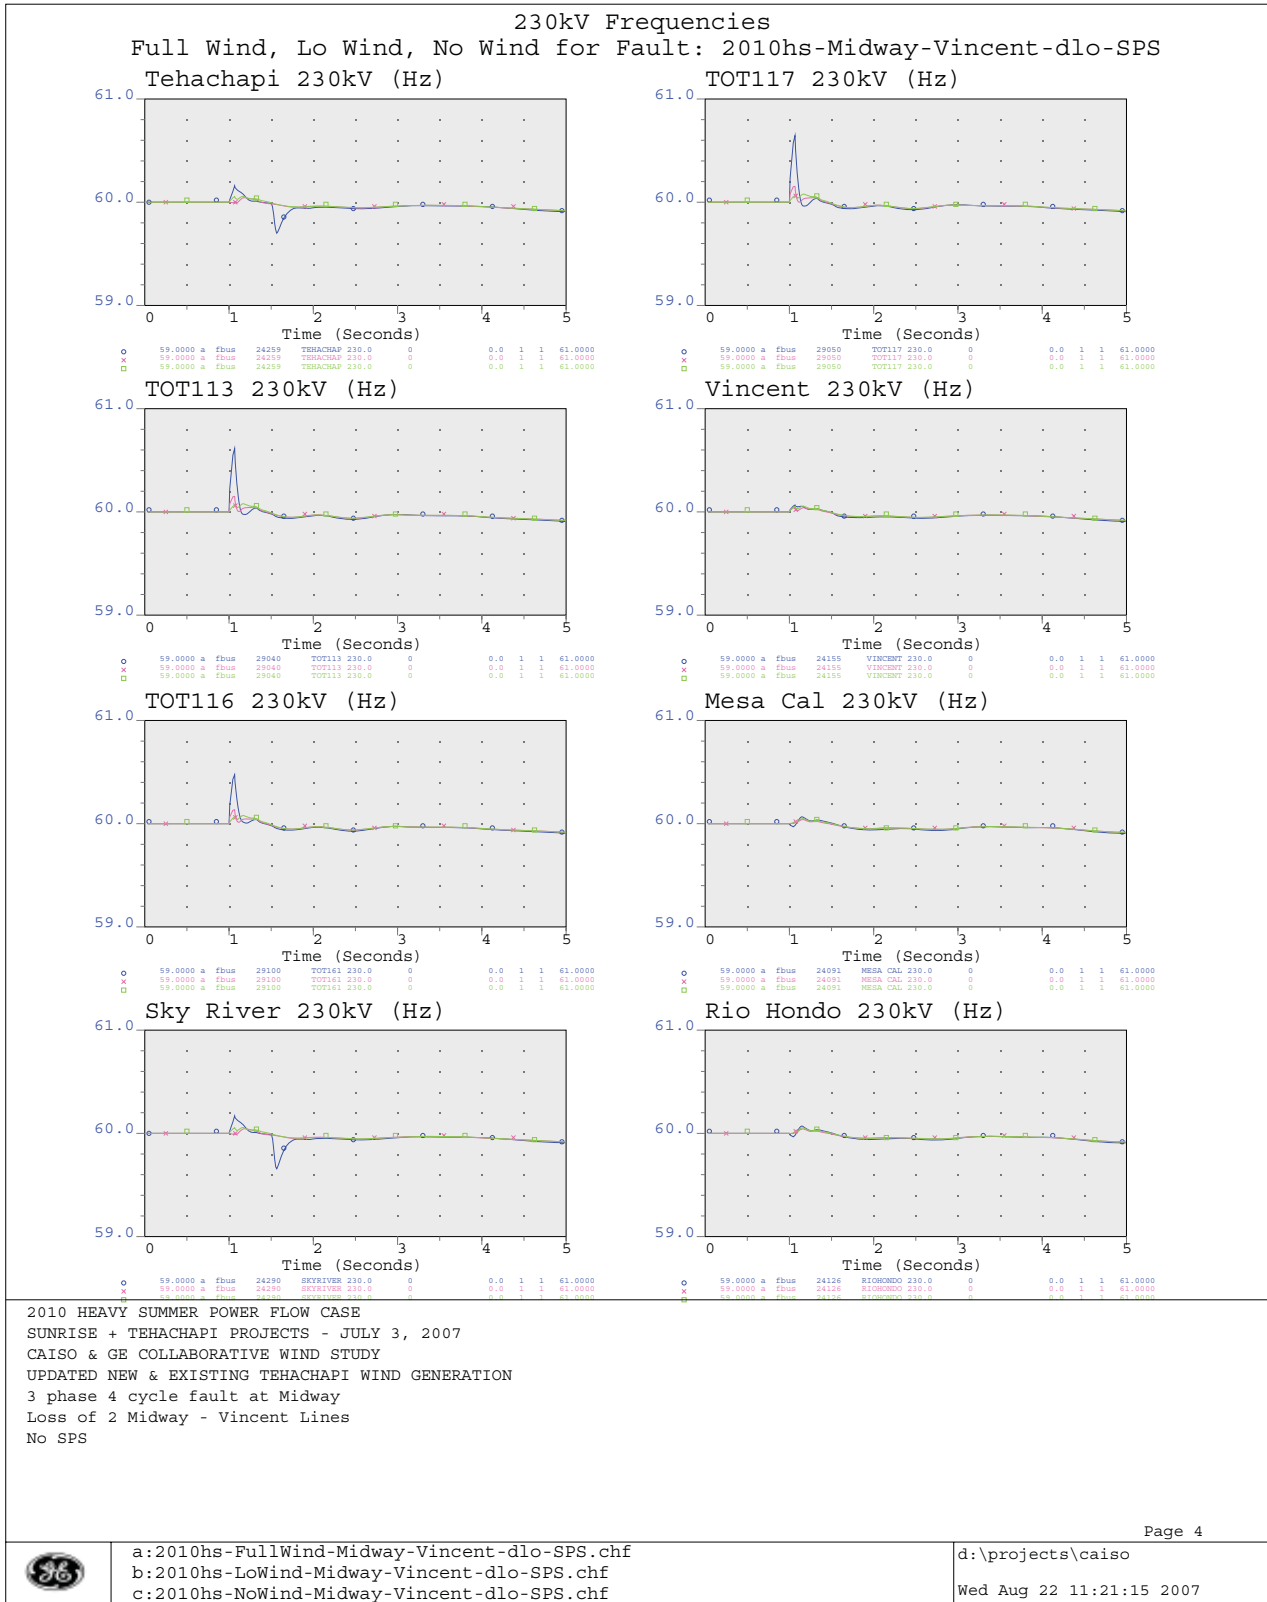



500kV Real Power Flows  
Full Wind, Lo Wind, No Wind for Fault: 2010hs-Midway-Vincent-dlo-SPS

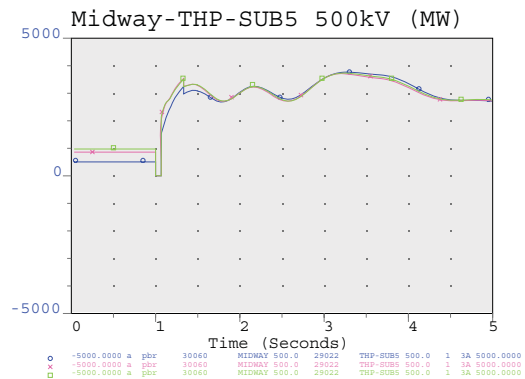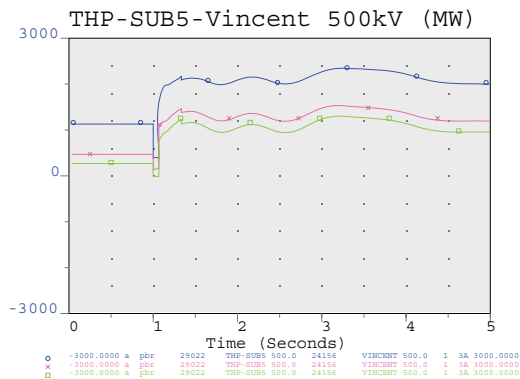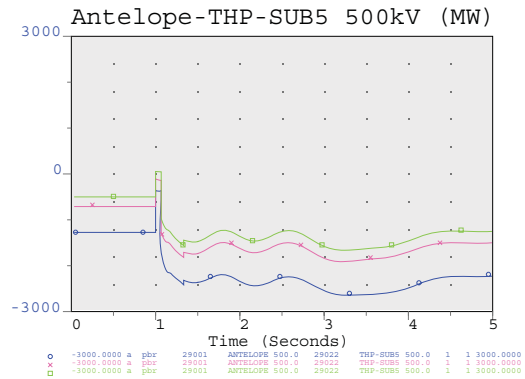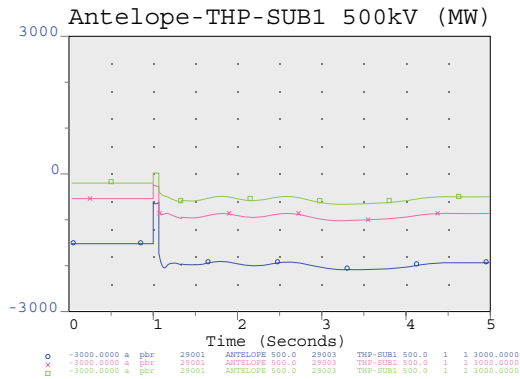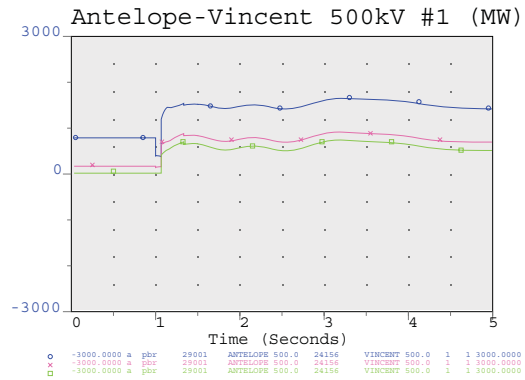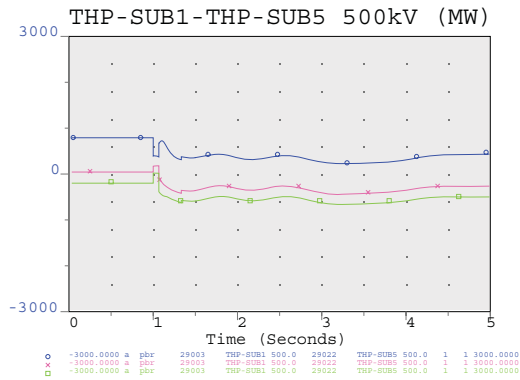


2010 HEAVY SUMMER POWER FLOW CASE  
SUNRISE + TEHACHAPI PROJECTS - JULY 3, 2007  
CAISO & GE COLLABORATIVE WIND STUDY  
UPDATED NEW & EXISTING TEHACHAPI WIND GENERATION  
3 phase 4 cycle fault at Midway  
Loss of 2 Midway - Vincent Lines  
No SPS









a:2010hs-FullWind-Midway-Vincent-dlo-SPS.chf  
b:2010hs-LoWind-Midway-Vincent-dlo-SPS.chf  
c:2010hs-NoWind-Midway-Vincent-dlo-SPS.chf

d:\projects\caiso  
Wed Aug 22 11:21:15 2007





500kV Reactive Power Flows  
Full Wind, Lo Wind, No Wind for Fault: 2010hs-Midway-Vincent-dlo-SPS

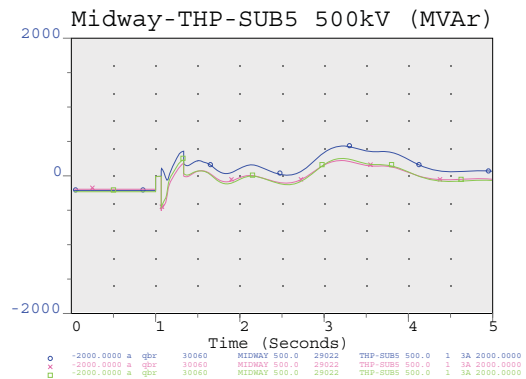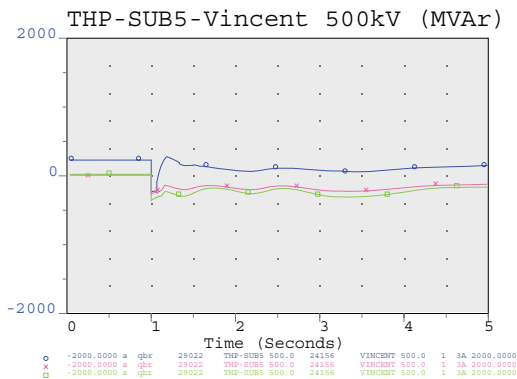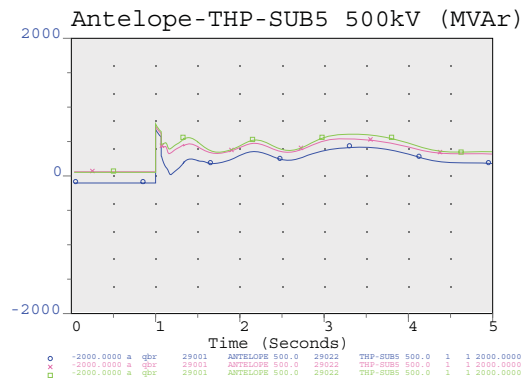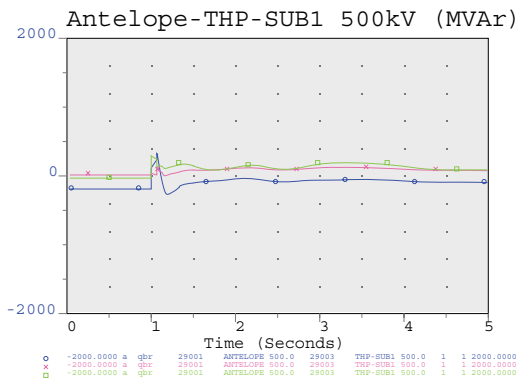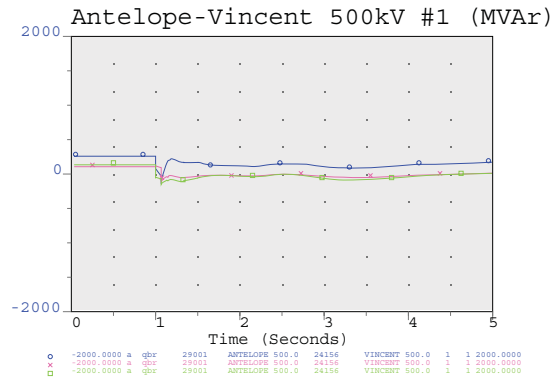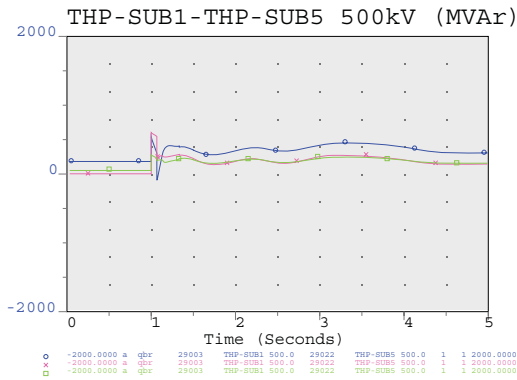

2010 HEAVY SUMMER POWER FLOW CASE  
 SUNRISE + TEHACHAPI PROJECTS - JULY 3, 2007  
 CAISO & GE COLLABORATIVE WIND STUDY  
 UPDATED NEW & EXISTING TEHACHAPI WIND GENERATION  
 3 phase 4 cycle fault at Midway  
 Loss of 2 Midway - Vincent Lines  
 No SPS











a:2010hs-FullWind-Midway-Vincent-dlo-SPS.chf  
 b:2010hs-LoWind-Midway-Vincent-dlo-SPS.chf  
 c:2010hs-NoWind-Midway-Vincent-dlo-SPS.chf

d:\projects\caiso  
 Wed Aug 22 11:21:15 2007





**Interface Power Flows**  
**Full Wind, Lo Wind, No Wind for Fault: 2010hs-Midway-Vincent-dlo-SPS**

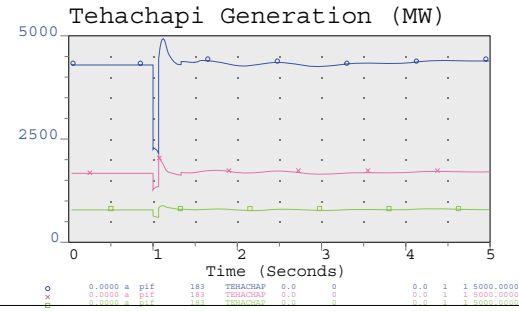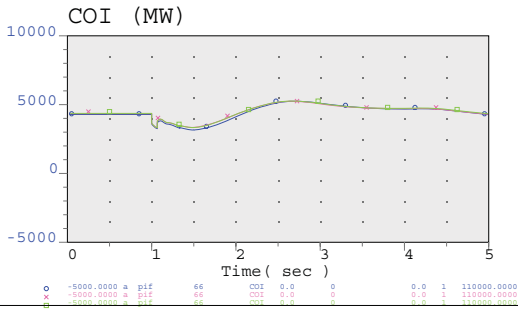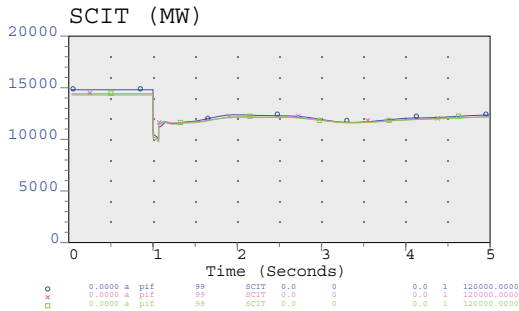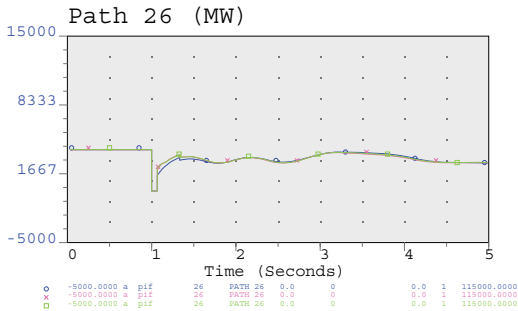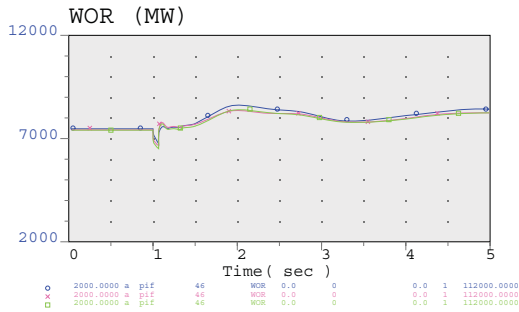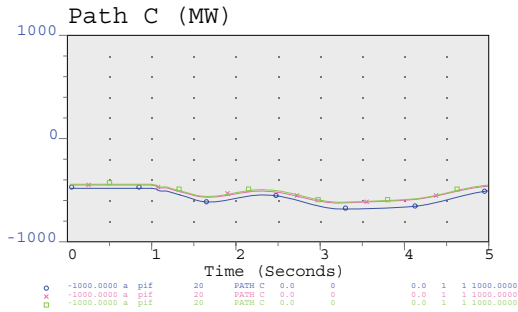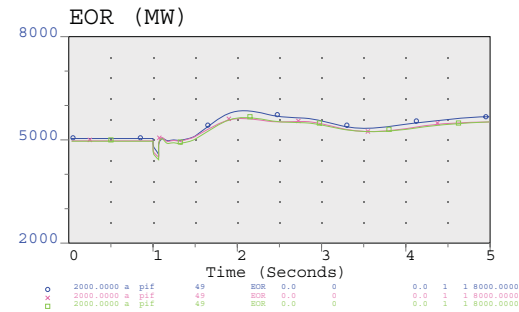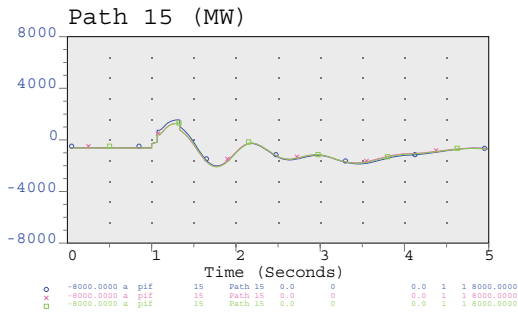


2010 HEAVY SUMMER POWER FLOW CASE  
 SUNRISE + TEHACHAPI PROJECTS - JULY 3, 2007  
 CAISO & GE COLLABORATIVE WIND STUDY  
 UPDATED NEW & EXISTING TEHACHAPI WIND GENERATION  
 3 phase 4 cycle fault at Midway  
 Loss of 2 Midway - Vincent Lines  
 No SPS









a:2010hs-FullWind-Midway-Vincent-dlo-SPS.chf  
 b:2010hs-LoWind-Midway-Vincent-dlo-SPS.chf  
 c:2010hs-NoWind-Midway-Vincent-dlo-SPS.chf

d:\projects\caiso  
 Wed Aug 22 11:21:15 2007





**SVC Variables**  
 Full Wind, Lo Wind, No Wind for Fault: 2010hs-Midway-Vincent-dlo-SPS

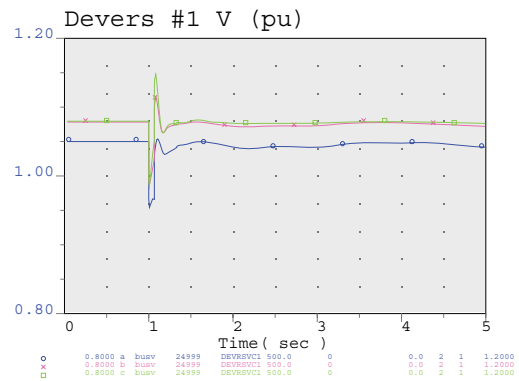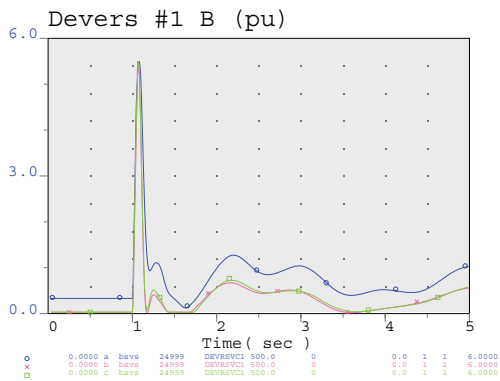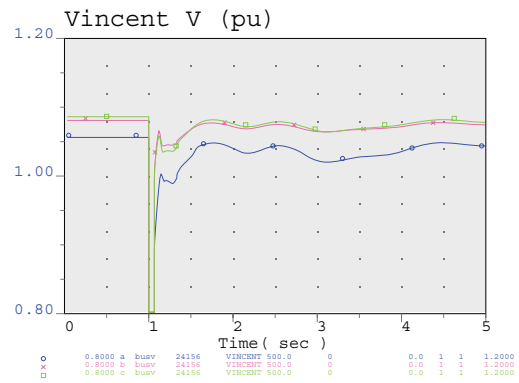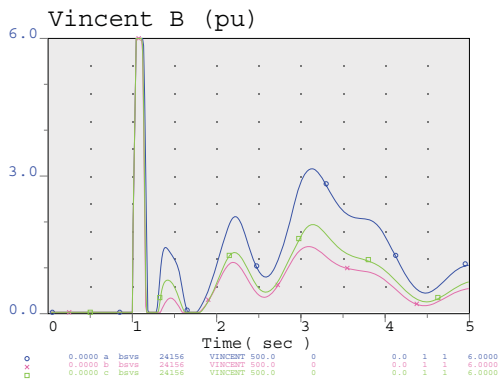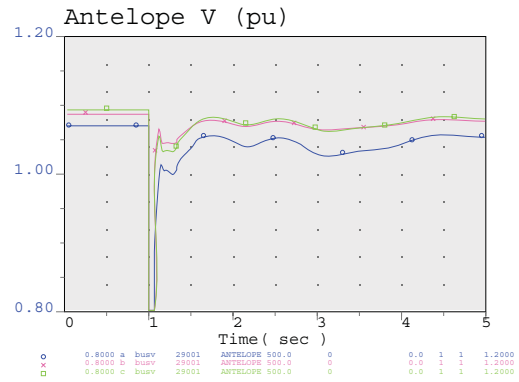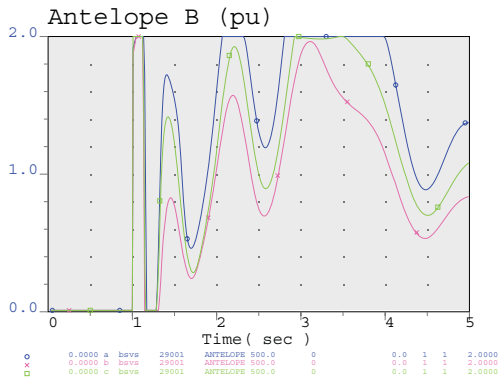

2010 HEAVY SUMMER POWER FLOW CASE  
 SUNRISE + TEHACHAPI PROJECTS - JULY 3, 2007  
 CAISO & GE COLLABORATIVE WIND STUDY  
 UPDATED NEW & EXISTING TEHACHAPI WIND GENERATION  
 3 phase 4 cycle fault at Midway  
 Loss of 2 Midway - Vincent Lines  
 No SPS



a:2010hs-FullWind-Midway-Vincent-dlo-SPS.chf  
 b:2010hs-LoWind-Midway-Vincent-dlo-SPS.chf  
 c:2010hs-NoWind-Midway-Vincent-dlo-SPS.chf


d:\projects\caiso  
 Wed Aug 22 11:21:15 2007






### 500kV Voltages


Full Wind, Lo Wind, No Wind for Fault: 2010hs-PaloVerde-g2-svc

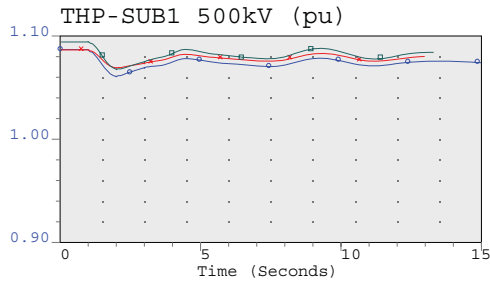


0.9000 a Vbus 29003 THP-SUB1 500.0 0 0.0 1 1 1.1000  
0.9000 a Vbus 29001 THP-SUB1 500.0 0 0.0 1 1 1.1000  
0.9000 a Vbus 29003 THP-SUB1 500.0 0 0.0 1 1 1.1000

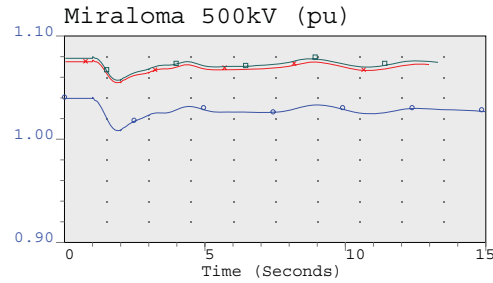


0.9000 a Vbus 24092 MIRALOMA 500.0 0 0.0 1 1 1.1000  
0.9000 a Vbus 24092 MIRALOMA 500.0 0 0.0 1 1 1.1000  
0.9000 a Vbus 24092 MIRALOMA 500.0 0 0.0 1 1 1.1000

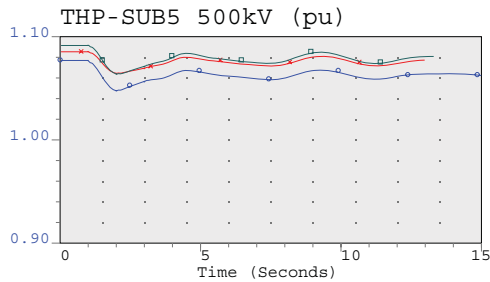


0.9000 a Vbus 29022 THP-SUB5 500.0 0 0.0 1 1 1.1000  
0.9000 a Vbus 29022 THP-SUB5 500.0 0 0.0 1 1 1.1000  
0.9000 a Vbus 29022 THP-SUB5 500.0 0 0.0 1 1 1.1000

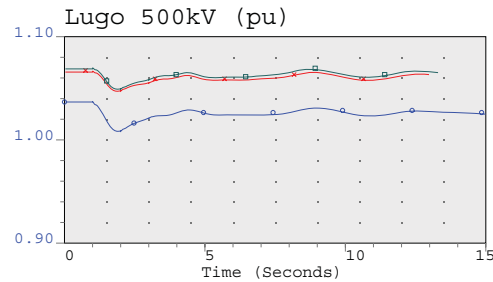


0.9000 a Vbus 24086 LUGO 500.0 0 0.0 1 1 1.1000  
0.9000 a Vbus 24086 LUGO 500.0 0 0.0 1 1 1.1000  
0.9000 a Vbus 24086 LUGO 500.0 0 0.0 1 1 1.1000

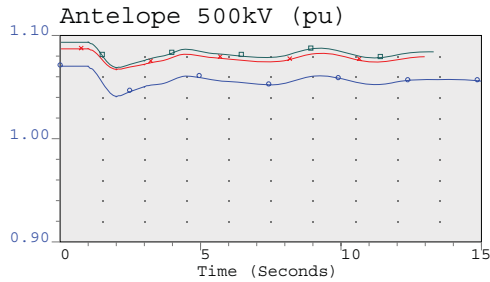


0.9000 a Vbus 29001 ANTELOPE 500.0 0 0.0 1 1 1.1000  
0.9000 a Vbus 29001 ANTELOPE 500.0 0 0.0 1 1 1.1000  
0.9000 a Vbus 29001 ANTELOPE 500.0 0 0.0 1 1 1.1000

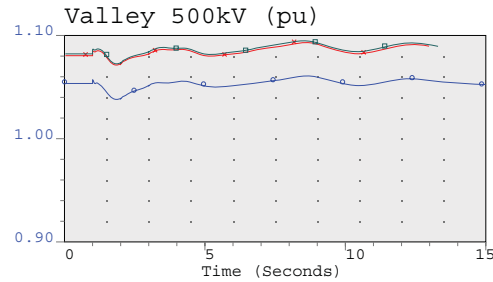


0.9000 a Vbus 24151 VALLEYS 500.0 0 0.0 1 1 1.1000  
0.9000 a Vbus 24151 VALLEYS 500.0 0 0.0 1 1 1.1000  
0.9000 a Vbus 24151 VALLEYS 500.0 0 0.0 1 1 1.1000

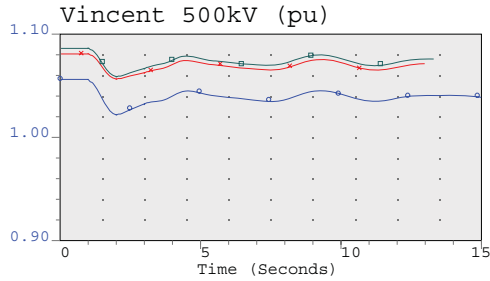


0.9000 a Vbus 24156 VINCENT 500.0 0 0.0 1 1 1.1000  
0.9000 a Vbus 24156 VINCENT 500.0 0 0.0 1 1 1.1000  
0.9000 a Vbus 24156 VINCENT 500.0 0 0.0 1 1 1.1000

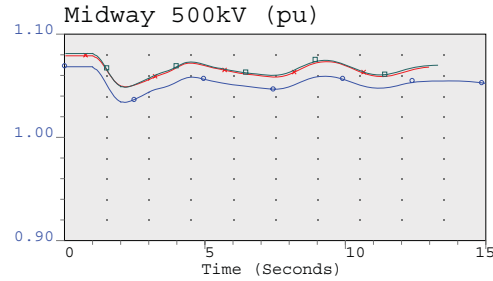

0.9000 a Vbus 30060 MIDWAY 500.0 0 0.0 1 1 1.1000  
0.9000 a Vbus 30060 MIDWAY 500.0 0 0.0 1 1 1.1000  
0.9000 a Vbus 30060 MIDWAY 500.0 0 0.0 1 1 1.1000















### 500kV Frequencies

Full Wind, Lo Wind, No Wind for Fault: 2010hs-PaloVerde-g2-svc

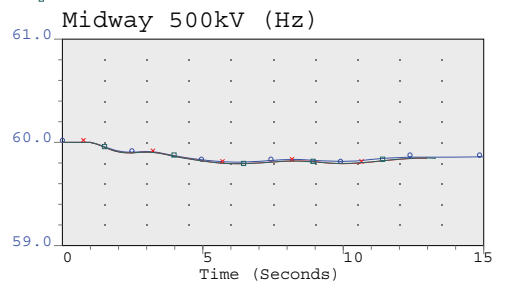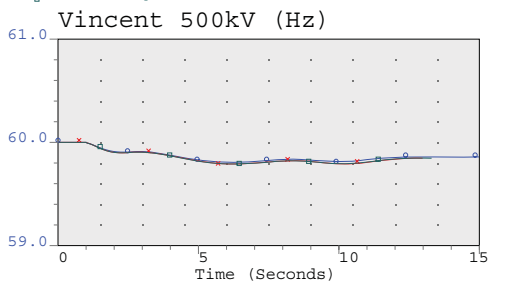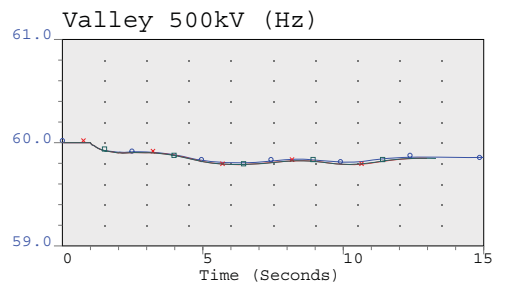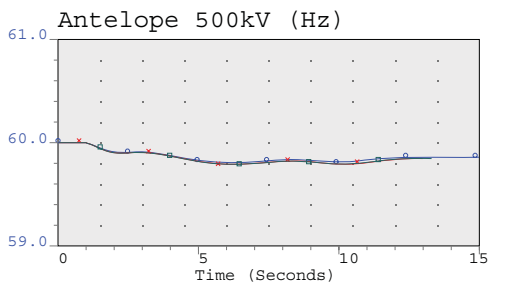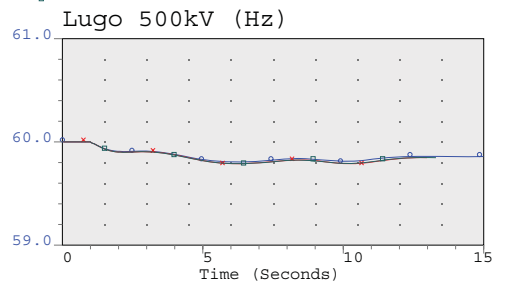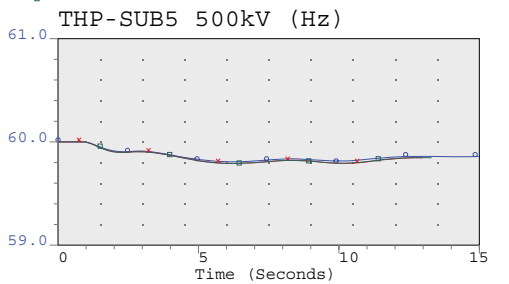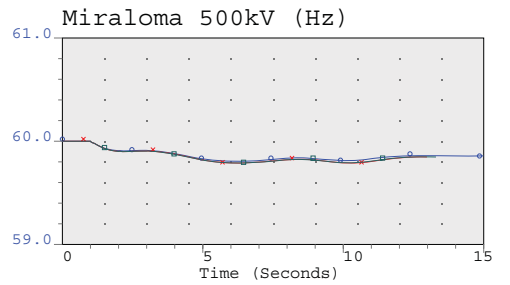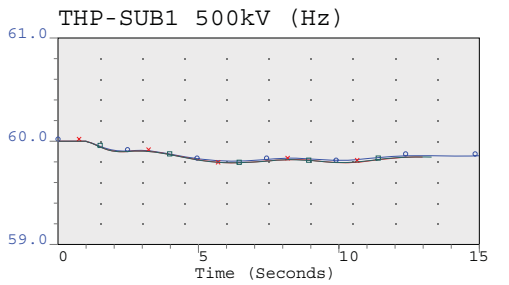

a:2010hs-FullWind-PaloVerde-g2-svc.chf  
 b:2010hs-LoWind-PaloVerde-g2-svc.chf  
 c:2010hs-NoWind-PaloVerde-g2-svc.chf


d:\projects\caiso  
 Wed Aug 22 11:15:41 2007






### 230kV Voltages


Full Wind, Lo Wind, No Wind for Fault: 2010hs-PaloVerde-g2-svc

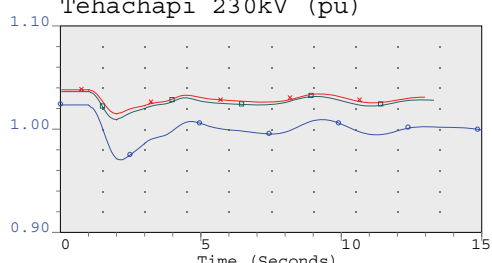


o	0.9000	a	vbus	24259	TEHACHAP	230.0	0	0.0	1	1	1.1000
x	0.9000	a	vbus	24259	TEHACHAP	230.0	0	0.0	1	1	1.1000
d	0.9000	a	vbus	24259	TEHACHAP	230.0	0	0.0	1	1	1.1000

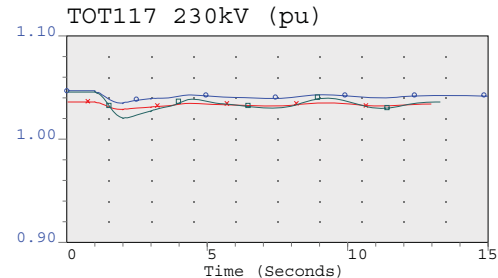


o	0.9000	a	vbus	29050	TOT117	230.0	0	0.0	1	1	1.1000
x	0.9000	a	vbus	29050	TOT117	230.0	0	0.0	1	1	1.1000
d	0.9000	a	vbus	29050	TOT117	230.0	0	0.0	1	1	1.1000

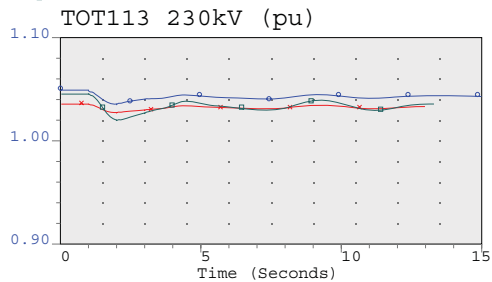


o	0.9000	a	vbus	29040	TOT113	230.0	0	0.0	1	1	1.1000
x	0.9000	a	vbus	29040	TOT113	230.0	0	0.0	1	1	1.1000
d	0.9000	a	vbus	29040	TOT113	230.0	0	0.0	1	1	1.1000

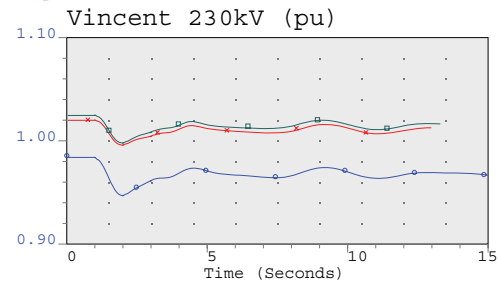


o	0.9000	a	vbus	24155	VINCENT	230.0	0	0.0	1	1	1.1000
x	0.9000	a	vbus	24155	VINCENT	230.0	0	0.0	1	1	1.1000
d	0.9000	a	vbus	24155	VINCENT	230.0	0	0.0	1	1	1.1000

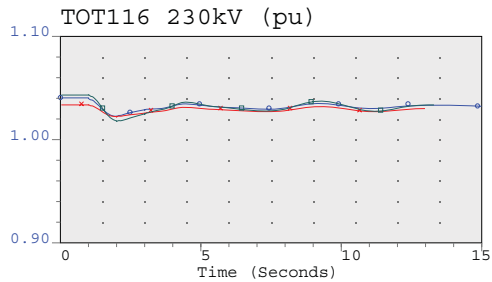


o	0.9000	a	vbus	29100	TOT116	230.0	0	0.0	1	1	1.1000
x	0.9000	a	vbus	29100	TOT116	230.0	0	0.0	1	1	1.1000
d	0.9000	a	vbus	29100	TOT116	230.0	0	0.0	1	1	1.1000

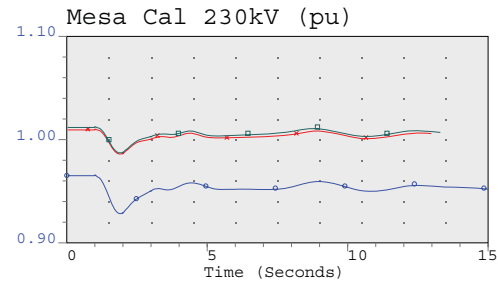


o	0.9000	a	vbus	24091	MESA CAL	230.0	0	0.0	1	1	1.1000
x	0.9000	a	vbus	24091	MESA CAL	230.0	0	0.0	1	1	1.1000
d	0.9000	a	vbus	24091	MESA CAL	230.0	0	0.0	1	1	1.1000

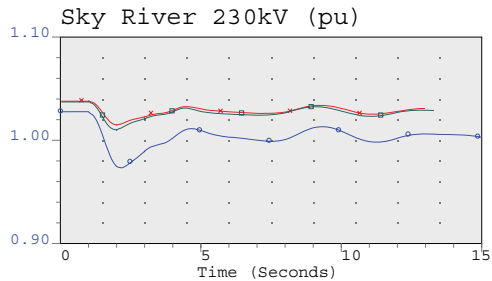

o	0.9000	a	vbus	24250	SKYRIVER	230.0	0	0.0	1	1	1.1000
x	0.9000	a	vbus	24250	SKYRIVER	230.0	0	0.0	1	1	1.1000
d	0.9000	a	vbus	24250	SKYRIVER	230.0	0	0.0	1	1	1.1000

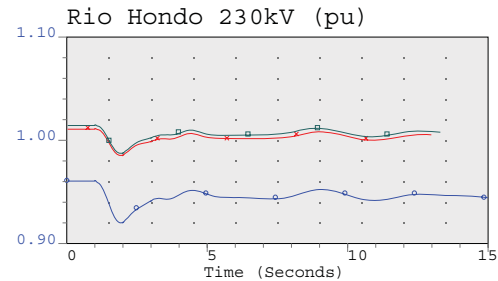









o	0.9000	a	vbus	24126	RIOHONDO	230.0	0	0.0	1	1	1.1000
x	0.9000	a	vbus	24126	RIOHONDO	230.0	0	0.0	1	1	1.1000
d	0.9000	a	vbus	24126	RIOHONDO	230.0	0	0.0	1	1	1.1000






### 230kV Frequencies

Full Wind, Lo Wind, No Wind for Fault: 2010hs-PaloVerde-g2-svc

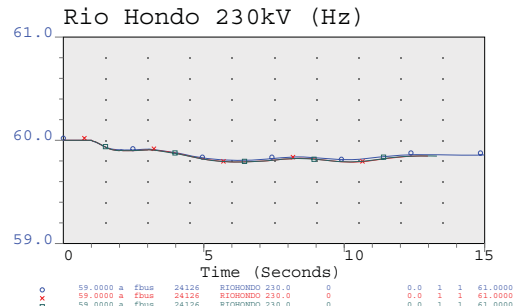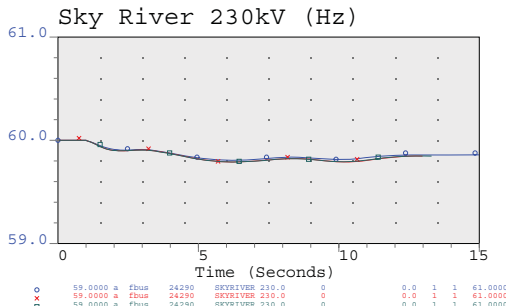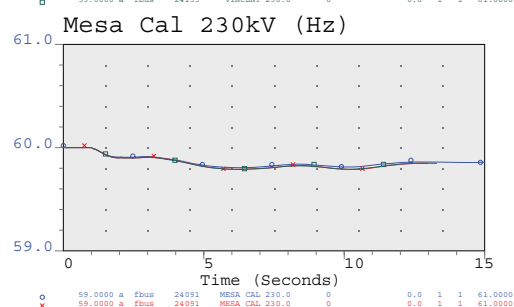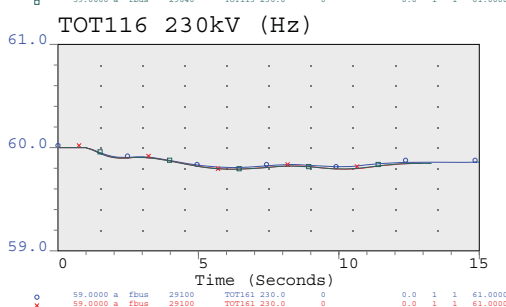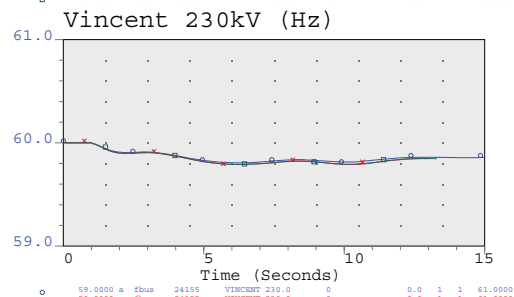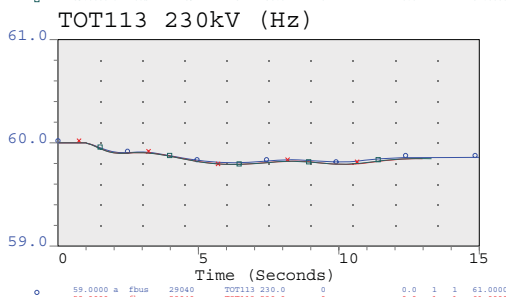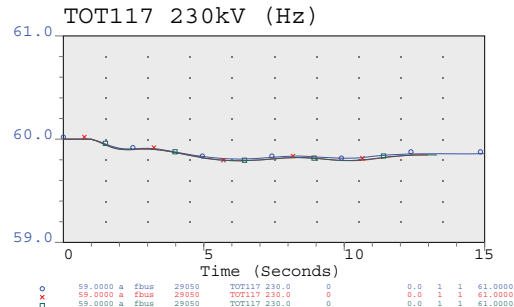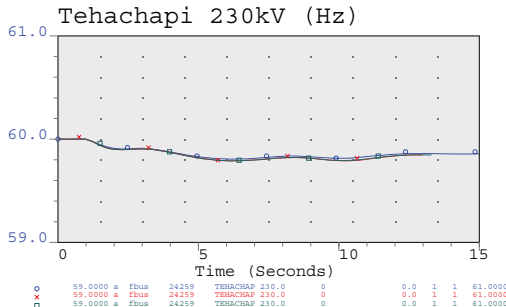








a:2010hs-FullWind-PaloVerde-g2-svc.chf  
 b:2010hs-LoWind-PaloVerde-g2-svc.chf  
 c:2010hs-NoWind-PaloVerde-g2-svc.chf

d:\projects\caiso  
 Wed Aug 22 11:15:41 2007






500kV Real Power Flows  
Full Wind, Lo Wind, No Wind for Fault: 2010hs-PaloVerde-g2-svc

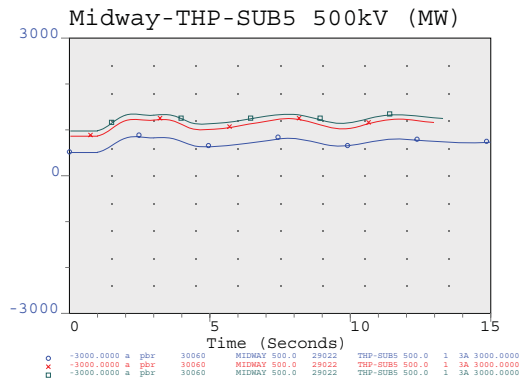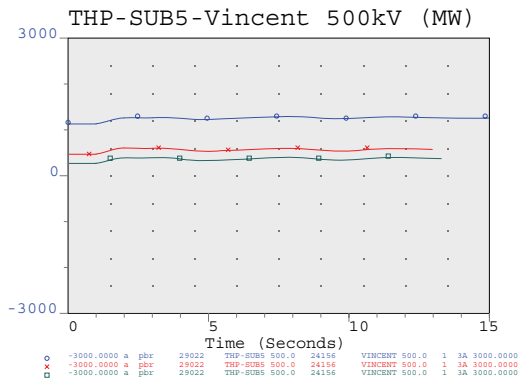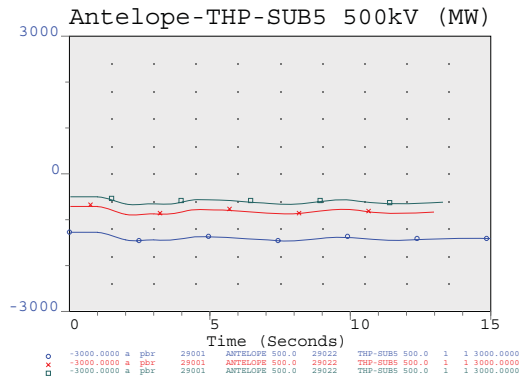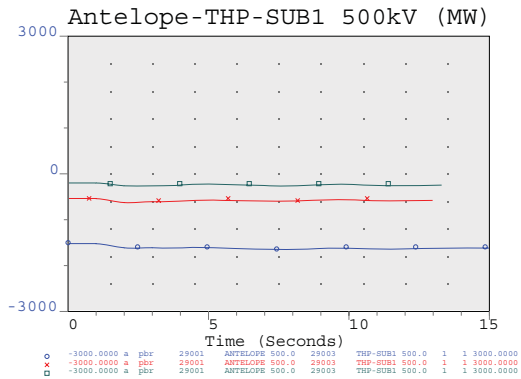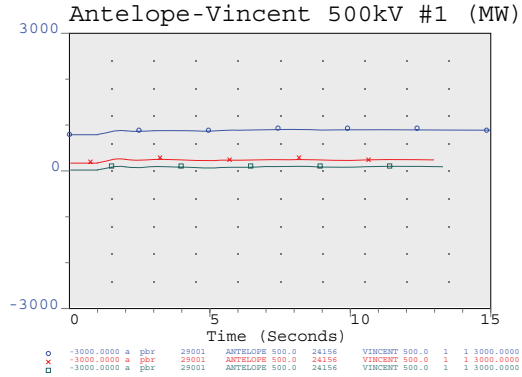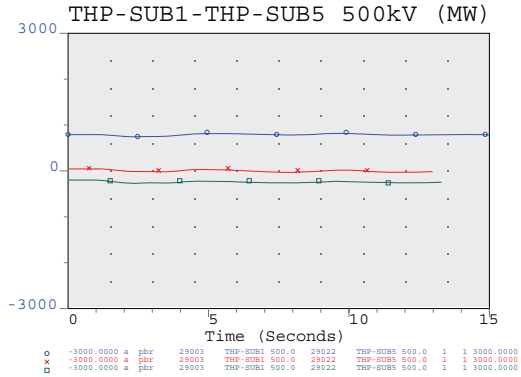




500kV Reactive Power Flows  
Full Wind, Lo Wind, No Wind for Fault: 2010hs-PaloVerde-g2-svc

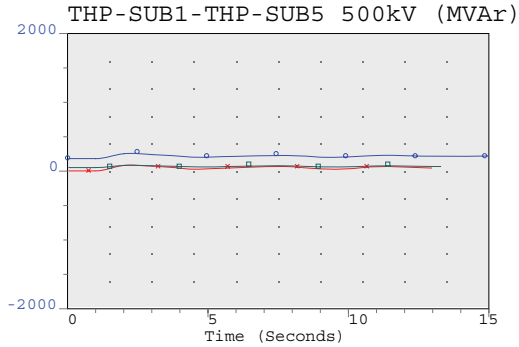

```

o -2000.0000 a qbr 29003 THP-SUB1 500.0 29022 THP-SUB5 500.0 1 1 2000.0000
x -2000.0000 a qbr 29003 THP-SUB1 500.0 29022 THP-SUB5 500.0 1 1 2000.0000
s -2000.0000 a qbr 29003 THP-SUB1 500.0 29022 THP-SUB5 500.0 1 1 2000.0000


```

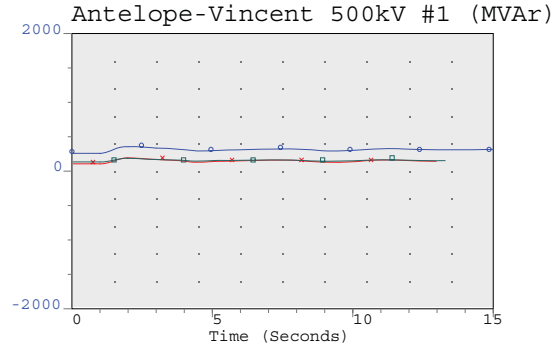

```

o -2000.0000 a qbr 29001 ANTELOPE 500.0 24156 VINCENT 500.0 1 1 2000.0000
x -2000.0000 a qbr 29001 ANTELOPE 500.0 24156 VINCENT 500.0 1 1 2000.0000
s -2000.0000 a qbr 29001 ANTELOPE 500.0 24156 VINCENT 500.0 1 1 2000.0000


```

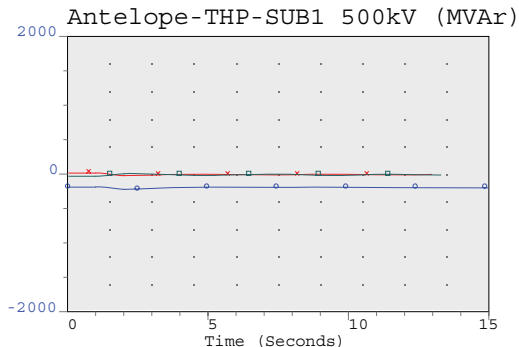

```

o -2000.0000 a qbr 29001 ANTELOPE 500.0 29003 THP-SUB1 500.0 1 1 2000.0000
x -2000.0000 a qbr 29001 ANTELOPE 500.0 29003 THP-SUB1 500.0 1 1 2000.0000
s -2000.0000 a qbr 29001 ANTELOPE 500.0 29003 THP-SUB1 500.0 1 1 2000.0000


```

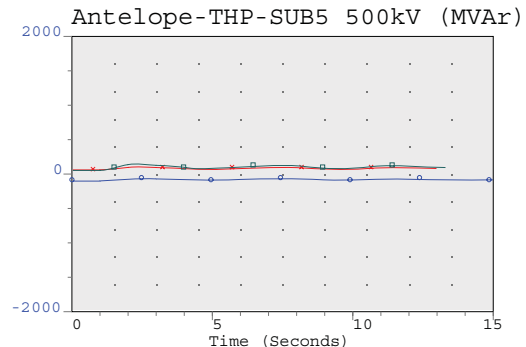

```

o -2000.0000 a qbr 29001 ANTELOPE 500.0 29022 THP-SUB5 500.0 1 1 2000.0000
x -2000.0000 a qbr 29001 ANTELOPE 500.0 29022 THP-SUB5 500.0 1 1 2000.0000
s -2000.0000 a qbr 29001 ANTELOPE 500.0 29022 THP-SUB5 500.0 1 1 2000.0000


```

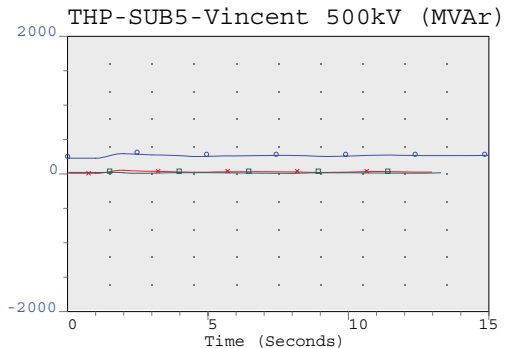

```

o -2000.0000 a qbr 29022 THP-SUB5 500.0 24156 VINCENT 500.0 1 3A 2000.0000
x -2000.0000 a qbr 29022 THP-SUB5 500.0 24156 VINCENT 500.0 1 3A 2000.0000
s -2000.0000 a qbr 29022 THP-SUB5 500.0 24156 VINCENT 500.0 1 3A 2000.0000

```

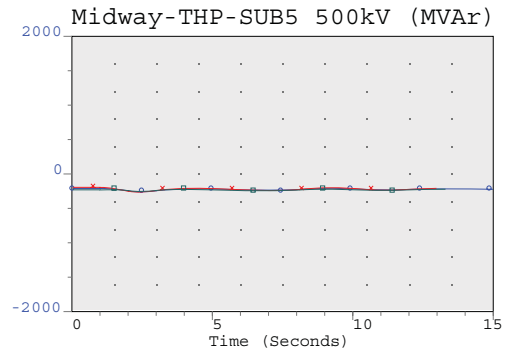

```

o -2000.0000 a qbr 30060 MIDWAY 500.0 29022 THP-SUB5 500.0 1 3A 2000.0000
x -2000.0000 a qbr 30060 MIDWAY 500.0 29022 THP-SUB5 500.0 1 3A 2000.0000
s -2000.0000 a qbr 30060 MIDWAY 500.0 29022 THP-SUB5 500.0 1 3A 2000.0000


```






Interface Power Flows

Full Wind, Lo Wind, No Wind for Fault: 2010hs-PaloVerde-g2-svc

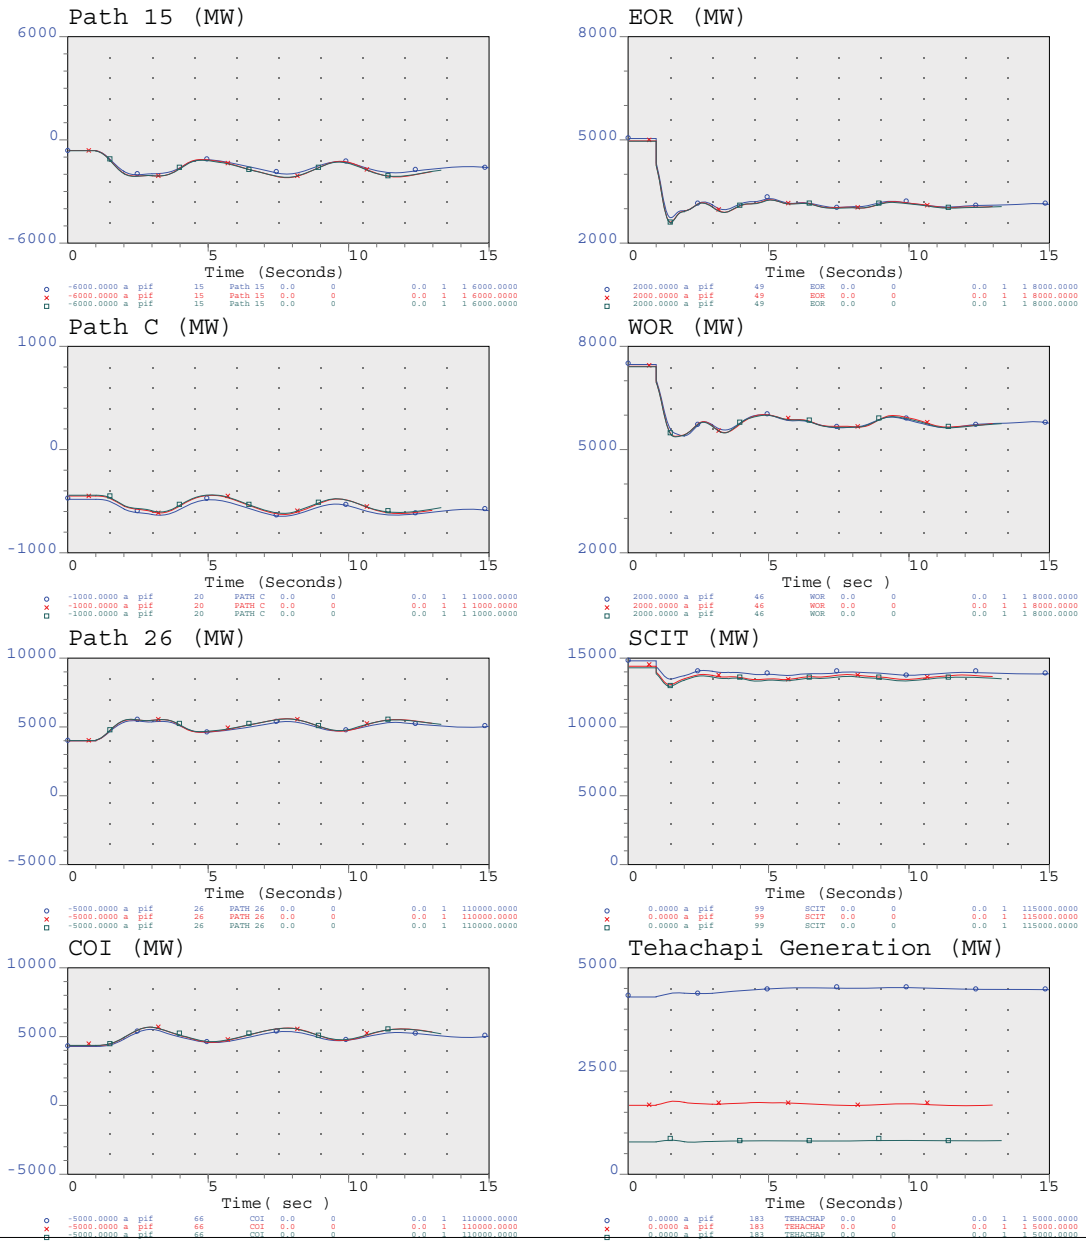

a:2010hs-FullWind-PaloVerde-g2-svc.chf  
 b:2010hs-LoWind-PaloVerde-g2-svc.chf  
 c:2010hs-NoWind-PaloVerde-g2-svc.chf







d:\projects\caiso  
 Wed Aug 22 11:15:42 2007





### SVC Variables

Full Wind, Lo Wind, No Wind for Fault: 2010hs-PaloVerde-g2-svc

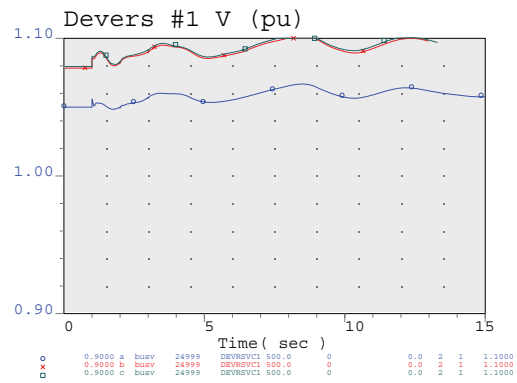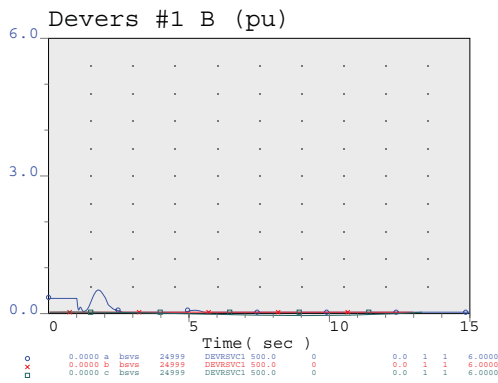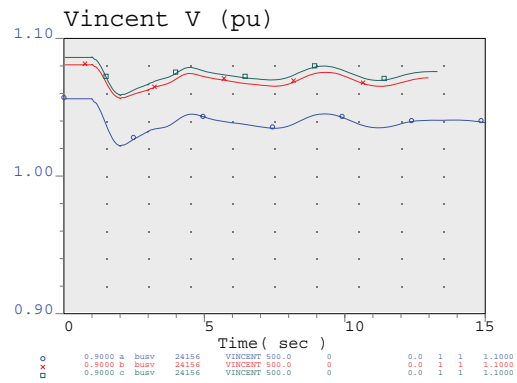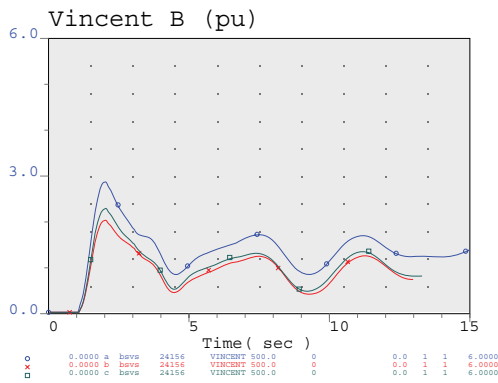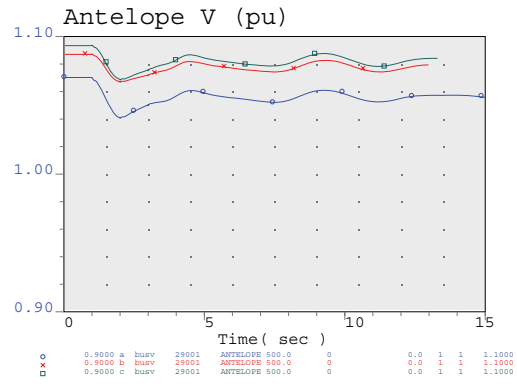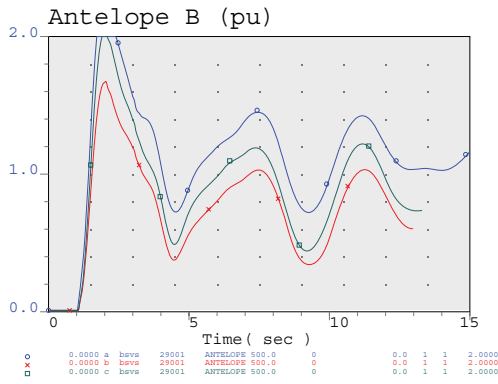

a:2010hs-FullWind-PaloVerde-g2-svc.chf  
 b:2010hs-LoWind-PaloVerde-g2-svc.chf  
 c:2010hs-NoWind-PaloVerde-g2-svc.chf

d:\projects\caiso  
 Wed Aug 22 11:15:42 2007









### 500kV Voltages


Full Wind, Lo Wind, No Wind for Fault: 2010hs-PDCI-NS-bipole-2000-svc

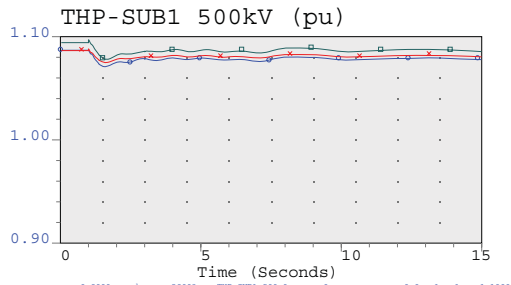


0.9000 a vbus 29003 THP-SUB1 500.0 0 0.0 1 1 1.1000  
0.9000 a vbus 29003 THP-SUB1 500.0 0 0.0 1 1 1.1000  
0.9000 a vbus 29003 THP-SUB1 500.0 0 0.0 1 1 1.1000

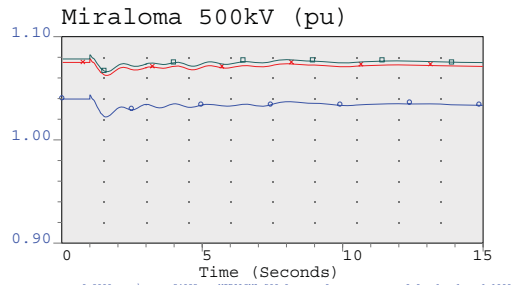


0.9000 a vbus 24092 MIRALOMA 500.0 0 0.0 1 1 1.1000  
0.9000 a vbus 24092 MIRALOMA 500.0 0 0.0 1 1 1.1000  
0.9000 a vbus 24092 MIRALOMA 500.0 0 0.0 1 1 1.1000

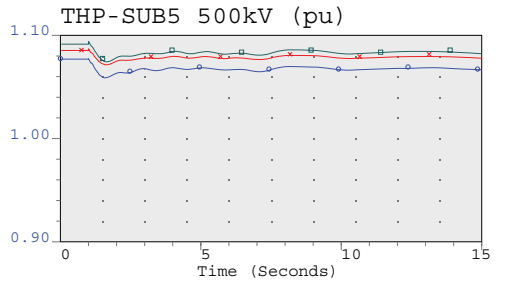


0.9000 a vbus 29022 THP-SUB5 500.0 0 0.0 1 1 1.1000  
0.9000 a vbus 29022 THP-SUB5 500.0 0 0.0 1 1 1.1000  
0.9000 a vbus 29022 THP-SUB5 500.0 0 0.0 1 1 1.1000

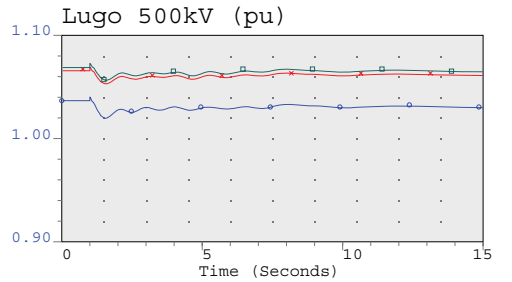


0.9000 a vbus 24086 LUGO 500.0 0 0.0 1 1 1.1000  
0.9000 a vbus 24086 LUGO 500.0 0 0.0 1 1 1.1000  
0.9000 a vbus 24086 LUGO 500.0 0 0.0 1 1 1.1000

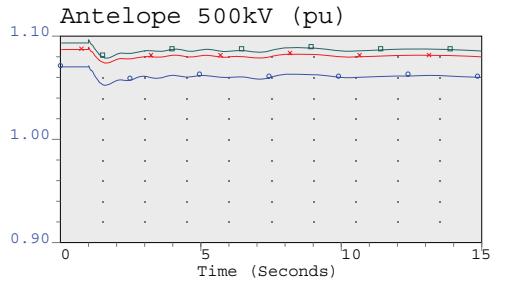


0.9000 a vbus 29001 ANTELOPE 500.0 0 0.0 1 1 1.1000  
0.9000 a vbus 29001 ANTELOPE 500.0 0 0.0 1 1 1.1000  
0.9000 a vbus 29001 ANTELOPE 500.0 0 0.0 1 1 1.1000

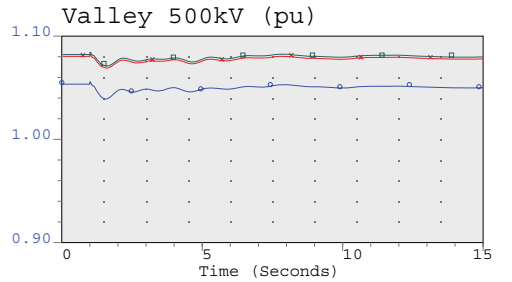


0.9000 a vbus 24151 VALLEYSC 500.0 0 0.0 1 1 1.1000  
0.9000 a vbus 24151 VALLEYSC 500.0 0 0.0 1 1 1.1000  
0.9000 a vbus 24151 VALLEYSC 500.0 0 0.0 1 1 1.1000

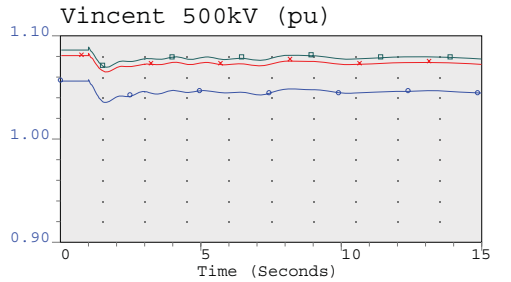


0.9000 a vbus 24156 VINCENT 500.0 0 0.0 1 1 1.1000  
0.9000 a vbus 24156 VINCENT 500.0 0 0.0 1 1 1.1000  
0.9000 a vbus 24156 VINCENT 500.0 0 0.0 1 1 1.1000

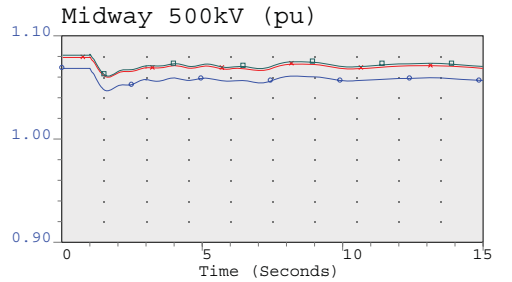




0.9000 a vbus 30060 MIDWAY 500.0 0 0.0 1 1 1.1000  
0.9000 a vbus 30060 MIDWAY 500.0 0 0.0 1 1 1.1000  
0.9000 a vbus 30060 MIDWAY 500.0 0 0.0 1 1 1.1000



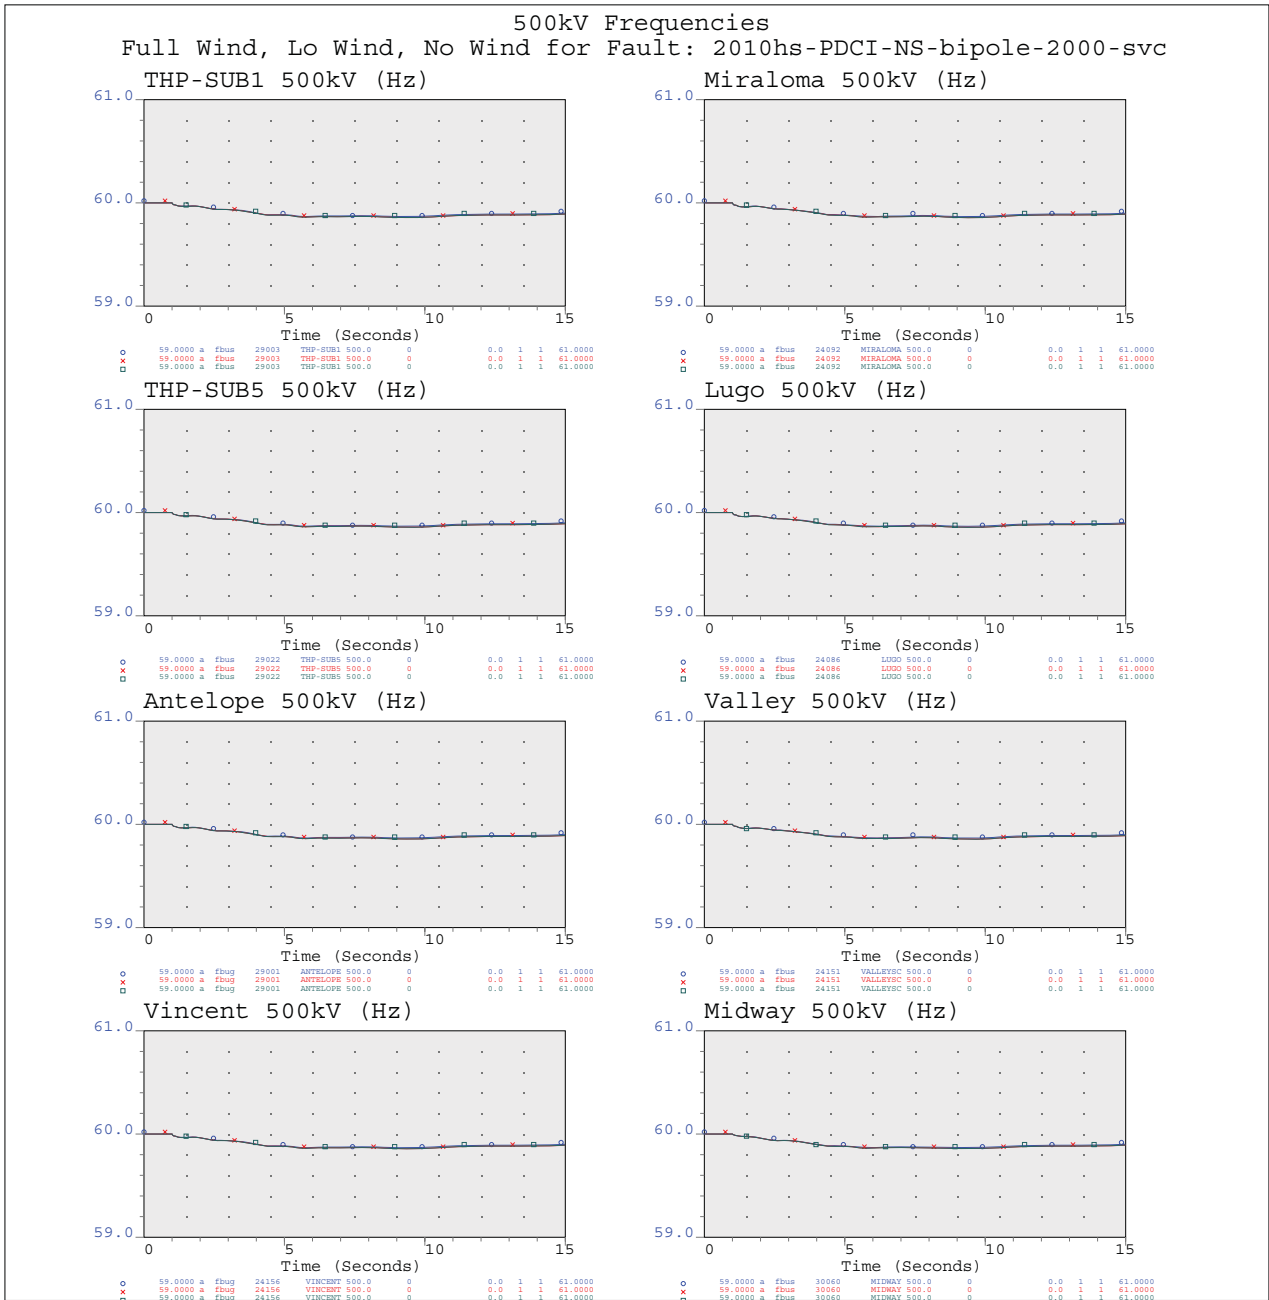









	a:2010hs-FullWind-PDCI-NS-bipole-2000-svc.chf	d:\projects\caiso
	b:2010hs-LoWind-PDCI-NS-bipole-2000-svc.chf	Wed Aug 22 11:16:07 2007
	c:2010hs-NoWind-PDCI-NS-bipole-2000-svc.chf	



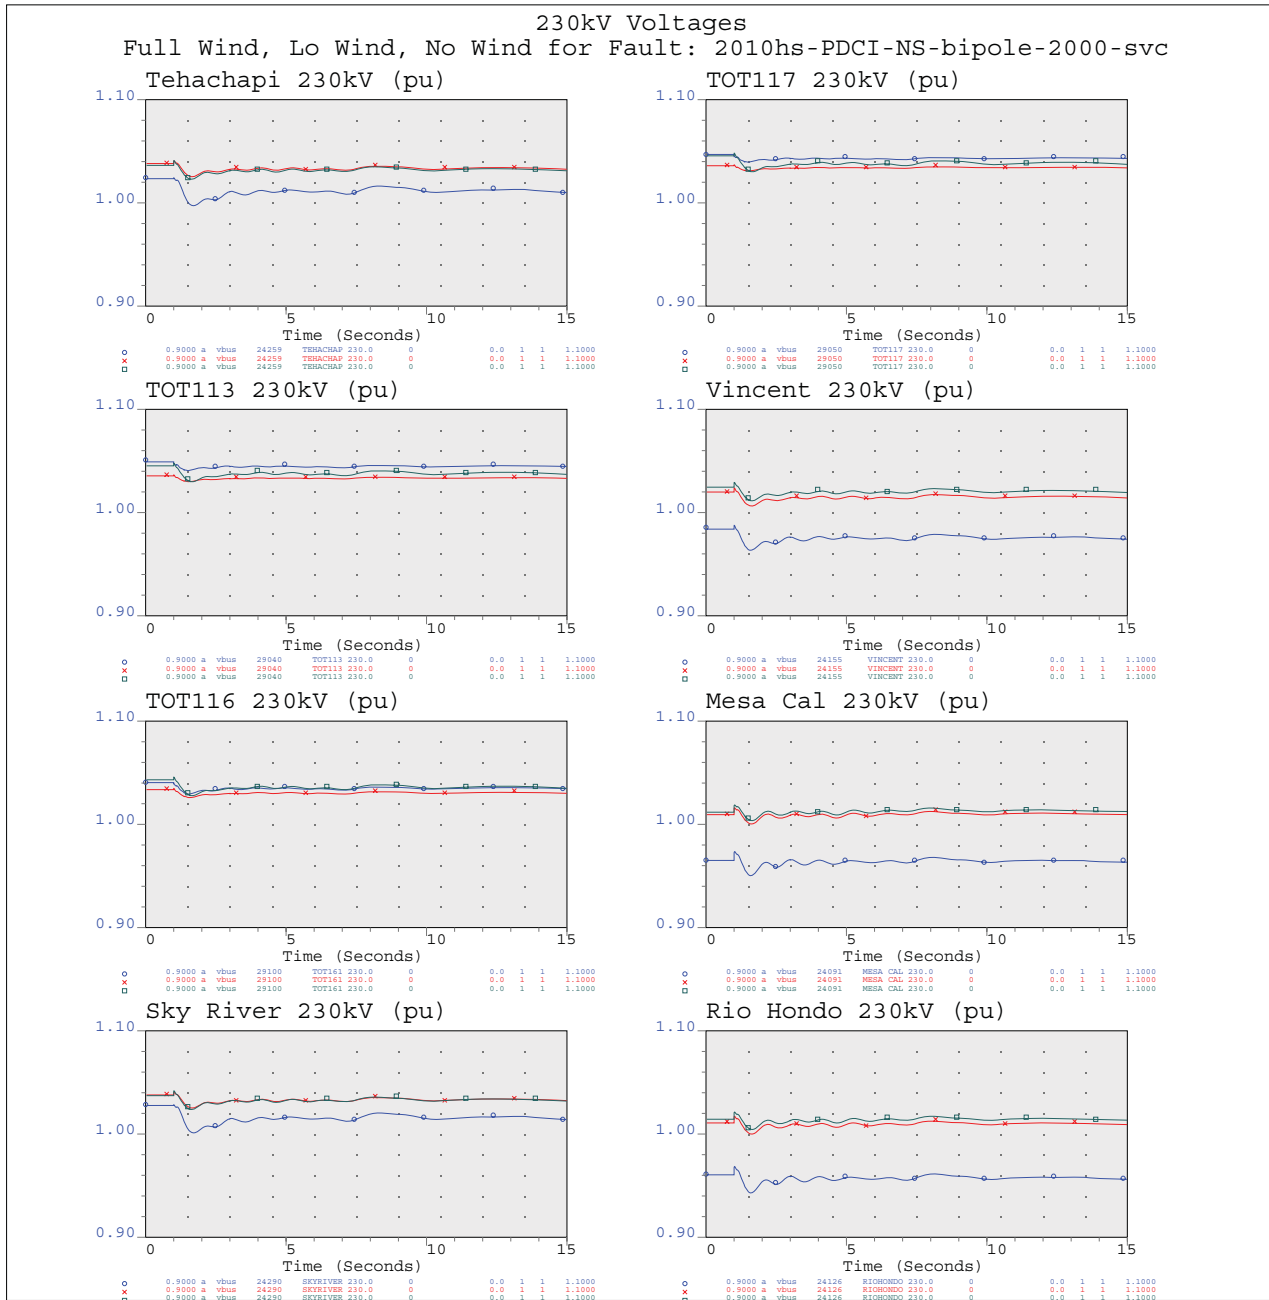




230kV Frequencies  
 Full Wind, Lo Wind, No Wind for Fault: 2010hs-PDCI-NS-bipole-2000-svc

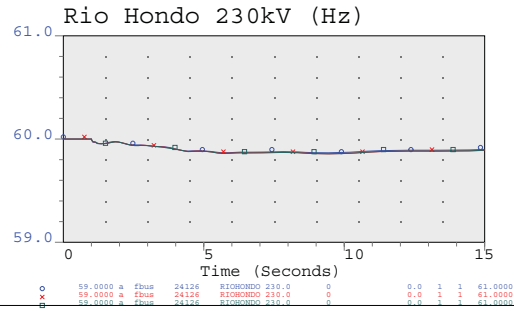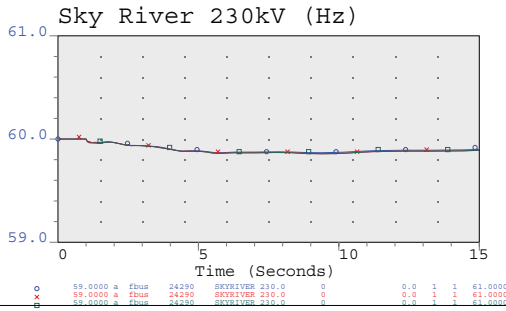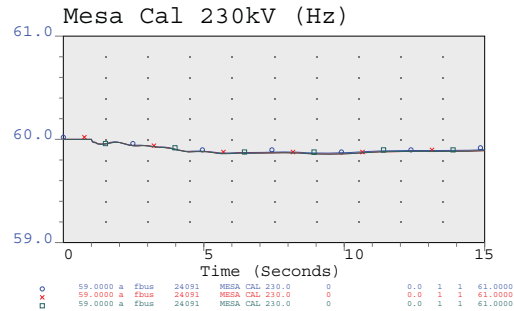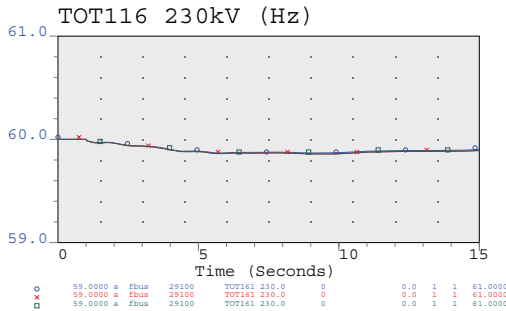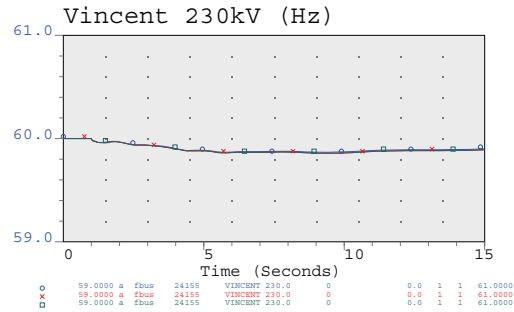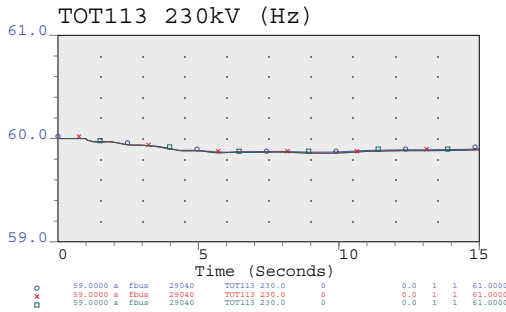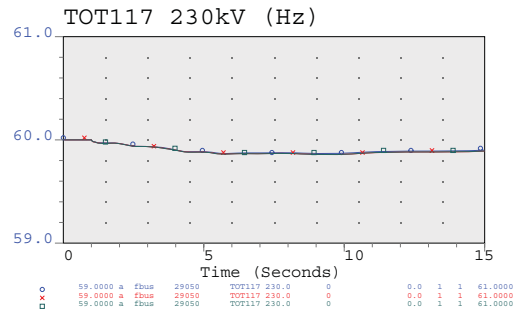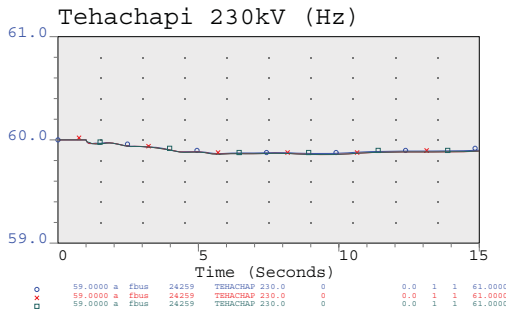








a: 2010hs-FullWind-PDCI-NS-bipole-2000-svc.chf  
 b: 2010hs-LoWind-PDCI-NS-bipole-2000-svc.chf  
 c: 2010hs-NoWind-PDCI-NS-bipole-2000-svc.chf

d:\projects\caiso  
 Wed Aug 22 11:16:08 2007






500kV Real Power Flows  
Full Wind, Lo Wind, No Wind for Fault: 2010hs-PDCI-NS-bipole-2000-svc

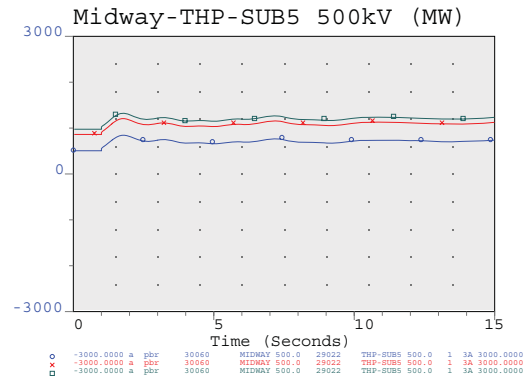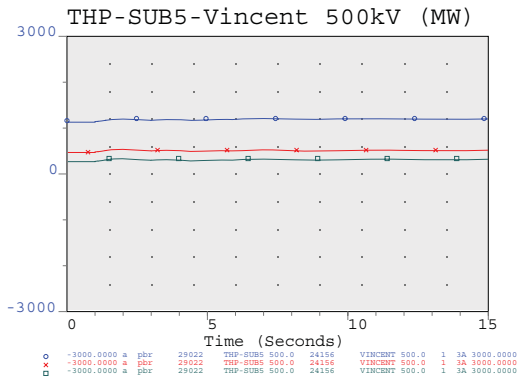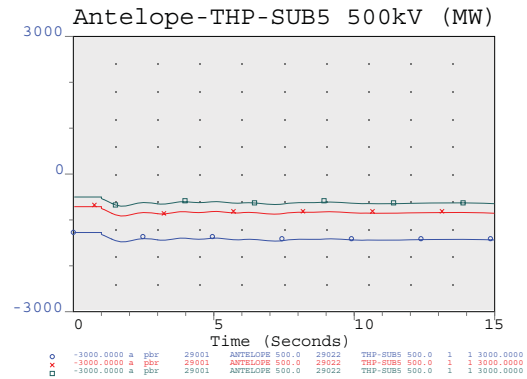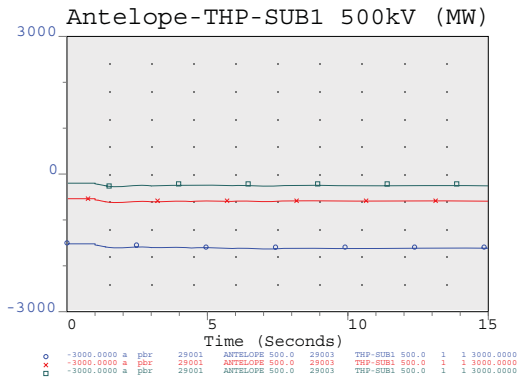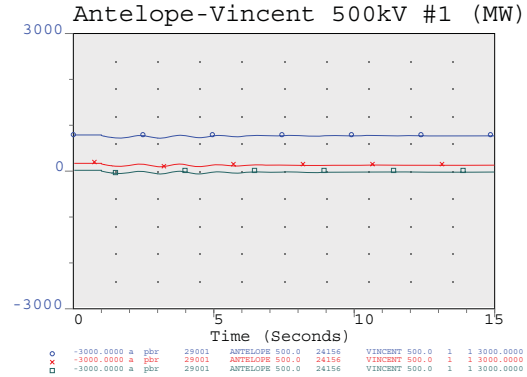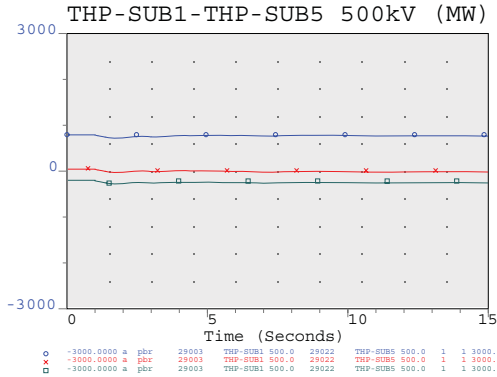




500kV Reactive Power Flows  
 Full Wind, Lo Wind, No Wind for Fault: 2010hs-PDCI-NS-bipole-2000-svc

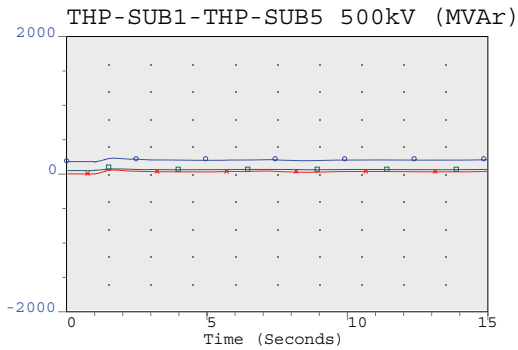


```

o -2000.0000 a qbr 29003 THP-SUB1 500.0 29022 THP-SUB5 500.0 1 1 2000.0000
x -2000.0000 a qbr 29003 THP-SUB1 500.0 29022 THP-SUB5 500.0 1 1 2000.0000
d -2000.0000 a qbr 29003 THP-SUB1 500.0 29022 THP-SUB5 500.0 1 1 2000.0000
  
```

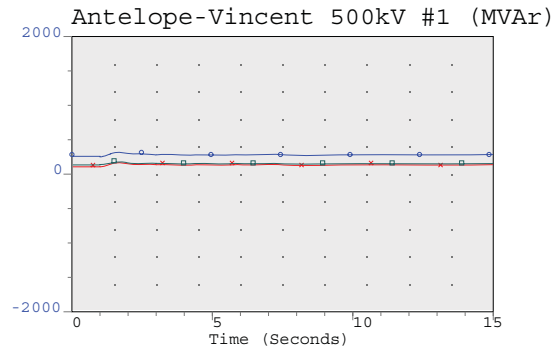


```

o -2000.0000 a qbr 29001 ANTELOPE 500.0 24156 VINCENT 500.0 1 1 2000.0000
x -2000.0000 a qbr 29001 ANTELOPE 500.0 24156 VINCENT 500.0 1 1 2000.0000
d -2000.0000 a qbr 29001 ANTELOPE 500.0 24156 VINCENT 500.0 1 1 2000.0000
  
```

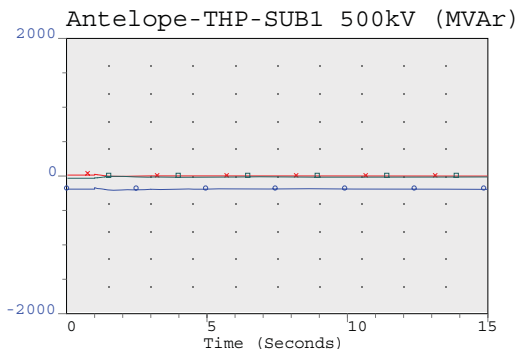


```

o -2000.0000 a qbr 29001 ANTELOPE 500.0 29003 THP-SUB1 500.0 1 1 2000.0000
x -2000.0000 a qbr 29001 ANTELOPE 500.0 29003 THP-SUB1 500.0 1 1 2000.0000
d -2000.0000 a qbr 29001 ANTELOPE 500.0 29003 THP-SUB1 500.0 1 1 2000.0000
  
```

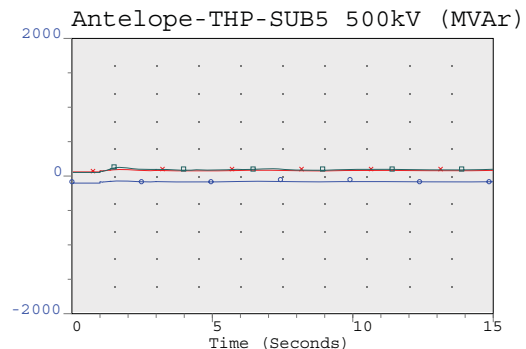


```

o -2000.0000 a qbr 29001 ANTELOPE 500.0 29022 THP-SUB5 500.0 1 1 2000.0000
x -2000.0000 a qbr 29001 ANTELOPE 500.0 29022 THP-SUB5 500.0 1 1 2000.0000
d -2000.0000 a qbr 29001 ANTELOPE 500.0 29022 THP-SUB5 500.0 1 1 2000.0000
  
```

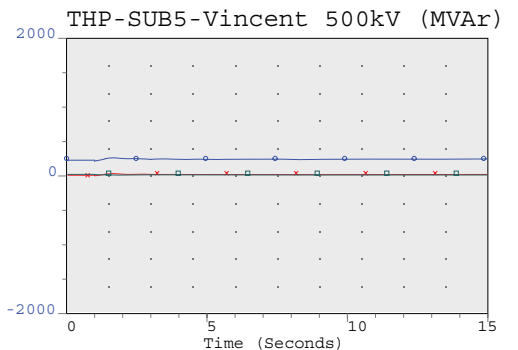

```

o -2000.0000 a qbr 29022 THP-SUB5 500.0 24156 VINCENT 500.0 1 3A 2000.0000
x -2000.0000 a qbr 29022 THP-SUB5 500.0 24156 VINCENT 500.0 1 3A 2000.0000
d -2000.0000 a qbr 29022 THP-SUB5 500.0 24156 VINCENT 500.0 1 3A 2000.0000
  
```

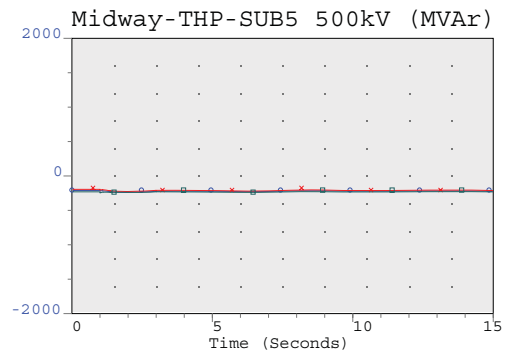

```

o -2000.0000 a qbr 30060 MIDWAY 500.0 29022 THP-SUB5 500.0 1 3A 2000.0000
x -2000.0000 a qbr 30060 MIDWAY 500.0 29022 THP-SUB5 500.0 1 3A 2000.0000
d -2000.0000 a qbr 30060 MIDWAY 500.0 29022 THP-SUB5 500.0 1 3A 2000.0000
  
```












a:2010hs-FullWind-PDCI-NS-bipole-2000-svc.chf  
 b:2010hs-LoWind-PDCI-NS-bipole-2000-svc.chf  
 c:2010hs-NoWind-PDCI-NS-bipole-2000-svc.chf

d:\projects\caiso  
 Wed Aug 22 11:16:08 2007













Interface Power Flows  
Full Wind, Lo Wind, No Wind for Fault: 2010hs-PDCI-NS-bipole-2000-svc

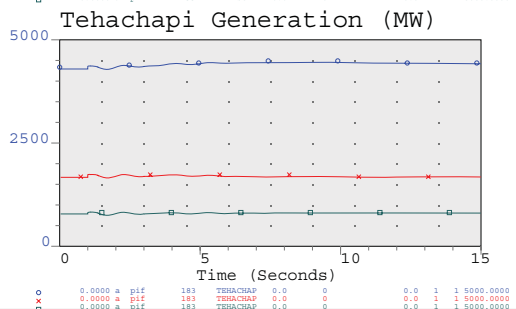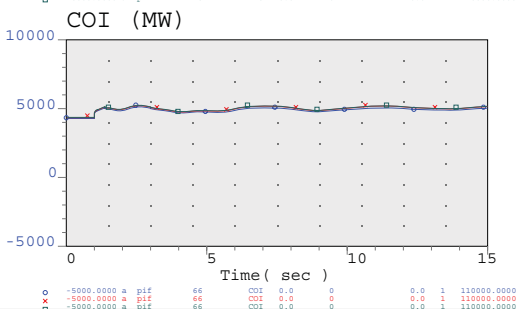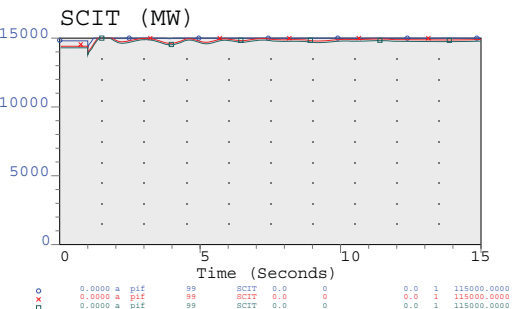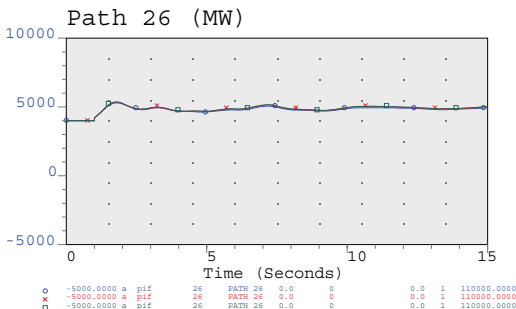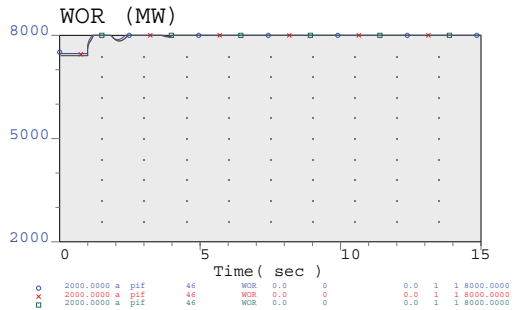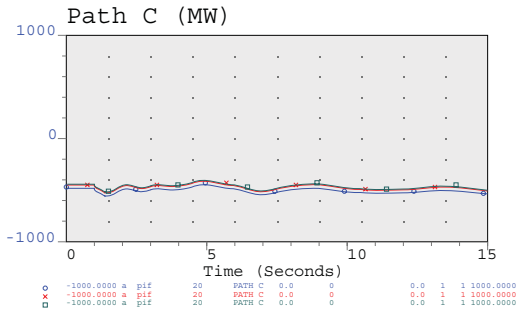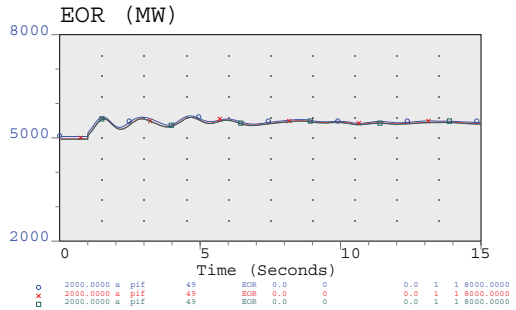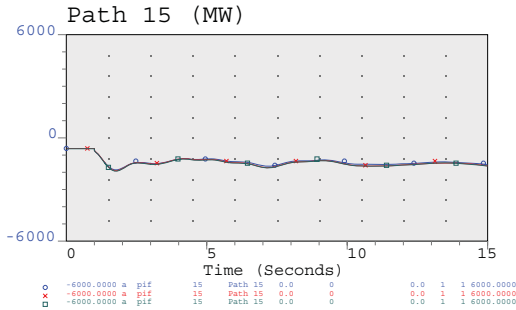













SVC Variables  
Full Wind, Lo Wind, No Wind for Fault: 2010hs-PDCI-NS-bipole-2000-svc

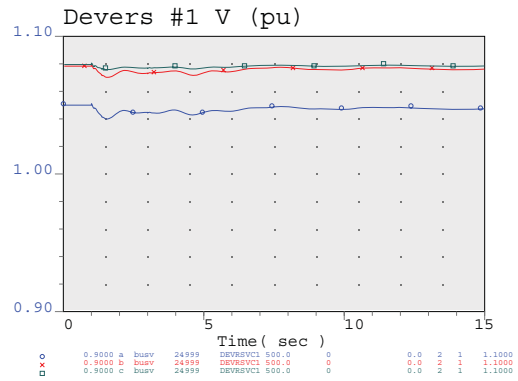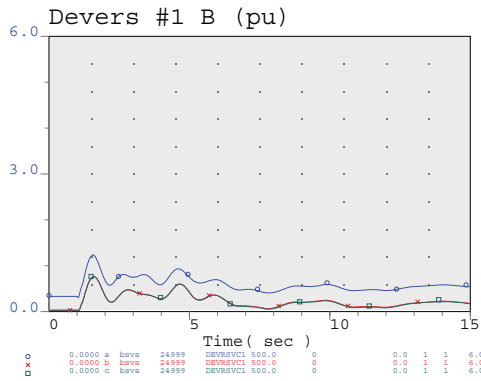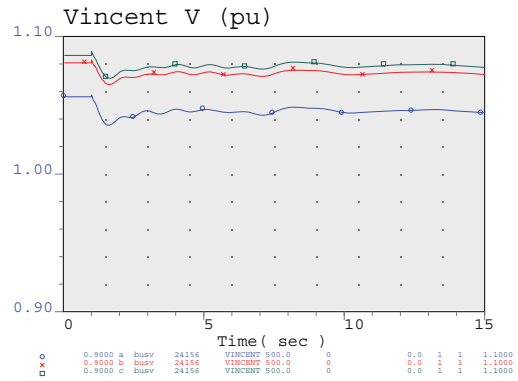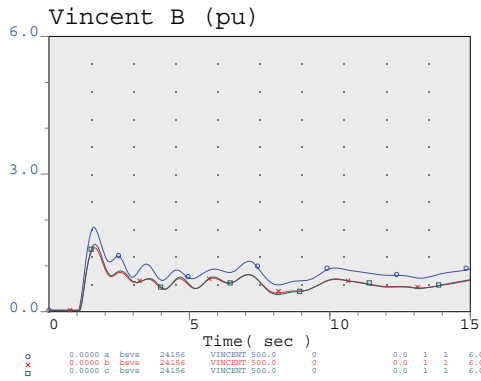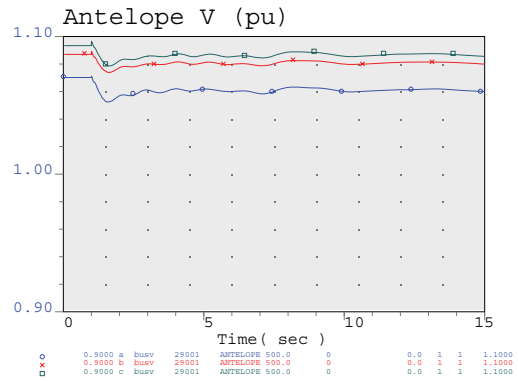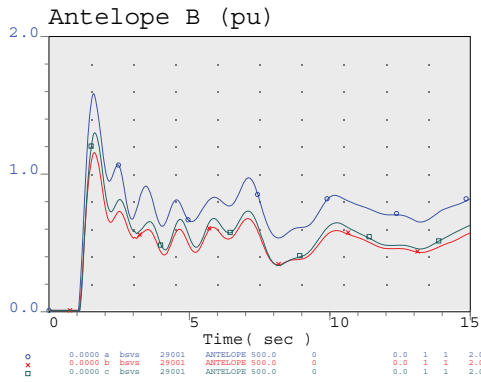





### 500kV Voltages

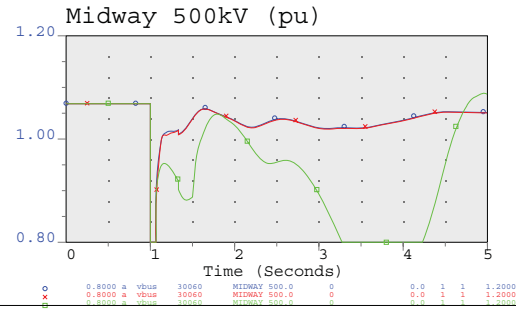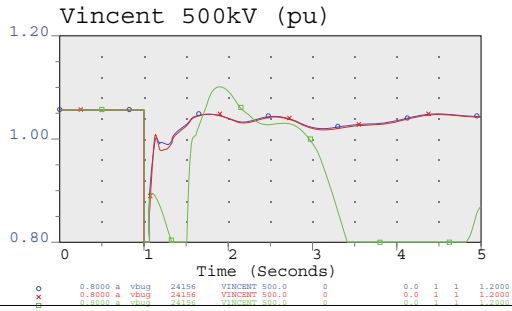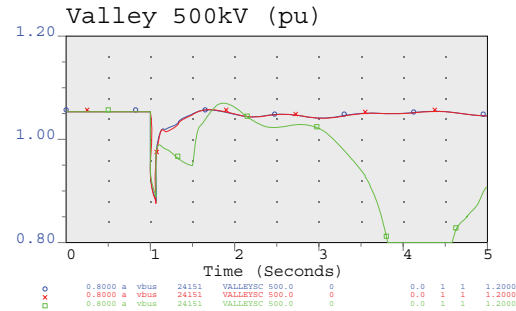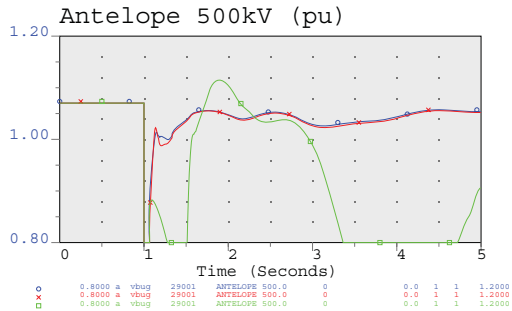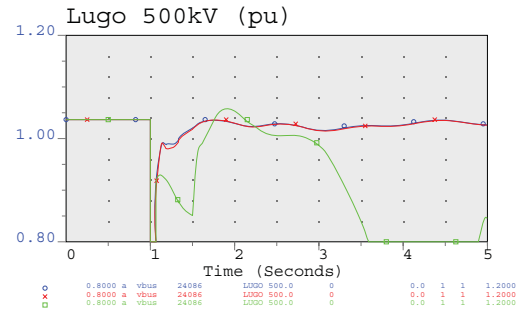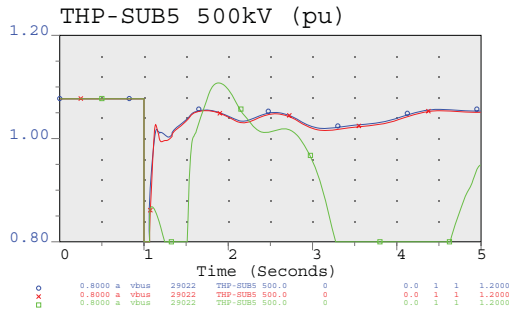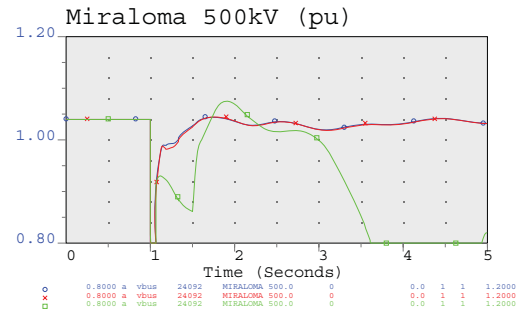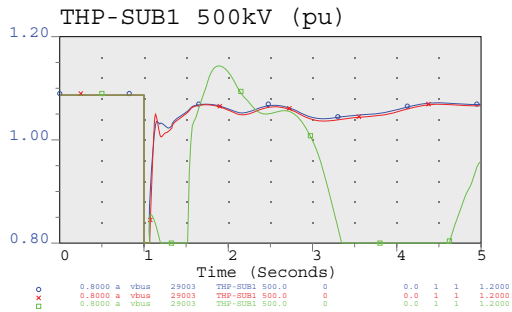









a:2010hs-FullWind-Midway-Vincent-SPS-dlo-30-0.chf  
 b:2010hs-Mix-Midway-Vincent-SPS-dlo-30-0.chf  
 c:2010hs-Type1-Midway-Vincent-SPS-dlo-30-0.chf

d:\kc\caiso  
 Mon Aug 20 10:27:44 2007





### 500kV Frequencies

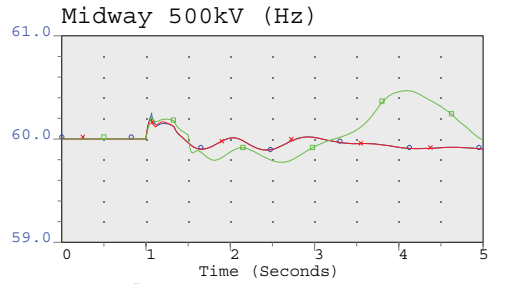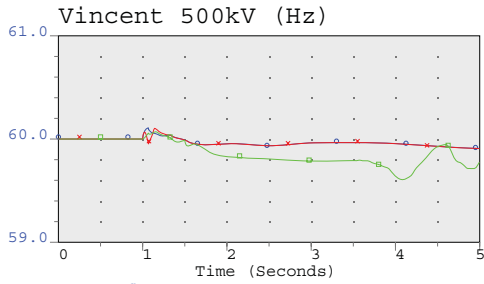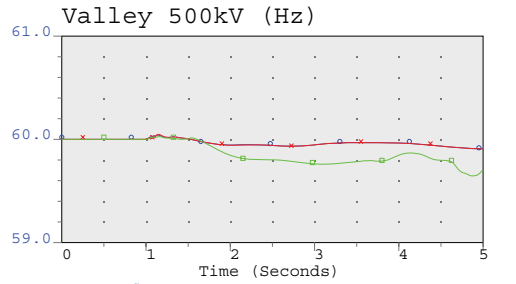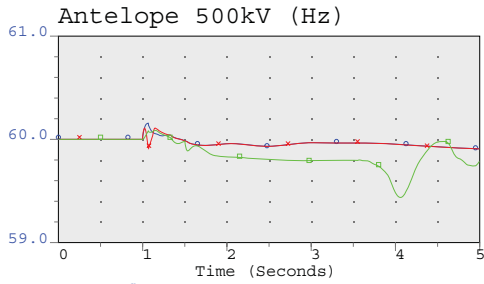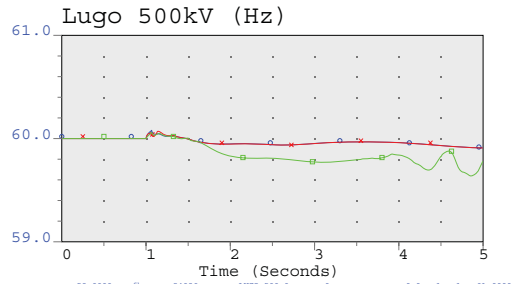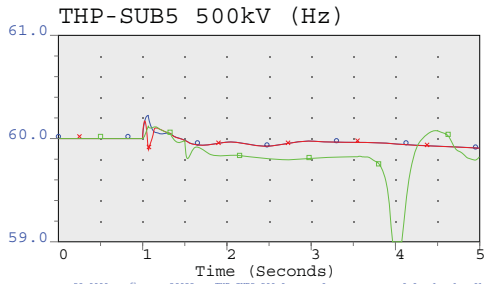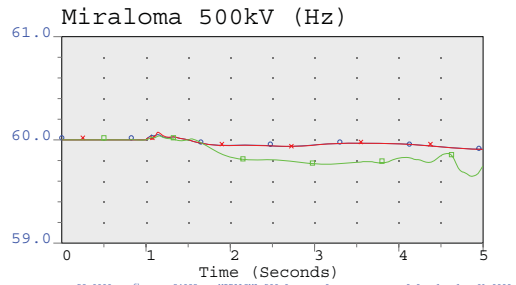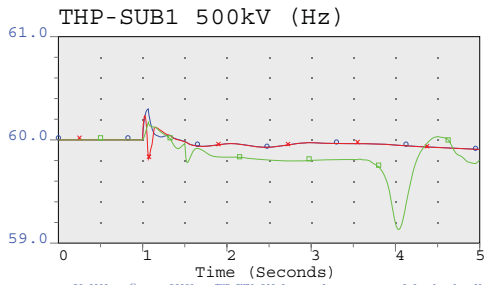










a:2010hs-FullWind-Midway-Vincent-SPS-dlo-30-0.chf  
 b:2010hs-Mix-Midway-Vincent-SPS-dlo-30-0.chf  
 c:2010hs-Type1-Midway-Vincent-SPS-dlo-30-0.chf

d:\kc\caiso  
 Mon Aug 20 10:27:44 2007













### 230kV Voltages

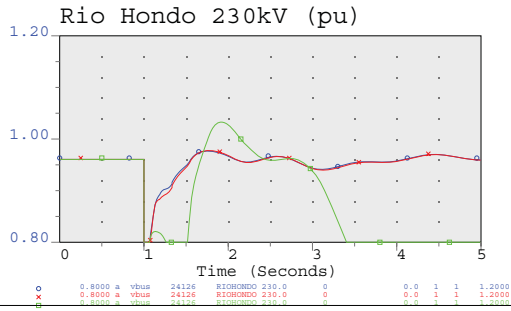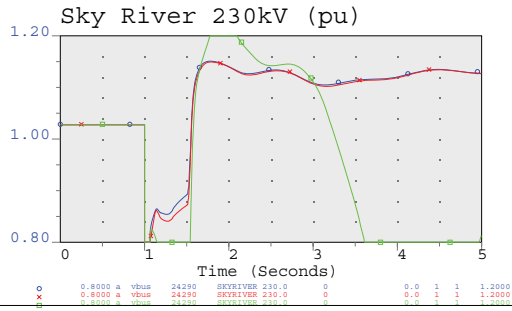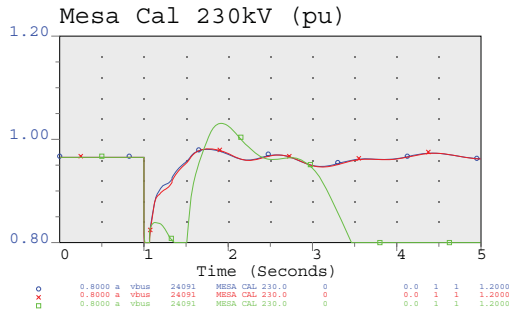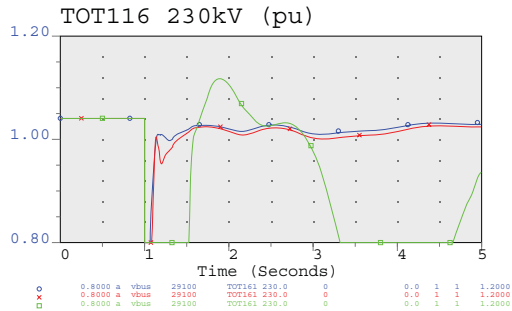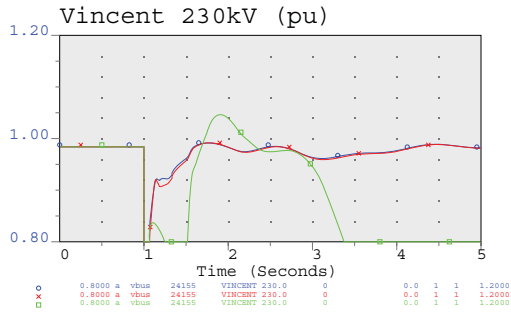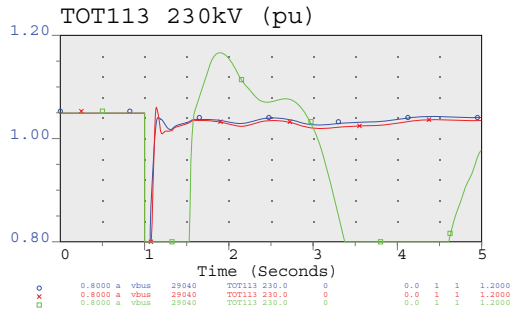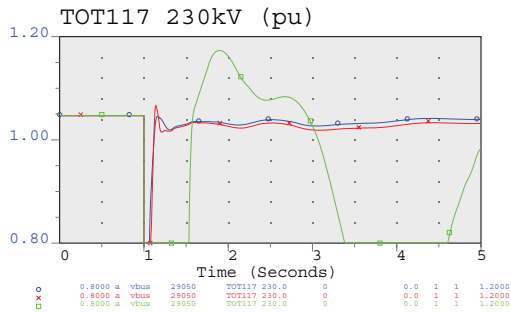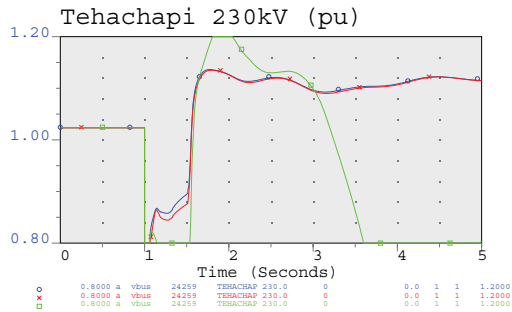




### 230kV Frequencies

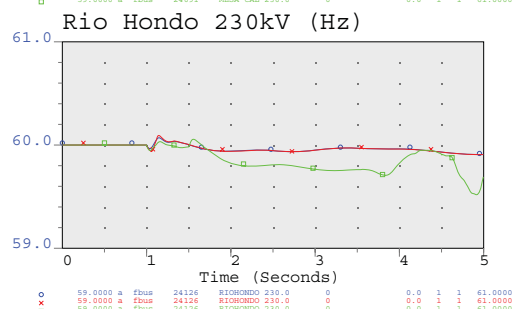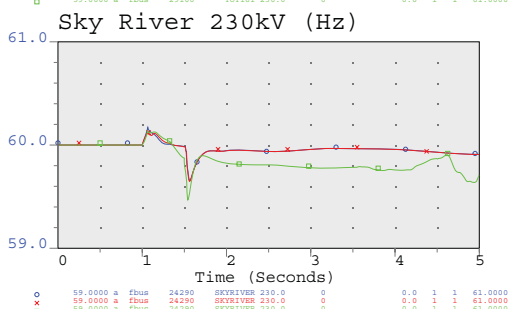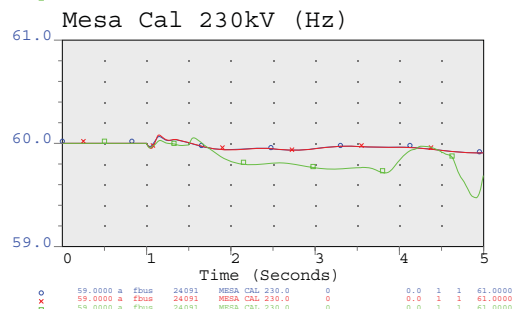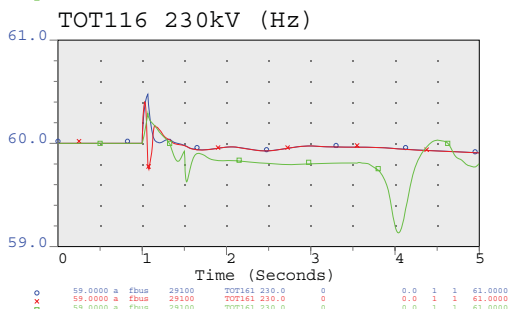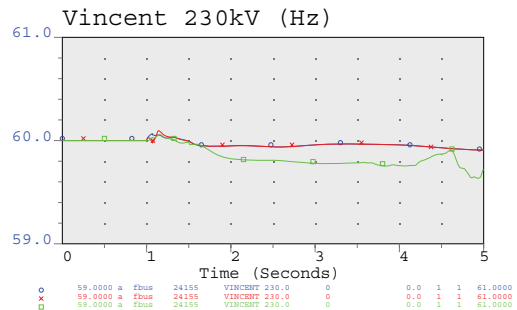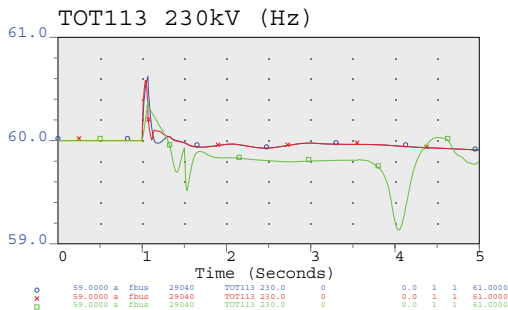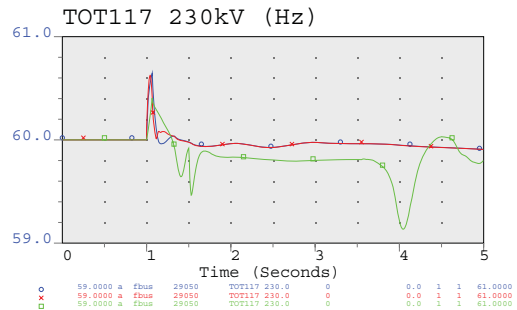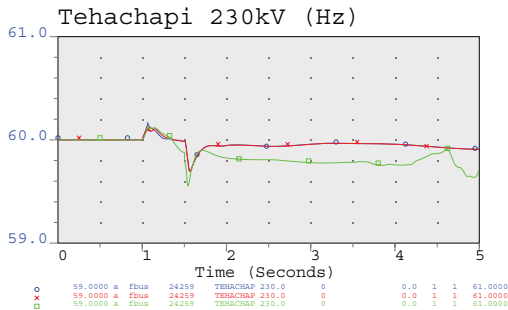

a: 2010hs-FullWind-Midway-Vincent-SPS-dlo-30-0.chf  
 b: 2010hs-Mix-Midway-Vincent-SPS-dlo-30-0.chf  
 c: 2010hs-Type1-Midway-Vincent-SPS-dlo-30-0.chf


d:\kc\caiso  
 Mon Aug 20 10:27:44 2007






### 500kV Real Power Flows


#### THP-SUB1-THP-SUB5 500kV (MW)

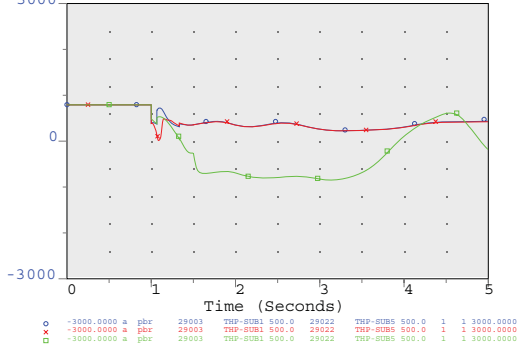


#### Antelope-Vincent 500kV #1 (MW)

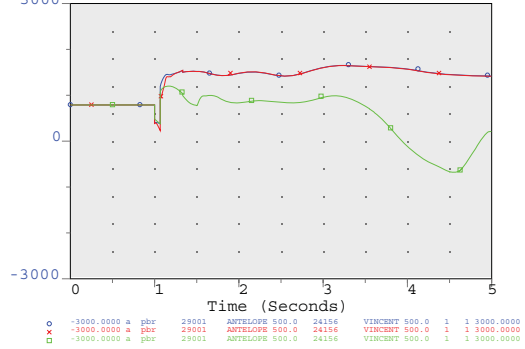


#### Antelope-THP-SUB1 500kV (MW)

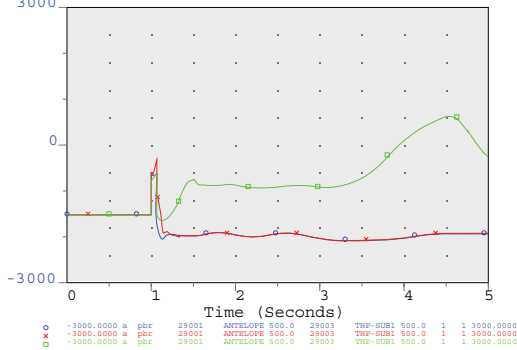



#### Antelope-THP-SUB5 500kV (MW)

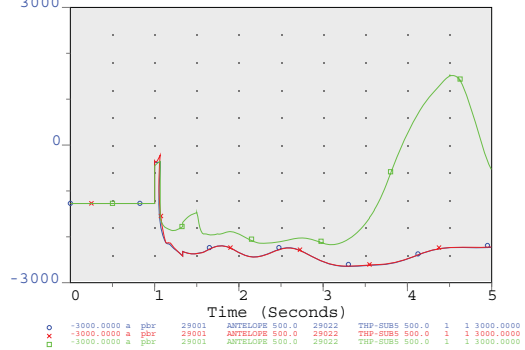

#### THP-SUB5-Vincent 500kV (MW)

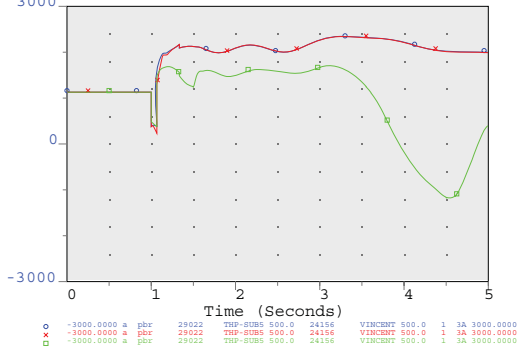


#### Midway-THP-SUB5 500kV (MW)

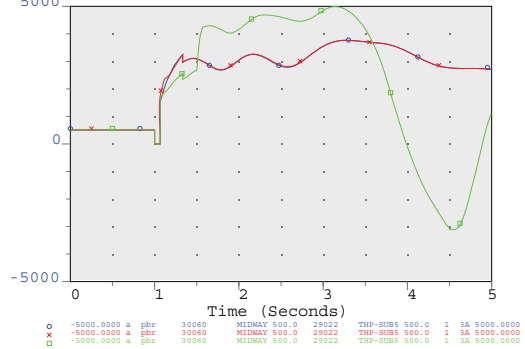




### 500kV Reactive Power Flows


#### THP-SUB1-THP-SUB5 500kV (MVar)

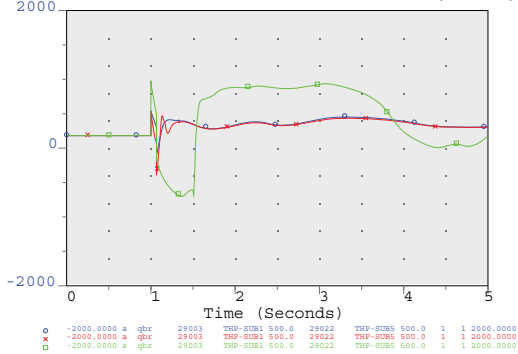


#### Antelope-Vincent 500kV #1 (MVar)

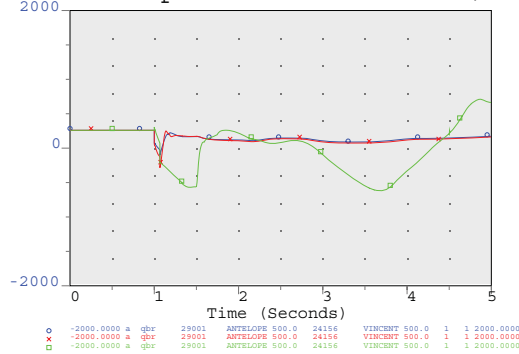


#### Antelope-THP-SUB1 500kV (MVar)

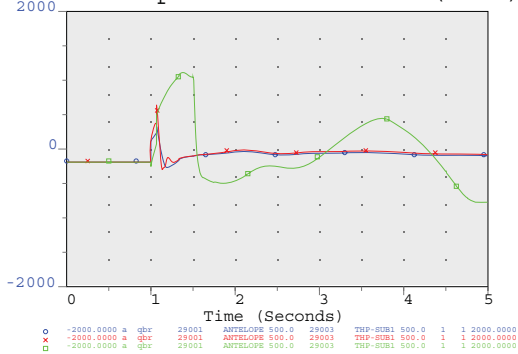


#### Antelope-THP-SUB5 500kV (MVar)

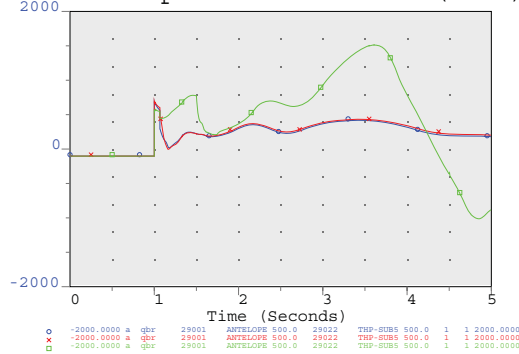

#### THP-SUB5-Vincent 500kV (MVar)

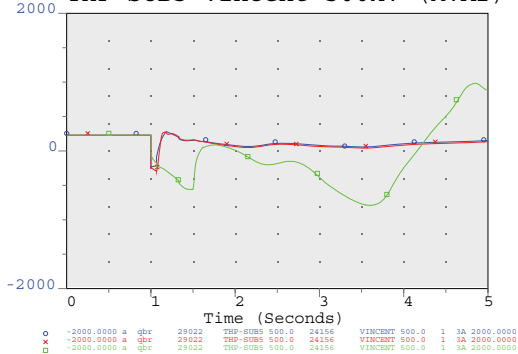


#### Midway-THP-SUB5 500kV (MVar)

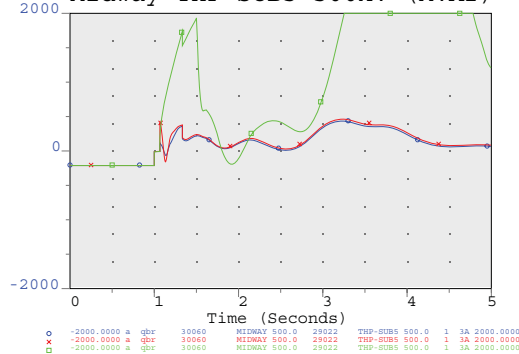

a:2010hs-FullWind-Midway-Vincent-SPS-dlo-30-0.chf  
 b:2010hs-Mix-Midway-Vincent-SPS-dlo-30-0.chf  
 c:2010hs-Type1-Midway-Vincent-SPS-dlo-30-0.chf









d:\kc\caiso  
 Mon Aug 20 10:27:45 2007













### Interface Power Flows

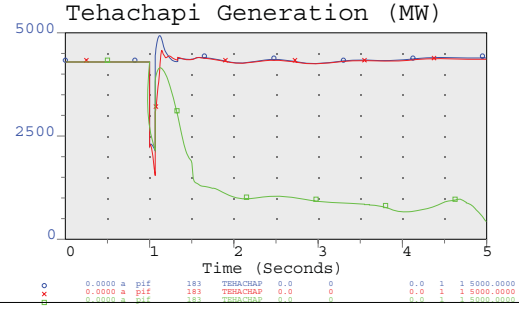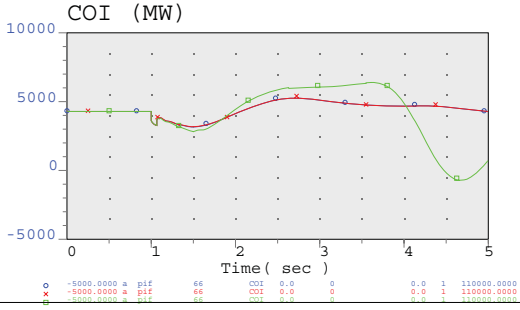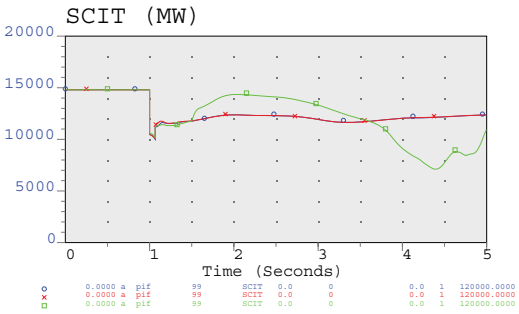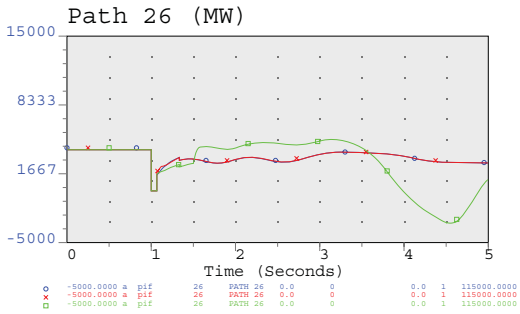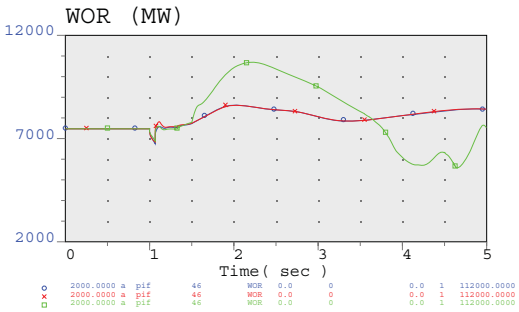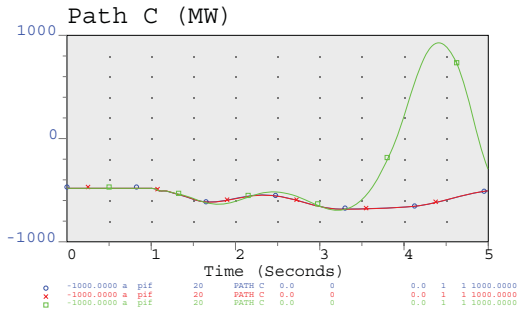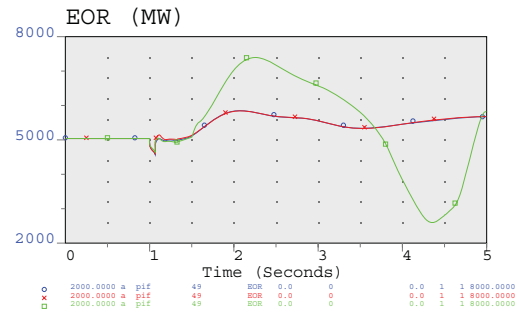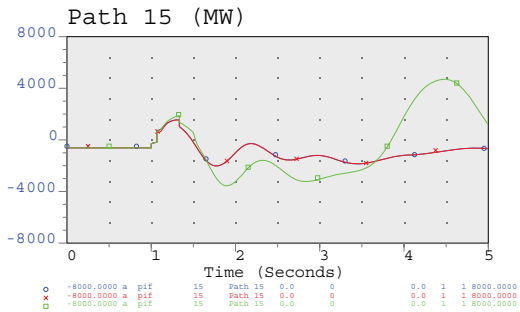




### SVC Variables

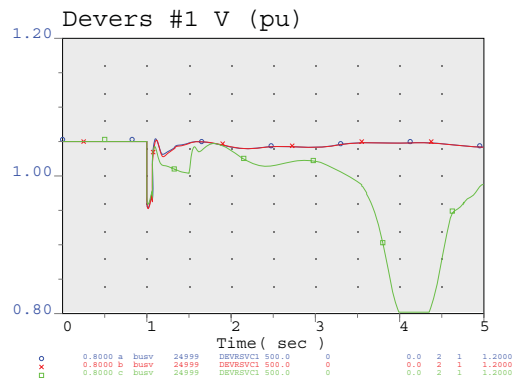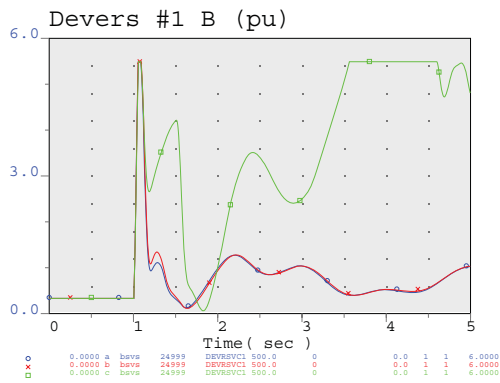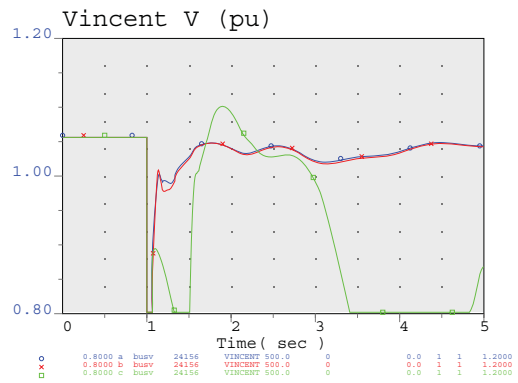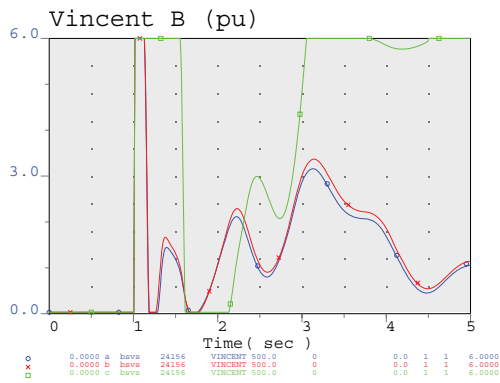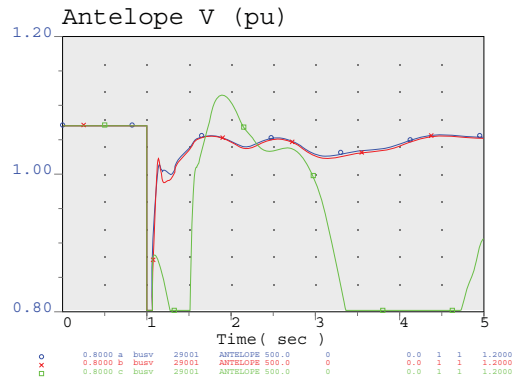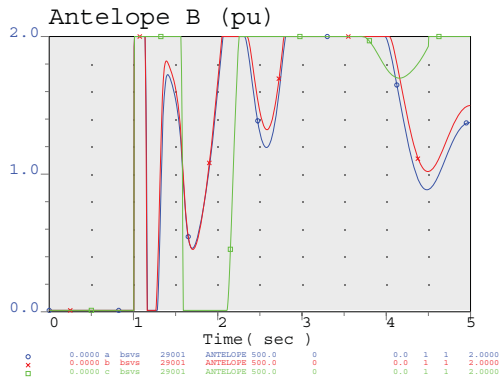

a: 2010hs-FullWind-Midway-Vincent-SPS-dlo-30-0.chf  
 b: 2010hs-Mix-Midway-Vincent-SPS-dlo-30-0.chf  
 c: 2010hs-Type1-Midway-Vincent-SPS-dlo-30-0.chf


d:\kc\caiso  
 Mon Aug 20 10:27:45 2007





### 500kV Voltages

Full Wind, Lo Wind, No Wind for Fault: 2012lspr-Lugo-Vincent-dlo

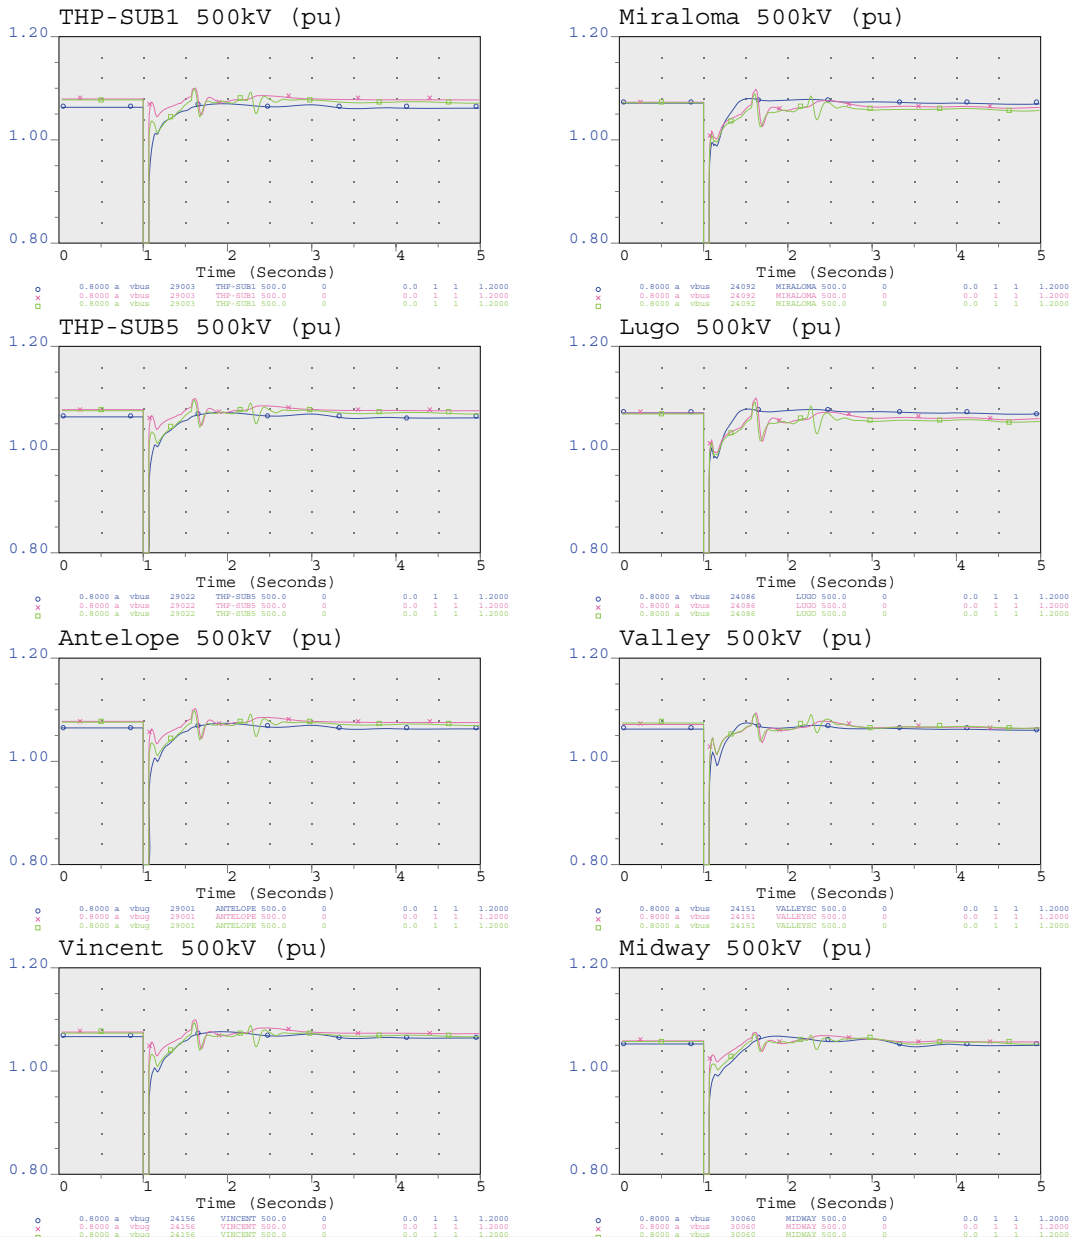


2011-12LW POWER FLOW CASE  
 TEHACHAPI+SUNRISE PROJECTS MODELED  
 JULY 3, 2007  
 CAISO & GE COLLABORATIVE WIND INTEGRATION STUDY  
 UPDATED CASE TO INCLUDE LATEST WIND GEN P.F. MODELS  
 3 phase 4 cycle fault at Lugo  
 Loss of 2 Lugo - Vincent Lines  
 No SC bypass



a:2012lspr-FullWind-Lugo-Vincent-dlo.chf  
 b:2012lspr-LoWind-Lugo-Vincent-dlo.chf  
 c:2012lspr-NoWind-Lugo-Vincent-dlo.chf









d:\projects\caiso  
 Wed Aug 22 14:38:38 2007





### 500kV Frequencies

Full Wind, Lo Wind, No Wind for Fault: 2012lspr-Lugo-Vincent-dlo

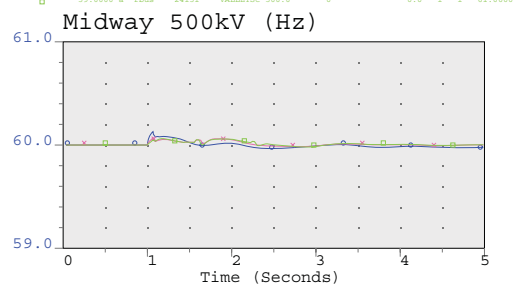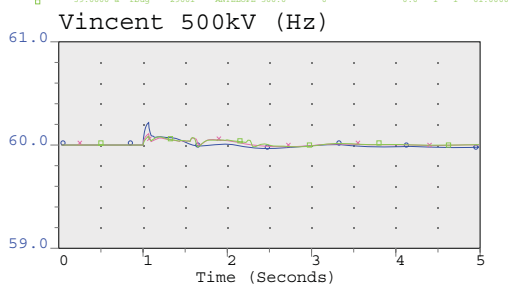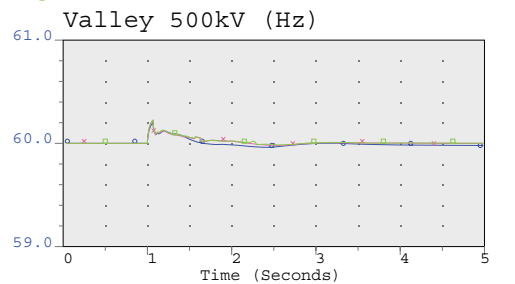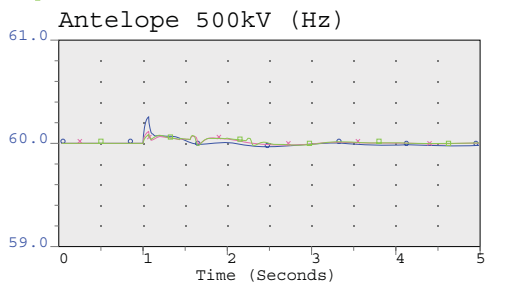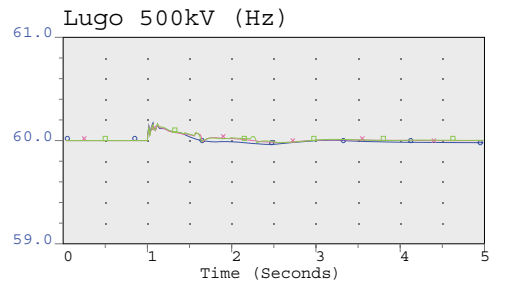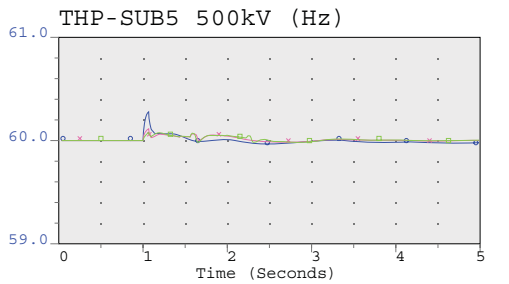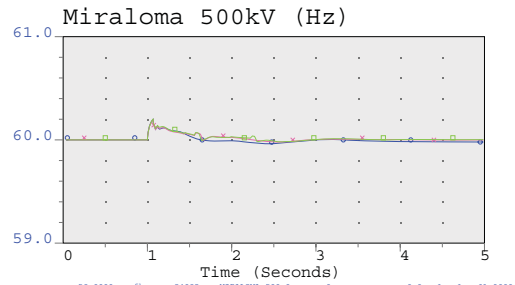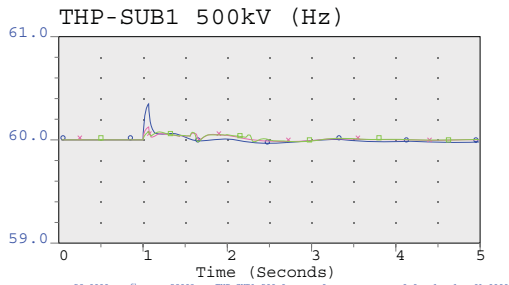




2011-12LW POWER FLOW CASE  
 TEHACHAPI+SUNRISE PROJECTS MODELED  
 JULY 3, 2007  
 CAISO & GE COLLABORATIVE WIND INTEGRATION STUDY  
 UPDATED CASE TO INCLUDE LATEST WIND GEN P.F. MODELS  
 3 phase 4 cycle fault at Lugo  
 Loss of 2 Lugo - Vincent Lines  
 No SC bypass





a:2012lspr-FullWind-Lugo-Vincent-dlo.chf  
 b:2012lspr-LoWind-Lugo-Vincent-dlo.chf  
 c:2012lspr-NoWind-Lugo-Vincent-dlo.chf

d:\projects\caiso  
 Wed Aug 22 14:38:39 2007



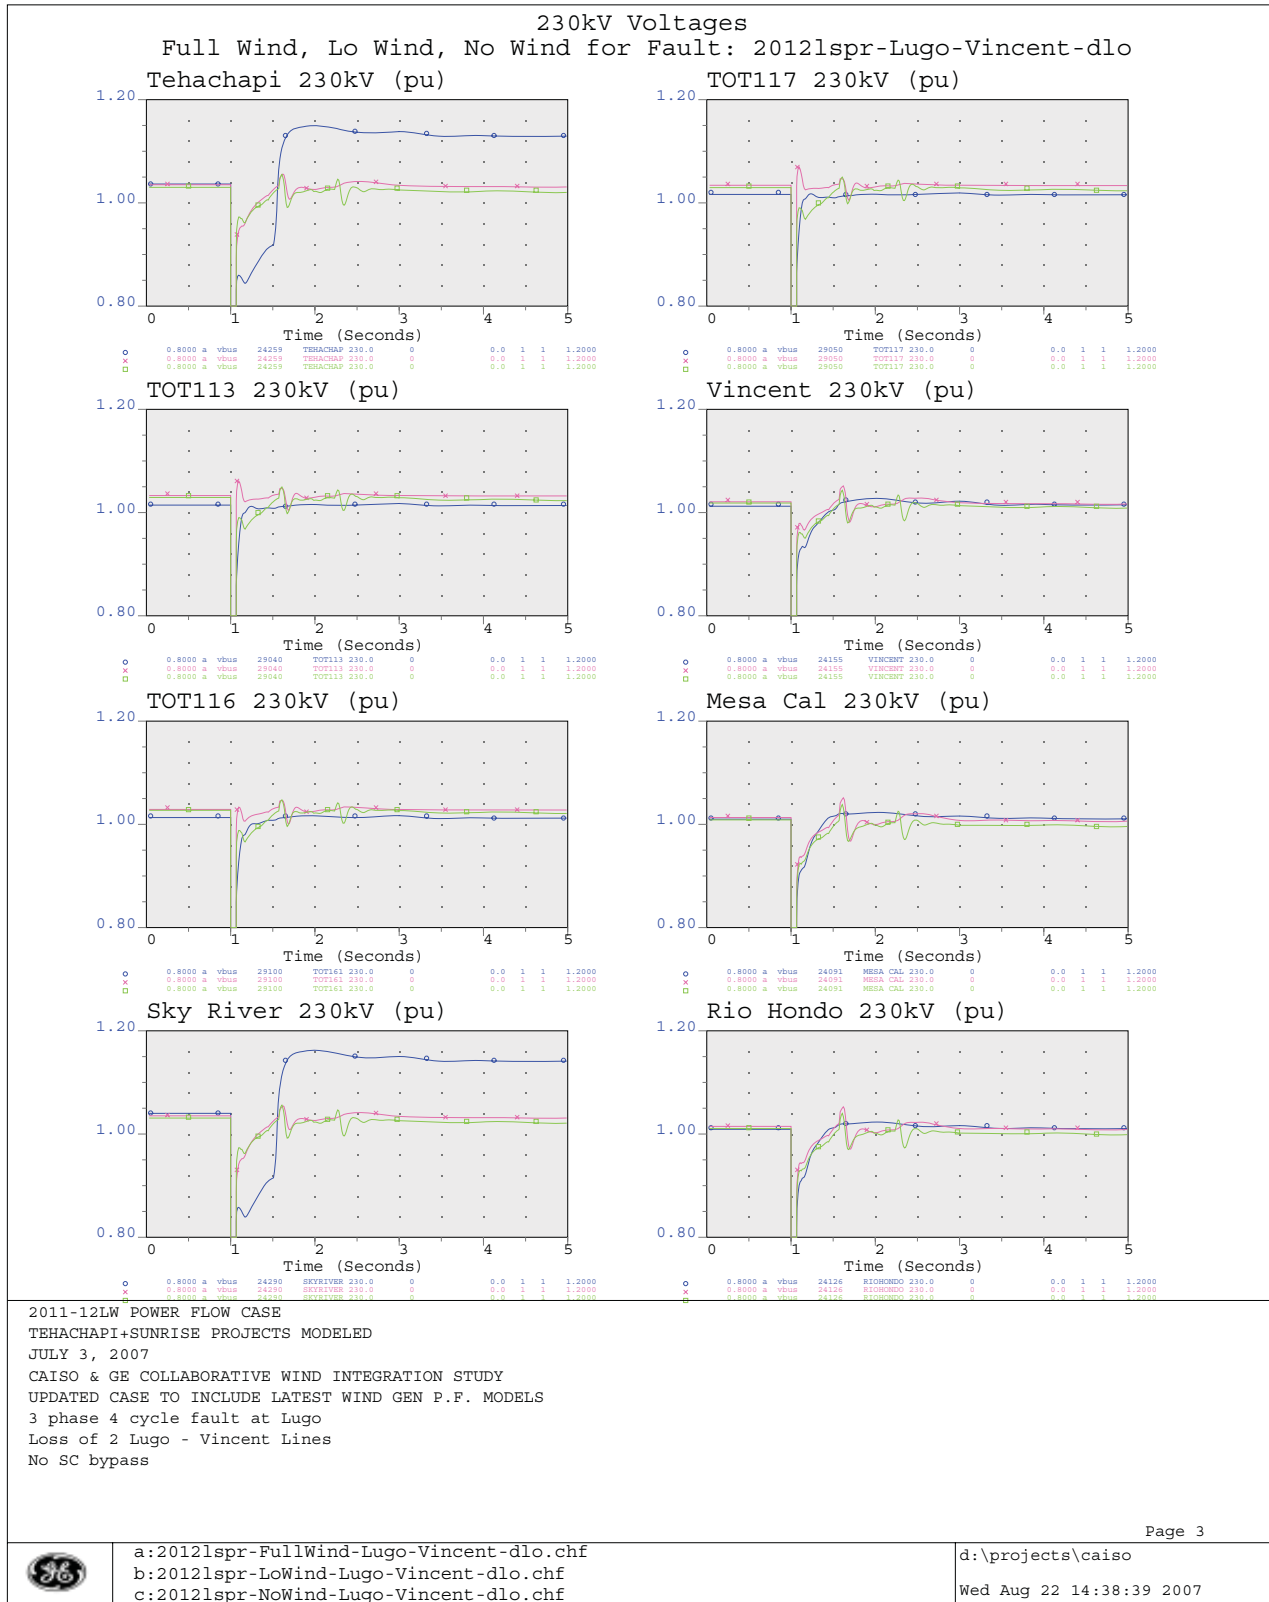


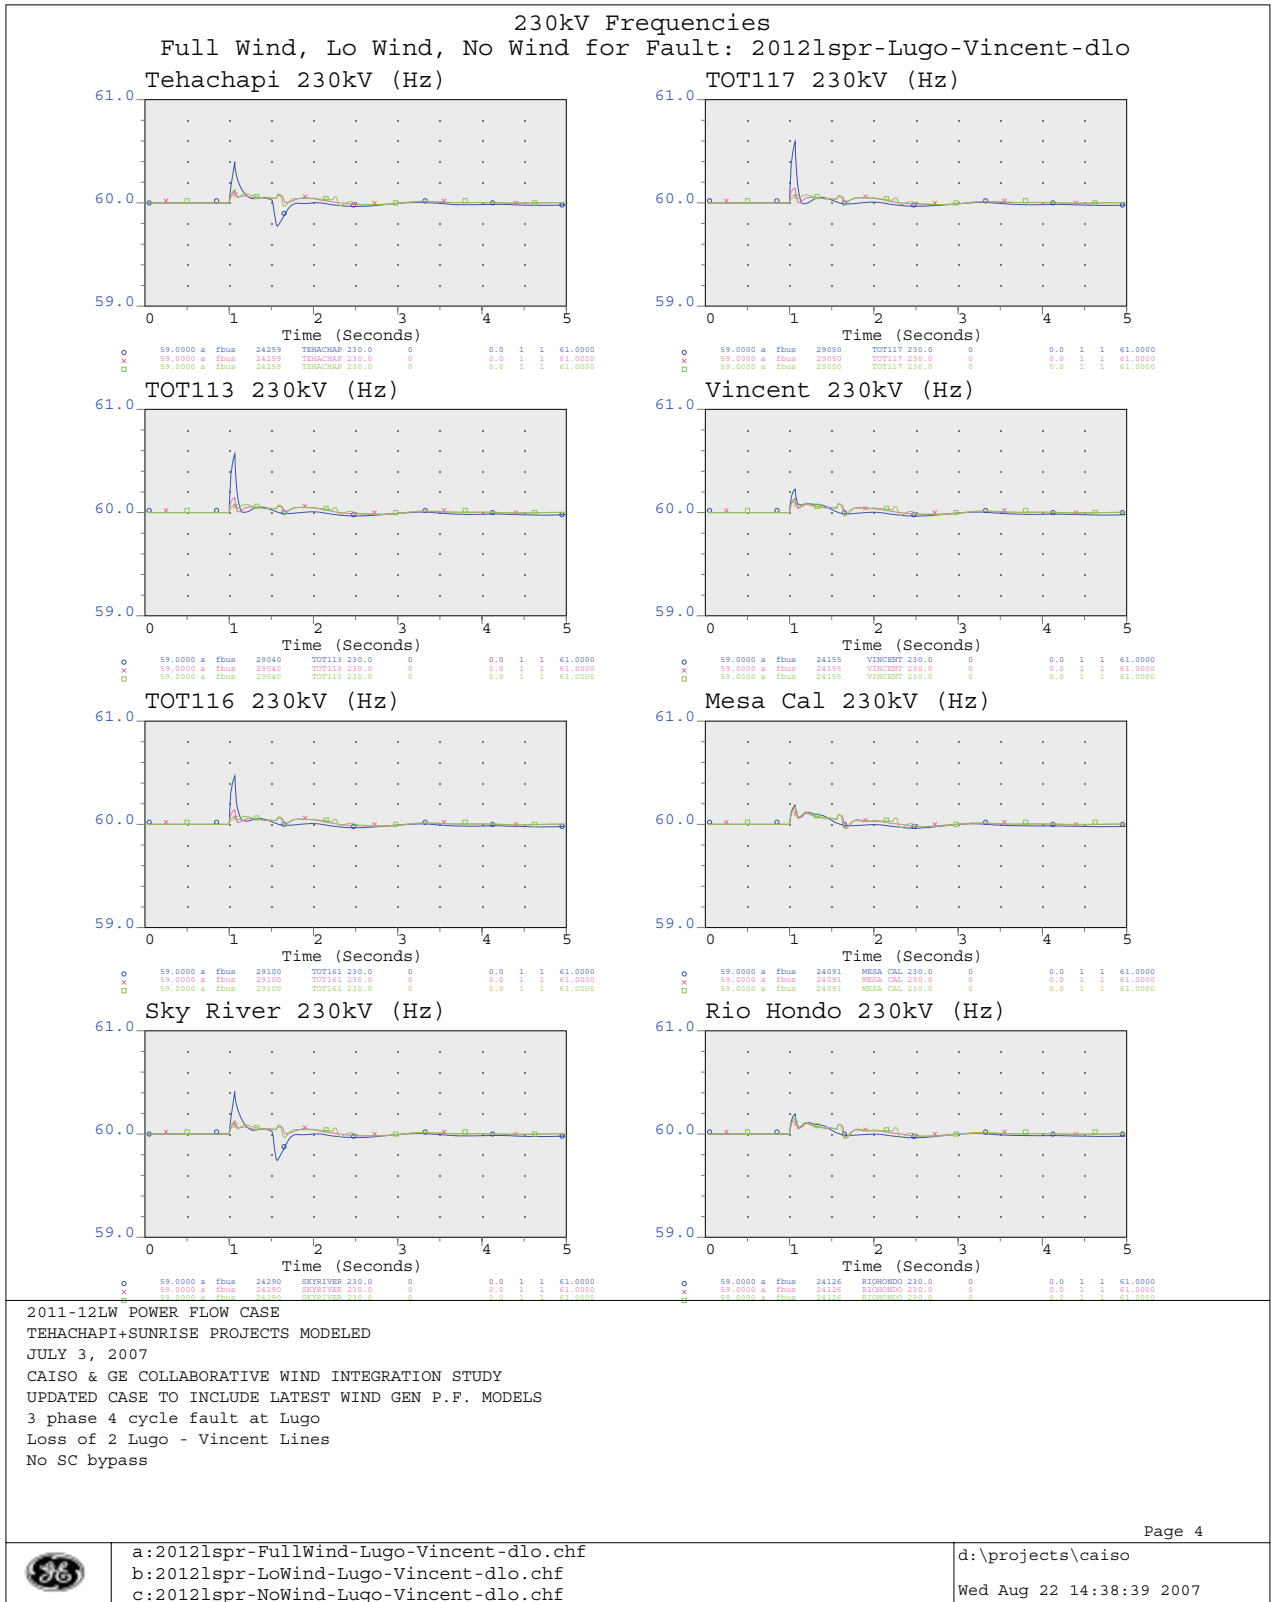




500kV Real Power Flows  
Full Wind, Lo Wind, No Wind for Fault: 2012lspr-Lugo-Vincent-dlo

THP-SUB1-THP-SUB5 500kV (MW)

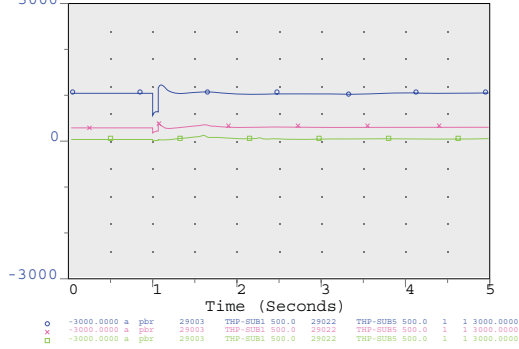


o -3000.0000 a pbr 29001 THP-SUB1 500.0 29022 THP-SUB5 500.0 1 1 3000.0000  
x -3000.0000 a pbr 29001 THP-SUB1 500.0 29022 THP-SUB5 500.0 1 1 3000.0000  
d -3000.0000 a pbr 29001 THP-SUB1 500.0 29022 THP-SUB5 500.0 1 1 3000.0000

Antelope-Vincent 500kV #1 (MW)

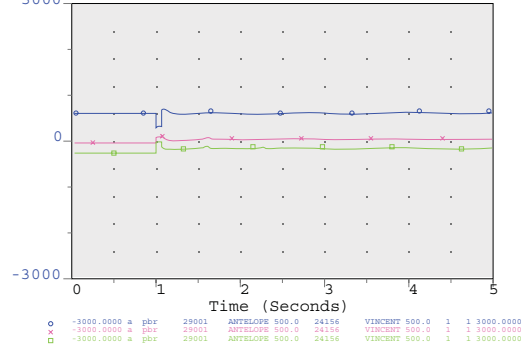


o -3000.0000 a pbr 29001 ANTELOPE 500.0 24156 VINCENT 500.0 1 1 3000.0000  
x -3000.0000 a pbr 29001 ANTELOPE 500.0 24156 VINCENT 500.0 1 1 3000.0000  
d -3000.0000 a pbr 29001 ANTELOPE 500.0 24156 VINCENT 500.0 1 1 3000.0000

Antelope-THP-SUB1 500kV (MW)

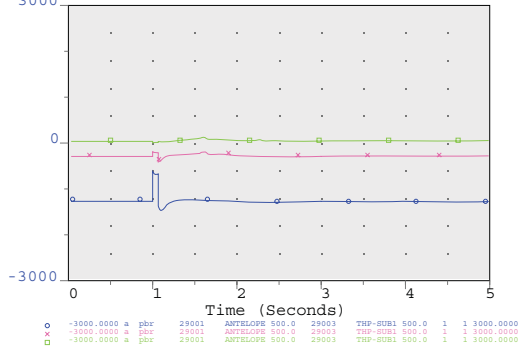


o -3000.0000 a pbr 29001 ANTELOPE 500.0 29001 THP-SUB1 500.0 1 1 3000.0000  
x -3000.0000 a pbr 29001 ANTELOPE 500.0 29001 THP-SUB1 500.0 1 1 3000.0000  
d -3000.0000 a pbr 29001 ANTELOPE 500.0 29001 THP-SUB1 500.0 1 1 3000.0000

Antelope-THP-SUB5 500kV (MW)

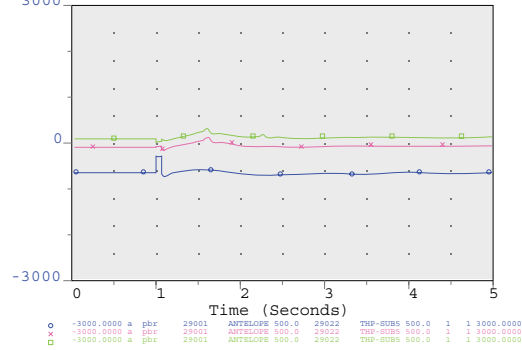


o -3000.0000 a pbr 29001 ANTELOPE 500.0 29022 THP-SUB5 500.0 1 1 3000.0000  
x -3000.0000 a pbr 29001 ANTELOPE 500.0 29022 THP-SUB5 500.0 1 1 3000.0000  
d -3000.0000 a pbr 29001 ANTELOPE 500.0 29022 THP-SUB5 500.0 1 1 3000.0000

THP-SUB5-Vincent 500kV (MW)

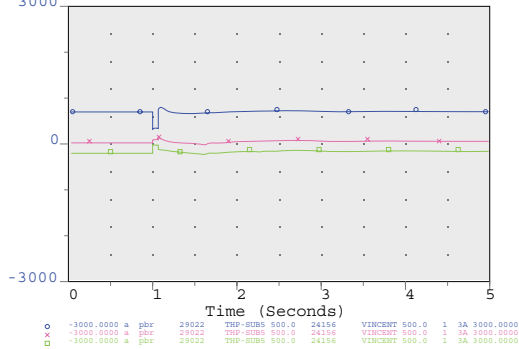

o -3000.0000 a pbr 29022 THP-SUB5 500.0 24156 VINCENT 500.0 1 1A 3000.0000  
x -3000.0000 a pbr 29022 THP-SUB5 500.0 24156 VINCENT 500.0 1 1A 3000.0000  
d -3000.0000 a pbr 29022 THP-SUB5 500.0 24156 VINCENT 500.0 1 1A 3000.0000

Midway-THP-SUB5 500kV (MW)

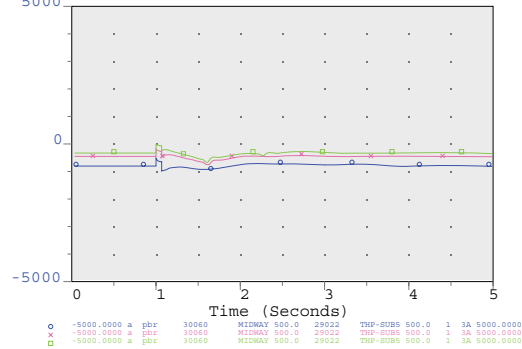


o -5000.0000 a pbr 30060 MIDWAY 500.0 29022 THP-SUB5 500.0 1 1A 5000.0000  
x -5000.0000 a pbr 30060 MIDWAY 500.0 29022 THP-SUB5 500.0 1 1A 5000.0000  
d -5000.0000 a pbr 30060 MIDWAY 500.0 29022 THP-SUB5 500.0 1 1A 5000.0000

2011-12LW POWER FLOW CASE  
TEHACHAPI+SUNRISE PROJECTS MODELED  
JULY 3, 2007  
CAISO & GE COLLABORATIVE WIND INTEGRATION STUDY  
UPDATED CASE TO INCLUDE LATEST WIND GEN P.F. MODELS  
3 phase 4 cycle fault at Lugo  
Loss of 2 Lugo - Vincent Lines  
No SC bypass



a:2012lspr-FullWind-Lugo-Vincent-dlo.chf  
b:2012lspr-LoWind-Lugo-Vincent-dlo.chf  
c:2012lspr-NoWind-Lugo-Vincent-dlo.chf


d:\projects\caiso  
Wed Aug 22 14:38:39 2007









500kV Reactive Power Flows  
Full Wind, Lo Wind, No Wind for Fault: 2012lspr-Lugo-Vincent-dlo

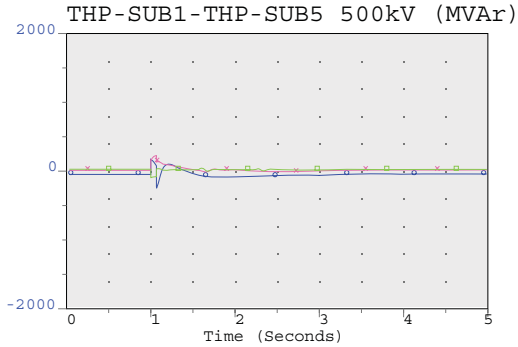


○ -2000.0000 a qbr 29003 THP-SUB1 500.0 29022 THP-SUB5 500.0 1 1 2000.0000  
 × -2000.0000 a qbr 29003 THP-SUB1 500.0 29022 THP-SUB5 500.0 1 1 2000.0000  
 □ -2000.0000 a qbr 29003 THP-SUB1 500.0 29022 THP-SUB5 500.0 1 1 2000.0000

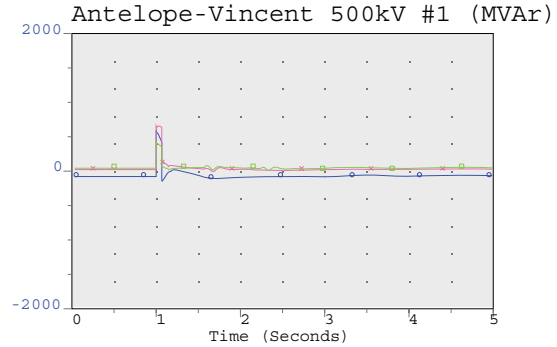


○ -2000.0000 a qbr 29001 ANTELOPE 500.0 24156 VINCENT 500.0 1 1 2000.0000  
 × -2000.0000 a qbr 29001 ANTELOPE 500.0 24156 VINCENT 500.0 1 1 2000.0000  
 □ -2000.0000 a qbr 29001 ANTELOPE 500.0 24156 VINCENT 500.0 1 1 2000.0000

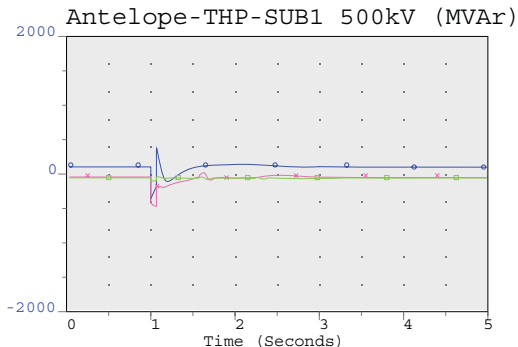


○ -2000.0000 a qbr 29001 ANTELOPE 500.0 29003 THP-SUB1 500.0 1 1 2000.0000  
 × -2000.0000 a qbr 29001 ANTELOPE 500.0 29003 THP-SUB1 500.0 1 1 2000.0000  
 □ -2000.0000 a qbr 29001 ANTELOPE 500.0 29003 THP-SUB1 500.0 1 1 2000.0000

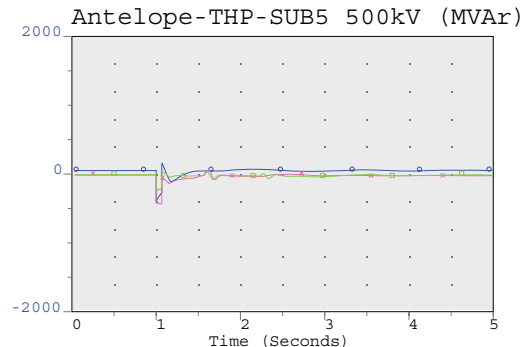

○ -2000.0000 a qbr 29001 ANTELOPE 500.0 29022 THP-SUB5 500.0 1 1 2000.0000  
 × -2000.0000 a qbr 29001 ANTELOPE 500.0 29022 THP-SUB5 500.0 1 1 2000.0000  
 □ -2000.0000 a qbr 29001 ANTELOPE 500.0 29022 THP-SUB5 500.0 1 1 2000.0000

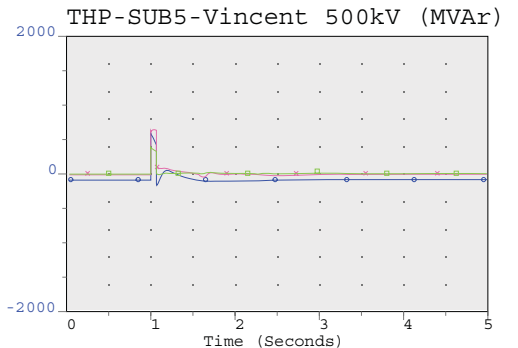

○ -2000.0000 a qbr 29022 THP-SUB5 500.0 24156 VINCENT 500.0 1 3A 2000.0000  
 × -2000.0000 a qbr 29022 THP-SUB5 500.0 24156 VINCENT 500.0 1 3A 2000.0000  
 □ -2000.0000 a qbr 29022 THP-SUB5 500.0 24156 VINCENT 500.0 1 3A 2000.0000

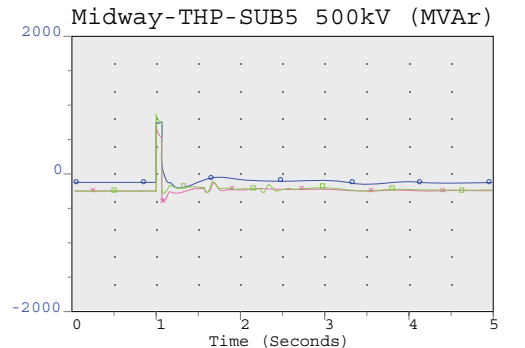


○ -2000.0000 a qbr 30060 MIDWAY 500.0 29022 THP-SUB5 500.0 1 3A 2000.0000  
 × -2000.0000 a qbr 30060 MIDWAY 500.0 29022 THP-SUB5 500.0 1 3A 2000.0000  
 □ -2000.0000 a qbr 30060 MIDWAY 500.0 29022 THP-SUB5 500.0 1 3A 2000.0000


2011-12LW POWER FLOW CASE  
 TEHACHAPI+SUNRISE PROJECTS MODELED  
 JULY 3, 2007  
 CAISO & GE COLLABORATIVE WIND INTEGRATION STUDY  
 UPDATED CASE TO INCLUDE LATEST WIND GEN P.F. MODELS  
 3 phase 4 cycle fault at Lugo  
 Loss of 2 Lugo - Vincent Lines  
 No SC bypass



a:2012lspr-FullWind-Lugo-Vincent-dlo.chf  
 b:2012lspr-LoWind-Lugo-Vincent-dlo.chf  
 c:2012lspr-NoWind-Lugo-Vincent-dlo.chf

d:\projects\caiso  
 Wed Aug 22 14:38:39 2007



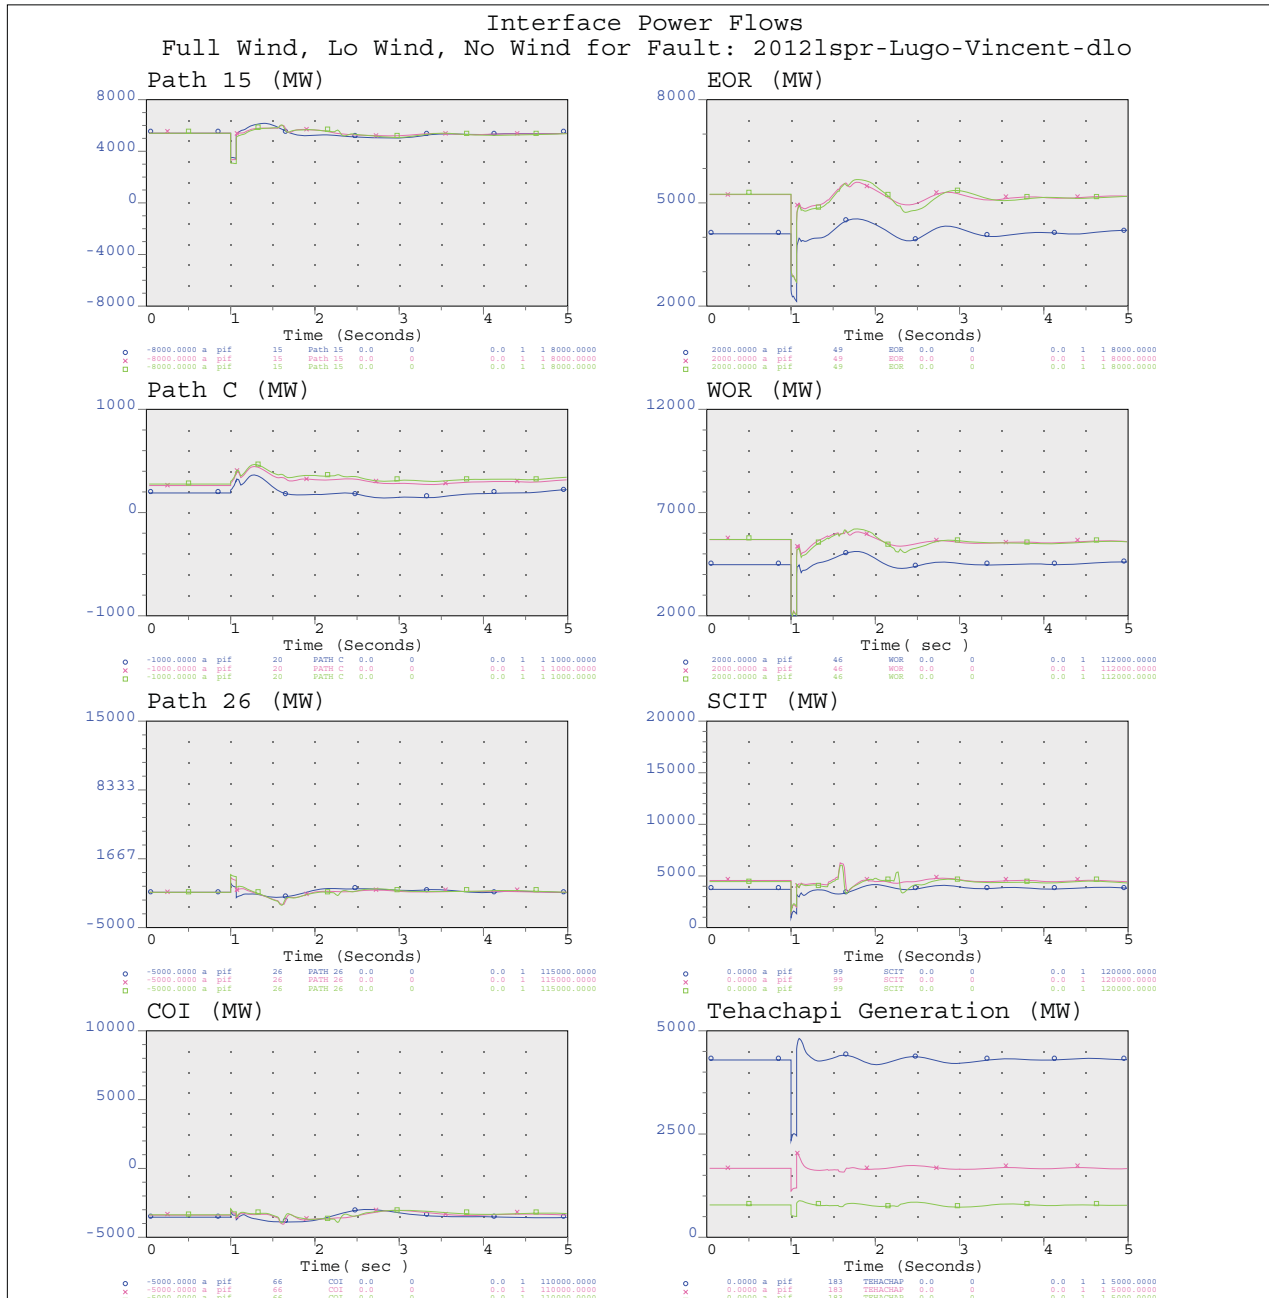


2011-12LW POWER FLOW CASE  
 TEHACHAPI+SUNRISE PROJECTS MODELED  
 JULY 3, 2007  
 CAISO & GE COLLABORATIVE WIND INTEGRATION STUDY  
 UPDATED CASE TO INCLUDE LATEST WIND GEN P.F. MODELS  
 3 phase 4 cycle fault at Lugo  
 Loss of 2 Lugo - Vincent Lines  
 No SC bypass



a:2012lspr-FullWind-Lugo-Vincent-dlo.chf  
 b:2012lspr-LoWind-Lugo-Vincent-dlo.chf  
 c:2012lspr-NoWind-Lugo-Vincent-dlo.chf







d:\projects\caiso  
 Wed Aug 22 14:38:39 2007





SVC Variables

Full Wind, Lo Wind, No Wind for Fault: 2012lspr-Lugo-Vincent-dlo

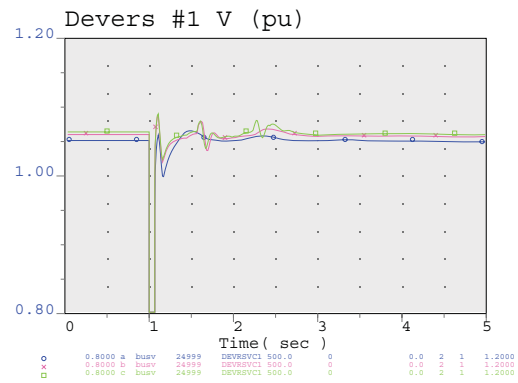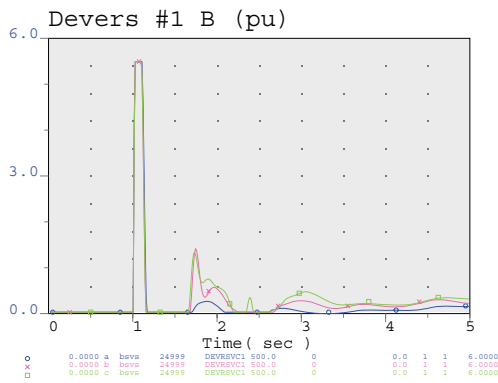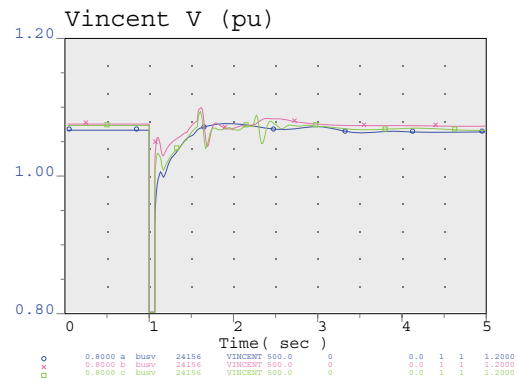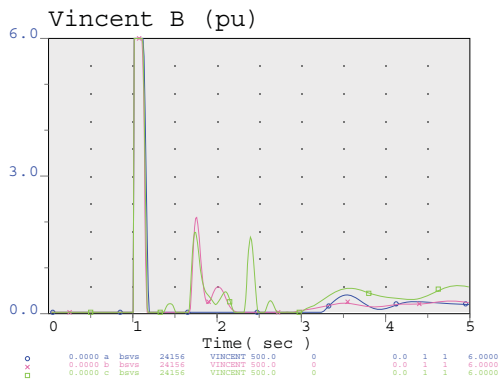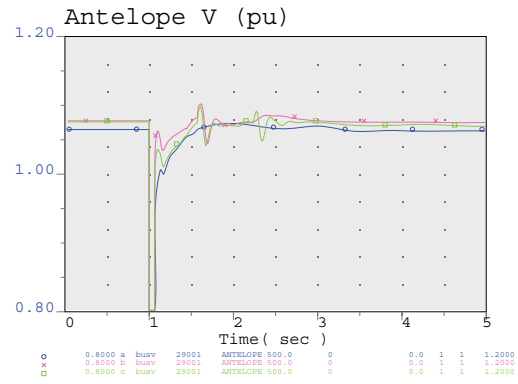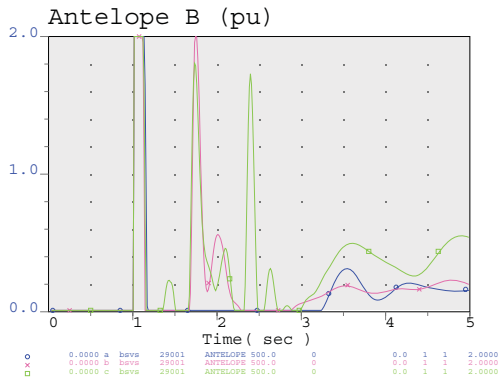

2011-12LW POWER FLOW CASE  
 TEHACHAPI+SUNRISE PROJECTS MODELED  
 JULY 3, 2007  
 CAISO & GE COLLABORATIVE WIND INTEGRATION STUDY  
 UPDATED CASE TO INCLUDE LATEST WIND GEN P.F. MODELS  
 3 phase 4 cycle fault at Lugo  
 Loss of 2 Lugo - Vincent Lines  
 No SC bypass




a:2012lspr-FullWind-Lugo-Vincent-dlo.chf  
 b:2012lspr-LoWind-Lugo-Vincent-dlo.chf  
 c:2012lspr-NoWind-Lugo-Vincent-dlo.chf

d:\projects\caiso  
 Wed Aug 22 14:38:39 2007







500kV Voltages  
Full Wind, Lo Wind, No Wind for Fault: 2012lspr-Midway-Vincent-dlo-noSPS

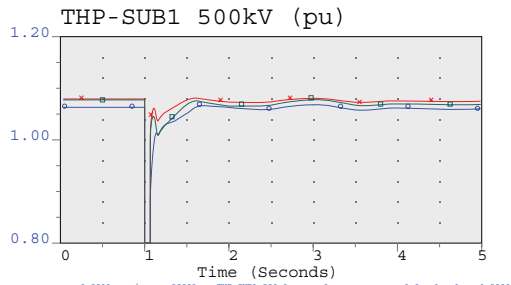


o	0.8000 a vbus	29003	THP-SUB1 500.0	0	0.0	1	1	1.2000
x	0.8000 a vbus	29003	THP-SUB1 500.0	0	0.0	1	1	1.2000
d	0.8000 a vbus	29003	THP-SUB1 500.0	0	0.0	1	1	1.2000

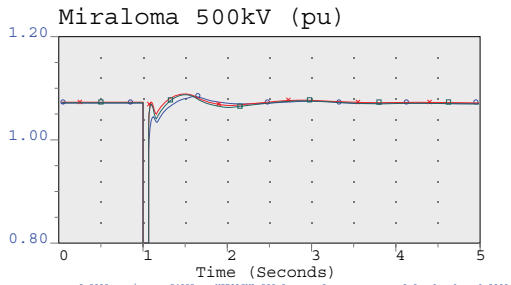


o	0.8000 a vbus	24092	MIRALOMA 500.0	0	0.0	1	1	1.2000
x	0.8000 a vbus	24092	MIRALOMA 500.0	0	0.0	1	1	1.2000
d	0.8000 a vbus	24092	MIRALOMA 500.0	0	0.0	1	1	1.2000

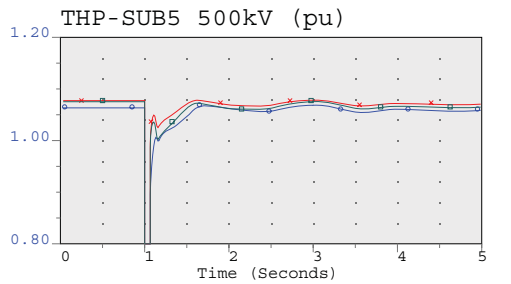


o	0.8000 a vbus	29022	THP-SUB5 500.0	0	0.0	1	1	1.2000
x	0.8000 a vbus	29022	THP-SUB5 500.0	0	0.0	1	1	1.2000
d	0.8000 a vbus	29022	THP-SUB5 500.0	0	0.0	1	1	1.2000

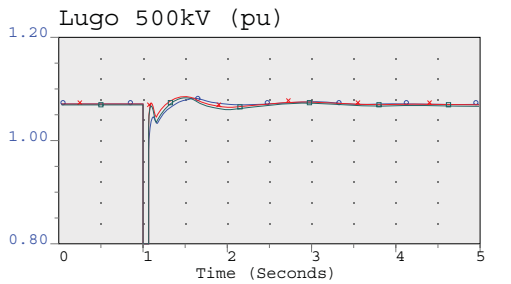


o	0.8000 a vbus	24086	LUGO 500.0	0	0.0	1	1	1.2000
x	0.8000 a vbus	24086	LUGO 500.0	0	0.0	1	1	1.2000
d	0.8000 a vbus	24086	LUGO 500.0	0	0.0	1	1	1.2000

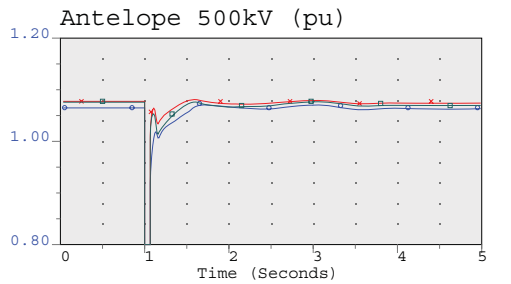


o	0.8000 a vbus	28901	ANTELOPE 500.0	0	0.0	1	1	1.2000
x	0.8000 a vbus	28901	ANTELOPE 500.0	0	0.0	1	1	1.2000
d	0.8000 a vbus	28901	ANTELOPE 500.0	0	0.0	1	1	1.2000

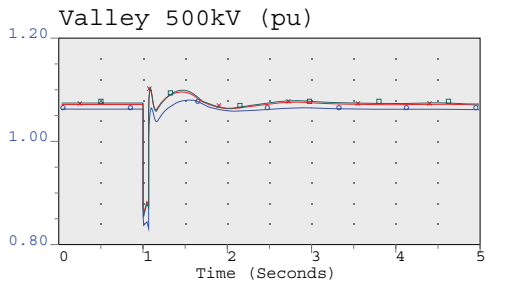

o	0.8000 a vbus	24151	VALLEYS 500.0	0	0.0	1	1	1.2000
x	0.8000 a vbus	24151	VALLEYS 500.0	0	0.0	1	1	1.2000
d	0.8000 a vbus	24151	VALLEYS 500.0	0	0.0	1	1	1.2000

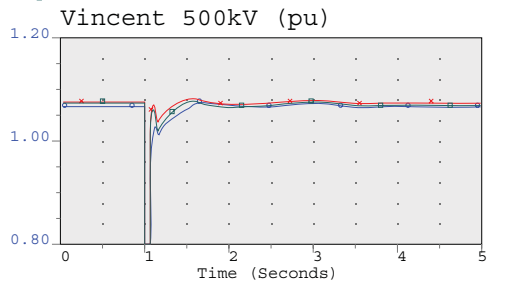

o	0.8000 a vbus	24156	VINCENT 500.0	0	0.0	1	1	1.2000
x	0.8000 a vbus	24156	VINCENT 500.0	0	0.0	1	1	1.2000
d	0.8000 a vbus	24156	VINCENT 500.0	0	0.0	1	1	1.2000

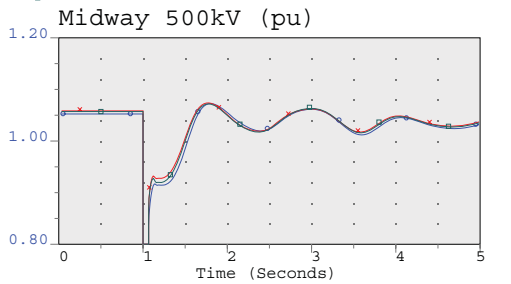


o	0.8000 a vbus	30860	MIDWAY 500.0	0	0.0	1	1	1.2000
x	0.8000 a vbus	30860	MIDWAY 500.0	0	0.0	1	1	1.2000
d	0.8000 a vbus	30860	MIDWAY 500.0	0	0.0	1	1	1.2000



2011-12LW POWER FLOW CASE  
TEHACHAPI+SUNRISE PROJECTS MODELED  
JULY 3, 2007  
CAISO & GE COLLABORATIVE WIND INTEGRATION STUDY  
UPDATED CASE TO INCLUDE LATEST WIND GEN P.F. MODELS  
3 phase 4 cycle fault at Midway  
Loss of 2 Midway - Vincent Lines  
SPS



a:2012lspr-FullWind-Midway-Vincent-dlo-noSPS.chf  
b:2012lspr-LoWind-Midway-Vincent-dlo-noSPS.chf  
c:2012lspr-NoWind-Midway-Vincent-dlo-noSPS.chf









d:\projects\caiso  
Mon Aug 27 11:44:30 2007



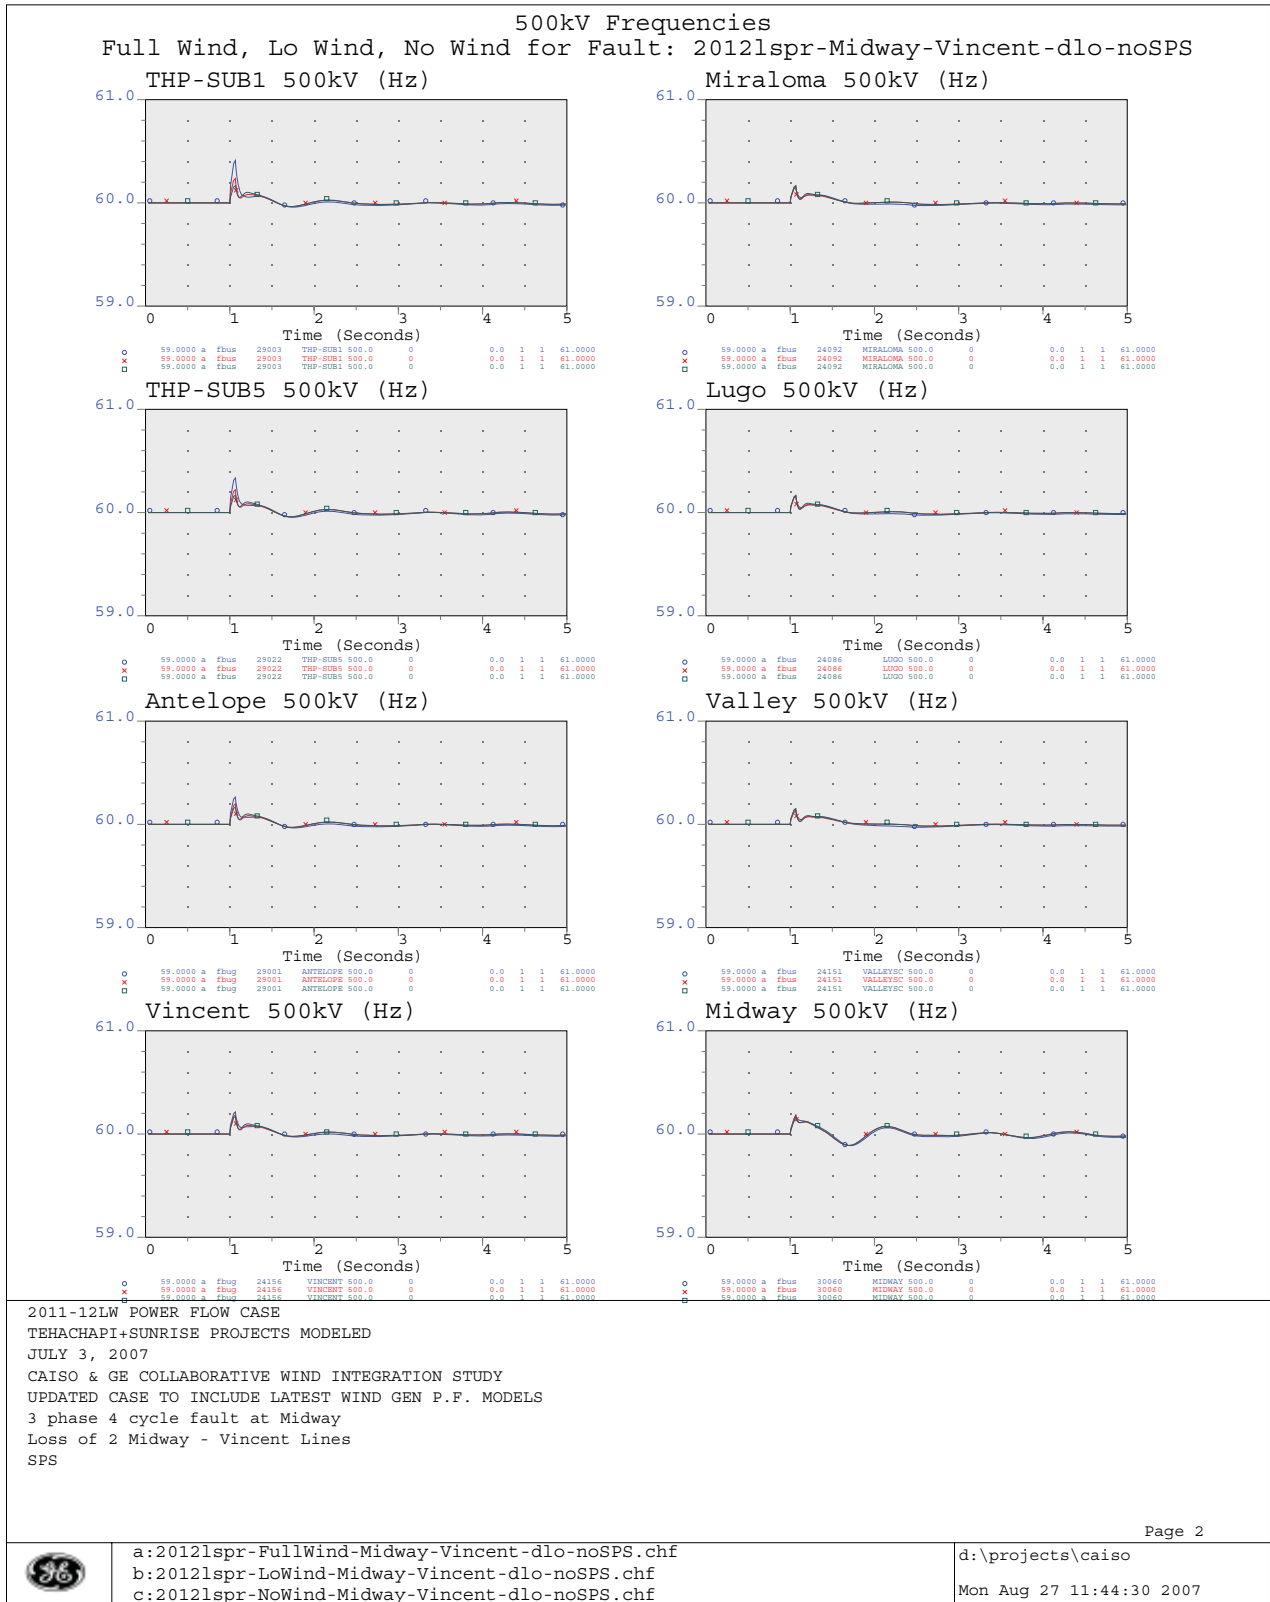




230kV Voltages  
Full Wind, Lo Wind, No Wind for Fault: 2012lspr-Midway-Vincent-dlo-noSPS

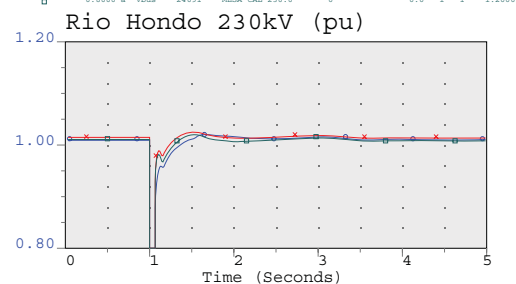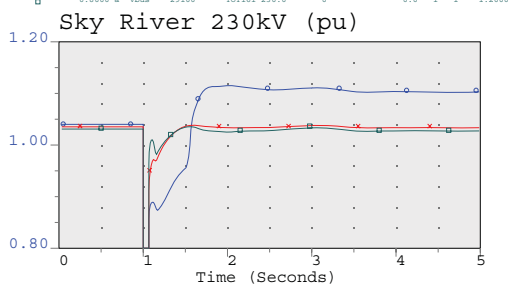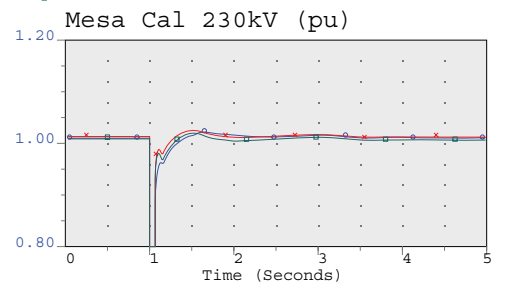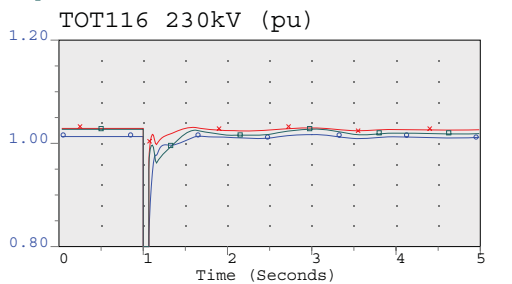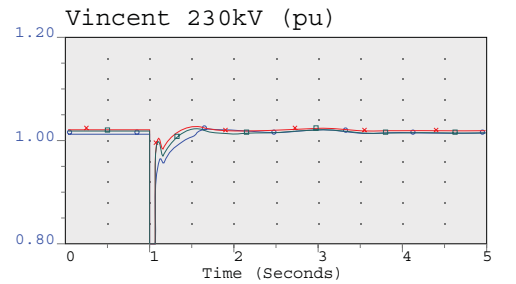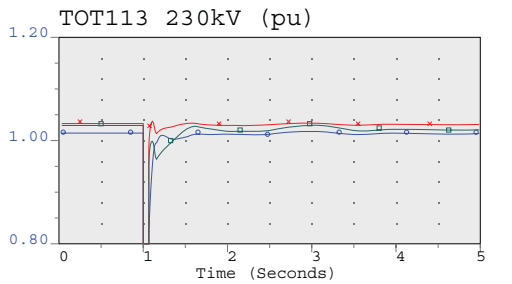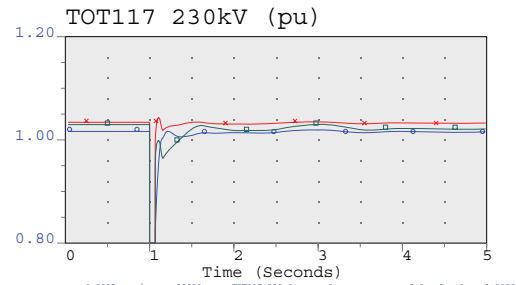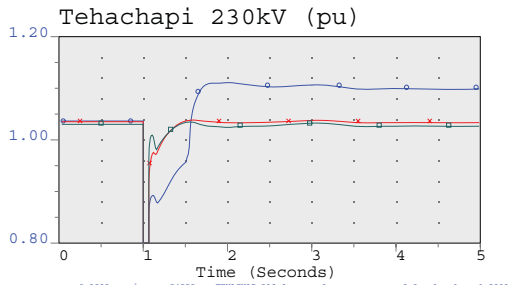

2011-12LW POWER FLOW CASE  
TEHACHAPI+SUNRISE PROJECTS MODELED  
JULY 3, 2007  
CAISO & GE COLLABORATIVE WIND INTEGRATION STUDY  
UPDATED CASE TO INCLUDE LATEST WIND GEN P.F. MODELS  
3 phase 4 cycle fault at Midway  
Loss of 2 Midway - Vincent Lines  
SPS









a:2012lspr-FullWind-Midway-Vincent-dlo-noSPS.chf  
b:2012lspr-LoWind-Midway-Vincent-dlo-noSPS.chf  
c:2012lspr-NoWind-Midway-Vincent-dlo-noSPS.chf

d:\projects\caiso  
Mon Aug 27 11:44:30 2007





230kV Frequencies  
Full Wind, Lo Wind, No Wind for Fault: 2012lspr-Midway-Vincent-dlo-noSPS

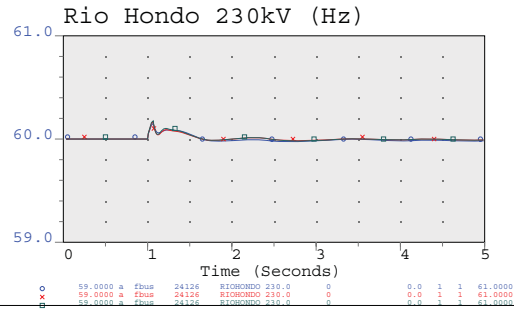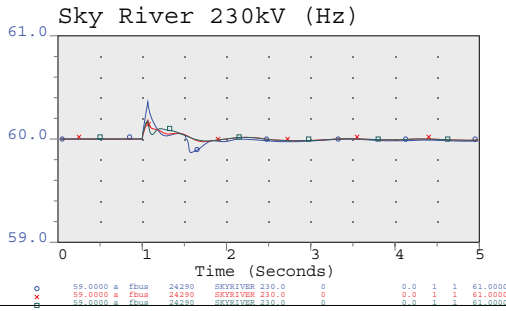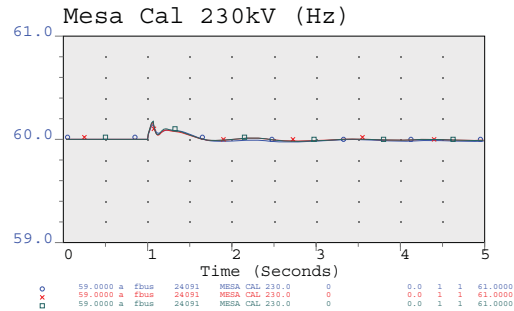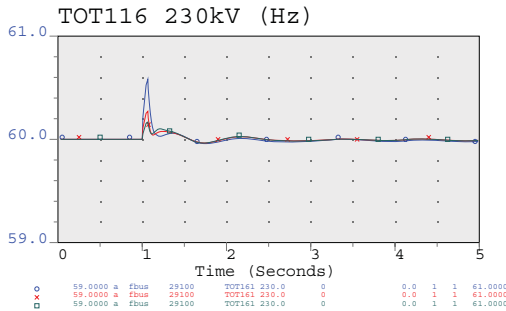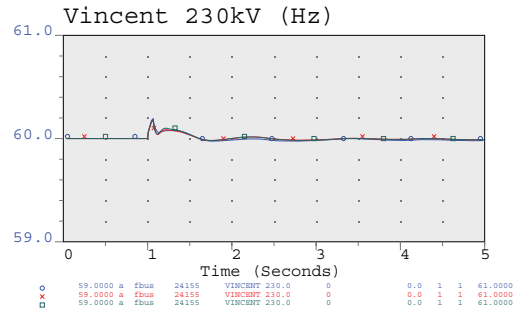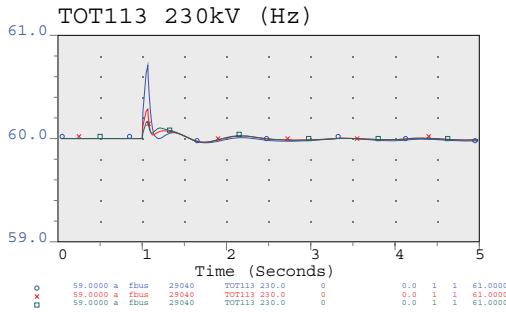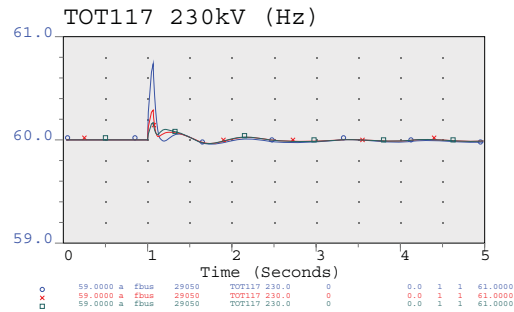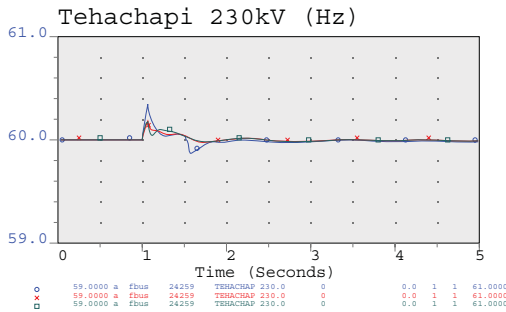

2011-12LW POWER FLOW CASE  
TEHACHAPI+SUNRISE PROJECTS MODELED  
JULY 3, 2007  
CAISO & GE COLLABORATIVE WIND INTEGRATION STUDY  
UPDATED CASE TO INCLUDE LATEST WIND GEN P.F. MODELS  
3 phase 4 cycle fault at Midway  
Loss of 2 Midway - Vincent Lines  
SPS



a:2012lspr-FullWind-Midway-Vincent-dlo-noSPS.chf  
b:2012lspr-LoWind-Midway-Vincent-dlo-noSPS.chf  
c:2012lspr-NoWind-Midway-Vincent-dlo-noSPS.chf







d:\projects\caiso  
Mon Aug 27 11:44:30 2007







500kV Real Power Flows  
Full Wind, Lo Wind, No Wind for Fault: 2012lspr-Midway-Vincent-dlo-noSPS

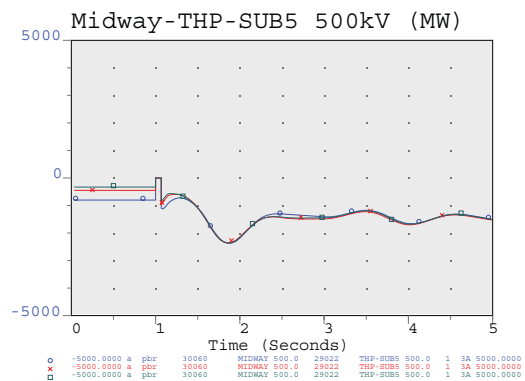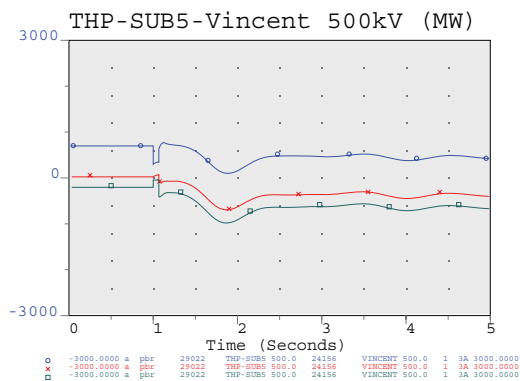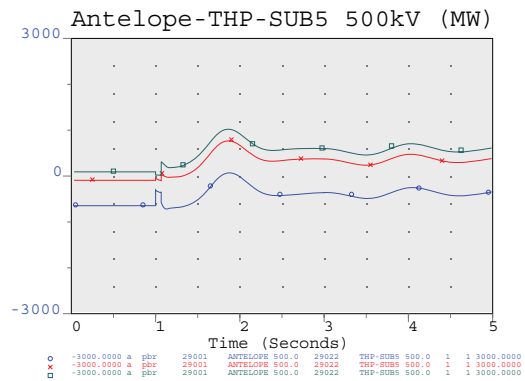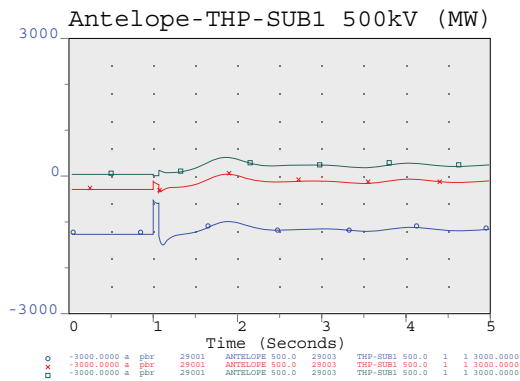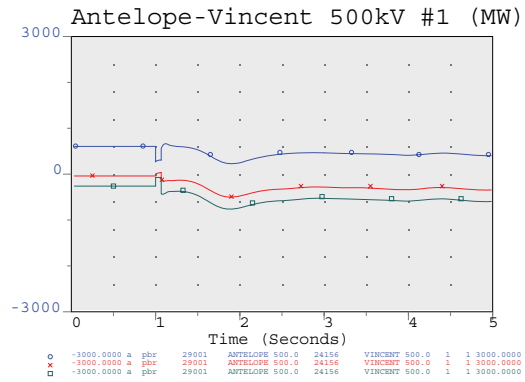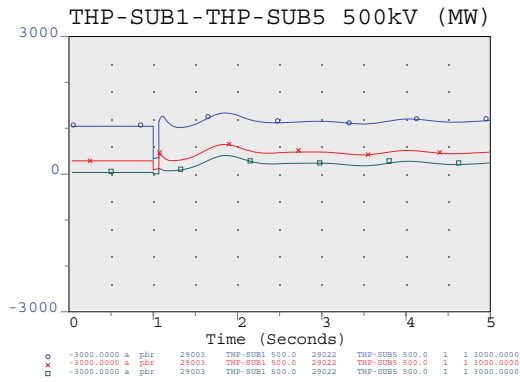


2011-12LW POWER FLOW CASE  
TEHACHAPI+SUNRISE PROJECTS MODELED  
JULY 3, 2007  
CAISO & GE COLLABORATIVE WIND INTEGRATION STUDY  
UPDATED CASE TO INCLUDE LATEST WIND GEN P.F. MODELS  
3 phase 4 cycle fault at Midway  
Loss of 2 Midway - Vincent Lines  
SPS









a:2012lspr-FullWind-Midway-Vincent-dlo-noSPS.chf  
b:2012lspr-LoWind-Midway-Vincent-dlo-noSPS.chf  
c:2012lspr-NoWind-Midway-Vincent-dlo-noSPS.chf

d:\projects\caiso  
Mon Aug 27 11:44:30 2007





500kV Reactive Power Flows  
Full Wind, Lo Wind, No Wind for Fault: 2012lspr-Midway-Vincent-dlo-noSPS

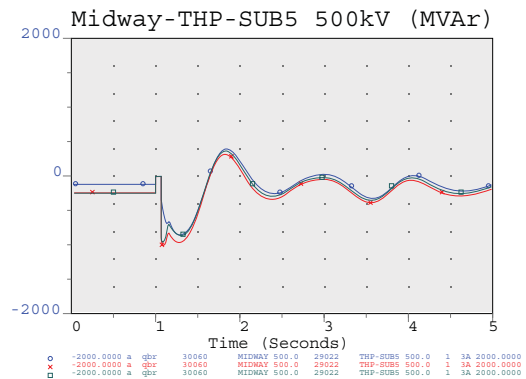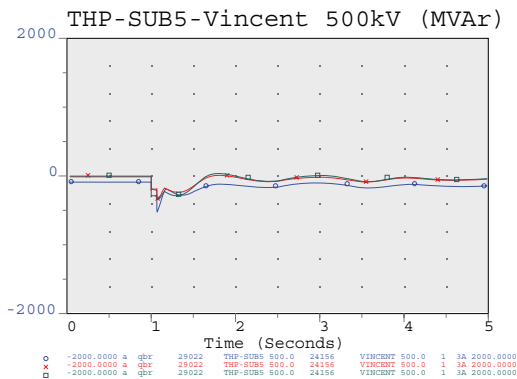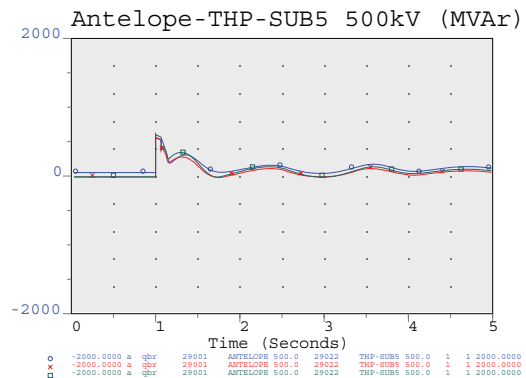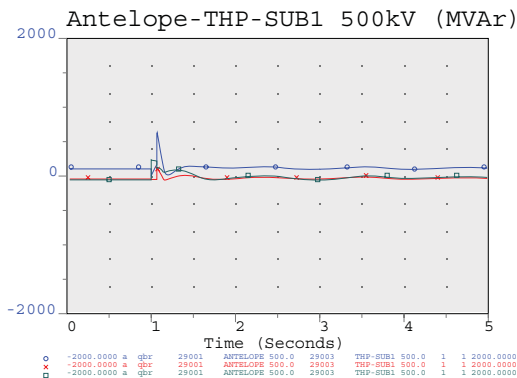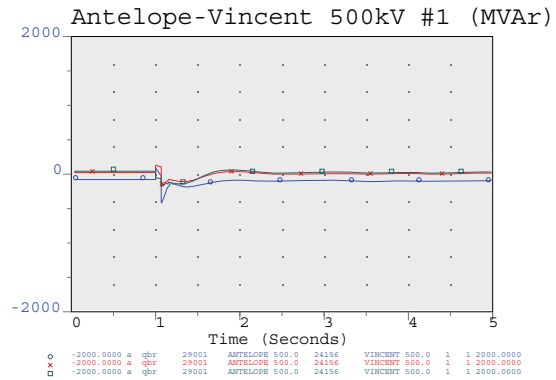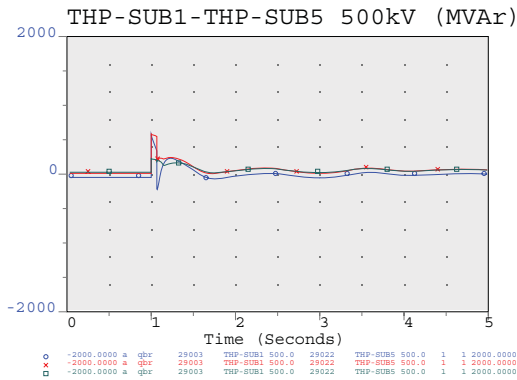

2011-12LW POWER FLOW CASE  
TEHACHAPI+SUNRISE PROJECTS MODELED  
JULY 3, 2007  
CAISO & GE COLLABORATIVE WIND INTEGRATION STUDY  
UPDATED CASE TO INCLUDE LATEST WIND GEN P.F. MODELS  
3 phase 4 cycle fault at Midway  
Loss of 2 Midway - Vincent Lines  
SPS











a:2012lspr-FullWind-Midway-Vincent-dlo-noSPS.chf  
b:2012lspr-LoWind-Midway-Vincent-dlo-noSPS.chf  
c:2012lspr-NoWind-Midway-Vincent-dlo-noSPS.chf

d:\projects\caiso  
Mon Aug 27 11:44:30 2007






Interface Power Flows  
Full Wind, Lo Wind, No Wind for Fault: 2012lspr-Midway-Vincent-dlo-noSPS

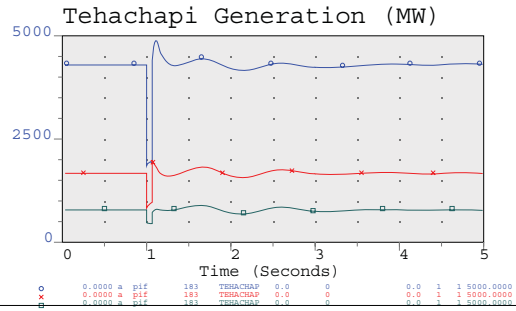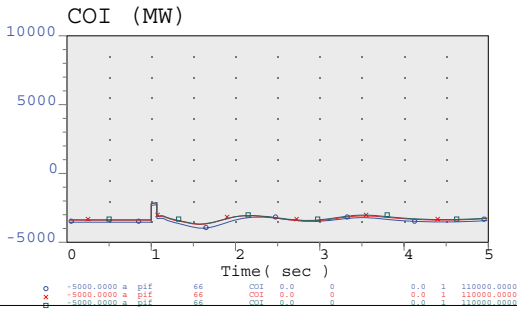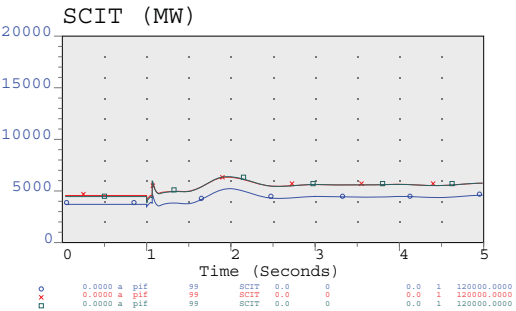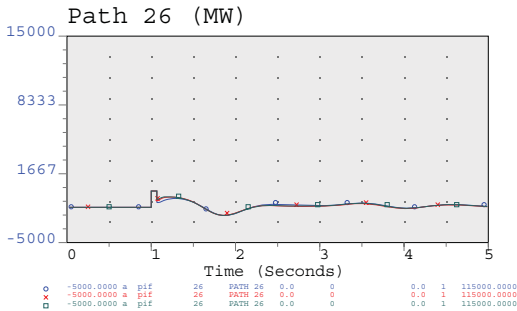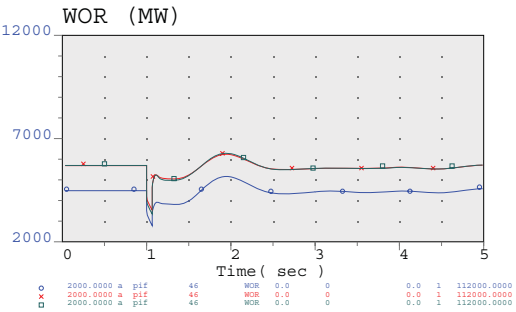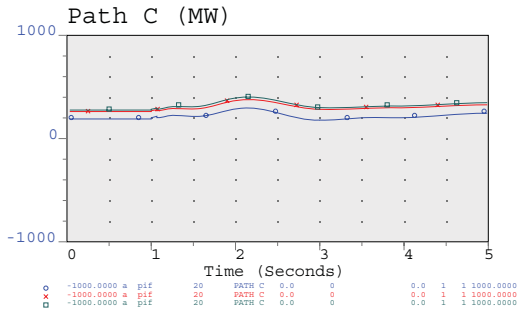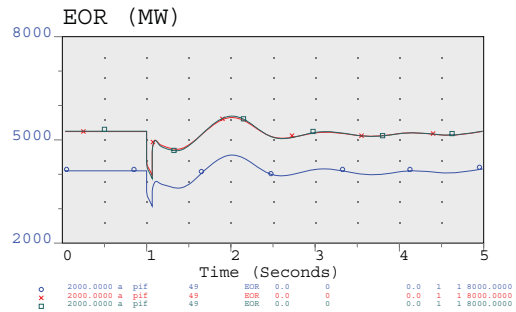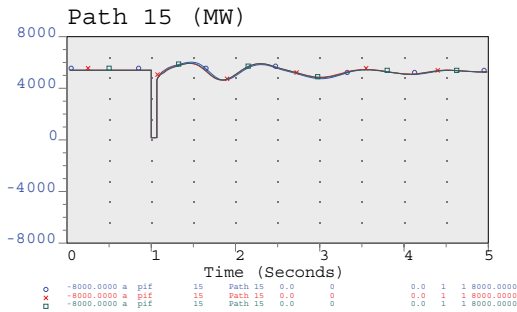

2011-12LW POWER FLOW CASE  
TEHACHAPI+SUNRISE PROJECTS MODELED  
JULY 3, 2007  
CAISO & GE COLLABORATIVE WIND INTEGRATION STUDY  
UPDATED CASE TO INCLUDE LATEST WIND GEN P.F. MODELS  
3 phase 4 cycle fault at Midway  
Loss of 2 Midway - Vincent Lines  
SPS







a: 2012lspr-FullWind-Midway-Vincent-dlo-noSPS.chf  
b: 2012lspr-LoWind-Midway-Vincent-dlo-noSPS.chf  
c: 2012lspr-NoWind-Midway-Vincent-dlo-noSPS.chf

d:\projects\caiso  
Mon Aug 27 11:44:30 2007





SVC Variables  
Full Wind, Lo Wind, No Wind for Fault: 2012lspr-Midway-Vincent-dlo-noSPS

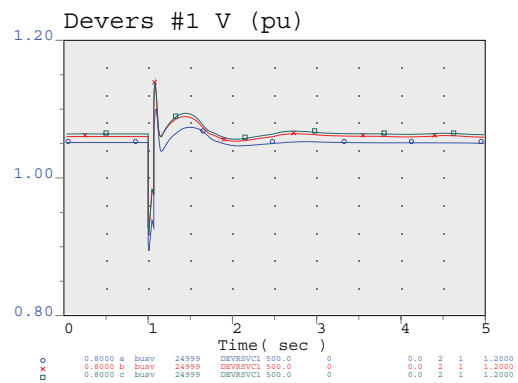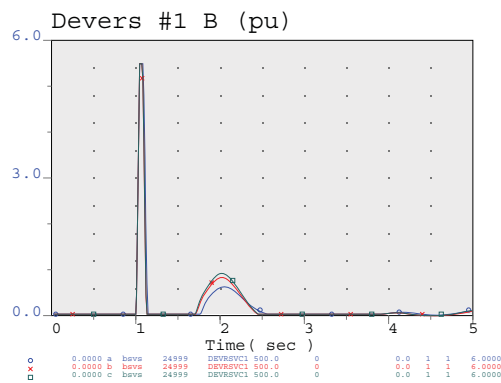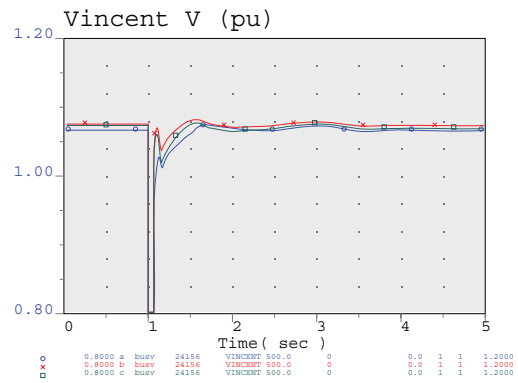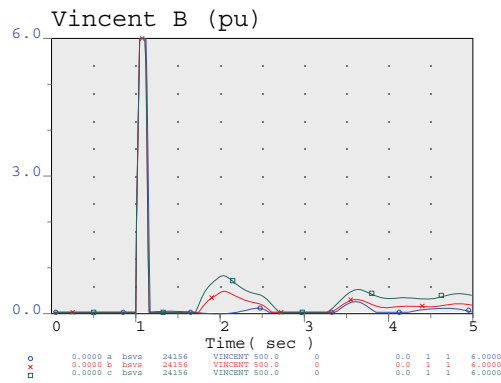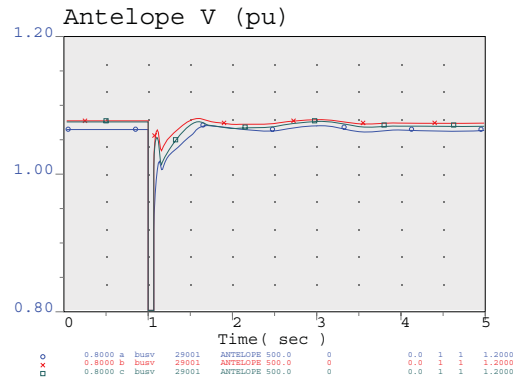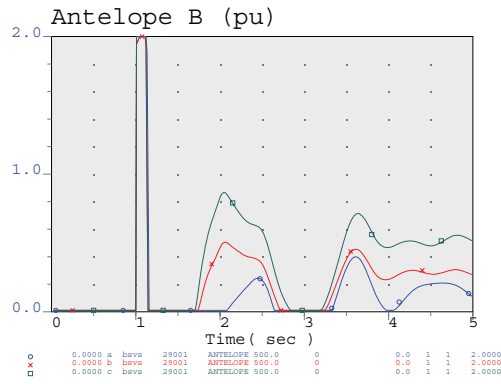

2011-12LW POWER FLOW CASE  
TEHACHAPI+SUNRISE PROJECTS MODELED  
JULY 3, 2007  
CAISO & GE COLLABORATIVE WIND INTEGRATION STUDY  
UPDATED CASE TO INCLUDE LATEST WIND GEN P.F. MODELS  
3 phase 4 cycle fault at Midway  
Loss of 2 Midway - Vincent Lines  
SPS



a:2012lspr-FullWind-Midway-Vincent-dlo-noSPS.chf  
b:2012lspr-LoWind-Midway-Vincent-dlo-noSPS.chf  
c:2012lspr-NoWind-Midway-Vincent-dlo-noSPS.chf

d:\projects\caiso  
Mon Aug 27 11:44:30 2007

