

**EPRI**

ELECTRIC POWER  
RESEARCH INSTITUTE 11-IEP-1H

**DOCKET**

11-IEP-1G

DATE Jun 22 2011

RECD. Jun 29 2011

# EPRI Perspective on Distribution Infrastructure Challenges for DG

**California Energy Commission**

**Distributed Generation Workshop**

June 22<sup>nd</sup>, 2011

Brian K. Seal  
Technical Executive

Power Delivery & Utilization

Electric Power Research Institute (EPRI)

# EPRI Perspective Basis


- Working with a diverse utility membership
  - Some with aggressive RPS, some with none at all. Some expecting or experiencing high penetration now, others without any signs.
- Facilitation of the “Smart Inverter Communication Initiative”
  - Engaging over 500 individuals, working to identify uniform smart-inverter functionalities that can then be mapped into open standard protocols

# Communication Connectedness is Key


- Without communication connectedness (i.e. manageability), utilities don't want DER to try to do anything "smart" or grid supportive, due to concerns that the behavior will not work as intended, even potentially working against the utility. Existing IEEE1547 rules reflect this do-nothing approach.
- With communication-connectedness, and authority to manage (control, or reconfigure), utilities are interested in a long list of potential grid-supportive functions from DER.

# Standard Functionalities are Necessary

- All vendors have “grid supportive” capabilities
- All vendors have communication capability
- But all in different, proprietary ways

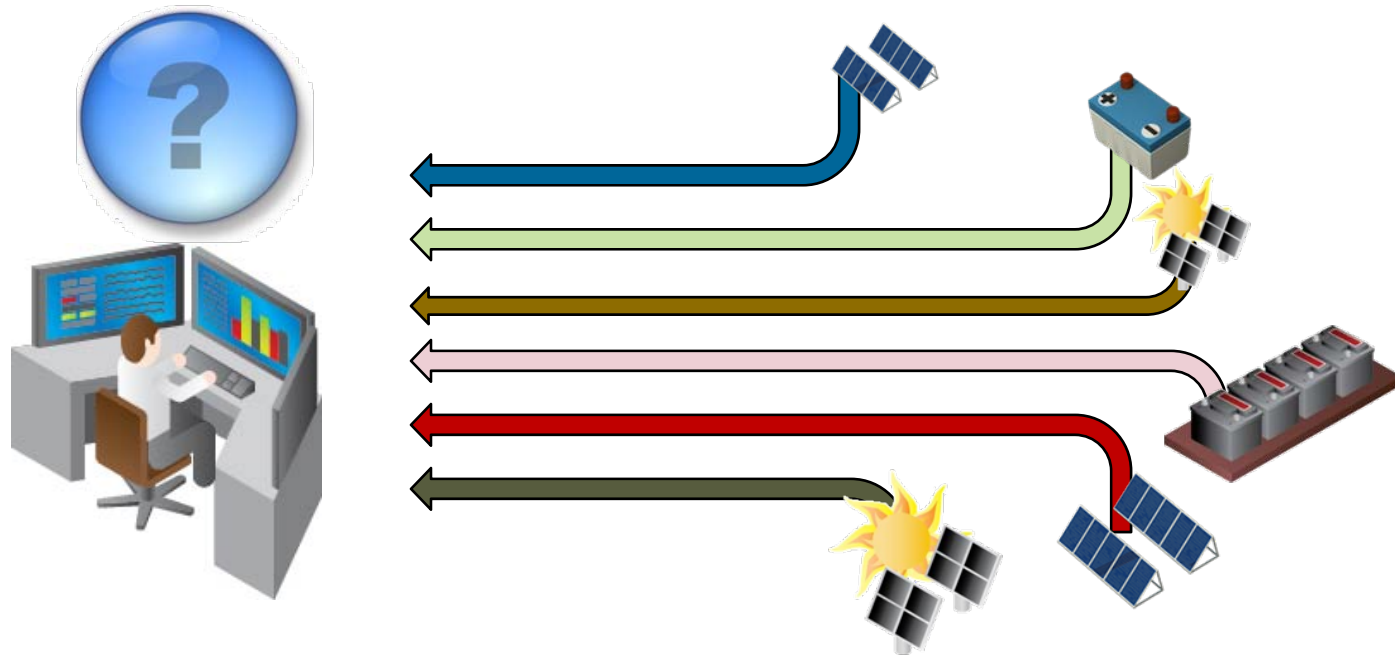

# More than Enabling High Penetration

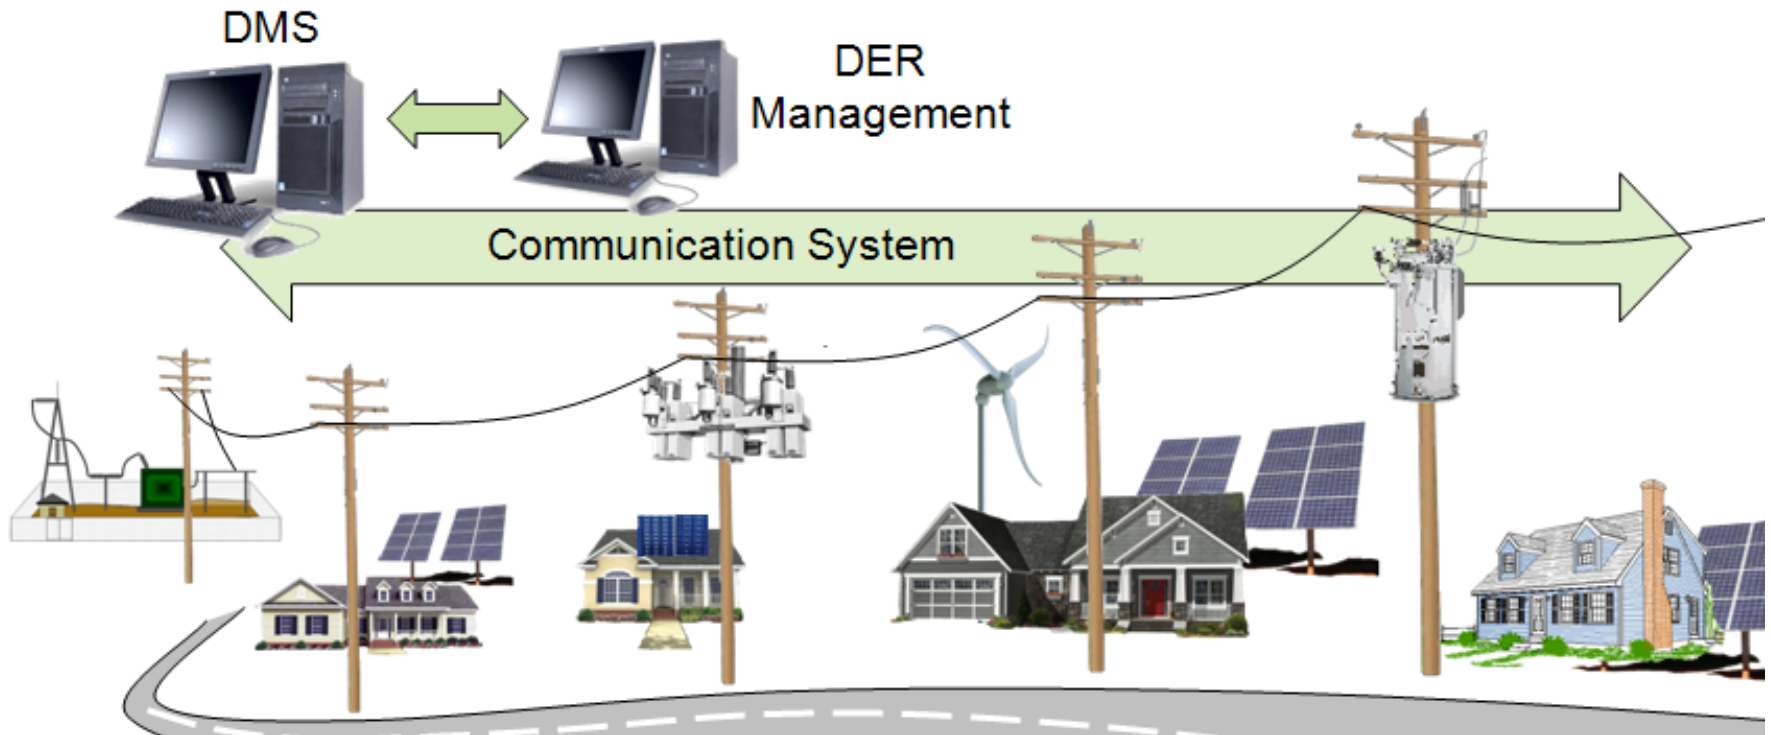

Communication-Connected Distributed Resources as  
Beneficial Distribution System Assets

# Smart DER Not Necessarily High Bandwidth

Autonomous “smart” behaviors are favored, responding to local voltage & frequency, steady-state and transients

Centralized control via infrequent configuration of desired behaviors

Configurable “Modes” can enable fast management of many devices

Common AMI and SCADA systems may be used for this kind of management

# Key Functionalities for High Penetration

Volt-Var Management\*


Watt-Volt Management\*

Simple Curtailment\*

Watt-Frequency Management

Dynamic Grid Stabilization (inertia)

Voltage Sag Ride-through

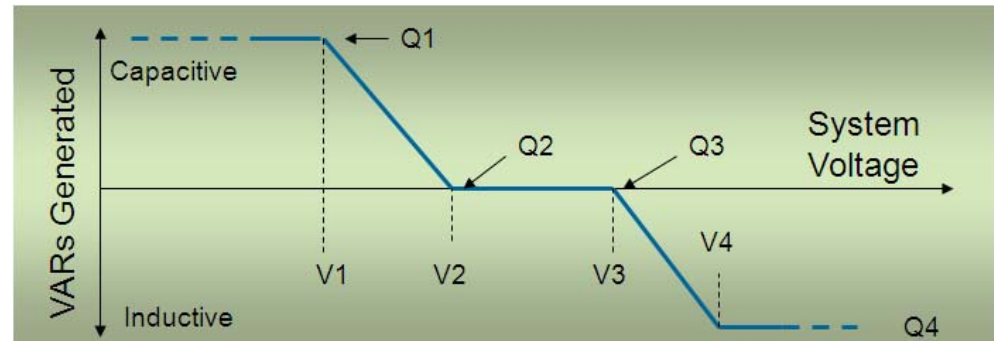

\* Potential customer sensitivities – policy attention needs

# Continued Work is (of course) Needed

- Manufacturers and Owners must understand why their products should be grid supportive:
  - Incent manufacturers to build intelligent functions and standard communication capability into their products.
- Standards work must continue:
  - More standard functions need to be defined, existing ones tested
  - Transient behaviors need to be determined and documented
- Significant gap in DMS integration and coordination
- New techniques such as active anti-islanding may be needed to prevent high penetrations of smart inverters from unintentionally islanding
- Standard test harnesses and certification agencies are needed