


DOCKETED

Docket Number:	08-AFC-09C
Project Title:	Palmdale Hybrid Power Project - Compliance
TN #:	205450
Document Title:	RPTA Figure 2-7b Revised
Description:	Replacement figure for PEP RPTA Figure 2-7b.
Filer:	Marie Fleming
Organization:	Galati Blek LLP
Submitter Role:	Applicant Representative
Submission Date:	7/21/2015 2:39:28 PM
Docketed Date:	7/21/2015

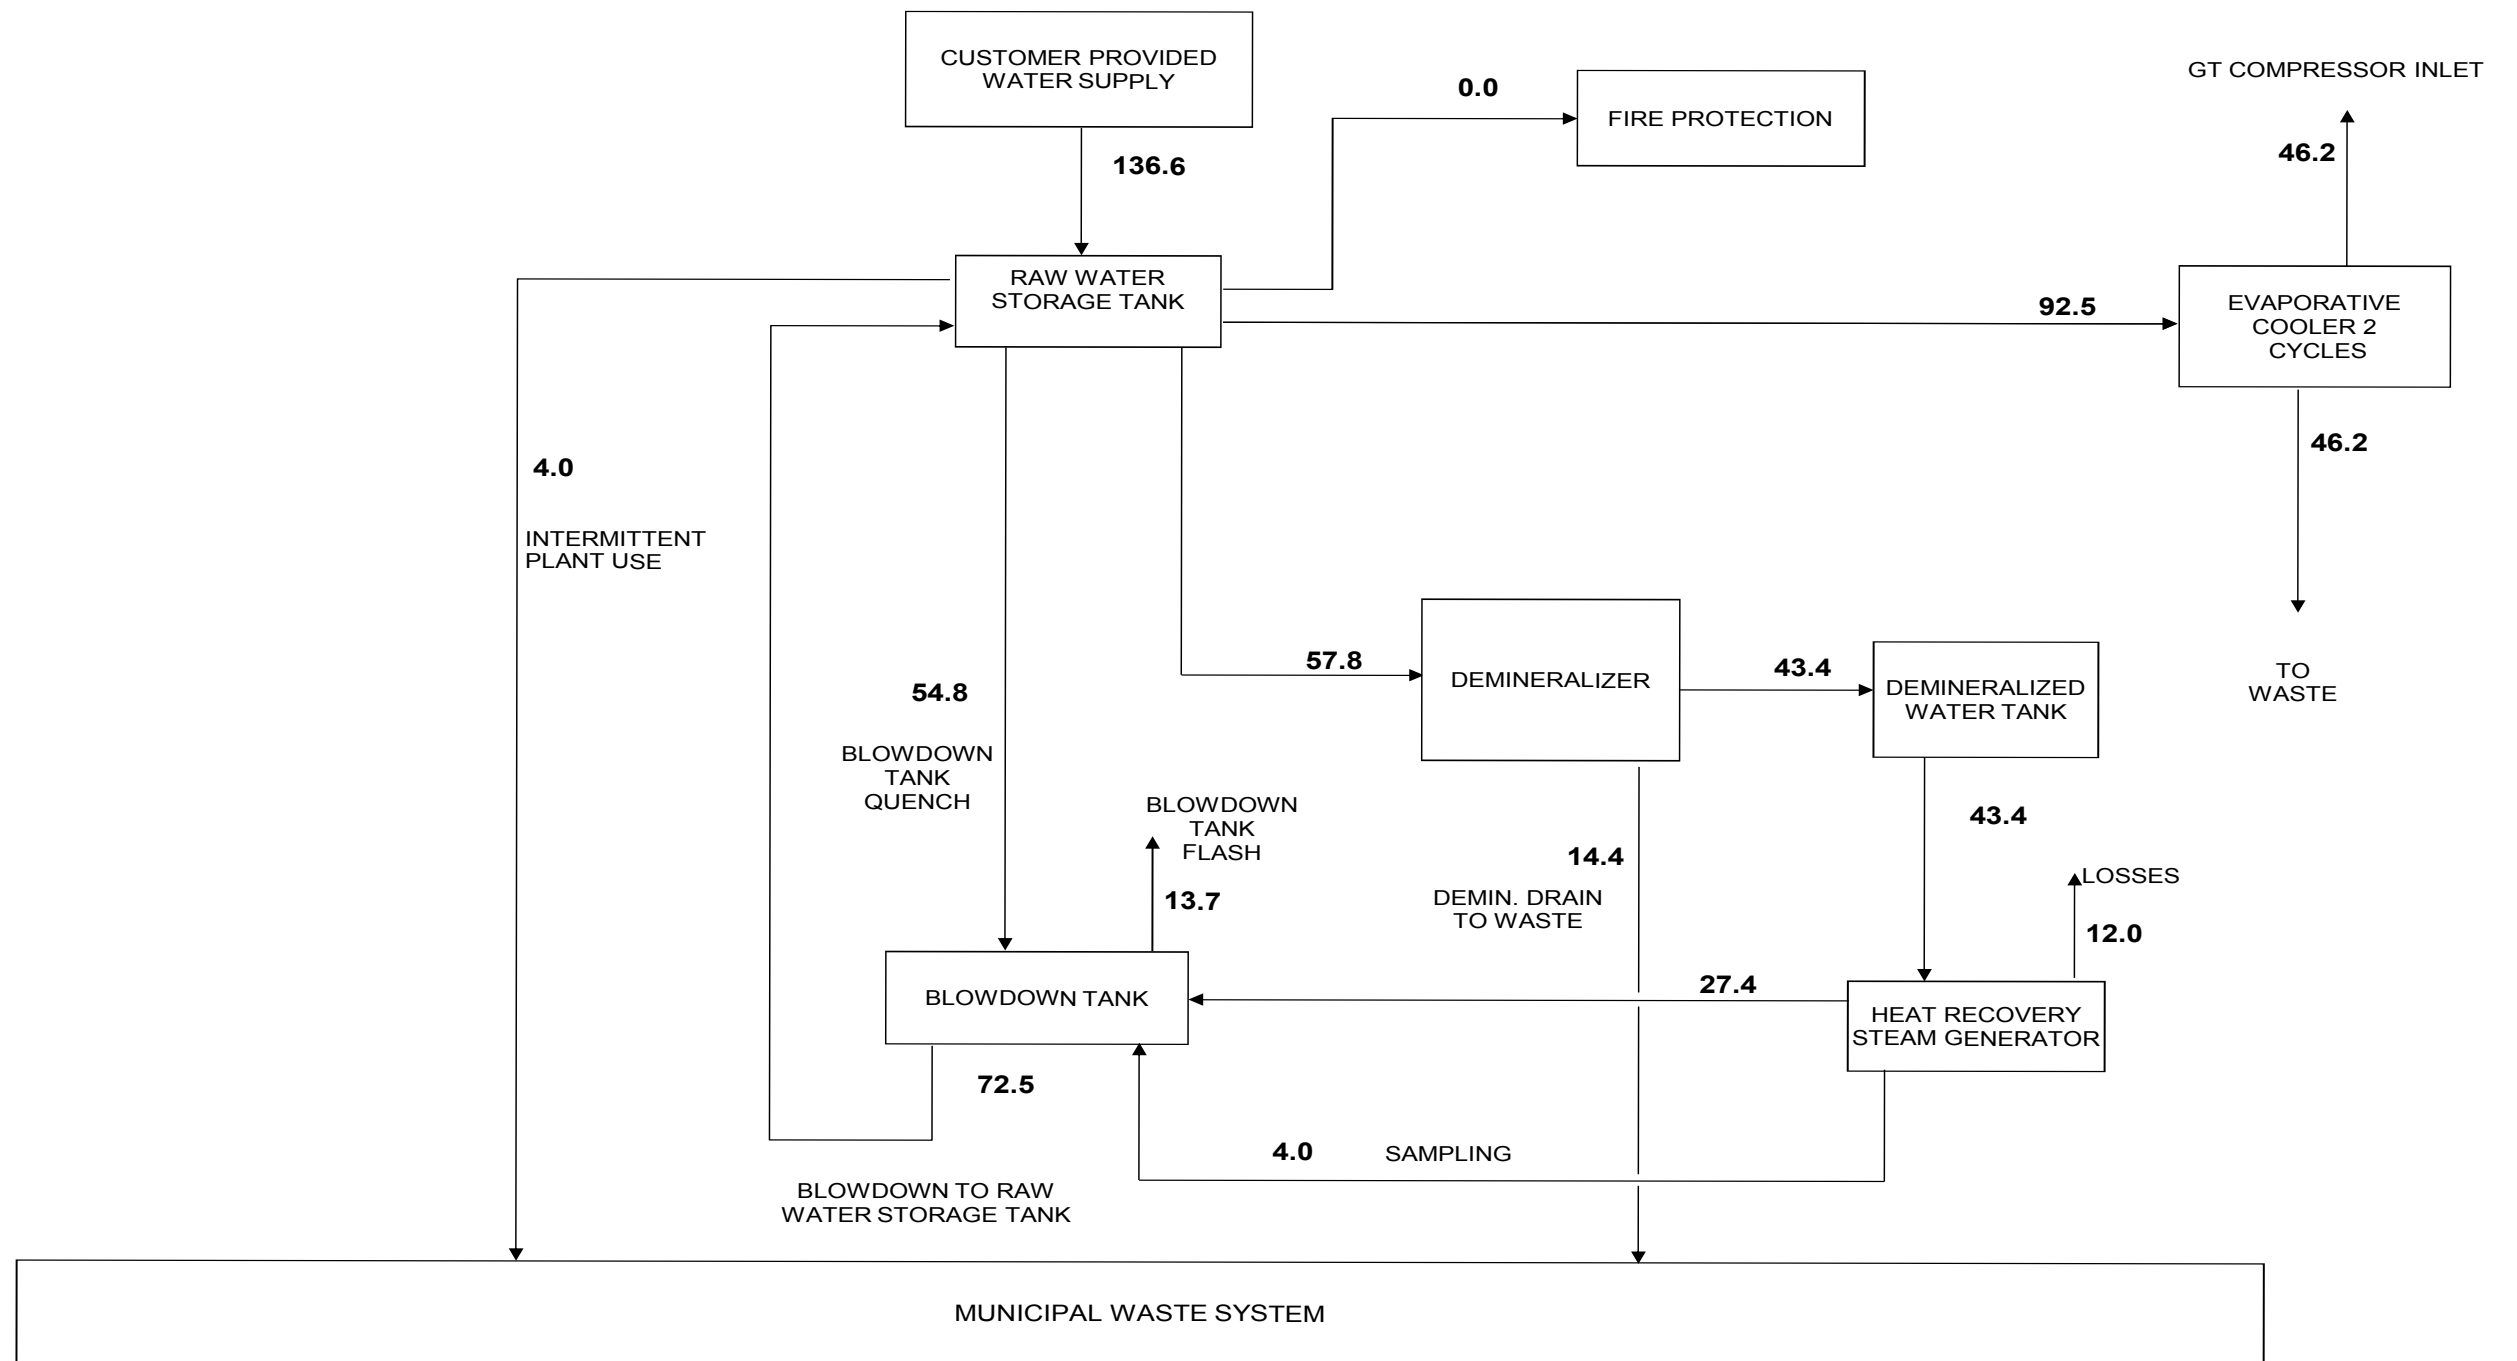

Notes:

1. Data is preliminary, and may change upon plant design, quality of water treatment, and plant operation.
2. Values are for information only, and do not represent guaranteed values.
3. Values are for steady - state conditions only and so are not accurate for non-normal operating conditions such as transients, start-up/shut down, steam blows, fire suppression, etc.
4. Siemens scope is not defined, and does not include consumption for other systems outside of Siemens scope of supply.
5. Water Balance is based upon the customer water supply meets the Siemens Water Quality Specification.
6. Units are gpm.

**PRELIMINARY USE ONLY
SCOPE NOT DEFINED**

This drawing contains information proprietary to Siemens Energy Inc. It is submitted in confidence and is to be used solely for the purpose for which it is furnished and returned upon request. This drawing and such information is not to be reproduced, transmitted, disclosed or used otherwise, in whole or in part, without the written authorization of Siemens Energy Inc.

DATE :	4/15/2015	Project :	Summit Palmdale
ENGINEER :	Middleton	SIEMENS	Siemens Energy Inc. A Siemens Company
APPROVED BY :	A Planeta		WATER BALANCE DIAGRAM
LOCATION :	ORL		Case 11: 64/40-FG-ON-100-2x1
CUST NO.			PAGE 1 OF 1

FIGURE 2-7b WATER BALANCE DIAGRAM