


Dr. Sönke Johnsen, Ph.D
Professor of Biology, Duke University



PSA equations for heating and cooling

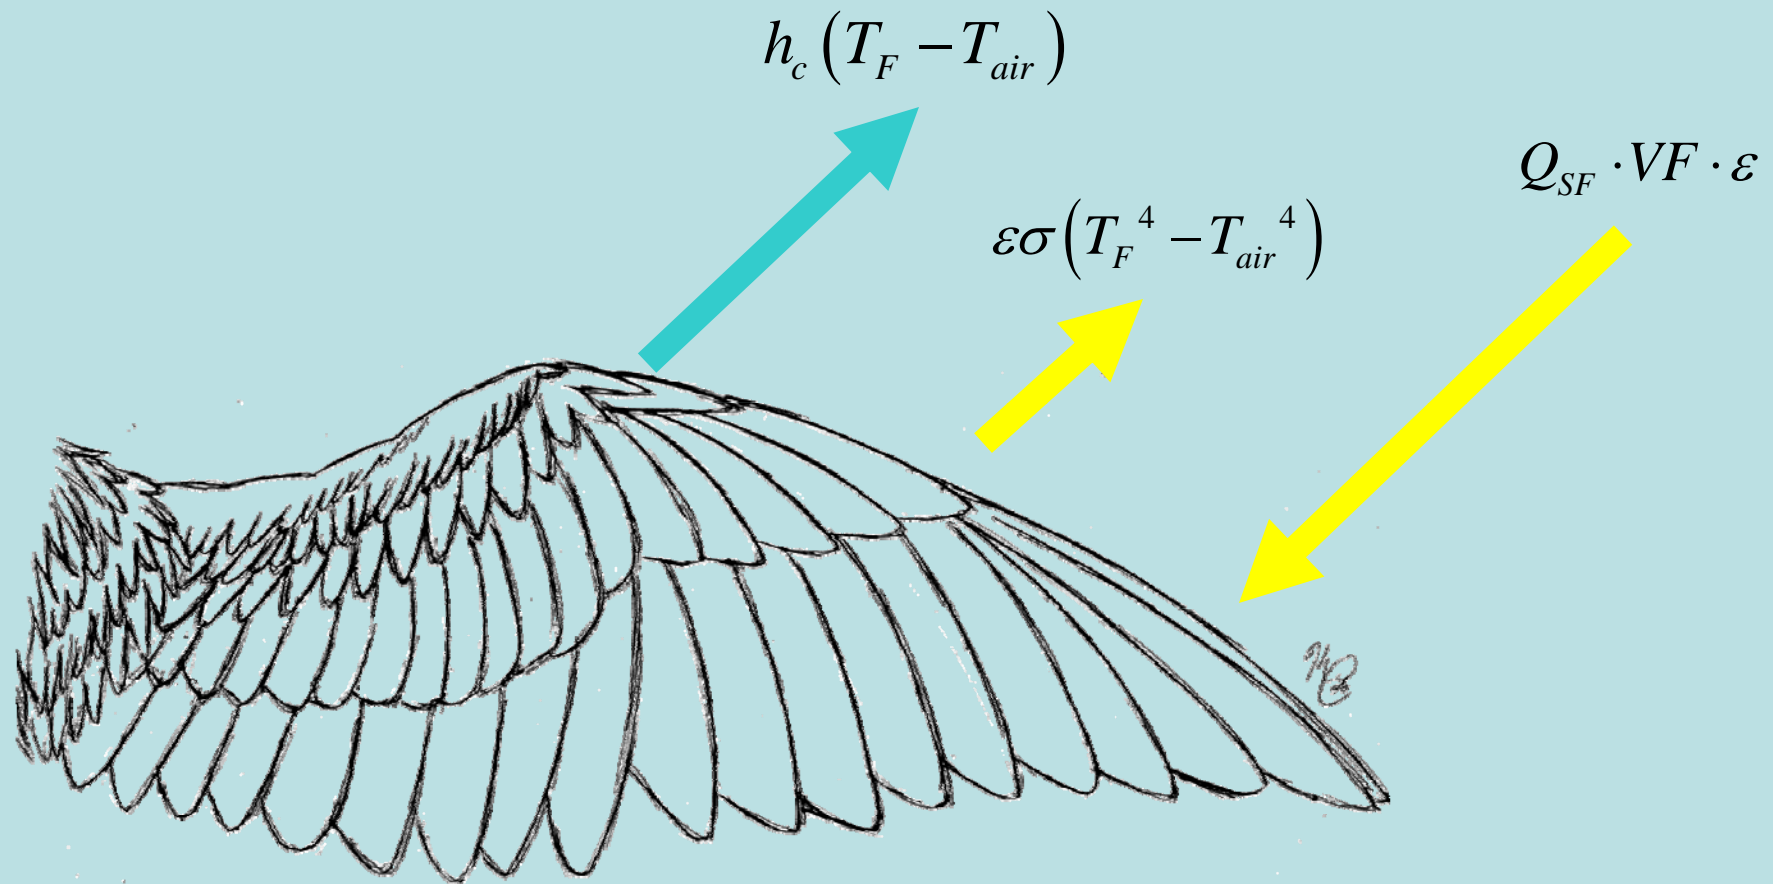

Solving for solar flux that heats feather to 160 C

Solar Flux = Radiant Losses + Convective Losses

$$Q_{SF} \cdot VF \cdot \varepsilon = \varepsilon \sigma (T_F^4 - T_{air}^4) + h_c (T_F - T_{air})$$

$$Q_{SF}^{MAX} = \frac{\varepsilon \sigma \left((160 + 273)^4 - T_{air}^4 \right) + h_c (160 - T_{air})}{VF \cdot \varepsilon}$$

Parameters used in the PSA

View Factor $VF = 1$

$$h_c = \frac{k_{air}}{L} Nu = 0.664 \frac{k_{air}}{L} \sqrt{Re} \sqrt[3]{Pr} \cong 28.5$$

$$T_{air} = 49C$$

$$\varepsilon = 0.95$$

$$Q_{SF}^{MAX} \cong 4.7 \text{ kW/m}^2$$

Absorptivity of feathers


$$Q_{SF} \cdot VF \cdot \varepsilon$$

$$Q_{SF} \cdot VF \cdot \alpha$$

does $\alpha = \varepsilon$?

$$\alpha(\lambda) = \varepsilon(\lambda)$$

Spectra of sun and feather heated to 200 C

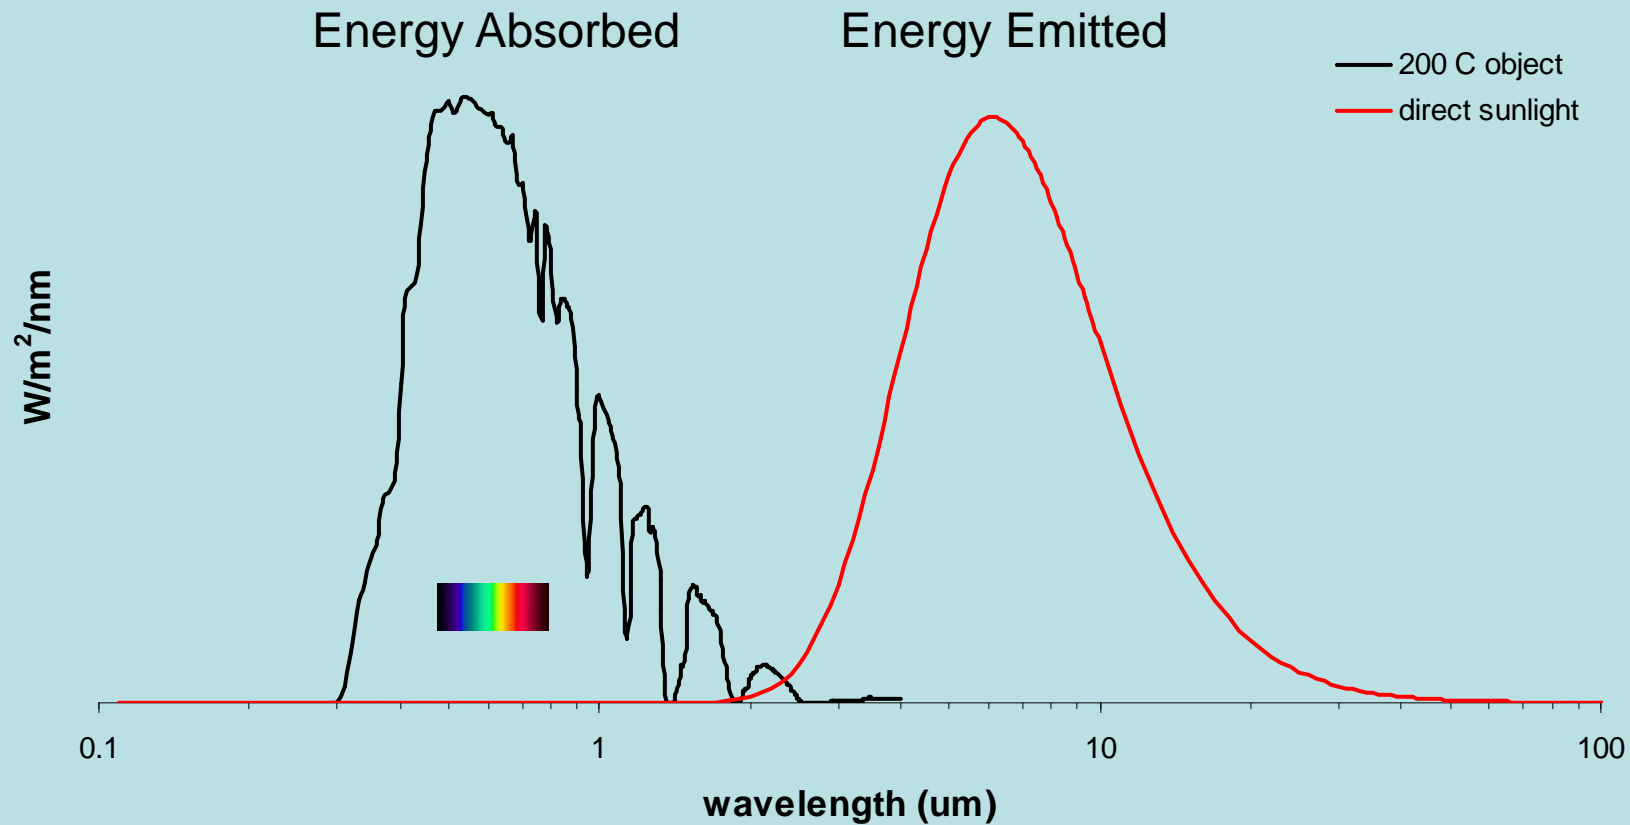

nearly all < 2um

nearly all > 2um


$$\alpha \neq \varepsilon$$

First correction of equations

$$h_c (T_F - T_{air})$$

$$\varepsilon \sigma (T_F^4 - T_{air}^4)$$

$$Q_{SF} \cdot VF \cdot \alpha_{sol}$$

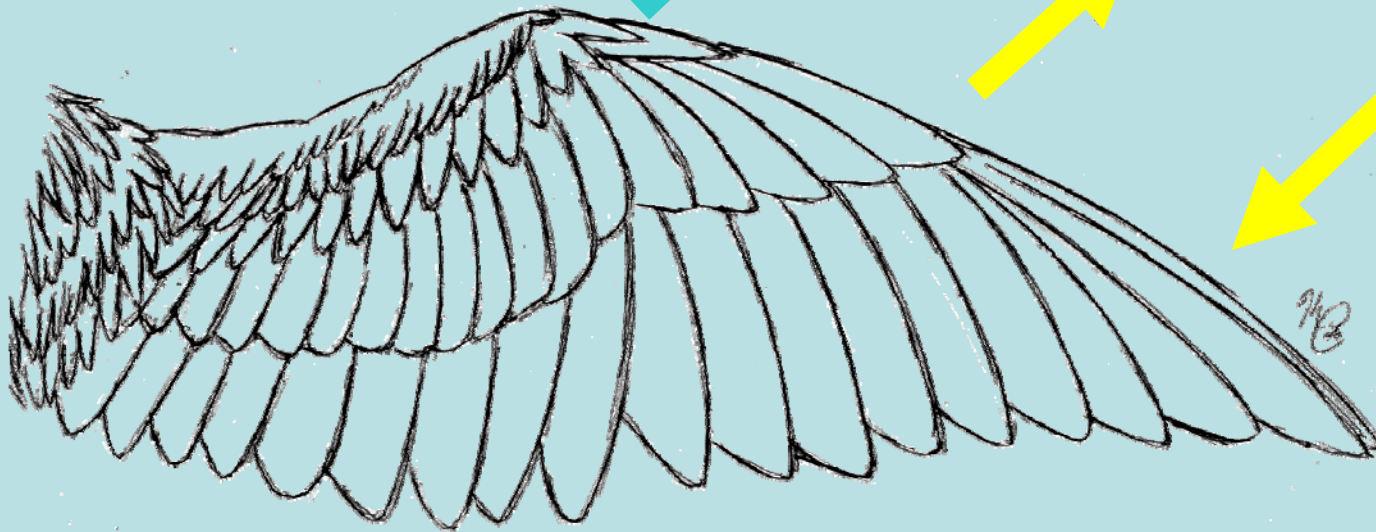

Results after first correction

kW/m²


α_{sol}	Absorptivity correction				
0.95	4.7 From PSA				
0.65	6.9				
0.75	6.0				
0.85	5.3				

View Factor



← (VF = 1)

versus

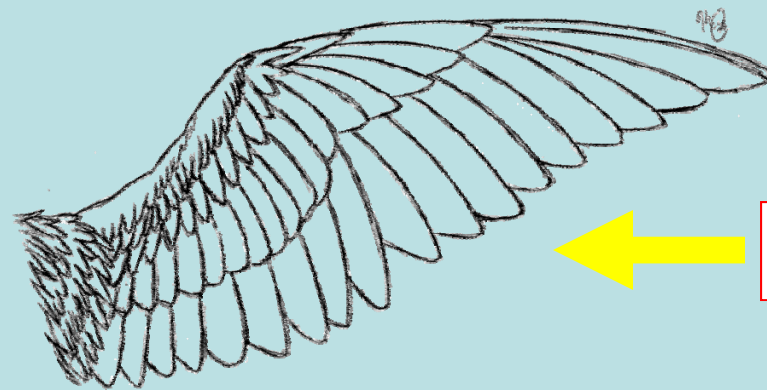


← (VF = 0.342)

Results after second correction

kW/m²

α_{sol}	Absorptivity correction	View Factor VF = 0.342			
0.95	4.7 From PSA	14			
0.65	6.9	20			
0.75	6.0	17			
0.85	5.3	15			

Heat Transfer Coefficient h_c

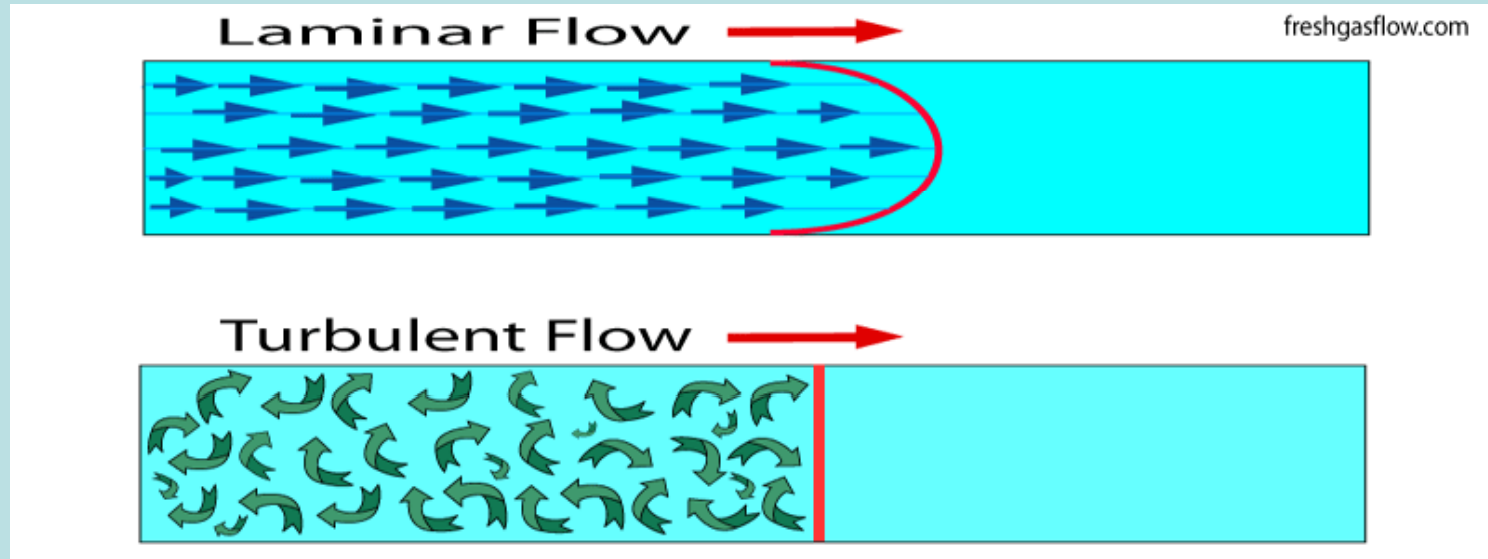

$$h_c = \frac{k_{air}}{L} Nu = 0.664 \frac{k_{air}}{L} \sqrt{Re} \sqrt[3]{Pr} \cong 28.5$$


Laminar

versus

$$h_c = \frac{k_{air}}{L} Nu = 0.0592 \frac{k_{air}}{L} (Re)^{4/5} \sqrt[3]{Pr} \cong 71.8$$

Turbulent

Heat Transfer Coefficient h_c

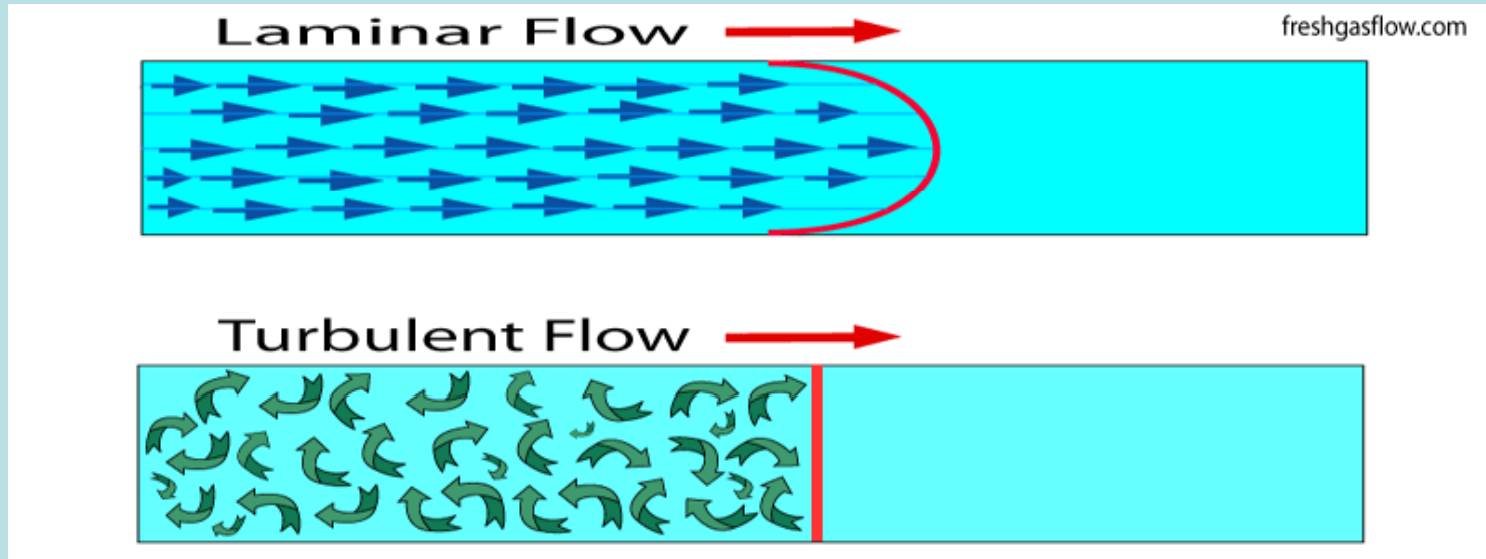

$$h_c = \frac{k_{air}}{L} Nu = 0.664 \frac{k_{air}}{L} \sqrt{Re} \sqrt[3]{Pr} \cong 28.5$$

versus

$$h_c = \frac{k_{air}}{L} Nu = 0.0592 \frac{k_{air}}{L} (Re)^{4/5} \sqrt[3]{Pr} \cong 71.8$$


$Re = \sim 68,000$ --- Turbulent flow

Results after third correction

kW/m²


α_{sol}	Absorptivity correction	View Factor VF = 0.342	Heat Xfer Coef. $H_c = 71.8$		
0.95	4.7 From PSA	14	29		
0.65	6.9	20	42		
0.75	6.0	17	36		
0.85	5.3	15	32		

T_{air} = 49 C?

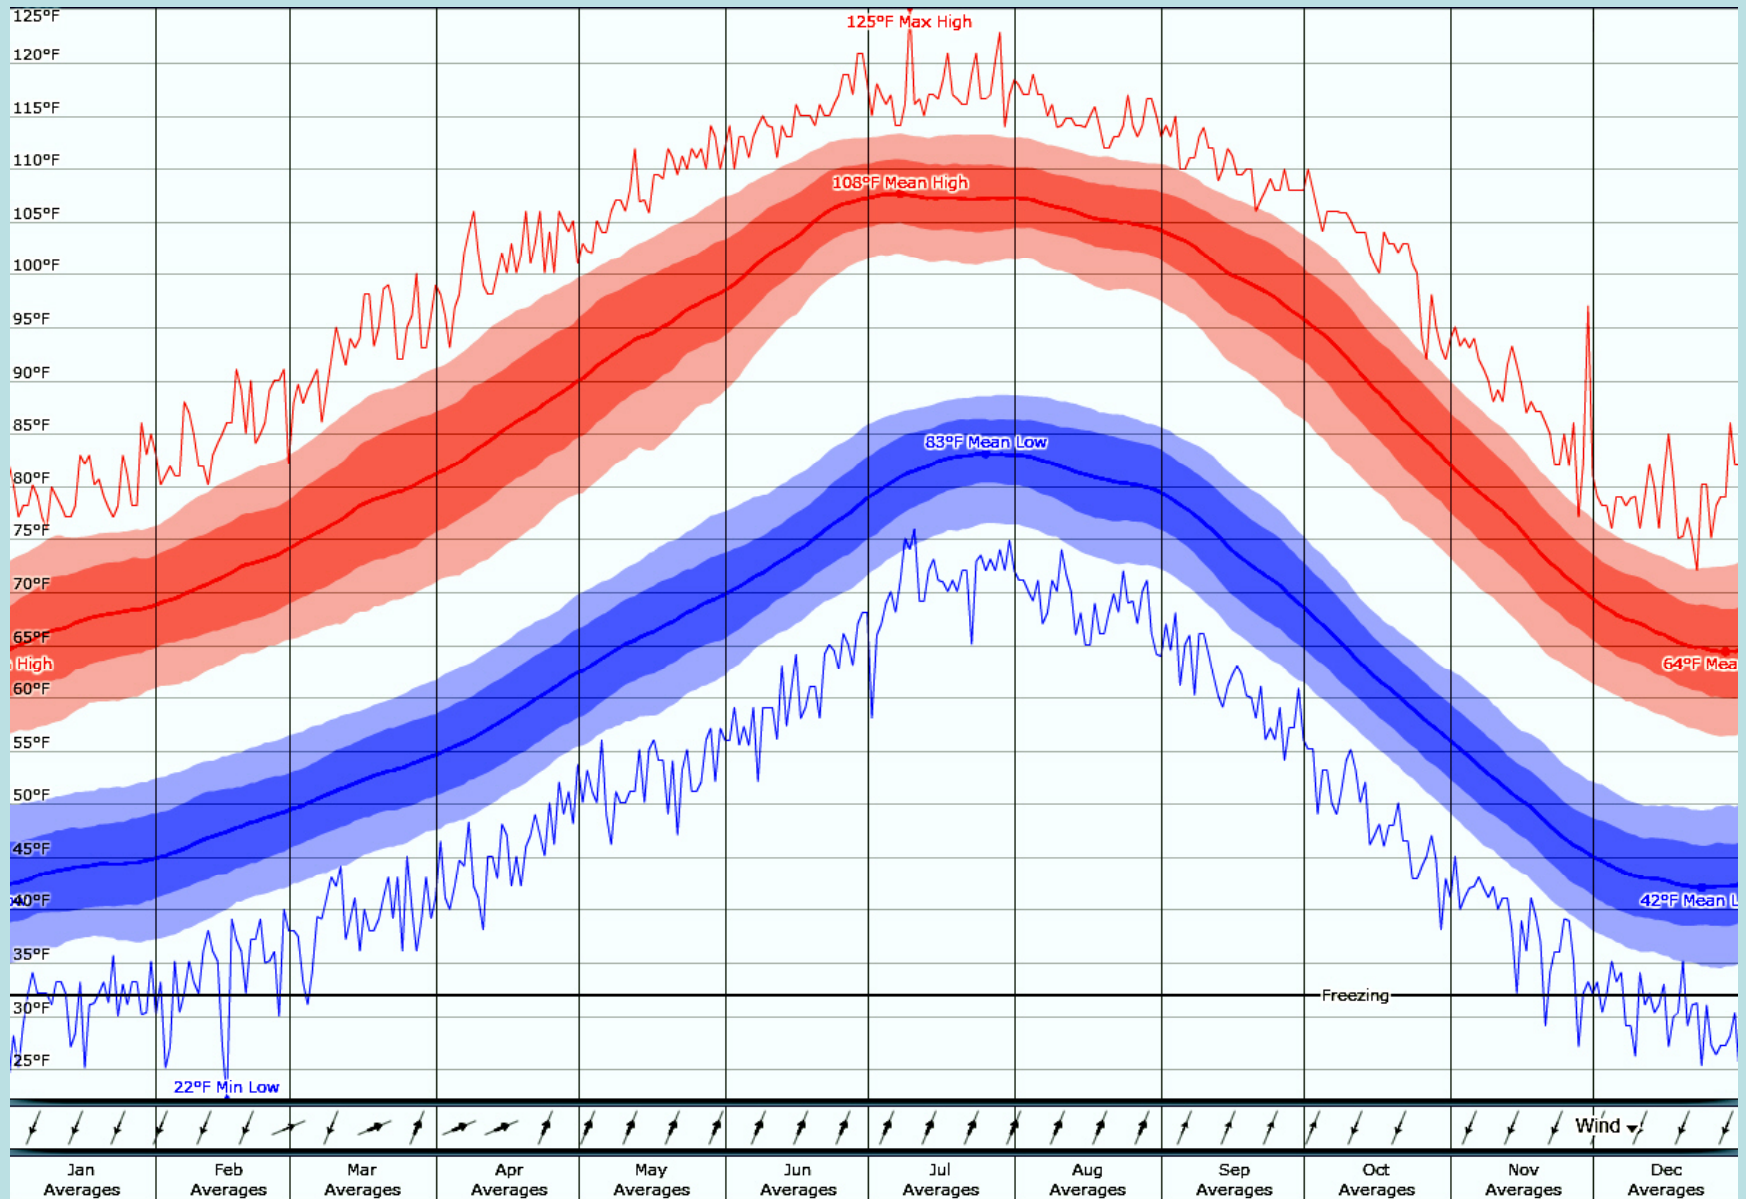


T_{air} = 49 C?

49 C

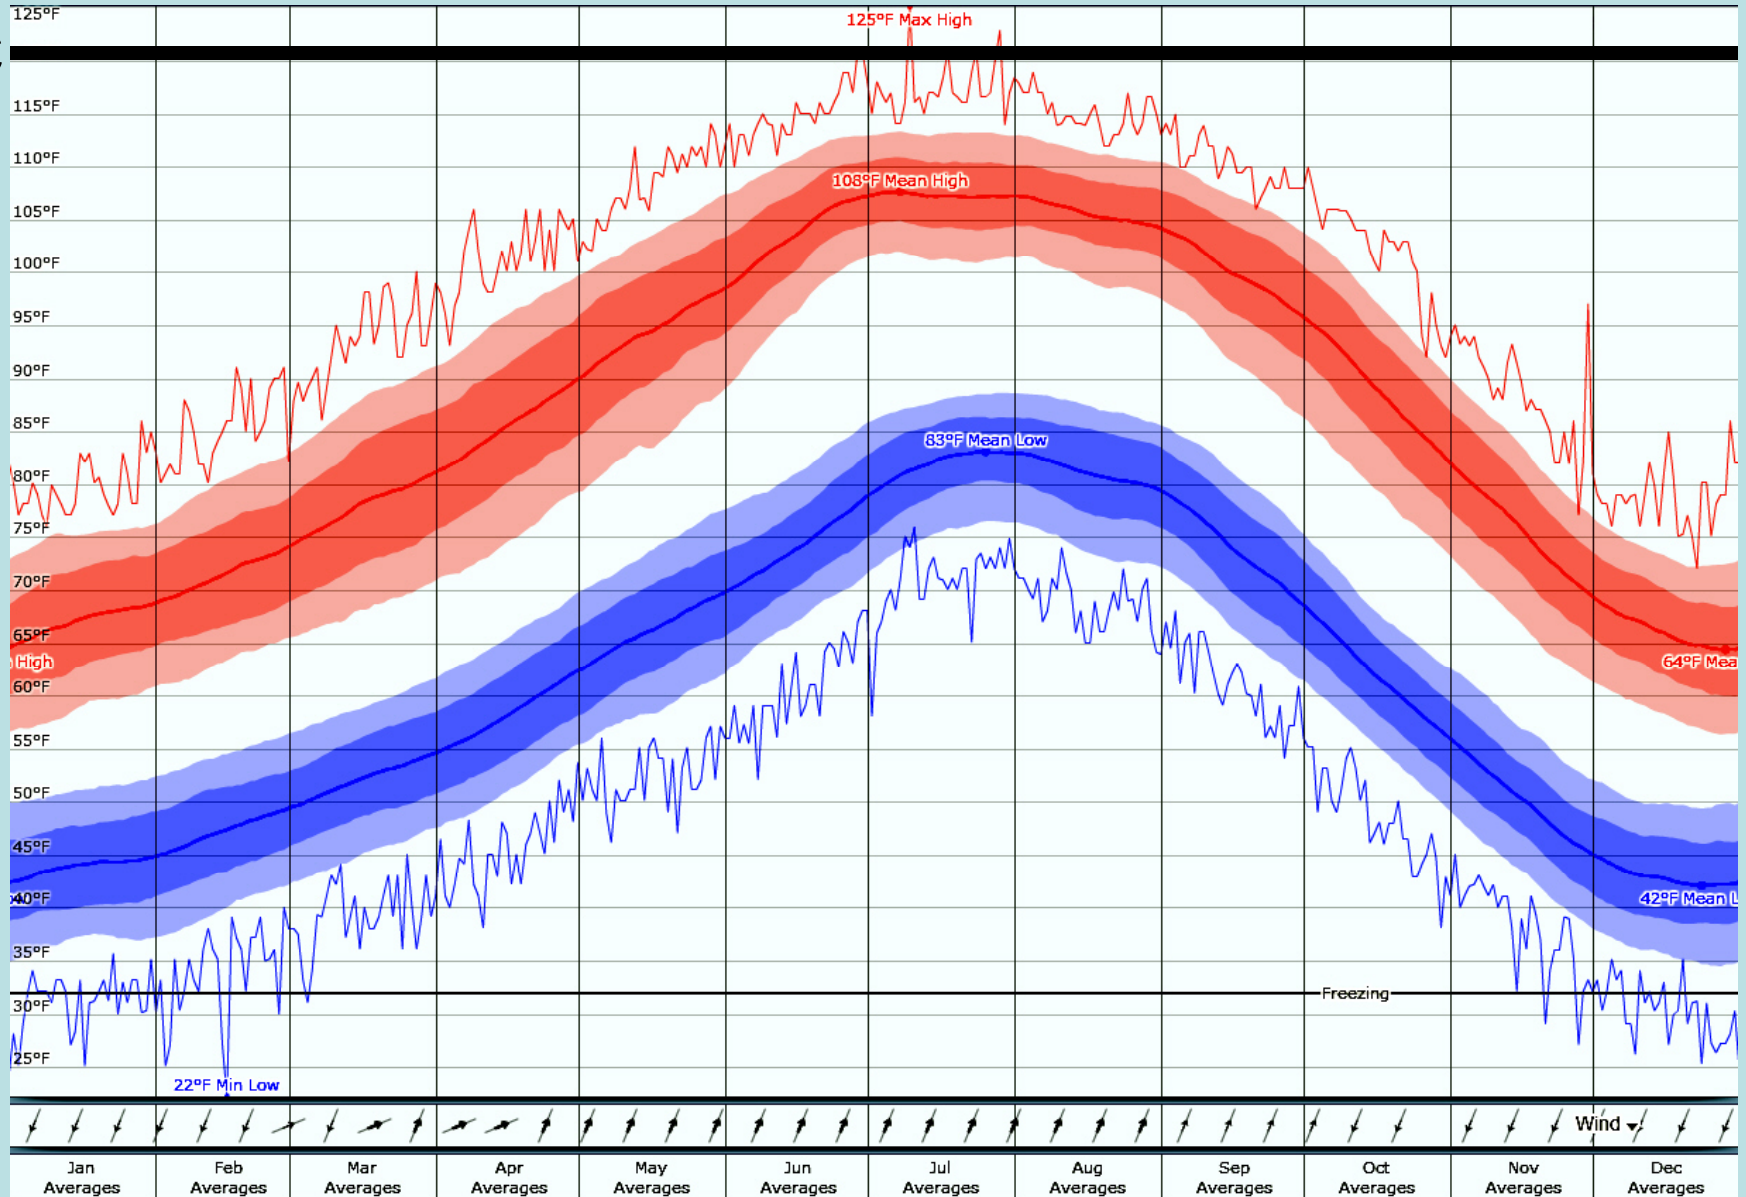

49 C
45 C

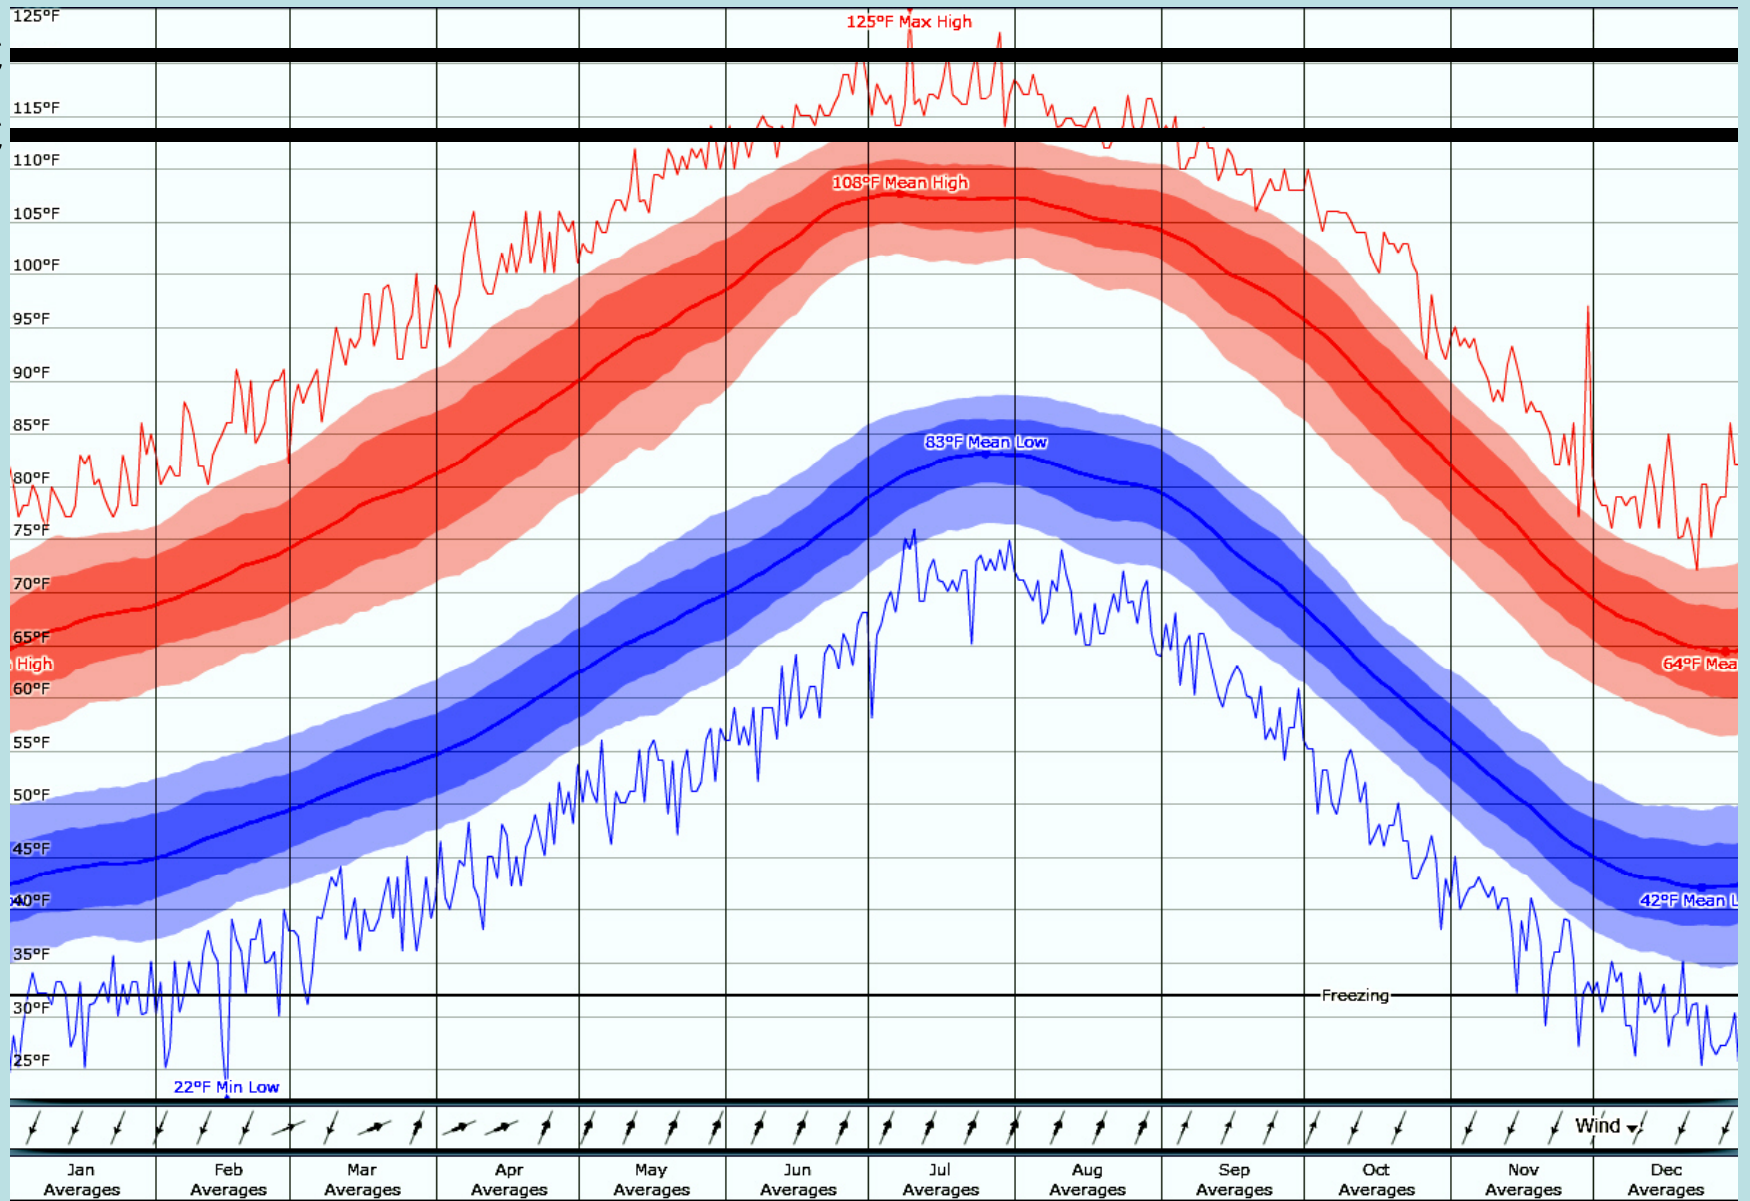

Results after fourth correction

kW/m²

α_{sol}	Absorptivity correction	View Factor VF = 0.342	Heat Xfer Coef. $H_c = 71.8$	Ambient Air $T_{air} = 45\text{ C}$	
0.95	4.7 From PSA	14	29	29	
0.65	6.9	20	42	43	
0.75	6.0	17	36	37	
0.85	5.3	15	32	33	

Radiative heat loss

$$h_c (T_F - T_{air})$$


$$\varepsilon\sigma (T_F^4 - T_{air}^4)$$


$$Q_{SF} \cdot VF \cdot \alpha_{sol}$$





Radiative temperature versus Air temperature

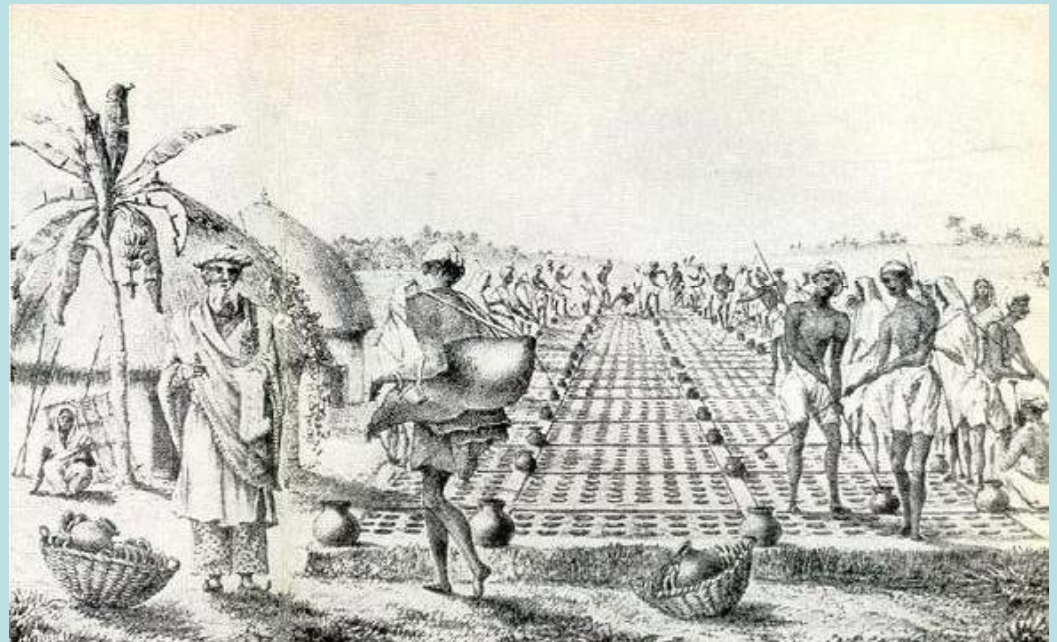

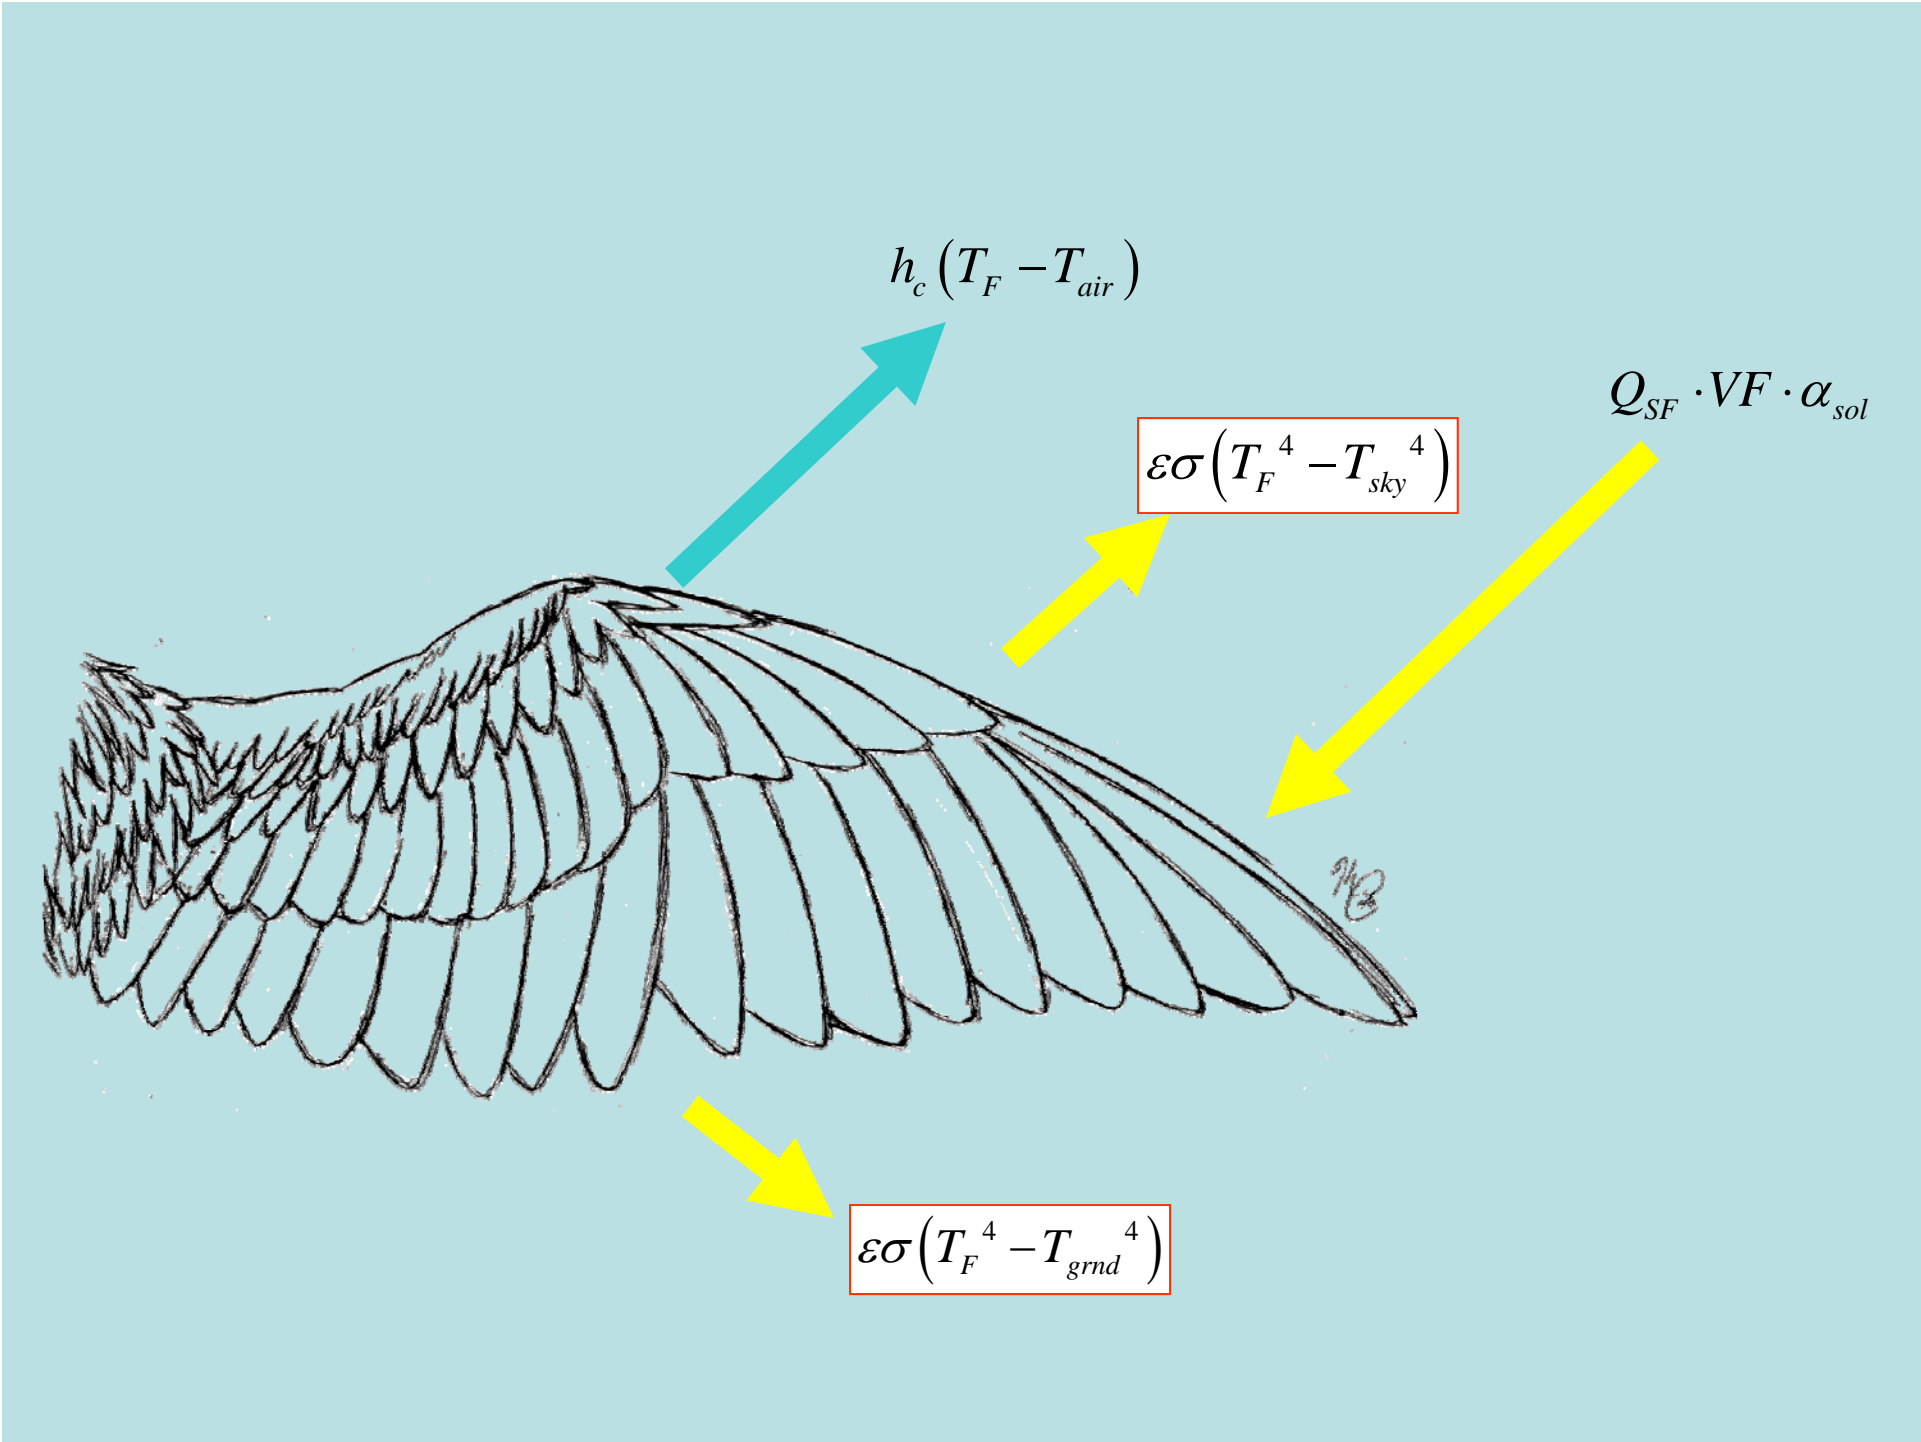
$$h_c (T_F - T_{air})$$

$$\varepsilon\sigma (T_F^4 - T_{sky}^4)$$

$$Q_{SF} \cdot VF \cdot \alpha_{sol}$$


$$\varepsilon\sigma (T_F^4 - T_{grnd}^4)$$

Results after fourth correction

kW/m²

α_{sol}	Absorptivity correction	View Factor VF = 0.342	Heat Xfer Coef. $H_c = 71.8$	Ambient Air $T_{air} = 45\text{ C}$	$T_{sky} = 0\text{ C}$ $T_{grnd} = 45$
0.95	4.7 From PSA	14	29	29	34
0.65	6.9	20	42	43	50
0.75	6.0	17	36	37	44
0.85	5.3	15	32	33	39

Wings Flap!

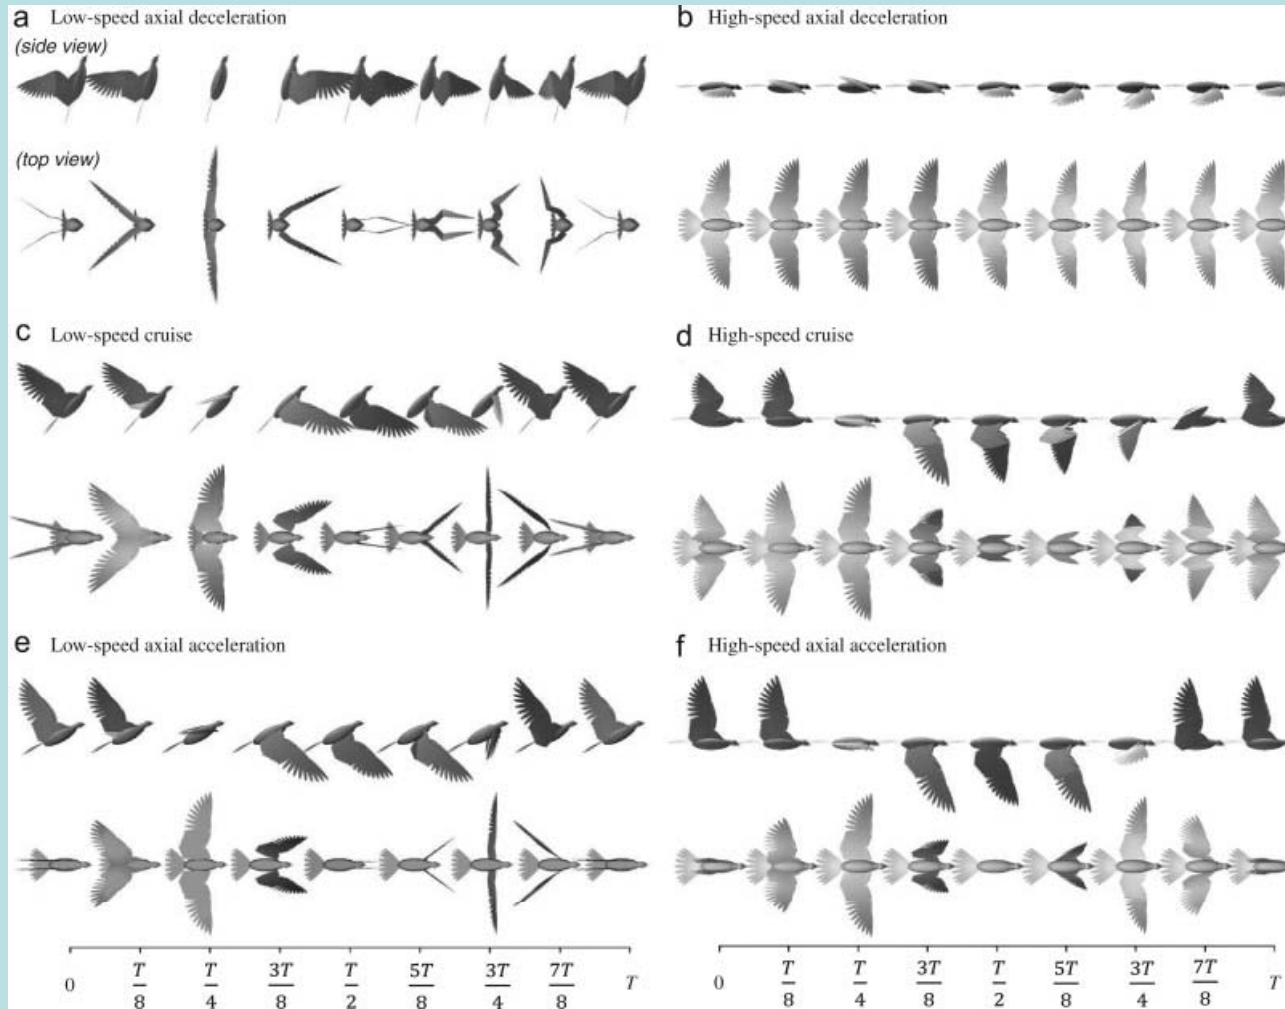



Conclusions

- Equations presented in the PSA are incorrect.
- Revised analysis presented here represents a reasonable, yet very conservative lower bound for flux effects.
- Wing flapping may significantly effect the heat transfer coefficient further reducing potential for flux effects.

STATE OF CALIFORNIA

Energy Resources Conservation
and Development Commission

Application for Certification for the HIDDEN)
HILLS SOLAR ELECTRIC GENERATING) Docket No. 11-AFC-2
SYSTEM PROJECT)
_____)

PROOF OF SERVICE

I, Karen A. Mitchell, declare that on December 5, 2012, I served the attached *December 5 2012 CEC Workshop Presentation by Dr. Sonke Johnsen* via electronic and U.S. mail to all parties on the attached service list.

I declare under the penalty of perjury that the foregoing is true and correct.



Karen A. Mitchell

SERVICE LIST
11-AFC-2

APPLICANT

Stephen Wiley
BrightSource Energy
1999 Harrison Street, Suite 2150
Oakland, CA 94612-3500
swiley@brightsourceenergy.com

Bradley Brownlow
Michelle L. Farley
BrightSource Energy
1999 Harrison Street, Suite 2150
Oakland, CA 94612-3500
bbrownlow@brightsourceenergy.com
mfarley@brightsourceenergy.com

Clay Jensen
Gary Kazio
BrightSource Energy
410 South Rampart Blvd., Suite 390
Las Vegas, Nevada 89145
cjensen@brightsourceenergy.com
gkazio@brightsourceenergy.com

APPLICANT'S CONSULTANTS

Susan Strachan
Strachan Consulting, LLC
P.O. Box 1049
Davis, CA 95617
susan@strachanconsult.com

John Carrier
CH2MHill
2485 Natomas Park Drive, Suite 600
Sacramento, CA 95833-2987
jcarrier@ch2m.com

COUNSEL FOR APPLICANT

Chris Ellison
Jeff Harris
Samantha Pottenger
Ellison, Schneider and Harris, LLP
2600 Capitol Avenue, Suite 400
Sacramento, CA 95816-5905
cte@eslawfirm.com
jdh@eslawfirm.com
sgp@eslawfirm.com

INTERVENORS

Jon William Zellhoefer
P.O. Box 34
Tecopa, CA 92389
jon@zellhoefer.info

Lisa T. Belenky, Sr. Attorney
Center for Biological Diversity
351 California Street, Ste. 600
San Francisco, CA 94104
lbelenky@biologicaldiversity.org

Ileene Anderson, Public Lands
Desert Director
Center for Biological Diversity
PMB 447
8033 Sunset Boulevard
Los Angeles, CA 90046
ianderson@biologicaldiversity.org

Jack Prichett
Old Spanish Trail Association
857 Nowita Place
Venice, CA 90291
jackprichett@ca.rr.com

Cindy R. MacDonald
3605 Silver Sand Court
N. Las Vegas, NV 89032
sacredintent@centurylink.net

Richard Arnold
P.O. Box 3411
Pahrump, NV 89041
rwarnold@hotmail.com

INTERESTED AGENCIES

California ISO
e-recipient@caiso.com

Great Basin Unified APCD
Duane Ono
Deputy Air Pollution Control Officer
157 Short Street
Bishop, CA 93514
dono@gbuapcd.org

Dana Crom, Deputy County Counsel
County of Inyo
P.O. Box M
Independence, CA 93526
dcrom@inyocounty.us

Lorinda A. Wichman, Chairman
Nye County Board of County Supervisors
P.O. Box 153
Tonopah, NV 89049
lawichman@gmail.com

L. Darrel Lacy
Interim General Manager
Nye County Water District
2101 E. Calvada Blvd., Suite 100
Pahrump, NV 89048
llacy@co.nye.nv.us

Michael L. Elliott
Cultural Resources Specialist
National Park Service
National Trails Intermountain Region
P.O. Box 728
Santa Fe, NM 87504-0728
Michael_Elliott@nps.gov

Southern Inyo
Fire Protection District
Larry Levy, Fire Chief
P.O. Box 51
Tecopa, CA 92389
sifpd@yahoo.com

ENERGY COMMISSION – DECISIONMAKERS

Karen Douglas
Commissioner and Presiding Member
karen.douglas@energy.ca.gov

Carla Peterman
Commissioner and Presiding Member
carla.peterman@energy.ca.gov

Ken Celli
Hearing Officer
ken.celli@energy.ca.gov

Eileen Allen
Commissioners' Technical Advisor for Facility Siting
eileen.allen@energy.ca.gov

Galen Lemei
Adviser to Commissioner Douglas
galen.lemei@energy.ca.gov

Jennifer Nelson
Advisor to Presiding Member
jennifer.nelson@energy.ca.gov

Jim Bartridge
Adviser to Associate Member
jim.bartridge@energy.ca.gov

ENERGY COMMISSION STAFF

Mike Monasmith
Senior Project Manager
mike.monasmith@energy.ca.gov

Richard Ratliff
Staff Counsel IV
dick.ratliff@energy.ca.gov

Kerry Willis
Staff Counsel
kerry.willis@energy.ca.gov

ENERGY COMMISSION – PUBLIC ADVISER

Jennifer Jennings
Public Adviser's Office
publicadviser@energy.ca.gov