


California Energy Commission
DOCKETED
11-AFC-02
 TN # 69668
 FEB. 25 2013

Hidden Hills SEGS Idealized Flux Field Diagram FLUX DENSITY > 50kW

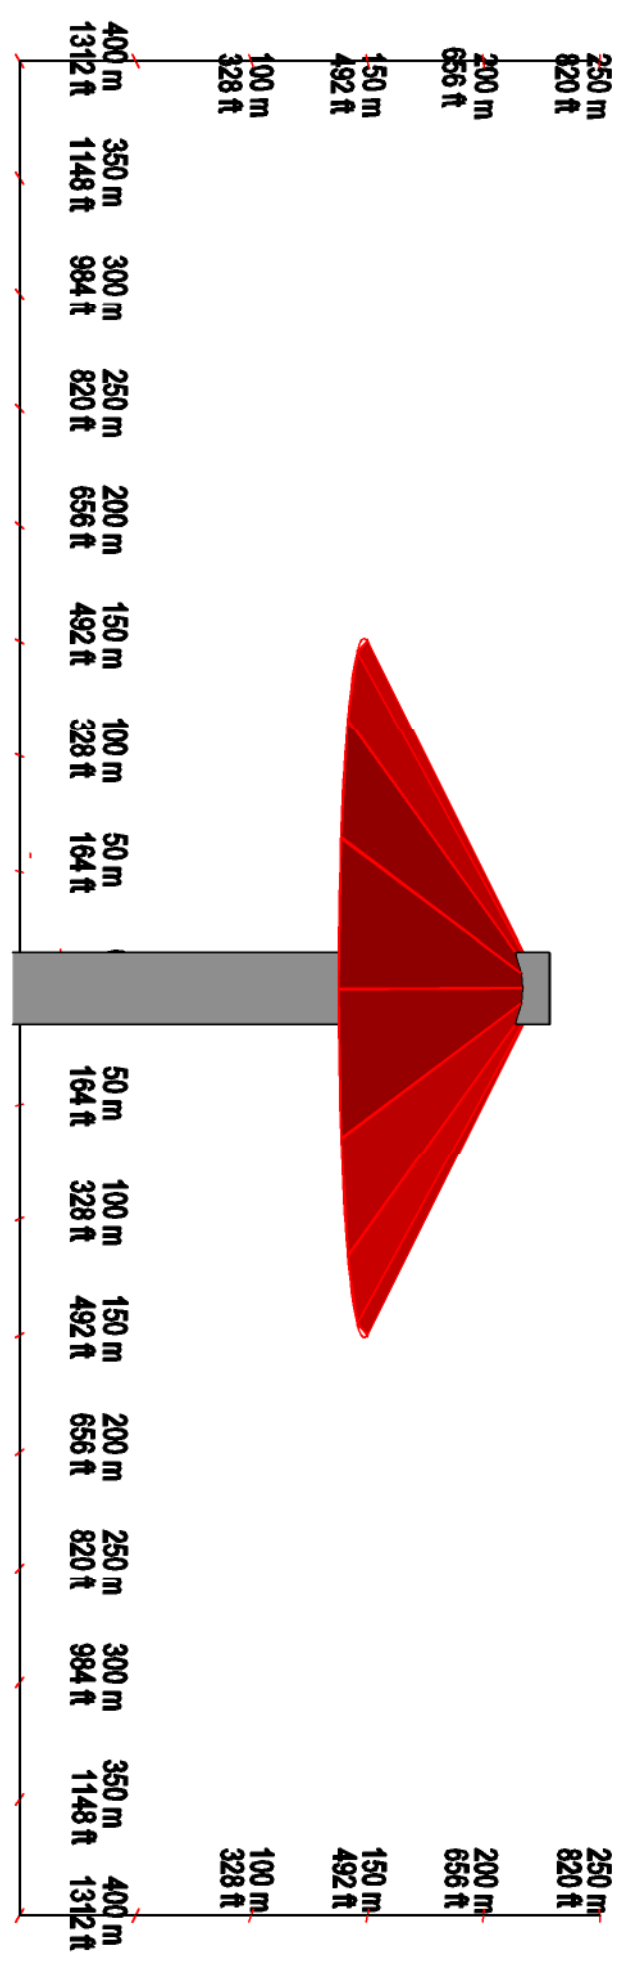

50 kW ELEVATION (HESEGS22FEB13)