

Rosamond Community Services District

BOARD OF DIRECTORS

Kathleen S. Spoor, President
Robert C. Scherer, Ed.D., Vice-President
Byron Glennan
Kim Lord
Daniel Landsgaard

OFFICERS

Jack Stewart
General Manager
Dennis LaMoreaux
*Assistant General Manager
& District Engineer*
Jeff Ferre / Jill Willis
Co-Counsel
Lizette Guerrero
Board Secretary

June 30, 2009

The Resources Agency of California
California Energy Commission
ATTN: Mr. Eric Solorio, Project Manager
1516 Ninth Street
Sacramento, CA 95814-5512

DOCKET	
08-AFC-2	
DATE	06/30/09
RECD.	07/07/09

RE: TERTIARY WATER SERVICE LETTER OF INTENT FOR THE BEACON SOLAR ENERGY PROJECT (08-AFC-2)

Dear Mr. Solorio,

The Rosamond Community Services District (RCSD) is pleased to submit a proposal in the form of this Letter of Intent (LOI) to provide tertiary water service to the Beacon Solar Energy Project (08-AFC-2) ("Beacon"), proposed to be located near Cantil, California. This LOI is meant to support the California Energy Commission's policy which mirrors the California State Water Resources Control Board policy regarding the use of water resources in industrial facilities and power plant cooling. In brief, RCSD is prepared to supply 1,456 acre-feet per year of Title 22 tertiary water generated from its customers, to Beacon for a period of thirty (30) years. To carry out this proposal will require a contractual agreement providing for Beacon to purchase the recycled water under mutually agreeable terms, in order for RCSD to secure financing for the required capital improvements.

Rosamond Community Services District is ready to negotiate a final contract to provide tertiary water service to the Project under the following general terms:

- 1) Water supply quality & levels of constituents: The delivered water will meet Title 22 requirements for tertiary treated recycled water. The constituents will be similar to the RCSD results shown in Appendix "A". Additionally, the tertiary

effluence is expected to contain silica levels of 46 ppm and a bio-nutrient removal process within the treatment plant;

- 2) Capacity to provide total quantities and peak flows: RCSD currently has an average inflow rate of 1.3 MGD. This equates to 1,456 acre-feet per year. RCSD recognizes Beacon's peak water demands will exceed the average daily outflow from the RCSD WWTP. However, RCSD will provide a constant flow rate of 1.3MGD to Beacon which can be stored on the Beacon site and utilized during peak demand periods to meet 100% of the projects cooling water demand. The storage facility will store excess winter tertiary water production in lined and covered basins for use in the summer months;
- 3) Proposed routes and Point of Delivery: RCSD has proposed two (2) routes to reach a point on Neuralia Road adjacent to Beacon as shown on the map included as Appendix "B". The delivery point for RCSD is located at the RCSD WWTP;
- 4) Ownership: RCSD will own and operate the tertiary wastewater plant expansion, including the portion needed to serve Beacon. The seasonal storage and transmission main and related facilities will be owned by Beacon;
- 5) Capital Cost Estimate: The total capital improvement cost to Beacon would be no more than \$48,533,450. Appendix "C" and "D" titled "Beacon Project Water Cost Basis" and "Beacon Project Supplied by RCSD w/o Peaking Capacity" respectively detail the assumptions and conditions related to the cost of service. The total capital cost covers the transmission main and booster stations, seasonal storage, and a portion of the tertiary wastewater treatment plant expansion. RCSD will expand the WWTP in order supply the necessary tertiary water for Beacon. The complete expansion will have a capacity of 2.0 MGD at an estimated cost of \$22M. 1.0 MGD of the expansion is needed for Beacon. The propositional cost associated with generating recycled water for use by Beacon is \$11M. The summary is as follows:

14"Transmission main, 3-Booster Stations, and related facilities:	\$32,333,450*
Beacon Seasonal Storage:	\$5,200,000*
RCSD Tertiary WWTP Expansion (portion):	<u>\$11,000,000</u>
Total:	\$48,533,450

These estimates **do not provide for public agency construction under prevailing wage requirements*

- 6) Annual O&M Cost Estimates: The annual O&M and tertiary water cost to Beacon is estimated as detailed in Appendix "D" and summarized below:

Estimated O&M (@ \$0.10/kWh):	\$248,811
Cost of Tertiary Water (\$624/AF):	<u>\$908,544</u>
Estimated Total Annual Cost:	\$1,157,355

These costs are estimates and must be calculated and adjusted annually based on the actual cost of power, maintenance activity, and potable water rates. The cost of tertiary water is established at \$624 with an annual escalator of 4%. RCSD will entertain an option for an initial payment of the full cost of tertiary water for the thirty (30) year period.

- 7) Financing: RCSD will obtain Certificates of Participation for the tertiary wastewater plant expansion and related facilities using a purchase contract with Beacon as security for the bondholders.
- 8) Construction: RCSD will obtain the necessary easements and rights-of-way for the transmission main and related facilities. Beacon will conduct surveying and design, provide contract documents for construction, and contract to build these facilities. The transmission main and related facilities will be operated and maintained by Beacon unless a separate agreement is reached with RCSD to provide those services; Beacon will be responsible for the peaking requirements by properly sizing the transmission main and booster stations and by constructing seasonal tertiary water storage at the Beacon site.
- 9) California Environmental Quality Act (CEQA) and National Environmental Policy Act (NEPA) Compliance: RCSD will work with the California Energy Commission (CEC) and Edwards Air Force Base to complete the required environmental documentation and procedures for facilities.

This Letter of Intent reflects the general terms and conditions under which RCSD is willing to provide tertiary water service to Beacon and serves as a basis for negotiating a mutually beneficial definitive agreement.

This Letter of Intent is intended to be a non-binding letter of intent summarizing and evidencing the terms upon which RCSD is willing to proceed. Any legally binding obligation of

the parties with respect to the Beacon Solar Energy Project shall exist only upon the execution and delivery of the definitive agreement, into which this Letter and all prior discussions shall merge. It expressly is understood that this Letter is not a contract to execute the definitive agreement or otherwise to provide recycled water, and that no party shall be entitled to any recourse, in the form of damages, or otherwise, for any expense incurred or any benefit conferred or lost before or after the date of this Letter if there is a failure, for any reason, of the parties to agree on the final terms and provisions of the definitive agreements. RCSD looks forward to a cooperative negotiation process, but expressly reserves the right of final approval or disapproval, of the definitive agreement.

The District is pleased to be considered for this opportunity and its potential benefits for the region. Please feel free to contact me if you have any questions.

Sincerely,

A handwritten signature in black ink that reads "Jack Stewart". The signature is written in a cursive, slightly slanted style.

Jack Stewart,
General Manager

Cc: RCSD Board of Directors

APPENDIX “A”

EFFLUENT MINERAL CHARACTERISTICS FOR LWRP, PWRP AND RWWTP

**TABLE 11, FINAL FACILITIES PLANNING REPORT, ANTELOPE VALLEY
RECYCLED WATER PROJECT**

Table 11: Effluent Mineral Characteristics for LWRP, PWRP and RWWTP

Parameter (Annual Mean Values)	Unit	LWRP ¹	PWRP ¹	RWWTP ²
Total Dissolved Solids	mg/l	548	520	590
Ammonia-N	mg/l	15.7	22	32
Calcium	mg/l	44	31.1	NA
Magnesium	mg/l	12.3	11.3	NA
Arsenic	mg/l	< 0.0022	< 0.001	0.007
Barium	mg/l	0.014	NA	NA
Aluminum	mg/l	< 0.09	NA	NA
Cadmium	mg/l	< 0.0004	< 0.0004	ND
Total Chromium	mg/l	< 0.010	< 0.010	ND
Hexavalent Chromium	mg/l	< 0.0001	NA	NA
Cobalt	mg/l	< 0.010	NA	NA
Iron	mg/l	0.275	NA	NA
Lead	mg/l	< 0.002	< 0.002	0.006
Manganese	mg/l	0.019	NA	NA
Mercury	mg/l	< 0.00004	< 0.00004	ND
Nickel	mg/l	< 0.020	< 0.020	ND
Potassium	mg/l	17	14.1	NA
Silver	mg/l	< 0.00036	< 0.00033	ND
Antimony	mg/l	< 0.0005	< 0.0005	ND
Beryllium	mg/l	< 0.0007	< 0.0005	ND
Molybdenum	mg/l	< 0.04	NA	NA
Thallium	mg/l	< 0.001	< 0.001	ND
Vanadium	mg/l	< 0.020	NA	NA
Sulfate	mg/l	80	69	NA
Chloride	mg/l	141	113	98
Total Hardness (as C ₂ CO ₃)	mg/l	127	NA	NA
MBAS	mg/l	0.1	0.2	7.8
Copper	mg/l	< 0.010	NA	0.043
Selenium	mg/l	< 0.001	NA	ND
Sodium	mg/l	167	125	NA
Zinc	mg/l	0.067	NA	0.440

NA: not available

ND: None detected at DLR.

¹2004 Annual Reports.

²BSK Analytical Laboratories Certificate of Analysis, Sample Date 07/20/04 of influent sewer.

APPENDIX “B”

ROUTING ALTERNATIVES AND POINT OF DELIVERY MAP

Proposed Alternate Recycled Water Pipelines

Beacon Solar Energy Project Site

California City

Mojave

Division Edwards Eastern Alternate
39.95 Miles



Sierra Highway Western Alternate
39.61 Miles

Rosamond

Edwards Air Force Base

Point of Delivery

N

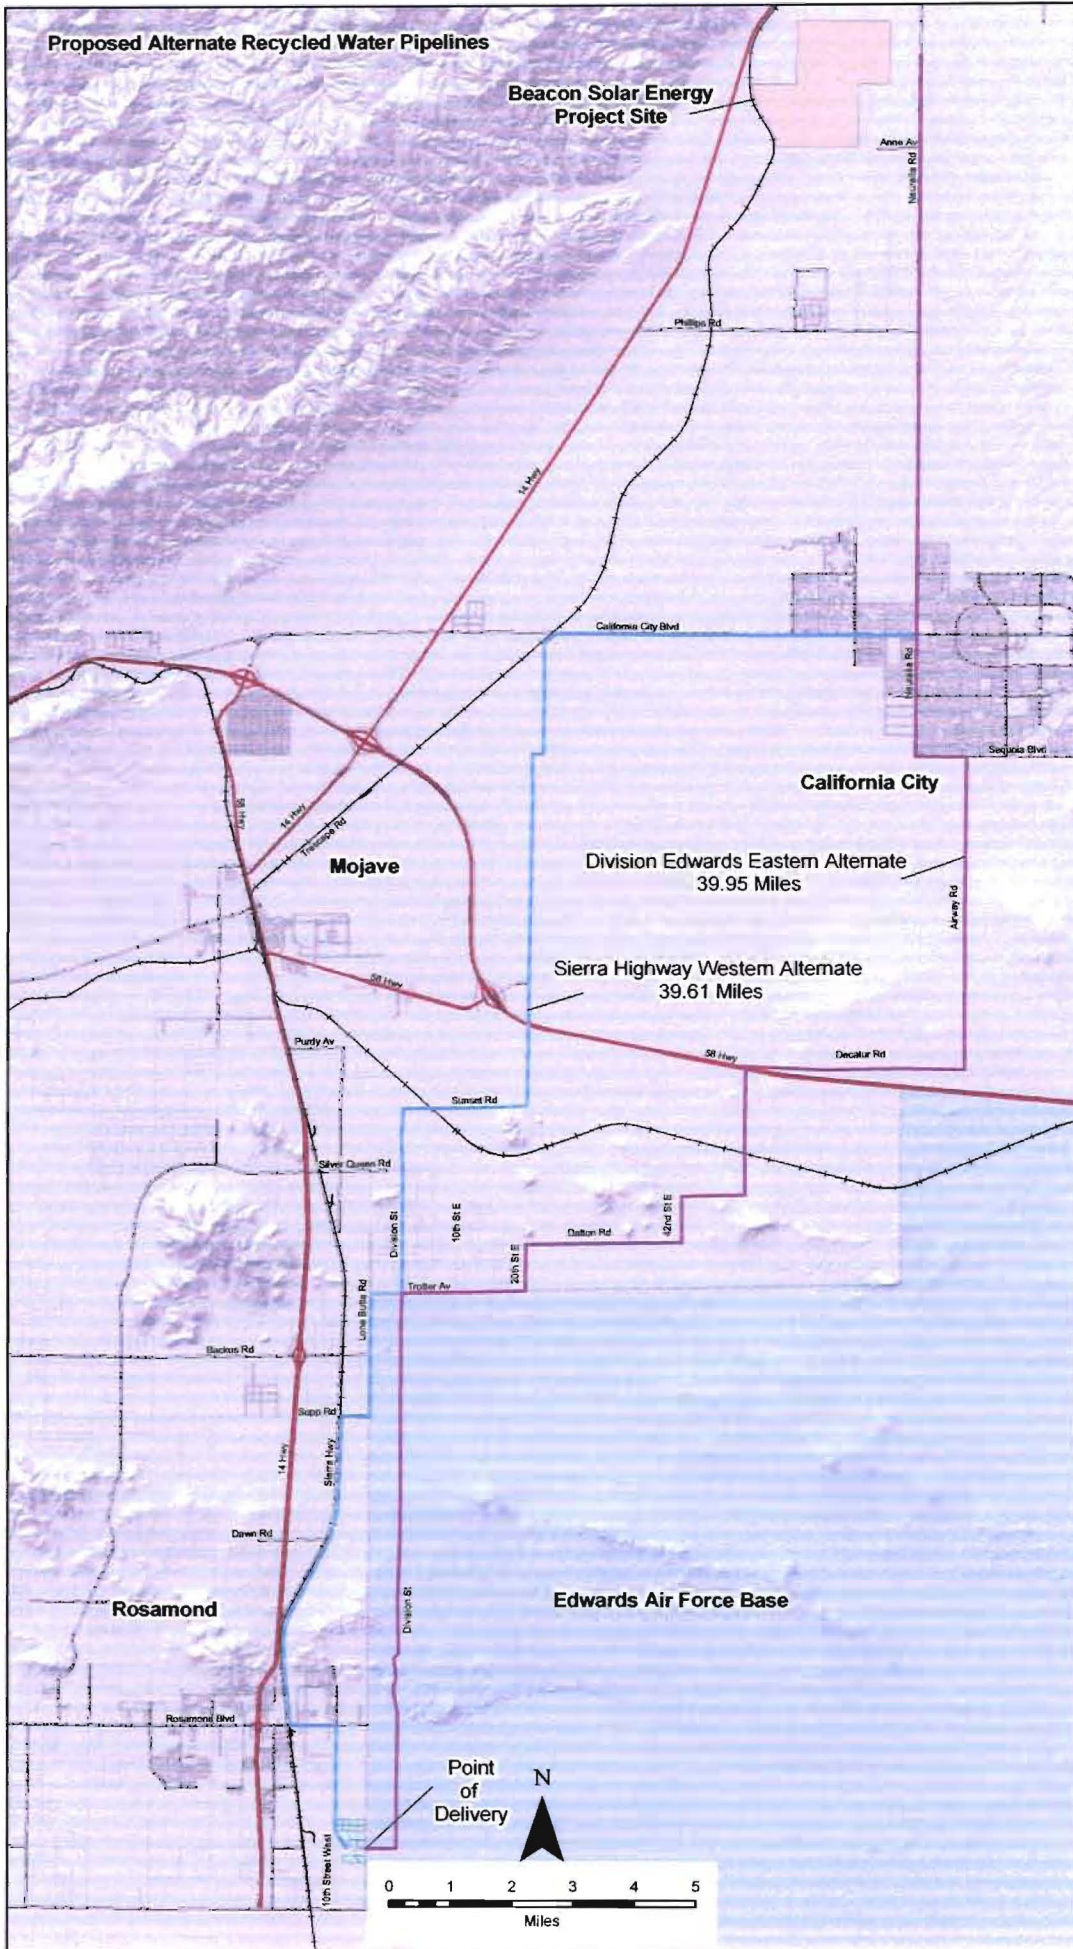

APPENDIX “C”

BEACON PROJECT WATER COST BASIS

BEACON PROJECT WATER COST BASIS

RCSD Tertiary Water (TW) Availability

$$\text{Annual TW} = (1.3 \text{ MGD}) (365) (1/.3259) = 1,456 \text{ AF/yr}$$

Capital Costs

RCSD

2.0 MGD Deep Lagoon Tertiary Plant Construction Estimate = \$22,000,000

1.0 MGD for Beacon Project: \$11,000,000

Beacon

500 AF TW Seasonal Storage Construction Estimate = \$5,200,000* (needed for peaking ability)

(***does not** provide for public agency construction under prevailing wage requirements)

Tertiary Water Rate

Potable Water Rate: Assume ¾" meter, 1 AF/month = 436 HCF/month, Rate effective 10/09

<u>HCF</u>	<u>Flat Rate</u>	<u>\$/HCF</u>	<u>\$/Tier</u>
3	16.00	-	16.00
4-18	-	1.30	19.50
19-33	-	1.43	21.45
34-43	-	1.61	16.10
44-436	-	1.80	<u>707.40</u>
Total:			\$780.45

80% of Potable Water Cost

$$\text{TW Cost} = (\$780.45/\text{AF Potable}) (0.8) = \$624/\text{AF}$$

Total Cost of Delivered Water

$$\text{Total Cost/AF with constant flow rate} = \text{TW Cost} + \text{O\&M Cost} = (0.8) (\text{Potable Rate}) + (\text{Actual O\&M})$$

APPENDIX “D”

BEACON PROJECT SUPPLIED BY RCSD W/PEAKING CAPACITY

CAPITAL AND ANNUAL COST ESTIMATES

BEACON PROJECT SUPPLIED BY RCSD w/o PEAKING CAPACITY

CAPITAL AND ANNUAL COST ESTIMATES

Tertiary Water Demand

Beacon Solar 230 MW Project
 RCSD WWTP Capability = 1.3MGD = 4.0 AF/day
 = 2.0 CFS

Main Sizing Criteria/Formula

CML pipe;

Minimize head losses;

$Q=VA$;

$h = (0.1) (5280/D) (V^2/64.4) = \text{ft head loss/mile}$

Assume Maximum pressure of 185 psi = 427'

Pumping Cost = $(24) (365) (0.746Qhc) / (3960u_p u_m)$

$Q = 2.0 \text{ cfs} = 900 \text{ gpm}$

$h = \text{total head (ft)}$

$c = \text{Electrical Cost: assume } \$0.10/\text{kWhr}$

$u_m u_p = \text{plant efficiency} = 0.70$

Pumping Cost = $(212) (h)$

Cost Estimates of Transmission Mains

Basis: \$13.00/in-dia/ft used in NLA/KC Project (\$2005);

1.09 CPI Adjustment to \$2009 = \$14.2/in-dia/ft (Use in areas with pavement, existing streets)

Use \$11/in-dia/ft in unimproved areas (per City of Lancaster bidding experience)

Eastern Route

Western Route

<u>Length(ft)</u>	<u>\$/in-dia/ft</u>	<u>\$/in-dia</u>	<u>Length(ft)</u>	<u>\$/in-dia/ft</u>	<u>\$/in-dia</u>
64,000	14.2	908,800	64,000	14.2	908,800

105,700	11.0	1,162,700	95,068	11.0	1,045,748
<u>50,550</u>	14.2	<u>717,810</u>	<u>50,550</u>	14.2	<u>717,810</u>
220,250		2,789,310	209,618		2,672,358

Eastern Weighted \$/in-dia/ft = \$12.66

Western Weighted \$/in-dia/ft = \$12.75

TRANSMISSION MAIN CAPITAL COST ESTIMATES											
Main Size (in)	Main Cost		Boosting Head					Booster Stations		Total Capital	
	Eastern (\$)	Western (\$)	Friction Head Loss (ft/mile) (Miles)		Elevation (ft)	Total h (ft)	No.	Cost (@\$1M/Sta.)	Eastern (\$)	Western (\$)	
12	33,460,380	32,071,554	53.2	23.1	1,229	393	1,622	3.8	4,000,000	37,460,380	36,071,554
14	39,037,110	37,416,813	24.6	23.1	568	393	961	2.3	3,000,000	42,037,110	40,416,813
16	44,613,840	42,762,072	12.6	23.1	291	393	684	1.6	2,000,000	46,613,840	44,762,072
18	50,190,570	48,107,331	7.0	23.1	162	393	555	1.3	2,000,000	52,190,570	50,107,331

ANNUAL WATER COST ESTIMATES			
Main Size (in)	Energy Cost (\$212/h)	Maint. Cost (\$20k/Sta.)	Total (\$)
12	343,847	75,968	419,815
14	203,787	45,024	248,811
16	145,021	32,040	177,061
18	117,596	25,981	143,578

Proposed Project and Estimated Costs

Use 14" Transmission main from RCSD to Beacon Project using the EAFB route

Capital Cost = Transmission main + 2.0 Tertiary WWTP + Beacon Onsite Seasonal Storage

Capital Cost = \$40,416,813 + \$11,000,000 + 6,500,000 = \$57.9M (RCSD Construction)

Capital Cost = \$32,333,450* + \$11,000,000 + \$5,200,000* = \$48.5M (*Beacon Construction)

Annual Cost = TW Cost + O&M = (\$624/AF) (1,456 AF) + \$248,811 = \$1,157,355/yr

Dennis D. LaMoreaux, P.E. C45906

June 24, 2009