

DOCKETED

Docket Number:	12-AFC-02
Project Title:	Huntington Beach Energy Project
TN #:	201955
Document Title:	Revised Preliminary Determination of Compliance
Description:	N/A
Filer:	Teraja Golston
Organization:	South Coast Air Quality Management District
Submitter Role:	Public Agency
Submission Date:	4/2/2014 3:32:38 PM
Docketed Date:	4/2/2014



South Coast Air Quality Management District

21865 Copley Drive, Diamond Bar, CA 91765-4178
(909) 396-2000 • www.aqmd.gov

April 1, 2014

Ms. Felicia Miller, Project Manager
California Energy Commission
1516 Ninth Street, MS-2000
Sacramento, CA 95814

SUBJECT: Huntington Beach Energy Project (HBEP)
Facility Location: 21730 Newland St, Huntington Beach, CA 92646

Dear Ms. Miller:

The South Coast Air Quality Management District (SCAQMD) has received permit applications for the subject project. The applicant is proposing to replace two existing electric utility boiler generator Units 1 and 2 that are older, less efficient units and which have been in operation since the 1950's with a new, state of the art and more efficient gas turbine generating system. The new generating system will consist of six natural gas-fired Mitsubishi 501DA combined cycle gas turbine generators configured as two 3-on-1 power blocks each with a steam turbine generator. The combined generating capacity of the HBEP will be 939 MW, as limited by the existing transmission line interconnect. This capacity replaces the generating capacity of the existing Unit 1 (215 MW) and Unit 2 (215 MW) at the Huntington Beach site as well as existing Unit 6 (175 MW) and Unit 8 (460 MW) at AES' Redondo Beach facility. The new HBEP will be equipped with air pollution control equipment, which consists of catalysts (selective catalytic reduction and oxidation catalysts). Additional new proposed equipment will include a 24,000 gallon aqueous ammonia storage tank.

The SCAQMD has evaluated the permit applications and made a preliminary determination that the equipment will comply with all of the applicable requirements of our rules and regulations. Attached for your review and comment is a Preliminary Determination of Compliance (PDOC) that includes the SCAQMD's engineering analysis. Based on the emission potential, this project is subject to the public notice requirements specified in SCAQMD Rules 212 – Standards for Approving Permits and Issuing Public Notice, 1710 – Prevention of Significant Deterioration Analysis, Notice and Reporting, 1714 – Prevention of Significant Deterioration for Greenhouse Gases, 3006 – Title V Public Participation.


We intend to issue the final permit 1) upon completion of the 30-day public comment and review period and after all pertinent comments have been considered, 2) after EPA's review of the Title V permit significant revision, and 3) upon issuance of a license for the project from the California Energy Commission.

Please find enclosed a public notice for the subject project issued in accordance with SCAQMD Rules 212, 1710, 1714, and 3006. The public notice is also being published in a newspaper of

general circulation in the vicinity of the project, and it is also being forwarded to other interested parties.

If you wish to provide comments or have any questions regarding this project, please contact Mr. Chris Perri at (909) 396-2696/cperri@aqmd.gov.

Sincerely,

A handwritten signature in black ink, appearing to read "Andrew Y. Lee". The signature is fluid and cursive, written over the word "Sincerely,".

Andrew Y. Lee, P.E.
Sr. Engineering Manager
Engineering and Compliance

Public Notice
Draft Facility Permit
PDOC

AYL:CDT:JTY:CGP

cc: Stephen O'Kane w/o attachments

Preliminary
Determination of Compliance

Huntington Beach Energy Project



South Coast Air Quality Management District

April 2014



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 2	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

APPLICANT:

AES Huntington Beach, LLC
21730 Newland St
Huntington Beach, CA 92646
SCAQMD ID# 115389

EQUIPMENT LOCATION:

21730 Newland St
Huntington Beach, CA 92646

EQUIPMENT DESCRIPTION:

Section H of the Facility Permit ID# 115389

Equipment	ID No.	Connected To	RECLAIM Source Type/Monitoring Unit	Emissions and Requirements	Conditions
PROCESS 3: POWER GENERATION-GAS TURBINES					
GAS TURBINE, UNIT NO.1A, COMBINED CYCLE, NATURAL GAS, MITSUBISHI MODEL 501DA, 1498 MMBTU AT 32 DEGREES F WITH DRY LOW NOX COMBUSTOR A/N: 539746	D115	C120, C121, S123	NOX: MAJOR SOURCE	CO: 2.0 PPM NATURAL GAS (4) [RULE 1703-PSD]; CO: 2000 PPM (5) [RULE 407]	A63.5, A63.6, A99.4., A195.6, A195.7, A195.8, A327.1, B61.1, C1.7, C1.8, C1.9, C1.10, D29.5, D29.6, D29.7, D82.3, D82.4, E193.3, E193.4, E193.5, E193.6, I298.1, I298.2, K40.3, K67.5
GENERATOR, 132.3 MW GROSS AT 32 DEGREES F	(B116)			NOX: 2.0 PPM NATURAL GAS (4) [RULE 1303(a)(1)-BACT, RULE 1703-PSD]; NOX: 15 PPM NATURAL GAS (8) [40 CFR60 SUBPART KKKK]; NOX: 12.75 LBS/MMCF NATURAL GAS (1) [RULE 2012]	
GENERATOR, HEAT RECOVERY STEAM	(B117)			VOC: 2.0 PPM NATURAL GAS (4) [RULE 1303(A)(1)-BACT]	
TURBINE, STEAM, COMMON WITH GAS TURBINE NOS. 1B AND 1C, 148.7 MW GROSS	(B118)			PM: 0.1 GR/SCF (5) [RULE 409]; PM: 11 LBS/HR (5) [RULE 475]; PM: 0.01 GR/SCF (5A) [RULE 475];	
				SOX: 0.060 LBS/MMBTU (8) [40CFR 60 SUBPART KKKK]; SO2: (9) [40CFR 72 - ACID RAIN]; SOX: 0.71 LBS/MMCF NATURAL GAS (1) [RULE 2011]	



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 3	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

Equipment	ID No.	Connected To	RECLAIM Source Type/ Monitoring Unit	Emissions and Requirements	Conditions
PROCESS 3: POWER GENERATION-GAS TURBINES					
BURNER, DUCT, NATURAL GAS, 507 MMBTU, LOCATED IN THE HRSG OF TURBINE NO. 1A A/N: 539746	D119		NOX: MAJOR SOURCE	CO: 2.0 PPM NATURAL GAS (4) [RULE 1703-PSD]; CO: 2000 PPM (5) [RULE 407] NOX: 2.0 PPM NATURAL GAS (4) [RULE 1303(a)(1)-BACT, RULE 1703-PSD]; NOX: 15 PPM NATURAL GAS (8) [40 CFR60 SUBPART KKKK]; NOX: 12.75 LBS/MMCF NATURAL GAS (1) [RULE 2012] VOC: 2.0 PPM NATURAL GAS (4) [RULE 1303(A)(1)-BACT] PM: 0.1 GR/SCF (5) [RULE 409]; PM: 11 LBS/HR (5) [RULE 475]; PM: 0.01 GR/SCF (5A) [RULE 475]; SOX: 0.060 LBS/MMBTU (8) [40CFR 60 SUBPART KKKK] SO ₂ : (9) [40CFR 72 - ACID RAIN]; SOX: 0.71 LBS/MMCF NATURAL GAS (1) [RULE 2011]	I298.3, I298.4
CO OXIDATION CATALYST, JOHNSON MATTHEY, SERVING GAS TURBINE NO. 1A, WITH 261 MODULES, 2655 CU. FEET OF TOTAL CATALYST VOLUME A/N: 540256	C120	D115			
SELECTIVE CATALYTIC REDUCTION, HALDOR TOPSOE, TITANIUM./VANADIUM/T UNGSTEN, SERVING UNIT NO.1A, WITH 20 MODULES, 140.8 CU. FEET OF TOTAL CATALYST VOLUME WITH A/N: 540256	C121	D115		NH ₃ : 5 PPM (4) [RULE 1303(a)(1)-BACT]	A195.9, D12.7, D12.8, D12.9, E179.4, E179.5, E193.4
AMMONIA INJECTION, INJECTION GRID	(B122)				
STACK SERVING UNIT NO. 1A, 120' H. X 18' DIA. A/N: 539746	S123	D115			



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 4	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

Equipment	ID No.	Connected To	RECLAIM Source Type/ Monitoring Unit	Emissions and Requirements	Conditions
PROCESS 3: POWER GENERATION-GAS TURBINES					
GAS TURBINE, UNIT NO.1B, COMBINED CYCLE, NATURAL GAS, MITSUBISHI MODEL 501DA, 1498 MMBTU AT 32 DEGREES F WITH DRY LOW NOX COMBUSTOR A/N: 539747	D124	C129 C130 S132	NOX: MAJOR SOURCE	CO: 2.0 PPM NATURAL GAS (4) [RULE 1703-PSD]; CO: 2000 PPM (5) [RULE 407] NOX: 2.0 PPM NATURAL GAS (4) [RULE 1303(a)(1)-BACT, RULE 1703-PSD]; NOX: 15 PPM NATURAL GAS (8) [40 CFR60 SUBPART KKKK]; NOX: 12.75 LBS/MMCF NATURAL GAS (1) [RULE 2012] VOC: 2.0 PPM NATURAL GAS (4) [RULE 1303(A)(1)-BACT] PM: 0.1 GR/SCF (5) [RULE 409]; PM: 11 LBS/HR (5) [RULE 475]; PM: 0.01 GR/SCF (5A) [RULE 475]; SOX: 0.060 LBS/MMBTU (8) [40CFR 60 SUBPART KKKK] SO2: (9) [40CFR 72 - ACID RAIN]; SOX: 0.71 LBS/MMCF NATURAL GAS (1) [RULE 2011]	A63.5, A63.6, A99.4., A195.6, A195.7, A195.8, A327.1, B61.1, C1.7, C1.8, C1.9, C1.10, D29.5, D29.6, D29.7, D82.3, D82.4, E193.3, E193.4, E193.5, E193.6, I298.1, I298.2, K40.3, K67.5
GENERATOR, 132.3 MW GROSS AT 32 DEGREES F	(B125)				
GENERATOR, HEAT RECOVERY STEAM	(B126)				
TURBINE, STEAM, COMMON WITH GAS TURBINE NOS. 1A AND 1C, 148.7 MW GROSS	(B127)				
BURNER, DUCT, NATURAL GAS, 507 MMBTU, LOCATED IN THE HRSG OF TURBINE NO. 1B A/N: 539747	D128		NOX: MAJOR SOURCE	CO: 2.0 PPM NATURAL GAS (4) [RULE 1703-PSD]; CO: 2000 PPM (5) [RULE 407] NOX: 2.0 PPM NATURAL GAS (4) [RULE 1303(a)(1)-BACT, RULE 1703-PSD]; NOX: 15 PPM NATURAL GAS (8) [40 CFR60 SUBPART KKKK]; NOX: 12.75 LBS/MMCF NATURAL GAS (1) [RULE 2012] VOC: 2.0 PPM NATURAL GAS (4) [RULE 1303(A)(1)-BACT] PM: 0.1 GR/SCF (5) [RULE 409]; PM: 11 LBS/HR (5) [RULE 475]; PM: 0.01 GR/SCF (5A) [RULE 475]; SOX: 0.060 LBS/MMBTU (8) [40CFR 60 SUBPART KKKK] SO2: (9) [40CFR 72 - ACID RAIN]; SOX: 0.71 LBS/MMCF NATURAL GAS (1) [RULE 2011]	I298.3, I298.4
CO OXIDATION	C129	D83			



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 5	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

Equipment	ID No.	Connected To	RECLAIM Source Type/ Monitoring Unit	Emissions and Requirements	Conditions
PROCESS 3: POWER GENERATION-GAS TURBINES					
CATALYST, JOHNSON MATTHEY, SERVING GAS TURBINE NO. 1B, WITH 261 MODULES, 2655 CU. FEET OF TOTAL CATALYST VOLUME A/N: 540257					
SELECTIVE CATALYTIC REDUCTION, HALDOR TOPSOE, TITANIUM./VANADIUM/TUNGSTEN, SERVING UNIT NO.1B, WITH 20 MODULES, 140.8 CU. FEET OF TOTAL CATALYST VOLUME WITH A/N: 540257	C130	D83		NH3: 5 PPM (4) [RULE 1303(a)(1)-BACT]	A195.9, D12.7, D12.8, D12.9, E179.4, E179.5, E193.4
AMMONIA INJECTION, INJECTION GRID	(B131)				
STACK SERVING UNIT NO. 1B, 120' H. X 18' DIA. A/N: 539747	S132	D83			
GAS TURBINE, UNIT NO.1C, COMBINED CYCLE, NATURAL GAS, MITSUBISHI MODEL 501DA, 1498 MMBTU AT 32 DEGREES F WITH DRY LOW NOX COMBUSTOR A/N: 539748	D133			CO: 2.0 PPM NATURAL GAS (4) [RULE 1703-PSD]; CO: 2000 PPM (5) [RULE 407] NOX: 2.0 PPM NATURAL GAS (4) [RULE 1303(a)(1)-BACT, RULE 1703-PSD]; NOX: 15 PPM NATURAL GAS (8) [40 CFR60 SUBPART KKKK]; NOX: 12.75 LBS/MMCF NATURAL GAS (1) [RULE 2012] VOC: 2.0 PPM NATURAL GAS (4) [RULE 1303(A)(1)-BACT] PM: 0.1 GR/SCF (5) [RULE 409]; PM: 11 LBS/HR (5) [RULE 475]; PM: 0.01 GR/SCF (5A) [RULE 475]; SOX: 0.060 LBS/MMBTU (8) [40CFR 60 SUBPART KKKK] SO2: (9) [40CFR 72 - ACID RAIN]; SOX: 0.71 LBS/MMCF NATURAL GAS (1) [RULE 2011]	A63.5, A63.6, A99.4., A195.6, A195.7, A195.8, A327.1, B61.1, C1.7, C1.8, C1.9, C1.10, D29.5, D29.6, D29.7, D82.3 D82.4, E193.3, E193.4, E193.5, E193.6, I298.1, I298.2, K40.3, K67.5
GENERATOR, 132.3 MW GROSS AT 32 DEGREES F	(B134)				
GENERATOR, HEAT RECOVERY STEAM	(B135)				
TURBINE, STEAM, COMMON WITH GAS TURBINE NOS. 1A AND 1B, 148.7MW GROSS	(B136)				
BURNER, DUCT,	D137			CO: 2.0 PPM NATURAL GAS (4)	I298.3, I298.4



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 6	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

Equipment	ID No.	Connected To	RECLAIM Source Type/ Monitoring Unit	Emissions and Requirements	Conditions
PROCESS 3: POWER GENERATION-GAS TURBINES					
NATURAL GAS, 507 MMBTU, LOCATED IN THE HRSG OF TURBINE NO. 1C A/N: 539748				[RULE 1703-PSD]; CO: 2000 PPM (5) [RULE 407] NOX: 2.0 PPM NATURAL GAS (4) [RULE 1303(a)(1)-BACT, RULE 1703-PSD]; NOX: 15 PPM NATURAL GAS (8) [40 CFR60 SUBPART KKKK]; NOX: 12.75 LBS/MMCF NATURAL GAS (1) [RULE 2012] VOC: 2.0 PPM NATURAL GAS (4) [RULE 1303(A)(1)-BACT] PM: 0.1 GR/SCF (5) [RULE 409]; PM: 11 LBS/HR (5) [RULE 475]; PM: 0.01 GR/SCF (5A) [RULE 475]; SOX: 0.060 LBS/MMBTU (8) [40CFR 60 SUBPART KKKK] SO2: (9) [40CFR 72 - ACID RAIN]; SOX: 0.71 LBS/MMCF NATURAL GAS (1) [RULE 2011]	
CO OXIDATION CATALYST, JOHNSON MATTHEY, SERVING GAS TURBINE NO. 1C, WITH 261 MODULES, 2655 CU. FEET OF TOTAL CATALYST VOLUME A/N: 540258	C138				
SELECTIVE CATALYTIC REDUCTION, HALDOR TOPSOE, TITANIUM./VANADIUM/TUNGSTEN, SERVING UNIT NO.1C, WITH 20 MODULES, 140.8 CU. FEET OF TOTAL CATALYST VOLUME WITH A/N: 540258	C139				A195.9, D12.7, D12.8, D12.9, E179.4, E179.5, E193.4
AMMONIA INJECTION, INJECTION GRID	(B140)				
STACK SERVING UNIT NO. 1C, 120' H. X 18' DIA. A/N: 539748	S141				



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 7	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

Equipment	ID No.	Connected To	RECLAIM Source Type/ Monitoring Unit	Emissions and Requirements	Conditions
PROCESS 3: POWER GENERATION-GAS TURBINES					
GAS TURBINE, UNIT NO.2A, COMBINED CYCLE, NATURAL GAS, MITSUBISHI MODEL 501DA, 1498 MMBTU AT 32 DEGREES F WITH DRY LOW NOX COMBUSTOR A/N: 539768	D142			<p>CO: 2.0 PPM NATURAL GAS (4) [RULE 1703-PSD]; CO: 2000 PPM (5) [RULE 407]</p> <p>NOX: 2.0 PPM NATURAL GAS (4) [RULE 1303(a)(1)-BACT, RULE 1703-PSD]; NOX: 15 PPM NATURAL GAS (8) [40 CFR60 SUBPART KKKK]; NOX: 12.75 LBS/MMCF NATURAL GAS (1) [RULE 2012]</p> <p>VOC: 2.0 PPM NATURAL GAS (4) [RULE 1303(A)(1)-BACT]</p> <p>PM: 0.1 GR/SCF (5) [RULE 409]; PM: 11 LBS/HR (5) [RULE 475]; PM: 0.01 GR/SCF (5A) [RULE 475];</p> <p>SOX: 0.060 LBS/MMBTU (8) [40CFR 60 SUBPART KKKK] SO2: (9) [40CFR 72 – ACID RAIN]; SOX: 0.71 LBS/MMCF NATURAL GAS (1) [RULE 2011]</p>	A63.5, A63.6, A99.4., A195.6, A195.7, A195.8, A327.1, B61.1, C1.7, C1.8, C1.9, C1.10, D29.5, D29.6, D29.7, D82.3 D82.4, E193.3, E193.4, E193.5, E193.6, I298.1, I298.2, K40.3, K67.5
GENERATOR, 132.3 MW GROSS AT 32 DEGREES F	(B143)				
GENERATOR, HEAT RECOVERY STEAM	(B144)				
TURBINE, STEAM, COMMON WITH GAS TURBINE NOS. 2B AND 2C, 148.7MW GROSS	(B145)				
BURNER, DUCT, NATURAL GAS, 507 MMBTU, LOCATED IN THE HRSG OF TURBINE NO. 2A A/N: 539768	D146			<p>CO: 2.0 PPM NATURAL GAS (4) [RULE 1703-PSD]; CO: 2000 PPM (5) [RULE 407]</p> <p>NOX: 2.0 PPM NATURAL GAS (4) [RULE 1303(a)(1)-BACT, RULE 1703-PSD]; NOX: 15 PPM NATURAL GAS (8) [40 CFR60 SUBPART KKKK]; NOX: 12.75 LBS/MMCF NATURAL GAS (1) [RULE 2012]</p> <p>VOC: 2.0 PPM NATURAL GAS (4) [RULE 1303(A)(1)-BACT]</p> <p>PM: 0.1 GR/SCF (5) [RULE 409]; PM: 11 LBS/HR (5) [RULE 475]; PM: 0.01 GR/SCF (5A) [RULE 475];</p> <p>SOX: 0.060 LBS/MMBTU (8) [40CFR 60 SUBPART KKKK] SO2: (9) [40CFR 72 – ACID RAIN]; SOX: 0.71 LBS/MMCF NATURAL GAS (1) [RULE 2011]</p>	I298.3, I298.4
CO OXIDATION	C147				



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 8	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

Equipment	ID No.	Connected To	RECLAIM Source Type/ Monitoring Unit	Emissions and Requirements	Conditions
PROCESS 3: POWER GENERATION-GAS TURBINES					
CATALYST, JOHNSON MATTHEY, SERVING GAS TURBINE NO. 2A, WITH 261 MODULES, 2655 CU. FEET OF TOTAL CATALYST VOLUME A/N: 540260					
SELECTIVE CATALYTIC REDUCTION, HALDOR TOPSOE, TITANIUM./VANADIUM/TUNGSTEN, SERVING UNIT NO.2A, WITH 20 MODULES, 140.8 CU. FEET OF TOTAL CATALYST VOLUME WITH A/N: 540260	C148			NH3: 5 PPM (4) [RULE 1303(a)(1)-BACT]	A195.9, D12.7, D12.8, D12.9, E179.4, E179.5, E193.4
AMMONIA INJECTION, INJECTION GRID	(B149)				
STACK SERVING UNIT NO. 2A, 120' H. X 18' DIA. A/N: 539768	S150				
GAS TURBINE, UNIT NO.2B, COMBINED CYCLE, NATURAL GAS, MITSUBISHI MODEL 501DA, 1498 MMBTU AT 32 DEGREES F WITH DRY LOW NOX COMBUSTOR A/N: 539769	D151			CO: 2.0 PPM NATURAL GAS (4) [RULE 1703-PSD]; CO: 2000 PPM (5) [RULE 407] NOX: 2.0 PPM NATURAL GAS (4) [RULE 1303(a)(1)-BACT, RULE 1703-PSD]; NOX: 15 PPM NATURAL GAS (8) [40 CFR60 SUBPART KKKK]; NOX: 12.75 LBS/MMCF NATURAL GAS (1) [RULE 2012] VOC: 2.0 PPM NATURAL GAS (4) [RULE 1303(A)(1)-BACT] PM: 0.1 GR/SCF (5) [RULE 409]; PM: 11 LBS/HR (5) [RULE 475]; PM: 0.01 GR/SCF (5A) [RULE 475]; SOX: 0.060 LBS/MMBTU (8) [40CFR 60 SUBPART KKKK] SO2: (9) [40CFR 72 - ACID RAIN]; SOX: 0.71 LBS/MMCF NATURAL GAS (1) [RULE 2011]	A63.5, A63.6, A99.4., A195.6, A195.7, A195.8, A327.1, B61.1, C1.7, C1.8, C1.9, C1.10, D29.5, D29.6, D29.7, D82.3 D82.4, E193.3, E193.4, E193.5, E193.6, I298.1, I298.2, K40.3, K67.5
GENERATOR, 132.3 MW GROSS AT 32 DEGREES F	(B152)				
GENERATOR, HEAT RECOVERY STEAM	(B153)				
TURBINE, STEAM, COMMON WITH GAS TURBINE NOS. 2A AND 2C, 148.7MW GROSS	(B154)				
BURNER, DUCT,	D155			CO: 2.0 PPM NATURAL GAS (4)	I298.3, I298.4



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 9	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

Equipment	ID No.	Connected To	RECLAIM Source Type/ Monitoring Unit	Emissions and Requirements	Conditions
PROCESS 3: POWER GENERATION GAS TURBINES					
NATURAL GAS, 507 MMBTU, LOCATED IN THE HRSG OF TURBINE NO. 2B A/N: 539769				[RULE 1703-PSD]; CO: 2000 PPM (5) [RULE 407] NOX: 2.0 PPM NATURAL GAS (4) [RULE 1303(a)(1)-BACT, RULE 1703-PSD]; NOX: 15 PPM NATURAL GAS (8) [40 CFR60 SUBPART KKKK]; NOX: 12.75 LBS/MMCF NATURAL GAS (1) [RULE 2012] VOC: 2.0 PPM NATURAL GAS (4) [RULE 1303(A)(1)-BACT] PM: 0.1 GR/SCF (5) [RULE 409]; PM: 11 LBS/HR (5) [RULE 475]; PM: 0.01 GR/SCF (5A) [RULE 475]; SOX: 0.060 LBS/MMBTU (8) [40CFR 60 SUBPART KKKK] SO2: (9) [40CFR 72 – ACID RAIN]; SOX: 0.71 LBS/MMCF NATURAL GAS (1) [RULE 2011]	
CO OXIDATION CATALYST, JOHNSON MATTHEY, SERVING GAS TURBINE NO. 2B, WITH 261 MODULES, 2655 CU. FEET OF TOTAL CATALYST VOLUME A/N: 540261	C156				
SELECTIVE CATALYTIC REDUCTION, HALDOR TOPSOE, TITANIUM./VANADIUM/TUNGSTEN, SERVING UNIT NO.2B, WITH 20 MODULES, 140.8 CU. FEET OF TOTAL CATALYST VOLUME WITH A/N: 540261	C157			NH3: 5 PPM (4) [RULE 1303(a)(1)-BACT]	A195.9, D12.7, D12.8, D12.9, E179.4, E179.5, E193.4
AMMONIA INJECTION, INJECTION GRID	(B158)				
STACK SERVING UNIT NO. 2B, 120' H. X 18' DIA. A/N: 539769	S159				



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 10	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

Equipment	ID No.	Connected To	RECLAIM Source Type/ Monitoring Unit	Emissions and Requirements	Conditions
PROCESS 3: POWER GENERATION-GAS TURBINES					
GAS TURBINE, UNIT NO.2C, COMBINED CYCLE, NATURAL GAS, MITSUBISHI MODEL 501DA, 1498 MMBTU AT 32 DEGREES F WITH DRY LOW NOX COMBUSTOR A/N: 539770	D160			CO: 2.0 PPM NATURAL GAS (4) [RULE 1703-PSD]; CO: 2000 PPM (5) [RULE 407]	A63.5, A63.6, A99.4., A195.6, A195.7, A195.8, A327.1, B61.1, C1.7, C1.8, C1.9, C1.10, D29.5, D29.6, D29.7, D82.3
GENERATOR, 132.3 MW GROSS AT 32 DEGREES F	(B161)			VOC: 2.0 PPM NATURAL GAS (4) [RULE 1303(A)(1)-BACT]	D82.4, E193.3, E193.4, E193.5, E193.6, I298.1, I298.2, K40.3, K67.5
GENERATOR, HEAT RECOVERY STEAM	(B162)			PM: 0.1 GR/SCF (5) [RULE 409]; PM: 11 LBS/HR (5) [RULE 475]; PM: 0.01 GR/SCF (5A) [RULE 475];	
TURBINE, STEAM, COMMON WITH GAS TURBINE NOS. 2A AND 2B, 148.7MW GROSS	(B163)			SOX: 0.060 LBS/MMBTU (8) [40CFR 60 SUBPART KKKK] SO2: (9) [40CFR 72 - ACID RAIN]; SOX: 0.71 LBS/MMCF NATURAL GAS (1) [RULE 2011]	
BURNER, DUCT, NATURAL GAS, 507 MMBTU, LOCATED IN THE HRSG OF TURBINE NO. 2C A/N: 539770	D164			CO: 2.0 PPM NATURAL GAS (4) [RULE 1703-PSD]; CO: 2000 PPM (5) [RULE 407]	I298.3, I298.4
				NOX: 2.0 PPM NATURAL GAS (4) [RULE 1303(a)(1)-BACT, RULE 1703-PSD]; NOX: 15 PPM NATURAL GAS (8) [40 CFR60 SUBPART KKKK]; NOX: 12.75 LBS/MMCF NATURAL GAS (1) [RULE 2012]	
				VOC: 2.0 PPM NATURAL GAS (4) [RULE 1303(A)(1)-BACT]	
				PM: 0.1 GR/SCF (5) [RULE 409]; PM: 11 LBS/HR (5) [RULE 475]; PM: 0.01 GR/SCF (5A) [RULE 475];	
				SOX: 0.060 LBS/MMBTU (8) [40CFR 60 SUBPART KKKK] SO2: (9) [40CFR 72 - ACID RAIN]; SOX: 0.71 LBS/MMCF NATURAL GAS (1) [RULE 2011]	
CO OXIDATION	C165				



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 11	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

Equipment	ID No.	Connected To	RECLAIM Source Type/ Monitoring Unit	Emissions and Requirements	Conditions
PROCESS 3: POWER GENERATION-GAS TURBINES					
CATALYST, JOHNSON MATTHEY, SERVING GAS TURBINE NO. 2C, WITH 261 MODULES, 2655 CU. FEET OF TOTAL CATALYST VOLUME A/N: 540262					
SELECTIVE CATALYTIC REDUCTION, HALDOR TOPSOE, TITANIUM./VANADIUM/TUNGSTEN, SERVING UNIT NO.2C, WITH 20 MODULES, 140.8 CU. FEET OF TOTAL CATALYST VOLUME WITH A/N: 540262	C166			NH3: 5 PPM (4) [RULE 1303(a)(1)-BACT]	A195.9, D12.7, D12.8, D12.9, E179.4, E179.5, E193.4
AMMONIA INJECTION, INJECTION GRID	(B167)				
STACK SERVING UNIT NO. 2C, 120' H. X 18' DIA. A/N: 539770	S168				
PROCESS 4: AMMONIA STORAGE					
STORAGE TANK, HORIZONTAL, 28'5" L X 6' DIA, AQUEOUS AMMONIA 19%, 24000 GALS A/N: 540255	D169				E144.1, C157.1, E193.4
PROCESS 5: WASTE WATER TREATMENT					
OIL WATER SEPARATOR A/N: 549121	D170				

BACKGROUND:

The Huntington Beach Energy Project (HBEP) is a proposed 1,032 MW (nominal) combined cycle power plant to be located at the existing site of the Huntington Beach Generating Station plant in Huntington Beach, approximately 900 feet from the Pacific Ocean. The surrounding area is a mix of residential, wetland preserve, public beach, and industrial, and is bordered by a manufactured home/recreation vehicle park on the west, Huntington Beach Channel and residential areas to the north and east, a tank farm to the north, the Huntington Beach Wetland Preserve/Magnolia Marsh wetlands on the



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 12	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

southeast, and the Huntington Beach State Park and the Pacific Ocean to the south and southwest. The entire parcel on which the Huntington Beach Generating Station is located, including the switchyard and tank farm, is approximately 106 acres, and the new plant will be constructed on about 28.6 of those acres. The nearest inhabitants to the proposed project site is a residential area approximately 300-400 feet from the site. The site location map is presented in Figure 1.1. The HBEP plot plan is presented in Appendix G.

The current Huntington Beach facility consists of 2 utility boilers. Boilers 1 and 2 are identical units, each rated at 215 MWs output and 2021 mmbtu/hr input. The boilers are equipped with SCR systems, and are fired on natural gas exclusively. The boilers were built in the 1950's. There are two 275 hp diesel-fueled emergency engines installed in 2001 for fire control, a 30,000 gallon urea storage tank, and two urea-to-ammonia converters. The urea is used in the SCR systems, and is converted into ammonia before injection into the boiler exhaust with the use of the urea-ammonia converters. There is also an old peaker turbine (Unit 5) that has been shutdown and no longer operates, as well as Boilers 3 and 4, which have also been shutdown.

The current ownership of the equipment at the site is split between AES Huntington Beach, LLC which owns Boilers 1 and 2, the two the emergency engines, and the urea storage tank, and Edison Mission Energy, LLC which purchased Boilers 3 and 4 and permanently retired them in November 2012. AES Huntington Beach is the operator for all the equipment on site.

The dismantling of Boilers 3 and 4 will begin in the second quarter 2015. It should be noted that the shutdown of Boilers 3 and 4 are not a part of the HBEP. The capacity for these units were replaced by a power project in City of Industry not owned or operated by AES.

Boilers 1 and 2, along with their SCR systems, urea storage tank, and urea to ammonia reactor will be shutdown concurrent with the new turbines coming on line, and will be dismantled beginning in 4th quarter 2020.

AES has also proposed to shutdown Boiler 6, rated at 1785 mmbtu heat input and 175 MW output, and Boiler 8, rated at 4752.2 mmbtu/hr heat input and 480 MW output, at the AES Redondo Beach facility, as part of this project. Total generating capacity being retired as part of this project is 1,085 MWs.

The proposed new facility will be a combined cycle power plant capable of producing a nominal power output of 1,032 MW net, and consisting of six combustion turbine generators (CTG), six heat recovery steam generators (HRSG) with duct burners, two steam turbine generators (STG), with auxiliary equipment including an aqueous ammonia storage tank.



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 13	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

AES Huntington Beach, LLC, a wholly owned subsidiary of AES Southland Corp. will be the facility owner and operator of the new plant.

The plant will be designed to supply power to the wholesale energy market through the existing substation adjacent to the property (to the north-east). Output will depend on market conditions and dispatch requirements. The plant's expected availability is over 98% on an annual basis, with the actual capacity factor anticipated to be between 35-50%. AES expects the plant to be dispatched at intermediate and minimum loads on a regular basis. Therefore, the plant is designed to have the ability to start quickly - cold starts should be 90 minutes or less, and can operate with only one or two turbines online at any given time.

The following applications for the project were submitted on June 26 and July 18, 2012:

Table 1.1 – Project Application Numbers

Application Number	Equipment Description
539746	Mitsubishi Gas Turbine #1A
539747	Mitsubishi Gas Turbine #1B
539748	Mitsubishi Gas Turbine #1C
539768	Mitsubishi Gas Turbine #2A
539769	Mitsubishi Gas Turbine #2B
539770	Mitsubishi Gas Turbine #2C
540256	SCR/CO Catalyst #1A
540257	SCR/CO Catalyst # 1B
540258	SCR/CO Catalyst #1C
540260	SCR/CO Catalyst #2A
540261	SCR/CO Catalyst #2B
540262	SCR/CO Catalyst #2C
540255	Aqueous Ammonia Storage Tank
540259	Title V/RECLAIM Significant Revision
549121	Oil/Water Separator

The applications were deemed substantially complete on July 24, 2012. Refer to Appendix O for fees paid.

The plant will be evaluated as a significant revision to the existing Title V permit at the AES, Huntington Beach site (facility ID# 115389). The new project is also subject to the NOx and SOx RECLAIM and PSD regulations for NO2, SOx, CO, GHG, and PM10. The plant is considered a major revision to a major stationary source under Regulation XIII, and as such is subject to the full requirements of New Source Review. Other major



**South Coast
Air Quality Management District**


Engineering Division
Application Processing & Calculations

PAGE 14	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

environmental regulations that apply to the new project are 40 CFR72 – Acid Rain, 40CFR 60 Subpart KKKK – New Source Performance Standards for Gas Turbines, and AQMD Rule 1401 – Toxics. The project is also subject to the California Energy Commissioning licensing procedure and an Application for Certification (AFC) has been submitted with that agency (2012-AFC-02).

Construction of Block 1 (turbines 1A, 1B, and 1C) is scheduled to begin in 2nd quarter 2015 and end in the 3rd quarter of 2018. Construction of Block 2 (turbines 2A, 2B, and 2C) is scheduled to begin in the 1st quarter of 2018 and end in the 2nd quarter of 2020.

Figure 1.1 –Site Location

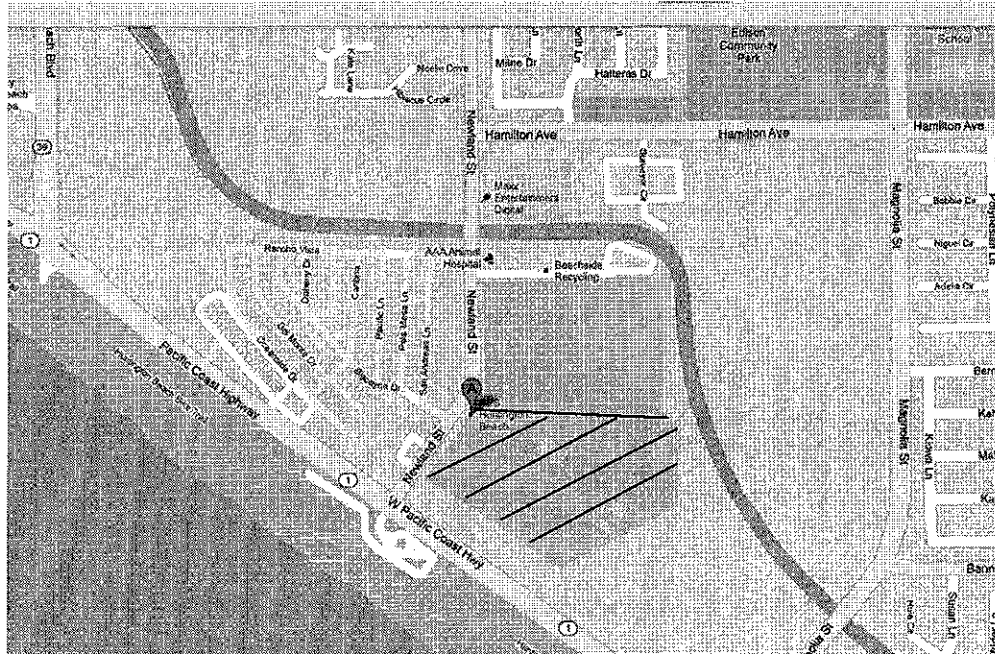

Compliance History

The following information was obtained from the District’s Compliance Tracking System for the 5-year period from 1/01/08 to 1/09/14 for the AES Huntington Beach facility.

Notice to Comply D03506

Issued 01/29/09 for failure to submit R218 CO emissions reports and RECLAIM NOx quarterly reports (QCER) in a timely manner. The follow up status is ‘in compliance.’

Notice to Comply D03529



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 15	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

Issued 12/01/10 for failure to include all equipment in the RECLAIM quarterly reports (QCER). The follow up status is 'in compliance.'

Notice to Comply E09956

Issued 10/14/11 for failure to comply with testing condition D28.3 and D29.3 including testing for a 60 minute period. The follow up status is 'in compliance.'

Notice of Violation P52182

Issued on 10/27/11 for exceeding the start up NOx limit of 38.4 lbs/hr for Boiler #4. This is a closed case.

There were no complaints associated with the facility for the stated time period in the AQMD database. The facility has also submitted a statement certifying that all facilities owner and operated in the state are currently in compliance with all applicable air quality regulations, as required by Rule 1303.

PROCESS DESCRIPTION:

The gas turbine facility will consist of 6 Mitsubishi 501DA combustion turbine generators (CTG), each rated at 121.8 MW's (nominal), equipped with dry low NOx combustors and evaporative inlet air cooling, 6 heat recovery steam generators (HRSG) each with a 507 MM Btu/hr duct burner, an SCR and an oxidation catalyst, and a two steam turbine generators (STG), each rated at 148.7 MW's (nominal). The plant will be configured in a 'three-on-one' arrangement with one arrangement designated as 'Block 1' and the other as 'Block 2'. Each block is independently operated and will consist of 3 CTGs, 3 HRSGs, and 1 STG.

Each combustion turbine will vent to a stack 120 feet tall. 19% aqueous ammonia for the SCRs will be stored in a 24,000 gallon tank.

The system output will vary depending on the ambient air temperature condition, use of evaporative coolers, amount of auxiliary load, generator power factor, the amount of supplemental firing in the duct burners, and other factors. Additionally, there is a transmission line interconnect limitation at the Huntington Beach plant which restricts the total plant output. At the site low temperature (maximum output case), the plant total output is restricted to 939 MWs. The tables below show the output on a per turbine basis, and each turbine can operate at full load capacity, the limitation is only at the transmission line. So although the potential gross plant output at low temperature conditions would be calculated based on Table 2.1 below as 1,091 MWs (181.835 MWs* 6 turbines), the line restriction limits transmission output to 939 MW.



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 16	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

Table 2.1 Plant Output Per Turbine 3-on-1 Operation

	ISO 59 F- 60% RH (Evaporative Cooling Off)	110 F-8% RH (Evaporative Cooling On)	32 F – 87% RH (Evaporative Cooling Off)	66 F – 58% RH (Evaporative Cooling On)
Gas Turbine Heat Input, mmbtu/h HHV	1,388	1,350	1,498	1,403
Total Heat Input, mmbtu/h HHV (w/duct fire) ¹	1,388	1,350	1,498	1,403
Gas Turbine Gross Output ² , kW	121,435	115,264	132,256	121,840
Steam Turbine Gross Output ³ , kW	51,865	43,632	49,579	50,192
Total Gross Power Output ⁴ , kW	173,300	158,896	181,835	172,032
Net Power Output, Kw	167,583	153,352	175,925	166,328
Net Plant Heat Rate, btu/kWh, LHV	7,354	7,814	7,558	7,487
Net Plant Heat Rate, btu/kWh, HHV	8,285	8,803	8,516	8,435
Net Plant Efficiency, %, HHV	41.2	38.8	40.1	40.5

- 1 there is no duct firing when the plant operating in 3-on-1 mode
- 2 on a per turbine basis
- 3 1/3 of the total steam turbine output
- 4 multiply by 3 to get the output per power block

Table 2.2 Plant Output Per Turbine 2-on-1 Operation

	85 F – 46% RH (Evaporative Cooling On)	66 F – 58% RH (Evaporative Cooling On)
Gas Turbine Heat Input, mmbtu/h HHV	1,354	1,403
Total Heat Input, mmbtu/h HHV (w/duct fire)	1,861	1,910
Gas Turbine Gross Output, kW	115,962	121,840
Steam Turbine Gross Output, kW	49,751	51,320
Total Gross Power Output, kW	165,713	173,160
Net Power Output, Kw	159,682	167,018
Net Plant Heat Rate, btu/kWh, LHV ¹	7,503.9	7,433.9
Net Plant Heat Rate, btu/kWh, HHV ¹	8,479.4	8,400.3
Net Plant Efficiency, %, HHV	40.3	40.7

- 1 duct burners are used for ramp speed and not for power augmentation, therefore heat rate is calculated assuming no duct firing



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 17	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

Table 2.3 Plant Output Per Turbine 1-on-1 Operation

	85 F – 46% RH (Evaporative Cooling On)	66 F – 58% RH (Evaporative Cooling On)
Gas Turbine Heat Input, mmbtu/h HHV	1,354	1,403
Total Heat Input, mmbtu/h HHV (w/duct fire)	1,861	1,910
Gas Turbine Gross Output, kW	115,962	121,840
Steam Turbine Gross Output, kW	47,192	49,382
Total Gross Power Output, kW	163,154	171,222
Net Power Output, Kw	155,661	163,611
Net Plant Heat Rate, btu/kWh, LHV ¹	7,697.7	7,588.7
Net Plant Heat Rate, btu/kWh, HHV ¹	8,698.4	8,575.2
Net Plant Heat Rate, %, HHV	39.3	39.8

¹ duct burners are used for ramp speed and not for power augmentation, therefore heat rate is calculated assuming no duct firing

There will be no new transmission lines or gas lines needed for the project.

Each of the components is discussed in more detail below:

- *Combustion Turbines*

The Mitsubishi 501DA units are rated at 121.8 MW nominal and 132.3 MW maximum (@ 32°F) each, and arranged in a three-on-one configuration. Each turbine will be equipped with inlet air filters and coolers. The turbines will combust natural gas exclusively. Total heat input for 6 turbines at nominal conditions is 8,418 mmbtu/hr (HHV), fuel use at these conditions is approximately 8.02 mmcf/hr, based on a natural gas heat content of 1050 btu/cf. Pertinent turbines specs are summarized below:



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 18	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

Table 2.2 Turbine Data

Specification	
CT Manufacturer	Mitsubishi
Model	501DA
Fuel Type	Natural gas
Maximum Power Output	132.3 MW (1 turbine @ 32 deg, no duct firing)
Maximum Heat Input without duct firing	1,498 mmbtu/hr HHV (1 turbine @ 32 deg)
Maximum Fuel Consumption	1.43 mmcf/hr HHV (1 turbine @ 32 deg, 1050 btu/cf)
Maximum Exhaust Flow	46.2 mmcf/hr, dry @ 15% O2 (1 turbine @ 32 deg)
Duct Burner Maximum Heat Input	507 mmbtu/hr HHV
Maximum Heat Input with duct firing	2005 mmbtu/hr HHV (1 turbine + DB @ 32 deg)
Combined CT and DB Exhaust Flow	61.8 mmcf/hr, dry @ 15% O2 (@ 32 deg)
Duct Burner Maximum Fuel Consumption	0.48 mmcf/hr
NOx Combustion Control	DLN 9 ppm
Post Combustion Control	SCR 2.0 ppm 1 hour average
Ammonia Injection Rate per turbine	256.3 lbs/hr maximum
Steam Turbine Output at 63°F Ambient	300.7 MW (@ 66 deg)
Net Plant Heat Rate, LHV	7,354 btu/Kw @ ISO
Net Plant Heat Rate, HHV	8,285 btu/Kw @ ISO
Net Plant Efficiency, HHV	41.2%

The 501DA turbines from Mitsubishi were initially developed by Westinghouse in the late 70's and was based on their W251 product which was the first commercial gas turbine employed in the United States (1949). The 501D turbines first began commercially operating in the early '80's. Later that decade, Westinghouse and Mitsubishi Heavy Industries (MHI) entered into an agreement to co-fabricate the 501 product line, and in 2001, MHI acquired all rights to the 501D turbine design.

The 501D product line has since been upgraded and redeveloped. The turbines AES will be using for the HBEP project deploy the latest generation of the 501D which includes the use of the 501F-class rotor in the D machine which has enabled the fast start and ramp capability.

These turbines are not the most efficient units on the market when compared to other F and G class turbines. However, the applicant anticipates that the operating profile of the plant will include the need for rapid starting and frequent ramping. They have chosen the 501D turbines because the units exhibit fairly consistent heat rates throughout the expected operating range required for HBEP. The anticipated load range for the HBEP is approximately 160 to 528 MW for each 3X1 power island. The heat rate for this operating range is estimated to be 8,800 to 8,140 btu/kWh HHV (38.8% - 41.9%).

Each turbine will exhaust to a Heat Recovery Steam Generator (HRSG). The HRSGs are designed to convert heat from the exhaust gas to produce steam for use in the steam



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 19	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

turbine. Exhaust gases enter the HRSG at approximately 1000 deg F. The HRSG's employ a single pressure design. Feed water into the HRSG will be converted to high pressure steam for use in the steam turbine. The steam exits the steam turbine as low pressure steam, enters the air cooled condenser, and is cooled and condensed back into water.

The HRSGs will contain duct burners and the Air Pollution Control (APC) equipment. Each HRSG will vent to a separate exhaust stack.

- *Air Pollution Control (APC) Equipment*

APC equipment will be installed to control NO_x, CO, and VOC from the gas turbines. Each APC system will consist of the following: 1) Dry Low NO_x (DLN) Burners, 2) SCR, and 3) Oxidation catalyst.

Dry Low NO_x Combustor - Each CT will include built-in pollution controls based on a dry combustion design (dry low-NO_x combustor) to reduce NO_x emissions. This control will reduce NO_x emissions to 9 parts-per-million volume dry basis (ppmvd) at 15 percent oxygen (O₂). The dry low NO_x control will be fully operational when the turbine reaches a load of approximately 70 percent or more.

Oxidation Catalyst System - An oxidation catalyst will be installed in the HRSG section of the turbine. The catalyst will be designed to reduce exhaust gas CO by about 80-85% to 2.0 ppm or less at 15% O₂, and VOC by 65-70% to 2.0 ppm at 15% O₂.

Table 2.3 Oxidation Catalyst Data

Specification	
Manufacturer	Johnson Matthey
Catalyst Type	Palladium in a honeycomb structure
Catalyst Volume	208.3 ft ³
Catalyst Area	1225.2 ft ²
Reactor Dimensions	20'L X 20'W X 66'H (includes SCR catalyst housing)
Space Velocity	348.4 hr ⁻¹ based on 72,582 ft ³ /hr exhaust
Area Velocity	59.2 ft/hr based on 72,582 ft ³ /hr exhaust
CO Removal Efficiency	80-85%
Outlet CO	2.0 ppmvd at 15% O ₂
VOC Removal Efficiency	65-70%
Outlet VOC	2.0 ppmvd at 15% O ₂
Minimum operating temperature	500 °F

Selective Catalytic Reduction System - An SCR catalyst will be installed in the HRSG to reduce NO_x emissions to 2.0 ppmvd at 15% O₂ on a 1 hour average at loads above 60%. The SCR catalyst will be located downstream of the CO catalyst, and will consist of a vanadium/titanium/tungsten type catalyst in a honeycomb structure. Each SCR module is approximately 10' wide X 6.5' high X 2' deep. The modules are arranged two across



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 20	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

(20') and 10 high (65') for a total of 20 modules in 1 layer. Total catalyst volume is about 2817 ft³. Aqueous ammonia (ammonium hydroxide at 19% concentration by weight) from the storage tank will be vaporized, diluted with air, and injection into the exhaust through an injection grid. The amount of ammonia injected will vary depending on NOx reduction requirements, but will be approximately a 1:1 molar ratio of ammonia to NOx.

Table 2.4 SCR Catalyst Data

Specification	
Manufacturer	Halder Topsoe
Catalyst Type	Titanium/Vanadium/Tungsten honeycomb
Catalyst Volume	2810.5 ft ³
Catalyst Area	1338.3 ft ²
Reactor Dimensions	20'L X 20'W X 66'H (includes CO catalyst housing)
Space Velocity	25.8 hr ⁻¹ based on 72,582 ft ³ /hr exhaust
Area Velocity	54.2 ft/hr based on 72,582 ft ³ /hr exhaust
Ammonia Injection Rate	255.8 lbm/hr
Ammonia Slip	5.0 ppm
Outlet NOx	2.0 ppm at 15%
Guarantee	24,000 hours of operation, or 3 years
SCR/CO catalyst Total Cost	\$1.1 million
Operating temperature range	400 °F-700°F

- *Exhaust Stacks*

Each turbine/HRSG will be equipped with identical 19-foot diameter 150.5 feet tall stacks. The stacks will contain sampling ports for exhaust gas testing.

Table 2.5 Stack Data

Specification	
Stack Diameter	18 feet
Stack Height	120 feet
Stack Area	254.3 ft ²
Exhaust gas temperature	376 deg F
Exhaust gas volume	48.4 mmscfh @ 105 deg F - 74.3 mmscfh @ 25 deg F, dry @15% O2
Exhaust gas velocity	10.2 feet/min @ 105 deg F - 15.7 feet/min @ 25 deg F

- *Duct Burners*

Each HRSG will be fitted with a duct burner rated at 507 mmbtu/hr HHV. For the HBEP, the duct burners will be used in 2 scenarios. First, in the traditional sense, duct firing will occur to boost peak output during 1-on-1 and 2-on-1 turbine operation. Duct firing will also occur during turbine load ramping to allow quicker transitions to higher output levels. Duct burning will not occur when the turbines are operated in a 3-on-1 mode.



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 21	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

• *Monitoring Systems*

Each turbine will be equipped with continuous stack monitors for NOx, CO, and O2, along with a fuel meter. A data acquisition system is required to collect information from the analyzers and fuel meters to calculate exhaust flows and mass emissions of NOx for transmission through the remote terminal unit (RTU). Other parameters which are required to be measured and recorded include the ammonia injection rate, exhaust temperature prior to the SCR catalyst, CTG output, and pressure drop across the SCR catalyst. A NOx analyzer will be placed upstream of the SCR catalyst for fine tuning the ammonia injection rate and also for use in estimating ammonia slip.

The plant is designed with a full steam bypass; however, the cold and warm start times are limited by the maximum safe temperature ramp rate of the high-pressure drum's metal construction. The bypass is installed to allow rapid depressurization of the steam cycle, it would not be used for normal operations.

• *Ammonia Storage Tank*

The 24,000 gallon ammonia tank will store a 19% aqueous ammonia solution for use in the turbines' SCRs. The tank is a horizontal pressure vessel with a PRVs set at 50 psig. During loading, vapors from the tanks are vented back to the filling truck through the vapor return line. The tank is designed so that under normal operating conditions, the pressure will not exceed the prv setting.

Expected average ammonia use is about 34.1 gallons per hour (255.8 lbs/hr/7.5 lbs/gal) per CTG/HRSG system. At a maximum annual turbine capacity factor of 0.7, estimated annual aqueous ammonia use is 1,254,607 gallons (34.1 X 24 X 365 X 0.7 X 6 turbines), or about 52 tank turnovers per year (1 per week on average).

• *Cooling System*

There are no cooling towers associated with this project, the turbines will be air cooled. Exhaust steam from the STGs will be condensed in two air-cooled condensers. The air-cooled condenser will utilize large fans to blow ambient air across finned tubes through which the low-pressure steam flows. The condensate collects in a receiver located under the air-cooled condenser, Condensate pumps will then return the condensate from the receiver back to the HRSGs for reuse.

• *Oil Water Separator*

There will be one new oil water separator (OWS) installed to serve the new power system. The OWS will collect potentially oily wastewater from equipment area wash downs and the HRSG feed water pump skid. The only potential oil contaminant is lubricating oil associated with the gas turbines and associated feed water pumps. Oil will be collected in the OWS and will be removed by vacuum truck before the oil collection section reaches its capacity.



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 22	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

EMISSIONS:

Emissions from the gas turbine will consist of NO_x, CO, CO_{2e}, VOC, PM₁₀, PM_{2.5}, and SO_x, plus toxics. Emissions are calculated for 4 basic operational modes as follows:

1. commissioning – a 1 time event which occurs following installation and just prior to bringing the turbine online for commercial operation
2. start up – occurs each time the turbine is started
3. normal operation
4. shutdown – occurs each time the turbine is shutdown

Table 3.1 - Operational Scenarios for HBEP

Scenario	Description
Commissioning	The commissioning operation will require each CT to operate individually as well as simultaneously under part load and full load. The testing will be performed on each CT for the purpose of “tuning in” the turbine combustor and control systems. Emissions are expected to be higher than normal operation. The commissioning will take about 491 operating hours per turbine over a period of about 180 days.
Startup	There are 3 types of starts – cold, warm, and hot. Cold starts occur after the turbine has been down for 49 or more hours, and the “start” will last about 1.5 hours (the time to reach proper operating temperature for full DLN, SCR and CO catalyst control). Warm starts occur after the turbine has been down 9 to 49 hours, and will last 32.5 minutes. Hot starts occur when the turbine has been down less than 9 hours, and will last 32.5 minutes. Applicant anticipates 24 cold, 150 warm, and 450 hot starts per year, (this equates to about 361 hours per year in start up mode).
Normal Operating	Normal operation is defined as when the turbine is operating at fully controlled levels (ie 2.0 ppm NO _x and CO, and 2.0 ppm VOC). The turbines will operate with and without duct burner firing. Total operation in normal mode with duct burner firing is estimated at 470 hrs per year, and without duct burner firing 5900 hrs per year.
Shutdown	During a turbine shutdown, the emission controls will continue to operate down to a level of 60% load. The final 10 minutes of the shutdown process will be partially to completely uncontrolled. There will be a maximum of 624 shutdowns per year (@ 10 minutes each = 104 hrs per year).



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 23	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

Operating Schedule

AES has proposed the following operating schedule for the plant:

	Monthly		Annual	
	Maximum # of Events	Maximum Hours of Operation	Maximum # of Events	Maximum Hours of Operation
Hot Starts	60	32.5	450	243.75
Warm Starts	25	13.5	150	81.25
Cold Starts	5	7.5	24	36
Shutdowns	90	15	624	104
Normal Operation without duct firing	//////////	489.5	//////////	5900
Normal Operation with duct firing	//////////	186	//////////	470
TOTAL	//////////	744	//////////	6835

Emission calculations can be referenced in Appendix A.

Hourly Emissions

Table 3.2 Maximum Hourly Emissions Normal Operation (1 Turbine)

Pollutant	Uncontrolled Hourly Emissions (with duct firing)	Uncontrolled Hourly Emissions (without duct firing)	Controlled Hourly Emissions (with duct firing)	Controlled Hourly Emissions (without duct firing)
NOx	66.6	30.3	14.8	11.0
CO	45.0	33.5	9.0	6.7
VOC	5.1	3.8	5.1	3.8
PM10	9.5	4.5	9.5	4.5
SOx	2.78	2.08	2.78	2.08
NH3	//////////	//////////	13.8	10.3

Uncontrolled emission rates based on DLN without SCR, NOx=9 ppm, CO=10 ppm, VOC=2 ppm



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 24	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

Table 3.3 Maximum Hourly And Total Emissions Start Ups and Shutdowns (1 Turbine)

Pollutant	Cold Start, 90 minutes		Warm Start, 32.5 minutes		Hot Start, 32.5 minutes		Shutdown, 10 minutes	
	lbs/hr ³	Lbs/event	lbs/hr ³	Lbs/event	lb/hr ³	Lbs/event	lbs/hr ³	Lbs/event
NOx	25.5	28.7 ¹	23.2	16.6	23.2	16.6	17.8	9.0
CO	115.3	115.9 ¹	50.0	46.0	37.6	33.6	50.7	45.3
VOC	25.9	27.9 ¹	21.6	21.0	21.0	20.4	31.8	31.0
PM10 ²	4.5	6.75	9.5	2.44	9.5	2.44	4.5	0.75
SOx ²	1.97	3.12	2.64	1.13	2.64	1.13	1.97	0.33

- (1) The NOx, CO, and VOC emissions in this table are as reported by AES
- (2) The units cannot use duct firing during cold start ups, but can during warm or hot starts
- (3) The lbs/hr numbers represent the highest hour during the event

Table 3.4 Highest Single Hour Emissions (1 Turbine)

Pollutant	Operating Scenario	Emissions, lbs/hr
NOx	Cold Start	25.5
CO	Cold Start	115
VOC	Shutdown	31.8
PM10	Normal Operation with Duct Firing	9.5
SOx	Normal Operation with Duct Firing	2.78
NH3	Normal Operation with Duct Firing	13.8

Table 3.5 Highest Single Hour Emissions (6 Turbines)

Pollutant	Operating Scenario	Emissions, lbs/hr
NOx	Cold Start	172.2
CO	Cold Start	695.4
VOC	Shutdown	186
PM10	Normal Operation with Duct Firing	47
SOx	Normal Operation with Duct Firing	16.68
NH3	Normal Operation with Duct Firing	82.8

Note: the HBEP power blocks cannot fire duct burners in all three HRSGs while the turbines are operated at base load. Therefore, the highest single hour PM10 emission rate is 47 lbs/hr (9.5 lbs/hr * 4 turbines + 4.5 lbs/hr * 2 turbines)



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 25	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

Daily Emissions

Table 3.7 Estimated Daily Emissions (1 Turbine)

Pollutant	Operating Scenario	Uncontrolled Daily Emissions	Controlled Daily Emissions
NOx	1 cold start + 3 hot starts + 4 shutdowns + 18.7 hrs normal with 5 hrs duct firing	895.80	339.20
CO	1 cold start + 3 hot starts + 4 shutdowns + 18.7 hrs normal with 5 hrs duct firing	1081.85	534.69
VOC	1 cold start + 3 hot starts + 4 shutdowns + 18.7 hrs normal with 5 hrs duct firing	290.66	290.66
PM10	24 hr normal with 5 hrs duct firing	133.00	133.00
SOx	24 hr normal with 5 hrs duct firing	53.42	53.42
NH3	24 hr normal with 5 hrs duct firing	//////////	264.70

1 cold start = 1.5 hrs, 3 hot starts = 1.63 hrs, 4 shutdowns = 0.67 hrs, downtime between starts = 1.5 hrs, remaining time at 100% load with 5 hrs duct firing

Table 3.8 Estimated Daily Emissions (6 Turbines)

Pollutant	Operating Scenario Per Turbine	Controlled Daily Emissions
NOx	1 cold start + 3 hot starts + 4 shutdowns + 18.7 hrs normal with 5 hrs duct firing	2035.20
CO	1 cold start + 3 hot starts + 4 shutdowns + 18.7 hrs normal with 5 hrs duct firing	3208.14
VOC	1 cold start + 3 hot starts + 4 shutdowns + 18.7 hrs normal with 5 hrs duct firing	1743.96
PM10	24 hr normal with 5 hrs duct firing	798
SOx	24 hr normal with 5 hrs duct firing	320.5
NH3	24 hr normal with 5 hrs duct firing	1588.2

1 cold start = 1.5 hrs, 3 hot starts = 1.63 hrs, 4 shutdowns = 0.67 hrs, downtime between starts = 1.5 hrs, remaining time at 100% load with 5 hrs duct firing



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 26	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

Monthly Emissions

Table 3.9 Monthly Total and 30-Day Average Emissions (1 Turbine)

Pollutant	Operating Scenario	Total Monthly Emissions	30-Day Average Emissions
NOx	5 cold starts+25 warm starts+60 hot starts+90 shutdowns+489.5 hrs normal w/o DB + 186 hrs normal with DB	10,501.8	350.1
CO	5 cold starts+25 warm starts+60 hot starts+90 shutdowns+489.5 hrs normal w/o DB + 186 hrs normal with DB	12,776.15	425.9
VOC	5 cold starts+25 warm starts+60 hot starts+90 shutdowns+489.5 hrs normal w/o DB + 186 hrs normal with DB	7,487.2	249.6
PM10	5 cold starts+25 warm starts+60 hot starts+90 shutdowns+489.5 hrs normal w/o DB + 186 hrs normal with DB	4278.00	142.6
SOx	744 hrs normal with 186 hrs duct firing	1677.72	55.92

5 cold starts = 7.5 hrs, 25 warm starts = 13.54 hrs, 60 hot starts = 32.5 hrs, 90 shutdowns = 15 hrs, remaining hours assumed at 100% load (31 days)

Table 3.10 Monthly Total and 30-Day Average Emissions (6 Turbines)

Pollutant	Operating Scenario Per Turbine	Total Monthly Emissions	30-Day Average Emissions
NOx	5 cold starts+25 warm starts+60 hot starts+90 shutdowns+489.5 hrs normal w/o DB + 186 hrs normal with DB	63010.8	2100.6
CO	5 cold starts+25 warm starts+60 hot starts+90 shutdowns+489.5 hrs normal w/o DB + 186 hrs normal with DB	76656.9	2555.4
VOC	5 cold starts+25 warm starts+60 hot starts+90 shutdowns+489.5 hrs normal w/o DB + 186 hrs normal with DB	44923.2	1497.6
PM10	5 cold starts+25 warm starts+60 hot starts+90 shutdowns+489.5 hrs normal w/o DB + 186 hrs normal with DB	25668	855.6
SOx	744 hrs normal with 186 hrs duct firing	10066.32	335.52



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 27	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

Annual Emissions

Table 3.11 Commissioning Emissions (Per Block)

Pollutant	Emissions, 1 Turbine	Total Emissions, 3 Turbines	
	Lbs	Lbs	Tons
NOx	8,282	24,846	12.4
CO	112,882	338,646	169.3
VOC	14,121	42,363	21.2
PM10	2,930	8,790	4.4
SOx	1,064	3192	1.6

Table 3.12-Annual Emissions Commissioning Year, 6 Turbines

Pollutant	Normal Emissions, 6 Turbines ¹	Commissioning Emissions, 3 Turbines ²	Total Annual Emissions	
	Lbs	Lbs	Lbs/yr	Tpy
NOx	383,166.6	24,846.0	408,012.6	204.0
CO	428,085.6	335,646.0	763,761.6	381.9
VOC	253,400.7	42,363.0	295,763.7	147.9
PM10	148,990.5	8790.0	157,780.5	78.9
SOx	22,881.2	3,192.0	26,073.2	13.0
NH3	235,396.0	0	235,396.0	117.7

(1) Includes a full 12 months of Block 1 normal operation plus approximately 6 months of normal operation for Block 2.

(2) Block 2 commissioning

Table 3.13 Annual Emissions Non-Commissioning Year, 6 Turbines

Pollutant	Total Annual Emissions, 6 Turbines	
	Lbs/yr	Tpy
NOx	501,970.8	264.4
CO	565,684.8	290.5
VOC	335,319.6	17.5
PM10	198,654.0	99.3
SOx	30,508.2	43.6
NH3	403,536.0	201.8
CO2e	7.834E+9	3,916,962

1- assumes 24 cold starts, 150 warm starts, 450 hot starts, 642 shutdowns, 6370 hours of normal operation (470 hours with duct firing and 5900 w/o duct firing)



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE
28

PAGES
141

APPL NO.
See Below

DATE
4/1/14

PROCESSED BY
CP01

CHECKED BY

Toxic Emissions

Table 3.14 Toxic Emissions

Pollutant	Annual Emissions 1 Turbine, lbs/yr	Annual Emissions 6 Turbines, lbs/yr
Ammonia	8.61E+04	5.17E+05
Acetaldehyde	3.93E+02	2.36E+03
Acolein	6.29E+01	3.77E+02
Benzene	1.18E+02	7.08E+02
1,3 Butadiene	4.23E+00	2.54E+01
Ethyl Benzene	3.14E+02	1.88E+03
Formaldehyde	2.83E+03	1.70E+04
Naphthalene	1.28E+01	7.68E+01
PAH	8.85E+00	5.31E+01
Propylene Oxide	2.85E+02	1.71E+03
Toluene	1.28E+03	7.68E+03
Xylene	6.29E+02	3.77E+03
	Total, lbs/yr	522,227
	Tons/yr	276.1

EVALUATION:

RULE 212-Standards for Approving Permits

This project is subject to Rule 212 public notice requirements because the daily maximum VOC, CO, NO_x, and PM₁₀ emissions from the project will all exceed the emissions thresholds specified in subdivision (g) of this rule. The facility is not located within 1000 feet of a school (the closest school is Edison High located approximately 0.6 miles north-east of the site). The District will prepare the public notice and it will contain sufficient information to fully describe the project.

In accordance with subdivision (d) of this rule, the applicant will be required to distribute the public notice to each address within ¼ mile radius of the project.

Subdivision (g) requires that the public notification and comment process include all applicable provisions of 40 CFR Part 51, Section 51.161(b) and 40 CFR Part 124, Section



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 29	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

124.10. The minimum requirements specified in the above documents are included in paragraphs (g)(1), (g)(2), and (g)(3).

In accordance with paragraph (g)(1) of this rule, the District will make the following information available for public inspection at the Huntington Beach Public Library located at 7111 Talbert Ave, Huntington Beach 92648, during the 30-day comment period: public notice, project information submitted by the applicant, and the District's permit to construct evaluation.

In accordance with paragraph (g)(2) of this rule, the public notice will be published in a newspaper which serves the area that will be impacted by the project.

In accordance with paragraph (g)(3) of this rule, the public notice will be mailed to the following persons: the applicant, the Region IX EPA administrator, the ARB, the chief executives of the city and county where the project will be located, the regional land use planning agency, and the state and federal land managers whose lands may be affected by the emissions from the proposed project.

After the public notice is published, there will be a 30-day period for submittal of public comments.

RULE 218 – Continuous Emission Monitoring

In order to insure the equipment meets the CO BACT limit as specified in the permit, a CO CEMS will be required by permit condition. The CO CEMS must be certified in accordance with Rule 218. The rule requires submittal of an “Application for CEMS” for approval. Once approved, CEMS data must be recorded and records of the data must be maintained on site for at least 2 years. Additionally, every 6 months a summary of the CEMS data must be submitted to AQMD. Any CEMS breakdowns must also be reported. Compliance with this rule is expected.

RULE 401 – Visible Emissions

This rule limits visible emissions to an opacity of less than 20 percent (Ringlemann No.1), as published by the United States Bureau of Mines. Visible emissions are not expected during normal operation from the turbines or ammonia tank.

RULE 402 - Nuisance

This rule requires that a person not discharge from any source whatsoever such quantities of air contaminants or other material which cause injury, detriment, nuisance, or annoyance to any considerable number of persons or to the public, or which cause, or have a natural tendency to cause injury or damage to business or property. The turbines



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 30	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

and ammonia tank are not expected to create nuisance problems under normal operating conditions.

RULE 403 – Fugitive Dust

The purpose of this rule is to reduce the amount of particulate matter entrained in the ambient air as a result of man-made fugitive dust sources by requiring actions to prevent, reduce, or mitigate fugitive dust emissions. The provisions of this rule apply to any activity or man-made condition capable of generating fugitive dust. This rule prohibits emissions of fugitive dust beyond the property line of the emission source. The applicant will be taking steps to prevent and/or reduce or mitigate fugitive dust emissions from the project site. They have proposed the following measures:

- Watering unpaved roads and disturbed areas
- Limiting onsite vehicle speeds to 10 mph and posting the speed limit
- Frequent watering during periods of high winds when excavation/grading is occurring
- Sweeping onsite paved roads and entrance roads on an as-needed basis
- Replacing ground cover in disturbed areas as soon as practical
- Covering truck loads when hauling materials that could be entrained during transit
- Applying dust suppressants or covers to soil stockpiles and disturbed areas when inactive for more than 2 weeks

In addition, the applicant will need to implement all Best Available Control Measures listed in Table 1 of the rule.

The installation and operation of the turbines and associated equipment is expected to comply with this rule.

RULE 407 – Liquid and Gaseous Air Contaminants

This rule limits CO emissions to 2000 ppmv. The SO2 portion of the rule does not apply as the natural gas fired in the turbines will be subject to the sulfur limit in Rule 431.1. The CO emissions from the turbines will be controlled by an oxidation catalyst to 2.0 ppmvd at 15% O2. Therefore, compliance with this rule is expected.

RULE 409 – Combustion Contaminants

This rule restricts the discharge of contaminants from the combustion of fuel to 0.23 grams per cubic meter (0.1 grain per cubic foot) of gas, calculated to 12% CO2, averaged over 15 minutes. The turbines are expected to meet this limit at the maximum firing load based on the calculations shown below. Compliance will be verified through the initial performance test.



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 31	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

$$\text{Grain Loading} = [(A \times B)/(C \times D)] \times 7000 \text{ gr/lb}$$

where:

- A = PM10 emission rate during normal operation, 9.5 lb/hr
- B = Rule specified percent of CO2 in the exhaust (12%)
- C = Percent of CO2 in the exhaust (approx. 4.29% for natural gas)
- D = Stack exhaust flow rate, 61.84E+06 scf/hr (@ 32°F)

$$\begin{aligned} \text{Grain Loading} &= \frac{9.5 \text{ lbs/hr} \times [(7000 \text{ grains/lb}) \times (12/4.29)]}{61.8 \text{ E}+06 \text{ scf/hr}} \\ &= \boxed{0.003 \text{ grains/scf}} \end{aligned}$$

RULE 431.1 – Sulfur Content of Gaseous Fuels

The natural gas supplied to the turbines is expected to comply with the 16 ppmv sulfur limit (calculated as H2S) specified in this rule. Commercial grade natural gas has an average sulfur content of about 4ppm. The long term (annual) SOx emissions from the turbines are based on 4 ppm or about 0.25 gr/100 cf concentration. The short term (hourly, daily, and monthly) SOx emissions from the turbines are based on 12 ppm or about 0.75 gr/100 cf concentration. A condition will be placed on the permit to require that the sulfur content is measured and recorded to insure compliance. The applicant will also comply with reporting and record keeping requirements as outlined in subdivision (e) of this rule.

RULE 475 – Electric Power Generating Equipment

This rule applies to power generating equipment greater than 10 MW installed after May 7, 1976. Requirements are that the equipment meet a limit for combustion contaminants of 11 lbs/hr or 0.01 gr/scf. Compliance is achieved if either the mass limit or the concentration limit is met. Mass PM10 emissions from each turbine are estimated at 9.5 lbs/hr, and 0.0033 gr/scf during natural gas firing at maximum firing load (see calculations below). Therefore, compliance is expected. Compliance will be verified through the initial performance test as well as ongoing periodic testing.

$$\text{Stack Exhaust Flow} \left(\frac{\text{scf}}{\text{hr}} \right) = F_d \times \frac{20.9}{(20.9 - \%O_2)} \times TFD$$

where:



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 32	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

Fd: Dry F factor for fuel type, 8710 dscf/MMBtu

O2: Rule specific dry oxygen content in the effluent stream, 3%

TFD: Total fired duty measured at HHV, 2005 MMBtu/hr (@ 32°F)

$$\text{Combustion Particulate} \left(\frac{\text{grain}}{\text{scf}} \right) = \frac{PM_{10}, \text{ lb/hr}}{\text{Stack Exhaust Flow, scf/hr}} \times 7000 \frac{\text{gr}}{\text{lb}}$$

$$\text{Stack flow} = 8710(20.9/17.9) \times 2005 = 20.39 \text{ mmscf/hr}$$

$$\text{Combustion particulate} = (9.5/20.39 \times 10^6) \times 7000 = \boxed{0.0033 \text{ gr/scf}}$$

RULE 1134 – Emissions of NOx from Gas Turbines

This rule applies to gas turbines, 0.3 MW and larger, installed on or before August 4, 1989. Therefore, as a new installation, the proposed HBEP turbines are not subject to this rule.

RULE 1135 – Emissions of NOx from Electric Power Generating Systems

This rule applies to the electric power generating systems of several of the major utility companies in the basin, including SCE and their successors. The plants which are included in the RECLAIM program are no longer subject to the requirements of this rule.

REGULATION XIII/Rule 2005 – New Source Review

The new turbines are subject to NSR, including BACT, modeling, and offsets. Also, the addition of the turbines to the Huntington Beach plant is considered a major modification to an existing major source. Therefore, the additional requirements for major sources are applicable.

o BACT

BACT is required for all criteria pollutants. For major sources, BACT is determined at the time the permit is issued, and is the Lowest Achievable Emission Rate (LAER), which has been Achieved in Practice. Based on recently issued permits, (including LADWP Scattergood, City of Pasadena, Inland Empire Energy Center, and El Segundo Generating Station) AQMD has determined that BACT for combined cycle gas turbines is as follows:



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 33	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

Table 4.1 Turbine Required BACT

NO _x	CO	VOC	PM ₁₀	SO _x	NH ₃
2.0 ppmdv @ 15% O ₂ , 1 hour average	2.0 ppmdv @ 15% O ₂ , 1 hour average	2.0 ppmdv @ 15% O ₂ , 1 hour average	Natural gas fuel	Natural gas fuel with fuel sulfur content of no more than 1 grain/100 scf (about 16 ppm)	5.0 ppmdv @ 15% O ₂ , 1 hour average

The applicant is proposing the following emission levels for this project. The emission levels of NO_x, CO, VOC, and NH₃ in the table are manufacturer guaranteed emissions under normal operating conditions.

TABLE 4.2 – Proposed Control Levels for the HBEP Turbines

NO _x	CO	VOC	PM ₁₀	SO _x	NH ₃
2.0 ppmdv @ 15% O ₂ , 1 hour average	2.0 ppmdv @ 15% O ₂ , 1 hour average	2.0 ppmdv @ 15% O ₂ , 1 hour average	Exclusive use of natural gas fuel, PM10 emissions of 4.5/9.5 lbs/hr	Exclusive use of natural gas fuel*	5.0 ppmdv @ 15% O ₂ , 1 hour average

**Natural gas provided by the Gas Company is limited to 16 ppm in the South Coast by Rule 431.1. Generally, the actual sulfur content is about 4 ppm (4 ppm corresponds to 0.25 gr/100 scf)*

BACT for the ammonia tank is the use of a pressure vessel equipped with a p/v valve.

o Modeling

The applicant performed dispersion modeling for NO₂, CO, SO₂, and PM₁₀.

Modeling evaluations were performed using the American Meteorological Society/USEPA AERMOD (version 12345) model and representative meteorological data from the John Wayne Airport meteorological station. Modeling analysis was performed for turbine startups, normal turbine operation, and turbine commissioning operations. A discussion of the modeling procedure and the inputs used in the modeling are shown in Appendix E.

The air basin where the plant will be located is in attainment for NO₂, CO, and SO₂. PM₁₀ was designated as a federal attainment pollutant in the SCAB on June 26, 2013, however it remains in non-attainment status at the state level and will therefore be evaluated as non-attainment. The compliance determination for NO₂, CO, and SO₂ is a comparison of the project impact plus the background concentration to show that it does



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 34	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

not exceed the AAQS. For PM10, the project impact should not exceed the Significant Increment. The results of the model show that the project will not cause a violation, or make significantly worse an existing violation, of any state or national ambient air quality standard. Model results are summarized in the tables below.

Table 4.3 Model Results – Start up/Shutdown and Normal Operation

Pollutant	Averaging Period	Maximum Predicted Impact (ug/m3)	Background Concentration (ug/m3) ⁽¹⁾	Total Concentration (ug/m3)	NAAQS (ug/m3)	CAAQS (ug/m3)
NO2	1-hour	58.8	140	198.8	NA	339
	Annual	0.5	21.3	21.8	57	57
CO	1-hour	333	3,329	3,662	40,000	23,000
	8-hour	78	2,530	2,608	10,000	10,000
SO2	1-hour	7.1	24.9	32.0	NA	655
	1-hour	7.1	10.7	17.8	196	NA
	24-hour	2.4	5.5	7.9	365	105
PM10	24-hour	4.7	48.0	52.7	NA	150

Table 4.6 Model Results, Commissioning

Pollutant	Averaging Period	Maximum Predicted Impact (ug/m3)	Background Concentration (ug/m3) ⁽¹⁾	Total Concentration (ug/m3)	NAAQS (ug/m3)	CAAQS (ug/m3)
NO2	1-hour	146.3	140	286.3	NA	339
CO	1-hour	5,076	3,329	8,405	40,000	23,000
	8-hour	4,369	2,530	6,899	10,000	10,000

The modeling was reviewed by AQMD modeling staff and deemed acceptable. Refer to the memo from Elaine Chang to Andrew Lee dated December 12, 2013.

o Offsets

The applicant is requesting that the project be evaluated under the Rule 1304(a)(2) – Electric Utility Steam Boiler Replacement exemption. This provision applies to the replacement of a utility steam boiler with combined cycle gas turbine(s), and allows an exemption from modeling and offsets for non-Reclaim pollutants in such cases. The exemption applies on a MW to MW basis. Its purpose was to facilitate the removal of older less efficient boiler/steam turbine technology with newer cleaner gas turbine technology at the utilities, in conjunction with the old Rule 1135. Since the advent of



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 35	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

Reclaim, the exemption was expanded to include modifications being conducted in order to comply with Reg. XX rules. Rule 2005 does not provide a similar exemption for NOx.

In order to qualify for the exemption, AES HB is proposing to shutdown 4 boilers in conjunction with the construction of the new HBEP. Those 4 boilers include Boilers 1 and 2 at the Huntington Beach site, as well as Boilers 6 and 8 at AES' Redondo Beach Generating Facility, located at 1100 N. Harbor Dr, Redondo Beach, CA 90277. The capacity of the boilers being shutdown is shown in the table below:

Unit	Capacity, MW
Boiler 1, HB	215
Boiler 2, HB	215
Boiler 6, RB	175
Boiler 8, RB	480
Total Shutdown Capacity	1085

The shutdown capacity is based on the description of the units as listed in the current AQMD permits.

The capacity of the new units is summarized below:

Total Gross Capacity as Permitted, MW	Total Net Capacity with Transmission Line Restriction, MW	Total Gross Capacity with Transmission Line Restriction, MW
1091	939	972 ¹

¹ At a temperature of 75-80 °F

Maximum capacity is determined at 32 °F. The plant output is physically restricted by the transmission line out of the facility to 939 MWs net. The plant will be limited to this output by permit condition.

The actual emissions from the 2 units being shutdown at the Huntington Beach facility (Boiler 1 and 2) are shown in Appendix D for reference only.

Under Rule 2005, RTCs to cover the expected emissions of NOx are required to be held for the first compliance year. Additionally, since the NOx PTE after the commissioning year is greater than the facility's initially allocation, the facility is required to hold NOx RTCs for each subsequent year. The Huntington Beach facility is also in the SOx RECLAIM program. Therefore, SOx RTCs are required to be held to cover the first year of operation. Additionally, because the facility opted into SOx RECLAIM after 1994, there is no initial allocation. For this reason, SOx RTCs are required to be held for each



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 36	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

compliance year after the first year of operation [paragraph (f)(1)]. RTC requirements are shown in Appendix P.

Other requirements of Rule 1303:

Sensitive Zone Requirements. For this project, ERCs may be obtained from either Zone 1 or Zone 2A.

Facility Compliance. This facility is currently in compliance with all applicable rules and regulations of the District.

Alternative Analysis. The project is subject to the California Energy Commission licensing procedure. Under this procedure, a full analysis of the proposal is conducted, including project alternatives.

The following alternative generating technologies were considered:

o Conventional Boiler and Steam Turbine
Rejected because of the low efficiency and large space requirements

o Simple-Cycle Combustion Turbine
Rejected for low efficiency

o Kalina Combined-Cycle
Rejected because the technology is still in development stage

o Internal Combustion Engine
Rejected because of higher emissions profile and smaller output than proposed turbine plant

The following fuel technology alternatives were considered:

o Geothermal and Hydroelectric
Rejected because there are no geothermal or hydroelectric resources near the plant site

o Biomass
Rejected because there are not enough locally available sources of biomass

o Wind
Rejected because the site does not experience sufficient wind resources

o Solar
Rejected because of space limitations and lack of sufficient solar resources



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 37	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

AES also considered wet cooling using either potable or recycled water, or seawater, as an alternative to the proposed dry cooling of the turbines. This was rejected because in the case of potable water, its use for power plant cooling purposes is discouraged by SWRCB and the CEC. In the case of recycled water, an additional pipeline and treatment facility would need to be constructed to supply enough water at the required level of treatment to serve the plant. The seawater option was rejected because of the environmental impacts of a seawater intake pipe, and cost considerations.

An alternative to the proposed site of the power plant was determined to be not necessary because PRC 25540.6 [b] states that if the commission finds 'that the project has a strong relationship to the existing industrial site' 'it is therefore reasonable not to analyze alternatives sites for the project'.

Protection of Visibility. Net Increase in emissions from the proposed project exceed the 15 tons per year PM₁₀ and 40 tons per year NO_x thresholds, but the site is not within the specified distance of any Class I areas. Distances to the Class I areas are summarized below:

Table 4.7 Distances to Class I Areas

Federal Class I Area	Threshold Distance (km)	Distance from the HBEP (km)
Cucamonga Wilderness	28	69
San Gabriel Wilderness	29	69.9
San Geronio Wilderness	32	107.6
San Jacinto Wilderness	28	114.2
Agua Tibia Wilderness	28	90.6
Joshua Tree NP	29	145.4

A visibility analysis was conducted under the PSD regulation.

Statewide Compliance. The applicant has submitted a statement certifying that all AES's stationary sources are currently in compliance with applicable state and federal environmental regulations.

Rule 1304.1 – Electrical Generating Facility Fee for Use of Offset Exemption

The project will utilize the offset exemption of Rule 1304(a)(2) for PM₁₀ and VOC, and is therefore subject to a fee under this rule. The facility has opted to pay an annual fee. The formula for calculating this fee is as follows:

$$[(R_{iA1} \times 100 / MW) + R_{iA2} \times (MW - 100) / MW] \times OF_i \times PTE_{repi} \times [(C_{rep} - C_{2YRAvgExisting}) / C_{rep}]$$



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 38	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

Where:

- Fi = Offset fee for pollutant (i)
- RiA1 = Annual Offset Fee Rate for pollutant (i), in terms of dollars per pound per day, annually (Table A1 of the rule)
- RiA2 = Annual Offset Fee Rate for pollutant (i), in terms of dollars per pound per day, annually (Table A2 of the rule)
- MW = MW of new replacement units
- OFi = Offset factor pursuant to Rule 1315(c)(2) for extreme non-attainment pollutants and their precursors (Tables A1 and A2 of the rule)
- PTerepi = permitted potential to emit of new replacement units for pollutant (i), in pounds per day (maximum permitted monthly emissions ÷ 30 days).
- Crep = maximum permitted annual megawatt-hour (MWh) generation of the new replacement units (maximum rated capacity (MW) X maximum permitted annual operating hours)
- C2yravgexisting = maximum permitted annual megawatt-hour (MWh) generation of the existing units to be replaced using the last 24 month period immediately prior to issuance of the permit to construct.

The facility will be required to demonstrate compliance with the specific requirements of this rule prior to the issuance of the Permits to Construct for the HBEP Project. The following calculation provides an estimate of the approximate fee that will be required.

The following factors are used in the equation:

Factor	PM10	VOC
PTerep	856 lbs/day	1,497 lbs/day
Ri1A	\$997/lb/day	\$47/lb/day
Ri2A	\$3,986/lb/day	\$185/lb/day
OFi	1.0	1.2
MW	972 MW	972 MW
Crep	6,949,670 MWh	6,949,670 MWh
C2yr	18,959.8 MW	18,959.8 MW

Notes:

972 MW is based the plant's maximum gross output with the transmission line restriction.
 PTerep is calculated as follows: PM10 -4,278 lbs/month ÷ 30 = 142.6* 6 turbines = 856 lbs/day, VOC - 7,487.2 lbs/month ÷ 30 = 249.6*6 turbines = 1,497 lbs/day
 Crep is calculated as follows: 972 MW * 6,370 hrs = 6,191,640 MWh (5,900 w no duct firing, 470 with duct firing, no starts or shutdowns included)
 C2yr is taken from Appendix O



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 39	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

PM10			
F_{PM10}	=	$[(997 \times 100 / 972) + 3620.65 \times (972 - 100) / 972] \times 1.0 \times 856$	
		$\times [(6191640 - 18959.8) / 6191640]$	
F_{PM10}	=	$[(102.57) + (3248.16)] \times (1.0) \times (856) \times (0.9969)$	
F_{PM10}	=	\$2,859,333.38	

VOC			
F_{VOC}	=	$[(47 \times 100 / 972) + 185 \times (972 - 100) / 972] \times 1.2 \times 1497$	
		$\times [(6191640 - 18959.8) / 6191640]$	
F_{VOC}	=	$[(4.84) + (165.97)] \times (1.2) \times (1497) \times (0.9969)$	
F_{VOC}	=	\$305,891.87	

RULE 1325 – Federal PM2.5 New Source Review

This rule applies to major polluting facilities, major modifications to a major polluting facility, or any modifications to an existing facility that would constitute a major polluting facility in and of itself. A major polluting facility is defined as a facility which has actual emissions, or a potential to emit of greater than 100 tons per year. A major polluting facility is required to comply with the following requirements:

- Use of LAER
- Offset PM2.5 emissions at the offset ratio of 1.1:1
- Certification of compliance of emission limits
- Conduct an alternative analysis of the project

As shown in Appendix L, the existing facility in a non-major source, and the total PM2.5 potential to emit resulting from the addition of the 6 turbines will not result in an emissions increase above the 100 ton/year threshold. Therefore, the Huntington Beach facility will continue to be a non-major polluting facility for PM2.5.

RULE 1401 – New Source Review of Toxic Air Contaminants

This rule requires an analysis of the new permit units' impacts due to the release of air toxics. A Tier 4 Health Risk Assessment was performed using CARB's Hotspots Analysis and Reporting Program (HARP, version 1.4f). Model inputs and results are presented in Appendix E. The results of the model are summarized below:



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 40	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

Table 4.8 Model Results, Individual Unit HRA

	Residential Cancer Risk	Residential Chronic HI	Residential Acute HI
Stack 1	0.42 per million	0.00124	0.0244
Stack 2	0.39 per million	0.00113	0.0291
Stack 3	0.36 per million	0.00104	0.0203
Stack 4	0.46 per million	0.00135	0.00368
Stack 5	0.47 per million	0.00136	0.00897
Stack 6	0.47 per million	0.00136	0.0117
	Worker Cancer Risk	Worker Chronic HI	Worker Acute HI
Stack 1	0.095 per million	0.00154	0.0244
Stack 2	0.095 per million	0.00154	0.0291
Stack 3	0.121 per million	0.00197	0.0203
Stack 4	0.095 per million	0.00154	0.00368
Stack 5	0.095 per million	0.00154	0.00897
Stack 6	0.096 per million	0.00157	0.0117

Table 4.9 Model Results, Project

Facility HRA	MICR (in a million)		Non-Cancer Hazard Index	
	Resident	Worker	Acute	Chronic
	2.35	0.49	0.069	0.008

Based on a radius of 2.8 km and a population density of 4,000 persons/km², the cancer burden is conservatively estimated to be 0.23.

The results show that the individual unit and total facility risks are less than the cancer and non-cancer rule limits of 10 in one million (for permit units with T-BACT, considered an oxidation catalyst for the turbines), cancer burden of 0.5, and hazard indices of 1.

REGULATION XVII – Prevention of Significant Deterioration

The South Coast Basin where the project is to be located is in attainment for NO₂, SO₂, CO, and PM₁₀ emissions. Additionally, beginning on January 2, 2011, Greenhouse Gases (GHGs) are a regulated criteria pollutant under the PSD major source permitting program. Therefore each of these pollutants must be evaluated under PSD for this project.

PSD applies to a significant increase in emissions from a major stationary source. For a combined cycle power plant, the major source threshold is 100 tons per year based on actual emissions or potential to emit. If the facility is deemed to be major, Rule 1702 further defines a significant emission increase as 40 tpy or more of NO₂ or SO₂ or 100 tons per year or more of CO. The existing equipment at the Huntington Beach Generating Station does not constitute a major source, however the addition of the new gas turbines



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 41	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

is considered major for NO₂, CO and PM₁₀, and is subject to PSD review for these pollutants.

Requirements for a significant emission increase under Rule 1703 include the following:

- Use of BACT [1703(a)(3)(B)]
- Modeling to determine impacts of the project of National and State AAQS and increases over the baseline concentration [1703(a)(3)(C)]
- Analysis of ambient air quality in the impact area [1703(a)(3)(D)]
- Analysis of project impacts on visibility, soil, and vegetation [1703(a)(3)(E)]

The BACT determination for NO₂, CO, SO₂, and PM₁₀ is based on a top-down analysis. This analysis has been performed for power plants of this type multiple times in the recent past, and the results of the analysis are summarized as follows:

- NO₂ – The turbines must meet a limit of 2.0 ppmvd, 1-hour average at 15% O₂. The facility has chosen to use a conventional SCR system for the control of NO_x emissions to this level.
- SO₂ – The requirement is to use pipeline quality natural gas. The facility is proposing the use of this fuel type exclusively.
- CO – The turbines must meet a limit of 2.0 ppmvd based on 1-hour average at 15% O₂. The facility has chosen to use a conventional oxidation catalyst system for the control of CO emissions to this level.
- PM₁₀ – The requirement is to use pipeline quality natural gas with a sulfur content (calculated as H₂S) less than 1 grain per 100 scf. The facility is proposing the use of this fuel type exclusively.

The PSD modeling analysis requires the following steps:

1. Determine whether preconstruction monitoring is required
2. Assessment of significance under PSD
3. Determine Ambient Air Quality Impacts
4. Determine Impacts in Class I Areas, including visibility, soil, and vegetation

The applicant performed modeling which indicated that the maximum 1-hour and 8-hour CO impacts from turbine operations including start ups and shutdowns are 332.6 ug/m³ and 78.3 ug/m³ respectively. These results are below the corresponding US EPA CO Class II SILs of 2,000 ug/m³ and 500 ug/m³. Therefore, 1-hour and 8-hour CO increment analyses are not required.



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 42	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

The peak annual NO₂ impact from the total project is 0.49 ug/m³. This impact is less than the US EPA NO₂ Class II significance impact of level of 1 ug/m³, therefore, no additional PSD analysis is necessary.

For 1-hour NO₂ impacts, it was first determined that the peak impact level from the proposed project of 52.2 ug/m³ exceeds the significance impact level of 7.52 ug/m³. Therefore, a cumulative impact assessment is necessary.

For the cumulative impact assessment, three facilities, Orange County Sanitation District's Huntington Beach and Fountain Valley facilities and Beta Offshore as well as emissions from shipping lane activities off the coast were selected to be included based on their facility emissions and distance to the project. Seasonal, by hour-of-day background concentrations from the Costa Mesa monitoring station were used in the modeling. Following the form of the standard, the 1-hour NO₂ impact from the project plus cumulative sources plus background is 168.2 ug/m³, which is less than the Federal 1-hour standard of 188 ug/m³. Therefore, no additional PSD analysis is necessary.

Effective July 26, 2013, the South Coast Air Basin has been re-designated to attainment for the 24 hour PM₁₀ NAAQS. The total project's peak 24-hour impact is 4.74 ug/m³, which is less than the Class II SIL of 5 ug/m³, therefore no additional PSD analysis is necessary.

Visibility Analysis

The nearest Class I areas to the project site are the San Gabriel Wilderness and Cucamonga Wilderness areas located approximately 69 km away. A radial receptor ring was placed at a distance of 50 km from the project (50 km is the maximum receptor distance of the AERMOD model). The maximum project impact for annual NO₂ at 50 km is 0.02 ug/m³, which is less than the significance level of 0.1 ug/m³.

A screening criteria is acceptable to use for projects located more than 50 km away from a Class I area, in order to estimate the potential impacts on visibility and deposition at these areas. The emissions/distance (Q/D) is calculated using the project's total annual emissions of SO₂, NO_x, PM₁₀, and H₂SO₄ (based on 24 hour maximum allowable emissions) divided by the distance between the project and the nearest Class I area. Since the project is limited to an operating profile of 6,835 hours per year, the project's annual emissions of 407.3 tpy are equivalent to 522 tpy. Therefore, the Q/D ratio is 7.6, which is less than the threshold of 10. Thus, modeling of visibility and deposition impacts to Class I areas is not necessary.

The project's impacts on visibility in Class II areas were also analyzed. Currently, there are no thresholds for visibility impacts on Class II areas. The project utilized the criteria and thresholds for visibility impacts on Class II areas. Visibility impacts are based on the



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 43	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

calculation of two factors – plume contrast and color contrast (ΔE) of the plume when compared to the sky and terrain backgrounds. For Class I areas, the criteria used is based on a perceptibility threshold of 0.05 (absolute value) for contrast and 2.0 for ΔE . The project applicant identified four Class II areas in the project vicinity, Crystal Cove State Park, Water Canyon state Park, Chino Hills State Park, and San Mateo Canyon Wilderness Area. The ΔE for Crystal Cove State Park and Water Canyon State Park exceeded the thresholds using the Level I VISCREEN analysis. Therefore a Level 2 VISCREEN analysis was performed for these 2 areas. Using the 5 year meteorological data from the John Wayne Airport, the joint frequency distribution tables were created and were used to determine the worst case single wind speed and stability class required for a VISCREEN analysis. Using the Level 2 VISCREEN analysis, the project’s impacts for both contrast and ΔE are less than the thresholds for both Crystal Cove state Park and Water Canyon State Park. Therefore, the proposed project would not be expected to adversely affect visibility at the Class II areas analyzed.

Soil and Vegetation Analysis

The facility performed an acid deposition analysis using AERMOD and added the results plus the background and compared it to the Critical Load (CL) for each wetland and protected area within 6 miles of HBEP. The results showed the total predicted acid deposition was well below the CL thresholds. Therefore, adverse acid deposition impacts attributable to the HBEP power equipment emissions are not likely to occur.

The Federal Land Managers (US Forest Service and National Park Service) were given the opportunity to review and comment on the potential impacts of the proposed project on Class I areas. Both the US Forest Service and the National Park Service deemed the impacts of the project to be negligible given the distance to the Class I areas, and the controlled emissions level at which the plant will operate. The Forest Service responded in a letter dated August 23, 2013, and the Park Service on June 5, 2013.

Rule 1714 – PSD for Greenhouse Gases

As of January 2, 2011 Greenhouse gases (GHGs) are a regulated New Source Review pollutant under the PSD permitting program when they are emitted by new sources or modifications to existing sources at amounts equal to or greater than the applicability thresholds of the GHG tailoring rule. The HBEP project will emit over 1 million tons of CO₂e, and the contemporaneous increase, after considering the shutdown of Boilers 1 and 2, will exceed 75,000 tons per year. The project is therefore subject to BACT for GHGs (reference Appendix F)

For PSD purposes, GHGs are defined as a single air pollutant consisting of the sum of the following six gases:



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 44	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

Carbon Dioxide (CO₂)
Nitrous Oxide (N₂O)
Methane (CH₄)
Hydrofluorocarbons
Perfluorocarbons
Sulfur hexafluoride (SF₆)

These gases can be summed together as CO₂ equivalent, or CO₂e, using each gases' global warming potential (GWP). The CO₂e limit as set forth in California law SB1368.. Under CCR Title 20 Chapter 11 Article 1 is 1,100 lb/_{net}MWh. The limit is based on the total annual CO₂e emissions from all operations, divided by the total annual net MW generation.

Approximate GHG emissions from the HBEP are calculated in Appendix F and summarized in the following table.

Table 4.10 New Turbines GHG PTE

GHG	Hourly Tons Per Turbine @ 2005 mmbtu/hr	Annual Tons Per Turbine @ 66,776,649 mmbtu/yr ⁽¹⁾	Annual Tons 6 Turbines
CO ₂	117.2	3,903,399	23,420,394
CH ₄	2.21E-3	73.6	441.6
N ₂ O	2.21E-4	7.4	44.4
Total Mass	117.2	3,903,480	23,420,880
CO ₂ e	117.3	3,907,239	23,443,434

GHG BACT Analysis

EPA has recommended the 5-step "top-down" process to determine BACT for GHGs.

1. Identify all available control options
2. Eliminate technically infeasible options
3. Ranking of controls
4. Economic, energy, and environmental impacts
5. Selecting BACT

Step 1 Identify All Available Control Options

The available CO₂ control technologies, as determined by EPA and Department of Energy, are:



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 45	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

- A. Carbon Capture and Sequestration (CCS)
- B. Lower Emitting Alternative Technology
- C. Thermal Efficiency

The technologies are described and discussed in the next sections.

A. Carbon Capture and Sequestration (CCS)

CCS is a process that captures, transports, and sequesters CO₂ emissions.

Capturing of CO₂ Emissions

Combustion flue gas may be processed for the purpose of separation and capture of carbon dioxide. Amine-based solvent systems are available in commercial use for scrubbing CO₂ from industrial flue gases and process gases. Solid sorbents are also available to capture CO₂ from flue gas through chemical adsorption or physical adsorption. However, based on a recent similar analysis conducted for LADWP Scattergood Generating Station, commercially available systems are not presently available to process flue gas from a commercial power plant.

Transportation of CO₂ Emissions

Once captured, CO₂ would have to be transported to a storage site. For geologic sequestration, a pipeline is typically used to transport the CO₂ as a critical fluid to the sequestration location. The Technical Advisory Committee for the California Carbon Capture and Storage Review Panel stated in the August 2010 report that there are no existing CO₂ pipelines in California. In addition, there are no CO₂ pipeline projects underway in California.

Sequestration of CO₂ Emissions

There are several sequestration approaches.

Geologic Sequestration

Under geologic sequestration the captured CO₂ is compressed and transported to a sequestration location. CO₂ is injected into underground at high pressure, and remains a supercritical fluid underground. Over time the CO₂ can dissolve into surrounding water and rocks, creating solid carbonate minerals.

There are several geologic formations identified in California that might provide a suitable site for geologic sequestration. Several sites near the HBEP Project may be the



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 46	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

old petroleum production area in Huntington Beach, a formation in the Lower San Joaquin Valley, and possibly a site located in Ventura County. While these sites may eventually prove to be suitable, the geotechnical analyses needed to confirm their suitability have not been conducted. In addition, there are no available pipelines to transport captured CO₂ to the sequestration site.

Ocean Storage

In lieu of injecting CO₂ underground as in geologic sequestration, ocean storage is accomplished by injecting CO₂ into the ocean water typically at depth of greater than 1,000 meters. CO₂ is expected to dissolve or form into a horizontal lens which would delay the dissolution of CO₂ into the surrounding environment.

Mineral Carbonation

Mineral carbonation is the reaction of CO₂ with metal oxides to form metal carbonates. Metal oxides are abundant in silicate minerals and in waste streams. The natural reaction of CO₂ with metal oxides is a very slow process. The reaction time can be increased by enhancing the purity of these metal oxides. Large scale production of metal oxides to meet the demand of electrical generation is very energy and cost intensive.

B. Lower Emitting Alternative Technology

Lower emitting alternative technologies for energy generation are available on the demand side. If demand for energy is reduced a utility's generation capacity can be reduced, thus lowering GHG emissions.

Demand-side resource programs include both energy efficiency, aimed at reducing total energy consumption, and demand response, aimed at reducing peak demand or shifting demand from peak to off-peak periods. Demand response programs include increasing the efficiency of Huntington Beach Energy Project's system capabilities such that energy is dispatched to more effectively track actual demand, and agreements with commercial and industrial customers to curtail load during peak periods. No additional lower emitting alternative technologies are feasible to incorporate into the project without fundamentally changing the business purpose of the Project.



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 47	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

C. Thermal Efficiency

Power generation through fossil fuel combustion is a chemical reaction process. The thermal efficiency is defined as the ratio of the net power produced and the heating values of the fuel. The plant efficiency varies from 30% to over 40%, depending on many factors. The heat rate, measured in Btu/kWh, is generally used as a thermal efficiency indicator. The thermal efficiency is at the highest when the reaction is at stoichiometric, and at the time when CO₂ emissions are the highest.

The following factors affect the thermal efficiency of a power plant:

- Thermal dynamic cycle selection, combined cycle versus simple cycle
- Combustion turbine performance, compression ration and turbine design temperature
- Combustion turbine startup time, load transition time
- Steam turbine startup time, load following time
- Fuel selection

The repower project is proposing to combust natural gas, the lowest emitting fossil fuel available. The proposed turbines are operated as a combined cycle generation system (CCGS). The CCGS has a higher cycle thermal efficiency than the simple cycle systems. Energy is recovered in the heat recovery steam generator (HRSG) and is used to generate power in the steam turbine generator (STG). The fast start capability of the turbines minimizes emissions during startup and increases the efficiency of the power plant.

Although new power generating system would emit GHG emissions, the high thermal efficiency of the new power generating equipment and the system build-out of renewable resources in California would result in a net cumulative reduction of GHG emissions from new and existing fossil resources.

With the adoption of Senate Bill 2 on April 12, 2011, California's Renewable Portfolio Standard (RPS) was increased from 20 percent by 2010 to 33 percent by 2020. To meet the new RPS requirements, the amount of dispatchable, high-efficiency, natural gas generation used as regulation resources, fast ramping resources, or load following or supplemental energy dispatches will have to be significantly increased. The construction of the HBEP will aid in the effort to meet California's RPS standard. Finally, the operation of the new power generating system will enhance the overall efficiency of AES's electricity system operation and thereby reduce GHG emissions.



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 48	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

Step 2 Eliminate Technically Infeasible Options

The second step for the BACT analysis is to eliminate technically infeasible options from the control technologies identified in Step 1. For each option that was identified, a technology evaluation was conducted to determine the technical feasibility. The technology is feasible only when the technology is available and applicable. A technology that is not commercially available for the scale of the project is also considered infeasible. An available technology is applicable if it can reasonably be installed and operated on the proposed project.

A. Carbon Capture and Sequestration (CCS)

The technical feasibility of each step of the CCS is discussed below.

Carbon Capture Technology

Solvent-based capture technology for a commercial scale power plant has only been demonstrated for a fraction of the flue gas. A solvent-based carbon capture process is currently judged to be technologically infeasible for a commercial power plant application.

Sorbent-based capture technology can be used for post-combustion capture of CO₂. However, the technology has not been demonstrated on combined-cycle gas turbine power plants. A sorbent-based carbon capture process is currently judged to be technologically infeasible for a natural gas-fired commercial power plant application.

Membrane-based capture technology is commercially available in the chemical industry for CO₂ removal but has not been demonstrated in practice for power generation applications. A membrane-based carbon capture process is currently judged to be technologically infeasible for a commercial power plant application.

CO₂ Transportation

The basic technologies required for CO₂ transportation (i.e., pipeline, tanker truck, ship) are in commercial use today for a number of applications and can be considered commercially available for liquid CO₂.

CO₂ Sequestration

Geologic sequestration has been demonstrated on a pilot scale. However, a number of significant technical issues remain to be resolved before the technology can be applied to a successful commercial scale application at a specific site. At this moment the technical



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 49	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

feasibility for geological sequestration for the new power generating system cannot be determined. Therefore CCS using geological sequestration cannot be demonstrated to be technically feasible in practice for the new power generating system.

Ocean storage and its ecological impacts are still in the research phase. It is not commercially available.

Mineral carbonation is technically feasible, as reaction chemistry is well understood. However, the sequestration of CO₂ through mineral carbonation has not been demonstrated on a commercial scale.

Summary of CCS Feasibility

In summary, the post-combustion carbon capture technologies are still in the developmental stage or pilot scale projects. These technologies would not be considered commercially available for the project size of a full-scale commercial power plant. In addition, there are no comprehensive standards in place defining requirements for long term sequestration. Therefore, CCS is not yet demonstrated in practice for a commercial-scale, natural gas fired power plant such as the HBEP. In consideration of the uncertainty in the technical feasibility of CCS and its emergence as a promising technology, CCS is carried forward in this BACT analysis as a potential GHG control technology. However, substantial evidence demonstrates that CCS is not yet demonstrated as technically feasible for the HBEP project.

B. Lower Emitting Alternative Technology

As discussed previously, any of the commercially available low GHG-emitting technologies that could be implemented, are not feasible for this site and would fundamentally alter the business purpose of the emission source. As such, lower emitting alternative technology was not considered as part of the BACT analysis.

C. Thermal Efficiency

The California Senate Bill (SB) 1368 requires the California Public Utilities Commission (CPUC) to establish a GHG emission performance standard for all baseload utilities by February 1, 2007. The California Energy Commission (CEC) was required to establish a similar standard for local publicly owned utilities by June 30, 2007. The CEC has established a GHG performance standard of 1,100 pounds of CO₂ per net MWh for baseload publicly owned electrical utilities. The California Legislature in Assembly Bill (AB) 1613 (2007), as amended by AB 2791 (2008), established a CO₂ Emission Performance Standard (EPS) for combined heat and power facilities of 1,100 lbs



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 50	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

CO₂/MWh. In 2010, the CEC promulgated its regulation to implement AB 1613 in its Guidelines for Certification of Combined Heat and Power Systems Pursuant to the Waste Heat and Carbon Emissions Reduction Act (CEC 2010b).

The HBEP CCGS will meet the California GHG emission performance standard of 1,100 pounds of CO₂ per net megawatt hour. As calculated in Appendix F, using a conservative annual operating schedule that includes all proposed startups and shutdowns, and all proposed hours of normal operation using load factors from 100% to as low as 70%, HBEP will emit CO₂ at a rate of 1,053.7 lb CO₂ per net megawatt hour. *This is below the 1,100 lbs CO₂ per net MWh California standard.*

The thermal efficiency for the new power generating system achieved by the state-of-the-art technologies is a technically feasible alternative for reducing GHG emissions from a fossil-fuel fired low efficiency power plant. In conclusion the combustion process inherent in the new power generating system is achieved in practice and is eligible for consideration under Step 3 of the BACT analysis.

Step 3 - Rank Remaining Control Technologies

While carbon capture and sequestration (CCS) was determined to be technically infeasible for the HPEP Project, this option is carried forward in the BACT analysis to Step 3. The rank order of control, starting from the most effective control (1) to the least effective control (2), is as follows:

1. CCS
2. Thermal efficiency

The control effectiveness is discussed below.

A. Carbon Capture and Sequestration (CCS)

Post-combustion capture systems being developed are expected to be capable of capturing more than 90 percent of flue gas CO₂. At an assumed control efficiency of 90 percent, this would be equivalent to an emission rate of 10 percent of the California EPS, or approximately 110 lb CO₂/MWh. This makes CCS the top-ranked technology on a theoretical basis. However, as discussed in Step 2, CCS was found to be technically infeasible for the HBEP Project. In addition, the above assumed CO₂ control efficiency does not take into account the parasitic loss associated with operation of the CCS system and the increased CO₂ emissions that will occur to replace the parasitic energy loss.



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 51	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

B. Thermal Efficiency

Thermal efficiency is capable of lowering GHG emissions, but the potential is much less than CCS on a theoretic basis. As discussed in Section 2, the new power generating system already incorporates increased thermal efficiency in its design by incorporation of state-of-the-art combustion turbines with the addition of RPS startup capability. Since the parasitic load is already relatively low at this facility, further increases to thermal efficiency are not achievable without changing basic objectives of the power project, if at all, and hence are not required by EPA guidelines for GHG BACT.

Step 4 – Evaluating the Most Effective Controls

Step 4 of the BACT analysis is to evaluate the most effective control. This step involves the consideration of energy, environmental, and economic impacts associated with each control technology. The top-down approach requires that the evaluation begin with the most effective technology.

A. Carbon Capture and Sequestration (CCS)

Because CCS is considered technically infeasible to apply for the HBEP Project it is not evaluated under this step.

B. Thermal Efficiency

The database review of BACT determinations described above identified six facilities with natural gas-fired combustion turbines for which a GHG BACT analysis was done:

- EPA issued the PSD Permit for the Palmdale Hybrid Power Project in October 2011. This project consists of a hybrid of natural gas fired combined cycle generating system (two GE 7FA combustion gas turbines and one shared steam turbine) integrated with solar thermal generating system. Based on EPA’s analysis CCS was eliminated as a control option because it is deemed economically infeasible.
- EPA issued the PSD Permit for the Lower Colorado River Authority (LCRA) Project in November 2011. This project consists of a natural gas fired combined cycle generating system with two GE 7FA combustion gas turbines and a shared



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 52	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

steam turbine. Based on the review of the available control technologies for GHG emissions, EPA concluded that BACT for LCRA was the use of new thermally efficient combustion turbines with applicable GHG emission limit.

- The Bay Area Air Quality Management District issued a GHG BACT determination for the Calpine Russell City Energy Center in 2010. According to a presentation by Calpine, thermal efficiency was the only feasible combustion control technology considered as CCS was determined to be not commercially available. Thermal efficiency was found to be the top level of control feasible for a combined-cycle power plant, and hence was the technology selected at GHG BACT for Russell City.
- EPA issued the PSD Permit for the Pio Pico Energy Center Project in November 2012. The project consists of three simple cycle GE LMS100 generators. EPA concluded that BACT was the use of new thermally efficient combustion gas turbines with applicable GHG emission limits.
- SCAQMD issued the PSD Permits for the LADWP Scattergood Generating Station in 2013. The project consists of one GE 7FA combined cycle gas turbine and two simple cycle GE LMS100 generators. SCAQMD concluded that BACT was the use of new thermally efficient combustion gas turbines with applicable GHG emission limits.
- SCAQMD issued the PSD Permit for the City of Pasadena in 2013. The project consists of one LM6000 combined cycle gas turbine. SCAQMD concluded that BACT was the use of new thermally efficient combustion gas turbines with applicable GHG emission limits

As demonstrated by the EPA permits thermal efficiency is the most cost effective control technology for GHG emissions from power plants. The Mitsubishi 501DA combustion turbines are acceptable for GHG PSD permits under the BACT thermal efficiency requirement.

Step 5 – Select BACT

Based on the above analysis, thermal efficiency is the only technically and economically feasible alternative for CO₂/GHG emissions control for the HBEP Project. The current design of the facility meets the BACT requirement for GHG emission reductions.

The BACT limit shall be applicable to the entire operation conditions. Therefore, BACT is determined based on the facility proposed annual operating scenarios that take into consideration of load factor and operating hours. The detailed calculations are included in Appendix F.



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 53	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

Based on calculations of Appendix F the Mitsubishi 501DA combined cycle generating system is expected to generate 1053.7 lbs of CO₂ per net megawatt hours over the course of a typical year and this will be the permit limit. This limit ensures compliance with the California law SB1368 limit of 1,100 lb_{net}/MWh. Each turbine will also be subject to the CO_{2e} emission limit of 3,907,239 tons per year. Compliance will be based on a 12-month rolling average as determined by using emission factors and fuel usage.

• **Circuit Breakers**

EPA in the Pio Pico Energy Center PSD permit requires the circuit breakers be equipped with a leak detection system, and be calibrated according to manufacturer specifications. EPA considers this to be BACT for circuit breakers. EPA further argues that the requirement is not redundant to the CARB regulation to reduce GHG (SF₆) emissions from gas insulated switchgears, California Code of Registers, Subchapter 10, Article 4, §95350-§95359.

A facility condition F52.2 will be added to enforce the BACT requirement for the circuit breakers, using the same language as the EPA permit.

Other PSD Requirements

In addition to the BACT requirement the PSD requirements generally include air quality modeling, ambient monitoring, and additional impact analysis. The modeling analysis shall demonstrate that there will be no violations of any NAAQS or PSD increments. However, because there are currently no NAAQS or PSD increments established for GHGs, the modeling analysis requirement would not apply for GHGs even if PSD is triggered for GHGs. EPA does not require monitoring for GHGs in accordance with Section 52.21(i)(5)(iii) and Section 51.166(i)(5)(iii), and EPA does not require impact analysis from GHGs in the nearby Class I areas. In addition, no offsets are required for CO because this pollutant is in attainment in the South Coast Air Basin.

Rule 2011 – SO_x RECLAIM, Monitoring Recording and Recordkeeping Requirements

The turbines will be classified as process units under SO_x RECLAIM. As such they are required to measure and record fuel use and calculate mass SO_x emissions using the emission factor on the permit, and electronically report emissions on a quarterly basis

Rule 2012 – NO_x RECLAIM, Monitoring Recording and Recordkeeping Requirements

The turbines will be classified as major NO_x sources under NO_x RECLAIM. As such, they are required to measure and record NO_x concentrations and calculate mass NO_x emissions with a Continuous Emissions Monitoring System (CEMS). The CEMS will



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 54	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

include in-stack NOx and O2 analyzers, a fuel meter, and a data recording and handling system. NOx emissions are reported to AQMD on a daily basis. The CEMS system will be required to be installed within 90 days of start up. Compliance is expected.

REGULATION XXX – Title V

The Huntington Beach facility is currently subject to Title V, and is operating under a valid Title V permit issued on May 4, 2011. The addition of the combined cycle plant will be considered a significant revision to the existing Title V permit. AES has submitted a Title V revision application A/N 540259. As a significant revision, the permit is subject to a 30 day public notice and a 45 day EPA review and comment period. The public notice requirements are discussed in more detail under the “Public Notice Requirements” section of this report.

State Regulations

California Environmental Quality Act (CEQA)

The project is subject to the licensing procedure under the California Energy Commission (CEC). This procedure analyzes all aspects of the proposed project, and is subject to a public review and comment period. It is therefore considered equivalent to an Environmental Impact Report, and satisfies the requirements of CEQA. CEC’s process will fully evaluate all air quality impacts for the entire project.

Federal Regulations

NSPS for Steam Generators – 40CFR 60 Subpart Da

The fired HRSGs are subject to this subpart because their heat input rating is 507 mmbtu/hr which is greater than the applicability standard of 250 mmbtu/hr in the rule. The emission standards that apply are as follows:

- NOx 0.2 lbs/mmbtu
- PM 0.015 lbs/mmbtu
- SO2 0.2 lbs/mmbtu

The regulation requires the installation of a CEMS to measure NOx and O2. A CEMS for opacity is not required since the unit burns natural gas exclusively and does not use post-combustion controls for PM or SO2 {60.49Da(u)(2)}. A PM CEMS is optional under 60.49Da(t). In lieu of a PM CEMS, a CO CEMS may be installed. An initial performance test is required.

Anticipated emissions from the gas turbines/duct burners are as follows:

- NOx 0.0081 lbs/mmbtu
- PM 0.0050 lbs/mmbtu



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 55	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

SO2 0.0015 lbs/mmbtu

The emissions estimates are all lower than subpart Da requirements. Compliance is expected.

NSPS for Steam Generators – 40CFR 60 Subpart Db

The fired HRSG is not subject to this subpart because the combined cycle turbine meets the applicability requirements of subpart KKKK {60.4b(i)}.

NSPS for Stationary Gas Turbines - 40CFR Part 60 Subpart GG

This regulation has been superseded by 40CFR 60 Subpart KKKK.

NSPS for Stationary Gas Turbines - 40CFR Part 60 Subpart KKKK

The turbines are subject to Subpart KKKK because their heat input is greater than 10.7 gigajoules per hour (10 MMBtu per hour) at peak load, based on the higher heating value of the fuel fired. Actual unit rating is 1498E+06 btu/hr (HHV) X 1055 joules/btu = 1580.4 gigajoules/hr. The standards applicable for a natural gas turbine greater than 850 mmbtu/hr are as follows:

NOx: 15 ppm at 15% O2 (0.43 lbs/MWh)

SOx: 0.90 lbs/MWh discharge, or 0.060 lbs/mmbtu potential SO2 in the fuel

Monitoring

The regulation requires that the fuel consumption and water to fuel ratio be monitored and recorded on a continuous basis, or alternatively, that a NOx and O2 CEMS be installed. For the SOx requirement, either a fuel meter to measure input, or a watt-meter to measure output is required, depending on which limit is selected. Also, daily monitoring of the sulfur content of the fuel is required if the fuel limit is selected. However, if the operator can provide supplier data showing the sulfur content of the fuel is less than 20 grains/100cf (for natural gas), then daily fuel monitoring is not required.

Testing

An initial performance test is required for both NOx and SO2. For units with a NOx CEMS, a minimum of 9 RATA reference method runs is required at an operating load of +/- 25 percent of 100 percent load. For SO2, either a fuel sample methodology or a stack measurement can be used, depending on the chosen limit. Annual performance tests are also required for NOx and SO2.

The EPA released a draft version of a proposed rule on January 8, 2014 (rescinding the March 27, 2012 version of the rule), to establish, a new source performance standard



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 56	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

(NSPS) for GHG emissions from fossil fuel-fired electric generating units. This rule is still subject to public comments and final action by EPA, but may become part of Subpart KKKK. Therefore, SCAQMD staff has evaluated its compliance, in case it becomes final and subject to this project in its final form. This standard will require the new fossil fuel-fired power plants to meet an output based standard (based on EPA’s definition of gross output power) of 1,000 lb CO₂/MWh on an average annual basis for combined cycle generating systems (CCGS) rated over 850 mmbtu/hr heat input. At this moment the proposed rule is in draft form, pending comments that EPA is soliciting. However, any project which starts construction after the January 8, 2014 publication date will be required to meet the standard in its current form or final form if different. As calculated in Appendix F under certain operating scenarios, which assume less than the proposed maximum number of startups and shutdowns and proposed hours of normal operation, the HBEP can emit CO₂ at a rate of 1,000 lb CO₂ per net megawatt hour or less.

Compliance with the requirements of this rule is expected.

NESHAPS for Stationary Gas Turbines - 40CFR Part 63 Subpart YYYY

This regulation applies to gas turbines located at major sources of HAP emissions. A major source is defined as a facility with emissions of 10 tpy or more of a single HAP or 25 tpy or more of a combination of HAPs based on the potential to emit. Although the total combined potential HAP emissions from all 6 turbines at the site are about 21 tpy, the formaldehyde emissions from the turbines exceed 10 tpy, therefore, AES Huntington Beach is classified as a major source of HAPs, and is subject to this subpart (calculations can be referenced in Appendix L).

Subpart YYYY sets emissions limits and requires notifications, source testing, monitoring, and recordkeeping for gas turbines. EPA proposed to delist natural gas fired turbines from the NESHAPs on August 14, 2004. Thus, in accordance §63.6095(d) of this subpart natural gas fired turbines are exempt from all requirements other than the initial notification to the Administrator.

40 CFR Part 64 – Compliance Assurance Monitoring

The CAM regulation applies to emission units at major stationary sources required to obtain a Title V permit, which use control equipment to achieve a specified emission limit and which have emissions that are at least 100% of the major source thresholds on a pre-control basis. The rule is intended to provide “reasonable assurance” that the control systems are operating properly to maintain compliance with the emission limits. Based on the emission calculations shown in Appendix L, the AES Huntington Beach facility is a major source and the turbine emissions are greater than the major source thresholds for NO_x, CO, VOC, and PM₁₀, and the turbines will be subject to an emission limit for each of these pollutants. Control systems are used for NO_x, CO, and VOC, but not PM₁₀.



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 57	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

NO_x

- Emission Limit – NO_x is subject to a 2.0 ppm 1 hour BACT limit.
- Control Equipment – NO_x is controlled with the SCR
- ✓ Requirement - As a NO_x Major Source under Reclaim, the turbines are required to have CEMS under Rule 2012. The use of a continuous monitor to show compliance with an emission limit is exempt from CAM under 64.2(b)(vi).

CO

- Emission Limit – CO is subject to a 2.0 ppm 1 hour BACT limit.
- Control Equipment – CO is controlled with the oxidation catalyst.
- ✓ Requirement – The turbines will be required to use a CO CEMS under Rule 218. The use of a continuous monitor to show compliance with an emission limit is exempt from CAM under 64.2(b)(vi).

VOC

- Emission Limit – VOC is subject to a 2.0 ppm 1 hour BACT limit.
- Control Equipment – VOC is controlled with the oxidation catalyst.
- ✓ Requirement – The oxidation catalyst is effective at operating temperatures above 500°F. The facility is required to maintain a temperature gauge in the exhaust (condition D12.7), which will measure the exhaust temperature on a continuous basis and record the readings on an hourly basis. The exhaust temperature is required to be at least 500°F, (with exceptions for start ups and shutdowns). This will insure that the oxidation catalyst is operating properly.

40 CFR Part 72 - (Acid Rain Provisions)

The facility will be subject to the requirements of the federal acid rain program, because the turbines are utility units greater than 25 MW. The acid rain program is similar to RECLAIM in that facilities are required to cover SO₂ emissions with “SO₂ allowances” that are similar in concept to RTCs. The Huntington Beach facility was given initial allowance allocations based on the past operation of their boilers. AES can either use those allocations, or if insufficient, must purchase additional allocations to cover the operation of the new turbines. The applicant is also required to monitor SO₂ emissions through use of fuel gas meters and gas constituent analyses, or, if fired with pipeline quality natural gas, as in the case of the Huntington Beach facility, a default emission factor of 0.0006 lbs/mmBtu is allowed. SO₂ mass emissions are to be recorded every hour. NO_x and O₂ must be monitored with CEMS in accordance with the specifications of Part 75. Under this program, NO_x and SO_x emissions will be reported directly to the U.S. EPA. Part 75 requires that the CEMS be installed and certified within 90 days of initial startup. Compliance is expected. Note that Section K of the permit will include the Acid Rain rule references applicable to this facility, specifically Part 72 and Part 73.



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 58	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

Public Notice Requirements

The project is subject to public notice under Rule 212, and Rule 3006. Following are the notice requirements for each rule:

Rule 212

The project is subject to the noticing requirements of paragraph (g). This paragraph requires that notification follow the procedures of 40 CFR51, Section 51.161(b), and 40 CFR124, section 124.10. Rule 212(g) also requires 1) the AQMD analysis and information submitted by the operator must be available for public inspection in an area affected, 2) notice by prominent advertisement in the affected area, and 3) mailing a copy of the notice to EPA, CARB, chief executives of the city and county where the source is located, any land use agencies, State and Federal Land Managers or Indian Governing Body whose lands may be affected by the project.

In addition to the above, Section 124.10 requires that the notice be sent to Federal and State agencies with jurisdiction over fish, shellfish, and wildlife resources and over coastal zone management plans, the Advisory Council on Historic Preservation, State and Historic Preservation Officers.

The applicant must also distribute the notification to all addresses within a ¼ mile radius of the facility.

Rule 3006

In addition to the parties receiving the notice under Rules 212 and Rule 3006 requires the notice be sent to those who request in writing to be on a list and other means determined by the EO to insure adequate notice to the affected public. Rule 3006 also requires that the notice contain the following:

- i) The identity and location of the affected facility;
- (ii) The name and mailing address of the facility's contact person;
- (iii) The identity and address of the South Coast Air Quality Management District as the permitting authority processing the permit;
- (iv) The activity or activities involved in the permit action;
- (v) The emissions change involved in any permit revision;
- (vi) The name, address, and telephone number of a person who interested persons may contact to review additional information including copies of the proposed permit, the application, all relevant supporting materials, including compliance documents as defined in paragraph (b)(5) of Rule 3000, and all other materials available to the Executive Officer that are relevant to the permit decision;



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 59	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

- (vii) A brief description of the public comment procedures provided; and,
- (viii) The time and place of any proposed permit hearing that may be held or a statement of the procedures to request a proposed permit hearing if one has not already been requested.

Title V also allows for a 45 day review and comment period by the U.S. EPA.

A copy of the notice and the mailing list of those sent the notice is included in this file.

RECOMMENDATION:

Based on the forgoing analysis, it is recommended that a Permit to Construct be issued following 1) completion of the 30 day public and 45 day EPA review and comment period, 2) CEC's approval of the proposed AFC, and 3) securing all necessary emission offsets. The following conditions shall apply:

CONDITIONS:

FACILITY

F2.1

The operator shall limit emissions from this facility as follows:

CONTAMINANT	EMISSIONS LIMIT
PM	Less than 100 TONS IN ANY ONE YEAR

For purposes of this condition, the PM shall be defined as particulate matter with aerodynamic diameter of 2.5 microns or less.

For purposes of demonstrating compliance with the 100 tons per year limit the operator shall sum the PM2.5 emissions for each of the major sources at this facility by calculating a 12 month rolling average using the calendar monthly fuel use data and following emission factors for each turbine PM2.5 = 3.36 lbs/mmcf with no duct firing and PM2.5 = 5.22 lbs/mmcf with duct firing., for Boiler 1 PM2.5 = 1.86 lbs/mmcf, for Boiler 2 PM2.5 = 2.1 lbs/mmcf.

The operator may apply to change the factors, via permit application, once a different value is demonstrated, subject to SCAQMD review of testing procedures and protocols.

The operator shall submit written reports of the monthly PM2.5 compliance demonstrations required by this condition. The report submittal shall be included with the



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 60	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

semi annual Title V report as required under Rule 3004(a)(4)(f). Records of the monthly PM2.5 compliance demonstrations shall be maintained on site for at least five years and made available upon SCAQMD request.

[Rule 1325]

F52.1

This facility is subject to the applicable requirements of the following rules or regulations:

The facility shall submit a detailed retirement plan for the permanent shutdown of Huntington Beach (HB) Boilers 1 and 2 and Redondo Beach (RB) Boilers 6 and 8 describing in detail the steps and schedule that will be taken to render the boilers permanently inoperable. The retirement plan shall be submitted to SCAQMD within 60 days after the Permits to Construct for gas turbine Units 1A, 1B, 1C, 2A, 2B, and 2C are issued.

The retirement plan must be approved in writing by SCAQMD. AES shall not commence any construction of HB Boilers 1 and 2 and RB Boilers 6 and 8 repowering project equipment including gas turbines 1A, 1B, 1C, 2A, 2B, 2C, steam turbines 1 and 2, SCR/CO catalysts for gas turbines 1A, 1B, 1C, 2A, 2B, and 2C, or the oil water separator, before the retirement plan is approved in writing by SCAQMD. If SCAQMD notifies AES that the plan is not approvable, AES shall submit a revised plan addressing SCAQMD's concerns within 30 days.

Within 30 calendar days of actual shutdown , or by no later than December 31, 2018, AES shall provide SCAQMD with a notarized statement that HB Beach Boilers 1 and 2 and RB Boilers 6 and 8 are permanently shutdown and that any re start or operation of the units shall require new Permits to Construct and be subject to all requirements of non-attainment new source review and the prevention of significant deterioration program.

AES shall notify SCAQMD 30 days prior to the implementation of the approved retirement plan for permanent shutdown of HB Boilers 1 and 2 and RB Boilers 6 and 8, or advise SCAQMD as soon practicable should AES undertake permanent shutdown prior to December 31, 2018.

AES shall cease operation of RB Boilers 6 and 8 within 90 calendar days of the first fire of Units 1A, 1B, or 1C, and AES shall cease operation of HB Boilers 1 and 2 within 90 calendar days of the first fire of Units 2A, 2B, or 2C.

[Rule 1304 – Modeling and Offset Exemption]

F52.2

This facility is subject to the applicable requirements of the following rules or regulations:



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 61	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

For all circuit breakers at the facility utilizing SF6, the operator shall install, operate, and maintain enclosed-pressure SF6 circuit breakers with a maximum annual leak rate of 0.5 percent by weight. The circuit breakers shall be equipped with a 10 percent by weight leak detection system. The leak detection system shall be calibrated in accordance with manufacturer's specifications. The manufacturer's specifications and all records of calibrations shall be maintained on site.

The total CO2e emissions from all circuit breakers shall not exceed 6.8 tons per calendar year.

[Rule 1714]

GAS TURBINE

A63.5

The operator shall limit emission from this equipment as follows:

CONTAMINANT	EMISSION LIMIT
PM10	4,278.0 LBS IN ANY ONE MONTH
CO	12,776.2 LBS IN ANY ONE MONTH
VOC	7,487.2 LBS IN ANY ONE MONTH

The above limits apply after the equipment is commissioned. The above limits apply to each turbine.

The operator shall calculate compliance with the emission limit(s) by using fuel use data and the following emission factors: VOC: 2.94 lbs/mmcf, PM10: 3.36 lbs/mmcf with no DB firing, 5.22 lbs/mmcf with DB firing.

The operator may apply to change the factors, via permit application, once a different value is demonstrated, subject to SCAQMD review of testing procedures and protocols.

The operator shall calculate compliance with the emission limits for CO after the CO CEMS certification based upon readings from the SCAQMD certified CEMS.

The operator shall limit the annual firing hours for each turbine to 6370 hours including no more than 470 hours with duct firing (this does not include start up and shutdown hours).

[Rule 1303 – Offsets]



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 62	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

A63.6

The operator shall limit emission from this equipment as follows:

CONTAMINANT	EMISSION LIMIT
PM10	2,930 LBS IN ANY ONE MONTH
CO	112,882 LBS IN ANY ONE MONTH
VOC	14,121 LBS IN ANY ONE MONTH

The above limits apply during commissioning. The above limits apply to each turbine.

The operator shall calculate compliance with the emission limit(s) by using fuel use data and the following emission factors: VOC: 21.74 lbs/mmcf, PM10: 4.51 lbs/mmcf, and CO: 173.80 lbs/mmcf.

A99.4

The 12.75 LBS/MMCF NOx emission limits shall only apply during turbine operation prior to CEMS certification for reporting NOx emissions.

[Rule 2012]

A195.6

The 2.0 PPMV NOX emission limit(s) is averaged over 60 minutes at 15 percent O2, dry. This limit shall not apply during commissioning, turbine start ups and turbine shutdowns.

[Rule 1703-PSD, Rule 2005]

A195.7

The 2.0 PPMV CO emission limit(s) is averaged over 60 minutes at 15 percent O2, dry. This limit shall not apply during commissioning, turbine start ups and turbine shutdowns.

[Rule 1703-PSD]

A195.8

The 2.0 PPMV VOC emission limit(s) is averaged over 60 minutes at 15 percent O2, dry. This limit shall not apply during commissioning, turbine start ups and turbine shutdowns.

[Rule 1303(a) – BACT, Rule 1303(b)(2) - Offsets]

A327.1

For the purpose of determining compliance with District Rule 475, combustion contaminants emissions may exceed the concentration limit or the mass emission limit listed, but not both limits at the same time.

[Rule 475]



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 63	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

B61.1

The operator shall not use natural gas containing the following specified compounds:

Compound	Grains per 100 scf
H ₂ S	Greater than 0.25

This concentration limit is an annual average based on monthly sample of natural gas composition or gas supplier documentation. Gaseous fuel samples shall be tested using District Method 307-91 for total sulfur calculated as H₂S.

[Rule 1303(b) – Offset]

C1.7

The operator shall limit the number of start ups to no more than 90 in any one calendar month.

The number of cold start ups shall not exceed 5 per months, the number of warm start ups shall not exceed 25 per month, and the number of hot start ups shall not exceed 60 per month.

For the purposes of this condition: A cold start up is defined as a start up which occurs after the steam turbine has been shutdown for 49 hours or more. A cold start up shall not exceed 90 minutes. Emissions from a cold start up shall not exceed the following: NO_x - 29 lbs., CO - 116 lbs., VOC - 28 lbs.

A warm start up is defined as a start up which occurs after the steam turbine has been shutdown for 9 - 49 hours. A warm start up shall not exceed 32.5 minutes. Emissions from a warm start up shall not exceed the following: NO_x - 17 lbs., CO - 46 lbs., VOC - 21 lbs.

A hot start up is defined as a start up which occurs after the steam turbine has been shutdown for less than 9 hours. A hot start up shall not exceed 32.5 minutes. Emissions from a hot start up shall not exceed the following: NO_x - 17 lbs., CO - 34 lbs., VOC - 21 lbs.

The beginning of a start up occurs at initial fire in the combustor and the end of start up occurs when the BACT levels are achieved. If during start up the process is aborted the process will count as one start up.

The operator shall maintain records, in a manner approved by the SCAQMD to demonstrate compliance with this condition.

[Rule 2005]



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 64	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

C1.8

The operator shall limit the number of shutdowns to no more than 90 in any one calendar month.

Shutdown time shall not exceed 10 minutes per shutdown. Emissions from a shutdown shall not exceed the following: NOx - 9 lbs., CO - 46 lbs., VOC - 31 lbs.

The operator shall maintain records, in a manner approved by the SCAQMD to demonstrate compliance with this condition.

[Rule 2005]

C1.9

The operator shall limit the power output of the plant to no more than 939 MWs

The 939 MW limit is based on the net power output.

The net electrical output shall be measured at the breaker of the transmission system interconnection point in the generation switchyard. The monitoring equipment shall meet ANSI Standard No. C12 or equivalent, and have an accuracy of +/-0.2 percent.

The net electrical output from each meter shall be recorded at the CEMS DAS

The operator shall maintain records, for a minimum of five years, in a manner approved by the SCAQMD to demonstrate compliance with this condition.

[Rule 1304 - Modeling and Offset Exemption]

C1.10

The operator shall limit the power output of the plant to no more than 972 MWs

The 972 MW limit is based on the gross power output.

The gross electrical output shall be measured at the each of the 8 generators. The monitoring equipment shall meet ANSI Standard No. C12 or equivalent, and have an accuracy of +/-0.2 percent.

The gross electrical output from generators shall be recorded at the CEMS DAS

The operator shall maintain records, for a minimum of five years, in a manner approved by the SCAQMD to demonstrate compliance with this condition.

[Rule 1304 - Modeling and Offset Exemption]



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 65	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

D29.5

The operator shall conduct source test(s) for the pollutant(s) identified below.

Pollutant to be tested	Required Test Method(s)	Averaging Time	Test Location
NOX emissions	District Method 100.1	1 hour	Outlet of the SCR
CO emissions	District Method 100.1	1 hour	Outlet of the SCR
SOX emissions	Approved District method	District approved averaging time	Fuel Sample
VOC emissions	Approved District method	1 hour	Outlet of the SCR
PM10 emissions	Approved District method	District approved averaging time	Outlet of the SCR
PM2.5	Approved District method	District approved averaging time	Outlet of the SCR
NH3 emissions	District method 207.1 and 5.3 or EPA method 17	1 hour	Outlet of the SCR

The test shall be conducted after SCAQMD approval of the source test protocol, but no later than 180 days after initial start-up. The SCAQMD shall be notified of the date and time of the test at least 10 days prior to the test.

The test shall be conducted to determine the oxygen levels in the exhaust. In addition, the tests shall measure the fuel flow rate (CFH), the flue gas flow rate, and the turbine generating output in MW net and MW gross.

The test shall be conducted in accordance with an SCAQMD approved test protocol. The protocol shall be submitted to the SCAQMD engineer no later than 45 days before the proposed test date and shall be approved by the SCAQMD before the test commences. The test protocol shall include the proposed operating conditions of the turbine during the tests, the identity of the testing lab, a statement from the testing lab certifying that it meets the criteria of Rule 304, and a description of all sampling and analytical procedures.

The test shall be conducted when this equipment is operating at loads of 100 and 70 percent without duct firing, and 100 percent with duct firing.



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 66	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

For natural gas fired turbines only, VOC compliance shall be demonstrated as follows: a) Stack gas samples are extracted into Summa canisters maintaining a final canister pressure between 400-500 mm Hg absolute, b) Pressurization of canisters are done with zero gas analyzed/certified to contain less than 0.05 ppmv total hydrocarbon as carbon, and c) Analysis of canisters are per EPA Method TO-12 (with pre concentration) and temperature of canisters when extracting samples for analysis is not below 70 deg F.

The use of this alternative method is solely for the determination of compliance with the VOC BACT level of 2.0 ppmv calculated as carbon for natural gas fired turbines. The results shall be reported with two significant digits.

[Rule 1303(a)(1) – BACT, Rule 1303(b)(2) – Offset, Rule 1703-PSD, Rule 2005]

D29.6

The operator shall conduct source test(s) for the pollutant(s) identified below.

Pollutant to be tested	Required Test Method(s)	Averaging Time	Test Location
NH3 emissions	District method 207.1 and 5.3 or EPA method 17	1 hour	Outlet of the SCR

The test shall be conducted and the results submitted to the District within 60 days after the test date. The SCAQMD shall be notified of the date and time of the test at least 10 days prior to the test.

The test shall be conducted at least quarterly during the first twelve months of operation and at least annually thereafter. The NOx concentration, as determined by the CEMS, shall be simultaneously recorded during the ammonia slip test. If the CEMS is inoperable, a test shall be conducted to determine the NOx emissions using District Method 100.1 measured over a 60 minute averaging time period.

The test shall be conducted to demonstrate compliance with the Rule 1303 concentration limit

[Rule 1303(a)(1) – BACT]



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 67	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

D29.7

The operator shall conduct source test(s) for the pollutant(s) identified below.

Pollutant to be tested	Required Test Method(s)	Averaging Time	Test Location
SOX emissions	Approved District method	District approved averaging time	Fuel Sample
VOC emissions	Approved District method	1 hour	Outlet of the SCR
PM10 emissions	Approved District method	District approved averaging time	Outlet of the SCR

The test shall be conducted at least once every three years.

The test shall be conducted and the results submitted to the SCAQMD within 60 days after the test date. The SCAQMD shall be notified of the date and time of the test at least 10 days prior to the test.

The test shall be conducted when this equipment is operating at 100 percent of maximum heat input.

For natural gas fired turbines only, VOC compliance shall be demonstrated as follows: a) Stack gas samples are extracted into Summa canisters maintaining a final canister pressure between 400-500 mm Hg absolute, b) Pressurization of canisters are done with zero gas analyzed/certified to contain less than 0.05 ppmv total hydrocarbon as carbon, and c) Analysis of canisters are per EPA Method TO-12 (with pre concentration) and temperature of canisters when extracting samples for analysis is not below 70 deg F.

The use of this alternative method is solely for the determination of compliance with the VOC BACT level of 2.0 ppmv calculated as carbon for natural gas fired turbines. The results shall be reported with two significant digits.

The test shall be conducted to demonstrate compliance with the Rule 1303 concentration and/or monthly emission limit.

[Rule 1303(a)(1) – BACT, Rule 1303(b)(2) – Offset, Rule 475]

D82.1

The operator shall install and maintain a CEMS to measure the following parameters:



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 68	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

CO concentration in ppmv

Concentrations shall be corrected to 15 percent oxygen on a dry basis. The CEMS shall be installed and operating no later than 90 days after initial startup of the turbine, in accordance with approved SCAQMD Rule 218 CEMS plan application. The operator shall not install the CEMS prior to receiving initial approval from SCAQMD.

The CEMS shall be installed and operated to measure the CO concentration over a 15 minute averaging time period.

The CEMS shall convert the actual CO concentrations to mass emission rates (lbs/hr) using the equation below and record the hourly emission rates on a continuous basis.

$$\text{CO Emission Rate, lbs/hr} = K * C_{co} * F_d \left[\frac{20.9}{20.9\% - \%O_2} \right] \left[\frac{Q_g * HHV}{10E6} \right], \text{ where}$$

- K = $7.267 * 10^{-8}$ (lbs/scf)/ppm
- C_{co} = Average of 4 consecutive 15 min. average CO concentrations, ppm
- F_d = 8710 dscf/MMBTU natural gas
- %O₂, d = Hourly average % by volume O₂ dry, corresponding to C_{co}
- Q_g = Fuel gas usage during the hour, scf/hr
- HHV = Gross high heating value of the fuel gas, BTU/scf

[Rule 1303 – BACT, Rule 1703-PSD]

D82.2

The operator shall install and maintain a CEMS to measure the following parameters:

NO_x concentration in ppmv

Concentrations shall be corrected to 15 percent oxygen on a dry basis. The CEMS shall be installed and operating no later than 90 days after initial startup of the turbine, in accordance with approved SCAQMD REG XX CEMS plan application. The operator shall not install the CEMS prior to receiving initial approval from SCAQMD.

Rule 2012 provisional RATA testing shall be completed and submitted to the SCAQMD within 90 days of the conclusion of the turbine commissioning period. During the interim period between the initial start up and the



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 69	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

provisional certification date of the CEMS, the operator shall comply with the requirements of Rule 2012(h)(2) and 2012(h)(3).

[Rule 1703 – PSD, Rule 2005, Rule 2012]

E193.3

The operator shall install this equipment according to the following requirements:

Construction shall commence within 12 months of the date of the permit to construct unless the permit is extended, but in no case should the start of construction exceed 18 months from the date of the permit to construct.

Construction shall not be discontinued for a period of 18 months or more.

[Rule 205, 40 CFR Part 52]

E193.4

The operator shall upon completion of the construction, operate and maintain this equipment according to the following specifications:

In accordance with all mitigation measures stipulated in the final California Energy Commission decision for the 12-AFC-02 project.

[CEQA]

E193.5

The operator shall install this equipment according to the following requirements:

Total commissioning hours shall not exceed 491 hours of operation for each turbine from the date of initial turbine start up. Total commissioning hours without control shall not exceed 47 hours of operation for each turbine. Only one turbine shall undergo steam blows at any one time and at a load of no more than 50%. During steam blows, the other two turbines in the block shall not be fired. During all other commissioning activities outside of steam blows, a maximum of 2 turbines may be operated at any one time.

The operator shall vent this equipment to the CO oxidation catalyst and SCR control system whenever the turbine is in operation after commissioning.

The operator shall provide SCAQMD with written notification of the initial start up date. Written records of commissioning, start ups, and shutdowns shall be maintained and be made available upon request from SCAQMD.

[Rule 1303 – BACT, Rule 1303 – Offsets, Rule 1703 – PSD, Rule 2005]

E193.6

The operator shall upon completion of the construction, operate and maintain this equipment according to the following specifications:



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 70	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

The operator shall record the total net power generated in a calendar month in megawatt-hours.

The operator shall calculate and record greenhouse gas emissions for each calendar month using the following formula:

$$GHG = 60.08 * FF$$

Where, GHG is the greenhouse gas emissions in tons of CO2 and FF is the monthly fuel usage in millions standard cubic feet.

The operator shall calculate and record the GHG emissions in pounds per net megawatt-hour on a 12-month rolling average. The GHG emissions from this equipment shall not exceed 652,827 tons per year per turbine on a 12-month rolling average basis. The calendar annual average GHG emissions shall not exceed 1,053.7 lbs per net megawatt-hour (1,138.0 lbs per net megawatt hour inclusive of equipment degradation).

The operator shall maintain records in a manner approved by the SCAQMD to demonstrate compliance with this condition. The records shall be made available to SCAQMD upon request.

[Rule 1714]

E193.7

The operator shall upon completion of the construction, operate and maintain this equipment according to the following specifications:

The operator shall record the total gross power generated in a calendar month in megawatt-hours.

The operator shall calculate and record greenhouse gas emissions for each calendar month using the following formula:

$$GHG = 60.08 * FF$$

Where, GHG is the greenhouse gas emissions in tons of CO2 and FF is the monthly fuel usage in millions standard cubic feet.

The operator shall calculate and record the GHG emissions in pounds per gross megawatt-hour on a 12-month rolling average. The calendar annual average GHG emissions shall not exceed 1,000 lbs per gross megawatt-hour, or the applicable limit which is published in the final EPA rule.



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 71	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

The operator shall maintain records in a manner approved by the SCAQMD to demonstrate compliance with this condition. The records shall be made available to SCAQMD upon request.

[40 CFR60 Subpart KKKK]

I298.1

This equipment shall not be operated unless the facility holds 39,854 pounds of NO_x RTCs in its allocation account to offset the annual emissions increase for the first year of operation. The RTCs held to satisfy the first year of operation portion of this condition may be transferred only after one year from the initial start of operation. In addition, this equipment shall not be operated unless the operator demonstrates to the Executive Officer that, at the commencement of each compliance year after the start of operation, the facility holds 62,507 pounds of NO_x RTCs valid during that compliance year. RTCs held to satisfy the compliance year portion of this condition may be transferred only after the compliance year for which the RTCs are held. If the initial or annual hold amount is partially satisfied by holding RTCs that expire midway through the hold period, those RTCs may be transferred upon their respective expiration dates. This hold amount is in addition to any other amount of RTCs required to be held under other condition(s) stated in this permit.

[Rule 2005]

I298.2

This equipment shall not be operated unless the facility holds 2,694 pounds of SO_x RTCs in its allocation account to offset the annual emissions increase for the first year of operation. The RTCs held to satisfy the first year of operation portion of this condition may be transferred only after one year from the initial start of operation. In addition, this equipment shall not be operated unless the operator demonstrates to the Executive Officer that, at the commencement of each compliance year after the start of operation, the facility holds 3,798 pounds of SO_x RTCs valid during that compliance year. RTCs held to satisfy the compliance year portion of this condition may be transferred only after the compliance year for which the RTCs are held. If the initial or annual hold amount is partially satisfied by holding RTCs that expire midway through the hold period, those RTCs may be transferred upon their respective expiration dates. This hold amount is in addition to any other amount of RTCs required to be held under other condition(s) stated in this permit.

[Rule 2005]

K40.3

The operator shall provide to the District a source test report in accordance with the following specifications:



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 72	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

Source test results shall be submitted to the District no later than 60 days after the source tests required under conditions D29.1, D29.2, and D29.3 are conducted.

Emission data shall be expressed in terms of concentration (ppmv) corrected to 15 percent oxygen (dry basis), mass rate (lb/hr), and lb/MMCF. In addition, solid PM emissions, if required to be tested, shall also be reported in terms of grains/DSCF.

All exhaust flow rate shall be expressed in terms of dry standard cubic feet per minute (DSCFM) and dry actual cubic feet per minute. All moisture concentration shall be expressed in terms of percent corrected to 15 percent oxygen.

Source test results shall also include the oxygen levels in the exhaust, fuel flow rate (CFH), the flue gas temperature, and the generator power output (MW) under which the test was conducted.

[Rule 1303(a)(1) – BACT, Rule 1303(b)(2) – Offset]

K67.5

The operator shall keep records in a manner approved by the District, for the following parameter(s) or item(s):

- Commissioning hours and type of control and fuel use
- Date, time, and duration of each start-up and shutdown, and the type of start up (cold, warm, or hot).
- In addition to the requirements of a certified CEMS, natural gas fuel use records shall be kept during and after the commissioning period and prior to CEMS certification
- Minute by minute data (NO₂ and O₂ concentration and fuel flow rate at a minimum) for each turbine start up
- Monthly number of hours each turbine is operated with duct firing
- Total annual power output in MWh

[Rule 1303(b)(2) - Offsets]

DUCT BURNER

I298.3

This equipment shall not be operated unless the facility holds 13,488 pounds of NO_x RTCs in its allocation account to offset the annual emissions increase for the first year of operation. The RTCs held to satisfy the first year of operation portion of this condition may be transferred only after one year from the initial start of operation. In addition, this equipment shall not be operated unless the operator demonstrates to the Executive Officer that, at the commencement of each compliance year after the start of operation, the facility holds 21,155 pounds of NO_x RTCs valid during that compliance year. RTCs held



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 73	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

to satisfy the compliance year portion of this condition may be transferred only after the compliance year for which the RTCs are held. If the initial or annual hold amount is partially satisfied by holding RTCs that expire midway through the hold period, those RTCs may be transferred upon their respective expiration dates. This hold amount is in addition to any other amount of RTCs required to be held under other condition(s) stated in this permit.

[Rule 2005]

I298.4

This equipment shall not be operated unless the facility holds 912 pounds of SOx RTCs in its allocation account to offset the annual emissions increase for the first year of operation. The RTCs held to satisfy the first year of operation portion of this condition may be transferred only after one year from the initial start of operation. In addition, this equipment shall not be operated unless the operator demonstrates to the Executive Officer that, at the commencement of each compliance year after the start of operation, the facility holds 1,286 pounds of SOx RTCs valid during that compliance year. RTCs held to satisfy the compliance year portion of this condition may be transferred only after the compliance year for which the RTCs are held. If the initial or annual hold amount is partially satisfied by holding RTCs that expire midway through the hold period, those RTCs may be transferred upon their respective expiration dates. This hold amount is in addition to any other amount of RTCs required to be held under other condition(s) stated in this permit.

[Rule 2005]

SCR

A195.9

The 5 ppmv NH3 emission limit is averaged over 60 minutes at 15% O2, dry basis. The operator shall calculate and continuously record the NH3 slip concentration using the following:

$$\text{NH3 (ppmv)} = [a - b * (c * 1.2) / 1E+06] * 1E+06 / b$$

where,

a = NH3 injection rate (lbs/hr)/17(lb/lb-mol)

b = dry exhaust gas flow rate (scf/hr)/385.3 scf/lb-mol)

c = change in measured NOx across the SCR (ppmvd at 15% O2)

The operator shall install and maintain a NOx analyzer to measure the SCR inlet NOx ppmv accurate to plus or minus 5 percent calibrated at least once every twelve months. The NOx analyzer shall be installed and operated within 90 days of initial start-up.



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 74	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

The operator shall use the above described method or another alternative method approved by the Executive Officer.

The ammonia slip calculation procedures described above shall not be used for compliance determination or emission information without corroborative data using an approved reference method for the determination of ammonia.

[Rule 1303(a)(1) – BACT]

D12.7

The operator shall install and maintain a(n) flow meter to accurately indicate the flow rate of the total hourly throughput of injected ammonia.

The operator shall also install and maintain a device to continuously record the parameter being measured.

The measuring device or gauge shall be accurate to within plus or minus 5 percent. It shall be calibrated once every twelve months.

The injected ammonia rate shall be maintained within 11.8 gal/min and 33 gal/min except during start ups and shutdowns

[Rule 1303(a)(1) – BACT]

D12.8

The operator shall install and maintain a(n) temperature gauge to accurately indicate the temperature in the exhaust at the inlet to the SCR reactor.

The operator shall also install and maintain a device to continuously record the parameter being measured.

The measuring device or gauge shall be accurate to within plus or minus 5 percent. It shall be calibrated once every twelve months.

The exhaust temperature at the inlet of the SCR shall be maintained between 400-700 deg F except during start up and shutdowns

[Rule 1303(a)(1) – BACT]

D12.9

The operator shall install and maintain a(n) pressure gauge to accurately indicate the differential pressure across the SCR catalyst bed in inches of water column.

The operator shall also install and maintain a device to continuously record the parameter being measured.

The measuring device or gauge shall be accurate to within plus or minus 5 percent. It shall be calibrated once every twelve months.

The differential pressure shall be maintained between 1.5 “ WC and 3.5 “ WC.

[Rule 1303(a)(1) – BACT]



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 75	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

E179.4

For the purpose of the following condition number(s), continuously record shall be defined as recording at least once every hour and shall be calculated based upon the average of the continuous monitoring for that hour.

Condition Number D12.7

Condition Number D12.8

[Rule 1303(a)(1) – BACT]

E179.5

For the purpose of the following condition numbers, continuous monitoring shall be defined as measuring at least once every month and shall be calculated based upon the average of the continuous monitoring for that month.

Condition Number: D12.9

[Rule 1303(a)(1) – BACT]

E193.4

The operator shall upon completion of the construction, operate and maintain this equipment according to the following specifications:

In accordance with all mitigation measures stipulated in the final California Energy Commission decision for the 12-AFC-2 project.

[CEQA]

CO Catalyst

D12.10

The operator shall install and maintain a(n) temperature gauge to accurately indicate the temperature in the exhaust at the inlet to the CO Catalyst.

The operator shall also install and maintain a device to continuously record the parameter being measured.

The measuring device or gauge shall be accurate to within plus or minus 5 percent. It shall be calibrated once every twelve months.

The exhaust temperature at the inlet of the CO Catalyst shall be maintained at a minimum of 500 deg F, except during start up and shutdowns.

[Rule 1303(a)(1) - BACT]

Ammonia Storage Tank

E144.1



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 76	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

The operator shall vent this equipment, during filling, only to the vessel from which it is being filled.

[Rule 1303(a)(1)-BACT]

C157.1

The operator shall install and maintain a pressure relief valve set at 50 psig.

[Rule 1303(a)(1)-BACT]

E193.4

The operator shall upon completion of the construction, operate and maintain this equipment according to the following specifications:

In accordance with all mitigation measures stipulated in the final California Energy Commission decision for the 12-AFC-2 project.

[CEQA]



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 77	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

**Huntington Beach Energy Project
List of Appendices**

1. Appendix A – Turbine Criteria Pollutant Emission Calculations
 - Normal Operation
 - Start Up Emissions
 - Shutdown Emission
 - Maximum Hourly
 - Maximum Daily Emissions
 - 30- Day Average Emissions
2. Appendix B – Commissioning Calculations
 - Commissioning Emissions
 - Annual Emissions
3. Appendix C – Air Toxic Emission Calculations
4. Appendix D – Existing Boilers’ Emissions
5. Appendix E – Modeling
6. Appendix G – Facility Plot Plan
7. Appendix H – Plant Elevation View
8. Appendix I – Process Flow
9. Appendix J – Nearest Schools
10. Appendix K – Existing Facility Reported Emissions
11. Appendix L – Major Source Determinations
12. Appendix M – Reclaim NOx Reporting Factor
13. Appendix O – Existing Boilers Historical Power Generation
14. Appendix P – RECLAIM Trading Credit Requirement
15. Appendix Q – Modeling Review Memo



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 78	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

Appendix A

Turbine Criteria Pollutant Emission Calculations

Normal Operation

➤ Table A.1 Manufacturer Guaranteed Emissions

Pollutant	Guarantee
NOx	2.0 ppm @15%
CO	2.0 ppm @ 15%
VOC	2.0 ppm @ 15%
PM10	4.5 lbs/hr no duct firing, 9.5 lbs/hr with duct firing
SOx	No guarantee
NH3	5 ppm @ 15%

NOx guarantee is for loads above 60%

Short term (lbs/hr, lbs/day and lbs/month) SOx emissions are based on 12 ppm sulfur in the natural gas (0.75 gr/100 scf), long term (annual) SOx based on 4 ppm sulfur (0.25 gr/100 scf).



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE
79

APPL NO.
See Below
PROCESSED BY
CP01

PAGES
141

DATE
4/1/14
CHECKED BY

Table A.2 Gas Turbine Performance Data

Ambient Conditions	65°F 65%	65°F 65%	62°F 65.7%
Fuel Type	Nat Gas	Nat Gas	Nat Gas
Evaporative Cooling On/Off	On	On	Off
O2 Percent (wet exhaust, mole basis)	10.94	11.07	11.30
H2O Percent	10.59	10.09	9.12
Exhaust Temp, °F	358.9	358	362.7°F
CT Gross Output, MW	114.505	121.048	131.469
Gross Heat Rate (HHV)	11,482	11,315	11,106
Turbine Heat Input, mmbtu/hr (HHV)	1,350	1,403	1,498
Turbine Fuel Use, mmscf/hr	1.29	1.34	1.43
Duct Burner Heat Rate, mmbtu/hr	507	507	507
Duct Burner Fuel Consumption, mmscf/hr	0.48	0.48	0.48
Stack Exhaust Flow, acfm	1093.4	1132.4	1209.7
Stack Exhaust Flow, ft3/hr (dry, @15%O2)	62,874,000	64,698,000	67,841,000
Gross Output, MW (1 CTG)	158.896	172.032	181.835
Net Output, MW (1 CTG)	153.352	166.328	175.925
	NOx		
Concentration, ppmv @ 15% O2	2.0	2.0	2.0
Hourly Emissions, lb/hr	15.02	15.46	16.21
Daily Emissions, lb/day	360.48	371.04	389.04
lbs/mmcf (incl DB)	8.49	8.49	8.49
lbs/mmbtu (incl DB)	0.0081	0.0081	0.0081
lbs/gross MW-hr (1 CTG)	0.095	0.090	0.089
Lbs/net MW-hr (1 CTG)	0.098	0.093	0.092
	CO		
Concentration, ppmv @ 15% O2	2.0	2.0	2.0
Hourly Emissions, lb/hr	9.15	9.41	9.87
Daily Emissions, lb/day	219.6	225.84	236.88
lbs/mmcf (incl DB)	5.17	5.17	5.17
lbs/mmbtu (incl DB)	0.0049	0.0049	0.0049
	VOC		
Concentration, ppmv, @ 15% O2	2.0	2.0	2.0
Hourly Emissions, lb/hr	5.22	5.38	5.64
Daily Emissions, lb/day	125.28	129.12	135.36
lbs/mmcf (incl DB)	2.94	2.94	2.94
lbs/mmbtu (incl DB)	0.0028	0.0028	0.0028



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 80	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

Table A.2 Normal Operation Emissions (continued)

Ambient Conditions	110°F, 79% RH	65.8°F, 65% RH	32°F, 86.7% RH
Fuel Type	Nat Gas	Nat Gas	Nat Gas
Evaporative Cooling On/Off	On	On	Off
O2 Percent (dry exhaust)	10.94	11.07	11.30
H2O Percent	10.59	10.09	9.12
Exhaust Temp, °F	358.9	358	362.7°F
CT Gross Output, MW	114.505	121.048	131.469
Gross Heat Rate (HHV)	11,482	11,315	11,106
Turbine Heat Input, mmbtu/hr (HHV)	1,350	1,403	1,498
Turbine Fuel Use, mmscf/hr	1.29	1.34	1.43
Duct Burner Heat Rate, mmbtu/hr	507	507	507
Duct Burner Fuel Consumption, mmscf/hr	0.48	0.48	0.48
Stack Exhaust Flow, dscfm	1093.4	1132.4	1209.7
Stack Exhaust Flow, ft3/hr (dry, @15%O2)	62,874,000	64,698,000	67,841,000
Gross Output, MW (1 CTG)	158.896	172.032	181.835
Net Output, MW (1 CTG)	153.352	166.328	175.925
SOX			
Concentration, ppmv, @ 15% O2	0.27	0.27	0.27
Hourly Emissions, lb/hr	2.83	2.91	3.05
Daily Emissions, lb/day	67.92	69.84	73.2
lbs/mmcf (incl DB)	1.60	1.60	1.60
lbs/mmbtu (incl DB)	0.0015	0.0015	0.0015
PM10			
Hourly Emissions, lb/hr (not incl DB)	4.50	4.50	4.50
Daily Emissions, lb/day	108	108	108
Hourly Emissions, lb/hr (incl DB)	9.50	9.50	9.50
lbs/mmcf (not incl DB)	3.49	3.36	3.15
lbs/mmcf (incl DB)	5.37	5.22	4.97
lbs/mmbtu (not incl DB)	0.0033	0.0032	0.0030
lbs/mmbtu (incl DB)	0.0051	0.0050	0.0047
NH3			
Concentration, ppm	5	5	5
Hourly Emissions, lb/hr	14.1	14.5	15.2
Daily Emissions, lb/day	338.4	348.0	364.8

- calculated using combined heat input turbine + DB * 8170 * 3.54
- emissions are assumed to be maximum permitted levels for each case



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 81	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

Exhaust gas calculation:

$$1209.7(1-.0912)(520/362.7+460) = 694.9E+3 \text{ cfm, dry @ stack O}_2$$

$$694.9E+3 * [(20.9-11.30)/(20.9-15)] = 1130.7E+3 \text{ dscfm} = 67.841 \text{ mmscfh}$$

SOx calculation:

*Short term (hourly, daily, and monthly) SOx concentration is based on a fuel H2S content of 0.75 grains/100 scf (approximately 12 ppm) which converts to SOx per mmcf fuel as follows: 0.75 grains/ 100 scf(lb/7000 grains)(64 lbs/lb-mole SO2/34 lbs/lb-mole H2S)(1E6 cf/mmcf) = 2.02 lbs/mmcf. The actual emission rate used by AES assumes a 30% conversion of SO2 to SO3 (from oxidation catalyst): 2.02*0.7 = 1.41 lbs/mmcf*

*Long term (annual) SOx concentration is based on a fuel H2S content of 0.25 grains/100 scf (approximately 4 ppm) which converts to SOx per mmcf fuel as follows: 0.25 grains/ 100 scf(lb/7000 grains)(64 lbs/lb-mole SO2/34 lbs/lb-mole H2S)(1E6 cf/mmcf) = 0.67 lbs/mmcf. The actual emission rate used by AES assumes a 30% conversion of SO2 to SO3 (from oxidation catalyst): 0.67*0.7 = 0.47 lbs/mmcf*

Emission Rates Normal Operation

The following calculation procedure will be used to estimate the highest hourly emission rate (low temperature case) and the average hourly emission rate (annual average temperature case) during normal operation. Although the emissions differ from what is reported by AES in Table A.2, the calculations below are based on a standard F factor methodology.

Low Temperature Case			
Heat Input @ 32 deg F, turbine	=	1498 mmbtu/hr	
Heat Input @ 32 deg F, duct burner	=	507 mmbtu/hr	
Exhaust flow @ 32 deg F w/o DB	=	1498*8710*3.54	= 46.2 mmscf/hr
Exhaust flow @ 32 deg F w/DB	=	2005*8710*3.54	= 61.8 mmscf/hr
Fuel use @ 32 deg F w/o DB	=	1498/1020	= 1.47 mmscf/hr
Fuel use @ 32 deg F w/DB	=	2005/1020	= 1.97 mmscf/hr

Average Temperature Case			
Heat Input @ 66 deg F, turbine	=	1403 mmbtu/hr	
Heat Input @ 66 deg F, duct burner	=	507 mmbtu/hr	
Exhaust flow @ 66 deg F w/o DB	=	1403*8710*3.54	= 43.3 mmscf/hr
Exhaust flow @ 66 deg F w/DB	=	1910*8710*3.54	= 58.9 mmscf/hr
Fuel use @ 66 deg F w/o DB	=	1403/1020	= 1.38 mmscf/hr
Fuel use @ 66 deg F w/DB	=	1910/1020	= 1.87 mmscf/hr



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 82	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

Table A.3 Maximum Hour

Pollutant	Concentration	Mass Emission Rate w/o DB	Mass Emission Rate w/ DB
	ppm	lbs/hr	lbs/hr
NOx ⁽¹⁾	9.0/2.0	30.3/11.0	66.6/14.8
CO ⁽¹⁾	10.0/2.0	33.5/6.7	45.0/9.0
VOC	2.0	3.8	5.1
PM10	////////	4.5	9.5
SOx	0.27 (1.41 lbs/mmcf)	2.08	2.78
NH3	5.0	10.3	13.8

(1) with DLN only/DLN + SCR

Sample Calculations:

NOx (2.0 ppm*61.8 mmcf/hr*46 lbs/lb-mole)/385 cf/lb-mole = 14.8 lbs/hr
w/DB DLN+SCR

SO2 (0.27 ppm*46.2 mmcf/hr*64.1 lbs/lb-mole)/385 cf/lb-mole = 2.08 lbs/hr
w/oDB

Table A.4 Average Hour

Pollutant	Concentration	Mass Emission Rate w/o DB	Mass Emission Rate w/ DB
	ppm	lbs/hr	lbs/hr
NOx ⁽¹⁾	9.0/2.0	46.6/10.3	63.3/14.1
CO ⁽¹⁾	10.0/2.0	31.5/6.3	42.8/8.6
VOC	2.0	3.6	4.9
PM10	////////	4.5	9.5
SOx	0.27 (1.41 lbs/mmcf)	1.9	2.6
NH3	5.0	9.6	13.0

(2) with DLN only/DLN + SCR

Sample Calculations:

NOx (2.0 ppm*58.9 mmcf/hr*46 lbs/lb-mole)/385 cf/lb-mole = 14.1 lbs/hr
w/DB DLN+SCR

Start Up Operation

There are 3 basic types of starts – cold, warm, and hot. A cold start up is defined as a start of the CT that occurs when the system is at ambient temperature, which would typically occur after a period of 49 hours or more from the last shutdown. The turbine will ramp to 70% load within 10 minutes from the fuel initiation, and the Dry Low NOx (DLN) combustors will reduce NOx to 9 ppm within 8-9 minutes. The SCR will become functional after about 12.5 minutes, and begin to control NOx



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 83	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

emissions at about a 70% efficiency. Typically, the BACT emission levels will be achieved within 60 minutes from the beginning of a cold start. The total time to reach the baseload operating rate is conservatively expected to take 90 minutes.

A warm start occurs after a shutdown lasting 9 to 49 hours. The warm start will take about 32.5 minutes to complete.

A hot start occurs after a shutdown of less than 9 hours. Approximate time to complete a hot start is also 32.5 minutes.

The steam turbine generator produces power in approximately 20 minutes for a warm or hot start and in 85 minutes for a cold start from the time fuel combustion is initiated.

The turbines can be shutdown in 10 minutes.

HBEP anticipates about 24 cold, 150 warm, and 450 hot starts per year.

The combustion turbine (CT) start up is initiated by mechanically turning the compressor/turbine rotor to a starting speed. Once rotor starting speed is achieved, fuel combustion is initiated and, after a short stabilization period, the rotor speed is accelerated to rated speed (3,600 revolutions per minute), or full speed – no load (FSNL) condition. After FSNL is achieved, the CT electrical generator is synchronized to the phase of electrical grid and the turbine load is increased. At approximately 70 percent turbine load, the dry low nitrogen oxides (NOX) combustors revert from the starting mode to the pre-mix mode where they are capable of achieving 9 parts per million (ppm) NOX and 10 ppm CO emissions.

The steam bypass system is used to match the steam conditions to the steam turbine (ST) requirements and a de-coupling of the HRSG from the ST, which enables the short and simplified start-up and operation of the unit. After the CT is started, the HRSGs start producing steam. When the steam is of sufficient quantity and quality, steam is gradually introduced to the ST. Each HRSG is fitted with a non-return valve and steam sparge line that provides a small amount of steam to the off-service HRSG(s) within the power block. This minimizes the amount of time needed to warm the other HRSG(s) within the power block, allowing the selective catalytic reduction and CO catalysts to reach nominal operating temperature quickly. It is expected that, during staged operation (meaning at least one CT is operating), these components will be maintained at nominal temperature reducing the time required for a start up and minimizing start up emissions.

Shutdown of the power island is fully automatic. Once a shutdown is initiated, the operating CT is unloaded; the generator breakers open automatically and the CT initiates a cool-down and coast-down cycle. Simultaneously, as the CT load is reduced, HRSG steam production is reduced and eventually the steam pressure is reduced. To achieve the fast start times, an ST shutdown is desired from the highest possible pressure to ensure the HRSG remains hot or warm. After CT and ST are electrically



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 84	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

disconnected from the grid, the turbine control systems will automatically engage a turning gear; after the turbine rotors have coasted to a stop, the power block will be ready to re-start.

Following is a minute-by minute accounting of the cold start up operation.

Table A.5 Cold Start Emissions Data

Time minutes	GT Load %	Exhaust Flow del/min @15%	NOx ppm @ 15%	CO ppm @ 15%	VOC ppm @ 15%	NOx lbs/min	CO lbs/min	VOC lbs/min	NOx lbs	CO lbs	VOC lbs
0-5	varies	varies	varies	varies	varies	0.44	4.2	0.82	2.20	21.0	4.1
5:03	5.62%	155,656	45	2,500	1,000	0.85	28.71	6.58	0.02	0.75	0.11
5:32	10.87%	181,403	45	1,500	600	0.99	20.08	4.60	0.27	7.08	1.62
5:56	15.18%	202,387	45	400	200	1.10	5.97	1.71	0.25	3.13	0.76
5:56	15.18%	202,387	45	4,000	2,000	1.10	59.74	17.11	///	///	///
5:62	16.27%	208,099	45	3,500	1,600	1.14	53.75	14.07	0.07	3.40	0.94
5:93	21.81%	234,423	45	2,460	980	1.28	42.55	9.71	0.37	14.93	3.69
6:24	27.33%	262,571	45	1,875	600	1.43	36.33	6.66	0.42	12.23	2.54
6:42	30.63%	279,280	45	1,510	530	1.52	31.12	6.26	0.27	6.07	1.16
6:55	32.83%	290,268	45	1,240	500	1.58	26.56	6.13	0.20	3.75	0.81
6:67	35.05%	302,430	45	980	431	1.65	21.87	5.51	0.19	2.91	0.70
6:92	39.5%	325,520	45	300	300	1.78	7.21	4.13	0.43	3.63	1.20
6:92	39.5%	325,520	45	3,950	1,180	1.78	94.88	16.23	///	///	///
7:48	49.63%	378,290	41	1,960	387	1.88	54.71	6.19	1.02	41.89	6.28
7:79	55.2%	407,871	38	1,100	210	1.88	33.11	3.62	0.58	13.61	1.52
8:10	60.69%	439,473	36	450	30	1.92	14.59	0.56	0.59	7.39	0.65
8:16	61.78%	445,315	36	320	21	1.94	10.52	0.40	0.12	0.75	0.03
8:25	63.42%	454,141	35	190	10	1.93	6.37	0.19	0.17	0.76	0.03
8:25	63.42%	454,141	9	100	10	0.50	3.35	0.19	///	///	///
8:40	66.16%	470,372	9	47	2	0.51	1.63	0.04	0.08	0.37	0.02
8:58	69.43%	489,604	9	10	1	0.53	0.36	0.02	0.09	0.18	0.01
9:00	70%	514,559	9	10	0.2	0.56	0.38	0.004	0.23	0.16	0.01
Total 1 st 9 mins									7.57	143.99	26.18
9-12.5	70%	514,559	9.0	10.0	2.0	0.55	0.37	0.043	1.93	1.30	0.15
12.5-60	100%	668,927	2.0	2.0	2.0	0.16	0.097	0.056	7.6	4.61	2.66
Total 1 st 60 mins									17.10	149.90	28.99
60-90	100%	668,927	2.0	2.0	2.0	0.16	0.097	0.056	4.80	2.91	1.68
Total 90 min									21.90	152.81	30.67



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 85	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CPO1	CHECKED BY

Table A.6 Cold Start Raw Data

Time minutes	Cl Load %	Exhaust Flow dsc/min, uncorrected	NOx ppm uncorrected	CO ppm uncorrected	VOC ppm uncorrected	O2
0-5	varies	varies	varies	varies	varies	varies
5:03	5.62%	500148	14.5	805.1	322.0	14.83
5:32	10.87%	472776	16.9	564.4	225.8	14.79
5:56	15.18%	472776	18.9	168.1	84.1	15.03
5:56	15.18%	473398	18.9	1681.4	840.7	15.24
5:62	16.27%	473398	19.4	1512.7	691.5	15.24
5:93	21.81%	473398	22.0	1200.8	478.4	15.35
6:24	27.33%	474020	24.6	1026.5	328.5	15.43
6:42	30.63%	474643	26.2	880.4	309.0	15.83
6:55	32.83%	475887	27.3	752.4	303.4	16.21
6:67	35.05%	477753	28.4	619.6	272.5	16.88
6:92	39.5%	477753	30.7	204.4	204.4	16.88
6:92	39.5%	478375	30.7	2691.4	804.0	17.17
7:48	49.63%	478375	32.6	1558.0	307.6	17.32
7:79	55.2%	478997	32.7	945.3	180.5	17.46
8:10	60.69%	479619	33.4	417.2	27.8	17.67
8:16	61.78%	480241	33.9	301.0	19.8	18.02
8:25	63.42%	481485	33.6	182.3	9.6	18.35
8:25	63.42%	481485	8.6	95.9	9.6	18.42
8:40	66.16%	481485	9.0	46.8	2.0	18.42
8:58	69.43%	482107	9.3	10.4	1.0	18.68
9:00	70%	483352	9.3	10.3	0.2	19

Based on the data, AES estimated the cold start emissions. They also provided estimates for the warm and hot starts and shutdowns (no data was provided for these scenarios).

Table A.7 Turbine Start Up Emissions

Pollutant	Cold Start, 90 minutes	Warm Start, 32.5 minutes	Hot Start, 32.5 minutes
	Lbs/event	Lbs/event	Lbs/event
NOx	28.7	16.6	16.6
CO	115.9	46.0	33.6
VOC	27.9	21.0	20.4
SOx ⁽¹⁾	3.12	1.13	1.13
PM10 ⁽²⁾	6.75	2.44	2.44

These numbers are the estimates provided by AES and may contain adjustment factors. Therefore, they do not necessarily match what's shown in Table A.5.

- (1) SOx based on 2.08 lbs/hr, (no duct firing during start ups)
- (2) PM10 based on 4.5 lbs/hr (no duct firing during start ups)



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 86	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

Table A.8 Turbine Start Up Emissions (combined 6 turbines)

Pollutant	Cold Start, 90 minutes	Warm Start, 32.5 minutes	Hot Start, 32.5 minutes
	Max	Max	Total
	Lbs/event	Lbs/event	Lbs/event
NOx	172.2	99.6	99.6
CO	695.4	276	201.6
VOC	167.4	126	122.4
SOx	18.72	6.78	6.78
PM10	40.5	14.64	14.64

Shut Down Operation

A shutdown is expected to take about 10 minutes to complete. Following is a summary of the estimated emissions during a shutdown as provide by AES.

Table A.9 Shutdown Emissions Data

Time minutes	CT Load %	NOx ppm @ 15%	CO ppm @ 15%	VOC ppm @ 15%	NOx lbs/min	CO lbs/min	VOC lbs/min	NOx lbs	CO lbs	VOC lbs
0	70	9	10	0.2	0.53	0.36	0.02	0.1	0.1	0.004
0.21	66.16	9	50	2	0.51	1.74	0.04	0.1	0.2	0.01
0.39	63.42	9	100	10	0.50	3.35	0.19	0.1	0.5	0.02
0.39	63.42	35	200	10	1.93	6.70	0.19	---	---	---
0.49	61.78	36	350	22	1.94	11.50	0.41	0.2	0.9	0.03
0.57	60.69	36	450	30	1.92	14.59	0.56	0.2	1	0.04
0.92	55.2	38	1100	215	1.88	33.11	3.71	0.7	8.3	0.75
1.28	49.63	41	2000	400	1.88	55.83	6.40	0.7	16	1.82
1.94	39.5	45	4000	1200	1.78	96.08	16.51	1.2	50.1	7.56
1.94	39.5	45	300	300	1.78	7.21	4.13	---	---	---
2.23	35.05	45	1000	433	1.65	22.32	5.53	0.5	4.3	1.4
2.38	32.83	45	1250	500	1.58	26.77	6.13	0.2	3.7	0.88
2.52	30.63	45	1600	540	1.52	32.97	6.37	0.2	4.2	0.88
2.73	27.33	45	1875	600	1.43	36.33	6.66	0.3	7.3	1.37
3.09	21.81	45	2500	1000	1.28	43.25	9.91	0.5	14.3	2.98
3.45	16.27	45	3500	1600	1.14	53.75	14.07	0.4	17.5	4.32
3.52	15.18	45	4000	2000	1.10	59.74	17.11	0.1	4	1.09
3.52	15.18	45	400	200	1.10	5.97	1.71	---	---	---
3.8	10.87	45	1500	600	0.99	20.08	4.60	0.3	3.6	0.88
4.14	5.62	45	2500	1000	0.85	28.71	6.58	0.3	8.3	1.9
4.48	0.51	45	3500	1600	0.71	33.47	8.76	0.3	10.6	2.61



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 87	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

4.51	0	45	1000	400	0.69	9.38	2.15	0	0.6	0.16
4.51	0	45	1000	400	0.69	9.38	2.15	---	---	---
9.51	0	45	1000	400	0.69	9.38	2.15	3.5	46.9	10.7
Totals								9.7	202.4	39.4

Table A.10 Turbine Shutdown Emissions

Pollutant	Shutdown, 10 minutes	
	1 Turbine	6 Turbines
	Lbs/event	Lbs/event
NOx	9.0	54.0
CO	45.3	271.8
VOC	31.0	186.0
PM10 ⁽¹⁾	0.75	4.5
SOx ⁽²⁾	0.33	1.98

The NOx, CO, and VOC emissions in this table are as reported by AES, they not match the numbers calculated in Table A.9.

- (1) PM10 based on 4.5 lbs/hr (no duct firing during shutdowns)
- (2) SOx based on 2.08 lbs/hr, (no duct firing during shutdowns)

Daily Emissions

Daily emissions are calculated assuming the following emission rates per turbine:

Table A.11 Maximum Emission Rates (1 Turbine)

	NOx	CO	VOC	PM10	SOx	NH3
Normal Operations Controlled w/DB(lbs/hr)	14.8	9.0	5.1	9.5	2.78	13.8
Normal Operations Controlled w/o DB (lbs/hr)	11.0	6.7	3.8	4.5	2.08	10.3
Normal Operations Uncontrolled w/DB (lbs/hr)	66.6	45.0	5.1	9.5	2.78	0
Normal Operations Uncontrolled w/o DB (lbs/hr)	30.3	33.5	3.8	4.5	2.08	0
Cold Start (total lbs)	28.7	115.9	27.9	6.75	3.12	0
Warm Start (total lbs)	16.6	46.0	21.0	2.44	1.13	0
Hot Start (total lbs)	16.6	33.6	20.4	2.44	1.13	0
Shutdown (total lbs)	9.0	45.3	31.0	0.75	0.33	0

Uncontrolled emission rates based on DLN without SCR, NOx=9 ppm, CO=10 ppm, VOC=2 ppm

Daily emissions are calculated on a per turbine and a per plant basis for 3 scenarios. The first assuming 1 cold start up and shutdown in the day, and the remaining hours at full load, with 5 hours of duct firing, the second assuming 1 cold start up, 3 hot starts, 4 shutdowns, and the remaining hours



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 88	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

at full load, with 5 hours of duct firing and 30 minutes of downtime between each hot start, and the third assuming 24 hrs at full load operation with 5 hours of duct firing.

Table A.12 Controlled Daily Emissions (1 Turbine)

	Emissions, lbs						NH3
	Duration	NOx	CO	VOC	PM10	SOx	
Scenario 1							
Cold Start	1.5	28.7	115.9	27.9	6.75	3.12	0
Normal Operation (includes 5 hrs DB)	22.33	264.63	161.11	91.35	125.49	49.95	247.50
Shutdown	0.17	9.0	45.3	31.0	0.75	0.33	0
TOTAL	24	302.33	322.21	150.25	132.99	53.40	247.50
Scenario 2							
Cold Start	1.5	28.7	115.9	27.9	6.75	3.12	0
Normal Operation (includes 5 hrs DB)	18.7	224.70	136.79	77.56	109.15	42.40	210.11
Shutdown (4)	2.72	36.0	181.2	124.0	3.0	1.32	0
Downtime	1.5	0	0	0	0	0	0
Hot Start (3)	1.62	49.8	100.8	61.2	7.32	3.39	0
TOTAL	24	339.20	534.69	290.66	126.22	50.23	210.11
Scenario 3							
Normal Operation (includes 5 hrs DB)	24	283.00	172.30	97.70	133.00	53.42	264.70

Sample Calc:

*NOx, normal operation scenario 1 = 14.8 lbs/hr*5 + 11.0 lbs/hr*17.33 = 264.63 lbs*

*PM10 normal operation, scenario 2 = 9.5 lbs/hr * 5 + 4.5 lbs/hr*13.7 = 109.15 lbs*

*VOC normal operation, scenario 3 = 5.1 lbs/hr*5 + 3.8 lbs/hr*19 = 97.70 lbs*



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 89	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

Table A.13 Uncontrolled Daily Emissions (1 Turbine)

	Duration	Emissions, lbs				
		NOx	CO	VOC	PM10	SOx
Scenario 1						
Cold Start	1.5	28.7	115.9	27.9	6.75	3.12
Normal Operation (includes 5 hrs DB)	22.33	858.10	805.56	91.35	125.49	49.95
Shutdown	0.17	9.0	45.3	31.0	0.75	0.33
TOTAL	24	895.80	966.76	150.25	132.99	53.40
Scenario 2						
Cold Start	1.5	28.7	115.9	27.9	6.75	3.12
Normal Operation (includes 5 hrs DB)	18.7	748.11	683.95	77.56	109.15	42.40
Shutdown (4)	2.72	36.0	181.2	124.0	3.0	1.32
Downtime	1.5	0	0	0	0	0
Hot Start (3)	1.62	49.8	100.8	61.2	7.32	3.39
TOTAL	24	862.61	1081.85	290.66	126.22	50.23
Scenario 3						
Normal Operation (includes 5 hrs DB)	24	908.70	861.50	97.70	133.00	53.42

Sample Calc:

NOx normal operation, scenario 1 = 66.6 lbs/hr*5 + 30.3 lbs/hr*17.33 = 858.10

NOx normal operation, scenario 2 = 66.6 lbs/hr*5 + 30.3 lbs/hr*13.7 = 748.11

Table A.14 Controlled Daily Emissions, (6 Turbines)

	Duration	Emissions, lbs					NH3
		NOx	CO	VOC	PM10	SOx	
Scenario 1							
Cold Start	1.5	172.2	695.4	167.4	40.5	18.72	0
Normal Operation (includes 5 hrs DB)	22.33	1587.78	966.66	548.1	752.94	299.7	1485
Shutdown	0.17	54	271.8	186	4.5	1.98	0
TOTAL	24	1813.98	1933.26	901.5	797.94	320.4	1485
Scenario 2							
Cold Start	1.5	172.2	695.4	167.4	40.5	18.72	0
Normal Operation (includes 5 hrs DB)	18.7	1348.2	820.74	465.36	654.9	254.4	1260.66
Shutdown (4)	2.72	216	1087.2	744	18	7.92	0
Downtime	1.5	0	0	0	0	0	0
Hot Start (3)	1.62	298.8	604.8	367.2	43.92	20.34	0
TOTAL	24	2035.2	3208.14	1743.96	757.32	301.38	1260.66
Scenario 3							
Normal Operation (includes 5 hrs DB)	24	1698	1033.8	586.2	798	320.5	1588.2



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 90	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

Table A.15 Maximum Controlled/Uncontrolled Daily Emissions (1 Turbine)

Pollutant	Operating Scenario	Uncontrolled Daily Emissions	Controlled Daily Emissions
NOx	See Below	908.70	339.20
CO	1 cold, 3 hot, 4 shutdowns, remaining hours normal	1081.85	534.69
VOC	1 cold, 3 hot, 4 shutdowns, remaining hours normal	290.66	290.66
PM10	24 hr normal	133	133
SOx	24 hr normal	53.42	53.42
NH3	24 hr normal	//////////	264.70

For NOx, the maximum uncontrolled emissions result from the 24 hr normal operation scenario, while the maximum controlled emissions result from the 1 cold, 3 hot, 4 shutdown scenario.

Table A.16 Maximum Controlled Daily Emissions (6 Turbines)

Pollutant	Operating Scenario	Controlled Daily Emissions
NOx	1 cold, 3 hot, 4 shutdowns, remaining hours normal	2035.2
CO	1 cold, 3 hot, 4 shutdowns, remaining hours normal	3208.14
VOC	1 cold, 3 hot, 4 shutdowns, remaining hours normal	1743.96
PM10	24 hr normal	798
SOx	24 hr normal	320.5
NH3	24 hr normal	1588.2

Monthly Emissions

Table A.17 Expected Monthly/Annual Operation

AES provided the following expected operating profile of the plant:

Event	Duration/month ⁽¹⁾	Duration/yr ⁽²⁾
Cold Start	7.5	36
Warm Start	13.5	81.25
Hot Start	32.5	243.75
Shutdown	15	104
100% Load @ 68.5 deg F w/o DB	489.5 hrs	5900
100% Load @ 68.5 deg F with DB	186 hrs	470
Total Hrs	744	6835

(1) Based on 5 cold starts (1.5 hrs each), 25 warm starts (32.5 min each), 60 hot starts (32.5 min each), and 90 shutdowns (10 min each) per month



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 91	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

(2) Based on 24 cold starts (1.5 hrs each), 150 warm starts (32.5 min each), 450 hot starts (32.5 min each), and 624 (10 min each) shutdowns per month

Monthly emissions and the 30 Day Averages are calculated for 2 scenarios, one assuming the maximum starts and shutdowns are based on the above operating profile, and the second assuming no start ups or shutdowns. For the second scenario, 186 hrs of duct burning is assumed, with the remaining hours in the month (31 days, 744 hrs), assumed to be without duct firing. The following factors are used:

Table A.18 Emission Factors for 30 Day Calculation

Event	lbs/hr or lbs/event					
	NOx	CO	VOC	PM10	SOx	NH3
Cold	28.7	115.9	27.9	6.75	3.12	0
Warm	16.6	46.0	21.0	2.44	1.13	0
Hot	16.6	33.6	20.4	2.44	1.13	0
Shutdown	9.0	45.3	31.0	0.75	0.33	0
Normal @ 68.5 deg F w/o DB	11.0	6.7	3.8	4.5	2.08	10.3
Normal @ 68.5 deg F w DB	14.8	9.0	5.1	9.5	2.78	13.8

Table A.19 30 Day Emissions /Scenario 1/, Start Ups and Shut Downs (1 Turbine)

Event	Duration hrs/month	# of events	Emissions					
			NOx	CO	VOC	PM10	SOx	NH3
Cold	7.5	5	143.5	579.5	139.5	33.75	15.6	0
Warm	13.5	25	415	1150	525	61	28.25	0
Hot	32.5	60	996	2016	1224	146.4	67.8	0
Shutdown	15	90	810	4077	2790	67.5	29.7	0
Normal @ 68.5 deg F W/O DB	489.5	//////	5384.5	3279.65	1860.1	2202.75	1018.16	5041.85
Normal @ 68.5 deg F W/DB	186	//////	2752.8	1674	948.6	1767	517.08	2566.8
Total lbs/month			10501.8	12776.15	7487.2	4278.4	1676.59	7608.65
Average lbs/day			350.1	425.9	249.6	142.61	55.89	253.6



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 92	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

Table A.20 30 Day Emissions /Scenario 2/ No Starts (1 Turbine)

Event	Duration, hrs/month	# of events	Emissions					
			NOx	CO	VOC	PM10	SOx	NH3
Normal @ 68.5 deg F W/O DB	558	//////	6138	3738.6	2120.4	2511	1160.64	5747.4
Normal @ 68.5 deg F W/ DB	186	//////	2752.8	1674	948.6	1767	517.08	2566.8
Total, lbs/month			8890.8	5412.6	3069	4278	1677.72	8314.2
Average lbs/day			296.36	180.42	102.3	142.6	55.92	277.14

Table A.21 30 Day Emissions (1 Turbine)

Pollutant	Operating Scenario	Total Monthly Emissions	30-Day Average Emissions
NOx	5 cold starts+25 warm starts+60 hot starts+90 shutdowns+489.5 hrs normal w/o DB + 186 hrs normal with DB	10,501.8	350.1
CO	5 cold starts+25 warm starts+60 hot starts+90 shutdowns+489.5 hrs normal w/o DB + 186 hrs normal with DB	12,776.15	425.9
VOC	5 cold starts+25 warm starts+60 hot starts+90 shutdowns+489.5 hrs normal w/o DB + 186 hrs normal with DB	7,487.2	249.6
PM10	5 cold starts+25 warm starts+60 hot starts+90 shutdowns+489.5 hrs normal w/o DB + 186 hrs normal with DB	4278.00	142.6
SOx	744 hrs normal with 186 hrs duct firing	1677.72	55.92

5 cold starts = 7.5 hrs, 25 warm starts = 13.54 hrs, 60 hot starts = 32.5 hrs, 90 shutdowns = 15 hrs, remaining hours assumed at 100% load (31 days)



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 93	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

Table A.22 30 Day Emissions (6 Turbines)

Pollutant	Operating Scenario Per Turbine	Total Monthly Emissions	30-Day Average Emissions
NOx	5 cold starts+25 warm starts+60 hot starts+90 shutdowns+489.5 hrs normal w/o DB + 186 hrs normal with DB	63010.8	2100.6
CO	5 cold starts+25 warm starts+60 hot starts+90 shutdowns+489.5 hrs normal w/o DB + 186 hrs normal with DB	76656.9	2555.4
VOC	5 cold starts+25 warm starts+60 hot starts+90 shutdowns+489.5 hrs normal w/o DB + 186 hrs normal with DB	44923.2	1497.6
PM10	5 cold starts+25 warm starts+60 hot starts+90 shutdowns+489.5 hrs normal w/o DB + 186 hrs normal with DB	25668	855.6
SOx	744 hrs normal with 186 hrs duct firing	10066.32	335.52

5 cold starts = 7.5 hrs, 25 warm starts = 13.54 hrs, 60 hot starts = 32.5 hrs, 90 shutdowns = 15 hrs, remaining hours assumed at 100% load (31 days)

Table A.23 Monthly Commissioning Emissions

Pollutant	Per Turbine, lbs	Total 3 Turbine (Block), lbs
NOx	1,380	4,141
CO	18,184	56,441
VOC	2,354	7,060.5
PM10	488	1,465
SO2	177	532

Monthly commissioning emissions are estimated by taking the total commissioning emissions from Table B.3 and dividing by 6 months.



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 94	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

**Appendix B
Commissioning and Annual Emissions**

Each turbine will go through a series of tests during commissioning to prepare for commercial operation. The commissioning is expected to take up to 180 days for each 3X1 power block. During that time, the turbines will be operated about 491 hours. Some of those hours will be with DLN, SCR and oxidation control, others with no control.

Table B.1 Approximate Commissioning Schedule

Event	Approximate Schedule
Steam Turbine/Gen Commissioning	3/19/18-3/30/18
Combined Cycle Commissioning	1/1/18-4/6/18
Performance & Emission Testing	4/9/18-6/22/18

Table B.2 Summary of Commissioning Emissions

Each turbine will undergo the following tests

Activity	Duration (hours)	CT Load (%)	Fuel Use		Pollutant Emission Rates (per turbine), lbs/hr			Total Emissions (per turbine), lbs				
			mmscf/hr	mmscf/activity	NOx	CO	VOC	NOx	CO	VOC	SO2	PM10
FSNL	4	5	0.059	0.235	48.53	1709.13	383.83	194.1	6836.5	1535.3	7.9	18.0
Steam Blows ⁽¹⁾	27	50	0.588	15.882	109.69	3169.39	373.13	2961.5	85573.6	10074.5	53.2	121.5
Set Unit HRSG & Steam Safety Valves	16	100	1.375	22.08	41.95	28.37	1.71	671.2	454.0	27.4	31.5	72.0
DLN Emissions Tuning	12	100	1.375	16.506	10.49	7.09	1.15	125.8	85.1	13.7	23.6	54.0
Emissions Tuning	12	70	1.014	12.165	7.82	5.29	1.15	93.9	63.5	13.7	23.6	54.0
Emissions Tuning	12	100	1.375	16.506	10.49	7.09	1.15	125.8	85.1	13.7	31.7	114.0
STG Bypass Valve Tuning HRSG Blowdown	12	40	0.471	5.647	25.97	1372.55	161.34	311.7	16470.6	1936.1	23.6	54.0
STG Bypass	12	75	1.073	12.871	8.19	5.54	1.15	98.3	66.5	13.7	23.6	54.0



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 95	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

Valve Tuning HRSG Blowdown												
STG Bypass Valve Tuning HRSG Blowdown	12	100	1.375	16.506	10.49	7.09	1.15	125.8	85.1	13.7	23.6	54.0
Verify STG on Turning Gear, Combined Blows Finalize Bypass Valve Tuning	12	75	1.073	12.871	8.19	5.54	1.15	98.3	66.5	13.7	23.6	54.0
Verify STG on Turning Gear, Combined Blows Finalize Bypass Valve Tuning	12	100	1.375	16.506	10.49	7.09	1.15	125.8	85.1	13.7	23.6	54.0
CT Baseload Testing	12	75	1.073	12.871	8.19	5.54	1.15	98.3	66.5	13.7	23.6	54.0
Load STG/Combined Cycle (3X1)	24	100	1.375	33.012	10.49	7.09	1.15	251.7	170.2	27.5	47.3	108.0
Combined Cycle Testing	24	100	1.375	33.012	16.50	17.00	1.15	396.0	408.0	27.5	47.3	108.0
STG Load Test	24	75	1.073	25.741	8.19	5.54	1.15	196.5	132.9	27.5	47.3	108.0
Commission Duo Burners	24	100	1.873	44.491	10.49	7.09	3.35	401.7	410.2	80.4	63.4	228.0
Refire Unit with Duo Burners	12	100	1.873	22.471	10.49	7.09	1.15	200.8	205.1	13.7	31.7	114.0
Source Testing	168	100	1.375	231.082	7.00	7.09	1.15	1176.0	1191.7	192.5	387.2	1176.0
Water Wash & Performance Preparation	24	100	1.375	33.012	10.49	7.09	1.15	251.7	170.2	27.5	47.3	108.0
Performance Testing	24	100	1.375	33.012	10.49	7.09	1.15	251.7	170.2	27.5	47.3	108.0
CALISO Certification	12	100	1.375	33.012	10.49	7.09	1.15	125.8	85.1	13.7	31.7	114.0
TOTALS	491	///////	25.295	649.491	///////	///////	///////	8282	112,882	14,121	1,064	2,930

(1) Steam blow for the first CTG is expected to last 40 hours, steam blows for the 2 remaining CTGs are expected to last 20 hrs each.
 Huntington Beach Energy Project Preliminary Determination of Compliance
 A/N's 539746-48, 539768-70, 540256-58, 540260-62, 540255



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 96	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

*Shaded activities are controlled by DLN, SCR and oxidation catalyst.
PM10 based on 4.5 lbs/hr, SOx based on 1.97 lbs/hr*

Table B.3 Combined Commissioning

All three turbines will operate during the following tests (these emissions are accounted for in Table B.1 for each individual turbine)

Activity	Duration (hours)	CT Load (%)	Pollutant Emission Rates, lbs/hr per turbine			Total Emissions (3 turbines), lbs				
			NOx	CO	VOC	NOx	CO	VOC	SOx	PM10
CTG Testing FSNL	4	5	48.53	1709.13	383.83	582.3	20509.5	4605.9	23.7	54
Steam Blows ⁽¹⁾	27	50	109.69	3169.39	373.13	8884.5	256720.8	30223.5	159.6	364.5
Set unit HRSG and steam safety valves	16	100	41.95	28.37	1.71	2013.6	1362	82.2	94.5	216
STG Bypass Valve Tuning HRSG Blowdown	12	40	25.97	1372.55	161.34	935.1	49411.8	5808.3	70.8	162
TOTALS	59	///////	226.14	6279.44	920.01	12415.5	328004.1	40719.9	348.6	796.5

*(1) Steam blow for the first CTG is expected to last 40 hours, steam blows for the 2 remaining CTGs are expected to last 20 hrs each.
Shaded activities are controlled by DLN, SCR and oxidation catalyst.
PM10 based on 4.5 lbs/hr, SOx based on 1.97 lbs/hr*

Table B.4 Total Commissioning Emissions (Per Block)

Pollutant	Per Turbine	Total 3 Turbines		Emission Factors for Commissioning
	Lbs	Lbs	Tons	lbs/mmcf



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 97	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

NOx	8,282	24846	12.4	12.75
CO	112,882	338646	169.3	173.80
VOC	14,121	42363	21.2	21.74
PM10	2,930	8790	4.4	4.51
SO2	1,064	3192	1.6	1.64

Emission factors based on per turbine emissions ÷ 649.491 mmcf fuel use.

Annual emissions are estimated for both a commissioning year, and for a normal year after commissioning. Block 1 and Block 2 will not be commissioned simultaneously, and not in the same year (Block 1 construction is estimated to be completed 1st half of 2018 while Block 2 construction won't be completed until the 2nd half of 2019). Therefore, to estimate the maximum 12 month emissions during a commissioning year, it will be assumed that Block 1 will be operating normally while Block 2 is being commissioned. Block 2 will then begin normal operation for the balance of the 12 months (approximately 6 months).



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 98	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

Table B.5 Annual Emissions, Commissioning Year

Operating Mode	# of Events	Hours	Emissions Per Turbine, lb/hr or lbs/event					Emissions Per Turbine, lbs				
			NOx	CO	VOC	PM10	SOx	NOx	CO	VOC	PM10	SOx
Commissioning Block 2	1	491	////////	////////	////////	////////	////////	8282.0	111882.0	14121.0	2930.0	1064.0
Cold Starts Block 2	12	18	28.7	115.9	27.9	6.75	3.12	344.4	1390.8	334.8	81	37.44
Warm Starts Block 2	75	60.625	16.6	46.0	21.0	2.44	1.13	1245	3450	1575	183	84.75
Hot Starts Block 2	225	121.875	16.6	33.6	20.4	2.44	1.13	3735	7560	4590	549	254.25
Shutdowns Block 2	312	52	9.0	45.3	31.0	0.75	0.33	2808	14133.6	9672	234	102.96
Normal Operation (no duct firing) Block 2	////////	2950	11.0	6.7	3.8	4.5	0.63	32450	19765	11210	13275	1858.5
Normal Operation (w/duct firing) Block 2	////////	235	14.8	9.0	5.1	9.5	0.87	3478	2115	1198.5	2232.5	204.45
Cold Starts Block 1	24	36	28.7	115.9	27.9	6.75	3.12	688.8	2781.6	669.6	162	74.88
Warm Starts Block 1	150	81.25	16.6	46.0	21.0	2.44	1.13	2490	6900	3150	366	169.5
Hot Starts Block 1	450	243.75	16.6	33.6	20.4	2.44	1.13	7470	15120	9180	1098	508.5
Shutdowns Block 1	624	104	9.0	45.3	31.0	0.75	0.33	5616	28267.2	19344	468	205.92
Normal Operation (no duct firing) Block 1		5900	10.3	6.3	3.6	4.5	0.63	60770	37170	21240	26550	3717
Normal Operation (w/duct firing) Block 1		470	14.1	8.6	4.9	9.5	0.87	6627	4042	2303	4465	408.9
TOTAL EMISSIONS, 6 TURBINES								408012.6	763731.6	295763.7	157780.5	26073.15

Notes:

The total emissions for all 6 turbines is calculated by taking the sum of (Block 2 emissions*3 + Block 1 emissions*3)

Emission rates for normal operation are based on annual average temperature from Table A.4, SOx is based on 0.25 grains/100 scf



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 99	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

Table B.6 Annual Emissions, Non-Commissioning Year

Operating Mode	# of Events	Hours	Emissions Per Turbine, lb/hr or lbs/event					Emissions Per Turbine, lbs				
			NOx	CO	VOC	PM10	SOx	NOx	CO	VOC	PM10	SOx
Cold Starts	24	36	28.7	115.9	27.9	6.75	3.12	688.8	2781.6	669.6	162	74.88
Warm Starts	150	81.25	16.6	46.0	21.0	2.44	1.13	2490	6900	3150	366	169.5
Hot Starts	450	243.75	16.6	33.6	20.4	2.44	1.13	7470	15120	9180	1098	508.5
Shutdowns	624	104	9.0	45.3	31.0	0.75	0.33	5616	28267.2	19344	468	205.92
Normal Operation (no duct firing)	////////	5900	10.3	6.3	3.6	4.5	0.63	60770	37170	21240	26550	3717
Normal Operation (w/duct firing)	////////	470	14.1	8.6	4.9	9.5	0.87	6627	4042	2303	4465	408.9
TOTAL EMISSIONS 1 TURBINE								83661.8	94280.8	55886.6	33109	5084.7
TOTAL EMISSIONS, 6 TURBINES								501970.8	565684.8	335319.6	198654	30508.2

Note:

Emission rates for normal operation are based on annual average temperature from Table A.4, SOx is based on 0.25 grains/100 scf



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 100	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

Appendix C

Turbine Air Toxic Emission Calculations

Data:

Maximum heat input (w/o duct firing) 1498 mmbtu/hr
 Maximum annual hours of operation (w/o duct firing, incl start/shutdown) 6365 hrs/yr
 Annual Heat Input (w/o duct firing) 9.5348E+06 mmbtu/yr

Maximum heat input (w/duct firing) 2005 mmbtu/hr
 Maximum annual hours of operation (w/duct firing) 470 hrs/yr
 Annual Heat Input (with duct firing) 0.9424E+06 mmbtu/yr

Total Annual Heat Input	1.0477E+07 mmbtu/yr
-------------------------	---------------------

Maximum fuel use (32°F, w/duct firing, 1020 btu/scf) 1.97 mmcf/hr
 Annual Hours of Operation 6835 hrs/yr

Total Annual Fuel Use	1.346E+04 mmcf/yr
-----------------------	-------------------

Table C.1 Toxic Emissions

Pollutant	Emission Factor	Maximum Hourly Emission Rate, lbs/hr	Annual Emissions 1 Turbine, lbs/yr
Ammonia	256.3 Lbs/hr	256.3	1.63E+06
Acetaldehyde	4.00E-05 Lbs/mmbtu	8.02E-02	4.19E+02
Acrolein	3.62E-06 Lbs/mmbtu	7.26E-03	3.79E+01
Benzene	3.26E-06 Lbs/mmbtu	6.54E-03	3.42E+01
1,3 Butadiene	4.30E-07 Lbs/mmbtu	8.62E-04	4.51E+00
Ethyl Benzene	3.20E-05 Lbs/mmbtu	6.42E-02	3.35E+02
Formaldehyde	3.60E-04 Lbs/mmbtu	7.22E-01	3.77E+03
Naphthalene	1.30E-06 Lbs/mmbtu	2.61E-03	1.36E+01
PAH	2.20E-06 Lbs/mmbtu	4.41E-03	2.30E+01
Propylene Oxide	2.90E-05 Lbs/mmbtu	5.81E-02	3.04E+02
Toluene	1.30E-04 Lbs/mmbtu	2.61E-01	1.36E+03
Xylene	6.40E-05 Lbs/mmbtu	1.28E-01	6.71E+02
Total		Lbs/yr	1.64E+06
		Tons/yr	818.5

Notes:



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 101	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

Emission factors from USEPA AP-42 Table 3.1-3, except 1) Formaldehyde, Benzene, and Acrolein emission factors which are from the Background document for AP-42 Section 3.1, Table 3.4-1 for natural gas turbine with CO catalyst.



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 102	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

Appendix D

Existing Facility Emissions

The existing facility consists of utility Boilers 1 and 2. The boilers are natural gas fired, each rated at 2021 mmbtu/hr heat input and 215 MW power output. The boilers are controlled with SCR systems. NOx is limited to 7 ppm on an annual average basis. The facility has submitted operating data for these units for the years 2006-2012 in order for the actual emissions of these units to be calculated. The fuel use data is taken from the CEMS for each unit. The emission factors used to estimate emissions for each unit are based on either CEMS data, source test results, or for SOx, the default emission factor. The following tables summarize the data.

Table D.1 Existing Boilers Emission Factors for Determination of Past Actual Emissions

Pollutant	Boiler 1 Emission Factor	Source	Boiler 2 Emission Factor	Source
NOx	Based on quarterly reports			
VOC	1.64 lbs/mmscf	12/18/11 source test	0.9 lbs/mmscf	11/14/12 source test
CO	0.274 lbs/mmbtu	Average of the 12/11/07 & 4/7/10 source tests for Boiler 1 & 4/6/10 source test for Boiler 2	0.274 lbs/mmbtu	Average of the 12/11/07 & 4/7/10 source tests for Boiler 1 & 4/6/10 source test for Boiler 2
SOx	0.83 lbs/mmscf	AQMD Form B-1 factor	0.83 lbs/mmscf	AQMD Form B-1 factor
PM10	1.86 lbs/mmscf	11/14/12 source test	2.1 lbs/mmscf	11/14/12 source test

Table D.2 Boiler #1 Past Actual Emissions

Year	Month	Fuel Use		VOC	CO	NOx	SOx	PM10
		mmscf	mmbtu	lbs	lbs	lbs	lbs	lbs
2006	1	407.004	423,631	675.3	116074.8	1634.5	341.7	765.8
	2	265.227	278,762	442.4	76380.9	1788.68	223.9	501.7
	3	392.303	409,101	652.9	112093.8	1582.08	330.4	740.5
	4	232.038	241,815	385.0	66257.4	1078.55	194.8	436.6
	5	229.015	239,988	379.4	65756.6	2031.57	192.0	430.3
	6	520.065	537,329	854.5	147228.2	2642.09	432.4	969.1
	7	649.615	671,764	1071.8	184063.3	4262.46	542.4	1215.6
	8	502.797	522,844	830.2	143259.1	2813.85	420.2	941.6
	9	520.696	540,025	863.7	147967.0	2994.04	437.1	979.5
	10	110.059	115,464	183.8	31637.2	688.93	93.0	208.4
	11	0	0	0.0	0.0	0.001	0.0	0.0
	12	339.456	358,490	570.4	98226.3	2062.64	288.7	646.9
	Total	4,168.275	4,339,213	6,909	1,188,945	23,379	3,497	7,836
2007	1	303.849	321,496	508.7	88089.9	1851.5	257.5	577.0
	2	217.609	230,442	362.6	63141.2	1311.5	183.5	411.2
	3	220.094	207,060	326.6	56734.4	1517.7	165.4	370.6
	4	246.911	256,470	404.6	70272.7	1267.7	204.7	458.8
	5	434.789	449,468	711.8	123154.3	4395.4	360.3	807.3
	6	455.443	468,999	742.3	128505.6	2856.1	375.7	841.9
	7	632.248	652,179	1037.9	178697.2	3795.4	525.3	1177.1



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 103	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

	8	678.326	699,416	1112.7	191640.0	6743.8	563.1	1261.9
	9	515.686	531,704	848.6	145686.8	2605.6	429.5	962.4
	10	697.769	721,747	1148.5	197758.7	4283.2	581.2	1302.5
	11	166.762	174,913	278.3	47926.0	667.5	140.9	315.7
	12	337.352	352,360	560.8	96546.7	1853.9	283.8	636.0
	Total	4,906,838	5,066,254	8,043	1,388,154	33,149	4,071	9,122
	Ave	4,537,557	4,702,734	7,476	1,288,549	28,364	3,784	8,479
2008	1	672.600	702,197	1116.3	192401.9	3313.93	564.9	1266.0
	2	421.174	442,719	705.8	121304.9	2243.96	357.2	800.5
	3	371.327	385,900	615.8	105736.6	2232.81	311.6	698.4
	4	343.682	356,504	569.6	97682.0	1956.42	288.3	646.0
	5	468.231	482,431	771.8	132186.0	2280.49	390.6	875.3
	6	560.233	578,166	918.8	158417.5	2781.3	465.0	1042.1
	7	547.447	568,483	899.3	155764.5	2460.9	455.1	1019.9
	8	672.694	697,211	1104.3	191035.7	3470.28	558.9	1252.4
	9	630.731	657,646	1041.2	180194.9	3182.01	527.0	1180.9
	10	705.653	732,043	1161.4	200579.9	3934.89	587.8	1317.2
	11	25.848	26,743	42.3	7327.6	135.55	21.4	48.0
	12	287.835	301,886	475.7	82716.7	1458.62	240.8	539.5
	Total	5,707,455	5,931,929	9,422	1,625,348	29,451	4,769	10,686
	Ave	5,307,147	5,499,092	8,733	1,506,751	31,300	4,420	9,904
2009	1	451.398	483,738	761.6	132544.3	1869.18	385.4	863.8
	2	199.963	207,552	329.0	56869.3	901.33	166.5	373.2
	3	365.795	388,010	612.3	106314.6	1641.89	309.9	694.5
	4	19.511	28,900	45.7	7918.5	115.71	23.1	51.8
	5	97.675	101,536	160.5	27820.9	735.38	81.2	182.1
	6	380.054	397,002	627.2	108778.6	3304.13	317.4	711.3
	7	492.397	510,609	807.5	139906.7	4546.2	408.7	915.8
	8	417.756	432,306	688.8	118452.0	3517.27	348.6	781.2
	9	651.862	672,062	1072.0	184145.0	3496.79	542.5	1215.8
	10	463.555	480,363	762.8	131619.5	2799.55	386.1	865.1
	1	208.561	246,883	391.3	67646.1	2073.59	198.1	443.8
	12	191.013	200,937	317.6	55056.8	2509.78	160.7	360.2
	Total	3,939,540	4,149,898	6,576	1,137,072	27,511	3,328	7,459
	Ave	4,823,498	5,040,914	7,999	1,381,210	28,481	4,048	9,072
2010	1	281.147	292,572	464.3	80164.7	1802.3	235.0	526.5
	2	122.538	125,979	200.4	34518.4	825.56	101.4	227.3
	3	72.069	73,160	116.8	20045.8	1068.96	59.1	132.5
	4	34.662	35,113	56.4	9620.9	722.05	28.6	64.0
	5	133.687	136,434	219.1	37382.8	1117.37	110.9	248.5
	6	217.850	211,455	337.2	57938.6	2981.13	170.7	382.5
	7	320.019	331,897	529.5	90939.6	2153.41	268.0	600.5
	8	552.545	573,943	916.4	157260.4	3843.57	463.8	1039.3
	9	376.276	391,577	626.1	107292.2	2491.05	316.9	710.1
	10	144.021	150,277	240.8	41175.9	1218.45	121.9	273.1
	11	168.833	122,933	197.2	33683.6	1047.48	99.8	223.7
	12	80.603	84,034	134.3	23025.3	849.42	68.0	152.4
	Total	2,504,250	2,529,374	4,039	693,048	20,121	2,044	4,580
	Ave	3,221,895	3,339,636	5,307	915,060	23,816	2,686	6,020



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 104	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

2011	1	62,763	60,156	96.3	16482.8	444.53	48.7	109.2
	2	0	0	0.0	0.0	0	0.0	0.0
	3	6,074	7,373	11.9	2020.3	1312.12	6.0	13.5
	4	400,181	413,469	664.0	113290.5	2494.6	336.1	753.1
	5	283,706	290,452	467.5	79583.9	4987.65	236.6	530.2
	6	440,604	451,166	726.1	123619.6	5510.48	367.5	823.5
	7	633,652	648,876	1039.8	177791.9	3892.44	526.3	1179.3
	8	409,049	418,914	671.4	114782.3	3641.22	339.8	761.4
	9	307,224	314,013	503.2	86039.5	2504.27	254.6	570.7
	10	114,327	117,214	187.5	32116.6	968.99	94.9	212.7
	11	112,735	115,873	185.8	31749.2	1293.79	94.0	210.7
	12	42	43	0.1	11.8	0.27	0.0	0.1
		Total	2,770,357	2,837,549	4,554	777,488	27,050	2,305
	Ave.	2,637,304	2,683,462	4,296	735,268	23,586	2,174	4,872
2012	1	0.0	0	0.0	0.0	0.0	0.0	0.0
	2	161,435	166,143	264.8	45578.5	7418.61	134.0	300.3
	3	105,458	108,533	173.0	29774.3	2794.12	87.5	196.2
	4	350,268	557,829	888.9	153031.2	3796.91	449.9	1008.2
	5	351,224	424,521	676.5	116460.2	5655.08	342.4	767.2
	6	305,425	474,294	755.8	130114.6	7262.46	382.5	857.2
	7	289,921	192,818	307.3	52896.4	9010.13	155.5	348.5
	8	494,545	433,370	690.6	118887.8	8257.04	349.5	783.2
	9	571,910	390,080	621.6	107012.0	6466.24	314.6	705.0
	10	781.90	80,470	128.2	22075.7	417.97	64.9	145.4
	11	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	12	133,084	0.0	218.3	37574.1	1118.87	110.5	247.5
		Total	5,750,375	2,828,058	4,725	813,405	52,197	2,391
	Ave.	4,260,366	2,832,804	4,640	79,544.7	39,624	2,348	5,262

Average based on previous 2 years

Table D.3 Boiler #2 Past Actual Emissions

Year	Month	Fuel Use		VOC	CO	NOx	SOx	PM10
		mmscf	mmbtu	lbs	lbs	lbs	lbs	lbs
2006	1	321,978	335,132	293.2	91826.1	1629.97	270.4	684.0
	2	316,957	333,132	290.1	91278.2	2000.67	267.6	676.9
	3	209,156	218,113	191.0	59762.9	1174.6	176.2	445.8
	4	201,079	209,552	183.1	57417.2	1000.53	168.8	427.2
	5	305,730	320,378	278.0	87783.6	1483.71	256.3	648.6
	6	404,434	417,860	364.7	114493.7	2391.05	336.3	850.9
	7	621,365	642,551	562.6	176058.9	4088.98	518.8	1312.7
	8	429,007	446,112	388.8	122234.6	2217.99	358.5	907.1
	9	371,036	384,810	337.7	105437.9	2199.78	311.5	788.1
	10	223,785	234,776	205.1	64328.6	1660.34	189.1	478.5
	11	307,661	319,584	278.6	87566.0	1906.81	256.9	650.0
	12	59,656	63,001	55.0	17262.2	245.76	50.7	128.3
	Total	3,771,844	3,925,001	3,428	1,075,450	22,000	3,161	7,998



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 105	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

2007	1	170.410	180,307	156.6	49404.3	1932.9	144.4	365.3
	2	54.312	57,515	49.7	15759.2	339.0	45.8	115.9
	3	106.226	99,936	86.5	27382.3	1539.6	79.8	201.9
	4	204.232	212,138	183.6	58125.9	1249.8	169.4	428.5
	5	110.161	113,880	99.0	31203.2	925.1	91.3	230.9
	6	82.673	85,134	73.9	23326.6	1092.1	68.2	172.5
	7	187.422	193,330	168.8	52972.4	1273.0	155.7	394.0
	8	349.310	360,171	314.4	98686.7	3723.8	290.0	733.7
	9	125.819	129,727	113.6	35545.1	1623.5	104.8	265.1
	10	185.850	192,236	167.9	52672.7	1055.9	154.8	391.7
	11	0	0	0.0	0.0	0.0	0.0	0.0
	12	72.235	75,449	65.9	20673.0	759.1	60.8	153.8
	Total	1,648.650	1,699,823	1,480	465,751	15,514	1,365	3,453
Ave	2,710.247	2,812,412	2,454	770,601	18,757	2,263	5,726	
2008	1	596.616	622,869	543.4	170666.2	2929.25	501.1	1267.9
	2	343.143	360,696	315.6	98830.8	2758.95	291.0	736.3
	3	176.403	183,327	160.5	50231.5	1164.86	148.0	374.6
	4	12.658	13,130	11.5	3597.7	196.32	10.6	26.9
	5	153.690	158,350	139.0	43388.0	1047.49	128.2	324.4
	6	608.896	628,387	548.0	172178.0	3560.37	505.4	1278.8
	7	452.107	469,480	407.6	128637.4	2707.65	375.9	951.0
	8	574.419	595,354	517.5	163127.0	3378.68	477.2	1207.4
	9	259.296	270,361	234.9	74078.9	1345.8	216.6	548.1
	10	545.225	565,616	492.5	154978.8	3626.42	454.2	1149.1
	11	159.461	164,984	143.3	45205.6	753.58	132.1	334.3
	12	250.079	262,287	226.8	71866.6	1504.78	209.2	529.2
	Total	4,131.993	4,294,841	3,741	1,176,787	24,974	3,450	8,728
Ave	2,890.322	2,997,332	2,610	821,269	20,244	2,407	6,091	
2009	1	0	0	0.0	0.0	0	0.0	0.0
	2	343.636	356,678	310.3	97729.7	1902.09	286.2	724.1
	3	100.160	106,243	92.0	29110.5	569.11	84.9	214.7
	4	71.211	105,478	91.4	28901.0	331.27	84.3	213.3
	5	145.475	151,226	131.2	41435.9	1113.81	121.0	306.1
	6	125.660	131,264	113.8	35966.2	915.11	104.9	265.5
	7	665.351	689,960	598.8	189049.1	4248.27	552.2	1397.2
	8	575.819	595,875	521.0	163269.9	4621.21	480.5	1215.8
	9	717.388	739,619	647.4	202655.6	4016.72	597.1	1510.7
	10	293.475	304,116	265.0	83327.8	1861.07	244.4	618.4
	11	0.051	60	0.1	16.4	0	0.0	0.1
	12	10.512	11,058	9.6	3029.8	64.79	8.8	22.4
	Total	3,048.738	3,191,577	2,781	874,492	19,643	2,564	6,488
Ave	3,590.366	3,743,209	3,261	1,025,639	22,309	3,007	7,608	
2010	1	13.481	14,029	12.2	3843.9	229.87	11.3	28.5
	2	179.756	184,804	161.3	50636.4	1094	148.8	376.4
	3	662.330	672,356	589.0	184225.5	3903.02	543.2	1374.4
	4	144.194	146,070	128.8	40023.1	1032.39	118.8	300.6
	5	195.590	199,608	175.9	54692.7	1377.58	162.2	410.4
	6	300.317	291,501	255.1	79871.2	3485.62	235.3	595.3
	7	406.176	421,251	368.8	115422.8	2331.56	340.1	860.5



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 106	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

	8	625.435	649,657	569.2	178005.9	3937.9	525.0	1328.2
	9	330.827	344,280	302.1	94332.8	1894.1	278.6	704.8
	10	88.886	92,747	81.6	25412.6	436.42	75.2	190.3
	11	0.044	32	0.0	8.7	0.18	0.0	0.1
	12	5,339	5,566	4.9	1525.1	72.82	4.5	11.4
	Total	2,952,375	3,021,901	2,649	828,001	19,795	2,443	6,181
	Ave	3,000,557	3,106,739	2,715	851,246	19,719	2,504	6,335
2011	1	14.056	13,472	11.8	3691.3	185.47	10.9	27.6
	2	106.169	101,824	89.8	27899.8	1500.59	82.8	209.5
	3	278.364	337,906	299.0	92586.2	1777.49	275.7	697.6
	4	37.870	39,127	34.5	10720.9	274.72	31.8	80.5
	5	22.156	22,683	20.0	6215.1	333.27	18.5	46.7
	6	250.102	256,098	226.2	70170.7	2667.85	208.6	527.7
	7	547.540	560,695	493.1	153630.4	3952.23	454.7	1150.6
	8	552.538	565,863	497.7	155046.5	5011.13	459.0	1161.2
	9	402.546	411,441	361.8	112734.9	5205.98	333.7	844.2
	10	287.825	295,093	259.1	80855.5	2764.63	239.0	604.6
	11	261.011	268,277	236.1	73507.9	3899.59	217.7	550.8
	12	328.531	340,574	298.4	93317.4	4236.25	275.2	696.3
		Total	3,088,708	3,213,053	2,828	880,377	31,809	2,608
	Ave	3,020,542	3,117,477	2,738	854,189	25,802	2,525	6,389
2012	1	368.745	379,499	331.9	104109.1	4899.35	306.1	774.4
	2	576.575	593,390	518.9	162786.6	5543.86	478.6	1210.8
	3	700.052	720,468	630.0	197648.4	7185.58	581.0	1470.1
	4	123.418	196,553	171.9	53921.2	1430.62	158.5	401.1
	5	583.942	705,805	617.2	193625.9	5097.79	569.2	1440.2
	6	468.252	727,148	635.9	199480.8	5817.53	586.4	1483.7
	7	443.085	294,683	257.7	80841.2	7953.6	237.7	601.3
	8	603.752	529,068	462.7	145141.0	7549.64	426.7	1079.6
	9	595.486	406,160	355.2	111423.3	6371.91	327.6	828.8
	10	558.382	574,666	502.5	157650.1	2535.32	463.5	1172.6
	11	412.050	424,067	370.8	116335.6	2259.07	342.0	865.3
	12	316.606	325,839	284.9	89388.6	2775.45	262.8	664.9
		Total	5750,345	5,877,346	5,139.6	1,612,351.8	59,419.72	4,740.1
	Ave	4,419,527	4,545,200	3,984	1,246,364	45,614	3,674	9,295

Average based on previous 2 years

Boiler 1 and 2 Rolling 2 Year Average Summary

VOC, tons			CO, tons			NOx, tons			SOx, tons			PM10, tons		
Unit1	Unit2	Total	Unit1	Unit2	Total	Unit1	Unit2	Total	Unit1	Unit2	Total	Unit1	Unit2	Total
4.37	1.63	6.00	753.38	512.82	1266.2	15.65	12.90	28.55	2.21	1.50	3.71	4.95	3.80	8.75



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 107	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

Appendix E

Modeling

The proposed projects will result in the release of 5 criteria pollutants plus toxics. Modeling is required to determine the impacts on ambient air quality and visibility from the release of NOx, SOx, CO, and PM10. Also, a health risk assessment is required for toxics. Modeling for the criteria pollutant impacts was conducted based on both an individual and combined basis from the 6 new turbines, and on an individual equipment basis for the HRA.

Meteorological data from the John Wayne airport station was used. Although the District's Costa Mesa meteorological station is closer to the project site, the data from the John Wayne airport station was deemed appropriate for this project because of the following factors:

- a) Surface characteristics at John Wayne airport are more similar to the project site
- b) John Wayne airport data is more current
- c) John Wayne airport has less missing data
- d) Costa Mesa data is problematic

Background concentrations were determined using North Coastal Orange County monitoring station data for the last 5 years (2008-2012).

The stack parameters and emission rates used in the modeling, and the model results are summarized in the following tables:

Criteria Pollutant Modeling

Start Up/Shutdown and Normal Operations

To determine the turbine impacts during a start up, shutdown, and full load normal operations, a screening level model was performed for 3 temperature conditions (110, 66, and 32 deg F) and 5 different load scenarios (start up, 80%, 90%, 100% without duct firing, and 100% with duct firing) for a total of 15 different scenarios to determine the worst case impacts. Once the worst case impacts were determined per pollutant, the stack parameters for that case in combination with the emission rates as shown in Table E.1 were used in the refined model.



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 108	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

Table E.1 Modeled Stack Parameters - Start Up/Shutdowns and Normal Operation

		Stack Diameter, m	Stack Ht, m	Stack Temp, K	Exhaust velocity, m/s	Reference Case #
NOx	1 hour Annual	5.49	36.6	461	15.4	15
		5.49	36.6	460	16.7	10
CO	1 hour	5.49	36.6	461	15.4	15
	8 hour	5.49	36.6	461	15.4	15
SO2	1 hour	5.49	36.6	455	21.8	11
	3 hour	5.49	36.6	455	21.8	11
	24 hour	5.49	36.6	455	21.8	11
PM10/P M2.5	24 hour	5.49	36.6	455	21.8	11
	Annual	5.49	36.6	460	16.7	10

Case 10 = 66 deg F, 70% load, Case 11 = 110 deg F 100% load with duct firing, Case 15 = 110 deg F 70% load

Table E.2 Modeled Emission Rates - Start Up/Shutdowns and Normal Operation

Averaging Time	Worst-case Emission Scenario	Pollutant	Emissions Per Turbine, lbs/hr
1-hour	NOx: All turbines in start up mode CO: All turbines in start up mode SOx: 100% load with duct firing, 110°F ambient temperature	NOx	25.5
		CO	115
		SOx	2.45
3-hour	SOx: Continuous 100% load operation with duct firing, 110°F ambient temperature	SOx	44.1
8-hour	CO: One cold start, two warm starts, 3 shutdowns, and remainder of period at 70% load	CO	45.4
24-hour	PM10/PM2.5: continuous 100% load operation with duct firing SOx: continuous 100% load operation with duct firing, 110°F ambient temperature	PM10	9.5
		SOx	2.45
Annual ¹	NOx, PM10, PM2.5: All turbines operate at 100% load for 6,370 hours (5,900 without duct firing, 470 with duct firing), 24 cold starts, 150 warm starts, 450 hot starts, and 624 shutdowns	NOx	9.22
		PM10	3.79

¹ - the annual operating scenario is revised from the original proposal of 5,000 hrs/yr without duct firing and 1200 hrs/yr with duct firing. As a result, the corresponding emissions change from 40.9 tpy to 40.4 tpy NOx and from 18.0 tpy to 16.6 tpy PM10/PM2.5

Table E.3 Model Results – Start up/Shutdown and Normal Operation



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE
109

APPL NO.
See Below

PROCESSED BY
CP01

PAGES
141

DATE
4/1/14

CHECKED BY

Pollutant	Averaging Period	Maximum Predicted Impact (ug/m3)	Background Concentration (ug/m3) ⁽¹⁾	Total Concentration (ug/m3)	NAAQS (ug/m3)	CAAQS (ug/m3)
NO2	1-hour	58.8	140	198.8	NA	339
	Annual	0.5	21.3	21.8	57	57
CO	1-hour	333	3,329	3,662	40,000	23,000
	8-hour	78	2,530	2,608	10,000	10,000
SO2	1-hour	7.1	24.9	32.0	NA	655
	1-hour	7.1	10.7	17.8	196	NA
	24-hour	2.4	5.5	7.9	365	105
PM10	24-hour	4.7	48.0	52.7	NA	150

Commissioning

NOx and CO during commissioning were modeled on a worst case scenario where 1 power block is undergoing commissioning (steam blows) while the other power block is operating under normal conditions. A permit condition will be placed in the permit which restricts the commissioning operation to 1 turbine undergoing steam blows at no more than 50% load while the other 2 turbines in the power block are not operating. Additionally, all other commissioning activities would be restricted to no more than 2 turbines undergoing fired commissioning activities simultaneously.

Table E.4 Modeled Emission Rates, Commissioning

Turbine Operating Scenario	Pollutant	Averaging Period	Emissions Per Turbine, lbs/hr	
			Commissioning	Start Up
3 turbines undergoing commissioning (steam blows @ 50% load), 3 turbines undergoing cold start up	NOx	1-hour	109.7	25.5
	CO	1-hour	3,169	115
		8-hour	3,169	115

Table E.5 Stack Parameters – Commissioning

Turbine Operating Scenario	Averaging Period	Stack Temp, K	Exhaust Velocity, m/s	Exhaust Flow, m ³ /s
3 turbines, 50% load steam blows	1-hour	465.9	9.90	234.2
	8-hour	465.9	9.90	234.2
3 turbines, cold start up	1-hour	461	15.4	364.4
	8-hour	461	15.4	364.4



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 110	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

Pollutant	Averaging Period	Maximum Predicted Impact (ug/m3)	Background Concentration (ug/m3) ⁽¹⁾	Total Concentration (ug/m3)	NAAQS (ug/m3)	CAAQS (ug/m3)
NO2	1-hour	146.3	140	286.3	NA	339
CO	1-hour	5,076	3,329	8,405	40,000	23,000
	8-hour	4,369	2,530	6,899	10,000	10,000

PSD, Deposition, and Visibility Analysis

Because of the distance from the project site to the nearest Class I areas is > 50 km, the facility used a screening calculation to show that a visibility and deposition analysis is not required for Class I areas. The facility was however, required to perform a visibility analysis for impacts on Class II areas, which they did using VISCREEN. Because it was determined that the project impacts exceeded the US EPA 1-hour NO2 significant impact level of 7.52 ug/m3, a cumulative PSD model was performed for NO2 impacts using AERMOD and the stack parameters and turbine emission rates of Tables E.1 and E.2.

Table E.6 Model Results, Cumulative NO2 Impacts

Pollutant	Averaging Period	Total Concentration (ug/m3)	NAAQS (ug/m3)
NO2	1-hour	168.2	188

Table E.7 Model Inputs, Visibility

Pollutant	Emission Rate, TPY (6 Turbines)
NO2	242.3
PM10	16.6

Table E.7 Model Results, Visibility

Level of Acceptable Change = 5%			
Predicted % Change in Light Extinction Coefficient			
Class I Area	2001	2002	2003
San Geronio Wilderness	7.82*	4.77	3.15
San Jacinto Wilderness	2.02	2.90	2.16
Agua Tibia Wilderness	1.88	1.87	2.43
Joshua Tree National Park	2.82	1.45	2.70



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 111	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

Table E.8 Tier I VISCREEN Results

Class II Area	Min Dist.	Max Dist.	Modeled Parameter	Sky	Terrain	Significance Threshold
Crystal Cove SP	12.5	18.4	Color Difference Index (Delta E)	3.961	7.746	2
			Contrast (C)	-0.041	0.042	0.05
Water Canyon SP	33.6	42.9	Color Difference Index (Delta E)	1.732	2.326	2
			Contrast (C)	-0.018	0.021	0.05
Chino Hills SP	35.8	41.6	Color Difference Index (Delta E)	1.437	1.612	2
			Contrast (C)	-0.015	0.017	0.05
San Mateo Canyon Wilderness Area	44.3	57.6	Color Difference Index (Delta E)	1.083	1.564	2
			Contrast (C)	0.011	0.015	0.05

Since the Tier I results exceeded the threshold for Crystal Cove and Water Canyon, a Tier II assessment was performed for these areas.

Table E.9 Tier II VISCREEN Results

Class II Area	Min Dist.	Max Dist.	Modeled Parameter	Sky	Terrain	Significance Threshold
Crystal Cove SP	12.5	18.4	Color Difference Index (Delta E)	0.319	0.687	2
			Contrast (C)	0.003	0.004	0.05
Water Canyon SP	33.6	42.9	Color Difference Index (Delta E)	0.586	0.797	2
			Contrast (C)	0.006	0.007	0.05

Air Toxics Health Risk Assessment (HRA)

A Tier 4 HRA was performed for the project using CARB's Hotspots Analysis and Reporting Program (HARP, version 1.4f).



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 112	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

Table E.8 Modeled Emission Rates For HRA

Pollutant	Emission Factor	Emissions per Turbine	
	lbs/mmbtu	lbs/hr	lbs/yr
Ammonia	5 ppm	1.32E+01	8.61E+04
Acetaldehyde	4.00E-05	8.02E-02	3.93E+02
Acolein	6.40E-06	1.28E-02	6.29E+01
Benzene	1.20E-05	2.41E-02	1.18E+02
1,3 Butadiene	4.30E-07	8.62E-04	4.23E+00
Ethyl Benzene	3.20E-05	6.42E-02	3.14E+02
Formaldehyde	7.10E-04	5.77E-01	2.83E+03
Naphthalene	1.30E-06	2.61E-03	1.28E+01
PAH	2.20E-06	1.80E-03	8.85E+00
Propylene Oxide	2.90E-05	5.81E-02	2.85E+02
Toluene	1.30E-04	2.61E-01	1.28E+03
Xylene	6.40E-05	1.28E-01	6.29E+02

Hourly emission rates based on 2,005 mmbtu/hr (maximum turbine heat input with duct burner firing at low temp), annual emission rates based on 1,403 mmbtu/hr for 6,365 hrs/yr and 1,910 mmbtu/hr for 470 hrs/yr (turbine and duct burner heat inputs at annual average temp).

Table E.9 Modeled Stack Parameters for HRA

Parameter	Hourly Impacts (case # 15)	Annual Impacts (case # 10)
Stack Diameter, m	5.49	5.49
Stack Height, m	36.6	36.6
Stack Temp, K	461	460
Stack Velocity, m/s	15.4	16.7

Case 10 = 66 deg F, 70% load, Case 15 = 110 deg F 70% load



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 113	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

Table E.10 Model Results – HRA

	Residential Cancer Risk	Residential Chronic HI	Residential Acute HI
Stack 1	0.42 per million	0.00124	0.0244
Stack 2	0.39 per million	0.00113	0.0291
Stack 3	0.36 per million	0.00104	0.0203
Stack 4	0.46 per million	0.00135	0.00368
Stack 5	0.47 per million	0.00136	0.00897
Stack 6	0.47 per million	0.00136	0.0117
	Worker Cancer Risk	Worker Chronic HI	Worker Acute HI
Stack 1	0.095 per million	0.00154	0.0244
Stack 2	0.095 per million	0.00154	0.0291
Stack 3	0.121 per million	0.00197	0.0203
Stack 4	0.095 per million	0.00154	0.00368
Stack 5	0.095 per million	0.00154	0.00897
Stack 6	0.096 per million	0.00157	0.0117



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 114	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

Appendix F

Greenhouse Gases

Out of the six GHG pollutants:

- carbon dioxide, CO₂,
- methane, CH₄,
- nitrous oxide, N₂O
- hydrofluorocarbons, HFCs
- perfluorocarbons, PFCs
- sulfur hexafluoride, SF₆

Only the first 3 are emitted by combustion sources. Sulfur hexafluoride can be emitted by circuit breakers.

The following emission factors and global warming potential (GWP) will be used in the calculations:

Table F.1 GHG Emission Factors

GHG	Emission Factor, natural gas		GWP
	kg/mmbtu	lbs/mmcf	
CO ₂	53.02	120,160	1.0
CH ₄	1.0E-03	2.27	21
N ₂ O	1.0E-04	0.227	310

The emission factors in kg/mmbtu are converted to lbs/mmcf assuming the default HHV of 1028 btu/cf from 40 CFR98 Subpart C Table C-1. 1 kg = 2.2046 lbs.

CO₂ equivalent (CO₂e) is calculated using the following equation:

$$CO_2e = CO_2 + 21*CH_4 + 310*N_2O$$

Or, using fuel consumption (F):

$$CO_2e = 120,160*F + 2.27*21*F + 0.227*310*F = 120,278*F \text{ (in lbs)}$$

$$CO_2e = 60.139*F \text{ (in tons)}$$

Existing Sources

There are 2 existing sources of GHG emissions at the Huntington Beach site, Boilers 1 and 2. The following data will be used in the GHG PTE calculations for these units:

PTE

Maximum Rating



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE
115

APPL NO.
See Below

PROCESSED BY
CP01

PAGES
141

DATE
4/1/14

CHECKED BY

Boiler 1 2021 mmbtu/hr
Boiler 2 2021 mmbtu/hr

Table F.2 Boilers 1 and 2 GHG PTE

Pollutant	Boiler 1, tons		Boiler 2, tons	
	Hourly	Annual	Hourly	Annual
CO2	118.2	1,028,783	118.2	1,028,783
CH4	2.23E-03	19.4	2.23E-03	19.4
N2O	2.23E-04	1.94	2.23E-04	1.94
Total Mass	118.2	1,028,804	118.2	1,028,804
CO2e	118.3	1,029,792	118.3	1,029,792

Actual Emissions

The data from Appendix E is used to calculate the past actual emissions.

Table F.3 Boilers 1 and 2 GHG Actual Emissions

	2006	2007	2008	2009	2010	2011
Boiler 1						
heat input, mmbtu	4,339,213	5,066,254	5,931,929	4,149,898	2,529,374	2,837,549
CO2, lbs	507,201,461	592,183,750	693,370,676	485,072,829	295,653,195	331,675,121
CH4, lbs	4,341.4	5,068.5	5,934.1	4,152.1	2,531.6	2,839.8
N2O, lbs	956.6	1,116.9	1,307.8	914.9	557.6	625.6
Total Mass, tons	253,603	296,095	346,689	242,539	147,828	165,839
CO2e, tons	253,795	296,318	346,950	242,722	147,940	165,964
Boiler 2						
heat input, mmbtu	3,925,001	1,699,823	4,294,841	3,191,577	3,021,901	3,213,053
CO2, lbs	458,785,093	198,688,727	502,014,911	373,056,708	353,223,638	375,566,992
CH4, lbs	3,927.2	1,702.0	4,297.0	3,193.8	3,024.1	3,215.3
N2O, lbs	865.3	374.7	946.8	703.6	666.2	708.3
Total Mass, tons	229,395	99,345	251,010	186,530	176,614	187,785
CO2e, tons	229,568	99,420	251,199	186,671	176,747	187,927

New Turbines

PTE

The annual operating schedule is used to calculate the annual heat input as follows:



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 116	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

Table F.4 - New Turbines Annual Operating Schedule

Event	Duration/yr ⁽¹⁾	Heat Input ⁽²⁾
Cold Start	36	(included below)
Warm Start	81.25	(included below)
Hot Start	243.75	(included below)
Shutdown	104	(included below)
100% Load @ 68.5 deg F w/o DB	5900	1744.3(includes start ups/shutdowns)
100% Load @ 68.5 deg F with DB	470	507
Total Per Turbine	6835	11,159,352

(1) Based on 24 cold starts (1.5 hrs each), 150 warm starts (32.5 min each), 450 hot starts (32.5 min each), and 624 (10 min each) shutdowns per month

(2) DB heat input = 507 mmbtu/hr, turbine heat input without DB, including start up and shutdowns = 1744.3 mmbtu/hr (given). Total annual heat input = 507*470 + 1744.3*(5900 + 361)

Table F.5 New Turbines GHG PTE

GHG	Hourly Tons Per Turbine @ 2005 mmbtu/hr	Annual Tons Per Turbine @ 11,159,352 mmbtu/yr	Annual Tons 6 Turbines
CO2	117.2	652,197	3,913,182
CH4	2.21E-3	12.3	73.8
N2O	2.21E-4	1.2	7.4
Total Mass	117.2	652,211	3,913,266
CO2e	117.3	652,827	3,916,962

Estimated Actual Annual Emissions Including All Operations

AES HB provided data on the expected heat rates for different load scenarios and different configurations. For each configuration (1X1, 2X1, and 3X1), AES provided heat rates for 5 different power outputs ranging from about 50-60% load up to 100% load. The 100% load configurations include duct firing for 1X1 and 2X1 configurations, but not for the 3X1 configuration, since the duct burners do not operate at 100% load in a 3X1 configuration. AES HB also provided the expected number of hours the plant would operate under each scenario, and heat rates for start ups and shutdowns.

The overall average heat rate is then obtained by taking the average heat rate for each configuration multiplied by the hours of operation for each configuration (shown in Tables F.9-F.11), including start ups and shutdowns, and dividing by the total annual hours of operation. The heat rates during start up and shutdown are much higher than during normal operation because the units are operating in simple cycle mode with no steam generation.

The data is presented below:



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 117	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

1 Power Block

Table F.6 – Heat Rates 1 on 1 Configuration

Net Plant Power	kW	116997	130750	144285	161150	203570 w/DB
Net Heat Rate, LHV	Btu/kW-hr	7969	7796	7669	7578	7979
Estimated Gross Heat Rate, LHV	Btu/kW-hr	7730	7562	7439	7351	7740
Estimated Net Heat Rate, HHV	Btu/kW-hr	8766	8576	8436	8336	8777

Table F.7 – Heat Rates 2 on 1 Configuration

Net Plant Power	kW	241081	268702	295720	329459	367913 w/DB
Net Heat Rate, LHV	Btu/kW-hr	7733	7587	7484	7413	7683
Estimated Gross Heat Rate, LHV	Btu/kW-hr	7501	7359	7259	7191	7453
Estimated Net Heat Rate, HHV	Btu/kW-hr	8506.3	8345.7	8232.4	8154.3	8451.3

Table F.8 – Heat Rates 3 on 1 Configuration

Net Plant Power	kW	363249	367918	403656	443066	492265
Net Heat Rate, LHV	Btu/kW-hr	7698	7681	7575	7492	7440
Estimated Gross Heat Rate, LHV	Btu/kW-hr	7467	7451	7348	7267	7217
Estimated Net Heat Rate, HHV	Btu/kW-hr	8467.8	8449.1	8332.5	8241.2	8184

2 Power Blocks

Table F.9 – Heat Rates 1 on 1 Configuration (325 hrs/yr)

Net Plant Power	kW	233954	261500	288570	322300	407140 w/DB
Net Heat Rate, LHV	Btu/kW-hr	7969	7796	7669	7578	7979
Estimated Gross Heat Rate, LHV	Btu/kW-hr	7730	7562	7439	7351	7740
Estimated Net Heat Rate, HHV	Btu/kW-hr	8765.9	8575.6	8435.9	8335.8	8776.9
Average power output, kW = 302,693		Average net heat rate, HHV = 8578				



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 118	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

Table F.10 – Heat Rates 2 on 1 Configuration (4160 hrs/yr)

Net Plant Power	kW	482162	537404	591440	658918	735826 w/DB
Net Heat Rate, LHV	Btu/kW-hr	7733	7587	7484	7413	7683
Estimated Gross Heat Rate, LHV	Btu/kW-hr	7501	7359	7259	7191	7453
Estimated Net Heat Rate, HHV	Btu/kW-hr	8506.3	8345.7	8232.4	8154.3	8451.3
Average power output, kW = 601,150		Average net heat rate, HHV = 8338				

Table F.11 – Heat Rates 3 on 1 Configuration (1898 hrs/yr)

Net Plant Power	kW	726498	735836	807312	886132	984530
Net Heat Rate, LHV	Btu/kW-hr	7698	7681	7575	7492	7440
Estimated Gross Heat Rate, LHV	Btu/kW-hr	7467	7451	7348	7267	7217
Estimated Net Heat Rate, HHV	Btu/kW-hr	8467.8	8449.1	8332.5	8241.2	8184
Average power output, kW = 828,062		Average net heat rate, HHV = 8335				

Table F.12 Heat Rates Start Ups and Shutdowns

Start Up Heat Rate	18267 btu/kWh	361 hours
Shut Down Heat Rate	16520 btu/kWh	104 hours

The overall average heat rate is determined by the following equation:

$$\text{Overall net heat rate} = \frac{[(\text{Avg Heat Rate X \# of Hours for 1X1 Configuration}) + (\text{Avg Heat Rate X \# of Hours 2X1 Configuration}) + (\text{Avg Heat Rate X \# of Hours 3X1 Configuration}) + (\text{Heat Rate X \# of Hours Start Ups}) + (\text{Heat Rate X \# of Hours Shutdowns})]{\text{Total Annual Hours of Operation}}$$

Scenario 1

Operation at fully permitted normal hours and fully permitted start up and shutdowns

$$\text{Overall net heat rate} = \frac{(8578 \text{ btu/kWh} * 325 \text{ hrs} + 8338 \text{ btu/h} * 4160 \text{ hrs} + 8335 \text{ btu/kWh} * 1898 \text{ hrs} + 18267 \text{ btu/kWh} * 361 \text{ hrs} + 16520 * 104 \text{ hrs})}{(5900 + 470 + 361 + 104 \text{ hrs})} = 9013.3 \text{ btu/kWh}$$

(Using the same calculation procedure, the overall gross heat rate = 8,779.7)

CO2

$$9013.3 \text{ btu/kWh} * 1000 \text{ kWh/MWh} * 1 * 10^{-6} \text{ MMBtu/Btu} * 53.02 \text{ kg CO}_2/\text{MMBtu-HHV} * 2.205 \text{ lb/kg} = 1,053.7 \text{ lb CO}_2/\text{MWH}$$

1,053.7 lb CO2/netMWH @ HHV (no equipment degradation)



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 119	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

Assuming an 8% equipment degradation, the estimated heat rate and CO₂e emissions are

Heat Rate with equipment degradation $9013.3 \text{ btu/kw-hr} * 1.08 = 9734.4 \text{ btu/kw-hr}$
 CO₂e with equipment degradation $1,053.7 * 1.08 = 1138.0 \text{ lb CO}_2\text{e/netMWH @ HHV}$

Scenario 2

Operation at 90% of fully permitted normal hours with 12 cold starts, 50 warm and 100 hot starts, 162 shutdowns

Overall net heat rate = $(8578 \text{ btu/kWh} * 292.5 \text{ hrs} + 8338 \text{ btu/h} * 3744 \text{ hrs} + 8335 \text{ btu/kWh} * 1708.2 \text{ hrs} + 18267 \text{ btu/kWh} * 99.25 \text{ hrs} + 16520 * 27 \text{ hrs}) / (5744.7 + 99.25 + 27 \text{ hrs}) = 8554.6 \text{ btu/kWh}$

CO₂

$8554.6 \text{ btu/kWh} * 1000 \text{ kWh/MWh} * 1 * 10^{-6} \text{ MMBtu/Btu} * 53.02 \text{ kg CO}_2\text{/MMBtu-HHV} * 2.205 \text{ lb/kg} = 1,000 \text{ lb CO}_2\text{/MWH}$

1,000 lb CO₂/netMWH @ HHV (no equipment degradation)

- **SF₆**

The facility has indicated that there will be about 624 pounds of sulfur hexafluoride (SF₆) contained within the HBEP circuit breakers. The leak rate assumed by HBEP is 0.1 percent per year, therefore, the expected emissions would be 0.624 pounds per year, or 6.8 tons per year of CO₂e assuming a global warming potential for SF₆ of 23,900.





**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 120	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

Appendix G – Facility Plot Plan

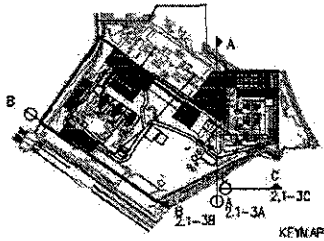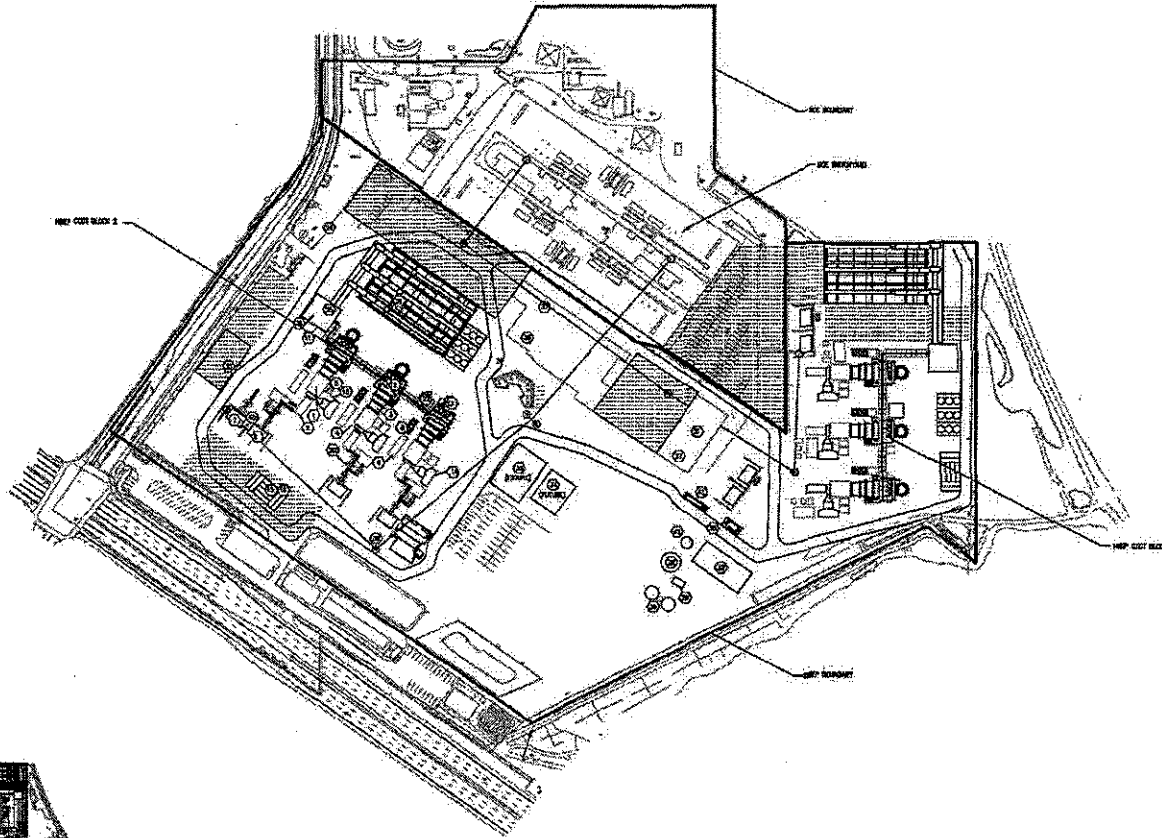




South Coast
Air Quality Management District

Engineering Division
Application Processing & Calculations

PAGE 121	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

Appendix H – Elevation View

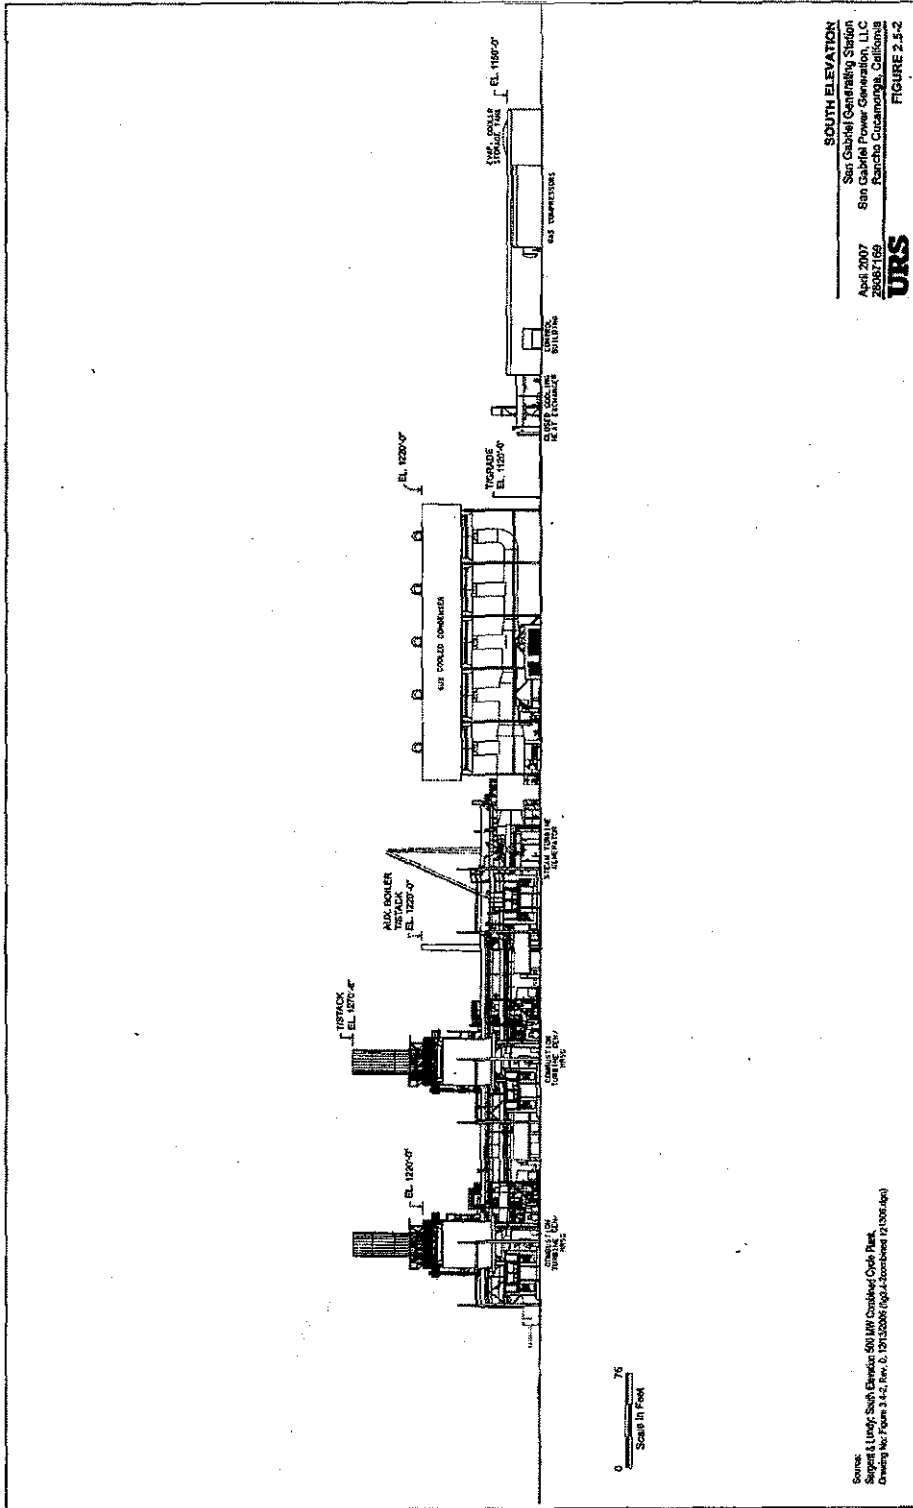



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE
122

PAGES
141


APPL NO.
See Below

DATE
4/1/14

PROCESSED BY
CP01

CHECKED BY

Appendix I -- Process Flow

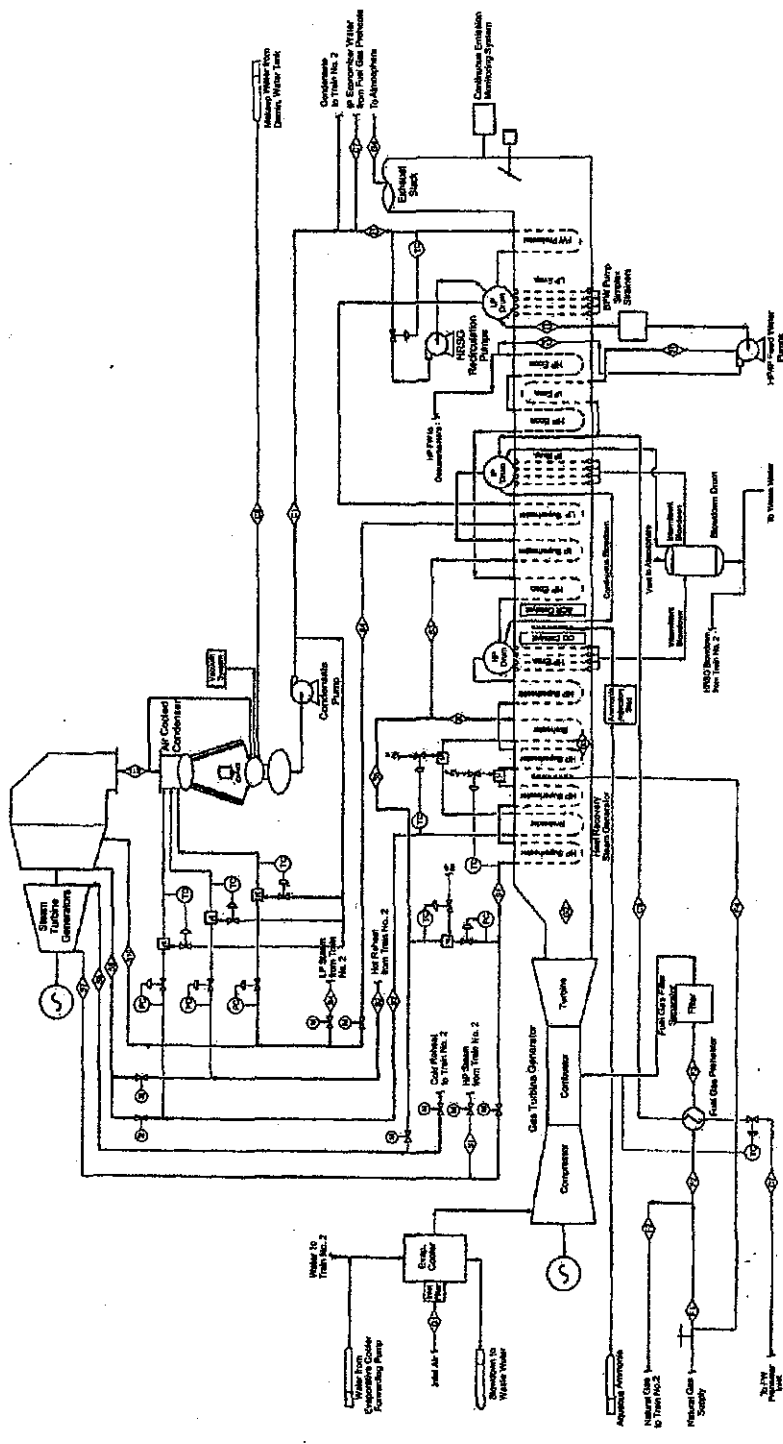

PROCESS FLOW DIAG
POWER B1
San Gabriel Generating
San Gabriel Power Generation
Rancho Cucamonga, CA
April 2007
28077189
URS
FIGURE

Source:
Sargent & Lundy; CD0406; sldmain_0414.dgn

200707 rev. 10/04/07 (Sargent & Lundy) 28077189.dwg



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE
123

APPL NO.
See Below

PROCESSED BY
CP01

PAGES
141

DATE
4/1/14

CHECKED BY

Appendix J

Nearest Schools

The following schools (K-12) were determined to be located within the vicinity of the proposed project:


	School	Location	Approx Distance from HBEP
1	Edison High	21400 Magnolia St	0.6 miles NE
2	William E Kettler School	8750 Dorsett Dr	0.65 miles NE
3	John H Eader School	9291 Banning Ave	0.91 miles SE
4	John R Peterson Elementary	20661 Farnsworth Lane	1.18 miles NW
5	Brethren Christian Jr/Sr High	21141 Strathmoor Lane	1.39 miles NE
6	St Simon and St Jude Elementary	20400 Magnolia St	1.14 miles NE
7	Sacred Heart Institute School	419 Main St	1.45 miles NW
8	Isaac L Sowers Middle School	9300 Indianapolis Ave	1.48 miles NE
9	S A Moffett Elementary	8900 Burlcrest Dr	1.5 miles N
10	Robert H Burke School	9700 Levee Dr	1.57 miles NE



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 124	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

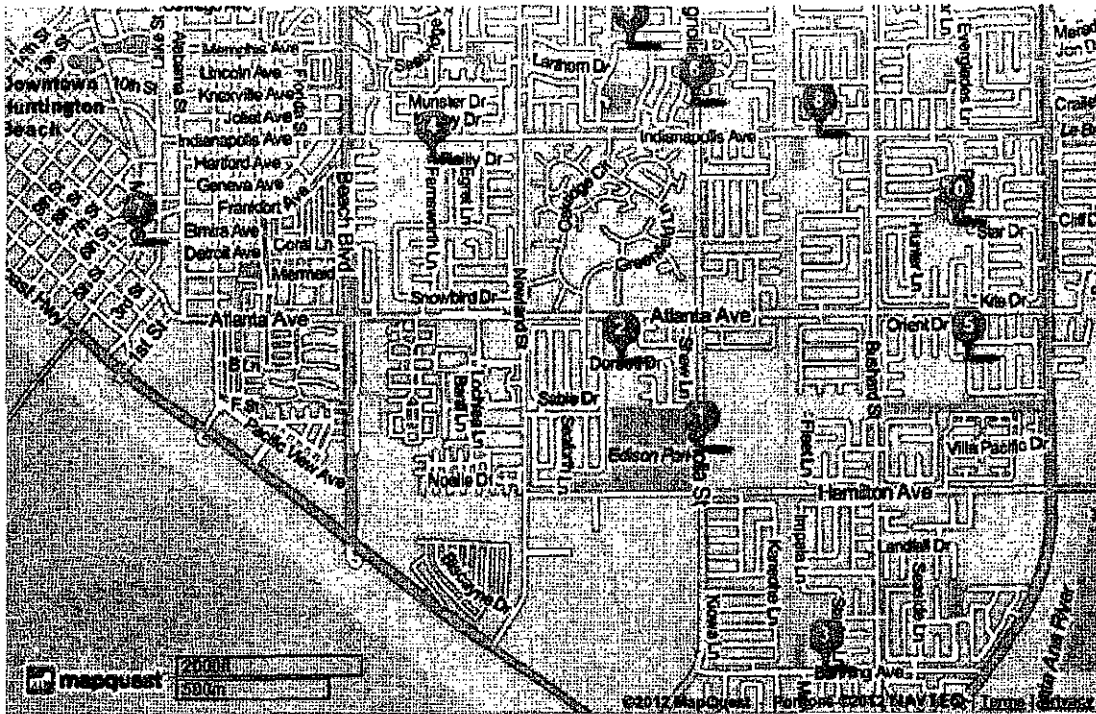



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE
125

PAGES
141

APPL NO.
See Below

DATE
4/1/14

PROCESSED BY
CP01

CHECKED BY

Appendix K

Facility Reported Emissions

The following tables summarize the annual emissions reported to AQMD by the facility for the most recent 2 year period:

Table K.1 Reported Criteria Emissions

Pollutant	Emissions, tpy	
	2011	2012
NOx	38.834	55.818
CO	443.266	669.180
VOC	8.458	4.972
PM10	14.051	8.680
SOx	4.237	3.566

Table K.2 Reported Toxic Emissions

Pollutant	Emissions, lbs/yr	
	2011	2012
Ammonia	13653.598	9734.850
Benzene	17.359	14.866
Formaldehyde	36.768	31.211
Naphthalene	3.062	2.587
PAHs	1.021	0.860
1,3 Butadiene	0.005	0.067

These emissions are for the total facility and include operation of the utility boilers, the 2 emergency generators, and smaller unpermitted equipment used at the site.



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 126	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

Appendix L

Major Source Determinations

The following data is used in the calculations:

Table L.1

Pollutant	Uncontrolled ⁽¹⁾		Controlled ⁽¹⁾		Cold Start	Warm Start	Hot Start	Shutdown
	With DB	W/O DB	With DB	W/O DB				
	lbs/hr	lbs/hr	lbs/hr	lbs/hr				
NOx	30.3	66.6	14.8	11.0	28.7	16.6	16.6	9.0
CO	33.5	45.0	9.0	6.7	115.9	46.0	33.6	45.3
VOC	5.1	3.8	5.1	3.8	27.9	21.0	20.4	31.0

(1) From Table A.3

Table L.2

Pollutant	With DB	W/O DB	Cold Start	Warm Start	Hot Start	Shutdown
	lbs/hr	lbs/hr	lbs/hr	lbs/hr	lbs/hr	lbs/hr
PM10/PM2.5	9.5	4.5	4.5	4.5	4.5	4.5
SOx	2.78	2.08	1.97	1.97	1.97	1.97

Table L.3

Event	# of Events Per Year	Duration, Each	Total Annual Duration
		minutes	hours
Cold Start	24	90	36
Warm Start	150	32.5	81.25
Hot Start	450	32.5	243.75
Shutdown	624	10	104

Table L.4

Operating Mode	Hours Per Year
With Duct Firing	470
Without Duct Firing	5,900
Start up/shutdown	465

1. 40CFR 64 CAM

For purposes of 40CFR 64, CAM Regulation, a major source is defined as a source or group of sources with pre-control potential to emit (PTE) emission levels exceeding those in Part 70 and Part 71.



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE
127

APPL NO.
See Below

PROCESSED BY
CP01

PAGES
141

DATE
4/1/14

CHECKED BY

Table L.5

Pollutant	Pre-Control PTE, tpy			Major Source?
	Per Turbine	Total 6 Turbines	Threshold	
NOx	113.2	679.0	10	Y
CO	135.9	815.6	50	Y
VOC	32.1	192.7	10	Y
PM10	16.6	99.3	70	Y
SOx	7.3	43.6	100	N

Sample Calculation:

NOx = 5,900 hrs *(30.3 lbs/hr) + 470 hrs (66.6) + 24 cold starts (28.7 lbs/start) + 150 warm starts (16.6 lbs/start) + 450 hot starts (16.6 lbs/start) + 624 shutdowns (9.0 lbs/shutdown)

PM10 = 5,900 hrs (4.5) + 470 hrs (9.5) + 36 hrs (4.5) + 81.25 hrs (4.5) + 243.75 hrs (4.5) + 104 hrs (4.5)

2. 40CFR 63 - NESHAPS

For NESHAPS, a major source is defined as a site that emits or has the potential to emit 10 tpy or more of any single HAP, or 25 tpy or more of any combination of HAPs (HAP being defined as one of the 187 air contaminants listed in the Section 112(b)(1), which does not include ammonia). See Appendix D for the calculations.

Table L.6 Total TAC Facility Emissions

Pollutant	Emission Factor	Emissions Per Turbine	Total Emissions, 6 Turbines
	lbs/mmbtu	lbs/yr	lbs/yr
Acetaldehyde	4.00E-05	4.19E+02	2.51E+03
Acrolein	3.62E-06	3.79E+01	2.28E+02
Benzene	3.26E-06	3.42E+01	2.05E+02
1,3 Butadiene	4.30E-07	4.51E+00	2.70E+01
Ethyl Benzene	3.20E-05	3.35E+02	2.01E+03
Formaldehyde	3.60E-04	3.77E+03	2.26E+04
Naphthalene	1.30E-06	1.36E+01	8.17E+01
PAH	2.20E-06	2.30E+01	1.38E+02
Propylene Oxide	2.90E-05	3.04E+02	1.82E+03
Toluene	1.30E-04	1.36E+03	8.17E+03
Xylene	6.40E-05	6.71E+02	4.02E+03
		Total, lbs/yr	4.19E+04
		Tons/yr	20.9



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 128	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

3. PSD

For purposes of PSD, the major source threshold for a fossil fuel fired steam electric plant with a heat input greater than 250 mmbtu/hr is the actual or potential to emit 100 tpy of any regulated NSR pollutant less any emission reduction from shutdown or modification. If the source 'in and of itself' is a major source, ie > 100 tpy, then netting is not allowed. For GHG emissions, the major source threshold is EITHER 75,000 tpy CO₂e AND a net increase greater than 0 tpy total GHG mass if the source is subject to PSD for another regulated pollutant ('anyway' sources). Or, for an existing major source of GHG's, the modification is major if it results in an increase of 75,000 tpy CO₂e AND a net increase of GHG mass greater than 0 tpy. For an existing minor source of GHG's, the modification is major if it results in an increase of 100,000 tpy CO₂e AND a net increase greater than 100 tpy GHG.

Table L.7

Pollutant	PTE, tpy			Major Source?
	Per Turbine	Total 6 Turbines	Threshold	
NO _x	46.8	280.8	100	Y
CO	54.7	328.0	100	Y
SO _x	7.3	43.6	100	N
PM _{2.5} /PM ₁₀	16.6	99.3	100	N
CO ₂ e ⁽¹⁾	652,827	3,916,962	100,000	Y

(1) From Table F.5

NO_x = 5,900 hrs *(11.0 lbs/hr) + 470 hrs (14.8 lbs/hr) + 24 cold starts (28.7 lbs/start) + 150 warm starts (16.6 lbs/start) + 450 hot starts (16.6 lbs/start) + 624 shutdowns (17.8 lbs/shutdown)

PM_{2.5} = 5,900 hrs (4.5 lbs/hr) + 470 hrs (9.5 lbs/hr) + 36 hrs (4.5 lbs/hr) + 81.25 hrs (4.5 lbs/hr) + 243.75 hrs (4.5 lbs/hr) + 104 hrs (4.5 lbs/hr)

Existing Facility

The PM_{2.5} PTE of the existing facility is summarized below, and is calculated using the following data:

Boiler 1:

Rating = 2012 mmbtu/hr
 Fuel use = 1.92 mmscf/hr (@ 1050 btu/scf)
 PM_{2.5} E.F. = 1.86 lbs/mmscf (from Table D.1)

Boiler 2:

Rating = 2012 mmbtu/hr
 Fuel use = 1.92 mmscf/hr (@ 1050 btu/scf)



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE
129

PAGES
141

APPL NO.
See Below

DATE
4/1/14

PROCESSED BY
CP01

CHECKED BY

PM2.5 E.F. = 2.1 lbs/mmcf (from Table D.1)

Table L.8

Pollutant	PTE, tpy		Total	Major Source?
	Boiler 1	Boiler 2		
PM2.5	15.6	17.7	33.3	N

The facility will operate Boilers 1 and 2 concurrently with the Block 1 turbines (Block 1 will come on line in 2nd QTR 2018, but Boilers 1 and 2 won't be shutdown until the Block 2 turbines come on line in 2nd QTR 2020). To check the major source determination for PM2.5 in this scenario, the PTE of the Block 1 turbines + Boilers 1 and 2 are summed as follows:

Table L.9

Pollutant	PTE, tpy			Total	Major Source?
	Block 1 (3 turbines)	Boiler 1	Boiler 2		
PM2.5	49.8	15.6	17.7	83.1	N



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 130	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

Appendix M

RECLAIM Reporting Emission Factor Determination

The facility is required to report NOx emissions based on the emission factor in the permit for any operation which occurs before initial certification of the CEMS (after certification or 180 days after installation whichever occurs first, missing data procedures are used). The facility will most likely certify its CEMS during or shortly after commissioning is completed. Therefore, the factor will be based on the total expected emissions during commissioning as follows:

Table M.1

Total Turbine Emissions During Commissioning	Total Turbine Fuel Use During Commissioning	Reclaim Reporting Factor
8,282 lbs	649,491 mmcf	12.75 lbs/mmcf

The facility is required to measure and record fuel use during commissioning.



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE
131

APPL NO.
See Below

PROCESSED BY
CP01

PAGES
141

DATE
4/1/14

CHECKED BY

Appendix N

Existing Units Historical Power Generation

Table N.1

Year	Month	HB1	HB2	RB6	RB8
2013	6	28703	42995	2134	11786
	5	28008	50924	3239	24982
	4	9467	17438	0	0
	3	20752	51668	0	0
	2	48920	61251	0	0
	1	20133	51273	0	0
2012	12	12677	30465	0	0
	11	0	42836	429	0
	10	7669	54102	2830	0
	9	57427	55833	5666	0
	8	45847	57913	12331	38147
	7	23496	40518	3986	0
	6	25026	42939	16986	0
	5	30144	56032	16548	8298
	4	32653	11939	20898	16549
	3	9207	69164	516	2601
	2	11467	55294	1344	0
	1	0	34478	385	0
2011	12	5	30304	0	0
	11	10886	24505	1420	0
	10	11287	27070	1913	0
	9	28584	36329	4245	936
	8	40898	53095	3560	0
	7	63608	52024	1159	0
Unit Average		23619.3	43766.2	4149.5	4304.1
Overall Average					18959.8



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 132	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

Appendix O

Summary of Applications and Processing Fees

The following table summarizes the application submittals and associated processing fees.

Table O.1

A/N	Submittal Date	Equip	Bcat	Fee Sch	Fee
539746	June 26, 2012	Gas turbine #1A	053349	G	\$15,811.76
539747	June 26, 2012	Gas turbine #1B	053349	G	7,905.88
539748	June 26, 2012	Gas turbine #1C	053349	G	7,905.88
539768	June 26, 2012	Gas turbine #2A	053349	G	7,905.88
539769	June 26, 2012	Gas turbine #2B	053349	G	7,905.88
539770	June 26, 2012	Gas turbine #2C	053349	G	7,905.88
540256	July 17, 2012	SCR/CO Catalyst #1A	81	C	3,440.06
540257	July 17, 2012	SCR/CO Catalyst #1B	81	C	1,720.03
540258	July 17, 2012	SCR/CO Catalyst #1C	81	C	1,720.03
540260	July 17, 2012	SCR/CO Catalyst #2A	81	C	1,720.03
540261	July 17, 2012	SCR/CO Catalyst #2B	81	C	1,720.03
540262	July 17, 2012	SCR/CO Catalyst #2C	81	C	1,720.03
540255	July 17, 2012	Ammonia Storage	210900	A	1,364.63
540259	July 17, 2012	Title V Revision	555009	C	1,789.12
Total					\$70,535.12

The facility will also be required to pay a fee for the public notice, and for the modeling review. There may also be a fee if there is a request for a public hearing. These fees will be billed to the facility after the permit is issued:

	Current Rate
Public Notice	\$1,204.05
Modeling Review ⁽¹⁾	4162.67
PSD Review	1,993.22
Total	\$7,359.94

(1) Plus T&M @ \$119.06/hr if above 35 hours

Total submitted \$70,535.12

Note that there are also fees for the CEMS application, which are invoiced separately by the ASTM group.



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE
133

APPL NO.
See Below

PROCESSED BY
CP01

PAGES
141

DATE
4/1/14

CHECKED BY

Appendix P

RECLAIM Trading Credit Requirement

• NOx

In accordance with Rule 2005 the facility is required to set aside sufficient RECLAIM Trading Credits (RTC) to cover the NOx emissions from the first year operation. Additionally, since the NOx PTE after the commissioning year is greater than the facility's initially allocation, the facility is required to hold NOx RTCs for each subsequent year.

During the 1st year, the turbines will be undergoing commissioning for approximately 6 months. Therefore, the NOx emissions for the 1st year of operation assume 6 months of commissioning and 6 months of normal operation for each turbine. The emissions are shown in Appendix B Table B.4 (the sum of the 1st 7 rows of NOx under the heading 'Emissions Per Turbine'), and summarized below.

	NOx
Turbine 1A	39,854
Duct Burner 1A	13,488
Total	53,342
Turbine 1B	39,854
Duct Burner 1B	13,488
Total	53,342
Turbine 1C	39,854
Duct Burner 1C	13,488
Total	53,342
Turbine 2A	39,854
Duct Burner 2A	13,488
Total	53,342
Turbine 2B	39,854
Duct Burner 2B	13,488
Total	53,342
Turbine 2C	39,854
Duct Burner 2C	13,488
Total	53,342

The RTC requirements are split between the turbine and duct burner based on the ratio of the maximum heat inputs (1498 to 507).

The total NOx RTC requirements are:

NOx RTC, 1st year = 314,054 lb/year

After the first year, commissioning will be completed, and the anticipated annual NOx emissions are based on the proposed operating schedule (Appendix B Table B.5, sum of NOx under the heading 'Emissions Per Turbine'):



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 134	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

		NOx
Turbine 1A		62,507
Duct Burner 1A		21,155
	Total	83,662
Turbine 1B		62,507
Duct Burner 1B		21,155
	Total	83,662
Turbine 1C		62,507
Duct Burner 1C		21,155
	Total	83,662
Turbine 2A		62,507
Duct Burner 2A		21,155
	Total	83,662
Turbine 2B		62,507
Duct Burner 2B		21,155
	Total	83,662
Turbine 2C		62,507
Duct Burner 2C		21,155
	Total	83,662

The RTC requirements are split between the turbine and duct burner based on the ratio of the maximum heat inputs (1498 to 507).

The total NOx RTC requirements are:

NOx RTC, subsequent years = 501,972 lb/year

- The current NOx RTC holding for the Huntington Beach facility is 179,740 lbs/yr. The initial NOx RTC allocation for this facility is 231,926 lbs/yr.

- SOx

Rule 2005 paragraph (f)(1) requires that for a facility modification which increases the annual allocation to a level greater than the starting allocation, offsets are required for the first year of operation, and each subsequent year. Since the facility opted into SOx RECLAIM, there was no initial allocation for SOx. Therefore, any increase is considered subject to the holding requirement for all compliance years. During the 1st year, the turbines will be undergoing commissioning for approximately 6 months. Therefore, the SOx emissions for the 1st year of operation assume 6 months of commissioning and 6 months of normal operation for each turbine. The emissions are shown in Appendix B Table B.4 (the sum of the 1st 7 rows of SOx under the heading 'Emissions Per Turbine'), and summarized below.



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE
135

PAGES
141

APPL NO.
See Below

DATE
4/1/14

PROCESSED BY
CP01

CHECKED BY

	SOx
Turbine 1A	2,694
Duct Burner 1A	912
Total	3,606
Turbine 1B	2,694
Duct Burner 1B	912
Total	3,606
Turbine 1C	2,694
Duct Burner 1C	912
Total	3,606
Turbine 2A	2,694
Duct Burner 2A	912
Total	3,606
Turbine 2B	2,694
Duct Burner 2B	912
Total	3,606
Turbine 2C	2,694
Duct Burner 2C	912
Total	3,606

The RTC requirements are split between the turbine and duct burner based on the ratio of the maximum heat inputs (1498 to 507).

The total SOx RTC requirements are:

SOx RTC, 1st year = 21,638 lb/year



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE
136

APPL NO.
See Below

PROCESSED BY
CP01

PAGES
141

DATE
4/1/14

CHECKED BY

After the first year, commissioning will be completed, and the anticipated annual SOx emissions are based on the proposed operating schedule (Appendix B Table B.5, sum of SOx under the heading 'Emissions Per Turbine'):

	SOx
Turbine 1A	3,798
Duct Burner 1A	1,286
Total	5,084
Turbine 1B	3,798
Duct Burner 1B	1,286
Total	5,084
Turbine 1C	3,798
Duct Burner 1C	1,286
Total	5,084
Turbine 2A	3,798
Duct Burner 2A	1,286
Total	5,084
Turbine 2B	3,798
Duct Burner 2B	1,286
Total	5,084
Turbine 2C	3,798
Duct Burner 2C	1,286
Total	5,084

The RTC requirements are split between the turbine and duct burner based on the ratio of the maximum heat inputs (1498 to 507).

The total SOx RTC requirements are:

SOx RTC, subsequent years = 30,504 lb/year

- The current SOx RTC holding for the Huntington Beach facility is 8,454 lbs/yr.



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 137	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

**SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT
MEMORANDUM**

DATE: December 12, 2013
TO: Andrew Lee
FROM: Elaine Chang
SUBJECT: Modeling Review of AES Huntington Beach Energy Project (A/N's 539746-8 & 539768-70)

As you requested, Planning, Rule Development & Area Sources (PRA) staff reviewed the modeling conducted for the AES Huntington Beach Energy Project located in the city of Huntington Beach. The June 2012 dispersion modeling analysis and health risk assessment (report) and electronic files were submitted for our review along with the modeling request memo dated November 1, 2012. Since the original submittal, there have been revisions to the project's modeling based on the use of John Wayne airport meteorological data. Our comments on the modeling conducted in the revised analysis dated October 18, 2013 are as follows:

• **AERMOD Dispersion Modeling**

- ✓ The applicant utilized AERMOD (version 12345) for the air dispersion modeling, which is the current EPA approved model and requires hourly meteorological data.
- ✓ The applicant used meteorological data from the John Wayne airport station, which is appropriate for the project. Although the District's Costa Mesa meteorological station is closer to the project site, meteorological data from the John Wayne airport was used instead because of the following factors:
 - a) Surface characteristics at John Wayne airport are more similar to the project site – the surface roughness at John Wayne airport in the predominant wind direction (i.e. from the SW quadrant) is more similar to the project site than the Costa Mesa station.
 - b) John Wayne airport data is more current – the period of record at John Wayne airport is 2008-2012, compared to 2005-2009 at Costa Mesa.
 - c) John Wayne airport has less missing data – the John Wayne airport meteorological data meets the EPA requirement that no more than 10% data is missing per quarter.
 - d) Costa Mesa data is problematic – the percent of calm winds at Costa Mesa can vary from 0% to 38% (0 hrs to 16,848 hrs) depending on how the data is processed.
- ✓ The AERMOD modeling generally conforms to the District's dispersion modeling methodology.
- ✓ The stack parameters and emission rates modeled are consistent with the parameters listed in Tables 1, 2, 4, 5, 7, and 8 of the requesting memo. These are assumed to be correct.
- ✓ The applicant used the monitoring data for SRA 18, North Coastal Orange County (No. 3195) monitoring station for the last five years (2008-2012) to determine the background concentrations. The predicted modeling impacts were added to the background concentrations for comparison to the ambient air quality standards.
- ✓ The U.S. EPA approved NO₂ to NO_x conversion ratios of 0.80 and 0.75 are assumed for evaluating 1-hour and annual NO₂ impacts from the project, respectively.



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 138	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

Andrew Lee

- 2 -

December 12, 2013

- ✓ The model results for NO₂, CO, SO₂, and PM₁₀ for the proposed project are presented in the applicant's report. PRA staff reproduced the modeling analysis.
- ✓ The proposed project is not subject to the modeling requirements of Regulation XIII per Rule 1304(a)(2). However the impacts discussed next are compared to National Ambient Air Quality Standards (NAAQS), California Ambient Air Quality Standards (CAAQS), and applicable federal Prevention of Significant Deterioration (PSD) significant impacts levels (SILs).
- **Impacts During Turbine Commissioning**
 - ✓ Turbine commissioning is a once-in-a-lifetime event. The maximum emissions will occur when power block 1 is operational and power block 2 is undergoing commissioning activities. The applicant has agreed to permit conditions during commissioning in order to reduce the project's impacts. The permit conditions would restrict steam blow at 50% load (commissioning activity that has the highest emission rate) to no more than one (1) turbine at a time with the other two (2) turbines in the power block not being fired. Additionally, all other commissioning activities would be restricted to no more than two (2) turbines undergoing fired commissioning activities simultaneously.
 - ✓ The peak 1-hour and 8-hour CO project impacts during commissioning plus the worst-case background are 8,405 µg/m³ and 6,899 µg/m³, respectively. These impacts are less than the state 1-hour and federal 8-hour CO standards of 23,000 µg/m³ and 10,000 µg/m³, respectively.
 - ✓ The peak 1-hour NO₂ project impact during commissioning plus the worst-case background is 286.3 µg/m³, which is less than the state 1-hour NO₂ standard of 339 µg/m³.
- **Impacts During Turbine Operations**
 - ✓ The peak CO, NO₂, SO₂, and PM₁₀ impacts presented here are those that are predicted to occur during turbine startups, turbine shutdowns, and normal turbine operations.
 - ✓ Peak 1-hour and 8-hour CO impacts plus the worst-case background are 3,662 µg/m³ and 2,608 µg/m³ respectively, which are less than the state 1-hour and federal 8-hour CO standards of 23,000 µg/m³ and 10,000 µg/m³.
 - ✓ The peak 1-hour and annual NO₂ impacts plus worst-case background are 198.8 µg/m³ and 21.8 µg/m³, which is less than the state annual NO₂ standards of 339 µg/m³ and 57 µg/m³, respectively.
 - ✓ The peak 1-hour and 24-hour SO₂ impacts plus the worst-case background are 32.0 µg/m³ and 7.9 µg/m³, respectively. These impacts are less than the state 1-hour and 24-hour SO₂ standards of 655 µg/m³ and 105 µg/m³, respectively.
 - ✓ On June 2, 2010, the U.S. EPA established a new 1-hour SO₂ standard. The applicant used the maximum AERMOD predicted 1-hour SO₂ concentration for the total project and added it to the 99th percentile background concentration (form of the federal standard), which is conservative. The peak 1-hour SO₂ impact is 17.8 µg/m³, which is less than the federal 1-hour SO₂ standard of 196 µg/m³.



South Coast
Air Quality Management District

Engineering Division
Application Processing & Calculations

PAGE 139	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

Andrew Lee

- 3 -

December 12, 2013

- ✓ The total project's peak 24-hour PM_{10} impact plus the worst-case background is $52.7 \mu\text{g}/\text{m}^3$, which is less than the federal 24-hour standard of $150 \mu\text{g}/\text{m}^3$.
- ✓ Background PM_{10} air quality in the impact area exceeds the state 24-hour and annual PM_{10} standards. The peak 24-hour and annual PM_{10} impacts for the total project are $4.74 \mu\text{g}/\text{m}^3$ and $0.27 \mu\text{g}/\text{m}^3$, respectively.
- **Federal PSD Air Quality Analyses**
 - ✓ The proposed project is subject to PSD review for CO and NO_2 .
 - ✓ Peak 1-hour and 8-hour CO impacts, during turbine operations including startups and shutdowns, are $332.6 \mu\text{g}/\text{m}^3$ and $78.3 \mu\text{g}/\text{m}^3$, respectively, which are below the corresponding U.S. EPA CO Class II SILs of $2,000 \mu\text{g}/\text{m}^3$ and $500 \mu\text{g}/\text{m}^3$. Therefore, 1-hour and 8-hour CO increment analyses are not required.
 - ✓ The maximum annual NO_2 impact from the total project is $0.49 \mu\text{g}/\text{m}^3$. This impact is less than the U.S. EPA NO_2 Class II significance impact level of $1 \mu\text{g}/\text{m}^3$; therefore, no additional PSD analysis is necessary.
 - ✓ The U.S. EPA established a new 1-hour NO_2 standard of 0.100 ppm (or $188 \mu\text{g}/\text{m}^3$) that became effective on April 12, 2010. In order to show compliance with the federal 1-hour NO_2 standard, the applicant used the maximum hourly emissions from startup, shutdown, and normal operations. Given the number of startups and shutdowns, the emissions from these events cannot be considered as intermittent, as described in the U.S. EPA's memo dated March 1, 2011. Emissions from commissioning were not included because commissioning is a once in a lifetime event and the form of the standard involves a three year average of the 98th percentile of the annual distribution of daily maximum 1-hour concentrations; therefore, commissioning emissions can be excluded.
 - ✓ The maximum 1-hour NO_2 impact from the proposed project is $52.2 \mu\text{g}/\text{m}^3$. This impact exceeds the U.S. EPA 1-hour NO_2 significance impact level of $7.52 \mu\text{g}/\text{m}^3$. Therefore, a cumulative impact assessment is necessary.
 - ✓ For the cumulative impact assessment, three facilities (Orange County Sanitation District's Huntington Beach and Fountain Valley facilities and Beta Offshore) as well as emissions from shipping lane activity off the coast were selected to be included based on their facility emissions and distance to the project. Seasonal, by hour-of-day background concentrations from the Costa Mesa monitoring station were used in the modeling. Following the form of the standard, the 1-hour NO_2 impact from the project plus cumulative projects plus background is $168.2 \mu\text{g}/\text{m}^3$, which is less than the federal 1-hour NO_2 standard of $188 \mu\text{g}/\text{m}^3$; therefore, no additional PSD analysis is necessary.
 - ✓ Effective July 26, 2013, the South Coast Air Basin has been redesignated to attainment for the 24-hour PM_{10} national ambient air quality standard. The total project's peak 24-hour impact is $4.74 \mu\text{g}/\text{m}^3$, which is less than the Class II SIL of $5 \mu\text{g}/\text{m}^3$; therefore, no additional PSD analysis is necessary.



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 140	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

Andrew Lee

- 4 -

December 12, 2013

• **Application of HARP for the Health Risk Impacts**

- ✓ The applicant performed the risk assessment with the Hot Spots Analysis and Reporting Program (HARP, version 1.4f). The District HRA procedures require HARP to be used in Tier 4 risk assessments.
- ✓ PRA staff re-ran the HARP model using the applicant provided data and reproduced the applicant's estimates. The impacts summarized here are for the entire project, which is more conservative than for each permit unit.
- ✓ The peak cancer risk for the proposed project is 2.35 in one million for a resident and 0.49 in one million for a worker. Based on a radius of 2.8 km and a population density of 4,000 persons/km², the cancer burden is conservatively estimated to be 0.23. The peak chronic and acute hazard indices for the proposed project are 0.008 and 0.069, respectively. These total facility risks are less than the Rule 1401 cancer and non-cancer permit limits of 10 in one million (for permit units with T-BACT), cancer burden of 0.5, and hazard index of 1, respectively. Therefore, the cancer and non-cancer risks are less than the Rule 1401 permit limits.

• **Visibility Impact Analysis for Class I and Class II Areas**

- ✓ The nearest Class I areas to the project site are the San Gabriel Wilderness and Cucamonga Wilderness areas located approximately 69 km away. A radial receptor ring was placed at a distance of 50 km from the project (50 km is the maximum receptor distance of the AERMOD model). The maximum project impact for annual NO₂ at 50km is 0.02 µg/m³, which is less than the significant impact level of 0.1 µg/m³.
- ✓ In order to estimate the potential impacts on visibility and deposition at the nearest Class I area, a screening criteria was used for projects located more than 50 km away from a Class I area. The emissions/distance (Q/D) is calculated using the project's total annual emissions of SO₂, NO_x, PM₁₀, and H₂SO₄ (based on 24-hour maximum allowable emissions) divided by the distance between the project and the nearest Class I area. Since the project is limited to an operating profile of 6,835 hours per year, the project's annual emissions of 407.3 tpy are actually an annual equivalent of 522 tpy. Therefore, the Q/D ratio is 7.6, which is less than the threshold of 10; thus, modeling of visibility and deposition impacts to Class I areas are not necessary.
- ✓ Additionally, the project's impacts on visibility in Class II areas were also analyzed. Currently, there are no thresholds for visibility impacts on Class II areas. The project utilized the criteria and thresholds for Class I areas, which is conservative. Visibility impacts are based on the calculation of two factors – plume contrast and color contrast (ΔE) of the plume when compared to the sky and terrain backgrounds. For Class I areas, the criteria used is based on a perceptibility threshold of 0.05 (absolute value) for contrast and 2.0 for ΔE. The project applicant identified four Class II areas in the project vicinity – Crystal Cove State Park, Water Canyon State Park, Chino Hills State Park, and San Mateo Canyon Wilderness Area. Using the Level 1 VISCREEN analysis, only the ΔE for Crystal Cove State Park and Water Canyon State Park exceeded the thresholds; thus a Level 2 VISCREEN analysis is warranted. Using the 5-year meteorological data from the John Wayne airport, the joint frequency distribution tables were created and were used to determine the worst-case single wind speed and stability class required for a Level 2 VISCREEN analysis. Using the Level 2 VISCREEN analysis, the project's



**South Coast
Air Quality Management District**

Engineering Division
Application Processing & Calculations

PAGE 141	PAGES 141
APPL NO. See Below	DATE 4/1/14
PROCESSED BY CP01	CHECKED BY

Andrew Lee

- 5 -

December 12, 2013

impacts for both contrast and ΔE are less than the thresholds for both Crystal Cove State Park and Water Canyon State Park. Therefore, the proposed project would not be expected to adversely affect visibility at the Class II areas analyzed here.

Modeling staff spent a total of 260 hours on this review. Please direct any questions to Thomas Chico at ext. 3149.

TC:JB

cc: Chris Perri ✓
Ian MacMillan

FACILITY PERMIT TO OPERATE

**AES HUNTINGTON BEACH, LLC
21730 NEWLAND ST
HUNTINGTON BEACH, CA 92646**

NOTICE

IN ACCORDANCE WITH RULE 206, THIS PERMIT TO OPERATE OR A COPY THEREOF MUST BE KEPT AT THE LOCATION FOR WHICH IT IS ISSUED.

THIS PERMIT DOES NOT AUTHORIZE THE EMISSION OF AIR CONTAMINANTS IN EXCESS OF THOSE ALLOWED BY DIVISION 26 OF THE HEALTH AND SAFETY CODE OF THE STATE OF CALIFORNIA OR THE RULES OF THE SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT. THIS PERMIT SHALL NOT BE CONSTRUED AS PERMISSION TO VIOLATE EXISTING LAWS, ORDINANCES, REGULATIONS OR STATUTES OF ANY OTHER FEDERAL, STATE OR LOCAL GOVERNMENTAL AGENCIES.

Barry R. Wallerstein, D. Env.
EXECUTIVE OFFICER

By _____
Mohsen Nazemi, P.E.
Deputy Executive Officer
Engineering & Compliance

FACILITY PERMIT TO OPERATE AES HUNTINGTON BEACH, LLC

SECTION H: PERMIT TO CONSTRUCT AND TEMPORARY PERMIT TO OPERATE

The operator shall comply with the terms and conditions set forth below:

Equipment	ID No.	Connected To	RECLAIM Source Type/ Monitoring Unit	Emissions* And Requirements	Conditions
Process 3: Power Generation - Gas Turbines					

* (1) (1A) (1B) Denotes RECLAIM emission factor
 (3) Denotes RECLAIM concentration limit
 (5) (5A) (5B) Denotes command and control emission limit
 (7) Denotes NSR applicability limit
 (9) See App B for Emission Limits

(2) (2A) (2B) Denotes RECLAIM emission rate
 (4) Denotes BACT emission limit
 (6) Denotes air toxic control rule limit
 (8) (8A) (8B) Denotes 40 CFR limit (e.g. NSPS, NESHAPS, etc.)
 (10) See section J for NESHAP/MACT requirements

** Refer to section F and G of this permit to determine the monitoring, recordkeeping and reporting requirements for this device.

FACILITY PERMIT TO OPERATE AES HUNTINGTON BEACH, LLC

SECTION H: PERMIT TO CONSTRUCT AND TEMPORARY PERMIT TO OPERATE

The operator shall comply with the terms and conditions set forth below:

Equipment	ID No.	Connected To	RECLAIM Source Type/ Monitoring Unit	Emissions* And Requirements	Conditions
Process 3: Power Generation - Gas Turbines					
GAS TURBINE, UNIT NO. 1A, COMBINED CYCLE, NATURAL GAS, MITSUBISHI MODEL 501DA, 1498 MMBTU/HR AT 32 DEGREES F WITH DRY LOW NOX COMBUSTOR WITH A/N:	D115		NOX: MAJOR SOURCE**; SOX: PROCESS UNIT**	CO: 2 PPMV NATURAL GAS (4) [RULE 1703 - PSD Analysis, 10-7-1988]; CO: 2000 PPMV NATURAL GAS (5) [RULE 407, 4-2-1982]; NOX: 2 PPMV NATURAL GAS (4) [RULE 1303(a)(1) -BACT, 5-10-1996; RULE 1303(a)(1)-BACT, 12-6-2002; RULE 1703 - PSD Analysis, 10-7-1988]; NOX: 12.75 LBS/MMSCF NATURAL GAS (1) [RULE 2012, 5-6-2005]; NOX: 15 PPMV NATURAL GAS (8) [40CFR 60 Subpart KKKK, 7-6-2006]; PM: 0.01 GRAINS/SCF NATURAL GAS (5A) [RULE 475, 10-8-1976; RULE 475, 8-7-1978]; PM: 0.1 GRAINS/SCF NATURAL GAS (5) [RULE 409, 8-7-1981; RULE 475, 10-8-1976; RULE 475, 8-7-1978]; PM: 11 LBS/HR NATURAL GAS (5) [RULE 409, 8-7-1981; RULE 475, 10-8-1976; RULE 475, 8-7-1978]; SO2: (9) [40CFR 72 - Acid Rain Provisions, 11-24-1997]; SOX: 0.06 LBS/MMBTU NATURAL GAS (8) [40CFR 60 Subpart KKKK, 7-6-2006]; SOX: 0.71 LBS/MMSCF NATURAL GAS (1) [RULE 2011,	A63.5, A63.6, A99.4, A195.6, A195.7, A195.8, A327.1, B61.1, C1.7, C1.8, C1.9, C1.10, D29.5, D29.6, D29.7, D82.3, D82.4, E193.3, E193.4, E193.5, E193.6, E193.7, I298.1, I298.2, K40.3, K67.5

* (1) (1A) (1B) Denotes RECLAIM emission factor (2) (2A) (2B) Denotes RECLAIM emission rate
 (3) Denotes RECLAIM concentration limit (4) Denotes BACT emission limit
 (5) (5A) (5B) Denotes command and control emission limit (6) Denotes air toxic control rule limit
 (7) Denotes NSR applicability limit (8) (8A) (8B) Denotes 40 CFR limit (e.g. NSPS, NESHAPS, etc.)
 (9) See App B for Emission Limits (10) See section J for NESHAP/MACT requirements

** Refer to section F and G of this permit to determine the monitoring, recordkeeping and reporting requirements for this device.

FACILITY PERMIT TO OPERATE AES HUNTINGTON BEACH, LLC

SECTION H: PERMIT TO CONSTRUCT AND TEMPORARY PERMIT TO OPERATE

The operator shall comply with the terms and conditions set forth below:

Equipment	ID No.	Connected To	RECLAIM Source Type/ Monitoring Unit	Emissions* And Requirements	Conditions
Process 3: Power Generation - Gas Turbines					
GENERATOR, 132.3 MW GROSS AT 32 DEGREES F GENERATOR, HEAT RECOVERY STEAM TURBINE, STEAM, COMMON WITH GAS TURBINES NOS. 1B AND 1C, 148.7 MW GROSS				5-6-2005]; VOC: 2 PPMV NATURAL GAS (4) [RULE 1303(a)(1)-BACT, 5-10-1996; RULE 1303(a)(1)-BACT, 12-6-2002]	

* (1) (1A) (1B) Denotes RECLAIM emission factor (2) (2A) (2B) Denotes RECLAIM emission rate
 (3) Denotes RECLAIM concentration limit (4) Denotes BACT emission limit
 (5) (5A) (5B) Denotes command and control emission limit (6) Denotes air toxic control rule limit
 (7) Denotes NSR applicability limit (8) (8A) (8B) Denotes 40 CFR limit (e.g. NSPS, NESHAPS, etc.)
 (9) See App B for Emission Limits (10) See section J for NESHAP/MACT requirements

** Refer to section F and G of this permit to determine the monitoring, recordkeeping and reporting requirements for this device.

FACILITY PERMIT TO OPERATE AES HUNTINGTON BEACH, LLC

SECTION H: PERMIT TO CONSTRUCT AND TEMPORARY PERMIT TO OPERATE

The operator shall comply with the terms and conditions set forth below:

Equipment	ID No.	Connected To	RECLAIM Source Type/ Monitoring Unit	Emissions* And Requirements	Conditions
Process 3: Power Generation - Gas Turbines					
BURNER, DUCT, NATURAL GAS, LOCATED IN THE HRSG OF TURBINE NO. 1A, 507 MMBTU/HR A/N:	D119		NOX: MAJOR SOURCE**; SOX: PROCESS UNIT**	CO: 2 PPMV NATURAL GAS (4) [RULE 1703 - PSD Analysis, 10-7-1988]; CO: 2000 PPMV NATURAL GAS (5) [RULE 407, 4-2-1982]; NOX: 2 PPMV NATURAL GAS (4) [RULE 1303(a)(1) -BACT, 5-10-1996; RULE 1303(a)(1)-BACT, 12-6-2002; RULE 1703 - PSD Analysis, 10-7-1988]; NOX: 12.75 LBS/MMSCF NATURAL GAS (1) [RULE 2012, 5-6-2005]; NOX: 15 PPMV NATURAL GAS (8) [40CFR 60 Subpart KKKK, 7-6-2006]; PM: 0.01 GRAINS/SCF NATURAL GAS (5A) [RULE 475, 10-8-1976; RULE 475, 8-7-1978]; PM: 0.1 GRAINS/SCF NATURAL GAS (5) [RULE 409, 8-7-1981; RULE 475, 10-8-1976; RULE 475, 8-7-1978]; PM: 11 LBS/HR NATURAL GAS (5) [RULE 409, 8-7-1981; RULE 475, 10-8-1976; RULE 475, 8-7-1978]; SO2: (9) [40CFR 72 - Acid Rain Provisions, 11-24-1997]; SOX: 0.06 LBS/MMBTU NATURAL GAS (8) [40CFR 60 Subpart KKKK, 7-6-2006]; SOX: 0.71 LBS/MMSCF NATURAL GAS (1) [RULE 2011,	I298.3, I298.4

* (1) (1A) (1B) Denotes RECLAIM emission factor (2) (2A) (2B) Denotes RECLAIM emission rate
 (3) Denotes RECLAIM concentration limit (4) Denotes BACT emission limit
 (5) (5A) (5B) Denotes command and control emission limit (6) Denotes air toxic control rule limit
 (7) Denotes NSR applicability limit (8) (8A) (8B) Denotes 40 CFR limit (e.g. NSPS, NESHAPS, etc.)
 (9) See App B for Emission Limits (10) See section J for NESHAP/MACT requirements

** Refer to section F and G of this permit to determine the monitoring, recordkeeping and reporting requirements for this device.

FACILITY PERMIT TO OPERATE AES HUNTINGTON BEACH, LLC

SECTION H: PERMIT TO CONSTRUCT AND TEMPORARY PERMIT TO OPERATE

The operator shall comply with the terms and conditions set forth below:

Equipment	ID No.	Connected To	RECLAIM Source Type/ Monitoring Unit	Emissions* And Requirements	Conditions
Process 3: Power Generation - Gas Turbines					
				1-7-2005; RULE 2011, 5-6-2005]; VOC: 2 PPMV NATURAL GAS (4) [RULE 1303(a)(1)-BACT, 5-10-1996; RULE 1303(a)(1)-BACT, 12-6-2002]	
CO OXIDATION CATALYST, JOHNSON MATTHEY, SERVING GAS TURBINE NO. 1A, WITH 261 MODULES, 2655 CU FT OF TOTAL CATALYST VOLUME A/N:	C120				D12.10
SELECTIVE CATALYTIC REDUCTION, HALDOR TOPSOE, TITANIUM/VANADIUM/TUNGSTEN, SERVING UNIT NO 1A WITH 20 MODULES, 140.8 CU FT OF TOTAL CATALYST VOLUME WITH A/N: AMMONIA INJECTION	C121			NH3; 5 PPMV NATURAL GAS (4) [RULE 1303(a)(1)-BACT, 5-10-1996; RULE 1303(a)(1)-BACT, 12-6-2002]	A195.9, D12.7, D12.8, D12.9, E179.4, E179.5, E193.4
STACK, SERVING TURBINE NO. 1A, HEIGHT: 120 FT ; DIAMETER: 18 FT A/N:	S123				

- | | |
|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| <ul style="list-style-type: none"> * (1) (1A) (1B) Denotes RECLAIM emission factor (3) Denotes RECLAIM concentration limit (5) (5A) (5B) Denotes command and control emission limit (7) Denotes NSR applicability limit (9) See App B for Emission Limits | <ul style="list-style-type: none"> (2) (2A) (2B) Denotes RECLAIM emission rate (4) Denotes BACT emission limit (6) Denotes air toxic control rule limit (8) (8A) (8B) Denotes 40 CFR limit (e.g. NSPS, NESHAPS, etc.) (10) See section J for NESHAP/MACT requirements |
|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|

** Refer to section F and G of this permit to determine the monitoring, recordkeeping and reporting requirements for this device.

FACILITY PERMIT TO OPERATE AES HUNTINGTON BEACH, LLC

SECTION H: PERMIT TO CONSTRUCT AND TEMPORARY PERMIT TO OPERATE

The operator shall comply with the terms and conditions set forth below:

Equipment	ID No.	Connected To	RECLAIM Source Type/ Monitoring Unit	Emissions* And Requirements	Conditions
Process 3: Power Generation - Gas Turbines					
GAS TURBINE, UNIT NO. 1B, COMBINED CYCLE, MITSUBISHI MODEL 501DA, 1498 MMBTU/HR AT 32 DEGREES F WITH DRY LOW NOX COMBUSTOR WITH A/N:	D124		NOX: MAJOR SOURCE**; SOX: PROCESS UNIT**	CO: 2 PPMV NATURAL GAS (4) [RULE 1703 - PSD Analysis, 10-7-1988]; CO: 2000 PPMV NATURAL GAS (5) [RULE 407, 4-2-1982]; NOX: 2 PPMV NATURAL GAS (4) [RULE 1303(a)(1) -BACT, 5-10-1996; RULE 1303(a)(1)-BACT, 12-6-2002; RULE 1703 - PSD Analysis, 10-7-1988]; NOX: 12.75 LBS/MMSCF NATURAL GAS (1) [RULE 2012, 5-6-2005]; NOX: 15 PPMV NATURAL GAS (8) [40CFR 60 Subpart KKKK, 7-6-2006]; PM: 0.01 GRAINS/SCF NATURAL GAS (5A) [RULE 475, 8-7-1978]; PM: 0.1 GRAINS/SCF NATURAL GAS (5) [RULE 409, 8-7-1981; RULE 475, 10-8-1976; RULE 475, 8-7-1978]; PM: 11 LBS/HR NATURAL GAS (5) [RULE 409, 8-7-1981; RULE 475, 10-8-1976; RULE 475, 8-7-1978]; SO2: (9) [40CFR 72 - Acid Rain Provisions, 11-24-1997]; SOX: 0.06 LBS/MMBTU NATURAL GAS (8) [40CFR 60 Subpart KKKK, 7-6-2006]; SOX: 0.71 LBS/MMSCF NATURAL GAS (1) [RULE 2011, 5-6-2005]; VOC: 2 PPMV	A63.5, A63.6, A99.4, A195.6, A195.7, A195.8, A327.1, B61.1, C1.7, C1.8, C1.9, C1.10, D29.5, D29.6, D29.7, D82.3, D82.4, E193.4, E193.5, E193.6, E193.7, I298.5, I298.10, K40.3, K67.5

* (1) (1A) (1B) Denotes RECLAIM emission factor (2) (2A) (2B) Denotes RECLAIM emission rate
 (3) Denotes RECLAIM concentration limit (4) Denotes BACT emission limit
 (5) (5A) (5B) Denotes command and control emission limit (6) Denotes air toxic control rule limit
 (7) Denotes NSR applicability limit (8) (8A) (8B) Denotes 40 CFR limit (e.g. NSPS, NESHAPS, etc.)
 (9) See App B for Emission Limits (10) See section J for NESHAP/MACT requirements

** Refer to section F and G of this permit to determine the monitoring, recordkeeping and reporting requirements for this device.

FACILITY PERMIT TO OPERATE AES HUNTINGTON BEACH, LLC

SECTION H: PERMIT TO CONSTRUCT AND TEMPORARY PERMIT TO OPERATE

The operator shall comply with the terms and conditions set forth below:

Equipment	ID No.	Connected To	RECLAIM Source Type/ Monitoring Unit	Emissions* And Requirements	Conditions
Process 3: Power Generation - Gas Turbines					
GENERATOR, 132.3 MW GROSS AT 32 DEGREES F GENERATOR, HEAT RECOVERY STEAM TURBINE, STEAM, COMMON WITH GAS TURBINE NOS 1A AND 1C,, 148.7 MW GROSS				NATURAL GAS (4) [RULE 1303(a)(1)-BACT, 5-10-1996; RULE 1303(a)(1)-BACT, 12-6-2002]	

* (1) (1A) (1B) Denotes RECLAIM emission factor
 (3) Denotes RECLAIM concentration limit
 (5) (5A) (5B) Denotes command and control emission limit
 (7) Denotes NSR applicability limit
 (9) See App B for Emission Limits

(2) (2A) (2B) Denotes RECLAIM emission rate
 (4) Denotes BACT emission limit
 (6) Denotes air toxic control rule limit
 (8) (8A) (8B) Denotes 40 CFR limit (e.g. NSPS, NESHAPS, etc.)
 (10) See section J for NESHAP/MACT requirements

** Refer to section F and G of this permit to determine the monitoring, recordkeeping and reporting requirements for this device.

FACILITY PERMIT TO OPERATE AES HUNTINGTON BEACH, LLC

SECTION H: PERMIT TO CONSTRUCT AND TEMPORARY PERMIT TO OPERATE

The operator shall comply with the terms and conditions set forth below:

Equipment	ID No.	Connected To	RECLAIM Source Type/ Monitoring Unit	Emissions* And Requirements	Conditions
Process 3: Power Generation - Gas Turbines					
BURNER, DUCT, 507 MMBTU/HR, LOCATED IN THE HRSG OF TURBINE NO. 1B A/N:	D128		NOX: MAJOR SOURCE**; SOX: PROCESS UNIT**	CO: 2 PPMV NATURAL GAS (4) [RULE 1703 - PSD Analysis, 10-7-1988]; CO: 2000 PPMV NATURAL GAS (5) [RULE 407, 4-2-1982]; NOX: 2 PPMV NATURAL GAS (4) [RULE 1303(a)(1) -BACT, 5-10-1996; RULE 1303(a)(1)-BACT, 12-6-2002; RULE 1703 - PSD Analysis, 10-7-1988]; NOX: 12.75 LBS/MMSCF NATURAL GAS (1) [RULE 2012, 5-6-2005]; NOX: 15 PPMV NATURAL GAS (8) [40CFR 60 Subpart KKKK, 7-6-2006]; PM: 0.01 GRAINS/SCF NATURAL GAS (5A) [RULE 475, 10-8-1976; RULE 475, 8-7-1978]; PM: 0.1 GRAINS/SCF NATURAL GAS (5) [RULE 409, 8-7-1981; RULE 475, 10-8-1976; RULE 475, 8-7-1978]; PM: 11 LBS/HR NATURAL GAS (5) [RULE 409, 8-7-1981; RULE 475, 10-8-1976; RULE 475, 8-7-1978]; SO2: (9) [40CFR 72 - Acid Rain Provisions, 11-24-1997]; SOX: 0.06 LBS/MMBTU NATURAL GAS (8) [40CFR 60 Subpart KKKK, 7-6-2006]; SOX: 0.71 LBS/MMSCF NATURAL GAS (1) [RULE 2011,	I298.15, I298.20

* (1) (1A) (1B) Denotes RECLAIM emission factor (2) (2A) (2B) Denotes RECLAIM emission rate
 (3) Denotes RECLAIM concentration limit (4) Denotes BACT emission limit
 (5) (5A) (5B) Denotes command and control emission limit (6) Denotes air toxic control rule limit
 (7) Denotes NSR applicability limit (8) (8A) (8B) Denotes 40 CFR limit (e.g. NSPS, NESHAPS, etc.)
 (9) See App B for Emission Limits (10) See section J for NESHAP/MACT requirements

** Refer to section F and G of this permit to determine the monitoring, recordkeeping and reporting requirements for this device.

FACILITY PERMIT TO OPERATE AES HUNTINGTON BEACH, LLC

SECTION H: PERMIT TO CONSTRUCT AND TEMPORARY PERMIT TO OPERATE

The operator shall comply with the terms and conditions set forth below:

Equipment	ID No.	Connected To	RECLAIM Source Type/ Monitoring Unit	Emissions* And Requirements	Conditions
Process 3: Power Generation - Gas Turbines					
				5-6-2005]; VOC: 2 PPMV NATURAL GAS (4) [RULE 1303(a)(1)-BACT, 5-10-1996; RULE 1303(a)(1)-BACT, 12-6-2002]	
CO OXIDATION CATALYST, JOHNSON MATTHEY, SERVING GAS TURBINE NO. 1B, WITH 261 MODULES, 2655 CU FEET OF TOTAL CATALYST VOLUME A/N:	C129				
SELECTIVE CATALYTIC REDUCTION, HALDOR TOPSOE, TITANIUM/VANADIUM/TUNGSTE N, SERVING UNIT NO. 1B, WITH 20 MODULES, 140.8 CU FT OF TOTAL CATALYST VOLUME WITH A/N: AMMONIA INJECTION	C130			NH3: 5 PPMV NATURAL GAS (4) [RULE 1303(a)(1) -BACT, 5-10-1996; RULE 1303(a)(1)-BACT, 12-6-2002]	A195.9, D12.7, D12.8, D12.9, E179.4, E179.5, E193.4
STACK, SERVING UNIT NO. 1B, HEIGHT: 120 FT ; DIAMETER: 18 FT A/N:	S132				

- * (1) (1A) (1B) Denotes RECLAIM emission factor
- (3) Denotes RECLAIM concentration limit
- (5) (5A) (5B) Denotes command and control emission limit
- (7) Denotes NSR applicability limit
- (9) See App B for Emission Limits
- (2) (2A) (2B) Denotes RECLAIM emission rate
- (4) Denotes BACT emission limit
- (6) Denotes air toxic control rule limit
- (8) (8A) (8B) Denotes 40 CFR limit (e.g. NSPS, NESHAPS, etc.)
- (10) See section J for NESHAP/MACT requirements

** Refer to section F and G of this permit to determine the monitoring, recordkeeping and reporting requirements for this device.

FACILITY PERMIT TO OPERATE AES HUNTINGTON BEACH, LLC

SECTION H: PERMIT TO CONSTRUCT AND TEMPORARY PERMIT TO OPERATE

The operator shall comply with the terms and conditions set forth below:

Equipment	ID No.	Connected To	RECLAIM Source Type/ Monitoring Unit	Emissions* And Requirements	Conditions
Process 3: Power Generation - Gas Turbines					
GAS TURBINE, UNIT NO. 1C, COMBINED CYCLE, MITSUBISHI MODEL 501DA, 1498 MMTU/HR AT 32 DEGREES F WITH DRY LOW NOX BURNER WITH A/N:	D133		NOX: MAJOR SOURCE**; SOX: PROCESS UNIT**	CO: 2 PPMV NATURAL GAS (4) [RULE 1703 - PSD Analysis, 10-7-1988]; CO: 2000 PPMV NATURAL GAS (5) [RULE 407, 4-2-1982]; NOX: 2 PPMV NATURAL GAS (4) [RULE 1303(a)(1) -BACT, 5-10-1996; RULE 1303(a)(1)-BACT, 12-6-2002; RULE 1703 - PSD Analysis, 10-7-1988]; NOX: 12.75 LBS/MMSCF NATURAL GAS (1) [RULE 2012, 5-6-2005]; NOX: 15 PPMV NATURAL GAS (8) [40CFR 60 Subpart KKKK, 7-6-2006]; PM: 0.01 GRAINS/SCF NATURAL GAS (5A) [RULE 475, 10-8-1976; RULE 475, 8-7-1978]; PM: 0.1 GRAINS/SCF NATURAL GAS (5) [RULE 409, 8-7-1981; RULE 475, 10-8-1976; RULE 475, 8-7-1978]; PM: 11 LBS/DAY PER CONNECTED WELL NATURAL GAS (5) [RULE 409, 8-7-1981; RULE 475, 10-8-1976; RULE 475, 8-7-1978]; SO2: (9) [40CFR 72 - Acid Rain Provisions, 11-24-1997]; SOX: 0.06 LBS/MMBTU NATURAL GAS (8) [40CFR 60 Subpart KKKK, 7-6-2006]; SOX: 0.71	A63.5, A63.6, A99.4, A195.6, A195.7, A195.8, A327.1, B61.1, C1.7, C1.8, C1.9, C1.10, D29.5, D29.6, D29.7, D82.3, D82.4, E193.4, E193.5, E193.6, E193.7, I298.6, I298.11, K40.3, K67.5

- | | |
|----------------------------------------------------------|---------------------------------------------------------------|
| * (1) (1A) (1B) Denotes RECLAIM emission factor | (2) (2A) (2B) Denotes RECLAIM emission rate |
| (3) Denotes RECLAIM concentration limit | (4) Denotes BACT emission limit |
| (5) (5A) (5B) Denotes command and control emission limit | (6) Denotes air toxic control rule limit |
| (7) Denotes NSR applicability limit | (8) (8A) (8B) Denotes 40 CFR limit (e.g. NSPS, NESHAPS, etc.) |
| (9) See App B for Emission Limits | (10) See section J for NESHAP/MACT requirements |

** Refer to section F and G of this permit to determine the monitoring, recordkeeping and reporting requirements for this device.

FACILITY PERMIT TO OPERATE AES HUNTINGTON BEACH, LLC

SECTION H: PERMIT TO CONSTRUCT AND TEMPORARY PERMIT TO OPERATE

The operator shall comply with the terms and conditions set forth below:

Equipment	ID No.	Connected To	RECLAIM Source Type/ Monitoring Unit	Emissions* And Requirements	Conditions
Process 3: Power Generation - Gas Turbines					
GENERATOR, 132.3 MW GROSS AT 32 DEGREES F GENERATOR, HEAT RECOVERY STEAM TURBINE, STEAM, COMMON WITH GAS TURBINES NOS. 1A AND 1B, 148.7 MW GROSS				LBS/MMSCF NATURAL GAS (1) [RULE 2011, 5-6-2005]; VOC: 2 PPMV NATURAL GAS (4) [RULE 1303(a)(1)-BACT, 5-10-1996; RULE 1303(a)(1)-BACT, 12-6-2002]	

* (1) (1A) (1B) Denotes RECLAIM emission factor
 (3) Denotes RECLAIM concentration limit
 (5) (5A) (5B) Denotes command and control emission limit
 (7) Denotes NSR applicability limit
 (9) See App B for Emission Limits
 (2) (2A) (2B) Denotes RECLAIM emission rate
 (4) Denotes BACT emission limit
 (6) Denotes air toxic control rule limit
 (8) (8A) (8B) Denotes 40 CFR limit (e.g. NSPS, NESHAPS, etc.)
 (10) See section J for NESHAP/MACT requirements

** Refer to section F and G of this permit to determine the monitoring, recordkeeping and reporting requirements for this device.

FACILITY PERMIT TO OPERATE AES HUNTINGTON BEACH, LLC

SECTION H: PERMIT TO CONSTRUCT AND TEMPORARY PERMIT TO OPERATE

The operator shall comply with the terms and conditions set forth below:

Equipment	ID No.	Connected To	RECLAIM Source Type/ Monitoring Unit	Emissions* And Requirements	Conditions
Process 3: Power Generation - Gas Turbines					
BURNER, DUCT, NATURAL GAS, LOCATED IN THE HRSG OF TURBINE NO. 1C, 507 MMBTU/HR A/N:	D137		NOX: MAJOR SOURCE**; SOX: PROCESS UNIT**	CO: 2 PPMV NATURAL GAS (4) [RULE 1703 - PSD Analysis, 10-7-1988]; CO: 2000 PPMV NATURAL GAS (5) [RULE 407, 4-2-1982]; NOX: 2 PPMV NATURAL GAS (4) [RULE 1303(a)(1) -BACT, 5-10-1996; RULE 1303(a)(1)-BACT, 12-6-2002; RULE 1703 - PSD Analysis, 10-7-1988]; NOX: 12.75 LBS/MMSCF NATURAL GAS (1) [RULE 2012, 5-6-2005]; NOX: 15 PPMV NATURAL GAS (8) [40CFR 60 Subpart KKKK, 7-6-2006]; PM: 0.01 GRAINS/SCF NATURAL GAS (5A) [RULE 475, 10-8-1976; RULE 475, 8-7-1978]; PM: 0.1 GRAINS/SCF NATURAL GAS (5) [RULE 409, 8-7-1981; RULE 475, 10-8-1976; RULE 475, 8-7-1978]; PM: 11 LBS/HR NATURAL GAS (5) [RULE 409, 8-7-1981; RULE 475, 10-8-1976; RULE 475, 8-7-1978]; SO2: (9) [40CFR 72 - Acid Rain Provisions, 11-24-1997]; SOX: 0.06 LBS/MMBTU NATURAL GAS (8) [40CFR 60 Subpart KKKK, 7-6-2006]; SOX: 0.71 LBS/MMSCF NATURAL GAS (1) [RULE 2012,	I298.16, I298.21

- | | |
|----------------------------------------------------------|---------------------------------------------------------------|
| * (1) (1A) (1B) Denotes RECLAIM emission factor | (2) (2A) (2B) Denotes RECLAIM emission rate |
| (3) Denotes RECLAIM concentration limit | (4) Denotes BACT emission limit |
| (5) (5A) (5B) Denotes command and control emission limit | (6) Denotes air toxic control rule limit |
| (7) Denotes NSR applicability limit | (8) (8A) (8B) Denotes 40 CFR limit (e.g. NSPS, NESHAPS, etc.) |
| (9) See App B for Emission Limits | (10) See section J for NESHAP/MACT requirements |

** Refer to section F and G of this permit to determine the monitoring, recordkeeping and reporting requirements for this device.

FACILITY PERMIT TO OPERATE AES HUNTINGTON BEACH, LLC

SECTION H: PERMIT TO CONSTRUCT AND TEMPORARY PERMIT TO OPERATE

The operator shall comply with the terms and conditions set forth below:

Equipment	ID No.	Connected To	RECLAIM Source Type/ Monitoring Unit	Emissions* And Requirements	Conditions
Process 3: Power Generation - Gas Turbines					
				5-6-2005]; VOC: 2 PPMV NATURAL GAS (4) [RULE 1303(a)(1)-BACT, 5-10-1996; RULE 1303(a)(1)-BACT, 12-6-2002]	
CO OXIDATION CATALYST, JOHNSON MATTHEY, SERVING GAS TURBINE NO. 1C, WITH 261 MODULES, 2655 CU FT OF TOTAL CATALYST VOLUME A/N:	C138				
SELECTIVE CATALYTIC REDUCTION, HALDOR TOPSOE, TITANIUM/VANADIUM/TUNGSTE N, SERVING UNIT NO 1C WITH 20 MODULES, 140.8 CU FT OF TOTAL CATALYST VOLUME WITH A/N: AMMONIA INJECTION	C139			NH3: 5 PPMV NATURAL GAS (4) [RULE 1303(a)(1) -BACT, 5-10-1996; RULE 1303(a)(1)-BACT, 12-6-2002]	A195.9, D12.7, D12.8, D12.9, E179.4, E179.5, E193.4
STACK, SERVING TURBINE NO. 1C, HEIGHT: 120 FT ; DIAMETER: 18 FT A/N:	S141				

- | | |
|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| <p>* (1) (1A) (1B) Denotes RECLAIM emission factor
 (3) Denotes RECLAIM concentration limit
 (5) (5A) (5B) Denotes command and control emission limit
 (7) Denotes NSR applicability limit
 (9) See App B for Emission Limits</p> | <p>(2) (2A) (2B) Denotes RECLAIM emission rate
 (4) Denotes BACT emission limit
 (6) Denotes air toxic control rule limit
 (8) (8A) (8B) Denotes 40 CFR limit (e.g. NSPS, NESHAPS, etc.)
 (10) See section J for NESHAP/MACT requirements</p> |
|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|

** Refer to section F and G of this permit to determine the monitoring, recordkeeping and reporting requirements for this device.

FACILITY PERMIT TO OPERATE AES HUNTINGTON BEACH, LLC

SECTION H: PERMIT TO CONSTRUCT AND TEMPORARY PERMIT TO OPERATE

The operator shall comply with the terms and conditions set forth below:

Equipment	ID No.	Connected To	RECLAIM Source Type/ Monitoring Unit	Emissions* And Requirements	Conditions
Process 3: Power Generation - Gas Turbines					
GAS TURBINE, UNIT NO. 2A, COMBINED CYCLE, NATURAL GAS, MITSUBISHI MODEL 501DA, 1498 MMBTU/HR AT 32 DEGREES F WITH DRY LOW NOX COMBUSTOR WITH A/N:	D142		NOX: MAJOR SOURCE**; SOX: PROCESS UNIT**	CO: 2 PPMV NATURAL GAS (4) [RULE 1703 - PSD Analysis, 10-7-1988]; CO: 2000 PPMV NATURAL GAS (5) [RULE 407, 4-2-1982]; NOX: 2 PPMV NATURAL GAS (4) [RULE 1303(a)(1) -BACT, 5-10-1996; RULE 1303(a)(1)-BACT, 12-6-2002]; NOX: 12.75 LBS/MMSCF NATURAL GAS (1) [RULE 2012, 5-6-2005]; NOX: 15 PPMV NATURAL GAS (8) [40CFR 60 Subpart KKKK, 7-6-2006]; PM: 0.01 GRAINS/SCF NATURAL GAS (5A) [RULE 475, 10-8-1976; RULE 475, 8-7-1978]; PM: 0.1 GRAINS/SCF NATURAL GAS (5) [RULE 409, 8-7-1981; RULE 475, 10-8-1976; RULE 475, 8-7-1978]; PM: 11 LBS/HR NATURAL GAS (5) [RULE 409, 8-7-1981; RULE 475, 10-8-1976; RULE 475, 8-7-1978]; SO2: (9) [40CFR 72 - Acid Rain Provisions, 11-24-1997]; SOX: 0.06 LBS/1000 BBL PROCESSED NATURAL GAS (8) [40CFR 60 Subpart KKKK, 7-6-2006]; SOX: 0.71 LBS/MMSCF NATURAL GAS (1) [RULE 2011, 5-6-2005]; VOC: 2	A63.5, A63.6, A99.4, A195.6, A195.7, A195.8, A327.1, B61.1, C1.7, C1.8, C1.9, C1.10, D29.5, D29.6, D29.7, D82.3, D82.4, E193.4, E193.5, E193.6, E193.7, I298.7, I298.12, K40.3, K67.5

* (1) (1A) (1B) Denotes RECLAIM emission factor (2) (2A) (2B) Denotes RECLAIM emission rate
 (3) Denotes RECLAIM concentration limit (4) Denotes BACT emission limit
 (5) (5A) (5B) Denotes command and control emission limit (6) Denotes air toxic control rule limit
 (7) Denotes NSR applicability limit (8) (8A) (8B) Denotes 40 CFR limit (e.g. NSPS, NESHAPS, etc.)
 (9) See App B for Emission Limits (10) See section J for NESHAP/MACT requirements

** Refer to section F and G of this permit to determine the monitoring, recordkeeping and reporting requirements for this device.

FACILITY PERMIT TO OPERATE AES HUNTINGTON BEACH, LLC

SECTION H: PERMIT TO CONSTRUCT AND TEMPORARY PERMIT TO OPERATE

The operator shall comply with the terms and conditions set forth below:

Equipment	ID No.	Connected To	RECLAIM Source Type/ Monitoring Unit	Emissions* And Requirements	Conditions
Process 3: Power Generation - Gas Turbines					
GENERATOR, 132.3 MW GROSS AT 32 DEGREES F GENERATOR, HEAT RECOVERY STEAM TURBINE, STEAM, COMMON WITH GAS TURBINES NOS. 2B AND 2C, 148.7 MW GROSS				PPMV NATURAL GAS (4) [RULE 1303(a)(1)-BACT, 5-10-1996; RULE 1303(a)(1) -BACT, 12-6-2002]	

* (1) (1A) (1B) Denotes RECLAIM emission factor
 (2) (2A) (2B) Denotes RECLAIM emission rate
 (3) Denotes RECLAIM concentration limit
 (4) Denotes BACT emission limit
 (5) (5A) (5B) Denotes command and control emission limit
 (6) Denotes air toxic control rule limit
 (7) Denotes NSR applicability limit
 (8) (8A) (8B) Denotes 40 CFR limit (e.g. NSPS, NESHAPS, etc.)
 (9) See App B for Emission Limits
 (10) See section J for NESHAP/MACT requirements

** Refer to section F and G of this permit to determine the monitoring, recordkeeping and reporting requirements for this device.

FACILITY PERMIT TO OPERATE AES HUNTINGTON BEACH, LLC

SECTION H: PERMIT TO CONSTRUCT AND TEMPORARY PERMIT TO OPERATE

The operator shall comply with the terms and conditions set forth below:

Equipment	ID No.	Connected To	RECLAIM Source Type/ Monitoring Unit	Emissions* And Requirements	Conditions
Process 3: Power Generation - Gas Turbines					
BURNER, DUCT, NATURAL GAS, LOCATED IN THE HRSG OF TURBINE NO. 2A, 507 MMBTU/HR A/N:	D146		NOX: MAJOR SOURCE**; SOX: PROCESS UNIT**	CO: 2 PPMV NATURAL GAS (4) [RULE 1703 - PSD Analysis, 10-7-1988]; CO: 2000 PPMV NATURAL GAS (5) [RULE 407, 4-2-1982]; NOX: 2 PPMV NATURAL GAS (4) [RULE 1303(a)(1) -BACT, 5-10-1996; RULE 1303(a)(1)-BACT, 12-6-2002; RULE 1703 - PSD Analysis, 10-7-1988]; NOX: 12.75 LBS/MMSCF NATURAL GAS (1) [RULE 2012, 5-6-2005]; NOX: 15 PPMV NATURAL GAS (8) [40CFR 63 Subpart KKKK, 4-20-2006]; PM: 0.01 GRAINS/SCF NATURAL GAS (5A) [RULE 475, 10-8-1976; RULE 475, 8-7-1978]; PM: 0.1 GRAINS/SCF NATURAL GAS (5) [RULE 409, 8-7-1981; RULE 475, 10-8-1976; RULE 475, 8-7-1978]; PM: 11 LBS/HR NATURAL GAS (5) [RULE 409, 8-7-1981; RULE 475, 10-8-1976; RULE 475, 8-7-1978]; SO2: (9) [40CFR 72 - Acid Rain Provisions, 11-24-1997]; SOX: 0.06 LBS/MMBTU NATURAL GAS (8) [40CFR 63 Subpart KKKK, 4-20-2006]; SOX: 0.71 LBS/MMSCF	I298.17, I298.22

* (1) (1A) (1B) Denotes RECLAIM emission factor (2) (2A) (2B) Denotes RECLAIM emission rate
 (3) Denotes RECLAIM concentration limit (4) Denotes BACT emission limit
 (5) (5A) (5B) Denotes command and control emission limit (6) Denotes air toxic control rule limit
 (7) Denotes NSR applicability limit (8) (8A) (8B) Denotes 40 CFR limit (e.g. NSPS, NESHAPS, etc.)
 (9) See App B for Emission Limits (10) See section J for NESHAP/MACT requirements

** Refer to section F and G of this permit to determine the monitoring, recordkeeping and reporting requirements for this device.

FACILITY PERMIT TO OPERATE AES HUNTINGTON BEACH, LLC

SECTION H: PERMIT TO CONSTRUCT AND TEMPORARY PERMIT TO OPERATE

The operator shall comply with the terms and conditions set forth below:

Equipment	ID No.	Connected To	RECLAIM Source Type/ Monitoring Unit	Emissions* And Requirements	Conditions
Process 3: Power Generation - Gas Turbines					
				NATURAL GAS (1) [RULE 2011, 5-6-2005]; VOC: 2 PPMV NATURAL GAS (4) [RULE 1303(a)(1)-BACT, 5-10-1996; RULE 1303(a)(1)-BACT, 12-6-2002]	
CO OXIDATION CATALYST, JOHNSON MATTHEY, SERVING GAS TURBINE NO. 2A, WITH 261 MODULES, 2655 CU FT OF TOTAL CATALYST VOLUME A/N:	C147				
SELECTIVE CATALYTIC REDUCTION, HALDOR TOPSOE, TITANIUM/VANADIUM/TUNGSTEN, SERVING UNIT NO 2A WITH 20 MODULES, 140.8 CU FT OF TOTAL CATALYST VOLUME WITH A/N: AMMONIA INJECTION	C148			NH3: 5 PPMV NATURAL GAS (4) [RULE 1303(a)(1)-BACT, 5-10-1996; RULE 1303(a)(1)-BACT, 12-6-2002]	A327.1, D12.7, D12.8, D12.9, E179.4, E179.5, E193.4
STACK, SERVING TURBINE NO. 2A, HEIGHT: 120 FT ; DIAMETER: 18 FT A/N:	S150				

- * (1) (1A) (1B) Denotes RECLAIM emission factor
- (3) Denotes RECLAIM concentration limit
- (5) (5A) (5B) Denotes command and control emission limit
- (7) Denotes NSR applicability limit
- (9) See App B for Emission Limits
- (2) (2A) (2B) Denotes RECLAIM emission rate
- (4) Denotes BACT emission limit
- (6) Denotes air toxic control rule limit
- (8) (8A) (8B) Denotes 40 CFR limit (e.g. NSPS, NESHAPS, etc.)
- (10) See section J for NESHAP/MACT requirements

** Refer to section F and G of this permit to determine the monitoring, recordkeeping and reporting requirements for this device.

FACILITY PERMIT TO OPERATE AES HUNTINGTON BEACH, LLC

SECTION H: PERMIT TO CONSTRUCT AND TEMPORARY PERMIT TO OPERATE

The operator shall comply with the terms and conditions set forth below:

Equipment	ID No.	Connected To	RECLAIM Source Type/ Monitoring Unit	Emissions* And Requirements	Conditions
Process 3: Power Generation - Gas Turbines					
GAS TURBINE, UNIT NO. 2B, COMBINED CYCLE, NATURAL GAS, MITSUBISHI MODEL 501DA, 1498 MMBTU/HR AT 32 DEGREES F WITH DRY LOW NOX COMBUSTOR WITH A/N:	D151		NOX: MAJOR SOURCE**; SOX: PROCESS UNIT**	CO: 2 PPMV NATURAL GAS (4) [RULE 1703 - PSD Analysis, 10-7-1988]; CO: 2000 PPMV NATURAL GAS (5) [RULE 407, 4-2-1982]; NOX: 2 PPMV NATURAL GAS (4) [RULE 1303(a)(1) -BACT, 5-10-1996; RULE 1303(a)(1)-BACT, 12-6-2002; RULE 1703 - PSD Analysis, 10-7-1988]; NOX: 12.75 LBS/MMSCF NATURAL GAS (1) [RULE 2012, 5-6-2005]; NOX: 15 PPMV NATURAL GAS (8) [40CFR 60 Subpart KKKK, 7-6-2006]; PM: 0.01 GRAINS/SCF NATURAL GAS (5A) [RULE 475, 10-8-1976; RULE 475, 8-7-1978]; PM: 0.1 GRAINS/SCF NATURAL GAS (5) [RULE 409, 8-7-1981; RULE 475, 10-8-1976; RULE 475, 8-7-1978]; PM: 11 LBS/HR NATURAL GAS (5) [RULE 409, 8-7-1981; RULE 475, 10-8-1976; RULE 475, 8-7-1978]; SO2: (9) [40CFR 72 - Acid Rain Provisions, 11-24-1997]; SOX: 0.06 LBS/MMBTU NATURAL GAS (8) [40CFR 60 Subpart KKKK, 7-6-2006]; SOX: 0.71 LBS/MMSCF NATURAL GAS (1) [RULE 2011,	A63.5, A63.6, A99.4, A195.6, A195.7, A195.8, A327.1, B61.1, C1.7, C1.8, C1.9, C1.10, D29.5, D29.6, D29.7, D82.3, D82.4, E193.4, E193.5, E193.6, E193.7, I298.8, I298.13, K40.3, K67.5

- | | |
|----------------------------------------------------------|---------------------------------------------------------------|
| * (1) (1A) (1B) Denotes RECLAIM emission factor | (2) (2A) (2B) Denotes RECLAIM emission rate |
| (3) Denotes RECLAIM concentration limit | (4) Denotes BACT emission limit |
| (5) (5A) (5B) Denotes command and control emission limit | (6) Denotes air toxic control rule limit |
| (7) Denotes NSR applicability limit | (8) (8A) (8B) Denotes 40 CFR limit (e.g. NSPS, NESHAPS, etc.) |
| (9) See App B for Emission Limits | (10) See section J for NESHAP/MACT requirements |

** Refer to section F and G of this permit to determine the monitoring, recordkeeping and reporting requirements for this device.

FACILITY PERMIT TO OPERATE AES HUNTINGTON BEACH, LLC

SECTION H: PERMIT TO CONSTRUCT AND TEMPORARY PERMIT TO OPERATE

The operator shall comply with the terms and conditions set forth below:

Equipment	ID No.	Connected To	RECLAIM Source Type/ Monitoring Unit	Emissions* And Requirements	Conditions
Process 3: Power Generation - Gas Turbines					
GENERATOR, 132.3 MW GROSS AT 32 DEGREES F GENERATOR, HEAT RECOVERY STEAM TURBINE, STEAM, COMMON WITH GAS TURBINES NOS. 2A AND 2C, 148.7 MW GROSS				5-6-2005]; VOC: 2 PPMV NATURAL GAS (4) [RULE 1303(a)(1)-BACT, 5-10-1996; RULE 1303(a)(1)-BACT, 12-6-2002]	

* (1) (1A) (1B) Denotes RECLAIM emission factor
 (3) Denotes RECLAIM concentration limit
 (5) (5A) (5B) Denotes command and control emission limit
 (7) Denotes NSR applicability limit
 (9) See App B for Emission Limits
 (2) (2A) (2B) Denotes RECLAIM emission rate
 (4) Denotes BACT emission limit
 (6) Denotes air toxic control rule limit
 (8) (8A) (8B) Denotes 40 CFR limit (e.g. NSPS, NESHAPS, etc.)
 (10) See section J for NESHAP/MACT requirements

** Refer to section F and G of this permit to determine the monitoring, recordkeeping and reporting requirements for this device.

FACILITY PERMIT TO OPERATE AES HUNTINGTON BEACH, LLC

SECTION H: PERMIT TO CONSTRUCT AND TEMPORARY PERMIT TO OPERATE

The operator shall comply with the terms and conditions set forth below:

Equipment	ID No.	Connected To	RECLAIM Source Type/ Monitoring Unit	Emissions* And Requirements	Conditions
Process 3: Power Generation - Gas Turbines					
BURNER, DUCT, NATURAL GAS, LOCATED IN THE HRSG OF TURBINE NO. 2B, 507 MMBTU/HR A/N:	D155		NOX: MAJOR SOURCE**; SOX: PROCESS UNIT**	CO: 2 PPMV NATURAL GAS (4) [RULE 1703 - PSD Analysis, 10-7-1988]; CO: 2000 PPMV NATURAL GAS (5) [RULE 407, 4-2-1982]; NOX: 2 PPMV NATURAL GAS (4) [RULE 1303(a)(1) -BACT, 5-10-1996; RULE 1303(a)(1)-BACT, 12-6-2002; RULE 1703 - PSD Analysis, 10-7-1988]; NOX: 12.75 LBS/MMSCF NATURAL GAS (1) [RULE 2012, 5-6-2005]; NOX: 15 PPMV NATURAL GAS (8) [40CFR 60 Subpart KKKK, 7-6-2006]; PM: 0.01 GRAINS/SCF NATURAL GAS (5A) [RULE 475, 10-8-1976; RULE 475, 8-7-1978]; PM: 0.1 GRAINS/SCF NATURAL GAS (5) [RULE 409, 8-7-1981; RULE 475, 10-8-1976; RULE 475, 8-7-1978]; PM: 11 LBS/HR NATURAL GAS (5) [RULE 409, 8-7-1981; RULE 475, 10-8-1976; RULE 475, 8-7-1978]; SO2: (9) [40CFR 72 - Acid Rain Provisions, 11-24-1997]; SOX: 0.06 LBS/MMBTU NATURAL GAS (8) [40CFR 60 Subpart KKKK, 7-6-2006]; SOX: 0.71 LBS/MMSCF NATURAL GAS (1) [RULE 2011,	I298.18, I298.23

* (1) (1A) (1B) Denotes RECLAIM emission factor (2) (2A) (2B) Denotes RECLAIM emission rate
 (3) Denotes RECLAIM-concentration limit (4) Denotes BACT emission limit
 (5) (5A) (5B) Denotes command and control emission limit (6) Denotes air toxic control rule limit
 (7) Denotes NSR applicability limit (8) (8A) (8B) Denotes 40 CFR limit (e.g. NSPS, NESHAPS, etc.)
 (9) See App B for Emission Limits (10) See section J for NESHAP/MACT requirements

** Refer to section F and G of this permit to determine the monitoring, recordkeeping and reporting requirements for this device.

FACILITY PERMIT TO OPERATE AES HUNTINGTON BEACH, LLC

SECTION H: PERMIT TO CONSTRUCT AND TEMPORARY PERMIT TO OPERATE

The operator shall comply with the terms and conditions set forth below:

Equipment	ID No.	Connected To	RECLAIM Source Type/ Monitoring Unit	Emissions* And Requirements	Conditions
Process 3: Power Generation - Gas Turbines					
				5-6-2005]; VOC: 2 PPMV NATURAL GAS (4) [RULE 1303(a)(1)-BACT, 5-10-1996; RULE 1303(a)(1)-BACT, 12-6-2002]	
CO OXIDATION CATALYST, JOHNSON MATTHEY, SERVING GAS TURBINE NO. 2B, WITH 261 MODULES, 2655 CU FT OF TOTAL CATALYST VOLUME A/N:	C156				
SELECTIVE CATALYTIC REDUCTION, HALDOR TOPSOE, TITANIUM/VANADIUM/TUNGSTE N, SERVING UNIT NO 2B WITH 20 MODULES, 140.8 CU FT OF TOTAL CATALYST VOLUME WITH A/N: AMMONIA INJECTION	C157			NH3: 5 PPMV NATURAL GAS (4) [RULE 1303(a)(1) -BACT, 5-10-1996; RULE 1303(a)(1)-BACT, 12-6-2002]	A195.9, D12.7, D12.8, D12.9, E179.4, E179.5, E193.4

* (1) (1A) (1B) Denotes RECLAIM emission factor (2) (2A) (2B) Denotes RECLAIM emission rate
 (3) Denotes RECLAIM concentration limit (4) Denotes BACT emission limit
 (5) (5A) (5B) Denotes command and control emission limit (6) Denotes air toxic control rule limit
 (7) Denotes NSR applicability limit (8) (8A) (8B) Denotes 40 CFR limit (e.g. NSPS, NESHAPS, etc.)
 (9) See App B for Emission Limits (10) See section J for NESHAP/MACT requirements

** Refer to section F and G of this permit to determine the monitoring, recordkeeping and reporting requirements for this device.

FACILITY PERMIT TO OPERATE AES HUNTINGTON BEACH, LLC

SECTION H: PERMIT TO CONSTRUCT AND TEMPORARY PERMIT TO OPERATE

The operator shall comply with the terms and conditions set forth below:

Equipment	ID No.	Connected To	RECLAIM Source Type/ Monitoring Unit	Emissions* And Requirements	Conditions
Process 3: Power Generation - Gas Turbines					
GAS TURBINE, UNIT NO. 2C, COMBINED CYCLE, NATURAL GAS, MITSUBISHI MODEL 501DA, 1498 MMBTU/HR AT 32 DEGREES F WITH DRY LOW NOX COMBUSTOR WITH A/N: GENERATOR, 132.3 MW GROSS AT 32 DEGREES F	D160		NOX: MAJOR SOURCE**; SOX: PROCESS UNIT**	CO: 2 PPMV NATURAL GAS (4) [RULE 1703 - PSD Analysis, 10-7-1988]; CO: 2000 PPMV NATURAL GAS (5) [RULE 407, 4-2-1982]; NOX: 2 PPMV NATURAL GAS (4) [RULE 1303(a)(1) -BACT, 5-10-1996; RULE 1303(a)(1)-BACT, 12-6-2002; RULE 1703 - PSD Analysis, 10-7-1988]; NOX: 12.75 LBS/MMSCF NATURAL GAS (1) [RULE 2012, 5-6-2005]; NOX: 15 PPMV NATURAL GAS (8) [40CFR 60 Subpart KKKK, 7-6-2006]; PM: 0.01 GRAINS/SCF NATURAL GAS (5A) [RULE 475, 10-8-1976; RULE 475, 8-7-1978]; SO2: (9) [40CFR 72 - Acid Rain Provisions, 11-24-1997]; SOX: 0.06 LBS/MMBTU NATURAL GAS (8) [40CFR 60 Subpart KKKK, 7-6-2006]; SOX: 0.71 LBS/MMSCF NATURAL GAS (1) [RULE 2011, 5-6-2005]; VOC: 2 PPMV NATURAL GAS (4) [RULE 1303(a)(1)-BACT, 5-10-1996; RULE 1303(a)(1)-BACT, 12-6-2002]	A63.5, A63.6, A99.4, A195.6, A195.7, A195.8, A327.1, B61.1, C1.7, C1.8, C1.9, C1.10, D29.5, D29.6, D29.7, D82.3, D82.4, E193.4, E193.5, E193.6, E193.7, I298.9, I298.14, K40.3, K67.5

- | | |
|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| * (1) (1A) (1B) Denotes RECLAIM emission factor
(3) Denotes RECLAIM concentration limit
(5) (5A) (5B) Denotes command and control emission limit
(7) Denotes NSR applicability limit
(9) See App B for Emission Limits | (2) (2A) (2B) Denotes RECLAIM emission rate
(4) Denotes BACT emission limit
(6) Denotes air toxic control rule limit
(8) (8A) (8B) Denotes 40 CFR limit (e.g. NSPS, NESHAPS, etc.)
(10) See section J for NESHAP/MACT requirements |
|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|

** Refer to section F and G of this permit to determine the monitoring, recordkeeping and reporting requirements for this device.

FACILITY PERMIT TO OPERATE AES HUNTINGTON BEACH, LLC

SECTION H: PERMIT TO CONSTRUCT AND TEMPORARY PERMIT TO OPERATE

The operator shall comply with the terms and conditions set forth below:

Equipment	ID No.	Connected To	RECLAIM Source Type/ Monitoring Unit	Emissions* And Requirements	Conditions
Process 3: Power Generation - Gas Turbines					
GENERATOR, HEAT RECOVERY STEAM					
TURBINE, STEAM, COMMON WITH GAS TURBINES NOS. 2A AND 2B, 148.7 MW GROSS					

* (1) (1A) (1B) Denotes RECLAIM emission factor
 (3) Denotes RECLAIM concentration limit
 (5) (5A) (5B) Denotes command and control emission limit
 (7) Denotes NSR applicability limit
 (9) See App B for Emission Limits
 (2) (2A) (2B) Denotes RECLAIM emission rate
 (4) Denotes BACT emission limit
 (6) Denotes air toxic control rule limit
 (8) (8A) (8B) Denotes 40 CFR limit (e.g. NSPS, NESHAPS, etc.)
 (10) See section J for NESHAP/MACT requirements

** Refer to section F and G of this permit to determine the monitoring, recordkeeping and reporting requirements for this device.

FACILITY PERMIT TO OPERATE AES HUNTINGTON BEACH, LLC

SECTION H: PERMIT TO CONSTRUCT AND TEMPORARY PERMIT TO OPERATE

The operator shall comply with the terms and conditions set forth below:

Equipment	ID No.	Connected To	RECLAIM Source Type/ Monitoring Unit	Emissions* And Requirements	Conditions
Process 3: Power Generation - Gas Turbines					
BURNER, DUCT, NATURAL GAS, LOCATED IN THE HRSG OF TURBINE NO. 2C, 507 MMBTU/HR A/N:	D164		NOX: MAJOR SOURCE**; SOX: PROCESS UNIT**	CO: 2 PPMV NATURAL GAS (4) [RULE 1703 - PSD Analysis, 10-7-1988]; CO: 2000 PPMV NATURAL GAS (5) [RULE 407, 4-2-1982]; NOX: 2 PPMV NATURAL GAS (4) [RULE 1303(a)(1) -BACT, 5-10-1996; RULE 1303(a)(1)-BACT, 12-6-2002; RULE 1703 - PSD Analysis, 10-7-1988]; NOX: 12.75 LBS/MMSCF NATURAL GAS (1) [RULE 2012, 5-6-2005]; NOX: 15 PPMV NATURAL GAS (8) [40CFR 60 Subpart KKKK, 7-6-2006]; PM: 0.01 GRAINS/SCF NATURAL GAS (5A) [RULE 475, 10-8-1976; RULE 475, 8-7-1978]; PM: 0.1 GRAINS/SCF NATURAL GAS (5) [RULE 409, 8-7-1981; RULE 475, 10-8-1976; RULE 475, 8-7-1978]; PM: 11 LBS/HR NATURAL GAS (5) [RULE 409, 8-7-1981; RULE 475, 10-8-1976; RULE 475, 8-7-1978]; SO2: (9) [40CFR 72 - Acid Rain Provisions, 11-24-1997]; SOX: 0.06 LBS/MMBTU NATURAL GAS (8) [40CFR 63 Subpart KKKK, 11-13-2003]; SOX: 0.71 LBS/MMSCF NATURAL GAS (1) [RULE	I298.19, I298.24

- | | |
|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| <p>* (1) (1A) (1B) Denotes RECLAIM emission factor
 (3) Denotes RECLAIM concentration limit
 (5) (5A) (5B) Denotes command and control emission limit
 (7) Denotes NSR applicability limit
 (9) See App B for Emission Limits</p> | <p>(2) (2A) (2B) Denotes RECLAIM emission rate
 (4) Denotes BACT emission limit
 (6) Denotes air toxic control rule limit
 (8) (8A) (8B) Denotes 40 CFR limit (e.g. NSPS, NESHAPS, etc.)
 (10) See section J for NESHAP/MACT requirements</p> |
|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|

** Refer to section F and G of this permit to determine the monitoring, recordkeeping and reporting requirements for this device.

FACILITY PERMIT TO OPERATE AES HUNTINGTON BEACH, LLC

SECTION H: PERMIT TO CONSTRUCT AND TEMPORARY PERMIT TO OPERATE

The operator shall comply with the terms and conditions set forth below:

Equipment	ID No.	Connected To	RECLAIM Source Type/ Monitoring Unit	Emissions* And Requirements	Conditions
Process 3: Power Generation - Gas Turbines					
				2011, 5-6-2005]; VOC: 2 PPMV NATURAL GAS (4) [RULE 1303(a)(1)-BACT, 5-10-1996; RULE 1303(a)(1)-BACT, 12-6-2002]	
CO OXIDATION CATALYST, JOHNSON MATTHEY, SERVING GAS TURBINE NO. 2C, WITH 261 MODULES, 2655 CU FT OF TOTAL CATALYST VOLUME A/N:	C165				
SELECTIVE CATALYTIC REDUCTION, HALDOR TOPSOE, TITANIUM/VANADIUM/TUNGSTEN, SERVING UNIT NO 2C WITH 20 MODULES, 140.8 CU FT OF TOTAL CATALYST VOLUME WITH A/N: AMMONIA INJECTION	C166			NH3: 5 PPMV NATURAL GAS (4) [RULE 1303(a)(1)-BACT, 5-10-1996; RULE 1303(a)(1)-BACT, 12-6-2002]	A195.9, D12.7, D12.8, D12.9, E179.4, E179.5, E193.4
STACK, SERVING TURBINE NO. 2C, HEIGHT: 120 FT ; DIAMETER: 18 FT A/N:	S168				
Process 4: AMMONIA STORAGE					
TANK, HORIZONTAL, AQUEOUS AMMONIA 19 PERCENT, 24000 GALLONS, LENGTH: 28 FT 5 IN; DIAMETER: 6 FT A/N:	D169				C157.1, E144.1, E193.4
Process 10: WASTEWATER TREATMENT					
OIL WATER SEPARATOR A/N:	D170				

- * (1) (1A) (1B) Denotes RECLAIM emission factor
- (3) Denotes RECLAIM concentration limit
- (5) (5A) (5B) Denotes command and control emission limit
- (7) Denotes NSR applicability limit
- (9) See App B for Emission Limits
- (2) (2A) (2B) Denotes RECLAIM emission rate
- (4) Denotes BACT emission limit
- (6) Denotes air toxic control rule limit
- (8) (8A) (8B) Denotes 40 CFR limit (e.g. NSPS, NESHAPS, etc.)
- (10) See section J for NESHAP/MACT requirements

** Refer to section F and G of this permit to determine the monitoring, recordkeeping and reporting requirements for this device.

**FACILITY PERMIT TO OPERATE
AES HUNTINGTON BEACH, LLC**

SECTION H: DEVICE ID INDEX

**The following sub-section provides an index
to the devices that make up the facility
description sorted by device ID.**

FACILITY PERMIT TO OPERATE AES HUNTINGTON BEACH, LLC

SECTION H: DEVICE ID INDEX

Device Index For Section H			
Device ID	Section H Page No.	Process	System
D115	3	3	0
D119	5	3	0
C120	5	3	0
C121	5	3	0
S123	5	3	0
D124	7	3	0
D128	9	3	0
C129	9	3	0
C130	9	3	0
S132	9	3	0
D133	11	3	0
D137	13	3	0
C138	13	3	0
C139	13	3	0
S141	13	3	0
D142	15	3	0
D146	17	3	0
C147	17	3	0
C148	17	3	0
S150	17	3	0
D151	19	3	0
D155	21	3	0
C156	21	3	0
C157	21	3	0
D160	23	3	0
D164	25	3	0
C165	25	3	0
C166	25	3	0
S168	25	3	0
D169	25	4	0
D170	25	10	0

FACILITY PERMIT TO OPERATE AES HUNTINGTON BEACH, LLC

SECTION H: PERMIT TO CONSTRUCT AND TEMPORARY PERMIT TO OPERATE

The operator shall comply with the terms and conditions set forth below:

FACILITY CONDITIONS

F2.1 The operator shall limit emissions from this facility as follows:

CONTAMINANT	EMISSIONS LIMIT
PM	Less than 100 TONS IN ANY ONE YEAR

For purposes of this condition, the PM shall be defined as particulate matter with aerodynamic diameter of 2.5 microns or less

For purposes of demonstrating compliance with the 100 tons per year limit the operator shall sum the PM2.5 emissions for each of the major sources at this facility by calculating a 12 month rolling average using the calendar monthly fuel use data and following emission factors for each turbine PM2.5 = 3.36 lbs/mmcf with no duct firing and PM2.5 = 5.52 lbs/mmcf with duct firing.

The operator shall submit written reports of the monthly PM2.5 compliance demonstrations required by this condition. The report submittal shall be included with the semi annual Title V report as required under Rule 3004(a)(4)(f). Records of the monthly PM2.5 compliance demonstrations shall be maintained on site for at least five years and made available upon SCAQMD request

[RULE 1325, 6-3-2011]

F9.1 Except for open abrasive blasting operations, the operator shall not discharge into the atmosphere from any single source of emissions whatsoever any air contaminant for a period or periods aggregating more than three minutes in any one hour which is:

(a) As dark or darker in shade as that designated No.1 on the Ringelmann Chart, as published by the United States Bureau of Mines; or

(b) Of such opacity as to obscure an observer's view to a degree equal to or greater than does smoke described in subparagraph (a) of this condition.

FACILITY PERMIT TO OPERATE AES HUNTINGTON BEACH, LLC

SECTION H: PERMIT TO CONSTRUCT AND TEMPORARY PERMIT TO OPERATE

The operator shall comply with the terms and conditions set forth below:

[RULE 401, 3-2-1984; RULE 401, 11-9-2001]

F14.1 The operator shall not purchase diesel fuel containing sulfur compounds in excess of 15 ppm by weight as supplied by the supplier.

[RULE 431.2, 5-4-1990; RULE 431.2, 9-15-2000]

F16.1 The operator shall keep records, in a manner approved by the District, for the following parameter(s) or item(s):

purchase records of fuel oil and sulfur content of the fuel

[RULE 3004(a)(4)-Periodic Monitoring, 12-12-1997]

F18.1 Acid Rain SO₂ Allowance Allocation for affected units are as follows:

Device ID	Boiler ID	Contaminant	Tons in any year
22	Boiler No. 1	SO ₂	1314
25	Boiler No. 2	SO ₂	1126
98	Boiler No. 3	SO ₂	161
104	Boiler No. 4	SO ₂	176

a). The allowance allocation(s) shall apply to calendar years 2000 through 2009.

b). The number of allowances allocated to Phase II affected units by U.S. EPA may change in a 1998 revision to 40CFR73 Tables 2,3, and 4. In addition, the number of allowances actually held by an affected source in a unit account may differ from the number allocated by U.S. EPA. Neither of the aforementioned conditions necessitate a revision to the unit SO₂ allowance allocations identified in this permit (see 40 CFR 72.84)

[40CFR 73 Subpart B, 1-11-1993]

FACILITY PERMIT TO OPERATE AES HUNTINGTON BEACH, LLC

SECTION H: PERMIT TO CONSTRUCT AND TEMPORARY PERMIT TO OPERATE

The operator shall comply with the terms and conditions set forth below:

F24.1 Accidental release prevention requirements of Section 112(r)(7):

a). The operator shall comply with the accidental release prevention requirements pursuant to 40 CFR Part 68 and shall submit to the Executive Officer, as a part of an annual compliance certification, a statement that certifies compliance with all of the requirements of 40 CFR Part 68, including the registration and submission of a risk management plan (RMP).

b). The operator shall submit any additional relevant information requested by the Executive Officer or designated agency.

[40CFR 68 - Accidental Release Prevention, 5-24-1996]

F52.1 This facility is subject to the applicable requirements of the following rules or regulation(s):

FACILITY PERMIT TO OPERATE AES HUNTINGTON BEACH, LLC

SECTION H: PERMIT TO CONSTRUCT AND TEMPORARY PERMIT TO OPERATE

The operator shall comply with the terms and conditions set forth below:

The facility shall submit a detailed retirement plan for the permanent shutdown of Huntington Beach (HB) Boilers 1 and 2 and Redondo Beach (RB) Boilers 6 and 8 describing in detail the steps and schedule that will be taken to render the boilers permanently inoperable. The retirement plan shall be submitted to SCAQMD within 60 days after the Permits to Construct for gas turbine Units 1A, 1B, 1C, 2A, 2B, and 2C are issued

The plan must be approved in writing by SCAQMD. AES shall not commence any construction of HB Boilers 1 & 2 and RB Boilers 6 & 8 repowering project equipment including gas turbines 1A, 1B, 1C, 2A, 2B, 2C, steam turbines 1 and 2, SCR/CO catalysts for gas turbines 1A, 1B, 1C, 2A, 2B, and 2C, or the oil water separator, before the retirement plan is approved in writing by SCAQMD. If SCAQMD notifies AES that the plan is not approvable, AES shall submit a revised plan addressing SCAQMD's concerns within 30 days

Within 30 calendar days of actual shutdown, or no later than December 31, 2018, AES shall provide SCAQMD with a notarized statement that HB Beach Boilers 1 and 2 and RB Boilers 6 and 8 are permanently shutdown and that any re start or operation of the units shall require new Permits to Construct and be subject to all requirements of non-attainment new source review and the prevention of significant deterioration program.

AES shall notify SCAQMD 30 days prior to the implementation of the approved retirement plan for permanent shutdown of HB Boilers 1 and 2 and RB Boilers 6 and 8, or advise SCAQMD as soon practicable should AES undertake permanent shutdown prior to December 31, 2018

AES shall cease operation of RB Boilers 6 and 8 within 90 calendar days of the first fire of Units 1A, 1B, or 1C, and AES shall cease operation of HB Boilers 1 and 2 within 90 calendar days of the first fire of Units 2A, 2B, or 2C

[RULE 1304(a)-Modeling and Offset Exemption, 6-14-1996]

F52.2 This facility is subject to the applicable requirements of the following rules or regulation(s):

FACILITY PERMIT TO OPERATE AES HUNTINGTON BEACH, LLC

SECTION H: PERMIT TO CONSTRUCT AND TEMPORARY PERMIT TO OPERATE

The operator shall comply with the terms and conditions set forth below:

For all circuit breakers at the facility utilizing SF6, the operator shall install, operate, and maintain enclosed-pressure SF6 circuit breakers with a maximum annual leak rate of 0.5 percent by weight. The circuit breakers shall be equipped with a 10 percent by weight leak detection system. The leak detection system shall be calibrated in accordance with manufacturer's specifications. The manufacturer's specifications and all records of calibrations shall be maintained on site

The total CO₂e emissions from all circuit breakers shall not exceed 6.8 tons per calendar year

[RULE 1714, 12-10-2012]

DEVICE CONDITIONS

A. Emission Limits

A63.5 The operator shall limit emissions from this equipment as follows:

CONTAMINANT	EMISSIONS LIMIT
PM10	Less than or equal to 4278 LBS IN ANY ONE MONTH
CO	Less than or equal to 12776.2 LBS IN ANY ONE MONTH
VOC	Less than or equal to 7487.2 LBS IN ANY ONE MONTH

FACILITY PERMIT TO OPERATE AES HUNTINGTON BEACH, LLC

SECTION H: PERMIT TO CONSTRUCT AND TEMPORARY PERMIT TO OPERATE

The operator shall comply with the terms and conditions set forth below:

The above limits apply after the equipment is commissioned. The above limits apply to each turbine

The operator shall calculate compliance with the emission limit(s) by using fuel use data and the following emission factors: VOC: 1.47 lbs/mmcf, PM10: 3.36 lbs/mmcf with no DB firing, 5.22 lbs/mmcf with DB firing

The operator shall calculate compliance with the emission limits for CO after the CO CEMS certification based upon readings from the SCAQMD certified CEMS

The operator shall limit the annual firing hours for each turbine to 6370 hours including no more than 470 hours with duct firing (this does not include start up and shutdown hours)

[RULE 1303(b)(2)-Offset, 5-10-1996; RULE 1303(b)(2)-Offset, 12-6-2002]

[Devices subject to this condition : D115, D124, D133, D142, D151, D160]

A63.6 The operator shall limit emissions from this equipment as follows:

CONTAMINANT	EMISSIONS LIMIT
PM10	Less than or equal to 2930 LBS IN ANY ONE MONTH
CO	Less than or equal to 112882 LBS IN ANY ONE MONTH
VOC	Less than or equal to 14121 LBS IN ANY ONE MONTH

The above limits apply during commissioning. The above limits apply to each turbine

The operator shall calculate compliance with the emission limit(s) by using fuel use data and the following emission factors: VOC: 21.74 lbs/mmcf, PM10: 4.51 lbs/mmcf, and CO: 173.80 lbs/mmcf

[RULE 1303(b)(2)-Offset, 5-10-1996; RULE 1303(b)(2)-Offset, 12-6-2002]

[Devices subject to this condition : D115, D124, D133, D142, D151, D160]

FACILITY PERMIT TO OPERATE AES HUNTINGTON BEACH, LLC

SECTION H: PERMIT TO CONSTRUCT AND TEMPORARY PERMIT TO OPERATE

The operator shall comply with the terms and conditions set forth below:

A99.4 The 12.75 LBS/MMSCF NOX emission limit(s) shall only apply during turbine operation prior to CEMS certification for reporting NOx emissions.

[RULE 2012, 5-6-2005]

[Devices subject to this condition : D115, D124, D133, D142, D151, D160]

A195.6 The 2.0 PPMV NOX emission limit(s) is averaged over 60 minutes at 15 percent O₂, dry. This limit shall not apply during commissioning, turbine start ups and turbine shutdowns.

[RULE 1703 - PSD Analysis, 10-7-1988; RULE 2005, 6-3-2011]

[Devices subject to this condition : D115, D124, D133, D142, D151, D160]

A195.7 The 2.0 PPMV CO emission limit(s) is averaged over 60 minutes at 15 percent O₂, dry. This limit shall not apply during commissioning, turbine start ups and turbine shutdowns.

[RULE 1703 - PSD Analysis, 10-7-1988]

[Devices subject to this condition : D115, D124, D133, D142, D151, D160]

A195.8 The 2.0 PPMV VOC emission limit(s) is averaged over 60 minutes at 15 percent O₂, dry. This limit shall not apply during commissioning, turbine start ups and turbine shutdowns.

[RULE 1303(a)(1)-BACT, 5-10-1996; RULE 1303(a)(1)-BACT, 12-6-2002; RULE 1303(b)(2)-Offset, 5-10-1996; RULE 1303(b)(2)-Offset, 12-6-2002]

[Devices subject to this condition : D115, D124, D133, D142, D151, D160]

A195.9 The 5 PPMV NH₃ emission limit(s) is averaged over 60 minutes at 15% O₂, dry basis. The operator shall calculate and continuously record the NH₃ slip concentration using the following:

FACILITY PERMIT TO OPERATE AES HUNTINGTON BEACH, LLC

SECTION H: PERMIT TO CONSTRUCT AND TEMPORARY PERMIT TO OPERATE

The operator shall comply with the terms and conditions set forth below:

$$\text{NH}_3 \text{ (ppmv)} = [\text{a-b}*(\text{c}*1.2)/1\text{E}+06]*1\text{E}+06/\text{b}$$

1. where,
2. a = NH₃ injection rate (lbs/hr)/17(lb/lb-mol)
3. b = dry exhaust gas flow rate (scf/hr)/385.3 scf/lb-mol)
4. c = change in measured NO_x across the SCR (ppmvd at 15% O₂)

The operator shall install and maintain a NO_x analyzer to measure the SCR inlet NO_x ppmv accurate to plus or minus 5 percent calibrated at least once every twelve months. The NO_x analyzer shall be installed and operated within 90 days of initial start-up..

The operator shall use the above described method or another alternative method approved by the Executive Officer..

The ammonia slip calculation procedures described above shall not be used for compliance determination or emission information without corroborative data using an approved reference method for the determination of ammonia..

[RULE 1303(a)(1)-BACT, 5-10-1996; RULE 1303(a)(1)-BACT, 12-6-2002]

[Devices subject to this condition : C121, C130, C139, C157, C166]

A327.1 For the purpose of determining compliance with District Rule 475, combustion contaminant emissions may exceed the concentration limit or the mass emission limit listed, but not both limits at the same time.

[RULE 475, 10-8-1976; RULE 475, 8-7-1978]

[Devices subject to this condition : D115, D124, D133, D142, C148, D151, D160]

B. Material/Fuel Type Limits

FACILITY PERMIT TO OPERATE AES HUNTINGTON BEACH, LLC

SECTION H: PERMIT TO CONSTRUCT AND TEMPORARY PERMIT TO OPERATE

The operator shall comply with the terms and conditions set forth below:

B61.1 The operator shall not use natural gas containing the following specified compounds:

Compound	grain per 100 scf
H2S greater than	.25

This concentration limit is an annual average based on monthly sample of natural gas composition or gas supplier documentation. Gaseous fuel samples shall be tested using District Method 307-91 for total sulfur calculated as H2S

[RULE 1303(b)(2)-Offset, 5-10-1996; RULE 1303(b)(2)-Offset, 12-6-2002]

[Devices subject to this condition : D115, D124, D133, D142, D151, D160]

C. Throughput or Operating Parameter Limits

C1.7 The operator shall limit the number of start-ups to no more than 90 in any one calendar month.

FACILITY PERMIT TO OPERATE AES HUNTINGTON BEACH, LLC

SECTION H: PERMIT TO CONSTRUCT AND TEMPORARY PERMIT TO OPERATE

The operator shall comply with the terms and conditions set forth below:

The number of cold start ups shall not exceed 5 per months, the number of warm start ups shall not exceed 25 per month, and the number of hot start ups shall not exceed 60 per month.

For the purposes of this condition: A cold start up is defined as a start up which occurs after the steam turbine has been shutdown for 49 hours or more. A cold start up shall not exceed 90 minutes. Emissions from a cold start up shall not exceed the following: NOx - 29 lbs., CO - 116 lbs., VOC - 28 lbs.

A warm start up is defined as a start up which occurs after the steam turbine has been shutdown for 9 - 49 hours. A warm start up shall not exceed 32.5 minutes. Emissions from a warm start up shall not exceed the following: NOx - 17 lbs., CO - 46 lbs., VOC - 21 lbs.

A hot start up is defined as a start up which occurs after the steam turbine has been shutdown for less than 9 hours. A hot start up shall not exceed 32.5 minutes. Emissions from a hot start up shall not exceed the following: NOx - 17 lbs., CO - 34 lbs., VOC - 21 lbs.

The beginning of a start up occurs at initial fire in the combustor and the end of start up occurs when the BACT levels are achieved. If during start up the process is aborted the process will count as one start up.

The operator shall maintain records, in a manner approved by the SCAQMD to demonstrate compliance with this condition.

[RULE 2005, 6-3-2011]

[Devices subject to this condition : D115, D124, D133, D142, D151, D160]

C1.8 The operator shall limit the number of shut-downs to no more than 90 in any one calendar month.

FACILITY PERMIT TO OPERATE AES HUNTINGTON BEACH, LLC

SECTION H: PERMIT TO CONSTRUCT AND TEMPORARY PERMIT TO OPERATE

The operator shall comply with the terms and conditions set forth below:

Shutdown time shall not exceed 10 minutes per shutdown. Emissions from a shutdown shall not exceed the following: NO_x - 9 lbs., CO - 46 lbs., VOC - 31 lbs.

The operator shall maintain records, in a manner approved by the SCAQMD to demonstrate compliance with this condition.

[RULE 2005, 6-3-2011]

[Devices subject to this condition : D115, D124, D133, D142, D151, D160]

C1.9 The operator shall limit the output to no more than 939 MW.

The 939 MW limit is based on the net power output.

The net electrical output shall be measured at the breaker of the transmission system interconnection point in the generation switchyard. The monitoring equipment shall meet ANSI Standard No. C12 or equivalent, and have an accuracy of +/-0.2 percent.

The net electrical output from each meter shall be recorded at the CEMS DAS.

The operator shall maintain records, for a minimum of five years, in a manner approved by the SCAQMD to demonstrate compliance with this condition.

[RULE 1304(a)-Modeling and Offset Exemption, 6-14-1996]

[Devices subject to this condition : D115, D124, D133, D142, D151, D160]

C1.10 The operator shall limit the output to no more than 972 MW.

FACILITY PERMIT TO OPERATE AES HUNTINGTON BEACH, LLC

SECTION H: PERMIT TO CONSTRUCT AND TEMPORARY PERMIT TO OPERATE

The operator shall comply with the terms and conditions set forth below:

The 972 MW limit is based on the gross power output.

The gross electrical output shall be measured at the each of the 8 generators. The monitoring equipment shall meet ANSI Standard No. C12 or equivalent, and have an accuracy of +/-0.2 percent.

The gross electrical output from generators shall be recorded at the CEMS DAS.

The operator shall maintain records, for a minimum of five years, in a manner approved by the SCAQMD to demonstrate compliance with this condition.

[RULE 1304(a)-Modeling and Offset Exemption, 6-14-1996]

[Devices subject to this condition : D115, D124, D133, D142, D151, D160]

C157.1 The operator shall install and maintain a pressure relief valve set at 50 psig.

[RULE 1303(a)(1)-BACT, 5-10-1996; RULE 1303(a)(1)-BACT, 12-6-2002]

[Devices subject to this condition : D169]

D. Monitoring/Testing Requirements

D12.7 The operator shall install and maintain a(n) flow meter to accurately indicate the flow rate of the total hourly throughput of injected ammonia.

The operator shall also install and maintain a device to continuously record the parameter being measured

The measuring device or gauge shall be accurate to within plus or minus 5 percent. It shall be calibrated once every twelve months

The injected ammonia rate shall be maintained within 11.8 gal/min and 33 gal/min except during start ups and shutdowns

[RULE 1303(a)(1)-BACT, 5-10-1996; RULE 1303(a)(1)-BACT, 12-6-2002]

FACILITY PERMIT TO OPERATE AES HUNTINGTON BEACH, LLC

SECTION H: PERMIT TO CONSTRUCT AND TEMPORARY PERMIT TO OPERATE

The operator shall comply with the terms and conditions set forth below:

[Devices subject to this condition : C121, C130, C139, C148, C157, C166]

D12.8 The operator shall install and maintain a(n) temperature gauge to accurately indicate the temperature in the exhaust at the inlet to the SCR reactor.

The operator shall also install and maintain a device to continuously record the parameter being measured

The measuring device or gauge shall be accurate to within plus or minus 5 percent. It shall be calibrated once every twelve months

The exhaust temperature at the inlet of the SCR shall be maintained between 400-700 deg F except during start up and shutdowns

[RULE 1303(a)(1)-BACT, 5-10-1996; RULE 1303(a)(1)-BACT, 12-6-2002]

[Devices subject to this condition : C121, C130, C139, C148, C157, C166]

D12.9 The operator shall install and maintain a(n) differential pressure gauge to accurately indicate the differential pressure across the SCR catalyst bed in inches of water column.

The operator shall also install and maintain a device to continuously record the parameter being measured

The measuring device or gauge shall be accurate to within plus or minus 5 percent. It shall be calibrated once every twelve months

The differential pressure shall be maintained between 1.5 " WC and 3.5 " WC

[RULE 1303(a)(1)-BACT, 5-10-1996; RULE 1303(a)(1)-BACT, 12-6-2002]

[Devices subject to this condition : C121, C130, C139, C148, C157, C166]

D12.10 The operator shall install and maintain a(n) temperature gauge to accurately indicate the temperature in the exhaust at the inlet to the CO Catalyst.

FACILITY PERMIT TO OPERATE AES HUNTINGTON BEACH, LLC

SECTION H: PERMIT TO CONSTRUCT AND TEMPORARY PERMIT TO OPERATE

The operator shall comply with the terms and conditions set forth below:

The operator shall also install and maintain a device to continuously record the parameter being measured

The measuring device or gauge shall be accurate to within plus or minus 5 percent. It shall be calibrated once every twelve months

The exhaust temperature at the inlet of the CO Catalyst shall be maintained at a minimum of 500 deg F, except during start up and shutdowns

[RULE 1303(a)(1)-BACT, 5-10-1996; RULE 1303(a)(1)-BACT, 12-6-2002]

[Devices subject to this condition : C120]

D29.5 The operator shall conduct source test(s) for the pollutant(s) identified below.

Pollutant(s) to be tested	Required Test Method(s)	Averaging Time	Test Location
NOX emissions	District method 100.1	1 hour	Outlet of the SCR serving this equipment
CO emissions	District method 100.1	1 hour	Outlet of the SCR serving this equipment
SOX emissions	Approved District method	District-approved averaging time	Fuel sample
VOC emissions	Approved District method	1 hour	Outlet of the SCR serving this equipment
PM10 emissions	Approved District method	District-approved averaging time	Outlet of the SCR serving this equipment
PM2.5	Approved District method	District-approved averaging time	Outlet of the SCR serving this equipment
NH3 emissions	District method 207.1 and 5.3 or EPA method	1 hour	Outlet of the SCR serving this equipment

FACILITY PERMIT TO OPERATE AES HUNTINGTON BEACH, LLC

SECTION H: PERMIT TO CONSTRUCT AND TEMPORARY PERMIT TO OPERATE

The operator shall comply with the terms and conditions set forth below:

The test shall be conducted after SCAQMD approval of the source test protocol, but no later than 180 days after initial start-up. The SCAQMD shall be notified of the date and time of the test at least 10 days prior to the test.

The test shall be conducted to determine the oxygen levels in the exhaust. In addition, the tests shall measure the fuel flow rate (CFH), the flue gas flow rate, and the turbine generating output in MW net and MW gross

The test shall be conducted in accordance with an SCAQMD approved protocol. The protocol shall be submitted to the SCAQMD engineer no later than 45 days before the proposed test date and shall be approved by the SCAQMD before the test commences. The protocol shall include the proposed operating conditions of the turbine during the tests, the identity of the testing lab, a statement from the lab certifying that it meets the criteria of Rule 304, and a description of all sampling and analytical procedures

The test shall be conducted when this equipment is operating at loads of 100 and 70 percent without duct firing, and 100 percent with duct firing

For natural gas fired turbines only, VOC compliance shall be demonstrated as follows: a) Stack gas samples are extracted into Summa canisters maintaining a final canister pressure between 400-500 mm Hg absolute, b) Pressurization of canisters are done with zero gas analyzed/certified to contain less than 0.05 ppmv total hydrocarbon as carbon, and c) Analysis of canisters are per EPA Method TO-12 (with pre concentration) and temperature of canisters when extracting samples for analysis is not below 70 deg F

The use of this alternative method is solely for the determination of compliance with the VOC BACT level of 2.0 ppmv calculated as carbon for natural gas fired turbines. The results shall be reported with two significant digits

[RULE 1303(a)(1)-BACT, 5-10-1996; RULE 1303(a)(1)-BACT, 12-6-2002; RULE 1303(b)(2)-Offset, 5-10-1996; RULE 1303(b)(2)-Offset, 12-6-2002; RULE 1703 - PSD Analysis, 10-7-1988; RULE 2005, 6-3-2011]

[Devices subject to this condition : D115, D124, D133, D142, D151, D160]

FACILITY PERMIT TO OPERATE AES HUNTINGTON BEACH, LLC

SECTION H: PERMIT TO CONSTRUCT AND TEMPORARY PERMIT TO OPERATE

The operator shall comply with the terms and conditions set forth below:

D29.6 The operator shall conduct source test(s) for the pollutant(s) identified below.

Pollutant(s) to be tested	Required Test Method(s)	Header 3	Test Location
NH3 emissions	District method 207.1 and 5.3 or EPA method 17	1 hour	Outlet of the SCR serving this equipment

The test shall be conducted and the results submitted to the District within 60 days after the test date. The SCAQMD shall be notified of the date and time of the test at least 10 days prior to the test

The test shall be conducted at least quarterly during the first twelve months of operation and at least annually thereafter. The NOx concentration, as determined by the CEMS, shall be simultaneously recorded during the ammonia slip test. If the CEMS is inoperable, a test shall be conducted to determine the NOx emissions using District Method 100.1 measured over a 60 minute averaging time period

The test shall be conducted to demonstrate compliance with the Rule 1303 concentration limit

[RULE 1303(a)(1)-BACT, 5-10-1996; RULE 1303(a)(1)-BACT, 12-6-2002]

[Devices subject to this condition : D115, D124, D133, D142, D151, D160]

D29.7 The operator shall conduct source test(s) for the pollutant(s) identified below.

Pollutant(s) to be tested	Required Test Method(s)	Averaging Time	Test Location
SOX emissions	Approved District method	District-approved averaging time	Fuel Sample
VOC emissions	Approved District method	1 hour	Outlet of the SCR serving this equipment

FACILITY PERMIT TO OPERATE AES HUNTINGTON BEACH, LLC

SECTION H: PERMIT TO CONSTRUCT AND TEMPORARY PERMIT TO OPERATE

The operator shall comply with the terms and conditions set forth below:

PM10 emissions	Approved District method	District-approved averaging time	Outlet of the SCR serving this equipment
-------------------	--------------------------	-------------------------------------	---------------------------------------------

The test shall be conducted at least once every three years

The test shall be conducted and the results submitted to the SCAQMD within 60 days after the test date. The SCAQMD shall be notified of the date and time of the test at least 10 days prior to the test

The test shall be conducted when this equipment is operating at 100 percent of maximum heat input.

For natural gas fired turbines only, VOC compliance shall be demonstrated as follows: a) Stack gas samples are extracted into Summa canisters maintaining a final canister pressure between 400-500 mm Hg absolute, b) Pressurization of canisters are done with zero gas analyzed/certified to contain less than 0.05 ppmv total hydrocarbon as carbon, and c) Analysis of canisters are per EPA Method TO-12 (with pre concentration) and temperature of canisters when extracting samples for analysis is not below 70 deg F

The use of this alternative method is solely for the determination of compliance with the VOC BACT level of 2.0 ppmv calculated as carbon for natural gas fired turbines. The results shall be reported with two significant digits

The test shall be conducted to demonstrate compliance with the Rule 1303 concentration and/or monthly emission limit

[RULE 1303(a)(1)-BACT, 5-10-1996; RULE 1303(a)(1)-BACT, 12-6-2002; RULE 1303(b)(2)-Offset, 5-10-1996; RULE 1303(b)(2)-Offset, 12-6-2002; RULE 475, 10-8-1976; RULE 475, 8-7-1978]

[Devices subject to this condition : D115, D124, D133, D142, D151, D160]

D82.3 The operator shall install and maintain a CEMS to measure the following parameters:

FACILITY PERMIT TO OPERATE AES HUNTINGTON BEACH, LLC

SECTION H: PERMIT TO CONSTRUCT AND TEMPORARY PERMIT TO OPERATE

The operator shall comply with the terms and conditions set forth below:

CO concentration in ppmv

Concentrations shall be corrected to 15 percent oxygen on a dry basis. The CEMS shall be installed and operating no later than 90 days after initial startup of the turbine, in accordance with approved SCAQMD Rule 218 CEMS plan application. The operator shall not install the CEMS prior to receiving initial approval from SCAQMD

The CEMS shall be installed and operated to measure the CO concentration over a 15 minute averaging time period

The CEMS shall convert the actual CO concentrations to mass emission rates (lbs/hr) using the equation below and record the hourly emission rates on a continuous basis

CO Emission Rate, lbs/hr = $K * C_{co} * F_d [20.9 / (20.9\% - \%O_2 d)] [(Q_g * HHV) / 10E6]$,
where

1. $K = 7.267 * 10^{-8}$ (lbs/scf)/ppm
2. C_{co} = Average of 4 consecutive 15 min. average CO concentrations, ppm
3. $F_d = 8710$ dscf/MMBTU natural gas
4. $\%O_2, d$ = Hourly average % by volume O2 dry, corresponding to C_{co}
5. Q_g = Fuel gas usage during the hour, scf/hr
6. HHV = Gross high heating value of the fuel gas, BTU/scf

**[RULE 1303(a)(1)-BACT, 5-10-1996; RULE 1303(a)(1)-BACT, 12-6-2002; RULE 1703
- PSD Analysis, 10-7-1988]**

[Devices subject to this condition : D115, D124, D133, D142, D151, D160]

D82.4 The operator shall install and maintain a CEMS to measure the following parameters:

FACILITY PERMIT TO OPERATE AES HUNTINGTON BEACH, LLC

SECTION H: PERMIT TO CONSTRUCT AND TEMPORARY PERMIT TO OPERATE

The operator shall comply with the terms and conditions set forth below:

NOx concentration in ppmv

Concentrations shall be corrected to 15 percent oxygen on a dry basis. The CEMS shall be installed and operating no later than 90 days after initial startup of the turbine, in accordance with approved SCAQMD REG XX CEMS plan application. The operator shall not install the CEMS prior to receiving initial approval from SCAQMD

Rule 2012 provisional RATA testing shall be completed and submitted to the SCAQMD within 90 days of the conclusion of the turbine commissioning period. During the interim period between the initial start up and the provisional certification date of the CEMS, the operator shall comply with the requirements of Rule 2012(h)(2) and 2012(h)(3)

[RULE 1703 - PSD Analysis, 10-7-1988; RULE 2005, 6-3-2011; RULE 2012, 5-6-2005]

[Devices subject to this condition : D115, D124, D133, D142, D151, D160]

E. Equipment Operation/Construction Requirements

E144.1 The operator shall vent this equipment, during filling, only to the vessel from which it is being filled.

[RULE 1303(a)(1)-BACT, 5-10-1996; RULE 1303(a)(1)-BACT, 12-6-2002]

[Devices subject to this condition : D169]

E179.4 For the purpose of the following condition number(s), continuously record shall be defined as as recording at least once every hour and shall be calculated based upon the average of the continuous monitoring for that hour.

Condition Number D 12- 7

Condition Number D 12- 8

[RULE 1303(a)(1)-BACT, 5-10-1996; RULE 1303(a)(1)-BACT, 12-6-2002]

[Devices subject to this condition : C121, C130, C139, C148, C157, C166]

FACILITY PERMIT TO OPERATE AES HUNTINGTON BEACH, LLC

SECTION H: PERMIT TO CONSTRUCT AND TEMPORARY PERMIT TO OPERATE

The operator shall comply with the terms and conditions set forth below:

E179.5 For the purpose of the following condition number(s), continuous monitoring shall be defined as measuring at least once every month and shall be calculated based upon the average of the continuous monitoring for that month.

Condition Number D 12- 9

[RULE 1303(a)(1)-BACT, 5-10-1996; RULE 1303(a)(1)-BACT, 12-6-2002]

[Devices subject to this condition : C121, C130, C139, C148, C157, C166]

E193.3 The operator shall install this equipment according to the following requirements:

Construction shall commence within 12 months of the date of the permit to construct unless the permit is extended, but in no case should the start of construction exceed 18 months from the date of the permit to construct. Construction shall not be discontinued for a period of 18 months or more

[RULE 205, 1-5-1990; 40CFR 52.21 - PSD, 6-19-1978]

[Devices subject to this condition : D115]

E193.4 The operator shall upon completion of construction, operate and maintain this equipment according to the following specifications:

In accordance with all mitigation measures stipulated in the final California Energy Commission decision for the 12-AFC-02 project.

[CA PRC CEQA, 11-23-1970]

[Devices subject to this condition : D115, C121, D124, C130, D133, C139, D142, C148, D151, C157, D160, C166, D169]

E193.5 The operator shall install this equipment according to the following requirements:

FACILITY PERMIT TO OPERATE AES HUNTINGTON BEACH, LLC

SECTION H: PERMIT TO CONSTRUCT AND TEMPORARY PERMIT TO OPERATE

The operator shall comply with the terms and conditions set forth below:

Total commissioning hrs shall not exceed 491 hrs of operation for each turbine from the date of initial turbine start up. Total commissioning hrs without control shall not exceed 47 hrs of operation for each turbine. Only one turbine shall undergo steam blows at any one time and at a load of no more than 50%. During steam blows, the other two turbines in the block shall not be fired. During all other commissioning activities outside of steam blows, a maximum of 2 turbines may be operated at any one time

The operator shall vent this equipment to the CO oxidation catalyst and SCR control system whenever the turbine is in operation after commissioning

The operator shall provide SCAQMD with written notification of the initial start up date. Written records of commissioning, start ups, and shutdowns shall be maintained and be made available upon request from SCAQMD

[RULE 1303(a)(1)-BACT, 5-10-1996; RULE 1303(a)(1)-BACT, 12-6-2002; RULE 1303(b)(2)-Offset, 5-10-1996; RULE 1303(b)(2)-Offset, 12-6-2002; RULE 1703 - PSD Analysis, 10-7-1988; RULE 2005, 6-3-2011]

[Devices subject to this condition : D115, D124, D133, D142, D151, D160]

E193.6 The operator shall upon completion of construction, operate and maintain this equipment according to the following specifications:

FACILITY PERMIT TO OPERATE AES HUNTINGTON BEACH, LLC

SECTION H: PERMIT TO CONSTRUCT AND TEMPORARY PERMIT TO OPERATE

The operator shall comply with the terms and conditions set forth below:

The operator shall record the total net power generated in a calendar month in megawatt-hours

The operator shall calculate and record greenhouse gas emissions for each calendar month using the following formula:

$$\text{GHG} = 60.08 * \text{FF}$$

Where, GHG is the greenhouse gas emissions in tons of CO₂ and FF is the monthly fuel usage in millions standard cubic feet

The operator shall calculate and record the GHG emissions in pounds per net megawatt-hour on the 12-month rolling average. The GHG emissions from this equipment shall not exceed 652,827 tons per year per turbine on a 12-month rolling average basis. The calendar annual average GHG emissions shall not exceed 1,053.7 lbs per net megawatt-hour (1,138.0 lbs per net megawatt hour inclusive of equipment degradation).

The operator shall maintain records in a manner approved by the SCAQMD to demonstrate compliance with this condition. The records shall be made available to SCAQMD upon request.

[RULE 1714, 12-10-2012]

[Devices subject to this condition : D115, D124, D133, D142, D151, D160]

E193.7 The operator shall upon completion of construction, operate and maintain this equipment according to the following specifications:

FACILITY PERMIT TO OPERATE AES HUNTINGTON BEACH, LLC

SECTION H: PERMIT TO CONSTRUCT AND TEMPORARY PERMIT TO OPERATE

The operator shall comply with the terms and conditions set forth below:

The operator shall record the total gross power generated in a calendar month in megawatt-hours

The operator shall calculate and record greenhouse gas emissions for each calendar month using the following formula:

$$\text{GHG} = 60.08 * \text{FF}$$

Where, GHG is the greenhouse gas emissions in tons of CO₂ and FF is the monthly fuel usage in millions standard cubic feet

The operator shall calculate and record the GHG emissions in pounds per gross megawatt-hour on a 12-month rolling average. The calendar annual average GHG emissions shall not exceed 1,000 lbs per gross megawatt-hour, or the applicable limit which is published in the final EPA rule

The operator shall maintain records in a manner approved by the SCAQMD to demonstrate compliance with this condition. The records shall be made available to SCAQMD upon request

[40CFR 63 Subpart KKKK, 4-20-2006]

[Devices subject to this condition : D115, D124, D133, D142, D151, D160]

I. Administrative

FACILITY PERMIT TO OPERATE AES HUNTINGTON BEACH, LLC

SECTION H: PERMIT TO CONSTRUCT AND TEMPORARY PERMIT TO OPERATE

The operator shall comply with the terms and conditions set forth below:

I298.1 This equipment shall not be operated unless the facility holds 39854 pounds of NOx RTCs in its allocation account to offset the annual emissions increase for the first year of operation. The RTCs held to satisfy the first year of operation portion of this condition may be transferred only after one year from the initial start of operation. In addition, this equipment shall not be operated unless the operator demonstrates to the Executive Officer that, at the commencement of each compliance year after the start of operation, the facility holds 62507 pounds of NOx RTCs valid during that compliance year. RTCs held to satisfy the compliance year portion of this condition may be transferred only after the compliance year for which the RTCs are held. If the initial or annual hold amount is partially satisfied by holding RTCs that expire midway through the hold period, those RTCs may be transferred upon their respective expiration dates. This hold amount is in addition to any other amount of RTCs required to be held under other condition(s) stated in this permit.

[RULE 2005, 6-3-2011]

[Devices subject to this condition : D115]

I298.2 This equipment shall not be operated unless the facility holds 2694 pounds of SOx RTCs in its allocation account to offset the annual emissions increase for the first year of operation. The RTCs held to satisfy the first year of operation portion of this condition may be transferred only after one year from the initial start of operation. In addition, this equipment shall not be operated unless the operator demonstrates to the Executive Officer that, at the commencement of each compliance year after the start of operation, the facility holds 3798 pounds of SOx RTCs valid during that compliance year. RTCs held to satisfy the compliance year portion of this condition may be transferred only after the compliance year for which the RTCs are held. If the initial or annual hold amount is partially satisfied by holding RTCs that expire midway through the hold period, those RTCs may be transferred upon their respective expiration dates. This hold amount is in addition to any other amount of RTCs required to be held under other condition(s) stated in this permit.

[RULE 2005, 6-3-2011]

[Devices subject to this condition : D115]

FACILITY PERMIT TO OPERATE AES HUNTINGTON BEACH, LLC

SECTION H: PERMIT TO CONSTRUCT AND TEMPORARY PERMIT TO OPERATE

The operator shall comply with the terms and conditions set forth below:

I298.3 This equipment shall not be operated unless the facility holds 13488 pounds of NOx RTCs in its allocation account to offset the annual emissions increase for the first year of operation. The RTCs held to satisfy the first year of operation portion of this condition may be transferred only after one year from the initial start of operation. In addition, this equipment shall not be operated unless the operator demonstrates to the Executive Officer that, at the commencement of each compliance year after the start of operation, the facility holds 21155 pounds of NOx RTCs valid during that compliance year. RTCs held to satisfy the compliance year portion of this condition may be transferred only after the compliance year for which the RTCs are held. If the initial or annual hold amount is partially satisfied by holding RTCs that expire midway through the hold period, those RTCs may be transferred upon their respective expiration dates. This hold amount is in addition to any other amount of RTCs required to be held under other condition(s) stated in this permit.

[RULE 2005, 6-3-2011]

[Devices subject to this condition : D119]

I298.4 This equipment shall not be operated unless the facility holds 912 pounds of SOx RTCs in its allocation account to offset the annual emissions increase for the first year of operation. The RTCs held to satisfy the first year of operation portion of this condition may be transferred only after one year from the initial start of operation. In addition, this equipment shall not be operated unless the operator demonstrates to the Executive Officer that, at the commencement of each compliance year after the start of operation, the facility holds 1286 pounds of SOx RTCs valid during that compliance year. RTCs held to satisfy the compliance year portion of this condition may be transferred only after the compliance year for which the RTCs are held. If the initial or annual hold amount is partially satisfied by holding RTCs that expire midway through the hold period, those RTCs may be transferred upon their respective expiration dates. This hold amount is in addition to any other amount of RTCs required to be held under other condition(s) stated in this permit.

[RULE 2005, 6-3-2011]

[Devices subject to this condition : D119]

FACILITY PERMIT TO OPERATE AES HUNTINGTON BEACH, LLC

SECTION H: PERMIT TO CONSTRUCT AND TEMPORARY PERMIT TO OPERATE

The operator shall comply with the terms and conditions set forth below:

I298.5 This equipment shall not be operated unless the facility holds 39854 pounds of NOx RTCs in its allocation account to offset the annual emissions increase for the first year of operation. The RTCs held to satisfy the first year of operation portion of this condition may be transferred only after one year from the initial start of operation. In addition, this equipment shall not be operated unless the operator demonstrates to the Executive Officer that, at the commencement of each compliance year after the start of operation, the facility holds 62507 pounds of NOx RTCs valid during that compliance year. RTCs held to satisfy the compliance year portion of this condition may be transferred only after the compliance year for which the RTCs are held. If the initial or annual hold amount is partially satisfied by holding RTCs that expire midway through the hold period, those RTCs may be transferred upon their respective expiration dates. This hold amount is in addition to any other amount of RTCs required to be held under other condition(s) stated in this permit.

[RULE 2005, 6-3-2011]

[Devices subject to this condition : D124]

I298.6 This equipment shall not be operated unless the facility holds 39854 pounds of NOx RTCs in its allocation account to offset the annual emissions increase for the first year of operation. The RTCs held to satisfy the first year of operation portion of this condition may be transferred only after one year from the initial start of operation. In addition, this equipment shall not be operated unless the operator demonstrates to the Executive Officer that, at the commencement of each compliance year after the start of operation, the facility holds 62507 pounds of NOx RTCs valid during that compliance year. RTCs held to satisfy the compliance year portion of this condition may be transferred only after the compliance year for which the RTCs are held. If the initial or annual hold amount is partially satisfied by holding RTCs that expire midway through the hold period, those RTCs may be transferred upon their respective expiration dates. This hold amount is in addition to any other amount of RTCs required to be held under other condition(s) stated in this permit.

[RULE 2005, 6-3-2011]

[Devices subject to this condition : D133]

FACILITY PERMIT TO OPERATE AES HUNTINGTON BEACH, LLC

SECTION H: PERMIT TO CONSTRUCT AND TEMPORARY PERMIT TO OPERATE

The operator shall comply with the terms and conditions set forth below:

I298.7 This equipment shall not be operated unless the facility holds 39854 pounds of NOx RTCs in its allocation account to offset the annual emissions increase for the first year of operation. The RTCs held to satisfy the first year of operation portion of this condition may be transferred only after one year from the initial start of operation. In addition, this equipment shall not be operated unless the operator demonstrates to the Executive Officer that, at the commencement of each compliance year after the start of operation, the facility holds 62507 pounds of NOx RTCs valid during that compliance year. RTCs held to satisfy the compliance year portion of this condition may be transferred only after the compliance year for which the RTCs are held. If the initial or annual hold amount is partially satisfied by holding RTCs that expire midway through the hold period, those RTCs may be transferred upon their respective expiration dates. This hold amount is in addition to any other amount of RTCs required to be held under other condition(s) stated in this permit.

[RULE 2005, 6-3-2011]

[Devices subject to this condition : D142]

I298.8 This equipment shall not be operated unless the facility holds 39854 pounds of NOx RTCs in its allocation account to offset the annual emissions increase for the first year of operation. The RTCs held to satisfy the first year of operation portion of this condition may be transferred only after one year from the initial start of operation. In addition, this equipment shall not be operated unless the operator demonstrates to the Executive Officer that, at the commencement of each compliance year after the start of operation, the facility holds 62507 pounds of NOx RTCs valid during that compliance year. RTCs held to satisfy the compliance year portion of this condition may be transferred only after the compliance year for which the RTCs are held. If the initial or annual hold amount is partially satisfied by holding RTCs that expire midway through the hold period, those RTCs may be transferred upon their respective expiration dates. This hold amount is in addition to any other amount of RTCs required to be held under other condition(s) stated in this permit.

[RULE 2005, 6-3-2011]

[Devices subject to this condition : D151]

FACILITY PERMIT TO OPERATE AES HUNTINGTON BEACH, LLC

SECTION H: PERMIT TO CONSTRUCT AND TEMPORARY PERMIT TO OPERATE

The operator shall comply with the terms and conditions set forth below:

I298.9 This equipment shall not be operated unless the facility holds 39854 pounds of NOx RTCs in its allocation account to offset the annual emissions increase for the first year of operation. The RTCs held to satisfy the first year of operation portion of this condition may be transferred only after one year from the initial start of operation. In addition, this equipment shall not be operated unless the operator demonstrates to the Executive Officer that, at the commencement of each compliance year after the start of operation, the facility holds 62507 pounds of NOx RTCs valid during that compliance year. RTCs held to satisfy the compliance year portion of this condition may be transferred only after the compliance year for which the RTCs are held. If the initial or annual hold amount is partially satisfied by holding RTCs that expire midway through the hold period, those RTCs may be transferred upon their respective expiration dates. This hold amount is in addition to any other amount of RTCs required to be held under other condition(s) stated in this permit.

[RULE 2005, 6-3-2011]

[Devices subject to this condition : D160]

I298.10 This equipment shall not be operated unless the facility holds 2694 pounds of SOx RTCs in its allocation account to offset the annual emissions increase for the first year of operation. The RTCs held to satisfy the first year of operation portion of this condition may be transferred only after one year from the initial start of operation. In addition, this equipment shall not be operated unless the operator demonstrates to the Executive Officer that, at the commencement of each compliance year after the start of operation, the facility holds 3798 pounds of SOx RTCs valid during that compliance year. RTCs held to satisfy the compliance year portion of this condition may be transferred only after the compliance year for which the RTCs are held. If the initial or annual hold amount is partially satisfied by holding RTCs that expire midway through the hold period, those RTCs may be transferred upon their respective expiration dates. This hold amount is in addition to any other amount of RTCs required to be held under other condition(s) stated in this permit.

[RULE 2005, 6-3-2011]

[Devices subject to this condition : D124]

FACILITY PERMIT TO OPERATE AES HUNTINGTON BEACH, LLC

SECTION H: PERMIT TO CONSTRUCT AND TEMPORARY PERMIT TO OPERATE

The operator shall comply with the terms and conditions set forth below:

I298.11 This equipment shall not be operated unless the facility holds 2694 pounds of SO_x RTCs in its allocation account to offset the annual emissions increase for the first year of operation. The RTCs held to satisfy the first year of operation portion of this condition may be transferred only after one year from the initial start of operation. In addition, this equipment shall not be operated unless the operator demonstrates to the Executive Officer that, at the commencement of each compliance year after the start of operation, the facility holds 3798 pounds of SO_x RTCs valid during that compliance year. RTCs held to satisfy the compliance year portion of this condition may be transferred only after the compliance year for which the RTCs are held. If the initial or annual hold amount is partially satisfied by holding RTCs that expire midway through the hold period, those RTCs may be transferred upon their respective expiration dates. This hold amount is in addition to any other amount of RTCs required to be held under other condition(s) stated in this permit.

[RULE 2005, 6-3-2011]

[Devices subject to this condition : D133]

I298.12 This equipment shall not be operated unless the facility holds 2694 pounds of SO_x RTCs in its allocation account to offset the annual emissions increase for the first year of operation. The RTCs held to satisfy the first year of operation portion of this condition may be transferred only after one year from the initial start of operation. In addition, this equipment shall not be operated unless the operator demonstrates to the Executive Officer that, at the commencement of each compliance year after the start of operation, the facility holds 3798 pounds of SO_x RTCs valid during that compliance year. RTCs held to satisfy the compliance year portion of this condition may be transferred only after the compliance year for which the RTCs are held. If the initial or annual hold amount is partially satisfied by holding RTCs that expire midway through the hold period, those RTCs may be transferred upon their respective expiration dates. This hold amount is in addition to any other amount of RTCs required to be held under other condition(s) stated in this permit.

[RULE 2005, 6-3-2011]

[Devices subject to this condition : D142]

FACILITY PERMIT TO OPERATE AES HUNTINGTON BEACH, LLC

SECTION H: PERMIT TO CONSTRUCT AND TEMPORARY PERMIT TO OPERATE

The operator shall comply with the terms and conditions set forth below:

I298.13 This equipment shall not be operated unless the facility holds 2694 pounds of SOx RTCs in its allocation account to offset the annual emissions increase for the first year of operation. The RTCs held to satisfy the first year of operation portion of this condition may be transferred only after one year from the initial start of operation. In addition, this equipment shall not be operated unless the operator demonstrates to the Executive Officer that, at the commencement of each compliance year after the start of operation, the facility holds 3798 pounds of SOx RTCs valid during that compliance year. RTCs held to satisfy the compliance year portion of this condition may be transferred only after the compliance year for which the RTCs are held. If the initial or annual hold amount is partially satisfied by holding RTCs that expire midway through the hold period, those RTCs may be transferred upon their respective expiration dates. This hold amount is in addition to any other amount of RTCs required to be held under other condition(s) stated in this permit.

[RULE 2005, 6-3-2011]

[Devices subject to this condition : D151]

I298.14 This equipment shall not be operated unless the facility holds 2694 pounds of SOx RTCs in its allocation account to offset the annual emissions increase for the first year of operation. The RTCs held to satisfy the first year of operation portion of this condition may be transferred only after one year from the initial start of operation. In addition, this equipment shall not be operated unless the operator demonstrates to the Executive Officer that, at the commencement of each compliance year after the start of operation, the facility holds 3798 pounds of SOx RTCs valid during that compliance year. RTCs held to satisfy the compliance year portion of this condition may be transferred only after the compliance year for which the RTCs are held. If the initial or annual hold amount is partially satisfied by holding RTCs that expire midway through the hold period, those RTCs may be transferred upon their respective expiration dates. This hold amount is in addition to any other amount of RTCs required to be held under other condition(s) stated in this permit.

[RULE 2005, 6-3-2011]

[Devices subject to this condition : D160]

FACILITY PERMIT TO OPERATE AES HUNTINGTON BEACH, LLC

SECTION H: PERMIT TO CONSTRUCT AND TEMPORARY PERMIT TO OPERATE

The operator shall comply with the terms and conditions set forth below:

I298.15 This equipment shall not be operated unless the facility holds 13488 pounds of NOx RTCs in its allocation account to offset the annual emissions increase for the first year of operation. The RTCs held to satisfy the first year of operation portion of this condition may be transferred only after one year from the initial start of operation. In addition, this equipment shall not be operated unless the operator demonstrates to the Executive Officer that, at the commencement of each compliance year after the start of operation, the facility holds 21155 pounds of NOx RTCs valid during that compliance year. RTCs held to satisfy the compliance year portion of this condition may be transferred only after the compliance year for which the RTCs are held. If the initial or annual hold amount is partially satisfied by holding RTCs that expire midway through the hold period, those RTCs may be transferred upon their respective expiration dates. This hold amount is in addition to any other amount of RTCs required to be held under other condition(s) stated in this permit.

[RULE 2005, 6-3-2011]

[Devices subject to this condition : D128]

I298.16 This equipment shall not be operated unless the facility holds 13488 pounds of NOx RTCs in its allocation account to offset the annual emissions increase for the first year of operation. The RTCs held to satisfy the first year of operation portion of this condition may be transferred only after one year from the initial start of operation. In addition, this equipment shall not be operated unless the operator demonstrates to the Executive Officer that, at the commencement of each compliance year after the start of operation, the facility holds 21155 pounds of NOx RTCs valid during that compliance year. RTCs held to satisfy the compliance year portion of this condition may be transferred only after the compliance year for which the RTCs are held. If the initial or annual hold amount is partially satisfied by holding RTCs that expire midway through the hold period, those RTCs may be transferred upon their respective expiration dates. This hold amount is in addition to any other amount of RTCs required to be held under other condition(s) stated in this permit.

[RULE 2005, 6-3-2011]

[Devices subject to this condition : D137]

FACILITY PERMIT TO OPERATE AES HUNTINGTON BEACH, LLC

SECTION H: PERMIT TO CONSTRUCT AND TEMPORARY PERMIT TO OPERATE

The operator shall comply with the terms and conditions set forth below:

I298.17 This equipment shall not be operated unless the facility holds 13488 pounds of NOx RTCs in its allocation account to offset the annual emissions increase for the first year of operation. The RTCs held to satisfy the first year of operation portion of this condition may be transferred only after one year from the initial start of operation. In addition, this equipment shall not be operated unless the operator demonstrates to the Executive Officer that, at the commencement of each compliance year after the start of operation, the facility holds 21155 pounds of NOx RTCs valid during that compliance year. RTCs held to satisfy the compliance year portion of this condition may be transferred only after the compliance year for which the RTCs are held. If the initial or annual hold amount is partially satisfied by holding RTCs that expire midway through the hold period, those RTCs may be transferred upon their respective expiration dates. This hold amount is in addition to any other amount of RTCs required to be held under other condition(s) stated in this permit.

[RULE 2005, 6-3-2011]

[Devices subject to this condition : D146]

I298.18 This equipment shall not be operated unless the facility holds 13488 pounds of NOx RTCs in its allocation account to offset the annual emissions increase for the first year of operation. The RTCs held to satisfy the first year of operation portion of this condition may be transferred only after one year from the initial start of operation. In addition, this equipment shall not be operated unless the operator demonstrates to the Executive Officer that, at the commencement of each compliance year after the start of operation, the facility holds 21155 pounds of NOx RTCs valid during that compliance year. RTCs held to satisfy the compliance year portion of this condition may be transferred only after the compliance year for which the RTCs are held. If the initial or annual hold amount is partially satisfied by holding RTCs that expire midway through the hold period, those RTCs may be transferred upon their respective expiration dates. This hold amount is in addition to any other amount of RTCs required to be held under other condition(s) stated in this permit.

[RULE 2005, 6-3-2011]

[Devices subject to this condition : D155]

FACILITY PERMIT TO OPERATE AES HUNTINGTON BEACH, LLC

SECTION H: PERMIT TO CONSTRUCT AND TEMPORARY PERMIT TO OPERATE

The operator shall comply with the terms and conditions set forth below:

I298.19 This equipment shall not be operated unless the facility holds 13488 pounds of NOx RTCs in its allocation account to offset the annual emissions increase for the first year of operation. The RTCs held to satisfy the first year of operation portion of this condition may be transferred only after one year from the initial start of operation. In addition, this equipment shall not be operated unless the operator demonstrates to the Executive Officer that, at the commencement of each compliance year after the start of operation, the facility holds 21155 pounds of NOx RTCs valid during that compliance year. RTCs held to satisfy the compliance year portion of this condition may be transferred only after the compliance year for which the RTCs are held. If the initial or annual hold amount is partially satisfied by holding RTCs that expire midway through the hold period, those RTCs may be transferred upon their respective expiration dates. This hold amount is in addition to any other amount of RTCs required to be held under other condition(s) stated in this permit.

[RULE 2005, 6-3-2011]

[Devices subject to this condition : D164]

I298.20 This equipment shall not be operated unless the facility holds 912 pounds of SOx RTCs in its allocation account to offset the annual emissions increase for the first year of operation. The RTCs held to satisfy the first year of operation portion of this condition may be transferred only after one year from the initial start of operation. In addition, this equipment shall not be operated unless the operator demonstrates to the Executive Officer that, at the commencement of each compliance year after the start of operation, the facility holds 1286 pounds of SOx RTCs valid during that compliance year. RTCs held to satisfy the compliance year portion of this condition may be transferred only after the compliance year for which the RTCs are held. If the initial or annual hold amount is partially satisfied by holding RTCs that expire midway through the hold period, those RTCs may be transferred upon their respective expiration dates. This hold amount is in addition to any other amount of RTCs required to be held under other condition(s) stated in this permit.

[RULE 2005, 6-3-2011]

[Devices subject to this condition : D128]

FACILITY PERMIT TO OPERATE AES HUNTINGTON BEACH, LLC

SECTION H: PERMIT TO CONSTRUCT AND TEMPORARY PERMIT TO OPERATE

The operator shall comply with the terms and conditions set forth below:

I298.21 This equipment shall not be operated unless the facility holds 912 pounds of SOx RTCs in its allocation account to offset the annual emissions increase for the first year of operation. The RTCs held to satisfy the first year of operation portion of this condition may be transferred only after one year from the initial start of operation. In addition, this equipment shall not be operated unless the operator demonstrates to the Executive Officer that, at the commencement of each compliance year after the start of operation, the facility holds 1286 pounds of SOx RTCs valid during that compliance year. RTCs held to satisfy the compliance year portion of this condition may be transferred only after the compliance year for which the RTCs are held. If the initial or annual hold amount is partially satisfied by holding RTCs that expire midway through the hold period, those RTCs may be transferred upon their respective expiration dates. This hold amount is in addition to any other amount of RTCs required to be held under other condition(s) stated in this permit.

[RULE 2005, 6-3-2011]

[Devices subject to this condition : D137]

I298.22 This equipment shall not be operated unless the facility holds 912 pounds of SOx RTCs in its allocation account to offset the annual emissions increase for the first year of operation. The RTCs held to satisfy the first year of operation portion of this condition may be transferred only after one year from the initial start of operation. In addition, this equipment shall not be operated unless the operator demonstrates to the Executive Officer that, at the commencement of each compliance year after the start of operation, the facility holds 1286 pounds of SOx RTCs valid during that compliance year. RTCs held to satisfy the compliance year portion of this condition may be transferred only after the compliance year for which the RTCs are held. If the initial or annual hold amount is partially satisfied by holding RTCs that expire midway through the hold period, those RTCs may be transferred upon their respective expiration dates. This hold amount is in addition to any other amount of RTCs required to be held under other condition(s) stated in this permit.

[RULE 2005, 6-3-2011]

[Devices subject to this condition : D146]

FACILITY PERMIT TO OPERATE AES HUNTINGTON BEACH, LLC

SECTION H: PERMIT TO CONSTRUCT AND TEMPORARY PERMIT TO OPERATE

The operator shall comply with the terms and conditions set forth below:

I298.23 This equipment shall not be operated unless the facility holds 912 pounds of SOx RTCs in its allocation account to offset the annual emissions increase for the first year of operation. The RTCs held to satisfy the first year of operation portion of this condition may be transferred only after one year from the initial start of operation. In addition, this equipment shall not be operated unless the operator demonstrates to the Executive Officer that, at the commencement of each compliance year after the start of operation, the facility holds 1286 pounds of SOx RTCs valid during that compliance year. RTCs held to satisfy the compliance year portion of this condition may be transferred only after the compliance year for which the RTCs are held. If the initial or annual hold amount is partially satisfied by holding RTCs that expire midway through the hold period, those RTCs may be transferred upon their respective expiration dates. This hold amount is in addition to any other amount of RTCs required to be held under other condition(s) stated in this permit.

[RULE 2005, 6-3-2011]

[Devices subject to this condition : D155]

I298.24 This equipment shall not be operated unless the facility holds 912 pounds of SOx RTCs in its allocation account to offset the annual emissions increase for the first year of operation. The RTCs held to satisfy the first year of operation portion of this condition may be transferred only after one year from the initial start of operation. In addition, this equipment shall not be operated unless the operator demonstrates to the Executive Officer that, at the commencement of each compliance year after the start of operation, the facility holds 1286 pounds of SOx RTCs valid during that compliance year. RTCs held to satisfy the compliance year portion of this condition may be transferred only after the compliance year for which the RTCs are held. If the initial or annual hold amount is partially satisfied by holding RTCs that expire midway through the hold period, those RTCs may be transferred upon their respective expiration dates. This hold amount is in addition to any other amount of RTCs required to be held under other condition(s) stated in this permit.

[RULE 2005, 6-3-2011]

[Devices subject to this condition : D164]

FACILITY PERMIT TO OPERATE AES HUNTINGTON BEACH, LLC

SECTION H: PERMIT TO CONSTRUCT AND TEMPORARY PERMIT TO OPERATE

The operator shall comply with the terms and conditions set forth below:

K. Record Keeping/Reporting

K40.3 The operator shall provide to the District a source test report in accordance with the following specifications:

Source test results shall be submitted to the District no later than 60 days after the source tests required under conditions D29.1, D29.2, and D29.3 are conducted

Emission data shall be expressed in terms of concentration (ppmv) corrected to 15 percent oxygen (dry basis), mass rate (lb/hr), and lb/MMCF. In addition, solid PM emissions, if required to be tested, shall also be reported in terms of grains/DSCF

All exhaust flow rate shall be expressed in terms of dry standard cubic feet per minute (DSCFM) and dry actual cubic feet per minute. All moisture concentration shall be expressed in terms of percent corrected to 15 percent oxygen

Source test results shall also include the oxygen levels in the exhaust, fuel flow rate (CFH), the flue gas temperature, and the generator power output (MW) under which the test was conducted

[RULE 1303(a)(1)-BACT, 5-10-1996; RULE 1303(a)(1)-BACT, 12-6-2002; RULE 1303(b)(2)-Offset, 5-10-1996; RULE 1303(b)(2)-Offset, 12-6-2002]

[Devices subject to this condition : D115, D124, D133, D142, D151, D160]

K67.5 The operator shall keep records, in a manner approved by the District, for the following parameter(s) or item(s):

FACILITY PERMIT TO OPERATE AES HUNTINGTON BEACH, LLC

SECTION H: PERMIT TO CONSTRUCT AND TEMPORARY PERMIT TO OPERATE

The operator shall comply with the terms and conditions set forth below:

Commissioning hours and type of control and fuel use

Date, time, and duration of each start-up and shutdown, and the type of start up (cold, warm, or hot)

In addition to the requirements of a certified CEMS, natural gas fuel use records shall be kept during and after the commissioning period and prior to CEMS certification

Minute by minute data (NO₂ and O₂ concentration and fuel flow rate at a minimum) for each turbine start up

Monthly number of hours each turbine is operated with duct firing

Total annual power output in MWh

[RULE 1303(b)(2)-Offset, 5-10-1996; RULE 1303(b)(2)-Offset, 12-6-2002]

[Devices subject to this condition : D115, D124, D133, D142, D151, D160]

