

DOCKETED	
Docket Number:	19-IEPR-03
Project Title:	Electricity and Natural Gas Demand Forecast
TN #:	230886
Document Title:	BTM Energy Storage Forecast
Description:	CED 2019 Revised Forecast by Sudhakar Konala
Filer:	Raquel Kravitz
Organization:	California Energy Commission
Submitter Role:	Commission Staff
Submission Date:	11/27/2019 1:04:28 PM
Docketed Date:	12/2/2019

BTM Energy Storage Forecast

CED 2019 Revised Forecast



Sudhakar Konala
California Energy Commission
December 2, 2019



Overview

- **Objective:** Describe the methodology used in the Energy Commission's behind-the-meter (BTM) energy storage forecast.

- **Methodology** for energy storage:
 1. Methodology for calculating historical storage adoption
 2. Methodology for forecasting storage adoption
 3. Methodology for estimating energy consumption due to storage
 - includes hourly charge and discharge behavior

Methodology for Calculating Historical Storage Adoption






Source of Energy Storage Data

Self-Generation Incentive Program (SGIP)


- Publishes list of distributed generation systems that apply for incentives
- Since 2016, over 15,000 applications for BTM energy storage projects;
 - Only 24 applications for all other technologies
 - SGIP effectively an energy storage incentive program
- Link: www.selfgenca.com/documents/reports/statewide_projects

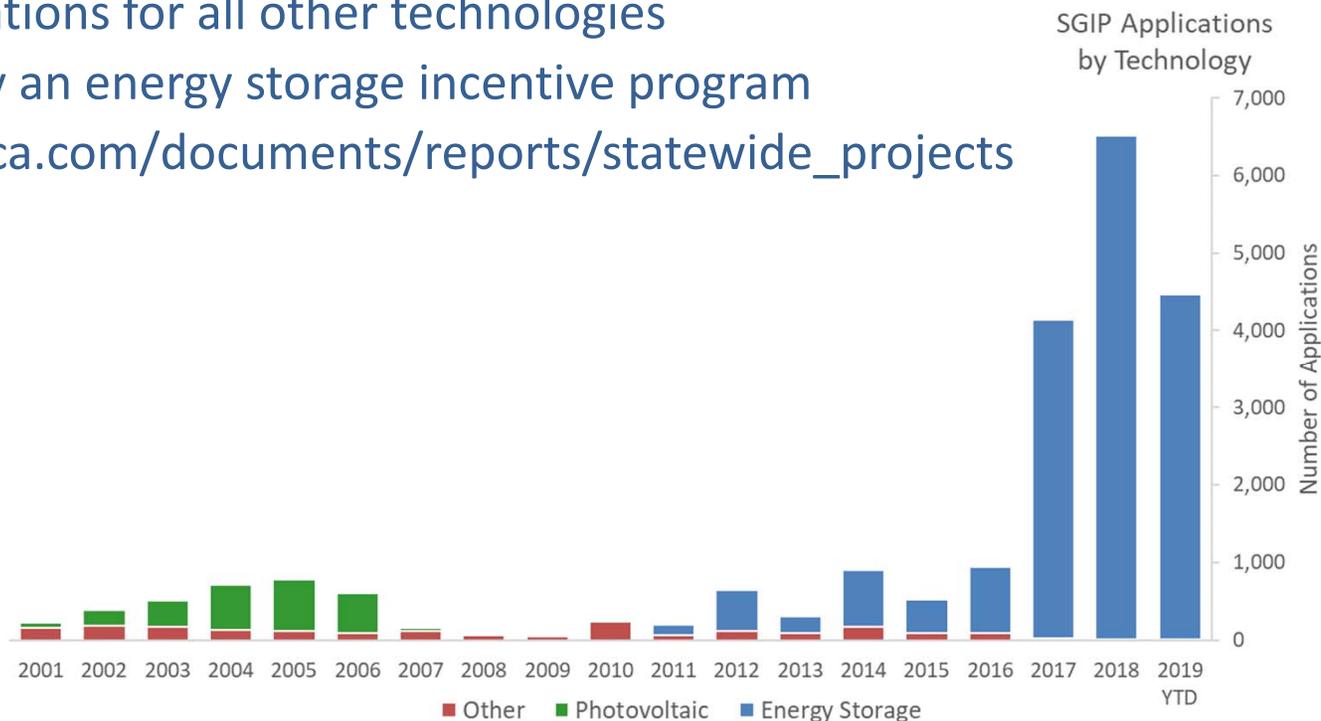

Source: California Energy Commission analysis of SGIP Weekly Statewide Report (10/21/2019)



Estimating Installed Storage

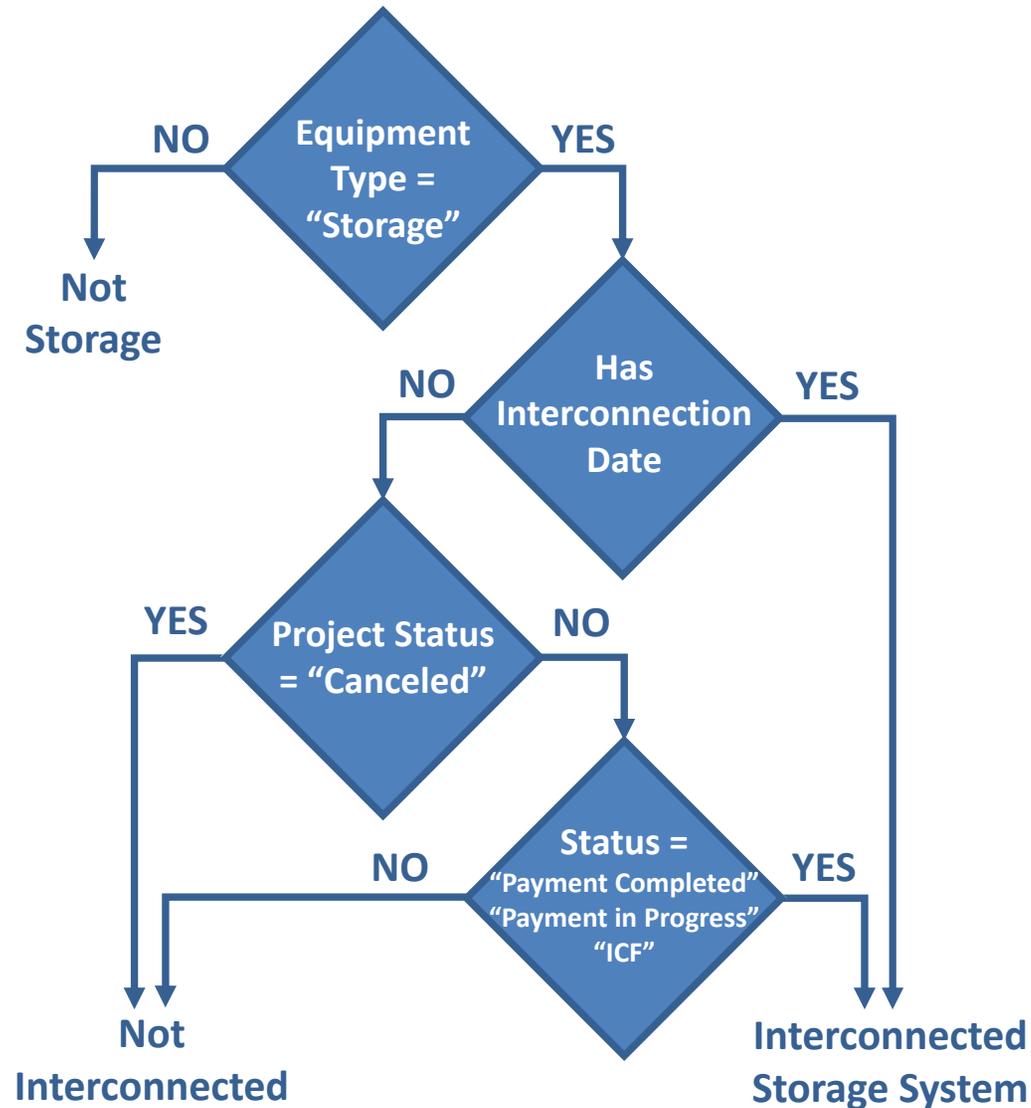




Energy Storage Data

Year	Installed		Likely Installed*		Total	
	Count	Capacity (kW)	Count	Capacity (kW)	Count	Capacity (kW)
Pre 2011	2	19			2	19
2011	3	1,040			3	1,040
2012	3	24	1	600	4	624
2013	38	1,606			38	1,606
2014	255	5,134	1	18	256	5,152
2015	343	25,422	21	153	364	25,575
2016	174	27,540	14	1,604	188	29,144
2017	825	29,173	139	11,059	964	40,232
2018	4,726	75,229	351	26,161	5,077	101,390
2019 YTD	2,681	42,248	834	20,836	3,515	63,083
Total	9,050	207,435	1,361	60,430	10,411	267,865


* Based on SGIP Incentive Status

- Approximately another 108,000 kW of energy storage is in the SGIP application queue.

Energy Storage Capacity by Sector

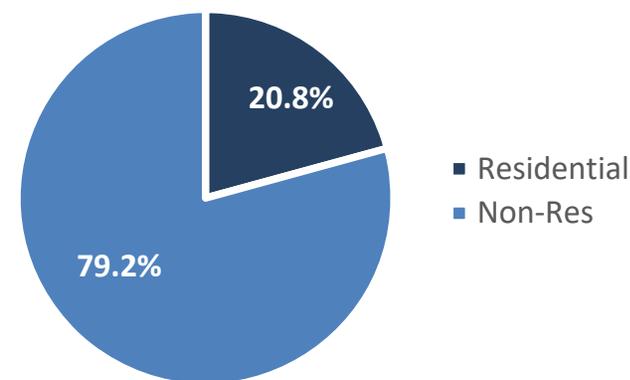

Number of Installed Systems by Sector

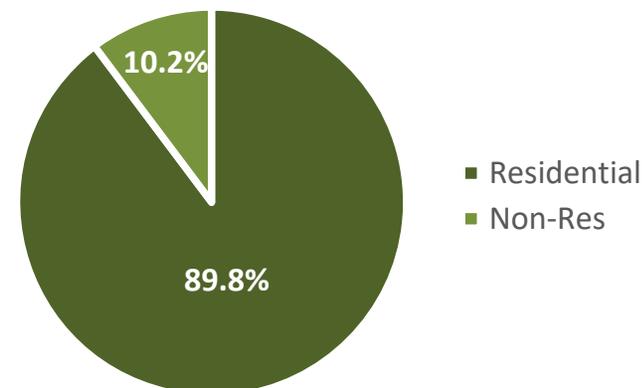

Source: California Energy Commission analysis of SGIP Weekly Statewide Report (10/21/2019)

Methodology for Forecasting Storage Adoption





Approach to Forecasting Storage

- Continue to use trend / time series analysis, but with some changes
- Observations:

% of Energy Storage Rated Capacity (kW) by System Classification and Sector		
Classification	Residential	Non-Residential
Solar + Storage	96.6%	32.6%
Solar + Other	0.2%	4.0%
Stand Alone Storage	3.1%	63.4%

Source: California Energy Commission analysis of SGIP Weekly Statewide Report (10/21/2019)

- **Non-residential sector:** most storage systems are stand alone.
 - **Residential sector:** nearly all systems are paired with PV.
- Applied different methodology for residential and non-residential storage adoption forecasts due to different observed characteristics.



Non-Residential Adoption Forecast

- Continue to base forecast on historical trend.
 - Most non-res storage systems are stand alone
 - Number of installations and system size can fluctuate from year to year
- Methodology for Trend Analysis:
 - *Capacity added in future year_(MW) = average of (2018 capacity_(MW) + 2019 capacity_(MW) + (SGIP program queue_(MW)) x (likelihood of installation))*
- SGIP gives some visibility into the storage project pipeline.





Residential Adoption Forecast


- Three adoption scenarios for residential storage
 - High energy demand (low storage adoption)
 - Continue to use historical trend just like non-res storage forecast.
 - Low energy demand (high storage adoption)
 - Residential storage adoption linked to PV capacity
 - Mid energy demand – average of high and low
- Low scenario methodology:
 - $Adoption\ rate = \frac{Energy\ storage\ capacity\ added\ in\ 2018(MW)}{Total\ installed\ PV\ Capacity\ (MW)}$
 - $Storage\ adoption_{(year,MW)} = forecast\ of\ PV\ capacity_{(year,MW)} \times adoption\ rate$
- Result: 3.4 times more storage capacity in low scenario vs. high by 2030.



Summary

Energy Storage Forecast

Approach for Forecasting Energy Storage Adoption (by Sector and Scenario)		
Scenario	Residential	Non-Res
High Demand	Trend Analysis	Trend Analysis
Low Demand	% of PV capacity	
Mid Demand	Avg. of High/Low	

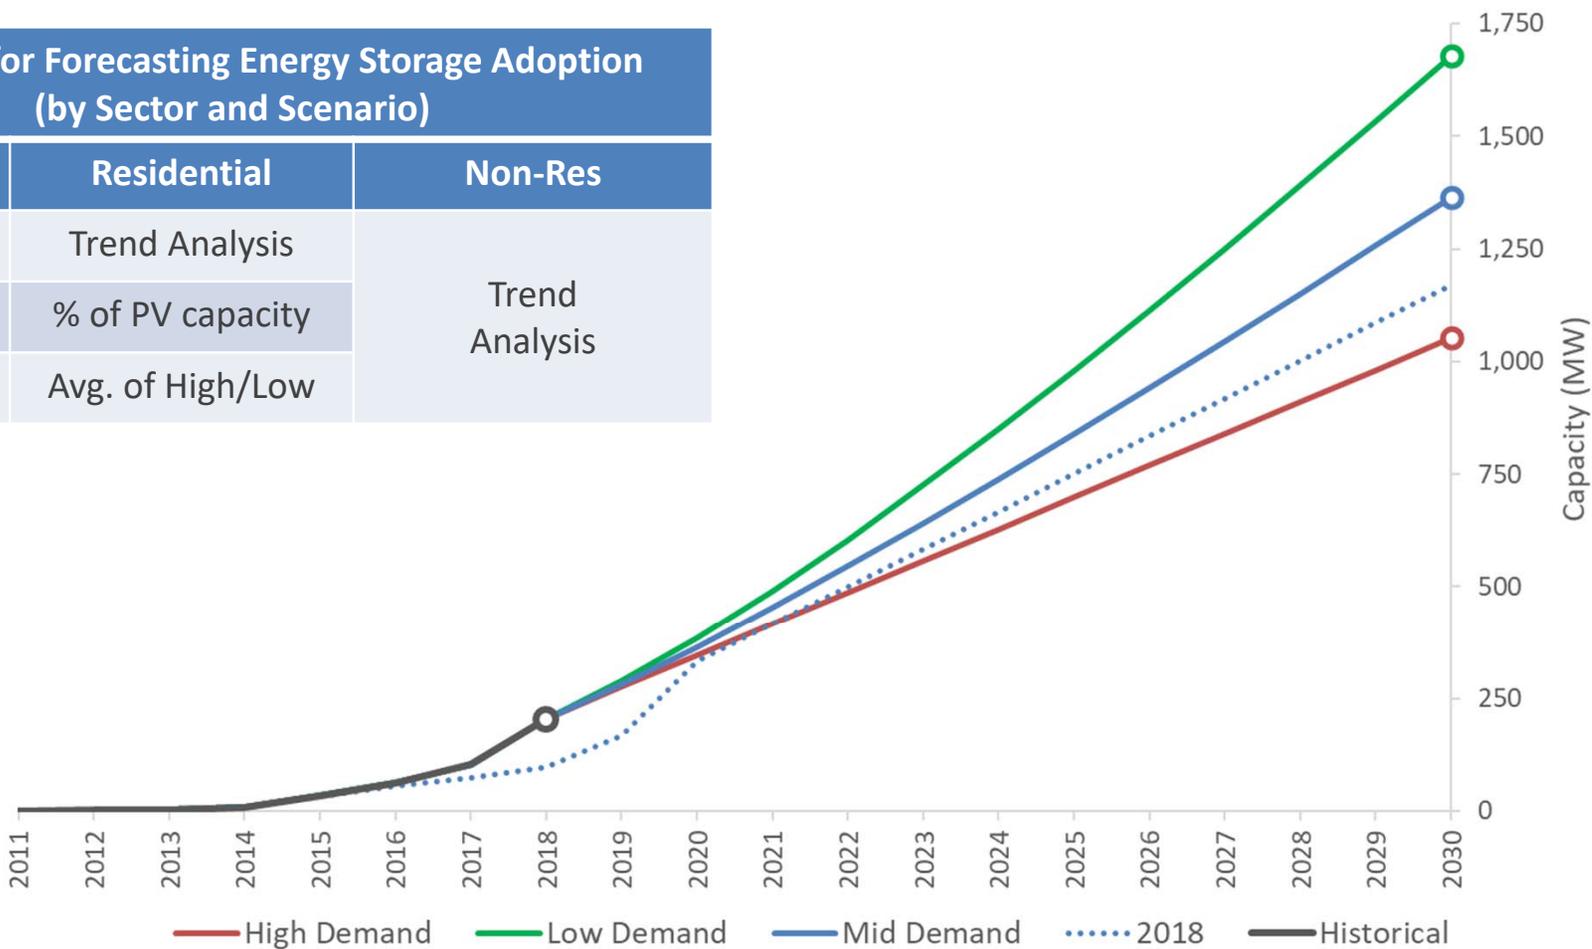

Forecasting Energy Consumption from Storage






Hourly Storage Forecast

- For CED 2019 revised, developed hourly forecast for energy storage.
 - Better account for effect during peak demand
- *Annual energy consumption_{storage} = \sum Hourly consumption_{storage}*
- Like storage adoption, staff used differing approaches for forecasting hourly energy consumption for residential and non-residential sectors.
 - Due to availability of data



Non-Res Hourly Storage Forecast

- For non-residential sector, used charge / discharge profiles published in 2017 SGIP Storage Impact Evaluation.
- Report has observed charge / discharge profiles for different non-res building types
 - Industrial, food / liquor, hotel, retail, school, other
 - By system size (< 30 kW, 30 kW or greater)
 - Sample size: 150
- Profiles are published by month and hour
 - Profiles are statewide, not utility specific
- Average hourly charge / discharge (in kW) per rebated capacity (in kW)

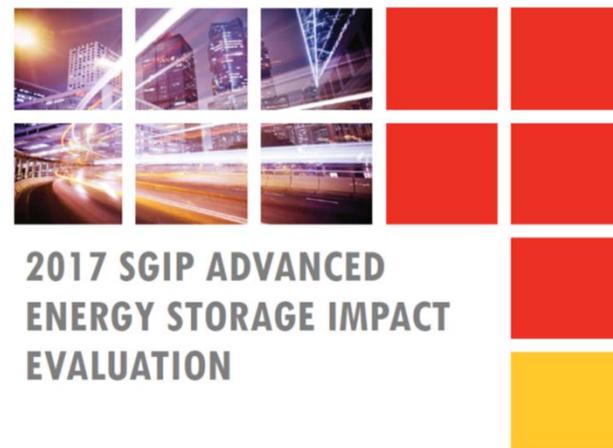



Non-Res Hourly Storage Forecast

- Applied hourly charge / discharge profiles to forecast of storage capacity to get hourly storage charge and discharge information.
- Non-res systems mainly used to reduce demand charges

FIGURE 4-30: AVERAGE HOURLY DISCHARGE (KW) PER REBATED CAPACITY (KW) FOR ALL NONRES PROJECTS

Hour	Jan 1	Feb 2	Mar 3	Apr 4	May 5	Jun 6	Jul 7	Aug 8	Sep 9	Oct 10	Nov 11	Dec 12
0	0.015	0.012	0.009	0.020	0.022	0.024	0.028	0.037	0.040	0.039	0.035	0.033
1	0.021	0.019	0.008	0.011	0.014	0.015	0.018	0.029	0.032	0.031	0.037	0.038
2	0.009	0.009	0.003	0.010	0.012	0.014	0.018	0.030	0.033	0.032	0.032	0.031
3	0.009	0.008	0.003	0.011	0.013	0.014	0.018	0.030	0.033	0.033	0.034	0.034
4	0.009	0.009	0.004	0.005	0.005	0.004	0.011	0.014	0.017	0.016	0.032	0.035
5	0.012	0.012	0.009	0.009	0.010	0.008	0.014	0.018	0.018	0.021	0.019	0.016
6	0.026	0.021	0.017	0.016	0.018	0.017	0.019	0.024	0.024	0.023	0.024	0.020
7	0.032	0.025	0.023	0.021	0.020	0.018	0.020	0.024	0.024	0.021	0.024	0.023
8	0.031	0.029	0.031	0.030	0.027	0.025	0.026	0.031	0.031	0.028	0.023	0.021
9	0.042	0.040	0.038	0.034	0.033	0.032	0.033	0.037	0.034	0.034	0.030	0.026
10	0.042	0.042	0.045	0.035	0.044	0.045	0.044	0.053	0.039	0.043	0.034	0.028
11	0.040	0.041	0.049	0.039	0.054	0.054	0.048	0.063	0.048	0.054	0.038	0.031
12	0.039	0.042	0.051	0.043	0.055	0.056	0.049	0.065	0.049	0.059	0.041	0.033
13	0.039	0.043	0.052	0.042	0.051	0.053	0.048	0.061	0.046	0.056	0.043	0.036
14	0.037	0.041	0.046	0.036	0.052	0.060	0.058	0.065	0.054	0.054	0.038	0.036
15	0.034	0.039	0.044	0.037	0.052	0.061	0.058	0.065	0.059	0.050	0.035	0.033
16	0.036	0.040	0.056	0.061	0.053	0.068	0.064	0.069	0.062	0.051	0.037	0.045
17	0.067	0.070	0.072	0.061	0.037	0.035	0.032	0.035	0.035	0.049	0.066	0.048
18	0.076	0.077	0.089	0.078	0.043	0.035	0.038	0.042	0.045	0.053	0.062	0.051
19	0.091	0.091	0.080	0.066	0.049	0.040	0.048	0.046	0.047	0.053	0.062	0.056
20	0.084	0.082	0.049	0.036	0.031	0.029	0.034	0.034	0.036	0.034	0.047	0.054
21	0.051	0.047	0.024	0.025	0.033	0.034	0.037	0.050	0.049	0.047	0.032	0.028
22	0.015	0.015	0.012	0.026	0.029	0.030	0.036	0.050	0.045	0.047	0.042	0.039
23	0.027	0.022	0.008	0.013	0.015	0.017	0.022	0.034	0.033	0.033	0.043	0.043

FIGURE 4-31: AVERAGE HOURLY CHARGE (KW) PER REBATED CAPACITY (KW) FOR ALL NONRES PROJECTS

Hour	Jan 1	Feb 2	Mar 3	Apr 4	May 5	Jun 6	Jul 7	Aug 8	Sep 9	Oct 10	Nov 11	Dec 12
0	-0.115	-0.109	-0.093	-0.095	-0.094	-0.097	-0.099	-0.113	-0.116	-0.104	-0.108	-0.101
1	-0.111	-0.105	-0.076	-0.072	-0.069	-0.073	-0.075	-0.091	-0.090	-0.079	-0.097	-0.094
2	-0.081	-0.077	-0.056	-0.055	-0.052	-0.055	-0.057	-0.069	-0.070	-0.066	-0.075	-0.073
3	-0.061	-0.058	-0.042	-0.044	-0.042	-0.043	-0.045	-0.058	-0.060	-0.058	-0.061	-0.059
4	-0.047	-0.046	-0.033	-0.033	-0.035	-0.034	-0.036	-0.045	-0.049	-0.047	-0.054	-0.054
5	-0.037	-0.037	-0.026	-0.024	-0.026	-0.023	-0.026	-0.030	-0.034	-0.031	-0.042	-0.043
6	-0.032	-0.032	-0.024	-0.025	-0.026	-0.023	-0.027	-0.028	-0.030	-0.032	-0.031	-0.030
7	-0.033	-0.030	-0.030	-0.025	-0.025	-0.024	-0.026	-0.026	-0.027	-0.028	-0.032	-0.031
8	-0.031	-0.032	-0.040	-0.035	-0.033	-0.030	-0.035	-0.039	-0.038	-0.039	-0.032	-0.029
9	-0.043	-0.044	-0.042	-0.033	-0.034	-0.031	-0.035	-0.041	-0.036	-0.038	-0.041	-0.037
10	-0.045	-0.044	-0.041	-0.035	-0.034	-0.034	-0.037	-0.041	-0.039	-0.039	-0.038	-0.038
11	-0.047	-0.043	-0.042	-0.033	-0.034	-0.037	-0.040	-0.041	-0.039	-0.040	-0.039	-0.038
12	-0.044	-0.040	-0.042	-0.033	-0.034	-0.037	-0.039	-0.042	-0.039	-0.039	-0.040	-0.034
13	-0.041	-0.040	-0.041	-0.036	-0.039	-0.041	-0.042	-0.049	-0.044	-0.045	-0.042	-0.033
14	-0.041	-0.041	-0.045	-0.037	-0.043	-0.044	-0.043	-0.054	-0.045	-0.049	-0.044	-0.034
15	-0.043	-0.042	-0.050	-0.043	-0.045	-0.046	-0.042	-0.058	-0.046	-0.053	-0.044	-0.037
16	-0.042	-0.046	-0.049	-0.037	-0.046	-0.045	-0.041	-0.059	-0.044	-0.056	-0.039	-0.036
17	-0.035	-0.038	-0.048	-0.045	-0.051	-0.057	-0.055	-0.069	-0.049	-0.056	-0.034	-0.036
18	-0.040	-0.042	-0.048	-0.040	-0.043	-0.052	-0.048	-0.054	-0.041	-0.047	-0.038	-0.037
19	-0.043	-0.044	-0.056	-0.053	-0.036	-0.045	-0.039	-0.046	-0.037	-0.041	-0.044	-0.036
20	-0.055	-0.061	-0.047	-0.039	-0.038	-0.036	-0.037	-0.040	-0.036	-0.041	-0.064	-0.033
21	-0.051	-0.051	-0.070	-0.091	-0.092	-0.087	-0.091	-0.101	-0.095	-0.107	-0.058	-0.052
22	-0.104	-0.098	-0.082	-0.083	-0.089	-0.089	-0.088	-0.107	-0.109	-0.101	-0.101	-0.096
23	-0.086	-0.083	-0.089	-0.102	-0.104	-0.102	-0.106	-0.125	-0.122	-0.117	-0.098	-0.086

Image from 2017 SGIP Advanced Storage Energy Storage Impact Evaluation



Residential Hourly Storage Forecast

- For residential sector, SGIP Storage Impact Evaluation was not used.
 - Limited sample size, all on tiered (and not TOU) rates
 - Profiles unlikely to reflect the way the residential storage systems would be deployed
- Staff used the System Advisor Model (SAM) for modeling residential storage
 - SAM is able to model battery storage when coupled with a PV system
 - Provides hourly charge and discharge profiles
 - Developed by National Renewable Energy Laboratory
 - <https://sam.nrel.gov/>
- Approach: Model a single battery, then scale it to installed capacity.





Modeling Residential Storage in SAM

- Must specify PV system and Battery characteristics in SAM.
- PV: modeled 6 kW AC system
 - Avg. statewide system size ~5.8 kW
- Battery: modeled Tesla Powerwall
 - Tesla has over 50% market share in residential sector
 - Specs: 13.5 kWh capacity, 5 kW rated power
 - Observed avg. residential battery size: 13.6 kWh, 12.9 kWh, 13.5 kWh in 2017, 2018, and 2019 respectively according to analysis of SGIP data
 - Limitation: could not incorporate Li-ion battery self-discharge



Modeling Residential Storage in SAM

- 1 | Select PV system and battery characteristics
- 2 | Select a region within each utility service territory
 - Staff modeled 32 different regions across the state
 - Capture regional variance in solar production (and thus battery charging)
- 3 | Used default hourly household electricity load profiles in SAM
 - Annual household consumption adjusted to match for each forecast zone.
- 4 | Input utility rates and rate structures
- 5 | Specify battery charging and discharging behavior



Charge / Discharge Behavior

- Used “Manual Dispatch Model” with in SAM’s battery storage module.
- Meet all incentive requirements
 - **Federal Incentive Tax Credit:** Battery must charge from solar / renewables
 - **SGIP Program Requirement:** battery must fully charge and discharge at least 52 times, or 687 kWh, per year
- Assume customers maximize bill savings
 - Battery charged and discharged in a way that maximizes bill savings
 - Charge during daytime using solar
 - Discharge only during hours which make sense financially
- Minimum State of Charge
 - Battery does not discharge below 20% (reserved for backup power)
 - Consistent with deployment of battery storage systems



Discharge Behavior – PG&E

- Battery allowed to discharge in summer months during peak hours
 - PG&E TOU rate difference between peak / off-peak winter months only ~1.5 cents
 - Estimated full charge / discharge cycles: 72 – 90

PG&E - Battery Discharge Rules

	12 am	1 am	2 am	3 am	4 am	5 am	6 am	7 am	8 am	9 am	10 am	11 am	12 pm	1 pm	2 pm	3 pm	4 pm	5 pm	6 pm	7 pm	8 pm	9 pm	10 pm	11 pm
Jan	Not Allowed																							
Feb	Not Allowed																							
Mar	Not Allowed																							
Apr	Not Allowed																							
May	Not Allowed																							
Jun	Not Allowed	Allowed	Allowed	Allowed	Allowed	Allowed	Not Allowed	Not Allowed	Not Allowed															
Jul	Not Allowed	Allowed	Allowed	Allowed	Allowed	Allowed	Not Allowed	Not Allowed	Not Allowed															
Aug	Not Allowed	Allowed	Allowed	Allowed	Allowed	Allowed	Not Allowed	Not Allowed	Not Allowed															
Sep	Not Allowed	Allowed	Allowed	Allowed	Allowed	Allowed	Not Allowed	Not Allowed	Not Allowed															
Oct	Not Allowed																							
Nov	Not Allowed																							
Dec	Not Allowed																							

 Discharge Allowed

 Discharge Not Allowed

Note: Battery can only charge using PV System



Discharge Behavior - SCE

- Battery allowed to discharge year round
 - SCE TOU rate structure incentivizes arbitrage during winter months
 - Estimated full charge / discharge cycles: ~ 250

SCE - Battery Discharge Rules

	12 am	1 am	2 am	3 am	4 am	5 am	6 am	7 am	8 am	9 am	10 am	11 am	12 pm	1 pm	2 pm	3 pm	4 pm	5 pm	6 pm	7 pm	8 pm	9 pm	10 pm	11 pm
Jan	Green	Red	Red	Red	Red	Red	Red	Red	Red	Green														
Feb	Green	Red	Red	Red	Red	Red	Red	Red	Red	Green														
Mar	Green	Red	Red	Red	Red	Red	Red	Red	Red	Green														
Apr	Green	Red	Red	Red	Red	Red	Red	Red	Red	Green														
May	Green	Red	Red	Red	Red	Red	Red	Red	Red	Green														
Jun	Red	Red	Red	Red	Red	Red	Red	Red	Red	Green	Green	Green	Green	Green	Red	Red	Red							
Jul	Red	Red	Red	Red	Red	Red	Red	Red	Red	Green	Green	Green	Green	Green	Red	Red	Red							
Aug	Red	Red	Red	Red	Red	Red	Red	Red	Red	Green	Green	Green	Green	Green	Red	Red	Red							
Sep	Red	Red	Red	Red	Red	Red	Red	Red	Red	Green	Green	Green	Green	Green	Red	Red	Red							
Oct	Green	Red	Red	Red	Red	Red	Red	Red	Red	Green														
Nov	Green	Red	Red	Red	Red	Red	Red	Red	Red	Green														
Dec	Green	Red	Red	Red	Red	Red	Red	Red	Red	Green														

Note: Battery can only charge using PV System

Oct to May

17¢	29¢	28¢
8am	4pm	9pm
☀️	☀️	🌙

June to Sept

Weekdays

22¢	41¢	22¢
8am	4pm	9pm
☀️	☀️	🌙

Weekends

22¢	27¢	22¢
8am	4pm	9pm
☀️	☀️	🌙

Discharge Allowed

Discharge Not Allowed




Discharge Behavior SDG&E

- Battery allowed to discharge during peak hours in summer months
 - Small TOU rate difference between peak / off-peak in winter months
 - Estimated full charge / discharge cycles: ~100

SDG&E - Battery Discharge Rules

	12 am	1 am	2 am	3 am	4 am	5 am	6 am	7 am	8 am	9 am	10 am	11 am	12 pm	1 pm	2 pm	3 pm	4 pm	5 pm	6 pm	7 pm	8 pm	9 pm	10 pm	11 pm
Jan	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red
Feb	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red
Mar	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red
Apr	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red
May	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red
Jun	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Green							
Jul	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Green							
Aug	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Green							
Sep	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Green							
Oct	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Green							
Nov	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red
Dec	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red	Red

Note: Battery can only charge using PV System

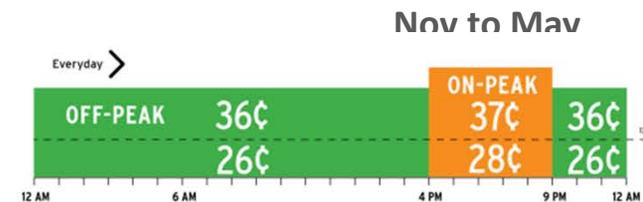

Discharge Allowed (Green)

Discharge Not Allowed (Red)



Modeling Residential Storage – Final Steps

6 | Run SAM

- SAM generates hourly charging and discharge data for 5kW/13.5 kWh battery

7 | Convert SAM hourly charge / discharge data for Powerwall to charge / discharge profiles per kW of rated capacity

8 | Combine charge / discharge profiles for 32 regions to create charge / discharge profiles for PG&E, SCE, and SDG&E

9 | For each forecast zone, apply per kW charge / discharge profiles to forecast of energy storage capacity (in MW)

- Hourly forecast for energy storage for the residential storage systems



Next Steps

- Energy storage forecast will continue to evolve.
- Expect incremental improvements over time including:
 - More data on charge / discharge behavior of battery systems
 - Changes to methodology as more data becomes available