

DOCKETED

Docket Number:	01-AFC-25C
Project Title:	Malburg Generating Station-Compliance
TN #:	232122
Document Title:	Quarterly Compliance Report Q4 2019
Description:	Quarterly Air Quality Compliance Report For Fourth Quarter 2019
Filer:	Anwar Ali
Organization:	Bicent (California) Malburg LLC
Submitter Role:	Applicant
Submission Date:	2/19/2020 1:55:03 PM
Docketed Date:	2/19/2020



MALBURG GENERATING STATION

4963 Soto Street
Vernon, CA 90058
Telephone: (323) 476-3610
Fax: (323) 476-3640

29 January 2020

Mr. Anwar Ali
Compliance Project Manager
California Energy Commission
Energy Facilities Siting Division
1516 9th Street, MS 2000
Sacramento, CA 95814-5512

Subject: Malburg Generating Station
2019 Q4 Compliance Report

Dear Mr. Ali:

On behalf of the owner of the Malburg Generating Station, Bicent (California) Malburg LLC, Colorado Energy has compiled the attached Quarterly Compliance Report per the California Energy Commission's Decision 01-AFC-25C.

Please contact me at (303) 607-5590 or kmccormack@coloradoenergy.com if you have any questions or need additional information.

Sincerely,

Kyle McCormack
Senior Manager of Environmental

Attachments:

MGS 2019 Q4 CEC Report



MALBURG GENERATING STATION

4963 Soto Street

Vernon, CA 90058

Telephone: (323) 476-3610

Fax: (323) 476-3640

**QUARTERLY COMPLIANCE REPORT
(Fourth Quarter 2019)**

**MALBURG GENERATING STATION
4963 SOTO STREET, VERNON, CA 90058**

SUBMITTED TO:

CALIFORNIA ENERGY COMMISSION

1516 9TH STREET, SACRAMENTO, CA 95814



MALBURG GENERATING STATION

4963 Soto Street

Vernon, CA 90058

Telephone: (323) 476-3610

Fax: (323) 476-3640

Contents

LIST OF TABLES.....	iv
LIST OF APPENDICES	iv
SECTION 1 INTRODUCTION.....	1
1.1 PROJECT LOCATION AND DESCRIPTION	1
1.2 ORGANIZATION OF THE QUARTERLY COMPLIANCE REPORT	1
SECTION 2 COMPLIANCE DETAILS.....	1
2.1 CONDITION OF CERTIFICATION AQ-C6.....	1
2.2 CONDITION OF CERTIFICATION AQ-C7	1
2.3 CONDITION OF CERTIFICATION AQ-C8.....	1
2.4 CONDITION OF CERTIFICATION AQ-C9.....	2
2.5 CONDITION OF CERTIFICATION AQ-C10.....	2
2.6 CONDITION OF CERTIFICATION AQ-C11	2
2.7 CONDITION OF CERTIFICATION AQ-2	2
2.8 CONDITION OF CERTIFICATION AQ-3	2
2.9 CONDITION OF CERTIFICATION AQ-5	3
2.10 CONDITION OF CERTIFICATION AQ-6	3
2.11 CONDITION OF CERTIFICATION AQ-8	4
2.12 CONDITION OF CERTIFICATION AQ-9	4
2.13 CONDITION OF CERTIFICATION AQ-10	4
2.14 CONDITION OF CERTIFICATION AQ-11	4
2.15 CONDITION OF CERTIFICATION AQ-12	5
2.16 CONDITION OF CERTIFICATION AQ-13	5
2.17 CONDITION OF CERTIFICATION AQ-14	5
2.18 CONDITION OF CERTIFICATION AQ-15	6
2.19 CONDITION OF CERTIFICATION NUMBER AQ-27	6
Appendix A	7
Cooling Tower Blowdown Reports.....	7



MALBURG GENERATING STATION

4963 Soto Street

Vernon, CA 90058

Telephone: (323) 476-3610

Fax: (323) 476-3640

Appendix B	8
Excess Emission Reports	8
Appendix C	9
Diesel Fuel Oil Specifications	9
Appendix D	10
Cooling Tower PM10 Guidance	10



MALBURG GENERATING STATION

4963 Soto Street

Vernon, CA 90058

Telephone: (323) 476-3610

Fax: (323) 476-3640

LIST OF TABLES

- 2-1 Cooling Tower TDS Sampling Results
- 2-2 Cooling Tower Daily PM10 Emissions During October
- 2-3 Cooling Tower Daily PM10 Emissions During November
- 2-4 Cooling Tower Daily PM10 Emissions During December
- 2-5 Diesel Fuel Fired Emergency Firewater Pump Testing Times
- 2-11 Total Monthly Emissions during October
- 2-12 Total Monthly Emissions during November
- 2-13 Total Monthly Emissions during December
- 2-14 Combustion Turbines Startup and Shutdown Events
- 2-15 Combustion Turbines and Duct Burners Gas Usage

LIST OF APPENDICES

- A Cooling Tower Blowdown Reports
- B Excess Emissions Reports
- C Chevron GST Oil Specifications
- D Cooling Tower PM10

SECTION 1

INTRODUCTION

This Quarterly Compliance Report (QCR) has been prepared to meet the California Energy Commission (CEC) requirements for the Malburg Generating Station (MGS). This QCR fulfills various Conditions of Certifications as described in the California Energy Commission's Petition to Amend License, June 20, 2019.

1.1 PROJECT LOCATION AND DESCRIPTION

The Malburg Generating Station is located at 4963 Soto Street on approximately 3.4 acres, in an industrial land use area. MGS is located near the geographic center of metropolitan Los Angeles County. MGS consists of two Alstom GTX-100 frame type natural gas combustion turbine generators (CTGs); two heat recovery steam generators (HRSG); a steam turbine-generator (STG); a cooling tower, a diesel fuel fired emergency firewater pump and support equipment.

The commissioning of MGS was completed in October 2005 and the power plant began Commercial Operation on October 17, 2005.

1.2 ORGANIZATION OF THE QUARTERLY COMPLIANCE REPORT

A summary of each condition of certification and required means of verification are provided in Section 2. Each sub-section also contains a description of the method used by MGS to demonstrate compliance with the verification requirements and references to Appendices, Figures and Tables as appropriate.

SECTION 2

COMPLIANCE DETAILS

The compliance details for various conditions of certification are provided below.

2.1 CONDITION OF CERTIFICATION AQ-C6

As per the Condition of Certification Number AQ-C6, MGS shall determine the Total Dissolved Solids (TDS) levels in the blowdown water by independent laboratory testing prior to initial operation and periodically thereafter.

For verification of the above condition of certification, the CEC requires MGS to submit weekly TDS reports for the blowdown water as part of the quarterly emission report to the Compliance Project Manager (CPM) for approval.

As demonstration of compliance, the weekly TDS results are provided in Table 2-1, and the weekly sample reports during operation are provided in Appendix A.

2.2 CONDITION OF CERTIFICATION AQ-C7

As per the Condition of Certification Number AQ-C7, particulate matter of diameter less than 10 microns (PM₁₀) emissions from the cooling tower shall not exceed 6.2 lb/day.

Compliance with the PM₁₀ daily emission limit shall be demonstrated as follows:

$$\text{PM}_{10} \text{ lb/day} = A * B * C * D$$

Where:

- A = circulating water recirculation rate
- B = total dissolved solids concentration in the blowdown water to be updated on a weekly basis
- C = design drift rate
- D = correction factor

For verification of the above condition of certification, the CEC requires the project owner to calculate the daily PM₁₀ emissions from the cooling tower and submit all calculations and results on a quarterly basis in the quarterly emissions reports to the CPM for approval.

As demonstration of compliance, the daily PM₁₀ emissions from the cooling tower are provided in Tables 2-2 through 2-4.

2.3 CONDITION OF CERTIFICATION AQ-C8

As per the Condition of certification Number AQ-C8, the project owner shall refrain from testing the firewater pump during the same hour as either gas fired combustion turbines is in start up or shut down as defined by Condition of Certification AQ-C9.

For verification of the above condition of certification, the CEC requires MGS to submit to the CPM for approval all testing times and results of the diesel fired emergency firewater pump in the quarterly emissions report.

As demonstration of compliance, the testing times for the diesel fired emergency firewater pump are provided in Table 2-5. MGS refrained from testing the diesel fired

emergency firewater pump on the same hour the combustion turbines were either started or shutdown.

2.4 CONDITION OF CERTIFICATION AQ-C9

As per the Condition of certification Number AQ-C9, MGS shall use the provided definitions to determine compliance with startup, shutdown and any related emission or operational limitations.

For verification of the above condition of certification, the CEC requires MGS to submit to the CPM for approval, a record of all startups and shutdowns including duration and date of occurrence on a quarterly basis as part of the quarterly emission report.

As demonstration of compliance, the startup and shutdown details are provided in Table 2-14.

2.5 CONDITION OF CERTIFICATION AQ-C10

The condition of certification number AQ-C10 has been deleted.

2.6 CONDITION OF CERTIFICATION AQ-C11

As per the Condition of Certification Number AQ-C11, MGS shall submit a quarterly emissions report on a quarterly basis to the CPM for approval. The quarterly emissions report shall generally report all ammonia, NO_x, SO_x, CO, PM₁₀ and VOC emissions from the MGS as necessary to demonstrate compliance with all emission limits. The fourth quarter emission report shall include an annual summary of all emissions of ammonia, NO_x, SO_x, CO, PM₁₀ and VOC as necessary to demonstrate compliance with all annual emission limits.

For verification of the above condition of certification, the CEC requires MGS to submit the quarterly emissions report no less than 30 days after the end of each calendar quarter.

2.7 CONDITION OF CERTIFICATION AQ-2

As per the Condition of Certification Number AQ-2, MGS shall not use diesel oil containing sulfur compounds in excess of 15 ppm by weight as supplied by the supplier.

For verification of the above condition of certification, the CEC requires MGS to submit fuel purchase records for approval to the CPM on a quarterly basis in the quarterly emissions report.

Low sulfur diesel fuel was purchased May 20, 2019.

2.8 CONDITION OF CERTIFICATION AQ-3

As per the Condition of Certification Number AQ-3, MGS shall keep records, in a manner approved by the District, for the following parameter(s) or item(s): Purchase records of fuel oil and sulfur content of the fuel.

For verification of the above condition of certification, the CEC requires MGS to submit fuel purchase records for approval to the CPM on a quarterly basis in the quarterly emissions report.

Low sulfur diesel fuel was purchased May 20, 2019.

2.9 CONDITION OF CERTIFICATION AQ-5

As per the condition of certification number AQ-5, MGS shall limit the emissions from both gas-fired combustion turbine-heat recovery steam generator train exhaust stacks as follows:

Contaminant Emissions Limit

- CO 7,633 lbs in any one month
- PM₁₀ 4,876 lbs in any one month
- PM_{2.5} 4,876 lbs in any one month
- VOC 3,236 lbs in any one month
- SO_x 227 lbs in any one month

For verification of the above condition of certification, the CEC requires the MGS to submit all emission calculations, fuel use and a summary demonstrating compliance of all emission limits stated in this condition for approval to the CPM on a quarterly basis in the quarterly emissions report.

As demonstration of compliance, the monthly emissions of CO, PM₁₀, VOC, and SO_x are presented in Tables 2-11 through 2-13. In addition, the fuel usage for the two turbine-duct burner pairs is provided in Table 2-15. MGS calculates the emission limit(s) for CO based on readings from the certified CEMS. In the event the CO CEMS is not operating or the emissions exceed the valid upper range of the analyzer, the emissions are calculated in accordance with the approved CEMS Plan. MGS calculates the emission limit(s) by using the monthly fuel use data and the following emission factors:- PM₁₀, PM_{2.5}: 6.014 lb/mmscf, VOC: 1.54 lb/mmscf & SO_x: 0.28lb/mmscf.

2.10 CONDITION OF CERTIFICATION AQ-6

As per the condition of certification numbers AQ-6; following commissioning, start-ups shall not exceed 120 minutes during a cold start-up without a trip, and 150 minutes during a cold start-up with a trip. Cold start-ups with or without a trip shall not exceed the following limits: NO_x 122.8 lbs, CO 204.8 lbs and VOC 1.75 lbs.

Start-ups shall not exceed 90 minutes during a non-cold start-up without a trip or 120 minutes during a non-cold start-up with a trip. Non-cold start-ups shall not exceed the following limits: NO_x 51.3 lbs, CO 59.9 lbs, and VOC 1.55 lbs.

Shut-downs shall not exceed 30 minutes. Shut-downs shall not exceed the following limits: NO_x 4.5 lbs, CO 10.8 lbs, and VOC 0.71 lbs.

The number of startups shall not exceed two per day per turbine.

For verification of the above condition of certification, the CEC requires the MGS to submit a record of all startups and shutdowns including duration and date of occurrence on a quarterly basis as part of the quarterly emission report.

As demonstration of compliance, the startup and shutdown details are provided in Table 2-14. Additionally, quarterly excess emission reports from the DAHS are provided in Appendix B.

2.11 CONDITION OF CERTIFICATION AQ-8

The Condition of Certification Number AQ-8 has been deleted.

2.12 CONDITION OF CERTIFICATION AQ-9

As per the Condition of Certification Number AQ-9, the 2.0 ppmv oxides of nitrogen (NO_x) emissions limit(s) are averaged over 1 hour at 15 percent oxygen, dry basis, during the normal operation of the MGS combustion turbine generators.

For verification of the above condition of certification, the CEC requires MGS to submit to the CPM for approval all emissions and emission calculations on a quarterly basis as part of the quarterly emissions report.

NO_x emission for MGS Units 1 and 2 are measured using the CEMS. A review of CEMS NO_x emission data indicated that the maximum corrected NO_x emissions concentration for both MGS combustion turbines during normal operations was 1.8 ppmv, which is lower than the emission concentration limit of 2.0 ppmv. All CEMS data for MGS combustion turbines are stored electronically at MGS. As demonstration of compliance, quarterly excess emission reports from the DAHS are provided in Appendix B.

2.13 CONDITION OF CERTIFICATION AQ-10

As per the Condition of Certification Number AQ-10 the 2.0 ppmv carbon monoxide (CO) emissions limit(s) are averaged over 1 hour at 15 percent oxygen, dry basis, during the normal operation of the MGS combustion turbine generators.

For verification of the above condition of certification, the CEC requires MGS to submit to the CPM for approval all emissions and emission calculations on a quarterly basis as part of the quarterly emissions report.

CO emission for MGS Units 1 and 2 are measured using the CEMS. A review of CEMS CO emission data indicated that maximum CO emission concentration for both MGS combustion turbines was 0.7 ppmv, which is lower than the emission concentration limit of 2.0 ppmv. All CEMS data for MGS combustion turbines are stored electronically at MGS. As demonstration of compliance, quarterly excess emission reports from the DAHS are provided in Appendix B.

2.14 CONDITION OF CERTIFICATION AQ-11

As per the Condition of Certification Number AQ-11, the 2.0 ppmv VOC emission limit(s) are averaged over 1 hour at 15 percent oxygen, dry basis.

For verification of the above condition of certification, the CEC requires MGS to submit to the CPM for approval all emissions and emission calculations on a quarterly basis as part of the quarterly emissions report.

2.15 CONDITION OF CERTIFICATION AQ-12

As per the Condition of Certification Number AQ-12, the 5 ppm ammonia (NH₃) emission limit(s) are averaged over 1 hour at 15 percent oxygen, dry basis. MGS shall calculate and continuously record the ammonia slip concentration using the following:

$$\text{NH}_3 \text{ (ppmv)} = [a - (b \cdot c / 1,000,000)] \cdot (1,000,000 \cdot d / b)$$
 where

a = ammonia injection rate (lbs/hr)/17 (lbs/lb-mole)

b = dry exhaust gas flow rate (lbs/hr)/29 (lbs/lb-mole)

c = change in measured NO_x across the SCR (ppmv dry basis)

d = correction derived by comparing the measured and calculated NH₃ slip concentrations during annual compliance testing.

For verification of the above condition of certification, the CEC requires MGS to submit to the CPM for approval all emissions and emission calculations on a quarterly basis as part of the quarterly emissions report.

NH₃ emissions are calculated via the CEMS on an hourly basis but compliance with 5 ppm limit is demonstrated from source tests. The last NH₃ compliance source test, performed in August 2019, indicated compliance with the emission limits for both CT1 and for CT2.

2.16 CONDITION OF CERTIFICATION AQ-13

As per the Condition of Certification Number AQ-13, for the purpose of determining compliance with District Rule 475, combustion contaminant emissions may exceed the concentration limit or the mass emission limit listed, but not both emission limits at the same time.

For verification of the above condition of certification, the CEC requires MGS to submit to the CPM for approval all emissions and emission calculations on a quarterly basis as part of the quarterly emissions report.

Rule 475 limits emission of combustion contaminants from electric generating equipment to no more than 5 kilograms (11 pounds) per hour or 23 milligrams per cubic meter (0.01 gr/SCF) calculated at three percent oxygen on a dry basis averaged over 15 consecutive minutes or any other averaging time specified by the Executive Officer.

The results of the last compliance source tests performed in August 2019 indicated compliance with the particulate matter emission limits for both CT1 and CT2.

2.17 CONDITION OF CERTIFICATION AQ-14

As per the Condition of Certification Number AQ-14, MGS shall only use diesel fuel containing the following specified compounds:

Sulfur less than or equal to 15 ppm by weight.

For verification of the above condition of certification, the CEC requires MGS to submit fuel purchase records to the CPM on a quarterly basis as part of the quarterly emissions report.

MGS uses CARB Ultra Low Sulfur Diesel for the diesel fire pump (D48). This is an ash less oil. As demonstration of compliance, detailed specifications of CARB Ultra Low Sulfur Diesel are provided in Appendix C.

2.18 CONDITION OF CERTIFICATION AQ-15

As per the condition of certification number AQ-15, MGS will limit the operating time to no more than 200 hours each in any one year.

Operations for maintenance and testing as defined in Rule 1470 shall not exceed 50 hours in any one calendar year. The total annual operating time includes all operations including maintenance and testing.

For verification of the above condition of certification, the CEC requires MGS to submit to the CPM for approval all testing times and results of the diesel fired emergency firewater pump in the quarterly emissions report.

As demonstration of compliance, the testing times for the diesel fired emergency firewater pump are provided in Table 2-5.

2.19 CONDITION OF CERTIFICATION NUMBER AQ-27

As per the Condition of Certification Number AQ-27, MGS shall limit the fuel usage of each turbine-duct burner pair to no more than 405 MM cubic feet per month.

For verification of the above condition of certification, the CEC requires MGS to submit to the CPM for approval all emissions and emission calculations on a quarterly basis as part of the quarterly emissions report.

As demonstration of compliance, the fuel usage for the two turbine-duct burner pairs is provided in Table 2-15.

Table 2-1

**Malburg Generating Station
Cooling Tower TDS Sampling Results
Quarter 4, 2019**

Starting	Ending	TDS (ppm)
9/22/2019	9/28/2019	4280
9/29/2019	10/5/2019	4380
10/6/2019	10/12/2019	4360
10/13/2019	10/19/2019	4320
10/20/2019	10/26/2019	4180
10/27/2019	11/2/2019	4520
11/3/2019	11/9/2019	0
11/10/2019	11/16/2019	0
11/17/2019	11/23/2019	4340
11/24/2019	11/30/2019	3490
12/1/2019	12/7/2019	4260
12/8/2019	12/14/2019	4580
12/15/2019	12/21/2019	4340
12/22/2019	12/28/2019	4660

*
*

* Outage

Table 2-2

Malburg Generating Station Cooling Tower Daily PM₁₀ Emissions During Oct. 2019							
PM₁₀ = A x B x C x D PM₁₀ Limit is 6.2 lbs/day				A = Circulation Rate C = Drift Factor		B = TDS D = Correction Factor	
Date	Circulation Rate (gal/day)	TDS (ppm)	PM ₁₀ (lbs/day)	Date	Circulation Rate (gal/day)	TDS (ppm)	PM ₁₀ (lbs/day)
1	38,811,456	4380	1.42	17	38,811,456	4320	1.40
2	38,811,456	4380	1.42	18	38,811,456	4320	1.40
3	38,811,456	4380	1.42	19	38,811,456	4320	1.40
4	38,811,456	4380	1.42	20	38,811,456	4180	1.35
5	38,811,456	4380	1.42	21	38,811,456	4180	1.35
6	38,811,456	4360	1.41	22	38,811,456	4180	1.35
7	38,811,456	4360	1.41	23	38,811,456	4180	1.35
8	38,811,456	4360	1.41	24	38,811,456	4180	1.35
9	38,811,456	4360	1.41	25	38,811,456	4180	1.35
10	38,811,456	4360	1.41	26	38,811,456	4180	1.35
11	38,811,456	4360	1.41	27	38,811,456	4520	1.46
12	38,811,456	4360	1.41	28	38,811,456	4520	1.46
13	38,811,456	4320	1.40	29	38,811,456	4520	1.46
14	38,811,456	4320	1.40	30	38,811,456	4520	1.46
15	38,811,456	4320	1.40	31	38,811,456	4520	1.46
16	38,811,456	4320	1.40				

Table 2-3

Malburg Generating Station Cooling Tower Daily PM10 Emissions During Nov. 2019							
PM₁₀ = A x B x C x D PM₁₀ Limit is 6.2 lbs/day				A = Circulation Rate C = Drift Factor		B = TDS D = Correction Factor	
Date	Circulation Rate (gal/day)	TDS (ppm)	PM ₁₀ (lbs/day)	Date	Circulation Rate (gal/day)	TDS (ppm)	PM ₁₀ (lbs/day)
1	38,811,456	4520	1.46	17	38,811,456	4340	1.40
2	38,811,456	4520	1.46	18	38,811,456	4340	1.40
3	38,811,456	0	0.00	19	38,811,456	4340	1.40
4	38,811,456	0	0.00	20	38,811,456	4340	1.40
5	38,811,456	0	0.00	21	38,811,456	4340	1.40
6	38,811,456	0	0.00	22	38,811,456	4340	1.40
7	38,811,456	0	0.00	23	38,811,456	4340	1.40
8	38,811,456	0	0.00	24	38,811,456	3490	1.13
9	38,811,456	0	0.00	25	38,811,456	3490	1.13
10	38,811,456	0	0.00	26	38,811,456	3490	1.13
11	38,811,456	0	0.00	27	38,811,456	3490	1.13
12	38,811,456	0	0.00	28	38,811,456	3490	1.13
13	38,811,456	0	0.00	29	38,811,456	3490	1.13
14	38,811,456	0	0.00	30	38,811,456	3490	1.13
15	38,811,456	0	0.00				
16	38,811,456	0	0.00				

Table 2-4

Malburg Generating Station Cooling Tower Daily PM10 Emissions During Dec. 2019							
PM₁₀ = A x B x C x D PM₁₀ Limit is 6.2 lbs/day				A = Circulation Rate C = Drift Factor		B = TDS D = Correction Factor	
Date	Circulation Rate (gal/day)	TDS (ppm)	PM ₁₀ (lbs/day)	Date	Circulation Rate (gal/day)	TDS (ppm)	PM ₁₀ (lbs/day)
1	38,811,456	4260	1.38	17	38,811,456	4340	1.40
2	38,811,456	4260	1.38	18	38,811,456	4340	1.40
3	38,811,456	4260	1.38	19	38,811,456	4340	1.40
4	38,811,456	4260	1.38	20	38,811,456	4340	1.40
5	38,811,456	4260	1.38	21	38,811,456	4340	1.40
6	38,811,456	4260	1.38	22	38,811,456	4660	1.51
7	38,811,456	4260	1.38	23	38,811,456	4660	1.51
8	38,811,456	4580	1.48	24	38,811,456	4660	1.51
9	38,811,456	4580	1.48	25	38,811,456	4660	1.51
10	38,811,456	4580	1.48	26	38,811,456	4660	1.51
11	38,811,456	4580	1.48	27	38,811,456	4660	1.51
12	38,811,456	4580	1.48	28	38,811,456	4660	1.51
13	38,811,456	4580	1.48	29	38,811,456	4400	1.42
14	38,811,456	4580	1.48	30	38,811,456	4400	1.42
15	38,811,456	4340	1.40	31	36,339,840	4400	1.33
16	38,811,456	4340	1.40				

Table 2-5

**Heorot Power Management
Malburg Generating Station
Diesel Fuel Fired Emergency Firewater Pump Testing Times
During Quarter 4, 2019**

Date	Time	Main / Test Emerg.	Hours of Operation	Fuel Used (gals)	Initials
Oct. 01, 2019	00:26	Testing	0.5	5.6	JPFO
Oct. 06, 2019	01:26	Testing	0.5	5.6	JAFO
Oct. 13, 2019	02:26	Testing	0.5	5.6	VFFO
Oct. 20, 2019	03:26	Testing	0.5	5.6	SCTFO
Oct. 27, 2019	04:26	Testing	0.3	3.4	STFO
Nov. 04, 2019	05:26	Testing	0.5	5.6	JAFO
Nov. 11, 2019	06:26	Testing	0.4	4.5	JAFO
Nov. 18, 2019	07:26	Testing	0.4	4.5	VFFO
Nov. 24, 2019	08:26	Testing	0.6	6.7	SCTFO
Dec. 01, 2019	09:26	Testing	0.5	5.6	STFO
Dec. 08, 2019	10:26	Testing	0.4	4.5	JPFO
Dec. 15, 2019	11:26	Testing	0.5	5.6	JAFO
Dec. 22, 2019	12:26	Testing	0.4	4.5	STFO
Dec. 29, 2019	13:26	Testing	0.5	5.6	SCTFO

Note: Event 'DNR' - Did Not Run

Table 2-14

**Malburg Generating Station
Combustion Turbines Startup and Shutdown Events
During Quarter 4, 2019**

CT1

Date	Event Type	Event Start	Event End	Duration (hrs:min)
10/28/2019	Shutdown/Trip	09:11	09:11	0:00
10/29/2019	Warm Startup	15:14	16:24	1:10
11/03/2019	Shutdown	00:03	00:10	0:07
11/09/2019	Cold Startup	13:29	15:09	1:40
11/09/2019	Shutdown	21:42	21:45	0:03
11/10/2019	Warm Startup	14:56	16:12	1:16
12/19/2019	Shutdown	10:30	10:37	0:07
12/22/2019	Cold Startup	06:03	07:37	1:34

CT2

11/03/2019	Shutdown	00:03	00:10	00:07
11/09/2019	Cold Startup	16:03	17:17	01:14
11/09/2019	Shutdown	21:43	21:45	00:02
11/10/2019	Warm Startup	16:41	17:41	01:00
11/17/2019	Shutdown/Trip	12:26	12:26	00:00
11/17/2019	Warm Startup	13:12	14:00	00:48
11/17/2019	Shutdown/Trip	18:33	18:33	00:00
11/17/2019	Startup	21:33	22:28	00:55

Table 2-15

Malburg Generating Station Combustion Turbines and Duct Burner Gas Usage During Quarter 4,2019		
Month	CT-1 / DB-1 Gas Usage (mmscf)	CT-2 / DB-2 Gas Usage (mmscf)
Oct-19	220.78	236.26
Nov-19	172.16	170.66
Dec-19	201.91	232.89

Appendix A

Cooling Tower Blowdown Reports



781 East Washington Blvd., Los Angeles, CA 90021
[213] 745-5312 FAX [213] 745-6372

October 09, 2019

Tom Barnhart
Colorado Energy Management
4963 Soto St.
Vernon, CA 90058

Report No.: 1910012
Project Name: Malburg Generating Station Weekly

Dear Tom Barnhart,

This report contains the analytical results for the sample(s) received under chain of custody(s) by Positive Lab Service on October 02, 2019.

The test results in this report are performed in compliance with ELAP accreditation requirements for the certified parameters. The laboratory report may not be produced, except in full, without the written approval of the laboratory.

The issuance of the final Certificate of Analysis takes precedence over any previous Preliminary Report. Preliminary data should not be used for regulatory purposes. Authorized signature(s) is provided on final report only.

If you have any questions in reference to this report, please contact your Positive Lab Service coordinator.


Project Manager



781 East Washington Blvd., Los Angeles, CA 90021
(213) 745-5312 FAX (213) 745-6372

Certificate of Analysis

Page 2 of 2

Colorado Energy Management
4963 Soto St.
Vernon, CA 90058

Attn: Tom Barnhart

Phone: (323) 476-3626 FAX: (323) 476-3640

File #: 74548

Report Date: 10/09/19

Submitted: 10/02/19

PLS Report No.: 1910012

Project: Malburg Generating Station Weekly

Sample ID: Cooling Tower Blowdown Water (1910012-01) Sampled: 10/02/19 09:30 Received: 10/02/19 09:30										
Analyte	Results	Flag	D.F.	Units	PQL	Prep/Test Method	Prepared	Analyzed	By	Batch
Total Dissolved Solids	4380		1	mg/L	5.0	SM 2540C	10/07/19	10/08/19	dd	BJ90834

Quality Control Data

Analyte	Result	PQL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Qualifier
Batch BJ90834 - -										
Blank										
Prepared: 10/07/19 Analyzed: 10/08/19										
Total Dissolved Solids	ND	5.0	mg/L							
LCS										
Prepared: 10/07/19 Analyzed: 10/08/19										
Total Dissolved Solids	331	5.0	mg/L	356.0		93.0	80-120			
Duplicate										
Source: 1910012-01 Prepared: 10/07/19 Analyzed: 10/08/19										
Total Dissolved Solids	4550	5.0	mg/L		4380			3.73	5	

Notes and Definitions

NA Not Applicable
ND Analyte NOT DETECTED at or above the detection limit
NR Not Reported
MDL Method Detection Limit
PQL Practical Quantitation Limit

Environmental Laboratory Accreditation Program Certificate No. 1131, Mobile Lab No. 2534, LACSD No. 10138

Authorized Signature(s)



CHAIN OF CUSTODY AND ANALYSIS REQUEST

781 East Washington Blvd., Los Angeles, CA 90021
(213) 745-5312 FAX (213) 745-6372

DATE: 10/2/9 PAGE 1 OF 1
LOG BOOK NO. _____ FILE NO. _____ LAB NO. 191 0012

CLIENT NAME: <u>Cam</u>				Project Name/No. <u>Malibu Generation Station Weekly</u>				P.O. NO.				AIRBILL NO: _____																																																																															
ADDRESS:								ANALYSES REQUESTED:								COOLER TEMP: <u>1.1°</u>																																																																											
PROJECT MANAGER: <u>Tom Bernhart</u>				PHONE NO:				FAX NO:				PRESERVATIVE:																																																																															
SAMPLER NAME: <u>Jon Baro</u> (Printed) <u>[Signature]</u> (Signature)								<table border="1" style="width:100%; height: 150px;"> <tr><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> <tr><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> <tr><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> <tr><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> </table>																																																																																REMARKS:			
TAT (Analytical Turn Around Time): 0 = Same Day; 1 = 1 Day; 2 = 2 Days; 3 = 3 Days; N = Normal (5-7 Working Days)																																																																																											
CONTAINER TYPES: B = Brass, E = Encore, G = Glass, P = Plastic, V = VOA Vial, O = Other:																																																																																											
UST Project: Y N - Global ID# _____																																																																																											
SAMPLE NO.	DATE SAMPLED	TIME SAMPLED	SAMPLE DESCRIPTION	MATRIX				TAT	CONTAINER									SAMPLE CONDITION/CONTAINER /COMMENTS:																																																																									
				WATER	SOIL	SLUDGE	OTHER		#	TYPE																																																																																	
1	<u>10/2/9</u>	<u>0930</u>	<u>Cooling Tower Blowdown</u>	<u>1</u>				<u>21</u>	<u>P</u>	<u>2</u>																																																																																	
2																																																																																											
3																																																																																											
4																																																																																											
5																																																																																											
6																																																																																											
7																																																																																											
8																																																																																											
9																																																																																											
10																																																																																											

Relinquished By: (Signature and Printed Name) <u>[Signature]</u>		Received By: (Signature and Printed Name) <u>[Signature]</u>		Date: <u>10/2/9</u>	Time: <u>10:55</u>	SAMPLE DISPOSITION: 1. Samples returned to client? YES NO 2. Samples will not be stored over 30 days, unless additional storage time is requested. 3. Storage time requested: _____ days By _____ Date _____
Relinquished By: (Signature and Printed Name)		Received By: (Signature and Printed Name)		Date:	Time:	
Relinquished By: (Signature and Printed Name)		Received By: (Signature and Printed Name)		Date:	Time:	

SPECIAL INSTRUCTIONS:

PRESERVATIVE: 1-HNO₃, 2-H₂SO₄, 3-HCL, 4-Zinc Acetate, 5-NaOH, 6-NH₄ Buffer, 7-Other



781 East Washington Blvd., Los Angeles, CA 90021
(213) 745-5312 FAX (213) 745-6372

October 14, 2019

Tom Barnhart
Colorado Energy Management
4963 Soto St.
Vernon, CA 90058

Report No.: 1910049
Project Name: Malburg Generating Station Weekly

Dear Tom Barnhart,

This report contains the analytical results for the sample(s) received under chain of custody(s) by Positive Lab Service on October 07, 2019.

The test results in this report are performed in compliance with ELAP accreditation requirements for the certified parameters. The laboratory report may not be produced, except in full, without the written approval of the laboratory.

The issuance of the final Certificate of Analysis takes precedence over any previous Preliminary Report. Preliminary data should not be used for regulatory purposes. Authorized signature(s) is provided on final report only.

If you have any questions in reference to this report, please contact your Positive Lab Service coordinator.



Project Manager



781 East Washington Blvd., Los Angeles, CA 90021
[213] 745-5312 FAX [213] 745-6372

Certificate of Analysis

Page 2 of 2

Colorado Energy Management
4963 Soto St.
Vernon, CA 90058

Attn: Tom Barnhart

Phone: (323) 476-3626 FAX:(323) 476-3640

File #:74548

Report Date: 10/14/19

Submitted: 10/07/19

PLS Report No.: 1910049

Project: Malburg Generating Station Weekly

Sample ID: Cooling Tower Blowdown Water (1910049-01) Sampled: 10/07/19 08:35 Received: 10/07/19 08:35

Analyte	Results	Flag	D.F.	Units	PQL	Prep/Test Method	Prepared	Analyzed	By	Batch
Total Dissolved Solids	4360		1	mg/L	5.0	- SM 2540C	10/10/19	10/11/19	dd	BJ91430

Quality Control Data

Analyte	Result	PQL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Qualifier
---------	--------	-----	-------	-------------	---------------	------	-------------	-----	-----------	-----------

Batch BJ91430 - -

Blank Prepared: 10/10/19 Analyzed: 10/11/19

Total Dissolved Solids ND 5.0 mg/L

LCS Prepared: 10/10/19 Analyzed: 10/11/19

Total Dissolved Solids 338 5.0 mg/L 356.0 94.9 80-120

Duplicate Source: 1910049-01 Prepared: 10/10/19 Analyzed: 10/11/19

Total Dissolved Solids 4430 5.0 mg/L 4360 1.63 5

Notes and Definitions

NA Not Applicable
ND Analyte NOT DETECTED at or above the detection limit
NR Not Reported
MDL Method Detection Limit
PQL Practical Quantitation Limit

Environmental Laboratory Accreditation Program Certificate No. 1131, Mobile Lab No. 2534, LACSD No. 10138

Authorized Signature(s)



CHAIN OF CUSTODY AND ANALYSIS REQUEST

 781 East Washington Blvd., Los Angeles, CA 90021
 (213) 745-5312 FAX (213) 745-6372

 DATE: 10-7-19 PAGE 1 OF 1
 LOG BOOK NO. _____ FILE NO. _____ LAB NO. 1910049

CLIENT NAME: <u>CEM</u>				Project Name/No. <u>Mathew Genesys Station Weekly</u>				P.O. NO. _____				AIRBILL NO: _____																																																																																																																																																																																																																																			
ADDRESS: _____								ANALYSES REQUESTED: _____								COOLER TEMP: <u>0-9°C</u>																																																																																																																																																																																																																															
PROJECT MANAGER: <u>Tom Barnhart</u>				PHONE NO: _____				FAX NO: _____				PRESERVATIVE: _____																																																																																																																																																																																																																																			
SAMPLER NAME: <u>Tom Barnhart</u> (Printed) <u>[Signature]</u> (Signature)								<div style="display: flex; align-items: center;"> <div style="writing-mode: vertical-rl; transform: rotate(180deg); font-weight: bold; margin-right: 10px;">TDS</div> <table border="1" style="width: 100%; height: 100%; border-collapse: collapse;"> <tr><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> <tr><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> <tr><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> <tr><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> <tr><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> <tr><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> <tr><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> <tr><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> <tr><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> <tr><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> <tr><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> </table> </div>																																																																																																																																																																																																																																				REMARKS: _____			
TAT (Analytical Turn Around Time): 0 = Same Day; 1 = 1 Day; 2 = 2 Days; 3 = 3 Days; N = Normal (5-7 Working Days)																																																																																																																																																																																																																																															
CONTAINER TYPES: B = Brass, E = Encore, G = Glass, P = Plastic, V = VOA Vial, O = Other:																																																																																																																																																																																																																																															
UST Project: Y N - Global ID# _____																																																																																																																																																																																																																																															
SAMPLE CONDITION/CONTAINER /COMMENTS: _____																																																																																																																																																																																																																																															
SAMPLE NO.	DATE SAMPLED	TIME SAMPLED	SAMPLE DESCRIPTION	MATRIX				TAT	CONTAINER																																																																																																																																																																																																																																						
				WATER	SOIL	SLUDGE	OTHER		#	TYPE																																																																																																																																																																																																																																					
1	10-7-19	0835	Cooring tower Blomdown	X				N1	P	X																																																																																																																																																																																																																																					
2																																																																																																																																																																																																																																															
3																																																																																																																																																																																																																																															
4																																																																																																																																																																																																																																															
5																																																																																																																																																																																																																																															
6																																																																																																																																																																																																																																															
7																																																																																																																																																																																																																																															
8																																																																																																																																																																																																																																															
9																																																																																																																																																																																																																																															
10																																																																																																																																																																																																																																															

Relinquished By: (Signature and Printed Name) [Signature]
 Relinquished By: (Signature and Printed Name) _____
 Relinquished By: (Signature and Printed Name) _____

Received By: (Signature and Printed Name) [Signature] 10-7-19 1210
 Received By: (Signature and Printed Name) _____
 Received By: (Signature and Printed Name) _____

Date: _____ Time: _____
 Date: _____ Time: _____
 Date: _____ Time: _____

SAMPLE DISPOSITION:
 1. Samples returned to client? YES NO
 2. Samples will not be stored over 30 days, unless additional storage time is requested.
 3. Storage time requested: _____ days
 By _____ Date _____

SPECIAL INSTRUCTIONS: _____

PRESERVATIVE: 1-HNO₃, 2-H₂SO₄, 3-HCL, 4-Zinc Acetate, 5-NaOH, 6-NH₄ Buffer, 7-Other



781 East Washington Blvd., Los Angeles, CA 90021
[213] 745-5312 FAX [213] 745-6372

October 21, 2019

Tom Barnhart
Colorado Energy Management
4963 Soto St.
Vernon, CA 90058

Report No.: 1910159
Project Name: Malburg Generating Station Weekly

Dear Tom Barnhart,

This report contains the analytical results for the sample(s) received under chain of custody(s) by Positive Lab Service on October 14, 2019.

The test results in this report are performed in compliance with ELAP accreditation requirements for the certified parameters. The laboratory report may not be produced, except in full, without the written approval of the laboratory.

The issuance of the final Certificate of Analysis takes precedence over any previous Preliminary Report. Preliminary data should not be used for regulatory purposes. Authorized signature(s) is provided on final report only.

If you have any questions in reference to this report, please contact your Positive Lab Service coordinator.


Project Manager



781 East Washington Blvd., Los Angeles, CA 90021
(213) 745-5312 FAX (213) 745-6372

Certificate of Analysis

Page 2 of 2

Colorado Energy Management
4963 Soto St.
Vernon, CA 90058

Attn: Tom Barnhart

Phone: (323) 476-3626 FAX:(323) 476-3640

File #:74548

Report Date: 10/21/19

Submitted: 10/14/19

PLS Report No.: 1910159

Project: Malburg Generating Station Weekly

Sample ID: Cooling Tower Blowdown Water (1910159-01) Sampled: 10/14/19 08:55 Received: 10/14/19 08:55

Analyte	Results	Flag	D.F.	Units	PQL	Prep/Test Method	Prepared	Analyzed	By	Batch
Total Dissolved Solids	4320		1	mg/L	5.0	- SM 2540C	10/17/19	10/18/19	dd	BJ92129

Quality Control Data

Analyte	Result	PQL	Units	Spike Level	Source Result	%REC Limits	RPD	RPD Limit	Qualifier
Batch BJ92129 --									
Blank									
Prepared: 10/17/19 Analyzed: 10/18/19									
Total Dissolved Solids	ND	5.0	mg/L						
LCS									
Prepared: 10/17/19 Analyzed: 10/18/19									
Total Dissolved Solids	338	5.0	mg/L	356.0		94.9 80-120			
Duplicate									
Source: 1910159-01 Prepared: 10/17/19 Analyzed: 10/18/19									
Total Dissolved Solids	4540	5.0	mg/L		4320		4.85	5	

Notes and Definitions

NA Not Applicable
ND Analyte NOT DETECTED at or above the detection limit
NR Not Reported
MDL Method Detection Limit
PQL Practical Quantitation Limit

Environmental Laboratory Accreditation Program Certificate No. 1131, Mobile Lab No. 2534, LACSD No. 10138


Authorized Signature(s)



CHAIN OF CUSTODY AND ANALYSIS REQUEST

 781 East Washington Blvd., Los Angeles, CA 90021
 (213) 745-5312 FAX (213) 745-6372

DATE: 10/14/19 PAGE 1 OF 1

LOG BOOK NO. FILE NO. LAB NO. 1910159

CLIENT NAME: CEM				Project Name/No. Malibu Generating Station - weekly				P.O. NO.				AIRBILL NO:																																																																																																	
ADDRESS:								ANALYSES REQUESTED:								COOLER TEMP: 0.7°C																																																																																													
PROJECT MANAGER: Tom Barnhart				PHONE NO:				FAX NO:				PRESERVATIVE:																																																																																																	
SAMPLER NAME: Jim Bane (Printed) (Signature)								<div style="display: flex; align-items: center;"> <div style="writing-mode: vertical-rl; transform: rotate(180deg); font-weight: bold; margin-right: 5px;">TAT</div> <table border="1" style="border-collapse: collapse; text-align: center;"> <tr><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> <tr><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> <tr><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> <tr><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> <tr><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> </table> </div>																																																																																																		REMARKS:			
TAT (Analytical Turn Around Time): 0 = Same Day; 1 = 1 Day; 2 = 2 Days; 3 = 3 Days; N = Normal (5-7 Working Days)																																																																																																													
CONTAINER TYPES: B = Brass, E = Encore, G = Glass, P = Plastic, V = VOA Vial, O = Other:																																																																																																													
UST Project: Y N - Global ID#																																																																																																													
SAMPLE NO.	DATE SAMPLED	TIME SAMPLED	SAMPLE DESCRIPTION	MATRIX				TAT	CONTAINER									SAMPLE CONDITION/CONTAINER /COMMENTS:																																																																																											
				WATER	SOIL	SLUDGE	OTHER		#	TYPE																																																																																																			
1	10/14/19	0835	Coating Tower Blower	X				N	1	P	X																																																																																																		
2																																																																																																													
3																																																																																																													
4																																																																																																													
5																																																																																																													
6																																																																																																													
7																																																																																																													
8																																																																																																													
9																																																																																																													
10																																																																																																													

Relinquished By: (Signature and Printed Name)	Received By: (Signature and Printed Name)	Date: 10/14/19	Time: 10P	SAMPLE DISPOSITION: 1. Samples returned to client? YES NO 2. Samples will not be stored over 30 days, unless additional storage time is requested. 3. Storage time requested: _____ days By _____ Date _____
Relinquished By: (Signature and Printed Name)	Received By: (Signature and Printed Name)	Date:	Time:	
Relinquished By: (Signature and Printed Name)	Received By: (Signature and Printed Name)	Date:	Time:	

SPECIAL INSTRUCTIONS:

PRESERVATIVE: 1-HNO3, 2-H2SO4, 3-HCL, 4-Zinc Acetate, 5-NaOH, 6-NH4 Buffer, 7-Other

LAB COPY



781 East Washington Blvd., Los Angeles, CA 90021
(213) 745-5312 FAX (213) 745-6372

October 28, 2019

Tom Barnhart
Colorado Energy Management
4963 Soto St.
Vernon, CA 90058

Report No.: 1910222
Project Name: Malburg Generating Station Weekly

Dear Tom Barnhart,

This report contains the analytical results for the sample(s) received under chain of custody(s) by Positive Lab Service on October 22, 2019.

The test results in this report are performed in compliance with ELAP accreditation requirements for the certified parameters. The laboratory report may not be produced, except in full, without the written approval of the laboratory.

The issuance of the final Certificate of Analysis takes precedence over any previous Preliminary Report. Preliminary data should not be used for regulatory purposes. Authorized signature(s) is provided on final report only.

If you have any questions in reference to this report, please contact your Positive Lab Service coordinator.


Project Manager



781 East Washington Blvd., Los Angeles, CA 90021
[213] 745-5312 FAX [213] 745-6372

Certificate of Analysis

Page 2 of 2

Colorado Energy Management
4963 Soto St.
Vernon, CA 90058

Attn: Tom Barnhart

Phone: (323) 476-3626 FAX: (323) 476-3640

File #: 74548

Report Date: 10/28/19

Submitted: 10/22/19

PLS Report No.: 1910222

Project: Malburg Generating Station Weekly

Sample ID: Cooling Tower Blowdown Water (1910222-01) Sampled: 10/22/19 08:40 Received: 10/22/19 08:40

Analyte	Results	Flag	D.F.	Units	PQL	Prep/Test Method	Prepared	Analyzed	By	Batch
Total Dissolved Solids	4180		1	mg/L	5.0	SM 2540C	10/24/19	10/25/19	dd	BJ92825


Quality Control Data

Analyte	Result	PQL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Qualifier
Batch BJ92825 - -										
Blank										
Prepared: 10/24/19 Analyzed: 10/25/19										
Total Dissolved Solids	ND	5.0	mg/L							
LCS										
Prepared: 10/24/19 Analyzed: 10/25/19										
Total Dissolved Solids	350	5.0	mg/L	356.0		98.3	80-120			
Duplicate										
Source: 1910222-01 Prepared: 10/24/19 Analyzed: 10/25/19										
Total Dissolved Solids	4390	5.0	mg/L		4180			4.86	5	

Notes and Definitions

NA Not Applicable
ND Analyte NOT DETECTED at or above the detection limit
NR Not Reported
MDL Method Detection Limit
PQL Practical Quantitation Limit

Environmental Laboratory Accreditation Program Certificate No. 1131, Mobile Lab No. 2534, LACSD No. 10138


Authorized Signature(s)



781 East Washington Blvd., Los Angeles, CA 90021
(213) 745-5312 FAX (213) 745-6372

November 04, 2019

Tom Barnhart
Colorado Energy Management
4963 Soto St.
Vernon, CA 90058

Report No.: 1910266
Project Name: Malburg Generating Station Weekly

Dear Tom Barnhart,

This report contains the analytical results for the sample(s) received under chain of custody(s) by Positive Lab Service on October 28, 2019.

The test results in this report are performed in compliance with ELAP accreditation requirements for the certified parameters. The laboratory report may not be produced, except in full, without the written approval of the laboratory.

The issuance of the final Certificate of Analysis takes precedence over any previous Preliminary Report. Preliminary data should not be used for regulatory purposes. Authorized signature(s) is provided on final report only.

If you have any questions in reference to this report, please contact your Positive Lab Service coordinator.

A handwritten signature in black ink, appearing to read "John Schmitt", is written over a horizontal line.

Project Manager



781 East Washington Blvd., Los Angeles, CA 90021
(213) 745-5312 FAX (213) 745-6372

Certificate of Analysis

Page 2 of 2

Colorado Energy Management
4963 Soto St.
Vernon, CA 90058

Attn: Tom Barnhart

Phone: (323) 476-3626 FAX:(323) 476-3640

File #:74548

Report Date: 11/04/19

Submitted: 10/28/19

PLS Report No.: 1910266

Project: Malburg Generating Station Weekly

Sample ID: Cooling Tower Blowdown Water (1910266-01) Sampled: 10/28/19 08:15 Received: 10/28/19 08:15										
Analyte	Results	Flag	D.F.	Units	PQL	Prep/Test Method	Prepared	Analyzed	By	Batch
Total Dissolved Solids	4520		1	mg/L	5.0	- SM 2540C	10/31/19	11/01/19	dd	BK90419


Quality Control Data

Analyte	Result	PQL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Qualifier
Batch BK90419 - -										
Blank										
Prepared: 10/31/19 Analyzed: 11/01/19										
Total Dissolved Solids	ND	5.0	mg/L							
LCS										
Prepared: 10/31/19 Analyzed: 11/01/19										
Total Dissolved Solids	356	5.0	mg/L	356.0		100	80-120			
Duplicate Source: 1910266-01 Prepared: 10/31/19 Analyzed: 11/01/19										
Total Dissolved Solids	4360	5.0	mg/L		4520			3.49	5	

Notes and Definitions

NA Not Applicable
ND Analyte NOT DETECTED at or above the detection limit
NR Not Reported
MDL Method Detection Limit
PQL Practical Quantitation Limit

Environmental Laboratory Accreditation Program Certificate No. 1131, Mobile Lab No. 2534, LACSD No. 10138


Authorized Signature(s)



CHAIN OF CUSTODY AND ANALYSIS REQUEST

 781 East Washington Blvd., Los Angeles, CA 90021
 (213) 745-5312 FAX (213) 745-6372

DATE: 102819 PAGE 1 OF 1

LOG BOOK NO. FILE NO. LAB NO. 1010260

CLIENT NAME: CEM

Project Name/No. Mobery Generating Station - weekly

P.O. NO.

AIRBILL NO:

ADDRESS:

ANALYSES REQUESTED:

COOLER TEMP: 0.94

PROJECT MANAGER: Tom Barnhart

PHONE NO:

FAX NO:

PRESERVATIVE:

SAMPLER NAME: Tom Barnhart

(Printed)

(Signature)

REMARKS:

TAT (Analytical Turn Around Time): 0 = Same Day; 1 = 1 Day; 2 = 2 Days; 3 = 3 Days; N = Normal (5-7 Working Days)

CONTAINER TYPES: B = Brass, E = Encore, G = Glass, P = Plastic, V = VOA Vial, O = Other:

UST Project: Y N - Global ID#

SAMPLE NO.	DATE SAMPLED	TIME SAMPLED	SAMPLE DESCRIPTION	MATRIX				TAT	CONTAINER	
				WATER	SOIL	SLUDGE	OTHER		#	TYPE
1	102819	0815	Coating Tower Blowdown					2	1	P
2										
3										
4										
5										
6										
7										
8										
9										
10										

SAMPLE CONDITION/
CONTAINER /COMMENTS:

Relinquished By: (Signature and Printed Name)

Received By: (Signature and Printed Name)

Date: 102819 Time: 1245

SAMPLE DISPOSITION:

1. Samples returned to client? YES NO

2. Samples will not be stored over 30 days, unless additional storage time is requested.

3. Storage time requested: days

Relinquished By: (Signature and Printed Name)

Received By: (Signature and Printed Name)

Date: Time:

Relinquished By: (Signature and Printed Name)

Received By: (Signature and Printed Name)

Date: Time:

SPECIAL INSTRUCTIONS:

By Date

PRESERVATIVE: 1-HNO₃, 2-H₂SO₄, 3-HCL, 4-Zinc Acetate, 5-NaOH, 6-NH₄ Buffer, 7-Other

LAB COPY



781 East Washington Blvd., Los Angeles, CA 90021
(213) 745-5312 FAX (213) 745-6372

November 25, 2019

Tom Barnhart
Colorado Energy Management
4963 Soto St.
Vernon, CA 90058

Report No.: 1911202
Project Name: Malburg Generating Station Weekly

Dear Tom Barnhart,

This report contains the analytical results for the sample(s) received under chain of custody(s) by Positive Lab Service on November 19, 2019.

The test results in this report are performed in compliance with ELAP accreditation requirements for the certified parameters. The laboratory report may not be produced, except in full, without the written approval of the laboratory.

The issuance of the final Certificate of Analysis takes precedence over any previous Preliminary Report. Preliminary data should not be used for regulatory purposes. Authorized signature(s) is provided on final report only.

If you have any questions in reference to this report, please contact your Positive Lab Service coordinator.


Project Manager



781 East Washington Blvd., Los Angeles, CA 90021
(213) 745-5312 FAX (213) 745-6372

Certificate of Analysis

Page 2 of 2

Colorado Energy Management
4963 Soto St.
Vernon, CA 90058

Attn: Tom Barnhart

Phone: (323) 476-3626 FAX:(323) 476-3640

File #:74548

Report Date: 11/25/19

Submitted: 11/19/19

PLS Report No.: 1911202

Project: Malburg Generating Station Weekly

Sample ID: Cooling Tower Blowdown Water (1911202-01) Sampled: 11/19/19 09:15 Received: 11/19/19 09:15										
Analyte	Results	Flag	D.F.	Units	PQL	Prep/Test Method	Prepared	Analyzed	By	Batch
Total Dissolved Solids	4340		1	mg/L	5.0	- SM 2540C	11/20/19	11/21/19	vc	BK92204

Quality Control Data


Analyte	Result	PQL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Qualifier
Batch BK92204 - -										
Blank										
Total Dissolved Solids	ND	5.0	mg/L							
LCS										
Total Dissolved Solids	48.0	5.0	mg/L	50.00		96.0	80-120			
Duplicate Source: 1911202-01 Prepared: 11/20/19 Analyzed: 11/21/19										
Total Dissolved Solids	4410	5.0	mg/L		4340			1.79	5	
Duplicate Source: 1911216-14 Prepared: 11/20/19 Analyzed: 11/21/19										
Total Dissolved Solids	6190	5.0	mg/L		6080			1.76	5	

Notes and Definitions

NA Not Applicable
ND Analyte NOT DETECTED at or above the detection limit
NR Not Reported
MDL Method Detection Limit
PQL Practical Quantitation Limit

Environmental Laboratory Accreditation Program Certificate No. 1131, Mobile Lab No. 2534, LACSD No. 10138


Authorized Signature(s)


POSITIVE
LAB SERVICE
CHAIN OF CUSTODY AND ANALYSIS REQUEST

 781 East Washington Blvd., Los Angeles, CA 90021
 (213) 745-5312 FAX (213) 745-6372

 DATE: 11/9/19 PAGE 1 OF 1

 LOG BOOK NO. _____ FILE NO. _____ LAB NO. 1911202

CLIENT NAME: <u>COM</u>			Project Name/No. <u>Mulhurg Cemetery Spring Weekly</u>			P.O. NO. _____			AIRBILL NO: _____																																																																																																																											
ADDRESS: _____						ANALYSES REQUESTED: _____			COOLER TEMP: <u>1.1°C</u>																																																																																																																											
PROJECT MANAGER: <u>Tom Babin</u>			PHONE NO: _____			FAX NO: _____			PRESERVATIVE: _____																																																																																																																											
SAMPLER NAME: <u>John Babin</u> (Printed) <u>[Signature]</u> (Signature)						<div style="border: 1px solid black; padding: 5px;"> TAT (Analytical Turn Around Time): 0 = Same Day; 1 = 1 Day; 2 = 2 Days; 3 = 3 Days; N = Normal (5-7 Working Days) </div>			REMARKS: _____																																																																																																																											
CONTAINER TYPES: B = Brass, E = Encore, G = Glass, P = Plastic, V = VOA Vial, O = Other: _____																																																																																																																																				
UST Project: Y N - Global ID# _____																																																																																																																																				
<table border="1" style="width:100%; border-collapse: collapse;"> <thead> <tr> <th rowspan="2">SAMPLE NO.</th> <th rowspan="2">DATE SAMPLED</th> <th rowspan="2">TIME SAMPLED</th> <th rowspan="2">SAMPLE DESCRIPTION</th> <th colspan="4">MATRIX</th> <th rowspan="2">TAT</th> <th colspan="2">CONTAINER</th> </tr> <tr> <th>WATER</th> <th>SOIL</th> <th>SLUDGE</th> <th>OTHER</th> <th>#</th> <th>TYPE</th> </tr> </thead> <tbody> <tr> <td>1</td> <td>11/9/19</td> <td>2915</td> <td>Loaing Tower Boulevard</td> <td></td> <td></td> <td></td> <td></td> <td>121</td> <td>P</td> <td></td> </tr> <tr><td>2</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> <tr><td>3</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> <tr><td>4</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> <tr><td>5</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> <tr><td>6</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> <tr><td>7</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> <tr><td>8</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> <tr><td>9</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> <tr><td>10</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> </tbody> </table>												SAMPLE NO.	DATE SAMPLED	TIME SAMPLED	SAMPLE DESCRIPTION	MATRIX				TAT	CONTAINER		WATER	SOIL	SLUDGE	OTHER	#	TYPE	1	11/9/19	2915	Loaing Tower Boulevard					121	P		2											3											4											5											6											7											8											9											10				
SAMPLE NO.	DATE SAMPLED	TIME SAMPLED	SAMPLE DESCRIPTION	MATRIX				TAT	CONTAINER																																																																																																																											
				WATER	SOIL	SLUDGE	OTHER		#	TYPE																																																																																																																										
1	11/9/19	2915	Loaing Tower Boulevard					121	P																																																																																																																											
2																																																																																																																																				
3																																																																																																																																				
4																																																																																																																																				
5																																																																																																																																				
6																																																																																																																																				
7																																																																																																																																				
8																																																																																																																																				
9																																																																																																																																				
10																																																																																																																																				
Relinquished By: (Signature and Printed Name) <u>[Signature]</u>			Received By: (Signature and Printed Name) <u>[Signature]</u>			Date: <u>11-9-19</u> Time: <u>1020</u>			SAMPLE DISPOSITION: 1. Samples returned to client? YES NO 2. Samples will not be stored over 30 days, unless additional storage time is requested. 3. Storage time requested: _____ days By _____ Date _____																																																																																																																											
Relinquished By: (Signature and Printed Name) _____			Received By: (Signature and Printed Name) _____			Date: _____ Time: _____																																																																																																																														
Relinquished By: (Signature and Printed Name) _____			Received By: (Signature and Printed Name) _____			Date: _____ Time: _____																																																																																																																														
SPECIAL INSTRUCTIONS: _____																																																																																																																																				

 PRESERVATIVE: 1-HNO₃, 2-H₂SO₄, 3-HCL, 4-Zinc Acetate, 5-NaOH, 6-NH₄ Buffer, 7-Other

LAB COPY



781 East Washington Blvd., Los Angeles, CA 90021
(213) 745-5312 FAX (213) 745-6372

December 04, 2019

Tom Barnhart
Colorado Energy Management
4963 Soto St.
Vernon, CA 90058

Report No.: 1911311
Project Name: Malburg Generating Station Weekly

Dear Tom Barnhart,

This report contains the analytical results for the sample(s) received under chain of custody(s) by Positive Lab Service on November 25, 2019.

The test results in this report are performed in compliance with ELAP accreditation requirements for the certified parameters. The laboratory report may not be produced, except in full, without the written approval of the laboratory.

The issuance of the final Certificate of Analysis takes precedence over any previous Preliminary Report. Preliminary data should not be used for regulatory purposes. Authorized signature(s) is provided on final report only.

If you have any questions in reference to this report, please contact your Positive Lab Service coordinator.


Project Manager



781 East Washington Blvd., Los Angeles, CA 90021
[213] 745-5312 FAX [213] 745-6372

Certificate of Analysis

Page 2 of 2

Colorado Energy Management
4963 Soto St.
Vernon, CA 90058

Attn: Tom Barnhart

Phone: (323) 476-3626 FAX: (323) 476-3640

File #: 74548

Report Date: 12/04/19

Submitted: 11/25/19

PLS Report No.: 1911311

Project: Malburg Generating Station Weekly

Sample ID: Cooling Tower Blowdown Water (1911311-01) Sampled: 11/25/19 08:50 Received: 11/25/19 08:50

Analyte	Results	Flag	D.F.	Units	PQL	Prep/Test Method	Prepared	Analyzed	By	Batch
Total Dissolved Solids	3490		1	mg/L	5.0	- SM 2540C	11/26/19	11/27/19	dd	BL90425

Quality Control Data

Analyte	Result	PQL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Qualifier
Batch BL90425 - -										
Blank										
Prepared: 11/26/19 Analyzed: 11/27/19										
Total Dissolved Solids	ND	5.0	mg/L							
LCS										
Prepared: 11/26/19 Analyzed: 11/27/19										
Total Dissolved Solids	47.0	5.0	mg/L	50.00		94.0	80-120			
Duplicate										
Source: 1911311-01 Prepared: 11/26/19 Analyzed: 11/27/19										
Total Dissolved Solids	3670	5.0	mg/L		3490			4.94	5	

Notes and Definitions

NA Not Applicable
ND Analyte NOT DETECTED at or above the detection limit
NR Not Reported
MDL Method Detection Limit
PQL Practical Quantitation Limit

Environmental Laboratory Accreditation Program Certificate No. 1131, Mobile Lab No. 2534, LACSD No. 10138

Authorized Signature(s)



CHAIN OF CUSTODY AND ANALYSIS REQUEST

781 East Washington Blvd., Los Angeles, CA 90021
(213) 745-5312 FAX (213) 745-6372

DATE: 11-25-79 PAGE 1 OF 1

LOG BOOK NO. _____ FILE NO. _____ LAB NO. 1911311

CLIENT NAME: <u>CUM</u>		Project Name/No. <u>Malibu Casing Station Weekly</u>		P.O. NO. _____		AIRBILL NO: _____											
ADDRESS: _____				ANALYSES REQUESTED: _____		COOLER TEMP: <u>1.1°r</u>											
PROJECT MANAGER: <u>Tom Rainhart</u>		PHONE NO: _____		FAX NO: _____		PRESERVATIVE: _____											
SAMPLER NAME: <u>Tom Rainhart</u> (Printed) <u>TR</u> (Signature)						REMARKS: _____											
TAT (Analytical Turn Around Time): 0 = Same Day; 1 = 1 Day; 2 = 2 Days; 3 = 3 Days; N = Normal (5-7 Working Days)																	
CONTAINER TYPES: B = Brass, E = Encore, G = Glass, P = Plastic, V = VOA Vial, O = Other:																	
UST Project: Y N - Global ID# _____																	
SAMPLE NO.	DATE SAMPLED	TIME SAMPLED	SAMPLE DESCRIPTION	MATRIX				TAT	CONTAINER								SAMPLE CONDITION/CONTAINER /COMMENTS:
				WATER	SOIL	SLUDGE	OTHER		#	TYPE							
1	<u>11-25-79</u>	<u>0850</u>	<u>Casing Toner Blend</u>	<u>1</u>				<u>1</u>	<u>1</u>	<u>P</u>	<u>Y</u>						
2																	
3																	
4																	
5																	
6																	
7																	
8																	
9																	
10																	

Relinquished By: (Signature and Printed Name) <u>[Signature]</u>	Received By: (Signature and Printed Name) <u>[Signature]</u>	Date: <u>11-25-79</u>	Time: <u>11:25</u>	SAMPLE DISPOSITION: 1. Samples returned to client? YES NO 2. Samples will not be stored over 30 days, unless additional storage time is requested. 3. Storage time requested: _____ days By _____ Date _____
Relinquished By: (Signature and Printed Name)	Received By: (Signature and Printed Name)	Date:	Time:	
Relinquished By: (Signature and Printed Name)	Received By: (Signature and Printed Name)	Date:	Time:	

SPECIAL INSTRUCTIONS: _____

PRESERVATIVE: 1-HNO₃, 2-H₂SO₄, 3-HCL, 4-Zinc Acetate, 5-NaOH, 6-NH₄ Buffer, 7-Other



781 East Washington Blvd., Los Angeles, CA 90021
(213) 745-5312 FAX (213) 745-6372

December 11, 2019

Tom Barnhart
Colorado Energy Management
4963 Soto St.
Vernon, CA 90058

Report No.: 1912188
Project Name: Malburg Generating Station Weekly

Dear Tom Barnhart,

This report contains the analytical results for the sample(s) received under chain of custody(s) by Positive Lab Service on December 04, 2019.

The test results in this report are performed in compliance with ELAP accreditation requirements for the certified parameters. The laboratory report may not be produced, except in full, without the written approval of the laboratory.

The issuance of the final Certificate of Analysis takes precedence over any previous Preliminary Report. Preliminary data should not be used for regulatory purposes. Authorized signature(s) is provided on final report only.

If you have any questions in reference to this report, please contact your Positive Lab Service coordinator.


Project Manager



781 East Washington Blvd., Los Angeles, CA 90021
(213) 745-5312 FAX (213) 745-6372

Certificate of Analysis

Page 2 of 2

Colorado Energy Management
4963 Soto St.
Vernon, CA 90058

Attn: Tom Barnhart

Phone: (323) 476-3626 FAX:(323) 476-3640

File #:74548

Report Date: 12/11/19

Submitted: 12/04/19

PLS Report No.: 1912188

Project: Malburg Generating Station Weekly

Sample ID: Cooling Tower Blowdown Water (1912188-01) Sampled: 12/04/19 09:40 Received: 12/04/19 09:40											
Analyte	Results	Flag	D.F.	Units	PQL	Prep/Test Method	Prepared	Analyzed	By	Batch	
Total Dissolved Solids	4260		1	mg/L	5.0	- SM 2540C	12/05/19	12/06/19	dd	BL90924	


Quality Control Data


Analyte	Result	PQL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Qualifier
Batch BL90924 - -										
Blank Prepared: 12/05/19 Analyzed: 12/06/19										
Total Dissolved Solids	ND	5.0	mg/L							
LCS Prepared: 12/05/19 Analyzed: 12/06/19										
Total Dissolved Solids	47.0	5.0	mg/L	50.00		94.0	80-120			
Duplicate Source: 1912188-01 Prepared: 12/05/19 Analyzed: 12/06/19										
Total Dissolved Solids	4110	5.0	mg/L		4260			3.66	5	

Notes and Definitions

NA Not Applicable
ND Analyte NOT DETECTED at or above the detection limit
NR Not Reported
MDL Method Detection Limit
PQL Practical Quantitation Limit

Environmental Laboratory Accreditation Program Certificate No. 1131, Mobile Lab No. 2534, LACSD No. 10138


Authorized Signature(s)


POSITIVE
LAB SERVICE
CHAIN OF CUSTODY AND ANALYSIS REQUEST

 781 East Washington Blvd., Los Angeles, CA 90021
 (213) 745-5312 FAX (213) 745-6372

 DATE: 12/1/09 PAGE 4 OF 1
 LOG BOOK NO. _____ FILE NO. _____ LAB NO. 19124881

CLIENT NAME: <u>Cam</u>		Project Name/No. <u>Making Chemistry Station Weekly</u>		P.O. NO. _____		AIRBILL NO: _____					
ADDRESS: _____				ANALYSES REQUESTED: _____		COOLER TEMP: <u>1.4°C</u>					
PROJECT MANAGER: <u>Tom Bahner</u>		PHONE NO: _____		FAX NO: _____		PRESERVATIVE: _____					
SAMPLER NAME: <u>Tom Bahner</u> (Printed)		(Signature) _____				REMARKS: _____					
TAT (Analytical Turn Around Time): 0 = Same Day; 1 = 1 Day; 2 = 2 Days; 3 = 3 Days; N = Normal (5-7 Working Days)											
CONTAINER TYPES: B = Brass, E = Encore, G = Glass, P = Plastic, V = VOA Vial, O = Other:											
UST Project: Y N - Global ID# _____											
SAMPLE NO.	DATE SAMPLED	TIME SAMPLED	SAMPLE DESCRIPTION	MATRIX				TAT	CONTAINER		SAMPLE CONDITION/CONTAINER /COMMENTS:
				WATER	SOIL	SLUDGE	OTHER		#	TYPE	
1	<u>12/1/09</u>	<u>0942</u>	<u>Coating from Bladder</u>	<u>✓</u>				<u>1-1</u>	<u>✓</u>		
2											
3											
4											
5											
6											
7											
8											
9											
10											

Relinquished By: (Signature and Printed Name) _____
 Relinquished By: (Signature and Printed Name) _____
 Relinquished By: (Signature and Printed Name) _____

Received By: (Signature and Printed Name) _____
 Received By: (Signature and Printed Name) _____
 Received By: (Signature and Printed Name) _____

Date: 12/1/09 Time: 1135
 Date: _____ Time: _____
 Date: _____ Time: _____

SAMPLE DISPOSITION:
 1. Samples returned to client? YES NO
 2. Samples will not be stored over 30 days, unless additional storage time is requested.
 3. Storage time requested: _____ days
 By _____ Date _____

SPECIAL INSTRUCTIONS: _____

 PRESERVATIVE: 1-HNO₃, 2-H₂SO₄, 3-HCL, 4-Zinc Acetate, 5-NaOH, 6-NH₄ Buffer, 7-Other

LAB COPY



781 East Washington Blvd., Los Angeles, CA 90021
(213) 745-5312 FAX (213) 745-6372

December 17, 2019

Tom Barnhart
Colorado Energy Management
4963 Soto St.
Vernon, CA 90058

Report No.: 1912352
Project Name: Malburg Generating Station Weekly


Dear Tom Barnhart,

This report contains the analytical results for the sample(s) received under chain of custody(s) by Positive Lab Service on December 10, 2019.

The test results in this report are performed in compliance with ELAP accreditation requirements for the certified parameters. The laboratory report may not be produced, except in full, without the written approval of the laboratory.

The issuance of the final Certificate of Analysis takes precedence over any previous Preliminary Report. Preliminary data should not be used for regulatory purposes. Authorized signature(s) is provided on final report only.

If you have any questions in reference to this report, please contact your Positive Lab Service coordinator.



Project Manager



781 East Washington Blvd., Los Angeles, CA 90021
[213] 745-5312 FAX [213] 745-6372

Certificate of Analysis

Page 2 of 2

Colorado Energy Management
4963 Soto St.
Vernon, CA 90058

Attn: Tom Barnhart

Phone: (323) 476-3626 FAX: (323) 476-3640

File #: 74548

Report Date: 12/17/19

Submitted: 12/10/19

PLS Report No.: 1912352

Project: Malburg Generating Station Weekly

Sample ID: Cooling Tower Blowdown Water (1912352-01) **Sampled:** 12/10/19 09:30 **Received:** 12/10/19 09:30

Analyte	Results	Flag	D.F.	Units	PQL	Prep/Test Method	Prepared	Analyzed	By	Batch
Total Dissolved Solids	4580		1	mg/L	5.0	- SM 2540C	12/12/19	12/13/19	dd	BL91744


Quality Control Data

Analyte	Result	PQL	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Qualifier
Batch BL91744 - -										
Blank										
Prepared: 12/12/19 Analyzed: 12/13/19										
Total Dissolved Solids	ND	5.0	mg/L							
LCS										
Prepared: 12/12/19 Analyzed: 12/13/19										
Total Dissolved Solids	50.0	5.0	mg/L	50.00		100	80-120			
Duplicate										
Source: 1912352-01 Prepared: 12/12/19 Analyzed: 12/13/19										
Total Dissolved Solids	4670	5.0	mg/L		4580			2.13	5	

Notes and Definitions

NA Not Applicable
ND Analyte NOT DETECTED at or above the detection limit
NR Not Reported
MDL Method Detection Limit
PQL Practical Quantitation Limit

Environmental Laboratory Accreditation Program Certificate No. 1131, Mobile Lab No. 2534, LACSD No. 10138


Authorized Signature(s)



CHAIN OF CUSTODY AND ANALYSIS REQUEST

 781 East Washington Blvd., Los Angeles, CA 90021
 (213) 745-5312 FAX (213) 745-6372

DATE: 12/19/19 PAGE 1 OF 1

LOG BOOK NO. _____ FILE NO. _____ LAB NO. 1912752

CLIENT NAME: <u>CEM</u>				Project Name/No. <u>Mr / Mrs / Corporation / Station Weekly</u>				P.O. NO. _____				AIRBILL NO: _____																																																																																			
ADDRESS: _____								ANALYSES REQUESTED: _____				COOLER TEMP: <u>1/42</u>																																																																																			
PROJECT MANAGER: <u>JON Reinhardt</u>				PHONE NO: _____				FAX NO: _____				PRESERVATIVE: _____																																																																																			
SAMPLER NAME: <u>J. Reinhardt</u> (Printed) <u>[Signature]</u> (Signature)								<table border="1" style="width:100%; height: 100px;"> <tr><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> <tr><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> <tr><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> <tr><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> </table>																																																																																				REMARKS: _____			
TAT (Analytical Turn Around Time): 0 = Same Day; 1 = 1 Day; 2 = 2 Days; 3 = 3 Days; N = Normal (5-7 Working Days)																																																																																															
CONTAINER TYPES: B = Brass, E = Encore, G = Glass, P = Plastic, V = VOA Vial, O = Other:																																																																																															
UST Project: Y N - Global ID# _____																																																																																															
SAMPLE NO.	DATE SAMPLED	TIME SAMPLED	SAMPLE DESCRIPTION	MATRIX				TAT	CONTAINER										SAMPLE CONDITION/ CONTAINER /COMMENTS:																																																																												
				WATER	SOIL	SLUDGE	OTHER		#	TYPE																																																																																					
1	12/19/19	0930	Cooling Pond Sludge	X					N1	P	6																																																																																				
2																																																																																															
3																																																																																															
4																																																																																															
5																																																																																															
6																																																																																															
7																																																																																															
8																																																																																															
9																																																																																															
10																																																																																															

Relinquished By: (Signature and Printed Name)	Received By: (Signature and Printed Name)	Date: 12/19/19	Time: 0930
Relinquished By: (Signature and Printed Name)	Received By: (Signature and Printed Name)	Date: _____	Time: _____
Relinquished By: (Signature and Printed Name)	Received By: (Signature and Printed Name)	Date: _____	Time: _____

SPECIAL INSTRUCTIONS: _____

SAMPLE DISPOSITION:
 1. Samples returned to client? YES NO
 2. Samples will not be stored over 30 days, unless additional storage time is requested.
 3. Storage time requested: _____ days
 By _____ Date _____

PRESERVATIVE: 1-HNO₃, 2-H₂SO₄, 3-HCL, 4-Zinc Acetate, 5-NaOH, 6-NH₄ Buffer, 7-Other

LAB COPY

Appendix B

Excess Emission Reports

Excess Emission Report

Unit 1 - NOx ppmvdc 1-hour during Normal Operation

From: 10/01/2019 00:00 To: 12/31/2019 23:59
Generated: 01/27/2020 13:59

Facility Name: Malburg Generating Station
Location: Vernon, California



Tag Name: U1_NOxNormal_Ppmvdc_1H

Total Operating Time: 1,939.00 Hour(s)

No Exclusions Allowed

Non-Operating Time: 269.00 Hour(s) Report Time: 2,208.00 Hour(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

Total Operating Time:	1,939.00 Hour(s)
Total Duration (Online only):	0.00 Hour(s)
Time in exceedance as a percentage of operating time:	0.00 %
Time in compliance as a percentage of operating time:	100.00 %

Excess Emission Report

Unit 1 - VOC ppmvdc 1-hour during Normal Operation

From: 10/01/2019 00:00 To: 12/31/2019 23:59

Generated: 01/27/2020 14:01

Facility Name:

Malburg Generating Station

Location:

Vernon, California



Tag Name: U1_VOCNormal_Ppmvdc_1H

Total Operating Time: 1,939.00 Hour(s)

No Exclusions Allowed

Non-Operating Time: 269.00 Hour(s) Report Time: 2,208.00 Hour(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

Total Operating Time:	1,939.00 Hour(s)
Total Duration (Online only):	0.00 Hour(s)
Time in exceedance as a percentage of operating time:	0.00 %
Time in compliance as a percentage of operating time:	100.00 %

Excess Emission Report

Unit 1 - CO ppmvdc 1-hour during Normal Operation

From: 10/01/2019 00:00 To: 12/31/2019 23:59 Facility Name: Malburg Generating Station
Generated: 01/27/2020 14:02 Location: Vernon, California



Tag Name: U1_CONormal_Ppmvdc_1H

Total Operating Time: 1,939.00 Hour(s)

No Exclusions Allowed

Non-Operating Time: 269.00 Hour(s) Report Time: 2,208.00 Hour(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

Total Operating Time:	1,939.00 Hour(s)
Total Duration (Online only):	0.00 Hour(s)
Time in exceedance as a percentage of operating time:	0.00 %
Time in compliance as a percentage of operating time:	100.00 %

Quad K Excess Emissions Report

U1 NOX 4-Hour Events

From: 10/01/2019 00:00 To: 12/31/2019 23:59
Generated: 01/27/2020 14:03

Facility Name: Malburg Generating Station
Location: Vernon, California



Tag Name: U1_NOx4H_Ppmvdc_1H

Total Operating Time: 1,939.00 Hour(s)

No Exclusions Allowed

Non-Operating Time: 269.00 Hour(s) Report Time: 2,208.00 Hour(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

Total Operating Time:	1,939.00 Hour(s)
Total Duration (Online only):	0.00 Hour(s)
Time in exceedance as a percentage of operating time:	0.00 %
Time in compliance as a percentage of operating time:	100.00 %

Startup/Shutdown Excess Emissions Report

U1 NOX Startup/Shutdown



From: 10/01/2019 00:00 **To:** 12/31/2019 23:59 **Facility Name:** Malburg Generating Station
Generated: 01/27/2020 14:10 **Location:** Vernon, California
Tag Name: U1_NOx_LbPerHr_1M SI = SampleInvalid, * = Excess Emission

Total Operating Time: 1,939 Hours
Non-Operating Time: 269 Hours **Report Time:** 2,208 Hours

Unit Operation and Excess Events

Event Period				Reason	Action
Begin/End	Duration in Minute(s)	Lb/Event	Limit	Code - Description	Code - Description

No excess emissions were found in the reporting period.

Startup/Shutdown Excess Emissions Report

U1 VOC Startup/Shutdown



From: 10/01/2019 00:00 **To:** 12/31/2019 23:59 **Facility Name:** Malburg Generating Station
Generated: 01/27/2020 14:11 **Location:** Vernon, California
Tag Name: U1_VOC_LbPerHr_1M SI = SampleInvalid, * = Excess Emission

Total Operating Time: 1,939 Hours
Non-Operating Time: 269 Hours **Report Time:** 2,208 Hours

Unit Operation and Excess Events

Event Period				Reason	Action
Begin/End	Duration in Minute(s)	Lb/Event	Limit	Code - Description	Code - Description

No excess emissions were found in the reporting period.

Startup/Shutdown Excess Emissions Report

U1 CO Startup/Shutdown



From: 10/01/2019 00:00 To: 12/31/2019 23:59 Facility Name: Malburg Generating Station
Generated: 01/29/2020 06:18 Location: Vernon, California
Tag Name: U1_CO_LbPerHr_1M
SI = SampleInvalid, * = Excess Emission

Total Operating Time: 1,939 Hours
Non-Operating Time: 269 Hours Report Time: 2,208 Hours

Unit Operation and Excess Events

Event Period				Reason	Action
Begin/End	Duration in Minute(s)	Lb/Event	Limit	Code - Description	Code - Description

No excess emissions were found in the reporting period.

Excess Emission Report

Unit 2 - NOx ppmvdc 1-hour during Normal Operation

From: 10/01/2019 00:00 To: 12/31/2019 23:59

Generated: 01/27/2020 14:04

Facility Name:

Malburg Generating Station

Location:

Vernon, California



Tag Name: U2_NOxNormal_Ppmvdc_1H

Total Operating Time: 2,028.00 Hour(s)

No Exclusions Allowed

Non-Operating Time: 180.00 Hour(s) Report Time: 2,208.00 Hour(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

Total Operating Time:	2,028.00 Hour(s)
Total Duration (Online only):	0.00 Hour(s)
Time in exceedance as a percentage of operating time:	0.00 %
Time in compliance as a percentage of operating time:	100.00 %

Excess Emission Report

Unit 2 - VOC ppmvdc 1-hour during Normal Operation

From: 10/01/2019 00:00 To: 12/31/2019 23:59
Generated: 01/27/2020 14:05

Facility Name: Malburg Generating Station
Location: Vernon, California



Tag Name: U2_VOCNormal_Ppmvdc_1H

Total Operating Time: 2,028.00 Hour(s)

No Exclusions Allowed

Non-Operating Time: 180.00 Hour(s) Report Time: 2,208.00 Hour(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

Total Operating Time:	2,028.00 Hour(s)
Total Duration (Online only):	0.00 Hour(s)
Time in exceedance as a percentage of operating time:	0.00 %
Time in compliance as a percentage of operating time:	100.00 %

Excess Emission Report

Unit 2 - CO ppmvdc 1-hour during Normal Operation

From: 10/01/2019 00:00 To: 12/31/2019 23:59 Facility Name: Malburg Generating Station
Generated: 01/27/2020 14:08 Location: Vernon, California



Tag Name: U2_CONormal_Ppmvdc_1H

Total Operating Time: 2,028.00 Hour(s)

No Exclusions Allowed

Non-Operating Time: 180.00 Hour(s) Report Time: 2,208.00 Hour(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

Total Operating Time:	2,028.00 Hour(s)
Total Duration (Online only):	0.00 Hour(s)
Time in exceedance as a percentage of operating time:	0.00 %
Time in compliance as a percentage of operating time:	100.00 %

Quad K Excess Emissions Report

U2 NOX 4-Hour Events

From: 10/01/2019 00:00 To: 12/31/2019 23:59
Generated: 01/27/2020 14:06

Facility Name: Malburg Generating Station
Location: Vernon, California



Tag Name: U2_NOx4H_Ppmvdc_1H

Total Operating Time: 2,028.00 Hour(s)

No Exclusions Allowed

Non-Operating Time: 180.00 Hour(s) Report Time: 2,208.00 Hour(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

Total Operating Time:	2,028.00 Hour(s)
Total Duration (Online only):	0.00 Hour(s)
Time in exceedance as a percentage of operating time:	0.00 %
Time in compliance as a percentage of operating time:	100.00 %

Startup/Shutdown Excess Emissions Report

U2 NOX Startup/Shutdown



From: 10/01/2019 00:00 **To:** 12/31/2019 23:59 **Facility Name:** Malburg Generating Station
Generated: 01/27/2020 14:14 **Location:** Vernon, California
Tag Name: U2_NOx_LbPerHr_1M SI = SampleInvalid, * = Excess Emission

Total Operating Time: 2,028 Hours
Non-Operating Time: 180 Hours **Report Time:** 2,208 Hours

Unit Operation and Excess Events

Event Period				Reason	Action
Begin/End	Duration in Minute(s)	Lb/Event	Limit	Code - Description	Code - Description

No excess emissions were found in the reporting period.

Startup/Shutdown Excess Emissions Report

U2 VOC Startup/Shutdown



From: 10/01/2019 00:00 **To:** 12/31/2019 23:59 **Facility Name:** Malburg Generating Station
Generated: 01/27/2020 14:19 **Location:** Vernon, California
Tag Name: U2_VOC_LbPerHr_1M SI = SampleInvalid, * = Excess Emission

Total Operating Time: 2,028 Hours
Non-Operating Time: 180 Hours **Report Time:** 2,208 Hours

Unit Operation and Excess Events

Event Period				Reason	Action
Begin/End	Duration in Minute(s)	Lb/Event	Limit	Code - Description	Code - Description

No excess emissions were found in the reporting period.

Startup/Shutdown Excess Emissions Report

U2 CO Startup/Shutdown



From: 10/01/2019 00:00 **To:** 12/31/2019 23:59 **Facility Name:** Malburg Generating Station
Generated: 01/27/2020 14:11 **Location:** Vernon, California
Tag Name: U2_CO_LbPerHr_1M SI = SampleInvalid, * = Excess Emission

Total Operating Time: 2,028 Hours
Non-Operating Time: 180 Hours **Report Time:** 2,208 Hours

Unit Operation and Excess Events

Event Period				Reason	Action
Begin/End	Duration in Minute(s)	Lb/Event	Limit	Code - Description	Code - Description

No excess emissions were found in the reporting period.

Appendix C

Diesel Fuel Oil Specifications



CHEVRON GST[®] OILS

ISO 32, 46, 68, 100

CUSTOMER BENEFITS

Chevron GST Oils deliver value through:

- **Superior oxidation stability** for long service life at elevated temperatures.
- **Rust and corrosion protection**
- **High viscosity index** assures minimum viscosity change when variations in temperature occur.
- **Minimum foam** prevents sump overflow or erratic governor operation.
- **Fast air release** minimizes possibility of pump cavitation in systems with high circulation rates and small reservoirs.
- **Superior thermal stability** minimizes deposit formation.
- **Rapid water separation** keeps water in oil to a minimum.
- **Hydraulic fluid service** — Chevron GST Oils ISO 32, 46, and 68 are excellent hydraulic fluids in low pressure systems up to 1000 psi.
- **Air compressor** lubricant when OEM recommends R&O type oil.
- **Environmental benefits** — All grades are ashless. This facilitates reclaiming and recycling of the used oils. Chevron GST Oils are not expected to be harmful to aquatic organisms.

FEATURES

Chevron GST Oils are designed to meet the critical demands of:

- gas, steam, and hydroelectric turbine bearing lubrication
- reduction gear lubrication in marine operations

They are an excellent recommendation for many other industrial applications including air compression.

Chevron GST Oils are formulated with ISOSYN[®] base stocks.

Higher temperatures in advanced gas and steam turbines require a circulating system oil with exceptional high temperature stability. Chevron GST Oils have outstanding **thermal and oxidation stability**.

Nonvolatile **oxidation inhibition** minimizes the evaporative loss of the inhibitors, a common problem with turbine oils where bearing temperatures are high and system capacities are limited. With retained oxidation resistance for long periods under high temperature conditions, Chevron GST Oils have proven they will provide longer oil service life and reduced turbine down time.

Corrosion inhibition protects costly turbine shafts and gears from corrosion and rusting.

Chevron GST Oils have excellent demulsibility characteristics which allow these oils to maintain a high film strength coating on critical wear points of bearings and gear reducers and assure fast removal of water contamination.

Foam inhibition prevents sump overflow and erratic governor operation.



APPLICATIONS

Chevron GST Oils are recommended for use in turbines of all types including gas, steam, and hydroelectric turbines, and marine gear turbine sets.

The following viscosity grades are formulated to meet the specified OEM requirements:

Chevron GST Oil ISO 32

- meets and exceeds
 - **General Electric** GEK-32568f, GEK 28143A, GEK-46506D, GEK-27070
 - **Ingersoll Rand** specification for Centac Centrifugal Compressors
 - **Solar** ES 9 224 requirements for gas turbine oils
 - **ASTM D4304, British Standard 489, and DIN 51515** standard organization requirements for new lubricants used in gas and steam turbines and auxiliary equipment
- is approved by
 - **Cincinnati Machine** P-38
 - **Alstom Power** HTGD 90117
 - **Siemens Westinghouse** M spec 55125Z3
 - **Siemens** TLV 901304

Chevron GST Oil ISO 46

- meets
 - **General Electric** and **Westinghouse** requirements for marine gas turbine system oils. Recommended by Siemens Westinghouse for reactor coolant pump motor bearings.
 - **Siemens** TLV 901304
 - **Solar** ES 9 224 requirements for gas turbine oils
 - **ASTM D4304, British Standard 489, and DIN 51515** standard organization requirements for new lubricants used in gas and steam turbines and auxiliary equipment
- is approved by
 - **Cincinnati Machine** P 55
 - **Alstom Power** HTGD 90117

Chevron GST Oil ISO 68

- meets
 - meets **General Electric, Alstom, Westinghouse**, and other OEM requirements for hydroelectric turbines, land and marine steam turbines, and associated reduction gears
 - **ASTM D4304, British Standard 489, and DIN 51515** standard organization requirements for new lubricants used in gas and steam turbines and auxiliary equipment
- is approved by
 - **Cincinnati Machine** P-54

Chevron GST Oil ISO 100

- meets
 - meets **General Electric, Alstom, Westinghouse**, and other OEM requirements for hydroelectric turbines, land and marine steam turbines, and associated reduction gears
 - **ASTM D4304, British Standard 489, and DIN 51515** standard organization requirements for new lubricants used in gas and steam turbines and auxiliary equipment

Chevron GST Oils ISO 32, 46, 68, and 100 are registered with NSF and are acceptable as lubricants where there is no possibility of food contact (H2) in and around food processing areas. The NSF Nonfood Compounds Registration Program is a continuation of the USDA product approval and listing program, which is based on meeting regulatory requirements of appropriate use, ingredient review and labeling verification.

Do not use in high pressure systems in the vicinity of flames, sparks and hot surfaces. Use only in well ventilated areas. Keep container closed.

Do not use in breathing air apparatus or medical equipment.

TYPICAL TEST DATA

ISO Grade	32	46	68	100
CPS Number	253026	253027	253028	253029
MSDS Number	6710	6710	6710	6710
AGMA Grade	—	1	2	3
API Gravity	32.7	32.0	31.7	31.4
Viscosity, Kinematic cSt at 40°C cSt at 100°C	30.4 5.2	43.7 6.6	64.6 8.5	95.0 11.0
Viscosity, Saybolt SUS at 100°F SUS at 210°F	157 43.8	225 48.2	334 54.8	495 63.9
Viscosity Index	102	101	102	100
Flash Point, °C(°F)	222(432)	224(435)	245(473)	262(504)
Pour Point, °C(°F)	-36(-33)	-36(-33)	-33(-27)	-30(-22)
Oxidation Stability ASTM D 943 ¹ ASTM D 2272 ²	17,000 1700	12,000 1400	11,000 1400	11,000 1400
FZG, Pass stage, DIN 51354	—	—	—	—

Typical test data are average values only. Minor variations which do not affect product performance are to be expected in normal manufacturing.

- 1 Hours to 2.0 mg KOH/g acid number modified D943
- 2 Minutes to 25 psi pressure drop



Invoice

Page 1 of 1

Southern Counties Oil Co, a Ca LP
1800 West Katella Ave, Suite 400, P.O. Box 4159, Orange, CA 92863-4159

PLEASE REMIT ALL PAYMENTS TO:

P.O. BOX 14237

ORANGE, CA 92863-1237

Ph:(800) 659-5823 Fax:(714) 992-7377 Credit Inquiries:(888) 364-0121

ACCT NO (Bill-to): 01-0001084

COLORADO ENERGY MANAGEMENT LLC
ATTN: ACCOUNTS PAYABLE
4963 S. SOTO STREET
VERNON, CA 90058
(323) 476-3622

SHIP TO: 1L CUST NO: 01-0001084
COLORADO ENERGY MANAGEMENT LLC
4963 SOTO STREET
VERNON, CA 90058

INVOICE 1427153-IN	DUE DATE 6/19/2019
INVOICE DATE 5/20/2019	SHIP DATE 5/20/2019
ORDER DATE 5/15/2019	SHIP VIA 924
CUSTOMER PO MGS16324	ORDER NUMBER 1427153
TERMS N30	SALESMAN Todd Cripps

Please direct any questions regarding this invoice to:
CSS@scfuels.com

UNIT	ITEM CODE	ITEM DESCRIPTION	QUANTITY DELIVERED	PACKAGE DESCRIPTION	EXTENDED QTY	UNIT PRICE	EXT PRICE
D055	422D055	CARB ULTRA L.S. DYED DIESEL	2.00	55 GAL DRM	110.00	4.30000	473.00
		Whse: 101					
		UN1202, DIESEL FUEL, 3, PG III - NONTAXABLE USE ONLY, PENALTY FOR TAXABLE USE					
		Federal Lust				0.00100	0.11
		CA - AB 32 - DSL				0.00704	0.77
						4.30804	473.88
D400	CH277210983D400	MEROPA 150 NRD#LT	1.00	400 LB DRM	400.00	2.78000	1,112.00
		Whse: 101					
C001	DRUMDEPOSITC0 01	DRUM DEPOSIT FEE	2.00	MISC CHRG	2.00	25.00000	50.00
		Whse: 101					
	/FUELCH	FUEL SURCHARGE					9.92
	/RCF	REGULATORY COMPLIANCE FEE					12.95

Net Invoice:	1,658.75
Less Discount:	0.00
Freight:	0.00
Sales Tax:	152.82
Invoice Total:	1,811.57

Save time, pay online! View invoices, make payments and more.
Sign up for the Customer Portal today. <https://customerportal.scfuels.com>

SC Fuels
P.O. Box 14237
Orange, CA 92863-1237
Tel: 800-659-5823
Fax: 714-992-7377
Credit Inquiries: 888-364-0121



Order#: 1427153
Order Date: 5/15/2019
Delv Req Date: 5/20/2019
Sales Person: 0177 - Todd Cripps

SOLD TO: 01-0001084
COLORADO ENERGY MANAGEMENT LLC
ATTN: ACCOUNTS PAYABLE
4963 S. SOTO STREET
VERNON, CA 90058
(323) 476-3622

SHIP TO: 1L
COLORADO ENERGY MANAGEMENT LLC
4963 SOTO STREET
VERNON, CA 90058
(323) 476-3632

Confirm To: ASHLEY HURD

Customer PO: MGS16324

Ship Via:

Whse: 101

Terms: N30

HM	Product Code / Desc / Svc Type	Qty Ordered / Package Desc	Ext Qty Ordered	Qty Delivered	Unit Price	Extended Amount
X	UN1202, DIESEL FUEL, 3, PG III - NONTAXABLE USE ONLY, PENALTY FOR TAXABLE USE					
	422D055 30	2.00 55 GAL DRM	110.00 GALS	2		
	CARB ULTRA L.S. DYED DIESEL					
	CH277210983D400 30	1.00 400 LB DRM	400.00 LBS	1		
	MEROPA 150 NRD#LT					
	DRUMDEPOSITC001 30	2.00 MISC CHRG	2.00 EACH	2		
	DRUM DEPOSIT FEE					
	/FUELCH 30		0.00			
	FUEL SURCHARGE					
	/RCF 30		0.00			
	REGULATORY COMPLIANCE FEE					

Received in INFOR
5/20/19
M. Gordon

Rec'd by [Signature] Date 5/20/19

Print Name Michael Gordon

Driver's Signature [Signature]

ARRIVED LOAD POINT		AM	DATE	COMPLETED LOADING		AM	DATE	TRUCK #	B/L #	FOR COMPANY USE ONLY	
		PM				PM				RT <input type="checkbox"/> TF <input type="checkbox"/> OP <input type="checkbox"/>	
ARRIVED DESTINATION		AM	DATE	COMPLETED UNLOADING		AM	DATE	D.O.T. HAZARDOUS MATERIALS PLACARD PROVIDED			
		PM				PM		BY SHIPPER <input type="checkbox"/> CARRIER <input type="checkbox"/>			
END TANK	GAS	DIESEL	OTHER	WATER DETECTED ?		THIS IS TO CERTIFY THAT THE ABOVE NAMED MATERIALS ARE PROPERLY CLASSIFIED, DESCRIBED, PACKAGED, MARKED AND LABELED AND ARE IN PROPER CONDITION FOR TRANSPORTATION ACCORDING TO APPLICABLE REGULATIONS OF THE DEPARTMENT OF TRANSPORTATION.					
				<input type="checkbox"/> YES <input type="checkbox"/> NO							
BEGINNING TANK	GAS	DIESEL	OTHER	DRUM DEPOSIT		DRUM CREDIT					

IN THE EVENT OF A HAZARDOUS MATERIALS INCIDENT - CALL 1-800-424-9300

FOR CHEMICAL EMERGENCY
Spill, Leak, Fire Exposure or Accident
CALL CHEMTREC - DAY OR NIGHT
800-424-9300

SC Fuels
P.O. Box 14237
Orange, CA 92863-1237
Tel: 800-659-5823
Fax: 714-992-7377
Credit Inquiries: 888-364-0121



SALES QUOTE

Order#: 1427153
Order Date: 5/15/2019
Delv Req Date: 12/31/5999
Sales Person: 0177 - Todd Cripps

SOLD TO: 01-0001084
COLORADO ENERGY MANAGEMENT LLC
ATTN: ACCOUNTS PAYABLE
4963 S. SOTO STREET
VERNON, CA 90058
(323) 476-3622

SHIP TO: 1L
COLORADO ENERGY MANAGEMENT LLC
4963 SOTO STREET
VERNON, CA 90058
(323) 476-3632

Confirm To: ASHLEY HURD

Customer PO:

Ship Via:

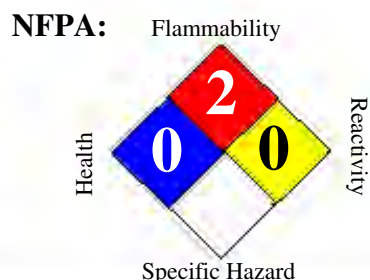
Whse: 101

Terms: N30

HM	Product Code / Desc / Svc Type	Qty Ordered / Package Desc	Ext Qty Ordered	Qty Delivered	Unit Price	Extended Amount
X	UN1202, DIESEL FUEL, 3, PG III - NONTAXABLE USE ONLY, PENALTY FOR TAXABLE USE					
	422D055 30	2.00 55 GAL DRM	110.00 GALS		4.30000	473.00
	CARB ULTRA L.S. DYED DIESEL					
	Federal Lust	N10630			0.00100	0.11
	CA - AB 32 - DSL				0.00704	0.77
					4.30804	473.88
	CH277210983D400 30	1.00 400 LB DRM	400.00 LBS		2.78000	1,112.00
	MEROPA 150 NRD#LT					
	Royal Purple Synfilm GT 100 \$49.18/gal					
	DRUMDEPOSITC001 30	2.00 MISC CHRG	2.00 EACH		25.00000	50.00
	DRUM DEPOSIT FEE					
	/FUELCH 30		0.00			9.92
	FUEL SURCHARGE					
	/RCF 30		0.00			12.95
	REGULATORY COMPLIANCE FEE					

Material Safety Data Sheet

Diesel Low Sulfur (LSD) and Ultra Low Sulfur Diesel (ULSD)



HMIS III:

HEALTH	1
FLAMMABILITY	2
PHYSICAL	0

0 = Insignificant, 1 = Slight, 2 = Moderate, 3 = High, 4 = Extreme

SECTION 1. PRODUCT AND COMPANY IDENTIFICATION

Product name	:	Diesel Low Sulfur (LSD) and Ultra Low Sulfur Diesel (ULSD)			
Synonyms	:	CARB Diesel, 888100004478			
MSDS Number	:	888100004478	Version	:	2.10
Product Use Description	:	Fuel			
Company	:	For: Tesoro Refining & Marketing Co. 19100 Ridgewood Parkway, San Antonio, TX 78259			
Tesoro Call Center	:	(877) 783-7676	Chemtrec (Emergency Contact)	:	(800) 424-9300

SECTION 2. HAZARDS IDENTIFICATION

Emergency Overview

Regulatory status	: This material is considered hazardous by the Occupational Safety and Health Administration (OSHA) Hazard Communication Standard (29 CFR 1910.1200).
Signal Word	: WARNING
Hazard Summary	: Toxic. Combustible Liquid

Potential Health Effects

Eyes	: Eye irritation may result from contact with liquid, mists, and/or vapors.
Inhalation	: Vapors or mists from this material can irritate the nose, throat, and lungs, and can cause signs and symptoms of central nervous system depression, depending on the concentration and duration of exposure.
Skin	: Skin irritation leading to dermatitis may occur upon prolonged or repeated contact. Liquid may be absorbed through the skin in toxic amounts if large areas of skin are repeatedly exposed. Long-term, repeated skin contact may cause skin cancer
Ingestion	: Harmful or fatal if swallowed. Do NOT induce vomiting. This material can irritate the mouth, throat, stomach, and cause nausea, vomiting, diarrhea and restlessness Aspiration hazard if liquid is inhaled into lungs, particularly from vomiting after ingestion. Aspiration may result in chemical pneumonia, severe lung damage, respiratory failure and even death.

Target Organs : Central nervous system, Eyes, Skin, Kidney, Liver

SECTION 3. COMPOSITION/INFORMATION ON INGREDIENTS

Component	CAS-No.	Weight %
Fuels, diesel, No 2; Gasoil - unspecified	68476-34-6	100%
Nonane	111-84-2	0 - 5%
Naphthalene	91-20-3	0 - 1%
1,2,4-Trimethylbenzene	95-63-6	0 - 2%
Xylene	1330-20-7	0 - 2%
Sulfur	7704-34-9	15 ppm maximum

SECTION 4. FIRST AID MEASURES

Inhalation	: Move to fresh air. Give oxygen. If breathing is irregular or stopped, administer artificial respiration. Seek medical attention immediately.
Skin contact	: Take off all contaminated clothing immediately. Wash off immediately with soap and plenty of water. Wash contaminated clothing before re-use. If skin irritation persists, seek medical attention immediately.
Eye contact	: Remove contact lenses. Rinse thoroughly with plenty of water for at least 15 minutes. If symptoms persist, seek medical attention.
Ingestion	: Do not induce vomiting without medical advice. If a person vomits when lying on his back, place him in the recovery position. Seek medical attention immediately.
Notes to physician	: Symptoms: Dizziness, Discomfort, Headache, Nausea, Disorder, Vomiting, Lung edema, Aspiration may cause pulmonary edema and pneumonitis, Liver disorders, Kidney disorders.

SECTION 5. FIRE-FIGHTING MEASURES

Form	: Liquid
Flash point	: 38°C Minimum for #1 Diesel, 52°C Minimum for #2 Diesel
Auto Ignition temperature	: 257 °C (495 °F)
Lower explosive limit	: 0.6 %(V)
Upper explosive limit	: 4.7 %(V)
Suitable extinguishing media	: Carbon dioxide (CO2), Water spray, Dry chemical, Foam, Keep containers and surroundings cool with water spray.
Specific hazards during fire fighting	: Fire Hazard Do not use a solid water stream as it may scatter and spread fire. Cool closed containers exposed to fire with water spray.
Special protective equipment	: Wear self-contained breathing apparatus and protective suit. Use personal

for fire-fighters	protective equipment.
Further information	: Exposure to decomposition products may be a hazard to health. Isolate area around container involved in fire. Cool tanks, shells, and containers exposed to fire and excessive heat with water. For massive fires the use of unmanned hose holders or monitor nozzles may be advantageous to further minimize personnel exposure. Major fires may require withdrawal, allowing the tank to burn. Large storage tank fires typically require specially trained personnel and equipment to extinguish the fire, often including the need for properly applied fire fighting foam.

SECTION 6. ACCIDENTAL RELEASE MEASURES

Personal precautions	: Evacuate nonessential personnel and remove or secure all ignition sources. Consider wind direction; stay upwind and uphill, if possible. Evaluate the direction of product travel, diking, sewers, etc. to contain spill areas. Spills may infiltrate subsurface soil and groundwater; professional assistance may be necessary to determine the extent of subsurface impact. Ensure adequate ventilation. Use personal protective equipment.
Environmental precautions	: Carefully contain and stop the source of the spill, if safe to do so. Protect bodies of water by diking, absorbents, or absorbent boom, if possible. Do not flush down sewer or drainage systems, unless system is designed and permitted to handle such material. The use of fire fighting foam may be useful in certain situations to reduce vapors. The proper use of water spray may effectively disperse product vapors or the liquid itself, preventing contact with ignition sources or areas/equipment that require protection. Discharge into the environment must be avoided. If the product contaminates rivers and lakes or drains inform respective authorities.
Methods for cleaning up	: Take up with sand or oil absorbing materials. Carefully shovel, scoop or sweep up into a waste container for reclamation or disposal - caution, flammable vapors may accumulate in closed containers. Response and clean-up crews must be properly trained and must utilize proper protective equipment (see Section 8).

CERCLA Hazardous substances and corresponding RQs :

Xylene	1330-20-7	100 lbs
Naphthalene	91-20-3	100 lbs
Nonane	111-84-2	100 lbs

SECTION 7. HANDLING AND STORAGE

Handling	: Keep away from fire, sparks and heated surfaces. No smoking near areas where material is stored or handled. The product should only be stored and handled in areas with intrinsically safe electrical classification.
Advice on protection against fire and explosion	: Hydrocarbon liquids including this product can act as a non-conductive flammable liquid (or static accumulators), and may form ignitable vapor-air mixtures in storage tanks or other containers. Precautions to prevent static-initated fire or explosion during transfer, storage or handling, include but are not limited to these examples: <ol style="list-style-type: none"> (1) Ground and bond containers during product transfers. Grounding and bonding may not be adequate protection to prevent ignition or explosion of hydrocarbon liquids and vapors that are static accumulators. (2) Special slow load procedures for "switch loading" must be followed to

avoid the static ignition hazard that can exist when higher flash point material (such as fuel oil or diesel) is loaded into tanks previously containing low flash point products (such as gasoline or naphtha).

(3) Storage tank level floats must be effectively bonded.

For more information on precautions to prevent static-initiated fire or explosion, see NFPA 77, Recommended Practice on Static Electricity (2007), and API Recommended Practice 2003, Protection Against Ignitions Arising Out of Static, Lightning, and Stray Currents (2008).

Dust explosion class : Not applicable

Requirements for storage areas and containers : Keep away from flame, sparks, excessive temperatures and open flame. Use approved containers. Keep containers closed and clearly labeled. Empty or partially full product containers or vessels may contain explosive vapors. Do not pressurize, cut, heat, weld or expose containers to sources of ignition. Store in a well-ventilated area. The storage area should comply with NFPA 30 "Flammable and Combustible Liquid Code". The cleaning of tanks previously containing this product should follow API Recommended Practice (RP) 2013 "Cleaning Mobile Tanks In Flammable and Combustible Liquid Service" and API RP 2015 "Cleaning Petroleum Storage Tanks".

Other data : Emergency eye wash capability should be available in the near proximity to operations presenting a potential splash exposure.

Advice on common storage Keep away from food, drink and animal feed. Incompatible with oxidizing agents. Incompatible with acids.

SECTION 8. EXPOSURE CONTROLS / PERSONAL PROTECTION

Exposure Guidelines

List	Components	CAS-No.	Type:	Value
OSHA Z1	Xylene	1330-20-7	PEL	100 ppm 435 mg/m3
	Naphthalene	91-20-3	PEL	10 ppm 50 mg/m3
ACGIH	Diesel Fuel	68476-30-2	TWA	100 mg/m3
	Xylene	1330-20-7	TWA	100 ppm
		1330-20-7	STEL	150 ppm
	Naphthalene	91-20-3	TWA	10 ppm
		91-20-3	STEL	15 ppm
	Nonane	111-84-2	TWA	200 ppm

Engineering measures : Use adequate ventilation to keep gas and vapor concentrations of this product below occupational exposure and flammability limits, particularly in confined spaces. Use only intrinsically safe electrical equipment approved for use in classified areas.

Eye protection : Safety glasses or goggles are recommended where there is a possibility of splashing or spraying.

Hand protection : Gloves constructed of nitrile, neoprene, or PVC are recommended. Consult manufacturer specifications for further information.

Skin and body protection	: If needed to prevent skin contact, chemical protective clothing such as of DuPont TyChem®, Saranex or equivalent recommended based on degree of exposure. The resistance of specific material may vary from product to product as well as with degree of exposure.
Respiratory protection	: A NIOSH/ MSHA-approved air-purifying respirator with organic vapor cartridges or canister may be permissible under certain circumstances where airborne concentrations are or may be expected to exceed exposure limits or for odor or irritation. Protection provided by air-purifying respirators is limited. Refer to OSHA 29 CFR 1910.134, ANSI Z88.2-1992, NIOSH Respirator Decision Logic, and the manufacturer for additional guidance on respiratory protection selection. Use a NIOSH/ MSHA-approved positive-pressure supplied-air respirator if there is a potential for uncontrolled release, exposure levels are not known, in oxygen-deficient atmospheres, or any other circumstance where an air-purifying respirator may not provide adequate protection.
Work / Hygiene practices	: Emergency eye wash capability should be available in the near proximity to operations presenting a potential splash exposure. Use good personal hygiene practices. Avoid repeated and/or prolonged skin exposure. Wash hands before eating, drinking, smoking, or using toilet facilities. Do not use as a cleaning solvent on the skin. Do not use solvents or harsh abrasive skin cleaners for washing this product from exposed skin areas. Waterless hand cleaners are effective. Promptly remove contaminated clothing and launder before reuse. Use care when laundering to prevent the formation of flammable vapors which could ignite via washer or dryer. Consider the need to discard contaminated leather shoes and gloves.

SECTION 9. PHYSICAL AND CHEMICAL PROPERTIES

Form	: Liquid
Appearance	: Clear, straw colored
Odor	: Characteristic petroleum (kerosene) odor
Flash point - typical	: 38 °C Minimum for #1 Diesel, 52 °C Minimum for #2 Diesel
Auto Ignition temperature	: 257 °C (495 °F)
Thermal decomposition	: No decomposition if stored and applied as directed.
Lower explosive limit	: 0.6 %(V)
Upper explosive limit	: 4.7 %(V)
pH	: Not applicable
Freezing point	: No data available
Boiling point	: 148 - 372 °C(298 - 702 °F)
Vapor Pressure	: < 2 mm Hg at 20 °C
Density	: 0.86 g/cm ³
Water solubility	: Negligible
Viscosity, dynamic	: 1.7 - 40 mPa.s at 37.8 °C (100.0 °F)

Percent Volatiles	: 100 %
Conductivity (conductivity can be reduced by environmental factors such as a decrease in temperature)	<div style="display: flex; justify-content: space-between;"> <div> Diesel Fuel Oils at terminal load rack: Ultra Low Sulfur Diesel (ULSD) without conductivity additive: ULSD at terminal load rack with conductivity additive: JP-8 at terminal load rack: </div> <div> At least 25 pS/m 0 pS/m to 5 pS/m At least 50 pS/m but conductivity may decrease from environmental factors such as temperature drop. 150 pS/m to 600 pS/m </div> </div>

SECTION 10. STABILITY AND REACTIVITY

Conditions to avoid	: Avoid high temperatures, open flames, sparks, welding, smoking and other ignition sources. Keep away from strong oxidizers. Viton ® ; Fluorel ®
Materials to avoid	: Strong oxidizing agents. Peroxides
Hazardous decomposition products	: Carbon monoxide, carbon dioxide and noncombusted hydrocarbons (smoke). Diesel exhaust particulates may be a lung hazard - see Section 11.
Thermal decomposition	: No decomposition if stored and applied as directed.
Hazardous reactions	: Keep away from oxidizing agents, and acidic or alkaline products.

SECTION 11. TOXICOLOGICAL INFORMATION

Carcinogenicity

NTP	: Naphthalene (CAS-No.: 91-20-3)
IARC	: Naphthalene (CAS-No.: 91-20-3)
OSHA	: No component of this product which is present at levels greater than or equal to 0.1 % is identified as a carcinogen or potential carcinogen by OSHA.
CA Prop 65	: WARNING! This product contains a chemical known to the State of California to cause cancer. naphthalene (CAS-No.: 91-20-3)
Skin irritation	: Irritating to skin.
Eye irritation	: Irritating to eyes.
Further information	: Studies have shown that similar products produce skin cancer or skin tumors in laboratory animals following repeated applications without washing or removal. The significance of this finding to human exposure has not been determined. Other studies with active skin carcinogens have shown that washing the animal's skin with soap and water between applications reduced tumor formation. Positive mutagenicity results have been reported. Repeated over-exposure may cause liver and kidney injury IARC classifies whole diesel fuel exhaust particulates as probably carcinogenic to humans (Group 2A). NIOSH regards whole diesel fuel exhaust particulates as a potential cause of occupational lung cancer based on animal studies and limited evidence in humans.

Component:

Fuels, diesel, No 2; Gasoil - unspecified	68476-34-6	<u>Acute oral toxicity:</u> LD50 rat Dose: 5,001 mg/kg <u>Acute dermal toxicity:</u> LD50 rabbit
--------------------------------------------------	------------	------------------------------------------------------------------------------------------------------------

Dose: 2,001 mg/kg

Acute inhalation toxicity: LC50 rat

Dose: 7.64 mg/l

Exposure time: 4 h

Skin irritation: Classification: Irritating to skin.

Result: Severe skin irritation

Eye irritation: Classification: Irritating to eyes.

Result: Mild eye irritation

Nonane

111-84-2

Acute oral toxicity: LD50 mouse

Dose: 218 mg/kg

Acute inhalation toxicity: LC50 rat

Exposure time: 4 h

Naphthalene

91-20-3

Acute oral toxicity: LD50 rat

Dose: 2,001 mg/kg

Acute dermal toxicity: LD50 rat

Dose: 2,501 mg/kg

Acute inhalation toxicity: LC50 rat

Dose: 101 mg/l

Exposure time: 4 h

Skin irritation: Classification: Irritating to skin.

Result: Mild skin irritation

Eye irritation: Classification: Irritating to eyes.

Result: Mild eye irritation

Carcinogenicity: N11.00422130

1,2,4-Trimethylbenzene

95-63-6

Acute inhalation toxicity: LC50 rat

Dose: 18 mg/l

Exposure time: 4 h

Skin irritation: Classification: Irritating to skin.

Result: Skin irritation

Eye irritation: Classification: Irritating to eyes.

Result: Eye irritation

Xylene

1330-20-7

Acute oral toxicity: LD50 rat

Dose: 2,840 mg/kg

Acute dermal toxicity: LD50 rabbit

Dose: ca. 4,500 mg/kg

Acute inhalation toxicity: LC50 rat

Dose: 6,350 mg/l

Exposure time: 4 h

Skin irritation: Classification: Irritating to skin.

Result: Mild skin irritation

Repeated or prolonged exposure may cause skin irritation and dermatitis, due to degreasing properties of the product.

Eye irritation: Classification: Irritating to eyes.

Result: Mild eye irritation

SECTION 12. ECOLOGICAL INFORMATION

Additional ecological : Keep out of sewers, drainage areas, and waterways. Report spills and releases, as

information

applicable, under Federal and State regulations.

Component:**Naphthalene**

91-20-3

Toxicity to algae:

EC50

Species:

Dose: 33 mg/l

Exposure time: 24 h

1,2,4-Trimethylbenzene

95-63-6

Toxicity to fish:

LC50

Species: Pimephales promelas (fathead minnow)

Dose: 7.72 mg/l

Exposure time: 96 h

Acute and prolonged toxicity for aquatic invertebrates:

EC50

Species: Daphnia

Dose: 3.6 mg/l

Exposure time: 48 h

SECTION 13. DISPOSAL CONSIDERATIONS**Disposal**

: In accordance with local and national regulations.

SECTION 14. TRANSPORT INFORMATION**CFR**

Proper shipping name : DIESEL FUEL
 UN-No. : UN1202 (NA 1993)
 Class : 3
 Packing group : III

TDG

Proper shipping name : DIESEL FUEL
 UN-No. : UN1202 (NA 1993)
 Class : 3
 Packing group : III

IATA Cargo Transport

UN UN-No. : UN1202 (NA 1993)
 Description of the goods : DIESEL FUEL
 Class : 3
 Packaging group : III
 ICAO-Labels : 3
 Packing instruction (cargo aircraft) : 310
 Packing instruction (cargo aircraft) : Y309

IATA Passenger Transport

UN UN-No. : UN1202 (NA 1993)
 Description of the goods : DIESEL FUEL
 Class : 3
 Packaging group : III

ICAO-Labels : 3
 Packing instruction : 309
 (passenger aircraft)
 Packing instruction : Y309
 (passenger aircraft)

IMDG-Code

UN-No. : UN 1202 (NA 1993)
 Description of the goods : DIESEL FUEL
 Class : 3
 Packaging group : III
 IMDG-Labels : 3
 EmS Number : F-E S-E
 Marine pollutant : No

SECTION 15. REGULATORY INFORMATION

OSHA Hazards : Combustible Liquid
 Moderate skin irritant
 Moderate eye irritant
 Toxic by ingestion
 POSSIBLE CANCER HAZARD

TSCA Status : On TSCA Inventory

DSL Status : All components of this product are on the Canadian DSL list.

SARA 311/312 Hazards : Fire Hazard
 Acute Health Hazard
 Chronic Health Hazard

SARA III US. EPA Emergency Planning and Community Right-To-Know Act (EPCRA) SARA Title III Section 313 Toxic Chemicals (40 CFR 372.65) - Supplier Notification Required

Components**CAS-No.**

Xylene 1330-20-7

1,2,4-Trimethylbenzene 95-63-6

Naphthalene 91-20-3

PENN RTK US. Pennsylvania Worker and Community Right-to-Know Law (34 Pa. Code Chap. 301-323)

Components**CAS-No.**

Nonane 111-84-2

Naphthalene 91-20-3

1,2,4-Trimethylbenzene 95-63-6

xylene 1330-20-7

Fuels, diesel, No 2; Gasoil - unspecified 68476-34-6

MASS RTK US. Massachusetts Commonwealth's Right-to-Know Law (Appendix A to 105 Code of Massachusetts Regulations Section 670.000)

Components**CAS-No.**

Xylene 1330-20-7

1,2,4-Trimethylbenzene 95-63-6

Naphthalene 91-20-3

Nonane 111-84-2

NJ RTK

US. New Jersey Worker and Community Right-to-Know Act (New Jersey Statute Annotated Section 34:5A-5)

Components

CAS-No.

Nonane 111-84-2

Naphthalene 91-20-3

1,2,4-Trimethylbenzene 95-63-6

Xylene 1330-20-7

Fuels, diesel, No 2; Gasoil - unspecified 68476-34-6

California Prop. 65

: WARNING! This product contains a chemical known to the State of California to cause cancer.

Naphthalene 91-20-3

SECTION 16. OTHER INFORMATION

Further information

The information provided in this Safety Data Sheet is correct to the best of our knowledge, information and belief at the date of its publication. The information given is designed only as guidance for safe handling, use, processing, storage, transportation, disposal and release and is not to be considered a warranty or quality specification. The information relates only to the specific material designated and may not be valid for such material used in combination with any other materials or in any process, unless specified in the text.

Prepared by : GWU mbH
Birlenbacher Str. 18
D-57078 Siegen

Germany

Telephone: +49-(0)271-88072-0

10/15/2009

65, 66, 295

Appendix D

Cooling Tower PM10 Guidance

COOLING TOWER DRIFT MASS DISTRIBUTION

Excel Drift Eliminators

The following table represents the predicted mass distribution of drift particle size for cooling tower drift dispersed from Marley TU10 and TU12 Excel Drift Eliminators properly installed in a cooling tower.

Mass in Particles (%)		Droplet Size (Microns)
0.2	Larger Than	525
1.0	Larger Than	375
5.0	Larger Than	230
10.0	Larger Than	170
20.0	Larger Than	115
40.0	Larger Than	65
60.0	Larger Than	35
80.0	Larger Than	15
88.0	Larger Than	10

How to read table: Example – 0.2% of the drift will have particle sizes larger than 525 microns.

Marley guarantees the data above for properly installed, undamaged drift eliminators in 'like-new' condition.

NOTE: Biological treatment and control of Legionella and other potentially health-threatening bacteria is essential. Consult a competent water treatment expert or service company.

pH	6.5 to 9.0 (special materials may be required beyond these limits)
Temperature	125° F (51.7° C) typical maximum; higher temperatures possible with special materials
Langelier Saturation Index	0.0 to 1.0 recommended; higher allowed if scale is controllable.
M-Alkalinity	100 to 500 ppm as CaCO ₃
Silica	150 ppm as SiO ₂ maximum (scale formation)
Iron	3 ppm maximum (staining and scale contributor)
Manganese	0.1 ppm maximum (staining and scale contributor)
Sulfides	Greater than 1 ppm can be corrosive to copper alloys, iron, steel, and galvanized steel. See table below for limits with film fill.
Ammonia	50 ppm maximum if copper alloys present; lower limits apply for film fill - see table.
Chlorine / bromine	1 ppm free residual intermittently (shock), or 0.4 ppm continuously maximum. Excess can attack sealants, accelerate corrosion, increase drift, and embrittle PVC.
Organic solvents	These can attack plastics and promote bio-growth. Trace amounts may be acceptable, depending on the solvent.
TDS	Over 5000 ppm may require thermal performance derate.

Individual Ions:

Cations:

Calcium
Magnesium
Sodium

MAXIMUM:

800 ppm as CaCO₃ preferred, (300 ppm with MX fills in arid climate).
Depends on pH and silica level (for magnesium silicate scale).
No limit.

Anions:

Chlorides

450 ppm as Cl⁻ (300 for galvanized towers).
upgrades are required for higher chloride levels.

Sulfates

800 ppm as CaCO₃ preferred if calcium is also high (CaSO₄ scale).

Nitrates

300 ppm as NO₃ (bacteria nutrient).

Carbonates/Bicarbonates

300 ppm as CaCO₃ preferred for wood or galvanized steel tower.

Fouling Contaminant Limits - based on fouling load of 2.5 pounds per cubic foot

Bacteria counts listed below relate to maintaining fill thermal efficiency only.

Biocidal treatment is required for all cooling tower installations. (see NOTE above).

<u>Fill Type</u>	<u>Aerobic Bacteria</u> <u>Heterotrophic Plate Count</u>	<u>Total Suspended</u> <u>Solids (TSS)</u>	<u>Oil and</u> <u>Grease</u>	<u>Sulfides</u>	<u>Ammonia</u>
MC75, MC120	10,000 CFU/ml	50 ppm	1 ppm	0.5 ppm	10 ppm
FB20, MX75 and MX625 (crossflow)	100,000 CFU/ml with TSS up to 50 ppm, or 10,000 CFU/ml with TSS up to 150 ppm		1 ppm	1.0 ppm	15 ppm
DF254, MCR16	100,000 CFU/ml	150 ppm	5 ppm	1.5 ppm	25 ppm
DF381 with 1' MC75 overlay	1,000,000 CFU/ml with TSS up to 50 ppm, or 100,000 CFU/ml with TSS up to 150 ppm		5 ppm	1.5 ppm	25 ppm
DF381, MVC20, AAFNCS ('Cleanflow') MCR12, Tricklebloc	1,000,000 CFU/ml	250 ppm	10 ppm	2.0 ppm	25 ppm
Splash bar or grid fill	1,000,000 CFU/ml target	No specific limit	10 ppm	N/A	N/A

Note: Any amount of oil or grease is likely to adversely affect thermal performance. Sulfides and ammonia promote bacterial growth which can cause fill fouling; conformance to the limits above will assist in controlling bacteria to the recommended levels.

Drift Effects:

Certain contaminants or treatment chemicals such as surfactants, glycols, biodispersants and antifoams may increase drift rate. When minimizing drift is vital, the circulating water shall have a surface tension of at least 65 dynes/cm and a total organic carbon (TOC) level below 25 ppm. *Reclaim or re-use waters in particular may contain contaminants which increase drift rate either directly or by necessitating the use of treatment chemicals which increase drift rate.*

Miscellaneous Solids and Nutrients

Avoid high efficiency fill (MC75) with water containing bacteria nutrients such as alcohols, nitrates, ammonia, fats, glycols, phosphates, black liquor, or TOC greater than 50 ppm. Clog-resistant fills may be considered for contaminated water, case by case. For all film fills, avoid fibrous, oily, greasy, fatty, or tarry contaminants, which can plug fill.

In general, do not use film fill in Steel Plants, Pulp & Paper Mills, Food Processing Operations, or similar applications unless leaks and contamination by airborne or waterborne particulates, oil, or fibers are extremely unlikely. If film fill is used, biological-growth control must be stringent and diligent.