

DOCKETED	
Docket Number:	08-AFC-07C
Project Title:	GWF Tracy (Compliance)
TN #:	232871
Document Title:	Quarterly Monitoring Report Q1 2020
Description:	Quarterly Monitoring Report Q1 2020
Filer:	Neftali Nevarez
Organization:	MRP San Joaquin Energy, LLC
Submitter Role:	Applicant
Submission Date:	4/29/2020 1:41:29 PM
Docketed Date:	4/29/2020

MRP San Joaquin Energy, LLC

April 21, 2020

Mr. Anwar Ali
Compliance Project Manager
California Energy Commission
1516 Ninth Street
Sacramento, CA. 95814

Reference: MRP- San Joaquin Energy, LLC. Tracy Combined Cycle Power Plant
Facility No. 08-AFC-07

Subject: CEC Conditions of Certification AQ-16 – AQ-170
Quarterly Compliance Report First Quarter 2020.

Dear Mr. Ali,

Enclosed please find the Quarterly Compliance Report for the First Quarter of 2020 as required per the Conditions of Certification as set forth in the California Energy Commission's Final Decision for MRP- San Joaquin Energy, LLC - Tracy Combined Cycle Power Plant Project (No. 08-AFC-07).

If you have any questions regarding this report, please contact Neftali Nevarez at (925) 597-2905.

Sincerely,

A handwritten signature in blue ink, appearing to be 'CC' or similar initials, followed by a long horizontal stroke.

Claude Couvillion
Vice President of Operations

**MRP-San Joaquin Energy Inc.
Tracy Power Plant**

Quarterly Air Compliance Report

1st Quarter 2020

This report documents compliance with the California Energy Commission's Conditions of Certification.

Attached are summaries of relevant permit conditions and compliance status as required documentation.

Attachment 1: Summary table identifying each condition, compliance status, reference to compliance documents.

Attachment 2: Rolling Year Emissions Mass Summary

Attachment 3: Breakdown/Deviation Reports filed this quarter.

Attachment 4: Breakdown follow up reports filed this quarter.

Attachment 5: Daily Emissions Report for this quarter.

Attachment 6: Gas Sulfur content 12 month rolling average.

Attachment 7: Start up and shutdown summaries.

Attachment 8: Fuel usage.

Attachment 9: Fuel sulfur analysis completed this quarter.

Attachment 10: CEM run/down time reports

Attachment 11: Emergency Generator Run Log

Attachment 12: Aux Boiler Run Log

Attachment 13: Emergency Fire Pump Run Log.

Attachment 14: Aux Boiler Compliance

Attachment 15: Dust Suppression Control Measures

Attachment 16: Annual WSAC PM 10 – (Submitted in Fourth Quarter Report only)

Attachment 1
Compliance Summary

COMPLIANCE SUMMARY

Condition Number	Permit Condition	Status	Document
AQ- SC9,16,41	Annual Total Mass Emissions	In Compliance	A-2, A-16 – Submitted Q4 2019
AQ-20	Report Breakdowns	In Compliance	A-3
AQ-21	Breakdown Follow up Reporting	In Compliance	A-4
AQ-26,38,39	Ammonia Slip	In Compliance	A-5
AQ-29,52,53,54,132,144,145	Fuel Sulfur	In Compliance	A-6, A-8, A-9
AQ-30,31,40,63,73,74	Emissions Rates	In Compliance	A-2, A-5
AQ-32,33,36	Startup and Shutdown Mass Emissions	In Compliance	A-2, A-7
AQ-33,34,35	Startup and Shutdown Time	In Compliance	A-7
AQ-44	Annual Fuel Usage	In Compliance	A-8
AQ-59	CEMs Audits	In Compliance	Results submitted separately
AQ-60	CEMs Annual RATA	In Compliance	Results submitted separately
AQ-70	CEMs Operation/Downtime	In Compliance	A-10
AQ-71	Formula if CEMs is not operating properly	In Compliance	
AQ-72	Records if CEMs is not working properly	In Compliance	
AQ-75	All Records Five Years	In Compliance	All Attachments
AQ-110,111,113,115,116,117,118	Emergency Diesel Generator	In Compliance	A-11
AQ-131,149,150,151	Aux Boiler	In Compliance	A-12
AQ-133	Aux Boiler Emissions	In compliance	A-14
AQ-166,167,168,169,170	Emergency Fire Pump	In Compliance	A-13
AQ-101	Dust Suppression	I-C	A-15

ATTACHMENT 2
ROLLING YEAR EMISSIONS MASS SUMMARY

TRACY COMBINED CYCLE POWER PLANT

Tracy, CA

Unit 1 - Annual Mass Emissions

March 2020 12-Month Rolling

ROLLING ANNUAL LBS LIMIT: CO = 74,598 NOx = 88,881 PM10= 32,250 SOx = 7,084 VOC = 15,145

Month	CO lbs Monthly Total	CO lbs 12-Mont h Rolling Total	NOx lbs Monthly Total	NOx lbs 12-Mont h Rolling Total	PM lbs Monthly Total	PM lbs 12-Mont h Rolling Total	SO2 lbs Monthly Total	SO2 lbs 12-Mont h Rolling Total	VOC lbs Monthly Total	VOC lbs 12-Mont h Rolling Total
Apr 2019	288	2152	3980	40499	181	3860	110	2352	20	370
May 2019	179	2283	2187	41701	61	3874	37	2361	7	372
Jun 2019	300	2474	5539	45274	332	4085	201	2489	34	393
Jul 2019	275	2504	4457	45170	355	3853	214	2347	35	373
Aug 2019	318	2713	4537	46291	368	3695	223	2248	36	360
Sep 2019	280	2746	3203	46489	243	3736	145	2273	25	364
Oct 2019	378	2904	4657	46686	285	3561	171	2164	29	349
Nov 2019	331	3108	3163	47093	379	3669	226	2224	37	361
Dec 2019	542	3523	4067	47992	705	4037	411	2427	65	395
Jan 2020	860	4157	3035	47098	514	4195	308	2518	48	409
Feb 2020	Down	4004	Down	42870	Down	3740	Down	2240	0	367
Mar 2020	137	3888	520	39345	55	3478	33	2079	6	342

TRACY COMBINED CYCLE POWER PLANT

Tracy, CA

Unit 2 - Annual Mass Emissions

March 2020 12-Month Rolling

ROLLING ANNUAL LBS LIMIT: CO = 74,598 NOx = 88,881 PM10= 32,250 SOx = 7,084 VOC = 15,145

Month	CO lbs Monthly Total	CO lbs 12-Mont h Rolling Total	NOx lbs Monthly Total	NOx lbs 12-Mont h Rolling Total	PM lbs Monthly Total	PM lbs 12-Mont h Rolling Total	SO2 lbs Monthly Total	SO2 lbs 12-Mont h Rolling Total	VOC lbs Monthly Total	VOC lbs 12-Mont h Rolling Total
Apr 2019	464	8941	2069	31470	229	7253	69	2199	20	850
May 2019	103	8940	470	31360	28	7230	8	2192	2	847
Jun 2019	230	8948	2852	32903	440	7474	133	2266	46	873
Jul 2019	167	8297	1727	30482	429	6758	127	2045	54	797
Aug 2019	207	7783	2305	29438	542	6254	163	1884	70	741
Sep 2019	226	7647	2015	29803	355	6338	106	1910	42	748
Oct 2019	321	6545	2619	28341	451	5727	134	1723	53	660
Nov 2019	311	6032	2661	28806	580	5821	173	1750	61	660
Dec 2019	442	5405	3664	30027	1139	6303	326	1877	129	697
Jan 2020	60	4600	425	27812	101	5793	29	1721	9	647
Feb 2020	Down	3436	Down	24032	Down	4894	Down	1448	0	554
Mar 2020	182	2713	1302	22109	170	4464	50	1318	15	501

ATTACHMENT 3
BREAKDOWN/DEVIATION REPORTS

MRP San Joaquin Energy

March 12, 2020

Mr. Taylor Leach
San Joaquin Valley Unified APCD
4800 Enterprise Way
Modesto, CA 95356-8718

**Subject: Title V Deviation/Follow-up Report
MRP San Joaquin Energy, LLC – Tracy Combined Cycle Power Plant
Facility ID N-4597**

Dear Mr. Leach

In accordance with Condition 2 of the Facility Wide Requirements of the Title V Permit for Facility ID N-4597, please find enclosed the Title V Deviation/Follow-up Report. The report was generated as instructed by the SJVAPCD after a Notice to Comply No. 5009468 was issued on March 5, 2018 for a clerical error in the Title V annual Compliance certification report that was corrected and resubmitted when reported to MRP San Joaquin Energy on February 11, 2020.

Please call Neftali Nevarez at (925) 597-2905 or e-mail (Neftali.Nevarez@naes.com) if you require additional information or if you have any questions regarding this report.

Respectfully,



Claude Couvillion
Vice President of Operation
MPR San Joaquin Energy, LLC

BREAKDOWN / TITLE V - DEVIATION REPORTING FORM

Check the appropriate box if using this form to submit/report a:

☐ Breakdown Notification (must be reported within 1 hour)

☒ Title V Deviation

☐ Breakdown Follow-up Report

☐ Title V Deviation/Breakdown Follow-up Report

This form can be used to file the initial report of an equipment breakdown, and as the follow-up report for both a breakdown and/or deviation from a Federal Title V permit condition. The required reports must be submitted to the nearest District regional office as follows:

- Breakdown follow-up reports no later than 10 days after returning to compliance
- Deviation reports no later than 10 days after discovery

Company Name: MRP San Joaquin Energy, LLC Facility ID: N-4597

Breakdown - Initial Notification:

Reported by: NA Date: NA

Reported to: NA Time: NA

BREAKDOWN / DEVIATION INFORMATION

1.	Permit unit and condition number(s): N-4597-0-3 Conditions # 5 and 36
2.	Equipment involved: No equipment involved. Clerical error in the Title V Annual Compliance Certification Report
3.	Location of operation: 14950 W. Schulte Rd; Tracy, CA 95377
4.	Description of permit condition: Condition #5 of Facility Wide Permit N-4597-0-3. The permittee must comply with all conditions of the permit, including.... Condition #36 of permit Unit N-4597-0-3. The permittee shall submit certifications of compliance with the terms and standards contained in Title V permits, including emission limits, standards and work practices to the District and the EPA annually (or more frequently as specified in an applicable requirement or as specified by the District). The certification shall include the identification of each permit term or condition, the compliance status, whether compliance was continuous or intermittent, the methods used for determining the compliance status, and any other facts required by the District to determine the compliance status of the source.

Northern Region Office
(Merced, San Joaquin, & Stanislaus Counties)
4800 Enterprise Way
Modesto, CA 95356-8718
Tel: (209) 557-6400 ♦ FAX: (209) 557-6475

Central Region Office
(Fresno, Kings, & Madera Counties)
1990 E Gettysburg Ave
Fresno, CA 93726-0244
Tel: (559) 230-5950 ♦ FAX: (559) 230-6062

Southern Region Office
(Tulare County & Valley portion of Kern County)
34946 Flyover Court
Bakersfield, CA 93308-9725
Tel: (661) 392-5500 ♦ FAX: (661) 392-5585

5.	Date, time, and duration of breakdown/deviation: 01/29/20, 09:17 am PST thru 02/11/20, 11:22 am PST. When the report page with the corrected condition was submitted to the District via e-mail. Duration of the deviation was 13 days, two hours and 5 minutes.
6.	Description of breakdown/deviation (include excess and visible emissions, if applicable): The Title V Annual Compliance Certification (TV ACC) report for the compliance period from January 1, 2019 thru December 31, 2019 that was submitted to SJVAPCD and EPA on January 29, 2020 contained a clerical error. For Condition 22 of Permit No. N-4597-5-1, Column 3 (compliance status) was marked as “continuous” compliance when it should have been marked as “intermittent” compliance. TCCP experienced and reported a breakdown/deviation from this condition on February 8, 2019. A timely Title V Breakdown/Deviation Report for the event was submitted on February 15, 2019. This breakdown/deviation event was also identified and reported in Column 5 for Condition 22 in the TV ACC. However, the TCCP inadvertently marked the compliance status as continuous rather than intermittent; a clerical error.
7.	Date and time when breakdown/deviation was discovered: March 5, 2020 when SJVAPCD submitted Notice to Comply No. 5009468 for the error, indicating their position that the error was considered a Title V Permit Deviation. This is the date of discovery.
8.	Date and time compliance was achieved: 02/11/2019 at 11:22 am PST, when the report page with the correct compliance status was sent to SJVAPCD via e-mail.
9.	Probable cause of breakdown/deviation: Minor oversight while preparing and reviewing report.
10.	Measures taken to correct this occurrence and prevent recurrence: The TV ACC Report was corrected and the page with the correct information was submitted to the SJVAPCD via e-mail on 02/11/20 11:22 am.
	• Attach photographs of defective equipment. • Provide any additional information necessary to establish that this occurrence was the result of an unavoidable failure or malfunction; Rule 1100 – <i>Equipment Breakdown</i> assigns the burden of proof to the source owner/operator seeking relief.

CERTIFICATION:

I declare, under penalty of perjury under the laws of the state of California, that based on information and belief formed after reasonable inquiry, all information provided in this report is true, accurate, and addresses all deviations that resulted from this event:



Signature of Responsible Official

(Responsible Official only required for Title V Permit Holders)

Claude Couvillion

Name of Responsible Official

Vice President of Operations

Title of Responsible Official

03/12/2020

Date

312.766.8716

Telephone

jcouvillion@mrpgenco.com

Email



SAN JOAQUIN VALLEY UNIFIED AIR POLLUTION CONTROL DISTRICT

☒ Northern Regional Office
4800 Enterprise Way
Modesto, CA 95356-8718
(209) 557-6400

Central Regional Office
1990 E Gettysburg Ave
Fresno, CA 93726-0244
(559) 230-5999

Southern Regional Office
34946 Flyover Court
Bakersfield, CA 93308
(661) 392-5500

NOTICE TO COMPLY

OCCURRENCE DATE: Wed January 29, 2020 **TIME:** 12:00 PM **NO:** 5009468
LOCATION: 14950 W Schulte Rd Tracy Combined Cycle Power Plant **CITY:** Tracy
NAME: Mrp San Joaquin Energy, Llc **PHONE:** (925) 597-2905
MAILING ADDRESS: 14950 W Schulte Rd Tracy Combined Cycle Power Plant
CITY: Tracy **STATE:** CA **ZIP:** 95377
FACILITY ID: N-4597

VIOLATIONS OBSERVED:

☒ San Joaquin Valley Unified Air Pollution Control District Rules and Regulation(s): 2520-Federally Mandated Operating Permits

California Health and Safety Code Section(s):

Description: Annual compliance certification (ACC) report for 2019 was not sufficiently accurate, in violation of the requirements of Condition 36 on PTO N-4597-0-3.

Corrective Action: Submitted an updated Annual Compliance Certification (ACC) on 2/11/19. Deviation report due 3/15/2020.

Correction Due Date: Sun Mar 15, 2020

RECIPIENT NAME: Neftali Nevarez

TITLE: Compliance Manager

SIGNING THIS NOTICE IS NOT
AN ADMISSION OF GUILT

x

SIGNATURE

**THIS IS A WARNING NOTICE ONLY.
FURTHER VIOLATIONS OF THIS TYPE WILL RESULT IN ENFORCEMENT ACTION.**

INSPECTOR: Taylor Leach
DATE: Thu Mar 05, 2020

DISTRICT SIGNED COPY TO RECIPIENT, RECIPIENT SIGNED COPY TO FILE, UNSIGNED COPY TO INSPECTOR

Continued

INSTRUCTIONS

- You must achieve compliance by the correction due date specified Sun Mar 15, 2020.
- Within 5 days of achieving compliance, sign below and return this NTC to the District. Your signature verifies that you have complied with the NTC. A false statement that compliance has been achieved is a misdemeanor violation and is subject to civil penalties. (*Rule 1180, section 5.*)

I hereby certify that I have complied with the requirements listed on this Notice to Comply (NTC No. 5009468).



Signature

3/12/2020

Date

- **Disputes.** If you disagree with one or more of the noted violations, you may give written notice of appeal to the District within 7 days of issuance of this NTC. The written notice shall include the grounds and basis for the appeal and include any evidence as to why the NTC should not have been issued. The APCO will grant or deny the appeal within 14 days. (*Rule 1180, section 6.*)
- **Failure to correct.** If you fail to correct the violation noted on the NTC, or if the District determines immediate enforcement action is warranted, you may be subject to further enforcement and/or legal action. (*Rule 1180, section 7.*)
- **Reinspection.** Your site of facility is subject to reinspection at any time to ensure it is in compliance or that the violation cited in the NTC has been corrected. (*Rule 1180, section 4.6.*)
- **Additional Information.** You may be required to submit reasonable and necessary documentation to support a claim of compliance. (*Rule 1180, section 4.7.*)
- **State and Federal law enforcement.** This NTC does not protect you against possible enforcement of federal and state laws through criminal or civil proceedings. (*Rule 1180, sections 4.8 and 4.9.*)

<u>COLUMN 2</u> Permit Condition	<u>COLUMN 3</u> Continuous, Intermittent, or Not in Compliance	<u>COLUMN 4</u> Method for Determining Compliance	<u>COLUMN 5</u> Additional Information
20. The minimum flue gas recirculation rate shall be established by source testing the unit per rules 4305, 4306, and 4320 at three firing rates (low, mid and high), the normal range shall be no lower than the minimum flue gas recirculation rate that complies with the NOx and CO emission limits as demonstrated through source testing at a similar firing rate. The source test emission measurements shall be made with the unit operating at conditions representative of normal operating conditions. No measurements shall be made within the first two hours after a continuous period in which fuel flow to the unit is shut off 30 minutes or longer, or within 30 minutes after re-ignition as defined in District Rule 4306. A flow transmitter shall be calibrated prior to the source test. [District Rules 4305, 4306, and 4320] Federally Enforceable through Title V permit.	Continuous	The minimum flue gas recirculation rates are established during source testing as specified by this permit condition. The flow transmitter is calibrated prior to any source test	Most recent source test completed 1/24/17.
21. The normal flue gas recirculation rate or level shall be re-established during each source test required by the permit. The flow transmitter shall be calibrated prior to each source test. [District Rules 4305, 4306, and 4320] Federally Enforceable through Title V permit.	Continuous	Refer to condition 20 for methodology used establish flue gas recirculation.	Next source test scheduled for January 31, 2020 The flue gas flow transmitter was calibrated January 13, 2020
22. Permittee shall continuously monitor and record the flue gas recirculation rate using a flow transmitter and the plant's CEM DAHS during period when this boiler is in use. [District Rules 4305, 4306, and 4320] Federally Enforceable through Title V permit.	Intermittent	The flue gas recirculation rate signal is configured and recorded continuously in the plant's CEM DAHS system	1. Deviation filed 02/08/19 for Unit N-4597-5-1. Flue Gas recirculation rate recorded "0" while the auxiliary boiler was running. All controls were operating properly including the flue gas recirculation damper.

ATTACHMENT 4
BREAKDOWN FOLLOW UP REPORTS

No breakdown request reports were filed during Q1 2020

ATTACHMENT 5
DAILY EMISSIONS REPORTS

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
January 1, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	1.7	5.48	8.76	0.5	1.09	6.00	0.9	1.17	9.40	On	1.00	Normal
01	1.6	5.85	10.30	0.5	1.09	6.00	0.9	1.21	9.40	On	1.00	Normal
02	1.7	5.83	10.30	0.6	1.15	6.00	1.0	1.25	9.40	On	1.00	Normal
03	1.7	5.81	10.30	0.6	1.21	6.00	1.0	1.29	9.40	On	1.00	Normal
04	1.7	5.84	10.30	0.6	1.24	6.00	1.0	1.33	9.40	On	1.00	Normal
05	1.6	5.72	10.30	0.6	1.21	6.00	1.0	1.37	9.40	On	1.00	Normal
06	1.7	5.80	10.30	0.6	1.21	6.00	1.1	1.40	9.40	On	1.00	Normal
07	1.7	5.81	10.30	0.6	1.24	6.00	1.1	1.44	9.40	On	1.00	Normal
08	1.6	4.83	8.17	0.6	1.18	6.00	1.1	1.40	9.40	On	1.00	Normal
09	1.6	4.87	8.10	0.5	1.06	6.00	1.1	1.47	9.40	Off	1.00	Normal
10	1.6	4.71	8.10	0.5	0.91	3.97	1.2	1.50	9.40	Off	1.00	Normal
11	1.6	4.72	8.10	0.5	0.88	3.90	1.2	1.54	9.40	Off	1.00	Normal
12	1.6	4.61	8.10	0.5	0.88	3.90	1.2	1.54	9.40	Off	1.00	Normal
13	1.6	4.56	8.10	0.5	0.91	3.90	1.2	1.54	9.40	Off	1.00	Normal
14	1.5	4.40	8.10	0.5	0.96	3.90	1.2	1.50	9.40	Off	1.00	Normal
15	1.4	4.19	8.10	0.6	1.07	3.90	1.2	1.49	9.40	Off	1.00	Normal
16	1.5	4.35	8.10	0.7	1.19	3.90	1.1	1.45	9.40	Off	1.00	Normal
17	1.6	5.72	8.10	0.7	1.28	3.90	1.2	1.49	9.40	Off	1.00	Normal
18	1.6	5.52	8.10	0.7	1.38	3.90	1.2	1.49	9.40	Off	1.00	Normal
19	1.6	5.61	8.39	0.7	1.44	4.18	1.1	1.45	9.40	On	1.00	Normal
20	1.6	5.57	10.30	0.7	1.51	6.00	1.1	1.41	9.40	On	1.00	Normal
21	1.6	5.61	10.30	0.7	1.51	6.00	1.1	1.41	9.40	On	1.00	Normal
22	1.6	5.66	10.30	0.7	1.49	6.00	1.1	1.41	9.40	On	1.00	Normal
23	1.6	5.64	9.75	0.7	1.43	6.00	1.1	1.37	9.40	On	1.00	Normal

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
January 2, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	1.4	4.42	8.10	0.7	1.38	6.00	1.1	1.36	9.40	Off	1.00	Normal
01	1.6	4.91	8.10	0.7	1.30	5.48	1.1	1.35	9.40	Off	1.00	Normal
02	1.6	4.76	8.10	0.7	1.31	3.90	1.1	1.34	9.40	Off	1.00	Normal
03	1.6	4.97	8.83	0.7	1.37	4.60	1.1	1.33	9.40	On	1.00	Normal
04	1.6	5.70	10.30	0.8	1.49	6.00	1.1	1.29	9.40	On	1.00	Normal
05	1.6	5.81	10.30	0.7	1.51	6.00	1.1	1.29	9.40	On	1.00	Normal
06	1.6	5.66	10.30	0.7	1.48	6.00	1.1	1.29	9.40	On	1.00	Normal
07	1.6	5.58	10.30	0.7	1.50	6.00	1.1	1.29	9.40	On	1.00	Normal
08	1.6	5.56	10.30	0.8	1.61	6.00	1.1	1.29	9.40	On	1.00	Normal
09	1.6	5.47	10.30	0.8	1.73	6.00	1.1	1.34	9.40	On	1.00	Normal
10	1.6	5.23	9.86	0.8	1.74	6.00	1.0	1.31	9.40	On	1.00	Normal
11	1.6	4.84	8.10	0.8	1.60	6.00	1.0	1.28	9.40	Off	1.00	Normal
12	1.5	4.56	8.10	0.8	1.52	5.58	1.0	1.28	9.40	Off	1.00	Normal
13	1.4	4.34	8.10	0.8	1.52	3.90	1.0	1.28	9.40	Off	1.00	Normal
14	1.4	4.56	8.58	0.9	1.64	4.36	1.0	1.28	9.40	On	1.00	Normal
15	1.6	5.76	10.30	0.8	1.64	6.00	1.0	1.29	9.40	On	1.00	Normal
16	1.6	5.68	10.30	0.8	1.67	6.00	1.0	1.30	9.40	On	1.00	Normal
17	1.6	5.74	10.30	0.7	1.61	6.00	1.0	1.26	9.40	On	1.00	Normal
18	1.6	5.61	10.30	0.7	1.56	6.00	1.0	1.26	9.40	On	1.00	Normal
19	1.6	5.57	10.30	0.7	1.46	6.00	1.0	1.26	9.40	On	1.00	Normal
20	1.6	5.57	10.30	0.7	1.46	6.00	1.0	1.26	9.40	On	1.00	Normal
21	1.6	5.54	10.30	0.7	1.48	6.00	1.0	1.22	9.40	On	1.00	Normal
22	1.6	5.60	10.30	0.7	1.55	6.00	1.0	1.22	9.40	On	1.00	Normal
23	1.6	5.57	9.75	0.8	1.58	6.00	1.0	1.26	9.40	On	1.00	Normal

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
January 3, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	1.6	4.93	8.10	0.8	1.55	6.00	1.0	1.26	9.40	Off	1.00	Normal
01	1.6	4.75	8.10	0.8	1.44	5.48	1.0	1.29	9.40	Off	1.00	Normal
02	1.6	4.75	8.10	0.8	1.39	3.90	1.0	1.32	9.40	Off	1.00	Normal
03	1.6	4.77	8.10	0.8	1.42	3.90	1.0	1.35	9.40	Off	1.00	Normal
04	1.6	5.05	8.10	0.8	1.55	3.90	1.1	1.45	9.40	Off	1.00	Normal
05	1.6	5.55	8.10	0.9	1.73	3.90	1.2	1.49	9.40	Off	1.00	Normal
06	1.6	5.52	8.10	1.0	1.90	3.90	1.2	1.53	9.40	Off	1.00	Normal
07	1.6	5.55	8.10	1.0	2.03	3.90	1.3	1.60	9.40	Off	1.00	Normal
08	1.6	5.41	8.10	1.0	2.15	3.90	1.4	1.76	9.40	Off	1.00	Normal
09	1.6	5.34	8.10	1.1	2.19	3.90	1.4	1.76	9.40	Off	1.00	Normal
10	1.6	4.75	8.10	1.0	2.04	3.90	1.5	1.78	9.40	Off	1.00	Normal
11	1.6	4.77	8.10	1.0	1.83	3.90	1.5	1.85	9.40	Off	1.00	Normal
12	1.6	4.77	8.10	0.9	1.64	3.90	1.5	1.89	9.40	Off	1.00	Normal
13	1.6	4.78	8.10	0.9	1.62	3.90	1.6	1.92	9.40	Off	1.00	Normal
14	1.6	4.92	8.10	0.9	1.56	3.90	1.6	1.99	9.40	Off	1.00	Normal
15	1.6	5.60	8.10	0.8	1.53	3.90	1.7	2.03	9.40	Off	1.00	Normal
16	1.6	5.60	8.10	0.8	1.55	3.90	1.7	2.07	9.40	Off	1.00	Normal
17	1.6	5.58	8.10	0.8	1.64	3.90	1.7	2.07	9.40	Off	1.00	Normal
18	1.6	5.60	8.10	0.8	1.77	3.90	1.8	2.14	9.40	Off	1.00	Normal
19	1.6	5.60	8.10	0.9	1.87	3.90	1.8	2.22	9.40	Off	1.00	Normal
20	1.6	5.65	8.10	0.9	1.91	3.90	1.9	2.30	9.40	Off	1.00	Normal
21	1.6	5.68	8.10	0.9	1.95	3.90	1.9	2.39	9.40	Off	1.00	Normal
22	1.6	5.70	8.10	0.9	1.92	3.90	2.0	2.43	9.40	Off	1.00	Normal
23	1.6	5.72	8.10	0.9	1.90	3.90	2.1	2.51	9.40	Off	1.00	Normal

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
January 4, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	1.6	5.67	8.10	0.9	1.86	3.90	2.1	2.60	9.40	Off	1.00	Normal
01	1.6	5.68	8.10	0.9	1.93	3.90	2.1	2.62	9.40	Off	1.00	Normal
02	1.6	5.73	8.10	0.9	1.93	3.90	2.2	2.64	9.40	Off	1.00	Normal
03	1.6	5.71	8.10	0.9	1.90	3.90	2.2	2.66	9.40	Off	1.00	Normal
04	1.6	5.71	8.10	0.9	1.84	3.90	2.2	2.64	9.40	Off	1.00	Normal
05	1.6	5.73	8.10	0.8	1.84	3.90	2.2	2.68	9.40	Off	1.00	Normal
06	1.6	5.71	8.10	0.8	1.81	3.90	2.2	2.68	9.40	Off	1.00	Normal
07	1.6	5.65	8.10	0.8	1.77	3.90	2.2	2.65	9.40	Off	1.00	Normal
08	1.6	5.60	8.10	0.8	1.79	3.90	2.1	2.61	9.40	Off	1.00	Normal
09	1.6	4.95	8.10	0.8	1.71	3.90	2.1	2.53	9.40	Off	1.00	Normal
10	1.6	4.76	8.10	0.8	1.62	3.90	2.0	2.50	9.40	Off	1.00	Normal
11	1.6	4.75	8.10	0.8	1.44	3.90	2.0	2.47	9.40	Off	1.00	Normal
12	1.6	4.62	8.10	0.8	1.43	3.90	2.0	2.43	9.40	Off	1.00	Normal
13	1.4	4.16	8.10	0.8	1.49	3.90	2.0	2.43	9.40	Off	1.00	Normal
14	1.3	3.92	8.10	0.9	1.60	3.90	1.9	2.36	9.40	Off	1.00	Normal
15	1.5	4.63	8.10	0.9	1.74	3.90	1.9	2.32	9.40	Off	1.00	Normal
16	1.6	5.52	8.10	0.9	1.79	3.90	1.9	2.32	9.40	Off	1.00	Normal
17	1.6	5.32	8.10	0.9	1.85	3.90	1.9	2.31	9.40	Off	1.00	Normal
18	1.6	5.63	8.10	0.9	1.83	3.90	1.9	2.31	9.40	Off	1.00	Normal
19	1.6	5.62	8.10	0.9	1.87	3.90	1.9	2.31	9.40	Off	1.00	Normal
20	1.6	5.69	8.10	0.8	1.82	3.90	1.8	2.27	9.40	Off	1.00	Normal
21	1.6	5.69	8.10	0.8	1.76	3.90	1.8	2.23	9.40	Off	1.00	Normal
22	1.6	5.70	8.10	0.8	1.67	3.90	1.8	2.19	9.40	Off	1.00	Normal
23	1.6	5.71	8.10	0.8	1.64	3.90	1.8	2.15	9.40	Off	1.00	Normal

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
January 5, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	1.5	5.05	8.10	0.8	1.76	3.90	1.7	2.03	9.40	Off	1.00	Normal
01	1.6	5.38	8.10	0.9	1.78	3.90	1.7	2.07	9.40	Off	1.00	Normal
02	1.5	5.18	8.10	0.9	1.89	3.90	1.7	2.07	9.40	Off	1.00	Normal
03	1.5	5.39	8.10	0.8	1.80	3.90	1.7	2.06	9.40	Off	1.00	Normal
04	1.5	5.34	8.10	0.8	1.79	3.90	1.7	2.07	9.40	Off	1.00	Normal
05	1.5	5.44	8.10	0.8	1.71	3.90	1.7	2.03	9.40	Off	1.00	Normal
06	1.5	5.32	8.10	0.8	1.78	3.90	1.7	2.03	9.40	Off	1.00	Normal
07	1.5	5.38	8.10	0.9	1.93	3.90	1.7	2.03	9.40	Off	1.00	Normal
08	1.5	5.28	8.10	0.9	1.99	3.90	1.7	2.03	9.40	Off	1.00	Normal
09	1.5	4.74	8.10	0.9	1.92	3.90	1.7	1.99	9.40	Off	1.00	Normal
10	1.5	4.55	8.10	0.9	1.67	3.90	1.6	1.99	9.40	Off	1.00	Normal
11	1.5	4.56	8.10	0.8	1.49	3.90	1.6	1.99	9.40	Off	1.00	Normal
12	1.5	4.51	8.10	0.8	1.47	3.90	1.6	1.99	9.40	Off	1.00	Normal
13	1.5	4.53	8.10	0.9	1.58	3.90	1.6	1.96	9.40	Off	1.00	Normal
14	1.5	4.42	8.10	0.9	1.67	3.90	1.6	1.96	9.40	Off	1.00	Normal
15	1.5	4.80	8.10	0.9	1.72	3.90	1.6	1.99	9.40	Off	1.00	Normal
16	1.5	5.27	8.10	0.9	1.79	3.90	1.6	2.00	9.40	Off	1.00	Normal
17	1.5	5.33	8.10	0.9	1.88	3.90	1.6	2.00	9.40	Off	1.00	Normal
18	1.5	5.25	8.10	0.9	1.88	3.90	1.6	1.96	9.40	Off	1.00	Normal
19	1.5	5.25	8.10	0.9	1.84	3.90	1.6	1.92	9.40	Off	1.00	Normal
20	1.5	5.24	8.10	0.9	1.84	3.90	1.6	1.92	9.40	Off	1.00	Normal
21	1.5	5.22	8.10	0.9	1.87	3.90	1.6	2.00	9.40	Off	1.00	Normal
22	1.5	5.22	8.10	0.9	1.93	3.90	1.6	2.00	9.40	Off	1.00	Normal
23	1.5	5.23	8.10	0.9	1.93	3.90	1.6	2.00	9.40	Off	1.00	Normal

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
January 6, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	1.5	5.25	8.10	0.9	1.90	3.90	1.7	2.11	9.40	Off	1.00	Normal
01	1.5	4.50	8.10	0.9	1.81	3.90	1.6	1.96	9.40	Off	1.00	Normal
02	1.5	4.46	8.10	0.9	1.69	3.90	1.5	1.91	9.40	Off	1.00	Normal
03	1.5	4.44	8.10	0.9	1.57	3.90	1.5	1.85	9.40	Off	1.00	Normal
04	1.5	4.94	8.10	0.9	1.55	3.90	1.6	1.92	9.40	Off	1.00	Normal
05	1.5	4.85	8.10	0.9	1.68	3.90	1.6	1.91	9.40	Off	1.00	Normal
06	1.5	5.29	8.10	0.9	1.89	3.90	1.6	1.91	9.40	Off	1.00	Normal
07	1.5	5.18	8.10	1.0	2.02	3.90	1.6	1.90	9.40	Off	1.00	Normal
08	1.5	5.14	8.10	1.0	2.04	3.90	1.6	1.90	9.40	Off	1.00	Normal
09	1.5	4.43	8.10	0.9	1.77	3.90	1.6	1.93	9.40	Off	1.00	Normal
10	1.5	4.41	8.10	0.8	1.46	3.90	1.6	1.97	9.40	Off	1.00	Normal
11	1.5	4.53	8.10	0.7	1.21	3.90	1.6	1.97	9.40	Off	1.00	Normal
12	1.5	4.52	8.10	0.7	1.18	3.90	1.7	1.97	9.40	Off	1.00	Normal
13	1.5	4.44	8.10	0.7	1.21	3.90	1.7	1.97	9.40	Off	1.00	Normal
14	1.4	4.13	8.10	0.7	1.27	3.90	1.7	1.97	9.40	Off	1.00	Normal
15	1.6	4.97	8.10	0.8	1.43	3.90	1.7	2.00	9.40	Off	1.00	Normal
16	1.5	5.95	9.42	0.8	1.48	5.16	1.8	2.09	9.40	On	1.00	Normal
17	1.5	5.31	10.30	0.8	1.60	6.00	1.7	2.06	9.40	On	1.00	Normal
18	1.5	5.32	10.30	0.8	1.64	6.00	1.7	2.06	9.40	On	1.00	Normal
19	1.5	5.21	10.30	0.8	1.83	6.00	1.7	2.10	9.40	On	1.00	Normal
20	1.5	5.16	9.31	0.9	1.93	6.00	1.7	2.06	9.40	On	1.00	Normal
21	1.5	5.11	8.10	0.9	2.01	6.00	1.7	2.02	9.40	Off	1.00	Normal
22	1.5	4.76	8.10	1.0	2.07	5.06	1.7	1.98	9.40	Off	1.00	Normal
23	1.5	5.34	8.10	1.0	2.09	3.90	1.7	2.05	9.40	Off	1.00	Normal

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
January 7, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	1.5	4.45	8.10	1.0	1.91	3.90	1.7	1.97	9.40	Off	1.00	Normal
01	1.5	4.45	8.10	0.9	1.74	3.90	1.8	2.07	9.40	Off	1.00	Normal
02	1.5	4.44	8.10	0.9	1.59	3.90	1.8	2.07	9.40	Off	1.00	Normal
03	1.5	4.42	8.10	0.9	1.56	3.90	1.8	2.10	9.40	Off	1.00	Normal
04	1.5	4.53	8.10	0.9	1.59	3.90	1.7	2.02	9.40	Off	1.00	Normal
05	1.6	4.81	8.10	1.0	1.75	3.90	1.8	2.08	9.40	Off	1.00	Normal
06	1.6	5.48	8.10	1.1	2.09	3.90	1.8	2.12	9.40	Off	1.00	Normal
07	1.6	5.29	8.80	1.1	2.33	4.57	1.8	2.04	9.40	On	1.00	Normal
08	1.6	4.88	8.10	1.1	2.29	4.57	1.8	2.06	9.40	Off	1.00	Normal
09	1.6	4.75	8.10	1.1	2.11	4.57	1.8	2.13	9.40	Off	1.00	Normal
10	1.5	4.68	8.10	1.1	2.06	3.90	1.9	2.20	9.40	Off	1.00	Normal
11	1.7	4.91	8.10	1.1	1.96	3.90	1.9	2.20	9.40	Off	1.00	Normal
12	1.6	4.80	8.10	1.1	1.97	3.90	1.9	2.24	9.40	Off	1.00	Normal
13	1.6	4.74	8.10	1.0	1.80	3.90	1.9	2.27	9.40	Off	1.00	Normal
14	1.5	4.87	8.10	1.0	1.92	3.90	2.0	2.31	9.40	Off	1.00	Normal
15	1.6	4.92	8.10	1.1	1.96	3.90	1.9	2.27	9.40	Off	1.00	Normal
16	1.6	5.99	9.79	1.1	2.09	5.51	2.0	2.30	9.40	On	1.00	Normal
17	1.5	5.51	10.30	1.1	2.18	6.00	2.0	2.30	9.40	On	1.00	Normal
18	1.6	5.74	10.30	1.0	2.24	6.00	2.0	2.30	9.40	On	1.00	Normal
19	1.6	5.72	10.30	1.0	2.17	6.00	1.9	2.26	9.40	On	1.00	Normal
20	1.6	5.74	10.30	0.9	2.01	6.00	1.9	2.30	9.40	On	1.00	Normal
21	1.5	5.11	8.36	0.9	1.87	6.00	1.9	2.22	9.40	On	1.00	Normal
22	1.6	4.59	8.10	0.9	1.79	6.00	1.9	2.28	9.40	Off	1.00	Normal
23	1.6	4.83	8.10	0.9	1.78	4.15	1.9	2.19	9.40	Off	1.00	Normal

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
January 8, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	1.6	4.74	8.10	1.0	1.76	3.90	1.9	2.19	9.40	Off	1.00	Normal
01	1.6	4.74	8.10	1.0	1.79	3.90	1.9	2.19	9.40	Off	1.00	Normal
02	1.6	4.76	8.10	1.0	1.83	3.90	1.9	2.19	9.40	Off	1.00	Normal
03	1.6	4.77	8.10	1.1	1.91	3.90	1.9	2.19	9.40	Off	1.00	Normal
04	1.6	4.76	8.10	1.1	1.99	3.90	1.9	2.19	9.40	Off	1.00	Normal
05	1.6	5.06	8.10	1.1	2.05	3.90	1.9	2.19	9.40	Off	1.00	Normal
06	1.6	5.75	8.10	1.1	2.24	3.90	1.9	2.19	9.40	Off	1.00	Normal
07	1.6	5.53	8.10	1.2	2.46	3.90	1.9	2.24	9.40	Off	1.00	Normal
08	1.7	5.81	8.10	1.2	2.55	3.90	1.9	2.22	9.40	Off	1.00	Normal
09	1.7	5.74	8.10	1.2	2.50	3.90	1.9	2.23	9.40	Off	1.00	Normal
10	1.6	5.57	8.10	1.1	2.41	3.90	1.8	2.21	9.40	Off	1.00	Normal
11	1.7	4.92	8.10	1.1	2.24	3.90	1.8	2.21	9.40	Off	1.00	Normal
12	1.7	4.91	8.10	1.0	1.99	3.90	1.8	2.18	9.40	Off	1.00	Normal
13	1.7	4.95	8.10	1.0	1.81	3.90	1.8	2.14	9.40	Off	1.00	Normal
14	1.7	4.95	8.10	1.0	1.81	3.90	1.7	2.11	9.40	Off	1.00	Normal
15	1.7	4.95	8.10	1.0	1.84	3.90	1.7	2.10	9.40	Off	1.00	Normal
16	1.6	5.73	8.10	1.0	1.89	3.90	1.7	2.02	9.40	Off	1.00	Normal
17	1.7	5.86	8.10	0.9	1.90	3.90	1.7	2.06	9.40	Off	1.00	Normal
18	1.7	5.86	8.10	0.9	1.92	3.90	1.7	2.06	9.40	Off	1.00	Normal
19	1.7	5.84	8.10	0.9	1.82	3.90	1.7	2.06	9.40	Off	1.00	Normal
20	1.7	5.89	8.10	0.8	1.76	3.90	1.7	2.06	9.40	Off	1.00	Normal
21	1.7	5.91	8.10	0.8	1.73	3.90	1.8	2.10	9.40	Off	1.00	Normal
22	1.7	5.81	8.10	0.8	1.73	3.90	1.7	2.08	9.40	Off	1.00	Normal
23	1.7	5.76	8.10	0.8	1.75	3.90	1.7	2.05	9.40	Off	1.00	Normal

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
January 9, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	1.6	5.08	8.10	0.9	1.82	3.90	1.6	2.02	9.40	Off	1.00	Normal
01	1.7	4.95	8.10	0.9	1.85	3.90	1.6	1.95	9.40	Off	1.00	Normal
02	1.7	4.94	8.10	1.0	1.81	3.90	1.6	1.92	9.40	Off	1.00	Normal
03	1.7	4.93	8.10	1.0	1.76	3.90	1.5	1.88	9.40	Off	1.00	Normal
04	1.7	5.25	8.10	1.0	1.84	3.90	1.5	1.89	9.40	Off	1.00	Normal
05	1.7	5.72	8.10	1.0	1.96	3.90	1.4	1.83	9.40	Off	1.00	Normal
06	1.7	5.72	8.10	1.0	2.08	3.90	1.4	1.79	9.40	Off	1.00	Normal
07	1.7	5.72	8.10	1.0	2.16	3.90	1.4	1.83	9.40	Off	1.00	Normal
08	1.7	5.82	8.10	1.0	2.17	3.90	1.4	1.83	9.40	Off	1.00	Normal
09	1.7	5.75	8.10	1.0	2.17	3.90	1.4	1.83	9.40	Off	1.00	Normal
10	1.6	4.80	8.10	1.0	1.98	3.90	1.4	1.74	9.40	Off	1.00	Normal
11	1.7	4.89	8.10	1.0	1.84	3.90	1.5	1.81	9.40	Off	1.00	Normal
12	1.7	4.90	8.10	1.0	1.68	3.90	1.5	1.88	9.40	Off	1.00	Normal
13	1.7	4.95	8.10	1.0	1.80	3.90	1.5	1.91	9.40	Off	1.00	Normal
14	1.7	4.93	8.10	1.1	1.91	3.90	1.6	1.94	9.40	Off	1.00	Normal
15	1.7	5.24	8.10	1.2	2.12	3.90	1.6	2.02	9.40	Off	1.00	Normal
16	1.6	5.94	8.10	1.1	2.16	3.90	1.6	2.02	9.40	Off	1.00	Normal
17	1.7	5.81	8.10	1.1	2.22	3.90	1.6	2.02	9.40	Off	1.00	Normal
18	1.7	5.87	8.10	1.0	2.15	3.90	1.7	2.06	9.40	Off	1.00	Normal
19	1.7	5.83	8.10	1.0	2.17	3.90	1.7	2.06	9.40	Off	1.00	Normal
20	1.7	5.90	8.10	1.0	2.12	3.90	1.7	2.10	9.40	Off	1.00	Normal
21	1.7	5.80	8.10	1.0	2.08	3.90	1.8	2.10	9.40	Off	1.00	Normal
22	1.7	5.85	8.10	0.9	1.98	3.90	1.8	2.14	9.40	Off	1.00	Normal
23	1.6	5.64	8.14	0.9	1.94	3.94	1.8	2.10	9.40	On	1.00	Normal

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
January 10, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	1.6	6.54	10.30	0.7	1.69	6.00	1.9	2.38	9.40	On	1.00	Normal
01	1.7	5.86	9.68	0.7	1.62	6.00	1.9	2.39	9.40	On	1.00	Normal
02	1.7	5.77	8.10	0.7	1.55	6.00	2.0	2.48	9.40	Off	1.00	Normal
03	1.7	5.80	8.10	0.8	1.74	5.41	2.0	2.53	9.40	Off	1.00	Normal
04	1.7	5.77	8.10	0.9	1.83	3.90	2.0	2.54	9.40	Off	1.00	Normal
05	1.7	5.78	8.10	0.9	1.93	3.90	2.0	2.54	9.40	Off	1.00	Normal
06	1.7	5.96	9.13	0.9	1.97	4.88	2.0	2.50	9.40	On	1.00	Normal
07	1.6	6.71	10.30	0.7	1.68	6.00	2.1	2.67	9.40	On	1.00	Normal
08	1.7	5.79	10.30	0.7	1.56	6.00	2.0	2.59	9.40	On	1.00	Normal
09	1.6	5.59	10.30	0.7	1.45	6.00	2.0	2.55	9.40	On	1.00	Normal
10	1.6	5.62	10.30	0.8	1.61	6.00	2.0	2.60	9.40	On	1.00	Normal
11	1.6	5.67	9.71	0.7	1.58	6.00	2.0	2.54	9.40	On	1.00	Normal
12	1.6	4.82	8.10	0.7	1.42	6.00	1.9	2.44	9.40	Off	1.00	Normal
13	1.7	4.89	8.10	0.7	1.25	5.44	1.9	2.40	9.40	Off	1.00	Normal
14	1.7	4.90	8.10	0.6	1.12	3.90	1.8	2.37	9.40	Off	1.00	Normal
15	1.7	5.24	8.65	0.6	1.17	4.43	1.7	2.26	9.40	On	1.00	Normal
16	1.7	5.88	10.30	0.7	1.31	6.00	1.7	2.22	9.40	On	1.00	Normal
17	1.7	6.00	10.30	0.7	1.50	6.00	1.7	2.22	9.40	On	1.00	Normal
18	1.7	6.00	10.30	0.7	1.66	6.00	1.6	2.18	9.40	On	1.00	Normal
19	1.7	5.90	10.30	0.8	1.73	6.00	1.6	2.18	9.40	On	1.00	Normal
20	1.7	5.83	9.90	0.8	1.81	6.00	1.6	2.14	9.40	On	1.00	Normal
21	1.7	5.79	8.10	0.9	1.88	6.00	1.6	2.18	9.40	Off	1.00	Normal
22	1.7	5.82	8.10	0.9	1.97	5.62	1.6	2.18	9.40	Off	1.00	Normal
23	1.7	4.14	8.10	0.9	1.76	3.90	1.5	2.14	9.40	Off	0.72	Shutdown

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
January 11, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	NSD	NSD	3.90	1.4	1.86	9.40	Off	0.00	Down
01	N/A	N/A	8.10	NSD	NSD	3.90	1.3	1.82	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	1.3	1.70	9.40	Off	0.40	Startup
03	1.7	4.83	8.10	NSD	NSD	3.90	1.2	1.58	9.40	Off	1.00	Startup
04	1.5	4.93	8.10	NSD	NSD	3.90	1.1	1.58	9.40	Off	1.00	Normal
05	1.6	4.99	8.10	0.5	0.96	3.90	1.1	1.56	9.40	Off	1.00	Normal
06	1.5	5.21	8.10	0.6	1.16	3.90	1.2	1.64	9.40	Off	1.00	Normal
07	1.5	5.41	8.10	0.6	1.17	3.90	1.1	1.52	9.40	Off	1.00	Normal
08	1.5	5.28	8.10	0.6	1.18	3.90	1.2	1.60	9.40	Off	1.00	Normal
09	1.5	4.39	8.10	0.6	1.12	3.90	1.1	1.52	9.40	Off	1.00	Normal
10	1.5	4.45	8.10	0.5	1.06	3.90	1.1	1.51	9.40	Off	1.00	Normal
11	1.5	4.45	8.10	0.5	0.97	3.90	1.1	1.47	9.40	Off	1.00	Normal
12	1.5	4.56	8.10	0.5	0.95	3.90	1.1	1.50	9.40	Off	1.00	Normal
13	1.5	4.48	8.10	0.5	0.95	3.90	1.1	1.47	9.40	Off	1.00	Normal
14	1.5	4.53	8.10	0.5	0.95	3.90	1.1	1.44	9.40	Off	1.00	Normal
15	1.5	4.73	8.10	0.5	0.99	3.90	1.1	1.47	9.40	Off	1.00	Normal
16	1.5	5.27	8.10	0.6	1.08	3.90	1.1	1.51	9.40	Off	1.00	Normal
17	1.5	5.38	8.10	0.6	1.20	3.90	1.2	1.55	9.40	Off	1.00	Normal
18	1.5	5.40	8.10	0.6	1.25	3.90	1.2	1.59	9.40	Off	1.00	Normal
19	1.5	5.29	8.10	0.6	1.25	3.90	1.3	1.63	9.40	Off	1.00	Normal
20	1.5	5.30	8.10	0.6	1.28	3.90	1.3	1.67	9.40	Off	1.00	Normal
21	1.5	5.25	8.10	0.6	1.31	3.90	1.3	1.67	9.40	Off	1.00	Normal
22	1.5	5.28	8.10	0.6	1.35	3.90	1.3	1.67	9.40	Off	1.00	Normal
23	1.5	5.28	8.10	0.6	1.34	3.90	1.4	1.79	9.40	Off	1.00	Normal

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
January 12, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	1.5	4.89	8.10	0.7	1.37	3.90	1.5	1.83	9.40	Off	1.00	Normal
01	1.5	5.22	8.10	0.7	1.39	3.90	1.6	1.98	9.40	Off	1.00	Normal
02	1.5	5.17	8.10	0.7	1.45	3.90	1.7	2.10	9.40	Off	1.00	Normal
03	1.5	5.17	8.10	0.7	1.51	3.90	1.8	2.22	9.40	Off	1.00	Normal
04	1.5	5.17	8.10	0.7	1.57	3.90	1.8	2.27	9.40	Off	1.00	Normal
05	1.5	5.23	8.10	0.8	1.61	3.90	1.9	2.36	9.40	Off	1.00	Normal
06	1.5	5.39	8.10	0.7	1.55	3.90	1.9	2.36	9.40	Off	1.00	Normal
07	1.5	5.29	8.10	0.7	1.50	3.90	1.9	2.32	9.40	Off	1.00	Normal
08	1.4	4.83	8.10	0.7	1.46	3.90	1.9	2.35	9.40	Off	1.00	Normal
09	1.5	4.36	8.10	0.7	1.38	3.90	1.9	2.35	9.40	Off	1.00	Normal
10	1.5	4.42	8.10	0.7	1.27	3.90	1.9	2.35	9.40	Off	1.00	Normal
11	1.5	4.46	8.10	0.6	1.16	3.90	2.0	2.39	9.40	Off	1.00	Normal
12	1.5	4.56	8.10	0.6	1.13	3.90	2.0	2.39	9.40	Off	1.00	Normal
13	1.5	4.57	8.10	0.7	1.17	3.90	2.0	2.42	9.40	Off	1.00	Normal
14	1.5	4.58	8.10	0.7	1.22	3.90	2.0	2.46	9.40	Off	1.00	Normal
15	1.5	4.74	8.10	0.7	1.30	3.90	2.1	2.53	9.40	Off	1.00	Normal
16	1.5	5.26	8.10	0.7	1.34	3.90	2.1	2.49	9.40	Off	1.00	Normal
17	1.5	5.37	8.10	0.7	1.39	3.90	2.0	2.49	9.40	Off	1.00	Normal
18	1.5	5.24	8.10	0.7	1.40	3.90	2.0	2.45	9.40	Off	1.00	Normal
19	1.5	5.26	8.10	0.7	1.43	3.90	2.0	2.45	9.40	Off	1.00	Normal
20	1.5	5.29	8.10	0.7	1.43	3.90	2.0	2.44	9.40	Off	1.00	Normal
21	1.5	5.11	8.10	0.7	1.42	3.90	2.0	2.48	9.40	Off	1.00	Normal
22	1.5	5.31	8.10	0.7	1.42	3.90	2.0	2.48	9.40	Off	1.00	Normal
23	1.5	5.30	8.10	0.7	1.42	3.90	2.0	2.48	9.40	Off	1.00	Normal

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
January 13, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	1.5	4.67	8.10	0.7	1.40	3.90	2.0	2.44	9.40	Off	1.00	Normal
01	1.5	4.48	8.10	0.7	1.36	3.90	1.9	2.35	9.40	Off	1.00	Normal
02	1.5	4.53	8.10	0.7	1.29	3.90	1.9	2.30	9.40	Off	1.00	Normal
03	1.5	4.57	8.10	0.7	1.27	3.90	1.8	2.25	9.40	Off	1.00	Normal
04	1.5	4.89	8.10	0.7	1.35	3.90	1.8	2.20	9.40	Off	1.00	Normal
05	1.5	5.33	8.10	0.8	1.45	3.90	1.8	2.12	9.40	Off	1.00	Normal
06	1.6	5.36	8.10	0.7	1.49	3.90	1.8	2.08	9.40	Off	1.00	Normal
07	1.6	5.43	8.10	0.7	1.45	3.90	1.8	2.12	9.40	Off	1.00	Normal
08	1.6	5.36	8.10	0.7	1.39	3.90	1.8	2.08	9.40	Off	1.00	Normal
09	1.6	5.50	8.10	0.6	1.33	3.90	1.9	2.20	9.40	Off	1.00	Normal
10	1.5	4.59	8.10	0.6	1.23	3.90	1.8	2.13	9.40	Off	1.00	Normal
11	1.6	4.67	8.10	0.6	1.12	3.90	1.8	2.13	9.40	Off	1.00	Normal
12	1.6	4.62	8.10	0.6	1.03	3.90	1.8	2.13	9.40	Off	1.00	Normal
13	1.6	4.62	8.10	0.5	1.00	3.90	1.8	2.13	9.40	Off	1.00	Normal
14	1.6	4.68	8.10	0.6	1.00	3.90	1.8	2.13	9.40	Off	1.00	Normal
15	1.5	4.62	8.10	0.6	1.07	3.90	1.8	2.13	9.40	Off	1.00	Normal
16	1.5	5.34	8.10	0.6	1.13	3.90	1.8	2.17	9.40	Off	1.00	Normal
17	1.6	6.53	9.05	0.5	1.13	4.81	1.9	2.28	9.40	On	1.00	Normal
18	1.6	5.57	10.30	0.5	1.13	6.00	1.8	2.20	9.40	On	1.00	Normal
19	1.7	5.79	10.30	0.5	1.12	6.00	1.8	2.16	9.40	On	1.00	Normal
20	1.7	5.60	10.30	0.6	1.16	6.00	1.8	2.11	9.40	On	1.00	Normal
21	1.7	5.75	10.30	0.6	1.25	6.00	1.7	2.03	9.40	On	1.00	Normal
22	1.7	5.75	10.30	0.6	1.31	6.00	1.6	1.99	9.40	On	1.00	Normal
23	1.7	5.78	10.30	0.7	1.41	6.00	1.6	1.95	9.40	On	1.00	Normal

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
January 14, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	1.6	5.02	8.58	0.6	1.34	6.00	1.6	1.99	9.40	On	1.00	Normal
01	1.6	4.73	8.10	0.6	1.21	6.00	1.6	1.99	9.40	Off	1.00	Normal
02	1.6	4.74	8.10	0.6	1.11	4.36	1.6	1.99	9.40	Off	1.00	Normal
03	1.6	4.76	8.10	0.6	1.12	3.90	1.6	1.99	9.40	Off	1.00	Normal
04	1.6	5.06	8.10	0.7	1.20	3.90	1.6	1.99	9.40	Off	1.00	Normal
05	1.6	5.55	8.10	0.7	1.30	3.90	1.6	1.98	9.40	Off	1.00	Normal
06	1.6	5.71	8.10	0.7	1.37	3.90	1.6	1.99	9.40	Off	1.00	Normal
07	1.6	5.65	8.10	0.7	1.43	3.90	1.6	1.99	9.40	Off	1.00	Normal
08	1.5	5.76	9.60	0.6	1.37	5.34	1.5	1.91	9.40	On	1.00	Normal
09	1.6	5.91	10.30	0.5	1.19	6.00	1.5	1.83	9.40	On	1.00	Normal
10	1.6	5.89	8.87	0.4	1.01	6.00	1.5	1.88	9.40	On	1.00	Normal
11	1.6	6.09	8.10	0.4	0.80	6.00	1.5	1.93	9.40	Off	1.00	Normal
12	1.4	4.88	8.10	0.3	0.72	4.64	1.6	2.01	9.40	Off	1.00	Normal
13	1.4	4.25	8.10	0.3	0.60	3.90	1.6	2.04	9.40	Off	1.00	Normal
14	1.4	4.18	8.10	0.3	0.61	3.90	1.6	2.04	9.40	Off	1.00	Normal
15	1.5	4.65	8.10	0.4	0.65	3.90	1.5	2.01	9.40	Off	1.00	Normal
16	1.6	5.62	8.10	0.4	0.82	3.90	1.5	1.93	9.40	Off	1.00	Normal
17	1.6	5.61	8.10	0.5	0.98	3.90	1.4	1.78	9.40	Off	1.00	Normal
18	1.6	5.59	8.10	0.5	1.11	3.90	1.5	1.86	9.40	Off	1.00	Normal
19	1.6	5.58	8.10	0.6	1.17	3.90	1.5	1.86	9.40	Off	1.00	Normal
20	1.6	5.57	8.10	0.6	1.20	3.90	1.5	1.90	9.40	Off	1.00	Normal
21	1.6	5.35	8.10	0.6	1.26	3.90	1.6	1.98	9.40	Off	1.00	Normal
22	1.6	5.71	8.10	0.6	1.29	3.90	1.6	2.02	9.40	Off	1.00	Normal
23	1.6	5.57	8.10	0.6	1.32	3.90	1.7	2.06	9.40	Off	1.00	Normal

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
January 15, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	1.6	4.95	8.10	0.6	1.28	3.90	1.7	2.06	9.40	Off	1.00	Normal
01	1.6	4.75	8.10	0.6	1.18	3.90	1.7	2.09	9.40	Off	1.00	Normal
02	1.6	5.02	8.10	0.6	1.18	3.90	1.7	2.17	9.40	Off	1.00	Normal
03	1.6	4.79	8.10	0.6	1.16	3.90	1.7	2.13	9.40	Off	1.00	Normal
04	1.6	4.82	8.10	0.6	1.11	3.90	1.7	2.10	9.40	Off	1.00	Normal
05	1.5	4.87	8.10	0.6	1.02	3.90	1.7	2.12	9.40	Off	1.00	Normal
06	1.6	6.14	9.02	0.6	1.12	4.78	1.7	2.13	9.40	On	1.00	Normal
07	Maint	Maint	10.30	Maint	Maint	6.00	1.6	2.06	9.40	On	1.00	Normal
08	1.4	4.89	10.30	Maint	Maint	6.00	1.7	2.10	9.40	On	1.00	Normal
09	1.6	5.69	10.30	Maint	Maint	6.00	1.7	2.14	9.40	On	1.00	Normal
10	1.6	5.69	10.30	0.4	0.93	6.00	1.7	2.18	9.40	On	1.00	Normal
11	1.6	5.69	10.30	0.4	0.90	6.00	1.7	2.17	9.40	On	1.00	Normal
12	1.6	5.70	10.30	0.4	0.84	6.00	1.7	2.14	9.40	On	1.00	Normal
13	1.6	5.71	10.30	0.4	0.80	6.00	1.7	2.15	9.40	On	1.00	Normal
14	1.6	5.73	10.30	0.4	0.77	6.00	1.7	2.20	9.40	On	1.00	Normal
15	1.6	5.72	10.30	0.3	0.74	6.00	1.6	2.18	9.40	On	1.00	Normal
16	1.6	5.72	10.30	0.3	0.74	6.00	1.7	2.22	9.40	On	1.00	Normal
17	1.6	5.71	10.30	0.3	0.74	6.00	1.6	2.22	9.40	On	1.00	Normal
18	1.6	5.70	10.30	0.4	0.80	6.00	1.6	2.22	9.40	On	1.00	Normal
19	1.6	5.70	10.30	0.4	0.80	6.00	1.6	2.23	9.40	On	1.00	Normal
20	1.6	5.78	10.30	0.4	0.80	6.00	1.6	2.19	9.40	On	1.00	Normal
21	1.7	5.89	10.30	0.4	0.77	6.00	1.6	2.11	9.40	On	1.00	Normal
22	1.7	5.89	10.30	0.4	0.77	6.00	1.5	2.07	9.40	On	1.00	Normal
23	1.7	5.88	10.30	0.4	0.77	6.00	1.5	2.03	9.40	On	1.00	Normal

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
January 16, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	1.6	5.46	8.32	0.4	0.79	6.00	1.5	2.03	9.40	On	1.00	Normal
01	1.6	4.72	8.10	0.4	0.72	6.00	1.5	2.03	9.40	Off	1.00	Normal
02	1.6	4.71	8.10	0.3	0.65	4.11	1.5	2.02	9.40	Off	1.00	Normal
03	1.6	4.73	8.10	0.3	0.59	3.90	1.6	2.12	9.40	Off	1.00	Normal
04	1.6	4.73	8.10	0.3	0.61	3.90	1.7	2.19	9.40	Off	1.00	Normal
05	1.5	4.66	8.10	0.4	0.66	3.90	1.7	2.27	9.40	Off	1.00	Normal
06	1.6	5.88	8.10	0.3	0.67	3.90	1.7	2.26	9.40	Off	1.00	Normal
07	1.5	5.76	9.24	0.3	0.63	4.99	1.7	2.21	9.40	On	1.00	Normal
08	1.6	5.82	10.30	0.3	0.57	6.00	1.7	2.21	9.40	On	1.00	Normal
09	1.6	5.79	10.19	0.2	0.47	6.00	1.7	2.21	9.40	On	1.00	Normal
10	1.6	4.61	8.10	0.2	0.46	6.00	1.7	2.17	9.40	Off	1.00	Normal
11	1.6	4.69	8.10	0.3	0.48	5.90	1.7	2.15	9.40	Off	1.00	Normal
12	1.6	4.71	8.10	0.3	0.53	3.90	1.7	2.10	9.40	Off	1.00	Normal
13	1.6	4.77	8.10	0.3	0.62	3.90	1.7	2.06	9.40	Off	1.00	Normal
14	1.6	4.70	8.10	0.3	0.59	3.90	1.7	2.04	9.40	Off	1.00	Normal
15	1.6	5.39	8.10	0.4	0.64	3.90	1.7	2.07	9.40	Off	1.00	Normal
16	1.6	5.71	8.10	0.3	0.63	3.90	1.7	2.07	9.40	Off	1.00	Normal
17	1.6	5.66	8.10	0.3	0.69	3.90	1.7	2.11	9.40	Off	1.00	Normal
18	1.6	5.63	8.10	0.3	0.70	3.90	1.7	2.11	9.40	Off	1.00	Normal
19	1.6	5.67	8.10	0.3	0.73	3.90	1.8	2.11	9.40	Off	1.00	Normal
20	1.6	5.64	8.10	0.4	0.76	3.90	1.8	2.15	9.40	Off	1.00	Normal
21	1.6	5.64	8.10	0.4	0.76	3.90	1.8	2.19	9.40	Off	1.00	Normal
22	1.6	5.65	8.10	0.4	0.76	3.90	1.8	2.23	9.40	Off	1.00	Normal
23	1.6	5.65	8.10	0.4	0.77	3.90	1.8	2.27	9.40	Off	1.00	Normal

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
January 17, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	1.6	4.98	8.10	0.4	0.74	3.90	1.9	2.33	9.40	Off	1.00	Normal
01	1.6	4.72	8.10	0.3	0.64	3.90	1.9	2.33	9.40	Off	1.00	Normal
02	1.6	4.74	8.10	0.3	0.57	3.90	1.9	2.30	9.40	Off	1.00	Normal
03	1.6	4.75	8.10	0.3	0.53	3.90	1.9	2.30	9.40	Off	1.00	Normal
04	1.6	5.16	8.10	0.3	0.63	3.90	2.0	2.42	9.40	Off	1.00	Normal
05	1.7	5.75	8.10	0.4	0.88	3.90	1.9	2.40	9.40	Off	1.00	Normal
06	1.7	6.32	8.10	0.5	1.13	3.90	2.1	2.61	9.40	Off	1.00	Normal
07	1.6	5.78	8.10	0.6	1.39	3.90	2.1	2.65	9.40	Off	1.00	Normal
08	1.7	5.79	8.10	0.7	1.45	3.90	2.2	2.77	9.40	Off	1.00	Normal
09	1.7	5.92	8.10	0.7	1.53	3.90	2.3	2.84	9.40	Off	1.00	Normal
10	1.8	6.21	8.10	0.7	1.49	3.90	2.4	2.93	9.40	Off	1.00	Normal
11	1.8	6.22	8.10	0.7	1.47	3.90	2.4	2.98	9.40	Off	1.00	Normal
12	1.8	6.31	8.10	0.6	1.38	3.90	2.5	3.07	9.40	Off	1.00	Normal
13	1.8	6.27	8.10	0.6	1.32	3.90	2.5	3.12	9.40	Off	1.00	Normal
14	1.8	6.38	8.10	0.6	1.27	3.90	2.5	3.13	9.40	Off	1.00	Normal
15	1.8	6.36	8.10	0.6	1.27	3.90	2.5	3.14	9.40	Off	1.00	Normal
16	1.8	6.16	8.10	0.6	1.33	3.90	2.5	3.14	9.40	Off	1.00	Normal
17	1.8	6.10	8.10	0.7	1.41	3.90	2.5	3.10	9.40	Off	1.00	Normal
18	1.7	5.48	8.10	0.7	1.48	3.90	2.4	3.06	9.40	Off	1.00	Normal
19	1.8	6.10	9.24	0.8	1.60	4.99	2.4	3.02	9.40	On	1.00	Normal
20	1.8	6.21	10.30	0.8	1.69	6.00	2.4	2.98	9.40	On	1.00	Normal
21	1.7	6.06	10.30	0.9	1.80	6.00	2.3	2.94	9.40	On	1.00	Normal
22	1.7	6.01	10.30	0.9	1.85	6.00	2.3	2.90	9.40	On	1.00	Normal
23	1.6	5.73	10.30	0.9	1.88	6.00	2.3	2.86	9.40	On	1.00	Normal

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
January 18, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	1.7	6.02	10.30	0.9	1.91	6.00	2.2	2.83	9.40	On	1.00	Normal
01	1.7	6.04	10.30	0.9	1.91	6.00	2.2	2.81	9.40	On	1.00	Normal
02	1.7	6.04	10.30	0.9	1.88	6.00	2.1	2.79	9.40	On	1.00	Normal
03	1.7	6.06	10.30	0.9	1.85	6.00	2.1	2.74	9.40	On	1.00	Normal
04	1.7	6.07	10.30	0.9	1.82	6.00	1.9	2.57	9.40	On	1.00	Normal
05	1.7	6.14	10.30	0.9	1.82	6.00	1.8	2.45	9.40	On	1.00	Normal
06	1.7	6.06	10.30	0.9	1.83	6.00	1.6	2.20	9.40	On	1.00	Normal
07	1.7	6.06	10.30	0.9	1.82	6.00	1.6	2.20	9.40	On	1.00	Normal
08	1.7	5.84	9.31	0.9	1.80	6.00	1.5	2.04	9.40	On	1.00	Normal
09	1.7	5.01	8.10	0.8	1.62	6.00	1.4	1.91	9.40	Off	1.00	Normal
10	1.7	5.05	8.10	0.7	1.39	5.06	1.4	1.86	9.40	Off	1.00	Normal
11	1.7	5.06	8.10	0.7	1.20	3.90	1.3	1.81	9.40	Off	1.00	Normal
12	1.7	5.05	8.10	0.6	1.15	3.90	1.3	1.75	9.40	Off	1.00	Normal
13	1.7	5.05	8.10	0.6	1.15	3.90	1.3	1.74	9.40	Off	1.00	Normal
14	1.7	5.07	8.10	0.6	1.12	3.90	1.3	1.72	9.40	Off	1.00	Normal
15	1.7	5.36	8.10	0.7	1.20	3.90	1.3	1.71	9.40	Off	1.00	Normal
16	1.7	5.93	8.10	0.7	1.36	3.90	1.3	1.74	9.40	Off	1.00	Normal
17	1.7	5.98	9.49	0.7	1.53	5.23	1.3	1.70	9.40	On	1.00	Normal
18	1.7	6.02	10.30	0.8	1.61	6.00	1.3	1.75	9.40	On	1.00	Normal
19	1.7	5.98	10.30	0.8	1.62	6.00	1.3	1.79	9.40	On	1.00	Normal
20	1.7	6.00	10.30	0.7	1.59	6.00	1.3	1.79	9.40	On	1.00	Normal
21	1.7	6.00	10.30	0.7	1.59	6.00	1.3	1.79	9.40	On	1.00	Normal
22	1.6	6.02	10.30	0.7	1.55	6.00	1.4	1.83	9.40	On	1.00	Normal
23	1.7	6.10	10.30	0.7	1.55	6.00	1.4	1.83	9.40	On	1.00	Normal

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
 Tracy, CA
Unit 1 Daily Emission Compliance Report
 January 19, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	1.7	6.03	10.30	0.7	1.55	6.00	1.4	1.83	9.40	On	1.00	Normal
01	1.7	6.01	10.30	0.8	1.62	6.00	1.4	1.83	9.40	On	1.00	Normal
02	1.7	6.01	10.30	0.8	1.72	6.00	1.4	1.83	9.40	On	1.00	Normal
03	1.7	6.02	10.30	0.8	1.79	6.00	1.4	1.83	9.40	On	1.00	Normal
04	1.7	6.04	10.30	0.9	1.82	6.00	1.4	1.83	9.40	On	1.00	Normal
05	1.7	5.96	10.30	0.9	1.83	6.00	1.4	1.83	9.40	On	1.00	Normal
06	1.7	6.09	10.30	0.8	1.80	6.00	1.4	1.83	9.40	On	1.00	Normal
07	1.7	6.02	10.30	0.8	1.80	6.00	1.4	1.83	9.40	On	1.00	Normal
08	1.7	5.82	9.31	0.9	1.80	6.00	1.4	1.83	9.40	On	1.00	Normal
09	1.7	5.05	8.10	0.9	1.71	6.00	1.4	1.83	9.40	Off	1.00	Normal
10	1.7	5.11	8.10	0.8	1.57	5.06	1.4	1.87	9.40	Off	1.00	Normal
11	1.7	5.09	8.10	0.8	1.41	3.90	1.4	1.87	9.40	Off	1.00	Normal
12	1.7	5.12	8.10	0.8	1.40	3.90	1.4	1.87	9.40	Off	1.00	Normal
13	1.7	5.12	8.10	0.8	1.43	3.90	1.4	1.87	9.40	Off	1.00	Normal
14	1.7	5.12	8.10	0.8	1.43	3.90	1.5	1.87	9.40	Off	1.00	Normal
15	1.8	7.05	9.71	0.7	1.41	5.44	1.5	1.99	9.40	On	1.00	Normal
16	1.6	5.86	10.30	0.7	1.47	6.00	1.5	1.91	9.40	On	1.00	Normal
17	1.7	6.04	10.30	0.7	1.55	6.00	1.5	1.95	9.40	On	1.00	Normal
18	1.7	6.02	10.30	0.8	1.63	6.00	1.5	1.95	9.40	On	1.00	Normal
19	1.7	5.96	10.30	0.8	1.63	6.00	1.5	1.95	9.40	On	1.00	Normal
20	1.7	5.85	10.30	0.8	1.66	6.00	1.5	1.95	9.40	On	1.00	Normal
21	1.7	5.86	10.30	0.8	1.70	6.00	1.5	1.95	9.40	On	1.00	Normal
22	1.7	5.86	10.30	0.8	1.73	6.00	1.5	1.90	9.40	On	1.00	Normal
23	1.7	5.84	9.79	0.8	1.76	6.00	1.5	1.90	9.40	On	1.00	Normal

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
January 20, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	1.6	5.13	8.10	0.8	1.72	6.00	1.5	1.86	9.40	Off	1.00	Normal
01	1.7	4.95	8.10	0.8	1.63	5.51	1.5	1.85	9.40	Off	1.00	Normal
02	1.7	4.94	8.10	0.8	1.51	3.90	1.5	1.84	9.40	Off	1.00	Normal
03	1.7	4.94	8.10	0.8	1.49	3.90	1.5	1.82	9.40	Off	1.00	Normal
04	1.7	5.30	8.10	0.9	1.60	3.90	1.6	1.89	9.40	Off	1.00	Normal
05	1.7	5.85	8.10	0.9	1.72	3.90	1.6	1.97	9.40	Off	1.00	Normal
06	1.7	5.86	8.10	0.9	1.82	3.90	1.7	2.05	9.40	Off	1.00	Normal
07	1.7	5.94	8.10	0.9	1.82	3.90	1.7	2.13	9.40	Off	1.00	Normal
08	1.7	5.90	8.10	0.9	1.83	3.90	1.8	2.21	9.40	Off	1.00	Normal
09	1.7	5.84	8.10	0.9	1.83	3.90	1.9	2.29	9.40	Off	1.00	Normal
10	1.7	5.90	8.10	0.8	1.80	3.90	1.9	2.35	9.40	Off	1.00	Normal
11	1.6	5.86	8.10	0.8	1.73	3.90	1.9	2.41	9.40	Off	1.00	Normal
12	1.7	5.81	8.10	0.8	1.66	3.90	1.9	2.46	9.40	Off	1.00	Normal
13	1.7	5.85	8.10	0.8	1.63	3.90	1.9	2.51	9.40	Off	1.00	Normal
14	1.7	5.85	8.10	0.7	1.59	3.90	2.0	2.56	9.40	Off	1.00	Normal
15	1.7	5.81	8.10	0.7	1.59	3.90	1.9	2.42	9.40	Off	1.00	Normal
16	1.7	5.86	8.10	0.7	1.56	3.90	1.9	2.50	9.40	Off	1.00	Normal
17	1.7	5.82	8.10	0.7	1.59	3.90	2.0	2.54	9.40	Off	1.00	Normal
18	1.7	5.85	8.10	0.7	1.60	3.90	2.0	2.58	9.40	Off	1.00	Normal
19	1.7	5.84	8.10	0.8	1.63	3.90	2.0	2.62	9.40	Off	1.00	Normal
20	1.7	5.81	8.10	0.8	1.66	3.90	2.1	2.66	9.40	Off	1.00	Normal
21	1.7	5.83	8.10	0.8	1.69	3.90	2.1	2.70	9.40	Off	1.00	Normal
22	1.7	5.84	8.10	0.8	1.75	3.90	2.1	2.74	9.40	Off	1.00	Normal
23	1.7	5.83	8.10	0.8	1.72	3.90	2.2	2.78	9.40	Off	1.00	Normal

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
January 21, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	1.6	5.47	8.10	0.8	1.71	3.90	2.2	2.82	9.40	Off	1.00	Normal
01	1.7	4.99	8.10	0.8	1.58	3.90	2.2	2.82	9.40	Off	1.00	Normal
02	1.7	4.94	8.10	0.8	1.53	3.90	2.2	2.82	9.40	Off	1.00	Normal
03	1.6	4.84	8.10	0.8	1.45	3.90	2.2	2.82	9.40	Off	1.00	Normal
04	1.7	5.29	8.10	0.8	1.51	3.90	2.2	2.82	9.40	Off	1.00	Normal
05	1.6	5.87	10.04	0.8	1.58	5.76	2.2	2.74	9.40	On	1.00	Normal
06	1.7	5.93	10.30	0.8	1.64	6.00	2.1	2.66	9.40	On	1.00	Normal
07	1.7	5.88	10.30	0.8	1.65	6.00	2.0	2.58	9.40	On	1.00	Normal
08	1.7	5.87	10.30	0.8	1.71	6.00	2.0	2.54	9.40	On	1.00	Normal
09	1.7	5.89	10.30	0.8	1.73	6.00	1.9	2.50	9.40	On	1.00	Normal
10	1.7	5.88	10.30	0.8	1.73	6.00	1.8	2.42	9.40	On	1.00	Normal
11	1.6	5.59	9.31	0.8	1.68	6.00	1.8	2.34	9.40	On	1.00	Normal
12	1.6	4.92	8.10	0.8	1.65	6.00	1.7	2.22	9.40	Off	1.00	Normal
13	1.7	5.02	8.10	0.9	1.68	5.06	1.6	2.13	9.40	Off	1.00	Normal
14	1.7	5.02	8.10	0.9	1.67	3.90	1.6	2.05	9.40	Off	1.00	Normal
15	1.7	5.38	8.69	0.9	1.64	4.46	1.5	2.00	9.40	On	1.00	Normal
16	1.6	5.92	10.30	0.8	1.55	6.00	1.5	1.93	9.40	On	1.00	Normal
17	1.7	5.87	10.30	0.7	1.52	6.00	1.4	1.85	9.40	On	1.00	Normal
18	1.7	5.88	10.30	0.7	1.51	6.00	1.4	1.77	9.40	On	1.00	Normal
19	1.7	5.87	10.30	0.7	1.54	6.00	1.3	1.69	9.40	On	1.00	Normal
20	1.6	5.67	10.30	0.7	1.57	6.00	1.3	1.61	9.40	On	1.00	Normal
21	1.6	5.66	10.30	0.7	1.60	6.00	1.2	1.57	9.40	On	1.00	Normal
22	1.6	5.39	8.83	0.8	1.61	6.00	1.2	1.49	9.40	On	1.00	Normal
23	1.6	4.81	8.10	0.7	1.47	6.00	1.0	1.37	9.40	Off	1.00	Normal

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
January 22, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	1.7	4.91	8.10	0.7	1.38	4.60	1.0	1.32	9.40	Off	1.00	Normal
01	1.7	4.91	8.10	0.7	1.31	3.90	1.0	1.29	9.40	Off	1.00	Normal
02	1.7	4.92	8.10	0.8	1.40	3.90	1.0	1.26	9.40	Off	1.00	Normal
03	1.7	4.93	8.10	0.8	1.42	3.90	0.9	1.22	9.40	Off	1.00	Normal
04	1.7	4.94	8.10	0.8	1.48	3.90	0.8	1.11	9.40	Off	1.00	Normal
05	1.7	5.38	8.69	0.8	1.51	4.46	0.8	1.07	9.40	On	1.00	Normal
06	1.7	5.92	10.30	0.8	1.64	6.00	0.8	1.03	9.40	On	1.00	Normal
07	1.7	5.89	10.30	0.8	1.74	6.00	0.8	0.99	9.40	On	1.00	Normal
08	1.7	5.87	10.30	0.8	1.83	6.00	0.8	0.95	9.40	On	1.00	Normal
09	1.7	5.92	10.30	0.8	1.80	6.00	0.7	0.91	9.40	On	1.00	Normal
10	1.6	5.57	9.35	0.8	1.78	6.00	0.7	0.87	9.40	On	1.00	Normal
11	1.6	4.96	8.10	0.9	1.75	6.00	0.7	0.83	9.40	Off	1.00	Normal
12	1.7	5.06	8.10	0.9	1.75	5.09	0.7	0.83	9.40	Off	1.00	Normal
13	1.7	5.06	8.10	0.9	1.74	3.90	0.7	0.79	9.40	Off	1.00	Normal
14	1.7	5.00	8.10	0.9	1.65	3.90	0.7	0.76	9.40	Off	1.00	Normal
15	1.7	5.48	8.69	0.8	1.59	4.46	0.7	0.76	9.40	On	1.00	Normal
16	1.6	5.94	10.30	0.8	1.50	6.00	0.7	0.76	9.40	On	1.00	Normal
17	1.7	5.91	10.30	0.7	1.53	6.00	0.7	0.76	9.40	On	1.00	Normal
18	1.5	4.60	8.36	0.8	1.56	6.00	0.6	0.76	9.40	On	1.00	Normal
19	1.5	5.05	8.10	0.8	1.65	6.00	0.6	0.75	9.40	Off	1.00	Normal
20	1.7	5.75	8.10	0.8	1.73	4.15	0.6	0.75	9.40	Off	1.00	Normal
21	1.7	5.81	8.10	0.8	1.78	3.90	0.6	0.75	9.40	Off	1.00	Normal
22	1.6	5.81	8.10	0.8	1.80	3.90	0.7	0.79	9.40	Off	1.00	Normal
23	1.6	5.62	8.10	0.8	1.81	3.90	0.8	0.87	9.40	Off	1.00	Normal

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
January 23, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	1.5	4.83	8.10	0.9	1.83	3.90	0.8	0.88	9.40	Off	1.00	Normal
01	1.6	4.85	8.10	0.9	1.71	3.90	0.8	0.88	9.40	Off	1.00	Normal
02	1.6	4.80	8.10	0.9	1.63	3.90	0.8	0.91	9.40	Off	1.00	Normal
03	1.6	4.83	8.10	0.9	1.55	3.90	0.8	0.94	9.40	Off	1.00	Normal
04	1.4	4.62	8.10	0.9	1.71	3.90	0.9	1.02	9.40	Off	1.00	Normal
05	1.7	6.19	8.10	0.9	1.78	3.90	0.9	1.07	9.40	Off	1.00	Normal
06	1.6	5.72	8.10	0.8	1.78	3.90	1.0	1.19	9.40	Off	1.00	Normal
07	1.6	5.59	8.10	0.8	1.73	3.90	1.0	1.23	9.40	Off	1.00	Normal
08	1.6	5.58	8.10	0.8	1.75	3.90	1.0	1.27	9.40	Off	1.00	Normal
09	1.6	4.78	8.10	0.8	1.71	3.90	1.0	1.23	9.40	Off	1.00	Normal
10	1.6	4.76	8.10	0.8	1.57	3.90	1.0	1.22	9.40	Off	1.00	Normal
11	1.6	4.76	8.10	0.8	1.40	3.90	1.0	1.25	9.40	Off	1.00	Normal
12	1.6	4.74	8.10	0.7	1.26	3.90	1.1	1.29	9.40	Off	1.00	Normal
13	1.6	4.75	8.10	0.7	1.21	3.90	1.1	1.32	9.40	Off	1.00	Normal
14	1.6	4.75	8.10	0.7	1.21	3.90	1.1	1.35	9.40	Off	1.00	Normal
15	1.6	5.03	8.10	0.7	1.32	3.90	1.1	1.42	9.40	Off	1.00	Normal
16	1.6	5.70	8.10	0.7	1.43	3.90	1.2	1.42	9.40	Off	1.00	Normal
17	1.6	5.61	8.10	0.8	1.57	3.90	1.2	1.42	9.40	Off	1.00	Normal
18	1.6	5.57	8.10	0.8	1.65	3.90	1.2	1.43	9.40	Off	1.00	Normal
19	1.6	5.56	8.10	0.8	1.70	3.90	1.2	1.43	9.40	Off	1.00	Normal
20	1.6	5.61	8.10	0.8	1.67	3.90	1.2	1.47	9.40	Off	1.00	Normal
21	1.6	5.41	8.10	0.8	1.68	3.90	1.2	1.47	9.40	Off	1.00	Normal
22	1.6	5.55	8.10	0.8	1.67	3.90	1.2	1.43	9.40	Off	1.00	Normal
23	1.6	5.55	8.10	0.8	1.70	3.90	1.2	1.43	9.40	Off	1.00	Normal

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
January 24, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	1.6	5.14	8.10	0.8	1.68	3.90	1.2	1.39	9.40	Off	1.00	Normal
01	1.6	4.79	8.10	0.8	1.60	3.90	1.2	1.39	9.40	Off	1.00	Normal
02	1.6	4.80	8.10	0.8	1.55	3.90	1.2	1.35	9.40	Off	1.00	Normal
03	1.6	4.81	8.10	0.8	1.52	3.90	1.1	1.32	9.40	Off	1.00	Normal
04	1.6	4.82	8.10	0.9	1.60	3.90	1.1	1.24	9.40	Off	1.00	Normal
05	1.6	4.88	8.10	0.9	1.63	3.90	1.1	1.23	9.40	Off	1.00	Normal
06	1.6	5.59	8.10	0.9	1.69	3.90	1.1	1.23	9.40	Off	1.00	Normal
07	1.6	5.81	8.76	0.8	1.66	4.53	1.1	1.23	9.40	On	1.00	Normal
08	1.6	4.82	8.10	0.8	1.61	4.53	1.0	1.19	9.40	Off	1.00	Normal
09	1.6	4.77	8.10	0.8	1.50	4.53	1.1	1.22	9.40	Off	1.00	Normal
10	1.6	4.78	8.10	0.8	1.42	3.90	1.1	1.22	9.40	Off	1.00	Normal
11	1.6	4.79	8.10	0.8	1.38	3.90	1.0	1.19	9.40	Off	1.00	Normal
12	1.6	4.65	8.10	0.8	1.38	3.90	1.0	1.16	9.40	Off	1.00	Normal
13	1.5	4.41	8.10	0.8	1.44	3.90	1.0	1.12	9.40	Off	1.00	Normal
14	1.6	4.74	8.10	0.8	1.42	3.90	0.9	1.09	9.40	Off	1.00	Normal
15	1.6	5.45	8.10	0.7	1.36	3.90	0.9	1.06	9.40	Off	1.00	Normal
16	1.6	5.70	8.10	0.6	1.29	3.90	0.9	1.02	9.40	Off	1.00	Normal
17	1.6	5.68	8.10	0.6	1.31	3.90	0.9	1.02	9.40	Off	1.00	Normal
18	1.6	5.63	8.10	0.6	1.38	3.90	0.9	1.02	9.40	Off	1.00	Normal
19	1.6	1.58	8.10	0.7	1.07	3.90	0.8	0.98	9.40	Off	0.53	Shutdown
20	N/A	N/A	8.10	NSD	NSD	3.90	0.8	0.90	9.40	Off	0.00	Down
21	N/A	N/A	8.10	NSD	NSD	3.90	0.7	0.82	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.7	0.79	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.6	0.71	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
January 25, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.6	0.71	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.6	0.67	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.5	0.64	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.5	0.61	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.4	0.57	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.4	0.50	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.3	0.34	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.2	0.26	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.2	0.23	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.2	0.19	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.1	0.16	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.1	0.16	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.1	0.16	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.1	0.16	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.1	0.16	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.1	0.08	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.1	0.08	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.04	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
January 26, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
January 27, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
January 28, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
January 29, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
January 30, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
January 31, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Turbine 1- Monthly Mass Emissions Report
January - 2020

Daily Emission Limits		12 Month Rolling Emission Limits	
NOx lbs - 814.9	CO lbs - 1071.6	NOx lbs - 88,881	CO lbs - 74,598
SOx lbs - 58.7	PM lbs - 132	SOx lbs - 7,084	PM lbs - 32,250
VOC lbs - 78.6		VOC lbs - 15,145	

Day	NOx lbs	SOx lbs	CO lbs	PM lbs	NH3 Slip lbs	VOC lbs	Turbine On-Time
01	126.7	9.9	28.8	21.4	32.8	2.2	24.0
02	127.0	10.1	37.0	21.8	30.2	2.2	24.0
03	126.3	10.0	42.3	21.5	60.3	1.9	24.0
04	127.9	10.3	41.7	22.1	51.7	1.9	24.0
05	121.9	10.2	43.2	22.0	47.9	1.9	24.0
06	117.6	10.0	40.5	21.4	49.2	2.0	24.0
07	119.7	9.7	46.5	20.7	52.6	2.0	24.0
08	128.6	9.9	47.7	21.3	49.2	1.9	24.0
09	130.2	10.0	47.9	21.4	50.5	1.9	24.0
10	136.1	10.4	38.4	22.4	54.2	2.1	23.7
11	110.4	8.9	24.3	19.1	46.2	1.7	21.4
12	120.2	10.2	33.4	21.8	59.5	1.9	24.0
13	124.0	10.0	29.9	21.5	46.9	2.1	24.0
14	127.4	10.2	26.1	21.9	49.4	2.0	24.0
15	126.4	10.4	20.9	22.5	46.6	2.3	24.0
16	126.4	10.0	15.5	21.5	54.4	2.0	24.0
17	139.5	10.4	31.9	22.3	68.6	2.0	24.0
18	138.0	10.2	37.5	21.9	44.0	2.2	24.0
19	138.9	10.4	39.5	22.2	45.7	2.3	24.0
20	136.4	10.4	40.1	22.4	66.7	1.9	24.0
21	131.9	10.1	38.2	21.7	32.8	2.2	24.0
22	129.2	9.9	39.6	21.4	20.9	2.1	24.0
23	125.0	9.9	38.1	21.3	34.2	1.9	24.0
24	99.0	7.8	31.3	16.8	17.0	1.6	19.5
25	Down	Down	Down	Down	Down	0.0	0.0
26	Down	Down	Down	Down	Down	0.0	0.0
27	Down	Down	Down	Down	Down	0.0	0.0
28	Down	Down	Down	Down	Down	0.0	0.0
29	Down	Down	Down	Down	Down	0.0	0.0
30	Down	Down	Down	Down	Down	0.0	0.0
31	Down	Down	Down	Down	Down	0.0	0.0
Total	3035	239	860	514	1111.5	48	569
12-Mo Rlng	47098	1955	4157	4195	12541	409	

Tracy Combined Cycle Power Plant
Tracy, CA
Turbine 1- Monthly Operations Report
January - 2020

Day	CT Gas Flow kscf	CT Heat Input mmBtu	CT Gas On-Time	DB Gas Flow kscf	DB Heat Input mmBtu	DB Gas On-Time	Total Heat Input mmBtu	Steam Flow To CTG klbs	Steam Flow To CTG On-Time	NH3 Flow lbs	NH3 Flow On-Time	CT Megawatt Hours	Turbine On-Time
01	19944.2	20821.9	24.00	574.2	599.4	11.21	21421	7664.2	24.00	739.2	24.00	1689	24.0
02	20097.4	20981.5	24.00	816.5	852.1	16.10	21834	7881.9	24.00	754.2	24.00	1709	24.0
03	20523.9	21427.1	24.00	Down	Down	0.00	21427	7460.3	24.00	737.4	24.00	1753	24.0
04	21103.1	22031.6	24.00	Down	Down	0.00	22032	7721.3	24.00	752.4	24.00	1820	24.0
05	21082.8	22009.8	24.00	Down	Down	0.00	22010	7726.2	24.00	759.3	24.00	1818	24.0
06	20193.6	21082.1	24.00	271.1	282.9	4.15	21365	7553.2	24.00	791.2	24.00	1708	24.0
07	19553.7	20414.1	24.00	307.2	320.7	5.21	20735	7302.1	24.00	752.1	24.00	1631	24.0
08	20417.6	21315.8	24.00	Down	Down	0.00	21316	7426.3	24.00	723.0	24.00	1737	24.0
09	20495.6	21397.3	24.00	1.1	1.1	0.02	21398	7470.6	24.00	724.1	24.00	1753	24.0
10	20695.8	21606.4	23.72	815.1	851.0	11.99	22457	8088.9	23.72	886.2	23.72	1787	23.7
11	18278.0	19081.9	21.40	Down	Down	0.00	19082	6673.3	21.37	712.6	21.35	1558	21.4
12	20886.2	21804.9	24.00	Down	Down	0.00	21805	7622.6	24.00	823.3	24.00	1800	24.0
13	20144.2	21030.4	24.00	421.2	439.7	6.43	21470	7648.8	24.00	791.9	24.00	1709	24.0
14	20894.1	21813.1	24.00	114.5	119.5	2.25	21933	7634.6	24.00	814.4	24.00	1788	24.0
15	20659.7	21568.7	24.00	922.3	962.6	17.42	22531	7842.8	24.00	882.8	24.00	1776	24.0
16	20418.5	21316.8	24.00	184.6	192.6	2.57	21509	7371.8	24.00	787.6	24.00	1745	24.0
17	21124.3	22053.5	24.00	234.4	244.8	4.52	22298	7810.0	24.00	849.8	24.00	1823	24.0
18	20202.4	21090.9	24.00	812.4	848.7	15.18	21940	7881.9	24.00	806.0	24.00	1717	24.0
19	20303.8	21197.4	24.00	959.6	1001.7	17.05	22199	7960.7	24.00	844.3	24.00	1732	24.0
20	21406.5	22348.4	24.00	Down	Down	0.00	22348	7767.5	24.00	815.9	24.00	1864	24.0
21	20209.7	21098.8	24.00	654.6	683.1	13.03	21782	7842.2	24.00	749.5	24.00	1721	24.0
22	20128.5	21013.8	24.00	362.4	378.3	7.23	21392	7643.7	24.00	680.7	24.00	1707	24.0
23	20432.2	21330.9	24.00	Down	Down	0.00	21331	7481.3	24.00	695.6	24.00	1732	24.0
24	16068.1	16775.0	19.53	45.1	47.1	0.30	16822	5957.7	19.53	533.1	19.53	1340	19.5
25	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
26	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
27	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
28	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
29	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
30	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
31	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
Average Total	20219.3 485263.9	21108.8 506612	568.7	468.5 7496.3	489.1 7825	134.7	21435 514437	7559.7 181433.9	568.6	766.9 18406.6	568.6	1726 41417	569

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
February 1, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
February 2, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
February 3, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
February 4, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
February 5, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
February 6, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
February 7, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
February 8, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
February 9, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
February 10, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
February 11, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
February 12, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
February 13, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
February 14, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
February 15, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
February 16, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
February 17, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
February 18, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
February 19, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
February 20, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
February 21, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
February 22, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
February 23, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
February 24, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
February 25, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
February 26, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
February 27, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
February 28, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
February 29, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Turbine 1- Monthly Mass Emissions Report
February - 2020

Daily Emission Limits		12 Month Rolling Emission Limits	
NOx lbs - 814.9	CO lbs - 1071.6	NOx lbs - 88,881	CO lbs - 74,598
SOx lbs - 58.7	PM lbs - 132	SOx lbs - 7,084	PM lbs - 32,250
VOC lbs - 78.6		VOC lbs - 15,145	

Day	NOx lbs	SOx lbs	CO lbs	PM lbs	NH3 Slip lbs	VOC lbs	Turbine On-Time
01	Down	Down	Down	Down	Down	0.0	0.0
02	Down	Down	Down	Down	Down	0.0	0.0
03	Down	Down	Down	Down	Down	0.0	0.0
04	Down	Down	Down	Down	Down	0.0	0.0
05	Down	Down	Down	Down	Down	0.0	0.0
06	Down	Down	Down	Down	Down	0.0	0.0
07	Down	Down	Down	Down	Down	0.0	0.0
08	Down	Down	Down	Down	Down	0.0	0.0
09	Down	Down	Down	Down	Down	0.0	0.0
10	Down	Down	Down	Down	Down	0.0	0.0
11	Down	Down	Down	Down	Down	0.0	0.0
12	Down	Down	Down	Down	Down	0.0	0.0
13	Down	Down	Down	Down	Down	0.0	0.0
14	Down	Down	Down	Down	Down	0.0	0.0
15	Down	Down	Down	Down	Down	0.0	0.0
16	Down	Down	Down	Down	Down	0.0	0.0
17	Down	Down	Down	Down	Down	0.0	0.0
18	Down	Down	Down	Down	Down	0.0	0.0
19	Down	Down	Down	Down	Down	0.0	0.0
20	Down	Down	Down	Down	Down	0.0	0.0
21	Down	Down	Down	Down	Down	0.0	0.0
22	Down	Down	Down	Down	Down	0.0	0.0
23	Down	Down	Down	Down	Down	0.0	0.0
24	Down	Down	Down	Down	Down	0.0	0.0
25	Down	Down	Down	Down	Down	0.0	0.0
26	Down	Down	Down	Down	Down	0.0	0.0
27	Down	Down	Down	Down	Down	0.0	0.0
28	Down	Down	Down	Down	Down	0.0	0.0
29	Down	Down	Down	Down	Down	0.0	0.0
Total 12-Mo Ring	Down 42870	Down 1742	Down 4004	Down 3740	Down 11441	0 367	0

Tracy Combined Cycle Power Plant
Tracy, CA
Turbine 1- Monthly Operations Report
February - 2020

Day	CT Gas Flow kscf	CT Heat Input mmBtu	CT Gas On-Time	DB Gas Flow kscf	DB Heat Input mmBtu	DB Gas On-Time	Total Heat Input mmBtu	Steam Flow To CTG klbs	Steam Flow To CTG On-Time	NH3 Flow lbs	NH3 Flow On-Time	CT Megawatt Hours	Turbine On-Time
01	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
02	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
03	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
04	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
05	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
06	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
07	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
08	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
09	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
10	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
11	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
12	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
13	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
14	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
15	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
16	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
17	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
18	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
19	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
20	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
21	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
22	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
23	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
24	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
25	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
26	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
27	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
28	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
29	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
Average Total	Down Down	Down Down	0.0	Down Down	Down Down	0.0	Down Down	Down Down	0.0	Down Down	0.0	Down Down	0

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
March 1, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
March 2, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
March 3, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
March 4, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
March 5, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
March 6, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Ring Avg)		NH3 (24 Hr Ring Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Ring	Normal Op CO lbs 3-Hr Ring	Normal Op CO lbs 3-Hr Ring Limit**	Normal Op NH3 ppm @15% O2 24-Hr Ring	Normal Ops NH3 lbs 24-Hr Ring	Normal Ops NH3 lbs 24-Hr Ring Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
March 7, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
March 8, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
March 9, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
March 10, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
March 11, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
March 12, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
March 13, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
March 14, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
March 15, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.28	Startup
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
March 16, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.43	Startup
10	1.1	0.55	8.10	NSD	NSD	3.90	0.0	0.00	9.40	Off	1.00	Startup
11	1.3	3.84	8.10	NSD	NSD	3.90	0.0	0.00	9.40	Off	1.00	Normal
12	1.4	4.06	8.10	0.4	0.56	3.90	0.0	0.03	9.40	Off	1.00	Normal
13	1.4	4.05	8.10	0.5	0.81	3.90	0.1	0.13	9.40	Off	1.00	Normal
14	1.2	4.05	9.46	0.5	0.92	5.20	0.2	0.21	9.40	On	1.00	Normal
15	1.5	5.09	10.30	0.4	0.92	6.00	0.3	0.29	9.40	On	1.00	Normal
16	1.5	5.19	10.30	0.4	0.88	6.00	0.3	0.37	9.40	On	1.00	Normal
17	1.5	5.61	10.30	0.4	0.77	6.00	0.4	0.49	9.40	On	1.00	Normal
18	1.4	5.01	10.30	0.4	0.73	6.00	0.4	0.53	9.40	On	1.00	Normal
19	1.5	5.09	10.30	0.4	0.77	6.00	0.5	0.61	9.40	On	1.00	Normal
20	1.5	5.32	10.30	0.4	0.79	6.00	0.5	0.69	9.40	On	1.00	Normal
21	1.5	5.60	10.30	0.4	0.81	6.00	0.6	0.77	9.40	On	1.00	Normal
22	1.5	5.44	10.30	0.4	0.81	6.00	0.6	0.85	9.40	On	1.00	Normal
23	1.5	5.23	10.30	0.4	0.84	6.00	0.7	0.93	9.40	On	1.00	Normal

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
March 17, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	1.5	5.24	10.30	0.4	0.83	6.00	0.7	1.01	9.40	On	1.00	Normal
01	1.5	5.23	10.30	0.4	0.79	6.00	0.8	1.09	9.40	On	1.00	Normal
02	1.5	5.22	10.30	0.4	0.76	6.00	0.8	1.17	9.40	On	1.00	Normal
03	1.5	5.21	10.30	0.4	0.79	6.00	0.9	1.21	9.40	On	1.00	Normal
04	1.5	5.28	10.30	0.4	0.82	6.00	0.9	1.25	9.40	On	1.00	Normal
05	1.5	5.30	10.30	0.4	0.85	6.00	1.0	1.29	9.40	On	1.00	Normal
06	1.5	5.19	10.30	0.4	0.85	6.00	1.0	1.37	9.40	On	1.00	Normal
07	1.5	5.19	10.30	0.4	0.85	6.00	1.1	1.41	9.40	On	1.00	Normal
08	1.5	5.22	10.30	0.4	0.82	6.00	1.1	1.49	9.40	On	1.00	Normal
09	1.5	0.16	8.14	0.4	0.54	6.00	1.1	1.49	9.40	On	0.30	Shutdown
10	N/A	N/A	8.10	NSD	NSD	6.00	1.1	1.49	9.40	Off	0.00	Down
11	N/A	N/A	8.10	NSD	NSD	3.94	1.1	1.49	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	1.1	1.45	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	1.0	1.36	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.9	1.28	9.40	Off	0.28	Startup
15	0.8	0.35	8.10	NSD	NSD	3.90	0.8	1.20	9.40	Off	1.00	Startup
16	1.5	4.33	8.10	NSD	NSD	3.90	0.8	1.12	9.40	Off	1.00	Normal
17	1.5	4.69	8.10	0.3	0.46	3.90	0.8	1.06	9.40	Off	1.00	Normal
18	1.5	5.14	8.10	0.3	0.65	3.90	0.8	1.06	9.40	Off	1.00	Normal
19	1.5	5.13	8.10	0.3	0.69	3.90	0.8	1.02	9.40	Off	1.00	Normal
20	1.5	5.22	8.10	0.3	0.72	3.90	0.8	1.02	9.40	Off	1.00	Normal
21	1.5	4.92	8.10	0.3	0.75	3.90	0.8	1.02	9.40	Off	1.00	Normal
22	1.5	5.11	8.10	0.3	0.74	3.90	0.8	0.97	9.40	Off	1.00	Normal
23	1.5	5.20	8.10	0.4	0.74	3.90	0.8	0.97	9.40	Off	1.00	Normal

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
March 18, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	<i>ppm @15% O2</i>	<i>lbs</i>	<i>ppm @15% O2</i>	<i>lbs</i>	<i>ppm @15% O2</i>	<i>lbs</i>
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	1.5	4.30	8.10	0.4	0.73	3.90	0.7	0.89	9.40	Off	1.00	Normal
01	1.5	4.36	8.10	0.4	0.74	3.90	0.7	0.85	9.40	Off	1.00	Normal
02	1.5	4.36	8.10	0.4	0.75	3.90	0.7	0.80	9.40	Off	1.00	Normal
03	1.5	4.58	8.10	0.4	0.79	3.90	0.7	0.83	9.40	Off	1.00	Normal
04	1.5	5.11	8.10	0.4	0.81	3.90	0.7	0.87	9.40	Off	1.00	Normal
05	1.5	5.21	8.10	0.4	0.83	3.90	0.8	0.90	9.40	Off	1.00	Normal
06	1.5	5.11	8.10	0.4	0.78	3.90	0.8	0.90	9.40	Off	1.00	Normal
07	1.5	5.09	8.10	0.3	0.71	3.90	0.8	0.94	9.40	Off	1.00	Normal
08	1.5	5.10	8.10	0.3	0.68	3.90	0.8	0.94	9.40	Off	1.00	Normal
09	1.5	0.16	8.10	0.3	0.47	3.90	0.8	0.94	9.40	Off	0.30	Shutdown
10	N/A	N/A	8.10	NSD	NSD	3.90	0.8	0.94	9.40	Off	0.00	Down
11	N/A	N/A	8.10	NSD	NSD	3.90	0.8	0.94	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.8	0.94	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.8	0.94	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.8	0.94	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.8	0.94	9.40	Off	0.27	Startup
16	N/A	N/A	8.10	N/A	N/A	3.90	0.8	0.94	9.40	Off	1.00	Startup
17	1.5	4.09	8.10	NSD	NSD	3.90	0.8	0.87	9.40	Off	1.00	Startup
18	1.5	5.23	8.10	NSD	NSD	3.90	0.8	0.91	9.40	Off	1.00	Normal
19	1.5	5.13	8.10	0.3	0.52	3.90	0.8	0.95	9.40	Off	1.00	Normal
20	1.5	5.20	8.10	0.3	0.56	3.90	0.8	0.95	9.40	Off	1.00	Normal
21	1.5	5.20	8.10	0.3	0.56	3.90	0.8	0.95	9.40	Off	1.00	Normal
22	1.5	5.05	8.10	0.3	0.59	3.90	0.8	0.95	9.40	Off	1.00	Normal
23	1.6	0.15	8.10	0.3	0.41	3.90	0.8	0.87	9.40	Off	0.30	Shutdown

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
March 19, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	NSD	NSD	3.90	0.8	0.87	9.40	Off	0.00	Down
01	N/A	N/A	8.10	NSD	NSD	3.90	0.7	0.84	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.7	0.80	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.6	0.74	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.5	0.66	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.5	0.58	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.4	0.50	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.3	0.43	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.3	0.35	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.3	0.35	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.3	0.35	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.3	0.35	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.3	0.35	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.3	0.35	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.3	0.35	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.3	0.35	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.3	0.35	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.3	0.35	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.2	0.27	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.2	0.19	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.1	0.12	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.04	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
March 20, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
March 21, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
March 22, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
March 23, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
March 24, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
March 25, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
March 26, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.08	Startup
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	1.00	Startup
09	1.5	2.72	8.10	NSD	NSD	3.90	0.0	0.00	9.40	Off	1.00	Startup
10	1.6	4.48	8.10	NSD	NSD	3.90	0.0	0.00	9.40	Off	1.00	Normal
11	1.5	4.60	8.10	0.2	0.41	3.90	0.0	0.03	9.40	Off	1.00	Normal
12	1.5	4.34	8.10	0.3	0.56	3.90	0.1	0.03	9.40	Off	1.00	Normal
13	1.5	4.27	8.10	0.3	0.55	3.90	0.1	0.03	9.40	Off	1.00	Normal
14	1.5	4.37	8.10	0.3	0.59	3.90	0.1	0.03	9.40	Off	1.00	Normal
15	1.5	4.35	8.10	0.4	0.65	3.90	0.1	0.07	9.40	Off	1.00	Normal
16	1.4	4.16	8.10	0.4	0.70	3.90	0.1	0.10	9.40	Off	1.00	Normal
17	1.5	5.16	9.13	0.4	0.68	4.88	0.2	0.25	9.40	On	1.00	Normal
18	1.4	4.68	10.30	0.4	0.69	6.00	0.3	0.33	9.40	On	1.00	Normal
19	1.4	4.89	10.30	0.3	0.71	6.00	0.4	0.41	9.40	On	1.00	Normal
20	1.4	4.89	10.30	0.4	0.75	6.00	0.4	0.48	9.40	On	1.00	Normal
21	1.4	4.81	10.04	0.4	0.78	6.00	0.5	0.56	9.40	On	1.00	Normal
22	1.4	0.14	8.10	0.4	0.54	6.00	0.5	0.56	9.40	Off	0.30	Shutdown
23	N/A	N/A	8.10	NSD	NSD	5.76	0.5	0.56	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
March 27, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	NSD	NSD	3.90	0.5	0.56	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.5	0.56	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.5	0.56	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.5	0.56	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.5	0.56	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.5	0.56	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.5	0.56	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.5	0.56	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.5	0.56	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.5	0.56	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.5	0.56	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.5	0.53	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.4	0.53	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.4	0.53	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.4	0.53	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.4	0.50	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.4	0.46	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.3	0.31	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.2	0.24	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.1	0.16	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.1	0.08	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
March 28, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
March 29, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
March 30, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 1 Daily Emission Compliance Report
March 31, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Turbine 1- Monthly Mass Emissions Report
March - 2020

Daily Emission Limits		12 Month Rolling Emission Limits	
NOx lbs - 814.9	CO lbs - 1071.6	NOx lbs - 88,881	CO lbs - 74,598
SOx lbs - 58.7	PM lbs - 132	SOx lbs - 7,084	PM lbs - 32,250
VOC lbs - 78.6		VOC lbs - 15,145	

Day	NOx lbs	SOx lbs	CO lbs	PM lbs	NH3 Slip lbs	VOC lbs	Turbine On-Time
01	Down	Down	Down	Down	Down	0.0	0.0
02	Down	Down	Down	Down	Down	0.0	0.0
03	Down	Down	Down	Down	Down	0.0	0.0
04	Down	Down	Down	Down	Down	0.0	0.0
05	Down	Down	Down	Down	Down	0.0	0.0
06	Down	Down	Down	Down	Down	0.0	0.0
07	Down	Down	Down	Down	Down	0.0	0.0
08	Down	Down	Down	Down	Down	0.0	0.0
09	Down	Down	Down	Down	Down	0.0	0.0
10	Down	Down	Down	Down	Down	0.0	0.0
11	Down	Down	Down	Down	Down	0.0	0.0
12	Down	Down	Down	Down	Down	0.0	0.0
13	Down	Down	Down	Down	Down	0.0	0.0
14	Down	Down	Down	Down	Down	0.0	0.0
15	2.2	0.0	31.6	0.0	Down	0.0	0.3
16	86.4	6.0	48.1	12.7	22.4	1.3	14.4
17	138.9	7.9	15.2	16.5	41.6	1.7	18.6
18	144.4	6.8	13.1	14.2	48.5	1.3	16.9
19	Down	Down	Down	Down	Down	0.0	0.0
20	Down	Down	Down	Down	Down	0.0	0.0
21	Down	Down	Down	Down	Down	0.0	0.0
22	Down	Down	Down	Down	Down	0.0	0.0
23	Down	Down	Down	Down	Down	0.0	0.0
24	Down	Down	Down	Down	Down	0.0	0.0
25	Down	Down	Down	Down	Down	0.0	0.0
26	148.4	5.5	28.6	11.6	59.4	1.2	14.4
27	Down	Down	Down	Down	Down	0.0	0.0
28	Down	Down	Down	Down	Down	0.0	0.0
29	Down	Down	Down	Down	Down	0.0	0.0
30	Down	Down	Down	Down	Down	0.0	0.0
31	Down	Down	Down	Down	Down	0.0	0.0
Total	520	26	137	55	171.9	6	65
12-Mo RIng	39345	1619	3888	3478	10701	342	

Tracy Combined Cycle Power Plant
Tracy, CA
Turbine 1- Monthly Operations Report
March - 2020

Day	CT Gas Flow kscf	CT Heat Input mmBtu	CT Gas On-Time	DB Gas Flow kscf	DB Heat Input mmBtu	DB Gas On-Time	Total Heat Input mmBtu	Steam Flow To CTG klbs	Steam Flow To CTG On-Time	NH3 Flow lbs	NH3 Flow On-Time	CT Megawatt Hours	Turbine On-Time
01	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
02	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
03	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
04	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
05	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
06	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
07	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
08	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
09	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
10	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
11	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
12	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
13	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
14	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
15	41.0	41.8	0.28	Down	Down	0.00	42	Down	0.00	Down	0.00	0	0.3
16	11852.0	12089.1	14.43	583.6	595.5	9.62	12685	4458.5	14.02	467.1	13.68	999	14.4
17	15681.6	15995.1	18.58	542.2	553.0	9.02	16548	5863.7	18.58	618.3	18.43	1344	18.6
18	13931.5	14210.1	16.87	Down	Down	0.00	14210	4980.8	16.87	507.1	16.68	1184	16.9
19	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
20	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
21	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
22	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
23	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
24	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
25	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
26	11036.6	11257.3	14.38	300.4	306.5	4.35	11564	4120.4	13.93	419.4	13.55	903	14.4
27	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
28	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
29	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
30	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
31	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
Average Total	10508.5 52542.7	10718.7 53593	64.5	475.4 1426.2	485.0 1455	23.0	11010 55049	4855.9 19423.4	63.4	503.0 2011.9	62.3	886 4430	65

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
January 1, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.1	0.08	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.1	0.08	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.1	0.08	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.1	0.04	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.1	0.04	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.1	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
January 2, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
January 3, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
January 4, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
January 5, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
January 6, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
January 7, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
January 8, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
January 9, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
January 10, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
January 11, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
January 12, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
January 13, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
January 14, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.72	Startup
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	1.00	Startup
08	0.9	2.53	9.64	NSD	NSD	5.37	0.0	0.00	9.40	On	1.00	Startup
09	0.7	2.67	10.30	NSD	NSD	6.00	0.1	0.17	9.40	On	1.00	Normal
10	0.7	2.60	8.83	0.2	0.50	6.00	0.2	0.34	9.40	On	1.00	Normal
11	0.8	3.10	8.10	0.3	0.57	6.00	0.2	0.34	9.40	Off	1.00	Normal
12	1.6	1.93	8.10	0.3	0.46	4.60	0.2	0.34	9.40	Off	0.60	Shutdown
13	N/A	N/A	8.10	NSD	NSD	3.90	0.2	0.34	9.40	Off	0.00	Down
14	N/A	N/A	8.10	NSD	NSD	3.90	0.2	0.34	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.2	0.34	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.2	0.34	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.2	0.34	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.2	0.34	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.2	0.34	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.2	0.34	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.2	0.34	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.2	0.34	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.2	0.34	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
January 15, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.2	0.34	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.2	0.34	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.2	0.34	9.40	Off	0.33	Startup
03	N/A	N/A	8.10	N/A	N/A	3.90	0.2	0.34	9.40	Off	1.00	Startup
04	1.6	4.25	8.10	NSD	NSD	3.90	0.2	0.34	9.40	Off	1.00	Startup
05	1.5	4.59	8.10	NSD	NSD	3.90	0.3	0.37	9.40	Off	1.00	Normal
06	1.6	6.13	9.02	0.2	0.36	4.78	0.3	0.42	9.40	On	1.00	Normal
07	1.6	6.61	10.30	0.2	0.44	6.00	0.3	0.46	9.40	On	1.00	Normal
08	Maint	Maint	10.30	Maint	Maint	6.00	0.3	0.48	9.40	On	1.00	Normal
09	Maint	Maint	10.30	Maint	Maint	6.00	0.2	0.32	9.40	On	1.00	Normal
10	Maint	Maint	10.30	Maint	Maint	6.00	0.1	0.14	9.40	On	1.00	Normal
11	1.6	5.63	10.30	Maint	Maint	6.00	0.1	0.14	9.40	On	1.00	Normal
12	1.6	5.74	10.30	Maint	Maint	6.00	0.1	0.14	9.40	On	1.00	Normal
13	1.6	5.75	10.30	0.2	0.38	6.00	0.1	0.14	9.40	On	1.00	Normal
14	1.6	5.75	10.30	0.2	0.38	6.00	0.1	0.14	9.40	On	1.00	Normal
15	1.6	5.76	10.30	0.2	0.39	6.00	0.2	0.14	9.40	On	1.00	Normal
16	1.6	5.76	10.30	0.2	0.42	6.00	0.2	0.19	9.40	On	1.00	Normal
17	1.6	5.64	10.30	0.2	0.46	6.00	0.2	0.19	9.40	On	1.00	Normal
18	1.6	5.72	10.30	0.2	0.49	6.00	0.2	0.19	9.40	On	1.00	Normal
19	1.6	5.54	10.30	0.2	0.48	6.00	0.2	0.24	9.40	On	1.00	Normal
20	1.6	5.72	10.30	0.2	0.48	6.00	0.3	0.28	9.40	On	1.00	Normal
21	1.6	5.72	10.30	0.2	0.45	6.00	0.3	0.28	9.40	On	1.00	Normal
22	1.6	5.73	10.30	0.2	0.42	6.00	0.3	0.28	9.40	On	1.00	Normal
23	1.6	5.72	10.30	0.2	0.39	6.00	0.3	0.28	9.40	On	1.00	Normal

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
January 16, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	1.6	5.36	8.32	0.2	0.41	6.00	0.3	0.28	9.40	On	1.00	Normal
01	1.6	4.69	8.10	0.2	0.36	6.00	0.3	0.28	9.40	Off	1.00	Normal
02	1.6	4.68	8.10	0.2	0.31	4.11	0.3	0.28	9.40	Off	1.00	Normal
03	1.6	4.70	8.10	0.1	0.24	3.90	0.3	0.28	9.40	Off	1.00	Normal
04	1.6	4.70	8.10	0.1	0.24	3.90	0.3	0.28	9.40	Off	1.00	Normal
05	1.4	4.46	8.10	0.2	0.27	3.90	0.3	0.28	9.40	Off	1.00	Normal
06	1.6	5.62	8.10	0.2	0.38	3.90	0.3	0.23	9.40	Off	1.00	Normal
07	1.6	5.58	9.24	0.2	0.43	4.99	0.3	0.18	9.40	On	1.00	Normal
08	1.6	5.80	10.30	0.2	0.42	6.00	0.3	0.22	9.40	On	1.00	Normal
09	1.6	5.77	10.19	0.2	0.32	6.00	0.3	0.25	9.40	On	1.00	Normal
10	1.6	4.59	8.10	0.2	0.27	6.00	0.3	0.24	9.40	Off	1.00	Normal
11	1.6	4.65	8.10	0.2	0.26	5.90	0.3	0.24	9.40	Off	1.00	Normal
12	1.6	4.69	8.10	0.2	0.27	3.90	0.3	0.24	9.40	Off	1.00	Normal
13	1.6	4.75	8.10	0.2	0.27	3.90	0.2	0.24	9.40	Off	1.00	Normal
14	1.6	4.67	8.10	0.2	0.27	3.90	0.2	0.24	9.40	Off	1.00	Normal
15	1.6	5.27	8.10	0.2	0.34	3.90	0.2	0.24	9.40	Off	1.00	Normal
16	1.6	5.67	8.10	0.2	0.45	3.90	0.2	0.20	9.40	Off	1.00	Normal
17	1.6	5.63	8.10	0.3	0.56	3.90	0.2	0.20	9.40	Off	1.00	Normal
18	1.6	5.60	8.10	0.3	0.60	3.90	0.2	0.20	9.40	Off	1.00	Normal
19	1.5	5.44	8.10	0.3	0.63	3.90	0.2	0.16	9.40	Off	1.00	Normal
20	1.6	5.61	8.10	0.3	0.67	3.90	0.1	0.12	9.40	Off	1.00	Normal
21	1.6	5.61	8.10	0.3	0.64	3.90	0.1	0.12	9.40	Off	1.00	Normal
22	1.6	5.62	8.10	0.3	0.60	3.90	0.1	0.12	9.40	Off	1.00	Normal
23	1.6	5.61	8.10	0.3	0.57	3.90	0.1	0.12	9.40	Off	1.00	Normal

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
January 17, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	1.6	4.95	8.10	0.3	0.52	3.90	0.1	0.12	9.40	Off	1.00	Normal
01	1.6	4.68	8.10	0.2	0.41	3.90	0.1	0.12	9.40	Off	1.00	Normal
02	1.6	4.72	8.10	0.2	0.30	3.90	0.1	0.12	9.40	Off	1.00	Normal
03	1.6	4.72	8.10	0.2	0.27	3.90	0.1	0.12	9.40	Off	1.00	Normal
04	1.6	2.12	8.10	0.2	0.23	3.90	0.1	0.12	9.40	Off	0.67	Shutdown
05	N/A	N/A	8.10	NSD	NSD	3.90	0.1	0.08	9.40	Off	0.00	Down
06	N/A	N/A	8.10	NSD	NSD	3.90	0.1	0.08	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.08	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.04	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
January 18, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
January 19, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
January 20, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
January 21, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
January 22, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
January 23, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
January 24, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
January 25, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
January 26, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
January 27, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
January 28, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
January 29, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
January 30, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
January 31, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Turbine 2- Monthly Mass Emissions Report
January - 2020

Daily Emission Limits		12 Month Rolling Emission Limits	
NOx lbs - 814.9	CO lbs - 1071.6	NOx lbs - 88,881	CO lbs - 74,598
SOx lbs - 58.7	PM lbs - 132	SOx lbs - 7,084	PM lbs - 32,250
VOC lbs - 78.6		VOC lbs - 15,145	

Day	NOx lbs	SOx lbs	CO lbs	PM lbs	NH3 Slip lbs	VOC lbs	Turbine On-Time
01	Down	Down	Down	Down	Down	0.0	0.0
02	Down	Down	Down	Down	Down	0.0	0.0
03	Down	Down	Down	Down	Down	0.0	0.0
04	Down	Down	Down	Down	Down	0.0	0.0
05	Down	Down	Down	Down	Down	0.0	0.0
06	Down	Down	Down	Down	Down	0.0	0.0
07	Down	Down	Down	Down	Down	0.0	0.0
08	Down	Down	Down	Down	Down	0.0	0.0
09	Down	Down	Down	Down	Down	0.0	0.0
10	Down	Down	Down	Down	Down	0.0	0.0
11	Down	Down	Down	Down	Down	0.0	0.0
12	Down	Down	Down	Down	Down	0.0	0.0
13	Down	Down	Down	Down	Down	0.0	0.0
14	107.7	2.6	33.0	10.9	21.4	0.9	6.3
15	169.3	9.5	13.0	40.1	16.1	5.7	21.3
16	124.8	10.1	10.0	42.7	2.8	2.3	24.0
17	23.4	1.7	3.9	7.4	0.5	0.3	4.7
18	Down	Down	Down	Down	Down	0.0	0.0
19	Down	Down	Down	Down	Down	0.0	0.0
20	Down	Down	Down	Down	Down	0.0	0.0
21	Down	Down	Down	Down	Down	0.0	0.0
22	Down	Down	Down	Down	Down	0.0	0.0
23	Down	Down	Down	Down	Down	0.0	0.0
24	Down	Down	Down	Down	Down	0.0	0.0
25	Down	Down	Down	Down	Down	0.0	0.0
26	Down	Down	Down	Down	Down	0.0	0.0
27	Down	Down	Down	Down	Down	0.0	0.0
28	Down	Down	Down	Down	Down	0.0	0.0
29	Down	Down	Down	Down	Down	0.0	0.0
30	Down	Down	Down	Down	Down	0.0	0.0
31	Down	Down	Down	Down	Down	0.0	0.0
Total	425	24	60	101	40.8	9	56
12-Mo RIng	27812	1371	4600	5793	6899	647	

Tracy Combined Cycle Power Plant
Tracy, CA
Turbine 2- Monthly Operations Report
January - 2020

Day	CT Gas Flow kscf	CT Heat Input mmBtu	CT Gas On-Time	DB Gas Flow kscf	DB Heat Input mmBtu	DB Gas On-Time	Total Heat Input mmBtu	Steam Flow To CTG klbs	Steam Flow To CTG On-Time	NH3 Flow lbs	NH3 Flow On-Time	CT Megawatt Hours	Turbine On-Time
01	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
02	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
03	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
04	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
05	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
06	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
07	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
08	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
09	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
10	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
11	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
12	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
13	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
14	5057.3	5279.9	6.32	155.5	162.5	2.03	5442	1964.3	5.93	277.1	5.55	420	6.3
15	18147.5	18945.7	21.33	1061.6	1107.9	17.42	20054	7574.5	21.15	757.4	20.68	1563	21.3
16	20254.0	21145.2	24.00	187.4	195.6	2.57	21341	7922.0	24.00	720.2	24.00	1741	24.0
17	3534.3	3689.7	4.67	Down	Down	0.00	3690	1391.6	4.62	131.6	4.67	286	4.7
18	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
19	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
20	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
21	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
22	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
23	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
24	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
25	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
26	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
27	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
28	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
29	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
30	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
31	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
Average Total	11748.3 46993.1	12265.1 49061	56.3	468.2 1404.5	488.7 1466	22.0	12632 50527	4713.1 18852.4	55.7	471.6 1886.3	54.9	1003 4010	56

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
February 1, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
February 2, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
February 3, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
February 4, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
February 5, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
February 6, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
February 7, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
February 8, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
February 9, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
February 10, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
February 11, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
February 12, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
February 13, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
February 14, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
February 15, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
February 16, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
February 17, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
February 18, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
February 19, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
February 20, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
February 21, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
February 22, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
February 23, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
February 24, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
February 25, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
February 26, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
February 27, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
February 28, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
February 29, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Turbine 2- Monthly Mass Emissions Report
February - 2020

Daily Emission Limits		12 Month Rolling Emission Limits	
NOx lbs - 814.9	CO lbs - 1071.6	NOx lbs - 88,881	CO lbs - 74,598
SOx lbs - 58.7	PM lbs - 132	SOx lbs - 7,084	PM lbs - 32,250
VOC lbs - 78.6		VOC lbs - 15,145	

Day	NOx lbs	SOx lbs	CO lbs	PM lbs	NH3 Slip lbs	VOC lbs	Turbine On-Time
01	Down	Down	Down	Down	Down	0.0	0.0
02	Down	Down	Down	Down	Down	0.0	0.0
03	Down	Down	Down	Down	Down	0.0	0.0
04	Down	Down	Down	Down	Down	0.0	0.0
05	Down	Down	Down	Down	Down	0.0	0.0
06	Down	Down	Down	Down	Down	0.0	0.0
07	Down	Down	Down	Down	Down	0.0	0.0
08	Down	Down	Down	Down	Down	0.0	0.0
09	Down	Down	Down	Down	Down	0.0	0.0
10	Down	Down	Down	Down	Down	0.0	0.0
11	Down	Down	Down	Down	Down	0.0	0.0
12	Down	Down	Down	Down	Down	0.0	0.0
13	Down	Down	Down	Down	Down	0.0	0.0
14	Down	Down	Down	Down	Down	0.0	0.0
15	Down	Down	Down	Down	Down	0.0	0.0
16	Down	Down	Down	Down	Down	0.0	0.0
17	Down	Down	Down	Down	Down	0.0	0.0
18	Down	Down	Down	Down	Down	0.0	0.0
19	Down	Down	Down	Down	Down	0.0	0.0
20	Down	Down	Down	Down	Down	0.0	0.0
21	Down	Down	Down	Down	Down	0.0	0.0
22	Down	Down	Down	Down	Down	0.0	0.0
23	Down	Down	Down	Down	Down	0.0	0.0
24	Down	Down	Down	Down	Down	0.0	0.0
25	Down	Down	Down	Down	Down	0.0	0.0
26	Down	Down	Down	Down	Down	0.0	0.0
27	Down	Down	Down	Down	Down	0.0	0.0
28	Down	Down	Down	Down	Down	0.0	0.0
29	Down	Down	Down	Down	Down	0.0	0.0
Total 12-Mo Ring	Down 24032	Down 1157	Down 3436	Down 4894	Down 5388	0 554	0

Tracy Combined Cycle Power Plant
Tracy, CA
Turbine 2- Monthly Operations Report
February - 2020

Day	CT Gas Flow kscf	CT Heat Input mmBtu	CT Gas On-Time	DB Gas Flow kscf	DB Heat Input mmBtu	DB Gas On-Time	Total Heat Input mmBtu	Steam Flow To CTG klbs	Steam Flow To CTG On-Time	NH3 Flow lbs	NH3 Flow On-Time	CT Megawatt Hours	Turbine On-Time
01	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
02	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
03	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
04	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
05	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
06	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
07	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
08	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
09	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
10	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
11	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
12	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
13	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
14	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
15	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
16	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
17	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
18	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
19	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
20	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
21	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
22	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
23	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
24	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
25	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
26	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
27	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
28	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
29	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
Average Total	Down Down	Down Down	0.0	Down Down	Down Down	0.0	Down Down	Down Down	0.0	Down Down	0.0	Down Down	0

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
March 1, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
March 2, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
March 3, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
March 4, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.27	Startup
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	1.00	Startup
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	1.00	Startup
18	1.4	3.09	8.10	NSD	NSD	3.90	0.0	0.00	9.40	Off	1.00	Startup
19	1.6	5.63	8.10	NSD	NSD	3.90	0.0	0.00	9.40	Off	1.00	Normal
20	1.6	5.62	8.10	0.3	0.50	3.90	0.0	0.00	9.40	Off	1.00	Normal
21	1.5	4.90	8.10	0.3	0.56	3.90	0.0	0.00	9.40	Off	1.00	Normal
22	1.6	5.38	8.10	0.3	0.58	3.90	0.0	0.00	9.40	Off	1.00	Normal
23	1.6	1.15	8.10	0.3	0.43	3.90	0.0	0.00	9.40	Off	0.47	Shutdown

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
March 5, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	NSD	NSD	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	NSD	NSD	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
March 6, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
March 7, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
March 8, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
March 9, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
March 10, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
March 11, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
March 12, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
March 13, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
March 14, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
March 15, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.93	Startup
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	1.00	Startup
05	1.0	0.78	8.10	NSD	NSD	3.90	0.0	0.00	9.40	Off	1.00	Startup
06	1.0	3.10	8.10	NSD	NSD	3.90	0.1	0.07	9.40	Off	1.00	Normal
07	1.3	4.21	8.10	0.2	0.28	3.90	0.1	0.07	9.40	Off	1.00	Normal
08	1.4	0.12	8.10	0.2	0.26	3.90	0.1	0.07	9.40	Off	0.25	Shutdown
09	N/A	N/A	8.10	NSD	NSD	3.90	0.1	0.07	9.40	Off	0.00	Down
10	N/A	N/A	8.10	NSD	NSD	3.90	0.1	0.07	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.1	0.07	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.1	0.07	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.1	0.07	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.1	0.07	9.40	Off	0.25	Startup
15	N/A	N/A	8.10	N/A	N/A	3.90	0.1	0.07	9.40	Off	1.00	Startup
16	1.4	4.53	8.10	NSD	NSD	3.90	0.1	0.07	9.40	Off	1.00	Startup
17	1.4	4.89	8.10	NSD	NSD	3.90	0.1	0.07	9.40	Off	1.00	Normal
18	1.5	5.21	9.13	0.3	0.52	4.88	0.1	0.11	9.40	On	1.00	Normal
19	1.5	5.33	10.30	0.3	0.57	6.00	0.1	0.15	9.40	On	1.00	Normal
20	1.5	5.28	10.30	0.3	0.57	6.00	0.2	0.19	9.40	On	1.00	Normal
21	1.5	5.28	10.30	0.3	0.58	6.00	0.2	0.23	9.40	On	1.00	Normal
22	1.5	5.29	10.30	0.3	0.58	6.00	0.2	0.27	9.40	On	1.00	Normal
23	1.6	6.08	10.23	0.3	0.53	6.00	0.3	0.40	9.40	On	1.00	Normal

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
March 16, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	1.6	5.63	10.30	0.2	0.53	6.00	0.3	0.44	9.40	On	1.00	Normal
01	1.6	5.61	10.30	0.2	0.52	6.00	0.4	0.48	9.40	On	1.00	Normal
02	1.6	5.62	10.30	0.3	0.57	6.00	0.4	0.52	9.40	On	1.00	Normal
03	1.6	5.62	10.30	0.3	0.57	6.00	0.4	0.56	9.40	On	1.00	Normal
04	1.6	5.63	10.30	0.3	0.57	6.00	0.5	0.60	9.40	On	1.00	Normal
05	1.7	7.23	10.30	0.2	0.50	6.00	0.7	0.95	9.40	On	1.00	Normal
06	1.5	5.34	10.30	0.2	0.50	6.00	0.6	0.88	9.40	On	1.00	Normal
07	1.6	5.62	10.30	0.2	0.50	6.00	0.7	0.92	9.40	On	1.00	Normal
08	1.6	5.60	10.23	0.3	0.57	6.00	0.7	0.96	9.40	On	1.00	Normal
09	1.6	4.92	8.10	0.3	0.64	6.00	0.7	0.96	9.40	Off	1.00	Normal
10	1.6	5.01	8.10	0.3	0.68	5.93	0.7	0.96	9.40	Off	1.00	Normal
11	1.6	4.59	8.10	0.3	0.65	3.90	0.7	0.96	9.40	Off	1.00	Normal
12	1.6	4.58	8.10	0.3	0.54	3.90	0.7	0.96	9.40	Off	1.00	Normal
13	1.6	4.57	8.10	0.2	0.44	3.90	0.7	0.96	9.40	Off	1.00	Normal
14	1.2	4.01	9.09	0.3	0.50	4.85	0.7	0.99	9.40	On	1.00	Normal
15	1.4	5.01	10.30	0.3	0.54	6.00	0.8	1.03	9.40	On	1.00	Normal
16	1.5	5.22	10.30	0.3	0.56	6.00	0.8	1.07	9.40	On	1.00	Normal
17	1.5	5.63	10.30	0.2	0.52	6.00	0.8	1.16	9.40	On	1.00	Normal
18	1.4	4.95	10.30	0.2	0.49	6.00	0.8	1.16	9.40	On	1.00	Normal
19	1.5	5.20	10.30	0.2	0.49	6.00	0.8	1.16	9.40	On	1.00	Normal
20	1.5	5.21	10.30	0.2	0.48	6.00	0.8	1.16	9.40	On	1.00	Normal
21	1.5	5.49	10.30	0.2	0.48	6.00	0.8	1.16	9.40	On	1.00	Normal
22	1.5	5.33	10.30	0.2	0.49	6.00	0.8	1.16	9.40	On	1.00	Normal
23	1.5	5.21	10.30	0.2	0.49	6.00	0.7	1.06	9.40	On	1.00	Normal

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
March 17, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	<i>ppm @15% O2</i>	<i>lbs</i>	<i>ppm @15% O2</i>	<i>lbs</i>	<i>ppm @15% O2</i>	<i>lbs</i>
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	1.5	5.21	10.30	0.2	0.48	6.00	0.7	1.06	9.40	On	1.00	Normal
01	1.5	5.21	10.30	0.2	0.47	6.00	0.7	1.06	9.40	On	1.00	Normal
02	1.5	5.23	10.30	0.2	0.47	6.00	0.7	1.06	9.40	On	1.00	Normal
03	1.5	5.23	10.30	0.2	0.47	6.00	0.7	1.06	9.40	On	1.00	Normal
04	1.5	5.21	10.30	0.2	0.47	6.00	0.7	1.06	9.40	On	1.00	Normal
05	1.5	5.32	10.30	0.2	0.47	6.00	0.5	0.76	9.40	On	1.00	Normal
06	1.5	5.21	10.30	0.2	0.47	6.00	0.6	0.80	9.40	On	1.00	Normal
07	1.5	5.18	10.30	0.2	0.47	6.00	0.5	0.80	9.40	On	1.00	Normal
08	1.5	5.20	10.30	0.2	0.47	6.00	0.5	0.80	9.40	On	1.00	Normal
09	1.5	0.15	8.17	0.2	0.32	6.00	0.5	0.80	9.40	On	0.28	Shutdown
10	N/A	N/A	8.10	NSD	NSD	6.00	0.5	0.80	9.40	Off	0.00	Down
11	N/A	N/A	8.10	NSD	NSD	3.97	0.5	0.80	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.5	0.80	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.5	0.80	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.5	0.76	9.40	Off	0.27	Startup
15	1.1	0.37	8.10	NSD	NSD	3.90	0.5	0.72	9.40	Off	1.00	Startup
16	1.5	4.24	8.10	NSD	NSD	3.90	0.5	0.68	9.40	Off	1.00	Normal
17	1.5	4.59	8.10	0.1	0.20	3.90	0.4	0.60	9.40	Off	1.00	Normal
18	1.5	5.11	8.10	0.2	0.34	3.90	0.4	0.56	9.40	Off	1.00	Normal
19	1.5	5.11	8.10	0.2	0.42	3.90	0.4	0.52	9.40	Off	1.00	Normal
20	1.5	5.11	8.10	0.2	0.49	3.90	0.3	0.48	9.40	Off	1.00	Normal
21	1.5	5.08	8.10	0.2	0.49	3.90	0.3	0.44	9.40	Off	1.00	Normal
22	1.5	5.09	8.10	0.3	0.53	3.90	0.3	0.40	9.40	Off	1.00	Normal
23	1.5	5.09	8.10	0.3	0.53	3.90	0.3	0.36	9.40	Off	1.00	Normal

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
March 18, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	1.5	4.28	8.10	0.2	0.48	3.90	0.2	0.32	9.40	Off	1.00	Normal
01	1.5	4.27	8.10	0.2	0.42	3.90	0.2	0.28	9.40	Off	1.00	Normal
02	1.5	4.27	8.10	0.2	0.34	3.90	0.2	0.24	9.40	Off	1.00	Normal
03	1.5	4.47	8.10	0.2	0.37	3.90	0.2	0.20	9.40	Off	1.00	Normal
04	1.5	5.08	8.10	0.2	0.46	3.90	0.2	0.16	9.40	Off	1.00	Normal
05	1.5	5.09	8.10	0.3	0.54	3.90	0.1	0.12	9.40	Off	1.00	Normal
06	1.5	5.09	8.10	0.3	0.56	3.90	0.1	0.08	9.40	Off	1.00	Normal
07	1.5	5.07	8.10	0.2	0.49	3.90	0.1	0.04	9.40	Off	1.00	Normal
08	1.5	5.08	8.10	0.2	0.46	3.90	0.0	0.00	9.40	Off	1.00	Normal
09	1.5	0.16	8.10	0.2	0.31	3.90	0.0	0.00	9.40	Off	0.28	Shutdown
10	N/A	N/A	8.10	NSD	NSD	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	NSD	NSD	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.25	Startup
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	1.00	Startup
17	1.5	3.87	8.10	NSD	NSD	3.90	0.0	0.00	9.40	Off	1.00	Startup
18	1.5	5.12	8.10	NSD	NSD	3.90	0.0	0.00	9.40	Off	1.00	Normal
19	1.5	5.11	8.10	0.2	0.32	3.90	0.0	0.00	9.40	Off	1.00	Normal
20	1.5	5.09	8.10	0.2	0.40	3.90	0.0	0.00	9.40	Off	1.00	Normal
21	1.5	5.09	8.10	0.2	0.43	3.90	0.0	0.00	9.40	Off	1.00	Normal
22	1.5	5.03	8.10	0.2	0.46	3.90	0.0	0.00	9.40	Off	1.00	Normal
23	1.6	0.15	8.10	0.2	0.31	3.90	0.0	0.00	9.40	Off	0.28	Shutdown

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
March 19, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	NSD	NSD	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	NSD	NSD	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
March 20, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
March 21, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
March 22, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
March 23, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
March 24, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.67	Startup
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	1.00	Startup
21	0.8	0.92	8.10	NSD	NSD	3.90	0.0	0.00	9.40	Off	1.00	Startup
22	0.8	2.53	8.10	NSD	NSD	3.90	0.1	0.07	9.40	Off	1.00	Normal
23	1.3	4.29	8.10	0.2	0.30	3.90	0.1	0.07	9.40	Off	1.00	Normal

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
March 25, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	1.2	0.11	8.10	0.2	0.26	3.90	0.1	0.07	9.40	Off	0.25	Shutdown
01	N/A	N/A	8.10	NSD	NSD	3.90	0.1	0.07	9.40	Off	0.00	Down
02	N/A	N/A	8.10	NSD	NSD	3.90	0.1	0.07	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.1	0.07	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.1	0.07	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.1	0.07	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.1	0.07	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.1	0.07	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.1	0.07	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.1	0.07	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.1	0.07	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.1	0.07	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.1	0.07	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.1	0.07	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.1	0.07	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.1	0.07	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.1	0.07	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.1	0.07	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.1	0.07	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.1	0.07	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.1	0.07	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.1	0.07	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
March 26, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.55	Startup
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	1.00	Startup
03	1.6	0.23	8.10	NSD	NSD	3.90	0.0	0.00	9.40	Off	1.00	Startup
04	1.5	4.71	8.10	NSD	NSD	3.90	0.0	0.00	9.40	Off	1.00	Normal
05	1.5	4.98	8.10	0.1	0.24	3.90	0.0	0.00	9.40	Off	1.00	Normal
06	1.5	4.65	8.10	0.2	0.41	3.90	0.0	0.00	9.40	Off	1.00	Normal
07	1.5	4.54	8.10	0.3	0.54	3.90	0.0	0.00	9.40	Off	1.00	Normal
08	1.5	4.63	8.10	0.3	0.56	3.90	0.0	0.00	9.40	Off	1.00	Normal
09	1.5	4.32	8.10	0.3	0.54	3.90	0.0	0.00	9.40	Off	1.00	Normal
10	1.5	4.30	8.10	0.3	0.51	3.90	0.0	0.00	9.40	Off	1.00	Normal
11	1.5	1.20	8.10	0.2	0.32	3.90	0.0	0.00	9.40	Off	0.52	Shutdown
12	N/A	N/A	8.10	NSD	NSD	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	NSD	NSD	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
March 27, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
March 28, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
March 29, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
March 30, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.10	Startup
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	1.00	Startup
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	1.00	Startup
04	1.4	1.24	8.10	NSD	NSD	3.90	0.0	0.00	9.40	Off	1.00	Startup
05	1.4	4.68	8.10	NSD	NSD	3.90	0.0	0.04	9.40	Off	1.00	Normal
06	1.5	5.11	8.10	0.1	0.28	3.90	0.0	0.04	9.40	Off	1.00	Normal
07	1.5	3.71	8.10	0.2	0.39	3.90	0.0	0.04	9.40	Off	1.00	Shutdown
08	N/A	N/A	8.10	NSD	NSD	3.90	0.0	0.04	9.40	Off	0.02	Shutdown
09	N/A	N/A	8.10	NSD	NSD	3.90	0.0	0.04	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.04	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.04	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.04	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.04	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.04	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.04	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.04	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.04	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.04	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.04	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.04	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.04	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.04	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.04	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Unit 2 Daily Emission Compliance Report
March 31, 2020

EMISSION LIMITS (NORMAL OPERATION)

	NOx (1 Hr)		CO (3 Hr Rlng Avg)		NH3 (24 Hr Rlng Avg)	
	ppm @15% O2	lbs	ppm @15% O2	lbs	ppm @15% O2	lbs
w/o DB	2.0	8.10	2.0	3.90	5.0	9.40
w/ DB	2.0	10.30	2.0	6.00	5.0	9.40

Hour	Normal Op NOx ppm @15% O2	Normal Op NOx lbs	Normal Op NOx lbs Limit*	Normal Op CO ppm @15% O2 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng	Normal Op CO lbs 3-Hr Rlng Limit**	Normal Op NH3 ppm @15% O2 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng	Normal Ops NH3 lbs 24-Hr Rlng Limit	DB Gas On (Y/N)	Operating Hour	Process Status
00	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.04	9.40	Off	0.00	Down
01	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.04	9.40	Off	0.00	Down
02	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.04	9.40	Off	0.00	Down
03	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.04	9.40	Off	0.00	Down
04	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.04	9.40	Off	0.00	Down
05	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
06	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
07	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
08	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
09	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
10	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
11	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
12	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
13	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
14	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
15	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
16	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
17	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
18	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
19	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
20	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
21	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
22	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down
23	N/A	N/A	8.10	N/A	N/A	3.90	0.0	0.00	9.40	Off	0.00	Down

* 1 hour average weighted limit, that is, the limit is calculated by averaging the limit for each minute in an hour.

** Maximum of the 3 rolling hour limits. For each of those 3 hours, the limit is 1-hr average weighted limit.

Tracy Combined Cycle Power Plant
Tracy, CA
Turbine 2- Monthly Mass Emissions Report
March - 2020

Daily Emission Limits		12 Month Rolling Emission Limits	
NOx lbs - 814.9	CO lbs - 1071.6	NOx lbs - 88,881	CO lbs - 74,598
SOx lbs - 58.7	PM lbs - 132	SOx lbs - 7,084	PM lbs - 32,250
VOC lbs - 78.6		VOC lbs - 15,145	

Day	NOx lbs	SOx lbs	CO lbs	PM lbs	NH3 Slip lbs	VOC lbs	Turbine On-Time
01	Down	Down	Down	Down	Down	0.0	0.0
02	Down	Down	Down	Down	Down	0.0	0.0
03	Down	Down	Down	Down	Down	0.0	0.0
04	173.7	2.9	23.5	11.9	19.5	0.5	7.7
05	Down	Down	Down	Down	Down	0.0	0.0
06	Down	Down	Down	Down	Down	0.0	0.0
07	Down	Down	Down	Down	Down	0.0	0.0
08	Down	Down	Down	Down	Down	0.0	0.0
09	Down	Down	Down	Down	Down	0.0	0.0
10	Down	Down	Down	Down	Down	0.0	0.0
11	Down	Down	Down	Down	Down	0.0	0.0
12	Down	Down	Down	Down	Down	0.0	0.0
13	Down	Down	Down	Down	Down	0.0	0.0
14	Down	Down	Down	Down	Down	0.0	0.0
15	252.6	5.6	40.9	23.2	26.7	2.3	14.4
16	126.8	10.8	12.8	44.8	25.5	6.1	24.0
17	140.8	8.0	9.4	33.0	15.2	3.5	18.6
18	143.1	6.9	9.4	28.3	9.2	1.2	16.8
19	Down	Down	Down	Down	Down	0.0	0.0
20	Down	Down	Down	Down	Down	0.0	0.0
21	Down	Down	Down	Down	Down	0.0	0.0
22	Down	Down	Down	Down	Down	0.0	0.0
23	Down	Down	Down	Down	Down	0.0	0.0
24	129.1	1.4	32.3	5.9	12.0	0.3	4.7
25	1.3	0.1	1.6	0.2	0.0	0.0	0.3
26	162.1	3.6	31.0	14.8	14.3	0.7	10.1
27	Down	Down	Down	Down	Down	0.0	0.0
28	Down	Down	Down	Down	Down	0.0	0.0
29	Down	Down	Down	Down	Down	0.0	0.0
30	172.4	2.0	21.5	8.1	19.8	0.4	6.1
31	Down	Down	Down	Down	Down	0.0	0.0
Total	1302	41	182	170	142.2	15	103
12-Mo Rlng	22109	1055	2713	4464	4428	501	

Tracy Combined Cycle Power Plant
Tracy, CA
Turbine 2- Monthly Operations Report
March - 2020

Day	CT Gas Flow kscf	CT Heat Input mmBtu	CT Gas On-Time	DB Gas Flow kscf	DB Heat Input mmBtu	DB Gas On-Time	Total Heat Input mmBtu	Steam Flow To CTG klbs	Steam Flow To CTG On-Time	NH3 Flow lbs	NH3 Flow On-Time	CT Megawatt Hours	Turbine On-Time
01	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
02	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
03	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
04	5849.8	5966.7	7.74	Down	Down	0.00	5967	2223.2	7.37	196.9	6.82	478	7.7
05	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
06	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
07	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
08	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
09	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
10	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
11	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
12	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
13	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
14	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
15	10965.8	11185.1	14.43	394.5	402.3	5.44	11587	4496.6	13.87	463.1	12.57	902	14.4
16	20678.1	21091.7	24.00	1328.7	1355.2	18.42	22447	8917.4	24.00	916.4	24.00	1795	24.0
17	15596.6	15908.6	18.55	581.2	592.8	9.03	16501	6331.5	18.50	636.4	18.43	1345	18.6
18	13866.7	14144.0	16.81	Down	Down	0.00	14144	5335.5	16.57	511.0	16.59	1186	16.8
19	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
20	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
21	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
22	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
23	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
24	2899.2	2957.1	4.67	Down	Down	0.00	2957	1058.0	4.23	119.8	3.50	217	4.7
25	117.2	119.6	0.25	Down	Down	0.00	120	41.0	0.20	6.8	0.25	8	0.3
26	7269.9	7415.5	10.07	Down	Down	0.00	7416	2814.4	9.76	273.8	9.34	581	10.1
27	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
28	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
29	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
30	3958.4	4037.5	6.12	Down	Down	0.00	4038	1532.4	5.82	155.1	5.35	301	6.1
31	Down	Down	0.00	Down	Down	0.00	Down	Down	0.00	Down	0.00	Down	0.0
Average Total	9022.4 81201.7	9202.9 82826	102.6	768.1 2304.4	783.4 2350	32.9	9464 85177	3638.9 32750.0	100.3	364.4 3279.3	96.9	757 6813	103

ATTACHMENT 6
FUEL SULFUR ROLLING AVG.

TCC FUEL SULFUR ROLLING AVG.				Month Avg.	Daily Limit	12 Month Rolling
Jul-19	0.08	0.1	0.08	0.09	0.66	0.16
Aug-19	0.17	0.16	0.17	0.17	0.66	
Sep-19	0.13	0.16	0.16	0.15	0.66	
Oct-19	0.21	0.21	0.2	0.21	0.66	
Nov-19	0.11	0.12	0.13	0.12	0.66	
Dec-19	0.13	0.17	0.18	0.16	0.66	
Jan-20	0.19	0.2	0.15	0.18	0.66	
Feb-20	0.15	0.16	0.17	0.16	0.66	
Mar-20	0.2	0.2	0.2	0.20	0.66	
Apr-19	0.15	0.2	0.16	0.17	0.66	
May-19	0.18	0.15	0.14	0.16	0.66	
Jun-19	0.13	0.11	0.1	0.11	0.66	

ATTACHMENT 7
STARTUP/SHUTDOWN SUMMARIES

Events

Tracy Combined Cycle Power Plant
for 1/1/2020 thru 3/31/2020

Limits

Turbine 1: NOx lbs/Startup Event	390.5	Turbine 1: PM lbs/Shutdown Event	3.0	Turbine 2: CO lbs/Startup Event	562.5
Turbine 1: NOx lbs/Shutdown Event	104.0	Turbine 1: VOC lbs/Startup Event	10.5	Turbine 2: CO lbs/Shutdown Event	148.0
Turbine 1: SOx lbs/Startup Event	4.1	Turbine 1: VOC lbs/Shutdown Event	2.6	Turbine 2: PM lbs/Startup Event	11.0
Turbine 1: SOx lbs/Shutdown Event	1.1	Turbine 2: NOx lbs/Startup Event	390.5	Turbine 2: PM lbs/Shutdown Event	3.0
Turbine 1: CO lbs/Startup Event	562.5	Turbine 2: NOx lbs/Shutdown Event	104.0	Turbine 2: VOC lbs/Startup Event	10.5
Turbine 1: CO lbs/Shutdown Event	148.0	Turbine 2: SOx lbs/Startup Event	4.1	Turbine 2: VOC lbs/Shutdown Event	2.6
Turbine 1: PM lbs/Startup Event	11.0	Turbine 2: SOx lbs/Shutdown Event	1.1		

Parameter	Start	End	Duration	NOx lbs	SOx lbs	CO lbs	PM lbs	VOC lbs
Turbine 1 Shutdown Event	1/10/2020 11:42 PM	11:42 PM	0:01	0.10	0.00	0.00	0.00	0.00
Turbine 1 Startup Event	1/11/2020 2:36 AM	3:08 AM	0:33	5.90	0.20	0.80	0.30	0.00
Turbine 2 Startup Event	1/14/2020 6:17 AM	8:15 AM	1:59	74.10	0.30	23.10	2.50	0.00
Turbine 2 Shutdown Event	1/14/2020 12:19 PM	12:35 PM	0:17	1.30	0.10	0.90	0.30	0.00
Turbine 2 Startup Event	1/15/2020 2:40 AM	4:05 AM	1:26	71.50	0.20	4.80	1.80	0.00
Turbine 2 Shutdown Event	1/17/2020 4:27 AM	4:39 AM	0:13	1.50	0.00	1.50	0.20	0.00
Turbine 1 Shutdown Event	1/24/2020 7:16 PM	7:31 PM	0:16	1.10	0.10	1.40	0.10	0.00
Turbine 2 Startup Event	3/4/2020 3:44 PM	6:20 PM	2:37	118.50	0.30	15.20	2.70	0.00
Turbine 2 Shutdown Event	3/4/2020 11:15 PM	11:27 PM	0:13	1.60	0.00	0.60	0.20	0.00
Turbine 2 Startup Event	3/15/2020 3:04 AM	5:45 AM	2:42	144.00	0.10	26.80	2.20	0.00
Turbine 2 Shutdown Event	3/15/2020 8:02 AM	8:14 AM	0:13	1.10	0.00	1.20	0.20	0.00
Turbine 2 Startup Event	3/15/2020 2:45 PM	4:03 PM	1:19	49.50	0.30	0.70	1.70	0.00
Turbine 1 Startup Event	3/15/2020 7:26 PM	7:36 PM	0:11	1.10	0.00	16.10	0.00	0.00
Turbine 1 Shutdown Event	3/15/2020 7:37 PM	7:42 PM	0:06	1.00	0.00	5.50	0.00	0.00
Turbine 1 Startup Event	3/16/2020 9:34 AM	10:48 AM	1:15	22.10	0.10	31.80	0.70	0.00
Turbine 1 Shutdown Event	3/17/2020 9:02 AM	9:17 AM	0:16	1.90	0.10	0.60	0.10	0.00
Turbine 2 Shutdown Event	3/17/2020 9:02 AM	9:16 AM	0:15	1.60	0.10	0.50	0.20	0.00
Turbine 1 Startup Event	3/17/2020 2:43 PM	3:50 PM	1:08	45.90	0.10	1.20	0.60	0.00

Parameter	Start	End	Duration	NOx lbs	SOx lbs	CO lbs	PM lbs	VOC lbs
Turbine 2 Startup Event	3/17/2020 2:44 PM	3:52 PM	1:09	48.90	0.10	0.70	1.30	0.00
Turbine 1 Shutdown Event	3/18/2020 9:02 AM	9:17 AM	0:16	1.60	0.10	0.60	0.10	0.00
Turbine 2 Shutdown Event	3/18/2020 9:02 AM	9:16 AM	0:15	1.40	0.10	0.60	0.20	0.00
Turbine 1 Startup Event	3/18/2020 3:44 PM	5:10 PM	1:27	65.60	0.20	0.90	0.80	0.00
Turbine 2 Startup Event	3/18/2020 3:45 PM	5:13 PM	1:29	65.70	0.20	0.30	1.90	0.00
Turbine 1 Shutdown Event	3/18/2020 11:02 PM	11:17 PM	0:16	1.50	0.10	0.60	0.10	0.00
Turbine 2 Shutdown Event	3/18/2020 11:02 PM	11:16 PM	0:15	1.40	0.10	1.00	0.20	0.00
Turbine 2 Startup Event	3/24/2020 7:20 PM	9:36 PM	2:17	118.40	0.10	23.20	1.70	0.00
Turbine 2 Shutdown Event	3/25/2020 12:02 AM	12:14 AM	0:13	0.90	0.00	1.00	0.20	0.00
Turbine 2 Startup Event	3/26/2020 1:27 AM	3:56 AM	2:30	123.40	0.20	20.60	3.00	0.00
Turbine 1 Startup Event	3/26/2020 7:55 AM	9:22 AM	1:28	85.90	0.20	16.90	0.80	0.00
Turbine 2 Shutdown Event	3/26/2020 11:17 AM	11:30 AM	0:14	1.30	0.00	1.10	0.20	0.00
Turbine 1 Shutdown Event	3/26/2020 10:02 PM	10:17 PM	0:16	0.90	0.10	0.70	0.10	0.00
Turbine 2 Startup Event	3/30/2020 1:54 AM	4:41 AM	2:48	151.90	0.10	18.60	2.40	0.00
Turbine 2 Shutdown Event	3/30/2020 7:48 AM	8:00 AM	0:13	1.30	0.00	0.80	0.20	0.00
Total (33 Events)			30:06	1213.90	3.60	220.30	27.00	0.00

ATTACHMENT 8
FUEL USAGE

TRACY COMBINED CYCLE POWER PLANT

Tracy, CA


12 Month Rolling - Combined Annual Gas Usage

March 2020 12-Month Rolling

Limit - 20,454 MMscf/year

Month	Unit 1 - Total Gas Flow kscf Monthly Total	Unit 2 - Total Gas Flow kscf Monthly Total	Total Gas Plant (U1+U2) Flow kscf Monthly Total	Total Plant Gas Flow mmscf Monthly Total	Total Plant Gas Flow mmscf 12 Month Rolling
Apr 2019	174638	110216	284854	285	7201
May 2019	57994	13211	71205	71	7203
Jun 2019	319756	211968	531724	532	7526
Jul 2019	340655	205373	546028	546	6960
Aug 2019	352084	259298	611382	611	6566
Sep 2019	232184	169733	401917	402	6642
Oct 2019	270379	213851	484230	484	6176
Nov 2019	361609	276559	638168	638	6319
Dec 2019	675869	546128	1221997	1222	6898
Jan 2020	492761	48397	541158	541	6801
Feb 2020	Down	Down	Down	Down	5929
Mar 2020	53970	83506	137476	137	5470

ATTACHMENT 9
FUEL SULFUR ANALYSIS



ZALCO LABORATORIES, INC.

Analytical & Consulting Services

4309 Armour Avenue
Bakersfield, California 93308

(661) 395-0539
FAX (661) 395-3069

January 13, 2020

Richard Vogler
San Joaquin Energy Inc.
14950 W. Shulte Road
Tracy, CA 95377

TEL: (209) 248-6841
FAX:


Project ID:
RE: 2001033

Dear Richard Vogler:

Zalco Laboratories, Inc. received 3 samples on 1/7/2020 for the analyses presented in the following report.


We appreciate your business and look forward to serving you in the future . Please feel free to call our office if you have any questions regarding these test results.

Sincerely,

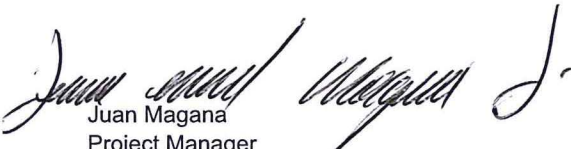
Juan Magana
Project Manager
CC: Neftali Nevarez & Wayne Toumbs

NSS: Non Sufficient Sample H: Exceeds Analysis Hold Time TTLC: Total Threshold Limit Concentration STLC: Soluble Threshold Limit Concentration TCLP: Toxicity Characteristic Leaching Procedure MCL: Maximum Contaminant Level *: See Case Narrative
The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.

Note: Samples analyzed for regulatory purposes should be put on ice immediately after sampling and received by the laboratory at temperatures between 0-6°C. Microbiological analysis requires samples to be at least 4-10°C when received at the laboratory. For additional information regarding the limitations of the method(s) referred to, please call us at 661-395-0539.



ZALCO LABORATORIES, INC.

Analytical & Consulting Services

4309 Armour Avenue
Bakersfield, California 93308

(661) 395-0539
FAX (661) 395-3069

San Joaquin Energy Inc.
14950 W. Shulte Road
Tracy, CA 95377

Project: Master
Project #:
Attention: Richard Vogler

Work Order No.: **2001033**
Reported: 01/13/2020
Received: 01/07/2020 09:43

Lab Sample ID: **2001033-01**

Collected By: Wayne Toumbs


Client Sample ID: Natural Gas

Date Collected: 1/6/2020 6:15:00AM

Analyte	Results	PQL	Units	Flag	Method	Date Prepared	Date Analyzed	Init.
Gas & Air Testing								
Sulfur	0.190	0.060	gr/100 scf		ASTM D3246-11	1/7/20	1/7/20	MO
Total Sulfur/Hydrogen Sulfide by ASTM D3246								
Total Sulfur	3.17	1.00	ppm		ASTM D 3246/M	1/7/20	1/7/20	MO

NSS: Non Sufficient Sample H: Exceeds Analysis Hold Time TTLC: Total Threshold Limit Concentration STLC: Soluble Threshold Limit Concentration TCLP: Toxicity Characteristic Leaching Procedure MCL: Maximum Contaminant Level *: See Case Narrative
The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.

Note: Samples analyzed for regulatory purposes should be put on ice immediately after sampling and received by the laboratory at temperatures between 0-6°C. Microbiological analysis requires samples to be at least 4-10°C when received at the laboratory. For additional information regarding the limitations of the method(s) referred to, please call us at 661-395-0539.



ZALCO LABORATORIES, INC.

Analytical & Consulting Services

4309 Armour Avenue
Bakersfield, California 93308

(661) 395-0539
FAX (661) 395-3069

San Joaquin Energy Inc.
14950 W. Shulte Road
Tracy, CA 95377

Project: Master
Project #:
Attention: Richard Vogler

Work Order No.: **2001033**
Reported: 01/13/2020
Received: 01/07/2020 09:43

Lab Sample ID: **2001033-02**

Collected By: Wayne Toumbs

Client Sample ID: Natural Gas

Date Collected: 1/6/2020 6:17:00AM

Analyte	Results	PQL	Units	Flag	Method	Date Prepared	Date Analyzed	Init.
Gas & Air Testing								
Sulfur	0.197	0.060	gr/100 scf		ASTM D3246-11	1/7/20	1/7/20	MO
Total Sulfur/Hydrogen Sulfide by ASTM D3246								
Total Sulfur	3.30	1.00	ppm		ASTM D 3246/M	1/7/20	1/7/20	MO

NSS: Non Sufficient Sample H: Exceeds Analysis Hold Time TTLC: Total Threshold Limit Concentration STLC: Soluble Threshold Limit Concentration TCLP: Toxicity Characteristic Leaching Procedure MCL: Maximum Contaminant Level *: See Case Narrative
The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.

Note: Samples analyzed for regulatory purposes should be put on ice immediately after sampling and received by the laboratory at temperatures between 0-6°C. Microbiological analysis requires samples to be at least 4-10°C when received at the laboratory. For additional information regarding the limitations of the method(s) referred to, please call us at 661-395-0539.



ZALCO LABORATORIES, INC.

Analytical & Consulting Services

4309 Armour Avenue
Bakersfield, California 93308

(661) 395-0539
FAX (661) 395-3069

San Joaquin Energy Inc.
14950 W. Shulte Road
Tracy, CA 95377

Project: Master
Project #:
Attention: Richard Vogler

Work Order No.: 2001033
Reported: 01/13/2020
Received: 01/07/2020 09:43

Lab Sample ID: 2001033-03

Collected By: Wayne Tumbs

Client Sample ID: Natural Gas

Date Collected: 1/6/2020 6:19:00AM

Analyte	Results	PQL	Units	Flag	Method	Date Prepared	Date Analyzed	Init.
Gas & Air Testing								
Sulfur	0.145	0.060	gr/100 scf		ASTM D3246-11	1/7/20	1/7/20	MO
Total Sulfur/Hydrogen Sulfide by ASTM D3246								
Total Sulfur	2.43	1.00	ppm		ASTM D 3246/M	1/7/20	1/7/20	MO

NSS: Non Sufficient Sample H: Exceeds Analysis Hold Time TTLC: Total Threshold Limit Concentration STLC: Soluble Threshold Limit Concentration TCLP: Toxicity Characteristic Leaching Procedure MCL: Maximum Contaminant Level *: See Case Narrative
The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.

Note: Samples analyzed for regulatory purposes should be put on ice immediately after sampling and received by the laboratory at temperatures between 0-6°C. Microbiological analysis requires samples to be at least 4-10°C when received at the laboratory. For additional information regarding the limitations of the method(s) referred to, please call us at 661-395-0539.

ZALCO LABORATORIES, INC.

4309 Armour Avenue, Bakersfield, CA 93308 (661) 395-0539 FAX (661) 395-3069 www.zalcolabs.com
2186 Eastman Avenue, Suite 103, Ventura, CA 93003 (805) 477-0114 Fax (805) 477-0125

CHAIN OF CUSTODY, ID#

Page 1 of 1

Zalco Lab # _____

Client PO # _____

PROJECT ID: _____

QUOTE ID:

COMMENTS:

Turnaround Time:

Routine 5 working days X

Rush By _____ working days

Send Copy to State of CA?

Yes ☐ No ☒

Attention To: _____

Send Copy to County?

Yes ☐ No ☒

County _____

REPORT INFO				INVOICE INFO											
Client: MRP San Joaquin Energy LLC.				Invoice To: Same as Client ☐											
Address: 14950 W. SHULTE RD.				Address:											
City, State, Zip: TRACY, CA 95377				City, State, Zip:											
Attention: Richard.Vogler@naes.com				Attention:											
Phone: Neftali.Nevarez@naes.com				Phone:											
Fax: Wayne.Toumbs@naes.com				Fax:											
Email: Results X				Email:											
SAMPLED BY: Wayne Toumbs				EMPLOYED BY: MRP San Joaquin Energy LLC											
Sample No. *	Sample Description	Date	Sample Time	Type*	# OF CONTAINERS	ANALYSIS						TEMPERATURE (C')	PROJECT ID:		
1	NATURAL GAS	1/6/20	06:15	G	X								QUOTE ID:		
2	NATURAL GAS	1/6/20	06:17	G	X								COMMENTS:		
3	NATURAL GAS	1/6/20	06:19	G	X								Turnaround Time:		
													Routine 5 working days X		
													Rush By working days		
													Send Copy to State of CA?		
													Yes ☐ No X		
													Attention To:		
													Send Copy to County?		
													Yes ☐ No X		
													County		
RELINQUISHED By: Signature				PRINT		COMPANY		Date		Time		RECEIVED By: Signature		PRINT	
Wayne Toumbs				Wayne Toumbs		San Joaquin Energy		1/6/20		0730		P. J. Schmitt		Bryan Schmitt	

NOTE: Samples are discarded 30 days after results unless other arrangements are made. Hazardous samples will be returned to client or disposed of at the client's expense.

*Sample Type Key: AO-Aqueous; BS-Biosolid; DW-Drinking Water; GW-Ground Water; G-Gas; LPG-Liquid Petroleum Gas; OL-Oil; O-Other; P-Petroleum; S-Soil/Solid; ST-Storm Water; WW-Wastewater

*Sample No.: FOR OFFICE USE ONLY



ZALCO LABORATORIES, INC.

Analytical & Consulting Services

4309 Armour Avenue
Bakersfield, California 93308

(661) 395-0539
FAX (661) 395-3069

February 11, 2020

Richard Vogler
San Joaquin Energy Inc.
14950 W. Shulte Road
Tracy, CA 95377

TEL: (209) 248-6841
FAX:

Project ID:
RE: 2002014

Dear Richard Vogler:

Zalco Laboratories, Inc. received 3 samples on 2/4/2020 for the analyses presented in the following report.

We appreciate your business and look forward to serving you in the future. Please feel free to call our office if you have any questions regarding these test results.

Sincerely,




Juan Magana
Project Manager

CC: Neftali Nevarez & Wayne Toumbs

NSS: Non Sufficient Sample H: Exceeds Analysis Hold Time TTLC: Total Threshold Limit Concentration STLC: Soluble Threshold Limit Concentration TCLP: Toxicity Characteristic
Leaching Procedure MCL: Maximum Contaminant Level *: See Case Narrative

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.

Note: Samples analyzed for regulatory purposes should be put on ice immediately after sampling and received by the laboratory at temperatures between 0-6°C. Microbiological analysis requires samples to be at least 4-10°C when received at the laboratory. For additional information regarding the limitations of the method(s) referred to, please call us at 661-395-0539.



ZALCO LABORATORIES, INC.

Analytical & Consulting Services

4309 Armour Avenue
Bakersfield, California 93308

(661) 395-0539
FAX (661) 395-3069

San Joaquin Energy Inc.
14950 W. Shulte Road
Tracy, CA 95377

Project: Master
Project #:
Attention: Richard Vogler

Work Order No.: 2002014
Reported: 02/11/2020
Received: 02/04/2020 10:25

Lab Sample ID: 2002014-01

Collected By: Wayne Toubms

Client Sample ID: Natural Gas

Date Collected: 2/3/2020 8:15:00AM

Analyte	Results	PQL	Units	Flag	Method	Date Prepared	Date Analyzed	Init.
Gas & Air Testing								
Sulfur	0.149	0.060	gr/100 scf		ASTM D3246-11	2/5/20	2/5/20	MO
Total Sulfur/Hydrogen Sulfide by ASTM D3246								
Total Sulfur	2.50	1.00	ppm		ASTM D 3246/M	2/5/20	2/5/20	MO

NSS: Non Sufficient Sample H: Exceeds Analysis Hold Time TTLC: Total Threshold Limit Concentration STLC: Soluble Threshold Limit Concentration TCLP: Toxicity Characteristic
Leaching Procedure MCL: Maximum Contaminant Level *: See Case Narrative

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.

Note: Samples analyzed for regulatory purposes should be put on ice immediately after sampling and received by the laboratory at temperatures between 0-6°C. Microbiological analysis requires samples to be at least 4-10°C when received at the laboratory. For additional information regarding the limitations of the method(s) referred to, please call us at 661-395-0539.



ZALCO LABORATORIES, INC.

Analytical & Consulting Services

4309 Armour Avenue
Bakersfield, California 93308

(661) 395-0539
FAX (661) 395-3069

San Joaquin Energy Inc.
14950 W. Shulte Road
Tracy, CA 95377

Project: Master
Project #:
Attention: Richard Vogler

Work Order No.: 2002014
Reported: 02/11/2020
Received: 02/04/2020 10:25

Lab Sample ID: 2002014-02

Collected By: Wayne Toubms


Client Sample ID: Natural Gas

Date Collected: 2/3/2020 8:17:00AM

Analyte	Results	PQL	Units	Flag	Method	Date Prepared	Date Analyzed	Init.
Gas & Air Testing								
Sulfur	0.162	0.060	gr/100 scf		ASTM D3246-11	2/5/20	2/5/20	MO
Total Sulfur/Hydrogen Sulfide by ASTM D3246								
Total Sulfur	2.72	1.00	ppm		ASTM D 3246/M	2/5/20	2/5/20	MO

NSS: Non Sufficient Sample H: Exceeds Analysis Hold Time TTLC: Total Threshold Limit Concentration STLC: Soluble Threshold Limit Concentration TCLP: Toxicity Characteristic Leaching Procedure MCL: Maximum Contaminant Level *: See Case Narrative
The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.

Note: Samples analyzed for regulatory purposes should be put on ice immediately after sampling and received by the laboratory at temperatures between 0-6°C. Microbiological analysis requires samples to be at least 4-10°C when received at the laboratory. For additional information regarding the limitations of the method(s) referred to, please call us at 661-395-0539.



ZALCO LABORATORIES, INC.

Analytical & Consulting Services

4309 Armour Avenue
Bakersfield, California 93308

(661) 395-0539
FAX (661) 395-3069

San Joaquin Energy Inc.
14950 W. Shulte Road
Tracy, CA 95377

Project: Master
Project #:
Attention: Richard Vogler

Work Order No.: 2002014
Reported: 02/11/2020
Received: 02/04/2020 10:25

Lab Sample ID: 2002014-03

Collected By: Wayne Toumbs

Client Sample ID: Natural Gas

Date Collected: 2/3/2020 8:19:00AM

Analyte	Results	PQL	Units	Flag	Method	Date Prepared	Date Analyzed	Init.
Gas & Air Testing								
Sulfur	0.169	0.060	gr/100 scf		ASTM D3246-11	2/5/20	2/5/20	MO
Total Sulfur/Hydrogen Sulfide by ASTM D3246								
Total Sulfur	2.83	1.00	ppm		ASTM D 3246/M	2/5/20	2/5/20	MO

NSS: Non Sufficient Sample H: Exceeds Analysis Hold Time TTLC: Total Threshold Limit Concentration STLC: Soluble Threshold Limit Concentration TCLP: Toxicity Characteristic Leaching Procedure MCL: Maximum Contaminant Level *: See Case Narrative

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.

Note: Samples analyzed for regulatory purposes should be put on ice immediately after sampling and received by the laboratory at temperatures between 0-6°C. Microbiological analysis requires samples to be at least 4-10°C when received at the laboratory. For additional information regarding the limitations of the method(s) referred to, please call us at 661-395-0539.

ZALCO LABORATORIES, INC.

4309 Armour Avenue, Bakersfield, CA 93308 (661) 395-0539 FAX (661) 395-3069 www.zalcolabs.com
2186 Eastman Avenue, Suite 103, Ventura, CA 93003 (805) 477-0114 Fax (805) 477-0125

CHAIN OF CUSTODY, ID#

Page 1 of 1

Zalco Lab # _____

Client PO # _____

PROJECT ID: _____

QUOTE ID:

COMMENTS:

Turnaround Time:

Routine 5 working days X

Rush By _____ working days

Send Copy to State of CA?

Yes ☐ No ☒

Attention To: _____

Send Copy to County?

Yes ☐ No ☒


County _____

[illegible]

NOTE: Samples are discarded 30 days after results unless other arrangements are made. Hazardous samples will be returned to client or disposed of at the client's expense.

*Sample Type Key: AQ-Aqueous; BS-Biosolid; DW-Drinking Water; GW-Ground Water; G-Gas; LPG-Liquid Petroleum Gas; OL-Oil O-Other; P-Petroleum; S-Soil/Solid; ST-Storm Water; WW-Wastewater

*Sample No.: FOR OFFICE USE ONLY



ZALCO LABORATORIES, INC.

Analytical & Consulting Services

4309 Armour Avenue
Bakersfield, California 93308

(661) 395-0539
FAX (661) 395-3069

March 6, 2020

Richard Vogler
San Joaquin Energy Inc.
14950 W. Shulte Road
Tracy, CA 95377

TEL: (209) 248-6841
FAX:

Project ID:
RE: 2003019

Dear Richard Vogler:

Zalco Laboratories, Inc. received 3 samples on 3/3/2020 for the analyses presented in the following report.

We appreciate your business and look forward to serving you in the future . Please feel free to call our office if you have any questions regarding these test results.

Sincerely,



Juan Magana
Project Manager
CC: Neftali Nevarez & Wayne Toumbs

NSS: Non Sufficient Sample H: Exceeds Analysis Hold Time TTLC: Total Threshold Limit Concentration STLC: Soluble Threshold Limit Concentration TCLP: Toxicity Characteristic
Leaching Procedure MCL: Maximum Contaminant Level *: See Case Narrative
The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.

Note: Samples analyzed for regulatory purposes should be put on ice immediately after sampling and received by the laboratory at temperatures between 0-6°C.
Microbiological analysis requires samples to be at least 4-10°C when received at the laboratory. For additional information regarding the limitations of the method(s) referred to, please call us at 661-395-0539.



ZALCO LABORATORIES, INC.

Analytical & Consulting Services

4309 Armour Avenue
Bakersfield, California 93308

(661) 395-0539
FAX (661) 395-3069

San Joaquin Energy Inc. 14950 W. Shulte Road Tracy, CA 95377	Project: Master Project #: Attention: Richard Vogler	Work Order No.: 2003019 Reported: 03/06/2020 Received: 03/03/2020 10:34
--	--	--

Lab Sample ID: 2003019-01 Client Sample ID: Natural Gas	Collected By: Wayne Toumbs Date Collected: 3/2/2020 7:40:00AM
---	--

Analyte	Results	PQL	Units	Flag	Method	Date Prepared	Date Analyzed	Init.
Gas & Air Testing								
Sulfur	0.204	0.060	gr/100 scf		ASTM D3246-11	3/4/20	3/4/20	MO
Total Sulfur/Hydrogen Sulfide by ASTM D3246								
Total Sulfur	3.36	1.00	ppm		ASTM D 3246/M	3/4/20	3/4/20	MO

NSS: Non Sufficient Sample H: Exceeds Analysis Hold Time TTLC: Total Threshold Limit Concentration STLC: Soluble Threshold Limit Concentration TCLP: Toxicity Characteristic Leaching Procedure MCL: Maximum Contaminant Level *: See Case Narrative
The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.

Note: Samples analyzed for regulatory purposes should be put on ice immediately after sampling and received by the laboratory at temperatures between 0-6°C. Microbiological analysis requires samples to be at least 4-10°C when received at the laboratory. For additional information regarding the limitations of the method(s) referred to, please call us at 661-395-0539.



ZALCO LABORATORIES, INC.

Analytical & Consulting Services

4309 Armour Avenue
Bakersfield, California 93308

(661) 395-0539
FAX (661) 395-3069

San Joaquin Energy Inc.
14950 W. Shulte Road
Tracy, CA 95377

Project: Master
Project #:
Attention: Richard Vogler

Work Order No.: **2003019**
Reported: 03/06/2020
Received: 03/03/2020 10:34

Lab Sample ID: **2003019-02**

Collected By: Wayne Tumbs

Client Sample ID: Natural Gas

Date Collected: 3/2/2020 7:42:00AM

Analyte	Results	PQL	Units	Flag	Method	Date Prepared	Date Analyzed	Init.
Gas & Air Testing								
Sulfur	0.198	0.060	gr/100 scf		ASTM D3246-11	3/4/20	3/4/20	MO
Total Sulfur/Hydrogen Sulfide by ASTM D3246								
Total Sulfur	3.26	1.00	ppm		ASTM D 3246/M	3/4/20	3/4/20	MO

NSS: Non Sufficient Sample H: Exceeds Analysis Hold Time TTLC: Total Threshold Limit Concentration STLC: Soluble Threshold Limit Concentration TCLP: Toxicity Characteristic Leaching Procedure MCL: Maximum Contaminant Level *: See Case Narrative
The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.

Note: Samples analyzed for regulatory purposes should be put on ice immediately after sampling and received by the laboratory at temperatures between 0-6°C. Microbiological analysis requires samples to be at least 4-10°C when received at the laboratory. For additional information regarding the limitations of the method(s) referred to, please call us at 661-395-0539.



ZALCO LABORATORIES, INC.

Analytical & Consulting Services

4309 Armour Avenue
Bakersfield, California 93308

(661) 395-0539
FAX (661) 395-3069

San Joaquin Energy Inc.
14950 W. Shulte Road
Tracy, CA 95377

Project: Master
Project #:
Attention: Richard Vogler

Work Order No.: 2003019
Reported: 03/06/2020
Received: 03/03/2020 10:34

Lab Sample ID: 2003019-03

Collected By: Wayne Toubms

Client Sample ID: Natural Gas

Date Collected: 3/2/2020 7:45:00AM

Analyte	Results	PQL	Units	Flag	Method	Date Prepared	Date Analyzed	Init.
Gas & Air Testing								
Sulfur	0.204	0.060	gr/100 scf		ASTM D3246-11	3/4/20	3/4/20	MO
Total Sulfur/Hydrogen Sulfide by ASTM D3246								
Total Sulfur	3.36	1.00	ppm		ASTM D 3246/M	3/4/20	3/4/20	MO

NSS: Non Sufficient Sample H: Exceeds Analysis Hold Time TTLC: Total Threshold Limit Concentration STLC: Soluble Threshold Limit Concentration TCLP: Toxicity Characteristic Leaching Procedure MCL: Maximum Contaminant Level *: See Case Narrative

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.

Note: Samples analyzed for regulatory purposes should be put on ice immediately after sampling and received by the laboratory at temperatures between 0-6°C. Microbiological analysis requires samples to be at least 4-10°C when received at the laboratory. For additional information regarding the limitations of the method(s) referred to, please call us at 661-395-0539.

ZALCO LABORATORIES, INC.

4309 Armour Avenue, Bakersfield, CA 93308 (661) 395-0539 FAX (661) 395-3069 www.zalcolabs.com
2186 Eastman Avenue, Suite 103, Ventura, CA 93003 (805) 477-0114 Fax (805) 477-0125

CHAIN OF CUSTODY, ID#

Page 1 of 1

Zalco Lab # _____

Client PO # _____

PROJECT ID: _____

QUOTE ID:

COMMENTS:

Turnaround Time:
Routine 5 working days ☒

Rush By _____ working days

Send Copy to State of CA?
Yes ☐ No ☒

Attention To: _____

Send Copy to County? Yes ☐ No ☒

County _____

[illegible]

NOTE: Samples are discarded 30 days after results unless other arrangements are made. Hazardous samples will be returned to client or disposed of at the client's expense.

*Sample Type Key: AQ-Aqueous; BS-Biosolid; DW-Drinking Water; GW-Ground Water; G-Gas; LPG-Liquid Petroleum Gas; OL-Oil; O-Other; P-Petroleum; S-Soil/Solid; ST-Storm Water; WW-Wastewater

*Sample No.: FOR OFFICE USE ONLY

ATTACHMENT 10
CEMS OPERATION REPORTS

☒ Northern Region ☐ Central Region ☐ Southern Region

QUARTERLY CEMS EXCESS EMISSION AND DOWNTIME SUMMARY

1ST ☒ JAN - MAR 2020

3RD ☐ JULY - SEPT 2020

2ND ☐ APR - JUNE 2020

4TH ☐ OCT - DEC 2019

Facility Name: MRP- San Joaquin Energy - TCCPP Permit #: N-4597-1-9

Location: 14950 W. Schulte Rd. City: Tracy

AIRS #: 06 077 N4597 NSPS Source ? : ☒ Yes ☐ No

Equipment Description: Electrical Power Generating System #1

Pollutants Monitored ☒ NOx ☐ SOx ☒ CO ☐ Opacity ☒ O₂ ☐ CO₂ ☒ NH₃

☒ Other Inlet NOx, O₂

Total Hours Operated This Quarter: 641

CEM Unit Information

Pollutant	Manufacturer / Model	Serial #	Date Installed	Total Hrs Operated This Qtr.
NOx	Horiba/ENDA - 7420-CL	P-4702-NOX-S	07-17-2017	2184
SOx				
CO	Horiba/ENDA - 7420-CL	P-4702-CO	07-17-2017	2184
Opacity				
O ₂	Horiba/ENDA - 7420-CL	P-4702-O2-S	07-17-2017	2184
CO ₂				
NH ₃				
Other	Horiba/ENDA - 7420-CL	P-4702-NOX-I P-4702-O2-I	07-17-2017	2184

Date of Last Performance Specification Test

Pollutant	NOx	SOx	CO	Opacity	O ₂	CO ₂	NH ₃	Other
Date	01/07/20		01/07/20		01/08/20			01/08/20
Type	☐ RATA ☒ CGA	☐ RATA ☐ CGA	☐ RATA ☒ CGA	☐ RATA ☐ CGA	☐ RATA ☒ CGA	☐ RATA ☐ CGA	☐ RATA ☐ CGA	☐ RATA ☒ CGA

Emission Limits (From Operating Permits)

Pollutant	ppm @ O ₂ % DB off	lb/hr DB off	ppm @ O ₂ % DB on	lb/hr DB on	lb/Day	ppm @ O ₂
NO _x	2.0	8.10	2.0	10.30	814.9	15%
SO _x		2.03		2.63	58.7	
CO	2.0	3.90	2.0	6.00	1071.6	15%
VOC	1.5	1.13	2.0	3.22	78.6	15%
O ₂						
PM10		4.40		5.80	132.0	
NH ₃ (24 hr avg)	5	9.40	5	9.40		15%

Excess Emissions Information (Report in Hours)

Pollutant	Start-Up / Shutdown	Cleaning	Breakdown	Other Known	Unknown	Total Hrs Excess	% Excess
NO _x	0	0	0	0	0	0	0
SO _x							
CO	0	0	0	0	0	0	0
Opacity							
O ₂	0	0	0	0	0	0	0
CO ₂							
NH ₃	0	0	0	0	0	0	0
	0	0	0	0	0	0	0

Include copies or a summary of: 1. All excess emissions notifications made in the quarter, 2. Equipment (non-instrument) breakdown reports associated with excess emission periods, 3. CEM equipment breakdown reports.

Excess emissions caused by a startup after shutdown due to a malfunction should be reported as an excess emission due to an equipment breakdown.. The source is not however, exempt from emission limits. All exceedances are to be reported in whole hour increments.

CEM Downtime Information (Report in Hours)

Pollutant	Monitor Malfunction	Non-Monitor Malfunction	Q/A - Cal	Other	Unknown	Total	% Downtime
NO _x	0	0	1	0	0	1	.16
SO _x							
CO	0	0	1	0	0	1	.16
Opacity							
O ₂	0	0	1	0	0	1	.16
CO ₂							
NH ₃							
Other	0	0	1	0	0	1	.16

Non-CEM malfunctions are incidents that result in the CEM system being down but are not associated with a malfunction of the CEM system, i.e. plant power failure.

☒ Northern Region ☐ Central Region ☐ Southern Region

QUARTERLY CEMS EXCESS EMISSION AND DOWNTIME SUMMARY

1ST ☒ JAN - MAR 2020

3RD ☐ JULY - SEPT 2020

2ND ☐ APR - JUNE 2020

4TH ☐ OCT - DEC 2020

Facility Name: MRP- San Joaquin Energy-TCCPP Permit #: N-4597-2-9

Location: 14950 W. Schulte Rd. City: Tracy

AIRS #: 06 077 N4597 NSPS Source ? : ☒ Yes ☐ No

Equipment Description: Electrical Power Generating System #2

Pollutants Monitored ☒ NOx ☐ SOx ☒ CO ☐ Opacity ☒ O₂ ☐ CO₂ ☒ NH₃

☒ Other Inlet NOx, O₂

Total Hours Operated This Quarter: 171

CEM Unit Information

Pollutant	Manufacturer / Model	Serial #	Date Installed	Total Hrs Operated This Qtr.
NOx	Horiba/ENDA-7420-CL	P-4701-NOX-S	07-18-2017	2184
SOx				
CO	Horiba/ENDA - 7420-CL	P-4701-CO	07/18/2017	2184
Opacity				
O ₂	Horiba/ENDA-7420-CL	P-4701-O2-S	07/18/2017	2184
CO ₂				
NH ₃				
Other	Horiba/ENDA-7420-CL	P-4701-NOX-I P-4701-O2-I	07/18/2017	2184

Date of Last Performance Specification Test

Pollutant	NOx	SOx	CO	Opacity	O ₂	CO ₂	NH ₃	Other
Date	01/07/20		01/07/20		01/08/20			01/08/20
Type	☐ RATA ☒ CGA	☐ RATA ☐ CGA	☐ RATA ☒ CGA	☐ RATA ☐ CGA	☐ RATA ☒ CGA	☐ RATA ☐ CGA	☐ RATA ☐ CGA	☐ RATA ☒ CGA

Emission Limits (From Operating Permits)

Pollutant	ppm @ O ₂ % DB off	lb/hr DB off	ppm @ O ₂ % DB on	lb/hr DB on	lb/Day	ppm @ O ₂
NO _x	2.0	8.10	2.0	10.30	814.9	15%
SO _x		2.03		2.63	58.7	
CO	2.0	3.90	2.0	6.00	1071.6	15%
VOC	1.5	1.13	2.0	3.22	78.6	15%
O ₂						
PM ₁₀		4.40		5.80	132.0	
NH ₃ (24 hr avg)	5	9.40	5	9.40		15%

Excess Emissions Information (Report in Hours)

Pollutant	Start-Up / Shutdown	Cleaning	Breakdown	Other Known	Unknown	Total Hrs Excess	% Excess
NO _x	0	0	0	0	0	0	0
SO _x							
CO	0	0	0	0	0	0	0
Opacity							
O ₂	0	0	0	0	0	0	0
CO ₂							
NH ₃	0	0	0	0	0	0	0
Other	0	0	0	0	0	0	0

Include copies or a summary of: 1. All excess emissions notifications made in the quarter, 2. Equipment (non-instrument) breakdown reports associated with excess emission periods, 3. CEM equipment breakdown reports.

Excess emissions caused by a startup after shutdown due to a malfunction should be reported as an excess emission due to an equipment breakdown.. The source is not however, exempt from emission limits. All exceedances are to be reported in whole hour increments.

CEM Downtime Information (Report in Hours)

Pollutant	Monitor Malfunction	Non-Monitor Malfunction	Q/A - Cal	Other	Unknown	Total	% Downtime
NO _x	0	0	3	0	0	3	1.8
SO _x							
CO	0	0	3	0	0	3	1.8
Opacity							
O ₂	0	0	3	0	0	3	1.8
CO ₂							
NH ₃							
Other	0	0	3	0	0	3	1.8

Non-CEM malfunctions are incidents that result in the CEM system being down but are not associated with a malfunction of the CEM system, i.e. plant power failure.

Reports must be submitted within 30 days of the end of the quarter for which the report was generated.

ATTACHMENT 11
EDG LOG

2

2

2

2

[illegible]

ATTACHMENT 12
AUX BOILER LOG

Tracy Combined Cycle Power Plant

Tracy, CA

Aux Boiler Operating Time

2020

Limit- 4000 Hr

Month	Aux Boiler Operating Time (Hrs)
Jan	124
Feb	51
Mar	224
Apr	84
May	Invalid
Jun	Invalid
Jul	Invalid
Aug	Invalid
Sep	Invalid
Oct	Invalid
Nov	Invalid
Dec	Invalid
Year-To-Month Total	483

ATTACHMENT 13
EMERGENCY FIRE PUMP LOG

Tracy Diesel Fire pump Run Log - 2020

Meter Begin	27.6	Meter End	29.5			
Date	Test/Maint Run Time (min)	Emergency Run Time (min)	Total run time Control panel (Hrs: Min)	Total Engine Run Time (HRs)	Total Engine Starts	Comments
1/1/2020	5	0	28:43	27.6	407	Weekly Test
1/7/2020	2	0	28:45	27.7	408	Weekly Test
1/14/2020	5	0	28:50	27.8	409	Weekly Test
1/21/2020	3	0	28:53	27.8	410	Weekly Test
1/28/2020	30	0	29:23	28.3	411	Monthly Test
2/4/2020	2	0	29:25	28.3	412	Weekly Test
2/11/2020	2	0	29:27	28.4	413	Weekly Test
2/18/2020	2	0	29:28	28.4	414	Weekly Test
2/25/2020	30	0	29:57	28.9	415	Monthly Test
3/3/2020	5	0	29:58	28.9	416	Weekly Test
3/10/2020	3	0	30:01	28.9	417	Weekly Test
3/17/2020	5	0	30:06	29.0	418	Weekly Test
3/24/2020	2		30:08	29.0	419	Weekly Test
3/31/2020	30	0	30:38	29.5	420	Monthly Test
Total Time	126	0	126		13	

	2.10	0.00	2.10
Total Hours	Test/Maint Run Time	Emergency Run Time	Total Run Time

	Time (Min)	No. of Starts	Time (Hours)
Run Times Per Reason:			
Weekly Reliability Test Run	126	13	2.10
Emergency Run	0	0	0

ATTACHMENT 14
Aux Boiler Compliance

April 2, 2020

Mr. Claude Couvillion
Mrp San Joaquin Energy, LLC
14950 W. Schulte Rd
Tracy, CA 95377

RE: DETERMINATION OF COMPLIANCE EMISSION TESTING

Dear Mr. Couvillion,

District staff have received the test report submitted for the permitted equipment listed below for compliance determination with permitted emission limits. Review of the test result(s) reveal the equipment appears to be **operating in full compliance** with permitted emission limits.

If the permitted equipment has annual source testing requirements, then the next required test must be conducted within thirty days (+/- 30) of the next test date as shown below. If an ATC has been issued for modifications to the permitted equipment then the testing requirements must follow the ATC.

Permit Number	Unit ID	Test Date	Next Test Date
N-4597-5-1	Boiler	1/31/2020	1/18/2023

If the equipment is under dormant status, you must contact the District before restarting unit. If you have any questions please call this office at (209) 557-6400.

Sincerely,



Lisa D Middleton
Supervising Air Quality Inspector

ATTACHMENT 15
Dust Suppression Control Measures

No construction occurred during Q1 2020, therefore no additional dust suppression control measures were put in place.