

**DOCKETED**

<b>Docket Number:</b>	13-ATTCP-01
<b>Project Title:</b>	Acceptance and Training Certification
<b>TN #:</b>	238148
<b>Document Title:</b>	ATTCP Quick Start Presentation
<b>Description:</b>	N/A
<b>Filer:</b>	Joe Loyer
<b>Organization:</b>	California Energy Commission
<b>Submitter Role:</b>	Commission Staff
<b>Submission Date:</b>	6/8/2021 9:05:54 AM
<b>Docketed Date:</b>	6/8/2021



# **Acceptance Testing Enforcement**

Lighting Controls and Mechanical Systems in Nonresidential Buildings

Presenter: Joe Loyer, Senior Mechanical Engineer

Date: TBD



# Agenda

---

- Introduction
- Acceptance Testing and the ATTCP
- Builders and Contractors
- Authorities Having Jurisdiction
- Questions and Answers



# Acronyms Used

---

ATTCP	Acceptance Test Technician Certification Provider
ATT	Acceptance Test Technician
ATE	Acceptance Test Employer
AHJ	Authority Having Jurisdiction
CEC	California Energy Commission
NRCC	Nonresidential Certificate of Compliance
NRCI	Nonresidential Certificate of Installation
NRCA	Nonresidential Certificate of Acceptance



# Introduction



# Learning Goals

---

## Understand the ATTCP Program

### Builders and contractors

- ATTCP program to demonstrate code compliance
- Secure an ATT certification
- Engineer or architect can rely on program

### Authorities Having Jurisdiction

- ATTCP program to enforce Energy Code
- Inspectors can rely on efficacy of program
- Other checks for inspectors to use



# ATTCP Program

---

CEC approves ATTCPs to


- Train, certify, and oversee ATTs and ATEs

ATTs perform tests in nonresidential buildings for

- Lighting Controls
- Mechanical Systems




# Construction Process Overview

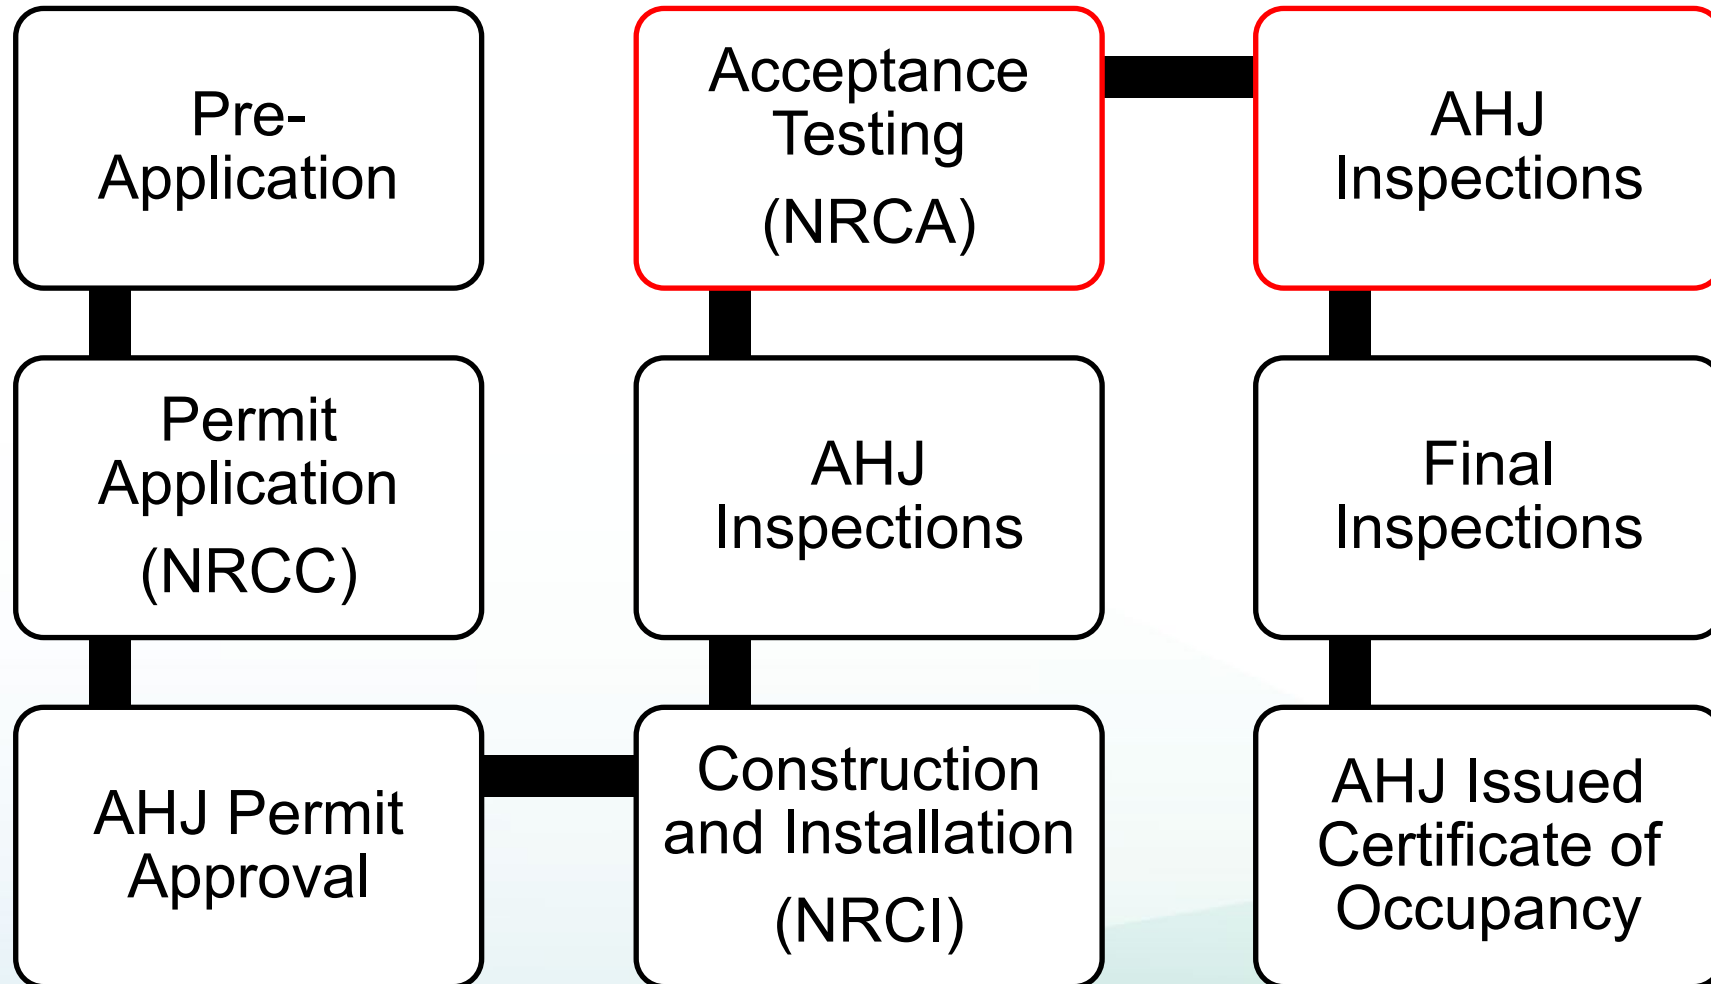





# Enforcing Acceptance Testing

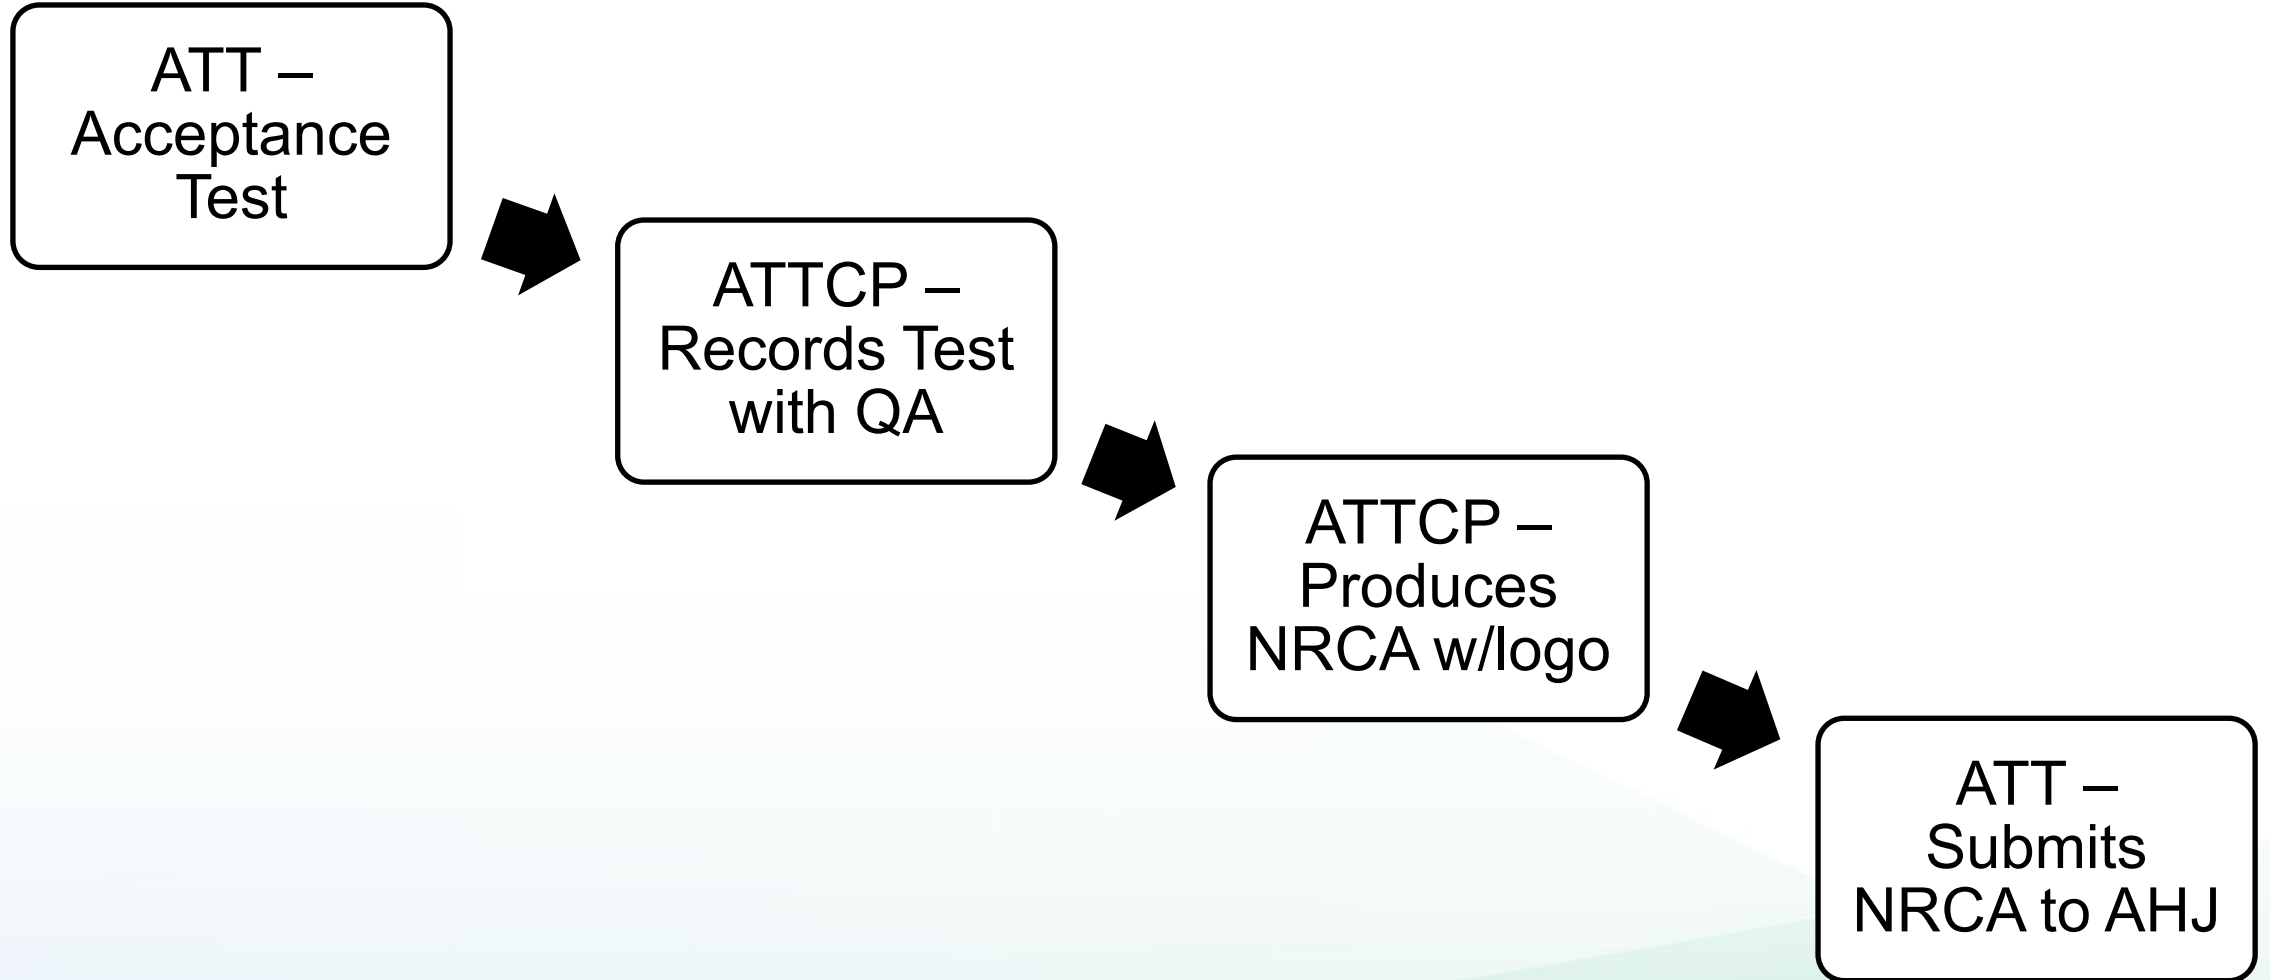



# ATT Certification Enforcement Dates

---

- Lighting Control: July 2014
- Mechanical Systems: October 1, 2021



# Acceptance Testing and the ATTCP



# Acceptance Testing

---

- Final stage of equipment installation
- Construction inspection and functional testing
- Goal: design compliance, functional design, code compliance
- Performed and documented by installing technician
- Submitted to AHJ



# ATTCP Program Background

---

- Established in the 2013 Energy Code
- Improve compliance for lighting controls and mechanical systems
- Private organizations approved by CEC
- Train, certify, provide oversight for ATTs / ATEs
- Tracking system for compliance forms



# ATTCP Responsibilities

---

- Train and certify ATTs and ATEs
- Quality Assurance Program
- Complaints Process
- Generate NRCA Compliance Documents



# Lighting Controls ATTCPs

---

Approved by CEC

- National Lighting Contractors Association of America (NLCAA)
- California Advanced Lighting Controls Training Program (CALCTP)



# Mechanical Systems ATTCPs

---

Approved by CEC

- California State Pipe Trades Council (CSPTC)
- National Energy Management Institute Committee (NEMIC)
- National Environmental Balancing Bureau (NEBB)
- Refrigeration Service Engineers Society (RSES)





# Builders and Contractors





# Triggers for Acceptance Testing

New installation, addition, alteration  
Newly constructed building or tenant improvement

Energy Code Ace - Resc X  
https://www.energycodeace.com/content/resources-ace/file\_type=trigger-sheet

EnergyCodeAce  
Helping you play your cards right

Get Forms Tools Ace Training

Trigger Sheet: Nonresidential New HVAC: Simple and Complex Systems 2019

Trigger Sheet: Residential HVAC Alterations 2019

Trigger Sheet: Nonresidential Exterior Lighting 2019

Trigger Sheet: Commercial Refrigeration 2019

Trigger Sheet: Nonresidential Interior Lighting Alterations 2019

Trigger Sheet: Nonresidential New HVAC: Simple and Complex Systems 2016

Trigger Sheet: Nonresidential Lighting 2019

https://www.energycodeace.com/download/36241/file\_path/fieldList/TriggerSheet.NR-NewHVAC.SimpleComplexSystems.2019

2019 ENERGY CODE  
Ace Resources Triggers  
Title 24, Part 6  
Nonresidential  
New HVAC: Simple and Complex Systems

### HVAC Simple Systems

	Mandatory Requirements							
	Zone Thermostat <sup>A</sup> §120.2(a), (b) Setback Capable <sup>B</sup>	DCV <sup>M</sup> §120.1(d)	Heat Pump Controls <sup>S</sup> §120.2(d)	Shutoff and Reset <sup>2</sup> §120.2(e)	Ventilation Dampers §120.2(f) Automatic close upon fan shutdown <sup>3</sup>	Isolation Devices <sup>4</sup> §120.2(g)	Demand Shedding <sup>5</sup> §120.2(h)	Economizer FDD <sup>6</sup> §120.2(i)
Space Conditioning Equipment <sup>A</sup>								
Package Terminal Air Conditioner <sup>B,C</sup>	YES <sup>D</sup>	YES	no	YES <sup>E</sup>	YES	no	YES	YES
Unitary Air Conditioners and Condensing Units <sup>9</sup>	YES	YES	no	YES <sup>E</sup>	YES	no	no	YES
Unitary Heat Pumps <sup>5</sup>	YES	YES	YES	YES <sup>E</sup>	YES	no	no	YES
Applied Heat Pumps <sup>5</sup>	YES	YES	YES	YES <sup>E</sup>	YES	YES	YES	YES
Forced Air Furnace	YES	YES	no	YES <sup>E</sup>	YES <sup>M</sup>	no	YES	no
Unit Heater	YES	no	no	YES <sup>E</sup>	no	no	no	no

A Central Energy Management Control System (EMCS) should be installed at building site for optimal equipment operation and coordination.

B Configurations vary between availability of central plant in design or reliance on self-contained heating and cooling.

C Special application requirements for Hotels, High-rise Residential, and Perimeter Zoning. Setback capable terminal devices should be used except where zone is not on EMCS. In that case, capability of four programmable control periods per 24 hours is required (§110.2(c)).

D Stand-alone single room window units are exempt (See §110.2(c)).

E Air or water source configuration.

I Heat pumps with supplementary electric resistance heat have control requirements.

J Must include automatic restart to maintain setback temperatures as necessary.

K Must include automatic time switch OR occupancy sensor OR 4-hour timer, 7-day programmable local control exemption.

L Assumes system has ventilation capacity at the terminal device. Damper is to reduce ventilation to zero during unoccupied periods. Exemptions for gravity dampers, combustion air paths, 24-hour operation, or local law jurisdiction.

M Reference to combustion air requirements.

N For systems serving multiple zones totaling more than 25,000 ft<sup>2</sup>.

### Acceptance Tests: HVAC Simple Systems

The measures below trigger these acceptance tests	NRCA-MCH-02-A Outdoor Air	NRCA-MCH-03-A Constant Volume, Single-zone, Unitary A/C and HP	NRCA-MCH-04-A Air Distribution Duct Leakage	NRCA-MCH-05-A Air Economizer Controls	NRCA-MCH-06-A Demand Control Ventilation	NRCA-MCH-07-A Supply Fan VFD	NRCA-MCH-08-A Valve Leakage	NRCA-MCH-11-A Automatic Demand Shed	NRCA-MCH-12-A Fault Detection and Diagnostic for DX Systems	NRCA-MCH-13-A Fault Detection and Diagnostic for AHUs	NRCA-MCH-16-A Supply Air Temp Reset	NRCA-MCH-18-A Energy Management Control System	NRCA-MCH-19-A Occupancy Sensor Control
Zone T-Stats	no	YES	no	no	no	no	no	no	no	no	no	YES	no
DCV	YES	YES	no	YES	YES	YES	no	no	no	no	no	YES	no
Heat Pump Controls	no	YES	no	no	no	no	no	no	no	no	no	no	no
Shutoff and Reset	no	YES	no	no	no	no	no	YES	no	no	no	YES	YES
Ventilation Dampers	YES	YES	YES	YES	no	YES	no	no	no	no	no	YES	no
Isolation Devices	no	YES	YES	no	no	no	YES	no	no	no	no	YES	no
Demand Shedding	no	no	no	no	no	no	no	YES	no	no	no	YES	no
Economizer and/or FDD	YES	YES	no	YES	no	YES	no	no	YES	YES	no	YES	no
Zone Control	no	YES	no	no	no	no	YES	YES	no	no	no	YES	no
Supply Temp. Reset	no	no	no	no	no	no	no	no	no	no	YES	YES	no
Variable Flow Control	no	no	no	no	no	YES	YES	no	no	no	no	YES	no
Duct Systems	YES	no	YES	no	no	no	no	no	no	no	no	no	no



# General Acceptance Testing Triggers

---

- Newly installed lighting controls
  - Indoor
  - Outdoor
- Mechanical systems
  - Newly installed
  - Replacement



# Alterations

## Indoor Lighting Controls

---

### Acceptance Testing Triggers

- Lighting system installed for first time
- 10% or more of luminaires are altered

### Exceptions

- New controls are for 20 or fewer luminaires
- Adding lighting controls only
- Only replacing lamps, ballasts, drivers
- One-for-one luminaire alteration limit 50 per year



# Alterations

## Outdoor Lighting Controls

### Acceptance Testing Triggers

- Systems listed in Table 140.7-A or 140.7-B.

### Exception

- Controls for 20 or fewer luminaires

TABLE 140.7-A GENERAL HARDSCAPE LIGHTING POWER ALLOWANCE					
Type of Power Allowance	Lighting Zone 0 <sup>3</sup>	Lighting Zone 1 <sup>3</sup>			
	Asphalt/Concrete	Asphalt/Concrete			
Area Wattage Allowance (AWA)	No allowance <sup>1</sup>	0.018 W/ft <sup>2</sup>			
Linear Wattage Allowance (LWA)		0.15 W/lf			
Initial Wattage Allowance (IWA)		180 W			
<sup>1</sup> Continuous lighting is explicitly prohibited in Lighting Zone 0. A parking area, trail head, fee payment kiosk, outhouse, or toilet facility. Luminaires installed shall meet the maximum zonal lumen limits as specified in Table 140.7-A.					
<sup>2</sup> Where greater than 50% of the paved surface of a parking lot is for parking, the paved surface shall not include any other General Hardscape areas.					
<sup>3</sup> Narrow band spectrum light sources with a dominant peak wavelength shall be used to minimize the impact on local, active professional astronomy or other sensitive uses. The power allowance multiplier shall be 1.0.					
TABLE 140.7-B ADDITIONAL LIGHTING POWER ALLOWANCE FOR SPECIFIC APPLICATIONS					
<i>All area and distance measurements in plan view unless otherwise noted.</i>					
Lighting Application	Lighting Zone 0	Lighting Zone 1	Lighting Zone 2	Lighting Zone 3	Lighting Zone 4
WATTAGE ALLOWANCE PER APPLICATION. Use all that apply as appropriate.					
<b>Building Entrances or Exits.</b> Allowance per door. Luminaires qualifying for this allowance shall be within 20 feet of the door.	Not applicable	9 watts	15 watts	19 watts	21 watts
<b>Primary Entrances to Senior Care Facilities, Police Stations, Healthcare Facilities, Fire Stations, and Emergency Vehicle Facilities.</b> Allowance per primary entrance(s) only. Primary entrances shall provide access for the general public and shall not be used exclusively for staff or service personnel. This allowance shall be in addition to the building entrance or exit allowance above. Luminaires qualifying for this allowance shall be within 100 feet of the primary entrance.	Not applicable	20 watts	40 watts	57 watts	60 watts
<b>Drive Up Windows.</b> Allowance per customer service location. Luminaires qualifying for this allowance shall be within 2 mounting heights of the sill of the window.	Not applicable	16 watts	30 watts	50 watts	75 watts
<b>Vehicle Service Station Uncovered Fuel Dispenser.</b> Allowance per	Not applicable	55 watts	77 watts	81 watts	125 watts



# Alterations Mechanical Systems - HVAC

---

## Acceptance Testing Triggers

- Any new or replacement systems or components

## Exception

- Electric resistance space heaters for apartments



# NRCCs for Lighting Controls and Mechanical Systems

STATE OF CALIFORNIA  
**Indoor Lighting**  
 NRCC-LTI-E (Created 10/20)  
 CERTIFICATE OF COMPLIANCE  
 CALIFORNIA ENERGY COMMISSION  
 NRCC-LTI-E

This document is used to demonstrate compliance with requirements in §110.9, §110.12(c), §130.0, §130.1, §140.6, and §141.0(b)2 for indoor lighting scopes using the prescriptive path.

Project Name: \_\_\_\_\_ Report Page: \_\_\_\_\_ Page 1 of 5  
 Project Address: \_\_\_\_\_ Date Prepared: \_\_\_\_\_

**A. GENERAL INFORMATION**

01 Project Location (city)	04 Total Conditioned Floor Area (ft <sup>2</sup> )
02 Climate Zone	05 Total Unconditioned Floor Area (ft <sup>2</sup> )
03 Occupancy Types Within Project (select all that apply):	06 # of Stories (Habitable Above Grade)

Office  Retail  Warehouse  Hotel/Motel  School  Support Areas  
 Parking Garage

STATE OF CALIFORNIA  
**Mechanical Systems**  
 NRCC-MCH-E (Created 09/2020)  
 CERTIFICATE OF COMPLIANCE  
 CALIFORNIA ENERGY COMMISSION  
 NRCC-MCH-E

This document is used to demonstrate compliance for mechanical systems that are within the scope of the permit application and are demonstrating compliance using the prescriptive path outlined in §140.4, or §141.0(b)2 for alterations.

Project Name: \_\_\_\_\_ Report Page: \_\_\_\_\_ Page 1 of 8  
 Project Address: \_\_\_\_\_ Date Prepared: \_\_\_\_\_

**A. GENERAL INFORMATION**

01 Project Location (city)	04 Total Conditioned Floor Area
02 Climate Zone	05 Total Unconditioned Floor Area
03 Occupancy Types Within Project:	06 # of Stories (Habitable Above Grade)

Office (B)  Retail (M)  Non-refrigerated Warehouse (S)  
 Guest Rooms (R-1)  School (E)  Healthcare Facility (I)  
 Rental (R-2/R-3)  Relocatable Class Bldg (E)  Other (Write In): \_\_\_\_\_

Climate zone can be determined on the California Energy Commission's website at [http://www.energy.ca.gov/maps/renewable/building\\_climate\\_zones.html](http://www.energy.ca.gov/maps/renewable/building_climate_zones.html)

**B. PROJECT SCOPE**  
 Table Instructions: Include all outdoor lighting systems that are within the scope of the permit application and are demonstrating compliance using the prescriptive path outlined in §140.2 or §141.0(b)2L for alterations.

My Project consists of:  
 New Lighting System  
 Altered Lighting

**C. COMPLIANCE RESULTS**  
 Table Instructions: If any cell on this table says "DOES NOT COMPLY" or "COMPLIES with Exceptional Conditions" refer to Table D. for guidance.

Lighting in conditioned and unconditioned spaces must not be combined for compliance per §140.6(b)1.

Conditioned: \_\_\_\_\_  
 Unconditioned: \_\_\_\_\_

CA Building Energy Efficiency Standards - 2019 Nonresidential Compliance: <http://www.energy.ca.gov/title24/2019standards/>

STATE OF CALIFORNIA  
**Outdoor Lighting**  
 NRCC-LTO-E (Created 11/19)  
 CERTIFICATE OF COMPLIANCE  
 CALIFORNIA ENERGY COMMISSION  
 NRCC-LTO-E

This document is used to demonstrate compliance with requirements in §110.9, §130.0, §130.2, §140.7, and §141.0(b)2L for outdoor lighting scopes using the prescriptive path.

Project Name: \_\_\_\_\_ Report Page: \_\_\_\_\_ Page 1 of 4  
 Project Address: \_\_\_\_\_ Date Prepared: \_\_\_\_\_

**A. GENERAL INFORMATION**

01 Project Location (city)	04 Total Illuminated Hardscape Area (ft <sup>2</sup> )
02 Climate Zone	
03 Outdoor Lighting Zone per Title 24, Part 1 §10-114 or as designated by Authority Having Jurisdiction (AHJ):	

LZ-0: Very Low - Undeveloped Parkland  LZ-2: Moderate - Rural Areas  LZ-4: High - Must be reviewed by CA Energy Commission for Approval  
 LZ-1: Low - Developed Parkland  LZ-3: Moderately High - Urban Areas

**B. PROJECT SCOPE**  
 Table Instructions: Include all outdoor lighting systems that are within the scope of the permit application and are demonstrating compliance using the prescriptive path outlined in §140.2 or §141.0(b)2L for alterations.

My project consists of:

01	02
<input type="checkbox"/> New Lighting System	Must Comply with Allowances from §140.7.
<input type="checkbox"/> Altered Lighting System	Is your alteration increasing the connected lighting load (Watts)? <input type="radio"/> Yes <input type="radio"/> No
03	04
% of Existing Luminaires Being Altered <sup>1</sup>	Sum Total of Luminaires Being Added or Altered
	Calculation Method

<sup>1</sup> FOOTNOTES: % of Existing Luminaires Being Altered = (Sum Total of Luminaires Being Added or Altered / Existing Luminaires within the Scope of the Permit Application) x 100

**C. COMPLIANCE RESULTS**  
 Table Instructions: If any cell on this table says "DOES NOT COMPLY" or "COMPLIES with Exceptional Conditions" refer to Table D. for guidance.

Calculation of Total Allowed Lighting Power (Watts) §140.7 or §141.0(b)2L						Compliance Results		
01	02	03	04	05	06	07	08	09
General Hardscape Allowance §140.7(d)1 (See Table I)	+ Per Application §140.7(d)2 (See Table J)	+ Sales Frontage §140.7(d)2 (See Table K)	+ Ornamental §140.7(d)2 (See Table L)	+ Per Specific Area §140.7(d)2 (See Table M)	OR Existing Power §141.0(b)2L (See Table N)	= Total Allowed (Watts)	≥ Total Actual (Watts) (See Table F)	07 Must be ≥ 08
Cutoff Compliance (See Table G for Details)						Not Applicable		
Controls Compliance (See Table H for Details)								

CA Building Energy Efficiency Standards - 2019 Nonresidential Compliance: <http://www.energy.ca.gov/title24/2019standards/> November 2019

**E. COMPLIANCE RESULTS**  
 Table Instructions: If any cell on this table says "DOES NOT COMPLY" or "COMPLIES with Exceptional Conditions" refer to Table D. for guidance.

My project consists of (check all that apply)

01	02	03
Air System(s)	Wet System Components	Dry System Components
<input type="checkbox"/> Air System(s)	<input type="checkbox"/> Water Economizer <input type="checkbox"/> Pumps	<input type="checkbox"/> Air Economizer <input type="checkbox"/> Electric Resistance Heat
<input type="checkbox"/> Mechanical Controls	<input type="checkbox"/> Hydronic System Piping	<input type="checkbox"/> Fan Systems
<input type="checkbox"/> Controls (existing to remain, altered or replaced)	<input type="checkbox"/> Cooling Towers <input type="checkbox"/> Chillers <input type="checkbox"/> Boilers	<input type="checkbox"/> Ductwork (existing to remain, altered or new) <input type="checkbox"/> Ventilation <input type="checkbox"/> Zonal Systems/ Terminal Boxes

**RESULTS**  
 If any cell on this table says "DOES NOT COMPLY" or "COMPLIES with Exceptional Conditions" refer to Table D. for guidance.

02	03	04	05	06	07	08	09
Pumps §140.4(k) (See Table G)	AND Fans/Economizers §140.4(c), §140.4(e) (See Table H)	AND System Controls §110.2, §120.2, §140.4(f) (See Table I)	AND Ventilation §120.1 (See Table J)	AND Terminal Box Controls §140.4(d) (See Table K)	AND Distribution Controls §120.3, §140.4(l) (See Table L)	AND Cooling Towers §110.2(e)2 (See Table M)	Compliance Results
Mandatory Measures Compliance (See Table Q for Details)							DOES NOT COMPLY

Efficiency Standards - 2019 Nonresidential Compliance: <http://www.energy.ca.gov/title24/2019standards/> September 2020





# NRCC - Acceptance Tests Tables

## Indoor Lighting - NRCC Acceptance Test Requirement Table

STATE OF CALIFORNIA		CALIFORNIA ENERGY COMMISSION		
Indoor Lighting		NRCC-LTI-E		
NRCC-LTI-E (Created 10/20)		Page 4 of 5		
CERTIFICATE OF COMPLIANCE		Project Name:	Report Page:	
Project Address:		Date Prepared:		
<input type="radio"/>	<input checked="" type="radio"/>	NRCI-LTI-02-E - Must be submitted for a lighting control system, or for an Energy Management Control System (EMCS), to be recognized for compliance.	<input type="checkbox"/>	
<input type="radio"/>	<input checked="" type="radio"/>	NRCI-LTI-04-E - Must be submitted for two interlocked systems serving an auditorium, a convention center, a conference room, a multipurpose room, or a theater to be recognized for compliance.	<input type="checkbox"/>	
<input type="radio"/>	<input checked="" type="radio"/>	NRCI-LTI-05-E - Must be submitted for a Power Adjustment Factor (PAF) to be recognized for compliance.	<input type="checkbox"/>	
<input type="radio"/>	<input checked="" type="radio"/>	NRCI-LTI-06-E - Must be submitted for additional wattage installed in a video conferencing studio to be recognized for compliance.	<input type="checkbox"/>	
<b>U. DECLARATION OF REQUIRED CERTIFICATES OF ACCEPTANCE</b>				
<p><i>Table Instructions: Selections have been made based on information provided in previous tables of this document. If any selection needs to be changed, please explain why in Table E. Additional Remarks. These documents must be provided to the building inspector during construction and any with "A" in the form name must be completed through an Acceptance Test Technician Certification Provider (ATTCP). For more information visit: <a href="http://www.energy.ca.gov/title24/attcp/providers.html">http://www.energy.ca.gov/title24/attcp/providers.html</a></i></p>				
YES	NO	Form/Title	Field Inspector	
			Pass	Fail
<input checked="" type="radio"/>	<input type="radio"/>	NRCA-LTI-02-A - Must be submitted for occupancy sensors and automatic time switch controls.	<input type="checkbox"/>	<input type="checkbox"/>
<input checked="" type="radio"/>	<input type="radio"/>	NRCA-LTI-03-A - Must be submitted for automatic daylight controls.	<input type="checkbox"/>	<input type="checkbox"/>
<input checked="" type="radio"/>	<input type="radio"/>	NRCA-LTI-04-A - Must be submitted for demand responsive lighting controls.	<input type="checkbox"/>	<input type="checkbox"/>
<input checked="" type="radio"/>	<input type="radio"/>	NRCA-LTI-05-A - Must be submitted for institutional tuning power adjustment factor (PAF).	<input type="checkbox"/>	<input type="checkbox"/>
<input type="radio"/>	<input checked="" type="radio"/>	NRCA-ENV-03-F - Must be submitted for daylighting design power adjustment factors (PAF).	<input type="checkbox"/>	<input type="checkbox"/>

CA Building Energy Efficiency Standards - 2019 Nonresidential Compliance: <http://www.energy.ca.gov/title24/2019standards> October 2020

## Mechanical - NRCC Acceptance Test Requirement Table

STATE OF CALIFORNIA		CALIFORNIA ENERGY COMMISSION			
Mechanical Systems		NRCC-MCH-E			
NRCC-MCH-E (Created 09/2020)		Page 4 of 8			
CERTIFICATE OF COMPLIANCE		Project Name:	Report Page:		
Project Address:		Date Prepared:			
<b>O. DECLARATION OF REQUIRED CERTIFICATES OF ACCEPTANCE</b>					
<p><i>Table Instructions: Selections have been made based on information provided in previous tables of this document. If any selection needs to be changed, please explain why in Table E. Additional Remarks. These documents must be provided to the building inspector during construction and can be found online at <a href="https://www.energy.ca.gov/title24/2019standards/2019_compliance_documents/Nonresidential_Documents/NRCA/">https://www.energy.ca.gov/title24/2019standards/2019_compliance_documents/Nonresidential_Documents/NRCA/</a></i></p>					
YES	NO	Form/Title	Systems To Be Field Verified	Field Inspector	
				Pass	Fail
<input checked="" type="radio"/>	<input type="radio"/>	NRCA-MCH-02-A Outdoor Air must be submitted for all newly installed HVAC units. Note: MCH02-A can be performed in conjunction with MCH-07-A Supply Fan VFD Acceptance (if applicable) since testing activities overlap.		<input type="checkbox"/>	<input type="checkbox"/>
<input checked="" type="radio"/>	<input type="radio"/>	NRCA-MCH-03-A Constant Volume Single Zone HVAC NOTE: This form does not automatically move to "Yes". If Constant Volume Single Zone HVAC Systems are included in the scope, permit applicant should move this form to "Yes".		<input type="checkbox"/>	<input type="checkbox"/>
<input checked="" type="radio"/>	<input type="radio"/>	NRCA-MCH-04-A Air Distribution Duct Leakage		<input type="checkbox"/>	<input type="checkbox"/>
<input type="radio"/>	<input checked="" type="radio"/>	NRCA-MCH-05-A Air Economizer Controls		<input type="checkbox"/>	<input type="checkbox"/>
<input checked="" type="radio"/>	<input type="radio"/>	NRCA-MCH-06-A Demand Control Ventilation Systems Acceptance must be submitted for all systems required to employ demand controlled ventilation (refer to §120.1(c)3) can vary outside ventilation flow rates based on maintaining interior carbon dioxide (CO2) concentration setpoints.		<input type="checkbox"/>	<input type="checkbox"/>
<input checked="" type="radio"/>	<input type="radio"/>	NRCA-MCH-07-A Supply Fan Variable Flow Controls		<input type="checkbox"/>	<input type="checkbox"/>
<input type="radio"/>	<input checked="" type="radio"/>	NRCA-MCH-08-A Valve Leakage Test		<input type="checkbox"/>	<input type="checkbox"/>
<input type="radio"/>	<input checked="" type="radio"/>	NRCA-MCH-09-A Supply Water Temperature Reset Controls		<input type="checkbox"/>	<input type="checkbox"/>
<input type="radio"/>	<input checked="" type="radio"/>	NRCA-MCH-10-A Hydronic System Variable Flow Controls		<input type="checkbox"/>	<input type="checkbox"/>
<input type="radio"/>	<input checked="" type="radio"/>	NRCA-MCH-11-A Automatic Demand Shed Controls		<input type="checkbox"/>	<input type="checkbox"/>

CA Building Energy Efficiency Standards - 2019 Nonresidential Compliance: <http://www.energy.ca.gov/title24/2019standards> September 2020





# AHJ Permit Application Approval

---

- NRCCs submitted with plan in permit application
- AHJ approves permit application including NRCC
  
- Total of 10 NRCC forms
  - 2 for lighting controls
  - 1 for mechanical systems



# Authorities Having Jurisdiction



# AHJ Site Inspection

---

**Enforcement can be simple!**

## **Required**

- Reference NRCC to verify required NRCAs
- Verify NRCA submitted has ATTCP logo

## **Recommended, if Necessary**

- Question parts of or entire test
- Take ATTCP Inspector Training
- Ask questions, inspect tools, require demonstration



# Lighting Controls ATTCP Logos



National Lighting Contractors  
Association of America



California Advanced Lighting  
Controls Training Program



# Mechanical Systems ATTCP Logos

a. NEMIC Logo (Background Watermark on NEMIC Acceptance Forms)



b. ICB/TABB Logo (Lower Right-Hand Corner on NEMIC Acceptance Forms)



Title 24 Acceptance Test Technician  
Certification Provider (ATTCP) Program





# Invalid NRCAs

STATE OF CALIFORNIA  
**SHUT-OFF LIGHTING CONTROL ACCEPTANCE DOCUMENT**  
 DEC-2015 (REVISED 01/19)

CALIFORNIA ENERGY COMMISSION

**CERTIFICATE OF ACCEPTANCE** NRCA-LTI-02-A  
 Shut-Off Lighting Control Acceptance Document (Page 1 of 3)

Project Name:	Enforcement Agency:	Permit Number:
Project Address:	City:	Site Date:

Compliance Results:  [COMPLIES] or  [DOES NOT COMPLY] Enforcement Agency Use: Checked by/Date

**Intent:** This document is used to demonstrate compliance with acceptance requirements in §130.4(a) and Reference Nonresidential Appendix NA7.6.2 for shut-off lighting controls. Attach additional sets of pages 1 through 2, as required, for all controls that must be tested.

**Indicate all types of shut-off controls tested for this project:**

Automatic time switch lighting controls (Sections A-1 and B-1 of this document should be completed)

Occupant sensing lighting controls (including occupant sensors, partial-ON occupant sensors, partial-OFF occupant sensors, and/or vacancy sensors) (Sections A-2 and B-2 of this document should be completed)

Automatic Time Switch Lighting Controls			
Building	Floor	Room	Control
<b>A-1. Automatic Time Switch Lighting Control Construction Inspection (NA7.6.2.4)</b>			
<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
<p>a. Automatic time switch controls are programmed with acceptable weekday, weekend, and holiday (if applicable) schedules. (NA7.6.2.4(a), §130.9(b)(6), §130.1(c)(6), §130.1(c)(4))</p> <p>b. Document for the owner, weekday, weekend, and holidays schedules, as well as all set-up and preference program settings. (NA7.6.2.4(b))</p> <p>c. The correct time and date are properly set in the time switch. (NA7.6.2.4(c))</p> <p>d. The battery backup (if applicable) is installed and energized. (NA7.6.2.4(d), §130.9(b)(1))</p> <p>e. Override time limit is no more than 2 hours. (NA7.6.2.4(e), §130.9(b)(2), §130.1(c)(8)) OR The automatic time switch control's override time is exempt from the 2-hour limit. (EXCEPTION to §130.1(c)(8))</p> <p>f. Override switches remote from area with controlled luminaires have annunciator lights. (NA7.6.2.4(f), §130.1(c)(5), §130.1(a)) OR The manual override switch is exempt from being in the same enclosed area with the lighting it controls. (EXCEPTION to §130.1(c)(7))</p>			
Construction Inspection Compliance: <input type="radio"/> Complies <input type="radio"/> Does Not Comply			
<b>B-1. Automatic Time Switch Lighting Control Functional Testing (NA7.6.2.5)</b>			
Confirm compliance (Y - yes / N - no) for the control being tested.			
<b>Step 1: Simulate occupied condition. (NA7.6.2.5(a))</b>			
<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
<p>a. All lights can be turned on and off by their respective area control switch. (NA7.6.2.5(a)(1))</p> <p>b. The switch only operates lighting in the enclosed space (ceiling-height partitioned area) in which the switch is located. (NA7.6.2.5(a)(2), §130.1(c)(2))</p> <p>c. For the area controlled by an automatic time switch control with a time override located in and for the area, the lighting can be turned on manually by initiating the time override. The lighting is configured to remain on for no more than 2 hours, unless the area is exempt from the 2-hour time override limit. (NA7.6.2.5(a)(3), §130.9(b)(6), §130.1(c)(8), EXCEPTION to §130.1(c)(8))</p> <p>d. For the area controlled by an automatic time switch control with an automatic holiday shut-off feature, the lighting in the area can be turned off automatically by initiating the holiday shut-off. (NA7.6.2.5(a)(4), §130.9(b)(4), §130.1(c)(4)) OR The automatic time switch control is exempt from incorporating an automatic holiday shut-off feature. (EXCEPTION to §130.1(c)(4))</p> <p>e. For the area controlled by an automatic time switch control with manual-on mode configured, the lighting in the area can be turned on manually when it is manually activated. (NA7.6.2.5(a)(5), §130.1(c)(1)) OR The automatic time switch control does not include or utilize a manual-on mode. (EXCEPTION to §130.1(c)(1))</p>			
<b>Step 2: Simulate unoccupied condition. (NA7.6.2.5(b))</b>			
<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
<p>a. All non-exempt lighting turns off in accordance with the programmed time switch schedules. (NA7.6.2.5(b)(1), §130.1(c)(4))</p> <p>b. Manual override switch allows only the lights in the enclosed space (ceiling height partitioned) where the override switch is located to turn on or remain on until the next scheduled shut off occurs. (NA7.6.2.5(b)(2), §130.1(c)(1), §130.1(c)(3))</p>			
Functional Testing Compliance: <input type="radio"/> Complies <input type="radio"/> Does Not Comply			

CA Building Energy Efficiency Standards - 2019 Nonresidential Compliance January 2019



# Complaint Process

---

- Available for AHJs and all other parties
- ATTCP complaint processes are CEC-approved
- ATTCPs report complaints to CEC annually
- Complaints can be submitted to CEC directly
- CEC will investigate to achieve resolution



# Resources

## ATTCP Training:

- [National Lighting Contractors Association of America \(NLCAA\)](#)
- [California Advanced Lighting Controls Training Program \(CALCTP\)](#)
- [California State Pipe Trades Council \(CSPTC\)](#)
- [National Energy Management Institute Committee \(NEMIC\)](#)
- [National Environmental Balancing Bureau \(NEBB\)](#)
- [Refrigeration Service Engineers Society \(RSES\)](#)

## California Energy Commission:

- [Acceptance Test Technician Certification Provider Program](#)
- [Online Resources Center](#)

Energy Code Ace: [Web-Link](#)

Staff Contact: Joe Loyer at [Joe.Loyer@energy.ca.gov](mailto:Joe.Loyer@energy.ca.gov)





# Questions & Answers





**Thank You!**

