

DOCKETED

Docket Number:	21-IEPR-06
Project Title:	Building Decarbonization and Energy Efficiency
TN #:	239966
Document Title:	Presentation - 2021 IEPR Commissioner Workshop on Grid Interactive Efficient Buildings Load Flexibility Demand Response Policies
Description:	*** THIS DOCUMENT SUPERSEDE TN 239956 *** - S2.3A Maryam Mozafari, CPUC
Filer:	Raquel Kravitz
Organization:	California Public Utilities Commission
Submitter Role:	Public Agency
Submission Date:	10/4/2021 2:44:54 PM
Docketed Date:	10/4/2021

2021 IEPR Commissioner Workshop on Grid Interactive Efficient Buildings - Load Flexibility

Demand Response Policies, Programs, and Initiatives

Maryam Mozafari

California Public Utilities Commission

October 5, 2021



California Public
Utilities Commission

Agenda

- Overview & Background
- Current Proceedings & New Initiatives

Overview:

- This presentation includes an overview of the California Public Utilities Commission's (CPUC) role in setting policies, programs and initiatives that enable demand flexibility in response to Price Signals, Grid Conditions or Other Incentives.
- This presentation only includes Demand Response (DR) policies and programs under CPUC jurisdiction and does not include DR policies and programs administered or overseen by local publicly owned utilities, other state agencies or other Non-IOU Load Serving Entities.

Demand Response (DR) vs. Energy Efficiency (EE)

- **Energy Efficiency**

Permanent One Time Change in Energy Consumption


Using less energy to deliver same or equivalent function

- **Demand Response**

Temporary and Recurring Change in Demand in Response to Price Signals, Grid Conditions or other Incentives.

Changes could lead to some or no loss of function

Evolution of DR

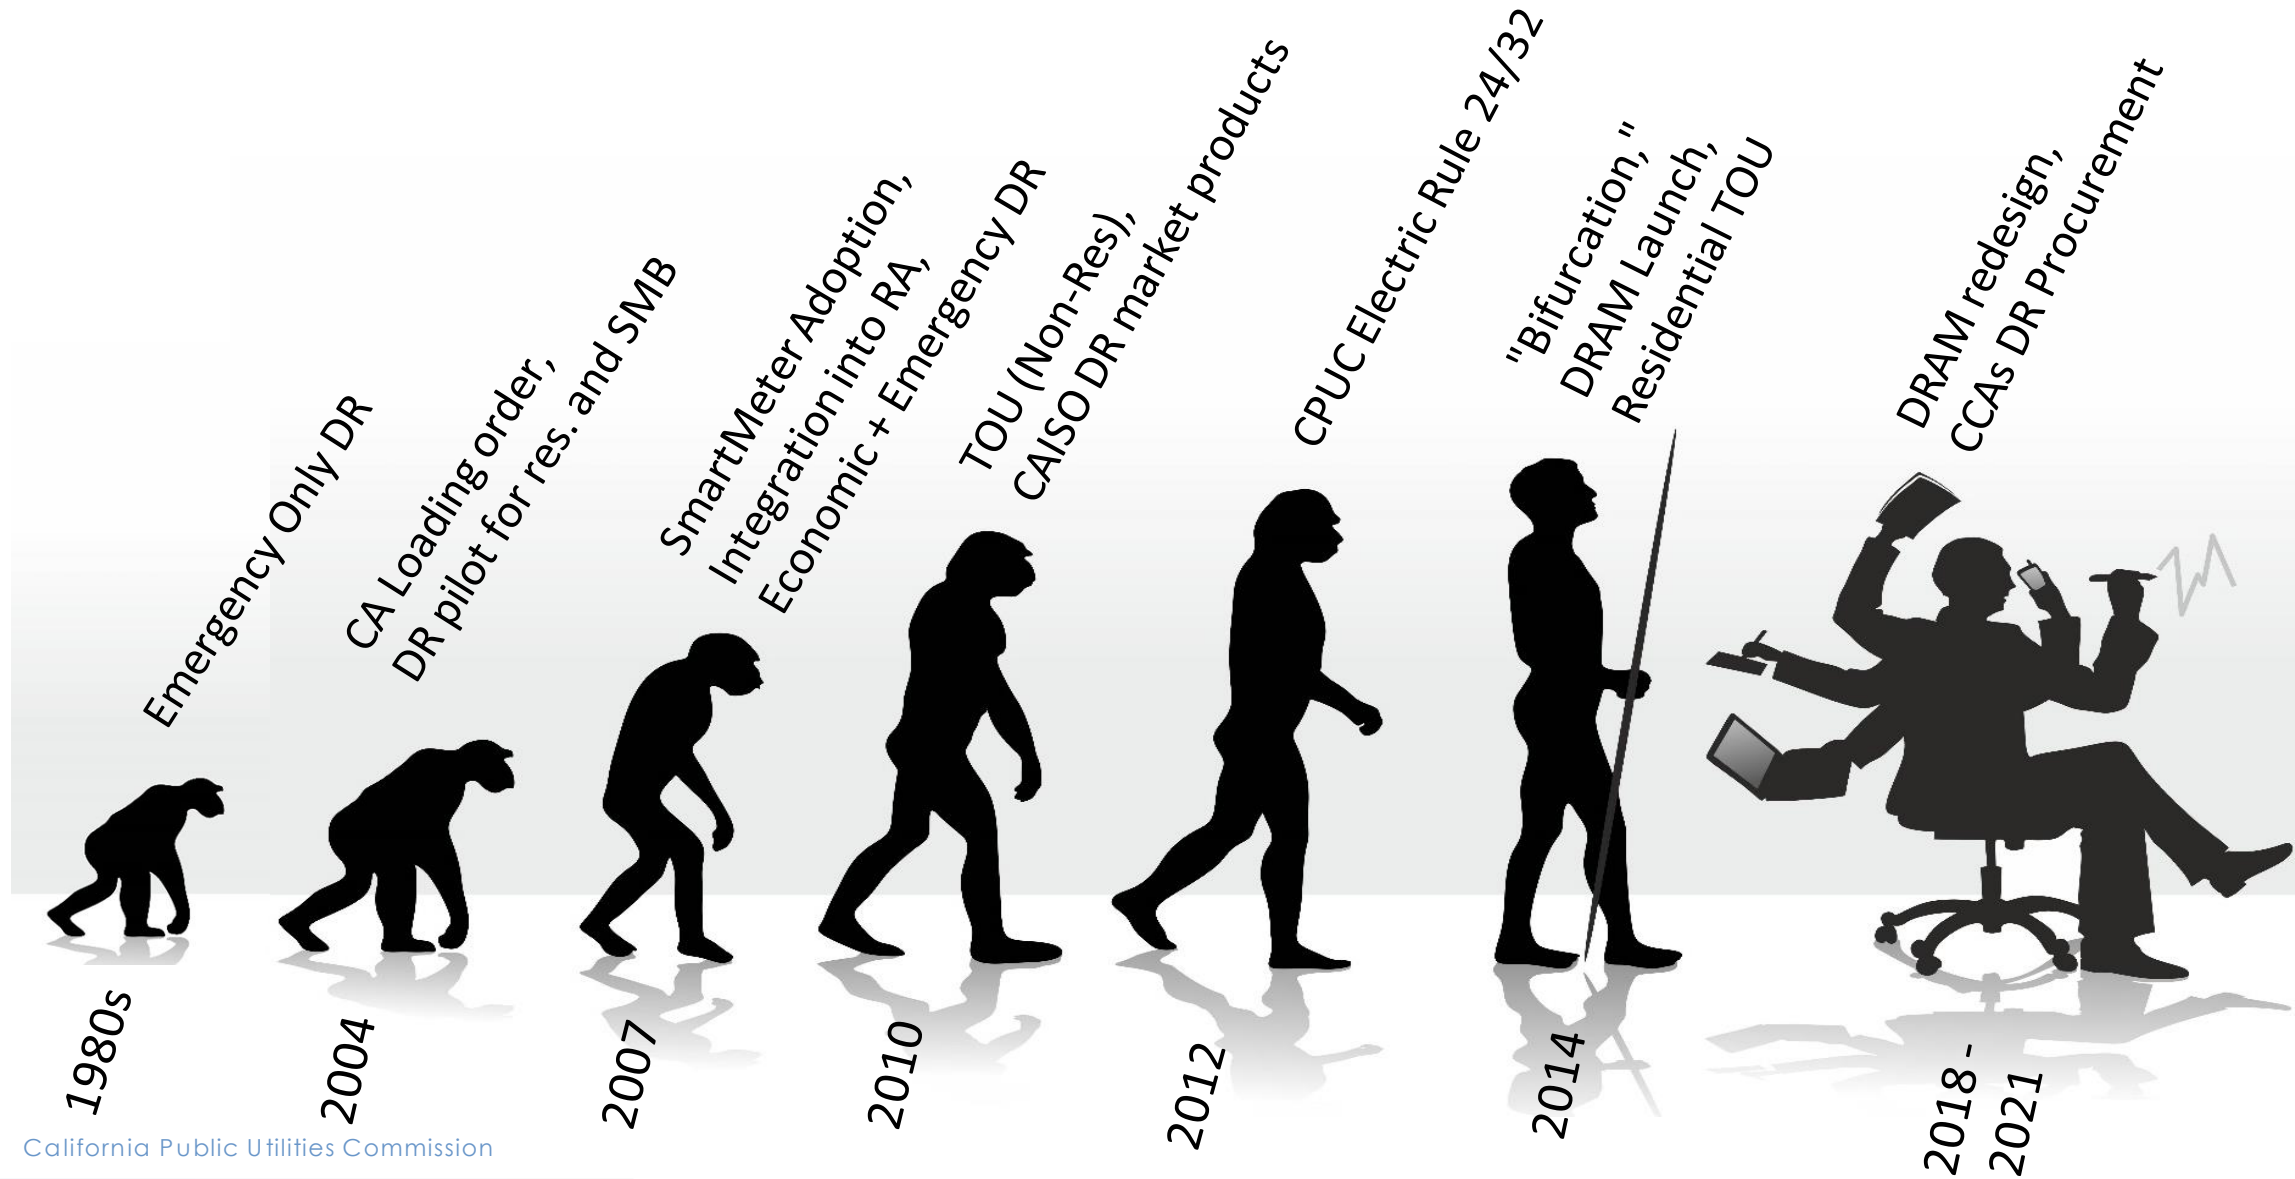

Bifurcation of DR Programs

2014 and 2015

Event Based -> Supply Side

Time Variant Rates -> Load Modifying

▪ **Supply Side DR:**

Event based dispatchable DR resources integrated into CAISO

Resource is offered to the CAISO market; gets dispatched based on grid needs

Resource is compensated for Capacity by the Load Serving Entity (LSE)

Resource is compensated for Energy by CAISO if dispatched

▪ **Load Modifying DR:**

Driven by time-variant rates

Resource is compensated via bill reduction

Current Proceedings and New Initiatives

- Demand Response Rulemaking (Closed)
- Summer Reliability Rulemaking
- Investor-Owned Utility (IOU) DR Applications (2023-2027)
- Resource Adequacy Rulemaking
- Load Flexibility Rulemaking (TBD)
- General Rate Case (GRC) Phase 2 Proceeding

Current DR Portfolio (2021)

Supply Side DR

- **IOU managed DR:**

- Emergency
 - Base Interruptible Program (BIP)
 - Agricultural Pumping program (API)
- Economic
 - Capacity Bidding Program (CBP)
 - AC Cycling
 - Local Capacity Requirement Contracts (LCR)

- **3rd Party managed DR:**

- Demand Response Auction Mechanism (DRAM)
- Community Choice Aggregator RA-DR Contracts

Load Modifying DR

- **IOU managed DR:**

- Permanent Load Shifting (PLS)
- Time of Use (TOU)
- Critical Peak Pricing (CPP)
- Real Time Pricing (RTP)

Demand Response Auction Mechanism (DRAM)


IOUs hold annual capacity auctions procuring DR from 3rd party DR providers

IOUs pay DRPs for the aggregated Capacity

Capacity is counted towards IOU's RA obligations

DR providers are required to bid their Capacity into the CAISO energy markets

CAISO compensates the DRPs for energy when resources are dispatched

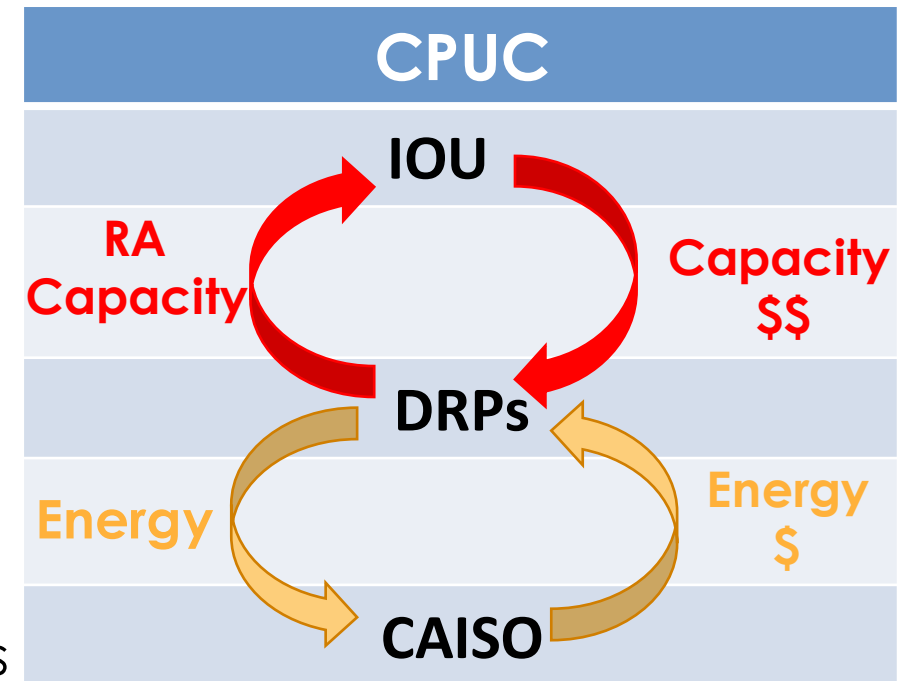

DRAM History– Capacity Procurement & Budgets

		I	II	III-A	III-B	IV	V	VI	VII
Delivery Year		<u>2016</u>	<u>2017</u>	<u>2018</u>	<u>2019</u>	<u>2019</u>	<u>2020</u>	<u>2021</u>	<u>2022</u>
Capacity (Aug) MWs	SCE	20	56	88	99	73	95	100	98
	PG&E	17	56	80	90	73	99	83	75
	SDG&E	3	12	14	16	17	22	23	28
	Total	40	124	182	205	163	216	206	201

Delivery Year		<u>2016</u>	<u>2017</u>	<u>2018</u>	<u>2019</u>	<u>2019</u>	<u>2020</u>	<u>2021</u>	<u>2022</u>
Budget (\$ Millions)	SCE	4	6	6	6	6	5.2	6	6
	PG&E	4	6	6	6	6	5.7	6	6
	SDG&E	1	1.5	1.5	1.5	1.5	1.9	2	2
	Total	\$9.0	\$13.5	\$13.5	\$13.5	\$13.5	\$12.8	\$14.0	\$14.0

Summer Reliability Rulemaking

■ Phase 1 Decision:

- Adopted changes to existing DR programs for incremental RA capacity
- Established the Emergency Load Reduction Program (ELRP):
 - A voluntary pay-for-performance program with no CAISO market obligations
 - Compensation for Incremental Load Reduction (ILR) at \$1 /kWh
 - ELRP load reduction is excluded from the RA and CEC's load forecasting framework

Virtual Power Plants (VPP)

- An aggregator managed BTM hybrid resource consisting of storage paired with Net Energy Metered (NEM) solar
- Resource cannot be part of a market integrated DR program (or enrolled in CPP/RTP¹)
- Minimum VPP Size threshold is set at 500 kW
- Resource will be compensated for the net export at the customer site

1. Critical Peak Pricing / Real Time Pricing

2023-2027 IOU DR Applications

IOU DR portfolio (budgets and programs) will be reviewed and updated

Resource Adequacy Rulemaking

QC Methodology for Demand Response

Other DR related topics (MCC¹Buckets, Slice of the day proposal, CPE² and multi-year procurement,...)

1. Maximum Cumulative Capacity
2. Central Procurement Entity

Load Flexibility Rulemaking

Distributed Energy Resources (DER) Action Plan 2.0 Update for 2021-2026

Track One: Load Flexibility and Rates

Track Two: Grid Infrastructure

Track Three: Market Integration

Track Four: DER Customer Programs

General Rate Case (GRC) Phase 2 Proceeding

Dynamic Rate Pilots



California Public Utilities Commission

Thank you!

Contact:

Maryam Mozafari, Demand Response

Maryam.Mozafari@cpuc.ca.gov