


**DOCKETED**

|                         |  |
|-------------------------|--|
| <b>Docket Number:</b>   | 01-AFC-19C                             |
| <b>Project Title:</b>   | SMUD Cosumnes Power Plant - Compliance |
| <b>TN #:</b>            | 244289-12                              |
| <b>Document Title:</b>  | Supplement C - Figure 2_2-6bR          |
| <b>Description:</b>     | N/A                                    |
| <b>Filer:</b>           | Patty Paul                             |
| <b>Organization:</b>    | Ch2mhill/Carrier                       |
| <b>Submitter Role:</b>  | Applicant Consultant                   |
| <b>Submission Date:</b> | 8/1/2022 5:57:17 PM                    |
| <b>Docketed Date:</b>   | 8/1/2022                               |

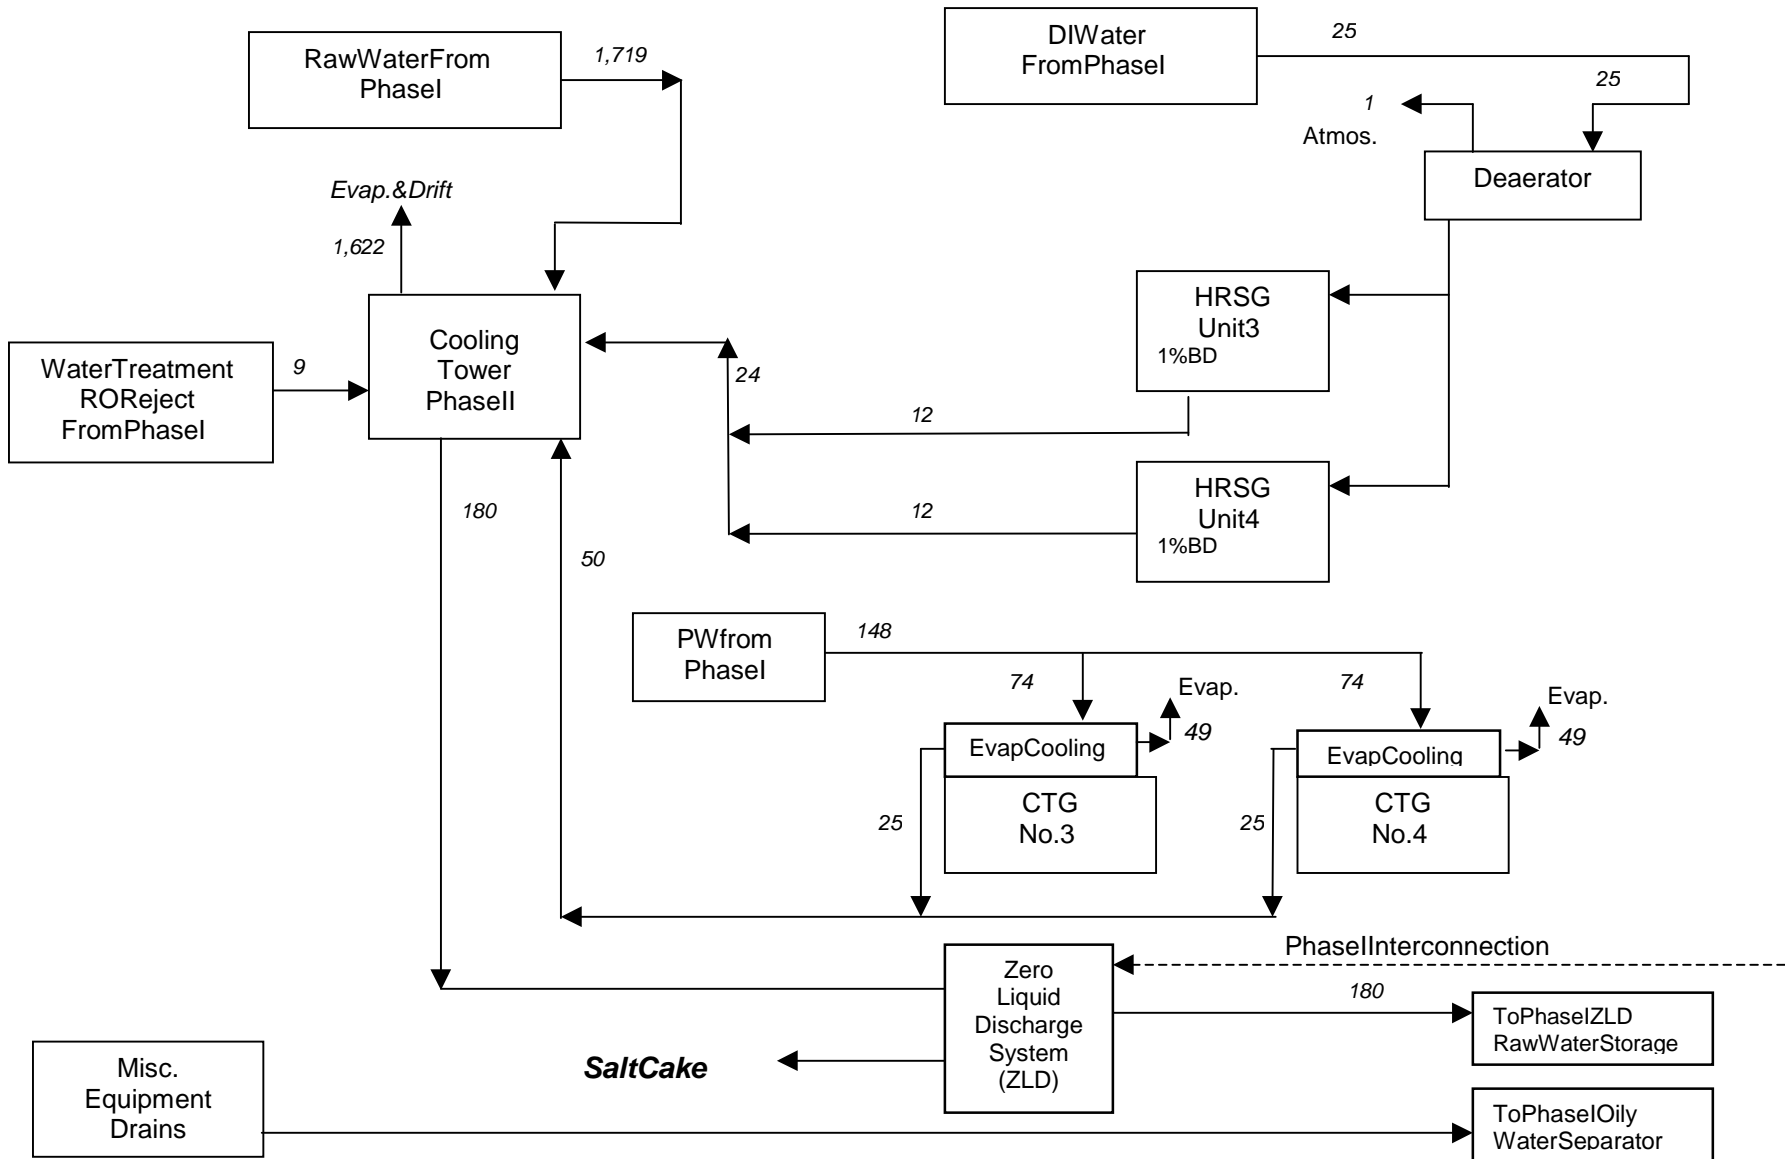

NOTES:  
 ALL FLOW RATES ARE GIVEN IN GPM.  
 FLOWS ARE BASED ON FULL LOAD OPERATION, ANNUAL AVERAGE TEMPERATURE OF 61 DEGREES F, 53 WB.  
 COOLING TOWER BLOWDOWN IS BASED ON MAINTAINING 10 CYCLES OF CONCENTRATION.  
 FLOWS ARE BASED ON FOLSOM SOUTH CANAL WATER CONSTITUENTS SPECIFIED.

**Figure 2.2-6bR**  
**Cosumnes Power Project**  
**Phase I - Annual Average**  
**WATER BALANCE DIAGRAM**  
 PBPOWER, INC.