


DOCKETED	
Docket Number:	01-AFC-19C
Project Title:	SMUD Cosumnes Power Plant - Compliance
TN #:	244289-16
Document Title:	Supplement C - Figure 8_14-3bR
Description:	N/A
Filer:	Patty Paul
Organization:	Ch2mhill/Carrier
Submitter Role:	Applicant Consultant
Submission Date:	8/1/2022 5:57:17 PM
Docketed Date:	8/1/2022

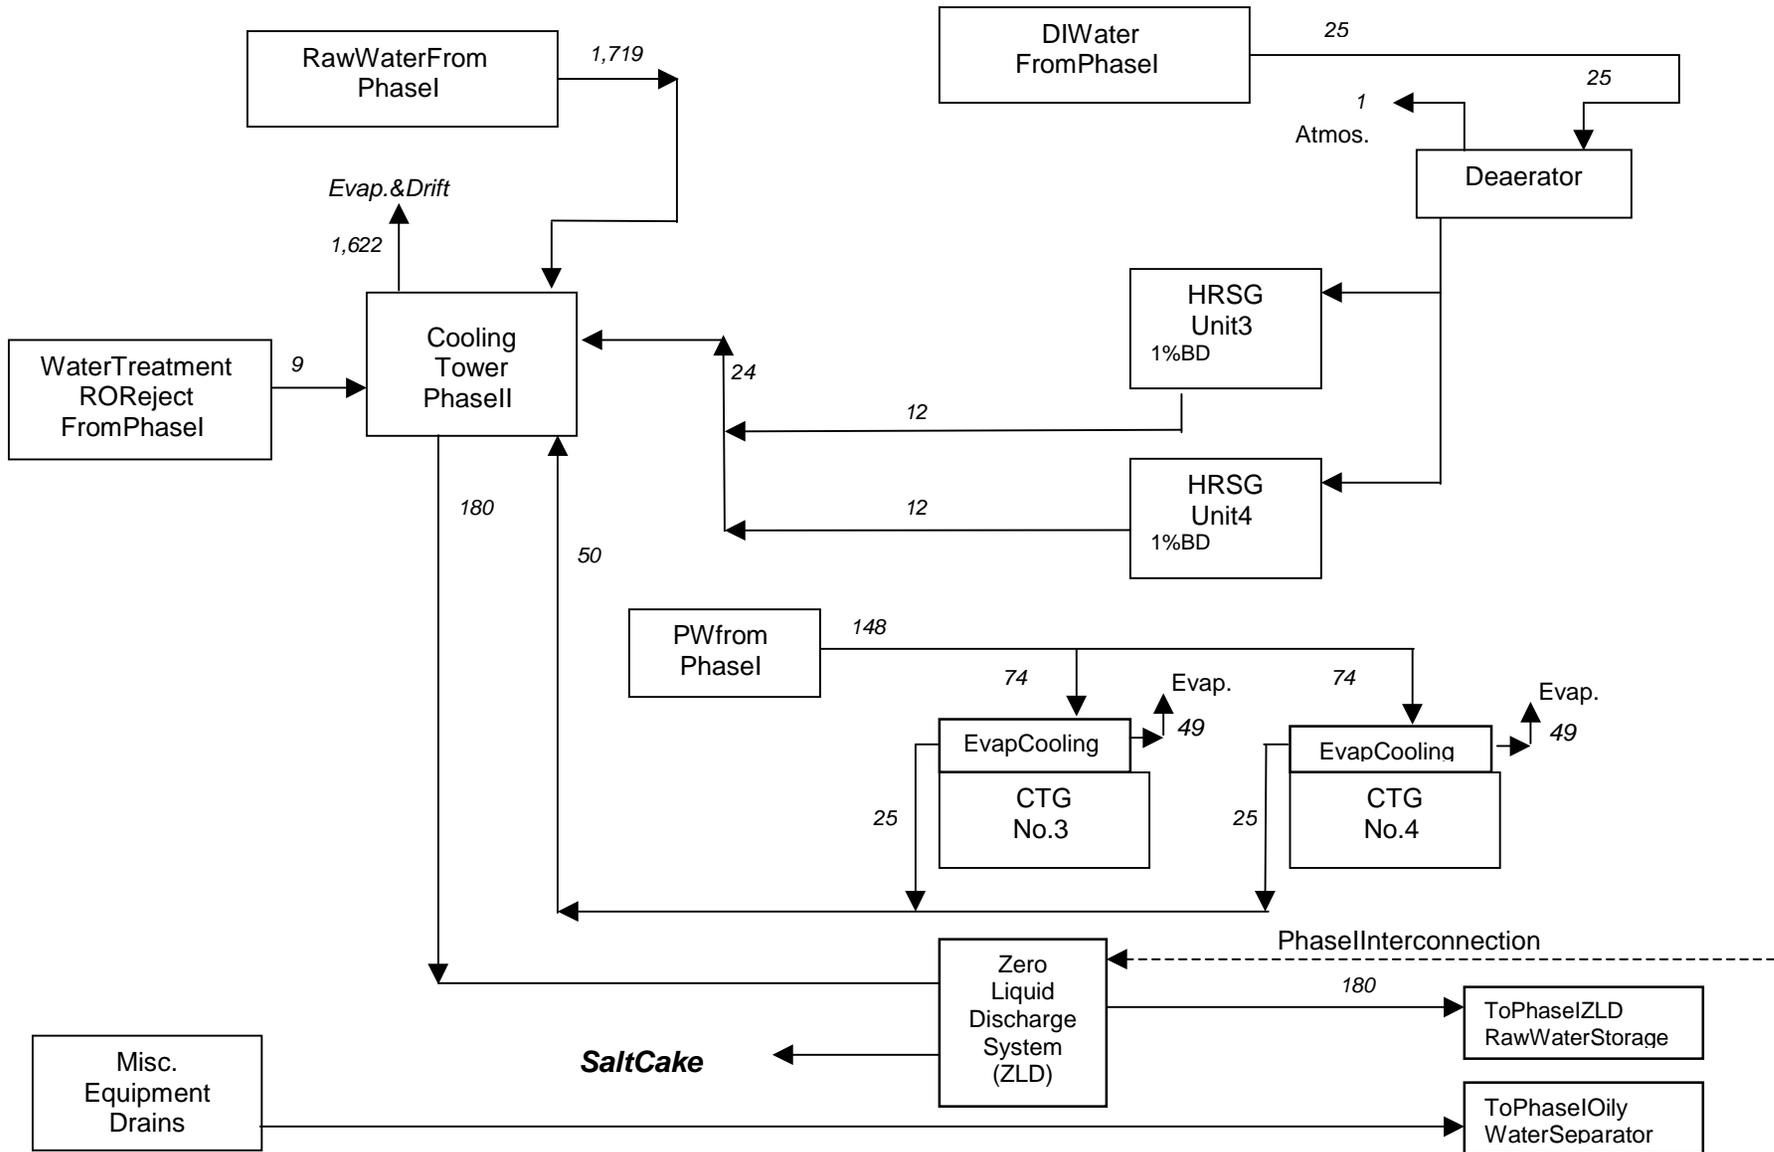

NOTES:
 ALL FLOW RATES ARE GIVEN IN GPM.
 FLOWS ARE BASED ON FULL LOAD OPERATION, ANNUAL AVERAGE TEMPERATURE OF 61 DEGREES F, 53 WB.
 COOLING TOWER BLOWDOWN IS BASED ON MAINTAINING 10 CYCLES OF CONCENTRATION.
 FLOWS ARE BASED ON FOLSOM SOUTH CANAL WATER CONSTITUENTS SPECIFIED.

Figure 8.14-3bR
Cosumnes Power Project
Phase I - Annual Average
WATER BALANCE DIAGRAM
 PBPOWER, INC.