DOCKETED	
Docket Number:	03-AFC-01C
Project Title:	Roseville Energy Park Compliance
TN #:	244898
Document Title:	Roseville Energy Park Quarterly Air Quality Report - Q2 2022
Description:	N/A
Filer:	Roseville Electric Compliance
Organization:	Roseville Electric
Submitter Role:	Public Agency
Submission Date:	8/12/2022 3:48:42 PM
Docketed Date:	8/12/2022

Roseville Electric Utility
2090 Hilltop Circle
Roseville, California 95747-9704
Reliable Energy. Dependable Service.

City of Roseville

Roseville Energy Park

(03-AFC-1)

California Energy Commission

Quarterly Operational Report

Second Quarter 2022

List of Attachments

AQ15 - SCR Installed before commissioning in 2007

AQ20 - The gas turbine engine shall be fired exclusively on pipeline quality natural gas with sulfur content no greater than 0.50 grains of sulfur compounds per 100 dry scf of natural gas

AQ21 – Startups and Shutdowns

AQ32 – All hourly, quarter NOx and CO emissions AQ-SC6

AQ33 – All hourly, daily, and quarterly SOx AQ-SC6

AQ34 – Startups and Shutdowns

AQ36 – Breakdown condition

AQ37 – Violations of Emissions

AQ40 – CEMS quality assurance test failures

AQ41 – Excess Emissions

AQ42 – Running 12-month summary

AQ47 – All nuisance violations

N/A for this report period

AQ48 – Nuisance complaints and stack emission opacity as dark as Ringlemann No. 1 (20% opacity) for periods aggregating more than 3 min.

N/A for this report period

AQ51 – Ammonia slip exceedances

AQ55 – Emission rates from each gas turbine and heat recovery steam generator exhaust during startup and shutdown – NOx and CO

AQ57 – Emission exceedance rates during startup and shutdown – CO, NOx, PM-10, SOx, and VOC

AQ59 – Emission limit exceedances – NOx, CO, VOC, PM-10, SO_2

AQ60 – Quarterly emission exceedances for Alstom GTX100 turbine – NOx, CO, VOCs, PMO, SOx

AQ63 – Total facility emission exceedances – NOx, CO, VOC, PM-10, SO_2

AQ68 – Annual water sample analysis of cooling tower water

AQ69 – Nuisance complaints

N/A for this report period

AQ70 – PM-10 quarterly emission rate exceedances from cooling tower

AQ71 – Exceedance of cooling tower PM-10 emission limit – PM-10 = cooling water recirculation rate*total dissolved solids concentration in the blow own water* design drift rate

AQ86 – Limits for operation for maintenance and testing of emergency diesel engine and generator limited to 50 hours per year

AQ87 – Operation for maintenance and testing purposes shall be limited to involuntary interruptions of electrical power. Operation shall not exceed 24 hours

AQ88 – Sulfur content of diesel fuel used shall not exceed 15 ppm by weight

N/A for this report period

AQ89 – Records of hours of operation engine run for maintenance and testing, during interruption of electrical power, records of sulfur content of diesel used for five years

AQ90 – No emissions are permitted, from any source, which are a nuisance per PCAPCD Rule 205, Nuisance

N/A for this report period

AQ91 – Stack emission opacity as dark as Ringelmann No. 1 (20% opacity) for periods aggregating more than 3 minutes in any one hour is prohibited and is in violation of PCAPCD Rule 202, Visible Emissions

N/A for this report period

AQ99 – Operation for maintenance and testing of the emergency diesel engine and generator shall be limited to 50 hours per year.

AQ100 – Emergency diesel Generator; Operation for other than maintenance and testing purposes shall be limited to involuntary interruptions of electrical power

AQ101 - The sulfur content of the diesel used shall not exceed 15ppm by weight

N/A for this report period

AQ102 – Records of operation and maintenance shall be kept by the owner or operator for a period of five years

AQ103 – No emissions are permitted, from any source, which are a nuisance

N/A for this report period

AQ104 – Stack emission opacity as dark as Ringelmann No. 1 (20% opacity) for periods aggregating more than 3 minutes in any one hour is prohibited

N/A for this report period

ATTACHMENT 1

AQ-15

AQ-15 The Project owner shall install a selective catalytic reduction (SCR) system and an oxidation catalyst on the gas turbine. The SCR and oxidation catalyst equipment shall be operated whenever the gas turbine is operated.

Verification: The Project owner shall submit to the CPM a written statement by a California registered Professional Engineer stating that said engineer has reviewed the as built deigns or inspected the identified equipment and certifies that it is operational and air tight. The Project owner shall include the operational status of the SCR and oxidation catalyst during all hours of operation as part of the Quarterly Air Quality Report required by the Condition of Certification AQ-SC6

This document is on file from the 2007 4Q QAQR.

ATTACHMENT 2

AQ-20

AQ-20 The gas turbine engine shall be fired exclusively on pipeline quality natural gas with sulfur content no greater than 0.50 grains of sulfur compounds per 100 dry scf of natural gas.

Verification: The Project owner shall submit to the CPM the most recent fuel testing analysis performed as part of the Quarterly Air Quality Report required by the Condition of Certification AQ-SC6

https://www.pge.com/pipeline/operations/sulfur/sulfur_info_values/index.page

Gas System Sulfur Survey Results

Date	Total Sulfur Maximum		Total Sulfur Average all sites	
	PPMv	gr/100 scf	PPMv	gr/100 scf
2022				
First Quarter	4.8	0.28	1.1	0.07
2021				
Fourth Quarter	4.4	0.26	3.2	0.19
Third Quarter	6.7	0.40	3.1	0.18
Second Quarter	4.9	0.29	3.4	0.20
First Quarter	4.2	0.26	3.5	0.22

AQ20 ROSEVILLE ENERGY PARK

2Q22

Fuel Quality Analysis BTU values

http://www.pge.com/pi

	APR	MAY	JUN
1	1039.01	1053.91	1040.15
2	1039.01	1057.10	1041.80
3	1039.01	1058.48	1041.07
4	1039.01	1056.70	1040.54
5	1039.01	1056.01	1038.99
6	1038.45	1057.91	1041.03
7	1037.67	1060.60	1038.38
8	1037.91	1053.58	1038.05
9	1038.21	1051.02	1039.79
10	1038.81	1049.35	1041.73
11	1037.94	1051.29	1041.48
12	1037.90	1053.18	1044.55
13	1037.42	1,051.15	1045.25
14	1036.29	1050.17	1044.75
15	1036.67	1042.58	1043.20
16	1037.40	1044.43	1040.68
17	1037.26	1045.15	1040.57
18	1040.04	1046.38	1036.88
19	1039.62	1045.84	1044.08
20	1039.69	1050.31	1042.05
21	1042.09	1054.81	1040.74
22	1044.49	1055.84	1041.86
23	1036.75	1055.08	1041.64
24	1029.01	1054.88	1040.66
25	1038.15	1047.46	1040.48
26	1044.24	1044.55	1040.23
27	1049.03	1039.42	1038.86
28	1052.78	1036.74	1042.10
29	1053.53	1035.02	1042.11
30	1053.74	1036.36	1039.19
31	N/A	N/A	N/A

ɔeline/operations/gas_quality/p01_2_weeks.shtml

ATTACHMENT 3

AQ-21

AQ-21 Startup is defined as the period beginning with the turbine light-off until the unit meets the lb/hr and ppmv emission limits in Conditions of Certification AQ-52, -54 and -55. Shutdown is defined as the period beginning with initiation of turbine shutdown sequence and ending with cessation of firing of the gas turbine engine. Startup and shutdown durations shall not exceed 3.0 hours and one hour, respectively, per occurrence.

Verification: The Project owner shall identify and submit to the CPM as part of the Quarterly Air Quality Report all startups and shutdowns for all units including the maximum hourly emission rate, total emissions and duration.

Monthly Summary By Day Report

Units CT1 and CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/07/2022 20:28 **Location:** Roseville, CA

Red = Invalid Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Limit Value:

	Units CT1 & CT2 CO, Lb 1 Hour(s)	Units CT1 & CT2 NOx, Lb 1 Hour(s)	Units CT1 & CT2 SO2, Lb 1 Hour(s)	Units CT1 & CT2 PM10, Lb 1 Hour(s)	Units CT1 & CT2 VOC, Lb 1 Hour(s)
04/01/2022	0.00	0.00	0.00	0.00	0.00
04/02/2022	0.00	0.00	0.00	0.00	0.00
04/03/2022	0.00	0.00	0.00	0.00	0.00
04/04/2022	0.00	0.00	0.00	0.00	0.00
04/05/2022	0.00	0.00	0.00	0.00	0.00
04/06/2022	0.00	0.00	0.00	0.00	0.00
04/07/2022	0.00	0.00	0.00	0.00	0.00
04/08/2022	0.00	0.00	0.00	0.00	0.00
04/09/2022	0.00	0.00	0.00	0.00	0.00
04/10/2022	0.00	0.00	0.00	0.00	0.00
04/11/2022	0.00	0.00	0.00	0.00	0.00
04/12/2022	0.00	0.00	0.00	0.00	0.00
04/13/2022	0.00	0.00	0.00	0.00	0.00
04/14/2022	0.00	0.00	0.00	0.00	0.00
04/15/2022	0.00	0.00	0.00	0.00	0.00
04/16/2022	0.00	0.00	0.00	0.00	0.00
04/17/2022	0.00	0.00	0.00	0.00	0.00
04/18/2022	0.00	0.00	0.00	0.00	0.00
04/19/2022	0.00	0.00	0.00	0.00	0.00
04/20/2022	0.00	0.00	0.00	0.00	0.00
04/21/2022	0.00	0.00	0.00	0.00	0.00
04/22/2022	0.00	0.00	0.00	0.00	0.00
04/23/2022	0.00	0.00	0.00	0.00	0.00
04/24/2022	0.00	0.00	0.00	0.00	0.00
04/25/2022	0.00	0.00	0.00	0.00	0.00
04/26/2022	262.54	37.61	2.20	4.44	7.40
04/27/2022	80.04	42.60	2.73	5.46	9.11
04/28/2022	433.35	48.04	1.82	3.67	6.09
04/29/2022	79.88	18.11	2.13	4.24	7.10
04/30/2022	0.00	0.00	0.00	0.00	0.00
Monthly Avg/Sum*:	855.81 *	146.36 *	8.88 *	17.81 *	29.70 *
Daily Min:	79.88	18.11	1.82	3.67	6.09
Daily Max:	433.35	48.04	2.73	5.46	9.11
Apr 2022 - Apr 2022	855.81	146.36	8.88	17.81	29.70
QTD:	855.81 *	146.36 *	8.88 *	17.81 *	29.70 *
YTD 2022:	4,901.62 *	5,903.34 *	609.85 *	1,220.45 *	2,034.49 *

Monthly Summary By Day Report

Units CT1 and CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/07/2022 20:28 **Location:** Roseville, CA

Red = Invalid Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Limit Value:

	Units CT1 & CT2 CO, Lb 1 Hour(s)	Units CT1 & CT2 NOx, Lb 1 Hour(s)	Units CT1 & CT2 SO2, Lb 1 Hour(s)	Units CT1 & CT2 PM10, Lb 1 Hour(s)	Units CT1 & CT2 VOC, Lb 1 Hour(s)
05/01/2022	52.77	40.13	3.31	6.59	11.01
05/02/2022	10.05	42.75	4.62	9.28	15.43
05/03/2022	90.10	21.95	0.64	1.29	2.14
05/04/2022	31.54	103.16	11.32	22.64	37.79
05/05/2022	29.70	89.84	10.06	20.15	33.53
05/06/2022	49.56	111.47	12.17	24.38	40.70
05/07/2022	48.59	86.19	8.41	16.75	27.98
05/08/2022	75.95	72.52	7.47	14.97	24.97
05/09/2022	41.13	57.60	6.11	12.23	20.36
05/10/2022	0.00	0.00	0.00	0.00	0.00
05/11/2022	0.00	0.00	0.00	0.00	0.00
05/12/2022	0.00	0.00	0.00	0.00	0.00
05/13/2022	0.00	0.00	0.00	0.00	0.00
05/14/2022	0.00	0.00	0.00	0.00	0.00
05/15/2022	0.00	0.00	0.00	0.00	0.00
05/16/2022	0.00	0.00	0.00	0.00	0.00
05/17/2022	101.23	54.71	4.07	8.14	13.53
05/18/2022	34.03	134.56	14.78	29.54	49.21
05/19/2022	117.78	87.91	9.04	18.14	30.19
05/20/2022	0.00	0.00	0.00	0.00	0.00
05/21/2022	0.00	0.00	0.00	0.00	0.00
05/22/2022	0.00	0.00	0.00	0.00	0.00
05/23/2022	0.00	0.00	0.00	0.00	0.00
05/24/2022	112.73	120.89	10.86	21.71	36.22
05/25/2022	28.34	131.48	14.17	28.39	47.29
05/26/2022	64.56	29.36	2.16	4.31	7.19
05/27/2022	0.00	0.00	0.00	0.00	0.00
05/28/2022	0.00	0.00	0.00	0.00	0.00
05/29/2022	0.00	0.00	0.00	0.00	0.00
05/30/2022	0.00	0.00	0.00	0.00	0.00
05/31/2022	0.00	0.00	0.00	0.00	0.00
Monthly Avg/Sum*:	888.06 *	1,184.52 *	119.19 *	238.51 *	397.54 *
Daily Min:	10.05	21.95	0.64	1.29	2.14
Daily Max:	117.78	134.56	14.78	29.54	49.21
Apr 2022 - May 2022	1,743.87	1,330.88	128.07	256.32	427.24
QTD:	1,743.87 *	1,330.88 *	128.07 *	256.32 *	427.24 *
YTD 2022:	5,789.68 *	7,087.86 *	729.04 *	1,458.96 *	2,432.03 *

Monthly Summary By Day Report

Units CT1 and CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/07/2022 20:28 **Location:** Roseville, CA

Red = Invalid Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Limit Value:

	Units CT1 & CT2 CO, Lb 1 Hour(s)	Units CT1 & CT2 NOx, Lb 1 Hour(s)	Units CT1 & CT2 SO2, Lb 1 Hour(s)	Units CT1 & CT2 PM10, Lb 1 Hour(s)	Units CT1 & CT2 VOC, Lb 1 Hour(s)
06/01/2022	0.00	0.00	0.00	0.00	0.00
06/02/2022	0.00	0.00	0.00	0.00	0.00
06/03/2022	0.00	0.00	0.00	0.00	0.00
06/04/2022	0.00	0.00	0.00	0.00	0.00
06/05/2022	0.00	0.00	0.00	0.00	0.00
06/06/2022	21.75	20.16	1.18	2.37	3.94
06/07/2022	21.08	0.22	1.91	3.81	6.36
06/08/2022	104.69	97.26	8.63	17.27	28.80
06/09/2022	103.92	107.30	10.99	21.99	36.68
06/10/2022	56.87	142.56	15.27	30.57	50.98
06/11/2022	52.50	123.61	12.90	25.77	42.96
06/12/2022	72.06	103.37	10.25	20.49	34.15
06/13/2022	77.17	63.42	5.64	11.29	18.84
06/14/2022	53.63	69.57	6.57	13.13	21.91
06/15/2022	47.74	123.31	13.33	26.63	44.42
06/16/2022	53.84	119.68	13.02	25.95	43.22
06/17/2022	48.67	77.86	8.41	16.84	28.05
06/18/2022	10.65	43.83	4.72	9.45	15.84
06/19/2022	11.96	42.94	4.67	9.37	15.63
06/20/2022	80.89	90.14	8.25	16.49	27.58
06/21/2022	56.60	73.67	6.38	12.74	21.27
06/22/2022	35.35	101.12	10.46	21.00	35.08
06/23/2022	71.52	100.25	9.40	18.72	31.26
06/24/2022	38.94	124.71	13.61	27.21	45.35
06/25/2022	47.48	105.25	10.82	21.69	36.14
06/26/2022	73.45	90.00	8.34	16.64	27.78
06/27/2022	67.61	91.51	8.22	16.43	27.38
06/28/2022	47.37	72.96	6.44	12.85	21.44
06/29/2022	58.13	108.51	10.00	19.97	33.37
06/30/2022	119.87	94.92	9.08	18.18	30.30
Monthly Avg/Sum*:	1,433.74 *	2,188.13 *	218.49 *	436.85 *	728.73 *
Daily Min:	10.65	0.22	1.18	2.37	3.94
Daily Max:	119.87	142.56	15.27	30.57	50.98
Apr 2022 - Jun 2022	3,177.61	3,519.01	346.56	693.17	1,155.97
QTD:	3,177.61 *	3,519.01 *	346.56 *	693.17 *	1,155.97 *
YTD 2022:	7,223.42 *	9,275.99 *	947.53 *	1,895.81 *	3,160.76 *

Monthly Summary By Day Report

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 07/07/2022 20:27 **Location:** Roseville, CA

Red = Invalid Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Limit Value:

	Unit CT1 CO_SUSD, LbPerHr 1 Hour(s)	Unit CT1 NOx_SUSD, LbPerHr 1 Hour(s)	Unit CT2 CO_SUSD, LbPerHr 1 Hour(s)	Unit CT2 NOx_SUSD, LbPerHr 1 Hour(s)
04/01/2022	0.1	0.0	0.0	0.0
04/02/2022	0.0	0.0	0.0	0.0
04/03/2022	0.0	0.0	0.0	0.0
04/04/2022	0.0	0.0	0.0	0.0
04/05/2022	0.0	0.0	0.0	0.0
04/06/2022	0.0	0.0	0.0	0.0
04/07/2022	0.0	0.0	0.0	0.0
04/08/2022	0.0	0.0	0.0	0.0
04/09/2022	0.0	0.0	0.0	0.0
04/10/2022	0.0	0.0	0.0	0.0
04/11/2022	0.0	0.0	0.0	0.0
04/12/2022	0.0	0.0	0.0	0.0
04/13/2022	0.0	0.0	0.0	0.0
04/14/2022	0.0	0.0	0.0	0.0
04/15/2022	0.0	0.0	0.0	0.0
04/16/2022	0.0	0.0	0.0	0.0
04/17/2022	0.0	0.0	0.0	0.0
04/18/2022	0.0	0.0	0.0	0.0
04/19/2022	0.0	0.0	0.0	0.0
04/20/2022	0.0	0.0	0.0	0.0
04/21/2022	0.0	0.0	0.0	0.0
04/22/2022	0.0	0.0	0.0	0.0
04/23/2022	0.0	0.0	0.0	0.0
04/24/2022	0.0	0.0	0.0	0.0
04/25/2022	0.0	0.0	0.0	0.0
04/26/2022	0.0	0.0	248.1	19.6
04/27/2022	0.0	0.0	66.0	21.6
04/28/2022	263.2	11.6	155.7	22.1
04/29/2022	11.5	1.9	0.0	0.0
04/30/2022	0.0	0.0	0.0	0.0
Monthly Avg/Sum*:	274.7 *	13.5 *	469.8 *	63.3 *
Daily Min:	11.5	1.9	66.0	19.6
Daily Max:	263.2	11.6	248.1	22.1
Apr 2022 - Apr 2022	274.7	13.5	469.8	63.3
QTD:	274.8 *	13.5 *	469.8 *	63.3 *
YTD 2022:	1,146.5 *	157.7 *	1,225.4 *	188.9 *

Monthly Summary By Day Report

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 07/07/2022 20:27 **Location:** Roseville, CA

Red = Invalid Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Limit Value:

	Unit CT1 CO_SUSD, LbPerHr 1 Hour(s)	Unit CT1 NOx_SUSD, LbPerHr 1 Hour(s)	Unit CT2 CO_SUSD, LbPerHr 1 Hour(s)	Unit CT2 NOx_SUSD, LbPerHr 1 Hour(s)
05/01/2022	46.9	11.2	0.0	0.0
05/02/2022	0.0	0.0	0.0	0.0
05/03/2022	53.3	11.7	26.5	5.1
05/04/2022	0.0	0.0	0.6	4.2
05/05/2022	0.0	0.0	0.0	0.0
05/06/2022	0.0	0.0	0.0	0.0
05/07/2022	0.0	0.0	20.4	12.3
05/08/2022	57.3	7.5	0.0	0.0
05/09/2022	15.7	0.7	13.1	1.2
05/10/2022	0.0	0.0	0.0	0.0
05/11/2022	0.0	0.0	0.0	0.0
05/12/2022	0.0	0.0	0.0	0.0
05/13/2022	0.0	0.0	0.0	0.0
05/14/2022	0.0	0.0	0.0	0.0
05/15/2022	0.0	0.0	0.0	0.0
05/16/2022	0.0	0.0	0.0	0.0
05/17/2022	36.4	8.8	43.8	9.9
05/18/2022	0.0	0.0	0.0	0.0
05/19/2022	66.7	10.7	12.3	1.3
05/20/2022	0.0	0.0	0.0	0.0
05/21/2022	0.0	0.0	0.0	0.0
05/22/2022	0.0	0.0	0.0	0.0
05/23/2022	0.0	0.0	0.0	0.0
05/24/2022	66.3	11.4	27.0	12.7
05/25/2022	16.3	1.0	8.2	0.8
05/26/2022	51.5	11.8	9.3	1.1
05/27/2022	0.0	0.0	0.0	0.0
05/28/2022	0.0	0.0	0.0	0.0
05/29/2022	0.0	0.0	0.0	0.0
05/30/2022	0.0	0.0	0.0	0.0
05/31/2022	0.0	0.0	0.0	0.0
Monthly Avg/Sum*:	410.4 *	74.8 *	161.2 *	48.6 *
Daily Min:	0.0	0.0	0.0	0.0
Daily Max:	66.7	11.8	43.8	12.7
Apr 2022 - May 2022	685.1	88.3	631.0	111.9
QTD:	685.2 *	88.3 *	631.0 *	111.9 *
YTD 2022:	1,556.9 *	232.5 *	1,386.6 *	237.5 *

Monthly Summary By Day Report

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 07/07/2022 20:27 **Location:** Roseville, CA

Red = Invalid Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Limit Value:

	Unit CT1 CO_SUSD, LbPerHr 1 Hour(s)	Unit CT1 NOx_SUSD, LbPerHr 1 Hour(s)	Unit CT2 CO_SUSD, LbPerHr 1 Hour(s)	Unit CT2 NOx_SUSD, LbPerHr 1 Hour(s)
06/01/2022	0.0	0.0	0.0	0.0
06/02/2022	0.0	0.0	0.0	0.0
06/03/2022	0.0	0.0	0.0	0.0
06/04/2022	0.0	0.0	0.0	0.0
06/05/2022	0.0	0.0	0.0	0.0
06/06/2022	20.4	8.5	0.0	0.0
06/07/2022	0.0	0.0	11.9	0.3
06/08/2022	48.9	11.8	23.9	6.9
06/09/2022	0.0	0.0	47.0	7.4
06/10/2022	0.0	0.0	12.0	2.2
06/11/2022	0.0	0.0	29.5	7.7
06/12/2022	0.0	0.0	28.9	10.4
06/13/2022	0.0	0.0	53.8	13.0
06/14/2022	0.0	0.0	32.5	13.1
06/15/2022	0.0	0.0	0.0	0.0
06/16/2022	0.0	0.0	0.0	0.0
06/17/2022	22.2	0.9	0.0	0.0
06/18/2022	0.0	0.0	0.0	0.0
06/19/2022	0.0	0.0	0.0	0.0
06/20/2022	47.6	11.2	11.5	0.8
06/21/2022	0.0	0.0	30.7	11.9
06/22/2022	0.0	0.0	0.0	0.0
06/23/2022	0.0	0.0	35.2	10.5
06/24/2022	0.0	0.0	0.0	0.0
06/25/2022	14.9	1.1	0.0	0.0
06/26/2022	36.9	10.5	9.5	0.9
06/27/2022	0.0	0.0	35.9	12.3
06/28/2022	0.0	0.0	21.0	12.0
06/29/2022	0.0	0.0	22.6	12.1
06/30/2022	0.0	0.0	64.2	14.2
Monthly Avg/Sum*:	190.9 *	44.0 *	470.1 *	135.7 *
Daily Min:	0.0	0.0	0.0	0.0
Daily Max:	48.9	11.8	64.2	14.2
Apr 2022 - Jun 2022	876.0	132.3	1,101.1	247.6
QTD:	876.1 *	132.3 *	1,101.1 *	247.6 *
YTD 2022:	1,747.8 *	276.5 *	1,856.7 *	373.2 *

Startup / Shutdown Events

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 07/07/2022 20:22 **Location:** Roseville, CA

Unit Offline

Tag Name: CT1_UnitOn_TF_1H

Offline Periods		
Start Time	**End Time**	**Duration in Hour(s)**
04/01/2022 00:00	04/28/2022 16:00	665
04/28/2022 19:00	04/29/2022 06:00	12
04/29/2022 17:00	05/01/2022 03:00	35
05/03/2022 02:00	05/03/2022 21:00	20
05/08/2022 07:00	05/08/2022 16:00	10
05/09/2022 12:00	05/17/2022 14:00	195
05/19/2022 01:00	05/19/2022 11:00	11
05/19/2022 23:00	05/24/2022 07:00	105
05/26/2022 00:00	05/26/2022 10:00	11
05/26/2022 21:00	06/06/2022 12:00	256
06/06/2022 19:00	06/08/2022 02:00	32
06/17/2022 14:00	06/20/2022 13:00	72
06/25/2022 22:00	06/26/2022 09:00	12

Startup / Shutdown Events

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 07/07/2022 20:22 **Location:** Roseville, CA

Operating Time Summary	
Available Data for Report (excludes missing data):	2,184.00 Hour(s)
Total Offline:	1,436.00 Hour(s)
Offline Percentage:	65.75 %
Total Online:	748.00 Hour(s)
Online Percentage:	34.25 %

Startup / Shutdown Events

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 07/07/2022 20:22 **Location:** Roseville, CA

Startup/Shutdown

Number	Start Time	End Time	Event Type	Duration
1	04/28/2022 17:43	04/28/2022 18:12	Cold Startup	30
2	04/28/2022 18:12	04/28/2022 18:12	Shutdown	1
3	04/29/2022 07:44	04/29/2022 09:11	Cold Startup	88
4	04/29/2022 16:15	04/29/2022 16:30	Shutdown	16
5	05/01/2022 04:38	05/01/2022 05:33	Cold Startup	56
6	05/03/2022 00:57	05/03/2022 01:14	Shutdown	18
7	05/03/2022 22:39	05/03/2022 23:22	Cold Startup	44
8	05/08/2022 05:59	05/08/2022 06:06	Shutdown	8
9	05/08/2022 17:18	05/08/2022 18:10	Cold Startup	53
10	05/09/2022 10:56	05/09/2022 11:03	Shutdown	8
11	05/17/2022 15:23	05/17/2022 16:08	Cold Startup	46
12	05/19/2022 00:14	05/19/2022 00:21	Shutdown	8
13	05/19/2022 12:25	05/19/2022 13:15	Cold Startup	51
14	05/19/2022 22:41	05/19/2022 22:48	Shutdown	8
15	05/24/2022 08:10	05/24/2022 09:06	Cold Startup	57
16	05/25/2022 22:53	05/25/2022 23:00	Shutdown	8
17	05/26/2022 11:39	05/26/2022 12:29	Cold Startup	51
18	05/26/2022 20:12	05/26/2022 20:27	Shutdown	16
19	06/06/2022 13:39	06/06/2022 14:15	Cold Startup	37
20	06/06/2022 17:58	06/06/2022 18:13	Shutdown	16
21	06/08/2022 03:44	06/08/2022 04:34	Cold Startup	51
22	06/17/2022 13:16	06/17/2022 13:23	Shutdown	8

Startup / Shutdown Events

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 07/07/2022 20:22 **Location:** Roseville, CA

Number	Start Time	End Time	Event Type	Duration
23	06/20/2022 14:15	06/20/2022 15:18	Cold Startup	64
24	06/25/2022 21:50	06/25/2022 21:57	Shutdown	8
25	06/26/2022 10:05	06/26/2022 11:04	Cold Startup	60

Startup / Shutdown Events

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 07/07/2022 20:22 **Location:** Roseville, CA

Startup/Shutdown Event Summary

	# Events	Duration	Duration %
Cold Startup	13	688	1.56
Warm Startup	0		0.00
Shutdown	12	123	0.28
Total Process Events:	25	811	1.84

Total Report Time:	2,183.98 Hour(s)
Total Operating Time:	734.07 Hour(s)
Total Startup Time:	688 Minute(s)
Total Shutdown Time:	123 Minute(s)
Total Startup/Shutdown Time:	811 Minute(s)
Total Startup/Shutdown Time as a Percentage of Total Operating Time:	1.84 %

Startup / Shutdown Events

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 07/07/2022 20:24 **Location:** Roseville, CA

Unit Offline

Tag Name: CT2_UnitOn_TF_1H

Offline Periods		
Start Time	**End Time**	**Duration in Hour(s)**
04/01/2022 00:00	04/26/2022 12:00	613
04/26/2022 23:00	04/27/2022 07:00	9
04/27/2022 20:00	04/28/2022 07:00	12
04/28/2022 18:00	05/03/2022 22:00	125
05/06/2022 23:00	05/07/2022 11:00	13
05/10/2022 00:00	05/17/2022 16:00	185
05/20/2022 00:00	05/24/2022 02:00	99
05/26/2022 00:00	05/26/2022 13:00	14
05/26/2022 15:00	06/07/2022 10:00	284
06/07/2022 21:00	06/08/2022 13:00	17
06/09/2022 03:00	06/09/2022 09:00	7
06/12/2022 03:00	06/12/2022 11:00	9
06/13/2022 01:00	06/13/2022 17:00	17
06/13/2022 22:00	06/14/2022 17:00	20
06/21/2022 00:00	06/21/2022 18:00	19
06/23/2022 03:00	06/23/2022 14:00	12
06/26/2022 23:00	06/27/2022 12:00	14
06/27/2022 23:00	06/28/2022 14:00	16
06/28/2022 22:00	06/29/2022 11:00	14
06/30/2022 01:00	06/30/2022 13:00	13

Startup / Shutdown Events

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 07/07/2022 20:24 **Location:** Roseville, CA

Operating Time Summary	
Available Data for Report (excludes missing data):	2,184.00 Hour(s)
Total Offline:	1,512.00 Hour(s)
Offline Percentage:	69.23 %
Total Online:	672.00 Hour(s)
Online Percentage:	30.77 %

Startup / Shutdown Events

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 07/07/2022 20:24 **Location:** Roseville, CA

Startup/Shutdown

Number	Start Time	End Time	Event Type	Duration
1	04/26/2022 13:39	04/26/2022 14:45	Cold Startup	67
2	04/26/2022 22:06	04/26/2022 22:15	Shutdown	10
3	04/27/2022 08:44	04/27/2022 10:25	Cold Startup	102
4	04/27/2022 18:54	04/27/2022 19:05	Shutdown	12
5	04/28/2022 08:39	04/28/2022 09:44	Cold Startup	66
6	04/28/2022 16:59	04/28/2022 17:06	Shutdown	8
7	05/03/2022 23:46	05/04/2022 00:33	Cold Startup	48
8	05/06/2022 22:40	05/06/2022 22:40	Shutdown	1
9	05/07/2022 12:43	05/07/2022 13:41	Cold Startup	59
10	05/08/2022 05:58	05/08/2022 05:58	Shutdown	1
11	05/09/2022 22:54	05/09/2022 23:04	Shutdown	11
12	05/17/2022 17:21	05/17/2022 18:07	Cold Startup	47
13	05/19/2022 22:58	05/19/2022 23:10	Shutdown	13
14	05/24/2022 03:40	05/24/2022 04:38	Cold Startup	59
15	05/25/2022 23:13	05/25/2022 23:22	Shutdown	10
16	05/26/2022 14:39	05/26/2022 14:47	Cold Startup	9
17	05/26/2022 14:47	05/26/2022 14:47	Shutdown	1
18	06/07/2022 11:40	06/07/2022 13:43	Cold Startup	124
19	06/07/2022 19:57	06/07/2022 20:06	Shutdown	10
20	06/08/2022 14:14	06/08/2022 14:43	Cold Startup	30
21	06/09/2022 02:50	06/09/2022 02:57	Shutdown	8
22	06/09/2022 10:39	06/09/2022 11:22	Cold Startup	44

Startup / Shutdown Events

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 07/07/2022 20:24 **Location:** Roseville, CA

Number	Start Time	End Time	Event Type	Duration
23	06/10/2022 22:55	06/10/2022 23:10	Shutdown	16
24	06/11/2022 00:44	06/11/2022 01:24	Warm Startup	41
25	06/12/2022 01:55	06/12/2022 02:02	Shutdown	8
26	06/12/2022 12:23	06/12/2022 13:03	Cold Startup	41
27	06/12/2022 23:55	06/13/2022 00:01	Shutdown	7
28	06/13/2022 18:11	06/13/2022 19:04	Cold Startup	54
29	06/13/2022 21:40	06/13/2022 21:47	Shutdown	8
30	06/14/2022 18:01	06/14/2022 18:57	Cold Startup	57
31	06/20/2022 22:53	06/20/2022 23:00	Shutdown	8
32	06/21/2022 19:24	06/21/2022 20:26	Cold Startup	63
33	06/23/2022 02:07	06/23/2022 02:14	Shutdown	8
34	06/23/2022 15:59	06/23/2022 16:46	Cold Startup	48
35	06/26/2022 22:10	06/26/2022 22:17	Shutdown	8
36	06/27/2022 13:05	06/27/2022 13:54	Cold Startup	50
37	06/27/2022 22:40	06/27/2022 22:47	Shutdown	8
38	06/28/2022 15:49	06/28/2022 16:41	Cold Startup	53
39	06/28/2022 21:23	06/28/2022 21:30	Shutdown	8
40	06/29/2022 12:00	06/29/2022 12:58	Cold Startup	59
41	06/30/2022 00:45	06/30/2022 00:52	Shutdown	8
42	06/30/2022 14:03	06/30/2022 14:54	Cold Startup	52
43	06/30/2022 23:23	06/30/2022 23:30	Shutdown	8

Startup / Shutdown Events

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 07/07/2022 20:24 **Location:** Roseville, CA

Startup/Shutdown Event Summary

	# Events	Duration	Duration %
Cold Startup	20	1132	2.91
Warm Startup	1	41	0.11
Shutdown	22	180	0.46
Total Process Events:	43	1353	3.48

Total Report Time:	2,183.98 Hour(s)
Total Operating Time:	648.63 Hour(s)
Total Startup Time:	1,173 Minute(s)
Total Shutdown Time:	180 Minute(s)
Total Startup/Shutdown Time:	1,353 Minute(s)
Total Startup/Shutdown Time as a Percentage of Total Operating Time:	3.48 %

CT1 SUSD EVENT 1

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/28/22 17:38	38662			0			-0.1			0			0			0		
04/28/22 17:39	38585			0			-0.1			0			0			0		
04/28/22 17:40	38585			0			-0.1			0			0			0		
04/28/22 17:41	38585			0			-0.1			0			0			0		
04/28/22 17:42	43899.1			0			-0.1			0			0			0		
04/28/22 17:43	46440.6			0.1			-0.1			0			0			1		
04/28/22 17:44	48366			0.1			-0.1			0			0			1		
04/28/22 17:45	56606.7			38.4			5.9			5.05			1.28			1		
04/28/22 17:46	65155.5			1176.4			8.17			178.01			2.03			1		
04/28/22 17:47	74705.5			749.6			14.23			130.05			4.06			1		
04/28/22 17:48	95114.7			430.1			22.05			95.02			8.02			1		
04/28/22 17:49	135471.1			266.9			25.85			84			13.39			1		
04/28/22 17:50	143942.9			175.1			44.84			58.56			24.68			1		
04/28/22 17:51	139938			605.3			49.56			196.89			26.53			1		
04/28/22 17:52	138089.6			2146.6			42.52			688.56			22.45			1		
04/28/22 17:53	137011.4			2224.3			44.46			708.02			23.29			1		
04/28/22 17:54	136318.3			2225.1			45.3			704.8			23.62			1		
04/28/22 17:55	135548.1			2225.1			50.36			700.81			26.1			1		
04/28/22 17:56	135009			2307.6			59.87			723.67			30.9			1		
04/28/22 17:57	134623.9			2307.6			67.09			721.6			34.53			1		
04/28/22 17:58	134315.9			2306			67.96			719.58			34.9			1		
04/28/22 17:59	134007.8			2305.4			67.3			717.82			34.49			1		
04/28/22 18:00	133776.8			2305.4			65.34			716.79			33.43			1		
04/28/22 18:01	133468.7			2305.4			63.15			714.73			32.22			1		
04/28/22 18:02	132852.5			2305.4			61.4			711.63			31.19			1		
04/28/22 18:03	132929.6			2305.4			60.31			712.15			30.66			1		
04/28/22 18:04	132621.5			2305.4			59.22			710.6			30.04			1		
04/28/22 18:05	132544.5			2305.4			58.34			710.08			29.58			1		
04/28/22 18:06	132236.4			2305.6			57.47			708.6			29.07			1		
04/28/22 18:07	132313.4			2396.3			58.77			736.48			29.73			1		
04/28/22 18:08	132005.4			2396.3			57.64			734.87			29.09			1		
04/28/22 18:09	131543.3			2396.3			56.73			732.19			28.53			1		
04/28/22 18:10	132236.4			2396.3			55.6			736.48			28.12			1		
04/28/22 18:11	132005.4			2394.3			54.69			734.25			27.6			1		

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/28/22 18:12	68390.2			2394			53.78			380.49			14.07			1		
04/28/22 18:13	41357.6			0			59.39			323.18			9.39			0		
04/28/22 18:14	41203.5			0			2.2			0			0			0		
04/28/22 18:15	41126.5			0			2.4			0			0			0		
04/28/22 18:16	40972.5			0			2.4			0			0			0		
04/28/22 18:17	40818.5			0			2.2			0			0			0		

CT1 SUSD EVENT 2

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/28/22 18:07	132313.4			2396.3			58.77			736.48			29.73			1		
04/28/22 18:08	132005.4			2396.3			57.64			734.87			29.09			1		
04/28/22 18:09	131543.3			2396.3			56.73			732.19			28.53			1		
04/28/22 18:10	132236.4			2396.3			55.6			736.48			28.12			1		
04/28/22 18:11	132005.4			2394.3			54.69			734.25			27.6			1		
04/28/22 18:12	68390.2			2394			53.78			380.49			14.07			1		
04/28/22 18:13	41357.6			0			59.39			323.18			9.39			0		
04/28/22 18:14	41203.5			0			2.2			0			0			0		
04/28/22 18:15	41126.5			0			2.4			0			0			0		
04/28/22 18:16	40972.5			0			2.4			0			0			0		
04/28/22 18:17	40818.5			0			2.2			0			0			0		

CT1 SUSD EVENT 3

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/29/22 7:39	24183			0	X		-0.1	X		0	X		0	X		0		
04/29/22 7:40	24260			0	X		-0.1	X		0	X		0	X		0		
04/29/22 7:41	24414.1			0	X		-0.1	X		0	X		0	X		0		
04/29/22 7:42	24876.2			0	X		-0.1	X		0	X		0	X		0		
04/29/22 7:43	34118.1			0	X		-0.1	X		0	X		0	X		0		
04/29/22 7:44	33887			0.2	X		-0.1	X		0	X		0	X		1		
04/29/22 7:45	38276.9			0.2	X		-0.1	X		0	X		0	X		1		
04/29/22 7:46	46825.7			88.5	X		44.25	X		9.63	X		7.92	X		1		
04/29/22 7:47	56837.8			1293	X		16.34	X		170.77	X		3.55	X		1		
04/29/22 7:48	67851.1			931.1	X		22.13	X		146.73	X		5.74	X		1		
04/29/22 7:49	85025.6			540	X		26.39	X		106.74	X		8.59	X		1		
04/29/22 7:50	126768.3			398	X		29.21	X		117.23	X		14.16	X		1		
04/29/22 7:51	144867			261.6	X		46.46	X		88.06	X		25.74	X		1		
04/29/22 7:52	146869.5			519	X		56.44	X		177.17	X		31.71	X		1		
04/29/22 7:53	153877.9			2054.4	X		53.49	X		734.4	X		31.47	X		1		
04/29/22 7:54	165661.4			1988.9	X		58.24	X		765.75	X		36.9	X		1		
04/29/22 7:55	168588			1813.9	X		60.04	X		710.56	X		38.71	X		1		
04/29/22 7:56	168511			1712.6	X		58.34	X		670.51	X		37.59	X		1		
04/29/22 7:57	167971.8			1524.4	X		55.81	X		595.12	X		35.86	X		1		
04/29/22 7:58	167124.7			1353.2	X		52.62	X		525.54	X		33.63	X		1		
04/29/22 7:59	166739.6			1376	X		48.68	X		533.17	X		31.04	X		1		
04/29/22 8:00	166662.6			1405.8	X		47.36	X		544.42	X		30.19	X		1		
04/29/22 8:01	165969.4			1442.4	X		41.96	X		556.31	X		26.63	X		1		
04/29/22 8:02	165430.3			1465.5	X		40.48	X		563.25	X		25.61	X		1		
04/29/22 8:03	165045.2			1486	X		37.04	X		569.8	X		23.37	X		1		
04/29/22 8:04	164891.2			1503.5	X		35.4	X		576.18	X		22.33	X		1		
04/29/22 8:05	164660.2			1522.2	X		34.74	X		582.32	X		21.87	X		1		
04/29/22 8:06	164968.2			1534	X		33.76	X		587.87	X		21.29	X		1		
04/29/22 8:07	164198			1542.2	X		32.94	X		588.25	X		20.68	X		1		
04/29/22 8:08	164660.2			1550.6	X		32.61	X		593.17	X		20.53	X		1		
04/29/22 8:09	164275.1			1558.1	X		32.45	X		594.66	X		20.38	X		1		
04/29/22 8:10	163890			1557.1	X		32.78	X		592.89	X		20.54	X		1		
04/29/22 8:11	163581.9			1549.7	X		33.11	X		589.04	X		20.71	X		1		
04/29/22 8:12	163581.9			1548.1	X		33.76	X		588.42	X		21.12	X		1		

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/29/22 8:13	163273.9			1548.6	X		34.42	X		587.56	X		21.49	X		1		
04/29/22 8:14	162888.8			1590	X		36.24	X		601.84	X		22.58	X		1		
04/29/22 8:15	162965.8			1588.1	X		37.09	X		601.49	X		23.12	X		1		
04/29/22 8:16	162503.7			1594.2	X		37.93	X		602.01	X		23.57	X		1		
04/29/22 8:17	163042.8			1593.7	X		38.94	X		603.6	X		24.27	X		1		
04/29/22 8:18	171976.7			1580.5	X		39.95	X		631.52	X		26.27	X		1		
04/29/22 8:19	193310.1			1199.3	X		43.59	X		538.81	X		32.23	X		1		
04/29/22 8:20	215413.7			276.7	X		45.58	X		138.5	X		37.54	X		1		
04/29/22 8:21	236054			30.4	X		45.02	X		16.67	X		40.63	X		1		
04/29/22 8:22	261700.3			4.3	X		43.73	X		2.6	X		43.75	X		1		
04/29/22 8:23	272174.4			3	X		29.5	X		1.87	X		30.7	X		1		
04/29/22 8:24	273406.7			2.5	X		13.44	X		1.6	X		14.06	X		1		
04/29/22 8:25	273714.8			2.2	X		12.55	X		1.43	X		13.13	X		1		
04/29/22 8:26	274793			2.1	X		12.55	X		1.32	X		13.19	X		1		
04/29/22 8:27	286422.4			1.9	X		12.46	X		1.25	X		13.64	X		1		
04/29/22 8:28	288116.8			1.8	X		11.89	X		1.17	X		13.1	X		1		
04/29/22 8:29	288424.8			1.7	X		10.26	X		1.16	X		11.31	X		1		
04/29/22 8:30	288578.8			1.8	X		10.14	X		1.17	X		11.19	X		1		
04/29/22 8:31	287808.7			1.7	X		9.96	X		1.11	X		10.96	X		1		
04/29/22 8:32	288039.8			1.6	X		9.86	X		1.05	X		10.87	X		1		
04/29/22 8:33	288347.8			1.5	X		9.77	X		0.99	X		10.77	X		1		
04/29/22 8:34	287885.7			1.4	X		9.68	X		0.92	X		10.66	X		1		
04/29/22 8:35	288424.8			1.3	X		9.68	X		0.86	X		10.68	X		1		
04/29/22 8:36	288116.8			1.2	X		9.59	X		0.8	X		10.56	X		1		
04/29/22 8:37	287885.7			1.1	X		9.68	X		0.74	X		10.66	X		1		
04/29/22 8:38	287731.7			1	X		9.68	X		0.68	X		10.65	X		1		
04/29/22 8:39	287885.7			0.9	X		9.83	X		0.63	X		10.82	X		1		
04/29/22 8:40	287962.7			0.9	X		8.05	X		0.63	X		8.87	X		1		
04/29/22 8:41	287885.7			0.8	X		6.56	X		0.56	X		7.22	X		1		
04/29/22 8:42	287500.6			0.8	X		5.81	X		0.56	X		6.38	X		1		
04/29/22 8:43	287808.7			0.8	X		5.34	X		0.56	X		5.87	X		1		
04/29/22 8:44	288039.8			0.7	X		4.96	X		0.5	X		5.47	X		1		
04/29/22 8:45	295587.3			0.7	X		4.87	X		0.51	X		5.5	X		1		
04/29/22 8:46	306677.6			0.7	X		4.4	X		0.53	X		5.16	X		1		
04/29/22 8:47	307832.8			0.7	X		3.78	X		0.53	X		4.45	X		1		
04/29/22 8:48	308217.9			0.7	X		3.63	X		0.52	X		4.28	X		1		
04/29/22 8:49	308371.9			0.8	X		3.54	X		0.59	X		4.17	X		1		

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/29/22 8:50	308294.9			0.8	X		3.45	X		0.59	X		4.07	X		1		
04/29/22 8:51	308680			0.8	X		3.45	X		0.59	X		4.07	X		1		
04/29/22 8:52	308294.9			0.8	X		3.36	X		0.59	X		3.96	X		1		
04/29/22 8:53	308063.9			0.7	X		3.36	X		0.52	X		3.96	X		1		
04/29/22 8:54	307909.8			0.7	X		3.27	X		0.52	X		3.85	X		1		
04/29/22 8:55	307447.8			0.7	X		3.18	X		0.52	X		3.73	X		1		
04/29/22 8:56	307601.8			0.7	X		3.09	X		0.52	X		3.63	X		1		
04/29/22 8:57	307216.7			0.7	X		3.09	X		0.52	X		3.63	X		1		
04/29/22 8:58	307293.7			0.7	X		3	X		0.52	X		3.52	X		1		
04/29/22 8:59	307755.8			0.7	X		3	X		0.52	X		3.53	X		1		
04/29/22 9:00	307447.8			0.7	X		3.09	X		0.52	X		3.63	X		1		
04/29/22 9:01	307216.7			0.7	X		3.09	X		0.52	X		3.63	X		1		
04/29/22 9:02	311298.6			0.7	X		3	X		0.53	X		3.57	X		1		
04/29/22 9:03	331091.7			0.7	X		2.9	X		0.56	X		3.68	X		1		
04/29/22 9:04	338947.3			0.7	X		2.81	X		0.57	X		3.65	X		1		
04/29/22 9:05	341026.7			0.7	X		2.27	X		0.58	X		2.96	X		1		
04/29/22 9:06	341026.7			0.7	X		2.18	X		0.58	X		2.84	X		1		
04/29/22 9:07	341257.8			0.8	X		2.18	X		0.65	X		2.84	X		1		
04/29/22 9:08	340487.6			0.8	X		2.09	X		0.65	X		2.72	X		1		
04/29/22 9:09	340179.6			0.8	X		1.97	X		0.64	X		2.56	X		1		
04/29/22 9:10	339640.4			0.8	X		1.91	X		0.64	X		2.48	X		1		
04/29/22 9:11	339486.4			0.8	X		1.91	X		0.64	X		2.47	X		1		
04/29/22 9:12	339717.5			0.8	X		1.91	X		0.64	X		2.48	X		0		
04/29/22 9:13	339871.5			0.8	X		1.91	X		0.65	X		2.48	X		0		
04/29/22 9:14	339486.4			0.8	X		1.82	X		0.64	X		2.36	X		0		
04/29/22 9:15	339794.5			0.8	X		1.82	X		0.64	X		2.36	X		0		
04/29/22 9:16	339948.5			0.8	X		1.82	X		0.65	X		2.36	X		0		

CT1 SUSD EVENT 4

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/29/22 16:10	444151.1			0.6			1.66			0.67			2.82			0		
04/29/22 16:11	441532.6			0.6			1.75			0.66			2.96			0		
04/29/22 16:12	440069.3			0.6			1.75			0.66			2.95			0		
04/29/22 16:13	434986.2			0.7			1.87			0.66			3.12			0		
04/29/22 16:14	432521.7			0.7			1.87			0.66			3.1			0		
04/29/22 16:15	430827.3			0.7			1.78			0.66			2.93			1		
04/29/22 16:16	426899.5			0.7			1.69			0.65			2.75			1		
04/29/22 16:17	410418.1			0.7			1.59			0.63			2.5			1		
04/29/22 16:18	388622.6			0.7			1.69			0.59			2.51			1		
04/29/22 16:19	366596			0.6			2.4			0.55			3.36			1		
04/29/22 16:20	343414.2			0.7			2.63			0.58			3.46			1		
04/29/22 16:21	319000.2			0.8			2.68			0.6			3.27			1		
04/29/22 16:22	296434.5			0.8			2.81			0.56			3.19			1		
04/29/22 16:23	276025.3			0.7			2.86			0.47			3.02			1		
04/29/22 16:24	254845.9			0.7			3.14			0.39			3.06			1		
04/29/22 16:25	231587			0.6			4.74			0.31			4.2			1		
04/29/22 16:26	210407.6			0.4			8.96			0.21			7.21			1		
04/29/22 16:27	186301.6			0.3			25.57			0.15			18.22			1		
04/29/22 16:28	166200.5			7.6			29.5			2.94			18.75			1		
04/29/22 16:29	148948.9			345.2			33.19			119.44			18.9			1		
04/29/22 16:30	97425.2			1366.4			33.38			309.24			12.43			1		
04/29/22 16:31	45670.5			0			36.52			254.34			6.38			0		
04/29/22 16:32	45516.4			0			0.2			0			0			0		
04/29/22 16:33	45516.4			0			0.1			0			0			0		
04/29/22 16:34	45593.5			0			0.1			0			0			0		
04/29/22 16:35	45439.4			0			0.1			0			0			0		

CT1 SUSD EVENT 5

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/01/22 4:33	0			0			-0.1			0			0			0		
05/01/22 4:34	0			0			-0.1			0			0			0		
05/01/22 4:35	0			0			-0.1			0			0			0		
05/01/22 4:36	0			0			-0.1			0			0			0		
05/01/22 4:37	10859.3			0			-0.1			0			0			0		
05/01/22 4:38	27802.8			0.1			-0.1			0			0			1		
05/01/22 4:39	32038.6			0.1			-0.1			0			0			1		
05/01/22 4:40	38816.1			1.2			0.2			0			0			1		
05/01/22 4:41	49675.3			1277.4			14.75			147.83			2.81			1		
05/01/22 4:42	61150.7			1117.9			16.13			159.14			3.78			1		
05/01/22 4:43	74859.5			655.9			21.31			114.37			6.11			1		
05/01/22 4:44	110517.9			458.1			25.37			117.83			10.74			1		
05/01/22 4:45	142864.6			332.3			34.6			110.53			18.94			1		
05/01/22 4:46	149565			215.1			49.94			74.93			28.63			1		
05/01/22 4:47	166431.5			1750.8			48.15			678.39			30.71			1		
05/01/22 4:48	185531.5			1843.9			53.45			796.62			38			1		
05/01/22 4:49	207635.1			975.2			61.48			471.3			48.9			1		
05/01/22 4:50	229738.6			162.2			61.2			86.73			53.86			1		
05/01/22 4:51	248530.5			15.9			54.79			9.2			52.17			1		
05/01/22 4:52	275178.1			2.8			50.81			1.82			53.57			1		
05/01/22 4:53	299207.1			2.4			26.55			1.64			30.44			1		
05/01/22 4:54	319462.3			2.2			15.82			1.66			19.36			1		
05/01/22 4:55	336328.8			2.4			12.57			1.87			16.2			1		
05/01/22 4:56	340102.5			2.5			11.37			1.96			14.82			1		
05/01/22 4:57	332786			2.4			10.09			1.85			12.86			1		
05/01/22 4:58	339640.4			2.2			9.75			1.76			12.68			1		
05/01/22 4:59	355274.7			2.1			8.76			1.72			11.93			1		
05/01/22 5:00	365748.8			1.8			6.69			1.57			9.38			1		
05/01/22 5:01	368136.3			1.7			6.26			1.46			8.83			1		
05/01/22 5:02	370523.8			1.5			6.35			1.31			9.01			1		
05/01/22 5:03	372218.2			1.4			6.35			1.24			9.05			1		
05/01/22 5:04	371217			1.3			6.26			1.16			8.9			1		
05/01/22 5:05	368444.4			1.3			6.08			1.13			8.58			1		
05/01/22 5:06	365902.9			1.3			6.08			1.13			8.52			1		

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/01/22 5:07	363515.4			1.3			6.08			1.12			8.46			1		
05/01/22 5:08	365055.7			1.2			5.81			1.05			8.13			1		
05/01/22 5:09	367289.2			1.2			5.63			0.99			7.93			1		
05/01/22 5:10	369137.6			1.1			5.45			0.92			7.71			1		
05/01/22 5:11	368136.3			1			5.18			0.84			7.31			1		
05/01/22 5:12	365209.8			1			5.45			0.84			7.63			1		
05/01/22 5:13	362129.1			1			5.54			0.83			7.69			1		
05/01/22 5:14	360742.8			1			5.54			0.83			7.66			1		
05/01/22 5:15	364516.6			1			5.18			0.83			7.24			1		
05/01/22 5:16	366365			1			5.18			0.84			7.28			1		
05/01/22 5:17	368290.4			1			5.18			0.84			7.32			1		
05/01/22 5:18	367674.3			1			5.18			0.84			7.3			1		
05/01/22 5:19	364978.7			1			5.63			0.84			7.88			1		
05/01/22 5:20	361358.9			1.1			4.74			0.9			6.56			1		
05/01/22 5:21	360126.7			1.1			2.86			0.9			3.95			1		
05/01/22 5:22	362591.2			1.1			2.23			0.91			3.1			1		
05/01/22 5:23	365132.7			1			2.15			0.84			3			1		
05/01/22 5:24	367135.1			1			2.23			0.84			3.14			1		
05/01/22 5:25	367674.3			1			2.23			0.84			3.15			1		
05/01/22 5:26	364439.6			1			2.32			0.83			3.25			1		
05/01/22 5:27	361821			1			2.41			0.83			3.35			1		
05/01/22 5:28	360203.7			1			2.41			0.82			3.33			1		
05/01/22 5:29	362052.1			1			2.23			0.83			3.1			1		
05/01/22 5:30	365055.7			1			2.06			0.84			2.88			1		
05/01/22 5:31	367443.2			1			1.88			0.84			2.64			1		
05/01/22 5:32	366673			1			1.7			0.84			2.39			1		
05/01/22 5:33	363823.4			1			1.61			0.83			2.24			1		
05/01/22 5:34	360203.7			1			1.52			0.82			2.1			0		
05/01/22 5:35	358278.3			1.1			1.52			0.89			2.09			0		
05/01/22 5:36	360742.8			1			1.52			0.83			2.1			0		
05/01/22 5:37	363823.4			1			1.43			0.83			1.99			0		
05/01/22 5:38	366288			1			1.43			0.84			2.01			0		

CT1 SUSD EVENT 6

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/03/22 0:52	450235.4			0.7			1.57			0.77			2.7			0		
05/03/22 0:53	450543.4			0.7			1.66			0.77			2.86			0		
05/03/22 0:54	450466.4			0.7			1.66			0.77			2.86			0		
05/03/22 0:55	449542.2			0.7			1.57			0.77			2.7			0		
05/03/22 0:56	450158.3			0.7			1.57			0.77			2.7			0		
05/03/22 0:57	449850.3			0.6			1.57			0.68			2.7			1		
05/03/22 0:58	449927.3			0.6			1.57			0.68			2.7			1		
05/03/22 0:59	440916.4			0.6			1.57			0.66			2.65			1		
05/03/22 1:00	422971.7			0.6			1.66			0.64			2.69			1		
05/03/22 1:01	399481.8			0.7			2.27			0.68			3.47			1		
05/03/22 1:02	377763.3			0.7			2.41			0.63			3.49			1		
05/03/22 1:03	356738			0.8			2.55			0.66			3.49			1		
05/03/22 1:04	331938.8			0.9			2.82			0.68			3.58			1		
05/03/22 1:05	309219.1			0.9			2.91			0.63			3.44			1		
05/03/22 1:06	288039.8			0.9			3.04			0.6			3.35			1		
05/03/22 1:07	266244.2			0.8			3.09			0.51			3.15			1		
05/03/22 1:08	243370.5			0.7			4.21			0.37			3.93			1		
05/03/22 1:09	222884.2			0.5			7.6			0.26			6.49			1		
05/03/22 1:10	198162.1			0.3			22.49			0.15			17.07			1		
05/03/22 1:11	176366.6			3.8			25.94			1.56			17.52			1		
05/03/22 1:12	158036.8			271.3			29.78			99.82			18.04			1		
05/03/22 1:13	139938			1159.9			31.89			377.78			17.09			1		
05/03/22 1:14	48828.1			1948.7			32.45			221.59			6.07			1		
05/03/22 1:15	21718.5			0			37.01			165.33			3.08			0		
05/03/22 1:16	21564.5			0			0.2			0			0			0		
05/03/22 1:17	21564.5			0			0.2			0			0			0		
05/03/22 1:18	21487.5			0			0.1			0			0			0		
05/03/22 1:19	21564.5			0			0.1			0			0			0		

CT1 SUSD EVENT 7

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/03/22 22:34	27802.8			0			-0.1			0			0			0		
05/03/22 22:35	27725.8			0			-0.1			0			0			0		
05/03/22 22:36	27417.7			0			-0.1			0			0			0		
05/03/22 22:37	27417.7			0			-0.1			0			0			0		
05/03/22 22:38	27494.7			0			-0.1			0			0			0		
05/03/22 22:39	32962.8			0.2			-0.1			0			0			1		
05/03/22 22:40	35196.3			0.2			-0.1			0			0			1		
05/03/22 22:41	44438.2			100.3			32.45			10.37			5.52			1		
05/03/22 22:42	54758.4			1194.1			16.79			152.35			3.53			1		
05/03/22 22:43	65232.5			814.2			22.21			123.57			5.55			1		
05/03/22 22:44	83716.4			490.3			27.95			95.6			8.97			1		
05/03/22 22:45	124072.7			325.1			33.71			93.87			16.02			1		
05/03/22 22:46	142633.6			201.3			47.91			66.83			26.17			1		
05/03/22 22:47	152645.7			447.2			59			158.97			34.52			1		
05/03/22 22:48	170128.3			2003.3			54.81			793.29			35.72			1		
05/03/22 22:49	192154.8			1413			58.49			631.94			43.06			1		
05/03/22 22:50	215028.6			307.7			55.98			153.99			46.11			1		
05/03/22 22:51	235822.9			33.6			55.15			18.45			49.84			1		
05/03/22 22:52	260237			3			49.81			1.79			49.65			1		
05/03/22 22:53	283803.8			2			35.3			1.3			38.39			1		
05/03/22 22:54	305445.3			1.8			15.92			1.27			18.63			1		
05/03/22 22:55	325623.5			1.8			11.63			1.38			14.5			1		
05/03/22 22:56	337638			1.9			10.76			1.5			13.92			1		
05/03/22 22:57	344184.4			1.9			8.68			1.53			11.44			1		
05/03/22 22:58	357893.2			1.8			7.4			1.47			10.14			1		
05/03/22 22:59	362129.1			1.6			6.08			1.36			8.43			1		
05/03/22 23:00	351115.8			1.4			6.35			1.17			8.54			1		
05/03/22 23:01	353503.3			1.3			6.78			1.09			9.18			1		
05/03/22 23:02	361590			1.2			5.55			1.04			7.69			1		
05/03/22 23:03	364362.6			1.3			5.17			1.08			7.22			1		
05/03/22 23:04	365440.8			1.1			5.18			0.91			7.26			1		
05/03/22 23:05	367135.1			1.1			5.26			0.93			7.4			1		
05/03/22 23:06	367135.1			1			5.17			0.85			7.28			1		
05/03/22 23:07	364747.7			1			5.08			0.85			7.1			1		

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/03/22 23:08	360973.9			1			5.01			0.83			6.92			1		
05/03/22 23:09	357893.2			1			5.01			0.82			6.86			1		
05/03/22 23:10	358432.3			1			4.92			0.82			6.75			1		
05/03/22 23:11	361050.9			1			4.54			0.84			6.28			1		
05/03/22 23:12	364131.5			0.9			4.63			0.77			6.46			1		
05/03/22 23:13	367366.2			0.9			4.63			0.78			6.52			1		
05/03/22 23:14	366904.1			0.9			4.54			0.78			6.38			1		
05/03/22 23:15	363438.4			0.9			4.99			0.77			6.95			1		
05/03/22 23:16	360280.7			0.9			4.99			0.76			6.89			1		
05/03/22 23:17	357123.1			1			4.99			0.83			6.83			1		
05/03/22 23:18	362976.3			1			4.99			0.84			6.94			1		
05/03/22 23:19	380998			0.9			2.9			0.81			4.24			1		
05/03/22 23:20	402254.4			0.9			1.97			0.88			3.03			1		
05/03/22 23:21	417118.5			0.8			1.87			0.82			2.99			1		
05/03/22 23:22	422355.6			0.7			1.78			0.74			2.88			1		
05/03/22 23:23	435294.3			0.7			1.78			0.76			2.97			0		
05/03/22 23:24	440069.3			0.7			2.25			0.77			3.79			0		
05/03/22 23:25	438220.9			0.8			2.58			0.85			4.33			0		
05/03/22 23:26	438528.9			0.8			2.49			0.85			4.18			0		
05/03/22 23:27	439607.2			0.8			2.34			0.86			3.94			0		

CT1 SUSD EVENT 8

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/08/22 5:54	267861.6			0.4			1.45			0.24			1.49			0		
05/08/22 5:55	267399.5			0.4			1.45			0.24			1.49			0		
05/08/22 5:56	267630.5			0.4			1.45			0.24			1.49			0		
05/08/22 5:57	267707.5			0.4			1.45			0.24			1.49			0		
05/08/22 5:58	267322.4			0.4			1.45			0.24			1.49			0		
05/08/22 5:59	266475.3			0.4			1.45			0.24			1.48			1		
05/08/22 6:00	252689.4			0.4			1.57			0.23			1.52			1		
05/08/22 6:01	232742.3			0.4			2.2			0.22			1.96			1		
05/08/22 6:02	210253.6			0.2			6.87			0.11			5.53			1		
05/08/22 6:03	185685.5			2.5			9.79			1.07			6.97			1		
05/08/22 6:04	165584.3			125			12.2			48.17			7.74			1		
05/08/22 6:05	148178.7			849.9			14.13			293.17			8.02			1		
05/08/22 6:06	91032.9			1795.9			14.75			380.69			5.15			1		
05/08/22 6:07	19639.1			0			16.01			119.51			1.2			0		
05/08/22 6:08	19331			0			0.1			0			0			0		
05/08/22 6:09	18714.9			0			0.1			0			0			0		
05/08/22 6:10	18714.9			0			0.1			0			0			0		
05/08/22 6:11	18714.9			0			0			0			0			0		

CT1 SUSD EVENT 9

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/08/22 17:13	30883.4			0			0			0			0			0		
05/08/22 17:14	30960.4			0			0			0			0			0		
05/08/22 17:15	31037.4			0			0			0			0			0		
05/08/22 17:16	31037.4			0			0			0			0			0		
05/08/22 17:17	31422.5			0			0			0			0			0		
05/08/22 17:18	38508			-0.1			0			0			0			1		
05/08/22 17:19	43976.1			0.9			0.2			0			0			1		
05/08/22 17:20	52755.9			1239			7.67			152.26			1.55			1		
05/08/22 17:21	62845			1119.3			8.85			163.86			2.13			1		
05/08/22 17:22	76168.8			628.2			12.84			111.37			3.75			1		
05/08/22 17:23	109362.7			407.1			17.08			103.61			7.15			1		
05/08/22 17:24	143480.8			255.8			21.45			85.45			11.79			1		
05/08/22 17:25	149257			178.1			38.68			61.87			22.11			1		
05/08/22 17:26	165892.4			1721.4			33.24			664.7			21.12			1		
05/08/22 17:27	185454.5			1864			35.22			804.89			25.03			1		
05/08/22 17:28	207943.1			735.3			34.47			356.03			27.47			1		
05/08/22 17:29	229430.6			117.5			35.54			62.73			31.24			1		
05/08/22 17:30	250610			8.7			35.77			5.09			34.34			1		
05/08/22 17:31	276179.3			1.9			34.62			1.22			36.63			1		
05/08/22 17:32	293199.8			1.6			16.6			1.09			18.65			1		
05/08/22 17:33	300285.3			1.5			9.8			1.02			11.28			1		
05/08/22 17:34	307139.7			1.5			8.01			1.07			9.43			1		
05/08/22 17:35	311837.7			1.5			6.53			1.1			7.8			1		
05/08/22 17:36	320078.4			1.3			5.9			1			7.24			1		
05/08/22 17:37	322234.8			1.2			5.72			0.87			7.06			1		
05/08/22 17:38	322465.9			1.1			5.37			0.79			6.64			1		
05/08/22 17:39	321464.7			1.1			4.93			0.79			6.07			1		
05/08/22 17:40	319000.2			1			4.74			0.73			5.79			1		
05/08/22 17:41	318076			1			4.65			0.73			5.66			1		
05/08/22 17:42	316073.6			0.9			4.47			0.66			5.41			1		
05/08/22 17:43	315303.4			0.8			4.29			0.59			5.18			1		
05/08/22 17:44	316073.6			0.8			4.18			0.6			5.06			1		
05/08/22 17:45	314764.3			0.8			4.08			0.6			4.93			1		
05/08/22 17:46	316073.6			0.7			3.99			0.53			4.84			1		

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/08/22 17:47	317305.8			0.7			3.99			0.54			4.86			1		
05/08/22 17:48	326778.8			0.7			3.9			0.55			4.89			1		
05/08/22 17:49	330321.5			0.7			3.9			0.56			4.94			1		
05/08/22 17:50	331014.7			0.6			3.81			0.49			4.84			1		
05/08/22 17:51	334788.4			0.6			3.63			0.5			4.66			1		
05/08/22 17:52	333094.1			0.6			3.54			0.49			4.52			1		
05/08/22 17:53	315149.3			0.6			3.45			0.47			4.17			1		
05/08/22 17:54	304829.2			0.6			3.9			0.45			4.56			1		
05/08/22 17:55	303211.9			0.6			3.72			0.45			4.32			1		
05/08/22 17:56	296819.6			0.6			3.23			0.45			3.67			1		
05/08/22 17:57	290735.3			0.6			2.21			0.37			2.46			1		
05/08/22 17:58	285498.2			0.6			2.15			0.37			2.36			1		
05/08/22 17:59	281108.3			0.5			2.15			0.31			2.32			1		
05/08/22 18:00	276102.3			0.5			2.19			0.31			2.31			1		
05/08/22 18:01	272328.5			0.5			2.38			0.3			2.48			1		
05/08/22 18:02	270480.1			0.4			2.47			0.24			2.56			1		
05/08/22 18:03	270018			0.4			2.61			0.24			2.7			1		
05/08/22 18:04	270018			0.4			2.51			0.24			2.6			1		
05/08/22 18:05	270095			0.4			2.42			0.24			2.5			1		
05/08/22 18:06	269401.9			0.3			2.22			0.18			2.3			1		
05/08/22 18:07	270018			0.3			2.03			0.18			2.1			1		
05/08/22 18:08	269864			0.3			1.93			0.18			2			1		
05/08/22 18:09	269247.8			0.3			1.84			0.18			1.9			1		
05/08/22 18:10	269555.9			0.3			1.74			0.18			1.8			1		
05/08/22 18:11	269786.9			0.3			1.64			0.18			1.7			0		
05/08/22 18:12	268554.7			0.3			1.64			0.18			1.69			0		
05/08/22 18:13	266552.3			0.3			1.55			0.18			1.58			0		
05/08/22 18:14	266398.3			0.3			1.55			0.18			1.58			0		
05/08/22 18:15	266783.3			0.3			1.57			0.18			1.61			0		

CT1 SUSD EVENT 10

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/09/22 10:51	270403.1			0.3			1.55			0.18			1.6			0		
05/09/22 10:52	270634.1			0.4			1.45			0.24			1.5			0		
05/09/22 10:53	269478.9			0.4			1.55			0.24			1.6			0		
05/09/22 10:54	267938.6			0.4			1.55			0.24			1.59			0		
05/09/22 10:55	268015.6			0.4			1.55			0.24			1.59			0		
05/09/22 10:56	267091.4			0.3			1.45			0.18			1.48			1		
05/09/22 10:57	252766.4			0.3			1.45			0.17			1.41			1		
05/09/22 10:58	231047.9			0.3			2.3			0.16			2.04			1		
05/09/22 10:59	209329.4			0.2			7.32			0.11			5.87			1		
05/09/22 11:00	184838.3			1.9			10.48			0.83			7.42			1		
05/09/22 11:01	165738.4			128.7			12.6			49.68			8.01			1		
05/09/22 11:02	148255.8			860.8			14.44			297.12			8.2			1		
05/09/22 11:03	86180.9			1852.2			15.73			371.5			5.19			1		
05/09/22 11:04	35966.5			0			16.23			223.09			2.24			0		
05/09/22 11:05	35966.5			0			0.1			0			0			0		
05/09/22 11:06	35735.4			0			0.1			0			0			0		
05/09/22 11:07	35581.4			0			0.1			0			0			0		
05/09/22 11:08	35350.3			0			0.1			0			0			0		

CT1 SUSD EVENT 11

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/17/22 15:18	48520.1			0			0			0			0			0		
05/17/22 15:19	48520.1			0			0			0			0			0		
05/17/22 15:20	48366			0			0			0			0			0		
05/17/22 15:21	49983.4			0			0			0			0			0		
05/17/22 15:22	51754.7			0			0			0			0			0		
05/17/22 15:23	54604.3			0			0			0			0			1		
05/17/22 15:24	58147.1			0			0			0			0			1		
05/17/22 15:25	64847.4			54.6			20.65			8.23			5.13			1		
05/17/22 15:26	73088.2			1056.1			16.01			179.67			4.48			1		
05/17/22 15:27	82484.1			628.5			21.17			120.71			6.69			1		
05/17/22 15:28	106898.2			311.8			26.26			77.62			10.76			1		
05/17/22 15:29	143788.8			175.1			32.45			58.6			17.87			1		
05/17/22 15:30	148563.8			105.1			47.42			36.35			26.99			1		
05/17/22 15:31	159577.1			990.2			39.02			367.96			23.86			1		
05/17/22 15:32	175981.5			1926			35.77			788.96			24.11			1		
05/17/22 15:33	197777			931.1			48.02			428.7			36.39			1		
05/17/22 15:34	221497.9			161.5			58.57			83.27			49.71			1		
05/17/22 15:35	240135.8			12.8			62.26			7.16			57.28			1		
05/17/22 15:36	266475.3			2			60.56			1.24			61.82			1		
05/17/22 15:37	289195			1.6			32.6			1.08			36.13			1		
05/17/22 15:38	309142.1			1.6			18.81			1.13			22.27			1		
05/17/22 15:39	328935.2			1.7			12.52			1.3			15.77			1		
05/17/22 15:40	345493.7			1.7			11.08			1.37			14.67			1		
05/17/22 15:41	342875.1			1.6			7.78			1.28			10.22			1		
05/17/22 15:42	344569.5			1.5			6.81			1.24			8.99			1		
05/17/22 15:43	359510.6			1.4			5.36			1.14			7.38			1		
05/17/22 15:44	365671.8			1.2			4.15			1.02			5.81			1		
05/17/22 15:45	368752.5			1			3.47			0.88			4.9			1		
05/17/22 15:46	371602.1			0.9			3.32			0.8			4.73			1		
05/17/22 15:47	370677.9			0.8			3.23			0.72			4.58			1		
05/17/22 15:48	368290.4			0.8			3			0.7			4.23			1		
05/17/22 15:49	364054.5			0.8			2.9			0.69			4.05			1		
05/17/22 15:50	365517.8			0.8			2.81			0.7			3.94			1		
05/17/22 15:51	369214.6			0.7			2.72			0.62			3.85			1		

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/17/22 15:52	371602.1			0.7			2.58			0.64			3.68			1		
05/17/22 15:53	373219.4			0.7			2.4			0.64			3.43			1		
05/17/22 15:54	369676.7			0.6			2.36			0.55			3.34			1		
05/17/22 15:55	366442			0.6			2.36			0.54			3.31			1		
05/17/22 15:56	363361.3			0.7			2.36			0.61			3.29			1		
05/17/22 15:57	365748.8			0.7			2.27			0.62			3.18			1		
05/17/22 15:58	368752.5			0.6			2.3			0.55			3.26			1		
05/17/22 15:59	370908.9			0.6			2.21			0.56			3.14			1		
05/17/22 16:00	371217			0.6			2.21			0.56			3.15			1		
05/17/22 16:01	368521.4			0.6			2.3			0.55			3.25			1		
05/17/22 16:02	364901.7			0.6			2.36			0.54			3.3			1		
05/17/22 16:03	363207.3			0.6			2.36			0.54			3.28			1		
05/17/22 16:04	365363.8			0.6			2.36			0.54			3.3			1		
05/17/22 16:05	366673			0.6			1.94			0.55			2.72			1		
05/17/22 16:06	368675.5			0.6			1.38			0.55			1.95			1		
05/17/22 16:07	369753.7			0.6			1.29			0.56			1.83			1		
05/17/22 16:08	369291.6			0.6			1.2			0.55			1.7			1		
05/17/22 16:09	366750.1			0.6			1.2			0.55			1.68			0		
05/17/22 16:10	364131.5			0.6			1.18			0.54			1.65			0		
05/17/22 16:11	362283.1			0.6			1.27			0.54			1.76			0		
05/17/22 16:12	364593.6			0.6			1.27			0.54			1.78			0		
05/17/22 16:13	367520.2			0.6			1.2			0.55			1.69			0		

CT1 SUSD EVENT 12

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/19/22 0:09	268708.7			0.4			1.55			0.24			1.59			0		
05/19/22 0:10	268169.6			0.4			1.55			0.24			1.59			0		
05/19/22 0:11	268246.6			0.4			1.64			0.24			1.69			0		
05/19/22 0:12	269324.8			0.4			1.64			0.24			1.7			0		
05/19/22 0:13	270480.1			0.4			1.64			0.24			1.7			0		
05/19/22 0:14	270326.1			0.4			1.64			0.24			1.7			1		
05/19/22 0:15	260160			0.4			1.64			0.23			1.64			1		
05/19/22 0:16	237517.3			0.4			1.74			0.21			1.58			1		
05/19/22 0:17	215875.8			0.3			5.59			0.15			4.63			1		
05/19/22 0:18	190922.6			0.2			13.16			0.1			9.63			1		
05/19/22 0:19	169743.2			4			17.2			1.59			11.18			1		
05/19/22 0:20	151952.5			302.6			20.15			107.03			11.73			1		
05/19/22 0:21	116217.1			1271.5			23.11			344.09			10.29			1		
05/19/22 0:22	37506.8			0			29.94			196.78			4.3			0		
05/19/22 0:23	37352.7			0			0.6			0			0			0		
05/19/22 0:24	37429.8			0			0.2			0			0			0		
05/19/22 0:25	37429.8			0			0.1			0			0			0		
05/19/22 0:26	37429.8			0			0.1			0			0			0		

CT1 SUSD EVENT 13

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/19/22 12:20	49444.3			0			0			0			0			0		
05/19/22 12:21	49521.3			0			0			0			0			0		
05/19/22 12:22	49521.3			0			0			0			0			0		
05/19/22 12:23	49598.3			0			0			0			0			0		
05/19/22 12:24	50214.4			0			0			0			0			0		
05/19/22 12:25	51754.7			-0.1			0			0			0			1		
05/19/22 12:26	55990.6			0			0			0			0			1		
05/19/22 12:27	62845			48.4			21.24			7.08			5.12			1		
05/19/22 12:28	71008.7			1043.5			12.98			172.62			3.53			1		
05/19/22 12:29	80404.7			656.6			18.74			122.88			5.77			1		
05/19/22 12:30	100890.9			318.3			23.6			74.74			9.12			1		
05/19/22 12:31	140400.1			181.8			25.75			59.42			13.85			1		
05/19/22 12:32	148332.8			105.3			46.11			36.38			26.21			1		
05/19/22 12:33	157112.6			913.4			44.92			334.07			27.04			1		
05/19/22 12:34	170821.4			1967.1			42.78			782.46			28			1		
05/19/22 12:35	191692.8			1346			45.51			600.81			33.43			1		
05/19/22 12:36	215105.6			289.2			46.02			144.84			37.93			1		
05/19/22 12:37	235899.9			30.9			46.28			16.99			41.82			1		
05/19/22 12:38	260391			2.5			44.54			1.54			44.43			1		
05/19/22 12:39	279953.1			1.6			30.33			1.01			32.52			1		
05/19/22 12:40	287962.7			1.4			14.05			0.94			15.5			1		
05/19/22 12:41	305214.3			1.5			10.35			1.03			12.1			1		
05/19/22 12:42	323236			1.4			8.71			1.02			10.79			1		
05/19/22 12:43	322157.8			1.3			8.4			0.94			10.37			1		
05/19/22 12:44	320617.5			1.2			7.69			0.87			9.44			1		
05/19/22 12:45	315996.5			1.1			6.97			0.79			8.44			1		
05/19/22 12:46	310759.4			1			6.99			0.72			8.32			1		
05/19/22 12:47	310528.4			0.9			6.91			0.67			8.23			1		
05/19/22 12:48	308834.1			0.9			6.82			0.66			8.07			1		
05/19/22 12:49	308526			0.8			6.73			0.6			7.96			1		
05/19/22 12:50	309296.2			0.7			6.73			0.53			7.98			1		
05/19/22 12:51	307524.8			0.7			6.73			0.53			7.93			1		
05/19/22 12:52	308140.9			0.7			6.82			0.53			8.05			1		
05/19/22 12:53	309989.3			0.6			6.82			0.47			8.1			1		

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/19/22 12:54	310066.3			0.7			7.02			0.47			8.34			1		
05/19/22 12:55	313069.9			0.6			7.01			0.47			8.4			1		
05/19/22 12:56	301055.4			0.6			7.1			0.45			8.19			1		
05/19/22 12:57	292814.7			0.7			6.93			0.45			7.77			1		
05/19/22 12:58	288963.9			0.7			6.47			0.45			7.16			1		
05/19/22 12:59	284111.9			0.6			5.04			0.38			5.49			1		
05/19/22 13:00	287654.7			0.5			2.95			0.32			3.25			1		
05/19/22 13:01	286807.5			0.5			2.61			0.32			2.87			1		
05/19/22 13:02	277873.6			0.5			2.57			0.31			2.74			1		
05/19/22 13:03	273945.8			0.5			2.61			0.31			2.74			1		
05/19/22 13:04	273483.7			0.5			2.71			0.31			2.84			1		
05/19/22 13:05	272790.6			0.4			3.05			0.25			3.19			1		
05/19/22 13:06	273175.7			0.4			3.15			0.25			3.29			1		
05/19/22 13:07	273252.7			0.4			3.15			0.25			3.29			1		
05/19/22 13:08	273483.7			0.4			2.95			0.25			3.09			1		
05/19/22 13:09	272020.4			0.4			2.66			0.25			2.77			1		
05/19/22 13:10	272636.5			0.4			2.46			0.25			2.57			1		
05/19/22 13:11	272251.5			0.4			2.26			0.25			2.36			1		
05/19/22 13:12	272867.6			0.4			2.07			0.25			2.16			1		
05/19/22 13:13	280415.2			0.4			1.97			0.26			2.11			1		
05/19/22 13:14	300362.3			0.4			1.87			0.28			2.15			1		
05/19/22 13:15	320078.4			0.4			1.71			0.28			2.1			1		
05/19/22 13:16	332863			0.5			1.59			0.36			2.03			0		
05/19/22 13:17	329166.3			0.6			1.01			0.42			1.28			0		
05/19/22 13:18	327163.8			0.6			0.91			0.48			1.14			0		
05/19/22 13:19	329243.3			0.6			0.91			0.49			1.14			0		
05/19/22 13:20	330167.5			0.6			0.82			0.49			1.03			0		

CT1 SUSD EVENT 14

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/19/22 22:36	378148.4			0.6			1.18			0.56			1.71			0		
05/19/22 22:37	358124.3			0.6			1.25			0.52			1.72			0		
05/19/22 22:38	335943.7			0.7			1.32			0.55			1.7			0		
05/19/22 22:39	311144.5			0.7			1.41			0.51			1.68			0		
05/19/22 22:40	290427.2			0.7			1.43			0.48			1.59			0		
05/19/22 22:41	269478.9			0.7			1.45			0.46			1.5			1		
05/19/22 22:42	245681			0.6			1.5			0.32			1.41			1		
05/19/22 22:43	224655.6			0.4			4.7			0.21			4.04			1		
05/19/22 22:44	201473.8			0.2			10.82			0.1			8.35			1		
05/19/22 22:45	178523			3.1			17.58			1.28			12.02			1		
05/19/22 22:46	160501.3			230			20.03			85.91			12.32			1		
05/19/22 22:47	142248.5			1083.7			23.6			358.77			12.86			1		
05/19/22 22:48	57993			1918			25.21			258.9			5.6			1		
05/19/22 22:49	31807.6			0			31.65			271.79			3.86			0		
05/19/22 22:50	31807.6			0			0.2			0			0			0		
05/19/22 22:51	31884.6			0			0.2			0			0			0		
05/19/22 22:52	31576.5			0			0.1			0			0			0		
05/19/22 22:53	31499.5			0			0.1			0			0			0		

CT1 SUSD EVENT 15

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/24/22 8:05	35350.3			0			0			0			0			0		
05/24/22 8:06	34965.3			0			0			0			0			0		
05/24/22 8:07	34811.2			0			0			0			0			0		
05/24/22 8:08	34734.2			0			0			0			0			0		
05/24/22 8:09	38739			0			0			0			0			0		
05/24/22 8:10	42820.9			0			0			0			0			1		
05/24/22 8:11	45054.3			0			0			0			0			1		
05/24/22 8:12	51985.8			1.5			0.3			0			0			1		
05/24/22 8:13	61227.7			1118.9			15.55			159.54			3.65			1		
05/24/22 8:14	70854.7			878.7			18.07			144.97			4.91			1		
05/24/22 8:15	86026.8			481.6			22.98			96.49			7.58			1		
05/24/22 8:16	125073.9			293.3			26.41			85.42			12.66			1		
05/24/22 8:17	144019.9			187.1			38.35			62.73			21.16			1		
05/24/22 8:18	148563.8			291.9			50.25			100.97			28.6			1		
05/24/22 8:19	150951.3			2004.6			43.46			704.5			25.14			1		
05/24/22 8:20	151567.4			1972.8			44.07			695.97			25.58			1		
05/24/22 8:21	165430.3			1972.8			51.63			759.56			32.71			1		
05/24/22 8:22	185839.5			1856.8			64.55			803.41			45.97			1		
05/24/22 8:23	207018.9			599.8			71.73			289.06			56.89			1		
05/24/22 8:24	229199.5			84.7			64.5			45.22			56.65			1		
05/24/22 8:25	250455.9			5.4			56.88			3.17			54.58			1		
05/24/22 8:26	275717.2			2.5			46.13			1.58			48.72			1		
05/24/22 8:27	298282.9			2.2			20.41			1.54			23.32			1		
05/24/22 8:28	316920.7			2.1			13.41			1.58			16.28			1		
05/24/22 8:29	333325.1			2.1			11.1			1.64			14.17			1		
05/24/22 8:30	336020.7			2.1			9.69			1.65			12.47			1		
05/24/22 8:31	336174.7			2			7.42			1.54			9.56			1		
05/24/22 8:32	333248.1			1.8			7.13			1.37			9.11			1		
05/24/22 8:33	331861.8			1.6			6.43			1.22			8.17			1		
05/24/22 8:34	332092.9			1.4			6.16			1.09			7.84			1		
05/24/22 8:35	331091.7			1.2			5.81			0.95			7.37			1		
05/24/22 8:36	331245.7			1.1			5.46			0.88			6.93			1		
05/24/22 8:37	330244.5			1.1			5.37			0.81			6.8			1		
05/24/22 8:38	330321.5			1.1			5.2			0.81			6.57			1		

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/24/22 8:39	329089.3			1			5.1			0.75			6.43			1		
05/24/22 8:40	329782.4			1			5.01			0.75			6.33			1		
05/24/22 8:41	329551.3			1			4.92			0.75			6.21			1		
05/24/22 8:42	328935.2			0.9			4.83			0.68			6.08			1		
05/24/22 8:43	328858.2			0.9			4.74			0.68			5.97			1		
05/24/22 8:44	329012.2			0.9			4.74			0.68			5.97			1		
05/24/22 8:45	328627.2			0.8			4.65			0.62			5.85			1		
05/24/22 8:46	328781.2			0.8			4.65			0.62			5.86			1		
05/24/22 8:47	329089.3			0.8			4.65			0.62			5.86			1		
05/24/22 8:48	327857			0.8			4.65			0.61			5.84			1		
05/24/22 8:49	328396.1			0.8			4.65			0.62			5.85			1		
05/24/22 8:50	327240.9			0.8			4.65			0.61			5.83			1		
05/24/22 8:51	319231.2			0.8			4.65			0.6			5.69			1		
05/24/22 8:52	316920.7			0.8			5.45			0.59			6.62			1		
05/24/22 8:53	315380.4			0.8			5.63			0.59			6.81			1		
05/24/22 8:54	314610.3			0.7			5.72			0.52			6.9			1		
05/24/22 8:55	312915.9			0.7			5.26			0.53			6.31			1		
05/24/22 8:56	312068.7			0.7			3.09			0.53			3.69			1		
05/24/22 8:57	310066.3			0.7			2.72			0.52			3.24			1		
05/24/22 8:58	308371.9			0.7			2.63			0.52			3.11			1		
05/24/22 8:59	307986.9			0.7			2.54			0.52			3			1		
05/24/22 9:00	305599.4			0.6			2.45			0.45			2.87			1		
05/24/22 9:01	304059.1			0.6			2.36			0.45			2.75			1		
05/24/22 9:02	299515.1			0.6			2.18			0.44			2.5			1		
05/24/22 9:03	295356.3			0.6			2.03			0.44			2.3			1		
05/24/22 9:04	289965.1			0.6			1.94			0.37			2.15			1		
05/24/22 9:05	285960.3			0.6			1.75			0.37			1.92			1		
05/24/22 9:06	285344.2			0.6			1.69			0.37			1.84			1		
05/24/22 9:07	282494.6			0.6			1.69			0.37			1.82			0		
05/24/22 9:08	273021.6			0.6			1.69			0.36			1.76			0		
05/24/22 9:09	268400.7			0.5			1.71			0.3			1.76			0		
05/24/22 9:10	267861.6			0.5			1.9			0.3			1.95			0		
05/24/22 9:11	269632.9			0.4			2.22			0.24			2.3			0		

CT1 SUSD EVENT 16

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/25/22 22:48	269864			0.4			2.28			0.24			2.36			0		
05/25/22 22:49	269941			0.5			2.19			0.3			2.26			0		
05/25/22 22:50	271866.4			0.5			2.09			0.3			2.18			0		
05/25/22 22:51	272020.4			0.5			1.9			0.3			1.98			0		
05/25/22 22:52	272251.5			0.5			1.71			0.3			1.79			0		
05/25/22 22:53	268323.7			0.5			1.52			0.3			1.57			1		
05/25/22 22:54	247606.3			0.5			1.52			0.27			1.44			1		
05/25/22 22:55	225964.9			0.4			2.56			0.21			2.21			1		
05/25/22 22:56	201473.8			0.3			8.26			0.15			6.38			1		
05/25/22 22:57	178137.9			2.3			16.01			0.95			10.93			1		
05/25/22 22:58	160655.3			98.7			20.11			36.92			12.38			1		
05/25/22 22:59	142017.5			745.9			23.44			246.6			12.76			1		
05/25/22 23:00	69006.3			1880			26.82			302.15			7.09			1		
05/25/22 23:01	47518.9			0			35.4			387.81			6.44			0		
05/25/22 23:02	47441.8			0			0.2			0			0			0		
05/25/22 23:03	47364.8			0			0.1			0			0			0		
05/25/22 23:04	47287.8			0			0.1			0			0			0		
05/25/22 23:05	47056.8			0			0.1			0			0			0		

CT1 SUSD EVENT 17

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/26/22 11:34	46363.6			0			0			0			0			0		
05/26/22 11:35	46363.6			0			0			0			0			0		
05/26/22 11:36	46594.7			0			0			0			0			0		
05/26/22 11:37	46440.6			0			0			0			0			0		
05/26/22 11:38	46671.7			0			0			0			0			0		
05/26/22 11:39	49598.3			0			0			0			0			1		
05/26/22 11:40	52139.8			0			0			0			0			1		
05/26/22 11:41	59918.4			73.8			32.45			10.28			7.45			1		
05/26/22 11:42	68159.1			1160.6			18.96			184.2			4.95			1		
05/26/22 11:43	78017.2			696.5			26.38			126.45			7.88			1		
05/26/22 11:44	100197.8			374.9			28.62			87.46			10.98			1		
05/26/22 11:45	138089.6			230.1			37.28			73.96			19.72			1		
05/26/22 11:46	147408.6			141.2			54.85			48.44			30.98			1		
05/26/22 11:47	162349.7			917			54.43			346.48			33.85			1		
05/26/22 11:48	181603.7			1916.2			54.58			810.26			37.98			1		
05/26/22 11:49	203476.2			786.6			55.97			372.59			43.63			1		
05/26/22 11:50	225502.8			127			54.93			66.66			47.45			1		
05/26/22 11:51	246605.1			9			51.87			5.15			49.01			1		
05/26/22 11:52	272174.4			1.9			46.44			1.18			48.43			1		
05/26/22 11:53	282263.5			1.6			22.22			1.03			24.04			1		
05/26/22 11:54	282494.6			1.5			13.62			1.01			14.74			1		
05/26/22 11:55	281801.4			1.6			11.35			1.07			12.25			1		
05/26/22 11:56	281724.4			1.6			10.6			1.03			11.44			1		
05/26/22 11:57	280954.3			1.4			9.5			0.9			10.22			1		
05/26/22 11:58	288501.8			1.2			9.5			0.8			10.49			1		
05/26/22 11:59	308371.9			1			8.52			0.74			10.07			1		
05/26/22 12:00	328319.1			0.9			7.47			0.7			9.39			1		
05/26/22 12:01	345724.7			0.9			6.72			0.73			8.9			1		
05/26/22 12:02	358047.3			1			4.81			0.83			6.6			1		
05/26/22 12:03	347342			0.9			4.7			0.75			6.26			1		
05/26/22 12:04	326547.7			0.8			5.1			0.61			6.37			1		
05/26/22 12:05	304059.1			0.9			5.2			0.62			6.05			1		
05/26/22 12:06	286114.3			0.9			5.27			0.6			5.78			1		
05/26/22 12:07	281570.4			0.8			5.07			0.54			5.47			1		

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/26/22 12:08	284497			0.7			6.37			0.43			6.94			1		
05/26/22 12:09	288116.8			0.6			6.46			0.38			7.13			1		
05/26/22 12:10	289811.1			0.6			6.56			0.38			7.28			1		
05/26/22 12:11	286345.4			0.6			6.37			0.37			6.99			1		
05/26/22 12:12	282802.7			0.6			6.18			0.37			6.7			1		
05/26/22 12:13	283033.7			0.6			6.27			0.37			6.81			1		
05/26/22 12:14	287038.5			0.6			6.65			0.38			7.31			1		
05/26/22 12:15	289888.1			0.5			6.74			0.32			7.49			1		
05/26/22 12:16	287500.6			0.6			6.37			0.38			7.01			1		
05/26/22 12:17	282802.7			0.6			6.37			0.37			6.9			1		
05/26/22 12:18	282109.5			0.6			6.47			0.37			6.99			1		
05/26/22 12:19	284497			0.6			4.28			0.38			4.67			1		
05/26/22 12:20	286268.4			0.5			3.05			0.32			3.34			1		
05/26/22 12:21	287962.7			0.5			2.85			0.32			3.15			1		
05/26/22 12:22	288809.9			0.6			2.66			0.38			2.95			1		
05/26/22 12:23	285267.2			0.6			2.47			0.38			2.7			1		
05/26/22 12:24	281339.3			0.6			2.38			0.37			2.56			1		
05/26/22 12:25	279876			0.5			2.28			0.31			2.45			1		
05/26/22 12:26	285498.2			0.5			2.13			0.32			2.33			1		
05/26/22 12:27	289734.1			0.5			2			0.32			2.22			1		
05/26/22 12:28	286037.3			0.5			1.9			0.32			2.09			1		
05/26/22 12:29	283649.8			0.5			1.81			0.31			1.96			1		
05/26/22 12:30	281416.4			0.5			1.62			0.31			1.74			0		
05/26/22 12:31	279336.9			0.5			1.43			0.31			1.53			0		
05/26/22 12:32	281647.4			0.5			1.35			0.32			1.46			0		
05/26/22 12:33	284420			0.5			1.35			0.32			1.48			0		
05/26/22 12:34	285421.2			0.5			1.33			0.32			1.46			0		

CT1 SUSD EVENT 18

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/26/22 20:07	435602.3			0.6			1.29			0.65			2.15			0		
05/26/22 20:08	434601.1			0.6			1.38			0.65			2.3			0		
05/26/22 20:09	434062			0.6			1.38			0.65			2.3			0		
05/26/22 20:10	434524.1			0.6			1.48			0.65			2.46			0		
05/26/22 20:11	434139			0.6			1.48			0.65			2.45			0		
05/26/22 20:12	434678.2			0.6			1.48			0.65			2.46			1		
05/26/22 20:13	428747.9			0.6			1.48			0.64			2.42			1		
05/26/22 20:14	410803.2			0.6			1.57			0.62			2.47			1		
05/26/22 20:15	389469.8			0.6			1.91			0.58			2.84			1		
05/26/22 20:16	367905.3			0.7			2.41			0.61			3.4			1		
05/26/22 20:17	347265			0.7			2.47			0.57			3.28			1		
05/26/22 20:18	321695.7			0.8			2.64			0.59			3.26			1		
05/26/22 20:19	298822			0.8			2.82			0.55			3.23			1		
05/26/22 20:20	278489.8			0.8			2.95			0.52			3.15			1		
05/26/22 20:21	256232.1			0.7			3.23			0.44			3.17			1		
05/26/22 20:22	232896.3			0.6			5.32			0.31			4.75			1		
05/26/22 20:23	210715.7			0.4			9.59			0.21			7.74			1		
05/26/22 20:24	186455.7			2.1			22.44			0.9			16.03			1		
05/26/22 20:25	167124.7			106.3			25.44			41.37			16.29			1		
05/26/22 20:26	150335.2			794.2			28.74			278.06			16.56			1		
05/26/22 20:27	91495			1809			28.81			385.51			10.1			1		
05/26/22 20:28	37814.8			0			32.83			222.28			4.75			0		
05/26/22 20:29	37814.8			0			0.3			0			0			0		
05/26/22 20:30	37814.8			0			0.2			0			0			0		
05/26/22 20:31	37737.8			0			0.2			0			0			0		
05/26/22 20:32	37660.8			0			0.1			0			0			0		

CT1 SUSD EVENT 19

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/06/22 13:34	47210.8			0			0			0			0			0		
06/06/22 13:35	47133.8			0			0			0			0			0		
06/06/22 13:36	47287.8			0			0			0			0			0		
06/06/22 13:37	47287.8			0			0			0			0			0		
06/06/22 13:38	49983.4			0			0			0			0			0		
06/06/22 13:39	53141			0			0			0			0			1		
06/06/22 13:40	54758.4			0			0			0			0			1		
06/06/22 13:41	59379.3			1.4			0.1			0			0			1		
06/06/22 13:42	66849.9			1306.1			19.91			205.24			5.15			1		
06/06/22 13:43	75783.7			211.4	X		11.31	X		37.67	X		3.32	X		1		
06/06/22 13:44	88183.3			211.4	X		27.04	X		43.82	X		9.22	X		1		
06/06/22 13:45	122224.4			126.9	X		28.91	X		36.43	X		13.66	X		1		
06/06/22 13:46	147331.6			110.3	X		39.25	X		38.2	X		22.37	X		1		
06/06/22 13:47	151721.5			87.5	X		52.69	X		31.2	X		30.92	X		1		
06/06/22 13:48	163350.9			81.8	X		38.64	X		31.42	X		24.41	X		1		
06/06/22 13:49	181218.6			79.3	X		40.19	X		33.77	X		28.18	X		1		
06/06/22 13:50	203168.1			68.6	X		51.03	X		32.74	X		40.1	X		1		
06/06/22 13:51	225887.8			131.3			57.88			69.74			50.57			1		
06/06/22 13:52	245681			10.6			60.11			6.1			57.13			1		
06/06/22 13:53	271866.4			2.1			57.44			1.35			60.42			1		
06/06/22 13:54	295587.3			1.8			28			1.25			32.02			1		
06/06/22 13:55	313763.1			1.7			16.43			1.27			19.94			1		
06/06/22 13:56	309527.2			1.8			12.78			1.3			15.31			1		
06/06/22 13:57	302903.8			1.8			11.89			1.27			13.93			1		
06/06/22 13:58	320001.4			1.6			9.8			1.23			12.13			1		
06/06/22 13:59	339717.5			1.5			9.53			1.16			12.52			1		
06/06/22 14:00	355043.6			1.3			8.05			1.12			11.05			1		
06/06/22 14:01	373296.4			1.3			5.99			1.13			8.65			1		
06/06/22 14:02	396170.2			1.2			5.06			1.13			7.75			1		
06/06/22 14:03	418504.8			1			4.95			1.03			8.01			1		
06/06/22 14:04	432598.7			0.9			4.57			0.87			7.64			1		
06/06/22 14:05	427053.6			0.8			5.43			0.85			8.97			1		
06/06/22 14:06	425513.3			0.8			5.06			0.84			8.32			1		
06/06/22 14:07	429980.2			0.9			4.66			0.87			7.76			1		

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/06/22 14:08	435602.3			0.8			4.09			0.78			6.9			1		
06/06/22 14:09	437835.8			0.7			4.19			0.69			7.09			1		
06/06/22 14:10	438683			0.7			4.21			0.68			7.15			1		
06/06/22 14:11	437912.8			0.6			4.5			0.58			7.61			1		
06/06/22 14:12	437296.7			0.6			3.37			0.58			5.7			1		
06/06/22 14:13	437604.8			0.6			1.59			0.58			2.7			1		
06/06/22 14:14	437912.8			0.6			1.31			0.58			2.22			1		
06/06/22 14:15	438143.9			0.6			1.12			0.58			1.9			1		
06/06/22 14:16	435140.3			0.6			1.22			0.57			2.05			0		
06/06/22 14:17	418427.8			0.6			1.5			0.55			2.43			0		
06/06/22 14:18	396863.3			0.6			1.59			0.52			2.44			0		
06/06/22 14:19	373296.4			0.5			1.72			0.48			2.49			0		
06/06/22 14:20	351500.9			0.6			1.88			0.52			2.55			0		

CT1 SUSD EVENT 20

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/06/22 17:53	442302.7			0.7			1.5			0.68			2.56			0		
06/06/22 17:54	442687.8			0.7			1.5			0.68			2.57			0		
06/06/22 17:55	443226.9			0.7			1.5			0.68			2.57			0		
06/06/22 17:56	442533.8			0.7			1.5			0.68			2.57			0		
06/06/22 17:57	440839.4			0.7			1.5			0.68			2.56			0		
06/06/22 17:58	441609.6			0.7			1.5			0.68			2.56			1		
06/06/22 17:59	433908			0.7			1.5			0.67			2.51			1		
06/06/22 18:00	417503.6			0.7			1.59			0.64			2.57			1		
06/06/22 18:01	394937.9			0.6			1.84			0.6			2.82			1		
06/06/22 18:02	372526.3			0.7			2.45			0.64			3.53			1		
06/06/22 18:03	351423.9			0.7			2.5			0.59			3.4			1		
06/06/22 18:04	326239.7			0.8			2.55			0.61			3.22			1		
06/06/22 18:05	303288.9			0.8			2.77			0.57			3.25			1		
06/06/22 18:06	283341.8			0.8			2.81			0.54			3.08			1		
06/06/22 18:07	261546.2			0.7			3.09			0.4			3.13			1		
06/06/22 18:08	237825.3			0.6			4.74			0.32			4.36			1		
06/06/22 18:09	217570.1			0.4			8.59			0.21			7.23			1		
06/06/22 18:10	193156.1			1			23.48			0.47			17.55			1		
06/06/22 18:11	172746.8			14.8			27.01			6.02			18.05			1		
06/06/22 18:12	156573.5			515.2			30.39			189.6			18.4			1		
06/06/22 18:13	105665.9			1591.1			31.69			395.35			12.96			1		
06/06/22 18:14	54681.3			0			35.91			326.67			7.59			0		
06/06/22 18:15	54142.2			0			0.3			0			0			0		
06/06/22 18:16	53757.1			0			0.2			0			0			0		
06/06/22 18:17	53372.1			0			0.2			0			0			0		
06/06/22 18:18	52833			0			0.2			0			0			0		

CT1 SUSD EVENT 21

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/08/22 3:39	28495.9			0			0			0			0			0		
06/08/22 3:40	28495.9			0			0			0			0			0		
06/08/22 3:41	28341.9			0			0			0			0			0		
06/08/22 3:42	28341.9			0			0			0			0			0		
06/08/22 3:43	29882.2			0			0			0			0			0		
06/08/22 3:44	34657.2			0			0			0			0			1		
06/08/22 3:45	40972.5			1.2			0			0			0			1		
06/08/22 3:46	50445.5			1334.2			20.23			158.29			3.95			1		
06/08/22 3:47	61227.7			1150.1			15.34			165.54			3.63			1		
06/08/22 3:48	73704.3			707.7			23.25			122.61			6.63			1		
06/08/22 3:49	104818.7			427.5			27.14			105.35			11.01			1		
06/08/22 3:50	140631.2			286.2			36.74			94.61			19.99			1		
06/08/22 3:51	146715.4			184.9			54.63			63.77			31.01			1		
06/08/22 3:52	158806.9			1546.6			53.69			577.46			32.99			1		
06/08/22 3:53	176135.5			1969.5			57.34			815.16			39.06			1		
06/08/22 3:54	197931			1378.3			62.11			641.12			47.55			1		
06/08/22 3:55	221112.9			264.2			62.02			137.33			53.05			1		
06/08/22 3:56	240289.8			28.7			57.08			16.23			53.05			1		
06/08/22 3:57	266244.2			3			51.85			1.85			53.41			1		
06/08/22 3:58	290812.3			2			34.26			1.34			38.55			1		
06/08/22 3:59	312222.8			1.8			16.04			1.35			19.37			1		
06/08/22 4:00	331399.7			1.8			12.24			1.44			15.69			1		
06/08/22 4:01	348420.3			1.9			11.11			1.56			14.97			1		
06/08/22 4:02	365286.8			1.9			8.54			1.66			12.07			1		
06/08/22 4:03	385542			1.7			6.79			1.54			10.13			1		
06/08/22 4:04	406182.3			1.5			6.17			1.39			9.7			1		
06/08/22 4:05	428516.9			1.3			5.99			1.3			9.93			1		
06/08/22 4:06	453778.1			1			5.53			1.08			9.71			1		
06/08/22 4:07	454394.3			0.9			6.45			0.98			11.34			1		
06/08/22 4:08	452622.9			0.9			6.73			0.98			11.78			1		
06/08/22 4:09	450851.5			0.8			6.45			0.88			11.25			1		
06/08/22 4:10	450928.5			0.8			6.36			0.88			11.1			1		
06/08/22 4:11	451698.7			0.8			6.18			0.88			10.79			1		
06/08/22 4:12	451082.6			0.7			6.08			0.78			10.62			1		

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/08/22 4:13	450851.5			0.7			5.99			0.78			10.45			1		
06/08/22 4:14	450697.5			0.7			5.99			0.78			10.45			1		
06/08/22 4:15	450851.5			0.7			5.9			0.78			10.29			1		
06/08/22 4:16	451005.5			0.7			5.9			0.78			10.29			1		
06/08/22 4:17	450928.5			0.6			5.9			0.68			10.29			1		
06/08/22 4:18	451159.6			0.6			5.99			0.68			10.46			1		
06/08/22 4:19	450774.5			0.6			5.99			0.68			10.45			1		
06/08/22 4:20	451313.6			0.6			6.08			0.68			10.62			1		
06/08/22 4:21	451544.7			0.6			5.62			0.68			9.82			1		
06/08/22 4:22	451467.6			0.6			2.95			0.68			5.15			1		
06/08/22 4:23	451159.6			0.6			2.12			0.68			3.7			1		
06/08/22 4:24	451698.7			0.6			2.12			0.69			3.7			1		
06/08/22 4:25	451544.7			0.6			2.21			0.68			3.86			1		
06/08/22 4:26	452006.8			0.6			2.4			0.69			4.19			1		
06/08/22 4:27	451775.7			0.6			2.58			0.69			4.51			1		
06/08/22 4:28	451159.6			0.6			2.77			0.68			4.83			1		
06/08/22 4:29	452314.8			0.6			2.67			0.69			4.68			1		
06/08/22 4:30	452083.8			0.6			2.49			0.69			4.35			1		
06/08/22 4:31	451698.7			0.6			2.21			0.69			3.87			1		
06/08/22 4:32	452391.8			0.6			1.84			0.69			3.23			1		
06/08/22 4:33	452006.8			0.6			1.66			0.69			2.9			1		
06/08/22 4:34	451775.7			0.6			1.48			0.69			2.58			1		
06/08/22 4:35	452237.8			0.6			1.38			0.69			2.42			0		
06/08/22 4:36	451698.7			0.6			1.38			0.69			2.42			0		
06/08/22 4:37	452006.8			0.6			1.38			0.69			2.42			0		
06/08/22 4:38	452391.8			0.6			1.29			0.69			2.26			0		
06/08/22 4:39	452314.8			0.6			1.29			0.69			2.26			0		

CT1 SUSD EVENT 22

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/17/22 13:11	269555.9			0.4			1.57			0.25			1.64			0		
06/17/22 13:12	269324.8			0.4			1.57			0.25			1.64			0		
06/17/22 13:13	270326.1			0.4			1.57			0.25			1.64			0		
06/17/22 13:14	269324.8			0.4			1.57			0.25			1.64			0		
06/17/22 13:15	270326.1			0.4			1.48			0.25			1.54			0		
06/17/22 13:16	266783.3			0.4			1.45			0.24			1.5			1		
06/17/22 13:17	245681			0.4			1.45			0.22			1.38			1		
06/17/22 13:18	224655.6			0.4			3.3			0.21			2.87			1		
06/17/22 13:19	200241.5			0.2			9.91			0.1			7.68			1		
06/17/22 13:20	177675.8			3.2			12.78			1.33			8.79			1		
06/17/22 13:21	159654.1			225.7			15.73			84.69			9.71			1		
06/17/22 13:22	141709.4			1118.1			18.03			372.4			9.88			1		
06/17/22 13:23	50291.4			1970.6			18.81			232.91			3.66			1		
06/17/22 13:24	50060.4			0			35.4			642.72			6.86			0		
06/17/22 13:25	49983.4			0			0.1			0			0			0		
06/17/22 13:26	49829.3			0			0.1			0			0			0		
06/17/22 13:27	49675.3			0			0.1			0			0			0		
06/17/22 13:28	49675.3			0			0.1			0			0			0		

CT1 SUSD EVENT 23

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/20/22 14:10	51754.7			0			0			0			0			0		
06/20/22 14:11	51831.8			0			0			0			0			0		
06/20/22 14:12	51985.8			0			0			0			0			0		
06/20/22 14:13	51908.8			0			0			0			0			0		
06/20/22 14:14	81945			0			0			0			0			0		
06/20/22 14:15	55682.5			0			0			0			0			1		
06/20/22 14:16	57530.9			0			0			0			0			1		
06/20/22 14:17	62151.9			2.4			0.1			0			0			1		
06/20/22 14:18	69545.4			1261.1			19.18			206.08			5.16			1		
06/20/22 14:19	77478.1			952.7			17.7			173.58			5.31			1		
06/20/22 14:20	88183.3			507.1			22.62			105.11			7.72			1		
06/20/22 14:21	117988.5			257.1			25.85			71.3			11.8			1		
06/20/22 14:22	148255.8			151.3			39.25			52.75			22.51			1		
06/20/22 14:23	148255.8			96.5			57.74			33.64			33.12			1		
06/20/22 14:24	157959.8			1461.8			53.3			542.86			32.57			1		
06/20/22 14:25	173594			2019.3			58.43			824.03			39.24			1		
06/20/22 14:26	193387.1			1433.4			70.63			651.65			52.84			1		
06/20/22 14:27	217339.1			282.4			72.62			144.28			61.05			1		
06/20/22 14:28	238056.4			23.7			64.38			13.28			59.29			1		
06/20/22 14:29	262085.4			2.5			57.15			1.57			57.94			1		
06/20/22 14:30	280954.3			1.9			36.12			1.23			39.26			1		
06/20/22 14:31	283726.8			1.7			16.39			1.12			17.99			1		
06/20/22 14:32	290658.3			1.7			11.35			1.18			12.76			1		
06/20/22 14:33	307293.7			1.8			9.86			1.27			11.73			1		
06/20/22 14:34	312145.8			1.6			8.02			1.15			9.69			1		
06/20/22 14:35	312530.8			1.5			7.26			1.07			8.78			1		
06/20/22 14:36	312145.8			1.5			6.55			1.08			7.9			1		
06/20/22 14:37	310066.3			1.4			5.72			1.01			6.86			1		
06/20/22 14:38	309296.2			1.2			5.25			0.87			6.29			1		
06/20/22 14:39	307601.8			1.1			4.79			0.8			5.7			1		
06/20/22 14:40	306523.6			1			4.78			0.74			5.66			1		
06/20/22 14:41	305676.4			0.9			4.59			0.67			5.43			1		
06/20/22 14:42	305676.4			0.9			4.5			0.67			5.32			1		
06/20/22 14:43	311606.6			0.8			4.31			0.62			5.19			1		

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/20/22 14:44	317305.8			0.8			4.31			0.63			5.29			1		
06/20/22 14:45	317998.9			0.8			4.15			0.62			5.1			1		
06/20/22 14:46	317690.9			0.8			4.06			0.62			4.99			1		
06/20/22 14:47	317228.8			0.8			3.96			0.62			4.86			1		
06/20/22 14:48	316997.8			0.7			3.87			0.55			4.75			1		
06/20/22 14:49	317613.9			0.7			3.78			0.55			4.64			1		
06/20/22 14:50	306831.6			0.7			3.75			0.54			4.45			1		
06/20/22 14:51	287423.6			0.7			3.75			0.51			4.16			1		
06/20/22 14:52	276564.3			0.7			3.81			0.43			4.07			1		
06/20/22 14:53	281339.3			0.6			4.03			0.39			4.39			1		
06/20/22 14:54	289272			0.5			4.52			0.33			5.06			1		
06/20/22 14:55	288886.9			0.5			4.55			0.33			5.08			1		
06/20/22 14:56	286191.3			0.5			4.35			0.33			4.82			1		
06/20/22 14:57	286037.3			0.6			4.26			0.39			4.71			1		
06/20/22 14:58	292737.7			0.6			4.26			0.4			4.82			1		
06/20/22 14:59	312607.8			0.5			4.26			0.36			5.15			1		
06/20/22 15:00	330783.6			0.6			4.09			0.44			5.24			1		
06/20/22 15:01	333171.1			0.6			2.62			0.44			3.38			1		
06/20/22 15:02	331014.7			0.7			1.97			0.51			2.52			1		
06/20/22 15:03	328165.1			0.7			1.97			0.51			2.5			1		
06/20/22 15:04	329166.3			0.7			2.15			0.51			2.74			1		
06/20/22 15:05	330398.5			0.7			2.43			0.58			3.11			1		
06/20/22 15:06	332400.9			0.7			2.62			0.51			3.37			1		
06/20/22 15:07	331553.8			0.7			2.9			0.51			3.72			1		
06/20/22 15:08	340641.7			0.7			3			0.52			3.95			1		
06/20/22 15:09	355890.8			0.7			2.34			0.55			3.22			1		
06/20/22 15:10	372988.3			0.7			1.81			0.58			2.61			1		
06/20/22 15:11	382846.4			0.6			1.74			0.52			2.58			1		
06/20/22 15:12	386543.2			0.6			2.03			0.53			3.04			1		
06/20/22 15:13	386081.1			0.6			2.61			0.53			3.9			1		
06/20/22 15:14	387621.4			0.6			2.61			0.53			3.92			1		
06/20/22 15:15	388853.7			0.6			1.93			0.53			2.91			1		
06/20/22 15:16	392704.4			0.6			1.64			0.54			2.5			1		
06/20/22 15:17	392704.4			0.6			1.55			0.54			2.35			1		
06/20/22 15:18	399173.8			0.6			1.55			0.54			2.39			1		
06/20/22 15:19	412805.6			0.6			1.55			0.56			2.47			0		
06/20/22 15:20	404333.8			0.6			1.62			0.54			2.53			0		

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/20/22 15:21	403332.7			0.7			1.71			0.63			2.67			0		
06/20/22 15:22	407260.5			0.7			1.84			0.65			2.89			0		
06/20/22 15:23	403024.6			0.7			1.74			0.64			2.71			0		

CT1 SUSD EVENT 24

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/25/22 21:45	280954.3			0.8			1.45			0.54			1.58			0		
06/25/22 21:46	276256.3			0.7			1.57			0.48			1.67			0		
06/25/22 21:47	275717.2			0.7			1.71			0.43			1.83			0		
06/25/22 21:48	276179.3			0.6			1.81			0.37			1.93			0		
06/25/22 21:49	275332.1			0.6			1.9			0.37			2.03			0		
06/25/22 21:50	274484.9			0.6			1.81			0.37			1.92			1		
06/25/22 21:51	257002.3			0.5			1.71			0.29			1.7			1		
06/25/22 21:52	233358.4			0.5			2.32			0.27			2.1			1		
06/25/22 21:53	211870.9			0.4			6.42			0.21			5.26			1		
06/25/22 21:54	187225.8			1.4			15.96			0.61			11.56			1		
06/25/22 21:55	167355.7			11.2			19.75			4.39			12.79			1		
06/25/22 21:56	149950.1			641.8			23.16			226.12			13.43			1		
06/25/22 21:57	94344.6			1759.2			27.07			390.26			9.88			1		
06/25/22 21:58	45131.4			0			32.32			269.67			5.64			0		
06/25/22 21:59	45054.3			0			0.4			0			0			0		
06/25/22 22:00	45131.4			0			0.2			0			0			0		
06/25/22 22:01	45208.4			0			0.1			0			0			0		
06/25/22 22:02	45208.4			0			0.1			0			0			0		

CT1 SUSD EVENT 25

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/26/22 10:00	41203.5			0			0			0			0			0		
06/26/22 10:01	41126.5			0			0			0			0			0		
06/26/22 10:02	40972.5			0			0			0			0			0		
06/26/22 10:03	41126.5			0			0			0			0			0		
06/26/22 10:04	41280.6			0			0			0			0			0		
06/26/22 10:05	45285.4			0			0			0			0			1		
06/26/22 10:06	49136.2			0.7			0			0			0			1		
06/26/22 10:07	56529.7			6.9			26.55			0.92			5.81			1		
06/26/22 10:08	65925.7			1047.8			18.88			162.31			4.81			1		
06/26/22 10:09	76091.8			579.8			27.53			103.71			8.1			1		
06/26/22 10:10	100582.9			315.4			24.78			74.54			9.64			1		
06/26/22 10:11	140092			188.5			41.84			62.08			22.67			1		
06/26/22 10:12	143634.8			122.6			55.94			41.38			31.08			1		
06/26/22 10:13	156650.5			989.1			53.48			364.22			32.41			1		
06/26/22 10:14	175134.3			1941.7			52.73			799.29			35.72			1		
06/26/22 10:15	195851.6			1046.9			54.9			481.82			41.58			1		
06/26/22 10:16	218956.4			175.1			54.54			90.13			46.19			1		
06/26/22 10:17	238518.5			12.1			51.84			6.75			47.83			1		
06/26/22 10:18	265012			2			47.09			1.25			48.28			1		
06/26/22 10:19	288116.8			1.7			25.9			1.15			28.86			1		
06/26/22 10:20	305599.4			1.7			13.46			1.19			15.91			1		
06/26/22 10:21	309604.2			1.7			9.92			1.24			11.88			1		
06/26/22 10:22	310682.4			1.6			9.39			1.17			11.28			1		
06/26/22 10:23	309681.2			1.4			8.31			1.04			9.96			1		
06/26/22 10:24	307986.9			1.3			7.87			0.97			9.37			1		
06/26/22 10:25	307139.7			1.2			6.97			0.84			8.28			1		
06/26/22 10:26	306523.6			1.1			6.79			0.77			8.05			1		
06/26/22 10:27	306677.6			1			6.72			0.72			7.97			1		
06/26/22 10:28	306292.5			1			6.44			0.72			7.64			1		
06/26/22 10:29	305368.3			0.9			6.17			0.65			7.29			1		
06/26/22 10:30	303365.9			0.9			6.08			0.65			7.14			1		
06/26/22 10:31	302672.8			0.8			5.99			0.58			7.01			1		
06/26/22 10:32	302210.7			0.8			6.08			0.59			7.11			1		
06/26/22 10:33	301594.6			0.8			5.99			0.59			6.99			1		

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/26/22 10:34	301825.6			0.7			5.99			0.52			7			1		
06/26/22 10:35	301748.6			0.7			6.08			0.52			7.1			1		
06/26/22 10:36	301286.5			0.7			6.18			0.53			7.2			1		
06/26/22 10:37	302826.8			0.7			6.18			0.53			7.24			1		
06/26/22 10:38	302980.8			0.7			6.18			0.53			7.24			1		
06/26/22 10:39	302672.8			0.7			6.18			0.53			7.24			1		
06/26/22 10:40	301979.6			0.6			5.9			0.46			6.89			1		
06/26/22 10:41	299669.2			0.6			5.81			0.45			6.73			1		
06/26/22 10:42	283187.7			0.6			5.81			0.43			6.36			1		
06/26/22 10:43	275101.1			0.7			6.09			0.42			6.48			1		
06/26/22 10:44	271173.3			0.6			7.52			0.36			7.88			1		
06/26/22 10:45	268862.8			0.5			6.38			0.3			6.63			1		
06/26/22 10:46	269093.8			0.5			6			0.31			6.24			1		
06/26/22 10:47	269093.8			0.5			5.51			0.31			5.74			1		
06/26/22 10:48	268708.7			0.5			4.74			0.31			4.93			1		
06/26/22 10:49	268400.7			0.5			3.97			0.31			4.12			1		
06/26/22 10:50	268246.6			0.5			3.93			0.31			4.08			1		
06/26/22 10:51	267938.6			0.5			4.03			0.31			4.18			1		
06/26/22 10:52	267630.5			0.5			4.03			0.31			4.17			1		
06/26/22 10:53	267399.5			0.5			3.74			0.31			3.87			1		
06/26/22 10:54	268323.7			0.5			2.85			0.31			2.96			1		
06/26/22 10:55	267553.5			0.5			2.75			0.31			2.85			1		
06/26/22 10:56	267553.5			0.5			2.66			0.31			2.75			1		
06/26/22 10:57	267861.6			0.4			2.46			0.25			2.55			1		
06/26/22 10:58	267476.5			0.5			2.36			0.31			2.44			1		
06/26/22 10:59	267861.6			0.4			2.26			0.25			2.34			1		
06/26/22 11:00	267245.4			0.4			2.16			0.25			2.24			1		
06/26/22 11:01	267553.5			0.4			2.07			0.25			2.14			1		
06/26/22 11:02	267553.5			0.4			1.97			0.25			2.04			1		
06/26/22 11:03	267014.4			0.4			1.87			0.25			1.93			1		
06/26/22 11:04	267707.5			0.4			1.77			0.25			1.83			1		
06/26/22 11:05	267476.5			0.4			1.67			0.25			1.73			0		
06/26/22 11:06	267630.5			0.4			1.57			0.25			1.63			0		
06/26/22 11:07	267707.5			0.4			1.48			0.25			1.53			0		
06/26/22 11:08	267014.4			0.4			1.48			0.25			1.52			0		
06/26/22 11:09	267322.4			0.4			1.38			0.25			1.42			0		

CT2 SUSD EVENT 1

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/26/22 13:34	0			0			0			0			0			0		
04/26/22 13:35	0			0			0			0			0			0		
04/26/22 13:36	0			0			0			0			0			0		
04/26/22 13:37	0			0			0			0			0			0		
04/26/22 13:38	0			0			0			0			0			0		
04/26/22 13:39	6700.4			0.1			0			0			0			1		
04/26/22 13:40	14325			0.1			0			0			0			1		
04/26/22 13:41	28033.8			1.1			0			0			0			1		
04/26/22 13:42	43514			1262.6			8.26			127.75			1.38			1		
04/26/22 13:43	54681.3			977.6			14.38			124.29			3.01			1		
04/26/22 13:44	68159.1			583.2			19.25			92.42			5.02			1		
04/26/22 13:45	99581.6			394.5			23.88			91.3			9.1			1		
04/26/22 13:46	144867			250.1			24.37			84.2			13.5			1		
04/26/22 13:47	144867			169.4			47.83			57.04			26.5			1		
04/26/22 13:48	140939.2			1140.4			41.49			373.47			22.36			1		
04/26/22 13:49	139630			2073.7			39.53			672.6			21.1			1		
04/26/22 13:50	139167.9			2191.5			41.71			708.87			22.2			1		
04/26/22 13:51	137242.5			2178.9			45.17			695.04			23.71			1		
04/26/22 13:52	137011.4			2241.2			53.52			713.38			28.04			1		
04/26/22 13:53	137319.5			2235.7			63			713.14			33.07			1		
04/26/22 13:54	136395.3			2236.3			66.16			708.84			34.51			1		
04/26/22 13:55	135779.2			2232.7			66.8			704.2			34.67			1		
04/26/22 13:56	134855			2234.2			65.32			700.17			33.69			1		
04/26/22 13:57	135086			2225.4			64.69			698.39			33.41			1		
04/26/22 13:58	134238.8			2212.3			64.06			689.83			32.87			1		
04/26/22 13:59	134238.8			2209.6			63.64			688.98			32.66			1		
04/26/22 14:00	134315.9			2219.9			63			692.69			32.36			1		
04/26/22 14:01	135009			2226.8			62.58			698.35			32.3			1		
04/26/22 14:02	133160.6			2223.9			61.74			687.97			31.43			1		
04/26/22 14:03	134700.9			2317.6			63.37			725.27			32.64			1		
04/26/22 14:04	147716.6			2330.5			62.5			799.73			35.3			1		
04/26/22 14:05	169974.3			2165.5			62.26			855.08			40.46			1		
04/26/22 14:06	191846.8			1585.7			61.15			706.7			44.85			1		
04/26/22 14:07	218263.3			543			59.3			275.4			49.51			1		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/26/22 14:08	243678.5			75.5			54.8			42.75			51.06			1		
04/26/22 14:09	268631.7			10.9			52.29			6.79			53.71			1		
04/26/22 14:10	290273.2			5.9			35.51			3.98			39.41			1		
04/26/22 14:11	295125.2			5			16.27			3.46			18.36			1		
04/26/22 14:12	294278			4.3			13.64			2.96			15.36			1		
04/26/22 14:13	293507.9			3.7			12.26			2.52			13.76			1		
04/26/22 14:14	292737.7			3.1			11.99			2.1			13.42			1		
04/26/22 14:15	293199.8			2.5			11.24			1.72			12.6			1		
04/26/22 14:16	294278			2.2			10.68			1.54			12.02			1		
04/26/22 14:17	294432.1			2.1			10.21			1.41			11.49			1		
04/26/22 14:18	294432.1			1.9			10.09			1.3			11.36			1		
04/26/22 14:19	292968.8			1.8			9.71			1.23			10.87			1		
04/26/22 14:20	292660.7			1.8			9.61			1.23			10.76			1		
04/26/22 14:21	293507.9			1.7			9.33			1.17			10.47			1		
04/26/22 14:22	293045.8			1.7			9.14			1.17			10.24			1		
04/26/22 14:23	292121.6			1.7			9.14			1.16			10.2			1		
04/26/22 14:24	292891.8			1.6			9.14			1.1			10.23			1		
04/26/22 14:25	305676.4			1.6			9.23			1.15			10.79			1		
04/26/22 14:26	306369.5			1.5			7.9			1.08			9.25			1		
04/26/22 14:27	307755.8			1.4			7.59			1			8.93			1		
04/26/22 14:28	307216.7			1.3			7.59			0.94			8.91			1		
04/26/22 14:29	307601.8			1.2			7.68			0.87			9.03			1		
04/26/22 14:30	306985.7			1.1			7.9			0.81			9.27			1		
04/26/22 14:31	305907.4			1			7.9			0.74			9.24			1		
04/26/22 14:32	306754.6			1			7.99			0.75			9.38			1		
04/26/22 14:33	305599.4			1			5.33			0.74			6.23			1		
04/26/22 14:34	307293.7			1			4			0.68			4.7			1		
04/26/22 14:35	305984.5			1			3.71			0.68			4.34			1		
04/26/22 14:36	306446.6			1			3.43			0.68			4.01			1		
04/26/22 14:37	306369.5			1			3.33			0.68			3.9			1		
04/26/22 14:38	307216.7			0.9			3.14			0.61			3.69			1		
04/26/22 14:39	306754.6			0.9			2.85			0.61			3.35			1		
04/26/22 14:40	305907.4			0.9			2.57			0.61			3.01			1		
04/26/22 14:41	305676.4			0.9			2.38			0.61			2.78			1		
04/26/22 14:42	305214.3			0.8			2.09			0.54			2.44			1		
04/26/22 14:43	305830.4			0.8			1.9			0.54			2.23			1		
04/26/22 14:44	304752.2			0.8			1.81			0.54			2.11			1		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/26/22 14:45	317382.8			0.8			1.62			0.56			1.96			1		
04/26/22 14:46	328473.1			0.8			1.52			0.58			1.91			0		
04/26/22 14:47	329012.2			0.8			1.5			0.64			1.89			0		
04/26/22 14:48	328396.1			0.8			1.48			0.63			1.85			0		
04/26/22 14:49	328165.1			0.9			1.48			0.7			1.85			0		
04/26/22 14:50	328242.1			0.9			1.38			0.7			1.74			0		

CT2 SUSD EVENT 2

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/26/22 22:01	349421.5			1			0.35			0.79			0.47			0		
04/26/22 22:02	347188			1			0.44			0.78			0.58			0		
04/26/22 22:03	331938.8			1			0.44			0.75			0.56			0		
04/26/22 22:04	328242.1			1			0.45			0.75			0.56			0		
04/26/22 22:05	328935.2			0.9			0.45			0.69			0.57			0		
04/26/22 22:06	322157.8			0.8			0.45			0.61			0.56			1		
04/26/22 22:07	301517.5			0.8			0.45			0.57			0.52			1		
04/26/22 22:08	280415.2			0.8			0.55			0.54			0.59			1		
04/26/22 22:09	255616			0.8			0.86			0.45			0.84			1		
04/26/22 22:10	231356			0.6			3.21			0.33			2.84			1		
04/26/22 22:11	206248.8			1.5			6.24			0.71			4.92			1		
04/26/22 22:12	182450.8			10			9.36			4.24			6.53			1		
04/26/22 22:13	161502.5			516.3			12.52			193.71			7.73			1		
04/26/22 22:14	142787.6			1236.1			15.57			410.05			8.5			1		
04/26/22 22:15	23797.9			1759.3			22.27			97.27			2.03			1		
04/26/22 22:16	0			0			28.52			0			0			0		
04/26/22 22:17	0			0			0.2			0			0			0		
04/26/22 22:18	0			0			0.1			0			0			0		
04/26/22 22:19	0			0			0.1			0			0			0		
04/26/22 22:20	0			0			0.1			0			0			0		

CT2 SUSD EVENT 3

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/27/22 8:39	0			0			0			0			0			0		
04/27/22 8:40	0			0			0			0			0			0		
04/27/22 8:41	0			0			0			0			0			0		
04/27/22 8:42	0			0			0			0			0			0		
04/27/22 8:43	0			0			0			0			0			0		
04/27/22 8:44	10782.2			0.1			0			0			0			1		
04/27/22 8:45	21179.4			0.1			0			0			0			1		
04/27/22 8:46	37583.8			80.6			37.37			7.04			5.37			1		
04/27/22 8:47	49136.2			1374.2			15.88			156.89			2.98			1		
04/27/22 8:48	60149.5			931.2			20.82			130.06			4.79			1		
04/27/22 8:49	74320.4			608.6			25.46			105.04			7.23			1		
04/27/22 8:50	110286.9			489.1			28.62			125.36			12.07			1		
04/27/22 8:51	150720.3			331.9			40.53			116.21			23.35			1		
04/27/22 8:52	152414.6			218.1			54.93			77.23			32.01			1		
04/27/22 8:53	163042.8			1430.1			51.96			541.64			32.39			1		
04/27/22 8:54	180679.5			1825.9			54.94			766.34			37.95			1		
04/27/22 8:55	201935.9			1315			56.64			616.99			43.74			1		
04/27/22 8:56	227274.1			498.8			55.02			263.42			47.81			1		
04/27/22 8:57	252381.3			74.6			54.15			43.75			52.26			1		
04/27/22 8:58	276410.3			6			51.48			3.86			54.41			1		
04/27/22 8:59	303365.9			2.3			41.51			1.63			48.16			1		
04/27/22 9:00	328165.1			2.1			18.18			1.6			22.81			1		
04/27/22 9:01	348959.4			1.9			12.94			1.57			17.27			1		
04/27/22 9:02	370908.9			2			10.85			1.72			15.38			1		
04/27/22 9:03	390162.9			2			8.68			1.81			12.95			1		
04/27/22 9:04	402177.4			1.8			6.25			1.73			9.62			1		
04/27/22 9:05	422432.6			1.5			5.45			1.51			8.8			1		
04/27/22 9:06	432136.6			1.4			5.36			1.37			8.85			1		
04/27/22 9:07	443843.1			1.2			5.08			1.22			8.63			1		
04/27/22 9:08	461017.6			1.1			4.79			1.18			8.45			1		
04/27/22 9:09	466331.7			1			4.61			1.1			8.22			1		
04/27/22 9:10	466331.7			0.9			4.7			1			8.38			1		
04/27/22 9:11	457705.9			0.9			4.79			0.98			8.39			1		
04/27/22 9:12	452006.8			1			4.89			1.07			8.45			1		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/27/22 9:13	448772.1			1			4.79			1.06			8.23			1		
04/27/22 9:14	449080.1			0.9			4.7			0.96			8.07			1		
04/27/22 9:15	448155.9			0.9			4.79			0.96			8.22			1		
04/27/22 9:16	446615.6			0.9			4.79			0.96			8.19			1		
04/27/22 9:17	448001.9			0.9			4.79			0.96			8.21			1		
04/27/22 9:18	448155.9			0.8			4.79			0.86			8.22			1		
04/27/22 9:19	448695.1			0.8			4.89			0.87			8.38			1		
04/27/22 9:20	446615.6			0.8			5.07			0.86			8.66			1		
04/27/22 9:21	447000.7			0.8			5.07			0.86			8.67			1		
04/27/22 9:22	447077.7			0.8			5.16			0.86			8.83			1		
04/27/22 9:23	446692.6			0.8			5.35			0.86			9.13			1		
04/27/22 9:24	447616.8			0.8			5.35			0.86			9.15			1		
04/27/22 9:25	444382.2			0.8			5.35			0.86			9.09			1		
04/27/22 9:26	443072.9			0.8			5.44			0.85			9.22			1		
04/27/22 9:27	443766			0.8			5.53			0.86			9.39			1		
04/27/22 9:28	443843.1			0.8			5.44			0.86			9.23			1		
04/27/22 9:29	445152.3			0.8			5.62			0.86			9.57			1		
04/27/22 9:30	444074.1			0.8			5.62			0.86			9.55			1		
04/27/22 9:31	443766			0.8			5.62			0.86			9.54			1		
04/27/22 9:32	443380.9			0.7			5.53			0.76			9.38			1		
04/27/22 9:33	443226.9			0.7			5.62			0.76			9.53			1		
04/27/22 9:34	444459.2			0.8			5.72			0.86			9.71			1		
04/27/22 9:35	444921.3			0.8			5.81			0.86			9.88			1		
04/27/22 9:36	442687.8			0.8			5.81			0.85			9.83			1		
04/27/22 9:37	444305.2			0.8			5.81			0.86			9.87			1		
04/27/22 9:38	441609.6			0.8			5.9			0.85			9.96			1		
04/27/22 9:39	442225.7			0.8			5.9			0.85			9.98			1		
04/27/22 9:40	446769.7			0.8			5.9			0.86			10.08			1		
04/27/22 9:41	466331.7			0.8			5.81			0.9			10.36			1		
04/27/22 9:42	480194.6			0.8			5.81			0.94			10.66			1		
04/27/22 9:43	476805.9			0.8			6.84			0.93			12.46			1		
04/27/22 9:44	476420.8			0.8			6.64			0.92			12.09			1		
04/27/22 9:45	478115.2			0.8			6.64			0.92			12.14			1		
04/27/22 9:46	481580.9			0.8			6.55			0.93			12.05			1		
04/27/22 9:47	481811.9			0.8			6.64			0.93			12.23			1		
04/27/22 9:48	483814.3			0.8			6.82			0.93			12.62			1		
04/27/22 9:49	483660.3			0.8			6.73			0.93			12.45			1		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/27/22 9:50	479886.5			0.8			6.73			0.93			12.35			1		
04/27/22 9:51	484276.4			0.8			6.73			0.93			12.46			1		
04/27/22 9:52	485354.7			0.8			6.73			0.94			12.49			1		
04/27/22 9:53	484815.5			0.7			6.82			0.83			12.65			1		
04/27/22 9:54	483506.3			0.7			6.91			0.83			12.78			1		
04/27/22 9:55	482428.1			0.7			7.01			0.83			12.93			1		
04/27/22 9:56	484738.5			0.7			7.01			0.83			12.99			1		
04/27/22 9:57	485046.6			0.8			7.1			0.94			13.17			1		
04/27/22 9:58	483891.3			0.8			7.1			0.93			13.14			1		
04/27/22 9:59	486124.8			0.8			7.1			0.94			13.2			1		
04/27/22 10:00	484430.5			0.8			7.19			0.93			13.32			1		
04/27/22 10:01	483198.2			0.7			7.74			0.83			14.31			1		
04/27/22 10:02	484892.6			0.8			7.56			0.93			14.02			1		
04/27/22 10:03	485508.7			0.8			7.38			0.94			13.69			1		
04/27/22 10:04	484353.4			0.8			7.28			0.93			13.49			1		
04/27/22 10:05	471491.8			0.8			7.19			0.91			12.96			1		
04/27/22 10:06	445460.4			0.8			7.19			0.86			12.25			1		
04/27/22 10:07	421508.4			0.8			7.08			0.8			11.41			1		
04/27/22 10:08	407799.6			0.8			4.29			0.76			6.69			1		
04/27/22 10:09	404179.8			0.9			2.15			0.84			3.32			1		
04/27/22 10:10	400175			0.9			1.88			0.83			2.87			1		
04/27/22 10:11	386543.2			0.9			1.97			0.8			2.91			1		
04/27/22 10:12	370215.8			0.9			2.55			0.76			3.62			1		
04/27/22 10:13	359510.6			1			2.73			0.81			3.75			1		
04/27/22 10:14	337715			1			2.73			0.76			3.53			1		
04/27/22 10:15	316304.6			1			3.17			0.71			3.83			1		
04/27/22 10:16	306369.5			1			3.18			0.71			3.72			1		
04/27/22 10:17	306138.5			0.9			3.13			0.66			3.67			1		
04/27/22 10:18	305522.4			0.8			3.04			0.59			3.55			1		
04/27/22 10:19	306600.6			0.7			2.77			0.53			3.24			1		
04/27/22 10:20	305522.4			0.8			2.58			0.59			3.02			1		
04/27/22 10:21	304983.3			0.7			2.3			0.52			2.69			1		
04/27/22 10:22	305753.4			0.7			2.15			0.53			2.52			1		
04/27/22 10:23	305907.4			0.6			1.94			0.46			2.26			1		
04/27/22 10:24	306292.5			0.6			1.75			0.46			2.05			1		
04/27/22 10:25	305753.4			0.7			1.69			0.47			1.97			1		
04/27/22 10:26	306061.5			0.7			1.5			0.47			1.75			0		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/27/22 10:27	306985.7			0.7			1.4			0.47			1.65			0		
04/27/22 10:28	306292.5			0.7			1.4			0.47			1.65			0		
04/27/22 10:29	305984.5			0.7			1.31			0.47			1.53			0		
04/27/22 10:30	306908.7			0.7			1.31			0.53			1.54			0		

CT2 SUSD EVENT 4

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/27/22 18:49	364670.6			0.9			1.34			0.76			1.87			0		
04/27/22 18:50	365902.9			0.9			1.34			0.76			1.88			0		
04/27/22 18:51	363900.5			0.9			1.25			0.76			1.74			0		
04/27/22 18:52	363438.4			0.9			1.25			0.75			1.74			0		
04/27/22 18:53	364824.7			0.9			1.25			0.76			1.75			0		
04/27/22 18:54	363207.3			0.9			1.25			0.75			1.74			1		
04/27/22 18:55	349113.4			0.9			1.34			0.73			1.79			1		
04/27/22 18:56	325623.5			1			1.5			0.73			1.86			1		
04/27/22 18:57	305291.3			0.9			1.79			0.63			2.09			1		
04/27/22 18:58	279491			0.8			2.21			0.54			2.36			1		
04/27/22 18:59	257233.3			0.8			3.52			0.46			3.46			1		
04/27/22 19:00	234051.5			0.7			6.51			0.39			5.83			1		
04/27/22 19:01	208328.2			1.4			21.67			0.66			17.26			1		
04/27/22 19:02	182912.9			10			25.99			4.27			18.18			1		
04/27/22 19:03	163967			578.2			29.93			220.29			18.77			1		
04/27/22 19:04	145329.1			1423			34.09			480.68			18.95			1		
04/27/22 19:05	47980.9			1893			37.61			211.02			6.9			1		
04/27/22 19:06	0			0			39.19			0			0			0		
04/27/22 19:07	0			0			0.3			0			0			0		
04/27/22 19:08	0			0			0.2			0			0			0		
04/27/22 19:09	0			0			0.2			0			0			0		
04/27/22 19:10	0			0			0.1			0			0			0		

CT2 SUSD EVENT 5

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/28/22 8:34	0			0			0			0			0			0		
04/28/22 8:35	0			0			0			0			0			0		
04/28/22 8:36	0			0			0			0			0			0		
04/28/22 8:37	0			0			0			0			0			0		
04/28/22 8:38	0			0			0			0			0			0		
04/28/22 8:39	2464.5			0			0			0			0			1		
04/28/22 8:40	22334.6			0.1			0			0			0			1		
04/28/22 8:41	36890.7			73.8			30.98			6.32			4.37			1		
04/28/22 8:42	50060.4			1293.4			16.44			150.55			3.15			1		
04/28/22 8:43	60919.6			897.1			22.56			126.92			5.25			1		
04/28/22 8:44	75783.7			589.7			27.33			103.88			7.92			1		
04/28/22 8:45	114599.8			469.1			29.21			124.94			12.8			1		
04/28/22 8:46	152799.7			319.1			43.87			113.29			25.63			1		
04/28/22 8:47	156419.4			217.1			58.19			78.91			34.81			1		
04/28/22 8:48	173671			1496.5			53.67			603.98			35.65			1		
04/28/22 8:49	179293.2			1551.9			57.26			646.48			39.26			1		
04/28/22 8:50	181141.6			1088.8			54.69			458.2			37.88			1		
04/28/22 8:51	179832.3			999.3			54.69			417.64			37.62			1		
04/28/22 8:52	177444.8			986.7			53.58			406.86			36.36			1		
04/28/22 8:53	178137.9			981.8			51.98			406.36			35.41			1		
04/28/22 8:54	176674.6			987.7			49.91			405.48			33.72			1		
04/28/22 8:55	177752.9			1009.9			48			417.07			32.62			1		
04/28/22 8:56	177675.8			1033.6			45.76			426.65			31.09			1		
04/28/22 8:57	175519.4			1055.9			43.85			430.66			29.43			1		
04/28/22 8:58	177059.7			1073			42.1			441.46			28.5			1		
04/28/22 8:59	176058.5			1084.5			40.82			443.76			27.49			1		
04/28/22 9:00	175442.4			1128			40.48			459.82			27.16			1		
04/28/22 9:01	175211.3			1143.1			39.17			465.45			26.25			1		
04/28/22 9:02	175288.4			1153.8			38.19			470.05			25.6			1		
04/28/22 9:03	189074.2			1164.1			37.2			511.52			26.9			1		
04/28/22 9:04	213719.3			759.9			38.04			377.26			31.08			1		
04/28/22 9:05	237902.3			183.2			42.53			101.24			38.69			1		
04/28/22 9:06	262316.4			18.2			45.36			11.09			45.5			1		
04/28/22 9:07	277719.6			3			46.09			1.94			48.95			1		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/28/22 9:08	279105.9			2.1			27.16			1.39			28.99			1		
04/28/22 9:09	280107.1			2			22.22			1.28			23.81			1		
04/28/22 9:10	278874.8			1.8			21.93			1.15			23.39			1		
04/28/22 9:11	278335.7			1.5			21.63			0.95			23.02			1		
04/28/22 9:12	278104.7			1.3			21.63			0.83			23.01			1		
04/28/22 9:13	279259.9			1.2			21.73			0.77			23.21			1		
04/28/22 9:14	278951.8			1.1			21.73			0.7			23.19			1		
04/28/22 9:15	278643.8			1			21.73			0.64			23.15			1		
04/28/22 9:16	278335.7			1			21.93			0.64			23.34			1		
04/28/22 9:17	277796.6			0.9			22.5			0.58			23.91			1		
04/28/22 9:18	276718.4			0.9			22.7			0.58			24.02			1		
04/28/22 9:19	278412.8			0.8			22.8			0.52			24.27			1		
04/28/22 9:20	278181.7			0.8			22.7			0.52			24.15			1		
04/28/22 9:21	277488.6			0.8			22.7			0.52			24.08			1		
04/28/22 9:22	278104.7			0.7			22.7			0.45			24.14			1		
04/28/22 9:23	277488.6			0.7			22.7			0.45			24.08			1		
04/28/22 9:24	277796.6			0.7			22.8			0.45			24.22			1		
04/28/22 9:25	276718.4			0.6			22.8			0.39			24.12			1		
04/28/22 9:26	276641.4			0.6			20.7			0.39			21.9			1		
04/28/22 9:27	276795.4			0.6			11.2			0.39			11.85			1		
04/28/22 9:28	279491			0.6			7.1			0.39			7.59			1		
04/28/22 9:29	284574			0.6			5.21			0.39			5.67			1		
04/28/22 9:30	284497			0.6			3.68			0.38			4			1		
04/28/22 9:31	284651			0.7			3.39			0.45			3.69			1		
04/28/22 9:32	284651			0.7			3.29			0.45			3.58			1		
04/28/22 9:33	284188.9			0.7			3.39			0.45			3.68			1		
04/28/22 9:34	283957.9			0.6			3.48			0.38			3.78			1		
04/28/22 9:35	285421.2			0.6			3.48			0.38			3.8			1		
04/28/22 9:36	284728.1			0.6			3.29			0.38			3.58			1		
04/28/22 9:37	283418.8			0.6			3			0.38			3.25			1		
04/28/22 9:38	283880.9			0.6			2.61			0.38			2.84			1		
04/28/22 9:39	285113.1			0.6			2.32			0.38			2.53			1		
04/28/22 9:40	285421.2			0.6			2.13			0.38			2.32			1		
04/28/22 9:41	283110.7			0.6			1.93			0.38			2.09			1		
04/28/22 9:42	283110.7			0.6			1.84			0.38			1.99			1		
04/28/22 9:43	283803.8			0.6			1.74			0.38			1.89			1		
04/28/22 9:44	284497			0.6			1.93			0.38			2.1			1		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/28/22 9:45	283418.8			0.6			1.84			0.38			1.99			0		
04/28/22 9:46	283418.8			0.6			1.74			0.38			1.89			0		
04/28/22 9:47	283264.8			0.6			1.55			0.38			1.68			0		
04/28/22 9:48	282802.7			0.6			1.45			0.38			1.57			0		
04/28/22 9:49	282417.6			0.6			1.35			0.38			1.46			0		

CT2 SUSD EVENT 6

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/28/22 16:54	272790.6			0.6			1.6			0.38			1.67			0		
04/28/22 16:55	272559.5			0.6			1.6			0.38			1.67			0		
04/28/22 16:56	272097.4			0.5			1.57			0.31			1.64			0		
04/28/22 16:57	272559.5			0.5			1.57			0.31			1.64			0		
04/28/22 16:58	272482.5			0.5			1.57			0.31			1.64			0		
04/28/22 16:59	270557.1			0.6			1.67			0.37			1.73			1		
04/28/22 17:00	256848.3			0.6			1.67			0.35			1.64			1		
04/28/22 17:01	233204.4			0.5			2.24			0.28			2			1		
04/28/22 17:02	205940.7			0.4			6.23			0.21			4.91			1		
04/28/22 17:03	183221			3.8			9.34			1.62			6.55			1		
04/28/22 17:04	161117.4			276.5			11.52			103.47			7.1			1		
04/28/22 17:05	141863.4			1068.2			14.83			352.22			8.05			1		
04/28/22 17:06	60688.6			1812.8			18.25			255.64			4.24			1		
04/28/22 17:07	0			0			22.81			0			0			0		
04/28/22 17:08	0			0			0.1			0			0			0		
04/28/22 17:09	0			0			0.1			0			0			0		
04/28/22 17:10	0			0			0.1			0			0			0		
04/28/22 17:11	0			0			0.1			0			0			0		

CT2 SUSD EVENT 7

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/03/22 23:41	0			0			0			0			0			0		
05/03/22 23:42	0			0			0			0			0			0		
05/03/22 23:43	0			0			0			0			0			0		
05/03/22 23:44	0			0			0			0			0			0		
05/03/22 23:45	4775			0			0			0			0			0		
05/03/22 23:46	12245.5			0.2			0			0			0			1		
05/03/22 23:47	27032.6			0.2			0			0			0			1		
05/03/22 23:48	40587.4			94.4			31.47			8.92			4.89			1		
05/03/22 23:49	51908.8			1177.1			15.17			142.28			3.02			1		
05/03/22 23:50	63230.1			783			19.09			115.32			4.63			1		
05/03/22 23:51	84948.6			525.7			22.98			103.91			7.47			1		
05/03/22 23:52	132390.5			381.3			24.72			117.52			12.54			1		
05/03/22 23:53	148024.7			244.5			35.64			84.23			20.2			1		
05/03/22 23:54	180140.4			462			38.94			193.69			26.87			1		
05/03/22 23:55	199548.4			1182.4			39.56			549.22			30.24			1		
05/03/22 23:56	223808.4			460.1			45.43			239.74			38.96			1		
05/03/22 23:57	248684.6			56.4			51.66			32.64			49.21			1		
05/03/22 23:58	275255.1			4.2			55.3			2.67			58.32			1		
05/03/22 23:59	299130			1.7			44.92			1.15			51.49			1		
05/04/22 0:00	325161.4			1.6			21.45			1.21			26.72			1		
05/04/22 0:01	343029.1			1.7			15.41			1.34			20.26			1		
05/04/22 0:02	369522.6			1.8			13.28			1.57			18.79			1		
05/04/22 0:03	376762.1			1.8			10.76			1.6			15.53			1		
05/04/22 0:04	388776.6			1.8			8.19			1.59			12.2			1		
05/04/22 0:05	385542			1.6			7.33			1.44			10.83			1		
05/04/22 0:06	388391.6			1.5			6.44			1.37			9.58			1		
05/04/22 0:07	384232.7			1.4			5.54			1.28			8.16			1		
05/04/22 0:08	388314.5			1.3			5.01			1.21			7.45			1		
05/04/22 0:09	382153.3			1.3			4.74			1.11			6.94			1		
05/04/22 0:10	383462.5			1.2			4.47			1.04			6.57			1		
05/04/22 0:11	382384.3			1.1			4.2			0.95			6.16			1		
05/04/22 0:12	380458.9			1.1			4.02			0.95			5.86			1		
05/04/22 0:13	383924.6			1.1			3.84			0.96			5.65			1		
05/04/22 0:14	380844			1.1			3.81			0.97			5.56			1		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/04/22 0:15	383077.4			1			3.81			0.89			5.6			1		
05/04/22 0:16	385310.9			1			3.81			0.9			5.63			1		
05/04/22 0:17	381152			1			3.72			0.89			5.43			1		
05/04/22 0:18	383462.5			1			3.72			0.89			5.47			1		
05/04/22 0:19	380767			1			3.72			0.89			5.43			1		
05/04/22 0:20	384617.8			1			3.72			0.89			5.48			1		
05/04/22 0:21	382692.4			1			3.81			0.89			5.59			1		
05/04/22 0:22	377840.4			1			3.9			0.88			5.65			1		
05/04/22 0:23	375375.8			1			3.99			0.87			5.74			1		
05/04/22 0:24	369599.7			1			4.08			0.86			5.78			1		
05/04/22 0:25	359972.7			1			4.56			0.82			6.29			1		
05/04/22 0:26	354273.5			1			3.67			0.81			4.97			1		
05/04/22 0:27	349729.5			1			2.59			0.8			3.47			1		
05/04/22 0:28	353195.3			1			2.41			0.81			3.27			1		
05/04/22 0:29	357123.1			1			2.23			0.82			3.06			1		
05/04/22 0:30	356506.9			1			1.97			0.82			2.69			1		
05/04/22 0:31	354119.4			1.1			1.79			0.88			2.43			1		
05/04/22 0:32	350268.7			1.1			1.7			0.87			2.28			1		
05/04/22 0:33	346494.8			1.1			1.61			0.87			2.14			1		
05/04/22 0:34	342104.9			1			1.7			0.78			2.23			0		
05/04/22 0:35	339640.4			1			1.7			0.78			2.21			0		
05/04/22 0:36	337484			1			1.79			0.77			2.31			0		
05/04/22 0:37	332323.9			1			1.82			0.77			2.31			0		
05/04/22 0:38	331707.8			0.9			1.82			0.7			2.31			0		

CT2 SUSD EVENT 8

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/06/22 22:35	354812.6			0.9			1.67			0.73			2.27			0		
05/06/22 22:36	341026.7			0.9			1.76			0.7			2.3			0		
05/06/22 22:37	346879.9			1			1.59			0.78			2.11			0		
05/06/22 22:38	337561			0.9			1.5			0.69			1.94			0		
05/06/22 22:39	315688.5			0.9			1.52			0.66			1.84			0		
05/06/22 22:40	79865.6			0.9			1.27			0.17			0.39			1		
05/06/22 22:41	0			0			1.04			0			0			0		
05/06/22 22:42	0			0			0			0			0			0		
05/06/22 22:43	0			0			0			0			0			0		
05/06/22 22:44	0			0			0			0			0			0		
05/06/22 22:45	0			0			0			0			0			0		

CT2 SUSD EVENT 9

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/07/22 12:38	0			0			0			0			0			0		
05/07/22 12:39	0			0			0			0			0			0		
05/07/22 12:40	0			0			0			0			0			0		
05/07/22 12:41	0			0			0			0			0			0		
05/07/22 12:42	0			0			0			0			0			0		
05/07/22 12:43	6392.3			0			0			0			0			1		
05/07/22 12:44	22950.8			0			0			0			0			1		
05/07/22 12:45	38508			79.1			24.78			7.1			3.66			1		
05/07/22 12:46	51600.7			1264.3			18.12			151.97			3.58			1		
05/07/22 12:47	61920.8			819.1			23.6			118.07			5.6			1		
05/07/22 12:48	79095.4			538.1			28.26			99.14			8.57			1		
05/07/22 12:49	124688.9			396.1			34.28			115.01			16.38			1		
05/07/22 12:50	151259.4			248.3			50.64			87.43			29.35			1		
05/07/22 12:51	190306.5			367.4			60.18			162.74			43.87			1		
05/07/22 12:52	218648.3			771.7			65.07			392.83			54.51			1		
05/07/22 12:53	245064.8			99			60.48			56.46			56.79			1		
05/07/22 12:54	270172			4.5			60.04			2.84			62.15			1		
05/07/22 12:55	296511.5			1.3			50.68			0.87			57.58			1		
05/07/22 12:56	313917.1			1.1			24.36			0.83			29.3			1		
05/07/22 12:57	314918.3			1.3			16.9			0.98			20.38			1		
05/07/22 12:58	318846.1			1.5			13.95			1.13			17.04			1		
05/07/22 12:59	322851			1.6			12.16			1.21			15.04			1		
05/07/22 13:00	325700.5			1.5			10.64			1.15			13.27			1		
05/07/22 13:01	326624.8			1.5			10.08			1.1			12.61			1		
05/07/22 13:02	328550.1			1.4			8.9			1.04			11.2			1		
05/07/22 13:03	329859.4			1.3			8.53			0.98			10.78			1		
05/07/22 13:04	327548.9			1.2			8.26			0.9			10.37			1		
05/07/22 13:05	328858.2			1.2			7.99			0.9			10.06			1		
05/07/22 13:06	328704.2			1.1			7.81			0.83			9.83			1		
05/07/22 13:07	328011			1.1			7.81			0.83			9.81			1		
05/07/22 13:08	326624.8			1			8.02			0.77			10.04			1		
05/07/22 13:09	324160.2			1			8.11			0.77			10.07			1		
05/07/22 13:10	323929.2			1			8.11			0.76			10.07			1		
05/07/22 13:11	322851			0.9			8.11			0.69			10.04			1		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/07/22 13:12	321464.7			0.9			8.11			0.69			9.99			1		
05/07/22 13:13	322696.9			0.9			8.11			0.69			10.03			1		
05/07/22 13:14	323390.1			0.9			8.2			0.69			10.16			1		
05/07/22 13:15	322465.9			0.9			8.39			0.69			10.37			1		
05/07/22 13:16	323390.1			0.9			8.57			0.69			10.62			1		
05/07/22 13:17	323852.2			0.9			8.76			0.7			10.87			1		
05/07/22 13:18	324930.4			0.8			8.94			0.63			11.13			1		
05/07/22 13:19	325084.4			0.8			9.22			0.63			11.48			1		
05/07/22 13:20	324468.3			0.8			9.59			0.63			11.92			1		
05/07/22 13:21	324160.2			0.8			9.77			0.63			12.14			1		
05/07/22 13:22	324622.3			0.8			9.5			0.63			11.81			1		
05/07/22 13:23	322542.9			0.8			5.62			0.62			6.95			1		
05/07/22 13:24	308988.1			0.8			3.87			0.6			4.58			1		
05/07/22 13:25	306831.6			0.8			3.75			0.6			4.4			1		
05/07/22 13:26	303288.9			0.8			3.9			0.54			4.53			1		
05/07/22 13:27	296280.4			0.8			4.28			0.53			4.86			1		
05/07/22 13:28	299053			0.8			4.47			0.53			5.12			1		
05/07/22 13:29	299669.2			0.7			4.38			0.46			5.03			1		
05/07/22 13:30	289888.1			0.7			3.43			0.45			3.81			1		
05/07/22 13:31	287962.7			0.7			3.24			0.45			3.57			1		
05/07/22 13:32	286268.4			0.7			3.19			0.45			3.5			1		
05/07/22 13:33	286114.3			0.6			3			0.39			3.29			1		
05/07/22 13:34	286268.4			0.7			2.8			0.45			3.08			1		
05/07/22 13:35	285421.2			0.7			2.51			0.45			2.75			1		
05/07/22 13:36	283726.8			0.6			2.32			0.38			2.52			1		
05/07/22 13:37	283033.7			0.6			2.13			0.38			2.31			1		
05/07/22 13:38	282879.7			0.6			1.93			0.38			2.1			1		
05/07/22 13:39	282109.5			0.6			1.84			0.38			1.99			1		
05/07/22 13:40	283418.8			0.6			1.64			0.38			1.79			1		
05/07/22 13:41	283880.9			0.6			1.55			0.38			1.68			1		
05/07/22 13:42	285498.2			0.6			1.55			0.39			1.69			0		
05/07/22 13:43	285498.2			0.6			1.45			0.39			1.59			0		
05/07/22 13:44	284188.9			0.6			1.35			0.38			1.47			0		
05/07/22 13:45	284497			0.6			1.26			0.38			1.37			0		
05/07/22 13:46	285883.3			0.6			1.26			0.39			1.38			0		

CT2 SUSD EVENT 10

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/08/22 5:53	287654.7			0.6			1.55			0.39			1.71			0		
05/08/22 5:54	286884.5			0.6			1.55			0.39			1.7			0		
05/08/22 5:55	287423.6			0.6			1.55			0.39			1.7			0		
05/08/22 5:56	288347.8			0.6			1.55			0.39			1.71			0		
05/08/22 5:57	286961.5			0.6			1.55			0.39			1.7			0		
05/08/22 5:58	281570.4			0.6			1.55			0.38			1.67			1		
05/08/22 5:59	277719.6			0.6			1.55			0.38			1.65			0		
05/08/22 6:00	285575.2			0.6			2.2			0.4			2.41			0		
05/08/22 6:01	289426			0.5			1.97			0.33			2.18			0		
05/08/22 6:02	308757			0.6			1.74			0.42			2.06			0		
05/08/22 6:03	329628.4			0.7			1.4			0.5			1.77			0		

CT2 SUSD EVENT 11

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/09/22 22:49	318538.1			0.7			1.57			0.55			1.91			0		
05/09/22 22:50	330629.6			0.7			1.48			0.57			1.87			0		
05/09/22 22:51	330706.6			0.7			1.27			0.56			1.61			0		
05/09/22 22:52	332709			0.8			1.16			0.62			1.48			0		
05/09/22 22:53	332709			0.9			1.25			0.69			1.6			0		
05/09/22 22:54	333094.1			0.9			1.34			0.69			1.71			1		
05/09/22 22:55	321387.7			0.9			1.34			0.67			1.65			1		
05/09/22 22:56	299284.1			0.9			1.36			0.63			1.56			1		
05/09/22 22:57	277950.7			0.8			1.94			0.54			2.06			1		
05/09/22 22:58	252227.3			0.8			4.16			0.45			4.02			1		
05/09/22 22:59	227659.2			0.6			9.17			0.34			8			1		
05/09/22 23:00	203168.1			2.9			16.66			1.37			12.97			1		
05/09/22 23:01	180294.4			152.1			19.11			63.85			13.2			1		
05/09/22 23:02	160039.2			742.1			21.83			276.41			13.38			1		
05/09/22 23:03	130234			1453.4			24.27			440.51			12.11			1		
05/09/22 23:04	0			0			25.02			0			0			1		
05/09/22 23:05	0			0			17.7			0			0			0		
05/09/22 23:06	0			0			0.1			0			0			0		
05/09/22 23:07	0			0			0.1			0			0			0		
05/09/22 23:08	0			0			0.1			0			0			0		
05/09/22 23:09	0			0			0.1			0			0			0		

CT2 SUSD EVENT 12

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/17/22 17:16	0			0			0			0			0			0		
05/17/22 17:17	0			0			0			0			0			0		
05/17/22 17:18	0			0			0			0			0			0		
05/17/22 17:19	0			0			0			0			0			0		
05/17/22 17:20	2541.5			0			0			0			0			0		
05/17/22 17:21	1001.2			0.1			0			0			0			1		
05/17/22 17:22	10705.2			0.1			0			0			0			1		
05/17/22 17:23	27725.8			1			0.2			0			0			1		
05/17/22 17:24	41742.7			1103.9			15.34			107.24			2.45			1		
05/17/22 17:25	55220.5			863.8			15.96			110.99			3.38			1		
05/17/22 17:26	65925.7			517.4			19.47			79.46			4.92			1		
05/17/22 17:27	95037.7			318.9			23.6			70.52			8.59			1		
05/17/22 17:28	142864.6			189.8			24.58			63.13			13.46			1		
05/17/22 17:29	145252.1			122.3			44.35			41.36			24.69			1		
05/17/22 17:30	152876.7			866			36.14			308.23			21.17			1		
05/17/22 17:31	155957.3			1634.5			31.47			593.44			18.8			1		
05/17/22 17:32	171591.6			1571.7			32.97			627.98			21.68			1		
05/17/22 17:33	195389.5			961.7			46.54			437.43			34.84			1		
05/17/22 17:34	223192.3			272			60.58			141.3			51.8			1		
05/17/22 17:35	246605.1			26.2			63.52			15.06			60.02			1		
05/17/22 17:36	273098.6			2.8			59.45			1.77			62.19			1		
05/17/22 17:37	301902.6			1.9			37.9			1.34			43.84			1		
05/17/22 17:38	318230			1.9			18.99			1.43			23.16			1		
05/17/22 17:39	342104.9			2			13.77			1.57			18.04			1		
05/17/22 17:40	357816.2			1.9			12.16			1.56			16.67			1		
05/17/22 17:41	353657.3			1.8			9.33			1.45			12.65			1		
05/17/22 17:42	355043.6			1.8			8.31			1.48			11.31			1		
05/17/22 17:43	354119.4			1.7			7.42			1.4			10.07			1		
05/17/22 17:44	353888.4			1.6			6.35			1.33			8.6			1		
05/17/22 17:45	355659.8			1.4			5.9			1.18			8.04			1		
05/17/22 17:46	353657.3			1.3			5.18			1.1			7.03			1		
05/17/22 17:47	362822.3			1.3			5.01			1.06			6.96			1		
05/17/22 17:48	383077.4			1.2			4.45			1.05			6.53			1		
05/17/22 17:49	392627.4			1.1			4.06			1.01			6.1			1		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/17/22 17:50	397248.4			1			3.84			0.95			5.84			1		
05/17/22 17:51	387929.4			0.9			3.75			0.85			5.57			1		
05/17/22 17:52	374990.8			0.9			4.03			0.82			5.79			1		
05/17/22 17:53	366056.9			0.9			4.15			0.79			5.82			1		
05/17/22 17:54	365132.7			1			3.99			0.85			5.59			1		
05/17/22 17:55	367982.3			1			3.96			0.87			5.59			1		
05/17/22 17:56	388006.5			0.9			3.87			0.83			5.76			1		
05/17/22 17:57	408415.7			0.9			3.47			0.89			5.42			1		
05/17/22 17:58	425359.2			0.9			3.33			0.85			5.43			1		
05/17/22 17:59	427284.6			0.9			4.19			0.85			6.85			1		
05/17/22 18:00	433522.9			0.9			3.71			0.86			6.16			1		
05/17/22 18:01	447539.8			0.8			3.14			0.79			5.38			1		
05/17/22 18:02	454856.3			0.8			3.43			0.81			5.97			1		
05/17/22 18:03	454779.3			0.7			2.53			0.79			4.41			1		
05/17/22 18:04	456935.8			0.7			1.97			0.8			3.44			1		
05/17/22 18:05	452468.8			0.7			1.69			0.79			2.92			1		
05/17/22 18:06	457089.8			0.7			1.5			0.8			2.62			1		
05/17/22 18:07	455241.4			0.8			1.4			0.89			2.45			1		
05/17/22 18:08	456165.6			0.7			1.31			0.8			2.29			0		
05/17/22 18:09	455241.4			0.7			1.31			0.79			2.29			0		
05/17/22 18:10	457551.9			0.7			1.4			0.8			2.46			0		
05/17/22 18:11	457243.8			0.7			1.4			0.8			2.46			0		
05/17/22 18:12	456088.6			0.8			1.5			0.89			2.62			0		

CT2 SUSD EVENT 13

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/19/22 22:53	425359.2			0.8			0.64			0.81			1.04			0		
05/19/22 22:54	424127			0.8			0.55			0.82			0.9			0		
05/19/22 22:55	403794.8			0.8			0.64			0.77			0.98			0		
05/19/22 22:56	389238.7			0.8			0.72			0.73			1.07			0		
05/19/22 22:57	385079.9			0.8			0.7			0.71			1.04			0		
05/19/22 22:58	381152			0.8			0.72			0.71			1.04			1		
05/19/22 22:59	363361.3			0.8			0.72			0.68			1			1		
05/19/22 23:00	340333.6			0.8			0.79			0.63			1.03			1		
05/19/22 23:01	316381.6			0.9			0.97			0.65			1.17			1		
05/19/22 23:02	295356.3			0.9			1.16			0.61			1.32			1		
05/19/22 23:03	272867.6			0.7			1.57			0.47			1.64			1		
05/19/22 23:04	245835			0.6			3.1			0.33			2.92			1		
05/19/22 23:05	224039.5			0.5			7.9			0.27			6.78			1		
05/19/22 23:06	198470.2			2.9			19.09			1.34			14.51			1		
05/19/22 23:07	175442.4			145.5			25.04			59.45			16.84			1		
05/19/22 23:08	155110.2			711.2			28.62			256.8			17			1		
05/19/22 23:09	127307.4			1404			32.53			416.12			15.87			1		
05/19/22 23:10	0			0			36.78			0			0			1		
05/19/22 23:11	0			0			94.4			0			0			0		
05/19/22 23:12	0			0			0.2			0			0			0		
05/19/22 23:13	0			0			0.2			0			0			0		
05/19/22 23:14	0			0			0.1			0			0			0		
05/19/22 23:15	0			0			0.1			0			0			0		

CT2 SUSD EVENT 14

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/24/22 3:35	0			0			0			0			0			0		
05/24/22 3:36	0			0			0			0			0			0		
05/24/22 3:37	0			0			0			0			0			0		
05/24/22 3:38	55528.5			0			0			0			0			0		
05/24/22 3:39	1617.3			0			0			0			0			0		
05/24/22 3:40	15249.2			0.2			0			0			0			1		
05/24/22 3:41	28572.9			1.2			0			0			0			1		
05/24/22 3:42	42743.9			1248.3			19.39			124.06			3.17			1		
05/24/22 3:43	53988.2			1022.2			14.75			128.36			3.05			1		
05/24/22 3:44	65848.7			645.3			18.32			98.94			4.62			1		
05/24/22 3:45	90647.8			453.2			21.63			95.66			7.52			1		
05/24/22 3:46	137935.6			344.6			24.67			110.7			13.04			1		
05/24/22 3:47	155649.3			219.8			41.96			79.67			25.02			1		
05/24/22 3:48	182681.9			705.8			42.22			300.18			29.55			1		
05/24/22 3:49	208867.3			1010.7			49.17			491.4			39.34			1		
05/24/22 3:50	233435.4			258.8			56.75			140.63			50.76			1		
05/24/22 3:51	255076.9			24.3			56.66			14.45			55.38			1		
05/24/22 3:52	283418.8			2.2			53.54			1.44			58.14			1		
05/24/22 3:53	303905			1.6			33.4			1.13			38.89			1		
05/24/22 3:54	308063.9			1.5			18.15			1.11			21.43			1		
05/24/22 3:55	301286.5			1.7			15.76			1.17			18.19			1		
05/24/22 3:56	290889.3			1.8			14.62			1.19			16.29			1		
05/24/22 3:57	290735.3			1.6			15.61			1.11			17.39			1		
05/24/22 3:58	289657.1			1.5			15.95			0.99			17.7			1		
05/24/22 3:59	288963.9			1.4			15.49			0.93			17.15			1		
05/24/22 4:00	290427.2			1.4			14.93			0.93			16.62			1		
05/24/22 4:01	303442.9			1.3			14.29			0.91			16.61			1		
05/24/22 4:02	306600.6			1.2			11.44			0.84			13.44			1		
05/24/22 4:03	308526			1.2			10.08			0.85			11.91			1		
05/24/22 4:04	304213.1			1.2			9.08			0.84			10.58			1		
05/24/22 4:05	301132.4			1.2			8.99			0.83			10.37			1		
05/24/22 4:06	304059.1			1.1			9.13			0.78			10.63			1		
05/24/22 4:07	308680			1			9.22			0.73			10.9			1		
05/24/22 4:08	304983.3			1			8.48			0.72			9.91			1		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/24/22 4:09	298745			1.1			8.39			0.77			9.6			1		
05/24/22 4:10	297743.8			1			8.85			0.7			10.09			1		
05/24/22 4:11	301902.6			1			9.59			0.71			11.09			1		
05/24/22 4:12	305368.3			1			9.22			0.72			10.79			1		
05/24/22 4:13	306215.5			1			8.39			0.72			9.84			1		
05/24/22 4:14	301363.5			1			8.11			0.71			9.37			1		
05/24/22 4:15	296434.5			1			8.39			0.7			9.53			1		
05/24/22 4:16	299053			1			9.18			0.72			10.52			1		
05/24/22 4:17	301902.6			0.9			9.65			0.66			11.16			1		
05/24/22 4:18	304675.2			0.9			9.22			0.65			10.76			1		
05/24/22 4:19	302518.8			0.9			8.76			0.65			10.15			1		
05/24/22 4:20	296665.5			0.9			8.67			0.64			9.85			1		
05/24/22 4:21	295664.3			0.9			9.18			0.64			10.4			1		
05/24/22 4:22	299053			0.9			10.21			0.65			11.7			1		
05/24/22 4:23	303211.9			0.8			10.11			0.59			11.75			1		
05/24/22 4:24	304290.1			0.9			7.19			0.65			8.38			1		
05/24/22 4:25	298667.9			0.9			3.87			0.64			4.43			1		
05/24/22 4:26	295202.2			0.9			3.65			0.64			4.13			1		
05/24/22 4:27	296973.6			0.8			4.31			0.58			4.9			1		
05/24/22 4:28	301440.5			0.8			4.78			0.59			5.52			1		
05/24/22 4:29	304829.2			0.8			4.5			0.6			5.25			1		
05/24/22 4:30	301517.5			0.8			3.32			0.58			3.83			1		
05/24/22 4:31	295741.3			0.8			2.95			0.57			3.34			1		
05/24/22 4:32	294201			0.9			2.72			0.64			3.06			1		
05/24/22 4:33	300208.3			0.8			2.72			0.59			3.12			1		
05/24/22 4:34	304752.2			0.8			2.53			0.6			2.95			1		
05/24/22 4:35	300362.3			0.8			2.06			0.59			2.37			1		
05/24/22 4:36	296126.4			0.8			1.78			0.58			2.02			1		
05/24/22 4:37	294586.1			0.8			1.69			0.58			1.9			1		
05/24/22 4:38	299130			0.8			1.69			0.59			1.93			1		
05/24/22 4:39	302133.7			0.8			1.69			0.59			1.95			0		
05/24/22 4:40	300208.3			0.8			1.5			0.59			1.72			0		
05/24/22 4:41	296126.4			0.8			1.31			0.58			1.49			0		
05/24/22 4:42	292968.8			0.8			1.31			0.57			1.47			0		
05/24/22 4:43	300131.3			0.8			1.4			0.59			1.62			0		

CT2 SUSD EVENT 15

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/25/22 23:08	311991.7			0.7	X		0.84			0.54	X		1.01			0		
05/25/22 23:09	312453.8			0.7	X		0.75			0.54	X		0.9			0		
05/25/22 23:10	310990.5			0.7	X		0.75			0.54	X		0.89			0		
05/25/22 23:11	311221.5			0.8	X		0.75			0.61	X		0.89			0		
05/25/22 23:12	310374.4			0.8	X		0.75			0.61	X		0.89			0		
05/25/22 23:13	311221.5			0.8	X		0.75			0.61	X		0.89			1		
05/25/22 23:14	298051.8			0.8	X		0.84			0.58	X		0.96			1		
05/25/22 23:15	276718.4			0.8	X		0.84			0.54	X		0.89			1		
05/25/22 23:16	251534.2			0.8	X		1.26			0.45	X		1.21			1		
05/25/22 23:17	230277.8			0.7	X		3.7			0.38	X		3.26			1		
05/25/22 23:18	202012.9			0.7	X		9.4			0.31	X		7.27			1		
05/25/22 23:19	178137.9			21.9			14.63			9.08			9.99			1		
05/25/22 23:20	158344.8			291.6			17.56			107.49			10.66			1		
05/25/22 23:21	138243.7			1027.2			21.69			330.66			11.49			1		
05/25/22 23:22	12014.5			1689.4			26.37			47.27			1.21			1		
05/25/22 23:23	0			0			28.03			0			0			0		
05/25/22 23:24	0			0			0.2			0			0			0		
05/25/22 23:25	0			0	X		0.1			0	X		0			0		
05/25/22 23:26	0			0	X		0.1			0	X		0			0		
05/25/22 23:27	0			0	X		0.1			0	X		0			0		

CT2 SUSD EVENT 16

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/26/22 14:34	0			0	X		0			0	X		0			0		
05/26/22 14:35	0			0	X		0			0	X		0			0		
05/26/22 14:36	0			0	X		0			0	X		0			0		
05/26/22 14:37	0			0	X		0			0	X		0			0		
05/26/22 14:38	0			0	X		0			0	X		0			0		
05/26/22 14:39	10705.2			0.4	X		0			0	X		0			1		
05/26/22 14:40	21564.5			0.2	X		0			0	X		0			1		
05/26/22 14:41	35735.4			1032.5			29.5			85.98			4.04			1		
05/26/22 14:42	47826.9			1097			16.91			122.04			3.1			1		
05/26/22 14:43	59071.3			755.9			23.27			103.89			5.26			1		
05/26/22 14:44	73473.2			463.3			25.85			79.23			7.27			1		
05/26/22 14:45	112751.4			339.8			32.72			89.22			14.14			1		
05/26/22 14:46	148794.9			205.6			45.78			71.18			26.09			1		
05/26/22 14:47	14479			163.9			57.1			5.54			3.18			1		
05/26/22 14:48	0			0			46.13			0			0			0		
05/26/22 14:49	0			0			0.5			0			0			0		
05/26/22 14:50	0			0	X		0.5			0	X		0			0		
05/26/22 14:51	0			0	X		0.4			0	X		0			0		
05/26/22 14:52	0			0	X		0.4			0	X		0			0		

CT2 SUSD EVENT 17

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/26/22 14:42	47826.9			1097			16.91			122.04			3.1			1		
05/26/22 14:43	59071.3			755.9			23.27			103.89			5.26			1		
05/26/22 14:44	73473.2			463.3			25.85			79.23			7.27			1		
05/26/22 14:45	112751.4			339.8			32.72			89.22			14.14			1		
05/26/22 14:46	148794.9			205.6			45.78			71.18			26.09			1		
05/26/22 14:47	14479			163.9			57.1			5.54			3.18			1		
05/26/22 14:48	0			0			46.13			0			0			0		
05/26/22 14:49	0			0			0.5			0			0			0		
05/26/22 14:50	0			0	X		0.5			0	X		0			0		
05/26/22 14:51	0			0	X		0.4			0	X		0			0		
05/26/22 14:52	0			0	X		0.4			0	X		0			0		

CT2 SUSD EVENT 18

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/07/22 11:35	0			0	X		0	X		0	X		0	X		0		
06/07/22 11:36	0			0	X		0	X		0	X		0	X		0		
06/07/22 11:37	0			0	X		0	X		0	X		0	X		0		
06/07/22 11:38	0			0	X		0	X		0	X		0	X		0		
06/07/22 11:39	1617.3			0	X		0	X		0	X		0	X		0		
06/07/22 11:40	15942.3			38.2	X		0	X		0	X		0	X		1		
06/07/22 11:41	28649.9			39.6	X		0	X		0	X		0	X		1		
06/07/22 11:42	42204.8			1218.4	X		19.67	X		120.82	X		3.21	X		1		
06/07/22 11:43	53834.2			986.8	X		15.49	X		124.8	X		3.22	X		1		
06/07/22 11:44	64924.5			622.3	X		19.56	X		95	X		4.92	X		1		
06/07/22 11:45	87644.2			397	X		23.32	X		81.75	X		7.9	X		1		
06/07/22 11:46	133468.7			253.4	X		24.11	X		79.48	X		12.45	X		1		
06/07/22 11:47	157035.6			157.1	X		43.92	X		57.99	X		26.68	X		1		
06/07/22 11:48	208559.3			454.3	X		42.59	X		222.71	X		34.36	X		1		
06/07/22 11:49	242677.3			428.5	X		58.38	X		244.41	X		54.8	X		1		
06/07/22 11:50	270249			28.3	X		50.74	X		17.99	X		53.05	X		1		
06/07/22 11:51	295818.3			24	X		44.51	X		16.7	X		50.93	X		1		
06/07/22 11:52	309604.2			20.1	X		26.32	X		14.65	X		31.52	X		1		
06/07/22 11:53	310682.4			15.8	X		18.32	X		11.51	X		22.01	X		1		
06/07/22 11:54	309989.3			13.8	X		16.09	X		10.03	X		19.3	X		1		
06/07/22 11:55	307139.7			14.3	X		14.16	X		10.29	X		16.82	X		1		
06/07/22 11:56	306908.7			14	X		13.07	X		10.08	X		15.52	X		1		
06/07/22 11:57	306138.5			15.9	X		12.26	X		11.41	X		14.52	X		1		
06/07/22 11:58	305214.3			16.2	X		11.62	X		11.64	X		13.71	X		1		
06/07/22 11:59	306061.5			18.2	X		10.51	X		13.07	X		12.44	X		1		
06/07/22 12:00	305214.3			17.1	X		9.96	X		12.3	X		11.76	X		1		
06/07/22 12:01	305060.3			17.7	X		9.27	X		12.69	X		10.94	X		1		
06/07/22 12:02	304752.2			18.1	X		8.71	X		12.95	X		10.27	X		1		
06/07/22 12:03	293738.9			17	X		8.24	X		11.7	X		9.36	X		1		
06/07/22 12:04	290119.2			14.8	X		8.43	X		10.09	X		9.46	X		1		
06/07/22 12:05	302441.7			16.3	X		9.8	X		11.57	X		11.47	X		1		
06/07/22 12:06	306908.7			18.1	X		7.9	X		13.04	X		9.38	X		1		
06/07/22 12:07	307293.7			16.4	X		7.3	X		11.84	X		8.68	X		1		
06/07/22 12:08	303674			17.7	X		7.21	X		12.64	X		8.47	X		1		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/07/22 12:09	300208.3			18.8	X		7.02	X		13.28	X		8.16	X		1		
06/07/22 12:10	298590.9			18.7	X		7.23	X		13.16	X		8.35	X		1		
06/07/22 12:11	301209.5			19.4	X		7.61	X		13.74	X		8.87	X		1		
06/07/22 12:12	303057.8			17.3	X		7.61	X		12.34	X		8.92	X		1		
06/07/22 12:13	304829.2			16.3	X		7.42	X		11.66	X		8.75	X		1		
06/07/22 12:14	305214.3			17.4	X		7.33	X		12.49	X		8.65	X		1		
06/07/22 12:15	302903.8			16.4	X		7.23	X		11.65	X		8.47	X		1		
06/07/22 12:16	297743.8			17.9	X		7.23	X		12.52	X		8.33	X		1		
06/07/22 12:17	295895.4			18	X		7.61	X		12.51	X		8.71	X		1		
06/07/22 12:18	300978.4			19.4	X		8.09	X		13.73	X		9.42	X		1		
06/07/22 12:19	303674			18.5	X		8.09	X		13.18	X		9.5	X		1		
06/07/22 12:20	304290.1			19.8	X		7.9	X		14.16	X		9.3	X		1		
06/07/22 12:21	299669.2			17.6	X		7.9	X		12.4	X		9.16	X		1		
06/07/22 12:22	296126.4			16.6	X		7.99	X		11.52	X		9.16	X		1		
06/07/22 12:23	298282.9			17.3	X		8.37	X		12.14	X		9.66	X		1		
06/07/22 12:24	301363.5			16.9	X		7.71	X		12	X		8.98	X		1		
06/07/22 12:25	300747.4			17.6	X		4.76	X		12.44	X		5.54	X		1		
06/07/22 12:26	304675.2			17.7	X		4.38	X		12.67	X		5.16	X		1		
06/07/22 12:27	299977.2			19.7	X		3.71	X		13.89	X		4.31	X		1		
06/07/22 12:28	295125.2			18.7	X		3.52	X		13	X		4.02	X		1		
06/07/22 12:29	296819.6			18.9	X		3.43	X		13.21	X		3.93	X		1		
06/07/22 12:30	300131.3			19	X		3.58	X		13.37	X		4.15	X		1		
06/07/22 12:31	303211.9			16.7	X		3.33	X		11.87	X		3.91	X		1		
06/07/22 12:32	304213.1			17.2	X		2.95	X		12.31	X		3.47	X		1		
06/07/22 12:33	299130			17.2	X		2.76	X		12.11	X		3.19	X		1		
06/07/22 12:34	296049.4			17.4	X		2.66	X		12.12	X		3.05	X		1		
06/07/22 12:35	295202.2			18.5	X		2.57	X		12.81	X		2.93	X		1		
06/07/22 12:36	297512.7			21	X		2.61	X		14.68	X		3.01	X		1		
06/07/22 12:37	299823.2			18.7	X		2.57	X		13.14	X		2.98	X		1		
06/07/22 12:38	302518.8			18.1	X		2.47	X		12.85	X		2.89	X		1		
06/07/22 12:39	302056.7			18.7	X		2.38	X		13.31	X		2.78	X		1		
06/07/22 12:40	298822			17.6	X		2.19	X		12.37	X		2.53	X		1		
06/07/22 12:41	294894.2			16.7	X		2.09	X		11.54	X		2.39	X		1		
06/07/22 12:42	299130			17.3	X		2	X		12.18	X		2.31	X		1		
06/07/22 12:43	303442.9			17.7	X		2	X		12.62	X		2.35	X		1		
06/07/22 12:44	299438.1			17.9	X		1.9	X		12.59	X		2.2	X		1		
06/07/22 12:45	295356.3			19.8	X		1.81	X		13.74	X		2.07	X		1		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/07/22 12:46	293970			18.7	X		1.81	X		12.95	X		2.06	X		1		
06/07/22 12:47	298590.9			19	X		2	X		13.36	X		2.31	X		1		
06/07/22 12:48	303674			18.1	X		2.09	X		12.91	X		2.46	X		1		
06/07/22 12:49	304367.1			16.3	X		2	X		11.64	X		2.35	X		1		
06/07/22 12:50	306677.6			17.2	X		1.81	X		12.41	X		2.14	X		1		
06/07/22 12:51	313994.1			17	X		1.71	X		12.57	X		2.08	X		1		
06/07/22 12:52	315996.5			17.7	X		1.71	X		13.15	X		2.09	X		1		
06/07/22 12:53	318846.1			18.6	X		1.69	X		13.97	X		2.08	X		1		
06/07/22 12:54	317305.8			20.3	X		1.59	X		15.16	X		1.95	X		1		
06/07/22 12:55	313840.1			17.4	X		1.48	X		12.85	X		1.79	X		1		
06/07/22 12:56	313069.9			17.4	X		1.38	X		12.82	X		1.67	X		1		
06/07/22 12:57	314456.2			17.9	X		1.38	X		13.22	X		1.68	X		1		
06/07/22 12:58	317459.8			17.1	X		1.38	X		12.72	X		1.7	X		1		
06/07/22 12:59	314302.2			16.2	X		1.38	X		11.99	X		1.68	X		1		
06/07/22 13:00	308988.1			15.5	X		1.38	X		11.25	X		1.65	X		1		
06/07/22 13:01	301979.6			41.6	X		1.39	X		29.56	X		1.62	X		1		
06/07/22 13:02	299284.1			34.3	X		1.42	X		24.11	X		1.65	X		1		
06/07/22 13:03	294894.2			21.5	X		1.43	X		14.9	X		1.63	X		1		
06/07/22 13:04	299130			16.3	X		0.69	X		11.47	X		0.8	X		1		
06/07/22 13:05	301671.6			79.4	X		0	X		56.33	X		0	X		1		
06/07/22 13:06	303905			80.1	X		0	X		57.19	X		0	X		1		
06/07/22 13:07	300901.4			85.3	X		0	X		60.35	X		0	X		1		
06/07/22 13:08	295895.4			84.5	X		0	X		58.77	X		0	X		1		
06/07/22 13:09	293276.8			87	X		0	X		59.98	X		0	X		1		
06/07/22 13:10	295587.3			83.7	X		0	X		58.12	X		0	X		1		
06/07/22 13:11	302749.8			90.6	X		0	X		64.48	X		0	X		1		
06/07/22 13:12	299900.2			86.6	X		0	X		61.05	X		0	X		1		
06/07/22 13:13	296280.4			43	X		1.3	X		29.94	X		1.49	X		1		
06/07/22 13:14	294586.1			20	X		1.35	X		13.86	X		1.54	X		1		
06/07/22 13:15	294432.1			19.4	X		1.31	X		13.46	X		1.49	X		1		
06/07/22 13:16	299053			41.3	X		0.49	X		29.03	X		0.57	X		1		
06/07/22 13:17	303057.8			109.9	X		0.28	X		78.25	X		0.33	X		1		
06/07/22 13:18	301979.6			76.5	X		0	X		54.29	X		0	X		1		
06/07/22 13:19	299284.1			82	X		0	X		57.65	X		0	X		1		
06/07/22 13:20	295279.3			0.4	X		0	X		0.29	X		0	X		1		
06/07/22 13:21	294586.1			88.9	X		0	X		61.57	X		0	X		1		
06/07/22 13:22	296819.6			55.9	X		1.05	X		38.97	X		1.2	X		1		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/07/22 13:23	301363.5			12.3	X		2.41	X		8.72	X		2.8	X		1		
06/07/22 13:24	302287.7			9.4	X		2.47	X		6.69	X		2.89	X		1		
06/07/22 13:25	298282.9			2.8	X		2.48	X		1.94	X		2.87	X		1		
06/07/22 13:26	295664.3			9.1	X		2.48	X		6.36	X		2.84	X		1		
06/07/22 13:27	296357.5			10.7	X		10.33	X		7.47	X		11.84	X		1		
06/07/22 13:28	300362.3			12.2	X		12.2	X		8.61	X		14.17	X		1		
06/07/22 13:29	301748.6			12.1	X		12.14	X		8.61	X		14.17	X		1		
06/07/22 13:30	301517.5			12.1	X		12.14	X		8.6	X		14.16	X		1		
06/07/22 13:31	299438.1			12.1	X		12.14	X		8.54	X		14.06	X		1		
06/07/22 13:32	296049.4			21.3	X		21.32	X		14.84	X		24.42	X		1		
06/07/22 13:33	294740.1			25.6	X		25.63	X		17.75	X		29.22	X		1		
06/07/22 13:34	297666.7			22.9	X		1.71	X		16.05	X		1.97	X		1		
06/07/22 13:35	300593.3			18.4	X		1.62	X		12.97	X		1.88	X		1		
06/07/22 13:36	304136.1			18.7	X		1.52	X		13.4	X		1.79	X		1		
06/07/22 13:37	302595.8			18.7	X		1.43	X		13.33	X		1.67	X		1		
06/07/22 13:38	308988.1			20.9	X		1.33	X		15.2	X		1.59	X		1		
06/07/22 13:39	321926.8			19.6	X		1.33	X		14.83	X		1.66	X		1		
06/07/22 13:40	325777.6			20.2	X		1.31			15.49	X		1.65			1		
06/07/22 13:41	321926.8			17.9	X		1.2			13.53	X		1.49			1		
06/07/22 13:42	318846.1			17.2	X		1.2			12.92	X		1.48			1		
06/07/22 13:43	330321.5			16.8	X		1.2			13.02	X		1.53			1		
06/07/22 13:44	350730.8			17.2	X		1.2			14.21	X		1.63			0		
06/07/22 13:45	361513			17.2	X		1.07			14.58	X		1.5			0		
06/07/22 13:46	361744			17.2	X		0.89			14.59	X		1.25			0		
06/07/22 13:47	358201.3			18.3	X		0.8			15.43	X		1.11			0		
06/07/22 13:48	353657.3			17.8	X		0.8			14.79	X		1.1			0		

CT2 SUSD EVENT 19

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/07/22 19:52	370292.8			0.8	X		0.27	X		0.7	X		0.38	X		0		
06/07/22 19:53	370985.9			0.8	X		0.26	X		0.69	X		0.38	X		0		
06/07/22 19:54	360049.7			0.8			0.26			0.67			0.37			0		
06/07/22 19:55	360203.7			0.9			0.26			0.75			0.37			0		
06/07/22 19:56	347727.1			0.9			0.26			0.72			0.36			0		
06/07/22 19:57	337252.9			0.9			0.26			0.7			0.34			1		
06/07/22 19:58	317767.9			0.9			0.27			0.67			0.33			1		
06/07/22 19:59	295895.4			0.8			0.36			0.57			0.42			1		
06/07/22 20:00	272482.5			0.7			0.37			0.47			0.39			1		
06/07/22 20:01	245295.9			0.7			0.57			0.38			0.54			1		
06/07/22 20:02	224655.6			0.5			2.07			0.27			1.8			1		
06/07/22 20:03	197623			2.2			3.06			1			2.34			1		
06/07/22 20:04	174441.2			150.8			3.85			61.86			2.6			1		
06/07/22 20:05	155033.2			694.9			4.57			253.23			2.74			1		
06/07/22 20:06	114291.7			1474.8			5.39			396.16			2.38			1		
06/07/22 20:07	0			0			6.77			0			0			0		
06/07/22 20:08	0			0			11.8			0			0			0		
06/07/22 20:09	0			0			0.1			0			0			0		
06/07/22 20:10	0			0			0.1			0			0			0		
06/07/22 20:11	0			0			0.1			0			0			0		

CT2 SUSD EVENT 20

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/08/22 14:09	0			0			0			0			0			0		
06/08/22 14:10	0			0			0			0			0			0		
06/08/22 14:11	0			0			0			0			0			0		
06/08/22 14:12	0			0			0			0			0			0		
06/08/22 14:13	0			0			0			0			0			0		
06/08/22 14:14	10320.1			0			0			0			0			1		
06/08/22 14:15	28187.8			1			0.2			0			0			1		
06/08/22 14:16	41357.6			1087.4			15.93			105.64			2.55			1		
06/08/22 14:17	53218			918.7			16.66			114.95			3.43			1		
06/08/22 14:18	64693.4			536.3			22.13			81.51			5.53			1		
06/08/22 14:19	89415.5			344.1			25.21			72.32			8.72			1		
06/08/22 14:20	136626.3			203.6			35.89			65.38			18.97			1		
06/08/22 14:21	147408.6			128.6			51.68			44.55			29.47			1		
06/08/22 14:22	167663.8			562.1			50.78			221.45			32.92			1		
06/08/22 14:23	185454.5			1046.3			52.76			456.02			37.85			1		
06/08/22 14:24	212102			429.6			52.04			214.18			42.7			1		
06/08/22 14:25	235206.8			70.5			51.76			39			47.1			1		
06/08/22 14:26	262316.4			4.2			49.05			2.57			49.77			1		
06/08/22 14:27	289426			1.4			39.23			0.99			43.92			1		
06/08/22 14:28	307062.7			1.3			16.3			0.95			19.35			1		
06/08/22 14:29	307370.8			1.4			9.74			1.03			11.58			1		
06/08/22 14:30	307986.9			1.5			7.35			1.12			8.76			1		
06/08/22 14:31	305214.3			1.5			6.26			1.11			7.39			1		
06/08/22 14:32	305368.3			1.4			5.35			0.99			6.32			1		
06/08/22 14:33	304829.2			1.3			4.7			0.92			5.54			1		
06/08/22 14:34	307678.8			1.1			4.06			0.8			4.83			1		
06/08/22 14:35	326547.7			1			3.78			0.78			4.77			1		
06/08/22 14:36	349498.5			1			3.6			0.83			4.86			1		
06/08/22 14:37	361744			1			2.63			0.85			3.68			1		
06/08/22 14:38	368367.4			1			2.15			0.85			3.06			1		
06/08/22 14:39	381075			1			2.06			0.88			3.03			1		
06/08/22 14:40	398249.6			1			1.97			0.92			3.03			1		
06/08/22 14:41	422740.7			0.9			1.63			0.9			2.67			1		
06/08/22 14:42	449080.1			0.8			1.57			0.88			2.72			1		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/08/22 14:43	459400.3			0.7			1.59			0.81			2.83			1		
06/08/22 14:44	456935.8			0.7			1.84			0.79			3.26			0		
06/08/22 14:45	463174.1			0.7			1.84			0.8			3.3			0		
06/08/22 14:46	456319.6			0.7			1.84			0.79			3.25			0		
06/08/22 14:47	456396.7			0.7			1.94			0.79			3.42			0		
06/08/22 14:48	458476.1			0.7			2.03			0.79			3.6			0		

CT2 SUSD EVENT 21

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/09/22 2:45	280492.2			0.7			2.81			0.43			3.05			0		
06/09/22 2:46	280338.1			0.6			3.52			0.38			3.82			0		
06/09/22 2:47	282186.5			0.5			2.66			0.32			2.91			0		
06/09/22 2:48	282494.6			0.5			1.43			0.32			1.56			0		
06/09/22 2:49	282109.5			0.5			1.05			0.32			1.14			0		
06/09/22 2:50	277103.5			0.6			0.66			0.37			0.7			1		
06/09/22 2:51	255847.1			0.6			0.67			0.34			0.66			1		
06/09/22 2:52	231510			0.5			1.73			0.28			1.55			1		
06/09/22 2:53	204169.3			0.9			3.34			0.43			2.64			1		
06/09/22 2:54	181064.5			10.1			4.43			4.29			3.1			1		
06/09/22 2:55	159808.1			587.3			5.06			220.61			3.13			1		
06/09/22 2:56	142017.5			1430.1			7.38			477.3			4.05			1		
06/09/22 2:57	0			1899.8			12.35			0			0			1		
06/09/22 2:58	0			0			19.18			0			0			0		
06/09/22 2:59	0			0			0.1			0			0			0		
06/09/22 3:00	0			0			0.1			0			0			0		
06/09/22 3:01	0			0			0.1			0			0			0		
06/09/22 3:02	0			0			0			0			0			0		

CT2 SUSD EVENT 22

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/09/22 10:34	0			0			0			0			0			0		
06/09/22 10:35	0			0			0			0			0			0		
06/09/22 10:36	0			0			0			0			0			0		
06/09/22 10:37	0			0			0			0			0			0		
06/09/22 10:38	0			0			0			0			0			0		
06/09/22 10:39	3234.7			0			0			0			0			1		
06/09/22 10:40	19947.1			0			0			0			0			1		
06/09/22 10:41	34734.2			47.2			5.9			3.86			0.79			1		
06/09/22 10:42	47749.9			1185.9			4.33			133			0.8			1		
06/09/22 10:43	57993			828.6			7.54			112.96			1.69			1		
06/09/22 10:44	72857.1			491.2			10.33			84.11			2.91			1		
06/09/22 10:45	107591.3			310.6			13.41			78.55			5.58			1		
06/09/22 10:46	144559			184.6			18.17			62.71			10.16			1		
06/09/22 10:47	149488			144.8			31.21			50.9			18.05			1		
06/09/22 10:48	160347.3			1307.2			30.79			492.77			19.1			1		
06/09/22 10:49	178600			1491.8			33.49			626.14			23.13			1		
06/09/22 10:50	203399.2			755.4			35.56			361.16			27.98			1		
06/09/22 10:51	229276.5			158.6			39.65			85.46			35.16			1		
06/09/22 10:52	253228.5			11.4			41.54			6.81			40.69			1		
06/09/22 10:53	281570.4			1.8			41.3			1.21			44.98			1		
06/09/22 10:54	306908.7			1.4			20.21			0.98			24			1		
06/09/22 10:55	328242.1			1.4			11.8			1.1			14.98			1		
06/09/22 10:56	349267.4			1.5			9.21			1.25			12.44			1		
06/09/22 10:57	357662.2			1.5			8.28			1.26			11.45			1		
06/09/22 10:58	359433.5			1.4			6.33			1.17			8.81			1		
06/09/22 10:59	360588.8			1.3			6.25			1.1			8.71			1		
06/09/22 11:00	359818.6			1.2			5.81			1.03			8.09			1		
06/09/22 11:01	358740.4			1.2			5.64			1.02			7.83			1		
06/09/22 11:02	358586.4			1.1			5.64			0.95			7.82			1		
06/09/22 11:03	355582.8			1.1			5.72			0.88			7.87			1		
06/09/22 11:04	343491.3			1.1			5.81			0.85			7.72			1		
06/09/22 11:05	332863			1			6.6			0.76			8.5			1		
06/09/22 11:06	326547.7			1			7.06			0.75			8.92			1		
06/09/22 11:07	318230			0.9			7.24			0.67			8.91			1		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/09/22 11:08	312530.8			0.8			6.35			0.6			7.68			1		
06/09/22 11:09	305830.4			0.8			3.36			0.59			3.97			1		
06/09/22 11:10	302441.7			0.7			2.95			0.52			3.45			1		
06/09/22 11:11	300824.4			0.7			3.13			0.52			3.65			1		
06/09/22 11:12	300824.4			0.6			3.41			0.46			3.97			1		
06/09/22 11:13	301748.6			0.6			3.41			0.46			3.98			1		
06/09/22 11:14	301363.5			0.6			3.23			0.46			3.76			1		
06/09/22 11:15	301132.4			0.6			2.77			0.46			3.22			1		
06/09/22 11:16	300824.4			0.7			2.53			0.46			2.94			1		
06/09/22 11:17	297974.8			0.7			2.25			0.46			2.59			1		
06/09/22 11:18	297820.8			0.7			2.06			0.46			2.37			1		
06/09/22 11:19	297127.6			0.7			1.97			0.46			2.26			1		
06/09/22 11:20	297050.6			0.7			1.87			0.46			2.15			1		
06/09/22 11:21	296049.4			0.7			1.78			0.46			2.04			1		
06/09/22 11:22	296588.5			0.7			1.62			0.46			1.86			1		
06/09/22 11:23	296973.6			0.6			1.52			0.4			1.75			0		
06/09/22 11:24	298205.8			0.6			1.43			0.4			1.65			0		
06/09/22 11:25	296819.6			0.6			1.33			0.4			1.53			0		
06/09/22 11:26	295510.3			0.6			1.24			0.4			1.41			0		
06/09/22 11:27	299284.1			3.6	X		1.72	X		2.57	X		1.99	X		0		

CT2 SUSD EVENT 23

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/10/22 22:50	462403.9			0.7			1.48			0.8			2.64			0		
06/10/22 22:51	472570			0.6			1.48			0.72			2.7			0		
06/10/22 22:52	467409.9			0.6			1.48			0.71			2.67			0		
06/10/22 22:53	469951.5			0.6			1.48			0.71			2.68			0		
06/10/22 22:54	465022.4			0.7			1.48			0.81			2.65			0		
06/10/22 22:55	469181.3			0.7			1.48			0.81			2.68			1		
06/10/22 22:56	451236.6			0.7			1.48			0.78			2.57			1		
06/10/22 22:57	431905.6			0.7			1.57			0.75			2.62			1		
06/10/22 22:58	411188.3			0.7			1.72			0.7			2.74			1		
06/10/22 22:59	384925.8			0.7			2.06			0.65			3.06			1		
06/10/22 23:00	363746.4			0.8			2.47			0.68			3.47			1		
06/10/22 23:01	331322.7			0.8			2.78			0.61			3.56			1		
06/10/22 23:02	311144.5			0.9			2.91			0.64			3.5			1		
06/10/22 23:03	287269.6			0.8			3.54			0.55			3.93			1		
06/10/22 23:04	266552.3			0.7			4.4			0.47			4.54			1		
06/10/22 23:05	240828.9			0.6			7.35			0.33			6.85			1		
06/10/22 23:06	215952.8			0.5			23.39			0.27			19.53			1		
06/10/22 23:07	188304			2.8			29.5			1.25			21.49			1		
06/10/22 23:08	167817.8			240.3			33.25			94.77			21.59			1		
06/10/22 23:09	147870.7			945.5			36.16			328.69			20.69			1		
06/10/22 23:10	74089.4			1646.4			36.61			286.73			10.49			1		
06/10/22 23:11	0			0			39.05			0			0			0		
06/10/22 23:12	0			0			0.3			0			0			0		
06/10/22 23:13	0			0			0.2			0			0			0		
06/10/22 23:14	0			0			0.2			0			0			0		
06/10/22 23:15	0			0			0.1			0			0			0		

CT2 SUSD EVENT 24

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/11/22 0:39	0			0			0			0			0			0		
06/11/22 0:40	0			0			0			0			0			0		
06/11/22 0:41	0			0			0			0			0			0		
06/11/22 0:42	0			0			0			0			0			0		
06/11/22 0:43	0			0			0			0			0			0		
06/11/22 0:44	2926.6			0			0			0			0			1		
06/11/22 0:45	21179.4			0			0			0			0			1		
06/11/22 0:46	32808.8			35.4			21.63			2.73			2.75			1		
06/11/22 0:47	47595.9			727			11.38			81.36			2.1			1		
06/11/22 0:48	58455.1			583.8			16.66			80.23			3.77			1		
06/11/22 0:49	73550.3			364.6			18.88			63.01			5.37			1		
06/11/22 0:50	113906.6			277.6			23.6			74.31			10.4			1		
06/11/22 0:51	144250.9			204.1			35.4			69.23			19.76			1		
06/11/22 0:52	154494			264.3			45.63			95.97			27.26			1		
06/11/22 0:53	175519.4			1494.7			45.73			616.65			31.05			1		
06/11/22 0:54	199394.4			1060			49.17			496.87			37.93			1		
06/11/22 0:55	224809.6			303.3			48.93			160.32			42.56			1		
06/11/22 0:56	250070.9			28.6			46.95			16.83			45.42			1		
06/11/22 0:57	275255.1			2.1			47.09			1.37			50.13			1		
06/11/22 0:58	288655.9			1.4			25.9			0.95			28.92			1		
06/11/22 0:59	290119.2			1.3			14.01			0.88			15.72			1		
06/11/22 1:00	295279.3			1.3			13.71			0.88			15.65			1		
06/11/22 1:01	295895.4			1.2			12.16			0.82			13.92			1		
06/11/22 1:02	295741.3			1.1			11.62			0.76			13.29			1		
06/11/22 1:03	293276.8			1			11.43			0.7			12.97			1		
06/11/22 1:04	294817.2			0.9			11.15			0.64			12.72			1		
06/11/22 1:05	298745			0.8			8.76			0.58			10.12			1		
06/11/22 1:06	319154.2			0.8			4.15			0.62			5.12			1		
06/11/22 1:07	342644.1			0.8			2.9			0.66			3.85			1		
06/11/22 1:08	360357.7			0.8			3.04			0.68			4.24			1		
06/11/22 1:09	354966.6			0.9			2.82			0.73			3.87			1		
06/11/22 1:10	333864.3			1			2.82			0.76			3.64			1		
06/11/22 1:11	311067.5			1			2.95			0.72			3.55			1		
06/11/22 1:12	288193.8			0.9			3.27			0.61			3.64			1		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/11/22 1:13	281493.4			0.7			3.84			0.5			4.18			1		
06/11/22 1:14	284034.9			0.7			4.76			0.44			5.23			1		
06/11/22 1:15	286653.4			0.6			4.19			0.38			4.64			1		
06/11/22 1:16	288039.8			0.6			3.33			0.39			3.71			1		
06/11/22 1:17	288501.8			0.6			2.57			0.39			2.87			1		
06/11/22 1:18	287269.6			0.6			2.38			0.39			2.64			1		
06/11/22 1:19	286345.4			0.6			2.19			0.38			2.42			1		
06/11/22 1:20	286961.5			0.6			2.09			0.39			2.32			1		
06/11/22 1:21	285190.2			0.6			2			0.38			2.2			1		
06/11/22 1:22	286037.3			0.5			1.9			0.32			2.11			1		
06/11/22 1:23	285575.2			0.5			1.81			0.32			2			1		
06/11/22 1:24	287192.6			0.5			1.71			0.32			1.9			1		
06/11/22 1:25	284805.1			0.6			1.62			0.38			1.78			0		
06/11/22 1:26	284574			0.6			1.52			0.38			1.68			0		
06/11/22 1:27	284420			0.6			1.52			0.38			1.67			0		
06/11/22 1:28	284574			0.6			1.43			0.38			1.57			0		
06/11/22 1:29	285344.2			0.6			1.33			0.38			1.47			0		

CT2 SUSD EVENT 25

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/12/22 1:50	285960.3			0.5			1.97			0.31			2.18			0		
06/12/22 1:51	282802.7			0.5			1.97			0.31			2.15			0		
06/12/22 1:52	283880.9			0.5			1.87			0.31			2.06			0		
06/12/22 1:53	287115.5			0.5			1.78			0.32			1.98			0		
06/12/22 1:54	285806.3			0.5			1.59			0.31			1.76			0		
06/12/22 1:55	283649.8			0.5			1.5			0.31			1.64			1		
06/12/22 1:56	261007.1			0.5			1.4			0.29			1.42			1		
06/12/22 1:57	240597.9			0.5			2.61			0.27			2.43			1		
06/12/22 1:58	212872.1			0.4			8.53			0.21			7.03			1		
06/12/22 1:59	188689.1			3.5			13.69			1.57			9.99			1		
06/12/22 2:00	166739.6			255.6			16.49			100.17			10.64			1		
06/12/22 2:01	146407.4			955.6			21.03			328.79			11.91			1		
06/12/22 2:02	53834.2			1664.8			26.03			210.56			5.42			1		
06/12/22 2:03	0			0			35.4			0			0			0		
06/12/22 2:04	0			0			0.2			0			0			0		
06/12/22 2:05	0			0			0.1			0			0			0		
06/12/22 2:06	0			0			0.1			0			0			0		
06/12/22 2:07	0			0			0.1			0			0			0		

CT2 SUSD EVENT 26

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/12/22 12:18	0			0			0			0			0			0		
06/12/22 12:19	0			0			0			0			0			0		
06/12/22 12:20	0			0			0			0			0			0		
06/12/22 12:21	0			0			0			0			0			0		
06/12/22 12:22	0			0			0			0			0			0		
06/12/22 12:23	7393.5			-0.1			0			0			0			1		
06/12/22 12:24	25415.3			0.3			0			0			0			1		
06/12/22 12:25	38893.1			78.4			21.07			7.16			3.17			1		
06/12/22 12:26	51061.6			1170.8			15.86			140.47			3.13			1		
06/12/22 12:27	62228.9			723.2			21.74			105.71			5.23			1		
06/12/22 12:28	80250.6			463.9			26.13			87.53			8.11			1		
06/12/22 12:29	125305			325.5			31.3			95.89			15.17			1		
06/12/22 12:30	152337.6			196.9			45.23			70.52			26.66			1		
06/12/22 12:31	193849.2			397.1			51.81			180.91			38.84			1		
06/12/22 12:32	195620.6			522.5			55.27			240.22			41.82			1		
06/12/22 12:33	215105.6			140.4			50.42			70.99			41.96			1		
06/12/22 12:34	237979.4			47.6			52.59			26.62			48.41			1		
06/12/22 12:35	261007.1			3.2			50.79			1.99			51.28			1		
06/12/22 12:36	290966.3			1			43.16			0.71			48.58			1		
06/12/22 12:37	312299.8			0.9			18.54			0.69			22.4			1		
06/12/22 12:38	331476.8			1.1			12.24			0.89			15.7			1		
06/12/22 12:39	336713.8			1.3			10.39			1.05			13.53			1		
06/12/22 12:40	325469.5			1.4			9.77			1.08			12.3			1		
06/12/22 12:41	326316.7			1.3			8.54			1.01			10.78			1		
06/12/22 12:42	329551.3			1.3			8.4			0.97			10.71			1		
06/12/22 12:43	340179.6			1.1			8.22			0.86			10.82			1		
06/12/22 12:44	359972.7			1			7.78			0.83			10.83			1		
06/12/22 12:45	376762.1			1			5.9			0.86			8.6			1		
06/12/22 12:46	398480.6			1			4.83			0.92			7.44			1		
06/12/22 12:47	424589.1			0.9			4.43			0.92			7.27			1		
06/12/22 12:48	434601.1			0.8			4.5			0.86			7.56			1		
06/12/22 12:49	416733.4			0.7			4.5			0.73			7.25			1		
06/12/22 12:50	392242.3			0.6			5.07			0.59			7.69			1		
06/12/22 12:51	366133.9			0.7			5.63			0.62			7.97			1		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/12/22 12:52	342644.1			0.8			5.9			0.65			7.82			1		
06/12/22 12:53	343799.3			0.9			6.08			0.71			8.08			1		
06/12/22 12:54	364285.6			0.9			6.17			0.77			8.69			1		
06/12/22 12:55	375529.9			0.8			4.92			0.71			7.14			1		
06/12/22 12:56	369214.6			0.7			4.9			0.63			7			1		
06/12/22 12:57	363053.3			0.7			5.54			0.62			7.78			1		
06/12/22 12:58	365132.7			0.7			5.72			0.61			8.08			1		
06/12/22 12:59	383693.6			0.7			4.83			0.64			7.16			1		
06/12/22 13:00	401407.3			0.7			2.27			0.69			3.52			1		
06/12/22 13:01	410880.2			0.7			1.59			0.63			2.53			1		
06/12/22 13:02	413190.7			0.6			1.48			0.63			2.36			1		
06/12/22 13:03	416502.4			0.6			1.57			0.63			2.52			1		
06/12/22 13:04	440300.3			0.7			1.59			0.68			2.71			0		
06/12/22 13:05	444382.2			0.7			1.87			0.68			3.22			0		
06/12/22 13:06	442687.8			0.7			2.15			0.68			3.69			0		
06/12/22 13:07	438143.9			0.7			2.15			0.68			3.65			0		
06/12/22 13:08	448310			0.7			2.15			0.69			3.74			0		

CT2 SUSD EVENT 27

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/12/22 23:50	277565.6			0.5			2.51			0.32			2.7			0		
06/12/22 23:51	278720.8			0.5			1.64			0.32			1.77			0		
06/12/22 23:52	278874.8			0.5			1.35			0.32			1.46			0		
06/12/22 23:53	277950.7			0.5			1.06			0.32			1.14			0		
06/12/22 23:54	278720.8			0.5			0.97			0.32			1.04			0		
06/12/22 23:55	272559.5			0.5			0.97			0.31			1.02			1		
06/12/22 23:56	248607.6			0.5			1.16			0.28			1.12			1		
06/12/22 23:57	223885.4			0.4			3.52			0.22			3.05			1		
06/12/22 23:58	200087.5			2.2			5.79			1.01			4.48			1		
06/12/22 23:59	177213.8			104			7.7			43.33			5.28			1		
06/13/22 0:00	157343.6			653			9.5			241.49			5.78			1		
06/13/22 0:01	114137.7			1500.8			14.33			402.46			6.32			1		
06/13/22 0:02	0			0			16.65			0			0			0		
06/13/22 0:03	0			0			17.7			0			0			0		
06/13/22 0:04	0			0			0.1			0			0			0		
06/13/22 0:05	0			0			0.1			0			0			0		
06/13/22 0:06	0			0			0.1			0			0			0		

CT2 SUSD EVENT 28

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/13/22 18:06	0			0			0			0			0			0		
06/13/22 18:07	0			0			0			0			0			0		
06/13/22 18:08	0			0			0			0			0			0		
06/13/22 18:09	0			0			0			0			0			0		
06/13/22 18:10	0			0			0			0			0			0		
06/13/22 18:11	1771.4			-0.1			0			0			0			1		
06/13/22 18:12	17482.6			-0.1			0			0			0			1		
06/13/22 18:13	31884.6			82.6			82.6			6.19			10.19			1		
06/13/22 18:14	45285.4			1126.9			18.15			120.07			3.18			1		
06/13/22 18:15	56606.7			808			23.25			107.43			5.09			1		
06/13/22 18:16	69776.5			508.6			28.26			83.46			7.63			1		
06/13/22 18:17	102123.2			341.1			34			81.85			13.43			1		
06/13/22 18:18	145175.1			204.3			44.5			69.69			24.98			1		
06/13/22 18:19	153569.8			130.6			60.18			47.12			35.74			1		
06/13/22 18:20	160193.2			1071.2			56.42			403.32			34.96			1		
06/13/22 18:21	178831.1			1434.2			56.14			602.93			38.84			1		
06/13/22 18:22	201319.8			766.4			56.45			362.65			43.96			1		
06/13/22 18:23	229507.6			194.3			56.75			104.81			50.39			1		
06/13/22 18:24	252766.4			15.5			55.56			9.2			54.32			1		
06/13/22 18:25	279876			2.1			56.33			1.39			60.99			1		
06/13/22 18:26	298745			1.6			32.3			1.12			37.33			1		
06/13/22 18:27	302441.7			1.6			16.59			1.11			19.42			1		
06/13/22 18:28	317151.8			1.6			13.34			1.22			16.37			1		
06/13/22 18:29	329089.3			1.6			10.62			1.26			13.52			1		
06/13/22 18:30	330937.6			1.5			9.44			1.2			12.08			1		
06/13/22 18:31	332632			1.4			8.67			1.12			11.16			1		
06/13/22 18:32	332169.9			1.4			7.9			1.06			10.15			1		
06/13/22 18:33	331630.8			1.3			7.06			0.98			9.06			1		
06/13/22 18:34	332709			1.1			6.79			0.84			8.74			1		
06/13/22 18:35	331553.8			1.1			6.62			0.84			8.48			1		
06/13/22 18:36	327934			1.1			6.44			0.83			8.16			1		
06/13/22 18:37	327471.9			1			6.26			0.76			7.93			1		
06/13/22 18:38	326316.7			1			6.17			0.75			7.79			1		
06/13/22 18:39	327703			0.9			6.26			0.7			7.94			1		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/13/22 18:40	328242.1			0.9			6.35			0.7			8.07			1		
06/13/22 18:41	327009.8			0.8			6.44			0.63			8.15			1		
06/13/22 18:42	328088			0.8			6.54			0.63			8.29			1		
06/13/22 18:43	336097.7			0.8			6.63			0.65			8.61			1		
06/13/22 18:44	339640.4			0.8			7.26			0.65			9.54			1		
06/13/22 18:45	337252.9			0.8			7.08			0.65			9.24			1		
06/13/22 18:46	340102.5			0.8			6.99			0.65			9.19			1		
06/13/22 18:47	340718.7			0.8			6.88			0.64			9.07			1		
06/13/22 18:48	331938.8			0.8			7.06			0.63			9.07			1		
06/13/22 18:49	314225.2			0.8			6.88			0.59			8.37			1		
06/13/22 18:50	311606.6			0.8			7.19			0.61			8.67			1		
06/13/22 18:51	307986.9			0.6			6.91			0.47			8.24			1		
06/13/22 18:52	299207.1			0.6			4.24			0.45			4.91			1		
06/13/22 18:53	290504.3			0.6			4.03			0.38			4.52			1		
06/13/22 18:54	287808.7			0.6			4.31			0.38			4.8			1		
06/13/22 18:55	286884.5			0.6			4.66			0.38			5.17			1		
06/13/22 18:56	286961.5			0.5			4.09			0.32			4.54			1		
06/13/22 18:57	287808.7			0.5			3.52			0.32			3.92			1		
06/13/22 18:58	289118			0.5			3.24			0.32			3.62			1		
06/13/22 18:59	289965.1			0.5			2.76			0.32			3.1			1		
06/13/22 19:00	289503			0.6			2.38			0.39			2.66			1		
06/13/22 19:01	289657.1			0.6			2			0.39			2.24			1		
06/13/22 19:02	289888.1			0.5			1.81			0.32			2.03			1		
06/13/22 19:03	287192.6			0.5			1.64			0.33			1.83			1		
06/13/22 19:04	287269.6			0.5			1.64			0.33			1.83			1		
06/13/22 19:05	287038.5			0.6			1.55			0.39			1.72			0		
06/13/22 19:06	286653.4			0.5			1.55			0.33			1.72			0		
06/13/22 19:07	286576.4			0.5			1.45			0.33			1.61			0		
06/13/22 19:08	286191.3			0.5			1.45			0.33			1.61			0		
06/13/22 19:09	286268.4			0.5			1.35			0.33			1.5			0		

CT2 SUSD EVENT 29

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/13/22 21:35	291043.3			0.6			0.95			0.39			1.07			0		
06/13/22 21:36	290350.2			0.6			0.95			0.39			1.07			0		
06/13/22 21:37	291967.6			0.6			1.05			0.39			1.18			0		
06/13/22 21:38	291505.5			0.6			1.14			0.39			1.29			0		
06/13/22 21:39	290889.3			0.6			1.14			0.39			1.28			0		
06/13/22 21:40	287038.5			0.6			1.24			0.39			1.37			1		
06/13/22 21:41	265628.1			0.6			1.43			0.36			1.47			1		
06/13/22 21:42	241214			0.6			3.34			0.33			3.12			1		
06/13/22 21:43	214412.5			0.5			9.12			0.27			7.56			1		
06/13/22 21:44	190229.5			3			15.58			1.32			11.46			1		
06/13/22 21:45	167740.8			198.9			20.25			78.39			13.14			1		
06/13/22 21:46	147562.6			787.3			23.75			272.98			13.55			1		
06/13/22 21:47	57222.9			1567.1			28.78			210.82			6.37			1		
06/13/22 21:48	0			0			31.86			0			0			0		
06/13/22 21:49	0			0			0.2			0			0			0		
06/13/22 21:50	0			0			0.1			0			0			0		
06/13/22 21:51	0			0			0.1			0			0			0		
06/13/22 21:52	0			0			0.1			0			0			0		

CT2 SUSD EVENT 30

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/14/22 17:56	0			0			0			0			0			0		
06/14/22 17:57	0			0			0			0			0			0		
06/14/22 17:58	0			0			0			0			0			0		
06/14/22 17:59	0			0			0			0			0			0		
06/14/22 18:00	0			0			0			0			0			0		
06/14/22 18:01	3234.7			-0.1			0			0			0			1		
06/14/22 18:02	21949.6			0			0			0			0			1		
06/14/22 18:03	37891.9			92.9			35.4			8.28			5.19			1		
06/14/22 18:04	47518.9			1021.5			18.88			114.1			3.47			1		
06/14/22 18:05	60534.6			645.4			24.91			91.88			5.84			1		
06/14/22 18:06	77709.1			389.7			28.32			71.18			8.51			1		
06/14/22 18:07	121839.3			247			37.01			70.71			17.44			1		
06/14/22 18:08	147177.5			143.2			52.65			49.52			29.96			1		
06/14/22 18:09	147485.6			217.3			65.28			75.36			37.25			1		
06/14/22 18:10	161656.5			1538.2			59.57			584.31			37.24			1		
06/14/22 18:11	183683.1			1269.7			58.65			548.26			41.68			1		
06/14/22 18:12	208559.3			525.1			60.4			257.42			48.73			1		
06/14/22 18:13	235052.8			90.6			62.57			50.03			56.89			1		
06/14/22 18:14	257233.3			5.8			59.35			3.5			59.06			1		
06/14/22 18:15	286730.5			1.8			53.1			1.23			58.9			1		
06/14/22 18:16	308526			1.6			24.18			1.19			28.86			1		
06/14/22 18:17	313840.1			1.6			14.52			1.21			17.63			1		
06/14/22 18:18	313378			1.7			11.62			1.27			14.08			1		
06/14/22 18:19	324314.3			1.7			10.53			1.31			13.21			1		
06/14/22 18:20	324622.3			1.5			10.08			1.18			12.65			1		
06/14/22 18:21	323467.1			1.4			8.99			1.04			11.24			1		
06/14/22 18:22	327625.9			1.3			8.26			0.98			10.47			1		
06/14/22 18:23	325161.4			1.1			7.99			0.83			10.05			1		
06/14/22 18:24	326162.7			1.1			7.62			0.84			9.62			1		
06/14/22 18:25	327009.8			1			7.44			0.77			9.42			1		
06/14/22 18:26	325931.6			1			7.44			0.76			9.38			1		
06/14/22 18:27	324083.2			0.9			7.35			0.69			9.22			1		
06/14/22 18:28	327394.9			0.9			7.35			0.7			9.31			1		
06/14/22 18:29	323236			0.8			7.44			0.62			9.31			1		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/14/22 18:30	322773.9			0.8			7.53			0.62			9.41			1		
06/14/22 18:31	322773.9			0.9			7.65			0.7			9.55			1		
06/14/22 18:32	321618.7			0.9			7.84			0.7			9.75			1		
06/14/22 18:33	319847.3			0.8			8.02			0.62			9.92			1		
06/14/22 18:34	309373.2			0.8			8.11			0.6			9.71			1		
06/14/22 18:35	286884.5			0.7			8.33			0.51			9.25			1		
06/14/22 18:36	280261.1			0.8			9.23			0.5			10.01			1		
06/14/22 18:37	278643.8			0.7			12.48			0.44			13.45			1		
06/14/22 18:38	278258.7			0.6			13.08			0.39			14.08			1		
06/14/22 18:39	279799			0.6			13.67			0.39			14.79			1		
06/14/22 18:40	279722			0.6			13.87			0.39			15			1		
06/14/22 18:41	278874.8			0.5			13.96			0.32			15.06			1		
06/14/22 18:42	278720.8			0.5			8.95			0.32			9.65			1		
06/14/22 18:43	280261.1			0.6			4.92			0.39			5.33			1		
06/14/22 18:44	283572.8			0.5			4.33			0.33			4.75			1		
06/14/22 18:45	285267.2			0.5			4.33			0.33			4.77			1		
06/14/22 18:46	285498.2			0.5			4.16			0.32			4.59			1		
06/14/22 18:47	283572.8			0.5			4.16			0.32			4.56			1		
06/14/22 18:48	281724.4			0.5			3.97			0.32			4.32			1		
06/14/22 18:49	281262.3			0.6			3.74			0.39			4.07			1		
06/14/22 18:50	282109.5			0.6			3.15			0.39			3.43			1		
06/14/22 18:51	280492.2			0.5			2.66			0.32			2.88			1		
06/14/22 18:52	280646.2			0.5			2.46			0.32			2.67			1		
06/14/22 18:53	291967.6			0.5			2.36			0.34			2.67			1		
06/14/22 18:54	312915.9			0.5			2.03			0.36			2.46			1		
06/14/22 18:55	336405.8			0.6			1.33			0.45			1.73			1		
06/14/22 18:56	345724.7			0.6			1.2			0.52			1.6			1		
06/14/22 18:57	342644.1			0.7			1			0.58			1.32			1		
06/14/22 18:58	350191.6			0.7			0.73			0.6			0.98			0		
06/14/22 18:59	366210.9			0.8			0.72			0.69			1.01			0		
06/14/22 19:00	389007.7			0.7			0.73			0.66			1.09			0		
06/14/22 19:01	397094.3			0.7			0.65			0.69			0.99			0		
06/14/22 19:02	399712.9			0.6			0.65			0.61			1			0		

CT2 SUSD EVENT 31

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/20/22 22:48	308526			0.8			1.91			0.59			2.28			0		
06/20/22 22:49	290042.2			0.8			1.72			0.56			1.93			0		
06/20/22 22:50	281801.4			0.7			1.87			0.5			2.04			0		
06/20/22 22:51	282571.6			0.8			2.19			0.51			2.39			0		
06/20/22 22:52	282571.6			0.7			2.09			0.44			2.29			0		
06/20/22 22:53	281724.4			0.7			1.62			0.44			1.76			1		
06/20/22 22:54	261854.3			0.7			1.43			0.41			1.45			1		
06/20/22 22:55	240058.8			0.7			2.85			0.39			2.65			1		
06/20/22 22:56	213411.3			0.6			7.94			0.32			6.55			1		
06/20/22 22:57	186301.6			4.7			11.56			2.06			8.33			1		
06/20/22 22:58	164891.2			278.8			14.75			108.02			9.41			1		
06/20/22 22:59	145021.1			990.7			20.49			337.76			11.5			1		
06/20/22 23:00	60765.6			1693.5			26.64			241.85			6.26			1		
06/20/22 23:01	0			0			30.89			0			0			0		
06/20/22 23:02	0			0			0.2			0			0			0		
06/20/22 23:03	0			0			0.1			0			0			0		
06/20/22 23:04	0			0			0.1			0			0			0		
06/20/22 23:05	0			0			0.1			0			0			0		

CT2 SUSD EVENT 32

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/21/22 19:19	0			0			0			0			0			0		
06/21/22 19:20	0			0			0			0			0			0		
06/21/22 19:21	0			0			0			0			0			0		
06/21/22 19:22	0			0			0			0			0			0		
06/21/22 19:23	0			0			0			0			0			0		
06/21/22 19:24	2387.5			0			0			0			0			1		
06/21/22 19:25	17482.6			0			0			0			0			1		
06/21/22 19:26	30729.4			94.4			47.2			6.83			5.62			1		
06/21/22 19:27	44900.3			1145.1			18.68			120.73			3.24			1		
06/21/22 19:28	55605.5			868.7			21.86			113.56			4.7			1		
06/21/22 19:29	67312			478.5			26.26			75.73			6.84			1		
06/21/22 19:30	99042.5			282.4			32.99			65.74			12.64			1		
06/21/22 19:31	141863.4			159.1			43.19			53.05			23.71			1		
06/21/22 19:32	147254.5			102.4			57.67			35.43			32.84			1		
06/21/22 19:33	158036.8			977			54.02			362.82			33.02			1		
06/21/22 19:34	178137.9			1427.6			55.42			597.59			38.18			1		
06/21/22 19:35	201781.8			617.3			56.05			292.82			43.75			1		
06/21/22 19:36	230123.7			117.7			57.35			63.67			51.05			1		
06/21/22 19:37	252612.4			8.2			56.23			4.86			54.94			1		
06/21/22 19:38	280338.1			2			52.99			1.34			57.47			1		
06/21/22 19:39	301209.5			1.7			24.57			1.23			28.63			1		
06/21/22 19:40	308757			1.7			13.34			1.25			15.94			1		
06/21/22 19:41	327625.9			1.8			10.26			1.4			13			1		
06/21/22 19:42	342027.9			1.7			9.8			1.39			12.97			1		
06/21/22 19:43	354196.5			1.5			7.87			1.27			10.78			1		
06/21/22 19:44	370677.9			1.5			7.15			1.32			10.25			1		
06/21/22 19:45	393705.7			1.5			5.9			1.34			8.99			1		
06/21/22 19:46	411804.4			1.3			5.07			1.25			8.08			1		
06/21/22 19:47	415578.2			1.1			5.99			1.08			9.63			1		
06/21/22 19:48	411342.3			1.1			5.81			1.07			9.24			1		
06/21/22 19:49	407799.6			1.1			5.72			1.06			9.02			1		
06/21/22 19:50	408338.7			1			5.62			0.97			8.88			1		
06/21/22 19:51	413498.8			1			5.53			1			8.84			1		
06/21/22 19:52	433985			0.9			4.21			0.96			7.07			1		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/21/22 19:53	446538.6			1			3.9			1			6.74			1		
06/21/22 19:54	445845.5			0.9			4.38			0.9			7.55			1		
06/21/22 19:55	446615.6			0.8			5.06			0.88			8.74			1		
06/21/22 19:56	454009.2			0.8			5.07			0.89			8.9			1		
06/21/22 19:57	446076.5			0.8			5.16			0.87			8.91			1		
06/21/22 19:58	455703.5			0.8			5.25			0.89			9.26			1		
06/21/22 19:59	455087.4			0.8			5.35			0.89			9.41			1		
06/21/22 20:00	452083.8			0.8			5.35			0.88			9.35			1		
06/21/22 20:01	452083.8			0.8			4.61			0.88			8.06			1		
06/21/22 20:02	454548.3			0.8			3.32			0.89			5.84			1		
06/21/22 20:03	451159.6			0.7			3.13			0.78			5.47			1		
06/21/22 20:04	450389.4			0.7			3.41			0.78			5.94			1		
06/21/22 20:05	445999.5			0.7			3.69			0.77			6.36			1		
06/21/22 20:06	448464			0.8			3.69			0.87			6.4			1		
06/21/22 20:07	447924.9			0.8			2.67			0.87			4.63			1		
06/21/22 20:08	453162			0.8			2.43			0.9			4.27			1		
06/21/22 20:09	457166.8			0.8			2.81			0.91			4.97			1		
06/21/22 20:10	463251.1			0.8			3.32			0.9			5.95			1		
06/21/22 20:11	462095.8			0.8			2.67			0.9			4.78			1		
06/21/22 20:12	463482.1			0.8			2.12			0.9			3.8			1		
06/21/22 20:13	460555.5			0.8			2.12			0.9			3.78			1		
06/21/22 20:14	462403.9			0.8			2.4			0.9			4.29			1		
06/21/22 20:15	462712			0.8			2.58			0.9			4.62			1		
06/21/22 20:16	463559.1			0.8			2.67			0.9			4.79			1		
06/21/22 20:17	463867.2			0.8			2.4			0.9			4.3			1		
06/21/22 20:18	456704.7			0.8			2.03			0.89			3.58			1		
06/21/22 20:19	454009.2			0.8			1.94			0.89			3.4			1		
06/21/22 20:20	452776.9			0.8			1.94			0.88			3.39			1		
06/21/22 20:21	452468.8			0.7			2.03			0.78			3.55			1		
06/21/22 20:22	454394.3			0.8			2.12			0.89			3.73			1		
06/21/22 20:23	452083.8			0.8			2.03			0.88			3.55			1		
06/21/22 20:24	451698.7			0.8			1.38			0.88			2.42			1		
06/21/22 20:25	456319.6			0.7			1.29			0.79			2.28			1		
06/21/22 20:26	460247.4			0.7			1.2			0.8			2.13			1		
06/21/22 20:27	454933.3			0.7			1.11			0.79			1.95			0		
06/21/22 20:28	453393			0.8			1.2			0.89			2.12			0		
06/21/22 20:29	453701.1			1.7			1.27			1.9			2.3			0		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/21/22 20:30	453239			3.9			1.34			4.42			2.48			0		
06/21/22 20:31	456704.7			2.3			1.39			2.7			2.63			0		

CT2 SUSD EVENT 33

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/23/22 2:02	286807.5			0.6			1.4			0.38			1.56			0		
06/23/22 2:03	287346.6			0.6			1.43			0.39			1.59			0		
06/23/22 2:04	287346.6			0.6			1.33			0.39			1.48			0		
06/23/22 2:05	286730.5			0.6			1.33			0.38			1.48			0		
06/23/22 2:06	287038.5			0.6			1.43			0.39			1.58			0		
06/23/22 2:07	277103.5			0.6			1.33			0.37			1.43			1		
06/23/22 2:08	253536.6			0.6			1.52			0.34			1.49			1		
06/23/22 2:09	232126.1			0.6			3.9			0.33			3.5			1		
06/23/22 2:10	205555.6			0.5			9.51			0.26			7.56			1		
06/23/22 2:11	181680.7			4.1			16.86			1.75			11.85			1		
06/23/22 2:12	160193.2			264.1			20.72			99.45			12.84			1		
06/23/22 2:13	138859.8			975.4			25.19			318.34			13.53			1		
06/23/22 2:14	24414.1			1679.3			30.42			96.23			2.87			1		
06/23/22 2:15	0			0			37.61			0			0			0		
06/23/22 2:16	0			0			0.2			0			0			0		
06/23/22 2:17	0			0			0.1			0			0			0		
06/23/22 2:18	0			0			0.1			0			0			0		
06/23/22 2:19	0			0			0.1			0			0			0		

CT2 SUSD EVENT 34

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/23/22 15:54	0			0			0			0			0			0		
06/23/22 15:55	0			0			0			0			0			0		
06/23/22 15:56	0			0			0			0			0			0		
06/23/22 15:57	0			0			0			0			0			0		
06/23/22 15:58	0			0			0			0			0			0		
06/23/22 15:59	4775			0			0			0			0			1		
06/23/22 16:00	21179.4			0.2			0			0			0			1		
06/23/22 16:01	35581.4			53.1			26.55			4.45			3.66			1		
06/23/22 16:02	47749.9			982			18.07			110.13			3.33			1		
06/23/22 16:03	59225.3			596.8			24.53			83.1			5.62			1		
06/23/22 16:04	76939			325.8			26.01			58.93			7.74			1		
06/23/22 16:05	122994.5			204.2			36.43			59.01			17.32			1		
06/23/22 16:06	145252.1			107.5			50.99			36.68			28.65			1		
06/23/22 16:07	149642			249.8			56.5			87.83			32.7			1		
06/23/22 16:08	168511			1446.4			52.74			572.75			34.37			1		
06/23/22 16:09	191769.8			931.1			54.58			419.74			40.49			1		
06/23/22 16:10	216337.9			245.6			54.83			124.93			45.89			1		
06/23/22 16:11	241830.2			22			54.73			12.49			51.19			1		
06/23/22 16:12	266552.3			2.1			54.1			1.33			55.79			1		
06/23/22 16:13	294894.2			1.5			34.7			1.04			39.58			1		
06/23/22 16:14	316150.6			1.5			15.03			1.1			18.38			1		
06/23/22 16:15	331322.7			1.6			10.44			1.27			13.38			1		
06/23/22 16:16	329705.4			1.6			7.87			1.25			10.03			1		
06/23/22 16:17	328627.2			1.5			6.79			1.17			8.64			1		
06/23/22 16:18	325469.5			1.5			6.35			1.11			8			1		
06/23/22 16:19	324468.3			1.3			6.17			0.97			7.75			1		
06/23/22 16:20	325238.4			1.3			5.99			0.99			7.54			1		
06/23/22 16:21	323390.1			1.2			5.62			0.91			7.04			1		
06/23/22 16:22	324006.2			1.1			5.16			0.84			6.47			1		
06/23/22 16:23	322157.8			1			5.07			0.77			6.32			1		
06/23/22 16:24	321310.6			1			4.98			0.77			6.19			1		
06/23/22 16:25	321310.6			1			4.89			0.77			6.07			1		
06/23/22 16:26	320694.5			0.9			4.89			0.69			6.06			1		
06/23/22 16:27	320386.4			0.9			4.89			0.69			6.06			1		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/23/22 16:28	320694.5			0.9			4.96			0.71			6.16			1		
06/23/22 16:29	320232.4			0.9			4.96			0.7			6.15			1		
06/23/22 16:30	319077.2			0.8			4.87			0.63			6.01			1		
06/23/22 16:31	319077.2			0.8			4.78			0.63			5.89			1		
06/23/22 16:32	319616.3			0.8			4.87			0.63			6.02			1		
06/23/22 16:33	317536.8			0.8			4.96			0.63			6.1			1		
06/23/22 16:34	300131.3			0.8			4.96			0.59			5.76			1		
06/23/22 16:35	292352.6			0.9			6.38			0.59			7.21			1		
06/23/22 16:36	289426			0.8			7.16			0.53			8.01			1		
06/23/22 16:37	283726.8			0.7			7.16			0.45			7.85			1		
06/23/22 16:38	282109.5			0.7			6.19			0.45			6.75			1		
06/23/22 16:39	280877.3			0.7			4.13			0.45			4.49			1		
06/23/22 16:40	281416.4			0.6			3.15			0.39			3.43			1		
06/23/22 16:41	281185.3			0.6			2.66			0.39			2.89			1		
06/23/22 16:42	280107.1			0.6			2.07			0.39			2.24			1		
06/23/22 16:43	280261.1			0.5			1.97			0.32			2.13			1		
06/23/22 16:44	280723.2			0.6			1.77			0.39			1.92			1		
06/23/22 16:45	280261.1			0.6			1.57			0.39			1.71			1		
06/23/22 16:46	281493.4			0.6			1.38			0.39			1.5			1		
06/23/22 16:47	280338.1			0.6			1.28			0.39			1.39			0		
06/23/22 16:48	288116.8			0.6			1.18			0.4			1.31			0		
06/23/22 16:49	294201			0.6			1.06			0.4			1.21			0		
06/23/22 16:50	295279.3			0.6			0.97			0.4			1.1			0		
06/23/22 16:51	291582.5			0.6			0.87			0.4			0.98			0		

CT2 SUSD EVENT 35

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/26/22 22:05	282802.7			0.6			1.62			0.38			1.77			0		
06/26/22 22:06	284111.9			0.6			1.62			0.38			1.78			0		
06/26/22 22:07	283726.8			0.6			1.62			0.38			1.78			0		
06/26/22 22:08	283187.7			0.6			1.64			0.39			1.8			0		
06/26/22 22:09	284111.9			0.6			1.64			0.39			1.81			0		
06/26/22 22:10	277180.5			0.6			1.64			0.38			1.76			1		
06/26/22 22:11	255924.1			0.6			1.64			0.35			1.63			1		
06/26/22 22:12	231741.1			0.5			4.5			0.27			4.03			1		
06/26/22 22:13	205324.6			0.5			10.27			0.26			8.16			1		
06/26/22 22:14	180063.3			4.5			16.62			1.89			11.58			1		
06/26/22 22:15	158806.9			343.3			20.37			128.19			12.52			1		
06/26/22 22:16	139707			1063.9			24.08			349.37			13.01			1		
06/26/22 22:17	22103.6			1710.8			29.68			88.85			2.54			1		
06/26/22 22:18	0			0			40.12			0			0			0		
06/26/22 22:19	0			0			0.1			0			0			0		
06/26/22 22:20	0			0			0.1			0			0			0		
06/26/22 22:21	0			0			0.1			0			0			0		
06/26/22 22:22	0			0			0.1			0			0			0		

CT2 SUSD EVENT 36

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/27/22 13:00	0			0			0			0			0			0		
06/27/22 13:01	0			0			0			0			0			0		
06/27/22 13:02	0			0			0			0			0			0		
06/27/22 13:03	0			0			0			0			0			0		
06/27/22 13:04	0			0			0			0			0			0		
06/27/22 13:05	5391.1			0			0			0			0			1		
06/27/22 13:06	18560.8			0			0			0			0			1		
06/27/22 13:07	32423.7			59			35.4			4.49			4.43			1		
06/27/22 13:08	46286.6			1035.6			16.52			112.67			2.96			1		
06/27/22 13:09	57916			701.1			23.6			95.42			5.29			1		
06/27/22 13:10	71085.7			388			25.85			64.79			7.1			1		
06/27/22 13:11	111211.1			227.3			33.6			59.42			14.46			1		
06/27/22 13:12	147716.6			126.2			45.16			43.8			25.8			1		
06/27/22 13:13	146484.4			116.7			59.18			40.18			33.53			1		
06/27/22 13:14	164429.1			1227.4			52.92			474.48			33.67			1		
06/27/22 13:15	186609.7			1042.3			56.3			457.05			40.63			1		
06/27/22 13:16	214027.4			308.6			57.67			155.21			47.74			1		
06/27/22 13:17	238980.6			33.5			57.97			18.8			53.59			1		
06/27/22 13:18	264549.9			2.7			57.75			1.69			59.1			1		
06/27/22 13:19	291043.3			1.6			42.01			1.11			47.3			1		
06/27/22 13:20	313301			1.5			19.01			1.1			23.04			1		
06/27/22 13:21	331784.8			1.5			11.44			1.2			14.68			1		
06/27/22 13:22	330013.4			1.6			9.3			1.25			11.87			1		
06/27/22 13:23	330552.6			1.5			7.6			1.18			9.72			1		
06/27/22 13:24	327780			1.5			7.44			1.12			9.44			1		
06/27/22 13:25	329782.4			1.4			6.81			1.06			8.68			1		
06/27/22 13:26	326932.8			1.2			6.63			0.91			8.38			1		
06/27/22 13:27	325161.4			1.2			6.45			0.92			8.12			1		
06/27/22 13:28	324699.3			1.1			6.18			0.84			7.76			1		
06/27/22 13:29	325931.6			1			6.08			0.78			7.67			1		
06/27/22 13:30	323005			1			5.99			0.77			7.49			1		
06/27/22 13:31	322003.8			0.9			5.9			0.7			7.35			1		
06/27/22 13:32	318153			0.9			5.9			0.69			7.26			1		
06/27/22 13:33	323159			0.9			9.18			0.71			11.47			1		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/27/22 13:34	323236			0.8			7.68			0.64			9.6			1		
06/27/22 13:35	320232.4			0.9			10.3			0.7			12.76			1		
06/27/22 13:36	319000.2			0.8			8.99			0.63			11.1			1		
06/27/22 13:37	321079.6			0.8			7.87			0.64			9.77			1		
06/27/22 13:38	321079.6			0.8			10.68			0.64			13.26			1		
06/27/22 13:39	320001.4			0.8			12.46			0.63			15.42			1		
06/27/22 13:40	319616.3			0.8			12.74			0.63			15.75			1		
06/27/22 13:41	298822			0.8			7.21			0.59			8.34			1		
06/27/22 13:42	292737.7			0.8			12.18			0.52			13.79			1		
06/27/22 13:43	288193.8			0.8			7.83			0.52			8.73			1		
06/27/22 13:44	281955.5			0.7			7.54			0.45			8.23			1		
06/27/22 13:45	282417.6			0.6			8.36			0.39			9.13			1		
06/27/22 13:46	281878.5			0.6			7.97			0.39			8.69			1		
06/27/22 13:47	281801.4			0.6			5.11			0.39			5.57			1		
06/27/22 13:48	281878.5			0.6			3.64			0.39			3.97			1		
06/27/22 13:49	281262.3			0.5			3.05			0.33			3.32			1		
06/27/22 13:50	283418.8			0.6			2.66			0.39			2.91			1		
06/27/22 13:51	282263.5			0.6			2.07			0.39			2.25			1		
06/27/22 13:52	281493.4			0.6			1.87			0.39			2.03			1		
06/27/22 13:53	281108.3			0.5			1.77			0.32			1.92			1		
06/27/22 13:54	280954.3			0.5			1.57			0.32			1.71			1		
06/27/22 13:55	281031.3			0.6			1.48			0.39			1.6			0		
06/27/22 13:56	280261.1			0.5			1.38			0.32			1.49			0		
06/27/22 13:57	281339.3			0.5			1.28			0.33			1.39			0		
06/27/22 13:58	281801.4			0.5			1.08			0.33			1.18			0		
06/27/22 13:59	292660.7			0.5			0.98			0.34			1.11			0		

CT2 SUSD EVENT 37

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/27/22 22:35	281339.3			0.6			1.55			0.38			1.68			0		
06/27/22 22:36	282186.5			0.6			1.55			0.38			1.69			0		
06/27/22 22:37	282109.5			0.5			1.45			0.32			1.58			0		
06/27/22 22:38	282340.6			0.5			1.55			0.32			1.69			0		
06/27/22 22:39	284651			0.5			1.55			0.32			1.7			0		
06/27/22 22:40	281724.4			0.6			1.55			0.38			1.69			1		
06/27/22 22:41	260237			0.6			1.55			0.36			1.56			1		
06/27/22 22:42	236131			0.5			3.15			0.27			2.87			1		
06/27/22 22:43	210176.6			0.5			9.12			0.26			7.41			1		
06/27/22 22:44	186070.6			2.6			15.58			1.14			11.21			1		
06/27/22 22:45	163042.8			216.6			19.04			82.99			12.01			1		
06/27/22 22:46	142556.6			883.9			23.13			296.2			12.76			1		
06/27/22 22:47	60688.6			1546.1			26.2			220.47			6.15			1		
06/27/22 22:48	0			0			30.89			0			0			0		
06/27/22 22:49	0			0			0.2			0			0			0		
06/27/22 22:50	0			0			0.1			0			0			0		
06/27/22 22:51	0			0			0.1			0			0			0		
06/27/22 22:52	0			0			0.1			0			0			0		

CT2 SUSD EVENT 38

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/28/22 15:44	0			0			0			0			0			0		
06/28/22 15:45	0			0			0			0			0			0		
06/28/22 15:46	0			0			0			0			0			0		
06/28/22 15:47	0			0			0			0			0			0		
06/28/22 15:48	0			0			0			0			0			0		
06/28/22 15:49	1848.4			0.1			0			0			0			1		
06/28/22 15:50	9473			0.1			0			0			0			1		
06/28/22 15:51	30729.4			59			41.3			4.27			4.91			1		
06/28/22 15:52	43822.1			996.7			18.54			102.63			3.14			1		
06/28/22 15:53	54681.3			682.1			23.93			87.64			5.06			1		
06/28/22 15:54	68621.2			365.2			26.41			58.95			7.01			1		
06/28/22 15:55	102200.2			210.6			34.63			50.58			13.69			1		
06/28/22 15:56	143865.8			116.3			48.14			39.35			26.8			1		
06/28/22 15:57	168896			78.8			63.95			31.27			41.77			1		
06/28/22 15:58	200318.5			553.9			64.73			260.76			50.15			1		
06/28/22 15:59	228814.5			103.3			66			55.58			58.43			1		
06/28/22 16:00	254999.9			5.1			67.55			3.03			66.64			1		
06/28/22 16:01	282109.5			1.2			59.42			0.77			64.84			1		
06/28/22 16:02	306292.5			1			27.6			0.75			32.7			1		
06/28/22 16:03	328473.1			1.2			13.43			0.91			17.07			1		
06/28/22 16:04	333710.2			1.4			9.57			1.12			12.35			1		
06/28/22 16:05	333017.1			1.4			7.24			1.12			9.33			1		
06/28/22 16:06	330244.5			1.3			7.87			1.04			10.05			1		
06/28/22 16:07	331399.7			1.2			7.93			0.96			10.16			1		
06/28/22 16:08	331938.8			1.2			8.05			0.91			10.33			1		
06/28/22 16:09	328858.2			1.2			7.78			0.9			9.89			1		
06/28/22 16:10	327934			1.1			7.42			0.83			9.41			1		
06/28/22 16:11	325854.6			1.1			7.15			0.82			9.01			1		
06/28/22 16:12	325854.6			1			6.97			0.75			8.79			1		
06/28/22 16:13	324545.3			1			6.88			0.75			8.64			1		
06/28/22 16:14	324853.4			1			6.9			0.76			8.67			1		
06/28/22 16:15	326316.7			0.9			6.9			0.7			8.71			1		
06/28/22 16:16	327548.9			0.9			6.9			0.7			8.74			1		
06/28/22 16:17	324853.4			0.9			6.99			0.69			8.78			1		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/28/22 16:18	324237.3			0.9			6.99			0.69			8.77			1		
06/28/22 16:19	323698.1			0.8			6.99			0.62			8.75			1		
06/28/22 16:20	324853.4			0.8			6.9			0.62			8.67			1		
06/28/22 16:21	322928			0.8			6.9			0.62			8.62			1		
06/28/22 16:22	321233.6			0.8			6.99			0.62			8.68			1		
06/28/22 16:23	323621.1			0.8			6.99			0.62			8.75			1		
06/28/22 16:24	323467.1			0.8			7.08			0.62			8.86			1		
06/28/22 16:25	312299.8			0.8			7.26			0.6			8.77			1		
06/28/22 16:26	293122.8			0.7			7.47			0.51			8.47			1		
06/28/22 16:27	290889.3			0.7			8.8			0.51			9.9			1		
06/28/22 16:28	286576.4			0.7			7.23			0.45			8.02			1		
06/28/22 16:29	283341.8			0.7			5.23			0.44			5.74			1		
06/28/22 16:30	282186.5			0.6			4.84			0.38			5.28			1		
06/28/22 16:31	282417.6			0.6			4.06			0.39			4.44			1		
06/28/22 16:32	281570.4			0.6			3.77			0.38			4.11			1		
06/28/22 16:33	281724.4			0.6			3.34			0.39			3.64			1		
06/28/22 16:34	281262.3			0.6			2.95			0.39			3.21			1		
06/28/22 16:35	280569.2			0.6			2.66			0.39			2.88			1		
06/28/22 16:36	280954.3			0.6			2.46			0.39			2.67			1		
06/28/22 16:37	282109.5			0.6			2.16			0.39			2.36			1		
06/28/22 16:38	280492.2			0.6			1.97			0.39			2.13			1		
06/28/22 16:39	281955.5			0.6			1.77			0.39			1.93			1		
06/28/22 16:40	280800.3			0.6			1.67			0.39			1.82			1		
06/28/22 16:41	280261.1			0.6			1.57			0.39			1.71			1		
06/28/22 16:42	279645			0.5			1.48			0.32			1.6			0		
06/28/22 16:43	280107.1			0.5			1.38			0.32			1.49			0		
06/28/22 16:44	279028.9			0.6			1.28			0.39			1.38			0		
06/28/22 16:45	281185.3			0.6			1.18			0.39			1.28			0		
06/28/22 16:46	278951.8			0.6			1.08			0.39			1.17			0		

CT2 SUSD EVENT 39

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/28/22 21:18	284959.1			0.6			1.52			0.38			1.68			0		
06/28/22 21:19	286114.3			0.6			1.33			0.38			1.47			0		
06/28/22 21:20	287346.6			0.6			1.24			0.39			1.37			0		
06/28/22 21:21	285498.2			0.6			1.24			0.38			1.37			0		
06/28/22 21:22	284497			0.6			1.24			0.38			1.36			0		
06/28/22 21:23	282263.5			0.6			1.33			0.38			1.45			1		
06/28/22 21:24	265474.1			0.6			1.43			0.36			1.47			1		
06/28/22 21:25	241830.2			0.6			2.61			0.33			2.44			1		
06/28/22 21:26	216800			0.5			8.11			0.27			6.8			1		
06/28/22 21:27	190383.5			2.4			15.5			1.09			11.42			1		
06/28/22 21:28	168511			120.9			19.8			47.87			12.9			1		
06/28/22 21:29	147331.6			695			24.21			240.67			13.79			1		
06/28/22 21:30	69699.5			1519.4			29.15			248.97			7.86			1		
06/28/22 21:31	0			0			31.98			0			0			0		
06/28/22 21:32	0			0			11.8			0			0			0		
06/28/22 21:33	0			0			0.2			0			0			0		
06/28/22 21:34	0			0			0.1			0			0			0		
06/28/22 21:35	0			0			0.1			0			0			0		

CT2 SUSD EVENT 40

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/29/22 11:55	0			0			0			0			0			0		
06/29/22 11:56	0			0			0			0			0			0		
06/29/22 11:57	0			0			0			0			0			0		
06/29/22 11:58	0			0			0			0			0			0		
06/29/22 11:59	0			0			0			0			0			0		
06/29/22 12:00	5699.2			0			0			0			0			1		
06/29/22 12:01	19485			0			0			0			0			1		
06/29/22 12:02	32038.6			56.1			35.4			4.22			4.38			1		
06/29/22 12:03	45824.5			1089.7			17.7			117.33			3.14			1		
06/29/22 12:04	57839			808.6			21.96			109.87			4.91			1		
06/29/22 12:05	69006.3			503.3			26.85			81.67			7.17			1		
06/29/22 12:06	100813.9			327.5			31.91			77.62			12.45			1		
06/29/22 12:07	145714.2			183.1			41.77			62.72			23.54			1		
06/29/22 12:08	148409.8			127.6			56.64			44.51			32.51			1		
06/29/22 12:09	189228.3			1074.5			53.47			477.94			39.14			1		
06/29/22 12:10	195620.6			534.4			59.47			245.71			45			1		
06/29/22 12:11	213642.3			168.5			53.92			84.6			44.56			1		
06/29/22 12:12	239288.6			35.4			56.05			19.91			51.89			1		
06/29/22 12:13	262855.5			2.8			54.6			1.72			55.52			1		
06/29/22 12:14	289272			1.3			48.68			0.86			54.46			1		
06/29/22 12:15	315611.5			1.2			20.7			0.9			25.27			1		
06/29/22 12:16	330629.6			1.3			12.87			1.04			16.47			1		
06/29/22 12:17	334480.4			1.4			10.82			1.12			13.99			1		
06/29/22 12:18	333402.2			1.5			9.39			1.19			12.11			1		
06/29/22 12:19	333325.1			1.4			8.58			1.12			11.07			1		
06/29/22 12:20	332400.9			1.3			8.19			1.03			10.53			1		
06/29/22 12:21	331168.7			1.1			7.49			0.89			9.59			1		
06/29/22 12:22	330090.5			1.1			7.42			0.83			9.47			1		
06/29/22 12:23	328858.2			1.1			7.24			0.83			9.21			1		
06/29/22 12:24	329936.4			1			6.97			0.76			8.9			1		
06/29/22 12:25	328242.1			1			6.88			0.76			8.74			1		
06/29/22 12:26	328627.2			1			6.79			0.76			8.64			1		
06/29/22 12:27	328319.1			0.9			6.79			0.69			8.63			1		
06/29/22 12:28	328088			0.9			6.79			0.69			8.62			1		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/29/22 12:29	326470.7			0.9			6.88			0.69			8.69			1		
06/29/22 12:30	325007.4			0.9			6.9			0.69			8.67			1		
06/29/22 12:31	326624.8			0.9			6.9			0.7			8.72			1		
06/29/22 12:32	321541.7			0.8			6.99			0.62			8.69			1		
06/29/22 12:33	302672.8			0.8			7.17			0.58			8.4			1		
06/29/22 12:34	287654.7			0.8			7.93			0.56			8.82			1		
06/29/22 12:35	284651			0.8			10.37			0.51			11.42			1		
06/29/22 12:36	285421.2			0.7			10.85			0.45			11.98			1		
06/29/22 12:37	284266			0.6			11.32			0.38			12.45			1		
06/29/22 12:38	284728.1			0.6			11.61			0.39			12.78			1		
06/29/22 12:39	283726.8			0.6			11.7			0.39			12.84			1		
06/29/22 12:40	284111.9			0.6			9.58			0.39			10.52			1		
06/29/22 12:41	284266			0.6			4.93			0.39			5.42			1		
06/29/22 12:42	284188.9			0.6			4.06			0.39			4.47			1		
06/29/22 12:43	284111.9			0.6			5.13			0.39			5.63			1		
06/29/22 12:44	282417.6			0.6			5.8			0.39			6.34			1		
06/29/22 12:45	285729.3			0.6			5.22			0.39			5.77			1		
06/29/22 12:46	285806.3			0.6			3.68			0.39			4.06			1		
06/29/22 12:47	287115.5			0.6			3			0.39			3.33			1		
06/29/22 12:48	286499.4			0.6			3.1			0.39			3.43			1		
06/29/22 12:49	287038.5			0.6			3.39			0.39			3.76			1		
06/29/22 12:50	287654.7			0.6			3.58			0.39			3.98			1		
06/29/22 12:51	287731.7			0.6			3.29			0.39			3.66			1		
06/29/22 12:52	286653.4			0.7			2.9			0.46			3.22			1		
06/29/22 12:53	292506.7			0.6			2.51			0.4			2.85			1		
06/29/22 12:54	301594.6			0.6			2.22			0.41			2.6			1		
06/29/22 12:55	301748.6			0.6			1.62			0.4			1.89			1		
06/29/22 12:56	299977.2			0.7			1.43			0.47			1.66			1		
06/29/22 12:57	298128.8			0.7			1.52			0.47			1.76			1		
06/29/22 12:58	308294.9			0.7			1.52			0.48			1.82			1		
06/29/22 12:59	327857			0.7			1.62			0.51			2.05			0		
06/29/22 13:00	328088			0.7			1.78			0.51			2.26			0		
06/29/22 13:01	323698.1			0.6			1.57			0.49			1.96			0		
06/29/22 13:02	323698.1			0.6			1.57			0.49			1.96			0		
06/29/22 13:03	324930.4			0.7			1.63			0.55			2.05			0		

CT2 SUSD EVENT 41

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/30/22 0:40	324930.4			0.9			1.39			0.66			1.74			0		
06/30/22 0:41	316843.7			0.9			1.59			0.66			1.94			0		
06/30/22 0:42	318153			0.8			1.54			0.61			1.9			0		
06/30/22 0:43	308063.9			0.7			1.45			0.53			1.73			0		
06/30/22 0:44	288886.9			0.7			1.45			0.49			1.62			0		
06/30/22 0:45	280261.1			0.6			1.75			0.43			1.9			1		
06/30/22 0:46	259235.8			0.6			2.38			0.35			2.39			1		
06/30/22 0:47	235129.8			0.5			5.7			0.28			5.18			1		
06/30/22 0:48	210561.7			0.8			15.19			0.38			12.37			1		
06/30/22 0:49	185146.4			8			19.79			3.48			14.17			1		
06/30/22 0:50	165122.3			446.9			23.19			173.46			14.81			1		
06/30/22 0:51	146099.3			1253.4			29.82			430.38			16.85			1		
06/30/22 0:52	49290.2			1848.9			34.29			214.39			6.54			1		
06/30/22 0:53	0			0			43.76			0			0			0		
06/30/22 0:54	0			0			0.2			0			0			0		
06/30/22 0:55	0			0			0.1			0			0			0		
06/30/22 0:56	0			0			0.1			0			0			0		
06/30/22 0:57	0			0			0.1			0			0			0		

CT2 SUSD EVENT 42

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/30/22 13:58	0			0	X		0	X		0	X		0	X		0		
06/30/22 13:59	0			0	X		0	X		0	X		0	X		0		
06/30/22 14:00	0			0	X		0	X		0	X		0	X		0		
06/30/22 14:01	0			0	X		0	X		0	X		0	X		0		
06/30/22 14:02	0			0	X		0	X		0	X		0	X		0		
06/30/22 14:03	2002.4			0	X		0	X		0	X		0	X		1		
06/30/22 14:04	21718.5			0.3	X		0	X		0	X		0	X		1		
06/30/22 14:05	35350.3			422.8	X		25.57	X		35.12	X		3.49	X		1		
06/30/22 14:06	48905.1			158.6	X		16.96	X		18.24	X		3.21	X		1		
06/30/22 14:07	61073.7			681.3			23.6			97.76			5.57			1		
06/30/22 14:08	77401.1			437.7			26.69			79.66			7.99			1		
06/30/22 14:09	122455.4			289.6			33.35			83.37			15.8			1		
06/30/22 14:10	148486.8			165.4			46.76			57.73			26.86			1		
06/30/22 14:11	171822.6			229			56.05			92.47			37.25			1		
06/30/22 14:12	162888.8			969.8			55.12			371.21			34.73			1		
06/30/22 14:13	157574.7			1030.7			50.39			381.63			30.7			1		
06/30/22 14:14	172438.8			1390.9			48.72			563.84			32.5			1		
06/30/22 14:15	195389.5			896.3			49.59			411.71			37.49			1		
06/30/22 14:16	221497.9			240.2			50.99			125.07			43.7			1		
06/30/22 14:17	245989			28.2			52.47			16.33			49.93			1		
06/30/22 14:18	270942.2			3			50.76			1.91			53.2			1		
06/30/22 14:19	297589.7			1.8			36.11			1.28			41.57			1		
06/30/22 14:20	318846.1			1.8			16.13			1.31			19.9			1		
06/30/22 14:21	330783.6			1.8			11.26			1.39			14.41			1		
06/30/22 14:22	332092.9			1.7			10.19			1.33			13.09			1		
06/30/22 14:23	332786			1.6			9.83			1.26			12.66			1		
06/30/22 14:24	331707.8			1.4			9.57			1.12			12.27			1		
06/30/22 14:25	332786			1.3			9.21			1.05			11.85			1		
06/30/22 14:26	330706.6			1.3			8.53			0.99			10.91			1		
06/30/22 14:27	328858.2			1.3			8.44			0.98			10.74			1		
06/30/22 14:28	327625.9			1.2			8.44			0.91			10.7			1		
06/30/22 14:29	326316.7			1.1			8.44			0.84			10.65			1		
06/30/22 14:30	326316.7			1.1			8.44			0.84			10.65			1		
06/30/22 14:31	324545.3			1			8.39			0.77			10.53			1		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/30/22 14:32	323390.1			1			8.39			0.77			10.5			1		
06/30/22 14:33	325007.4			0.9			8.3			0.7			10.43			1		
06/30/22 14:34	325854.6			0.9			8.3			0.71			10.46			1		
06/30/22 14:35	322851			0.9			8.3			0.7			10.36			1		
06/30/22 14:36	306138.5			0.8			8.3			0.6			9.82			1		
06/30/22 14:37	294509.1			0.8			8.24			0.58			9.39			1		
06/30/22 14:38	290196.2			0.9			9.04			0.58			10.15			1		
06/30/22 14:39	283495.8			0.8			9.99			0.51			10.96			1		
06/30/22 14:40	284959.1			0.7			11.32			0.45			12.47			1		
06/30/22 14:41	284651			0.6			11.61			0.39			12.78			1		
06/30/22 14:42	283726.8			0.6			11.8			0.39			12.95			1		
06/30/22 14:43	284188.9			0.6			9.58			0.39			10.53			1		
06/30/22 14:44	284034.9			0.6			6.09			0.39			6.69			1		
06/30/22 14:45	285498.2			0.6			4.74			0.39			5.23			1		
06/30/22 14:46	285960.3			0.6			3.97			0.39			4.39			1		
06/30/22 14:47	285267.2			0.6			3.29			0.39			3.63			1		
06/30/22 14:48	286884.5			0.6			3.1			0.39			3.43			1		
06/30/22 14:49	285883.3			0.6			2.8			0.39			3.1			1		
06/30/22 14:50	284188.9			0.6			2.61			0.39			2.87			1		
06/30/22 14:51	284882.1			0.6			2.32			0.39			2.56			1		
06/30/22 14:52	285344.2			0.6			2.22			0.39			2.46			1		
06/30/22 14:53	284805.1			0.6			2.03			0.39			2.24			1		
06/30/22 14:54	286191.3			0.6			1.93			0.39			2.14			1		
06/30/22 14:55	283033.7			0.6			1.74			0.39			1.91			0		
06/30/22 14:56	284188.9			0.6			1.74			0.39			1.91			0		
06/30/22 14:57	285190.2			0.6			1.55			0.39			1.71			0		
06/30/22 14:58	299823.2			0.6			1.55			0.41			1.79			0		
06/30/22 14:59	320694.5			0.6			1.33			0.43			1.65			0		

CT2 SUSD EVENT 43

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/30/22 23:18	285575.2			0.5			1.52			0.32			1.68			0		
06/30/22 23:19	286884.5			0.5			1.33			0.32			1.48			0		
06/30/22 23:20	286499.4			0.5			1.12			0.32			1.25			0		
06/30/22 23:21	288809.9			0.5			1.12			0.32			1.26			0		
06/30/22 23:22	288270.8			0.5			1.12			0.32			1.25			0		
06/30/22 23:23	281647.4			0.6			1.12			0.37			1.22			1		
06/30/22 23:24	257695.4			0.5			1.24			0.29			1.23			1		
06/30/22 23:25	234821.7			0.5			3.9			0.28			3.54			1		
06/30/22 23:26	209791.5			0.8			8.52			0.38			6.92			1		
06/30/22 23:27	184222.2			7.7			11.55			3.35			8.23			1		
06/30/22 23:28	163967			492.8			14.89			189.95			9.45			1		
06/30/22 23:29	144405			1235.3			19.29			419.21			10.78			1		
06/30/22 23:30	24953.2			1799.7			25.26			105.55			2.44			1		
06/30/22 23:31	0			0			34.66			0			0			0		
06/30/22 23:32	0			0			0.1			0			0			0		
06/30/22 23:33	0			0			0.1			0			0			0		
06/30/22 23:34	0			0			0.1			0			0			0		
06/30/22 23:35	0			0			0.1			0			0			0		

ATTACHMENT 4

AQ-32

AQ-32 The Project owner shall maintain hourly records of NOx and CO emission concentrations (ppmv @ 15% O2), and hourly, daily, and quarterly records of NOx and CO emissions. Ongoing compliance with the CO emission limits during normal operation shall be deemed compliance with the VOC emission limits during normal operation.

Verification: The project owner shall submit to the CPM all concentration, hourly, daily, and quarter NOx and CO emissions as part of the Quarterly Air Quality Report required by Condition of Certification AQ-SC6

AQ32 DAILY NOX CO

	CT1_CO_Lb_1D			CT1_NOx_Lb_1D			CT2_CO_Lb_1D			CT2_NOx_Lb_1D								
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/01/22 0:00	0			0			0			0								
04/02/22 0:00	0			0			0			0								
04/03/22 0:00	0			0			0			0								
04/04/22 0:00	0			0			0			0								
04/05/22 0:00	0			0			0			0								
04/06/22 0:00	0			0			0			0								
04/07/22 0:00	0			0			0			0								
04/08/22 0:00	0			0			0			0								
04/09/22 0:00	0			0			0			0								
04/10/22 0:00	0			0			0			0								
04/11/22 0:00	0			0			0			0								
04/12/22 0:00	0			0			0			0								
04/13/22 0:00	0			0			0			0								
04/14/22 0:00	0			0			0			0								
04/15/22 0:00	0			0			0			0								
04/16/22 0:00	0			0			0			0								
04/17/22 0:00	0			0			0			0								
04/18/22 0:00	0			0			0			0								
04/19/22 0:00	0			0			0			0								
04/20/22 0:00	0			0			0			0								
04/21/22 0:00	0			0			0			0								
04/22/22 0:00	0			0			0			0								
04/23/22 0:00	0			0			0			0								
04/24/22 0:00	0			0			0			0								
04/25/22 0:00	0			0			0			0								
04/26/22 0:00	0			0			262.54			37.61								
04/27/22 0:00	0			0			80.04			42.6								
04/28/22 0:00	270.17			11.85			163.18			36.19								
04/29/22 0:00	18.36			18.11			0			0								
04/30/22 0:00	0			0			0			0								
05/01/22 0:00	52.77			40.13			0			0								
05/02/22 0:00	10.05			42.75			0			0								
05/03/22 0:00	61.98			16.75			28.12			5.2								
05/04/22 0:00	13.01			49.06			18.53			54.1								

	CT1_CO_Lb_1D			CT1_NOx_Lb_1D			CT2_CO_Lb_1D			CT2_NOx_Lb_1D								
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/05/22 0:00	11.94			43.49			17.76			46.35								
05/06/22 0:00	21.45			55.91			28.11			55.56								
05/07/22 0:00	20.88			54.26			27.71			31.93								
05/08/22 0:00	59.58			28.1			16.37			44.42								
05/09/22 0:00	16.63			17.22			24.5			40.38								
05/10/22 0:00	0			0			0			0								
05/11/22 0:00	0			0			0			0								
05/12/22 0:00	0			0			0			0								
05/13/22 0:00	0			0			0			0								
05/14/22 0:00	0			0			0			0								
05/15/22 0:00	0			0			0			0								
05/16/22 0:00	0			0			0			0								
05/17/22 0:00	43.98			28.53			57.25			26.18								
05/18/22 0:00	14.11			65.58			19.92			68.98								
05/19/22 0:00	81.59			35.75			36.19			52.16								
05/20/22 0:00	0			0			0			0								
05/21/22 0:00	0			0			0			0								
05/22/22 0:00	0			0			0			0								
05/23/22 0:00	0			0			0			0								
05/24/22 0:00	71.78			54.39			40.95			66.5								
05/25/22 0:00	26.34			63.85			2			67.63								
05/26/22 0:00	64.56			28.12			0			1.24								
05/27/22 0:00	0			0			0			0								
05/28/22 0:00	0			0			0			0								
05/29/22 0:00	0			0			0			0								
05/30/22 0:00	0			0			0			0								
05/31/22 0:00	0			0			0			0								
06/01/22 0:00	0			0			0			0								
06/02/22 0:00	0			0			0			0								
06/03/22 0:00	0			0			0			0								
06/04/22 0:00	0			0			0			0								
06/05/22 0:00	0			0			0			0								
06/06/22 0:00	21.75			20.16			0			0								
06/07/22 0:00	0			0			13.52			0.22								
06/08/22 0:00	64.43			60.43			40.26			36.83								
06/09/22 0:00	18.69			56.88			85.23			50.42								
06/10/22 0:00	18.81			69.58			38.06			72.98								

	CT1_CO_Lb_1D			CT1_NOx_Lb_1D			CT2_CO_Lb_1D			CT2_NOx_Lb_1D								
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/11/22 0:00	11.17			57.56			41.33			66.05								
06/12/22 0:00	20.95			55.88			51.11			47.49								
06/13/22 0:00	11.88			44.03			65.29			19.39								
06/14/22 0:00	13.6			43.17			40.03			26.4								
06/15/22 0:00	22.3			60.18			25.44			63.13								
06/16/22 0:00	25.07			57.53			28.77			62.15								
06/17/22 0:00	30.37			28.62			18.3			49.24								
06/18/22 0:00	0			0			10.65			43.83								
06/19/22 0:00	0			0			11.96			42.94								
06/20/22 0:00	48.16			35.81			32.73			54.33								
06/21/22 0:00	13.72			49.3			42.88			24.37								
06/22/22 0:00	16.21			49.45			19.14			51.67								
06/23/22 0:00	19.34			61.18			52.18			39.07								
06/24/22 0:00	17.87			60.29			21.07			64.42								
06/25/22 0:00	31.71			49.46			15.77			55.79								
06/26/22 0:00	40.44			39.23			33.01			50.77								
06/27/22 0:00	13.48			52.87			54.13			38.64								
06/28/22 0:00	12.3			48.36			35.07			24.6								
06/29/22 0:00	19.98			61.89			38.15			46.62								
06/30/22 0:00	15.7			54.15			104.17			40.77								
07/01/22 0:00	15.41			46.94			60.05			27.54								

AQ32 HOURLY NOX CO

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	**Value**	**Sl**	**Mod**	**Value**	**Sl**	**Mod**	**Value**	**Sl**	**Mod**	**Value**	**Sl**	**Mod**	**Value**	**Sl**	**Mod**	**Value**	**Sl**	**Mod**
04/01/22 0:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/01/22 1:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/01/22 2:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/01/22 3:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/01/22 4:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/01/22 5:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/01/22 6:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/01/22 7:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/01/22 8:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/01/22 9:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/01/22 10:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/01/22 11:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/01/22 12:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/01/22 13:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/01/22 14:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/01/22 15:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/01/22 16:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/01/22 17:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/01/22 18:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/01/22 19:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/01/22 20:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/01/22 21:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/01/22 22:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/01/22 23:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/02/22 0:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/02/22 1:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/02/22 2:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/02/22 3:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/02/22 4:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/02/22 5:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/02/22 6:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/02/22 7:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/02/22 8:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/02/22 9:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/02/22 10:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/02/22 11:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/02/22 12:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/02/22 13:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/02/22 14:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/02/22 15:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/02/22 16:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/02/22 17:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/02/22 18:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/02/22 19:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/02/22 20:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/02/22 21:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/02/22 22:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/02/22 23:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/03/22 0:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/03/22 1:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/03/22 2:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/03/22 3:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/03/22 4:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/03/22 5:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/03/22 6:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/03/22 7:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/03/22 8:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/03/22 9:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/03/22 10:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/03/22 11:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/03/22 12:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/03/22 13:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/03/22 14:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/03/22 15:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/03/22 16:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/03/22 17:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/03/22 18:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/03/22 19:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/03/22 20:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/03/22 21:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/03/22 22:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/03/22 23:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/04/22 0:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/04/22 1:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/04/22 2:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/04/22 3:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/04/22 4:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/04/22 5:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/04/22 6:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/04/22 7:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/04/22 8:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/04/22 9:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/04/22 10:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/04/22 11:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/04/22 12:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/04/22 13:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/04/22 14:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/04/22 15:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/04/22 16:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/04/22 17:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/04/22 18:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/04/22 19:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/04/22 20:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/04/22 21:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/04/22 22:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/04/22 23:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/05/22 0:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/05/22 1:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/05/22 2:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/05/22 3:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/05/22 4:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/05/22 5:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/05/22 6:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/05/22 7:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/05/22 8:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/05/22 9:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/05/22 10:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/05/22 11:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/05/22 12:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/05/22 13:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/05/22 14:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/05/22 15:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/05/22 16:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/05/22 17:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/05/22 18:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/05/22 19:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/05/22 20:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/05/22 21:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/05/22 22:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/05/22 23:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/06/22 0:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/06/22 1:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/06/22 2:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/06/22 3:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/06/22 4:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/06/22 5:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/06/22 6:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/06/22 7:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/06/22 8:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/06/22 9:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/06/22 10:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/06/22 11:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/06/22 12:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/06/22 13:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/06/22 14:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/06/22 15:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/06/22 16:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/06/22 17:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/06/22 18:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/06/22 19:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/06/22 20:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/06/22 21:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/06/22 22:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/06/22 23:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/07/22 0:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/07/22 1:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/07/22 2:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/07/22 3:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/07/22 4:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/07/22 5:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/07/22 6:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/07/22 7:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/07/22 8:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/07/22 9:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/07/22 10:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/07/22 11:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/07/22 12:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/07/22 13:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/07/22 14:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/07/22 15:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/07/22 16:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/07/22 17:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/07/22 18:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/07/22 19:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/07/22 20:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/07/22 21:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/07/22 22:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/07/22 23:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/08/22 0:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/08/22 1:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/08/22 2:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/08/22 3:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/08/22 4:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/08/22 5:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/08/22 6:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/08/22 7:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/08/22 8:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/08/22 9:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/08/22 10:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/08/22 11:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/08/22 12:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/08/22 13:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/08/22 14:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/08/22 15:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/08/22 16:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/08/22 17:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/08/22 18:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/08/22 19:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/08/22 20:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/08/22 21:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/08/22 22:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/08/22 23:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/09/22 0:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/09/22 1:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/09/22 2:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/09/22 3:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/09/22 4:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/09/22 5:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/09/22 6:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/09/22 7:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/09/22 8:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/09/22 9:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/09/22 10:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/09/22 11:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/09/22 12:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/09/22 13:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/09/22 14:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/09/22 15:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/09/22 16:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/09/22 17:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/09/22 18:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/09/22 19:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/09/22 20:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/09/22 21:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/09/22 22:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/09/22 23:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/10/22 0:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/10/22 1:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/10/22 2:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/10/22 3:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/10/22 4:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/10/22 5:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/10/22 6:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/10/22 7:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/10/22 8:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/10/22 9:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/10/22 10:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/10/22 11:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/10/22 12:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/10/22 13:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/10/22 14:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/10/22 15:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/10/22 16:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/10/22 17:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/10/22 18:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/10/22 19:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/10/22 20:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/10/22 21:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/10/22 22:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/10/22 23:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/11/22 0:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/11/22 1:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/11/22 2:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/11/22 3:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/11/22 4:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/11/22 5:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/11/22 6:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/11/22 7:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/11/22 8:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/11/22 9:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/11/22 10:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/11/22 11:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/11/22 12:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/11/22 13:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/11/22 14:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/11/22 15:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/11/22 16:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/11/22 17:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/11/22 18:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/11/22 19:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/11/22 20:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/11/22 21:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/11/22 22:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/11/22 23:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/12/22 0:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/12/22 1:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/12/22 2:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/12/22 3:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/12/22 4:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/12/22 5:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/12/22 6:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/12/22 7:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/12/22 8:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/12/22 9:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/12/22 10:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/12/22 11:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/12/22 12:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/12/22 13:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/12/22 14:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/12/22 15:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/12/22 16:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/12/22 17:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/12/22 18:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/12/22 19:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/12/22 20:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/12/22 21:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/12/22 22:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/12/22 23:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/13/22 0:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/13/22 1:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/13/22 2:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/13/22 3:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/13/22 4:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/13/22 5:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/13/22 6:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/13/22 7:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/13/22 8:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/13/22 9:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/13/22 10:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/13/22 11:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/13/22 12:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/13/22 13:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/13/22 14:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/13/22 15:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/13/22 16:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/13/22 17:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/13/22 18:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/13/22 19:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/13/22 20:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/13/22 21:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/13/22 22:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/13/22 23:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/14/22 0:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/14/22 1:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/14/22 2:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/14/22 3:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/14/22 4:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/14/22 5:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/14/22 6:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/14/22 7:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/14/22 8:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/14/22 9:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/14/22 10:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/14/22 11:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/14/22 12:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/14/22 13:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/14/22 14:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/14/22 15:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/14/22 16:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/14/22 17:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/14/22 18:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/14/22 19:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/14/22 20:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/14/22 21:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/14/22 22:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/14/22 23:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/15/22 0:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/15/22 1:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/15/22 2:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/15/22 3:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/15/22 4:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/15/22 5:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/15/22 6:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/15/22 7:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/15/22 8:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/15/22 9:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/15/22 10:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/15/22 11:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/15/22 12:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/15/22 13:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/15/22 14:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/15/22 15:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/15/22 16:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/15/22 17:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/15/22 18:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/15/22 19:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/15/22 20:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/15/22 21:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/15/22 22:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/15/22 23:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/16/22 0:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/16/22 1:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/16/22 2:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/16/22 3:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/16/22 4:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/16/22 5:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/16/22 6:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/16/22 7:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/16/22 8:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/16/22 9:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/16/22 10:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/16/22 11:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/16/22 12:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/16/22 13:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/16/22 14:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/16/22 15:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/16/22 16:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/16/22 17:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/16/22 18:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/16/22 19:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/16/22 20:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/16/22 21:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/16/22 22:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/16/22 23:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/17/22 0:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/17/22 1:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/17/22 2:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/17/22 3:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/17/22 4:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/17/22 5:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/17/22 6:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/17/22 7:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/17/22 8:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/17/22 9:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/17/22 10:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/17/22 11:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/17/22 12:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/17/22 13:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/17/22 14:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/17/22 15:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/17/22 16:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/17/22 17:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/17/22 18:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/17/22 19:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/17/22 20:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/17/22 21:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/17/22 22:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/17/22 23:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/18/22 0:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/18/22 1:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/18/22 2:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/18/22 3:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/18/22 4:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/18/22 5:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/18/22 6:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/18/22 7:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/18/22 8:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/18/22 9:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/18/22 10:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/18/22 11:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/18/22 12:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/18/22 13:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/18/22 14:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/18/22 15:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/18/22 16:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/18/22 17:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/18/22 18:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/18/22 19:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/18/22 20:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/18/22 21:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/18/22 22:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/18/22 23:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/19/22 0:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/19/22 1:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/19/22 2:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/19/22 3:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/19/22 4:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/19/22 5:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/19/22 6:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/19/22 7:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/19/22 8:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/19/22 9:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/19/22 10:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/19/22 11:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/19/22 12:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/19/22 13:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/19/22 14:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/19/22 15:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/19/22 16:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/19/22 17:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/19/22 18:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/19/22 19:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/19/22 20:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/19/22 21:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/19/22 22:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/19/22 23:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/20/22 0:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/20/22 1:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/20/22 2:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/20/22 3:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/20/22 4:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/20/22 5:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/20/22 6:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/20/22 7:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/20/22 8:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/20/22 9:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/20/22 10:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/20/22 11:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/20/22 12:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/20/22 13:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/20/22 14:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/20/22 15:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/20/22 16:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/20/22 17:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/20/22 18:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/20/22 19:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/20/22 20:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/20/22 21:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/20/22 22:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/20/22 23:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/21/22 0:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/21/22 1:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/21/22 2:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/21/22 3:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/21/22 4:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/21/22 5:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/21/22 6:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/21/22 7:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/21/22 8:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/21/22 9:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/21/22 10:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/21/22 11:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/21/22 12:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/21/22 13:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/21/22 14:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/21/22 15:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/21/22 16:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/21/22 17:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/21/22 18:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/21/22 19:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/21/22 20:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/21/22 21:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/21/22 22:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/21/22 23:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/22/22 0:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/22/22 1:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/22/22 2:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/22/22 3:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/22/22 4:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/22/22 5:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/22/22 6:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/22/22 7:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/22/22 8:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/22/22 9:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/22/22 10:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/22/22 11:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/22/22 12:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/22/22 13:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/22/22 14:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/22/22 15:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/22/22 16:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/22/22 17:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/22/22 18:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/22/22 19:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/22/22 20:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/22/22 21:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/22/22 22:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/22/22 23:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/23/22 0:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/23/22 1:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/23/22 2:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/23/22 3:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/23/22 4:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/23/22 5:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/23/22 6:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/23/22 7:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/23/22 8:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/23/22 9:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/23/22 10:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/23/22 11:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/23/22 12:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/23/22 13:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/23/22 14:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/23/22 15:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/23/22 16:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/23/22 17:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/23/22 18:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/23/22 19:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/23/22 20:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/23/22 21:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/23/22 22:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/23/22 23:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/24/22 0:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/24/22 1:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/24/22 2:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/24/22 3:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/24/22 4:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/24/22 5:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/24/22 6:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/24/22 7:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/24/22 8:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/24/22 9:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/24/22 10:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/24/22 11:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/24/22 12:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/24/22 13:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/24/22 14:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/24/22 15:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/24/22 16:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/24/22 17:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/24/22 18:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/24/22 19:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/24/22 20:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/24/22 21:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/24/22 22:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/24/22 23:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/25/22 0:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/25/22 1:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/25/22 2:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/25/22 3:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/25/22 4:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/25/22 5:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/25/22 6:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/25/22 7:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/25/22 8:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/25/22 9:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/25/22 10:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/25/22 11:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/25/22 12:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/25/22 13:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/25/22 14:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/25/22 15:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/25/22 16:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/25/22 17:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/25/22 18:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/25/22 19:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/25/22 20:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/25/22 21:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/25/22 22:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/25/22 23:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/26/22 0:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/26/22 1:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/26/22 2:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/26/22 3:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/26/22 4:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/26/22 5:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/26/22 6:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/26/22 7:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/26/22 8:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/26/22 9:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/26/22 10:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/26/22 11:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/26/22 12:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/26/22 13:00	0	X		0	X		0	X	1	0			0			18.7		1
04/26/22 14:00	0	X		0	X		0	X	1	0.8			1.3			15.1		1
04/26/22 15:00	0	X		0	X		0	X	1	0.9			1.4			14.5		1
04/26/22 16:00	0	X		0	X		0	X	1	0.8			1.4			14.6		1
04/26/22 17:00	0	X		0	X		0	X	1	0.8			1.5			14.5		1
04/26/22 18:00	0	X		0	X		0	X	1	0.8			1.6			14.5		1
04/26/22 19:00	0	X		0	X		0	X	1	0.8			1.5			14.5		1
04/26/22 20:00	0	X		0	X		0	X	1	0.8			1.5			14.5		1
04/26/22 21:00	0	X		0	X		0	X	1	0.8			1.4			14.5		1
04/26/22 22:00	0	X		0	X		0	X	1	1			0.4			15.2		1
04/26/22 23:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/27/22 0:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/27/22 1:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/27/22 2:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/27/22 3:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/27/22 4:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/27/22 5:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/27/22 6:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/27/22 7:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/27/22 8:00	0	X		0	X		0	X	1	0			0			18.3		1
04/27/22 9:00	0	X		0	X		0	X	1	0			0			14.5		1
04/27/22 10:00	0	X		0	X		0	X	1	0.7			1.2			14.5		1
04/27/22 11:00	0	X		0	X		0	X	1	0.8			1.5			14.5		1
04/27/22 12:00	0	X		0	X		0	X	1	0.8			1.5			14.4		1
04/27/22 13:00	0	X		0	X		0	X	1	0.8			1.5			14.5		1
04/27/22 14:00	0	X		0	X		0	X	1	0.8			1.5			14.5		1
04/27/22 15:00	0	X		0	X		0	X	1	0.8			1.5			14.5		1
04/27/22 16:00	0	X		0	X		0	X	1	0.8			1.5			14.5		1
04/27/22 17:00	0	X		0	X		0	X	1	0.9			1.5			14.3		1
04/27/22 18:00	0	X		0	X		0	X	1	0.9			1.5			14.3		1
04/27/22 19:00	0	X		0	X		0	X	1	0			0			16.5		1
04/27/22 20:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/27/22 21:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/27/22 22:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/27/22 23:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/28/22 0:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/28/22 1:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/28/22 2:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/28/22 3:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/28/22 4:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/28/22 5:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/28/22 6:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/28/22 7:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/28/22 8:00	0	X		0	X		0	X	1	0			0			18.2		1
04/28/22 9:00	0	X		0	X		0	X	1	0.6			1.2			15.1		1
04/28/22 10:00	0	X		0	X		0	X	1	0.6			1.5			14.8		1
04/28/22 11:00	0	X		0	X		0	X	1	0.6			1.6			14.9		1
04/28/22 12:00	0	X		0	X		0	X	1	0.8			0.9			14.5		1
04/28/22 13:00	0	X		0	X		0	X	1	0.9			1.5			14.4		1
04/28/22 14:00	0	X		0	X		0	X	1	0.8			1.5			14.5		1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/28/22 15:00	0	X		0	X		0	X	1	0.8			1.5			14.5		1
04/28/22 16:00	0	X		0	X		0	X	1	0.6			1.7			14.9		1
04/28/22 17:00	0			0			18.9		1	0			0			16.2		1
04/28/22 18:00	0			0			18.2		1	0	X		0	X		0	X	1
04/28/22 19:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/28/22 20:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/28/22 21:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/28/22 22:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/28/22 23:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/29/22 0:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/29/22 1:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/29/22 2:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/29/22 3:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/29/22 4:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/29/22 5:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/29/22 6:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/29/22 7:00	0	X		0	X		0	X	0	0	X		0	X		0	X	1
04/29/22 8:00	0	X		0	X		0	X	0	0	X		0	X		0	X	1
04/29/22 9:00	0	X		0	X		0	X	0	0	X		0	X		0	X	1
04/29/22 10:00	0.7			1.5			14.6		1	0	X		0	X		0	X	1
04/29/22 11:00	0.6			1.5			14.5		1	0	X		0	X		0	X	1
04/29/22 12:00	0.6			1.4			14.6		1	0	X		0	X		0	X	1
04/29/22 13:00	0.6			1.6			14.5		1	0	X		0	X		0	X	1
04/29/22 14:00	0.6			1.5			14.5		1	0	X		0	X		0	X	1
04/29/22 15:00	0.6			1.5			14.5		1	0	X		0	X		0	X	1
04/29/22 16:00	0.7			1.6			14.8		1	0	X		0	X		0	X	1
04/29/22 17:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/29/22 18:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/29/22 19:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/29/22 20:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/29/22 21:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/29/22 22:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/29/22 23:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/30/22 0:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/30/22 1:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/30/22 2:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/30/22 3:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/30/22 4:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/30/22 5:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/30/22 6:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/30/22 7:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/30/22 8:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/30/22 9:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/30/22 10:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/30/22 11:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/30/22 12:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/30/22 13:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/30/22 14:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/30/22 15:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/30/22 16:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/30/22 17:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/30/22 18:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/30/22 19:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/30/22 20:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/30/22 21:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/30/22 22:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
04/30/22 23:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/01/22 0:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/01/22 1:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/01/22 2:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/01/22 3:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/01/22 4:00	0			0			17.1		1	0	X		0	X		0	X	1
05/01/22 5:00	1			1.5			14.3		1	0	X		0	X		0	X	1
05/01/22 6:00	1			1.5			14.3		1	0	X		0	X		0	X	1
05/01/22 7:00	0.6			1.5			14.5		1	0	X		0	X		0	X	1
05/01/22 8:00	0.6			1.6			14.7		1	0	X		0	X		0	X	1
05/01/22 9:00	0.5			1.5			14.7		1	0	X		0	X		0	X	1
05/01/22 10:00	0.5			1.5			14.8		1	0	X		0	X		0	X	1
05/01/22 11:00	0.5			1.5			14.8		1	0	X		0	X		0	X	1
05/01/22 12:00	0.5			1.5			14.8		1	0	X		0	X		0	X	1
05/01/22 13:00	0.5			1.5			14.9		1	0	X		0	X		0	X	1
05/01/22 14:00	0.4			1.5			14.9		1	0	X		0	X		0	X	1
05/01/22 15:00	0.5			1.5			14.9		1	0	X		0	X		0	X	1
05/01/22 16:00	0.4			1.5			14.9		1	0	X		0	X		0	X	1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/01/22 17:00	0.5			1.5			14.9		1	0	X		0	X		0	X	1
05/01/22 18:00	0.5			1.5			14.8		1	0	X		0	X		0	X	1
05/01/22 19:00	0.5			1.5			14.8		1	0	X		0	X		0	X	1
05/01/22 20:00	0.5			1.5			14.8		1	0	X		0	X		0	X	1
05/01/22 21:00	0.5			1.5			14.8		1	0	X		0	X		0	X	1
05/01/22 22:00	0.5			1.5			14.8		1	0	X		0	X		0	X	1
05/01/22 23:00	0.5			1.5			14.8		1	0	X		0	X		0	X	1
05/02/22 0:00	0.5			1.5			14.8		1	0	X		0	X		0	X	1
05/02/22 1:00	0.5			1.5			14.8		1	0	X		0	X		0	X	1
05/02/22 2:00	0.5			1.5			14.8		1	0	X		0	X		0	X	1
05/02/22 3:00	0.5			1.5			14.8		1	0	X		0	X		0	X	1
05/02/22 4:00	0.5			1.5			14.9		1	0	X		0	X		0	X	1
05/02/22 5:00	0.4			1.7			15		1	0	X		0	X		0	X	1
05/02/22 6:00	0.4			1.5			14.9		1	0	X		0	X		0	X	1
05/02/22 7:00	0.4			1.5			14.9		1	0	X		0	X		0	X	1
05/02/22 8:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
05/02/22 9:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
05/02/22 10:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
05/02/22 11:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
05/02/22 12:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
05/02/22 13:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
05/02/22 14:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
05/02/22 15:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
05/02/22 16:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
05/02/22 17:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
05/02/22 18:00	0.6			1.4			14.5		1	0	X		0	X		0	X	1
05/02/22 19:00	0.6			1.6			14.5		1	0	X		0	X		0	X	1
05/02/22 20:00	0.7			1.4			14.6		1	0	X		0	X		0	X	1
05/02/22 21:00	0.7			1.5			14.6		1	0	X		0	X		0	X	1
05/02/22 22:00	0.7			1.5			14.6		1	0	X		0	X		0	X	1
05/02/22 23:00	0.7			1.5			14.5		1	0	X		0	X		0	X	1
05/03/22 0:00	0.7			1.5			14.5		1	0	X		0	X		0	X	1
05/03/22 1:00	0			0			15.2		1	0	X		0	X		0	X	1
05/03/22 2:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/03/22 3:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/03/22 4:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/03/22 5:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/03/22 6:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/03/22 7:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/03/22 8:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/03/22 9:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/03/22 10:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/03/22 11:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/03/22 12:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/03/22 13:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/03/22 14:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/03/22 15:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/03/22 16:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/03/22 17:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/03/22 18:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/03/22 19:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/03/22 20:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/03/22 21:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/03/22 22:00	0			0			17.2		1	0	X		0	X		0	X	1
05/03/22 23:00	0.8			1.6			14.5		1	0			0			18.4		1
05/04/22 0:00	0.8			1.5			14.3		1	0.8			1.5			14.4		1
05/04/22 1:00	0.7			1.5			14.6		1	0.7			1.5			14.6		1
05/04/22 2:00	0.8			1.4			14.4		1	0.9			1.1			14.5		1
05/04/22 3:00	0.8			1.5			14.5		1	0.9			1.5			14.5		1
05/04/22 4:00	0.7			1.5			14.5		1	0.8			1.5			14.5		1
05/04/22 5:00	0.7			1.6			14.5		1	0.8			1.6			14.5		1
05/04/22 6:00	0.6			1.4			14.6		1	1			1.4			14.4		1
05/04/22 7:00	1			1.5			14.1		1	1.2			1.5			14.1		1
05/04/22 8:00	0.7			1.2			14.6		1	1			1.2			14.7		1
05/04/22 9:00	0.5			1			14.8		1	0.7			1.1			14.8		1
05/04/22 10:00	0.4			1.3			14.8		1	0.6			1.3			14.8		1
05/04/22 11:00	0.4			1.3			14.8		1	0.7			1.3			14.8		1
05/04/22 12:00	0.5			1.5			14.8		1	0.7			1.6			14.8		1
05/04/22 13:00	0.5			1.5			14.8		1	0.7			1.5			14.8		1
05/04/22 14:00	0.4			1.5			14.8		1	0.7			1.5			14.8		1
05/04/22 15:00	0.4			1.6			14.9		1	0.6			1.5			14.9		1
05/04/22 16:00	0.4			1.5			14.9		1	0.6			1.5			14.9		1
05/04/22 17:00	0.5			1.4			14.8		1	0.7			1.6			14.8		1
05/04/22 18:00	0.3			1.5			12.9		1	0.6			1.4			13		1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/04/22 19:00	0.6			1.5			13.6		1	0.9			1.5			13.6		1
05/04/22 20:00	0.7			1.5			13.8		1	1			1.5			13.7		1
05/04/22 21:00	0.4			1.5			13.2		1	0.7			1.5			13.2		1
05/04/22 22:00	0.9			1.5			13.9		1	1.2			1.5			13.8		1
05/04/22 23:00	0.9			1.6			14.3		1	1.1			1.2			14.3		1
05/05/22 0:00	0.6			1.6			14.5		1	0.8			1.4			14.5		1
05/05/22 1:00	0.5			1.4			14.6		1	0.7			1.4			14.6		1
05/05/22 2:00	0.5			1.5			14.6		1	0.7			1.5			14.7		1
05/05/22 3:00	0.5			1.5			14.6		1	0.7			1.5			14.7		1
05/05/22 4:00	0.5			1.4			14.5		1	0.7			1.3			14.6		1
05/05/22 5:00	0.6			1.5			14.4		1	0.8			1.5			14.4		1
05/05/22 6:00	0.4			1.5			14.7		1	0.6			1.4			14.7		1
05/05/22 7:00	0.4			1.5			14.7		1	0.6			1.5			14.7		1
05/05/22 8:00	0.4			1.5			14.7		1	0.6			1.5			14.8		1
05/05/22 9:00	0.5			1.4			14.6		1	0.7			1.5			14.6		1
05/05/22 10:00	0.5			1.3			14.7		1	0.7			1.3			14.7		1
05/05/22 11:00	0.4			1.4			14.7		1	0.7			1.4			14.7		1
05/05/22 12:00	0.6			1.2			14.5		1	0.8			1.3			14.4		1
05/05/22 13:00	0.6			1.5			14.6		1	0.8			1.6			14.5		1
05/05/22 14:00	0.4			1.4			14.7		1	0.7			1.3			14.6		1
05/05/22 15:00	0.5			1.5			14.6		1	0.7			1.5			14.6		1
05/05/22 16:00	0.4			1.5			14.8		1	0.6			1.5			14.8		1
05/05/22 17:00	0.5			1.4			14.6		1	0.7			1.4			14.6		1
05/05/22 18:00	1.3			1.5			14.2		1	1.8			1.5			14.2		1
05/05/22 19:00	1.3			1.5			14.2		1	1.7			1.5			14.2		1
05/05/22 20:00	1.3			1.5			14.2		1	1.7			1.5			14.2		1
05/05/22 21:00	1			1.6			14.3		1	1.3			1.6			14.3		1
05/05/22 22:00	0.6			1.5			14.5		1	0.8			1.3			14.5		1
05/05/22 23:00	0.5			1.5			14.6		1	0.7			1.5			14.7		1
05/06/22 0:00	0.5			1.5			14.6		1	0.7			1.5			14.6		1
05/06/22 1:00	0.5			1.5			14.6		1	0.6			1.5			14.7		1
05/06/22 2:00	0.5			1.6			14.6		1	0.7			1.6			14.6		1
05/06/22 3:00	0.6			1.4			14.5		1	0.8			1.4			14.5		1
05/06/22 4:00	1.2			1.5			14.3		1	1.6			1.5			14.3		1
05/06/22 5:00	1.2			1.5			14.2		1	1.8			1.5			14.3		1
05/06/22 6:00	1.1			1.5			14.2		1	1.7			1.5			14.3		1
05/06/22 7:00	0.7			1.5			14.4		1	0.9			1.3			14.3		1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/06/22 8:00	1.2			1.5			14.3		1	1.6			1.2			14.3		1
05/06/22 9:00	1.2			1.5			14.3		1	1.5			1.5			14.3		1
05/06/22 10:00	0.9			1.5			14.3		1	1.3			1.5			14.4		1
05/06/22 11:00	1.1			1.5			14.1		1	1.6			1.5			14.2		1
05/06/22 12:00	0.6			1.5			14.4		1	0.8			1.5			14.5		1
05/06/22 13:00	1			1.5			14.1		1	1.4			1.5			14.1		1
05/06/22 14:00	0.7			1.6			14.4		1	1			1.7			14.4		1
05/06/22 15:00	0.4			1.4			14.8		1	0.6			1.4			14.8		1
05/06/22 16:00	0.9			1.4			14.2		1	1.1			1.4			14.1		1
05/06/22 17:00	1			1.5			14		1	1.1			1.5			14.1		1
05/06/22 18:00	1.2			1.5			14.1		1	1.3			1.5			14.2		1
05/06/22 19:00	1.1			1.5			14.2		1	1.2			1.5			14.2		1
05/06/22 20:00	1.1			1.5			14.2		1	1.3			1.5			14.2		1
05/06/22 21:00	1.1			1.5			14.2		1	1.3			1.5			14.2		1
05/06/22 22:00	0.8			1.6			14.4		1	1.1			1.5			14.3		1
05/06/22 23:00	0.7			1.5			14.4		1	0	X		0	X		0	X	1
05/07/22 0:00	1.2			1.5			14.4		1	0	X		0	X		0	X	1
05/07/22 1:00	1			1.5			14.2		1	0	X		0	X		0	X	1
05/07/22 2:00	1			1.5			14.1		1	0	X		0	X		0	X	1
05/07/22 3:00	1.1			1.5			14.1		1	0	X		0	X		0	X	1
05/07/22 4:00	1.1			1.5			14.1		1	0	X		0	X		0	X	1
05/07/22 5:00	1.2			1.5			14.1		1	0	X		0	X		0	X	1
05/07/22 6:00	1.2			1.5			14.1		1	0	X		0	X		0	X	1
05/07/22 7:00	1			1.5			14.1		1	0	X		0	X		0	X	1
05/07/22 8:00	1.1			1.5			14.1		1	0	X		0	X		0	X	1
05/07/22 9:00	1			1.5			14.1		1	0	X		0	X		0	X	1
05/07/22 10:00	1			1.5			14.1		1	0	X		0	X		0	X	1
05/07/22 11:00	0.9			1.5			14.1		1	0	X		0	X		0	X	1
05/07/22 12:00	1			1.5			14.2		1	0			0			17.5		1
05/07/22 13:00	0.5			1.4			14.6		1	0.6			1.3			14.6		1
05/07/22 14:00	0.4			1.5			14.8		1	0.6			1.5			14.8		1
05/07/22 15:00	0.4			1.5			14.8		1	0.6			1.5			14.9		1
05/07/22 16:00	0.4			1.5			14.8		1	0.6			1.5			14.9		1
05/07/22 17:00	0.5			1.4			14.7		1	0.6			1.4			14.8		1
05/07/22 18:00	1			1.5			14.2		1	1.2			1.6			14.1		1
05/07/22 19:00	1.2			1.5			14.2		1	1.3			1.5			14.2		1
05/07/22 20:00	1.1			1.5			14.4		1	1.2			1.5			14.3		1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/07/22 21:00	0.5			1.5			14.7		1	0.7			1.3			14.7		1
05/07/22 22:00	0.4			1.3			14.8		1	0.6			1.3			14.8		1
05/07/22 23:00	0.4			1.3			14.8		1	0.6			1.3			14.8		1
05/08/22 0:00	0.4			1.3			14.8		1	0.6			1.3			14.8		1
05/08/22 1:00	0.4			1.3			14.8		1	0.6			1.3			14.8		1
05/08/22 2:00	0.3			1.3			14.9		1	0.6			1.3			14.8		1
05/08/22 3:00	0.4			1.4			14.8		1	0.6			1.3			14.8		1
05/08/22 4:00	0.4			1.3			14.8		1	0.6			1.3			14.7		1
05/08/22 5:00	0.4			1.5			14.9		1	0.6			1.5			14.8		1
05/08/22 6:00	0			0			16		1	0.7			1.3			14.6		1
05/08/22 7:00	0	X		0	X		0	X	1	0.7			1.5			14.6		1
05/08/22 8:00	0	X		0	X		0	X	1	0.7			1.5			14.6		1
05/08/22 9:00	0	X		0	X		0	X	1	0.7			1.5			14.6		1
05/08/22 10:00	0	X		0	X		0	X	1	0.7			1.5			14.6		1
05/08/22 11:00	0	X		0	X		0	X	1	0.7			1.5			14.6		1
05/08/22 12:00	0	X		0	X		0	X	1	0.7			1.5			14.6		1
05/08/22 13:00	0	X		0	X		0	X	1	0.7			1.5			14.7		1
05/08/22 14:00	0	X		0	X		0	X	1	0.7			1.5			14.7		1
05/08/22 15:00	0	X		0	X		0	X	1	0.7			1.5			14.7		1
05/08/22 16:00	0	X		0	X		0	X	1	0.9			1.3			14.6		1
05/08/22 17:00	0			0			15.7		1	0.9			1.6			14.4		1
05/08/22 18:00	0.4			1.3			14.7		1	0.6			1.3			14.7		1
05/08/22 19:00	1.2			1.5			14.3		1	2.1			1.5			14.3		1
05/08/22 20:00	1.1			1.5			14.3		1	1.8			1.5			14.3		1
05/08/22 21:00	1			1.5			14.3		1	1.6			1.5			14.3		1
05/08/22 22:00	0.4			1.7			14.7		1	0.7			1.6			14.7		1
05/08/22 23:00	0.3			1.5			14.9		1	0.6			1.5			14.8		1
05/09/22 0:00	0.3			1.5			14.9		1	0.6			1.5			14.8		1
05/09/22 1:00	0.3			1.5			14.9		1	0.6			1.5			14.8		1
05/09/22 2:00	0.3			1.5			14.9		1	0.6			1.5			14.8		1
05/09/22 3:00	0.4			1.5			14.8		1	0.6			1.5			14.8		1
05/09/22 4:00	0.4			1.5			14.8		1	0.6			1.5			14.8		1
05/09/22 5:00	0.4			1.6			14.8		1	0.6			1.5			14.8		1
05/09/22 6:00	0.3			1.5			14.9		1	0.6			1.5			14.9		1
05/09/22 7:00	0.3			1.5			14.9		1	0.5			1.5			14.8		1
05/09/22 8:00	0.3			1.5			14.9		1	0.6			1.5			14.8		1
05/09/22 9:00	0.3			1.5			14.9		1	0.6			1.5			14.8		1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/09/22 10:00	0.3			1.5			14.9		1	0.6			1.5			14.8		1
05/09/22 11:00	0			0			16.8		1	0.7			1.3			14.5		1
05/09/22 12:00	0	X		0	X		0	X	1	0.7			1.5			14.6		1
05/09/22 13:00	0	X		0	X		0	X	1	0.7			1.5			14.6		1
05/09/22 14:00	0	X		0	X		0	X	1	0.7			1.5			14.6		1
05/09/22 15:00	0	X		0	X		0	X	1	0.7			1.5			14.6		1
05/09/22 16:00	0	X		0	X		0	X	1	0.7			1.5			14.6		1
05/09/22 17:00	0	X		0	X		0	X	1	0.7			1.5			14.6		1
05/09/22 18:00	0	X		0	X		0	X	1	0.7			1.5			14.6		1
05/09/22 19:00	0	X		0	X		0	X	1	0.7			1.5			14.5		1
05/09/22 20:00	0	X		0	X		0	X	1	0.7			1.5			14.5		1
05/09/22 21:00	0	X		0	X		0	X	1	0.7			1.5			14.5		1
05/09/22 22:00	0	X		0	X		0	X	1	0.7			1.5			14.5		1
05/09/22 23:00	0	X		0	X		0	X	1	0			0			16.6		1
05/10/22 0:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/10/22 1:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/10/22 2:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/10/22 3:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/10/22 4:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/10/22 5:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/10/22 6:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/10/22 7:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/10/22 8:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/10/22 9:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/10/22 10:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/10/22 11:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/10/22 12:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/10/22 13:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/10/22 14:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/10/22 15:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/10/22 16:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/10/22 17:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/10/22 18:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/10/22 19:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/10/22 20:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/10/22 21:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/10/22 22:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/10/22 23:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/11/22 0:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/11/22 1:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/11/22 2:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/11/22 3:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/11/22 4:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/11/22 5:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/11/22 6:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/11/22 7:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/11/22 8:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/11/22 9:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/11/22 10:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/11/22 11:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/11/22 12:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/11/22 13:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/11/22 14:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/11/22 15:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/11/22 16:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/11/22 17:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/11/22 18:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/11/22 19:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/11/22 20:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/11/22 21:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/11/22 22:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/11/22 23:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/12/22 0:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/12/22 1:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/12/22 2:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/12/22 3:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/12/22 4:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/12/22 5:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/12/22 6:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/12/22 7:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/12/22 8:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/12/22 9:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/12/22 10:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/12/22 11:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/12/22 12:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/12/22 13:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/12/22 14:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/12/22 15:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/12/22 16:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/12/22 17:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/12/22 18:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/12/22 19:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/12/22 20:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/12/22 21:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/12/22 22:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/12/22 23:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/13/22 0:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/13/22 1:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/13/22 2:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/13/22 3:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/13/22 4:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/13/22 5:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/13/22 6:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/13/22 7:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/13/22 8:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/13/22 9:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/13/22 10:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/13/22 11:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/13/22 12:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/13/22 13:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/13/22 14:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/13/22 15:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/13/22 16:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/13/22 17:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/13/22 18:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/13/22 19:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/13/22 20:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/13/22 21:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/13/22 22:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/13/22 23:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/14/22 0:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/14/22 1:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/14/22 2:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/14/22 3:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/14/22 4:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/14/22 5:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/14/22 6:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/14/22 7:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/14/22 8:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/14/22 9:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/14/22 10:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/14/22 11:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/14/22 12:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/14/22 13:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/14/22 14:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/14/22 15:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/14/22 16:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/14/22 17:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/14/22 18:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/14/22 19:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/14/22 20:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/14/22 21:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/14/22 22:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/14/22 23:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/15/22 0:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/15/22 1:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/15/22 2:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/15/22 3:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/15/22 4:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/15/22 5:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/15/22 6:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/15/22 7:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/15/22 8:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/15/22 9:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/15/22 10:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/15/22 11:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/15/22 12:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/15/22 13:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/15/22 14:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/15/22 15:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/15/22 16:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/15/22 17:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/15/22 18:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/15/22 19:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/15/22 20:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/15/22 21:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/15/22 22:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/15/22 23:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/16/22 0:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/16/22 1:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/16/22 2:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/16/22 3:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/16/22 4:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/16/22 5:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/16/22 6:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/16/22 7:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/16/22 8:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/16/22 9:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/16/22 10:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/16/22 11:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/16/22 12:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/16/22 13:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/16/22 14:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/16/22 15:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/16/22 16:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/16/22 17:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/16/22 18:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/16/22 19:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/16/22 20:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/16/22 21:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/16/22 22:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/16/22 23:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/17/22 0:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/17/22 1:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/17/22 2:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/17/22 3:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/17/22 4:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/17/22 5:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/17/22 6:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/17/22 7:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/17/22 8:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/17/22 9:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/17/22 10:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/17/22 11:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/17/22 12:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/17/22 13:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/17/22 14:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/17/22 15:00	0			0			16		1	0	X		0	X		0	X	1
05/17/22 16:00	0.6			1.4			14.6		1	0	X		0	X		0	X	1
05/17/22 17:00	0.6			1.5			14.5		1	0			0			16.1		1
05/17/22 18:00	0.6			1.5			14.6		1	0.8			1.5			14.5		1
05/17/22 19:00	1.1			1.5			14.3		1	1.2			1.5			14		1
05/17/22 20:00	0.8			1.5			13.8		1	1.1			1.5			13.7		1
05/17/22 21:00	0.7			1.5			13.6		1	0.9			1.5			13.5		1
05/17/22 22:00	0.9			1.5			14.2		1	1			1.6			14.1		1
05/17/22 23:00	0.4			1.6			14.9		1	0.6			1.5			14.8		1
05/18/22 0:00	0.4			1.5			14.9		1	0.6			1.5			14.8		1
05/18/22 1:00	0.4			1.5			14.9		1	0.6			1.5			14.8		1
05/18/22 2:00	0.6			1.4			14.6		1	0.7			1.2			14.5		1
05/18/22 3:00	0.7			1.6			12.7		1	1.1			1.5			12.7		1
05/18/22 4:00	0.1			1.5			11.8		1	0.3			1.5			11.9		1
05/18/22 5:00	0.7			1.5			13.8		1	0.9			1.5			13.8		1
05/18/22 6:00	0.6			1.6			14.5		1	0.8			1.6			14.4		1
05/18/22 7:00	0.6			1			14.5		1	0.8			1.1			14.5		1
05/18/22 8:00	0.6			1.5			14.5		1	0.8			1.5			14.5		1
05/18/22 9:00	0.6			1.5			14.5		1	0.7			1.5			14.5		1
05/18/22 10:00	0.8			1.5			14.4		1	1			1.5			14.4		1
05/18/22 11:00	0.3			1.5			12.9		1	0.5			1.5			12.9		1
05/18/22 12:00	1.2			1.5			14.3		1	1.3			1.5			14.3		1
05/18/22 13:00	0.8			1.5			13.4		1	1			1.5			13.4		1
05/18/22 14:00	0.1			1.5			12.2		1	0.3			1.5			12.2		1
05/18/22 15:00	0.3			1.5			13.1		1	0.5			1.5			13		1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/18/22 16:00	0.8			1.5			13.8		1	0.8			1.5			13.7		1
05/18/22 17:00	0.2			1.5			12.5		1	0.4			1.5			12.5		1
05/18/22 18:00	0.2			1.5			12.9		1	0.4			1.5			12.9		1
05/18/22 19:00	0.5			1.5			13.2		1	0.6			1.5			13.1		1
05/18/22 20:00	0.2			1.5			12.5		1	0.4			1.5			12.5		1
05/18/22 21:00	0.9			1.5			13.8		1	1			1.5			13.8		1
05/18/22 22:00	1			1.5			13.9		1	1			1.5			13.9		1
05/18/22 23:00	0.9			1.5			14.3		1	1.1			1.6			14.3		1
05/19/22 0:00	0.4			1.7			15.1		1	0.8			1.3			14.6		1
05/19/22 1:00	0	X		0	X		0	X	1	0.7			1.6			14.5		1
05/19/22 2:00	0	X		0	X		0	X	1	0.7			1.5			14.6		1
05/19/22 3:00	0	X		0	X		0	X	1	1.6			1.4			14.3		1
05/19/22 4:00	0	X		0	X		0	X	1	1.8			1.5			14.2		1
05/19/22 5:00	0	X		0	X		0	X	1	1.5			1.5			14.2		1
05/19/22 6:00	0	X		0	X		0	X	1	0.8			1.4			14.5		1
05/19/22 7:00	0	X		0	X		0	X	1	0.8			1.4			14.4		1
05/19/22 8:00	0	X		0	X		0	X	1	0.7			1.3			14.5		1
05/19/22 9:00	0	X		0	X		0	X	1	0.7			1.5			14.6		1
05/19/22 10:00	0	X		0	X		0	X	1	0.7			1.5			14.7		1
05/19/22 11:00	0	X		0	X		0	X	1	1.6			1.4			14.4		1
05/19/22 12:00	0			0			16.1		1	0	X		0	X		0	X	0
05/19/22 13:00	0.6			1.3			14.6		1	0.8			1.3			14.6		1
05/19/22 14:00	0.9			1.4			13.8		1	1			1.3			13.7		1
05/19/22 15:00	0.8			1.4			14.4		1	0.9			1.3			14.3		1
05/19/22 16:00	0.7			1.4			14.5		1	0.8			1.3			14.4		1
05/19/22 17:00	0.9			1.4			14		1	1.1			1.3			14		1
05/19/22 18:00	0.9			1.4			13.9		1	1.1			1.3			13.8		1
05/19/22 19:00	0.7			1.5			13.7		1	0.9			1.5			13.6		1
05/19/22 20:00	0.4			1.5			13.1		1	0.6			1.5			13.1		1
05/19/22 21:00	0.9			1.5			13.9		1	1			1.5			13.8		1
05/19/22 22:00	0.9			1.4			14.6		1	0.9			1.4			14.4		1
05/19/22 23:00	0	X		0	X		0	X	1	0			0			15.4		1
05/20/22 0:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/20/22 1:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/20/22 2:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/20/22 3:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/20/22 4:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/20/22 5:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/20/22 6:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/20/22 7:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/20/22 8:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/20/22 9:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/20/22 10:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/20/22 11:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/20/22 12:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/20/22 13:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/20/22 14:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/20/22 15:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/20/22 16:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/20/22 17:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/20/22 18:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/20/22 19:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/20/22 20:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/20/22 21:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/20/22 22:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/20/22 23:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/21/22 0:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/21/22 1:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/21/22 2:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/21/22 3:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/21/22 4:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/21/22 5:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/21/22 6:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/21/22 7:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/21/22 8:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/21/22 9:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/21/22 10:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/21/22 11:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/21/22 12:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/21/22 13:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/21/22 14:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/21/22 15:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/21/22 16:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/21/22 17:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/21/22 18:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/21/22 19:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/21/22 20:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/21/22 21:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/21/22 22:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/21/22 23:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/22/22 0:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/22/22 1:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/22/22 2:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/22/22 3:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/22/22 4:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/22/22 5:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/22/22 6:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/22/22 7:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/22/22 8:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/22/22 9:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/22/22 10:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/22/22 11:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/22/22 12:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/22/22 13:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/22/22 14:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/22/22 15:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/22/22 16:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/22/22 17:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/22/22 18:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/22/22 19:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/22/22 20:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/22/22 21:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/22/22 22:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/22/22 23:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/23/22 0:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/23/22 1:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/23/22 2:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/23/22 3:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/23/22 4:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/23/22 5:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/23/22 6:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/23/22 7:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/23/22 8:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/23/22 9:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/23/22 10:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/23/22 11:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/23/22 12:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/23/22 13:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/23/22 14:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/23/22 15:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/23/22 16:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/23/22 17:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/23/22 18:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/23/22 19:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/23/22 20:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/23/22 21:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/23/22 22:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/23/22 23:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/24/22 0:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/24/22 1:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/24/22 2:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/24/22 3:00	0	X		0	X		0	X	1	0			0			17		1
05/24/22 4:00	0	X		0	X		0	X	1	0.8			1.4			14.6		1
05/24/22 5:00	0	X		0	X		0	X	1	0.8			1.5			14.6		1
05/24/22 6:00	0	X		0	X		0	X	1	0.8			1.5			14.5		1
05/24/22 7:00	0	X		0	X		0	X	1	1.4			1.5			14.4		1
05/24/22 8:00	0			0			15.7		1	1.3			1.5			14.3		1
05/24/22 9:00	0.5			1.5			14.7		1	0.8			1.5			14.7		1
05/24/22 10:00	0.7			1.4			14.6		1	0.9			1.4			14.5		1
05/24/22 11:00	0.7			1.5			14.5		1	0.9			1.5			14.4		1
05/24/22 12:00	0.8			1.5			14.4		1	1.1			1.5			14.3		1
05/24/22 13:00	0.7			1.5			13.6		1	1			1.5			13.5		1
05/24/22 14:00	0.2			1.5			12.5		1	0.4			1.5			12.4		1
05/24/22 15:00	0.1			1.5			11.9		1	0.3			1.5			11.9		1
05/24/22 16:00	0.1			1.5			12.4		1	0.4			1.5			12.4		1
05/24/22 17:00	0.3			1.5			12.9		1	0.5			1.5			12.9		1
05/24/22 18:00	0.1			1.5			11.8		1	0.3			1.5			11.9		1
05/24/22 19:00	0.1			1.5			12.2		1	0.3			1.5			12.1		1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/24/22 20:00	0.4			1.5			13.3		1	0.7			1.5			13.2		1
05/24/22 21:00	0.6			1.5			13.5		1	0.9			1.5			13.4		1
05/24/22 22:00	0.4			1.5			12.9		1	0.6			1.5			12.9		1
05/24/22 23:00	1			1.6			14.4		1	1.3			1.6			14.3		1
05/25/22 0:00	0.6			1.3			14.7		1	0.9			1.3			14.6		1
05/25/22 1:00	0.6			1.6			14.5		1	0.8			1.5			14.5		1
05/25/22 2:00	0.6			1.6			14.7		1	0.8			1.6			14.6		1
05/25/22 3:00	1			1.4			14.4		1	0	X		1.4			14.3		1
05/25/22 4:00	1.4			1.5			14.1		1	0	X		1.5			14.1		1
05/25/22 5:00	1			1.5			14.4		1	0	X		1.5			14.3		1
05/25/22 6:00	1.3			1.5			14.1		1	0	X		1.5			14.1		1
05/25/22 7:00	0.8			1.6			14.5		1	0	X		1.6			14.4		1
05/25/22 8:00	0.4			1.5			14.9		1	0	X		1.5			14.8		1
05/25/22 9:00	0.6			1.1			14.5		1	0	X		1.3			14.4		1
05/25/22 10:00	1			1.4			14.5		1	0	X		1.5			14.4		1
05/25/22 11:00	0.2			1.5			12.2		1	0	X		1.5			12.2		1
05/25/22 12:00	0.1			1.5			11.8		1	0	X		1.5			11.7		1
05/25/22 13:00	0.1			1.5			11.8		1	0	X		1.5			11.7		1
05/25/22 14:00	0.1			1.5			11.7		1	0	X		1.5			11.7		1
05/25/22 15:00	0.1			1.5			11.7		1	0	X		1.5			11.8		1
05/25/22 16:00	0.1			1.5			11.7		1	0	X		1.5			11.8		1
05/25/22 17:00	0.1			1.5			11.8		1	0	X		1.5			11.9		1
05/25/22 18:00	0.1			1.5			11.8		1	0	X		1.5			11.8		1
05/25/22 19:00	0.3			1.5			13		1	0	X		1.5			13		1
05/25/22 20:00	0.8			1.5			13.8		1	0	X		1.5			13.7		1
05/25/22 21:00	0.8			1.5			13.7		1	0	X		1.5			13.6		1
05/25/22 22:00	0.8			1.5			14.5		1	0	X		1.6			14.3		1
05/25/22 23:00	0			0			17.6		1	0	X		0.9			15.1		1
05/26/22 0:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/26/22 1:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/26/22 2:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/26/22 3:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/26/22 4:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/26/22 5:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/26/22 6:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/26/22 7:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/26/22 8:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/26/22 9:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/26/22 10:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/26/22 11:00	0			0			17.1		1	0	X		0	X		0	X	1
05/26/22 12:00	0.5			1.1			14.7		1	0	X		0	X		0	X	1
05/26/22 13:00	0.4			1.4			14.8		1	0	X		0	X		0	X	1
05/26/22 14:00	0.7			0.9			14.6		1	0	X		0			19.4		1
05/26/22 15:00	1.5			1.2			14.3		1	0	X		0	X		0	X	1
05/26/22 16:00	1.6			1.2			14.3		1	0	X		0	X		0	X	1
05/26/22 17:00	1.6			1.4			14.3		1	0	X		0	X		0	X	1
05/26/22 18:00	1.5			1.5			14.3		1	0	X		0	X		0	X	1
05/26/22 19:00	1.4			1.5			14.3		1	0	X		0	X		0	X	1
05/26/22 20:00	0.9			1.4			14.8		1	0	X		0	X		0	X	1
05/26/22 21:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/26/22 22:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/26/22 23:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/27/22 0:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/27/22 1:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/27/22 2:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/27/22 3:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/27/22 4:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/27/22 5:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/27/22 6:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/27/22 7:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/27/22 8:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/27/22 9:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/27/22 10:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/27/22 11:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/27/22 12:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/27/22 13:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/27/22 14:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/27/22 15:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/27/22 16:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/27/22 17:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/27/22 18:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/27/22 19:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/27/22 20:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/27/22 21:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/27/22 22:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/27/22 23:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/28/22 0:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/28/22 1:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/28/22 2:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/28/22 3:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/28/22 4:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/28/22 5:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/28/22 6:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/28/22 7:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/28/22 8:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/28/22 9:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/28/22 10:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/28/22 11:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/28/22 12:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/28/22 13:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/28/22 14:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/28/22 15:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/28/22 16:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/28/22 17:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/28/22 18:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/28/22 19:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/28/22 20:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/28/22 21:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/28/22 22:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/28/22 23:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/29/22 0:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/29/22 1:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/29/22 2:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/29/22 3:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/29/22 4:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/29/22 5:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/29/22 6:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/29/22 7:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/29/22 8:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/29/22 9:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/29/22 10:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/29/22 11:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/29/22 12:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/29/22 13:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/29/22 14:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/29/22 15:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/29/22 16:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/29/22 17:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/29/22 18:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/29/22 19:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/29/22 20:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/29/22 21:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/29/22 22:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/29/22 23:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/30/22 0:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/30/22 1:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/30/22 2:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/30/22 3:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/30/22 4:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/30/22 5:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/30/22 6:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/30/22 7:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/30/22 8:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/30/22 9:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/30/22 10:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/30/22 11:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/30/22 12:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/30/22 13:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/30/22 14:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/30/22 15:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/30/22 16:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/30/22 17:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/30/22 18:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/30/22 19:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/30/22 20:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/30/22 21:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/30/22 22:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/30/22 23:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/31/22 0:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/31/22 1:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/31/22 2:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/31/22 3:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/31/22 4:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/31/22 5:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/31/22 6:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/31/22 7:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/31/22 8:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/31/22 9:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/31/22 10:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/31/22 11:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/31/22 12:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/31/22 13:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/31/22 14:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/31/22 15:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/31/22 16:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/31/22 17:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/31/22 18:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/31/22 19:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/31/22 20:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/31/22 21:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/31/22 22:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
05/31/22 23:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/01/22 0:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/01/22 1:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/01/22 2:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/01/22 3:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/01/22 4:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/01/22 5:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/01/22 6:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/01/22 7:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/01/22 8:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/01/22 9:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/01/22 10:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/01/22 11:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/01/22 12:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/01/22 13:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/01/22 14:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/01/22 15:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/01/22 16:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/01/22 17:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/01/22 18:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/01/22 19:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/01/22 20:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/01/22 21:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/01/22 22:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/01/22 23:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/02/22 0:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/02/22 1:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/02/22 2:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/02/22 3:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/02/22 4:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/02/22 5:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/02/22 6:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/02/22 7:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/02/22 8:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/02/22 9:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/02/22 10:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/02/22 11:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/02/22 12:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/02/22 13:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/02/22 14:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/02/22 15:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/02/22 16:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/02/22 17:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/02/22 18:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/02/22 19:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/02/22 20:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/02/22 21:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/02/22 22:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/02/22 23:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/03/22 0:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/03/22 1:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/03/22 2:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/03/22 3:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/03/22 4:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/03/22 5:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/03/22 6:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/03/22 7:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/03/22 8:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/03/22 9:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/03/22 10:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/03/22 11:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/03/22 12:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/03/22 13:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/03/22 14:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/03/22 15:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/03/22 16:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/03/22 17:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/03/22 18:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/03/22 19:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/03/22 20:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/03/22 21:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/03/22 22:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/03/22 23:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/04/22 0:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/04/22 1:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/04/22 2:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/04/22 3:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/04/22 4:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/04/22 5:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/04/22 6:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/04/22 7:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/04/22 8:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/04/22 9:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/04/22 10:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/04/22 11:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/04/22 12:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/04/22 13:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/04/22 14:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/04/22 15:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/04/22 16:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/04/22 17:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/04/22 18:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/04/22 19:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/04/22 20:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/04/22 21:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/04/22 22:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/04/22 23:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/05/22 0:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/05/22 1:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/05/22 2:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/05/22 3:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/05/22 4:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/05/22 5:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/05/22 6:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/05/22 7:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/05/22 8:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/05/22 9:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/05/22 10:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/05/22 11:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/05/22 12:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/05/22 13:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/05/22 14:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/05/22 15:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/05/22 16:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/05/22 17:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/05/22 18:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/05/22 19:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/05/22 20:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/05/22 21:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/05/22 22:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/05/22 23:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/06/22 0:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/06/22 1:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/06/22 2:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/06/22 3:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/06/22 4:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/06/22 5:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/06/22 6:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/06/22 7:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/06/22 8:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/06/22 9:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/06/22 10:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/06/22 11:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/06/22 12:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/06/22 13:00	0			0			16.8		1	0	X		0	X		0	X	1
06/06/22 14:00	0.6			1.6			14.6		1	0	X		0	X		0	X	1
06/06/22 15:00	0.7			1.5			14.6		1	0	X		0	X		0	X	1
06/06/22 16:00	0.7			1.5			14.6		1	0	X		0	X		0	X	1
06/06/22 17:00	0.7			1.5			14.6		1	0	X		0	X		0	X	1
06/06/22 18:00	0			0			15.1		1	0	X		0	X		0	X	1
06/06/22 19:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/06/22 20:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/06/22 21:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/06/22 22:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/06/22 23:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/07/22 0:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/07/22 1:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/07/22 2:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/07/22 3:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/07/22 4:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/07/22 5:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/07/22 6:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/07/22 7:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/07/22 8:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/07/22 9:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/07/22 10:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/07/22 11:00	0	X		0	X		0	X	1	0	X		0	X		0	X	0
06/07/22 12:00	0	X		0	X		0	X	1	0	X		0	X		0	X	0
06/07/22 13:00	0	X		0	X		0	X	1	0	X		0.9	X		0	X	0
06/07/22 14:00	0	X		0	X		0	X	1	0	X		0	X		0	X	0
06/07/22 15:00	0	X		0	X		0	X	1	0	X		0	X		0	X	0
06/07/22 16:00	0	X		0	X		0	X	1	0	X		0	X		0	X	0

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/07/22 17:00	0	X		0	X		0	X	1	0	X		0	X		0	X	0
06/07/22 18:00	0	X		0	X		0	X	1	0	X		0	X		0	X	0
06/07/22 19:00	0	X		0	X		0	X	1	0	X		0	X		0	X	0
06/07/22 20:00	0	X		0	X		0	X	1	0			0			15.8		1
06/07/22 21:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/07/22 22:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/07/22 23:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/08/22 0:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/08/22 1:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/08/22 2:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
06/08/22 3:00	0			0			18		1	0	X		0	X		0	X	1
06/08/22 4:00	0.6			1.4			14.5		1	0	X		0	X		0	X	1
06/08/22 5:00	0.6			1.5			14.5		1	0	X		0	X		0	X	1
06/08/22 6:00	0.6			1.5			14.5		1	0	X		0	X		0	X	1
06/08/22 7:00	0.7			1.5			14.3		1	0	X		0	X		0	X	1
06/08/22 8:00	0.7			1.5			14.4		1	0	X		0	X		0	X	1
06/08/22 9:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
06/08/22 10:00	0.5			1.5			14.7		1	0	X		0	X		0	X	1
06/08/22 11:00	0.5			1.5			14.8		1	0	X		0	X		0	X	1
06/08/22 12:00	0.5			1.4			14.7		1	0	X		0	X		0	X	1
06/08/22 13:00	1.6			1.5			14.4		1	0	X		0	X		0	X	1
06/08/22 14:00	1.1			1.5			14.1		1	0.7			1.4			15.6		1
06/08/22 15:00	0.7			1.3			14.5		1	0.7			1.4			14.5		1
06/08/22 16:00	0.9			1.5			14.5		1	1.2			1.5			14.4		1
06/08/22 17:00	0.7			1.5			13.3		1	1			1.5			13.2		1
06/08/22 18:00	0.1			1.5			11.8		1	0.3			1.5			11.8		1
06/08/22 19:00	0.2			1.5			12.5		1	0.4			1.5			12.5		1
06/08/22 20:00	0.7			1.5			13.5		1	0.7			1.5			13.5		1
06/08/22 21:00	1			1.5			13.9		1	1			1.5			13.9		1
06/08/22 22:00	1.1			1.5			14.1		1	1.1			1.5			14		1
06/08/22 23:00	1.1			1.5			13.9		1	1			1.5			13.8		1
06/09/22 0:00	1			1.5			13.9		1	1			1.5			13.8		1
06/09/22 1:00	1.1			1.5			14		1	1.2			1.5			13.9		1
06/09/22 2:00	0.9			1.5			14.4		1	1.1			1.5			14.5		1
06/09/22 3:00	1.8			1.5			14.3		1	0	X		0	X		0	X	1
06/09/22 4:00	1.7			1.5			14.3		1	0	X		0	X		0	X	1
06/09/22 5:00	0.7			1.6			14.5		1	0	X		0	X		0	X	1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/09/22 6:00	0.6			1.5			14.5		1	0	X		0	X		0	X	1
06/09/22 7:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
06/09/22 8:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
06/09/22 9:00	0.6			1.4			14.6		1	0	X		0	X		0	X	1
06/09/22 10:00	0.7			1.5			14.5		1	0			0			17.2		1
06/09/22 11:00	0.5			1.5			14.7		1	0.6			1			14.5		1
06/09/22 12:00	0.5			1.5			14.9		1	0.6			1.5			14.8		1
06/09/22 13:00	0.6			1.1			14.6		1	0.7			1.3			14.5		1
06/09/22 14:00	0.7			1.3			14		1	0.8			1.5			13.9		1
06/09/22 15:00	0.6			1.5			13.5		1	0.7			1.5			13.4		1
06/09/22 16:00	0.8			1.4			14.3		1	0.8			1.5			14.2		1
06/09/22 17:00	0.5			1.5			13.5		1	0.6			1.5			13.4		1
06/09/22 18:00	0.5			1.5			13.4		1	0.6			1.5			13.3		1
06/09/22 19:00	1			1.5			13.9		1	0.9			1.5			13.8		1
06/09/22 20:00	0.5			1.5			13.2		1	0.6			1.5			13.2		1
06/09/22 21:00	0.7			1.5			13.6		1	0.7			1.5			13.5		1
06/09/22 22:00	0.9			1.5			14.4		1	1			1.5			14.3		1
06/09/22 23:00	0.9			1.5			13.7		1	1			1.5			13.6		1
06/10/22 0:00	1.2			1.5			14		1	1.2			1.5			13.9		1
06/10/22 1:00	1.2			1.5			14		1	1.1			1.5			13.9		1
06/10/22 2:00	1.2			1.5			14		1	1.1			1.5			14		1
06/10/22 3:00	1.3			1.5			14.1		1	1.1			1.5			14		1
06/10/22 4:00	1.3			1.5			14.1		1	1.3			1.5			14		1
06/10/22 5:00	1			1.5			13.7		1	1			1.5			13.7		1
06/10/22 6:00	1.2			1.5			14.2		1	1.3			1.5			14.2		1
06/10/22 7:00	0.7			1.5			14.5		1	0.8			1.5			14.4		1
06/10/22 8:00	0.6			1.5			14.5		1	0.7			1.5			14.4		1
06/10/22 9:00	0.6			1.5			14.5		1	0.7			1.5			14.5		1
06/10/22 10:00	1.3			1.5			14.4		1	1.5			1.5			14.3		1
06/10/22 11:00	0.9			1.5			13.8		1	1			1.5			13.8		1
06/10/22 12:00	0.6			1.5			13.4		1	0.6			1.4			13.3		1
06/10/22 13:00	0.2			1.5			12.8		1	0.3			1.5			12.8		1
06/10/22 14:00	0.1			1.5			12.2		1	0.2			1.5			12.2		1
06/10/22 15:00	0.1			1.5			12.3		1	0.2			1.5			12.2		1
06/10/22 16:00	0.5			1.5			13.3		1	0.8			1.5			14		1
06/10/22 17:00	0.1			1.5			12.1		1	0.2			1.5			12.1		1
06/10/22 18:00	0.1			1.5			12.1		1	0.2			1.5			12.1		1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/10/22 19:00	0.2			1.5			12.6		1	0.3			1.5			12.5		1
06/10/22 20:00	0.4			1.5			13.2		1	0.5			1.5			13.2		1
06/10/22 21:00	0.4			1.5			13.1		1	0.5			1.5			13.1		1
06/10/22 22:00	0.9			1.5			14.3		1	1			1.5			14.2		1
06/10/22 23:00	0.6			1.4			14.5		1	0			0			15.3		1
06/11/22 0:00	1.6			1.5			14.3		1	0			0			18		1
06/11/22 1:00	0.6			1.5			14.7		1	0.5			1.4			14.6		1
06/11/22 2:00	0.5			1.4			14.8		1	0.5			1.4			14.7		1
06/11/22 3:00	0.5			1.5			14.8		1	0.6			1.5			14.7		1
06/11/22 4:00	0.5			1.5			14.8		1	0.5			1.5			14.7		1
06/11/22 5:00	0.5			1.5			14.8		1	0.5			1.5			14.7		1
06/11/22 6:00	0.5			1.5			14.8		1	0.5			1.5			14.7		1
06/11/22 7:00	0.4			1.5			14.8		1	0.5			1.5			14.7		1
06/11/22 8:00	0.4			1.5			14.9		1	0.5			1.6			14.8		1
06/11/22 9:00	0.5			1.4			14.8		1	0.6			1.5			14.7		1
06/11/22 10:00	0.6			1.1			14.5		1	0.7			1.4			14.4		1
06/11/22 11:00	0.6			1.2			14.5		1	0.6			1.4			14.4		1
06/11/22 12:00	1.2			1.5			14.2		1	1.4			1.5			14.1		1
06/11/22 13:00	0.3			1.5			13		1	0.4			1.5			12.9		1
06/11/22 14:00	0.2			1.5			12.8		1	0.3			1.5			12.7		1
06/11/22 15:00	0.2			1.5			12.8		1	0.3			1.5			12.8		1
06/11/22 16:00	0.3			1.5			13		1	0.4			1.5			12.9		1
06/11/22 17:00	0.2			1.5			12.4		1	0.3			1.5			12.4		1
06/11/22 18:00	0.1			1.5			11.8		1	0.2			1.5			11.8		1
06/11/22 19:00	0.1			1.5			11.9		1	0.2			1.5			11.9		1
06/11/22 20:00	0.1			1.5			12.2		1	0.2			1.5			12.1		1
06/11/22 21:00	0.1			1.5			12.2		1	0.2			1.5			12.2		1
06/11/22 22:00	1			1.5			13.9		1	1			1.5			13.8		1
06/11/22 23:00	1.1			1.4			14.3		1	1.3			1.5			14.2		1
06/12/22 0:00	0.7			1.5			13.4		1	0.7			1.5			13.4		1
06/12/22 1:00	0.9			1.6			14.3		1	1			1.6			14.3		1
06/12/22 2:00	0.9			1.4			14.5		1	0			0			17		1
06/12/22 3:00	0.6			1.5			14.5		1	0	X		0	X		0	X	1
06/12/22 4:00	0.6			1.5			14.5		1	0	X		0	X		0	X	1
06/12/22 5:00	0.6			1.2			14.5		1	0	X		0	X		0	X	1
06/12/22 6:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
06/12/22 7:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/12/22 8:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
06/12/22 9:00	0.6			1.4			14.6		1	0	X		0	X		0	X	1
06/12/22 10:00	0.5			1.5			14.6		1	0	X		0	X		0	X	1
06/12/22 11:00	0.8			1.3			14.5		1	0	X		0	X		0	X	1
06/12/22 12:00	1.2			1.4			14.3		1	0			0			15.8		1
06/12/22 13:00	1.2			1.4			14.3		1	1.2			1.4			14.3		1
06/12/22 14:00	1.2			1.5			14.2		1	1.3			1.5			14.1		1
06/12/22 15:00	1.1			1.5			14.1		1	1.1			1.5			14		1
06/12/22 16:00	1			1.5			13.9		1	1.1			1.5			13.8		1
06/12/22 17:00	1			1.5			13.9		1	1.1			1.5			13.8		1
06/12/22 18:00	0.9			1.5			13.8		1	0.9			1.5			13.7		1
06/12/22 19:00	1.1			1.5			14.1		1	1.2			1.5			14		1
06/12/22 20:00	1.3			1.5			14.1		1	1.2			1.5			14		1
06/12/22 21:00	1.1			1.5			14.2		1	1.2			1.5			14.1		1
06/12/22 22:00	1.2			1.5			14.2		1	1.2			1.5			14.1		1
06/12/22 23:00	0.7			1.6			14.5		1	0.8			1.7			14.5		1
06/13/22 0:00	0.7			1.3			14.5		1	0			0			17.1		1
06/13/22 1:00	0.7			1.5			14.5		1	0	X		0	X		0	X	1
06/13/22 2:00	0.6			1.7			14.6		1	0	X		0	X		0	X	1
06/13/22 3:00	0.7			1.5			14.6		1	0	X		0	X		0	X	1
06/13/22 4:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
06/13/22 5:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
06/13/22 6:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
06/13/22 7:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
06/13/22 8:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
06/13/22 9:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
06/13/22 10:00	0.5			1.5			14.7		1	0	X		0	X		0	X	1
06/13/22 11:00	0.5			1.5			14.7		1	0	X		0	X		0	X	1
06/13/22 12:00	0.5			1.5			14.7		1	0	X		0	X		0	X	1
06/13/22 13:00	0.5			1.5			14.8		1	0	X		0	X		0	X	1
06/13/22 14:00	0.5			1.5			14.8		1	0	X		0	X		0	X	1
06/13/22 15:00	0.5			1.5			14.8		1	0	X		0	X		0	X	1
06/13/22 16:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
06/13/22 17:00	0.8			1.4			14.6		1	0	X		0	X		0	X	1
06/13/22 18:00	1.1			1.6			14.4		1	0			0			15.7		1
06/13/22 19:00	1			1.3			14.5		1	1.1			1.3			14.4		1
06/13/22 20:00	1.3			1.5			14.3		1	1.2			1.5			14.3		1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/13/22 21:00	0.6			1.5			14.6		1	0.7			1.5			14.7		1
06/13/22 22:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
06/13/22 23:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
06/14/22 0:00	0.7			1.5			14.7		1	0	X		0	X		0	X	1
06/14/22 1:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
06/14/22 2:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
06/14/22 3:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
06/14/22 4:00	0.7			1.5			14.6		1	0	X		0	X		0	X	1
06/14/22 5:00	0.8			1.4			14.5		1	0	X		0	X		0	X	1
06/14/22 6:00	0.6			1.3			14.7		1	0	X		0	X		0	X	1
06/14/22 7:00	0.6			1.3			14.7		1	0	X		0	X		0	X	1
06/14/22 8:00	0.6			1.3			14.7		1	0	X		0	X		0	X	1
06/14/22 9:00	0.6			1.3			14.7		1	0	X		0	X		0	X	1
06/14/22 10:00	0.6			1.3			14.7		1	0	X		0	X		0	X	1
06/14/22 11:00	0.6			1.3			14.7		1	0	X		0	X		0	X	1
06/14/22 12:00	0.6			1.3			14.8		1	0	X		0	X		0	X	1
06/14/22 13:00	0.6			1.5			14.8		1	0	X		0	X		0	X	1
06/14/22 14:00	0.6			1.6			14.8		1	0	X		0	X		0	X	1
06/14/22 15:00	0.6			1.5			14.8		1	0	X		0	X		0	X	1
06/14/22 16:00	0.6			1.5			14.8		1	0	X		0	X		0	X	1
06/14/22 17:00	0.6			1.4			14.7		1	0	X		0	X		0	X	1
06/14/22 18:00	0.6			1.6			14.7		1	0.8			0.7			15.6		1
06/14/22 19:00	0.9			1.3			14.3		1	1			1.3			14.4		1
06/14/22 20:00	1			1.5			14.1		1	1.1			1.5			14.2		1
06/14/22 21:00	0.8			1.6			14.5		1	0.9			1.6			14.4		1
06/14/22 22:00	1.3			1.4			14.4		1	1.5			1.4			14.3		1
06/14/22 23:00	1.4			1.5			14.1		1	1.6			1.5			14		1
06/15/22 0:00	1.4			1.5			14.1		1	1.5			1.5			14		1
06/15/22 1:00	1.4			1.5			14.2		1	1.5			1.5			14.1		1
06/15/22 2:00	1.3			1.6			14.4		1	1.5			1.6			14.4		1
06/15/22 3:00	1.4			1.5			14		1	1.6			1.5			13.9		1
06/15/22 4:00	0.7			1.5			13.3		1	0.8			1.5			13.2		1
06/15/22 5:00	1.2			1.5			14.2		1	1.2			1.5			14.2		1
06/15/22 6:00	0.7			1.7			14.6		1	0.7			1.6			14.5		1
06/15/22 7:00	0.6			1.4			14.6		1	0.7			1.3			14.5		1
06/15/22 8:00	0.4			1.5			14.9		1	0.5			1.5			14.8		1
06/15/22 9:00	0.4			1.5			14.9		1	0.5			1.5			14.8		1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/15/22 10:00	0.4			1.5			14.9		1	0.5			1.5			14.8		1
06/15/22 11:00	0.5			1.5			14.8		1	0.6			1.4			14.8		1
06/15/22 12:00	0.6			1.6			14.6		1	0.7			1.4			14.5		1
06/15/22 13:00	0.6			1.6			14.6		1	0.6			1.5			14.5		1
06/15/22 14:00	0.8			1.5			14		1	1.1			1.5			14.4		1
06/15/22 15:00	0.5			1.5			13.4		1	0.5			1.5			13.2		1
06/15/22 16:00	0.7			1.5			13.7		1	0.7			1.5			13.6		1
06/15/22 17:00	0.7			1.5			13.7		1	0.8			1.5			13.6		1
06/15/22 18:00	0.9			1.5			14		1	0.9			1.5			13.9		1
06/15/22 19:00	1			1.5			14.1		1	1			1.5			14		1
06/15/22 20:00	1.2			1.5			14.2		1	1.1			1.5			14.1		1
06/15/22 21:00	1.3			1.5			14.2		1	1.3			1.5			14.1		1
06/15/22 22:00	1.4			1.5			14.2		1	1.3			1.5			14.1		1
06/15/22 23:00	1.3			1.5			14.2		1	1.3			1.5			14.2		1
06/16/22 0:00	1.3			1.5			14.2		1	1.3			1.5			14.2		1
06/16/22 1:00	1.3			1.5			14.2		1	1.3			1.5			14.2		1
06/16/22 2:00	1.4			1.5			14.3		1	1.4			1.5			14.2		1
06/16/22 3:00	1.5			1.5			14.3		1	1.4			1.5			14.2		1
06/16/22 4:00	1.4			1.5			14.3		1	1.4			1.5			14.2		1
06/16/22 5:00	0.9			1.6			14.5		1	1.4			1.5			14.2		1
06/16/22 6:00	0.5			1.5			14.8		1	0.5			1.6			14.7		1
06/16/22 7:00	0.5			1.5			14.8		1	0.5			1.5			14.7		1
06/16/22 8:00	0.5			1.5			14.8		1	0.5			1.5			14.7		1
06/16/22 9:00	0.4			1.5			14.9		1	0.5			1.5			14.8		1
06/16/22 10:00	0.4			1.5			14.9		1	0.5			1.5			14.8		1
06/16/22 11:00	0.5			1.4			14.8		1	0.6			1.4			14.7		1
06/16/22 12:00	1			1.6			14.1		1	1.2			1.5			14		1
06/16/22 13:00	0.6			1.4			13.5		1	0.6			1.5			13.4		1
06/16/22 14:00	1			1.3			14.1		1	0.9			1.5			14		1
06/16/22 15:00	1			1.5			14.1		1	1			1.5			14		1
06/16/22 16:00	1			1.4			14.1		1	1			1.5			14		1
06/16/22 17:00	0.9			1.5			14.4		1	1.1			1.5			14.3		1
06/16/22 18:00	1.1			1.5			14.2		1	1.3			1.5			14.1		1
06/16/22 19:00	1.2			1.5			14.3		1	1.2			1.5			14.2		1
06/16/22 20:00	1.2			1.5			14.4		1	1.4			1.5			14.3		1
06/16/22 21:00	1.6			1.5			14.3		1	1.7			1.5			14.2		1
06/16/22 22:00	1.4			1.5			14.3		1	1.7			1.5			14.2		1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/16/22 23:00	1.5			1.5			14.3		1	1.7			1.5			14.2		1
06/17/22 0:00	1.5			1.5			14.3		1	1.8			1.5			14.2		1
06/17/22 1:00	1.5			1.5			14.3		1	1.8			1.5			14.2		1
06/17/22 2:00	1.5			1.5			14.3		1	1.8			1.5			14.2		1
06/17/22 3:00	1.5			1.5			14.3		1	1.8			1.5			14.2		1
06/17/22 4:00	1.2			1.5			14		1	1.4			1.5			13.9		1
06/17/22 5:00	0.9			1.5			14.2		1	0.9			1.5			14.1		1
06/17/22 6:00	0.6			1.3			14.6		1	0.7			1.7			14.5		1
06/17/22 7:00	0.6			1.3			14.6		1	0.7			1.4			14.5		1
06/17/22 8:00	0.4			1.4			14.8		1	0.5			1.6			14.7		1
06/17/22 9:00	0.5			1.6			14.7		1	0.5			1.5			14.8		1
06/17/22 10:00	0.5			1.6			14.7		1	0.6			1.5			14.7		1
06/17/22 11:00	0.4			1.5			14.8		1	0.5			1.5			14.8		1
06/17/22 12:00	0.4			1.5			14.9		1	0.5			1.5			14.8		1
06/17/22 13:00	0.4			1.5			15.3		1	0.6			1.3			14.6		1
06/17/22 14:00	0	X		0	X		0	X	1	0.6			1.5			14.6		1
06/17/22 15:00	0	X		0	X		0	X	1	0.6			1.5			14.6		1
06/17/22 16:00	0	X		0	X		0	X	1	0.7			1.5			14.6		1
06/17/22 17:00	0	X		0	X		0	X	1	0.7			1.5			14.6		1
06/17/22 18:00	0	X		0	X		0	X	1	0.6			1.5			14.6		1
06/17/22 19:00	0	X		0	X		0	X	1	0.6			1.5			14.6		1
06/17/22 20:00	0	X		0	X		0	X	1	0.6			1.5			14.6		1
06/17/22 21:00	0	X		0	X		0	X	1	0.6			1.5			14.6		1
06/17/22 22:00	0	X		0	X		0	X	1	0.6			1.5			14.6		1
06/17/22 23:00	0	X		0	X		0	X	1	0.6			1.5			14.5		1
06/18/22 0:00	0	X		0	X		0	X	1	0.6			1.5			14.5		1
06/18/22 1:00	0	X		0	X		0	X	1	0.6			1.6			14.5		1
06/18/22 2:00	0	X		0	X		0	X	1	0.6			1.5			14.6		1
06/18/22 3:00	0	X		0	X		0	X	1	0.6			1.7			14.6		1
06/18/22 4:00	0	X		0	X		0	X	1	0.6			1.5			14.5		1
06/18/22 5:00	0	X		0	X		0	X	1	0.6			1.5			14.6		1
06/18/22 6:00	0	X		0	X		0	X	1	0.6			1.5			14.6		1
06/18/22 7:00	0	X		0	X		0	X	1	0.6			1.5			14.6		1
06/18/22 8:00	0	X		0	X		0	X	1	0.6			1.5			14.6		1
06/18/22 9:00	0	X		0	X		0	X	1	0.6			1.5			14.6		1
06/18/22 10:00	0	X		0	X		0	X	1	0.6			1.5			14.6		1
06/18/22 11:00	0	X		0	X		0	X	1	0.6			1.5			14.6		1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/18/22 12:00	0	X		0	X		0	X	1	0.6			1.5			14.6		1
06/18/22 13:00	0	X		0	X		0	X	1	0.6			1.5			14.7		1
06/18/22 14:00	0	X		0	X		0	X	1	0.6			1.5			14.7		1
06/18/22 15:00	0	X		0	X		0	X	1	0.6			1.5			14.7		1
06/18/22 16:00	0	X		0	X		0	X	1	0.6			1.5			14.7		1
06/18/22 17:00	0	X		0	X		0	X	1	0.6			1.5			14.7		1
06/18/22 18:00	0	X		0	X		0	X	1	0.7			1.5			14.7		1
06/18/22 19:00	0	X		0	X		0	X	1	0.7			1.5			14.6		1
06/18/22 20:00	0	X		0	X		0	X	1	0.7			1.4			14.5		1
06/18/22 21:00	0	X		0	X		0	X	1	0.6			1.4			14.6		1
06/18/22 22:00	0	X		0	X		0	X	1	0.7			1.5			14.5		1
06/18/22 23:00	0	X		0	X		0	X	1	0.8			1.5			14.5		1
06/19/22 0:00	0	X		0	X		0	X	1	0.7			1.4			14.5		1
06/19/22 1:00	0	X		0	X		0	X	1	0.7			1.4			14.4		1
06/19/22 2:00	0	X		0	X		0	X	1	0.7			1.4			14.5		1
06/19/22 3:00	0	X		0	X		0	X	1	0.7			1.5			14.6		1
06/19/22 4:00	0	X		0	X		0	X	1	0.7			1.5			14.6		1
06/19/22 5:00	0	X		0	X		0	X	1	0.7			1.4			14.5		1
06/19/22 6:00	0	X		0	X		0	X	1	0.7			1.5			14.6		1
06/19/22 7:00	0	X		0	X		0	X	1	0.7			1.5			14.6		1
06/19/22 8:00	0	X		0	X		0	X	1	0.7			1.5			14.6		1
06/19/22 9:00	0	X		0	X		0	X	1	0.7			1.5			14.6		1
06/19/22 10:00	0	X		0	X		0	X	1	0.7			1.5			14.6		1
06/19/22 11:00	0	X		0	X		0	X	1	0.7			1.5			14.7		1
06/19/22 12:00	0	X		0	X		0	X	1	0.7			1.5			14.7		1
06/19/22 13:00	0	X		0	X		0	X	1	0.6			1.5			14.7		1
06/19/22 14:00	0	X		0	X		0	X	1	0.6			1.5			14.7		1
06/19/22 15:00	0	X		0	X		0	X	1	0.6			1.5			14.7		1
06/19/22 16:00	0	X		0	X		0	X	1	0.7			1.5			14.7		1
06/19/22 17:00	0	X		0	X		0	X	1	0.6			1.5			14.7		1
06/19/22 18:00	0	X		0	X		0	X	1	0.7			1.5			14.7		1
06/19/22 19:00	0	X		0	X		0	X	1	0.7			1.5			14.7		1
06/19/22 20:00	0	X		0	X		0	X	1	1.1			1.4			14.6		1
06/19/22 21:00	0	X		0	X		0	X	1	0.7			1.5			14.7		1
06/19/22 22:00	0	X		0	X		0	X	1	0.7			1.5			14.6		1
06/19/22 23:00	0	X		0	X		0	X	1	0.7			1.5			14.6		1
06/20/22 0:00	0	X		0	X		0	X	1	0.7			1.5			14.6		1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/20/22 1:00	0	X		0	X		0	X	1	0.7			1.5			14.6		1
06/20/22 2:00	0	X		0	X		0	X	1	0.7			1.4			14.6		1
06/20/22 3:00	0	X		0	X		0	X	1	0.8			1.5			14.6		1
06/20/22 4:00	0	X		0	X		0	X	1	0.8			1.4			14.5		1
06/20/22 5:00	0	X		0	X		0	X	1	0.7			1.4			14.5		1
06/20/22 6:00	0	X		0	X		0	X	1	0.7			1.4			14.5		1
06/20/22 7:00	0	X		0	X		0	X	1	0.7			1.5			14.6		1
06/20/22 8:00	0	X		0	X		0	X	1	0.7			1.5			14.6		1
06/20/22 9:00	0	X		0	X		0	X	1	0.7			1.5			14.7		1
06/20/22 10:00	0	X		0	X		0	X	1	0.7			1.5			14.7		1
06/20/22 11:00	0	X		0	X		0	X	1	0.7			1.5			14.7		1
06/20/22 12:00	0	X		0	X		0	X	1	0.7			1.4			14.6		1
06/20/22 13:00	0	X		0	X		0	X	1	0.7			1.4			14.6		1
06/20/22 14:00	0			0			16		1	0.7			1.7			14.5		1
06/20/22 15:00	0.5			1.6			13.9		1	0.8			1.3			13.7		1
06/20/22 16:00	0.1			1.5			12.5		1	0.3			1.5			12.3		1
06/20/22 17:00	0.4			1.6			13.6		1	0.7			1.6			13.4		1
06/20/22 18:00	0.4			1.7			13.5		1	0.7			1.7			13.4		1
06/20/22 19:00	0.7			1.7			13.9		1	0.9			1.7			13.7		1
06/20/22 20:00	1			1.7			14		1	1			1.7			13.8		1
06/20/22 21:00	1			1.7			14		1	1.2			1.7			13.9		1
06/20/22 22:00	0.9			1.6			14.5		1	1.1			1.7			14.5		1
06/20/22 23:00	0.7			1.6			14.6		1	0			0			17.6		1
06/21/22 0:00	0.8			1.7			14.7		1	0	X		0	X		0	X	1
06/21/22 1:00	0.7			1.7			14.7		1	0	X		0	X		0	X	1
06/21/22 2:00	0.7			1.8			14.7		1	0	X		0	X		0	X	1
06/21/22 3:00	0.7			1.8			14.7		1	0	X		0	X		0	X	1
06/21/22 4:00	0.7			1.6			14.6		1	0	X		0	X		0	X	1
06/21/22 5:00	0.7			1.5			14.6		1	0	X		0	X		0	X	1
06/21/22 6:00	0.7			1.6			14.7		1	0	X		0	X		0	X	1
06/21/22 7:00	0.6			1.6			14.7		1	0	X		0	X		0	X	1
06/21/22 8:00	0.6			1.6			14.7		1	0	X		0	X		0	X	1
06/21/22 9:00	0.6			1.6			14.8		1	0	X		0	X		0	X	1
06/21/22 10:00	0.6			1.6			14.8		1	0	X		0	X		0	X	1
06/21/22 11:00	0.6			1.6			14.8		1	0	X		0	X		0	X	1
06/21/22 12:00	0.6			1.6			14.8		1	0	X		0	X		0	X	1
06/21/22 13:00	0.5			1.6			14.8		1	0	X		0	X		0	X	1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/21/22 14:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
06/21/22 15:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
06/21/22 16:00	0.5			1.6			14.7		1	0	X		0	X		0	X	1
06/21/22 17:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
06/21/22 18:00	0.7			1.5			14.7		1	0	X		0	X		0	X	1
06/21/22 19:00	1.2			1.6			14.3		1	0			0			16.1		1
06/21/22 20:00	0.8			1.6			13.6		1	1.4			1.6			14.2		1
06/21/22 21:00	0.7			1.6			13.4		1	0.9			1.6			13.5		1
06/21/22 22:00	1.2			1.6			14		1	1.2			1.6			13.9		1
06/21/22 23:00	1.3			1.6			14		1	1.2			1.6			14		1
06/22/22 0:00	1.4			1.6			14.1		1	1.3			1.6			14		1
06/22/22 1:00	1.6			1.6			14.1		1	1.4			1.6			14		1
06/22/22 2:00	1.1			1.5			14.4		1	1.1			1.5			14.3		1
06/22/22 3:00	1.6			1.6			14.2		1	2.1			1.6			14.1		1
06/22/22 4:00	1.2			1.6			14.4		1	1.3			1.6			14.3		1
06/22/22 5:00	0.8			1.6			14.6		1	0.9			1.6			14.5		1
06/22/22 6:00	0.7			1.6			14.8		1	0.8			1.6			14.8		1
06/22/22 7:00	0.6			1.6			14.9		1	0.7			1.6			14.8		1
06/22/22 8:00	0.5			1.6			14.9		1	0.6			1.6			14.8		1
06/22/22 9:00	0.5			1.6			15		1	0.6			1.6			14.9		1
06/22/22 10:00	0.5			1.6			15		1	0.6			1.6			14.9		1
06/22/22 11:00	0.5			1.6			15		1	0.6			1.6			14.9		1
06/22/22 12:00	0.5			1.6			15		1	0.6			1.6			14.9		1
06/22/22 13:00	0.5			1.5			14.9		1	0.6			1.5			14.8		1
06/22/22 14:00	0.5			1.5			14.9		1	0.6			1.5			14.7		1
06/22/22 15:00	0.5			1.6			14.9		1	0.6			1.5			14.7		1
06/22/22 16:00	0.5			1.6			15		1	0.6			1.6			14.9		1
06/22/22 17:00	0.5			1.6			15		1	0.6			1.6			14.9		1
06/22/22 18:00	0.5			1.6			14.9		1	0.6			1.6			14.9		1
06/22/22 19:00	0.5			1.6			14.9		1	0.6			1.6			14.9		1
06/22/22 20:00	0.7			1.5			14.6		1	0.7			1.4			14.5		1
06/22/22 21:00	1.1			1.6			14.4		1	1.3			1.6			14.3		1
06/22/22 22:00	0.7			1.6			14.6		1	0.7			1.5			14.5		1
06/22/22 23:00	1.1			1.5			14.1		1	1.3			1.5			14		1
06/23/22 0:00	0.9			1.5			13.9		1	1			1.5			13.8		1
06/23/22 1:00	1			1.5			14.3		1	1.1			1.5			14.2		1
06/23/22 2:00	0.6			1.3			14.6		1	0.6			1.4			15.3		1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/23/22 3:00	0.7			1.5			14.7		1	0	X		0	X		0	X	1
06/23/22 4:00	0.9			1.4			14.5		1	0	X		0	X		0	X	1
06/23/22 5:00	1.2			1.6			14.5		1	0	X		0	X		0	X	1
06/23/22 6:00	1.4			1.7			14.3		1	0	X		0	X		0	X	1
06/23/22 7:00	1.4			1.7			14.3		1	0	X		0	X		0	X	1
06/23/22 8:00	1.3			1.7			14.3		1	0	X		0	X		0	X	1
06/23/22 9:00	1.3			1.7			14.3		1	0	X		0	X		0	X	1
06/23/22 10:00	1.1			1.7			14.4		1	0	X		0	X		0	X	1
06/23/22 11:00	0.6			1.7			14.7		1	0	X		0	X		0	X	1
06/23/22 12:00	0.5			1.7			14.9		1	0	X		0	X		0	X	1
06/23/22 13:00	0.5			1.7			14.9		1	0	X		0	X		0	X	1
06/23/22 14:00	0.5			1.7			14.9		1	0	X		0	X		0	X	1
06/23/22 15:00	0.5			1.7			14.8		1	0			0			20.9		1
06/23/22 16:00	0.6			1.7			14.7		1	0.6			0.9			15.4		1
06/23/22 17:00	0.8			1.6			14.1		1	0.8			1.3			14.1		1
06/23/22 18:00	0.4			1.7			13		1	0.3			1.7			12.5		1
06/23/22 19:00	0.1			1.6			12.4		1	0.3			1.6			12.4		1
06/23/22 20:00	0.3			1.5			12.6		1	0.4			1.5			12.6		1
06/23/22 21:00	0.8			1.5			13.6		1	0.8			1.5			13.6		1
06/23/22 22:00	1.1			1.5			14		1	1			1.5			13.9		1
06/23/22 23:00	1.2			1.5			14		1	1.1			1.5			14		1
06/24/22 0:00	1.2			1.5			14.1		1	1			1.5			14		1
06/24/22 1:00	1.2			1.5			14.1		1	1.1			1.5			14		1
06/24/22 2:00	1.2			1.5			14.2		1	1.2			1.4			14.1		1
06/24/22 3:00	0.8			1.4			14.4		1	1			1.4			14.3		1
06/24/22 4:00	1.4			1.5			14.1		1	1.5			1.5			14.1		1
06/24/22 5:00	0.9			1.5			14.5		1	1			1.5			14.4		1
06/24/22 6:00	0.5			1.5			14.8		1	0.6			1.5			14.7		1
06/24/22 7:00	0.5			1.5			14.9		1	0.6			1.5			14.8		1
06/24/22 8:00	0.5			1.5			14.9		1	0.6			1.5			14.8		1
06/24/22 9:00	0.5			1.5			14.9		1	0.6			1.4			14.8		1
06/24/22 10:00	0.6			1.4			14.7		1	0.7			1.2			14.6		1
06/24/22 11:00	0.8			1.5			14.5		1	0.9			1.4			14.4		1
06/24/22 12:00	1.1			1.5			14.5		1	1.4			1.5			14.4		1
06/24/22 13:00	0.7			1.5			14.4		1	0.9			1.5			14.3		1
06/24/22 14:00	0.4			1.5			13.1		1	0.6			1.5			13.1		1
06/24/22 15:00	0.4			1.5			13.1		1	0.5			1.5			13.1		1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/24/22 16:00	0.4			1.5			13.1		1	0.7			1.5			13.4		1
06/24/22 17:00	0.1			1.5			12.2		1	0.3			1.5			12.2		1
06/24/22 18:00	0.3			1.5			12.8		1	0.4			1.5			12.8		1
06/24/22 19:00	0.2			1.5			12.7		1	0.4			1.5			12.7		1
06/24/22 20:00	0.7			1.5			13.6		1	0.8			1.5			13.6		1
06/24/22 21:00	1			1.5			13.9		1	1			1.5			13.8		1
06/24/22 22:00	0.9			1.5			13.7		1	0.9			1.5			13.6		1
06/24/22 23:00	1.1			1.5			14		1	1			1.5			13.9		1
06/25/22 0:00	0.9			1.5			14.4		1	1			1.5			14.3		1
06/25/22 1:00	0.6			1.5			13.1		1	0.8			1.5			13		1
06/25/22 2:00	0.8			1.4			14.3		1	0.9			1.6			14.2		1
06/25/22 3:00	0.7			1.5			14.5		1	0.7			1.5			14.4		1
06/25/22 4:00	0.7			1.5			14.5		1	0.7			1.5			14.4		1
06/25/22 5:00	0.6			1.5			14.6		1	0.7			1.5			14.5		1
06/25/22 6:00	0.5			1.6			14.9		1	0.6			1.6			14.8		1
06/25/22 7:00	0.5			1.6			14.9		1	0.6			1.6			14.8		1
06/25/22 8:00	0.5			1.6			14.9		1	0.6			1.6			14.8		1
06/25/22 9:00	0.5			1.6			14.9		1	0.6			1.6			14.8		1
06/25/22 10:00	0.5			1.6			14.9		1	0.6			1.6			14.8		1
06/25/22 11:00	0.5			1.6			14.9		1	0.6			1.6			14.9		1
06/25/22 12:00	0.5			1.6			14.9		1	0.6			1.6			14.8		1
06/25/22 13:00	0.5			1.6			15		1	0.6			1.6			14.9		1
06/25/22 14:00	0.5			1.6			14.9		1	0.6			1.6			14.8		1
06/25/22 15:00	0.5			1.6			14.9		1	0.6			1.5			14.8		1
06/25/22 16:00	0.5			1.5			14.8		1	0.6			1.5			14.7		1
06/25/22 17:00	0.7			1.6			13.8		1	1			1.6			13.9		1
06/25/22 18:00	0.4			1.6			13.2		1	0.5			1.6			13.1		1
06/25/22 19:00	0.8			1.6			13.7		1	0.8			1.6			13.7		1
06/25/22 20:00	0.8			1.6			13.8		1	0.9			1.6			13.7		1
06/25/22 21:00	1			1.6			14.5		1	1			1.5			14.3		1
06/25/22 22:00	0	X		0	X		0	X	1	0.7			1.5			14.6		1
06/25/22 23:00	0	X		0	X		0	X	1	0.7			1.6			14.7		1
06/26/22 0:00	0	X		0	X		0	X	1	0.7			1.6			14.6		1
06/26/22 1:00	0	X		0	X		0	X	1	0.7			1.5			14.5		1
06/26/22 2:00	0	X		0	X		0	X	1	0.7			1.6			14.5		1
06/26/22 3:00	0	X		0	X		0	X	1	0.7			1.6			14.5		1
06/26/22 4:00	0	X		0	X		0	X	1	1			1.5			14.4		1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/26/22 5:00	0	X		0	X		0	X	1	1.1			1.5			14.4		1
06/26/22 6:00	0	X		0	X		0	X	1	0.7			1.6			14.6		1
06/26/22 7:00	0	X		0	X		0	X	1	0.7			1.6			14.6		1
06/26/22 8:00	0	X		0	X		0	X	1	0.7			1.6			14.6		1
06/26/22 9:00	0	X		0	X		0	X	1	0.7			1.5			14.6		1
06/26/22 10:00	0			0			15.6		1	0.7			1.6			14.5		1
06/26/22 11:00	0.4			1.6			14.9		1	0.6			1.6			14.9		1
06/26/22 12:00	0.5			1.6			15		1	0.6			1.6			14.9		1
06/26/22 13:00	0.4			1.6			15		1	0.6			1.6			14.9		1
06/26/22 14:00	0.4			1.6			15		1	0.6			1.6			14.9		1
06/26/22 15:00	0.4			1.6			14.9		1	0.6			1.6			14.8		1
06/26/22 16:00	0.7			1.5			14.2		1	0.9			1.5			14.2		1
06/26/22 17:00	0.8			1.6			13.8		1	1.1			1.6			13.8		1
06/26/22 18:00	0.1			1.6			12.5		1	0.4			1.6			12.4		1
06/26/22 19:00	0.8			1.6			13.8		1	0.9			1.6			13.8		1
06/26/22 20:00	1			1.6			14.1		1	1			1.6			14		1
06/26/22 21:00	1			1.6			14.3		1	1			1.6			14.2		1
06/26/22 22:00	0.6			1.5			14.7		1	0.6			1.5			15.3		1
06/26/22 23:00	0.6			1.6			14.7		1	0	X		0	X		0	X	1
06/27/22 0:00	0.6			1.6			14.7		1	0	X		0	X		0	X	1
06/27/22 1:00	0.6			1.6			14.7		1	0	X		0	X		0	X	1
06/27/22 2:00	0.6			1.6			14.7		1	0	X		0	X		0	X	1
06/27/22 3:00	0.6			1.6			14.7		1	0	X		0	X		0	X	1
06/27/22 4:00	0.7			1.5			14.5		1	0	X		0	X		0	X	1
06/27/22 5:00	0.6			1.6			14.7		1	0	X		0	X		0	X	1
06/27/22 6:00	0.6			1.6			14.7		1	0	X		0	X		0	X	1
06/27/22 7:00	0.6			1.6			14.7		1	0	X		0	X		0	X	1
06/27/22 8:00	0.6			1.6			14.7		1	0	X		0	X		0	X	1
06/27/22 9:00	0.6			1.6			14.7		1	0	X		0	X		0	X	1
06/27/22 10:00	0.6			1.6			14.7		1	0	X		0	X		0	X	1
06/27/22 11:00	0.6			1.6			14.8		1	0	X		0	X		0	X	1
06/27/22 12:00	0.6			1.5			14.8		1	0	X		0	X		0	X	1
06/27/22 13:00	0.6			1.6			14.7		1	0.5			1.2			15.6		1
06/27/22 14:00	0.7			1.6			14.6		1	0.8			1.4			14.5		1
06/27/22 15:00	0.9			1.6			14		1	1.2			1.6			13.9		1
06/27/22 16:00	0.9			1.6			14		1	1.2			1.6			13.9		1
06/27/22 17:00	0.7			1.6			13.6		1	0.9			1.6			13.6		1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/27/22 18:00	0.3			1.6			13.1		1	0.5			1.6			13		1
06/27/22 19:00	0.8			1.6			13.7		1	0.9			1.6			13.7		1
06/27/22 20:00	1			1.6			13.9		1	1			1.6			13.8		1
06/27/22 21:00	0.9			1.6			13.9		1	0.9			1.6			13.9		1
06/27/22 22:00	0.6			1.5			14.6		1	0.7			1.6			14.8		1
06/27/22 23:00	0.6			1.6			14.7		1	0	X		0	X		0	X	1
06/28/22 0:00	0.6			1.6			14.7		1	0	X		0	X		0	X	1
06/28/22 1:00	0.6			1.6			14.7		1	0	X		0	X		0	X	1
06/28/22 2:00	0.6			1.7			14.7		1	0	X		0	X		0	X	1
06/28/22 3:00	0.6			1.6			14.7		1	0	X		0	X		0	X	1
06/28/22 4:00	0.7			1.6			14.6		1	0	X		0	X		0	X	1
06/28/22 5:00	0.7			1.6			14.5		1	0	X		0	X		0	X	1
06/28/22 6:00	0.6			1.6			14.7		1	0	X		0	X		0	X	1
06/28/22 7:00	0.6			1.6			14.7		1	0	X		0	X		0	X	1
06/28/22 8:00	0.6			1.6			14.7		1	0	X		0	X		0	X	1
06/28/22 9:00	0.6			1.6			14.7		1	0	X		0	X		0	X	1
06/28/22 10:00	0.6			1.6			14.8		1	0	X		0	X		0	X	1
06/28/22 11:00	0.6			1.6			14.8		1	0	X		0	X		0	X	1
06/28/22 12:00	0.6			1.6			14.8		1	0	X		0	X		0	X	1
06/28/22 13:00	0.5			1.6			14.8		1	0	X		0	X		0	X	1
06/28/22 14:00	0.5			1.6			14.8		1	0	X		0	X		0	X	1
06/28/22 15:00	0.5			1.5			14.7		1	0			0			19		1
06/28/22 16:00	0.5			1.6			14.8		1	0.6			1.2			14.7		1
06/28/22 17:00	0.7			1.5			14.2		1	0.9			1.5			14.3		1
06/28/22 18:00	0.9			1.6			14		1	1			1.6			13.9		1
06/28/22 19:00	1.3			1.6			14.1		1	1.3			1.6			14		1
06/28/22 20:00	0.9			1.6			14.3		1	1			1.6			14.2		1
06/28/22 21:00	0.6			1.5			14.6		1	0.7			1.4			14.8		1
06/28/22 22:00	0.6			1.6			14.7		1	0	X		0	X		0	X	1
06/28/22 23:00	0.7			1.5			14.6		1	0	X		0	X		0	X	1
06/29/22 0:00	1.4			1.6			14.5		1	0	X		0	X		0	X	1
06/29/22 1:00	0.8			1.6			14.5		1	0	X		0	X		0	X	1
06/29/22 2:00	0.6			1.6			14.5		1	0	X		0	X		0	X	1
06/29/22 3:00	0.6			1.6			14.5		1	0	X		0	X		0	X	1
06/29/22 4:00	0.6			1.6			14.5		1	0	X		0	X		0	X	1
06/29/22 5:00	0.6			1.6			14.5		1	0	X		0	X		0	X	1
06/29/22 6:00	0.6			1.6			14.6		1	0	X		0	X		0	X	1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/29/22 7:00	0.6			1.6			14.7		1	0	X		0	X		0	X	1
06/29/22 8:00	0.6			1.6			14.7		1	0	X		0	X		0	X	1
06/29/22 9:00	0.6			1.6			14.6		1	0	X		0	X		0	X	1
06/29/22 10:00	0.6			1.6			14.7		1	0	X		0	X		0	X	1
06/29/22 11:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
06/29/22 12:00	0.5			1.6			14.7		1	0.7			1.6			15.5		1
06/29/22 13:00	0.8			1.6			14.5		1	0.9			1.6			14.3		1
06/29/22 14:00	1			1.6			14		1	1.3			1.6			13.9		1
06/29/22 15:00	1			1.6			14		1	1.3			1.6			13.9		1
06/29/22 16:00	1			1.6			14		1	1.3			1.6			13.9		1
06/29/22 17:00	1			1.6			14		1	1.3			1.6			13.9		1
06/29/22 18:00	1			1.6			13.9		1	1.1			1.6			13.8		1
06/29/22 19:00	0.9			1.6			13.7		1	1			1.6			13.6		1
06/29/22 20:00	0.9			1.6			13.8		1	1			1.6			13.7		1
06/29/22 21:00	1.3			1.6			14		1	1.4			1.6			13.9		1
06/29/22 22:00	1.4			1.6			14.2		1	1.6			1.6			14.1		1
06/29/22 23:00	0.6			1.6			13.2		1	0.8			1.6			13.2		1
06/30/22 0:00	0.9			1.5			14.4		1	1.1			1.6			14.5		1
06/30/22 1:00	0.6			1.4			14.5		1	0	X		0	X		0	X	1
06/30/22 2:00	0.6			1.3			14.5		1	0	X		0	X		0	X	1
06/30/22 3:00	0.6			1.4			14.5		1	0	X		0	X		0	X	1
06/30/22 4:00	0.7			1.4			14.5		1	0	X		0	X		0	X	1
06/30/22 5:00	0.6			1.5			14.5		1	0	X		0	X		0	X	1
06/30/22 6:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
06/30/22 7:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
06/30/22 8:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
06/30/22 9:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
06/30/22 10:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
06/30/22 11:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
06/30/22 12:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
06/30/22 13:00	0.6			1.4			14.7		1	0	X		0	X		0	X	1
06/30/22 14:00	0.6			1.5			14.7		1	0.6			1.6			15.3		1
06/30/22 15:00	0.8			1.5			14.3		1	0.8			0.5			14.4		1
06/30/22 16:00	1			1.5			14		1	1			1.5			13.9		1
06/30/22 17:00	0.9			1.5			13.9		1	0.9			1.5			13.8		1
06/30/22 18:00	0.4			1.5			12.8		1	0.5			1.5			12.8		1
06/30/22 19:00	0.1			1.5			12		1	0.3			1.5			12		1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/30/22 20:00	0.9			1.5			13.7		1	0.9			1.5			13.6		1
06/30/22 21:00	1.4			1.5			14.2		1	1.3			1.5			14.1		1
06/30/22 22:00	1.2			1.5			14.3		1	1.2			1.5			14.2		1
06/30/22 23:00	0.7			1.4			14.5		1	0.7			1.5			14.8		1
07/01/22 0:00	0.6			1.5			14.5		1	0	X		0	X		0	X	1
07/01/22 1:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/01/22 2:00	0.6			1.4			14.6		1	0	X		0	X		0	X	1
07/01/22 3:00	0.7			1.5			14.6		1	0	X		0	X		0	X	1
07/01/22 4:00	0.7			1.5			14.6		1	0	X		0	X		0	X	1
07/01/22 5:00	0.7			1.5			14.5		1	0	X		0	X		0	X	1
07/01/22 6:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/01/22 7:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/01/22 8:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/01/22 9:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
07/01/22 10:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
07/01/22 11:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
07/01/22 12:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
07/01/22 13:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
07/01/22 14:00	0.6			1.5			14.8		1	0	X		0	X		0	X	1
07/01/22 15:00	0.5			1.5			14.8		1	0	X		0	X		0	X	1
07/01/22 16:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
07/01/22 17:00	1.6			1.5			14.3		1	0			0			15.7		1
07/01/22 18:00	0.9			1.5			14.3		1	1.1			1.5			14.3		1
07/01/22 19:00	1			1.5			14.1		1	1.4			1.5			14		1
07/01/22 20:00	1.3			1.5			14.1		1	1.4			1.5			14		1
07/01/22 21:00	1.5			1.5			14.2		1	1.4			1.5			14.1		1
07/01/22 22:00	1.2			1.5			14.3		1	1.2			1.5			14.2		1
07/01/22 23:00	0.6			1.4			14.5		1	0			0			15.7		1

Tons 12 Month Rolling Summary

CT1 and CT2 Combined

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:43 **Location:** Roseville, CA

* = Excess Emission

	Units CT1 & CT2		Units CT1 & CT2		Units CT1 & CT2		Units CT1 & CT2		Units CT1 & CT2	
Date	CO, Ton 1 Day(s)		NOx, Ton 1 Day(s)		PM10, Ton 1 Day(s)		SO2, Ton 1 Day(s)		VOC, Ton 1 Day(s)	
	Sum	Rolling Sum	Sum	Rolling Sum	Sum	Rolling Sum	Sum	Rolling Sum	Sum	Rolling Sum
Apr 2022	0.4279	6.9825	0.0732	14.0559	0.0088	2.9936	0.0045	1.4962	0.0149	4.9895
May 2022	0.4443	6.8879	0.5924	13.9853	0.1194	2.9870	0.0596	1.4929	0.1989	4.9780
Jun 2022	0.7168	6.7270	1.0943	13.6989	0.2183	2.9175	0.1092	1.4584	0.3644	4.8627
Sum/Avg	6.7270		13.6989		2.9175		1.4584		4.8627	
Limit Value										

ATTACHMENT 5

AQ-33

AQ-33 The Project owner shall maintain records of Sox lb/hr, lb/day, and lb, quarter emissions. Sox emissions shall be based on fuel use records, natural gas sulfur content, and mass balance calculations.

Verification: The Project owner shall submit to the CPM all hourly, daily, and quarterly Sox emissions as part of the Quarterly Air Quality Report required by the Condition of Certification AQ-SC6

AQ33 HOURLY SOX

	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/01/22 0:00	0	X		0	X		0											
04/01/22 1:00	0	X		0	X		0											
04/01/22 2:00	0	X		0	X		0											
04/01/22 3:00	0	X		0	X		0											
04/01/22 4:00	0	X		0	X		0											
04/01/22 5:00	0	X		0	X		0											
04/01/22 6:00	0	X		0	X		0											
04/01/22 7:00	0	X		0	X		0											
04/01/22 8:00	0	X		0	X		0											
04/01/22 9:00	0	X		0	X		0											
04/01/22 10:00	0	X		0	X		0											
04/01/22 11:00	0	X		0	X		0											
04/01/22 12:00	0	X		0	X		0											
04/01/22 13:00	0	X		0	X		0											
04/01/22 14:00	0	X		0	X		0											
04/01/22 15:00	0	X		0	X		0											
04/01/22 16:00	0	X		0	X		0											
04/01/22 17:00	0	X		0	X		0											
04/01/22 18:00	0	X		0	X		0											
04/01/22 19:00	0	X		0	X		0											
04/01/22 20:00	0	X		0	X		0											
04/01/22 21:00	0	X		0	X		0											
04/01/22 22:00	0	X		0	X		0											
04/01/22 23:00	0	X		0	X		0											
04/02/22 0:00	0	X		0	X		0											
04/02/22 1:00	0	X		0	X		0											
04/02/22 2:00	0	X		0	X		0											
04/02/22 3:00	0	X		0	X		0											
04/02/22 4:00	0	X		0	X		0											
04/02/22 5:00	0	X		0	X		0											
04/02/22 6:00	0	X		0	X		0											
04/02/22 7:00	0	X		0	X		0											
04/02/22 8:00	0	X		0	X		0											
04/02/22 9:00	0	X		0	X		0											

	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/02/22 10:00	0	X		0	X		0											
04/02/22 11:00	0	X		0	X		0											
04/02/22 12:00	0	X		0	X		0											
04/02/22 13:00	0	X		0	X		0											
04/02/22 14:00	0	X		0	X		0											
04/02/22 15:00	0	X		0	X		0											
04/02/22 16:00	0	X		0	X		0											
04/02/22 17:00	0	X		0	X		0											
04/02/22 18:00	0	X		0	X		0											
04/02/22 19:00	0	X		0	X		0											
04/02/22 20:00	0	X		0	X		0											
04/02/22 21:00	0	X		0	X		0											
04/02/22 22:00	0	X		0	X		0											
04/02/22 23:00	0	X		0	X		0											
04/03/22 0:00	0	X		0	X		0											
04/03/22 1:00	0	X		0	X		0											
04/03/22 2:00	0	X		0	X		0											
04/03/22 3:00	0	X		0	X		0											
04/03/22 4:00	0	X		0	X		0											
04/03/22 5:00	0	X		0	X		0											
04/03/22 6:00	0	X		0	X		0											
04/03/22 7:00	0	X		0	X		0											
04/03/22 8:00	0	X		0	X		0											
04/03/22 9:00	0	X		0	X		0											
04/03/22 10:00	0	X		0	X		0											
04/03/22 11:00	0	X		0	X		0											
04/03/22 12:00	0	X		0	X		0											
04/03/22 13:00	0	X		0	X		0											
04/03/22 14:00	0	X		0	X		0											
04/03/22 15:00	0	X		0	X		0											
04/03/22 16:00	0	X		0	X		0											
04/03/22 17:00	0	X		0	X		0											
04/03/22 18:00	0	X		0	X		0											
04/03/22 19:00	0	X		0	X		0											
04/03/22 20:00	0	X		0	X		0											
04/03/22 21:00	0	X		0	X		0											
04/03/22 22:00	0	X		0	X		0											

	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/03/22 23:00	0	X		0	X		0											
04/04/22 0:00	0	X		0	X		0											
04/04/22 1:00	0	X		0	X		0											
04/04/22 2:00	0	X		0	X		0											
04/04/22 3:00	0	X		0	X		0											
04/04/22 4:00	0	X		0	X		0											
04/04/22 5:00	0	X		0	X		0											
04/04/22 6:00	0	X		0	X		0											
04/04/22 7:00	0	X		0	X		0											
04/04/22 8:00	0	X		0	X		0											
04/04/22 9:00	0	X		0	X		0											
04/04/22 10:00	0	X		0	X		0											
04/04/22 11:00	0	X		0	X		0											
04/04/22 12:00	0	X		0	X		0											
04/04/22 13:00	0	X		0	X		0											
04/04/22 14:00	0	X		0	X		0											
04/04/22 15:00	0	X		0	X		0											
04/04/22 16:00	0	X		0	X		0											
04/04/22 17:00	0	X		0	X		0											
04/04/22 18:00	0	X		0	X		0											
04/04/22 19:00	0	X		0	X		0											
04/04/22 20:00	0	X		0	X		0											
04/04/22 21:00	0	X		0	X		0											
04/04/22 22:00	0	X		0	X		0											
04/04/22 23:00	0	X		0	X		0											
04/05/22 0:00	0	X		0	X		0											
04/05/22 1:00	0	X		0	X		0											
04/05/22 2:00	0	X		0	X		0											
04/05/22 3:00	0	X		0	X		0											
04/05/22 4:00	0	X		0	X		0											
04/05/22 5:00	0	X		0	X		0											
04/05/22 6:00	0	X		0	X		0											
04/05/22 7:00	0	X		0	X		0											
04/05/22 8:00	0	X		0	X		0											
04/05/22 9:00	0	X		0	X		0											
04/05/22 10:00	0	X		0	X		0											
04/05/22 11:00	0	X		0	X		0											

	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/05/22 12:00	0	X		0	X		0											
04/05/22 13:00	0	X		0	X		0											
04/05/22 14:00	0	X		0	X		0											
04/05/22 15:00	0	X		0	X		0											
04/05/22 16:00	0	X		0	X		0											
04/05/22 17:00	0	X		0	X		0											
04/05/22 18:00	0	X		0	X		0											
04/05/22 19:00	0	X		0	X		0											
04/05/22 20:00	0	X		0	X		0											
04/05/22 21:00	0	X		0	X		0											
04/05/22 22:00	0	X		0	X		0											
04/05/22 23:00	0	X		0	X		0											
04/06/22 0:00	0	X		0	X		0											
04/06/22 1:00	0	X		0	X		0											
04/06/22 2:00	0	X		0	X		0											
04/06/22 3:00	0	X		0	X		0											
04/06/22 4:00	0	X		0	X		0											
04/06/22 5:00	0	X		0	X		0											
04/06/22 6:00	0	X		0	X		0											
04/06/22 7:00	0	X		0	X		0											
04/06/22 8:00	0	X		0	X		0											
04/06/22 9:00	0	X		0	X		0											
04/06/22 10:00	0	X		0	X		0											
04/06/22 11:00	0	X		0	X		0											
04/06/22 12:00	0	X		0	X		0											
04/06/22 13:00	0	X		0	X		0											
04/06/22 14:00	0	X		0	X		0											
04/06/22 15:00	0	X		0	X		0											
04/06/22 16:00	0	X		0	X		0											
04/06/22 17:00	0	X		0	X		0											
04/06/22 18:00	0	X		0	X		0											
04/06/22 19:00	0	X		0	X		0											
04/06/22 20:00	0	X		0	X		0											
04/06/22 21:00	0	X		0	X		0											
04/06/22 22:00	0	X		0	X		0											
04/06/22 23:00	0	X		0	X		0											
04/07/22 0:00	0	X		0	X		0											

	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/07/22 1:00	0	X		0	X		0											
04/07/22 2:00	0	X		0	X		0											
04/07/22 3:00	0	X		0	X		0											
04/07/22 4:00	0	X		0	X		0											
04/07/22 5:00	0	X		0	X		0											
04/07/22 6:00	0	X		0	X		0											
04/07/22 7:00	0	X		0	X		0											
04/07/22 8:00	0	X		0	X		0											
04/07/22 9:00	0	X		0	X		0											
04/07/22 10:00	0	X		0	X		0											
04/07/22 11:00	0	X		0	X		0											
04/07/22 12:00	0	X		0	X		0											
04/07/22 13:00	0	X		0	X		0											
04/07/22 14:00	0	X		0	X		0											
04/07/22 15:00	0	X		0	X		0											
04/07/22 16:00	0	X		0	X		0											
04/07/22 17:00	0	X		0	X		0											
04/07/22 18:00	0	X		0	X		0											
04/07/22 19:00	0	X		0	X		0											
04/07/22 20:00	0	X		0	X		0											
04/07/22 21:00	0	X		0	X		0											
04/07/22 22:00	0	X		0	X		0											
04/07/22 23:00	0	X		0	X		0											
04/08/22 0:00	0	X		0	X		0											
04/08/22 1:00	0	X		0	X		0											
04/08/22 2:00	0	X		0	X		0											
04/08/22 3:00	0	X		0	X		0											
04/08/22 4:00	0	X		0	X		0											
04/08/22 5:00	0	X		0	X		0											
04/08/22 6:00	0	X		0	X		0											
04/08/22 7:00	0	X		0	X		0											
04/08/22 8:00	0	X		0	X		0											
04/08/22 9:00	0	X		0	X		0											
04/08/22 10:00	0	X		0	X		0											
04/08/22 11:00	0	X		0	X		0											
04/08/22 12:00	0	X		0	X		0											
04/08/22 13:00	0	X		0	X		0											

	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/08/22 14:00	0	X		0	X		0											
04/08/22 15:00	0	X		0	X		0											
04/08/22 16:00	0	X		0	X		0											
04/08/22 17:00	0	X		0	X		0											
04/08/22 18:00	0	X		0	X		0											
04/08/22 19:00	0	X		0	X		0											
04/08/22 20:00	0	X		0	X		0											
04/08/22 21:00	0	X		0	X		0											
04/08/22 22:00	0	X		0	X		0											
04/08/22 23:00	0	X		0	X		0											
04/09/22 0:00	0	X		0	X		0											
04/09/22 1:00	0	X		0	X		0											
04/09/22 2:00	0	X		0	X		0											
04/09/22 3:00	0	X		0	X		0											
04/09/22 4:00	0	X		0	X		0											
04/09/22 5:00	0	X		0	X		0											
04/09/22 6:00	0	X		0	X		0											
04/09/22 7:00	0	X		0	X		0											
04/09/22 8:00	0	X		0	X		0											
04/09/22 9:00	0	X		0	X		0											
04/09/22 10:00	0	X		0	X		0											
04/09/22 11:00	0	X		0	X		0											
04/09/22 12:00	0	X		0	X		0											
04/09/22 13:00	0	X		0	X		0											
04/09/22 14:00	0	X		0	X		0											
04/09/22 15:00	0	X		0	X		0											
04/09/22 16:00	0	X		0	X		0											
04/09/22 17:00	0	X		0	X		0											
04/09/22 18:00	0	X		0	X		0											
04/09/22 19:00	0	X		0	X		0											
04/09/22 20:00	0	X		0	X		0											
04/09/22 21:00	0	X		0	X		0											
04/09/22 22:00	0	X		0	X		0											
04/09/22 23:00	0	X		0	X		0											
04/10/22 0:00	0	X		0	X		0											
04/10/22 1:00	0	X		0	X		0											
04/10/22 2:00	0	X		0	X		0											

	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/10/22 3:00	0	X		0	X		0											
04/10/22 4:00	0	X		0	X		0											
04/10/22 5:00	0	X		0	X		0											
04/10/22 6:00	0	X		0	X		0											
04/10/22 7:00	0	X		0	X		0											
04/10/22 8:00	0	X		0	X		0											
04/10/22 9:00	0	X		0	X		0											
04/10/22 10:00	0	X		0	X		0											
04/10/22 11:00	0	X		0	X		0											
04/10/22 12:00	0	X		0	X		0											
04/10/22 13:00	0	X		0	X		0											
04/10/22 14:00	0	X		0	X		0											
04/10/22 15:00	0	X		0	X		0											
04/10/22 16:00	0	X		0	X		0											
04/10/22 17:00	0	X		0	X		0											
04/10/22 18:00	0	X		0	X		0											
04/10/22 19:00	0	X		0	X		0											
04/10/22 20:00	0	X		0	X		0											
04/10/22 21:00	0	X		0	X		0											
04/10/22 22:00	0	X		0	X		0											
04/10/22 23:00	0	X		0	X		0											
04/11/22 0:00	0	X		0	X		0											
04/11/22 1:00	0	X		0	X		0											
04/11/22 2:00	0	X		0	X		0											
04/11/22 3:00	0	X		0	X		0											
04/11/22 4:00	0	X		0	X		0											
04/11/22 5:00	0	X		0	X		0											
04/11/22 6:00	0	X		0	X		0											
04/11/22 7:00	0	X		0	X		0											
04/11/22 8:00	0	X		0	X		0											
04/11/22 9:00	0	X		0	X		0											
04/11/22 10:00	0	X		0	X		0											
04/11/22 11:00	0	X		0	X		0											
04/11/22 12:00	0	X		0	X		0											
04/11/22 13:00	0	X		0	X		0											
04/11/22 14:00	0	X		0	X		0											
04/11/22 15:00	0	X		0	X		0											

	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/11/22 16:00	0	X		0	X		0											
04/11/22 17:00	0	X		0	X		0											
04/11/22 18:00	0	X		0	X		0											
04/11/22 19:00	0	X		0	X		0											
04/11/22 20:00	0	X		0	X		0											
04/11/22 21:00	0	X		0	X		0											
04/11/22 22:00	0	X		0	X		0											
04/11/22 23:00	0	X		0	X		0											
04/12/22 0:00	0	X		0	X		0											
04/12/22 1:00	0	X		0	X		0											
04/12/22 2:00	0	X		0	X		0											
04/12/22 3:00	0	X		0	X		0											
04/12/22 4:00	0	X		0	X		0											
04/12/22 5:00	0	X		0	X		0											
04/12/22 6:00	0	X		0	X		0											
04/12/22 7:00	0	X		0	X		0											
04/12/22 8:00	0	X		0	X		0											
04/12/22 9:00	0	X		0	X		0											
04/12/22 10:00	0	X		0	X		0											
04/12/22 11:00	0	X		0	X		0											
04/12/22 12:00	0	X		0	X		0											
04/12/22 13:00	0	X		0	X		0											
04/12/22 14:00	0	X		0	X		0											
04/12/22 15:00	0	X		0	X		0											
04/12/22 16:00	0	X		0	X		0											
04/12/22 17:00	0	X		0	X		0											
04/12/22 18:00	0	X		0	X		0											
04/12/22 19:00	0	X		0	X		0											
04/12/22 20:00	0	X		0	X		0											
04/12/22 21:00	0	X		0	X		0											
04/12/22 22:00	0	X		0	X		0											
04/12/22 23:00	0	X		0	X		0											
04/13/22 0:00	0	X		0	X		0											
04/13/22 1:00	0	X		0	X		0											
04/13/22 2:00	0	X		0	X		0											
04/13/22 3:00	0	X		0	X		0											
04/13/22 4:00	0	X		0	X		0											

	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/13/22 5:00	0	X		0	X		0											
04/13/22 6:00	0	X		0	X		0											
04/13/22 7:00	0	X		0	X		0											
04/13/22 8:00	0	X		0	X		0											
04/13/22 9:00	0	X		0	X		0											
04/13/22 10:00	0	X		0	X		0											
04/13/22 11:00	0	X		0	X		0											
04/13/22 12:00	0	X		0	X		0											
04/13/22 13:00	0	X		0	X		0											
04/13/22 14:00	0	X		0	X		0											
04/13/22 15:00	0	X		0	X		0											
04/13/22 16:00	0	X		0	X		0											
04/13/22 17:00	0	X		0	X		0											
04/13/22 18:00	0	X		0	X		0											
04/13/22 19:00	0	X		0	X		0											
04/13/22 20:00	0	X		0	X		0											
04/13/22 21:00	0	X		0	X		0											
04/13/22 22:00	0	X		0	X		0											
04/13/22 23:00	0	X		0	X		0											
04/14/22 0:00	0	X		0	X		0											
04/14/22 1:00	0	X		0	X		0											
04/14/22 2:00	0	X		0	X		0											
04/14/22 3:00	0	X		0	X		0											
04/14/22 4:00	0	X		0	X		0											
04/14/22 5:00	0	X		0	X		0											
04/14/22 6:00	0	X		0	X		0											
04/14/22 7:00	0	X		0	X		0											
04/14/22 8:00	0	X		0	X		0											
04/14/22 9:00	0	X		0	X		0											
04/14/22 10:00	0	X		0	X		0											
04/14/22 11:00	0	X		0	X		0											
04/14/22 12:00	0	X		0	X		0											
04/14/22 13:00	0	X		0	X		0											
04/14/22 14:00	0	X		0	X		0											
04/14/22 15:00	0	X		0	X		0											
04/14/22 16:00	0	X		0	X		0											
04/14/22 17:00	0	X		0	X		0											

	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/14/22 18:00	0	X		0	X		0											
04/14/22 19:00	0	X		0	X		0											
04/14/22 20:00	0	X		0	X		0											
04/14/22 21:00	0	X		0	X		0											
04/14/22 22:00	0	X		0	X		0											
04/14/22 23:00	0	X		0	X		0											
04/15/22 0:00	0	X		0	X		0											
04/15/22 1:00	0	X		0	X		0											
04/15/22 2:00	0	X		0	X		0											
04/15/22 3:00	0	X		0	X		0											
04/15/22 4:00	0	X		0	X		0											
04/15/22 5:00	0	X		0	X		0											
04/15/22 6:00	0	X		0	X		0											
04/15/22 7:00	0	X		0	X		0											
04/15/22 8:00	0	X		0	X		0											
04/15/22 9:00	0	X		0	X		0											
04/15/22 10:00	0	X		0	X		0											
04/15/22 11:00	0	X		0	X		0											
04/15/22 12:00	0	X		0	X		0											
04/15/22 13:00	0	X		0	X		0											
04/15/22 14:00	0	X		0	X		0											
04/15/22 15:00	0	X		0	X		0											
04/15/22 16:00	0	X		0	X		0											
04/15/22 17:00	0	X		0	X		0											
04/15/22 18:00	0	X		0	X		0											
04/15/22 19:00	0	X		0	X		0											
04/15/22 20:00	0	X		0	X		0											
04/15/22 21:00	0	X		0	X		0											
04/15/22 22:00	0	X		0	X		0											
04/15/22 23:00	0	X		0	X		0											
04/16/22 0:00	0	X		0	X		0											
04/16/22 1:00	0	X		0	X		0											
04/16/22 2:00	0	X		0	X		0											
04/16/22 3:00	0	X		0	X		0											
04/16/22 4:00	0	X		0	X		0											
04/16/22 5:00	0	X		0	X		0											
04/16/22 6:00	0	X		0	X		0											

	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/16/22 7:00	0	X		0	X		0											
04/16/22 8:00	0	X		0	X		0											
04/16/22 9:00	0	X		0	X		0											
04/16/22 10:00	0	X		0	X		0											
04/16/22 11:00	0	X		0	X		0											
04/16/22 12:00	0	X		0	X		0											
04/16/22 13:00	0	X		0	X		0											
04/16/22 14:00	0	X		0	X		0											
04/16/22 15:00	0	X		0	X		0											
04/16/22 16:00	0	X		0	X		0											
04/16/22 17:00	0	X		0	X		0											
04/16/22 18:00	0	X		0	X		0											
04/16/22 19:00	0	X		0	X		0											
04/16/22 20:00	0	X		0	X		0											
04/16/22 21:00	0	X		0	X		0											
04/16/22 22:00	0	X		0	X		0											
04/16/22 23:00	0	X		0	X		0											
04/17/22 0:00	0	X		0	X		0											
04/17/22 1:00	0	X		0	X		0											
04/17/22 2:00	0	X		0	X		0											
04/17/22 3:00	0	X		0	X		0											
04/17/22 4:00	0	X		0	X		0											
04/17/22 5:00	0	X		0	X		0											
04/17/22 6:00	0	X		0	X		0											
04/17/22 7:00	0	X		0	X		0											
04/17/22 8:00	0	X		0	X		0											
04/17/22 9:00	0	X		0	X		0											
04/17/22 10:00	0	X		0	X		0											
04/17/22 11:00	0	X		0	X		0											
04/17/22 12:00	0	X		0	X		0											
04/17/22 13:00	0	X		0	X		0											
04/17/22 14:00	0	X		0	X		0											
04/17/22 15:00	0	X		0	X		0											
04/17/22 16:00	0	X		0	X		0											
04/17/22 17:00	0	X		0	X		0											
04/17/22 18:00	0	X		0	X		0											
04/17/22 19:00	0	X		0	X		0											

	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/17/22 20:00	0	X		0	X		0											
04/17/22 21:00	0	X		0	X		0											
04/17/22 22:00	0	X		0	X		0											
04/17/22 23:00	0	X		0	X		0											
04/18/22 0:00	0	X		0	X		0											
04/18/22 1:00	0	X		0	X		0											
04/18/22 2:00	0	X		0	X		0											
04/18/22 3:00	0	X		0	X		0											
04/18/22 4:00	0	X		0	X		0											
04/18/22 5:00	0	X		0	X		0											
04/18/22 6:00	0	X		0	X		0											
04/18/22 7:00	0	X		0	X		0											
04/18/22 8:00	0	X		0	X		0											
04/18/22 9:00	0	X		0	X		0											
04/18/22 10:00	0	X		0	X		0											
04/18/22 11:00	0	X		0	X		0											
04/18/22 12:00	0	X		0	X		0											
04/18/22 13:00	0	X		0	X		0											
04/18/22 14:00	0	X		0	X		0											
04/18/22 15:00	0	X		0	X		0											
04/18/22 16:00	0	X		0	X		0											
04/18/22 17:00	0	X		0	X		0											
04/18/22 18:00	0	X		0	X		0											
04/18/22 19:00	0	X		0	X		0											
04/18/22 20:00	0	X		0	X		0											
04/18/22 21:00	0	X		0	X		0											
04/18/22 22:00	0	X		0	X		0											
04/18/22 23:00	0	X		0	X		0											
04/19/22 0:00	0	X		0	X		0											
04/19/22 1:00	0	X		0	X		0											
04/19/22 2:00	0	X		0	X		0											
04/19/22 3:00	0	X		0	X		0											
04/19/22 4:00	0	X		0	X		0											
04/19/22 5:00	0	X		0	X		0											
04/19/22 6:00	0	X		0	X		0											
04/19/22 7:00	0	X		0	X		0											
04/19/22 8:00	0	X		0	X		0											

	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/19/22 9:00	0	X		0	X		0											
04/19/22 10:00	0	X		0	X		0											
04/19/22 11:00	0	X		0	X		0											
04/19/22 12:00	0	X		0	X		0											
04/19/22 13:00	0	X		0	X		0											
04/19/22 14:00	0	X		0	X		0											
04/19/22 15:00	0	X		0	X		0											
04/19/22 16:00	0	X		0	X		0											
04/19/22 17:00	0	X		0	X		0											
04/19/22 18:00	0	X		0	X		0											
04/19/22 19:00	0	X		0	X		0											
04/19/22 20:00	0	X		0	X		0											
04/19/22 21:00	0	X		0	X		0											
04/19/22 22:00	0	X		0	X		0											
04/19/22 23:00	0	X		0	X		0											
04/20/22 0:00	0	X		0	X		0											
04/20/22 1:00	0	X		0	X		0											
04/20/22 2:00	0	X		0	X		0											
04/20/22 3:00	0	X		0	X		0											
04/20/22 4:00	0	X		0	X		0											
04/20/22 5:00	0	X		0	X		0											
04/20/22 6:00	0	X		0	X		0											
04/20/22 7:00	0	X		0	X		0											
04/20/22 8:00	0	X		0	X		0											
04/20/22 9:00	0	X		0	X		0											
04/20/22 10:00	0	X		0	X		0											
04/20/22 11:00	0	X		0	X		0											
04/20/22 12:00	0	X		0	X		0											
04/20/22 13:00	0	X		0	X		0											
04/20/22 14:00	0	X		0	X		0											
04/20/22 15:00	0	X		0	X		0											
04/20/22 16:00	0	X		0	X		0											
04/20/22 17:00	0	X		0	X		0											
04/20/22 18:00	0	X		0	X		0											
04/20/22 19:00	0	X		0	X		0											
04/20/22 20:00	0	X		0	X		0											
04/20/22 21:00	0	X		0	X		0											

	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/20/22 22:00	0	X		0	X		0											
04/20/22 23:00	0	X		0	X		0											
04/21/22 0:00	0	X		0	X		0											
04/21/22 1:00	0	X		0	X		0											
04/21/22 2:00	0	X		0	X		0											
04/21/22 3:00	0	X		0	X		0											
04/21/22 4:00	0	X		0	X		0											
04/21/22 5:00	0	X		0	X		0											
04/21/22 6:00	0	X		0	X		0											
04/21/22 7:00	0	X		0	X		0											
04/21/22 8:00	0	X		0	X		0											
04/21/22 9:00	0	X		0	X		0											
04/21/22 10:00	0	X		0	X		0											
04/21/22 11:00	0	X		0	X		0											
04/21/22 12:00	0	X		0	X		0											
04/21/22 13:00	0	X		0	X		0											
04/21/22 14:00	0	X		0	X		0											
04/21/22 15:00	0	X		0	X		0											
04/21/22 16:00	0	X		0	X		0											
04/21/22 17:00	0	X		0	X		0											
04/21/22 18:00	0	X		0	X		0											
04/21/22 19:00	0	X		0	X		0											
04/21/22 20:00	0	X		0	X		0											
04/21/22 21:00	0	X		0	X		0											
04/21/22 22:00	0	X		0	X		0											
04/21/22 23:00	0	X		0	X		0											
04/22/22 0:00	0	X		0	X		0											
04/22/22 1:00	0	X		0	X		0											
04/22/22 2:00	0	X		0	X		0											
04/22/22 3:00	0	X		0	X		0											
04/22/22 4:00	0	X		0	X		0											
04/22/22 5:00	0	X		0	X		0											
04/22/22 6:00	0	X		0	X		0											
04/22/22 7:00	0	X		0	X		0											
04/22/22 8:00	0	X		0	X		0											
04/22/22 9:00	0	X		0	X		0											
04/22/22 10:00	0	X		0	X		0											

	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/22/22 11:00	0	X		0	X		0											
04/22/22 12:00	0	X		0	X		0											
04/22/22 13:00	0	X		0	X		0											
04/22/22 14:00	0	X		0	X		0											
04/22/22 15:00	0	X		0	X		0											
04/22/22 16:00	0	X		0	X		0											
04/22/22 17:00	0	X		0	X		0											
04/22/22 18:00	0	X		0	X		0											
04/22/22 19:00	0	X		0	X		0											
04/22/22 20:00	0	X		0	X		0											
04/22/22 21:00	0	X		0	X		0											
04/22/22 22:00	0	X		0	X		0											
04/22/22 23:00	0	X		0	X		0											
04/23/22 0:00	0	X		0	X		0											
04/23/22 1:00	0	X		0	X		0											
04/23/22 2:00	0	X		0	X		0											
04/23/22 3:00	0	X		0	X		0											
04/23/22 4:00	0	X		0	X		0											
04/23/22 5:00	0	X		0	X		0											
04/23/22 6:00	0	X		0	X		0											
04/23/22 7:00	0	X		0	X		0											
04/23/22 8:00	0	X		0	X		0											
04/23/22 9:00	0	X		0	X		0											
04/23/22 10:00	0	X		0	X		0											
04/23/22 11:00	0	X		0	X		0											
04/23/22 12:00	0	X		0	X		0											
04/23/22 13:00	0	X		0	X		0											
04/23/22 14:00	0	X		0	X		0											
04/23/22 15:00	0	X		0	X		0											
04/23/22 16:00	0	X		0	X		0											
04/23/22 17:00	0	X		0	X		0											
04/23/22 18:00	0	X		0	X		0											
04/23/22 19:00	0	X		0	X		0											
04/23/22 20:00	0	X		0	X		0											
04/23/22 21:00	0	X		0	X		0											
04/23/22 22:00	0	X		0	X		0											
04/23/22 23:00	0	X		0	X		0											

	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/24/22 0:00	0	X		0	X		0											
04/24/22 1:00	0	X		0	X		0											
04/24/22 2:00	0	X		0	X		0											
04/24/22 3:00	0	X		0	X		0											
04/24/22 4:00	0	X		0	X		0											
04/24/22 5:00	0	X		0	X		0											
04/24/22 6:00	0	X		0	X		0											
04/24/22 7:00	0	X		0	X		0											
04/24/22 8:00	0	X		0	X		0											
04/24/22 9:00	0	X		0	X		0											
04/24/22 10:00	0	X		0	X		0											
04/24/22 11:00	0	X		0	X		0											
04/24/22 12:00	0	X		0	X		0											
04/24/22 13:00	0	X		0	X		0											
04/24/22 14:00	0	X		0	X		0											
04/24/22 15:00	0	X		0	X		0											
04/24/22 16:00	0	X		0	X		0											
04/24/22 17:00	0	X		0	X		0											
04/24/22 18:00	0	X		0	X		0											
04/24/22 19:00	0	X		0	X		0											
04/24/22 20:00	0	X		0	X		0											
04/24/22 21:00	0	X		0	X		0											
04/24/22 22:00	0	X		0	X		0											
04/24/22 23:00	0	X		0	X		0											
04/25/22 0:00	0	X		0	X		0											
04/25/22 1:00	0	X		0	X		0											
04/25/22 2:00	0	X		0	X		0											
04/25/22 3:00	0	X		0	X		0											
04/25/22 4:00	0	X		0	X		0											
04/25/22 5:00	0	X		0	X		0											
04/25/22 6:00	0	X		0	X		0											
04/25/22 7:00	0	X		0	X		0											
04/25/22 8:00	0	X		0	X		0											
04/25/22 9:00	0	X		0	X		0											
04/25/22 10:00	0	X		0	X		0											
04/25/22 11:00	0	X		0	X		0											
04/25/22 12:00	0	X		0	X		0											

	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/25/22 13:00	0	X		0	X		0											
04/25/22 14:00	0	X		0	X		0											
04/25/22 15:00	0	X		0	X		0											
04/25/22 16:00	0	X		0	X		0											
04/25/22 17:00	0	X		0	X		0											
04/25/22 18:00	0	X		0	X		0											
04/25/22 19:00	0	X		0	X		0											
04/25/22 20:00	0	X		0	X		0											
04/25/22 21:00	0	X		0	X		0											
04/25/22 22:00	0	X		0	X		0											
04/25/22 23:00	0	X		0	X		0											
04/26/22 0:00	0	X		0	X		0											
04/26/22 1:00	0	X		0	X		0											
04/26/22 2:00	0	X		0	X		0											
04/26/22 3:00	0	X		0	X		0											
04/26/22 4:00	0	X		0	X		0											
04/26/22 5:00	0	X		0	X		0											
04/26/22 6:00	0	X		0	X		0											
04/26/22 7:00	0	X		0	X		0											
04/26/22 8:00	0	X		0	X		0											
04/26/22 9:00	0	X		0	X		0											
04/26/22 10:00	0	X		0	X		0											
04/26/22 11:00	0	X		0	X		0											
04/26/22 12:00	0	X		0	X		0											
04/26/22 13:00	0	X		0.0666			0.02											
04/26/22 14:00	0	X		0.17874			0.18											
04/26/22 15:00	0	X		0.22614			0.23											
04/26/22 16:00	0	X		0.28362			0.28											
04/26/22 17:00	0	X		0.29328			0.29											
04/26/22 18:00	0	X		0.27456			0.27											
04/26/22 19:00	0	X		0.29394			0.29											
04/26/22 20:00	0	X		0.30072			0.3											
04/26/22 21:00	0	X		0.29724			0.3											
04/26/22 22:00	0	X		0.1614			0.04											
04/26/22 23:00	0	X		0	X		0											
04/27/22 0:00	0	X		0	X		0											
04/27/22 1:00	0	X		0	X		0											

	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/27/22 2:00	0	X		0	X		0											
04/27/22 3:00	0	X		0	X		0											
04/27/22 4:00	0	X		0	X		0											
04/27/22 5:00	0	X		0	X		0											
04/27/22 6:00	0	X		0	X		0											
04/27/22 7:00	0	X		0	X		0											
04/27/22 8:00	0	X		0.08844			0.02											
04/27/22 9:00	0	X		0.28092			0.28											
04/27/22 10:00	0	X		0.24456			0.24											
04/27/22 11:00	0	X		0.29412			0.29											
04/27/22 12:00	0	X		0.27906			0.28											
04/27/22 13:00	0	X		0.29748			0.3											
04/27/22 14:00	0	X		0.29634			0.3											
04/27/22 15:00	0	X		0.28008			0.28											
04/27/22 16:00	0	X		0.28602			0.29											
04/27/22 17:00	0	X		0.22248			0.22											
04/27/22 18:00	0	X		0.21984			0.22											
04/27/22 19:00	0	X		0.102			0.01											
04/27/22 20:00	0	X		0	X		0											
04/27/22 21:00	0	X		0	X		0											
04/27/22 22:00	0	X		0	X		0											
04/27/22 23:00	0	X		0	X		0											
04/28/22 0:00	0	X		0	X		0											
04/28/22 1:00	0	X		0	X		0											
04/28/22 2:00	0	X		0	X		0											
04/28/22 3:00	0	X		0	X		0											
04/28/22 4:00	0	X		0	X		0											
04/28/22 5:00	0	X		0	X		0											
04/28/22 6:00	0	X		0	X		0											
04/28/22 7:00	0	X		0	X		0											
04/28/22 8:00	0	X		0.0831			0.03											
04/28/22 9:00	0	X		0.16962			0.17											
04/28/22 10:00	0	X		0.17586			0.18											
04/28/22 11:00	0	X		0.1746			0.17											
04/28/22 12:00	0	X		0.22296			0.22											
04/28/22 13:00	0	X		0.24426			0.24											
04/28/22 14:00	0	X		0.29964			0.3											

	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/28/22 15:00	0	X		0.291			0.29											
04/28/22 16:00	0	X		0.16974			0.17											
04/28/22 17:00	0.06924			0.11058			0.03											
04/28/22 18:00	0.0795			0	X		0.02											
04/28/22 19:00	0	X		0	X		0											
04/28/22 20:00	0	X		0	X		0											
04/28/22 21:00	0	X		0	X		0											
04/28/22 22:00	0	X		0	X		0											
04/28/22 23:00	0	X		0	X		0											
04/29/22 0:00	0	X		0	X		0											
04/29/22 1:00	0	X		0	X		0											
04/29/22 2:00	0	X		0	X		0											
04/29/22 3:00	0	X		0	X		0											
04/29/22 4:00	0	X		0	X		0											
04/29/22 5:00	0	X		0	X		0											
04/29/22 6:00	0	X		0	X		0											
04/29/22 7:00	0.07416			0	X		0.02											
04/29/22 8:00	0.15486			0	X		0.15											
04/29/22 9:00	0.22194			0	X		0.22											
04/29/22 10:00	0.27762			0	X		0.28											
04/29/22 11:00	0.28104			0	X		0.28											
04/29/22 12:00	0.21612			0	X		0.22											
04/29/22 13:00	0.2805			0	X		0.28											
04/29/22 14:00	0.28008			0	X		0.28											
04/29/22 15:00	0.2772			0	X		0.28											
04/29/22 16:00	0.22446			0	X		0.12											
04/29/22 17:00	0	X		0	X		0											
04/29/22 18:00	0	X		0	X		0											
04/29/22 19:00	0	X		0	X		0											
04/29/22 20:00	0	X		0	X		0											
04/29/22 21:00	0	X		0	X		0											
04/29/22 22:00	0	X		0	X		0											
04/29/22 23:00	0	X		0	X		0											
04/30/22 0:00	0	X		0	X		0											
04/30/22 1:00	0	X		0	X		0											
04/30/22 2:00	0	X		0	X		0											
04/30/22 3:00	0	X		0	X		0											

	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/30/22 4:00	0	X		0	X		0											
04/30/22 5:00	0	X		0	X		0											
04/30/22 6:00	0	X		0	X		0											
04/30/22 7:00	0	X		0	X		0											
04/30/22 8:00	0	X		0	X		0											
04/30/22 9:00	0	X		0	X		0											
04/30/22 10:00	0	X		0	X		0											
04/30/22 11:00	0	X		0	X		0											
04/30/22 12:00	0	X		0	X		0											
04/30/22 13:00	0	X		0	X		0											
04/30/22 14:00	0	X		0	X		0											
04/30/22 15:00	0	X		0	X		0											
04/30/22 16:00	0	X		0	X		0											
04/30/22 17:00	0	X		0	X		0											
04/30/22 18:00	0	X		0	X		0											
04/30/22 19:00	0	X		0	X		0											
04/30/22 20:00	0	X		0	X		0											
04/30/22 21:00	0	X		0	X		0											
04/30/22 22:00	0	X		0	X		0											
04/30/22 23:00	0	X		0	X		0											
05/01/22 0:00	0	X		0	X		0											
05/01/22 1:00	0	X		0	X		0											
05/01/22 2:00	0	X		0	X		0											
05/01/22 3:00	0	X		0	X		0											
05/01/22 4:00	0.12264			0	X		0.05											
05/01/22 5:00	0.2274			0	X		0.23											
05/01/22 6:00	0.19974			0	X		0.2											
05/01/22 7:00	0.18078			0	X		0.18											
05/01/22 8:00	0.17064			0	X		0.17											
05/01/22 9:00	0.16632			0	X		0.17											
05/01/22 10:00	0.16488			0	X		0.16											
05/01/22 11:00	0.16578			0	X		0.17											
05/01/22 12:00	0.16692			0	X		0.17											
05/01/22 13:00	0.1662			0	X		0.17											
05/01/22 14:00	0.16596			0	X		0.17											
05/01/22 15:00	0.16524			0	X		0.17											
05/01/22 16:00	0.16488			0	X		0.16											

	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/01/22 17:00	0.16512			0	X		0.17											
05/01/22 18:00	0.1647			0	X		0.16											
05/01/22 19:00	0.16428			0	X		0.16											
05/01/22 20:00	0.16446			0	X		0.16											
05/01/22 21:00	0.1644			0	X		0.16											
05/01/22 22:00	0.16482			0	X		0.16											
05/01/22 23:00	0.16554			0	X		0.17											
05/02/22 0:00	0.16524			0	X		0.17											
05/02/22 1:00	0.16446			0	X		0.16											
05/02/22 2:00	0.16452			0	X		0.16											
05/02/22 3:00	0.16398			0	X		0.16											
05/02/22 4:00	0.1638			0	X		0.16											
05/02/22 5:00	0.1608			0	X		0.16											
05/02/22 6:00	0.1617			0	X		0.16											
05/02/22 7:00	0.16254			0	X		0.16											
05/02/22 8:00	0.17688			0	X		0.18											
05/02/22 9:00	0.17772			0	X		0.18											
05/02/22 10:00	0.17952			0	X		0.18											
05/02/22 11:00	0.17904			0	X		0.18											
05/02/22 12:00	0.17754			0	X		0.18											
05/02/22 13:00	0.17814			0	X		0.18											
05/02/22 14:00	0.17862			0	X		0.18											
05/02/22 15:00	0.1782			0	X		0.18											
05/02/22 16:00	0.17808			0	X		0.18											
05/02/22 17:00	0.21432			0	X		0.21											
05/02/22 18:00	0.2121			0	X		0.21											
05/02/22 19:00	0.23112			0	X		0.23											
05/02/22 20:00	0.23166			0	X		0.23											
05/02/22 21:00	0.27666			0	X		0.28											
05/02/22 22:00	0.27414			0	X		0.27											
05/02/22 23:00	0.27954			0	X		0.28											
05/03/22 0:00	0.28014			0	X		0.28											
05/03/22 1:00	0.16392			0	X		0.04											
05/03/22 2:00	0	X		0	X		0											
05/03/22 3:00	0	X		0	X		0											
05/03/22 4:00	0	X		0	X		0											
05/03/22 5:00	0	X		0	X		0											

	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/03/22 6:00	0	X		0	X		0											
05/03/22 7:00	0	X		0	X		0											
05/03/22 8:00	0	X		0	X		0											
05/03/22 9:00	0	X		0	X		0											
05/03/22 10:00	0	X		0	X		0											
05/03/22 11:00	0	X		0	X		0											
05/03/22 12:00	0	X		0	X		0											
05/03/22 13:00	0	X		0	X		0											
05/03/22 14:00	0	X		0	X		0											
05/03/22 15:00	0	X		0	X		0											
05/03/22 16:00	0	X		0	X		0											
05/03/22 17:00	0	X		0	X		0											
05/03/22 18:00	0	X		0	X		0											
05/03/22 19:00	0	X		0	X		0											
05/03/22 20:00	0	X		0	X		0											
05/03/22 21:00	0	X		0	X		0											
05/03/22 22:00	0.12258			0	X		0.04											
05/03/22 23:00	0.25782			0.08856			0.28											
05/04/22 0:00	0.20316			0.2163			0.42											
05/04/22 1:00	0.17754			0.18996			0.37											
05/04/22 2:00	0.2463			0.26574			0.51											
05/04/22 3:00	0.26436			0.28542			0.55											
05/04/22 4:00	0.27114			0.2931			0.56											
05/04/22 5:00	0.23592			0.25404			0.49											
05/04/22 6:00	0.23094			0.24738			0.48											
05/04/22 7:00	0.29322			0.31152			0.6											
05/04/22 8:00	0.20094			0.2142			0.42											
05/04/22 9:00	0.17046			0.18114			0.35											
05/04/22 10:00	0.16722			0.17718			0.34											
05/04/22 11:00	0.1707			0.18			0.35											
05/04/22 12:00	0.17412			0.18306			0.36											
05/04/22 13:00	0.17484			0.18348			0.36											
05/04/22 14:00	0.17166			0.18018			0.35											
05/04/22 15:00	0.16692			0.1755			0.34											
05/04/22 16:00	0.16686			0.1755			0.34											
05/04/22 17:00	0.18828			0.19908			0.39											
05/04/22 18:00	0.33216			0.34758			0.68											

	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/04/22 19:00	0.30618			0.33246			0.64											
05/04/22 20:00	0.3015			0.3297			0.63											
05/04/22 21:00	0.32568			0.35382			0.68											
05/04/22 22:00	0.29766			0.32502			0.62											
05/04/22 23:00	0.23604			0.25602			0.49											
05/05/22 0:00	0.21636			0.23232			0.45											
05/05/22 1:00	0.1782			0.1908			0.37											
05/05/22 2:00	0.17382			0.18582			0.36											
05/05/22 3:00	0.17376			0.18588			0.36											
05/05/22 4:00	0.21144			0.22722			0.44											
05/05/22 5:00	0.19824			0.2136			0.41											
05/05/22 6:00	0.16926			0.18126			0.35											
05/05/22 7:00	0.1662			0.1776			0.34											
05/05/22 8:00	0.16752			0.17856			0.35											
05/05/22 9:00	0.17448			0.18612			0.36											
05/05/22 10:00	0.17286			0.18372			0.36											
05/05/22 11:00	0.17058			0.18054			0.35											
05/05/22 12:00	0.22836			0.24468			0.47											
05/05/22 13:00	0.24492			0.26448			0.51											
05/05/22 14:00	0.18336			0.19542			0.38											
05/05/22 15:00	0.17904			0.19104			0.37											
05/05/22 16:00	0.16854			0.17898			0.35											
05/05/22 17:00	0.20394			0.21768			0.42											
05/05/22 18:00	0.28878			0.3078			0.6											
05/05/22 19:00	0.28746			0.3075			0.59											
05/05/22 20:00	0.2871			0.30702			0.59											
05/05/22 21:00	0.2556			0.27372			0.53											
05/05/22 22:00	0.18996			0.20394			0.39											
05/05/22 23:00	0.17202			0.18396			0.36											
05/06/22 0:00	0.17316			0.1848			0.36											
05/06/22 1:00	0.17004			0.18222			0.35											
05/06/22 2:00	0.17352			0.18588			0.36											
05/06/22 3:00	0.18198			0.195			0.38											
05/06/22 4:00	0.28128			0.30258			0.58											
05/06/22 5:00	0.2865			0.30582			0.59											
05/06/22 6:00	0.28614			0.30606			0.59											
05/06/22 7:00	0.2094			0.2244			0.43											

	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/06/22 8:00	0.28266			0.30228			0.58											
05/06/22 9:00	0.28278			0.30174			0.58											
05/06/22 10:00	0.27738			0.29562			0.57											
05/06/22 11:00	0.29112			0.30864			0.6											
05/06/22 12:00	0.25938			0.27696			0.54											
05/06/22 13:00	0.29238			0.30924			0.6											
05/06/22 14:00	0.2244			0.23718			0.46											
05/06/22 15:00	0.1659			0.17526			0.34											
05/06/22 16:00	0.28008			0.30006			0.58											
05/06/22 17:00	0.29346			0.31014			0.6											
05/06/22 18:00	0.28986			0.30762			0.6											
05/06/22 19:00	0.28758			0.30678			0.59											
05/06/22 20:00	0.28746			0.30708			0.59											
05/06/22 21:00	0.28698			0.30654			0.59											
05/06/22 22:00	0.24582			0.2736			0.43											
05/06/22 23:00	0.27864			0	X		0.28											
05/07/22 0:00	0.27852			0	X		0.28											
05/07/22 1:00	0.28692			0	X		0.29											
05/07/22 2:00	0.29604			0	X		0.3											
05/07/22 3:00	0.29556			0	X		0.3											
05/07/22 4:00	0.29532			0	X		0.3											
05/07/22 5:00	0.29484			0	X		0.29											
05/07/22 6:00	0.2952			0	X		0.3											
05/07/22 7:00	0.29634			0	X		0.3											
05/07/22 8:00	0.29358			0	X		0.29											
05/07/22 9:00	0.29556			0	X		0.3											
05/07/22 10:00	0.2949			0	X		0.29											
05/07/22 11:00	0.29622			0	X		0.3											
05/07/22 12:00	0.28092			0.11112			0.31											
05/07/22 13:00	0.17706			0.1887			0.37											
05/07/22 14:00	0.1662			0.17562			0.34											
05/07/22 15:00	0.16506			0.17478			0.34											
05/07/22 16:00	0.16518			0.17502			0.34											
05/07/22 17:00	0.17304			0.18378			0.36											
05/07/22 18:00	0.28086			0.3087			0.59											
05/07/22 19:00	0.28734			0.31158			0.6											
05/07/22 20:00	0.27882			0.3021			0.58											

	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/07/22 21:00	0.17328			0.18564			0.36											
05/07/22 22:00	0.16536			0.17694			0.34											
05/07/22 23:00	0.16542			0.17748			0.34											
05/08/22 0:00	0.1653			0.1776			0.34											
05/08/22 1:00	0.16536			0.17796			0.34											
05/08/22 2:00	0.16566			0.17802			0.34											
05/08/22 3:00	0.16578			0.17832			0.34											
05/08/22 4:00	0.16956			0.18246			0.35											
05/08/22 5:00	0.16668			0.1794			0.35											
05/08/22 6:00	0.11466			0.19998			0.21											
05/08/22 7:00	0	X		0.1911			0.19											
05/08/22 8:00	0	X		0.19134			0.19											
05/08/22 9:00	0	X		0.19134			0.19											
05/08/22 10:00	0	X		0.19122			0.19											
05/08/22 11:00	0	X		0.19116			0.19											
05/08/22 12:00	0	X		0.19074			0.19											
05/08/22 13:00	0	X		0.18894			0.19											
05/08/22 14:00	0	X		0.18822			0.19											
05/08/22 15:00	0	X		0.19026			0.19											
05/08/22 16:00	0	X		0.22668			0.23											
05/08/22 17:00	0.15984			0.2526			0.36											
05/08/22 18:00	0.19104			0.20478			0.4											
05/08/22 19:00	0.28926			0.30846			0.6											
05/08/22 20:00	0.29118			0.30576			0.6											
05/08/22 21:00	0.28632			0.30342			0.59											
05/08/22 22:00	0.17892			0.19236			0.37											
05/08/22 23:00	0.16584			0.1785			0.34											
05/09/22 0:00	0.16656			0.17904			0.35											
05/09/22 1:00	0.16632			0.17898			0.35											
05/09/22 2:00	0.16632			0.17934			0.35											
05/09/22 3:00	0.16668			0.17922			0.35											
05/09/22 4:00	0.16734			0.18			0.35											
05/09/22 5:00	0.16944			0.18246			0.35											
05/09/22 6:00	0.16572			0.17838			0.34											
05/09/22 7:00	0.1659			0.17802			0.34											
05/09/22 8:00	0.1656			0.1779			0.34											
05/09/22 9:00	0.16566			0.17772			0.34											

	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/09/22 10:00	0.16554			0.17826			0.34											
05/09/22 11:00	0.09126			0.20484			0.21											
05/09/22 12:00	0	X		0.1902			0.19											
05/09/22 13:00	0	X		0.18834			0.19											
05/09/22 14:00	0	X		0.1896			0.19											
05/09/22 15:00	0	X		0.19146			0.19											
05/09/22 16:00	0	X		0.19032			0.19											
05/09/22 17:00	0	X		0.1899			0.19											
05/09/22 18:00	0	X		0.19188			0.19											
05/09/22 19:00	0	X		0.19302			0.19											
05/09/22 20:00	0	X		0.1926			0.19											
05/09/22 21:00	0	X		0.19242			0.19											
05/09/22 22:00	0	X		0.19218			0.19											
05/09/22 23:00	0	X		0.10512			0.01											
05/10/22 0:00	0	X		0	X		0											
05/10/22 1:00	0	X		0	X		0											
05/10/22 2:00	0	X		0	X		0											
05/10/22 3:00	0	X		0	X		0											
05/10/22 4:00	0	X		0	X		0											
05/10/22 5:00	0	X		0	X		0											
05/10/22 6:00	0	X		0	X		0											
05/10/22 7:00	0	X		0	X		0											
05/10/22 8:00	0	X		0	X		0											
05/10/22 9:00	0	X		0	X		0											
05/10/22 10:00	0	X		0	X		0											
05/10/22 11:00	0	X		0	X		0											
05/10/22 12:00	0	X		0	X		0											
05/10/22 13:00	0	X		0	X		0											
05/10/22 14:00	0	X		0	X		0											
05/10/22 15:00	0	X		0	X		0											
05/10/22 16:00	0	X		0	X		0											
05/10/22 17:00	0	X		0	X		0											
05/10/22 18:00	0	X		0	X		0											
05/10/22 19:00	0	X		0	X		0											
05/10/22 20:00	0	X		0	X		0											
05/10/22 21:00	0	X		0	X		0											
05/10/22 22:00	0	X		0	X		0											

	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/10/22 23:00	0	X		0	X		0											
05/11/22 0:00	0	X		0	X		0											
05/11/22 1:00	0	X		0	X		0											
05/11/22 2:00	0	X		0	X		0											
05/11/22 3:00	0	X		0	X		0											
05/11/22 4:00	0	X		0	X		0											
05/11/22 5:00	0	X		0	X		0											
05/11/22 6:00	0	X		0	X		0											
05/11/22 7:00	0	X		0	X		0											
05/11/22 8:00	0	X		0	X		0											
05/11/22 9:00	0	X		0	X		0											
05/11/22 10:00	0	X		0	X		0											
05/11/22 11:00	0	X		0	X		0											
05/11/22 12:00	0	X		0	X		0											
05/11/22 13:00	0	X		0	X		0											
05/11/22 14:00	0	X		0	X		0											
05/11/22 15:00	0	X		0	X		0											
05/11/22 16:00	0	X		0	X		0											
05/11/22 17:00	0	X		0	X		0											
05/11/22 18:00	0	X		0	X		0											
05/11/22 19:00	0	X		0	X		0											
05/11/22 20:00	0	X		0	X		0											
05/11/22 21:00	0	X		0	X		0											
05/11/22 22:00	0	X		0	X		0											
05/11/22 23:00	0	X		0	X		0											
05/12/22 0:00	0	X		0	X		0											
05/12/22 1:00	0	X		0	X		0											
05/12/22 2:00	0	X		0	X		0											
05/12/22 3:00	0	X		0	X		0											
05/12/22 4:00	0	X		0	X		0											
05/12/22 5:00	0	X		0	X		0											
05/12/22 6:00	0	X		0	X		0											
05/12/22 7:00	0	X		0	X		0											
05/12/22 8:00	0	X		0	X		0											
05/12/22 9:00	0	X		0	X		0											
05/12/22 10:00	0	X		0	X		0											
05/12/22 11:00	0	X		0	X		0											

	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/12/22 12:00	0	X		0	X		0											
05/12/22 13:00	0	X		0	X		0											
05/12/22 14:00	0	X		0	X		0											
05/12/22 15:00	0	X		0	X		0											
05/12/22 16:00	0	X		0	X		0											
05/12/22 17:00	0	X		0	X		0											
05/12/22 18:00	0	X		0	X		0											
05/12/22 19:00	0	X		0	X		0											
05/12/22 20:00	0	X		0	X		0											
05/12/22 21:00	0	X		0	X		0											
05/12/22 22:00	0	X		0	X		0											
05/12/22 23:00	0	X		0	X		0											
05/13/22 0:00	0	X		0	X		0											
05/13/22 1:00	0	X		0	X		0											
05/13/22 2:00	0	X		0	X		0											
05/13/22 3:00	0	X		0	X		0											
05/13/22 4:00	0	X		0	X		0											
05/13/22 5:00	0	X		0	X		0											
05/13/22 6:00	0	X		0	X		0											
05/13/22 7:00	0	X		0	X		0											
05/13/22 8:00	0	X		0	X		0											
05/13/22 9:00	0	X		0	X		0											
05/13/22 10:00	0	X		0	X		0											
05/13/22 11:00	0	X		0	X		0											
05/13/22 12:00	0	X		0	X		0											
05/13/22 13:00	0	X		0	X		0											
05/13/22 14:00	0	X		0	X		0											
05/13/22 15:00	0	X		0	X		0											
05/13/22 16:00	0	X		0	X		0											
05/13/22 17:00	0	X		0	X		0											
05/13/22 18:00	0	X		0	X		0											
05/13/22 19:00	0	X		0	X		0											
05/13/22 20:00	0	X		0	X		0											
05/13/22 21:00	0	X		0	X		0											
05/13/22 22:00	0	X		0	X		0											
05/13/22 23:00	0	X		0	X		0											
05/14/22 0:00	0	X		0	X		0											

	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/14/22 1:00	0	X		0	X		0											
05/14/22 2:00	0	X		0	X		0											
05/14/22 3:00	0	X		0	X		0											
05/14/22 4:00	0	X		0	X		0											
05/14/22 5:00	0	X		0	X		0											
05/14/22 6:00	0	X		0	X		0											
05/14/22 7:00	0	X		0	X		0											
05/14/22 8:00	0	X		0	X		0											
05/14/22 9:00	0	X		0	X		0											
05/14/22 10:00	0	X		0	X		0											
05/14/22 11:00	0	X		0	X		0											
05/14/22 12:00	0	X		0	X		0											
05/14/22 13:00	0	X		0	X		0											
05/14/22 14:00	0	X		0	X		0											
05/14/22 15:00	0	X		0	X		0											
05/14/22 16:00	0	X		0	X		0											
05/14/22 17:00	0	X		0	X		0											
05/14/22 18:00	0	X		0	X		0											
05/14/22 19:00	0	X		0	X		0											
05/14/22 20:00	0	X		0	X		0											
05/14/22 21:00	0	X		0	X		0											
05/14/22 22:00	0	X		0	X		0											
05/14/22 23:00	0	X		0	X		0											
05/15/22 0:00	0	X		0	X		0											
05/15/22 1:00	0	X		0	X		0											
05/15/22 2:00	0	X		0	X		0											
05/15/22 3:00	0	X		0	X		0											
05/15/22 4:00	0	X		0	X		0											
05/15/22 5:00	0	X		0	X		0											
05/15/22 6:00	0	X		0	X		0											
05/15/22 7:00	0	X		0	X		0											
05/15/22 8:00	0	X		0	X		0											
05/15/22 9:00	0	X		0	X		0											
05/15/22 10:00	0	X		0	X		0											
05/15/22 11:00	0	X		0	X		0											
05/15/22 12:00	0	X		0	X		0											
05/15/22 13:00	0	X		0	X		0											

	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/15/22 14:00	0	X		0	X		0											
05/15/22 15:00	0	X		0	X		0											
05/15/22 16:00	0	X		0	X		0											
05/15/22 17:00	0	X		0	X		0											
05/15/22 18:00	0	X		0	X		0											
05/15/22 19:00	0	X		0	X		0											
05/15/22 20:00	0	X		0	X		0											
05/15/22 21:00	0	X		0	X		0											
05/15/22 22:00	0	X		0	X		0											
05/15/22 23:00	0	X		0	X		0											
05/16/22 0:00	0	X		0	X		0											
05/16/22 1:00	0	X		0	X		0											
05/16/22 2:00	0	X		0	X		0											
05/16/22 3:00	0	X		0	X		0											
05/16/22 4:00	0	X		0	X		0											
05/16/22 5:00	0	X		0	X		0											
05/16/22 6:00	0	X		0	X		0											
05/16/22 7:00	0	X		0	X		0											
05/16/22 8:00	0	X		0	X		0											
05/16/22 9:00	0	X		0	X		0											
05/16/22 10:00	0	X		0	X		0											
05/16/22 11:00	0	X		0	X		0											
05/16/22 12:00	0	X		0	X		0											
05/16/22 13:00	0	X		0	X		0											
05/16/22 14:00	0	X		0	X		0											
05/16/22 15:00	0	X		0	X		0											
05/16/22 16:00	0	X		0	X		0											
05/16/22 17:00	0	X		0	X		0											
05/16/22 18:00	0	X		0	X		0											
05/16/22 19:00	0	X		0	X		0											
05/16/22 20:00	0	X		0	X		0											
05/16/22 21:00	0	X		0	X		0											
05/16/22 22:00	0	X		0	X		0											
05/16/22 23:00	0	X		0	X		0											
05/17/22 0:00	0	X		0	X		0											
05/17/22 1:00	0	X		0	X		0											
05/17/22 2:00	0	X		0	X		0											

	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/17/22 3:00	0	X		0	X		0											
05/17/22 4:00	0	X		0	X		0											
05/17/22 5:00	0	X		0	X		0											
05/17/22 6:00	0	X		0	X		0											
05/17/22 7:00	0	X		0	X		0											
05/17/22 8:00	0	X		0	X		0											
05/17/22 9:00	0	X		0	X		0											
05/17/22 10:00	0	X		0	X		0											
05/17/22 11:00	0	X		0	X		0											
05/17/22 12:00	0	X		0	X		0											
05/17/22 13:00	0	X		0	X		0											
05/17/22 14:00	0	X		0	X		0											
05/17/22 15:00	0.17214			0	X		0.11											
05/17/22 16:00	0.25908			0	X		0.26											
05/17/22 17:00	0.26448			0.16794			0.37											
05/17/22 18:00	0.2685			0.28452			0.55											
05/17/22 19:00	0.28338			0.3066			0.59											
05/17/22 20:00	0.31182			0.3285			0.64											
05/17/22 21:00	0.31926			0.33708			0.66											
05/17/22 22:00	0.26472			0.28254			0.55											
05/17/22 23:00	0.16374			0.17466			0.34											
05/18/22 0:00	0.16392			0.17538			0.34											
05/18/22 1:00	0.16248			0.17418			0.34											
05/18/22 2:00	0.21906			0.23532			0.45											
05/18/22 3:00	0.3552			0.37494			0.73											
05/18/22 4:00	0.40452			0.42444			0.83											
05/18/22 5:00	0.29862			0.31932			0.62											
05/18/22 6:00	0.22764			0.24372			0.47											
05/18/22 7:00	0.2622			0.27978			0.54											
05/18/22 8:00	0.28026			0.29898			0.58											
05/18/22 9:00	0.2799			0.29736			0.58											
05/18/22 10:00	0.2805			0.29718			0.58											
05/18/22 11:00	0.3531			0.36768			0.72											
05/18/22 12:00	0.28152			0.29538			0.58											
05/18/22 13:00	0.32778			0.34104			0.67											
05/18/22 14:00	0.38064			0.39366			0.77											
05/18/22 15:00	0.3399			0.35424			0.69											

	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/18/22 16:00	0.30798			0.32274			0.63											
05/18/22 17:00	0.36846			0.38244			0.75											
05/18/22 18:00	0.34728			0.36288			0.71											
05/18/22 19:00	0.33588			0.35196			0.69											
05/18/22 20:00	0.3645			0.3807			0.75											
05/18/22 21:00	0.30438			0.32082			0.63											
05/18/22 22:00	0.30204			0.3192			0.62											
05/18/22 23:00	0.24558			0.26166			0.51											
05/19/22 0:00	0.15288			0.22446			0.28											
05/19/22 1:00	0	X		0.21234			0.21											
05/19/22 2:00	0	X		0.19044			0.19											
05/19/22 3:00	0	X		0.26478			0.26											
05/19/22 4:00	0	X		0.30402			0.3											
05/19/22 5:00	0	X		0.30834			0.31											
05/19/22 6:00	0	X		0.22284			0.22											
05/19/22 7:00	0	X		0.2163			0.22											
05/19/22 8:00	0	X		0.21834			0.22											
05/19/22 9:00	0	X		0.19008			0.19											
05/19/22 10:00	0	X		0.18852			0.19											
05/19/22 11:00	0	X		0.29208			0.29											
05/19/22 12:00	0.1491			0.26172			0.35											
05/19/22 13:00	0.2337			0.24774			0.48											
05/19/22 14:00	0.31266			0.3279			0.64											
05/19/22 15:00	0.24336			0.25752			0.5											
05/19/22 16:00	0.23256			0.24588			0.48											
05/19/22 17:00	0.2988			0.31512			0.61											
05/19/22 18:00	0.30762			0.32496			0.63											
05/19/22 19:00	0.31704			0.3354			0.65											
05/19/22 20:00	0.34302			0.36222			0.71											
05/19/22 21:00	0.30444			0.32448			0.63											
05/19/22 22:00	0.24198			0.26448			0.46											
05/19/22 23:00	0	X		0.1467			0.02											
05/20/22 0:00	0	X		0	X		0											
05/20/22 1:00	0	X		0	X		0											
05/20/22 2:00	0	X		0	X		0											
05/20/22 3:00	0	X		0	X		0											
05/20/22 4:00	0	X		0	X		0											

	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/20/22 5:00	0	X		0	X		0											
05/20/22 6:00	0	X		0	X		0											
05/20/22 7:00	0	X		0	X		0											
05/20/22 8:00	0	X		0	X		0											
05/20/22 9:00	0	X		0	X		0											
05/20/22 10:00	0	X		0	X		0											
05/20/22 11:00	0	X		0	X		0											
05/20/22 12:00	0	X		0	X		0											
05/20/22 13:00	0	X		0	X		0											
05/20/22 14:00	0	X		0	X		0											
05/20/22 15:00	0	X		0	X		0											
05/20/22 16:00	0	X		0	X		0											
05/20/22 17:00	0	X		0	X		0											
05/20/22 18:00	0	X		0	X		0											
05/20/22 19:00	0	X		0	X		0											
05/20/22 20:00	0	X		0	X		0											
05/20/22 21:00	0	X		0	X		0											
05/20/22 22:00	0	X		0	X		0											
05/20/22 23:00	0	X		0	X		0											
05/21/22 0:00	0	X		0	X		0											
05/21/22 1:00	0	X		0	X		0											
05/21/22 2:00	0	X		0	X		0											
05/21/22 3:00	0	X		0	X		0											
05/21/22 4:00	0	X		0	X		0											
05/21/22 5:00	0	X		0	X		0											
05/21/22 6:00	0	X		0	X		0											
05/21/22 7:00	0	X		0	X		0											
05/21/22 8:00	0	X		0	X		0											
05/21/22 9:00	0	X		0	X		0											
05/21/22 10:00	0	X		0	X		0											
05/21/22 11:00	0	X		0	X		0											
05/21/22 12:00	0	X		0	X		0											
05/21/22 13:00	0	X		0	X		0											
05/21/22 14:00	0	X		0	X		0											
05/21/22 15:00	0	X		0	X		0											
05/21/22 16:00	0	X		0	X		0											
05/21/22 17:00	0	X		0	X		0											

	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/21/22 18:00	0	X		0	X		0											
05/21/22 19:00	0	X		0	X		0											
05/21/22 20:00	0	X		0	X		0											
05/21/22 21:00	0	X		0	X		0											
05/21/22 22:00	0	X		0	X		0											
05/21/22 23:00	0	X		0	X		0											
05/22/22 0:00	0	X		0	X		0											
05/22/22 1:00	0	X		0	X		0											
05/22/22 2:00	0	X		0	X		0											
05/22/22 3:00	0	X		0	X		0											
05/22/22 4:00	0	X		0	X		0											
05/22/22 5:00	0	X		0	X		0											
05/22/22 6:00	0	X		0	X		0											
05/22/22 7:00	0	X		0	X		0											
05/22/22 8:00	0	X		0	X		0											
05/22/22 9:00	0	X		0	X		0											
05/22/22 10:00	0	X		0	X		0											
05/22/22 11:00	0	X		0	X		0											
05/22/22 12:00	0	X		0	X		0											
05/22/22 13:00	0	X		0	X		0											
05/22/22 14:00	0	X		0	X		0											
05/22/22 15:00	0	X		0	X		0											
05/22/22 16:00	0	X		0	X		0											
05/22/22 17:00	0	X		0	X		0											
05/22/22 18:00	0	X		0	X		0											
05/22/22 19:00	0	X		0	X		0											
05/22/22 20:00	0	X		0	X		0											
05/22/22 21:00	0	X		0	X		0											
05/22/22 22:00	0	X		0	X		0											
05/22/22 23:00	0	X		0	X		0											
05/23/22 0:00	0	X		0	X		0											
05/23/22 1:00	0	X		0	X		0											
05/23/22 2:00	0	X		0	X		0											
05/23/22 3:00	0	X		0	X		0											
05/23/22 4:00	0	X		0	X		0											
05/23/22 5:00	0	X		0	X		0											
05/23/22 6:00	0	X		0	X		0											

	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/23/22 7:00	0	X		0	X		0											
05/23/22 8:00	0	X		0	X		0											
05/23/22 9:00	0	X		0	X		0											
05/23/22 10:00	0	X		0	X		0											
05/23/22 11:00	0	X		0	X		0											
05/23/22 12:00	0	X		0	X		0											
05/23/22 13:00	0	X		0	X		0											
05/23/22 14:00	0	X		0	X		0											
05/23/22 15:00	0	X		0	X		0											
05/23/22 16:00	0	X		0	X		0											
05/23/22 17:00	0	X		0	X		0											
05/23/22 18:00	0	X		0	X		0											
05/23/22 19:00	0	X		0	X		0											
05/23/22 20:00	0	X		0	X		0											
05/23/22 21:00	0	X		0	X		0											
05/23/22 22:00	0	X		0	X		0											
05/23/22 23:00	0	X		0	X		0											
05/24/22 0:00	0	X		0	X		0											
05/24/22 1:00	0	X		0	X		0											
05/24/22 2:00	0	X		0	X		0											
05/24/22 3:00	0	X		0.1194			0.04											
05/24/22 4:00	0	X		0.1872			0.19											
05/24/22 5:00	0	X		0.19614			0.2											
05/24/22 6:00	0	X		0.19338			0.19											
05/24/22 7:00	0	X		0.25482			0.25											
05/24/22 8:00	0.16344			0.24918			0.38											
05/24/22 9:00	0.17376			0.18426			0.36											
05/24/22 10:00	0.21768			0.23172			0.45											
05/24/22 11:00	0.23562			0.25062			0.49											
05/24/22 12:00	0.2721			0.2877			0.56											
05/24/22 13:00	0.3201			0.33384			0.65											
05/24/22 14:00	0.36882			0.38142			0.75											
05/24/22 15:00	0.39396			0.40602			0.8											
05/24/22 16:00	0.37056			0.3837			0.75											
05/24/22 17:00	0.34506			0.35886			0.7											
05/24/22 18:00	0.39222			0.4056			0.8											
05/24/22 19:00	0.37698			0.39144			0.77											

	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/24/22 20:00	0.32868			0.34506			0.67											
05/24/22 21:00	0.31956			0.33612			0.66											
05/24/22 22:00	0.3444			0.3615			0.71											
05/24/22 23:00	0.23604			0.2514			0.49											
05/25/22 0:00	0.2337			0.25056			0.48											
05/25/22 1:00	0.18978			0.20226			0.39											
05/25/22 2:00	0.1734			0.18534			0.36											
05/25/22 3:00	0.23202			0.24852			0.48											
05/25/22 4:00	0.29184			0.31116			0.6											
05/25/22 5:00	0.27144			0.29046			0.56											
05/25/22 6:00	0.2922			0.31032			0.6											
05/25/22 7:00	0.22992			0.24384			0.47											
05/25/22 8:00	0.16602			0.17562			0.34											
05/25/22 9:00	0.21912			0.23364			0.45											
05/25/22 10:00	0.27336			0.2892			0.56											
05/25/22 11:00	0.38112			0.39408			0.78											
05/25/22 12:00	0.39936			0.41082			0.81											
05/25/22 13:00	0.39858			0.4095			0.81											
05/25/22 14:00	0.39786			0.40908			0.81											
05/25/22 15:00	0.39642			0.40806			0.8											
05/25/22 16:00	0.39618			0.4077			0.8											
05/25/22 17:00	0.39144			0.40302			0.79											
05/25/22 18:00	0.39276			0.40554			0.8											
05/25/22 19:00	0.33678			0.35142			0.69											
05/25/22 20:00	0.30354			0.31908			0.62											
05/25/22 21:00	0.309			0.3264			0.64											
05/25/22 22:00	0.2247			0.24486			0.47											
05/25/22 23:00	0.04308			0.16128			0.06											
05/26/22 0:00	0	X		0	X		0											
05/26/22 1:00	0	X		0	X		0											
05/26/22 2:00	0	X		0	X		0											
05/26/22 3:00	0	X		0	X		0											
05/26/22 4:00	0	X		0	X		0											
05/26/22 5:00	0	X		0	X		0											
05/26/22 6:00	0	X		0	X		0											
05/26/22 7:00	0	X		0	X		0											
05/26/22 8:00	0	X		0	X		0											

	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/26/22 9:00	0	X		0	X		0											
05/26/22 10:00	0	X		0	X		0											
05/26/22 11:00	0.11862			0	X		0.04											
05/26/22 12:00	0.18072			0	X		0.18											
05/26/22 13:00	0.16938			0	X		0.17											
05/26/22 14:00	0.23064			0.03636			0.24											
05/26/22 15:00	0.28428			0	X		0.28											
05/26/22 16:00	0.28488			0	X		0.28											
05/26/22 17:00	0.28548			0	X		0.29											
05/26/22 18:00	0.28644			0	X		0.29											
05/26/22 19:00	0.28692			0	X		0.29											
05/26/22 20:00	0.21906			0	X		0.1											
05/26/22 21:00	0	X		0	X		0											
05/26/22 22:00	0	X		0	X		0											
05/26/22 23:00	0	X		0	X		0											
05/27/22 0:00	0	X		0	X		0											
05/27/22 1:00	0	X		0	X		0											
05/27/22 2:00	0	X		0	X		0											
05/27/22 3:00	0	X		0	X		0											
05/27/22 4:00	0	X		0	X		0											
05/27/22 5:00	0	X		0	X		0											
05/27/22 6:00	0	X		0	X		0											
05/27/22 7:00	0	X		0	X		0											
05/27/22 8:00	0	X		0	X		0											
05/27/22 9:00	0	X		0	X		0											
05/27/22 10:00	0	X		0	X		0											
05/27/22 11:00	0	X		0	X		0											
05/27/22 12:00	0	X		0	X		0											
05/27/22 13:00	0	X		0	X		0											
05/27/22 14:00	0	X		0	X		0											
05/27/22 15:00	0	X		0	X		0											
05/27/22 16:00	0	X		0	X		0											
05/27/22 17:00	0	X		0	X		0											
05/27/22 18:00	0	X		0	X		0											
05/27/22 19:00	0	X		0	X		0											
05/27/22 20:00	0	X		0	X		0											
05/27/22 21:00	0	X		0	X		0											

	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/27/22 22:00	0	X		0	X		0											
05/27/22 23:00	0	X		0	X		0											
05/28/22 0:00	0	X		0	X		0											
05/28/22 1:00	0	X		0	X		0											
05/28/22 2:00	0	X		0	X		0											
05/28/22 3:00	0	X		0	X		0											
05/28/22 4:00	0	X		0	X		0											
05/28/22 5:00	0	X		0	X		0											
05/28/22 6:00	0	X		0	X		0											
05/28/22 7:00	0	X		0	X		0											
05/28/22 8:00	0	X		0	X		0											
05/28/22 9:00	0	X		0	X		0											
05/28/22 10:00	0	X		0	X		0											
05/28/22 11:00	0	X		0	X		0											
05/28/22 12:00	0	X		0	X		0											
05/28/22 13:00	0	X		0	X		0											
05/28/22 14:00	0	X		0	X		0											
05/28/22 15:00	0	X		0	X		0											
05/28/22 16:00	0	X		0	X		0											
05/28/22 17:00	0	X		0	X		0											
05/28/22 18:00	0	X		0	X		0											
05/28/22 19:00	0	X		0	X		0											
05/28/22 20:00	0	X		0	X		0											
05/28/22 21:00	0	X		0	X		0											
05/28/22 22:00	0	X		0	X		0											
05/28/22 23:00	0	X		0	X		0											
05/29/22 0:00	0	X		0	X		0											
05/29/22 1:00	0	X		0	X		0											
05/29/22 2:00	0	X		0	X		0											
05/29/22 3:00	0	X		0	X		0											
05/29/22 4:00	0	X		0	X		0											
05/29/22 5:00	0	X		0	X		0											
05/29/22 6:00	0	X		0	X		0											
05/29/22 7:00	0	X		0	X		0											
05/29/22 8:00	0	X		0	X		0											
05/29/22 9:00	0	X		0	X		0											
05/29/22 10:00	0	X		0	X		0											

	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/29/22 11:00	0	X		0	X		0											
05/29/22 12:00	0	X		0	X		0											
05/29/22 13:00	0	X		0	X		0											
05/29/22 14:00	0	X		0	X		0											
05/29/22 15:00	0	X		0	X		0											
05/29/22 16:00	0	X		0	X		0											
05/29/22 17:00	0	X		0	X		0											
05/29/22 18:00	0	X		0	X		0											
05/29/22 19:00	0	X		0	X		0											
05/29/22 20:00	0	X		0	X		0											
05/29/22 21:00	0	X		0	X		0											
05/29/22 22:00	0	X		0	X		0											
05/29/22 23:00	0	X		0	X		0											
05/30/22 0:00	0	X		0	X		0											
05/30/22 1:00	0	X		0	X		0											
05/30/22 2:00	0	X		0	X		0											
05/30/22 3:00	0	X		0	X		0											
05/30/22 4:00	0	X		0	X		0											
05/30/22 5:00	0	X		0	X		0											
05/30/22 6:00	0	X		0	X		0											
05/30/22 7:00	0	X		0	X		0											
05/30/22 8:00	0	X		0	X		0											
05/30/22 9:00	0	X		0	X		0											
05/30/22 10:00	0	X		0	X		0											
05/30/22 11:00	0	X		0	X		0											
05/30/22 12:00	0	X		0	X		0											
05/30/22 13:00	0	X		0	X		0											
05/30/22 14:00	0	X		0	X		0											
05/30/22 15:00	0	X		0	X		0											
05/30/22 16:00	0	X		0	X		0											
05/30/22 17:00	0	X		0	X		0											
05/30/22 18:00	0	X		0	X		0											
05/30/22 19:00	0	X		0	X		0											
05/30/22 20:00	0	X		0	X		0											
05/30/22 21:00	0	X		0	X		0											
05/30/22 22:00	0	X		0	X		0											
05/30/22 23:00	0	X		0	X		0											

	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/31/22 0:00	0	X		0	X		0											
05/31/22 1:00	0	X		0	X		0											
05/31/22 2:00	0	X		0	X		0											
05/31/22 3:00	0	X		0	X		0											
05/31/22 4:00	0	X		0	X		0											
05/31/22 5:00	0	X		0	X		0											
05/31/22 6:00	0	X		0	X		0											
05/31/22 7:00	0	X		0	X		0											
05/31/22 8:00	0	X		0	X		0											
05/31/22 9:00	0	X		0	X		0											
05/31/22 10:00	0	X		0	X		0											
05/31/22 11:00	0	X		0	X		0											
05/31/22 12:00	0	X		0	X		0											
05/31/22 13:00	0	X		0	X		0											
05/31/22 14:00	0	X		0	X		0											
05/31/22 15:00	0	X		0	X		0											
05/31/22 16:00	0	X		0	X		0											
05/31/22 17:00	0	X		0	X		0											
05/31/22 18:00	0	X		0	X		0											
05/31/22 19:00	0	X		0	X		0											
05/31/22 20:00	0	X		0	X		0											
05/31/22 21:00	0	X		0	X		0											
05/31/22 22:00	0	X		0	X		0											
05/31/22 23:00	0	X		0	X		0											
06/01/22 0:00	0	X		0	X		0											
06/01/22 1:00	0	X		0	X		0											
06/01/22 2:00	0	X		0	X		0											
06/01/22 3:00	0	X		0	X		0											
06/01/22 4:00	0	X		0	X		0											
06/01/22 5:00	0	X		0	X		0											
06/01/22 6:00	0	X		0	X		0											
06/01/22 7:00	0	X		0	X		0											
06/01/22 8:00	0	X		0	X		0											
06/01/22 9:00	0	X		0	X		0											
06/01/22 10:00	0	X		0	X		0											
06/01/22 11:00	0	X		0	X		0											
06/01/22 12:00	0	X		0	X		0											

	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/01/22 13:00	0	X		0	X		0											
06/01/22 14:00	0	X		0	X		0											
06/01/22 15:00	0	X		0	X		0											
06/01/22 16:00	0	X		0	X		0											
06/01/22 17:00	0	X		0	X		0											
06/01/22 18:00	0	X		0	X		0											
06/01/22 19:00	0	X		0	X		0											
06/01/22 20:00	0	X		0	X		0											
06/01/22 21:00	0	X		0	X		0											
06/01/22 22:00	0	X		0	X		0											
06/01/22 23:00	0	X		0	X		0											
06/02/22 0:00	0	X		0	X		0											
06/02/22 1:00	0	X		0	X		0											
06/02/22 2:00	0	X		0	X		0											
06/02/22 3:00	0	X		0	X		0											
06/02/22 4:00	0	X		0	X		0											
06/02/22 5:00	0	X		0	X		0											
06/02/22 6:00	0	X		0	X		0											
06/02/22 7:00	0	X		0	X		0											
06/02/22 8:00	0	X		0	X		0											
06/02/22 9:00	0	X		0	X		0											
06/02/22 10:00	0	X		0	X		0											
06/02/22 11:00	0	X		0	X		0											
06/02/22 12:00	0	X		0	X		0											
06/02/22 13:00	0	X		0	X		0											
06/02/22 14:00	0	X		0	X		0											
06/02/22 15:00	0	X		0	X		0											
06/02/22 16:00	0	X		0	X		0											
06/02/22 17:00	0	X		0	X		0											
06/02/22 18:00	0	X		0	X		0											
06/02/22 19:00	0	X		0	X		0											
06/02/22 20:00	0	X		0	X		0											
06/02/22 21:00	0	X		0	X		0											
06/02/22 22:00	0	X		0	X		0											
06/02/22 23:00	0	X		0	X		0											
06/03/22 0:00	0	X		0	X		0											
06/03/22 1:00	0	X		0	X		0											

	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/03/22 2:00	0	X		0	X		0											
06/03/22 3:00	0	X		0	X		0											
06/03/22 4:00	0	X		0	X		0											
06/03/22 5:00	0	X		0	X		0											
06/03/22 6:00	0	X		0	X		0											
06/03/22 7:00	0	X		0	X		0											
06/03/22 8:00	0	X		0	X		0											
06/03/22 9:00	0	X		0	X		0											
06/03/22 10:00	0	X		0	X		0											
06/03/22 11:00	0	X		0	X		0											
06/03/22 12:00	0	X		0	X		0											
06/03/22 13:00	0	X		0	X		0											
06/03/22 14:00	0	X		0	X		0											
06/03/22 15:00	0	X		0	X		0											
06/03/22 16:00	0	X		0	X		0											
06/03/22 17:00	0	X		0	X		0											
06/03/22 18:00	0	X		0	X		0											
06/03/22 19:00	0	X		0	X		0											
06/03/22 20:00	0	X		0	X		0											
06/03/22 21:00	0	X		0	X		0											
06/03/22 22:00	0	X		0	X		0											
06/03/22 23:00	0	X		0	X		0											
06/04/22 0:00	0	X		0	X		0											
06/04/22 1:00	0	X		0	X		0											
06/04/22 2:00	0	X		0	X		0											
06/04/22 3:00	0	X		0	X		0											
06/04/22 4:00	0	X		0	X		0											
06/04/22 5:00	0	X		0	X		0											
06/04/22 6:00	0	X		0	X		0											
06/04/22 7:00	0	X		0	X		0											
06/04/22 8:00	0	X		0	X		0											
06/04/22 9:00	0	X		0	X		0											
06/04/22 10:00	0	X		0	X		0											
06/04/22 11:00	0	X		0	X		0											
06/04/22 12:00	0	X		0	X		0											
06/04/22 13:00	0	X		0	X		0											
06/04/22 14:00	0	X		0	X		0											

	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/04/22 15:00	0	X		0	X		0											
06/04/22 16:00	0	X		0	X		0											
06/04/22 17:00	0	X		0	X		0											
06/04/22 18:00	0	X		0	X		0											
06/04/22 19:00	0	X		0	X		0											
06/04/22 20:00	0	X		0	X		0											
06/04/22 21:00	0	X		0	X		0											
06/04/22 22:00	0	X		0	X		0											
06/04/22 23:00	0	X		0	X		0											
06/05/22 0:00	0	X		0	X		0											
06/05/22 1:00	0	X		0	X		0											
06/05/22 2:00	0	X		0	X		0											
06/05/22 3:00	0	X		0	X		0											
06/05/22 4:00	0	X		0	X		0											
06/05/22 5:00	0	X		0	X		0											
06/05/22 6:00	0	X		0	X		0											
06/05/22 7:00	0	X		0	X		0											
06/05/22 8:00	0	X		0	X		0											
06/05/22 9:00	0	X		0	X		0											
06/05/22 10:00	0	X		0	X		0											
06/05/22 11:00	0	X		0	X		0											
06/05/22 12:00	0	X		0	X		0											
06/05/22 13:00	0	X		0	X		0											
06/05/22 14:00	0	X		0	X		0											
06/05/22 15:00	0	X		0	X		0											
06/05/22 16:00	0	X		0	X		0											
06/05/22 17:00	0	X		0	X		0											
06/05/22 18:00	0	X		0	X		0											
06/05/22 19:00	0	X		0	X		0											
06/05/22 20:00	0	X		0	X		0											
06/05/22 21:00	0	X		0	X		0											
06/05/22 22:00	0	X		0	X		0											
06/05/22 23:00	0	X		0	X		0											
06/06/22 0:00	0	X		0	X		0											
06/06/22 1:00	0	X		0	X		0											
06/06/22 2:00	0	X		0	X		0											
06/06/22 3:00	0	X		0	X		0											

	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/06/22 4:00	0	X		0	X		0											
06/06/22 5:00	0	X		0	X		0											
06/06/22 6:00	0	X		0	X		0											
06/06/22 7:00	0	X		0	X		0											
06/06/22 8:00	0	X		0	X		0											
06/06/22 9:00	0	X		0	X		0											
06/06/22 10:00	0	X		0	X		0											
06/06/22 11:00	0	X		0	X		0											
06/06/22 12:00	0	X		0	X		0											
06/06/22 13:00	0.11976			0	X		0.04											
06/06/22 14:00	0.26352			0	X		0.26											
06/06/22 15:00	0.27936			0	X		0.28											
06/06/22 16:00	0.27882			0	X		0.28											
06/06/22 17:00	0.27858			0	X		0.28											
06/06/22 18:00	0.17076			0	X		0.04											
06/06/22 19:00	0	X		0	X		0											
06/06/22 20:00	0	X		0	X		0											
06/06/22 21:00	0	X		0	X		0											
06/06/22 22:00	0	X		0	X		0											
06/06/22 23:00	0	X		0	X		0											
06/07/22 0:00	0	X		0	X		0											
06/07/22 1:00	0	X		0	X		0											
06/07/22 2:00	0	X		0	X		0											
06/07/22 3:00	0	X		0	X		0											
06/07/22 4:00	0	X		0	X		0											
06/07/22 5:00	0	X		0	X		0											
06/07/22 6:00	0	X		0	X		0											
06/07/22 7:00	0	X		0	X		0											
06/07/22 8:00	0	X		0	X		0											
06/07/22 9:00	0	X		0	X		0											
06/07/22 10:00	0	X		0	X		0											
06/07/22 11:00	0	X		0.12798			0.04											
06/07/22 12:00	0	X		0.19074			0.19											
06/07/22 13:00	0	X		0.19974			0.2											
06/07/22 14:00	0	X		0.23412			0.23											
06/07/22 15:00	0	X		0.24528			0.25											
06/07/22 16:00	0	X		0.24552			0.25											

	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/07/22 17:00	0	X		0.24594			0.25											
06/07/22 18:00	0	X		0.24612			0.25											
06/07/22 19:00	0	X		0.24084			0.24											
06/07/22 20:00	0	X		0.12456			0.01											
06/07/22 21:00	0	X		0	X		0											
06/07/22 22:00	0	X		0	X		0											
06/07/22 23:00	0	X		0	X		0											
06/08/22 0:00	0	X		0	X		0											
06/08/22 1:00	0	X		0	X		0											
06/08/22 2:00	0	X		0	X		0											
06/08/22 3:00	0.09912			0	X		0.03											
06/08/22 4:00	0.27984			0	X		0.28											
06/08/22 5:00	0.28452			0	X		0.28											
06/08/22 6:00	0.28356			0	X		0.28											
06/08/22 7:00	0.22206			0	X		0.22											
06/08/22 8:00	0.21564			0	X		0.22											
06/08/22 9:00	0.183			0	X		0.18											
06/08/22 10:00	0.18036			0	X		0.18											
06/08/22 11:00	0.18078			0	X		0.18											
06/08/22 12:00	0.19044			0	X		0.19											
06/08/22 13:00	0.28056			0	X		0.28											
06/08/22 14:00	0.27984			0.2043			0.44											
06/08/22 15:00	0.26622			0.2811			0.55											
06/08/22 16:00	0.26892			0.28548			0.55											
06/08/22 17:00	0.3327			0.3483			0.68											
06/08/22 18:00	0.3984			0.41328			0.81											
06/08/22 19:00	0.36528			0.38124			0.75											
06/08/22 20:00	0.32208			0.33984			0.66											
06/08/22 21:00	0.30186			0.32082			0.62											
06/08/22 22:00	0.29802			0.31734			0.62											
06/08/22 23:00	0.30714			0.32646			0.63											
06/09/22 0:00	0.306			0.3258			0.63											
06/09/22 1:00	0.3021			0.32172			0.62											
06/09/22 2:00	0.24402			0.2469			0.48											
06/09/22 3:00	0.28758			0	X		0.29											
06/09/22 4:00	0.2868			0	X		0.29											
06/09/22 5:00	0.20304			0	X		0.2											

	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/09/22 6:00	0.1938			0	X		0.19											
06/09/22 7:00	0.18024			0	X		0.18											
06/09/22 8:00	0.18072			0	X		0.18											
06/09/22 9:00	0.19218			0	X		0.19											
06/09/22 10:00	0.26874			0.12018			0.31											
06/09/22 11:00	0.18012			0.19116			0.37											
06/09/22 12:00	0.17148			0.17988			0.35											
06/09/22 13:00	0.23142			0.24444			0.48											
06/09/22 14:00	0.27786			0.29178			0.57											
06/09/22 15:00	0.32352			0.33774			0.66											
06/09/22 16:00	0.2478			0.26214			0.51											
06/09/22 17:00	0.31374			0.32922			0.64											
06/09/22 18:00	0.3252			0.34032			0.67											
06/09/22 19:00	0.30522			0.32094			0.63											
06/09/22 20:00	0.33558			0.35142			0.69											
06/09/22 21:00	0.31812			0.33492			0.65											
06/09/22 22:00	0.27426			0.294			0.57											
06/09/22 23:00	0.3114			0.32862			0.64											
06/10/22 0:00	0.2994			0.3177			0.62											
06/10/22 1:00	0.29892			0.3171			0.62											
06/10/22 2:00	0.29826			0.31662			0.61											
06/10/22 3:00	0.2973			0.31614			0.61											
06/10/22 4:00	0.29718			0.3159			0.61											
06/10/22 5:00	0.31368			0.33168			0.65											
06/10/22 6:00	0.28152			0.30186			0.58											
06/10/22 7:00	0.27798			0.2943			0.57											
06/10/22 8:00	0.2766			0.29286			0.57											
06/10/22 9:00	0.2754			0.2916			0.57											
06/10/22 10:00	0.2796			0.29478			0.57											
06/10/22 11:00	0.30834			0.3225			0.63											
06/10/22 12:00	0.32826			0.342			0.67											
06/10/22 13:00	0.35442			0.36786			0.72											
06/10/22 14:00	0.38166			0.39504			0.78											
06/10/22 15:00	0.3756			0.38898			0.76											
06/10/22 16:00	0.3291			0.30012			0.63											
06/10/22 17:00	0.38454			0.39822			0.78											
06/10/22 18:00	0.3831			0.39678			0.78											

	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/10/22 19:00	0.3618			0.37662			0.74											
06/10/22 20:00	0.33414			0.34998			0.68											
06/10/22 21:00	0.33978			0.3558			0.7											
06/10/22 22:00	0.2832			0.29862			0.58											
06/10/22 23:00	0.2142			0.14862			0.24											
06/11/22 0:00	0.27738			0.09264			0.3											
06/11/22 1:00	0.18048			0.18354			0.36											
06/11/22 2:00	0.1698			0.18114			0.35											
06/11/22 3:00	0.16992			0.18144			0.35											
06/11/22 4:00	0.16722			0.17862			0.35											
06/11/22 5:00	0.16746			0.17868			0.35											
06/11/22 6:00	0.16782			0.1788			0.35											
06/11/22 7:00	0.16806			0.17838			0.35											
06/11/22 8:00	0.17112			0.18144			0.35											
06/11/22 9:00	0.1743			0.18468			0.36											
06/11/22 10:00	0.2295			0.2442			0.47											
06/11/22 11:00	0.243			0.25854			0.5											
06/11/22 12:00	0.2913			0.30582			0.6											
06/11/22 13:00	0.34626			0.36006			0.71											
06/11/22 14:00	0.35286			0.36642			0.72											
06/11/22 15:00	0.34842			0.36222			0.71											
06/11/22 16:00	0.34158			0.35526			0.7											
06/11/22 17:00	0.36654			0.38046			0.75											
06/11/22 18:00	0.39324			0.40734			0.8											
06/11/22 19:00	0.38988			0.40452			0.79											
06/11/22 20:00	0.3774			0.39348			0.77											
06/11/22 21:00	0.37692			0.39354			0.77											
06/11/22 22:00	0.29526			0.31344			0.61											
06/11/22 23:00	0.2547			0.27192			0.53											
06/12/22 0:00	0.3249			0.34368			0.67											
06/12/22 1:00	0.23766			0.25062			0.49											
06/12/22 2:00	0.27222			0.07704			0.28											
06/12/22 3:00	0.2775			0	X		0.28											
06/12/22 4:00	0.27768			0	X		0.28											
06/12/22 5:00	0.22344			0	X		0.22											
06/12/22 6:00	0.17946			0	X		0.18											
06/12/22 7:00	0.18072			0	X		0.18											

	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/12/22 8:00	0.18042			0	X		0.18											
06/12/22 9:00	0.18054			0	X		0.18											
06/12/22 10:00	0.18096			0	X		0.18											
06/12/22 11:00	0.21708			0	X		0.22											
06/12/22 12:00	0.25584			0.17568			0.36											
06/12/22 13:00	0.28008			0.29232			0.57											
06/12/22 14:00	0.28746			0.3009			0.59											
06/12/22 15:00	0.29562			0.31134			0.61											
06/12/22 16:00	0.3042			0.31884			0.62											
06/12/22 17:00	0.3066			0.32172			0.63											
06/12/22 18:00	0.3093			0.32544			0.63											
06/12/22 19:00	0.29658			0.3144			0.61											
06/12/22 20:00	0.29772			0.31626			0.61											
06/12/22 21:00	0.29334			0.3123			0.61											
06/12/22 22:00	0.29274			0.31188			0.6											
06/12/22 23:00	0.22686			0.2382			0.47											
06/13/22 0:00	0.24204			0.0855			0.24											
06/13/22 1:00	0.2604			0	X		0.26											
06/13/22 2:00	0.1848			0	X		0.18											
06/13/22 3:00	0.18			0	X		0.18											
06/13/22 4:00	0.17982			0	X		0.18											
06/13/22 5:00	0.18018			0	X		0.18											
06/13/22 6:00	0.1794			0	X		0.18											
06/13/22 7:00	0.18			0	X		0.18											
06/13/22 8:00	0.17976			0	X		0.18											
06/13/22 9:00	0.17988			0	X		0.18											
06/13/22 10:00	0.1794			0	X		0.18											
06/13/22 11:00	0.18072			0	X		0.18											
06/13/22 12:00	0.18114			0	X		0.18											
06/13/22 13:00	0.18084			0	X		0.18											
06/13/22 14:00	0.18114			0	X		0.18											
06/13/22 15:00	0.1803			0	X		0.18											
06/13/22 16:00	0.2001			0	X		0.2											
06/13/22 17:00	0.21702			0	X		0.22											
06/13/22 18:00	0.22998			0.16374			0.36											
06/13/22 19:00	0.25182			0.27024			0.52											
06/13/22 20:00	0.28836			0.30804			0.6											

	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/13/22 21:00	0.20088			0.19602			0.36											
06/13/22 22:00	0.18006			0	X		0.18											
06/13/22 23:00	0.18012			0	X		0.18											
06/14/22 0:00	0.17976			0	X		0.18											
06/14/22 1:00	0.17952			0	X		0.18											
06/14/22 2:00	0.1797			0	X		0.18											
06/14/22 3:00	0.17976			0	X		0.18											
06/14/22 4:00	0.17994			0	X		0.18											
06/14/22 5:00	0.21258			0	X		0.21											
06/14/22 6:00	0.18012			0	X		0.18											
06/14/22 7:00	0.18036			0	X		0.18											
06/14/22 8:00	0.17958			0	X		0.18											
06/14/22 9:00	0.17952			0	X		0.18											
06/14/22 10:00	0.18006			0	X		0.18											
06/14/22 11:00	0.18114			0	X		0.18											
06/14/22 12:00	0.18144			0	X		0.18											
06/14/22 13:00	0.18192			0	X		0.18											
06/14/22 14:00	0.18186			0	X		0.18											
06/14/22 15:00	0.18162			0	X		0.18											
06/14/22 16:00	0.18168			0	X		0.18											
06/14/22 17:00	0.22536			0	X		0.23											
06/14/22 18:00	0.20424			0.16572			0.37											
06/14/22 19:00	0.27864			0.2973			0.58											
06/14/22 20:00	0.29022			0.3081			0.6											
06/14/22 21:00	0.2463			0.264			0.51											
06/14/22 22:00	0.27612			0.2946			0.57											
06/14/22 23:00	0.29988			0.31914			0.62											
06/15/22 0:00	0.30066			0.32046			0.62											
06/15/22 1:00	0.29616			0.31566			0.61											
06/15/22 2:00	0.2676			0.28752			0.56											
06/15/22 3:00	0.30108			0.32118			0.62											
06/15/22 4:00	0.3438			0.36462			0.71											
06/15/22 5:00	0.26664			0.28542			0.55											
06/15/22 6:00	0.2013			0.21606			0.42											
06/15/22 7:00	0.21192			0.22722			0.44											
06/15/22 8:00	0.16776			0.1782			0.35											
06/15/22 9:00	0.16788			0.17814			0.35											

	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/15/22 10:00	0.16962			0.17958			0.35											
06/15/22 11:00	0.18594			0.19662			0.38											
06/15/22 12:00	0.2595			0.27576			0.54											
06/15/22 13:00	0.27486			0.29124			0.57											
06/15/22 14:00	0.29892			0.31386			0.61											
06/15/22 15:00	0.3297			0.34464			0.67											
06/15/22 16:00	0.31818			0.33312			0.65											
06/15/22 17:00	0.3165			0.33174			0.65											
06/15/22 18:00	0.3051			0.32178			0.63											
06/15/22 19:00	0.29742			0.31566			0.61											
06/15/22 20:00	0.2952			0.31512			0.61											
06/15/22 21:00	0.29496			0.31506			0.61											
06/15/22 22:00	0.29382			0.31422			0.61											
06/15/22 23:00	0.29274			0.31398			0.61											
06/16/22 0:00	0.2922			0.31362			0.61											
06/16/22 1:00	0.29208			0.31362			0.61											
06/16/22 2:00	0.29154			0.31344			0.6											
06/16/22 3:00	0.29166			0.31404			0.61											
06/16/22 4:00	0.29178			0.31386			0.61											
06/16/22 5:00	0.23298			0.2502			0.48											
06/16/22 6:00	0.1692			0.1806			0.35											
06/16/22 7:00	0.16992			0.18078			0.35											
06/16/22 8:00	0.16944			0.18048			0.35											
06/16/22 9:00	0.16818			0.17886			0.35											
06/16/22 10:00	0.16782			0.17808			0.35											
06/16/22 11:00	0.19284			0.2037			0.4											
06/16/22 12:00	0.30222			0.31806			0.62											
06/16/22 13:00	0.3312			0.3468			0.68											
06/16/22 14:00	0.3			0.31566			0.62											
06/16/22 15:00	0.30048			0.31656			0.62											
06/16/22 16:00	0.2997			0.31566			0.62											
06/16/22 17:00	0.27126			0.2874			0.56											
06/16/22 18:00	0.29718			0.3156			0.61											
06/16/22 19:00	0.2892			0.31044			0.6											
06/16/22 20:00	0.28344			0.30438			0.59											
06/16/22 21:00	0.29262			0.31422			0.61											
06/16/22 22:00	0.29208			0.31422			0.61											

	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/16/22 23:00	0.29196			0.31416			0.61											
06/17/22 0:00	0.29214			0.31302			0.61											
06/17/22 1:00	0.29238			0.31242			0.6											
06/17/22 2:00	0.29268			0.31212			0.6											
06/17/22 3:00	0.2928			0.31074			0.6											
06/17/22 4:00	0.30948			0.32946			0.64											
06/17/22 5:00	0.28848			0.3099			0.6											
06/17/22 6:00	0.20178			0.21678			0.42											
06/17/22 7:00	0.18642			0.19926			0.39											
06/17/22 8:00	0.17052			0.1812			0.35											
06/17/22 9:00	0.17568			0.17934			0.36											
06/17/22 10:00	0.17814			0.1839			0.36											
06/17/22 11:00	0.17052			0.1788			0.35											
06/17/22 12:00	0.1695			0.17832			0.35											
06/17/22 13:00	0.15126			0.2166			0.28											
06/17/22 14:00	0	X		0.19194			0.19											
06/17/22 15:00	0	X		0.19284			0.19											
06/17/22 16:00	0	X		0.19272			0.19											
06/17/22 17:00	0	X		0.19242			0.19											
06/17/22 18:00	0	X		0.19224			0.19											
06/17/22 19:00	0	X		0.19248			0.19											
06/17/22 20:00	0	X		0.19266			0.19											
06/17/22 21:00	0	X		0.19284			0.19											
06/17/22 22:00	0	X		0.1896			0.19											
06/17/22 23:00	0	X		0.19146			0.19											
06/18/22 0:00	0	X		0.19158			0.19											
06/18/22 1:00	0	X		0.19158			0.19											
06/18/22 2:00	0	X		0.1926			0.19											
06/18/22 3:00	0	X		0.1887			0.19											
06/18/22 4:00	0	X		0.19446			0.19											
06/18/22 5:00	0	X		0.19116			0.19											
06/18/22 6:00	0	X		0.1911			0.19											
06/18/22 7:00	0	X		0.19134			0.19											
06/18/22 8:00	0	X		0.19122			0.19											
06/18/22 9:00	0	X		0.19128			0.19											
06/18/22 10:00	0	X		0.19122			0.19											
06/18/22 11:00	0	X		0.19182			0.19											

	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/18/22 12:00	0	X		0.19122			0.19											
06/18/22 13:00	0	X		0.19098			0.19											
06/18/22 14:00	0	X		0.1914			0.19											
06/18/22 15:00	0	X		0.19176			0.19											
06/18/22 16:00	0	X		0.19152			0.19											
06/18/22 17:00	0	X		0.1917			0.19											
06/18/22 18:00	0	X		0.192			0.19											
06/18/22 19:00	0	X		0.19218			0.19											
06/18/22 20:00	0	X		0.20034			0.2											
06/18/22 21:00	0	X		0.19554			0.2											
06/18/22 22:00	0	X		0.29844			0.3											
06/18/22 23:00	0	X		0.21852			0.22											
06/19/22 0:00	0	X		0.19968			0.2											
06/19/22 1:00	0	X		0.24474			0.24											
06/19/22 2:00	0	X		0.20964			0.21											
06/19/22 3:00	0	X		0.1923			0.19											
06/19/22 4:00	0	X		0.19272			0.19											
06/19/22 5:00	0	X		0.19572			0.2											
06/19/22 6:00	0	X		0.192			0.19											
06/19/22 7:00	0	X		0.19194			0.19											
06/19/22 8:00	0	X		0.19248			0.19											
06/19/22 9:00	0	X		0.19254			0.19											
06/19/22 10:00	0	X		0.19242			0.19											
06/19/22 11:00	0	X		0.19206			0.19											
06/19/22 12:00	0	X		0.19152			0.19											
06/19/22 13:00	0	X		0.19092			0.19											
06/19/22 14:00	0	X		0.18954			0.19											
06/19/22 15:00	0	X		0.19014			0.19											
06/19/22 16:00	0	X		0.19068			0.19											
06/19/22 17:00	0	X		0.1896			0.19											
06/19/22 18:00	0	X		0.18912			0.19											
06/19/22 19:00	0	X		0.18996			0.19											
06/19/22 20:00	0	X		0.20826			0.21											
06/19/22 21:00	0	X		0.18978			0.19											
06/19/22 22:00	0	X		0.19272			0.19											
06/19/22 23:00	0	X		0.19206			0.19											
06/20/22 0:00	0	X		0.19194			0.19											

	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/20/22 1:00	0	X		0.19188			0.19											
06/20/22 2:00	0	X		0.19218			0.19											
06/20/22 3:00	0	X		0.19212			0.19											
06/20/22 4:00	0	X		0.2031			0.2											
06/20/22 5:00	0	X		0.19608			0.2											
06/20/22 6:00	0	X		0.19584			0.2											
06/20/22 7:00	0	X		0.19194			0.19											
06/20/22 8:00	0	X		0.19176			0.19											
06/20/22 9:00	0	X		0.19188			0.19											
06/20/22 10:00	0	X		0.19206			0.19											
06/20/22 11:00	0	X		0.19188			0.19											
06/20/22 12:00	0	X		0.20268			0.2											
06/20/22 13:00	0	X		0.21888			0.22											
06/20/22 14:00	0.15588			0.2445			0.36											
06/20/22 15:00	0.26628			0.29676			0.56											
06/20/22 16:00	0.3534			0.39462			0.75											
06/20/22 17:00	0.30246			0.34092			0.64											
06/20/22 18:00	0.3051			0.34524			0.65											
06/20/22 19:00	0.29838			0.33222			0.63											
06/20/22 20:00	0.29538			0.32592			0.62											
06/20/22 21:00	0.2958			0.32382			0.62											
06/20/22 22:00	0.2385			0.24858			0.49											
06/20/22 23:00	0.195			0.03828			0.2											
06/21/22 0:00	0.17808			0	X		0.18											
06/21/22 1:00	0.17736			0	X		0.18											
06/21/22 2:00	0.17802			0	X		0.18											
06/21/22 3:00	0.17898			0	X		0.18											
06/21/22 4:00	0.18006			0	X		0.18											
06/21/22 5:00	0.19464			0	X		0.19											
06/21/22 6:00	0.18042			0	X		0.18											
06/21/22 7:00	0.18054			0	X		0.18											
06/21/22 8:00	0.17964			0	X		0.18											
06/21/22 9:00	0.17916			0	X		0.18											
06/21/22 10:00	0.17922			0	X		0.18											
06/21/22 11:00	0.18132			0	X		0.18											
06/21/22 12:00	0.1818			0	X		0.18											
06/21/22 13:00	0.18204			0	X		0.18											

	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/21/22 14:00	0.18546			0	X		0.19											
06/21/22 15:00	0.19194			0	X		0.19											
06/21/22 16:00	0.18216			0	X		0.18											
06/21/22 17:00	0.19008			0	X		0.19											
06/21/22 18:00	0.20754			0	X		0.21											
06/21/22 19:00	0.27102			0.18126			0.38											
06/21/22 20:00	0.31572			0.29592			0.61											
06/21/22 21:00	0.3261			0.34098			0.67											
06/21/22 22:00	0.30042			0.31686			0.62											
06/21/22 23:00	0.2991			0.31578			0.61											
06/22/22 0:00	0.29772			0.3156			0.61											
06/22/22 1:00	0.29754			0.31482			0.61											
06/22/22 2:00	0.2694			0.28776			0.56											
06/22/22 3:00	0.29382			0.31104			0.6											
06/22/22 4:00	0.28254			0.30168			0.58											
06/22/22 5:00	0.21768			0.23214			0.45											
06/22/22 6:00	0.16692			0.17802			0.34											
06/22/22 7:00	0.16704			0.17742			0.34											
06/22/22 8:00	0.16716			0.17694			0.34											
06/22/22 9:00	0.16698			0.17658			0.34											
06/22/22 10:00	0.16716			0.17634			0.34											
06/22/22 11:00	0.16818			0.17646			0.34											
06/22/22 12:00	0.16848			0.1764			0.34											
06/22/22 13:00	0.17964			0.18876			0.37											
06/22/22 14:00	0.1875			0.20142			0.39											
06/22/22 15:00	0.17646			0.18642			0.36											
06/22/22 16:00	0.16758			0.17628			0.34											
06/22/22 17:00	0.16716			0.1764			0.34											
06/22/22 18:00	0.16704			0.1764			0.34											
06/22/22 19:00	0.1677			0.1773			0.35											
06/22/22 20:00	0.2262			0.2472			0.47											
06/22/22 21:00	0.26388			0.28032			0.54											
06/22/22 22:00	0.26928			0.28848			0.56											
06/22/22 23:00	0.29604			0.31362			0.61											
06/23/22 0:00	0.30636			0.32358			0.63											
06/23/22 1:00	0.25968			0.2769			0.54											
06/23/22 2:00	0.19716			0.14628			0.23											

	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/23/22 3:00	0.18234			0	X		0.18											
06/23/22 4:00	0.22548			0	X		0.23											
06/23/22 5:00	0.25032			0	X		0.25											
06/23/22 6:00	0.28632			0	X		0.29											
06/23/22 7:00	0.28548			0	X		0.29											
06/23/22 8:00	0.28398			0	X		0.28											
06/23/22 9:00	0.2832			0	X		0.28											
06/23/22 10:00	0.27462			0	X		0.27											
06/23/22 11:00	0.18078			0	X		0.18											
06/23/22 12:00	0.17604			0	X		0.18											
06/23/22 13:00	0.1758			0	X		0.18											
06/23/22 14:00	0.1755			0	X		0.18											
06/23/22 15:00	0.20382			0.003			0.2											
06/23/22 16:00	0.1998			0.16824			0.37											
06/23/22 17:00	0.26838			0.27708			0.55											
06/23/22 18:00	0.34746			0.3597			0.71											
06/23/22 19:00	0.37152			0.38538			0.76											
06/23/22 20:00	0.36156			0.3768			0.74											
06/23/22 21:00	0.31506			0.33144			0.65											
06/23/22 22:00	0.29874			0.3168			0.62											
06/23/22 23:00	0.29814			0.31638			0.61											
06/24/22 0:00	0.29802			0.3165			0.61											
06/24/22 1:00	0.29724			0.3168			0.61											
06/24/22 2:00	0.28656			0.30552			0.59											
06/24/22 3:00	0.21024			0.22518			0.44											
06/24/22 4:00	0.29634			0.31632			0.61											
06/24/22 5:00	0.22776			0.24354			0.47											
06/24/22 6:00	0.1695			0.18054			0.35											
06/24/22 7:00	0.16872			0.17886			0.35											
06/24/22 8:00	0.16836			0.1788			0.35											
06/24/22 9:00	0.1689			0.17916			0.35											
06/24/22 10:00	0.19788			0.21042			0.41											
06/24/22 11:00	0.24768			0.26208			0.51											
06/24/22 12:00	0.27534			0.29046			0.57											
06/24/22 13:00	0.27012			0.28548			0.56											
06/24/22 14:00	0.34176			0.35508			0.7											
06/24/22 15:00	0.33888			0.35202			0.69											

	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/24/22 16:00	0.34104			0.32688			0.67											
06/24/22 17:00	0.38268			0.396			0.78											
06/24/22 18:00	0.3549			0.3696			0.72											
06/24/22 19:00	0.35844			0.3744			0.73											
06/24/22 20:00	0.31524			0.33204			0.65											
06/24/22 21:00	0.30324			0.32124			0.62											
06/24/22 22:00	0.31434			0.33288			0.65											
06/24/22 23:00	0.29874			0.31824			0.62											
06/25/22 0:00	0.2748			0.29406			0.57											
06/25/22 1:00	0.34572			0.36534			0.71											
06/25/22 2:00	0.28086			0.30096			0.58											
06/25/22 3:00	0.27966			0.3003			0.58											
06/25/22 4:00	0.27288			0.29454			0.57											
06/25/22 5:00	0.22806			0.24438			0.47											
06/25/22 6:00	0.16884			0.18012			0.35											
06/25/22 7:00	0.16686			0.17772			0.34											
06/25/22 8:00	0.16674			0.17748			0.34											
06/25/22 9:00	0.16704			0.17724			0.34											
06/25/22 10:00	0.16716			0.17706			0.34											
06/25/22 11:00	0.16824			0.17682			0.35											
06/25/22 12:00	0.17442			0.183			0.36											
06/25/22 13:00	0.16998			0.17808			0.35											
06/25/22 14:00	0.1743			0.183			0.36											
06/25/22 15:00	0.17214			0.18072			0.35											
06/25/22 16:00	0.183			0.19248			0.38											
06/25/22 17:00	0.30816			0.31344			0.62											
06/25/22 18:00	0.33906			0.35424			0.69											
06/25/22 19:00	0.3135			0.32994			0.64											
06/25/22 20:00	0.31224			0.32916			0.64											
06/25/22 21:00	0.2349			0.2661			0.49											
06/25/22 22:00	0	X		0.21264			0.21											
06/25/22 23:00	0	X		0.19068			0.19											
06/26/22 0:00	0	X		0.19074			0.19											
06/26/22 1:00	0	X		0.21582			0.22											
06/26/22 2:00	0	X		0.22326			0.22											
06/26/22 3:00	0	X		0.20052			0.2											
06/26/22 4:00	0	X		0.27378			0.27											

	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/26/22 5:00	0	X		0.26604			0.27											
06/26/22 6:00	0	X		0.19146			0.19											
06/26/22 7:00	0	X		0.19158			0.19											
06/26/22 8:00	0	X		0.19182			0.19											
06/26/22 9:00	0	X		0.20454			0.2											
06/26/22 10:00	0.15768			0.22152			0.37											
06/26/22 11:00	0.16842			0.17706			0.35											
06/26/22 12:00	0.16854			0.1767			0.35											
06/26/22 13:00	0.17142			0.1797			0.35											
06/26/22 14:00	0.16968			0.17778			0.35											
06/26/22 15:00	0.17274			0.1812			0.35											
06/26/22 16:00	0.24144			0.25392			0.5											
06/26/22 17:00	0.31242			0.31938			0.63											
06/26/22 18:00	0.37224			0.38664			0.76											
06/26/22 19:00	0.31002			0.3258			0.64											
06/26/22 20:00	0.29898			0.31638			0.62											
06/26/22 21:00	0.25422			0.27036			0.52											
06/26/22 22:00	0.1854			0.15066			0.23											
06/26/22 23:00	0.17922			0	X		0.18											
06/27/22 0:00	0.17922			0	X		0.18											
06/27/22 1:00	0.17982			0	X		0.18											
06/27/22 2:00	0.17988			0	X		0.18											
06/27/22 3:00	0.17982			0	X		0.18											
06/27/22 4:00	0.20508			0	X		0.21											
06/27/22 5:00	0.18006			0	X		0.18											
06/27/22 6:00	0.18018			0	X		0.18											
06/27/22 7:00	0.18054			0	X		0.18											
06/27/22 8:00	0.18054			0	X		0.18											
06/27/22 9:00	0.18084			0	X		0.18											
06/27/22 10:00	0.18066			0	X		0.18											
06/27/22 11:00	0.18078			0	X		0.18											
06/27/22 12:00	0.19032			0	X		0.19											
06/27/22 13:00	0.21006			0.16254			0.36											
06/27/22 14:00	0.24672			0.261			0.51											
06/27/22 15:00	0.30396			0.3171			0.62											
06/27/22 16:00	0.30366			0.31734			0.62											
06/27/22 17:00	0.31896			0.33198			0.65											

	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/27/22 18:00	0.34392			0.35754			0.7											
06/27/22 19:00	0.30996			0.32514			0.64											
06/27/22 20:00	0.30474			0.32094			0.63											
06/27/22 21:00	0.29328			0.31098			0.6											
06/27/22 22:00	0.18978			0.18144			0.33											
06/27/22 23:00	0.18066			0	X		0.18											
06/28/22 0:00	0.17694			0	X		0.18											
06/28/22 1:00	0.177			0	X		0.18											
06/28/22 2:00	0.17664			0	X		0.18											
06/28/22 3:00	0.1767			0	X		0.18											
06/28/22 4:00	0.24972			0	X		0.25											
06/28/22 5:00	0.20748			0	X		0.21											
06/28/22 6:00	0.17928			0	X		0.18											
06/28/22 7:00	0.17988			0	X		0.18											
06/28/22 8:00	0.18024			0	X		0.18											
06/28/22 9:00	0.18036			0	X		0.18											
06/28/22 10:00	0.18			0	X		0.18											
06/28/22 11:00	0.1935			0	X		0.19											
06/28/22 12:00	0.18018			0	X		0.18											
06/28/22 13:00	0.17982			0	X		0.18											
06/28/22 14:00	0.1803			0	X		0.18											
06/28/22 15:00	0.20724			0.0603			0.22											
06/28/22 16:00	0.18114			0.18852			0.37											
06/28/22 17:00	0.25902			0.27276			0.53											
06/28/22 18:00	0.30204			0.31716			0.62											
06/28/22 19:00	0.29862			0.31506			0.61											
06/28/22 20:00	0.26196			0.27918			0.54											
06/28/22 21:00	0.19914			0.18954			0.3											
06/28/22 22:00	0.17844			0	X		0.18											
06/28/22 23:00	0.26478			0	X		0.26											
06/29/22 0:00	0.28176			0	X		0.28											
06/29/22 1:00	0.27684			0	X		0.28											
06/29/22 2:00	0.27672			0	X		0.28											
06/29/22 3:00	0.2763			0	X		0.28											
06/29/22 4:00	0.27726			0	X		0.28											
06/29/22 5:00	0.25908			0	X		0.26											
06/29/22 6:00	0.18816			0	X		0.19											

	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/29/22 7:00	0.18078			0	X		0.18											
06/29/22 8:00	0.18174			0	X		0.18											
06/29/22 9:00	0.18468			0	X		0.18											
06/29/22 10:00	0.18126			0	X		0.18											
06/29/22 11:00	0.20886			0	X		0.21											
06/29/22 12:00	0.20184			0.16572			0.37											
06/29/22 13:00	0.25494			0.26982			0.52											
06/29/22 14:00	0.30354			0.31812			0.62											
06/29/22 15:00	0.30258			0.31746			0.62											
06/29/22 16:00	0.30228			0.31698			0.62											
06/29/22 17:00	0.3024			0.31722			0.62											
06/29/22 18:00	0.30864			0.3246			0.63											
06/29/22 19:00	0.31614			0.3336			0.65											
06/29/22 20:00	0.3123			0.33192			0.64											
06/29/22 21:00	0.30234			0.32238			0.62											
06/29/22 22:00	0.29418			0.31464			0.61											
06/29/22 23:00	0.3408			0.36168			0.7											
06/30/22 0:00	0.2517			0.25224			0.47											
06/30/22 1:00	0.28014			0	X		0.28											
06/30/22 2:00	0.2433			0	X		0.24											
06/30/22 3:00	0.27288			0	X		0.27											
06/30/22 4:00	0.24552			0	X		0.25											
06/30/22 5:00	0.23796			0	X		0.24											
06/30/22 6:00	0.18024			0	X		0.18											
06/30/22 7:00	0.18054			0	X		0.18											
06/30/22 8:00	0.18042			0	X		0.18											
06/30/22 9:00	0.18078			0	X		0.18											
06/30/22 10:00	0.18138			0	X		0.18											
06/30/22 11:00	0.18264			0	X		0.18											
06/30/22 12:00	0.18318			0	X		0.18											
06/30/22 13:00	0.2106			0	X		0.21											
06/30/22 14:00	0.20922			0.1611			0.36											
06/30/22 15:00	0.2682			0.27684			0.55											
06/30/22 16:00	0.30462			0.31854			0.62											
06/30/22 17:00	0.31098			0.32442			0.64											
06/30/22 18:00	0.35712			0.37176			0.73											
06/30/22 19:00	0.3942			0.4101			0.8											

	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/30/22 20:00	0.31716			0.33612			0.65											
06/30/22 21:00	0.29556			0.31392			0.61											
06/30/22 22:00	0.26946			0.2895			0.56											
06/30/22 23:00	0.23766			0.189			0.34											
07/01/22 0:00	0.22584			0	X		0.23											
07/01/22 1:00	0.18036			0	X		0.18											
07/01/22 2:00	0.18108			0	X		0.18											
07/01/22 3:00	0.18204			0	X		0.18											
07/01/22 4:00	0.18276			0	X		0.18											
07/01/22 5:00	0.21846			0	X		0.22											
07/01/22 6:00	0.18084			0	X		0.18											
07/01/22 7:00	0.1815			0	X		0.18											
07/01/22 8:00	0.18096			0	X		0.18											
07/01/22 9:00	0.18102			0	X		0.18											
07/01/22 10:00	0.18144			0	X		0.18											
07/01/22 11:00	0.18282			0	X		0.18											
07/01/22 12:00	0.1833			0	X		0.18											
07/01/22 13:00	0.1821			0	X		0.18											
07/01/22 14:00	0.1815			0	X		0.18											
07/01/22 15:00	0.18114			0	X		0.18											
07/01/22 16:00	0.20916			0	X		0.21											
07/01/22 17:00	0.2844			0.19464			0.42											
07/01/22 18:00	0.28038			0.2985			0.58											
07/01/22 19:00	0.30084			0.31818			0.62											
07/01/22 20:00	0.29832			0.3183			0.62											
07/01/22 21:00	0.29628			0.3162			0.61											
07/01/22 22:00	0.26514			0.2871			0.55											
07/01/22 23:00	0.18636			0.12852			0.2											

AQ33 DAILY SOX

	CT1_SO2_Lb_1D			CT2_SO2_Lb_1D													
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/01/22 0:00	0			0														
04/02/22 0:00	0			0														
04/03/22 0:00	0			0														
04/04/22 0:00	0			0														
04/05/22 0:00	0			0														
04/06/22 0:00	0			0														
04/07/22 0:00	0			0														
04/08/22 0:00	0			0														
04/09/22 0:00	0			0														
04/10/22 0:00	0			0														
04/11/22 0:00	0			0														
04/12/22 0:00	0			0														
04/13/22 0:00	0			0														
04/14/22 0:00	0			0														
04/15/22 0:00	0			0														
04/16/22 0:00	0			0														
04/17/22 0:00	0			0														
04/18/22 0:00	0			0														
04/19/22 0:00	0			0														
04/20/22 0:00	0			0														
04/21/22 0:00	0			0														
04/22/22 0:00	0			0														
04/23/22 0:00	0			0														
04/24/22 0:00	0			0														
04/25/22 0:00	0			0														
04/26/22 0:00	0			2.2														
04/27/22 0:00	0			2.7														
04/28/22 0:00	0			1.8														
04/29/22 0:00	2.2			0														
04/30/22 0:00	0			0														
05/01/22 0:00	3.8			0														
05/02/22 0:00	5.1			0														
05/03/22 0:00	0.6			0														
05/04/22 0:00	5.6			6														

	CT1_SO2_Lb_1D			CT2_SO2_Lb_1D														
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/05/22 0:00	5.2			5.3														
05/06/22 0:00	6.4			6.1														
05/07/22 0:00	6.4			2.5														
05/08/22 0:00	2.8			5.2														
05/09/22 0:00	2.2			4.6														
05/10/22 0:00	0			0														
05/11/22 0:00	0			0														
05/12/22 0:00	0			0														
05/13/22 0:00	0			0														
05/14/22 0:00	0			0														
05/15/22 0:00	0			0														
05/16/22 0:00	0			0														
05/17/22 0:00	2.4			1.8														
05/18/22 0:00	7.3			7.7														
05/19/22 0:00	2.8			6														
05/20/22 0:00	0			0														
05/21/22 0:00	0			0														
05/22/22 0:00	0			0														
05/23/22 0:00	0			0														
05/24/22 0:00	4.7			6.1														
05/25/22 0:00	6.9			7.2														
05/26/22 0:00	2.2			0														
05/27/22 0:00	0			0														
05/28/22 0:00	0			0														
05/29/22 0:00	0			0														
05/30/22 0:00	0			0														
05/31/22 0:00	0			0														
06/01/22 0:00	0			0														
06/02/22 0:00	0			0														
06/03/22 0:00	0			0														
06/04/22 0:00	0			0														
06/05/22 0:00	0			0														
06/06/22 0:00	1.2			0														
06/07/22 0:00	0			1.6														
06/08/22 0:00	5.6			3.1														
06/09/22 0:00	6.2			4.5														
06/10/22 0:00	7.7			7.7														

	CT1_SO2_Lb_1D			CT2_SO2_Lb_1D														
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/11/22 0:00	6.7			6.8														
06/12/22 0:00	6.3			3.9														
06/13/22 0:00	5.1			0.9														
06/14/22 0:00	5.2			1.7														
06/15/22 0:00	6.6			6.7														
06/16/22 0:00	6.5			6.6														
06/17/22 0:00	3.3			5.4														
06/18/22 0:00	0			4.9														
06/19/22 0:00	0			4.8														
06/20/22 0:00	2.7			5.4														
06/21/22 0:00	5.3			1.3														
06/22/22 0:00	5.6			5.6														
06/23/22 0:00	6.5			3.2														
06/24/22 0:00	6.7			7														
06/25/22 0:00	5.3			6														
06/26/22 0:00	3.3			5.3														
06/27/22 0:00	5.5			2.7														
06/28/22 0:00	5.3			1.5														
06/29/22 0:00	6.5			3.6														
06/30/22 0:00	6.1			3.1														
07/01/22 0:00	5.4			1.6														

Tons 12 Month Rolling Summary

CT1 and CT2 Combined

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:43 **Location:** Roseville, CA

* = Excess Emission

	Units CT1 & CT2		Units CT1 & CT2		Units CT1 & CT2		Units CT1 & CT2		Units CT1 & CT2	
Date	CO, Ton 1 Day(s)		NOx, Ton 1 Day(s)		PM10, Ton 1 Day(s)		SO2, Ton 1 Day(s)		VOC, Ton 1 Day(s)	
	Sum	Rolling Sum	Sum	Rolling Sum	Sum	Rolling Sum	Sum	Rolling Sum	Sum	Rolling Sum
Apr 2022	0.4279	6.9825	0.0732	14.0559	0.0088	2.9936	0.0045	1.4962	0.0149	4.9895
May 2022	0.4443	6.8879	0.5924	13.9853	0.1194	2.9870	0.0596	1.4929	0.1989	4.9780
Jun 2022	0.7168	6.7270	1.0943	13.6989	0.2183	2.9175	0.1092	1.4584	0.3644	4.8627
Sum/Avg	6.7270		13.6989		2.9175		1.4584		4.8627	
Limit Value										

ATTACHMENT 6

AQ-34

AQ-34 the Project owner shall maintain the following records: occurrence, duration, and type of any startup, shutdown, or malfunction: performance testing, evaluations, calibrations, check, adjustments, any period during which a continuous monitoring system or monitoring device was inoperative, maintenance of any continuous emission monitor; emission measurements, total daily and rolling twelve month averages hours of operation, hourly quantity of fuel used and gross three hour average operating load.

Verification; The Project owner shall submit to the CPM all data identified in this condition as part of the Quarterly Air Quality Report required by the Condition of Certification AQ-SC6

Daily Calibration Results

CT1 and CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:50 **Location:** Roseville, CA

All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	Zero	04/26/22 15:43	200.0	0.0	0.1	|R-A|/Span * 100		0.1
	High	04/26/22 15:53	200.0	184.1	185.7	|R-A|/Span * 100		0.8
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**	**Pass**	
	Zero	04/26/22 15:43	10.0	0.0	0.2	|R-A|/Span * 100		2.0
	High	04/26/22 15:48	10.0	9.5	9.7	|R-A|/Span * 100		2.0
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	Zero	04/26/22 15:43	200.0	0.0	0.0	|R-A|/Span * 100		0.0
	High	04/26/22 15:53	200.0	182.0	178.8	|R-A|/Span * 100		1.6
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**	**Pass**	
	Zero	04/26/22 15:43	10.0	0.0	0.0	|R-A|/Span * 100		0.0
	High	04/26/22 15:48	10.0	8.8	8.7	|R-A|/Span * 100		1.0
Part 75	**CT2_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	High	04/26/22 15:43	21.0	18.1	18.1	|R-A|		0.0
	Zero	04/26/22 15:48	21.0	0.0	0.0	|R-A|		0.0
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	Zero	04/26/22 21:37	200.0	0.0	0.1	|R-A|/Span * 100		0.1
	High	04/26/22 21:48	200.0	184.1	185.4	|R-A|/Span * 100		0.7
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**	**Pass**	
	Zero	04/26/22 21:37	10.0	0.0	0.2	|R-A|/Span * 100		2.0
	High	04/26/22 21:42	10.0	9.5	9.7	|R-A|/Span * 100		2.0
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	Zero	04/26/22 21:37	200.0	0.0	0.0	|R-A|/Span * 100		0.0
	High	04/26/22 21:48	200.0	182.0	178.1	|R-A|/Span * 100		2.0
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**	**Pass**	
	Zero	04/26/22 21:37	10.0	0.0	0.0	|R-A|/Span * 100		0.0
	High	04/26/22 21:42	10.0	8.8	8.7	|R-A|/Span * 100		1.0
Part 75	**CT2_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	High	04/26/22 21:37	21.0	18.1	18.1	|R-A|		0.0
	Zero	04/26/22 21:42	21.0	0.0	0.0	|R-A|		0.0
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	Zero	04/27/22 16:17	200.0	0.0	0.1	|R-A|/Span * 100		0.1
	High	04/27/22 16:27	200.0	184.1	185.7	|R-A|/Span * 100		0.8
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**	**Pass**	
	Zero	04/27/22 16:17	10.0	0.0	0.2	|R-A|/Span * 100		2.0
	High	04/27/22 16:22	10.0	9.5	9.7	|R-A|/Span * 100		2.0

Daily Calibration Results

CT1 and CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:50 **Location:** Roseville, CA

All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	Zero	04/27/22 16:17	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	04/27/22 16:27	200.0	182.0	178.0		|R-A|/Span * 100	2.0
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**	**Pass**	
	Zero	04/27/22 16:17	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	04/27/22 16:22	10.0	8.8	8.7		|R-A|/Span * 100	1.0
Part 75	**CT2_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	High	04/27/22 16:17	21.0	18.1	18.1		|R-A|	0.0
	Zero	04/27/22 16:22	21.0	0.0	0.0		|R-A|	0.0
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	Zero	04/28/22 11:26	200.0	0.0	0.1		|R-A|/Span * 100	0.1
	High	04/28/22 11:37	200.0	184.1	184.6		|R-A|/Span * 100	0.3
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**	**Pass**	
	Zero	04/28/22 11:26	10.0	0.0	0.1		|R-A|/Span * 100	1.0
	High	04/28/22 11:32	10.0	9.5	9.7		|R-A|/Span * 100	2.0
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	Zero	04/28/22 11:26	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	04/28/22 11:37	200.0	182.0	177.8		|R-A|/Span * 100	2.1
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**	**Pass**	
	Zero	04/28/22 11:26	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	04/28/22 11:32	10.0	8.8	8.6		|R-A|/Span * 100	2.0
Part 75	**CT2_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	High	04/28/22 11:26	21.0	18.1	18.1		|R-A|	0.0
	Zero	04/28/22 11:32	21.0	0.0	0.0		|R-A|	0.0
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	Zero	04/29/22 09:48	200.0	0.0	0.1		|R-A|/Span * 100	0.1
	High	04/29/22 09:59	200.0	182.3	182.8		|R-A|/Span * 100	0.3
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**	**Pass**	
	Zero	04/29/22 09:48	10.0	0.0	0.2		|R-A|/Span * 100	2.0
	High	04/29/22 09:53	10.0	9.0	9.0		|R-A|/Span * 100	0.0
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	Zero	04/29/22 09:48	200.0	0.0	-0.1		|R-A|/Span * 100	0.1
	High	04/29/22 09:59	200.0	175.0	166.7	>1x Alert	|R-A|/Span * 100	4.2
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**	**Pass**	
	Zero	04/29/22 09:48	10.0	0.0	-0.1		|R-A|/Span * 100	1.0
	High	04/29/22 09:53	10.0	8.9	8.3		|R-A|	0.6

Daily Calibration Results

CT1 and CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:50 **Location:** Roseville, CA

All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 75	**CT1_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	High	04/29/22 09:48	21.0	18.3	18.4		|R-A|	0.1
	Zero	04/29/22 09:53	21.0	0.0	0.0		|R-A|	0.0
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	Zero	04/29/22 13:34	200.0	0.0	0.1		|R-A|/Span * 100	0.1
	High	04/29/22 13:44	200.0	182.3	182.2		|R-A|/Span * 100	0.1
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**	**Pass**	
	Zero	04/29/22 13:34	10.0	0.0	0.1		|R-A|/Span * 100	1.0
	High	04/29/22 13:39	10.0	9.0	8.9		|R-A|/Span * 100	1.0
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	Zero	04/29/22 13:34	200.0	0.0	-0.1		|R-A|/Span * 100	0.1
	High	04/29/22 13:44	200.0	175.0	174.6		|R-A|/Span * 100	0.2
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**	**Pass**	
	Zero	04/29/22 13:34	10.0	0.0	-0.1		|R-A|/Span * 100	1.0
	High	04/29/22 13:39	10.0	8.9	8.9		|R-A|/Span * 100	0.0
Part 75	**CT1_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	High	04/29/22 13:34	21.0	18.3	18.4		|R-A|	0.1
	Zero	04/29/22 13:39	21.0	0.0	0.0		|R-A|	0.0
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	Zero	05/01/22 06:43	200.0	0.0	0.1		|R-A|/Span * 100	0.1
	High	05/01/22 06:53	200.0	182.3	183.3		|R-A|/Span * 100	0.5
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**	**Pass**	
	Zero	05/01/22 06:43	10.0	0.0	0.2		|R-A|/Span * 100	2.0
	High	05/01/22 06:48	10.0	9.0	9.0		|R-A|/Span * 100	0.0
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	Zero	05/01/22 06:43	200.0	0.0	-0.1		|R-A|/Span * 100	0.1
	High	05/01/22 06:53	200.0	175.0	173.4		|R-A|/Span * 100	0.8
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**	**Pass**	
	Zero	05/01/22 06:43	10.0	0.0	-0.1		|R-A|/Span * 100	1.0
	High	05/01/22 06:48	10.0	8.9	8.7		|R-A|/Span * 100	2.0
Part 75	**CT1_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	High	05/01/22 06:43	21.0	18.3	18.4		|R-A|	0.1
	Zero	05/01/22 06:48	21.0	0.0	0.0		|R-A|	0.0
Part 60	**CT1_NOXInlet_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	Zero	05/02/22 02:14	200.0	0.0	0.1		|R-A|/Span * 100	0.1
	High	05/02/22 02:25	200.0	175.0	168.6	>1x Alert	|R-A|/Span * 100	3.2

Daily Calibration Results

CT1 and CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:50 **Location:** Roseville, CA

All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	**CT1_NOXInlet_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Warning**
	Zero	05/02/22 02:14	30.0	0.0	0.1		|R-A|/Span * 100	0.3
	High	05/02/22 02:20	30.0	27.3	25.3	>2x	|R-A|/Span * 100	6.7
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	05/02/22 03:14	200.0	0.0	0.1		|R-A|/Span * 100	0.1
	High	05/02/22 03:25	200.0	182.3	183.8		|R-A|/Span * 100	0.8
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	05/02/22 03:14	10.0	0.0	0.2		|R-A|/Span * 100	2.0
	High	05/02/22 03:20	10.0	9.0	9.0		|R-A|/Span * 100	0.0
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	05/02/22 03:14	200.0	0.0	-0.1		|R-A|/Span * 100	0.1
	High	05/02/22 03:25	200.0	175.0	174.5		|R-A|/Span * 100	0.3
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	05/02/22 03:14	10.0	0.0	-0.1		|R-A|/Span * 100	1.0
	High	05/02/22 03:20	10.0	8.9	8.8		|R-A|/Span * 100	1.0
Part 75	**CT1_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	High	05/02/22 03:14	21.0	18.3	18.4		|R-A|	0.1
	Zero	05/02/22 03:20	21.0	0.0	0.0		|R-A|	0.0
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	05/04/22 00:44	200.0	0.0	0.1		|R-A|/Span * 100	0.1
	High	05/04/22 00:54	200.0	182.3	184.2		|R-A|/Span * 100	1.0
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	05/04/22 00:44	10.0	0.0	0.2		|R-A|/Span * 100	2.0
	High	05/04/22 00:49	10.0	9.0	9.0		|R-A|/Span * 100	0.0
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	05/04/22 00:44	200.0	0.0	-0.1		|R-A|/Span * 100	0.1
	High	05/04/22 00:54	200.0	175.0	172.9		|R-A|/Span * 100	1.1
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	05/04/22 00:44	10.0	0.0	-0.1		|R-A|/Span * 100	1.0
	High	05/04/22 00:49	10.0	8.9	8.6	>1x Alert	|R-A|/Span * 100	3.0
Part 75	**CT1_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	High	05/04/22 00:44	21.0	18.3	18.4		|R-A|	0.1
	Zero	05/04/22 00:49	21.0	0.0	0.0		|R-A|	0.0
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	05/04/22 01:50	200.0	0.0	0.1		|R-A|/Span * 100	0.1
	High	05/04/22 02:01	200.0	184.1	185.0		|R-A|/Span * 100	0.5

Daily Calibration Results

CT1 and CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:50 **Location:** Roseville, CA

All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	05/04/22 01:50	10.0	0.0	0.1		|R-A|/Span * 100	1.0
	High	05/04/22 01:55	10.0	9.5	9.6		|R-A|/Span * 100	1.0
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	05/04/22 01:50	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/04/22 02:01	200.0	182.0	177.8		|R-A|/Span * 100	2.1
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	05/04/22 01:50	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/04/22 01:55	10.0	8.8	8.6		|R-A|/Span * 100	2.0
Part 75	**CT2_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	High	05/04/22 01:50	21.0	18.1	18.1		|R-A|	0.0
	Zero	05/04/22 01:55	21.0	0.0	0.0		|R-A|	0.0
Part 60	**CT1_NOXInlet_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	05/04/22 02:14	200.0	0.0	0.1		|R-A|/Span * 100	0.1
	High	05/04/22 02:25	200.0	175.0	168.9	>1x Alert	|R-A|/Span * 100	3.1
Part 60	**CT1_NOXInlet_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Warning**
	Zero	05/04/22 02:14	30.0	0.0	0.1		|R-A|/Span * 100	0.3
	High	05/04/22 02:20	30.0	27.3	25.5	>2x	|R-A|/Span * 100	6.0
Part 60	**CT2_NOXInlet_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	05/04/22 02:15	200.0	0.0	0.1		|R-A|/Span * 100	0.1
	High	05/04/22 02:25	200.0	182.0	180.9		|R-A|/Span * 100	0.6
Part 60	**CT2_NOXInlet_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	05/04/22 02:15	30.0	0.0	0.1		|R-A|/Span * 100	0.3
	High	05/04/22 02:20	30.0	27.5	27.2		|R-A|/Span * 100	1.0
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	05/04/22 07:28	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/04/22 07:38	200.0	182.3	183.6		|R-A|/Span * 100	0.7
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	05/04/22 07:28	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/04/22 07:33	10.0	9.0	9.0		|R-A|/Span * 100	0.0
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	05/04/22 07:28	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/04/22 07:38	200.0	175.0	174.9		|R-A|/Span * 100	0.1
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	05/04/22 07:28	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/04/22 07:33	10.0	8.9	9.0		|R-A|/Span * 100	1.0

Daily Calibration Results

CT1 and CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:50 **Location:** Roseville, CA

All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 75	**CT1_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	High	05/04/22 07:28	21.0	18.3	18.4		|R-A|	0.1
	Zero	05/04/22 07:33	21.0	0.0	0.0		|R-A|	0.0
Part 60	**CT1_NOXInlet_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	Zero	05/04/22 13:28	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/04/22 13:39	200.0	175.0	175.2		|R-A|/Span * 100	0.1
Part 60	**CT1_NOXInlet_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**	**Pass**	
	Zero	05/04/22 13:28	30.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/04/22 13:33	30.0	27.3	27.8		|R-A|/Span * 100	1.7
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	Zero	05/05/22 02:04	200.0	0.0	0.1		|R-A|/Span * 100	0.1
	High	05/05/22 02:15	200.0	184.1	185.1		|R-A|/Span * 100	0.5
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**	**Pass**	
	Zero	05/05/22 02:04	10.0	0.0	0.1		|R-A|/Span * 100	1.0
	High	05/05/22 02:10	10.0	9.5	9.7		|R-A|/Span * 100	2.0
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	Zero	05/05/22 02:04	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/05/22 02:15	200.0	182.0	177.9		|R-A|/Span * 100	2.1
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**	**Pass**	
	Zero	05/05/22 02:04	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/05/22 02:10	10.0	8.8	8.7		|R-A|/Span * 100	1.0
Part 75	**CT2_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	High	05/05/22 02:04	21.0	18.1	18.1		|R-A|	0.0
	Zero	05/05/22 02:10	21.0	0.0	0.0		|R-A|	0.0
Part 60	**CT1_NOXInlet_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	Zero	05/05/22 02:14	200.0	0.0	0.1		|R-A|/Span * 100	0.1
	High	05/05/22 02:24	200.0	175.0	175.0		|R-A|/Span * 100	0.0
Part 60	**CT1_NOXInlet_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**	**Pass**	
	Zero	05/05/22 02:14	30.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/05/22 02:19	30.0	27.3	27.7		|R-A|/Span * 100	1.3
Part 60	**CT2_NOXInlet_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	Zero	05/05/22 02:14	200.0	0.0	0.1		|R-A|/Span * 100	0.1
	High	05/05/22 02:24	200.0	182.0	176.5	>1x Alert	|R-A|/Span * 100	2.8
Part 60	**CT2_NOXInlet_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**	**Pass**	
	Zero	05/05/22 02:14	30.0	0.0	0.1		|R-A|/Span * 100	0.3
	High	05/05/22 02:19	30.0	27.5	26.2	>1x Alert	|R-A|/Span * 100	4.3

Daily Calibration Results

CT1 and CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:50 **Location:** Roseville, CA

All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	Zero	05/05/22 03:14	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/05/22 03:25	200.0	182.3	183.8		|R-A|/Span * 100	0.8
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**	**Pass**	
	Zero	05/05/22 03:14	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/05/22 03:20	10.0	9.0	9.0		|R-A|/Span * 100	0.0
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	Zero	05/05/22 03:14	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/05/22 03:25	200.0	175.0	175.0		|R-A|/Span * 100	0.0
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**	**Pass**	
	Zero	05/05/22 03:14	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/05/22 03:20	10.0	8.9	8.9		|R-A|/Span * 100	0.0
Part 75	**CT1_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	High	05/05/22 03:14	21.0	18.3	18.4		|R-A|	0.1
	Zero	05/05/22 03:20	21.0	0.0	0.0		|R-A|	0.0
Part 60	**CT1_NOXInlet_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	Zero	05/06/22 02:15	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/06/22 02:25	200.0	175.0	173.6		|R-A|/Span * 100	0.7
Part 60	**CT1_NOXInlet_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**	**Pass**	
	Zero	05/06/22 02:15	30.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/06/22 02:20	30.0	27.3	27.4		|R-A|/Span * 100	0.3
Part 60	**CT2_NOXInlet_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	Zero	05/06/22 02:14	200.0	0.0	0.1		|R-A|/Span * 100	0.1
	High	05/06/22 02:24	200.0	182.0	175.1	>1x Alert	|R-A|/Span * 100	3.5
Part 60	**CT2_NOXInlet_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**	**Pass**	
	Zero	05/06/22 02:14	30.0	0.0	0.1		|R-A|/Span * 100	0.3
	High	05/06/22 02:19	30.0	27.5	26.1	>1x Alert	|R-A|/Span * 100	4.7
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	Zero	05/06/22 02:19	200.0	0.0	0.1		|R-A|/Span * 100	0.1
	High	05/06/22 02:29	200.0	184.1	184.6		|R-A|/Span * 100	0.3
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**	**Pass**	
	Zero	05/06/22 02:19	10.0	0.0	0.1		|R-A|/Span * 100	1.0
	High	05/06/22 02:23	10.0	9.5	9.7		|R-A|/Span * 100	2.0
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	Zero	05/06/22 02:19	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/06/22 02:29	200.0	182.0	176.8	>1x Alert	|R-A|/Span * 100	2.6

Daily Calibration Results

CT1 and CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:50 **Location:** Roseville, CA

All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	05/06/22 02:19	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/06/22 02:23	10.0	8.8	8.6		|R-A|/Span * 100	2.0
Part 75	**CT2_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	High	05/06/22 02:19	21.0	18.1	18.1		|R-A|	0.0
	Zero	05/06/22 02:23	21.0	0.0	0.0		|R-A|	0.0
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	05/06/22 03:15	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/06/22 03:25	200.0	182.3	183.5		|R-A|/Span * 100	0.6
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	05/06/22 03:15	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/06/22 03:20	10.0	9.0	9.0		|R-A|/Span * 100	0.0
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	05/06/22 03:15	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/06/22 03:25	200.0	175.0	174.8		|R-A|/Span * 100	0.1
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	05/06/22 03:15	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/06/22 03:20	10.0	8.9	8.9		|R-A|/Span * 100	0.0
Part 75	**CT1_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	High	05/06/22 03:15	21.0	18.3	18.4		|R-A|	0.1
	Zero	05/06/22 03:20	21.0	0.0	0.0		|R-A|	0.0
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	05/06/22 07:26	200.0	0.0	0.1		|R-A|/Span * 100	0.1
	High	05/06/22 07:36	200.0	182.3	182.9		|R-A|/Span * 100	0.3
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	05/06/22 07:26	10.0	0.0	0.1		|R-A|/Span * 100	1.0
	High	05/06/22 07:32	10.0	9.5	9.7		|R-A|/Span * 100	2.0
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	05/06/22 07:26	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/06/22 07:36	200.0	176.0	175.6		|R-A|/Span * 100	0.2
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	05/06/22 07:26	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/06/22 07:32	10.0	8.8	8.8		|R-A|/Span * 100	0.0
Part 75	**CT2_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	High	05/06/22 07:26	21.0	18.1	18.1		|R-A|	0.0
	Zero	05/06/22 07:32	21.0	0.0	0.0		|R-A|	0.0

Daily Calibration Results

CT1 and CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:50 **Location:** Roseville, CA

All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	**CT2_NOXInlet_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	05/06/22 07:48	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/06/22 07:59	200.0	176.0	176.5		|R-A|/Span * 100	0.3
Part 60	**CT2_NOXInlet_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	05/06/22 07:48	30.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/06/22 07:53	30.0	27.5	27.6		|R-A|/Span * 100	0.3
Part 60	**CT1_NOXInlet_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	05/07/22 02:15	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/07/22 02:25	200.0	175.0	173.9		|R-A|/Span * 100	0.6
Part 60	**CT1_NOXInlet_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	05/07/22 02:15	30.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/07/22 02:20	30.0	27.3	27.5		|R-A|/Span * 100	0.7
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	05/07/22 03:14	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/07/22 03:25	200.0	182.3	183.8		|R-A|/Span * 100	0.8
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	05/07/22 03:14	10.0	0.0	0.1		|R-A|/Span * 100	1.0
	High	05/07/22 03:20	10.0	9.0	9.0		|R-A|/Span * 100	0.0
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	05/07/22 03:14	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/07/22 03:25	200.0	175.0	175.0		|R-A|/Span * 100	0.0
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	05/07/22 03:14	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/07/22 03:20	10.0	8.9	8.8		|R-A|/Span * 100	1.0
Part 75	**CT1_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	High	05/07/22 03:14	21.0	18.3	18.4		|R-A|	0.1
	Zero	05/07/22 03:20	21.0	0.0	0.0		|R-A|	0.0
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	05/07/22 14:48	200.0	0.0	0.1		|R-A|/Span * 100	0.1
	High	05/07/22 14:58	200.0	182.3	183.2		|R-A|/Span * 100	0.5
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	05/07/22 14:48	10.0	0.0	0.1		|R-A|/Span * 100	1.0
	High	05/07/22 14:53	10.0	9.5	9.6		|R-A|/Span * 100	1.0
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	05/07/22 14:48	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/07/22 14:58	200.0	176.0	176.7		|R-A|/Span * 100	0.4

Daily Calibration Results

CT1 and CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:50 **Location:** Roseville, CA

All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	05/07/22 14:48	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/07/22 14:53	10.0	8.8	8.9		|R-A|/Span * 100	1.0
Part 75	**CT2_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	High	05/07/22 14:48	21.0	18.1	18.1		|R-A|	0.0
	Zero	05/07/22 14:53	21.0	0.0	0.0		|R-A|	0.0
Part 60	**CT1_NOXInlet_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	05/08/22 02:14	200.0	0.0	0.1		|R-A|/Span * 100	0.1
	High	05/08/22 02:24	200.0	175.0	173.8		|R-A|/Span * 100	0.6
Part 60	**CT1_NOXInlet_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	05/08/22 02:14	30.0	0.0	0.1		|R-A|/Span * 100	0.3
	High	05/08/22 02:20	30.0	27.3	27.5		|R-A|/Span * 100	0.7
Part 60	**CT2_NOXInlet_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	05/08/22 02:14	200.0	0.0	0.1		|R-A|/Span * 100	0.1
	High	05/08/22 02:24	200.0	176.0	175.5		|R-A|/Span * 100	0.3
Part 60	**CT2_NOXInlet_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	05/08/22 02:14	30.0	0.0	0.1		|R-A|/Span * 100	0.3
	High	05/08/22 02:19	30.0	27.5	27.2		|R-A|/Span * 100	1.0
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	05/08/22 03:14	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/08/22 03:24	200.0	182.3	184.0		|R-A|/Span * 100	0.9
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	05/08/22 03:14	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/08/22 03:20	10.0	9.0	9.0		|R-A|/Span * 100	0.0
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	05/08/22 03:14	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/08/22 03:24	200.0	175.0	175.3		|R-A|/Span * 100	0.2
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	05/08/22 03:14	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/08/22 03:20	10.0	8.9	8.9		|R-A|/Span * 100	0.0
Part 75	**CT1_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	High	05/08/22 03:14	21.0	18.3	18.4		|R-A|	0.1
	Zero	05/08/22 03:20	21.0	0.0	0.0		|R-A|	0.0
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	05/08/22 03:14	200.0	0.0	0.1		|R-A|/Span * 100	0.1
	High	05/08/22 03:25	200.0	182.3	183.5		|R-A|/Span * 100	0.6

Daily Calibration Results

CT1 and CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:50 **Location:** Roseville, CA

All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	05/08/22 03:14	10.0	0.0	0.1		|R-A|/Span * 100	1.0
	High	05/08/22 03:20	10.0	9.5	9.7		|R-A|/Span * 100	2.0
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	05/08/22 03:14	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/08/22 03:25	200.0	176.0	176.5		|R-A|/Span * 100	0.3
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	05/08/22 03:14	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/08/22 03:20	10.0	8.8	8.8		|R-A|/Span * 100	0.0
Part 75	**CT2_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	High	05/08/22 03:14	21.0	18.1	18.1		|R-A|	0.0
	Zero	05/08/22 03:20	21.0	0.0	0.0		|R-A|	0.0
Part 60	**CT1_NOXInlet_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	05/09/22 02:15	200.0	0.0	0.1		|R-A|/Span * 100	0.1
	High	05/09/22 02:25	200.0	175.0	174.1		|R-A|/Span * 100	0.5
Part 60	**CT1_NOXInlet_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	05/09/22 02:15	30.0	0.0	0.1		|R-A|/Span * 100	0.3
	High	05/09/22 02:19	30.0	27.3	27.5		|R-A|/Span * 100	0.7
Part 60	**CT2_NOXInlet_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	05/09/22 02:14	200.0	0.0	0.1		|R-A|/Span * 100	0.1
	High	05/09/22 02:24	200.0	176.0	175.5		|R-A|/Span * 100	0.3
Part 60	**CT2_NOXInlet_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	05/09/22 02:14	30.0	0.0	0.1		|R-A|/Span * 100	0.3
	High	05/09/22 02:19	30.0	27.5	27.3		|R-A|/Span * 100	0.7
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	05/09/22 03:15	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/09/22 03:25	200.0	182.3	183.9		|R-A|/Span * 100	0.8
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	05/09/22 03:15	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/09/22 03:20	10.0	9.0	9.0		|R-A|/Span * 100	0.0
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	05/09/22 03:15	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/09/22 03:25	200.0	175.0	174.8		|R-A|/Span * 100	0.1
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	05/09/22 03:15	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/09/22 03:20	10.0	8.9	8.9		|R-A|/Span * 100	0.0

Daily Calibration Results

CT1 and CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:50 **Location:** Roseville, CA

All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 75	**CT1_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	High	05/09/22 03:15	21.0	18.3	18.4		|R-A|	0.1
	Zero	05/09/22 03:20	21.0	0.0	0.0		|R-A|	0.0
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	05/09/22 03:15	200.0	0.0	0.1		|R-A|/Span * 100	0.1
	High	05/09/22 03:25	200.0	182.3	183.8		|R-A|/Span * 100	0.8
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	05/09/22 03:15	10.0	0.0	0.1		|R-A|/Span * 100	1.0
	High	05/09/22 03:20	10.0	9.5	9.7		|R-A|/Span * 100	2.0
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	05/09/22 03:15	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/09/22 03:25	200.0	176.0	176.4		|R-A|/Span * 100	0.2
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	05/09/22 03:15	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/09/22 03:20	10.0	8.8	8.8		|R-A|/Span * 100	0.0
Part 75	**CT2_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	High	05/09/22 03:15	21.0	18.1	18.1		|R-A|	0.0
	Zero	05/09/22 03:20	21.0	0.0	0.0		|R-A|	0.0
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	05/17/22 17:27	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/17/22 17:37	200.0	182.3	182.4		|R-A|/Span * 100	0.1
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	05/17/22 17:27	10.0	0.0	0.1		|R-A|/Span * 100	1.0
	High	05/17/22 17:32	10.0	9.0	9.0		|R-A|/Span * 100	0.0
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	05/17/22 17:27	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/17/22 17:37	200.0	175.0	173.9		|R-A|/Span * 100	0.6
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	05/17/22 17:27	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/17/22 17:32	10.0	8.9	9.0		|R-A|/Span * 100	1.0
Part 75	**CT1_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	High	05/17/22 17:27	21.0	18.3	18.4		|R-A|	0.1
	Zero	05/17/22 17:32	21.0	0.0	0.0		|R-A|	0.0
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	05/17/22 19:25	200.0	0.0	0.1		|R-A|/Span * 100	0.1
	High	05/17/22 19:35	200.0	182.3	181.7		|R-A|/Span * 100	0.3

Daily Calibration Results

CT1 and CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:50 **Location:** Roseville, CA

All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**				**Calibration Result: Online**	**Pass**
	Zero	05/17/22 19:25	10.0	0.0	0.1		|R-A|/Span * 100	1.0
	High	05/17/22 19:31	10.0	9.5	9.6		|R-A|/Span * 100	1.0
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**				**Calibration Result: Online**	**Pass**
	Zero	05/17/22 19:25	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/17/22 19:35	200.0	176.0	176.1		|R-A|/Span * 100	0.1
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**				**Calibration Result: Online**	**Pass**
	Zero	05/17/22 19:25	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/17/22 19:31	10.0	8.8	8.8		|R-A|/Span * 100	0.0
Part 75	**CT2_O2D_P_Instrument**	**Used For QA**	**Range: High**				**Calibration Result: Online**	**Pass**
	High	05/17/22 19:25	21.0	18.1	18.1		|R-A|	0.0
	Zero	05/17/22 19:31	21.0	0.0	0.0		|R-A|	0.0
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: High**				**Calibration Result: Online**	**Pass**
	Zero	05/17/22 22:23	200.0	0.0	0.1		|R-A|/Span * 100	0.1
	High	05/17/22 22:34	200.0	182.3	182.9		|R-A|/Span * 100	0.3
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**				**Calibration Result: Online**	**Pass**
	Zero	05/17/22 22:23	10.0	0.0	0.2		|R-A|/Span * 100	2.0
	High	05/17/22 22:29	10.0	9.5	9.6		|R-A|/Span * 100	1.0
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**				**Calibration Result: Online**	**Pass**
	Zero	05/17/22 22:23	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/17/22 22:34	200.0	176.0	175.8		|R-A|/Span * 100	0.1
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**				**Calibration Result: Online**	**Pass**
	Zero	05/17/22 22:23	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/17/22 22:29	10.0	8.8	8.8		|R-A|/Span * 100	0.0
Part 75	**CT2_O2D_P_Instrument**	**Used For QA**	**Range: High**				**Calibration Result: Online**	**Pass**
	High	05/17/22 22:23	21.0	18.1	18.1		|R-A|	0.0
	Zero	05/17/22 22:29	21.0	0.0	0.0		|R-A|	0.0
Part 60	**CT1_NOXInlet_P_Instrument**	**Used For QA**	**Range: High**				**Calibration Result: Online**	**Pass**
	Zero	05/18/22 02:14	200.0	0.0	0.1		|R-A|/Span * 100	0.1
	High	05/18/22 02:25	200.0	175.0	168.1	>1x Alert	|R-A|/Span * 100	3.5
Part 60	**CT1_NOXInlet_P_Instrument**	**Used For QA**	**Range: Low**				**Calibration Result: Online**	**Warning**
	Zero	05/18/22 02:14	30.0	0.0	0.1		|R-A|/Span * 100	0.3
	High	05/18/22 02:19	30.0	27.3	25.6	>2x	|R-A|/Span * 100	5.7
Part 60	**CT2_NOXInlet_P_Instrument**	**Used For QA**	**Range: High**				**Calibration Result: Online**	**Pass**
	Zero	05/18/22 02:14	200.0	0.0	-0.1		|R-A|/Span * 100	0.1
	High	05/18/22 02:25	200.0	176.0	177.4		|R-A|/Span * 100	0.7

Daily Calibration Results

CT1 and CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:50 **Location:** Roseville, CA

All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	**CT2_NOXInlet_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	05/18/22 02:14	30.0	0.0	-0.1		|R-A|/Span * 100	0.3
	High	05/18/22 02:19	30.0	27.5	27.7		|R-A|/Span * 100	0.7
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	05/18/22 03:14	200.0	0.0	0.1		|R-A|/Span * 100	0.1
	High	05/18/22 03:25	200.0	182.3	182.4		|R-A|/Span * 100	0.1
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	05/18/22 03:14	10.0	0.0	0.1		|R-A|/Span * 100	1.0
	High	05/18/22 03:20	10.0	9.0	9.0		|R-A|/Span * 100	0.0
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	05/18/22 03:14	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/18/22 03:25	200.0	175.0	175.0		|R-A|/Span * 100	0.0
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	05/18/22 03:14	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/18/22 03:20	10.0	8.9	9.1		|R-A|/Span * 100	2.0
Part 75	**CT1_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	High	05/18/22 03:14	21.0	18.3	18.4		|R-A|	0.1
	Zero	05/18/22 03:20	21.0	0.0	0.0		|R-A|	0.0
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	05/18/22 03:15	200.0	0.0	0.1		|R-A|/Span * 100	0.1
	High	05/18/22 03:25	200.0	182.3	182.2		|R-A|/Span * 100	0.1
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	05/18/22 03:15	10.0	0.0	0.2		|R-A|/Span * 100	2.0
	High	05/18/22 03:20	10.0	9.5	9.6		|R-A|/Span * 100	1.0
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	05/18/22 03:15	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/18/22 03:25	200.0	176.0	175.8		|R-A|/Span * 100	0.1
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	05/18/22 03:15	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/18/22 03:20	10.0	8.8	8.8		|R-A|/Span * 100	0.0
Part 75	**CT2_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	High	05/18/22 03:15	21.0	18.1	18.1		|R-A|	0.0
	Zero	05/18/22 03:20	21.0	0.0	0.0		|R-A|	0.0
Part 60	**CT2_NOXInlet_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	05/19/22 02:14	200.0	0.0	-0.1		|R-A|/Span * 100	0.1
	High	05/19/22 02:25	200.0	176.0	176.9		|R-A|/Span * 100	0.5

Daily Calibration Results

CT1 and CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:50 **Location:** Roseville, CA

All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	**CT2_NOXInlet_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	05/19/22 02:14	30.0	0.0	-0.1		|R-A|/Span * 100	0.3
	High	05/19/22 02:20	30.0	27.5	27.6		|R-A|/Span * 100	0.3
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	05/19/22 03:14	200.0	0.0	0.1		|R-A|/Span * 100	0.1
	High	05/19/22 03:25	200.0	182.3	182.2		|R-A|/Span * 100	0.1
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	05/19/22 03:14	10.0	0.0	0.1		|R-A|/Span * 100	1.0
	High	05/19/22 03:19	10.0	9.5	9.6		|R-A|/Span * 100	1.0
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	05/19/22 03:14	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/19/22 03:25	200.0	176.0	175.7		|R-A|/Span * 100	0.2
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	05/19/22 03:14	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/19/22 03:19	10.0	8.8	8.8		|R-A|/Span * 100	0.0
Part 75	**CT2_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	High	05/19/22 03:14	21.0	18.1	18.1		|R-A|	0.0
	Zero	05/19/22 03:19	21.0	0.0	0.0		|R-A|	0.0
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	05/19/22 14:29	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/19/22 14:40	200.0	182.3	183.1		|R-A|/Span * 100	0.4
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	05/19/22 14:29	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/19/22 14:34	10.0	9.0	9.0		|R-A|/Span * 100	0.0
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	05/19/22 14:29	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/19/22 14:40	200.0	175.0	174.5		|R-A|/Span * 100	0.3
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	05/19/22 14:29	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/19/22 14:34	10.0	8.9	9.0		|R-A|/Span * 100	1.0
Part 75	**CT1_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	High	05/19/22 14:29	21.0	18.3	18.4		|R-A|	0.1
	Zero	05/19/22 14:34	21.0	0.0	0.0		|R-A|	0.0
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	05/24/22 05:44	200.0	0.0	0.1		|R-A|/Span * 100	0.1
	High	05/24/22 05:55	200.0	182.3	181.3		|R-A|/Span * 100	0.5

Daily Calibration Results

CT1 and CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:50 **Location:** Roseville, CA

All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**	**Pass**	
	Zero	05/24/22 05:44	10.0	0.0	0.2		|R-A|/Span * 100	2.0
	High	05/24/22 05:50	10.0	9.5	9.9		|R-A|/Span * 100	4.0
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	Zero	05/24/22 05:44	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/24/22 05:55	200.0	176.0	175.5		|R-A|/Span * 100	0.3
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**	**Pass**	
	Zero	05/24/22 05:44	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/24/22 05:50	10.0	8.8	8.8		|R-A|/Span * 100	0.0
Part 75	**CT2_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	High	05/24/22 05:44	21.0	18.1	18.1		|R-A|	0.0
	Zero	05/24/22 05:50	21.0	0.0	0.0		|R-A|	0.0
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	Zero	05/24/22 10:14	200.0	0.0	0.1		|R-A|/Span * 100	0.1
	High	05/24/22 10:25	200.0	182.3	182.9		|R-A|/Span * 100	0.3
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**	**Pass**	
	Zero	05/24/22 10:14	10.0	0.0	0.1		|R-A|/Span * 100	1.0
	High	05/24/22 10:20	10.0	9.0	9.0		|R-A|/Span * 100	0.0
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	Zero	05/24/22 10:14	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/24/22 10:25	200.0	175.0	174.3		|R-A|/Span * 100	0.4
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**	**Pass**	
	Zero	05/24/22 10:14	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/24/22 10:20	10.0	8.9	9.0		|R-A|/Span * 100	1.0
Part 75	**CT1_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	High	05/24/22 10:14	21.0	18.3	18.4		|R-A|	0.1
	Zero	05/24/22 10:20	21.0	0.0	0.0		|R-A|	0.0
Part 60	**CT1_NOXInlet_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	Zero	05/25/22 02:15	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/25/22 02:25	200.0	175.0	174.5		|R-A|/Span * 100	0.3
Part 60	**CT1_NOXInlet_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**	**Pass**	
	Zero	05/25/22 02:15	30.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/25/22 02:19	30.0	27.3	27.0		|R-A|/Span * 100	1.0
Part 60	**CT2_NOXInlet_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	Zero	05/25/22 02:14	200.0	0.0	-0.1		|R-A|/Span * 100	0.1
	High	05/25/22 02:25	200.0	176.0	179.1		|R-A|/Span * 100	1.6

Daily Calibration Results

CT1 and CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:50 **Location:** Roseville, CA

All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	**CT2_NOXInlet_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	05/25/22 02:14	30.0	0.0	-0.1		|R-A|/Span * 100	0.3
	High	05/25/22 02:19	30.0	27.5	28.0		|R-A|/Span * 100	1.7
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	05/25/22 03:14	200.0	0.0	0.1		|R-A|/Span * 100	0.1
	High	05/25/22 03:24	200.0	182.3	183.6		|R-A|/Span * 100	0.7
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	05/25/22 03:14	10.0	0.0	0.1		|R-A|/Span * 100	1.0
	High	05/25/22 03:19	10.0	9.0	9.0		|R-A|/Span * 100	0.0
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	05/25/22 03:14	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/25/22 03:24	200.0	175.0	175.1		|R-A|/Span * 100	0.1
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	05/25/22 03:14	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/25/22 03:19	10.0	8.9	9.0		|R-A|/Span * 100	1.0
Part 75	**CT1_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	High	05/25/22 03:14	21.0	18.3	18.4		|R-A|	0.1
	Zero	05/25/22 03:19	21.0	0.0	0.0		|R-A|	0.0
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	05/25/22 03:15	200.0	0.0	0.1		|R-A|/Span * 100	0.1
	High	05/25/22 03:25	200.0	182.3	181.1		|R-A|/Span * 100	0.6
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	05/25/22 03:15	10.0	0.0	0.2		|R-A|/Span * 100	2.0
	High	05/25/22 03:20	10.0	9.5	9.8		|R-A|/Span * 100	3.0
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	05/25/22 03:15	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/25/22 03:25	200.0	176.0	175.0		|R-A|/Span * 100	0.5
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	05/25/22 03:15	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/25/22 03:20	10.0	8.8	8.8		|R-A|/Span * 100	0.0
Part 75	**CT2_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	High	05/25/22 03:15	21.0	18.1	18.1		|R-A|	0.0
	Zero	05/25/22 03:20	21.0	0.0	0.0		|R-A|	0.0
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	05/26/22 13:44	200.0	0.0	0.1		|R-A|/Span * 100	0.1
	High	05/26/22 13:54	200.0	182.3	183.2		|R-A|/Span * 100	0.5

Daily Calibration Results

CT1 and CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:50 **Location:** Roseville, CA

All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**				**Calibration Result: Online**	**Pass**
	Zero	05/26/22 13:44	10.0	0.0	0.1		|R-A|/Span * 100	1.0
	High	05/26/22 13:48	10.0	9.0	9.0		|R-A|/Span * 100	0.0
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**				**Calibration Result: Online**	**Pass**
	Zero	05/26/22 13:44	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/26/22 13:54	200.0	175.0	174.0		|R-A|/Span * 100	0.5
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**				**Calibration Result: Online**	**Pass**
	Zero	05/26/22 13:44	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	05/26/22 13:48	10.0	8.9	8.9		|R-A|/Span * 100	0.0
Part 75	**CT1_O2D_P_Instrument**	**Used For QA**	**Range: High**				**Calibration Result: Online**	**Pass**
	High	05/26/22 13:44	21.0	18.3	18.4		|R-A|	0.1
	Zero	05/26/22 13:48	21.0	0.0	0.0		|R-A|	0.0
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: High**				**Calibration Result: Online**	**Pass**
	Zero	06/06/22 15:44	200.0	0.0	0.1		|R-A|/Span * 100	0.1
	High	06/06/22 15:54	200.0	182.3	182.8		|R-A|/Span * 100	0.3
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**				**Calibration Result: Online**	**Pass**
	Zero	06/06/22 15:44	10.0	0.0	0.1		|R-A|/Span * 100	1.0
	High	06/06/22 15:49	10.0	9.0	9.0		|R-A|/Span * 100	0.0
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**				**Calibration Result: Online**	**Pass**
	Zero	06/06/22 15:44	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/06/22 15:54	200.0	175.0	174.8		|R-A|/Span * 100	0.1
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**				**Calibration Result: Online**	**Pass**
	Zero	06/06/22 15:44	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/06/22 15:49	10.0	8.9	9.0		|R-A|/Span * 100	1.0
Part 75	**CT1_O2D_P_Instrument**	**Used For QA**	**Range: High**				**Calibration Result: Online**	**Pass**
	High	06/06/22 15:44	21.0	18.3	18.4		|R-A|	0.1
	Zero	06/06/22 15:49	21.0	0.0	0.0		|R-A|	0.0
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: High**				**Calibration Result: Online**	**Pass**
	Zero	06/07/22 13:21	200.0	0.0	3.5		|R-A|/Span * 100	1.8
	High	06/07/22 13:32	200.0	182.3	179.4		|R-A|/Span * 100	1.5
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**				**Calibration Result: Online**	**Fail**
	Zero	06/07/22 13:21	10.0	0.0	42.2	>4x	|R-A|/Span * 100	422.0
	High	06/07/22 13:26	10.0	9.6	32.4	>4x	|R-A|/Span * 100	228.0
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**				**Calibration Result: Online**	**Pass**
	Zero	06/07/22 13:21	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/07/22 13:32	200.0	176.0	174.8		|R-A|/Span * 100	0.6

Daily Calibration Results

CT1 and CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:50 **Location:** Roseville, CA

All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/07/22 13:21	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/07/22 13:26	10.0	8.8	8.8		|R-A|/Span * 100	0.0
Part 75	**CT2_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	High	06/07/22 13:21	21.0	18.1	18.1		|R-A|	0.0
	Zero	06/07/22 13:26	21.0	0.0	0.0		|R-A|	0.0
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/07/22 19:35	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/07/22 19:46	200.0	182.3	182.2		|R-A|/Span * 100	0.1
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/07/22 19:35	10.0	0.0	0.1		|R-A|/Span * 100	1.0
	High	06/07/22 19:41	10.0	9.6	9.5		|R-A|/Span * 100	1.0
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/07/22 19:35	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/07/22 19:46	200.0	176.0	174.8		|R-A|/Span * 100	0.6
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/07/22 19:35	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/07/22 19:41	10.0	8.8	8.8		|R-A|/Span * 100	0.0
Part 75	**CT2_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	High	06/07/22 19:35	21.0	18.0	18.0		|R-A|	0.0
	Zero	06/07/22 19:41	21.0	0.0	0.0		|R-A|	0.0
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/08/22 05:48	200.0	0.0	0.1		|R-A|/Span * 100	0.1
	High	06/08/22 05:59	200.0	182.3	183.3		|R-A|/Span * 100	0.5
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/08/22 05:48	10.0	0.0	0.1		|R-A|/Span * 100	1.0
	High	06/08/22 05:54	10.0	9.0	9.0		|R-A|/Span * 100	0.0
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/08/22 05:48	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/08/22 05:59	200.0	175.0	174.7		|R-A|/Span * 100	0.2
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/08/22 05:48	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/08/22 05:54	10.0	8.9	8.9		|R-A|/Span * 100	0.0
Part 75	**CT1_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	High	06/08/22 05:48	21.0	18.3	18.4		|R-A|	0.1
	Zero	06/08/22 05:54	21.0	0.0	0.0		|R-A|	0.0

Daily Calibration Results

CT1 and CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:50 **Location:** Roseville, CA

All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	Zero	06/08/22 15:36	200.0	0.0	0.1		|R-A|/Span * 100	0.1
	High	06/08/22 15:47	200.0	182.3	182.2		|R-A|/Span * 100	0.1
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**	**Pass**	
	Zero	06/08/22 15:36	10.0	0.0	0.1		|R-A|/Span * 100	1.0
	High	06/08/22 15:41	10.0	9.6	9.5		|R-A|/Span * 100	1.0
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	Zero	06/08/22 15:36	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/08/22 15:47	200.0	176.0	174.5		|R-A|/Span * 100	0.8
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**	**Pass**	
	Zero	06/08/22 15:36	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/08/22 15:41	10.0	8.8	8.7		|R-A|/Span * 100	1.0
Part 75	**CT2_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	High	06/08/22 15:36	21.0	18.0	18.0		|R-A|	0.0
	Zero	06/08/22 15:41	21.0	0.0	0.0		|R-A|	0.0
Part 60	**CT1_NOXInlet_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	Zero	06/09/22 02:14	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/09/22 02:25	200.0	175.0	173.6		|R-A|/Span * 100	0.7
Part 60	**CT1_NOXInlet_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**	**Pass**	
	Zero	06/09/22 02:14	30.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/09/22 02:19	30.0	27.3	26.6		|R-A|/Span * 100	2.3
Part 60	**CT2_NOXInlet_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	Zero	06/09/22 02:15	200.0	0.0	-0.1		|R-A|/Span * 100	0.1
	High	06/09/22 02:25	200.0	176.0	179.8		|R-A|/Span * 100	1.9
Part 60	**CT2_NOXInlet_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**	**Pass**	
	Zero	06/09/22 02:15	30.0	0.0	-0.1		|R-A|/Span * 100	0.3
	High	06/09/22 02:20	30.0	27.5	28.0		|R-A|/Span * 100	1.7
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	Zero	06/09/22 03:15	200.0	0.0	0.1		|R-A|/Span * 100	0.1
	High	06/09/22 03:25	200.0	182.3	183.2		|R-A|/Span * 100	0.5
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**	**Pass**	
	Zero	06/09/22 03:15	10.0	0.0	0.1		|R-A|/Span * 100	1.0
	High	06/09/22 03:20	10.0	9.0	9.1		|R-A|/Span * 100	1.0
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	Zero	06/09/22 03:15	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/09/22 03:25	200.0	175.0	175.3		|R-A|/Span * 100	0.2

Daily Calibration Results

CT1 and CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:50 **Location:** Roseville, CA

All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/09/22 03:15	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/09/22 03:20	10.0	8.9	9.0		|R-A|/Span * 100	1.0
Part 75	**CT1_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	High	06/09/22 03:15	21.0	18.3	18.4		|R-A|	0.1
	Zero	06/09/22 03:20	21.0	0.0	0.0		|R-A|	0.0
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/09/22 11:31	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/09/22 11:42	200.0	182.3	182.4		|R-A|/Span * 100	0.1
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/09/22 11:31	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/09/22 11:36	10.0	9.6	9.5		|R-A|/Span * 100	1.0
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/09/22 11:31	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/09/22 11:42	200.0	176.0	174.0		|R-A|/Span * 100	1.0
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/09/22 11:31	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/09/22 11:36	10.0	8.8	8.7		|R-A|/Span * 100	1.0
Part 75	**CT2_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	High	06/09/22 11:31	21.0	18.0	18.0		|R-A|	0.0
	Zero	06/09/22 11:36	21.0	0.0	0.0		|R-A|	0.0
Part 60	**CT1_NOXInlet_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/10/22 02:14	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/10/22 02:25	200.0	175.0	172.8		|R-A|/Span * 100	1.1
Part 60	**CT1_NOXInlet_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/10/22 02:14	30.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/10/22 02:19	30.0	27.3	26.6		|R-A|/Span * 100	2.3
Part 60	**CT2_NOXInlet_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/10/22 02:14	200.0	0.0	-0.1		|R-A|/Span * 100	0.1
	High	06/10/22 02:25	200.0	176.0	178.7		|R-A|/Span * 100	1.4
Part 60	**CT2_NOXInlet_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/10/22 02:14	30.0	0.0	-0.1		|R-A|/Span * 100	0.3
	High	06/10/22 02:20	30.0	27.5	27.8		|R-A|/Span * 100	1.0
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/10/22 03:15	200.0	0.0	0.1		|R-A|/Span * 100	0.1
	High	06/10/22 03:25	200.0	182.3	183.2		|R-A|/Span * 100	0.5

Daily Calibration Results

CT1 and CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:50 **Location:** Roseville, CA

All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/10/22 03:15	10.0	0.0	0.1		|R-A|/Span * 100	1.0
	High	06/10/22 03:19	10.0	9.0	9.1		|R-A|/Span * 100	1.0
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/10/22 03:15	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/10/22 03:25	200.0	175.0	175.1		|R-A|/Span * 100	0.1
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/10/22 03:15	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/10/22 03:19	10.0	8.9	9.0		|R-A|/Span * 100	1.0
Part 75	**CT1_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	High	06/10/22 03:15	21.0	18.3	18.4		|R-A|	0.1
	Zero	06/10/22 03:19	21.0	0.0	0.0		|R-A|	0.0
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/10/22 03:15	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/10/22 03:25	200.0	182.3	181.8		|R-A|/Span * 100	0.3
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/10/22 03:15	10.0	0.0	0.1		|R-A|/Span * 100	1.0
	High	06/10/22 03:20	10.0	9.6	9.5		|R-A|/Span * 100	1.0
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/10/22 03:15	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/10/22 03:25	200.0	176.0	173.6		|R-A|/Span * 100	1.2
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/10/22 03:15	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/10/22 03:20	10.0	8.8	8.7		|R-A|/Span * 100	1.0
Part 75	**CT2_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	High	06/10/22 03:15	21.0	18.0	18.0		|R-A|	0.0
	Zero	06/10/22 03:20	21.0	0.0	0.0		|R-A|	0.0
Part 60	**CT1_NOXInlet_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/11/22 02:14	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/11/22 02:24	200.0	175.0	172.6		|R-A|/Span * 100	1.2
Part 60	**CT1_NOXInlet_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/11/22 02:14	30.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/11/22 02:20	30.0	27.3	26.7		|R-A|/Span * 100	2.0
Part 60	**CT2_NOXInlet_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/11/22 02:14	200.0	0.0	-0.1		|R-A|/Span * 100	0.1
	High	06/11/22 02:24	200.0	176.0	178.3		|R-A|/Span * 100	1.2

Daily Calibration Results

CT1 and CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:50 **Location:** Roseville, CA

All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	**CT2_NOXInlet_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/11/22 02:14	30.0	0.0	-0.1		|R-A|/Span * 100	0.3
	High	06/11/22 02:19	30.0	27.5	27.8		|R-A|/Span * 100	1.0
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/11/22 03:14	200.0	0.0	0.1		|R-A|/Span * 100	0.1
	High	06/11/22 03:24	200.0	182.3	183.2		|R-A|/Span * 100	0.5
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/11/22 03:14	10.0	0.0	0.1		|R-A|/Span * 100	1.0
	High	06/11/22 03:19	10.0	9.0	9.1		|R-A|/Span * 100	1.0
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/11/22 03:14	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/11/22 03:24	200.0	175.0	175.1		|R-A|/Span * 100	0.1
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/11/22 03:14	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/11/22 03:19	10.0	8.9	9.0		|R-A|/Span * 100	1.0
Part 75	**CT1_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	High	06/11/22 03:14	21.0	18.3	18.4		|R-A|	0.1
	Zero	06/11/22 03:19	21.0	0.0	0.0		|R-A|	0.0
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/11/22 03:15	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/11/22 03:25	200.0	182.3	182.2		|R-A|/Span * 100	0.1
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/11/22 03:15	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/11/22 03:20	10.0	9.6	9.5		|R-A|/Span * 100	1.0
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/11/22 03:15	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/11/22 03:25	200.0	176.0	172.9		|R-A|/Span * 100	1.6
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/11/22 03:15	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/11/22 03:20	10.0	8.8	8.7		|R-A|/Span * 100	1.0
Part 75	**CT2_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	High	06/11/22 03:15	21.0	18.0	18.0		|R-A|	0.0
	Zero	06/11/22 03:20	21.0	0.0	0.0		|R-A|	0.0
Part 60	**CT1_NOXInlet_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/12/22 02:15	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/12/22 02:25	200.0	175.0	172.6		|R-A|/Span * 100	1.2

Daily Calibration Results

CT1 and CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:50 **Location:** Roseville, CA

All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	**CT1_NOXInlet_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/12/22 02:15	30.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/12/22 02:20	30.0	27.3	26.6		|R-A|/Span * 100	2.3
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/12/22 03:14	200.0	0.0	0.1		|R-A|/Span * 100	0.1
	High	06/12/22 03:24	200.0	182.3	183.5		|R-A|/Span * 100	0.6
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/12/22 03:14	10.0	0.0	0.1		|R-A|/Span * 100	1.0
	High	06/12/22 03:19	10.0	9.0	9.1		|R-A|/Span * 100	1.0
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/12/22 03:14	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/12/22 03:24	200.0	175.0	175.1		|R-A|/Span * 100	0.1
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/12/22 03:14	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/12/22 03:19	10.0	8.9	9.0		|R-A|/Span * 100	1.0
Part 75	**CT1_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	High	06/12/22 03:14	21.0	18.3	18.4		|R-A|	0.1
	Zero	06/12/22 03:19	21.0	0.0	0.0		|R-A|	0.0
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/12/22 14:27	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/12/22 14:37	200.0	182.3	182.6		|R-A|/Span * 100	0.2
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/12/22 14:27	10.0	0.0	0.1		|R-A|/Span * 100	1.0
	High	06/12/22 14:32	10.0	9.6	9.4		|R-A|/Span * 100	2.0
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/12/22 14:27	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/12/22 14:37	200.0	176.0	172.9		|R-A|/Span * 100	1.6
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/12/22 14:27	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/12/22 14:32	10.0	8.8	8.6		|R-A|/Span * 100	2.0
Part 75	**CT2_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	High	06/12/22 14:27	21.0	18.0	18.0		|R-A|	0.0
	Zero	06/12/22 14:32	21.0	0.0	0.0		|R-A|	0.0
Part 60	**CT1_NOXInlet_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/13/22 02:15	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/13/22 02:25	200.0	175.0	173.7		|R-A|/Span * 100	0.7

Daily Calibration Results

CT1 and CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:50 **Location:** Roseville, CA

All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	**CT1_NOXInlet_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/13/22 02:15	30.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/13/22 02:20	30.0	27.3	26.7		|R-A|/Span * 100	2.0
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/13/22 03:14	200.0	0.0	0.1		|R-A|/Span * 100	0.1
	High	06/13/22 03:25	200.0	182.3	182.9		|R-A|/Span * 100	0.3
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/13/22 03:14	10.0	0.0	0.1		|R-A|/Span * 100	1.0
	High	06/13/22 03:20	10.0	9.0	9.0		|R-A|/Span * 100	0.0
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/13/22 03:14	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/13/22 03:25	200.0	175.0	175.0		|R-A|/Span * 100	0.0
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/13/22 03:14	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/13/22 03:20	10.0	8.9	9.0		|R-A|/Span * 100	1.0
Part 75	**CT1_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	High	06/13/22 03:14	21.0	18.3	18.4		|R-A|	0.1
	Zero	06/13/22 03:20	21.0	0.0	0.0		|R-A|	0.0
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/13/22 20:16	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/13/22 20:26	200.0	182.3	180.8		|R-A|/Span * 100	0.8
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/13/22 20:16	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/13/22 20:20	10.0	9.6	9.4		|R-A|/Span * 100	2.0
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/13/22 20:16	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/13/22 20:26	200.0	176.0	174.0		|R-A|/Span * 100	1.0
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/13/22 20:16	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/13/22 20:20	10.0	8.8	8.7		|R-A|/Span * 100	1.0
Part 75	**CT2_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	High	06/13/22 20:16	21.0	18.0	18.0		|R-A|	0.0
	Zero	06/13/22 20:20	21.0	0.0	0.0		|R-A|	0.0
Part 60	**CT1_NOXInlet_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/14/22 02:15	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/14/22 02:25	200.0	175.0	173.3		|R-A|/Span * 100	0.9

Daily Calibration Results

CT1 and CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:50 **Location:** Roseville, CA

All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	**CT1_NOXInlet_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/14/22 02:15	30.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/14/22 02:20	30.0	27.3	26.9		|R-A|/Span * 100	1.3
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/14/22 03:14	200.0	0.0	0.1		|R-A|/Span * 100	0.1
	High	06/14/22 03:24	200.0	182.3	182.6		|R-A|/Span * 100	0.2
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/14/22 03:14	10.0	0.0	0.1		|R-A|/Span * 100	1.0
	High	06/14/22 03:20	10.0	9.0	9.0		|R-A|/Span * 100	0.0
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/14/22 03:14	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/14/22 03:24	200.0	175.0	174.5		|R-A|/Span * 100	0.3
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/14/22 03:14	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/14/22 03:20	10.0	8.9	9.0		|R-A|/Span * 100	1.0
Part 75	**CT1_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	High	06/14/22 03:14	21.0	18.3	18.4		|R-A|	0.1
	Zero	06/14/22 03:20	21.0	0.0	0.0		|R-A|	0.0
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/14/22 19:50	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/14/22 20:00	200.0	182.3	180.7		|R-A|/Span * 100	0.8
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/14/22 19:50	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/14/22 19:55	10.0	9.6	9.4		|R-A|/Span * 100	2.0
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/14/22 19:50	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/14/22 20:00	200.0	176.0	174.6		|R-A|/Span * 100	0.7
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/14/22 19:50	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/14/22 19:55	10.0	8.8	8.7		|R-A|/Span * 100	1.0
Part 75	**CT2_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	High	06/14/22 19:50	21.0	18.0	18.0		|R-A|	0.0
	Zero	06/14/22 19:55	21.0	0.0	0.0		|R-A|	0.0
Part 60	**CT1_NOXInlet_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/15/22 02:15	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/15/22 02:25	200.0	175.0	172.7		|R-A|/Span * 100	1.2

Daily Calibration Results

CT1 and CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:50 **Location:** Roseville, CA

All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	**CT1_NOXInlet_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/15/22 02:15	30.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/15/22 02:20	30.0	27.3	26.7		|R-A|/Span * 100	2.0
Part 60	**CT2_NOXInlet_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/15/22 02:15	200.0	0.0	-0.1		|R-A|/Span * 100	0.1
	High	06/15/22 02:25	200.0	176.0	178.4		|R-A|/Span * 100	1.2
Part 60	**CT2_NOXInlet_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/15/22 02:15	30.0	0.0	-0.1		|R-A|/Span * 100	0.3
	High	06/15/22 02:20	30.0	27.5	27.8		|R-A|/Span * 100	1.0
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/15/22 03:14	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/15/22 03:24	200.0	182.3	182.9		|R-A|/Span * 100	0.3
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/15/22 03:14	10.0	0.0	0.1		|R-A|/Span * 100	1.0
	High	06/15/22 03:19	10.0	9.0	9.0		|R-A|/Span * 100	0.0
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/15/22 03:14	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/15/22 03:24	200.0	175.0	174.0		|R-A|/Span * 100	0.5
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/15/22 03:14	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/15/22 03:19	10.0	8.9	9.0		|R-A|/Span * 100	1.0
Part 75	**CT1_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	High	06/15/22 03:14	21.0	18.3	18.4		|R-A|	0.1
	Zero	06/15/22 03:19	21.0	0.0	0.0		|R-A|	0.0
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/15/22 03:14	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/15/22 03:24	200.0	182.3	181.3		|R-A|/Span * 100	0.5
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/15/22 03:14	10.0	0.0	0.1		|R-A|/Span * 100	1.0
	High	06/15/22 03:19	10.0	9.6	9.4		|R-A|/Span * 100	2.0
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/15/22 03:14	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/15/22 03:24	200.0	176.0	173.4		|R-A|/Span * 100	1.3
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/15/22 03:14	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/15/22 03:19	10.0	8.8	8.7		|R-A|/Span * 100	1.0

Daily Calibration Results

CT1 and CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:50 **Location:** Roseville, CA

All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 75	**CT2_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	High	06/15/22 03:14	21.0	18.0	18.0		|R-A|	0.0
	Zero	06/15/22 03:19	21.0	0.0	0.0		|R-A|	0.0
Part 60	**CT1_NOXInlet_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	Zero	06/16/22 02:15	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/16/22 02:25	200.0	175.0	172.4		|R-A|/Span * 100	1.3
Part 60	**CT1_NOXInlet_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**	**Pass**	
	Zero	06/16/22 02:15	30.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/16/22 02:19	30.0	27.3	26.5	>1x Alert	|R-A|/Span * 100	2.7
Part 60	**CT2_NOXInlet_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	Zero	06/16/22 02:14	200.0	0.0	-0.1		|R-A|/Span * 100	0.1
	High	06/16/22 02:25	200.0	176.0	177.0		|R-A|/Span * 100	0.5
Part 60	**CT2_NOXInlet_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**	**Pass**	
	Zero	06/16/22 02:14	30.0	0.0	-0.1		|R-A|/Span * 100	0.3
	High	06/16/22 02:19	30.0	27.5	27.5		|R-A|/Span * 100	0.0
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	Zero	06/16/22 03:15	200.0	0.0	0.1		|R-A|/Span * 100	0.1
	High	06/16/22 03:25	200.0	182.3	182.9		|R-A|/Span * 100	0.3
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**	**Pass**	
	Zero	06/16/22 03:15	10.0	0.0	0.1		|R-A|/Span * 100	1.0
	High	06/16/22 03:20	10.0	9.0	9.0		|R-A|/Span * 100	0.0
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	Zero	06/16/22 03:15	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/16/22 03:25	200.0	175.0	174.0		|R-A|/Span * 100	0.5
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**	**Pass**	
	Zero	06/16/22 03:15	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/16/22 03:20	10.0	8.9	8.9		|R-A|/Span * 100	0.0
Part 75	**CT1_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	High	06/16/22 03:15	21.0	18.3	18.4		|R-A|	0.1
	Zero	06/16/22 03:20	21.0	0.0	0.0		|R-A|	0.0
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	Zero	06/16/22 03:15	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/16/22 03:25	200.0	182.3	180.8		|R-A|/Span * 100	0.8
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**	**Pass**	
	Zero	06/16/22 03:15	10.0	0.0	0.1		|R-A|/Span * 100	1.0
	High	06/16/22 03:20	10.0	9.6	9.4		|R-A|/Span * 100	2.0

Daily Calibration Results

CT1 and CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:50 **Location:** Roseville, CA

All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/16/22 03:15	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/16/22 03:25	200.0	176.0	173.0		|R-A|/Span * 100	1.5
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/16/22 03:15	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/16/22 03:20	10.0	8.8	8.7		|R-A|/Span * 100	1.0
Part 75	**CT2_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	High	06/16/22 03:15	21.0	18.0	18.0		|R-A|	0.0
	Zero	06/16/22 03:20	21.0	0.0	0.0		|R-A|	0.0
Part 60	**CT1_NOXInlet_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/17/22 02:14	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/17/22 02:25	200.0	175.0	171.5		|R-A|/Span * 100	1.8
Part 60	**CT1_NOXInlet_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Warning**
	Zero	06/17/22 02:14	30.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/17/22 02:19	30.0	26.7	23.9	>2x	|R-A|/Span * 100	9.3
Part 60	**CT2_NOXInlet_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/17/22 02:15	200.0	0.0	-0.1		|R-A|/Span * 100	0.1
	High	06/17/22 02:25	200.0	176.0	176.8		|R-A|/Span * 100	0.4
Part 60	**CT2_NOXInlet_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/17/22 02:15	30.0	0.0	-0.1		|R-A|/Span * 100	0.3
	High	06/17/22 02:20	30.0	27.5	27.4		|R-A|/Span * 100	0.3
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/17/22 03:14	200.0	0.0	0.1		|R-A|/Span * 100	0.1
	High	06/17/22 03:25	200.0	182.3	183.2		|R-A|/Span * 100	0.5
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/17/22 03:14	10.0	0.0	0.1		|R-A|/Span * 100	1.0
	High	06/17/22 03:20	10.0	9.7	9.8		|R-A|/Span * 100	1.0
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/17/22 03:14	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/17/22 03:25	200.0	175.0	174.0		|R-A|/Span * 100	0.5
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/17/22 03:14	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/17/22 03:20	10.0	8.8	8.7		|R-A|/Span * 100	1.0
Part 75	**CT1_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	High	06/17/22 03:14	21.0	18.3	18.4		|R-A|	0.1
	Zero	06/17/22 03:20	21.0	0.0	0.0		|R-A|	0.0

Daily Calibration Results

CT1 and CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:50 **Location:** Roseville, CA

All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	Zero	06/17/22 03:14	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/17/22 03:25	200.0	182.3	182.1		|R-A|/Span * 100	0.1
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**	**Pass**	
	Zero	06/17/22 03:14	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/17/22 03:20	10.0	9.6	9.4		|R-A|/Span * 100	2.0
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	Zero	06/17/22 03:14	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/17/22 03:25	200.0	176.0	173.2		|R-A|/Span * 100	1.4
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**	**Pass**	
	Zero	06/17/22 03:14	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/17/22 03:20	10.0	8.8	8.7		|R-A|/Span * 100	1.0
Part 75	**CT2_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	High	06/17/22 03:14	21.0	18.0	18.0		|R-A|	0.0
	Zero	06/17/22 03:20	21.0	0.0	0.0		|R-A|	0.0
Part 60	**CT2_NOXInlet_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	Zero	06/18/22 02:14	200.0	0.0	-0.1		|R-A|/Span * 100	0.1
	High	06/18/22 02:25	200.0	176.0	176.2		|R-A|/Span * 100	0.1
Part 60	**CT2_NOXInlet_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**	**Pass**	
	Zero	06/18/22 02:14	30.0	0.0	-0.1		|R-A|/Span * 100	0.3
	High	06/18/22 02:19	30.0	27.5	27.4		|R-A|/Span * 100	0.3
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	Zero	06/18/22 03:15	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/18/22 03:25	200.0	182.3	181.0		|R-A|/Span * 100	0.7
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**	**Pass**	
	Zero	06/18/22 03:15	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/18/22 03:20	10.0	9.6	9.5		|R-A|/Span * 100	1.0
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	Zero	06/18/22 03:15	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/18/22 03:25	200.0	176.0	172.8		|R-A|/Span * 100	1.6
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**	**Pass**	
	Zero	06/18/22 03:15	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/18/22 03:20	10.0	8.8	8.7		|R-A|/Span * 100	1.0
Part 75	**CT2_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	High	06/18/22 03:15	21.0	18.0	18.0		|R-A|	0.0
	Zero	06/18/22 03:20	21.0	0.0	0.0		|R-A|	0.0

Daily Calibration Results

CT1 and CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:50 **Location:** Roseville, CA

All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	**CT2_NOXInlet_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	Zero	06/19/22 02:15	200.0	0.0	-0.1	|R-A|/Span * 100		0.1
	High	06/19/22 02:25	200.0	176.0	176.6	|R-A|/Span * 100		0.3
Part 60	**CT2_NOXInlet_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**	**Pass**	
	Zero	06/19/22 02:15	30.0	0.0	-0.1	|R-A|/Span * 100		0.3
	High	06/19/22 02:20	30.0	27.5	27.5	|R-A|/Span * 100		0.0
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	Zero	06/19/22 03:14	200.0	0.0	0.0	|R-A|/Span * 100		0.0
	High	06/19/22 03:24	200.0	182.3	180.8	|R-A|/Span * 100		0.8
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**	**Pass**	
	Zero	06/19/22 03:14	10.0	0.0	0.0	|R-A|/Span * 100		0.0
	High	06/19/22 03:19	10.0	9.6	9.4	|R-A|/Span * 100		2.0
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	Zero	06/19/22 03:14	200.0	0.0	0.0	|R-A|/Span * 100		0.0
	High	06/19/22 03:24	200.0	176.0	173.2	|R-A|/Span * 100		1.4
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**	**Pass**	
	Zero	06/19/22 03:14	10.0	0.0	0.0	|R-A|/Span * 100		0.0
	High	06/19/22 03:19	10.0	8.8	8.7	|R-A|/Span * 100		1.0
Part 75	**CT2_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	High	06/19/22 03:14	21.0	18.0	18.0	|R-A|		0.0
	Zero	06/19/22 03:19	21.0	0.0	0.0	|R-A|		0.0
Part 60	**CT2_NOXInlet_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	Zero	06/20/22 02:14	200.0	0.0	-0.1	|R-A|/Span * 100		0.1
	High	06/20/22 02:24	200.0	176.0	176.6	|R-A|/Span * 100		0.3
Part 60	**CT2_NOXInlet_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**	**Pass**	
	Zero	06/20/22 02:14	30.0	0.0	-0.1	|R-A|/Span * 100		0.3
	High	06/20/22 02:19	30.0	27.5	27.5	|R-A|/Span * 100		0.0
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	Zero	06/20/22 03:15	200.0	0.0	0.0	|R-A|/Span * 100		0.0
	High	06/20/22 03:25	200.0	182.3	180.7	|R-A|/Span * 100		0.8
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**	**Pass**	
	Zero	06/20/22 03:15	10.0	0.0	0.1	|R-A|/Span * 100		1.0
	High	06/20/22 03:20	10.0	9.6	9.4	|R-A|/Span * 100		2.0
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	Zero	06/20/22 03:15	200.0	0.0	0.0	|R-A|/Span * 100		0.0
	High	06/20/22 03:25	200.0	176.0	172.9	|R-A|/Span * 100		1.6

Daily Calibration Results

CT1 and CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:50 **Location:** Roseville, CA

All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/20/22 03:15	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/20/22 03:20	10.0	8.8	8.7		|R-A|/Span * 100	1.0
Part 75	**CT2_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	High	06/20/22 03:15	21.0	18.0	18.0		|R-A|	0.0
	Zero	06/20/22 03:20	21.0	0.0	0.0		|R-A|	0.0
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/20/22 16:19	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/20/22 16:30	200.0	182.3	181.9		|R-A|/Span * 100	0.2
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/20/22 16:19	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/20/22 16:24	10.0	9.7	9.8		|R-A|/Span * 100	1.0
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/20/22 16:19	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/20/22 16:30	200.0	175.0	173.1		|R-A|/Span * 100	1.0
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/20/22 16:19	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/20/22 16:24	10.0	8.8	8.6		|R-A|/Span * 100	2.0
Part 75	**CT1_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	High	06/20/22 16:19	21.0	18.3	18.4		|R-A|	0.1
	Zero	06/20/22 16:24	21.0	0.0	0.0		|R-A|	0.0
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/20/22 18:08	200.0	0.0	0.1		|R-A|/Span * 100	0.1
	High	06/20/22 18:18	200.0	182.3	182.2		|R-A|/Span * 100	0.1
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/20/22 18:08	10.0	0.0	0.1		|R-A|/Span * 100	1.0
	High	06/20/22 18:13	10.0	9.7	9.8		|R-A|/Span * 100	1.0
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/20/22 18:08	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/20/22 18:18	200.0	175.0	174.2		|R-A|/Span * 100	0.4
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/20/22 18:08	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/20/22 18:13	10.0	8.8	9.0		|R-A|/Span * 100	2.0
Part 75	**CT1_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	High	06/20/22 18:08	21.0	18.3	18.4		|R-A|	0.1
	Zero	06/20/22 18:13	21.0	0.0	0.0		|R-A|	0.0

Daily Calibration Results

CT1 and CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:50 **Location:** Roseville, CA

All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	**CT1_NOXInlet_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	Zero	06/21/22 02:14	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/21/22 02:25	200.0	175.0	171.6		|R-A|/Span * 100	1.7
Part 60	**CT1_NOXInlet_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**	**Pass**	
	Zero	06/21/22 02:14	30.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/21/22 02:19	30.0	26.7	26.0		|R-A|/Span * 100	2.3
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	Zero	06/21/22 03:15	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/21/22 03:25	200.0	182.3	182.6		|R-A|/Span * 100	0.2
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**	**Pass**	
	Zero	06/21/22 03:15	10.0	0.0	0.1		|R-A|/Span * 100	1.0
	High	06/21/22 03:20	10.0	9.7	9.8		|R-A|/Span * 100	1.0
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	Zero	06/21/22 03:15	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/21/22 03:25	200.0	175.0	174.2		|R-A|/Span * 100	0.4
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**	**Pass**	
	Zero	06/21/22 03:15	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/21/22 03:20	10.0	8.8	8.9		|R-A|/Span * 100	1.0
Part 75	**CT1_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	High	06/21/22 03:15	21.0	18.1	18.2		|R-A|	0.1
	Zero	06/21/22 03:20	21.0	0.0	0.0		|R-A|	0.0
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	Zero	06/21/22 03:44	200.0	0.0	0.1		|R-A|/Span * 100	0.1
	High	06/21/22 03:55	200.0	182.3	182.5		|R-A|/Span * 100	0.1
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**	**Pass**	
	Zero	06/21/22 03:44	10.0	0.0	0.1		|R-A|/Span * 100	1.0
	High	06/21/22 03:49	10.0	9.7	9.8		|R-A|/Span * 100	1.0
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	Zero	06/21/22 03:44	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/21/22 03:55	200.0	175.0	174.9		|R-A|/Span * 100	0.1
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**	**Pass**	
	Zero	06/21/22 03:44	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/21/22 03:49	10.0	8.8	9.0		|R-A|/Span * 100	2.0
Part 75	**CT1_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	High	06/21/22 03:44	21.0	18.1	18.2		|R-A|	0.1
	Zero	06/21/22 03:49	21.0	0.0	0.0		|R-A|	0.0

Daily Calibration Results

CT1 and CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:50 **Location:** Roseville, CA

All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	Zero	06/21/22 21:29	200.0	0.0	0.1		|R-A|/Span * 100	0.1
	High	06/21/22 21:39	200.0	182.3	182.5		|R-A|/Span * 100	0.1
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**	**Pass**	
	Zero	06/21/22 21:29	10.0	0.0	0.1		|R-A|/Span * 100	1.0
	High	06/21/22 21:34	10.0	9.6	9.5		|R-A|/Span * 100	1.0
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	Zero	06/21/22 21:29	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/21/22 21:39	200.0	176.0	172.7		|R-A|/Span * 100	1.7
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**	**Pass**	
	Zero	06/21/22 21:29	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/21/22 21:34	10.0	8.8	8.6		|R-A|/Span * 100	2.0
Part 75	**CT2_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	High	06/21/22 21:29	21.0	18.0	18.0		|R-A|	0.0
	Zero	06/21/22 21:34	21.0	0.0	0.0		|R-A|	0.0
Part 60	**CT1_NOXInlet_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	Zero	06/22/22 02:15	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/22/22 02:24	200.0	175.0	172.2		|R-A|/Span * 100	1.4
Part 60	**CT1_NOXInlet_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**	**Pass**	
	Zero	06/22/22 02:15	30.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/22/22 02:19	30.0	26.7	26.8		|R-A|/Span * 100	0.3
Part 60	**CT2_NOXInlet_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	Zero	06/22/22 02:14	200.0	0.0	-0.1		|R-A|/Span * 100	0.1
	High	06/22/22 02:25	200.0	176.0	179.1		|R-A|/Span * 100	1.6
Part 60	**CT2_NOXInlet_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**	**Pass**	
	Zero	06/22/22 02:14	30.0	0.0	-0.1		|R-A|/Span * 100	0.3
	High	06/22/22 02:19	30.0	26.3	27.4	>1x Alert	|R-A|/Span * 100	3.7
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	Zero	06/22/22 03:15	200.0	0.0	0.1		|R-A|/Span * 100	0.1
	High	06/22/22 03:25	200.0	182.3	183.3		|R-A|/Span * 100	0.5
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**	**Pass**	
	Zero	06/22/22 03:15	10.0	0.0	0.1		|R-A|/Span * 100	1.0
	High	06/22/22 03:20	10.0	9.7	9.9		|R-A|/Span * 100	2.0
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	Zero	06/22/22 03:15	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/22/22 03:25	200.0	175.0	174.3		|R-A|/Span * 100	0.4

Daily Calibration Results

CT1 and CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:50 **Location:** Roseville, CA

All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/22/22 03:15	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/22/22 03:20	10.0	8.8	8.8		|R-A|/Span * 100	0.0
Part 75	**CT1_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	High	06/22/22 03:15	21.0	18.1	18.2		|R-A|	0.1
	Zero	06/22/22 03:20	21.0	0.0	0.0		|R-A|	0.0
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/22/22 03:14	200.0	0.0	0.1		|R-A|/Span * 100	0.1
	High	06/22/22 03:25	200.0	182.3	182.5		|R-A|/Span * 100	0.1
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/22/22 03:14	10.0	0.0	0.1		|R-A|/Span * 100	1.0
	High	06/22/22 03:20	10.0	9.6	9.5		|R-A|/Span * 100	1.0
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/22/22 03:14	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/22/22 03:25	200.0	176.0	172.9		|R-A|/Span * 100	1.6
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/22/22 03:14	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/22/22 03:20	10.0	8.8	8.6		|R-A|/Span * 100	2.0
Part 75	**CT2_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	High	06/22/22 03:14	21.0	18.0	18.0		|R-A|	0.0
	Zero	06/22/22 03:20	21.0	0.0	0.0		|R-A|	0.0
Part 60	**CT1_NOXInlet_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/23/22 02:14	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/23/22 02:25	200.0	175.0	172.9		|R-A|/Span * 100	1.1
Part 60	**CT1_NOXInlet_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Warning**
	Zero	06/23/22 02:14	30.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/23/22 02:19	30.0	26.7	24.6	>2x	|R-A|/Span * 100	7.0
Part 60	**CT2_NOXInlet_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/23/22 02:14	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/23/22 02:25	200.0	176.0	177.7		|R-A|/Span * 100	0.9
Part 60	**CT2_NOXInlet_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/23/22 02:14	30.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/23/22 02:19	30.0	26.3	27.1	>1x Alert	|R-A|/Span * 100	2.7
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/23/22 03:15	200.0	0.0	0.1		|R-A|/Span * 100	0.1
	High	06/23/22 03:25	200.0	182.3	183.3		|R-A|/Span * 100	0.5

Daily Calibration Results

CT1 and CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:50 **Location:** Roseville, CA

All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**	**Pass**	
	Zero	06/23/22 03:15	10.0	0.0	0.1		|R-A|/Span * 100	1.0
	High	06/23/22 03:20	10.0	9.7	9.8		|R-A|/Span * 100	1.0
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	Zero	06/23/22 03:15	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/23/22 03:25	200.0	175.0	174.3		|R-A|/Span * 100	0.4
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**	**Pass**	
	Zero	06/23/22 03:15	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/23/22 03:20	10.0	8.8	8.8		|R-A|/Span * 100	0.0
Part 75	**CT1_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	High	06/23/22 03:15	21.0	18.1	18.2		|R-A|	0.1
	Zero	06/23/22 03:20	21.0	0.0	0.0		|R-A|	0.0
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	Zero	06/23/22 18:03	200.0	0.0	0.1		|R-A|/Span * 100	0.1
	High	06/23/22 18:14	200.0	182.3	183.1		|R-A|/Span * 100	0.4
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**	**Pass**	
	Zero	06/23/22 18:03	10.0	0.0	0.1		|R-A|/Span * 100	1.0
	High	06/23/22 18:09	10.0	9.6	9.6		|R-A|/Span * 100	0.0
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	Zero	06/23/22 18:03	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/23/22 18:14	200.0	176.0	173.1		|R-A|/Span * 100	1.5
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**	**Pass**	
	Zero	06/23/22 18:03	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/23/22 18:09	10.0	8.8	8.7		|R-A|/Span * 100	1.0
Part 75	**CT2_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	High	06/23/22 18:03	21.0	18.0	18.0		|R-A|	0.0
	Zero	06/23/22 18:09	21.0	0.0	0.0		|R-A|	0.0
Part 60	**CT1_NOXInlet_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	Zero	06/24/22 02:14	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/24/22 02:24	200.0	175.0	172.7		|R-A|/Span * 100	1.2
Part 60	**CT1_NOXInlet_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**	**Pass**	
	Zero	06/24/22 02:14	30.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/24/22 02:19	30.0	26.7	26.5		|R-A|/Span * 100	0.7
Part 60	**CT2_NOXInlet_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**	**Pass**	
	Zero	06/24/22 02:14	200.0	0.0	-0.1		|R-A|/Span * 100	0.1
	High	06/24/22 02:24	200.0	176.0	178.7		|R-A|/Span * 100	1.4

Daily Calibration Results

CT1 and CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:50 **Location:** Roseville, CA

All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	**CT2_NOXInlet_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/24/22 02:14	30.0	0.0	0.1		|R-A|/Span * 100	0.3
	High	06/24/22 02:19	30.0	26.3	25.9		|R-A|/Span * 100	1.3
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/24/22 03:14	200.0	0.0	0.1		|R-A|/Span * 100	0.1
	High	06/24/22 03:25	200.0	182.3	183.5		|R-A|/Span * 100	0.6
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/24/22 03:14	10.0	0.0	0.1		|R-A|/Span * 100	1.0
	High	06/24/22 03:20	10.0	9.7	9.9		|R-A|/Span * 100	2.0
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/24/22 03:14	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/24/22 03:25	200.0	175.0	174.4		|R-A|/Span * 100	0.3
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/24/22 03:14	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/24/22 03:20	10.0	8.8	8.9		|R-A|/Span * 100	1.0
Part 75	**CT1_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	High	06/24/22 03:14	21.0	18.1	18.2		|R-A|	0.1
	Zero	06/24/22 03:20	21.0	0.0	0.0		|R-A|	0.0
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/24/22 03:14	200.0	0.0	0.1		|R-A|/Span * 100	0.1
	High	06/24/22 03:25	200.0	182.3	183.1		|R-A|/Span * 100	0.4
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/24/22 03:14	10.0	0.0	0.1		|R-A|/Span * 100	1.0
	High	06/24/22 03:20	10.0	9.6	9.5		|R-A|/Span * 100	1.0
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/24/22 03:14	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/24/22 03:25	200.0	176.0	173.1		|R-A|/Span * 100	1.5
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/24/22 03:14	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/24/22 03:20	10.0	8.8	8.6		|R-A|/Span * 100	2.0
Part 75	**CT2_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	High	06/24/22 03:14	21.0	18.0	18.0		|R-A|	0.0
	Zero	06/24/22 03:20	21.0	0.0	0.0		|R-A|	0.0
Part 60	**CT1_NOXInlet_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/25/22 02:14	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/25/22 02:25	200.0	175.0	172.8		|R-A|/Span * 100	1.1

Daily Calibration Results

CT1 and CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:50 **Location:** Roseville, CA

All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	**CT1_NOXInlet_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/25/22 02:14	30.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/25/22 02:20	30.0	26.7	26.4		|R-A|/Span * 100	1.0
Part 60	**CT2_NOXInlet_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/25/22 02:15	200.0	0.0	-0.1		|R-A|/Span * 100	0.1
	High	06/25/22 02:25	200.0	176.0	177.8		|R-A|/Span * 100	0.9
Part 60	**CT2_NOXInlet_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/25/22 02:15	30.0	0.0	0.1		|R-A|/Span * 100	0.3
	High	06/25/22 02:20	30.0	26.3	25.8		|R-A|/Span * 100	1.7
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/25/22 03:14	200.0	0.0	0.1		|R-A|/Span * 100	0.1
	High	06/25/22 03:24	200.0	182.3	181.9		|R-A|/Span * 100	0.2
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/25/22 03:14	10.0	0.0	0.1		|R-A|/Span * 100	1.0
	High	06/25/22 03:19	10.0	9.6	9.5		|R-A|/Span * 100	1.0
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/25/22 03:14	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/25/22 03:24	200.0	176.0	172.6		|R-A|/Span * 100	1.7
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/25/22 03:14	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/25/22 03:19	10.0	8.8	8.7		|R-A|/Span * 100	1.0
Part 75	**CT2_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	High	06/25/22 03:14	21.0	18.0	18.0		|R-A|	0.0
	Zero	06/25/22 03:19	21.0	0.0	0.0		|R-A|	0.0
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/25/22 03:15	200.0	0.0	0.1		|R-A|/Span * 100	0.1
	High	06/25/22 03:25	200.0	182.3	183.3		|R-A|/Span * 100	0.5
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/25/22 03:15	10.0	0.0	0.1		|R-A|/Span * 100	1.0
	High	06/25/22 03:19	10.0	9.7	9.9		|R-A|/Span * 100	2.0
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/25/22 03:15	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/25/22 03:25	200.0	175.0	174.6		|R-A|/Span * 100	0.2
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/25/22 03:15	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/25/22 03:19	10.0	8.8	8.9		|R-A|/Span * 100	1.0

Daily Calibration Results

CT1 and CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:50 **Location:** Roseville, CA

All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 75	**CT1_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	High	06/25/22 03:15	21.0	18.1	18.2		|R-A|	0.1
	Zero	06/25/22 03:19	21.0	0.0	0.0		|R-A|	0.0
Part 60	**CT2_NOXInlet_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/26/22 02:14	200.0	0.0	-0.1		|R-A|/Span * 100	0.1
	High	06/26/22 02:24	200.0	176.0	177.9		|R-A|/Span * 100	1.0
Part 60	**CT2_NOXInlet_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/26/22 02:14	30.0	0.0	0.1		|R-A|/Span * 100	0.3
	High	06/26/22 02:19	30.0	26.3	25.8		|R-A|/Span * 100	1.7
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/26/22 03:15	200.0	0.0	0.1		|R-A|/Span * 100	0.1
	High	06/26/22 03:25	200.0	182.3	181.3		|R-A|/Span * 100	0.5
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/26/22 03:15	10.0	0.0	0.1		|R-A|/Span * 100	1.0
	High	06/26/22 03:20	10.0	9.6	9.5		|R-A|/Span * 100	1.0
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/26/22 03:15	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/26/22 03:25	200.0	176.0	172.9		|R-A|/Span * 100	1.6
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/26/22 03:15	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/26/22 03:20	10.0	8.8	8.7		|R-A|/Span * 100	1.0
Part 75	**CT2_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	High	06/26/22 03:15	21.0	18.0	18.0		|R-A|	0.0
	Zero	06/26/22 03:20	21.0	0.0	0.0		|R-A|	0.0
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/26/22 12:09	200.0	0.0	0.1		|R-A|/Span * 100	0.1
	High	06/26/22 12:20	200.0	182.3	182.9		|R-A|/Span * 100	0.3
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/26/22 12:09	10.0	0.0	0.1		|R-A|/Span * 100	1.0
	High	06/26/22 12:14	10.0	9.7	9.9		|R-A|/Span * 100	2.0
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/26/22 12:09	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/26/22 12:20	200.0	175.0	173.7		|R-A|/Span * 100	0.7
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/26/22 12:09	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/26/22 12:14	10.0	8.8	8.8		|R-A|/Span * 100	0.0

Daily Calibration Results

CT1 and CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:50 **Location:** Roseville, CA

All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 75	**CT1_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	High	06/26/22 12:09	21.0	18.1	18.2		|R-A|	0.1
	Zero	06/26/22 12:14	21.0	0.0	0.0		|R-A|	0.0
Part 60	**CT1_NOXInlet_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/27/22 02:14	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/27/22 02:24	200.0	175.0	172.3		|R-A|/Span * 100	1.4
Part 60	**CT1_NOXInlet_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/27/22 02:14	30.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/27/22 02:19	30.0	26.7	26.5		|R-A|/Span * 100	0.7
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/27/22 03:15	200.0	0.0	0.1		|R-A|/Span * 100	0.1
	High	06/27/22 03:25	200.0	182.3	183.1		|R-A|/Span * 100	0.4
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/27/22 03:15	10.0	0.0	0.1		|R-A|/Span * 100	1.0
	High	06/27/22 03:19	10.0	9.7	9.9		|R-A|/Span * 100	2.0
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/27/22 03:15	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/27/22 03:25	200.0	175.0	174.3		|R-A|/Span * 100	0.4
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/27/22 03:15	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/27/22 03:19	10.0	8.8	8.9		|R-A|/Span * 100	1.0
Part 75	**CT1_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	High	06/27/22 03:15	21.0	18.1	18.3		|R-A|	0.2
	Zero	06/27/22 03:19	21.0	0.0	0.0		|R-A|	0.0
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/27/22 15:09	200.0	0.0	0.1		|R-A|/Span * 100	0.1
	High	06/27/22 15:20	200.0	182.3	181.5		|R-A|/Span * 100	0.4
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/27/22 15:09	10.0	0.0	0.1		|R-A|/Span * 100	1.0
	High	06/27/22 15:15	10.0	9.6	9.5		|R-A|/Span * 100	1.0
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/27/22 15:09	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/27/22 15:20	200.0	176.0	173.6		|R-A|/Span * 100	1.2
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/27/22 15:09	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/27/22 15:15	10.0	8.8	8.7		|R-A|/Span * 100	1.0

Daily Calibration Results

CT1 and CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:50 **Location:** Roseville, CA

All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 75	**CT2_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	High	06/27/22 15:09	21.0	18.0	18.0		|R-A|	0.0
	Zero	06/27/22 15:15	21.0	0.0	0.0		|R-A|	0.0
Part 60	**CT1_NOXInlet_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/28/22 02:15	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/28/22 02:25	200.0	175.0	172.6		|R-A|/Span * 100	1.2
Part 60	**CT1_NOXInlet_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/28/22 02:15	30.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/28/22 02:19	30.0	26.7	26.5		|R-A|/Span * 100	0.7
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/28/22 03:14	200.0	0.0	0.1		|R-A|/Span * 100	0.1
	High	06/28/22 03:24	200.0	182.3	182.9		|R-A|/Span * 100	0.3
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/28/22 03:14	10.0	0.0	0.1		|R-A|/Span * 100	1.0
	High	06/28/22 03:19	10.0	9.7	9.9		|R-A|/Span * 100	2.0
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/28/22 03:14	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/28/22 03:24	200.0	175.0	174.4		|R-A|/Span * 100	0.3
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/28/22 03:14	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/28/22 03:19	10.0	8.8	8.9		|R-A|/Span * 100	1.0
Part 75	**CT1_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	High	06/28/22 03:14	21.0	18.1	18.2		|R-A|	0.1
	Zero	06/28/22 03:19	21.0	0.0	0.0		|R-A|	0.0
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/28/22 17:53	200.0	0.0	0.1		|R-A|/Span * 100	0.1
	High	06/28/22 18:03	200.0	184.3	183.8		|R-A|/Span * 100	0.3
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/28/22 17:53	10.0	0.0	0.1		|R-A|/Span * 100	1.0
	High	06/28/22 17:59	10.0	9.6	9.5		|R-A|/Span * 100	1.0
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/28/22 17:53	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/28/22 18:03	200.0	182.0	180.3		|R-A|/Span * 100	0.9
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/28/22 17:53	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/28/22 17:59	10.0	8.8	8.6		|R-A|/Span * 100	2.0

Daily Calibration Results

CT1 and CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:50 **Location:** Roseville, CA

All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 75	**CT2_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	High	06/28/22 17:53	21.0	18.0	18.0		|R-A|	0.0
	Zero	06/28/22 17:59	21.0	0.0	0.0		|R-A|	0.0
Part 60	**CT1_NOXInlet_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Fail**
	Zero	06/29/22 02:14	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/29/22 02:24	200.0	175.0	6.8	>4x	|R-A|/Span * 100	84.1
Part 60	**CT1_NOXInlet_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/29/22 02:14	30.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/29/22 02:19	30.0	26.7	26.3		|R-A|/Span * 100	1.3
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/29/22 02:41	200.0	0.0	0.1		|R-A|/Span * 100	0.1
	High	06/29/22 02:51	200.0	182.4	182.6		|R-A|/Span * 100	0.1
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/29/22 02:41	10.0	0.0	0.1		|R-A|/Span * 100	1.0
	High	06/29/22 02:46	10.0	9.7	9.8		|R-A|/Span * 100	1.0
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/29/22 02:41	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/29/22 02:51	200.0	175.0	172.5		|R-A|/Span * 100	1.3
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/29/22 02:41	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/29/22 02:46	10.0	8.8	8.8		|R-A|/Span * 100	0.0
Part 75	**CT1_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	High	06/29/22 02:41	21.0	18.1	18.2		|R-A|	0.1
	Zero	06/29/22 02:46	21.0	0.0	0.0		|R-A|	0.0
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/29/22 14:27	200.0	0.0	0.1		|R-A|/Span * 100	0.1
	High	06/29/22 14:37	200.0	184.3	183.3		|R-A|/Span * 100	0.5
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/29/22 14:27	10.0	0.0	0.1		|R-A|/Span * 100	1.0
	High	06/29/22 14:32	10.0	9.6	9.5		|R-A|/Span * 100	1.0
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/29/22 14:27	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/29/22 14:37	200.0	182.0	180.0		|R-A|/Span * 100	1.0
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/29/22 14:27	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/29/22 14:32	10.0	8.8	8.6		|R-A|/Span * 100	2.0

Daily Calibration Results

CT1 and CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:50 **Location:** Roseville, CA

All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 75	**CT2_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	High	06/29/22 14:27	21.0	18.0	18.0		|R-A|	0.0
	Zero	06/29/22 14:32	21.0	0.0	0.0		|R-A|	0.0
Part 60	**CT1_NOXInlet_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/30/22 02:14	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/30/22 02:24	200.0	175.0	171.0		|R-A|/Span * 100	2.0
Part 60	**CT1_NOXInlet_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/30/22 02:14	30.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/30/22 02:19	30.0	26.7	26.2		|R-A|/Span * 100	1.7
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/30/22 02:55	200.0	0.0	0.1		|R-A|/Span * 100	0.1
	High	06/30/22 03:04	200.0	182.4	182.6		|R-A|/Span * 100	0.1
Part 60	**CT1_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/30/22 02:55	10.0	0.0	0.1		|R-A|/Span * 100	1.0
	High	06/30/22 03:00	10.0	9.7	9.9		|R-A|/Span * 100	2.0
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/30/22 02:55	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/30/22 03:04	200.0	175.0	174.0		|R-A|/Span * 100	0.5
Part 75	**CT1_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/30/22 02:55	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/30/22 03:00	10.0	8.8	8.9		|R-A|/Span * 100	1.0
Part 75	**CT1_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	High	06/30/22 02:55	21.0	18.1	18.2		|R-A|	0.1
	Zero	06/30/22 03:00	21.0	0.0	0.0		|R-A|	0.0
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/30/22 15:33	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/30/22 15:43	200.0	184.3	182.9		|R-A|/Span * 100	0.7
Part 60	**CT2_CODualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/30/22 15:33	10.0	0.0	0.1		|R-A|/Span * 100	1.0
	High	06/30/22 15:39	10.0	8.8	8.8		|R-A|/Span * 100	0.0
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	Zero	06/30/22 15:33	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/30/22 15:43	200.0	182.0	179.3		|R-A|/Span * 100	1.4
Part 75	**CT2_NOXDualRg_P_Instrument**	**Used For QA**	**Range: Low**			**Calibration Result: Online**		**Pass**
	Zero	06/30/22 15:33	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/30/22 15:39	10.0	8.1	8.3		|R-A|/Span * 100	2.0

Daily Calibration Results

CT1 and CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:50 **Location:** Roseville, CA

All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 75	**CT2_O2D_P_Instrument**	**Used For QA**	**Range: High**			**Calibration Result: Online**		**Pass**
	High	06/30/22 15:33	21.0	18.0	18.0		|R-A|	0.0
	Zero	06/30/22 15:39	21.0	0.0	0.0		|R-A|	0.0

AQ34 3HR AVG LOAD

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/01/22 0:00	0			0			0											
04/01/22 1:00	0			0			0											
04/01/22 2:00	0			0			0											
04/01/22 3:00	0			0			0											
04/01/22 4:00	0			0			0											
04/01/22 5:00	0			0			0											
04/01/22 6:00	0			0			0											
04/01/22 7:00	0			0			0											
04/01/22 8:00	0			0			0											
04/01/22 9:00	0			0			0											
04/01/22 10:00	0			0			0											
04/01/22 11:00	0			0			0											
04/01/22 12:00	0			0			0											
04/01/22 13:00	0			0			0											
04/01/22 14:00	0			0			0											
04/01/22 15:00	0			0			0											
04/01/22 16:00	0			0			0											
04/01/22 17:00	0			0			0											
04/01/22 18:00	0			0			0											
04/01/22 19:00	0			0			0											
04/01/22 20:00	0			0			0											
04/01/22 21:00	0			0			0											
04/01/22 22:00	0			0			0											
04/01/22 23:00	0			0			0											
04/02/22 0:00	0			0			0											
04/02/22 1:00	0			0			0											
04/02/22 2:00	0			0			0											
04/02/22 3:00	0			0			0											
04/02/22 4:00	0			0			0											
04/02/22 5:00	0			0			0											
04/02/22 6:00	0			0			0											
04/02/22 7:00	0			0			0											
04/02/22 8:00	0			0			0											
04/02/22 9:00	0			0			0											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/02/22 10:00	0			0			0											
04/02/22 11:00	0			0			0											
04/02/22 12:00	0			0			0											
04/02/22 13:00	0			0			0											
04/02/22 14:00	0			0			0											
04/02/22 15:00	0			0			0											
04/02/22 16:00	0			0			0											
04/02/22 17:00	0			0			0											
04/02/22 18:00	0			0			0											
04/02/22 19:00	0			0			0											
04/02/22 20:00	0			0			0											
04/02/22 21:00	0			0			0											
04/02/22 22:00	0			0			0											
04/02/22 23:00	0			0			0											
04/03/22 0:00	0			0			0											
04/03/22 1:00	0			0			0											
04/03/22 2:00	0			0			0											
04/03/22 3:00	0			0			0											
04/03/22 4:00	0			0			0											
04/03/22 5:00	0			0			0											
04/03/22 6:00	0			0			0											
04/03/22 7:00	0			0			0											
04/03/22 8:00	0			0			0											
04/03/22 9:00	0			0			0											
04/03/22 10:00	0			0			0											
04/03/22 11:00	0			0			0											
04/03/22 12:00	0			0			0											
04/03/22 13:00	0			0			0											
04/03/22 14:00	0			0			0											
04/03/22 15:00	0			0			0											
04/03/22 16:00	0			0			0											
04/03/22 17:00	0			0			0											
04/03/22 18:00	0			0			0											
04/03/22 19:00	0			0			0											
04/03/22 20:00	0			0			0											
04/03/22 21:00	0			0			0											
04/03/22 22:00	0			0			0											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/03/22 23:00	0			0			0											
04/04/22 0:00	0			0			0											
04/04/22 1:00	0			0			0											
04/04/22 2:00	0			0			0											
04/04/22 3:00	0			0			0											
04/04/22 4:00	0			0			0											
04/04/22 5:00	0			0			0											
04/04/22 6:00	0			0			0											
04/04/22 7:00	0			0			0											
04/04/22 8:00	0			0			0											
04/04/22 9:00	0			0			0											
04/04/22 10:00	0			0			0											
04/04/22 11:00	0			0			0											
04/04/22 12:00	0			0			0											
04/04/22 13:00	0			0			0											
04/04/22 14:00	0			0			0											
04/04/22 15:00	0			0			0											
04/04/22 16:00	0			0			0											
04/04/22 17:00	0			0			0											
04/04/22 18:00	0			0			0											
04/04/22 19:00	0			0			0											
04/04/22 20:00	0			0			0											
04/04/22 21:00	0			0			0											
04/04/22 22:00	0			0			0											
04/04/22 23:00	0			0			0											
04/05/22 0:00	0			0			0											
04/05/22 1:00	0			0			0											
04/05/22 2:00	0			0			0											
04/05/22 3:00	0			0			0											
04/05/22 4:00	0			0			0											
04/05/22 5:00	0			0			0											
04/05/22 6:00	0			0			0											
04/05/22 7:00	0			0			0											
04/05/22 8:00	0			0			0											
04/05/22 9:00	0			0			0											
04/05/22 10:00	0			0			0											
04/05/22 11:00	0			0			0											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/05/22 12:00	0			0			0											
04/05/22 13:00	0			0			0											
04/05/22 14:00	0			0			0											
04/05/22 15:00	0			0			0											
04/05/22 16:00	0			0			0											
04/05/22 17:00	0			0			0											
04/05/22 18:00	0			0			0											
04/05/22 19:00	0			0			0											
04/05/22 20:00	0			0			0											
04/05/22 21:00	0			0			0											
04/05/22 22:00	0			0			0											
04/05/22 23:00	0			0			0											
04/06/22 0:00	0			0			0											
04/06/22 1:00	0			0			0											
04/06/22 2:00	0			0			0											
04/06/22 3:00	0			0			0											
04/06/22 4:00	0			0			0											
04/06/22 5:00	0			0			0											
04/06/22 6:00	0			0			0											
04/06/22 7:00	0			0			0											
04/06/22 8:00	0			0			0											
04/06/22 9:00	0			0			0											
04/06/22 10:00	0			0			0											
04/06/22 11:00	0			0			0											
04/06/22 12:00	0			0			0											
04/06/22 13:00	0			0			0											
04/06/22 14:00	0			0			0											
04/06/22 15:00	0			0			0											
04/06/22 16:00	0			0			0											
04/06/22 17:00	0			0			0											
04/06/22 18:00	0			0			0											
04/06/22 19:00	0			0			0											
04/06/22 20:00	0			0			0											
04/06/22 21:00	0			0			0											
04/06/22 22:00	0			0			0											
04/06/22 23:00	0			0			0											
04/07/22 0:00	0			0			0											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/07/22 1:00	0			0			0											
04/07/22 2:00	0			0			0											
04/07/22 3:00	0			0			0											
04/07/22 4:00	0			0			0											
04/07/22 5:00	0			0			0											
04/07/22 6:00	0			0			0											
04/07/22 7:00	0			0			0											
04/07/22 8:00	0			0			0											
04/07/22 9:00	0			0			0											
04/07/22 10:00	0			0			0											
04/07/22 11:00	0			0			0											
04/07/22 12:00	0			0			0											
04/07/22 13:00	0			0			0											
04/07/22 14:00	0			0			0											
04/07/22 15:00	0			0			0											
04/07/22 16:00	0			0			0											
04/07/22 17:00	0			0			0											
04/07/22 18:00	0			0			0											
04/07/22 19:00	0			0			0											
04/07/22 20:00	0			0			0											
04/07/22 21:00	0			0			0											
04/07/22 22:00	0			0			0											
04/07/22 23:00	0			0			0											
04/08/22 0:00	0			0			0											
04/08/22 1:00	0			0			0											
04/08/22 2:00	0			0			0											
04/08/22 3:00	0			0			0											
04/08/22 4:00	0			0			0											
04/08/22 5:00	0			0			0											
04/08/22 6:00	0			0			0											
04/08/22 7:00	0			0			0											
04/08/22 8:00	0			0			0											
04/08/22 9:00	0			0			0											
04/08/22 10:00	0			0			0											
04/08/22 11:00	0			0			0											
04/08/22 12:00	0			0			0											
04/08/22 13:00	0			0			0											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/08/22 14:00	0			0			0											
04/08/22 15:00	0			0			0											
04/08/22 16:00	0			0			0											
04/08/22 17:00	0			0			0											
04/08/22 18:00	0			0			0											
04/08/22 19:00	0			0			0											
04/08/22 20:00	0			0			0											
04/08/22 21:00	0			0			0											
04/08/22 22:00	0			0			0											
04/08/22 23:00	0			0			0											
04/09/22 0:00	0			0			0											
04/09/22 1:00	0			0			0											
04/09/22 2:00	0			0			0											
04/09/22 3:00	0			0			0											
04/09/22 4:00	0			0			0											
04/09/22 5:00	0			0			0											
04/09/22 6:00	0			0			0											
04/09/22 7:00	0			0			0											
04/09/22 8:00	0			0			0											
04/09/22 9:00	0			0			0											
04/09/22 10:00	0			0			0											
04/09/22 11:00	0			0			0											
04/09/22 12:00	0			0			0											
04/09/22 13:00	0			0			0											
04/09/22 14:00	0			0			0											
04/09/22 15:00	0			0			0											
04/09/22 16:00	0			0			0											
04/09/22 17:00	0			0			0											
04/09/22 18:00	0			0			0											
04/09/22 19:00	0			0			0											
04/09/22 20:00	0			0			0											
04/09/22 21:00	0			0			0											
04/09/22 22:00	0			0			0											
04/09/22 23:00	0			0			0											
04/10/22 0:00	0			0			0											
04/10/22 1:00	0			0			0											
04/10/22 2:00	0			0			0											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/10/22 3:00	0			0			0											
04/10/22 4:00	0			0			0											
04/10/22 5:00	0			0			0											
04/10/22 6:00	0			0			0											
04/10/22 7:00	0			0			0											
04/10/22 8:00	0			0			0											
04/10/22 9:00	0			0			0											
04/10/22 10:00	0			0			0											
04/10/22 11:00	0			0			0											
04/10/22 12:00	0			0			0											
04/10/22 13:00	0			0			0											
04/10/22 14:00	0			0			0											
04/10/22 15:00	0			0			0											
04/10/22 16:00	0			0			0											
04/10/22 17:00	0			0			0											
04/10/22 18:00	0			0			0											
04/10/22 19:00	0			0			0											
04/10/22 20:00	0			0			0											
04/10/22 21:00	0			0			0											
04/10/22 22:00	0			0			0											
04/10/22 23:00	0			0			0											
04/11/22 0:00	0			0			0											
04/11/22 1:00	0			0			0											
04/11/22 2:00	0			0			0											
04/11/22 3:00	0			0			0											
04/11/22 4:00	0			0			0											
04/11/22 5:00	0			0			0											
04/11/22 6:00	0			0			0											
04/11/22 7:00	0			0			0											
04/11/22 8:00	0			0			0											
04/11/22 9:00	0			0			0											
04/11/22 10:00	0			0			0											
04/11/22 11:00	0			0			0											
04/11/22 12:00	0			0			0											
04/11/22 13:00	0			0			0											
04/11/22 14:00	0			0			0											
04/11/22 15:00	0			0			0											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/11/22 16:00	0			0			0											
04/11/22 17:00	0			0			0											
04/11/22 18:00	0			0			0											
04/11/22 19:00	0			0			0											
04/11/22 20:00	0			0			0											
04/11/22 21:00	0			0			0											
04/11/22 22:00	0			0			0											
04/11/22 23:00	0			0			0											
04/12/22 0:00	0			0			0											
04/12/22 1:00	0			0			0											
04/12/22 2:00	0			0			0											
04/12/22 3:00	0			0			0											
04/12/22 4:00	0			0			0											
04/12/22 5:00	0			0			0											
04/12/22 6:00	0			0			0											
04/12/22 7:00	0			0			0											
04/12/22 8:00	0			0			0											
04/12/22 9:00	0			0			0											
04/12/22 10:00	0			0			0											
04/12/22 11:00	0			0			0											
04/12/22 12:00	0			0			0											
04/12/22 13:00	0			0			0											
04/12/22 14:00	0			0			0											
04/12/22 15:00	0			0			0											
04/12/22 16:00	0			0			0											
04/12/22 17:00	0			0			0											
04/12/22 18:00	0			0			0											
04/12/22 19:00	0			0			0											
04/12/22 20:00	0			0			0											
04/12/22 21:00	0			0			0											
04/12/22 22:00	0			0			0											
04/12/22 23:00	0			0			0											
04/13/22 0:00	0			0			0											
04/13/22 1:00	0			0			0											
04/13/22 2:00	0			0			0											
04/13/22 3:00	0			0			0											
04/13/22 4:00	0			0			0											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/13/22 5:00	0			0			0											
04/13/22 6:00	0			0			0											
04/13/22 7:00	0			0			0											
04/13/22 8:00	0			0			0											
04/13/22 9:00	0			0			0											
04/13/22 10:00	0			0			0											
04/13/22 11:00	0			0			0											
04/13/22 12:00	0			0			0											
04/13/22 13:00	0			0			0											
04/13/22 14:00	0			0			0											
04/13/22 15:00	0			0			0											
04/13/22 16:00	0			0			0											
04/13/22 17:00	0			0			0											
04/13/22 18:00	0			0			0											
04/13/22 19:00	0			0			0											
04/13/22 20:00	0			0			0											
04/13/22 21:00	0			0			0											
04/13/22 22:00	0			0			0											
04/13/22 23:00	0			0			0											
04/14/22 0:00	0			0			0											
04/14/22 1:00	0			0			0											
04/14/22 2:00	0			0			0											
04/14/22 3:00	0			0			0											
04/14/22 4:00	0			0			0											
04/14/22 5:00	0			0			0											
04/14/22 6:00	0			0			0											
04/14/22 7:00	0			0			0											
04/14/22 8:00	0			0			0											
04/14/22 9:00	0			0			0											
04/14/22 10:00	0			0			0											
04/14/22 11:00	0			0			0											
04/14/22 12:00	0			0			0											
04/14/22 13:00	0			0			0											
04/14/22 14:00	0			0			0											
04/14/22 15:00	0			0			0											
04/14/22 16:00	0			0			0											
04/14/22 17:00	0			0			0											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/14/22 18:00	0			0			0											
04/14/22 19:00	0			0			0											
04/14/22 20:00	0			0			0											
04/14/22 21:00	0			0			0											
04/14/22 22:00	0			0			0											
04/14/22 23:00	0			0			0											
04/15/22 0:00	0			0			0											
04/15/22 1:00	0			0			0											
04/15/22 2:00	0			0			0											
04/15/22 3:00	0			0			0											
04/15/22 4:00	0			0			0											
04/15/22 5:00	0			0			0											
04/15/22 6:00	0			0			0											
04/15/22 7:00	0			0			0											
04/15/22 8:00	0			0			0											
04/15/22 9:00	0			0			0											
04/15/22 10:00	0			0			0											
04/15/22 11:00	0			0			0											
04/15/22 12:00	0			0			0											
04/15/22 13:00	0			0			0											
04/15/22 14:00	0			0			0											
04/15/22 15:00	0			0			0											
04/15/22 16:00	0			0			0											
04/15/22 17:00	0			0			0											
04/15/22 18:00	0			0			0											
04/15/22 19:00	0			0			0											
04/15/22 20:00	0			0			0											
04/15/22 21:00	0			0			0											
04/15/22 22:00	0			0			0											
04/15/22 23:00	0			0			0											
04/16/22 0:00	0			0			0											
04/16/22 1:00	0			0			0											
04/16/22 2:00	0			0			0											
04/16/22 3:00	0			0			0											
04/16/22 4:00	0			0			0											
04/16/22 5:00	0			0			0											
04/16/22 6:00	0			0			0											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/16/22 7:00	0			0			0											
04/16/22 8:00	0			0			0											
04/16/22 9:00	0			0			0											
04/16/22 10:00	0			0			0											
04/16/22 11:00	0			0			0											
04/16/22 12:00	0			0			0											
04/16/22 13:00	0			0			0											
04/16/22 14:00	0			0			0											
04/16/22 15:00	0			0			0											
04/16/22 16:00	0			0			0											
04/16/22 17:00	0			0			0											
04/16/22 18:00	0			0			0											
04/16/22 19:00	0			0			0											
04/16/22 20:00	0			0			0											
04/16/22 21:00	0			0			0											
04/16/22 22:00	0			0			0											
04/16/22 23:00	0			0			0											
04/17/22 0:00	0			0			0											
04/17/22 1:00	0			0			0											
04/17/22 2:00	0			0			0											
04/17/22 3:00	0			0			0											
04/17/22 4:00	0			0			0											
04/17/22 5:00	0			0			0											
04/17/22 6:00	0			0			0											
04/17/22 7:00	0			0			0											
04/17/22 8:00	0			0			0											
04/17/22 9:00	0			0			0											
04/17/22 10:00	0			0			0											
04/17/22 11:00	0			0			0											
04/17/22 12:00	0			0			0											
04/17/22 13:00	0			0			0											
04/17/22 14:00	0			0			0											
04/17/22 15:00	0			0			0											
04/17/22 16:00	0			0			0											
04/17/22 17:00	0			0			0											
04/17/22 18:00	0			0			0											
04/17/22 19:00	0			0			0											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/17/22 20:00	0			0			0											
04/17/22 21:00	0			0			0											
04/17/22 22:00	0			0			0											
04/17/22 23:00	0			0			0											
04/18/22 0:00	0			0			0											
04/18/22 1:00	0			0			0											
04/18/22 2:00	0			0			0											
04/18/22 3:00	0			0			0											
04/18/22 4:00	0			0			0											
04/18/22 5:00	0			0			0											
04/18/22 6:00	0			0			0											
04/18/22 7:00	0			0			0											
04/18/22 8:00	0			0			0											
04/18/22 9:00	0			0			0											
04/18/22 10:00	0			0			0											
04/18/22 11:00	0			0			0											
04/18/22 12:00	0			0			0											
04/18/22 13:00	0			0			0											
04/18/22 14:00	0			0			0											
04/18/22 15:00	0			0			0											
04/18/22 16:00	0			0			0											
04/18/22 17:00	0			0			0											
04/18/22 18:00	0			0			0											
04/18/22 19:00	0			0			0											
04/18/22 20:00	0			0			0											
04/18/22 21:00	0			0			0											
04/18/22 22:00	0			0			0											
04/18/22 23:00	0			0			0											
04/19/22 0:00	0			0			0											
04/19/22 1:00	0			0			0											
04/19/22 2:00	0			0			0											
04/19/22 3:00	0			0			0											
04/19/22 4:00	0			0			0											
04/19/22 5:00	0			0			0											
04/19/22 6:00	0			0			0											
04/19/22 7:00	0			0			0											
04/19/22 8:00	0			0			0											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/19/22 9:00	0			0			0											
04/19/22 10:00	0			0			0											
04/19/22 11:00	0			0			0											
04/19/22 12:00	0			0			0											
04/19/22 13:00	0			0			0											
04/19/22 14:00	0			0			0											
04/19/22 15:00	0			0			0											
04/19/22 16:00	0			0			0											
04/19/22 17:00	0			0			0											
04/19/22 18:00	0			0			0											
04/19/22 19:00	0			0			0											
04/19/22 20:00	0			0			0											
04/19/22 21:00	0			0			0											
04/19/22 22:00	0			0			0											
04/19/22 23:00	0			0			0											
04/20/22 0:00	0			0			0											
04/20/22 1:00	0			0			0											
04/20/22 2:00	0			0			0											
04/20/22 3:00	0			0			0											
04/20/22 4:00	0			0			0											
04/20/22 5:00	0			0			0											
04/20/22 6:00	0			0			0											
04/20/22 7:00	0			0			0											
04/20/22 8:00	0			0			0											
04/20/22 9:00	0			0			0											
04/20/22 10:00	0			0			0											
04/20/22 11:00	0			0			0											
04/20/22 12:00	0			0			0											
04/20/22 13:00	0			0			0											
04/20/22 14:00	0			0			0											
04/20/22 15:00	0			0			0											
04/20/22 16:00	0			0			0											
04/20/22 17:00	0			0			0											
04/20/22 18:00	0			0			0											
04/20/22 19:00	0			0			0											
04/20/22 20:00	0			0			0											
04/20/22 21:00	0			0			0											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/20/22 22:00	0			0			0											
04/20/22 23:00	0			0			0											
04/21/22 0:00	0			0			0											
04/21/22 1:00	0			0			0											
04/21/22 2:00	0			0			0											
04/21/22 3:00	0			0			0											
04/21/22 4:00	0			0			0											
04/21/22 5:00	0			0			0											
04/21/22 6:00	0			0			0											
04/21/22 7:00	0			0			0											
04/21/22 8:00	0			0			0											
04/21/22 9:00	0			0			0											
04/21/22 10:00	0			0			0											
04/21/22 11:00	0			0			0											
04/21/22 12:00	0			0			0											
04/21/22 13:00	0			0			0											
04/21/22 14:00	0			0			0											
04/21/22 15:00	0			0			0											
04/21/22 16:00	0			0			0											
04/21/22 17:00	0			0			0											
04/21/22 18:00	0			0			0											
04/21/22 19:00	0			0			0											
04/21/22 20:00	0			0			0											
04/21/22 21:00	0			0			0											
04/21/22 22:00	0			0			0											
04/21/22 23:00	0			0			0											
04/22/22 0:00	0			0			0											
04/22/22 1:00	0			0			0											
04/22/22 2:00	0			0			0											
04/22/22 3:00	0			0			0											
04/22/22 4:00	0			0			0											
04/22/22 5:00	0			0			0											
04/22/22 6:00	0			0			0											
04/22/22 7:00	0			0			0											
04/22/22 8:00	0			0			0											
04/22/22 9:00	0			0			0											
04/22/22 10:00	0			0			0											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/22/22 11:00	0			0			0											
04/22/22 12:00	0			0			0											
04/22/22 13:00	0			0			0											
04/22/22 14:00	0			0			0											
04/22/22 15:00	0			0			0											
04/22/22 16:00	0			0			0											
04/22/22 17:00	0			0			0											
04/22/22 18:00	0			0			0											
04/22/22 19:00	0			0			0											
04/22/22 20:00	0			0			0											
04/22/22 21:00	0			0			0											
04/22/22 22:00	0			0			0											
04/22/22 23:00	0			0			0											
04/23/22 0:00	0			0			0											
04/23/22 1:00	0			0			0											
04/23/22 2:00	0			0			0											
04/23/22 3:00	0			0			0											
04/23/22 4:00	0			0			0											
04/23/22 5:00	0			0			0											
04/23/22 6:00	0			0			0											
04/23/22 7:00	0			0			0											
04/23/22 8:00	0			0			0											
04/23/22 9:00	0			0			0											
04/23/22 10:00	0			0			0											
04/23/22 11:00	0			0			0											
04/23/22 12:00	0			0			0											
04/23/22 13:00	0			0			0											
04/23/22 14:00	0			0			0											
04/23/22 15:00	0			0			0											
04/23/22 16:00	0			0			0											
04/23/22 17:00	0			0			0											
04/23/22 18:00	0			0			0											
04/23/22 19:00	0			0			0											
04/23/22 20:00	0			0			0											
04/23/22 21:00	0			0			0											
04/23/22 22:00	0			0			0											
04/23/22 23:00	0			0			0											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/24/22 0:00	0			0			0											
04/24/22 1:00	0			0			0											
04/24/22 2:00	0			0			0											
04/24/22 3:00	0			0			0											
04/24/22 4:00	0			0			0											
04/24/22 5:00	0			0			0											
04/24/22 6:00	0			0			0											
04/24/22 7:00	0			0			0											
04/24/22 8:00	0			0			0											
04/24/22 9:00	0			0			0											
04/24/22 10:00	0			0			0											
04/24/22 11:00	0			0			0											
04/24/22 12:00	0			0			0											
04/24/22 13:00	0			0			0											
04/24/22 14:00	0			0			0											
04/24/22 15:00	0			0			0											
04/24/22 16:00	0			0			0											
04/24/22 17:00	0			0			0											
04/24/22 18:00	0			0			0											
04/24/22 19:00	0			0			0											
04/24/22 20:00	0			0			0											
04/24/22 21:00	0			0			0											
04/24/22 22:00	0			0			0											
04/24/22 23:00	0			0			0											
04/25/22 0:00	0			0			0											
04/25/22 1:00	0			0			0											
04/25/22 2:00	0			0			0											
04/25/22 3:00	0			0			0											
04/25/22 4:00	0			0			0											
04/25/22 5:00	0			0			0											
04/25/22 6:00	0			0			0											
04/25/22 7:00	0			0			0											
04/25/22 8:00	0			0			0											
04/25/22 9:00	0			0			0											
04/25/22 10:00	0			0			0											
04/25/22 11:00	0			0			0											
04/25/22 12:00	0			0			0											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/25/22 13:00	0			0			0											
04/25/22 14:00	0			0			0											
04/25/22 15:00	0			0			0											
04/25/22 16:00	0			0			0											
04/25/22 17:00	0			0			0											
04/25/22 18:00	0			0			0											
04/25/22 19:00	0			0			0											
04/25/22 20:00	0			0			0											
04/25/22 21:00	0			0			0											
04/25/22 22:00	0			0			0											
04/25/22 23:00	0			0			0											
04/26/22 0:00	0			0			0											
04/26/22 1:00	0			0			0											
04/26/22 2:00	0			0			0											
04/26/22 3:00	0			0			0											
04/26/22 4:00	0			0			0											
04/26/22 5:00	0			0			0											
04/26/22 6:00	0			0			0											
04/26/22 7:00	0			0			0											
04/26/22 8:00	0			0			0											
04/26/22 9:00	0			0			0											
04/26/22 10:00	0			0			0											
04/26/22 11:00	0			0			0											
04/26/22 12:00	0			0			0											
04/26/22 13:00	1			0			0											
04/26/22 14:00	1			0			7											
04/26/22 15:00	1			0			17											
04/26/22 16:00	1			0			31											
04/26/22 17:00	1			0			42											
04/26/22 18:00	1			0			49											
04/26/22 19:00	1			0			55											
04/26/22 20:00	1			0			57											
04/26/22 21:00	1			0			59											
04/26/22 22:00	1			0			46											
04/26/22 23:00	0			0			26											
04/27/22 0:00	0			0			6											
04/27/22 1:00	0			0			0											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/27/22 2:00	0			0			0											
04/27/22 3:00	0			0			0											
04/27/22 4:00	0			0			0											
04/27/22 5:00	0			0			0											
04/27/22 6:00	0			0			0											
04/27/22 7:00	0			0			0											
04/27/22 8:00	1			0			2											
04/27/22 9:00	1			0			15											
04/27/22 10:00	1			0			27											
04/27/22 11:00	1			0			45											
04/27/22 12:00	1			0			50											
04/27/22 13:00	1			0			59											
04/27/22 14:00	1			0			60											
04/27/22 15:00	1			0			60											
04/27/22 16:00	1			0			59											
04/27/22 17:00	1			0			53											
04/27/22 18:00	1			0			47											
04/27/22 19:00	1			0			30											
04/27/22 20:00	0			0			15											
04/27/22 21:00	0			0			2											
04/27/22 22:00	0			0			0											
04/27/22 23:00	0			0			0											
04/28/22 0:00	0			0			0											
04/28/22 1:00	0			0			0											
04/28/22 2:00	0			0			0											
04/28/22 3:00	0			0			0											
04/28/22 4:00	0			0			0											
04/28/22 5:00	0			0			0											
04/28/22 6:00	0			0			0											
04/28/22 7:00	0			0			0											
04/28/22 8:00	1			0			1											
04/28/22 9:00	1			0			7											
04/28/22 10:00	1			0			15											
04/28/22 11:00	1			0			24											
04/28/22 12:00	1			0			33											
04/28/22 13:00	1			0			40											
04/28/22 14:00	1			0			51											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/28/22 15:00	1			0			57											
04/28/22 16:00	1			0			50											
04/28/22 17:00	1			0			32											
04/28/22 18:00	1			0			12											
04/28/22 19:00	0			0			3											
04/28/22 20:00	0			0			0											
04/28/22 21:00	0			0			0											
04/28/22 22:00	0			0			0											
04/28/22 23:00	0			0			0											
04/29/22 0:00	0			0			0											
04/29/22 1:00	0			0			0											
04/29/22 2:00	0			0			0											
04/29/22 3:00	0			0			0											
04/29/22 4:00	0			0			0											
04/29/22 5:00	0			0			0											
04/29/22 6:00	0			0			0											
04/29/22 7:00	1			1			0											
04/29/22 8:00	1			6			0											
04/29/22 9:00	1			19			0											
04/29/22 10:00	1			38			0											
04/29/22 11:00	1			53			0											
04/29/22 12:00	1			55			0											
04/29/22 13:00	1			56			0											
04/29/22 14:00	1			56			0											
04/29/22 15:00	1			62			0											
04/29/22 16:00	1			55			0											
04/29/22 17:00	0			34			0											
04/29/22 18:00	0			14			0											
04/29/22 19:00	0			0			0											
04/29/22 20:00	0			0			0											
04/29/22 21:00	0			0			0											
04/29/22 22:00	0			0			0											
04/29/22 23:00	0			0			0											
04/30/22 0:00	0			0			0											
04/30/22 1:00	0			0			0											
04/30/22 2:00	0			0			0											
04/30/22 3:00	0			0			0											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/30/22 4:00	0			0			0											
04/30/22 5:00	0			0			0											
04/30/22 6:00	0			0			0											
04/30/22 7:00	0			0			0											
04/30/22 8:00	0			0			0											
04/30/22 9:00	0			0			0											
04/30/22 10:00	0			0			0											
04/30/22 11:00	0			0			0											
04/30/22 12:00	0			0			0											
04/30/22 13:00	0			0			0											
04/30/22 14:00	0			0			0											
04/30/22 15:00	0			0			0											
04/30/22 16:00	0			0			0											
04/30/22 17:00	0			0			0											
04/30/22 18:00	0			0			0											
04/30/22 19:00	0			0			0											
04/30/22 20:00	0			0			0											
04/30/22 21:00	0			0			0											
04/30/22 22:00	0			0			0											
04/30/22 23:00	0			0			0											
05/01/22 0:00	0			0			0											
05/01/22 1:00	0			0			0											
05/01/22 2:00	0			0			0											
05/01/22 3:00	0			0			0											
05/01/22 4:00	1			4			0											
05/01/22 5:00	1			15			0											
05/01/22 6:00	1			27			0											
05/01/22 7:00	1			34			0											
05/01/22 8:00	1			33			0											
05/01/22 9:00	1			31			0											
05/01/22 10:00	1			30			0											
05/01/22 11:00	1			30			0											
05/01/22 12:00	1			30			0											
05/01/22 13:00	1			30			0											
05/01/22 14:00	1			30			0											
05/01/22 15:00	1			30			0											
05/01/22 16:00	1			30			0											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/01/22 17:00	1			29			0											
05/01/22 18:00	1			29			0											
05/01/22 19:00	1			29			0											
05/01/22 20:00	1			29			0											
05/01/22 21:00	1			29			0											
05/01/22 22:00	1			29			0											
05/01/22 23:00	1			29			0											
05/02/22 0:00	1			29			0											
05/02/22 1:00	1			29			0											
05/02/22 2:00	1			29			0											
05/02/22 3:00	1			29			0											
05/02/22 4:00	1			29			0											
05/02/22 5:00	1			29			0											
05/02/22 6:00	1			29			0											
05/02/22 7:00	1			29			0											
05/02/22 8:00	1			30			0											
05/02/22 9:00	1			32			0											
05/02/22 10:00	1			33			0											
05/02/22 11:00	1			33			0											
05/02/22 12:00	1			33			0											
05/02/22 13:00	1			33			0											
05/02/22 14:00	1			33			0											
05/02/22 15:00	1			33			0											
05/02/22 16:00	1			33			0											
05/02/22 17:00	1			37			0											
05/02/22 18:00	1			40			0											
05/02/22 19:00	1			46			0											
05/02/22 20:00	1			47			0											
05/02/22 21:00	1			53			0											
05/02/22 22:00	1			57			0											
05/02/22 23:00	1			61			0											
05/03/22 0:00	1			60			0											
05/03/22 1:00	1			47			0											
05/03/22 2:00	0			26			0											
05/03/22 3:00	0			7			0											
05/03/22 4:00	0			0			0											
05/03/22 5:00	0			0			0											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/03/22 6:00	0			0			0											
05/03/22 7:00	0			0			0											
05/03/22 8:00	0			0			0											
05/03/22 9:00	0			0			0											
05/03/22 10:00	0			0			0											
05/03/22 11:00	0			0			0											
05/03/22 12:00	0			0			0											
05/03/22 13:00	0			0			0											
05/03/22 14:00	0			0			0											
05/03/22 15:00	0			0			0											
05/03/22 16:00	0			0			0											
05/03/22 17:00	0			0			0											
05/03/22 18:00	0			0			0											
05/03/22 19:00	0			0			0											
05/03/22 20:00	0			0			0											
05/03/22 21:00	0			0			0											
05/03/22 22:00	1			4			0											
05/03/22 23:00	1			17			2											
05/04/22 0:00	1			29			13											
05/04/22 1:00	1			36			25											
05/04/22 2:00	1			41			42											
05/04/22 3:00	1			50			51											
05/04/22 4:00	1			59			61											
05/04/22 5:00	1			58			60											
05/04/22 6:00	1			55			57											
05/04/22 7:00	1			56			58											
05/04/22 8:00	1			53			54											
05/04/22 9:00	1			47			48											
05/04/22 10:00	1			36			37											
05/04/22 11:00	1			33			34											
05/04/22 12:00	1			33			34											
05/04/22 13:00	1			34			35											
05/04/22 14:00	1			34			35											
05/04/22 15:00	1			33			34											
05/04/22 16:00	1			33			33											
05/04/22 17:00	1			34			35											
05/04/22 18:00	1			47			48											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/04/22 19:00	1			58			60											
05/04/22 20:00	1			67			70											
05/04/22 21:00	1			67			71											
05/04/22 22:00	1			66			71											
05/04/22 23:00	1			62			66											
05/05/22 0:00	1			55			57											
05/05/22 1:00	1			45			46											
05/05/22 2:00	1			39			40											
05/05/22 3:00	1			35			36											
05/05/22 4:00	1			38			39											
05/05/22 5:00	1			40			41											
05/05/22 6:00	1			40			41											
05/05/22 7:00	1			35			36											
05/05/22 8:00	1			32			33											
05/05/22 9:00	1			33			34											
05/05/22 10:00	1			33			34											
05/05/22 11:00	1			34			35											
05/05/22 12:00	1			39			40											
05/05/22 13:00	1			46			47											
05/05/22 14:00	1			47			48											
05/05/22 15:00	1			42			44											
05/05/22 16:00	1			35			36											
05/05/22 17:00	1			37			38											
05/05/22 18:00	1			47			48											
05/05/22 19:00	1			58			59											
05/05/22 20:00	1			66			67											
05/05/22 21:00	1			63			64											
05/05/22 22:00	1			54			55											
05/05/22 23:00	1			44			45											
05/06/22 0:00	1			36			37											
05/06/22 1:00	1			34			35											
05/06/22 2:00	1			34			35											
05/06/22 3:00	1			35			36											
05/06/22 4:00	1			45			46											
05/06/22 5:00	1			56			57											
05/06/22 6:00	1			66			67											
05/06/22 7:00	1			59			61											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/06/22 8:00	1			59			60											
05/06/22 9:00	1			58			60											
05/06/22 10:00	1			65			66											
05/06/22 11:00	1			65			66											
05/06/22 12:00	1			63			64											
05/06/22 13:00	1			64			65											
05/06/22 14:00	1			58			59											
05/06/22 15:00	1			49			50											
05/06/22 16:00	1			48			49											
05/06/22 17:00	1			54			55											
05/06/22 18:00	1			65			66											
05/06/22 19:00	1			66			67											
05/06/22 20:00	1			66			67											
05/06/22 21:00	1			66			67											
05/06/22 22:00	1			62			64											
05/06/22 23:00	1			61			41											
05/07/22 0:00	1			59			19											
05/07/22 1:00	1			62			0											
05/07/22 2:00	1			64			0											
05/07/22 3:00	1			65			0											
05/07/22 4:00	1			65			0											
05/07/22 5:00	1			65			0											
05/07/22 6:00	1			65			0											
05/07/22 7:00	1			65			0											
05/07/22 8:00	1			65			0											
05/07/22 9:00	1			65			0											
05/07/22 10:00	1			64			0											
05/07/22 11:00	1			64			0											
05/07/22 12:00	1			63			4											
05/07/22 13:00	1			52			14											
05/07/22 14:00	1			41			25											
05/07/22 15:00	1			32			33											
05/07/22 16:00	1			32			33											
05/07/22 17:00	1			33			34											
05/07/22 18:00	1			43			45											
05/07/22 19:00	1			55			57											
05/07/22 20:00	1			65			67											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/07/22 21:00	1			55			57											
05/07/22 22:00	1			44			45											
05/07/22 23:00	1			33			34											
05/08/22 0:00	1			32			33											
05/08/22 1:00	1			32			33											
05/08/22 2:00	1			32			33											
05/08/22 3:00	1			32			33											
05/08/22 4:00	1			32			33											
05/08/22 5:00	1			32			33											
05/08/22 6:00	1			25			35											
05/08/22 7:00	1			14			34											
05/08/22 8:00	1			4			34											
05/08/22 9:00	1			0			33											
05/08/22 10:00	1			0			33											
05/08/22 11:00	1			0			33											
05/08/22 12:00	1			0			33											
05/08/22 13:00	1			0			33											
05/08/22 14:00	1			0			33											
05/08/22 15:00	1			0			33											
05/08/22 16:00	1			0			36											
05/08/22 17:00	1			8			41											
05/08/22 18:00	1			21			43											
05/08/22 19:00	1			43			51											
05/08/22 20:00	1			57			59											
05/08/22 21:00	1			66			68											
05/08/22 22:00	1			56			57											
05/08/22 23:00	1			45			46											
05/09/22 0:00	1			33			34											
05/09/22 1:00	1			32			33											
05/09/22 2:00	1			32			33											
05/09/22 3:00	1			32			33											
05/09/22 4:00	1			32			33											
05/09/22 5:00	1			32			33											
05/09/22 6:00	1			32			33											
05/09/22 7:00	1			32			33											
05/09/22 8:00	1			32			33											
05/09/22 9:00	1			32			33											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/09/22 10:00	1			32			33											
05/09/22 11:00	1			23			35											
05/09/22 12:00	1			12			35											
05/09/22 13:00	1			2			35											
05/09/22 14:00	1			0			33											
05/09/22 15:00	1			0			33											
05/09/22 16:00	1			0			33											
05/09/22 17:00	1			0			33											
05/09/22 18:00	1			0			33											
05/09/22 19:00	1			0			34											
05/09/22 20:00	1			0			34											
05/09/22 21:00	1			0			34											
05/09/22 22:00	1			0			33											
05/09/22 23:00	1			0			23											
05/10/22 0:00	0			0			12											
05/10/22 1:00	0			0			2											
05/10/22 2:00	0			0			0											
05/10/22 3:00	0			0			0											
05/10/22 4:00	0			0			0											
05/10/22 5:00	0			0			0											
05/10/22 6:00	0			0			0											
05/10/22 7:00	0			0			0											
05/10/22 8:00	0			0			0											
05/10/22 9:00	0			0			0											
05/10/22 10:00	0			0			0											
05/10/22 11:00	0			0			0											
05/10/22 12:00	0			0			0											
05/10/22 13:00	0			0			0											
05/10/22 14:00	0			0			0											
05/10/22 15:00	0			0			0											
05/10/22 16:00	0			0			0											
05/10/22 17:00	0			0			0											
05/10/22 18:00	0			0			0											
05/10/22 19:00	0			0			0											
05/10/22 20:00	0			0			0											
05/10/22 21:00	0			0			0											
05/10/22 22:00	0			0			0											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/10/22 23:00	0			0			0											
05/11/22 0:00	0			0			0											
05/11/22 1:00	0			0			0											
05/11/22 2:00	0			0			0											
05/11/22 3:00	0			0			0											
05/11/22 4:00	0			0			0											
05/11/22 5:00	0			0			0											
05/11/22 6:00	0			0			0											
05/11/22 7:00	0			0			0											
05/11/22 8:00	0			0			0											
05/11/22 9:00	0			0			0											
05/11/22 10:00	0			0			0											
05/11/22 11:00	0			0			0											
05/11/22 12:00	0			0			0											
05/11/22 13:00	0			0			0											
05/11/22 14:00	0			0			0											
05/11/22 15:00	0			0			0											
05/11/22 16:00	0			0			0											
05/11/22 17:00	0			0			0											
05/11/22 18:00	0			0			0											
05/11/22 19:00	0			0			0											
05/11/22 20:00	0			0			0											
05/11/22 21:00	0			0			0											
05/11/22 22:00	0			0			0											
05/11/22 23:00	0			0			0											
05/12/22 0:00	0			0			0											
05/12/22 1:00	0			0			0											
05/12/22 2:00	0			0			0											
05/12/22 3:00	0			0			0											
05/12/22 4:00	0			0			0											
05/12/22 5:00	0			0			0											
05/12/22 6:00	0			0			0											
05/12/22 7:00	0			0			0											
05/12/22 8:00	0			0			0											
05/12/22 9:00	0			0			0											
05/12/22 10:00	0			0			0											
05/12/22 11:00	0			0			0											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/12/22 12:00	0			0			0											
05/12/22 13:00	0			0			0											
05/12/22 14:00	0			0			0											
05/12/22 15:00	0			0			0											
05/12/22 16:00	0			0			0											
05/12/22 17:00	0			0			0											
05/12/22 18:00	0			0			0											
05/12/22 19:00	0			0			0											
05/12/22 20:00	0			0			0											
05/12/22 21:00	0			0			0											
05/12/22 22:00	0			0			0											
05/12/22 23:00	0			0			0											
05/13/22 0:00	0			0			0											
05/13/22 1:00	0			0			0											
05/13/22 2:00	0			0			0											
05/13/22 3:00	0			0			0											
05/13/22 4:00	0			0			0											
05/13/22 5:00	0			0			0											
05/13/22 6:00	0			0			0											
05/13/22 7:00	0			0			0											
05/13/22 8:00	0			0			0											
05/13/22 9:00	0			0			0											
05/13/22 10:00	0			0			0											
05/13/22 11:00	0			0			0											
05/13/22 12:00	0			0			0											
05/13/22 13:00	0			0			0											
05/13/22 14:00	0			0			0											
05/13/22 15:00	0			0			0											
05/13/22 16:00	0			0			0											
05/13/22 17:00	0			0			0											
05/13/22 18:00	0			0			0											
05/13/22 19:00	0			0			0											
05/13/22 20:00	0			0			0											
05/13/22 21:00	0			0			0											
05/13/22 22:00	0			0			0											
05/13/22 23:00	0			0			0											
05/14/22 0:00	0			0			0											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/14/22 1:00	0			0			0											
05/14/22 2:00	0			0			0											
05/14/22 3:00	0			0			0											
05/14/22 4:00	0			0			0											
05/14/22 5:00	0			0			0											
05/14/22 6:00	0			0			0											
05/14/22 7:00	0			0			0											
05/14/22 8:00	0			0			0											
05/14/22 9:00	0			0			0											
05/14/22 10:00	0			0			0											
05/14/22 11:00	0			0			0											
05/14/22 12:00	0			0			0											
05/14/22 13:00	0			0			0											
05/14/22 14:00	0			0			0											
05/14/22 15:00	0			0			0											
05/14/22 16:00	0			0			0											
05/14/22 17:00	0			0			0											
05/14/22 18:00	0			0			0											
05/14/22 19:00	0			0			0											
05/14/22 20:00	0			0			0											
05/14/22 21:00	0			0			0											
05/14/22 22:00	0			0			0											
05/14/22 23:00	0			0			0											
05/15/22 0:00	0			0			0											
05/15/22 1:00	0			0			0											
05/15/22 2:00	0			0			0											
05/15/22 3:00	0			0			0											
05/15/22 4:00	0			0			0											
05/15/22 5:00	0			0			0											
05/15/22 6:00	0			0			0											
05/15/22 7:00	0			0			0											
05/15/22 8:00	0			0			0											
05/15/22 9:00	0			0			0											
05/15/22 10:00	0			0			0											
05/15/22 11:00	0			0			0											
05/15/22 12:00	0			0			0											
05/15/22 13:00	0			0			0											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/15/22 14:00	0			0			0											
05/15/22 15:00	0			0			0											
05/15/22 16:00	0			0			0											
05/15/22 17:00	0			0			0											
05/15/22 18:00	0			0			0											
05/15/22 19:00	0			0			0											
05/15/22 20:00	0			0			0											
05/15/22 21:00	0			0			0											
05/15/22 22:00	0			0			0											
05/15/22 23:00	0			0			0											
05/16/22 0:00	0			0			0											
05/16/22 1:00	0			0			0											
05/16/22 2:00	0			0			0											
05/16/22 3:00	0			0			0											
05/16/22 4:00	0			0			0											
05/16/22 5:00	0			0			0											
05/16/22 6:00	0			0			0											
05/16/22 7:00	0			0			0											
05/16/22 8:00	0			0			0											
05/16/22 9:00	0			0			0											
05/16/22 10:00	0			0			0											
05/16/22 11:00	0			0			0											
05/16/22 12:00	0			0			0											
05/16/22 13:00	0			0			0											
05/16/22 14:00	0			0			0											
05/16/22 15:00	0			0			0											
05/16/22 16:00	0			0			0											
05/16/22 17:00	0			0			0											
05/16/22 18:00	0			0			0											
05/16/22 19:00	0			0			0											
05/16/22 20:00	0			0			0											
05/16/22 21:00	0			0			0											
05/16/22 22:00	0			0			0											
05/16/22 23:00	0			0			0											
05/17/22 0:00	0			0			0											
05/17/22 1:00	0			0			0											
05/17/22 2:00	0			0			0											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/17/22 3:00	0			0			0											
05/17/22 4:00	0			0			0											
05/17/22 5:00	0			0			0											
05/17/22 6:00	0			0			0											
05/17/22 7:00	0			0			0											
05/17/22 8:00	0			0			0											
05/17/22 9:00	0			0			0											
05/17/22 10:00	0			0			0											
05/17/22 11:00	0			0			0											
05/17/22 12:00	0			0			0											
05/17/22 13:00	0			0			0											
05/17/22 14:00	0			0			0											
05/17/22 15:00	1			7			0											
05/17/22 16:00	1			20			0											
05/17/22 17:00	1			34			7											
05/17/22 18:00	1			45			24											
05/17/22 19:00	1			52			45											
05/17/22 20:00	1			61			61											
05/17/22 21:00	1			67			68											
05/17/22 22:00	1			66			67											
05/17/22 23:00	1			54			55											
05/18/22 0:00	1			41			42											
05/18/22 1:00	1			31			32											
05/18/22 2:00	1			36			37											
05/18/22 3:00	1			51			52											
05/18/22 4:00	1			69			70											
05/18/22 5:00	1			77			78											
05/18/22 6:00	1			68			69											
05/18/22 7:00	1			59			60											
05/18/22 8:00	1			57			58											
05/18/22 9:00	1			61			62											
05/18/22 10:00	1			63			64											
05/18/22 11:00	1			67			68											
05/18/22 12:00	1			68			69											
05/18/22 13:00	1			70			71											
05/18/22 14:00	1			71			72											
05/18/22 15:00	1			74			74											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/18/22 16:00	1			73			73											
05/18/22 17:00	1			72			72											
05/18/22 18:00	1			72			73											
05/18/22 19:00	1			74			75											
05/18/22 20:00	1			74			75											
05/18/22 21:00	1			72			73											
05/18/22 22:00	1			70			71											
05/18/22 23:00	1			63			63											
05/19/22 0:00	1			48			55											
05/19/22 1:00	1			25			46											
05/19/22 2:00	1			7			39											
05/19/22 3:00	1			0			41											
05/19/22 4:00	1			0			49											
05/19/22 5:00	1			0			60											
05/19/22 6:00	1			0			57											
05/19/22 7:00	1			0			49											
05/19/22 8:00	1			0			42											
05/19/22 9:00	1			0			39											
05/19/22 10:00	1			0			36											
05/19/22 11:00	1			0			43											
05/19/22 12:00	1			7			48											
05/19/22 13:00	1			23			53											
05/19/22 14:00	1			46			56											
05/19/22 15:00	1			58			58											
05/19/22 16:00	1			58			59											
05/19/22 17:00	1			58			58											
05/19/22 18:00	1			62			63											
05/19/22 19:00	1			68			70											
05/19/22 20:00	1			71			72											
05/19/22 21:00	1			71			73											
05/19/22 22:00	1			65			67											
05/19/22 23:00	1			40			48											
05/20/22 0:00	0			17			25											
05/20/22 1:00	0			0			6											
05/20/22 2:00	0			0			0											
05/20/22 3:00	0			0			0											
05/20/22 4:00	0			0			0											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/20/22 5:00	0			0			0											
05/20/22 6:00	0			0			0											
05/20/22 7:00	0			0			0											
05/20/22 8:00	0			0			0											
05/20/22 9:00	0			0			0											
05/20/22 10:00	0			0			0											
05/20/22 11:00	0			0			0											
05/20/22 12:00	0			0			0											
05/20/22 13:00	0			0			0											
05/20/22 14:00	0			0			0											
05/20/22 15:00	0			0			0											
05/20/22 16:00	0			0			0											
05/20/22 17:00	0			0			0											
05/20/22 18:00	0			0			0											
05/20/22 19:00	0			0			0											
05/20/22 20:00	0			0			0											
05/20/22 21:00	0			0			0											
05/20/22 22:00	0			0			0											
05/20/22 23:00	0			0			0											
05/21/22 0:00	0			0			0											
05/21/22 1:00	0			0			0											
05/21/22 2:00	0			0			0											
05/21/22 3:00	0			0			0											
05/21/22 4:00	0			0			0											
05/21/22 5:00	0			0			0											
05/21/22 6:00	0			0			0											
05/21/22 7:00	0			0			0											
05/21/22 8:00	0			0			0											
05/21/22 9:00	0			0			0											
05/21/22 10:00	0			0			0											
05/21/22 11:00	0			0			0											
05/21/22 12:00	0			0			0											
05/21/22 13:00	0			0			0											
05/21/22 14:00	0			0			0											
05/21/22 15:00	0			0			0											
05/21/22 16:00	0			0			0											
05/21/22 17:00	0			0			0											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/21/22 18:00	0			0			0											
05/21/22 19:00	0			0			0											
05/21/22 20:00	0			0			0											
05/21/22 21:00	0			0			0											
05/21/22 22:00	0			0			0											
05/21/22 23:00	0			0			0											
05/22/22 0:00	0			0			0											
05/22/22 1:00	0			0			0											
05/22/22 2:00	0			0			0											
05/22/22 3:00	0			0			0											
05/22/22 4:00	0			0			0											
05/22/22 5:00	0			0			0											
05/22/22 6:00	0			0			0											
05/22/22 7:00	0			0			0											
05/22/22 8:00	0			0			0											
05/22/22 9:00	0			0			0											
05/22/22 10:00	0			0			0											
05/22/22 11:00	0			0			0											
05/22/22 12:00	0			0			0											
05/22/22 13:00	0			0			0											
05/22/22 14:00	0			0			0											
05/22/22 15:00	0			0			0											
05/22/22 16:00	0			0			0											
05/22/22 17:00	0			0			0											
05/22/22 18:00	0			0			0											
05/22/22 19:00	0			0			0											
05/22/22 20:00	0			0			0											
05/22/22 21:00	0			0			0											
05/22/22 22:00	0			0			0											
05/22/22 23:00	0			0			0											
05/23/22 0:00	0			0			0											
05/23/22 1:00	0			0			0											
05/23/22 2:00	0			0			0											
05/23/22 3:00	0			0			0											
05/23/22 4:00	0			0			0											
05/23/22 5:00	0			0			0											
05/23/22 6:00	0			0			0											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/23/22 7:00	0			0			0											
05/23/22 8:00	0			0			0											
05/23/22 9:00	0			0			0											
05/23/22 10:00	0			0			0											
05/23/22 11:00	0			0			0											
05/23/22 12:00	0			0			0											
05/23/22 13:00	0			0			0											
05/23/22 14:00	0			0			0											
05/23/22 15:00	0			0			0											
05/23/22 16:00	0			0			0											
05/23/22 17:00	0			0			0											
05/23/22 18:00	0			0			0											
05/23/22 19:00	0			0			0											
05/23/22 20:00	0			0			0											
05/23/22 21:00	0			0			0											
05/23/22 22:00	0			0			0											
05/23/22 23:00	0			0			0											
05/24/22 0:00	0			0			0											
05/24/22 1:00	0			0			0											
05/24/22 2:00	0			0			0											
05/24/22 3:00	1			0			3											
05/24/22 4:00	1			0			10											
05/24/22 5:00	1			0			18											
05/24/22 6:00	1			0			26											
05/24/22 7:00	1			0			35											
05/24/22 8:00	1			8			42											
05/24/22 9:00	1			19			43											
05/24/22 10:00	1			35			42											
05/24/22 11:00	1			44			45											
05/24/22 12:00	1			53			54											
05/24/22 13:00	1			61			62											
05/24/22 14:00	1			70			70											
05/24/22 15:00	1			76			77											
05/24/22 16:00	1			79			79											
05/24/22 17:00	1			78			78											
05/24/22 18:00	1			78			78											
05/24/22 19:00	1			78			79											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/24/22 20:00	1			77			78											
05/24/22 21:00	1			73			74											
05/24/22 22:00	1			72			73											
05/24/22 23:00	1			66			67											
05/25/22 0:00	1			59			61											
05/25/22 1:00	1			48			49											
05/25/22 2:00	1			42			43											
05/25/22 3:00	1			42			42											
05/25/22 4:00	1			51			51											
05/25/22 5:00	1			60			61											
05/25/22 6:00	1			65			66											
05/25/22 7:00	1			60			60											
05/25/22 8:00	1			50			50											
05/25/22 9:00	1			43			44											
05/25/22 10:00	1			47			48											
05/25/22 11:00	1			63			63											
05/25/22 12:00	1			74			75											
05/25/22 13:00	1			80			81											
05/25/22 14:00	1			81			82											
05/25/22 15:00	1			81			82											
05/25/22 16:00	1			81			82											
05/25/22 17:00	1			81			81											
05/25/22 18:00	1			80			81											
05/25/22 19:00	1			77			78											
05/25/22 20:00	1			73			74											
05/25/22 21:00	1			69			70											
05/25/22 22:00	1			62			63											
05/25/22 23:00	1			39			48											
05/26/22 0:00	0			17			25											
05/26/22 1:00	0			0			8											
05/26/22 2:00	0			0			0											
05/26/22 3:00	0			0			0											
05/26/22 4:00	0			0			0											
05/26/22 5:00	0			0			0											
05/26/22 6:00	0			0			0											
05/26/22 7:00	0			0			0											
05/26/22 8:00	0			0			0											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/26/22 9:00	0			0			0											
05/26/22 10:00	0			0			0											
05/26/22 11:00	1			3			0											
05/26/22 12:00	1			11			0											
05/26/22 13:00	1			19			0											
05/26/22 14:00	1			31			0											
05/26/22 15:00	1			45			0											
05/26/22 16:00	1			57			0											
05/26/22 17:00	1			62			0											
05/26/22 18:00	1			63			0											
05/26/22 19:00	1			63			0											
05/26/22 20:00	1			55			0											
05/26/22 21:00	0			34			0											
05/26/22 22:00	0			13			0											
05/26/22 23:00	0			0			0											
05/27/22 0:00	0			0			0											
05/27/22 1:00	0			0			0											
05/27/22 2:00	0			0			0											
05/27/22 3:00	0			0			0											
05/27/22 4:00	0			0			0											
05/27/22 5:00	0			0			0											
05/27/22 6:00	0			0			0											
05/27/22 7:00	0			0			0											
05/27/22 8:00	0			0			0											
05/27/22 9:00	0			0			0											
05/27/22 10:00	0			0			0											
05/27/22 11:00	0			0			0											
05/27/22 12:00	0			0			0											
05/27/22 13:00	0			0			0											
05/27/22 14:00	0			0			0											
05/27/22 15:00	0			0			0											
05/27/22 16:00	0			0			0											
05/27/22 17:00	0			0			0											
05/27/22 18:00	0			0			0											
05/27/22 19:00	0			0			0											
05/27/22 20:00	0			0			0											
05/27/22 21:00	0			0			0											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/27/22 22:00	0			0			0											
05/27/22 23:00	0			0			0											
05/28/22 0:00	0			0			0											
05/28/22 1:00	0			0			0											
05/28/22 2:00	0			0			0											
05/28/22 3:00	0			0			0											
05/28/22 4:00	0			0			0											
05/28/22 5:00	0			0			0											
05/28/22 6:00	0			0			0											
05/28/22 7:00	0			0			0											
05/28/22 8:00	0			0			0											
05/28/22 9:00	0			0			0											
05/28/22 10:00	0			0			0											
05/28/22 11:00	0			0			0											
05/28/22 12:00	0			0			0											
05/28/22 13:00	0			0			0											
05/28/22 14:00	0			0			0											
05/28/22 15:00	0			0			0											
05/28/22 16:00	0			0			0											
05/28/22 17:00	0			0			0											
05/28/22 18:00	0			0			0											
05/28/22 19:00	0			0			0											
05/28/22 20:00	0			0			0											
05/28/22 21:00	0			0			0											
05/28/22 22:00	0			0			0											
05/28/22 23:00	0			0			0											
05/29/22 0:00	0			0			0											
05/29/22 1:00	0			0			0											
05/29/22 2:00	0			0			0											
05/29/22 3:00	0			0			0											
05/29/22 4:00	0			0			0											
05/29/22 5:00	0			0			0											
05/29/22 6:00	0			0			0											
05/29/22 7:00	0			0			0											
05/29/22 8:00	0			0			0											
05/29/22 9:00	0			0			0											
05/29/22 10:00	0			0			0											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/29/22 11:00	0			0			0											
05/29/22 12:00	0			0			0											
05/29/22 13:00	0			0			0											
05/29/22 14:00	0			0			0											
05/29/22 15:00	0			0			0											
05/29/22 16:00	0			0			0											
05/29/22 17:00	0			0			0											
05/29/22 18:00	0			0			0											
05/29/22 19:00	0			0			0											
05/29/22 20:00	0			0			0											
05/29/22 21:00	0			0			0											
05/29/22 22:00	0			0			0											
05/29/22 23:00	0			0			0											
05/30/22 0:00	0			0			0											
05/30/22 1:00	0			0			0											
05/30/22 2:00	0			0			0											
05/30/22 3:00	0			0			0											
05/30/22 4:00	0			0			0											
05/30/22 5:00	0			0			0											
05/30/22 6:00	0			0			0											
05/30/22 7:00	0			0			0											
05/30/22 8:00	0			0			0											
05/30/22 9:00	0			0			0											
05/30/22 10:00	0			0			0											
05/30/22 11:00	0			0			0											
05/30/22 12:00	0			0			0											
05/30/22 13:00	0			0			0											
05/30/22 14:00	0			0			0											
05/30/22 15:00	0			0			0											
05/30/22 16:00	0			0			0											
05/30/22 17:00	0			0			0											
05/30/22 18:00	0			0			0											
05/30/22 19:00	0			0			0											
05/30/22 20:00	0			0			0											
05/30/22 21:00	0			0			0											
05/30/22 22:00	0			0			0											
05/30/22 23:00	0			0			0											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/31/22 0:00	0			0			0											
05/31/22 1:00	0			0			0											
05/31/22 2:00	0			0			0											
05/31/22 3:00	0			0			0											
05/31/22 4:00	0			0			0											
05/31/22 5:00	0			0			0											
05/31/22 6:00	0			0			0											
05/31/22 7:00	0			0			0											
05/31/22 8:00	0			0			0											
05/31/22 9:00	0			0			0											
05/31/22 10:00	0			0			0											
05/31/22 11:00	0			0			0											
05/31/22 12:00	0			0			0											
05/31/22 13:00	0			0			0											
05/31/22 14:00	0			0			0											
05/31/22 15:00	0			0			0											
05/31/22 16:00	0			0			0											
05/31/22 17:00	0			0			0											
05/31/22 18:00	0			0			0											
05/31/22 19:00	0			0			0											
05/31/22 20:00	0			0			0											
05/31/22 21:00	0			0			0											
05/31/22 22:00	0			0			0											
05/31/22 23:00	0			0			0											
06/01/22 0:00	0			0			0											
06/01/22 1:00	0			0			0											
06/01/22 2:00	0			0			0											
06/01/22 3:00	0			0			0											
06/01/22 4:00	0			0			0											
06/01/22 5:00	0			0			0											
06/01/22 6:00	0			0			0											
06/01/22 7:00	0			0			0											
06/01/22 8:00	0			0			0											
06/01/22 9:00	0			0			0											
06/01/22 10:00	0			0			0											
06/01/22 11:00	0			0			0											
06/01/22 12:00	0			0			0											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/01/22 13:00	0			0			0											
06/01/22 14:00	0			0			0											
06/01/22 15:00	0			0			0											
06/01/22 16:00	0			0			0											
06/01/22 17:00	0			0			0											
06/01/22 18:00	0			0			0											
06/01/22 19:00	0			0			0											
06/01/22 20:00	0			0			0											
06/01/22 21:00	0			0			0											
06/01/22 22:00	0			0			0											
06/01/22 23:00	0			0			0											
06/02/22 0:00	0			0			0											
06/02/22 1:00	0			0			0											
06/02/22 2:00	0			0			0											
06/02/22 3:00	0			0			0											
06/02/22 4:00	0			0			0											
06/02/22 5:00	0			0			0											
06/02/22 6:00	0			0			0											
06/02/22 7:00	0			0			0											
06/02/22 8:00	0			0			0											
06/02/22 9:00	0			0			0											
06/02/22 10:00	0			0			0											
06/02/22 11:00	0			0			0											
06/02/22 12:00	0			0			0											
06/02/22 13:00	0			0			0											
06/02/22 14:00	0			0			0											
06/02/22 15:00	0			0			0											
06/02/22 16:00	0			0			0											
06/02/22 17:00	0			0			0											
06/02/22 18:00	0			0			0											
06/02/22 19:00	0			0			0											
06/02/22 20:00	0			0			0											
06/02/22 21:00	0			0			0											
06/02/22 22:00	0			0			0											
06/02/22 23:00	0			0			0											
06/03/22 0:00	0			0			0											
06/03/22 1:00	0			0			0											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/03/22 2:00	0			0			0											
06/03/22 3:00	0			0			0											
06/03/22 4:00	0			0			0											
06/03/22 5:00	0			0			0											
06/03/22 6:00	0			0			0											
06/03/22 7:00	0			0			0											
06/03/22 8:00	0			0			0											
06/03/22 9:00	0			0			0											
06/03/22 10:00	0			0			0											
06/03/22 11:00	0			0			0											
06/03/22 12:00	0			0			0											
06/03/22 13:00	0			0			0											
06/03/22 14:00	0			0			0											
06/03/22 15:00	0			0			0											
06/03/22 16:00	0			0			0											
06/03/22 17:00	0			0			0											
06/03/22 18:00	0			0			0											
06/03/22 19:00	0			0			0											
06/03/22 20:00	0			0			0											
06/03/22 21:00	0			0			0											
06/03/22 22:00	0			0			0											
06/03/22 23:00	0			0			0											
06/04/22 0:00	0			0			0											
06/04/22 1:00	0			0			0											
06/04/22 2:00	0			0			0											
06/04/22 3:00	0			0			0											
06/04/22 4:00	0			0			0											
06/04/22 5:00	0			0			0											
06/04/22 6:00	0			0			0											
06/04/22 7:00	0			0			0											
06/04/22 8:00	0			0			0											
06/04/22 9:00	0			0			0											
06/04/22 10:00	0			0			0											
06/04/22 11:00	0			0			0											
06/04/22 12:00	0			0			0											
06/04/22 13:00	0			0			0											
06/04/22 14:00	0			0			0											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/04/22 15:00	0			0			0											
06/04/22 16:00	0			0			0											
06/04/22 17:00	0			0			0											
06/04/22 18:00	0			0			0											
06/04/22 19:00	0			0			0											
06/04/22 20:00	0			0			0											
06/04/22 21:00	0			0			0											
06/04/22 22:00	0			0			0											
06/04/22 23:00	0			0			0											
06/05/22 0:00	0			0			0											
06/05/22 1:00	0			0			0											
06/05/22 2:00	0			0			0											
06/05/22 3:00	0			0			0											
06/05/22 4:00	0			0			0											
06/05/22 5:00	0			0			0											
06/05/22 6:00	0			0			0											
06/05/22 7:00	0			0			0											
06/05/22 8:00	0			0			0											
06/05/22 9:00	0			0			0											
06/05/22 10:00	0			0			0											
06/05/22 11:00	0			0			0											
06/05/22 12:00	0			0			0											
06/05/22 13:00	0			0			0											
06/05/22 14:00	0			0			0											
06/05/22 15:00	0			0			0											
06/05/22 16:00	0			0			0											
06/05/22 17:00	0			0			0											
06/05/22 18:00	0			0			0											
06/05/22 19:00	0			0			0											
06/05/22 20:00	0			0			0											
06/05/22 21:00	0			0			0											
06/05/22 22:00	0			0			0											
06/05/22 23:00	0			0			0											
06/06/22 0:00	0			0			0											
06/06/22 1:00	0			0			0											
06/06/22 2:00	0			0			0											
06/06/22 3:00	0			0			0											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/06/22 4:00	0			0			0											
06/06/22 5:00	0			0			0											
06/06/22 6:00	0			0			0											
06/06/22 7:00	0			0			0											
06/06/22 8:00	0			0			0											
06/06/22 9:00	0			0			0											
06/06/22 10:00	0			0			0											
06/06/22 11:00	0			0			0											
06/06/22 12:00	0			0			0											
06/06/22 13:00	1			3			0											
06/06/22 14:00	1			17			0											
06/06/22 15:00	1			31			0											
06/06/22 16:00	1			42			0											
06/06/22 17:00	1			43			0											
06/06/22 18:00	1			35			0											
06/06/22 19:00	0			21			0											
06/06/22 20:00	0			7			0											
06/06/22 21:00	0			0			0											
06/06/22 22:00	0			0			0											
06/06/22 23:00	0			0			0											
06/07/22 0:00	0			0			0											
06/07/22 1:00	0			0			0											
06/07/22 2:00	0			0			0											
06/07/22 3:00	0			0			0											
06/07/22 4:00	0			0			0											
06/07/22 5:00	0			0			0											
06/07/22 6:00	0			0			0											
06/07/22 7:00	0			0			0											
06/07/22 8:00	0			0			0											
06/07/22 9:00	0			0			0											
06/07/22 10:00	0			0			0											
06/07/22 11:00	1			0			4											
06/07/22 12:00	1			0			11											
06/07/22 13:00	1			0			19											
06/07/22 14:00	1			0			27											
06/07/22 15:00	1			0			31											
06/07/22 16:00	1			0			34											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/07/22 17:00	1			0			33											
06/07/22 18:00	1			0			33											
06/07/22 19:00	1			0			33											
06/07/22 20:00	1			0			25											
06/07/22 21:00	0			0			14											
06/07/22 22:00	0			0			3											
06/07/22 23:00	0			0			0											
06/08/22 0:00	0			0			0											
06/08/22 1:00	0			0			0											
06/08/22 2:00	0			0			0											
06/08/22 3:00	1			2			0											
06/08/22 4:00	1			17			0											
06/08/22 5:00	1			32			0											
06/08/22 6:00	1			45			0											
06/08/22 7:00	1			41			0											
06/08/22 8:00	1			36			0											
06/08/22 9:00	1			32			0											
06/08/22 10:00	1			33			0											
06/08/22 11:00	1			33			0											
06/08/22 12:00	1			34			0											
06/08/22 13:00	1			43			0											
06/08/22 14:00	1			51			11											
06/08/22 15:00	1			58			31											
06/08/22 16:00	1			58			51											
06/08/22 17:00	1			63			64											
06/08/22 18:00	1			70			71											
06/08/22 19:00	1			75			76											
06/08/22 20:00	1			75			76											
06/08/22 21:00	1			70			71											
06/08/22 22:00	1			67			68											
06/08/22 23:00	1			67			68											
06/09/22 0:00	1			67			68											
06/09/22 1:00	1			67			68											
06/09/22 2:00	1			63			63											
06/09/22 3:00	1			61			40											
06/09/22 4:00	1			60			17											
06/09/22 5:00	1			55			0											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/09/22 6:00	1			47			0											
06/09/22 7:00	1			37			0											
06/09/22 8:00	1			35			0											
06/09/22 9:00	1			34			0											
06/09/22 10:00	1			42			4											
06/09/22 11:00	1			42			16											
06/09/22 12:00	1			41			27											
06/09/22 13:00	1			39			39											
06/09/22 14:00	1			48			49											
06/09/22 15:00	1			60			61											
06/09/22 16:00	1			62			63											
06/09/22 17:00	1			64			65											
06/09/22 18:00	1			65			65											
06/09/22 19:00	1			69			69											
06/09/22 20:00	1			69			70											
06/09/22 21:00	1			69			70											
06/09/22 22:00	1			67			69											
06/09/22 23:00	1			66			68											
06/10/22 0:00	1			65			67											
06/10/22 1:00	1			67			68											
06/10/22 2:00	1			66			67											
06/10/22 3:00	1			66			67											
06/10/22 4:00	1			66			67											
06/10/22 5:00	1			67			68											
06/10/22 6:00	1			66			67											
06/10/22 7:00	1			65			66											
06/10/22 8:00	1			63			64											
06/10/22 9:00	1			62			63											
06/10/22 10:00	1			62			63											
06/10/22 11:00	1			64			64											
06/10/22 12:00	1			67			67											
06/10/22 13:00	1			70			70											
06/10/22 14:00	1			74			74											
06/10/22 15:00	1			77			77											
06/10/22 16:00	1			75			74											
06/10/22 17:00	1			75			74											
06/10/22 18:00	1			75			74											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/10/22 19:00	1			77			78											
06/10/22 20:00	1			75			75											
06/10/22 21:00	1			73			74											
06/10/22 22:00	1			69			70											
06/10/22 23:00	1			60			52											
06/11/22 0:00	1			56			30											
06/11/22 1:00	1			46			19											
06/11/22 2:00	1			42			24											
06/11/22 3:00	1			33			33											
06/11/22 4:00	1			33			33											
06/11/22 5:00	1			32			33											
06/11/22 6:00	1			32			33											
06/11/22 7:00	1			32			33											
06/11/22 8:00	1			32			33											
06/11/22 9:00	1			33			34											
06/11/22 10:00	1			39			40											
06/11/22 11:00	1			46			46											
06/11/22 12:00	1			56			56											
06/11/22 13:00	1			63			64											
06/11/22 14:00	1			70			71											
06/11/22 15:00	1			73			73											
06/11/22 16:00	1			73			73											
06/11/22 17:00	1			73			74											
06/11/22 18:00	1			76			76											
06/11/22 19:00	1			78			79											
06/11/22 20:00	1			79			80											
06/11/22 21:00	1			79			79											
06/11/22 22:00	1			74			75											
06/11/22 23:00	1			67			68											
06/12/22 0:00	1			64			65											
06/12/22 1:00	1			60			60											
06/12/22 2:00	1			60			42											
06/12/22 3:00	1			57			18											
06/12/22 4:00	1			60			1											
06/12/22 5:00	1			55			0											
06/12/22 6:00	1			46			0											
06/12/22 7:00	1			37			0											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/12/22 8:00	1			33			0											
06/12/22 9:00	1			33			0											
06/12/22 10:00	1			33			0											
06/12/22 11:00	1			36			0											
06/12/22 12:00	1			42			8											
06/12/22 13:00	1			52			29											
06/12/22 14:00	1			59			50											
06/12/22 15:00	1			64			64											
06/12/22 16:00	1			65			65											
06/12/22 17:00	1			66			66											
06/12/22 18:00	1			67			68											
06/12/22 19:00	1			67			68											
06/12/22 20:00	1			67			68											
06/12/22 21:00	1			66			67											
06/12/22 22:00	1			66			67											
06/12/22 23:00	1			60			61											
06/13/22 0:00	1			55			39											
06/13/22 1:00	1			52			17											
06/13/22 2:00	1			47			1											
06/13/22 3:00	1			41			0											
06/13/22 4:00	1			34			0											
06/13/22 5:00	1			33			0											
06/13/22 6:00	1			33			0											
06/13/22 7:00	1			33			0											
06/13/22 8:00	1			33			0											
06/13/22 9:00	1			33			0											
06/13/22 10:00	1			33			0											
06/13/22 11:00	1			33			0											
06/13/22 12:00	1			33			0											
06/13/22 13:00	1			33			0											
06/13/22 14:00	1			33			0											
06/13/22 15:00	1			33			0											
06/13/22 16:00	1			35			0											
06/13/22 17:00	1			38			0											
06/13/22 18:00	1			42			8											
06/13/22 19:00	1			47			27											
06/13/22 20:00	1			55			49											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/13/22 21:00	1			54			53											
06/13/22 22:00	1			46			34											
06/13/22 23:00	1			36			12											
06/14/22 0:00	1			33			0											
06/14/22 1:00	1			33			0											
06/14/22 2:00	1			33			0											
06/14/22 3:00	1			33			0											
06/14/22 4:00	1			33			0											
06/14/22 5:00	1			36			0											
06/14/22 6:00	1			36			0											
06/14/22 7:00	1			36			0											
06/14/22 8:00	1			33			0											
06/14/22 9:00	1			33			0											
06/14/22 10:00	1			33			0											
06/14/22 11:00	1			33			0											
06/14/22 12:00	1			33			0											
06/14/22 13:00	1			33			0											
06/14/22 14:00	1			33			0											
06/14/22 15:00	1			33			0											
06/14/22 16:00	1			33			0											
06/14/22 17:00	1			37			0											
06/14/22 18:00	1			39			9											
06/14/22 19:00	1			49			30											
06/14/22 20:00	1			56			52											
06/14/22 21:00	1			61			62											
06/14/22 22:00	1			61			62											
06/14/22 23:00	1			61			62											
06/15/22 0:00	1			66			67											
06/15/22 1:00	1			67			68											
06/15/22 2:00	1			65			66											
06/15/22 3:00	1			65			66											
06/15/22 4:00	1			67			68											
06/15/22 5:00	1			67			68											
06/15/22 6:00	1			58			60											
06/15/22 7:00	1			49			50											
06/15/22 8:00	1			39			41											
06/15/22 9:00	1			36			37											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/15/22 10:00	1			32			33											
06/15/22 11:00	1			34			35											
06/15/22 12:00	1			42			43											
06/15/22 13:00	1			52			53											
06/15/22 14:00	1			62			62											
06/15/22 15:00	1			66			67											
06/15/22 16:00	1			69			69											
06/15/22 17:00	1			70			70											
06/15/22 18:00	1			68			69											
06/15/22 19:00	1			67			68											
06/15/22 20:00	1			66			67											
06/15/22 21:00	1			66			67											
06/15/22 22:00	1			66			67											
06/15/22 23:00	1			66			67											
06/16/22 0:00	1			66			67											
06/16/22 1:00	1			66			68											
06/16/22 2:00	1			66			67											
06/16/22 3:00	1			66			67											
06/16/22 4:00	1			66			67											
06/16/22 5:00	1			61			62											
06/16/22 6:00	1			49			51											
06/16/22 7:00	1			38			39											
06/16/22 8:00	1			32			33											
06/16/22 9:00	1			32			33											
06/16/22 10:00	1			32			33											
06/16/22 11:00	1			34			35											
06/16/22 12:00	1			46			46											
06/16/22 13:00	1			59			59											
06/16/22 14:00	1			68			68											
06/16/22 15:00	1			68			68											
06/16/22 16:00	1			66			67											
06/16/22 17:00	1			64			65											
06/16/22 18:00	1			64			65											
06/16/22 19:00	1			64			65											
06/16/22 20:00	1			65			67											
06/16/22 21:00	1			65			67											
06/16/22 22:00	1			65			67											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/16/22 23:00	1			66			67											
06/17/22 0:00	1			66			67											
06/17/22 1:00	1			66			67											
06/17/22 2:00	1			66			67											
06/17/22 3:00	1			66			67											
06/17/22 4:00	1			67			68											
06/17/22 5:00	1			67			68											
06/17/22 6:00	1			59			60											
06/17/22 7:00	1			48			50											
06/17/22 8:00	1			37			38											
06/17/22 9:00	1			35			35											
06/17/22 10:00	1			34			33											
06/17/22 11:00	1			34			33											
06/17/22 12:00	1			33			33											
06/17/22 13:00	1			29			36											
06/17/22 14:00	1			18			36											
06/17/22 15:00	1			7			37											
06/17/22 16:00	1			0			34											
06/17/22 17:00	1			0			34											
06/17/22 18:00	1			0			33											
06/17/22 19:00	1			0			33											
06/17/22 20:00	1			0			33											
06/17/22 21:00	1			0			33											
06/17/22 22:00	1			0			33											
06/17/22 23:00	1			0			33											
06/18/22 0:00	1			0			33											
06/18/22 1:00	1			0			33											
06/18/22 2:00	1			0			33											
06/18/22 3:00	1			0			33											
06/18/22 4:00	1			0			33											
06/18/22 5:00	1			0			33											
06/18/22 6:00	1			0			33											
06/18/22 7:00	1			0			33											
06/18/22 8:00	1			0			33											
06/18/22 9:00	1			0			33											
06/18/22 10:00	1			0			33											
06/18/22 11:00	1			0			33											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/18/22 12:00	1			0			33											
06/18/22 13:00	1			0			33											
06/18/22 14:00	1			0			33											
06/18/22 15:00	1			0			33											
06/18/22 16:00	1			0			33											
06/18/22 17:00	1			0			33											
06/18/22 18:00	1			0			33											
06/18/22 19:00	1			0			33											
06/18/22 20:00	1			0			34											
06/18/22 21:00	1			0			34											
06/18/22 22:00	1			0			43											
06/18/22 23:00	1			0			45											
06/19/22 0:00	1			0			45											
06/19/22 1:00	1			0			41											
06/19/22 2:00	1			0			40											
06/19/22 3:00	1			0			39											
06/19/22 4:00	1			0			35											
06/19/22 5:00	1			0			33											
06/19/22 6:00	1			0			33											
06/19/22 7:00	1			0			33											
06/19/22 8:00	1			0			33											
06/19/22 9:00	1			0			33											
06/19/22 10:00	1			0			33											
06/19/22 11:00	1			0			33											
06/19/22 12:00	1			0			33											
06/19/22 13:00	1			0			33											
06/19/22 14:00	1			0			33											
06/19/22 15:00	1			0			33											
06/19/22 16:00	1			0			33											
06/19/22 17:00	1			0			33											
06/19/22 18:00	1			0			33											
06/19/22 19:00	1			0			33											
06/19/22 20:00	1			0			35											
06/19/22 21:00	1			0			35											
06/19/22 22:00	1			0			35											
06/19/22 23:00	1			0			33											
06/20/22 0:00	1			0			33											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/20/22 1:00	1			0			33											
06/20/22 2:00	1			0			33											
06/20/22 3:00	1			0			33											
06/20/22 4:00	1			0			34											
06/20/22 5:00	1			0			34											
06/20/22 6:00	1			0			35											
06/20/22 7:00	1			0			34											
06/20/22 8:00	1			0			33											
06/20/22 9:00	1			0			33											
06/20/22 10:00	1			0			33											
06/20/22 11:00	1			0			33											
06/20/22 12:00	1			0			34											
06/20/22 13:00	1			0			37											
06/20/22 14:00	1			7			40											
06/20/22 15:00	1			27			49											
06/20/22 16:00	1			50			62											
06/20/22 17:00	1			64			71											
06/20/22 18:00	1			66			74											
06/20/22 19:00	1			64			70											
06/20/22 20:00	1			64			70											
06/20/22 21:00	1			64			69											
06/20/22 22:00	1			60			63											
06/20/22 23:00	1			52			40											
06/21/22 0:00	1			41			17											
06/21/22 1:00	1			35			0											
06/21/22 2:00	1			33			0											
06/21/22 3:00	1			33			0											
06/21/22 4:00	1			33			0											
06/21/22 5:00	1			34			0											
06/21/22 6:00	1			34			0											
06/21/22 7:00	1			34			0											
06/21/22 8:00	1			33			0											
06/21/22 9:00	1			33			0											
06/21/22 10:00	1			33			0											
06/21/22 11:00	1			33			0											
06/21/22 12:00	1			33			0											
06/21/22 13:00	1			33			0											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/21/22 14:00	1			33			0											
06/21/22 15:00	1			34			0											
06/21/22 16:00	1			34			0											
06/21/22 17:00	1			35			0											
06/21/22 18:00	1			37			0											
06/21/22 19:00	1			44			9											
06/21/22 20:00	1			54			30											
06/21/22 21:00	1			64			54											
06/21/22 22:00	1			68			67											
06/21/22 23:00	1			68			68											
06/22/22 0:00	1			66			67											
06/22/22 1:00	1			66			67											
06/22/22 2:00	1			64			65											
06/22/22 3:00	1			64			65											
06/22/22 4:00	1			64			65											
06/22/22 5:00	1			59			60											
06/22/22 6:00	1			47			48											
06/22/22 7:00	1			37			38											
06/22/22 8:00	1			32			33											
06/22/22 9:00	1			32			33											
06/22/22 10:00	1			32			33											
06/22/22 11:00	1			32			33											
06/22/22 12:00	1			32			33											
06/22/22 13:00	1			33			34											
06/22/22 14:00	1			35			36											
06/22/22 15:00	1			36			37											
06/22/22 16:00	1			35			36											
06/22/22 17:00	1			33			34											
06/22/22 18:00	1			32			33											
06/22/22 19:00	1			32			33											
06/22/22 20:00	1			38			39											
06/22/22 21:00	1			47			48											
06/22/22 22:00	1			56			58											
06/22/22 23:00	1			62			63											
06/23/22 0:00	1			65			66											
06/23/22 1:00	1			64			65											
06/23/22 2:00	1			55			49											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/23/22 3:00	1			44			26											
06/23/22 4:00	1			40			6											
06/23/22 5:00	1			44			0											
06/23/22 6:00	1			54			0											
06/23/22 7:00	1			59			0											
06/23/22 8:00	1			62			0											
06/23/22 9:00	1			62			0											
06/23/22 10:00	1			61			0											
06/23/22 11:00	1			52			0											
06/23/22 12:00	1			42			0											
06/23/22 13:00	1			32			0											
06/23/22 14:00	1			32			0											
06/23/22 15:00	1			34			0											
06/23/22 16:00	1			36			9											
06/23/22 17:00	1			45			28											
06/23/22 18:00	1			57			53											
06/23/22 19:00	1			70			69											
06/23/22 20:00	1			75			75											
06/23/22 21:00	1			74			74											
06/23/22 22:00	1			70			71											
06/23/22 23:00	1			67			68											
06/24/22 0:00	1			66			67											
06/24/22 1:00	1			66			67											
06/24/22 2:00	1			66			67											
06/24/22 3:00	1			58			59											
06/24/22 4:00	1			58			59											
06/24/22 5:00	1			53			54											
06/24/22 6:00	1			49			50											
06/24/22 7:00	1			38			39											
06/24/22 8:00	1			32			33											
06/24/22 9:00	1			32			33											
06/24/22 10:00	1			35			36											
06/24/22 11:00	1			42			43											
06/24/22 12:00	1			52			53											
06/24/22 13:00	1			59			60											
06/24/22 14:00	1			65			65											
06/24/22 15:00	1			68			69											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/24/22 16:00	1			72			71											
06/24/22 17:00	1			74			74											
06/24/22 18:00	1			75			75											
06/24/22 19:00	1			76			77											
06/24/22 20:00	1			73			74											
06/24/22 21:00	1			70			71											
06/24/22 22:00	1			68			69											
06/24/22 23:00	1			67			69											
06/25/22 0:00	1			66			67											
06/25/22 1:00	1			68			69											
06/25/22 2:00	1			67			68											
06/25/22 3:00	1			67			68											
06/25/22 4:00	1			63			64											
06/25/22 5:00	1			58			59											
06/25/22 6:00	1			48			49											
06/25/22 7:00	1			38			39											
06/25/22 8:00	1			32			33											
06/25/22 9:00	1			32			33											
06/25/22 10:00	1			32			33											
06/25/22 11:00	1			32			33											
06/25/22 12:00	1			33			33											
06/25/22 13:00	1			33			33											
06/25/22 14:00	1			33			34											
06/25/22 15:00	1			33			34											
06/25/22 16:00	1			34			35											
06/25/22 17:00	1			45			46											
06/25/22 18:00	1			58			59											
06/25/22 19:00	1			69			70											
06/25/22 20:00	1			70			70											
06/25/22 21:00	1			63			65											
06/25/22 22:00	1			40			55											
06/25/22 23:00	1			17			43											
06/26/22 0:00	1			0			35											
06/26/22 1:00	1			0			35											
06/26/22 2:00	1			0			38											
06/26/22 3:00	1			0			39											
06/26/22 4:00	1			0			44											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/26/22 5:00	1			0			47											
06/26/22 6:00	1			0			46											
06/26/22 7:00	1			0			39											
06/26/22 8:00	1			0			33											
06/26/22 9:00	1			0			34											
06/26/22 10:00	1			8			36											
06/26/22 11:00	1			19			36											
06/26/22 12:00	1			29			35											
06/26/22 13:00	1			32			33											
06/26/22 14:00	1			33			33											
06/26/22 15:00	1			33			34											
06/26/22 16:00	1			40			40											
06/26/22 17:00	1			51			51											
06/26/22 18:00	1			66			66											
06/26/22 19:00	1			71			71											
06/26/22 20:00	1			70			71											
06/26/22 21:00	1			63			64											
06/26/22 22:00	1			53			48											
06/26/22 23:00	1			42			26											
06/27/22 0:00	1			34			7											
06/27/22 1:00	1			33			0											
06/27/22 2:00	1			33			0											
06/27/22 3:00	1			33			0											
06/27/22 4:00	1			35			0											
06/27/22 5:00	1			35			0											
06/27/22 6:00	1			35			0											
06/27/22 7:00	1			33			0											
06/27/22 8:00	1			33			0											
06/27/22 9:00	1			33			0											
06/27/22 10:00	1			33			0											
06/27/22 11:00	1			33			0											
06/27/22 12:00	1			34			0											
06/27/22 13:00	1			36			8											
06/27/22 14:00	1			43			26											
06/27/22 15:00	1			53			49											
06/27/22 16:00	1			63			63											
06/27/22 17:00	1			68			68											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/27/22 18:00	1			70			70											
06/27/22 19:00	1			70			70											
06/27/22 20:00	1			69			70											
06/27/22 21:00	1			67			68											
06/27/22 22:00	1			57			56											
06/27/22 23:00	1			46			33											
06/28/22 0:00	1			35			11											
06/28/22 1:00	1			33			0											
06/28/22 2:00	1			33			0											
06/28/22 3:00	1			33			0											
06/28/22 4:00	1			40			0											
06/28/22 5:00	1			42			0											
06/28/22 6:00	1			42			0											
06/28/22 7:00	1			36			0											
06/28/22 8:00	1			33			0											
06/28/22 9:00	1			33			0											
06/28/22 10:00	1			33			0											
06/28/22 11:00	1			34			0											
06/28/22 12:00	1			34			0											
06/28/22 13:00	1			34			0											
06/28/22 14:00	1			33			0											
06/28/22 15:00	1			35			1											
06/28/22 16:00	1			35			11											
06/28/22 17:00	1			43			31											
06/28/22 18:00	1			52			52											
06/28/22 19:00	1			64			64											
06/28/22 20:00	1			64			65											
06/28/22 21:00	1			55			53											
06/28/22 22:00	1			44			30											
06/28/22 23:00	1			43			10											
06/29/22 0:00	1			51			0											
06/29/22 1:00	1			60			0											
06/29/22 2:00	1			61			0											
06/29/22 3:00	1			60			0											
06/29/22 4:00	1			60			0											
06/29/22 5:00	1			58			0											
06/29/22 6:00	1			50			0											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/29/22 7:00	1			41			0											
06/29/22 8:00	1			34			0											
06/29/22 9:00	1			34			0											
06/29/22 10:00	1			34			0											
06/29/22 11:00	1			36			0											
06/29/22 12:00	1			37			9											
06/29/22 13:00	1			45			28											
06/29/22 14:00	1			53			50											
06/29/22 15:00	1			63			64											
06/29/22 16:00	1			67			67											
06/29/22 17:00	1			67			67											
06/29/22 18:00	1			67			67											
06/29/22 19:00	1			68			68											
06/29/22 20:00	1			69			69											
06/29/22 21:00	1			68			69											
06/29/22 22:00	1			67			68											
06/29/22 23:00	1			69			70											
06/30/22 0:00	1			65			65											
06/30/22 1:00	1			63			42											
06/30/22 2:00	1			56			17											
06/30/22 3:00	1			57			0											
06/30/22 4:00	1			54			0											
06/30/22 5:00	1			53			0											
06/30/22 6:00	1			45			0											
06/30/22 7:00	1			38			0											
06/30/22 8:00	1			33			0											
06/30/22 9:00	1			33			0											
06/30/22 10:00	1			33			0											
06/30/22 11:00	1			33			0											
06/30/22 12:00	1			33			0											
06/30/22 13:00	1			36			0											
06/30/22 14:00	1			38			8											
06/30/22 15:00	1			47			27											
06/30/22 16:00	1			55			50											
06/30/22 17:00	1			65			64											
06/30/22 18:00	1			70			70											
06/30/22 19:00	1			75			75											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/30/22 20:00	1			75			76											
06/30/22 21:00	1			72			73											
06/30/22 22:00	1			66			67											
06/30/22 23:00	1			59			53											
07/01/22 0:00	1			53			31											
07/01/22 1:00	1			43			10											
07/01/22 2:00	1			37			0											
07/01/22 3:00	1			33			0											
07/01/22 4:00	1			33			0											
07/01/22 5:00	1			37			0											
07/01/22 6:00	1			37			0											
07/01/22 7:00	1			37			0											
07/01/22 8:00	1			33			0											
07/01/22 9:00	1			33			0											
07/01/22 10:00	1			33			0											
07/01/22 11:00	1			33			0											
07/01/22 12:00	1			33			0											
07/01/22 13:00	1			33			0											
07/01/22 14:00	1			33			0											
07/01/22 15:00	1			33			0											
07/01/22 16:00	1			36			0											
07/01/22 17:00	1			44			10											
07/01/22 18:00	1			54			32											
07/01/22 19:00	1			62			54											
07/01/22 20:00	1			65			66											
07/01/22 21:00	1			66			67											
07/01/22 22:00	1			64			65											
07/01/22 23:00	1			54			47											

Tons 12 Month Rolling Summary

CT1 and CT2 Combined

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:43 **Location:** Roseville, CA

* = Excess Emission

	Units CT1 & CT2		Units CT1 & CT2		Units CT1 & CT2		Units CT1 & CT2		Units CT1 & CT2	
Date	CO, Ton 1 Day(s)		NOx, Ton 1 Day(s)		PM10, Ton 1 Day(s)		SO2, Ton 1 Day(s)		VOC, Ton 1 Day(s)	
	Sum	Rolling Sum	Sum	Rolling Sum	Sum	Rolling Sum	Sum	Rolling Sum	Sum	Rolling Sum
Apr 2022	0.4279	6.9825	0.0732	14.0559	0.0088	2.9936	0.0045	1.4962	0.0149	4.9895
May 2022	0.4443	6.8879	0.5924	13.9853	0.1194	2.9870	0.0596	1.4929	0.1989	4.9780
Jun 2022	0.7168	6.7270	1.0943	13.6989	0.2183	2.9175	0.1092	1.4584	0.3644	4.8627
Sum/Avg	6.7270		13.6989		2.9175		1.4584		4.8627	
Limit Value										

Monthly Summary Report

Units CT1 and CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 07/08/2022 00:48 **Location:** Roseville, CA

Date	Unit CT1 OperatingTime, Hr		Unit CT1 DBOn, Hr		Unit CT2 OperatingTime, Hr		Unit CT2 DBOn, Hr	
	1 Hour(s)		1 Hour(s)		1 Hour(s)		1 Hour(s)	
	Sum	Running Sum	Sum	Running Sum	Sum	Running Sum	Sum	Running Sum
Apr 22	9.29	9.29	0.00	0.00	27.46	27.46	0.00	0.00
May 22	256.92	266.21	96.19	96.19	226.94	254.40	84.47	84.47
Jun 22	467.89	734.10	187.21	283.40	394.27	648.67	174.70	259.17
Sum/Avg	734.10		283.40		648.67		259.17	

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
04/01/2022 00:00	0.0	0.0	0.0	104,300.0	0.0	0.00	0.0	0.0
04/01/2022 01:00	0.0	0.0	0.0	104,300.0	0.0	0.00	0.0	0.0
04/01/2022 02:00	0.0	0.0	0.0	104,300.0	0.0	0.00	0.0	0.0
04/01/2022 03:00	0.0	0.0	0.0	104,300.0	0.0	0.00	0.0	0.0
04/01/2022 04:00	0.0	0.0	0.0	104,300.0	0.0	0.00	0.0	0.0
04/01/2022 05:00	0.0	0.0	0.0	104,300.0	0.0	0.00	0.0	0.0
04/01/2022 06:00	0.0	0.0	0.0	104,300.0	0.0	0.00	0.0	0.0
04/01/2022 07:00	0.0	0.0	0.0	104,300.0	0.0	0.00	0.0	0.0
04/01/2022 08:00	0.0	0.0	0.0	104,300.0	0.0	0.00	0.0	0.0
04/01/2022 09:00	0.0	0.0	0.0	104,300.0	0.0	0.00	0.0	0.0
04/01/2022 10:00	0.0	0.0	0.0	104,300.0	0.0	0.00	0.0	0.0
04/01/2022 11:00	0.0	0.0	0.0	104,300.0	0.0	0.00	0.0	0.0
04/01/2022 12:00	0.0	0.0	0.0	104,300.0	0.0	0.00	0.0	0.0
04/01/2022 13:00	0.0	0.0	0.0	104,300.0	0.0	0.00	0.0	0.0
04/01/2022 14:00	0.0	0.0	0.0	104,300.0	0.0	0.00	0.0	0.0
04/01/2022 15:00	0.0	0.0	0.0	104,300.0	0.0	0.00	0.0	0.0
04/01/2022 16:00	0.0	0.0	0.0	104,300.0	0.0	0.00	0.0	0.0
04/01/2022 17:00	0.0	0.0	0.0	104,300.0	0.0	0.00	0.0	0.0
04/01/2022 18:00	0.0	0.0	0.0	104,300.0	0.0	0.00	0.0	0.0
04/01/2022 19:00	0.0	0.0	0.0	104,300.0	0.0	0.00	0.0	0.0
04/01/2022 20:00	0.0	0.0	0.0	104,300.0	0.0	0.00	0.0	0.0
04/01/2022 21:00	0.0	0.0	0.0	104,300.0	0.0	0.00	0.0	0.0
04/01/2022 22:00	0.0	0.0	0.0	104,300.0	0.0	0.00	0.0	0.0
04/01/2022 23:00	0.0	0.0	0.0	104,300.0	0.0	0.00	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	104,300.0	0.0	0.00	0.0	0.0
Minimum:	0.0	0.0	0.0	104,300.0	0.0	0.00	0.0	0.0
Maximum:	0.0	0.0	0.0	104,300.0	0.0	0.00	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
04/02/2022 00:00	0.0	0.0	0.0	104,300.0	0.0	0.00	0.0	0.0
04/02/2022 01:00	0.0	0.0	0.0	104,300.0	0.0	0.00	0.0	0.0
04/02/2022 02:00	0.0	0.0	0.0	104,300.0	0.0	0.00	0.0	0.0
04/02/2022 03:00	0.0	0.0	0.0	104,300.0	0.0	0.00	0.0	0.0
04/02/2022 04:00	0.0	0.0	0.0	104,300.0	0.0	0.00	0.0	0.0
04/02/2022 05:00	0.0	0.0	0.0	104,300.0	0.0	0.00	0.0	0.0
04/02/2022 06:00	0.0	0.0	0.0	104,300.0	0.0	0.00	0.0	0.0
04/02/2022 07:00	0.0	0.0	0.0	104,300.0	0.0	0.00	0.0	0.0
04/02/2022 08:00	0.0	0.0	0.0	104,300.0	0.0	0.00	0.0	0.0
04/02/2022 09:00	0.0	0.0	0.0	104,300.0	0.0	0.00	0.0	0.0
04/02/2022 10:00	0.0	0.0	0.0	104,300.0	0.0	0.00	0.0	0.0
04/02/2022 11:00	0.0	0.0	0.0	104,300.0	0.0	0.00	0.0	0.0
04/02/2022 12:00	0.0	0.0	0.0	104,300.0	0.0	0.00	0.0	0.0
04/02/2022 13:00	0.0	0.0	0.0	104,300.0	0.0	0.00	0.0	0.0
04/02/2022 14:00	0.0	0.0	0.0	104,300.0	0.0	0.00	0.0	0.0
04/02/2022 15:00	0.0	0.0	0.0	104,300.0	0.0	0.00	0.0	0.0
04/02/2022 16:00	0.0	0.0	0.0	104,300.0	0.0	0.00	0.0	0.0
04/02/2022 17:00	0.0	0.0	0.0	104,300.0	0.0	0.00	0.0	0.0
04/02/2022 18:00	0.0	0.0	0.0	104,300.0	0.0	0.00	0.0	0.0
04/02/2022 19:00	0.0	0.0	0.0	104,300.0	0.0	0.00	0.0	0.0
04/02/2022 20:00	0.0	0.0	0.0	104,300.0	0.0	0.00	0.0	0.0
04/02/2022 21:00	0.0	0.0	0.0	104,300.0	0.0	0.00	0.0	0.0
04/02/2022 22:00	0.0	0.0	0.0	104,300.0	0.0	0.00	0.0	0.0
04/02/2022 23:00	0.0	0.0	0.0	104,300.0	0.0	0.00	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	104,300.0	0.0	0.00	0.0	0.0
Minimum:	0.0	0.0	0.0	104,300.0	0.0	0.00	0.0	0.0
Maximum:	0.0	0.0	0.0	104,300.0	0.0	0.00	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
04/03/2022 00:00	0.0	0.0	0.0	104,300.0	0.0	0.00	0.0	0.0
04/03/2022 01:00	0.0	0.0	0.0	104,300.0	0.0	0.00	0.0	0.0
04/03/2022 02:00	0.0	0.0	0.0	104,300.0	0.0	0.00	0.0	0.0
04/03/2022 03:00	0.0	0.0	0.0	104,300.0	0.0	0.00	0.0	0.0
04/03/2022 04:00	0.0	0.0	0.0	104,300.0	0.0	0.00	0.0	0.0
04/03/2022 05:00	0.0	0.0	0.0	104,300.0	0.0	0.00	0.0	0.0
04/03/2022 06:00	0.0	0.0	0.0	104,300.0	0.0	0.00	0.0	0.0
04/03/2022 07:00	0.0	0.0	0.0	104,300.0	0.0	0.00	0.0	0.0
04/03/2022 08:00	0.0	0.0	0.0	104,300.0	0.0	0.00	0.0	0.0
04/03/2022 09:00	0.0	0.0	0.0	104,300.0	0.0	0.00	0.0	0.0
04/03/2022 10:00	0.0	0.0	0.0	104,300.0	0.0	0.00	0.0	0.0
04/03/2022 11:00	0.0	0.0	0.0	104,300.0	0.0	0.00	0.0	0.0
04/03/2022 12:00	0.0	0.0	0.0	104,300.0	0.0	0.00	0.0	0.0
04/03/2022 13:00	0.0	0.0	0.0	104,300.0	0.0	0.00	0.0	0.0
04/03/2022 14:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/03/2022 15:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/03/2022 16:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/03/2022 17:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/03/2022 18:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/03/2022 19:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/03/2022 20:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/03/2022 21:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/03/2022 22:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/03/2022 23:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	104,091.7	0.0	0.00	0.0	0.0
Minimum:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Maximum:	0.0	0.0	0.0	104,300.0	0.0	0.00	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
04/04/2022 00:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/04/2022 01:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/04/2022 02:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/04/2022 03:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/04/2022 04:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/04/2022 05:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/04/2022 06:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/04/2022 07:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/04/2022 08:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/04/2022 09:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/04/2022 10:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/04/2022 11:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/04/2022 12:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/04/2022 13:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/04/2022 14:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/04/2022 15:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/04/2022 16:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/04/2022 17:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/04/2022 18:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/04/2022 19:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/04/2022 20:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/04/2022 21:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/04/2022 22:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/04/2022 23:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Minimum:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Maximum:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
04/05/2022 00:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/05/2022 01:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/05/2022 02:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/05/2022 03:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/05/2022 04:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/05/2022 05:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/05/2022 06:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/05/2022 07:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/05/2022 08:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/05/2022 09:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/05/2022 10:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/05/2022 11:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/05/2022 12:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/05/2022 13:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/05/2022 14:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/05/2022 15:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/05/2022 16:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/05/2022 17:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/05/2022 18:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/05/2022 19:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/05/2022 20:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/05/2022 21:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/05/2022 22:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/05/2022 23:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Minimum:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Maximum:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
04/06/2022 00:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/06/2022 01:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/06/2022 02:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/06/2022 03:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/06/2022 04:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/06/2022 05:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/06/2022 06:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/06/2022 07:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/06/2022 08:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/06/2022 09:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/06/2022 10:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/06/2022 11:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/06/2022 12:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/06/2022 13:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/06/2022 14:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/06/2022 15:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/06/2022 16:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/06/2022 17:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/06/2022 18:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/06/2022 19:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/06/2022 20:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/06/2022 21:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/06/2022 22:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/06/2022 23:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Minimum:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Maximum:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
04/07/2022 00:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/07/2022 01:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/07/2022 02:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/07/2022 03:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/07/2022 04:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/07/2022 05:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/07/2022 06:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/07/2022 07:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/07/2022 08:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/07/2022 09:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/07/2022 10:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/07/2022 11:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/07/2022 12:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/07/2022 13:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/07/2022 14:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/07/2022 15:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/07/2022 16:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/07/2022 17:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/07/2022 18:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/07/2022 19:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/07/2022 20:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/07/2022 21:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/07/2022 22:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/07/2022 23:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Minimum:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Maximum:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
04/08/2022 00:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/08/2022 01:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/08/2022 02:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/08/2022 03:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/08/2022 04:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/08/2022 05:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/08/2022 06:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/08/2022 07:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/08/2022 08:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/08/2022 09:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/08/2022 10:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/08/2022 11:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/08/2022 12:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/08/2022 13:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/08/2022 14:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/08/2022 15:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/08/2022 16:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/08/2022 17:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/08/2022 18:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/08/2022 19:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/08/2022 20:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/08/2022 21:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/08/2022 22:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/08/2022 23:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Minimum:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Maximum:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
04/09/2022 00:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/09/2022 01:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/09/2022 02:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/09/2022 03:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/09/2022 04:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/09/2022 05:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/09/2022 06:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/09/2022 07:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/09/2022 08:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/09/2022 09:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/09/2022 10:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/09/2022 11:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/09/2022 12:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/09/2022 13:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/09/2022 14:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/09/2022 15:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/09/2022 16:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/09/2022 17:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/09/2022 18:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/09/2022 19:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/09/2022 20:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/09/2022 21:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/09/2022 22:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/09/2022 23:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Minimum:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Maximum:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
04/10/2022 00:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/10/2022 01:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/10/2022 02:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/10/2022 03:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/10/2022 04:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/10/2022 05:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/10/2022 06:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/10/2022 07:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/10/2022 08:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/10/2022 09:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/10/2022 10:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/10/2022 11:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/10/2022 12:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/10/2022 13:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/10/2022 14:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/10/2022 15:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/10/2022 16:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/10/2022 17:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/10/2022 18:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/10/2022 19:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/10/2022 20:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/10/2022 21:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/10/2022 22:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/10/2022 23:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Minimum:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Maximum:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
04/11/2022 00:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/11/2022 01:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/11/2022 02:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/11/2022 03:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/11/2022 04:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/11/2022 05:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/11/2022 06:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/11/2022 07:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/11/2022 08:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/11/2022 09:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/11/2022 10:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/11/2022 11:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/11/2022 12:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/11/2022 13:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/11/2022 14:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/11/2022 15:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/11/2022 16:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/11/2022 17:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/11/2022 18:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/11/2022 19:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/11/2022 20:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/11/2022 21:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/11/2022 22:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/11/2022 23:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Minimum:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Maximum:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
04/12/2022 00:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/12/2022 01:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/12/2022 02:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/12/2022 03:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/12/2022 04:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/12/2022 05:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/12/2022 06:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/12/2022 07:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/12/2022 08:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/12/2022 09:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/12/2022 10:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/12/2022 11:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/12/2022 12:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/12/2022 13:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/12/2022 14:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/12/2022 15:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/12/2022 16:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/12/2022 17:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/12/2022 18:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/12/2022 19:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/12/2022 20:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/12/2022 21:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/12/2022 22:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/12/2022 23:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Minimum:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Maximum:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
04/13/2022 00:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/13/2022 01:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/13/2022 02:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/13/2022 03:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/13/2022 04:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/13/2022 05:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/13/2022 06:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/13/2022 07:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/13/2022 08:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/13/2022 09:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/13/2022 10:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/13/2022 11:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/13/2022 12:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/13/2022 13:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/13/2022 14:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/13/2022 15:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/13/2022 16:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/13/2022 17:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/13/2022 18:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/13/2022 19:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/13/2022 20:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/13/2022 21:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/13/2022 22:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/13/2022 23:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Minimum:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Maximum:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
04/14/2022 00:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/14/2022 01:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/14/2022 02:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/14/2022 03:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/14/2022 04:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/14/2022 05:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/14/2022 06:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/14/2022 07:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/14/2022 08:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/14/2022 09:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/14/2022 10:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/14/2022 11:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/14/2022 12:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/14/2022 13:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/14/2022 14:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/14/2022 15:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/14/2022 16:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/14/2022 17:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/14/2022 18:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/14/2022 19:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/14/2022 20:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/14/2022 21:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/14/2022 22:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/14/2022 23:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Minimum:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Maximum:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
04/15/2022 00:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/15/2022 01:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/15/2022 02:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/15/2022 03:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/15/2022 04:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/15/2022 05:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/15/2022 06:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/15/2022 07:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/15/2022 08:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/15/2022 09:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/15/2022 10:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/15/2022 11:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/15/2022 12:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/15/2022 13:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/15/2022 14:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/15/2022 15:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/15/2022 16:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/15/2022 17:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/15/2022 18:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/15/2022 19:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/15/2022 20:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/15/2022 21:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/15/2022 22:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/15/2022 23:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Minimum:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Maximum:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
04/16/2022 00:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/16/2022 01:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/16/2022 02:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/16/2022 03:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/16/2022 04:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/16/2022 05:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/16/2022 06:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/16/2022 07:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/16/2022 08:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/16/2022 09:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/16/2022 10:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/16/2022 11:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/16/2022 12:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/16/2022 13:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/16/2022 14:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/16/2022 15:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/16/2022 16:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/16/2022 17:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/16/2022 18:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/16/2022 19:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/16/2022 20:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/16/2022 21:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/16/2022 22:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/16/2022 23:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Minimum:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Maximum:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
04/17/2022 00:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/17/2022 01:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/17/2022 02:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/17/2022 03:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/17/2022 04:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/17/2022 05:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/17/2022 06:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/17/2022 07:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/17/2022 08:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/17/2022 09:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/17/2022 10:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/17/2022 11:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/17/2022 12:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/17/2022 13:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/17/2022 14:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/17/2022 15:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/17/2022 16:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/17/2022 17:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/17/2022 18:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/17/2022 19:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/17/2022 20:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/17/2022 21:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/17/2022 22:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/17/2022 23:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Minimum:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Maximum:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
04/18/2022 00:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/18/2022 01:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/18/2022 02:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/18/2022 03:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/18/2022 04:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/18/2022 05:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/18/2022 06:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/18/2022 07:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/18/2022 08:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/18/2022 09:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/18/2022 10:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/18/2022 11:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/18/2022 12:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/18/2022 13:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/18/2022 14:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/18/2022 15:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/18/2022 16:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/18/2022 17:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/18/2022 18:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/18/2022 19:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/18/2022 20:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/18/2022 21:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/18/2022 22:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/18/2022 23:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Minimum:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Maximum:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
04/19/2022 00:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/19/2022 01:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/19/2022 02:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/19/2022 03:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/19/2022 04:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/19/2022 05:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/19/2022 06:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/19/2022 07:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/19/2022 08:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/19/2022 09:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/19/2022 10:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/19/2022 11:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/19/2022 12:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/19/2022 13:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/19/2022 14:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/19/2022 15:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/19/2022 16:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/19/2022 17:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/19/2022 18:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/19/2022 19:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/19/2022 20:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/19/2022 21:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/19/2022 22:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/19/2022 23:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Minimum:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Maximum:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
04/20/2022 00:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/20/2022 01:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/20/2022 02:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/20/2022 03:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/20/2022 04:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/20/2022 05:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/20/2022 06:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/20/2022 07:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/20/2022 08:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/20/2022 09:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/20/2022 10:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/20/2022 11:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/20/2022 12:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/20/2022 13:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/20/2022 14:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/20/2022 15:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/20/2022 16:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/20/2022 17:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/20/2022 18:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/20/2022 19:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/20/2022 20:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/20/2022 21:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/20/2022 22:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/20/2022 23:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Minimum:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Maximum:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
04/21/2022 00:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/21/2022 01:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/21/2022 02:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/21/2022 03:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/21/2022 04:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/21/2022 05:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/21/2022 06:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/21/2022 07:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/21/2022 08:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/21/2022 09:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/21/2022 10:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/21/2022 11:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/21/2022 12:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/21/2022 13:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/21/2022 14:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/21/2022 15:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/21/2022 16:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/21/2022 17:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/21/2022 18:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/21/2022 19:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/21/2022 20:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/21/2022 21:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/21/2022 22:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/21/2022 23:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Minimum:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Maximum:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
04/22/2022 00:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/22/2022 01:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/22/2022 02:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/22/2022 03:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/22/2022 04:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/22/2022 05:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/22/2022 06:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/22/2022 07:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/22/2022 08:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/22/2022 09:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/22/2022 10:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/22/2022 11:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/22/2022 12:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/22/2022 13:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/22/2022 14:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/22/2022 15:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/22/2022 16:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/22/2022 17:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/22/2022 18:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/22/2022 19:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/22/2022 20:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/22/2022 21:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/22/2022 22:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/22/2022 23:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Minimum:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Maximum:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
04/23/2022 00:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/23/2022 01:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/23/2022 02:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/23/2022 03:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/23/2022 04:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/23/2022 05:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/23/2022 06:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/23/2022 07:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/23/2022 08:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/23/2022 09:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/23/2022 10:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/23/2022 11:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/23/2022 12:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/23/2022 13:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/23/2022 14:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/23/2022 15:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/23/2022 16:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/23/2022 17:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/23/2022 18:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/23/2022 19:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/23/2022 20:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/23/2022 21:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/23/2022 22:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/23/2022 23:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Minimum:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Maximum:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
04/24/2022 00:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/24/2022 01:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/24/2022 02:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/24/2022 03:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/24/2022 04:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/24/2022 05:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/24/2022 06:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/24/2022 07:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/24/2022 08:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/24/2022 09:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/24/2022 10:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/24/2022 11:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/24/2022 12:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/24/2022 13:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/24/2022 14:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/24/2022 15:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/24/2022 16:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/24/2022 17:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/24/2022 18:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/24/2022 19:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/24/2022 20:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/24/2022 21:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/24/2022 22:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/24/2022 23:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Minimum:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Maximum:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
04/25/2022 00:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/25/2022 01:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/25/2022 02:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/25/2022 03:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/25/2022 04:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/25/2022 05:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/25/2022 06:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/25/2022 07:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/25/2022 08:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/25/2022 09:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/25/2022 10:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/25/2022 11:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/25/2022 12:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/25/2022 13:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/25/2022 14:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/25/2022 15:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/25/2022 16:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/25/2022 17:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/25/2022 18:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/25/2022 19:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/25/2022 20:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/25/2022 21:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/25/2022 22:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/25/2022 23:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Minimum:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Maximum:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
04/26/2022 00:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/26/2022 01:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/26/2022 02:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/26/2022 03:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/26/2022 04:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/26/2022 05:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/26/2022 06:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/26/2022 07:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/26/2022 08:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/26/2022 09:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/26/2022 10:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/26/2022 11:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/26/2022 12:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/26/2022 13:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/26/2022 14:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/26/2022 15:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/26/2022 16:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/26/2022 17:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/26/2022 18:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/26/2022 19:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/26/2022 20:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/26/2022 21:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/26/2022 22:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/26/2022 23:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Minimum:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Maximum:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
04/27/2022 00:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/27/2022 01:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/27/2022 02:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/27/2022 03:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/27/2022 04:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/27/2022 05:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/27/2022 06:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/27/2022 07:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/27/2022 08:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/27/2022 09:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/27/2022 10:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/27/2022 11:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/27/2022 12:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/27/2022 13:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/27/2022 14:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/27/2022 15:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/27/2022 16:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/27/2022 17:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/27/2022 18:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/27/2022 19:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/27/2022 20:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/27/2022 21:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/27/2022 22:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/27/2022 23:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Minimum:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Maximum:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
04/28/2022 00:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/28/2022 01:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/28/2022 02:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/28/2022 03:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/28/2022 04:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/28/2022 05:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/28/2022 06:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/28/2022 07:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/28/2022 08:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/28/2022 09:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/28/2022 10:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/28/2022 11:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/28/2022 12:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/28/2022 13:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/28/2022 14:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/28/2022 15:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/28/2022 16:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/28/2022 17:00	1,112.2	0.0	1,112.2	103,800.0	115.4	0.00	0.0	0.0
04/28/2022 18:00	1,276.1	0.0	1,276.1	103,800.0	132.5	0.00	0.0	0.0
04/28/2022 19:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/28/2022 20:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/28/2022 21:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/28/2022 22:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/28/2022 23:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Average/Sum#:	1,194.2	0.0	1,194.2	103,800.0	124.0	0.00	0.0	0.0
Minimum:	1,112.2	0.0	1,112.2	103,800.0	115.4	0.00	0.0	0.0
Maximum:	1,276.1	0.0	1,276.1	103,800.0	132.5	0.00	0.0	0.0
%SI	91.67	91.67	91.67	0.00	91.67	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
04/29/2022 00:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/29/2022 01:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/29/2022 02:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/29/2022 03:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/29/2022 04:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/29/2022 05:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/29/2022 06:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/29/2022 07:00	1,191.1	0.0	1,191.1	103,800.0	123.6	0.00	0.0	0.0
04/29/2022 08:00	2,486.2	0.0	2,486.2	103,800.0	258.1	0.00	0.0	0.0
04/29/2022 09:00	3,563.2	0.0	3,563.2	103,800.0	369.9	0.45	0.2	0.8
04/29/2022 10:00	4,457.7	0.0	4,457.7	103,800.0	462.7	0.55	0.3	0.9
04/29/2022 11:00	4,512.6	0.0	4,512.6	103,800.0	468.4	0.56	0.3	0.9
04/29/2022 12:00	3,470.0	0.0	3,470.0	103,800.0	360.2	0.43	0.2	0.7
04/29/2022 13:00	4,504.2	0.0	4,504.2	103,800.0	467.5	0.56	0.3	0.9
04/29/2022 14:00	4,497.0	0.0	4,497.0	103,800.0	466.8	0.56	0.3	0.9
04/29/2022 15:00	4,450.7	0.0	4,450.7	103,800.0	462.0	0.56	0.3	0.9
04/29/2022 16:00	3,604.1	0.0	3,604.1	103,800.0	374.1	0.55	0.3	0.9
04/29/2022 17:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/29/2022 18:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/29/2022 19:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/29/2022 20:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/29/2022 21:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/29/2022 22:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/29/2022 23:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Average/Sum#:	3,673.7	0.0	3,673.7	103,800.0	381.3	0.53	0.3	0.9
Minimum:	1,191.1	0.0	1,191.1	103,800.0	123.6	0.43	0.2	0.7
Maximum:	4,512.6	0.0	4,512.6	103,800.0	468.4	0.56	0.3	0.9
%SI	58.33	58.33	58.33	0.00	58.33	66.67	66.67	66.67

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
04/30/2022 00:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/30/2022 01:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/30/2022 02:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/30/2022 03:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/30/2022 04:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/30/2022 05:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/30/2022 06:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/30/2022 07:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/30/2022 08:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/30/2022 09:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/30/2022 10:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/30/2022 11:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/30/2022 12:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/30/2022 13:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/30/2022 14:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/30/2022 15:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/30/2022 16:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/30/2022 17:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/30/2022 18:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/30/2022 19:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/30/2022 20:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/30/2022 21:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/30/2022 22:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
04/30/2022 23:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Minimum:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Maximum:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
05/01/2022 00:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/01/2022 01:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/01/2022 02:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/01/2022 03:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/01/2022 04:00	1,965.1	0.0	1,965.1	104,000.0	204.4	0.00	0.0	0.0
05/01/2022 05:00	3,644.2	0.0	3,644.2	104,000.0	379.0	0.45	0.2	0.8
05/01/2022 06:00	3,200.8	0.0	3,200.8	104,000.0	332.9	0.40	0.2	0.7
05/01/2022 07:00	2,896.8	0.0	2,896.8	104,000.0	301.3	0.36	0.2	0.6
05/01/2022 08:00	2,734.5	0.0	2,734.5	104,000.0	284.4	0.34	0.2	0.6
05/01/2022 09:00	2,665.2	0.0	2,665.2	104,000.0	277.2	0.33	0.2	0.6
05/01/2022 10:00	2,642.0	0.0	2,642.0	104,000.0	274.8	0.33	0.2	0.6
05/01/2022 11:00	2,656.9	0.0	2,656.9	104,000.0	276.3	0.33	0.2	0.6
05/01/2022 12:00	2,674.9	0.0	2,674.9	104,000.0	278.2	0.33	0.2	0.6
05/01/2022 13:00	2,663.9	0.0	2,663.9	104,000.0	277.0	0.33	0.2	0.6
05/01/2022 14:00	2,659.5	0.0	2,659.5	104,000.0	276.6	0.33	0.2	0.6
05/01/2022 15:00	2,647.9	0.0	2,647.9	104,000.0	275.4	0.33	0.2	0.6
05/01/2022 16:00	2,642.6	0.0	2,642.6	104,000.0	274.8	0.33	0.2	0.6
05/01/2022 17:00	2,645.9	0.0	2,645.9	104,000.0	275.2	0.33	0.2	0.6
05/01/2022 18:00	2,639.1	0.0	2,639.1	104,000.0	274.5	0.33	0.2	0.6
05/01/2022 19:00	2,632.6	0.0	2,632.6	104,000.0	273.8	0.33	0.2	0.6
05/01/2022 20:00	2,635.8	0.0	2,635.8	104,000.0	274.1	0.33	0.2	0.6
05/01/2022 21:00	2,634.7	0.0	2,634.7	104,000.0	274.0	0.33	0.2	0.6
05/01/2022 22:00	2,641.4	0.0	2,641.4	104,000.0	274.7	0.33	0.2	0.6
05/01/2022 23:00	2,652.7	0.0	2,652.7	104,000.0	275.9	0.33	0.2	0.6
Average/Sum#:	2,708.8	0.0	2,708.8	104,000.0	281.7	0.34	0.2	0.6
Minimum:	1,965.1	0.0	1,965.1	104,000.0	204.4	0.33	0.2	0.6
Maximum:	3,644.2	0.0	3,644.2	104,000.0	379.0	0.45	0.2	0.8
%SI	16.67	16.67	16.67	0.00	16.67	20.83	20.83	20.83

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
05/02/2022 00:00	2,648.2	0.0	2,648.2	104,000.0	275.4	0.33	0.2	0.6
05/02/2022 01:00	2,635.8	0.0	2,635.8	104,000.0	274.1	0.33	0.2	0.6
05/02/2022 02:00	2,636.1	0.0	2,636.1	104,000.0	274.2	0.33	0.2	0.6
05/02/2022 03:00	2,627.6	0.0	2,627.6	104,000.0	273.3	0.33	0.2	0.6
05/02/2022 04:00	2,624.8	0.0	2,624.8	104,000.0	273.0	0.33	0.2	0.6
05/02/2022 05:00	2,577.3	0.0	2,577.3	104,000.0	268.0	0.32	0.2	0.5
05/02/2022 06:00	2,591.4	0.0	2,591.4	104,000.0	269.5	0.32	0.2	0.5
05/02/2022 07:00	2,604.4	0.0	2,604.4	104,000.0	270.9	0.32	0.2	0.5
05/02/2022 08:00	2,835.0	0.0	2,835.0	104,000.0	294.8	0.35	0.2	0.6
05/02/2022 09:00	2,848.3	0.0	2,848.3	104,000.0	296.2	0.36	0.2	0.6
05/02/2022 10:00	2,876.9	0.0	2,876.9	104,000.0	299.2	0.36	0.2	0.6
05/02/2022 11:00	2,869.7	0.0	2,869.7	104,000.0	298.4	0.36	0.2	0.6
05/02/2022 12:00	2,844.8	0.0	2,844.8	104,000.0	295.9	0.36	0.2	0.6
05/02/2022 13:00	2,854.9	0.0	2,854.9	104,000.0	296.9	0.36	0.2	0.6
05/02/2022 14:00	2,862.3	0.0	2,862.3	104,000.0	297.7	0.36	0.2	0.6
05/02/2022 15:00	2,856.2	0.0	2,856.2	104,000.0	297.0	0.36	0.2	0.6
05/02/2022 16:00	2,854.0	0.0	2,854.0	104,000.0	296.8	0.36	0.2	0.6
05/02/2022 17:00	3,434.6	0.0	3,434.6	104,000.0	357.2	0.43	0.2	0.7
05/02/2022 18:00	3,399.5	0.0	3,399.5	104,000.0	353.5	0.43	0.2	0.7
05/02/2022 19:00	3,703.4	0.0	3,703.4	104,000.0	385.2	0.46	0.2	0.8
05/02/2022 20:00	3,712.5	0.0	3,712.5	104,000.0	386.1	0.46	0.2	0.8
05/02/2022 21:00	4,434.0	0.0	4,434.0	104,000.0	461.1	0.55	0.3	0.9
05/02/2022 22:00	4,393.7	0.0	4,393.7	104,000.0	456.9	0.55	0.3	0.9
05/02/2022 23:00	4,480.0	0.0	4,480.0	104,000.0	465.9	0.56	0.3	0.9
Average/Sum#:	3,091.9	0.0	3,091.9	104,000.0	321.6	0.39	0.2	0.7
Minimum:	2,577.3	0.0	2,577.3	104,000.0	268.0	0.32	0.2	0.5
Maximum:	4,480.0	0.0	4,480.0	104,000.0	465.9	0.56	0.3	0.9
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
05/03/2022 00:00	4,489.1	0.0	4,489.1	104,000.0	466.9	0.56	0.3	0.9
05/03/2022 01:00	2,626.7	0.0	2,626.7	104,000.0	273.2	0.00	0.0	0.0
05/03/2022 02:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/03/2022 03:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/03/2022 04:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/03/2022 05:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/03/2022 06:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/03/2022 07:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/03/2022 08:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/03/2022 09:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/03/2022 10:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/03/2022 11:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/03/2022 12:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/03/2022 13:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/03/2022 14:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/03/2022 15:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/03/2022 16:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/03/2022 17:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/03/2022 18:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/03/2022 19:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/03/2022 20:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/03/2022 21:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/03/2022 22:00	1,964.6	0.0	1,964.6	104,000.0	204.3	0.00	0.0	0.0
05/03/2022 23:00	4,131.7	0.0	4,131.7	104,000.0	429.7	0.55	0.3	0.9
Average/Sum#:	3,303.0	0.0	3,303.0	104,000.0	343.5	0.56	0.3	0.9
Minimum:	1,964.6	0.0	1,964.6	104,000.0	204.3	0.55	0.3	0.9
Maximum:	4,489.1	0.0	4,489.1	104,000.0	466.9	0.56	0.3	0.9
%SI	83.33	83.33	83.33	0.00	83.33	91.67	91.67	91.67

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
05/04/2022 00:00	3,256.2	0.0	3,256.2	104,000.0	338.6	0.41	0.2	0.7
05/04/2022 01:00	2,844.8	0.0	2,844.8	104,000.0	295.9	0.36	0.2	0.6
05/04/2022 02:00	3,946.9	0.0	3,946.9	104,000.0	410.5	0.49	0.2	0.8
05/04/2022 03:00	4,236.4	0.0	4,236.4	104,000.0	440.6	0.53	0.3	0.9
05/04/2022 04:00	4,344.8	0.0	4,344.8	104,000.0	451.9	0.54	0.3	0.9
05/04/2022 05:00	3,780.8	0.0	3,780.8	104,000.0	393.2	0.47	0.2	0.8
05/04/2022 06:00	3,683.7	63.1	3,701.4	104,000.0	384.9	0.47	0.2	0.8
05/04/2022 07:00	4,395.8	303.7	4,699.5	104,000.0	488.7	0.59	0.3	1.0
05/04/2022 08:00	3,219.2	9.1	3,220.1	104,000.0	334.9	0.40	0.2	0.7
05/04/2022 09:00	2,731.4	0.0	2,731.4	104,000.0	284.1	0.34	0.2	0.6
05/04/2022 10:00	2,680.0	0.0	2,680.0	104,000.0	278.7	0.33	0.2	0.6
05/04/2022 11:00	2,735.5	0.0	2,735.5	104,000.0	284.5	0.34	0.2	0.6
05/04/2022 12:00	2,790.8	0.0	2,790.8	104,000.0	290.2	0.35	0.2	0.6
05/04/2022 13:00	2,801.6	0.0	2,801.6	104,000.0	291.4	0.35	0.2	0.6
05/04/2022 14:00	2,751.1	0.0	2,751.1	104,000.0	286.1	0.34	0.2	0.6
05/04/2022 15:00	2,674.6	0.0	2,674.6	104,000.0	278.2	0.33	0.2	0.6
05/04/2022 16:00	2,673.8	0.0	2,673.8	104,000.0	278.1	0.33	0.2	0.6
05/04/2022 17:00	3,012.2	50.2	3,017.2	104,000.0	313.8	0.38	0.2	0.6
05/04/2022 18:00	4,165.2	1,157.4	5,322.6	104,000.0	553.6	0.66	0.3	1.1
05/04/2022 19:00	4,207.5	699.2	4,906.7	104,000.0	510.3	0.61	0.3	1.0
05/04/2022 20:00	4,206.5	625.0	4,831.5	104,000.0	502.5	0.60	0.3	1.0
05/04/2022 21:00	4,236.6	982.6	5,219.2	104,000.0	542.8	0.65	0.3	1.1
05/04/2022 22:00	4,282.4	488.1	4,770.5	104,000.0	496.1	0.59	0.3	1.0
05/04/2022 23:00	3,730.0	122.2	3,782.5	104,000.0	393.4	0.48	0.2	0.8
Average/Sum#:	3,474.5	187.5	3,655.0	104,000.0	380.1	0.46	0.2	0.8
Minimum:	2,673.8	0.0	2,673.8	104,000.0	278.1	0.33	0.2	0.6
Maximum:	4,395.8	1,157.4	5,322.6	104,000.0	553.6	0.66	0.3	1.1
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
05/05/2022 00:00	3,467.6	0.0	3,467.6	104,000.0	360.6	0.43	0.2	0.7
05/05/2022 01:00	2,855.4	0.0	2,855.4	104,000.0	297.0	0.36	0.2	0.6
05/05/2022 02:00	2,785.5	0.0	2,785.5	104,000.0	289.7	0.35	0.2	0.6
05/05/2022 03:00	2,784.3	0.0	2,784.3	104,000.0	289.6	0.35	0.2	0.6
05/05/2022 04:00	3,388.6	0.0	3,388.6	104,000.0	352.4	0.43	0.2	0.7
05/05/2022 05:00	3,177.2	0.0	3,177.2	104,000.0	330.4	0.40	0.2	0.7
05/05/2022 06:00	2,712.3	0.0	2,712.3	104,000.0	282.1	0.34	0.2	0.6
05/05/2022 07:00	2,663.5	0.0	2,663.5	104,000.0	277.0	0.33	0.2	0.6
05/05/2022 08:00	2,684.9	0.0	2,684.9	104,000.0	279.2	0.33	0.2	0.6
05/05/2022 09:00	2,796.6	0.0	2,796.6	104,000.0	290.8	0.35	0.2	0.6
05/05/2022 10:00	2,770.1	0.0	2,770.1	104,000.0	288.1	0.35	0.2	0.6
05/05/2022 11:00	2,733.4	0.0	2,733.4	104,000.0	284.3	0.34	0.2	0.6
05/05/2022 12:00	3,659.7	0.0	3,659.7	104,000.0	380.6	0.46	0.2	0.8
05/05/2022 13:00	3,925.2	0.0	3,925.2	104,000.0	408.2	0.49	0.2	0.8
05/05/2022 14:00	2,938.7	0.0	2,938.7	104,000.0	305.6	0.37	0.2	0.6
05/05/2022 15:00	2,869.2	0.0	2,869.2	104,000.0	298.4	0.36	0.2	0.6
05/05/2022 16:00	2,700.8	0.0	2,700.8	104,000.0	280.9	0.34	0.2	0.6
05/05/2022 17:00	3,268.5	0.0	3,268.5	104,000.0	339.9	0.41	0.2	0.7
05/05/2022 18:00	4,470.6	157.7	4,628.3	104,000.0	481.3	0.58	0.3	1.0
05/05/2022 19:00	4,474.5	132.3	4,606.8	104,000.0	479.1	0.57	0.3	1.0
05/05/2022 20:00	4,471.4	129.5	4,600.9	104,000.0	478.5	0.57	0.3	1.0
05/05/2022 21:00	4,061.7	65.5	4,095.8	104,000.0	426.0	0.52	0.3	0.9
05/05/2022 22:00	3,044.3	0.0	3,044.3	104,000.0	316.6	0.38	0.2	0.6
05/05/2022 23:00	2,756.7	0.0	2,756.7	104,000.0	286.7	0.34	0.2	0.6
Average/Sum#:	3,227.5	20.2	3,246.4	104,000.0	337.6	0.41	0.2	0.7
Minimum:	2,663.5	0.0	2,663.5	104,000.0	277.0	0.33	0.2	0.6
Maximum:	4,474.5	157.7	4,628.3	104,000.0	481.3	0.58	0.3	1.0
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
05/06/2022 00:00	2,774.6	0.0	2,774.6	104,000.0	288.6	0.35	0.2	0.6
05/06/2022 01:00	2,724.7	0.0	2,724.7	104,000.0	283.4	0.34	0.2	0.6
05/06/2022 02:00	2,780.4	0.0	2,780.4	104,000.0	289.2	0.35	0.2	0.6
05/06/2022 03:00	2,916.3	0.0	2,916.3	104,000.0	303.3	0.37	0.2	0.6
05/06/2022 04:00	4,427.2	107.6	4,507.9	104,000.0	468.8	0.56	0.3	0.9
05/06/2022 05:00	4,463.5	127.6	4,591.1	104,000.0	477.5	0.57	0.3	1.0
05/06/2022 06:00	4,458.2	127.0	4,585.2	104,000.0	476.9	0.57	0.3	1.0
05/06/2022 07:00	3,355.3	1.6	3,355.3	104,000.0	349.0	0.42	0.2	0.7
05/06/2022 08:00	4,449.0	112.1	4,529.7	104,000.0	471.1	0.57	0.3	0.9
05/06/2022 09:00	4,453.1	102.6	4,532.1	104,000.0	471.3	0.57	0.3	0.9
05/06/2022 10:00	4,397.3	100.3	4,445.4	104,000.0	462.3	0.56	0.3	0.9
05/06/2022 11:00	4,445.9	219.6	4,665.5	104,000.0	485.2	0.58	0.3	1.0
05/06/2022 12:00	4,157.1	1.6	4,157.1	104,000.0	432.3	0.52	0.3	0.9
05/06/2022 13:00	4,408.8	285.0	4,685.3	104,000.0	487.3	0.59	0.3	1.0
05/06/2022 14:00	3,573.0	77.7	3,596.3	104,000.0	374.0	0.46	0.2	0.8
05/06/2022 15:00	2,658.8	0.0	2,658.8	104,000.0	276.5	0.33	0.2	0.6
05/06/2022 16:00	4,312.7	244.2	4,488.5	104,000.0	466.8	0.57	0.3	0.9
05/06/2022 17:00	4,418.6	284.2	4,702.8	104,000.0	489.1	0.59	0.3	1.0
05/06/2022 18:00	4,445.4	199.9	4,645.3	104,000.0	483.1	0.58	0.3	1.0
05/06/2022 19:00	4,460.8	147.6	4,608.4	104,000.0	479.3	0.58	0.3	1.0
05/06/2022 20:00	4,468.0	138.9	4,606.9	104,000.0	479.1	0.58	0.3	1.0
05/06/2022 21:00	4,472.1	127.4	4,599.5	104,000.0	478.3	0.57	0.3	1.0
05/06/2022 22:00	3,930.7	33.8	3,939.8	104,000.0	409.7	0.49	0.2	0.8
05/06/2022 23:00	4,463.6	14.5	4,465.1	104,000.0	464.4	0.56	0.3	0.9
Average/Sum#:	3,975.6	102.2	4,065.1	104,000.0	422.8	0.51	0.3	0.9
Minimum:	2,658.8	0.0	2,658.8	104,000.0	276.5	0.33	0.2	0.6
Maximum:	4,472.1	285.0	4,702.8	104,000.0	489.1	0.59	0.3	1.0
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
05/07/2022 00:00	4,432.9	61.7	4,463.8	104,000.0	464.2	0.56	0.3	0.9
05/07/2022 01:00	4,452.4	189.6	4,598.4	104,000.0	478.2	0.58	0.3	1.0
05/07/2022 02:00	4,473.3	270.5	4,743.8	104,000.0	493.4	0.59	0.3	1.0
05/07/2022 03:00	4,477.4	259.5	4,736.9	104,000.0	492.6	0.59	0.3	1.0
05/07/2022 04:00	4,486.2	246.7	4,732.9	104,000.0	492.2	0.59	0.3	1.0
05/07/2022 05:00	4,492.4	232.9	4,725.3	104,000.0	491.4	0.59	0.3	1.0
05/07/2022 06:00	4,496.2	234.9	4,731.1	104,000.0	492.0	0.59	0.3	1.0
05/07/2022 07:00	4,483.9	264.8	4,748.7	104,000.0	493.9	0.59	0.3	1.0
05/07/2022 08:00	4,459.3	245.9	4,705.2	104,000.0	489.3	0.59	0.3	1.0
05/07/2022 09:00	4,450.1	286.7	4,736.8	104,000.0	492.6	0.59	0.3	1.0
05/07/2022 10:00	4,417.2	308.7	4,725.9	104,000.0	491.5	0.59	0.3	1.0
05/07/2022 11:00	4,402.2	344.8	4,747.0	104,000.0	493.7	0.59	0.3	1.0
05/07/2022 12:00	4,345.4	169.9	4,501.7	104,000.0	468.2	0.56	0.3	0.9
05/07/2022 13:00	2,837.1	0.0	2,837.1	104,000.0	295.1	0.35	0.2	0.6
05/07/2022 14:00	2,663.8	0.0	2,663.8	104,000.0	277.0	0.33	0.2	0.6
05/07/2022 15:00	2,645.3	0.0	2,645.3	104,000.0	275.1	0.33	0.2	0.6
05/07/2022 16:00	2,647.5	0.0	2,647.5	104,000.0	275.3	0.33	0.2	0.5
05/07/2022 17:00	2,772.9	0.0	2,772.9	104,000.0	288.4	0.35	0.2	0.6
05/07/2022 18:00	4,314.9	226.5	4,500.6	104,000.0	468.1	0.57	0.3	0.9
05/07/2022 19:00	4,385.4	219.0	4,604.4	104,000.0	478.9	0.57	0.3	1.0
05/07/2022 20:00	4,370.5	127.4	4,468.6	104,000.0	464.7	0.56	0.3	0.9
05/07/2022 21:00	2,776.9	0.0	2,776.9	104,000.0	288.8	0.35	0.2	0.6
05/07/2022 22:00	2,649.7	0.0	2,649.7	104,000.0	275.6	0.33	0.2	0.5
05/07/2022 23:00	2,651.0	0.0	2,651.0	104,000.0	275.7	0.33	0.2	0.6
Average/Sum#:	3,857.7	153.7	4,004.8	104,000.0	416.5	0.50	0.3	0.8
Minimum:	2,645.3	0.0	2,645.3	104,000.0	275.1	0.33	0.2	0.5
Maximum:	4,496.2	344.8	4,748.7	104,000.0	493.9	0.59	0.3	1.0
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
05/08/2022 00:00	2,649.3	0.0	2,649.3	104,000.0	275.5	0.33	0.2	0.6
05/08/2022 01:00	2,649.8	0.0	2,649.8	104,000.0	275.6	0.33	0.2	0.6
05/08/2022 02:00	2,655.2	0.0	2,655.2	104,000.0	276.1	0.33	0.2	0.6
05/08/2022 03:00	2,656.5	0.0	2,656.5	104,000.0	276.3	0.33	0.2	0.6
05/08/2022 04:00	2,717.2	0.0	2,717.2	104,000.0	282.6	0.34	0.2	0.6
05/08/2022 05:00	2,671.0	0.0	2,671.0	104,000.0	277.8	0.33	0.2	0.6
05/08/2022 06:00	1,837.4	0.0	1,837.4	104,000.0	191.1	0.00	0.0	0.0
05/08/2022 07:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/08/2022 08:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/08/2022 09:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/08/2022 10:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/08/2022 11:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/08/2022 12:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/08/2022 13:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/08/2022 14:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/08/2022 15:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/08/2022 16:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/08/2022 17:00	2,561.1	0.0	2,561.1	104,000.0	266.4	0.00	0.0	0.0
05/08/2022 18:00	3,061.1	0.0	3,061.1	104,000.0	318.4	0.39	0.2	0.7
05/08/2022 19:00	4,513.8	126.0	4,636.0	104,000.0	482.1	0.58	0.3	1.0
05/08/2022 20:00	4,536.9	129.3	4,666.2	104,000.0	485.3	0.58	0.3	1.0
05/08/2022 21:00	4,510.4	100.9	4,588.1	104,000.0	477.2	0.57	0.3	1.0
05/08/2022 22:00	2,867.2	0.0	2,867.2	104,000.0	298.2	0.36	0.2	0.6
05/08/2022 23:00	2,658.0	0.0	2,658.0	104,000.0	276.4	0.33	0.2	0.6
Average/Sum#:	3,038.9	25.4	3,062.4	104,000.0	318.5	0.40	0.2	0.7
Minimum:	1,837.4	0.0	1,837.4	104,000.0	191.1	0.33	0.2	0.6
Maximum:	4,536.9	129.3	4,666.2	104,000.0	485.3	0.58	0.3	1.0
%SI	41.67	41.67	41.67	0.00	41.67	50.00	50.00	50.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
05/09/2022 00:00	2,669.2	0.0	2,669.2	104,000.0	277.6	0.33	0.2	0.6
05/09/2022 01:00	2,665.6	0.0	2,665.6	104,000.0	277.2	0.33	0.2	0.6
05/09/2022 02:00	2,665.5	0.0	2,665.5	104,000.0	277.2	0.33	0.2	0.6
05/09/2022 03:00	2,671.0	0.0	2,671.0	104,000.0	277.8	0.33	0.2	0.6
05/09/2022 04:00	2,681.6	0.0	2,681.6	104,000.0	278.9	0.33	0.2	0.6
05/09/2022 05:00	2,715.0	0.0	2,715.0	104,000.0	282.4	0.34	0.2	0.6
05/09/2022 06:00	2,656.0	0.0	2,656.0	104,000.0	276.2	0.33	0.2	0.6
05/09/2022 07:00	2,659.1	0.0	2,659.1	104,000.0	276.5	0.33	0.2	0.6
05/09/2022 08:00	2,654.3	0.0	2,654.3	104,000.0	276.0	0.33	0.2	0.6
05/09/2022 09:00	2,654.8	0.0	2,654.8	104,000.0	276.1	0.33	0.2	0.6
05/09/2022 10:00	2,652.6	0.0	2,652.6	104,000.0	275.9	0.33	0.2	0.6
05/09/2022 11:00	1,462.5	0.0	1,462.5	104,000.0	152.1	0.00	0.0	0.0
05/09/2022 12:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/09/2022 13:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/09/2022 14:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/09/2022 15:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/09/2022 16:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/09/2022 17:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/09/2022 18:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/09/2022 19:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/09/2022 20:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/09/2022 21:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/09/2022 22:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/09/2022 23:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
Average/Sum#:	2,567.3	0.0	2,567.3	104,000.0	267.0	0.33	0.2	0.6
Minimum:	1,462.5	0.0	1,462.5	104,000.0	152.1	0.33	0.2	0.6
Maximum:	2,715.0	0.0	2,715.0	104,000.0	282.4	0.34	0.2	0.6
%SI	50.00	50.00	50.00	0.00	50.00	54.17	54.17	54.17

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
05/10/2022 00:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/10/2022 01:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/10/2022 02:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/10/2022 03:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/10/2022 04:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/10/2022 05:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/10/2022 06:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/10/2022 07:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/10/2022 08:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/10/2022 09:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/10/2022 10:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/10/2022 11:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/10/2022 12:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/10/2022 13:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/10/2022 14:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/10/2022 15:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/10/2022 16:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/10/2022 17:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/10/2022 18:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/10/2022 19:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/10/2022 20:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/10/2022 21:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/10/2022 22:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/10/2022 23:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
Minimum:	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
Maximum:	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
05/11/2022 00:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/11/2022 01:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/11/2022 02:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/11/2022 03:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/11/2022 04:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/11/2022 05:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/11/2022 06:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/11/2022 07:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/11/2022 08:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/11/2022 09:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/11/2022 10:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/11/2022 11:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/11/2022 12:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/11/2022 13:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/11/2022 14:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/11/2022 15:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/11/2022 16:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/11/2022 17:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/11/2022 18:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/11/2022 19:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/11/2022 20:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/11/2022 21:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/11/2022 22:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/11/2022 23:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
Minimum:	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
Maximum:	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
05/12/2022 00:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/12/2022 01:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/12/2022 02:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/12/2022 03:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/12/2022 04:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/12/2022 05:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/12/2022 06:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/12/2022 07:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/12/2022 08:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/12/2022 09:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/12/2022 10:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/12/2022 11:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/12/2022 12:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/12/2022 13:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/12/2022 14:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/12/2022 15:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/12/2022 16:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/12/2022 17:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/12/2022 18:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/12/2022 19:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/12/2022 20:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/12/2022 21:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/12/2022 22:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/12/2022 23:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
Minimum:	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
Maximum:	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
05/13/2022 00:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/13/2022 01:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/13/2022 02:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/13/2022 03:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/13/2022 04:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/13/2022 05:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/13/2022 06:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/13/2022 07:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/13/2022 08:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/13/2022 09:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/13/2022 10:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/13/2022 11:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/13/2022 12:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/13/2022 13:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/13/2022 14:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/13/2022 15:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/13/2022 16:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/13/2022 17:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/13/2022 18:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/13/2022 19:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/13/2022 20:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/13/2022 21:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/13/2022 22:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/13/2022 23:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
Minimum:	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
Maximum:	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
05/14/2022 00:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/14/2022 01:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/14/2022 02:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/14/2022 03:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/14/2022 04:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/14/2022 05:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/14/2022 06:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/14/2022 07:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/14/2022 08:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/14/2022 09:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/14/2022 10:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/14/2022 11:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/14/2022 12:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/14/2022 13:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/14/2022 14:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/14/2022 15:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/14/2022 16:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/14/2022 17:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/14/2022 18:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/14/2022 19:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/14/2022 20:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/14/2022 21:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/14/2022 22:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/14/2022 23:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
Minimum:	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
Maximum:	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
05/15/2022 00:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/15/2022 01:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/15/2022 02:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/15/2022 03:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/15/2022 04:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/15/2022 05:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/15/2022 06:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/15/2022 07:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/15/2022 08:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/15/2022 09:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/15/2022 10:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/15/2022 11:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/15/2022 12:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/15/2022 13:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/15/2022 14:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/15/2022 15:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/15/2022 16:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/15/2022 17:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/15/2022 18:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/15/2022 19:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/15/2022 20:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/15/2022 21:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/15/2022 22:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/15/2022 23:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
Minimum:	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
Maximum:	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
05/16/2022 00:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/16/2022 01:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/16/2022 02:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/16/2022 03:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/16/2022 04:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/16/2022 05:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/16/2022 06:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/16/2022 07:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/16/2022 08:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/16/2022 09:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/16/2022 10:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/16/2022 11:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/16/2022 12:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/16/2022 13:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/16/2022 14:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/16/2022 15:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/16/2022 16:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/16/2022 17:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/16/2022 18:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/16/2022 19:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/16/2022 20:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/16/2022 21:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/16/2022 22:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/16/2022 23:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
Minimum:	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
Maximum:	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
05/17/2022 00:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/17/2022 01:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/17/2022 02:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/17/2022 03:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/17/2022 04:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/17/2022 05:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/17/2022 06:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/17/2022 07:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/17/2022 08:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/17/2022 09:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/17/2022 10:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/17/2022 11:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/17/2022 12:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/17/2022 13:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/17/2022 14:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/17/2022 15:00	2,758.7	0.0	2,758.7	104,000.0	286.9	0.00	0.0	0.0
05/17/2022 16:00	4,151.5	0.0	4,151.5	104,000.0	431.8	0.53	0.3	0.9
05/17/2022 17:00	4,238.0	0.0	4,238.0	104,000.0	440.8	0.53	0.3	0.9
05/17/2022 18:00	4,303.1	0.0	4,303.1	104,000.0	447.5	0.54	0.3	0.9
05/17/2022 19:00	4,384.6	214.7	4,541.3	104,000.0	472.3	0.57	0.3	1.0
05/17/2022 20:00	4,429.3	567.6	4,996.9	104,000.0	519.7	0.62	0.3	1.0
05/17/2022 21:00	4,437.8	678.3	5,116.1	104,000.0	532.1	0.64	0.3	1.1
05/17/2022 22:00	4,147.0	183.8	4,242.6	104,000.0	441.2	0.54	0.3	0.9
05/17/2022 23:00	2,624.5	0.0	2,624.5	104,000.0	272.9	0.33	0.2	0.5
Average/Sum#:	3,941.6	182.7	4,108.1	104,000.0	427.2	0.54	0.3	0.9
Minimum:	2,624.5	0.0	2,624.5	104,000.0	272.9	0.33	0.2	0.5
Maximum:	4,437.8	678.3	5,116.1	104,000.0	532.1	0.64	0.3	1.1
%SI	62.50	62.50	62.50	0.00	62.50	66.67	66.67	66.67

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
05/18/2022 00:00	2,626.8	0.0	2,626.8	104,000.0	273.2	0.33	0.2	0.5
05/18/2022 01:00	2,604.3	0.0	2,604.3	104,000.0	270.8	0.32	0.2	0.5
05/18/2022 02:00	3,510.0	2.6	3,510.1	104,000.0	365.1	0.44	0.2	0.7
05/18/2022 03:00	4,505.6	1,186.4	5,692.0	104,000.0	592.0	0.71	0.4	1.2
05/18/2022 04:00	4,514.6	1,968.5	6,483.1	104,000.0	674.2	0.81	0.4	1.3
05/18/2022 05:00	4,513.0	454.6	4,785.8	104,000.0	497.7	0.62	0.3	1.0
05/18/2022 06:00	3,647.9	0.0	3,647.9	104,000.0	379.4	0.46	0.2	0.8
05/18/2022 07:00	4,202.3	0.0	4,202.3	104,000.0	437.0	0.52	0.3	0.9
05/18/2022 08:00	4,491.4	0.0	4,491.4	104,000.0	467.1	0.56	0.3	0.9
05/18/2022 09:00	4,485.8	0.0	4,485.8	104,000.0	466.5	0.56	0.3	0.9
05/18/2022 10:00	4,465.1	108.7	4,495.5	104,000.0	467.5	0.57	0.3	1.0
05/18/2022 11:00	4,452.9	1,205.9	5,658.8	104,000.0	588.5	0.71	0.4	1.2
05/18/2022 12:00	4,425.8	126.2	4,511.6	104,000.0	469.2	0.57	0.3	0.9
05/18/2022 13:00	4,395.4	857.4	5,252.8	104,000.0	546.3	0.66	0.3	1.1
05/18/2022 14:00	4,370.2	1,729.6	6,099.8	104,000.0	634.4	0.76	0.4	1.3
05/18/2022 15:00	4,357.1	1,089.6	5,446.7	104,000.0	566.5	0.68	0.3	1.1
05/18/2022 16:00	4,362.7	572.7	4,935.4	104,000.0	513.3	0.62	0.3	1.0
05/18/2022 17:00	4,372.2	1,532.8	5,905.0	104,000.0	614.1	0.74	0.4	1.2
05/18/2022 18:00	4,371.0	1,194.0	5,565.0	104,000.0	578.8	0.69	0.3	1.2
05/18/2022 19:00	4,378.3	1,004.0	5,382.3	104,000.0	559.8	0.67	0.3	1.1
05/18/2022 20:00	4,390.6	1,450.7	5,841.3	104,000.0	607.5	0.73	0.4	1.2
05/18/2022 21:00	4,409.0	468.7	4,877.7	104,000.0	507.3	0.61	0.3	1.0
05/18/2022 22:00	4,422.6	417.5	4,840.1	104,000.0	503.4	0.60	0.3	1.0
05/18/2022 23:00	3,901.5	101.7	3,935.1	104,000.0	409.3	0.50	0.2	0.8
Average/Sum#:	4,174.0	644.7	4,803.2	104,000.0	499.5	0.60	0.3	1.0
Minimum:	2,604.3	0.0	2,604.3	104,000.0	270.8	0.32	0.2	0.5
Maximum:	4,514.6	1,968.5	6,483.1	104,000.0	674.2	0.81	0.4	1.3
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
05/19/2022 00:00	2,449.7	0.0	2,449.7	104,000.0	254.8	0.34	0.2	0.6
05/19/2022 01:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/19/2022 02:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/19/2022 03:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/19/2022 04:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/19/2022 05:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/19/2022 06:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/19/2022 07:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/19/2022 08:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/19/2022 09:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/19/2022 10:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/19/2022 11:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/19/2022 12:00	2,389.0	0.0	2,389.0	104,000.0	248.5	0.00	0.0	0.0
05/19/2022 13:00	3,744.7	2.8	3,744.8	104,000.0	389.5	0.51	0.3	0.9
05/19/2022 14:00	4,442.0	568.3	5,010.3	104,000.0	521.1	0.62	0.3	1.0
05/19/2022 15:00	3,862.2	100.6	3,900.4	104,000.0	405.6	0.49	0.2	0.8
05/19/2022 16:00	3,704.3	82.6	3,727.4	104,000.0	387.6	0.47	0.2	0.8
05/19/2022 17:00	4,432.1	356.4	4,788.5	104,000.0	498.0	0.60	0.3	1.0
05/19/2022 18:00	4,431.8	497.7	4,929.5	104,000.0	512.7	0.62	0.3	1.0
05/19/2022 19:00	4,437.2	643.2	5,080.4	104,000.0	528.4	0.63	0.3	1.1
05/19/2022 20:00	4,439.9	1,057.6	5,497.5	104,000.0	571.7	0.69	0.3	1.1
05/19/2022 21:00	4,456.0	422.8	4,878.8	104,000.0	507.4	0.61	0.3	1.0
05/19/2022 22:00	3,867.2	36.9	3,877.6	104,000.0	403.3	0.54	0.3	0.9
05/19/2022 23:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
Average/Sum#:	3,888.0	314.1	4,189.5	104,000.0	435.7	0.56	0.3	0.9
Minimum:	2,389.0	0.0	2,389.0	104,000.0	248.5	0.34	0.2	0.6
Maximum:	4,456.0	1,057.6	5,497.5	104,000.0	571.7	0.69	0.3	1.1
%SI	50.00	50.00	50.00	0.00	50.00	54.17	54.17	54.17

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
05/20/2022 00:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/20/2022 01:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/20/2022 02:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/20/2022 03:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/20/2022 04:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/20/2022 05:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/20/2022 06:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/20/2022 07:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/20/2022 08:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/20/2022 09:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/20/2022 10:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/20/2022 11:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/20/2022 12:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/20/2022 13:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/20/2022 14:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/20/2022 15:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/20/2022 16:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/20/2022 17:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/20/2022 18:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/20/2022 19:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/20/2022 20:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/20/2022 21:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/20/2022 22:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/20/2022 23:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
Minimum:	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
Maximum:	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
05/21/2022 00:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/21/2022 01:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/21/2022 02:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/21/2022 03:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/21/2022 04:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/21/2022 05:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/21/2022 06:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/21/2022 07:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/21/2022 08:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/21/2022 09:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/21/2022 10:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/21/2022 11:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/21/2022 12:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/21/2022 13:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/21/2022 14:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/21/2022 15:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/21/2022 16:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/21/2022 17:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/21/2022 18:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/21/2022 19:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/21/2022 20:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/21/2022 21:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/21/2022 22:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/21/2022 23:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
Minimum:	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
Maximum:	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
05/22/2022 00:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/22/2022 01:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/22/2022 02:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/22/2022 03:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/22/2022 04:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/22/2022 05:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/22/2022 06:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/22/2022 07:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/22/2022 08:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/22/2022 09:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/22/2022 10:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/22/2022 11:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/22/2022 12:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/22/2022 13:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/22/2022 14:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/22/2022 15:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/22/2022 16:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/22/2022 17:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/22/2022 18:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/22/2022 19:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/22/2022 20:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/22/2022 21:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/22/2022 22:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/22/2022 23:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
Minimum:	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
Maximum:	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
05/23/2022 00:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/23/2022 01:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/23/2022 02:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/23/2022 03:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/23/2022 04:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/23/2022 05:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/23/2022 06:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/23/2022 07:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/23/2022 08:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/23/2022 09:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/23/2022 10:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/23/2022 11:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/23/2022 12:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/23/2022 13:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/23/2022 14:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/23/2022 15:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/23/2022 16:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/23/2022 17:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/23/2022 18:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/23/2022 19:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/23/2022 20:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/23/2022 21:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/23/2022 22:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/23/2022 23:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
Minimum:	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
Maximum:	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
05/24/2022 00:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/24/2022 01:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/24/2022 02:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/24/2022 03:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/24/2022 04:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/24/2022 05:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/24/2022 06:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/24/2022 07:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/24/2022 08:00	2,619.1	0.0	2,619.1	104,000.0	272.4	0.00	0.0	0.0
05/24/2022 09:00	2,784.2	0.0	2,784.2	104,000.0	289.6	0.35	0.2	0.6
05/24/2022 10:00	3,488.1	1.3	3,488.1	104,000.0	362.8	0.44	0.2	0.7
05/24/2022 11:00	3,775.9	0.0	3,775.9	104,000.0	392.7	0.47	0.2	0.8
05/24/2022 12:00	4,318.4	119.8	4,360.3	104,000.0	453.5	0.56	0.3	0.9
05/24/2022 13:00	4,378.6	751.2	5,129.8	104,000.0	533.5	0.64	0.3	1.1
05/24/2022 14:00	4,361.2	1,549.4	5,910.6	104,000.0	614.7	0.74	0.4	1.2
05/24/2022 15:00	4,346.4	1,966.6	6,313.0	104,000.0	656.6	0.79	0.4	1.3
05/24/2022 16:00	4,344.5	1,594.2	5,938.7	104,000.0	617.6	0.74	0.4	1.2
05/24/2022 17:00	4,337.6	1,192.2	5,529.8	104,000.0	575.1	0.69	0.3	1.2
05/24/2022 18:00	4,322.2	1,963.7	6,285.9	104,000.0	653.7	0.78	0.4	1.3
05/24/2022 19:00	4,323.8	1,717.3	6,041.1	104,000.0	628.3	0.75	0.4	1.3
05/24/2022 20:00	4,334.7	932.9	5,267.6	104,000.0	547.8	0.66	0.3	1.1
05/24/2022 21:00	4,356.3	765.0	5,121.3	104,000.0	532.6	0.64	0.3	1.1
05/24/2022 22:00	4,376.5	1,143.2	5,519.7	104,000.0	574.0	0.69	0.3	1.1
05/24/2022 23:00	3,748.1	94.0	3,782.9	104,000.0	393.4	0.48	0.2	0.8
Average/Sum#:	4,013.5	861.9	4,866.8	104,000.0	506.1	0.63	0.3	1.0
Minimum:	2,619.1	0.0	2,619.1	104,000.0	272.4	0.35	0.2	0.6
Maximum:	4,378.6	1,966.6	6,313.0	104,000.0	656.6	0.79	0.4	1.3
%SI	33.33	33.33	33.33	0.00	33.33	37.50	37.50	37.50

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
05/25/2022 00:00	3,745.4	0.0	3,745.4	104,000.0	389.5	0.47	0.2	0.8
05/25/2022 01:00	3,040.9	0.0	3,040.9	104,000.0	316.3	0.38	0.2	0.6
05/25/2022 02:00	2,778.8	0.0	2,778.8	104,000.0	289.0	0.35	0.2	0.6
05/25/2022 03:00	3,697.9	75.3	3,718.2	104,000.0	386.7	0.47	0.2	0.8
05/25/2022 04:00	4,441.4	235.2	4,676.6	104,000.0	486.4	0.58	0.3	1.0
05/25/2022 05:00	4,335.1	54.1	4,349.7	104,000.0	452.4	0.55	0.3	0.9
05/25/2022 06:00	4,440.9	249.0	4,682.4	104,000.0	487.0	0.59	0.3	1.0
05/25/2022 07:00	3,665.7	69.2	3,684.4	104,000.0	383.2	0.47	0.2	0.8
05/25/2022 08:00	2,660.7	0.0	2,660.7	104,000.0	276.7	0.33	0.2	0.6
05/25/2022 09:00	3,511.7	0.0	3,511.7	104,000.0	365.2	0.44	0.2	0.7
05/25/2022 10:00	4,348.0	102.8	4,380.9	104,000.0	455.6	0.56	0.3	0.9
05/25/2022 11:00	4,362.3	1,745.4	6,107.7	104,000.0	635.2	0.76	0.4	1.3
05/25/2022 12:00	4,355.7	2,044.5	6,400.2	104,000.0	665.6	0.80	0.4	1.3
05/25/2022 13:00	4,344.9	2,042.6	6,387.5	104,000.0	664.3	0.80	0.4	1.3
05/25/2022 14:00	4,335.0	2,041.3	6,376.3	104,000.0	663.1	0.80	0.4	1.3
05/25/2022 15:00	4,317.6	2,035.5	6,353.1	104,000.0	660.7	0.79	0.4	1.3
05/25/2022 16:00	4,320.0	2,029.5	6,349.5	104,000.0	660.3	0.79	0.4	1.3
05/25/2022 17:00	4,314.7	1,958.8	6,273.5	104,000.0	652.4	0.78	0.4	1.3
05/25/2022 18:00	4,312.8	1,981.9	6,294.7	104,000.0	654.6	0.79	0.4	1.3
05/25/2022 19:00	4,326.5	1,070.3	5,396.8	104,000.0	561.3	0.67	0.3	1.1
05/25/2022 20:00	4,339.7	525.2	4,864.9	104,000.0	505.9	0.61	0.3	1.0
05/25/2022 21:00	4,342.7	609.4	4,952.1	104,000.0	515.0	0.62	0.3	1.0
05/25/2022 22:00	3,570.3	111.8	3,600.5	104,000.0	374.5	0.49	0.2	0.8
05/25/2022 23:00	690.1	0.0	690.1	104,000.0	71.8	0.00	0.0	0.0
Average/Sum#:	3,858.3	790.9	4,636.5	104,000.0	482.2	0.60	0.3	1.0
Minimum:	690.1	0.0	690.1	104,000.0	71.8	0.33	0.2	0.6
Maximum:	4,441.4	2,044.5	6,400.2	104,000.0	665.6	0.80	0.4	1.3
%SI	0.00	0.00	0.00	0.00	0.00	4.17	4.17	4.17

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
05/26/2022 00:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/26/2022 01:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/26/2022 02:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/26/2022 03:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/26/2022 04:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/26/2022 05:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/26/2022 06:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/26/2022 07:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/26/2022 08:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/26/2022 09:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/26/2022 10:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/26/2022 11:00	1,900.6	0.0	1,900.6	104,000.0	197.7	0.00	0.0	0.0
05/26/2022 12:00	2,896.0	0.0	2,896.0	104,000.0	301.2	0.35	0.2	0.6
05/26/2022 13:00	2,714.9	0.0	2,714.9	104,000.0	282.3	0.34	0.2	0.6
05/26/2022 14:00	3,695.8	1.6	3,695.8	104,000.0	384.4	0.46	0.2	0.8
05/26/2022 15:00	4,429.6	145.3	4,556.0	104,000.0	473.8	0.57	0.3	1.0
05/26/2022 16:00	4,439.7	125.5	4,565.2	104,000.0	474.8	0.57	0.3	1.0
05/26/2022 17:00	4,448.6	126.2	4,574.8	104,000.0	475.8	0.57	0.3	1.0
05/26/2022 18:00	4,463.9	126.4	4,590.3	104,000.0	477.4	0.57	0.3	1.0
05/26/2022 19:00	4,471.0	127.3	4,598.3	104,000.0	478.2	0.57	0.3	1.0
05/26/2022 20:00	3,509.9	3.6	3,510.1	104,000.0	365.1	0.55	0.3	0.9
05/26/2022 21:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/26/2022 22:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/26/2022 23:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
Average/Sum#:	3,697.0	65.6	3,760.2	104,000.0	391.1	0.51	0.3	0.9
Minimum:	1,900.6	0.0	1,900.6	104,000.0	197.7	0.34	0.2	0.6
Maximum:	4,471.0	145.3	4,598.3	104,000.0	478.2	0.57	0.3	1.0
%SI	58.33	58.33	58.33	0.00	58.33	62.50	62.50	62.50

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
05/27/2022 00:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/27/2022 01:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/27/2022 02:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/27/2022 03:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/27/2022 04:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/27/2022 05:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/27/2022 06:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/27/2022 07:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/27/2022 08:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/27/2022 09:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/27/2022 10:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/27/2022 11:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/27/2022 12:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/27/2022 13:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/27/2022 14:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/27/2022 15:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/27/2022 16:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/27/2022 17:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/27/2022 18:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/27/2022 19:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/27/2022 20:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/27/2022 21:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/27/2022 22:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/27/2022 23:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
Minimum:	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
Maximum:	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
05/28/2022 00:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/28/2022 01:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/28/2022 02:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/28/2022 03:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/28/2022 04:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/28/2022 05:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/28/2022 06:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/28/2022 07:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/28/2022 08:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/28/2022 09:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/28/2022 10:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/28/2022 11:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/28/2022 12:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/28/2022 13:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/28/2022 14:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/28/2022 15:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/28/2022 16:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/28/2022 17:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/28/2022 18:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/28/2022 19:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/28/2022 20:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/28/2022 21:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/28/2022 22:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/28/2022 23:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
Minimum:	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
Maximum:	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
05/29/2022 00:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/29/2022 01:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/29/2022 02:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/29/2022 03:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/29/2022 04:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/29/2022 05:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/29/2022 06:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/29/2022 07:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/29/2022 08:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/29/2022 09:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/29/2022 10:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/29/2022 11:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/29/2022 12:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/29/2022 13:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/29/2022 14:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/29/2022 15:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/29/2022 16:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/29/2022 17:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/29/2022 18:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/29/2022 19:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/29/2022 20:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/29/2022 21:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/29/2022 22:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/29/2022 23:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
Minimum:	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
Maximum:	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
05/30/2022 00:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/30/2022 01:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/30/2022 02:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/30/2022 03:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/30/2022 04:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/30/2022 05:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/30/2022 06:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/30/2022 07:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/30/2022 08:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/30/2022 09:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/30/2022 10:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/30/2022 11:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/30/2022 12:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/30/2022 13:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/30/2022 14:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/30/2022 15:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/30/2022 16:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/30/2022 17:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/30/2022 18:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/30/2022 19:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/30/2022 20:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/30/2022 21:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/30/2022 22:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/30/2022 23:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
Minimum:	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
Maximum:	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
05/31/2022 00:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/31/2022 01:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/31/2022 02:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/31/2022 03:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/31/2022 04:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/31/2022 05:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/31/2022 06:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/31/2022 07:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/31/2022 08:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/31/2022 09:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/31/2022 10:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/31/2022 11:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/31/2022 12:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/31/2022 13:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/31/2022 14:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/31/2022 15:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/31/2022 16:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/31/2022 17:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/31/2022 18:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/31/2022 19:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/31/2022 20:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/31/2022 21:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/31/2022 22:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
05/31/2022 23:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
Minimum:	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
Maximum:	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
06/01/2022 00:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
06/01/2022 01:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
06/01/2022 02:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
06/01/2022 03:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
06/01/2022 04:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
06/01/2022 05:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
06/01/2022 06:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
06/01/2022 07:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
06/01/2022 08:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
06/01/2022 09:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
06/01/2022 10:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
06/01/2022 11:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
06/01/2022 12:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
06/01/2022 13:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
06/01/2022 14:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
06/01/2022 15:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
06/01/2022 16:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
06/01/2022 17:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
06/01/2022 18:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
06/01/2022 19:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
06/01/2022 20:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
06/01/2022 21:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
06/01/2022 22:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
06/01/2022 23:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
Minimum:	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
Maximum:	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
06/02/2022 00:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
06/02/2022 01:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
06/02/2022 02:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
06/02/2022 03:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
06/02/2022 04:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
06/02/2022 05:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
06/02/2022 06:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
06/02/2022 07:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
06/02/2022 08:00	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
06/02/2022 09:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/02/2022 10:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/02/2022 11:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/02/2022 12:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/02/2022 13:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/02/2022 14:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/02/2022 15:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/02/2022 16:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/02/2022 17:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/02/2022 18:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/02/2022 19:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/02/2022 20:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/02/2022 21:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/02/2022 22:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/02/2022 23:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	104,625.0	0.0	0.00	0.0	0.0
Minimum:	0.0	0.0	0.0	104,000.0	0.0	0.00	0.0	0.0
Maximum:	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
06/03/2022 00:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/03/2022 01:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/03/2022 02:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/03/2022 03:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/03/2022 04:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/03/2022 05:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/03/2022 06:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/03/2022 07:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/03/2022 08:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/03/2022 09:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/03/2022 10:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/03/2022 11:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/03/2022 12:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/03/2022 13:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/03/2022 14:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/03/2022 15:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/03/2022 16:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/03/2022 17:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/03/2022 18:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/03/2022 19:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/03/2022 20:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/03/2022 21:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/03/2022 22:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/03/2022 23:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
Minimum:	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
Maximum:	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
06/04/2022 00:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/04/2022 01:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/04/2022 02:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/04/2022 03:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/04/2022 04:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/04/2022 05:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/04/2022 06:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/04/2022 07:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/04/2022 08:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/04/2022 09:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/04/2022 10:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/04/2022 11:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/04/2022 12:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/04/2022 13:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/04/2022 14:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/04/2022 15:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/04/2022 16:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/04/2022 17:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/04/2022 18:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/04/2022 19:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/04/2022 20:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/04/2022 21:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/04/2022 22:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/04/2022 23:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
Minimum:	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
Maximum:	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
06/05/2022 00:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/05/2022 01:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/05/2022 02:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/05/2022 03:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/05/2022 04:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/05/2022 05:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/05/2022 06:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/05/2022 07:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/05/2022 08:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/05/2022 09:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/05/2022 10:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/05/2022 11:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/05/2022 12:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/05/2022 13:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/05/2022 14:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/05/2022 15:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/05/2022 16:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/05/2022 17:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/05/2022 18:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/05/2022 19:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/05/2022 20:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/05/2022 21:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/05/2022 22:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/05/2022 23:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
Minimum:	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
Maximum:	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
06/06/2022 00:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/06/2022 01:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/06/2022 02:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/06/2022 03:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/06/2022 04:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/06/2022 05:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/06/2022 06:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/06/2022 07:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/06/2022 08:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/06/2022 09:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/06/2022 10:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/06/2022 11:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/06/2022 12:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/06/2022 13:00	1,901.0	0.0	1,901.0	105,000.0	199.6	0.00	0.0	0.0
06/06/2022 14:00	4,182.9	0.0	4,182.9	105,000.0	439.2	0.52	0.3	0.9
06/06/2022 15:00	4,434.5	0.0	4,434.5	105,000.0	465.6	0.56	0.3	0.9
06/06/2022 16:00	4,425.7	0.0	4,425.7	105,000.0	464.7	0.56	0.3	0.9
06/06/2022 17:00	4,421.6	0.0	4,421.6	105,000.0	464.3	0.56	0.3	0.9
06/06/2022 18:00	2,710.2	0.0	2,710.2	105,000.0	284.6	0.00	0.0	0.0
06/06/2022 19:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/06/2022 20:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/06/2022 21:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/06/2022 22:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/06/2022 23:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
Average/Sum#:	3,679.3	0.0	3,679.3	105,000.0	386.3	0.55	0.3	0.9
Minimum:	1,901.0	0.0	1,901.0	105,000.0	199.6	0.52	0.3	0.9
Maximum:	4,434.5	0.0	4,434.5	105,000.0	465.6	0.56	0.3	0.9
%SI	75.00	75.00	75.00	0.00	75.00	83.33	83.33	83.33

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
06/07/2022 00:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/07/2022 01:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/07/2022 02:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/07/2022 03:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/07/2022 04:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/07/2022 05:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/07/2022 06:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/07/2022 07:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/07/2022 08:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/07/2022 09:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/07/2022 10:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/07/2022 11:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/07/2022 12:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/07/2022 13:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/07/2022 14:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/07/2022 15:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/07/2022 16:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/07/2022 17:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/07/2022 18:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/07/2022 19:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/07/2022 20:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/07/2022 21:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/07/2022 22:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/07/2022 23:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
Minimum:	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
Maximum:	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
06/08/2022 00:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/08/2022 01:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/08/2022 02:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/08/2022 03:00	1,573.0	0.0	1,573.0	105,000.0	165.2	0.00	0.0	0.0
06/08/2022 04:00	4,442.2	0.0	4,442.2	105,000.0	466.4	0.57	0.3	1.0
06/08/2022 05:00	4,516.6	0.0	4,516.6	105,000.0	474.2	0.57	0.3	1.0
06/08/2022 06:00	4,500.7	0.0	4,500.7	105,000.0	472.6	0.57	0.3	0.9
06/08/2022 07:00	3,525.1	0.0	3,525.1	105,000.0	370.1	0.44	0.2	0.7
06/08/2022 08:00	3,422.4	0.0	3,422.4	105,000.0	359.4	0.43	0.2	0.7
06/08/2022 09:00	2,904.7	0.0	2,904.7	105,000.0	305.0	0.37	0.2	0.6
06/08/2022 10:00	2,863.0	0.0	2,863.0	105,000.0	300.6	0.36	0.2	0.6
06/08/2022 11:00	2,869.4	0.0	2,869.4	105,000.0	301.3	0.36	0.2	0.6
06/08/2022 12:00	3,022.8	0.0	3,022.8	105,000.0	317.4	0.38	0.2	0.6
06/08/2022 13:00	4,388.4	99.9	4,453.3	105,000.0	467.6	0.57	0.3	0.9
06/08/2022 14:00	4,246.1	271.9	4,441.9	105,000.0	466.4	0.57	0.3	0.9
06/08/2022 15:00	4,223.7	21.3	4,225.4	105,000.0	443.7	0.53	0.3	0.9
06/08/2022 16:00	4,251.1	57.8	4,268.4	105,000.0	448.2	0.54	0.3	0.9
06/08/2022 17:00	4,353.4	927.6	5,281.0	105,000.0	554.5	0.66	0.3	1.1
06/08/2022 18:00	4,368.4	1,955.6	6,324.0	105,000.0	664.0	0.80	0.4	1.3
06/08/2022 19:00	4,384.7	1,413.3	5,798.0	105,000.0	608.8	0.73	0.4	1.2
06/08/2022 20:00	4,391.7	720.6	5,112.3	105,000.0	536.8	0.64	0.3	1.1
06/08/2022 21:00	4,395.8	396.0	4,791.8	105,000.0	503.1	0.61	0.3	1.0
06/08/2022 22:00	4,412.2	318.1	4,730.3	105,000.0	496.7	0.60	0.3	1.0
06/08/2022 23:00	4,418.3	457.0	4,875.3	105,000.0	511.9	0.61	0.3	1.0
Average/Sum#:	3,879.7	316.1	4,187.7	105,000.0	439.7	0.55	0.3	0.9
Minimum:	1,573.0	0.0	1,573.0	105,000.0	165.2	0.36	0.2	0.6
Maximum:	4,516.6	1,955.6	6,324.0	105,000.0	664.0	0.80	0.4	1.3
%SI	12.50	12.50	12.50	0.00	12.50	16.67	16.67	16.67

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
06/09/2022 00:00	4,426.3	430.8	4,857.1	105,000.0	510.0	0.61	0.3	1.0
06/09/2022 01:00	4,437.7	357.9	4,795.6	105,000.0	503.5	0.60	0.3	1.0
06/09/2022 02:00	3,853.5	66.1	3,873.3	105,000.0	406.7	0.49	0.2	0.8
06/09/2022 03:00	4,452.4	120.4	4,564.4	105,000.0	479.3	0.58	0.3	1.0
06/09/2022 04:00	4,465.2	105.3	4,552.6	105,000.0	478.0	0.58	0.3	1.0
06/09/2022 05:00	3,222.9	0.0	3,222.9	105,000.0	338.4	0.41	0.2	0.7
06/09/2022 06:00	3,075.8	0.0	3,075.8	105,000.0	323.0	0.39	0.2	0.6
06/09/2022 07:00	2,861.1	0.0	2,861.1	105,000.0	300.4	0.36	0.2	0.6
06/09/2022 08:00	2,868.7	0.0	2,868.7	105,000.0	301.2	0.36	0.2	0.6
06/09/2022 09:00	3,050.5	0.0	3,050.5	105,000.0	320.3	0.38	0.2	0.6
06/09/2022 10:00	4,265.9	0.0	4,265.9	105,000.0	447.9	0.53	0.3	0.9
06/09/2022 11:00	2,859.4	0.0	2,859.4	105,000.0	300.2	0.36	0.2	0.6
06/09/2022 12:00	2,721.9	0.0	2,721.9	105,000.0	285.8	0.34	0.2	0.6
06/09/2022 13:00	3,673.7	0.0	3,673.7	105,000.0	385.7	0.46	0.2	0.8
06/09/2022 14:00	4,196.5	404.5	4,410.9	105,000.0	463.1	0.58	0.3	1.0
06/09/2022 15:00	4,349.7	785.9	5,135.6	105,000.0	539.2	0.65	0.3	1.1
06/09/2022 16:00	3,901.5	119.3	3,933.7	105,000.0	413.0	0.51	0.3	0.8
06/09/2022 17:00	4,325.6	838.7	4,979.8	105,000.0	522.9	0.65	0.3	1.1
06/09/2022 18:00	4,327.2	834.4	5,161.6	105,000.0	542.0	0.65	0.3	1.1
06/09/2022 19:00	4,336.9	507.9	4,844.8	105,000.0	508.7	0.61	0.3	1.0
06/09/2022 20:00	4,365.4	961.0	5,326.4	105,000.0	559.3	0.67	0.3	1.1
06/09/2022 21:00	4,364.5	684.8	5,049.3	105,000.0	530.2	0.64	0.3	1.1
06/09/2022 22:00	4,320.4	111.2	4,353.8	105,000.0	457.1	0.56	0.3	0.9
06/09/2022 23:00	4,374.7	568.2	4,942.9	105,000.0	519.0	0.62	0.3	1.0
Average/Sum#:	3,879.1	287.4	4,140.9	105,000.0	434.8	0.52	0.3	0.9
Minimum:	2,721.9	0.0	2,721.9	105,000.0	285.8	0.34	0.2	0.6
Maximum:	4,465.2	961.0	5,326.4	105,000.0	559.3	0.67	0.3	1.1
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
06/10/2022 00:00	4,379.2	373.0	4,752.2	105,000.0	499.0	0.60	0.3	1.0
06/10/2022 01:00	4,389.4	355.3	4,744.7	105,000.0	498.2	0.60	0.3	1.0
06/10/2022 02:00	4,408.2	326.2	4,734.4	105,000.0	497.1	0.60	0.3	1.0
06/10/2022 03:00	4,424.3	294.9	4,719.2	105,000.0	495.5	0.59	0.3	1.0
06/10/2022 04:00	4,437.2	280.3	4,717.5	105,000.0	495.3	0.59	0.3	1.0
06/10/2022 05:00	4,440.0	539.5	4,979.5	105,000.0	522.8	0.63	0.3	1.0
06/10/2022 06:00	4,367.5	169.1	4,469.0	105,000.0	469.2	0.57	0.3	1.0
06/10/2022 07:00	4,412.5	0.0	4,412.5	105,000.0	463.3	0.56	0.3	0.9
06/10/2022 08:00	4,390.5	0.0	4,390.5	105,000.0	461.0	0.55	0.3	0.9
06/10/2022 09:00	4,371.9	0.0	4,371.9	105,000.0	459.0	0.55	0.3	0.9
06/10/2022 10:00	4,369.2	111.4	4,438.3	105,000.0	466.0	0.56	0.3	0.9
06/10/2022 11:00	4,364.8	529.5	4,894.3	105,000.0	513.9	0.62	0.3	1.0
06/10/2022 12:00	4,351.6	858.4	5,210.0	105,000.0	547.1	0.66	0.3	1.1
06/10/2022 13:00	4,348.6	1,276.7	5,625.3	105,000.0	590.7	0.71	0.4	1.2
06/10/2022 14:00	4,335.9	1,722.2	6,058.1	105,000.0	636.1	0.76	0.4	1.3
06/10/2022 15:00	4,333.8	1,628.4	5,962.2	105,000.0	626.0	0.75	0.4	1.3
06/10/2022 16:00	4,325.8	898.0	5,223.8	105,000.0	548.5	0.66	0.3	1.1
06/10/2022 17:00	4,312.5	1,791.0	6,103.5	105,000.0	640.9	0.77	0.4	1.3
06/10/2022 18:00	4,298.8	1,782.5	6,081.3	105,000.0	638.5	0.77	0.4	1.3
06/10/2022 19:00	4,327.1	1,415.4	5,742.5	105,000.0	603.0	0.72	0.4	1.2
06/10/2022 20:00	4,356.1	947.6	5,303.7	105,000.0	556.9	0.67	0.3	1.1
06/10/2022 21:00	4,390.4	1,002.8	5,393.2	105,000.0	566.3	0.68	0.3	1.1
06/10/2022 22:00	4,396.0	191.6	4,495.6	105,000.0	472.0	0.58	0.3	1.0
06/10/2022 23:00	3,399.6	0.0	3,399.6	105,000.0	357.0	0.43	0.2	0.7
Average/Sum#:	4,330.5	687.2	5,009.3	105,000.0	526.0	0.63	0.3	1.1
Minimum:	3,399.6	0.0	3,399.6	105,000.0	357.0	0.43	0.2	0.7
Maximum:	4,440.0	1,791.0	6,103.5	105,000.0	640.9	0.77	0.4	1.3
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
06/11/2022 00:00	4,320.7	106.3	4,402.6	105,000.0	462.3	0.56	0.3	0.9
06/11/2022 01:00	2,864.8	0.0	2,864.8	105,000.0	300.8	0.36	0.2	0.6
06/11/2022 02:00	2,695.1	0.0	2,695.1	105,000.0	283.0	0.34	0.2	0.6
06/11/2022 03:00	2,696.9	0.0	2,696.9	105,000.0	283.2	0.34	0.2	0.6
06/11/2022 04:00	2,654.2	0.0	2,654.2	105,000.0	278.7	0.33	0.2	0.6
06/11/2022 05:00	2,658.0	0.0	2,658.0	105,000.0	279.1	0.34	0.2	0.6
06/11/2022 06:00	2,664.1	0.0	2,664.1	105,000.0	279.7	0.34	0.2	0.6
06/11/2022 07:00	2,667.8	0.0	2,667.8	105,000.0	280.1	0.34	0.2	0.6
06/11/2022 08:00	2,716.0	0.0	2,716.0	105,000.0	285.2	0.34	0.2	0.6
06/11/2022 09:00	2,766.4	0.0	2,766.4	105,000.0	290.5	0.35	0.2	0.6
06/11/2022 10:00	3,642.6	0.0	3,642.6	105,000.0	382.5	0.46	0.2	0.8
06/11/2022 11:00	3,857.5	0.0	3,857.5	105,000.0	405.0	0.49	0.2	0.8
06/11/2022 12:00	4,352.1	285.8	4,623.6	105,000.0	485.5	0.59	0.3	1.0
06/11/2022 13:00	4,337.5	1,158.3	5,495.8	105,000.0	577.1	0.69	0.3	1.2
06/11/2022 14:00	4,320.3	1,280.2	5,600.5	105,000.0	588.1	0.70	0.4	1.2
06/11/2022 15:00	4,301.8	1,228.8	5,530.6	105,000.0	580.7	0.70	0.3	1.2
06/11/2022 16:00	4,304.0	1,118.2	5,422.2	105,000.0	569.3	0.68	0.3	1.1
06/11/2022 17:00	4,296.9	1,520.9	5,817.8	105,000.0	610.9	0.73	0.4	1.2
06/11/2022 18:00	4,298.2	1,943.7	6,241.9	105,000.0	655.4	0.79	0.4	1.3
06/11/2022 19:00	4,309.0	1,879.6	6,188.6	105,000.0	649.8	0.78	0.4	1.3
06/11/2022 20:00	4,307.2	1,683.4	5,990.6	105,000.0	629.0	0.75	0.4	1.3
06/11/2022 21:00	4,337.5	1,645.8	5,983.3	105,000.0	628.2	0.75	0.4	1.3
06/11/2022 22:00	4,338.3	419.2	4,686.2	105,000.0	492.1	0.60	0.3	1.0
06/11/2022 23:00	4,016.4	70.9	4,043.3	105,000.0	424.5	0.51	0.3	0.9
Average/Sum#:	3,655.1	597.5	4,246.3	105,000.0	445.9	0.54	0.3	0.9
Minimum:	2,654.2	0.0	2,654.2	105,000.0	278.7	0.33	0.2	0.6
Maximum:	4,352.1	1,943.7	6,241.9	105,000.0	655.4	0.79	0.4	1.3
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
06/12/2022 00:00	4,369.3	787.4	5,156.7	105,000.0	541.5	0.65	0.3	1.1
06/12/2022 01:00	3,728.3	119.8	3,772.6	105,000.0	396.1	0.49	0.2	0.8
06/12/2022 02:00	4,316.6	23.5	4,321.3	105,000.0	453.7	0.54	0.3	0.9
06/12/2022 03:00	4,404.6	0.0	4,404.6	105,000.0	462.5	0.56	0.3	0.9
06/12/2022 04:00	4,407.9	0.0	4,407.9	105,000.0	462.8	0.56	0.3	0.9
06/12/2022 05:00	3,546.7	0.0	3,546.7	105,000.0	372.4	0.45	0.2	0.7
06/12/2022 06:00	2,848.9	0.0	2,848.9	105,000.0	299.1	0.36	0.2	0.6
06/12/2022 07:00	2,868.2	0.0	2,868.2	105,000.0	301.2	0.36	0.2	0.6
06/12/2022 08:00	2,864.0	0.0	2,864.0	105,000.0	300.7	0.36	0.2	0.6
06/12/2022 09:00	2,865.6	0.0	2,865.6	105,000.0	300.9	0.36	0.2	0.6
06/12/2022 10:00	2,872.1	0.0	2,872.1	105,000.0	301.6	0.36	0.2	0.6
06/12/2022 11:00	3,440.6	25.8	3,445.8	105,000.0	361.8	0.44	0.2	0.7
06/12/2022 12:00	4,013.1	82.0	4,060.7	105,000.0	426.4	0.52	0.3	0.9
06/12/2022 13:00	4,327.9	163.8	4,445.8	105,000.0	466.8	0.57	0.3	0.9
06/12/2022 14:00	4,374.0	188.8	4,562.8	105,000.0	479.1	0.58	0.3	1.0
06/12/2022 15:00	4,373.9	318.7	4,692.6	105,000.0	492.7	0.59	0.3	1.0
06/12/2022 16:00	4,385.4	442.7	4,828.1	105,000.0	507.0	0.61	0.3	1.0
06/12/2022 17:00	4,395.8	470.7	4,866.5	105,000.0	511.0	0.61	0.3	1.0
06/12/2022 18:00	4,407.8	501.6	4,909.4	105,000.0	515.5	0.62	0.3	1.0
06/12/2022 19:00	4,430.3	277.3	4,707.6	105,000.0	494.3	0.59	0.3	1.0
06/12/2022 20:00	4,457.3	268.4	4,725.7	105,000.0	496.2	0.60	0.3	1.0
06/12/2022 21:00	4,458.4	197.5	4,655.9	105,000.0	488.9	0.59	0.3	1.0
06/12/2022 22:00	4,465.4	181.3	4,646.7	105,000.0	487.9	0.59	0.3	1.0
06/12/2022 23:00	3,600.9	1.0	3,600.9	105,000.0	378.1	0.45	0.2	0.8
Average/Sum#:	3,926.0	168.8	4,086.5	105,000.0	429.1	0.52	0.3	0.9
Minimum:	2,848.9	0.0	2,848.9	105,000.0	299.1	0.36	0.2	0.6
Maximum:	4,465.4	787.4	5,156.7	105,000.0	541.5	0.65	0.3	1.1
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
06/13/2022 00:00	3,841.5	1.2	3,841.5	105,000.0	403.4	0.48	0.2	0.8
06/13/2022 01:00	4,133.6	0.0	4,133.6	105,000.0	434.0	0.52	0.3	0.9
06/13/2022 02:00	2,933.1	0.0	2,933.1	105,000.0	308.0	0.37	0.2	0.6
06/13/2022 03:00	2,857.4	0.0	2,857.4	105,000.0	300.0	0.36	0.2	0.6
06/13/2022 04:00	2,854.5	0.0	2,854.5	105,000.0	299.7	0.36	0.2	0.6
06/13/2022 05:00	2,859.7	0.0	2,859.7	105,000.0	300.3	0.36	0.2	0.6
06/13/2022 06:00	2,847.5	0.0	2,847.5	105,000.0	299.0	0.36	0.2	0.6
06/13/2022 07:00	2,857.4	0.0	2,857.4	105,000.0	300.0	0.36	0.2	0.6
06/13/2022 08:00	2,853.1	0.0	2,853.1	105,000.0	299.6	0.36	0.2	0.6
06/13/2022 09:00	2,855.5	0.0	2,855.5	105,000.0	299.8	0.36	0.2	0.6
06/13/2022 10:00	2,847.4	0.0	2,847.4	105,000.0	299.0	0.36	0.2	0.6
06/13/2022 11:00	2,868.1	0.0	2,868.1	105,000.0	301.2	0.36	0.2	0.6
06/13/2022 12:00	2,875.6	0.0	2,875.6	105,000.0	301.9	0.36	0.2	0.6
06/13/2022 13:00	2,870.9	0.0	2,870.9	105,000.0	301.4	0.36	0.2	0.6
06/13/2022 14:00	2,875.3	0.0	2,875.3	105,000.0	301.9	0.36	0.2	0.6
06/13/2022 15:00	2,861.8	0.0	2,861.8	105,000.0	300.5	0.36	0.2	0.6
06/13/2022 16:00	3,176.5	0.0	3,176.5	105,000.0	333.5	0.40	0.2	0.7
06/13/2022 17:00	3,441.9	19.5	3,445.2	105,000.0	361.7	0.44	0.2	0.7
06/13/2022 18:00	3,632.0	47.8	3,650.2	105,000.0	383.3	0.46	0.2	0.8
06/13/2022 19:00	3,953.5	93.0	3,997.2	105,000.0	419.7	0.51	0.3	0.8
06/13/2022 20:00	4,481.0	124.6	4,576.9	105,000.0	480.6	0.58	0.3	1.0
06/13/2022 21:00	3,188.9	0.0	3,188.9	105,000.0	334.8	0.40	0.2	0.7
06/13/2022 22:00	2,858.1	0.0	2,858.1	105,000.0	300.1	0.36	0.2	0.6
06/13/2022 23:00	2,858.7	0.0	2,858.7	105,000.0	300.2	0.36	0.2	0.6
Average/Sum#:	3,153.5	11.9	3,160.2	105,000.0	331.8	0.40	0.2	0.7
Minimum:	2,847.4	0.0	2,847.4	105,000.0	299.0	0.36	0.2	0.6
Maximum:	4,481.0	124.6	4,576.9	105,000.0	480.6	0.58	0.3	1.0
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
06/14/2022 00:00	2,853.5	0.0	2,853.5	105,000.0	299.6	0.36	0.2	0.6
06/14/2022 01:00	2,849.8	0.0	2,849.8	105,000.0	299.2	0.36	0.2	0.6
06/14/2022 02:00	2,852.6	0.0	2,852.6	105,000.0	299.5	0.36	0.2	0.6
06/14/2022 03:00	2,853.7	0.0	2,853.7	105,000.0	299.6	0.36	0.2	0.6
06/14/2022 04:00	2,856.4	0.0	2,856.4	105,000.0	299.9	0.36	0.2	0.6
06/14/2022 05:00	3,374.5	1.9	3,374.5	105,000.0	354.3	0.43	0.2	0.7
06/14/2022 06:00	2,859.3	0.0	2,859.3	105,000.0	300.2	0.36	0.2	0.6
06/14/2022 07:00	2,862.8	0.0	2,862.8	105,000.0	300.6	0.36	0.2	0.6
06/14/2022 08:00	2,850.1	0.0	2,850.1	105,000.0	299.3	0.36	0.2	0.6
06/14/2022 09:00	2,849.7	0.0	2,849.7	105,000.0	299.2	0.36	0.2	0.6
06/14/2022 10:00	2,857.9	0.0	2,857.9	105,000.0	300.1	0.36	0.2	0.6
06/14/2022 11:00	2,875.7	0.0	2,875.7	105,000.0	301.9	0.36	0.2	0.6
06/14/2022 12:00	2,880.2	0.0	2,880.2	105,000.0	302.4	0.36	0.2	0.6
06/14/2022 13:00	2,887.8	0.0	2,887.8	105,000.0	303.2	0.36	0.2	0.6
06/14/2022 14:00	2,886.7	0.0	2,886.7	105,000.0	303.1	0.36	0.2	0.6
06/14/2022 15:00	2,883.0	0.0	2,883.0	105,000.0	302.7	0.36	0.2	0.6
06/14/2022 16:00	2,884.2	0.0	2,884.2	105,000.0	302.8	0.36	0.2	0.6
06/14/2022 17:00	3,577.0	0.0	3,577.0	105,000.0	375.6	0.45	0.2	0.8
06/14/2022 18:00	3,241.8	0.0	3,241.8	105,000.0	340.4	0.41	0.2	0.7
06/14/2022 19:00	4,285.9	257.7	4,422.5	105,000.0	464.4	0.57	0.3	1.0
06/14/2022 20:00	4,393.0	277.3	4,606.5	105,000.0	483.7	0.59	0.3	1.0
06/14/2022 21:00	3,909.2	0.0	3,909.2	105,000.0	410.5	0.49	0.2	0.8
06/14/2022 22:00	4,330.8	98.0	4,382.7	105,000.0	460.2	0.56	0.3	0.9
06/14/2022 23:00	4,474.1	286.0	4,760.1	105,000.0	499.8	0.60	0.3	1.0
Average/Sum#:	3,226.2	38.4	3,254.9	105,000.0	341.8	0.41	0.2	0.7
Minimum:	2,849.7	0.0	2,849.7	105,000.0	299.2	0.36	0.2	0.6
Maximum:	4,474.1	286.0	4,760.1	105,000.0	499.8	0.60	0.3	1.0
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
06/15/2022 00:00	4,472.1	300.2	4,772.3	105,000.0	501.1	0.60	0.3	1.0
06/15/2022 01:00	4,487.6	213.5	4,701.1	105,000.0	493.6	0.59	0.3	1.0
06/15/2022 02:00	4,240.7	30.4	4,247.7	105,000.0	446.0	0.54	0.3	0.9
06/15/2022 03:00	4,504.0	274.8	4,778.8	105,000.0	501.8	0.60	0.3	1.0
06/15/2022 04:00	4,521.2	936.4	5,457.6	105,000.0	573.0	0.69	0.3	1.1
06/15/2022 05:00	4,162.7	133.3	4,232.0	105,000.0	444.4	0.54	0.3	0.9
06/15/2022 06:00	3,195.6	0.0	3,195.6	105,000.0	335.5	0.40	0.2	0.7
06/15/2022 07:00	3,363.8	0.0	3,363.8	105,000.0	353.2	0.42	0.2	0.7
06/15/2022 08:00	2,662.4	0.0	2,662.4	105,000.0	279.6	0.33	0.2	0.6
06/15/2022 09:00	2,665.1	0.0	2,665.1	105,000.0	279.8	0.34	0.2	0.6
06/15/2022 10:00	2,692.0	0.0	2,692.0	105,000.0	282.7	0.34	0.2	0.6
06/15/2022 11:00	2,951.2	0.0	2,951.2	105,000.0	309.9	0.37	0.2	0.6
06/15/2022 12:00	4,118.7	0.0	4,118.7	105,000.0	432.5	0.52	0.3	0.9
06/15/2022 13:00	4,362.5	0.0	4,362.5	105,000.0	458.1	0.55	0.3	0.9
06/15/2022 14:00	4,393.9	450.0	4,744.9	105,000.0	498.2	0.61	0.3	1.0
06/15/2022 15:00	4,378.8	854.8	5,233.6	105,000.0	549.5	0.66	0.3	1.1
06/15/2022 16:00	4,393.6	656.4	5,050.0	105,000.0	530.3	0.64	0.3	1.1
06/15/2022 17:00	4,401.6	621.9	5,023.5	105,000.0	527.5	0.63	0.3	1.1
06/15/2022 18:00	4,410.1	433.0	4,843.1	105,000.0	508.5	0.61	0.3	1.0
06/15/2022 19:00	4,420.8	299.9	4,720.7	105,000.0	495.7	0.59	0.3	1.0
06/15/2022 20:00	4,437.6	247.8	4,685.4	105,000.0	492.0	0.59	0.3	1.0
06/15/2022 21:00	4,455.8	225.7	4,681.5	105,000.0	491.6	0.59	0.3	1.0
06/15/2022 22:00	4,466.0	197.6	4,663.6	105,000.0	489.7	0.59	0.3	1.0
06/15/2022 23:00	4,473.2	173.3	4,646.5	105,000.0	487.9	0.59	0.3	1.0
Average/Sum#:	4,026.3	252.0	4,270.6	105,000.0	448.4	0.54	0.3	0.9
Minimum:	2,662.4	0.0	2,662.4	105,000.0	279.6	0.33	0.2	0.6
Maximum:	4,521.2	936.4	5,457.6	105,000.0	573.0	0.69	0.3	1.1
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
06/16/2022 00:00	4,477.4	161.0	4,638.4	105,000.0	487.0	0.59	0.3	1.0
06/16/2022 01:00	4,483.2	152.6	4,635.8	105,000.0	486.8	0.58	0.3	1.0
06/16/2022 02:00	4,493.7	134.3	4,628.0	105,000.0	485.9	0.58	0.3	1.0
06/16/2022 03:00	4,496.9	132.3	4,629.2	105,000.0	486.1	0.58	0.3	1.0
06/16/2022 04:00	4,499.6	131.7	4,631.3	105,000.0	486.3	0.58	0.3	1.0
06/16/2022 05:00	3,689.1	34.3	3,698.4	105,000.0	388.3	0.47	0.2	0.8
06/16/2022 06:00	2,686.1	0.0	2,686.1	105,000.0	282.0	0.34	0.2	0.6
06/16/2022 07:00	2,697.0	0.0	2,697.0	105,000.0	283.2	0.34	0.2	0.6
06/16/2022 08:00	2,689.9	0.0	2,689.9	105,000.0	282.4	0.34	0.2	0.6
06/16/2022 09:00	2,669.7	0.0	2,669.7	105,000.0	280.3	0.34	0.2	0.6
06/16/2022 10:00	2,663.4	0.0	2,663.4	105,000.0	279.7	0.34	0.2	0.6
06/16/2022 11:00	3,060.6	12.0	3,061.4	105,000.0	321.4	0.39	0.2	0.6
06/16/2022 12:00	4,430.5	366.4	4,796.9	105,000.0	503.7	0.60	0.3	1.0
06/16/2022 13:00	4,434.7	822.1	5,256.8	105,000.0	552.0	0.66	0.3	1.1
06/16/2022 14:00	4,439.6	322.2	4,761.8	105,000.0	500.0	0.60	0.3	1.0
06/16/2022 15:00	4,433.0	336.2	4,769.2	105,000.0	500.8	0.60	0.3	1.0
06/16/2022 16:00	4,449.0	307.7	4,756.7	105,000.0	499.5	0.60	0.3	1.0
06/16/2022 17:00	4,272.6	87.2	4,305.7	105,000.0	452.1	0.55	0.3	0.9
06/16/2022 18:00	4,457.5	259.6	4,717.1	105,000.0	495.3	0.59	0.3	1.0
06/16/2022 19:00	4,479.4	144.5	4,590.7	105,000.0	482.0	0.58	0.3	1.0
06/16/2022 20:00	4,466.0	68.8	4,499.0	105,000.0	472.4	0.57	0.3	1.0
06/16/2022 21:00	4,500.7	144.0	4,644.7	105,000.0	487.7	0.59	0.3	1.0
06/16/2022 22:00	4,493.8	142.2	4,636.0	105,000.0	486.8	0.58	0.3	1.0
06/16/2022 23:00	4,497.9	136.5	4,634.4	105,000.0	486.6	0.58	0.3	1.0
Average/Sum#:	3,998.4	162.3	4,154.1	105,000.0	436.2	0.52	0.3	0.9
Minimum:	2,663.4	0.0	2,663.4	105,000.0	279.7	0.34	0.2	0.6
Maximum:	4,500.7	822.1	5,256.8	105,000.0	552.0	0.66	0.3	1.1
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
06/17/2022 00:00	4,506.6	130.8	4,637.4	105,000.0	486.9	0.58	0.3	1.0
06/17/2022 01:00	4,511.6	129.4	4,641.0	105,000.0	487.3	0.59	0.3	1.0
06/17/2022 02:00	4,516.1	129.3	4,645.4	105,000.0	487.8	0.59	0.3	1.0
06/17/2022 03:00	4,518.6	129.4	4,648.0	105,000.0	488.0	0.59	0.3	1.0
06/17/2022 04:00	4,523.9	388.6	4,912.5	105,000.0	515.8	0.62	0.3	1.0
06/17/2022 05:00	4,482.8	185.7	4,579.4	105,000.0	480.8	0.59	0.3	1.0
06/17/2022 06:00	3,203.1	0.0	3,203.1	105,000.0	336.3	0.40	0.2	0.7
06/17/2022 07:00	2,958.9	0.0	2,958.9	105,000.0	310.7	0.37	0.2	0.6
06/17/2022 08:00	2,706.4	0.0	2,706.4	105,000.0	284.2	0.34	0.2	0.6
06/17/2022 09:00	2,788.1	0.0	2,788.1	105,000.0	292.8	0.35	0.2	0.6
06/17/2022 10:00	2,827.8	0.0	2,827.8	105,000.0	296.9	0.36	0.2	0.6
06/17/2022 11:00	2,706.2	0.0	2,706.2	105,000.0	284.2	0.34	0.2	0.6
06/17/2022 12:00	2,690.2	0.0	2,690.2	105,000.0	282.5	0.34	0.2	0.6
06/17/2022 13:00	2,401.1	0.0	2,401.1	105,000.0	252.1	0.34	0.2	0.6
06/17/2022 14:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/17/2022 15:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/17/2022 16:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/17/2022 17:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/17/2022 18:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/17/2022 19:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/17/2022 20:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/17/2022 21:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/17/2022 22:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/17/2022 23:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
Average/Sum#:	3,524.4	78.1	3,596.1	105,000.0	377.6	0.46	0.2	0.8
Minimum:	2,401.1	0.0	2,401.1	105,000.0	252.1	0.34	0.2	0.6
Maximum:	4,523.9	388.6	4,912.5	105,000.0	515.8	0.62	0.3	1.0
%SI	41.67	41.67	41.67	0.00	41.67	41.67	41.67	41.67

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
06/18/2022 00:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/18/2022 01:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/18/2022 02:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/18/2022 03:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/18/2022 04:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/18/2022 05:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/18/2022 06:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/18/2022 07:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/18/2022 08:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/18/2022 09:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/18/2022 10:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/18/2022 11:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/18/2022 12:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/18/2022 13:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/18/2022 14:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/18/2022 15:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/18/2022 16:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/18/2022 17:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/18/2022 18:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/18/2022 19:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/18/2022 20:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/18/2022 21:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/18/2022 22:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/18/2022 23:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
Minimum:	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
Maximum:	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
06/19/2022 00:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/19/2022 01:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/19/2022 02:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/19/2022 03:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/19/2022 04:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/19/2022 05:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/19/2022 06:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/19/2022 07:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/19/2022 08:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/19/2022 09:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/19/2022 10:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/19/2022 11:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/19/2022 12:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/19/2022 13:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/19/2022 14:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/19/2022 15:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/19/2022 16:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/19/2022 17:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/19/2022 18:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/19/2022 19:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/19/2022 20:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/19/2022 21:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/19/2022 22:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/19/2022 23:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
Minimum:	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
Maximum:	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
06/20/2022 00:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/20/2022 01:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/20/2022 02:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/20/2022 03:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/20/2022 04:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/20/2022 05:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/20/2022 06:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/20/2022 07:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/20/2022 08:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/20/2022 09:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/20/2022 10:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/20/2022 11:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/20/2022 12:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/20/2022 13:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/20/2022 14:00	2,474.7	0.0	2,474.7	105,000.0	259.8	0.00	0.0	0.0
06/20/2022 15:00	3,915.8	565.8	4,227.0	105,000.0	443.8	0.62	0.3	1.0
06/20/2022 16:00	4,041.3	1,568.5	5,609.8	105,000.0	589.0	0.71	0.4	1.2
06/20/2022 17:00	4,036.5	764.8	4,801.3	105,000.0	504.1	0.60	0.3	1.0
06/20/2022 18:00	4,040.7	802.3	4,843.0	105,000.0	508.5	0.61	0.3	1.0
06/20/2022 19:00	4,139.2	597.2	4,736.4	105,000.0	497.3	0.60	0.3	1.0
06/20/2022 20:00	4,207.1	481.2	4,688.3	105,000.0	492.3	0.59	0.3	1.0
06/20/2022 21:00	4,262.3	433.2	4,695.5	105,000.0	493.0	0.59	0.3	1.0
06/20/2022 22:00	3,780.8	34.7	3,785.3	105,000.0	397.5	0.48	0.2	0.8
06/20/2022 23:00	3,095.0	0.0	3,095.0	105,000.0	325.0	0.39	0.2	0.7
Average/Sum#:	3,799.3	524.8	4,295.6	105,000.0	451.0	0.58	0.3	1.0
Minimum:	2,474.7	0.0	2,474.7	105,000.0	259.8	0.39	0.2	0.7
Maximum:	4,262.3	1,568.5	5,609.8	105,000.0	589.0	0.71	0.4	1.2
%SI	58.33	58.33	58.33	0.00	58.33	62.50	62.50	62.50

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
06/21/2022 00:00	2,827.0	0.0	2,827.0	105,000.0	296.8	0.36	0.2	0.6
06/21/2022 01:00	2,815.7	0.0	2,815.7	105,000.0	295.6	0.35	0.2	0.6
06/21/2022 02:00	2,825.5	0.0	2,825.5	105,000.0	296.7	0.36	0.2	0.6
06/21/2022 03:00	2,841.0	0.0	2,841.0	105,000.0	298.3	0.36	0.2	0.6
06/21/2022 04:00	2,858.1	0.0	2,858.1	105,000.0	300.1	0.36	0.2	0.6
06/21/2022 05:00	3,089.2	0.0	3,089.2	105,000.0	324.4	0.39	0.2	0.6
06/21/2022 06:00	2,864.2	0.0	2,864.2	105,000.0	300.7	0.36	0.2	0.6
06/21/2022 07:00	2,865.9	0.0	2,865.9	105,000.0	300.9	0.36	0.2	0.6
06/21/2022 08:00	2,851.7	0.0	2,851.7	105,000.0	299.4	0.36	0.2	0.6
06/21/2022 09:00	2,844.2	0.0	2,844.2	105,000.0	298.6	0.36	0.2	0.6
06/21/2022 10:00	2,845.0	0.0	2,845.0	105,000.0	298.7	0.36	0.2	0.6
06/21/2022 11:00	2,877.9	0.0	2,877.9	105,000.0	302.2	0.36	0.2	0.6
06/21/2022 12:00	2,885.8	0.0	2,885.8	105,000.0	303.0	0.36	0.2	0.6
06/21/2022 13:00	2,889.7	0.0	2,889.7	105,000.0	303.4	0.36	0.2	0.6
06/21/2022 14:00	2,944.2	0.0	2,944.2	105,000.0	309.1	0.37	0.2	0.6
06/21/2022 15:00	3,046.6	0.0	3,046.6	105,000.0	319.9	0.38	0.2	0.6
06/21/2022 16:00	2,891.1	0.0	2,891.1	105,000.0	303.6	0.37	0.2	0.6
06/21/2022 17:00	3,017.6	0.0	3,017.6	105,000.0	316.8	0.38	0.2	0.6
06/21/2022 18:00	3,289.9	25.7	3,294.3	105,000.0	345.9	0.42	0.2	0.7
06/21/2022 19:00	4,187.4	156.7	4,301.8	105,000.0	451.7	0.55	0.3	0.9
06/21/2022 20:00	4,354.2	657.3	5,011.5	105,000.0	526.2	0.63	0.3	1.1
06/21/2022 21:00	4,373.0	803.3	5,176.3	105,000.0	543.5	0.65	0.3	1.1
06/21/2022 22:00	4,387.5	380.9	4,768.4	105,000.0	500.7	0.60	0.3	1.0
06/21/2022 23:00	4,402.0	345.3	4,747.3	105,000.0	498.5	0.60	0.3	1.0
Average/Sum#:	3,211.4	98.7	3,307.5	105,000.0	347.3	0.42	0.2	0.7
Minimum:	2,815.7	0.0	2,815.7	105,000.0	295.6	0.35	0.2	0.6
Maximum:	4,402.0	803.3	5,176.3	105,000.0	543.5	0.65	0.3	1.1
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
06/22/2022 00:00	4,433.4	291.9	4,725.3	105,000.0	496.2	0.60	0.3	1.0
06/22/2022 01:00	4,433.4	289.8	4,723.2	105,000.0	495.9	0.60	0.3	1.0
06/22/2022 02:00	4,260.9	57.7	4,276.5	105,000.0	449.0	0.54	0.3	0.9
06/22/2022 03:00	4,454.8	215.3	4,663.6	105,000.0	489.7	0.59	0.3	1.0
06/22/2022 04:00	4,458.9	74.5	4,485.0	105,000.0	470.9	0.57	0.3	1.0
06/22/2022 05:00	3,454.8	0.0	3,454.8	105,000.0	362.8	0.43	0.2	0.7
06/22/2022 06:00	2,649.6	0.0	2,649.6	105,000.0	278.2	0.33	0.2	0.6
06/22/2022 07:00	2,651.2	0.0	2,651.2	105,000.0	278.4	0.33	0.2	0.6
06/22/2022 08:00	2,653.0	0.0	2,653.0	105,000.0	278.6	0.33	0.2	0.6
06/22/2022 09:00	2,650.8	0.0	2,650.8	105,000.0	278.3	0.33	0.2	0.6
06/22/2022 10:00	2,653.4	0.0	2,653.4	105,000.0	278.6	0.33	0.2	0.6
06/22/2022 11:00	2,669.1	0.0	2,669.1	105,000.0	280.3	0.34	0.2	0.6
06/22/2022 12:00	2,674.4	0.0	2,674.4	105,000.0	280.8	0.34	0.2	0.6
06/22/2022 13:00	2,851.8	0.0	2,851.8	105,000.0	299.4	0.36	0.2	0.6
06/22/2022 14:00	2,976.4	0.0	2,976.4	105,000.0	312.5	0.38	0.2	0.6
06/22/2022 15:00	2,800.6	0.0	2,800.6	105,000.0	294.1	0.35	0.2	0.6
06/22/2022 16:00	2,659.7	0.0	2,659.7	105,000.0	279.3	0.34	0.2	0.6
06/22/2022 17:00	2,653.6	0.0	2,653.6	105,000.0	278.6	0.33	0.2	0.6
06/22/2022 18:00	2,651.1	0.0	2,651.1	105,000.0	278.4	0.33	0.2	0.6
06/22/2022 19:00	2,662.0	0.0	2,662.0	105,000.0	279.5	0.33	0.2	0.6
06/22/2022 20:00	3,590.6	0.0	3,590.6	105,000.0	377.0	0.45	0.2	0.8
06/22/2022 21:00	4,155.5	83.1	4,188.7	105,000.0	439.8	0.53	0.3	0.9
06/22/2022 22:00	4,274.1	0.0	4,274.1	105,000.0	448.8	0.54	0.3	0.9
06/22/2022 23:00	4,385.9	347.4	4,698.6	105,000.0	493.4	0.60	0.3	1.0
Average/Sum#:	3,323.3	56.7	3,372.4	105,000.0	354.1	0.43	0.2	0.7
Minimum:	2,649.6	0.0	2,649.6	105,000.0	278.2	0.33	0.2	0.6
Maximum:	4,458.9	347.4	4,725.3	105,000.0	496.2	0.60	0.3	1.0
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
06/23/2022 00:00	4,413.2	449.5	4,862.7	105,000.0	510.6	0.61	0.3	1.0
06/23/2022 01:00	4,040.7	153.4	4,122.0	105,000.0	432.8	0.53	0.3	0.9
06/23/2022 02:00	3,129.1	0.0	3,129.1	105,000.0	328.6	0.39	0.2	0.7
06/23/2022 03:00	2,894.6	0.0	2,894.6	105,000.0	303.9	0.36	0.2	0.6
06/23/2022 04:00	3,578.2	10.4	3,579.2	105,000.0	375.8	0.45	0.2	0.8
06/23/2022 05:00	3,936.3	67.4	3,973.4	105,000.0	417.2	0.50	0.3	0.8
06/23/2022 06:00	4,424.0	120.9	4,544.9	105,000.0	477.2	0.57	0.3	1.0
06/23/2022 07:00	4,414.0	117.9	4,531.9	105,000.0	475.8	0.57	0.3	1.0
06/23/2022 08:00	4,392.5	115.3	4,507.8	105,000.0	473.3	0.57	0.3	0.9
06/23/2022 09:00	4,375.5	120.2	4,495.7	105,000.0	472.0	0.57	0.3	0.9
06/23/2022 10:00	4,299.4	85.6	4,359.3	105,000.0	457.7	0.55	0.3	0.9
06/23/2022 11:00	2,869.9	0.0	2,869.9	105,000.0	301.3	0.36	0.2	0.6
06/23/2022 12:00	2,794.4	0.0	2,794.4	105,000.0	293.4	0.35	0.2	0.6
06/23/2022 13:00	2,790.7	0.0	2,790.7	105,000.0	293.0	0.35	0.2	0.6
06/23/2022 14:00	2,786.1	0.0	2,786.1	105,000.0	292.5	0.35	0.2	0.6
06/23/2022 15:00	3,235.6	0.0	3,235.6	105,000.0	339.7	0.41	0.2	0.7
06/23/2022 16:00	3,171.1	0.0	3,171.1	105,000.0	333.0	0.40	0.2	0.7
06/23/2022 17:00	4,037.1	354.2	4,260.2	105,000.0	447.3	0.55	0.3	0.9
06/23/2022 18:00	4,332.5	1,182.3	5,514.8	105,000.0	579.1	0.70	0.3	1.2
06/23/2022 19:00	4,345.5	1,551.3	5,896.8	105,000.0	619.2	0.74	0.4	1.2
06/23/2022 20:00	4,374.8	1,364.3	5,739.1	105,000.0	602.6	0.72	0.4	1.2
06/23/2022 21:00	4,383.8	616.9	5,000.7	105,000.0	525.1	0.63	0.3	1.1
06/23/2022 22:00	4,367.2	374.9	4,742.1	105,000.0	497.9	0.60	0.3	1.0
06/23/2022 23:00	4,393.6	339.1	4,732.7	105,000.0	496.9	0.60	0.3	1.0
Average/Sum#:	3,824.2	292.7	4,105.6	105,000.0	431.1	0.52	0.3	0.9
Minimum:	2,786.1	0.0	2,786.1	105,000.0	292.5	0.35	0.2	0.6
Maximum:	4,424.0	1,551.3	5,896.8	105,000.0	619.2	0.74	0.4	1.2
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
06/24/2022 00:00	4,407.8	323.1	4,730.9	105,000.0	496.7	0.60	0.3	1.0
06/24/2022 01:00	4,413.7	304.1	4,717.8	105,000.0	495.4	0.59	0.3	1.0
06/24/2022 02:00	4,383.5	211.5	4,548.5	105,000.0	477.6	0.58	0.3	1.0
06/24/2022 03:00	3,336.7	5.8	3,336.9	105,000.0	350.4	0.42	0.2	0.7
06/24/2022 04:00	4,441.4	262.4	4,703.8	105,000.0	493.9	0.59	0.3	1.0
06/24/2022 05:00	3,600.5	54.1	3,615.1	105,000.0	379.6	0.46	0.2	0.8
06/24/2022 06:00	2,690.2	0.0	2,690.2	105,000.0	282.5	0.34	0.2	0.6
06/24/2022 07:00	2,678.2	0.0	2,678.2	105,000.0	281.2	0.34	0.2	0.6
06/24/2022 08:00	2,672.2	0.0	2,672.2	105,000.0	280.6	0.34	0.2	0.6
06/24/2022 09:00	2,681.2	0.0	2,681.2	105,000.0	281.5	0.34	0.2	0.6
06/24/2022 10:00	3,141.3	0.0	3,141.3	105,000.0	329.8	0.40	0.2	0.7
06/24/2022 11:00	3,929.5	15.6	3,931.1	105,000.0	412.8	0.50	0.2	0.8
06/24/2022 12:00	4,338.9	75.5	4,370.6	105,000.0	458.9	0.56	0.3	0.9
06/24/2022 13:00	4,248.8	137.3	4,287.2	105,000.0	450.2	0.55	0.3	0.9
06/24/2022 14:00	4,358.3	1,066.1	5,424.4	105,000.0	569.6	0.68	0.3	1.1
06/24/2022 15:00	4,357.5	1,021.9	5,379.4	105,000.0	564.8	0.68	0.3	1.1
06/24/2022 16:00	4,360.1	1,053.4	5,413.5	105,000.0	568.4	0.68	0.3	1.1
06/24/2022 17:00	4,356.7	1,717.7	6,074.4	105,000.0	637.8	0.77	0.4	1.3
06/24/2022 18:00	4,360.9	1,272.2	5,633.1	105,000.0	591.5	0.71	0.4	1.2
06/24/2022 19:00	4,360.5	1,328.8	5,689.3	105,000.0	597.4	0.72	0.4	1.2
06/24/2022 20:00	4,355.8	647.8	5,003.6	105,000.0	525.4	0.63	0.3	1.1
06/24/2022 21:00	4,346.5	467.1	4,813.6	105,000.0	505.4	0.61	0.3	1.0
06/24/2022 22:00	4,359.9	629.7	4,989.6	105,000.0	523.9	0.63	0.3	1.0
06/24/2022 23:00	4,378.9	362.8	4,741.7	105,000.0	497.9	0.60	0.3	1.0
Average/Sum#:	3,940.0	456.5	4,386.2	105,000.0	460.6	0.56	0.3	0.9
Minimum:	2,672.2	0.0	2,672.2	105,000.0	280.6	0.34	0.2	0.6
Maximum:	4,441.4	1,717.7	6,074.4	105,000.0	637.8	0.77	0.4	1.3
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
06/25/2022 00:00	4,336.0	78.7	4,362.0	105,000.0	458.0	0.56	0.3	0.9
06/25/2022 01:00	4,426.0	1,061.5	5,487.5	105,000.0	576.2	0.69	0.3	1.2
06/25/2022 02:00	4,428.5	110.5	4,458.3	105,000.0	468.1	0.57	0.3	1.0
06/25/2022 03:00	4,439.0	0.0	4,439.0	105,000.0	466.1	0.56	0.3	0.9
06/25/2022 04:00	4,331.6	0.0	4,331.6	105,000.0	454.8	0.55	0.3	0.9
06/25/2022 05:00	3,619.9	0.0	3,619.9	105,000.0	380.1	0.46	0.2	0.8
06/25/2022 06:00	2,679.9	0.0	2,679.9	105,000.0	281.4	0.34	0.2	0.6
06/25/2022 07:00	2,648.6	0.0	2,648.6	105,000.0	278.1	0.33	0.2	0.6
06/25/2022 08:00	2,647.0	0.0	2,647.0	105,000.0	277.9	0.33	0.2	0.6
06/25/2022 09:00	2,651.6	0.0	2,651.6	105,000.0	278.4	0.33	0.2	0.6
06/25/2022 10:00	2,652.9	0.0	2,652.9	105,000.0	278.6	0.33	0.2	0.6
06/25/2022 11:00	2,670.7	0.0	2,670.7	105,000.0	280.4	0.34	0.2	0.6
06/25/2022 12:00	2,768.8	0.0	2,768.8	105,000.0	290.7	0.35	0.2	0.6
06/25/2022 13:00	2,698.0	0.0	2,698.0	105,000.0	283.3	0.34	0.2	0.6
06/25/2022 14:00	2,766.7	0.0	2,766.7	105,000.0	290.5	0.35	0.2	0.6
06/25/2022 15:00	2,732.6	0.0	2,732.6	105,000.0	286.9	0.34	0.2	0.6
06/25/2022 16:00	2,904.3	0.0	2,904.3	105,000.0	305.0	0.37	0.2	0.6
06/25/2022 17:00	4,349.1	616.5	4,891.6	105,000.0	513.6	0.63	0.3	1.0
06/25/2022 18:00	4,375.8	1,006.1	5,381.9	105,000.0	565.1	0.68	0.3	1.1
06/25/2022 19:00	4,385.6	590.9	4,976.5	105,000.0	522.5	0.63	0.3	1.0
06/25/2022 20:00	4,396.7	559.8	4,956.5	105,000.0	520.4	0.62	0.3	1.0
06/25/2022 21:00	3,704.9	83.4	3,729.0	105,000.0	391.5	0.51	0.3	0.9
06/25/2022 22:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/25/2022 23:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
Average/Sum#:	3,482.5	186.7	3,657.0	105,000.0	384.0	0.46	0.2	0.8
Minimum:	2,647.0	0.0	2,647.0	105,000.0	277.9	0.33	0.2	0.6
Maximum:	4,439.0	1,061.5	5,487.5	105,000.0	576.2	0.69	0.3	1.2
%SI	8.33	8.33	8.33	0.00	8.33	8.33	8.33	8.33

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
06/26/2022 00:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/26/2022 01:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/26/2022 02:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/26/2022 03:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/26/2022 04:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/26/2022 05:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/26/2022 06:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/26/2022 07:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/26/2022 08:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/26/2022 09:00	0.0	0.0	0.0	105,000.0	0.0	0.00	0.0	0.0
06/26/2022 10:00	2,503.2	0.0	2,503.2	105,000.0	262.8	0.00	0.0	0.0
06/26/2022 11:00	2,672.9	0.0	2,672.9	105,000.0	280.7	0.34	0.2	0.6
06/26/2022 12:00	2,675.4	0.0	2,675.4	105,000.0	280.9	0.34	0.2	0.6
06/26/2022 13:00	2,721.3	0.0	2,721.3	105,000.0	285.7	0.34	0.2	0.6
06/26/2022 14:00	2,693.7	0.0	2,693.7	105,000.0	282.8	0.34	0.2	0.6
06/26/2022 15:00	2,741.5	0.0	2,741.5	105,000.0	287.9	0.35	0.2	0.6
06/26/2022 16:00	3,742.3	226.0	3,832.7	105,000.0	402.4	0.50	0.3	0.8
06/26/2022 17:00	4,379.4	579.9	4,959.3	105,000.0	520.7	0.63	0.3	1.0
06/26/2022 18:00	4,378.6	1,530.0	5,908.6	105,000.0	620.4	0.74	0.4	1.2
06/26/2022 19:00	4,397.3	523.3	4,920.6	105,000.0	516.7	0.62	0.3	1.0
06/26/2022 20:00	4,409.3	336.3	4,745.6	105,000.0	498.3	0.60	0.3	1.0
06/26/2022 21:00	3,943.5	176.7	4,035.4	105,000.0	423.7	0.52	0.3	0.9
06/26/2022 22:00	2,942.4	0.0	2,942.4	105,000.0	309.0	0.37	0.2	0.6
06/26/2022 23:00	2,845.1	0.0	2,845.1	105,000.0	298.7	0.36	0.2	0.6
Average/Sum#:	3,360.4	240.9	3,585.6	105,000.0	376.5	0.47	0.3	0.8
Minimum:	2,503.2	0.0	2,503.2	105,000.0	262.8	0.34	0.2	0.6
Maximum:	4,409.3	1,530.0	5,908.6	105,000.0	620.4	0.74	0.4	1.2
%SI	41.67	41.67	41.67	0.00	41.67	45.83	45.83	45.83

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
06/27/2022 00:00	2,844.7	0.0	2,844.7	105,000.0	298.7	0.36	0.2	0.6
06/27/2022 01:00	2,854.5	0.0	2,854.5	105,000.0	299.7	0.36	0.2	0.6
06/27/2022 02:00	2,855.5	0.0	2,855.5	105,000.0	299.8	0.36	0.2	0.6
06/27/2022 03:00	2,854.1	0.0	2,854.1	105,000.0	299.7	0.36	0.2	0.6
06/27/2022 04:00	3,255.6	1.4	3,255.6	105,000.0	341.8	0.41	0.2	0.7
06/27/2022 05:00	2,858.4	0.0	2,858.4	105,000.0	300.1	0.36	0.2	0.6
06/27/2022 06:00	2,860.0	0.0	2,860.0	105,000.0	300.3	0.36	0.2	0.6
06/27/2022 07:00	2,865.7	0.0	2,865.7	105,000.0	300.9	0.36	0.2	0.6
06/27/2022 08:00	2,865.6	0.0	2,865.6	105,000.0	300.9	0.36	0.2	0.6
06/27/2022 09:00	2,870.9	0.0	2,870.9	105,000.0	301.4	0.36	0.2	0.6
06/27/2022 10:00	2,867.3	0.0	2,867.3	105,000.0	301.1	0.36	0.2	0.6
06/27/2022 11:00	2,869.3	0.0	2,869.3	105,000.0	301.3	0.36	0.2	0.6
06/27/2022 12:00	3,021.1	0.0	3,021.1	105,000.0	317.2	0.38	0.2	0.6
06/27/2022 13:00	3,334.1	0.0	3,334.1	105,000.0	350.1	0.42	0.2	0.7
06/27/2022 14:00	3,908.8	50.1	3,916.3	105,000.0	411.2	0.50	0.2	0.8
06/27/2022 15:00	4,378.7	445.6	4,824.3	105,000.0	506.6	0.61	0.3	1.0
06/27/2022 16:00	4,377.3	442.5	4,819.8	105,000.0	506.1	0.61	0.3	1.0
06/27/2022 17:00	4,366.0	697.1	5,063.1	105,000.0	531.6	0.64	0.3	1.1
06/27/2022 18:00	4,354.8	1,104.1	5,458.9	105,000.0	573.2	0.69	0.3	1.1
06/27/2022 19:00	4,354.5	565.3	4,919.8	105,000.0	516.6	0.62	0.3	1.0
06/27/2022 20:00	4,393.6	443.9	4,837.5	105,000.0	507.9	0.61	0.3	1.0
06/27/2022 21:00	4,344.8	403.1	4,655.2	105,000.0	488.8	0.60	0.3	1.0
06/27/2022 22:00	3,012.2	0.0	3,012.2	105,000.0	316.3	0.38	0.2	0.6
06/27/2022 23:00	2,867.9	0.0	2,867.9	105,000.0	301.1	0.36	0.2	0.6
Average/Sum#:	3,393.1	173.0	3,560.5	105,000.0	373.9	0.45	0.2	0.7
Minimum:	2,844.7	0.0	2,844.7	105,000.0	298.7	0.36	0.2	0.6
Maximum:	4,393.6	1,104.1	5,458.9	105,000.0	573.2	0.69	0.3	1.1
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
06/28/2022 00:00	2,809.0	0.0	2,809.0	105,000.0	294.9	0.35	0.2	0.6
06/28/2022 01:00	2,809.5	0.0	2,809.5	105,000.0	295.0	0.35	0.2	0.6
06/28/2022 02:00	2,803.6	0.0	2,803.6	105,000.0	294.4	0.35	0.2	0.6
06/28/2022 03:00	2,805.2	0.0	2,805.2	105,000.0	294.5	0.35	0.2	0.6
06/28/2022 04:00	3,964.2	0.0	3,964.2	105,000.0	416.2	0.50	0.2	0.8
06/28/2022 05:00	3,293.5	0.0	3,293.5	105,000.0	345.8	0.41	0.2	0.7
06/28/2022 06:00	2,845.4	0.0	2,845.4	105,000.0	298.8	0.36	0.2	0.6
06/28/2022 07:00	2,855.2	0.0	2,855.2	105,000.0	299.8	0.36	0.2	0.6
06/28/2022 08:00	2,861.2	0.0	2,861.2	105,000.0	300.4	0.36	0.2	0.6
06/28/2022 09:00	2,862.7	0.0	2,862.7	105,000.0	300.6	0.36	0.2	0.6
06/28/2022 10:00	2,857.3	0.0	2,857.3	105,000.0	300.0	0.36	0.2	0.6
06/28/2022 11:00	3,071.9	0.0	3,071.9	105,000.0	322.5	0.39	0.2	0.6
06/28/2022 12:00	2,859.8	0.0	2,859.8	105,000.0	300.3	0.36	0.2	0.6
06/28/2022 13:00	2,854.2	0.0	2,854.2	105,000.0	299.7	0.36	0.2	0.6
06/28/2022 14:00	2,862.1	0.0	2,862.1	105,000.0	300.5	0.36	0.2	0.6
06/28/2022 15:00	3,289.2	0.0	3,289.2	105,000.0	345.4	0.42	0.2	0.7
06/28/2022 16:00	2,875.6	0.0	2,875.6	105,000.0	301.9	0.36	0.2	0.6
06/28/2022 17:00	3,991.1	256.4	4,111.6	105,000.0	431.7	0.54	0.3	0.9
06/28/2022 18:00	4,362.6	431.7	4,794.3	105,000.0	503.4	0.60	0.3	1.0
06/28/2022 19:00	4,393.0	347.3	4,740.3	105,000.0	497.7	0.60	0.3	1.0
06/28/2022 20:00	4,080.3	150.3	4,158.5	105,000.0	436.6	0.53	0.3	0.9
06/28/2022 21:00	3,160.5	0.0	3,160.5	105,000.0	331.9	0.40	0.2	0.7
06/28/2022 22:00	2,832.6	0.0	2,832.6	105,000.0	297.4	0.36	0.2	0.6
06/28/2022 23:00	4,203.1	2.5	4,203.2	105,000.0	441.3	0.53	0.3	0.9
Average/Sum#:	3,233.5	49.5	3,274.2	105,000.0	343.8	0.41	0.2	0.7
Minimum:	2,803.6	0.0	2,803.6	105,000.0	294.4	0.35	0.2	0.6
Maximum:	4,393.0	431.7	4,794.3	105,000.0	503.4	0.60	0.3	1.0
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
06/29/2022 00:00	4,472.8	0.0	4,472.8	105,000.0	469.6	0.56	0.3	0.9
06/29/2022 01:00	4,394.5	0.0	4,394.5	105,000.0	461.4	0.55	0.3	0.9
06/29/2022 02:00	4,392.3	0.0	4,392.3	105,000.0	461.2	0.55	0.3	0.9
06/29/2022 03:00	4,385.9	0.0	4,385.9	105,000.0	460.5	0.55	0.3	0.9
06/29/2022 04:00	4,401.3	0.0	4,401.3	105,000.0	462.1	0.55	0.3	0.9
06/29/2022 05:00	4,112.6	0.0	4,112.6	105,000.0	431.8	0.52	0.3	0.9
06/29/2022 06:00	2,987.0	0.0	2,987.0	105,000.0	313.6	0.38	0.2	0.6
06/29/2022 07:00	2,869.6	0.0	2,869.6	105,000.0	301.3	0.36	0.2	0.6
06/29/2022 08:00	2,884.5	0.0	2,884.5	105,000.0	302.9	0.36	0.2	0.6
06/29/2022 09:00	2,931.3	0.0	2,931.3	105,000.0	307.8	0.37	0.2	0.6
06/29/2022 10:00	2,877.2	0.0	2,877.2	105,000.0	302.1	0.36	0.2	0.6
06/29/2022 11:00	3,314.8	0.0	3,314.8	105,000.0	348.1	0.42	0.2	0.7
06/29/2022 12:00	3,203.5	0.0	3,203.5	105,000.0	336.4	0.40	0.2	0.7
06/29/2022 13:00	4,021.2	100.3	4,046.3	105,000.0	424.9	0.52	0.3	0.9
06/29/2022 14:00	4,405.1	412.9	4,818.0	105,000.0	505.9	0.61	0.3	1.0
06/29/2022 15:00	4,403.5	399.5	4,803.0	105,000.0	504.3	0.60	0.3	1.0
06/29/2022 16:00	4,418.2	380.2	4,798.4	105,000.0	503.8	0.61	0.3	1.0
06/29/2022 17:00	4,424.9	374.8	4,799.7	105,000.0	504.0	0.60	0.3	1.0
06/29/2022 18:00	4,434.6	464.1	4,898.7	105,000.0	514.4	0.62	0.3	1.0
06/29/2022 19:00	4,445.5	572.8	5,018.3	105,000.0	526.9	0.63	0.3	1.1
06/29/2022 20:00	4,456.7	500.8	4,957.5	105,000.0	520.5	0.62	0.3	1.0
06/29/2022 21:00	4,464.9	334.3	4,799.2	105,000.0	503.9	0.60	0.3	1.0
06/29/2022 22:00	4,479.2	189.9	4,669.1	105,000.0	490.3	0.59	0.3	1.0
06/29/2022 23:00	4,485.7	923.6	5,409.3	105,000.0	568.0	0.68	0.3	1.1
Average/Sum#:	3,986.1	193.9	4,176.9	105,000.0	438.6	0.53	0.3	0.9
Minimum:	2,869.6	0.0	2,869.6	105,000.0	301.3	0.36	0.2	0.6
Maximum:	4,485.7	923.6	5,409.3	105,000.0	568.0	0.68	0.3	1.1
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:51 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
06/30/2022 00:00	3,986.0	35.2	3,995.5	105,000.0	419.5	0.51	0.3	0.8
06/30/2022 01:00	4,446.5	0.0	4,446.5	105,000.0	466.9	0.56	0.3	0.9
06/30/2022 02:00	3,861.5	0.0	3,861.5	105,000.0	405.5	0.49	0.2	0.8
06/30/2022 03:00	4,331.4	0.0	4,331.4	105,000.0	454.8	0.55	0.3	0.9
06/30/2022 04:00	3,897.3	0.0	3,897.3	105,000.0	409.2	0.49	0.2	0.8
06/30/2022 05:00	3,777.0	0.0	3,777.0	105,000.0	396.6	0.48	0.2	0.8
06/30/2022 06:00	2,860.9	0.0	2,860.9	105,000.0	300.4	0.36	0.2	0.6
06/30/2022 07:00	2,866.1	0.0	2,866.1	105,000.0	300.9	0.36	0.2	0.6
06/30/2022 08:00	2,863.8	0.0	2,863.8	105,000.0	300.7	0.36	0.2	0.6
06/30/2022 09:00	2,869.5	0.0	2,869.5	105,000.0	301.3	0.36	0.2	0.6
06/30/2022 10:00	2,878.9	0.0	2,878.9	105,000.0	302.3	0.36	0.2	0.6
06/30/2022 11:00	2,899.3	0.0	2,899.3	105,000.0	304.4	0.37	0.2	0.6
06/30/2022 12:00	2,907.4	0.0	2,907.4	105,000.0	305.3	0.37	0.2	0.6
06/30/2022 13:00	3,342.6	0.0	3,342.6	105,000.0	351.0	0.42	0.2	0.7
06/30/2022 14:00	3,321.1	0.0	3,321.1	105,000.0	348.7	0.42	0.2	0.7
06/30/2022 15:00	4,144.7	225.1	4,257.3	105,000.0	447.0	0.55	0.3	0.9
06/30/2022 16:00	4,420.6	414.3	4,834.9	105,000.0	507.7	0.61	0.3	1.0
06/30/2022 17:00	4,421.8	514.6	4,936.4	105,000.0	518.3	0.62	0.3	1.0
06/30/2022 18:00	4,413.5	1,254.7	5,668.2	105,000.0	595.2	0.71	0.4	1.2
06/30/2022 19:00	4,428.1	1,829.5	6,257.6	105,000.0	657.0	0.79	0.4	1.3
06/30/2022 20:00	4,446.1	588.1	5,034.2	105,000.0	528.6	0.63	0.3	1.1
06/30/2022 21:00	4,465.8	226.1	4,691.9	105,000.0	492.6	0.59	0.3	1.0
06/30/2022 22:00	4,227.3	96.2	4,277.3	105,000.0	449.1	0.54	0.3	0.9
06/30/2022 23:00	3,772.5	1.2	3,772.5	105,000.0	396.1	0.48	0.2	0.8
Average/Sum#:	3,743.7	216.0	3,952.0	105,000.0	415.0	0.50	0.3	0.8
Minimum:	2,860.9	0.0	2,860.9	105,000.0	300.4	0.36	0.2	0.6
Maximum:	4,465.8	1,829.5	6,257.6	105,000.0	657.0	0.79	0.4	1.3
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
04/01/2022 00:00	0.0	0.0	0.0	104,300.0	0.0	0.0	0.0	0.0
04/01/2022 01:00	0.0	0.0	0.0	104,300.0	0.0	0.0	0.0	0.0
04/01/2022 02:00	0.0	0.0	0.0	104,300.0	0.0	0.0	0.0	0.0
04/01/2022 03:00	0.0	0.0	0.0	104,300.0	0.0	0.0	0.0	0.0
04/01/2022 04:00	0.0	0.0	0.0	104,300.0	0.0	0.0	0.0	0.0
04/01/2022 05:00	0.0	0.0	0.0	104,300.0	0.0	0.0	0.0	0.0
04/01/2022 06:00	0.0	0.0	0.0	104,300.0	0.0	0.0	0.0	0.0
04/01/2022 07:00	0.0	0.0	0.0	104,300.0	0.0	0.0	0.0	0.0
04/01/2022 08:00	0.0	0.0	0.0	104,300.0	0.0	0.0	0.0	0.0
04/01/2022 09:00	0.0	0.0	0.0	104,300.0	0.0	0.0	0.0	0.0
04/01/2022 10:00	0.0	0.0	0.0	104,300.0	0.0	0.0	0.0	0.0
04/01/2022 11:00	0.0	0.0	0.0	104,300.0	0.0	0.0	0.0	0.0
04/01/2022 12:00	0.0	0.0	0.0	104,300.0	0.0	0.0	0.0	0.0
04/01/2022 13:00	0.0	0.0	0.0	104,300.0	0.0	0.0	0.0	0.0
04/01/2022 14:00	0.0	0.0	0.0	104,300.0	0.0	0.0	0.0	0.0
04/01/2022 15:00	0.0	0.0	0.0	104,300.0	0.0	0.0	0.0	0.0
04/01/2022 16:00	0.0	0.0	0.0	104,300.0	0.0	0.0	0.0	0.0
04/01/2022 17:00	0.0	0.0	0.0	104,300.0	0.0	0.0	0.0	0.0
04/01/2022 18:00	0.0	0.0	0.0	104,300.0	0.0	0.0	0.0	0.0
04/01/2022 19:00	0.0	0.0	0.0	104,300.0	0.0	0.0	0.0	0.0
04/01/2022 20:00	0.0	0.0	0.0	104,300.0	0.0	0.0	0.0	0.0
04/01/2022 21:00	0.0	0.0	0.0	104,300.0	0.0	0.0	0.0	0.0
04/01/2022 22:00	0.0	0.0	0.0	104,300.0	0.0	0.0	0.0	0.0
04/01/2022 23:00	0.0	0.0	0.0	104,300.0	0.0	0.0	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	104,300.0	0.0	0.0	0.0	0.0
Minimum:	0.0	0.0	0.0	104,300.0	0.0	0.0	0.0	0.0
Maximum:	0.0	0.0	0.0	104,300.0	0.0	0.0	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
04/02/2022 00:00	0.0	0.0	0.0	104,300.0	0.0	0.0	0.0	0.0
04/02/2022 01:00	0.0	0.0	0.0	104,300.0	0.0	0.0	0.0	0.0
04/02/2022 02:00	0.0	0.0	0.0	104,300.0	0.0	0.0	0.0	0.0
04/02/2022 03:00	0.0	0.0	0.0	104,300.0	0.0	0.0	0.0	0.0
04/02/2022 04:00	0.0	0.0	0.0	104,300.0	0.0	0.0	0.0	0.0
04/02/2022 05:00	0.0	0.0	0.0	104,300.0	0.0	0.0	0.0	0.0
04/02/2022 06:00	0.0	0.0	0.0	104,300.0	0.0	0.0	0.0	0.0
04/02/2022 07:00	0.0	0.0	0.0	104,300.0	0.0	0.0	0.0	0.0
04/02/2022 08:00	0.0	0.0	0.0	104,300.0	0.0	0.0	0.0	0.0
04/02/2022 09:00	0.0	0.0	0.0	104,300.0	0.0	0.0	0.0	0.0
04/02/2022 10:00	0.0	0.0	0.0	104,300.0	0.0	0.0	0.0	0.0
04/02/2022 11:00	0.0	0.0	0.0	104,300.0	0.0	0.0	0.0	0.0
04/02/2022 12:00	0.0	0.0	0.0	104,300.0	0.0	0.0	0.0	0.0
04/02/2022 13:00	0.0	0.0	0.0	104,300.0	0.0	0.0	0.0	0.0
04/02/2022 14:00	0.0	0.0	0.0	104,300.0	0.0	0.0	0.0	0.0
04/02/2022 15:00	0.0	0.0	0.0	104,300.0	0.0	0.0	0.0	0.0
04/02/2022 16:00	0.0	0.0	0.0	104,300.0	0.0	0.0	0.0	0.0
04/02/2022 17:00	0.0	0.0	0.0	104,300.0	0.0	0.0	0.0	0.0
04/02/2022 18:00	0.0	0.0	0.0	104,300.0	0.0	0.0	0.0	0.0
04/02/2022 19:00	0.0	0.0	0.0	104,300.0	0.0	0.0	0.0	0.0
04/02/2022 20:00	0.0	0.0	0.0	104,300.0	0.0	0.0	0.0	0.0
04/02/2022 21:00	0.0	0.0	0.0	104,300.0	0.0	0.0	0.0	0.0
04/02/2022 22:00	0.0	0.0	0.0	104,300.0	0.0	0.0	0.0	0.0
04/02/2022 23:00	0.0	0.0	0.0	104,300.0	0.0	0.0	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	104,300.0	0.0	0.0	0.0	0.0
Minimum:	0.0	0.0	0.0	104,300.0	0.0	0.0	0.0	0.0
Maximum:	0.0	0.0	0.0	104,300.0	0.0	0.0	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
04/03/2022 00:00	0.0	0.0	0.0	104,300.0	0.0	0.0	0.0	0.0
04/03/2022 01:00	0.0	0.0	0.0	104,300.0	0.0	0.0	0.0	0.0
04/03/2022 02:00	0.0	0.0	0.0	104,300.0	0.0	0.0	0.0	0.0
04/03/2022 03:00	0.0	0.0	0.0	104,300.0	0.0	0.0	0.0	0.0
04/03/2022 04:00	0.0	0.0	0.0	104,300.0	0.0	0.0	0.0	0.0
04/03/2022 05:00	0.0	0.0	0.0	104,300.0	0.0	0.0	0.0	0.0
04/03/2022 06:00	0.0	0.0	0.0	104,300.0	0.0	0.0	0.0	0.0
04/03/2022 07:00	0.0	0.0	0.0	104,300.0	0.0	0.0	0.0	0.0
04/03/2022 08:00	0.0	0.0	0.0	104,300.0	0.0	0.0	0.0	0.0
04/03/2022 09:00	0.0	0.0	0.0	104,300.0	0.0	0.0	0.0	0.0
04/03/2022 10:00	0.0	0.0	0.0	104,300.0	0.0	0.0	0.0	0.0
04/03/2022 11:00	0.0	0.0	0.0	104,300.0	0.0	0.0	0.0	0.0
04/03/2022 12:00	0.0	0.0	0.0	104,300.0	0.0	0.0	0.0	0.0
04/03/2022 13:00	0.0	0.0	0.0	104,300.0	0.0	0.0	0.0	0.0
04/03/2022 14:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/03/2022 15:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/03/2022 16:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/03/2022 17:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/03/2022 18:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/03/2022 19:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/03/2022 20:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/03/2022 21:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/03/2022 22:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/03/2022 23:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	104,091.7	0.0	0.0	0.0	0.0
Minimum:	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Maximum:	0.0	0.0	0.0	104,300.0	0.0	0.0	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
04/04/2022 00:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/04/2022 01:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/04/2022 02:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/04/2022 03:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/04/2022 04:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/04/2022 05:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/04/2022 06:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/04/2022 07:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/04/2022 08:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/04/2022 09:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/04/2022 10:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/04/2022 11:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/04/2022 12:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/04/2022 13:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/04/2022 14:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/04/2022 15:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/04/2022 16:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/04/2022 17:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/04/2022 18:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/04/2022 19:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/04/2022 20:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/04/2022 21:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/04/2022 22:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/04/2022 23:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Minimum:	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Maximum:	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
04/05/2022 00:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/05/2022 01:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/05/2022 02:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/05/2022 03:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/05/2022 04:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/05/2022 05:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/05/2022 06:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/05/2022 07:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/05/2022 08:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/05/2022 09:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/05/2022 10:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/05/2022 11:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/05/2022 12:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/05/2022 13:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/05/2022 14:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/05/2022 15:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/05/2022 16:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/05/2022 17:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/05/2022 18:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/05/2022 19:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/05/2022 20:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/05/2022 21:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/05/2022 22:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/05/2022 23:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Minimum:	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Maximum:	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
04/06/2022 00:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/06/2022 01:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/06/2022 02:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/06/2022 03:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/06/2022 04:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/06/2022 05:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/06/2022 06:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/06/2022 07:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/06/2022 08:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/06/2022 09:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/06/2022 10:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/06/2022 11:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/06/2022 12:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/06/2022 13:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/06/2022 14:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/06/2022 15:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/06/2022 16:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/06/2022 17:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/06/2022 18:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/06/2022 19:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/06/2022 20:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/06/2022 21:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/06/2022 22:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/06/2022 23:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Minimum:	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Maximum:	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
04/07/2022 00:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/07/2022 01:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/07/2022 02:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/07/2022 03:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/07/2022 04:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/07/2022 05:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/07/2022 06:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/07/2022 07:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/07/2022 08:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/07/2022 09:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/07/2022 10:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/07/2022 11:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/07/2022 12:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/07/2022 13:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/07/2022 14:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/07/2022 15:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/07/2022 16:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/07/2022 17:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/07/2022 18:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/07/2022 19:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/07/2022 20:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/07/2022 21:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/07/2022 22:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/07/2022 23:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Minimum:	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Maximum:	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
04/08/2022 00:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/08/2022 01:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/08/2022 02:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/08/2022 03:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/08/2022 04:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/08/2022 05:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/08/2022 06:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/08/2022 07:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/08/2022 08:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/08/2022 09:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/08/2022 10:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/08/2022 11:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/08/2022 12:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/08/2022 13:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/08/2022 14:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/08/2022 15:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/08/2022 16:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/08/2022 17:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/08/2022 18:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/08/2022 19:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/08/2022 20:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/08/2022 21:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/08/2022 22:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/08/2022 23:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Minimum:	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Maximum:	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
04/09/2022 00:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/09/2022 01:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/09/2022 02:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/09/2022 03:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/09/2022 04:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/09/2022 05:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/09/2022 06:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/09/2022 07:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/09/2022 08:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/09/2022 09:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/09/2022 10:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/09/2022 11:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/09/2022 12:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/09/2022 13:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/09/2022 14:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/09/2022 15:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/09/2022 16:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/09/2022 17:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/09/2022 18:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/09/2022 19:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/09/2022 20:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/09/2022 21:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/09/2022 22:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/09/2022 23:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Minimum:	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Maximum:	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
04/10/2022 00:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/10/2022 01:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/10/2022 02:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/10/2022 03:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/10/2022 04:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/10/2022 05:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/10/2022 06:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/10/2022 07:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/10/2022 08:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/10/2022 09:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/10/2022 10:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/10/2022 11:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/10/2022 12:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/10/2022 13:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/10/2022 14:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/10/2022 15:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/10/2022 16:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/10/2022 17:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/10/2022 18:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/10/2022 19:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/10/2022 20:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/10/2022 21:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/10/2022 22:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/10/2022 23:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Minimum:	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Maximum:	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
04/11/2022 00:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/11/2022 01:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/11/2022 02:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/11/2022 03:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/11/2022 04:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/11/2022 05:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/11/2022 06:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/11/2022 07:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/11/2022 08:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/11/2022 09:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/11/2022 10:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/11/2022 11:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/11/2022 12:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/11/2022 13:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/11/2022 14:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/11/2022 15:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/11/2022 16:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/11/2022 17:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/11/2022 18:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/11/2022 19:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/11/2022 20:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/11/2022 21:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/11/2022 22:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/11/2022 23:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Minimum:	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Maximum:	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
04/12/2022 00:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/12/2022 01:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/12/2022 02:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/12/2022 03:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/12/2022 04:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/12/2022 05:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/12/2022 06:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/12/2022 07:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/12/2022 08:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/12/2022 09:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/12/2022 10:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/12/2022 11:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/12/2022 12:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/12/2022 13:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/12/2022 14:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/12/2022 15:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/12/2022 16:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/12/2022 17:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/12/2022 18:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/12/2022 19:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/12/2022 20:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/12/2022 21:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/12/2022 22:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/12/2022 23:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Minimum:	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Maximum:	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
04/13/2022 00:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/13/2022 01:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/13/2022 02:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/13/2022 03:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/13/2022 04:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/13/2022 05:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/13/2022 06:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/13/2022 07:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/13/2022 08:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/13/2022 09:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/13/2022 10:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/13/2022 11:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/13/2022 12:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/13/2022 13:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/13/2022 14:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/13/2022 15:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/13/2022 16:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/13/2022 17:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/13/2022 18:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/13/2022 19:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/13/2022 20:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/13/2022 21:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/13/2022 22:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/13/2022 23:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Minimum:	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Maximum:	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
04/14/2022 00:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/14/2022 01:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/14/2022 02:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/14/2022 03:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/14/2022 04:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/14/2022 05:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/14/2022 06:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/14/2022 07:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/14/2022 08:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/14/2022 09:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/14/2022 10:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/14/2022 11:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/14/2022 12:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/14/2022 13:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/14/2022 14:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/14/2022 15:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/14/2022 16:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/14/2022 17:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/14/2022 18:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/14/2022 19:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/14/2022 20:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/14/2022 21:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/14/2022 22:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/14/2022 23:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Minimum:	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Maximum:	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
04/15/2022 00:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/15/2022 01:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/15/2022 02:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/15/2022 03:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/15/2022 04:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/15/2022 05:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/15/2022 06:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/15/2022 07:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/15/2022 08:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/15/2022 09:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/15/2022 10:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/15/2022 11:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/15/2022 12:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/15/2022 13:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/15/2022 14:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/15/2022 15:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/15/2022 16:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/15/2022 17:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/15/2022 18:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/15/2022 19:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/15/2022 20:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/15/2022 21:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/15/2022 22:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/15/2022 23:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Minimum:	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Maximum:	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
04/16/2022 00:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/16/2022 01:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/16/2022 02:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/16/2022 03:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/16/2022 04:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/16/2022 05:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/16/2022 06:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/16/2022 07:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/16/2022 08:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/16/2022 09:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/16/2022 10:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/16/2022 11:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/16/2022 12:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/16/2022 13:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/16/2022 14:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/16/2022 15:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/16/2022 16:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/16/2022 17:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/16/2022 18:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/16/2022 19:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/16/2022 20:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/16/2022 21:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/16/2022 22:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/16/2022 23:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Minimum:	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Maximum:	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
04/17/2022 00:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/17/2022 01:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/17/2022 02:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/17/2022 03:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/17/2022 04:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/17/2022 05:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/17/2022 06:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/17/2022 07:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/17/2022 08:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/17/2022 09:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/17/2022 10:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/17/2022 11:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/17/2022 12:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/17/2022 13:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/17/2022 14:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/17/2022 15:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/17/2022 16:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/17/2022 17:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/17/2022 18:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/17/2022 19:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/17/2022 20:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/17/2022 21:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/17/2022 22:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/17/2022 23:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Minimum:	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Maximum:	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
04/18/2022 00:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/18/2022 01:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/18/2022 02:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/18/2022 03:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/18/2022 04:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/18/2022 05:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/18/2022 06:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/18/2022 07:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/18/2022 08:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/18/2022 09:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/18/2022 10:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/18/2022 11:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/18/2022 12:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/18/2022 13:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/18/2022 14:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/18/2022 15:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/18/2022 16:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/18/2022 17:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/18/2022 18:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/18/2022 19:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/18/2022 20:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/18/2022 21:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/18/2022 22:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/18/2022 23:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Minimum:	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Maximum:	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
04/19/2022 00:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/19/2022 01:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/19/2022 02:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/19/2022 03:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/19/2022 04:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/19/2022 05:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/19/2022 06:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/19/2022 07:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/19/2022 08:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/19/2022 09:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/19/2022 10:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/19/2022 11:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/19/2022 12:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/19/2022 13:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/19/2022 14:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/19/2022 15:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/19/2022 16:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/19/2022 17:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/19/2022 18:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/19/2022 19:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/19/2022 20:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/19/2022 21:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/19/2022 22:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/19/2022 23:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Minimum:	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Maximum:	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
04/20/2022 00:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/20/2022 01:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/20/2022 02:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/20/2022 03:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/20/2022 04:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/20/2022 05:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/20/2022 06:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/20/2022 07:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/20/2022 08:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/20/2022 09:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/20/2022 10:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/20/2022 11:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/20/2022 12:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/20/2022 13:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/20/2022 14:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/20/2022 15:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/20/2022 16:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/20/2022 17:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/20/2022 18:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/20/2022 19:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/20/2022 20:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/20/2022 21:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/20/2022 22:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/20/2022 23:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Minimum:	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Maximum:	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
04/21/2022 00:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/21/2022 01:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/21/2022 02:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/21/2022 03:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/21/2022 04:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/21/2022 05:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/21/2022 06:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/21/2022 07:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/21/2022 08:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/21/2022 09:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/21/2022 10:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/21/2022 11:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/21/2022 12:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/21/2022 13:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/21/2022 14:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/21/2022 15:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/21/2022 16:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/21/2022 17:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/21/2022 18:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/21/2022 19:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/21/2022 20:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/21/2022 21:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/21/2022 22:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/21/2022 23:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Minimum:	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Maximum:	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
04/22/2022 00:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/22/2022 01:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/22/2022 02:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/22/2022 03:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/22/2022 04:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/22/2022 05:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/22/2022 06:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/22/2022 07:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/22/2022 08:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/22/2022 09:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/22/2022 10:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/22/2022 11:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/22/2022 12:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/22/2022 13:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/22/2022 14:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/22/2022 15:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/22/2022 16:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/22/2022 17:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/22/2022 18:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/22/2022 19:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/22/2022 20:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/22/2022 21:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/22/2022 22:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/22/2022 23:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Minimum:	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Maximum:	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
04/23/2022 00:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/23/2022 01:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/23/2022 02:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/23/2022 03:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/23/2022 04:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/23/2022 05:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/23/2022 06:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/23/2022 07:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/23/2022 08:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/23/2022 09:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/23/2022 10:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/23/2022 11:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/23/2022 12:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/23/2022 13:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/23/2022 14:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/23/2022 15:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/23/2022 16:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/23/2022 17:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/23/2022 18:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/23/2022 19:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/23/2022 20:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/23/2022 21:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/23/2022 22:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/23/2022 23:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Minimum:	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Maximum:	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
04/24/2022 00:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/24/2022 01:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/24/2022 02:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/24/2022 03:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/24/2022 04:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/24/2022 05:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/24/2022 06:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/24/2022 07:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/24/2022 08:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/24/2022 09:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/24/2022 10:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/24/2022 11:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/24/2022 12:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/24/2022 13:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/24/2022 14:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/24/2022 15:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/24/2022 16:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/24/2022 17:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/24/2022 18:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/24/2022 19:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/24/2022 20:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/24/2022 21:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/24/2022 22:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/24/2022 23:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Minimum:	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Maximum:	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
04/25/2022 00:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/25/2022 01:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/25/2022 02:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/25/2022 03:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/25/2022 04:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/25/2022 05:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/25/2022 06:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/25/2022 07:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/25/2022 08:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/25/2022 09:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/25/2022 10:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/25/2022 11:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/25/2022 12:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/25/2022 13:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/25/2022 14:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/25/2022 15:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/25/2022 16:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/25/2022 17:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/25/2022 18:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/25/2022 19:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/25/2022 20:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/25/2022 21:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/25/2022 22:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/25/2022 23:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Minimum:	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Maximum:	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
04/26/2022 00:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/26/2022 01:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/26/2022 02:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/26/2022 03:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/26/2022 04:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/26/2022 05:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/26/2022 06:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/26/2022 07:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/26/2022 08:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/26/2022 09:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/26/2022 10:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/26/2022 11:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/26/2022 12:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/26/2022 13:00	1,069.8	0.0	1,069.8	103,800.0	111.0	0.0	0.0	0.0
04/26/2022 14:00	2,869.7	0.0	2,869.7	103,800.0	297.9	0.4	0.2	0.7
04/26/2022 15:00	3,630.7	0.0	3,630.7	103,800.0	376.9	0.5	0.2	0.8
04/26/2022 16:00	4,553.8	0.0	4,553.8	103,800.0	472.7	0.6	0.3	0.9
04/26/2022 17:00	4,709.5	0.0	4,709.5	103,800.0	488.8	0.6	0.3	1.0
04/26/2022 18:00	4,408.7	0.0	4,408.7	103,800.0	457.6	0.5	0.3	0.9
04/26/2022 19:00	4,719.2	0.0	4,719.2	103,800.0	489.9	0.6	0.3	1.0
04/26/2022 20:00	4,828.8	0.0	4,828.8	103,800.0	501.2	0.6	0.3	1.0
04/26/2022 21:00	4,772.8	0.0	4,772.8	103,800.0	495.4	0.6	0.3	1.0
04/26/2022 22:00	2,591.5	0.0	2,591.5	103,800.0	269.0	0.4	0.2	0.7
04/26/2022 23:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Average/Sum#:	3,815.5	0.0	3,815.5	103,800.0	396.0	0.5	0.3	0.9
Minimum:	1,069.8	0.0	1,069.8	103,800.0	111.0	0.4	0.2	0.7
Maximum:	4,828.8	0.0	4,828.8	103,800.0	501.2	0.6	0.3	1.0
%SI	58.33	58.33	58.33	0.00	58.33	62.50	62.50	62.50

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
04/27/2022 00:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/27/2022 01:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/27/2022 02:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/27/2022 03:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/27/2022 04:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/27/2022 05:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/27/2022 06:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/27/2022 07:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/27/2022 08:00	1,419.8	0.0	1,419.8	103,800.0	147.4	0.0	0.0	0.0
04/27/2022 09:00	4,510.9	0.0	4,510.9	103,800.0	468.2	0.0	0.0	0.0
04/27/2022 10:00	3,926.6	0.0	3,926.6	103,800.0	407.6	0.5	0.3	0.8
04/27/2022 11:00	4,722.7	0.0	4,722.7	103,800.0	490.2	0.6	0.3	1.0
04/27/2022 12:00	4,480.7	0.0	4,480.7	103,800.0	465.1	0.6	0.3	0.9
04/27/2022 13:00	4,776.6	0.0	4,776.6	103,800.0	495.8	0.6	0.3	1.0
04/27/2022 14:00	4,757.9	0.0	4,757.9	103,800.0	493.9	0.6	0.3	1.0
04/27/2022 15:00	4,497.3	0.0	4,497.3	103,800.0	466.8	0.6	0.3	0.9
04/27/2022 16:00	4,592.2	0.0	4,592.2	103,800.0	476.7	0.6	0.3	1.0
04/27/2022 17:00	3,572.7	0.0	3,572.7	103,800.0	370.8	0.4	0.2	0.7
04/27/2022 18:00	3,529.7	0.0	3,529.7	103,800.0	366.4	0.4	0.2	0.7
04/27/2022 19:00	1,637.6	0.0	1,637.6	103,800.0	170.0	0.0	0.0	0.0
04/27/2022 20:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/27/2022 21:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/27/2022 22:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/27/2022 23:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Average/Sum#:	3,868.7	0.0	3,868.7	103,800.0	401.6	0.5	0.3	0.9
Minimum:	1,419.8	0.0	1,419.8	103,800.0	147.4	0.4	0.2	0.7
Maximum:	4,776.6	0.0	4,776.6	103,800.0	495.8	0.6	0.3	1.0
%SI	50.00	50.00	50.00	0.00	50.00	62.50	62.50	62.50

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
04/28/2022 00:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/28/2022 01:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/28/2022 02:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/28/2022 03:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/28/2022 04:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/28/2022 05:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/28/2022 06:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/28/2022 07:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/28/2022 08:00	1,334.5	0.0	1,334.5	103,800.0	138.5	0.0	0.0	0.0
04/28/2022 09:00	2,723.6	0.0	2,723.6	103,800.0	282.7	0.4	0.2	0.6
04/28/2022 10:00	2,823.7	0.0	2,823.7	103,800.0	293.1	0.4	0.2	0.6
04/28/2022 11:00	2,803.0	0.0	2,803.0	103,800.0	291.0	0.3	0.2	0.6
04/28/2022 12:00	3,580.4	0.0	3,580.4	103,800.0	371.6	0.4	0.2	0.7
04/28/2022 13:00	3,922.1	0.0	3,922.1	103,800.0	407.1	0.5	0.2	0.8
04/28/2022 14:00	4,811.3	0.0	4,811.3	103,800.0	499.4	0.6	0.3	1.0
04/28/2022 15:00	4,672.1	0.0	4,672.1	103,800.0	485.0	0.6	0.3	1.0
04/28/2022 16:00	2,725.5	0.0	2,725.5	103,800.0	282.9	0.3	0.2	0.6
04/28/2022 17:00	1,775.5	0.0	1,775.5	103,800.0	184.3	0.0	0.0	0.0
04/28/2022 18:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/28/2022 19:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/28/2022 20:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/28/2022 21:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/28/2022 22:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/28/2022 23:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Average/Sum#:	3,117.2	0.0	3,117.2	103,800.0	323.6	0.4	0.2	0.7
Minimum:	1,334.5	0.0	1,334.5	103,800.0	138.5	0.3	0.2	0.6
Maximum:	4,811.3	0.0	4,811.3	103,800.0	499.4	0.6	0.3	1.0
%SI	58.33	58.33	58.33	0.00	58.33	66.67	66.67	66.67

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
04/29/2022 00:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/29/2022 01:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/29/2022 02:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/29/2022 03:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/29/2022 04:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/29/2022 05:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/29/2022 06:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/29/2022 07:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/29/2022 08:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/29/2022 09:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/29/2022 10:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/29/2022 11:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/29/2022 12:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/29/2022 13:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/29/2022 14:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/29/2022 15:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/29/2022 16:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/29/2022 17:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/29/2022 18:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/29/2022 19:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/29/2022 20:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/29/2022 21:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/29/2022 22:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/29/2022 23:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Minimum:	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Maximum:	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
04/30/2022 00:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/30/2022 01:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/30/2022 02:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/30/2022 03:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/30/2022 04:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/30/2022 05:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/30/2022 06:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/30/2022 07:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/30/2022 08:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/30/2022 09:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/30/2022 10:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/30/2022 11:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/30/2022 12:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/30/2022 13:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/30/2022 14:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/30/2022 15:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/30/2022 16:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/30/2022 17:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/30/2022 18:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/30/2022 19:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/30/2022 20:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/30/2022 21:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/30/2022 22:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
04/30/2022 23:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Minimum:	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Maximum:	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
05/01/2022 00:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/01/2022 01:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/01/2022 02:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/01/2022 03:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/01/2022 04:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/01/2022 05:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/01/2022 06:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/01/2022 07:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/01/2022 08:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/01/2022 09:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/01/2022 10:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/01/2022 11:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/01/2022 12:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/01/2022 13:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/01/2022 14:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/01/2022 15:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/01/2022 16:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/01/2022 17:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/01/2022 18:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/01/2022 19:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/01/2022 20:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/01/2022 21:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/01/2022 22:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/01/2022 23:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
Minimum:	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
Maximum:	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
05/02/2022 00:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/02/2022 01:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/02/2022 02:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/02/2022 03:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/02/2022 04:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/02/2022 05:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/02/2022 06:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/02/2022 07:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/02/2022 08:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/02/2022 09:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/02/2022 10:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/02/2022 11:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/02/2022 12:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/02/2022 13:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/02/2022 14:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/02/2022 15:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/02/2022 16:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/02/2022 17:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/02/2022 18:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/02/2022 19:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/02/2022 20:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/02/2022 21:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/02/2022 22:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/02/2022 23:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
Minimum:	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
Maximum:	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
05/03/2022 00:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/03/2022 01:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/03/2022 02:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/03/2022 03:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/03/2022 04:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/03/2022 05:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/03/2022 06:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/03/2022 07:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/03/2022 08:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/03/2022 09:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/03/2022 10:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/03/2022 11:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/03/2022 12:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/03/2022 13:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/03/2022 14:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/03/2022 15:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/03/2022 16:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/03/2022 17:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/03/2022 18:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/03/2022 19:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/03/2022 20:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/03/2022 21:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/03/2022 22:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/03/2022 23:00	1,419.2	0.0	1,419.2	104,000.0	147.6	0.0	0.0	0.0
Average/Sum#:	1,419.2	0.0	1,419.2	104,000.0	147.6	0.0	0.0	0.0
Minimum:	1,419.2	0.0	1,419.2	104,000.0	147.6	0.0	0.0	0.0
Maximum:	1,419.2	0.0	1,419.2	104,000.0	147.6	0.0	0.0	0.0
%SI	95.83	95.83	95.83	0.00	95.83	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
05/04/2022 00:00	3,466.6	0.0	3,466.6	104,000.0	360.5	0.4	0.2	0.7
05/04/2022 01:00	3,044.5	0.0	3,044.5	104,000.0	316.6	0.4	0.2	0.6
05/04/2022 02:00	4,258.7	0.0	4,258.7	104,000.0	442.9	0.5	0.3	0.9
05/04/2022 03:00	4,574.4	0.0	4,574.4	104,000.0	475.7	0.6	0.3	1.0
05/04/2022 04:00	4,696.8	0.0	4,696.8	104,000.0	488.5	0.6	0.3	1.0
05/04/2022 05:00	4,071.2	0.0	4,071.2	104,000.0	423.4	0.5	0.3	0.8
05/04/2022 06:00	3,946.0	66.0	3,964.5	104,000.0	412.3	0.5	0.3	0.8
05/04/2022 07:00	4,691.6	301.0	4,992.6	104,000.0	519.2	0.6	0.3	1.0
05/04/2022 08:00	3,432.0	8.2	3,432.8	104,000.0	357.0	0.4	0.2	0.7
05/04/2022 09:00	2,902.7	0.0	2,902.7	104,000.0	301.9	0.4	0.2	0.6
05/04/2022 10:00	2,839.8	0.0	2,839.8	104,000.0	295.3	0.4	0.2	0.6
05/04/2022 11:00	2,884.3	0.0	2,884.3	104,000.0	300.0	0.4	0.2	0.6
05/04/2022 12:00	2,933.4	0.0	2,933.4	104,000.0	305.1	0.4	0.2	0.6
05/04/2022 13:00	2,940.0	0.0	2,940.0	104,000.0	305.8	0.4	0.2	0.6
05/04/2022 14:00	2,887.3	0.0	2,887.3	104,000.0	300.3	0.4	0.2	0.6
05/04/2022 15:00	2,812.6	0.0	2,812.6	104,000.0	292.5	0.4	0.2	0.6
05/04/2022 16:00	2,812.7	0.0	2,812.7	104,000.0	292.5	0.4	0.2	0.6
05/04/2022 17:00	3,183.0	59.9	3,190.2	104,000.0	331.8	0.4	0.2	0.7
05/04/2022 18:00	4,420.6	1,149.8	5,570.4	104,000.0	579.3	0.7	0.3	1.2
05/04/2022 19:00	4,634.3	693.6	5,327.9	104,000.0	554.1	0.7	0.3	1.1
05/04/2022 20:00	4,663.8	620.0	5,283.8	104,000.0	549.5	0.7	0.3	1.1
05/04/2022 21:00	4,695.6	974.3	5,669.9	104,000.0	589.7	0.7	0.4	1.2
05/04/2022 22:00	4,724.3	484.2	5,208.5	104,000.0	541.7	0.6	0.3	1.1
05/04/2022 23:00	4,052.3	118.4	4,103.2	104,000.0	426.7	0.5	0.3	0.9
Average/Sum#:	3,732.0	186.5	3,911.2	104,000.0	406.8	0.5	0.3	0.8
Minimum:	2,812.6	0.0	2,812.6	104,000.0	292.5	0.4	0.2	0.6
Maximum:	4,724.3	1,149.8	5,669.9	104,000.0	589.7	0.7	0.4	1.2
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
05/05/2022 00:00	3,723.4	0.0	3,723.4	104,000.0	387.2	0.5	0.2	0.8
05/05/2022 01:00	3,057.9	0.0	3,057.9	104,000.0	318.0	0.4	0.2	0.6
05/05/2022 02:00	2,978.0	0.0	2,978.0	104,000.0	309.7	0.4	0.2	0.6
05/05/2022 03:00	2,978.6	0.0	2,978.6	104,000.0	309.8	0.4	0.2	0.6
05/05/2022 04:00	3,641.5	0.0	3,641.5	104,000.0	378.7	0.5	0.2	0.8
05/05/2022 05:00	3,423.2	0.0	3,423.2	104,000.0	356.0	0.4	0.2	0.7
05/05/2022 06:00	2,904.5	0.0	2,904.5	104,000.0	302.1	0.4	0.2	0.6
05/05/2022 07:00	2,845.8	0.0	2,845.8	104,000.0	296.0	0.4	0.2	0.6
05/05/2022 08:00	2,861.7	0.0	2,861.7	104,000.0	297.6	0.4	0.2	0.6
05/05/2022 09:00	2,983.0	0.0	2,983.0	104,000.0	310.2	0.4	0.2	0.6
05/05/2022 10:00	2,944.1	0.0	2,944.1	104,000.0	306.2	0.4	0.2	0.6
05/05/2022 11:00	2,892.9	0.0	2,892.9	104,000.0	300.9	0.4	0.2	0.6
05/05/2022 12:00	3,921.2	0.0	3,921.2	104,000.0	407.8	0.5	0.2	0.8
05/05/2022 13:00	4,238.1	0.0	4,238.1	104,000.0	440.8	0.5	0.3	0.9
05/05/2022 14:00	3,131.9	0.0	3,131.9	104,000.0	325.7	0.4	0.2	0.7
05/05/2022 15:00	3,061.9	0.0	3,061.9	104,000.0	318.4	0.4	0.2	0.6
05/05/2022 16:00	2,868.0	0.0	2,868.0	104,000.0	298.3	0.4	0.2	0.6
05/05/2022 17:00	3,488.7	0.0	3,488.7	104,000.0	362.8	0.4	0.2	0.7
05/05/2022 18:00	4,779.8	153.1	4,932.9	104,000.0	513.0	0.6	0.3	1.0
05/05/2022 19:00	4,795.8	132.5	4,928.3	104,000.0	512.5	0.6	0.3	1.0
05/05/2022 20:00	4,796.7	123.7	4,920.4	104,000.0	511.7	0.6	0.3	1.0
05/05/2022 21:00	4,356.3	57.6	4,386.3	104,000.0	456.2	0.6	0.3	0.9
05/05/2022 22:00	3,268.5	0.0	3,268.5	104,000.0	339.9	0.4	0.2	0.7
05/05/2022 23:00	2,947.9	0.0	2,947.9	104,000.0	306.6	0.4	0.2	0.6
Average/Sum#:	3,453.7	19.5	3,472.0	104,000.0	361.1	0.5	0.2	0.7
Minimum:	2,845.8	0.0	2,845.8	104,000.0	296.0	0.4	0.2	0.6
Maximum:	4,796.7	153.1	4,932.9	104,000.0	513.0	0.6	0.3	1.0
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
05/06/2022 00:00	2,961.5	0.0	2,961.5	104,000.0	308.0	0.4	0.2	0.6
05/06/2022 01:00	2,920.6	0.0	2,920.6	104,000.0	303.7	0.4	0.2	0.6
05/06/2022 02:00	2,979.3	0.0	2,979.3	104,000.0	309.8	0.4	0.2	0.6
05/06/2022 03:00	3,124.8	0.0	3,124.8	104,000.0	325.0	0.4	0.2	0.7
05/06/2022 04:00	4,779.1	93.7	4,849.4	104,000.0	504.3	0.6	0.3	1.0
05/06/2022 05:00	4,813.2	88.2	4,901.4	104,000.0	509.7	0.6	0.3	1.0
05/06/2022 06:00	4,800.9	104.3	4,905.2	104,000.0	510.1	0.6	0.3	1.0
05/06/2022 07:00	3,596.6	1.1	3,596.6	104,000.0	374.0	0.4	0.2	0.7
05/06/2022 08:00	4,763.9	110.1	4,844.3	104,000.0	503.8	0.6	0.3	1.0
05/06/2022 09:00	4,760.6	97.1	4,835.4	104,000.0	502.9	0.6	0.3	1.0
05/06/2022 10:00	4,690.4	97.5	4,737.2	104,000.0	492.7	0.6	0.3	1.0
05/06/2022 11:00	4,728.1	217.8	4,945.9	104,000.0	514.4	0.6	0.3	1.0
05/06/2022 12:00	4,438.7	1.1	4,438.7	104,000.0	461.6	0.6	0.3	0.9
05/06/2022 13:00	4,679.5	281.7	4,955.6	104,000.0	515.4	0.6	0.3	1.0
05/06/2022 14:00	3,777.6	77.9	3,801.0	104,000.0	395.3	0.5	0.2	0.8
05/06/2022 15:00	2,808.9	0.0	2,808.9	104,000.0	292.1	0.4	0.2	0.6
05/06/2022 16:00	4,588.2	282.1	4,808.2	104,000.0	500.1	0.6	0.3	1.0
05/06/2022 17:00	4,687.9	282.0	4,969.9	104,000.0	516.9	0.6	0.3	1.0
05/06/2022 18:00	4,730.0	199.4	4,929.4	104,000.0	512.7	0.6	0.3	1.0
05/06/2022 19:00	4,769.9	146.9	4,916.8	104,000.0	511.3	0.6	0.3	1.0
05/06/2022 20:00	4,783.9	137.0	4,920.9	104,000.0	511.8	0.6	0.3	1.0
05/06/2022 21:00	4,795.7	117.0	4,912.7	104,000.0	510.9	0.6	0.3	1.0
05/06/2022 22:00	4,369.1	39.6	4,384.8	104,000.0	456.0	0.6	0.3	0.9
05/06/2022 23:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
Average/Sum#:	4,232.5	103.2	4,323.8	104,000.0	449.7	0.5	0.3	0.9
Minimum:	2,808.9	0.0	2,808.9	104,000.0	292.1	0.4	0.2	0.6
Maximum:	4,813.2	282.1	4,969.9	104,000.0	516.9	0.6	0.3	1.0
%SI	4.17	4.17	4.17	0.00	4.17	4.17	4.17	4.17

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
05/07/2022 00:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/07/2022 01:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/07/2022 02:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/07/2022 03:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/07/2022 04:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/07/2022 05:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/07/2022 06:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/07/2022 07:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/07/2022 08:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/07/2022 09:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/07/2022 10:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/07/2022 11:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/07/2022 12:00	1,781.0	0.0	1,781.0	104,000.0	185.2	0.0	0.0	0.0
05/07/2022 13:00	3,023.9	0.0	3,023.9	104,000.0	314.5	0.4	0.2	0.6
05/07/2022 14:00	2,814.8	0.0	2,814.8	104,000.0	292.7	0.4	0.2	0.6
05/07/2022 15:00	2,800.9	0.0	2,800.9	104,000.0	291.3	0.4	0.2	0.6
05/07/2022 16:00	2,805.0	0.0	2,805.0	104,000.0	291.7	0.4	0.2	0.6
05/07/2022 17:00	2,945.3	0.0	2,945.3	104,000.0	306.3	0.4	0.2	0.6
05/07/2022 18:00	4,672.8	304.9	4,947.2	104,000.0	514.5	0.6	0.3	1.0
05/07/2022 19:00	4,775.2	217.9	4,993.1	104,000.0	519.3	0.6	0.3	1.0
05/07/2022 20:00	4,745.2	124.9	4,841.4	104,000.0	503.5	0.6	0.3	1.0
05/07/2022 21:00	2,974.7	0.0	2,974.7	104,000.0	309.4	0.4	0.2	0.6
05/07/2022 22:00	2,835.6	0.0	2,835.6	104,000.0	294.9	0.4	0.2	0.6
05/07/2022 23:00	2,844.5	0.0	2,844.5	104,000.0	295.8	0.4	0.2	0.6
Average/Sum#:	3,251.6	54.0	3,300.6	104,000.0	343.3	0.5	0.2	0.7
Minimum:	1,781.0	0.0	1,781.0	104,000.0	185.2	0.4	0.2	0.6
Maximum:	4,775.2	304.9	4,993.1	104,000.0	519.3	0.6	0.3	1.0
%SI	50.00	50.00	50.00	0.00	50.00	54.17	54.17	54.17

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
05/08/2022 00:00	2,845.9	0.0	2,845.9	104,000.0	296.0	0.4	0.2	0.6
05/08/2022 01:00	2,852.1	0.0	2,852.1	104,000.0	296.6	0.4	0.2	0.6
05/08/2022 02:00	2,853.0	0.0	2,853.0	104,000.0	296.7	0.4	0.2	0.6
05/08/2022 03:00	2,857.5	0.0	2,857.5	104,000.0	297.2	0.4	0.2	0.6
05/08/2022 04:00	2,923.8	0.0	2,923.8	104,000.0	304.1	0.4	0.2	0.6
05/08/2022 05:00	2,875.2	0.0	2,875.2	104,000.0	299.0	0.4	0.2	0.6
05/08/2022 06:00	3,204.4	0.0	3,204.4	104,000.0	333.3	0.4	0.2	0.7
05/08/2022 07:00	3,062.6	0.0	3,062.6	104,000.0	318.5	0.4	0.2	0.6
05/08/2022 08:00	3,065.9	0.0	3,065.9	104,000.0	318.9	0.4	0.2	0.6
05/08/2022 09:00	3,066.3	0.0	3,066.3	104,000.0	318.9	0.4	0.2	0.6
05/08/2022 10:00	3,064.9	0.0	3,064.9	104,000.0	318.7	0.4	0.2	0.6
05/08/2022 11:00	3,063.0	0.0	3,063.0	104,000.0	318.6	0.4	0.2	0.6
05/08/2022 12:00	3,057.0	0.0	3,057.0	104,000.0	317.9	0.4	0.2	0.6
05/08/2022 13:00	3,027.6	0.0	3,027.6	104,000.0	314.9	0.4	0.2	0.6
05/08/2022 14:00	3,016.8	0.0	3,016.8	104,000.0	313.7	0.4	0.2	0.6
05/08/2022 15:00	3,048.6	0.0	3,048.6	104,000.0	317.1	0.4	0.2	0.6
05/08/2022 16:00	3,631.9	4.2	3,632.7	104,000.0	377.8	0.5	0.2	0.8
05/08/2022 17:00	4,047.9	0.0	4,047.9	104,000.0	421.0	0.5	0.3	0.8
05/08/2022 18:00	3,281.9	0.0	3,281.9	104,000.0	341.3	0.4	0.2	0.7
05/08/2022 19:00	4,883.5	60.8	4,943.1	104,000.0	514.1	0.6	0.3	1.0
05/08/2022 20:00	4,875.4	24.9	4,900.3	104,000.0	509.6	0.6	0.3	1.0
05/08/2022 21:00	4,850.1	16.1	4,862.5	104,000.0	505.7	0.6	0.3	1.0
05/08/2022 22:00	3,082.4	0.0	3,082.4	104,000.0	320.6	0.4	0.2	0.6
05/08/2022 23:00	2,860.8	0.0	2,860.8	104,000.0	297.5	0.4	0.2	0.6
Average/Sum#:	3,308.3	4.4	3,312.3	104,000.0	344.5	0.4	0.2	0.7
Minimum:	2,845.9	0.0	2,845.9	104,000.0	296.0	0.4	0.2	0.6
Maximum:	4,883.5	60.8	4,943.1	104,000.0	514.1	0.6	0.3	1.0
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
05/09/2022 00:00	2,869.0	0.0	2,869.0	104,000.0	298.4	0.4	0.2	0.6
05/09/2022 01:00	2,868.6	0.0	2,868.6	104,000.0	298.3	0.4	0.2	0.6
05/09/2022 02:00	2,874.4	0.0	2,874.4	104,000.0	298.9	0.4	0.2	0.6
05/09/2022 03:00	2,872.4	0.0	2,872.4	104,000.0	298.7	0.4	0.2	0.6
05/09/2022 04:00	2,885.0	0.0	2,885.0	104,000.0	300.0	0.4	0.2	0.6
05/09/2022 05:00	2,924.5	0.0	2,924.5	104,000.0	304.1	0.4	0.2	0.6
05/09/2022 06:00	2,858.3	0.0	2,858.3	104,000.0	297.3	0.4	0.2	0.6
05/09/2022 07:00	2,853.0	0.0	2,853.0	104,000.0	296.7	0.4	0.2	0.6
05/09/2022 08:00	2,851.3	0.0	2,851.3	104,000.0	296.5	0.4	0.2	0.6
05/09/2022 09:00	2,847.6	0.0	2,847.6	104,000.0	296.2	0.4	0.2	0.6
05/09/2022 10:00	2,856.5	0.0	2,856.5	104,000.0	297.1	0.4	0.2	0.6
05/09/2022 11:00	3,282.7	0.0	3,282.7	104,000.0	341.4	0.4	0.2	0.7
05/09/2022 12:00	3,047.8	0.0	3,047.8	104,000.0	317.0	0.4	0.2	0.6
05/09/2022 13:00	3,018.1	0.0	3,018.1	104,000.0	313.9	0.4	0.2	0.6
05/09/2022 14:00	3,038.4	0.0	3,038.4	104,000.0	316.0	0.4	0.2	0.6
05/09/2022 15:00	3,068.5	0.0	3,068.5	104,000.0	319.1	0.4	0.2	0.6
05/09/2022 16:00	3,050.4	0.0	3,050.4	104,000.0	317.2	0.4	0.2	0.6
05/09/2022 17:00	3,043.2	0.0	3,043.2	104,000.0	316.5	0.4	0.2	0.6
05/09/2022 18:00	3,074.7	0.0	3,074.7	104,000.0	319.8	0.4	0.2	0.6
05/09/2022 19:00	3,093.7	0.0	3,093.7	104,000.0	321.7	0.4	0.2	0.6
05/09/2022 20:00	3,086.9	0.0	3,086.9	104,000.0	321.0	0.4	0.2	0.6
05/09/2022 21:00	3,083.6	0.0	3,083.6	104,000.0	320.7	0.4	0.2	0.6
05/09/2022 22:00	3,080.2	0.0	3,080.2	104,000.0	320.3	0.4	0.2	0.6
05/09/2022 23:00	1,684.3	0.0	1,684.3	104,000.0	175.2	0.0	0.0	0.0
Average/Sum#:	2,925.5	0.0	2,925.5	104,000.0	304.3	0.4	0.2	0.6
Minimum:	1,684.3	0.0	1,684.3	104,000.0	175.2	0.4	0.2	0.6
Maximum:	3,282.7	0.0	3,282.7	104,000.0	341.4	0.4	0.2	0.7
%SI	0.00	0.00	0.00	0.00	0.00	4.17	4.17	4.17

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
05/10/2022 00:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/10/2022 01:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/10/2022 02:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/10/2022 03:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/10/2022 04:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/10/2022 05:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/10/2022 06:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/10/2022 07:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/10/2022 08:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/10/2022 09:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/10/2022 10:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/10/2022 11:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/10/2022 12:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/10/2022 13:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/10/2022 14:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/10/2022 15:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/10/2022 16:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/10/2022 17:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/10/2022 18:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/10/2022 19:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/10/2022 20:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/10/2022 21:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/10/2022 22:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/10/2022 23:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
Minimum:	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
Maximum:	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
05/11/2022 00:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/11/2022 01:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/11/2022 02:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/11/2022 03:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/11/2022 04:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/11/2022 05:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/11/2022 06:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/11/2022 07:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/11/2022 08:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/11/2022 09:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/11/2022 10:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/11/2022 11:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/11/2022 12:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/11/2022 13:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/11/2022 14:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/11/2022 15:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/11/2022 16:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/11/2022 17:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/11/2022 18:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/11/2022 19:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/11/2022 20:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/11/2022 21:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/11/2022 22:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/11/2022 23:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
Minimum:	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
Maximum:	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
05/12/2022 00:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/12/2022 01:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/12/2022 02:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/12/2022 03:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/12/2022 04:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/12/2022 05:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/12/2022 06:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/12/2022 07:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/12/2022 08:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/12/2022 09:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/12/2022 10:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/12/2022 11:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/12/2022 12:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/12/2022 13:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/12/2022 14:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/12/2022 15:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/12/2022 16:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/12/2022 17:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/12/2022 18:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/12/2022 19:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/12/2022 20:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/12/2022 21:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/12/2022 22:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/12/2022 23:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
Minimum:	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
Maximum:	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
05/13/2022 00:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/13/2022 01:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/13/2022 02:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/13/2022 03:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/13/2022 04:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/13/2022 05:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/13/2022 06:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/13/2022 07:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/13/2022 08:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/13/2022 09:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/13/2022 10:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/13/2022 11:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/13/2022 12:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/13/2022 13:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/13/2022 14:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/13/2022 15:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/13/2022 16:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/13/2022 17:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/13/2022 18:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/13/2022 19:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/13/2022 20:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/13/2022 21:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/13/2022 22:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/13/2022 23:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
Minimum:	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
Maximum:	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
05/14/2022 00:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/14/2022 01:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/14/2022 02:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/14/2022 03:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/14/2022 04:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/14/2022 05:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/14/2022 06:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/14/2022 07:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/14/2022 08:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/14/2022 09:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/14/2022 10:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/14/2022 11:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/14/2022 12:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/14/2022 13:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/14/2022 14:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/14/2022 15:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/14/2022 16:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/14/2022 17:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/14/2022 18:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/14/2022 19:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/14/2022 20:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/14/2022 21:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/14/2022 22:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/14/2022 23:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
Minimum:	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
Maximum:	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
05/15/2022 00:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/15/2022 01:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/15/2022 02:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/15/2022 03:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/15/2022 04:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/15/2022 05:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/15/2022 06:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/15/2022 07:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/15/2022 08:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/15/2022 09:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/15/2022 10:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/15/2022 11:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/15/2022 12:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/15/2022 13:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/15/2022 14:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/15/2022 15:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/15/2022 16:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/15/2022 17:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/15/2022 18:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/15/2022 19:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/15/2022 20:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/15/2022 21:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/15/2022 22:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/15/2022 23:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
Minimum:	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
Maximum:	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
05/16/2022 00:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/16/2022 01:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/16/2022 02:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/16/2022 03:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/16/2022 04:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/16/2022 05:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/16/2022 06:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/16/2022 07:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/16/2022 08:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/16/2022 09:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/16/2022 10:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/16/2022 11:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/16/2022 12:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/16/2022 13:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/16/2022 14:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/16/2022 15:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/16/2022 16:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/16/2022 17:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/16/2022 18:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/16/2022 19:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/16/2022 20:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/16/2022 21:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/16/2022 22:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/16/2022 23:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
Minimum:	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
Maximum:	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
05/17/2022 00:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/17/2022 01:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/17/2022 02:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/17/2022 03:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/17/2022 04:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/17/2022 05:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/17/2022 06:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/17/2022 07:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/17/2022 08:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/17/2022 09:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/17/2022 10:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/17/2022 11:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/17/2022 12:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/17/2022 13:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/17/2022 14:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/17/2022 15:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/17/2022 16:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/17/2022 17:00	2,691.6	0.0	2,691.6	104,000.0	279.9	0.0	0.0	0.0
05/17/2022 18:00	4,560.0	0.0	4,560.0	104,000.0	474.2	0.6	0.3	1.0
05/17/2022 19:00	4,643.8	328.8	4,913.4	104,000.0	511.0	0.6	0.3	1.0
05/17/2022 20:00	4,701.2	563.4	5,264.6	104,000.0	547.5	0.7	0.3	1.1
05/17/2022 21:00	4,730.2	671.5	5,401.7	104,000.0	561.8	0.7	0.3	1.1
05/17/2022 22:00	4,433.1	182.7	4,528.1	104,000.0	470.9	0.6	0.3	1.0
05/17/2022 23:00	2,799.1	0.0	2,799.1	104,000.0	291.1	0.4	0.2	0.6
Average/Sum#:	4,079.9	249.5	4,308.4	104,000.0	448.1	0.6	0.3	1.0
Minimum:	2,691.6	0.0	2,691.6	104,000.0	279.9	0.4	0.2	0.6
Maximum:	4,730.2	671.5	5,401.7	104,000.0	561.8	0.7	0.3	1.1
%SI	70.83	70.83	70.83	0.00	70.83	75.00	75.00	75.00

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
05/18/2022 00:00	2,810.3	0.0	2,810.3	104,000.0	292.3	0.4	0.2	0.6
05/18/2022 01:00	2,790.9	0.0	2,790.9	104,000.0	290.3	0.4	0.2	0.6
05/18/2022 02:00	3,770.9	2.6	3,771.0	104,000.0	392.2	0.5	0.2	0.8
05/18/2022 03:00	4,831.2	1,177.7	6,008.9	104,000.0	624.9	0.7	0.4	1.2
05/18/2022 04:00	4,847.3	1,954.4	6,801.7	104,000.0	707.4	0.8	0.4	1.4
05/18/2022 05:00	4,846.6	450.6	5,117.0	104,000.0	532.2	0.7	0.3	1.1
05/18/2022 06:00	3,905.5	0.0	3,905.5	104,000.0	406.2	0.5	0.2	0.8
05/18/2022 07:00	4,483.2	0.0	4,483.2	104,000.0	466.3	0.6	0.3	0.9
05/18/2022 08:00	4,791.7	0.0	4,791.7	104,000.0	498.3	0.6	0.3	1.0
05/18/2022 09:00	4,765.4	0.0	4,765.4	104,000.0	495.6	0.6	0.3	1.0
05/18/2022 10:00	4,732.5	105.8	4,762.1	104,000.0	495.3	0.6	0.3	1.0
05/18/2022 11:00	4,695.9	1,196.3	5,892.2	104,000.0	612.8	0.7	0.4	1.2
05/18/2022 12:00	4,658.5	110.9	4,733.9	104,000.0	492.3	0.6	0.3	1.0
05/18/2022 13:00	4,625.7	840.0	5,465.7	104,000.0	568.4	0.7	0.3	1.1
05/18/2022 14:00	4,605.8	1,702.4	6,308.2	104,000.0	656.1	0.8	0.4	1.3
05/18/2022 15:00	4,597.0	1,079.6	5,676.6	104,000.0	590.4	0.7	0.4	1.2
05/18/2022 16:00	4,604.6	567.3	5,171.9	104,000.0	537.9	0.6	0.3	1.1
05/18/2022 17:00	4,619.7	1,509.4	6,129.1	104,000.0	637.4	0.8	0.4	1.3
05/18/2022 18:00	4,630.9	1,184.1	5,815.0	104,000.0	604.8	0.7	0.4	1.2
05/18/2022 19:00	4,643.8	996.6	5,640.4	104,000.0	586.6	0.7	0.4	1.2
05/18/2022 20:00	4,662.9	1,438.3	6,101.2	104,000.0	634.5	0.8	0.4	1.3
05/18/2022 21:00	4,676.5	464.4	5,140.9	104,000.0	534.7	0.6	0.3	1.1
05/18/2022 22:00	4,701.1	414.5	5,115.6	104,000.0	532.0	0.6	0.3	1.1
05/18/2022 23:00	4,159.9	95.5	4,193.3	104,000.0	436.1	0.5	0.3	0.9
Average/Sum#:	4,435.7	637.1	5,058.0	104,000.0	526.0	0.6	0.3	1.1
Minimum:	2,790.9	0.0	2,790.9	104,000.0	290.3	0.4	0.2	0.6
Maximum:	4,847.3	1,954.4	6,801.7	104,000.0	707.4	0.8	0.4	1.4
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
05/19/2022 00:00	3,596.9	7.7	3,597.4	104,000.0	374.1	0.5	0.2	0.7
05/19/2022 01:00	3,403.1	0.0	3,403.1	104,000.0	353.9	0.4	0.2	0.7
05/19/2022 02:00	3,051.8	0.0	3,051.8	104,000.0	317.4	0.4	0.2	0.6
05/19/2022 03:00	4,218.7	54.3	4,243.1	104,000.0	441.3	0.5	0.3	0.9
05/19/2022 04:00	4,801.5	71.0	4,872.5	104,000.0	506.7	0.6	0.3	1.0
05/19/2022 05:00	4,808.9	132.2	4,941.1	104,000.0	513.9	0.6	0.3	1.0
05/19/2022 06:00	3,571.6	1.3	3,571.6	104,000.0	371.4	0.4	0.2	0.7
05/19/2022 07:00	3,466.5	0.0	3,466.5	104,000.0	360.5	0.4	0.2	0.7
05/19/2022 08:00	3,499.5	0.0	3,499.5	104,000.0	363.9	0.4	0.2	0.7
05/19/2022 09:00	3,045.8	0.0	3,045.8	104,000.0	316.8	0.4	0.2	0.6
05/19/2022 10:00	3,020.9	0.0	3,020.9	104,000.0	314.2	0.4	0.2	0.6
05/19/2022 11:00	4,618.2	75.5	4,680.9	104,000.0	486.8	0.6	0.3	1.0
05/19/2022 12:00	4,155.6	65.1	4,194.7	104,000.0	436.2	0.5	0.3	0.9
05/19/2022 13:00	3,969.7	3.3	3,969.8	104,000.0	412.9	0.5	0.2	0.8
05/19/2022 14:00	4,692.8	561.8	5,254.6	104,000.0	546.5	0.7	0.3	1.1
05/19/2022 15:00	4,089.2	100.6	4,127.4	104,000.0	429.2	0.5	0.3	0.9
05/19/2022 16:00	3,916.9	82.5	3,940.0	104,000.0	409.8	0.5	0.2	0.8
05/19/2022 17:00	4,696.2	353.5	5,049.7	104,000.0	525.2	0.6	0.3	1.1
05/19/2022 18:00	4,714.4	493.3	5,207.7	104,000.0	541.6	0.7	0.3	1.1
05/19/2022 19:00	4,737.6	637.6	5,375.2	104,000.0	559.0	0.7	0.3	1.1
05/19/2022 20:00	4,756.2	1,048.4	5,804.6	104,000.0	603.7	0.7	0.4	1.2
05/19/2022 21:00	4,780.0	419.8	5,199.8	104,000.0	540.8	0.6	0.3	1.1
05/19/2022 22:00	4,231.2	28.0	4,238.2	104,000.0	440.8	0.5	0.3	0.9
05/19/2022 23:00	2,351.1	0.0	2,351.1	104,000.0	244.5	0.0	0.0	0.0
Average/Sum#:	4,008.1	172.3	4,171.1	104,000.0	433.8	0.5	0.3	0.9
Minimum:	2,351.1	0.0	2,351.1	104,000.0	244.5	0.4	0.2	0.6
Maximum:	4,808.9	1,048.4	5,804.6	104,000.0	603.7	0.7	0.4	1.2
%SI	0.00	0.00	0.00	0.00	0.00	4.17	4.17	4.17

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
05/20/2022 00:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/20/2022 01:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/20/2022 02:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/20/2022 03:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/20/2022 04:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/20/2022 05:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/20/2022 06:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/20/2022 07:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/20/2022 08:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/20/2022 09:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/20/2022 10:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/20/2022 11:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/20/2022 12:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/20/2022 13:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/20/2022 14:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/20/2022 15:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/20/2022 16:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/20/2022 17:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/20/2022 18:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/20/2022 19:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/20/2022 20:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/20/2022 21:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/20/2022 22:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/20/2022 23:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
Minimum:	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
Maximum:	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
05/21/2022 00:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/21/2022 01:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/21/2022 02:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/21/2022 03:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/21/2022 04:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/21/2022 05:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/21/2022 06:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/21/2022 07:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/21/2022 08:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/21/2022 09:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/21/2022 10:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/21/2022 11:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/21/2022 12:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/21/2022 13:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/21/2022 14:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/21/2022 15:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/21/2022 16:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/21/2022 17:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/21/2022 18:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/21/2022 19:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/21/2022 20:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/21/2022 21:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/21/2022 22:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/21/2022 23:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
Minimum:	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
Maximum:	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
05/22/2022 00:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/22/2022 01:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/22/2022 02:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/22/2022 03:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/22/2022 04:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/22/2022 05:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/22/2022 06:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/22/2022 07:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/22/2022 08:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/22/2022 09:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/22/2022 10:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/22/2022 11:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/22/2022 12:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/22/2022 13:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/22/2022 14:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/22/2022 15:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/22/2022 16:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/22/2022 17:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/22/2022 18:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/22/2022 19:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/22/2022 20:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/22/2022 21:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/22/2022 22:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/22/2022 23:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
Minimum:	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
Maximum:	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
05/23/2022 00:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/23/2022 01:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/23/2022 02:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/23/2022 03:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/23/2022 04:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/23/2022 05:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/23/2022 06:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/23/2022 07:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/23/2022 08:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/23/2022 09:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/23/2022 10:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/23/2022 11:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/23/2022 12:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/23/2022 13:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/23/2022 14:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/23/2022 15:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/23/2022 16:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/23/2022 17:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/23/2022 18:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/23/2022 19:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/23/2022 20:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/23/2022 21:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/23/2022 22:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/23/2022 23:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
Minimum:	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
Maximum:	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
05/24/2022 00:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/24/2022 01:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/24/2022 02:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/24/2022 03:00	1,913.8	0.0	1,913.8	104,000.0	199.0	0.0	0.0	0.0
05/24/2022 04:00	2,999.8	0.0	2,999.8	104,000.0	312.0	0.4	0.2	0.6
05/24/2022 05:00	3,142.8	0.0	3,142.8	104,000.0	326.9	0.4	0.2	0.7
05/24/2022 06:00	3,099.2	0.0	3,099.2	104,000.0	322.3	0.4	0.2	0.6
05/24/2022 07:00	4,070.6	28.8	4,083.6	104,000.0	424.7	0.5	0.3	0.9
05/24/2022 08:00	3,980.2	34.2	3,993.2	104,000.0	415.3	0.5	0.3	0.8
05/24/2022 09:00	2,953.3	0.0	2,953.3	104,000.0	307.1	0.4	0.2	0.6
05/24/2022 10:00	3,713.5	1.9	3,713.6	104,000.0	386.2	0.5	0.2	0.8
05/24/2022 11:00	4,016.6	0.0	4,016.6	104,000.0	417.7	0.5	0.3	0.8
05/24/2022 12:00	4,566.6	125.2	4,610.4	104,000.0	479.5	0.6	0.3	1.0
05/24/2022 13:00	4,605.4	745.0	5,350.4	104,000.0	556.4	0.7	0.3	1.1
05/24/2022 14:00	4,585.9	1,526.2	6,112.1	104,000.0	635.7	0.8	0.4	1.3
05/24/2022 15:00	4,580.2	1,926.4	6,506.6	104,000.0	676.7	0.8	0.4	1.4
05/24/2022 16:00	4,576.1	1,572.6	6,148.7	104,000.0	639.5	0.8	0.4	1.3
05/24/2022 17:00	4,569.3	1,182.0	5,751.3	104,000.0	598.1	0.7	0.4	1.2
05/24/2022 18:00	4,567.5	1,932.8	6,500.3	104,000.0	676.0	0.8	0.4	1.4
05/24/2022 19:00	4,569.7	1,703.6	6,273.3	104,000.0	652.4	0.8	0.4	1.3
05/24/2022 20:00	4,606.3	923.9	5,530.2	104,000.0	575.1	0.7	0.3	1.2
05/24/2022 21:00	4,627.8	758.6	5,386.4	104,000.0	560.2	0.7	0.3	1.1
05/24/2022 22:00	4,659.6	1,133.5	5,793.1	104,000.0	602.5	0.7	0.4	1.2
05/24/2022 23:00	3,995.2	88.2	4,028.7	104,000.0	419.0	0.5	0.3	0.8
Average/Sum#:	4,019.0	651.6	4,662.3	104,000.0	484.9	0.6	0.3	1.0
Minimum:	1,913.8	0.0	1,913.8	104,000.0	199.0	0.4	0.2	0.6
Maximum:	4,659.6	1,932.8	6,506.6	104,000.0	676.7	0.8	0.4	1.4
%SI	12.50	12.50	12.50	0.00	12.50	16.67	16.67	16.67

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
05/25/2022 00:00	4,015.0	0.0	4,015.0	104,000.0	417.6	0.5	0.3	0.8
05/25/2022 01:00	3,241.8	0.0	3,241.8	104,000.0	337.1	0.4	0.2	0.7
05/25/2022 02:00	2,970.0	0.0	2,970.0	104,000.0	308.9	0.4	0.2	0.6
05/25/2022 03:00	3,945.3	106.0	3,982.4	104,000.0	414.2	0.5	0.3	0.8
05/25/2022 04:00	4,752.0	234.1	4,986.1	104,000.0	518.6	0.6	0.3	1.0
05/25/2022 05:00	4,640.1	53.3	4,654.5	104,000.0	484.1	0.6	0.3	1.0
05/25/2022 06:00	4,732.5	245.9	4,973.5	104,000.0	517.2	0.6	0.3	1.0
05/25/2022 07:00	3,888.9	69.1	3,907.6	104,000.0	406.4	0.5	0.2	0.8
05/25/2022 08:00	2,814.1	0.0	2,814.1	104,000.0	292.7	0.4	0.2	0.6
05/25/2022 09:00	3,744.2	0.0	3,744.2	104,000.0	389.4	0.5	0.2	0.8
05/25/2022 10:00	4,599.4	99.6	4,634.3	104,000.0	482.0	0.6	0.3	1.0
05/25/2022 11:00	4,589.3	1,726.4	6,315.7	104,000.0	656.8	0.8	0.4	1.3
05/25/2022 12:00	4,577.7	2,006.0	6,583.7	104,000.0	684.7	0.8	0.4	1.4
05/25/2022 13:00	4,559.9	2,002.2	6,562.1	104,000.0	682.5	0.8	0.4	1.4
05/25/2022 14:00	4,554.4	2,001.2	6,555.6	104,000.0	681.8	0.8	0.4	1.4
05/25/2022 15:00	4,546.4	1,993.4	6,539.8	104,000.0	680.1	0.8	0.4	1.4
05/25/2022 16:00	4,539.4	1,994.2	6,533.6	104,000.0	679.5	0.8	0.4	1.4
05/25/2022 17:00	4,536.7	1,921.8	6,458.5	104,000.0	671.7	0.8	0.4	1.3
05/25/2022 18:00	4,543.2	1,956.0	6,499.2	104,000.0	675.9	0.8	0.4	1.4
05/25/2022 19:00	4,572.5	1,059.3	5,631.8	104,000.0	585.7	0.7	0.4	1.2
05/25/2022 20:00	4,593.7	520.2	5,113.9	104,000.0	531.8	0.6	0.3	1.1
05/25/2022 21:00	4,625.3	605.6	5,230.9	104,000.0	544.0	0.7	0.3	1.1
05/25/2022 22:00	3,894.5	111.1	3,924.5	104,000.0	408.1	0.5	0.2	0.8
05/25/2022 23:00	2,584.4	0.0	2,584.4	104,000.0	268.8	0.4	0.2	0.6
Average/Sum#:	4,169.2	779.4	4,935.7	104,000.0	513.3	0.6	0.3	1.0
Minimum:	2,584.4	0.0	2,584.4	104,000.0	268.8	0.4	0.2	0.6
Maximum:	4,752.0	2,006.0	6,583.7	104,000.0	684.7	0.8	0.4	1.4
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
05/26/2022 00:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/26/2022 01:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/26/2022 02:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/26/2022 03:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/26/2022 04:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/26/2022 05:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/26/2022 06:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/26/2022 07:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/26/2022 08:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/26/2022 09:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/26/2022 10:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/26/2022 11:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/26/2022 12:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/26/2022 13:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/26/2022 14:00	582.7	0.0	582.7	104,000.0	60.6	0.0	0.0	0.0
05/26/2022 15:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/26/2022 16:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/26/2022 17:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/26/2022 18:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/26/2022 19:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/26/2022 20:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/26/2022 21:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/26/2022 22:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/26/2022 23:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
Average/Sum#:	582.7	0.0	582.7	104,000.0	60.6	0.0	0.0	0.0
Minimum:	582.7	0.0	582.7	104,000.0	60.6	0.0	0.0	0.0
Maximum:	582.7	0.0	582.7	104,000.0	60.6	0.0	0.0	0.0
%SI	95.83	95.83	95.83	0.00	95.83	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
05/27/2022 00:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/27/2022 01:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/27/2022 02:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/27/2022 03:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/27/2022 04:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/27/2022 05:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/27/2022 06:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/27/2022 07:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/27/2022 08:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/27/2022 09:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/27/2022 10:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/27/2022 11:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/27/2022 12:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/27/2022 13:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/27/2022 14:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/27/2022 15:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/27/2022 16:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/27/2022 17:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/27/2022 18:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/27/2022 19:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/27/2022 20:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/27/2022 21:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/27/2022 22:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/27/2022 23:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
Minimum:	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
Maximum:	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
05/28/2022 00:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/28/2022 01:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/28/2022 02:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/28/2022 03:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/28/2022 04:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/28/2022 05:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/28/2022 06:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/28/2022 07:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/28/2022 08:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/28/2022 09:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/28/2022 10:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/28/2022 11:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/28/2022 12:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/28/2022 13:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/28/2022 14:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/28/2022 15:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/28/2022 16:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/28/2022 17:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/28/2022 18:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/28/2022 19:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/28/2022 20:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/28/2022 21:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/28/2022 22:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/28/2022 23:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
Minimum:	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
Maximum:	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
05/29/2022 00:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/29/2022 01:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/29/2022 02:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/29/2022 03:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/29/2022 04:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/29/2022 05:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/29/2022 06:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/29/2022 07:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/29/2022 08:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/29/2022 09:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/29/2022 10:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/29/2022 11:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/29/2022 12:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/29/2022 13:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/29/2022 14:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/29/2022 15:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/29/2022 16:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/29/2022 17:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/29/2022 18:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/29/2022 19:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/29/2022 20:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/29/2022 21:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/29/2022 22:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/29/2022 23:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
Minimum:	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
Maximum:	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
05/30/2022 00:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/30/2022 01:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/30/2022 02:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/30/2022 03:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/30/2022 04:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/30/2022 05:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/30/2022 06:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/30/2022 07:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/30/2022 08:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/30/2022 09:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/30/2022 10:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/30/2022 11:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/30/2022 12:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/30/2022 13:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/30/2022 14:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/30/2022 15:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/30/2022 16:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/30/2022 17:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/30/2022 18:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/30/2022 19:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/30/2022 20:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/30/2022 21:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/30/2022 22:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/30/2022 23:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
Minimum:	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
Maximum:	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
05/31/2022 00:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/31/2022 01:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/31/2022 02:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/31/2022 03:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/31/2022 04:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/31/2022 05:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/31/2022 06:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/31/2022 07:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/31/2022 08:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/31/2022 09:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/31/2022 10:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/31/2022 11:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/31/2022 12:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/31/2022 13:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/31/2022 14:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/31/2022 15:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/31/2022 16:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/31/2022 17:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/31/2022 18:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/31/2022 19:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/31/2022 20:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/31/2022 21:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/31/2022 22:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
05/31/2022 23:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
Minimum:	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
Maximum:	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
06/01/2022 00:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
06/01/2022 01:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
06/01/2022 02:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
06/01/2022 03:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
06/01/2022 04:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
06/01/2022 05:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
06/01/2022 06:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
06/01/2022 07:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
06/01/2022 08:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
06/01/2022 09:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
06/01/2022 10:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
06/01/2022 11:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
06/01/2022 12:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
06/01/2022 13:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
06/01/2022 14:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
06/01/2022 15:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
06/01/2022 16:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
06/01/2022 17:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
06/01/2022 18:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
06/01/2022 19:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
06/01/2022 20:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
06/01/2022 21:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
06/01/2022 22:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
06/01/2022 23:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
Minimum:	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
Maximum:	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
06/02/2022 00:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
06/02/2022 01:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
06/02/2022 02:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
06/02/2022 03:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
06/02/2022 04:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
06/02/2022 05:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
06/02/2022 06:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
06/02/2022 07:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
06/02/2022 08:00	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
06/02/2022 09:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/02/2022 10:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/02/2022 11:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/02/2022 12:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/02/2022 13:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/02/2022 14:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/02/2022 15:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/02/2022 16:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/02/2022 17:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/02/2022 18:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/02/2022 19:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/02/2022 20:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/02/2022 21:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/02/2022 22:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/02/2022 23:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	104,625.0	0.0	0.0	0.0	0.0
Minimum:	0.0	0.0	0.0	104,000.0	0.0	0.0	0.0	0.0
Maximum:	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
06/03/2022 00:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/03/2022 01:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/03/2022 02:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/03/2022 03:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/03/2022 04:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/03/2022 05:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/03/2022 06:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/03/2022 07:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/03/2022 08:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/03/2022 09:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/03/2022 10:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/03/2022 11:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/03/2022 12:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/03/2022 13:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/03/2022 14:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/03/2022 15:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/03/2022 16:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/03/2022 17:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/03/2022 18:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/03/2022 19:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/03/2022 20:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/03/2022 21:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/03/2022 22:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/03/2022 23:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
Minimum:	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
Maximum:	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
06/04/2022 00:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/04/2022 01:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/04/2022 02:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/04/2022 03:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/04/2022 04:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/04/2022 05:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/04/2022 06:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/04/2022 07:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/04/2022 08:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/04/2022 09:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/04/2022 10:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/04/2022 11:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/04/2022 12:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/04/2022 13:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/04/2022 14:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/04/2022 15:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/04/2022 16:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/04/2022 17:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/04/2022 18:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/04/2022 19:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/04/2022 20:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/04/2022 21:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/04/2022 22:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/04/2022 23:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
Minimum:	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
Maximum:	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
06/05/2022 00:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/05/2022 01:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/05/2022 02:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/05/2022 03:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/05/2022 04:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/05/2022 05:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/05/2022 06:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/05/2022 07:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/05/2022 08:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/05/2022 09:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/05/2022 10:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/05/2022 11:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/05/2022 12:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/05/2022 13:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/05/2022 14:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/05/2022 15:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/05/2022 16:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/05/2022 17:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/05/2022 18:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/05/2022 19:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/05/2022 20:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/05/2022 21:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/05/2022 22:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/05/2022 23:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
Minimum:	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
Maximum:	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
06/06/2022 00:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/06/2022 01:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/06/2022 02:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/06/2022 03:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/06/2022 04:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/06/2022 05:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/06/2022 06:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/06/2022 07:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/06/2022 08:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/06/2022 09:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/06/2022 10:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/06/2022 11:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/06/2022 12:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/06/2022 13:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/06/2022 14:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/06/2022 15:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/06/2022 16:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/06/2022 17:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/06/2022 18:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/06/2022 19:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/06/2022 20:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/06/2022 21:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/06/2022 22:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/06/2022 23:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
Minimum:	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
Maximum:	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
06/07/2022 00:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/07/2022 01:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/07/2022 02:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/07/2022 03:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/07/2022 04:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/07/2022 05:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/07/2022 06:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/07/2022 07:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/07/2022 08:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/07/2022 09:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/07/2022 10:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/07/2022 11:00	2,031.4	0.0	2,031.4	105,000.0	213.3	0.0	0.0	0.0
06/07/2022 12:00	3,028.0	0.0	3,028.0	105,000.0	317.9	0.0	0.0	0.0
06/07/2022 13:00	3,170.6	0.0	3,170.6	105,000.0	332.9	0.5	0.2	0.8
06/07/2022 14:00	3,716.0	0.0	3,716.0	105,000.0	390.2	0.5	0.2	0.8
06/07/2022 15:00	3,893.8	0.0	3,893.8	105,000.0	408.8	0.5	0.2	0.8
06/07/2022 16:00	3,897.2	0.0	3,897.2	105,000.0	409.2	0.5	0.2	0.8
06/07/2022 17:00	3,904.2	0.0	3,904.2	105,000.0	409.9	0.5	0.2	0.8
06/07/2022 18:00	3,906.6	0.0	3,906.6	105,000.0	410.2	0.5	0.2	0.8
06/07/2022 19:00	3,823.3	0.0	3,823.3	105,000.0	401.4	0.5	0.2	0.8
06/07/2022 20:00	1,976.9	0.0	1,976.9	105,000.0	207.6	0.0	0.0	0.0
06/07/2022 21:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/07/2022 22:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/07/2022 23:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
Average/Sum#:	3,334.8	0.0	3,334.8	105,000.0	350.1	0.5	0.2	0.8
Minimum:	1,976.9	0.0	1,976.9	105,000.0	207.6	0.5	0.2	0.8
Maximum:	3,906.6	0.0	3,906.6	105,000.0	410.2	0.5	0.2	0.8
%SI	58.33	58.33	58.33	0.00	58.33	70.83	70.83	70.83

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
06/08/2022 00:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/08/2022 01:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/08/2022 02:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/08/2022 03:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/08/2022 04:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/08/2022 05:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/08/2022 06:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/08/2022 07:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/08/2022 08:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/08/2022 09:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/08/2022 10:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/08/2022 11:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/08/2022 12:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/08/2022 13:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/08/2022 14:00	3,243.3	0.0	3,243.3	105,000.0	340.5	0.6	0.3	1.0
06/08/2022 15:00	4,462.3	0.0	4,462.3	105,000.0	468.5	0.6	0.3	0.9
06/08/2022 16:00	4,514.4	53.8	4,531.6	105,000.0	475.8	0.6	0.3	1.0
06/08/2022 17:00	4,599.3	929.3	5,528.6	105,000.0	580.5	0.7	0.3	1.2
06/08/2022 18:00	4,622.6	1,937.2	6,559.8	105,000.0	688.8	0.8	0.4	1.4
06/08/2022 19:00	4,654.3	1,397.3	6,051.6	105,000.0	635.4	0.8	0.4	1.3
06/08/2022 20:00	4,679.4	714.8	5,394.2	105,000.0	566.4	0.7	0.3	1.1
06/08/2022 21:00	4,700.2	392.3	5,092.5	105,000.0	534.7	0.6	0.3	1.1
06/08/2022 22:00	4,721.6	315.4	5,037.0	105,000.0	528.9	0.6	0.3	1.1
06/08/2022 23:00	4,729.1	453.2	5,182.3	105,000.0	544.1	0.7	0.3	1.1
Average/Sum#:	4,492.7	619.3	5,108.3	105,000.0	536.4	0.7	0.3	1.1
Minimum:	3,243.3	0.0	3,243.3	105,000.0	340.5	0.6	0.3	0.9
Maximum:	4,729.1	1,937.2	6,559.8	105,000.0	688.8	0.8	0.4	1.4
%SI	58.33	58.33	58.33	0.00	58.33	58.33	58.33	58.33

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
06/09/2022 00:00	4,744.0	427.5	5,171.5	105,000.0	543.0	0.7	0.3	1.1
06/09/2022 01:00	4,752.7	354.3	5,107.0	105,000.0	536.2	0.6	0.3	1.1
06/09/2022 02:00	3,897.0	67.2	3,919.2	105,000.0	411.5	0.5	0.3	0.9
06/09/2022 03:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/09/2022 04:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/09/2022 05:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/09/2022 06:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/09/2022 07:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/09/2022 08:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/09/2022 09:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/09/2022 10:00	1,907.9	0.0	1,907.9	105,000.0	200.3	0.0	0.0	0.0
06/09/2022 11:00	3,034.4	0.0	3,034.4	105,000.0	318.6	0.4	0.2	0.6
06/09/2022 12:00	2,854.9	0.0	2,854.9	105,000.0	299.8	0.4	0.2	0.6
06/09/2022 13:00	3,880.2	0.0	3,880.2	105,000.0	407.4	0.5	0.2	0.8
06/09/2022 14:00	4,421.1	396.5	4,631.2	105,000.0	486.3	0.6	0.3	1.0
06/09/2022 15:00	4,581.9	778.6	5,360.5	105,000.0	562.9	0.7	0.3	1.1
06/09/2022 16:00	4,129.4	118.7	4,161.4	105,000.0	436.9	0.5	0.3	0.9
06/09/2022 17:00	4,572.6	836.8	5,225.3	105,000.0	548.7	0.7	0.3	1.1
06/09/2022 18:00	4,575.5	826.8	5,402.3	105,000.0	567.2	0.7	0.3	1.1
06/09/2022 19:00	4,591.1	503.2	5,094.3	105,000.0	534.9	0.6	0.3	1.1
06/09/2022 20:00	4,625.4	952.9	5,578.3	105,000.0	585.7	0.7	0.4	1.2
06/09/2022 21:00	4,636.9	679.4	5,316.3	105,000.0	558.2	0.7	0.3	1.1
06/09/2022 22:00	4,633.7	109.8	4,666.6	105,000.0	490.0	0.6	0.3	1.0
06/09/2022 23:00	4,652.8	563.7	5,216.5	105,000.0	547.7	0.7	0.3	1.1
Average/Sum#:	4,146.6	389.1	4,501.6	105,000.0	472.7	0.6	0.3	1.0
Minimum:	1,907.9	0.0	1,907.9	105,000.0	200.3	0.4	0.2	0.6
Maximum:	4,752.7	952.9	5,578.3	105,000.0	585.7	0.7	0.4	1.2
%SI	29.17	29.17	29.17	0.00	29.17	33.33	33.33	33.33

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
06/10/2022 00:00	4,672.4	370.0	5,042.4	105,000.0	529.5	0.6	0.3	1.1
06/10/2022 01:00	4,681.3	352.5	5,033.8	105,000.0	528.5	0.6	0.3	1.1
06/10/2022 02:00	4,701.6	323.7	5,025.3	105,000.0	527.7	0.6	0.3	1.1
06/10/2022 03:00	4,725.0	292.7	5,017.7	105,000.0	526.9	0.6	0.3	1.1
06/10/2022 04:00	4,736.1	278.3	5,014.4	105,000.0	526.5	0.6	0.3	1.1
06/10/2022 05:00	4,730.1	534.9	5,265.0	105,000.0	552.8	0.7	0.3	1.1
06/10/2022 06:00	4,692.0	165.7	4,791.4	105,000.0	503.1	0.6	0.3	1.0
06/10/2022 07:00	4,671.3	0.0	4,671.3	105,000.0	490.5	0.6	0.3	1.0
06/10/2022 08:00	4,648.6	0.0	4,648.6	105,000.0	488.1	0.6	0.3	1.0
06/10/2022 09:00	4,628.2	0.0	4,628.2	105,000.0	486.0	0.6	0.3	1.0
06/10/2022 10:00	4,612.6	106.2	4,679.5	105,000.0	491.3	0.6	0.3	1.0
06/10/2022 11:00	4,588.0	531.2	5,119.2	105,000.0	537.5	0.6	0.3	1.1
06/10/2022 12:00	4,577.1	851.3	5,428.4	105,000.0	570.0	0.7	0.3	1.1
06/10/2022 13:00	4,574.5	1,264.9	5,839.4	105,000.0	613.1	0.7	0.4	1.2
06/10/2022 14:00	4,561.9	1,709.0	6,270.9	105,000.0	658.4	0.8	0.4	1.3
06/10/2022 15:00	4,561.4	1,612.7	6,174.1	105,000.0	648.3	0.8	0.4	1.3
06/10/2022 16:00	4,548.5	358.5	4,763.6	105,000.0	500.2	0.6	0.3	1.0
06/10/2022 17:00	4,542.4	1,778.6	6,321.0	105,000.0	663.7	0.8	0.4	1.3
06/10/2022 18:00	4,531.1	1,767.3	6,298.4	105,000.0	661.3	0.8	0.4	1.3
06/10/2022 19:00	4,577.0	1,401.3	5,978.3	105,000.0	627.7	0.8	0.4	1.3
06/10/2022 20:00	4,616.4	938.8	5,555.2	105,000.0	583.3	0.7	0.3	1.2
06/10/2022 21:00	4,651.9	995.4	5,647.3	105,000.0	593.0	0.7	0.4	1.2
06/10/2022 22:00	4,640.6	190.9	4,739.9	105,000.0	497.7	0.6	0.3	1.0
06/10/2022 23:00	2,359.0	0.0	2,359.0	105,000.0	247.7	0.0	0.0	0.0
Average/Sum#:	4,534.5	659.3	5,179.7	105,000.0	543.9	0.7	0.3	1.1
Minimum:	2,359.0	0.0	2,359.0	105,000.0	247.7	0.6	0.3	1.0
Maximum:	4,736.1	1,778.6	6,321.0	105,000.0	663.7	0.8	0.4	1.3
%SI	0.00	0.00	0.00	0.00	0.00	4.17	4.17	4.17

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
06/11/2022 00:00	1,470.6	0.0	1,470.6	105,000.0	154.4	0.0	0.0	0.0
06/11/2022 01:00	2,913.0	0.0	2,913.0	105,000.0	305.9	0.4	0.2	0.6
06/11/2022 02:00	2,875.6	0.0	2,875.6	105,000.0	301.9	0.4	0.2	0.6
06/11/2022 03:00	2,879.6	0.0	2,879.6	105,000.0	302.4	0.4	0.2	0.6
06/11/2022 04:00	2,835.2	0.0	2,835.2	105,000.0	297.7	0.4	0.2	0.6
06/11/2022 05:00	2,836.3	0.0	2,836.3	105,000.0	297.8	0.4	0.2	0.6
06/11/2022 06:00	2,837.8	0.0	2,837.8	105,000.0	298.0	0.4	0.2	0.6
06/11/2022 07:00	2,831.1	0.0	2,831.1	105,000.0	297.3	0.4	0.2	0.6
06/11/2022 08:00	2,880.2	0.0	2,880.2	105,000.0	302.4	0.4	0.2	0.6
06/11/2022 09:00	2,931.9	0.0	2,931.9	105,000.0	307.8	0.4	0.2	0.6
06/11/2022 10:00	3,876.0	0.0	3,876.0	105,000.0	407.0	0.5	0.2	0.8
06/11/2022 11:00	4,103.7	0.0	4,103.7	105,000.0	430.9	0.5	0.3	0.9
06/11/2022 12:00	4,582.4	286.6	4,854.7	105,000.0	509.7	0.6	0.3	1.0
06/11/2022 13:00	4,567.3	1,148.4	5,715.7	105,000.0	600.1	0.7	0.4	1.2
06/11/2022 14:00	4,548.3	1,267.9	5,816.2	105,000.0	610.7	0.7	0.4	1.2
06/11/2022 15:00	4,530.9	1,218.7	5,749.6	105,000.0	603.7	0.7	0.4	1.2
06/11/2022 16:00	4,531.0	1,108.0	5,639.0	105,000.0	592.1	0.7	0.4	1.2
06/11/2022 17:00	4,530.2	1,508.4	6,038.6	105,000.0	634.1	0.8	0.4	1.3
06/11/2022 18:00	4,539.8	1,925.6	6,465.4	105,000.0	678.9	0.8	0.4	1.4
06/11/2022 19:00	4,557.9	1,863.3	6,421.2	105,000.0	674.2	0.8	0.4	1.3
06/11/2022 20:00	4,576.4	1,669.0	6,245.4	105,000.0	655.8	0.8	0.4	1.3
06/11/2022 21:00	4,615.0	1,632.1	6,247.1	105,000.0	655.9	0.8	0.4	1.3
06/11/2022 22:00	4,622.7	414.5	4,975.0	105,000.0	522.4	0.6	0.3	1.1
06/11/2022 23:00	4,287.8	71.1	4,316.2	105,000.0	453.2	0.5	0.3	0.9
Average/Sum#:	3,740.0	588.1	4,323.1	105,000.0	453.9	0.6	0.3	0.9
Minimum:	1,470.6	0.0	1,470.6	105,000.0	154.4	0.4	0.2	0.6
Maximum:	4,622.7	1,925.6	6,465.4	105,000.0	678.9	0.8	0.4	1.4
%SI	0.00	0.00	0.00	0.00	0.00	4.17	4.17	4.17

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
06/12/2022 00:00	4,668.6	786.6	5,455.2	105,000.0	572.8	0.7	0.3	1.1
06/12/2022 01:00	3,934.3	119.2	3,978.4	105,000.0	417.7	0.5	0.3	0.9
06/12/2022 02:00	1,223.3	0.0	1,223.3	105,000.0	128.4	0.0	0.0	0.0
06/12/2022 03:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/12/2022 04:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/12/2022 05:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/12/2022 06:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/12/2022 07:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/12/2022 08:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/12/2022 09:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/12/2022 10:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/12/2022 11:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/12/2022 12:00	2,788.2	0.0	2,788.2	105,000.0	292.8	0.0	0.0	0.0
06/12/2022 13:00	4,520.7	162.9	4,639.6	105,000.0	487.2	0.6	0.3	1.0
06/12/2022 14:00	4,599.6	177.0	4,776.6	105,000.0	501.5	0.6	0.3	1.0
06/12/2022 15:00	4,618.6	323.5	4,942.1	105,000.0	518.9	0.6	0.3	1.0
06/12/2022 16:00	4,622.0	438.7	5,060.7	105,000.0	531.4	0.6	0.3	1.1
06/12/2022 17:00	4,639.9	467.0	5,106.9	105,000.0	536.2	0.6	0.3	1.1
06/12/2022 18:00	4,669.0	496.9	5,165.9	105,000.0	542.4	0.7	0.3	1.1
06/12/2022 19:00	4,714.8	275.5	4,990.3	105,000.0	524.0	0.6	0.3	1.0
06/12/2022 20:00	4,753.1	266.8	5,019.9	105,000.0	527.1	0.6	0.3	1.1
06/12/2022 21:00	4,761.1	196.4	4,957.5	105,000.0	520.5	0.6	0.3	1.0
06/12/2022 22:00	4,770.9	179.3	4,950.2	105,000.0	519.8	0.6	0.3	1.0
06/12/2022 23:00	3,781.2	0.6	3,781.2	105,000.0	397.0	0.5	0.2	0.8
Average/Sum#:	4,204.4	259.4	4,455.7	105,000.0	467.8	0.6	0.3	1.0
Minimum:	1,223.3	0.0	1,223.3	105,000.0	128.4	0.5	0.2	0.8
Maximum:	4,770.9	786.6	5,455.2	105,000.0	572.8	0.7	0.3	1.1
%SI	37.50	37.50	37.50	0.00	37.50	45.83	45.83	45.83

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
06/13/2022 00:00	1,357.4	0.0	1,357.4	105,000.0	142.5	0.0	0.0	0.0
06/13/2022 01:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/13/2022 02:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/13/2022 03:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/13/2022 04:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/13/2022 05:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/13/2022 06:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/13/2022 07:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/13/2022 08:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/13/2022 09:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/13/2022 10:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/13/2022 11:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/13/2022 12:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/13/2022 13:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/13/2022 14:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/13/2022 15:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/13/2022 16:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/13/2022 17:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/13/2022 18:00	2,599.1	0.0	2,599.1	105,000.0	272.9	0.0	0.0	0.0
06/13/2022 19:00	4,225.6	120.8	4,289.6	105,000.0	450.4	0.6	0.3	0.9
06/13/2022 20:00	4,797.0	120.6	4,889.9	105,000.0	513.4	0.6	0.3	1.0
06/13/2022 21:00	3,111.6	0.0	3,111.6	105,000.0	326.7	0.4	0.2	0.7
06/13/2022 22:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/13/2022 23:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
Average/Sum#:	3,218.1	48.3	3,249.5	105,000.0	341.2	0.5	0.3	0.9
Minimum:	1,357.4	0.0	1,357.4	105,000.0	142.5	0.4	0.2	0.7
Maximum:	4,797.0	120.8	4,889.9	105,000.0	513.4	0.6	0.3	1.0
%SI	79.17	79.17	79.17	0.00	79.17	87.50	87.50	87.50

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
06/14/2022 00:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/14/2022 01:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/14/2022 02:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/14/2022 03:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/14/2022 04:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/14/2022 05:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/14/2022 06:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/14/2022 07:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/14/2022 08:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/14/2022 09:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/14/2022 10:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/14/2022 11:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/14/2022 12:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/14/2022 13:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/14/2022 14:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/14/2022 15:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/14/2022 16:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/14/2022 17:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/14/2022 18:00	2,630.7	0.0	2,630.7	105,000.0	276.2	0.5	0.2	0.8
06/14/2022 19:00	4,585.0	253.3	4,719.2	105,000.0	495.5	0.6	0.3	1.0
06/14/2022 20:00	4,678.3	275.0	4,890.1	105,000.0	513.5	0.6	0.3	1.0
06/14/2022 21:00	4,190.0	0.0	4,190.0	105,000.0	440.0	0.5	0.3	0.9
06/14/2022 22:00	4,625.7	96.1	4,676.6	105,000.0	491.0	0.6	0.3	1.0
06/14/2022 23:00	4,783.4	282.6	5,066.0	105,000.0	531.9	0.6	0.3	1.1
Average/Sum#:	4,248.9	151.2	4,362.1	105,000.0	458.0	0.6	0.3	1.0
Minimum:	2,630.7	0.0	2,630.7	105,000.0	276.2	0.5	0.2	0.8
Maximum:	4,783.4	282.6	5,066.0	105,000.0	531.9	0.6	0.3	1.1
%SI	75.00	75.00	75.00	0.00	75.00	75.00	75.00	75.00

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
06/15/2022 00:00	4,788.0	298.6	5,086.6	105,000.0	534.1	0.6	0.3	1.1
06/15/2022 01:00	4,807.3	202.8	5,010.1	105,000.0	526.1	0.6	0.3	1.1
06/15/2022 02:00	4,556.4	28.7	4,563.6	105,000.0	479.2	0.6	0.3	1.0
06/15/2022 03:00	4,833.1	264.7	5,097.8	105,000.0	535.3	0.6	0.3	1.1
06/15/2022 04:00	4,859.2	928.4	5,787.6	105,000.0	607.7	0.7	0.4	1.2
06/15/2022 05:00	4,470.7	114.4	4,530.2	105,000.0	475.7	0.6	0.3	1.0
06/15/2022 06:00	3,429.1	0.0	3,429.1	105,000.0	360.1	0.4	0.2	0.7
06/15/2022 07:00	3,606.3	0.0	3,606.3	105,000.0	378.7	0.5	0.2	0.8
06/15/2022 08:00	2,828.7	0.0	2,828.7	105,000.0	297.0	0.4	0.2	0.6
06/15/2022 09:00	2,827.7	0.0	2,827.7	105,000.0	296.9	0.4	0.2	0.6
06/15/2022 10:00	2,850.6	0.0	2,850.6	105,000.0	299.3	0.4	0.2	0.6
06/15/2022 11:00	3,121.0	0.0	3,121.0	105,000.0	327.7	0.4	0.2	0.7
06/15/2022 12:00	4,377.4	0.0	4,377.4	105,000.0	459.6	0.6	0.3	0.9
06/15/2022 13:00	4,623.3	0.0	4,623.3	105,000.0	485.4	0.6	0.3	1.0
06/15/2022 14:00	4,633.9	445.9	4,981.7	105,000.0	523.1	0.6	0.3	1.1
06/15/2022 15:00	4,623.3	847.3	5,470.6	105,000.0	574.4	0.7	0.3	1.1
06/15/2022 16:00	4,637.1	650.3	5,287.4	105,000.0	555.2	0.7	0.3	1.1
06/15/2022 17:00	4,649.6	616.1	5,265.7	105,000.0	552.9	0.7	0.3	1.1
06/15/2022 18:00	4,679.3	428.4	5,107.7	105,000.0	536.3	0.6	0.3	1.1
06/15/2022 19:00	4,713.4	297.4	5,010.8	105,000.0	526.1	0.6	0.3	1.1
06/15/2022 20:00	4,756.1	245.9	5,002.0	105,000.0	525.2	0.6	0.3	1.1
06/15/2022 21:00	4,776.2	224.5	5,000.7	105,000.0	525.1	0.6	0.3	1.1
06/15/2022 22:00	4,790.9	196.6	4,987.5	105,000.0	523.7	0.6	0.3	1.0
06/15/2022 23:00	4,811.6	172.1	4,983.7	105,000.0	523.3	0.6	0.3	1.0
Average/Sum#:	4,293.8	248.4	4,534.9	105,000.0	476.2	0.6	0.3	1.0
Minimum:	2,827.7	0.0	2,827.7	105,000.0	296.9	0.4	0.2	0.6
Maximum:	4,859.2	928.4	5,787.6	105,000.0	607.7	0.7	0.4	1.2
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
06/16/2022 00:00	4,818.0	159.8	4,977.8	105,000.0	522.7	0.6	0.3	1.0
06/16/2022 01:00	4,826.2	152.3	4,978.5	105,000.0	522.7	0.6	0.3	1.0
06/16/2022 02:00	4,838.8	136.5	4,975.3	105,000.0	522.4	0.6	0.3	1.0
06/16/2022 03:00	4,851.6	133.0	4,984.6	105,000.0	523.4	0.6	0.3	1.0
06/16/2022 04:00	4,853.6	128.6	4,982.2	105,000.0	523.1	0.6	0.3	1.0
06/16/2022 05:00	3,964.0	28.2	3,971.6	105,000.0	417.0	0.5	0.3	0.8
06/16/2022 06:00	2,866.5	0.0	2,866.5	105,000.0	301.0	0.4	0.2	0.6
06/16/2022 07:00	2,869.8	0.0	2,869.8	105,000.0	301.3	0.4	0.2	0.6
06/16/2022 08:00	2,865.1	0.0	2,865.1	105,000.0	300.8	0.4	0.2	0.6
06/16/2022 09:00	2,838.9	0.0	2,838.9	105,000.0	298.1	0.4	0.2	0.6
06/16/2022 10:00	2,826.8	0.0	2,826.8	105,000.0	296.8	0.4	0.2	0.6
06/16/2022 11:00	3,232.6	8.3	3,233.2	105,000.0	339.5	0.4	0.2	0.7
06/16/2022 12:00	4,686.0	362.5	5,048.5	105,000.0	530.1	0.6	0.3	1.1
06/16/2022 13:00	4,689.1	815.2	5,504.3	105,000.0	578.0	0.7	0.3	1.2
06/16/2022 14:00	4,691.7	318.8	5,010.5	105,000.0	526.1	0.6	0.3	1.1
06/16/2022 15:00	4,691.5	333.1	5,024.6	105,000.0	527.6	0.6	0.3	1.1
06/16/2022 16:00	4,705.3	305.0	5,010.3	105,000.0	526.1	0.6	0.3	1.1
06/16/2022 17:00	4,531.1	81.2	4,562.0	105,000.0	479.0	0.6	0.3	1.0
06/16/2022 18:00	4,752.7	256.8	5,009.5	105,000.0	526.0	0.6	0.3	1.1
06/16/2022 19:00	4,817.9	142.0	4,927.2	105,000.0	517.4	0.6	0.3	1.0
06/16/2022 20:00	4,799.1	66.4	4,831.0	105,000.0	507.3	0.6	0.3	1.0
06/16/2022 21:00	4,844.1	143.7	4,987.8	105,000.0	523.7	0.6	0.3	1.0
06/16/2022 22:00	4,848.9	138.4	4,987.3	105,000.0	523.7	0.6	0.3	1.0
06/16/2022 23:00	4,850.9	135.4	4,986.3	105,000.0	523.6	0.6	0.3	1.0
Average/Sum#:	4,273.3	160.2	4,427.5	105,000.0	464.9	0.6	0.3	0.9
Minimum:	2,826.8	0.0	2,826.8	105,000.0	296.8	0.4	0.2	0.6
Maximum:	4,853.6	815.2	5,504.3	105,000.0	578.0	0.7	0.3	1.2
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
06/17/2022 00:00	4,845.3	123.6	4,968.9	105,000.0	521.7	0.6	0.3	1.0
06/17/2022 01:00	4,858.3	101.2	4,959.5	105,000.0	520.7	0.6	0.3	1.0
06/17/2022 02:00	4,869.6	85.1	4,954.7	105,000.0	520.2	0.6	0.3	1.0
06/17/2022 03:00	4,866.8	65.2	4,932.0	105,000.0	517.9	0.6	0.3	1.0
06/17/2022 04:00	4,877.5	352.4	5,229.9	105,000.0	549.1	0.7	0.3	1.1
06/17/2022 05:00	4,831.1	169.3	4,919.1	105,000.0	516.5	0.6	0.3	1.1
06/17/2022 06:00	3,440.8	0.0	3,440.8	105,000.0	361.3	0.4	0.2	0.7
06/17/2022 07:00	3,162.9	0.0	3,162.9	105,000.0	332.1	0.4	0.2	0.7
06/17/2022 08:00	2,876.4	0.0	2,876.4	105,000.0	302.0	0.4	0.2	0.6
06/17/2022 09:00	2,846.6	0.0	2,846.6	105,000.0	298.9	0.4	0.2	0.6
06/17/2022 10:00	2,919.3	0.0	2,919.3	105,000.0	306.5	0.4	0.2	0.6
06/17/2022 11:00	2,838.0	0.0	2,838.0	105,000.0	298.0	0.4	0.2	0.6
06/17/2022 12:00	2,830.1	0.0	2,830.1	105,000.0	297.2	0.4	0.2	0.6
06/17/2022 13:00	3,437.7	0.0	3,437.7	105,000.0	361.0	0.4	0.2	0.7
06/17/2022 14:00	3,046.9	0.0	3,046.9	105,000.0	319.9	0.4	0.2	0.6
06/17/2022 15:00	3,060.8	0.0	3,060.8	105,000.0	321.4	0.4	0.2	0.6
06/17/2022 16:00	3,058.8	0.0	3,058.8	105,000.0	321.2	0.4	0.2	0.6
06/17/2022 17:00	3,054.7	0.0	3,054.7	105,000.0	320.7	0.4	0.2	0.6
06/17/2022 18:00	3,051.3	0.0	3,051.3	105,000.0	320.4	0.4	0.2	0.6
06/17/2022 19:00	3,055.4	0.0	3,055.4	105,000.0	320.8	0.4	0.2	0.6
06/17/2022 20:00	3,057.9	0.0	3,057.9	105,000.0	321.1	0.4	0.2	0.6
06/17/2022 21:00	3,060.9	0.0	3,060.9	105,000.0	321.4	0.4	0.2	0.6
06/17/2022 22:00	3,009.8	0.0	3,009.8	105,000.0	316.0	0.4	0.2	0.6
06/17/2022 23:00	3,038.7	0.0	3,038.7	105,000.0	319.1	0.4	0.2	0.6
Average/Sum#:	3,499.8	37.4	3,533.8	105,000.0	371.0	0.5	0.2	0.7
Minimum:	2,830.1	0.0	2,830.1	105,000.0	297.2	0.4	0.2	0.6
Maximum:	4,877.5	352.4	5,229.9	105,000.0	549.1	0.7	0.3	1.1
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
06/18/2022 00:00	3,041.3	0.0	3,041.3	105,000.0	319.3	0.4	0.2	0.6
06/18/2022 01:00	3,041.2	0.0	3,041.2	105,000.0	319.3	0.4	0.2	0.6
06/18/2022 02:00	3,056.9	0.0	3,056.9	105,000.0	321.0	0.4	0.2	0.6
06/18/2022 03:00	2,995.6	0.0	2,995.6	105,000.0	314.5	0.4	0.2	0.6
06/18/2022 04:00	3,086.4	0.0	3,086.4	105,000.0	324.1	0.4	0.2	0.6
06/18/2022 05:00	3,033.9	0.0	3,033.9	105,000.0	318.6	0.4	0.2	0.6
06/18/2022 06:00	3,033.7	0.0	3,033.7	105,000.0	318.5	0.4	0.2	0.6
06/18/2022 07:00	3,037.0	0.0	3,037.0	105,000.0	318.9	0.4	0.2	0.6
06/18/2022 08:00	3,035.2	0.0	3,035.2	105,000.0	318.7	0.4	0.2	0.6
06/18/2022 09:00	3,036.1	0.0	3,036.1	105,000.0	318.8	0.4	0.2	0.6
06/18/2022 10:00	3,035.2	0.0	3,035.2	105,000.0	318.7	0.4	0.2	0.6
06/18/2022 11:00	3,044.3	0.0	3,044.3	105,000.0	319.7	0.4	0.2	0.6
06/18/2022 12:00	3,035.5	0.0	3,035.5	105,000.0	318.7	0.4	0.2	0.6
06/18/2022 13:00	3,031.8	0.0	3,031.8	105,000.0	318.3	0.4	0.2	0.6
06/18/2022 14:00	3,037.8	0.0	3,037.8	105,000.0	319.0	0.4	0.2	0.6
06/18/2022 15:00	3,043.6	0.0	3,043.6	105,000.0	319.6	0.4	0.2	0.6
06/18/2022 16:00	3,040.0	0.0	3,040.0	105,000.0	319.2	0.4	0.2	0.6
06/18/2022 17:00	3,042.6	0.0	3,042.6	105,000.0	319.5	0.4	0.2	0.6
06/18/2022 18:00	3,047.7	0.0	3,047.7	105,000.0	320.0	0.4	0.2	0.6
06/18/2022 19:00	3,050.9	0.0	3,050.9	105,000.0	320.3	0.4	0.2	0.6
06/18/2022 20:00	3,180.4	0.0	3,180.4	105,000.0	333.9	0.4	0.2	0.7
06/18/2022 21:00	3,104.1	0.0	3,104.1	105,000.0	325.9	0.4	0.2	0.7
06/18/2022 22:00	4,737.5	0.5	4,737.5	105,000.0	497.4	0.6	0.3	1.0
06/18/2022 23:00	3,468.9	0.4	3,468.9	105,000.0	364.2	0.4	0.2	0.7
Average/Sum#:	3,137.4	0.0	3,137.4	105,000.0	329.4	0.4	0.2	0.6
Minimum:	2,995.6	0.0	2,995.6	105,000.0	314.5	0.4	0.2	0.6
Maximum:	4,737.5	0.5	4,737.5	105,000.0	497.4	0.6	0.3	1.0
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
06/19/2022 00:00	3,169.8	0.0	3,169.8	105,000.0	332.8	0.4	0.2	0.7
06/19/2022 01:00	3,884.5	0.0	3,884.5	105,000.0	407.9	0.5	0.2	0.8
06/19/2022 02:00	3,327.9	0.0	3,327.9	105,000.0	349.4	0.4	0.2	0.7
06/19/2022 03:00	3,052.2	0.0	3,052.2	105,000.0	320.5	0.4	0.2	0.6
06/19/2022 04:00	3,058.7	0.0	3,058.7	105,000.0	321.2	0.4	0.2	0.6
06/19/2022 05:00	3,107.0	0.0	3,107.0	105,000.0	326.2	0.4	0.2	0.7
06/19/2022 06:00	3,047.9	0.0	3,047.9	105,000.0	320.0	0.4	0.2	0.6
06/19/2022 07:00	3,046.6	0.0	3,046.6	105,000.0	319.9	0.4	0.2	0.6
06/19/2022 08:00	3,054.8	0.0	3,054.8	105,000.0	320.8	0.4	0.2	0.6
06/19/2022 09:00	3,056.4	0.0	3,056.4	105,000.0	320.9	0.4	0.2	0.6
06/19/2022 10:00	3,054.5	0.0	3,054.5	105,000.0	320.7	0.4	0.2	0.6
06/19/2022 11:00	3,049.0	0.0	3,049.0	105,000.0	320.1	0.4	0.2	0.6
06/19/2022 12:00	3,040.2	0.0	3,040.2	105,000.0	319.2	0.4	0.2	0.6
06/19/2022 13:00	3,030.1	0.0	3,030.1	105,000.0	318.2	0.4	0.2	0.6
06/19/2022 14:00	3,008.1	0.0	3,008.1	105,000.0	315.9	0.4	0.2	0.6
06/19/2022 15:00	3,018.0	0.0	3,018.0	105,000.0	316.9	0.4	0.2	0.6
06/19/2022 16:00	3,027.0	0.0	3,027.0	105,000.0	317.8	0.4	0.2	0.6
06/19/2022 17:00	3,009.5	0.0	3,009.5	105,000.0	316.0	0.4	0.2	0.6
06/19/2022 18:00	3,001.9	0.0	3,001.9	105,000.0	315.2	0.4	0.2	0.6
06/19/2022 19:00	3,015.1	0.0	3,015.1	105,000.0	316.6	0.4	0.2	0.6
06/19/2022 20:00	3,305.5	0.0	3,305.5	105,000.0	347.1	0.4	0.2	0.7
06/19/2022 21:00	3,012.8	0.0	3,012.8	105,000.0	316.3	0.4	0.2	0.6
06/19/2022 22:00	3,058.6	0.0	3,058.6	105,000.0	321.2	0.4	0.2	0.6
06/19/2022 23:00	3,048.6	0.0	3,048.6	105,000.0	320.1	0.4	0.2	0.6
Average/Sum#:	3,103.5	0.0	3,103.5	105,000.0	325.9	0.4	0.2	0.6
Minimum:	3,001.9	0.0	3,001.9	105,000.0	315.2	0.4	0.2	0.6
Maximum:	3,884.5	0.0	3,884.5	105,000.0	407.9	0.5	0.2	0.8
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
06/20/2022 00:00	3,047.0	0.0	3,047.0	105,000.0	319.9	0.4	0.2	0.6
06/20/2022 01:00	3,045.5	0.0	3,045.5	105,000.0	319.8	0.4	0.2	0.6
06/20/2022 02:00	3,050.4	0.0	3,050.4	105,000.0	320.3	0.4	0.2	0.6
06/20/2022 03:00	3,049.9	0.0	3,049.9	105,000.0	320.2	0.4	0.2	0.6
06/20/2022 04:00	3,223.4	0.0	3,223.4	105,000.0	338.5	0.4	0.2	0.7
06/20/2022 05:00	3,112.3	0.0	3,112.3	105,000.0	326.8	0.4	0.2	0.7
06/20/2022 06:00	3,108.8	0.0	3,108.8	105,000.0	326.4	0.4	0.2	0.7
06/20/2022 07:00	3,046.5	0.0	3,046.5	105,000.0	319.9	0.4	0.2	0.6
06/20/2022 08:00	3,043.6	0.0	3,043.6	105,000.0	319.6	0.4	0.2	0.6
06/20/2022 09:00	3,046.0	0.0	3,046.0	105,000.0	319.8	0.4	0.2	0.6
06/20/2022 10:00	3,048.1	0.0	3,048.1	105,000.0	320.1	0.4	0.2	0.6
06/20/2022 11:00	3,045.7	0.0	3,045.7	105,000.0	319.8	0.4	0.2	0.6
06/20/2022 12:00	3,217.1	0.0	3,217.1	105,000.0	337.8	0.4	0.2	0.7
06/20/2022 13:00	3,474.3	0.4	3,474.3	105,000.0	364.8	0.4	0.2	0.7
06/20/2022 14:00	3,880.7	0.0	3,880.7	105,000.0	407.5	0.5	0.2	0.8
06/20/2022 15:00	4,385.7	570.5	4,710.9	105,000.0	494.6	0.6	0.3	1.0
06/20/2022 16:00	4,678.7	1,584.8	6,263.5	105,000.0	657.7	0.8	0.4	1.3
06/20/2022 17:00	4,653.4	758.1	5,411.5	105,000.0	568.2	0.7	0.3	1.1
06/20/2022 18:00	4,684.2	795.8	5,480.0	105,000.0	575.4	0.7	0.3	1.2
06/20/2022 19:00	4,681.4	591.8	5,273.2	105,000.0	553.7	0.7	0.3	1.1
06/20/2022 20:00	4,696.5	476.7	5,173.2	105,000.0	543.2	0.7	0.3	1.1
06/20/2022 21:00	4,710.0	429.8	5,139.8	105,000.0	539.7	0.6	0.3	1.1
06/20/2022 22:00	3,940.9	34.1	3,945.3	105,000.0	414.3	0.5	0.3	0.9
06/20/2022 23:00	607.7	0.0	607.7	105,000.0	63.8	0.0	0.0	0.0
Average/Sum#:	3,519.9	218.4	3,726.9	105,000.0	391.3	0.5	0.2	0.8
Minimum:	607.7	0.0	607.7	105,000.0	63.8	0.4	0.2	0.6
Maximum:	4,710.0	1,584.8	6,263.5	105,000.0	657.7	0.8	0.4	1.3
%SI	0.00	0.00	0.00	0.00	0.00	4.17	4.17	4.17

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
06/21/2022 00:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/21/2022 01:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/21/2022 02:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/21/2022 03:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/21/2022 04:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/21/2022 05:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/21/2022 06:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/21/2022 07:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/21/2022 08:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/21/2022 09:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/21/2022 10:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/21/2022 11:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/21/2022 12:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/21/2022 13:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/21/2022 14:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/21/2022 15:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/21/2022 16:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/21/2022 17:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/21/2022 18:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/21/2022 19:00	2,877.2	0.0	2,877.2	105,000.0	302.1	0.0	0.0	0.0
06/21/2022 20:00	4,570.4	239.7	4,697.4	105,000.0	493.2	0.6	0.3	1.1
06/21/2022 21:00	4,615.8	796.8	5,412.6	105,000.0	568.3	0.7	0.3	1.1
06/21/2022 22:00	4,651.4	377.7	5,029.1	105,000.0	528.1	0.6	0.3	1.1
06/21/2022 23:00	4,670.2	342.4	5,012.6	105,000.0	526.3	0.6	0.3	1.1
Average/Sum#:	4,277.0	351.3	4,605.8	105,000.0	483.6	0.6	0.3	1.1
Minimum:	2,877.2	0.0	2,877.2	105,000.0	302.1	0.6	0.3	1.1
Maximum:	4,670.2	796.8	5,412.6	105,000.0	568.3	0.7	0.3	1.1
%SI	79.17	79.17	79.17	0.00	79.17	83.33	83.33	83.33

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
06/22/2022 00:00	4,719.3	289.8	5,009.1	105,000.0	526.0	0.6	0.3	1.1
06/22/2022 01:00	4,709.5	287.9	4,997.4	105,000.0	524.7	0.6	0.3	1.1
06/22/2022 02:00	4,552.0	56.3	4,567.2	105,000.0	479.6	0.6	0.3	1.0
06/22/2022 03:00	4,729.6	211.6	4,937.0	105,000.0	518.4	0.6	0.3	1.0
06/22/2022 04:00	4,765.4	71.2	4,788.9	105,000.0	502.8	0.6	0.3	1.0
06/22/2022 05:00	3,685.0	0.0	3,685.0	105,000.0	386.9	0.5	0.2	0.8
06/22/2022 06:00	2,825.6	0.0	2,825.6	105,000.0	296.7	0.4	0.2	0.6
06/22/2022 07:00	2,816.1	0.0	2,816.1	105,000.0	295.7	0.4	0.2	0.6
06/22/2022 08:00	2,808.5	0.0	2,808.5	105,000.0	294.9	0.4	0.2	0.6
06/22/2022 09:00	2,803.2	0.0	2,803.2	105,000.0	294.3	0.4	0.2	0.6
06/22/2022 10:00	2,798.7	0.0	2,798.7	105,000.0	293.9	0.4	0.2	0.6
06/22/2022 11:00	2,800.6	0.0	2,800.6	105,000.0	294.1	0.4	0.2	0.6
06/22/2022 12:00	2,799.6	0.0	2,799.6	105,000.0	294.0	0.4	0.2	0.6
06/22/2022 13:00	2,995.9	0.0	2,995.9	105,000.0	314.6	0.4	0.2	0.6
06/22/2022 14:00	3,197.2	0.0	3,197.2	105,000.0	335.7	0.4	0.2	0.7
06/22/2022 15:00	2,958.8	0.0	2,958.8	105,000.0	310.7	0.4	0.2	0.6
06/22/2022 16:00	2,798.2	0.0	2,798.2	105,000.0	293.8	0.4	0.2	0.6
06/22/2022 17:00	2,800.1	0.0	2,800.1	105,000.0	294.0	0.4	0.2	0.6
06/22/2022 18:00	2,800.2	0.0	2,800.2	105,000.0	294.0	0.4	0.2	0.6
06/22/2022 19:00	2,814.6	0.0	2,814.6	105,000.0	295.5	0.4	0.2	0.6
06/22/2022 20:00	3,924.1	0.0	3,924.1	105,000.0	412.0	0.5	0.2	0.8
06/22/2022 21:00	4,423.7	67.7	4,449.4	105,000.0	467.2	0.6	0.3	0.9
06/22/2022 22:00	4,578.8	0.0	4,578.8	105,000.0	480.8	0.6	0.3	1.0
06/22/2022 23:00	4,662.4	350.9	4,978.2	105,000.0	522.7	0.6	0.3	1.1
Average/Sum#:	3,532.0	55.6	3,580.5	105,000.0	376.0	0.5	0.2	0.8
Minimum:	2,798.2	0.0	2,798.2	105,000.0	293.8	0.4	0.2	0.6
Maximum:	4,765.4	350.9	5,009.1	105,000.0	526.0	0.6	0.3	1.1
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
06/23/2022 00:00	4,690.8	445.8	5,136.6	105,000.0	539.3	0.6	0.3	1.1
06/23/2022 01:00	4,310.3	154.9	4,395.5	105,000.0	461.5	0.6	0.3	0.9
06/23/2022 02:00	2,321.7	0.0	2,321.7	105,000.0	243.8	0.4	0.2	0.6
06/23/2022 03:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/23/2022 04:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/23/2022 05:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/23/2022 06:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/23/2022 07:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/23/2022 08:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/23/2022 09:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/23/2022 10:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/23/2022 11:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/23/2022 12:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/23/2022 13:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/23/2022 14:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/23/2022 15:00	47.8	0.0	47.8	105,000.0	5.0	0.0	0.0	0.0
06/23/2022 16:00	2,670.6	0.0	2,670.6	105,000.0	280.4	0.4	0.2	0.6
06/23/2022 17:00	4,164.4	359.2	4,397.9	105,000.0	461.8	0.6	0.3	1.0
06/23/2022 18:00	4,536.8	1,172.7	5,709.5	105,000.0	599.5	0.7	0.4	1.2
06/23/2022 19:00	4,578.6	1,538.6	6,117.2	105,000.0	642.3	0.8	0.4	1.3
06/23/2022 20:00	4,628.3	1,352.3	5,980.6	105,000.0	628.0	0.8	0.4	1.3
06/23/2022 21:00	4,648.7	611.8	5,260.5	105,000.0	552.4	0.7	0.3	1.1
06/23/2022 22:00	4,657.3	371.7	5,029.0	105,000.0	528.0	0.6	0.3	1.1
06/23/2022 23:00	4,685.3	336.6	5,021.9	105,000.0	527.3	0.6	0.3	1.1
Average/Sum#:	3,828.4	528.6	4,340.7	105,000.0	455.8	0.6	0.3	1.0
Minimum:	47.8	0.0	47.8	105,000.0	5.0	0.4	0.2	0.6
Maximum:	4,690.8	1,538.6	6,117.2	105,000.0	642.3	0.8	0.4	1.3
%SI	50.00	50.00	50.00	0.00	50.00	54.17	54.17	54.17

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
06/24/2022 00:00	4,703.5	320.6	5,024.1	105,000.0	527.5	0.6	0.3	1.1
06/24/2022 01:00	4,727.2	301.8	5,029.0	105,000.0	528.0	0.6	0.3	1.1
06/24/2022 02:00	4,681.1	210.5	4,849.5	105,000.0	509.2	0.6	0.3	1.0
06/24/2022 03:00	3,572.8	17.5	3,574.2	105,000.0	375.3	0.5	0.2	0.8
06/24/2022 04:00	4,755.1	265.7	5,020.8	105,000.0	527.2	0.6	0.3	1.1
06/24/2022 05:00	3,851.1	53.1	3,865.4	105,000.0	405.9	0.5	0.2	0.8
06/24/2022 06:00	2,866.0	0.0	2,866.0	105,000.0	300.9	0.4	0.2	0.6
06/24/2022 07:00	2,839.2	0.0	2,839.2	105,000.0	298.1	0.4	0.2	0.6
06/24/2022 08:00	2,838.0	0.0	2,838.0	105,000.0	298.0	0.4	0.2	0.6
06/24/2022 09:00	2,844.0	0.0	2,844.0	105,000.0	298.6	0.4	0.2	0.6
06/24/2022 10:00	3,340.3	0.0	3,340.3	105,000.0	350.7	0.4	0.2	0.7
06/24/2022 11:00	4,158.0	14.0	4,159.7	105,000.0	436.8	0.5	0.3	0.9
06/24/2022 12:00	4,579.5	72.7	4,610.8	105,000.0	484.1	0.6	0.3	1.0
06/24/2022 13:00	4,493.4	135.7	4,531.4	105,000.0	475.8	0.6	0.3	1.0
06/24/2022 14:00	4,579.2	1,056.7	5,635.9	105,000.0	591.8	0.7	0.4	1.2
06/24/2022 15:00	4,573.1	1,014.2	5,587.3	105,000.0	586.7	0.7	0.4	1.2
06/24/2022 16:00	4,589.0	799.9	5,188.9	105,000.0	544.8	0.7	0.3	1.1
06/24/2022 17:00	4,581.4	1,704.6	6,286.0	105,000.0	660.0	0.8	0.4	1.3
06/24/2022 18:00	4,605.1	1,261.2	5,866.3	105,000.0	616.0	0.7	0.4	1.2
06/24/2022 19:00	4,625.1	1,317.7	5,942.8	105,000.0	624.0	0.7	0.4	1.2
06/24/2022 20:00	4,628.5	641.7	5,270.2	105,000.0	553.4	0.7	0.3	1.1
06/24/2022 21:00	4,635.6	463.2	5,098.8	105,000.0	535.4	0.6	0.3	1.1
06/24/2022 22:00	4,658.5	625.3	5,283.8	105,000.0	554.8	0.7	0.3	1.1
06/24/2022 23:00	4,692.3	359.0	5,051.3	105,000.0	530.4	0.6	0.3	1.1
Average/Sum#:	4,184.0	443.1	4,608.5	105,000.0	483.9	0.6	0.3	1.0
Minimum:	2,838.0	0.0	2,838.0	105,000.0	298.0	0.4	0.2	0.6
Maximum:	4,755.1	1,704.6	6,286.0	105,000.0	660.0	0.8	0.4	1.3
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
06/25/2022 00:00	4,641.6	78.0	4,667.3	105,000.0	490.1	0.6	0.3	1.0
06/25/2022 01:00	4,748.5	1,050.8	5,799.3	105,000.0	608.9	0.7	0.4	1.2
06/25/2022 02:00	4,747.6	107.6	4,776.7	105,000.0	501.6	0.6	0.3	1.0
06/25/2022 03:00	4,766.5	0.0	4,766.5	105,000.0	500.5	0.6	0.3	1.0
06/25/2022 04:00	4,675.3	0.0	4,675.3	105,000.0	490.9	0.6	0.3	1.0
06/25/2022 05:00	3,879.2	0.0	3,879.2	105,000.0	407.3	0.5	0.2	0.8
06/25/2022 06:00	2,858.9	0.0	2,858.9	105,000.0	300.2	0.4	0.2	0.6
06/25/2022 07:00	2,821.1	0.0	2,821.1	105,000.0	296.2	0.4	0.2	0.6
06/25/2022 08:00	2,817.5	0.0	2,817.5	105,000.0	295.8	0.4	0.2	0.6
06/25/2022 09:00	2,813.5	0.0	2,813.5	105,000.0	295.4	0.4	0.2	0.6
06/25/2022 10:00	2,810.3	0.0	2,810.3	105,000.0	295.1	0.4	0.2	0.6
06/25/2022 11:00	2,806.7	0.0	2,806.7	105,000.0	294.7	0.4	0.2	0.6
06/25/2022 12:00	2,905.1	0.0	2,905.1	105,000.0	305.0	0.4	0.2	0.6
06/25/2022 13:00	2,826.5	0.0	2,826.5	105,000.0	296.8	0.4	0.2	0.6
06/25/2022 14:00	2,904.6	0.0	2,904.6	105,000.0	305.0	0.4	0.2	0.6
06/25/2022 15:00	2,868.1	0.0	2,868.1	105,000.0	301.2	0.4	0.2	0.6
06/25/2022 16:00	3,055.2	0.0	3,055.2	105,000.0	320.8	0.4	0.2	0.6
06/25/2022 17:00	4,573.5	483.9	4,975.1	105,000.0	522.4	0.6	0.3	1.1
06/25/2022 18:00	4,625.3	997.1	5,622.4	105,000.0	590.4	0.7	0.4	1.2
06/25/2022 19:00	4,652.1	584.6	5,236.7	105,000.0	549.9	0.7	0.3	1.1
06/25/2022 20:00	4,669.6	555.4	5,225.0	105,000.0	548.6	0.7	0.3	1.1
06/25/2022 21:00	4,199.2	81.3	4,223.6	105,000.0	443.5	0.5	0.3	0.9
06/25/2022 22:00	3,374.8	0.0	3,374.8	105,000.0	354.4	0.4	0.2	0.7
06/25/2022 23:00	3,026.5	0.0	3,026.5	105,000.0	317.8	0.4	0.2	0.6
Average/Sum#:	3,669.5	164.1	3,822.3	105,000.0	401.4	0.5	0.3	0.8
Minimum:	2,806.7	0.0	2,806.7	105,000.0	294.7	0.4	0.2	0.6
Maximum:	4,766.5	1,050.8	5,799.3	105,000.0	608.9	0.7	0.4	1.2
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
06/26/2022 00:00	3,027.6	0.0	3,027.6	105,000.0	317.9	0.4	0.2	0.6
06/26/2022 01:00	3,425.4	0.0	3,425.4	105,000.0	359.7	0.4	0.2	0.7
06/26/2022 02:00	3,544.1	0.0	3,544.1	105,000.0	372.1	0.4	0.2	0.7
06/26/2022 03:00	3,183.3	0.0	3,183.3	105,000.0	334.2	0.4	0.2	0.7
06/26/2022 04:00	4,345.3	1.1	4,345.4	105,000.0	456.3	0.5	0.3	0.9
06/26/2022 05:00	4,221.8	6.5	4,222.8	105,000.0	443.4	0.5	0.3	0.9
06/26/2022 06:00	3,038.7	0.0	3,038.7	105,000.0	319.1	0.4	0.2	0.6
06/26/2022 07:00	3,041.4	0.0	3,041.4	105,000.0	319.3	0.4	0.2	0.6
06/26/2022 08:00	3,044.7	0.0	3,044.7	105,000.0	319.7	0.4	0.2	0.6
06/26/2022 09:00	3,246.9	0.0	3,246.9	105,000.0	340.9	0.4	0.2	0.7
06/26/2022 10:00	3,516.1	0.0	3,516.1	105,000.0	369.2	0.4	0.2	0.7
06/26/2022 11:00	2,810.1	0.0	2,810.1	105,000.0	295.1	0.4	0.2	0.6
06/26/2022 12:00	2,804.5	0.0	2,804.5	105,000.0	294.5	0.4	0.2	0.6
06/26/2022 13:00	2,852.8	0.0	2,852.8	105,000.0	299.5	0.4	0.2	0.6
06/26/2022 14:00	2,822.0	0.0	2,822.0	105,000.0	296.3	0.4	0.2	0.6
06/26/2022 15:00	2,876.6	0.0	2,876.6	105,000.0	302.0	0.4	0.2	0.6
06/26/2022 16:00	3,944.5	214.5	4,030.3	105,000.0	423.2	0.5	0.3	0.9
06/26/2022 17:00	4,604.9	499.2	5,069.2	105,000.0	532.3	0.6	0.3	1.1
06/26/2022 18:00	4,619.9	1,516.9	6,136.8	105,000.0	644.4	0.8	0.4	1.3
06/26/2022 19:00	4,652.9	518.3	5,171.2	105,000.0	543.0	0.7	0.3	1.1
06/26/2022 20:00	4,688.8	333.5	5,022.3	105,000.0	527.3	0.6	0.3	1.1
06/26/2022 21:00	4,200.5	175.8	4,291.9	105,000.0	450.6	0.6	0.3	0.9
06/26/2022 22:00	2,391.9	0.0	2,391.9	105,000.0	251.1	0.4	0.2	0.6
06/26/2022 23:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
Average/Sum#:	3,517.6	142.0	3,648.5	105,000.0	383.1	0.5	0.2	0.8
Minimum:	2,391.9	0.0	2,391.9	105,000.0	251.1	0.4	0.2	0.6
Maximum:	4,688.8	1,516.9	6,136.8	105,000.0	644.4	0.8	0.4	1.3
%SI	4.17	4.17	4.17	0.00	4.17	4.17	4.17	4.17

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
06/27/2022 00:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/27/2022 01:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/27/2022 02:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/27/2022 03:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/27/2022 04:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/27/2022 05:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/27/2022 06:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/27/2022 07:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/27/2022 08:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/27/2022 09:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/27/2022 10:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/27/2022 11:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/27/2022 12:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/27/2022 13:00	2,580.1	0.0	2,580.1	105,000.0	270.9	0.4	0.2	0.6
06/27/2022 14:00	4,137.0	43.7	4,142.7	105,000.0	435.0	0.5	0.3	0.9
06/27/2022 15:00	4,591.9	441.9	5,033.8	105,000.0	528.5	0.6	0.3	1.1
06/27/2022 16:00	4,598.5	438.7	5,037.2	105,000.0	528.9	0.6	0.3	1.1
06/27/2022 17:00	4,578.1	691.5	5,269.6	105,000.0	553.3	0.7	0.3	1.1
06/27/2022 18:00	4,581.2	1,094.4	5,675.6	105,000.0	595.9	0.7	0.4	1.2
06/27/2022 19:00	4,601.9	559.5	5,161.4	105,000.0	541.9	0.7	0.3	1.1
06/27/2022 20:00	4,654.1	440.0	5,094.1	105,000.0	534.9	0.6	0.3	1.1
06/27/2022 21:00	4,628.1	400.6	4,936.6	105,000.0	518.3	0.6	0.3	1.1
06/27/2022 22:00	2,880.0	0.0	2,880.0	105,000.0	302.4	0.4	0.2	0.6
06/27/2022 23:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
Average/Sum#:	4,183.1	411.0	4,581.1	105,000.0	481.0	0.6	0.3	1.0
Minimum:	2,580.1	0.0	2,580.1	105,000.0	270.9	0.4	0.2	0.6
Maximum:	4,654.1	1,094.4	5,675.6	105,000.0	595.9	0.7	0.4	1.2
%SI	58.33	58.33	58.33	0.00	58.33	58.33	58.33	58.33

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
06/28/2022 00:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/28/2022 01:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/28/2022 02:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/28/2022 03:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/28/2022 04:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/28/2022 05:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/28/2022 06:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/28/2022 07:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/28/2022 08:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/28/2022 09:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/28/2022 10:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/28/2022 11:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/28/2022 12:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/28/2022 13:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/28/2022 14:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/28/2022 15:00	957.5	0.0	957.5	105,000.0	100.5	0.0	0.0	0.0
06/28/2022 16:00	2,992.4	0.0	2,992.4	105,000.0	314.2	0.4	0.2	0.6
06/28/2022 17:00	4,206.9	255.3	4,329.4	105,000.0	454.6	0.6	0.3	0.9
06/28/2022 18:00	4,606.5	427.6	5,034.1	105,000.0	528.6	0.6	0.3	1.1
06/28/2022 19:00	4,656.4	344.1	5,000.5	105,000.0	525.1	0.6	0.3	1.1
06/28/2022 20:00	4,353.8	149.6	4,431.6	105,000.0	465.3	0.6	0.3	0.9
06/28/2022 21:00	3,009.0	0.0	3,009.0	105,000.0	315.9	0.4	0.2	0.7
06/28/2022 22:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/28/2022 23:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
Average/Sum#:	3,540.4	168.1	3,679.2	105,000.0	386.3	0.5	0.3	0.9
Minimum:	957.5	0.0	957.5	105,000.0	100.5	0.4	0.2	0.6
Maximum:	4,656.4	427.6	5,034.1	105,000.0	528.6	0.6	0.3	1.1
%SI	70.83	70.83	70.83	0.00	70.83	75.00	75.00	75.00

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
06/29/2022 00:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/29/2022 01:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/29/2022 02:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/29/2022 03:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/29/2022 04:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/29/2022 05:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/29/2022 06:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/29/2022 07:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/29/2022 08:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/29/2022 09:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/29/2022 10:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/29/2022 11:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/29/2022 12:00	2,630.7	0.0	2,630.7	105,000.0	276.2	0.4	0.2	0.7
06/29/2022 13:00	4,258.4	97.2	4,282.7	105,000.0	449.7	0.5	0.3	0.9
06/29/2022 14:00	4,639.8	409.4	5,049.2	105,000.0	530.2	0.6	0.3	1.1
06/29/2022 15:00	4,642.7	396.1	5,038.8	105,000.0	529.1	0.6	0.3	1.1
06/29/2022 16:00	4,654.3	376.7	5,031.0	105,000.0	528.3	0.6	0.3	1.1
06/29/2022 17:00	4,663.9	371.3	5,035.2	105,000.0	528.7	0.6	0.3	1.1
06/29/2022 18:00	4,692.5	459.8	5,152.3	105,000.0	541.0	0.6	0.3	1.1
06/29/2022 19:00	4,727.4	568.2	5,295.6	105,000.0	556.0	0.7	0.3	1.1
06/29/2022 20:00	4,771.6	496.7	5,268.3	105,000.0	553.2	0.7	0.3	1.1
06/29/2022 21:00	4,784.4	332.4	5,116.8	105,000.0	537.3	0.6	0.3	1.1
06/29/2022 22:00	4,806.8	187.8	4,994.6	105,000.0	524.4	0.6	0.3	1.0
06/29/2022 23:00	4,824.4	916.3	5,740.7	105,000.0	602.8	0.7	0.4	1.2
Average/Sum#:	4,508.1	384.3	4,886.3	105,000.0	513.1	0.6	0.3	1.1
Minimum:	2,630.7	0.0	2,630.7	105,000.0	276.2	0.4	0.2	0.7
Maximum:	4,824.4	916.3	5,740.7	105,000.0	602.8	0.7	0.4	1.2
%SI	50.00	50.00	50.00	0.00	50.00	50.00	50.00	50.00

Fuel Gas and Emissions Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:						> 4.73	> 1	> 1.8
	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
06/30/2022 00:00	3,994.4	31.7	4,004.1	105,000.0	420.4	0.6	0.3	0.9
06/30/2022 01:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/30/2022 02:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/30/2022 03:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/30/2022 04:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/30/2022 05:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/30/2022 06:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/30/2022 07:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/30/2022 08:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/30/2022 09:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/30/2022 10:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/30/2022 11:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/30/2022 12:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/30/2022 13:00	0.0	0.0	0.0	105,000.0	0.0	0.0	0.0	0.0
06/30/2022 14:00	2,557.5	0.0	2,557.5	105,000.0	268.5	0.4	0.2	0.6
06/30/2022 15:00	4,276.9	225.3	4,394.1	105,000.0	461.4	0.6	0.3	0.9
06/30/2022 16:00	4,645.3	410.6	5,055.9	105,000.0	530.9	0.6	0.3	1.1
06/30/2022 17:00	4,639.2	510.6	5,149.8	105,000.0	540.7	0.6	0.3	1.1
06/30/2022 18:00	4,655.7	1,245.5	5,901.2	105,000.0	619.6	0.7	0.4	1.2
06/30/2022 19:00	4,694.5	1,814.7	6,509.2	105,000.0	683.5	0.8	0.4	1.4
06/30/2022 20:00	4,752.8	582.0	5,334.8	105,000.0	560.2	0.7	0.3	1.1
06/30/2022 21:00	4,758.4	224.2	4,982.6	105,000.0	523.2	0.6	0.3	1.0
06/30/2022 22:00	4,547.2	92.0	4,595.0	105,000.0	482.5	0.6	0.3	1.0
06/30/2022 23:00	2,999.8	0.0	2,999.8	105,000.0	315.0	0.4	0.2	0.7
Average/Sum#:	4,229.2	467.0	4,680.4	105,000.0	491.4	0.6	0.3	1.0
Minimum:	2,557.5	0.0	2,557.5	105,000.0	268.5	0.4	0.2	0.6
Maximum:	4,758.4	1,814.7	6,509.2	105,000.0	683.5	0.8	0.4	1.4
%SI	54.17	54.17	54.17	0.00	54.17	54.17	54.17	54.17

Linearity Report

ORIS Code:	56298	Facility Name:	ROSEVILLE ENERGY		
EDR Site ID:	CT001	Component ID:	A15	ReasonForTes	QA
		Component Type:	NOXA	Grace Period:	0
Instrument	CT1_NOXDualRg_P_Instr	Test End	06/14/2022	Scale:	High
Performance	5 %	Test No.:	116	Highest	3.5
		Status	**Passed**		

Date	Time	Cal Gas Level	Span Value	Ref Value	Meas Value	Aborted Test Indicator	Ref Value As Pct Span
06/14/2022	1127	L	200.0	47.6	44.8		23.8 %
06/14/2022	1132	M	200.0	105.0	108.3		52.5 %
06/14/2022	1137	H	200.0	176.0	176.6		88.0 %
06/14/2022	1145	L	200.0	47.6	48.3		23.8 %
06/14/2022	1150	M	200.0	105.0	108.7		52.5 %
06/14/2022	1155	H	200.0	176.0	176.6		88.0 %
06/14/2022	1202	L	200.0	47.6	49.2		23.8 %
06/14/2022	1207	M	200.0	105.0	108.9		52.5 %
06/14/2022	1212	H	200.0	176.0	176.8		88.0 %

Summary

Cal Gas Level	Reference Mean	CEMS Mean	Alt Perf Spec	Results
L	47.600	47.433	No	**0.4**
M	105.000	108.633	No	**3.5**
H	176.000	176.667	No	**0.4**

Linearity Report

ORIS Code:	56298	Facility Name:	ROSEVILLE ENERGY		
EDR Site ID:	CT001	Component ID:	A16	ReasonForTes	QA
		Component Type:	O2D	Grace Period:	0
Instrument	CT1_O2D_P_Instrument	Test End	06/14/2022	Scale:	High
Performance	5 %	Test No.:	117	Highest	1.8
		Status	**Passed**		

Date	Time	Cal Gas Level	Span Value	Ref Value	Meas Value	Aborted Test Indicator	Ref Value As Pct Span
06/14/2022	1328	L	21.0	5.5	5.6		26.2 %
06/14/2022	1333	M	21.0	11.1	11.1		52.9 %
06/14/2022	1338	H	21.0	18.1	18.4		86.2 %
06/14/2022	1345	L	21.0	5.5	5.6		26.2 %
06/14/2022	1350	M	21.0	11.1	11.1		52.9 %
06/14/2022	1355	H	21.0	18.1	18.4		86.2 %
06/14/2022	1402	L	21.0	5.5	5.6		26.2 %
06/14/2022	1407	M	21.0	11.1	11.1		52.9 %
06/14/2022	1412	H	21.0	18.1	18.4		86.2 %

Summary

Cal Gas Level	Reference Mean	CEMS Mean	Alt Perf Spec	Results
L	5.500	5.600	No	**1.8**
M	11.100	11.100	No	**0.0**
H	18.100	18.400	No	**1.7**

Linearity Report

ORIS Code:	56298	Facility Name:	ROSEVILLE ENERGY		
EDR Site ID:	CT002	Component ID:	A21	ReasonForTes	QA
		Component Type:	NOXA	Grace Period:	0
Instrument	CT2_NOXDualRg_P_Instr	Test End	06/15/2022	Scale:	High
Performance	5 %	Test No.:	119	Highest	3.0
		Status	**Passed**		

Date	Time	Cal Gas Level	Span Value	Ref Value	Meas Value	Aborted Test Indicator	Ref Value As Pct Span
06/15/2022	1427	L	200.0	48.2	47.2		24.1 %
06/15/2022	1432	M	200.0	106.0	109.2		53.0 %
06/15/2022	1438	H	200.0	176.0	174.8		88.0 %
06/15/2022	1445	L	200.0	48.2	46.9		24.1 %
06/15/2022	1450	M	200.0	106.0	109.2		53.0 %
06/15/2022	1455	H	200.0	176.0	174.9		88.0 %
06/15/2022	1502	L	200.0	48.2	48.0		24.1 %
06/15/2022	1507	M	200.0	106.0	109.2		53.0 %
06/15/2022	1512	H	200.0	176.0	174.8		88.0 %

Summary

Cal Gas Level	Reference Mean	CEMS Mean	Alt Perf Spec	Results
L	48.200	47.367	No	**1.7**
M	106.000	109.200	No	**3.0**
H	176.000	174.833	No	**0.7**

Linearity Report

ORIS Code:	56298	Facility Name:	ROSEVILLE ENERGY		
EDR Site ID:	CT002	Component ID:	A22	ReasonForTes	QA
		Component Type:	O2D	Grace Period:	0
Instrument	CT2_O2D_P_Instrument	Test End	06/16/2022	Scale:	High
Performance	5 %	Test No.:	120	Highest	0.6
		Status	**Passed**		

Date	Time	Cal Gas Level	Span Value	Ref Value	Meas Value	Aborted Test Indicator	Ref Value As Pct Span
06/16/2022	0525	L	21.0	5.0	5.0		23.8 %
06/16/2022	0531	M	21.0	11.2	11.2		53.3 %
06/16/2022	0536	H	21.0	18.1	18.0		86.2 %
06/16/2022	0543	L	21.0	5.0	5.0		23.8 %
06/16/2022	0548	M	21.0	11.2	11.2		53.3 %
06/16/2022	0553	H	21.0	18.1	18.0		86.2 %
06/16/2022	0600	L	21.0	5.0	5.0		23.8 %
06/16/2022	0605	M	21.0	11.2	11.2		53.3 %
06/16/2022	0610	H	21.0	18.1	18.0		86.2 %

Summary

Cal Gas Level	Reference Mean	CEMS Mean	Alt Perf Spec	Results
L	5.000	5.000	No	**0.0**
M	11.200	11.200	No	**0.0**
H	18.100	18.000	No	**0.6**

Cylinder Gas Audit

Facility:	ROSEVILLE ENERGY			Instrument	CT1_CODualRg_P_Instr
Unit/Stack:	CT1	Test Date:	06/14/2022	Performance	15 Pct
Parameter/Scal	CO / Low	Test	**Pass**	Alternate Spec:	5 Ppm

Date	Time	Test Level	Span Value	Reference	Measured Value	Ref Value As Pct Span
06/14/2022	09:31	L	10	2.400	2.300	24.0 %
06/14/2022	09:36	M	10	5.700	5.600	57.0 %
06/14/2022	09:44	L	10	2.400	2.200	24.0 %
06/14/2022	09:49	M	10	5.700	5.600	57.0 %
06/14/2022	09:56	L	10	2.400	2.200	24.0 %
06/14/2022	10:01	M	10	5.700	5.600	57.0 %

Summary

Cal Gas Level	Reference	Mean	CEMS Mean	Specification	Results
L	2.400		2.233	Std	**6.9**
M	5.700		5.600	Std	**1.8**

Cylinder Gas Audit

Facility:	ROSEVILLE ENERGY			Instrument	CT1_CODualRg_P_Instr
Unit/Stack:	CT1	Test Date:	06/14/2022	Performance	15 Pct
Parameter/Scal	CO / High	Test	**Pass**	Alternate Spec:	5 Ppm

Date	Time	Test Level	Span Value	Reference	Measured Value	Ref Value As Pct Span
06/14/2022	11:27	L	200	50.300	49.600	25.2 %
06/14/2022	11:32	M	200	112.800	114.200	56.4 %
06/14/2022	11:45	L	200	50.300	49.700	25.2 %
06/14/2022	11:50	M	200	112.800	114.300	56.4 %
06/14/2022	12:02	L	200	50.300	49.700	25.2 %
06/14/2022	12:07	M	200	112.800	114.300	56.4 %

Summary

Cal Gas Level	Reference Mean	CEMS Mean	Specification	Results
L	50.300	49.667	Std	**1.3**
M	112.800	114.267	Std	**1.3**

Cylinder Gas Audit

Facility:	ROSEVILLE ENERGY			Instrument	CT2_CODualRg_P_Instr
Unit/Stack:	CT2	Test Date:	06/15/2022	Performance	15 Pct
Parameter/Scal	CO / High	Test	**Pass**	Alternate Spec:	5 Ppm

Date	Time	Test Level	Span Value	Reference	Measured Value	Ref Value As Pct Span
06/15/2022	14:27	L	200	49.400	49.400	24.7 %
06/15/2022	14:32	M	200	112.700	114.400	56.4 %
06/15/2022	14:45	L	200	49.400	49.600	24.7 %
06/15/2022	14:50	M	200	112.700	113.900	56.4 %
06/15/2022	15:02	L	200	49.400	49.600	24.7 %
06/15/2022	15:07	M	200	112.700	114.300	56.4 %

Summary

Cal Gas Level	Reference Mean	CEMS Mean	Specification	Results
L	49.400	49.533	Std	**0.3**
M	112.700	114.200	Std	**1.3**

Cylinder Gas Audit

Facility:	ROSEVILLE ENERGY			Instrument	CT2_CODualRg_P_Instr
Unit/Stack:	CT2	Test Date:	06/16/2022	Performance	15 Pct
Parameter/Scal	CO / Low	Test	**Pass**	Alternate Spec:	5 Ppm

Date	Time	Test Level	Span Value	Reference	Measured Value	Ref Value As Pct Span
06/16/2022	08:28	L	10	2.400	2.200	24.0 %
06/16/2022	08:33	M	10	5.700	5.500	57.0 %
06/16/2022	08:40	L	10	2.400	2.200	24.0 %
06/16/2022	08:45	M	10	5.700	5.500	57.0 %
06/16/2022	08:52	L	10	2.400	2.200	24.0 %
06/16/2022	08:57	M	10	5.700	5.500	57.0 %

Summary

Cal Gas Level	Reference Mean	CEMS Mean	Specification	Results
L	2.400	2.200	Std	**8.3**
M	5.700	5.500	Std	**3.5**

Roseville Energy Park
Revision History

RegPerfect® by Teledyne Monitor Labs, Inc.
Teledyne Monitor Labs, Inc.
35 Inverness Drive East
Englewood, CO 80112-5189
Telephone: (800) 846-6062
http://www.teledyne-ml.com/
http://www.regperfect.com/
©1998-2005 Teledyne Monitor Labs, Inc. All rights reserved.
RegPerfect® is a registered trademark of Teledyne Monitor Labs, Inc.

NOTE: This server's C drive is only 20 GB in size!! Do not place large files on this drive.

7/1/22 William Vanhorn
Checking to see if the NOx excess emissions are correct on 6/30.

6/21/22 Taylor Sullivan
EDR check

6/2/22 Taylor Sullivan
EDR check

5/5/22 Taylor Sullivan
EDR check

4/20-21/22 Taylor Sullivan
Q1 EDR

CEMs Log

Date/Time	Operator	Description
06/30/22 16:43 CALIBRATION	Operator (DWN)	DURING START-UP OF CT2 THE COLD START-UP BIT WAS ACTIVE AND THEN CLEARED AFTER 4 MINUTES BEFORE THE UNIT WAS IN COMPLIANCE. AFTER START WAS SATISFACTORY. MULTIPLE EXCESS EMISSIONS ALARMS CAME IN THE NEXT HOUR AFTER THE START. THE SIGNAL FROM THE DCS INDICATING CT2 RUNNING WAS ACTIVE DURING THE ENTIRE START
06/30/22 7:12	Operator (DWN)	UNIT 2 LOW NOX/CO. NOX 8.112 / CO 8.78 CYLINDER EB0016152
06/28/22 16:57	Operator (RC)	CHANGED UNIT A HIGH NOX/CO 175/182.4, CYLINDER #EB0030587 EXP DEC-2-2024
06/28/22 11:55	Operator (RC)	CHANGED UNIT 2 HIGH NOX/CO, 182/ 184.3, CYLINDER # EB0096684 EXP JAN-5-2025
06/23/22 15:08	Operator (BRB)	Zeroed and Spanned both SCR NOX low ranges after 2X warning on unit 1 and 1X alert on unit 2
06/20/22 23:54	Operator (RC)	CHANGED UNIT 1 O2 BOTTLE # CC206982, 18.13% EXP DATE 1/5/2027
06/20/22 12:17	Operator (RC)	CHANGED OUT CT-2 INLET NOX CYL#EB0144538. NEW VALUE 26.25
06/16/22 12:18	Operator (EO)	CHANGED OUT CT-1 INLET NOX CYL# EB0144539, EXP 12/29/24 & CT-1 LOW NOX CYL# EB0039007, EXP 10/20/23
06/15/22 13:04	Operator (ME)	CHANGED OUT LOW O2 BOTTLE (LINEARITY) CT2, NEW VALUE: 5.018% CYLINDER # EB0095516 EXPIRATION DATE: 12/10/2025
06/07/22 20:00	Operator (ME)	AFTER MUCH DELIBERATION AND TROUBLESHOOTING, WE FOUND THAT AN ADJUSTMENT NEEDED TO BE MADE TO THE SYNC/DEMOD GAIN POTENTIOMETER TO ADJUST THE RAW MV SIGNAL TO 4500.
06/07/22 14:47	Operator (LH)	CHANGED UNIT 2 O2 BOTTLE 18.015 #EB0018098
06/07/22 10:29	Operator (ME)	LOW NOX /CO FOR CT2 CORRECTED FROM 9.529 TO 9.592 FOR LINEARITY TEST RUNS.
06/02/22 9:53	Operator (CC)	UPDATED GCV FOR JUNE TO 105,000
05/19/22 15:09	Operator (RG)	CT2 REPLACED CO ANALZYER PUMP. RAN MANUAL CALIBRATION. ALL SAT.
05/18/22 7:51	Operator (ME)	CT1 INLET NOX MANUALLY CALIBRATED. ALL SAT.
05/06/22 6:13	Operator (BRB)	REPLACED scr LOW AND HIGH NOX CO Daily bottles
05/04/22 13:46	Operator (BRB)	MANUAL HANDS OFF SCR CAL UNIT 1
05/04/22 13:03	Operator (BRB)	Spanned gasses on analyzers for NOX stack and SCR unit 1 and reinitiated the daily cal
05/04/22 4:38	Operator (DE)	UPDATED GCV VALUE FOR MAY TO 104,000
04/28/22 10:12	Operator (DWN)	DAHS COMPUTER REBOOTED BY RE - IT FOR SYSTEM UPDATES
04/04/22 7:24	Operator (DWN)	SWAPPED TO ALTERNATE FEED POWER SOURCE CAUSING ANALYZER FAULT ALARMS WHILE THE PLANT WAS BLACK

Date/Time	Operator	Description
04/03/22 14:23	Operator (JB)	UPDATED GCV VALUE FOR APRIL TO 103,800

CO Ppmvdc EDS/CMS Summary Report

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 07/08/2022 01:05 **Location:** Roseville, CA
Description: Electric Utility

CMS Data from: CT1_CO_Ppmvdc_1H
EDS Data from: CT1_CO_Ppmvdc_3H
Emission Limitation: 4
No Value Exclusions Allowed
Monitor Manufacturer and Model No.: TELEDYNE MONITOR LABS INC, TML30
Date of Latest CMS Certification or Audit: 04/09/2006 14:00
Process Unit(s) Description:

Operating time for EDS: 748.00 Hour(s)
Operating time for CMS: 748.00 Hour(s)

Emission Data Summary	
1. Duration of excess emission in reporting period due to:	
a. Startup/shutdown	0
b. Control equipment problems	0
c. Process Problems	0
d. Other known causes	0
e. Unknown causes	0
2. Upset Conditions	0
3. Total Duration (Subtracts Exclusions and Upset Conditions)	0
4. Time of Excess Emission as a percentage of operating time	0.00
5. Time in compliance as percentage of operating time	100.00

CMS Performance Summary	
1. CMS downtime in reporting period due to:	
a. Monitor equipment malfunctions	0
b. Non-Monitor equipment malfunctions	0
c. Quality assurance calibration	0
d. Other known causes	0
e. Unknown causes	3
2. Total CMS Downtime	3
3. Total Downtime as a percentage of operating time	0.40
4. Total Availability as a percentage of operating time	99.60

Note: The total duration of EDS (<1%) and CMS (<5%) incidents meets federal standard 40CFR60.7(d), therefore the excess emmission detail report may not be required as part of the quarterly/semi-annual submission unless requested by the Administrator.

NOx Ppmvdc EDS/CMS Summary Report

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 07/08/2022 01:06 **Location:** Roseville, CA
Description: Electric Utility

CMS Data from: CT1_NOx_Ppmvdc_1H
EDS Data from: CT1_NOx_Ppmvdc_1H
Emission Limitation: 2.0
No Value Exclusions Allowed
Monitor Manufacturer and Model No.: TELEDYNE MONITOR LABS INC, TML41-O2
Date of Latest CMS Certification or Audit: 04/09/2006 14:00
Process Unit(s) Description:

Operating time for EDS: 748.00 Hour(s)
Operating time for CMS: 748.00 Hour(s)

Emission Data Summary	
1. Duration of excess emission in reporting period due to:	
a. Startup/shutdown	0
b. Control equipment problems	0
c. Process Problems	0
d. Other known causes	0
e. Unknown causes	0
2. Upset Conditions	0
3. Total Duration (Subtracts Exclusions and Upset Conditions)	0
4. Time of Excess Emission as a percentage of operating time	0.00
5. Time in compliance as percentage of operating time	100.00

CMS Performance Summary	
1. CMS downtime in reporting period due to:	
a. Monitor equipment malfunctions	0
b. Non-Monitor equipment malfunctions	0
c. Quality assurance calibration	0
d. Other known causes	0
e. Unknown causes	3
2. Total CMS Downtime	3
3. Total Downtime as a percentage of operating time	0.40
4. Total Availability as a percentage of operating time	99.60

Note: The total duration of EDS (<1%) and CMS (<5%) incidents meets federal standard 40CFR60.7(d), therefore the excess emmission detail report may not be required as part of the quarterly/semi-annual submission unless requested by the Administrator.

CO Ppmvdc EDS/CMS Summary Report

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 07/08/2022 01:07 **Location:** Roseville, CA
Description: Electric Utility

CMS Data from: CT2_CO_Ppmvdc_1H
EDS Data from: CT2_CO_Ppmvdc_3H
Emission Limitation: 4
No Value Exclusions Allowed
Monitor Manufacturer and Model No.: TELEDYNE MONITOR LABS INC, TML30
Date of Latest CMS Certification or Audit: 04/10/2006 07:00
Process Unit(s) Description:

Operating time for EDS: 672.00 Hour(s)
Operating time for CMS: 672.00 Hour(s)

Emission Data Summary	
1. Duration of excess emission in reporting period due to:	
a. Startup/shutdown	0
b. Control equipment problems	0
c. Process Problems	0
d. Other known causes	0
e. Unknown causes	0
2. Upset Conditions	0
3. Total Duration (Subtracts Exclusions and Upset Conditions)	0
4. Time of Excess Emission as a percentage of operating time	0.00
5. Time in compliance as percentage of operating time	100.00

CMS Performance Summary	
1. CMS downtime in reporting period due to:	
a. Monitor equipment malfunctions	0
b. Non-Monitor equipment malfunctions	0
c. Quality assurance calibration	0
d. Other known causes	0
e. Unknown causes	32
2. Total CMS Downtime	32
3. Total Downtime as a percentage of operating time	4.76
4. Total Availability as a percentage of operating time	95.24

Note: The total duration of EDS (<1%) and CMS (<5%) incidents meets federal standard 40CFR60.7(d), therefore the excess emmission detail report may not be required as part of the quarterly/semi-annual submission unless requested by the Administrator.

NOx Ppmvdc EDS/CMS Summary Report

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 07/08/2022 01:08 **Location:** Roseville, CA
Description: Electric Utility

CMS Data from: CT2_NOx_Ppmvdc_1H
EDS Data from: CT2_NOx_Ppmvdc_1H
Emission Limitation: 2.0
No Value Exclusions Allowed
Monitor Manufacturer and Model No.: TELEDYNE MONITOR LABS INC, TML41-O2
Date of Latest CMS Certification or Audit: 04/10/2006 07:00
Process Unit(s) Description:

Operating time for EDS: 672.00 Hour(s)
Operating time for CMS: 672.00 Hour(s)

Emission Data Summary	
1. Duration of excess emission in reporting period due to:	
a. Startup/shutdown	0
b. Control equipment problems	0
c. Process Problems	0
d. Other known causes	0
e. Unknown causes	0
2. Upset Conditions	0
3. Total Duration (Subtracts Exclusions and Upset Conditions)	0
4. Time of Excess Emission as a percentage of operating time	0.00
5. Time in compliance as percentage of operating time	100.00

CMS Performance Summary	
1. CMS downtime in reporting period due to:	
a. Monitor equipment malfunctions	0
b. Non-Monitor equipment malfunctions	0
c. Quality assurance calibration	0
d. Other known causes	0
e. Unknown causes	10
2. Total CMS Downtime	10
3. Total Downtime as a percentage of operating time	1.49
4. Total Availability as a percentage of operating time	98.51

Note: The total duration of EDS (<1%) and CMS (<5%) incidents meets federal standard 40CFR60.7(d), therefore the excess emmission detail report may not be required as part of the quarterly/semi-annual submission unless requested by the Administrator.

CO Invalid Data

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 07/08/2022 01:09 **Location:** Roseville, CA

Tag Name: CT1_CO_Ppm_1H
Total Operating Time: 748.00 Hour(s)
Non-Operating Time: 1,436.00 Hour(s) Report Time: 2,184.00 Hour(s)

No incidents have been reported for this reporting period. Monitor has 100% availability.

Total Operating Time:	**748.00 Hour(s)**
Total Monitor Downtime (Online only):	**0.00 Hour(s)**
Percent Monitor Availability:	**100.00 %**
Percent Monitor Downtime:	**0.00 %**

NOx Invalid Data

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 07/08/2022 01:09 **Location:** Roseville, CA

Tag Name: CT1_NOx_Ppm_1H
Total Operating Time: 748.00 Hour(s)
Non-Operating Time: 1,436.00 Hour(s) Report Time: 2,184.00 Hour(s)

Inc No	Start Time	End Time	Duration in Hour(s)	Reason Code - Description	Action Code - Description
1	04/29/2022 07:00	04/29/2022 07:59	1	8 - No prior online calibration within 26 hours	
2	04/29/2022 08:00	04/29/2022 08:59	1	8 - No prior online calibration within 26 hours	
3	04/29/2022 09:00	04/29/2022 09:59	1	3 - Quality assurance calibration	

Total Operating Time:	**748.00 Hour(s)**
Total Monitor Downtime (Online only):	**3.00 Hour(s)**
Percent Monitor Availability:	**99.60 %**
Percent Monitor Downtime:	**0.40 %**

Report Code	Type	Text	Duration	Duration Percent
8	Reason	No prior online calibration within 26 hours	2	66.67
3	Reason	Quality assurance calibration	1	33.33

NOx SCR Invalid Data

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 07/08/2022 01:10 **Location:** Roseville, CA

Tag Name: CT1_NOx_SCR_Ppm_1H
Total Operating Time: 748.00 Hour(s)
Non-Operating Time: 1,436.00 Hour(s) Report Time: 2,184.00 Hour(s)

No incidents have been reported for this reporting period. Monitor has 100% availability.

Total Operating Time:	**748.00 Hour(s)**
Total Monitor Downtime (Online only):	**0.00 Hour(s)**
Percent Monitor Availability:	**100.00 %**
Percent Monitor Downtime:	**0.00 %**

O2 Invalid Data

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 07/08/2022 01:11 **Location:** Roseville, CA

Tag Name: CT1_O2Dry_Pct_1H
Total Operating Time: 748.00 Hour(s)
Non-Operating Time: 1,436.00 Hour(s) Report Time: 2,184.00 Hour(s)

Inc No	Start Time	End Time	Duration in Hour(s)	Reason Code - Description	Action Code - Description
1	04/29/2022 07:00	04/29/2022 07:59	1	8 - No prior online calibration within 26 hours	
2	04/29/2022 08:00	04/29/2022 08:59	1	8 - No prior online calibration within 26 hours	
3	04/29/2022 09:00	04/29/2022 09:59	1	3 - Quality assurance calibration	

Total Operating Time:	**748.00 Hour(s)**
Total Monitor Downtime (Online only):	**3.00 Hour(s)**
Percent Monitor Availability:	**99.60 %**
Percent Monitor Downtime:	**0.40 %**

Report Code	Type	Text	Duration	Duration Percent
8	Reason	No prior online calibration within 26 hours	2	66.67
3	Reason	Quality assurance calibration	1	33.33

CO Invalid Data

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 07/08/2022 01:12 **Location:** Roseville, CA

Tag Name: CT2_CO_Ppm_1H
Total Operating Time: 672.00 Hour(s)
Non-Operating Time: 1,512.00 Hour(s) Report Time: 2,184.00 Hour(s)

Inc No	Start Time	End Time	Duration in Hour(s)	Reason Code - Description	Action Code - Description
1	05/19/2022 12:00	05/19/2022 12:59	1		
2	05/25/2022 03:00	05/25/2022 03:59	1	3 - Quality assurance calibration	
3	05/25/2022 04:00	05/25/2022 04:59	1		
4	05/25/2022 05:00	05/25/2022 05:59	1		
5	05/25/2022 06:00	05/25/2022 06:59	1		
6	05/25/2022 07:00	05/25/2022 07:59	1		
7	05/25/2022 08:00	05/25/2022 08:59	1		
8	05/25/2022 09:00	05/25/2022 09:59	1		
9	05/25/2022 10:00	05/25/2022 10:59	1		
10	05/25/2022 11:00	05/25/2022 11:59	1		
11	05/25/2022 12:00	05/25/2022 12:59	1		
12	05/25/2022 13:00	05/25/2022 13:59	1		
13	05/25/2022 14:00	05/25/2022 14:59	1		
14	05/25/2022 15:00	05/25/2022 15:59	1		
15	05/25/2022 16:00	05/25/2022 16:59	1		
16	05/25/2022 17:00	05/25/2022 17:59	1		
17	05/25/2022 18:00	05/25/2022 18:59	1		
18	05/25/2022 19:00	05/25/2022 19:59	1		
19	05/25/2022 20:00	05/25/2022 20:59	1		
20	05/25/2022 21:00	05/25/2022 21:59	1		
21	05/25/2022 22:00	05/25/2022 22:59	1		
22	05/25/2022 23:00	05/25/2022 23:59	1		
23	05/26/2022 14:00	05/26/2022 14:59	1		
24	06/07/2022 13:00	06/07/2022 13:59	1	3 - Quality assurance calibration	
25	06/07/2022 14:00	06/07/2022 14:59	1		
26	06/07/2022 15:00	06/07/2022 15:59	1	6 - Under investigation	

CO Invalid Data

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 07/08/2022 01:12 **Location:** Roseville, CA

Tag Name: CT2_CO_Ppm_1H
Total Operating Time: 672.00 Hour(s)
Non-Operating Time: 1,512.00 Hour(s) Report Time: 2,184.00 Hour(s)

Inc No	Start Time	End Time	Duration in Hour(s)	Reason Code - Description	Action Code - Description
27	06/07/2022 16:00	06/07/2022 16:59	1	6 - Under investigation	
28	06/07/2022 17:00	06/07/2022 17:59	1	6 - Under investigation	
29	06/07/2022 18:00	06/07/2022 18:59	1	6 - Under investigation	
30	06/07/2022 19:00	06/07/2022 19:59	1	3 - Quality assurance calibration	

Total Operating Time:	**672.00 Hour(s)**
Total Monitor Downtime (Online only):	**30.00 Hour(s)**
Percent Monitor Availability:	**95.54 %**
Percent Monitor Downtime:	**4.46 %**

Report Code	Type	Text	Duration	Duration Percent
3	Reason	Quality assurance calibration	3	10.00
6	Reason	Under investigation	4	13.33

NOx Invalid Data

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 07/08/2022 01:13 **Location:** Roseville, CA

Tag Name: CT2_NOx_Ppm_1H
Total Operating Time: 672.00 Hour(s)
Non-Operating Time: 1,512.00 Hour(s) Report Time: 2,184.00 Hour(s)

Inc No	Start Time	End Time	Duration in Hour(s)	Reason Code - Description	Action Code - Description
1	05/19/2022 12:00	05/19/2022 12:59	1		
2	06/07/2022 11:00	06/07/2022 11:59	1	14 - Unit startup, not enough samples for a valid hour	
3	06/07/2022 12:00	06/07/2022 12:59	1		
4	06/07/2022 13:00	06/07/2022 13:59	1	3 - Quality assurance calibration	
5	06/07/2022 14:00	06/07/2022 14:59	1		
6	06/07/2022 15:00	06/07/2022 15:59	1	6 - Under investigation	
7	06/07/2022 16:00	06/07/2022 16:59	1	6 - Under investigation	
8	06/07/2022 17:00	06/07/2022 17:59	1	6 - Under investigation	
9	06/07/2022 18:00	06/07/2022 18:59	1	6 - Under investigation	
10	06/07/2022 19:00	06/07/2022 19:59	1	3 - Quality assurance calibration	

Total Operating Time:	**672.00 Hour(s)**
Total Monitor Downtime (Online only):	**10.00 Hour(s)**
Percent Monitor Availability:	**98.51 %**
Percent Monitor Downtime:	**1.49 %**

Report Code	Type	Text	Duration	Duration Percent
3	Reason	Quality assurance calibration	2	20.00
6	Reason	Under investigation	4	40.00
14	Reason	Unit startup, not enough samples for a valid hour	1	10.00

NOx SCR Invalid Data

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 07/08/2022 01:14 **Location:** Roseville, CA

Tag Name: CT2_NOx_SCR_Ppm_1H
Total Operating Time: 672.00 Hour(s)
Non-Operating Time: 1,512.00 Hour(s) Report Time: 2,184.00 Hour(s)

No incidents have been reported for this reporting period. Monitor has 100% availability.

Total Operating Time:	**672.00 Hour(s)**
Total Monitor Downtime (Online only):	**0.00 Hour(s)**
Percent Monitor Availability:	**100.00 %**
Percent Monitor Downtime:	**0.00 %**

O2 Invalid Data

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 07/08/2022 01:15 **Location:** Roseville, CA

Tag Name: CT2_O2Dry_Pct_1H
Total Operating Time: 672.00 Hour(s)
Non-Operating Time: 1,512.00 Hour(s) Report Time: 2,184.00 Hour(s)

Inc No	Start Time	End Time	Duration in Hour(s)	Reason Code - Description	Action Code - Description
1	05/19/2022 12:00	05/19/2022 12:59	1		
2	06/07/2022 11:00	06/07/2022 11:59	1	14 - Unit startup, not enough samples for a valid hour	
3	06/07/2022 12:00	06/07/2022 12:59	1		
4	06/07/2022 13:00	06/07/2022 13:59	1	3 - Quality assurance calibration	
5	06/07/2022 14:00	06/07/2022 14:59	1		
6	06/07/2022 15:00	06/07/2022 15:59	1	6 - Under investigation	
7	06/07/2022 16:00	06/07/2022 16:59	1	6 - Under investigation	
8	06/07/2022 17:00	06/07/2022 17:59	1	6 - Under investigation	
9	06/07/2022 18:00	06/07/2022 18:59	1	6 - Under investigation	
10	06/07/2022 19:00	06/07/2022 19:59	1	3 - Quality assurance calibration	

Total Operating Time:	**672.00 Hour(s)**
Total Monitor Downtime (Online only):	**10.00 Hour(s)**
Percent Monitor Availability:	**98.51 %**
Percent Monitor Downtime:	**1.49 %**

Report Code	Type	Text	Duration	Duration Percent
3	Reason	Quality assurance calibration	2	20.00
6	Reason	Under investigation	4	40.00
14	Reason	Unit startup, not enough samples for a valid hour	1	10.00

ATTACHMENT 7

AQ-36

AQ-36: The project owner shall notify the _PCAPCD of any breakdown condition as soon as reasonably possible, but no later than two PCAPCD business hours after its detection.

Verification: The Project owner shall include the identification of all breakdowns, PCAPCD notification, resulting excess emission (if any) and corrective actions taken (if any) as part of the Quarterly Air Quality Report required in Condition of Certification AQ-SC6

| | | |

Year: 2022-004

Non-Compliance Event Number

UPSET / BREAKDOWN AND EMERGENCY CHECKLIST

Company Name	Roseville Energy Park	**Address**	5120 Phillip Rd. Roseville		
Detection of Non-Compliance Event	**Date** 6-7-22	**Time** 14:00	☐ AM ☑ PM		

Complete the following questions associated with determining whether an event is an "Upset/Breakdown" Event pursuant to Rule 404, and/or an "Emergency" Event pursuant to Rule 507. To be considered as a legitimate Upset / Breakdown or Emergency event, all of the checklist questions must be answered with a "Yes" checkmark.

Yes	No		
☑	☐	1.	Equipment associated with the breakdown event have been designed, maintained, and operated in a manner consistent with minimizing emissions.
☑	☐	2.	The amount and duration of emissions as a result of the event have been minimized.
☑	☐	3.	The event is not part of a recurring pattern of previous breakdowns of the same equipment for same/similar reasons that are indicative of inadequate equipment design, operation, or maintenance.
☑	☐	4.	The event is not the result of operator error, negligence, carelessness, or willful misconduct (i.e., the facility is being properly operated).
☑	☐	5.	The event is not the result of improper equipment design.
☑	☐	6.	The event is not the result of improper preventative maintenance of equipment.
☑	☐	7.	The event is the result of a sudden, unavoidable breakdown of equipment, beyond the control of the operator.
☑	☐	8.	The event could not have been foreseen or avoided or planned for, and could not have been avoided or prevented by better operating and maintenance practices.
☑	☐	9.	The event has not resulted in a nuisance.
☑	☐	10.	The event is not the result of the disregard of air pollution rules or regulations.
☑	☐	11.	This Upset / Breakdown form has been completed and submitted to the District in a timely manner -- within 7 calendar days from the end of the Non-Compliance Event.
☑	☐	12.	Immediate corrective actions have been taken to minimize emissions, as described in Item 11 on the Part I Non-Compliance Event Notification Form.

I certify under penalty of law that I am the responsible official for this facility, or his/her duly designated representative, and based on information and belief formed after reasonable inquiry, the statements and information in this document are true, accurate, and complete.

Signature Tom Flynn 6.8.22

You are requesting that the District not take enforcement action because the Non-Compliance Event is the result of an "Upset / Breakdown" Event under District Rule 404. A breakdown condition means an unforeseeable failure or malfunction of 1) any air pollution control equipment or related operating equipment which causes a violation of any emission limitations or restriction prescribed by the District Rules and Regulations, or by State law, or 2) any in-stack continuous monitoring equipment, where such failure or malfunction: (1) is not the result of neglect or disregard of any air pollution control law or rule or regulation; (2) is not intentional or the result of negligence; (3) is not the result of improper maintenance; (4) does not constitute a nuisance; (5) is not a recurrent breakdown of the same equipment. You have the burden of providing sufficient information to demonstrate that the Upset / Breakdown was an unforeseeable equipment failure or malfunction that meets the above listed criteria. This checklist must be completed and returned to the District with either the Part 1 or Part II Non-Compliance Event Notification form to attest to your having made this determination. Submission of a request for shielding from enforcement action does not by itself confer such a shield. If breakdown or emission exceeding operations continue after the breakdown or emission exceedance is identified, the possibility exists that the District after consideration of the information provided, the timeliness and completeness of the submittals, and a comparison to other like breakdowns, may ultimately determine that the Non-Compliance Event was not the result of a legitimate Upset / Breakdown event and may elect to take enforcement action. Action to return to compliance should be accomplished as expeditiously as possible. Thus, you are advised to: (1) assure that the breakdown meets the criteria for an unforeseeable failure or malfunction; (2) minimize emissions resulting from the event to the maximum degree possible; and (3) assure that the required failure and malfunction information and information on the corrective actions taken is provided to the District in a complete and timely manner.

CITY OF ROSEVILLE CALIFORNIA

Roseville Electric
Roseville Energy Park
5120 Phillip Road
Roseville, California 95747

Tony Johnson
Operations and Maintenance Supervisor
Roseville Energy Park
5120 Phillip Road
Roseville, California 95747

Subject: Non-Compliance Event Upset Breakdown Notification form 2022-004

To Whom It May Concern:

This memo is to provide additional information for Non-Compliance Event Notification form 2022-004.

On 6-7-2022, Roseville Energy Park's Combustion Turbine #2 (CT2) was dispatched and a start-initiate took place at 12:30 so the unit could be online at 13:00. The startup was normal but the indicated CO emissions on the Continuous Emissions Monitoring System (CEMS) were unusually erratic. A manual CEMS calibration was initiated around 13:20 by the operator and the result was a failed calibration. Troubleshooting began with confirming the calibration gas bottles were of sufficient pressure and the supply valves were open. We then began looking at the turbine's burner flame pulsations and air intake to ensure we were not having true CO emissions and at this time all indications appeared normal. At 13:58 the CEMS was placed in maintenance mode to troubleshoot the CO analyzer.

A Part I was filed out of abundance of caution at 15:35.

An Instrument Technician was called to investigate the erratic CO numbers and tried calibrating the CO analyzer but could not get any realistic numbers. The Technician accessed the equipment manual and located the troubleshooting guide that directed him to adjust the Sync/Demod Gain Potentiometer until the CO read correctly. The adjustments were made (see attachments) and the analyzer was calibrated against EPA Protocol gases and passed calibration according to the CEMS at 19:35. The unit was shut down a shortly after the correction. No excess emissions occurred during this evolution.

Let me know if you have any questions.

Sincerely,

Tony Johnson

6.13.22

(916) 746-1656 • *Fax* (916) 746-1655 • ajohnson@roseville.ca.us

Johnson, Anthony

From: Brown, Bradley
Sent: Wednesday, June 8, 2022 6:00 AM
To: Johnson, Anthony
Cc: Vasquez, Ediberto; Estes, Michael; Garcia, Rony
Subject: Cems unit 2 Breakdown

After a lot of troubleshooting calling for help and looking through the manual we came to the step where we needed to go through the procedure to adjust the Sync/Demod Gain Potentiometer. After doing this the readings looked very normal and we spanned gas to the analyzer and put it in a hands off Calibration with Great results. We will continue to monitor the analyzer to make sure things stay steady.

Figure 11-19: Location of Sync/Demod Housing Mo

7. Adjust potentiometer VR1 until **CO MEAS** reads 4500 mV ± 300 m

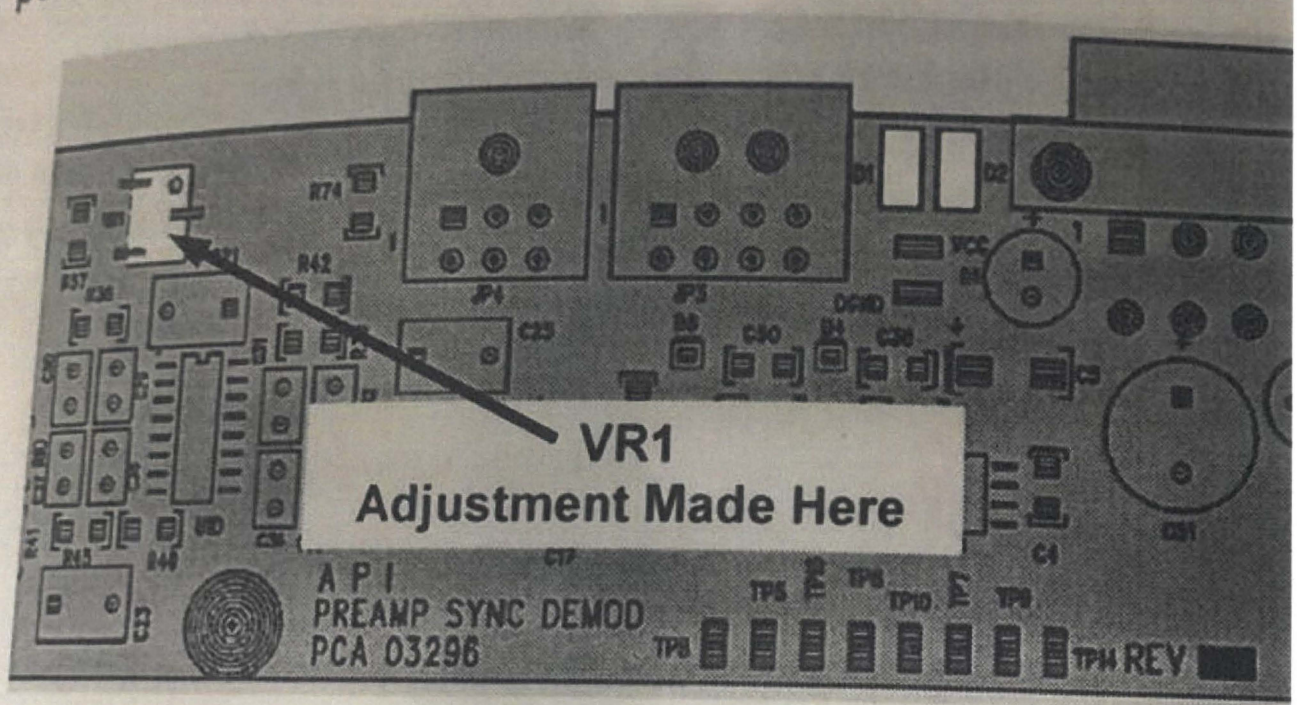
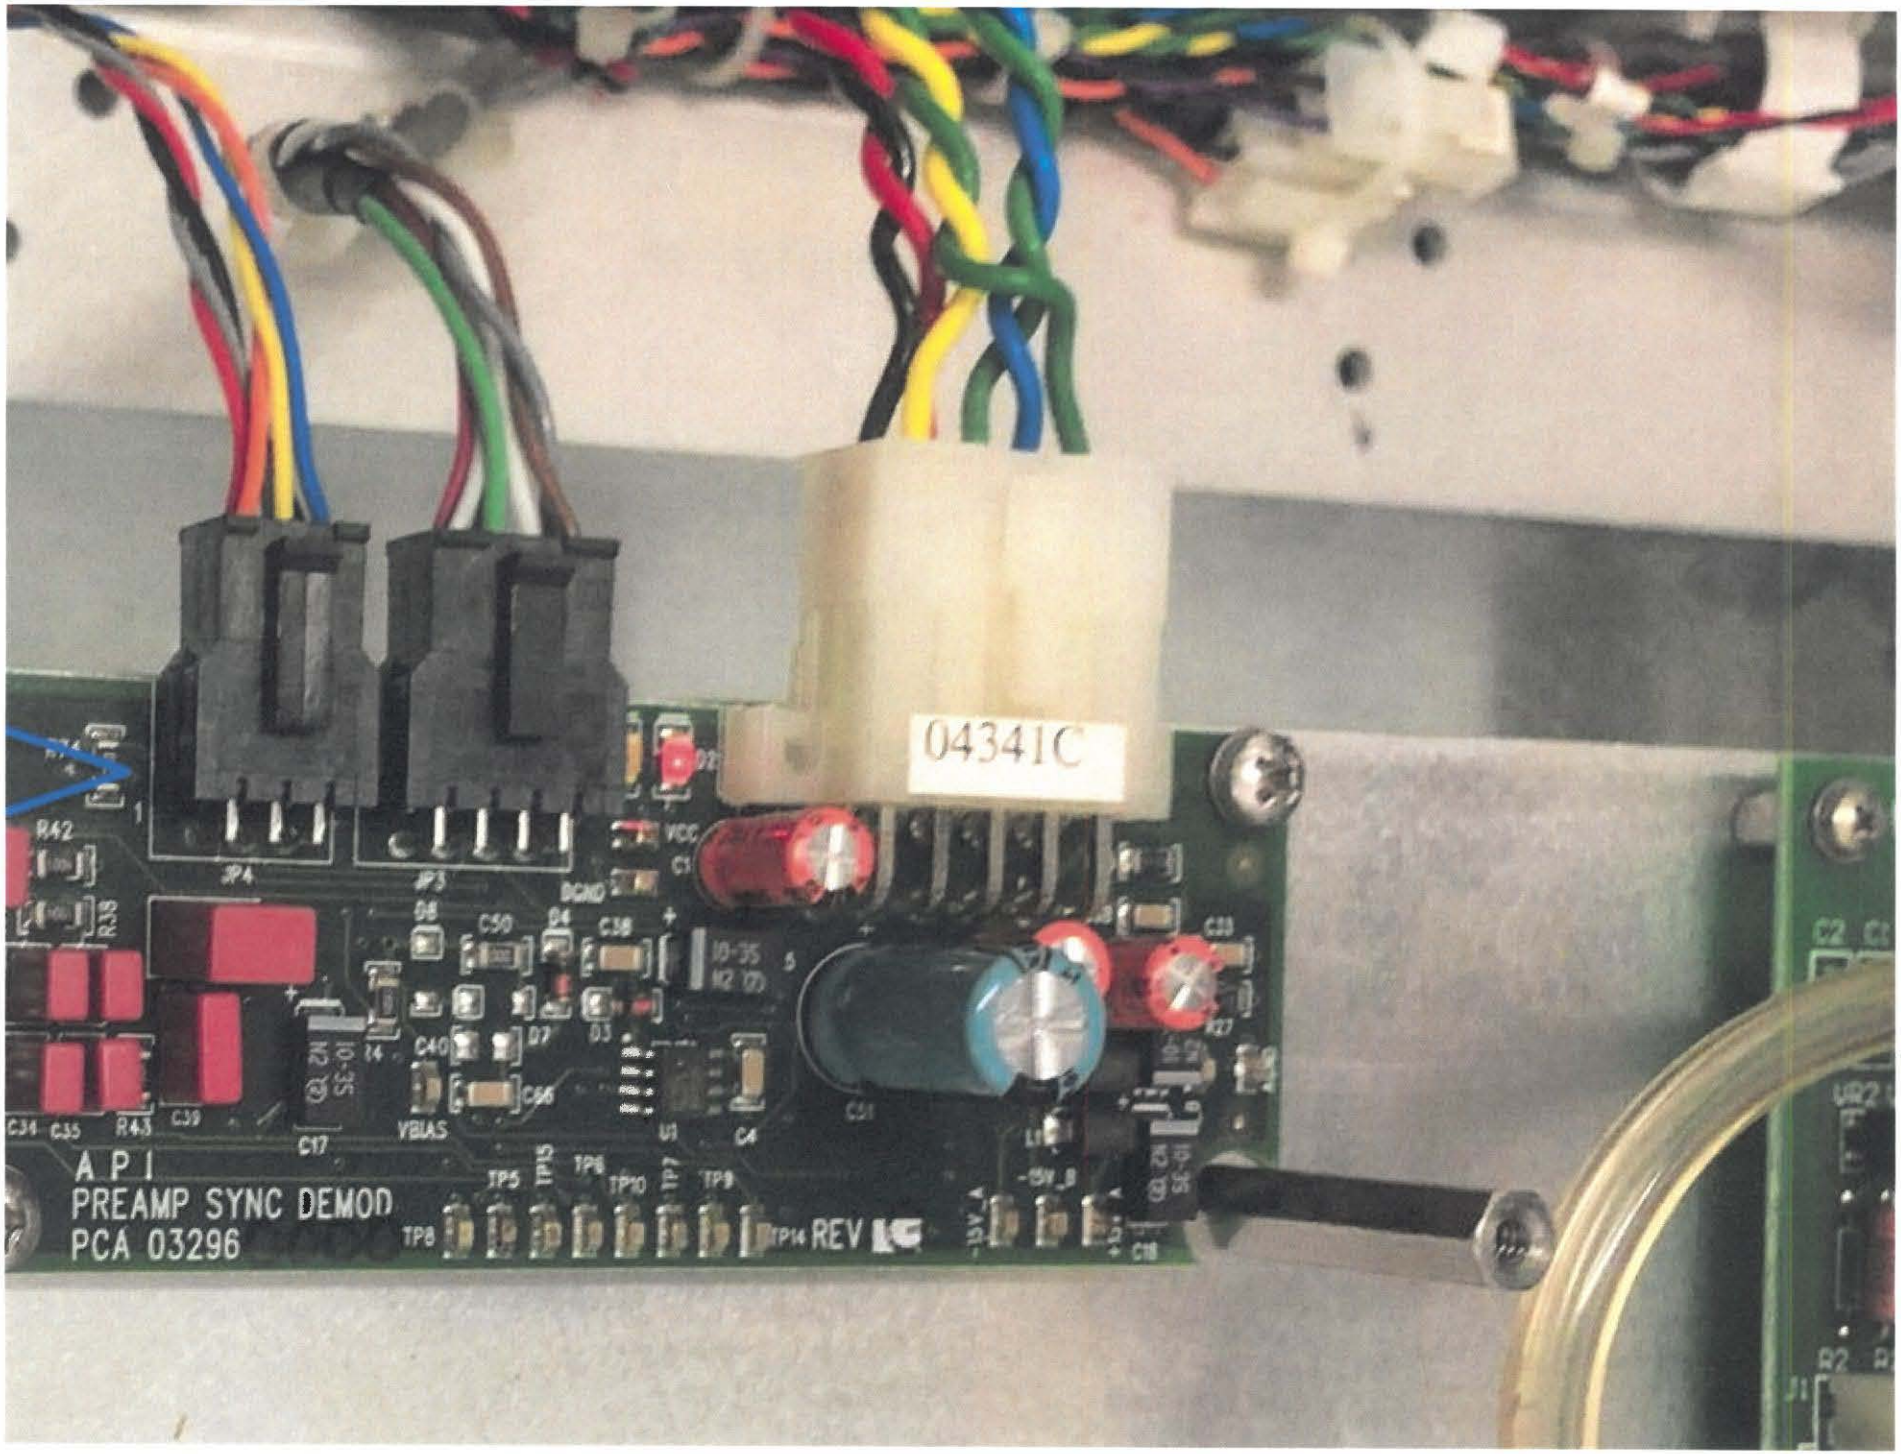


Figure 11-20: Location of Sync/Demod Gain Po


04341C
API
PREAMP SYNC DEMOD
PCA 03296
REV

Daily Calibration Results

CT1 and CT2

From: 06/07/2022 00:01 **To:** 06/07/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 06/13/2022 09:41 **Location:** Roseville, CA

All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online		Pass
	Zero	06/07/22 13:21	200.0	0.0	3.5		|R-A|/Span * 100	1.8
	High	06/07/22 13:32	200.0	182.3	179.4		|R-A|/Span * 100	1.5
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online		Fail
	Zero	06/07/22 13:21	10.0	0.0	42.2	>4x	|R-A|/Span * 100	422.0
	High	06/07/22 13:26	10.0	9.6	32.4	>4x	|R-A|/Span * 100	228.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online		Pass
	Zero	06/07/22 13:21	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/07/22 13:32	200.0	176.0	174.8		|R-A|/Span * 100	0.6
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online		Pass
	Zero	06/07/22 13:21	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/07/22 13:26	10.0	8.8	8.8		|R-A|/Span * 100	0.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online		Pass
	High	06/07/22 13:21	21.0	18.1	18.1		|R-A|	0.0
	Zero	06/07/22 13:26	21.0	0.0	0.0		|R-A|	0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online		Pass
	Zero	06/07/22 19:35	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/07/22 19:46	200.0	182.3	182.2		|R-A|/Span * 100	0.1
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online		Pass
	Zero	06/07/22 19:35	10.0	0.0	0.1		|R-A|/Span * 100	1.0
	High	06/07/22 19:41	10.0	9.6	9.5		|R-A|/Span * 100	1.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online		Pass
	Zero	06/07/22 19:35	200.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/07/22 19:46	200.0	176.0	174.8		|R-A|/Span * 100	0.6
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online		Pass
	Zero	06/07/22 19:35	10.0	0.0	0.0		|R-A|/Span * 100	0.0
	High	06/07/22 19:41	10.0	8.8	8.8		|R-A|/Span * 100	0.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online		Pass
	High	06/07/22 19:35	21.0	18.0	18.0		|R-A|	0.0
	Zero	06/07/22 19:41	21.0	0.0	0.0		|R-A|	0.0

				-		2022	005

Year | Non-Compliance Event Number

Placer County
110 Maple Street, Auburn, CA 95603 • (530) 745-2330 • Fax (530) 745-2373 • www.placerair.org
Erik C. White, Air Pollution Control Officer

NON-COMPLIANCE EVENT NOTIFICATION FORM – PART I

submit within 2 business hours after detection of the Non-Compliance Event

1.	**Company Name**	**ROSEVILLE ENERGY PARK**				**5120 PHILLIP ROAD**		
2.	**Title V Source Status**	**Major** Yes ■	No ☐	**Synthetic Minor** Yes ☐	No ■			
3.	**For Title V Sources, is the Non-Compliance Event the Result of an Emergency under District Rule 507, Section 402.2(I)**						Yes ☐	No ■
4.	**Emission Exceedances**	NOx ☐	SOx ☐	PM ☐	VOC ☐	CO ☐	Opacity ☐	None ☐ check all that apply
5.	**CEMS / COMS / CMS Breakdown**	Yes ■	No ☐					
6.	**Detection of Non-Compliance Event**	**Date** 6-30-22	**Time** 16:30	☐ AM ☐ PM				
7.	**Start of Non-Compliance Event**	**Date** 6-30-22	**Time** 15:30	☐ AM ☐ PM ☐ Not known				
8.	**Violation**	**Permit No.** REPR-20-02	**Condition No.**	**Rule**	**Section**			
9.	**Unit / Equipment Involved**	CT2						
10.	**Description / Cause of Non-Compliance Event** information attached	**Startup bit expired after only 4 minutes**	☐ additional					
11.	**Immediate Corrective Actions**	**Performed a callbration of analyzers** ☐ additional information attached						
12.	**Was the Non-Compliance Event an Emission Violation or Monitoring Equipment Failure or Malfunction** Yes ■ No ☐ **If yes, do you Request that the Violation, Failure or Malfunction be Shielded from Enforcement Action as an Upset / Breakdown Pursuant to District Rule 404**							
	Yes ☐	No ☐	Not Able to Determine at this Time ☐	If "Yes", complete and submit the Upset / Breakdown Checklist Form with Part I				
13.	**Submitted By**	**Tony Johnson**	**Telephone**	**(916) 746 - 1656**				
	Signature Tony Johnson	**Date** 7-1-22	**Time** 08:00	☐ AM ☐ PM				

NON-COMPLIANCE EVENT NOTIFICATION FORM – PART II

submit within 7 calendar days after end of the Non-Compliance Event

14.	**End of Non-Compliance Event**	**Date** 6-30-22	**Time** 15:00	☐ AM ■ PM		
15.	**Duration of Non-Compliance Event**	**Hours**	**Minutes** 0			
16.	**Excess Emissions Estimates**	NOx 2.1 ppmvdc	SOx	PM		
	VOC	CO	Opacity	%, for	minutes	Other N/A
17.	**Variance in Effect**	Yes ☐	Variance #	No ☐		
18.	**Corrective and Preventative Actions Taken**	**(a) Minimize Emissions**	**(b) Correct Event**	**(c) Prevent Future Events**	■ additional information attached	
19.	**If Not Able to Determine in Item 12 of Part I, Was the Non-Compliance Event an Emission Violation or Monitoring Equipment Failure or Malfunction If yes, do you Request that the Violation, Failure or Malfunction be Shielded from Enforcement Action as an Upset / Breakdown Under District Rule 404**					
	Yes ■	No ☐	If "Yes", complete and submit the Upset / Breakdown Checklist Form if not previously submitted with Part I			
20.	**Submitted By**	Tony Johnson	**Telephone**	**(916) 746 - 1656**		
	I certify under penalty of law that I am the responsible official for this facility, or his/her duly designated representative, and based on information and belief formed after reasonable inquiry, the statements and information in this document are true, accurate, and complete.					
	Signature	**Date** 7-7-22	**Time** 2:30	☐ AM ■ PM		

Year: 2022-005

Non-Compliance Event Number

UPSET / BREAKDOWN AND EMERGENCY CHECKLIST

Company Name	Roseville Energy Park	Address	5120 Phillip Road, Roseville		
Detection of Non-Compliance Event	Date 6-30-22	Time	16:30	☐ AM	☐ PM

Complete the following questions associated with determining whether an event is an "Upset/Breakdown" Event pursuant to Rule 404, and/or an "Emergency" Event pursuant to Rule 507. To be considered as a legitimate Upset / Breakdown or Emergency event, all of the checklist questions must be answered with a "Yes" checkmark.

Yes	No		
☑	☐	1.	Equipment associated with the breakdown event have been designed, maintained, and operated in a manner consistent with minimizing emissions.
☑	☐	2.	The amount and duration of emissions as a result of the event have been minimized.
☑	☐	3.	The event is not part of a recurring pattern of previous breakdowns of the same equipment for same/similar reasons that are indicative of inadequate equipment design, operation, or maintenance.
☑	☐	4.	The event is not the result of operator error, negligence, carelessness, or willful misconduct (i.e., the facility is being properly operated).
☑	☐	5.	The event is not the result of improper equipment design.
☑	☐	6.	The event is not the result of improper preventative maintenance of equipment.
☑	☐	7.	The event is the result of a sudden, unavoidable breakdown of equipment, beyond the control of the operator.
☑	☐	8.	The event could not have been foreseen or avoided or planned for, and could not have been avoided or prevented by better operating and maintenance practices.
☑	☐	9.	The event has not resulted in a nuisance.
☑	☐	10.	The event is not the result of the disregard of air pollution rules or regulations.
☑	☐	11.	This Upset / Breakdown form has been completed and submitted to the District in a timely manner -- within 7 calendar days from the end of the Non-Compliance Event.
☑	☐	12.	Immediate corrective actions have been taken to minimize emissions, as described in Item 11 on the Part I Non-Compliance Event Notification Form.

I certify under penalty of law that I am the responsible official for this facility, or his/her duly designated representative, and based on information and belief formed after reasonable inquiry, the statements and information in this document are true, accurate, and complete.

Signature Tony Hsu

You are requesting that the District not take enforcement action because the Non-Compliance Event is the result of an "Upset / Breakdown" Event under District Rule 404. A breakdown condition means an unforeseeable failure or malfunction of 1) any air pollution control equipment or related operating equipment which causes a violation of any emission limitations or restriction prescribed by the District Rules and Regulations, or by State law, or 2) any in-stack continuous monitoring equipment, where such failure or malfunction: (1) is not the result of neglect or disregard of any air pollution control law or rule or regulation; (2) is not intentional or the result of negligence; (3) is not the result of improper maintenance; (4) does not constitute a nuisance; (5) is not a recurrent breakdown of the same equipment. You have the burden of providing sufficient information to demonstrate that the Upset / Breakdown was an unforeseeable equipment failure or malfunction that meets the above listed criteria. This checklist must be completed and returned to the District with either the Part 1 or Part II Non-Compliance Event Notification form to attest to your having made this determination. Submission of a request for shielding from enforcement action does not by itself confer such a shield. If breakdown or emission exceeding operations continue after the breakdown or emission exceedance is identified, the possibility exists that the District after consideration of the information provided, the timeliness and completeness of the submittals, and a comparison to other like breakdowns, may ultimately determine that the Non-Compliance Event was not the result of a legitimate Upset / Breakdown event and may elect to take enforcement action. Action to return to compliance should be accomplished as expeditiously as possible. Thus, you are advised to: (1) assure that the breakdown meets the criteria for an unforeseeable failure or malfunction; (2) minimize emissions resulting from the event to the maximum degree possible; and (3) assure that the required failure and malfunction information and information on the corrective actions taken is provided to the District in a complete and timely manner.

CITY OF ROSEVILLE CALIFORNIA

Roseville Electric
Roseville Energy Park
5120 Phillip Road
Roseville, California 95747

Tony Johnson
Operations and Maintenance Supervisor
Roseville Energy Park
5120 Phillip Road
Roseville, California 95747

Subject: Non-Compliance Event Upset Breakdown Notification form 2022-005

To Whom It May Concern:

This memo is to provide additional information for Non-Compliance Event Notification form 2022-005.

On 6-30-2022 Roseville Energy Park Instrument Technicians were performing preventive maintenance on the Continuous Emissions Monitoring System (CEMS), replacing a peristaltic hose, for Unit #2 which was offline at approximately 14:00. The unit was available for dispatch by the CAISO in the Energy Imbalance Market (EIM) and was called for a start. The start command was given at 14:53.

The repairs were completed immediately and the CEMS was returned to service at 14:58. Startup was initiated when the turbine light off at 15:03 and the breaker closed at 15:11. Shortly after the startup our Power Plant Operator discerned that the startup bit indication was not lit on the CEMS screen with excess emissions alarms displayed on the CEMS monitor.

A Part I was filed with the District and the CEMS manufacturer, Teledyne, was contacted for troubleshooting assistance. William Vanhorn, Programmer/Analyst from Teledyne, confirmed the DAHS error and corrected the startup time to 15:03 when flame on occurred and captured the emissions correctly instead of the 14:53 start initiate command.

His explanation was that due to the unit being in maintenance mode when the Start command was received, the logic that tells the DAHS that it is in a startup was not recognized. This caused the data to be calculated as normal running emissions. Due to the DAHS calculating as normal running emissions, it flagged the data as excess emissions instead of normal startup emissions defined in Condition 18 of our Operating Permit #REPR-20-01

Let me know if you have any questions.

Sincerely,

Tony Johnson

(916) 746-1656 • *Fax* (916) 746-1655 • ajohnson@roseville.ca.us

Startup / Shutdown Events

CT2

From: 06/30/2022 00:00 To: 06/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 07/06/2022 13:00 Location: Roseville, CA

Startup/Shutdown

Number	Start Time	End Time	Event Type	Duration
1	06/30/2022 00:45	06/30/2022 00:52	Shutdown	8
2	06/30/2022 14:03	06/30/2022 14:54	Cold Startup	52
3	06/30/2022 23:23	06/30/2022 23:30	Shutdown	8

Startup / Shutdown Events

CT2

From: 06/30/2022 00:00 To: 06/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 07/06/2022 13:00 Location: Roseville, CA

Startup/Shutdown Event Summary

	# Events	Duration	Duration %
Cold Startup	1	52	8.37
Warm Startup	0		0.00
Shutdown	2	16	2.58
Total Process Events:	3	68	10.95

Total Report Time:	23.98 Hour(s)
Total Operating Time:	10.35 Hour(s)
Total Startup Time:	52 Minute(s)
Total Shutdown Time:	16 Minute(s)
Total Startup/Shutdown Time:	68 Minute(s)
Total Startup/Shutdown Time as a Percentage of Total Operating Time:	10.95 %

ATTACHMENT 8

AQ-37

AQ-37 Any Violation of any emission standard listed in this permit which is indicated by the CEMS shall be reported to the PCAPCD no later than 96 hours after such occurrence as per California Health and Safety Code 42706

Verification: The Project owner shall include all violations of emissions standards and corresponding PCAPCD notifications in the Quarterly Air Quality Report required by the Condition of Certification AQ-SC6

All Notices of Non Compliance are included in AQ-41.

ATTACHMENT 9

AQ-40

AQ-40 The Project owner shall comply with the applicable requirements for quality assurance testing and maintenance of the continuous emission monitor equipment in accordance with the procedures and guidance specified in 40 CFR Part 60, Appendix F.

Verification: The Project owner shall include all CEMS quality assurance test failures that required corrective action as part of the Quarterly Air Quality Report required by the Condition of Certification AQ-SC6

Cylinder Gas Audit

Facility:	ROSEVILLE ENERGY			Instrument	CT1_CODualRg_P_Instr
Unit/Stack:	CT1	Test Date:	06/14/2022	Performance	15 Pct
Parameter/Scal	CO / Low	Test	**Pass**	Alternate Spec:	5 Ppm

Date	Time	Test Level	Span Value	Reference	Measured Value	Ref Value As Pct Span
06/14/2022	09:31	L	10	2.400	2.300	24.0 %
06/14/2022	09:36	M	10	5.700	5.600	57.0 %
06/14/2022	09:44	L	10	2.400	2.200	24.0 %
06/14/2022	09:49	M	10	5.700	5.600	57.0 %
06/14/2022	09:56	L	10	2.400	2.200	24.0 %
06/14/2022	10:01	M	10	5.700	5.600	57.0 %

Summary

Cal Gas Level	Reference	Mean	CEMS Mean	Specification	Results
L	2.400		2.233	Std	**6.9**
M	5.700		5.600	Std	**1.8**

Cylinder Gas Audit

Facility:	ROSEVILLE ENERGY			Instrument	CT1_CODualRg_P_Instr
Unit/Stack:	CT1	Test Date:	06/14/2022	Performance	15 Pct
Parameter/Scal	CO / High	Test	**Pass**	Alternate Spec:	5 Ppm

Date	Time	Test Level	Span Value	Reference	Measured Value	Ref Value As Pct Span
06/14/2022	11:27	L	200	50.300	49.600	25.2 %
06/14/2022	11:32	M	200	112.800	114.200	56.4 %
06/14/2022	11:45	L	200	50.300	49.700	25.2 %
06/14/2022	11:50	M	200	112.800	114.300	56.4 %
06/14/2022	12:02	L	200	50.300	49.700	25.2 %
06/14/2022	12:07	M	200	112.800	114.300	56.4 %

Summary

Cal Gas Level	Reference Mean	CEMS Mean	Specification	Results
L	50.300	49.667	Std	**1.3**
M	112.800	114.267	Std	**1.3**

Cylinder Gas Audit

Facility:	ROSEVILLE ENERGY			Instrument	CT2_CODualRg_P_Instr
Unit/Stack:	CT2	Test Date:	06/15/2022	Performance	15 Pct
Parameter/Scal	CO / High	Test	**Pass**	Alternate Spec:	5 Ppm

Date	Time	Test Level	Span Value	Reference	Measured Value	Ref Value As Pct Span
06/15/2022	14:27	L	200	49.400	49.400	24.7 %
06/15/2022	14:32	M	200	112.700	114.400	56.4 %
06/15/2022	14:45	L	200	49.400	49.600	24.7 %
06/15/2022	14:50	M	200	112.700	113.900	56.4 %
06/15/2022	15:02	L	200	49.400	49.600	24.7 %
06/15/2022	15:07	M	200	112.700	114.300	56.4 %

Summary

Cal Gas Level	Reference Mean	CEMS Mean	Specification	Results
L	49.400	49.533	Std	**0.3**
M	112.700	114.200	Std	**1.3**

Cylinder Gas Audit

Facility:	ROSEVILLE ENERGY			Instrument	CT2_CODualRg_P_Instr
Unit/Stack:	CT2	Test Date:	06/16/2022	Performance	15 Pct
Parameter/Scal	CO / Low	Test	**Pass**	Alternate Spec:	5 Ppm

Date	Time	Test Level	Span Value	Reference	Measured Value	Ref Value As Pct Span
06/16/2022	08:28	L	10	2.400	2.200	24.0 %
06/16/2022	08:33	M	10	5.700	5.500	57.0 %
06/16/2022	08:40	L	10	2.400	2.200	24.0 %
06/16/2022	08:45	M	10	5.700	5.500	57.0 %
06/16/2022	08:52	L	10	2.400	2.200	24.0 %
06/16/2022	08:57	M	10	5.700	5.500	57.0 %

Summary

Cal Gas Level	Reference Mean	CEMS Mean	Specification	Results
L	2.400	2.200	Std	**8.3**
M	5.700	5.500	Std	**3.5**

Linearity Report

ORIS Code:	56298	Facility Name:	ROSEVILLE ENERGY		
EDR Site ID:	CT001	Component ID:	A15	ReasonForTes	QA
		Component Type:	NOXA	Grace Period:	0
Instrument	CT1_NOXDualRg_P_Instr	Test End	06/14/2022	Scale:	High
Performance	5 %	Test No.:	116	Highest	3.5
		Status	**Passed**		

Date	Time	Cal Gas Level	Span Value	Ref Value	Meas Value	Aborted Test Indicator	Ref Value As Pct Span
06/14/2022	1127	L	200.0	47.6	44.8		23.8 %
06/14/2022	1132	M	200.0	105.0	108.3		52.5 %
06/14/2022	1137	H	200.0	176.0	176.6		88.0 %
06/14/2022	1145	L	200.0	47.6	48.3		23.8 %
06/14/2022	1150	M	200.0	105.0	108.7		52.5 %
06/14/2022	1155	H	200.0	176.0	176.6		88.0 %
06/14/2022	1202	L	200.0	47.6	49.2		23.8 %
06/14/2022	1207	M	200.0	105.0	108.9		52.5 %
06/14/2022	1212	H	200.0	176.0	176.8		88.0 %

Summary

Cal Gas Level	Reference Mean	CEMS Mean	Alt Perf Spec	Results
L	47.600	47.433	No	**0.4**
M	105.000	108.633	No	**3.5**
H	176.000	176.667	No	**0.4**

Linearity Report

ORIS Code:	56298	Facility Name:	ROSEVILLE ENERGY		
EDR Site ID:	CT001	Component ID:	A16	ReasonForTes	QA
		Component Type:	O2D	Grace Period:	0
Instrument	CT1_O2D_P_Instrument	Test End	06/14/2022	Scale:	High
Performance	5 %	Test No.:	117	Highest	1.8
		Status	**Passed**		

Date	Time	Cal Gas Level	Span Value	Ref Value	Meas Value	Aborted Test Indicator	Ref Value As Pct Span
06/14/2022	1328	L	21.0	5.5	5.6		26.2 %
06/14/2022	1333	M	21.0	11.1	11.1		52.9 %
06/14/2022	1338	H	21.0	18.1	18.4		86.2 %
06/14/2022	1345	L	21.0	5.5	5.6		26.2 %
06/14/2022	1350	M	21.0	11.1	11.1		52.9 %
06/14/2022	1355	H	21.0	18.1	18.4		86.2 %
06/14/2022	1402	L	21.0	5.5	5.6		26.2 %
06/14/2022	1407	M	21.0	11.1	11.1		52.9 %
06/14/2022	1412	H	21.0	18.1	18.4		86.2 %

Summary

Cal Gas Level	Reference Mean	CEMS Mean	Alt Perf Spec	Results
L	5.500	5.600	No	**1.8**
M	11.100	11.100	No	**0.0**
H	18.100	18.400	No	**1.7**

Linearity Report

ORIS Code:	56298	Facility Name:	ROSEVILLE ENERGY		
EDR Site ID:	CT002	Component ID:	A21	ReasonForTes	QA
		Component Type:	NOXA	Grace Period:	0
Instrument	CT2_NOXDualRg_P_Instr	Test End	06/15/2022	Scale:	High
Performance	5 %	Test No.:	119	Highest	3.0
		Status	**Passed**		

Date	Time	Cal Gas Level	Span Value	Ref Value	Meas Value	Aborted Test Indicator	Ref Value As Pct Span
06/15/2022	1427	L	200.0	48.2	47.2		24.1 %
06/15/2022	1432	M	200.0	106.0	109.2		53.0 %
06/15/2022	1438	H	200.0	176.0	174.8		88.0 %
06/15/2022	1445	L	200.0	48.2	46.9		24.1 %
06/15/2022	1450	M	200.0	106.0	109.2		53.0 %
06/15/2022	1455	H	200.0	176.0	174.9		88.0 %
06/15/2022	1502	L	200.0	48.2	48.0		24.1 %
06/15/2022	1507	M	200.0	106.0	109.2		53.0 %
06/15/2022	1512	H	200.0	176.0	174.8		88.0 %

Summary

Cal Gas Level	Reference Mean	CEMS Mean	Alt Perf Spec	Results
L	48.200	47.367	No	**1.7**
M	106.000	109.200	No	**3.0**
H	176.000	174.833	No	**0.7**

Linearity Report

ORIS Code:	56298	Facility Name:	ROSEVILLE ENERGY		
EDR Site ID:	CT002	Component ID:	A22	ReasonForTes	QA
		Component Type:	O2D	Grace Period:	0
Instrument	CT2_O2D_P_Instrument	Test End	06/16/2022	Scale:	High
Performance	5 %	Test No.:	120	Highest	0.6
		Status	**Passed**		

Date	Time	Cal Gas Level	Span Value	Ref Value	Meas Value	Aborted Test Indicator	Ref Value As Pct Span
06/16/2022	0525	L	21.0	5.0	5.0		23.8 %
06/16/2022	0531	M	21.0	11.2	11.2		53.3 %
06/16/2022	0536	H	21.0	18.1	18.0		86.2 %
06/16/2022	0543	L	21.0	5.0	5.0		23.8 %
06/16/2022	0548	M	21.0	11.2	11.2		53.3 %
06/16/2022	0553	H	21.0	18.1	18.0		86.2 %
06/16/2022	0600	L	21.0	5.0	5.0		23.8 %
06/16/2022	0605	M	21.0	11.2	11.2		53.3 %
06/16/2022	0610	H	21.0	18.1	18.0		86.2 %

Summary

Cal Gas Level	Reference Mean	CEMS Mean	Alt Perf Spec	Results
L	5.000	5.000	No	**0.0**
M	11.200	11.200	No	**0.0**
H	18.100	18.000	No	**0.6**

Roseville Energy Park
Revision History

RegPerfect® by Teledyne Monitor Labs, Inc.
Teledyne Monitor Labs, Inc.
35 Inverness Drive East
Englewood, CO 80112-5189
Telephone: (800) 846-6062
http://www.teledyne-ml.com/
http://www.regperfect.com/
©1998-2005 Teledyne Monitor Labs, Inc. All rights reserved.
RegPerfect® is a registered trademark of Teledyne Monitor Labs, Inc.

NOTE: This server's C drive is only 20 GB in size!! Do not place large files on this drive.

7/1/22 William Vanhorn
Checking to see if the NOx excess emissions are correct on 6/30.

6/21/22 Taylor Sullivan
EDR check

6/2/22 Taylor Sullivan
EDR check

5/5/22 Taylor Sullivan
EDR check

4/20-21/22 Taylor Sullivan
Q1 EDR

ATTACHMENT 10

AQ-41

AQ-41 The Project owner shall submit a written report to the APCO and the CPM for each calendar quarter, within 30 days of the end of the quarter, including: time intervals, data and magnitude of excess emissions, nature and cause of excess (if known), corrective actions taken and preventive measures adopted; averaging period used for data reporting shall correspond to the averaging period for each respective emission standard; applicable time and date of each period during which the CEMS was inoperative (except for zero and span checks) and the nature of the system repairs and adjustments; and a negative declaration when no excess emission occurred.

Verification: The Project owner shall include the excess emission report as part of the Quarterly Air Quality Report required in Condition of Certification AQ-SC6

Excess Emission Report

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 07/08/2022 01:17 **Location:** Roseville, CA

Tag Name: ALL_CO_Lb_1D
Total Operating Time: 44.00 Day(s) **No Exclusions Allowed**
Non-Operating Time: 47.00 Day(s) Report Time: 91.00 Day(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

Total Operating Time:	**44.00 Day(s)**
Total Duration (Online only):	**0.00 Day(s)**
Time in exceedance as a percentage of operating time:	**0.00 %**
Time in compliance as a percentage of operating time:	**100.00 %**

Excess Emission Report

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 07/08/2022 01:18 **Location:** Roseville, CA

Tag Name: ALL_NOx_Lb_1D
Total Operating Time: 44.00 Day(s) **No Exclusions Allowed**
Non-Operating Time: 47.00 Day(s) Report Time: 91.00 Day(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

Total Operating Time:	**44.00 Day(s)**
Total Duration (Online only):	**0.00 Day(s)**
Time in exceedance as a percentage of operating time:	**0.00 %**
Time in compliance as a percentage of operating time:	**100.00 %**

Excess Emission Report

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 07/08/2022 01:19 **Location:** Roseville, CA

Tag Name: ALL_PM10_Lb_1D
Total Operating Time: 44.00 Day(s) **No Exclusions Allowed**
Non-Operating Time: 47.00 Day(s) Report Time: 91.00 Day(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

Total Operating Time:	**44.00 Day(s)**
Total Duration (Online only):	**0.00 Day(s)**
Time in exceedance as a percentage of operating time:	**0.00 %**
Time in compliance as a percentage of operating time:	**100.00 %**

Excess Emission Report

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 07/08/2022 01:19 **Location:** Roseville, CA

Tag Name: ALL_SO2_Lb_1D
Total Operating Time: 44.00 Day(s) **No Exclusions Allowed**
Non-Operating Time: 47.00 Day(s) Report Time: 91.00 Day(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

Total Operating Time:	**44.00 Day(s)**
Total Duration (Online only):	**0.00 Day(s)**
Time in exceedance as a percentage of operating time:	**0.00 %**
Time in compliance as a percentage of operating time:	**100.00 %**

Excess Emission Report

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 07/08/2022 01:20 **Location:** Roseville, CA

Tag Name: ALL_VOC_Lb_1D
Total Operating Time: 44.00 Day(s) **No Exclusions Allowed**
Non-Operating Time: 47.00 Day(s) Report Time: 91.00 Day(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

Total Operating Time:	**44.00 Day(s)**
Total Duration (Online only):	**0.00 Day(s)**
Time in exceedance as a percentage of operating time:	**0.00 %**
Time in compliance as a percentage of operating time:	**100.00 %**

CO LbPerHr 3-Hour Rolling Excess Emissions

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 07/08/2022 01:21 **Location:** Roseville, CA

Tag Name: CT1_CO_3Hr_LbPerHr_1H
Total Operating Time: 748.00 Hour(s) **No Exclusions Allowed**
Non-Operating Time: 1,436.00 Hour(s) Report Time: 2,184.00 Hour(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

Total Operating Time:	**748.00 Hour(s)**
Total Duration (Online only):	**0.00 Hour(s)**
Time in exceedance as a percentage of operating time:	**0.00 %**
Time in compliance as a percentage of operating time:	**100.00 %**

CO Ppmvdc 3-Hour Block Excess Emissions

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 07/08/2022 01:22 **Location:** Roseville, CA

Tag Name: CT1_CO_Ppmvdc_3H
Total Operating Time: 748.00 Hour(s) **No Exclusions Allowed**
Non-Operating Time: 1,436.00 Hour(s) Report Time: 2,184.00 Hour(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

Total Operating Time:	**748.00 Hour(s)**
Total Duration (Online only):	**0.00 Hour(s)**
Time in exceedance as a percentage of operating time:	**0.00 %**
Time in compliance as a percentage of operating time:	**100.00 %**

CO LbPerHr SUSD 1-Hour Block Excess Emissions

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 07/08/2022 01:22 **Location:** Roseville, CA

Tag Name: CT1_CO_SUSD_LbPerHr_1H
Total Operating Time: 748.00 Hour(s) **No Exclusions Allowed**
Non-Operating Time: 1,436.00 Hour(s) Report Time: 2,184.00 Hour(s)

Inc No	Start Time	End Time	Duration in Hour(s)	Tag Value	Limit	Reason Code	Action Code
1	04/28/22 17:00	04/28/22 17:59	1	107.2	89.5	19 - COMMISSIONING	3 - RETURN TO NORMAL OPERATIONS
2	04/28/22 18:00	04/28/22 18:59	1	156.0	89.5	19 - COMMISSIONING	3 - RETURN TO NORMAL OPERATIONS

Total Operating Time:	**748.00 Hour(s)**
Total Duration (Online only):	**2.00 Hour(s)**
Time in exceedance as a percentage of operating time:	**0.27 %**
Time in compliance as a percentage of operating time:	**99.73 %**

Report Code	Type	Text	Duration	Duration Percent
19	Reason	COMMISSIONING	2	100.00
3	Action	RETURN TO NORMAL OPERATIONS	2	100.00

NH3 Slip Ppmvdc 1-Hour Block Excess Emissions

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 07/08/2022 01:23 **Location:** Roseville, CA

Tag Name: CT1_NH3Slip_Ppmvdc_1H
Total Operating Time: 748.00 Hour(s) **No Exclusions Allowed**
Non-Operating Time: 1,436.00 Hour(s) Report Time: 2,184.00 Hour(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

Total Operating Time:	**748.00 Hour(s)**
Total Duration (Online only):	**0.00 Hour(s)**
Time in exceedance as a percentage of operating time:	**0.00 %**
Time in compliance as a percentage of operating time:	**100.00 %**

NOx LbPerHr 1-Hour Block Excess Emissions

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 07/08/2022 01:23 **Location:** Roseville, CA

Tag Name: CT1_NOx_Norm_LbPerHr_1H
Total Operating Time: 748.00 Hour(s) **No Exclusions Allowed**
Non-Operating Time: 1,436.00 Hour(s) Report Time: 2,184.00 Hour(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

Total Operating Time:	**748.00 Hour(s)**
Total Duration (Online only):	**0.00 Hour(s)**
Time in exceedance as a percentage of operating time:	**0.00 %**
Time in compliance as a percentage of operating time:	**100.00 %**

NOx Ppmvdc 1-Hour Block Excess Emissions

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 07/08/2022 01:24 **Location:** Roseville, CA

Tag Name: CT1_NOx_Ppmvdc_1H
Total Operating Time: 748.00 Hour(s) **No Exclusions Allowed**
Non-Operating Time: 1,436.00 Hour(s) Report Time: 2,184.00 Hour(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

Total Operating Time:	**748.00 Hour(s)**
Total Duration (Online only):	**0.00 Hour(s)**
Time in exceedance as a percentage of operating time:	**0.00 %**
Time in compliance as a percentage of operating time:	**100.00 %**

NOx LbPerHr SUSD 1-Hour Block Excess Emissions

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 07/08/2022 01:24 **Location:** Roseville, CA

Tag Name: CT1_NOx_SUSD_LbPerHr_1H
Total Operating Time: 748.00 Hour(s) **No Exclusions Allowed**
Non-Operating Time: 1,436.00 Hour(s) Report Time: 2,184.00 Hour(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

Total Operating Time:	**748.00 Hour(s)**
Total Duration (Online only):	**0.00 Hour(s)**
Time in exceedance as a percentage of operating time:	**0.00 %**
Time in compliance as a percentage of operating time:	**100.00 %**

PM10 LbPerHr 1-Hour Block Excess Emissions

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 07/08/2022 01:25 **Location:** Roseville, CA

Tag Name: CT1_PM10_Norm_LbPerHr_1H
Total Operating Time: 748.00 Hour(s) **No Exclusions Allowed**
Non-Operating Time: 1,436.00 Hour(s) Report Time: 2,184.00 Hour(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

Total Operating Time:	**748.00 Hour(s)**
Total Duration (Online only):	**0.00 Hour(s)**
Time in exceedance as a percentage of operating time:	**0.00 %**
Time in compliance as a percentage of operating time:	**100.00 %**

SO2 LbPerHr 1-Hour Block Excess Emissions

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 07/08/2022 01:25 **Location:** Roseville, CA

Tag Name: CT1_SO2_Norm_LbPerHr_1H
Total Operating Time: 748.00 Hour(s) **No Exclusions Allowed**
Non-Operating Time: 1,436.00 Hour(s) Report Time: 2,184.00 Hour(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

Total Operating Time:	**748.00 Hour(s)**
Total Duration (Online only):	**0.00 Hour(s)**
Time in exceedance as a percentage of operating time:	**0.00 %**
Time in compliance as a percentage of operating time:	**100.00 %**

VOC LbPerHr 1-Hour Block Excess Emissions

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 07/08/2022 01:26 **Location:** Roseville, CA

Tag Name: CT1_VOC_Norm_LbPerHr_1H
Total Operating Time: 748.00 Hour(s) **No Exclusions Allowed**
Non-Operating Time: 1,436.00 Hour(s) Report Time: 2,184.00 Hour(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

Total Operating Time:	**748.00 Hour(s)**
Total Duration (Online only):	**0.00 Hour(s)**
Time in exceedance as a percentage of operating time:	**0.00 %**
Time in compliance as a percentage of operating time:	**100.00 %**

CO LbPerHr 3-Hour Rolling Excess Emissions

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 07/08/2022 01:27 **Location:** Roseville, CA

Tag Name: CT2_CO_3Hr_LbPerHr_1H
Total Operating Time: 672.00 Hour(s) **No Exclusions Allowed**
Non-Operating Time: 1,512.00 Hour(s) Report Time: 2,184.00 Hour(s)

Inc No	Start Time	End Time	Duration in Hour(s)	Tag Value	Limit	Reason Code	Action Code
1	06/30/22 16:00	06/30/22 16:59	1	15.2	6.2	20 - CEMS IN MAINTENANCE DURING START UP	9 - TML corrected calculation in DAS and recalculated data. No excess emmision

Total Operating Time:	**672.00 Hour(s)**
Total Duration (Online only):	**1.00 Hour(s)**
Time in exceedance as a percentage of operating time:	**0.15 %**
Time in compliance as a percentage of operating time:	**99.85 %**

Report Code	Type	Text	Duration	Duration Percent
20	Reason	CEMS IN MAINTENANCE DURING START UP	1	100.00
9	Action	TML corrected calculation in DAS and recalculated data. No excess emmision	1	100.00

CO Ppmvdc 3-Hour Block Excess Emissions

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 07/08/2022 01:28 **Location:** Roseville, CA

Tag Name: CT2_CO_Ppmvdc_3H
Total Operating Time: 672.00 Hour(s) **No Exclusions Allowed**
Non-Operating Time: 1,512.00 Hour(s) Report Time: 2,184.00 Hour(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

Total Operating Time:	**672.00 Hour(s)**
Total Duration (Online only):	**0.00 Hour(s)**
Time in exceedance as a percentage of operating time:	**0.00 %**
Time in compliance as a percentage of operating time:	**100.00 %**

CO LbPerHr SUSD 1-Hour Block Excess Emissions

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 07/08/2022 01:28 **Location:** Roseville, CA

Tag Name: CT2_CO_SUSD_LbPerHr_1H
Total Operating Time: 672.00 Hour(s) **No Exclusions Allowed**
Non-Operating Time: 1,512.00 Hour(s) Report Time: 2,184.00 Hour(s)

Inc No	Start Time	End Time	Duration in Hour(s)	Tag Value	Limit	Reason Code	Action Code
1	04/26/22 13:00	04/26/22 13:59	1	144.1	89.5	1 - Startup/shutdown	
2	04/26/22 14:00	04/26/22 14:59	1	92.2	89.5	19 - COMMISSIONING	3 - RETURN TO NORMAL OPERATIONS
3	04/28/22 08:00	04/28/22 08:59	1	103.5	89.5	19 - COMMISSIONING	3 - RETURN TO NORMAL OPERATIONS

Total Operating Time:	**672.00 Hour(s)**
Total Duration (Online only):	**3.00 Hour(s)**
Time in exceedance as a percentage of operating time:	**0.45 %**
Time in compliance as a percentage of operating time:	**99.55 %**

Report Code	Type	Text	Duration	Duration Percent
19	Reason	COMMISSIONING	2	66.67
1	Reason	Startup/shutdown	1	33.33
3	Action	RETURN TO NORMAL OPERATIONS	2	66.67

NH3 Slip Ppmvdc 1-Hour Block Excess Emissions

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 07/08/2022 01:29 **Location:** Roseville, CA

Tag Name: CT2_NH3Slip_Ppmvdc_1H
Total Operating Time: 672.00 Hour(s) **No Exclusions Allowed**
Non-Operating Time: 1,512.00 Hour(s) Report Time: 2,184.00 Hour(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

Total Operating Time:	**672.00 Hour(s)**
Total Duration (Online only):	**0.00 Hour(s)**
Time in exceedance as a percentage of operating time:	**0.00 %**
Time in compliance as a percentage of operating time:	**100.00 %**

NOx LbPerHr 1-Hour Block Excess Emissions

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 07/08/2022 01:30 **Location:** Roseville, CA

Tag Name: CT2_NOx_Norm_LbPerHr_1H
Total Operating Time: 672.00 Hour(s) **No Exclusions Allowed**
Non-Operating Time: 1,512.00 Hour(s) Report Time: 2,184.00 Hour(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

Total Operating Time:	**672.00 Hour(s)**
Total Duration (Online only):	**0.00 Hour(s)**
Time in exceedance as a percentage of operating time:	**0.00 %**
Time in compliance as a percentage of operating time:	**100.00 %**

NOx Ppmvdc 1-Hour Block Excess Emissions

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 07/08/2022 01:30 **Location:** Roseville, CA

Tag Name: CT2_NOx_Ppmvdc_1H
Total Operating Time: 672.00 Hour(s) **No Exclusions Allowed**
Non-Operating Time: 1,512.00 Hour(s) Report Time: 2,184.00 Hour(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

Total Operating Time:	**672.00 Hour(s)**
Total Duration (Online only):	**0.00 Hour(s)**
Time in exceedance as a percentage of operating time:	**0.00 %**
Time in compliance as a percentage of operating time:	**100.00 %**

NOx LbPerHr SUSD 1-Hour Block Excess Emissions

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 07/08/2022 01:30 **Location:** Roseville, CA

Tag Name: CT2_NOx_SUSD_LbPerHr_1H
Total Operating Time: 672.00 Hour(s) **No Exclusions Allowed**
Non-Operating Time: 1,512.00 Hour(s) Report Time: 2,184.00 Hour(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

Total Operating Time:	**672.00 Hour(s)**
Total Duration (Online only):	**0.00 Hour(s)**
Time in exceedance as a percentage of operating time:	**0.00 %**
Time in compliance as a percentage of operating time:	**100.00 %**

PM10 LbPerHr 1-Hour Block Excess Emissions

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 07/08/2022 01:31 **Location:** Roseville, CA

Tag Name: CT2_PM10_Norm_LbPerHr_1H
Total Operating Time: 672.00 Hour(s) **No Exclusions Allowed**
Non-Operating Time: 1,512.00 Hour(s) Report Time: 2,184.00 Hour(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

Total Operating Time:	**672.00 Hour(s)**
Total Duration (Online only):	**0.00 Hour(s)**
Time in exceedance as a percentage of operating time:	**0.00 %**
Time in compliance as a percentage of operating time:	**100.00 %**

SO2 LbPerHr 1-Hour Block Excess Emissions

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 07/08/2022 01:31 **Location:** Roseville, CA

Tag Name: CT2_SO2_Norm_LbPerHr_1H
Total Operating Time: 672.00 Hour(s) **No Exclusions Allowed**
Non-Operating Time: 1,512.00 Hour(s) Report Time: 2,184.00 Hour(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

Total Operating Time:	**672.00 Hour(s)**
Total Duration (Online only):	**0.00 Hour(s)**
Time in exceedance as a percentage of operating time:	**0.00 %**
Time in compliance as a percentage of operating time:	**100.00 %**

VOC LbPerHr 1-Hour Block Excess Emissions

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 07/08/2022 01:32 **Location:** Roseville, CA

Tag Name: CT2_VOC_Norm_LbPerHr_1H
Total Operating Time: 672.00 Hour(s) **No Exclusions Allowed**
Non-Operating Time: 1,512.00 Hour(s) Report Time: 2,184.00 Hour(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

Total Operating Time:	**672.00 Hour(s)**
Total Duration (Online only):	**0.00 Hour(s)**
Time in exceedance as a percentage of operating time:	**0.00 %**
Time in compliance as a percentage of operating time:	**100.00 %**

ATTACHMENT 11

AQ-42

AQ-42 The Project owner shall provide the PCAPCD and CPM with a written emission statement showing actual emissions of volatile organic compounds and oxides of nitrogen. Pursuant to PCAPCD Rule 503 the Project owner shall submit this emission statement on a form or in a format specified by the Air Pollution Control Officer. The statement shall contain the following information:

a) Information contained in the California Air Resources Board's Emission Inventory Turn Around Document as described in Instructions for the Emission Data System Review and Update Report;
b) Actual emissions of volatile organic compounds and oxides of nitrogen, in tons per year, for the calendar year prior to the preparation of the emission statement;
c) Information regarding seasonal or diurnal peaks in the emission of affected pollutants; and
d) Certification by a responsible official of the Project owner that the information contained in the emission statement is accurate to the best knowledge of the individual certifying the emission statement.

Verification: The Project owner shall submit to the CPM the emission statement described herein prior to the beginning of March each year.

12 Month Running Summary Report

AQ42 12 Month Running Summary Report

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 07/08/2022 01:36 **Location:** Roseville, CA

	Units CT1 & CT2		Units CT1 & CT2	
Date	NOx, Ton 1 Day(s)		VOC, Ton 1 Day(s)	
	Sum	Running Sum	Sum	Running Sum
Apr 22	0.0732	0.0732	0.0149	0.0149
May 22	0.5924	0.6656	0.1989	0.2138
Jun 22	1.0943	1.7599	0.3644	0.5782
Sum/Avg	1.7599		0.5782	

Roseville Energy Park Quarterly Emissions Summary
for PCAPCD

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 07/08/2022 00:59 **Location:** Roseville, CA

* = Excess Emission

Date	Unit CT1 CO, Ton		Unit CT1 NOx, Ton		Unit CT1 OperatingTime, Hrs		Unit CT2 CO, Ton		Unit CT2 NOx, Ton		Unit CT2 OperatingTime, Hrs	
	1 Day(s)		1 Day(s)		1 Day(s)		1 Day(s)		1 Day(s)		1 Day(s)	
	Sum	Rolling Sum	Sum	Rolling Sum	Sum	Rolling Sum	Sum	Rolling Sum	Sum	Rolling Sum	Sum	Rolling Sum
Apr 2022	0.1443	2.9810	0.0150	6.6429	9.29	6,180.44	0.2529	3.9530	0.0582	7.4132	27.46	6,413.15
May 2022	0.2854	3.0965	0.3121	6.8094	256.92	6,331.68	0.1590	3.7476	0.2805	7.1762	226.94	6,196.75
Jun 2022	0.2541	3.0228	0.5579	6.5683	467.89	6,098.44	0.4592	3.6715	0.5360	7.1301	394.27	6,214.12
Sum/Avg	3.0228		6.5683		6,098.44		3.6715		7.1301		6,214.12	
Limit Value												

ATTACHMENT 12

AQ-47

AQ-47 No emissions are permitted, from any source, which are a nuisance per PCAPCD Rule 205, Nuisance.

Verification: The Project owner shall report all violations of this condition as noticed by the PCAPCD as well as any offsite nuisance complaints as part of the Quarterly Air Quality Report in Condition of Certification AQ-SC6

In regards to AQ-47of Roseville Energy Park's 2Q22 QAQR, there were no violations of PCAPCD's Rule 205 for nuisance.

ATTACHMENT 13

AQ-48

AQ-48 Stack emission opacity as dark as Ringelmann No. 1 (20% opacity) for periods aggregating more than 3 minutes in any one hour is prohibited and is in violation of PCAPCD Rule 202, Visible Emissions.

Verification: The Project owner shall report all violations of this condition as noticed by the PCAPCD as well as any offsite nuisance complaints as part of the Quarterly Air Quality Report in Condition of Certification AQ-SC6

In regards to AQ-48 of Roseville Energy Park's 2Q22 QAQR, there were no violations of PCAPCD's Rule 202 for opacity.

ATTACHMENT 14

AQ-51

AQ-51 The ammonia slip shall not exceed 10 ppmv @ 15% o2 averaged over one hour. The SCR catalyst shall be replaced, repaired or otherwise reconditioned within 24 months of the ammonia slip reaching 7 ppm @ 15% O2 averaged over 24 hours. The SCR ammonia injection grid replacement, repair or reconditioning scheduled event may be cancelled if the Project owner can demonstrate to the CPM that, subsequent to the initial exceedance, the ammonia slip consistently remains below 7 ppm @ 15% O2 averaged over 24 hours and that the initial exceedance does not accurately indicate expected future operating conditions.

Compliance with ammonia slip limits shall be demonstrated by using the following calculation procedure:

Ammonia slip ppmv @ 15% O2 = ((a-(bxc/1,000,000)) x 1,000,000/b) x d,

Where

a = ammonia injection rate (lb/hr)/17(lb/lb mol)

b = dry exhaust gas flow rate (lb/hr)/ (29(lb/lb mol)

c = change in measured NOX conc. Ppmv @ 15% O2 across catalyst, and

d = correction factor

The correction factor shall be derived annually during compliance testing by comparing the measured and calculated ammonia slip.

Verification: The Project owner shall include the ammonia slip concentrations averaged on an hourly and 24 hour basis calculated via the protocol provided as part of the Quarterly Air Quality Report required in Condition of Certification AQ-SC6. The Project owner shall notify the CPM within 10 days of an exceedance of the 7 ppm ammonia slip limit herein. The Project owner shall notify the CPM no less than 30 days prior to the scheduled date of the SCR catalyst replacement, repair or reconditioning event. If the Project owner finds that the exceedance of the 7 ppm slip limit does not accurately reflect the expected future operations provided for in this condition, the Project owner shall submit all relevant information to the CPM no less than 30 days prior to the scheduled date of the SCR catalyst replacement, repair or reconditioning event in order to cancel the event.

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:52 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
04/01/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/01/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/01/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/01/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/01/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/01/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/01/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/01/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/01/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/01/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/01/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/01/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/01/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/01/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/01/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/01/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/01/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/01/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/01/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/01/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/01/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/01/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/01/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/01/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:52 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
04/02/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/02/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/02/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/02/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/02/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/02/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/02/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/02/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/02/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/02/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/02/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/02/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/02/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/02/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/02/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/02/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/02/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/02/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/02/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/02/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/02/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/02/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/02/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/02/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:52 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
04/03/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/03/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/03/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/03/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/03/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/03/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/03/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/03/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/03/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/03/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/03/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/03/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/03/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/03/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/03/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/03/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/03/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/03/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/03/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/03/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/03/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/03/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/03/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/03/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:52 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
04/04/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/04/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/04/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/04/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/04/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/04/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/04/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/04/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/04/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/04/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/04/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/04/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/04/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/04/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/04/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/04/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/04/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/04/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/04/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/04/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/04/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/04/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/04/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/04/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:52 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
04/05/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/05/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/05/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/05/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/05/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/05/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/05/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/05/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/05/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/05/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/05/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/05/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/05/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/05/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/05/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/05/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/05/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/05/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/05/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/05/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/05/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/05/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/05/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/05/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:52 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
04/06/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/06/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/06/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/06/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/06/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/06/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/06/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/06/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/06/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/06/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/06/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/06/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/06/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/06/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/06/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/06/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/06/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/06/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/06/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/06/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/06/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/06/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/06/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/06/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:52 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
04/07/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/07/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/07/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/07/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/07/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/07/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/07/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/07/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/07/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/07/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/07/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/07/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/07/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/07/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/07/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/07/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/07/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/07/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/07/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/07/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/07/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/07/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/07/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/07/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:52 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
04/08/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/08/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/08/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/08/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/08/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/08/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/08/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/08/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/08/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/08/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/08/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/08/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/08/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/08/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/08/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/08/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/08/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/08/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/08/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/08/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/08/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/08/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/08/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/08/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:52 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
04/09/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/09/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/09/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/09/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/09/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/09/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/09/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/09/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/09/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/09/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/09/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/09/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/09/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/09/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/09/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/09/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/09/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/09/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/09/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/09/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/09/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/09/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/09/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/09/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:52 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
04/10/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/10/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/10/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/10/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/10/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/10/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/10/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/10/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/10/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/10/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/10/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/10/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/10/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/10/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/10/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/10/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/10/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/10/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/10/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/10/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/10/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/10/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/10/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/10/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:52 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
04/11/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/11/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/11/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/11/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/11/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/11/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/11/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/11/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/11/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/11/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/11/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/11/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/11/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/11/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/11/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/11/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/11/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/11/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/11/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/11/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/11/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/11/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/11/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/11/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:52 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
04/12/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/12/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/12/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/12/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/12/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/12/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/12/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/12/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/12/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/12/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/12/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/12/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/12/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/12/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/12/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/12/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/12/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/12/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/12/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/12/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/12/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/12/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/12/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/12/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:52 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
04/13/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/13/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/13/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/13/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/13/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/13/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/13/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/13/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/13/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/13/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/13/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/13/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/13/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/13/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/13/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/13/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/13/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/13/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/13/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/13/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/13/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/13/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/13/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/13/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:52 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
04/14/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/14/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/14/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/14/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/14/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/14/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/14/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/14/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/14/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/14/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/14/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/14/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/14/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/14/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/14/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/14/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/14/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/14/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/14/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/14/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/14/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/14/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/14/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/14/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:52 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
04/15/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/15/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/15/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/15/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/15/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/15/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/15/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/15/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/15/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/15/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/15/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/15/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/15/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/15/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/15/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/15/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/15/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/15/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/15/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/15/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/15/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/15/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/15/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/15/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:52 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
04/16/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/16/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/16/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/16/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/16/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/16/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/16/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/16/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/16/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/16/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/16/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/16/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/16/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/16/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/16/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/16/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/16/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/16/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/16/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/16/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/16/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/16/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/16/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/16/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:52 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
04/17/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/17/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/17/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/17/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/17/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/17/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/17/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/17/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/17/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/17/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/17/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/17/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/17/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/17/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/17/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/17/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/17/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/17/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/17/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/17/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/17/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/17/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/17/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/17/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
04/18/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/18/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/18/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/18/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/18/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/18/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/18/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/18/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/18/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/18/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/18/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/18/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/18/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/18/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/18/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/18/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/18/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/18/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/18/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/18/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/18/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/18/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/18/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/18/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
04/19/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/19/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/19/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/19/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/19/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/19/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/19/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/19/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/19/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/19/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/19/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/19/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/19/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/19/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/19/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/19/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/19/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/19/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/19/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/19/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/19/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/19/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/19/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/19/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
04/20/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/20/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/20/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/20/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/20/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/20/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/20/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/20/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/20/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/20/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/20/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/20/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/20/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/20/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/20/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/20/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/20/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/20/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/20/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/20/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/20/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/20/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/20/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/20/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
04/21/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/21/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/21/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/21/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/21/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/21/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/21/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/21/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/21/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/21/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/21/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/21/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/21/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/21/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/21/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/21/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/21/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/21/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/21/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/21/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/21/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/21/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/21/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/21/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
04/22/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/22/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/22/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/22/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/22/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/22/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/22/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/22/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/22/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/22/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/22/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/22/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/22/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/22/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/22/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/22/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/22/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/22/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/22/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/22/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/22/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/22/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/22/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/22/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
04/23/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/23/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/23/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/23/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/23/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/23/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/23/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/23/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/23/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/23/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/23/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/23/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/23/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/23/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/23/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/23/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/23/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/23/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/23/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/23/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/23/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/23/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/23/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/23/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
04/24/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/24/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/24/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/24/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/24/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/24/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/24/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/24/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/24/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/24/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/24/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/24/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/24/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/24/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/24/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/24/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/24/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/24/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/24/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/24/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/24/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/24/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/24/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/24/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
04/25/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/25/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/25/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/25/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/25/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/25/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/25/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/25/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/25/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/25/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/25/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/25/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/25/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/25/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/25/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/25/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/25/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/25/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/25/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/25/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/25/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/25/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/25/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/25/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
04/26/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/26/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/26/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/26/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/26/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/26/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/26/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/26/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/26/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/26/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/26/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/26/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/26/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/26/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/26/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/26/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/26/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/26/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/26/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/26/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/26/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/26/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/26/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/26/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
04/27/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/27/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/27/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/27/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/27/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/27/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/27/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/27/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/27/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/27/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/27/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/27/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/27/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/27/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/27/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/27/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/27/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/27/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/27/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/27/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/27/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/27/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/27/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/27/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
04/28/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/28/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/28/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/28/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/28/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/28/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/28/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/28/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/28/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/28/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/28/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/28/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/28/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/28/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/28/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/28/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/28/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/28/2022 17:00	0	16.1	18.4	18.9	0.0	790,157.9	0.28	0.28
04/28/2022 18:00	0	26.4	21.7	18.2	0.0	672,032.3	0.22	0.22
04/28/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/28/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/28/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/28/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/28/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	21.3	20.1	18.6	0.0	731,095.1	0.50 #	0.50 #
Minimum:	0	16.1	18.4	18.2	0.0	672,032.3	0.00	0.00
Maximum:	0	26.4	21.7	18.9	0.0	790,157.9	0.28	0.28
%SI	100.00	91.67	91.67	91.67	91.67	91.67	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
04/29/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/29/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/29/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/29/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/29/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/29/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/29/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/29/2022 07:00	0	0.0	17.8	0.0	0.0	80,986.1	0.27	0.27
04/29/2022 08:00	0	0.0	17.7	0.0	6.8	169,114.1	1.00	1.00
04/29/2022 09:00	0	0.0	7.9	0.0	20.2	242,368.5	0.20	1.00
04/29/2022 10:00	1	1.6	8.1	14.6	21.2	1,005,766.1	0.00	1.00
04/29/2022 11:00	1	1.6	8.1	14.5	21.3	1,002,247.5	0.00	1.00
04/29/2022 12:00	2	1.5	10.2	14.6	22.7	782,963.0	0.00	1.00
04/29/2022 13:00	1	1.7	7.7	14.5	18.5	1,000,321.7	0.00	1.00
04/29/2022 14:00	2	1.6	8.2	14.5	22.5	998,823.9	0.00	1.00
04/29/2022 15:00	1	1.6	7.5	14.5	18.2	988,553.2	0.00	1.00
04/29/2022 16:00	1	4.9	12.6	14.8	9.8	839,838.8	0.27	0.52
04/29/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/29/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/29/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/29/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/29/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/29/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/29/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	1	2.1	10.6	14.6	16.1	945,502.0	1.74 #	8.79 #
Minimum:	1	1.5	7.5	14.5	0.0	782,963.0	0.00	0.00
Maximum:	2	4.9	17.8	14.8	22.7	1,005,766.1	1.00	1.00
%SI	70.83	70.83	58.33	70.83	58.33	70.83	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
04/30/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/30/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/30/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/30/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/30/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/30/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/30/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/30/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/30/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/30/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/30/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/30/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/30/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/30/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/30/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/30/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/30/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/30/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/30/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/30/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/30/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/30/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/30/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/30/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
05/01/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/01/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/01/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/01/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/01/2022 04:00	0	18.0	18.8	17.1	0.0	736,606.2	0.37	0.37
05/01/2022 05:00	3	3.5	8.4	14.3	16.1	786,381.6	0.57	1.00
05/01/2022 06:00	2	1.7	9.3	14.3	20.5	690,729.4	0.00	1.00
05/01/2022 07:00	2	1.6	10.2	14.5	20.0	644,699.3	0.00	1.00
05/01/2022 08:00	4	1.6	12.4	14.7	27.5	628,168.2	0.00	1.00
05/01/2022 09:00	4	1.6	13.2	14.7	28.2	612,265.2	0.00	1.00
05/01/2022 10:00	4	1.6	13.6	14.8	29.4	616,914.5	0.00	1.00
05/01/2022 11:00	3	1.5	13.0	14.8	26.4	620,281.9	0.00	1.00
05/01/2022 12:00	3	1.6	12.1	14.8	24.1	624,547.3	0.00	1.00
05/01/2022 13:00	3	1.5	12.2	14.9	24.7	632,217.6	0.00	1.00
05/01/2022 14:00	3	1.5	12.2	14.9	24.1	631,304.6	0.00	1.00
05/01/2022 15:00	3	1.5	12.1	14.9	24.1	628,565.8	0.00	1.00
05/01/2022 16:00	3	1.5	12.1	14.9	24.0	627,196.4	0.00	1.00
05/01/2022 17:00	3	1.5	12.1	14.9	24.0	628,109.3	0.00	1.00
05/01/2022 18:00	3	1.5	12.3	14.8	24.4	616,241.0	0.00	1.00
05/01/2022 19:00	3	1.5	12.5	14.8	25.5	614,669.5	0.00	1.00
05/01/2022 20:00	3	1.6	12.6	14.8	26.0	615,343.0	0.00	1.00
05/01/2022 21:00	4	1.6	13.1	14.8	27.6	615,118.5	0.00	1.00
05/01/2022 22:00	4	1.6	13.2	14.8	27.8	616,690.0	0.00	1.00
05/01/2022 23:00	4	1.6	13.3	14.8	28.3	619,383.9	0.00	1.00
Average/Sum#:	3	2.5	12.4	14.9	23.6	640,271.7	0.94 #	19.37 #
Minimum:	2	1.5	8.4	14.3	0.0	612,265.2	0.00	0.00
Maximum:	4	18.0	18.8	17.1	29.4	786,381.6	0.57	1.00
%SI	20.83	16.67	16.67	16.67	16.67	16.67	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
05/02/2022 00:00	4	1.6	13.6	14.8	29.6	618,261.4	0.00	1.00
05/02/2022 01:00	4	1.6	14.1	14.8	31.8	615,343.0	0.00	1.00
05/02/2022 02:00	4	1.5	14.4	14.8	31.4	615,567.5	0.00	1.00
05/02/2022 03:00	5	1.6	14.6	14.8	32.4	613,547.0	0.00	1.00
05/02/2022 04:00	5	1.5	14.9	14.9	33.9	623,088.1	0.00	1.00
05/02/2022 05:00	6	1.7	18.6	15.0	46.0	622,043.6	0.00	1.00
05/02/2022 06:00	5	1.5	17.1	14.9	39.9	615,099.8	0.00	1.00
05/02/2022 07:00	5	1.5	16.4	14.9	37.0	618,295.1	0.00	1.00
05/02/2022 08:00	1	1.6	9.9	14.6	12.5	640,803.7	0.00	1.00
05/02/2022 09:00	2	1.6	9.3	14.6	15.7	643,846.8	0.00	1.00
05/02/2022 10:00	2	1.6	8.8	14.6	15.1	650,367.9	0.00	1.00
05/02/2022 11:00	2	1.6	8.9	14.6	15.9	648,628.9	0.00	1.00
05/02/2022 12:00	2	1.6	9.2	14.6	16.5	643,194.7	0.00	1.00
05/02/2022 13:00	2	1.6	9.1	14.6	16.0	645,368.4	0.00	1.00
05/02/2022 14:00	2	1.6	9.0	14.6	16.0	647,107.4	0.00	1.00
05/02/2022 15:00	2	1.6	9.0	14.6	15.9	645,585.8	0.00	1.00
05/02/2022 16:00	2	1.6	8.8	14.7	15.9	655,556.7	0.00	1.00
05/02/2022 17:00	1	1.6	7.9	14.6	13.9	776,441.9	0.00	1.00
05/02/2022 18:00	2	1.5	8.5	14.5	16.8	756,393.0	0.00	1.00
05/02/2022 19:00	2	1.8	8.9	14.5	20.2	824,222.3	0.00	1.00
05/02/2022 20:00	2	1.5	8.5	14.6	18.2	839,261.5	0.00	1.00
05/02/2022 21:00	1	1.6	7.9	14.6	21.2	1,002,288.2	0.00	1.00
05/02/2022 22:00	1	1.6	7.5	14.6	20.2	993,158.7	0.00	1.00
05/02/2022 23:00	2	1.6	8.0	14.5	22.7	996,898.2	0.00	1.00
Average/Sum#:	3	1.6	11.0	14.7	23.1	706,265.4	0.00 #	24.00 #
Minimum:	1	1.5	7.5	14.5	12.5	613,547.0	0.00	1.00
Maximum:	6	1.8	18.6	15.0	46.0	1,002,288.2	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
05/03/2022 00:00	2	1.6	7.8	14.5	21.7	999,037.9	0.05	1.00
05/03/2022 01:00	0	9.0	18.4	15.2	0.0	656,362.7	0.25	0.25
05/03/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/03/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/03/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/03/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/03/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/03/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/03/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/03/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/03/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/03/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/03/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/03/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/03/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/03/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/03/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/03/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/03/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/03/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/03/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/03/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/03/2022 22:00	0	17.8	18.8	17.2	0.0	756,144.3	0.35	0.35
05/03/2022 23:00	2	3.0	8.1	14.5	16.8	919,440.1	0.38	1.00
Average/Sum#:	2	7.9	13.3	15.4	9.6	832,746.3	1.03 #	2.60 #
Minimum:	2	1.6	7.8	14.5	0.0	656,362.7	0.00	0.00
Maximum:	2	17.8	18.8	17.2	21.7	999,037.9	0.38	1.00
%SI	91.67	83.33	83.33	83.33	83.33	83.33	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
05/04/2022 00:00	1	1.7	8.6	14.3	17.0	702,556.2	0.00	1.00
05/04/2022 01:00	3	1.6	10.6	14.6	22.4	643,194.7	0.00	1.00
05/04/2022 02:00	1	1.5	7.7	14.4	16.5	864,844.2	0.00	1.00
05/04/2022 03:00	2	1.6	7.5	14.5	19.8	942,763.1	0.00	1.00
05/04/2022 04:00	2	1.6	7.4	14.5	20.2	966,942.0	0.00	1.00
05/04/2022 05:00	2	1.7	8.5	14.5	21.4	841,340.1	0.00	1.00
05/04/2022 06:00	3	1.5	9.1	14.6	21.9	836,653.1	0.00	1.00
05/04/2022 07:00	1	1.8	9.6	14.1	21.0	984,173.1	0.00	1.00
05/04/2022 08:00	3	1.2	11.3	14.6	28.0	727,968.6	0.00	1.00
05/04/2022 09:00	2	1.0	11.7	14.8	22.0	637,792.6	0.00	1.00
05/04/2022 10:00	2	1.4	12.4	14.8	22.3	625,669.8	0.00	1.00
05/04/2022 11:00	2	1.4	11.1	14.8	18.4	638,690.6	0.00	1.00
05/04/2022 12:00	0	1.6	9.7	14.8	10.7	651,486.8	0.00	1.00
05/04/2022 13:00	1	1.6	10.0	14.8	15.2	654,180.8	0.00	1.00
05/04/2022 14:00	1	1.5	10.8	14.8	17.2	642,282.5	0.00	1.00
05/04/2022 15:00	2	1.6	11.9	14.9	21.5	634,956.4	0.00	1.00
05/04/2022 16:00	2	1.5	11.9	14.9	21.1	634,728.2	0.00	1.00
05/04/2022 17:00	1	1.5	10.5	14.8	17.6	704,467.8	0.00	1.00
05/04/2022 18:00	2	2.1	12.5	12.9	25.8	947,641.7	0.00	1.00
05/04/2022 19:00	2	1.9	10.2	13.6	22.9	957,283.9	0.00	1.00
05/04/2022 20:00	2	1.8	9.7	13.8	22.4	969,205.3	0.00	1.00
05/04/2022 21:00	2	1.9	11.7	13.2	27.0	965,355.3	0.00	1.00
05/04/2022 22:00	2	1.8	9.4	13.9	21.7	970,530.6	0.00	1.00
05/04/2022 23:00	1	1.7	8.6	14.3	17.7	816,259.9	0.00	1.00
Average/Sum#:	2	1.6	10.1	14.4	20.5	790,040.3	0.00 #	24.00 #
Minimum:	0	1.0	7.4	12.9	10.7	625,669.8	0.00	1.00
Maximum:	3	2.1	12.5	14.9	28.0	984,173.1	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
05/05/2022 00:00	2	1.7	8.6	14.5	17.1	771,585.1	0.00	1.00
05/05/2022 01:00	2	1.5	10.7	14.6	19.6	645,585.8	0.00	1.00
05/05/2022 02:00	2	1.6	11.7	14.6	21.2	629,717.8	0.00	1.00
05/05/2022 03:00	3	1.6	11.4	14.6	21.6	629,500.5	0.00	1.00
05/05/2022 04:00	2	1.5	9.3	14.5	17.2	754,039.3	0.00	1.00
05/05/2022 05:00	2	1.6	9.4	14.4	20.4	696,088.9	0.00	1.00
05/05/2022 06:00	3	1.5	13.4	14.7	27.6	623,088.1	0.00	1.00
05/05/2022 07:00	3	1.6	14.3	14.7	28.1	611,823.5	0.00	1.00
05/05/2022 08:00	3	1.6	13.5	14.7	25.6	616,682.7	0.00	1.00
05/05/2022 09:00	2	1.5	11.5	14.6	20.7	632,108.9	0.00	1.00
05/05/2022 10:00	2	1.4	11.3	14.7	21.0	636,340.6	0.00	1.00
05/05/2022 11:00	2	1.5	11.4	14.7	19.8	627,947.3	0.00	1.00
05/05/2022 12:00	0	1.3	7.3	14.5	9.5	814,379.6	0.00	1.00
05/05/2022 13:00	1	1.6	7.9	14.6	13.5	887,300.1	0.00	1.00
05/05/2022 14:00	2	1.5	10.2	14.7	18.2	674,993.7	0.00	1.00
05/05/2022 15:00	2	1.6	10.9	14.6	19.4	648,628.9	0.00	1.00
05/05/2022 16:00	2	1.5	12.3	14.8	21.3	630,608.7	0.00	1.00
05/05/2022 17:00	1	1.4	9.8	14.6	16.5	738,837.1	0.00	1.00
05/05/2022 18:00	1	1.7	8.1	14.2	17.7	983,737.2	0.00	1.00
05/05/2022 19:00	1	1.7	8.1	14.2	19.3	979,240.6	0.00	1.00
05/05/2022 20:00	1	1.7	8.1	14.2	19.9	978,014.3	0.00	1.00
05/05/2022 21:00	2	1.8	8.2	14.3	18.8	883,901.2	0.00	1.00
05/05/2022 22:00	2	1.6	9.9	14.5	19.0	677,437.1	0.00	1.00
05/05/2022 23:00	2	1.6	11.5	14.6	21.0	623,196.8	0.00	1.00
Average/Sum#:	2	1.6	10.4	14.5	19.8	724,782.7	0.00 #	24.00 #
Minimum:	0	1.3	7.3	14.2	9.5	611,823.5	0.00	1.00
Maximum:	3	1.8	14.3	14.8	28.1	983,737.2	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
05/06/2022 00:00	3	1.6	11.5	14.6	21.9	627,326.8	0.00	1.00
05/06/2022 01:00	3	1.6	12.5	14.6	24.9	616,023.6	0.00	1.00
05/06/2022 02:00	2	1.7	11.8	14.6	20.7	628,631.0	0.00	1.00
05/06/2022 03:00	2	1.5	10.8	14.5	20.7	648,978.8	0.00	1.00
05/06/2022 04:00	1	1.7	7.9	14.3	17.9	972,706.3	0.00	1.00
05/06/2022 05:00	2	1.7	8.2	14.2	21.2	975,970.4	0.00	1.00
05/06/2022 06:00	2	1.7	8.1	14.2	21.4	974,744.0	0.00	1.00
05/06/2022 07:00	2	1.6	9.0	14.4	19.2	735,275.6	0.00	1.00
05/06/2022 08:00	1	1.7	7.7	14.3	17.5	977,478.5	0.00	1.00
05/06/2022 09:00	1	1.7	7.7	14.3	18.5	977,893.5	0.00	1.00
05/06/2022 10:00	1	1.7	7.6	14.3	18.0	959,219.5	0.00	1.00
05/06/2022 11:00	1	1.7	8.2	14.1	19.3	977,124.6	0.00	1.00
05/06/2022 12:00	1	1.6	7.0	14.4	13.0	910,772.6	0.00	1.00
05/06/2022 13:00	1	1.7	8.1	14.1	18.4	981,353.7	0.00	1.00
05/06/2022 14:00	2	1.8	9.6	14.4	20.3	787,945.7	0.00	1.00
05/06/2022 15:00	2	1.5	12.3	14.8	20.9	620,730.9	0.00	1.00
05/06/2022 16:00	1	1.5	7.9	14.2	14.0	954,100.5	0.00	1.00
05/06/2022 17:00	1	1.8	8.3	14.0	18.5	970,703.6	0.00	1.00
05/06/2022 18:00	1	1.7	8.2	14.1	19.4	972,895.5	0.00	1.00
05/06/2022 19:00	1	1.7	8.1	14.2	20.0	979,649.4	0.00	1.00
05/06/2022 20:00	1	1.7	8.1	14.2	20.3	979,240.6	0.00	1.00
05/06/2022 21:00	2	1.7	8.1	14.2	20.7	977,605.5	0.00	1.00
05/06/2022 22:00	2	1.7	8.3	14.4	17.9	863,158.7	0.00	1.00
05/06/2022 23:00	1	1.7	7.4	14.4	19.6	978,401.1	0.00	1.00
Average/Sum#:	2	1.7	8.9	14.3	19.3	876,997.1	0.00 #	24.00 #
Minimum:	1	1.5	7.0	14.0	13.0	616,023.6	0.00	1.00
Maximum:	3	1.8	12.5	14.8	24.9	981,353.7	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
05/07/2022 00:00	2	1.7	7.6	14.4	20.2	977,979.7	0.00	1.00
05/07/2022 01:00	2	1.7	8.3	14.2	22.7	977,401.1	0.00	1.00
05/07/2022 02:00	2	1.7	9.2	14.1	23.8	993,638.2	0.00	1.00
05/07/2022 03:00	2	1.7	9.0	14.1	24.3	992,027.1	0.00	1.00
05/07/2022 04:00	2	1.7	8.8	14.1	24.0	991,221.6	0.00	1.00
05/07/2022 05:00	2	1.7	8.7	14.1	23.9	989,610.5	0.00	1.00
05/07/2022 06:00	2	1.7	8.7	14.1	23.5	990,818.8	0.00	1.00
05/07/2022 07:00	2	1.7	8.8	14.1	23.2	994,645.2	0.00	1.00
05/07/2022 08:00	2	1.7	8.8	14.1	22.3	985,381.4	0.00	1.00
05/07/2022 09:00	2	1.7	9.0	14.1	22.7	992,027.1	0.00	1.00
05/07/2022 10:00	2	1.7	9.0	14.1	22.6	989,811.9	0.00	1.00
05/07/2022 11:00	2	1.7	9.3	14.1	22.7	994,242.4	0.00	1.00
05/07/2022 12:00	1	1.7	8.7	14.2	20.8	956,961.9	0.00	1.00
05/07/2022 13:00	3	1.5	11.0	14.6	21.9	641,455.8	0.00	1.00
05/07/2022 14:00	3	1.6	13.8	14.8	25.8	621,853.4	0.00	1.00
05/07/2022 15:00	3	1.6	13.8	14.8	25.6	617,587.9	0.00	1.00
05/07/2022 16:00	3	1.6	13.8	14.8	25.7	618,036.9	0.00	1.00
05/07/2022 17:00	2	1.4	12.5	14.7	21.8	637,003.2	0.00	1.00
05/07/2022 18:00	1	1.6	8.4	14.2	14.9	956,757.5	0.00	1.00
05/07/2022 19:00	1	1.7	8.6	14.2	20.0	978,831.8	0.00	1.00
05/07/2022 20:00	1	1.7	8.4	14.4	20.6	979,033.1	0.00	1.00
05/07/2022 21:00	4	1.6	12.6	14.7	28.2	637,886.7	0.00	1.00
05/07/2022 22:00	4	1.3	14.6	14.8	30.4	618,710.4	0.00	1.00
05/07/2022 23:00	4	1.4	14.4	14.8	30.6	618,934.9	0.00	1.00
Average/Sum#:	2	1.6	10.2	14.4	23.4	864,660.8	0.00 #	24.00 #
Minimum:	1	1.3	7.6	14.1	14.9	617,587.9	0.00	1.00
Maximum:	4	1.7	14.6	14.8	30.6	994,645.2	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
05/08/2022 00:00	4	1.4	14.6	14.8	31.6	618,485.9	0.00	1.00
05/08/2022 01:00	4	1.3	14.9	14.8	33.1	618,710.4	0.00	1.00
05/08/2022 02:00	4	1.3	15.5	14.9	33.3	630,163.5	0.00	1.00
05/08/2022 03:00	5	1.4	15.6	14.8	35.6	620,281.9	0.00	1.00
05/08/2022 04:00	4	1.4	15.4	14.8	33.7	634,425.1	0.00	1.00
05/08/2022 05:00	4	1.5	16.4	14.9	35.1	634,043.5	0.02	1.00
05/08/2022 06:00	0	6.4	31.3	16.0	0.0	534,075.5	0.12	0.12
05/08/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/08/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/08/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/08/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/08/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/08/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/08/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/08/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/08/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/08/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/08/2022 17:00	0	7.9	16.9	15.7	3.3	701,566.6	0.70	0.70
05/08/2022 18:00	3	1.5	14.1	14.7	29.3	703,265.7	0.18	1.00
05/08/2022 19:00	1	1.7	9.2	14.3	20.7	1,000,302.3	0.00	1.00
05/08/2022 20:00	2	1.7	9.2	14.3	23.6	1,006,941.9	0.00	1.00
05/08/2022 21:00	2	1.7	8.9	14.3	23.6	990,135.3	0.00	1.00
05/08/2022 22:00	4	1.7	14.3	14.7	33.3	658,649.0	0.00	1.00
05/08/2022 23:00	4	1.5	16.6	14.9	35.7	630,848.2	0.00	1.00
Average/Sum#:	3	2.3	15.2	14.9	26.6	712,992.5	1.02 #	12.82 #
Minimum:	1	1.3	8.9	14.3	0.0	534,075.5	0.00	0.00
Maximum:	5	7.9	31.3	16.0	35.7	1,006,941.9	0.70	1.00
%SI	50.00	41.67	41.67	41.67	41.67	41.67	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
05/09/2022 00:00	4	1.5	15.8	14.9	33.8	633,587.0	0.00	1.00
05/09/2022 01:00	4	1.5	15.7	14.9	33.7	632,674.1	0.00	1.00
05/09/2022 02:00	4	1.5	16.5	14.9	34.8	632,674.1	0.00	1.00
05/09/2022 03:00	4	1.5	15.9	14.8	34.2	623,649.3	0.00	1.00
05/09/2022 04:00	4	1.5	15.8	14.8	33.9	626,118.8	0.00	1.00
05/09/2022 05:00	4	1.6	15.2	14.8	32.5	633,976.1	0.00	1.00
05/09/2022 06:00	5	1.5	16.9	14.9	37.8	630,391.7	0.00	1.00
05/09/2022 07:00	4	1.5	16.7	14.9	36.0	631,076.4	0.00	1.00
05/09/2022 08:00	4	1.5	16.1	14.9	33.3	629,935.2	0.00	1.00
05/09/2022 09:00	4	1.5	15.8	14.9	33.0	630,163.5	0.00	1.00
05/09/2022 10:00	3	1.6	15.9	14.9	29.4	629,707.0	0.07	1.00
05/09/2022 11:00	0	9.1	34.9	16.8	0.0	508,023.0	0.07	0.07
05/09/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/09/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/09/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/09/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/09/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/09/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/09/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/09/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/09/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/09/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/09/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/09/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	4	2.2	17.6	15.0	31.0	620,164.7	0.14 #	11.07 #
Minimum:	3	1.5	15.2	14.8	0.0	508,023.0	0.00	0.00
Maximum:	5	9.1	34.9	16.8	37.8	633,976.1	0.07	1.00
%SI	54.17	50.00	50.00	50.00	50.00	50.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
05/10/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/10/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/10/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/10/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/10/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/10/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/10/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/10/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/10/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/10/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/10/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/10/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/10/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/10/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/10/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/10/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/10/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/10/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/10/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/10/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/10/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/10/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/10/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/10/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
05/11/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/11/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/11/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/11/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/11/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/11/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/11/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/11/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/11/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/11/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/11/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/11/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/11/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/11/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/11/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/11/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/11/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/11/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/11/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/11/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/11/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/11/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/11/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/11/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
05/12/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/12/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/12/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/12/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/12/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/12/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/12/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/12/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/12/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/12/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/12/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/12/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/12/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/12/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/12/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/12/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/12/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/12/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/12/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/12/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/12/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/12/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/12/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/12/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
05/13/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/13/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/13/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/13/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/13/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/13/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/13/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/13/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/13/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/13/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/13/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/13/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/13/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/13/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/13/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/13/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/13/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/13/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/13/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/13/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/13/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/13/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/13/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/13/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
05/14/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/14/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/14/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/14/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/14/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/14/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/14/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/14/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/14/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/14/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/14/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/14/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/14/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/14/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/14/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/14/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/14/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/14/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/14/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/14/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/14/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/14/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/14/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/14/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
05/15/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/15/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/15/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/15/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/15/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/15/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/15/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/15/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/15/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/15/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/15/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/15/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/15/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/15/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/15/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/15/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/15/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/15/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/15/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/15/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/15/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/15/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/15/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/15/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
05/16/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/16/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/16/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/16/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/16/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/16/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/16/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/16/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/16/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/16/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/16/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/16/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/16/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/16/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/16/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/16/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/16/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/16/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/16/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/16/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/16/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/16/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/16/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/16/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
05/17/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/17/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/17/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/17/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/17/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/17/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/17/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/17/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/17/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/17/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/17/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/17/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/17/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/17/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/17/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/17/2022 15:00	0	11.3	15.0	16.0	0.0	801,812.0	0.62	0.62
05/17/2022 16:00	0	1.6	7.5	14.6	12.5	938,599.1	0.15	1.00
05/17/2022 17:00	1	1.6	7.6	14.5	15.4	943,191.0	0.00	1.00
05/17/2022 18:00	1	1.6	7.0	14.6	14.4	972,726.1	0.00	1.00
05/17/2022 19:00	1	1.7	8.1	14.3	19.3	979,968.4	0.00	1.00
05/17/2022 20:00	2	1.8	9.3	13.8	22.7	1,002,380.1	0.00	1.00
05/17/2022 21:00	2	1.8	9.4	13.6	23.0	998,179.1	0.00	1.00
05/17/2022 22:00	1	1.7	7.9	14.2	17.9	901,776.2	0.00	1.00
05/17/2022 23:00	4	1.6	13.5	14.9	29.3	622,859.9	0.00	1.00
Average/Sum#:	2	2.7	9.5	14.5	17.2	906,832.4	0.77 #	8.62 #
Minimum:	0	1.6	7.0	13.6	0.0	622,859.9	0.00	0.00
Maximum:	4	11.3	15.0	16.0	29.3	1,002,380.1	0.62	1.00
%SI	66.67	62.50	62.50	62.50	62.50	62.50	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
05/18/2022 00:00	3	1.6	13.5	14.9	27.1	623,544.6	0.00	1.00
05/18/2022 01:00	4	1.5	14.2	14.9	30.1	618,066.9	0.00	1.00
05/18/2022 02:00	0	1.4	8.1	14.6	11.7	793,614.0	0.00	1.00
05/18/2022 03:00	2	2.2	11.4	12.7	29.0	988,657.6	0.00	1.00
05/18/2022 04:00	4	2.3	13.6	11.8	42.5	1,014,577.9	0.00	1.00
05/18/2022 05:00	2	1.8	8.9	13.8	22.8	959,947.2	0.00	1.00
05/18/2022 06:00	2	1.7	9.0	14.5	21.5	811,811.9	0.00	1.00
05/18/2022 07:00	1	1.1	7.8	14.5	13.1	935,060.1	0.00	1.00
05/18/2022 08:00	1	1.6	7.8	14.5	17.6	999,465.8	0.00	1.00
05/18/2022 09:00	1	1.6	7.7	14.5	18.0	998,182.0	0.00	1.00
05/18/2022 10:00	1	1.7	7.8	14.4	18.4	984,932.2	0.00	1.00
05/18/2022 11:00	2	2.0	11.6	12.9	28.7	1,007,382.8	0.00	1.00
05/18/2022 12:00	1	1.7	7.6	14.3	17.1	973,536.2	0.00	1.00
05/18/2022 13:00	2	1.9	10.0	13.4	24.4	997,488.7	0.00	1.00
05/18/2022 14:00	3	2.2	13.2	12.2	35.0	998,578.0	0.00	1.00
05/18/2022 15:00	2	2.0	11.1	13.1	25.7	994,588.4	0.00	1.00
05/18/2022 16:00	1	1.8	8.8	13.8	20.5	990,036.0	0.00	1.00
05/18/2022 17:00	3	2.2	12.2	12.5	33.0	1,001,147.0	0.00	1.00
05/18/2022 18:00	2	2.0	11.3	12.9	27.3	990,778.5	0.00	1.00
05/18/2022 19:00	2	2.0	10.4	13.2	25.0	995,589.3	0.00	1.00
05/18/2022 20:00	3	2.1	11.9	12.5	31.0	990,387.3	0.00	1.00
05/18/2022 21:00	1	1.8	8.4	13.8	19.6	978,463.4	0.00	1.00
05/18/2022 22:00	1	1.8	8.7	13.9	19.9	984,811.8	0.00	1.00
05/18/2022 23:00	1	1.7	7.9	14.3	15.7	849,250.6	0.00	1.00
Average/Sum#:	2	1.8	10.1	13.7	23.9	936,662.4	0.00 #	24.00 #
Minimum:	0	1.1	7.6	11.8	11.7	618,066.9	0.00	1.00
Maximum:	4	2.3	14.2	14.9	42.5	1,014,577.9	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
05/19/2022 00:00	3	4.1	16.7	15.1	16.1	601,602.3	0.13	0.37
05/19/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/19/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/19/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/19/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/19/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/19/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/19/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/19/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/19/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/19/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/19/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/19/2022 12:00	0	12.0	17.2	16.1	1.9	708,962.4	0.58	0.58
05/19/2022 13:00	1	1.7	8.2	14.6	17.1	846,652.1	0.27	1.00
05/19/2022 14:00	2	1.7	10.0	13.8	25.1	1,005,080.3	0.00	1.00
05/19/2022 15:00	1	1.5	8.9	14.4	18.3	854,520.8	0.00	1.00
05/19/2022 16:00	1	1.5	8.9	14.5	16.6	829,357.6	0.00	1.00
05/19/2022 17:00	1	1.6	9.1	14.0	21.7	988,367.2	0.00	1.00
05/19/2022 18:00	1	1.7	9.6	13.9	22.5	1,003,005.5	0.00	1.00
05/19/2022 19:00	2	1.9	9.9	13.7	23.8	1,005,005.3	0.00	1.00
05/19/2022 20:00	2	2.0	11.6	13.1	28.6	1,003,717.8	0.00	1.00
05/19/2022 21:00	2	1.8	9.4	13.9	22.6	992,637.0	0.00	1.00
05/19/2022 22:00	1	2.8	11.2	14.6	17.0	876,649.0	0.13	0.82
05/19/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	2	2.9	10.9	14.3	19.3	892,963.1	1.11 #	10.77 #
Minimum:	1	1.5	8.2	13.1	1.9	601,602.3	0.00	0.00
Maximum:	3	12.0	17.2	16.1	28.6	1,005,080.3	0.58	1.00
%SI	54.17	50.00	50.00	50.00	50.00	50.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
05/20/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/20/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/20/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/20/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/20/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/20/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/20/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/20/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/20/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/20/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/20/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/20/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/20/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/20/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/20/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/20/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/20/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/20/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/20/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/20/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/20/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/20/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/20/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/20/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
05/21/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/21/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/21/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/21/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/21/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/21/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/21/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/21/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/21/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/21/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/21/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/21/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/21/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/21/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/21/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/21/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/21/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/21/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/21/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/21/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/21/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/21/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/21/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/21/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
05/22/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/22/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/22/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/22/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/22/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/22/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/22/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/22/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/22/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/22/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/22/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/22/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/22/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/22/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/22/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/22/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/22/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/22/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/22/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/22/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/22/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/22/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/22/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/22/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
05/23/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/23/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/23/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/23/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/23/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/23/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/23/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/23/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/23/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/23/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/23/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/23/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/23/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/23/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/23/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/23/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/23/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/23/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/23/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/23/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/23/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/23/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/23/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/23/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
05/24/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/24/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/24/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/24/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/24/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/24/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/24/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/24/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/24/2022 08:00	0	11.7	14.5	15.7	2.8	717,367.7	0.83	0.83
05/24/2022 09:00	1	1.6	10.6	14.7	17.4	639,653.7	0.12	1.00
05/24/2022 10:00	1	1.5	8.2	14.6	14.6	788,614.5	0.00	1.00
05/24/2022 11:00	0	1.6	7.2	14.5	10.5	840,270.2	0.00	1.00
05/24/2022 12:00	1	1.7	7.5	14.4	15.4	955,436.9	0.00	1.00
05/24/2022 13:00	2	1.9	10.3	13.6	23.9	1,000,805.4	0.00	1.00
05/24/2022 14:00	3	2.2	13.0	12.5	33.5	1,002,125.2	0.00	1.00
05/24/2022 15:00	4	2.3	14.2	11.9	40.5	999,071.2	0.00	1.00
05/24/2022 16:00	3	2.2	13.3	12.4	34.0	995,007.6	0.00	1.00
05/24/2022 17:00	2	2.0	11.9	12.9	27.7	984,445.0	0.00	1.00
05/24/2022 18:00	4	2.3	14.1	11.8	39.3	983,728.3	0.00	1.00
05/24/2022 19:00	3	2.2	13.7	12.2	35.3	988,976.3	0.00	1.00
05/24/2022 20:00	2	1.9	10.4	13.3	23.6	987,066.7	0.00	1.00
05/24/2022 21:00	2	1.9	9.8	13.5	23.1	985,615.4	0.00	1.00
05/24/2022 22:00	2	2.0	11.4	12.9	28.1	982,562.0	0.00	1.00
05/24/2022 23:00	1	1.7	8.5	14.4	16.2	828,817.8	0.00	1.00
Average/Sum#:	2	2.5	11.2	13.5	24.1	917,472.7	0.95 #	15.83 #
Minimum:	0	1.5	7.2	11.8	2.8	639,653.7	0.00	0.00
Maximum:	4	11.7	14.5	15.7	40.5	1,002,125.2	0.83	1.00
%SI	37.50	33.33	33.33	33.33	33.33	33.33	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
05/25/2022 00:00	1	1.4	7.6	14.7	13.4	860,307.7	0.00	1.00
05/25/2022 01:00	2	1.7	9.2	14.5	16.0	676,795.2	0.00	1.00
05/25/2022 02:00	2	1.7	10.8	14.7	18.0	638,328.5	0.00	1.00
05/25/2022 03:00	1	1.5	8.3	14.4	16.6	814,702.2	0.00	1.00
05/25/2022 04:00	1	1.7	8.2	14.1	19.5	979,541.2	0.00	1.00
05/25/2022 05:00	1	1.7	7.4	14.4	17.0	953,119.4	0.00	1.00
05/25/2022 06:00	1	1.7	8.0	14.1	18.6	980,749.5	0.00	1.00
05/25/2022 07:00	2	1.7	9.0	14.5	18.4	819,942.8	0.00	1.00
05/25/2022 08:00	2	1.5	11.8	14.9	20.0	631,532.9	0.00	1.00
05/25/2022 09:00	0	1.2	7.1	14.5	8.4	781,427.8	0.00	1.00
05/25/2022 10:00	0	1.5	7.0	14.5	11.1	974,859.0	0.00	1.00
05/25/2022 11:00	3	2.3	12.5	12.2	33.5	999,837.2	0.00	1.00
05/25/2022 12:00	4	2.3	13.1	11.8	38.7	1,001,636.1	0.00	1.00
05/25/2022 13:00	4	2.3	13.1	11.8	38.7	999,679.8	0.00	1.00
05/25/2022 14:00	4	2.3	13.1	11.7	38.7	987,027.5	0.00	1.00
05/25/2022 15:00	4	2.3	13.0	11.7	39.0	983,455.1	0.00	1.00
05/25/2022 16:00	4	2.3	13.0	11.7	38.8	982,859.7	0.00	1.00
05/25/2022 17:00	4	2.3	13.0	11.8	37.4	981,771.9	0.00	1.00
05/25/2022 18:00	4	2.3	12.9	11.8	37.2	985,082.6	0.00	1.00
05/25/2022 19:00	2	2.0	10.6	13.0	23.3	972,984.7	0.00	1.00
05/25/2022 20:00	1	1.8	8.5	13.8	18.4	975,763.1	0.00	1.00
05/25/2022 21:00	1	1.9	8.9	13.7	19.8	979,518.8	0.00	1.00
05/25/2022 22:00	1	2.5	10.3	14.5	13.0	801,327.2	0.12	1.00
05/25/2022 23:00	0	15.0	25.4	17.6	0.0	297,953.5	0.02	0.02
Average/Sum#:	2	2.5	10.9	13.6	23.1	877,508.5	0.14 #	23.02 #
Minimum:	0	1.2	7.0	11.7	0.0	297,953.5	0.00	0.02
Maximum:	4	15.0	25.4	17.6	39.0	1,001,636.1	0.12	1.00
%SI	4.17	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
05/26/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/26/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/26/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/26/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/26/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/26/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/26/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/26/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/26/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/26/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/26/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/26/2022 11:00	0	17.7	20.8	17.1	0.0	712,461.1	0.35	0.35
05/26/2022 12:00	2	3.1	9.7	14.7	14.6	665,275.2	0.50	1.00
05/26/2022 13:00	3	1.4	11.6	14.8	25.1	633,751.6	0.00	1.00
05/26/2022 14:00	0	1.0	8.0	14.6	12.3	835,566.2	0.00	1.00
05/26/2022 15:00	1	1.4	7.7	14.3	17.3	983,080.7	0.00	1.00
05/26/2022 16:00	1	1.4	7.7	14.3	18.7	985,155.6	0.00	1.00
05/26/2022 17:00	1	1.6	7.7	14.3	16.7	987,230.5	0.00	1.00
05/26/2022 18:00	1	1.7	7.7	14.3	18.1	990,550.3	0.00	1.00
05/26/2022 19:00	1	1.7	7.8	14.3	18.7	992,210.2	0.00	1.00
05/26/2022 20:00	1	4.7	11.7	14.8	7.2	819,634.2	0.27	0.47
05/26/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/26/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/26/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	1	3.6	10.0	14.8	14.9	860,491.6	1.12 #	8.82 #
Minimum:	0	1.0	7.7	14.3	0.0	633,751.6	0.00	0.00
Maximum:	3	17.7	20.8	17.1	25.1	992,210.2	0.50	1.00
%SI	62.50	58.33	58.33	58.33	58.33	58.33	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
05/27/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/27/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/27/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/27/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/27/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/27/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/27/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/27/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/27/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/27/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/27/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/27/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/27/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/27/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/27/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/27/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/27/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/27/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/27/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/27/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/27/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/27/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/27/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/27/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
05/28/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/28/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/28/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/28/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/28/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/28/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/28/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/28/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/28/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/28/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/28/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/28/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/28/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/28/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/28/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/28/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/28/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/28/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/28/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/28/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/28/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/28/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/28/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/28/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
05/29/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/29/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/29/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/29/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/29/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/29/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/29/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/29/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/29/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/29/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/29/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/29/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/29/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/29/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/29/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/29/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/29/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/29/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/29/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/29/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/29/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/29/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/29/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/29/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
05/30/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/30/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/30/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/30/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/30/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/30/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/30/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/30/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/30/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/30/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/30/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/30/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/30/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/30/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/30/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/30/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/30/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/30/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/30/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/30/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/30/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/30/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/30/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/30/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
05/31/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/31/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/31/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/31/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/31/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/31/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/31/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/31/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/31/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/31/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/31/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/31/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/31/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/31/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/31/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/31/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/31/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/31/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/31/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/31/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/31/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/31/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/31/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/31/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
06/01/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/01/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/01/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/01/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/01/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/01/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/01/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/01/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/01/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/01/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/01/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/01/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/01/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/01/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/01/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/01/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/01/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/01/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/01/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/01/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/01/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/01/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/01/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/01/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
06/02/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/02/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/02/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/02/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/02/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/02/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/02/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/02/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/02/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/02/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/02/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/02/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/02/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/02/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/02/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/02/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/02/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/02/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/02/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/02/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/02/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/02/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/02/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/02/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
06/03/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/03/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/03/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/03/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/03/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/03/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/03/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/03/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/03/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/03/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/03/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/03/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/03/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/03/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/03/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/03/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/03/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/03/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/03/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/03/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/03/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/03/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/03/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/03/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
06/04/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/04/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/04/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/04/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/04/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/04/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/04/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/04/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/04/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/04/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/04/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/04/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/04/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/04/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/04/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/04/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/04/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/04/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/04/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/04/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/04/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/04/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/04/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/04/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
06/05/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/05/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/05/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/05/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/05/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/05/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/05/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/05/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/05/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/05/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/05/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/05/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/05/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/05/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/05/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/05/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/05/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/05/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/05/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/05/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/05/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/05/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/05/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/05/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
06/06/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/06/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/06/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/06/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/06/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/06/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/06/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/06/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/06/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/06/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/06/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/06/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/06/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/06/2022 13:00	0	18.4	20.5	16.8	0.0	666,675.9	0.35	0.35
06/06/2022 14:00	1	2.4	8.0	14.6	15.5	954,684.4	0.27	1.00
06/06/2022 15:00	1	1.6	7.8	14.6	18.0	1,012,069.8	0.00	1.00
06/06/2022 16:00	1	1.6	7.6	14.6	17.1	1,010,113.5	0.00	1.00
06/06/2022 17:00	1	1.6	7.6	14.6	16.3	1,009,244.0	0.03	1.00
06/06/2022 18:00	0	8.2	16.9	15.1	0.0	671,962.4	0.23	0.23
06/06/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/06/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/06/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/06/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/06/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	1	5.6	11.4	15.1	11.2	887,458.3	0.88 #	4.58 #
Minimum:	1	1.6	7.6	14.6	0.0	666,675.9	0.00	0.00
Maximum:	1	18.4	20.5	16.8	18.0	1,012,069.8	0.35	1.00
%SI	83.33	75.00	75.00	75.00	75.00	75.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
06/07/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/07/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/07/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/07/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/07/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/07/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/07/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/07/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/07/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/07/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/07/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/07/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/07/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/07/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/07/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/07/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/07/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/07/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/07/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/07/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/07/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/07/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/07/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/07/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
06/08/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/08/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/08/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/08/2022 03:00	0	21.3	22.4	18.0	0.0	780,099.7	0.27	0.27
06/08/2022 04:00	1	3.9	8.8	14.5	16.4	997,968.0	0.58	1.00
06/08/2022 05:00	1	1.6	8.2	14.5	20.9	1,014,657.9	0.00	1.00
06/08/2022 06:00	1	1.6	7.9	14.5	19.6	1,011,234.3	0.00	1.00
06/08/2022 07:00	1	1.7	7.6	14.3	12.2	767,915.1	0.00	1.00
06/08/2022 08:00	1	1.7	7.6	14.4	12.9	757,186.3	0.00	1.00
06/08/2022 09:00	1	1.6	8.8	14.7	15.1	673,668.4	0.00	1.00
06/08/2022 10:00	1	1.6	8.8	14.7	14.8	663,950.0	0.00	1.00
06/08/2022 11:00	1	1.6	8.7	14.8	14.3	676,405.8	0.00	1.00
06/08/2022 12:00	1	1.5	8.1	14.7	13.2	701,056.9	0.00	1.00
06/08/2022 13:00	0	1.6	7.0	14.4	12.6	985,142.8	0.00	1.00
06/08/2022 14:00	1	1.7	7.6	14.1	16.3	939,264.0	0.00	1.00
06/08/2022 15:00	0	1.4	6.5	14.5	11.1	949,396.2	0.00	1.00
06/08/2022 16:00	1	1.6	6.7	14.5	12.6	959,025.0	0.00	1.00
06/08/2022 17:00	2	2.0	9.7	13.3	23.0	999,139.2	0.00	1.00
06/08/2022 18:00	3	2.3	12.9	11.8	36.1	999,228.3	0.00	1.00
06/08/2022 19:00	2	2.1	11.7	12.5	29.3	992,506.6	0.00	1.00
06/08/2022 20:00	1	1.9	9.2	13.5	20.9	993,387.9	0.00	1.00
06/08/2022 21:00	1	1.8	8.2	13.9	18.7	984,224.9	0.00	1.00
06/08/2022 22:00	1	1.7	8.2	14.1	18.7	1,000,284.0	0.00	1.00
06/08/2022 23:00	1	1.8	8.6	13.9	20.0	1,001,440.5	0.00	1.00
Average/Sum#:	1	2.8	9.2	14.3	17.1	897,484.8	0.85 #	20.27 #
Minimum:	0	1.4	6.5	11.8	0.0	663,950.0	0.00	0.00
Maximum:	3	21.3	22.4	18.0	36.1	1,014,657.9	0.58	1.00
%SI	16.67	12.50	12.50	12.50	12.50	12.50	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
06/09/2022 00:00	1	1.8	8.5	13.9	20.4	997,723.5	0.00	1.00
06/09/2022 01:00	1	1.8	8.3	14.0	20.1	999,282.9	0.00	1.00
06/09/2022 02:00	2	1.7	9.0	14.4	18.5	856,838.3	0.00	1.00
06/09/2022 03:00	1	1.6	7.6	14.3	15.8	994,492.6	0.00	1.00
06/09/2022 04:00	1	1.7	7.5	14.3	19.4	991,795.2	0.00	1.00
06/09/2022 05:00	2	1.7	8.2	14.5	15.4	724,083.1	0.00	1.00
06/09/2022 06:00	1	1.6	8.3	14.5	13.4	691,131.4	0.00	1.00
06/09/2022 07:00	1	1.6	8.5	14.7	13.4	663,508.2	0.00	1.00
06/09/2022 08:00	1	1.6	8.3	14.7	12.8	665,275.2	0.00	1.00
06/09/2022 09:00	0	1.5	7.6	14.6	7.9	696,232.7	0.00	1.00
06/09/2022 10:00	1	1.6	6.9	14.5	12.8	958,383.1	0.00	1.00
06/09/2022 11:00	1	1.6	8.1	14.7	11.2	663,066.5	0.00	1.00
06/09/2022 12:00	1	1.6	9.4	14.9	14.9	652,302.5	0.00	1.00
06/09/2022 13:00	0	1.1	6.8	14.6	10.3	838,392.0	0.00	1.00
06/09/2022 14:00	1	1.6	7.8	14.0	13.8	919,102.1	0.00	1.00
06/09/2022 15:00	1	1.9	9.4	13.5	20.8	997,829.2	0.00	1.00
06/09/2022 16:00	1	1.6	7.2	14.3	12.2	856,927.7	0.00	1.00
06/09/2022 17:00	1	1.9	9.5	13.5	20.9	967,664.9	0.00	1.00
06/09/2022 18:00	1	1.9	9.5	13.4	21.2	989,637.4	0.00	1.00
06/09/2022 19:00	1	1.8	8.2	13.9	17.9	995,180.3	0.00	1.00
06/09/2022 20:00	2	2.0	10.0	13.2	22.8	994,700.1	0.00	1.00
06/09/2022 21:00	1	1.9	9.0	13.6	20.3	994,614.8	0.00	1.00
06/09/2022 22:00	1	1.6	6.7	14.4	13.3	963,021.4	0.00	1.00
06/09/2022 23:00	1	1.8	8.7	13.7	19.6	987,126.7	0.00	1.00
Average/Sum#:	1	1.7	8.3	14.2	16.2	877,429.7	0.00 #	24.00 #
Minimum:	0	1.1	6.7	13.2	7.9	652,302.5	0.00	1.00
Maximum:	2	2.0	10.0	14.9	22.8	999,282.9	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
06/10/2022 00:00	1	1.8	8.1	14.0	17.8	990,351.8	0.00	1.00
06/10/2022 01:00	1	1.8	8.1	14.0	18.3	988,764.1	0.00	1.00
06/10/2022 02:00	1	1.7	8.5	14.0	18.7	986,581.0	0.00	1.00
06/10/2022 03:00	1	1.7	8.2	14.1	19.3	997,867.3	0.00	1.00
06/10/2022 04:00	1	1.7	8.1	14.1	19.4	997,464.6	0.00	1.00
06/10/2022 05:00	1	1.8	8.9	13.7	20.9	994,354.3	0.00	1.00
06/10/2022 06:00	1	1.7	7.4	14.2	16.2	959,005.9	0.00	1.00
06/10/2022 07:00	1	1.6	6.7	14.5	15.0	991,334.9	0.00	1.00
06/10/2022 08:00	1	1.6	6.6	14.5	14.5	986,413.5	0.00	1.00
06/10/2022 09:00	1	1.6	6.6	14.5	14.6	982,134.1	0.00	1.00
06/10/2022 10:00	1	1.7	6.9	14.4	15.9	981,771.9	0.00	1.00
06/10/2022 11:00	1	1.8	8.4	13.8	18.2	991,193.2	0.00	1.00
06/10/2022 12:00	2	1.8	9.4	13.4	22.0	998,949.4	0.00	1.00
06/10/2022 13:00	2	2.1	11.2	12.8	25.7	998,665.4	0.00	1.00
06/10/2022 14:00	3	2.2	12.7	12.2	32.9	1,001,253.9	0.00	1.00
06/10/2022 15:00	3	2.2	12.4	12.3	31.9	996,813.6	0.00	1.00
06/10/2022 16:00	2	1.9	9.7	13.3	22.0	988,328.0	0.00	1.00
06/10/2022 17:00	3	2.3	12.7	12.1	33.4	997,345.6	0.00	1.00
06/10/2022 18:00	3	2.3	12.4	12.1	32.3	993,610.8	0.00	1.00
06/10/2022 19:00	2	2.1	11.6	12.6	27.9	994,895.1	0.00	1.00
06/10/2022 20:00	2	1.9	9.9	13.2	22.2	990,431.7	0.00	1.00
06/10/2022 21:00	2	2.0	10.4	13.1	24.0	994,237.2	0.00	1.00
06/10/2022 22:00	1	1.7	7.6	14.3	16.4	979,345.9	0.00	1.00
06/10/2022 23:00	0	1.6	7.2	14.5	9.9	763,882.0	0.00	1.00
Average/Sum#:	2	1.9	9.2	13.6	21.2	981,041.5	0.00 #	24.00 #
Minimum:	0	1.6	6.6	12.1	9.9	763,882.0	0.00	1.00
Maximum:	3	2.3	12.7	14.5	33.4	1,001,253.9	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
06/11/2022 00:00	1	1.6	7.0	14.3	14.6	959,219.5	0.00	1.00
06/11/2022 01:00	2	1.6	9.7	14.7	16.7	664,391.7	0.00	1.00
06/11/2022 02:00	1	1.5	10.7	14.8	17.3	635,323.1	0.00	1.00
06/11/2022 03:00	2	1.6	10.3	14.8	17.4	635,772.1	0.00	1.00
06/11/2022 04:00	2	1.6	11.4	14.8	20.6	625,669.8	0.00	1.00
06/11/2022 05:00	2	1.6	11.4	14.8	20.2	626,567.8	0.00	1.00
06/11/2022 06:00	2	1.5	11.2	14.8	19.0	627,914.8	0.00	1.00
06/11/2022 07:00	2	1.5	11.0	14.8	18.6	628,812.7	0.00	1.00
06/11/2022 08:00	1	1.5	9.8	14.9	13.3	650,933.1	0.00	1.00
06/11/2022 09:00	0	1.5	8.7	14.8	10.7	652,160.3	0.00	1.00
06/11/2022 10:00	0	1.2	6.5	14.5	8.2	818,445.0	0.00	1.00
06/11/2022 11:00	0	1.2	6.5	14.5	9.0	866,588.9	0.00	1.00
06/11/2022 12:00	0	1.7	7.4	14.2	13.0	992,321.7	0.00	1.00
06/11/2022 13:00	2	2.0	10.6	13.0	23.7	1,000,373.2	0.00	1.00
06/11/2022 14:00	2	2.1	11.3	12.8	25.1	994,269.7	0.00	1.00
06/11/2022 15:00	2	2.1	10.9	12.8	24.3	981,758.9	0.00	1.00
06/11/2022 16:00	2	2.0	10.4	13.0	22.8	986,852.3	0.00	1.00
06/11/2022 17:00	2	2.2	11.4	12.4	27.8	984,213.4	0.00	1.00
06/11/2022 18:00	3	2.3	12.5	11.8	33.9	986,286.5	0.00	1.00
06/11/2022 19:00	3	2.3	12.4	11.9	33.5	988,724.4	0.00	1.00
06/11/2022 20:00	3	2.2	12.2	12.2	30.3	990,078.1	0.00	1.00
06/11/2022 21:00	3	2.2	12.1	12.2	30.8	988,818.8	0.00	1.00
06/11/2022 22:00	1	1.7	7.9	13.9	16.4	962,705.3	0.00	1.00
06/11/2022 23:00	1	1.5	6.6	14.3	11.5	880,788.9	0.00	1.00
Average/Sum#:	2	1.8	10.0	13.8	19.9	838,707.9	0.00 #	24.00 #
Minimum:	0	1.2	6.5	11.8	8.2	625,669.8	0.00	1.00
Maximum:	3	2.3	12.5	14.9	33.9	1,000,373.2	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
06/12/2022 00:00	2	1.9	9.1	13.4	21.4	988,724.4	0.00	1.00
06/12/2022 01:00	1	1.8	7.8	14.3	15.4	821,862.1	0.00	1.00
06/12/2022 02:00	1	1.5	7.0	14.5	14.1	970,793.5	0.00	1.00
06/12/2022 03:00	1	1.6	7.0	14.5	17.0	989,623.1	0.00	1.00
06/12/2022 04:00	1	1.6	6.9	14.5	16.4	990,265.0	0.00	1.00
06/12/2022 05:00	2	1.3	7.3	14.5	16.9	796,833.8	0.00	1.00
06/12/2022 06:00	0	1.6	8.1	14.6	9.3	650,150.5	0.00	1.00
06/12/2022 07:00	1	1.6	7.9	14.6	13.0	654,715.3	0.00	1.00
06/12/2022 08:00	1	1.6	7.9	14.6	12.7	653,628.4	0.00	1.00
06/12/2022 09:00	0	1.5	7.8	14.6	9.0	654,063.2	0.00	1.00
06/12/2022 10:00	0	1.6	7.7	14.6	7.3	655,584.8	0.00	1.00
06/12/2022 11:00	0	1.4	7.0	14.5	8.0	774,152.7	0.00	1.00
06/12/2022 12:00	1	1.6	6.7	14.3	11.4	884,731.1	0.00	1.00
06/12/2022 13:00	1	1.6	6.8	14.3	12.9	968,556.5	0.00	1.00
06/12/2022 14:00	1	1.7	7.1	14.2	14.7	979,240.6	0.00	1.00
06/12/2022 15:00	1	1.8	7.6	14.1	16.8	992,228.5	0.00	1.00
06/12/2022 16:00	1	1.8	8.2	13.9	17.7	991,854.5	0.00	1.00
06/12/2022 17:00	1	1.8	8.3	13.9	18.3	999,679.8	0.00	1.00
06/12/2022 18:00	1	1.8	8.4	13.8	19.1	994,279.3	0.00	1.00
06/12/2022 19:00	1	1.7	7.9	14.1	18.5	995,450.7	0.00	1.00
06/12/2022 20:00	1	1.7	8.1	14.1	19.4	999,277.0	0.00	1.00
06/12/2022 21:00	1	1.7	7.8	14.2	19.3	999,271.0	0.00	1.00
06/12/2022 22:00	1	1.7	7.7	14.2	19.5	997,227.1	0.00	1.00
06/12/2022 23:00	2	1.7	8.6	14.5	19.3	809,030.2	0.00	1.00
Average/Sum#:	1	1.7	7.7	14.3	15.3	883,801.0	0.00 #	24.00 #
Minimum:	0	1.3	6.7	13.4	7.3	650,150.5	0.00	1.00
Maximum:	2	1.9	9.1	14.6	21.4	999,679.8	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
06/13/2022 00:00	0	1.4	7.3	14.5	11.9	863,165.3	0.00	1.00
06/13/2022 01:00	1	1.6	7.1	14.5	16.7	928,640.9	0.00	1.00
06/13/2022 02:00	2	1.9	9.9	14.6	18.1	669,496.4	0.00	1.00
06/13/2022 03:00	2	1.6	9.9	14.6	18.8	652,106.8	0.00	1.00
06/13/2022 04:00	2	1.6	9.9	14.6	18.7	651,454.7	0.00	1.00
06/13/2022 05:00	2	1.6	9.9	14.6	18.1	652,759.0	0.00	1.00
06/13/2022 06:00	2	1.6	10.0	14.7	18.0	660,416.0	0.00	1.00
06/13/2022 07:00	2	1.6	9.8	14.7	17.2	662,624.7	0.00	1.00
06/13/2022 08:00	2	1.6	9.6	14.7	16.5	661,741.2	0.00	1.00
06/13/2022 09:00	1	1.6	9.3	14.7	15.9	662,183.0	0.00	1.00
06/13/2022 10:00	2	1.6	9.5	14.7	16.6	660,416.0	0.00	1.00
06/13/2022 11:00	1	1.6	9.2	14.7	16.1	665,275.2	0.00	1.00
06/13/2022 12:00	1	1.6	9.2	14.7	16.1	666,821.3	0.00	1.00
06/13/2022 13:00	1	1.6	9.3	14.8	15.7	676,630.3	0.00	1.00
06/13/2022 14:00	1	1.6	9.2	14.8	15.2	677,752.8	0.00	1.00
06/13/2022 15:00	1	1.6	9.2	14.8	15.2	674,609.9	0.00	1.00
06/13/2022 16:00	1	1.5	8.6	14.7	13.5	736,617.8	0.00	1.00
06/13/2022 17:00	1	1.5	8.2	14.6	13.9	786,223.5	0.00	1.00
06/13/2022 18:00	1	1.8	8.6	14.4	16.9	807,539.0	0.00	1.00
06/13/2022 19:00	1	1.5	8.6	14.5	16.9	898,042.8	0.00	1.00
06/13/2022 20:00	1	1.7	7.7	14.3	18.2	997,189.9	0.00	1.00
06/13/2022 21:00	2	1.5	10.4	14.6	21.9	727,751.2	0.00	1.00
06/13/2022 22:00	1	1.6	9.6	14.6	13.7	652,324.2	0.00	1.00
06/13/2022 23:00	2	1.6	9.6	14.7	16.9	663,066.5	0.00	1.00
Average/Sum#:	1	1.6	9.2	14.6	16.5	723,118.7	0.00 #	24.00 #
Minimum:	0	1.4	7.1	14.3	11.9	651,454.7	0.00	1.00
Maximum:	2	1.9	10.4	14.8	21.9	997,189.9	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
06/14/2022 00:00	2	1.6	9.8	14.7	17.6	661,741.2	0.00	1.00
06/14/2022 01:00	2	1.6	9.9	14.6	18.1	650,367.9	0.00	1.00
06/14/2022 02:00	2	1.6	10.5	14.6	18.6	651,020.0	0.00	1.00
06/14/2022 03:00	2	1.6	10.6	14.6	19.9	651,237.4	0.00	1.00
06/14/2022 04:00	2	1.6	10.6	14.6	19.9	651,889.5	0.00	1.00
06/14/2022 05:00	2	1.5	9.0	14.5	18.6	758,104.8	0.00	1.00
06/14/2022 06:00	2	1.3	10.0	14.7	18.6	663,066.5	0.00	1.00
06/14/2022 07:00	2	1.4	9.8	14.7	18.1	663,950.0	0.00	1.00
06/14/2022 08:00	2	1.4	9.5	14.7	17.1	661,078.6	0.00	1.00
06/14/2022 09:00	1	1.4	9.3	14.7	17.0	660,857.7	0.00	1.00
06/14/2022 10:00	1	1.3	9.1	14.7	16.1	662,845.6	0.00	1.00
06/14/2022 11:00	1	1.3	8.9	14.7	15.7	666,821.3	0.00	1.00
06/14/2022 12:00	1	1.4	8.8	14.8	15.4	678,875.3	0.00	1.00
06/14/2022 13:00	0	1.5	8.9	14.8	12.3	680,671.3	0.00	1.00
06/14/2022 14:00	1	1.6	8.8	14.8	12.4	680,446.8	0.00	1.00
06/14/2022 15:00	1	1.5	8.9	14.8	14.8	679,548.8	0.00	1.00
06/14/2022 16:00	1	1.6	8.9	14.8	14.2	679,773.3	0.00	1.00
06/14/2022 17:00	1	1.5	7.9	14.7	13.8	829,606.1	0.00	1.00
06/14/2022 18:00	2	1.7	9.5	14.7	18.7	751,858.2	0.00	1.00
06/14/2022 19:00	1	1.4	7.6	14.3	14.1	963,576.8	0.00	1.00
06/14/2022 20:00	1	1.7	8.3	14.1	18.4	974,103.8	0.00	1.00
06/14/2022 21:00	1	1.7	7.4	14.5	15.5	878,357.4	0.00	1.00
06/14/2022 22:00	1	1.6	7.5	14.4	16.9	969,552.5	0.00	1.00
06/14/2022 23:00	1	1.7	8.4	14.1	20.4	1,006,526.9	0.00	1.00
Average/Sum#:	1	1.5	9.1	14.6	16.8	740,661.6	0.00 #	24.00 #
Minimum:	0	1.3	7.4	14.1	12.3	650,367.9	0.00	1.00
Maximum:	2	1.7	10.6	14.8	20.4	1,006,526.9	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
06/15/2022 00:00	1	1.7	8.6	14.1	20.9	1,009,144.9	0.00	1.00
06/15/2022 01:00	1	1.7	8.3	14.2	20.9	1,008,877.4	0.00	1.00
06/15/2022 02:00	1	1.7	7.7	14.4	16.9	939,635.8	0.00	1.00
06/15/2022 03:00	2	1.8	8.6	14.0	22.4	995,908.9	0.00	1.00
06/15/2022 04:00	2	2.0	10.9	13.3	28.0	1,032,473.9	0.00	1.00
06/15/2022 05:00	1	1.7	8.1	14.2	18.2	908,316.7	0.00	1.00
06/15/2022 06:00	2	1.8	10.1	14.6	20.2	729,272.8	0.00	1.00
06/15/2022 07:00	2	1.5	9.6	14.6	17.3	767,747.1	0.00	1.00
06/15/2022 08:00	2	1.6	12.4	14.9	20.9	638,151.8	0.00	1.00
06/15/2022 09:00	2	1.5	11.8	14.9	20.7	638,608.2	0.00	1.00
06/15/2022 10:00	1	1.5	10.8	14.9	15.6	645,227.1	0.00	1.00
06/15/2022 11:00	1	1.5	9.8	14.8	15.0	695,712.5	0.00	1.00
06/15/2022 12:00	1	1.7	6.5	14.6	10.0	940,120.7	0.00	1.00
06/15/2022 13:00	1	1.7	6.7	14.6	13.4	995,767.2	0.00	1.00
06/15/2022 14:00	1	1.8	8.5	14.0	18.6	988,764.1	0.00	1.00
06/15/2022 15:00	1	1.9	9.8	13.4	20.3	1,003,331.6	0.00	1.00
06/15/2022 16:00	2	1.9	9.0	13.7	20.4	1,008,619.1	0.00	1.00
06/15/2022 17:00	1	1.8	9.0	13.7	19.9	1,003,293.6	0.00	1.00
06/15/2022 18:00	1	1.8	8.5	14.0	18.8	1,009,206.2	0.00	1.00
06/15/2022 19:00	1	1.7	8.1	14.1	18.3	998,270.1	0.00	1.00
06/15/2022 20:00	1	1.7	7.9	14.2	18.5	1,005,607.2	0.00	1.00
06/15/2022 21:00	1	1.7	7.8	14.2	18.8	1,004,789.6	0.00	1.00
06/15/2022 22:00	1	1.7	7.8	14.2	19.3	1,000,906.2	0.00	1.00
06/15/2022 23:00	1	1.7	7.9	14.2	19.7	997,227.1	0.00	1.00
Average/Sum#:	1	1.7	8.9	14.2	18.9	915,207.5	0.00 #	24.00 #
Minimum:	1	1.5	6.5	13.3	10.0	638,151.8	0.00	1.00
Maximum:	2	2.0	12.4	14.9	28.0	1,032,473.9	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
06/16/2022 00:00	1	1.7	7.9	14.2	19.7	995,387.6	0.00	1.00
06/16/2022 01:00	1	1.7	7.9	14.2	20.0	994,978.8	0.00	1.00
06/16/2022 02:00	1	1.7	8.3	14.3	20.3	1,008,186.8	0.00	1.00
06/16/2022 03:00	1	1.7	8.0	14.3	20.8	1,008,601.8	0.00	1.00
06/16/2022 04:00	1	1.7	7.9	14.3	20.6	1,009,016.8	0.00	1.00
06/16/2022 05:00	3	1.7	9.4	14.5	23.3	830,855.5	0.00	1.00
06/16/2022 06:00	2	1.5	13.2	14.8	23.4	633,078.2	0.00	1.00
06/16/2022 07:00	2	1.6	12.3	14.8	22.0	635,772.1	0.00	1.00
06/16/2022 08:00	2	1.5	11.9	14.8	20.8	633,976.1	0.00	1.00
06/16/2022 09:00	2	1.5	11.9	14.9	21.1	639,749.4	0.00	1.00
06/16/2022 10:00	2	1.5	11.6	14.9	20.4	638,380.0	0.00	1.00
06/16/2022 11:00	1	1.5	9.9	14.8	15.4	721,529.5	0.00	1.00
06/16/2022 12:00	1	1.8	8.0	14.1	14.8	1,014,381.0	0.00	1.00
06/16/2022 13:00	2	1.8	9.5	13.5	23.7	1,021,516.6	0.00	1.00
06/16/2022 14:00	1	1.5	8.1	14.1	17.0	1,006,929.7	0.00	1.00
06/16/2022 15:00	1	1.8	8.2	14.1	19.3	1,008,540.8	0.00	1.00
06/16/2022 16:00	1	1.6	8.2	14.1	18.2	1,005,922.8	0.00	1.00
06/16/2022 17:00	1	1.6	7.1	14.4	13.9	952,487.3	0.00	1.00
06/16/2022 18:00	1	1.7	7.9	14.2	18.9	1,012,352.1	0.00	1.00
06/16/2022 19:00	1	1.7	7.6	14.3	18.7	1,000,094.8	0.00	1.00
06/16/2022 20:00	1	1.7	7.4	14.4	18.4	995,255.5	0.00	1.00
06/16/2022 21:00	1	1.7	7.8	14.3	20.0	1,011,921.6	0.00	1.00
06/16/2022 22:00	1	1.7	7.8	14.3	20.3	1,010,054.2	0.00	1.00
06/16/2022 23:00	1	1.7	7.9	14.3	20.6	1,009,639.3	0.00	1.00
Average/Sum#:	1	1.7	9.0	14.4	19.7	908,275.3	0.00 #	24.00 #
Minimum:	1	1.5	7.1	13.5	13.9	633,078.2	0.00	1.00
Maximum:	3	1.8	13.2	14.9	23.7	1,021,516.6	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
06/17/2022 00:00	1	1.7	7.9	14.3	20.8	1,010,261.7	0.00	1.00
06/17/2022 01:00	2	1.7	7.9	14.3	21.2	1,011,091.7	0.00	1.00
06/17/2022 02:00	1	1.7	8.4	14.3	21.5	1,012,129.1	0.00	1.00
06/17/2022 03:00	2	1.7	8.1	14.3	22.0	1,012,544.1	0.00	1.00
06/17/2022 04:00	2	1.8	8.9	14.0	24.6	1,023,694.3	0.00	1.00
06/17/2022 05:00	1	1.7	8.0	14.2	20.0	982,715.3	0.00	1.00
06/17/2022 06:00	4	1.4	10.6	14.6	30.5	731,011.8	0.00	1.00
06/17/2022 07:00	0	1.3	10.3	14.6	9.9	675,365.3	0.00	1.00
06/17/2022 08:00	3	1.4	12.9	14.8	25.3	638,017.1	0.00	1.00
06/17/2022 09:00	2	1.6	10.5	14.7	17.9	646,721.7	0.00	1.00
06/17/2022 10:00	1	1.6	9.7	14.7	13.3	655,777.6	0.00	1.00
06/17/2022 11:00	3	1.5	12.3	14.8	24.2	638,017.1	0.00	1.00
06/17/2022 12:00	2	1.5	12.5	14.9	24.1	644,770.6	0.00	1.00
06/17/2022 13:00	2	3.4	17.6	15.3	16.1	616,485.5	0.13	0.40
06/17/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/17/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/17/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/17/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/17/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/17/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/17/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/17/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/17/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/17/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	2	1.7	10.4	14.6	20.8	807,043.1	0.13 #	13.40 #
Minimum:	0	1.3	7.9	14.0	9.9	616,485.5	0.00	0.00
Maximum:	4	3.4	17.6	15.3	30.5	1,023,694.3	0.13	1.00
%SI	41.67	41.67	41.67	41.67	41.67	41.67	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
06/18/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/18/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/18/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/18/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/18/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/18/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/18/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/18/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/18/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/18/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/18/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/18/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/18/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/18/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/18/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/18/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/18/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/18/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/18/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/18/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/18/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/18/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/18/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/18/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
06/19/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/19/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/19/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/19/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/19/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/19/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/19/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/19/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/19/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/19/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/19/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/19/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/19/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/19/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/19/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/19/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/19/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/19/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/19/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/19/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/19/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/19/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/19/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/19/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
06/20/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/20/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/20/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/20/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/20/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/20/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/20/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/20/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/20/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/20/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/20/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/20/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/20/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/20/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/20/2022 14:00	0	11.5	15.6	16.0	0.2	726,074.4	0.75	0.75
06/20/2022 15:00	2	2.1	9.9	13.9	20.2	868,215.1	0.32	1.00
06/20/2022 16:00	3	2.1	14.8	12.5	36.5	960,227.3	0.00	1.00
06/20/2022 17:00	1	2.0	10.5	13.6	20.4	945,653.2	0.00	1.00
06/20/2022 18:00	2	2.1	10.6	13.5	21.7	941,016.6	0.00	1.00
06/20/2022 19:00	1	2.0	9.6	13.9	19.3	972,878.2	0.00	1.00
06/20/2022 20:00	1	2.0	9.1	14.0	18.9	977,054.5	0.00	1.00
06/20/2022 21:00	1	2.0	9.0	14.0	18.7	978,443.8	0.00	1.00
06/20/2022 22:00	1	1.8	7.9	14.5	13.9	850,540.9	0.00	1.00
06/20/2022 23:00	1	1.7	8.6	14.6	11.9	706,449.1	0.00	1.00
Average/Sum#:	1	2.9	10.6	14.1	18.2	892,655.3	1.07 #	9.75 #
Minimum:	1	1.7	7.9	12.5	0.2	706,449.1	0.00	0.00
Maximum:	3	11.5	15.6	16.0	36.5	978,443.8	0.75	1.00
%SI	62.50	58.33	58.33	58.33	58.33	58.33	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
06/21/2022 00:00	1	1.8	9.5	14.7	14.9	655,556.7	0.00	1.00
06/21/2022 01:00	1	1.8	9.9	14.7	16.3	652,906.2	0.00	1.00
06/21/2022 02:00	1	1.9	10.3	14.7	15.3	655,335.8	0.00	1.00
06/21/2022 03:00	1	1.9	9.9	14.7	15.9	658,869.8	0.00	1.00
06/21/2022 04:00	2	1.7	9.9	14.6	16.9	652,324.2	0.00	1.00
06/21/2022 05:00	1	1.6	9.1	14.6	15.0	705,144.9	0.00	1.00
06/21/2022 06:00	1	1.7	9.4	14.7	15.1	664,170.8	0.00	1.00
06/21/2022 07:00	1	1.7	9.0	14.7	14.1	664,612.6	0.00	1.00
06/21/2022 08:00	1	1.7	8.7	14.7	12.9	661,299.5	0.00	1.00
06/21/2022 09:00	1	1.7	8.7	14.8	13.2	670,344.5	0.00	1.00
06/21/2022 10:00	1	1.7	8.7	14.8	13.0	670,569.0	0.00	1.00
06/21/2022 11:00	1	1.7	8.6	14.8	12.2	678,426.3	0.00	1.00
06/21/2022 12:00	0	1.6	8.5	14.8	11.0	680,222.3	0.00	1.00
06/21/2022 13:00	1	1.6	8.6	14.8	12.2	681,120.3	0.00	1.00
06/21/2022 14:00	1	1.6	8.2	14.7	11.1	682,724.3	0.00	1.00
06/21/2022 15:00	0	1.5	8.0	14.7	10.5	706,578.8	0.00	1.00
06/21/2022 16:00	1	1.7	8.6	14.7	12.8	670,576.2	0.00	1.00
06/21/2022 17:00	1	1.5	8.2	14.7	12.0	699,731.7	0.00	1.00
06/21/2022 18:00	0	1.6	7.9	14.7	10.4	764,006.3	0.00	1.00
06/21/2022 19:00	1	1.8	7.4	14.3	14.0	937,225.7	0.00	1.00
06/21/2022 20:00	1	2.0	9.1	13.6	18.6	987,111.1	0.00	1.00
06/21/2022 21:00	1	2.0	9.8	13.4	21.0	992,376.2	0.00	1.00
06/21/2022 22:00	1	1.9	8.5	14.0	17.8	993,725.8	0.00	1.00
06/21/2022 23:00	1	1.9	8.4	14.0	18.0	989,359.5	0.00	1.00
Average/Sum#:	1	1.7	8.9	14.5	14.3	740,596.6	0.00 #	24.00 #
Minimum:	0	1.5	7.4	13.4	10.4	652,324.2	0.00	1.00
Maximum:	2	2.0	10.3	14.8	21.0	993,725.8	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
06/22/2022 00:00	1	1.8	8.2	14.1	17.9	999,277.0	0.00	1.00
06/22/2022 01:00	1	1.9	8.1	14.1	18.1	998,672.9	0.00	1.00
06/22/2022 02:00	1	1.7	7.7	14.4	15.9	945,956.2	0.00	1.00
06/22/2022 03:00	1	1.8	8.3	14.2	19.6	1,000,906.2	0.00	1.00
06/22/2022 04:00	1	1.8	7.7	14.4	17.6	992,095.3	0.00	1.00
06/22/2022 05:00	2	1.7	10.1	14.6	21.1	788,614.5	0.00	1.00
06/22/2022 06:00	2	1.6	12.7	14.8	21.0	624,547.3	0.00	1.00
06/22/2022 07:00	2	1.6	11.9	14.9	19.0	635,412.9	0.00	1.00
06/22/2022 08:00	1	1.6	11.4	14.9	18.0	635,869.4	0.00	1.00
06/22/2022 09:00	1	1.6	10.6	15.0	16.1	645,950.5	0.00	1.00
06/22/2022 10:00	1	1.6	9.6	15.0	13.7	646,646.8	0.00	1.00
06/22/2022 11:00	1	1.6	9.5	15.0	14.2	650,592.6	0.00	1.00
06/22/2022 12:00	1	1.6	9.0	15.0	12.9	651,753.2	0.00	1.00
06/22/2022 13:00	1	1.6	8.2	14.9	11.3	683,342.8	0.00	1.00
06/22/2022 14:00	0	1.6	7.6	14.9	10.0	713,241.9	0.00	1.00
06/22/2022 15:00	1	1.6	7.7	14.9	10.8	671,246.2	0.00	1.00
06/22/2022 16:00	1	1.6	8.7	15.0	12.4	648,271.6	0.00	1.00
06/22/2022 17:00	1	1.6	9.1	15.0	13.8	646,646.8	0.00	1.00
06/22/2022 18:00	1	1.6	9.5	14.9	14.8	635,412.9	0.00	1.00
06/22/2022 19:00	1	1.6	9.7	14.9	14.8	637,923.5	0.00	1.00
06/22/2022 20:00	0	1.6	6.7	14.6	6.8	819,480.9	0.00	1.00
06/22/2022 21:00	0	1.7	7.0	14.4	10.9	926,573.6	0.00	1.00
06/22/2022 22:00	1	1.7	6.2	14.6	11.5	975,551.8	0.00	1.00
06/22/2022 23:00	1	1.8	8.2	14.1	18.0	993,638.2	0.00	1.00
Average/Sum#:	1	1.7	8.9	14.7	15.0	773,651.0	0.00 #	24.00 #
Minimum:	0	1.6	6.2	14.1	6.8	624,547.3	0.00	1.00
Maximum:	2	1.9	12.7	15.0	21.1	1,000,906.2	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
06/23/2022 00:00	1	1.8	8.7	13.9	19.3	998,897.3	0.00	1.00
06/23/2022 01:00	1	1.7	8.0	14.3	16.2	898,010.4	0.00	1.00
06/23/2022 02:00	1	1.4	9.7	14.6	12.6	714,274.4	0.00	1.00
06/23/2022 03:00	1	1.5	8.7	14.7	11.8	671,238.8	0.00	1.00
06/23/2022 04:00	1	1.6	7.7	14.5	12.0	804,108.9	0.00	1.00
06/23/2022 05:00	1	1.7	7.7	14.5	12.7	892,693.5	0.00	1.00
06/23/2022 06:00	1	1.9	7.8	14.3	16.0	990,135.3	0.00	1.00
06/23/2022 07:00	1	1.9	7.6	14.3	15.9	987,230.5	0.00	1.00
06/23/2022 08:00	1	1.9	7.4	14.3	15.2	982,043.3	0.00	1.00
06/23/2022 09:00	1	1.9	7.4	14.3	15.4	979,345.9	0.00	1.00
06/23/2022 10:00	1	1.9	7.2	14.4	15.1	964,285.4	0.00	1.00
06/23/2022 11:00	1	1.8	8.0	14.7	10.5	665,496.1	0.00	1.00
06/23/2022 12:00	0	1.7	7.9	14.9	8.3	669,648.5	0.00	1.00
06/23/2022 13:00	0	1.8	7.9	14.9	9.5	668,735.6	0.00	1.00
06/23/2022 14:00	0	1.7	7.8	14.9	8.9	667,594.4	0.00	1.00
06/23/2022 15:00	0	1.8	7.3	14.8	9.2	762,612.2	0.00	1.00
06/23/2022 16:00	1	1.8	8.3	14.7	12.5	735,513.4	0.00	1.00
06/23/2022 17:00	1	1.9	7.7	14.1	12.8	900,799.3	0.00	1.00
06/23/2022 18:00	2	2.3	10.7	13.0	23.4	1,003,840.1	0.00	1.00
06/23/2022 19:00	2	2.3	12.1	12.4	29.3	997,585.4	0.00	1.00
06/23/2022 20:00	2	2.1	11.4	12.6	28.5	994,235.1	0.00	1.00
06/23/2022 21:00	1	1.8	8.9	13.6	19.2	985,047.6	0.00	1.00
06/23/2022 22:00	1	1.8	8.2	14.0	17.3	988,168.7	0.00	1.00
06/23/2022 23:00	1	1.8	8.2	14.0	17.8	986,184.0	0.00	1.00
Average/Sum#:	1	1.8	8.4	14.2	15.4	871,155.2	0.00 #	24.00 #
Minimum:	0	1.4	7.2	12.4	8.3	665,496.1	0.00	1.00
Maximum:	2	2.3	12.1	14.9	29.3	1,003,840.1	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
06/24/2022 00:00	1	1.7	8.2	14.1	17.9	1,000,284.0	0.00	1.00
06/24/2022 01:00	1	1.7	8.1	14.1	17.9	997,665.9	0.00	1.00
06/24/2022 02:00	1	1.7	8.1	14.2	17.3	976,174.8	0.00	1.00
06/24/2022 03:00	1	1.6	8.3	14.4	12.5	738,225.1	0.00	1.00
06/24/2022 04:00	1	1.7	8.1	14.1	18.7	994,645.2	0.00	1.00
06/24/2022 05:00	2	1.6	9.0	14.5	19.0	812,239.8	0.00	1.00
06/24/2022 06:00	2	1.5	10.9	14.8	18.0	634,200.6	0.00	1.00
06/24/2022 07:00	2	1.5	10.9	14.9	18.2	641,803.6	0.00	1.00
06/24/2022 08:00	1	1.5	10.5	14.9	17.3	640,434.1	0.00	1.00
06/24/2022 09:00	1	1.5	10.1	14.9	16.5	642,488.3	0.00	1.00
06/24/2022 10:00	0	1.4	7.4	14.7	8.6	728,445.4	0.00	1.00
06/24/2022 11:00	0	1.6	6.6	14.5	10.6	883,278.7	0.00	1.00
06/24/2022 12:00	1	1.6	6.6	14.5	13.5	981,920.1	0.00	1.00
06/24/2022 13:00	1	1.7	6.7	14.4	14.4	948,484.4	0.00	1.00
06/24/2022 14:00	2	2.0	10.5	13.1	24.5	1,000,030.9	0.00	1.00
06/24/2022 15:00	2	2.0	10.4	13.1	24.6	991,603.7	0.00	1.00
06/24/2022 16:00	2	2.0	10.6	13.1	25.2	997,924.1	0.00	1.00
06/24/2022 17:00	3	2.2	12.8	12.2	33.7	1,003,929.7	0.00	1.00
06/24/2022 18:00	2	2.0	11.4	12.8	27.7	1,000,017.9	0.00	1.00
06/24/2022 19:00	2	2.1	11.7	12.7	28.8	997,675.8	0.00	1.00
06/24/2022 20:00	1	1.8	8.9	13.6	19.5	985,610.4	0.00	1.00
06/24/2022 21:00	1	1.8	8.3	13.9	17.7	988,724.4	0.00	1.00
06/24/2022 22:00	1	1.8	8.9	13.7	19.7	996,446.4	0.00	1.00
06/24/2022 23:00	1	1.7	8.1	14.0	17.3	988,168.7	0.00	1.00
Average/Sum#:	1	1.7	9.2	14.0	19.1	898,767.6	0.00 #	24.00 #
Minimum:	0	1.4	6.6	12.2	8.6	634,200.6	0.00	1.00
Maximum:	3	2.2	12.8	14.9	33.7	1,003,929.7	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
06/25/2022 00:00	1	1.7	7.1	14.4	15.5	964,917.5	0.00	1.00
06/25/2022 01:00	2	2.0	10.6	13.1	25.9	1,011,618.4	0.00	1.00
06/25/2022 02:00	1	1.5	7.9	14.3	18.0	971,253.9	0.00	1.00
06/25/2022 03:00	1	1.6	7.3	14.5	17.1	997,326.1	0.00	1.00
06/25/2022 04:00	1	1.6	7.0	14.5	16.1	973,147.2	0.00	1.00
06/25/2022 05:00	2	1.7	8.9	14.6	19.1	826,219.4	0.00	1.00
06/25/2022 06:00	2	1.6	11.6	14.9	19.1	642,260.0	0.00	1.00
06/25/2022 07:00	2	1.6	12.0	14.9	20.6	634,728.2	0.00	1.00
06/25/2022 08:00	2	1.6	11.6	14.9	19.5	634,271.7	0.00	1.00
06/25/2022 09:00	2	1.6	11.1	14.9	18.7	635,412.9	0.00	1.00
06/25/2022 10:00	1	1.6	10.5	14.9	17.0	635,869.4	0.00	1.00
06/25/2022 11:00	1	1.6	10.0	14.9	15.9	639,977.7	0.00	1.00
06/25/2022 12:00	0	1.6	8.3	14.9	9.1	663,486.1	0.00	1.00
06/25/2022 13:00	1	1.6	9.0	15.0	13.8	657,555.8	0.00	1.00
06/25/2022 14:00	0	1.6	8.1	14.9	10.1	663,029.6	0.00	1.00
06/25/2022 15:00	1	1.6	8.3	14.9	11.4	654,813.1	0.00	1.00
06/25/2022 16:00	0	1.6	7.6	14.8	9.6	684,712.2	0.00	1.00
06/25/2022 17:00	1	1.9	8.9	13.8	17.7	990,614.6	0.00	1.00
06/25/2022 18:00	2	2.1	10.5	13.2	23.1	1,005,015.2	0.00	1.00
06/25/2022 19:00	1	1.9	8.9	13.7	18.8	993,783.7	0.00	1.00
06/25/2022 20:00	1	1.9	8.8	13.8	18.9	1,003,730.2	0.00	1.00
06/25/2022 21:00	1	2.8	9.6	14.5	12.0	837,702.6	0.13	0.97
06/25/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/25/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	1	1.7	9.3	14.5	16.7	805,520.3	0.13 #	21.97 #
Minimum:	0	1.5	7.0	13.1	9.1	634,271.7	0.00	0.00
Maximum:	2	2.8	12.0	15.0	25.9	1,011,618.4	0.13	1.00
%SI	8.33	8.33	8.33	8.33	8.33	8.33	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
06/26/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/26/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/26/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/26/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/26/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/26/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/26/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/26/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/26/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/26/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/26/2022 10:00	0	10.0	14.3	15.6	6.9	679,027.8	0.92	0.92
06/26/2022 11:00	2	1.6	11.1	14.9	19.3	640,662.4	0.08	1.00
06/26/2022 12:00	2	1.6	9.8	15.0	15.9	651,985.3	0.00	1.00
06/26/2022 13:00	1	1.6	9.0	15.0	13.5	663,126.3	0.00	1.00
06/26/2022 14:00	1	1.6	8.9	15.0	14.0	656,395.3	0.00	1.00
06/26/2022 15:00	1	1.6	8.5	14.9	12.6	657,095.5	0.00	1.00
06/26/2022 16:00	1	1.7	8.2	14.2	14.5	822,472.2	0.00	1.00
06/26/2022 17:00	1	1.9	8.8	13.8	19.3	1,004,308.8	0.00	1.00
06/26/2022 18:00	2	2.3	12.4	12.5	29.9	1,011,417.7	0.00	1.00
06/26/2022 19:00	1	1.9	8.7	13.8	19.1	996,593.8	0.00	1.00
06/26/2022 20:00	1	1.9	8.2	14.1	17.6	1,003,506.1	0.00	1.00
06/26/2022 21:00	1	1.8	8.0	14.3	16.5	879,129.0	0.00	1.00
06/26/2022 22:00	1	1.6	8.7	14.7	11.9	682,503.4	0.00	1.00
06/26/2022 23:00	1	1.7	8.5	14.7	13.3	659,753.3	0.00	1.00
Average/Sum#:	1	2.3	9.5	14.5	16.0	786,284.1	1.00 #	13.92 #
Minimum:	1	1.6	8.0	12.5	6.9	640,662.4	0.00	0.00
Maximum:	2	10.0	14.3	15.6	29.9	1,011,417.7	0.92	1.00
%SI	45.83	41.67	41.67	41.67	41.67	41.67	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
06/27/2022 00:00	1	1.7	8.7	14.7	14.1	659,753.3	0.00	1.00
06/27/2022 01:00	1	1.7	8.8	14.7	14.3	661,962.1	0.00	1.00
06/27/2022 02:00	1	1.7	9.4	14.7	14.8	662,183.0	0.00	1.00
06/27/2022 03:00	1	1.7	9.3	14.7	15.4	661,962.1	0.00	1.00
06/27/2022 04:00	1	1.7	8.5	14.5	14.6	731,358.2	0.00	1.00
06/27/2022 05:00	1	1.7	9.3	14.7	15.5	662,845.6	0.00	1.00
06/27/2022 06:00	1	1.7	9.2	14.7	14.7	663,287.3	0.00	1.00
06/27/2022 07:00	1	1.7	8.8	14.7	14.1	664,612.6	0.00	1.00
06/27/2022 08:00	1	1.7	8.6	14.7	13.0	664,612.6	0.00	1.00
06/27/2022 09:00	1	1.7	8.2	14.7	12.6	665,717.0	0.00	1.00
06/27/2022 10:00	1	1.7	8.2	14.7	12.7	665,054.3	0.00	1.00
06/27/2022 11:00	1	1.7	8.1	14.8	12.3	676,405.8	0.00	1.00
06/27/2022 12:00	1	1.6	7.6	14.8	10.9	712,100.7	0.00	1.00
06/27/2022 13:00	1	1.7	8.4	14.7	15.2	773,283.0	0.00	1.00
06/27/2022 14:00	0	1.7	6.7	14.6	10.2	893,821.1	0.00	1.00
06/27/2022 15:00	1	1.9	8.6	14.0	18.0	1,005,435.4	0.00	1.00
06/27/2022 16:00	1	1.9	8.6	14.0	18.2	1,004,443.0	0.00	1.00
06/27/2022 17:00	1	2.0	9.3	13.6	20.4	997,241.1	0.00	1.00
06/27/2022 18:00	2	2.1	10.6	13.1	24.1	1,006,351.4	0.00	1.00
06/27/2022 19:00	1	1.9	8.5	13.7	18.1	982,562.0	0.00	1.00
06/27/2022 20:00	1	1.9	8.2	13.9	17.7	993,615.2	0.00	1.00
06/27/2022 21:00	1	1.9	8.1	13.9	16.3	956,249.5	0.00	1.00
06/27/2022 22:00	1	1.6	8.7	14.6	13.7	687,538.0	0.00	1.00
06/27/2022 23:00	1	1.6	8.7	14.7	13.9	665,054.3	0.00	1.00
Average/Sum#:	1	1.8	8.6	14.4	15.2	779,893.7	0.00 #	24.00 #
Minimum:	0	1.6	6.7	13.1	10.2	659,753.3	0.00	1.00
Maximum:	2	2.1	10.6	14.8	24.1	1,006,351.4	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
06/28/2022 00:00	1	1.7	9.0	14.7	14.1	651,360.1	0.00	1.00
06/28/2022 01:00	1	1.7	9.3	14.7	14.7	651,581.0	0.00	1.00
06/28/2022 02:00	1	1.8	10.0	14.7	15.4	650,255.7	0.00	1.00
06/28/2022 03:00	2	1.7	9.9	14.7	15.1	650,476.6	0.00	1.00
06/28/2022 04:00	1	1.7	7.3	14.6	12.3	904,689.6	0.00	1.00
06/28/2022 05:00	1	1.7	8.8	14.5	16.3	739,917.1	0.00	1.00
06/28/2022 06:00	1	1.7	9.3	14.7	14.5	659,974.2	0.00	1.00
06/28/2022 07:00	1	1.7	9.1	14.7	14.0	662,183.0	0.00	1.00
06/28/2022 08:00	1	1.7	8.7	14.7	13.3	663,508.2	0.00	1.00
06/28/2022 09:00	1	1.7	8.5	14.7	13.3	663,950.0	0.00	1.00
06/28/2022 10:00	1	1.7	8.4	14.8	13.1	673,487.4	0.00	1.00
06/28/2022 11:00	1	1.6	7.9	14.8	12.1	723,999.0	0.00	1.00
06/28/2022 12:00	1	1.6	8.3	14.8	12.8	674,160.9	0.00	1.00
06/28/2022 13:00	1	1.6	8.3	14.8	12.7	672,813.9	0.00	1.00
06/28/2022 14:00	1	1.6	8.5	14.8	13.0	674,609.9	0.00	1.00
06/28/2022 15:00	1	1.5	7.7	14.7	11.6	762,901.9	0.00	1.00
06/28/2022 16:00	1	1.7	9.2	14.8	15.4	677,752.8	0.00	1.00
06/28/2022 17:00	1	1.7	7.7	14.2	13.4	882,359.0	0.00	1.00
06/28/2022 18:00	1	1.9	8.2	14.0	16.9	999,084.4	0.00	1.00
06/28/2022 19:00	1	1.9	8.1	14.1	17.4	1,002,297.8	0.00	1.00
06/28/2022 20:00	1	1.8	7.5	14.3	14.0	905,895.0	0.00	1.00
06/28/2022 21:00	1	1.6	8.6	14.6	14.3	721,447.5	0.00	1.00
06/28/2022 22:00	1	1.7	9.0	14.7	14.3	656,882.0	0.00	1.00
06/28/2022 23:00	1	1.7	7.0	14.6	13.5	959,249.2	0.00	1.00
Average/Sum#:	1	1.7	8.5	14.6	14.1	745,201.5	0.00 #	24.00 #
Minimum:	1	1.5	7.0	14.0	11.6	650,255.7	0.00	1.00
Maximum:	2	1.9	10.0	14.8	17.4	1,002,297.8	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
06/29/2022 00:00	1	1.8	7.3	14.5	17.2	1,004,815.1	0.00	1.00
06/29/2022 01:00	1	1.7	6.7	14.5	15.0	987,269.4	0.00	1.00
06/29/2022 02:00	1	1.7	6.9	14.5	15.8	986,841.4	0.00	1.00
06/29/2022 03:00	1	1.7	6.8	14.5	15.9	985,343.6	0.00	1.00
06/29/2022 04:00	1	1.7	6.9	14.5	16.2	988,767.2	0.00	1.00
06/29/2022 05:00	1	1.7	7.3	14.5	16.6	923,933.5	0.00	1.00
06/29/2022 06:00	1	1.7	9.0	14.6	13.9	681,669.0	0.00	1.00
06/29/2022 07:00	1	1.7	9.0	14.7	14.5	665,496.1	0.00	1.00
06/29/2022 08:00	1	1.7	8.7	14.7	13.8	669,030.1	0.00	1.00
06/29/2022 09:00	1	1.7	8.3	14.6	12.4	669,061.6	0.00	1.00
06/29/2022 10:00	1	1.7	8.2	14.7	12.8	667,263.1	0.00	1.00
06/29/2022 11:00	1	1.6	7.5	14.7	11.5	768,865.5	0.00	1.00
06/29/2022 12:00	1	1.7	8.8	14.7	14.8	743,023.2	0.00	1.00
06/29/2022 13:00	0	1.7	7.1	14.5	11.2	909,169.4	0.00	1.00
06/29/2022 14:00	1	1.9	8.4	14.0	17.7	1,004,046.1	0.00	1.00
06/29/2022 15:00	1	1.9	8.3	14.0	17.7	1,000,870.6	0.00	1.00
06/29/2022 16:00	1	1.9	8.3	14.0	18.0	999,878.3	0.00	1.00
06/29/2022 17:00	1	1.9	8.2	14.0	17.8	1,000,275.2	0.00	1.00
06/29/2022 18:00	1	1.9	8.5	13.9	18.4	1,006,331.3	0.00	1.00
06/29/2022 19:00	1	1.9	8.8	13.7	19.7	1,002,152.4	0.00	1.00
06/29/2022 20:00	1	1.9	8.5	13.8	19.0	1,003,923.1	0.00	1.00
06/29/2022 21:00	1	1.9	8.1	14.0	18.4	1,000,076.7	0.00	1.00
06/29/2022 22:00	1	1.8	7.7	14.2	18.3	1,002,132.5	0.00	1.00
06/29/2022 23:00	2	2.1	10.2	13.2	24.6	1,010,172.8	0.00	1.00
Average/Sum#:	1	1.8	8.1	14.3	16.3	903,350.3	0.00 #	24.00 #
Minimum:	0	1.6	6.7	13.2	11.2	665,496.1	0.00	1.00
Maximum:	2	2.1	10.2	14.7	24.6	1,010,172.8	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:53 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT1 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT1 NOx, Ppm 1 Hour(s)	Unit CT1 NOx, _SCR, Ppm 1 Hour(s)	Unit CT1 O2, Dry, Pct 1 Hour(s)	Unit CT1 NH3Inj, LbPerHr 1 Hour(s)	Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT1 SUSD, Hr 1 Hour(s)	Unit CT1 OperatingTime, Hr 1 Hour(s)
06/30/2022 00:00	2	1.6	7.5	14.4	16.9	883,805.4	0.00	1.00
06/30/2022 01:00	1	1.5	6.8	14.5	16.8	999,037.9	0.00	1.00
06/30/2022 02:00	2	1.5	8.7	14.5	19.0	867,658.7	0.00	1.00
06/30/2022 03:00	1	1.5	6.9	14.5	16.3	973,147.2	0.00	1.00
06/30/2022 04:00	1	1.5	7.5	14.5	16.4	875,575.7	0.00	1.00
06/30/2022 05:00	2	1.6	8.0	14.5	18.3	848,615.2	0.00	1.00
06/30/2022 06:00	2	1.6	9.7	14.6	16.9	652,976.3	0.00	1.00
06/30/2022 07:00	1	1.6	9.5	14.6	15.9	654,063.2	0.00	1.00
06/30/2022 08:00	1	1.6	9.2	14.6	15.3	653,628.4	0.00	1.00
06/30/2022 09:00	1	1.6	8.8	14.7	14.5	665,496.1	0.00	1.00
06/30/2022 10:00	1	1.6	8.5	14.7	14.1	667,704.8	0.00	1.00
06/30/2022 11:00	1	1.6	8.3	14.7	13.5	672,343.2	0.00	1.00
06/30/2022 12:00	1	1.6	8.2	14.7	13.0	674,331.1	0.00	1.00
06/30/2022 13:00	1	1.5	7.5	14.7	11.7	775,270.9	0.00	1.00
06/30/2022 14:00	1	1.6	8.7	14.7	16.3	770,190.8	0.00	1.00
06/30/2022 15:00	0	1.7	7.4	14.3	12.6	927,473.8	0.00	1.00
06/30/2022 16:00	1	1.8	8.2	14.0	17.7	1,007,618.5	0.00	1.00
06/30/2022 17:00	1	1.8	8.4	13.9	18.5	1,013,960.9	0.00	1.00
06/30/2022 18:00	2	2.1	10.7	12.8	26.3	1,006,273.3	0.00	1.00
06/30/2022 19:00	3	2.3	12.4	12.0	34.5	1,010,912.2	0.00	1.00
06/30/2022 20:00	1	1.8	8.8	13.7	20.0	1,005,385.7	0.00	1.00
06/30/2022 21:00	1	1.7	7.6	14.2	17.7	1,006,833.5	0.00	1.00
06/30/2022 22:00	1	1.6	7.1	14.3	15.4	931,831.0	0.00	1.00
06/30/2022 23:00	1	1.5	7.9	14.5	15.4	847,545.3	0.00	1.00
Average/Sum#:	1	1.7	8.4	14.3	17.2	849,653.3	0.00 #	24.00 #
Minimum:	0	1.5	6.8	12.0	11.7	652,976.3	0.00	1.00
Maximum:	3	2.3	12.4	14.7	34.5	1,013,960.9	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
04/01/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/01/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/01/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/01/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/01/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/01/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/01/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/01/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/01/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/01/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/01/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/01/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/01/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/01/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/01/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/01/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/01/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/01/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/01/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/01/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/01/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/01/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/01/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/01/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
04/02/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/02/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/02/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/02/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/02/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/02/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/02/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/02/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/02/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/02/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/02/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/02/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/02/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/02/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/02/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/02/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/02/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/02/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/02/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/02/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/02/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/02/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/02/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/02/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
04/03/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/03/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/03/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/03/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/03/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/03/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/03/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/03/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/03/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/03/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/03/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/03/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/03/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/03/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/03/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/03/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/03/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/03/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/03/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/03/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/03/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/03/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/03/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/03/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
04/04/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/04/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/04/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/04/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/04/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/04/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/04/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/04/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/04/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/04/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/04/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/04/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/04/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/04/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/04/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/04/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/04/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/04/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/04/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/04/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/04/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/04/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/04/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/04/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
04/05/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/05/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/05/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/05/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/05/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/05/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/05/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/05/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/05/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/05/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/05/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/05/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/05/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/05/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/05/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/05/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/05/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/05/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/05/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/05/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/05/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/05/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/05/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/05/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
04/06/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/06/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/06/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/06/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/06/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/06/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/06/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/06/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/06/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/06/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/06/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/06/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/06/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/06/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/06/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/06/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/06/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/06/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/06/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/06/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/06/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/06/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/06/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/06/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
04/07/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/07/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/07/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/07/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/07/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/07/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/07/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/07/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/07/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/07/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/07/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/07/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/07/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/07/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/07/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/07/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/07/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/07/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/07/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/07/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/07/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/07/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/07/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/07/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
04/08/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/08/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/08/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/08/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/08/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/08/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/08/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/08/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/08/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/08/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/08/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/08/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/08/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/08/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/08/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/08/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/08/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/08/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/08/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/08/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/08/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/08/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/08/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/08/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
04/09/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/09/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/09/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/09/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/09/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/09/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/09/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/09/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/09/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/09/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/09/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/09/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/09/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/09/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/09/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/09/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/09/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/09/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/09/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/09/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/09/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/09/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/09/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/09/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
04/10/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/10/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/10/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/10/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/10/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/10/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/10/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/10/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/10/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/10/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/10/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/10/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/10/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/10/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/10/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/10/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/10/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/10/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/10/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/10/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/10/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/10/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/10/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/10/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
04/11/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/11/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/11/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/11/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/11/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/11/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/11/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/11/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/11/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/11/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/11/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/11/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/11/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/11/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/11/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/11/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/11/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/11/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/11/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/11/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/11/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/11/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/11/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/11/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
04/12/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/12/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/12/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/12/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/12/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/12/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/12/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/12/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/12/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/12/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/12/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/12/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/12/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/12/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/12/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/12/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/12/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/12/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/12/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/12/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/12/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/12/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/12/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/12/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
04/13/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/13/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/13/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/13/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/13/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/13/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/13/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/13/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/13/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/13/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/13/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/13/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/13/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/13/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/13/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/13/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/13/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/13/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/13/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/13/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/13/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/13/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/13/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/13/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
04/14/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/14/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/14/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/14/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/14/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/14/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/14/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/14/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/14/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/14/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/14/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/14/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/14/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/14/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/14/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/14/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/14/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/14/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/14/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/14/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/14/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/14/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/14/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/14/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
04/15/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/15/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/15/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/15/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/15/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/15/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/15/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/15/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/15/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/15/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/15/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/15/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/15/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/15/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/15/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/15/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/15/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/15/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/15/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/15/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/15/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/15/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/15/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/15/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
04/16/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/16/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/16/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/16/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/16/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/16/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/16/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/16/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/16/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/16/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/16/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/16/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/16/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/16/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/16/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/16/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/16/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/16/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/16/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/16/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/16/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/16/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/16/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/16/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
04/17/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/17/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/17/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/17/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/17/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/17/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/17/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/17/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/17/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/17/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/17/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/17/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/17/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/17/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/17/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/17/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/17/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/17/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/17/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/17/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/17/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/17/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/17/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/17/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
04/18/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/18/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/18/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/18/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/18/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/18/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/18/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/18/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/18/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/18/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/18/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/18/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/18/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/18/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/18/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/18/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/18/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/18/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/18/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/18/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/18/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/18/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/18/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/18/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
04/19/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/19/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/19/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/19/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/19/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/19/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/19/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/19/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/19/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/19/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/19/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/19/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/19/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/19/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/19/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/19/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/19/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/19/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/19/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/19/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/19/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/19/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/19/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/19/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
04/20/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/20/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/20/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/20/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/20/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/20/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/20/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/20/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/20/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/20/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/20/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/20/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/20/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/20/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/20/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/20/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/20/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/20/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/20/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/20/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/20/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/20/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/20/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/20/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
04/21/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/21/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/21/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/21/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/21/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/21/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/21/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/21/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/21/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/21/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/21/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/21/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/21/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/21/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/21/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/21/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/21/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/21/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/21/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/21/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/21/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/21/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/21/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/21/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
04/22/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/22/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/22/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/22/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/22/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/22/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/22/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/22/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/22/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/22/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/22/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/22/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/22/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/22/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/22/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/22/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/22/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/22/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/22/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/22/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/22/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/22/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/22/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/22/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
04/23/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/23/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/23/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/23/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/23/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/23/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/23/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/23/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/23/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/23/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/23/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/23/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/23/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/23/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/23/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/23/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/23/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/23/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/23/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/23/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/23/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/23/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/23/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/23/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
04/24/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/24/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/24/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/24/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/24/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/24/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/24/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/24/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/24/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/24/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/24/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/24/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/24/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/24/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/24/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/24/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/24/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/24/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/24/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/24/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/24/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/24/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/24/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/24/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
04/25/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/25/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/25/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/25/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/25/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/25/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/25/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/25/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/25/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/25/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/25/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/25/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/25/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/25/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/25/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/25/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/25/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/25/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/25/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/25/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/25/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/25/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/25/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/25/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
04/26/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/26/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/26/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/26/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/26/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/26/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/26/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/26/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/26/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/26/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/26/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/26/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/26/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/26/2022 13:00	0	18.0	21.2	18.7	0.0	690,936.8	0.35	0.35
04/26/2022 14:00	1	11.0	17.6	15.1	11.9	703,364.7	0.77	1.00
04/26/2022 15:00	0	1.6	10.1	14.5	16.9	806,462.6	0.00	1.00
04/26/2022 16:00	0	1.4	8.2	14.6	14.1	1,027,503.0	0.00	1.00
04/26/2022 17:00	0	1.6	8.7	14.5	16.1	1,045,897.9	0.00	1.00
04/26/2022 18:00	0	1.7	9.3	14.5	16.8	979,138.4	0.00	1.00
04/26/2022 19:00	0	1.6	8.8	14.5	17.5	1,048,251.6	0.00	1.00
04/26/2022 20:00	0	1.6	9.0	14.5	18.3	1,072,430.5	0.00	1.00
04/26/2022 21:00	1	1.5	9.0	14.5	22.2	1,060,020.1	0.00	1.00
04/26/2022 22:00	1	3.2	21.2	15.2	9.1	646,272.2	0.17	0.27
04/26/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	4.3	12.3	15.1	14.3	908,027.8	1.29 #	8.62 #
Minimum:	0	1.4	8.2	14.5	0.0	646,272.2	0.00	0.00
Maximum:	1	18.0	21.2	18.7	22.2	1,072,430.5	0.77	1.00
%SI	62.50	58.33	58.33	58.33	58.33	58.33	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
04/27/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/27/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/27/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/27/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/27/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/27/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/27/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/27/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/27/2022 08:00	0	20.3	23.8	18.3	0.0	776,358.3	0.27	0.27
04/27/2022 09:00	0	6.8	9.1	14.5	0.0	1,001,819.5	1.00	1.00
04/27/2022 10:00	0	2.6	10.4	14.5	16.5	872,152.2	0.43	1.00
04/27/2022 11:00	0	1.6	8.6	14.5	15.8	1,048,893.5	0.00	1.00
04/27/2022 12:00	0	1.7	7.8	14.4	14.1	979,875.8	0.00	1.00
04/27/2022 13:00	0	1.6	8.6	14.5	16.9	1,060,876.0	0.00	1.00
04/27/2022 14:00	0	1.6	9.1	14.5	18.6	1,056,810.5	0.00	1.00
04/27/2022 15:00	0	1.6	9.2	14.5	17.0	998,823.9	0.00	1.00
04/27/2022 16:00	1	1.6	8.6	14.5	16.4	1,020,007.2	0.00	1.00
04/27/2022 17:00	0	1.7	9.1	14.3	12.5	769,367.5	0.00	1.00
04/27/2022 18:00	0	1.7	9.4	14.3	11.9	760,238.0	0.10	1.00
04/27/2022 19:00	0	18.0	32.5	16.5	0.0	529,095.8	0.10	0.10
04/27/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/27/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/27/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/27/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	5.1	12.2	14.9	11.6	906,193.2	1.90 #	10.37 #
Minimum:	0	1.6	7.8	14.3	0.0	529,095.8	0.00	0.00
Maximum:	1	20.3	32.5	18.3	18.6	1,060,876.0	1.00	1.00
%SI	62.50	50.00	50.00	50.00	50.00	50.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
04/28/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/28/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/28/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/28/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/28/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/28/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/28/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/28/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/28/2022 08:00	0	21.1	25.0	18.2	0.0	702,464.0	0.35	0.35
04/28/2022 09:00	2	12.4	24.6	15.1	23.3	667,476.3	0.75	1.00
04/28/2022 10:00	1	1.6	17.6	14.8	27.5	657,997.2	0.00	1.00
04/28/2022 11:00	1	1.7	16.4	14.9	26.4	664,170.8	0.00	1.00
04/28/2022 12:00	0	1.0	9.8	14.5	13.5	795,122.0	0.00	1.00
04/28/2022 13:00	0	1.6	7.8	14.4	9.6	857,681.0	0.00	1.00
04/28/2022 14:00	0	1.7	8.5	14.5	17.4	1,068,579.0	0.00	1.00
04/28/2022 15:00	0	1.6	8.5	14.5	16.2	1,037,766.9	0.00	1.00
04/28/2022 16:00	2	1.7	18.6	14.9	31.7	645,683.6	0.02	1.00
04/28/2022 17:00	0	6.4	33.5	16.2	0.0	536,989.2	0.12	0.12
04/28/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/28/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/28/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/28/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/28/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/28/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	1	5.1	17.0	15.2	16.6	763,393.0	1.24 #	8.47 #
Minimum:	0	1.0	7.8	14.4	0.0	536,989.2	0.00	0.00
Maximum:	2	21.1	33.5	18.2	31.7	1,068,579.0	0.75	1.00
%SI	66.67	58.33	58.33	58.33	58.33	58.33	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
04/29/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/29/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/29/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/29/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/29/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/29/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/29/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/29/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/29/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/29/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/29/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/29/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/29/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/29/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/29/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/29/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/29/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/29/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/29/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/29/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/29/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/29/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/29/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/29/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
04/30/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/30/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/30/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/30/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/30/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/30/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/30/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/30/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/30/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/30/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/30/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/30/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/30/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/30/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/30/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/30/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/30/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/30/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/30/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/30/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/30/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/30/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/30/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
04/30/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
05/01/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/01/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/01/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/01/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/01/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/01/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/01/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/01/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/01/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/01/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/01/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/01/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/01/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/01/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/01/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/01/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/01/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/01/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/01/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/01/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/01/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/01/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/01/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/01/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
05/02/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/02/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/02/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/02/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/02/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/02/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/02/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/02/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/02/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/02/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/02/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/02/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/02/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/02/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/02/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/02/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/02/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/02/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/02/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/02/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/02/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/02/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/02/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/02/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
05/03/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/03/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/03/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/03/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/03/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/03/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/03/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/03/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/03/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/03/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/03/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/03/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/03/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/03/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/03/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/03/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/03/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/03/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/03/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/03/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/03/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/03/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/03/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/03/2022 23:00	0	17.6	23.8	18.4	0.0	808,508.2	0.23	0.23
Average/Sum#:	0	17.6	23.8	18.4	0.0	808,508.2	0.23 #	0.23 #
Minimum:	0	17.6	23.8	18.4	0.0	808,508.2	0.00	0.00
Maximum:	0	17.6	23.8	18.4	0.0	808,508.2	0.23	0.23
%SI	100.00	95.83	95.83	95.83	95.83	95.83	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
05/04/2022 00:00	1	4.0	10.7	14.4	12.6	759,503.8	0.57	1.00
05/04/2022 01:00	1	1.6	13.6	14.6	21.4	688,190.1	0.00	1.00
05/04/2022 02:00	0	1.2	8.5	14.5	13.0	947,684.5	0.00	1.00
05/04/2022 03:00	0	1.6	8.3	14.5	15.3	1,017,867.5	0.00	1.00
05/04/2022 04:00	0	1.6	8.4	14.5	15.9	1,045,256.0	0.00	1.00
05/04/2022 05:00	1	1.7	10.3	14.5	20.4	905,959.8	0.00	1.00
05/04/2022 06:00	0	1.5	10.8	14.4	15.0	868,636.4	0.00	1.00
05/04/2022 07:00	1	1.7	9.4	14.1	19.3	1,045,595.8	0.00	1.00
05/04/2022 08:00	2	1.3	13.1	14.7	26.9	788,523.4	0.00	1.00
05/04/2022 09:00	1	1.1	14.1	14.8	22.5	677,752.8	0.00	1.00
05/04/2022 10:00	1	1.3	15.2	14.8	23.2	662,936.1	0.00	1.00
05/04/2022 11:00	1	1.4	13.4	14.8	19.3	673,487.4	0.00	1.00
05/04/2022 12:00	0	1.6	11.7	14.8	15.6	684,936.7	0.00	1.00
05/04/2022 13:00	0	1.6	11.3	14.8	15.9	686,508.2	0.00	1.00
05/04/2022 14:00	1	1.5	12.4	14.8	18.2	674,160.9	0.00	1.00
05/04/2022 15:00	1	1.6	14.2	14.9	23.5	667,594.4	0.00	1.00
05/04/2022 16:00	1	1.5	14.2	14.9	21.3	667,594.4	0.00	1.00
05/04/2022 17:00	1	1.7	15.3	14.8	31.2	744,877.1	0.00	1.00
05/04/2022 18:00	3	1.8	26.1	13.0	66.2	1,004,186.8	0.00	1.00
05/04/2022 19:00	2	1.9	23.1	13.6	57.5	1,039,449.4	0.00	1.00
05/04/2022 20:00	3	1.8	22.9	13.7	60.3	1,045,137.1	0.00	1.00
05/04/2022 21:00	3	1.9	24.1	13.2	62.7	1,048,765.7	0.00	1.00
05/04/2022 22:00	2	1.8	22.6	13.8	60.0	1,044,812.9	0.00	1.00
05/04/2022 23:00	1	1.4	16.8	14.3	35.1	885,353.6	0.00	1.00
Average/Sum#:	1	1.7	14.6	14.4	28.8	844,782.1	0.57 #	24.00 #
Minimum:	0	1.1	8.3	13.0	12.6	662,936.1	0.00	1.00
Maximum:	3	4.0	26.1	14.9	66.2	1,048,765.7	0.57	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
05/05/2022 00:00	0	1.5	9.3	14.5	13.6	828,501.8	0.00	1.00
05/05/2022 01:00	1	1.5	12.3	14.6	18.3	691,233.3	0.00	1.00
05/05/2022 02:00	1	1.6	13.3	14.7	21.1	684,049.6	0.00	1.00
05/05/2022 03:00	1	1.6	13.4	14.7	21.1	684,270.4	0.00	1.00
05/05/2022 04:00	0	1.4	10.6	14.6	15.6	823,176.2	0.00	1.00
05/05/2022 05:00	1	1.6	10.7	14.4	20.0	750,023.2	0.00	1.00
05/05/2022 06:00	1	1.5	15.6	14.7	25.6	667,263.1	0.00	1.00
05/05/2022 07:00	1	1.6	16.6	14.7	27.6	653,789.7	0.00	1.00
05/05/2022 08:00	1	1.6	15.7	14.8	25.4	668,099.5	0.00	1.00
05/05/2022 09:00	1	1.5	13.6	14.6	21.5	674,278.5	0.00	1.00
05/05/2022 10:00	1	1.4	13.7	14.7	22.3	676,318.9	0.00	1.00
05/05/2022 11:00	1	1.5	13.7	14.7	21.0	664,612.6	0.00	1.00
05/05/2022 12:00	0	1.4	7.8	14.4	8.8	859,155.8	0.00	1.00
05/05/2022 13:00	0	1.7	8.4	14.5	14.3	943,191.0	0.00	1.00
05/05/2022 14:00	1	1.4	12.1	14.6	19.2	707,970.7	0.00	1.00
05/05/2022 15:00	1	1.6	13.1	14.6	22.6	692,102.7	0.00	1.00
05/05/2022 16:00	1	1.6	14.7	14.8	22.6	669,671.0	0.00	1.00
05/05/2022 17:00	0	1.5	11.4	14.6	16.6	788,614.5	0.00	1.00
05/05/2022 18:00	0	1.7	8.5	14.2	16.6	1,048,529.4	0.00	1.00
05/05/2022 19:00	1	1.7	8.5	14.2	18.1	1,047,507.5	0.00	1.00
05/05/2022 20:00	1	1.7	8.5	14.2	18.4	1,045,872.3	0.00	1.00
05/05/2022 21:00	1	1.8	8.9	14.3	18.3	946,562.7	0.00	1.00
05/05/2022 22:00	1	1.4	11.6	14.5	20.3	727,292.7	0.00	1.00
05/05/2022 23:00	1	1.6	13.8	14.7	21.3	677,202.4	0.00	1.00
Average/Sum#:	1	1.6	11.9	14.6	19.6	775,803.7	0.00 #	24.00 #
Minimum:	0	1.4	7.8	14.2	8.8	653,789.7	0.00	1.00
Maximum:	1	1.8	16.6	14.8	27.6	1,048,529.4	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
05/06/2022 00:00	1	1.6	13.7	14.6	22.2	669,496.4	0.00	1.00
05/06/2022 01:00	1	1.5	14.9	14.7	24.6	670,797.1	0.00	1.00
05/06/2022 02:00	1	1.7	13.8	14.6	21.4	673,409.0	0.00	1.00
05/06/2022 03:00	1	1.6	12.8	14.5	19.1	695,410.8	0.00	1.00
05/06/2022 04:00	0	1.7	8.4	14.3	15.7	1,046,364.7	0.00	1.00
05/06/2022 05:00	1	1.7	8.7	14.3	18.4	1,057,569.1	0.00	1.00
05/06/2022 06:00	1	1.7	8.6	14.3	19.2	1,058,399.1	0.00	1.00
05/06/2022 07:00	0	1.4	12.2	14.3	18.6	776,007.2	0.00	1.00
05/06/2022 08:00	0	1.4	8.9	14.3	15.7	1,045,327.3	0.00	1.00
05/06/2022 09:00	0	1.7	8.7	14.3	17.4	1,043,459.9	0.00	1.00
05/06/2022 10:00	0	1.7	8.3	14.4	16.2	1,038,023.7	0.00	1.00
05/06/2022 11:00	0	1.7	8.9	14.2	18.0	1,051,390.9	0.00	1.00
05/06/2022 12:00	0	1.6	7.7	14.5	13.6	987,697.3	0.00	1.00
05/06/2022 13:00	0	1.7	8.9	14.1	17.6	1,037,943.1	0.00	1.00
05/06/2022 14:00	1	1.8	11.1	14.4	21.5	832,820.7	0.00	1.00
05/06/2022 15:00	1	1.5	15.1	14.8	21.4	655,752.2	0.00	1.00
05/06/2022 16:00	0	1.6	8.5	14.1	13.6	1,007,131.1	0.00	1.00
05/06/2022 17:00	0	1.7	8.8	14.1	17.5	1,040,963.9	0.00	1.00
05/06/2022 18:00	1	1.7	8.9	14.2	18.3	1,047,916.2	0.00	1.00
05/06/2022 19:00	1	1.7	9.0	14.2	18.8	1,045,054.8	0.00	1.00
05/06/2022 20:00	1	1.7	8.9	14.2	18.7	1,046,076.7	0.00	1.00
05/06/2022 21:00	1	1.7	8.9	14.2	18.8	1,044,237.2	0.00	1.00
05/06/2022 22:00	0	1.7	8.4	14.3	15.2	946,147.8	0.02	0.68
05/06/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	1	1.6	10.1	14.3	18.3	935,539.0	0.02 #	22.68 #
Minimum:	0	1.4	7.7	14.1	13.6	655,752.2	0.00	0.00
Maximum:	1	1.8	15.1	14.8	24.6	1,058,399.1	0.02	1.00
%SI	4.17	4.17	4.17	4.17	4.17	4.17	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
05/07/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/07/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/07/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/07/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/07/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/07/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/07/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/07/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/07/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/07/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/07/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/07/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/07/2022 12:00	0	20.2	24.3	17.5	0.0	745,933.5	0.28	0.28
05/07/2022 13:00	1	5.1	17.6	14.6	22.7	683,625.3	0.70	1.00
05/07/2022 14:00	1	1.6	20.0	14.8	31.1	657,099.2	0.00	1.00
05/07/2022 15:00	1	1.6	19.5	14.9	30.8	664,855.5	0.00	1.00
05/07/2022 16:00	1	1.6	19.1	14.9	30.0	665,768.5	0.00	1.00
05/07/2022 17:00	1	1.5	17.2	14.8	25.3	687,630.6	0.00	1.00
05/07/2022 18:00	2	1.8	22.6	14.1	57.3	1,036,130.7	0.00	1.00
05/07/2022 19:00	2	1.7	22.9	14.2	59.8	1,061,406.1	0.00	1.00
05/07/2022 20:00	2	1.7	22.7	14.3	58.7	1,044,704.8	0.00	1.00
05/07/2022 21:00	1	1.4	16.8	14.7	24.6	683,386.9	0.00	1.00
05/07/2022 22:00	1	1.3	19.2	14.8	31.7	662,038.1	0.00	1.00
05/07/2022 23:00	2	1.4	19.2	14.8	32.9	664,058.6	0.00	1.00
Average/Sum#:	1	3.4	20.1	14.9	33.7	771,386.5	0.98 #	11.28 #
Minimum:	1	1.3	16.8	14.1	0.0	657,099.2	0.00	0.00
Maximum:	2	20.2	24.3	17.5	59.8	1,061,406.1	0.70	1.00
%SI	54.17	50.00	50.00	50.00	50.00	50.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
05/08/2022 00:00	2	1.4	19.5	14.8	33.7	664,507.6	0.00	1.00
05/08/2022 01:00	2	1.4	19.6	14.8	34.1	665,854.5	0.00	1.00
05/08/2022 02:00	2	1.3	20.4	14.8	35.1	666,079.0	0.00	1.00
05/08/2022 03:00	2	1.4	20.6	14.8	36.2	667,201.5	0.00	1.00
05/08/2022 04:00	2	1.4	19.9	14.7	34.4	671,680.6	0.00	1.00
05/08/2022 05:00	2	1.6	21.2	14.8	35.3	671,242.4	0.02	1.00
05/08/2022 06:00	1	1.4	15.2	14.6	24.0	724,490.7	0.00	1.00
05/08/2022 07:00	1	1.6	16.1	14.6	25.3	692,320.1	0.00	1.00
05/08/2022 08:00	1	1.6	15.7	14.6	25.3	693,189.6	0.00	1.00
05/08/2022 09:00	1	1.6	15.6	14.6	25.2	693,189.6	0.00	1.00
05/08/2022 10:00	1	1.6	15.2	14.6	24.3	692,754.8	0.00	1.00
05/08/2022 11:00	1	1.6	14.9	14.6	23.9	692,537.5	0.00	1.00
05/08/2022 12:00	1	1.6	14.9	14.6	24.0	691,015.9	0.00	1.00
05/08/2022 13:00	1	1.6	15.6	14.7	25.5	695,535.1	0.00	1.00
05/08/2022 14:00	1	1.6	15.7	14.7	25.3	692,884.6	0.00	1.00
05/08/2022 15:00	1	1.6	15.2	14.7	24.3	700,394.3	0.00	1.00
05/08/2022 16:00	1	1.4	12.7	14.6	19.3	821,219.9	0.00	1.00
05/08/2022 17:00	0	1.7	9.6	14.4	15.4	886,965.6	0.00	1.00
05/08/2022 18:00	2	1.4	17.0	14.7	31.0	753,846.0	0.00	1.00
05/08/2022 19:00	0	1.7	9.2	14.3	16.2	1,066,698.6	0.00	1.00
05/08/2022 20:00	1	1.7	9.4	14.3	19.9	1,057,361.6	0.00	1.00
05/08/2022 21:00	1	1.7	9.2	14.3	19.3	1,049,269.6	0.00	1.00
05/08/2022 22:00	2	1.7	17.3	14.7	32.4	708,124.9	0.00	1.00
05/08/2022 23:00	2	1.5	20.5	14.8	35.5	667,875.0	0.00	1.00
Average/Sum#:	1	1.5	15.8	14.6	26.9	749,426.6	0.02 #	24.00 #
Minimum:	0	1.3	9.2	14.3	15.4	664,507.6	0.00	1.00
Maximum:	2	1.7	21.2	14.8	36.2	1,066,698.6	0.02	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
05/09/2022 00:00	2	1.6	19.9	14.8	33.8	669,895.5	0.00	1.00
05/09/2022 01:00	2	1.6	19.9	14.8	34.1	669,671.0	0.00	1.00
05/09/2022 02:00	2	1.5	20.7	14.8	35.1	671,017.9	0.00	1.00
05/09/2022 03:00	2	1.6	20.6	14.8	35.1	670,569.0	0.00	1.00
05/09/2022 04:00	2	1.5	20.2	14.8	33.8	673,487.4	0.00	1.00
05/09/2022 05:00	2	1.6	19.6	14.8	34.1	682,691.7	0.00	1.00
05/09/2022 06:00	2	1.6	21.7	14.9	40.0	678,549.8	0.00	1.00
05/09/2022 07:00	1	1.5	22.8	14.8	38.5	666,079.0	0.00	1.00
05/09/2022 08:00	2	1.6	22.1	14.8	37.2	665,630.0	0.00	1.00
05/09/2022 09:00	2	1.6	21.6	14.8	36.6	664,956.6	0.00	1.00
05/09/2022 10:00	2	1.6	21.0	14.8	34.8	666,977.0	0.00	1.00
05/09/2022 11:00	0	1.4	12.5	14.5	16.5	730,502.3	0.00	1.00
05/09/2022 12:00	1	1.6	14.6	14.6	23.0	689,059.6	0.00	1.00
05/09/2022 13:00	1	1.6	14.1	14.6	21.5	682,321.1	0.00	1.00
05/09/2022 14:00	1	1.6	13.9	14.6	21.1	686,885.9	0.00	1.00
05/09/2022 15:00	1	1.6	13.0	14.6	19.6	693,624.3	0.00	1.00
05/09/2022 16:00	1	1.6	13.5	14.6	21.3	689,494.3	0.00	1.00
05/09/2022 17:00	1	1.6	14.0	14.6	21.8	687,972.7	0.00	1.00
05/09/2022 18:00	1	1.6	13.1	14.6	20.1	695,145.9	0.00	1.00
05/09/2022 19:00	1	1.6	13.0	14.5	20.1	688,349.7	0.00	1.00
05/09/2022 20:00	1	1.6	13.2	14.5	20.7	686,851.9	0.00	1.00
05/09/2022 21:00	1	1.6	13.8	14.5	21.8	686,210.0	0.00	1.00
05/09/2022 22:00	1	1.8	14.6	14.5	19.7	685,354.1	0.10	1.00
05/09/2022 23:00	0	14.6	38.9	16.6	0.0	557,960.8	0.07	0.07
Average/Sum#:	1	2.1	18.0	14.8	26.7	676,635.7	0.17 #	23.07 #
Minimum:	0	1.4	12.5	14.5	0.0	557,960.8	0.00	0.07
Maximum:	2	14.6	38.9	16.6	40.0	730,502.3	0.10	1.00
%SI	4.17	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
05/10/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/10/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/10/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/10/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/10/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/10/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/10/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/10/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/10/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/10/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/10/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/10/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/10/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/10/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/10/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/10/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/10/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/10/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/10/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/10/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/10/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/10/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/10/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/10/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
05/11/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/11/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/11/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/11/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/11/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/11/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/11/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/11/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/11/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/11/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/11/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/11/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/11/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/11/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/11/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/11/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/11/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/11/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/11/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/11/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/11/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/11/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/11/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/11/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
05/12/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/12/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/12/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/12/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/12/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/12/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/12/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/12/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/12/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/12/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/12/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/12/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/12/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/12/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/12/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/12/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/12/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/12/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/12/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/12/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/12/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/12/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/12/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/12/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
05/13/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/13/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/13/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/13/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/13/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/13/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/13/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/13/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/13/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/13/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/13/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/13/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/13/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/13/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/13/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/13/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/13/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/13/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/13/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/13/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/13/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/13/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/13/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/13/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
05/14/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/14/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/14/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/14/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/14/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/14/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/14/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/14/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/14/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/14/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/14/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/14/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/14/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/14/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/14/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/14/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/14/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/14/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/14/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/14/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/14/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/14/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/14/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/14/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
05/15/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/15/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/15/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/15/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/15/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/15/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/15/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/15/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/15/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/15/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/15/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/15/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/15/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/15/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/15/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/15/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/15/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/15/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/15/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/15/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/15/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/15/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/15/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/15/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
05/16/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/16/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/16/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/16/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/16/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/16/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/16/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/16/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/16/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/16/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/16/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/16/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/16/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/16/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/16/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/16/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/16/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/16/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/16/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/16/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/16/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/16/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/16/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/16/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
05/17/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/17/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/17/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/17/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/17/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/17/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/17/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/17/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/17/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/17/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/17/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/17/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/17/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/17/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/17/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/17/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/17/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/17/2022 17:00	0	12.2	17.1	16.1	0.0	798,545.6	0.65	0.65
05/17/2022 18:00	0	1.7	8.4	14.5	15.9	1,014,657.9	0.13	1.00
05/17/2022 19:00	0	1.7	9.9	14.0	19.0	1,014,167.9	0.00	1.00
05/17/2022 20:00	1	1.9	10.6	13.7	21.0	1,041,333.1	0.00	1.00
05/17/2022 21:00	1	1.9	11.1	13.5	21.7	1,039,652.2	0.00	1.00
05/17/2022 22:00	1	1.8	9.9	14.1	19.9	948,326.4	0.00	1.00
05/17/2022 23:00	2	1.6	20.6	14.8	33.9	653,507.3	0.00	1.00
Average/Sum#:	1	3.3	12.5	14.4	18.8	930,027.2	0.78 #	6.65 #
Minimum:	0	1.6	8.4	13.5	0.0	653,507.3	0.00	0.00
Maximum:	2	12.2	20.6	16.1	33.9	1,041,333.1	0.65	1.00
%SI	75.00	70.83	70.83	70.83	70.83	70.83	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
05/18/2022 00:00	2	1.6	20.6	14.8	33.7	656,201.2	0.00	1.00
05/18/2022 01:00	2	1.6	21.6	14.8	35.1	651,711.3	0.00	1.00
05/18/2022 02:00	0	1.3	10.4	14.5	16.1	839,200.4	0.00	1.00
05/18/2022 03:00	1	2.1	12.2	12.7	25.1	1,043,601.6	0.00	1.00
05/18/2022 04:00	2	2.3	14.1	11.9	38.2	1,076,367.6	0.00	1.00
05/18/2022 05:00	1	1.8	10.6	13.8	21.5	1,026,489.7	0.00	1.00
05/18/2022 06:00	1	1.7	12.0	14.4	23.6	855,784.9	0.00	1.00
05/18/2022 07:00	0	1.2	9.1	14.5	13.9	997,754.0	0.00	1.00
05/18/2022 08:00	0	1.6	8.6	14.5	16.5	1,066,225.3	0.00	1.00
05/18/2022 09:00	0	1.6	8.5	14.5	16.8	1,060,448.0	0.00	1.00
05/18/2022 10:00	0	1.7	8.7	14.4	17.1	1,043,501.4	0.00	1.00
05/18/2022 11:00	1	2.0	11.9	12.9	26.0	1,048,979.1	0.00	1.00
05/18/2022 12:00	0	1.7	8.5	14.3	16.3	1,021,466.1	0.00	1.00
05/18/2022 13:00	1	1.9	10.5	13.4	23.2	1,037,841.1	0.00	1.00
05/18/2022 14:00	2	2.2	12.9	12.2	32.4	1,032,734.9	0.00	1.00
05/18/2022 15:00	1	2.0	11.6	13.0	24.6	1,023,428.0	0.00	1.00
05/18/2022 16:00	1	1.8	10.0	13.7	20.1	1,023,074.1	0.00	1.00
05/18/2022 17:00	2	2.2	12.4	12.5	30.4	1,039,132.3	0.00	1.00
05/18/2022 18:00	1	2.0	11.9	12.9	25.4	1,035,284.8	0.00	1.00
05/18/2022 19:00	1	2.0	11.1	13.1	23.1	1,029,877.4	0.00	1.00
05/18/2022 20:00	1	2.1	12.1	12.5	28.2	1,034,404.5	0.00	1.00
05/18/2022 21:00	1	1.8	9.6	13.8	18.7	1,031,311.6	0.00	1.00
05/18/2022 22:00	1	1.8	9.5	13.9	19.1	1,040,762.5	0.00	1.00
05/18/2022 23:00	1	1.8	9.3	14.3	17.6	904,857.5	0.00	1.00
Average/Sum#:	1	1.8	11.6	13.6	23.4	984,185.0	0.00 #	24.00 #
Minimum:	0	1.2	8.5	11.9	13.9	651,711.3	0.00	1.00
Maximum:	2	2.3	21.6	14.8	38.2	1,076,367.6	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
05/19/2022 00:00	0	1.4	12.4	14.6	18.8	813,177.2	0.00	1.00
05/19/2022 01:00	1	1.8	12.1	14.5	20.8	757,248.9	0.00	1.00
05/19/2022 02:00	1	1.6	13.9	14.6	21.7	689,929.0	0.00	1.00
05/19/2022 03:00	0	1.6	9.0	14.3	13.1	915,646.9	0.00	1.00
05/19/2022 04:00	0	1.7	8.8	14.2	17.8	1,035,652.7	0.00	1.00
05/19/2022 05:00	1	1.7	9.0	14.2	18.7	1,050,368.9	0.00	1.00
05/19/2022 06:00	1	1.6	11.8	14.5	21.4	794,694.1	0.00	1.00
05/19/2022 07:00	0	1.5	10.2	14.4	12.2	759,503.8	0.00	1.00
05/19/2022 08:00	1	1.4	10.4	14.5	19.2	778,646.1	0.00	1.00
05/19/2022 09:00	0	1.6	11.1	14.6	15.4	688,624.8	0.00	1.00
05/19/2022 10:00	1	1.6	11.3	14.7	16.7	693,988.9	0.00	1.00
05/19/2022 11:00	0	1.6	7.9	14.4	14.2	1,025,593.5	0.00	1.00
05/19/2022 12:00	0	0.0	10.3	0.0	15.8	285,810.0	0.00	1.00
05/19/2022 13:00	1	1.4	10.4	14.6	14.9	897,516.4	0.00	1.00
05/19/2022 14:00	1	1.5	10.2	13.7	22.6	1,039,431.1	0.00	1.00
05/19/2022 15:00	1	1.5	9.6	14.3	18.3	890,540.8	0.00	1.00
05/19/2022 16:00	0	1.4	10.0	14.4	16.4	863,369.4	0.00	1.00
05/19/2022 17:00	1	1.5	9.7	14.0	20.0	1,042,350.3	0.00	1.00
05/19/2022 18:00	1	1.6	10.1	13.8	21.0	1,044,620.1	0.00	1.00
05/19/2022 19:00	1	1.9	10.8	13.6	22.1	1,048,641.4	0.00	1.00
05/19/2022 20:00	1	2.0	12.0	13.1	26.1	1,059,899.4	0.00	1.00
05/19/2022 21:00	1	1.8	10.2	13.8	21.4	1,043,077.1	0.00	1.00
05/19/2022 22:00	1	1.5	9.7	14.4	19.1	928,680.4	0.03	1.00
05/19/2022 23:00	0	9.0	25.8	15.4	0.0	608,771.4	0.17	0.17
Average/Sum#:	1	1.9	11.1	14.3	17.8	889,998.8	0.20 #	23.17 #
Minimum:	0	1.4	7.9	13.1	0.0	608,771.4	0.00	0.17
Maximum:	1	9.0	25.8	15.4	26.1	1,059,899.4	0.17	1.00
%SI	8.33	4.17	0.00	4.17	0.00	4.17	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
05/20/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/20/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/20/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/20/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/20/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/20/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/20/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/20/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/20/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/20/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/20/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/20/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/20/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/20/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/20/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/20/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/20/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/20/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/20/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/20/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/20/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/20/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/20/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/20/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
05/21/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/21/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/21/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/21/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/21/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/21/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/21/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/21/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/21/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/21/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/21/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/21/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/21/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/21/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/21/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/21/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/21/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/21/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/21/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/21/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/21/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/21/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/21/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/21/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
05/22/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/22/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/22/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/22/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/22/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/22/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/22/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/22/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/22/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/22/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/22/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/22/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/22/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/22/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/22/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/22/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/22/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/22/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/22/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/22/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/22/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/22/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/22/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/22/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
05/23/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/23/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/23/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/23/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/23/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/23/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/23/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/23/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/23/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/23/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/23/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/23/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/23/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/23/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/23/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/23/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/23/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/23/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/23/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/23/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/23/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/23/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/23/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/23/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
05/24/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/24/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/24/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/24/2022 03:00	0	18.8	22.5	17.0	0.0	698,757.6	0.33	0.33
05/24/2022 04:00	1	5.6	13.9	14.6	15.9	678,191.1	0.65	1.00
05/24/2022 05:00	0	1.6	12.4	14.6	17.4	710,579.1	0.00	1.00
05/24/2022 06:00	0	1.6	12.1	14.5	16.3	689,633.6	0.00	1.00
05/24/2022 07:00	0	1.6	9.5	14.4	14.3	894,760.8	0.00	1.00
05/24/2022 08:00	0	1.7	9.7	14.3	15.3	861,699.9	0.00	1.00
05/24/2022 09:00	1	1.6	13.0	14.7	18.6	678,306.8	0.00	1.00
05/24/2022 10:00	0	1.5	9.4	14.5	12.9	826,362.0	0.00	1.00
05/24/2022 11:00	0	1.6	7.7	14.4	11.1	880,013.2	0.00	1.00
05/24/2022 12:00	0	1.7	8.4	14.3	15.8	994,907.6	0.00	1.00
05/24/2022 13:00	1	1.9	10.7	13.5	22.1	1,029,659.1	0.00	1.00
05/24/2022 14:00	2	2.2	12.8	12.4	30.3	1,024,168.3	0.00	1.00
05/24/2022 15:00	2	2.3	13.5	11.9	36.2	1,029,655.0	0.00	1.00
05/24/2022 16:00	2	2.2	12.9	12.4	30.7	1,030,290.5	0.00	1.00
05/24/2022 17:00	1	2.1	11.9	12.9	25.2	1,023,815.9	0.00	1.00
05/24/2022 18:00	2	2.3	13.3	11.9	35.2	1,028,589.9	0.00	1.00
05/24/2022 19:00	2	2.2	13.0	12.1	31.6	1,015,241.4	0.00	1.00
05/24/2022 20:00	1	2.0	11.2	13.2	21.5	1,022,800.0	0.00	1.00
05/24/2022 21:00	1	1.9	10.7	13.4	21.2	1,022,868.7	0.00	1.00
05/24/2022 22:00	1	2.0	11.7	12.9	25.1	1,031,347.7	0.00	1.00
05/24/2022 23:00	1	1.8	10.0	14.3	18.1	869,377.0	0.00	1.00
Average/Sum#:	1	2.9	11.9	13.7	20.7	906,715.5	0.98 #	20.33 #
Minimum:	0	1.5	7.7	11.9	0.0	678,191.1	0.00	0.00
Maximum:	2	18.8	22.5	17.0	36.2	1,031,347.7	0.65	1.00
%SI	16.67	12.50	12.50	12.50	12.50	12.50	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
05/25/2022 00:00	0	1.4	9.2	14.6	13.5	907,732.7	0.00	1.00
05/25/2022 01:00	1	1.7	11.3	14.5	17.8	721,301.5	0.00	1.00
05/25/2022 02:00	1	1.7	13.3	14.6	19.9	671,452.7	0.00	1.00
05/25/2022 03:00	0	1.5	9.9	14.3	15.2	859,417.5	0.00	1.00
05/25/2022 04:00	0	1.8	9.3	14.1	18.0	1,044,387.5	0.00	1.00
05/25/2022 05:00	0	1.7	8.4	14.3	16.0	1,004,452.0	0.00	1.00
05/25/2022 06:00	0	1.7	9.1	14.1	18.0	1,041,568.1	0.00	1.00
05/25/2022 07:00	1	1.8	10.8	14.4	20.0	856,206.3	0.00	1.00
05/25/2022 08:00	1	1.5	14.9	14.8	21.8	657,099.2	0.00	1.00
05/25/2022 09:00	0	1.5	8.6	14.4	10.3	820,390.5	0.00	1.00
05/25/2022 10:00	0	1.7	8.0	14.4	14.9	1,015,480.9	0.00	1.00
05/25/2022 11:00	2	2.2	12.7	12.2	31.6	1,033,836.7	0.00	1.00
05/25/2022 12:00	2	2.3	13.3	11.7	36.2	1,019,179.2	0.00	1.00
05/25/2022 13:00	2	2.3	13.2	11.7	36.6	1,015,904.5	0.00	1.00
05/25/2022 14:00	2	2.3	13.2	11.7	36.7	1,014,862.5	0.00	1.00
05/25/2022 15:00	2	2.3	13.2	11.8	36.5	1,023,456.6	0.00	1.00
05/25/2022 16:00	2	2.3	13.2	11.8	36.1	1,022,553.7	0.00	1.00
05/25/2022 17:00	2	2.3	13.1	11.9	34.9	1,022,047.1	0.00	1.00
05/25/2022 18:00	2	2.3	13.0	11.8	34.5	1,017,136.2	0.00	1.00
05/25/2022 19:00	1	2.0	11.3	13.0	21.9	1,015,280.8	0.00	1.00
05/25/2022 20:00	1	1.8	9.6	13.7	18.0	1,011,472.1	0.00	1.00
05/25/2022 21:00	1	1.9	10.1	13.6	19.5	1,020,502.6	0.00	1.00
05/25/2022 22:00	1	1.8	10.3	14.3	19.0	846,760.7	0.00	1.00
05/25/2022 23:00	1	3.5	18.9	15.1	11.3	634,657.4	0.17	0.38
Average/Sum#:	1	2.0	11.6	13.5	23.3	929,047.5	0.17 #	23.38 #
Minimum:	0	1.4	8.0	11.7	10.3	634,657.4	0.00	0.38
Maximum:	2	3.5	18.9	15.1	36.7	1,044,387.5	0.17	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
05/26/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/26/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/26/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/26/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/26/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/26/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/26/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/26/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/26/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/26/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/26/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/26/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/26/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/26/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/26/2022 14:00	0	9.4	12.3	19.4	0.0	553,247.5	0.15	0.15
05/26/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/26/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/26/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/26/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/26/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/26/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/26/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/26/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/26/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	9.4	12.3	19.4	0.0	553,247.5	0.15 #	0.15 #
Minimum:	0	9.4	12.3	19.4	0.0	553,247.5	0.00	0.00
Maximum:	0	9.4	12.3	19.4	0.0	553,247.5	0.15	0.15
%SI	100.00	95.83	95.83	95.83	95.83	95.83	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
05/27/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/27/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/27/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/27/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/27/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/27/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/27/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/27/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/27/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/27/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/27/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/27/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/27/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/27/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/27/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/27/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/27/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/27/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/27/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/27/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/27/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/27/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/27/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/27/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
05/28/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/28/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/28/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/28/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/28/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/28/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/28/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/28/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/28/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/28/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/28/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/28/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/28/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/28/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/28/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/28/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/28/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/28/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/28/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/28/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/28/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/28/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/28/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/28/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
05/29/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/29/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/29/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/29/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/29/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/29/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/29/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/29/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/29/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/29/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/29/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/29/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/29/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/29/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/29/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/29/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/29/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/29/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/29/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/29/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/29/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/29/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/29/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/29/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
05/30/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/30/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/30/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/30/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/30/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/30/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/30/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/30/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/30/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/30/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/30/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/30/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/30/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/30/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/30/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/30/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/30/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/30/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/30/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/30/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/30/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/30/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/30/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/30/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
05/31/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/31/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/31/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/31/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/31/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/31/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/31/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/31/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/31/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/31/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/31/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/31/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/31/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/31/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/31/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/31/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/31/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/31/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/31/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/31/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/31/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/31/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/31/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
05/31/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
06/01/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/01/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/01/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/01/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/01/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/01/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/01/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/01/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/01/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/01/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/01/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/01/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/01/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/01/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/01/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/01/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/01/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/01/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/01/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/01/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/01/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/01/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/01/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/01/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
06/02/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/02/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/02/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/02/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/02/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/02/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/02/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/02/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/02/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/02/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/02/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/02/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/02/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/02/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/02/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/02/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/02/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/02/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/02/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/02/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/02/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/02/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/02/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/02/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
06/03/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/03/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/03/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/03/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/03/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/03/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/03/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/03/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/03/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/03/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/03/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/03/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/03/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/03/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/03/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/03/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/03/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/03/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/03/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/03/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/03/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/03/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/03/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/03/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
06/04/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/04/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/04/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/04/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/04/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/04/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/04/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/04/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/04/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/04/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/04/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/04/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/04/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/04/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/04/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/04/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/04/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/04/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/04/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/04/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/04/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/04/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/04/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/04/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
06/05/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/05/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/05/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/05/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/05/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/05/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/05/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/05/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/05/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/05/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/05/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/05/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/05/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/05/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/05/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/05/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/05/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/05/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/05/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/05/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/05/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/05/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/05/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/05/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
06/06/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/06/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/06/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/06/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/06/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/06/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/06/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/06/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/06/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/06/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/06/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/06/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/06/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/06/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/06/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/06/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/06/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/06/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/06/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/06/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/06/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/06/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/06/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/06/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
06/07/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/07/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/07/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/07/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/07/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/07/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/07/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/07/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/07/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/07/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/07/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/07/2022 11:00	0	0.0	21.9	0.0	0.0	139,759.9	0.33	0.33
06/07/2022 12:00	0	0.0	12.2	0.0	11.3	208,296.7	1.00	1.00
06/07/2022 13:00	1	0.0	10.9	0.0	17.3	218,125.1	0.73	1.00
06/07/2022 14:00	0	0.0	9.1	0.0	18.5	255,669.6	0.00	1.00
06/07/2022 15:00	0	0.0	7.8	0.0	19.0	267,856.8	0.00	1.00
06/07/2022 16:00	0	0.0	7.7	0.0	19.0	268,118.9	0.00	1.00
06/07/2022 17:00	0	0.0	7.6	0.0	19.0	268,577.5	0.00	1.00
06/07/2022 18:00	0	0.0	7.6	0.0	19.0	268,774.1	0.00	1.00
06/07/2022 19:00	0	0.0	7.9	0.0	17.4	263,008.1	0.05	1.00
06/07/2022 20:00	0	2.1	32.9	15.8	0.0	557,436.3	0.12	0.12
06/07/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/07/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/07/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	1	2.1	12.6	15.8	14.1	557,436.3	2.23 #	8.45 #
Minimum:	1	2.1	7.6	15.8	0.0	557,436.3	0.00	0.00
Maximum:	1	2.1	32.9	15.8	19.0	557,436.3	1.00	1.00
%SI	95.83	95.83	58.33	95.83	58.33	95.83	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
06/08/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/08/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/08/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/08/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/08/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/08/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/08/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/08/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/08/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/08/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/08/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/08/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/08/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/08/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/08/2022 14:00	0	8.3	15.1	15.6	4.0	879,790.6	0.50	0.77
06/08/2022 15:00	0	1.6	7.9	14.5	11.7	1,002,461.4	0.00	1.00
06/08/2022 16:00	0	1.7	8.1	14.4	13.6	1,002,418.6	0.00	1.00
06/08/2022 17:00	1	2.0	10.7	13.2	21.4	1,032,403.7	0.00	1.00
06/08/2022 18:00	2	2.3	13.1	11.8	32.8	1,036,548.9	0.00	1.00
06/08/2022 19:00	1	2.1	12.2	12.5	26.1	1,035,871.7	0.00	1.00
06/08/2022 20:00	1	1.9	10.5	13.5	19.3	1,048,164.8	0.00	1.00
06/08/2022 21:00	0	1.8	9.4	13.9	17.4	1,046,044.6	0.00	1.00
06/08/2022 22:00	0	1.8	9.3	14.0	17.4	1,049,693.6	0.00	1.00
06/08/2022 23:00	0	1.8	9.7	13.8	18.5	1,049,442.0	0.00	1.00
Average/Sum#:	1	2.5	10.6	13.7	18.2	1,018,284.0	0.50 #	9.77 #
Minimum:	0	1.6	7.9	11.8	4.0	879,790.6	0.00	0.00
Maximum:	2	8.3	15.1	15.6	32.8	1,049,693.6	0.50	1.00
%SI	58.33	58.33	58.33	58.33	58.33	58.33	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
06/09/2022 00:00	1	1.8	9.6	13.8	18.6	1,047,320.3	0.00	1.00
06/09/2022 01:00	0	1.8	9.4	13.9	18.1	1,048,979.1	0.00	1.00
06/09/2022 02:00	1	1.9	14.6	14.5	17.5	880,497.1	0.13	0.97
06/09/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/09/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/09/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/09/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/09/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/09/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/09/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/09/2022 10:00	0	12.6	22.0	17.2	0.0	741,339.7	0.35	0.35
06/09/2022 11:00	0	3.2	11.2	14.5	17.4	681,716.6	0.38	1.00
06/09/2022 12:00	0	1.6	12.5	14.8	16.5	673,038.4	0.00	1.00
06/09/2022 13:00	0	1.4	8.1	14.5	9.8	871,724.2	0.00	1.00
06/09/2022 14:00	0	1.8	8.8	13.9	15.9	951,358.7	0.00	1.00
06/09/2022 15:00	1	1.9	10.4	13.4	20.3	1,027,798.6	0.00	1.00
06/09/2022 16:00	0	1.7	8.4	14.2	13.7	892,987.3	0.00	1.00
06/09/2022 17:00	1	1.9	10.4	13.4	21.3	1,001,870.9	0.00	1.00
06/09/2022 18:00	1	1.9	10.7	13.3	20.4	1,022,023.0	0.00	1.00
06/09/2022 19:00	0	1.8	9.5	13.8	17.6	1,031,697.3	0.00	1.00
06/09/2022 20:00	1	2.0	11.0	13.2	21.4	1,041,651.8	0.00	1.00
06/09/2022 21:00	1	1.9	10.3	13.5	19.7	1,032,990.1	0.00	1.00
06/09/2022 22:00	0	1.7	8.3	14.3	15.2	1,016,693.9	0.00	1.00
06/09/2022 23:00	1	1.9	9.9	13.6	18.6	1,027,443.5	0.00	1.00
Average/Sum#:	1	2.5	10.9	14.1	16.6	940,654.7	0.86 #	16.32 #
Minimum:	0	1.4	8.1	13.2	0.0	673,038.4	0.00	0.00
Maximum:	1	12.6	22.0	17.2	21.4	1,048,979.1	0.38	1.00
%SI	33.33	29.17	29.17	29.17	29.17	29.17	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
06/10/2022 00:00	0	1.8	9.2	13.9	17.5	1,035,871.7	0.00	1.00
06/10/2022 01:00	0	1.8	9.2	13.9	17.6	1,033,915.4	0.00	1.00
06/10/2022 02:00	0	1.7	9.4	14.0	18.0	1,047,312.0	0.00	1.00
06/10/2022 03:00	0	1.8	9.4	14.0	18.2	1,045,724.2	0.00	1.00
06/10/2022 04:00	0	1.8	9.2	14.0	17.9	1,044,930.3	0.00	1.00
06/10/2022 05:00	1	1.8	10.0	13.7	19.4	1,051,413.6	0.00	1.00
06/10/2022 06:00	0	1.7	8.5	14.2	16.2	1,028,294.6	0.00	1.00
06/10/2022 07:00	0	1.7	8.0	14.4	14.8	1,033,388.7	0.00	1.00
06/10/2022 08:00	0	1.6	7.9	14.4	14.6	1,028,332.4	0.00	1.00
06/10/2022 09:00	0	1.6	7.9	14.5	15.0	1,039,906.6	0.00	1.00
06/10/2022 10:00	0	1.7	8.0	14.3	15.1	1,019,391.2	0.00	1.00
06/10/2022 11:00	1	1.8	9.3	13.8	17.7	1,036,712.1	0.00	1.00
06/10/2022 12:00	1	1.8	10.4	13.3	21.1	1,027,068.3	0.00	1.00
06/10/2022 13:00	1	2.1	11.9	12.8	25.0	1,036,535.9	0.00	1.00
06/10/2022 14:00	2	2.2	12.7	12.2	31.0	1,036,355.2	0.00	1.00
06/10/2022 15:00	2	2.2	12.5	12.2	29.8	1,020,457.3	0.00	1.00
06/10/2022 16:00	0	1.8	8.9	14.0	16.2	992,733.4	0.00	1.00
06/10/2022 17:00	2	2.2	12.7	12.1	31.6	1,032,826.1	0.00	1.00
06/10/2022 18:00	2	2.3	12.4	12.1	30.0	1,029,091.3	0.00	1.00
06/10/2022 19:00	1	2.1	12.1	12.5	25.9	1,023,318.7	0.00	1.00
06/10/2022 20:00	1	2.0	10.9	13.2	20.7	1,037,383.4	0.00	1.00
06/10/2022 21:00	1	2.0	11.3	13.1	22.4	1,041,113.7	0.00	1.00
06/10/2022 22:00	0	1.7	8.7	14.2	14.8	1,017,257.5	0.08	1.00
06/10/2022 23:00	0	12.9	22.4	15.3	0.0	605,725.7	0.18	0.18
Average/Sum#:	1	2.3	10.5	13.6	19.6	1,014,377.5	0.26 #	23.18 #
Minimum:	0	1.6	7.9	12.1	0.0	605,725.7	0.00	0.18
Maximum:	2	12.9	22.4	15.3	31.6	1,051,413.6	0.18	1.00
%SI	4.17	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
06/11/2022 00:00	0	17.0	21.3	18.0	0.0	729,100.4	0.27	0.27
06/11/2022 01:00	1	3.1	13.9	14.6	20.9	664,931.6	0.42	1.00
06/11/2022 02:00	0	1.5	14.0	14.7	19.9	666,821.3	0.00	1.00
06/11/2022 03:00	1	1.6	13.8	14.7	19.7	667,925.7	0.00	1.00
06/11/2022 04:00	1	1.6	14.6	14.7	21.6	657,544.6	0.00	1.00
06/11/2022 05:00	1	1.6	14.8	14.7	21.6	657,765.5	0.00	1.00
06/11/2022 06:00	1	1.6	14.5	14.7	20.7	658,207.2	0.00	1.00
06/11/2022 07:00	1	1.6	14.2	14.7	20.6	656,661.1	0.00	1.00
06/11/2022 08:00	1	1.6	12.9	14.8	18.4	678,875.3	0.00	1.00
06/11/2022 09:00	0	1.5	11.4	14.7	15.0	679,852.9	0.00	1.00
06/11/2022 10:00	0	1.5	7.7	14.4	9.4	857,470.3	0.00	1.00
06/11/2022 11:00	0	1.5	7.7	14.4	12.1	907,823.0	0.00	1.00
06/11/2022 12:00	0	1.8	8.5	14.1	16.1	1,026,464.1	0.00	1.00
06/11/2022 13:00	1	2.1	11.3	12.9	23.6	1,027,239.5	0.00	1.00
06/11/2022 14:00	1	2.1	11.7	12.7	25.0	1,019,887.2	0.00	1.00
06/11/2022 15:00	1	2.1	11.3	12.8	23.8	1,020,643.8	0.00	1.00
06/11/2022 16:00	1	2.0	11.0	12.9	22.1	1,013,545.2	0.00	1.00
06/11/2022 17:00	1	2.2	11.6	12.4	26.2	1,021,590.6	0.00	1.00
06/11/2022 18:00	2	2.3	12.3	11.8	31.4	1,021,650.8	0.00	1.00
06/11/2022 19:00	2	2.3	12.2	11.9	30.9	1,025,851.0	0.00	1.00
06/11/2022 20:00	2	2.2	12.2	12.1	28.3	1,020,532.4	0.00	1.00
06/11/2022 21:00	2	2.2	12.2	12.2	28.8	1,032,420.1	0.00	1.00
06/11/2022 22:00	0	1.8	9.0	13.8	15.7	1,007,587.7	0.00	1.00
06/11/2022 23:00	0	1.7	7.8	14.2	12.9	926,303.2	0.00	1.00
Average/Sum#:	1	2.5	12.2	13.9	20.2	860,278.9	0.69 #	23.27 #
Minimum:	0	1.5	7.7	11.8	0.0	656,661.1	0.00	0.27
Maximum:	2	17.0	21.3	18.0	31.4	1,032,420.1	0.42	1.00
%SI	4.17	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
06/12/2022 00:00	1	1.9	10.2	13.4	20.6	1,045,875.0	0.00	1.00
06/12/2022 01:00	1	2.1	11.0	14.3	15.9	866,679.6	0.08	1.00
06/12/2022 02:00	0	13.7	31.5	17.0	0.0	450,856.6	0.05	0.05
06/12/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/12/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/12/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/12/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/12/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/12/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/12/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/12/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/12/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/12/2022 12:00	0	12.6	15.7	15.8	1.7	786,210.7	0.62	0.62
06/12/2022 13:00	0	1.6	8.3	14.3	16.6	1,010,884.2	0.07	1.00
06/12/2022 14:00	0	1.7	8.5	14.1	15.4	1,009,950.5	0.00	1.00
06/12/2022 15:00	0	1.8	9.1	14.0	16.6	1,029,846.8	0.00	1.00
06/12/2022 16:00	0	1.8	9.4	13.8	17.2	1,024,946.6	0.00	1.00
06/12/2022 17:00	0	1.8	9.5	13.8	17.9	1,034,204.7	0.00	1.00
06/12/2022 18:00	0	1.8	9.8	13.7	18.3	1,031,633.0	0.00	1.00
06/12/2022 19:00	0	1.8	9.2	14.0	17.6	1,039,968.7	0.00	1.00
06/12/2022 20:00	0	1.7	9.5	14.0	18.4	1,046,121.1	0.00	1.00
06/12/2022 21:00	0	1.7	9.3	14.1	18.2	1,048,213.8	0.00	1.00
06/12/2022 22:00	0	1.7	9.3	14.1	18.3	1,046,804.1	0.00	1.00
06/12/2022 23:00	1	2.0	12.5	14.5	19.0	849,471.1	0.08	1.00
Average/Sum#:	0	3.3	11.5	14.3	15.4	954,777.8	0.90 #	13.67 #
Minimum:	0	1.6	8.3	13.4	0.0	450,856.6	0.00	0.00
Maximum:	1	13.7	31.5	17.0	20.6	1,048,213.8	0.62	1.00
%SI	45.83	37.50	37.50	37.50	37.50	37.50	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
06/13/2022 00:00	0	7.6	32.8	17.1	0.0	513,534.1	0.03	0.03
06/13/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/13/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/13/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/13/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/13/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/13/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/13/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/13/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/13/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/13/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/13/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/13/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/13/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/13/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/13/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/13/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/13/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/13/2022 18:00	0	12.2	18.0	15.7	7.1	718,684.5	0.82	0.82
06/13/2022 19:00	0	1.5	11.0	14.4	18.2	948,905.8	0.08	1.00
06/13/2022 20:00	0	1.7	9.3	14.3	18.5	1,065,246.2	0.00	1.00
06/13/2022 21:00	1	2.9	16.7	14.7	18.7	721,598.3	0.13	0.80
06/13/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/13/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	5.2	17.6	15.2	12.5	793,593.8	1.06 #	3.65 #
Minimum:	0	1.5	9.3	14.3	0.0	513,534.1	0.00	0.00
Maximum:	1	12.2	32.8	17.1	18.7	1,065,246.2	0.82	1.00
%SI	87.50	79.17	79.17	79.17	79.17	79.17	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
06/14/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/14/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/14/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/14/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/14/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/14/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/14/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/14/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/14/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/14/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/14/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/14/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/14/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/14/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/14/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/14/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/14/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/14/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/14/2022 18:00	0	11.6	18.3	15.6	10.0	713,651.0	0.95	1.00
06/14/2022 19:00	0	1.5	9.1	14.4	16.5	1,043,922.7	0.00	1.00
06/14/2022 20:00	0	1.7	9.7	14.2	17.7	1,049,551.4	0.00	1.00
06/14/2022 21:00	0	1.7	9.0	14.4	15.5	926,995.0	0.00	1.00
06/14/2022 22:00	0	1.6	8.7	14.3	15.9	1,018,768.7	0.00	1.00
06/14/2022 23:00	0	1.7	9.7	14.0	19.2	1,055,647.6	0.00	1.00
Average/Sum#:	0	3.3	10.8	14.5	15.8	968,089.4	0.95 #	6.00 #
Minimum:	0	1.5	8.7	14.0	10.0	713,651.0	0.00	0.00
Maximum:	0	11.6	18.3	15.6	19.2	1,055,647.6	0.95	1.00
%SI	75.00	75.00	75.00	75.00	75.00	75.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
06/15/2022 00:00	1	1.8	9.8	14.0	19.7	1,060,013.9	0.00	1.00
06/15/2022 01:00	0	1.7	9.6	14.1	19.3	1,059,491.4	0.00	1.00
06/15/2022 02:00	0	1.8	8.5	14.4	14.5	1,009,581.8	0.00	1.00
06/15/2022 03:00	1	1.8	9.9	13.9	20.3	1,047,218.4	0.00	1.00
06/15/2022 04:00	1	2.0	12.1	13.2	25.4	1,080,778.2	0.00	1.00
06/15/2022 05:00	0	1.7	9.5	14.2	16.6	972,291.3	0.00	1.00
06/15/2022 06:00	1	1.7	12.3	14.5	20.0	770,515.2	0.00	1.00
06/15/2022 07:00	1	1.4	11.4	14.5	17.8	810,314.1	0.00	1.00
06/15/2022 08:00	1	1.6	15.7	14.8	22.5	666,752.5	0.00	1.00
06/15/2022 09:00	1	1.6	15.2	14.8	22.0	666,528.0	0.00	1.00
06/15/2022 10:00	0	1.5	14.1	14.8	19.6	671,915.9	0.00	1.00
06/15/2022 11:00	0	1.5	12.6	14.8	18.4	735,672.7	0.00	1.00
06/15/2022 12:00	0	1.6	7.8	14.5	11.3	983,417.9	0.00	1.00
06/15/2022 13:00	0	1.6	7.9	14.5	14.9	1,038,622.8	0.00	1.00
06/15/2022 14:00	0	1.7	9.6	14.4	21.1	1,102,070.6	0.00	1.00
06/15/2022 15:00	1	1.9	10.9	13.2	21.9	1,021,555.0	0.00	1.00
06/15/2022 16:00	1	1.9	10.3	13.6	20.1	1,041,512.9	0.00	1.00
06/15/2022 17:00	1	1.8	10.2	13.6	19.7	1,037,198.3	0.00	1.00
06/15/2022 18:00	1	1.8	9.7	13.9	18.6	1,049,174.7	0.00	1.00
06/15/2022 19:00	0	1.8	9.3	14.0	18.0	1,044,136.5	0.00	1.00
06/15/2022 20:00	0	1.7	9.3	14.1	18.5	1,057,679.0	0.00	1.00
06/15/2022 21:00	0	1.7	9.3	14.1	18.8	1,057,477.6	0.00	1.00
06/15/2022 22:00	1	1.7	9.2	14.1	18.6	1,054,658.2	0.00	1.00
06/15/2022 23:00	1	1.7	9.1	14.2	18.8	1,069,581.8	0.00	1.00
Average/Sum#:	1	1.7	10.6	14.2	19.0	962,839.9	0.00 #	24.00 #
Minimum:	0	1.4	7.8	13.2	11.3	666,528.0	0.00	1.00
Maximum:	1	2.0	15.7	14.8	25.4	1,102,070.6	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
06/16/2022 00:00	0	1.7	9.2	14.2	18.9	1,068,355.4	0.00	1.00
06/16/2022 01:00	0	1.7	9.1	14.2	18.9	1,068,355.4	0.00	1.00
06/16/2022 02:00	0	1.7	9.4	14.2	18.9	1,067,742.2	0.00	1.00
06/16/2022 03:00	0	1.7	9.3	14.2	19.3	1,069,786.2	0.00	1.00
06/16/2022 04:00	1	1.7	9.3	14.2	19.4	1,069,173.0	0.00	1.00
06/16/2022 05:00	0	1.7	11.4	14.2	16.6	852,313.4	0.00	1.00
06/16/2022 06:00	1	1.7	16.2	14.7	25.0	664,833.5	0.00	1.00
06/16/2022 07:00	1	1.6	15.5	14.7	23.3	665,496.1	0.00	1.00
06/16/2022 08:00	1	1.6	15.0	14.7	22.9	664,391.7	0.00	1.00
06/16/2022 09:00	1	1.6	15.1	14.8	22.5	669,222.0	0.00	1.00
06/16/2022 10:00	1	1.6	14.9	14.8	22.1	666,303.5	0.00	1.00
06/16/2022 11:00	0	1.4	12.4	14.7	17.7	749,870.3	0.00	1.00
06/16/2022 12:00	0	1.8	9.2	14.0	15.0	1,052,075.2	0.00	1.00
06/16/2022 13:00	1	1.9	10.8	13.4	21.2	1,055,369.7	0.00	1.00
06/16/2022 14:00	0	1.8	9.3	14.0	18.2	1,044,136.5	0.00	1.00
06/16/2022 15:00	0	1.8	9.4	14.0	18.5	1,047,113.5	0.00	1.00
06/16/2022 16:00	0	1.8	9.4	14.0	18.5	1,044,136.5	0.00	1.00
06/16/2022 17:00	0	1.7	8.4	14.3	15.4	993,870.1	0.00	1.00
06/16/2022 18:00	1	1.8	9.5	14.1	19.3	1,059,290.0	0.00	1.00
06/16/2022 19:00	0	1.7	9.4	14.2	18.9	1,057,522.7	0.00	1.00
06/16/2022 20:00	0	1.7	9.0	14.3	17.9	1,052,589.4	0.00	1.00
06/16/2022 21:00	0	1.7	9.4	14.2	19.3	1,070,399.3	0.00	1.00
06/16/2022 22:00	0	1.7	9.4	14.2	19.3	1,070,399.3	0.00	1.00
06/16/2022 23:00	1	1.7	9.4	14.2	19.5	1,070,194.9	0.00	1.00
Average/Sum#:	0	1.7	10.8	14.3	19.4	953,872.5	0.00 #	24.00 #
Minimum:	0	1.4	8.4	13.4	15.0	664,391.7	0.00	1.00
Maximum:	1	1.9	16.2	14.8	25.0	1,070,399.3	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
06/17/2022 00:00	0	1.7	9.3	14.2	19.3	1,066,311.5	0.00	1.00
06/17/2022 01:00	0	1.7	9.4	14.2	19.4	1,064,267.6	0.00	1.00
06/17/2022 02:00	0	1.7	9.8	14.2	19.7	1,063,245.6	0.00	1.00
06/17/2022 03:00	0	1.7	9.5	14.2	19.6	1,058,544.6	0.00	1.00
06/17/2022 04:00	1	1.8	10.3	13.9	21.6	1,074,215.6	0.00	1.00
06/17/2022 05:00	0	1.7	9.3	14.1	18.5	1,040,158.4	0.00	1.00
06/17/2022 06:00	1	1.8	12.8	14.5	23.6	773,082.9	0.00	1.00
06/17/2022 07:00	0	1.5	12.8	14.5	15.3	710,602.9	0.00	1.00
06/17/2022 08:00	1	1.7	16.4	14.7	27.2	667,042.2	0.00	1.00
06/17/2022 09:00	1	1.6	16.6	14.8	25.5	671,017.9	0.00	1.00
06/17/2022 10:00	1	1.6	14.5	14.7	22.6	676,981.6	0.00	1.00
06/17/2022 11:00	1	1.6	16.2	14.8	24.9	668,997.5	0.00	1.00
06/17/2022 12:00	1	1.6	16.2	14.8	24.8	667,201.5	0.00	1.00
06/17/2022 13:00	0	1.4	11.5	14.6	15.5	784,701.9	0.00	1.00
06/17/2022 14:00	0	1.6	11.2	14.6	15.8	695,363.3	0.00	1.00
06/17/2022 15:00	1	1.6	11.2	14.6	16.0	698,623.8	0.00	1.00
06/17/2022 16:00	1	1.6	11.3	14.6	16.4	698,189.1	0.00	1.00
06/17/2022 17:00	1	1.6	11.3	14.6	16.5	697,102.2	0.00	1.00
06/17/2022 18:00	1	1.6	11.6	14.6	16.9	696,450.1	0.00	1.00
06/17/2022 19:00	1	1.6	11.9	14.6	17.0	697,319.6	0.00	1.00
06/17/2022 20:00	1	1.6	12.1	14.6	17.6	697,971.7	0.00	1.00
06/17/2022 21:00	1	1.6	12.3	14.6	18.3	698,623.8	0.00	1.00
06/17/2022 22:00	1	1.6	13.6	14.6	20.7	686,885.9	0.00	1.00
06/17/2022 23:00	1	1.6	13.1	14.5	20.3	682,786.4	0.00	1.00
Average/Sum#:	1	1.6	12.3	14.5	19.7	788,987.0	0.00 #	24.00 #
Minimum:	0	1.4	9.3	13.9	15.3	667,042.2	0.00	1.00
Maximum:	1	1.8	16.6	14.8	27.2	1,074,215.6	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
06/18/2022 00:00	1	1.6	13.2	14.5	18.9	683,214.4	0.00	1.00
06/18/2022 01:00	1	1.7	13.0	14.5	19.8	683,214.4	0.00	1.00
06/18/2022 02:00	0	1.6	12.6	14.6	18.7	697,754.3	0.00	1.00
06/18/2022 03:00	1	1.8	14.8	14.6	21.1	683,625.3	0.00	1.00
06/18/2022 04:00	1	1.6	12.6	14.5	18.1	693,485.1	0.00	1.00
06/18/2022 05:00	1	1.7	13.8	14.6	20.7	692,537.5	0.00	1.00
06/18/2022 06:00	1	1.6	13.6	14.6	19.9	692,320.1	0.00	1.00
06/18/2022 07:00	1	1.6	13.0	14.6	18.6	693,189.6	0.00	1.00
06/18/2022 08:00	0	1.6	12.7	14.6	17.7	692,754.8	0.00	1.00
06/18/2022 09:00	0	1.6	12.3	14.6	17.1	692,972.2	0.00	1.00
06/18/2022 10:00	0	1.6	12.0	14.6	16.2	692,754.8	0.00	1.00
06/18/2022 11:00	0	1.6	11.8	14.6	16.4	694,928.5	0.00	1.00
06/18/2022 12:00	1	1.6	11.7	14.6	16.7	692,754.8	0.00	1.00
06/18/2022 13:00	0	1.6	11.7	14.7	16.6	703,044.8	0.00	1.00
06/18/2022 14:00	0	1.6	11.6	14.7	16.6	704,590.9	0.00	1.00
06/18/2022 15:00	1	1.6	11.4	14.7	16.3	705,916.2	0.00	1.00
06/18/2022 16:00	0	1.6	11.4	14.7	16.2	705,032.7	0.00	1.00
06/18/2022 17:00	0	1.6	11.4	14.7	16.3	705,695.3	0.00	1.00
06/18/2022 18:00	0	1.6	11.4	14.7	16.5	706,799.7	0.00	1.00
06/18/2022 19:00	1	1.6	11.3	14.6	16.4	696,232.7	0.00	1.00
06/18/2022 20:00	1	1.5	11.2	14.5	15.9	714,454.4	0.00	1.00
06/18/2022 21:00	0	1.5	12.0	14.6	15.3	708,405.4	0.00	1.00
06/18/2022 22:00	0	1.6	7.7	14.5	12.5	1,064,299.5	0.00	1.00
06/18/2022 23:00	1	1.6	11.2	14.5	17.8	779,288.1	0.00	1.00
Average/Sum#:	1	1.6	12.1	14.6	17.3	715,802.7	0.00 #	24.00 #
Minimum:	0	1.5	7.7	14.5	12.5	683,214.4	0.00	1.00
Maximum:	1	1.8	14.8	14.7	21.1	1,064,299.5	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
06/19/2022 00:00	0	1.5	11.9	14.5	16.3	712,100.7	0.00	1.00
06/19/2022 01:00	0	1.5	9.9	14.4	14.5	859,366.5	0.00	1.00
06/19/2022 02:00	1	1.6	11.1	14.5	16.7	747,620.1	0.00	1.00
06/19/2022 03:00	1	1.6	13.5	14.6	20.6	696,667.5	0.00	1.00
06/19/2022 04:00	1	1.6	13.4	14.6	19.4	698,189.1	0.00	1.00
06/19/2022 05:00	1	1.6	13.2	14.5	19.6	697,978.5	0.00	1.00
06/19/2022 06:00	1	1.6	13.2	14.6	18.8	695,580.6	0.00	1.00
06/19/2022 07:00	1	1.6	12.7	14.6	17.8	695,363.3	0.00	1.00
06/19/2022 08:00	0	1.6	12.1	14.6	15.8	697,319.6	0.00	1.00
06/19/2022 09:00	0	1.6	11.6	14.6	16.5	697,537.0	0.00	1.00
06/19/2022 10:00	0	1.6	11.3	14.6	16.0	697,102.2	0.00	1.00
06/19/2022 11:00	0	1.6	11.2	14.7	16.0	707,020.6	0.00	1.00
06/19/2022 12:00	0	1.6	11.2	14.7	15.9	705,032.7	0.00	1.00
06/19/2022 13:00	0	1.6	11.3	14.7	16.0	702,823.9	0.00	1.00
06/19/2022 14:00	0	1.6	11.4	14.7	16.3	697,743.8	0.00	1.00
06/19/2022 15:00	0	1.6	11.3	14.7	16.4	699,952.6	0.00	1.00
06/19/2022 16:00	0	1.6	11.1	14.7	15.8	701,940.4	0.00	1.00
06/19/2022 17:00	0	1.6	11.4	14.7	16.1	697,964.7	0.00	1.00
06/19/2022 18:00	0	1.6	11.5	14.7	16.3	696,197.7	0.00	1.00
06/19/2022 19:00	0	1.6	11.3	14.7	16.2	699,289.9	0.00	1.00
06/19/2022 20:00	1	1.5	10.5	14.6	14.3	754,487.6	0.00	1.00
06/19/2022 21:00	1	1.6	11.9	14.7	17.2	698,627.3	0.00	1.00
06/19/2022 22:00	1	1.6	11.4	14.6	16.2	698,189.1	0.00	1.00
06/19/2022 23:00	1	1.6	11.4	14.6	16.2	695,798.0	0.00	1.00
Average/Sum#:	0	1.6	11.7	14.6	16.7	710,412.2	0.00 #	24.00 #
Minimum:	0	1.5	9.9	14.4	14.3	695,363.3	0.00	1.00
Maximum:	1	1.6	13.5	14.7	20.6	859,366.5	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
06/20/2022 00:00	1	1.6	11.7	14.6	16.6	695,363.3	0.00	1.00
06/20/2022 01:00	0	1.6	11.9	14.6	16.5	695,145.9	0.00	1.00
06/20/2022 02:00	0	1.5	12.2	14.6	17.0	696,232.7	0.00	1.00
06/20/2022 03:00	0	1.6	12.7	14.6	18.4	696,015.4	0.00	1.00
06/20/2022 04:00	0	1.6	11.7	14.5	15.8	724,297.1	0.00	1.00
06/20/2022 05:00	1	1.5	12.3	14.5	16.4	699,262.3	0.00	1.00
06/20/2022 06:00	0	1.5	11.9	14.5	15.6	698,406.4	0.00	1.00
06/20/2022 07:00	0	1.6	12.0	14.6	16.1	695,363.3	0.00	1.00
06/20/2022 08:00	0	1.6	11.8	14.6	16.4	694,711.2	0.00	1.00
06/20/2022 09:00	0	1.6	11.3	14.7	15.6	706,357.9	0.00	1.00
06/20/2022 10:00	0	1.6	11.1	14.7	15.6	707,020.6	0.00	1.00
06/20/2022 11:00	0	1.6	11.0	14.7	15.5	706,357.9	0.00	1.00
06/20/2022 12:00	1	1.5	10.6	14.6	14.5	734,272.3	0.00	1.00
06/20/2022 13:00	0	1.5	10.6	14.6	13.5	792,961.9	0.00	1.00
06/20/2022 14:00	1	1.8	9.6	14.5	14.5	871,938.2	0.00	1.00
06/20/2022 15:00	0	1.7	9.7	13.7	15.3	940,718.5	0.00	1.00
06/20/2022 16:00	1	2.2	13.0	12.3	29.3	1,047,291.2	0.00	1.00
06/20/2022 17:00	0	2.0	10.8	13.4	19.4	1,037,475.9	0.00	1.00
06/20/2022 18:00	1	2.2	11.0	13.4	20.1	1,050,622.4	0.00	1.00
06/20/2022 19:00	0	2.1	10.2	13.7	18.2	1,053,125.4	0.00	1.00
06/20/2022 20:00	0	2.1	9.8	13.8	17.5	1,047,706.1	0.00	1.00
06/20/2022 21:00	0	2.0	9.6	13.9	17.2	1,055,826.2	0.00	1.00
06/20/2022 22:00	1	2.5	11.3	14.5	13.3	886,488.3	0.12	1.00
06/20/2022 23:00	0	14.9	28.2	17.6	0.0	264,755.4	0.02	0.02
Average/Sum#:	0	2.3	11.9	14.4	16.2	799,904.8	0.14 #	23.02 #
Minimum:	0	1.5	9.6	12.3	0.0	264,755.4	0.00	0.02
Maximum:	1	14.9	28.2	17.6	29.3	1,055,826.2	0.12	1.00
%SI	4.17	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
06/21/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/21/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/21/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/21/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/21/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/21/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/21/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/21/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/21/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/21/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/21/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/21/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/21/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/21/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/21/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/21/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/21/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/21/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/21/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/21/2022 19:00	0	13.3	16.9	16.1	0.0	861,881.5	0.60	0.60
06/21/2022 20:00	0	2.3	9.0	14.2	15.9	1,008,059.9	0.45	1.00
06/21/2022 21:00	1	2.1	11.2	13.5	19.7	1,051,680.9	0.00	1.00
06/21/2022 22:00	0	1.9	9.9	13.9	18.0	1,033,132.9	0.00	1.00
06/21/2022 23:00	0	1.9	9.8	14.0	18.0	1,044,533.4	0.00	1.00
Average/Sum#:	0	4.3	11.4	14.3	14.3	999,857.7	1.05 #	4.60 #
Minimum:	0	1.9	9.0	13.5	0.0	861,881.5	0.00	0.00
Maximum:	1	13.3	16.9	16.1	19.7	1,051,680.9	0.60	1.00
%SI	83.33	79.17	79.17	79.17	79.17	79.17	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
06/22/2022 00:00	0	1.9	9.6	14.0	18.0	1,043,938.0	0.00	1.00
06/22/2022 01:00	0	1.9	9.4	14.0	17.6	1,041,357.9	0.00	1.00
06/22/2022 02:00	0	1.6	8.7	14.3	15.3	995,115.1	0.00	1.00
06/22/2022 03:00	0	1.8	9.6	14.1	18.4	1,043,984.7	0.00	1.00
06/22/2022 04:00	0	1.8	9.2	14.3	17.3	1,043,252.4	0.00	1.00
06/22/2022 05:00	1	1.7	12.4	14.5	20.7	827,859.8	0.00	1.00
06/22/2022 06:00	1	1.7	15.8	14.8	22.3	666,079.0	0.00	1.00
06/22/2022 07:00	1	1.7	15.2	14.8	21.4	663,834.1	0.00	1.00
06/22/2022 08:00	1	1.6	14.7	14.8	20.6	662,038.1	0.00	1.00
06/22/2022 09:00	0	1.6	13.7	14.9	18.8	671,702.7	0.00	1.00
06/22/2022 10:00	0	1.6	12.6	14.9	17.1	670,789.7	0.00	1.00
06/22/2022 11:00	0	1.6	12.7	14.9	17.3	671,246.2	0.00	1.00
06/22/2022 12:00	0	1.6	11.8	14.9	15.9	671,017.9	0.00	1.00
06/22/2022 13:00	1	1.5	10.9	14.8	15.5	706,263.8	0.00	1.00
06/22/2022 14:00	0	1.5	10.6	14.7	12.1	741,477.0	0.00	1.00
06/22/2022 15:00	1	1.6	11.7	14.7	18.6	686,258.3	0.00	1.00
06/22/2022 16:00	0	1.6	11.9	14.9	14.8	670,561.5	0.00	1.00
06/22/2022 17:00	0	1.6	12.1	14.9	16.9	671,017.9	0.00	1.00
06/22/2022 18:00	1	1.6	12.7	14.9	18.0	671,017.9	0.00	1.00
06/22/2022 19:00	1	1.6	12.8	14.9	17.7	674,441.5	0.00	1.00
06/22/2022 20:00	0	1.6	7.5	14.5	5.1	881,566.9	0.00	1.00
06/22/2022 21:00	0	1.8	7.8	14.3	11.8	969,386.5	0.00	1.00
06/22/2022 22:00	0	1.6	7.4	14.5	13.4	1,028,780.1	0.00	1.00
06/22/2022 23:00	0	1.8	9.3	14.0	17.7	1,037,388.6	0.00	1.00
Average/Sum#:	0	1.7	11.3	14.6	16.8	808,765.7	0.00 #	24.00 #
Minimum:	0	1.5	7.4	14.0	5.1	662,038.1	0.00	1.00
Maximum:	1	1.9	15.8	14.9	22.3	1,043,984.7	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
06/23/2022 00:00	1	1.8	9.8	13.8	19.1	1,040,183.9	0.00	1.00
06/23/2022 01:00	1	1.7	9.4	14.2	17.9	943,267.7	0.00	1.00
06/23/2022 02:00	2	5.8	16.3	15.3	12.5	596,188.7	0.13	0.25
06/23/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/23/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/23/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/23/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/23/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/23/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/23/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/23/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/23/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/23/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/23/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/23/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/23/2022 15:00	0	0.0	0.0	20.9	0.0	0.0	0.02	0.02
06/23/2022 16:00	1	8.7	14.3	15.4	9.9	698,157.4	0.78	1.00
06/23/2022 17:00	0	1.6	8.8	14.1	10.5	930,000.3	0.00	1.00
06/23/2022 18:00	1	2.5	11.2	12.5	23.5	977,345.1	0.00	1.00
06/23/2022 19:00	1	2.3	12.4	12.4	28.2	1,034,801.5	0.00	1.00
06/23/2022 20:00	1	2.1	11.9	12.6	27.1	1,036,142.8	0.00	1.00
06/23/2022 21:00	1	1.9	10.1	13.6	18.9	1,036,260.3	0.00	1.00
06/23/2022 22:00	0	1.8	9.3	13.9	18.0	1,032,937.2	0.00	1.00
06/23/2022 23:00	1	1.8	9.2	14.0	18.3	1,046,518.1	0.00	1.00
Average/Sum#:	1	2.7	10.2	14.4	17.0	864,316.9	0.93 #	10.27 #
Minimum:	0	0.0	0.0	12.4	0.0	0.0	0.00	0.00
Maximum:	2	8.7	16.3	20.9	28.2	1,046,518.1	0.78	1.00
%SI	54.17	50.00	50.00	50.00	50.00	50.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
06/24/2022 00:00	1	1.8	9.3	14.0	18.6	1,046,915.0	0.00	1.00
06/24/2022 01:00	1	1.8	9.2	14.0	18.6	1,047,907.4	0.00	1.00
06/24/2022 02:00	0	1.7	9.1	14.1	17.6	1,025,457.2	0.00	1.00
06/24/2022 03:00	0	1.6	10.5	14.3	15.4	778,704.5	0.00	1.00
06/24/2022 04:00	1	1.8	9.0	14.1	18.6	1,061,706.7	0.00	1.00
06/24/2022 05:00	1	1.6	10.9	14.4	20.4	855,152.9	0.00	1.00
06/24/2022 06:00	1	1.6	14.4	14.7	21.7	664,612.6	0.00	1.00
06/24/2022 07:00	1	1.6	14.2	14.8	21.4	669,222.0	0.00	1.00
06/24/2022 08:00	1	1.6	13.8	14.8	20.9	668,997.5	0.00	1.00
06/24/2022 09:00	1	1.5	13.1	14.8	20.0	670,344.5	0.00	1.00
06/24/2022 10:00	0	1.3	9.0	14.6	8.8	762,312.9	0.00	1.00
06/24/2022 11:00	0	1.6	7.5	14.4	9.3	920,253.2	0.00	1.00
06/24/2022 12:00	0	1.7	7.7	14.4	14.7	1,019,905.1	0.00	1.00
06/24/2022 13:00	0	1.7	7.8	14.3	15.4	987,230.5	0.00	1.00
06/24/2022 14:00	1	2.0	10.9	13.1	23.9	1,039,006.9	0.00	1.00
06/24/2022 15:00	1	2.0	10.9	13.1	23.9	1,030,052.9	0.00	1.00
06/24/2022 16:00	1	1.9	10.3	13.4	21.5	994,749.9	0.00	1.00
06/24/2022 17:00	2	2.3	12.5	12.2	31.6	1,038,873.7	0.00	1.00
06/24/2022 18:00	1	2.1	11.7	12.8	25.9	1,041,438.8	0.00	1.00
06/24/2022 19:00	1	2.1	12.0	12.7	27.0	1,042,098.6	0.00	1.00
06/24/2022 20:00	1	1.9	9.9	13.6	19.3	1,038,136.2	0.00	1.00
06/24/2022 21:00	0	1.8	9.3	13.8	17.5	1,032,661.7	0.00	1.00
06/24/2022 22:00	1	1.9	9.7	13.6	19.9	1,040,762.5	0.00	1.00
06/24/2022 23:00	1	1.8	9.1	13.9	17.9	1,037,632.4	0.00	1.00
Average/Sum#:	1	1.8	10.5	13.9	19.6	938,089.0	0.00 #	24.00 #
Minimum:	0	1.3	7.5	12.2	8.8	664,612.6	0.00	1.00
Maximum:	2	2.3	14.4	14.8	31.6	1,061,706.7	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
06/25/2022 00:00	0	1.7	8.1	14.3	15.8	1,016,901.3	0.00	1.00
06/25/2022 01:00	1	2.0	11.3	13.0	25.2	1,055,496.8	0.00	1.00
06/25/2022 02:00	0	1.8	9.0	14.2	17.0	1,025,228.8	0.00	1.00
06/25/2022 03:00	0	1.7	8.5	14.4	17.7	1,054,456.8	0.00	1.00
06/25/2022 04:00	0	1.7	8.2	14.4	16.1	1,034,231.4	0.00	1.00
06/25/2022 05:00	1	1.7	11.0	14.5	20.2	871,510.2	0.00	1.00
06/25/2022 06:00	1	1.7	15.1	14.8	22.7	673,936.4	0.00	1.00
06/25/2022 07:00	1	1.7	15.1	14.8	22.8	664,956.6	0.00	1.00
06/25/2022 08:00	1	1.7	14.6	14.8	22.0	664,058.6	0.00	1.00
06/25/2022 09:00	1	1.7	14.1	14.8	21.3	663,160.6	0.00	1.00
06/25/2022 10:00	1	1.6	13.3	14.8	19.6	662,487.1	0.00	1.00
06/25/2022 11:00	1	1.7	12.6	14.9	18.4	672,615.6	0.00	1.00
06/25/2022 12:00	0	1.6	10.4	14.8	13.5	684,712.2	0.00	1.00
06/25/2022 13:00	1	1.6	11.0	14.9	16.1	677,408.6	0.00	1.00
06/25/2022 14:00	0	1.6	10.4	14.8	14.1	684,712.2	0.00	1.00
06/25/2022 15:00	0	1.6	10.6	14.8	14.5	676,181.4	0.00	1.00
06/25/2022 16:00	0	1.5	9.6	14.7	11.5	708,566.7	0.00	1.00
06/25/2022 17:00	0	1.9	8.9	13.9	15.3	1,021,981.9	0.00	1.00
06/25/2022 18:00	1	2.1	11.0	13.1	22.4	1,036,548.9	0.00	1.00
06/25/2022 19:00	1	2.0	9.8	13.7	19.0	1,045,897.9	0.00	1.00
06/25/2022 20:00	1	2.0	9.7	13.7	18.5	1,043,425.3	0.00	1.00
06/25/2022 21:00	1	1.7	8.6	14.3	14.9	920,211.7	0.00	1.00
06/25/2022 22:00	1	1.6	10.3	14.6	15.1	770,355.6	0.00	1.00
06/25/2022 23:00	1	1.7	11.0	14.7	16.1	701,940.4	0.00	1.00
Average/Sum#:	1	1.7	10.9	14.4	17.9	834,624.3	0.00 #	24.00 #
Minimum:	0	1.5	8.1	13.0	11.5	662,487.1	0.00	1.00
Maximum:	1	2.1	15.1	14.9	25.2	1,055,496.8	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
06/26/2022 00:00	1	1.7	11.2	14.6	16.8	691,015.9	0.00	1.00
06/26/2022 01:00	1	1.6	10.0	14.5	14.6	769,659.3	0.00	1.00
06/26/2022 02:00	0	1.7	9.6	14.5	11.2	796,191.9	0.00	1.00
06/26/2022 03:00	1	1.7	11.1	14.5	14.3	715,096.3	0.00	1.00
06/26/2022 04:00	0	1.6	7.9	14.4	12.0	961,335.9	0.00	1.00
06/26/2022 05:00	1	1.7	9.0	14.4	15.9	934,158.1	0.00	1.00
06/26/2022 06:00	0	1.7	11.5	14.6	15.5	693,624.3	0.00	1.00
06/26/2022 07:00	1	1.7	11.0	14.6	15.7	694,059.1	0.00	1.00
06/26/2022 08:00	1	1.7	10.7	14.6	15.3	694,928.5	0.00	1.00
06/26/2022 09:00	0	1.6	9.9	14.6	12.9	741,010.7	0.00	1.00
06/26/2022 10:00	1	1.7	10.5	14.5	17.5	789,986.7	0.00	1.00
06/26/2022 11:00	1	1.6	13.5	14.9	20.2	673,528.6	0.00	1.00
06/26/2022 12:00	1	1.6	12.1	14.9	17.5	672,159.1	0.00	1.00
06/26/2022 13:00	1	1.6	10.8	14.9	15.5	683,571.0	0.00	1.00
06/26/2022 14:00	1	1.6	10.7	14.9	15.5	676,267.4	0.00	1.00
06/26/2022 15:00	1	1.6	10.4	14.8	14.5	677,977.3	0.00	1.00
06/26/2022 16:00	0	1.7	9.1	14.2	13.2	864,985.7	0.00	1.00
06/26/2022 17:00	0	1.9	9.4	13.8	17.8	1,026,682.5	0.00	1.00
06/26/2022 18:00	1	2.3	12.2	12.4	28.0	1,038,184.8	0.00	1.00
06/26/2022 19:00	1	1.9	9.7	13.8	18.5	1,047,320.3	0.00	1.00
06/26/2022 20:00	0	1.9	9.0	14.0	17.5	1,046,518.1	0.00	1.00
06/26/2022 21:00	1	1.8	9.1	14.2	17.2	920,989.0	0.00	1.00
06/26/2022 22:00	1	5.2	21.2	15.3	11.7	614,040.1	0.13	0.30
06/26/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	1	1.9	10.9	14.4	16.0	801,012.6	0.13 #	22.30 #
Minimum:	0	1.6	7.9	12.4	11.2	614,040.1	0.00	0.00
Maximum:	1	5.2	21.2	15.3	28.0	1,047,320.3	0.13	1.00
%SI	4.17	4.17	4.17	4.17	4.17	4.17	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
06/27/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/27/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/27/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/27/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/27/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/27/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/27/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/27/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/27/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/27/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/27/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/27/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/27/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/27/2022 13:00	2	11.1	16.6	15.6	8.3	699,956.7	0.83	0.92
06/27/2022 14:00	0	1.5	8.1	14.5	10.6	930,780.6	0.00	1.00
06/27/2022 15:00	1	1.9	9.7	13.9	18.0	1,033,915.4	0.00	1.00
06/27/2022 16:00	1	1.9	9.5	13.9	18.6	1,034,697.9	0.00	1.00
06/27/2022 17:00	1	2.0	10.1	13.6	20.4	1,037,948.6	0.00	1.00
06/27/2022 18:00	1	2.2	11.2	13.0	23.3	1,032,962.0	0.00	1.00
06/27/2022 19:00	1	2.0	9.5	13.7	18.1	1,030,682.0	0.00	1.00
06/27/2022 20:00	1	1.9	9.2	13.8	17.6	1,031,697.3	0.00	1.00
06/27/2022 21:00	0	1.9	9.1	13.9	16.2	1,013,960.9	0.00	1.00
06/27/2022 22:00	1	2.9	15.3	14.8	17.6	678,875.3	0.13	0.80
06/27/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	1	2.9	10.8	14.1	16.9	952,547.7	0.96 #	9.72 #
Minimum:	0	1.5	8.1	13.0	8.3	678,875.3	0.00	0.00
Maximum:	2	11.1	16.6	15.6	23.3	1,037,948.6	0.83	1.00
%SI	58.33	58.33	58.33	58.33	58.33	58.33	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
06/28/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/28/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/28/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/28/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/28/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/28/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/28/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/28/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/28/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/28/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/28/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/28/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/28/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/28/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/28/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/28/2022 15:00	0	16.0	20.7	19.0	0.0	724,353.4	0.18	0.18
06/28/2022 16:00	0	7.0	14.6	14.7	12.5	693,988.9	0.70	1.00
06/28/2022 17:00	0	1.7	9.4	14.3	14.9	943,242.9	0.00	1.00
06/28/2022 18:00	0	1.9	9.4	13.9	17.5	1,034,111.0	0.00	1.00
06/28/2022 19:00	0	1.9	9.2	14.0	17.7	1,042,151.8	0.00	1.00
06/28/2022 20:00	0	1.8	8.7	14.2	15.3	951,034.6	0.00	1.00
06/28/2022 21:00	1	3.5	16.7	14.8	15.3	709,182.2	0.13	0.52
06/28/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/28/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	4.8	12.7	15.0	13.3	871,152.1	1.01 #	5.70 #
Minimum:	0	1.7	8.7	13.9	0.0	693,988.9	0.00	0.00
Maximum:	1	16.0	20.7	19.0	17.7	1,042,151.8	0.70	1.00
%SI	75.00	70.83	70.83	70.83	70.83	70.83	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
06/29/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/29/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/29/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/29/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/29/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/29/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/29/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/29/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/29/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/29/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/29/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/29/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/29/2022 12:00	0	10.7	16.0	15.5	6.8	700,435.2	0.98	1.00
06/29/2022 13:00	0	1.8	8.6	14.3	13.9	933,076.0	0.00	1.00
06/29/2022 14:00	1	1.9	9.6	13.9	18.5	1,037,241.2	0.00	1.00
06/29/2022 15:00	1	1.9	9.6	13.9	18.3	1,035,089.2	0.00	1.00
06/29/2022 16:00	0	1.9	9.5	13.9	17.9	1,033,524.1	0.00	1.00
06/29/2022 17:00	0	1.9	9.5	13.9	17.8	1,034,306.7	0.00	1.00
06/29/2022 18:00	1	1.9	9.6	13.8	18.4	1,043,462.8	0.00	1.00
06/29/2022 19:00	1	2.0	9.9	13.6	19.7	1,043,013.6	0.00	1.00
06/29/2022 20:00	1	2.0	9.8	13.7	19.2	1,052,174.4	0.00	1.00
06/29/2022 21:00	1	1.9	9.3	13.9	18.9	1,051,131.0	0.00	1.00
06/29/2022 22:00	1	1.8	9.0	14.1	18.6	1,056,067.9	0.00	1.00
06/29/2022 23:00	1	2.1	11.2	13.2	23.9	1,072,063.7	0.00	1.00
Average/Sum#:	1	2.7	10.1	14.0	17.7	1,007,632.2	0.98 #	12.00 #
Minimum:	0	1.8	8.6	13.2	6.8	700,435.2	0.00	0.00
Maximum:	1	10.7	16.0	15.5	23.9	1,072,063.7	0.98	1.00
%SI	50.00	50.00	50.00	50.00	50.00	50.00	0.00	0.00

NH3 Slip Daily Summary

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:54 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10

	Unit CT2 NH3Slip, Ppmvdc 1 Hour(s)	Unit CT2 NOx, Ppm 1 Hour(s)	Unit CT2 NOx, _SCR, Ppm 1 Hour(s)	Unit CT2 O2, Dry, Pct 1 Hour(s)	Unit CT2 NH3Inj, LbPerHr 1 Hour(s)	Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s)	Unit CT2 SUSD, Hr 1 Hour(s)	Unit CT2 OperatingTime, Hr 1 Hour(s)
06/30/2022 00:00	1	3.3	11.8	14.5	14.5	899,540.6	0.13	0.88
06/30/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/30/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/30/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/30/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/30/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/30/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/30/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/30/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/30/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/30/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/30/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/30/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/30/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
06/30/2022 14:00	2	12.4	17.5	15.3	9.9	656,590.1	0.87	0.95
06/30/2022 15:00	2	0.5	8.7	14.4	21.4	972,080.6	0.00	1.00
06/30/2022 16:00	0	1.8	9.3	13.9	13.3	1,038,610.6	0.00	1.00
06/30/2022 17:00	1	1.8	9.5	13.8	18.4	1,042,884.2	0.00	1.00
06/30/2022 18:00	1	2.1	11.4	12.8	25.7	1,047,525.1	0.00	1.00
06/30/2022 19:00	2	2.3	12.7	12.0	32.5	1,051,687.2	0.00	1.00
06/30/2022 20:00	1	1.8	10.1	13.6	19.8	1,050,892.5	0.00	1.00
06/30/2022 21:00	1	1.7	8.9	14.1	18.1	1,053,651.2	0.00	1.00
06/30/2022 22:00	0	1.7	8.4	14.2	15.3	986,189.9	0.00	1.00
06/30/2022 23:00	2	3.1	15.9	14.8	17.9	707,161.8	0.13	0.52
Average/Sum#:	1	3.0	11.3	13.9	18.8	955,164.9	1.13 #	10.35 #
Minimum:	0	0.5	8.4	12.0	9.9	656,590.1	0.00	0.00
Maximum:	2	12.4	17.5	15.3	32.5	1,053,651.2	0.87	1.00
%SI	54.17	54.17	54.17	54.17	54.17	54.17	0.00	0.00

ATTACHMENT 15

AQ-55

AQ-55 The emissions rates from each gas turbine and heat recovery steam generator exhaust during startup and shutdown shall not exceed the following:

Turbine emissions limitations during Startup and Shutdown		
Pollutant	**Max Lbs/ Hr (worst case turbine**	**Pounds per Startup or Shutdown (both turbines combined)**
NOx	**37.1**	**122.8**
CO	**89.5**	**204.8**

Verification: The Project owner shall include all necessary emissions data to demonstrate compliance with the emissions limits provided in this Condition as part of the Quarterly Air Quality Report required in Condition of Certification AQ-SC6.

Monthly Summary By Day Report

Units CT1 and CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/07/2022 20:28 **Location:** Roseville, CA

Red = Invalid Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Limit Value:

	Units CT1 & CT2 CO, Lb 1 Hour(s)	Units CT1 & CT2 NOx, Lb 1 Hour(s)	Units CT1 & CT2 SO2, Lb 1 Hour(s)	Units CT1 & CT2 PM10, Lb 1 Hour(s)	Units CT1 & CT2 VOC, Lb 1 Hour(s)
04/01/2022	0.00	0.00	0.00	0.00	0.00
04/02/2022	0.00	0.00	0.00	0.00	0.00
04/03/2022	0.00	0.00	0.00	0.00	0.00
04/04/2022	0.00	0.00	0.00	0.00	0.00
04/05/2022	0.00	0.00	0.00	0.00	0.00
04/06/2022	0.00	0.00	0.00	0.00	0.00
04/07/2022	0.00	0.00	0.00	0.00	0.00
04/08/2022	0.00	0.00	0.00	0.00	0.00
04/09/2022	0.00	0.00	0.00	0.00	0.00
04/10/2022	0.00	0.00	0.00	0.00	0.00
04/11/2022	0.00	0.00	0.00	0.00	0.00
04/12/2022	0.00	0.00	0.00	0.00	0.00
04/13/2022	0.00	0.00	0.00	0.00	0.00
04/14/2022	0.00	0.00	0.00	0.00	0.00
04/15/2022	0.00	0.00	0.00	0.00	0.00
04/16/2022	0.00	0.00	0.00	0.00	0.00
04/17/2022	0.00	0.00	0.00	0.00	0.00
04/18/2022	0.00	0.00	0.00	0.00	0.00
04/19/2022	0.00	0.00	0.00	0.00	0.00
04/20/2022	0.00	0.00	0.00	0.00	0.00
04/21/2022	0.00	0.00	0.00	0.00	0.00
04/22/2022	0.00	0.00	0.00	0.00	0.00
04/23/2022	0.00	0.00	0.00	0.00	0.00
04/24/2022	0.00	0.00	0.00	0.00	0.00
04/25/2022	0.00	0.00	0.00	0.00	0.00
04/26/2022	262.54	37.61	2.20	4.44	7.40
04/27/2022	80.04	42.60	2.73	5.46	9.11
04/28/2022	433.35	48.04	1.82	3.67	6.09
04/29/2022	79.88	18.11	2.13	4.24	7.10
04/30/2022	0.00	0.00	0.00	0.00	0.00
Monthly Avg/Sum*:	855.81 *	146.36 *	8.88 *	17.81 *	29.70 *
Daily Min:	79.88	18.11	1.82	3.67	6.09
Daily Max:	433.35	48.04	2.73	5.46	9.11
Apr 2022 - Apr 2022	855.81	146.36	8.88	17.81	29.70
QTD:	855.81 *	146.36 *	8.88 *	17.81 *	29.70 *
YTD 2022:	4,901.62 *	5,903.34 *	609.85 *	1,220.45 *	2,034.49 *

Monthly Summary By Day Report

Units CT1 and CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/07/2022 20:28 **Location:** Roseville, CA

Red = Invalid Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Limit Value:

	Units CT1 & CT2 CO, Lb 1 Hour(s)	Units CT1 & CT2 NOx, Lb 1 Hour(s)	Units CT1 & CT2 SO2, Lb 1 Hour(s)	Units CT1 & CT2 PM10, Lb 1 Hour(s)	Units CT1 & CT2 VOC, Lb 1 Hour(s)
05/01/2022	52.77	40.13	3.31	6.59	11.01
05/02/2022	10.05	42.75	4.62	9.28	15.43
05/03/2022	90.10	21.95	0.64	1.29	2.14
05/04/2022	31.54	103.16	11.32	22.64	37.79
05/05/2022	29.70	89.84	10.06	20.15	33.53
05/06/2022	49.56	111.47	12.17	24.38	40.70
05/07/2022	48.59	86.19	8.41	16.75	27.98
05/08/2022	75.95	72.52	7.47	14.97	24.97
05/09/2022	41.13	57.60	6.11	12.23	20.36
05/10/2022	0.00	0.00	0.00	0.00	0.00
05/11/2022	0.00	0.00	0.00	0.00	0.00
05/12/2022	0.00	0.00	0.00	0.00	0.00
05/13/2022	0.00	0.00	0.00	0.00	0.00
05/14/2022	0.00	0.00	0.00	0.00	0.00
05/15/2022	0.00	0.00	0.00	0.00	0.00
05/16/2022	0.00	0.00	0.00	0.00	0.00
05/17/2022	101.23	54.71	4.07	8.14	13.53
05/18/2022	34.03	134.56	14.78	29.54	49.21
05/19/2022	117.78	87.91	9.04	18.14	30.19
05/20/2022	0.00	0.00	0.00	0.00	0.00
05/21/2022	0.00	0.00	0.00	0.00	0.00
05/22/2022	0.00	0.00	0.00	0.00	0.00
05/23/2022	0.00	0.00	0.00	0.00	0.00
05/24/2022	112.73	120.89	10.86	21.71	36.22
05/25/2022	28.34	131.48	14.17	28.39	47.29
05/26/2022	64.56	29.36	2.16	4.31	7.19
05/27/2022	0.00	0.00	0.00	0.00	0.00
05/28/2022	0.00	0.00	0.00	0.00	0.00
05/29/2022	0.00	0.00	0.00	0.00	0.00
05/30/2022	0.00	0.00	0.00	0.00	0.00
05/31/2022	0.00	0.00	0.00	0.00	0.00
Monthly Avg/Sum*:	888.06 *	1,184.52 *	119.19 *	238.51 *	397.54 *
Daily Min:	10.05	21.95	0.64	1.29	2.14
Daily Max:	117.78	134.56	14.78	29.54	49.21
Apr 2022 - May 2022	1,743.87	1,330.88	128.07	256.32	427.24
QTD:	1,743.87 *	1,330.88 *	128.07 *	256.32 *	427.24 *
YTD 2022:	5,789.68 *	7,087.86 *	729.04 *	1,458.96 *	2,432.03 *

Monthly Summary By Day Report

Units CT1 and CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/07/2022 20:28 **Location:** Roseville, CA

Red = Invalid Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Limit Value:

	Units CT1 & CT2 CO, Lb 1 Hour(s)	Units CT1 & CT2 NOx, Lb 1 Hour(s)	Units CT1 & CT2 SO2, Lb 1 Hour(s)	Units CT1 & CT2 PM10, Lb 1 Hour(s)	Units CT1 & CT2 VOC, Lb 1 Hour(s)
06/01/2022	0.00	0.00	0.00	0.00	0.00
06/02/2022	0.00	0.00	0.00	0.00	0.00
06/03/2022	0.00	0.00	0.00	0.00	0.00
06/04/2022	0.00	0.00	0.00	0.00	0.00
06/05/2022	0.00	0.00	0.00	0.00	0.00
06/06/2022	21.75	20.16	1.18	2.37	3.94
06/07/2022	21.08	0.22	1.91	3.81	6.36
06/08/2022	104.69	97.26	8.63	17.27	28.80
06/09/2022	103.92	107.30	10.99	21.99	36.68
06/10/2022	56.87	142.56	15.27	30.57	50.98
06/11/2022	52.50	123.61	12.90	25.77	42.96
06/12/2022	72.06	103.37	10.25	20.49	34.15
06/13/2022	77.17	63.42	5.64	11.29	18.84
06/14/2022	53.63	69.57	6.57	13.13	21.91
06/15/2022	47.74	123.31	13.33	26.63	44.42
06/16/2022	53.84	119.68	13.02	25.95	43.22
06/17/2022	48.67	77.86	8.41	16.84	28.05
06/18/2022	10.65	43.83	4.72	9.45	15.84
06/19/2022	11.96	42.94	4.67	9.37	15.63
06/20/2022	80.89	90.14	8.25	16.49	27.58
06/21/2022	56.60	73.67	6.38	12.74	21.27
06/22/2022	35.35	101.12	10.46	21.00	35.08
06/23/2022	71.52	100.25	9.40	18.72	31.26
06/24/2022	38.94	124.71	13.61	27.21	45.35
06/25/2022	47.48	105.25	10.82	21.69	36.14
06/26/2022	73.45	90.00	8.34	16.64	27.78
06/27/2022	67.61	91.51	8.22	16.43	27.38
06/28/2022	47.37	72.96	6.44	12.85	21.44
06/29/2022	58.13	108.51	10.00	19.97	33.37
06/30/2022	119.87	94.92	9.08	18.18	30.30
Monthly Avg/Sum*:	1,433.74 *	2,188.13 *	218.49 *	436.85 *	728.73 *
Daily Min:	10.65	0.22	1.18	2.37	3.94
Daily Max:	119.87	142.56	15.27	30.57	50.98
Apr 2022 - Jun 2022	3,177.61	3,519.01	346.56	693.17	1,155.97
QTD:	3,177.61 *	3,519.01 *	346.56 *	693.17 *	1,155.97 *
YTD 2022:	7,223.42 *	9,275.99 *	947.53 *	1,895.81 *	3,160.76 *

Monthly Summary By Day Report

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 07/07/2022 20:27 **Location:** Roseville, CA

Red = Invalid Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Limit Value:

	Unit CT1 CO_SUSD, LbPerHr 1 Hour(s)	Unit CT1 NOx_SUSD, LbPerHr 1 Hour(s)	Unit CT2 CO_SUSD, LbPerHr 1 Hour(s)	Unit CT2 NOx_SUSD, LbPerHr 1 Hour(s)
04/01/2022	0.1	0.0	0.0	0.0
04/02/2022	0.0	0.0	0.0	0.0
04/03/2022	0.0	0.0	0.0	0.0
04/04/2022	0.0	0.0	0.0	0.0
04/05/2022	0.0	0.0	0.0	0.0
04/06/2022	0.0	0.0	0.0	0.0
04/07/2022	0.0	0.0	0.0	0.0
04/08/2022	0.0	0.0	0.0	0.0
04/09/2022	0.0	0.0	0.0	0.0
04/10/2022	0.0	0.0	0.0	0.0
04/11/2022	0.0	0.0	0.0	0.0
04/12/2022	0.0	0.0	0.0	0.0
04/13/2022	0.0	0.0	0.0	0.0
04/14/2022	0.0	0.0	0.0	0.0
04/15/2022	0.0	0.0	0.0	0.0
04/16/2022	0.0	0.0	0.0	0.0
04/17/2022	0.0	0.0	0.0	0.0
04/18/2022	0.0	0.0	0.0	0.0
04/19/2022	0.0	0.0	0.0	0.0
04/20/2022	0.0	0.0	0.0	0.0
04/21/2022	0.0	0.0	0.0	0.0
04/22/2022	0.0	0.0	0.0	0.0
04/23/2022	0.0	0.0	0.0	0.0
04/24/2022	0.0	0.0	0.0	0.0
04/25/2022	0.0	0.0	0.0	0.0
04/26/2022	0.0	0.0	248.1	19.6
04/27/2022	0.0	0.0	66.0	21.6
04/28/2022	263.2	11.6	155.7	22.1
04/29/2022	11.5	1.9	0.0	0.0
04/30/2022	0.0	0.0	0.0	0.0
Monthly Avg/Sum*:	274.7 *	13.5 *	469.8 *	63.3 *
Daily Min:	11.5	1.9	66.0	19.6
Daily Max:	263.2	11.6	248.1	22.1
Apr 2022 - Apr 2022	274.7	13.5	469.8	63.3
QTD:	274.8 *	13.5 *	469.8 *	63.3 *
YTD 2022:	1,146.5 *	157.7 *	1,225.4 *	188.9 *

Monthly Summary By Day Report

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 07/07/2022 20:27 **Location:** Roseville, CA

Red = Invalid Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Limit Value:

	Unit CT1 CO_SUSD, LbPerHr 1 Hour(s)	Unit CT1 NOx_SUSD, LbPerHr 1 Hour(s)	Unit CT2 CO_SUSD, LbPerHr 1 Hour(s)	Unit CT2 NOx_SUSD, LbPerHr 1 Hour(s)
05/01/2022	46.9	11.2	0.0	0.0
05/02/2022	0.0	0.0	0.0	0.0
05/03/2022	53.3	11.7	26.5	5.1
05/04/2022	0.0	0.0	0.6	4.2
05/05/2022	0.0	0.0	0.0	0.0
05/06/2022	0.0	0.0	0.0	0.0
05/07/2022	0.0	0.0	20.4	12.3
05/08/2022	57.3	7.5	0.0	0.0
05/09/2022	15.7	0.7	13.1	1.2
05/10/2022	0.0	0.0	0.0	0.0
05/11/2022	0.0	0.0	0.0	0.0
05/12/2022	0.0	0.0	0.0	0.0
05/13/2022	0.0	0.0	0.0	0.0
05/14/2022	0.0	0.0	0.0	0.0
05/15/2022	0.0	0.0	0.0	0.0
05/16/2022	0.0	0.0	0.0	0.0
05/17/2022	36.4	8.8	43.8	9.9
05/18/2022	0.0	0.0	0.0	0.0
05/19/2022	66.7	10.7	12.3	1.3
05/20/2022	0.0	0.0	0.0	0.0
05/21/2022	0.0	0.0	0.0	0.0
05/22/2022	0.0	0.0	0.0	0.0
05/23/2022	0.0	0.0	0.0	0.0
05/24/2022	66.3	11.4	27.0	12.7
05/25/2022	16.3	1.0	8.2	0.8
05/26/2022	51.5	11.8	9.3	1.1
05/27/2022	0.0	0.0	0.0	0.0
05/28/2022	0.0	0.0	0.0	0.0
05/29/2022	0.0	0.0	0.0	0.0
05/30/2022	0.0	0.0	0.0	0.0
05/31/2022	0.0	0.0	0.0	0.0
Monthly Avg/Sum*:	410.4 *	74.8 *	161.2 *	48.6 *
Daily Min:	0.0	0.0	0.0	0.0
Daily Max:	66.7	11.8	43.8	12.7
Apr 2022 - May 2022	685.1	88.3	631.0	111.9
QTD:	685.2 *	88.3 *	631.0 *	111.9 *
YTD 2022:	1,556.9 *	232.5 *	1,386.6 *	237.5 *

Monthly Summary By Day Report

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 07/07/2022 20:27 **Location:** Roseville, CA

Red = Invalid Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Limit Value:

	Unit CT1 CO_SUSD, LbPerHr 1 Hour(s)	Unit CT1 NOx_SUSD, LbPerHr 1 Hour(s)	Unit CT2 CO_SUSD, LbPerHr 1 Hour(s)	Unit CT2 NOx_SUSD, LbPerHr 1 Hour(s)
06/01/2022	0.0	0.0	0.0	0.0
06/02/2022	0.0	0.0	0.0	0.0
06/03/2022	0.0	0.0	0.0	0.0
06/04/2022	0.0	0.0	0.0	0.0
06/05/2022	0.0	0.0	0.0	0.0
06/06/2022	20.4	8.5	0.0	0.0
06/07/2022	0.0	0.0	11.9	0.3
06/08/2022	48.9	11.8	23.9	6.9
06/09/2022	0.0	0.0	47.0	7.4
06/10/2022	0.0	0.0	12.0	2.2
06/11/2022	0.0	0.0	29.5	7.7
06/12/2022	0.0	0.0	28.9	10.4
06/13/2022	0.0	0.0	53.8	13.0
06/14/2022	0.0	0.0	32.5	13.1
06/15/2022	0.0	0.0	0.0	0.0
06/16/2022	0.0	0.0	0.0	0.0
06/17/2022	22.2	0.9	0.0	0.0
06/18/2022	0.0	0.0	0.0	0.0
06/19/2022	0.0	0.0	0.0	0.0
06/20/2022	47.6	11.2	11.5	0.8
06/21/2022	0.0	0.0	30.7	11.9
06/22/2022	0.0	0.0	0.0	0.0
06/23/2022	0.0	0.0	35.2	10.5
06/24/2022	0.0	0.0	0.0	0.0
06/25/2022	14.9	1.1	0.0	0.0
06/26/2022	36.9	10.5	9.5	0.9
06/27/2022	0.0	0.0	35.9	12.3
06/28/2022	0.0	0.0	21.0	12.0
06/29/2022	0.0	0.0	22.6	12.1
06/30/2022	0.0	0.0	64.2	14.2
Monthly Avg/Sum*:	190.9 *	44.0 *	470.1 *	135.7 *
Daily Min:	0.0	0.0	0.0	0.0
Daily Max:	48.9	11.8	64.2	14.2
Apr 2022 - Jun 2022	876.0	132.3	1,101.1	247.6
QTD:	876.1 *	132.3 *	1,101.1 *	247.6 *
YTD 2022:	1,747.8 *	276.5 *	1,856.7 *	373.2 *

Startup / Shutdown Events

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 07/07/2022 20:22 **Location:** Roseville, CA

Unit Offline

Tag Name: CT1_UnitOn_TF_1H

Offline Periods		
Start Time	**End Time**	**Duration in Hour(s)**
04/01/2022 00:00	04/28/2022 16:00	665
04/28/2022 19:00	04/29/2022 06:00	12
04/29/2022 17:00	05/01/2022 03:00	35
05/03/2022 02:00	05/03/2022 21:00	20
05/08/2022 07:00	05/08/2022 16:00	10
05/09/2022 12:00	05/17/2022 14:00	195
05/19/2022 01:00	05/19/2022 11:00	11
05/19/2022 23:00	05/24/2022 07:00	105
05/26/2022 00:00	05/26/2022 10:00	11
05/26/2022 21:00	06/06/2022 12:00	256
06/06/2022 19:00	06/08/2022 02:00	32
06/17/2022 14:00	06/20/2022 13:00	72
06/25/2022 22:00	06/26/2022 09:00	12

Startup / Shutdown Events

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 07/07/2022 20:22 **Location:** Roseville, CA

Operating Time Summary	
Available Data for Report (excludes missing data):	2,184.00 Hour(s)
Total Offline:	1,436.00 Hour(s)
Offline Percentage:	65.75 %
Total Online:	748.00 Hour(s)
Online Percentage:	34.25 %

Startup / Shutdown Events

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 07/07/2022 20:22 **Location:** Roseville, CA

Startup/Shutdown

Number	Start Time	End Time	Event Type	Duration
1	04/28/2022 17:43	04/28/2022 18:12	Cold Startup	30
2	04/28/2022 18:12	04/28/2022 18:12	Shutdown	1
3	04/29/2022 07:44	04/29/2022 09:11	Cold Startup	88
4	04/29/2022 16:15	04/29/2022 16:30	Shutdown	16
5	05/01/2022 04:38	05/01/2022 05:33	Cold Startup	56
6	05/03/2022 00:57	05/03/2022 01:14	Shutdown	18
7	05/03/2022 22:39	05/03/2022 23:22	Cold Startup	44
8	05/08/2022 05:59	05/08/2022 06:06	Shutdown	8
9	05/08/2022 17:18	05/08/2022 18:10	Cold Startup	53
10	05/09/2022 10:56	05/09/2022 11:03	Shutdown	8
11	05/17/2022 15:23	05/17/2022 16:08	Cold Startup	46
12	05/19/2022 00:14	05/19/2022 00:21	Shutdown	8
13	05/19/2022 12:25	05/19/2022 13:15	Cold Startup	51
14	05/19/2022 22:41	05/19/2022 22:48	Shutdown	8
15	05/24/2022 08:10	05/24/2022 09:06	Cold Startup	57
16	05/25/2022 22:53	05/25/2022 23:00	Shutdown	8
17	05/26/2022 11:39	05/26/2022 12:29	Cold Startup	51
18	05/26/2022 20:12	05/26/2022 20:27	Shutdown	16
19	06/06/2022 13:39	06/06/2022 14:15	Cold Startup	37
20	06/06/2022 17:58	06/06/2022 18:13	Shutdown	16
21	06/08/2022 03:44	06/08/2022 04:34	Cold Startup	51
22	06/17/2022 13:16	06/17/2022 13:23	Shutdown	8

Startup / Shutdown Events

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 07/07/2022 20:22 **Location:** Roseville, CA

Number	Start Time	End Time	Event Type	Duration
23	06/20/2022 14:15	06/20/2022 15:18	Cold Startup	64
24	06/25/2022 21:50	06/25/2022 21:57	Shutdown	8
25	06/26/2022 10:05	06/26/2022 11:04	Cold Startup	60

Startup / Shutdown Events

CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 07/07/2022 20:22 **Location:** Roseville, CA

Startup/Shutdown Event Summary

	# Events	Duration	Duration %
Cold Startup	13	688	1.56
Warm Startup	0		0.00
Shutdown	12	123	0.28
Total Process Events:	25	811	1.84

Total Report Time:	2,183.98 Hour(s)
Total Operating Time:	734.07 Hour(s)
Total Startup Time:	688 Minute(s)
Total Shutdown Time:	123 Minute(s)
Total Startup/Shutdown Time:	811 Minute(s)
Total Startup/Shutdown Time as a Percentage of Total Operating Time:	1.84 %

Startup / Shutdown Events

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 07/07/2022 20:24 **Location:** Roseville, CA

Unit Offline

Tag Name: CT2_UnitOn_TF_1H

Offline Periods		
Start Time	**End Time**	**Duration in Hour(s)**
04/01/2022 00:00	04/26/2022 12:00	613
04/26/2022 23:00	04/27/2022 07:00	9
04/27/2022 20:00	04/28/2022 07:00	12
04/28/2022 18:00	05/03/2022 22:00	125
05/06/2022 23:00	05/07/2022 11:00	13
05/10/2022 00:00	05/17/2022 16:00	185
05/20/2022 00:00	05/24/2022 02:00	99
05/26/2022 00:00	05/26/2022 13:00	14
05/26/2022 15:00	06/07/2022 10:00	284
06/07/2022 21:00	06/08/2022 13:00	17
06/09/2022 03:00	06/09/2022 09:00	7
06/12/2022 03:00	06/12/2022 11:00	9
06/13/2022 01:00	06/13/2022 17:00	17
06/13/2022 22:00	06/14/2022 17:00	20
06/21/2022 00:00	06/21/2022 18:00	19
06/23/2022 03:00	06/23/2022 14:00	12
06/26/2022 23:00	06/27/2022 12:00	14
06/27/2022 23:00	06/28/2022 14:00	16
06/28/2022 22:00	06/29/2022 11:00	14
06/30/2022 01:00	06/30/2022 13:00	13

Startup / Shutdown Events

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 07/07/2022 20:24 **Location:** Roseville, CA

Operating Time Summary	
Available Data for Report (excludes missing data):	2,184.00 Hour(s)
Total Offline:	1,512.00 Hour(s)
Offline Percentage:	69.23 %
Total Online:	672.00 Hour(s)
Online Percentage:	30.77 %

Startup / Shutdown Events

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 07/07/2022 20:24 **Location:** Roseville, CA

Startup/Shutdown

Number	Start Time	End Time	Event Type	Duration
1	04/26/2022 13:39	04/26/2022 14:45	Cold Startup	67
2	04/26/2022 22:06	04/26/2022 22:15	Shutdown	10
3	04/27/2022 08:44	04/27/2022 10:25	Cold Startup	102
4	04/27/2022 18:54	04/27/2022 19:05	Shutdown	12
5	04/28/2022 08:39	04/28/2022 09:44	Cold Startup	66
6	04/28/2022 16:59	04/28/2022 17:06	Shutdown	8
7	05/03/2022 23:46	05/04/2022 00:33	Cold Startup	48
8	05/06/2022 22:40	05/06/2022 22:40	Shutdown	1
9	05/07/2022 12:43	05/07/2022 13:41	Cold Startup	59
10	05/08/2022 05:58	05/08/2022 05:58	Shutdown	1
11	05/09/2022 22:54	05/09/2022 23:04	Shutdown	11
12	05/17/2022 17:21	05/17/2022 18:07	Cold Startup	47
13	05/19/2022 22:58	05/19/2022 23:10	Shutdown	13
14	05/24/2022 03:40	05/24/2022 04:38	Cold Startup	59
15	05/25/2022 23:13	05/25/2022 23:22	Shutdown	10
16	05/26/2022 14:39	05/26/2022 14:47	Cold Startup	9
17	05/26/2022 14:47	05/26/2022 14:47	Shutdown	1
18	06/07/2022 11:40	06/07/2022 13:43	Cold Startup	124
19	06/07/2022 19:57	06/07/2022 20:06	Shutdown	10
20	06/08/2022 14:14	06/08/2022 14:43	Cold Startup	30
21	06/09/2022 02:50	06/09/2022 02:57	Shutdown	8
22	06/09/2022 10:39	06/09/2022 11:22	Cold Startup	44

Startup / Shutdown Events

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 07/07/2022 20:24 **Location:** Roseville, CA

Number	Start Time	End Time	Event Type	Duration
23	06/10/2022 22:55	06/10/2022 23:10	Shutdown	16
24	06/11/2022 00:44	06/11/2022 01:24	Warm Startup	41
25	06/12/2022 01:55	06/12/2022 02:02	Shutdown	8
26	06/12/2022 12:23	06/12/2022 13:03	Cold Startup	41
27	06/12/2022 23:55	06/13/2022 00:01	Shutdown	7
28	06/13/2022 18:11	06/13/2022 19:04	Cold Startup	54
29	06/13/2022 21:40	06/13/2022 21:47	Shutdown	8
30	06/14/2022 18:01	06/14/2022 18:57	Cold Startup	57
31	06/20/2022 22:53	06/20/2022 23:00	Shutdown	8
32	06/21/2022 19:24	06/21/2022 20:26	Cold Startup	63
33	06/23/2022 02:07	06/23/2022 02:14	Shutdown	8
34	06/23/2022 15:59	06/23/2022 16:46	Cold Startup	48
35	06/26/2022 22:10	06/26/2022 22:17	Shutdown	8
36	06/27/2022 13:05	06/27/2022 13:54	Cold Startup	50
37	06/27/2022 22:40	06/27/2022 22:47	Shutdown	8
38	06/28/2022 15:49	06/28/2022 16:41	Cold Startup	53
39	06/28/2022 21:23	06/28/2022 21:30	Shutdown	8
40	06/29/2022 12:00	06/29/2022 12:58	Cold Startup	59
41	06/30/2022 00:45	06/30/2022 00:52	Shutdown	8
42	06/30/2022 14:03	06/30/2022 14:54	Cold Startup	52
43	06/30/2022 23:23	06/30/2022 23:30	Shutdown	8

Startup / Shutdown Events

CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 07/07/2022 20:24 **Location:** Roseville, CA

Startup/Shutdown Event Summary

	# Events	Duration	Duration %
Cold Startup	20	1132	2.91
Warm Startup	1	41	0.11
Shutdown	22	180	0.46
Total Process Events:	43	1353	3.48

Total Report Time:	2,183.98 Hour(s)
Total Operating Time:	648.63 Hour(s)
Total Startup Time:	1,173 Minute(s)
Total Shutdown Time:	180 Minute(s)
Total Startup/Shutdown Time:	1,353 Minute(s)
Total Startup/Shutdown Time as a Percentage of Total Operating Time:	3.48 %

CT1 SUSD EVENT 1

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/28/22 17:38	38662			0			-0.1			0			0			0		
04/28/22 17:39	38585			0			-0.1			0			0			0		
04/28/22 17:40	38585			0			-0.1			0			0			0		
04/28/22 17:41	38585			0			-0.1			0			0			0		
04/28/22 17:42	43899.1			0			-0.1			0			0			0		
04/28/22 17:43	46440.6			0.1			-0.1			0			0			1		
04/28/22 17:44	48366			0.1			-0.1			0			0			1		
04/28/22 17:45	56606.7			38.4			5.9			5.05			1.28			1		
04/28/22 17:46	65155.5			1176.4			8.17			178.01			2.03			1		
04/28/22 17:47	74705.5			749.6			14.23			130.05			4.06			1		
04/28/22 17:48	95114.7			430.1			22.05			95.02			8.02			1		
04/28/22 17:49	135471.1			266.9			25.85			84			13.39			1		
04/28/22 17:50	143942.9			175.1			44.84			58.56			24.68			1		
04/28/22 17:51	139938			605.3			49.56			196.89			26.53			1		
04/28/22 17:52	138089.6			2146.6			42.52			688.56			22.45			1		
04/28/22 17:53	137011.4			2224.3			44.46			708.02			23.29			1		
04/28/22 17:54	136318.3			2225.1			45.3			704.8			23.62			1		
04/28/22 17:55	135548.1			2225.1			50.36			700.81			26.1			1		
04/28/22 17:56	135009			2307.6			59.87			723.67			30.9			1		
04/28/22 17:57	134623.9			2307.6			67.09			721.6			34.53			1		
04/28/22 17:58	134315.9			2306			67.96			719.58			34.9			1		
04/28/22 17:59	134007.8			2305.4			67.3			717.82			34.49			1		
04/28/22 18:00	133776.8			2305.4			65.34			716.79			33.43			1		
04/28/22 18:01	133468.7			2305.4			63.15			714.73			32.22			1		
04/28/22 18:02	132852.5			2305.4			61.4			711.63			31.19			1		
04/28/22 18:03	132929.6			2305.4			60.31			712.15			30.66			1		
04/28/22 18:04	132621.5			2305.4			59.22			710.6			30.04			1		
04/28/22 18:05	132544.5			2305.4			58.34			710.08			29.58			1		
04/28/22 18:06	132236.4			2305.6			57.47			708.6			29.07			1		
04/28/22 18:07	132313.4			2396.3			58.77			736.48			29.73			1		
04/28/22 18:08	132005.4			2396.3			57.64			734.87			29.09			1		
04/28/22 18:09	131543.3			2396.3			56.73			732.19			28.53			1		
04/28/22 18:10	132236.4			2396.3			55.6			736.48			28.12			1		
04/28/22 18:11	132005.4			2394.3			54.69			734.25			27.6			1		

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/28/22 18:12	68390.2			2394			53.78			380.49			14.07			1		
04/28/22 18:13	41357.6			0			59.39			323.18			9.39			0		
04/28/22 18:14	41203.5			0			2.2			0			0			0		
04/28/22 18:15	41126.5			0			2.4			0			0			0		
04/28/22 18:16	40972.5			0			2.4			0			0			0		
04/28/22 18:17	40818.5			0			2.2			0			0			0		

CT1 SUSD EVENT 2

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/28/22 18:07	132313.4			2396.3			58.77			736.48			29.73			1		
04/28/22 18:08	132005.4			2396.3			57.64			734.87			29.09			1		
04/28/22 18:09	131543.3			2396.3			56.73			732.19			28.53			1		
04/28/22 18:10	132236.4			2396.3			55.6			736.48			28.12			1		
04/28/22 18:11	132005.4			2394.3			54.69			734.25			27.6			1		
04/28/22 18:12	68390.2			2394			53.78			380.49			14.07			1		
04/28/22 18:13	41357.6			0			59.39			323.18			9.39			0		
04/28/22 18:14	41203.5			0			2.2			0			0			0		
04/28/22 18:15	41126.5			0			2.4			0			0			0		
04/28/22 18:16	40972.5			0			2.4			0			0			0		
04/28/22 18:17	40818.5			0			2.2			0			0			0		

CT1 SUSD EVENT 3

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/29/22 7:39	24183			0	X		-0.1	X		0	X		0	X		0		
04/29/22 7:40	24260			0	X		-0.1	X		0	X		0	X		0		
04/29/22 7:41	24414.1			0	X		-0.1	X		0	X		0	X		0		
04/29/22 7:42	24876.2			0	X		-0.1	X		0	X		0	X		0		
04/29/22 7:43	34118.1			0	X		-0.1	X		0	X		0	X		0		
04/29/22 7:44	33887			0.2	X		-0.1	X		0	X		0	X		1		
04/29/22 7:45	38276.9			0.2	X		-0.1	X		0	X		0	X		1		
04/29/22 7:46	46825.7			88.5	X		44.25	X		9.63	X		7.92	X		1		
04/29/22 7:47	56837.8			1293	X		16.34	X		170.77	X		3.55	X		1		
04/29/22 7:48	67851.1			931.1	X		22.13	X		146.73	X		5.74	X		1		
04/29/22 7:49	85025.6			540	X		26.39	X		106.74	X		8.59	X		1		
04/29/22 7:50	126768.3			398	X		29.21	X		117.23	X		14.16	X		1		
04/29/22 7:51	144867			261.6	X		46.46	X		88.06	X		25.74	X		1		
04/29/22 7:52	146869.5			519	X		56.44	X		177.17	X		31.71	X		1		
04/29/22 7:53	153877.9			2054.4	X		53.49	X		734.4	X		31.47	X		1		
04/29/22 7:54	165661.4			1988.9	X		58.24	X		765.75	X		36.9	X		1		
04/29/22 7:55	168588			1813.9	X		60.04	X		710.56	X		38.71	X		1		
04/29/22 7:56	168511			1712.6	X		58.34	X		670.51	X		37.59	X		1		
04/29/22 7:57	167971.8			1524.4	X		55.81	X		595.12	X		35.86	X		1		
04/29/22 7:58	167124.7			1353.2	X		52.62	X		525.54	X		33.63	X		1		
04/29/22 7:59	166739.6			1376	X		48.68	X		533.17	X		31.04	X		1		
04/29/22 8:00	166662.6			1405.8	X		47.36	X		544.42	X		30.19	X		1		
04/29/22 8:01	165969.4			1442.4	X		41.96	X		556.31	X		26.63	X		1		
04/29/22 8:02	165430.3			1465.5	X		40.48	X		563.25	X		25.61	X		1		
04/29/22 8:03	165045.2			1486	X		37.04	X		569.8	X		23.37	X		1		
04/29/22 8:04	164891.2			1503.5	X		35.4	X		576.18	X		22.33	X		1		
04/29/22 8:05	164660.2			1522.2	X		34.74	X		582.32	X		21.87	X		1		
04/29/22 8:06	164968.2			1534	X		33.76	X		587.87	X		21.29	X		1		
04/29/22 8:07	164198			1542.2	X		32.94	X		588.25	X		20.68	X		1		
04/29/22 8:08	164660.2			1550.6	X		32.61	X		593.17	X		20.53	X		1		
04/29/22 8:09	164275.1			1558.1	X		32.45	X		594.66	X		20.38	X		1		
04/29/22 8:10	163890			1557.1	X		32.78	X		592.89	X		20.54	X		1		
04/29/22 8:11	163581.9			1549.7	X		33.11	X		589.04	X		20.71	X		1		
04/29/22 8:12	163581.9			1548.1	X		33.76	X		588.42	X		21.12	X		1		

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/29/22 8:13	163273.9			1548.6	X		34.42	X		587.56	X		21.49	X		1		
04/29/22 8:14	162888.8			1590	X		36.24	X		601.84	X		22.58	X		1		
04/29/22 8:15	162965.8			1588.1	X		37.09	X		601.49	X		23.12	X		1		
04/29/22 8:16	162503.7			1594.2	X		37.93	X		602.01	X		23.57	X		1		
04/29/22 8:17	163042.8			1593.7	X		38.94	X		603.6	X		24.27	X		1		
04/29/22 8:18	171976.7			1580.5	X		39.95	X		631.52	X		26.27	X		1		
04/29/22 8:19	193310.1			1199.3	X		43.59	X		538.81	X		32.23	X		1		
04/29/22 8:20	215413.7			276.7	X		45.58	X		138.5	X		37.54	X		1		
04/29/22 8:21	236054			30.4	X		45.02	X		16.67	X		40.63	X		1		
04/29/22 8:22	261700.3			4.3	X		43.73	X		2.6	X		43.75	X		1		
04/29/22 8:23	272174.4			3	X		29.5	X		1.87	X		30.7	X		1		
04/29/22 8:24	273406.7			2.5	X		13.44	X		1.6	X		14.06	X		1		
04/29/22 8:25	273714.8			2.2	X		12.55	X		1.43	X		13.13	X		1		
04/29/22 8:26	274793			2.1	X		12.55	X		1.32	X		13.19	X		1		
04/29/22 8:27	286422.4			1.9	X		12.46	X		1.25	X		13.64	X		1		
04/29/22 8:28	288116.8			1.8	X		11.89	X		1.17	X		13.1	X		1		
04/29/22 8:29	288424.8			1.7	X		10.26	X		1.16	X		11.31	X		1		
04/29/22 8:30	288578.8			1.8	X		10.14	X		1.17	X		11.19	X		1		
04/29/22 8:31	287808.7			1.7	X		9.96	X		1.11	X		10.96	X		1		
04/29/22 8:32	288039.8			1.6	X		9.86	X		1.05	X		10.87	X		1		
04/29/22 8:33	288347.8			1.5	X		9.77	X		0.99	X		10.77	X		1		
04/29/22 8:34	287885.7			1.4	X		9.68	X		0.92	X		10.66	X		1		
04/29/22 8:35	288424.8			1.3	X		9.68	X		0.86	X		10.68	X		1		
04/29/22 8:36	288116.8			1.2	X		9.59	X		0.8	X		10.56	X		1		
04/29/22 8:37	287885.7			1.1	X		9.68	X		0.74	X		10.66	X		1		
04/29/22 8:38	287731.7			1	X		9.68	X		0.68	X		10.65	X		1		
04/29/22 8:39	287885.7			0.9	X		9.83	X		0.63	X		10.82	X		1		
04/29/22 8:40	287962.7			0.9	X		8.05	X		0.63	X		8.87	X		1		
04/29/22 8:41	287885.7			0.8	X		6.56	X		0.56	X		7.22	X		1		
04/29/22 8:42	287500.6			0.8	X		5.81	X		0.56	X		6.38	X		1		
04/29/22 8:43	287808.7			0.8	X		5.34	X		0.56	X		5.87	X		1		
04/29/22 8:44	288039.8			0.7	X		4.96	X		0.5	X		5.47	X		1		
04/29/22 8:45	295587.3			0.7	X		4.87	X		0.51	X		5.5	X		1		
04/29/22 8:46	306677.6			0.7	X		4.4	X		0.53	X		5.16	X		1		
04/29/22 8:47	307832.8			0.7	X		3.78	X		0.53	X		4.45	X		1		
04/29/22 8:48	308217.9			0.7	X		3.63	X		0.52	X		4.28	X		1		
04/29/22 8:49	308371.9			0.8	X		3.54	X		0.59	X		4.17	X		1		

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/29/22 8:50	308294.9			0.8	X		3.45	X		0.59	X		4.07	X		1		
04/29/22 8:51	308680			0.8	X		3.45	X		0.59	X		4.07	X		1		
04/29/22 8:52	308294.9			0.8	X		3.36	X		0.59	X		3.96	X		1		
04/29/22 8:53	308063.9			0.7	X		3.36	X		0.52	X		3.96	X		1		
04/29/22 8:54	307909.8			0.7	X		3.27	X		0.52	X		3.85	X		1		
04/29/22 8:55	307447.8			0.7	X		3.18	X		0.52	X		3.73	X		1		
04/29/22 8:56	307601.8			0.7	X		3.09	X		0.52	X		3.63	X		1		
04/29/22 8:57	307216.7			0.7	X		3.09	X		0.52	X		3.63	X		1		
04/29/22 8:58	307293.7			0.7	X		3	X		0.52	X		3.52	X		1		
04/29/22 8:59	307755.8			0.7	X		3	X		0.52	X		3.53	X		1		
04/29/22 9:00	307447.8			0.7	X		3.09	X		0.52	X		3.63	X		1		
04/29/22 9:01	307216.7			0.7	X		3.09	X		0.52	X		3.63	X		1		
04/29/22 9:02	311298.6			0.7	X		3	X		0.53	X		3.57	X		1		
04/29/22 9:03	331091.7			0.7	X		2.9	X		0.56	X		3.68	X		1		
04/29/22 9:04	338947.3			0.7	X		2.81	X		0.57	X		3.65	X		1		
04/29/22 9:05	341026.7			0.7	X		2.27	X		0.58	X		2.96	X		1		
04/29/22 9:06	341026.7			0.7	X		2.18	X		0.58	X		2.84	X		1		
04/29/22 9:07	341257.8			0.8	X		2.18	X		0.65	X		2.84	X		1		
04/29/22 9:08	340487.6			0.8	X		2.09	X		0.65	X		2.72	X		1		
04/29/22 9:09	340179.6			0.8	X		1.97	X		0.64	X		2.56	X		1		
04/29/22 9:10	339640.4			0.8	X		1.91	X		0.64	X		2.48	X		1		
04/29/22 9:11	339486.4			0.8	X		1.91	X		0.64	X		2.47	X		1		
04/29/22 9:12	339717.5			0.8	X		1.91	X		0.64	X		2.48	X		0		
04/29/22 9:13	339871.5			0.8	X		1.91	X		0.65	X		2.48	X		0		
04/29/22 9:14	339486.4			0.8	X		1.82	X		0.64	X		2.36	X		0		
04/29/22 9:15	339794.5			0.8	X		1.82	X		0.64	X		2.36	X		0		
04/29/22 9:16	339948.5			0.8	X		1.82	X		0.65	X		2.36	X		0		

CT1 SUSD EVENT 4

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/29/22 16:10	444151.1			0.6			1.66			0.67			2.82			0		
04/29/22 16:11	441532.6			0.6			1.75			0.66			2.96			0		
04/29/22 16:12	440069.3			0.6			1.75			0.66			2.95			0		
04/29/22 16:13	434986.2			0.7			1.87			0.66			3.12			0		
04/29/22 16:14	432521.7			0.7			1.87			0.66			3.1			0		
04/29/22 16:15	430827.3			0.7			1.78			0.66			2.93			1		
04/29/22 16:16	426899.5			0.7			1.69			0.65			2.75			1		
04/29/22 16:17	410418.1			0.7			1.59			0.63			2.5			1		
04/29/22 16:18	388622.6			0.7			1.69			0.59			2.51			1		
04/29/22 16:19	366596			0.6			2.4			0.55			3.36			1		
04/29/22 16:20	343414.2			0.7			2.63			0.58			3.46			1		
04/29/22 16:21	319000.2			0.8			2.68			0.6			3.27			1		
04/29/22 16:22	296434.5			0.8			2.81			0.56			3.19			1		
04/29/22 16:23	276025.3			0.7			2.86			0.47			3.02			1		
04/29/22 16:24	254845.9			0.7			3.14			0.39			3.06			1		
04/29/22 16:25	231587			0.6			4.74			0.31			4.2			1		
04/29/22 16:26	210407.6			0.4			8.96			0.21			7.21			1		
04/29/22 16:27	186301.6			0.3			25.57			0.15			18.22			1		
04/29/22 16:28	166200.5			7.6			29.5			2.94			18.75			1		
04/29/22 16:29	148948.9			345.2			33.19			119.44			18.9			1		
04/29/22 16:30	97425.2			1366.4			33.38			309.24			12.43			1		
04/29/22 16:31	45670.5			0			36.52			254.34			6.38			0		
04/29/22 16:32	45516.4			0			0.2			0			0			0		
04/29/22 16:33	45516.4			0			0.1			0			0			0		
04/29/22 16:34	45593.5			0			0.1			0			0			0		
04/29/22 16:35	45439.4			0			0.1			0			0			0		

CT1 SUSD EVENT 5

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/01/22 4:33	0			0			-0.1			0			0			0		
05/01/22 4:34	0			0			-0.1			0			0			0		
05/01/22 4:35	0			0			-0.1			0			0			0		
05/01/22 4:36	0			0			-0.1			0			0			0		
05/01/22 4:37	10859.3			0			-0.1			0			0			0		
05/01/22 4:38	27802.8			0.1			-0.1			0			0			1		
05/01/22 4:39	32038.6			0.1			-0.1			0			0			1		
05/01/22 4:40	38816.1			1.2			0.2			0			0			1		
05/01/22 4:41	49675.3			1277.4			14.75			147.83			2.81			1		
05/01/22 4:42	61150.7			1117.9			16.13			159.14			3.78			1		
05/01/22 4:43	74859.5			655.9			21.31			114.37			6.11			1		
05/01/22 4:44	110517.9			458.1			25.37			117.83			10.74			1		
05/01/22 4:45	142864.6			332.3			34.6			110.53			18.94			1		
05/01/22 4:46	149565			215.1			49.94			74.93			28.63			1		
05/01/22 4:47	166431.5			1750.8			48.15			678.39			30.71			1		
05/01/22 4:48	185531.5			1843.9			53.45			796.62			38			1		
05/01/22 4:49	207635.1			975.2			61.48			471.3			48.9			1		
05/01/22 4:50	229738.6			162.2			61.2			86.73			53.86			1		
05/01/22 4:51	248530.5			15.9			54.79			9.2			52.17			1		
05/01/22 4:52	275178.1			2.8			50.81			1.82			53.57			1		
05/01/22 4:53	299207.1			2.4			26.55			1.64			30.44			1		
05/01/22 4:54	319462.3			2.2			15.82			1.66			19.36			1		
05/01/22 4:55	336328.8			2.4			12.57			1.87			16.2			1		
05/01/22 4:56	340102.5			2.5			11.37			1.96			14.82			1		
05/01/22 4:57	332786			2.4			10.09			1.85			12.86			1		
05/01/22 4:58	339640.4			2.2			9.75			1.76			12.68			1		
05/01/22 4:59	355274.7			2.1			8.76			1.72			11.93			1		
05/01/22 5:00	365748.8			1.8			6.69			1.57			9.38			1		
05/01/22 5:01	368136.3			1.7			6.26			1.46			8.83			1		
05/01/22 5:02	370523.8			1.5			6.35			1.31			9.01			1		
05/01/22 5:03	372218.2			1.4			6.35			1.24			9.05			1		
05/01/22 5:04	371217			1.3			6.26			1.16			8.9			1		
05/01/22 5:05	368444.4			1.3			6.08			1.13			8.58			1		
05/01/22 5:06	365902.9			1.3			6.08			1.13			8.52			1		

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/01/22 5:07	363515.4			1.3			6.08			1.12			8.46			1		
05/01/22 5:08	365055.7			1.2			5.81			1.05			8.13			1		
05/01/22 5:09	367289.2			1.2			5.63			0.99			7.93			1		
05/01/22 5:10	369137.6			1.1			5.45			0.92			7.71			1		
05/01/22 5:11	368136.3			1			5.18			0.84			7.31			1		
05/01/22 5:12	365209.8			1			5.45			0.84			7.63			1		
05/01/22 5:13	362129.1			1			5.54			0.83			7.69			1		
05/01/22 5:14	360742.8			1			5.54			0.83			7.66			1		
05/01/22 5:15	364516.6			1			5.18			0.83			7.24			1		
05/01/22 5:16	366365			1			5.18			0.84			7.28			1		
05/01/22 5:17	368290.4			1			5.18			0.84			7.32			1		
05/01/22 5:18	367674.3			1			5.18			0.84			7.3			1		
05/01/22 5:19	364978.7			1			5.63			0.84			7.88			1		
05/01/22 5:20	361358.9			1.1			4.74			0.9			6.56			1		
05/01/22 5:21	360126.7			1.1			2.86			0.9			3.95			1		
05/01/22 5:22	362591.2			1.1			2.23			0.91			3.1			1		
05/01/22 5:23	365132.7			1			2.15			0.84			3			1		
05/01/22 5:24	367135.1			1			2.23			0.84			3.14			1		
05/01/22 5:25	367674.3			1			2.23			0.84			3.15			1		
05/01/22 5:26	364439.6			1			2.32			0.83			3.25			1		
05/01/22 5:27	361821			1			2.41			0.83			3.35			1		
05/01/22 5:28	360203.7			1			2.41			0.82			3.33			1		
05/01/22 5:29	362052.1			1			2.23			0.83			3.1			1		
05/01/22 5:30	365055.7			1			2.06			0.84			2.88			1		
05/01/22 5:31	367443.2			1			1.88			0.84			2.64			1		
05/01/22 5:32	366673			1			1.7			0.84			2.39			1		
05/01/22 5:33	363823.4			1			1.61			0.83			2.24			1		
05/01/22 5:34	360203.7			1			1.52			0.82			2.1			0		
05/01/22 5:35	358278.3			1.1			1.52			0.89			2.09			0		
05/01/22 5:36	360742.8			1			1.52			0.83			2.1			0		
05/01/22 5:37	363823.4			1			1.43			0.83			1.99			0		
05/01/22 5:38	366288			1			1.43			0.84			2.01			0		

CT1 SUSD EVENT 6

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/03/22 0:52	450235.4			0.7			1.57			0.77			2.7			0		
05/03/22 0:53	450543.4			0.7			1.66			0.77			2.86			0		
05/03/22 0:54	450466.4			0.7			1.66			0.77			2.86			0		
05/03/22 0:55	449542.2			0.7			1.57			0.77			2.7			0		
05/03/22 0:56	450158.3			0.7			1.57			0.77			2.7			0		
05/03/22 0:57	449850.3			0.6			1.57			0.68			2.7			1		
05/03/22 0:58	449927.3			0.6			1.57			0.68			2.7			1		
05/03/22 0:59	440916.4			0.6			1.57			0.66			2.65			1		
05/03/22 1:00	422971.7			0.6			1.66			0.64			2.69			1		
05/03/22 1:01	399481.8			0.7			2.27			0.68			3.47			1		
05/03/22 1:02	377763.3			0.7			2.41			0.63			3.49			1		
05/03/22 1:03	356738			0.8			2.55			0.66			3.49			1		
05/03/22 1:04	331938.8			0.9			2.82			0.68			3.58			1		
05/03/22 1:05	309219.1			0.9			2.91			0.63			3.44			1		
05/03/22 1:06	288039.8			0.9			3.04			0.6			3.35			1		
05/03/22 1:07	266244.2			0.8			3.09			0.51			3.15			1		
05/03/22 1:08	243370.5			0.7			4.21			0.37			3.93			1		
05/03/22 1:09	222884.2			0.5			7.6			0.26			6.49			1		
05/03/22 1:10	198162.1			0.3			22.49			0.15			17.07			1		
05/03/22 1:11	176366.6			3.8			25.94			1.56			17.52			1		
05/03/22 1:12	158036.8			271.3			29.78			99.82			18.04			1		
05/03/22 1:13	139938			1159.9			31.89			377.78			17.09			1		
05/03/22 1:14	48828.1			1948.7			32.45			221.59			6.07			1		
05/03/22 1:15	21718.5			0			37.01			165.33			3.08			0		
05/03/22 1:16	21564.5			0			0.2			0			0			0		
05/03/22 1:17	21564.5			0			0.2			0			0			0		
05/03/22 1:18	21487.5			0			0.1			0			0			0		
05/03/22 1:19	21564.5			0			0.1			0			0			0		

CT1 SUSD EVENT 7

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/03/22 22:34	27802.8			0			-0.1			0			0			0		
05/03/22 22:35	27725.8			0			-0.1			0			0			0		
05/03/22 22:36	27417.7			0			-0.1			0			0			0		
05/03/22 22:37	27417.7			0			-0.1			0			0			0		
05/03/22 22:38	27494.7			0			-0.1			0			0			0		
05/03/22 22:39	32962.8			0.2			-0.1			0			0			1		
05/03/22 22:40	35196.3			0.2			-0.1			0			0			1		
05/03/22 22:41	44438.2			100.3			32.45			10.37			5.52			1		
05/03/22 22:42	54758.4			1194.1			16.79			152.35			3.53			1		
05/03/22 22:43	65232.5			814.2			22.21			123.57			5.55			1		
05/03/22 22:44	83716.4			490.3			27.95			95.6			8.97			1		
05/03/22 22:45	124072.7			325.1			33.71			93.87			16.02			1		
05/03/22 22:46	142633.6			201.3			47.91			66.83			26.17			1		
05/03/22 22:47	152645.7			447.2			59			158.97			34.52			1		
05/03/22 22:48	170128.3			2003.3			54.81			793.29			35.72			1		
05/03/22 22:49	192154.8			1413			58.49			631.94			43.06			1		
05/03/22 22:50	215028.6			307.7			55.98			153.99			46.11			1		
05/03/22 22:51	235822.9			33.6			55.15			18.45			49.84			1		
05/03/22 22:52	260237			3			49.81			1.79			49.65			1		
05/03/22 22:53	283803.8			2			35.3			1.3			38.39			1		
05/03/22 22:54	305445.3			1.8			15.92			1.27			18.63			1		
05/03/22 22:55	325623.5			1.8			11.63			1.38			14.5			1		
05/03/22 22:56	337638			1.9			10.76			1.5			13.92			1		
05/03/22 22:57	344184.4			1.9			8.68			1.53			11.44			1		
05/03/22 22:58	357893.2			1.8			7.4			1.47			10.14			1		
05/03/22 22:59	362129.1			1.6			6.08			1.36			8.43			1		
05/03/22 23:00	351115.8			1.4			6.35			1.17			8.54			1		
05/03/22 23:01	353503.3			1.3			6.78			1.09			9.18			1		
05/03/22 23:02	361590			1.2			5.55			1.04			7.69			1		
05/03/22 23:03	364362.6			1.3			5.17			1.08			7.22			1		
05/03/22 23:04	365440.8			1.1			5.18			0.91			7.26			1		
05/03/22 23:05	367135.1			1.1			5.26			0.93			7.4			1		
05/03/22 23:06	367135.1			1			5.17			0.85			7.28			1		
05/03/22 23:07	364747.7			1			5.08			0.85			7.1			1		

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/03/22 23:08	360973.9			1			5.01			0.83			6.92			1		
05/03/22 23:09	357893.2			1			5.01			0.82			6.86			1		
05/03/22 23:10	358432.3			1			4.92			0.82			6.75			1		
05/03/22 23:11	361050.9			1			4.54			0.84			6.28			1		
05/03/22 23:12	364131.5			0.9			4.63			0.77			6.46			1		
05/03/22 23:13	367366.2			0.9			4.63			0.78			6.52			1		
05/03/22 23:14	366904.1			0.9			4.54			0.78			6.38			1		
05/03/22 23:15	363438.4			0.9			4.99			0.77			6.95			1		
05/03/22 23:16	360280.7			0.9			4.99			0.76			6.89			1		
05/03/22 23:17	357123.1			1			4.99			0.83			6.83			1		
05/03/22 23:18	362976.3			1			4.99			0.84			6.94			1		
05/03/22 23:19	380998			0.9			2.9			0.81			4.24			1		
05/03/22 23:20	402254.4			0.9			1.97			0.88			3.03			1		
05/03/22 23:21	417118.5			0.8			1.87			0.82			2.99			1		
05/03/22 23:22	422355.6			0.7			1.78			0.74			2.88			1		
05/03/22 23:23	435294.3			0.7			1.78			0.76			2.97			0		
05/03/22 23:24	440069.3			0.7			2.25			0.77			3.79			0		
05/03/22 23:25	438220.9			0.8			2.58			0.85			4.33			0		
05/03/22 23:26	438528.9			0.8			2.49			0.85			4.18			0		
05/03/22 23:27	439607.2			0.8			2.34			0.86			3.94			0		

CT1 SUSD EVENT 8

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/08/22 5:54	267861.6			0.4			1.45			0.24			1.49			0		
05/08/22 5:55	267399.5			0.4			1.45			0.24			1.49			0		
05/08/22 5:56	267630.5			0.4			1.45			0.24			1.49			0		
05/08/22 5:57	267707.5			0.4			1.45			0.24			1.49			0		
05/08/22 5:58	267322.4			0.4			1.45			0.24			1.49			0		
05/08/22 5:59	266475.3			0.4			1.45			0.24			1.48			1		
05/08/22 6:00	252689.4			0.4			1.57			0.23			1.52			1		
05/08/22 6:01	232742.3			0.4			2.2			0.22			1.96			1		
05/08/22 6:02	210253.6			0.2			6.87			0.11			5.53			1		
05/08/22 6:03	185685.5			2.5			9.79			1.07			6.97			1		
05/08/22 6:04	165584.3			125			12.2			48.17			7.74			1		
05/08/22 6:05	148178.7			849.9			14.13			293.17			8.02			1		
05/08/22 6:06	91032.9			1795.9			14.75			380.69			5.15			1		
05/08/22 6:07	19639.1			0			16.01			119.51			1.2			0		
05/08/22 6:08	19331			0			0.1			0			0			0		
05/08/22 6:09	18714.9			0			0.1			0			0			0		
05/08/22 6:10	18714.9			0			0.1			0			0			0		
05/08/22 6:11	18714.9			0			0			0			0			0		

CT1 SUSD EVENT 9

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/08/22 17:13	30883.4			0			0			0			0			0		
05/08/22 17:14	30960.4			0			0			0			0			0		
05/08/22 17:15	31037.4			0			0			0			0			0		
05/08/22 17:16	31037.4			0			0			0			0			0		
05/08/22 17:17	31422.5			0			0			0			0			0		
05/08/22 17:18	38508			-0.1			0			0			0			1		
05/08/22 17:19	43976.1			0.9			0.2			0			0			1		
05/08/22 17:20	52755.9			1239			7.67			152.26			1.55			1		
05/08/22 17:21	62845			1119.3			8.85			163.86			2.13			1		
05/08/22 17:22	76168.8			628.2			12.84			111.37			3.75			1		
05/08/22 17:23	109362.7			407.1			17.08			103.61			7.15			1		
05/08/22 17:24	143480.8			255.8			21.45			85.45			11.79			1		
05/08/22 17:25	149257			178.1			38.68			61.87			22.11			1		
05/08/22 17:26	165892.4			1721.4			33.24			664.7			21.12			1		
05/08/22 17:27	185454.5			1864			35.22			804.89			25.03			1		
05/08/22 17:28	207943.1			735.3			34.47			356.03			27.47			1		
05/08/22 17:29	229430.6			117.5			35.54			62.73			31.24			1		
05/08/22 17:30	250610			8.7			35.77			5.09			34.34			1		
05/08/22 17:31	276179.3			1.9			34.62			1.22			36.63			1		
05/08/22 17:32	293199.8			1.6			16.6			1.09			18.65			1		
05/08/22 17:33	300285.3			1.5			9.8			1.02			11.28			1		
05/08/22 17:34	307139.7			1.5			8.01			1.07			9.43			1		
05/08/22 17:35	311837.7			1.5			6.53			1.1			7.8			1		
05/08/22 17:36	320078.4			1.3			5.9			1			7.24			1		
05/08/22 17:37	322234.8			1.2			5.72			0.87			7.06			1		
05/08/22 17:38	322465.9			1.1			5.37			0.79			6.64			1		
05/08/22 17:39	321464.7			1.1			4.93			0.79			6.07			1		
05/08/22 17:40	319000.2			1			4.74			0.73			5.79			1		
05/08/22 17:41	318076			1			4.65			0.73			5.66			1		
05/08/22 17:42	316073.6			0.9			4.47			0.66			5.41			1		
05/08/22 17:43	315303.4			0.8			4.29			0.59			5.18			1		
05/08/22 17:44	316073.6			0.8			4.18			0.6			5.06			1		
05/08/22 17:45	314764.3			0.8			4.08			0.6			4.93			1		
05/08/22 17:46	316073.6			0.7			3.99			0.53			4.84			1		

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/08/22 17:47	317305.8			0.7			3.99			0.54			4.86			1		
05/08/22 17:48	326778.8			0.7			3.9			0.55			4.89			1		
05/08/22 17:49	330321.5			0.7			3.9			0.56			4.94			1		
05/08/22 17:50	331014.7			0.6			3.81			0.49			4.84			1		
05/08/22 17:51	334788.4			0.6			3.63			0.5			4.66			1		
05/08/22 17:52	333094.1			0.6			3.54			0.49			4.52			1		
05/08/22 17:53	315149.3			0.6			3.45			0.47			4.17			1		
05/08/22 17:54	304829.2			0.6			3.9			0.45			4.56			1		
05/08/22 17:55	303211.9			0.6			3.72			0.45			4.32			1		
05/08/22 17:56	296819.6			0.6			3.23			0.45			3.67			1		
05/08/22 17:57	290735.3			0.6			2.21			0.37			2.46			1		
05/08/22 17:58	285498.2			0.6			2.15			0.37			2.36			1		
05/08/22 17:59	281108.3			0.5			2.15			0.31			2.32			1		
05/08/22 18:00	276102.3			0.5			2.19			0.31			2.31			1		
05/08/22 18:01	272328.5			0.5			2.38			0.3			2.48			1		
05/08/22 18:02	270480.1			0.4			2.47			0.24			2.56			1		
05/08/22 18:03	270018			0.4			2.61			0.24			2.7			1		
05/08/22 18:04	270018			0.4			2.51			0.24			2.6			1		
05/08/22 18:05	270095			0.4			2.42			0.24			2.5			1		
05/08/22 18:06	269401.9			0.3			2.22			0.18			2.3			1		
05/08/22 18:07	270018			0.3			2.03			0.18			2.1			1		
05/08/22 18:08	269864			0.3			1.93			0.18			2			1		
05/08/22 18:09	269247.8			0.3			1.84			0.18			1.9			1		
05/08/22 18:10	269555.9			0.3			1.74			0.18			1.8			1		
05/08/22 18:11	269786.9			0.3			1.64			0.18			1.7			0		
05/08/22 18:12	268554.7			0.3			1.64			0.18			1.69			0		
05/08/22 18:13	266552.3			0.3			1.55			0.18			1.58			0		
05/08/22 18:14	266398.3			0.3			1.55			0.18			1.58			0		
05/08/22 18:15	266783.3			0.3			1.57			0.18			1.61			0		

CT1 SUSD EVENT 10

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/09/22 10:51	270403.1			0.3			1.55			0.18			1.6			0		
05/09/22 10:52	270634.1			0.4			1.45			0.24			1.5			0		
05/09/22 10:53	269478.9			0.4			1.55			0.24			1.6			0		
05/09/22 10:54	267938.6			0.4			1.55			0.24			1.59			0		
05/09/22 10:55	268015.6			0.4			1.55			0.24			1.59			0		
05/09/22 10:56	267091.4			0.3			1.45			0.18			1.48			1		
05/09/22 10:57	252766.4			0.3			1.45			0.17			1.41			1		
05/09/22 10:58	231047.9			0.3			2.3			0.16			2.04			1		
05/09/22 10:59	209329.4			0.2			7.32			0.11			5.87			1		
05/09/22 11:00	184838.3			1.9			10.48			0.83			7.42			1		
05/09/22 11:01	165738.4			128.7			12.6			49.68			8.01			1		
05/09/22 11:02	148255.8			860.8			14.44			297.12			8.2			1		
05/09/22 11:03	86180.9			1852.2			15.73			371.5			5.19			1		
05/09/22 11:04	35966.5			0			16.23			223.09			2.24			0		
05/09/22 11:05	35966.5			0			0.1			0			0			0		
05/09/22 11:06	35735.4			0			0.1			0			0			0		
05/09/22 11:07	35581.4			0			0.1			0			0			0		
05/09/22 11:08	35350.3			0			0.1			0			0			0		

CT1 SUSD EVENT 11

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/17/22 15:18	48520.1			0			0			0			0			0		
05/17/22 15:19	48520.1			0			0			0			0			0		
05/17/22 15:20	48366			0			0			0			0			0		
05/17/22 15:21	49983.4			0			0			0			0			0		
05/17/22 15:22	51754.7			0			0			0			0			0		
05/17/22 15:23	54604.3			0			0			0			0			1		
05/17/22 15:24	58147.1			0			0			0			0			1		
05/17/22 15:25	64847.4			54.6			20.65			8.23			5.13			1		
05/17/22 15:26	73088.2			1056.1			16.01			179.67			4.48			1		
05/17/22 15:27	82484.1			628.5			21.17			120.71			6.69			1		
05/17/22 15:28	106898.2			311.8			26.26			77.62			10.76			1		
05/17/22 15:29	143788.8			175.1			32.45			58.6			17.87			1		
05/17/22 15:30	148563.8			105.1			47.42			36.35			26.99			1		
05/17/22 15:31	159577.1			990.2			39.02			367.96			23.86			1		
05/17/22 15:32	175981.5			1926			35.77			788.96			24.11			1		
05/17/22 15:33	197777			931.1			48.02			428.7			36.39			1		
05/17/22 15:34	221497.9			161.5			58.57			83.27			49.71			1		
05/17/22 15:35	240135.8			12.8			62.26			7.16			57.28			1		
05/17/22 15:36	266475.3			2			60.56			1.24			61.82			1		
05/17/22 15:37	289195			1.6			32.6			1.08			36.13			1		
05/17/22 15:38	309142.1			1.6			18.81			1.13			22.27			1		
05/17/22 15:39	328935.2			1.7			12.52			1.3			15.77			1		
05/17/22 15:40	345493.7			1.7			11.08			1.37			14.67			1		
05/17/22 15:41	342875.1			1.6			7.78			1.28			10.22			1		
05/17/22 15:42	344569.5			1.5			6.81			1.24			8.99			1		
05/17/22 15:43	359510.6			1.4			5.36			1.14			7.38			1		
05/17/22 15:44	365671.8			1.2			4.15			1.02			5.81			1		
05/17/22 15:45	368752.5			1			3.47			0.88			4.9			1		
05/17/22 15:46	371602.1			0.9			3.32			0.8			4.73			1		
05/17/22 15:47	370677.9			0.8			3.23			0.72			4.58			1		
05/17/22 15:48	368290.4			0.8			3			0.7			4.23			1		
05/17/22 15:49	364054.5			0.8			2.9			0.69			4.05			1		
05/17/22 15:50	365517.8			0.8			2.81			0.7			3.94			1		
05/17/22 15:51	369214.6			0.7			2.72			0.62			3.85			1		

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/17/22 15:52	371602.1			0.7			2.58			0.64			3.68			1		
05/17/22 15:53	373219.4			0.7			2.4			0.64			3.43			1		
05/17/22 15:54	369676.7			0.6			2.36			0.55			3.34			1		
05/17/22 15:55	366442			0.6			2.36			0.54			3.31			1		
05/17/22 15:56	363361.3			0.7			2.36			0.61			3.29			1		
05/17/22 15:57	365748.8			0.7			2.27			0.62			3.18			1		
05/17/22 15:58	368752.5			0.6			2.3			0.55			3.26			1		
05/17/22 15:59	370908.9			0.6			2.21			0.56			3.14			1		
05/17/22 16:00	371217			0.6			2.21			0.56			3.15			1		
05/17/22 16:01	368521.4			0.6			2.3			0.55			3.25			1		
05/17/22 16:02	364901.7			0.6			2.36			0.54			3.3			1		
05/17/22 16:03	363207.3			0.6			2.36			0.54			3.28			1		
05/17/22 16:04	365363.8			0.6			2.36			0.54			3.3			1		
05/17/22 16:05	366673			0.6			1.94			0.55			2.72			1		
05/17/22 16:06	368675.5			0.6			1.38			0.55			1.95			1		
05/17/22 16:07	369753.7			0.6			1.29			0.56			1.83			1		
05/17/22 16:08	369291.6			0.6			1.2			0.55			1.7			1		
05/17/22 16:09	366750.1			0.6			1.2			0.55			1.68			0		
05/17/22 16:10	364131.5			0.6			1.18			0.54			1.65			0		
05/17/22 16:11	362283.1			0.6			1.27			0.54			1.76			0		
05/17/22 16:12	364593.6			0.6			1.27			0.54			1.78			0		
05/17/22 16:13	367520.2			0.6			1.2			0.55			1.69			0		

CT1 SUSD EVENT 12

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/19/22 0:09	268708.7			0.4			1.55			0.24			1.59			0		
05/19/22 0:10	268169.6			0.4			1.55			0.24			1.59			0		
05/19/22 0:11	268246.6			0.4			1.64			0.24			1.69			0		
05/19/22 0:12	269324.8			0.4			1.64			0.24			1.7			0		
05/19/22 0:13	270480.1			0.4			1.64			0.24			1.7			0		
05/19/22 0:14	270326.1			0.4			1.64			0.24			1.7			1		
05/19/22 0:15	260160			0.4			1.64			0.23			1.64			1		
05/19/22 0:16	237517.3			0.4			1.74			0.21			1.58			1		
05/19/22 0:17	215875.8			0.3			5.59			0.15			4.63			1		
05/19/22 0:18	190922.6			0.2			13.16			0.1			9.63			1		
05/19/22 0:19	169743.2			4			17.2			1.59			11.18			1		
05/19/22 0:20	151952.5			302.6			20.15			107.03			11.73			1		
05/19/22 0:21	116217.1			1271.5			23.11			344.09			10.29			1		
05/19/22 0:22	37506.8			0			29.94			196.78			4.3			0		
05/19/22 0:23	37352.7			0			0.6			0			0			0		
05/19/22 0:24	37429.8			0			0.2			0			0			0		
05/19/22 0:25	37429.8			0			0.1			0			0			0		
05/19/22 0:26	37429.8			0			0.1			0			0			0		

CT1 SUSD EVENT 13

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/19/22 12:20	49444.3			0			0			0			0			0		
05/19/22 12:21	49521.3			0			0			0			0			0		
05/19/22 12:22	49521.3			0			0			0			0			0		
05/19/22 12:23	49598.3			0			0			0			0			0		
05/19/22 12:24	50214.4			0			0			0			0			0		
05/19/22 12:25	51754.7			-0.1			0			0			0			1		
05/19/22 12:26	55990.6			0			0			0			0			1		
05/19/22 12:27	62845			48.4			21.24			7.08			5.12			1		
05/19/22 12:28	71008.7			1043.5			12.98			172.62			3.53			1		
05/19/22 12:29	80404.7			656.6			18.74			122.88			5.77			1		
05/19/22 12:30	100890.9			318.3			23.6			74.74			9.12			1		
05/19/22 12:31	140400.1			181.8			25.75			59.42			13.85			1		
05/19/22 12:32	148332.8			105.3			46.11			36.38			26.21			1		
05/19/22 12:33	157112.6			913.4			44.92			334.07			27.04			1		
05/19/22 12:34	170821.4			1967.1			42.78			782.46			28			1		
05/19/22 12:35	191692.8			1346			45.51			600.81			33.43			1		
05/19/22 12:36	215105.6			289.2			46.02			144.84			37.93			1		
05/19/22 12:37	235899.9			30.9			46.28			16.99			41.82			1		
05/19/22 12:38	260391			2.5			44.54			1.54			44.43			1		
05/19/22 12:39	279953.1			1.6			30.33			1.01			32.52			1		
05/19/22 12:40	287962.7			1.4			14.05			0.94			15.5			1		
05/19/22 12:41	305214.3			1.5			10.35			1.03			12.1			1		
05/19/22 12:42	323236			1.4			8.71			1.02			10.79			1		
05/19/22 12:43	322157.8			1.3			8.4			0.94			10.37			1		
05/19/22 12:44	320617.5			1.2			7.69			0.87			9.44			1		
05/19/22 12:45	315996.5			1.1			6.97			0.79			8.44			1		
05/19/22 12:46	310759.4			1			6.99			0.72			8.32			1		
05/19/22 12:47	310528.4			0.9			6.91			0.67			8.23			1		
05/19/22 12:48	308834.1			0.9			6.82			0.66			8.07			1		
05/19/22 12:49	308526			0.8			6.73			0.6			7.96			1		
05/19/22 12:50	309296.2			0.7			6.73			0.53			7.98			1		
05/19/22 12:51	307524.8			0.7			6.73			0.53			7.93			1		
05/19/22 12:52	308140.9			0.7			6.82			0.53			8.05			1		
05/19/22 12:53	309989.3			0.6			6.82			0.47			8.1			1		

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/19/22 12:54	310066.3			0.7			7.02			0.47			8.34			1		
05/19/22 12:55	313069.9			0.6			7.01			0.47			8.4			1		
05/19/22 12:56	301055.4			0.6			7.1			0.45			8.19			1		
05/19/22 12:57	292814.7			0.7			6.93			0.45			7.77			1		
05/19/22 12:58	288963.9			0.7			6.47			0.45			7.16			1		
05/19/22 12:59	284111.9			0.6			5.04			0.38			5.49			1		
05/19/22 13:00	287654.7			0.5			2.95			0.32			3.25			1		
05/19/22 13:01	286807.5			0.5			2.61			0.32			2.87			1		
05/19/22 13:02	277873.6			0.5			2.57			0.31			2.74			1		
05/19/22 13:03	273945.8			0.5			2.61			0.31			2.74			1		
05/19/22 13:04	273483.7			0.5			2.71			0.31			2.84			1		
05/19/22 13:05	272790.6			0.4			3.05			0.25			3.19			1		
05/19/22 13:06	273175.7			0.4			3.15			0.25			3.29			1		
05/19/22 13:07	273252.7			0.4			3.15			0.25			3.29			1		
05/19/22 13:08	273483.7			0.4			2.95			0.25			3.09			1		
05/19/22 13:09	272020.4			0.4			2.66			0.25			2.77			1		
05/19/22 13:10	272636.5			0.4			2.46			0.25			2.57			1		
05/19/22 13:11	272251.5			0.4			2.26			0.25			2.36			1		
05/19/22 13:12	272867.6			0.4			2.07			0.25			2.16			1		
05/19/22 13:13	280415.2			0.4			1.97			0.26			2.11			1		
05/19/22 13:14	300362.3			0.4			1.87			0.28			2.15			1		
05/19/22 13:15	320078.4			0.4			1.71			0.28			2.1			1		
05/19/22 13:16	332863			0.5			1.59			0.36			2.03			0		
05/19/22 13:17	329166.3			0.6			1.01			0.42			1.28			0		
05/19/22 13:18	327163.8			0.6			0.91			0.48			1.14			0		
05/19/22 13:19	329243.3			0.6			0.91			0.49			1.14			0		
05/19/22 13:20	330167.5			0.6			0.82			0.49			1.03			0		

CT1 SUSD EVENT 14

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/19/22 22:36	378148.4			0.6			1.18			0.56			1.71			0		
05/19/22 22:37	358124.3			0.6			1.25			0.52			1.72			0		
05/19/22 22:38	335943.7			0.7			1.32			0.55			1.7			0		
05/19/22 22:39	311144.5			0.7			1.41			0.51			1.68			0		
05/19/22 22:40	290427.2			0.7			1.43			0.48			1.59			0		
05/19/22 22:41	269478.9			0.7			1.45			0.46			1.5			1		
05/19/22 22:42	245681			0.6			1.5			0.32			1.41			1		
05/19/22 22:43	224655.6			0.4			4.7			0.21			4.04			1		
05/19/22 22:44	201473.8			0.2			10.82			0.1			8.35			1		
05/19/22 22:45	178523			3.1			17.58			1.28			12.02			1		
05/19/22 22:46	160501.3			230			20.03			85.91			12.32			1		
05/19/22 22:47	142248.5			1083.7			23.6			358.77			12.86			1		
05/19/22 22:48	57993			1918			25.21			258.9			5.6			1		
05/19/22 22:49	31807.6			0			31.65			271.79			3.86			0		
05/19/22 22:50	31807.6			0			0.2			0			0			0		
05/19/22 22:51	31884.6			0			0.2			0			0			0		
05/19/22 22:52	31576.5			0			0.1			0			0			0		
05/19/22 22:53	31499.5			0			0.1			0			0			0		

CT1 SUSD EVENT 15

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/24/22 8:05	35350.3			0			0			0			0			0		
05/24/22 8:06	34965.3			0			0			0			0			0		
05/24/22 8:07	34811.2			0			0			0			0			0		
05/24/22 8:08	34734.2			0			0			0			0			0		
05/24/22 8:09	38739			0			0			0			0			0		
05/24/22 8:10	42820.9			0			0			0			0			1		
05/24/22 8:11	45054.3			0			0			0			0			1		
05/24/22 8:12	51985.8			1.5			0.3			0			0			1		
05/24/22 8:13	61227.7			1118.9			15.55			159.54			3.65			1		
05/24/22 8:14	70854.7			878.7			18.07			144.97			4.91			1		
05/24/22 8:15	86026.8			481.6			22.98			96.49			7.58			1		
05/24/22 8:16	125073.9			293.3			26.41			85.42			12.66			1		
05/24/22 8:17	144019.9			187.1			38.35			62.73			21.16			1		
05/24/22 8:18	148563.8			291.9			50.25			100.97			28.6			1		
05/24/22 8:19	150951.3			2004.6			43.46			704.5			25.14			1		
05/24/22 8:20	151567.4			1972.8			44.07			695.97			25.58			1		
05/24/22 8:21	165430.3			1972.8			51.63			759.56			32.71			1		
05/24/22 8:22	185839.5			1856.8			64.55			803.41			45.97			1		
05/24/22 8:23	207018.9			599.8			71.73			289.06			56.89			1		
05/24/22 8:24	229199.5			84.7			64.5			45.22			56.65			1		
05/24/22 8:25	250455.9			5.4			56.88			3.17			54.58			1		
05/24/22 8:26	275717.2			2.5			46.13			1.58			48.72			1		
05/24/22 8:27	298282.9			2.2			20.41			1.54			23.32			1		
05/24/22 8:28	316920.7			2.1			13.41			1.58			16.28			1		
05/24/22 8:29	333325.1			2.1			11.1			1.64			14.17			1		
05/24/22 8:30	336020.7			2.1			9.69			1.65			12.47			1		
05/24/22 8:31	336174.7			2			7.42			1.54			9.56			1		
05/24/22 8:32	333248.1			1.8			7.13			1.37			9.11			1		
05/24/22 8:33	331861.8			1.6			6.43			1.22			8.17			1		
05/24/22 8:34	332092.9			1.4			6.16			1.09			7.84			1		
05/24/22 8:35	331091.7			1.2			5.81			0.95			7.37			1		
05/24/22 8:36	331245.7			1.1			5.46			0.88			6.93			1		
05/24/22 8:37	330244.5			1.1			5.37			0.81			6.8			1		
05/24/22 8:38	330321.5			1.1			5.2			0.81			6.57			1		

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/24/22 8:39	329089.3			1			5.1			0.75			6.43			1		
05/24/22 8:40	329782.4			1			5.01			0.75			6.33			1		
05/24/22 8:41	329551.3			1			4.92			0.75			6.21			1		
05/24/22 8:42	328935.2			0.9			4.83			0.68			6.08			1		
05/24/22 8:43	328858.2			0.9			4.74			0.68			5.97			1		
05/24/22 8:44	329012.2			0.9			4.74			0.68			5.97			1		
05/24/22 8:45	328627.2			0.8			4.65			0.62			5.85			1		
05/24/22 8:46	328781.2			0.8			4.65			0.62			5.86			1		
05/24/22 8:47	329089.3			0.8			4.65			0.62			5.86			1		
05/24/22 8:48	327857			0.8			4.65			0.61			5.84			1		
05/24/22 8:49	328396.1			0.8			4.65			0.62			5.85			1		
05/24/22 8:50	327240.9			0.8			4.65			0.61			5.83			1		
05/24/22 8:51	319231.2			0.8			4.65			0.6			5.69			1		
05/24/22 8:52	316920.7			0.8			5.45			0.59			6.62			1		
05/24/22 8:53	315380.4			0.8			5.63			0.59			6.81			1		
05/24/22 8:54	314610.3			0.7			5.72			0.52			6.9			1		
05/24/22 8:55	312915.9			0.7			5.26			0.53			6.31			1		
05/24/22 8:56	312068.7			0.7			3.09			0.53			3.69			1		
05/24/22 8:57	310066.3			0.7			2.72			0.52			3.24			1		
05/24/22 8:58	308371.9			0.7			2.63			0.52			3.11			1		
05/24/22 8:59	307986.9			0.7			2.54			0.52			3			1		
05/24/22 9:00	305599.4			0.6			2.45			0.45			2.87			1		
05/24/22 9:01	304059.1			0.6			2.36			0.45			2.75			1		
05/24/22 9:02	299515.1			0.6			2.18			0.44			2.5			1		
05/24/22 9:03	295356.3			0.6			2.03			0.44			2.3			1		
05/24/22 9:04	289965.1			0.6			1.94			0.37			2.15			1		
05/24/22 9:05	285960.3			0.6			1.75			0.37			1.92			1		
05/24/22 9:06	285344.2			0.6			1.69			0.37			1.84			1		
05/24/22 9:07	282494.6			0.6			1.69			0.37			1.82			0		
05/24/22 9:08	273021.6			0.6			1.69			0.36			1.76			0		
05/24/22 9:09	268400.7			0.5			1.71			0.3			1.76			0		
05/24/22 9:10	267861.6			0.5			1.9			0.3			1.95			0		
05/24/22 9:11	269632.9			0.4			2.22			0.24			2.3			0		

CT1 SUSD EVENT 16

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/25/22 22:48	269864			0.4			2.28			0.24			2.36			0		
05/25/22 22:49	269941			0.5			2.19			0.3			2.26			0		
05/25/22 22:50	271866.4			0.5			2.09			0.3			2.18			0		
05/25/22 22:51	272020.4			0.5			1.9			0.3			1.98			0		
05/25/22 22:52	272251.5			0.5			1.71			0.3			1.79			0		
05/25/22 22:53	268323.7			0.5			1.52			0.3			1.57			1		
05/25/22 22:54	247606.3			0.5			1.52			0.27			1.44			1		
05/25/22 22:55	225964.9			0.4			2.56			0.21			2.21			1		
05/25/22 22:56	201473.8			0.3			8.26			0.15			6.38			1		
05/25/22 22:57	178137.9			2.3			16.01			0.95			10.93			1		
05/25/22 22:58	160655.3			98.7			20.11			36.92			12.38			1		
05/25/22 22:59	142017.5			745.9			23.44			246.6			12.76			1		
05/25/22 23:00	69006.3			1880			26.82			302.15			7.09			1		
05/25/22 23:01	47518.9			0			35.4			387.81			6.44			0		
05/25/22 23:02	47441.8			0			0.2			0			0			0		
05/25/22 23:03	47364.8			0			0.1			0			0			0		
05/25/22 23:04	47287.8			0			0.1			0			0			0		
05/25/22 23:05	47056.8			0			0.1			0			0			0		

CT1 SUSD EVENT 17

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/26/22 11:34	46363.6			0			0			0			0			0		
05/26/22 11:35	46363.6			0			0			0			0			0		
05/26/22 11:36	46594.7			0			0			0			0			0		
05/26/22 11:37	46440.6			0			0			0			0			0		
05/26/22 11:38	46671.7			0			0			0			0			0		
05/26/22 11:39	49598.3			0			0			0			0			1		
05/26/22 11:40	52139.8			0			0			0			0			1		
05/26/22 11:41	59918.4			73.8			32.45			10.28			7.45			1		
05/26/22 11:42	68159.1			1160.6			18.96			184.2			4.95			1		
05/26/22 11:43	78017.2			696.5			26.38			126.45			7.88			1		
05/26/22 11:44	100197.8			374.9			28.62			87.46			10.98			1		
05/26/22 11:45	138089.6			230.1			37.28			73.96			19.72			1		
05/26/22 11:46	147408.6			141.2			54.85			48.44			30.98			1		
05/26/22 11:47	162349.7			917			54.43			346.48			33.85			1		
05/26/22 11:48	181603.7			1916.2			54.58			810.26			37.98			1		
05/26/22 11:49	203476.2			786.6			55.97			372.59			43.63			1		
05/26/22 11:50	225502.8			127			54.93			66.66			47.45			1		
05/26/22 11:51	246605.1			9			51.87			5.15			49.01			1		
05/26/22 11:52	272174.4			1.9			46.44			1.18			48.43			1		
05/26/22 11:53	282263.5			1.6			22.22			1.03			24.04			1		
05/26/22 11:54	282494.6			1.5			13.62			1.01			14.74			1		
05/26/22 11:55	281801.4			1.6			11.35			1.07			12.25			1		
05/26/22 11:56	281724.4			1.6			10.6			1.03			11.44			1		
05/26/22 11:57	280954.3			1.4			9.5			0.9			10.22			1		
05/26/22 11:58	288501.8			1.2			9.5			0.8			10.49			1		
05/26/22 11:59	308371.9			1			8.52			0.74			10.07			1		
05/26/22 12:00	328319.1			0.9			7.47			0.7			9.39			1		
05/26/22 12:01	345724.7			0.9			6.72			0.73			8.9			1		
05/26/22 12:02	358047.3			1			4.81			0.83			6.6			1		
05/26/22 12:03	347342			0.9			4.7			0.75			6.26			1		
05/26/22 12:04	326547.7			0.8			5.1			0.61			6.37			1		
05/26/22 12:05	304059.1			0.9			5.2			0.62			6.05			1		
05/26/22 12:06	286114.3			0.9			5.27			0.6			5.78			1		
05/26/22 12:07	281570.4			0.8			5.07			0.54			5.47			1		

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/26/22 12:08	284497			0.7			6.37			0.43			6.94			1		
05/26/22 12:09	288116.8			0.6			6.46			0.38			7.13			1		
05/26/22 12:10	289811.1			0.6			6.56			0.38			7.28			1		
05/26/22 12:11	286345.4			0.6			6.37			0.37			6.99			1		
05/26/22 12:12	282802.7			0.6			6.18			0.37			6.7			1		
05/26/22 12:13	283033.7			0.6			6.27			0.37			6.81			1		
05/26/22 12:14	287038.5			0.6			6.65			0.38			7.31			1		
05/26/22 12:15	289888.1			0.5			6.74			0.32			7.49			1		
05/26/22 12:16	287500.6			0.6			6.37			0.38			7.01			1		
05/26/22 12:17	282802.7			0.6			6.37			0.37			6.9			1		
05/26/22 12:18	282109.5			0.6			6.47			0.37			6.99			1		
05/26/22 12:19	284497			0.6			4.28			0.38			4.67			1		
05/26/22 12:20	286268.4			0.5			3.05			0.32			3.34			1		
05/26/22 12:21	287962.7			0.5			2.85			0.32			3.15			1		
05/26/22 12:22	288809.9			0.6			2.66			0.38			2.95			1		
05/26/22 12:23	285267.2			0.6			2.47			0.38			2.7			1		
05/26/22 12:24	281339.3			0.6			2.38			0.37			2.56			1		
05/26/22 12:25	279876			0.5			2.28			0.31			2.45			1		
05/26/22 12:26	285498.2			0.5			2.13			0.32			2.33			1		
05/26/22 12:27	289734.1			0.5			2			0.32			2.22			1		
05/26/22 12:28	286037.3			0.5			1.9			0.32			2.09			1		
05/26/22 12:29	283649.8			0.5			1.81			0.31			1.96			1		
05/26/22 12:30	281416.4			0.5			1.62			0.31			1.74			0		
05/26/22 12:31	279336.9			0.5			1.43			0.31			1.53			0		
05/26/22 12:32	281647.4			0.5			1.35			0.32			1.46			0		
05/26/22 12:33	284420			0.5			1.35			0.32			1.48			0		
05/26/22 12:34	285421.2			0.5			1.33			0.32			1.46			0		

CT1 SUSD EVENT 18

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/26/22 20:07	435602.3			0.6			1.29			0.65			2.15			0		
05/26/22 20:08	434601.1			0.6			1.38			0.65			2.3			0		
05/26/22 20:09	434062			0.6			1.38			0.65			2.3			0		
05/26/22 20:10	434524.1			0.6			1.48			0.65			2.46			0		
05/26/22 20:11	434139			0.6			1.48			0.65			2.45			0		
05/26/22 20:12	434678.2			0.6			1.48			0.65			2.46			1		
05/26/22 20:13	428747.9			0.6			1.48			0.64			2.42			1		
05/26/22 20:14	410803.2			0.6			1.57			0.62			2.47			1		
05/26/22 20:15	389469.8			0.6			1.91			0.58			2.84			1		
05/26/22 20:16	367905.3			0.7			2.41			0.61			3.4			1		
05/26/22 20:17	347265			0.7			2.47			0.57			3.28			1		
05/26/22 20:18	321695.7			0.8			2.64			0.59			3.26			1		
05/26/22 20:19	298822			0.8			2.82			0.55			3.23			1		
05/26/22 20:20	278489.8			0.8			2.95			0.52			3.15			1		
05/26/22 20:21	256232.1			0.7			3.23			0.44			3.17			1		
05/26/22 20:22	232896.3			0.6			5.32			0.31			4.75			1		
05/26/22 20:23	210715.7			0.4			9.59			0.21			7.74			1		
05/26/22 20:24	186455.7			2.1			22.44			0.9			16.03			1		
05/26/22 20:25	167124.7			106.3			25.44			41.37			16.29			1		
05/26/22 20:26	150335.2			794.2			28.74			278.06			16.56			1		
05/26/22 20:27	91495			1809			28.81			385.51			10.1			1		
05/26/22 20:28	37814.8			0			32.83			222.28			4.75			0		
05/26/22 20:29	37814.8			0			0.3			0			0			0		
05/26/22 20:30	37814.8			0			0.2			0			0			0		
05/26/22 20:31	37737.8			0			0.2			0			0			0		
05/26/22 20:32	37660.8			0			0.1			0			0			0		

CT1 SUSD EVENT 19

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/06/22 13:34	47210.8			0			0			0			0			0		
06/06/22 13:35	47133.8			0			0			0			0			0		
06/06/22 13:36	47287.8			0			0			0			0			0		
06/06/22 13:37	47287.8			0			0			0			0			0		
06/06/22 13:38	49983.4			0			0			0			0			0		
06/06/22 13:39	53141			0			0			0			0			1		
06/06/22 13:40	54758.4			0			0			0			0			1		
06/06/22 13:41	59379.3			1.4			0.1			0			0			1		
06/06/22 13:42	66849.9			1306.1			19.91			205.24			5.15			1		
06/06/22 13:43	75783.7			211.4	X		11.31	X		37.67	X		3.32	X		1		
06/06/22 13:44	88183.3			211.4	X		27.04	X		43.82	X		9.22	X		1		
06/06/22 13:45	122224.4			126.9	X		28.91	X		36.43	X		13.66	X		1		
06/06/22 13:46	147331.6			110.3	X		39.25	X		38.2	X		22.37	X		1		
06/06/22 13:47	151721.5			87.5	X		52.69	X		31.2	X		30.92	X		1		
06/06/22 13:48	163350.9			81.8	X		38.64	X		31.42	X		24.41	X		1		
06/06/22 13:49	181218.6			79.3	X		40.19	X		33.77	X		28.18	X		1		
06/06/22 13:50	203168.1			68.6	X		51.03	X		32.74	X		40.1	X		1		
06/06/22 13:51	225887.8			131.3			57.88			69.74			50.57			1		
06/06/22 13:52	245681			10.6			60.11			6.1			57.13			1		
06/06/22 13:53	271866.4			2.1			57.44			1.35			60.42			1		
06/06/22 13:54	295587.3			1.8			28			1.25			32.02			1		
06/06/22 13:55	313763.1			1.7			16.43			1.27			19.94			1		
06/06/22 13:56	309527.2			1.8			12.78			1.3			15.31			1		
06/06/22 13:57	302903.8			1.8			11.89			1.27			13.93			1		
06/06/22 13:58	320001.4			1.6			9.8			1.23			12.13			1		
06/06/22 13:59	339717.5			1.5			9.53			1.16			12.52			1		
06/06/22 14:00	355043.6			1.3			8.05			1.12			11.05			1		
06/06/22 14:01	373296.4			1.3			5.99			1.13			8.65			1		
06/06/22 14:02	396170.2			1.2			5.06			1.13			7.75			1		
06/06/22 14:03	418504.8			1			4.95			1.03			8.01			1		
06/06/22 14:04	432598.7			0.9			4.57			0.87			7.64			1		
06/06/22 14:05	427053.6			0.8			5.43			0.85			8.97			1		
06/06/22 14:06	425513.3			0.8			5.06			0.84			8.32			1		
06/06/22 14:07	429980.2			0.9			4.66			0.87			7.76			1		

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/06/22 14:08	435602.3			0.8			4.09			0.78			6.9			1		
06/06/22 14:09	437835.8			0.7			4.19			0.69			7.09			1		
06/06/22 14:10	438683			0.7			4.21			0.68			7.15			1		
06/06/22 14:11	437912.8			0.6			4.5			0.58			7.61			1		
06/06/22 14:12	437296.7			0.6			3.37			0.58			5.7			1		
06/06/22 14:13	437604.8			0.6			1.59			0.58			2.7			1		
06/06/22 14:14	437912.8			0.6			1.31			0.58			2.22			1		
06/06/22 14:15	438143.9			0.6			1.12			0.58			1.9			1		
06/06/22 14:16	435140.3			0.6			1.22			0.57			2.05			0		
06/06/22 14:17	418427.8			0.6			1.5			0.55			2.43			0		
06/06/22 14:18	396863.3			0.6			1.59			0.52			2.44			0		
06/06/22 14:19	373296.4			0.5			1.72			0.48			2.49			0		
06/06/22 14:20	351500.9			0.6			1.88			0.52			2.55			0		

CT1 SUSD EVENT 20

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/06/22 17:53	442302.7			0.7			1.5			0.68			2.56			0		
06/06/22 17:54	442687.8			0.7			1.5			0.68			2.57			0		
06/06/22 17:55	443226.9			0.7			1.5			0.68			2.57			0		
06/06/22 17:56	442533.8			0.7			1.5			0.68			2.57			0		
06/06/22 17:57	440839.4			0.7			1.5			0.68			2.56			0		
06/06/22 17:58	441609.6			0.7			1.5			0.68			2.56			1		
06/06/22 17:59	433908			0.7			1.5			0.67			2.51			1		
06/06/22 18:00	417503.6			0.7			1.59			0.64			2.57			1		
06/06/22 18:01	394937.9			0.6			1.84			0.6			2.82			1		
06/06/22 18:02	372526.3			0.7			2.45			0.64			3.53			1		
06/06/22 18:03	351423.9			0.7			2.5			0.59			3.4			1		
06/06/22 18:04	326239.7			0.8			2.55			0.61			3.22			1		
06/06/22 18:05	303288.9			0.8			2.77			0.57			3.25			1		
06/06/22 18:06	283341.8			0.8			2.81			0.54			3.08			1		
06/06/22 18:07	261546.2			0.7			3.09			0.4			3.13			1		
06/06/22 18:08	237825.3			0.6			4.74			0.32			4.36			1		
06/06/22 18:09	217570.1			0.4			8.59			0.21			7.23			1		
06/06/22 18:10	193156.1			1			23.48			0.47			17.55			1		
06/06/22 18:11	172746.8			14.8			27.01			6.02			18.05			1		
06/06/22 18:12	156573.5			515.2			30.39			189.6			18.4			1		
06/06/22 18:13	105665.9			1591.1			31.69			395.35			12.96			1		
06/06/22 18:14	54681.3			0			35.91			326.67			7.59			0		
06/06/22 18:15	54142.2			0			0.3			0			0			0		
06/06/22 18:16	53757.1			0			0.2			0			0			0		
06/06/22 18:17	53372.1			0			0.2			0			0			0		
06/06/22 18:18	52833			0			0.2			0			0			0		

CT1 SUSD EVENT 21

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/08/22 3:39	28495.9			0			0			0			0			0		
06/08/22 3:40	28495.9			0			0			0			0			0		
06/08/22 3:41	28341.9			0			0			0			0			0		
06/08/22 3:42	28341.9			0			0			0			0			0		
06/08/22 3:43	29882.2			0			0			0			0			0		
06/08/22 3:44	34657.2			0			0			0			0			1		
06/08/22 3:45	40972.5			1.2			0			0			0			1		
06/08/22 3:46	50445.5			1334.2			20.23			158.29			3.95			1		
06/08/22 3:47	61227.7			1150.1			15.34			165.54			3.63			1		
06/08/22 3:48	73704.3			707.7			23.25			122.61			6.63			1		
06/08/22 3:49	104818.7			427.5			27.14			105.35			11.01			1		
06/08/22 3:50	140631.2			286.2			36.74			94.61			19.99			1		
06/08/22 3:51	146715.4			184.9			54.63			63.77			31.01			1		
06/08/22 3:52	158806.9			1546.6			53.69			577.46			32.99			1		
06/08/22 3:53	176135.5			1969.5			57.34			815.16			39.06			1		
06/08/22 3:54	197931			1378.3			62.11			641.12			47.55			1		
06/08/22 3:55	221112.9			264.2			62.02			137.33			53.05			1		
06/08/22 3:56	240289.8			28.7			57.08			16.23			53.05			1		
06/08/22 3:57	266244.2			3			51.85			1.85			53.41			1		
06/08/22 3:58	290812.3			2			34.26			1.34			38.55			1		
06/08/22 3:59	312222.8			1.8			16.04			1.35			19.37			1		
06/08/22 4:00	331399.7			1.8			12.24			1.44			15.69			1		
06/08/22 4:01	348420.3			1.9			11.11			1.56			14.97			1		
06/08/22 4:02	365286.8			1.9			8.54			1.66			12.07			1		
06/08/22 4:03	385542			1.7			6.79			1.54			10.13			1		
06/08/22 4:04	406182.3			1.5			6.17			1.39			9.7			1		
06/08/22 4:05	428516.9			1.3			5.99			1.3			9.93			1		
06/08/22 4:06	453778.1			1			5.53			1.08			9.71			1		
06/08/22 4:07	454394.3			0.9			6.45			0.98			11.34			1		
06/08/22 4:08	452622.9			0.9			6.73			0.98			11.78			1		
06/08/22 4:09	450851.5			0.8			6.45			0.88			11.25			1		
06/08/22 4:10	450928.5			0.8			6.36			0.88			11.1			1		
06/08/22 4:11	451698.7			0.8			6.18			0.88			10.79			1		
06/08/22 4:12	451082.6			0.7			6.08			0.78			10.62			1		

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/08/22 4:13	450851.5			0.7			5.99			0.78			10.45			1		
06/08/22 4:14	450697.5			0.7			5.99			0.78			10.45			1		
06/08/22 4:15	450851.5			0.7			5.9			0.78			10.29			1		
06/08/22 4:16	451005.5			0.7			5.9			0.78			10.29			1		
06/08/22 4:17	450928.5			0.6			5.9			0.68			10.29			1		
06/08/22 4:18	451159.6			0.6			5.99			0.68			10.46			1		
06/08/22 4:19	450774.5			0.6			5.99			0.68			10.45			1		
06/08/22 4:20	451313.6			0.6			6.08			0.68			10.62			1		
06/08/22 4:21	451544.7			0.6			5.62			0.68			9.82			1		
06/08/22 4:22	451467.6			0.6			2.95			0.68			5.15			1		
06/08/22 4:23	451159.6			0.6			2.12			0.68			3.7			1		
06/08/22 4:24	451698.7			0.6			2.12			0.69			3.7			1		
06/08/22 4:25	451544.7			0.6			2.21			0.68			3.86			1		
06/08/22 4:26	452006.8			0.6			2.4			0.69			4.19			1		
06/08/22 4:27	451775.7			0.6			2.58			0.69			4.51			1		
06/08/22 4:28	451159.6			0.6			2.77			0.68			4.83			1		
06/08/22 4:29	452314.8			0.6			2.67			0.69			4.68			1		
06/08/22 4:30	452083.8			0.6			2.49			0.69			4.35			1		
06/08/22 4:31	451698.7			0.6			2.21			0.69			3.87			1		
06/08/22 4:32	452391.8			0.6			1.84			0.69			3.23			1		
06/08/22 4:33	452006.8			0.6			1.66			0.69			2.9			1		
06/08/22 4:34	451775.7			0.6			1.48			0.69			2.58			1		
06/08/22 4:35	452237.8			0.6			1.38			0.69			2.42			0		
06/08/22 4:36	451698.7			0.6			1.38			0.69			2.42			0		
06/08/22 4:37	452006.8			0.6			1.38			0.69			2.42			0		
06/08/22 4:38	452391.8			0.6			1.29			0.69			2.26			0		
06/08/22 4:39	452314.8			0.6			1.29			0.69			2.26			0		

CT1 SUSD EVENT 22

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/17/22 13:11	269555.9			0.4			1.57			0.25			1.64			0		
06/17/22 13:12	269324.8			0.4			1.57			0.25			1.64			0		
06/17/22 13:13	270326.1			0.4			1.57			0.25			1.64			0		
06/17/22 13:14	269324.8			0.4			1.57			0.25			1.64			0		
06/17/22 13:15	270326.1			0.4			1.48			0.25			1.54			0		
06/17/22 13:16	266783.3			0.4			1.45			0.24			1.5			1		
06/17/22 13:17	245681			0.4			1.45			0.22			1.38			1		
06/17/22 13:18	224655.6			0.4			3.3			0.21			2.87			1		
06/17/22 13:19	200241.5			0.2			9.91			0.1			7.68			1		
06/17/22 13:20	177675.8			3.2			12.78			1.33			8.79			1		
06/17/22 13:21	159654.1			225.7			15.73			84.69			9.71			1		
06/17/22 13:22	141709.4			1118.1			18.03			372.4			9.88			1		
06/17/22 13:23	50291.4			1970.6			18.81			232.91			3.66			1		
06/17/22 13:24	50060.4			0			35.4			642.72			6.86			0		
06/17/22 13:25	49983.4			0			0.1			0			0			0		
06/17/22 13:26	49829.3			0			0.1			0			0			0		
06/17/22 13:27	49675.3			0			0.1			0			0			0		
06/17/22 13:28	49675.3			0			0.1			0			0			0		

CT1 SUSD EVENT 23

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/20/22 14:10	51754.7			0			0			0			0			0		
06/20/22 14:11	51831.8			0			0			0			0			0		
06/20/22 14:12	51985.8			0			0			0			0			0		
06/20/22 14:13	51908.8			0			0			0			0			0		
06/20/22 14:14	81945			0			0			0			0			0		
06/20/22 14:15	55682.5			0			0			0			0			1		
06/20/22 14:16	57530.9			0			0			0			0			1		
06/20/22 14:17	62151.9			2.4			0.1			0			0			1		
06/20/22 14:18	69545.4			1261.1			19.18			206.08			5.16			1		
06/20/22 14:19	77478.1			952.7			17.7			173.58			5.31			1		
06/20/22 14:20	88183.3			507.1			22.62			105.11			7.72			1		
06/20/22 14:21	117988.5			257.1			25.85			71.3			11.8			1		
06/20/22 14:22	148255.8			151.3			39.25			52.75			22.51			1		
06/20/22 14:23	148255.8			96.5			57.74			33.64			33.12			1		
06/20/22 14:24	157959.8			1461.8			53.3			542.86			32.57			1		
06/20/22 14:25	173594			2019.3			58.43			824.03			39.24			1		
06/20/22 14:26	193387.1			1433.4			70.63			651.65			52.84			1		
06/20/22 14:27	217339.1			282.4			72.62			144.28			61.05			1		
06/20/22 14:28	238056.4			23.7			64.38			13.28			59.29			1		
06/20/22 14:29	262085.4			2.5			57.15			1.57			57.94			1		
06/20/22 14:30	280954.3			1.9			36.12			1.23			39.26			1		
06/20/22 14:31	283726.8			1.7			16.39			1.12			17.99			1		
06/20/22 14:32	290658.3			1.7			11.35			1.18			12.76			1		
06/20/22 14:33	307293.7			1.8			9.86			1.27			11.73			1		
06/20/22 14:34	312145.8			1.6			8.02			1.15			9.69			1		
06/20/22 14:35	312530.8			1.5			7.26			1.07			8.78			1		
06/20/22 14:36	312145.8			1.5			6.55			1.08			7.9			1		
06/20/22 14:37	310066.3			1.4			5.72			1.01			6.86			1		
06/20/22 14:38	309296.2			1.2			5.25			0.87			6.29			1		
06/20/22 14:39	307601.8			1.1			4.79			0.8			5.7			1		
06/20/22 14:40	306523.6			1			4.78			0.74			5.66			1		
06/20/22 14:41	305676.4			0.9			4.59			0.67			5.43			1		
06/20/22 14:42	305676.4			0.9			4.5			0.67			5.32			1		
06/20/22 14:43	311606.6			0.8			4.31			0.62			5.19			1		

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/20/22 14:44	317305.8			0.8			4.31			0.63			5.29			1		
06/20/22 14:45	317998.9			0.8			4.15			0.62			5.1			1		
06/20/22 14:46	317690.9			0.8			4.06			0.62			4.99			1		
06/20/22 14:47	317228.8			0.8			3.96			0.62			4.86			1		
06/20/22 14:48	316997.8			0.7			3.87			0.55			4.75			1		
06/20/22 14:49	317613.9			0.7			3.78			0.55			4.64			1		
06/20/22 14:50	306831.6			0.7			3.75			0.54			4.45			1		
06/20/22 14:51	287423.6			0.7			3.75			0.51			4.16			1		
06/20/22 14:52	276564.3			0.7			3.81			0.43			4.07			1		
06/20/22 14:53	281339.3			0.6			4.03			0.39			4.39			1		
06/20/22 14:54	289272			0.5			4.52			0.33			5.06			1		
06/20/22 14:55	288886.9			0.5			4.55			0.33			5.08			1		
06/20/22 14:56	286191.3			0.5			4.35			0.33			4.82			1		
06/20/22 14:57	286037.3			0.6			4.26			0.39			4.71			1		
06/20/22 14:58	292737.7			0.6			4.26			0.4			4.82			1		
06/20/22 14:59	312607.8			0.5			4.26			0.36			5.15			1		
06/20/22 15:00	330783.6			0.6			4.09			0.44			5.24			1		
06/20/22 15:01	333171.1			0.6			2.62			0.44			3.38			1		
06/20/22 15:02	331014.7			0.7			1.97			0.51			2.52			1		
06/20/22 15:03	328165.1			0.7			1.97			0.51			2.5			1		
06/20/22 15:04	329166.3			0.7			2.15			0.51			2.74			1		
06/20/22 15:05	330398.5			0.7			2.43			0.58			3.11			1		
06/20/22 15:06	332400.9			0.7			2.62			0.51			3.37			1		
06/20/22 15:07	331553.8			0.7			2.9			0.51			3.72			1		
06/20/22 15:08	340641.7			0.7			3			0.52			3.95			1		
06/20/22 15:09	355890.8			0.7			2.34			0.55			3.22			1		
06/20/22 15:10	372988.3			0.7			1.81			0.58			2.61			1		
06/20/22 15:11	382846.4			0.6			1.74			0.52			2.58			1		
06/20/22 15:12	386543.2			0.6			2.03			0.53			3.04			1		
06/20/22 15:13	386081.1			0.6			2.61			0.53			3.9			1		
06/20/22 15:14	387621.4			0.6			2.61			0.53			3.92			1		
06/20/22 15:15	388853.7			0.6			1.93			0.53			2.91			1		
06/20/22 15:16	392704.4			0.6			1.64			0.54			2.5			1		
06/20/22 15:17	392704.4			0.6			1.55			0.54			2.35			1		
06/20/22 15:18	399173.8			0.6			1.55			0.54			2.39			1		
06/20/22 15:19	412805.6			0.6			1.55			0.56			2.47			0		
06/20/22 15:20	404333.8			0.6			1.62			0.54			2.53			0		

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/20/22 15:21	403332.7			0.7			1.71			0.63			2.67			0		
06/20/22 15:22	407260.5			0.7			1.84			0.65			2.89			0		
06/20/22 15:23	403024.6			0.7			1.74			0.64			2.71			0		

CT1 SUSD EVENT 24

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/25/22 21:45	280954.3			0.8			1.45			0.54			1.58			0		
06/25/22 21:46	276256.3			0.7			1.57			0.48			1.67			0		
06/25/22 21:47	275717.2			0.7			1.71			0.43			1.83			0		
06/25/22 21:48	276179.3			0.6			1.81			0.37			1.93			0		
06/25/22 21:49	275332.1			0.6			1.9			0.37			2.03			0		
06/25/22 21:50	274484.9			0.6			1.81			0.37			1.92			1		
06/25/22 21:51	257002.3			0.5			1.71			0.29			1.7			1		
06/25/22 21:52	233358.4			0.5			2.32			0.27			2.1			1		
06/25/22 21:53	211870.9			0.4			6.42			0.21			5.26			1		
06/25/22 21:54	187225.8			1.4			15.96			0.61			11.56			1		
06/25/22 21:55	167355.7			11.2			19.75			4.39			12.79			1		
06/25/22 21:56	149950.1			641.8			23.16			226.12			13.43			1		
06/25/22 21:57	94344.6			1759.2			27.07			390.26			9.88			1		
06/25/22 21:58	45131.4			0			32.32			269.67			5.64			0		
06/25/22 21:59	45054.3			0			0.4			0			0			0		
06/25/22 22:00	45131.4			0			0.2			0			0			0		
06/25/22 22:01	45208.4			0			0.1			0			0			0		
06/25/22 22:02	45208.4			0			0.1			0			0			0		

CT1 SUSD EVENT 25

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/26/22 10:00	41203.5			0			0			0			0			0		
06/26/22 10:01	41126.5			0			0			0			0			0		
06/26/22 10:02	40972.5			0			0			0			0			0		
06/26/22 10:03	41126.5			0			0			0			0			0		
06/26/22 10:04	41280.6			0			0			0			0			0		
06/26/22 10:05	45285.4			0			0			0			0			1		
06/26/22 10:06	49136.2			0.7			0			0			0			1		
06/26/22 10:07	56529.7			6.9			26.55			0.92			5.81			1		
06/26/22 10:08	65925.7			1047.8			18.88			162.31			4.81			1		
06/26/22 10:09	76091.8			579.8			27.53			103.71			8.1			1		
06/26/22 10:10	100582.9			315.4			24.78			74.54			9.64			1		
06/26/22 10:11	140092			188.5			41.84			62.08			22.67			1		
06/26/22 10:12	143634.8			122.6			55.94			41.38			31.08			1		
06/26/22 10:13	156650.5			989.1			53.48			364.22			32.41			1		
06/26/22 10:14	175134.3			1941.7			52.73			799.29			35.72			1		
06/26/22 10:15	195851.6			1046.9			54.9			481.82			41.58			1		
06/26/22 10:16	218956.4			175.1			54.54			90.13			46.19			1		
06/26/22 10:17	238518.5			12.1			51.84			6.75			47.83			1		
06/26/22 10:18	265012			2			47.09			1.25			48.28			1		
06/26/22 10:19	288116.8			1.7			25.9			1.15			28.86			1		
06/26/22 10:20	305599.4			1.7			13.46			1.19			15.91			1		
06/26/22 10:21	309604.2			1.7			9.92			1.24			11.88			1		
06/26/22 10:22	310682.4			1.6			9.39			1.17			11.28			1		
06/26/22 10:23	309681.2			1.4			8.31			1.04			9.96			1		
06/26/22 10:24	307986.9			1.3			7.87			0.97			9.37			1		
06/26/22 10:25	307139.7			1.2			6.97			0.84			8.28			1		
06/26/22 10:26	306523.6			1.1			6.79			0.77			8.05			1		
06/26/22 10:27	306677.6			1			6.72			0.72			7.97			1		
06/26/22 10:28	306292.5			1			6.44			0.72			7.64			1		
06/26/22 10:29	305368.3			0.9			6.17			0.65			7.29			1		
06/26/22 10:30	303365.9			0.9			6.08			0.65			7.14			1		
06/26/22 10:31	302672.8			0.8			5.99			0.58			7.01			1		
06/26/22 10:32	302210.7			0.8			6.08			0.59			7.11			1		
06/26/22 10:33	301594.6			0.8			5.99			0.59			6.99			1		

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/26/22 10:34	301825.6			0.7			5.99			0.52			7			1		
06/26/22 10:35	301748.6			0.7			6.08			0.52			7.1			1		
06/26/22 10:36	301286.5			0.7			6.18			0.53			7.2			1		
06/26/22 10:37	302826.8			0.7			6.18			0.53			7.24			1		
06/26/22 10:38	302980.8			0.7			6.18			0.53			7.24			1		
06/26/22 10:39	302672.8			0.7			6.18			0.53			7.24			1		
06/26/22 10:40	301979.6			0.6			5.9			0.46			6.89			1		
06/26/22 10:41	299669.2			0.6			5.81			0.45			6.73			1		
06/26/22 10:42	283187.7			0.6			5.81			0.43			6.36			1		
06/26/22 10:43	275101.1			0.7			6.09			0.42			6.48			1		
06/26/22 10:44	271173.3			0.6			7.52			0.36			7.88			1		
06/26/22 10:45	268862.8			0.5			6.38			0.3			6.63			1		
06/26/22 10:46	269093.8			0.5			6			0.31			6.24			1		
06/26/22 10:47	269093.8			0.5			5.51			0.31			5.74			1		
06/26/22 10:48	268708.7			0.5			4.74			0.31			4.93			1		
06/26/22 10:49	268400.7			0.5			3.97			0.31			4.12			1		
06/26/22 10:50	268246.6			0.5			3.93			0.31			4.08			1		
06/26/22 10:51	267938.6			0.5			4.03			0.31			4.18			1		
06/26/22 10:52	267630.5			0.5			4.03			0.31			4.17			1		
06/26/22 10:53	267399.5			0.5			3.74			0.31			3.87			1		
06/26/22 10:54	268323.7			0.5			2.85			0.31			2.96			1		
06/26/22 10:55	267553.5			0.5			2.75			0.31			2.85			1		
06/26/22 10:56	267553.5			0.5			2.66			0.31			2.75			1		
06/26/22 10:57	267861.6			0.4			2.46			0.25			2.55			1		
06/26/22 10:58	267476.5			0.5			2.36			0.31			2.44			1		
06/26/22 10:59	267861.6			0.4			2.26			0.25			2.34			1		
06/26/22 11:00	267245.4			0.4			2.16			0.25			2.24			1		
06/26/22 11:01	267553.5			0.4			2.07			0.25			2.14			1		
06/26/22 11:02	267553.5			0.4			1.97			0.25			2.04			1		
06/26/22 11:03	267014.4			0.4			1.87			0.25			1.93			1		
06/26/22 11:04	267707.5			0.4			1.77			0.25			1.83			1		
06/26/22 11:05	267476.5			0.4			1.67			0.25			1.73			0		
06/26/22 11:06	267630.5			0.4			1.57			0.25			1.63			0		
06/26/22 11:07	267707.5			0.4			1.48			0.25			1.53			0		
06/26/22 11:08	267014.4			0.4			1.48			0.25			1.52			0		
06/26/22 11:09	267322.4			0.4			1.38			0.25			1.42			0		

CT2 SUSD EVENT 1

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/26/22 13:34	0			0			0			0			0			0		
04/26/22 13:35	0			0			0			0			0			0		
04/26/22 13:36	0			0			0			0			0			0		
04/26/22 13:37	0			0			0			0			0			0		
04/26/22 13:38	0			0			0			0			0			0		
04/26/22 13:39	6700.4			0.1			0			0			0			1		
04/26/22 13:40	14325			0.1			0			0			0			1		
04/26/22 13:41	28033.8			1.1			0			0			0			1		
04/26/22 13:42	43514			1262.6			8.26			127.75			1.38			1		
04/26/22 13:43	54681.3			977.6			14.38			124.29			3.01			1		
04/26/22 13:44	68159.1			583.2			19.25			92.42			5.02			1		
04/26/22 13:45	99581.6			394.5			23.88			91.3			9.1			1		
04/26/22 13:46	144867			250.1			24.37			84.2			13.5			1		
04/26/22 13:47	144867			169.4			47.83			57.04			26.5			1		
04/26/22 13:48	140939.2			1140.4			41.49			373.47			22.36			1		
04/26/22 13:49	139630			2073.7			39.53			672.6			21.1			1		
04/26/22 13:50	139167.9			2191.5			41.71			708.87			22.2			1		
04/26/22 13:51	137242.5			2178.9			45.17			695.04			23.71			1		
04/26/22 13:52	137011.4			2241.2			53.52			713.38			28.04			1		
04/26/22 13:53	137319.5			2235.7			63			713.14			33.07			1		
04/26/22 13:54	136395.3			2236.3			66.16			708.84			34.51			1		
04/26/22 13:55	135779.2			2232.7			66.8			704.2			34.67			1		
04/26/22 13:56	134855			2234.2			65.32			700.17			33.69			1		
04/26/22 13:57	135086			2225.4			64.69			698.39			33.41			1		
04/26/22 13:58	134238.8			2212.3			64.06			689.83			32.87			1		
04/26/22 13:59	134238.8			2209.6			63.64			688.98			32.66			1		
04/26/22 14:00	134315.9			2219.9			63			692.69			32.36			1		
04/26/22 14:01	135009			2226.8			62.58			698.35			32.3			1		
04/26/22 14:02	133160.6			2223.9			61.74			687.97			31.43			1		
04/26/22 14:03	134700.9			2317.6			63.37			725.27			32.64			1		
04/26/22 14:04	147716.6			2330.5			62.5			799.73			35.3			1		
04/26/22 14:05	169974.3			2165.5			62.26			855.08			40.46			1		
04/26/22 14:06	191846.8			1585.7			61.15			706.7			44.85			1		
04/26/22 14:07	218263.3			543			59.3			275.4			49.51			1		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/26/22 14:08	243678.5			75.5			54.8			42.75			51.06			1		
04/26/22 14:09	268631.7			10.9			52.29			6.79			53.71			1		
04/26/22 14:10	290273.2			5.9			35.51			3.98			39.41			1		
04/26/22 14:11	295125.2			5			16.27			3.46			18.36			1		
04/26/22 14:12	294278			4.3			13.64			2.96			15.36			1		
04/26/22 14:13	293507.9			3.7			12.26			2.52			13.76			1		
04/26/22 14:14	292737.7			3.1			11.99			2.1			13.42			1		
04/26/22 14:15	293199.8			2.5			11.24			1.72			12.6			1		
04/26/22 14:16	294278			2.2			10.68			1.54			12.02			1		
04/26/22 14:17	294432.1			2.1			10.21			1.41			11.49			1		
04/26/22 14:18	294432.1			1.9			10.09			1.3			11.36			1		
04/26/22 14:19	292968.8			1.8			9.71			1.23			10.87			1		
04/26/22 14:20	292660.7			1.8			9.61			1.23			10.76			1		
04/26/22 14:21	293507.9			1.7			9.33			1.17			10.47			1		
04/26/22 14:22	293045.8			1.7			9.14			1.17			10.24			1		
04/26/22 14:23	292121.6			1.7			9.14			1.16			10.2			1		
04/26/22 14:24	292891.8			1.6			9.14			1.1			10.23			1		
04/26/22 14:25	305676.4			1.6			9.23			1.15			10.79			1		
04/26/22 14:26	306369.5			1.5			7.9			1.08			9.25			1		
04/26/22 14:27	307755.8			1.4			7.59			1			8.93			1		
04/26/22 14:28	307216.7			1.3			7.59			0.94			8.91			1		
04/26/22 14:29	307601.8			1.2			7.68			0.87			9.03			1		
04/26/22 14:30	306985.7			1.1			7.9			0.81			9.27			1		
04/26/22 14:31	305907.4			1			7.9			0.74			9.24			1		
04/26/22 14:32	306754.6			1			7.99			0.75			9.38			1		
04/26/22 14:33	305599.4			1			5.33			0.74			6.23			1		
04/26/22 14:34	307293.7			1			4			0.68			4.7			1		
04/26/22 14:35	305984.5			1			3.71			0.68			4.34			1		
04/26/22 14:36	306446.6			1			3.43			0.68			4.01			1		
04/26/22 14:37	306369.5			1			3.33			0.68			3.9			1		
04/26/22 14:38	307216.7			0.9			3.14			0.61			3.69			1		
04/26/22 14:39	306754.6			0.9			2.85			0.61			3.35			1		
04/26/22 14:40	305907.4			0.9			2.57			0.61			3.01			1		
04/26/22 14:41	305676.4			0.9			2.38			0.61			2.78			1		
04/26/22 14:42	305214.3			0.8			2.09			0.54			2.44			1		
04/26/22 14:43	305830.4			0.8			1.9			0.54			2.23			1		
04/26/22 14:44	304752.2			0.8			1.81			0.54			2.11			1		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/26/22 14:45	317382.8			0.8			1.62			0.56			1.96			1		
04/26/22 14:46	328473.1			0.8			1.52			0.58			1.91			0		
04/26/22 14:47	329012.2			0.8			1.5			0.64			1.89			0		
04/26/22 14:48	328396.1			0.8			1.48			0.63			1.85			0		
04/26/22 14:49	328165.1			0.9			1.48			0.7			1.85			0		
04/26/22 14:50	328242.1			0.9			1.38			0.7			1.74			0		

CT2 SUSD EVENT 2

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/26/22 22:01	349421.5			1			0.35			0.79			0.47			0		
04/26/22 22:02	347188			1			0.44			0.78			0.58			0		
04/26/22 22:03	331938.8			1			0.44			0.75			0.56			0		
04/26/22 22:04	328242.1			1			0.45			0.75			0.56			0		
04/26/22 22:05	328935.2			0.9			0.45			0.69			0.57			0		
04/26/22 22:06	322157.8			0.8			0.45			0.61			0.56			1		
04/26/22 22:07	301517.5			0.8			0.45			0.57			0.52			1		
04/26/22 22:08	280415.2			0.8			0.55			0.54			0.59			1		
04/26/22 22:09	255616			0.8			0.86			0.45			0.84			1		
04/26/22 22:10	231356			0.6			3.21			0.33			2.84			1		
04/26/22 22:11	206248.8			1.5			6.24			0.71			4.92			1		
04/26/22 22:12	182450.8			10			9.36			4.24			6.53			1		
04/26/22 22:13	161502.5			516.3			12.52			193.71			7.73			1		
04/26/22 22:14	142787.6			1236.1			15.57			410.05			8.5			1		
04/26/22 22:15	23797.9			1759.3			22.27			97.27			2.03			1		
04/26/22 22:16	0			0			28.52			0			0			0		
04/26/22 22:17	0			0			0.2			0			0			0		
04/26/22 22:18	0			0			0.1			0			0			0		
04/26/22 22:19	0			0			0.1			0			0			0		
04/26/22 22:20	0			0			0.1			0			0			0		

CT2 SUSD EVENT 3

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/27/22 8:39	0			0			0			0			0			0		
04/27/22 8:40	0			0			0			0			0			0		
04/27/22 8:41	0			0			0			0			0			0		
04/27/22 8:42	0			0			0			0			0			0		
04/27/22 8:43	0			0			0			0			0			0		
04/27/22 8:44	10782.2			0.1			0			0			0			1		
04/27/22 8:45	21179.4			0.1			0			0			0			1		
04/27/22 8:46	37583.8			80.6			37.37			7.04			5.37			1		
04/27/22 8:47	49136.2			1374.2			15.88			156.89			2.98			1		
04/27/22 8:48	60149.5			931.2			20.82			130.06			4.79			1		
04/27/22 8:49	74320.4			608.6			25.46			105.04			7.23			1		
04/27/22 8:50	110286.9			489.1			28.62			125.36			12.07			1		
04/27/22 8:51	150720.3			331.9			40.53			116.21			23.35			1		
04/27/22 8:52	152414.6			218.1			54.93			77.23			32.01			1		
04/27/22 8:53	163042.8			1430.1			51.96			541.64			32.39			1		
04/27/22 8:54	180679.5			1825.9			54.94			766.34			37.95			1		
04/27/22 8:55	201935.9			1315			56.64			616.99			43.74			1		
04/27/22 8:56	227274.1			498.8			55.02			263.42			47.81			1		
04/27/22 8:57	252381.3			74.6			54.15			43.75			52.26			1		
04/27/22 8:58	276410.3			6			51.48			3.86			54.41			1		
04/27/22 8:59	303365.9			2.3			41.51			1.63			48.16			1		
04/27/22 9:00	328165.1			2.1			18.18			1.6			22.81			1		
04/27/22 9:01	348959.4			1.9			12.94			1.57			17.27			1		
04/27/22 9:02	370908.9			2			10.85			1.72			15.38			1		
04/27/22 9:03	390162.9			2			8.68			1.81			12.95			1		
04/27/22 9:04	402177.4			1.8			6.25			1.73			9.62			1		
04/27/22 9:05	422432.6			1.5			5.45			1.51			8.8			1		
04/27/22 9:06	432136.6			1.4			5.36			1.37			8.85			1		
04/27/22 9:07	443843.1			1.2			5.08			1.22			8.63			1		
04/27/22 9:08	461017.6			1.1			4.79			1.18			8.45			1		
04/27/22 9:09	466331.7			1			4.61			1.1			8.22			1		
04/27/22 9:10	466331.7			0.9			4.7			1			8.38			1		
04/27/22 9:11	457705.9			0.9			4.79			0.98			8.39			1		
04/27/22 9:12	452006.8			1			4.89			1.07			8.45			1		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/27/22 9:13	448772.1			1			4.79			1.06			8.23			1		
04/27/22 9:14	449080.1			0.9			4.7			0.96			8.07			1		
04/27/22 9:15	448155.9			0.9			4.79			0.96			8.22			1		
04/27/22 9:16	446615.6			0.9			4.79			0.96			8.19			1		
04/27/22 9:17	448001.9			0.9			4.79			0.96			8.21			1		
04/27/22 9:18	448155.9			0.8			4.79			0.86			8.22			1		
04/27/22 9:19	448695.1			0.8			4.89			0.87			8.38			1		
04/27/22 9:20	446615.6			0.8			5.07			0.86			8.66			1		
04/27/22 9:21	447000.7			0.8			5.07			0.86			8.67			1		
04/27/22 9:22	447077.7			0.8			5.16			0.86			8.83			1		
04/27/22 9:23	446692.6			0.8			5.35			0.86			9.13			1		
04/27/22 9:24	447616.8			0.8			5.35			0.86			9.15			1		
04/27/22 9:25	444382.2			0.8			5.35			0.86			9.09			1		
04/27/22 9:26	443072.9			0.8			5.44			0.85			9.22			1		
04/27/22 9:27	443766			0.8			5.53			0.86			9.39			1		
04/27/22 9:28	443843.1			0.8			5.44			0.86			9.23			1		
04/27/22 9:29	445152.3			0.8			5.62			0.86			9.57			1		
04/27/22 9:30	444074.1			0.8			5.62			0.86			9.55			1		
04/27/22 9:31	443766			0.8			5.62			0.86			9.54			1		
04/27/22 9:32	443380.9			0.7			5.53			0.76			9.38			1		
04/27/22 9:33	443226.9			0.7			5.62			0.76			9.53			1		
04/27/22 9:34	444459.2			0.8			5.72			0.86			9.71			1		
04/27/22 9:35	444921.3			0.8			5.81			0.86			9.88			1		
04/27/22 9:36	442687.8			0.8			5.81			0.85			9.83			1		
04/27/22 9:37	444305.2			0.8			5.81			0.86			9.87			1		
04/27/22 9:38	441609.6			0.8			5.9			0.85			9.96			1		
04/27/22 9:39	442225.7			0.8			5.9			0.85			9.98			1		
04/27/22 9:40	446769.7			0.8			5.9			0.86			10.08			1		
04/27/22 9:41	466331.7			0.8			5.81			0.9			10.36			1		
04/27/22 9:42	480194.6			0.8			5.81			0.94			10.66			1		
04/27/22 9:43	476805.9			0.8			6.84			0.93			12.46			1		
04/27/22 9:44	476420.8			0.8			6.64			0.92			12.09			1		
04/27/22 9:45	478115.2			0.8			6.64			0.92			12.14			1		
04/27/22 9:46	481580.9			0.8			6.55			0.93			12.05			1		
04/27/22 9:47	481811.9			0.8			6.64			0.93			12.23			1		
04/27/22 9:48	483814.3			0.8			6.82			0.93			12.62			1		
04/27/22 9:49	483660.3			0.8			6.73			0.93			12.45			1		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/27/22 9:50	479886.5			0.8			6.73			0.93			12.35			1		
04/27/22 9:51	484276.4			0.8			6.73			0.93			12.46			1		
04/27/22 9:52	485354.7			0.8			6.73			0.94			12.49			1		
04/27/22 9:53	484815.5			0.7			6.82			0.83			12.65			1		
04/27/22 9:54	483506.3			0.7			6.91			0.83			12.78			1		
04/27/22 9:55	482428.1			0.7			7.01			0.83			12.93			1		
04/27/22 9:56	484738.5			0.7			7.01			0.83			12.99			1		
04/27/22 9:57	485046.6			0.8			7.1			0.94			13.17			1		
04/27/22 9:58	483891.3			0.8			7.1			0.93			13.14			1		
04/27/22 9:59	486124.8			0.8			7.1			0.94			13.2			1		
04/27/22 10:00	484430.5			0.8			7.19			0.93			13.32			1		
04/27/22 10:01	483198.2			0.7			7.74			0.83			14.31			1		
04/27/22 10:02	484892.6			0.8			7.56			0.93			14.02			1		
04/27/22 10:03	485508.7			0.8			7.38			0.94			13.69			1		
04/27/22 10:04	484353.4			0.8			7.28			0.93			13.49			1		
04/27/22 10:05	471491.8			0.8			7.19			0.91			12.96			1		
04/27/22 10:06	445460.4			0.8			7.19			0.86			12.25			1		
04/27/22 10:07	421508.4			0.8			7.08			0.8			11.41			1		
04/27/22 10:08	407799.6			0.8			4.29			0.76			6.69			1		
04/27/22 10:09	404179.8			0.9			2.15			0.84			3.32			1		
04/27/22 10:10	400175			0.9			1.88			0.83			2.87			1		
04/27/22 10:11	386543.2			0.9			1.97			0.8			2.91			1		
04/27/22 10:12	370215.8			0.9			2.55			0.76			3.62			1		
04/27/22 10:13	359510.6			1			2.73			0.81			3.75			1		
04/27/22 10:14	337715			1			2.73			0.76			3.53			1		
04/27/22 10:15	316304.6			1			3.17			0.71			3.83			1		
04/27/22 10:16	306369.5			1			3.18			0.71			3.72			1		
04/27/22 10:17	306138.5			0.9			3.13			0.66			3.67			1		
04/27/22 10:18	305522.4			0.8			3.04			0.59			3.55			1		
04/27/22 10:19	306600.6			0.7			2.77			0.53			3.24			1		
04/27/22 10:20	305522.4			0.8			2.58			0.59			3.02			1		
04/27/22 10:21	304983.3			0.7			2.3			0.52			2.69			1		
04/27/22 10:22	305753.4			0.7			2.15			0.53			2.52			1		
04/27/22 10:23	305907.4			0.6			1.94			0.46			2.26			1		
04/27/22 10:24	306292.5			0.6			1.75			0.46			2.05			1		
04/27/22 10:25	305753.4			0.7			1.69			0.47			1.97			1		
04/27/22 10:26	306061.5			0.7			1.5			0.47			1.75			0		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/27/22 10:27	306985.7			0.7			1.4			0.47			1.65			0		
04/27/22 10:28	306292.5			0.7			1.4			0.47			1.65			0		
04/27/22 10:29	305984.5			0.7			1.31			0.47			1.53			0		
04/27/22 10:30	306908.7			0.7			1.31			0.53			1.54			0		

CT2 SUSD EVENT 4

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/27/22 18:49	364670.6			0.9			1.34			0.76			1.87			0		
04/27/22 18:50	365902.9			0.9			1.34			0.76			1.88			0		
04/27/22 18:51	363900.5			0.9			1.25			0.76			1.74			0		
04/27/22 18:52	363438.4			0.9			1.25			0.75			1.74			0		
04/27/22 18:53	364824.7			0.9			1.25			0.76			1.75			0		
04/27/22 18:54	363207.3			0.9			1.25			0.75			1.74			1		
04/27/22 18:55	349113.4			0.9			1.34			0.73			1.79			1		
04/27/22 18:56	325623.5			1			1.5			0.73			1.86			1		
04/27/22 18:57	305291.3			0.9			1.79			0.63			2.09			1		
04/27/22 18:58	279491			0.8			2.21			0.54			2.36			1		
04/27/22 18:59	257233.3			0.8			3.52			0.46			3.46			1		
04/27/22 19:00	234051.5			0.7			6.51			0.39			5.83			1		
04/27/22 19:01	208328.2			1.4			21.67			0.66			17.26			1		
04/27/22 19:02	182912.9			10			25.99			4.27			18.18			1		
04/27/22 19:03	163967			578.2			29.93			220.29			18.77			1		
04/27/22 19:04	145329.1			1423			34.09			480.68			18.95			1		
04/27/22 19:05	47980.9			1893			37.61			211.02			6.9			1		
04/27/22 19:06	0			0			39.19			0			0			0		
04/27/22 19:07	0			0			0.3			0			0			0		
04/27/22 19:08	0			0			0.2			0			0			0		
04/27/22 19:09	0			0			0.2			0			0			0		
04/27/22 19:10	0			0			0.1			0			0			0		

CT2 SUSD EVENT 5

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/28/22 8:34	0			0			0			0			0			0		
04/28/22 8:35	0			0			0			0			0			0		
04/28/22 8:36	0			0			0			0			0			0		
04/28/22 8:37	0			0			0			0			0			0		
04/28/22 8:38	0			0			0			0			0			0		
04/28/22 8:39	2464.5			0			0			0			0			1		
04/28/22 8:40	22334.6			0.1			0			0			0			1		
04/28/22 8:41	36890.7			73.8			30.98			6.32			4.37			1		
04/28/22 8:42	50060.4			1293.4			16.44			150.55			3.15			1		
04/28/22 8:43	60919.6			897.1			22.56			126.92			5.25			1		
04/28/22 8:44	75783.7			589.7			27.33			103.88			7.92			1		
04/28/22 8:45	114599.8			469.1			29.21			124.94			12.8			1		
04/28/22 8:46	152799.7			319.1			43.87			113.29			25.63			1		
04/28/22 8:47	156419.4			217.1			58.19			78.91			34.81			1		
04/28/22 8:48	173671			1496.5			53.67			603.98			35.65			1		
04/28/22 8:49	179293.2			1551.9			57.26			646.48			39.26			1		
04/28/22 8:50	181141.6			1088.8			54.69			458.2			37.88			1		
04/28/22 8:51	179832.3			999.3			54.69			417.64			37.62			1		
04/28/22 8:52	177444.8			986.7			53.58			406.86			36.36			1		
04/28/22 8:53	178137.9			981.8			51.98			406.36			35.41			1		
04/28/22 8:54	176674.6			987.7			49.91			405.48			33.72			1		
04/28/22 8:55	177752.9			1009.9			48			417.07			32.62			1		
04/28/22 8:56	177675.8			1033.6			45.76			426.65			31.09			1		
04/28/22 8:57	175519.4			1055.9			43.85			430.66			29.43			1		
04/28/22 8:58	177059.7			1073			42.1			441.46			28.5			1		
04/28/22 8:59	176058.5			1084.5			40.82			443.76			27.49			1		
04/28/22 9:00	175442.4			1128			40.48			459.82			27.16			1		
04/28/22 9:01	175211.3			1143.1			39.17			465.45			26.25			1		
04/28/22 9:02	175288.4			1153.8			38.19			470.05			25.6			1		
04/28/22 9:03	189074.2			1164.1			37.2			511.52			26.9			1		
04/28/22 9:04	213719.3			759.9			38.04			377.26			31.08			1		
04/28/22 9:05	237902.3			183.2			42.53			101.24			38.69			1		
04/28/22 9:06	262316.4			18.2			45.36			11.09			45.5			1		
04/28/22 9:07	277719.6			3			46.09			1.94			48.95			1		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/28/22 9:08	279105.9			2.1			27.16			1.39			28.99			1		
04/28/22 9:09	280107.1			2			22.22			1.28			23.81			1		
04/28/22 9:10	278874.8			1.8			21.93			1.15			23.39			1		
04/28/22 9:11	278335.7			1.5			21.63			0.95			23.02			1		
04/28/22 9:12	278104.7			1.3			21.63			0.83			23.01			1		
04/28/22 9:13	279259.9			1.2			21.73			0.77			23.21			1		
04/28/22 9:14	278951.8			1.1			21.73			0.7			23.19			1		
04/28/22 9:15	278643.8			1			21.73			0.64			23.15			1		
04/28/22 9:16	278335.7			1			21.93			0.64			23.34			1		
04/28/22 9:17	277796.6			0.9			22.5			0.58			23.91			1		
04/28/22 9:18	276718.4			0.9			22.7			0.58			24.02			1		
04/28/22 9:19	278412.8			0.8			22.8			0.52			24.27			1		
04/28/22 9:20	278181.7			0.8			22.7			0.52			24.15			1		
04/28/22 9:21	277488.6			0.8			22.7			0.52			24.08			1		
04/28/22 9:22	278104.7			0.7			22.7			0.45			24.14			1		
04/28/22 9:23	277488.6			0.7			22.7			0.45			24.08			1		
04/28/22 9:24	277796.6			0.7			22.8			0.45			24.22			1		
04/28/22 9:25	276718.4			0.6			22.8			0.39			24.12			1		
04/28/22 9:26	276641.4			0.6			20.7			0.39			21.9			1		
04/28/22 9:27	276795.4			0.6			11.2			0.39			11.85			1		
04/28/22 9:28	279491			0.6			7.1			0.39			7.59			1		
04/28/22 9:29	284574			0.6			5.21			0.39			5.67			1		
04/28/22 9:30	284497			0.6			3.68			0.38			4			1		
04/28/22 9:31	284651			0.7			3.39			0.45			3.69			1		
04/28/22 9:32	284651			0.7			3.29			0.45			3.58			1		
04/28/22 9:33	284188.9			0.7			3.39			0.45			3.68			1		
04/28/22 9:34	283957.9			0.6			3.48			0.38			3.78			1		
04/28/22 9:35	285421.2			0.6			3.48			0.38			3.8			1		
04/28/22 9:36	284728.1			0.6			3.29			0.38			3.58			1		
04/28/22 9:37	283418.8			0.6			3			0.38			3.25			1		
04/28/22 9:38	283880.9			0.6			2.61			0.38			2.84			1		
04/28/22 9:39	285113.1			0.6			2.32			0.38			2.53			1		
04/28/22 9:40	285421.2			0.6			2.13			0.38			2.32			1		
04/28/22 9:41	283110.7			0.6			1.93			0.38			2.09			1		
04/28/22 9:42	283110.7			0.6			1.84			0.38			1.99			1		
04/28/22 9:43	283803.8			0.6			1.74			0.38			1.89			1		
04/28/22 9:44	284497			0.6			1.93			0.38			2.1			1		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/28/22 9:45	283418.8			0.6			1.84			0.38			1.99			0		
04/28/22 9:46	283418.8			0.6			1.74			0.38			1.89			0		
04/28/22 9:47	283264.8			0.6			1.55			0.38			1.68			0		
04/28/22 9:48	282802.7			0.6			1.45			0.38			1.57			0		
04/28/22 9:49	282417.6			0.6			1.35			0.38			1.46			0		

CT2 SUSD EVENT 6

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/28/22 16:54	272790.6			0.6			1.6			0.38			1.67			0		
04/28/22 16:55	272559.5			0.6			1.6			0.38			1.67			0		
04/28/22 16:56	272097.4			0.5			1.57			0.31			1.64			0		
04/28/22 16:57	272559.5			0.5			1.57			0.31			1.64			0		
04/28/22 16:58	272482.5			0.5			1.57			0.31			1.64			0		
04/28/22 16:59	270557.1			0.6			1.67			0.37			1.73			1		
04/28/22 17:00	256848.3			0.6			1.67			0.35			1.64			1		
04/28/22 17:01	233204.4			0.5			2.24			0.28			2			1		
04/28/22 17:02	205940.7			0.4			6.23			0.21			4.91			1		
04/28/22 17:03	183221			3.8			9.34			1.62			6.55			1		
04/28/22 17:04	161117.4			276.5			11.52			103.47			7.1			1		
04/28/22 17:05	141863.4			1068.2			14.83			352.22			8.05			1		
04/28/22 17:06	60688.6			1812.8			18.25			255.64			4.24			1		
04/28/22 17:07	0			0			22.81			0			0			0		
04/28/22 17:08	0			0			0.1			0			0			0		
04/28/22 17:09	0			0			0.1			0			0			0		
04/28/22 17:10	0			0			0.1			0			0			0		
04/28/22 17:11	0			0			0.1			0			0			0		

CT2 SUSD EVENT 7

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/03/22 23:41	0			0			0			0			0			0		
05/03/22 23:42	0			0			0			0			0			0		
05/03/22 23:43	0			0			0			0			0			0		
05/03/22 23:44	0			0			0			0			0			0		
05/03/22 23:45	4775			0			0			0			0			0		
05/03/22 23:46	12245.5			0.2			0			0			0			1		
05/03/22 23:47	27032.6			0.2			0			0			0			1		
05/03/22 23:48	40587.4			94.4			31.47			8.92			4.89			1		
05/03/22 23:49	51908.8			1177.1			15.17			142.28			3.02			1		
05/03/22 23:50	63230.1			783			19.09			115.32			4.63			1		
05/03/22 23:51	84948.6			525.7			22.98			103.91			7.47			1		
05/03/22 23:52	132390.5			381.3			24.72			117.52			12.54			1		
05/03/22 23:53	148024.7			244.5			35.64			84.23			20.2			1		
05/03/22 23:54	180140.4			462			38.94			193.69			26.87			1		
05/03/22 23:55	199548.4			1182.4			39.56			549.22			30.24			1		
05/03/22 23:56	223808.4			460.1			45.43			239.74			38.96			1		
05/03/22 23:57	248684.6			56.4			51.66			32.64			49.21			1		
05/03/22 23:58	275255.1			4.2			55.3			2.67			58.32			1		
05/03/22 23:59	299130			1.7			44.92			1.15			51.49			1		
05/04/22 0:00	325161.4			1.6			21.45			1.21			26.72			1		
05/04/22 0:01	343029.1			1.7			15.41			1.34			20.26			1		
05/04/22 0:02	369522.6			1.8			13.28			1.57			18.79			1		
05/04/22 0:03	376762.1			1.8			10.76			1.6			15.53			1		
05/04/22 0:04	388776.6			1.8			8.19			1.59			12.2			1		
05/04/22 0:05	385542			1.6			7.33			1.44			10.83			1		
05/04/22 0:06	388391.6			1.5			6.44			1.37			9.58			1		
05/04/22 0:07	384232.7			1.4			5.54			1.28			8.16			1		
05/04/22 0:08	388314.5			1.3			5.01			1.21			7.45			1		
05/04/22 0:09	382153.3			1.3			4.74			1.11			6.94			1		
05/04/22 0:10	383462.5			1.2			4.47			1.04			6.57			1		
05/04/22 0:11	382384.3			1.1			4.2			0.95			6.16			1		
05/04/22 0:12	380458.9			1.1			4.02			0.95			5.86			1		
05/04/22 0:13	383924.6			1.1			3.84			0.96			5.65			1		
05/04/22 0:14	380844			1.1			3.81			0.97			5.56			1		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/04/22 0:15	383077.4			1			3.81			0.89			5.6			1		
05/04/22 0:16	385310.9			1			3.81			0.9			5.63			1		
05/04/22 0:17	381152			1			3.72			0.89			5.43			1		
05/04/22 0:18	383462.5			1			3.72			0.89			5.47			1		
05/04/22 0:19	380767			1			3.72			0.89			5.43			1		
05/04/22 0:20	384617.8			1			3.72			0.89			5.48			1		
05/04/22 0:21	382692.4			1			3.81			0.89			5.59			1		
05/04/22 0:22	377840.4			1			3.9			0.88			5.65			1		
05/04/22 0:23	375375.8			1			3.99			0.87			5.74			1		
05/04/22 0:24	369599.7			1			4.08			0.86			5.78			1		
05/04/22 0:25	359972.7			1			4.56			0.82			6.29			1		
05/04/22 0:26	354273.5			1			3.67			0.81			4.97			1		
05/04/22 0:27	349729.5			1			2.59			0.8			3.47			1		
05/04/22 0:28	353195.3			1			2.41			0.81			3.27			1		
05/04/22 0:29	357123.1			1			2.23			0.82			3.06			1		
05/04/22 0:30	356506.9			1			1.97			0.82			2.69			1		
05/04/22 0:31	354119.4			1.1			1.79			0.88			2.43			1		
05/04/22 0:32	350268.7			1.1			1.7			0.87			2.28			1		
05/04/22 0:33	346494.8			1.1			1.61			0.87			2.14			1		
05/04/22 0:34	342104.9			1			1.7			0.78			2.23			0		
05/04/22 0:35	339640.4			1			1.7			0.78			2.21			0		
05/04/22 0:36	337484			1			1.79			0.77			2.31			0		
05/04/22 0:37	332323.9			1			1.82			0.77			2.31			0		
05/04/22 0:38	331707.8			0.9			1.82			0.7			2.31			0		

CT2 SUSD EVENT 8

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/06/22 22:35	354812.6			0.9			1.67			0.73			2.27			0		
05/06/22 22:36	341026.7			0.9			1.76			0.7			2.3			0		
05/06/22 22:37	346879.9			1			1.59			0.78			2.11			0		
05/06/22 22:38	337561			0.9			1.5			0.69			1.94			0		
05/06/22 22:39	315688.5			0.9			1.52			0.66			1.84			0		
05/06/22 22:40	79865.6			0.9			1.27			0.17			0.39			1		
05/06/22 22:41	0			0			1.04			0			0			0		
05/06/22 22:42	0			0			0			0			0			0		
05/06/22 22:43	0			0			0			0			0			0		
05/06/22 22:44	0			0			0			0			0			0		
05/06/22 22:45	0			0			0			0			0			0		

CT2 SUSD EVENT 9

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/07/22 12:38	0			0			0			0			0			0		
05/07/22 12:39	0			0			0			0			0			0		
05/07/22 12:40	0			0			0			0			0			0		
05/07/22 12:41	0			0			0			0			0			0		
05/07/22 12:42	0			0			0			0			0			0		
05/07/22 12:43	6392.3			0			0			0			0			1		
05/07/22 12:44	22950.8			0			0			0			0			1		
05/07/22 12:45	38508			79.1			24.78			7.1			3.66			1		
05/07/22 12:46	51600.7			1264.3			18.12			151.97			3.58			1		
05/07/22 12:47	61920.8			819.1			23.6			118.07			5.6			1		
05/07/22 12:48	79095.4			538.1			28.26			99.14			8.57			1		
05/07/22 12:49	124688.9			396.1			34.28			115.01			16.38			1		
05/07/22 12:50	151259.4			248.3			50.64			87.43			29.35			1		
05/07/22 12:51	190306.5			367.4			60.18			162.74			43.87			1		
05/07/22 12:52	218648.3			771.7			65.07			392.83			54.51			1		
05/07/22 12:53	245064.8			99			60.48			56.46			56.79			1		
05/07/22 12:54	270172			4.5			60.04			2.84			62.15			1		
05/07/22 12:55	296511.5			1.3			50.68			0.87			57.58			1		
05/07/22 12:56	313917.1			1.1			24.36			0.83			29.3			1		
05/07/22 12:57	314918.3			1.3			16.9			0.98			20.38			1		
05/07/22 12:58	318846.1			1.5			13.95			1.13			17.04			1		
05/07/22 12:59	322851			1.6			12.16			1.21			15.04			1		
05/07/22 13:00	325700.5			1.5			10.64			1.15			13.27			1		
05/07/22 13:01	326624.8			1.5			10.08			1.1			12.61			1		
05/07/22 13:02	328550.1			1.4			8.9			1.04			11.2			1		
05/07/22 13:03	329859.4			1.3			8.53			0.98			10.78			1		
05/07/22 13:04	327548.9			1.2			8.26			0.9			10.37			1		
05/07/22 13:05	328858.2			1.2			7.99			0.9			10.06			1		
05/07/22 13:06	328704.2			1.1			7.81			0.83			9.83			1		
05/07/22 13:07	328011			1.1			7.81			0.83			9.81			1		
05/07/22 13:08	326624.8			1			8.02			0.77			10.04			1		
05/07/22 13:09	324160.2			1			8.11			0.77			10.07			1		
05/07/22 13:10	323929.2			1			8.11			0.76			10.07			1		
05/07/22 13:11	322851			0.9			8.11			0.69			10.04			1		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/07/22 13:12	321464.7			0.9			8.11			0.69			9.99			1		
05/07/22 13:13	322696.9			0.9			8.11			0.69			10.03			1		
05/07/22 13:14	323390.1			0.9			8.2			0.69			10.16			1		
05/07/22 13:15	322465.9			0.9			8.39			0.69			10.37			1		
05/07/22 13:16	323390.1			0.9			8.57			0.69			10.62			1		
05/07/22 13:17	323852.2			0.9			8.76			0.7			10.87			1		
05/07/22 13:18	324930.4			0.8			8.94			0.63			11.13			1		
05/07/22 13:19	325084.4			0.8			9.22			0.63			11.48			1		
05/07/22 13:20	324468.3			0.8			9.59			0.63			11.92			1		
05/07/22 13:21	324160.2			0.8			9.77			0.63			12.14			1		
05/07/22 13:22	324622.3			0.8			9.5			0.63			11.81			1		
05/07/22 13:23	322542.9			0.8			5.62			0.62			6.95			1		
05/07/22 13:24	308988.1			0.8			3.87			0.6			4.58			1		
05/07/22 13:25	306831.6			0.8			3.75			0.6			4.4			1		
05/07/22 13:26	303288.9			0.8			3.9			0.54			4.53			1		
05/07/22 13:27	296280.4			0.8			4.28			0.53			4.86			1		
05/07/22 13:28	299053			0.8			4.47			0.53			5.12			1		
05/07/22 13:29	299669.2			0.7			4.38			0.46			5.03			1		
05/07/22 13:30	289888.1			0.7			3.43			0.45			3.81			1		
05/07/22 13:31	287962.7			0.7			3.24			0.45			3.57			1		
05/07/22 13:32	286268.4			0.7			3.19			0.45			3.5			1		
05/07/22 13:33	286114.3			0.6			3			0.39			3.29			1		
05/07/22 13:34	286268.4			0.7			2.8			0.45			3.08			1		
05/07/22 13:35	285421.2			0.7			2.51			0.45			2.75			1		
05/07/22 13:36	283726.8			0.6			2.32			0.38			2.52			1		
05/07/22 13:37	283033.7			0.6			2.13			0.38			2.31			1		
05/07/22 13:38	282879.7			0.6			1.93			0.38			2.1			1		
05/07/22 13:39	282109.5			0.6			1.84			0.38			1.99			1		
05/07/22 13:40	283418.8			0.6			1.64			0.38			1.79			1		
05/07/22 13:41	283880.9			0.6			1.55			0.38			1.68			1		
05/07/22 13:42	285498.2			0.6			1.55			0.39			1.69			0		
05/07/22 13:43	285498.2			0.6			1.45			0.39			1.59			0		
05/07/22 13:44	284188.9			0.6			1.35			0.38			1.47			0		
05/07/22 13:45	284497			0.6			1.26			0.38			1.37			0		
05/07/22 13:46	285883.3			0.6			1.26			0.39			1.38			0		

CT2 SUSD EVENT 10

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/08/22 5:53	287654.7			0.6			1.55			0.39			1.71			0		
05/08/22 5:54	286884.5			0.6			1.55			0.39			1.7			0		
05/08/22 5:55	287423.6			0.6			1.55			0.39			1.7			0		
05/08/22 5:56	288347.8			0.6			1.55			0.39			1.71			0		
05/08/22 5:57	286961.5			0.6			1.55			0.39			1.7			0		
05/08/22 5:58	281570.4			0.6			1.55			0.38			1.67			1		
05/08/22 5:59	277719.6			0.6			1.55			0.38			1.65			0		
05/08/22 6:00	285575.2			0.6			2.2			0.4			2.41			0		
05/08/22 6:01	289426			0.5			1.97			0.33			2.18			0		
05/08/22 6:02	308757			0.6			1.74			0.42			2.06			0		
05/08/22 6:03	329628.4			0.7			1.4			0.5			1.77			0		

CT2 SUSD EVENT 11

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/09/22 22:49	318538.1			0.7			1.57			0.55			1.91			0		
05/09/22 22:50	330629.6			0.7			1.48			0.57			1.87			0		
05/09/22 22:51	330706.6			0.7			1.27			0.56			1.61			0		
05/09/22 22:52	332709			0.8			1.16			0.62			1.48			0		
05/09/22 22:53	332709			0.9			1.25			0.69			1.6			0		
05/09/22 22:54	333094.1			0.9			1.34			0.69			1.71			1		
05/09/22 22:55	321387.7			0.9			1.34			0.67			1.65			1		
05/09/22 22:56	299284.1			0.9			1.36			0.63			1.56			1		
05/09/22 22:57	277950.7			0.8			1.94			0.54			2.06			1		
05/09/22 22:58	252227.3			0.8			4.16			0.45			4.02			1		
05/09/22 22:59	227659.2			0.6			9.17			0.34			8			1		
05/09/22 23:00	203168.1			2.9			16.66			1.37			12.97			1		
05/09/22 23:01	180294.4			152.1			19.11			63.85			13.2			1		
05/09/22 23:02	160039.2			742.1			21.83			276.41			13.38			1		
05/09/22 23:03	130234			1453.4			24.27			440.51			12.11			1		
05/09/22 23:04	0			0			25.02			0			0			1		
05/09/22 23:05	0			0			17.7			0			0			0		
05/09/22 23:06	0			0			0.1			0			0			0		
05/09/22 23:07	0			0			0.1			0			0			0		
05/09/22 23:08	0			0			0.1			0			0			0		
05/09/22 23:09	0			0			0.1			0			0			0		

CT2 SUSD EVENT 12

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/17/22 17:16	0			0			0			0			0			0		
05/17/22 17:17	0			0			0			0			0			0		
05/17/22 17:18	0			0			0			0			0			0		
05/17/22 17:19	0			0			0			0			0			0		
05/17/22 17:20	2541.5			0			0			0			0			0		
05/17/22 17:21	1001.2			0.1			0			0			0			1		
05/17/22 17:22	10705.2			0.1			0			0			0			1		
05/17/22 17:23	27725.8			1			0.2			0			0			1		
05/17/22 17:24	41742.7			1103.9			15.34			107.24			2.45			1		
05/17/22 17:25	55220.5			863.8			15.96			110.99			3.38			1		
05/17/22 17:26	65925.7			517.4			19.47			79.46			4.92			1		
05/17/22 17:27	95037.7			318.9			23.6			70.52			8.59			1		
05/17/22 17:28	142864.6			189.8			24.58			63.13			13.46			1		
05/17/22 17:29	145252.1			122.3			44.35			41.36			24.69			1		
05/17/22 17:30	152876.7			866			36.14			308.23			21.17			1		
05/17/22 17:31	155957.3			1634.5			31.47			593.44			18.8			1		
05/17/22 17:32	171591.6			1571.7			32.97			627.98			21.68			1		
05/17/22 17:33	195389.5			961.7			46.54			437.43			34.84			1		
05/17/22 17:34	223192.3			272			60.58			141.3			51.8			1		
05/17/22 17:35	246605.1			26.2			63.52			15.06			60.02			1		
05/17/22 17:36	273098.6			2.8			59.45			1.77			62.19			1		
05/17/22 17:37	301902.6			1.9			37.9			1.34			43.84			1		
05/17/22 17:38	318230			1.9			18.99			1.43			23.16			1		
05/17/22 17:39	342104.9			2			13.77			1.57			18.04			1		
05/17/22 17:40	357816.2			1.9			12.16			1.56			16.67			1		
05/17/22 17:41	353657.3			1.8			9.33			1.45			12.65			1		
05/17/22 17:42	355043.6			1.8			8.31			1.48			11.31			1		
05/17/22 17:43	354119.4			1.7			7.42			1.4			10.07			1		
05/17/22 17:44	353888.4			1.6			6.35			1.33			8.6			1		
05/17/22 17:45	355659.8			1.4			5.9			1.18			8.04			1		
05/17/22 17:46	353657.3			1.3			5.18			1.1			7.03			1		
05/17/22 17:47	362822.3			1.3			5.01			1.06			6.96			1		
05/17/22 17:48	383077.4			1.2			4.45			1.05			6.53			1		
05/17/22 17:49	392627.4			1.1			4.06			1.01			6.1			1		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/17/22 17:50	397248.4			1			3.84			0.95			5.84			1		
05/17/22 17:51	387929.4			0.9			3.75			0.85			5.57			1		
05/17/22 17:52	374990.8			0.9			4.03			0.82			5.79			1		
05/17/22 17:53	366056.9			0.9			4.15			0.79			5.82			1		
05/17/22 17:54	365132.7			1			3.99			0.85			5.59			1		
05/17/22 17:55	367982.3			1			3.96			0.87			5.59			1		
05/17/22 17:56	388006.5			0.9			3.87			0.83			5.76			1		
05/17/22 17:57	408415.7			0.9			3.47			0.89			5.42			1		
05/17/22 17:58	425359.2			0.9			3.33			0.85			5.43			1		
05/17/22 17:59	427284.6			0.9			4.19			0.85			6.85			1		
05/17/22 18:00	433522.9			0.9			3.71			0.86			6.16			1		
05/17/22 18:01	447539.8			0.8			3.14			0.79			5.38			1		
05/17/22 18:02	454856.3			0.8			3.43			0.81			5.97			1		
05/17/22 18:03	454779.3			0.7			2.53			0.79			4.41			1		
05/17/22 18:04	456935.8			0.7			1.97			0.8			3.44			1		
05/17/22 18:05	452468.8			0.7			1.69			0.79			2.92			1		
05/17/22 18:06	457089.8			0.7			1.5			0.8			2.62			1		
05/17/22 18:07	455241.4			0.8			1.4			0.89			2.45			1		
05/17/22 18:08	456165.6			0.7			1.31			0.8			2.29			0		
05/17/22 18:09	455241.4			0.7			1.31			0.79			2.29			0		
05/17/22 18:10	457551.9			0.7			1.4			0.8			2.46			0		
05/17/22 18:11	457243.8			0.7			1.4			0.8			2.46			0		
05/17/22 18:12	456088.6			0.8			1.5			0.89			2.62			0		

CT2 SUSD EVENT 13

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/19/22 22:53	425359.2			0.8			0.64			0.81			1.04			0		
05/19/22 22:54	424127			0.8			0.55			0.82			0.9			0		
05/19/22 22:55	403794.8			0.8			0.64			0.77			0.98			0		
05/19/22 22:56	389238.7			0.8			0.72			0.73			1.07			0		
05/19/22 22:57	385079.9			0.8			0.7			0.71			1.04			0		
05/19/22 22:58	381152			0.8			0.72			0.71			1.04			1		
05/19/22 22:59	363361.3			0.8			0.72			0.68			1			1		
05/19/22 23:00	340333.6			0.8			0.79			0.63			1.03			1		
05/19/22 23:01	316381.6			0.9			0.97			0.65			1.17			1		
05/19/22 23:02	295356.3			0.9			1.16			0.61			1.32			1		
05/19/22 23:03	272867.6			0.7			1.57			0.47			1.64			1		
05/19/22 23:04	245835			0.6			3.1			0.33			2.92			1		
05/19/22 23:05	224039.5			0.5			7.9			0.27			6.78			1		
05/19/22 23:06	198470.2			2.9			19.09			1.34			14.51			1		
05/19/22 23:07	175442.4			145.5			25.04			59.45			16.84			1		
05/19/22 23:08	155110.2			711.2			28.62			256.8			17			1		
05/19/22 23:09	127307.4			1404			32.53			416.12			15.87			1		
05/19/22 23:10	0			0			36.78			0			0			1		
05/19/22 23:11	0			0			94.4			0			0			0		
05/19/22 23:12	0			0			0.2			0			0			0		
05/19/22 23:13	0			0			0.2			0			0			0		
05/19/22 23:14	0			0			0.1			0			0			0		
05/19/22 23:15	0			0			0.1			0			0			0		

CT2 SUSD EVENT 14

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/24/22 3:35	0			0			0			0			0			0		
05/24/22 3:36	0			0			0			0			0			0		
05/24/22 3:37	0			0			0			0			0			0		
05/24/22 3:38	55528.5			0			0			0			0			0		
05/24/22 3:39	1617.3			0			0			0			0			0		
05/24/22 3:40	15249.2			0.2			0			0			0			1		
05/24/22 3:41	28572.9			1.2			0			0			0			1		
05/24/22 3:42	42743.9			1248.3			19.39			124.06			3.17			1		
05/24/22 3:43	53988.2			1022.2			14.75			128.36			3.05			1		
05/24/22 3:44	65848.7			645.3			18.32			98.94			4.62			1		
05/24/22 3:45	90647.8			453.2			21.63			95.66			7.52			1		
05/24/22 3:46	137935.6			344.6			24.67			110.7			13.04			1		
05/24/22 3:47	155649.3			219.8			41.96			79.67			25.02			1		
05/24/22 3:48	182681.9			705.8			42.22			300.18			29.55			1		
05/24/22 3:49	208867.3			1010.7			49.17			491.4			39.34			1		
05/24/22 3:50	233435.4			258.8			56.75			140.63			50.76			1		
05/24/22 3:51	255076.9			24.3			56.66			14.45			55.38			1		
05/24/22 3:52	283418.8			2.2			53.54			1.44			58.14			1		
05/24/22 3:53	303905			1.6			33.4			1.13			38.89			1		
05/24/22 3:54	308063.9			1.5			18.15			1.11			21.43			1		
05/24/22 3:55	301286.5			1.7			15.76			1.17			18.19			1		
05/24/22 3:56	290889.3			1.8			14.62			1.19			16.29			1		
05/24/22 3:57	290735.3			1.6			15.61			1.11			17.39			1		
05/24/22 3:58	289657.1			1.5			15.95			0.99			17.7			1		
05/24/22 3:59	288963.9			1.4			15.49			0.93			17.15			1		
05/24/22 4:00	290427.2			1.4			14.93			0.93			16.62			1		
05/24/22 4:01	303442.9			1.3			14.29			0.91			16.61			1		
05/24/22 4:02	306600.6			1.2			11.44			0.84			13.44			1		
05/24/22 4:03	308526			1.2			10.08			0.85			11.91			1		
05/24/22 4:04	304213.1			1.2			9.08			0.84			10.58			1		
05/24/22 4:05	301132.4			1.2			8.99			0.83			10.37			1		
05/24/22 4:06	304059.1			1.1			9.13			0.78			10.63			1		
05/24/22 4:07	308680			1			9.22			0.73			10.9			1		
05/24/22 4:08	304983.3			1			8.48			0.72			9.91			1		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/24/22 4:09	298745			1.1			8.39			0.77			9.6			1		
05/24/22 4:10	297743.8			1			8.85			0.7			10.09			1		
05/24/22 4:11	301902.6			1			9.59			0.71			11.09			1		
05/24/22 4:12	305368.3			1			9.22			0.72			10.79			1		
05/24/22 4:13	306215.5			1			8.39			0.72			9.84			1		
05/24/22 4:14	301363.5			1			8.11			0.71			9.37			1		
05/24/22 4:15	296434.5			1			8.39			0.7			9.53			1		
05/24/22 4:16	299053			1			9.18			0.72			10.52			1		
05/24/22 4:17	301902.6			0.9			9.65			0.66			11.16			1		
05/24/22 4:18	304675.2			0.9			9.22			0.65			10.76			1		
05/24/22 4:19	302518.8			0.9			8.76			0.65			10.15			1		
05/24/22 4:20	296665.5			0.9			8.67			0.64			9.85			1		
05/24/22 4:21	295664.3			0.9			9.18			0.64			10.4			1		
05/24/22 4:22	299053			0.9			10.21			0.65			11.7			1		
05/24/22 4:23	303211.9			0.8			10.11			0.59			11.75			1		
05/24/22 4:24	304290.1			0.9			7.19			0.65			8.38			1		
05/24/22 4:25	298667.9			0.9			3.87			0.64			4.43			1		
05/24/22 4:26	295202.2			0.9			3.65			0.64			4.13			1		
05/24/22 4:27	296973.6			0.8			4.31			0.58			4.9			1		
05/24/22 4:28	301440.5			0.8			4.78			0.59			5.52			1		
05/24/22 4:29	304829.2			0.8			4.5			0.6			5.25			1		
05/24/22 4:30	301517.5			0.8			3.32			0.58			3.83			1		
05/24/22 4:31	295741.3			0.8			2.95			0.57			3.34			1		
05/24/22 4:32	294201			0.9			2.72			0.64			3.06			1		
05/24/22 4:33	300208.3			0.8			2.72			0.59			3.12			1		
05/24/22 4:34	304752.2			0.8			2.53			0.6			2.95			1		
05/24/22 4:35	300362.3			0.8			2.06			0.59			2.37			1		
05/24/22 4:36	296126.4			0.8			1.78			0.58			2.02			1		
05/24/22 4:37	294586.1			0.8			1.69			0.58			1.9			1		
05/24/22 4:38	299130			0.8			1.69			0.59			1.93			1		
05/24/22 4:39	302133.7			0.8			1.69			0.59			1.95			0		
05/24/22 4:40	300208.3			0.8			1.5			0.59			1.72			0		
05/24/22 4:41	296126.4			0.8			1.31			0.58			1.49			0		
05/24/22 4:42	292968.8			0.8			1.31			0.57			1.47			0		
05/24/22 4:43	300131.3			0.8			1.4			0.59			1.62			0		

CT2 SUSD EVENT 15

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/25/22 23:08	311991.7			0.7	X		0.84			0.54	X		1.01			0		
05/25/22 23:09	312453.8			0.7	X		0.75			0.54	X		0.9			0		
05/25/22 23:10	310990.5			0.7	X		0.75			0.54	X		0.89			0		
05/25/22 23:11	311221.5			0.8	X		0.75			0.61	X		0.89			0		
05/25/22 23:12	310374.4			0.8	X		0.75			0.61	X		0.89			0		
05/25/22 23:13	311221.5			0.8	X		0.75			0.61	X		0.89			1		
05/25/22 23:14	298051.8			0.8	X		0.84			0.58	X		0.96			1		
05/25/22 23:15	276718.4			0.8	X		0.84			0.54	X		0.89			1		
05/25/22 23:16	251534.2			0.8	X		1.26			0.45	X		1.21			1		
05/25/22 23:17	230277.8			0.7	X		3.7			0.38	X		3.26			1		
05/25/22 23:18	202012.9			0.7	X		9.4			0.31	X		7.27			1		
05/25/22 23:19	178137.9			21.9			14.63			9.08			9.99			1		
05/25/22 23:20	158344.8			291.6			17.56			107.49			10.66			1		
05/25/22 23:21	138243.7			1027.2			21.69			330.66			11.49			1		
05/25/22 23:22	12014.5			1689.4			26.37			47.27			1.21			1		
05/25/22 23:23	0			0			28.03			0			0			0		
05/25/22 23:24	0			0			0.2			0			0			0		
05/25/22 23:25	0			0	X		0.1			0	X		0			0		
05/25/22 23:26	0			0	X		0.1			0	X		0			0		
05/25/22 23:27	0			0	X		0.1			0	X		0			0		

CT2 SUSD EVENT 16

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/26/22 14:34	0			0	X		0			0	X		0			0		
05/26/22 14:35	0			0	X		0			0	X		0			0		
05/26/22 14:36	0			0	X		0			0	X		0			0		
05/26/22 14:37	0			0	X		0			0	X		0			0		
05/26/22 14:38	0			0	X		0			0	X		0			0		
05/26/22 14:39	10705.2			0.4	X		0			0	X		0			1		
05/26/22 14:40	21564.5			0.2	X		0			0	X		0			1		
05/26/22 14:41	35735.4			1032.5			29.5			85.98			4.04			1		
05/26/22 14:42	47826.9			1097			16.91			122.04			3.1			1		
05/26/22 14:43	59071.3			755.9			23.27			103.89			5.26			1		
05/26/22 14:44	73473.2			463.3			25.85			79.23			7.27			1		
05/26/22 14:45	112751.4			339.8			32.72			89.22			14.14			1		
05/26/22 14:46	148794.9			205.6			45.78			71.18			26.09			1		
05/26/22 14:47	14479			163.9			57.1			5.54			3.18			1		
05/26/22 14:48	0			0			46.13			0			0			0		
05/26/22 14:49	0			0			0.5			0			0			0		
05/26/22 14:50	0			0	X		0.5			0	X		0			0		
05/26/22 14:51	0			0	X		0.4			0	X		0			0		
05/26/22 14:52	0			0	X		0.4			0	X		0			0		

CT2 SUSD EVENT 17

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/26/22 14:42	47826.9			1097			16.91			122.04			3.1			1		
05/26/22 14:43	59071.3			755.9			23.27			103.89			5.26			1		
05/26/22 14:44	73473.2			463.3			25.85			79.23			7.27			1		
05/26/22 14:45	112751.4			339.8			32.72			89.22			14.14			1		
05/26/22 14:46	148794.9			205.6			45.78			71.18			26.09			1		
05/26/22 14:47	14479			163.9			57.1			5.54			3.18			1		
05/26/22 14:48	0			0			46.13			0			0			0		
05/26/22 14:49	0			0			0.5			0			0			0		
05/26/22 14:50	0			0	X		0.5			0	X		0			0		
05/26/22 14:51	0			0	X		0.4			0	X		0			0		
05/26/22 14:52	0			0	X		0.4			0	X		0			0		

CT2 SUSD EVENT 18

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/07/22 11:35	0			0	X		0	X		0	X		0	X		0		
06/07/22 11:36	0			0	X		0	X		0	X		0	X		0		
06/07/22 11:37	0			0	X		0	X		0	X		0	X		0		
06/07/22 11:38	0			0	X		0	X		0	X		0	X		0		
06/07/22 11:39	1617.3			0	X		0	X		0	X		0	X		0		
06/07/22 11:40	15942.3			38.2	X		0	X		0	X		0	X		1		
06/07/22 11:41	28649.9			39.6	X		0	X		0	X		0	X		1		
06/07/22 11:42	42204.8			1218.4	X		19.67	X		120.82	X		3.21	X		1		
06/07/22 11:43	53834.2			986.8	X		15.49	X		124.8	X		3.22	X		1		
06/07/22 11:44	64924.5			622.3	X		19.56	X		95	X		4.92	X		1		
06/07/22 11:45	87644.2			397	X		23.32	X		81.75	X		7.9	X		1		
06/07/22 11:46	133468.7			253.4	X		24.11	X		79.48	X		12.45	X		1		
06/07/22 11:47	157035.6			157.1	X		43.92	X		57.99	X		26.68	X		1		
06/07/22 11:48	208559.3			454.3	X		42.59	X		222.71	X		34.36	X		1		
06/07/22 11:49	242677.3			428.5	X		58.38	X		244.41	X		54.8	X		1		
06/07/22 11:50	270249			28.3	X		50.74	X		17.99	X		53.05	X		1		
06/07/22 11:51	295818.3			24	X		44.51	X		16.7	X		50.93	X		1		
06/07/22 11:52	309604.2			20.1	X		26.32	X		14.65	X		31.52	X		1		
06/07/22 11:53	310682.4			15.8	X		18.32	X		11.51	X		22.01	X		1		
06/07/22 11:54	309989.3			13.8	X		16.09	X		10.03	X		19.3	X		1		
06/07/22 11:55	307139.7			14.3	X		14.16	X		10.29	X		16.82	X		1		
06/07/22 11:56	306908.7			14	X		13.07	X		10.08	X		15.52	X		1		
06/07/22 11:57	306138.5			15.9	X		12.26	X		11.41	X		14.52	X		1		
06/07/22 11:58	305214.3			16.2	X		11.62	X		11.64	X		13.71	X		1		
06/07/22 11:59	306061.5			18.2	X		10.51	X		13.07	X		12.44	X		1		
06/07/22 12:00	305214.3			17.1	X		9.96	X		12.3	X		11.76	X		1		
06/07/22 12:01	305060.3			17.7	X		9.27	X		12.69	X		10.94	X		1		
06/07/22 12:02	304752.2			18.1	X		8.71	X		12.95	X		10.27	X		1		
06/07/22 12:03	293738.9			17	X		8.24	X		11.7	X		9.36	X		1		
06/07/22 12:04	290119.2			14.8	X		8.43	X		10.09	X		9.46	X		1		
06/07/22 12:05	302441.7			16.3	X		9.8	X		11.57	X		11.47	X		1		
06/07/22 12:06	306908.7			18.1	X		7.9	X		13.04	X		9.38	X		1		
06/07/22 12:07	307293.7			16.4	X		7.3	X		11.84	X		8.68	X		1		
06/07/22 12:08	303674			17.7	X		7.21	X		12.64	X		8.47	X		1		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/07/22 12:09	300208.3			18.8	X		7.02	X		13.28	X		8.16	X		1		
06/07/22 12:10	298590.9			18.7	X		7.23	X		13.16	X		8.35	X		1		
06/07/22 12:11	301209.5			19.4	X		7.61	X		13.74	X		8.87	X		1		
06/07/22 12:12	303057.8			17.3	X		7.61	X		12.34	X		8.92	X		1		
06/07/22 12:13	304829.2			16.3	X		7.42	X		11.66	X		8.75	X		1		
06/07/22 12:14	305214.3			17.4	X		7.33	X		12.49	X		8.65	X		1		
06/07/22 12:15	302903.8			16.4	X		7.23	X		11.65	X		8.47	X		1		
06/07/22 12:16	297743.8			17.9	X		7.23	X		12.52	X		8.33	X		1		
06/07/22 12:17	295895.4			18	X		7.61	X		12.51	X		8.71	X		1		
06/07/22 12:18	300978.4			19.4	X		8.09	X		13.73	X		9.42	X		1		
06/07/22 12:19	303674			18.5	X		8.09	X		13.18	X		9.5	X		1		
06/07/22 12:20	304290.1			19.8	X		7.9	X		14.16	X		9.3	X		1		
06/07/22 12:21	299669.2			17.6	X		7.9	X		12.4	X		9.16	X		1		
06/07/22 12:22	296126.4			16.6	X		7.99	X		11.52	X		9.16	X		1		
06/07/22 12:23	298282.9			17.3	X		8.37	X		12.14	X		9.66	X		1		
06/07/22 12:24	301363.5			16.9	X		7.71	X		12	X		8.98	X		1		
06/07/22 12:25	300747.4			17.6	X		4.76	X		12.44	X		5.54	X		1		
06/07/22 12:26	304675.2			17.7	X		4.38	X		12.67	X		5.16	X		1		
06/07/22 12:27	299977.2			19.7	X		3.71	X		13.89	X		4.31	X		1		
06/07/22 12:28	295125.2			18.7	X		3.52	X		13	X		4.02	X		1		
06/07/22 12:29	296819.6			18.9	X		3.43	X		13.21	X		3.93	X		1		
06/07/22 12:30	300131.3			19	X		3.58	X		13.37	X		4.15	X		1		
06/07/22 12:31	303211.9			16.7	X		3.33	X		11.87	X		3.91	X		1		
06/07/22 12:32	304213.1			17.2	X		2.95	X		12.31	X		3.47	X		1		
06/07/22 12:33	299130			17.2	X		2.76	X		12.11	X		3.19	X		1		
06/07/22 12:34	296049.4			17.4	X		2.66	X		12.12	X		3.05	X		1		
06/07/22 12:35	295202.2			18.5	X		2.57	X		12.81	X		2.93	X		1		
06/07/22 12:36	297512.7			21	X		2.61	X		14.68	X		3.01	X		1		
06/07/22 12:37	299823.2			18.7	X		2.57	X		13.14	X		2.98	X		1		
06/07/22 12:38	302518.8			18.1	X		2.47	X		12.85	X		2.89	X		1		
06/07/22 12:39	302056.7			18.7	X		2.38	X		13.31	X		2.78	X		1		
06/07/22 12:40	298822			17.6	X		2.19	X		12.37	X		2.53	X		1		
06/07/22 12:41	294894.2			16.7	X		2.09	X		11.54	X		2.39	X		1		
06/07/22 12:42	299130			17.3	X		2	X		12.18	X		2.31	X		1		
06/07/22 12:43	303442.9			17.7	X		2	X		12.62	X		2.35	X		1		
06/07/22 12:44	299438.1			17.9	X		1.9	X		12.59	X		2.2	X		1		
06/07/22 12:45	295356.3			19.8	X		1.81	X		13.74	X		2.07	X		1		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/07/22 12:46	293970			18.7	X		1.81	X		12.95	X		2.06	X		1		
06/07/22 12:47	298590.9			19	X		2	X		13.36	X		2.31	X		1		
06/07/22 12:48	303674			18.1	X		2.09	X		12.91	X		2.46	X		1		
06/07/22 12:49	304367.1			16.3	X		2	X		11.64	X		2.35	X		1		
06/07/22 12:50	306677.6			17.2	X		1.81	X		12.41	X		2.14	X		1		
06/07/22 12:51	313994.1			17	X		1.71	X		12.57	X		2.08	X		1		
06/07/22 12:52	315996.5			17.7	X		1.71	X		13.15	X		2.09	X		1		
06/07/22 12:53	318846.1			18.6	X		1.69	X		13.97	X		2.08	X		1		
06/07/22 12:54	317305.8			20.3	X		1.59	X		15.16	X		1.95	X		1		
06/07/22 12:55	313840.1			17.4	X		1.48	X		12.85	X		1.79	X		1		
06/07/22 12:56	313069.9			17.4	X		1.38	X		12.82	X		1.67	X		1		
06/07/22 12:57	314456.2			17.9	X		1.38	X		13.22	X		1.68	X		1		
06/07/22 12:58	317459.8			17.1	X		1.38	X		12.72	X		1.7	X		1		
06/07/22 12:59	314302.2			16.2	X		1.38	X		11.99	X		1.68	X		1		
06/07/22 13:00	308988.1			15.5	X		1.38	X		11.25	X		1.65	X		1		
06/07/22 13:01	301979.6			41.6	X		1.39	X		29.56	X		1.62	X		1		
06/07/22 13:02	299284.1			34.3	X		1.42	X		24.11	X		1.65	X		1		
06/07/22 13:03	294894.2			21.5	X		1.43	X		14.9	X		1.63	X		1		
06/07/22 13:04	299130			16.3	X		0.69	X		11.47	X		0.8	X		1		
06/07/22 13:05	301671.6			79.4	X		0	X		56.33	X		0	X		1		
06/07/22 13:06	303905			80.1	X		0	X		57.19	X		0	X		1		
06/07/22 13:07	300901.4			85.3	X		0	X		60.35	X		0	X		1		
06/07/22 13:08	295895.4			84.5	X		0	X		58.77	X		0	X		1		
06/07/22 13:09	293276.8			87	X		0	X		59.98	X		0	X		1		
06/07/22 13:10	295587.3			83.7	X		0	X		58.12	X		0	X		1		
06/07/22 13:11	302749.8			90.6	X		0	X		64.48	X		0	X		1		
06/07/22 13:12	299900.2			86.6	X		0	X		61.05	X		0	X		1		
06/07/22 13:13	296280.4			43	X		1.3	X		29.94	X		1.49	X		1		
06/07/22 13:14	294586.1			20	X		1.35	X		13.86	X		1.54	X		1		
06/07/22 13:15	294432.1			19.4	X		1.31	X		13.46	X		1.49	X		1		
06/07/22 13:16	299053			41.3	X		0.49	X		29.03	X		0.57	X		1		
06/07/22 13:17	303057.8			109.9	X		0.28	X		78.25	X		0.33	X		1		
06/07/22 13:18	301979.6			76.5	X		0	X		54.29	X		0	X		1		
06/07/22 13:19	299284.1			82	X		0	X		57.65	X		0	X		1		
06/07/22 13:20	295279.3			0.4	X		0	X		0.29	X		0	X		1		
06/07/22 13:21	294586.1			88.9	X		0	X		61.57	X		0	X		1		
06/07/22 13:22	296819.6			55.9	X		1.05	X		38.97	X		1.2	X		1		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/07/22 13:23	301363.5			12.3	X		2.41	X		8.72	X		2.8	X		1		
06/07/22 13:24	302287.7			9.4	X		2.47	X		6.69	X		2.89	X		1		
06/07/22 13:25	298282.9			2.8	X		2.48	X		1.94	X		2.87	X		1		
06/07/22 13:26	295664.3			9.1	X		2.48	X		6.36	X		2.84	X		1		
06/07/22 13:27	296357.5			10.7	X		10.33	X		7.47	X		11.84	X		1		
06/07/22 13:28	300362.3			12.2	X		12.2	X		8.61	X		14.17	X		1		
06/07/22 13:29	301748.6			12.1	X		12.14	X		8.61	X		14.17	X		1		
06/07/22 13:30	301517.5			12.1	X		12.14	X		8.6	X		14.16	X		1		
06/07/22 13:31	299438.1			12.1	X		12.14	X		8.54	X		14.06	X		1		
06/07/22 13:32	296049.4			21.3	X		21.32	X		14.84	X		24.42	X		1		
06/07/22 13:33	294740.1			25.6	X		25.63	X		17.75	X		29.22	X		1		
06/07/22 13:34	297666.7			22.9	X		1.71	X		16.05	X		1.97	X		1		
06/07/22 13:35	300593.3			18.4	X		1.62	X		12.97	X		1.88	X		1		
06/07/22 13:36	304136.1			18.7	X		1.52	X		13.4	X		1.79	X		1		
06/07/22 13:37	302595.8			18.7	X		1.43	X		13.33	X		1.67	X		1		
06/07/22 13:38	308988.1			20.9	X		1.33	X		15.2	X		1.59	X		1		
06/07/22 13:39	321926.8			19.6	X		1.33	X		14.83	X		1.66	X		1		
06/07/22 13:40	325777.6			20.2	X		1.31			15.49	X		1.65			1		
06/07/22 13:41	321926.8			17.9	X		1.2			13.53	X		1.49			1		
06/07/22 13:42	318846.1			17.2	X		1.2			12.92	X		1.48			1		
06/07/22 13:43	330321.5			16.8	X		1.2			13.02	X		1.53			1		
06/07/22 13:44	350730.8			17.2	X		1.2			14.21	X		1.63			0		
06/07/22 13:45	361513			17.2	X		1.07			14.58	X		1.5			0		
06/07/22 13:46	361744			17.2	X		0.89			14.59	X		1.25			0		
06/07/22 13:47	358201.3			18.3	X		0.8			15.43	X		1.11			0		
06/07/22 13:48	353657.3			17.8	X		0.8			14.79	X		1.1			0		

CT2 SUSD EVENT 19

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/07/22 19:52	370292.8			0.8	X		0.27	X		0.7	X		0.38	X		0		
06/07/22 19:53	370985.9			0.8	X		0.26	X		0.69	X		0.38	X		0		
06/07/22 19:54	360049.7			0.8			0.26			0.67			0.37			0		
06/07/22 19:55	360203.7			0.9			0.26			0.75			0.37			0		
06/07/22 19:56	347727.1			0.9			0.26			0.72			0.36			0		
06/07/22 19:57	337252.9			0.9			0.26			0.7			0.34			1		
06/07/22 19:58	317767.9			0.9			0.27			0.67			0.33			1		
06/07/22 19:59	295895.4			0.8			0.36			0.57			0.42			1		
06/07/22 20:00	272482.5			0.7			0.37			0.47			0.39			1		
06/07/22 20:01	245295.9			0.7			0.57			0.38			0.54			1		
06/07/22 20:02	224655.6			0.5			2.07			0.27			1.8			1		
06/07/22 20:03	197623			2.2			3.06			1			2.34			1		
06/07/22 20:04	174441.2			150.8			3.85			61.86			2.6			1		
06/07/22 20:05	155033.2			694.9			4.57			253.23			2.74			1		
06/07/22 20:06	114291.7			1474.8			5.39			396.16			2.38			1		
06/07/22 20:07	0			0			6.77			0			0			0		
06/07/22 20:08	0			0			11.8			0			0			0		
06/07/22 20:09	0			0			0.1			0			0			0		
06/07/22 20:10	0			0			0.1			0			0			0		
06/07/22 20:11	0			0			0.1			0			0			0		

CT2 SUSD EVENT 20

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/08/22 14:09	0			0			0			0			0			0		
06/08/22 14:10	0			0			0			0			0			0		
06/08/22 14:11	0			0			0			0			0			0		
06/08/22 14:12	0			0			0			0			0			0		
06/08/22 14:13	0			0			0			0			0			0		
06/08/22 14:14	10320.1			0			0			0			0			1		
06/08/22 14:15	28187.8			1			0.2			0			0			1		
06/08/22 14:16	41357.6			1087.4			15.93			105.64			2.55			1		
06/08/22 14:17	53218			918.7			16.66			114.95			3.43			1		
06/08/22 14:18	64693.4			536.3			22.13			81.51			5.53			1		
06/08/22 14:19	89415.5			344.1			25.21			72.32			8.72			1		
06/08/22 14:20	136626.3			203.6			35.89			65.38			18.97			1		
06/08/22 14:21	147408.6			128.6			51.68			44.55			29.47			1		
06/08/22 14:22	167663.8			562.1			50.78			221.45			32.92			1		
06/08/22 14:23	185454.5			1046.3			52.76			456.02			37.85			1		
06/08/22 14:24	212102			429.6			52.04			214.18			42.7			1		
06/08/22 14:25	235206.8			70.5			51.76			39			47.1			1		
06/08/22 14:26	262316.4			4.2			49.05			2.57			49.77			1		
06/08/22 14:27	289426			1.4			39.23			0.99			43.92			1		
06/08/22 14:28	307062.7			1.3			16.3			0.95			19.35			1		
06/08/22 14:29	307370.8			1.4			9.74			1.03			11.58			1		
06/08/22 14:30	307986.9			1.5			7.35			1.12			8.76			1		
06/08/22 14:31	305214.3			1.5			6.26			1.11			7.39			1		
06/08/22 14:32	305368.3			1.4			5.35			0.99			6.32			1		
06/08/22 14:33	304829.2			1.3			4.7			0.92			5.54			1		
06/08/22 14:34	307678.8			1.1			4.06			0.8			4.83			1		
06/08/22 14:35	326547.7			1			3.78			0.78			4.77			1		
06/08/22 14:36	349498.5			1			3.6			0.83			4.86			1		
06/08/22 14:37	361744			1			2.63			0.85			3.68			1		
06/08/22 14:38	368367.4			1			2.15			0.85			3.06			1		
06/08/22 14:39	381075			1			2.06			0.88			3.03			1		
06/08/22 14:40	398249.6			1			1.97			0.92			3.03			1		
06/08/22 14:41	422740.7			0.9			1.63			0.9			2.67			1		
06/08/22 14:42	449080.1			0.8			1.57			0.88			2.72			1		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/08/22 14:43	459400.3			0.7			1.59			0.81			2.83			1		
06/08/22 14:44	456935.8			0.7			1.84			0.79			3.26			0		
06/08/22 14:45	463174.1			0.7			1.84			0.8			3.3			0		
06/08/22 14:46	456319.6			0.7			1.84			0.79			3.25			0		
06/08/22 14:47	456396.7			0.7			1.94			0.79			3.42			0		
06/08/22 14:48	458476.1			0.7			2.03			0.79			3.6			0		

CT2 SUSD EVENT 21

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/09/22 2:45	280492.2			0.7			2.81			0.43			3.05			0		
06/09/22 2:46	280338.1			0.6			3.52			0.38			3.82			0		
06/09/22 2:47	282186.5			0.5			2.66			0.32			2.91			0		
06/09/22 2:48	282494.6			0.5			1.43			0.32			1.56			0		
06/09/22 2:49	282109.5			0.5			1.05			0.32			1.14			0		
06/09/22 2:50	277103.5			0.6			0.66			0.37			0.7			1		
06/09/22 2:51	255847.1			0.6			0.67			0.34			0.66			1		
06/09/22 2:52	231510			0.5			1.73			0.28			1.55			1		
06/09/22 2:53	204169.3			0.9			3.34			0.43			2.64			1		
06/09/22 2:54	181064.5			10.1			4.43			4.29			3.1			1		
06/09/22 2:55	159808.1			587.3			5.06			220.61			3.13			1		
06/09/22 2:56	142017.5			1430.1			7.38			477.3			4.05			1		
06/09/22 2:57	0			1899.8			12.35			0			0			1		
06/09/22 2:58	0			0			19.18			0			0			0		
06/09/22 2:59	0			0			0.1			0			0			0		
06/09/22 3:00	0			0			0.1			0			0			0		
06/09/22 3:01	0			0			0.1			0			0			0		
06/09/22 3:02	0			0			0			0			0			0		

CT2 SUSD EVENT 22

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/09/22 10:34	0			0			0			0			0			0		
06/09/22 10:35	0			0			0			0			0			0		
06/09/22 10:36	0			0			0			0			0			0		
06/09/22 10:37	0			0			0			0			0			0		
06/09/22 10:38	0			0			0			0			0			0		
06/09/22 10:39	3234.7			0			0			0			0			1		
06/09/22 10:40	19947.1			0			0			0			0			1		
06/09/22 10:41	34734.2			47.2			5.9			3.86			0.79			1		
06/09/22 10:42	47749.9			1185.9			4.33			133			0.8			1		
06/09/22 10:43	57993			828.6			7.54			112.96			1.69			1		
06/09/22 10:44	72857.1			491.2			10.33			84.11			2.91			1		
06/09/22 10:45	107591.3			310.6			13.41			78.55			5.58			1		
06/09/22 10:46	144559			184.6			18.17			62.71			10.16			1		
06/09/22 10:47	149488			144.8			31.21			50.9			18.05			1		
06/09/22 10:48	160347.3			1307.2			30.79			492.77			19.1			1		
06/09/22 10:49	178600			1491.8			33.49			626.14			23.13			1		
06/09/22 10:50	203399.2			755.4			35.56			361.16			27.98			1		
06/09/22 10:51	229276.5			158.6			39.65			85.46			35.16			1		
06/09/22 10:52	253228.5			11.4			41.54			6.81			40.69			1		
06/09/22 10:53	281570.4			1.8			41.3			1.21			44.98			1		
06/09/22 10:54	306908.7			1.4			20.21			0.98			24			1		
06/09/22 10:55	328242.1			1.4			11.8			1.1			14.98			1		
06/09/22 10:56	349267.4			1.5			9.21			1.25			12.44			1		
06/09/22 10:57	357662.2			1.5			8.28			1.26			11.45			1		
06/09/22 10:58	359433.5			1.4			6.33			1.17			8.81			1		
06/09/22 10:59	360588.8			1.3			6.25			1.1			8.71			1		
06/09/22 11:00	359818.6			1.2			5.81			1.03			8.09			1		
06/09/22 11:01	358740.4			1.2			5.64			1.02			7.83			1		
06/09/22 11:02	358586.4			1.1			5.64			0.95			7.82			1		
06/09/22 11:03	355582.8			1.1			5.72			0.88			7.87			1		
06/09/22 11:04	343491.3			1.1			5.81			0.85			7.72			1		
06/09/22 11:05	332863			1			6.6			0.76			8.5			1		
06/09/22 11:06	326547.7			1			7.06			0.75			8.92			1		
06/09/22 11:07	318230			0.9			7.24			0.67			8.91			1		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/09/22 11:08	312530.8			0.8			6.35			0.6			7.68			1		
06/09/22 11:09	305830.4			0.8			3.36			0.59			3.97			1		
06/09/22 11:10	302441.7			0.7			2.95			0.52			3.45			1		
06/09/22 11:11	300824.4			0.7			3.13			0.52			3.65			1		
06/09/22 11:12	300824.4			0.6			3.41			0.46			3.97			1		
06/09/22 11:13	301748.6			0.6			3.41			0.46			3.98			1		
06/09/22 11:14	301363.5			0.6			3.23			0.46			3.76			1		
06/09/22 11:15	301132.4			0.6			2.77			0.46			3.22			1		
06/09/22 11:16	300824.4			0.7			2.53			0.46			2.94			1		
06/09/22 11:17	297974.8			0.7			2.25			0.46			2.59			1		
06/09/22 11:18	297820.8			0.7			2.06			0.46			2.37			1		
06/09/22 11:19	297127.6			0.7			1.97			0.46			2.26			1		
06/09/22 11:20	297050.6			0.7			1.87			0.46			2.15			1		
06/09/22 11:21	296049.4			0.7			1.78			0.46			2.04			1		
06/09/22 11:22	296588.5			0.7			1.62			0.46			1.86			1		
06/09/22 11:23	296973.6			0.6			1.52			0.4			1.75			0		
06/09/22 11:24	298205.8			0.6			1.43			0.4			1.65			0		
06/09/22 11:25	296819.6			0.6			1.33			0.4			1.53			0		
06/09/22 11:26	295510.3			0.6			1.24			0.4			1.41			0		
06/09/22 11:27	299284.1			3.6	X		1.72	X		2.57	X		1.99	X		0		

CT2 SUSD EVENT 23

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/10/22 22:50	462403.9			0.7			1.48			0.8			2.64			0		
06/10/22 22:51	472570			0.6			1.48			0.72			2.7			0		
06/10/22 22:52	467409.9			0.6			1.48			0.71			2.67			0		
06/10/22 22:53	469951.5			0.6			1.48			0.71			2.68			0		
06/10/22 22:54	465022.4			0.7			1.48			0.81			2.65			0		
06/10/22 22:55	469181.3			0.7			1.48			0.81			2.68			1		
06/10/22 22:56	451236.6			0.7			1.48			0.78			2.57			1		
06/10/22 22:57	431905.6			0.7			1.57			0.75			2.62			1		
06/10/22 22:58	411188.3			0.7			1.72			0.7			2.74			1		
06/10/22 22:59	384925.8			0.7			2.06			0.65			3.06			1		
06/10/22 23:00	363746.4			0.8			2.47			0.68			3.47			1		
06/10/22 23:01	331322.7			0.8			2.78			0.61			3.56			1		
06/10/22 23:02	311144.5			0.9			2.91			0.64			3.5			1		
06/10/22 23:03	287269.6			0.8			3.54			0.55			3.93			1		
06/10/22 23:04	266552.3			0.7			4.4			0.47			4.54			1		
06/10/22 23:05	240828.9			0.6			7.35			0.33			6.85			1		
06/10/22 23:06	215952.8			0.5			23.39			0.27			19.53			1		
06/10/22 23:07	188304			2.8			29.5			1.25			21.49			1		
06/10/22 23:08	167817.8			240.3			33.25			94.77			21.59			1		
06/10/22 23:09	147870.7			945.5			36.16			328.69			20.69			1		
06/10/22 23:10	74089.4			1646.4			36.61			286.73			10.49			1		
06/10/22 23:11	0			0			39.05			0			0			0		
06/10/22 23:12	0			0			0.3			0			0			0		
06/10/22 23:13	0			0			0.2			0			0			0		
06/10/22 23:14	0			0			0.2			0			0			0		
06/10/22 23:15	0			0			0.1			0			0			0		

CT2 SUSD EVENT 24

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/11/22 0:39	0			0			0			0			0			0		
06/11/22 0:40	0			0			0			0			0			0		
06/11/22 0:41	0			0			0			0			0			0		
06/11/22 0:42	0			0			0			0			0			0		
06/11/22 0:43	0			0			0			0			0			0		
06/11/22 0:44	2926.6			0			0			0			0			1		
06/11/22 0:45	21179.4			0			0			0			0			1		
06/11/22 0:46	32808.8			35.4			21.63			2.73			2.75			1		
06/11/22 0:47	47595.9			727			11.38			81.36			2.1			1		
06/11/22 0:48	58455.1			583.8			16.66			80.23			3.77			1		
06/11/22 0:49	73550.3			364.6			18.88			63.01			5.37			1		
06/11/22 0:50	113906.6			277.6			23.6			74.31			10.4			1		
06/11/22 0:51	144250.9			204.1			35.4			69.23			19.76			1		
06/11/22 0:52	154494			264.3			45.63			95.97			27.26			1		
06/11/22 0:53	175519.4			1494.7			45.73			616.65			31.05			1		
06/11/22 0:54	199394.4			1060			49.17			496.87			37.93			1		
06/11/22 0:55	224809.6			303.3			48.93			160.32			42.56			1		
06/11/22 0:56	250070.9			28.6			46.95			16.83			45.42			1		
06/11/22 0:57	275255.1			2.1			47.09			1.37			50.13			1		
06/11/22 0:58	288655.9			1.4			25.9			0.95			28.92			1		
06/11/22 0:59	290119.2			1.3			14.01			0.88			15.72			1		
06/11/22 1:00	295279.3			1.3			13.71			0.88			15.65			1		
06/11/22 1:01	295895.4			1.2			12.16			0.82			13.92			1		
06/11/22 1:02	295741.3			1.1			11.62			0.76			13.29			1		
06/11/22 1:03	293276.8			1			11.43			0.7			12.97			1		
06/11/22 1:04	294817.2			0.9			11.15			0.64			12.72			1		
06/11/22 1:05	298745			0.8			8.76			0.58			10.12			1		
06/11/22 1:06	319154.2			0.8			4.15			0.62			5.12			1		
06/11/22 1:07	342644.1			0.8			2.9			0.66			3.85			1		
06/11/22 1:08	360357.7			0.8			3.04			0.68			4.24			1		
06/11/22 1:09	354966.6			0.9			2.82			0.73			3.87			1		
06/11/22 1:10	333864.3			1			2.82			0.76			3.64			1		
06/11/22 1:11	311067.5			1			2.95			0.72			3.55			1		
06/11/22 1:12	288193.8			0.9			3.27			0.61			3.64			1		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/11/22 1:13	281493.4			0.7			3.84			0.5			4.18			1		
06/11/22 1:14	284034.9			0.7			4.76			0.44			5.23			1		
06/11/22 1:15	286653.4			0.6			4.19			0.38			4.64			1		
06/11/22 1:16	288039.8			0.6			3.33			0.39			3.71			1		
06/11/22 1:17	288501.8			0.6			2.57			0.39			2.87			1		
06/11/22 1:18	287269.6			0.6			2.38			0.39			2.64			1		
06/11/22 1:19	286345.4			0.6			2.19			0.38			2.42			1		
06/11/22 1:20	286961.5			0.6			2.09			0.39			2.32			1		
06/11/22 1:21	285190.2			0.6			2			0.38			2.2			1		
06/11/22 1:22	286037.3			0.5			1.9			0.32			2.11			1		
06/11/22 1:23	285575.2			0.5			1.81			0.32			2			1		
06/11/22 1:24	287192.6			0.5			1.71			0.32			1.9			1		
06/11/22 1:25	284805.1			0.6			1.62			0.38			1.78			0		
06/11/22 1:26	284574			0.6			1.52			0.38			1.68			0		
06/11/22 1:27	284420			0.6			1.52			0.38			1.67			0		
06/11/22 1:28	284574			0.6			1.43			0.38			1.57			0		
06/11/22 1:29	285344.2			0.6			1.33			0.38			1.47			0		

CT2 SUSD EVENT 25

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/12/22 1:50	285960.3			0.5			1.97			0.31			2.18			0		
06/12/22 1:51	282802.7			0.5			1.97			0.31			2.15			0		
06/12/22 1:52	283880.9			0.5			1.87			0.31			2.06			0		
06/12/22 1:53	287115.5			0.5			1.78			0.32			1.98			0		
06/12/22 1:54	285806.3			0.5			1.59			0.31			1.76			0		
06/12/22 1:55	283649.8			0.5			1.5			0.31			1.64			1		
06/12/22 1:56	261007.1			0.5			1.4			0.29			1.42			1		
06/12/22 1:57	240597.9			0.5			2.61			0.27			2.43			1		
06/12/22 1:58	212872.1			0.4			8.53			0.21			7.03			1		
06/12/22 1:59	188689.1			3.5			13.69			1.57			9.99			1		
06/12/22 2:00	166739.6			255.6			16.49			100.17			10.64			1		
06/12/22 2:01	146407.4			955.6			21.03			328.79			11.91			1		
06/12/22 2:02	53834.2			1664.8			26.03			210.56			5.42			1		
06/12/22 2:03	0			0			35.4			0			0			0		
06/12/22 2:04	0			0			0.2			0			0			0		
06/12/22 2:05	0			0			0.1			0			0			0		
06/12/22 2:06	0			0			0.1			0			0			0		
06/12/22 2:07	0			0			0.1			0			0			0		

CT2 SUSD EVENT 26

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/12/22 12:18	0			0			0			0			0			0		
06/12/22 12:19	0			0			0			0			0			0		
06/12/22 12:20	0			0			0			0			0			0		
06/12/22 12:21	0			0			0			0			0			0		
06/12/22 12:22	0			0			0			0			0			0		
06/12/22 12:23	7393.5			-0.1			0			0			0			1		
06/12/22 12:24	25415.3			0.3			0			0			0			1		
06/12/22 12:25	38893.1			78.4			21.07			7.16			3.17			1		
06/12/22 12:26	51061.6			1170.8			15.86			140.47			3.13			1		
06/12/22 12:27	62228.9			723.2			21.74			105.71			5.23			1		
06/12/22 12:28	80250.6			463.9			26.13			87.53			8.11			1		
06/12/22 12:29	125305			325.5			31.3			95.89			15.17			1		
06/12/22 12:30	152337.6			196.9			45.23			70.52			26.66			1		
06/12/22 12:31	193849.2			397.1			51.81			180.91			38.84			1		
06/12/22 12:32	195620.6			522.5			55.27			240.22			41.82			1		
06/12/22 12:33	215105.6			140.4			50.42			70.99			41.96			1		
06/12/22 12:34	237979.4			47.6			52.59			26.62			48.41			1		
06/12/22 12:35	261007.1			3.2			50.79			1.99			51.28			1		
06/12/22 12:36	290966.3			1			43.16			0.71			48.58			1		
06/12/22 12:37	312299.8			0.9			18.54			0.69			22.4			1		
06/12/22 12:38	331476.8			1.1			12.24			0.89			15.7			1		
06/12/22 12:39	336713.8			1.3			10.39			1.05			13.53			1		
06/12/22 12:40	325469.5			1.4			9.77			1.08			12.3			1		
06/12/22 12:41	326316.7			1.3			8.54			1.01			10.78			1		
06/12/22 12:42	329551.3			1.3			8.4			0.97			10.71			1		
06/12/22 12:43	340179.6			1.1			8.22			0.86			10.82			1		
06/12/22 12:44	359972.7			1			7.78			0.83			10.83			1		
06/12/22 12:45	376762.1			1			5.9			0.86			8.6			1		
06/12/22 12:46	398480.6			1			4.83			0.92			7.44			1		
06/12/22 12:47	424589.1			0.9			4.43			0.92			7.27			1		
06/12/22 12:48	434601.1			0.8			4.5			0.86			7.56			1		
06/12/22 12:49	416733.4			0.7			4.5			0.73			7.25			1		
06/12/22 12:50	392242.3			0.6			5.07			0.59			7.69			1		
06/12/22 12:51	366133.9			0.7			5.63			0.62			7.97			1		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/12/22 12:52	342644.1			0.8			5.9			0.65			7.82			1		
06/12/22 12:53	343799.3			0.9			6.08			0.71			8.08			1		
06/12/22 12:54	364285.6			0.9			6.17			0.77			8.69			1		
06/12/22 12:55	375529.9			0.8			4.92			0.71			7.14			1		
06/12/22 12:56	369214.6			0.7			4.9			0.63			7			1		
06/12/22 12:57	363053.3			0.7			5.54			0.62			7.78			1		
06/12/22 12:58	365132.7			0.7			5.72			0.61			8.08			1		
06/12/22 12:59	383693.6			0.7			4.83			0.64			7.16			1		
06/12/22 13:00	401407.3			0.7			2.27			0.69			3.52			1		
06/12/22 13:01	410880.2			0.7			1.59			0.63			2.53			1		
06/12/22 13:02	413190.7			0.6			1.48			0.63			2.36			1		
06/12/22 13:03	416502.4			0.6			1.57			0.63			2.52			1		
06/12/22 13:04	440300.3			0.7			1.59			0.68			2.71			0		
06/12/22 13:05	444382.2			0.7			1.87			0.68			3.22			0		
06/12/22 13:06	442687.8			0.7			2.15			0.68			3.69			0		
06/12/22 13:07	438143.9			0.7			2.15			0.68			3.65			0		
06/12/22 13:08	448310			0.7			2.15			0.69			3.74			0		

CT2 SUSD EVENT 27

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/12/22 23:50	277565.6			0.5			2.51			0.32			2.7			0		
06/12/22 23:51	278720.8			0.5			1.64			0.32			1.77			0		
06/12/22 23:52	278874.8			0.5			1.35			0.32			1.46			0		
06/12/22 23:53	277950.7			0.5			1.06			0.32			1.14			0		
06/12/22 23:54	278720.8			0.5			0.97			0.32			1.04			0		
06/12/22 23:55	272559.5			0.5			0.97			0.31			1.02			1		
06/12/22 23:56	248607.6			0.5			1.16			0.28			1.12			1		
06/12/22 23:57	223885.4			0.4			3.52			0.22			3.05			1		
06/12/22 23:58	200087.5			2.2			5.79			1.01			4.48			1		
06/12/22 23:59	177213.8			104			7.7			43.33			5.28			1		
06/13/22 0:00	157343.6			653			9.5			241.49			5.78			1		
06/13/22 0:01	114137.7			1500.8			14.33			402.46			6.32			1		
06/13/22 0:02	0			0			16.65			0			0			0		
06/13/22 0:03	0			0			17.7			0			0			0		
06/13/22 0:04	0			0			0.1			0			0			0		
06/13/22 0:05	0			0			0.1			0			0			0		
06/13/22 0:06	0			0			0.1			0			0			0		

CT2 SUSD EVENT 28

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/13/22 18:06	0			0			0			0			0			0		
06/13/22 18:07	0			0			0			0			0			0		
06/13/22 18:08	0			0			0			0			0			0		
06/13/22 18:09	0			0			0			0			0			0		
06/13/22 18:10	0			0			0			0			0			0		
06/13/22 18:11	1771.4			-0.1			0			0			0			1		
06/13/22 18:12	17482.6			-0.1			0			0			0			1		
06/13/22 18:13	31884.6			82.6			82.6			6.19			10.19			1		
06/13/22 18:14	45285.4			1126.9			18.15			120.07			3.18			1		
06/13/22 18:15	56606.7			808			23.25			107.43			5.09			1		
06/13/22 18:16	69776.5			508.6			28.26			83.46			7.63			1		
06/13/22 18:17	102123.2			341.1			34			81.85			13.43			1		
06/13/22 18:18	145175.1			204.3			44.5			69.69			24.98			1		
06/13/22 18:19	153569.8			130.6			60.18			47.12			35.74			1		
06/13/22 18:20	160193.2			1071.2			56.42			403.32			34.96			1		
06/13/22 18:21	178831.1			1434.2			56.14			602.93			38.84			1		
06/13/22 18:22	201319.8			766.4			56.45			362.65			43.96			1		
06/13/22 18:23	229507.6			194.3			56.75			104.81			50.39			1		
06/13/22 18:24	252766.4			15.5			55.56			9.2			54.32			1		
06/13/22 18:25	279876			2.1			56.33			1.39			60.99			1		
06/13/22 18:26	298745			1.6			32.3			1.12			37.33			1		
06/13/22 18:27	302441.7			1.6			16.59			1.11			19.42			1		
06/13/22 18:28	317151.8			1.6			13.34			1.22			16.37			1		
06/13/22 18:29	329089.3			1.6			10.62			1.26			13.52			1		
06/13/22 18:30	330937.6			1.5			9.44			1.2			12.08			1		
06/13/22 18:31	332632			1.4			8.67			1.12			11.16			1		
06/13/22 18:32	332169.9			1.4			7.9			1.06			10.15			1		
06/13/22 18:33	331630.8			1.3			7.06			0.98			9.06			1		
06/13/22 18:34	332709			1.1			6.79			0.84			8.74			1		
06/13/22 18:35	331553.8			1.1			6.62			0.84			8.48			1		
06/13/22 18:36	327934			1.1			6.44			0.83			8.16			1		
06/13/22 18:37	327471.9			1			6.26			0.76			7.93			1		
06/13/22 18:38	326316.7			1			6.17			0.75			7.79			1		
06/13/22 18:39	327703			0.9			6.26			0.7			7.94			1		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/13/22 18:40	328242.1			0.9			6.35			0.7			8.07			1		
06/13/22 18:41	327009.8			0.8			6.44			0.63			8.15			1		
06/13/22 18:42	328088			0.8			6.54			0.63			8.29			1		
06/13/22 18:43	336097.7			0.8			6.63			0.65			8.61			1		
06/13/22 18:44	339640.4			0.8			7.26			0.65			9.54			1		
06/13/22 18:45	337252.9			0.8			7.08			0.65			9.24			1		
06/13/22 18:46	340102.5			0.8			6.99			0.65			9.19			1		
06/13/22 18:47	340718.7			0.8			6.88			0.64			9.07			1		
06/13/22 18:48	331938.8			0.8			7.06			0.63			9.07			1		
06/13/22 18:49	314225.2			0.8			6.88			0.59			8.37			1		
06/13/22 18:50	311606.6			0.8			7.19			0.61			8.67			1		
06/13/22 18:51	307986.9			0.6			6.91			0.47			8.24			1		
06/13/22 18:52	299207.1			0.6			4.24			0.45			4.91			1		
06/13/22 18:53	290504.3			0.6			4.03			0.38			4.52			1		
06/13/22 18:54	287808.7			0.6			4.31			0.38			4.8			1		
06/13/22 18:55	286884.5			0.6			4.66			0.38			5.17			1		
06/13/22 18:56	286961.5			0.5			4.09			0.32			4.54			1		
06/13/22 18:57	287808.7			0.5			3.52			0.32			3.92			1		
06/13/22 18:58	289118			0.5			3.24			0.32			3.62			1		
06/13/22 18:59	289965.1			0.5			2.76			0.32			3.1			1		
06/13/22 19:00	289503			0.6			2.38			0.39			2.66			1		
06/13/22 19:01	289657.1			0.6			2			0.39			2.24			1		
06/13/22 19:02	289888.1			0.5			1.81			0.32			2.03			1		
06/13/22 19:03	287192.6			0.5			1.64			0.33			1.83			1		
06/13/22 19:04	287269.6			0.5			1.64			0.33			1.83			1		
06/13/22 19:05	287038.5			0.6			1.55			0.39			1.72			0		
06/13/22 19:06	286653.4			0.5			1.55			0.33			1.72			0		
06/13/22 19:07	286576.4			0.5			1.45			0.33			1.61			0		
06/13/22 19:08	286191.3			0.5			1.45			0.33			1.61			0		
06/13/22 19:09	286268.4			0.5			1.35			0.33			1.5			0		

CT2 SUSD EVENT 29

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/13/22 21:35	291043.3			0.6			0.95			0.39			1.07			0		
06/13/22 21:36	290350.2			0.6			0.95			0.39			1.07			0		
06/13/22 21:37	291967.6			0.6			1.05			0.39			1.18			0		
06/13/22 21:38	291505.5			0.6			1.14			0.39			1.29			0		
06/13/22 21:39	290889.3			0.6			1.14			0.39			1.28			0		
06/13/22 21:40	287038.5			0.6			1.24			0.39			1.37			1		
06/13/22 21:41	265628.1			0.6			1.43			0.36			1.47			1		
06/13/22 21:42	241214			0.6			3.34			0.33			3.12			1		
06/13/22 21:43	214412.5			0.5			9.12			0.27			7.56			1		
06/13/22 21:44	190229.5			3			15.58			1.32			11.46			1		
06/13/22 21:45	167740.8			198.9			20.25			78.39			13.14			1		
06/13/22 21:46	147562.6			787.3			23.75			272.98			13.55			1		
06/13/22 21:47	57222.9			1567.1			28.78			210.82			6.37			1		
06/13/22 21:48	0			0			31.86			0			0			0		
06/13/22 21:49	0			0			0.2			0			0			0		
06/13/22 21:50	0			0			0.1			0			0			0		
06/13/22 21:51	0			0			0.1			0			0			0		
06/13/22 21:52	0			0			0.1			0			0			0		

CT2 SUSD EVENT 30

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/14/22 17:56	0			0			0			0			0			0		
06/14/22 17:57	0			0			0			0			0			0		
06/14/22 17:58	0			0			0			0			0			0		
06/14/22 17:59	0			0			0			0			0			0		
06/14/22 18:00	0			0			0			0			0			0		
06/14/22 18:01	3234.7			-0.1			0			0			0			1		
06/14/22 18:02	21949.6			0			0			0			0			1		
06/14/22 18:03	37891.9			92.9			35.4			8.28			5.19			1		
06/14/22 18:04	47518.9			1021.5			18.88			114.1			3.47			1		
06/14/22 18:05	60534.6			645.4			24.91			91.88			5.84			1		
06/14/22 18:06	77709.1			389.7			28.32			71.18			8.51			1		
06/14/22 18:07	121839.3			247			37.01			70.71			17.44			1		
06/14/22 18:08	147177.5			143.2			52.65			49.52			29.96			1		
06/14/22 18:09	147485.6			217.3			65.28			75.36			37.25			1		
06/14/22 18:10	161656.5			1538.2			59.57			584.31			37.24			1		
06/14/22 18:11	183683.1			1269.7			58.65			548.26			41.68			1		
06/14/22 18:12	208559.3			525.1			60.4			257.42			48.73			1		
06/14/22 18:13	235052.8			90.6			62.57			50.03			56.89			1		
06/14/22 18:14	257233.3			5.8			59.35			3.5			59.06			1		
06/14/22 18:15	286730.5			1.8			53.1			1.23			58.9			1		
06/14/22 18:16	308526			1.6			24.18			1.19			28.86			1		
06/14/22 18:17	313840.1			1.6			14.52			1.21			17.63			1		
06/14/22 18:18	313378			1.7			11.62			1.27			14.08			1		
06/14/22 18:19	324314.3			1.7			10.53			1.31			13.21			1		
06/14/22 18:20	324622.3			1.5			10.08			1.18			12.65			1		
06/14/22 18:21	323467.1			1.4			8.99			1.04			11.24			1		
06/14/22 18:22	327625.9			1.3			8.26			0.98			10.47			1		
06/14/22 18:23	325161.4			1.1			7.99			0.83			10.05			1		
06/14/22 18:24	326162.7			1.1			7.62			0.84			9.62			1		
06/14/22 18:25	327009.8			1			7.44			0.77			9.42			1		
06/14/22 18:26	325931.6			1			7.44			0.76			9.38			1		
06/14/22 18:27	324083.2			0.9			7.35			0.69			9.22			1		
06/14/22 18:28	327394.9			0.9			7.35			0.7			9.31			1		
06/14/22 18:29	323236			0.8			7.44			0.62			9.31			1		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/14/22 18:30	322773.9			0.8			7.53			0.62			9.41			1		
06/14/22 18:31	322773.9			0.9			7.65			0.7			9.55			1		
06/14/22 18:32	321618.7			0.9			7.84			0.7			9.75			1		
06/14/22 18:33	319847.3			0.8			8.02			0.62			9.92			1		
06/14/22 18:34	309373.2			0.8			8.11			0.6			9.71			1		
06/14/22 18:35	286884.5			0.7			8.33			0.51			9.25			1		
06/14/22 18:36	280261.1			0.8			9.23			0.5			10.01			1		
06/14/22 18:37	278643.8			0.7			12.48			0.44			13.45			1		
06/14/22 18:38	278258.7			0.6			13.08			0.39			14.08			1		
06/14/22 18:39	279799			0.6			13.67			0.39			14.79			1		
06/14/22 18:40	279722			0.6			13.87			0.39			15			1		
06/14/22 18:41	278874.8			0.5			13.96			0.32			15.06			1		
06/14/22 18:42	278720.8			0.5			8.95			0.32			9.65			1		
06/14/22 18:43	280261.1			0.6			4.92			0.39			5.33			1		
06/14/22 18:44	283572.8			0.5			4.33			0.33			4.75			1		
06/14/22 18:45	285267.2			0.5			4.33			0.33			4.77			1		
06/14/22 18:46	285498.2			0.5			4.16			0.32			4.59			1		
06/14/22 18:47	283572.8			0.5			4.16			0.32			4.56			1		
06/14/22 18:48	281724.4			0.5			3.97			0.32			4.32			1		
06/14/22 18:49	281262.3			0.6			3.74			0.39			4.07			1		
06/14/22 18:50	282109.5			0.6			3.15			0.39			3.43			1		
06/14/22 18:51	280492.2			0.5			2.66			0.32			2.88			1		
06/14/22 18:52	280646.2			0.5			2.46			0.32			2.67			1		
06/14/22 18:53	291967.6			0.5			2.36			0.34			2.67			1		
06/14/22 18:54	312915.9			0.5			2.03			0.36			2.46			1		
06/14/22 18:55	336405.8			0.6			1.33			0.45			1.73			1		
06/14/22 18:56	345724.7			0.6			1.2			0.52			1.6			1		
06/14/22 18:57	342644.1			0.7			1			0.58			1.32			1		
06/14/22 18:58	350191.6			0.7			0.73			0.6			0.98			0		
06/14/22 18:59	366210.9			0.8			0.72			0.69			1.01			0		
06/14/22 19:00	389007.7			0.7			0.73			0.66			1.09			0		
06/14/22 19:01	397094.3			0.7			0.65			0.69			0.99			0		
06/14/22 19:02	399712.9			0.6			0.65			0.61			1			0		

CT2 SUSD EVENT 31

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/20/22 22:48	308526			0.8			1.91			0.59			2.28			0		
06/20/22 22:49	290042.2			0.8			1.72			0.56			1.93			0		
06/20/22 22:50	281801.4			0.7			1.87			0.5			2.04			0		
06/20/22 22:51	282571.6			0.8			2.19			0.51			2.39			0		
06/20/22 22:52	282571.6			0.7			2.09			0.44			2.29			0		
06/20/22 22:53	281724.4			0.7			1.62			0.44			1.76			1		
06/20/22 22:54	261854.3			0.7			1.43			0.41			1.45			1		
06/20/22 22:55	240058.8			0.7			2.85			0.39			2.65			1		
06/20/22 22:56	213411.3			0.6			7.94			0.32			6.55			1		
06/20/22 22:57	186301.6			4.7			11.56			2.06			8.33			1		
06/20/22 22:58	164891.2			278.8			14.75			108.02			9.41			1		
06/20/22 22:59	145021.1			990.7			20.49			337.76			11.5			1		
06/20/22 23:00	60765.6			1693.5			26.64			241.85			6.26			1		
06/20/22 23:01	0			0			30.89			0			0			0		
06/20/22 23:02	0			0			0.2			0			0			0		
06/20/22 23:03	0			0			0.1			0			0			0		
06/20/22 23:04	0			0			0.1			0			0			0		
06/20/22 23:05	0			0			0.1			0			0			0		

CT2 SUSD EVENT 32

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/21/22 19:19	0			0			0			0			0			0		
06/21/22 19:20	0			0			0			0			0			0		
06/21/22 19:21	0			0			0			0			0			0		
06/21/22 19:22	0			0			0			0			0			0		
06/21/22 19:23	0			0			0			0			0			0		
06/21/22 19:24	2387.5			0			0			0			0			1		
06/21/22 19:25	17482.6			0			0			0			0			1		
06/21/22 19:26	30729.4			94.4			47.2			6.83			5.62			1		
06/21/22 19:27	44900.3			1145.1			18.68			120.73			3.24			1		
06/21/22 19:28	55605.5			868.7			21.86			113.56			4.7			1		
06/21/22 19:29	67312			478.5			26.26			75.73			6.84			1		
06/21/22 19:30	99042.5			282.4			32.99			65.74			12.64			1		
06/21/22 19:31	141863.4			159.1			43.19			53.05			23.71			1		
06/21/22 19:32	147254.5			102.4			57.67			35.43			32.84			1		
06/21/22 19:33	158036.8			977			54.02			362.82			33.02			1		
06/21/22 19:34	178137.9			1427.6			55.42			597.59			38.18			1		
06/21/22 19:35	201781.8			617.3			56.05			292.82			43.75			1		
06/21/22 19:36	230123.7			117.7			57.35			63.67			51.05			1		
06/21/22 19:37	252612.4			8.2			56.23			4.86			54.94			1		
06/21/22 19:38	280338.1			2			52.99			1.34			57.47			1		
06/21/22 19:39	301209.5			1.7			24.57			1.23			28.63			1		
06/21/22 19:40	308757			1.7			13.34			1.25			15.94			1		
06/21/22 19:41	327625.9			1.8			10.26			1.4			13			1		
06/21/22 19:42	342027.9			1.7			9.8			1.39			12.97			1		
06/21/22 19:43	354196.5			1.5			7.87			1.27			10.78			1		
06/21/22 19:44	370677.9			1.5			7.15			1.32			10.25			1		
06/21/22 19:45	393705.7			1.5			5.9			1.34			8.99			1		
06/21/22 19:46	411804.4			1.3			5.07			1.25			8.08			1		
06/21/22 19:47	415578.2			1.1			5.99			1.08			9.63			1		
06/21/22 19:48	411342.3			1.1			5.81			1.07			9.24			1		
06/21/22 19:49	407799.6			1.1			5.72			1.06			9.02			1		
06/21/22 19:50	408338.7			1			5.62			0.97			8.88			1		
06/21/22 19:51	413498.8			1			5.53			1			8.84			1		
06/21/22 19:52	433985			0.9			4.21			0.96			7.07			1		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/21/22 19:53	446538.6			1			3.9			1			6.74			1		
06/21/22 19:54	445845.5			0.9			4.38			0.9			7.55			1		
06/21/22 19:55	446615.6			0.8			5.06			0.88			8.74			1		
06/21/22 19:56	454009.2			0.8			5.07			0.89			8.9			1		
06/21/22 19:57	446076.5			0.8			5.16			0.87			8.91			1		
06/21/22 19:58	455703.5			0.8			5.25			0.89			9.26			1		
06/21/22 19:59	455087.4			0.8			5.35			0.89			9.41			1		
06/21/22 20:00	452083.8			0.8			5.35			0.88			9.35			1		
06/21/22 20:01	452083.8			0.8			4.61			0.88			8.06			1		
06/21/22 20:02	454548.3			0.8			3.32			0.89			5.84			1		
06/21/22 20:03	451159.6			0.7			3.13			0.78			5.47			1		
06/21/22 20:04	450389.4			0.7			3.41			0.78			5.94			1		
06/21/22 20:05	445999.5			0.7			3.69			0.77			6.36			1		
06/21/22 20:06	448464			0.8			3.69			0.87			6.4			1		
06/21/22 20:07	447924.9			0.8			2.67			0.87			4.63			1		
06/21/22 20:08	453162			0.8			2.43			0.9			4.27			1		
06/21/22 20:09	457166.8			0.8			2.81			0.91			4.97			1		
06/21/22 20:10	463251.1			0.8			3.32			0.9			5.95			1		
06/21/22 20:11	462095.8			0.8			2.67			0.9			4.78			1		
06/21/22 20:12	463482.1			0.8			2.12			0.9			3.8			1		
06/21/22 20:13	460555.5			0.8			2.12			0.9			3.78			1		
06/21/22 20:14	462403.9			0.8			2.4			0.9			4.29			1		
06/21/22 20:15	462712			0.8			2.58			0.9			4.62			1		
06/21/22 20:16	463559.1			0.8			2.67			0.9			4.79			1		
06/21/22 20:17	463867.2			0.8			2.4			0.9			4.3			1		
06/21/22 20:18	456704.7			0.8			2.03			0.89			3.58			1		
06/21/22 20:19	454009.2			0.8			1.94			0.89			3.4			1		
06/21/22 20:20	452776.9			0.8			1.94			0.88			3.39			1		
06/21/22 20:21	452468.8			0.7			2.03			0.78			3.55			1		
06/21/22 20:22	454394.3			0.8			2.12			0.89			3.73			1		
06/21/22 20:23	452083.8			0.8			2.03			0.88			3.55			1		
06/21/22 20:24	451698.7			0.8			1.38			0.88			2.42			1		
06/21/22 20:25	456319.6			0.7			1.29			0.79			2.28			1		
06/21/22 20:26	460247.4			0.7			1.2			0.8			2.13			1		
06/21/22 20:27	454933.3			0.7			1.11			0.79			1.95			0		
06/21/22 20:28	453393			0.8			1.2			0.89			2.12			0		
06/21/22 20:29	453701.1			1.7			1.27			1.9			2.3			0		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/21/22 20:30	453239			3.9			1.34			4.42			2.48			0		
06/21/22 20:31	456704.7			2.3			1.39			2.7			2.63			0		

CT2 SUSD EVENT 33

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/23/22 2:02	286807.5			0.6			1.4			0.38			1.56			0		
06/23/22 2:03	287346.6			0.6			1.43			0.39			1.59			0		
06/23/22 2:04	287346.6			0.6			1.33			0.39			1.48			0		
06/23/22 2:05	286730.5			0.6			1.33			0.38			1.48			0		
06/23/22 2:06	287038.5			0.6			1.43			0.39			1.58			0		
06/23/22 2:07	277103.5			0.6			1.33			0.37			1.43			1		
06/23/22 2:08	253536.6			0.6			1.52			0.34			1.49			1		
06/23/22 2:09	232126.1			0.6			3.9			0.33			3.5			1		
06/23/22 2:10	205555.6			0.5			9.51			0.26			7.56			1		
06/23/22 2:11	181680.7			4.1			16.86			1.75			11.85			1		
06/23/22 2:12	160193.2			264.1			20.72			99.45			12.84			1		
06/23/22 2:13	138859.8			975.4			25.19			318.34			13.53			1		
06/23/22 2:14	24414.1			1679.3			30.42			96.23			2.87			1		
06/23/22 2:15	0			0			37.61			0			0			0		
06/23/22 2:16	0			0			0.2			0			0			0		
06/23/22 2:17	0			0			0.1			0			0			0		
06/23/22 2:18	0			0			0.1			0			0			0		
06/23/22 2:19	0			0			0.1			0			0			0		

CT2 SUSD EVENT 34

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/23/22 15:54	0			0			0			0			0			0		
06/23/22 15:55	0			0			0			0			0			0		
06/23/22 15:56	0			0			0			0			0			0		
06/23/22 15:57	0			0			0			0			0			0		
06/23/22 15:58	0			0			0			0			0			0		
06/23/22 15:59	4775			0			0			0			0			1		
06/23/22 16:00	21179.4			0.2			0			0			0			1		
06/23/22 16:01	35581.4			53.1			26.55			4.45			3.66			1		
06/23/22 16:02	47749.9			982			18.07			110.13			3.33			1		
06/23/22 16:03	59225.3			596.8			24.53			83.1			5.62			1		
06/23/22 16:04	76939			325.8			26.01			58.93			7.74			1		
06/23/22 16:05	122994.5			204.2			36.43			59.01			17.32			1		
06/23/22 16:06	145252.1			107.5			50.99			36.68			28.65			1		
06/23/22 16:07	149642			249.8			56.5			87.83			32.7			1		
06/23/22 16:08	168511			1446.4			52.74			572.75			34.37			1		
06/23/22 16:09	191769.8			931.1			54.58			419.74			40.49			1		
06/23/22 16:10	216337.9			245.6			54.83			124.93			45.89			1		
06/23/22 16:11	241830.2			22			54.73			12.49			51.19			1		
06/23/22 16:12	266552.3			2.1			54.1			1.33			55.79			1		
06/23/22 16:13	294894.2			1.5			34.7			1.04			39.58			1		
06/23/22 16:14	316150.6			1.5			15.03			1.1			18.38			1		
06/23/22 16:15	331322.7			1.6			10.44			1.27			13.38			1		
06/23/22 16:16	329705.4			1.6			7.87			1.25			10.03			1		
06/23/22 16:17	328627.2			1.5			6.79			1.17			8.64			1		
06/23/22 16:18	325469.5			1.5			6.35			1.11			8			1		
06/23/22 16:19	324468.3			1.3			6.17			0.97			7.75			1		
06/23/22 16:20	325238.4			1.3			5.99			0.99			7.54			1		
06/23/22 16:21	323390.1			1.2			5.62			0.91			7.04			1		
06/23/22 16:22	324006.2			1.1			5.16			0.84			6.47			1		
06/23/22 16:23	322157.8			1			5.07			0.77			6.32			1		
06/23/22 16:24	321310.6			1			4.98			0.77			6.19			1		
06/23/22 16:25	321310.6			1			4.89			0.77			6.07			1		
06/23/22 16:26	320694.5			0.9			4.89			0.69			6.06			1		
06/23/22 16:27	320386.4			0.9			4.89			0.69			6.06			1		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/23/22 16:28	320694.5			0.9			4.96			0.71			6.16			1		
06/23/22 16:29	320232.4			0.9			4.96			0.7			6.15			1		
06/23/22 16:30	319077.2			0.8			4.87			0.63			6.01			1		
06/23/22 16:31	319077.2			0.8			4.78			0.63			5.89			1		
06/23/22 16:32	319616.3			0.8			4.87			0.63			6.02			1		
06/23/22 16:33	317536.8			0.8			4.96			0.63			6.1			1		
06/23/22 16:34	300131.3			0.8			4.96			0.59			5.76			1		
06/23/22 16:35	292352.6			0.9			6.38			0.59			7.21			1		
06/23/22 16:36	289426			0.8			7.16			0.53			8.01			1		
06/23/22 16:37	283726.8			0.7			7.16			0.45			7.85			1		
06/23/22 16:38	282109.5			0.7			6.19			0.45			6.75			1		
06/23/22 16:39	280877.3			0.7			4.13			0.45			4.49			1		
06/23/22 16:40	281416.4			0.6			3.15			0.39			3.43			1		
06/23/22 16:41	281185.3			0.6			2.66			0.39			2.89			1		
06/23/22 16:42	280107.1			0.6			2.07			0.39			2.24			1		
06/23/22 16:43	280261.1			0.5			1.97			0.32			2.13			1		
06/23/22 16:44	280723.2			0.6			1.77			0.39			1.92			1		
06/23/22 16:45	280261.1			0.6			1.57			0.39			1.71			1		
06/23/22 16:46	281493.4			0.6			1.38			0.39			1.5			1		
06/23/22 16:47	280338.1			0.6			1.28			0.39			1.39			0		
06/23/22 16:48	288116.8			0.6			1.18			0.4			1.31			0		
06/23/22 16:49	294201			0.6			1.06			0.4			1.21			0		
06/23/22 16:50	295279.3			0.6			0.97			0.4			1.1			0		
06/23/22 16:51	291582.5			0.6			0.87			0.4			0.98			0		

CT2 SUSD EVENT 35

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/26/22 22:05	282802.7			0.6			1.62			0.38			1.77			0		
06/26/22 22:06	284111.9			0.6			1.62			0.38			1.78			0		
06/26/22 22:07	283726.8			0.6			1.62			0.38			1.78			0		
06/26/22 22:08	283187.7			0.6			1.64			0.39			1.8			0		
06/26/22 22:09	284111.9			0.6			1.64			0.39			1.81			0		
06/26/22 22:10	277180.5			0.6			1.64			0.38			1.76			1		
06/26/22 22:11	255924.1			0.6			1.64			0.35			1.63			1		
06/26/22 22:12	231741.1			0.5			4.5			0.27			4.03			1		
06/26/22 22:13	205324.6			0.5			10.27			0.26			8.16			1		
06/26/22 22:14	180063.3			4.5			16.62			1.89			11.58			1		
06/26/22 22:15	158806.9			343.3			20.37			128.19			12.52			1		
06/26/22 22:16	139707			1063.9			24.08			349.37			13.01			1		
06/26/22 22:17	22103.6			1710.8			29.68			88.85			2.54			1		
06/26/22 22:18	0			0			40.12			0			0			0		
06/26/22 22:19	0			0			0.1			0			0			0		
06/26/22 22:20	0			0			0.1			0			0			0		
06/26/22 22:21	0			0			0.1			0			0			0		
06/26/22 22:22	0			0			0.1			0			0			0		

CT2 SUSD EVENT 36

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/27/22 13:00	0			0			0			0			0			0		
06/27/22 13:01	0			0			0			0			0			0		
06/27/22 13:02	0			0			0			0			0			0		
06/27/22 13:03	0			0			0			0			0			0		
06/27/22 13:04	0			0			0			0			0			0		
06/27/22 13:05	5391.1			0			0			0			0			1		
06/27/22 13:06	18560.8			0			0			0			0			1		
06/27/22 13:07	32423.7			59			35.4			4.49			4.43			1		
06/27/22 13:08	46286.6			1035.6			16.52			112.67			2.96			1		
06/27/22 13:09	57916			701.1			23.6			95.42			5.29			1		
06/27/22 13:10	71085.7			388			25.85			64.79			7.1			1		
06/27/22 13:11	111211.1			227.3			33.6			59.42			14.46			1		
06/27/22 13:12	147716.6			126.2			45.16			43.8			25.8			1		
06/27/22 13:13	146484.4			116.7			59.18			40.18			33.53			1		
06/27/22 13:14	164429.1			1227.4			52.92			474.48			33.67			1		
06/27/22 13:15	186609.7			1042.3			56.3			457.05			40.63			1		
06/27/22 13:16	214027.4			308.6			57.67			155.21			47.74			1		
06/27/22 13:17	238980.6			33.5			57.97			18.8			53.59			1		
06/27/22 13:18	264549.9			2.7			57.75			1.69			59.1			1		
06/27/22 13:19	291043.3			1.6			42.01			1.11			47.3			1		
06/27/22 13:20	313301			1.5			19.01			1.1			23.04			1		
06/27/22 13:21	331784.8			1.5			11.44			1.2			14.68			1		
06/27/22 13:22	330013.4			1.6			9.3			1.25			11.87			1		
06/27/22 13:23	330552.6			1.5			7.6			1.18			9.72			1		
06/27/22 13:24	327780			1.5			7.44			1.12			9.44			1		
06/27/22 13:25	329782.4			1.4			6.81			1.06			8.68			1		
06/27/22 13:26	326932.8			1.2			6.63			0.91			8.38			1		
06/27/22 13:27	325161.4			1.2			6.45			0.92			8.12			1		
06/27/22 13:28	324699.3			1.1			6.18			0.84			7.76			1		
06/27/22 13:29	325931.6			1			6.08			0.78			7.67			1		
06/27/22 13:30	323005			1			5.99			0.77			7.49			1		
06/27/22 13:31	322003.8			0.9			5.9			0.7			7.35			1		
06/27/22 13:32	318153			0.9			5.9			0.69			7.26			1		
06/27/22 13:33	323159			0.9			9.18			0.71			11.47			1		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/27/22 13:34	323236			0.8			7.68			0.64			9.6			1		
06/27/22 13:35	320232.4			0.9			10.3			0.7			12.76			1		
06/27/22 13:36	319000.2			0.8			8.99			0.63			11.1			1		
06/27/22 13:37	321079.6			0.8			7.87			0.64			9.77			1		
06/27/22 13:38	321079.6			0.8			10.68			0.64			13.26			1		
06/27/22 13:39	320001.4			0.8			12.46			0.63			15.42			1		
06/27/22 13:40	319616.3			0.8			12.74			0.63			15.75			1		
06/27/22 13:41	298822			0.8			7.21			0.59			8.34			1		
06/27/22 13:42	292737.7			0.8			12.18			0.52			13.79			1		
06/27/22 13:43	288193.8			0.8			7.83			0.52			8.73			1		
06/27/22 13:44	281955.5			0.7			7.54			0.45			8.23			1		
06/27/22 13:45	282417.6			0.6			8.36			0.39			9.13			1		
06/27/22 13:46	281878.5			0.6			7.97			0.39			8.69			1		
06/27/22 13:47	281801.4			0.6			5.11			0.39			5.57			1		
06/27/22 13:48	281878.5			0.6			3.64			0.39			3.97			1		
06/27/22 13:49	281262.3			0.5			3.05			0.33			3.32			1		
06/27/22 13:50	283418.8			0.6			2.66			0.39			2.91			1		
06/27/22 13:51	282263.5			0.6			2.07			0.39			2.25			1		
06/27/22 13:52	281493.4			0.6			1.87			0.39			2.03			1		
06/27/22 13:53	281108.3			0.5			1.77			0.32			1.92			1		
06/27/22 13:54	280954.3			0.5			1.57			0.32			1.71			1		
06/27/22 13:55	281031.3			0.6			1.48			0.39			1.6			0		
06/27/22 13:56	280261.1			0.5			1.38			0.32			1.49			0		
06/27/22 13:57	281339.3			0.5			1.28			0.33			1.39			0		
06/27/22 13:58	281801.4			0.5			1.08			0.33			1.18			0		
06/27/22 13:59	292660.7			0.5			0.98			0.34			1.11			0		

CT2 SUSD EVENT 37

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/27/22 22:35	281339.3			0.6			1.55			0.38			1.68			0		
06/27/22 22:36	282186.5			0.6			1.55			0.38			1.69			0		
06/27/22 22:37	282109.5			0.5			1.45			0.32			1.58			0		
06/27/22 22:38	282340.6			0.5			1.55			0.32			1.69			0		
06/27/22 22:39	284651			0.5			1.55			0.32			1.7			0		
06/27/22 22:40	281724.4			0.6			1.55			0.38			1.69			1		
06/27/22 22:41	260237			0.6			1.55			0.36			1.56			1		
06/27/22 22:42	236131			0.5			3.15			0.27			2.87			1		
06/27/22 22:43	210176.6			0.5			9.12			0.26			7.41			1		
06/27/22 22:44	186070.6			2.6			15.58			1.14			11.21			1		
06/27/22 22:45	163042.8			216.6			19.04			82.99			12.01			1		
06/27/22 22:46	142556.6			883.9			23.13			296.2			12.76			1		
06/27/22 22:47	60688.6			1546.1			26.2			220.47			6.15			1		
06/27/22 22:48	0			0			30.89			0			0			0		
06/27/22 22:49	0			0			0.2			0			0			0		
06/27/22 22:50	0			0			0.1			0			0			0		
06/27/22 22:51	0			0			0.1			0			0			0		
06/27/22 22:52	0			0			0.1			0			0			0		

CT2 SUSD EVENT 38

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/28/22 15:44	0			0			0			0			0			0		
06/28/22 15:45	0			0			0			0			0			0		
06/28/22 15:46	0			0			0			0			0			0		
06/28/22 15:47	0			0			0			0			0			0		
06/28/22 15:48	0			0			0			0			0			0		
06/28/22 15:49	1848.4			0.1			0			0			0			1		
06/28/22 15:50	9473			0.1			0			0			0			1		
06/28/22 15:51	30729.4			59			41.3			4.27			4.91			1		
06/28/22 15:52	43822.1			996.7			18.54			102.63			3.14			1		
06/28/22 15:53	54681.3			682.1			23.93			87.64			5.06			1		
06/28/22 15:54	68621.2			365.2			26.41			58.95			7.01			1		
06/28/22 15:55	102200.2			210.6			34.63			50.58			13.69			1		
06/28/22 15:56	143865.8			116.3			48.14			39.35			26.8			1		
06/28/22 15:57	168896			78.8			63.95			31.27			41.77			1		
06/28/22 15:58	200318.5			553.9			64.73			260.76			50.15			1		
06/28/22 15:59	228814.5			103.3			66			55.58			58.43			1		
06/28/22 16:00	254999.9			5.1			67.55			3.03			66.64			1		
06/28/22 16:01	282109.5			1.2			59.42			0.77			64.84			1		
06/28/22 16:02	306292.5			1			27.6			0.75			32.7			1		
06/28/22 16:03	328473.1			1.2			13.43			0.91			17.07			1		
06/28/22 16:04	333710.2			1.4			9.57			1.12			12.35			1		
06/28/22 16:05	333017.1			1.4			7.24			1.12			9.33			1		
06/28/22 16:06	330244.5			1.3			7.87			1.04			10.05			1		
06/28/22 16:07	331399.7			1.2			7.93			0.96			10.16			1		
06/28/22 16:08	331938.8			1.2			8.05			0.91			10.33			1		
06/28/22 16:09	328858.2			1.2			7.78			0.9			9.89			1		
06/28/22 16:10	327934			1.1			7.42			0.83			9.41			1		
06/28/22 16:11	325854.6			1.1			7.15			0.82			9.01			1		
06/28/22 16:12	325854.6			1			6.97			0.75			8.79			1		
06/28/22 16:13	324545.3			1			6.88			0.75			8.64			1		
06/28/22 16:14	324853.4			1			6.9			0.76			8.67			1		
06/28/22 16:15	326316.7			0.9			6.9			0.7			8.71			1		
06/28/22 16:16	327548.9			0.9			6.9			0.7			8.74			1		
06/28/22 16:17	324853.4			0.9			6.99			0.69			8.78			1		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/28/22 16:18	324237.3			0.9			6.99			0.69			8.77			1		
06/28/22 16:19	323698.1			0.8			6.99			0.62			8.75			1		
06/28/22 16:20	324853.4			0.8			6.9			0.62			8.67			1		
06/28/22 16:21	322928			0.8			6.9			0.62			8.62			1		
06/28/22 16:22	321233.6			0.8			6.99			0.62			8.68			1		
06/28/22 16:23	323621.1			0.8			6.99			0.62			8.75			1		
06/28/22 16:24	323467.1			0.8			7.08			0.62			8.86			1		
06/28/22 16:25	312299.8			0.8			7.26			0.6			8.77			1		
06/28/22 16:26	293122.8			0.7			7.47			0.51			8.47			1		
06/28/22 16:27	290889.3			0.7			8.8			0.51			9.9			1		
06/28/22 16:28	286576.4			0.7			7.23			0.45			8.02			1		
06/28/22 16:29	283341.8			0.7			5.23			0.44			5.74			1		
06/28/22 16:30	282186.5			0.6			4.84			0.38			5.28			1		
06/28/22 16:31	282417.6			0.6			4.06			0.39			4.44			1		
06/28/22 16:32	281570.4			0.6			3.77			0.38			4.11			1		
06/28/22 16:33	281724.4			0.6			3.34			0.39			3.64			1		
06/28/22 16:34	281262.3			0.6			2.95			0.39			3.21			1		
06/28/22 16:35	280569.2			0.6			2.66			0.39			2.88			1		
06/28/22 16:36	280954.3			0.6			2.46			0.39			2.67			1		
06/28/22 16:37	282109.5			0.6			2.16			0.39			2.36			1		
06/28/22 16:38	280492.2			0.6			1.97			0.39			2.13			1		
06/28/22 16:39	281955.5			0.6			1.77			0.39			1.93			1		
06/28/22 16:40	280800.3			0.6			1.67			0.39			1.82			1		
06/28/22 16:41	280261.1			0.6			1.57			0.39			1.71			1		
06/28/22 16:42	279645			0.5			1.48			0.32			1.6			0		
06/28/22 16:43	280107.1			0.5			1.38			0.32			1.49			0		
06/28/22 16:44	279028.9			0.6			1.28			0.39			1.38			0		
06/28/22 16:45	281185.3			0.6			1.18			0.39			1.28			0		
06/28/22 16:46	278951.8			0.6			1.08			0.39			1.17			0		

CT2 SUSD EVENT 39

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/28/22 21:18	284959.1			0.6			1.52			0.38			1.68			0		
06/28/22 21:19	286114.3			0.6			1.33			0.38			1.47			0		
06/28/22 21:20	287346.6			0.6			1.24			0.39			1.37			0		
06/28/22 21:21	285498.2			0.6			1.24			0.38			1.37			0		
06/28/22 21:22	284497			0.6			1.24			0.38			1.36			0		
06/28/22 21:23	282263.5			0.6			1.33			0.38			1.45			1		
06/28/22 21:24	265474.1			0.6			1.43			0.36			1.47			1		
06/28/22 21:25	241830.2			0.6			2.61			0.33			2.44			1		
06/28/22 21:26	216800			0.5			8.11			0.27			6.8			1		
06/28/22 21:27	190383.5			2.4			15.5			1.09			11.42			1		
06/28/22 21:28	168511			120.9			19.8			47.87			12.9			1		
06/28/22 21:29	147331.6			695			24.21			240.67			13.79			1		
06/28/22 21:30	69699.5			1519.4			29.15			248.97			7.86			1		
06/28/22 21:31	0			0			31.98			0			0			0		
06/28/22 21:32	0			0			11.8			0			0			0		
06/28/22 21:33	0			0			0.2			0			0			0		
06/28/22 21:34	0			0			0.1			0			0			0		
06/28/22 21:35	0			0			0.1			0			0			0		

CT2 SUSD EVENT 40

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/29/22 11:55	0			0			0			0			0			0		
06/29/22 11:56	0			0			0			0			0			0		
06/29/22 11:57	0			0			0			0			0			0		
06/29/22 11:58	0			0			0			0			0			0		
06/29/22 11:59	0			0			0			0			0			0		
06/29/22 12:00	5699.2			0			0			0			0			1		
06/29/22 12:01	19485			0			0			0			0			1		
06/29/22 12:02	32038.6			56.1			35.4			4.22			4.38			1		
06/29/22 12:03	45824.5			1089.7			17.7			117.33			3.14			1		
06/29/22 12:04	57839			808.6			21.96			109.87			4.91			1		
06/29/22 12:05	69006.3			503.3			26.85			81.67			7.17			1		
06/29/22 12:06	100813.9			327.5			31.91			77.62			12.45			1		
06/29/22 12:07	145714.2			183.1			41.77			62.72			23.54			1		
06/29/22 12:08	148409.8			127.6			56.64			44.51			32.51			1		
06/29/22 12:09	189228.3			1074.5			53.47			477.94			39.14			1		
06/29/22 12:10	195620.6			534.4			59.47			245.71			45			1		
06/29/22 12:11	213642.3			168.5			53.92			84.6			44.56			1		
06/29/22 12:12	239288.6			35.4			56.05			19.91			51.89			1		
06/29/22 12:13	262855.5			2.8			54.6			1.72			55.52			1		
06/29/22 12:14	289272			1.3			48.68			0.86			54.46			1		
06/29/22 12:15	315611.5			1.2			20.7			0.9			25.27			1		
06/29/22 12:16	330629.6			1.3			12.87			1.04			16.47			1		
06/29/22 12:17	334480.4			1.4			10.82			1.12			13.99			1		
06/29/22 12:18	333402.2			1.5			9.39			1.19			12.11			1		
06/29/22 12:19	333325.1			1.4			8.58			1.12			11.07			1		
06/29/22 12:20	332400.9			1.3			8.19			1.03			10.53			1		
06/29/22 12:21	331168.7			1.1			7.49			0.89			9.59			1		
06/29/22 12:22	330090.5			1.1			7.42			0.83			9.47			1		
06/29/22 12:23	328858.2			1.1			7.24			0.83			9.21			1		
06/29/22 12:24	329936.4			1			6.97			0.76			8.9			1		
06/29/22 12:25	328242.1			1			6.88			0.76			8.74			1		
06/29/22 12:26	328627.2			1			6.79			0.76			8.64			1		
06/29/22 12:27	328319.1			0.9			6.79			0.69			8.63			1		
06/29/22 12:28	328088			0.9			6.79			0.69			8.62			1		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/29/22 12:29	326470.7			0.9			6.88			0.69			8.69			1		
06/29/22 12:30	325007.4			0.9			6.9			0.69			8.67			1		
06/29/22 12:31	326624.8			0.9			6.9			0.7			8.72			1		
06/29/22 12:32	321541.7			0.8			6.99			0.62			8.69			1		
06/29/22 12:33	302672.8			0.8			7.17			0.58			8.4			1		
06/29/22 12:34	287654.7			0.8			7.93			0.56			8.82			1		
06/29/22 12:35	284651			0.8			10.37			0.51			11.42			1		
06/29/22 12:36	285421.2			0.7			10.85			0.45			11.98			1		
06/29/22 12:37	284266			0.6			11.32			0.38			12.45			1		
06/29/22 12:38	284728.1			0.6			11.61			0.39			12.78			1		
06/29/22 12:39	283726.8			0.6			11.7			0.39			12.84			1		
06/29/22 12:40	284111.9			0.6			9.58			0.39			10.52			1		
06/29/22 12:41	284266			0.6			4.93			0.39			5.42			1		
06/29/22 12:42	284188.9			0.6			4.06			0.39			4.47			1		
06/29/22 12:43	284111.9			0.6			5.13			0.39			5.63			1		
06/29/22 12:44	282417.6			0.6			5.8			0.39			6.34			1		
06/29/22 12:45	285729.3			0.6			5.22			0.39			5.77			1		
06/29/22 12:46	285806.3			0.6			3.68			0.39			4.06			1		
06/29/22 12:47	287115.5			0.6			3			0.39			3.33			1		
06/29/22 12:48	286499.4			0.6			3.1			0.39			3.43			1		
06/29/22 12:49	287038.5			0.6			3.39			0.39			3.76			1		
06/29/22 12:50	287654.7			0.6			3.58			0.39			3.98			1		
06/29/22 12:51	287731.7			0.6			3.29			0.39			3.66			1		
06/29/22 12:52	286653.4			0.7			2.9			0.46			3.22			1		
06/29/22 12:53	292506.7			0.6			2.51			0.4			2.85			1		
06/29/22 12:54	301594.6			0.6			2.22			0.41			2.6			1		
06/29/22 12:55	301748.6			0.6			1.62			0.4			1.89			1		
06/29/22 12:56	299977.2			0.7			1.43			0.47			1.66			1		
06/29/22 12:57	298128.8			0.7			1.52			0.47			1.76			1		
06/29/22 12:58	308294.9			0.7			1.52			0.48			1.82			1		
06/29/22 12:59	327857			0.7			1.62			0.51			2.05			0		
06/29/22 13:00	328088			0.7			1.78			0.51			2.26			0		
06/29/22 13:01	323698.1			0.6			1.57			0.49			1.96			0		
06/29/22 13:02	323698.1			0.6			1.57			0.49			1.96			0		
06/29/22 13:03	324930.4			0.7			1.63			0.55			2.05			0		

CT2 SUSD EVENT 41

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/30/22 0:40	324930.4			0.9			1.39			0.66			1.74			0		
06/30/22 0:41	316843.7			0.9			1.59			0.66			1.94			0		
06/30/22 0:42	318153			0.8			1.54			0.61			1.9			0		
06/30/22 0:43	308063.9			0.7			1.45			0.53			1.73			0		
06/30/22 0:44	288886.9			0.7			1.45			0.49			1.62			0		
06/30/22 0:45	280261.1			0.6			1.75			0.43			1.9			1		
06/30/22 0:46	259235.8			0.6			2.38			0.35			2.39			1		
06/30/22 0:47	235129.8			0.5			5.7			0.28			5.18			1		
06/30/22 0:48	210561.7			0.8			15.19			0.38			12.37			1		
06/30/22 0:49	185146.4			8			19.79			3.48			14.17			1		
06/30/22 0:50	165122.3			446.9			23.19			173.46			14.81			1		
06/30/22 0:51	146099.3			1253.4			29.82			430.38			16.85			1		
06/30/22 0:52	49290.2			1848.9			34.29			214.39			6.54			1		
06/30/22 0:53	0			0			43.76			0			0			0		
06/30/22 0:54	0			0			0.2			0			0			0		
06/30/22 0:55	0			0			0.1			0			0			0		
06/30/22 0:56	0			0			0.1			0			0			0		
06/30/22 0:57	0			0			0.1			0			0			0		

CT2 SUSD EVENT 42

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/30/22 13:58	0			0	X		0	X		0	X		0	X		0		
06/30/22 13:59	0			0	X		0	X		0	X		0	X		0		
06/30/22 14:00	0			0	X		0	X		0	X		0	X		0		
06/30/22 14:01	0			0	X		0	X		0	X		0	X		0		
06/30/22 14:02	0			0	X		0	X		0	X		0	X		0		
06/30/22 14:03	2002.4			0	X		0	X		0	X		0	X		1		
06/30/22 14:04	21718.5			0.3	X		0	X		0	X		0	X		1		
06/30/22 14:05	35350.3			422.8	X		25.57	X		35.12	X		3.49	X		1		
06/30/22 14:06	48905.1			158.6	X		16.96	X		18.24	X		3.21	X		1		
06/30/22 14:07	61073.7			681.3			23.6			97.76			5.57			1		
06/30/22 14:08	77401.1			437.7			26.69			79.66			7.99			1		
06/30/22 14:09	122455.4			289.6			33.35			83.37			15.8			1		
06/30/22 14:10	148486.8			165.4			46.76			57.73			26.86			1		
06/30/22 14:11	171822.6			229			56.05			92.47			37.25			1		
06/30/22 14:12	162888.8			969.8			55.12			371.21			34.73			1		
06/30/22 14:13	157574.7			1030.7			50.39			381.63			30.7			1		
06/30/22 14:14	172438.8			1390.9			48.72			563.84			32.5			1		
06/30/22 14:15	195389.5			896.3			49.59			411.71			37.49			1		
06/30/22 14:16	221497.9			240.2			50.99			125.07			43.7			1		
06/30/22 14:17	245989			28.2			52.47			16.33			49.93			1		
06/30/22 14:18	270942.2			3			50.76			1.91			53.2			1		
06/30/22 14:19	297589.7			1.8			36.11			1.28			41.57			1		
06/30/22 14:20	318846.1			1.8			16.13			1.31			19.9			1		
06/30/22 14:21	330783.6			1.8			11.26			1.39			14.41			1		
06/30/22 14:22	332092.9			1.7			10.19			1.33			13.09			1		
06/30/22 14:23	332786			1.6			9.83			1.26			12.66			1		
06/30/22 14:24	331707.8			1.4			9.57			1.12			12.27			1		
06/30/22 14:25	332786			1.3			9.21			1.05			11.85			1		
06/30/22 14:26	330706.6			1.3			8.53			0.99			10.91			1		
06/30/22 14:27	328858.2			1.3			8.44			0.98			10.74			1		
06/30/22 14:28	327625.9			1.2			8.44			0.91			10.7			1		
06/30/22 14:29	326316.7			1.1			8.44			0.84			10.65			1		
06/30/22 14:30	326316.7			1.1			8.44			0.84			10.65			1		
06/30/22 14:31	324545.3			1			8.39			0.77			10.53			1		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/30/22 14:32	323390.1			1			8.39			0.77			10.5			1		
06/30/22 14:33	325007.4			0.9			8.3			0.7			10.43			1		
06/30/22 14:34	325854.6			0.9			8.3			0.71			10.46			1		
06/30/22 14:35	322851			0.9			8.3			0.7			10.36			1		
06/30/22 14:36	306138.5			0.8			8.3			0.6			9.82			1		
06/30/22 14:37	294509.1			0.8			8.24			0.58			9.39			1		
06/30/22 14:38	290196.2			0.9			9.04			0.58			10.15			1		
06/30/22 14:39	283495.8			0.8			9.99			0.51			10.96			1		
06/30/22 14:40	284959.1			0.7			11.32			0.45			12.47			1		
06/30/22 14:41	284651			0.6			11.61			0.39			12.78			1		
06/30/22 14:42	283726.8			0.6			11.8			0.39			12.95			1		
06/30/22 14:43	284188.9			0.6			9.58			0.39			10.53			1		
06/30/22 14:44	284034.9			0.6			6.09			0.39			6.69			1		
06/30/22 14:45	285498.2			0.6			4.74			0.39			5.23			1		
06/30/22 14:46	285960.3			0.6			3.97			0.39			4.39			1		
06/30/22 14:47	285267.2			0.6			3.29			0.39			3.63			1		
06/30/22 14:48	286884.5			0.6			3.1			0.39			3.43			1		
06/30/22 14:49	285883.3			0.6			2.8			0.39			3.1			1		
06/30/22 14:50	284188.9			0.6			2.61			0.39			2.87			1		
06/30/22 14:51	284882.1			0.6			2.32			0.39			2.56			1		
06/30/22 14:52	285344.2			0.6			2.22			0.39			2.46			1		
06/30/22 14:53	284805.1			0.6			2.03			0.39			2.24			1		
06/30/22 14:54	286191.3			0.6			1.93			0.39			2.14			1		
06/30/22 14:55	283033.7			0.6			1.74			0.39			1.91			0		
06/30/22 14:56	284188.9			0.6			1.74			0.39			1.91			0		
06/30/22 14:57	285190.2			0.6			1.55			0.39			1.71			0		
06/30/22 14:58	299823.2			0.6			1.55			0.41			1.79			0		
06/30/22 14:59	320694.5			0.6			1.33			0.43			1.65			0		

CT2 SUSD EVENT 43

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/30/22 23:18	285575.2			0.5			1.52			0.32			1.68			0		
06/30/22 23:19	286884.5			0.5			1.33			0.32			1.48			0		
06/30/22 23:20	286499.4			0.5			1.12			0.32			1.25			0		
06/30/22 23:21	288809.9			0.5			1.12			0.32			1.26			0		
06/30/22 23:22	288270.8			0.5			1.12			0.32			1.25			0		
06/30/22 23:23	281647.4			0.6			1.12			0.37			1.22			1		
06/30/22 23:24	257695.4			0.5			1.24			0.29			1.23			1		
06/30/22 23:25	234821.7			0.5			3.9			0.28			3.54			1		
06/30/22 23:26	209791.5			0.8			8.52			0.38			6.92			1		
06/30/22 23:27	184222.2			7.7			11.55			3.35			8.23			1		
06/30/22 23:28	163967			492.8			14.89			189.95			9.45			1		
06/30/22 23:29	144405			1235.3			19.29			419.21			10.78			1		
06/30/22 23:30	24953.2			1799.7			25.26			105.55			2.44			1		
06/30/22 23:31	0			0			34.66			0			0			0		
06/30/22 23:32	0			0			0.1			0			0			0		
06/30/22 23:33	0			0			0.1			0			0			0		
06/30/22 23:34	0			0			0.1			0			0			0		
06/30/22 23:35	0			0			0.1			0			0			0		

ATTACHMENT 16

AQ-57

AQ-57 The emissions rates from each gas turbine and heat recovery steam generator exhaust during startup and shutdown or excursions shall not exceed the following:

Combustion Turbine emissions limitations per Turbine excluding Startup and Shutdown	
Pollutant	**Pounds/Hour**
CO	6.2 3hr rolling
NOX	5.1 1 hour rolling
PM-10	4.7
SOX	1.0
VOC	1.8

Verification: The Project owner shall include all necessary emissions data to demonstrate compliance with the emissions limits provided in this Condition as part of the Quarterly Air Quality Report required in Condition of Certification AQ-SC6

AQ-57 If the Alstom GX100 turbines are selected for the Project, emission rates from each gas turbine and heat recovery steam generator exhaust, except during startup and/or shutdown, or excursions shall not exceed the following:

Alstom GTX100 - COMBUSTION TURBINE EMISSION LIMITATIONS PER TURBINE EXCLUDING STARTUP AND SHUTDOWN	
POLLUTANT	POUNDS/HOUR
Carbon Monoxide (CO)	6.2 (three-hour rolling average)
Nitrogen Oxides (NOx)	5.1 (one-hour average)
PM10	4.7
Sulfur Oxides (SOx)	1.0
Volatile Organic Compounds (VOCs)	1.8

Verification: The Project owner shall include all necessary emissions data to demonstrate compliance with the emission limits provided in this Condition as part of the Quarterly Air Quality Report required in Condition of Certification AQ-SC6.

AQ57 CT1 HOURLY EMISSIONS

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/01/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/01/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/01/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/01/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/01/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/01/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/01/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/01/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/01/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/01/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/01/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/01/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/01/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/01/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/01/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/01/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/01/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/01/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/01/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/01/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/01/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/01/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/01/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/01/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/02/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/02/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/02/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/02/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/02/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/02/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/02/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/02/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/02/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/02/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/02/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/02/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/02/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/02/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/02/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/02/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/02/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/02/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/02/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/02/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/02/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/02/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/02/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/02/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/03/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/03/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/03/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/03/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/03/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/03/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/03/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/03/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/03/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/03/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/03/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/03/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/03/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/03/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/03/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/03/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/03/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/03/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/03/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/03/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/03/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/03/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/03/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/03/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/04/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/04/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/04/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/04/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/04/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/04/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/04/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/04/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/04/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/04/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/04/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/04/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/04/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/04/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/04/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/04/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/04/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/04/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/04/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/04/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/04/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/04/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/04/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/04/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/05/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/05/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/05/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/05/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/05/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/05/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/05/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/05/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/05/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/05/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/05/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/05/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/05/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/05/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/05/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/05/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/05/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/05/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/05/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/05/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/05/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/05/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/05/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/05/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/06/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/06/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/06/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/06/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/06/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/06/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/06/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/06/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/06/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/06/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/06/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/06/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/06/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/06/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/06/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/06/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/06/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/06/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/06/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/06/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/06/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/06/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/06/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/06/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/07/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/07/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/07/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/07/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/07/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/07/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/07/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/07/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/07/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/07/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/07/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/07/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/07/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/07/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/07/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/07/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/07/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/07/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/07/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/07/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/07/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/07/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/07/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/07/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/08/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/08/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/08/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/08/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/08/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/08/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/08/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/08/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/08/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/08/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/08/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/08/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/08/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/08/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/08/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/08/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/08/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/08/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/08/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/08/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/08/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/08/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/08/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/08/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/09/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/09/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/09/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/09/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/09/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/09/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/09/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/09/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/09/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/09/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/09/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/09/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/09/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/09/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/09/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/09/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/09/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/09/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/09/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/09/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/09/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/09/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/09/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/09/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/10/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/10/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/10/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/10/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/10/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/10/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/10/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/10/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/10/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/10/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/10/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/10/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/10/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/10/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/10/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/10/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/10/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/10/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/10/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/10/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/10/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/10/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/10/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/10/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/11/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/11/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/11/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/11/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/11/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/11/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/11/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/11/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/11/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/11/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/11/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/11/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/11/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/11/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/11/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/11/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/11/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/11/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/11/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/11/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/11/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/11/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/11/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/11/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/12/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/12/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/12/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/12/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/12/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/12/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/12/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/12/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/12/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/12/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/12/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/12/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/12/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/12/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/12/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/12/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/12/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/12/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/12/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/12/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/12/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/12/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/12/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/12/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/13/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/13/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/13/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/13/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/13/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/13/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/13/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/13/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/13/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/13/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/13/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/13/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/13/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/13/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/13/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/13/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/13/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/13/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/13/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/13/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/13/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/13/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/13/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/13/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/14/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/14/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/14/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/14/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/14/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/14/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/14/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/14/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/14/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/14/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/14/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/14/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/14/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/14/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/14/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/14/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/14/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/14/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/14/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/14/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/14/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/14/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/14/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/14/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/15/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/15/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/15/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/15/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/15/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/15/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/15/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/15/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/15/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/15/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/15/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/15/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/15/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/15/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/15/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/15/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/15/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/15/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/15/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/15/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/15/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/15/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/15/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/15/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/16/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/16/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/16/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/16/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/16/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/16/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/16/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/16/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/16/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/16/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/16/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/16/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/16/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/16/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/16/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/16/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/16/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/16/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/16/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/16/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/16/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/16/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/16/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/16/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/17/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/17/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/17/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/17/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/17/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/17/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/17/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/17/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/17/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/17/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/17/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/17/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/17/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/17/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/17/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/17/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/17/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/17/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/17/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/17/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/17/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/17/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/17/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/17/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/18/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/18/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/18/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/18/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/18/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/18/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/18/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/18/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/18/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/18/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/18/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/18/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/18/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/18/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/18/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/18/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/18/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/18/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/18/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/18/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/18/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/18/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/18/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/18/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/19/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/19/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/19/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/19/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/19/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/19/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/19/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/19/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/19/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/19/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/19/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/19/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/19/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/19/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/19/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/19/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/19/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/19/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/19/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/19/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/19/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/19/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/19/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/19/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/20/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/20/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/20/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/20/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/20/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/20/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/20/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/20/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/20/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/20/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/20/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/20/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/20/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/20/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/20/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/20/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/20/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/20/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/20/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/20/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/20/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/20/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/20/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/20/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/21/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/21/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/21/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/21/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/21/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/21/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/21/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/21/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/21/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/21/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/21/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/21/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/21/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/21/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/21/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/21/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/21/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/21/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/21/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/21/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/21/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/21/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/21/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/21/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/22/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/22/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/22/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/22/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/22/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/22/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/22/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/22/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/22/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/22/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/22/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/22/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/22/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/22/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/22/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/22/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/22/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/22/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/22/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/22/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/22/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/22/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/22/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/22/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/23/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/23/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/23/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/23/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/23/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/23/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/23/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/23/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/23/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/23/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/23/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/23/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/23/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/23/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/23/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/23/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/23/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/23/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/23/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/23/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/23/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/23/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/23/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/23/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/24/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/24/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/24/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/24/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/24/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/24/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/24/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/24/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/24/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/24/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/24/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/24/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/24/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/24/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/24/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/24/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/24/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/24/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/24/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/24/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/24/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/24/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/24/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/24/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/25/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/25/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/25/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/25/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/25/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/25/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/25/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/25/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/25/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/25/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/25/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/25/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/25/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/25/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/25/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/25/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/25/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/25/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/25/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/25/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/25/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/25/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/25/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/25/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/26/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/26/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/26/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/26/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/26/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/26/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/26/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/26/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/26/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/26/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/26/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/26/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/26/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/26/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/26/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/26/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/26/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/26/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/26/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/26/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/26/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/26/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/26/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/26/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/27/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/27/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/27/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/27/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/27/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/27/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/27/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/27/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/27/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/27/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/27/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/27/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/27/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/27/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/27/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/27/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/27/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/27/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/27/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/27/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/27/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/27/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/27/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/27/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/28/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/28/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/28/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/28/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/28/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/28/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/28/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/28/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/28/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/28/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/28/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/28/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/28/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/28/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/28/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/28/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/28/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/28/22 17:00	0			0			0	X		0.14			0.06924			0.23		
04/28/22 18:00	0			0			0	X		0.16			0.0795			0.27		
04/28/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/28/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/28/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/28/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/28/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/29/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/29/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/29/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/29/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/29/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/29/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/29/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/29/22 7:00	0	X		0	X		0	X		0.15			0.07416			0.25		
04/29/22 8:00	0	X		0	X		0	X		0.31			0.15486			0.52		
04/29/22 9:00	0	X		0	X		0	X		0.44			0.22194			0.74		
04/29/22 10:00	0.7			1.5			1			0.56			0.27762			0.93		
04/29/22 11:00	0.6			1.5			1			0.56			0.28104			0.94		
04/29/22 12:00	0.6			1.4			2			0.43			0.21612			0.72		
04/29/22 13:00	0.6			1.6			1			0.56			0.2805			0.94		
04/29/22 14:00	0.6			1.5			2			0.56			0.28008			0.93		
04/29/22 15:00	0.6			1.5			1			0.55			0.2772			0.92		
04/29/22 16:00	0.7			1.6			1			0.45			0.22446			0.75		
04/29/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/29/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/29/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/29/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/29/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/29/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/29/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/30/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/30/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/30/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/30/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/30/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/30/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/30/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/30/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/30/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/30/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/30/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/30/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/30/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/30/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/30/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/30/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/30/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/30/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/30/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/30/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/30/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/30/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/30/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/30/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/01/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/01/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/01/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/01/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/01/22 4:00	0			0			0	X		0.25			0.12264			0.41		
05/01/22 5:00	1			1.5			3			0.45			0.2274			0.76		
05/01/22 6:00	1			1.5			2			0.4			0.19974			0.67		
05/01/22 7:00	0.6			1.5			2			0.36			0.18078			0.6		
05/01/22 8:00	0.6			1.6			4			0.34			0.17064			0.57		
05/01/22 9:00	0.5			1.5			4			0.33			0.16632			0.55		
05/01/22 10:00	0.5			1.5			4			0.33			0.16488			0.55		
05/01/22 11:00	0.5			1.5			3			0.33			0.16578			0.55		
05/01/22 12:00	0.5			1.5			3			0.33			0.16692			0.56		
05/01/22 13:00	0.5			1.5			3			0.33			0.1662			0.55		
05/01/22 14:00	0.4			1.5			3			0.33			0.16596			0.55		
05/01/22 15:00	0.5			1.5			3			0.33			0.16524			0.55		
05/01/22 16:00	0.4			1.5			3			0.33			0.16488			0.55		

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/01/22 17:00	0.5			1.5			3			0.33			0.16512			0.55		
05/01/22 18:00	0.5			1.5			3			0.33			0.1647			0.55		
05/01/22 19:00	0.5			1.5			3			0.33			0.16428			0.55		
05/01/22 20:00	0.5			1.5			3			0.33			0.16446			0.55		
05/01/22 21:00	0.5			1.5			4			0.33			0.1644			0.55		
05/01/22 22:00	0.5			1.5			4			0.33			0.16482			0.55		
05/01/22 23:00	0.5			1.5			4			0.33			0.16554			0.55		
05/02/22 0:00	0.5			1.5			4			0.33			0.16524			0.55		
05/02/22 1:00	0.5			1.5			4			0.33			0.16446			0.55		
05/02/22 2:00	0.5			1.5			4			0.33			0.16452			0.55		
05/02/22 3:00	0.5			1.5			5			0.33			0.16398			0.55		
05/02/22 4:00	0.5			1.5			5			0.33			0.1638			0.55		
05/02/22 5:00	0.4			1.7			6			0.32			0.1608			0.54		
05/02/22 6:00	0.4			1.5			5			0.32			0.1617			0.54		
05/02/22 7:00	0.4			1.5			5			0.33			0.16254			0.54		
05/02/22 8:00	0.6			1.5			1			0.35			0.17688			0.59		
05/02/22 9:00	0.6			1.5			2			0.36			0.17772			0.59		
05/02/22 10:00	0.6			1.5			2			0.36			0.17952			0.6		
05/02/22 11:00	0.6			1.5			2			0.36			0.17904			0.6		
05/02/22 12:00	0.6			1.5			2			0.36			0.17754			0.59		
05/02/22 13:00	0.6			1.5			2			0.36			0.17814			0.59		
05/02/22 14:00	0.6			1.5			2			0.36			0.17862			0.6		
05/02/22 15:00	0.6			1.5			2			0.36			0.1782			0.59		
05/02/22 16:00	0.6			1.5			2			0.36			0.17808			0.59		
05/02/22 17:00	0.6			1.5			1			0.43			0.21432			0.71		
05/02/22 18:00	0.6			1.4			2			0.42			0.2121			0.71		
05/02/22 19:00	0.6			1.6			2			0.46			0.23112			0.77		
05/02/22 20:00	0.7			1.4			2			0.46			0.23166			0.77		
05/02/22 21:00	0.7			1.5			1			0.55			0.27666			0.92		
05/02/22 22:00	0.7			1.5			1			0.55			0.27414			0.91		
05/02/22 23:00	0.7			1.5			2			0.56			0.27954			0.93		
05/03/22 0:00	0.7			1.5			2			0.56			0.28014			0.93		
05/03/22 1:00	0			0			0	X		0.33			0.16392			0.55		
05/03/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/03/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/03/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/03/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/03/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/03/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/03/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/03/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/03/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/03/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/03/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/03/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/03/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/03/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/03/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/03/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/03/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/03/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/03/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/03/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/03/22 22:00	0			0			0	X		0.25			0.12258			0.41		
05/03/22 23:00	0.8			1.6			2			0.52			0.25782			0.86		
05/04/22 0:00	0.8			1.5			1			0.41			0.20316			0.68		
05/04/22 1:00	0.7			1.5			3			0.36			0.17754			0.59		
05/04/22 2:00	0.8			1.4			1			0.49			0.2463			0.82		
05/04/22 3:00	0.8			1.5			2			0.53			0.26436			0.88		
05/04/22 4:00	0.7			1.5			2			0.54			0.27114			0.9		
05/04/22 5:00	0.7			1.6			2			0.47			0.23592			0.79		
05/04/22 6:00	0.6			1.4			3			0.46			0.23094			0.77		
05/04/22 7:00	1			1.5			1			0.59			0.29322			0.98		
05/04/22 8:00	0.7			1.2			3			0.4			0.20094			0.67		
05/04/22 9:00	0.5			1			2			0.34			0.17046			0.57		
05/04/22 10:00	0.4			1.3			2			0.33			0.16722			0.56		
05/04/22 11:00	0.4			1.3			2			0.34			0.1707			0.57		
05/04/22 12:00	0.5			1.5			0			0.35			0.17412			0.58		
05/04/22 13:00	0.5			1.5			1			0.35			0.17484			0.58		
05/04/22 14:00	0.4			1.5			1			0.34			0.17166			0.57		
05/04/22 15:00	0.4			1.6			2			0.33			0.16692			0.56		
05/04/22 16:00	0.4			1.5			2			0.33			0.16686			0.56		
05/04/22 17:00	0.5			1.4			1			0.38			0.18828			0.63		
05/04/22 18:00	0.3			1.5			2			0.66			0.33216			1.11		

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/04/22 19:00	0.6			1.5			2			0.61			0.30618			1.02		
05/04/22 20:00	0.7			1.5			2			0.6			0.3015			1.01		
05/04/22 21:00	0.4			1.5			2			0.65			0.32568			1.09		
05/04/22 22:00	0.9			1.5			2			0.6			0.29766			0.99		
05/04/22 23:00	0.9			1.6			1			0.47			0.23604			0.79		
05/05/22 0:00	0.6			1.6			2			0.43			0.21636			0.72		
05/05/22 1:00	0.5			1.4			2			0.36			0.1782			0.59		
05/05/22 2:00	0.5			1.5			2			0.35			0.17382			0.58		
05/05/22 3:00	0.5			1.5			3			0.35			0.17376			0.58		
05/05/22 4:00	0.5			1.4			2			0.42			0.21144			0.7		
05/05/22 5:00	0.6			1.5			2			0.4			0.19824			0.66		
05/05/22 6:00	0.4			1.5			3			0.34			0.16926			0.56		
05/05/22 7:00	0.4			1.5			3			0.33			0.1662			0.55		
05/05/22 8:00	0.4			1.5			3			0.34			0.16752			0.56		
05/05/22 9:00	0.5			1.4			2			0.35			0.17448			0.58		
05/05/22 10:00	0.5			1.3			2			0.35			0.17286			0.58		
05/05/22 11:00	0.4			1.4			2			0.34			0.17058			0.57		
05/05/22 12:00	0.6			1.2			0			0.46			0.22836			0.76		
05/05/22 13:00	0.6			1.5			1			0.49			0.24492			0.82		
05/05/22 14:00	0.4			1.4			2			0.37			0.18336			0.61		
05/05/22 15:00	0.5			1.5			2			0.36			0.17904			0.6		
05/05/22 16:00	0.4			1.5			2			0.34			0.16854			0.56		
05/05/22 17:00	0.5			1.4			1			0.41			0.20394			0.68		
05/05/22 18:00	1.3			1.5			1			0.58			0.28878			0.96		
05/05/22 19:00	1.3			1.5			1			0.57			0.28746			0.96		
05/05/22 20:00	1.3			1.5			1			0.57			0.2871			0.96		
05/05/22 21:00	1			1.6			2			0.51			0.2556			0.85		
05/05/22 22:00	0.6			1.5			2			0.38			0.18996			0.63		
05/05/22 23:00	0.5			1.5			2			0.34			0.17202			0.57		
05/06/22 0:00	0.5			1.5			3			0.35			0.17316			0.58		
05/06/22 1:00	0.5			1.5			3			0.34			0.17004			0.57		
05/06/22 2:00	0.5			1.6			2			0.35			0.17352			0.58		
05/06/22 3:00	0.6			1.4			2			0.36			0.18198			0.61		
05/06/22 4:00	1.2			1.5			1			0.56			0.28128			0.94		
05/06/22 5:00	1.2			1.5			2			0.57			0.2865			0.96		
05/06/22 6:00	1.1			1.5			2			0.57			0.28614			0.95		
05/06/22 7:00	0.7			1.5			2			0.42			0.2094			0.7		

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/06/22 8:00	1.2			1.5			1			0.57			0.28266			0.94		
05/06/22 9:00	1.2			1.5			1			0.57			0.28278			0.94		
05/06/22 10:00	0.9			1.5			1			0.55			0.27738			0.92		
05/06/22 11:00	1.1			1.5			1			0.58			0.29112			0.97		
05/06/22 12:00	0.6			1.5			1			0.52			0.25938			0.86		
05/06/22 13:00	1			1.5			1			0.58			0.29238			0.97		
05/06/22 14:00	0.7			1.6			2			0.45			0.2244			0.75		
05/06/22 15:00	0.4			1.4			2			0.33			0.1659			0.55		
05/06/22 16:00	0.9			1.4			1			0.56			0.28008			0.93		
05/06/22 17:00	1			1.5			1			0.59			0.29346			0.98		
05/06/22 18:00	1.2			1.5			1			0.58			0.28986			0.97		
05/06/22 19:00	1.1			1.5			1			0.58			0.28758			0.96		
05/06/22 20:00	1.1			1.5			1			0.57			0.28746			0.96		
05/06/22 21:00	1.1			1.5			2			0.57			0.28698			0.96		
05/06/22 22:00	0.8			1.6			2			0.49			0.24582			0.82		
05/06/22 23:00	0.7			1.5			1			0.56			0.27864			0.93		
05/07/22 0:00	1.2			1.5			2			0.56			0.27852			0.93		
05/07/22 1:00	1			1.5			2			0.57			0.28692			0.96		
05/07/22 2:00	1			1.5			2			0.59			0.29604			0.99		
05/07/22 3:00	1.1			1.5			2			0.59			0.29556			0.99		
05/07/22 4:00	1.1			1.5			2			0.59			0.29532			0.98		
05/07/22 5:00	1.2			1.5			2			0.59			0.29484			0.98		
05/07/22 6:00	1.2			1.5			2			0.59			0.2952			0.98		
05/07/22 7:00	1			1.5			2			0.59			0.29634			0.99		
05/07/22 8:00	1.1			1.5			2			0.59			0.29358			0.98		
05/07/22 9:00	1			1.5			2			0.59			0.29556			0.99		
05/07/22 10:00	1			1.5			2			0.59			0.2949			0.98		
05/07/22 11:00	0.9			1.5			2			0.59			0.29622			0.99		
05/07/22 12:00	1			1.5			1			0.56			0.28092			0.94		
05/07/22 13:00	0.5			1.4			3			0.35			0.17706			0.59		
05/07/22 14:00	0.4			1.5			3			0.33			0.1662			0.55		
05/07/22 15:00	0.4			1.5			3			0.33			0.16506			0.55		
05/07/22 16:00	0.4			1.5			3			0.33			0.16518			0.55		
05/07/22 17:00	0.5			1.4			2			0.35			0.17304			0.58		
05/07/22 18:00	1			1.5			1			0.56			0.28086			0.94		
05/07/22 19:00	1.2			1.5			1			0.57			0.28734			0.96		
05/07/22 20:00	1.1			1.5			1			0.56			0.27882			0.93		

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/07/22 21:00	0.5			1.5			4			0.35			0.17328			0.58		
05/07/22 22:00	0.4			1.3			4			0.33			0.16536			0.55		
05/07/22 23:00	0.4			1.3			4			0.33			0.16542			0.55		
05/08/22 0:00	0.4			1.3			4			0.33			0.1653			0.55		
05/08/22 1:00	0.4			1.3			4			0.33			0.16536			0.55		
05/08/22 2:00	0.3			1.3			4			0.33			0.16566			0.55		
05/08/22 3:00	0.4			1.4			5			0.33			0.16578			0.55		
05/08/22 4:00	0.4			1.3			4			0.34			0.16956			0.57		
05/08/22 5:00	0.4			1.5			4			0.33			0.16668			0.56		
05/08/22 6:00	0			0			0	X		0.23			0.11466			0.38		
05/08/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/08/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/08/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/08/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/08/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/08/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/08/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/08/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/08/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/08/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/08/22 17:00	0			0			0	X		0.32			0.15984			0.53		
05/08/22 18:00	0.4			1.3			3			0.38			0.19104			0.64		
05/08/22 19:00	1.2			1.5			1			0.58			0.28926			0.96		
05/08/22 20:00	1.1			1.5			2			0.58			0.29118			0.97		
05/08/22 21:00	1			1.5			2			0.57			0.28632			0.95		
05/08/22 22:00	0.4			1.7			4			0.36			0.17892			0.6		
05/08/22 23:00	0.3			1.5			4			0.33			0.16584			0.55		
05/09/22 0:00	0.3			1.5			4			0.33			0.16656			0.56		
05/09/22 1:00	0.3			1.5			4			0.33			0.16632			0.55		
05/09/22 2:00	0.3			1.5			4			0.33			0.16632			0.55		
05/09/22 3:00	0.4			1.5			4			0.33			0.16668			0.56		
05/09/22 4:00	0.4			1.5			4			0.33			0.16734			0.56		
05/09/22 5:00	0.4			1.6			4			0.34			0.16944			0.56		
05/09/22 6:00	0.3			1.5			5			0.33			0.16572			0.55		
05/09/22 7:00	0.3			1.5			4			0.33			0.1659			0.55		
05/09/22 8:00	0.3			1.5			4			0.33			0.1656			0.55		
05/09/22 9:00	0.3			1.5			4			0.33			0.16566			0.55		

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/09/22 10:00	0.3			1.5			3			0.33			0.16554			0.55		
05/09/22 11:00	0			0			0	X		0.18			0.09126			0.3		
05/09/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/09/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/09/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/09/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/09/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/09/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/09/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/09/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/09/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/09/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/09/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/09/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/10/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/10/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/10/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/10/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/10/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/10/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/10/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/10/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/10/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/10/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/10/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/10/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/10/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/10/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/10/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/10/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/10/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/10/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/10/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/10/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/10/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/10/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/10/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/10/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/11/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/11/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/11/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/11/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/11/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/11/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/11/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/11/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/11/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/11/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/11/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/11/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/11/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/11/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/11/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/11/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/11/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/11/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/11/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/11/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/11/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/11/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/11/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/11/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/12/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/12/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/12/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/12/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/12/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/12/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/12/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/12/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/12/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/12/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/12/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/12/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/12/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/12/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/12/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/12/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/12/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/12/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/12/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/12/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/12/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/12/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/12/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/12/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/13/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/13/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/13/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/13/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/13/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/13/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/13/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/13/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/13/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/13/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/13/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/13/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/13/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/13/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/13/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/13/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/13/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/13/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/13/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/13/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/13/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/13/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/13/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/13/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/14/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/14/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/14/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/14/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/14/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/14/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/14/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/14/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/14/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/14/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/14/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/14/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/14/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/14/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/14/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/14/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/14/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/14/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/14/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/14/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/14/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/14/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/14/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/14/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/15/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/15/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/15/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/15/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/15/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/15/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/15/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/15/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/15/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/15/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/15/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/15/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/15/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/15/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/15/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/15/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/15/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/15/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/15/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/15/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/15/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/15/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/15/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/15/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/16/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/16/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/16/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/16/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/16/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/16/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/16/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/16/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/16/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/16/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/16/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/16/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/16/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/16/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/16/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/16/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/16/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/16/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/16/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/16/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/16/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/16/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/16/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/16/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/17/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/17/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/17/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/17/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/17/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/17/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/17/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/17/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/17/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/17/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/17/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/17/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/17/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/17/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/17/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/17/22 15:00	0			0			0	X		0.34			0.17214			0.57		
05/17/22 16:00	0.6			1.4			0			0.52			0.25908			0.86		
05/17/22 17:00	0.6			1.5			1			0.53			0.26448			0.88		
05/17/22 18:00	0.6			1.5			1			0.54			0.2685			0.9		
05/17/22 19:00	1.1			1.5			1			0.57			0.28338			0.94		
05/17/22 20:00	0.8			1.5			2			0.62			0.31182			1.04		
05/17/22 21:00	0.7			1.5			2			0.64			0.31926			1.06		
05/17/22 22:00	0.9			1.5			1			0.53			0.26472			0.88		
05/17/22 23:00	0.4			1.6			4			0.33			0.16374			0.55		
05/18/22 0:00	0.4			1.5			3			0.33			0.16392			0.55		
05/18/22 1:00	0.4			1.5			4			0.32			0.16248			0.54		
05/18/22 2:00	0.6			1.4			0			0.44			0.21906			0.73		
05/18/22 3:00	0.7			1.6			2			0.71			0.3552			1.18		
05/18/22 4:00	0.1			1.5			4			0.81			0.40452			1.35		
05/18/22 5:00	0.7			1.5			2			0.6			0.29862			1		
05/18/22 6:00	0.6			1.6			2			0.46			0.22764			0.76		
05/18/22 7:00	0.6			1			1			0.52			0.2622			0.87		
05/18/22 8:00	0.6			1.5			1			0.56			0.28026			0.93		
05/18/22 9:00	0.6			1.5			1			0.56			0.2799			0.93		
05/18/22 10:00	0.8			1.5			1			0.56			0.2805			0.94		
05/18/22 11:00	0.3			1.5			2			0.71			0.3531			1.18		
05/18/22 12:00	1.2			1.5			1			0.56			0.28152			0.94		
05/18/22 13:00	0.8			1.5			2			0.66			0.32778			1.09		
05/18/22 14:00	0.1			1.5			3			0.76			0.38064			1.27		
05/18/22 15:00	0.3			1.5			2			0.68			0.3399			1.13		

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/18/22 16:00	0.8			1.5			1			0.62			0.30798			1.03		
05/18/22 17:00	0.2			1.5			3			0.74			0.36846			1.23		
05/18/22 18:00	0.2			1.5			2			0.69			0.34728			1.16		
05/18/22 19:00	0.5			1.5			2			0.67			0.33588			1.12		
05/18/22 20:00	0.2			1.5			3			0.73			0.3645			1.22		
05/18/22 21:00	0.9			1.5			1			0.61			0.30438			1.01		
05/18/22 22:00	1			1.5			1			0.6			0.30204			1.01		
05/18/22 23:00	0.9			1.5			1			0.49			0.24558			0.82		
05/19/22 0:00	0.4			1.7			3			0.31			0.15288			0.51		
05/19/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/19/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/19/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/19/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/19/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/19/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/19/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/19/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/19/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/19/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/19/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/19/22 12:00	0			0			0	X		0.3			0.1491			0.5		
05/19/22 13:00	0.6			1.3			1			0.47			0.2337			0.78		
05/19/22 14:00	0.9			1.4			2			0.63			0.31266			1.04		
05/19/22 15:00	0.8			1.4			1			0.49			0.24336			0.81		
05/19/22 16:00	0.7			1.4			1			0.47			0.23256			0.78		
05/19/22 17:00	0.9			1.4			1			0.6			0.2988			1		
05/19/22 18:00	0.9			1.4			1			0.62			0.30762			1.03		
05/19/22 19:00	0.7			1.5			2			0.63			0.31704			1.06		
05/19/22 20:00	0.4			1.5			2			0.69			0.34302			1.14		
05/19/22 21:00	0.9			1.5			2			0.61			0.30444			1.01		
05/19/22 22:00	0.9			1.4			1			0.48			0.24198			0.81		
05/19/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/20/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/20/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/20/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/20/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/20/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/20/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/20/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/20/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/20/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/20/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/20/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/20/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/20/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/20/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/20/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/20/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/20/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/20/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/20/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/20/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/20/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/20/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/20/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/20/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/21/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/21/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/21/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/21/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/21/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/21/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/21/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/21/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/21/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/21/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/21/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/21/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/21/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/21/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/21/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/21/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/21/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/21/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/21/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/21/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/21/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/21/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/21/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/21/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/22/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/22/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/22/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/22/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/22/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/22/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/22/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/22/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/22/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/22/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/22/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/22/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/22/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/22/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/22/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/22/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/22/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/22/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/22/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/22/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/22/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/22/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/22/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/22/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/23/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/23/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/23/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/23/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/23/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/23/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/23/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/23/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/23/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/23/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/23/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/23/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/23/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/23/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/23/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/23/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/23/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/23/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/23/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/23/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/23/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/23/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/23/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/23/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/24/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/24/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/24/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/24/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/24/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/24/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/24/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/24/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/24/22 8:00	0			0			0	X		0.33			0.16344			0.54		
05/24/22 9:00	0.5			1.5			1			0.35			0.17376			0.58		
05/24/22 10:00	0.7			1.4			1			0.44			0.21768			0.73		
05/24/22 11:00	0.7			1.5			0			0.47			0.23562			0.79		
05/24/22 12:00	0.8			1.5			1			0.54			0.2721			0.91		
05/24/22 13:00	0.7			1.5			2			0.64			0.3201			1.07		
05/24/22 14:00	0.2			1.5			3			0.74			0.36882			1.23		
05/24/22 15:00	0.1			1.5			4			0.79			0.39396			1.31		
05/24/22 16:00	0.1			1.5			3			0.74			0.37056			1.24		
05/24/22 17:00	0.3			1.5			2			0.69			0.34506			1.15		
05/24/22 18:00	0.1			1.5			4			0.78			0.39222			1.31		
05/24/22 19:00	0.1			1.5			3			0.75			0.37698			1.26		

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/24/22 20:00	0.4			1.5			2			0.66			0.32868			1.1		
05/24/22 21:00	0.6			1.5			2			0.64			0.31956			1.07		
05/24/22 22:00	0.4			1.5			2			0.69			0.3444			1.15		
05/24/22 23:00	1			1.6			1			0.47			0.23604			0.79		
05/25/22 0:00	0.6			1.3			1			0.47			0.2337			0.78		
05/25/22 1:00	0.6			1.6			2			0.38			0.18978			0.63		
05/25/22 2:00	0.6			1.6			2			0.35			0.1734			0.58		
05/25/22 3:00	1			1.4			1			0.46			0.23202			0.77		
05/25/22 4:00	1.4			1.5			1			0.58			0.29184			0.97		
05/25/22 5:00	1			1.5			1			0.54			0.27144			0.9		
05/25/22 6:00	1.3			1.5			1			0.58			0.2922			0.97		
05/25/22 7:00	0.8			1.6			2			0.46			0.22992			0.77		
05/25/22 8:00	0.4			1.5			2			0.33			0.16602			0.55		
05/25/22 9:00	0.6			1.1			0			0.44			0.21912			0.73		
05/25/22 10:00	1			1.4			0			0.55			0.27336			0.91		
05/25/22 11:00	0.2			1.5			3			0.76			0.38112			1.27		
05/25/22 12:00	0.1			1.5			4			0.8			0.39936			1.33		
05/25/22 13:00	0.1			1.5			4			0.8			0.39858			1.33		
05/25/22 14:00	0.1			1.5			4			0.8			0.39786			1.33		
05/25/22 15:00	0.1			1.5			4			0.79			0.39642			1.32		
05/25/22 16:00	0.1			1.5			4			0.79			0.39618			1.32		
05/25/22 17:00	0.1			1.5			4			0.78			0.39144			1.3		
05/25/22 18:00	0.1			1.5			4			0.79			0.39276			1.31		
05/25/22 19:00	0.3			1.5			2			0.67			0.33678			1.12		
05/25/22 20:00	0.8			1.5			1			0.61			0.30354			1.01		
05/25/22 21:00	0.8			1.5			1			0.62			0.309			1.03		
05/25/22 22:00	0.8			1.5			1			0.45			0.2247			0.75		
05/25/22 23:00	0			0			0	X		0.09			0.04308			0.14		
05/26/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/26/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/26/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/26/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/26/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/26/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/26/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/26/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/26/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/26/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/26/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/26/22 11:00	0			0			0	X		0.24			0.11862			0.4		
05/26/22 12:00	0.5			1.1			2			0.36			0.18072			0.6		
05/26/22 13:00	0.4			1.4			3			0.34			0.16938			0.56		
05/26/22 14:00	0.7			0.9			0			0.46			0.23064			0.77		
05/26/22 15:00	1.5			1.2			1			0.57			0.28428			0.95		
05/26/22 16:00	1.6			1.2			1			0.57			0.28488			0.95		
05/26/22 17:00	1.6			1.4			1			0.57			0.28548			0.95		
05/26/22 18:00	1.5			1.5			1			0.57			0.28644			0.95		
05/26/22 19:00	1.4			1.5			1			0.57			0.28692			0.96		
05/26/22 20:00	0.9			1.4			1			0.44			0.21906			0.73		
05/26/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/26/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/26/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/27/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/27/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/27/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/27/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/27/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/27/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/27/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/27/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/27/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/27/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/27/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/27/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/27/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/27/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/27/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/27/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/27/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/27/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/27/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/27/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/27/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/27/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/27/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/27/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/28/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/28/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/28/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/28/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/28/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/28/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/28/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/28/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/28/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/28/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/28/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/28/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/28/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/28/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/28/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/28/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/28/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/28/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/28/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/28/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/28/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/28/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/28/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/28/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/29/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/29/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/29/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/29/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/29/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/29/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/29/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/29/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/29/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/29/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/29/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/29/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/29/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/29/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/29/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/29/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/29/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/29/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/29/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/29/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/29/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/29/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/29/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/29/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/30/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/30/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/30/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/30/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/30/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/30/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/30/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/30/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/30/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/30/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/30/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/30/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/30/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/30/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/30/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/30/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/30/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/30/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/30/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/30/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/30/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/30/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/30/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/30/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/31/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/31/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/31/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/31/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/31/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/31/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/31/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/31/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/31/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/31/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/31/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/31/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/31/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/31/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/31/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/31/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/31/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/31/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/31/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/31/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/31/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/31/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/31/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/31/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/01/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/01/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/01/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/01/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/01/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/01/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/01/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/01/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/01/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/01/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/01/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/01/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/01/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/01/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/01/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/01/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/01/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/01/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/01/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/01/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/01/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/01/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/01/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/01/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/02/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/02/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/02/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/02/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/02/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/02/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/02/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/02/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/02/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/02/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/02/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/02/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/02/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/02/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/02/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/02/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/02/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/02/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/02/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/02/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/02/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/02/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/02/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/02/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/03/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/03/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/03/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/03/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/03/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/03/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/03/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/03/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/03/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/03/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/03/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/03/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/03/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/03/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/03/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/03/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/03/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/03/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/03/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/03/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/03/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/03/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/03/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/03/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/04/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/04/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/04/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/04/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/04/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/04/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/04/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/04/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/04/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/04/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/04/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/04/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/04/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/04/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/04/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/04/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/04/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/04/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/04/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/04/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/04/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/04/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/04/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/04/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/05/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/05/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/05/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/05/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/05/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/05/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/05/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/05/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/05/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/05/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/05/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/05/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/05/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/05/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/05/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/05/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/05/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/05/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/05/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/05/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/05/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/05/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/05/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/05/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/06/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/06/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/06/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/06/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/06/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/06/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/06/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/06/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/06/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/06/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/06/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/06/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/06/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/06/22 13:00	0			0			0	X		0.24			0.11976			0.4		
06/06/22 14:00	0.6			1.6			1			0.53			0.26352			0.88		
06/06/22 15:00	0.7			1.5			1			0.56			0.27936			0.93		
06/06/22 16:00	0.7			1.5			1			0.56			0.27882			0.93		
06/06/22 17:00	0.7			1.5			1			0.56			0.27858			0.93		
06/06/22 18:00	0			0			0	X		0.34			0.17076			0.57		
06/06/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/06/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/06/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/06/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/06/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/07/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/07/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/07/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/07/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/07/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/07/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/07/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/07/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/07/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/07/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/07/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/07/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/07/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/07/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/07/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/07/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/07/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/07/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/07/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/07/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/07/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/07/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/07/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/07/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/08/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/08/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/08/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/08/22 3:00	0			0			0	X		0.2			0.09912			0.33		
06/08/22 4:00	0.6			1.4			1			0.56			0.27984			0.93		
06/08/22 5:00	0.6			1.5			1			0.57			0.28452			0.95		
06/08/22 6:00	0.6			1.5			1			0.57			0.28356			0.95		
06/08/22 7:00	0.7			1.5			1			0.44			0.22206			0.74		
06/08/22 8:00	0.7			1.5			1			0.43			0.21564			0.72		
06/08/22 9:00	0.6			1.5			1			0.37			0.183			0.61		
06/08/22 10:00	0.5			1.5			1			0.36			0.18036			0.6		
06/08/22 11:00	0.5			1.5			1			0.36			0.18078			0.6		
06/08/22 12:00	0.5			1.4			1			0.38			0.19044			0.63		
06/08/22 13:00	1.6			1.5			0			0.56			0.28056			0.94		
06/08/22 14:00	1.1			1.5			1			0.56			0.27984			0.93		
06/08/22 15:00	0.7			1.3			0			0.53			0.26622			0.89		
06/08/22 16:00	0.9			1.5			1			0.54			0.26892			0.9		
06/08/22 17:00	0.7			1.5			2			0.67			0.3327			1.11		
06/08/22 18:00	0.1			1.5			3			0.8			0.3984			1.33		
06/08/22 19:00	0.2			1.5			2			0.73			0.36528			1.22		
06/08/22 20:00	0.7			1.5			1			0.64			0.32208			1.07		
06/08/22 21:00	1			1.5			1			0.6			0.30186			1.01		
06/08/22 22:00	1.1			1.5			1			0.6			0.29802			0.99		
06/08/22 23:00	1.1			1.5			1			0.61			0.30714			1.02		
06/09/22 0:00	1			1.5			1			0.61			0.306			1.02		
06/09/22 1:00	1.1			1.5			1			0.6			0.3021			1.01		
06/09/22 2:00	0.9			1.5			2			0.49			0.24402			0.81		
06/09/22 3:00	1.8			1.5			1			0.58			0.28758			0.96		
06/09/22 4:00	1.7			1.5			1			0.57			0.2868			0.96		
06/09/22 5:00	0.7			1.6			2			0.41			0.20304			0.68		

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/09/22 6:00	0.6			1.5			1			0.39			0.1938			0.65		
06/09/22 7:00	0.6			1.5			1			0.36			0.18024			0.6		
06/09/22 8:00	0.6			1.5			1			0.36			0.18072			0.6		
06/09/22 9:00	0.6			1.4			0			0.38			0.19218			0.64		
06/09/22 10:00	0.7			1.5			1			0.54			0.26874			0.9		
06/09/22 11:00	0.5			1.5			1			0.36			0.18012			0.6		
06/09/22 12:00	0.5			1.5			1			0.34			0.17148			0.57		
06/09/22 13:00	0.6			1.1			0			0.46			0.23142			0.77		
06/09/22 14:00	0.7			1.3			1			0.56			0.27786			0.93		
06/09/22 15:00	0.6			1.5			1			0.65			0.32352			1.08		
06/09/22 16:00	0.8			1.4			1			0.5			0.2478			0.83		
06/09/22 17:00	0.5			1.5			1			0.63			0.31374			1.05		
06/09/22 18:00	0.5			1.5			1			0.65			0.3252			1.08		
06/09/22 19:00	1			1.5			1			0.61			0.30522			1.02		
06/09/22 20:00	0.5			1.5			2			0.67			0.33558			1.12		
06/09/22 21:00	0.7			1.5			1			0.64			0.31812			1.06		
06/09/22 22:00	0.9			1.5			1			0.55			0.27426			0.91		
06/09/22 23:00	0.9			1.5			1			0.62			0.3114			1.04		
06/10/22 0:00	1.2			1.5			1			0.6			0.2994			1		
06/10/22 1:00	1.2			1.5			1			0.6			0.29892			1		
06/10/22 2:00	1.2			1.5			1			0.6			0.29826			0.99		
06/10/22 3:00	1.3			1.5			1			0.59			0.2973			0.99		
06/10/22 4:00	1.3			1.5			1			0.59			0.29718			0.99		
06/10/22 5:00	1			1.5			1			0.63			0.31368			1.05		
06/10/22 6:00	1.2			1.5			1			0.56			0.28152			0.94		
06/10/22 7:00	0.7			1.5			1			0.56			0.27798			0.93		
06/10/22 8:00	0.6			1.5			1			0.55			0.2766			0.92		
06/10/22 9:00	0.6			1.5			1			0.55			0.2754			0.92		
06/10/22 10:00	1.3			1.5			1			0.56			0.2796			0.93		
06/10/22 11:00	0.9			1.5			1			0.62			0.30834			1.03		
06/10/22 12:00	0.6			1.5			2			0.66			0.32826			1.09		
06/10/22 13:00	0.2			1.5			2			0.71			0.35442			1.18		
06/10/22 14:00	0.1			1.5			3			0.76			0.38166			1.27		
06/10/22 15:00	0.1			1.5			3			0.75			0.3756			1.25		
06/10/22 16:00	0.5			1.5			2			0.66			0.3291			1.1		
06/10/22 17:00	0.1			1.5			3			0.77			0.38454			1.28		
06/10/22 18:00	0.1			1.5			3			0.77			0.3831			1.28		

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/10/22 19:00	0.2			1.5			2			0.72			0.3618			1.21		
06/10/22 20:00	0.4			1.5			2			0.67			0.33414			1.11		
06/10/22 21:00	0.4			1.5			2			0.68			0.33978			1.13		
06/10/22 22:00	0.9			1.5			1			0.57			0.2832			0.94		
06/10/22 23:00	0.6			1.4			0			0.43			0.2142			0.71		
06/11/22 0:00	1.6			1.5			1			0.55			0.27738			0.92		
06/11/22 1:00	0.6			1.5			2			0.36			0.18048			0.6		
06/11/22 2:00	0.5			1.4			1			0.34			0.1698			0.57		
06/11/22 3:00	0.5			1.5			2			0.34			0.16992			0.57		
06/11/22 4:00	0.5			1.5			2			0.33			0.16722			0.56		
06/11/22 5:00	0.5			1.5			2			0.33			0.16746			0.56		
06/11/22 6:00	0.5			1.5			2			0.34			0.16782			0.56		
06/11/22 7:00	0.4			1.5			2			0.34			0.16806			0.56		
06/11/22 8:00	0.4			1.5			1			0.34			0.17112			0.57		
06/11/22 9:00	0.5			1.4			0			0.35			0.1743			0.58		
06/11/22 10:00	0.6			1.1			0			0.46			0.2295			0.77		
06/11/22 11:00	0.6			1.2			0			0.49			0.243			0.81		
06/11/22 12:00	1.2			1.5			0			0.58			0.2913			0.97		
06/11/22 13:00	0.3			1.5			2			0.69			0.34626			1.15		
06/11/22 14:00	0.2			1.5			2			0.71			0.35286			1.18		
06/11/22 15:00	0.2			1.5			2			0.7			0.34842			1.16		
06/11/22 16:00	0.3			1.5			2			0.68			0.34158			1.14		
06/11/22 17:00	0.2			1.5			2			0.73			0.36654			1.22		
06/11/22 18:00	0.1			1.5			3			0.79			0.39324			1.31		
06/11/22 19:00	0.1			1.5			3			0.78			0.38988			1.3		
06/11/22 20:00	0.1			1.5			3			0.75			0.3774			1.26		
06/11/22 21:00	0.1			1.5			3			0.75			0.37692			1.26		
06/11/22 22:00	1			1.5			1			0.59			0.29526			0.98		
06/11/22 23:00	1.1			1.4			1			0.51			0.2547			0.85		
06/12/22 0:00	0.7			1.5			2			0.65			0.3249			1.08		
06/12/22 1:00	0.9			1.6			1			0.48			0.23766			0.79		
06/12/22 2:00	0.9			1.4			1			0.54			0.27222			0.91		
06/12/22 3:00	0.6			1.5			1			0.56			0.2775			0.93		
06/12/22 4:00	0.6			1.5			1			0.56			0.27768			0.93		
06/12/22 5:00	0.6			1.2			2			0.45			0.22344			0.74		
06/12/22 6:00	0.6			1.5			0			0.36			0.17946			0.6		
06/12/22 7:00	0.6			1.5			1			0.36			0.18072			0.6		

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/12/22 8:00	0.6			1.5			1			0.36			0.18042			0.6		
06/12/22 9:00	0.6			1.4			0			0.36			0.18054			0.6		
06/12/22 10:00	0.5			1.5			0			0.36			0.18096			0.6		
06/12/22 11:00	0.8			1.3			0			0.43			0.21708			0.72		
06/12/22 12:00	1.2			1.4			1			0.51			0.25584			0.85		
06/12/22 13:00	1.2			1.4			1			0.56			0.28008			0.93		
06/12/22 14:00	1.2			1.5			1			0.57			0.28746			0.96		
06/12/22 15:00	1.1			1.5			1			0.59			0.29562			0.99		
06/12/22 16:00	1			1.5			1			0.61			0.3042			1.01		
06/12/22 17:00	1			1.5			1			0.61			0.3066			1.02		
06/12/22 18:00	0.9			1.5			1			0.62			0.3093			1.03		
06/12/22 19:00	1.1			1.5			1			0.59			0.29658			0.99		
06/12/22 20:00	1.3			1.5			1			0.6			0.29772			0.99		
06/12/22 21:00	1.1			1.5			1			0.59			0.29334			0.98		
06/12/22 22:00	1.2			1.5			1			0.59			0.29274			0.98		
06/12/22 23:00	0.7			1.6			2			0.45			0.22686			0.76		
06/13/22 0:00	0.7			1.3			0			0.48			0.24204			0.81		
06/13/22 1:00	0.7			1.5			1			0.52			0.2604			0.87		
06/13/22 2:00	0.6			1.7			2			0.37			0.1848			0.62		
06/13/22 3:00	0.7			1.5			2			0.36			0.18			0.6		
06/13/22 4:00	0.6			1.5			2			0.36			0.17982			0.6		
06/13/22 5:00	0.6			1.5			2			0.36			0.18018			0.6		
06/13/22 6:00	0.6			1.5			2			0.36			0.1794			0.6		
06/13/22 7:00	0.6			1.5			2			0.36			0.18			0.6		
06/13/22 8:00	0.6			1.5			2			0.36			0.17976			0.6		
06/13/22 9:00	0.6			1.5			1			0.36			0.17988			0.6		
06/13/22 10:00	0.5			1.5			2			0.36			0.1794			0.6		
06/13/22 11:00	0.5			1.5			1			0.36			0.18072			0.6		
06/13/22 12:00	0.5			1.5			1			0.36			0.18114			0.6		
06/13/22 13:00	0.5			1.5			1			0.36			0.18084			0.6		
06/13/22 14:00	0.5			1.5			1			0.36			0.18114			0.6		
06/13/22 15:00	0.5			1.5			1			0.36			0.1803			0.6		
06/13/22 16:00	0.6			1.5			1			0.4			0.2001			0.67		
06/13/22 17:00	0.8			1.4			1			0.43			0.21702			0.72		
06/13/22 18:00	1.1			1.6			1			0.46			0.22998			0.77		
06/13/22 19:00	1			1.3			1			0.5			0.25182			0.84		
06/13/22 20:00	1.3			1.5			1			0.58			0.28836			0.96		

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/13/22 21:00	0.6			1.5			2			0.4			0.20088			0.67		
06/13/22 22:00	0.6			1.5			1			0.36			0.18006			0.6		
06/13/22 23:00	0.6			1.5			2			0.36			0.18012			0.6		
06/14/22 0:00	0.7			1.5			2			0.36			0.17976			0.6		
06/14/22 1:00	0.6			1.5			2			0.36			0.17952			0.6		
06/14/22 2:00	0.6			1.5			2			0.36			0.1797			0.6		
06/14/22 3:00	0.6			1.5			2			0.36			0.17976			0.6		
06/14/22 4:00	0.7			1.5			2			0.36			0.17994			0.6		
06/14/22 5:00	0.8			1.4			2			0.43			0.21258			0.71		
06/14/22 6:00	0.6			1.3			2			0.36			0.18012			0.6		
06/14/22 7:00	0.6			1.3			2			0.36			0.18036			0.6		
06/14/22 8:00	0.6			1.3			2			0.36			0.17958			0.6		
06/14/22 9:00	0.6			1.3			1			0.36			0.17952			0.6		
06/14/22 10:00	0.6			1.3			1			0.36			0.18006			0.6		
06/14/22 11:00	0.6			1.3			1			0.36			0.18114			0.6		
06/14/22 12:00	0.6			1.3			1			0.36			0.18144			0.6		
06/14/22 13:00	0.6			1.5			0			0.36			0.18192			0.61		
06/14/22 14:00	0.6			1.6			1			0.36			0.18186			0.61		
06/14/22 15:00	0.6			1.5			1			0.36			0.18162			0.61		
06/14/22 16:00	0.6			1.5			1			0.36			0.18168			0.61		
06/14/22 17:00	0.6			1.4			1			0.45			0.22536			0.75		
06/14/22 18:00	0.6			1.6			2			0.41			0.20424			0.68		
06/14/22 19:00	0.9			1.3			1			0.56			0.27864			0.93		
06/14/22 20:00	1			1.5			1			0.58			0.29022			0.97		
06/14/22 21:00	0.8			1.6			1			0.49			0.2463			0.82		
06/14/22 22:00	1.3			1.4			1			0.55			0.27612			0.92		
06/14/22 23:00	1.4			1.5			1			0.6			0.29988			1		
06/15/22 0:00	1.4			1.5			1			0.6			0.30066			1		
06/15/22 1:00	1.4			1.5			1			0.59			0.29616			0.99		
06/15/22 2:00	1.3			1.6			1			0.54			0.2676			0.89		
06/15/22 3:00	1.4			1.5			2			0.6			0.30108			1		
06/15/22 4:00	0.7			1.5			2			0.69			0.3438			1.15		
06/15/22 5:00	1.2			1.5			1			0.53			0.26664			0.89		
06/15/22 6:00	0.7			1.7			2			0.4			0.2013			0.67		
06/15/22 7:00	0.6			1.4			2			0.42			0.21192			0.71		
06/15/22 8:00	0.4			1.5			2			0.34			0.16776			0.56		
06/15/22 9:00	0.4			1.5			2			0.34			0.16788			0.56		

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/15/22 10:00	0.4			1.5			1			0.34			0.16962			0.57		
06/15/22 11:00	0.5			1.5			1			0.37			0.18594			0.62		
06/15/22 12:00	0.6			1.6			1			0.52			0.2595			0.87		
06/15/22 13:00	0.6			1.6			1			0.55			0.27486			0.92		
06/15/22 14:00	0.8			1.5			1			0.6			0.29892			1		
06/15/22 15:00	0.5			1.5			1			0.66			0.3297			1.1		
06/15/22 16:00	0.7			1.5			2			0.64			0.31818			1.06		
06/15/22 17:00	0.7			1.5			1			0.63			0.3165			1.06		
06/15/22 18:00	0.9			1.5			1			0.61			0.3051			1.02		
06/15/22 19:00	1			1.5			1			0.59			0.29742			0.99		
06/15/22 20:00	1.2			1.5			1			0.59			0.2952			0.98		
06/15/22 21:00	1.3			1.5			1			0.59			0.29496			0.98		
06/15/22 22:00	1.4			1.5			1			0.59			0.29382			0.98		
06/15/22 23:00	1.3			1.5			1			0.59			0.29274			0.98		
06/16/22 0:00	1.3			1.5			1			0.58			0.2922			0.97		
06/16/22 1:00	1.3			1.5			1			0.58			0.29208			0.97		
06/16/22 2:00	1.4			1.5			1			0.58			0.29154			0.97		
06/16/22 3:00	1.5			1.5			1			0.58			0.29166			0.97		
06/16/22 4:00	1.4			1.5			1			0.58			0.29178			0.97		
06/16/22 5:00	0.9			1.6			3			0.47			0.23298			0.78		
06/16/22 6:00	0.5			1.5			2			0.34			0.1692			0.56		
06/16/22 7:00	0.5			1.5			2			0.34			0.16992			0.57		
06/16/22 8:00	0.5			1.5			2			0.34			0.16944			0.56		
06/16/22 9:00	0.4			1.5			2			0.34			0.16818			0.56		
06/16/22 10:00	0.4			1.5			2			0.34			0.16782			0.56		
06/16/22 11:00	0.5			1.4			1			0.39			0.19284			0.64		
06/16/22 12:00	1			1.6			1			0.6			0.30222			1.01		
06/16/22 13:00	0.6			1.4			2			0.66			0.3312			1.1		
06/16/22 14:00	1			1.3			1			0.6			0.3			1		
06/16/22 15:00	1			1.5			1			0.6			0.30048			1		
06/16/22 16:00	1			1.4			1			0.6			0.2997			1		
06/16/22 17:00	0.9			1.5			1			0.54			0.27126			0.9		
06/16/22 18:00	1.1			1.5			1			0.59			0.29718			0.99		
06/16/22 19:00	1.2			1.5			1			0.58			0.2892			0.96		
06/16/22 20:00	1.2			1.5			1			0.57			0.28344			0.94		
06/16/22 21:00	1.6			1.5			1			0.59			0.29262			0.98		
06/16/22 22:00	1.4			1.5			1			0.58			0.29208			0.97		

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/16/22 23:00	1.5			1.5			1			0.58			0.29196			0.97		
06/17/22 0:00	1.5			1.5			1			0.58			0.29214			0.97		
06/17/22 1:00	1.5			1.5			2			0.58			0.29238			0.97		
06/17/22 2:00	1.5			1.5			1			0.59			0.29268			0.98		
06/17/22 3:00	1.5			1.5			2			0.59			0.2928			0.98		
06/17/22 4:00	1.2			1.5			2			0.62			0.30948			1.03		
06/17/22 5:00	0.9			1.5			1			0.58			0.28848			0.96		
06/17/22 6:00	0.6			1.3			4			0.4			0.20178			0.67		
06/17/22 7:00	0.6			1.3			0			0.37			0.18642			0.62		
06/17/22 8:00	0.4			1.4			3			0.34			0.17052			0.57		
06/17/22 9:00	0.5			1.6			2			0.35			0.17568			0.59		
06/17/22 10:00	0.5			1.6			1			0.36			0.17814			0.59		
06/17/22 11:00	0.4			1.5			3			0.34			0.17052			0.57		
06/17/22 12:00	0.4			1.5			2			0.34			0.1695			0.57		
06/17/22 13:00	0.4			1.5			2			0.3			0.15126			0.5		
06/17/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/17/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/17/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/17/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/17/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/17/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/17/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/17/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/17/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/17/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/18/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/18/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/18/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/18/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/18/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/18/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/18/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/18/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/18/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/18/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/18/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/18/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/18/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/18/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/18/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/18/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/18/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/18/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/18/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/18/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/18/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/18/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/18/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/18/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/19/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/19/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/19/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/19/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/19/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/19/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/19/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/19/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/19/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/19/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/19/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/19/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/19/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/19/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/19/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/19/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/19/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/19/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/19/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/19/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/19/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/19/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/19/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/19/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/20/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/20/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/20/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/20/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/20/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/20/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/20/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/20/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/20/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/20/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/20/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/20/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/20/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/20/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/20/22 14:00	0			0			0	X		0.31			0.15588			0.52		
06/20/22 15:00	0.5			1.6			2			0.53			0.26628			0.89		
06/20/22 16:00	0.1			1.5			3			0.71			0.3534			1.18		
06/20/22 17:00	0.4			1.6			1			0.6			0.30246			1.01		
06/20/22 18:00	0.4			1.7			2			0.61			0.3051			1.02		
06/20/22 19:00	0.7			1.7			1			0.6			0.29838			0.99		
06/20/22 20:00	1			1.7			1			0.59			0.29538			0.98		
06/20/22 21:00	1			1.7			1			0.59			0.2958			0.99		
06/20/22 22:00	0.9			1.6			1			0.48			0.2385			0.8		
06/20/22 23:00	0.7			1.6			1			0.39			0.195			0.65		
06/21/22 0:00	0.8			1.7			1			0.36			0.17808			0.59		
06/21/22 1:00	0.7			1.7			1			0.35			0.17736			0.59		
06/21/22 2:00	0.7			1.8			1			0.36			0.17802			0.59		
06/21/22 3:00	0.7			1.8			1			0.36			0.17898			0.6		
06/21/22 4:00	0.7			1.6			2			0.36			0.18006			0.6		
06/21/22 5:00	0.7			1.5			1			0.39			0.19464			0.65		
06/21/22 6:00	0.7			1.6			1			0.36			0.18042			0.6		
06/21/22 7:00	0.6			1.6			1			0.36			0.18054			0.6		
06/21/22 8:00	0.6			1.6			1			0.36			0.17964			0.6		
06/21/22 9:00	0.6			1.6			1			0.36			0.17916			0.6		
06/21/22 10:00	0.6			1.6			1			0.36			0.17922			0.6		
06/21/22 11:00	0.6			1.6			1			0.36			0.18132			0.6		
06/21/22 12:00	0.6			1.6			0			0.36			0.1818			0.61		
06/21/22 13:00	0.5			1.6			1			0.36			0.18204			0.61		

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/21/22 14:00	0.6			1.5			1			0.37			0.18546			0.62		
06/21/22 15:00	0.6			1.5			0			0.38			0.19194			0.64		
06/21/22 16:00	0.5			1.6			1			0.36			0.18216			0.61		
06/21/22 17:00	0.6			1.5			1			0.38			0.19008			0.63		
06/21/22 18:00	0.7			1.5			0			0.42			0.20754			0.69		
06/21/22 19:00	1.2			1.6			1			0.54			0.27102			0.9		
06/21/22 20:00	0.8			1.6			1			0.63			0.31572			1.05		
06/21/22 21:00	0.7			1.6			1			0.65			0.3261			1.09		
06/21/22 22:00	1.2			1.6			1			0.6			0.30042			1		
06/21/22 23:00	1.3			1.6			1			0.6			0.2991			1		
06/22/22 0:00	1.4			1.6			1			0.6			0.29772			0.99		
06/22/22 1:00	1.6			1.6			1			0.6			0.29754			0.99		
06/22/22 2:00	1.1			1.5			1			0.54			0.2694			0.9		
06/22/22 3:00	1.6			1.6			1			0.59			0.29382			0.98		
06/22/22 4:00	1.2			1.6			1			0.57			0.28254			0.94		
06/22/22 5:00	0.8			1.6			2			0.44			0.21768			0.73		
06/22/22 6:00	0.7			1.6			2			0.33			0.16692			0.56		
06/22/22 7:00	0.6			1.6			2			0.33			0.16704			0.56		
06/22/22 8:00	0.5			1.6			1			0.33			0.16716			0.56		
06/22/22 9:00	0.5			1.6			1			0.33			0.16698			0.56		
06/22/22 10:00	0.5			1.6			1			0.33			0.16716			0.56		
06/22/22 11:00	0.5			1.6			1			0.34			0.16818			0.56		
06/22/22 12:00	0.5			1.6			1			0.34			0.16848			0.56		
06/22/22 13:00	0.5			1.5			1			0.36			0.17964			0.6		
06/22/22 14:00	0.5			1.5			0			0.38			0.1875			0.63		
06/22/22 15:00	0.5			1.6			1			0.35			0.17646			0.59		
06/22/22 16:00	0.5			1.6			1			0.34			0.16758			0.56		
06/22/22 17:00	0.5			1.6			1			0.33			0.16716			0.56		
06/22/22 18:00	0.5			1.6			1			0.33			0.16704			0.56		
06/22/22 19:00	0.5			1.6			1			0.34			0.1677			0.56		
06/22/22 20:00	0.7			1.5			0			0.45			0.2262			0.75		
06/22/22 21:00	1.1			1.6			0			0.53			0.26388			0.88		
06/22/22 22:00	0.7			1.6			1			0.54			0.26928			0.9		
06/22/22 23:00	1.1			1.5			1			0.59			0.29604			0.99		
06/23/22 0:00	0.9			1.5			1			0.61			0.30636			1.02		
06/23/22 1:00	1			1.5			1			0.52			0.25968			0.87		
06/23/22 2:00	0.6			1.3			1			0.39			0.19716			0.66		

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/23/22 3:00	0.7			1.5			1			0.36			0.18234			0.61		
06/23/22 4:00	0.9			1.4			1			0.45			0.22548			0.75		
06/23/22 5:00	1.2			1.6			1			0.5			0.25032			0.83		
06/23/22 6:00	1.4			1.7			1			0.57			0.28632			0.95		
06/23/22 7:00	1.4			1.7			1			0.57			0.28548			0.95		
06/23/22 8:00	1.3			1.7			1			0.57			0.28398			0.95		
06/23/22 9:00	1.3			1.7			1			0.57			0.2832			0.94		
06/23/22 10:00	1.1			1.7			1			0.55			0.27462			0.92		
06/23/22 11:00	0.6			1.7			1			0.36			0.18078			0.6		
06/23/22 12:00	0.5			1.7			0			0.35			0.17604			0.59		
06/23/22 13:00	0.5			1.7			0			0.35			0.1758			0.59		
06/23/22 14:00	0.5			1.7			0			0.35			0.1755			0.59		
06/23/22 15:00	0.5			1.7			0			0.41			0.20382			0.68		
06/23/22 16:00	0.6			1.7			1			0.4			0.1998			0.67		
06/23/22 17:00	0.8			1.6			1			0.54			0.26838			0.89		
06/23/22 18:00	0.4			1.7			2			0.69			0.34746			1.16		
06/23/22 19:00	0.1			1.6			2			0.74			0.37152			1.24		
06/23/22 20:00	0.3			1.5			2			0.72			0.36156			1.21		
06/23/22 21:00	0.8			1.5			1			0.63			0.31506			1.05		
06/23/22 22:00	1.1			1.5			1			0.6			0.29874			1		
06/23/22 23:00	1.2			1.5			1			0.6			0.29814			0.99		
06/24/22 0:00	1.2			1.5			1			0.6			0.29802			0.99		
06/24/22 1:00	1.2			1.5			1			0.59			0.29724			0.99		
06/24/22 2:00	1.2			1.5			1			0.57			0.28656			0.96		
06/24/22 3:00	0.8			1.4			1			0.42			0.21024			0.7		
06/24/22 4:00	1.4			1.5			1			0.59			0.29634			0.99		
06/24/22 5:00	0.9			1.5			2			0.46			0.22776			0.76		
06/24/22 6:00	0.5			1.5			2			0.34			0.1695			0.57		
06/24/22 7:00	0.5			1.5			2			0.34			0.16872			0.56		
06/24/22 8:00	0.5			1.5			1			0.34			0.16836			0.56		
06/24/22 9:00	0.5			1.5			1			0.34			0.1689			0.56		
06/24/22 10:00	0.6			1.4			0			0.4			0.19788			0.66		
06/24/22 11:00	0.8			1.5			0			0.5			0.24768			0.83		
06/24/22 12:00	1.1			1.5			1			0.55			0.27534			0.92		
06/24/22 13:00	0.7			1.5			1			0.54			0.27012			0.9		
06/24/22 14:00	0.4			1.5			2			0.68			0.34176			1.14		
06/24/22 15:00	0.4			1.5			2			0.68			0.33888			1.13		

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/24/22 16:00	0.4			1.5			2			0.68			0.34104			1.14		
06/24/22 17:00	0.1			1.5			3			0.77			0.38268			1.28		
06/24/22 18:00	0.3			1.5			2			0.71			0.3549			1.18		
06/24/22 19:00	0.2			1.5			2			0.72			0.35844			1.19		
06/24/22 20:00	0.7			1.5			1			0.63			0.31524			1.05		
06/24/22 21:00	1			1.5			1			0.61			0.30324			1.01		
06/24/22 22:00	0.9			1.5			1			0.63			0.31434			1.05		
06/24/22 23:00	1.1			1.5			1			0.6			0.29874			1		
06/25/22 0:00	0.9			1.5			1			0.55			0.2748			0.92		
06/25/22 1:00	0.6			1.5			2			0.69			0.34572			1.15		
06/25/22 2:00	0.8			1.4			1			0.56			0.28086			0.94		
06/25/22 3:00	0.7			1.5			1			0.56			0.27966			0.93		
06/25/22 4:00	0.7			1.5			1			0.55			0.27288			0.91		
06/25/22 5:00	0.6			1.5			2			0.46			0.22806			0.76		
06/25/22 6:00	0.5			1.6			2			0.34			0.16884			0.56		
06/25/22 7:00	0.5			1.6			2			0.33			0.16686			0.56		
06/25/22 8:00	0.5			1.6			2			0.33			0.16674			0.56		
06/25/22 9:00	0.5			1.6			2			0.33			0.16704			0.56		
06/25/22 10:00	0.5			1.6			1			0.33			0.16716			0.56		
06/25/22 11:00	0.5			1.6			1			0.34			0.16824			0.56		
06/25/22 12:00	0.5			1.6			0			0.35			0.17442			0.58		
06/25/22 13:00	0.5			1.6			1			0.34			0.16998			0.57		
06/25/22 14:00	0.5			1.6			0			0.35			0.1743			0.58		
06/25/22 15:00	0.5			1.6			1			0.34			0.17214			0.57		
06/25/22 16:00	0.5			1.5			0			0.37			0.183			0.61		
06/25/22 17:00	0.7			1.6			1			0.62			0.30816			1.03		
06/25/22 18:00	0.4			1.6			2			0.68			0.33906			1.13		
06/25/22 19:00	0.8			1.6			1			0.63			0.3135			1.05		
06/25/22 20:00	0.8			1.6			1			0.62			0.31224			1.04		
06/25/22 21:00	1			1.6			1			0.47			0.2349			0.78		
06/25/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/25/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/26/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/26/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/26/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/26/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/26/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/26/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/26/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/26/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/26/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/26/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/26/22 10:00	0			0			0	X		0.32			0.15768			0.53		
06/26/22 11:00	0.4			1.6			2			0.34			0.16842			0.56		
06/26/22 12:00	0.5			1.6			2			0.34			0.16854			0.56		
06/26/22 13:00	0.4			1.6			1			0.34			0.17142			0.57		
06/26/22 14:00	0.4			1.6			1			0.34			0.16968			0.57		
06/26/22 15:00	0.4			1.6			1			0.35			0.17274			0.58		
06/26/22 16:00	0.7			1.5			1			0.48			0.24144			0.8		
06/26/22 17:00	0.8			1.6			1			0.62			0.31242			1.04		
06/26/22 18:00	0.1			1.6			2			0.74			0.37224			1.24		
06/26/22 19:00	0.8			1.6			1			0.62			0.31002			1.03		
06/26/22 20:00	1			1.6			1			0.6			0.29898			1		
06/26/22 21:00	1			1.6			1			0.51			0.25422			0.85		
06/26/22 22:00	0.6			1.5			1			0.37			0.1854			0.62		
06/26/22 23:00	0.6			1.6			1			0.36			0.17922			0.6		
06/27/22 0:00	0.6			1.6			1			0.36			0.17922			0.6		
06/27/22 1:00	0.6			1.6			1			0.36			0.17982			0.6		
06/27/22 2:00	0.6			1.6			1			0.36			0.17988			0.6		
06/27/22 3:00	0.6			1.6			1			0.36			0.17982			0.6		
06/27/22 4:00	0.7			1.5			1			0.41			0.20508			0.68		
06/27/22 5:00	0.6			1.6			1			0.36			0.18006			0.6		
06/27/22 6:00	0.6			1.6			1			0.36			0.18018			0.6		
06/27/22 7:00	0.6			1.6			1			0.36			0.18054			0.6		
06/27/22 8:00	0.6			1.6			1			0.36			0.18054			0.6		
06/27/22 9:00	0.6			1.6			1			0.36			0.18084			0.6		
06/27/22 10:00	0.6			1.6			1			0.36			0.18066			0.6		
06/27/22 11:00	0.6			1.6			1			0.36			0.18078			0.6		
06/27/22 12:00	0.6			1.5			1			0.38			0.19032			0.63		
06/27/22 13:00	0.6			1.6			1			0.42			0.21006			0.7		
06/27/22 14:00	0.7			1.6			0			0.49			0.24672			0.82		
06/27/22 15:00	0.9			1.6			1			0.61			0.30396			1.01		
06/27/22 16:00	0.9			1.6			1			0.61			0.30366			1.01		
06/27/22 17:00	0.7			1.6			1			0.64			0.31896			1.06		

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/27/22 18:00	0.3			1.6			2			0.69			0.34392			1.15		
06/27/22 19:00	0.8			1.6			1			0.62			0.30996			1.03		
06/27/22 20:00	1			1.6			1			0.61			0.30474			1.02		
06/27/22 21:00	0.9			1.6			1			0.59			0.29328			0.98		
06/27/22 22:00	0.6			1.5			1			0.38			0.18978			0.63		
06/27/22 23:00	0.6			1.6			1			0.36			0.18066			0.6		
06/28/22 0:00	0.6			1.6			1			0.35			0.17694			0.59		
06/28/22 1:00	0.6			1.6			1			0.35			0.177			0.59		
06/28/22 2:00	0.6			1.7			1			0.35			0.17664			0.59		
06/28/22 3:00	0.6			1.6			2			0.35			0.1767			0.59		
06/28/22 4:00	0.7			1.6			1			0.5			0.24972			0.83		
06/28/22 5:00	0.7			1.6			1			0.41			0.20748			0.69		
06/28/22 6:00	0.6			1.6			1			0.36			0.17928			0.6		
06/28/22 7:00	0.6			1.6			1			0.36			0.17988			0.6		
06/28/22 8:00	0.6			1.6			1			0.36			0.18024			0.6		
06/28/22 9:00	0.6			1.6			1			0.36			0.18036			0.6		
06/28/22 10:00	0.6			1.6			1			0.36			0.18			0.6		
06/28/22 11:00	0.6			1.6			1			0.39			0.1935			0.65		
06/28/22 12:00	0.6			1.6			1			0.36			0.18018			0.6		
06/28/22 13:00	0.5			1.6			1			0.36			0.17982			0.6		
06/28/22 14:00	0.5			1.6			1			0.36			0.1803			0.6		
06/28/22 15:00	0.5			1.5			1			0.41			0.20724			0.69		
06/28/22 16:00	0.5			1.6			1			0.36			0.18114			0.6		
06/28/22 17:00	0.7			1.5			1			0.52			0.25902			0.86		
06/28/22 18:00	0.9			1.6			1			0.6			0.30204			1.01		
06/28/22 19:00	1.3			1.6			1			0.6			0.29862			1		
06/28/22 20:00	0.9			1.6			1			0.52			0.26196			0.87		
06/28/22 21:00	0.6			1.5			1			0.4			0.19914			0.66		
06/28/22 22:00	0.6			1.6			1			0.36			0.17844			0.59		
06/28/22 23:00	0.7			1.5			1			0.53			0.26478			0.88		
06/29/22 0:00	1.4			1.6			1			0.56			0.28176			0.94		
06/29/22 1:00	0.8			1.6			1			0.55			0.27684			0.92		
06/29/22 2:00	0.6			1.6			1			0.55			0.27672			0.92		
06/29/22 3:00	0.6			1.6			1			0.55			0.2763			0.92		
06/29/22 4:00	0.6			1.6			1			0.55			0.27726			0.92		
06/29/22 5:00	0.6			1.6			1			0.52			0.25908			0.86		
06/29/22 6:00	0.6			1.6			1			0.38			0.18816			0.63		

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/29/22 7:00	0.6			1.6			1			0.36			0.18078			0.6		
06/29/22 8:00	0.6			1.6			1			0.36			0.18174			0.61		
06/29/22 9:00	0.6			1.6			1			0.37			0.18468			0.62		
06/29/22 10:00	0.6			1.6			1			0.36			0.18126			0.6		
06/29/22 11:00	0.6			1.5			1			0.42			0.20886			0.7		
06/29/22 12:00	0.5			1.6			1			0.4			0.20184			0.67		
06/29/22 13:00	0.8			1.6			0			0.51			0.25494			0.85		
06/29/22 14:00	1			1.6			1			0.61			0.30354			1.01		
06/29/22 15:00	1			1.6			1			0.61			0.30258			1.01		
06/29/22 16:00	1			1.6			1			0.6			0.30228			1.01		
06/29/22 17:00	1			1.6			1			0.6			0.3024			1.01		
06/29/22 18:00	1			1.6			1			0.62			0.30864			1.03		
06/29/22 19:00	0.9			1.6			1			0.63			0.31614			1.05		
06/29/22 20:00	0.9			1.6			1			0.62			0.3123			1.04		
06/29/22 21:00	1.3			1.6			1			0.6			0.30234			1.01		
06/29/22 22:00	1.4			1.6			1			0.59			0.29418			0.98		
06/29/22 23:00	0.6			1.6			2			0.68			0.3408			1.14		
06/30/22 0:00	0.9			1.5			2			0.5			0.2517			0.84		
06/30/22 1:00	0.6			1.4			1			0.56			0.28014			0.93		
06/30/22 2:00	0.6			1.3			2			0.49			0.2433			0.81		
06/30/22 3:00	0.6			1.4			1			0.55			0.27288			0.91		
06/30/22 4:00	0.7			1.4			1			0.49			0.24552			0.82		
06/30/22 5:00	0.6			1.5			2			0.48			0.23796			0.79		
06/30/22 6:00	0.6			1.5			2			0.36			0.18024			0.6		
06/30/22 7:00	0.6			1.5			1			0.36			0.18054			0.6		
06/30/22 8:00	0.6			1.5			1			0.36			0.18042			0.6		
06/30/22 9:00	0.6			1.5			1			0.36			0.18078			0.6		
06/30/22 10:00	0.6			1.5			1			0.36			0.18138			0.6		
06/30/22 11:00	0.6			1.5			1			0.37			0.18264			0.61		
06/30/22 12:00	0.6			1.5			1			0.37			0.18318			0.61		
06/30/22 13:00	0.6			1.4			1			0.42			0.2106			0.7		
06/30/22 14:00	0.6			1.5			1			0.42			0.20922			0.7		
06/30/22 15:00	0.8			1.5			0			0.54			0.2682			0.89		
06/30/22 16:00	1			1.5			1			0.61			0.30462			1.02		
06/30/22 17:00	0.9			1.5			1			0.62			0.31098			1.04		
06/30/22 18:00	0.4			1.5			2			0.71			0.35712			1.19		
06/30/22 19:00	0.1			1.5			3			0.79			0.3942			1.31		

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/30/22 20:00	0.9			1.5			1			0.63			0.31716			1.06		
06/30/22 21:00	1.4			1.5			1			0.59			0.29556			0.99		
06/30/22 22:00	1.2			1.5			1			0.54			0.26946			0.9		
06/30/22 23:00	0.7			1.4			1			0.48			0.23766			0.79		
07/01/22 0:00	0.6			1.5			2			0.45			0.22584			0.75		
07/01/22 1:00	0.6			1.5			2			0.36			0.18036			0.6		
07/01/22 2:00	0.6			1.4			1			0.36			0.18108			0.6		
07/01/22 3:00	0.7			1.5			2			0.36			0.18204			0.61		
07/01/22 4:00	0.7			1.5			2			0.37			0.18276			0.61		
07/01/22 5:00	0.7			1.5			1			0.44			0.21846			0.73		
07/01/22 6:00	0.6			1.5			2			0.36			0.18084			0.6		
07/01/22 7:00	0.6			1.5			1			0.36			0.1815			0.61		
07/01/22 8:00	0.6			1.5			1			0.36			0.18096			0.6		
07/01/22 9:00	0.6			1.5			1			0.36			0.18102			0.6		
07/01/22 10:00	0.6			1.5			1			0.36			0.18144			0.6		
07/01/22 11:00	0.6			1.5			1			0.37			0.18282			0.61		
07/01/22 12:00	0.6			1.5			1			0.37			0.1833			0.61		
07/01/22 13:00	0.6			1.5			1			0.36			0.1821			0.61		
07/01/22 14:00	0.6			1.5			1			0.36			0.1815			0.61		
07/01/22 15:00	0.5			1.5			1			0.36			0.18114			0.6		
07/01/22 16:00	0.6			1.5			1			0.42			0.20916			0.7		
07/01/22 17:00	1.6			1.5			1			0.57			0.2844			0.95		
07/01/22 18:00	0.9			1.5			1			0.56			0.28038			0.93		
07/01/22 19:00	1			1.5			1			0.6			0.30084			1		
07/01/22 20:00	1.3			1.5			1			0.6			0.29832			0.99		
07/01/22 21:00	1.5			1.5			1			0.59			0.29628			0.99		
07/01/22 22:00	1.2			1.5			1			0.53			0.26514			0.88		
07/01/22 23:00	0.6			1.4			2			0.37			0.18636			0.62		

AQ57 CT2 HOURLY EMISSIONS

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/01/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/01/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/01/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/01/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/01/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/01/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/01/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/01/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/01/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/01/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/01/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/01/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/01/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/01/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/01/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/01/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/01/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/01/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/01/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/01/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/01/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/01/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/01/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/01/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/02/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/02/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/02/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/02/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/02/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/02/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/02/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/02/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/02/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/02/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/02/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/02/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/02/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/02/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/02/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/02/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/02/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/02/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/02/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/02/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/02/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/02/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/02/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/02/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/03/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/03/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/03/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/03/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/03/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/03/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/03/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/03/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/03/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/03/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/03/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/03/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/03/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/03/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/03/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/03/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/03/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/03/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/03/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/03/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/03/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/03/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/03/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/03/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/04/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/04/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/04/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/04/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/04/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/04/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/04/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/04/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/04/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/04/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/04/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/04/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/04/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/04/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/04/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/04/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/04/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/04/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/04/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/04/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/04/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/04/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/04/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/04/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/05/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/05/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/05/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/05/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/05/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/05/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/05/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/05/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/05/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/05/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/05/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/05/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/05/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/05/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/05/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/05/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/05/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/05/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/05/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/05/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/05/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/05/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/05/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/05/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/06/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/06/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/06/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/06/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/06/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/06/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/06/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/06/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/06/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/06/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/06/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/06/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/06/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/06/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/06/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/06/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/06/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/06/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/06/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/06/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/06/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/06/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/06/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/06/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/07/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/07/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/07/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/07/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/07/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/07/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/07/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/07/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/07/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/07/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/07/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/07/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/07/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/07/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/07/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/07/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/07/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/07/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/07/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/07/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/07/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/07/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/07/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/07/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/08/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/08/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/08/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/08/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/08/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/08/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/08/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/08/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/08/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/08/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/08/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/08/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/08/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/08/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/08/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/08/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/08/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/08/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/08/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/08/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/08/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/08/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/08/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/08/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/09/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/09/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/09/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/09/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/09/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/09/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/09/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/09/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/09/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/09/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/09/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/09/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/09/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/09/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/09/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/09/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/09/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/09/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/09/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/09/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/09/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/09/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/09/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/09/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/10/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/10/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/10/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/10/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/10/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/10/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/10/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/10/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/10/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/10/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/10/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/10/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/10/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/10/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/10/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/10/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/10/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/10/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/10/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/10/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/10/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/10/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/10/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/10/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/11/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/11/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/11/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/11/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/11/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/11/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/11/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/11/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/11/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/11/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/11/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/11/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/11/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/11/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/11/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/11/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/11/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/11/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/11/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/11/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/11/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/11/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/11/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/11/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/12/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/12/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/12/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/12/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/12/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/12/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/12/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/12/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/12/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/12/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/12/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/12/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/12/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/12/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/12/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/12/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/12/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/12/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/12/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/12/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/12/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/12/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/12/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/12/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/13/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/13/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/13/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/13/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/13/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/13/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/13/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/13/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/13/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/13/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/13/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/13/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/13/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/13/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/13/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/13/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/13/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/13/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/13/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/13/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/13/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/13/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/13/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/13/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/14/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/14/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/14/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/14/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/14/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/14/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/14/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/14/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/14/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/14/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/14/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/14/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/14/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/14/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/14/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/14/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/14/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/14/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/14/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/14/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/14/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/14/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/14/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/14/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/15/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/15/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/15/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/15/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/15/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/15/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/15/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/15/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/15/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/15/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/15/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/15/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/15/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/15/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/15/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/15/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/15/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/15/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/15/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/15/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/15/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/15/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/15/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/15/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/16/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/16/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/16/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/16/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/16/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/16/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/16/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/16/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/16/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/16/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/16/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/16/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/16/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/16/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/16/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/16/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/16/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/16/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/16/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/16/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/16/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/16/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/16/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/16/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/17/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/17/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/17/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/17/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/17/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/17/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/17/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/17/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/17/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/17/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/17/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/17/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/17/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/17/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/17/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/17/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/17/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/17/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/17/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/17/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/17/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/17/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/17/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/17/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/18/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/18/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/18/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/18/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/18/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/18/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/18/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/18/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/18/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/18/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/18/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/18/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/18/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/18/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/18/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/18/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/18/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/18/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/18/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/18/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/18/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/18/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/18/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/18/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/19/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/19/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/19/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/19/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/19/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/19/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/19/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/19/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/19/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/19/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/19/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/19/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/19/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/19/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/19/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/19/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/19/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/19/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/19/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/19/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/19/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/19/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/19/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/19/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/20/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/20/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/20/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/20/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/20/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/20/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/20/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/20/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/20/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/20/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/20/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/20/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/20/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/20/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/20/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/20/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/20/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/20/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/20/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/20/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/20/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/20/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/20/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/20/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/21/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/21/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/21/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/21/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/21/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/21/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/21/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/21/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/21/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/21/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/21/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/21/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/21/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/21/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/21/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/21/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/21/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/21/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/21/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/21/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/21/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/21/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/21/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/21/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/22/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/22/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/22/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/22/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/22/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/22/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/22/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/22/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/22/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/22/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/22/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/22/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/22/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/22/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/22/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/22/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/22/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/22/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/22/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/22/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/22/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/22/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/22/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/22/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/23/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/23/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/23/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/23/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/23/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/23/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/23/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/23/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/23/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/23/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/23/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/23/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/23/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/23/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/23/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/23/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/23/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/23/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/23/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/23/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/23/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/23/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/23/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/23/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/24/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/24/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/24/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/24/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/24/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/24/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/24/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/24/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/24/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/24/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/24/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/24/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/24/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/24/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/24/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/24/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/24/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/24/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/24/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/24/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/24/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/24/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/24/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/24/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/25/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/25/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/25/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/25/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/25/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/25/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/25/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/25/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/25/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/25/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/25/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/25/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/25/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/25/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/25/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/25/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/25/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/25/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/25/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/25/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/25/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/25/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/25/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/25/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/26/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/26/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/26/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/26/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/26/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/26/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/26/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/26/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/26/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/26/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/26/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/26/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/26/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/26/22 13:00	0			0	X		0			0	X		0.0666			0.22		
04/26/22 14:00	0.8			1			1.3			0	X		0.17874			0.6		
04/26/22 15:00	0.9			0			1.4			0	X		0.22614			0.75		
04/26/22 16:00	0.8			0			1.4			0	X		0.28362			0.95		
04/26/22 17:00	0.8			0			1.5			0	X		0.29328			0.98		
04/26/22 18:00	0.8			0			1.6			0	X		0.27456			0.92		
04/26/22 19:00	0.8			0			1.5			0	X		0.29394			0.98		
04/26/22 20:00	0.8			0			1.5			0	X		0.30072			1		
04/26/22 21:00	0.8			1			1.4			0	X		0.29724			0.99		
04/26/22 22:00	1			1			0.4			0	X		0.1614			0.54		
04/26/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/27/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/27/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/27/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/27/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/27/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/27/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/27/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/27/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/27/22 8:00	0			0	X		0			0	X		0.08844			0.29		
04/27/22 9:00	0			0	X		0			0	X		0.28092			0.94		
04/27/22 10:00	0.7			0			1.2			0	X		0.24456			0.82		
04/27/22 11:00	0.8			0			1.5			0	X		0.29412			0.98		
04/27/22 12:00	0.8			0			1.5			0	X		0.27906			0.93		
04/27/22 13:00	0.8			0			1.5			0	X		0.29748			0.99		
04/27/22 14:00	0.8			0			1.5			0	X		0.29634			0.99		
04/27/22 15:00	0.8			0			1.5			0	X		0.28008			0.93		
04/27/22 16:00	0.8			1			1.5			0	X		0.28602			0.95		
04/27/22 17:00	0.9			0			1.5			0	X		0.22248			0.74		
04/27/22 18:00	0.9			0			1.5			0	X		0.21984			0.73		
04/27/22 19:00	0			0	X		0			0	X		0.102			0.34		
04/27/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/27/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/27/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/27/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/28/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/28/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/28/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/28/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/28/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/28/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/28/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/28/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/28/22 8:00	0			0	X		0			0	X		0.0831			0.28		
04/28/22 9:00	0.6			2			1.2			0	X		0.16962			0.57		
04/28/22 10:00	0.6			1			1.5			0	X		0.17586			0.59		
04/28/22 11:00	0.6			1			1.6			0	X		0.1746			0.58		
04/28/22 12:00	0.8			0			0.9			0	X		0.22296			0.74		
04/28/22 13:00	0.9			0			1.5			0	X		0.24426			0.81		
04/28/22 14:00	0.8			0			1.5			0	X		0.29964			1		

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/28/22 15:00	0.8			0			1.5			0	X		0.291			0.97		
04/28/22 16:00	0.6			2			1.7			0	X		0.16974			0.57		
04/28/22 17:00	0			0	X		0			0.14			0.11058			0.37		
04/28/22 18:00	0	X		0	X		0	X		0.16			0	X		0	X	
04/28/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/28/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/28/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/28/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/28/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/29/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/29/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/29/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/29/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/29/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/29/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/29/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/29/22 7:00	0	X		0	X		0	X		0.15			0	X		0	X	
04/29/22 8:00	0	X		0	X		0	X		0.31			0	X		0	X	
04/29/22 9:00	0	X		0	X		0	X		0.44			0	X		0	X	
04/29/22 10:00	0	X		0	X		0	X		0.56			0	X		0	X	
04/29/22 11:00	0	X		0	X		0	X		0.56			0	X		0	X	
04/29/22 12:00	0	X		0	X		0	X		0.43			0	X		0	X	
04/29/22 13:00	0	X		0	X		0	X		0.56			0	X		0	X	
04/29/22 14:00	0	X		0	X		0	X		0.56			0	X		0	X	
04/29/22 15:00	0	X		0	X		0	X		0.55			0	X		0	X	
04/29/22 16:00	0	X		0	X		0	X		0.45			0	X		0	X	
04/29/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/29/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/29/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/29/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/29/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/29/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/29/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/30/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/30/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/30/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/30/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
04/30/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/30/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/30/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/30/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/30/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/30/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/30/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/30/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/30/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/30/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/30/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/30/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/30/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/30/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/30/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/30/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/30/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/30/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/30/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
04/30/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/01/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/01/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/01/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/01/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/01/22 4:00	0	X		0	X		0	X		0.25			0	X		0	X	
05/01/22 5:00	0	X		0	X		0	X		0.45			0	X		0	X	
05/01/22 6:00	0	X		0	X		0	X		0.4			0	X		0	X	
05/01/22 7:00	0	X		0	X		0	X		0.36			0	X		0	X	
05/01/22 8:00	0	X		0	X		0	X		0.34			0	X		0	X	
05/01/22 9:00	0	X		0	X		0	X		0.33			0	X		0	X	
05/01/22 10:00	0	X		0	X		0	X		0.33			0	X		0	X	
05/01/22 11:00	0	X		0	X		0	X		0.33			0	X		0	X	
05/01/22 12:00	0	X		0	X		0	X		0.33			0	X		0	X	
05/01/22 13:00	0	X		0	X		0	X		0.33			0	X		0	X	
05/01/22 14:00	0	X		0	X		0	X		0.33			0	X		0	X	
05/01/22 15:00	0	X		0	X		0	X		0.33			0	X		0	X	
05/01/22 16:00	0	X		0	X		0	X		0.33			0	X		0	X	

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/01/22 17:00	0	X		0	X		0	X		0.33			0	X		0	X	
05/01/22 18:00	0	X		0	X		0	X		0.33			0	X		0	X	
05/01/22 19:00	0	X		0	X		0	X		0.33			0	X		0	X	
05/01/22 20:00	0	X		0	X		0	X		0.33			0	X		0	X	
05/01/22 21:00	0	X		0	X		0	X		0.33			0	X		0	X	
05/01/22 22:00	0	X		0	X		0	X		0.33			0	X		0	X	
05/01/22 23:00	0	X		0	X		0	X		0.33			0	X		0	X	
05/02/22 0:00	0	X		0	X		0	X		0.33			0	X		0	X	
05/02/22 1:00	0	X		0	X		0	X		0.33			0	X		0	X	
05/02/22 2:00	0	X		0	X		0	X		0.33			0	X		0	X	
05/02/22 3:00	0	X		0	X		0	X		0.33			0	X		0	X	
05/02/22 4:00	0	X		0	X		0	X		0.33			0	X		0	X	
05/02/22 5:00	0	X		0	X		0	X		0.32			0	X		0	X	
05/02/22 6:00	0	X		0	X		0	X		0.32			0	X		0	X	
05/02/22 7:00	0	X		0	X		0	X		0.33			0	X		0	X	
05/02/22 8:00	0	X		0	X		0	X		0.35			0	X		0	X	
05/02/22 9:00	0	X		0	X		0	X		0.36			0	X		0	X	
05/02/22 10:00	0	X		0	X		0	X		0.36			0	X		0	X	
05/02/22 11:00	0	X		0	X		0	X		0.36			0	X		0	X	
05/02/22 12:00	0	X		0	X		0	X		0.36			0	X		0	X	
05/02/22 13:00	0	X		0	X		0	X		0.36			0	X		0	X	
05/02/22 14:00	0	X		0	X		0	X		0.36			0	X		0	X	
05/02/22 15:00	0	X		0	X		0	X		0.36			0	X		0	X	
05/02/22 16:00	0	X		0	X		0	X		0.36			0	X		0	X	
05/02/22 17:00	0	X		0	X		0	X		0.43			0	X		0	X	
05/02/22 18:00	0	X		0	X		0	X		0.42			0	X		0	X	
05/02/22 19:00	0	X		0	X		0	X		0.46			0	X		0	X	
05/02/22 20:00	0	X		0	X		0	X		0.46			0	X		0	X	
05/02/22 21:00	0	X		0	X		0	X		0.55			0	X		0	X	
05/02/22 22:00	0	X		0	X		0	X		0.55			0	X		0	X	
05/02/22 23:00	0	X		0	X		0	X		0.56			0	X		0	X	
05/03/22 0:00	0	X		0	X		0	X		0.56			0	X		0	X	
05/03/22 1:00	0	X		0	X		0	X		0.33			0	X		0	X	
05/03/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/03/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/03/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/03/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/03/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/03/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/03/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/03/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/03/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/03/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/03/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/03/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/03/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/03/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/03/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/03/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/03/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/03/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/03/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/03/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/03/22 22:00	0	X		0	X		0	X		0.25			0	X		0	X	
05/03/22 23:00	0			0	X		0			0.52			0.08856			0.3		
05/04/22 0:00	0.8			1			1.5			0.41			0.2163			0.72		
05/04/22 1:00	0.7			1			1.5			0.36			0.18996			0.63		
05/04/22 2:00	0.9			0			1.1			0.49			0.26574			0.89		
05/04/22 3:00	0.9			0			1.5			0.53			0.28542			0.95		
05/04/22 4:00	0.8			0			1.5			0.54			0.2931			0.98		
05/04/22 5:00	0.8			1			1.6			0.47			0.25404			0.85		
05/04/22 6:00	1			0			1.4			0.46			0.24738			0.82		
05/04/22 7:00	1.2			1			1.5			0.59			0.31152			1.04		
05/04/22 8:00	1			2			1.2			0.4			0.2142			0.71		
05/04/22 9:00	0.7			1			1.1			0.34			0.18114			0.6		
05/04/22 10:00	0.6			1			1.3			0.33			0.17718			0.59		
05/04/22 11:00	0.7			1			1.3			0.34			0.18			0.6		
05/04/22 12:00	0.7			0			1.6			0.35			0.18306			0.61		
05/04/22 13:00	0.7			0			1.5			0.35			0.18348			0.61		
05/04/22 14:00	0.7			1			1.5			0.34			0.18018			0.6		
05/04/22 15:00	0.6			1			1.5			0.33			0.1755			0.59		
05/04/22 16:00	0.6			1			1.5			0.33			0.1755			0.59		
05/04/22 17:00	0.7			1			1.6			0.38			0.19908			0.66		
05/04/22 18:00	0.6			3			1.4			0.66			0.34758			1.16		

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/04/22 19:00	0.9			2			1.5			0.61			0.33246			1.11		
05/04/22 20:00	1			3			1.5			0.6			0.3297			1.1		
05/04/22 21:00	0.7			3			1.5			0.65			0.35382			1.18		
05/04/22 22:00	1.2			2			1.5			0.6			0.32502			1.08		
05/04/22 23:00	1.1			1			1.2			0.47			0.25602			0.85		
05/05/22 0:00	0.8			0			1.4			0.43			0.23232			0.77		
05/05/22 1:00	0.7			1			1.4			0.36			0.1908			0.64		
05/05/22 2:00	0.7			1			1.5			0.35			0.18582			0.62		
05/05/22 3:00	0.7			1			1.5			0.35			0.18588			0.62		
05/05/22 4:00	0.7			0			1.3			0.42			0.22722			0.76		
05/05/22 5:00	0.8			1			1.5			0.4			0.2136			0.71		
05/05/22 6:00	0.6			1			1.4			0.34			0.18126			0.6		
05/05/22 7:00	0.6			1			1.5			0.33			0.1776			0.59		
05/05/22 8:00	0.6			1			1.5			0.34			0.17856			0.6		
05/05/22 9:00	0.7			1			1.5			0.35			0.18612			0.62		
05/05/22 10:00	0.7			1			1.3			0.35			0.18372			0.61		
05/05/22 11:00	0.7			1			1.4			0.34			0.18054			0.6		
05/05/22 12:00	0.8			0			1.3			0.46			0.24468			0.82		
05/05/22 13:00	0.8			0			1.6			0.49			0.26448			0.88		
05/05/22 14:00	0.7			1			1.3			0.37			0.19542			0.65		
05/05/22 15:00	0.7			1			1.5			0.36			0.19104			0.64		
05/05/22 16:00	0.6			1			1.5			0.34			0.17898			0.6		
05/05/22 17:00	0.7			0			1.4			0.41			0.21768			0.73		
05/05/22 18:00	1.8			0			1.5			0.58			0.3078			1.03		
05/05/22 19:00	1.7			1			1.5			0.57			0.3075			1.03		
05/05/22 20:00	1.7			1			1.5			0.57			0.30702			1.02		
05/05/22 21:00	1.3			1			1.6			0.51			0.27372			0.91		
05/05/22 22:00	0.8			1			1.3			0.38			0.20394			0.68		
05/05/22 23:00	0.7			1			1.5			0.34			0.18396			0.61		
05/06/22 0:00	0.7			1			1.5			0.35			0.1848			0.62		
05/06/22 1:00	0.6			1			1.5			0.34			0.18222			0.61		
05/06/22 2:00	0.7			1			1.6			0.35			0.18588			0.62		
05/06/22 3:00	0.8			1			1.4			0.36			0.195			0.65		
05/06/22 4:00	1.6			0			1.5			0.56			0.30258			1.01		
05/06/22 5:00	1.8			1			1.5			0.57			0.30582			1.02		
05/06/22 6:00	1.7			1			1.5			0.57			0.30606			1.02		
05/06/22 7:00	0.9			0			1.3			0.42			0.2244			0.75		

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/06/22 8:00	1.6			0			1.2			0.57			0.30228			1.01		
05/06/22 9:00	1.5			0			1.5			0.57			0.30174			1.01		
05/06/22 10:00	1.3			0			1.5			0.55			0.29562			0.99		
05/06/22 11:00	1.6			0			1.5			0.58			0.30864			1.03		
05/06/22 12:00	0.8			0			1.5			0.52			0.27696			0.92		
05/06/22 13:00	1.4			0			1.5			0.58			0.30924			1.03		
05/06/22 14:00	1			1			1.7			0.45			0.23718			0.79		
05/06/22 15:00	0.6			1			1.4			0.33			0.17526			0.58		
05/06/22 16:00	1.1			0			1.4			0.56			0.30006			1		
05/06/22 17:00	1.1			0			1.5			0.59			0.31014			1.03		
05/06/22 18:00	1.3			1			1.5			0.58			0.30762			1.03		
05/06/22 19:00	1.2			1			1.5			0.58			0.30678			1.02		
05/06/22 20:00	1.3			1			1.5			0.57			0.30708			1.02		
05/06/22 21:00	1.3			1			1.5			0.57			0.30654			1.02		
05/06/22 22:00	1.1			0			1.5			0.49			0.2736			0.91		
05/06/22 23:00	0	X		0	X		0	X		0.56			0	X		0	X	
05/07/22 0:00	0	X		0	X		0	X		0.56			0	X		0	X	
05/07/22 1:00	0	X		0	X		0	X		0.57			0	X		0	X	
05/07/22 2:00	0	X		0	X		0	X		0.59			0	X		0	X	
05/07/22 3:00	0	X		0	X		0	X		0.59			0	X		0	X	
05/07/22 4:00	0	X		0	X		0	X		0.59			0	X		0	X	
05/07/22 5:00	0	X		0	X		0	X		0.59			0	X		0	X	
05/07/22 6:00	0	X		0	X		0	X		0.59			0	X		0	X	
05/07/22 7:00	0	X		0	X		0	X		0.59			0	X		0	X	
05/07/22 8:00	0	X		0	X		0	X		0.59			0	X		0	X	
05/07/22 9:00	0	X		0	X		0	X		0.59			0	X		0	X	
05/07/22 10:00	0	X		0	X		0	X		0.59			0	X		0	X	
05/07/22 11:00	0	X		0	X		0	X		0.59			0	X		0	X	
05/07/22 12:00	0			0	X		0			0.56			0.11112			0.37		
05/07/22 13:00	0.6			1			1.3			0.35			0.1887			0.63		
05/07/22 14:00	0.6			1			1.5			0.33			0.17562			0.59		
05/07/22 15:00	0.6			1			1.5			0.33			0.17478			0.58		
05/07/22 16:00	0.6			1			1.5			0.33			0.17502			0.58		
05/07/22 17:00	0.6			1			1.4			0.35			0.18378			0.61		
05/07/22 18:00	1.2			2			1.6			0.56			0.3087			1.03		
05/07/22 19:00	1.3			2			1.5			0.57			0.31158			1.04		
05/07/22 20:00	1.2			2			1.5			0.56			0.3021			1.01		

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/07/22 21:00	0.7			1			1.3			0.35			0.18564			0.62		
05/07/22 22:00	0.6			1			1.3			0.33			0.17694			0.59		
05/07/22 23:00	0.6			2			1.3			0.33			0.17748			0.59		
05/08/22 0:00	0.6			2			1.3			0.33			0.1776			0.59		
05/08/22 1:00	0.6			2			1.3			0.33			0.17796			0.59		
05/08/22 2:00	0.6			2			1.3			0.33			0.17802			0.59		
05/08/22 3:00	0.6			2			1.3			0.33			0.17832			0.59		
05/08/22 4:00	0.6			2			1.3			0.34			0.18246			0.61		
05/08/22 5:00	0.6			2			1.5			0.33			0.1794			0.6		
05/08/22 6:00	0.7			1			1.3			0.23			0.19998			0.67		
05/08/22 7:00	0.7			1			1.5			0	X		0.1911			0.64		
05/08/22 8:00	0.7			1			1.5			0	X		0.19134			0.64		
05/08/22 9:00	0.7			1			1.5			0	X		0.19134			0.64		
05/08/22 10:00	0.7			1			1.5			0	X		0.19122			0.64		
05/08/22 11:00	0.7			1			1.5			0	X		0.19116			0.64		
05/08/22 12:00	0.7			1			1.5			0	X		0.19074			0.64		
05/08/22 13:00	0.7			1			1.5			0	X		0.18894			0.63		
05/08/22 14:00	0.7			1			1.5			0	X		0.18822			0.63		
05/08/22 15:00	0.7			1			1.5			0	X		0.19026			0.63		
05/08/22 16:00	0.9			1			1.3			0	X		0.22668			0.76		
05/08/22 17:00	0.9			0			1.6			0.32			0.2526			0.84		
05/08/22 18:00	0.6			2			1.3			0.38			0.20478			0.68		
05/08/22 19:00	2.1			0			1.5			0.58			0.30846			1.03		
05/08/22 20:00	1.8			1			1.5			0.58			0.30576			1.02		
05/08/22 21:00	1.6			1			1.5			0.57			0.30342			1.01		
05/08/22 22:00	0.7			2			1.6			0.36			0.19236			0.64		
05/08/22 23:00	0.6			2			1.5			0.33			0.1785			0.6		
05/09/22 0:00	0.6			2			1.5			0.33			0.17904			0.6		
05/09/22 1:00	0.6			2			1.5			0.33			0.17898			0.6		
05/09/22 2:00	0.6			2			1.5			0.33			0.17934			0.6		
05/09/22 3:00	0.6			2			1.5			0.33			0.17922			0.6		
05/09/22 4:00	0.6			2			1.5			0.33			0.18			0.6		
05/09/22 5:00	0.6			2			1.5			0.34			0.18246			0.61		
05/09/22 6:00	0.6			2			1.5			0.33			0.17838			0.59		
05/09/22 7:00	0.5			1			1.5			0.33			0.17802			0.59		
05/09/22 8:00	0.6			2			1.5			0.33			0.1779			0.59		
05/09/22 9:00	0.6			2			1.5			0.33			0.17772			0.59		

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/09/22 10:00	0.6			2			1.5			0.33			0.17826			0.59		
05/09/22 11:00	0.7			0			1.3			0.18			0.20484			0.68		
05/09/22 12:00	0.7			1			1.5			0	X		0.1902			0.63		
05/09/22 13:00	0.7			1			1.5			0	X		0.18834			0.63		
05/09/22 14:00	0.7			1			1.5			0	X		0.1896			0.63		
05/09/22 15:00	0.7			1			1.5			0	X		0.19146			0.64		
05/09/22 16:00	0.7			1			1.5			0	X		0.19032			0.63		
05/09/22 17:00	0.7			1			1.5			0	X		0.1899			0.63		
05/09/22 18:00	0.7			1			1.5			0	X		0.19188			0.64		
05/09/22 19:00	0.7			1			1.5			0	X		0.19302			0.64		
05/09/22 20:00	0.7			1			1.5			0	X		0.1926			0.64		
05/09/22 21:00	0.7			1			1.5			0	X		0.19242			0.64		
05/09/22 22:00	0.7			1			1.5			0	X		0.19218			0.64		
05/09/22 23:00	0			0	X		0			0	X		0.10512			0.35		
05/10/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/10/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/10/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/10/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/10/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/10/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/10/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/10/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/10/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/10/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/10/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/10/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/10/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/10/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/10/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/10/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/10/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/10/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/10/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/10/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/10/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/10/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/10/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/10/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/11/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/11/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/11/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/11/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/11/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/11/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/11/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/11/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/11/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/11/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/11/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/11/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/11/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/11/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/11/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/11/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/11/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/11/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/11/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/11/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/11/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/11/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/11/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/11/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/12/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/12/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/12/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/12/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/12/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/12/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/12/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/12/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/12/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/12/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/12/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/12/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/12/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/12/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/12/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/12/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/12/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/12/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/12/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/12/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/12/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/12/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/12/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/12/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/13/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/13/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/13/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/13/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/13/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/13/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/13/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/13/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/13/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/13/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/13/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/13/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/13/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/13/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/13/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/13/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/13/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/13/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/13/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/13/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/13/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/13/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/13/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/13/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/14/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/14/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/14/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/14/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/14/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/14/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/14/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/14/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/14/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/14/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/14/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/14/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/14/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/14/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/14/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/14/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/14/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/14/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/14/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/14/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/14/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/14/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/14/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/14/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/15/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/15/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/15/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/15/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/15/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/15/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/15/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/15/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/15/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/15/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/15/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/15/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/15/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/15/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/15/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/15/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/15/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/15/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/15/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/15/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/15/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/15/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/15/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/15/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/16/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/16/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/16/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/16/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/16/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/16/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/16/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/16/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/16/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/16/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/16/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/16/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/16/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/16/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/16/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/16/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/16/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/16/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/16/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/16/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/16/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/16/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/16/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/16/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/17/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/17/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/17/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/17/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/17/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/17/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/17/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/17/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/17/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/17/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/17/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/17/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/17/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/17/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/17/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/17/22 15:00	0	X		0	X		0	X		0.34			0	X		0	X	
05/17/22 16:00	0	X		0	X		0	X		0.52			0	X		0	X	
05/17/22 17:00	0			0	X		0			0.53			0.16794			0.56		
05/17/22 18:00	0.8			0			1.5			0.54			0.28452			0.95		
05/17/22 19:00	1.2			0			1.5			0.57			0.3066			1.02		
05/17/22 20:00	1.1			1			1.5			0.62			0.3285			1.1		
05/17/22 21:00	0.9			1			1.5			0.64			0.33708			1.12		
05/17/22 22:00	1			1			1.6			0.53			0.28254			0.94		
05/17/22 23:00	0.6			2			1.5			0.33			0.17466			0.58		
05/18/22 0:00	0.6			2			1.5			0.33			0.17538			0.58		
05/18/22 1:00	0.6			2			1.5			0.32			0.17418			0.58		
05/18/22 2:00	0.7			0			1.2			0.44			0.23532			0.78		
05/18/22 3:00	1.1			1			1.5			0.71			0.37494			1.25		
05/18/22 4:00	0.3			2			1.5			0.81			0.42444			1.41		
05/18/22 5:00	0.9			1			1.5			0.6			0.31932			1.06		
05/18/22 6:00	0.8			1			1.6			0.46			0.24372			0.81		
05/18/22 7:00	0.8			0			1.1			0.52			0.27978			0.93		
05/18/22 8:00	0.8			0			1.5			0.56			0.29898			1		
05/18/22 9:00	0.7			0			1.5			0.56			0.29736			0.99		
05/18/22 10:00	1			0			1.5			0.56			0.29718			0.99		
05/18/22 11:00	0.5			1			1.5			0.71			0.36768			1.23		
05/18/22 12:00	1.3			0			1.5			0.56			0.29538			0.98		
05/18/22 13:00	1			1			1.5			0.66			0.34104			1.14		
05/18/22 14:00	0.3			2			1.5			0.76			0.39366			1.31		
05/18/22 15:00	0.5			1			1.5			0.68			0.35424			1.18		

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/18/22 16:00	0.8			1			1.5			0.62			0.32274			1.08		
05/18/22 17:00	0.4			2			1.5			0.74			0.38244			1.27		
05/18/22 18:00	0.4			1			1.5			0.69			0.36288			1.21		
05/18/22 19:00	0.6			1			1.5			0.67			0.35196			1.17		
05/18/22 20:00	0.4			1			1.5			0.73			0.3807			1.27		
05/18/22 21:00	1			1			1.5			0.61			0.32082			1.07		
05/18/22 22:00	1			1			1.5			0.6			0.3192			1.06		
05/18/22 23:00	1.1			1			1.6			0.49			0.26166			0.87		
05/19/22 0:00	0.8			0			1.3			0.31			0.22446			0.75		
05/19/22 1:00	0.7			1			1.6			0	X		0.21234			0.71		
05/19/22 2:00	0.7			1			1.5			0	X		0.19044			0.63		
05/19/22 3:00	1.6			0			1.4			0	X		0.26478			0.88		
05/19/22 4:00	1.8			0			1.5			0	X		0.30402			1.01		
05/19/22 5:00	1.5			1			1.5			0	X		0.30834			1.03		
05/19/22 6:00	0.8			1			1.4			0	X		0.22284			0.74		
05/19/22 7:00	0.8			0			1.4			0	X		0.2163			0.72		
05/19/22 8:00	0.7			1			1.3			0	X		0.21834			0.73		
05/19/22 9:00	0.7			0			1.5			0	X		0.19008			0.63		
05/19/22 10:00	0.7			1			1.5			0	X		0.18852			0.63		
05/19/22 11:00	1.6			0			1.4			0	X		0.29208			0.97		
05/19/22 12:00	0	X		0	X		0	X		0.3			0.26172			0.87		
05/19/22 13:00	0.8			1			1.3			0.47			0.24774			0.83		
05/19/22 14:00	1			1			1.3			0.63			0.3279			1.09		
05/19/22 15:00	0.9			1			1.3			0.49			0.25752			0.86		
05/19/22 16:00	0.8			0			1.3			0.47			0.24588			0.82		
05/19/22 17:00	1.1			1			1.3			0.6			0.31512			1.05		
05/19/22 18:00	1.1			1			1.3			0.62			0.32496			1.08		
05/19/22 19:00	0.9			1			1.5			0.63			0.3354			1.12		
05/19/22 20:00	0.6			1			1.5			0.69			0.36222			1.21		
05/19/22 21:00	1			1			1.5			0.61			0.32448			1.08		
05/19/22 22:00	0.9			1			1.4			0.48			0.26448			0.88		
05/19/22 23:00	0			0	X		0			0	X		0.1467			0.49		
05/20/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/20/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/20/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/20/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/20/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/20/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/20/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/20/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/20/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/20/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/20/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/20/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/20/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/20/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/20/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/20/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/20/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/20/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/20/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/20/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/20/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/20/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/20/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/20/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/21/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/21/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/21/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/21/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/21/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/21/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/21/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/21/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/21/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/21/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/21/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/21/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/21/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/21/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/21/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/21/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/21/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/21/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/21/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/21/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/21/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/21/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/21/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/21/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/22/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/22/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/22/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/22/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/22/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/22/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/22/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/22/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/22/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/22/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/22/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/22/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/22/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/22/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/22/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/22/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/22/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/22/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/22/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/22/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/22/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/22/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/22/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/22/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/23/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/23/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/23/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/23/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/23/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/23/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/23/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/23/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/23/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/23/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/23/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/23/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/23/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/23/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/23/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/23/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/23/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/23/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/23/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/23/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/23/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/23/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/23/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/23/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/24/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/24/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/24/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/24/22 3:00	0			0	X		0			0	X		0.1194			0.4		
05/24/22 4:00	0.8			1			1.4			0	X		0.1872			0.62		
05/24/22 5:00	0.8			0			1.5			0	X		0.19614			0.65		
05/24/22 6:00	0.8			0			1.5			0	X		0.19338			0.64		
05/24/22 7:00	1.4			0			1.5			0	X		0.25482			0.85		
05/24/22 8:00	1.3			0			1.5			0.33			0.24918			0.83		
05/24/22 9:00	0.8			1			1.5			0.35			0.18426			0.61		
05/24/22 10:00	0.9			0			1.4			0.44			0.23172			0.77		
05/24/22 11:00	0.9			0			1.5			0.47			0.25062			0.84		
05/24/22 12:00	1.1			0			1.5			0.54			0.2877			0.96		
05/24/22 13:00	1			1			1.5			0.64			0.33384			1.11		
05/24/22 14:00	0.4			2			1.5			0.74			0.38142			1.27		
05/24/22 15:00	0.3			2			1.5			0.79			0.40602			1.35		
05/24/22 16:00	0.4			2			1.5			0.74			0.3837			1.28		
05/24/22 17:00	0.5			1			1.5			0.69			0.35886			1.2		
05/24/22 18:00	0.3			2			1.5			0.78			0.4056			1.35		
05/24/22 19:00	0.3			2			1.5			0.75			0.39144			1.3		

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/24/22 20:00	0.7			1			1.5			0.66			0.34506			1.15		
05/24/22 21:00	0.9			1			1.5			0.64			0.33612			1.12		
05/24/22 22:00	0.6			1			1.5			0.69			0.3615			1.21		
05/24/22 23:00	1.3			1			1.6			0.47			0.2514			0.84		
05/25/22 0:00	0.9			0			1.3			0.47			0.25056			0.84		
05/25/22 1:00	0.8			1			1.5			0.38			0.20226			0.67		
05/25/22 2:00	0.8			1			1.6			0.35			0.18534			0.62		
05/25/22 3:00	0	X		0			1.4			0.46			0.24852			0.83		
05/25/22 4:00	0	X		0			1.5			0.58			0.31116			1.04		
05/25/22 5:00	0	X		0			1.5			0.54			0.29046			0.97		
05/25/22 6:00	0	X		0			1.5			0.58			0.31032			1.03		
05/25/22 7:00	0	X		1			1.6			0.46			0.24384			0.81		
05/25/22 8:00	0	X		1			1.5			0.33			0.17562			0.59		
05/25/22 9:00	0	X		0			1.3			0.44			0.23364			0.78		
05/25/22 10:00	0	X		0			1.5			0.55			0.2892			0.96		
05/25/22 11:00	0	X		2			1.5			0.76			0.39408			1.31		
05/25/22 12:00	0	X		2			1.5			0.8			0.41082			1.37		
05/25/22 13:00	0	X		2			1.5			0.8			0.4095			1.37		
05/25/22 14:00	0	X		2			1.5			0.8			0.40908			1.36		
05/25/22 15:00	0	X		2			1.5			0.79			0.40806			1.36		
05/25/22 16:00	0	X		2			1.5			0.79			0.4077			1.36		
05/25/22 17:00	0	X		2			1.5			0.78			0.40302			1.34		
05/25/22 18:00	0	X		2			1.5			0.79			0.40554			1.35		
05/25/22 19:00	0	X		1			1.5			0.67			0.35142			1.17		
05/25/22 20:00	0	X		1			1.5			0.61			0.31908			1.06		
05/25/22 21:00	0	X		1			1.5			0.62			0.3264			1.09		
05/25/22 22:00	0	X		1			1.6			0.45			0.24486			0.82		
05/25/22 23:00	0	X		1			0.9			0.09			0.16128			0.54		
05/26/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/26/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/26/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/26/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/26/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/26/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/26/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/26/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/26/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/26/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/26/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/26/22 11:00	0	X		0	X		0	X		0.24			0	X		0	X	
05/26/22 12:00	0	X		0	X		0	X		0.36			0	X		0	X	
05/26/22 13:00	0	X		0	X		0	X		0.34			0	X		0	X	
05/26/22 14:00	0	X		0	X		0			0.46			0.03636			0.12		
05/26/22 15:00	0	X		0	X		0	X		0.57			0	X		0	X	
05/26/22 16:00	0	X		0	X		0	X		0.57			0	X		0	X	
05/26/22 17:00	0	X		0	X		0	X		0.57			0	X		0	X	
05/26/22 18:00	0	X		0	X		0	X		0.57			0	X		0	X	
05/26/22 19:00	0	X		0	X		0	X		0.57			0	X		0	X	
05/26/22 20:00	0	X		0	X		0	X		0.44			0	X		0	X	
05/26/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/26/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/26/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/27/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/27/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/27/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/27/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/27/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/27/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/27/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/27/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/27/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/27/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/27/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/27/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/27/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/27/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/27/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/27/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/27/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/27/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/27/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/27/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/27/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/27/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/27/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/27/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/28/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/28/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/28/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/28/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/28/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/28/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/28/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/28/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/28/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/28/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/28/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/28/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/28/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/28/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/28/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/28/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/28/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/28/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/28/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/28/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/28/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/28/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/28/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/28/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/29/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/29/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/29/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/29/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/29/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/29/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/29/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/29/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/29/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/29/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/29/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/29/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/29/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/29/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/29/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/29/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/29/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/29/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/29/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/29/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/29/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/29/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/29/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/29/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/30/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/30/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/30/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/30/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/30/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/30/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/30/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/30/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/30/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/30/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/30/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/30/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/30/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/30/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/30/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/30/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/30/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/30/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/30/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/30/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/30/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/30/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/30/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/30/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
05/31/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/31/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/31/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/31/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/31/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/31/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/31/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/31/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/31/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/31/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/31/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/31/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/31/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/31/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/31/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/31/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/31/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/31/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/31/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/31/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/31/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/31/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/31/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
05/31/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/01/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/01/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/01/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/01/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/01/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/01/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/01/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/01/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/01/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/01/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/01/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/01/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/01/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/01/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/01/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/01/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/01/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/01/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/01/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/01/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/01/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/01/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/01/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/01/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/02/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/02/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/02/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/02/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/02/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/02/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/02/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/02/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/02/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/02/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/02/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/02/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/02/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/02/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/02/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/02/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/02/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/02/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/02/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/02/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/02/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/02/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/02/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/02/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/03/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/03/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/03/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/03/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/03/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/03/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/03/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/03/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/03/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/03/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/03/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/03/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/03/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/03/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/03/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/03/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/03/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/03/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/03/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/03/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/03/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/03/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/03/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/03/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/04/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/04/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/04/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/04/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/04/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/04/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/04/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/04/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/04/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/04/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/04/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/04/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/04/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/04/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/04/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/04/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/04/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/04/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/04/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/04/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/04/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/04/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/04/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/04/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/05/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/05/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/05/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/05/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/05/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/05/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/05/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/05/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/05/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/05/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/05/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/05/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/05/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/05/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/05/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/05/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/05/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/05/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/05/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/05/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/05/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/05/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/05/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/05/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/06/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/06/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/06/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/06/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/06/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/06/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/06/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/06/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/06/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/06/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/06/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/06/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/06/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/06/22 13:00	0	X		0	X		0	X		0.24			0	X		0	X	
06/06/22 14:00	0	X		0	X		0	X		0.53			0	X		0	X	
06/06/22 15:00	0	X		0	X		0	X		0.56			0	X		0	X	
06/06/22 16:00	0	X		0	X		0	X		0.56			0	X		0	X	
06/06/22 17:00	0	X		0	X		0	X		0.56			0	X		0	X	
06/06/22 18:00	0	X		0	X		0	X		0.34			0	X		0	X	
06/06/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/06/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/06/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/06/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/06/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/07/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/07/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/07/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/07/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/07/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/07/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/07/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/07/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/07/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/07/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/07/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/07/22 11:00	0	X		0	X		0	X		0	X		0.12798			0.43		
06/07/22 12:00	0	X		0	X		0	X		0	X		0.19074			0.64		
06/07/22 13:00	0	X		1			0.9	X		0	X		0.19974			0.67		
06/07/22 14:00	0	X		0	X		0	X		0	X		0.23412			0.78		
06/07/22 15:00	0	X		0	X		0	X		0	X		0.24528			0.82		
06/07/22 16:00	0	X		0	X		0	X		0	X		0.24552			0.82		

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/07/22 17:00	0	X		0	X		0	X		0	X		0.24594			0.82		
06/07/22 18:00	0	X		0	X		0	X		0	X		0.24612			0.82		
06/07/22 19:00	0	X		0	X		0	X		0	X		0.24084			0.8		
06/07/22 20:00	0			0	X		0			0	X		0.12456			0.42		
06/07/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/07/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/07/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/08/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/08/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/08/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
06/08/22 3:00	0	X		0	X		0	X		0.2			0	X		0	X	
06/08/22 4:00	0	X		0	X		0	X		0.56			0	X		0	X	
06/08/22 5:00	0	X		0	X		0	X		0.57			0	X		0	X	
06/08/22 6:00	0	X		0	X		0	X		0.57			0	X		0	X	
06/08/22 7:00	0	X		0	X		0	X		0.44			0	X		0	X	
06/08/22 8:00	0	X		0	X		0	X		0.43			0	X		0	X	
06/08/22 9:00	0	X		0	X		0	X		0.37			0	X		0	X	
06/08/22 10:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/08/22 11:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/08/22 12:00	0	X		0	X		0	X		0.38			0	X		0	X	
06/08/22 13:00	0	X		0	X		0	X		0.56			0	X		0	X	
06/08/22 14:00	0.7			0			1.4			0.56			0.2043			0.68		
06/08/22 15:00	0.7			0			1.4			0.53			0.2811			0.94		
06/08/22 16:00	1.2			0			1.5			0.54			0.28548			0.95		
06/08/22 17:00	1			1			1.5			0.67			0.3483			1.16		
06/08/22 18:00	0.3			2			1.5			0.8			0.41328			1.38		
06/08/22 19:00	0.4			1			1.5			0.73			0.38124			1.27		
06/08/22 20:00	0.7			1			1.5			0.64			0.33984			1.13		
06/08/22 21:00	1			0			1.5			0.6			0.32082			1.07		
06/08/22 22:00	1.1			0			1.5			0.6			0.31734			1.06		
06/08/22 23:00	1			0			1.5			0.61			0.32646			1.09		
06/09/22 0:00	1			1			1.5			0.61			0.3258			1.09		
06/09/22 1:00	1.2			0			1.5			0.6			0.32172			1.07		
06/09/22 2:00	1.1			1			1.5			0.49			0.2469			0.82		
06/09/22 3:00	0	X		0	X		0	X		0.58			0	X		0	X	
06/09/22 4:00	0	X		0	X		0	X		0.57			0	X		0	X	
06/09/22 5:00	0	X		0	X		0	X		0.41			0	X		0	X	

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/09/22 6:00	0	X		0	X		0	X		0.39			0	X		0	X	
06/09/22 7:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/09/22 8:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/09/22 9:00	0	X		0	X		0	X		0.38			0	X		0	X	
06/09/22 10:00	0			0	X		0			0.54			0.12018			0.4		
06/09/22 11:00	0.6			0			1			0.36			0.19116			0.64		
06/09/22 12:00	0.6			0			1.5			0.34			0.17988			0.6		
06/09/22 13:00	0.7			0			1.3			0.46			0.24444			0.81		
06/09/22 14:00	0.8			0			1.5			0.56			0.29178			0.97		
06/09/22 15:00	0.7			1			1.5			0.65			0.33774			1.13		
06/09/22 16:00	0.8			0			1.5			0.5			0.26214			0.87		
06/09/22 17:00	0.6			1			1.5			0.63			0.32922			1.1		
06/09/22 18:00	0.6			1			1.5			0.65			0.34032			1.13		
06/09/22 19:00	0.9			0			1.5			0.61			0.32094			1.07		
06/09/22 20:00	0.6			1			1.5			0.67			0.35142			1.17		
06/09/22 21:00	0.7			1			1.5			0.64			0.33492			1.12		
06/09/22 22:00	1			0			1.5			0.55			0.294			0.98		
06/09/22 23:00	1			1			1.5			0.62			0.32862			1.1		
06/10/22 0:00	1.2			0			1.5			0.6			0.3177			1.06		
06/10/22 1:00	1.1			0			1.5			0.6			0.3171			1.06		
06/10/22 2:00	1.1			0			1.5			0.6			0.31662			1.06		
06/10/22 3:00	1.1			0			1.5			0.59			0.31614			1.05		
06/10/22 4:00	1.3			0			1.5			0.59			0.3159			1.05		
06/10/22 5:00	1			1			1.5			0.63			0.33168			1.11		
06/10/22 6:00	1.3			0			1.5			0.56			0.30186			1.01		
06/10/22 7:00	0.8			0			1.5			0.56			0.2943			0.98		
06/10/22 8:00	0.7			0			1.5			0.55			0.29286			0.98		
06/10/22 9:00	0.7			0			1.5			0.55			0.2916			0.97		
06/10/22 10:00	1.5			0			1.5			0.56			0.29478			0.98		
06/10/22 11:00	1			1			1.5			0.62			0.3225			1.08		
06/10/22 12:00	0.6			1			1.4			0.66			0.342			1.14		
06/10/22 13:00	0.3			1			1.5			0.71			0.36786			1.23		
06/10/22 14:00	0.2			2			1.5			0.76			0.39504			1.32		
06/10/22 15:00	0.2			2			1.5			0.75			0.38898			1.3		
06/10/22 16:00	0.8			0			1.5			0.66			0.30012			1		
06/10/22 17:00	0.2			2			1.5			0.77			0.39822			1.33		
06/10/22 18:00	0.2			2			1.5			0.77			0.39678			1.32		

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/10/22 19:00	0.3			1			1.5			0.72			0.37662			1.26		
06/10/22 20:00	0.5			1			1.5			0.67			0.34998			1.17		
06/10/22 21:00	0.5			1			1.5			0.68			0.3558			1.19		
06/10/22 22:00	1			0			1.5			0.57			0.29862			1		
06/10/22 23:00	0			0	X		0			0.43			0.14862			0.5		
06/11/22 0:00	0			0	X		0			0.55			0.09264			0.31		
06/11/22 1:00	0.5			1			1.4			0.36			0.18354			0.61		
06/11/22 2:00	0.5			0			1.4			0.34			0.18114			0.6		
06/11/22 3:00	0.6			1			1.5			0.34			0.18144			0.6		
06/11/22 4:00	0.5			1			1.5			0.33			0.17862			0.6		
06/11/22 5:00	0.5			1			1.5			0.33			0.17868			0.6		
06/11/22 6:00	0.5			1			1.5			0.34			0.1788			0.6		
06/11/22 7:00	0.5			1			1.5			0.34			0.17838			0.59		
06/11/22 8:00	0.5			1			1.6			0.34			0.18144			0.6		
06/11/22 9:00	0.6			0			1.5			0.35			0.18468			0.62		
06/11/22 10:00	0.7			0			1.4			0.46			0.2442			0.81		
06/11/22 11:00	0.6			0			1.4			0.49			0.25854			0.86		
06/11/22 12:00	1.4			0			1.5			0.58			0.30582			1.02		
06/11/22 13:00	0.4			1			1.5			0.69			0.36006			1.2		
06/11/22 14:00	0.3			1			1.5			0.71			0.36642			1.22		
06/11/22 15:00	0.3			1			1.5			0.7			0.36222			1.21		
06/11/22 16:00	0.4			1			1.5			0.68			0.35526			1.18		
06/11/22 17:00	0.3			1			1.5			0.73			0.38046			1.27		
06/11/22 18:00	0.2			2			1.5			0.79			0.40734			1.36		
06/11/22 19:00	0.2			2			1.5			0.78			0.40452			1.35		
06/11/22 20:00	0.2			2			1.5			0.75			0.39348			1.31		
06/11/22 21:00	0.2			2			1.5			0.75			0.39354			1.31		
06/11/22 22:00	1			0			1.5			0.59			0.31344			1.04		
06/11/22 23:00	1.3			0			1.5			0.51			0.27192			0.91		
06/12/22 0:00	0.7			1			1.5			0.65			0.34368			1.15		
06/12/22 1:00	1			1			1.6			0.48			0.25062			0.84		
06/12/22 2:00	0			0	X		0			0.54			0.07704			0.26		
06/12/22 3:00	0	X		0	X		0	X		0.56			0	X		0	X	
06/12/22 4:00	0	X		0	X		0	X		0.56			0	X		0	X	
06/12/22 5:00	0	X		0	X		0	X		0.45			0	X		0	X	
06/12/22 6:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/12/22 7:00	0	X		0	X		0	X		0.36			0	X		0	X	

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/12/22 8:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/12/22 9:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/12/22 10:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/12/22 11:00	0	X		0	X		0	X		0.43			0	X		0	X	
06/12/22 12:00	0			0	X		0			0.51			0.17568			0.59		
06/12/22 13:00	1.2			0			1.4			0.56			0.29232			0.97		
06/12/22 14:00	1.3			0			1.5			0.57			0.3009			1		
06/12/22 15:00	1.1			0			1.5			0.59			0.31134			1.04		
06/12/22 16:00	1.1			0			1.5			0.61			0.31884			1.06		
06/12/22 17:00	1.1			0			1.5			0.61			0.32172			1.07		
06/12/22 18:00	0.9			0			1.5			0.62			0.32544			1.08		
06/12/22 19:00	1.2			0			1.5			0.59			0.3144			1.05		
06/12/22 20:00	1.2			0			1.5			0.6			0.31626			1.05		
06/12/22 21:00	1.2			0			1.5			0.59			0.3123			1.04		
06/12/22 22:00	1.2			0			1.5			0.59			0.31188			1.04		
06/12/22 23:00	0.8			1			1.7			0.45			0.2382			0.79		
06/13/22 0:00	0			0	X		0			0.48			0.0855			0.29		
06/13/22 1:00	0	X		0	X		0	X		0.52			0	X		0	X	
06/13/22 2:00	0	X		0	X		0	X		0.37			0	X		0	X	
06/13/22 3:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/13/22 4:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/13/22 5:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/13/22 6:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/13/22 7:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/13/22 8:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/13/22 9:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/13/22 10:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/13/22 11:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/13/22 12:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/13/22 13:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/13/22 14:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/13/22 15:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/13/22 16:00	0	X		0	X		0	X		0.4			0	X		0	X	
06/13/22 17:00	0	X		0	X		0	X		0.43			0	X		0	X	
06/13/22 18:00	0			0	X		0			0.46			0.16374			0.55		
06/13/22 19:00	1.1			0			1.3			0.5			0.27024			0.9		
06/13/22 20:00	1.2			0			1.5			0.58			0.30804			1.03		

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/13/22 21:00	0.7			1			1.5			0.4			0.19602			0.65		
06/13/22 22:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/13/22 23:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/14/22 0:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/14/22 1:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/14/22 2:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/14/22 3:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/14/22 4:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/14/22 5:00	0	X		0	X		0	X		0.43			0	X		0	X	
06/14/22 6:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/14/22 7:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/14/22 8:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/14/22 9:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/14/22 10:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/14/22 11:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/14/22 12:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/14/22 13:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/14/22 14:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/14/22 15:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/14/22 16:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/14/22 17:00	0	X		0	X		0	X		0.45			0	X		0	X	
06/14/22 18:00	0.8			0			0.7			0.41			0.16572			0.55		
06/14/22 19:00	1			0			1.3			0.56			0.2973			0.99		
06/14/22 20:00	1.1			0			1.5			0.58			0.3081			1.03		
06/14/22 21:00	0.9			0			1.6			0.49			0.264			0.88		
06/14/22 22:00	1.5			0			1.4			0.55			0.2946			0.98		
06/14/22 23:00	1.6			0			1.5			0.6			0.31914			1.06		
06/15/22 0:00	1.5			1			1.5			0.6			0.32046			1.07		
06/15/22 1:00	1.5			0			1.5			0.59			0.31566			1.05		
06/15/22 2:00	1.5			0			1.6			0.54			0.28752			0.96		
06/15/22 3:00	1.6			1			1.5			0.6			0.32118			1.07		
06/15/22 4:00	0.8			1			1.5			0.69			0.36462			1.22		
06/15/22 5:00	1.2			0			1.5			0.53			0.28542			0.95		
06/15/22 6:00	0.7			1			1.6			0.4			0.21606			0.72		
06/15/22 7:00	0.7			1			1.3			0.42			0.22722			0.76		
06/15/22 8:00	0.5			1			1.5			0.34			0.1782			0.59		
06/15/22 9:00	0.5			1			1.5			0.34			0.17814			0.59		

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/15/22 10:00	0.5			0			1.5			0.34			0.17958			0.6		
06/15/22 11:00	0.6			0			1.4			0.37			0.19662			0.66		
06/15/22 12:00	0.7			0			1.4			0.52			0.27576			0.92		
06/15/22 13:00	0.6			0			1.5			0.55			0.29124			0.97		
06/15/22 14:00	1.1			0			1.5			0.6			0.31386			1.05		
06/15/22 15:00	0.5			1			1.5			0.66			0.34464			1.15		
06/15/22 16:00	0.7			1			1.5			0.64			0.33312			1.11		
06/15/22 17:00	0.8			1			1.5			0.63			0.33174			1.11		
06/15/22 18:00	0.9			1			1.5			0.61			0.32178			1.07		
06/15/22 19:00	1			0			1.5			0.59			0.31566			1.05		
06/15/22 20:00	1.1			0			1.5			0.59			0.31512			1.05		
06/15/22 21:00	1.3			0			1.5			0.59			0.31506			1.05		
06/15/22 22:00	1.3			1			1.5			0.59			0.31422			1.05		
06/15/22 23:00	1.3			1			1.5			0.59			0.31398			1.05		
06/16/22 0:00	1.3			0			1.5			0.58			0.31362			1.05		
06/16/22 1:00	1.3			0			1.5			0.58			0.31362			1.05		
06/16/22 2:00	1.4			0			1.5			0.58			0.31344			1.04		
06/16/22 3:00	1.4			0			1.5			0.58			0.31404			1.05		
06/16/22 4:00	1.4			1			1.5			0.58			0.31386			1.05		
06/16/22 5:00	1.4			0			1.5			0.47			0.2502			0.83		
06/16/22 6:00	0.5			1			1.6			0.34			0.1806			0.6		
06/16/22 7:00	0.5			1			1.5			0.34			0.18078			0.6		
06/16/22 8:00	0.5			1			1.5			0.34			0.18048			0.6		
06/16/22 9:00	0.5			1			1.5			0.34			0.17886			0.6		
06/16/22 10:00	0.5			1			1.5			0.34			0.17808			0.59		
06/16/22 11:00	0.6			0			1.4			0.39			0.2037			0.68		
06/16/22 12:00	1.2			0			1.5			0.6			0.31806			1.06		
06/16/22 13:00	0.6			1			1.5			0.66			0.3468			1.16		
06/16/22 14:00	0.9			0			1.5			0.6			0.31566			1.05		
06/16/22 15:00	1			0			1.5			0.6			0.31656			1.06		
06/16/22 16:00	1			0			1.5			0.6			0.31566			1.05		
06/16/22 17:00	1.1			0			1.5			0.54			0.2874			0.96		
06/16/22 18:00	1.3			1			1.5			0.59			0.3156			1.05		
06/16/22 19:00	1.2			0			1.5			0.58			0.31044			1.03		
06/16/22 20:00	1.4			0			1.5			0.57			0.30438			1.01		
06/16/22 21:00	1.7			0			1.5			0.59			0.31422			1.05		
06/16/22 22:00	1.7			0			1.5			0.58			0.31422			1.05		

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/16/22 23:00	1.7			1			1.5			0.58			0.31416			1.05		
06/17/22 0:00	1.8			0			1.5			0.58			0.31302			1.04		
06/17/22 1:00	1.8			0			1.5			0.58			0.31242			1.04		
06/17/22 2:00	1.8			0			1.5			0.59			0.31212			1.04		
06/17/22 3:00	1.8			0			1.5			0.59			0.31074			1.04		
06/17/22 4:00	1.4			1			1.5			0.62			0.32946			1.1		
06/17/22 5:00	0.9			0			1.5			0.58			0.3099			1.03		
06/17/22 6:00	0.7			1			1.7			0.4			0.21678			0.72		
06/17/22 7:00	0.7			0			1.4			0.37			0.19926			0.66		
06/17/22 8:00	0.5			1			1.6			0.34			0.1812			0.6		
06/17/22 9:00	0.5			1			1.5			0.35			0.17934			0.6		
06/17/22 10:00	0.6			1			1.5			0.36			0.1839			0.61		
06/17/22 11:00	0.5			1			1.5			0.34			0.1788			0.6		
06/17/22 12:00	0.5			1			1.5			0.34			0.17832			0.59		
06/17/22 13:00	0.6			0			1.3			0.3			0.2166			0.72		
06/17/22 14:00	0.6			0			1.5			0	X		0.19194			0.64		
06/17/22 15:00	0.6			1			1.5			0	X		0.19284			0.64		
06/17/22 16:00	0.7			1			1.5			0	X		0.19272			0.64		
06/17/22 17:00	0.7			1			1.5			0	X		0.19242			0.64		
06/17/22 18:00	0.6			1			1.5			0	X		0.19224			0.64		
06/17/22 19:00	0.6			1			1.5			0	X		0.19248			0.64		
06/17/22 20:00	0.6			1			1.5			0	X		0.19266			0.64		
06/17/22 21:00	0.6			1			1.5			0	X		0.19284			0.64		
06/17/22 22:00	0.6			1			1.5			0	X		0.1896			0.63		
06/17/22 23:00	0.6			1			1.5			0	X		0.19146			0.64		
06/18/22 0:00	0.6			1			1.5			0	X		0.19158			0.64		
06/18/22 1:00	0.6			1			1.6			0	X		0.19158			0.64		
06/18/22 2:00	0.6			0			1.5			0	X		0.1926			0.64		
06/18/22 3:00	0.6			1			1.7			0	X		0.1887			0.63		
06/18/22 4:00	0.6			1			1.5			0	X		0.19446			0.65		
06/18/22 5:00	0.6			1			1.5			0	X		0.19116			0.64		
06/18/22 6:00	0.6			1			1.5			0	X		0.1911			0.64		
06/18/22 7:00	0.6			1			1.5			0	X		0.19134			0.64		
06/18/22 8:00	0.6			0			1.5			0	X		0.19122			0.64		
06/18/22 9:00	0.6			0			1.5			0	X		0.19128			0.64		
06/18/22 10:00	0.6			0			1.5			0	X		0.19122			0.64		
06/18/22 11:00	0.6			0			1.5			0	X		0.19182			0.64		

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/18/22 12:00	0.6			1			1.5			0	X		0.19122			0.64		
06/18/22 13:00	0.6			0			1.5			0	X		0.19098			0.64		
06/18/22 14:00	0.6			0			1.5			0	X		0.1914			0.64		
06/18/22 15:00	0.6			1			1.5			0	X		0.19176			0.64		
06/18/22 16:00	0.6			0			1.5			0	X		0.19152			0.64		
06/18/22 17:00	0.6			0			1.5			0	X		0.1917			0.64		
06/18/22 18:00	0.7			0			1.5			0	X		0.192			0.64		
06/18/22 19:00	0.7			1			1.5			0	X		0.19218			0.64		
06/18/22 20:00	0.7			1			1.4			0	X		0.20034			0.67		
06/18/22 21:00	0.6			0			1.4			0	X		0.19554			0.65		
06/18/22 22:00	0.7			0			1.5			0	X		0.29844			0.99		
06/18/22 23:00	0.8			1			1.5			0	X		0.21852			0.73		
06/19/22 0:00	0.7			0			1.4			0	X		0.19968			0.67		
06/19/22 1:00	0.7			0			1.4			0	X		0.24474			0.82		
06/19/22 2:00	0.7			1			1.4			0	X		0.20964			0.7		
06/19/22 3:00	0.7			1			1.5			0	X		0.1923			0.64		
06/19/22 4:00	0.7			1			1.5			0	X		0.19272			0.64		
06/19/22 5:00	0.7			1			1.4			0	X		0.19572			0.65		
06/19/22 6:00	0.7			1			1.5			0	X		0.192			0.64		
06/19/22 7:00	0.7			1			1.5			0	X		0.19194			0.64		
06/19/22 8:00	0.7			0			1.5			0	X		0.19248			0.64		
06/19/22 9:00	0.7			0			1.5			0	X		0.19254			0.64		
06/19/22 10:00	0.7			0			1.5			0	X		0.19242			0.64		
06/19/22 11:00	0.7			0			1.5			0	X		0.19206			0.64		
06/19/22 12:00	0.7			0			1.5			0	X		0.19152			0.64		
06/19/22 13:00	0.6			0			1.5			0	X		0.19092			0.64		
06/19/22 14:00	0.6			0			1.5			0	X		0.18954			0.63		
06/19/22 15:00	0.6			0			1.5			0	X		0.19014			0.63		
06/19/22 16:00	0.7			0			1.5			0	X		0.19068			0.64		
06/19/22 17:00	0.6			0			1.5			0	X		0.1896			0.63		
06/19/22 18:00	0.7			0			1.5			0	X		0.18912			0.63		
06/19/22 19:00	0.7			0			1.5			0	X		0.18996			0.63		
06/19/22 20:00	1.1			1			1.4			0	X		0.20826			0.69		
06/19/22 21:00	0.7			1			1.5			0	X		0.18978			0.63		
06/19/22 22:00	0.7			1			1.5			0	X		0.19272			0.64		
06/19/22 23:00	0.7			1			1.5			0	X		0.19206			0.64		
06/20/22 0:00	0.7			1			1.5			0	X		0.19194			0.64		

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/20/22 1:00	0.7			0			1.5			0	X		0.19188			0.64		
06/20/22 2:00	0.7			0			1.4			0	X		0.19218			0.64		
06/20/22 3:00	0.8			0			1.5			0	X		0.19212			0.64		
06/20/22 4:00	0.8			0			1.4			0	X		0.2031			0.68		
06/20/22 5:00	0.7			1			1.4			0	X		0.19608			0.65		
06/20/22 6:00	0.7			0			1.4			0	X		0.19584			0.65		
06/20/22 7:00	0.7			0			1.5			0	X		0.19194			0.64		
06/20/22 8:00	0.7			0			1.5			0	X		0.19176			0.64		
06/20/22 9:00	0.7			0			1.5			0	X		0.19188			0.64		
06/20/22 10:00	0.7			0			1.5			0	X		0.19206			0.64		
06/20/22 11:00	0.7			0			1.5			0	X		0.19188			0.64		
06/20/22 12:00	0.7			1			1.4			0	X		0.20268			0.68		
06/20/22 13:00	0.7			0			1.4			0	X		0.21888			0.73		
06/20/22 14:00	0.7			1			1.7			0.31			0.2445			0.82		
06/20/22 15:00	0.8			0			1.3			0.53			0.29676			0.99		
06/20/22 16:00	0.3			1			1.5			0.71			0.39462			1.32		
06/20/22 17:00	0.7			0			1.6			0.6			0.34092			1.14		
06/20/22 18:00	0.7			1			1.7			0.61			0.34524			1.15		
06/20/22 19:00	0.9			0			1.7			0.6			0.33222			1.11		
06/20/22 20:00	1			0			1.7			0.59			0.32592			1.09		
06/20/22 21:00	1.2			0			1.7			0.59			0.32382			1.08		
06/20/22 22:00	1.1			1			1.7			0.48			0.24858			0.83		
06/20/22 23:00	0			0	X		0			0.39			0.03828			0.13		
06/21/22 0:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/21/22 1:00	0	X		0	X		0	X		0.35			0	X		0	X	
06/21/22 2:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/21/22 3:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/21/22 4:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/21/22 5:00	0	X		0	X		0	X		0.39			0	X		0	X	
06/21/22 6:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/21/22 7:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/21/22 8:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/21/22 9:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/21/22 10:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/21/22 11:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/21/22 12:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/21/22 13:00	0	X		0	X		0	X		0.36			0	X		0	X	

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/21/22 14:00	0	X		0	X		0	X		0.37			0	X		0	X	
06/21/22 15:00	0	X		0	X		0	X		0.38			0	X		0	X	
06/21/22 16:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/21/22 17:00	0	X		0	X		0	X		0.38			0	X		0	X	
06/21/22 18:00	0	X		0	X		0	X		0.42			0	X		0	X	
06/21/22 19:00	0			0	X		0			0.54			0.18126			0.6		
06/21/22 20:00	1.4			0			1.6			0.63			0.29592			0.99		
06/21/22 21:00	0.9			1			1.6			0.65			0.34098			1.14		
06/21/22 22:00	1.2			0			1.6			0.6			0.31686			1.06		
06/21/22 23:00	1.2			0			1.6			0.6			0.31578			1.05		
06/22/22 0:00	1.3			0			1.6			0.6			0.3156			1.05		
06/22/22 1:00	1.4			0			1.6			0.6			0.31482			1.05		
06/22/22 2:00	1.1			0			1.5			0.54			0.28776			0.96		
06/22/22 3:00	2.1			0			1.6			0.59			0.31104			1.04		
06/22/22 4:00	1.3			0			1.6			0.57			0.30168			1.01		
06/22/22 5:00	0.9			1			1.6			0.44			0.23214			0.77		
06/22/22 6:00	0.8			1			1.6			0.33			0.17802			0.59		
06/22/22 7:00	0.7			1			1.6			0.33			0.17742			0.59		
06/22/22 8:00	0.6			1			1.6			0.33			0.17694			0.59		
06/22/22 9:00	0.6			0			1.6			0.33			0.17658			0.59		
06/22/22 10:00	0.6			0			1.6			0.33			0.17634			0.59		
06/22/22 11:00	0.6			0			1.6			0.34			0.17646			0.59		
06/22/22 12:00	0.6			0			1.6			0.34			0.1764			0.59		
06/22/22 13:00	0.6			1			1.5			0.36			0.18876			0.63		
06/22/22 14:00	0.6			0			1.5			0.38			0.20142			0.67		
06/22/22 15:00	0.6			1			1.5			0.35			0.18642			0.62		
06/22/22 16:00	0.6			0			1.6			0.34			0.17628			0.59		
06/22/22 17:00	0.6			0			1.6			0.33			0.1764			0.59		
06/22/22 18:00	0.6			1			1.6			0.33			0.1764			0.59		
06/22/22 19:00	0.6			1			1.6			0.34			0.1773			0.59		
06/22/22 20:00	0.7			0			1.4			0.45			0.2472			0.82		
06/22/22 21:00	1.3			0			1.6			0.53			0.28032			0.93		
06/22/22 22:00	0.7			0			1.5			0.54			0.28848			0.96		
06/22/22 23:00	1.3			0			1.5			0.59			0.31362			1.05		
06/23/22 0:00	1			1			1.5			0.61			0.32358			1.08		
06/23/22 1:00	1.1			1			1.5			0.52			0.2769			0.92		
06/23/22 2:00	0.6			2			1.4			0.39			0.14628			0.49		

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/23/22 3:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/23/22 4:00	0	X		0	X		0	X		0.45			0	X		0	X	
06/23/22 5:00	0	X		0	X		0	X		0.5			0	X		0	X	
06/23/22 6:00	0	X		0	X		0	X		0.57			0	X		0	X	
06/23/22 7:00	0	X		0	X		0	X		0.57			0	X		0	X	
06/23/22 8:00	0	X		0	X		0	X		0.57			0	X		0	X	
06/23/22 9:00	0	X		0	X		0	X		0.57			0	X		0	X	
06/23/22 10:00	0	X		0	X		0	X		0.55			0	X		0	X	
06/23/22 11:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/23/22 12:00	0	X		0	X		0	X		0.35			0	X		0	X	
06/23/22 13:00	0	X		0	X		0	X		0.35			0	X		0	X	
06/23/22 14:00	0	X		0	X		0	X		0.35			0	X		0	X	
06/23/22 15:00	0			0	X		0			0.41			0.003			0.01		
06/23/22 16:00	0.6			1			0.9			0.4			0.16824			0.56		
06/23/22 17:00	0.8			0			1.3			0.54			0.27708			0.92		
06/23/22 18:00	0.3			1			1.7			0.69			0.3597			1.2		
06/23/22 19:00	0.3			1			1.6			0.74			0.38538			1.28		
06/23/22 20:00	0.4			1			1.5			0.72			0.3768			1.26		
06/23/22 21:00	0.8			1			1.5			0.63			0.33144			1.1		
06/23/22 22:00	1			0			1.5			0.6			0.3168			1.06		
06/23/22 23:00	1.1			1			1.5			0.6			0.31638			1.05		
06/24/22 0:00	1			1			1.5			0.6			0.3165			1.06		
06/24/22 1:00	1.1			1			1.5			0.59			0.3168			1.06		
06/24/22 2:00	1.2			0			1.4			0.57			0.30552			1.02		
06/24/22 3:00	1			0			1.4			0.42			0.22518			0.75		
06/24/22 4:00	1.5			1			1.5			0.59			0.31632			1.05		
06/24/22 5:00	1			1			1.5			0.46			0.24354			0.81		
06/24/22 6:00	0.6			1			1.5			0.34			0.18054			0.6		
06/24/22 7:00	0.6			1			1.5			0.34			0.17886			0.6		
06/24/22 8:00	0.6			1			1.5			0.34			0.1788			0.6		
06/24/22 9:00	0.6			1			1.4			0.34			0.17916			0.6		
06/24/22 10:00	0.7			0			1.2			0.4			0.21042			0.7		
06/24/22 11:00	0.9			0			1.4			0.5			0.26208			0.87		
06/24/22 12:00	1.4			0			1.5			0.55			0.29046			0.97		
06/24/22 13:00	0.9			0			1.5			0.54			0.28548			0.95		
06/24/22 14:00	0.6			1			1.5			0.68			0.35508			1.18		
06/24/22 15:00	0.5			1			1.5			0.68			0.35202			1.17		

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/24/22 16:00	0.7			1			1.5			0.68			0.32688			1.09		
06/24/22 17:00	0.3			2			1.5			0.77			0.396			1.32		
06/24/22 18:00	0.4			1			1.5			0.71			0.3696			1.23		
06/24/22 19:00	0.4			1			1.5			0.72			0.3744			1.25		
06/24/22 20:00	0.8			1			1.5			0.63			0.33204			1.11		
06/24/22 21:00	1			0			1.5			0.61			0.32124			1.07		
06/24/22 22:00	0.9			1			1.5			0.63			0.33288			1.11		
06/24/22 23:00	1			1			1.5			0.6			0.31824			1.06		
06/25/22 0:00	1			0			1.5			0.55			0.29406			0.98		
06/25/22 1:00	0.8			1			1.5			0.69			0.36534			1.22		
06/25/22 2:00	0.9			0			1.6			0.56			0.30096			1		
06/25/22 3:00	0.7			0			1.5			0.56			0.3003			1		
06/25/22 4:00	0.7			0			1.5			0.55			0.29454			0.98		
06/25/22 5:00	0.7			1			1.5			0.46			0.24438			0.81		
06/25/22 6:00	0.6			1			1.6			0.34			0.18012			0.6		
06/25/22 7:00	0.6			1			1.6			0.33			0.17772			0.59		
06/25/22 8:00	0.6			1			1.6			0.33			0.17748			0.59		
06/25/22 9:00	0.6			1			1.6			0.33			0.17724			0.59		
06/25/22 10:00	0.6			1			1.6			0.33			0.17706			0.59		
06/25/22 11:00	0.6			1			1.6			0.34			0.17682			0.59		
06/25/22 12:00	0.6			0			1.6			0.35			0.183			0.61		
06/25/22 13:00	0.6			1			1.6			0.34			0.17808			0.59		
06/25/22 14:00	0.6			0			1.6			0.35			0.183			0.61		
06/25/22 15:00	0.6			0			1.5			0.34			0.18072			0.6		
06/25/22 16:00	0.6			0			1.5			0.37			0.19248			0.64		
06/25/22 17:00	1			0			1.6			0.62			0.31344			1.04		
06/25/22 18:00	0.5			1			1.6			0.68			0.35424			1.18		
06/25/22 19:00	0.8			1			1.6			0.63			0.32994			1.1		
06/25/22 20:00	0.9			1			1.6			0.62			0.32916			1.1		
06/25/22 21:00	1			1			1.5			0.47			0.2661			0.89		
06/25/22 22:00	0.7			1			1.5			0	X		0.21264			0.71		
06/25/22 23:00	0.7			1			1.6			0	X		0.19068			0.64		
06/26/22 0:00	0.7			1			1.6			0	X		0.19074			0.64		
06/26/22 1:00	0.7			1			1.5			0	X		0.21582			0.72		
06/26/22 2:00	0.7			0			1.6			0	X		0.22326			0.74		
06/26/22 3:00	0.7			1			1.6			0	X		0.20052			0.67		
06/26/22 4:00	1			0			1.5			0	X		0.27378			0.91		

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/26/22 5:00	1.1			1			1.5			0	X		0.26604			0.89		
06/26/22 6:00	0.7			0			1.6			0	X		0.19146			0.64		
06/26/22 7:00	0.7			1			1.6			0	X		0.19158			0.64		
06/26/22 8:00	0.7			1			1.6			0	X		0.19182			0.64		
06/26/22 9:00	0.7			0			1.5			0	X		0.20454			0.68		
06/26/22 10:00	0.7			1			1.6			0.32			0.22152			0.74		
06/26/22 11:00	0.6			1			1.6			0.34			0.17706			0.59		
06/26/22 12:00	0.6			1			1.6			0.34			0.1767			0.59		
06/26/22 13:00	0.6			1			1.6			0.34			0.1797			0.6		
06/26/22 14:00	0.6			1			1.6			0.34			0.17778			0.59		
06/26/22 15:00	0.6			1			1.6			0.35			0.1812			0.6		
06/26/22 16:00	0.9			0			1.5			0.48			0.25392			0.85		
06/26/22 17:00	1.1			0			1.6			0.62			0.31938			1.06		
06/26/22 18:00	0.4			1			1.6			0.74			0.38664			1.29		
06/26/22 19:00	0.9			1			1.6			0.62			0.3258			1.09		
06/26/22 20:00	1			0			1.6			0.6			0.31638			1.05		
06/26/22 21:00	1			1			1.6			0.51			0.27036			0.9		
06/26/22 22:00	0.6			1			1.5			0.37			0.15066			0.5		
06/26/22 23:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/27/22 0:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/27/22 1:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/27/22 2:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/27/22 3:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/27/22 4:00	0	X		0	X		0	X		0.41			0	X		0	X	
06/27/22 5:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/27/22 6:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/27/22 7:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/27/22 8:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/27/22 9:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/27/22 10:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/27/22 11:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/27/22 12:00	0	X		0	X		0	X		0.38			0	X		0	X	
06/27/22 13:00	0.5			2			1.2			0.42			0.16254			0.54		
06/27/22 14:00	0.8			0			1.4			0.49			0.261			0.87		
06/27/22 15:00	1.2			1			1.6			0.61			0.3171			1.06		
06/27/22 16:00	1.2			1			1.6			0.61			0.31734			1.06		
06/27/22 17:00	0.9			1			1.6			0.64			0.33198			1.11		

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/27/22 18:00	0.5			1			1.6			0.69			0.35754			1.19		
06/27/22 19:00	0.9			1			1.6			0.62			0.32514			1.08		
06/27/22 20:00	1			1			1.6			0.61			0.32094			1.07		
06/27/22 21:00	0.9			0			1.6			0.59			0.31098			1.04		
06/27/22 22:00	0.7			1			1.6			0.38			0.18144			0.6		
06/27/22 23:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/28/22 0:00	0	X		0	X		0	X		0.35			0	X		0	X	
06/28/22 1:00	0	X		0	X		0	X		0.35			0	X		0	X	
06/28/22 2:00	0	X		0	X		0	X		0.35			0	X		0	X	
06/28/22 3:00	0	X		0	X		0	X		0.35			0	X		0	X	
06/28/22 4:00	0	X		0	X		0	X		0.5			0	X		0	X	
06/28/22 5:00	0	X		0	X		0	X		0.41			0	X		0	X	
06/28/22 6:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/28/22 7:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/28/22 8:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/28/22 9:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/28/22 10:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/28/22 11:00	0	X		0	X		0	X		0.39			0	X		0	X	
06/28/22 12:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/28/22 13:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/28/22 14:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/28/22 15:00	0			0	X		0			0.41			0.0603			0.2		
06/28/22 16:00	0.6			0			1.2			0.36			0.18852			0.63		
06/28/22 17:00	0.9			0			1.5			0.52			0.27276			0.91		
06/28/22 18:00	1			0			1.6			0.6			0.31716			1.06		
06/28/22 19:00	1.3			0			1.6			0.6			0.31506			1.05		
06/28/22 20:00	1			0			1.6			0.52			0.27918			0.93		
06/28/22 21:00	0.7			1			1.4			0.4			0.18954			0.63		
06/28/22 22:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/28/22 23:00	0	X		0	X		0	X		0.53			0	X		0	X	
06/29/22 0:00	0	X		0	X		0	X		0.56			0	X		0	X	
06/29/22 1:00	0	X		0	X		0	X		0.55			0	X		0	X	
06/29/22 2:00	0	X		0	X		0	X		0.55			0	X		0	X	
06/29/22 3:00	0	X		0	X		0	X		0.55			0	X		0	X	
06/29/22 4:00	0	X		0	X		0	X		0.55			0	X		0	X	
06/29/22 5:00	0	X		0	X		0	X		0.52			0	X		0	X	
06/29/22 6:00	0	X		0	X		0	X		0.38			0	X		0	X	

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/29/22 7:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/29/22 8:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/29/22 9:00	0	X		0	X		0	X		0.37			0	X		0	X	
06/29/22 10:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/29/22 11:00	0	X		0	X		0	X		0.42			0	X		0	X	
06/29/22 12:00	0.7			0			1.6			0.4			0.16572			0.55		
06/29/22 13:00	0.9			0			1.6			0.51			0.26982			0.9		
06/29/22 14:00	1.3			1			1.6			0.61			0.31812			1.06		
06/29/22 15:00	1.3			1			1.6			0.61			0.31746			1.06		
06/29/22 16:00	1.3			0			1.6			0.6			0.31698			1.06		
06/29/22 17:00	1.3			0			1.6			0.6			0.31722			1.06		
06/29/22 18:00	1.1			1			1.6			0.62			0.3246			1.08		
06/29/22 19:00	1			1			1.6			0.63			0.3336			1.11		
06/29/22 20:00	1			1			1.6			0.62			0.33192			1.11		
06/29/22 21:00	1.4			1			1.6			0.6			0.32238			1.07		
06/29/22 22:00	1.6			1			1.6			0.59			0.31464			1.05		
06/29/22 23:00	0.8			1			1.6			0.68			0.36168			1.21		
06/30/22 0:00	1.1			1			1.6			0.5			0.25224			0.84		
06/30/22 1:00	0	X		0	X		0	X		0.56			0	X		0	X	
06/30/22 2:00	0	X		0	X		0	X		0.49			0	X		0	X	
06/30/22 3:00	0	X		0	X		0	X		0.55			0	X		0	X	
06/30/22 4:00	0	X		0	X		0	X		0.49			0	X		0	X	
06/30/22 5:00	0	X		0	X		0	X		0.48			0	X		0	X	
06/30/22 6:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/30/22 7:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/30/22 8:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/30/22 9:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/30/22 10:00	0	X		0	X		0	X		0.36			0	X		0	X	
06/30/22 11:00	0	X		0	X		0	X		0.37			0	X		0	X	
06/30/22 12:00	0	X		0	X		0	X		0.37			0	X		0	X	
06/30/22 13:00	0	X		0	X		0	X		0.42			0	X		0	X	
06/30/22 14:00	0.6			2			1.6			0.42			0.1611			0.54		
06/30/22 15:00	0.8			2			0.5			0.54			0.27684			0.92		
06/30/22 16:00	1			0			1.5			0.61			0.31854			1.06		
06/30/22 17:00	0.9			1			1.5			0.62			0.32442			1.08		
06/30/22 18:00	0.5			1			1.5			0.71			0.37176			1.24		
06/30/22 19:00	0.3			2			1.5			0.79			0.4101			1.37		

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**	**Value**	**SI**	**Mod**
06/30/22 20:00	0.9			1			1.5			0.63			0.33612			1.12		
06/30/22 21:00	1.3			1			1.5			0.59			0.31392			1.05		
06/30/22 22:00	1.2			0			1.5			0.54			0.2895			0.97		
06/30/22 23:00	0.7			2			1.5			0.48			0.189			0.63		
07/01/22 0:00	0	X		0	X		0	X		0.45			0	X		0	X	
07/01/22 1:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/01/22 2:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/01/22 3:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/01/22 4:00	0	X		0	X		0	X		0.37			0	X		0	X	
07/01/22 5:00	0	X		0	X		0	X		0.44			0	X		0	X	
07/01/22 6:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/01/22 7:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/01/22 8:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/01/22 9:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/01/22 10:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/01/22 11:00	0	X		0	X		0	X		0.37			0	X		0	X	
07/01/22 12:00	0	X		0	X		0	X		0.37			0	X		0	X	
07/01/22 13:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/01/22 14:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/01/22 15:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/01/22 16:00	0	X		0	X		0	X		0.42			0	X		0	X	
07/01/22 17:00	0			0	X		0			0.57			0.19464			0.65		
07/01/22 18:00	1.1			1			1.5			0.56			0.2985			1		
07/01/22 19:00	1.4			1			1.5			0.6			0.31818			1.06		
07/01/22 20:00	1.4			1			1.5			0.6			0.3183			1.06		
07/01/22 21:00	1.4			1			1.5			0.59			0.3162			1.05		
07/01/22 22:00	1.2			1			1.5			0.53			0.2871			0.96		
07/01/22 23:00	0			0	X		0			0.37			0.12852			0.43		

ATTACHMENT 17

AQ-59

AQ-59 The Daily Emissions shall not exceed the following rates:

POLLUTANT	TWO TURBINES	AUX BOILER	COOLING TOWER	EMERGENCY DIESEL GENERATOR	DIESEL FIRE PUMP
NOX	406.0	16.8	-	4.31	1.72
CO	629.5	52.8	-	0.84	0.09
VOC	223.1	7.2	-	0.16	0.05
PM-10	226.8	14.4	16.3	0.14	0.03
SO2	47.1	1.92	-	0.10	0.19

Verification: The Project owner shall include all necessary emissions data to demonstrate compliance with the emissions limits provided in this Condition as part of the Quarterly Air Quality Report required in Condition of Certification AQ-SC6

Monthly Summary By Day Report

Units CT1 and CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/07/2022 20:28 **Location:** Roseville, CA

Red = Invalid Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Limit Value:

	Units CT1 & CT2 CO, Lb 1 Hour(s)	Units CT1 & CT2 NOx, Lb 1 Hour(s)	Units CT1 & CT2 SO2, Lb 1 Hour(s)	Units CT1 & CT2 PM10, Lb 1 Hour(s)	Units CT1 & CT2 VOC, Lb 1 Hour(s)
04/01/2022	0.00	0.00	0.00	0.00	0.00
04/02/2022	0.00	0.00	0.00	0.00	0.00
04/03/2022	0.00	0.00	0.00	0.00	0.00
04/04/2022	0.00	0.00	0.00	0.00	0.00
04/05/2022	0.00	0.00	0.00	0.00	0.00
04/06/2022	0.00	0.00	0.00	0.00	0.00
04/07/2022	0.00	0.00	0.00	0.00	0.00
04/08/2022	0.00	0.00	0.00	0.00	0.00
04/09/2022	0.00	0.00	0.00	0.00	0.00
04/10/2022	0.00	0.00	0.00	0.00	0.00
04/11/2022	0.00	0.00	0.00	0.00	0.00
04/12/2022	0.00	0.00	0.00	0.00	0.00
04/13/2022	0.00	0.00	0.00	0.00	0.00
04/14/2022	0.00	0.00	0.00	0.00	0.00
04/15/2022	0.00	0.00	0.00	0.00	0.00
04/16/2022	0.00	0.00	0.00	0.00	0.00
04/17/2022	0.00	0.00	0.00	0.00	0.00
04/18/2022	0.00	0.00	0.00	0.00	0.00
04/19/2022	0.00	0.00	0.00	0.00	0.00
04/20/2022	0.00	0.00	0.00	0.00	0.00
04/21/2022	0.00	0.00	0.00	0.00	0.00
04/22/2022	0.00	0.00	0.00	0.00	0.00
04/23/2022	0.00	0.00	0.00	0.00	0.00
04/24/2022	0.00	0.00	0.00	0.00	0.00
04/25/2022	0.00	0.00	0.00	0.00	0.00
04/26/2022	262.54	37.61	2.20	4.44	7.40
04/27/2022	80.04	42.60	2.73	5.46	9.11
04/28/2022	433.35	48.04	1.82	3.67	6.09
04/29/2022	79.88	18.11	2.13	4.24	7.10
04/30/2022	0.00	0.00	0.00	0.00	0.00
Monthly Avg/Sum*:	855.81 *	146.36 *	8.88 *	17.81 *	29.70 *
Daily Min:	79.88	18.11	1.82	3.67	6.09
Daily Max:	433.35	48.04	2.73	5.46	9.11
Apr 2022 - Apr 2022	855.81	146.36	8.88	17.81	29.70
QTD:	855.81 *	146.36 *	8.88 *	17.81 *	29.70 *
YTD 2022:	4,901.62 *	5,903.34 *	609.85 *	1,220.45 *	2,034.49 *

Monthly Summary By Day Report

Units CT1 and CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/07/2022 20:28 **Location:** Roseville, CA

Red = Invalid Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Limit Value:

	Units CT1 & CT2 CO, Lb 1 Hour(s)	Units CT1 & CT2 NOx, Lb 1 Hour(s)	Units CT1 & CT2 SO2, Lb 1 Hour(s)	Units CT1 & CT2 PM10, Lb 1 Hour(s)	Units CT1 & CT2 VOC, Lb 1 Hour(s)
05/01/2022	52.77	40.13	3.31	6.59	11.01
05/02/2022	10.05	42.75	4.62	9.28	15.43
05/03/2022	90.10	21.95	0.64	1.29	2.14
05/04/2022	31.54	103.16	11.32	22.64	37.79
05/05/2022	29.70	89.84	10.06	20.15	33.53
05/06/2022	49.56	111.47	12.17	24.38	40.70
05/07/2022	48.59	86.19	8.41	16.75	27.98
05/08/2022	75.95	72.52	7.47	14.97	24.97
05/09/2022	41.13	57.60	6.11	12.23	20.36
05/10/2022	0.00	0.00	0.00	0.00	0.00
05/11/2022	0.00	0.00	0.00	0.00	0.00
05/12/2022	0.00	0.00	0.00	0.00	0.00
05/13/2022	0.00	0.00	0.00	0.00	0.00
05/14/2022	0.00	0.00	0.00	0.00	0.00
05/15/2022	0.00	0.00	0.00	0.00	0.00
05/16/2022	0.00	0.00	0.00	0.00	0.00
05/17/2022	101.23	54.71	4.07	8.14	13.53
05/18/2022	34.03	134.56	14.78	29.54	49.21
05/19/2022	117.78	87.91	9.04	18.14	30.19
05/20/2022	0.00	0.00	0.00	0.00	0.00
05/21/2022	0.00	0.00	0.00	0.00	0.00
05/22/2022	0.00	0.00	0.00	0.00	0.00
05/23/2022	0.00	0.00	0.00	0.00	0.00
05/24/2022	112.73	120.89	10.86	21.71	36.22
05/25/2022	28.34	131.48	14.17	28.39	47.29
05/26/2022	64.56	29.36	2.16	4.31	7.19
05/27/2022	0.00	0.00	0.00	0.00	0.00
05/28/2022	0.00	0.00	0.00	0.00	0.00
05/29/2022	0.00	0.00	0.00	0.00	0.00
05/30/2022	0.00	0.00	0.00	0.00	0.00
05/31/2022	0.00	0.00	0.00	0.00	0.00
Monthly Avg/Sum*:	888.06 *	1,184.52 *	119.19 *	238.51 *	397.54 *
Daily Min:	10.05	21.95	0.64	1.29	2.14
Daily Max:	117.78	134.56	14.78	29.54	49.21
Apr 2022 - May 2022	1,743.87	1,330.88	128.07	256.32	427.24
QTD:	1,743.87 *	1,330.88 *	128.07 *	256.32 *	427.24 *
YTD 2022:	5,789.68 *	7,087.86 *	729.04 *	1,458.96 *	2,432.03 *

Monthly Summary By Day Report

Units CT1 and CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/07/2022 20:28 **Location:** Roseville, CA

Red = Invalid Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Limit Value:

	Units CT1 & CT2 CO, Lb 1 Hour(s)	Units CT1 & CT2 NOx, Lb 1 Hour(s)	Units CT1 & CT2 SO2, Lb 1 Hour(s)	Units CT1 & CT2 PM10, Lb 1 Hour(s)	Units CT1 & CT2 VOC, Lb 1 Hour(s)
06/01/2022	0.00	0.00	0.00	0.00	0.00
06/02/2022	0.00	0.00	0.00	0.00	0.00
06/03/2022	0.00	0.00	0.00	0.00	0.00
06/04/2022	0.00	0.00	0.00	0.00	0.00
06/05/2022	0.00	0.00	0.00	0.00	0.00
06/06/2022	21.75	20.16	1.18	2.37	3.94
06/07/2022	21.08	0.22	1.91	3.81	6.36
06/08/2022	104.69	97.26	8.63	17.27	28.80
06/09/2022	103.92	107.30	10.99	21.99	36.68
06/10/2022	56.87	142.56	15.27	30.57	50.98
06/11/2022	52.50	123.61	12.90	25.77	42.96
06/12/2022	72.06	103.37	10.25	20.49	34.15
06/13/2022	77.17	63.42	5.64	11.29	18.84
06/14/2022	53.63	69.57	6.57	13.13	21.91
06/15/2022	47.74	123.31	13.33	26.63	44.42
06/16/2022	53.84	119.68	13.02	25.95	43.22
06/17/2022	48.67	77.86	8.41	16.84	28.05
06/18/2022	10.65	43.83	4.72	9.45	15.84
06/19/2022	11.96	42.94	4.67	9.37	15.63
06/20/2022	80.89	90.14	8.25	16.49	27.58
06/21/2022	56.60	73.67	6.38	12.74	21.27
06/22/2022	35.35	101.12	10.46	21.00	35.08
06/23/2022	71.52	100.25	9.40	18.72	31.26
06/24/2022	38.94	124.71	13.61	27.21	45.35
06/25/2022	47.48	105.25	10.82	21.69	36.14
06/26/2022	73.45	90.00	8.34	16.64	27.78
06/27/2022	67.61	91.51	8.22	16.43	27.38
06/28/2022	47.37	72.96	6.44	12.85	21.44
06/29/2022	58.13	108.51	10.00	19.97	33.37
06/30/2022	119.87	94.92	9.08	18.18	30.30
Monthly Avg/Sum*:	1,433.74 *	2,188.13 *	218.49 *	436.85 *	728.73 *
Daily Min:	10.65	0.22	1.18	2.37	3.94
Daily Max:	119.87	142.56	15.27	30.57	50.98
Apr 2022 - Jun 2022	3,177.61	3,519.01	346.56	693.17	1,155.97
QTD:	3,177.61 *	3,519.01 *	346.56 *	693.17 *	1,155.97 *
YTD 2022:	7,223.42 *	9,275.99 *	947.53 *	1,895.81 *	3,160.76 *

Monthly Summary By Day Report

Unit CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:58 **Location:** Roseville, CA

Red = Invalid Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Limit Value:

	Unit CT1 CO, Lb 1 Hour(s)	Unit CT1 NOx, Lb 1 Hour(s)	Unit CT1 SO2, Lb 1 Hour(s)	Unit CT1 PM10, Lb 1 Hour(s)	Unit CT1 VOC, Lb 1 Hour(s)
04/01/2022	0.00	0.00	0.0	0.00	0.00
04/02/2022	0.00	0.00	0.0	0.00	0.00
04/03/2022	0.00	0.00	0.0	0.00	0.00
04/04/2022	0.00	0.00	0.0	0.00	0.00
04/05/2022	0.00	0.00	0.0	0.00	0.00
04/06/2022	0.00	0.00	0.0	0.00	0.00
04/07/2022	0.00	0.00	0.0	0.00	0.00
04/08/2022	0.00	0.00	0.0	0.00	0.00
04/09/2022	0.00	0.00	0.0	0.00	0.00
04/10/2022	0.00	0.00	0.0	0.00	0.00
04/11/2022	0.00	0.00	0.0	0.00	0.00
04/12/2022	0.00	0.00	0.0	0.00	0.00
04/13/2022	0.00	0.00	0.0	0.00	0.00
04/14/2022	0.00	0.00	0.0	0.00	0.00
04/15/2022	0.00	0.00	0.0	0.00	0.00
04/16/2022	0.00	0.00	0.0	0.00	0.00
04/17/2022	0.00	0.00	0.0	0.00	0.00
04/18/2022	0.00	0.00	0.0	0.00	0.00
04/19/2022	0.00	0.00	0.0	0.00	0.00
04/20/2022	0.00	0.00	0.0	0.00	0.00
04/21/2022	0.00	0.00	0.0	0.00	0.00
04/22/2022	0.00	0.00	0.0	0.00	0.00
04/23/2022	0.00	0.00	0.0	0.00	0.00
04/24/2022	0.00	0.00	0.0	0.00	0.00
04/25/2022	0.00	0.00	0.0	0.00	0.00
04/26/2022	0.00	0.00	0.0	0.00	0.00
04/27/2022	0.00	0.00	0.0	0.00	0.00
04/28/2022	270.17	11.85	0.0	0.08	0.12
04/29/2022	18.36	18.11	2.2	4.24	7.10
04/30/2022	0.00	0.00	0.0	0.00	0.00
Monthly Avg/Sum*:	288.53 *	29.96 *	2.2 *	4.32 *	7.22 *
Daily Min:	18.36	11.85	0.0	0.08	0.12
Daily Max:	270.17	18.11	2.2	4.24	7.10
Apr 2022 - Apr 2022	288.53	29.96	2.2	4.32	7.22
QTD:	288.53 *	29.96 *	2.2 *	4.32 *	7.22 *
YTD 2022:	2,078.50 *	2,597.09 *	278.0 *	531.24 *	886.79 *

Monthly Summary By Day Report

Unit CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:58 **Location:** Roseville, CA

Red = Invalid Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Limit Value:

	Unit CT1 CO, Lb 1 Hour(s)	Unit CT1 NOx, Lb 1 Hour(s)	Unit CT1 SO2, Lb 1 Hour(s)	Unit CT1 PM10, Lb 1 Hour(s)	Unit CT1 VOC, Lb 1 Hour(s)
05/01/2022	52.77	40.13	3.8	6.59	11.01
05/02/2022	10.05	42.75	5.1	9.28	15.43
05/03/2022	61.98	16.75	0.6	1.25	2.07
05/04/2022	13.01	49.06	5.6	10.93	18.27
05/05/2022	11.94	43.49	5.2	9.74	16.19
05/06/2022	21.45	55.91	6.4	12.17	20.30
05/07/2022	20.88	54.26	6.4	11.98	20.01
05/08/2022	59.58	28.10	2.8	5.04	8.42
05/09/2022	16.63	17.22	2.2	3.65	6.11
05/10/2022	0.00	0.00	0.0	0.00	0.00
05/11/2022	0.00	0.00	0.0	0.00	0.00
05/12/2022	0.00	0.00	0.0	0.00	0.00
05/13/2022	0.00	0.00	0.0	0.00	0.00
05/14/2022	0.00	0.00	0.0	0.00	0.00
05/15/2022	0.00	0.00	0.0	0.00	0.00
05/16/2022	0.00	0.00	0.0	0.00	0.00
05/17/2022	43.98	28.53	2.4	4.49	7.46
05/18/2022	14.11	65.58	7.3	14.39	23.99
05/19/2022	81.59	35.75	2.8	5.88	9.79
05/20/2022	0.00	0.00	0.0	0.00	0.00
05/21/2022	0.00	0.00	0.0	0.00	0.00
05/22/2022	0.00	0.00	0.0	0.00	0.00
05/23/2022	0.00	0.00	0.0	0.00	0.00
05/24/2022	71.78	54.39	4.7	9.66	16.14
05/25/2022	26.34	63.85	6.9	13.80	22.98
05/26/2022	64.56	28.12	2.2	4.30	7.17
05/27/2022	0.00	0.00	0.0	0.00	0.00
05/28/2022	0.00	0.00	0.0	0.00	0.00
05/29/2022	0.00	0.00	0.0	0.00	0.00
05/30/2022	0.00	0.00	0.0	0.00	0.00
05/31/2022	0.00	0.00	0.0	0.00	0.00
Monthly Avg/Sum*:	570.65 *	623.89 *	64.4 *	123.15 *	205.34 *
Daily Min:	10.05	16.75	0.6	1.25	2.07
Daily Max:	81.59	65.58	7.3	14.39	23.99
Apr 2022 - May 2022	859.18	653.85	66.6	127.47	212.56
QTD:	859.18 *	653.85 *	66.6 *	127.47 *	212.56 *
YTD 2022:	2,649.15 *	3,220.98 *	342.4 *	654.39 *	1,092.13 *

Monthly Summary By Day Report

Unit CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:58 **Location:** Roseville, CA

Red = Invalid Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Limit Value:

	Unit CT1 CO, Lb 1 Hour(s)	Unit CT1 NOx, Lb 1 Hour(s)	Unit CT1 SO2, Lb 1 Hour(s)	Unit CT1 PM10, Lb 1 Hour(s)	Unit CT1 VOC, Lb 1 Hour(s)
06/01/2022	0.00	0.00	0.0	0.00	0.00
06/02/2022	0.00	0.00	0.0	0.00	0.00
06/03/2022	0.00	0.00	0.0	0.00	0.00
06/04/2022	0.00	0.00	0.0	0.00	0.00
06/05/2022	0.00	0.00	0.0	0.00	0.00
06/06/2022	21.75	20.16	1.2	2.37	3.94
06/07/2022	0.00	0.00	0.0	0.00	0.00
06/08/2022	64.43	60.43	5.6	10.93	18.23
06/09/2022	18.69	56.88	6.2	12.53	20.89
06/10/2022	18.81	69.58	7.7	15.16	25.24
06/11/2022	11.17	57.56	6.7	12.83	21.41
06/12/2022	20.95	55.88	6.3	12.36	20.59
06/13/2022	11.88	44.03	5.1	9.54	15.93
06/14/2022	13.60	43.17	5.2	9.83	16.42
06/15/2022	22.30	60.18	6.6	12.92	21.55
06/16/2022	25.07	57.53	6.5	12.55	20.90
06/17/2022	30.37	28.62	3.3	6.16	10.27
06/18/2022	0.00	0.00	0.0	0.00	0.00
06/19/2022	0.00	0.00	0.0	0.00	0.00
06/20/2022	48.16	35.81	2.7	5.33	8.90
06/21/2022	13.72	49.30	5.3	9.99	16.67
06/22/2022	16.21	49.45	5.6	10.21	17.03
06/23/2022	19.34	61.18	6.5	12.40	20.71
06/24/2022	17.87	60.29	6.7	13.29	22.12
06/25/2022	31.71	49.46	5.3	10.13	16.89
06/26/2022	40.44	39.23	3.3	6.30	10.51
06/27/2022	13.48	52.87	5.5	10.77	17.92
06/28/2022	12.30	48.36	5.3	9.88	16.49
06/29/2022	19.98	61.89	6.5	12.60	21.05
06/30/2022	15.70	54.15	6.1	11.96	19.91
Monthly Avg/Sum*:	507.93 *	1,116.01 *	119.2 *	230.04 *	383.57 *
Daily Min:	11.17	20.16	1.2	2.37	3.94
Daily Max:	64.43	69.58	7.7	15.16	25.24
Apr 2022 - Jun 2022	1,367.11	1,769.86	185.8	357.51	596.13
QTD:	1,367.11 *	1,769.86 *	185.8 *	357.51 *	596.13 *
YTD 2022:	3,157.08 *	4,336.99 *	461.6 *	884.43 *	1,475.70 *

Monthly Summary By Day Report

Unit CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:55 **Location:** Roseville, CA

Red = Invalid Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Limit Value:

	Unit CT2 CO, Lb 1 Hour(s)	Unit CT2 NOx, Lb 1 Hour(s)	Unit CT2 SO2, Lb 1 Hour(s)	Unit CT2 PM10, Lb 1 Hour(s)	Unit CT2 VOC, Lb 1 Hour(s)
04/01/2022	0.00	0.00	0.0	0.00	0.00
04/02/2022	0.00	0.00	0.0	0.00	0.00
04/03/2022	0.00	0.00	0.0	0.00	0.00
04/04/2022	0.00	0.00	0.0	0.00	0.00
04/05/2022	0.00	0.00	0.0	0.00	0.00
04/06/2022	0.00	0.00	0.0	0.00	0.00
04/07/2022	0.00	0.00	0.0	0.00	0.00
04/08/2022	0.00	0.00	0.0	0.00	0.00
04/09/2022	0.00	0.00	0.0	0.00	0.00
04/10/2022	0.00	0.00	0.0	0.00	0.00
04/11/2022	0.00	0.00	0.0	0.00	0.00
04/12/2022	0.00	0.00	0.0	0.00	0.00
04/13/2022	0.00	0.00	0.0	0.00	0.00
04/14/2022	0.00	0.00	0.0	0.00	0.00
04/15/2022	0.00	0.00	0.0	0.00	0.00
04/16/2022	0.00	0.00	0.0	0.00	0.00
04/17/2022	0.00	0.00	0.0	0.00	0.00
04/18/2022	0.00	0.00	0.0	0.00	0.00
04/19/2022	0.00	0.00	0.0	0.00	0.00
04/20/2022	0.00	0.00	0.0	0.00	0.00
04/21/2022	0.00	0.00	0.0	0.00	0.00
04/22/2022	0.00	0.00	0.0	0.00	0.00
04/23/2022	0.00	0.00	0.0	0.00	0.00
04/24/2022	0.00	0.00	0.0	0.00	0.00
04/25/2022	0.00	0.00	0.0	0.00	0.00
04/26/2022	262.54	37.61	2.2	4.44	7.40
04/27/2022	80.04	42.60	2.7	5.46	9.11
04/28/2022	163.18	36.19	1.8	3.59	5.97
04/29/2022	0.00	0.00	0.0	0.00	0.00
04/30/2022	0.00	0.00	0.0	0.00	0.00
Monthly Avg/Sum*:	505.76 *	116.40 *	6.7 *	13.49 *	22.48 *
Daily Min:	80.04	36.19	1.8	3.59	5.97
Daily Max:	262.54	42.60	2.7	5.46	9.11
Apr 2022 - Apr 2022	505.76	116.40	6.7	13.49	22.48
QTD:	505.76 *	116.40 *	6.7 *	13.49 *	22.48 *
YTD 2022:	2,761.60 *	3,306.25 *	342.8 *	689.21 *	1,147.70 *

Monthly Summary By Day Report

Unit CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:55 **Location:** Roseville, CA

Red = Invalid Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Limit Value:

	Unit CT2 CO, Lb 1 Hour(s)	Unit CT2 NOx, Lb 1 Hour(s)	Unit CT2 SO2, Lb 1 Hour(s)	Unit CT2 PM10, Lb 1 Hour(s)	Unit CT2 VOC, Lb 1 Hour(s)
05/01/2022	0.00	0.00	0.0	0.00	0.00
05/02/2022	0.00	0.00	0.0	0.00	0.00
05/03/2022	28.12	5.20	0.0	0.04	0.07
05/04/2022	18.53	54.10	6.0	11.71	19.52
05/05/2022	17.76	46.35	5.3	10.41	17.34
05/06/2022	28.11	55.56	6.1	12.21	20.40
05/07/2022	27.71	31.93	2.5	4.77	7.97
05/08/2022	16.37	44.42	5.2	9.93	16.55
05/09/2022	24.50	40.38	4.6	8.58	14.25
05/10/2022	0.00	0.00	0.0	0.00	0.00
05/11/2022	0.00	0.00	0.0	0.00	0.00
05/12/2022	0.00	0.00	0.0	0.00	0.00
05/13/2022	0.00	0.00	0.0	0.00	0.00
05/14/2022	0.00	0.00	0.0	0.00	0.00
05/15/2022	0.00	0.00	0.0	0.00	0.00
05/16/2022	0.00	0.00	0.0	0.00	0.00
05/17/2022	57.25	26.18	1.8	3.65	6.07
05/18/2022	19.92	68.98	7.7	15.15	25.22
05/19/2022	36.19	52.16	6.0	12.26	20.40
05/20/2022	0.00	0.00	0.0	0.00	0.00
05/21/2022	0.00	0.00	0.0	0.00	0.00
05/22/2022	0.00	0.00	0.0	0.00	0.00
05/23/2022	0.00	0.00	0.0	0.00	0.00
05/24/2022	40.95	66.50	6.1	12.05	20.08
05/25/2022	2.00	67.63	7.2	14.59	24.31
05/26/2022	0.00	1.24	0.0	0.01	0.02
05/27/2022	0.00	0.00	0.0	0.00	0.00
05/28/2022	0.00	0.00	0.0	0.00	0.00
05/29/2022	0.00	0.00	0.0	0.00	0.00
05/30/2022	0.00	0.00	0.0	0.00	0.00
05/31/2022	0.00	0.00	0.0	0.00	0.00
Monthly Avg/Sum*:	317.41 *	560.63 *	58.5 *	115.36 *	192.20 *
Daily Min:	0.00	1.24	0.0	0.01	0.02
Daily Max:	57.25	68.98	7.7	15.15	25.22
Apr 2022 - May 2022	823.17	677.03	65.2	128.85	214.68
QTD:	823.17 *	677.03 *	65.2 *	128.85 *	214.68 *
YTD 2022:	3,079.01 *	3,866.88 *	401.3 *	804.57 *	1,339.90 *

Monthly Summary By Day Report

Unit CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:55 **Location:** Roseville, CA

Red = Invalid Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Limit Value:

	Unit CT2 CO, Lb 1 Hour(s)	Unit CT2 NOx, Lb 1 Hour(s)	Unit CT2 SO2, Lb 1 Hour(s)	Unit CT2 PM10, Lb 1 Hour(s)	Unit CT2 VOC, Lb 1 Hour(s)
06/01/2022	0.00	0.00	0.0	0.00	0.00
06/02/2022	0.00	0.00	0.0	0.00	0.00
06/03/2022	0.00	0.00	0.0	0.00	0.00
06/04/2022	0.00	0.00	0.0	0.00	0.00
06/05/2022	0.00	0.00	0.0	0.00	0.00
06/06/2022	0.00	0.00	0.0	0.00	0.00
06/07/2022	13.52	0.22	1.6	3.81	6.36
06/08/2022	40.26	36.83	3.1	6.34	10.57
06/09/2022	85.23	50.42	4.5	9.46	15.79
06/10/2022	38.06	72.98	7.7	15.41	25.74
06/11/2022	41.33	66.05	6.8	12.94	21.55
06/12/2022	51.11	47.49	3.9	8.13	13.56
06/13/2022	65.29	19.39	0.9	1.75	2.91
06/14/2022	40.03	26.40	1.7	3.30	5.49
06/15/2022	25.44	63.13	6.7	13.71	22.87
06/16/2022	28.77	62.15	6.6	13.40	22.32
06/17/2022	18.30	49.24	5.4	10.68	17.78
06/18/2022	10.65	43.83	4.9	9.45	15.84
06/19/2022	11.96	42.94	4.8	9.37	15.63
06/20/2022	32.73	54.33	5.4	11.16	18.68
06/21/2022	42.88	24.37	1.3	2.75	4.60
06/22/2022	19.14	51.67	5.6	10.79	18.05
06/23/2022	52.18	39.07	3.2	6.32	10.55
06/24/2022	21.07	64.42	7.0	13.92	23.23
06/25/2022	15.77	55.79	6.0	11.56	19.25
06/26/2022	33.01	50.77	5.3	10.34	17.27
06/27/2022	54.13	38.64	2.7	5.66	9.46
06/28/2022	35.07	24.60	1.5	2.97	4.95
06/29/2022	38.15	46.62	3.6	7.37	12.32
06/30/2022	104.17	40.77	3.1	6.22	10.39
Monthly Avg/Sum*:	918.25 *	1,072.12 *	103.3 *	206.81 *	345.16 *
Daily Min:	10.65	0.22	0.9	1.75	2.91
Daily Max:	104.17	72.98	7.7	15.41	25.74
Apr 2022 - Jun 2022	1,741.42	1,749.15	168.5	335.66	559.84
QTD:	1,741.42 *	1,749.15 *	168.5 *	335.66 *	559.84 *
YTD 2022:	3,997.26 *	4,939.00 *	504.6 *	1,011.38 *	1,685.06 *

ATTACHMENT 18

AQ-60

AQ-60 If the Alstom GTX100 turbine are selected, the quarterly emissions shall not exceed the levels shown below:

Alstom GTX100 Gas Turbines					
Pollutant	Quarter 1 (lbs/quarter) Two turbines	Quarter 2 (lbs/quarter) Two Turbines	Quarter 3 (lbs/quarter) Two turbines	Quarter 4 (lbs/quarter) Two Turbines	Tons/ Year Two Turbines
NOx	15,399	12,965	17,496	15,422	30.64
CO	26,787	32,590	28,175	29,862	58.71
VOCs	5,791	7,306	6,630	6,848	13.29
PM0	16,300	13,692	17,789	17,569	32.67
SOx	3,385	2,843	3,694	3,648	6.78

Verification: The Project owner shall include all necessary emissions data to demonstrate compliance with the emission limits provided in this Condition as part of the Quarterly Air Quality Report required in Condition of Certification AQ-SC6.

Monthly Summary By Day Report

Units CT1 and CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/07/2022 20:28 **Location:** Roseville, CA

Red = Invalid Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Limit Value:

	Units CT1 & CT2 CO, Lb 1 Hour(s)	Units CT1 & CT2 NOx, Lb 1 Hour(s)	Units CT1 & CT2 SO2, Lb 1 Hour(s)	Units CT1 & CT2 PM10, Lb 1 Hour(s)	Units CT1 & CT2 VOC, Lb 1 Hour(s)
04/01/2022	0.00	0.00	0.00	0.00	0.00
04/02/2022	0.00	0.00	0.00	0.00	0.00
04/03/2022	0.00	0.00	0.00	0.00	0.00
04/04/2022	0.00	0.00	0.00	0.00	0.00
04/05/2022	0.00	0.00	0.00	0.00	0.00
04/06/2022	0.00	0.00	0.00	0.00	0.00
04/07/2022	0.00	0.00	0.00	0.00	0.00
04/08/2022	0.00	0.00	0.00	0.00	0.00
04/09/2022	0.00	0.00	0.00	0.00	0.00
04/10/2022	0.00	0.00	0.00	0.00	0.00
04/11/2022	0.00	0.00	0.00	0.00	0.00
04/12/2022	0.00	0.00	0.00	0.00	0.00
04/13/2022	0.00	0.00	0.00	0.00	0.00
04/14/2022	0.00	0.00	0.00	0.00	0.00
04/15/2022	0.00	0.00	0.00	0.00	0.00
04/16/2022	0.00	0.00	0.00	0.00	0.00
04/17/2022	0.00	0.00	0.00	0.00	0.00
04/18/2022	0.00	0.00	0.00	0.00	0.00
04/19/2022	0.00	0.00	0.00	0.00	0.00
04/20/2022	0.00	0.00	0.00	0.00	0.00
04/21/2022	0.00	0.00	0.00	0.00	0.00
04/22/2022	0.00	0.00	0.00	0.00	0.00
04/23/2022	0.00	0.00	0.00	0.00	0.00
04/24/2022	0.00	0.00	0.00	0.00	0.00
04/25/2022	0.00	0.00	0.00	0.00	0.00
04/26/2022	262.54	37.61	2.20	4.44	7.40
04/27/2022	80.04	42.60	2.73	5.46	9.11
04/28/2022	433.35	48.04	1.82	3.67	6.09
04/29/2022	79.88	18.11	2.13	4.24	7.10
04/30/2022	0.00	0.00	0.00	0.00	0.00
Monthly Avg/Sum*:	855.81 *	146.36 *	8.88 *	17.81 *	29.70 *
Daily Min:	79.88	18.11	1.82	3.67	6.09
Daily Max:	433.35	48.04	2.73	5.46	9.11
Apr 2022 - Apr 2022	855.81	146.36	8.88	17.81	29.70
QTD:	855.81 *	146.36 *	8.88 *	17.81 *	29.70 *
YTD 2022:	4,901.62 *	5,903.34 *	609.85 *	1,220.45 *	2,034.49 *

Monthly Summary By Day Report

Units CT1 and CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/07/2022 20:28 **Location:** Roseville, CA

Red = Invalid Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Limit Value:

	Units CT1 & CT2 CO, Lb 1 Hour(s)	Units CT1 & CT2 NOx, Lb 1 Hour(s)	Units CT1 & CT2 SO2, Lb 1 Hour(s)	Units CT1 & CT2 PM10, Lb 1 Hour(s)	Units CT1 & CT2 VOC, Lb 1 Hour(s)
05/01/2022	52.77	40.13	3.31	6.59	11.01
05/02/2022	10.05	42.75	4.62	9.28	15.43
05/03/2022	90.10	21.95	0.64	1.29	2.14
05/04/2022	31.54	103.16	11.32	22.64	37.79
05/05/2022	29.70	89.84	10.06	20.15	33.53
05/06/2022	49.56	111.47	12.17	24.38	40.70
05/07/2022	48.59	86.19	8.41	16.75	27.98
05/08/2022	75.95	72.52	7.47	14.97	24.97
05/09/2022	41.13	57.60	6.11	12.23	20.36
05/10/2022	0.00	0.00	0.00	0.00	0.00
05/11/2022	0.00	0.00	0.00	0.00	0.00
05/12/2022	0.00	0.00	0.00	0.00	0.00
05/13/2022	0.00	0.00	0.00	0.00	0.00
05/14/2022	0.00	0.00	0.00	0.00	0.00
05/15/2022	0.00	0.00	0.00	0.00	0.00
05/16/2022	0.00	0.00	0.00	0.00	0.00
05/17/2022	101.23	54.71	4.07	8.14	13.53
05/18/2022	34.03	134.56	14.78	29.54	49.21
05/19/2022	117.78	87.91	9.04	18.14	30.19
05/20/2022	0.00	0.00	0.00	0.00	0.00
05/21/2022	0.00	0.00	0.00	0.00	0.00
05/22/2022	0.00	0.00	0.00	0.00	0.00
05/23/2022	0.00	0.00	0.00	0.00	0.00
05/24/2022	112.73	120.89	10.86	21.71	36.22
05/25/2022	28.34	131.48	14.17	28.39	47.29
05/26/2022	64.56	29.36	2.16	4.31	7.19
05/27/2022	0.00	0.00	0.00	0.00	0.00
05/28/2022	0.00	0.00	0.00	0.00	0.00
05/29/2022	0.00	0.00	0.00	0.00	0.00
05/30/2022	0.00	0.00	0.00	0.00	0.00
05/31/2022	0.00	0.00	0.00	0.00	0.00
Monthly Avg/Sum*:	888.06 *	1,184.52 *	119.19 *	238.51 *	397.54 *
Daily Min:	10.05	21.95	0.64	1.29	2.14
Daily Max:	117.78	134.56	14.78	29.54	49.21
Apr 2022 - May 2022	1,743.87	1,330.88	128.07	256.32	427.24
QTD:	1,743.87 *	1,330.88 *	128.07 *	256.32 *	427.24 *
YTD 2022:	5,789.68 *	7,087.86 *	729.04 *	1,458.96 *	2,432.03 *

Monthly Summary By Day Report

Units CT1 and CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/07/2022 20:28 **Location:** Roseville, CA

Red = Invalid Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Limit Value:

	Units CT1 & CT2 CO, Lb 1 Hour(s)	Units CT1 & CT2 NOx, Lb 1 Hour(s)	Units CT1 & CT2 SO2, Lb 1 Hour(s)	Units CT1 & CT2 PM10, Lb 1 Hour(s)	Units CT1 & CT2 VOC, Lb 1 Hour(s)
06/01/2022	0.00	0.00	0.00	0.00	0.00
06/02/2022	0.00	0.00	0.00	0.00	0.00
06/03/2022	0.00	0.00	0.00	0.00	0.00
06/04/2022	0.00	0.00	0.00	0.00	0.00
06/05/2022	0.00	0.00	0.00	0.00	0.00
06/06/2022	21.75	20.16	1.18	2.37	3.94
06/07/2022	21.08	0.22	1.91	3.81	6.36
06/08/2022	104.69	97.26	8.63	17.27	28.80
06/09/2022	103.92	107.30	10.99	21.99	36.68
06/10/2022	56.87	142.56	15.27	30.57	50.98
06/11/2022	52.50	123.61	12.90	25.77	42.96
06/12/2022	72.06	103.37	10.25	20.49	34.15
06/13/2022	77.17	63.42	5.64	11.29	18.84
06/14/2022	53.63	69.57	6.57	13.13	21.91
06/15/2022	47.74	123.31	13.33	26.63	44.42
06/16/2022	53.84	119.68	13.02	25.95	43.22
06/17/2022	48.67	77.86	8.41	16.84	28.05
06/18/2022	10.65	43.83	4.72	9.45	15.84
06/19/2022	11.96	42.94	4.67	9.37	15.63
06/20/2022	80.89	90.14	8.25	16.49	27.58
06/21/2022	56.60	73.67	6.38	12.74	21.27
06/22/2022	35.35	101.12	10.46	21.00	35.08
06/23/2022	71.52	100.25	9.40	18.72	31.26
06/24/2022	38.94	124.71	13.61	27.21	45.35
06/25/2022	47.48	105.25	10.82	21.69	36.14
06/26/2022	73.45	90.00	8.34	16.64	27.78
06/27/2022	67.61	91.51	8.22	16.43	27.38
06/28/2022	47.37	72.96	6.44	12.85	21.44
06/29/2022	58.13	108.51	10.00	19.97	33.37
06/30/2022	119.87	94.92	9.08	18.18	30.30
Monthly Avg/Sum*:	1,433.74 *	2,188.13 *	218.49 *	436.85 *	728.73 *
Daily Min:	10.65	0.22	1.18	2.37	3.94
Daily Max:	119.87	142.56	15.27	30.57	50.98
Apr 2022 - Jun 2022	3,177.61	3,519.01	346.56	693.17	1,155.97
QTD:	3,177.61 *	3,519.01 *	346.56 *	693.17 *	1,155.97 *
YTD 2022:	7,223.42 *	9,275.99 *	947.53 *	1,895.81 *	3,160.76 *

Monthly Summary By Day Report

Unit CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:58 **Location:** Roseville, CA

Red = Invalid Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Limit Value:

	Unit CT1 CO, Lb 1 Hour(s)	Unit CT1 NOx, Lb 1 Hour(s)	Unit CT1 SO2, Lb 1 Hour(s)	Unit CT1 PM10, Lb 1 Hour(s)	Unit CT1 VOC, Lb 1 Hour(s)
04/01/2022	0.00	0.00	0.0	0.00	0.00
04/02/2022	0.00	0.00	0.0	0.00	0.00
04/03/2022	0.00	0.00	0.0	0.00	0.00
04/04/2022	0.00	0.00	0.0	0.00	0.00
04/05/2022	0.00	0.00	0.0	0.00	0.00
04/06/2022	0.00	0.00	0.0	0.00	0.00
04/07/2022	0.00	0.00	0.0	0.00	0.00
04/08/2022	0.00	0.00	0.0	0.00	0.00
04/09/2022	0.00	0.00	0.0	0.00	0.00
04/10/2022	0.00	0.00	0.0	0.00	0.00
04/11/2022	0.00	0.00	0.0	0.00	0.00
04/12/2022	0.00	0.00	0.0	0.00	0.00
04/13/2022	0.00	0.00	0.0	0.00	0.00
04/14/2022	0.00	0.00	0.0	0.00	0.00
04/15/2022	0.00	0.00	0.0	0.00	0.00
04/16/2022	0.00	0.00	0.0	0.00	0.00
04/17/2022	0.00	0.00	0.0	0.00	0.00
04/18/2022	0.00	0.00	0.0	0.00	0.00
04/19/2022	0.00	0.00	0.0	0.00	0.00
04/20/2022	0.00	0.00	0.0	0.00	0.00
04/21/2022	0.00	0.00	0.0	0.00	0.00
04/22/2022	0.00	0.00	0.0	0.00	0.00
04/23/2022	0.00	0.00	0.0	0.00	0.00
04/24/2022	0.00	0.00	0.0	0.00	0.00
04/25/2022	0.00	0.00	0.0	0.00	0.00
04/26/2022	0.00	0.00	0.0	0.00	0.00
04/27/2022	0.00	0.00	0.0	0.00	0.00
04/28/2022	270.17	11.85	0.0	0.08	0.12
04/29/2022	18.36	18.11	2.2	4.24	7.10
04/30/2022	0.00	0.00	0.0	0.00	0.00
Monthly Avg/Sum*:	288.53 *	29.96 *	2.2 *	4.32 *	7.22 *
Daily Min:	18.36	11.85	0.0	0.08	0.12
Daily Max:	270.17	18.11	2.2	4.24	7.10
Apr 2022 - Apr 2022	288.53	29.96	2.2	4.32	7.22
QTD:	288.53 *	29.96 *	2.2 *	4.32 *	7.22 *
YTD 2022:	2,078.50 *	2,597.09 *	278.0 *	531.24 *	886.79 *

Monthly Summary By Day Report

Unit CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:58 **Location:** Roseville, CA

Red = Invalid Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Limit Value:

	Unit CT1 CO, Lb 1 Hour(s)	Unit CT1 NOx, Lb 1 Hour(s)	Unit CT1 SO2, Lb 1 Hour(s)	Unit CT1 PM10, Lb 1 Hour(s)	Unit CT1 VOC, Lb 1 Hour(s)
05/01/2022	52.77	40.13	3.8	6.59	11.01
05/02/2022	10.05	42.75	5.1	9.28	15.43
05/03/2022	61.98	16.75	0.6	1.25	2.07
05/04/2022	13.01	49.06	5.6	10.93	18.27
05/05/2022	11.94	43.49	5.2	9.74	16.19
05/06/2022	21.45	55.91	6.4	12.17	20.30
05/07/2022	20.88	54.26	6.4	11.98	20.01
05/08/2022	59.58	28.10	2.8	5.04	8.42
05/09/2022	16.63	17.22	2.2	3.65	6.11
05/10/2022	0.00	0.00	0.0	0.00	0.00
05/11/2022	0.00	0.00	0.0	0.00	0.00
05/12/2022	0.00	0.00	0.0	0.00	0.00
05/13/2022	0.00	0.00	0.0	0.00	0.00
05/14/2022	0.00	0.00	0.0	0.00	0.00
05/15/2022	0.00	0.00	0.0	0.00	0.00
05/16/2022	0.00	0.00	0.0	0.00	0.00
05/17/2022	43.98	28.53	2.4	4.49	7.46
05/18/2022	14.11	65.58	7.3	14.39	23.99
05/19/2022	81.59	35.75	2.8	5.88	9.79
05/20/2022	0.00	0.00	0.0	0.00	0.00
05/21/2022	0.00	0.00	0.0	0.00	0.00
05/22/2022	0.00	0.00	0.0	0.00	0.00
05/23/2022	0.00	0.00	0.0	0.00	0.00
05/24/2022	71.78	54.39	4.7	9.66	16.14
05/25/2022	26.34	63.85	6.9	13.80	22.98
05/26/2022	64.56	28.12	2.2	4.30	7.17
05/27/2022	0.00	0.00	0.0	0.00	0.00
05/28/2022	0.00	0.00	0.0	0.00	0.00
05/29/2022	0.00	0.00	0.0	0.00	0.00
05/30/2022	0.00	0.00	0.0	0.00	0.00
05/31/2022	0.00	0.00	0.0	0.00	0.00
Monthly Avg/Sum*:	570.65 *	623.89 *	64.4 *	123.15 *	205.34 *
Daily Min:	10.05	16.75	0.6	1.25	2.07
Daily Max:	81.59	65.58	7.3	14.39	23.99
Apr 2022 - May 2022	859.18	653.85	66.6	127.47	212.56
QTD:	859.18 *	653.85 *	66.6 *	127.47 *	212.56 *
YTD 2022:	2,649.15 *	3,220.98 *	342.4 *	654.39 *	1,092.13 *

Monthly Summary By Day Report

Unit CT1

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:58 **Location:** Roseville, CA

Red = Invalid Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Limit Value:

	Unit CT1 CO, Lb 1 Hour(s)	Unit CT1 NOx, Lb 1 Hour(s)	Unit CT1 SO2, Lb 1 Hour(s)	Unit CT1 PM10, Lb 1 Hour(s)	Unit CT1 VOC, Lb 1 Hour(s)
06/01/2022	0.00	0.00	0.0	0.00	0.00
06/02/2022	0.00	0.00	0.0	0.00	0.00
06/03/2022	0.00	0.00	0.0	0.00	0.00
06/04/2022	0.00	0.00	0.0	0.00	0.00
06/05/2022	0.00	0.00	0.0	0.00	0.00
06/06/2022	21.75	20.16	1.2	2.37	3.94
06/07/2022	0.00	0.00	0.0	0.00	0.00
06/08/2022	64.43	60.43	5.6	10.93	18.23
06/09/2022	18.69	56.88	6.2	12.53	20.89
06/10/2022	18.81	69.58	7.7	15.16	25.24
06/11/2022	11.17	57.56	6.7	12.83	21.41
06/12/2022	20.95	55.88	6.3	12.36	20.59
06/13/2022	11.88	44.03	5.1	9.54	15.93
06/14/2022	13.60	43.17	5.2	9.83	16.42
06/15/2022	22.30	60.18	6.6	12.92	21.55
06/16/2022	25.07	57.53	6.5	12.55	20.90
06/17/2022	30.37	28.62	3.3	6.16	10.27
06/18/2022	0.00	0.00	0.0	0.00	0.00
06/19/2022	0.00	0.00	0.0	0.00	0.00
06/20/2022	48.16	35.81	2.7	5.33	8.90
06/21/2022	13.72	49.30	5.3	9.99	16.67
06/22/2022	16.21	49.45	5.6	10.21	17.03
06/23/2022	19.34	61.18	6.5	12.40	20.71
06/24/2022	17.87	60.29	6.7	13.29	22.12
06/25/2022	31.71	49.46	5.3	10.13	16.89
06/26/2022	40.44	39.23	3.3	6.30	10.51
06/27/2022	13.48	52.87	5.5	10.77	17.92
06/28/2022	12.30	48.36	5.3	9.88	16.49
06/29/2022	19.98	61.89	6.5	12.60	21.05
06/30/2022	15.70	54.15	6.1	11.96	19.91
Monthly Avg/Sum*:	507.93 *	1,116.01 *	119.2 *	230.04 *	383.57 *
Daily Min:	11.17	20.16	1.2	2.37	3.94
Daily Max:	64.43	69.58	7.7	15.16	25.24
Apr 2022 - Jun 2022	1,367.11	1,769.86	185.8	357.51	596.13
QTD:	1,367.11 *	1,769.86 *	185.8 *	357.51 *	596.13 *
YTD 2022:	3,157.08 *	4,336.99 *	461.6 *	884.43 *	1,475.70 *

Monthly Summary By Day Report

Unit CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:55 **Location:** Roseville, CA

Red = Invalid Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Limit Value:

	Unit CT2 CO, Lb 1 Hour(s)	Unit CT2 NOx, Lb 1 Hour(s)	Unit CT2 SO2, Lb 1 Hour(s)	Unit CT2 PM10, Lb 1 Hour(s)	Unit CT2 VOC, Lb 1 Hour(s)
04/01/2022	0.00	0.00	0.0	0.00	0.00
04/02/2022	0.00	0.00	0.0	0.00	0.00
04/03/2022	0.00	0.00	0.0	0.00	0.00
04/04/2022	0.00	0.00	0.0	0.00	0.00
04/05/2022	0.00	0.00	0.0	0.00	0.00
04/06/2022	0.00	0.00	0.0	0.00	0.00
04/07/2022	0.00	0.00	0.0	0.00	0.00
04/08/2022	0.00	0.00	0.0	0.00	0.00
04/09/2022	0.00	0.00	0.0	0.00	0.00
04/10/2022	0.00	0.00	0.0	0.00	0.00
04/11/2022	0.00	0.00	0.0	0.00	0.00
04/12/2022	0.00	0.00	0.0	0.00	0.00
04/13/2022	0.00	0.00	0.0	0.00	0.00
04/14/2022	0.00	0.00	0.0	0.00	0.00
04/15/2022	0.00	0.00	0.0	0.00	0.00
04/16/2022	0.00	0.00	0.0	0.00	0.00
04/17/2022	0.00	0.00	0.0	0.00	0.00
04/18/2022	0.00	0.00	0.0	0.00	0.00
04/19/2022	0.00	0.00	0.0	0.00	0.00
04/20/2022	0.00	0.00	0.0	0.00	0.00
04/21/2022	0.00	0.00	0.0	0.00	0.00
04/22/2022	0.00	0.00	0.0	0.00	0.00
04/23/2022	0.00	0.00	0.0	0.00	0.00
04/24/2022	0.00	0.00	0.0	0.00	0.00
04/25/2022	0.00	0.00	0.0	0.00	0.00
04/26/2022	262.54	37.61	2.2	4.44	7.40
04/27/2022	80.04	42.60	2.7	5.46	9.11
04/28/2022	163.18	36.19	1.8	3.59	5.97
04/29/2022	0.00	0.00	0.0	0.00	0.00
04/30/2022	0.00	0.00	0.0	0.00	0.00
Monthly Avg/Sum*:	505.76 *	116.40 *	6.7 *	13.49 *	22.48 *
Daily Min:	80.04	36.19	1.8	3.59	5.97
Daily Max:	262.54	42.60	2.7	5.46	9.11
Apr 2022 - Apr 2022	505.76	116.40	6.7	13.49	22.48
QTD:	505.76 *	116.40 *	6.7 *	13.49 *	22.48 *
YTD 2022:	2,761.60 *	3,306.25 *	342.8 *	689.21 *	1,147.70 *

Monthly Summary By Day Report

Unit CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:55 **Location:** Roseville, CA

Red = Invalid Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Limit Value:

	Unit CT2 CO, Lb 1 Hour(s)	Unit CT2 NOx, Lb 1 Hour(s)	Unit CT2 SO2, Lb 1 Hour(s)	Unit CT2 PM10, Lb 1 Hour(s)	Unit CT2 VOC, Lb 1 Hour(s)
05/01/2022	0.00	0.00	0.0	0.00	0.00
05/02/2022	0.00	0.00	0.0	0.00	0.00
05/03/2022	28.12	5.20	0.0	0.04	0.07
05/04/2022	18.53	54.10	6.0	11.71	19.52
05/05/2022	17.76	46.35	5.3	10.41	17.34
05/06/2022	28.11	55.56	6.1	12.21	20.40
05/07/2022	27.71	31.93	2.5	4.77	7.97
05/08/2022	16.37	44.42	5.2	9.93	16.55
05/09/2022	24.50	40.38	4.6	8.58	14.25
05/10/2022	0.00	0.00	0.0	0.00	0.00
05/11/2022	0.00	0.00	0.0	0.00	0.00
05/12/2022	0.00	0.00	0.0	0.00	0.00
05/13/2022	0.00	0.00	0.0	0.00	0.00
05/14/2022	0.00	0.00	0.0	0.00	0.00
05/15/2022	0.00	0.00	0.0	0.00	0.00
05/16/2022	0.00	0.00	0.0	0.00	0.00
05/17/2022	57.25	26.18	1.8	3.65	6.07
05/18/2022	19.92	68.98	7.7	15.15	25.22
05/19/2022	36.19	52.16	6.0	12.26	20.40
05/20/2022	0.00	0.00	0.0	0.00	0.00
05/21/2022	0.00	0.00	0.0	0.00	0.00
05/22/2022	0.00	0.00	0.0	0.00	0.00
05/23/2022	0.00	0.00	0.0	0.00	0.00
05/24/2022	40.95	66.50	6.1	12.05	20.08
05/25/2022	2.00	67.63	7.2	14.59	24.31
05/26/2022	0.00	1.24	0.0	0.01	0.02
05/27/2022	0.00	0.00	0.0	0.00	0.00
05/28/2022	0.00	0.00	0.0	0.00	0.00
05/29/2022	0.00	0.00	0.0	0.00	0.00
05/30/2022	0.00	0.00	0.0	0.00	0.00
05/31/2022	0.00	0.00	0.0	0.00	0.00
Monthly Avg/Sum*:	317.41 *	560.63 *	58.5 *	115.36 *	192.20 *
Daily Min:	0.00	1.24	0.0	0.01	0.02
Daily Max:	57.25	68.98	7.7	15.15	25.22
Apr 2022 - May 2022	823.17	677.03	65.2	128.85	214.68
QTD:	823.17 *	677.03 *	65.2 *	128.85 *	214.68 *
YTD 2022:	3,079.01 *	3,866.88 *	401.3 *	804.57 *	1,339.90 *

Monthly Summary By Day Report

Unit CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:55 **Location:** Roseville, CA

Red = Invalid Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Limit Value:

	Unit CT2 CO, Lb 1 Hour(s)	Unit CT2 NOx, Lb 1 Hour(s)	Unit CT2 SO2, Lb 1 Hour(s)	Unit CT2 PM10, Lb 1 Hour(s)	Unit CT2 VOC, Lb 1 Hour(s)
06/01/2022	0.00	0.00	0.0	0.00	0.00
06/02/2022	0.00	0.00	0.0	0.00	0.00
06/03/2022	0.00	0.00	0.0	0.00	0.00
06/04/2022	0.00	0.00	0.0	0.00	0.00
06/05/2022	0.00	0.00	0.0	0.00	0.00
06/06/2022	0.00	0.00	0.0	0.00	0.00
06/07/2022	13.52	0.22	1.6	3.81	6.36
06/08/2022	40.26	36.83	3.1	6.34	10.57
06/09/2022	85.23	50.42	4.5	9.46	15.79
06/10/2022	38.06	72.98	7.7	15.41	25.74
06/11/2022	41.33	66.05	6.8	12.94	21.55
06/12/2022	51.11	47.49	3.9	8.13	13.56
06/13/2022	65.29	19.39	0.9	1.75	2.91
06/14/2022	40.03	26.40	1.7	3.30	5.49
06/15/2022	25.44	63.13	6.7	13.71	22.87
06/16/2022	28.77	62.15	6.6	13.40	22.32
06/17/2022	18.30	49.24	5.4	10.68	17.78
06/18/2022	10.65	43.83	4.9	9.45	15.84
06/19/2022	11.96	42.94	4.8	9.37	15.63
06/20/2022	32.73	54.33	5.4	11.16	18.68
06/21/2022	42.88	24.37	1.3	2.75	4.60
06/22/2022	19.14	51.67	5.6	10.79	18.05
06/23/2022	52.18	39.07	3.2	6.32	10.55
06/24/2022	21.07	64.42	7.0	13.92	23.23
06/25/2022	15.77	55.79	6.0	11.56	19.25
06/26/2022	33.01	50.77	5.3	10.34	17.27
06/27/2022	54.13	38.64	2.7	5.66	9.46
06/28/2022	35.07	24.60	1.5	2.97	4.95
06/29/2022	38.15	46.62	3.6	7.37	12.32
06/30/2022	104.17	40.77	3.1	6.22	10.39
Monthly Avg/Sum*:	918.25 *	1,072.12 *	103.3 *	206.81 *	345.16 *
Daily Min:	10.65	0.22	0.9	1.75	2.91
Daily Max:	104.17	72.98	7.7	15.41	25.74
Apr 2022 - Jun 2022	1,741.42	1,749.15	168.5	335.66	559.84
QTD:	1,741.42 *	1,749.15 *	168.5 *	335.66 *	559.84 *
YTD 2022:	3,997.26 *	4,939.00 *	504.6 *	1,011.38 *	1,685.06 *

ATTACHMENT 19

AQ-63

AQ-63 The Total Facility Emissions shall not exceed the following quarterly emissions rates.

POLLUTANT	Q1 (LBS)	Q2 (LBS)	Q3 (LBS)	Q4 (LBS)	TONS/YEAR
NOX	15546	13412	17646	15572	31.09
CO	27121	33872	28515	30202	59.86
VOC	5832	7455	6672	6890	13.42
PM-10	17854	15513	19378	19158	35.95
SO2	3400	2893	3709	3663	6.83

Verification: The Project owner shall include all necessary emissions data to demonstrate compliance with the emissions limits provided in this Condition as part of the Quarterly Air Quality Report required in Condition of Certification AQ-SC6

Monthly Summary By Day Report

Units CT1 and CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/07/2022 20:28 **Location:** Roseville, CA

Red = Invalid Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Limit Value:

	Units CT1 & CT2 CO, Lb 1 Hour(s)	Units CT1 & CT2 NOx, Lb 1 Hour(s)	Units CT1 & CT2 SO2, Lb 1 Hour(s)	Units CT1 & CT2 PM10, Lb 1 Hour(s)	Units CT1 & CT2 VOC, Lb 1 Hour(s)
04/01/2022	0.00	0.00	0.00	0.00	0.00
04/02/2022	0.00	0.00	0.00	0.00	0.00
04/03/2022	0.00	0.00	0.00	0.00	0.00
04/04/2022	0.00	0.00	0.00	0.00	0.00
04/05/2022	0.00	0.00	0.00	0.00	0.00
04/06/2022	0.00	0.00	0.00	0.00	0.00
04/07/2022	0.00	0.00	0.00	0.00	0.00
04/08/2022	0.00	0.00	0.00	0.00	0.00
04/09/2022	0.00	0.00	0.00	0.00	0.00
04/10/2022	0.00	0.00	0.00	0.00	0.00
04/11/2022	0.00	0.00	0.00	0.00	0.00
04/12/2022	0.00	0.00	0.00	0.00	0.00
04/13/2022	0.00	0.00	0.00	0.00	0.00
04/14/2022	0.00	0.00	0.00	0.00	0.00
04/15/2022	0.00	0.00	0.00	0.00	0.00
04/16/2022	0.00	0.00	0.00	0.00	0.00
04/17/2022	0.00	0.00	0.00	0.00	0.00
04/18/2022	0.00	0.00	0.00	0.00	0.00
04/19/2022	0.00	0.00	0.00	0.00	0.00
04/20/2022	0.00	0.00	0.00	0.00	0.00
04/21/2022	0.00	0.00	0.00	0.00	0.00
04/22/2022	0.00	0.00	0.00	0.00	0.00
04/23/2022	0.00	0.00	0.00	0.00	0.00
04/24/2022	0.00	0.00	0.00	0.00	0.00
04/25/2022	0.00	0.00	0.00	0.00	0.00
04/26/2022	262.54	37.61	2.20	4.44	7.40
04/27/2022	80.04	42.60	2.73	5.46	9.11
04/28/2022	433.35	48.04	1.82	3.67	6.09
04/29/2022	79.88	18.11	2.13	4.24	7.10
04/30/2022	0.00	0.00	0.00	0.00	0.00
Monthly Avg/Sum*:	855.81 *	146.36 *	8.88 *	17.81 *	29.70 *
Daily Min:	79.88	18.11	1.82	3.67	6.09
Daily Max:	433.35	48.04	2.73	5.46	9.11
Apr 2022 - Apr 2022	855.81	146.36	8.88	17.81	29.70
QTD:	855.81 *	146.36 *	8.88 *	17.81 *	29.70 *
YTD 2022:	4,901.62 *	5,903.34 *	609.85 *	1,220.45 *	2,034.49 *

Monthly Summary By Day Report

Units CT1 and CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/07/2022 20:28 **Location:** Roseville, CA

Red = Invalid Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Limit Value:

	Units CT1 & CT2 CO, Lb 1 Hour(s)	Units CT1 & CT2 NOx, Lb 1 Hour(s)	Units CT1 & CT2 SO2, Lb 1 Hour(s)	Units CT1 & CT2 PM10, Lb 1 Hour(s)	Units CT1 & CT2 VOC, Lb 1 Hour(s)
05/01/2022	52.77	40.13	3.31	6.59	11.01
05/02/2022	10.05	42.75	4.62	9.28	15.43
05/03/2022	90.10	21.95	0.64	1.29	2.14
05/04/2022	31.54	103.16	11.32	22.64	37.79
05/05/2022	29.70	89.84	10.06	20.15	33.53
05/06/2022	49.56	111.47	12.17	24.38	40.70
05/07/2022	48.59	86.19	8.41	16.75	27.98
05/08/2022	75.95	72.52	7.47	14.97	24.97
05/09/2022	41.13	57.60	6.11	12.23	20.36
05/10/2022	0.00	0.00	0.00	0.00	0.00
05/11/2022	0.00	0.00	0.00	0.00	0.00
05/12/2022	0.00	0.00	0.00	0.00	0.00
05/13/2022	0.00	0.00	0.00	0.00	0.00
05/14/2022	0.00	0.00	0.00	0.00	0.00
05/15/2022	0.00	0.00	0.00	0.00	0.00
05/16/2022	0.00	0.00	0.00	0.00	0.00
05/17/2022	101.23	54.71	4.07	8.14	13.53
05/18/2022	34.03	134.56	14.78	29.54	49.21
05/19/2022	117.78	87.91	9.04	18.14	30.19
05/20/2022	0.00	0.00	0.00	0.00	0.00
05/21/2022	0.00	0.00	0.00	0.00	0.00
05/22/2022	0.00	0.00	0.00	0.00	0.00
05/23/2022	0.00	0.00	0.00	0.00	0.00
05/24/2022	112.73	120.89	10.86	21.71	36.22
05/25/2022	28.34	131.48	14.17	28.39	47.29
05/26/2022	64.56	29.36	2.16	4.31	7.19
05/27/2022	0.00	0.00	0.00	0.00	0.00
05/28/2022	0.00	0.00	0.00	0.00	0.00
05/29/2022	0.00	0.00	0.00	0.00	0.00
05/30/2022	0.00	0.00	0.00	0.00	0.00
05/31/2022	0.00	0.00	0.00	0.00	0.00
Monthly Avg/Sum*:	888.06 *	1,184.52 *	119.19 *	238.51 *	397.54 *
Daily Min:	10.05	21.95	0.64	1.29	2.14
Daily Max:	117.78	134.56	14.78	29.54	49.21
Apr 2022 - May 2022	1,743.87	1,330.88	128.07	256.32	427.24
QTD:	1,743.87 *	1,330.88 *	128.07 *	256.32 *	427.24 *
YTD 2022:	5,789.68 *	7,087.86 *	729.04 *	1,458.96 *	2,432.03 *

Monthly Summary By Day Report

Units CT1 and CT2

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/07/2022 20:28 **Location:** Roseville, CA

Red = Invalid Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Limit Value:

	Units CT1 & CT2 CO, Lb 1 Hour(s)	Units CT1 & CT2 NOx, Lb 1 Hour(s)	Units CT1 & CT2 SO2, Lb 1 Hour(s)	Units CT1 & CT2 PM10, Lb 1 Hour(s)	Units CT1 & CT2 VOC, Lb 1 Hour(s)
06/01/2022	0.00	0.00	0.00	0.00	0.00
06/02/2022	0.00	0.00	0.00	0.00	0.00
06/03/2022	0.00	0.00	0.00	0.00	0.00
06/04/2022	0.00	0.00	0.00	0.00	0.00
06/05/2022	0.00	0.00	0.00	0.00	0.00
06/06/2022	21.75	20.16	1.18	2.37	3.94
06/07/2022	21.08	0.22	1.91	3.81	6.36
06/08/2022	104.69	97.26	8.63	17.27	28.80
06/09/2022	103.92	107.30	10.99	21.99	36.68
06/10/2022	56.87	142.56	15.27	30.57	50.98
06/11/2022	52.50	123.61	12.90	25.77	42.96
06/12/2022	72.06	103.37	10.25	20.49	34.15
06/13/2022	77.17	63.42	5.64	11.29	18.84
06/14/2022	53.63	69.57	6.57	13.13	21.91
06/15/2022	47.74	123.31	13.33	26.63	44.42
06/16/2022	53.84	119.68	13.02	25.95	43.22
06/17/2022	48.67	77.86	8.41	16.84	28.05
06/18/2022	10.65	43.83	4.72	9.45	15.84
06/19/2022	11.96	42.94	4.67	9.37	15.63
06/20/2022	80.89	90.14	8.25	16.49	27.58
06/21/2022	56.60	73.67	6.38	12.74	21.27
06/22/2022	35.35	101.12	10.46	21.00	35.08
06/23/2022	71.52	100.25	9.40	18.72	31.26
06/24/2022	38.94	124.71	13.61	27.21	45.35
06/25/2022	47.48	105.25	10.82	21.69	36.14
06/26/2022	73.45	90.00	8.34	16.64	27.78
06/27/2022	67.61	91.51	8.22	16.43	27.38
06/28/2022	47.37	72.96	6.44	12.85	21.44
06/29/2022	58.13	108.51	10.00	19.97	33.37
06/30/2022	119.87	94.92	9.08	18.18	30.30
Monthly Avg/Sum*:	1,433.74 *	2,188.13 *	218.49 *	436.85 *	728.73 *
Daily Min:	10.65	0.22	1.18	2.37	3.94
Daily Max:	119.87	142.56	15.27	30.57	50.98
Apr 2022 - Jun 2022	3,177.61	3,519.01	346.56	693.17	1,155.97
QTD:	3,177.61 *	3,519.01 *	346.56 *	693.17 *	1,155.97 *
YTD 2022:	7,223.42 *	9,275.99 *	947.53 *	1,895.81 *	3,160.76 *

Tons 12 Month Rolling Summary

CT1 and CT2 Combined

From: 04/01/2022 00:00 **To:** 06/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY

Generated: 07/08/2022 00:43 **Location:** Roseville, CA

* = Excess Emission

	Units CT1 & CT2		Units CT1 & CT2		Units CT1 & CT2		Units CT1 & CT2		Units CT1 & CT2	
Date	CO, Ton 1 Day(s)		NOx, Ton 1 Day(s)		PM10, Ton 1 Day(s)		SO2, Ton 1 Day(s)		VOC, Ton 1 Day(s)	
	Sum	Rolling Sum	Sum	Rolling Sum	Sum	Rolling Sum	Sum	Rolling Sum	Sum	Rolling Sum
Apr 2022	0.4279	6.9825	0.0732	14.0559	0.0088	2.9936	0.0045	1.4962	0.0149	4.9895
May 2022	0.4443	6.8879	0.5924	13.9853	0.1194	2.9870	0.0596	1.4929	0.1989	4.9780
Jun 2022	0.7168	6.7270	1.0943	13.6989	0.2183	2.9175	0.1092	1.4584	0.3644	4.8627
Sum/Avg	6.7270		13.6989		2.9175		1.4584		4.8627	
Limit Value										

Replace the dates with the ones you need

4/1/2022 0:00
6/30/2022 0:00

1D

TOWER AVG.

2030

	519-AIT-9504-1
4/1/22 0:00	1444.6
4/2/22 0:00	1297.4
4/3/22 0:00	1300.2
4/4/22 0:00	1204.7
4/5/22 0:00	1199.1
4/6/22 0:00	1165.5
4/7/22 0:00	1215.4
4/8/22 0:00	1262.5
4/9/22 0:00	1284.4
4/10/22 0:00	1162.4
4/11/22 0:00	1151.1
4/12/22 0:00	1119.1
4/13/22 0:00	1116.2
4/14/22 0:00	1118.7
4/15/22 0:00	1173.8
4/16/22 0:00	1215.6
4/17/22 0:00	1214.0
4/18/22 0:00	1180.2
4/19/22 0:00	1190.7
4/20/22 0:00	1204.0
4/21/22 0:00	1217.5
4/22/22 0:00	1196.3
4/23/22 0:00	1149.6
4/24/22 0:00	1096.5
4/25/22 0:00	1048.7
4/26/22 0:00	943.6
4/27/22 0:00	1315.8
4/28/22 0:00	1264.3
4/29/22 0:00	1311.7
4/30/22 0:00	1347.7
5/1/22 0:00	1183.8
5/2/22 0:00	1711.9
5/3/22 0:00	2038.6
5/4/22 0:00	1409.2
5/5/22 0:00	2151.5
5/6/22 0:00	2445.2
5/7/22 0:00	2293.1
5/8/22 0:00	2490.3
5/9/22 0:00	2728.0
5/10/22 0:00	2537.0
5/11/22 0:00	1721.9
5/12/22 0:00	1506.2
5/13/22 0:00	1383.1
5/14/22 0:00	1351.4
5/15/22 0:00	1329.0
5/16/22 0:00	1259.4
5/17/22 0:00	1184.3
5/18/22 0:00	1712.3
5/19/22 0:00	2439.8

5/20/22 0:00	2837.5
5/21/22 0:00	1953.6
5/22/22 0:00	1845.5
5/23/22 0:00	2055.0
5/24/22 0:00	1840.0
5/25/22 0:00	2779.4
5/26/22 0:00	3165.7
5/27/22 0:00	2496.1
5/28/22 0:00	2209.1
5/29/22 0:00	1988.4
5/30/22 0:00	1860.4
5/31/22 0:00	1419.9
6/1/22 0:00	1343.2
6/2/22 0:00	1318.8
6/3/22 0:00	1531.4
6/4/22 0:00	1438.6
6/5/22 0:00	1368.3
6/6/22 0:00	1420.1
6/7/22 0:00	1260.1
6/8/22 0:00	1581.8
6/9/22 0:00	2299.8
6/10/22 0:00	2780.5
6/11/22 0:00	3109.5
6/12/22 0:00	3394.0
6/13/22 0:00	3224.0
6/14/22 0:00	3382.3
6/15/22 0:00	3125.6
6/16/22 0:00	3606.2
6/17/22 0:00	3361.0
6/18/22 0:00	3638.1
6/19/22 0:00	4034.3
6/20/22 0:00	3883.6
6/21/22 0:00	3472.5
6/22/22 0:00	3245.6
6/23/22 0:00	3617.1
6/24/22 0:00	3635.9
6/25/22 0:00	3525.5
6/26/22 0:00	3899.7
6/27/22 0:00	3984.8
6/28/22 0:00	3634.5
6/29/22 0:00	3508.6
6/30/22 0:00	3659.7

ROSEVILLE ENERGY PARK COOLING TOWER EMISSIONS

POLLUTANT	LBS PER DAY	QUARTER 1	QUARTER 2	QUARTER 3	QUARTER 4
PM-10	16.3	1471	1487	1504	1504

Whereas compliance with the PM-10 emission limit shall be demonstrated as;
Cooling tower recirculation rate * total dissolved solids of blowdown ***** design drift rate

	53814	Gallons per minute
	* 8.33	Pounds per gallon
	* 1440	Minutes per day
Circ pump flow rate	**64,550,969**	Pounds per day

	2030	Average daily conductivity umhos
	0.00000064	Conversion to TDS ppm
Total dissolved solids	**0.0012992**	

Design drift rate	**0.005%**
PM-10 pounds per day	**4.19**
	91 Days in quarter
PM-10 pounds this quarter	**382**

2Q22

fill only these

ATTACHMENT 20

AQ-68

AQ-68: A water sample analysis of cooling tower water shall be performed within 180 days of initial operation and annually thereafter.

Verification: The Project owner shall submit to the CPM and the PCAPCD the initial and annual cooling tower water sample analysis for approval no later than 60 days following the date of test performance.

The Cooling Tower Water Analysis was last reported with the 2Q21 QAQR.

ATTACHMENT 21

AQ-69

AQ-69 No emissions are permitted, from any source, which are a nuisance per PCAPCD Rule 205, Nuisance.

Verification: The Project owner shall report all violations of this condition as noticed by the PCAPCD as well as any offsite nuisance complaints as part of the Quarterly Air Quality Report in Condition of Certification AQ-SC6

In regards to AQ-69 of Roseville Energy Park's 2Q22 QAQR, there were no violations of PCAPCD's Rule 205 for nuisance.

ATTACHMENT 22

AQ-70

AQ-70 PM-10 emission rates from the cooling tower shall not exceed the following limits

Cooling Tower Emissions Limitations					
Pollutant	Lbs/day	Quarter 1	Quarter 2	Quarter 3	Quarter 4
PM 10	16.3	1471	1487	1504	1504

Verification: the Project owner shall include all the necessary emissions data to demonstrate compliance with the emissions limits provided in this Condition as part of the Quarterly air Quality Report required in condition of Certification AQ-SC6.

Replace the dates with the ones you need

4/1/2022 0:00
6/30/2022 0:00

1D

TOWER AVG.

2030

	519-AIT-9504-1
4/1/22 0:00	1444.6
4/2/22 0:00	1297.4
4/3/22 0:00	1300.2
4/4/22 0:00	1204.7
4/5/22 0:00	1199.1
4/6/22 0:00	1165.5
4/7/22 0:00	1215.4
4/8/22 0:00	1262.5
4/9/22 0:00	1284.4
4/10/22 0:00	1162.4
4/11/22 0:00	1151.1
4/12/22 0:00	1119.1
4/13/22 0:00	1116.2
4/14/22 0:00	1118.7
4/15/22 0:00	1173.8
4/16/22 0:00	1215.6
4/17/22 0:00	1214.0
4/18/22 0:00	1180.2
4/19/22 0:00	1190.7
4/20/22 0:00	1204.0
4/21/22 0:00	1217.5
4/22/22 0:00	1196.3
4/23/22 0:00	1149.6
4/24/22 0:00	1096.5
4/25/22 0:00	1048.7
4/26/22 0:00	943.6
4/27/22 0:00	1315.8
4/28/22 0:00	1264.3
4/29/22 0:00	1311.7
4/30/22 0:00	1347.7
5/1/22 0:00	1183.8
5/2/22 0:00	1711.9
5/3/22 0:00	2038.6
5/4/22 0:00	1409.2
5/5/22 0:00	2151.5
5/6/22 0:00	2445.2
5/7/22 0:00	2293.1
5/8/22 0:00	2490.3
5/9/22 0:00	2728.0
5/10/22 0:00	2537.0
5/11/22 0:00	1721.9
5/12/22 0:00	1506.2
5/13/22 0:00	1383.1
5/14/22 0:00	1351.4
5/15/22 0:00	1329.0
5/16/22 0:00	1259.4
5/17/22 0:00	1184.3
5/18/22 0:00	1712.3
5/19/22 0:00	2439.8

5/20/22 0:00	2837.5
5/21/22 0:00	1953.6
5/22/22 0:00	1845.5
5/23/22 0:00	2055.0
5/24/22 0:00	1840.0
5/25/22 0:00	2779.4
5/26/22 0:00	3165.7
5/27/22 0:00	2496.1
5/28/22 0:00	2209.1
5/29/22 0:00	1988.4
5/30/22 0:00	1860.4
5/31/22 0:00	1419.9
6/1/22 0:00	1343.2
6/2/22 0:00	1318.8
6/3/22 0:00	1531.4
6/4/22 0:00	1438.6
6/5/22 0:00	1368.3
6/6/22 0:00	1420.1
6/7/22 0:00	1260.1
6/8/22 0:00	1581.8
6/9/22 0:00	2299.8
6/10/22 0:00	2780.5
6/11/22 0:00	3109.5
6/12/22 0:00	3394.0
6/13/22 0:00	3224.0
6/14/22 0:00	3382.3
6/15/22 0:00	3125.6
6/16/22 0:00	3606.2
6/17/22 0:00	3361.0
6/18/22 0:00	3638.1
6/19/22 0:00	4034.3
6/20/22 0:00	3883.6
6/21/22 0:00	3472.5
6/22/22 0:00	3245.6
6/23/22 0:00	3617.1
6/24/22 0:00	3635.9
6/25/22 0:00	3525.5
6/26/22 0:00	3899.7
6/27/22 0:00	3984.8
6/28/22 0:00	3634.5
6/29/22 0:00	3508.6
6/30/22 0:00	3659.7

ROSEVILLE ENERGY PARK COOLING TOWER EMISSIONS

POLLUTANT	LBS PER DAY	QUARTER 1	QUARTER 2	QUARTER 3	QUARTER 4
PM-10	16.3	1471	1487	1504	1504

Whereas compliance with the PM-10 emission limit shall be demonstrated as;
Cooling tower recirculation rate * total dissolved solids of blowdown ***** design drift rate

	53814	Gallons per minute
	* 8.33	Pounds per gallon
	* 1440	Minutes per day
Circ pump flow rate	**64,550,969**	Pounds per day

	2030	Average daily conductivity umhos
	0.00000064	Conversion to TDS ppm
Total dissolved solids	**0.0012992**	

Design drift rate	**0.005%**
PM-10 pounds per day	**4.19**
	91 Days in quarter
PM-10 pounds this quarter	**382**

2Q22

fill only these

ATTACHMENT 23

AQ-71

AQ-71 Compliance with the cooling tower PM-10 emission limit shall be demonstrated as follows: PM-10 = cooling water recirculation rate* total dissolved solids concentration in the blow own water* design drift rate.

Verification: the Project owner shall include all the necessary emissions data to demonstrate compliance with the emissions limits provided in this Condition as part of the Quarterly air Quality Report required in condition of Certification AQ-SC6.

Replace the dates with the ones you need

4/1/2022 0:00
6/30/2022 0:00

1D

TOWER AVG.

2030

	519-AIT-9504-1
4/1/22 0:00	1444.6
4/2/22 0:00	1297.4
4/3/22 0:00	1300.2
4/4/22 0:00	1204.7
4/5/22 0:00	1199.1
4/6/22 0:00	1165.5
4/7/22 0:00	1215.4
4/8/22 0:00	1262.5
4/9/22 0:00	1284.4
4/10/22 0:00	1162.4
4/11/22 0:00	1151.1
4/12/22 0:00	1119.1
4/13/22 0:00	1116.2
4/14/22 0:00	1118.7
4/15/22 0:00	1173.8
4/16/22 0:00	1215.6
4/17/22 0:00	1214.0
4/18/22 0:00	1180.2
4/19/22 0:00	1190.7
4/20/22 0:00	1204.0
4/21/22 0:00	1217.5
4/22/22 0:00	1196.3
4/23/22 0:00	1149.6
4/24/22 0:00	1096.5
4/25/22 0:00	1048.7
4/26/22 0:00	943.6
4/27/22 0:00	1315.8
4/28/22 0:00	1264.3
4/29/22 0:00	1311.7
4/30/22 0:00	1347.7
5/1/22 0:00	1183.8
5/2/22 0:00	1711.9
5/3/22 0:00	2038.6
5/4/22 0:00	1409.2
5/5/22 0:00	2151.5
5/6/22 0:00	2445.2
5/7/22 0:00	2293.1
5/8/22 0:00	2490.3
5/9/22 0:00	2728.0
5/10/22 0:00	2537.0
5/11/22 0:00	1721.9
5/12/22 0:00	1506.2
5/13/22 0:00	1383.1
5/14/22 0:00	1351.4
5/15/22 0:00	1329.0
5/16/22 0:00	1259.4
5/17/22 0:00	1184.3
5/18/22 0:00	1712.3
5/19/22 0:00	2439.8

5/20/22 0:00	2837.5
5/21/22 0:00	1953.6
5/22/22 0:00	1845.5
5/23/22 0:00	2055.0
5/24/22 0:00	1840.0
5/25/22 0:00	2779.4
5/26/22 0:00	3165.7
5/27/22 0:00	2496.1
5/28/22 0:00	2209.1
5/29/22 0:00	1988.4
5/30/22 0:00	1860.4
5/31/22 0:00	1419.9
6/1/22 0:00	1343.2
6/2/22 0:00	1318.8
6/3/22 0:00	1531.4
6/4/22 0:00	1438.6
6/5/22 0:00	1368.3
6/6/22 0:00	1420.1
6/7/22 0:00	1260.1
6/8/22 0:00	1581.8
6/9/22 0:00	2299.8
6/10/22 0:00	2780.5
6/11/22 0:00	3109.5
6/12/22 0:00	3394.0
6/13/22 0:00	3224.0
6/14/22 0:00	3382.3
6/15/22 0:00	3125.6
6/16/22 0:00	3606.2
6/17/22 0:00	3361.0
6/18/22 0:00	3638.1
6/19/22 0:00	4034.3
6/20/22 0:00	3883.6
6/21/22 0:00	3472.5
6/22/22 0:00	3245.6
6/23/22 0:00	3617.1
6/24/22 0:00	3635.9
6/25/22 0:00	3525.5
6/26/22 0:00	3899.7
6/27/22 0:00	3984.8
6/28/22 0:00	3634.5
6/29/22 0:00	3508.6
6/30/22 0:00	3659.7

ROSEVILLE ENERGY PARK COOLING TOWER EMISSIONS

POLLUTANT	LBS PER DAY	QUARTER 1	QUARTER 2	QUARTER 3	QUARTER 4
PM-10	16.3	1471	1487	1504	1504

Whereas compliance with the PM-10 emission limit shall be demonstrated as;
Cooling tower recirculation rate * total dissolved solids of blowdown ***** design drift rate

	53814	Gallons per minute
	* 8.33	Pounds per gallon
	* 1440	Minutes per day
Circ pump flow rate	**64,550,969**	Pounds per day

	2030	Average daily conductivity umhos
	0.00000064	Conversion to TDS ppm
Total dissolved solids	**0.0012992**	

Design drift rate	**0.005%**
PM-10 pounds per day	**4.19**
	91 Days in quarter
PM-10 pounds this quarter	**382**

2Q22

fill only these

ATTACHMENT 24

AQ-86

AQ-86 Operation for maintenance and testing of the emergency diesel engine and generator shall be limited to 50 hours per year.

Verification: The Project owner shall include all necessary operational data to demonstrate compliance with the limits provided in this Condition as part of the Quarterly Air Quality Report required in Condition of Certification AQ-SC6.

DATE	TECH	TIME START	S/O	RUN TIME TOTAL HRS.	RUN TIME YTD minutes
8-26-2020	KRB	01:00	01:30	108	301
11-13-2020	RC	1538 - BI WEEKLY TEST -	1610	109	333
10/4/20	DE	1323 - 1400 - Test Run		109	370
10/22/20	[illegible]	DIESEL DELIVERY 64 GALS			
11/1/2020	KRB	13:01	13:31 Bi Weekly test	110	400
11/29/20	[illegible]	1444	1514 BIWEEKLY TEST RUN	110	430
12-20-2020	[illegible]	1650 - 1720 BI-WEEKLY TEST RUN		111	460
		2021			
1-9-21	DWN	14:00 - 14:30 Bi-Weekly Test		111	30
2-3-21	[illegible]	Diesel Filled 355 gallons			~~60~~
3-28-2021	[illegible]	1319 - 1349 BI-WEEKLY TEST RUN		112	60
4-25-2021	[illegible]	1320 - 1350 BI-WEEKLY TEST RUN		112	90
5-23-2021	[illegible]	1435 - 1505 BI-WEEKLY TEST RUN		113	120
6-14-2021	KRB	1034 - 1104 Bi-Weekly Test Run		113	150
6-25-2021	CO & POWER	10:50 - 11:00 ANN. SVC		114	160
6/20/2021	[illegible]	0452 - 0528 Bi-Weekly Test Run		114	196
8-19-21	[illegible]	1139 Bi-weekly test Run		115	229
9-01-2021	[illegible]	1338 Bi-weekly test Run Annual PCAPCO		115	255
9-5-21	[illegible]	1604 BI-WEEKLY TEST RUN 1638		115	265
10-3-21	KRB	1405 Bi-Weekly Test Rund 1435		116	285
10-30-21	[illegible]	1319 Bi-Weekly Test Run	1348	116	325
11/21/21	DE	1045 BI-WEEKLY TEST RUN	1115	117	355
12/24/21	DE	1354 BI-WEEKLY TEST RUN	1424	117	385
		2022		Starting Hours 117	
1/10/22	DE	0225 BI-WEEKLY TEST RUN	0255	118	30
1/28/22	KRB	1136 Bi-weekly test run 1206		118	60
2-3-22	[illegible]	1630 Bi-weekly test run	1700	119	90
02-15-22	[illegible]	1636 Bi-Weekly Test Run	1711	120	125
3-5-22	[illegible]	1539 Bi weekly test Run	1608	120	155
3-19-22	[illegible]	15:43 Bi weekly Test Run	1613	121	185
4-3-22	DWN	1540 Bi-Weekly Test Run	1610	121	215
4-30-22	[illegible]	1100 Bi weekly test Run	1130	122	245
5-15-22	ED.	14:01 BI-WEEKLY TEST RUN	14:31	122	275
5-27-22	DWN	1240 Bi-Weekly Test Run	1310	123	305
6-11-22	KRB	1435 Bi-Weekly test Run,	1505	124	335
6-26-22	[illegible]	1529 BI-WEEKLY TEST RUN	1559	124	365

ATTACHMENT 25

AQ-87

AQ-87 Operation for other than maintenance and testing purposes shall be limited to involuntary interruptions of electrical power. Operation shall not exceed 24 hours without prior authorization by the Air Pollution Control Officer.

Verification: The Project owner shall include all necessary operational data to demonstrate compliance with the limits provided in this Condition as part of the Quarterly Air Quality Report required in Condition of Certification AQ-SC6.

DATE	START	REASON	STOP	TOTAL HRS	YTD	INITIALS
4-3-22	1500	Weekly Test Run	1530	228.1	7.0	DWN
4.30.22	0855	Weekly test Run	0925	230.1	9.0	JB
5-8-22	1444	Weekly Test Run	1512	230.6	9.5	ZHR
5-15-22	14:55	WEEKLY TEST RUN	15:25	231.1	10.0	EO.
5-22-2022	1311	WEEKLY TEST RUN	1341	231.6	10.5	JAB
5.28.22	1516	Weekly test Run	1546	232.1	11	JB
6.5.22	1440	WEEKLY TEST RUN	1510	232.6	11.5	RC
6-12-22	16:20	WEEKLY Test Run	16:50	233.1	12.0	LH
6.20.22	1520	WEEKLY TEST RUN	1550	233.6	12.5	RC
6.25.22	1042	Weekly test Run	1112	234.1	13	JB
7/3/22	1326	WEEKLY TEST RUN	1356	234.6	13.5	DE

ATTACHMENT 26

AQ-88

AQ-88 The Sulfur content of the Diesel fuel used shall not exceed 15 ppm by weight.

Verification: The Project owner shall include a summary of diesel fuel purchase records showing amounts delivered, date delivered and fuel type with the Quarterly Air Quality Report as required in Condition of Certification AQ-SC6.

ATTACHMENT 27

AQ-89

AQ-89 Records of operation and maintenance shall be kept by the owner or Operator for a period of five years and shall be made available to the PCAPCD upon request. Information required for reporting to the PCAPCD includes, but is not limited to:

1. The hours of operation the engine was run for maintenance and testing;
2. The hours of operation the engine was run during interruption of electrical power; and
3. Records of the sulfur content of the diesel used.

VERIFICATION: The Project owner shall include these records as part of the Quarterly Air Quality Report required in Condition of Certification AQ-SC6.

DATE	TECH	TIME START	S/O	RUN TIME TOTAL HRS.	RUN TIME YTD minutes
8-26-2020	KRB	01:00	01:30	108	301
11-13-2020	RC	1538 - BI WEEKLY TEST -	1610	109	333
10/4/20	DE	1323 - 1400 - Test Run		109	370
10/22/20	[illegible]	DIESEL DELIVERY 64 GALS			
11/1/2020	KRB	13:01	13:31 Bi Weekly test	110	400
11/29/20	[illegible]	1444	1514 BIWEEKLY TEST RUN	110	430
12-20-2020	[illegible]	1650 - 1720 BI-WEEKLY TEST RUN		111	460
		2021			
1-9-21	DWN	14:00 - 14:30 Bi-Weekly Test		111	30
2-3-21	[illegible]	Diesel Filled 355 gallons			~~60~~
3-28-2021	[illegible]	1319 - 1349 BI-WEEKLY TEST RUN		112	60
4-25-2021	[illegible]	1320 - 1350 BI-WEEKLY TEST RUN		112	90
5-23-2021	[illegible]	1435 - 1505 BI-WEEKLY TEST RUN		113	120
6-14-2021	KRB	1034 - 1104 Bi-Weekly Test Run		113	150
6-25-2021	CO & POWER	10:50 - 11:00 ANN. SVC		114	160
6/20/2021	[illegible]	0452 - 0528 Bi-Weekly Test Run		114	196
8-19-21	[illegible]	1139 Bi-weekly test Run		115	229
9-01-2021	[illegible]	1338 Bi-weekly test Run Annual PCAPCO		115	255
9-5-21	[illegible]	1604 BI-WEEKLY TEST RUN 1638		115	265
10-3-21	KRB	1405 Bi-Weekly Test Rund 1435		116	285
10-30-21	[illegible]	1319 Bi-Weekly Test Run	1348	116	325
11/21/21	DE	1045 BI-WEEKLY TEST RUN	1115	117	355
12/24/21	DE	1354 BI-WEEKLY TEST RUN	1424	117	385
		2022		Starting Hours 117	
1/10/22	DE	0225 BI-WEEKLY TEST RUN	0255	118	30
1/28/22	KRB	1136 Bi-weekly test run 1206		118	60
2-3-22	[illegible]	1630 Bi-weekly test run	1700	119	90
02-15-22	[illegible]	1636 Bi-Weekly Test Run	1711	120	125
3-5-22	[illegible]	1539 Bi weekly test Run	1608	120	155
3-19-22	[illegible]	15:43 Bi weekly Test Run	1613	121	185
4-3-22	DWN	1540 Bi-Weekly Test Run	1610	121	215
4-30-22	[illegible]	1100 Bi weekly test Run	1130	122	245
5-15-22	ED.	14:01 BI-WEEKLY TEST RUN	14:31	122	275
5-27-22	DWN	1240 Bi-Weekly Test Run	1310	123	305
6-11-22	KRB	1435 Bi-Weekly test Run,	1505	124	335
6-26-22	[illegible]	1529 BI-WEEKLY TEST RUN	1559	124	365

ATTACHMENT 28

AQ-90

AQ-90 No emissions are permitted, from any source, which are a nuisance per PCAPCD Rule 205, Nuisance.

Verification: The Project owner shall report all violations of this condition as noticed by the PCAPCD as well as any offsite nuisance complaints as part of the Quarterly Air Quality Report in Condition of Certification AQ-SC6.

In regards to AQ-90of Roseville Energy Park's 2Q22 QAQR, there were no violations of PCAPCD's Rule 205 for nuisance.

ATTACHMENT 29

AQ-91

AQ-91 Stack emission opacity as dark as Ringelmann No. 1 (20% opacity) for periods aggregating more than 3 minutes in any one hour is prohibited and is in violation of PCAPCD Rule 202, Visible Emissions.

Verification: The Project owner shall report all violations of this condition as noticed by the PCAPCD as well as any offsite nuisance complaints as part of the Quarterly Air Quality Report in Condition of Certification AQ-SC6.

In regards to AQ-91of Roseville Energy Park's 2Q22 QAQR, there were no violations of PCAPCD's Rule 202 for opacity from the diesel fire pump.

ATTACHMENT 30

AQ-99

AQ-99 Operation for maintenance and testing of the emergency diesel engine and generator shall be limited to 50 hours per year.

Verification: The Project shall include all necessary operational data to demonstrate compliance with the limits provided as part of the Quarterly Air Quality Report in Condition of Certification AQ-SC6

DATE	TECH	TIME START	S/O	RUN TIME TOTAL HRS.	RUN TIME YTD minutes
8-26-2020	KRB	01:00	01:30	108	301
11-13-2020	RC	1538 - BI WEEKLY TEST -	1610	109	333
10/4/20	DE	1323 - 1400 - Test Run		109	370
10/22/20	[illegible]	DIESEL DELIVERY 64 GALS			
11/1/2020	KRB	13:01	13:31 Bi Weekly test	110	400
11/29/20	[illegible]	1444	1514 BIWEEKLY TEST RUN	110	430
12-20-2020	[illegible]	1650 - 1720 BI-WEEKLY TEST RUN		111	460
		2021			
1-9-21	DWN	14:00 - 14:30 Bi-Weekly Test		111	30
2-3-21	[illegible]	Diesel Filled 355 gallons			~~60~~
3-28-2021	[illegible]	1319 - 1349 BI-WEEKLY TEST RUN		112	60
4-25-2021	[illegible]	1320 - 1350 BI-WEEKLY TEST RUN		112	90
5-23-2021	[illegible]	1435 - 1505 BI-WEEKLY TEST RUN		113	120
6-14-2021	KRB	1034 - 1104 Bi-Weekly Test Run		113	150
6-25-2021	CO & POWER	10:50 - 11:00 ANN. SVC		114	160
6/20/2021	[illegible]	0452 - 0528 Bi-Weekly Test Run		114	196
8-19-21	[illegible]	1139 Bi-weekly test Run		115	229
9-01-2021	[illegible]	1338 Bi-weekly test Run Annual PCAPCO		115	255
9-5-21	[illegible]	1604 BI-WEEKLY TEST RUN 1638		115	265
10-3-21	KRB	1405 Bi-Weekly Test Rund 1435		116	285
10-30-21	[illegible]	1319 Bi-Weekly Test Run	1348	116	325
11/21/21	DE	1045 BI-WEEKLY TEST RUN	1115	117	355
12/24/21	DE	1354 BI-WEEKLY TEST RUN	1424	117	385
		2022		Starting Hours 117	
1/10/22	DE	0225 BI-WEEKLY TEST RUN	0255	118	30
1/28/22	KRB	1136 Bi-weekly test run 1206		118	60
2-3-22	[illegible]	1630 Bi-weekly test run	1700	119	90
02-15-22	[illegible]	1636 Bi-Weekly Test Run	1711	120	125
3-5-22	[illegible]	1539 Bi weekly test Run	1608	120	155
3-19-22	[illegible]	15:43 Bi weekly Test Run	1613	121	185
4-3-22	DWN	1540 Bi-Weekly Test Run	1610	121	215
4-30-22	[illegible]	1100 Bi weekly test Run	1130	122	245
5-15-22	ED.	14:01 BI-WEEKLY TEST RUN	14:31	122	275
5-27-22	DWN	1240 Bi-Weekly Test Run	1310	123	305
6-11-22	KRB	1435 Bi-Weekly test Run,	1505	124	335
6-26-22	[illegible]	1529 BI-WEEKLY TEST RUN	1559	124	365

ATTACHMENT 31

AQ-100

AQ-100 In regards to the Emergency diesel Generator; Operation for other than maintenance and testing purposes shall be limited to involuntary interruptions of electrical power. Operation shall not exceed 24 hours without prior authorization by the Air Pollution Control Officer.

DATE	TECH	TIME START	S/O	RUN TIME TOTAL HRS.	RUN TIME YTD minutes
8-26-2020	KRB	01:00	01:30	108	301
11-13-2020	RC	1538 - BI WEEKLY TEST -	1610	109	333
10/4/20	DE	1323 - 1400 - Test Run		109	370
10/22/20	[illegible]	DIESEL DELIVERY 64 GALS			
11/1/2020	KRB	13:01	13:31 Bi Weekly test	110	400
11/29/20	[illegible]	1444	1514 BIWEEKLY TEST RUN	110	430
12-20-2020	[illegible]	1650 - 1720 BI-WEEKLY TEST RUN		111	460
		2021			
1-9-21	DWN	14:00 - 14:30 Bi-Weekly Test		111	30
2-3-21	[illegible]	Diesel Filled 355 gallons			~~60~~
3-28-2021	[illegible]	1319 - 1349 BI-WEEKLY TEST RUN		112	60
4-25-2021	[illegible]	1320 - 1350 BI-WEEKLY TEST RUN		112	90
5-23-2021	[illegible]	1435 - 1505 BI-WEEKLY TEST RUN		113	120
6-14-2021	KRB	1034 - 1104 Bi-Weekly Test Run		113	150
6-25-2021	CO & POWER	10:50 - 11:00 ANN. SVC		114	160
6/20/2021	[illegible]	0452 - 0528 Bi-Weekly Test Run		114	196
8-19-21	[illegible]	1139 Bi-weekly test Run		115	229
9-01-2021	[illegible]	1338 Bi-weekly test Run Annual PCAPCO		115	255
9-5-21	[illegible]	1604 BI-WEEKLY TEST RUN 1638		115	265
10-3-21	KRB	1405 Bi-Weekly Test Rund 1435		116	285
10-30-21	[illegible]	1319 Bi-Weekly Test Run	1348	116	325
11/21/21	DE	1045 BI-WEEKLY TEST RUN	1115	117	355
12/24/21	DE	1354 BI-WEEKLY TEST RUN	1424	117	385
		2022		Starting Hours 117	
1/10/22	DE	0225 BI-WEEKLY TEST RUN	0255	118	30
1/28/22	KRB	1136 Bi-weekly test run 1206		118	60
2-3-22	[illegible]	1630 Bi-weekly test run	1700	119	90
02-15-22	[illegible]	1636 Bi-Weekly Test Run	1711	120	125
3-5-22	[illegible]	1539 Bi weekly test Run	1608	120	155
3-19-22	[illegible]	15:43 Bi weekly Test Run	1613	121	185
4-3-22	DWN	1540 Bi-Weekly Test Run	1610	121	215
4-30-22	[illegible]	1100 Bi weekly test Run	1130	122	245
5-15-22	ED.	14:01 BI-WEEKLY TEST RUN	14:31	122	275
5-27-22	DWN	1240 Bi-Weekly Test Run	1310	123	305
6-11-22	KRB	1435 Bi-Weekly test Run,	1505	124	335
6-26-22	[illegible]	1529 BI-WEEKLY TEST RUN	1559	124	365

ATTACHMENT 32

AQ-101

AQ-101 The sulfur content of the diesel used shall not exceed 15ppm by weight

Verification: The Project owner shall include a summary of diesel fuel purchase records showing amounts delivered, date delivered and fuel type with the Quarterly Air Quality Report in Condition of Certification AQ-SC6

ATTACHMENT 33

AQ-102

AQ-102 Records of operation and maintenance shall be kept by the owner or operator for a period of five years and shall be made available to the PCAPCD by request. Information required for reporting to the PCAPCD includes, but is not limited to:

A. Hours of operation the engine was run for maintenance and testing
B. Hours of operation the engine was run during interruption of electrical power
C. Records of sulfur content of the diesel fuel used

Verification: The Project owner shall include these records as part of the Quarterly Air Quality Report in Condition of Certification AQ-SC6

DATE	TECH	TIME START	S/O	RUN TIME TOTAL HRS.	RUN TIME YTD minutes
8-26-2020	KRB	01:00	01:30	108	301
11-13-2020	RC	1538 - BI WEEKLY TEST -	1610	109	333
10/4/20	DE	1323 - 1400 - Test Run		109	370
10/22/20	[illegible]	DIESEL DELIVERY 64 GALS			
11/1/2020	KRB	13:01	13:31 Bi Weekly test	110	400
11/29/20	[illegible]	1444	1514 BIWEEKLY TEST RUN	110	430
12-20-2020	[illegible]	1650 - 1720 BI-WEEKLY TEST RUN		111	460
		2021			
1-9-21	DWN	14:00 - 14:30 Bi-Weekly Test		111	30
2-3-21	[illegible]	Diesel Filled 355 gallons			~~60~~
3-28-2021	[illegible]	1319 - 1349 BI-WEEKLY TEST RUN		112	60
4-25-2021	[illegible]	1320 - 1350 BI-WEEKLY TEST RUN		112	90
5-23-2021	[illegible]	1435 - 1505 BI-WEEKLY TEST RUN		113	120
6-14-2021	KRB	1034 - 1104 Bi-Weekly Test Run		113	150
6-25-2021	CO & POWER	10:50 - 11:00 ANN. SVC		114	160
6/20/2021	[illegible]	0452 - 0528 Bi-Weekly Test Run		114	196
8-19-21	[illegible]	1139 Bi-weekly test Run		115	229
9-01-2021	[illegible]	1338 Bi-weekly test Run Annual PCAPCO		115	255
9-5-21	[illegible]	1604 BI-WEEKLY TEST RUN 1638		115	265
10-3-21	KRB	1405 Bi-Weekly Test Rund 1435		116	285
10-30-21	[illegible]	1319 Bi-Weekly Test Run	1348	116	325
11/21/21	DE	1045 BI-WEEKLY TEST RUN	1115	117	355
12/24/21	DE	1354 BI-WEEKLY TEST RUN	1424	117	385
		2022		Starting Hours 117	
1/10/22	DE	0225 BI-WEEKLY TEST RUN	0255	118	30
1/28/22	KRB	1136 Bi-weekly test run 1206		118	60
2-3-22	[illegible]	1630 Bi-weekly test run	1700	119	90
02-15-22	[illegible]	1636 Bi-Weekly Test Run	1711	120	125
3-5-22	[illegible]	1539 Bi weekly test Run	1608	120	155
3-19-22	[illegible]	15:43 Bi weekly Test Run	1613	121	185
4-3-22	DWN	1540 Bi-Weekly Test Run	1610	121	215
4-30-22	[illegible]	1100 Bi weekly test Run	1130	122	245
5-15-22	ED.	14:01 BI-WEEKLY TEST RUN	14:31	122	275
5-27-22	DWN	1240 Bi-Weekly Test Run	1310	123	305
6-11-22	KRB	1435 Bi-Weekly test Run,	1505	124	335
6-26-22	[illegible]	1529 BI-WEEKLY TEST RUN	1559	124	365

ATTACHMENT 34

AQ-103

AQ-103 No emissions are permitted, from any source, which are a nuisance per PCAPCD Rule 205, Nuisance.

Verification: The Project owner shall report all violations of this condition as noticed by the PCAPCD as well as any offsite nuisance complaints as part of the Quarterly Air Quality Report in Condition of Certification AQ-SC6.

In regards to AQ-103 of Roseville Energy Park's 2Q22 QAQR, there were no violations of PCAPCD's Rule 205 for nuisance.

ATTACHMENT 35

AQ-104

AQ-104 Stack emission opacity as dark as Ringelmann No. 1 (20% opacity) for periods aggregating more than 3 minutes in any one hour is prohibited and is in violation of PCAPCD Rule 202, Visible Emissions.

Verification: The Project owner shall report all violations of this condition as noticed by the PCAPCD as well as any offsite opacity complaints as part of the Quarterly Air Quality Report in Condition of Certification AQ-SC6

In regards to AQ-104 of Roseville Energy Park's 2Q22 QAQR, there were no violations of PCAPCD's Rule 202 for opacity from stack emissions of the emergency diesel generator.