

DOCKETED

Docket Number:	03-AFC-01C
Project Title:	Roseville Energy Park Compliance
TN #:	247402
Document Title:	Roseville Energy Park Quarterly Air Quality Report - Q3 2022
Description:	N/A
Filer:	Roseville Electric Compliance
Organization:	Roseville Electric
Submitter Role:	Public Agency
Submission Date:	11/10/2022 4:17:56 PM
Docketed Date:	11/10/2022



Roseville Electric Utility
2090 Hilltop Circle
Roseville, California 95747-9704
Reliable Energy. Dependable Service.

City of Roseville

Roseville Energy Park

(03-AFC-1)

California Energy Commission

Quarterly Operational Report

Third Quarter 2022

List of Attachments

Attachment 1: AQ15 – SCR Installed before commissioning in 2007

Attachment 2: AQ20 - The gas turbine engine shall be fired exclusively on pipeline quality natural gas with sulfur content no greater than 0.50 grains of sulfur compounds per 100 dry scf of natural gas

Attachment 3: AQ21 – Startups and Shutdowns

Attachment 4: AQ32 – All hourly, quarter NOx and CO emissions AQ-SC6

Attachment 5: AQ33 – All hourly, daily, and quarterly Sox AQ-SC6

Attachment 6: AQ34 – Start Up and Shut downs

Attachment 7: AQ36 – Breakdown condition

Attachment 8: AQ37 – Violations of Emissions

Attachment 9: AQ40 – CEMS quality assurance test failures

Attachment 10: AQ41 – Excess Emissions

Attachment 11: AQ42 – Running 12 month summary

Attachment 12: AQ47 – All nuisance violations

N/A for this report period

Attachment 13: AQ48 – Nuisance complaints and stack emission opacity as dark as Ringlemann No. 1 (20% opacity) for periods aggregating more than 3 min.

N/A for this report period

Attachment 14: AQ51 – Ammonia slip exceedances

Attachment 15: AQ55 – Emission rates from each gas turbine and heat recovery steam generator exhaust during startup and shutdown – NOx and CO

Attachment 16: AQ57 – Emission exceedance rates during startup and shutdown – CO, NOX, PM-10, SOX, and VOC

Attachment 17: AQ59 – Emission limit exceedances – NOX, CO, VOC, PM-10, SO2

Attachment 18: AQ60 – Quarterly emission exceedances for Alstom GTX100 turbine – NO_x, CO, VOCs, PM₁₀, SO₂

Attachment 19: AQ63 – Total facility emission exceedances – NO_x, CO, VOC, PM₁₀, SO₂

Attachment 20: AQ68 – Annual water sample analysis of cooling tower water

Attachment 21: AQ69 – Nuisance complaints

N/A for this report period

Attachment 22: AQ70 – PM₁₀ quarterly emission rate exceedances from cooling tower

Attachment 23: AQ71 – Exceedance of cooling tower PM₁₀ emission limit – PM₁₀ = cooling water recirculation rate*total dissolved solids concentration in the blow down water* design drift rate

Attachment 24: AQ86 – Limits for operation for maintenance and testing of emergency diesel engine and generator limited to 50 hours per year

Attachment 25: AQ87 – Operation for maintenance and testing purposes shall be limited to involuntary interruptions of electrical power. Operation shall not exceed 24 hours

Attachment 26: AQ88 – Sulfur content of diesel fuel used shall not exceed 15 ppm by weight

Attachment 27: AQ89 – Records of hours of operation engine run for maintenance and testing, during interruption of electrical power, records of sulfur content of diesel used for five years

Attachment 28: AQ90 – No emissions are permitted, from any source, which are a nuisance per PCAPCD Rule 205, Nuisance

N/A for this report period

Attachment 29: AQ91 – Stack emission opacity as dark as Ringelmann No. 1 (20% opacity) for periods aggregating more than 3 minutes in any one hour is prohibited and is in violation of PCAPCD Rule 202, Visible Emissions

N/A for this report period

Attachment 30: AQ99 – Operation for maintenance and testing of the emergency diesel engine and generator shall be limited to 50 hours per year.

Attachment 31: AQ100 – Emergency diesel Generator; Operation for other than maintenance and testing purposes shall be limited to involuntary interruptions of electrical power

Attachment 32: AQ101 - The sulfur content of the diesel used shall not exceed 15ppm by weight

Attachment 33: AQ102 – Records of operation and maintenance shall be kept by the owner or operator for a period of five years

Attachment 34: AQ103 – No emissions are permitted, from any source, which are a nuisance

N/A for this report period

Attachment 35: AQ104 – Stack emission opacity as dark as Ringelmann No. 1 (20% opacity) for periods aggregating more than 3 minutes in any one hour is prohibited

N/A for this report period

ATTACHMENT 1

AQ-15

AQ-15 The Project owner shall install a selective catalytic reduction (SCR) system and an oxidation catalyst on the gas turbine. The SCR and oxidation catalyst equipment shall be operated whenever the gas turbine is operated.

Verification: The Project owner shall submit to the CPM a written statement by a California registered Professional Engineer stating that said engineer has reviewed the as built designs or inspected the identified equipment and certifies that it is operational and air tight. The Project owner shall include the operational status of the SCR and oxidation catalyst during all hours of operation as part of the Quarterly Air Quality Report required by the Condition of Certification AQ-SC6

This document is on file from the 2007 4Q QAQR.

ATTACHMENT 2

AQ-20

AQ-20 The gas turbine engine shall be fired exclusively on pipeline quality natural gas with sulfur content no greater than 0.50 grains of sulfur compounds per 100 dry scf of natural gas.

Verification: The Project owner shall submit to the CPM the most recent fuel testing analysis performed as part of the Quarterly Air Quality Report required by the Condition of Certification AQ-SC6

AQ20 ROSEVILLE ENERGY PARK

3Q22

Fuel Quality Analysis BTU values

<http://www.pge.com/pij>

	JUL	AUG	SEP
1	1038.71	1042.55	1062.45
2	1042.38	1040.47	1065.98
3	1044.99	1038.20	1064.70
4	1043.44	1037.32	1058.63
5	1043.01	1038.75	1058.14
6	1040.25	1038.32	1059.21
7	1040.71	1038.18	1059.82
8	1038.94	1038.95	1058.97
9	1036.46	1038.58	1059.20
10	1037.49	1038.27	1059.92
11	1039.66	1039.55	1059.07
12	1042.05	1040.95	1055.25
13	1043.54	1,038.65	1056.48
14	1037.72	1039.34	1056.67
15	1035.38	1039.49	1057.34
16	1038.30	1037.80	1056.09
17	1039.34	1037.51	1058.77
18	1036.25	1038.24	1055.24
19	1035.22	1038.53	1055.30
20	1037.77	1039.70	1053.43
21	1035.77	1039.32	1055.03
22	1030.48	1041.50	1055.46
23	1030.50	1045.25	1053.10
24	1030.67	1049.17	1051.87
25	1037.52	1048.51	1053.86
26	1034.72	1048.61	1056.46
27	1034.60	1064.27	1056.38
28	1035.89	1062.17	1054.23
29	1038.49	1061.39	1046.44
30	1036.50	1063.41	1044.98
31	1043.46	1067.79	

odeline/operations/gas_quality/p01_2_weeks.shtml



California Gas Transmission

Pipe Ranger

[Go](#)[Log in](#)[About CGT](#)[Products](#)[Tools & Services](#)[Operating Data](#)[Reference/Library](#)[Current Pipeline Status](#)[Forecasts](#)[Historical Archives](#)[Gas Quality/Heating Values](#)

Gas System Sulfur Survey Results

Date	Total Sulfur Maximum		Total Sulfur Average all sites	
	PPMv	gr/100 scf	PPMv	gr/100 scf
2022				
Second Quarter	5.0	0.30	0.9	0.06
First Quarter	4.8	0.28	1.1	0.07

ATTACHMENT 3

AQ-21

AQ-21 Startup is defined as the period beginning with the turbine light-off until the unit meets the lb/hr and ppmv emission limits in Conditions of Certification AQ-52, -54 and -55. Shutdown is defined as the period beginning with initiation of turbine shutdown sequence and ending with cessation of firing of the gas turbine engine. Startup and shutdown durations shall not exceed 3.0 hours and one hour, respectively, per occurrence.

Verification: The Project owner shall identify and submit to the CPM as part of the Quarterly Air Quality Report all startups and shutdowns for all units including the maximum hourly emission rate, total emissions and duration.

Startup / Shutdown Events

CT1



From: 07/01/2022 00:00 **To:** 09/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 10/01/2022 19:11 **Location:** Roseville, CA

Unit offline

Tag Name: CT1_UnitOn_TF_1H

Offline Periods		
Start Time	End Time	Duration in Hour(s)
08/17/2022 08:00	08/19/2022 10:00	51
08/20/2022 16:00	08/21/2022 07:00	16
08/22/2022 06:00	08/26/2022 04:00	95
09/22/2022 22:00	09/23/2022 11:00	14

Startup / Shutdown Events

CT1



From: 07/01/2022 00:00 **To:** 09/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 10/01/2022 19:11 **Location:** Roseville, CA

Operating Time Summary

Available Data for Report (excludes missing data):	2,208.00 Hour(s)
Total Offline:	176.00 Hour(s)
Offline Percentage:	7.97 %
Total Online:	2,032.00 Hour(s)
Online Percentage:	92.03 %

Startup / Shutdown Events

CT1



From: 07/01/2022 00:00 **To:** 09/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 10/01/2022 19:11 **Location:** Roseville, CA

Startup/Shutdown

Number	Start Time	End Time	Event Type	Duration
1	08/17/2022 07:21	08/17/2022 07:21	Shutdown	1
2	08/19/2022 11:02	08/19/2022 12:01	cold Startup	60
3	08/20/2022 15:18	08/20/2022 15:19	Shutdown	2
4	08/21/2022 08:13	08/21/2022 09:13	cold Startup	61
5	08/22/2022 05:31	08/22/2022 05:31	Shutdown	1
6	08/26/2022 05:40	08/26/2022 06:39	cold Startup	60
7	09/22/2022 21:51	09/22/2022 21:59	Shutdown	9
8	09/23/2022 12:37	09/23/2022 13:34	cold Startup	58

Startup / Shutdown Events

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 19:11 Location: Roseville, CA

Startup/Shutdown Event Summary

	# Events	Duration	Duration %
Cold Startup	4	239	0.20
Warm Startup	0		0.00
Shutdown	4	13	0.01
Total Process Events:	8	252	0.21

Total Report Time:	2,207.98 Hour(s)
Total Operating Time:	2,028.70 Hour(s)
Total Startup Time:	239 Minute(s)
Total Shutdown Time:	13 Minute(s)
Total Startup/Shutdown Time:	252 Minute(s)
Total Startup/Shutdown Time as a Percentage of Total Operating Time:	0.21 %

Startup / Shutdown Events

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 19:12 Location: Roseville, CA

Unit offline

Tag Name: CT2_UnitOn_TF_1H

Offline Periods		
Start Time	End Time	Duration in Hour(s)
07/01/2022 00:00	07/01/2022 16:00	17
07/02/2022 00:00	07/05/2022 14:00	87
07/05/2022 23:00	07/06/2022 15:00	17
07/06/2022 23:00	07/07/2022 13:00	15
07/08/2022 00:00	07/08/2022 13:00	14
07/08/2022 19:00	07/10/2022 13:00	43
07/14/2022 01:00	07/14/2022 12:00	12
07/23/2022 00:00	07/23/2022 15:00	16
07/23/2022 23:00	07/24/2022 04:00	6
08/19/2022 22:00	08/20/2022 14:00	17
09/23/2022 00:00	09/23/2022 14:00	15

Startup / Shutdown Events

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 19:12 Location: Roseville, CA

Operating Time Summary

Available Data for Report (excludes missing data):	2,208.00 Hour(s)
Total Offline:	259.00 Hour(s)
Offline Percentage:	11.73 %
Total Online:	1,949.00 Hour(s)
Online Percentage:	88.27 %

Startup / Shutdown Events

CT2



From: 07/01/2022 00:00 **To:** 09/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 10/01/2022 19:12 **Location:** Roseville, CA

Startup/Shutdown

Number	Start Time	End Time	Event Type	Duration
1	07/01/2022 17:17	07/01/2022 18:08	Cold Startup	52
2	07/01/2022 22:59	07/01/2022 23:07	Shutdown	9
3	07/05/2022 15:18	07/05/2022 16:24	Cold Startup	67
4	07/05/2022 21:53	07/05/2022 22:00	Shutdown	8
5	07/06/2022 16:51	07/06/2022 17:48	Cold Startup	58
6	07/06/2022 22:07	07/06/2022 22:15	Shutdown	9
7	07/07/2022 14:56	07/07/2022 15:48	Cold Startup	53
8	07/07/2022 23:24	07/07/2022 23:31	Shutdown	8
9	07/08/2022 14:07	07/08/2022 15:03	Cold Startup	57
10	07/08/2022 18:22	07/08/2022 18:29	Shutdown	8
11	07/10/2022 14:58	07/10/2022 15:44	Cold Startup	47
12	07/13/2022 23:54	07/14/2022 00:01	Shutdown	8
13	07/14/2022 13:08	07/14/2022 13:52	Cold Startup	45
14	07/22/2022 23:21	07/22/2022 23:29	Shutdown	9
15	07/23/2022 16:04	07/23/2022 16:50	Cold Startup	47
16	07/23/2022 22:13	07/23/2022 22:20	Shutdown	8
17	07/24/2022 05:06	07/24/2022 06:08	Cold Startup	63
18	08/19/2022 20:58	08/19/2022 21:06	Shutdown	9
19	08/20/2022 15:04	08/20/2022 15:51	Cold Startup	48
20	09/22/2022 22:50	09/22/2022 23:02	Shutdown	13
21	09/23/2022 15:45	09/23/2022 16:52	Cold Startup	68

Startup / Shutdown Events

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 19:12 Location: Roseville, CA

Startup/Shutdown Event Summary

	# Events	Duration	Duration %
Cold Startup	11	605	0.52
Warm Startup	0		0.00
Shutdown	10	89	0.08
Total Process Events:	21	694	0.6

Total Report Time:	2,207.98 Hour(s)
Total Operating Time:	1,936.93 Hour(s)
Total Startup Time:	605 Minute(s)
Total Shutdown Time:	89 Minute(s)
Total Startup/Shutdown Time:	694 Minute(s)
Total Startup/Shutdown Time as a Percentage of Total Operating Time:	0.60 %

Monthly Summary By Day Report



From: 07/01/2022 00:00 **To:** 09/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 10/01/2022 19:13 **Location:** Roseville, CA

Red = Invalid Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Limit Value:

	Unit CT1 CO_SUSD, LbPerHr	Unit CT1 NOX_SUSD, LbPerHr	Unit CT2 CO_SUSD, LbPerHr	Unit CT2 NOX_SUSD, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/01/2022	0.0	0.0	42.5	12.1
07/02/2022	0.0	0.0	0.0	0.0
07/03/2022	0.0	0.0	0.0	0.0
07/04/2022	0.0	0.0	0.0	0.0
07/05/2022	0.0	0.0	45.0	13.3
07/06/2022	0.0	0.0	28.9	11.3
07/07/2022	0.0	0.0	35.9	11.6
07/08/2022	0.0	0.0	26.5	11.2
07/09/2022	0.0	0.0	0.0	0.0
07/10/2022	0.0	0.0	15.1	10.1
07/11/2022	0.0	0.0	0.0	0.0
07/12/2022	0.0	0.0	0.0	0.0
07/13/2022	0.0	0.0	2.4	0.6
07/14/2022	0.0	0.0	36.6	9.8
07/15/2022	0.0	0.0	0.0	0.0
07/16/2022	0.0	0.0	0.0	0.0
07/17/2022	0.0	0.0	0.0	0.0
07/18/2022	0.0	0.0	0.0	0.0
07/19/2022	0.0	0.0	0.0	0.0
07/20/2022	0.0	0.0	0.0	0.0
07/21/2022	0.0	0.0	0.0	0.0
07/22/2022	0.0	0.0	8.3	0.9
07/23/2022	0.0	0.0	23.6	9.9
07/24/2022	0.0	0.0	39.5	10.5
07/25/2022	0.0	0.0	0.0	0.0
07/26/2022	0.0	0.0	0.0	0.0
07/27/2022	0.0	0.0	0.0	0.0
07/28/2022	0.0	0.0	0.0	0.0
07/29/2022	0.0	0.0	0.0	0.0
07/30/2022	0.0	0.0	0.0	0.0
07/31/2022	0.0	0.0	0.0	0.0
Monthly Avg/Sum*:	0.0 *	0.0 *	304.3 *	101.3 *
Daily Min:	0.0	0.0	0.0	0.0
Daily Max:	0.0	0.0	45.0	13.3
Jul 2022 - Jul 2022	0.0	0.0	304.3	101.3
QTD:	0.0 *	0.0 *	304.3 *	101.3 *
YTD 2022:	1,747.8 *	276.5 *	2,161.0 *	474.5 *

Monthly Summary By Day Report



From: 07/01/2022 00:00 **To:** 09/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 10/01/2022 19:13 **Location:** Roseville, CA

Red = Invalid Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Limit Value:

	Unit CT1 CO_SUSD, LbPerHr	Unit CT1 NOX_SUSD, LbPerHr	Unit CT2 CO_SUSD, LbPerHr	Unit CT2 NOX_SUSD, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/01/2022	0.0	0.0	0.0	0.0
08/02/2022	0.0	0.0	0.0	0.0
08/03/2022	0.0	0.0	0.0	0.0
08/04/2022	0.0	0.0	0.0	0.0
08/05/2022	0.0	0.0	0.0	0.0
08/06/2022	0.0	0.0	0.0	0.0
08/07/2022	0.0	0.0	0.0	0.0
08/08/2022	0.0	0.0	0.0	0.0
08/09/2022	0.0	0.0	0.0	0.0
08/10/2022	0.0	0.0	0.0	0.0
08/11/2022	0.0	0.0	0.0	0.0
08/12/2022	0.0	0.0	0.0	0.0
08/13/2022	0.0	0.0	0.0	0.0
08/14/2022	0.0	0.0	0.0	0.0
08/15/2022	0.0	0.0	0.0	0.0
08/16/2022	0.0	0.0	0.0	0.0
08/17/2022	0.0	0.0	0.0	0.0
08/18/2022	0.0	0.0	0.0	0.0
08/19/2022	47.9	11.0	8.4	1.2
08/20/2022	0.1	0.0	28.9	10.4
08/21/2022	43.0	10.5	0.0	0.0
08/22/2022	2.7	0.3	0.0	0.0
08/23/2022	0.0	0.0	0.0	0.0
08/24/2022	0.0	0.0	0.0	0.0
08/25/2022	0.0	0.0	0.0	0.0
08/26/2022	47.2	11.2	0.0	0.0
08/27/2022	0.0	0.0	0.0	0.0
08/28/2022	0.0	0.0	0.0	0.0
08/29/2022	0.0	0.0	0.0	0.0
08/30/2022	0.0	0.0	0.0	0.0
08/31/2022	0.0	0.0	0.0	0.0
Monthly Avg/Sum*:	140.9 *	33.0 *	37.3 *	11.6 *
Daily Min:	0.0	0.0	0.0	0.0
Daily Max:	47.9	11.2	28.9	10.4
Jul 2022 - Aug 2022	140.9	33.0	341.6	112.9
QTD:	140.9 *	33.0 *	341.6 *	112.9 *
YTD 2022:	1,888.7 *	309.5 *	2,198.3 *	486.1 *

Monthly Summary By Day Report



From: 07/01/2022 00:00 **To:** 09/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 10/01/2022 19:13 **Location:** Roseville, CA

Red = Invalid Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Limit Value:

	Unit CT1 CO_SUSD, LbPerHr	Unit CT1 NOX_SUSD, LbPerHr	Unit CT2 CO_SUSD, LbPerHr	Unit CT2 NOX_SUSD, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/01/2022	0.0	0.0	0.0	0.0
09/02/2022	0.0	0.0	0.0	0.0
09/03/2022	0.0	0.0	0.0	0.0
09/04/2022	0.0	0.0	0.0	0.0
09/05/2022	0.0	0.0	0.0	0.0
09/06/2022	0.0	0.0	0.0	0.0
09/07/2022	0.0	0.0	0.0	0.0
09/08/2022	0.0	0.0	0.0	0.0
09/09/2022	0.0	0.0	0.0	0.0
09/10/2022	0.0	0.0	0.0	0.0
09/11/2022	0.0	0.0	0.0	0.0
09/12/2022	0.0	0.0	0.0	0.0
09/13/2022	0.0	0.0	0.0	0.0
09/14/2022	0.0	0.0	0.0	0.0
09/15/2022	0.0	0.0	0.0	0.0
09/16/2022	0.0	0.0	0.0	0.0
09/17/2022	0.0	0.0	0.0	0.0
09/18/2022	0.0	0.0	0.0	0.0
09/19/2022	0.0	0.0	0.0	0.0
09/20/2022	0.0	0.0	0.0	0.0
09/21/2022	0.0	0.0	0.0	0.0
09/22/2022	18.1	1.1	11.6	1.7
09/23/2022	45.5	9.6	31.1	12.2
09/24/2022	0.0	0.0	0.0	0.0
09/25/2022	0.0	0.0	0.0	0.0
09/26/2022	0.0	0.0	0.0	0.0
09/27/2022	0.0	0.0	0.0	0.0
09/28/2022	0.0	0.0	0.0	0.0
09/29/2022	0.0	0.0	0.0	0.0
09/30/2022	0.0	0.0	0.0	0.0
Monthly Avg/Sum*:	63.6 *	10.7 *	42.7 *	13.9 *
Daily Min:	0.0	0.0	0.0	0.0
Daily Max:	45.5	9.6	31.1	12.2
Jul 2022 - Sep 2022	204.5	43.7	384.3	126.8
QTD:	204.5 *	43.7 *	384.3 *	126.8 *
YTD 2022:	1,952.3 *	320.2 *	2,241.0 *	500.0 *

Monthly Summary By Day Report

Units CT1 and CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 19:14 Location: Roseville, CA

Red = Invalid Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Limit Value:

	Units CT1 & CT2 CO, Lb 1 Hour(s)	Units CT1 & CT2 NOx, Lb 1 Hour(s)	Units CT1 & CT2 SO2, Lb 1 Hour(s)	Units CT1 & CT2 PM10, Lb 1 Hour(s)	Units CT1 & CT2 VOC, Lb 1 Hour(s)
07/01/2022	74.79	73.87	6.74	13.49	22.50
07/02/2022	9.07	39.83	4.32	8.65	14.36
07/03/2022	8.89	39.70	4.32	8.63	14.34
07/04/2022	8.49	42.20	4.32	8.63	14.29
07/05/2022	70.69	76.30	6.98	13.95	23.28
07/06/2022	59.76	67.78	6.19	12.40	20.67
07/07/2022	73.55	81.52	7.75	15.52	25.80
07/08/2022	50.69	65.00	6.10	12.17	20.24
07/09/2022	10.51	41.85	4.49	8.97	14.90
07/10/2022	36.72	76.83	7.48	14.88	24.85
07/11/2022	34.40	120.88	13.11	26.23	43.76
07/12/2022	40.01	119.09	12.79	25.60	42.64
07/13/2022	40.41	123.57	12.18	24.41	40.72
07/14/2022	67.24	98.49	9.29	18.57	30.91
07/15/2022	38.77	132.48	13.25	26.51	44.22
07/16/2022	29.71	129.21	13.06	26.16	43.55
07/17/2022	32.75	141.03	14.51	28.99	48.32
07/18/2022	39.64	142.88	14.26	28.57	47.65
07/19/2022	32.34	121.45	12.10	24.18	40.33
07/20/2022	24.57	104.69	11.34	22.66	37.77
07/21/2022	27.95	102.48	10.62	21.25	35.46
07/22/2022	50.00	100.13	10.25	20.53	34.25
07/23/2022	54.52	77.89	7.19	14.39	23.97
07/24/2022	61.79	96.48	9.14	18.29	30.52
07/25/2022	29.76	101.95	11.10	22.23	37.02
07/26/2022	38.02	108.18	11.79	23.58	39.33
07/27/2022	29.89	110.66	11.23	22.46	37.44
07/28/2022	40.03	128.85	13.12	26.23	43.72
07/29/2022	40.70	121.99	12.44	24.90	41.49
07/30/2022	45.90	139.63	13.83	27.66	46.07
07/31/2022	43.49	127.65	13.07	26.15	43.58
Monthly Avg/Sum*:	1,245.05 *	3,054.54 *	308.36 *	616.84 *	1,027.95 *
Daily Min:	8.49	39.70	4.32	8.63	14.29
Daily Max:	74.79	142.88	14.51	28.99	48.32
Jul 2022 - Jul 2022	1,245.05	3,054.54	308.36	616.84	1,027.95
QTD:	1,245.05 *	3,054.54 *	308.36 *	616.84 *	1,027.95 *
YTD 2022:	8,468.47 *	12,330.53 *	1,255.89 *	2,512.65 *	4,188.71 *

Monthly Summary By Day Report

Units CT1 and CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 19:14 Location: Roseville, CA

Red = Invalid Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Limit Value:	Units CT1 & CT2 CO, Lb 1 Hour(s)	Units CT1 & CT2 NOx, Lb 1 Hour(s)	Units CT1 & CT2 SO2, Lb 1 Hour(s)	Units CT1 & CT2 PM10, Lb 1 Hour(s)	Units CT1 & CT2 VOC, Lb 1 Hour(s)
08/01/2022	57.30	138.87	13.74	27.53	45.83
08/02/2022	40.01	124.00	12.52	25.06	41.84
08/03/2022	32.09	118.48	12.61	25.25	42.08
08/04/2022	44.22	143.63	14.66	29.37	48.92
08/05/2022	52.52	122.37	13.21	26.38	44.03
08/06/2022	21.07	87.42	9.08	18.18	30.36
08/07/2022	25.81	101.87	9.75	19.54	32.58
08/08/2022	38.44	120.83	12.29	24.55	40.93
08/09/2022	59.53	145.47	14.46	28.92	48.32
08/10/2022	37.06	133.62	12.86	25.69	42.77
08/11/2022	33.13	135.37	13.39	26.75	44.59
08/12/2022	34.85	126.91	12.83	25.63	42.69
08/13/2022	34.31	117.04	11.94	23.93	39.83
08/14/2022	38.21	115.24	11.66	23.29	38.83
08/15/2022	25.39	118.55	11.85	23.64	39.40
08/16/2022	28.68	134.56	13.78	27.53	45.87
08/17/2022	25.79	85.33	8.68	17.29	28.80
08/18/2022	19.99	58.67	5.84	11.72	19.58
08/19/2022	88.65	85.89	7.68	15.34	25.54
08/20/2022	53.66	64.73	5.35	10.70	17.82
08/21/2022	67.71	109.02	10.13	20.32	33.82
08/22/2022	20.54	75.20	7.66	15.31	25.53
08/23/2022	27.40	77.29	7.79	15.53	25.89
08/24/2022	28.36	75.00	7.61	15.18	25.30
08/25/2022	32.79	73.08	7.34	14.63	24.39
08/26/2022	72.41	136.70	12.88	25.76	42.95
08/27/2022	33.87	124.44	13.01	26.03	43.36
08/28/2022	25.17	101.72	10.34	20.69	34.49
08/29/2022	30.65	119.02	12.14	24.27	40.47
08/30/2022	30.52	138.25	14.18	28.39	47.30
08/31/2022	33.36	149.46	15.16	30.35	50.57
Monthly Avg/Sum*:	1,193.49 *	3,458.03 *	346.42 *	692.75 *	1,154.68 *
Daily Min:	19.99	58.67	5.35	10.70	17.82
Daily Max:	88.65	149.46	15.16	30.35	50.57
Jul 2022 - Aug 2022	2,438.54	6,512.57	654.78	1,309.59	2,182.63
QTD:	2,438.54 *	6,512.57 *	654.78 *	1,309.59 *	2,182.63 *
YTD 2022:	9,661.96 *	15,788.56 *	1,602.31 *	3,205.40 *	5,343.39 *

Monthly Summary By Day Report

Units CT1 and CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 19:14 Location: Roseville, CA

Red = Invalid Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Limit Value:	Units CT1 & CT2 CO, Lb 1 Hour(s)	Units CT1 & CT2 NOx, Lb 1 Hour(s)	Units CT1 & CT2 SO2, Lb 1 Hour(s)	Units CT1 & CT2 PM10, Lb 1 Hour(s)	Units CT1 & CT2 VOC, Lb 1 Hour(s)
09/01/2022	32.98	148.87	15.12	30.21	50.34
09/02/2022	41.38	155.87	15.88	31.71	52.89
09/03/2022	29.00	99.58	10.26	20.50	34.16
09/04/2022	32.33	107.43	11.06	22.11	36.91
09/05/2022	29.28	140.29	14.32	28.66	47.76
09/06/2022	35.09	158.54	16.06	32.14	53.54
09/07/2022	33.02	166.75	16.21	32.42	54.00
09/08/2022	34.92	166.17	16.63	33.26	55.41
09/09/2022	42.81	157.17	16.05	32.17	53.57
09/10/2022	28.90	98.50	10.47	20.94	34.90
09/11/2022	33.28	110.37	11.38	22.76	37.93
09/12/2022	31.16	107.51	11.13	22.21	37.04
09/13/2022	40.09	107.60	11.13	22.28	37.18
09/14/2022	23.60	92.08	9.47	18.96	31.61
09/15/2022	26.94	92.59	9.71	19.38	32.29
09/16/2022	18.99	82.94	8.52	17.02	28.38
09/17/2022	19.09	82.90	8.49	16.89	28.25
09/18/2022	24.61	94.86	9.65	19.24	32.08
09/19/2022	36.18	113.34	11.50	23.01	38.33
09/20/2022	38.99	116.89	11.84	23.68	39.50
09/21/2022	31.59	107.78	11.18	22.34	37.26
09/22/2022	63.62	90.80	9.26	18.50	30.84
09/23/2022	105.13	71.62	5.36	10.72	17.85
09/24/2022	29.80	105.73	10.82	21.66	36.11
09/25/2022	23.06	94.28	9.79	19.63	32.69
09/26/2022	21.84	89.93	9.33	18.66	31.14
09/27/2022	64.71	130.96	13.32	26.66	44.41
09/28/2022	21.14	96.87	10.05	20.09	33.48
09/29/2022	32.06	100.81	10.51	21.01	35.03
09/30/2022	23.82	90.89	9.90	19.82	33.03
Monthly Avg/Sum*:	1,049.41 *	3,379.92 *	344.40 *	688.64 *	1,147.91 *
Daily Min:	18.99	71.62	5.36	10.72	17.85
Daily Max:	105.13	166.75	16.63	33.26	55.41
Jul 2022 - Sep 2022	3,487.95	9,892.49	999.18	1,998.23	3,330.54
QTD:	3,487.95 *	9,892.49 *	999.18 *	1,998.23 *	3,330.54 *
YTD 2022:	10,711.37 *	19,168.48 *	1,946.71 *	3,894.04 *	6,491.30 *

CT1 SUSD EVENT 1

Date/Time	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/17/22 7:16	377224.2			0.6			0.51			0.54			0.73			0		
08/17/22 7:17	378687.5			0.5			0.42			0.46			0.61			0		
08/17/22 7:18	375144.8			0.4			0.32			0.37			0.45			0		
08/17/22 7:19	364978.7			0.4			0.32			0.36			0.44			0		
08/17/22 7:20	363207.3			0.4			0.32			0.36			0.45			0		
08/17/22 7:21	156496.5			0.5			0.22			0.2			0.13			1		
08/17/22 7:22	34734.2			0			0.94			0.48			0.13			0		
08/17/22 7:23	35273.3			0			0			0			0			0		
08/17/22 7:24	35658.4			0			0			0			0			0		
08/17/22 7:25	35889.4			0			0			0			0			0		
08/17/22 7:26	36043.5			0			0			0			0			0		

CT1 SUSD EVENT 2

Date/Time	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/19/22 10:57	41973.7			0			0			0			0			0		
08/19/22 10:58	42358.8			0			0			0			0			0		
08/19/22 10:59	42358.8			0			0			0			0			0		
08/19/22 11:00	42435.8			0			0			0			0			0		
08/19/22 11:01	42743.9			0			0			0			0			0		
08/19/22 11:02	47749.9			0.2			0			0			0			1		
08/19/22 11:03	50137.4			0.2			0			0			0			1		
08/19/22 11:04	57068.8			64.9			31.47			8.6			6.86			1		
08/19/22 11:05	66079.7			1157.2			15.17			177.7			3.83			1		
08/19/22 11:06	76322.8			701.8			20.82			124.41			6.08			1		
08/19/22 11:07	99042.5			360.2			25.67			82.89			9.72			1		
08/19/22 11:08	138474.7			204.9			33.25			65.91			17.6			1		
08/19/22 11:09	142402.5			125.4			48.29			41.5			26.29			1		
08/19/22 11:10	148794.9			810			51.39			279.96			29.23			1		
08/19/22 11:11	157959.8			2046			51.96			751.09			31.39			1		
08/19/22 11:12	174749.2			1922			58.82			780.43			39.31			1		
08/19/22 11:13	197160.9			979.2			68.01			448.7			51.29			1		
08/19/22 11:14	220958.8			135.3			61.11			69.47			51.64			1		
08/19/22 11:15	240212.8			9.6			55.56			5.35			51.03			1		
08/19/22 11:16	267553.5			2.3			51.43			1.45			52.62			1		
08/19/22 11:17	289965.1			2			24.58			1.33			27.26			1		
08/19/22 11:18	308294.9			1.9			14.34			1.37			16.91			1		
08/19/22 11:19	314148.2			2			10.37			1.44			12.46			1		
08/19/22 11:20	311298.6			2			9.21			1.42			10.96			1		
08/19/22 11:21	320925.6			1.8			7.78			1.33			9.54			1		
08/19/22 11:22	322157.8			1.7			7.24			1.27			8.92			1		
08/19/22 11:23	322311.8			1.5			6.34			1.12			7.82			1		
08/19/22 11:24	322080.8			1.4			5.81			1.05			7.16			1		
08/19/22 11:25	322465.9			1.3			5.37			0.99			6.62			1		
08/19/22 11:26	319693.3			1.3			5.01			0.93			6.12			1		
08/19/22 11:27	321618.7			1.2			4.92			0.87			6.05			1		
08/19/22 11:28	322465.9			1.2			4.83			0.87			5.95			1		
08/19/22 11:29	323005			1.1			4.65			0.81			5.74			1		
08/19/22 11:30	322542.9			1.1			4.65			0.8			5.73			1		

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/19/22 11:31	322696.9			1.1			4.65			0.8			5.74			1		
08/19/22 11:32	320540.5			1			4.56			0.73			5.59			1		
08/19/22 11:33	319693.3			1			4.56			0.73			5.57			1		
08/19/22 11:34	320001.4			1			4.56			0.73			5.58			1		
08/19/22 11:35	318923.2			0.9			4.56			0.66			5.56			1		
08/19/22 11:36	319308.2			0.9			4.56			0.66			5.57			1		
08/19/22 11:37	320463.5			0.9			4.65			0.67			5.7			1		
08/19/22 11:38	320078.4			0.9			4.65			0.66			5.69			1		
08/19/22 11:39	321387.7			0.9			4.83			0.67			5.93			1		
08/19/22 11:40	320848.5			0.9			4.92			0.67			6.03			1		
08/19/22 11:41	321079.6			0.9			5.1			0.67			6.26			1		
08/19/22 11:42	321156.6			0.9			5.18			0.67			6.37			1		
08/19/22 11:43	319770.3			0.8			5.27			0.6			6.45			1		
08/19/22 11:44	320771.5			0.8			5.36			0.6			6.58			1		
08/19/22 11:45	321156.6			0.8			5.54			0.61			6.8			1		
08/19/22 11:46	320771.5			0.8			5.54			0.61			6.79			1		
08/19/22 11:47	319462.3			0.8			5.1			0.6			6.22			1		
08/19/22 11:48	319385.3			0.8			3.99			0.61			4.88			1		
08/19/22 11:49	319693.3			0.8			3.36			0.61			4.11			1		
08/19/22 11:50	319616.3			0.8			3.45			0.61			4.22			1		
08/19/22 11:51	321387.7			0.8			4.18			0.61			5.13			1		
08/19/22 11:52	321772.7			0.8			4.18			0.61			5.14			1		
08/19/22 11:53	322619.9			0.8			3.27			0.61			4.03			1		
08/19/22 11:54	321387.7			0.8			2.9			0.61			3.57			1		
08/19/22 11:55	320386.4			0.8			2.72			0.61			3.34			1		
08/19/22 11:56	319847.3			0.8			2.45			0.61			3			1		
08/19/22 11:57	321772.7			0.8			2.27			0.61			2.79			1		
08/19/22 11:58	322157.8			0.8			2.18			0.61			2.68			1		
08/19/22 11:59	321387.7			0.8			2			0.61			2.45			1		
08/19/22 12:00	319770.3			0.8			1.91			0.61			2.33			1		
08/19/22 12:01	319154.2			0.8			1.91			0.61			2.33			1		
08/19/22 12:02	319847.3			0.8			1.82			0.61			2.22			0		
08/19/22 12:03	321002.6			0.8			1.72			0.61			2.12			0		
08/19/22 12:04	320771.5			0.7			1.72			0.54			2.12			0		
08/19/22 12:05	321310.6			0.7			1.63			0.54			2.01			0		
08/19/22 12:06	322234.8			0.7			1.63			0.54			2.01			0		

CT1 SUSD EVENT 3

CT1_GasFlow_CT_scfh_1M				CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/20/22 15:13	429749.1			0.7			1.69			0.65			2.77			0		
08/20/22 15:14	424435			0.7			1.69			0.65			2.74			0		
08/20/22 15:15	406567.3			0.7			1.69			0.62			2.62			0		
08/20/22 15:16	385464.9			0.7			1.69			0.59			2.48			0		
08/20/22 15:17	363977.5			0.7			1.63			0.61			2.27			0		
08/20/22 15:18	341334.8			0.7			1.38			0.58			1.8			1		
08/20/22 15:19	130234			0.7			0.68			0.2			0.34			1		
08/20/22 15:20	54989.4			0			1.64			2.39			0.34			0		
08/20/22 15:21	54681.3			0			0.3			0			0			0		
08/20/22 15:22	54450.3			0			0.1			0			0			0		
08/20/22 15:23	54065.2			0			0			0			0			0		
08/20/22 15:24	53988.2			0			0			0			0			0		

CT1 SUSD EVENT 4

Date/Time	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/21/22 8:08	32038.6			0			0			0			0			0		
08/21/22 8:09	32115.7			0			0			0			0			0		
08/21/22 8:10	31961.6			0			0			0			0			0		
08/21/22 8:11	32115.7			0			0			0			0			0		
08/21/22 8:12	33039.9			0			0			0			0			0		
08/21/22 8:13	35735.4			0.2			0			0			0			1		
08/21/22 8:14	41588.6			0.2			0			0			0			1		
08/21/22 8:15	50599.5			75.5			28.32			8.88			5.48			1		
08/21/22 8:16	60611.6			1178.4			16.52			165.92			3.83			1		
08/21/22 8:17	70854.7			691.6			24.58			113.79			6.66			1		
08/21/22 8:18	96193			399.1			28.62			89.17			10.52			1		
08/21/22 8:19	136857.4			244			41.03			77.63			21.48			1		
08/21/22 8:20	142171.5			161.5			56.6			53.35			30.77			1		
08/21/22 8:21	153338.8			974.1			55.57			347.12			32.59			1		
08/21/22 8:22	170436.3			2025			55.95			801.88			36.47			1		
08/21/22 8:23	190614.5			1503.2			57.82			665.88			42.15			1		
08/21/22 8:24	215182.6			313			58.12			156.52			47.83			1		
08/21/22 8:25	235206.8			27.8			54.64			15.21			49.13			1		
08/21/22 8:26	259774.9			5.9			49.36			3.56			49.02			1		
08/21/22 8:27	285344.2			5			33.95			3.29			37.05			1		
08/21/22 8:28	304213.1			4.6			15.67			3.26			18.23			1		
08/21/22 8:29	313532			4.8			11.1			3.53			13.3			1		
08/21/22 8:30	312068.7			5.5			10.3			4.02			12.29			1		
08/21/22 8:31	310451.4			6.4			9.07			4.64			10.77			1		
08/21/22 8:32	309681.2			7.5			9.12			5.4			10.8			1		
08/21/22 8:33	309296.2			8			8.22			5.78			9.73			1		
08/21/22 8:34	307524.8			7.9			7.96			5.62			9.36			1		
08/21/22 8:35	306754.6			7.3			6.88			5.22			8.07			1		
08/21/22 8:36	306600.6			6.6			6.35			4.71			7.44			1		
08/21/22 8:37	306292.5			5.8			5.81			4.13			6.81			1		
08/21/22 8:38	305753.4			5.1			5.45			3.61			6.37			1		
08/21/22 8:39	306908.7			4.3			4.9			3.04			5.75			1		
08/21/22 8:40	305753.4			3.5			4.81			2.52			5.63			1		
08/21/22 8:41	305214.3			2.8			4.72			2			5.51			1		

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/21/22 8:42	304598.2			2.4			4.54			1.67			5.29			1		
08/21/22 8:43	304136.1			2.1			4.27			1.48			4.96			1		
08/21/22 8:44	303828			1.9			4.18			1.35			4.85			1		
08/21/22 8:45	303674			1.8			4.15			1.24			4.82			1		
08/21/22 8:46	303365.9			1.6			4.06			1.1			4.71			1		
08/21/22 8:47	303211.9			1.5			4.15			1.04			4.81			1		
08/21/22 8:48	302980.8			1.4			4.24			0.97			4.91			1		
08/21/22 8:49	303057.8			1.2			4.33			0.84			5.02			1		
08/21/22 8:50	301748.6			1.1			4.5			0.79			5.19			1		
08/21/22 8:51	283803.8			1			4.43			0.67			4.8			1		
08/21/22 8:52	277873.6			0.9			4.5			0.6			4.78			1		
08/21/22 8:53	274407.9			0.9			5.14			0.55			5.39			1		
08/21/22 8:54	268169.6			0.8			5.52			0.47			5.66			1		
08/21/22 8:55	267784.5			0.7			5.61			0.41			5.75			1		
08/21/22 8:56	267014.4			0.7			5.71			0.42			5.83			1		
08/21/22 8:57	266783.3			0.6			5.42			0.36			5.53			1		
08/21/22 8:58	266937.4			0.6			4.74			0.36			4.84			1		
08/21/22 8:59	272097.4			0.6			4.55			0.37			4.73			1		
08/21/22 9:00	272790.6			0.6			4.26			0.37			4.44			1		
08/21/22 9:01	272867.6			0.6			3.62			0.36			3.77			1		
08/21/22 9:02	270788.2			0.6			3.52			0.36			3.65			1		
08/21/22 9:03	270557.1			0.6			3.48			0.36			3.6			1		
08/21/22 9:04	271712.3			0.6			3.19			0.37			3.32			1		
08/21/22 9:05	272790.6			0.6			3			0.37			3.13			1		
08/21/22 9:06	272097.4			0.6			2.9			0.37			3.02			1		
08/21/22 9:07	272020.4			0.6			2.71			0.37			2.82			1		
08/21/22 9:08	271866.4			0.6			2.51			0.37			2.61			1		
08/21/22 9:09	271712.3			0.6			2.32			0.37			2.41			1		
08/21/22 9:10	272097.4			0.6			2.13			0.37			2.21			1		
08/21/22 9:11	271789.4			0.6			1.93			0.37			2.01			1		
08/21/22 9:12	271943.4			0.6			1.84			0.37			1.91			1		
08/21/22 9:13	271404.3			0.6			1.74			0.37			1.81			1		
08/21/22 9:14	271712.3			0.6			1.64			0.37			1.71			0		
08/21/22 9:15	271481.3			0.6			1.55			0.37			1.61			0		
08/21/22 9:16	271327.3			0.6			1.45			0.37			1.51			0		
08/21/22 9:17	271096.2			0.5			1.45			0.3			1.5			0		
08/21/22 9:18	269401.9			0.6			1.35			0.36			1.39			0		

CT1 SUSD EVENT 5

Date/Time	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/22/22 5:26	441609.6			0.7			1.59			0.67			2.69			0		
08/22/22 5:27	442533.8			0.7			1.59			0.67			2.69			0		
08/22/22 5:28	440762.4			0.7			1.59			0.67			2.68			0		
08/22/22 5:29	443997.1			0.7			1.59			0.68			2.7			0		
08/22/22 5:30	441378.5			0.7			1.69			0.67			2.85			0		
08/22/22 5:31	368675.5			0.7			1.69			0.56			2.38			1		
08/22/22 5:32	23952			0			2.43			0.04			0.22			0		
08/22/22 5:33	24029			0			167.17			162.89			15.33			0		
08/22/22 5:34	23875			0			0.1			0			0			0		
08/22/22 5:35	23720.9			0			0.1			0			0			0		
08/22/22 5:36	24260			0			0			0			0			0		

CT1 SUSD EVENT 6

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/26/22 5:35	3157.7			0			0			0			0			0		
08/26/22 5:36	0			0			0			0			0			0		
08/26/22 5:37	3157.7			0			0			0			0			0		
08/26/22 5:38	2002.4			0			0			0			0			0		
08/26/22 5:39	37891.9			0			0			0			0			0		
08/26/22 5:40	28187.8			0.1			0			0			0			1		
08/26/22 5:41	33347.9			0.1			0			0			0			1		
08/26/22 5:42	41357.6			1			0.2			0			0			1		
08/26/22 5:43	50753.5			1405.7			18.44			165.82			3.58			1		
08/26/22 5:44	61689.8			1146.2			16.52			164.2			3.89			1		
08/26/22 5:45	75783.7			657.5			21.31			115.83			6.18			1		
08/26/22 5:46	112135.3			430.7			25.37			112.22			10.88			1		
08/26/22 5:47	141863.4			292.1			34.6			96.3			18.77			1		
08/26/22 5:48	143095.7			205.7			46.36			68.36			25.36			1		
08/26/22 5:49	159654.1			1647.7			39.53			611.14			24.13			1		
08/26/22 5:50	178369			1960.1			44.43			812.14			30.3			1		
08/26/22 5:51	199856.5			1150.8			55.65			534.53			42.54			1		
08/26/22 5:52	223269.3			206.1			63.35			106.93			54.1			1		
08/26/22 5:53	243293.5			15.4			58.14			8.68			54.08			1		
08/26/22 5:54	270172			2.6			53.32			1.61			55.08			1		
08/26/22 5:55	290042.2			2			30.2			1.35			33.5			1		
08/26/22 5:56	294740.1			1.9			16.43			1.31			18.51			1		
08/26/22 5:57	294124			1.9			12.42			1.32			13.96			1		
08/26/22 5:58	294278			1.9			10.66			1.32			11.99			1		
08/26/22 5:59	307678.8			1.8			9.83			1.28			11.57			1		
08/26/22 6:00	324930.4			1.6			8.58			1.21			10.66			1		
08/26/22 6:01	343260.2			1.5			8.19			1.19			10.75			1		
08/26/22 6:02	360357.7			1.5			5.99			1.25			8.25			1		
08/26/22 6:03	378148.4			1.4			4.63			1.2			6.69			1		
08/26/22 6:04	400560.1			1.2			4.33			1.12			6.64			1		
08/26/22 6:05	422355.6			1			4.15			1			6.7			1		
08/26/22 6:06	443380.9			0.9			3.93			0.96			6.67			1		
08/26/22 6:07	446923.7			0.8			4.12			0.88			7.04			1		
08/26/22 6:08	445383.4			0.8			4.61			0.86			7.85			1		

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/26/22 6:09	445075.3			0.8			4.61			0.86			7.85			1		
08/26/22 6:10	445691.4			0.8			4.61			0.86			7.86			1		
08/26/22 6:11	445460.4			0.8			4.52			0.86			7.69			1		
08/26/22 6:12	444844.3			0.8			4.52			0.86			7.68			1		
08/26/22 6:13	445691.4			0.7			4.52			0.76			7.7			1		
08/26/22 6:14	444921.3			0.7			4.7			0.76			8			1		
08/26/22 6:15	445614.4			0.7			4.79			0.76			8.17			1		
08/26/22 6:16	445460.4			0.7			4.89			0.76			8.32			1		
08/26/22 6:17	445152.3			0.7			4.98			0.76			8.47			1		
08/26/22 6:18	445306.3			0.7			5.07			0.76			8.63			1		
08/26/22 6:19	445075.3			0.7			5.16			0.76			8.79			1		
08/26/22 6:20	445922.5			0.7			5.16			0.76			8.8			1		
08/26/22 6:21	446076.5			0.7			5.16			0.76			8.81			1		
08/26/22 6:22	445229.3			0.7			3.69			0.76			6.28			1		
08/26/22 6:23	445999.5			0.7			2.67			0.76			4.56			1		
08/26/22 6:24	446384.6			0.7			2.49			0.76			4.25			1		
08/26/22 6:25	445768.4			0.7			3.04			0.76			5.19			1		
08/26/22 6:26	445383.4			0.7			3.5			0.76			5.97			1		
08/26/22 6:27	445614.4			0.7			3.6			0.76			6.13			1		
08/26/22 6:28	445460.4			0.7			3.04			0.76			5.18			1		
08/26/22 6:29	445922.5			0.6			2.4			0.67			4.09			1		
08/26/22 6:30	446769.7			0.6			2.21			0.67			3.78			1		
08/26/22 6:31	446230.5			0.7			2.12			0.76			3.62			1		
08/26/22 6:32	446307.6			0.7			2.21			0.76			3.78			1		
08/26/22 6:33	445845.5			0.6			2.4			0.67			4.09			1		
08/26/22 6:34	446615.6			0.6			2.58			0.67			4.41			1		
08/26/22 6:35	446923.7			0.6			2.67			0.67			4.57			1		
08/26/22 6:36	439530.2			0.6			2.4			0.66			4.03			1		
08/26/22 6:37	424049.9			0.6			1.66			0.64			2.69			1		
08/26/22 6:38	415732.2			0.7			1.57			0.71			2.49			1		
08/26/22 6:39	399404.8			0.7			1.54			0.67			2.36			1		
08/26/22 6:40	387852.4			0.7			1.72			0.65			2.56			0		
08/26/22 6:41	382461.3			0.7			1.79			0.64			2.61			0		
08/26/22 6:42	381152			0.8			1.91			0.72			2.78			0		
08/26/22 6:43	378533.5			0.8			1.82			0.72			2.63			0		
08/26/22 6:44	377840.4			0.7			1.82			0.64			2.62			0		

CT1 SUSD EVENT 7

Date/Time	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/22/22 21:46	279028.9			0.7			1.69			0.43			1.81			0		
09/22/22 21:47	279645			0.6			1.78			0.37			1.91			0		
09/22/22 21:48	279491			0.6			1.69			0.37			1.81			0		
09/22/22 21:49	279028.9			0.6			1.69			0.37			1.81			0		
09/22/22 21:50	279722			0.6			1.5			0.37			1.61			0		
09/22/22 21:51	278951.8			0.6			1.5			0.37			1.61			1		
09/22/22 21:52	263240.6			0.6			1.4			0.35			1.42			1		
09/22/22 21:53	239519.7			0.6			1.71			0.32			1.58			1		
09/22/22 21:54	218648.3			0.5			5.5			0.26			4.63			1		
09/22/22 21:55	193310.1			0.4			14.03			0.2			10.43			1		
09/22/22 21:56	171745.6			4.9			18.19			1.97			12.02			1		
09/22/22 21:57	153569.8			339.8			21.35			121.93			12.61			1		
09/22/22 21:58	135086			1351.6			24.72			426.59			12.84			1		
09/22/22 21:59	27725.8			2021			28.36			131.2			3.03			1		
09/22/22 22:00	27340.7			0			44.25			399.64			4.65			0		
09/22/22 22:01	27571.7			0			0.2			0			0			0		
09/22/22 22:02	27494.7			0			0.1			0			0			0		
09/22/22 22:03	27648.7			0			0.1			0			0			0		
09/22/22 22:04	27725.8			0			0.1			0			0			0		

CT1 SUSD EVENT 8

Date/Time	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/23/22 12:31	32808.8			0			0			0			0			0		
09/23/22 12:32	32731.8			0			0			0			0			0		
09/23/22 12:33	32885.8			0			0			0			0			0		
09/23/22 12:34	32962.8			0			0			0			0			0		
09/23/22 12:35	32962.8			0			0			0			0			0		
09/23/22 12:36	33501.9			0			0			0			0			0		
09/23/22 12:37	40279.4			0.1			0			0			0			1		
09/23/22 12:38	43822.1			0.9			0.1			0			0			1		
09/23/22 12:39	52293.8			1175.6			20.65			143.68			4.15			1		
09/23/22 12:40	62151.9			1050.6			18.49			152.63			4.42			1		
09/23/22 12:41	73858.3			562.8			25.57			97.13			7.26			1		
09/23/22 12:42	102123.2			291.1			26.97			69.45			10.59			1		
09/23/22 12:43	138320.7			172.9			40.79			55.89			21.7			1		
09/23/22 12:44	147485.6			102.9			54.52			35.49			30.93			1		
09/23/22 12:45	148871.9			1331.5			50.25			463.17			28.76			1		
09/23/22 12:46	161194.4			1898.5			47.2			715.25			29.26			1		
09/23/22 12:47	180987.5			1660.9			50.15			702.65			34.92			1		
09/23/22 12:48	203091.1			477.4			49.92			226.57			38.99			1		
09/23/22 12:49	225425.8			57.7			50.28			30.37			43.59			1		
09/23/22 12:50	248299.5			3.8			46.37			2.19			44.28			1		
09/23/22 12:51	273483.7			2			37.72			1.28			39.67			1		
09/23/22 12:52	288732.9			1.8			16.75			1.22			18.6			1		
09/23/22 12:53	300285.3			1.7			11			1.19			12.7			1		
09/23/22 12:54	319077.2			1.7			9.08			1.29			11.14			1		
09/23/22 12:55	337715			1.6			8.67			1.27			11.26			1		
09/23/22 12:56	351038.8			1.4			6.35			1.17			8.57			1		
09/23/22 12:57	355351.7			1.4			5.54			1.13			7.57			1		
09/23/22 12:58	357816.2			1.2			5.36			0.97			7.38			1		
09/23/22 12:59	357508.2			1.1			5.27			0.9			7.25			1		
09/23/22 13:00	353580.3			1			5.1			0.81			6.93			1		
09/23/22 13:01	350191.6			1			5.01			0.8			6.74			1		
09/23/22 13:02	350191.6			1			4.92			0.8			6.62			1		
09/23/22 13:03	353580.3			0.9			4.56			0.74			6.2			1		
09/23/22 13:04	354658.6			0.9			4.45			0.75			6.07			1		

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/23/22 13:05	351346.9			0.8			4.45			0.67			6.01			1		
09/23/22 13:06	347419.1			0.8			4.38			0.65			5.85			1		
09/23/22 13:07	345955.8			0.8			4.47			0.65			5.95			1		
09/23/22 13:08	349113.4			0.8			4.47			0.66			6			1		
09/23/22 13:09	352502.1			0.8			4.45			0.67			6.03			1		
09/23/22 13:10	354812.6			0.7			4.36			0.6			5.95			1		
09/23/22 13:11	354042.4			0.7			4.36			0.6			5.93			1		
09/23/22 13:12	350961.8			0.7			4.45			0.6			6			1		
09/23/22 13:13	348035.2			0.7			4.54			0.59			6.08			1		
09/23/22 13:14	346186.8			0.7			4.63			0.59			6.16			1		
09/23/22 13:15	346802.9			0.7			4.36			0.59			5.81			1		
09/23/22 13:16	350345.7			0.7			3			0.59			4.04			1		
09/23/22 13:17	352887.2			0.7			2.27			0.6			3.08			1		
09/23/22 13:18	351346.9			0.7			2.36			0.6			3.19			1		
09/23/22 13:19	348112.2			0.7			3			0.59			4.01			1		
09/23/22 13:20	346032.8			0.7			3.18			0.59			4.23			1		
09/23/22 13:21	348882.3			0.7			3.27			0.59			4.38			1		
09/23/22 13:22	352271.1			0.7			2.72			0.6			3.69			1		
09/23/22 13:23	352656.1			0.7			2.27			0.6			3.08			1		
09/23/22 13:24	348035.2			0.7			2.18			0.59			2.92			1		
09/23/22 13:25	345647.7			0.7			2.18			0.59			2.9			1		
09/23/22 13:26	346725.9			0.7			2.27			0.59			3.03			1		
09/23/22 13:27	350268.7			0.7			2.36			0.59			3.18			1		
09/23/22 13:28	352733.2			0.7			2.45			0.6			3.33			1		
09/23/22 13:29	350191.6			0.7			2.36			0.59			3.18			1		
09/23/22 13:30	346725.9			0.7			2.27			0.59			3.03			1		
09/23/22 13:31	344492.4			0.7			2			0.58			2.65			1		
09/23/22 13:32	347419.1			0.7			1.82			0.59			2.43			1		
09/23/22 13:33	350730.8			0.7			1.63			0.6			2.2			1		
09/23/22 13:34	352733.2			0.7			1.54			0.6			2.09			1		
09/23/22 13:35	350037.6			0.7			1.63			0.59			2.2			0		
09/23/22 13:36	346340.8			0.7			1.72			0.59			2.3			0		
09/23/22 13:37	345185.6			0.7			1.82			0.59			2.41			0		
09/23/22 13:38	348728.3			0.7			1.91			0.59			2.56			0		
09/23/22 13:39	352964.2			0.7			1.91			0.6			2.59			0		

CT2 SUSD EVENT 1

Date/Time	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/01/22 17:12	0			0			0			0			0			0		
07/01/22 17:13	0			0			0			0			0			0		
07/01/22 17:14	0			0			0			0			0			0		
07/01/22 17:15	0			0			0			0			0			0		
07/01/22 17:16	0			0			0			0			0			0		
07/01/22 17:17	3773.8			0			0			0			0			1		
07/01/22 17:18	21333.4			0.3			0			0			0			1		
07/01/22 17:19	36274.5			67.9			26.55			5.74			3.7			1		
07/01/22 17:20	49444.3			979.8			18.81			112.95			3.57			1		
07/01/22 17:21	62228.9			588.8			26.08			85.4			6.23			1		
07/01/22 17:22	78787.3			365			28.1			66.99			8.49			1		
07/01/22 17:23	126075.1			227.8			37.45			66.9			18.1			1		
07/01/22 17:24	149334			132.9			52.88			46.25			30.29			1		
07/01/22 17:25	152491.6			378.7			58.45			134.53			34.17			1		
07/01/22 17:26	170667.4			1516.7			53.46			603.29			35			1		
07/01/22 17:27	190768.6			1007.3			55.56			447.79			40.65			1		
07/01/22 17:28	217262.1			316.5			56.79			160.27			47.32			1		
07/01/22 17:29	240828.9			33.3			56.95			18.71			52.6			1		
07/01/22 17:30	269016.8			2.6			55.6			1.64			57.35			1		
07/01/22 17:31	293507.9			1.5			40.38			1.04			45.45			1		
07/01/22 17:32	318538.1			1.5			17.79			1.09			21.74			1		
07/01/22 17:33	335866.7			1.7			11.8			1.33			15.2			1		
07/01/22 17:34	336559.8			1.8			10.1			1.4			13.04			1		
07/01/22 17:35	335866.7			1.7			8.31			1.33			10.71			1		
07/01/22 17:36	336713.8			1.5			8.01			1.17			10.35			1		
07/01/22 17:37	335712.6			1.3			7.93			1.03			10.2			1		
07/01/22 17:38	340333.6			1.2			7.66			0.98			10			1		
07/01/22 17:39	356044.8			1.1			7.4			0.95			10.1			1		
07/01/22 17:40	375760.9			1.1			6.08			1			8.76			1		
07/01/22 17:41	397479.4			1.1			4.74			0.99			7.22			1		
07/01/22 17:42	421739.5			1.1			4.08			1.07			6.61			1		
07/01/22 17:43	447308.8			0.9			4.06			0.96			6.96			1		
07/01/22 17:44	466100.7			0.8			4.12			0.92			7.37			1		
07/01/22 17:45	459092.2			0.8			5.16			0.89			9.09			1		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/01/22 17:46	458168			0.7			4.98			0.79			8.75			1		
07/01/22 17:47	466408.7			0.7			5.07			0.8			9.07			1		
07/01/22 17:48	466639.8			0.8			5.16			0.9			9.24			1		
07/01/22 17:49	452776.9			0.8			5.16			0.88			8.96			1		
07/01/22 17:50	442764.8			0.7			4.98			0.76			8.45			1		
07/01/22 17:51	453547.1			0.7			5.16			0.78			8.98			1		
07/01/22 17:52	441994.7			0.7			4.98			0.76			8.44			1		
07/01/22 17:53	417041.5			0.7			5.35			0.72			8.55			1		
07/01/22 17:54	396863.3			0.7			4.99			0.67			7.6			1		
07/01/22 17:55	383539.5			0.8			2.32			0.72			3.42			1		
07/01/22 17:56	381383.1			0.9			1.67			0.78			2.45			1		
07/01/22 17:57	384155.7			0.9			1.79			0.8			2.63			1		
07/01/22 17:58	396247.2			0.9			1.97			0.83			2.99			1		
07/01/22 17:59	419274.9			0.8			2.09			0.8			3.36			1		
07/01/22 18:00	440839.4			0.8			2.12			0.85			3.58			1		
07/01/22 18:01	456550.7			0.7			2.4			0.78			4.2			1		
07/01/22 18:02	459554.3			0.6			3.23			0.69			5.69			1		
07/01/22 18:03	460786.6			0.7			3.32			0.79			5.86			1		
07/01/22 18:04	457860			0.7			2.21			0.79			3.88			1		
07/01/22 18:05	458322.1			0.7			1.94			0.79			3.4			1		
07/01/22 18:06	466254.7			0.7			1.75			0.8			3.13			1		
07/01/22 18:07	470182.5			0.7			1.75			0.81			3.16			1		
07/01/22 18:08	466023.7			0.7			1.94			0.8			3.46			1		
07/01/22 18:09	467332.9			0.7			2.12			0.8			3.8			0		
07/01/22 18:10	470336.5			0.7			2.21			0.81			3.99			0		
07/01/22 18:11	468565.2			0.7			2.03			0.81			3.64			0		
07/01/22 18:12	469027.3			0.7			1.75			0.81			3.15			0		
07/01/22 18:13	468565.2			0.7			1.48			0.81			2.65			0		

CT2 SUSD EVENT 2

Date/Time	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/01/22 22:54	364516.6			0.9			1.48			0.74			2.06			0		
07/01/22 22:55	341873.9			0.9			1.21			0.69			1.59			0		
07/01/22 22:56	330244.5			1			1.21			0.73			1.54			0		
07/01/22 22:57	328704.2			1			1.43			0.75			1.8			0		
07/01/22 22:58	328319.1			0.9			1.43			0.68			1.8			0		
07/01/22 22:59	314148.2			0.8			1.25			0.59			1.51			1		
07/01/22 23:00	292352.6			0.8			1.27			0.56			1.42			1		
07/01/22 23:01	268554.7			0.7			1.48			0.46			1.52			1		
07/01/22 23:02	244525.7			0.7			3.87			0.39			3.63			1		
07/01/22 23:03	218879.4			0.5			9.48			0.27			7.96			1		
07/01/22 23:04	194696.4			3.2			19.32			1.47			14.43			1		
07/01/22 23:05	172977.9			222.1			23.73			89.54			15.75			1		
07/01/22 23:06	152337.6			949.9			27.99			337.23			16.35			1		
07/01/22 23:07	87490.1			1666.4			32.8			339.82			11.01			1		
07/01/22 23:08	0			0			38.89			0			0			0		
07/01/22 23:09	0			0			11.8			0			0			0		
07/01/22 23:10	0			0			0.1			0			0			0		
07/01/22 23:11	0			0			0.1			0			0			0		
07/01/22 23:12	0			0			0.1			0			0			0		

CT2 SUSD EVENT 3

Date/Time	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/05/22 15:13	0			0			0			0			0			0		
07/05/22 15:14	0			0			0			0			0			0		
07/05/22 15:15	0			0			0			0			0			0		
07/05/22 15:16	0			0			0			0			0			0		
07/05/22 15:17	0			0			0			0			0			0		
07/05/22 15:18	1078.2			0			0			0			0			1		
07/05/22 15:19	9473			-0.1			0			0			0			1		
07/05/22 15:20	29420.1			53.1			35.4			3.64			3.99			1		
07/05/22 15:21	43822.1			1236.5			14.75			126.22			2.48			1		
07/05/22 15:22	55143.4			932.9			16.31			119.87			3.45			1		
07/05/22 15:23	68390.2			544.9			19.77			86.84			5.18			1		
07/05/22 15:24	101353			361.8			23.33			85.44			9.07			1		
07/05/22 15:25	142402.5			217.6			24.09			72.17			13.15			1		
07/05/22 15:26	147485.6			147.5			44.25			50.68			25.02			1		
07/05/22 15:27	163890			1031.8			39.64			394.01			24.91			1		
07/05/22 15:28	184376.2			1503.1			44.88			645.66			31.73			1		
07/05/22 15:29	208174.2			671.5			55.89			325.73			44.62			1		
07/05/22 15:30	234359.6			115.3			59			62.99			53.03			1		
07/05/22 15:31	258465.6			7.9			57.7			4.76			57.2			1		
07/05/22 15:32	286114.3			1.9			50.57			1.26			55.48			1		
07/05/22 15:33	306677.6			1.6			24.17			1.16			28.43			1		
07/05/22 15:34	313994.1			1.6			15.02			1.18			18.09			1		
07/05/22 15:35	326085.6			1.7			12.34			1.29			15.43			1		
07/05/22 15:36	324237.3			1.6			11.8			1.22			14.67			1		
07/05/22 15:37	323082			1.5			10.91			1.14			13.51			1		
07/05/22 15:38	322157.8			1.5			10.19			1.14			12.59			1		
07/05/22 15:39	321849.8			1.4			9.74			1.07			12.03			1		
07/05/22 15:40	319539.3			1.3			9.26			0.95			11.34			1		
07/05/22 15:41	320694.5			1.2			8.71			0.88			10.72			1		
07/05/22 15:42	319385.3			1.2			8.26			0.88			10.12			1		
07/05/22 15:43	330321.5			1.1			7.9			0.84			10			1		
07/05/22 15:44	340256.6			1			7.81			0.79			10.19			1		
07/05/22 15:45	337638			1			7.06			0.77			9.14			1		
07/05/22 15:46	338100.1			1			6.88			0.77			8.93			1		

CT2_GasFlow_CT_scfh_1M				CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/05/22 15:47	336559.8			1			6.79			0.77			8.77			1		
07/05/22 15:48	335481.6			1			6.9			0.78			8.87			1		
07/05/22 15:49	333710.2			0.9			6.81			0.71			8.71			1		
07/05/22 15:50	334018.3			0.9			6.81			0.71			8.72			1		
07/05/22 15:51	337407			0.9			6.9			0.71			8.93			1		
07/05/22 15:52	335404.6			0.9			6.9			0.71			8.87			1		
07/05/22 15:53	336097.7			0.9			6.72			0.71			8.66			1		
07/05/22 15:54	338023.1			0.9			6.72			0.72			8.71			1		
07/05/22 15:55	334634.4			0.9			6.54			0.71			8.39			1		
07/05/22 15:56	318923.2			0.9			6.44			0.67			7.88			1		
07/05/22 15:57	316535.7			0.8			6.9			0.6			8.37			1		
07/05/22 15:58	323929.2			0.7			6.91			0.56			8.59			1		
07/05/22 15:59	345647.7			0.7			7.17			0.58			9.5			1		
07/05/22 16:00	358124.3			0.7			6.62			0.6			9.09			1		
07/05/22 16:01	350730.8			0.7			5.1			0.58			6.85			1		
07/05/22 16:02	346032.8			0.8			5.01			0.65			6.64			1		
07/05/22 16:03	353195.3			0.8			5.11			0.65			6.92			1		
07/05/22 16:04	372988.3			0.8			4.14			0.69			5.92			1		
07/05/22 16:05	391703.3			0.8			3.04			0.73			4.57			1		
07/05/22 16:06	402870.6			0.7			2.81			0.68			4.35			1		
07/05/22 16:07	405027			0.7			2.77			0.7			4.3			1		
07/05/22 16:08	416964.5			0.6			3			0.62			4.79			1		
07/05/22 16:09	437758.8			0.6			3.18			0.65			5.33			1		
07/05/22 16:10	458784.2			0.6			3.13			0.69			5.51			1		
07/05/22 16:11	465407.5			0.7			3.37			0.71			6.02			1		
07/05/22 16:12	465330.5			0.6			3.69			0.7			6.58			1		
07/05/22 16:13	460940.6			0.6			2.4			0.69			4.24			1		
07/05/22 16:14	457705.9			0.6			1.84			0.69			3.24			1		
07/05/22 16:15	462789			0.6			1.75			0.7			3.11			1		
07/05/22 16:16	465484.5			0.6			1.94			0.7			3.46			1		
07/05/22 16:17	460324.5			0.7			2.21			0.79			3.91			1		
07/05/22 16:18	454394.3			0.7			2.4			0.78			4.18			1		
07/05/22 16:19	462943			0.7			2.58			0.8			4.59			1		
07/05/22 16:20	465561.6			0.7			2.3			0.81			4.19			1		
07/05/22 16:21	460478.5			1.4			1.88			1.59			3.43			1		
07/05/22 16:22	453547.1			2.7			1.59			2.99			2.86			1		
07/05/22 16:23	454779.3			3.3			1.41			3.69			2.56			1		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/05/22 16:24	466331.7			2.7			1.5			3.07			2.77			1		
07/05/22 16:25	466331.7			2.2			1.67			2.47			3.09			0		
07/05/22 16:26	463020			2.1			1.85			2.35			3.38			0		
07/05/22 16:27	457860			2			2.03			2.23			3.67			0		
07/05/22 16:28	453932.1			1.9			2.2			2.15			4.02			0		
07/05/22 16:29	459169.2			1.7			2.17			1.98			4.07			0		

CT2 SUSD EVENT 4

Date/Time	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/05/22 21:48	287346.6			0.6			1.43			0.38			1.57			0		
07/05/22 21:49	287038.5			0.6			1.31			0.38			1.44			0		
07/05/22 21:50	289272			0.6			1.31			0.38			1.45			0		
07/05/22 21:51	287038.5			0.6			1.31			0.38			1.44			0		
07/05/22 21:52	287038.5			0.6			1.31			0.38			1.44			0		
07/05/22 21:53	287038.5			0.6			1.43			0.38			1.57			1		
07/05/22 21:54	273175.7			0.6			1.43			0.36			1.5			1		
07/05/22 21:55	247760.4			0.5			2.13			0.28			2.02			1		
07/05/22 21:56	224270.5			0.5			7.35			0.27			6.32			1		
07/05/22 21:57	199163.3			2.4			11.12			1.11			8.49			1		
07/05/22 21:58	174903.3			127			15.65			51.76			10.5			1		
07/05/22 21:59	154956.1			700			19.77			252.76			11.74			1		
07/05/22 22:00	113213.5			1392.9			23.44			367.6			10.18			1		
07/05/22 22:01	0			0			28.63			0			0			0		
07/05/22 22:02	0			0			23.6			0			0			0		
07/05/22 22:03	0			0			0.2			0			0			0		
07/05/22 22:04	0			0			0.1			0			0			0		
07/05/22 22:05	0			0			0.1			0			0			0		

CT2 SUSD EVENT 5

Date/Time	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/06/22 16:46	0			0			0			0			0			0		
07/06/22 16:47	0			0			0			0			0			0		
07/06/22 16:48	0			0			0			0			0			0		
07/06/22 16:49	0			0			0			0			0			0		
07/06/22 16:50	0			0			0			0			0			0		
07/06/22 16:51	1155.2			0			0			0			0			1		
07/06/22 16:52	22719.7			1.2			0.1			0			0			1		
07/06/22 16:53	37660.8			1222			20.65			107.23			2.98			1		
07/06/22 16:54	50214.4			1090.4			18.07			127.65			3.48			1		
07/06/22 16:55	62151.9			673.5			23.6			97.55			5.63			1		
07/06/22 16:56	81945			429.3			26.41			81.97			8.3			1		
07/06/22 16:57	130003			287.6			34.37			87.09			17.13			1		
07/06/22 16:58	154879.1			177.7			50.48			64.11			29.98			1		
07/06/22 16:59	196698.8			431.3			56.23			197.7			42.43			1		
07/06/22 17:00	223269.3			470.8			60.24			244.9			51.58			1		
07/06/22 17:01	247144.3			39.5			55.36			22.77			52.47			1		
07/06/22 17:02	272482.5			1.8			55.33			1.13			57.82			1		
07/06/22 17:03	299130			1.2			39.37			0.85			45.16			1		
07/06/22 17:04	321541.7			1.1			17.98			0.83			22.17			1		
07/06/22 17:05	331322.7			1.3			12.5			1.02			15.89			1		
07/06/22 17:06	330244.5			1.4			11.54			1.08			14.61			1		
07/06/22 17:07	332015.8			1.5			9.95			1.16			12.67			1		
07/06/22 17:08	327163.8			1.4			9.07			1.07			11.38			1		
07/06/22 17:09	324930.4			1.3			8.1			1			10.1			1		
07/06/22 17:10	325392.5			1.2			7.87			0.88			9.82			1		
07/06/22 17:11	326855.8			1.1			7.24			0.82			9.08			1		
07/06/22 17:12	323852.2			1			7.06			0.74			8.77			1		
07/06/22 17:13	323313.1			1			6.79			0.74			8.42			1		
07/06/22 17:14	321156.6			1			6.62			0.74			8.15			1		
07/06/22 17:15	321310.6			0.9			6.7			0.67			8.26			1		
07/06/22 17:16	320078.4			0.9			6.63			0.68			8.13			1		
07/06/22 17:17	318769.1			0.9			6.72			0.67			8.21			1		
07/06/22 17:18	319462.3			0.8			6.72			0.61			8.23			1		
07/06/22 17:19	319385.3			0.8			6.72			0.61			8.23			1		

CT2_GasFlow_CT_scfh_1M				CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/06/22 17:20	319770.3			0.8			6.81			0.61			8.35			1		
07/06/22 17:21	319847.3			0.8			7.01			0.62			8.6			1		
07/06/22 17:22	320232.4			0.8			7.01			0.62			8.61			1		
07/06/22 17:23	314687.3			0.7			7.1			0.54			8.57			1		
07/06/22 17:24	294201			0.7			7.1			0.51			8.01			1		
07/06/22 17:25	285190.2			0.7			8.15			0.5			8.91			1		
07/06/22 17:26	284188.9			0.7			10.37			0.44			11.3			1		
07/06/22 17:27	282725.6			0.6			10.75			0.38			11.66			1		
07/06/22 17:28	283572.8			0.6			11.04			0.38			12			1		
07/06/22 17:29	284034.9			0.6			11.23			0.38			12.23			1		
07/06/22 17:30	283803.8			0.6			11.32			0.38			12.32			1		
07/06/22 17:31	284497			0.6			10.37			0.38			11.32			1		
07/06/22 17:32	283264.8			1	X		7.81	X		0.69	X		8.48	X		1		
07/06/22 17:33	283033.7			0.6	X		5.57	X		0.37	X		6.04	X		1		
07/06/22 17:34	282879.7			0.5	X		4.74	X		0.32	X		5.14	X		1		
07/06/22 17:35	283033.7			0.6	X		4.35	X		0.38	X		4.72	X		1		
07/06/22 17:36	284343			0.6	X		4.06	X		0.38	X		4.43	X		1		
07/06/22 17:37	284266			0.6	X		3.68	X		0.38	X		4.01	X		1		
07/06/22 17:38	282571.6			0.6	X		3.39	X		0.38	X		3.67	X		1		
07/06/22 17:39	283110.7			0.5	X		3.1	X		0.32	X		3.36	X		1		
07/06/22 17:40	282725.6			0.5			2.9			0.32			3.15			1		
07/06/22 17:41	282725.6			0.5			2.71			0.32			2.94			1		
07/06/22 17:42	282725.6			0.5			2.61			0.32			2.83			1		
07/06/22 17:43	284034.9			0.5			2.42			0.32			2.63			1		
07/06/22 17:44	299438.1			0.5			2.32			0.34			2.67			1		
07/06/22 17:45	315765.5			0.5			2.09			0.35			2.54			1		
07/06/22 17:46	316458.6			0.6			1.59			0.41			1.93			1		
07/06/22 17:47	311914.7			0.6			1.38			0.4			1.65			1		
07/06/22 17:48	321849.8			0.7			1.22			0.49			1.5			1		
07/06/22 17:49	343645.3			0.6			1.11			0.52			1.46			0		
07/06/22 17:50	361590			0.7			1.09			0.61			1.51			0		
07/06/22 17:51	373450.4			0.7			0.82			0.63			1.17			0		
07/06/22 17:52	371294			0.8			0.64			0.71			0.9			0		
07/06/22 17:53	379765.8			0.7			0.63			0.63			0.91			0		

CT2 SUSD EVENT 6

Date/Time	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/06/22 22:02	285575.2			0.5			1.24			0.32			1.35			0		
07/06/22 22:03	284651			0.5			1.24			0.32			1.35			0		
07/06/22 22:04	284651			0.5			1.33			0.32			1.45			0		
07/06/22 22:05	285113.1			0.5			1.33			0.32			1.46			0		
07/06/22 22:06	284343			0.5			1.43			0.32			1.56			0		
07/06/22 22:07	286422.4			0.5			1.52			0.32			1.67			1		
07/06/22 22:08	275255.1			0.5			1.4			0.3			1.48			1		
07/06/22 22:09	250995			0.6			1.9			0.33			1.83			1		
07/06/22 22:10	229276.5			0.5			6			0.27			5.28			1		
07/06/22 22:11	201704.8			2.5			10.55			1.17			8.16			1		
07/06/22 22:12	179139.2			2.8			14.19			1.15			9.75			1		
07/06/22 22:13	157189.6			627.6			17.7			229.82			10.67			1		
07/06/22 22:14	138166.7			1383.1			22.13			445.19			11.72			1		
07/06/22 22:15	0			1775.5			27.6			0			0			1		
07/06/22 22:16	0			0			23.6			0			0			0		
07/06/22 22:17	0			0			0.1			0			0			0		
07/06/22 22:18	0			0			0.1			0			0			0		
07/06/22 22:19	0			0			0.1			0			0			0		
07/06/22 22:20	0			0			0.1			0			0			0		

CT2 SUSD EVENT 7

Date/Time	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/07/22 14:51	0			0			0			0			0			0		
07/07/22 14:52	0			0			0			0			0			0		
07/07/22 14:53	0			0			0			0			0			0		
07/07/22 14:54	0			0			0			0			0			0		
07/07/22 14:55	0			0			0			0			0			0		
07/07/22 14:56	4158.9			0			0			0			0			1		
07/07/22 14:57	19947.1			0			0			0			0			1		
07/07/22 14:58	35658.4			44.8			24.78			3.72			3.39			1		
07/07/22 14:59	48289			1124.1			16.91			126.57			3.13			1		
07/07/22 15:00	59533.3			729			23.6			101.17			5.39			1		
07/07/22 15:01	73242.2			423.1			26.13			72.17			7.33			1		
07/07/22 15:02	116448.1			286.7			34.33			77.78			15.33			1		
07/07/22 15:03	148486.8			164.3			45.38			56.86			25.85			1		
07/07/22 15:04	155110.2			180.8			58.24			65.36			34.65			1		
07/07/22 15:05	174287.1			1248.8			52.92			507.1			35.37			1		
07/07/22 15:06	196544.8			841.8			54.38			385.53			40.99			1		
07/07/22 15:07	223500.3			221.4			55.21			115.32			47.33			1		
07/07/22 15:08	249762.8			18.3			55.19			10.66			52.86			1		
07/07/22 15:09	274793			2			53.54			1.26			56.43			1		
07/07/22 15:10	301671.6			1.5			30.9			1.05			35.74			1		
07/07/22 15:11	319847.3			1.5			15.52			1.08			19.04			1		
07/07/22 15:12	340872.7			1.5			11.17			1.21			14.61			1		
07/07/22 15:13	342336			1.6			9.92			1.28			13.03			1		
07/07/22 15:14	344261.4			1.5			8.01			1.2			10.58			1		
07/07/22 15:15	342182			1.4			7.75			1.12			10.17			1		
07/07/22 15:16	344954.5			1.3			7.49			1.06			9.9			1		
07/07/22 15:17	343953.3			1.2			7.22			0.99			9.53			1		
07/07/22 15:18	342952.1			1.1			6.96			0.91			9.15			1		
07/07/22 15:19	342875.1			1.1			6.87			0.91			9.03			1		
07/07/22 15:20	342644.1			1.1			6.78			0.84			8.91			1		
07/07/22 15:21	341873.9			1.1			6.69			0.84			8.77			1		
07/07/22 15:22	340718.7			1			6.69			0.77			8.75			1		
07/07/22 15:23	341873.9			1			6.79			0.78			8.91			1		
07/07/22 15:24	340487.6			1			6.79			0.78			8.87			1		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/07/22 15:25	339948.5			0.9			6.79			0.71			8.86			1		
07/07/22 15:26	340564.6			0.9			6.79			0.71			8.87			1		
07/07/22 15:27	341488.8			0.9			6.88			0.71			9.01			1		
07/07/22 15:28	342104.9			0.9			6.88			0.71			9.03			1		
07/07/22 15:29	343183.2			0.9			6.88			0.71			9.06			1		
07/07/22 15:30	343106.2			0.9			6.88			0.71			9.06			1		
07/07/22 15:31	339255.3			0.9			6.79			0.71			8.84			1		
07/07/22 15:32	320925.6			0.8			6.88			0.6			8.47			1		
07/07/22 15:33	315534.4			0.8			7.17			0.6			8.68			1		
07/07/22 15:34	309681.2			0.7			6.91			0.53			8.21			1		
07/07/22 15:35	302441.7			0.7			5.16			0.52			5.99			1		
07/07/22 15:36	297204.6			0.6			4.79			0.45			5.46			1		
07/07/22 15:37	291890.5			0.7			5.43			0.45			6.08			1		
07/07/22 15:38	285729.3			0.7			4.31			0.44			4.72			1		
07/07/22 15:39	285498.2			0.6			3.62			0.38			3.96			1		
07/07/22 15:40	284728.1			0.6			3.33			0.38			3.64			1		
07/07/22 15:41	284343			0.5			3.24			0.32			3.53			1		
07/07/22 15:42	284805.1			0.5			3.33			0.32			3.64			1		
07/07/22 15:43	297666.7			0.6			3.33			0.4			3.8			1		
07/07/22 15:44	317767.9			0.6			2.76			0.42			3.36			1		
07/07/22 15:45	341642.8			0.6			1.87			0.45			2.45			1		
07/07/22 15:46	352271.1			0.6			1.84			0.53			2.49			1		
07/07/22 15:47	351038.8			0.8			1.54			0.67			2.08			1		
07/07/22 15:48	349421.5			0.8			1.34			0.66			1.8			1		
07/07/22 15:49	350576.7			0.8			1.52			0.66			2.04			0		
07/07/22 15:50	347650.1			0.8			1.61			0.65			2.15			0		
07/07/22 15:51	353503.3			0.8			1.7			0.66			2.3			0		
07/07/22 15:52	351038.8			0.8			1.79			0.66			2.41			0		
07/07/22 15:53	352271.1			0.8			1.88			0.66			2.54			0		

CT2 SUSD EVENT 8

CT2_GasFlow_CT_scfh_1M				CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/07/22 23:19	283264.8			0.5			1.33			0.31			1.45			0		
07/07/22 23:20	282648.6			0.5			1.24			0.31			1.34			0		
07/07/22 23:21	283341.8			0.5			1.24			0.31			1.34			0		
07/07/22 23:22	284111.9			0.5			1.24			0.32			1.35			0		
07/07/22 23:23	282494.6			0.5			1.24			0.31			1.34			0		
07/07/22 23:24	278258.7			0.5			1.33			0.31			1.42			1		
07/07/22 23:25	255308			0.5			1.43			0.28			1.4			1		
07/07/22 23:26	230585.8			0.4			4.58			0.22			4.05			1		
07/07/22 23:27	204400.4			1.2			9.46			0.58			7.42			1		
07/07/22 23:28	180910.5			9.2			12.43			3.86			8.62			1		
07/07/22 23:29	160886.4			496.2			15.59			186.03			9.62			1		
07/07/22 23:30	140939.2			1242			20.57			407.86			11.12			1		
07/07/22 23:31	0			1727			26			0			0			1		
07/07/22 23:32	0			0			28.03			0			0			0		
07/07/22 23:33	0			0			0.1			0			0			0		
07/07/22 23:34	0			0			0.1			0			0			0		
07/07/22 23:35	0			0			0.1			0			0			0		
07/07/22 23:36	0			0			0.1			0			0			0		

CT2 SUSD EVENT 9

Date/Time	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/08/22 14:02	0			0			0			0			0			0		
07/08/22 14:03	0			0			0			0			0			0		
07/08/22 14:04	0			0			0			0			0			0		
07/08/22 14:05	0			0			0			0			0			0		
07/08/22 14:06	0			0			0			0			0			0		
07/08/22 14:07	6469.3			0			0			0			0			1		
07/08/22 14:08	23720.9			0.8			0.1			0			0			1		
07/08/22 14:09	38508			1135.4			17.04			101.92			2.52			1		
07/08/22 14:10	50753.5			1048.7			17.33			123.95			3.37			1		
07/08/22 14:11	62768			620.1			22.98			90.64			5.53			1		
07/08/22 14:12	85179.7			367.1			25.21			72.9			8.24			1		
07/08/22 14:13	131697.3			240.1			34.12			73.69			17.23			1		
07/08/22 14:14	150874.3			140.5			48.89			49.42			28.29			1		
07/08/22 14:15	190229.5			427.8			52.92			189.63			38.6			1		
07/08/22 14:16	220111.7			527.9			58.53			270.72			49.4			1		
07/08/22 14:17	246759.2			32.9			57.37			18.91			54.29			1		
07/08/22 14:18	274099.8			1.7			54.52			1.12			57.3			1		
07/08/22 14:19	299900.2			1.2			37.8			0.84			43.48			1		
07/08/22 14:20	307909.8			1.2			16.61			0.85			19.61			1		
07/08/22 14:21	308294.9			1.3			11			0.96			13			1		
07/08/22 14:22	309373.2			1.4			10.17			0.98			12.06			1		
07/08/22 14:23	307678.8			1.3			9.17			0.91			10.82			1		
07/08/22 14:24	318615.1			1.2			8.94			0.89			10.93			1		
07/08/22 14:25	339717.5			1.1			8.48			0.88			11.05			1		
07/08/22 14:26	344877.5			1.1			7.44			0.88			9.84			1		
07/08/22 14:27	343183.2			1.1			5.99			0.86			7.88			1		
07/08/22 14:28	343183.2			1.1			5.9			0.85			7.77			1		
07/08/22 14:29	338947.3			1.1			6.08			0.83			7.9			1		
07/08/22 14:30	340179.6			1			6.08			0.77			7.93			1		
07/08/22 14:31	338793.3			1			6.17			0.78			8.01			1		
07/08/22 14:32	339024.3			0.9			6.26			0.71			8.14			1		
07/08/22 14:33	337869.1			0.9			6.26			0.7			8.11			1		
07/08/22 14:34	339409.4			0.9			6.35			0.71			8.26			1		
07/08/22 14:35	338254.2			0.8			6.35			0.63			8.23			1		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/08/22 14:36	340256.6			0.8			6.35			0.64			8.28			1		
07/08/22 14:37	340410.6			0.8			6.35			0.64			8.29			1		
07/08/22 14:38	337869.1			0.8			6.35			0.63			8.22			1		
07/08/22 14:39	338870.3			0.8			6.44			0.64			8.37			1		
07/08/22 14:40	342413			0.8			6.62			0.64			8.69			1		
07/08/22 14:41	340179.6			0.8			6.62			0.64			8.63			1		
07/08/22 14:42	331014.7			0.8			6.53			0.62			8.28			1		
07/08/22 14:43	333633.2			0.8			6.97			0.63			8.92			1		
07/08/22 14:44	332015.8			0.8			6.81			0.63			8.67			1		
07/08/22 14:45	323852.2			0.8			4.74			0.61			5.88			1		
07/08/22 14:46	321695.7			0.8			4.08			0.61			5.04			1		
07/08/22 14:47	314456.2			0.7			4.18			0.53			5.04			1		
07/08/22 14:48	308526			0.7			4.43			0.53			5.24			1		
07/08/22 14:49	304675.2			0.6			4.52			0.46			5.28			1		
07/08/22 14:50	302210.7			0.6			4.52			0.45			5.24			1		
07/08/22 14:51	300901.4			0.7			3.75			0.46			4.32			1		
07/08/22 14:52	301517.5			0.6			2.53			0.39			2.92			1		
07/08/22 14:53	300978.4			0.6			2.15			0.39			2.49			1		
07/08/22 14:54	300208.3			0.6			2.25			0.39			2.59			1		
07/08/22 14:55	299438.1			0.6			2.43			0.39			2.8			1		
07/08/22 14:56	296357.5			0.6			2.66			0.39			3.03			1		
07/08/22 14:57	297050.6			0.6			2.76			0.4			3.14			1		
07/08/22 14:58	306215.5			0.6			2.76			0.41			3.24			1		
07/08/22 14:59	323467.1			0.6			2.28			0.43			2.83			1		
07/08/22 15:00	327009.8			0.6			1.87			0.43			2.35			1		
07/08/22 15:01	323698.1			0.6			1.57			0.49			1.95			1		
07/08/22 15:02	321926.8			0.6			1.38			0.48			1.71			1		
07/08/22 15:03	323544.1			0.6			1.38			0.49			1.72			1		
07/08/22 15:04	324776.3			0.6			1.48			0.49			1.84			0		
07/08/22 15:05	324930.4			0.6			1.54			0.48			1.92			0		
07/08/22 15:06	324853.4			0.6			1.72			0.48			2.15			0		
07/08/22 15:07	323621.1			0.6			1.82			0.48			2.25			0		
07/08/22 15:08	326316.7			0.7			1.82			0.55			2.27			0		

CT2 SUSD EVENT 10

CT2_GasFlow_CT_scfh_1M				CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/08/22 18:17	286422.4			0.5			1.35			0.32			1.49			0		
07/08/22 18:18	282571.6			0.5			1.35			0.32			1.47			0		
07/08/22 18:19	283957.9			0.5			1.45			0.32			1.58			0		
07/08/22 18:20	283495.8			0.5			1.45			0.32			1.58			0		
07/08/22 18:21	283495.8			0.5			1.55			0.32			1.68			0		
07/08/22 18:22	281108.3			0.5			1.55			0.32			1.67			1		
07/08/22 18:23	264549.9			0.5			1.55			0.3			1.57			1		
07/08/22 18:24	239288.6			0.5			2.75			0.27			2.53			1		
07/08/22 18:25	213026.2			0.4			8.32			0.21			6.8			1		
07/08/22 18:26	187456.9			2.2			15.96			0.96			11.47			1		
07/08/22 18:27	166123.5			115.5			19.4			44.71			12.36			1		
07/08/22 18:28	143326.7			690.9			22.69			230.75			12.47			1		
07/08/22 18:29	84255.5			1486.6			26.38			291.84			8.52			1		
07/08/22 18:30	0			0			28.1			0			0			0		
07/08/22 18:31	0			0			0.2			0			0			0		
07/08/22 18:32	0			0			0.1			0			0			0		
07/08/22 18:33	0			0			0.1			0			0			0		
07/08/22 18:34	0			0			0.1			0			0			0		

CT2 SUSD EVENT 11

Date/Time	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/10/22 14:53	0			0			0			0			0			0		
07/10/22 14:54	0			0			0			0			0			0		
07/10/22 14:55	0			0			0			0			0			0		
07/10/22 14:56	0			0			0			0			0			0		
07/10/22 14:57	1848.4			0			0			0			0			0		
07/10/22 14:58	6161.3			0			0			0			0			1		
07/10/22 14:59	23258.8			0			0			0			0			1		
07/10/22 15:00	36890.7			47.2			21.24			4.06			3			1		
07/10/22 15:01	50060.4			1008.5			14.01			117.62			2.69			1		
07/10/22 15:02	61535.8			633.2			18.01			90.85			4.25			1		
07/10/22 15:03	78094.2			370			23.32			67.34			6.98			1		
07/10/22 15:04	123841.7			219.6			25.14			63.36			11.94			1		
07/10/22 15:05	149642			125.9			44.36			43.9			25.46			1		
07/10/22 15:06	174364.2			206.7			56.05			83.97			37.48			1		
07/10/22 15:07	193618.2			656.7			59.98			296.35			44.55			1		
07/10/22 15:08	218802.4			200.5			65.04			102.22			54.59			1		
07/10/22 15:09	244679.8			18.7			63.02			10.66			59.13			1		
07/10/22 15:10	270634.1			1.4			60			0.91			62.27			1		
07/10/22 15:11	295741.3			1			41.91			0.7			47.54			1		
07/10/22 15:12	320694.5			1.1			18.53			0.83			22.79			1		
07/10/22 15:13	340256.6			1.3			12.6			0.99			16.45			1		
07/10/22 15:14	347573.1			1.4			10.37			1.16			13.82			1		
07/10/22 15:15	344646.5			1.4			9.03			1.15			11.93			1		
07/10/22 15:16	346879.9			1.4			7.96			1.16			10.58			1		
07/10/22 15:17	342875.1			1.4			7.33			1.14			9.64			1		
07/10/22 15:18	342875.1			1.3			6.53			1.07			8.58			1		
07/10/22 15:19	339948.5			1.3			5.99			0.99			7.81			1		
07/10/22 15:20	342721.1			1.2			5.63			0.94			7.4			1		
07/10/22 15:21	340256.6			1.1			5.45			0.86			7.11			1		
07/10/22 15:22	337561			1			5.26			0.79			6.82			1		
07/10/22 15:23	338716.3			1			5.08			0.79			6.6			1		
07/10/22 15:24	337561			1			4.9			0.79			6.35			1		
07/10/22 15:25	335866.7			1			4.81			0.78			6.2			1		
07/10/22 15:26	335866.7			0.9			4.89			0.72			6.29			1		

CT2_GasFlow_CT_scfh_1M				CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/10/22 15:27	333787.2			0.8			4.79			0.65			6.14			1		
07/10/22 15:28	335789.6			0.9			4.79			0.72			6.17			1		
07/10/22 15:29	334172.3			0.9			4.7			0.72			6.03			1		
07/10/22 15:30	337021.9			0.9			4.7			0.72			6.08			1		
07/10/22 15:31	336174.7			0.8			4.7			0.65			6.06			1		
07/10/22 15:32	336482.8			0.8			4.79			0.65			6.19			1		
07/10/22 15:33	337869.1			0.8			4.79			0.65			6.21			1		
07/10/22 15:34	334865.4			0.8			4.89			0.65			6.27			1		
07/10/22 15:35	338023.1			0.8			4.98			0.65			6.45			1		
07/10/22 15:36	340564.6			0.8			5.07			0.66			6.62			1		
07/10/22 15:37	324776.3			0.8			5.25			0.63			6.54			1		
07/10/22 15:38	316612.7			0.8			4.89			0.61			5.93			1		
07/10/22 15:39	316920.7			0.8			7.02			0.62			8.54			1		
07/10/22 15:40	311221.5			0.7			6.46			0.54			7.71			1		
07/10/22 15:41	304983.3			0.8			2.66			0.54			3.12			1		
07/10/22 15:42	299515.1			0.7			1.05			0.46			1.2			1		
07/10/22 15:43	304675.2			0.7			1.16			0.48			1.36			1		
07/10/22 15:44	326162.7			0.7			1.35			0.51			1.69			1		
07/10/22 15:45	347804.1			0.7			2.47			0.54			3.3			0		
07/10/22 15:46	356892			0.7			2.12			0.61			2.9			0		
07/10/22 15:47	358663.4			0.7			1.03			0.63			1.42			0		
07/10/22 15:48	365363.8			0.7			1.03			0.64			1.44			0		
07/10/22 15:49	381999.2			0.7			1.12			0.67			1.65			0		

CT2 SUSD EVENT 12

CT2_GasFlow_CT_scfh_1M				CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/13/22 23:49	285652.3			0.6			1.22			0.37			1.33			0		
07/13/22 23:50	285113.1			0.5			1.22			0.31			1.33			0		
07/13/22 23:51	285344.2			0.5			1.22			0.31			1.33			0		
07/13/22 23:52	283880.9			0.5			1.31			0.31			1.43			0		
07/13/22 23:53	284343			0.5			1.4			0.31			1.53			0		
07/13/22 23:54	281955.5			0.5			1.5			0.31			1.62			1		
07/13/22 23:55	259543.8			0.5			1.71			0.29			1.71			1		
07/13/22 23:56	235745.9			0.4			4.52			0.22			4.09			1		
07/13/22 23:57	210484.7			0.4			9.87			0.21			7.97			1		
07/13/22 23:58	186455.7			5.2			15.77			2.25			11.28			1		
07/13/22 23:59	164198			362.5			18.93			138.68			11.92			1		
07/14/22 0:00	144790			1044			23.6			352.18			13.1			1		
07/14/22 0:01	34349.1			1659.3			28.43			132.97			3.75			1		
07/14/22 0:02	0			0			35.4			0			0			0		
07/14/22 0:03	0			0			0.2			0			0			0		
07/14/22 0:04	0			0			0.1			0			0			0		
07/14/22 0:05	0			0			0.1			0			0			0		
07/14/22 0:06	0			0			0.1			0			0			0		

CT2 SUSD EVENT 13

Date/Time	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/14/22 13:03	0			0			0			0			0			0		
07/14/22 13:04	0			0			0			0			0			0		
07/14/22 13:05	0			0			0			0			0			0		
07/14/22 13:06	0			0			0			0			0			0		
07/14/22 13:07	0			0			0			0			0			0		
07/14/22 13:08	6777.4			0			0			0			0			1		
07/14/22 13:09	19793.1			0			0			0			0			1		
07/14/22 13:10	36428.6			65.9			21.63			5.59			3.02			1		
07/14/22 13:11	47903.9			1083.4			14.75			121.01			2.71			1		
07/14/22 13:12	59379.3			687.8			21.43			95.15			4.88			1		
07/14/22 13:13	76091.8			412.2			25.57			73.07			7.46			1		
07/14/22 13:14	118989.7			260.9			31.55			72.35			14.4			1		
07/14/22 13:15	146099.3			142.7			45.01			48.58			25.22			1		
07/14/22 13:16	150027.1			242.1			52.92			84.64			30.45			1		
07/14/22 13:17	164737.2			1397.6			49.35			536.53			31.18			1		
07/14/22 13:18	185993.6			1051.8			50.97			455.83			36.35			1		
07/14/22 13:19	212718.1			342.8			52.36			169.89			42.71			1		
07/14/22 13:20	239134.6			44			52.46			24.51			48.1			1		
07/14/22 13:21	264703.9			3.1			51.28			1.89			52.07			1		
07/14/22 13:22	290966.3			1.6			37.64			1.1			42			1		
07/14/22 13:23	301825.6			1.6			16.04			1.1			18.57			1		
07/14/22 13:24	321464.7			1.6			10.62			1.22			13.09			1		
07/14/22 13:25	335712.6			1.5			9.35			1.21			12.04			1		
07/14/22 13:26	332400.9			1.4			7.87			1.11			10.03			1		
07/14/22 13:27	331784.8			1.3			6.88			1.04			8.76			1		
07/14/22 13:28	333094.1			1.3			6.7			0.97			8.56			1		
07/14/22 13:29	330090.5			1.3			6.63			0.98			8.39			1		
07/14/22 13:30	329705.4			1.2			6.26			0.91			7.92			1		
07/14/22 13:31	328242.1			1.1			6.17			0.83			7.77			1		
07/14/22 13:32	327625.9			1			5.99			0.76			7.53			1		
07/14/22 13:33	324545.3			1			5.9			0.76			7.34			1		
07/14/22 13:34	305907.4			0.9			5.9			0.66			6.92			1		
07/14/22 13:35	292275.6			0.8			6.55			0.57			7.34			1		
07/14/22 13:36	286268.4			0.8			7.33			0.51			8.04			1		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/14/22 13:37	283495.8			0.8			8.09			0.5			8.79			1		
07/14/22 13:38	284497			0.7			8.85			0.44			9.66			1		
07/14/22 13:39	283726.8			0.7			9.09			0.45			9.89			1		
07/14/22 13:40	283572.8			0.6			9.09			0.38			9.89			1		
07/14/22 13:41	284420			0.6			9.19			0.38			10.02			1		
07/14/22 13:42	284497			0.6			9.29			0.38			10.13			1		
07/14/22 13:43	285960.3			0.6			9.48			0.39			10.4			1		
07/14/22 13:44	289349			0.6			8.22			0.39			9.12			1		
07/14/22 13:45	291197.4			0.6			4.35			0.39			4.86			1		
07/14/22 13:46	292044.6			0.6			3.71			0.39			4.16			1		
07/14/22 13:47	288963.9			0.6			3.43			0.38			3.8			1		
07/14/22 13:48	288039.8			0.6			2.71			0.39			2.99			1		
07/14/22 13:49	286961.5			0.6			2.03			0.39			2.24			1		
07/14/22 13:50	285421.2			0.6			1.74			0.39			1.91			1		
07/14/22 13:51	283495.8			0.6			1.55			0.38			1.68			1		
07/14/22 13:52	286114.3			0.6			1.45			0.39			1.59			1		
07/14/22 13:53	298513.9			0.6			1.26			0.4			1.44			0		
07/14/22 13:54	322234.8			0.6			1.16			0.44			1.43			0		
07/14/22 13:55	343029.1			0.6			0.94			0.45			1.23			0		
07/14/22 13:56	348343.3			0.6			0.74			0.52			0.99			0		
07/14/22 13:57	343491.3			0.7			0.65			0.59			0.85			0		

CT2 SUSD EVENT 14

Date/Time	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/22/22 23:16	289118			0.6			1.22			0.38			1.35			0		
07/22/22 23:17	289503			0.6			1.24			0.39			1.37			0		
07/22/22 23:18	288193.8			0.6			1.33			0.38			1.47			0		
07/22/22 23:19	285960.3			0.6			1.43			0.38			1.57			0		
07/22/22 23:20	285421.2			0.6			1.52			0.38			1.67			0		
07/22/22 23:21	288655.9			0.6			1.52			0.38			1.69			1		
07/22/22 23:22	278412.8			0.6			1.62			0.37			1.73			1		
07/22/22 23:23	254383.8			0.6			1.81			0.34			1.76			1		
07/22/22 23:24	231741.1			0.6			5.8			0.32			5.15			1		
07/22/22 23:25	203399.2			0.6			10.69			0.26			8.33			1		
07/22/22 23:26	180217.4			5.4			15.61			2.27			10.79			1		
07/22/22 23:27	158575.9			384.2			18.4			141.99			11.19			1		
07/22/22 23:28	138936.8			1082.4			21.37			350.36			11.38			1		
07/22/22 23:29	0			1684.2			25.31			0			0			1		
07/22/22 23:30	0			0			25.57			0			0			0		
07/22/22 23:31	0			0			0.1			0			0			0		
07/22/22 23:32	0			0			0.1			0			0			0		
07/22/22 23:33	0			0			0.1			0			0			0		
07/22/22 23:34	0			0			0.1			0			0			0		

CT2 SUSD EVENT 15

Date/Time	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/23/22 15:59	0			0			0			0			0			0		
07/23/22 16:00	0			0			0			0			0			0		
07/23/22 16:01	0			0			0			0			0			0		
07/23/22 16:02	0			0			0			0			0			0		
07/23/22 16:03	0			0			0			0			0			0		
07/23/22 16:04	4158.9			0.1			0			0			0			1		
07/23/22 16:05	15634.2			0.1			0			0			0			1		
07/23/22 16:06	33887			53.1			24.78			4.2			3.22			1		
07/23/22 16:07	46825.7			1010			16.96			110.33			3.05			1		
07/23/22 16:08	57376.9			637.5			23.29			85.19			5.12			1		
07/23/22 16:09	73935.3			371.1			26.97			63.97			7.65			1		
07/23/22 16:10	116063.1			227			33.86			61.39			15.07			1		
07/23/22 16:11	145560.2			129.1			47.65			43.79			26.6			1		
07/23/22 16:12	176366.6			152.8			58.45			62.82			39.53			1		
07/23/22 16:13	212025			665.9			61.7			328.95			50.16			1		
07/23/22 16:14	239134.6			57.7			62.49			32.12			57.3			1		
07/23/22 16:15	263548.7			2.6			61.16			1.6			61.82			1		
07/23/22 16:16	292660.7			1			48.83			0.69			54.81			1		
07/23/22 16:17	315688.5			1.1			20			0.81			24.22			1		
07/23/22 16:18	338331.2			1.3			11.62			1.06			15.08			1		
07/23/22 16:19	345031.6			1.5			8.94			1.22			11.83			1		
07/23/22 16:20	333017.1			1.5			8.05			1.18			10.28			1		
07/23/22 16:21	330013.4			1.5			6.53			1.17			8.26			1		
07/23/22 16:22	329474.3			1.4			5.99			1.05			7.57			1		
07/23/22 16:23	331168.7			1.3			5.36			0.98			6.8			1		
07/23/22 16:24	329936.4			1.1			4.99			0.84			6.32			1		
07/23/22 16:25	328550.1			1.1			4.7			0.85			5.92			1		
07/23/22 16:26	328627.2			1.1			4.43			0.85			5.58			1		
07/23/22 16:27	324160.2			1.1			4.33			0.84			5.39			1		
07/23/22 16:28	324468.3			1			4.24			0.77			5.28			1		
07/23/22 16:29	324930.4			1			4.24			0.77			5.29			1		
07/23/22 16:30	325392.5			0.9			4.31			0.71			5.38			1		
07/23/22 16:31	325238.4			0.9			4.21			0.71			5.26			1		
07/23/22 16:32	325007.4			0.9			4.12			0.71			5.14			1		

CT2_GasFlow_CT_scfh_1M				CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/23/22 16:33	325238.4			0.9			4.03			0.71			5.02			1		
07/23/22 16:34	324545.3			0.9			3.93			0.71			4.9			1		
07/23/22 16:35	321310.6			0.9			3.93			0.7			4.85			1		
07/23/22 16:36	321772.7			0.8			3.93			0.63			4.85			1		
07/23/22 16:37	321849.8			0.8			4.12			0.63			5.09			1		
07/23/22 16:38	324930.4			0.8			4.12			0.64			5.14			1		
07/23/22 16:39	325546.5			0.8			4.03			0.64			5.03			1		
07/23/22 16:40	307755.8			0.8			4.03			0.6			4.75			1		
07/23/22 16:41	295741.3			0.9			5.33			0.59			6.04			1		
07/23/22 16:42	293045.8			0.8			9.09			0.53			10.22			1		
07/23/22 16:43	286499.4			0.8			3.58			0.52			3.93			1		
07/23/22 16:44	283726.8			0.7			2.8			0.45			3.05			1		
07/23/22 16:45	282879.7			0.7			2.46			0.45			2.67			1		
07/23/22 16:46	282571.6			0.7			2.16			0.45			2.34			1		
07/23/22 16:47	283187.7			0.6			1.97			0.39			2.14			1		
07/23/22 16:48	282109.5			0.6			1.77			0.39			1.92			1		
07/23/22 16:49	282109.5			0.6			1.57			0.39			1.7			1		
07/23/22 16:50	282802.7			0.6			1.48			0.39			1.6			1		
07/23/22 16:51	282417.6			0.6			1.38			0.39			1.49			0		
07/23/22 16:52	281878.5			0.6			1.28			0.39			1.38			0		
07/23/22 16:53	282494.6			0.6			1.18			0.39			1.28			0		
07/23/22 16:54	282032.5			0.6			1.08			0.39			1.17			0		
07/23/22 16:55	283418.8			0.6			1.08			0.39			1.18			0		

CT2 SUSD EVENT 16

Date/Time	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/23/22 22:08	286191.3			0.6			1.43			0.38			1.57			0		
07/23/22 22:09	285729.3			0.6			1.43			0.38			1.56			0		
07/23/22 22:10	286730.5			0.6			1.52			0.38			1.67			0		
07/23/22 22:11	285652.3			0.6			1.52			0.38			1.67			0		
07/23/22 22:12	285421.2			0.6			1.52			0.38			1.67			0		
07/23/22 22:13	284420			0.6			1.62			0.38			1.76			1		
07/23/22 22:14	265782.1			0.6			1.62			0.35			1.65			1		
07/23/22 22:15	241291			0.6			2.9			0.33			2.69			1		
07/23/22 22:16	216568.9			0.6			7.69			0.32			6.39			1		
07/23/22 22:17	190845.6			2.5			16.31			1.13			11.94			1		
07/23/22 22:18	167971.8			136.7			19.67			53.54			12.67			1		
07/23/22 22:19	146946.5			780.8			23.3			267.4			13.13			1		
07/23/22 22:20	74474.4			1584.7			27.94			274.91			7.98			1		
07/23/22 22:21	0			0			32.31			0			0			0		
07/23/22 22:22	0			0			0.2			0			0			0		
07/23/22 22:23	0			0			0.1			0			0			0		
07/23/22 22:24	0			0			0.1			0			0			0		
07/23/22 22:25	0			0			0.1			0			0			0		

CT2 SUSD EVENT 17

Date/Time	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/24/22 5:01	0			0			0			0			0			0		
07/24/22 5:02	0			0			0			0			0			0		
07/24/22 5:03	0			0			0			0			0			0		
07/24/22 5:04	0			0			0			0			0			0		
07/24/22 5:05	0			0			0			0			0			0		
07/24/22 5:06	4852			0			0			0			0			1		
07/24/22 5:07	22719.7			0			0			0			0			1		
07/24/22 5:08	36813.6			13.8			14.75			1.18			2.08			1		
07/24/22 5:09	50137.4			1270.9			11.41			148.5			2.19			1		
07/24/22 5:10	62305.9			839.4			15.73			121.95			3.76			1		
07/24/22 5:11	77555.1			541.6			19.77			97.84			5.88			1		
07/24/22 5:12	118835.6			430.1			23.88			119.1			10.88			1		
07/24/22 5:13	152106.5			270.5			34.46			95.84			20.09			1		
07/24/22 5:14	159423.1			270.6			43.77			100.57			26.77			1		
07/24/22 5:15	171976.7			1610			42.59			645.09			28.09			1		
07/24/22 5:16	192077.8			1418.5			45.18			635.06			33.29			1		
07/24/22 5:17	218340.3			604.5			45.99			307.58			38.51			1		
07/24/22 5:18	242523.3			120.8			46.8			68.29			43.53			1		
07/24/22 5:19	265474.1			8.1			47.08			5.04			47.94			1		
07/24/22 5:20	295279.3			1.9			41.83			1.3			47.37			1		
07/24/22 5:21	319154.2			1.6			18.84			1.2			23.06			1		
07/24/22 5:22	332632			1.5			12.94			1.16			16.51			1		
07/24/22 5:23	333787.2			1.6			10.33			1.21			13.22			1		
07/24/22 5:24	336482.8			1.6			9.77			1.24			12.61			1		
07/24/22 5:25	333479.2			1.5			9.51			1.16			12.16			1		
07/24/22 5:26	332477.9			1.4			9.33			1.09			11.9			1		
07/24/22 5:27	332632			1.2			9.07			0.96			11.57			1		
07/24/22 5:28	331168.7			1.2			8.94			0.9			11.35			1		
07/24/22 5:29	328858.2			1.2			8.67			0.89			10.93			1		
07/24/22 5:30	328935.2			1.1			8.49			0.82			10.71			1		
07/24/22 5:31	329012.2			1			8.4			0.75			10.6			1		
07/24/22 5:32	325392.5			1			8.4			0.75			10.48			1		
07/24/22 5:33	309912.3			0.9			8.53			0.66			10.14			1		
07/24/22 5:34	301363.5			0.9			8.62			0.64			9.97			1		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/24/22 5:35	297666.7			0.8			10.97			0.58			12.52			1		
07/24/22 5:36	291736.5			0.7			11.33			0.51			12.68			1		
07/24/22 5:37	289195			0.7			8.99			0.44			9.97			1		
07/24/22 5:38	288501.8			0.7			5.99			0.44			6.63			1		
07/24/22 5:39	288424.8			0.7			5.62			0.44			6.21			1		
07/24/22 5:40	287269.6			0.6			5.52			0.38			6.08			1		
07/24/22 5:41	288501.8			0.6			5.23			0.38			5.79			1		
07/24/22 5:42	286576.4			0.6			4.85			0.38			5.33			1		
07/24/22 5:43	286345.4			0.6			4.57			0.38			5.02			1		
07/24/22 5:44	286576.4			0.6			4.28			0.38			4.71			1		
07/24/22 5:45	286807.5			0.6			4.09			0.38			4.5			1		
07/24/22 5:46	286884.5			0.6			3.9			0.38			4.29			1		
07/24/22 5:47	286884.5			0.6			3.71			0.38			4.08			1		
07/24/22 5:48	286114.3			0.6			3.52			0.38			3.86			1		
07/24/22 5:49	285960.3			0.6			3.43			0.38			3.76			1		
07/24/22 5:50	286884.5			0.5			3.24			0.32			3.56			1		
07/24/22 5:51	286499.4			0.5			3.14			0.32			3.45			1		
07/24/22 5:52	286499.4			0.6			2.95			0.38			3.24			1		
07/24/22 5:53	286037.3			0.6			2.95			0.38			3.24			1		
07/24/22 5:54	285960.3			0.6			2.76			0.38			3.03			1		
07/24/22 5:55	287577.6			0.6			2.76			0.38			3.04			1		
07/24/22 5:56	285729.3			0.6			2.66			0.38			2.92			1		
07/24/22 5:57	287115.5			0.6			2.57			0.38			2.83			1		
07/24/22 5:58	286730.5			0.6			2.47			0.38			2.72			1		
07/24/22 5:59	286961.5			0.6			2.38			0.38			2.62			1		
07/24/22 6:00	285960.3			0.6			2.38			0.38			2.61			1		
07/24/22 6:01	286268.4			0.6			2.28			0.38			2.51			1		
07/24/22 6:02	286268.4			0.6			2.28			0.38			2.51			1		
07/24/22 6:03	286345.4			0.6			2.19			0.38			2.4			1		
07/24/22 6:04	285729.3			0.6			2.09			0.38			2.29			1		
07/24/22 6:05	286191.3			0.6			2			0.38			2.19			1		
07/24/22 6:06	286345.4			0.5			1.9			0.32			2.09			1		
07/24/22 6:07	286730.5			0.6			1.71			0.38			1.88			1		
07/24/22 6:08	288655.9			0.6			1.71			0.38			1.9			1		
07/24/22 6:09	301671.6			0.6			1.52			0.4			1.76			0		
07/24/22 6:10	305522.4			0.6			1.4			0.4			1.65			0		
07/24/22 6:11	302441.7			0.7			1.12			0.46			1.3			0		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/24/22 6:12	301748.6			0.7			0.94			0.46			1.08			0		
07/24/22 6:13	290889.3			0.7			0.94			0.44			1.04			0		

CT2 SUSD EVENT 18

Date/Time	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/19/22 20:53	285498.2			0.7			1.43			0.44			1.56			0		
08/19/22 20:54	284805.1			0.7			1.43			0.44			1.55			0		
08/19/22 20:55	283880.9			0.7			1.52			0.44			1.65			0		
08/19/22 20:56	281878.5			0.7			1.62			0.44			1.74			0		
08/19/22 20:57	283957.9			0.7			1.62			0.44			1.76			0		
08/19/22 20:58	281339.3			0.7			1.62			0.44			1.74			1		
08/19/22 20:59	269864			0.6			1.74			0.36			1.8			1		
08/19/22 21:00	247452.3			0.6			2.13			0.33			2.01			1		
08/19/22 21:01	224501.6			0.6			6.21			0.32			5.33			1		
08/19/22 21:02	196313.7			0.6			16.92			0.25			12.7			1		
08/19/22 21:03	173363			7.8			22.09			3.13			14.64			1		
08/19/22 21:04	151644.5			404			25			142.35			14.5			1		
08/19/22 21:05	123302.6			1251			29.66			358.43			13.99			1		
08/19/22 21:06	0			1747.7			31.97			0			0			1		
08/19/22 21:07	0			0			44.25			0			0			0		
08/19/22 21:08	0			0			0.1			0			0			0		
08/19/22 21:09	0			0			0.1			0			0			0		
08/19/22 21:10	0			0			0.1			0			0			0		
08/19/22 21:11	0			0			0.1			0			0			0		

CT2 SUSD EVENT 19

Date/Time	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/20/22 14:59	0			0			0			0			0			0		
08/20/22 15:00	0			0			0			0			0			0		
08/20/22 15:01	0			0			0			0			0			0		
08/20/22 15:02	0			0			0			0			0			0		
08/20/22 15:03	0			0			0			0			0			0		
08/20/22 15:04	5853.2			0			0			0			0			1		
08/20/22 15:05	26493.5			1.6			0.2			0			0			1		
08/20/22 15:06	39509.2			1085			21.24			99.58			3.21			1		
08/20/22 15:07	52601.9			896.1			20.82			109.52			4.19			1		
08/20/22 15:08	63615.2			501.8			25.67			74.13			6.24			1		
08/20/22 15:09	88876.4			273.8			33.25			56.57			11.31			1		
08/20/22 15:10	136241.3			152.7			43.27			48.32			22.54			1		
08/20/22 15:11	141478.3			90.1			58.19			29.64			31.49			1		
08/20/22 15:12	146869.5			607.7			57.75			207.45			32.44			1		
08/20/22 15:13	166200.5			1546.7			56.6			597.24			35.97			1		
08/20/22 15:14	186994.8			851.6			58.84			369.99			42.07			1		
08/20/22 15:15	216260.8			202.9			61.01			101.97			50.46			1		
08/20/22 15:16	239981.8			19			61.26			10.57			56.22			1		
08/20/22 15:17	267168.4			2.2			61			1.38			62.32			1		
08/20/22 15:18	294586.1			1.6			35.9			1.1			40.44			1		
08/20/22 15:19	318846.1			1.6			15.21			1.16			18.55			1		
08/20/22 15:20	329243.3			1.6			9.44			1.25			11.89			1		
08/20/22 15:21	328704.2			1.7			7.33			1.3			9.21			1		
08/20/22 15:22	335327.5			1.6			6.99			1.27			8.96			1		
08/20/22 15:23	352733.2			1.5			6.63			1.19			8.94			1		
08/20/22 15:24	372372.2			1.4			6.17			1.18			8.79			1		
08/20/22 15:25	384925.8			1.3			5.53			1.15			8.14			1		
08/20/22 15:26	382769.4			1.2			6.08			1.07			8.91			1		
08/20/22 15:27	382230.3			1.1			5.9			0.98			8.62			1		
08/20/22 15:28	382307.3			1.1			5.72			0.98			8.36			1		
08/20/22 15:29	381691.2			1			5.53			0.9			8.07			1		
08/20/22 15:30	381075			1			5.35			0.9			7.79			1		
08/20/22 15:31	380767			1			5.35			0.9			7.78			1		
08/20/22 15:32	379688.8			0.9			5.43			0.83			7.89			1		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/20/22 15:33	379303.7			0.9			5.34			0.83			7.74			1		
08/20/22 15:34	377532.3			0.9			5.34			0.82			7.71			1		
08/20/22 15:35	379303.7			0.9			5.43			0.83			7.88			1		
08/20/22 15:36	382846.4			0.9			5.43			0.83			7.95			1		
08/20/22 15:37	400945.2			0.8			3.93			0.79			6.03			1		
08/20/22 15:38	417657.6			0.9			3.52			0.83			5.62			1		
08/20/22 15:39	427284.6			0.8			4.09			0.76			6.69			1		
08/20/22 15:40	434755.2			0.7			3.93			0.66			6.54			1		
08/20/22 15:41	440069.3			0.7			2.34			0.67			3.94			1		
08/20/22 15:42	441994.7			0.7			1.97			0.67			3.32			1		
08/20/22 15:43	442610.8			0.7			2.15			0.67			3.65			1		
08/20/22 15:44	443997.1			0.7			2.43			0.77			4.13			1		
08/20/22 15:45	445537.4			0.7			2.72			0.78			4.63			1		
08/20/22 15:46	445460.4			0.7			2.81			0.78			4.79			1		
08/20/22 15:47	446461.6			0.7			2.72			0.78			4.64			1		
08/20/22 15:48	446923.7			0.7			1.97			0.78			3.36			1		
08/20/22 15:49	446461.6			0.7			1.59			0.78			2.72			1		
08/20/22 15:50	447616.8			0.7			1.4			0.78			2.4			1		
08/20/22 15:51	447077.7			0.7			1.22			0.78			2.08			1		
08/20/22 15:52	447693.8			0.7			1.03			0.78			1.76			0		
08/20/22 15:53	448695.1			0.7			0.94			0.78			1.61			0		
08/20/22 15:54	445999.5			0.7			0.83			0.76			1.41			0		
08/20/22 15:55	447770.9			0.7			0.74			0.77			1.26			0		
08/20/22 15:56	446769.7			0.7			0.74			0.77			1.26			0		

CT2 SUSD EVENT 20

Date/Time	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/22/22 22:45	311683.6			0.6			1.54			0.46			1.85			0		
09/22/22 22:46	324699.3			0.6			1.36			0.48			1.7			0		
09/22/22 22:47	345262.6			0.6			1.36			0.51			1.81			0		
09/22/22 22:48	365440.8			0.6			1.41			0.53			1.98			0		
09/22/22 22:49	375760.9			0.7			1.23			0.62			1.78			0		
09/22/22 22:50	377994.4			0.7			1.07			0.63			1.56			1		
09/22/22 22:51	367982.3			0.7			1.14			0.61			1.62			1		
09/22/22 22:52	347958.2			0.7			1.23			0.57			1.65			1		
09/22/22 22:53	323929.2			0.8			1.39			0.59			1.73			1		
09/22/22 22:54	302364.7			0.8			1.88			0.57			2.18			1		
09/22/22 22:55	277950.7			0.7			2.36			0.47			2.52			1		
09/22/22 22:56	253921.7			0.6			4.03			0.33			3.93			1		
09/22/22 22:57	231664			0.4			8			0.22			7.13			1		
09/22/22 22:58	206171.8			0.3			24.69			0.16			19.58			1		
09/22/22 22:59	182527.9			7.9			29.38			3.36			20.63			1		
09/22/22 23:00	162118.6			470.2			33.15			178.18			20.68			1		
09/22/22 23:01	140323.1			1243.1			35.24			407.67			19.02			1		
09/22/22 23:02	24260			1800.1			36.14			101.94			3.37			1		
09/22/22 23:03	0			0			39.83			0			0			0		
09/22/22 23:04	0			0			5.9			0			0			0		
09/22/22 23:05	0			0			0.1			0			0			0		
09/22/22 23:06	0			0			0.1			0			0			0		
09/22/22 23:07	0			0			0			0			0			0		

CT2 SUSD EVENT 21

Date/Time	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/23/22 15:40	0			0			-0.1			0			0			0		
09/23/22 15:41	0			0			-0.1			0			0			0		
09/23/22 15:42	0			0			-0.1			0			0			0		
09/23/22 15:43	0			0			-0.1			0			0			0		
09/23/22 15:44	0			0			-0.1			0			0			0		
09/23/22 15:45	3696.8			-0.1			-0.1			0			0			1		
09/23/22 15:46	20794.3			-0.2			-0.1			0			0			1		
09/23/22 15:47	35889.4			47.2			25.96			3.96			3.59			1		
09/23/22 15:48	48058			1135.9			17.31			127.65			3.2			1		
09/23/22 15:49	59764.4			701.8			22.36			98.03			5.14			1		
09/23/22 15:50	74859.5			438.3			25.57			76.72			7.37			1		
09/23/22 15:51	118219.5			287			33.6			79.29			15.28			1		
09/23/22 15:52	147254.5			171.1			47.43			58.87			26.85			1		
09/23/22 15:53	153338.8			208.9			56.97			74.86			33.6			1		
09/23/22 15:54	170359.3			1503.1			50.78			598.56			33.28			1		
09/23/22 15:55	193464.1			1143.3			54.25			516.96			40.37			1		
09/23/22 15:56	220188.7			333.1			54.11			171.44			45.83			1		
09/23/22 15:57	241907.2			36.8			53.6			20.8			49.88			1		
09/23/22 15:58	268015.6			2.6			53.66			1.6			55.31			1		
09/23/22 15:59	293584.9			1.4			37.84			0.98			42.73			1		
09/23/22 16:00	317844.9			1.4			17.7			1.03			21.64			1		
09/23/22 16:01	331091.7			1.5			12.25			1.18			15.6			1		
09/23/22 16:02	330244.5			1.6			10.92			1.22			13.87			1		
09/23/22 16:03	332477.9			1.5			9.21			1.18			11.77			1		
09/23/22 16:04	333017.1			1.3			8.76			1.04			11.22			1		
09/23/22 16:05	333479.2			1.2			8.37			0.96			10.73			1		
09/23/22 16:06	332323.9			1.1			8.01			0.89			10.24			1		
09/23/22 16:07	330860.6			1.1			7.75			0.82			9.86			1		
09/23/22 16:08	330475.5			1			7.6			0.76			9.66			1		
09/23/22 16:09	328704.2			1			7.42			0.76			9.38			1		
09/23/22 16:10	326239.7			0.9			7.24			0.68			9.09			1		
09/23/22 16:11	327703			0.9			7.06			0.68			8.9			1		
09/23/22 16:12	328550.1			0.8			6.97			0.62			8.81			1		
09/23/22 16:13	338408.2			0.8			6.97			0.64			9.08			1		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/23/22 16:14	338947.3			0.8			7.06			0.64			9.21			1		
09/23/22 16:15	339409.4			0.8			6.69			0.63			8.74			1		
09/23/22 16:16	340795.7			0.8			6.62			0.64			8.67			1		
09/23/22 16:17	339948.5			0.8			6.53			0.64			8.53			1		
09/23/22 16:18	339794.5			0.8			6.44			0.64			8.41			1		
09/23/22 16:19	339948.5			0.8			6.53			0.64			8.53			1		
09/23/22 16:20	339024.3			0.7			6.53			0.57			8.51			1		
09/23/22 16:21	342721.1			0.7			6.53			0.57			8.6			1		
09/23/22 16:22	340872.7			0.7			6.62			0.57			8.67			1		
09/23/22 16:23	350422.7			0.8			6.53			0.66			8.79			1		
09/23/22 16:24	368829.5			0.8			5.9			0.69			8.37			1		
09/23/22 16:25	388314.5			0.7			4.11			0.65			6.14			1		
09/23/22 16:26	404256.8			0.6			3.27			0.6			5.08			1		
09/23/22 16:27	404641.9			0.6			3.23			0.61			5.02			1		
09/23/22 16:28	400252			0.6			3.41			0.52			5.25			1		
09/23/22 16:29	384848.8			0.5			3.54			0.49			5.24			1		
09/23/22 16:30	376454.1			0.6			4.02			0.55			5.82			1		
09/23/22 16:31	373065.4			0.6			3.31			0.55			4.75			1		
09/23/22 16:32	371679.1			0.7			2.77			0.62			3.96			1		
09/23/22 16:33	382076.3			0.7			2.77			0.64			4.07			1		
09/23/22 16:34	400714.1			0.7			2.68			0.67			4.13			1		
09/23/22 16:35	426745.5			0.6			2.4			0.64			3.93			1		
09/23/22 16:36	441070.5			0.6			2.49			0.67			4.22			1		
09/23/22 16:37	450004.3			0.6			2.62			0.59			4.54			1		
09/23/22 16:38	457551.9			0.6			2.81			0.6			4.94			1		
09/23/22 16:39	456627.7			0.6			3.32			0.59			5.83			1		
09/23/22 16:40	452314.8			0.6			2.86			0.58			4.97			1		
09/23/22 16:41	450158.3			0.6			1.84			0.58			3.19			1		
09/23/22 16:42	452314.8			0.6			1.75			0.58			3.05			1		
09/23/22 16:43	453239			0.6			1.84			0.59			3.21			1		
09/23/22 16:44	458707.1			0.6			2.03			0.59			3.58			1		
09/23/22 16:45	457397.8			0.6			2.3			0.59			4.05			1		
09/23/22 16:46	457397.8			0.6			2.4			0.59			4.22			1		
09/23/22 16:47	451544.7			0.6			2.4			0.58			4.16			1		
09/23/22 16:48	455164.4			0.6			2.3			0.59			4.03			1		
09/23/22 16:49	460247.4			0.6			1.94			0.59			3.43			1		
09/23/22 16:50	455549.5			0.6			1.75			0.59			3.07			1		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/23/22 16:51	459323.3			0.6			1.66			0.59			2.93			1		
09/23/22 16:52	458938.2			0.6			1.75			0.59			3.09			1		
09/23/22 16:53	460093.4			0.6			1.94			0.59			3.43			0		
09/23/22 16:54	451467.6			0.6			2.03			0.58			3.52			0		
09/23/22 16:55	449003.1			0.6			1.94			0.58			3.34			0		
09/23/22 16:56	442687.8			0.6			1.84			0.57			3.14			0		
09/23/22 16:57	452468.8			0.6			1.75			0.68			3.05			0		

ATTACHMENT 4

AQ-32

AQ-32 The Project owner shall maintain hourly records of NO_x and CO emission concentrations (ppmv @ 15% O₂), and hourly, daily, and quarterly records of NO_x and CO emissions. Ongoing compliance with the CO emission limits during normal operation shall be deemed compliance with the VOC emission limits during normal operation.

Verification: The project owner shall submit to the CPM all concentration, hourly, daily, and quarter NO_x and CO emissions as part of the Quarterly Air Quality Report required by Condition of Certification AQ-SC6

AQ32 DAILY NOX CO

Date/Time	CT1_CO_Lb_1D			CT1_NOx_Lb_1D			CT2_CO_Lb_1D			CT2_NOx_Lb_1D			Value	SI	Mod	Value	SI	Mod
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod						
07/01/22 0:00	15.25	A46.57			59.54			27.3										
07/02/22 0:00	9.07			39.83			0			0								
07/03/22 0:00	8.89			39.7			0			0								
07/04/22 0:00	8.49			42.2			0			0								
07/05/22 0:00	13.73			47.23			56.96			29.07								
07/06/22 0:00	12.79			43.76			46.97			24.02								
07/07/22 0:00	14.67			47.9			58.88			33.62								
07/08/22 0:00	15.9			47.22			34.79			17.78								
07/09/22 0:00	10.51			41.85			0			0								
07/10/22 0:00	12.05			46.29			24.67			30.54								
07/11/22 0:00	16.31			58.84			18.09			62.04								
07/12/22 0:00	19.16			57.87			20.85			61.22								
07/13/22 0:00	17.16			59.65			23.25			63.92								
07/14/22 0:00	17.49			58.72			49.75			39.77								
07/15/22 0:00	18.3			64.56			20.47			67.92								
07/16/22 0:00	13.7			62.62			16.01			66.59								
07/17/22 0:00	14.81			69.02			17.94			72.01								
07/18/22 0:00	18.22			69.86			21.42			73.02								
07/19/22 0:00	14.83			59.36			17.51			62.09								
07/20/22 0:00	10.92			50.79			13.65			53.9								
07/21/22 0:00	13.32			49.62			14.63			52.86								
07/22/22 0:00	14.24			48.83			35.76			51.3								
07/23/22 0:00	19.35			52.93			35.17			24.96								
07/24/22 0:00	13.42			49.66			48.37			46.82								
07/25/22 0:00	13.89			49.72			15.87			52.23								
07/26/22 0:00	18.33			52.62			19.69			55.56								
07/27/22 0:00	14.12			53.83			15.77			56.83								
07/28/22 0:00	18.18			63.49			21.85			65.36								
07/29/22 0:00	18.97			59.61			21.73			62.38								
07/30/22 0:00	21.46			67.81			24.44			71.82								
07/31/22 0:00	20.94			62.42			22.55			65.23								
08/01/22 0:00	27.23			67.15			30.07			71.72								
08/02/22 0:00	18.53			60.4			21.48			63.6								
08/03/22 0:00	14.8			60.13			17.29			58.35								

Date/Time	CT1_CO_Lb_1D			CT1_NOx_Lb_1D			CT2_CO_Lb_1D			CT2_NOx_Lb_1D			Value	SI	Mod	Value	SI	Mod
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod						
08/04/22 0:00	20.37			70			23.85			73.63								
08/05/22 0:00	26.01			59.77			26.51			62.6								
08/06/22 0:00	9.91			42.31			11.16			45.11								
08/07/22 0:00	12.86			49.54			12.95			52.33								
08/08/22 0:00	18.14			58.66			20.3			62.17								
08/09/22 0:00	29.44			70.02			30.09			75.45								
08/10/22 0:00	17.34			64.59			19.72			69.03								
08/11/22 0:00	14.73			65.8			18.4			69.57								
08/12/22 0:00	16.14			61.62			18.71			65.29								
08/13/22 0:00	16.43			56.77			17.88			60.27								
08/14/22 0:00	17.89			56.28			20.32			58.96								
08/15/22 0:00	10.75			57.7			14.64			60.85								
08/16/22 0:00	12.05			65.74			16.63			68.82								
08/17/22 0:00	5.34			18.83			20.45			66.5								
08/18/22 0:00	0			0			19.99			58.67								
08/19/22 0:00	51.84			33.71			36.81			52.18								
08/20/22 0:00	5.93			27.36			47.73			37.37								
08/21/22 0:00	49.56			49.47			18.15			59.55								
08/22/22 0:00	3.9			14.87			16.64			60.33								
08/23/22 0:00	0			0			27.4			77.29								
08/24/22 0:00	0			0			28.36			75								
08/25/22 0:00	0			0			32.79			73.08								
08/26/22 0:00	50.97			64.33			21.44			72.37								
08/27/22 0:00	14.1			58.67			19.77			65.77								
08/28/22 0:00	11.04			49.93			14.13			51.79								
08/29/22 0:00	12.74			58.15			17.91			60.87								
08/30/22 0:00	11.66			67.47			18.86			70.78								
08/31/22 0:00	13.16			72.22			20.2			77.24								
09/01/22 0:00	11.51			72.29			21.47			76.58								
09/02/22 0:00	14.7			75.89			26.68			79.98								
09/03/22 0:00	12.93			48.14			16.07			51.44								
09/04/22 0:00	13.75			52.38			18.58			55.05								
09/05/22 0:00	10.6			68.94			18.68			71.35								
09/06/22 0:00	11.27			77.44			23.82			81.1								
09/07/22 0:00	9.11			81.5			23.91			85.25								
09/08/22 0:00	10			81.63			24.92			84.54								
09/09/22 0:00	11.6			76.74			31.21			80.43								

Date/Time	CT1_CO_Lb_1D			CT1_NOx_Lb_1D			CT2_CO_Lb_1D			CT2_NOx_Lb_1D			Value	SI	Mod	Value	SI	Mod
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod						
09/10/22 0:00	13.13			48.44			15.77			50.06								
09/11/22 0:00	14.29			53.26			18.99			57.11								
09/12/22 0:00	13.66			51.95			17.5			55.56								
09/13/22 0:00	18.26			52.2			21.83			55.4								
09/14/22 0:00	10.5			44.47			13.1			47.61								
09/15/22 0:00	11.98			44.94			14.96			47.65								
09/16/22 0:00	8.39			40.03			10.6			42.91								
09/17/22 0:00	8.39			40.27			10.7			42.63								
09/18/22 0:00	10.89			45.99			13.72			48.87								
09/19/22 0:00	14.24			55.28			21.94			58.06								
09/20/22 0:00	13.41			56.83			25.58			60.06								
09/21/22 0:00	14.36			52.17			17.23			55.61								
09/22/22 0:00	37.46			44			26.16			46.8								
09/23/22 0:00	56.25			37.49			48.88			34.13								
09/24/22 0:00	15.15			51.17			14.65			54.56								
09/25/22 0:00	11.74			45.97			11.32			48.31								
09/26/22 0:00	10.79			43.91			11.05			46.02								
09/27/22 0:00	22.65			63.37			42.06			67.59								
09/28/22 0:00	10.03			47.19			11.11			49.68								
09/29/22 0:00	13.41			49.82			18.65			50.99								
09/30/22 0:00	11.31			44.2			12.51			46.69								

AQ32 HOURLY NOX CO

Date/Time	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/01/22 0:00	0.6			1.5			14.5		1	0	X		0	X		0	X	1
07/01/22 1:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/01/22 2:00	0.6			1.4			14.6		1	0	X		0	X		0	X	1
07/01/22 3:00	0.7			1.5			14.6		1	0	X		0	X		0	X	1
07/01/22 4:00	0.7			1.5			14.6		1	0	X		0	X		0	X	1
07/01/22 5:00	0.7			1.5			14.5		1	0	X		0	X		0	X	1
07/01/22 6:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/01/22 7:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/01/22 8:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/01/22 9:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
07/01/22 10:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
07/01/22 11:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
07/01/22 12:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
07/01/22 13:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
07/01/22 14:00	0.6			1.5			14.8		1	0	X		0	X		0	X	1
07/01/22 15:00	0.5			1.5			14.8		1	0	X		0	X		0	X	1
07/01/22 16:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
07/01/22 17:00	1.6			1.5			14.3		1	0			0			15.7		1
07/01/22 18:00	0.9			1.5			14.3		1	1.1			1.5			14.3		1
07/01/22 19:00	1			1.5			14.1		1	1.4			1.5			14		1
07/01/22 20:00	1.3			1.5			14.1		1	1.4			1.5			14		1
07/01/22 21:00	1.5			1.5			14.2		1	1.4			1.5			14.1		1
07/01/22 22:00	1.2			1.5			14.3		1	1.2			1.5			14.2		1
07/01/22 23:00	0.6			1.4			14.5		1	0			0			15.7		1
07/02/22 0:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/02/22 1:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/02/22 2:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/02/22 3:00	0.7			1.5			14.6		1	0	X		0	X		0	X	1
07/02/22 4:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/02/22 5:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/02/22 6:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/02/22 7:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/02/22 8:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/02/22 9:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/02/22 10:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
07/02/22 11:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
07/02/22 12:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
07/02/22 13:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
07/02/22 14:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
07/02/22 15:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
07/02/22 16:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
07/02/22 17:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
07/02/22 18:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/02/22 19:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/02/22 20:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/02/22 21:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/02/22 22:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/02/22 23:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/03/22 0:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/03/22 1:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/03/22 2:00	0.6			1.4			14.6		1	0	X		0	X		0	X	1
07/03/22 3:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/03/22 4:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/03/22 5:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/03/22 6:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/03/22 7:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/03/22 8:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/03/22 9:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/03/22 10:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/03/22 11:00	0.5			1.5			14.7		1	0	X		0	X		0	X	1
07/03/22 12:00	0.5			1.5			14.7		1	0	X		0	X		0	X	1
07/03/22 13:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
07/03/22 14:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
07/03/22 15:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
07/03/22 16:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
07/03/22 17:00	0.5			1.5			14.7		1	0	X		0	X		0	X	1
07/03/22 18:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
07/03/22 19:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
07/03/22 20:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
07/03/22 21:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/03/22 22:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/03/22 23:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/04/22 0:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/04/22 1:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/04/22 2:00	0.6			1.7			14.6		1	0	X		0	X		0	X	1
07/04/22 3:00	0.7			1.5			14.6		1	0	X		0	X		0	X	1
07/04/22 4:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/04/22 5:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/04/22 6:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/04/22 7:00	0.6			1.6			14.6		1	0	X		0	X		0	X	1
07/04/22 8:00	0.6			1.7			14.6		1	0	X		0	X		0	X	1
07/04/22 9:00	0.6			1.7			14.7		1	0	X		0	X		0	X	1
07/04/22 10:00	0.6			1.7			14.7		1	0	X		0	X		0	X	1
07/04/22 11:00	0.5			1.7			14.7		1	0	X		0	X		0	X	1
07/04/22 12:00	0.5			1.7			14.7		1	0	X		0	X		0	X	1
07/04/22 13:00	0.5			1.7			14.7		1	0	X		0	X		0	X	1
07/04/22 14:00	0.5			1.7			14.7		1	0	X		0	X		0	X	1
07/04/22 15:00	0.5			1.7			14.7		1	0	X		0	X		0	X	1
07/04/22 16:00	0.5			1.7			14.7		1	0	X		0	X		0	X	1
07/04/22 17:00	0.5			1.6			14.7		1	0	X		0	X		0	X	1
07/04/22 18:00	0.5			1.6			14.7		1	0	X		0	X		0	X	1
07/04/22 19:00	0.5			1.6			14.7		1	0	X		0	X		0	X	1
07/04/22 20:00	0.5			1.6			14.7		1	0	X		0	X		0	X	1
07/04/22 21:00	0.6			1.6			14.7		1	0	X		0	X		0	X	1
07/04/22 22:00	0.6			1.6			14.6		1	0	X		0	X		0	X	1
07/04/22 23:00	0.6			1.6			14.6		1	0	X		0	X		0	X	1
07/05/22 0:00	0.6			1.6			14.6		1	0	X		0	X		0	X	1
07/05/22 1:00	0.6			1.6			14.6		1	0	X		0	X		0	X	1
07/05/22 2:00	0.6			1.6			14.6		1	0	X		0	X		0	X	1
07/05/22 3:00	0.6			1.6			14.6		1	0	X		0	X		0	X	1
07/05/22 4:00	0.6			1.6			14.6		1	0	X		0	X		0	X	1
07/05/22 5:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/05/22 6:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/05/22 7:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/05/22 8:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/05/22 9:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
07/05/22 10:00	0.5			1.5			14.7		1	0	X		0	X		0	X	1
07/05/22 11:00	0.5			1.5			14.7		1	0	X		0	X		0	X	1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/05/22 12:00	0.5			1.5			14.7		1	0	X		0	X		0	X	1
07/05/22 13:00	0.5			1.5			14.7		1	0	X		0	X		0	X	1
07/05/22 14:00	0.5			1.5			14.7		1	0	X		0	X		0	X	1
07/05/22 15:00	0.6			1.5			14.5		1	0			0			15.8		1
07/05/22 16:00	1			1.5			14.2		1	1.2			1.6			14.1		1
07/05/22 17:00	1			1.5			13.9		1	1.1			1.5			13.9		1
07/05/22 18:00	1.1			1.5			14		1	1.2			1.5			13.9		1
07/05/22 19:00	1.1			1.5			14		1	1.2			1.5			14		1
07/05/22 20:00	1.1			1.5			14.1		1	1.3			1.5			14		1
07/05/22 21:00	0.9			1.5			14.4		1	1			1.5			14.4		1
07/05/22 22:00	0.7			1.4			14.5		1	0			0			17.3		1
07/05/22 23:00	0.7			1.5			14.5		1	0	X		0	X		0	X	1
07/06/22 0:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/06/22 1:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/06/22 2:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/06/22 3:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/06/22 4:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/06/22 5:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/06/22 6:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/06/22 7:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/06/22 8:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/06/22 9:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
07/06/22 10:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
07/06/22 11:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
07/06/22 12:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
07/06/22 13:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
07/06/22 14:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
07/06/22 15:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
07/06/22 16:00	0.6			1.5			14.7		1	0			0			19.3		1
07/06/22 17:00	0.6			1.4			14.6		1	0.7			0.8			14.6		1
07/06/22 18:00	0.9			1.5			14.3		1	1			1.4			14.3		1
07/06/22 19:00	1.2			1.5			14.1		1	1.3			1.5			14		1
07/06/22 20:00	1.5			1.5			14.2		1	1.4			1.5			14.1		1
07/06/22 21:00	1.2			1.5			14.3		1	1.2			1.5			14.2		1
07/06/22 22:00	0.6			1.4			14.6		1	0.5			1.3			15.4		1
07/06/22 23:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/07/22 0:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/07/22 1:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/07/22 2:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/07/22 3:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/07/22 4:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/07/22 5:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/07/22 6:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/07/22 7:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/07/22 8:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/07/22 9:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/07/22 10:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
07/07/22 11:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
07/07/22 12:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
07/07/22 13:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
07/07/22 14:00	0.6			1.5			14.6		1	0			0			20.4		1
07/07/22 15:00	0.6			1.4			14.5		1	0.8			1.8			14.9		1
07/07/22 16:00	1			1.5			14.2		1	0.9			1.5			14.2		1
07/07/22 17:00	0.9			1.5			13.9		1	0.9			1.5			13.8		1
07/07/22 18:00	0.7			1.5			13.6		1	0.7			1.5			13.5		1
07/07/22 19:00	1.1			1.5			14.1		1	1			1.5			14		1
07/07/22 20:00	1.2			1.5			14.1		1	1			1.5			14		1
07/07/22 21:00	1.2			1.5			14.1		1	1			1.5			14		1
07/07/22 22:00	1.1			1.5			14.3		1	0.9			1.5			14.2		1
07/07/22 23:00	0.7			1.4			14.5		1	0.7			1.4			14.8		1
07/08/22 0:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/08/22 1:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
07/08/22 2:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/08/22 3:00	0.7			1.5			14.6		1	0	X		0	X		0	X	1
07/08/22 4:00	0.6			1.5			14.5		1	0	X		0	X		0	X	1
07/08/22 5:00	0.7			1.5			14.5		1	0	X		0	X		0	X	1
07/08/22 6:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/08/22 7:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
07/08/22 8:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
07/08/22 9:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
07/08/22 10:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
07/08/22 11:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
07/08/22 12:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
07/08/22 13:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/08/22 14:00	0.6			1.5			14.5		1	0			0			15.3		1
07/08/22 15:00	0.8			1.5			14.3		1	0.9			1.5			14.2		1
07/08/22 16:00	0.8			1.5			14.3		1	1			1.5			14		1
07/08/22 17:00	0.5			1.5			14.8		1	0.6			1.4			14.7		1
07/08/22 18:00	0.6			1.4			14.7		1	0.6			1.4			15		1
07/08/22 19:00	0.7			1.4			14.5		1	0	X		0	X		0	X	1
07/08/22 20:00	1.6			1.5			14.3		1	0	X		0	X		0	X	1
07/08/22 21:00	1.5			1.5			14.3		1	0	X		0	X		0	X	1
07/08/22 22:00	1.5			1.5			14.3		1	0	X		0	X		0	X	1
07/08/22 23:00	1.5			1.5			14.3		1	0	X		0	X		0	X	1
07/09/22 0:00	1.5			1.5			14.3		1	0	X		0	X		0	X	1
07/09/22 1:00	0.7			1.5			14.5		1	0	X		0	X		0	X	1
07/09/22 2:00	0.6			1.6			14.6		1	0	X		0	X		0	X	1
07/09/22 3:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/09/22 4:00	0.7			1.5			14.4		1	0	X		0	X		0	X	1
07/09/22 5:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/09/22 6:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/09/22 7:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/09/22 8:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
07/09/22 9:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
07/09/22 10:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
07/09/22 11:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
07/09/22 12:00	0.6			1.5			14.8		1	0	X		0	X		0	X	1
07/09/22 13:00	0.6			1.5			14.8		1	0	X		0	X		0	X	1
07/09/22 14:00	0.6			1.5			14.8		1	0	X		0	X		0	X	1
07/09/22 15:00	0.5			1.5			14.8		1	0	X		0	X		0	X	1
07/09/22 16:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/09/22 17:00	0.5			1.5			14.8		1	0	X		0	X		0	X	1
07/09/22 18:00	0.5			1.5			14.8		1	0	X		0	X		0	X	1
07/09/22 19:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
07/09/22 20:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
07/09/22 21:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
07/09/22 22:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
07/09/22 23:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
07/10/22 0:00	0.7			1.5			14.7		1	0	X		0	X		0	X	1
07/10/22 1:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/10/22 2:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/10/22 3:00	0.7			1.5			14.6		1	0	X		0	X		0	X	1
07/10/22 4:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/10/22 5:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/10/22 6:00	0.6			1.5			14.6		1	0	X		0	X		0	X	1
07/10/22 7:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
07/10/22 8:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
07/10/22 9:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
07/10/22 10:00	0.6			1.5			14.7		1	0	X		0	X		0	X	1
07/10/22 11:00	0.6			1.5			14.8		1	0	X		0	X		0	X	1
07/10/22 12:00	0.6			1.5			14.8		1	0	X		0	X		0	X	1
07/10/22 13:00	0.6			1.5			14.8		1	0	X		0	X		0	X	1
07/10/22 14:00	0.6			1.5			14.7		1	0			0			20.9		1
07/10/22 15:00	0.7			1.5			14.5		1	0.7			1.8			15.2		1
07/10/22 16:00	1			1.5			14.5		1	0.9			1.1			14.5		1
07/10/22 17:00	0.7			1.5			14.6		1	0.7			1.4			14.5		1
07/10/22 18:00	0.7			1.5			14.6		1	0.7			1.5			14.5		1
07/10/22 19:00	0.7			1.5			14.6		1	0.7			1.5			14.5		1
07/10/22 20:00	0.7			1.5			14.6		1	0.7			1.5			14.5		1
07/10/22 21:00	0.7			1.5			14.5		1	0.7			1.5			14.4		1
07/10/22 22:00	0.7			1.5			14.5		1	0.7			1.5			14.5		1
07/10/22 23:00	0.7			1.5			14.6		1	0.7			1.5			14.5		1
07/11/22 0:00	0.7			1.5			14.6		1	0.7			1.5			14.5		1
07/11/22 1:00	0.7			1.5			14.6		1	0.7			1.5			14.5		1
07/11/22 2:00	0.7			1.6			14.6		1	0.7			1.7			14.5		1
07/11/22 3:00	0.7			1.5			14.5		1	0.7			1.5			14.5		1
07/11/22 4:00	0.7			1.5			14.5		1	0.7			1.5			14.5		1
07/11/22 5:00	0.7			1.5			14.5		1	0.7			1.5			14.5		1
07/11/22 6:00	0.6			1.5			14.8		1	0.6			1.5			14.7		1
07/11/22 7:00	0.5			1.5			14.9		1	0.6			1.5			14.8		1
07/11/22 8:00	0.5			1.5			14.9		1	0.6			1.5			14.8		1
07/11/22 9:00	0.5			1.5			14.9		1	0.6			1.5			14.8		1
07/11/22 10:00	0.6			1.5			14.8		1	0.6			1.5			14.7		1
07/11/22 11:00	0.6			1.5			14.6		1	0.7			1.4			14.6		1
07/11/22 12:00	1			1.5			13.9		1	1.1			1.5			13.8		1
07/11/22 13:00	0.6			1.5			13.5		1	0.7			1.5			13.4		1
07/11/22 14:00	0.6			1.5			13.4		1	0.6			1.5			13.3		1
07/11/22 15:00	0.5			1.5			13.4		1	0.6			1.5			13.3		1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/11/22 16:00	0.6			1.5			13.4		1	0.6			1.5			13.4		1
07/11/22 17:00	0.6			1.5			13.5		1	0.6			1.5			13.4		1
07/11/22 18:00	0.5			1.5			13.3		1	0.5			1.5			13.3		1
07/11/22 19:00	0.6			1.5			13.4		1	0.6			1.5			13.4		1
07/11/22 20:00	0.7			1.5			13.6		1	0.7			1.5			13.5		1
07/11/22 21:00	1			1.5			13.9		1	1			1.5			13.8		1
07/11/22 22:00	1			1.5			13.8		1	0.9			1.5			13.7		1
07/11/22 23:00	1.1			1.5			13.9		1	1			1.5			13.8		1
07/12/22 0:00	1.1			1.5			13.9		1	1			1.5			13.8		1
07/12/22 1:00	1.1			1.5			13.9		1	1			1.5			13.8		1
07/12/22 2:00	1.2			1.5			14		1	1.2			1.6			13.9		1
07/12/22 3:00	1.1			1.5			13.8		1	1.1			1.5			13.8		1
07/12/22 4:00	1			1.5			13.8		1	1.1			1.5			13.7		1
07/12/22 5:00	1.1			1.5			14.1		1	1.1			1.5			14		1
07/12/22 6:00	0.6			1.5			14.6		1	0.7			1.5			14.5		1
07/12/22 7:00	0.5			1.5			14.8		1	0.6			1.5			14.7		1
07/12/22 8:00	0.5			1.5			14.9		1	0.5			1.5			14.8		1
07/12/22 9:00	0.5			1.5			14.9		1	0.5			1.5			14.8		1
07/12/22 10:00	0.6			1.3			14.8		1	0.5			1.5			14.8		1
07/12/22 11:00	0.5			1.5			14.8		1	0.6			1.5			14.7		1
07/12/22 12:00	0.6			1.5			14.7		1	0.6			1.4			14.6		1
07/12/22 13:00	0.9			1.5			14.4		1	1			1.5			14.3		1
07/12/22 14:00	0.7			1.5			13.6		1	0.8			1.5			13.5		1
07/12/22 15:00	0.8			1.5			13.8		1	0.8			1.5			13.7		1
07/12/22 16:00	0.8			1.5			13.7		1	0.8			1.5			13.6		1
07/12/22 17:00	0.7			1.5			13.5		1	0.7			1.5			13.4		1
07/12/22 18:00	0.8			1.5			13.7		1	0.8			1.5			13.6		1
07/12/22 19:00	0.9			1.6			14		1	0.9			1.6			14		1
07/12/22 20:00	0.8			1.7			14.4		1	0.9			1.7			14.3		1
07/12/22 21:00	0.9			1.7			13.7		1	0.9			1.7			13.6		1
07/12/22 22:00	0.7			1.6			14.5		1	0.8			1.5			14.4		1
07/12/22 23:00	0.7			1.7			14.6		1	0.7			1.6			14.4		1
07/13/22 0:00	0.7			1.7			14.6		1	0.7			1.7			14.4		1
07/13/22 1:00	0.6			1.7			14.5		1	0.6			1.6			14.4		1
07/13/22 2:00	0.6			1.6			14.5		1	0.6			1.6			14.4		1
07/13/22 3:00	1.2			1.7			14.4		1	1.4			1.7			14.3		1
07/13/22 4:00	0.6			1.7			13.3		1	0.7			1.7			13.2		1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/13/22 5:00	0.9			1.6			13.6		1	1.1			1.6			13.5		1
07/13/22 6:00	1.3			1.6			14.3		1	1.3			1.6			14.2		1
07/13/22 7:00	0.5			1.6			14.7		1	0.5			1.6			14.6		1
07/13/22 8:00	0.5			1.6			14.8		1	0.5			1.6			14.7		1
07/13/22 9:00	0.5			1.7			14.8		1	0.5			1.6			14.7		1
07/13/22 10:00	0.4			1.7			14.8		1	0.5			1.6			14.7		1
07/13/22 11:00	0.4			1.7			14.9		1	0.5			1.7			14.8		1
07/13/22 12:00	0.4			1.7			14.9		1	0.5			1.7			14.8		1
07/13/22 13:00	0.4			1.7			14.9		1	0.5			1.7			14.8		1
07/13/22 14:00	0.5			1.6			14.8		1	0.5			1.5			14.7		1
07/13/22 15:00	0.9			1.7			14.1		1	1.1			1.6			14		1
07/13/22 16:00	1			1.7			13.9		1	1.1			1.7			13.8		1
07/13/22 17:00	0.7			1.5			14.5		1	0.7			1.3			14.4		1
07/13/22 18:00	0.9			1.7			14.2		1	1			1.7			14.1		1
07/13/22 19:00	1			1.7			14		1	1			1.7			13.9		1
07/13/22 20:00	0.7			1.7			13.5		1	0.8			1.7			13.5		1
07/13/22 21:00	1			1.6			13.9		1	1			1.7			13.8		1
07/13/22 22:00	1.2			1.6			14.1		1	1			1.7			14		1
07/13/22 23:00	0.7			1.6			14.5		1	0.8			1.6			14.5		1
07/14/22 0:00	0.8			1.5			14.5		1	0			0			17.4		1
07/14/22 1:00	0.7			1.6			14.5		1	0	X		0	X		0	X	1
07/14/22 2:00	0.7			1.7			14.5		1	0	X		0	X		0	X	1
07/14/22 3:00	0.7			1.6			14.5		1	0	X		0	X		0	X	1
07/14/22 4:00	0.7			1.7			14.5		1	0	X		0	X		0	X	1
07/14/22 5:00	0.6			1.6			14.5		1	0	X		0	X		0	X	1
07/14/22 6:00	0.8			1.6			14.5		1	0	X		0	X		0	X	1
07/14/22 7:00	0.6			1.6			14.5		1	0	X		0	X		0	X	1
07/14/22 8:00	0.6			1.6			14.7		1	0	X		0	X		0	X	1
07/14/22 9:00	0.6			1.7			14.7		1	0	X		0	X		0	X	1
07/14/22 10:00	0.6			1.7			14.7		1	0	X		0	X		0	X	1
07/14/22 11:00	0.6			1.6			14.7		1	0	X		0	X		0	X	1
07/14/22 12:00	0.6			1.6			14.7		1	0	X		0	X		0	X	1
07/14/22 13:00	0.6			1.6			14.6		1	0.7			0.8			15.6		1
07/14/22 14:00	0.7			1.4			14		1	0.8			1			14.3		1
07/14/22 15:00	0.7			1.5			13.7		1	0.7			1.5			13.5		1
07/14/22 16:00	0.8			1.5			13.7		1	0.8			1.5			13.7		1
07/14/22 17:00	0.6			1.6			13.5		1	0.7			1.6			13.4		1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/14/22 18:00	0.6			1.6			13.5		1	0.7			1.7			13.4		1
07/14/22 19:00	1			1.6			13.9		1	1			1.6			13.8		1
07/14/22 20:00	1			1.6			13.9		1	1			1.6			13.8		1
07/14/22 21:00	1.1			1.6			14		1	1.1			1.6			13.9		1
07/14/22 22:00	1.3			1.6			14.1		1	1.3			1.6			14		1
07/14/22 23:00	1.4			1.6			14.1		1	1.4			1.6			14		1
07/15/22 0:00	0.8			1.6			14.4		1	0.8			1.5			14.3		1
07/15/22 1:00	0.9			1.6			14.5		1	1.1			1.6			14.4		1
07/15/22 2:00	1.2			1.8			13.9		1	1.1			1.9			13.8		1
07/15/22 3:00	1.5			1.6			14.2		1	1.4			1.6			14.1		1
07/15/22 4:00	1.5			1.6			14.2		1	1.4			1.6			14.1		1
07/15/22 5:00	1.3			1.6			14		1	1.3			1.6			13.9		1
07/15/22 6:00	0.9			1.6			14.5		1	0.9			1.5			14.4		1
07/15/22 7:00	0.5			1.6			14.8		1	0.5			1.6			14.7		1
07/15/22 8:00	0.5			1.6			14.8		1	0.5			1.6			14.7		1
07/15/22 9:00	0.5			1.6			14.8		1	0.5			1.6			14.7		1
07/15/22 10:00	0.5			1.6			14.8		1	0.5			1.6			14.7		1
07/15/22 11:00	0.5			1.6			14.8		1	0.6			1.6			14.7		1
07/15/22 12:00	0.5			1.6			14.8		1	0.6			1.6			14.7		1
07/15/22 13:00	0.8			1.6			14.6		1	0.9			1.5			14.5		1
07/15/22 14:00	0.9			1.6			13.8		1	0.9			1.6			13.7		1
07/15/22 15:00	0.8			1.6			13.7		1	0.8			1.6			13.7		1
07/15/22 16:00	0.9			1.6			13.9		1	0.9			1.6			13.8		1
07/15/22 17:00	0.7			1.6			13.5		1	0.7			1.6			13.5		1
07/15/22 18:00	0.2			1.6			12.8		1	0.4			1.6			12.7		1
07/15/22 19:00	0.4			1.6			13.1		1	0.5			1.6			13		1
07/15/22 20:00	0.5			1.7			13.3		1	0.6			1.7			13.2		1
07/15/22 21:00	0.6			1.7			13.3		1	0.6			1.7			13.3		1
07/15/22 22:00	0.5			1.7			13.3		1	0.6			1.7			13.2		1
07/15/22 23:00	0.8			1.7			13.7		1	0.9			1.7			13.6		1
07/16/22 0:00	1.2			1.7			14.2		1	1.2			1.7			14.1		1
07/16/22 1:00	0.7			1.7			14.5		1	0.7			1.7			14.4		1
07/16/22 2:00	0.7			1.6			14.6		1	0.7			1.5			14.4		1
07/16/22 3:00	0.7			1.7			14.6		1	0.7			1.7			14.4		1
07/16/22 4:00	0.6			1.7			14.5		1	0.6			1.7			14.4		1
07/16/22 5:00	0.6			1.6			14.5		1	0.7			1.5			14.4		1
07/16/22 6:00	0.6			1.6			14.6		1	0.6			1.5			14.5		1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/16/22 7:00	0.5			1.6			14.8		1	0.5			1.6			14.7		1
07/16/22 8:00	0.5			1.5			14.8		1	0.5			1.5			14.7		1
07/16/22 9:00	0.5			1.6			14.8		1	0.6			1.5			14.7		1
07/16/22 10:00	0.5			1.6			14.8		1	0.6			1.5			14.7		1
07/16/22 11:00	0.6			1.6			14.8		1	0.6			1.6			14.7		1
07/16/22 12:00	0.6			1.6			14.8		1	0.6			1.6			14.7		1
07/16/22 13:00	0.6			1.6			14.7		1	0.6			1.5			14.6		1
07/16/22 14:00	1.2			1.6			14.3		1	1.1			1.6			14.1		1
07/16/22 15:00	0.2			1.6			12.8		1	0.4			1.6			12.7		1
07/16/22 16:00	0.7			1.6			13.7		1	0.7			1.6			13.6		1
07/16/22 17:00	0.5			1.6			13.3		1	0.6			1.6			13.2		1
07/16/22 18:00	0.3			1.6			13		1	0.4			1.6			13		1
07/16/22 19:00	0.7			1.6			13.7		1	0.8			1.6			13.6		1
07/16/22 20:00	0.4			1.6			13.1		1	0.5			1.6			13		1
07/16/22 21:00	0.3			1.6			12.8		1	0.4			1.6			12.8		1
07/16/22 22:00	0.3			1.6			12.9		1	0.4			1.6			12.9		1
07/16/22 23:00	0.6			1.6			13.3		1	0.7			1.6			13.3		1
07/17/22 0:00	0.3			1.6			12.9		1	0.4			1.6			12.8		1
07/17/22 1:00	0.4			1.6			13		1	0.5			1.6			12.9		1
07/17/22 2:00	0.4			1.4			13		1	0.5			1.3			13		1
07/17/22 3:00	0.4			1.6			13		1	0.5			1.6			12.9		1
07/17/22 4:00	0.5			1.6			13.2		1	0.6			1.6			13.1		1
07/17/22 5:00	0.9			1.6			14.5		1	0.9			1.6			14.3		1
07/17/22 6:00	0.7			1.6			14.5		1	0.7			1.6			14.4		1
07/17/22 7:00	0.6			1.6			14.8		1	0.6			1.6			14.6		1
07/17/22 8:00	0.6			1.6			14.6		1	0.6			1.5			14.5		1
07/17/22 9:00	0.5			1.6			14.8		1	0.6			1.6			14.7		1
07/17/22 10:00	0.5			1.5			14.8		1	0.6			1.5			14.7		1
07/17/22 11:00	0.8			1.6			14.4		1	1			1.5			14.3		1
07/17/22 12:00	0.8			1.6			13.8		1	0.8			1.6			13.7		1
07/17/22 13:00	0.6			1.6			13.5		1	0.7			1.6			13.4		1
07/17/22 14:00	0.8			1.6			13.8		1	0.8			1.6			13.7		1
07/17/22 15:00	0.5			1.6			13.3		1	0.6			1.6			13.2		1
07/17/22 16:00	0.4			1.6			13.3		1	0.6			1.6			13.2		1
07/17/22 17:00	0.5			1.6			13.4		1	0.6			1.6			13.3		1
07/17/22 18:00	0.3			1.6			12.9		1	0.4			1.6			12.8		1
07/17/22 19:00	0.3			1.6			13		1	0.4			1.6			12.9		1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/17/22 20:00	0.2			1.6			12.8		1	0.4			1.6			12.7		1
07/17/22 21:00	0.7			1.6			13.5		1	0.7			1.6			13.4		1
07/17/22 22:00	1.1			1.6			14		1	1.1			1.6			13.9		1
07/17/22 23:00	1.2			1.6			14		1	1.1			1.6			13.9		1
07/18/22 0:00	1.2			1.6			14.1		1	1.1			1.6			14		1
07/18/22 1:00	1.1			1.6			14.2		1	1			1.6			14.1		1
07/18/22 2:00	0.6			1.8			14.7		1	0.7			1.5			14.6		1
07/18/22 3:00	0.5			1.6			14.9		1	0.6			1.6			14.8		1
07/18/22 4:00	0.6			1.5			14.7		1	0.6			1.5			14.6		1
07/18/22 5:00	1.1			1.6			14.2		1	1.3			1.6			14.1		1
07/18/22 6:00	1.2			1.6			14.1		1	1.4			1.6			14		1
07/18/22 7:00	0.8			1.6			14.5		1	0.9			1.6			14.3		1
07/18/22 8:00	0.6			1.6			14.7		1	0.6			1.5			14.6		1
07/18/22 9:00	1			1.6			14.1		1	1.2			1.6			14		1
07/18/22 10:00	1			1.6			13.9		1	1.2			1.6			13.9		1
07/18/22 11:00	1			1.6			13.9		1	1.2			1.6			13.8		1
07/18/22 12:00	0.9			1.6			13.8		1	0.9			1.6			13.7		1
07/18/22 13:00	0.4			1.6			13.1		1	0.5			1.6			13.1		1
07/18/22 14:00	0.6			1.6			13.6		1	0.7			1.6			13.5		1
07/18/22 15:00	0.2			1.6			12.8		1	0.4			1.6			12.8		1
07/18/22 16:00	0.2			1.6			12.8		1	0.4			1.6			12.8		1
07/18/22 17:00	0.3			1.7			13		1	0.4			1.7			12.9		1
07/18/22 18:00	0.2			1.7			12.9		1	0.4			1.7			12.8		1
07/18/22 19:00	0.3			1.7			13		1	0.5			1.7			13		1
07/18/22 20:00	0.3			1.7			12.9		1	0.4			1.7			12.9		1
07/18/22 21:00	0.7			1.7			13.6		1	0.8			1.7			13.5		1
07/18/22 22:00	1.2			1.7			14.1		1	1			1.7			14		1
07/18/22 23:00	1			1.7			14.3		1	1			1.7			14.2		1
07/19/22 0:00	0.6			1.7			14.8		1	0.6			1.7			14.7		1
07/19/22 1:00	0.6			1.7			14.8		1	0.6			1.7			14.7		1
07/19/22 2:00	0.6			1.7			14.7		1	0.6			1.7			14.6		1
07/19/22 3:00	0.6			1.7			14.7		1	0.6			1.7			14.6		1
07/19/22 4:00	0.6			1.7			14.7		1	0.6			1.7			14.6		1
07/19/22 5:00	0.6			1.7			14.7		1	0.6			1.7			14.6		1
07/19/22 6:00	0.5			1.7			14.8		1	0.6			1.7			14.7		1
07/19/22 7:00	0.5			1.7			14.9		1	0.5			1.7			14.8		1
07/19/22 8:00	0.5			1.7			14.9		1	0.5			1.7			14.8		1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/19/22 9:00	0.5			1.6			14.9		1	0.6			1.7			14.8		1
07/19/22 10:00	0.6			1.7			14.7		1	0.7			1.5			14.6		1
07/19/22 11:00	0.6			1.5			14.6		1	0.9			1.4			14.4		1
07/19/22 12:00	0.8			1.7			13.7		1	1.3			1.5			13.9		1
07/19/22 13:00	0.8			1.7			13.8		1	0.9			1.7			13.8		1
07/19/22 14:00	0.9			1.7			14		1	1			1.7			13.9		1
07/19/22 15:00	0.9			1.7			13.9		1	1			1.7			13.8		1
07/19/22 16:00	0.5			1.7			13.2		1	0.7			1.7			13.2		1
07/19/22 17:00	0.4			1.7			13.1		1	0.5			1.7			13		1
07/19/22 18:00	0.1			1.7			12.6		1	0.4			1.7			12.6		1
07/19/22 19:00	0.4			1.5			13.1		1	0.6			1.5			13		1
07/19/22 20:00	1.1			1.5			14		1	1.1			1.5			13.9		1
07/19/22 21:00	1.1			1.5			13.9		1	1			1.5			13.9		1
07/19/22 22:00	1.3			1.5			14.1		1	1.1			1.5			14		1
07/19/22 23:00	0.9			1.5			14.5		1	0.9			1.4			14.4		1
07/20/22 0:00	0.5			1.6			14.9		1	0.6			1.6			14.8		1
07/20/22 1:00	0.5			1.6			14.9		1	0.6			1.6			14.8		1
07/20/22 2:00	0.5			1.6			14.9		1	0.6			1.6			14.8		1
07/20/22 3:00	0.5			1.6			14.8		1	0.6			1.6			14.7		1
07/20/22 4:00	0.5			1.6			14.8		1	0.6			1.6			14.7		1
07/20/22 5:00	0.5			1.5			14.8		1	0.6			1.5			14.7		1
07/20/22 6:00	0.5			1.5			14.8		1	0.6			1.5			14.7		1
07/20/22 7:00	0.6			1.5			14.8		1	0.6			1.5			14.7		1
07/20/22 8:00	0.5			1.5			14.9		1	0.6			1.5			14.8		1
07/20/22 9:00	0.5			1.5			14.8		1	0.6			1.5			14.7		1
07/20/22 10:00	0.5			1.5			14.9		1	0.6			1.5			14.8		1
07/20/22 11:00	0.5			1.5			14.8		1	0.6			1.5			14.7		1
07/20/22 12:00	0.9			1.4			14.4		1	1.1			1.4			14.3		1
07/20/22 13:00	0.8			1.5			13.7		1	1			1.5			13.6		1
07/20/22 14:00	0.2			1.5			12.5		1	0.3			1.5			12.4		1
07/20/22 15:00	0.8			1.5			13.7		1	0.8			1.5			13.7		1
07/20/22 16:00	0.8			1.5			13.7		1	0.9			1.5			13.7		1
07/20/22 17:00	0.2			1.5			12.7		1	0.4			1.5			12.6		1
07/20/22 18:00	0.4			1.5			13.2		1	0.5			1.5			13.1		1
07/20/22 19:00	0.3			1.5			13		1	0.5			1.5			12.9		1
07/20/22 20:00	0.6			1.5			13.4		1	0.7			1.5			13.3		1
07/20/22 21:00	0.8			1.5			14.5		1	0.8			1.5			14.4		1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/20/22 22:00	0.6			1.4			14.8		1	0.6			1.4			14.7		1
07/20/22 23:00	0.5			1.5			14.9		1	0.6			1.5			14.8		1
07/21/22 0:00	0.6			1.5			14.8		1	0.6			1.5			14.7		1
07/21/22 1:00	0.5			1.5			14.8		1	0.6			1.5			14.7		1
07/21/22 2:00	0.5			1.4			14.8		1	0.6			1.4			14.7		1
07/21/22 3:00	0.6			1.4			14.7		1	0.6			1.5			14.6		1
07/21/22 4:00	0.5			1.5			14.8		1	0.6			1.5			14.7		1
07/21/22 5:00	0.5			1.5			14.8		1	0.6			1.5			14.7		1
07/21/22 6:00	0.5			1.6			14.8		1	0.6			1.6			14.7		1
07/21/22 7:00	0.5			1.6			14.8		1	0.6			1.6			14.7		1
07/21/22 8:00	0.5			1.6			14.9		1	0.6			1.6			14.8		1
07/21/22 9:00	0.5			1.6			14.9		1	0.6			1.6			14.8		1
07/21/22 10:00	0.5			1.6			14.9		1	0.6			1.6			14.8		1
07/21/22 11:00	0.5			1.6			14.9		1	0.5			1.6			14.8		1
07/21/22 12:00	0.5			1.6			14.9		1	0.6			1.6			14.8		1
07/21/22 13:00	0.7			1.6			14.6		1	0.7			1.4			14.6		1
07/21/22 14:00	1			1.6			13.8		1	1			1.6			13.7		1
07/21/22 15:00	0.9			1.6			13.8		1	0.9			1.6			13.7		1
07/21/22 16:00	0.9			1.6			13.8		1	0.9			1.6			13.7		1
07/21/22 17:00	0.7			1.6			13.5		1	0.7			1.6			13.4		1
07/21/22 18:00	0.5			1.6			13.3		1	0.6			1.6			13.2		1
07/21/22 19:00	1			1.6			13.8		1	1			1.6			13.8		1
07/21/22 20:00	1.1			1.6			13.9		1	1			1.6			13.8		1
07/21/22 21:00	1			1.6			14.3		1	1			1.6			14.2		1
07/21/22 22:00	0.5			1.6			14.9		1	0.6			1.6			14.8		1
07/21/22 23:00	0.6			1.6			14.8		1	0.6			1.6			14.7		1
07/22/22 0:00	0.6			1.6			14.7		1	0.7			1.6			14.7		1
07/22/22 1:00	0.6			1.6			14.8		1	0.7			1.6			14.7		1
07/22/22 2:00	0.7			1.6			14.5		1	0.8			1.4			14.4		1
07/22/22 3:00	0.6			1.6			14.7		1	0.7			1.6			14.6		1
07/22/22 4:00	0.6			1.6			14.7		1	0.7			1.6			14.6		1
07/22/22 5:00	0.6			1.6			14.7		1	0.7			1.6			14.6		1
07/22/22 6:00	0.5			1.6			14.8		1	0.6			1.6			14.7		1
07/22/22 7:00	0.5			1.6			14.8		1	0.6			1.6			14.8		1
07/22/22 8:00	0.5			1.6			14.9		1	0.6			1.6			14.8		1
07/22/22 9:00	0.5			1.6			14.9		1	0.6			1.6			14.8		1
07/22/22 10:00	0.5			1.6			14.9		1	0.6			1.6			14.8		1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/22/22 11:00	0.5			1.6			14.9		1	0.6			1.6			14.8		1
07/22/22 12:00	0.4			1.6			14.9		1	0.6			1.6			14.9		1
07/22/22 13:00	0.5			1.6			15		1	0.6			1.6			14.9		1
07/22/22 14:00	0.8			1.5			14.7		1	0.9			1.4			14.6		1
07/22/22 15:00	1			1.6			13.9		1	1.1			1.6			13.8		1
07/22/22 16:00	1			1.6			13.9		1	1.1			1.6			13.8		1
07/22/22 17:00	1			1.6			13.9		1	1.2			1.6			13.8		1
07/22/22 18:00	1			1.6			13.9		1	1.2			1.6			13.8		1
07/22/22 19:00	1.1			1.6			14		1	1.2			1.6			13.9		1
07/22/22 20:00	1.2			1.6			14		1	1.3			1.6			13.9		1
07/22/22 21:00	0.9			1.5			14.4		1	1			1.5			14.3		1
07/22/22 22:00	0.6			1.5			14.7		1	0.7			1.5			14.6		1
07/22/22 23:00	0.7			1.4			14.6		1	0.7			1.2			15		1
07/23/22 0:00	0.7			1.6			14.5		1	0		X	0		X	0		X
07/23/22 1:00	0.6			1.6			14.6		1	0		X	0		X	0		X
07/23/22 2:00	0.7			1.6			14.6		1	0		X	0		X	0		X
07/23/22 3:00	0.6			1.5			14.6		1	0		X	0		X	0		X
07/23/22 4:00	0.7			1.5			14.6		1	0		X	0		X	0		X
07/23/22 5:00	0.7			1.5			14.5		1	0		X	0		X	0		X
07/23/22 6:00	1.9			1.6			14.4		1	0		X	0		X	0		X
07/23/22 7:00	2			1.6			14.3		1	0		X	0		X	0		X
07/23/22 8:00	2			1.6			14.3		1	0		X	0		X	0		X
07/23/22 9:00	1			1.6			14.5		1	0		X	0		X	0		X
07/23/22 10:00	0.6			1.6			14.7		1	0		X	0		X	0		X
07/23/22 11:00	0.6			1.6			14.8		1	0		X	0		X	0		X
07/23/22 12:00	0.6			1.6			14.8		1	0		X	0		X	0		X
07/23/22 13:00	0.6			1.6			14.8		1	0		X	0		X	0		X
07/23/22 14:00	0.6			1.6			14.8		1	0		X	0		X	0		X
07/23/22 15:00	0.6			1.5			14.7		1	0		X	0		X	0		X
07/23/22 16:00	0.6			1.6			14.6		1	0.6			1.1			15.5		1
07/23/22 17:00	0.8			1.6			14.7		1	0.9			1.5			14.7		1
07/23/22 18:00	0.5			1.6			13.2		1	0.6			1.6			13.1		1
07/23/22 19:00	0.6			1.6			13.5		1	0.7			1.6			13.4		1
07/23/22 20:00	1.2			1.6			14		1	1.1			1.6			13.9		1
07/23/22 21:00	1			1.6			14.2		1	1			1.6			14.1		1
07/23/22 22:00	0.7			1.5			14.6		1	0.6			1.5			15.1		1
07/23/22 23:00	1.7			1.6			14.4		1	0		X	0		X	0		X

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/24/22 0:00	0.7			1.6			14.5		1	0	X		0	X		0	X	1
07/24/22 1:00	0.7			1.6			14.5		1	0	X		0	X		0	X	1
07/24/22 2:00	0.7			1.6			14.5		1	0	X		0	X		0	X	1
07/24/22 3:00	0.7			1.6			14.5		1	0	X		0	X		0	X	1
07/24/22 4:00	0.6			1.6			14.5		1	0	X		0	X		0	X	1
07/24/22 5:00	0.6			1.6			14.6		1	0			0			15.6		1
07/24/22 6:00	0.6			1.5			14.7		1	0.6			1.3			14.6		1
07/24/22 7:00	0.6			1.6			14.7		1	0.6			1.6			14.6		1
07/24/22 8:00	0.5			1.6			14.8		1	0.6			1.6			14.7		1
07/24/22 9:00	0.5			1.6			14.9		1	0.6			1.6			14.8		1
07/24/22 10:00	0.5			1.6			14.9		1	0.6			1.6			14.8		1
07/24/22 11:00	0.5			1.6			14.9		1	0.6			1.6			14.8		1
07/24/22 12:00	0.5			1.6			14.9		1	0.6			1.6			14.8		1
07/24/22 13:00	0.5			1.6			14.9		1	0.6			1.6			14.9		1
07/24/22 14:00	0.5			1.6			15		1	0.6			1.6			14.9		1
07/24/22 15:00	0.5			1.6			15		1	0.6			1.6			14.9		1
07/24/22 16:00	0.9			1.6			14.4		1	1			1.5			14.3		1
07/24/22 17:00	0.8			1.6			13.8		1	0.9			1.6			13.7		1
07/24/22 18:00	0.9			1.6			13.8		1	0.9			1.6			13.7		1
07/24/22 19:00	1.1			1.6			13.9		1	1.1			1.6			13.9		1
07/24/22 20:00	1			1.6			14.2		1	1			1.6			14.2		1
07/24/22 21:00	0.6			1.5			14.9		1	0.6			1.4			14.8		1
07/24/22 22:00	0.5			1.5			14.9		1	0.6			1.5			14.8		1
07/24/22 23:00	0.6			1.5			14.7		1	0.7			1.5			14.7		1
07/25/22 0:00	0.5			1.5			14.8		1	0.6			1.5			14.7		1
07/25/22 1:00	0.5			1.5			14.8		1	0.6			1.5			14.7		1
07/25/22 2:00	0.5			1.5			14.8		1	0.6			1.5			14.7		1
07/25/22 3:00	0.6			1.5			14.8		1	0.6			1.5			14.7		1
07/25/22 4:00	0.6			1.5			14.7		1	0.7			1.5			14.6		1
07/25/22 5:00	0.6			1.5			14.7		1	0.7			1.5			14.6		1
07/25/22 6:00	0.6			1.5			14.7		1	0.7			1.5			14.6		1
07/25/22 7:00	0.6			1.5			14.7		1	0.7			1.5			14.6		1
07/25/22 8:00	0.5			1.5			14.8		1	0.6			1.5			14.7		1
07/25/22 9:00	0.5			1.5			14.8		1	0.6			1.5			14.7		1
07/25/22 10:00	0.5			1.5			14.9		1	0.6			1.5			14.8		1
07/25/22 11:00	0.6			1.4			14.8		1	0.6			1.4			14.7		1
07/25/22 12:00	0.6			1.5			14.8		1	0.7			1.5			14.7		1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/25/22 13:00	0.8			1.5			14.4		1	1			1.4			14.3		1
07/25/22 14:00	0.8			1.5			13.7		1	1			1.5			13.6		1
07/25/22 15:00	0.8			1.5			13.6		1	0.8			1.5			13.5		1
07/25/22 16:00	0.7			1.5			13.4		1	0.7			1.5			13.4		1
07/25/22 17:00	0.6			1.5			13.3		1	0.6			1.5			13.2		1
07/25/22 18:00	0.5			1.5			13.2		1	0.6			1.5			13.2		1
07/25/22 19:00	0.9			1.5			13.7		1	0.9			1.5			13.6		1
07/25/22 20:00	1.2			1.5			13.9		1	1.1			1.5			13.8		1
07/25/22 21:00	1.2			1.5			14		1	1.1			1.5			13.9		1
07/25/22 22:00	0.9			1.5			14.4		1	0.8			1.5			14.3		1
07/25/22 23:00	0.7			1.5			14.5		1	0.7			1.4			14.4		1
07/26/22 0:00	0.6			1.5			14.7		1	0.6			1.5			14.6		1
07/26/22 1:00	0.6			1.5			14.7		1	0.6			1.5			14.6		1
07/26/22 2:00	0.6			1.5			14.7		1	0.6			1.5			14.6		1
07/26/22 3:00	0.6			1.5			14.7		1	0.6			1.5			14.6		1
07/26/22 4:00	0.9			1.5			14.5		1	1			1.4			14.3		1
07/26/22 5:00	1.7			1.5			14.2		1	1.7			1.5			14.1		1
07/26/22 6:00	0.7			1.5			14.6		1	0.8			1.5			14.5		1
07/26/22 7:00	0.6			1.5			14.7		1	0.6			1.5			14.6		1
07/26/22 8:00	0.5			1.5			14.8		1	0.6			1.5			14.7		1
07/26/22 9:00	0.5			1.5			14.8		1	0.6			1.5			14.7		1
07/26/22 10:00	0.6			1.4			14.7		1	0.6			1.4			14.6		1
07/26/22 11:00	0.5			1.5			14.8		1	0.6			1.5			14.7		1
07/26/22 12:00	0.6			1.5			14.7		1	0.7			1.5			14.6		1
07/26/22 13:00	1			1.4			14.4		1	1.2			1.4			14.3		1
07/26/22 14:00	1			1.5			13.9		1	1			1.5			13.8		1
07/26/22 15:00	1			1.5			13.8		1	0.9			1.5			13.7		1
07/26/22 16:00	0.7			1.5			13.6		1	0.8			1.5			13.5		1
07/26/22 17:00	0.4			1.5			13.2		1	0.6			1.5			13.1		1
07/26/22 18:00	0.6			1.5			13.5		1	0.8			1.5			13.4		1
07/26/22 19:00	1			1.5			13.8		1	1			1.5			13.7		1
07/26/22 20:00	1.1			1.5			13.9		1	1.1			1.5			13.8		1
07/26/22 21:00	1.3			1.5			14		1	1.2			1.5			13.9		1
07/26/22 22:00	1.4			1.5			14.1		1	1.1			1.5			14		1
07/26/22 23:00	0.9			1.5			14.4		1	0.9			1.5			14.3		1
07/27/22 0:00	0.6			1.5			14.7		1	0.6			1.5			14.6		1
07/27/22 1:00	0.6			1.5			14.7		1	0.6			1.5			14.6		1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/27/22 2:00	0.6			1.5			14.7		1	0.6			1.6			14.6		1
07/27/22 3:00	0.6			1.5			14.7		1	0.6			1.5			14.6		1
07/27/22 4:00	0.6			1.5			14.7		1	0.6			1.5			14.6		1
07/27/22 5:00	0.6			1.5			14.6		1	0.7			1.4			14.5		1
07/27/22 6:00	0.6			1.6			14.6		1	0.7			1.6			14.5		1
07/27/22 7:00	0.6			1.6			14.7		1	0.6			1.6			14.5		1
07/27/22 8:00	0.5			1.7			14.7		1	0.6			1.7			14.6		1
07/27/22 9:00	0.5			1.6			14.8		1	0.6			1.6			14.7		1
07/27/22 10:00	0.5			1.6			14.8		1	0.6			1.6			14.7		1
07/27/22 11:00	0.5			1.6			14.8		1	0.6			1.6			14.7		1
07/27/22 12:00	0.5			1.6			14.8		1	0.6			1.6			14.7		1
07/27/22 13:00	1			1.6			14.2		1	1.2			1.5			14.1		1
07/27/22 14:00	0.9			1.7			13.8		1	0.9			1.7			13.7		1
07/27/22 15:00	0.7			1.6			13.7		1	0.8			1.7			13.6		1
07/27/22 16:00	0.7			1.7			13.7		1	0.8			1.7			13.6		1
07/27/22 17:00	0.2			1.7			12.8		1	0.4			1.7			12.7		1
07/27/22 18:00	0.9			1.6			13.8		1	0.9			1.6			13.7		1
07/27/22 19:00	1			1.7			13.9		1	1			1.7			13.8		1
07/27/22 20:00	1.1			1.7			13.9		1	1.1			1.7			13.9		1
07/27/22 21:00	1			1.6			14.2		1	1			1.6			14.1		1
07/27/22 22:00	0.6			1.6			14.6		1	0.7			1.5			14.5		1
07/27/22 23:00	0.6			1.7			14.6		1	0.7			1.6			14.5		1
07/28/22 0:00	0.7			1.5			14.5		1	0.7			1.3			14.4		1
07/28/22 1:00	0.6			1.6			14.6		1	0.7			1.6			14.5		1
07/28/22 2:00	0.6			1.6			14.7		1	0.6			1.7			14.6		1
07/28/22 3:00	1.2			1.7			14.4		1	1.3			1.7			14.3		1
07/28/22 4:00	1.7			1.7			14.2		1	1.9			1.7			14.1		1
07/28/22 5:00	1.3			1.6			14.3		1	1.5			1.6			14.2		1
07/28/22 6:00	0.7			1.6			14.4		1	0.8			1.6			14.3		1
07/28/22 7:00	0.7			1.6			14.5		1	0.7			1.2			14.4		1
07/28/22 8:00	0.5			1.6			14.7		1	0.6			1.5			14.6		1
07/28/22 9:00	0.5			1.6			14.7		1	0.6			1.5			14.6		1
07/28/22 10:00	0.7			1.6			14.5		1	0.7			1.5			14.4		1
07/28/22 11:00	0.9			1.7			13.8		1	1.1			1.7			13.7		1
07/28/22 12:00	0.9			1.7			13.8		1	1			1.7			13.7		1
07/28/22 13:00	0.8			1.7			13.7		1	0.9			1.7			13.6		1
07/28/22 14:00	0.4			1.7			13.1		1	0.6			1.7			13		1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/28/22 15:00	0.7			1.7			13.7		1	0.9			1.7			13.6		1
07/28/22 16:00	0.7			1.7			13.6		1	0.8			1.6			13.5		1
07/28/22 17:00	0.4			1.7			12.9		1	0.5			1.6			12.8		1
07/28/22 18:00	0.2			1.6			12.6		1	0.4			1.6			12.6		1
07/28/22 19:00	0.7			1.6			13.5		1	0.8			1.6			13.4		1
07/28/22 20:00	0.8			1.6			13.6		1	0.8			1.6			13.5		1
07/28/22 21:00	1.2			1.6			14		1	1.1			1.6			13.9		1
07/28/22 22:00	1			1.6			14.2		1	1			1.6			14.1		1
07/28/22 23:00	0.6			1.6			14.6		1	0.6			1.5			14.5		1
07/29/22 0:00	0.6			1.6			14.7		1	0.6			1.6			14.6		1
07/29/22 1:00	0.6			1.6			14.7		1	0.6			1.6			14.6		1
07/29/22 2:00	0.6			1.6			14.7		1	0.6			1.3			14.6		1
07/29/22 3:00	0.6			1.6			14.7		1	0.6			1.7			14.6		1
07/29/22 4:00	1.2			1.6			14.3		1	1.4			1.5			14.2		1
07/29/22 5:00	1.6			1.6			14.1		1	1.6			1.6			14		1
07/29/22 6:00	0.8			1.6			14.5		1	0.8			1.5			14.4		1
07/29/22 7:00	0.6			1.6			14.6		1	0.6			1.6			14.5		1
07/29/22 8:00	0.6			1.6			14.7		1	0.6			1.6			14.6		1
07/29/22 9:00	0.5			1.6			14.7		1	0.6			1.6			14.6		1
07/29/22 10:00	0.6			1.6			14.7		1	0.6			1.6			14.6		1
07/29/22 11:00	0.6			1.6			14.7		1	0.6			1.5			14.6		1
07/29/22 12:00	1.1			1.6			14		1	1.2			1.6			13.9		1
07/29/22 13:00	0.8			1.6			13.7		1	0.9			1.6			13.6		1
07/29/22 14:00	0.6			1.6			13.5		1	0.8			1.6			13.4		1
07/29/22 15:00	0.7			1.6			13.6		1	0.8			1.6			13.6		1
07/29/22 16:00	0.6			1.6			13.6		1	0.8			1.6			13.5		1
07/29/22 17:00	0.6			1.6			13.4		1	0.7			1.6			13.4		1
07/29/22 18:00	0.8			1.6			13.7		1	0.9			1.6			13.6		1
07/29/22 19:00	1			1.6			13.8		1	1			1.6			13.7		1
07/29/22 20:00	1.1			1.6			13.9		1	1.1			1.6			13.8		1
07/29/22 21:00	1			1.6			13.8		1	1			1.6			13.7		1
07/29/22 22:00	1.2			1.6			14		1	1.2			1.6			13.9		1
07/29/22 23:00	1.1			1.6			13.9		1	1.2			1.6			13.8		1
07/30/22 0:00	1.3			1.6			14.1		1	1.5			1.6			14		1
07/30/22 1:00	1.4			1.6			14.1		1	1.5			1.6			14		1
07/30/22 2:00	0.7			1.5			14.4		1	0.8			1.7			14.3		1
07/30/22 3:00	0.7			1.6			14.4		1	0.7			1.6			14.3		1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/30/22 4:00	1.5			1.6			14.2		1	1.8			1.6			14.1		1
07/30/22 5:00	1.5			1.6			14		1	1.6			1.6			13.9		1
07/30/22 6:00	1			1.7			14.4		1	1			1.7			14.3		1
07/30/22 7:00	0.6			1.7			14.5		1	0.7			1.7			14.4		1
07/30/22 8:00	0.5			1.7			14.7		1	0.6			1.7			14.6		1
07/30/22 9:00	0.5			1.7			14.8		1	0.6			1.7			14.7		1
07/30/22 10:00	0.5			1.6			14.8		1	0.5			1.6			14.7		1
07/30/22 11:00	0.8			1.6			14.6		1	1			1.5			14.5		1
07/30/22 12:00	1			1.7			13.8		1	1			1.8			13.7		1
07/30/22 13:00	0.8			1.7			13.7		1	0.9			1.7			13.6		1
07/30/22 14:00	0.5			1.7			13		1	0.6			1.7			12.9		1
07/30/22 15:00	0.1			1.7			12		1	0.3			1.7			12		1
07/30/22 16:00	0.2			1.7			12.3		1	0.4			1.7			12.3		1
07/30/22 17:00	0.4			1.7			13.2		1	0.6			1.7			13.1		1
07/30/22 18:00	0.9			1.6			13.8		1	0.9			1.6			13.7		1
07/30/22 19:00	1			1.6			13.8		1	1			1.6			13.8		1
07/30/22 20:00	1.2			1.6			13.9		1	1			1.6			13.9		1
07/30/22 21:00	0.9			1.6			13.7		1	1			1.6			13.6		1
07/30/22 22:00	1.2			1.6			14		1	1.1			1.6			13.9		1
07/30/22 23:00	1.2			1.6			14		1	1.1			1.6			13.9		1
07/31/22 0:00	1.3			1.6			14		1	1.1			1.6			13.9		1
07/31/22 1:00	1.3			1.6			14.1		1	1.1			1.6			14		1
07/31/22 2:00	1.3			1.6			14.1		1	1.1			1.6			14		1
07/31/22 3:00	1			1.6			14.4		1	0.9			1.6			14.3		1
07/31/22 4:00	0.5			1.5			14.7		1	0.6			1.5			14.6		1
07/31/22 5:00	0.6			1.5			14.6		1	0.6			1.5			14.5		1
07/31/22 6:00	0.7			1.6			14.5		1	0.7			1.5			14.4		1
07/31/22 7:00	0.6			1.6			14.7		1	0.6			1.6			14.6		1
07/31/22 8:00	0.5			1.6			14.8		1	0.5			1.6			14.7		1
07/31/22 9:00	0.5			1.6			14.7		1	0.6			1.6			14.6		1
07/31/22 10:00	0.8			1.5			14.5		1	0.9			1.5			14.4		1
07/31/22 11:00	1.1			1.6			14		1	1.3			1.6			13.9		1
07/31/22 12:00	1.1			1.6			14		1	1.3			1.6			13.9		1
07/31/22 13:00	1.1			1.6			13.9		1	1.2			1.6			13.8		1
07/31/22 14:00	0.7			1.6			13.5		1	0.9			1.6			13.4		1
07/31/22 15:00	0.7			1.6			13.6		1	0.8			1.6			13.5		1
07/31/22 16:00	0.7			1.6			13.4		1	0.7			1.6			13.3		1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/31/22 17:00	0.3			1.6			12.9		1	0.5			1.6			12.8		1
07/31/22 18:00	0.9			1.6			13.8		1	0.9			1.6			13.7		1
07/31/22 19:00	1.1			1.6			13.9		1	1			1.6			13.9		1
07/31/22 20:00	1.1			1.6			14		1	1.1			1.6			13.9		1
07/31/22 21:00	1			1.6			13.9		1	1			1.6			13.8		1
07/31/22 22:00	1			1.6			14.2		1	1			1.6			14.1		1
07/31/22 23:00	0.6			1.6			14.7		1	0.6			1.6			14.6		1
08/01/22 0:00	0.7			1.5			14.4		1	0.7			1.5			14.3		1
08/01/22 1:00	0.6			1.6			14.7		1	0.6			1.6			14.6		1
08/01/22 2:00	0.6			1.6			14.7		1	0.6			1.5			14.6		1
08/01/22 3:00	1			1.6			14.4		1	1.3			1.6			14.3		1
08/01/22 4:00	1.5			1.6			14.1		1	1.6			1.6			14		1
08/01/22 5:00	1			1.7			13.7		1	1.6			1.7			14		1
08/01/22 6:00	0.3			1			12.6		1	0.8			1.4			13.1		1
08/01/22 7:00	1.5			1.6			14.2		1	1.6			1.7			14.1		1
08/01/22 8:00	1.3			1.8			14.1		1	1.5			1.7			14		1
08/01/22 9:00	1.2			1.7			14.1		1	1.3			1.7			14		1
08/01/22 10:00	1.2			1.7			14.1		1	1.1			1.7			14		1
08/01/22 11:00	1.1			1.7			14		1	1.1			1.7			14		1
08/01/22 12:00	1.2			1.7			14		1	1.1			1.7			13.9		1
08/01/22 13:00	1.2			1.7			14		1	1			1.7			13.9		1
08/01/22 14:00	1.2			1.7			14		1	1.1			1.7			13.9		1
08/01/22 15:00	1.1			1.7			13.9		1	1.1			1.7			13.8		1
08/01/22 16:00	1.1			1.7			13.9		1	1.1			1.7			13.8		1
08/01/22 17:00	1.2			1.7			13.9		1	1.1			1.7			13.8		1
08/01/22 18:00	1.2			1.7			13.9		1	1.1			1.7			13.9		1
08/01/22 19:00	1.3			1.7			13.9		1	1.1			1.7			13.9		1
08/01/22 20:00	1.2			1.7			13.9		1	1.1			1.7			13.8		1
08/01/22 21:00	1.2			1.7			13.9		1	1.2			1.7			13.8		1
08/01/22 22:00	1.2			1.7			14.2		1	1.2			1.6			14.1		1
08/01/22 23:00	0.8			1.7			14.6		1	0.8			1.7			14.6		1
08/02/22 0:00	0.8			1.7			14.7		1	0.9			1.7			14.6		1
08/02/22 1:00	0.9			1.7			14.7		1	0.9			1.7			14.7		1
08/02/22 2:00	1			1.7			14.8		1	1			1.7			14.7		1
08/02/22 3:00	1			1.6			14.7		1	1			1.6			14.6		1
08/02/22 4:00	1.2			1.7			14.4		1	1.4			1.6			14.3		1
08/02/22 5:00	1.3			1.7			14		1	1.6			1.6			14		1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/02/22 6:00	1.1			1.6			14.4		1	1.3			1.6			14.3		1
08/02/22 7:00	0.7			1.6			14.8		1	0.7			1.6			14.7		1
08/02/22 8:00	0.6			1.6			14.8		1	0.6			1.6			14.7		1
08/02/22 9:00	0.5			1.6			14.8		1	0.6			1.6			14.8		1
08/02/22 10:00	0.5			1.6			14.8		1	0.6			1.6			14.8		1
08/02/22 11:00	0.8			1.5			14.4		1	0.9			1.5			14.3		1
08/02/22 12:00	0.8			1.6			13.6		1	0.9			1.6			13.6		1
08/02/22 13:00	0.7			1.6			13.6		1	0.8			1.6			13.5		1
08/02/22 14:00	0.7			1.6			13.7		1	0.9			1.6			13.6		1
08/02/22 15:00	0.7			1.6			13.6		1	0.9			1.6			13.6		1
08/02/22 16:00	0.2			1.6			12.7		1	0.4			1.6			12.7		1
08/02/22 17:00	0.1			1.6			12.2		1	0.3			1.6			12.1		1
08/02/22 18:00	0.6			1.6			13.4		1	0.7			1.6			13.3		1
08/02/22 19:00	0.9			1.6			13.8		1	0.9			1.6			13.8		1
08/02/22 20:00	0.9			1.6			13.8		1	0.9			1.6			13.7		1
08/02/22 21:00	1.2			1.6			14		1	1			1.6			13.9		1
08/02/22 22:00	1.2			1.6			14		1	1.1			1.6			13.9		1
08/02/22 23:00	1.3			1.6			14		1	1.1			1.6			14		1
08/03/22 0:00	0.8			1.6			14.6		1	0.8			1.6			14.5		1
08/03/22 1:00	0.6			1.6			14.7		1	0.6			1.6			14.6		1
08/03/22 2:00	0.6			1.7			14.7		1	0.6			1.6			14.6		1
08/03/22 3:00	0.6			1.6			14.7		1	0.6			1.6			14.6		1
08/03/22 4:00	0.9			1.5			14.4		1	1			1.5			14.3		1
08/03/22 5:00	1.5			1.6			14.1		1	1.6			1.6			14.1		1
08/03/22 6:00	0.8			1.6			14.5		1	0.7			1.5			14.5		1
08/03/22 7:00	0.5			1.6			14.8		1	0.6			1.6			14.7		1
08/03/22 8:00	0.6			1.6			14.8		1	0.7			0.7			14.7		1
08/03/22 9:00	0.5			1.6			14.9		1	0.5			1.1			14.8		1
08/03/22 10:00	0.5			1.6			14.9		1	0.5			1			14.8		1
08/03/22 11:00	0.6			1.6			14.7		1	0.6			1			14.6		1
08/03/22 12:00	0.6			1.6			14.7		1	0.6			1			14.7		1
08/03/22 13:00	0.9			1.6			13.9		1	0.9			1.1			13.6		1
08/03/22 14:00	0.6			1.6			13.5		1	0.8			1.5			13.4		1
08/03/22 15:00	0.7			1.6			13.6		1	0.8			1.6			13.5		1
08/03/22 16:00	0.7			1.6			13.6		1	0.8			1.6			13.5		1
08/03/22 17:00	0.2			1.6			11.9		1	0.4			1.6			11.9		1
08/03/22 18:00	0.2			1.6			11.9		1	0.4			1.6			11.9		1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/03/22 19:00	0.2			1.6			12		1	0.4			1.6			12		1
08/03/22 20:00	0.2			1.6			12.6		1	0.5			1.6			12.6		1
08/03/22 21:00	1			1.6			13.8		1	0.9			1.6			13.7		1
08/03/22 22:00	1.1			1.6			13.9		1	1			1.6			13.8		1
08/03/22 23:00	1.1			1.6			13.9		1	1			1.6			13.8		1
08/04/22 0:00	1.2			1.6			14		1	1.1			1.6			13.9		1
08/04/22 1:00	1.2			1.6			14		1	1.1			1.6			13.9		1
08/04/22 2:00	1.2			1.6			14.1		1	1.1			1.6			14		1
08/04/22 3:00	0.7			1.5			14.6		1	0.7			1.6			14.6		1
08/04/22 4:00	0.8			1.6			14.5		1	0.9			1.5			14.4		1
08/04/22 5:00	1.2			1.6			14		1	1.4			1.6			14		1
08/04/22 6:00	1.1			1.6			14.2		1	1.2			1.6			14.2		1
08/04/22 7:00	0.7			1.6			14.5		1	0.7			1.6			14.4		1
08/04/22 8:00	0.9			1.6			14.4		1	1			1.5			14.3		1
08/04/22 9:00	1.1			1.6			14		1	1.1			1.6			13.9		1
08/04/22 10:00	1.1			1.6			13.9		1	1			1.6			13.9		1
08/04/22 11:00	1			1.6			13.8		1	1			1.6			13.8		1
08/04/22 12:00	0.8			1.6			13.6		1	0.8			1.6			13.5		1
08/04/22 13:00	0.2			1.5			12.7		1	0.6			1.6			13		1
08/04/22 14:00	0.2			1.7			11.9		1	0.4			1.6			11.9		1
08/04/22 15:00	0.1			1.6			12		1	0.4			1.6			12		1
08/04/22 16:00	0.2			1.6			12.2		1	0.4			1.6			12.1		1
08/04/22 17:00	0.2			1.6			12.3		1	0.5			1.6			12.3		1
08/04/22 18:00	0.4			1.6			13		1	0.6			1.6			12.9		1
08/04/22 19:00	0.7			1.6			13.4		1	0.8			1.6			13.3		1
08/04/22 20:00	1.1			1.6			13.9		1	1			1.6			13.8		1
08/04/22 21:00	1.2			1.6			14		1	1			1.6			13.9		1
08/04/22 22:00	1.3			1.6			14.1		1	1			1.6			14		1
08/04/22 23:00	0.8			1.6			14.5		1	0.8			1.6			14.4		1
08/05/22 0:00	0.6			1.5			14.6		1	0.7			1.5			14.5		1
08/05/22 1:00	0.6			1.6			14.7		1	0.6			1.6			14.7		1
08/05/22 2:00	0.6			1.6			14.6		1	0.7			1.3			14.5		1
08/05/22 3:00	0.6			1.5			14.7		1	0.6			1.6			14.6		1
08/05/22 4:00	0.7			1.5			14.6		1	0.7			1.4			14.5		1
08/05/22 5:00	1.7			1.5			14.2		1	2.1			1.5			14.1		1
08/05/22 6:00	1.5			1.5			14.1		1	1.4			1.5			14		1
08/05/22 7:00	1.4			1.5			14.2		1	1.3			1.5			14.1		1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/05/22 8:00	1.3			1.5			14.2		1	1.3			1.5			14.1		1
08/05/22 9:00	1.2			1.5			14.1		1	1.2			1.5			14.1		1
08/05/22 10:00	1.1			1.5			14.1		1	1.1			1.5			14		1
08/05/22 11:00	1.1			1.5			14		1	1			1.5			13.9		1
08/05/22 12:00	1.1			1.5			14		1	1			1.5			13.9		1
08/05/22 13:00	1			1.5			14		1	1			1.5			13.9		1
08/05/22 14:00	1.1			1.5			13.9		1	1			1.5			13.8		1
08/05/22 15:00	1.1			1.5			13.9		1	1			1.5			13.8		1
08/05/22 16:00	1.1			1.5			13.9		1	1			1.5			13.8		1
08/05/22 17:00	1			1.5			13.9		1	1			1.5			13.8		1
08/05/22 18:00	1			1.5			13.9		1	1			1.5			13.8		1
08/05/22 19:00	1.1			1.5			13.9		1	1			1.5			13.8		1
08/05/22 20:00	1.2			1.5			14		1	1			1.5			13.9		1
08/05/22 21:00	1.2			1.5			14		1	1			1.5			14		1
08/05/22 22:00	1.1			1.5			14.3		1	1			1.5			14.2		1
08/05/22 23:00	0.6			1.5			14.7		1	0.7			1.5			14.6		1
08/06/22 0:00	0.6			1.5			14.7		1	0.6			1.5			14.6		1
08/06/22 1:00	0.6			1.5			14.7		1	0.6			1.5			14.7		1
08/06/22 2:00	0.5			1.5			14.8		1	0.5			1.5			14.7		1
08/06/22 3:00	0.5			1.5			14.8		1	0.5			1.5			14.7		1
08/06/22 4:00	0.5			1.5			14.8		1	0.5			1.5			14.7		1
08/06/22 5:00	0.5			1.5			14.7		1	0.6			1.5			14.7		1
08/06/22 6:00	0.5			1.5			14.8		1	0.5			1.5			14.7		1
08/06/22 7:00	0.5			1.5			14.8		1	0.5			1.5			14.7		1
08/06/22 8:00	0.5			1.5			14.8		1	0.5			1.5			14.7		1
08/06/22 9:00	0.5			1.5			14.8		1	0.5			1.5			14.7		1
08/06/22 10:00	0.5			1.5			14.9		1	0.5			1.5			14.8		1
08/06/22 11:00	0.5			1.5			14.9		1	0.5			1.5			14.8		1
08/06/22 12:00	0.5			1.5			14.9		1	0.5			1.5			14.8		1
08/06/22 13:00	0.5			1.5			14.9		1	0.5			1.5			14.8		1
08/06/22 14:00	0.5			1.5			14.9		1	0.5			1.5			14.8		1
08/06/22 15:00	0.5			1.5			14.9		1	0.5			1.5			14.8		1
08/06/22 16:00	0.5			1.5			14.9		1	0.5			1.4			14.8		1
08/06/22 17:00	0.6			1.5			14.8		1	0.6			1.5			14.7		1
08/06/22 18:00	0.7			1.7			14.7		1	0.7			1.6			14.4		1
08/06/22 19:00	0.9			1.7			14.4		1	1			1.6			14.3		1
08/06/22 20:00	1			1.7			14		1	1.3			1.7			13.9		1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/06/22 21:00	1			1.7			14.3		1	1.1			1.7			14.2		1
08/06/22 22:00	0.6			1.7			14.7		1	0.6			1.7			14.6		1
08/06/22 23:00	0.6			1.7			14.7		1	0.6			1.7			14.6		1
08/07/22 0:00	0.5			1.7			14.8		1	0.5			1.7			14.7		1
08/07/22 1:00	0.6			1.7			14.7		1	0.6			1.7			14.6		1
08/07/22 2:00	0.6			1.8			14.8		1	0.6			1.7			14.7		1
08/07/22 3:00	0.5			1.7			14.8		1	0.5			1.7			14.7		1
08/07/22 4:00	0.6			1.7			14.7		1	0.6			1.7			14.6		1
08/07/22 5:00	0.6			1.7			14.7		1	0.6			1.7			14.6		1
08/07/22 6:00	0.5			1.7			14.8		1	0.5			1.7			14.7		1
08/07/22 7:00	0.5			1.7			14.8		1	0.5			1.7			14.7		1
08/07/22 8:00	0.5			1.7			14.8		1	0.5			1.7			14.7		1
08/07/22 9:00	0.5			1.7			14.8		1	0.5			1.7			14.7		1
08/07/22 10:00	0.5			1.7			14.9		1	0.5			1.7			14.8		1
08/07/22 11:00	0.5			1.7			14.9		1	0.5			1.7			14.8		1
08/07/22 12:00	0.5			1.7			14.9		1	0.5			1.7			14.8		1
08/07/22 13:00	0.5			1.7			14.9		1	0.5			1.7			14.8		1
08/07/22 14:00	0.5			1.7			14.9		1	0.5			1.7			14.8		1
08/07/22 15:00	0.5			1.7			14.9		1	0.5			1.7			14.8		1
08/07/22 16:00	0.6			1.7			14.7		1	0.6			1.6			14.7		1
08/07/22 17:00	0.9			1.7			14.2		1	1			1.7			14.1		1
08/07/22 18:00	1.1			1.7			14		1	1			1.7			13.9		1
08/07/22 19:00	1.2			1.7			14		1	1			1.7			14		1
08/07/22 20:00	1.2			1.7			14.1		1	1.1			1.7			14		1
08/07/22 21:00	1.3			1.7			14.1		1	1.1			1.7			14		1
08/07/22 22:00	0.9			1.7			14.4		1	0.8			1.7			14.4		1
08/07/22 23:00	0.6			1.7			14.7		1	0.6			1.7			14.6		1
08/08/22 0:00	0.6			1.7			14.7		1	0.6			1.7			14.6		1
08/08/22 1:00	0.6			1.7			14.7		1	0.6			1.7			14.6		1
08/08/22 2:00	0.6			1.7			14.7		1	0.6			1.8			14.6		1
08/08/22 3:00	0.6			1.7			14.7		1	0.6			1.7			14.6		1
08/08/22 4:00	0.9			1.7			14.5		1	1.1			1.6			14.4		1
08/08/22 5:00	1.6			1.7			14.2		1	1.9			1.7			14.1		1
08/08/22 6:00	1			1.5			14.4		1	1.2			1.5			14.4		1
08/08/22 7:00	0.6			1.6			14.7		1	0.6			1.6			14.7		1
08/08/22 8:00	0.5			1.5			14.8		1	0.5			1.6			14.7		1
08/08/22 9:00	0.6			1.6			14.8		1	0.6			1.6			14.7		1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/08/22 10:00	0.6			1.5			14.8		1	0.6			1.5			14.7		1
08/08/22 11:00	0.9			1.6			14.4		1	0.9			1.5			14.3		1
08/08/22 12:00	1			1.6			13.9		1	1.1			1.6			13.8		1
08/08/22 13:00	0.7			1.5			14.6		1	0.7			1.5			14.5		1
08/08/22 14:00	0.7			1.6			14.6		1	0.7			1.5			14.5		1
08/08/22 15:00	1.1			1.6			13.9		1	1.2			1.6			13.9		1
08/08/22 16:00	1			1.6			13.9		1	1.1			1.6			13.8		1
08/08/22 17:00	0.7			1.6			13.4		1	0.7			1.6			13.4		1
08/08/22 18:00	0.5			1.6			13.2		1	0.5			1.6			13.1		1
08/08/22 19:00	0.4			1.6			12.9		1	0.5			1.6			12.8		1
08/08/22 20:00	0.5			1.6			13		1	0.6			1.6			12.9		1
08/08/22 21:00	1.1			1.6			13.9		1	1.1			1.6			13.8		1
08/08/22 22:00	1.2			1.6			14		1	1.1			1.6			13.9		1
08/08/22 23:00	1.4			1.6			14.1		1	1.2			1.6			14.1		1
08/09/22 0:00	1.5			1.6			14.1		1	1.2			1.6			14.1		1
08/09/22 1:00	1.5			1.6			14.2		1	1.2			1.6			14.1		1
08/09/22 2:00	1.5			1.6			14.2		1	1.2			1.6			14.1		1
08/09/22 3:00	1.5			1.6			14.1		1	1.2			1.6			14		1
08/09/22 4:00	1.6			1.6			14.2		1	1.2			1.6			14.1		1
08/09/22 5:00	1.5			1.6			14.2		1	1.3			1.6			14.1		1
08/09/22 6:00	1.4			1.6			14.2		1	1.3			1.6			14.1		1
08/09/22 7:00	1.4			1.6			14.2		1	1.3			1.6			14.1		1
08/09/22 8:00	1.3			1.6			14.1		1	1.3			1.6			14		1
08/09/22 9:00	1.1			1.6			14.1		1	1.2			1.6			14		1
08/09/22 10:00	1.1			1.6			14.1		1	1.2			1.6			14		1
08/09/22 11:00	1.1			1.6			14		1	1.2			1.6			13.9		1
08/09/22 12:00	1.1			1.6			14.1		1	1.1			1.6			14		1
08/09/22 13:00	0.6			1.6			14.7		1	0.6			1.5			14.6		1
08/09/22 14:00	0.8			1.6			14.5		1	0.9			1.5			14.4		1
08/09/22 15:00	1			1.6			14		1	1.2			1.6			13.9		1
08/09/22 16:00	1			1.6			14		1	1.2			1.6			13.9		1
08/09/22 17:00	1			1.7			14		1	1.2			1.6			13.9		1
08/09/22 18:00	0.6			1.7			13.2		1	0.6			1.7			13.1		1
08/09/22 19:00	0.8			1.7			13.6		1	0.9			1.7			13.6		1
08/09/22 20:00	0.5			1.7			13.1		1	0.6			1.7			13.1		1
08/09/22 21:00	0.8			1.7			13.5		1	0.9			1.7			13.5		1
08/09/22 22:00	1			1.7			13.8		1	1			1.7			13.7		1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/09/22 23:00	1.3			1.7			14.1		1	1.1			1.7			14.1		1
08/10/22 0:00	0.7			1.7			14.5		1	0.7			1.7			14.4		1
08/10/22 1:00	0.7			1.7			14.5		1	0.7			1.7			14.4		1
08/10/22 2:00	0.7			1.8			14.5		1	0.7			1.8			14.4		1
08/10/22 3:00	1.2			1.7			14.4		1	1.6			1.7			14.3		1
08/10/22 4:00	0.8			1.7			13.6		1	0.9			1.7			13.5		1
08/10/22 5:00	1.1			1.7			13.8		1	1.1			1.7			13.7		1
08/10/22 6:00	0.9			1.7			14.5		1	0.9			1.7			14.4		1
08/10/22 7:00	0.6			1.6			14.7		1	0.6			1.7			14.6		1
08/10/22 8:00	0.6			1.7			14.7		1	0.6			1.7			14.6		1
08/10/22 9:00	0.5			1.6			14.8		1	0.6			1.7			14.6		1
08/10/22 10:00	0.5			1.7			14.8		1	0.6			1.7			14.7		1
08/10/22 11:00	0.6			1.6			14.7		1	0.6			1.5			14.6		1
08/10/22 12:00	0.5			1.6			14.8		1	0.6			1.6			14.7		1
08/10/22 13:00	0.5			1.6			14.7		1	0.6			1.6			14.6		1
08/10/22 14:00	0.8			1.7			14		1	0.8			1.8			13.9		1
08/10/22 15:00	0.6			1.7			13.5		1	0.7			1.7			13.4		1
08/10/22 16:00	1			1.7			14.1		1	1			1.7			14		1
08/10/22 17:00	0.9			1.7			13.9		1	0.9			1.7			13.8		1
08/10/22 18:00	0.4			1.7			13		1	0.5			1.7			12.9		1
08/10/22 19:00	0.4			1.7			13.1		1	0.5			1.7			13		1
08/10/22 20:00	0.6			1.7			13.5		1	0.8			1.7			13.4		1
08/10/22 21:00	1			1.7			13.7		1	1			1.7			13.7		1
08/10/22 22:00	1			1.7			14.3		1	1			1.7			14.2		1
08/10/22 23:00	0.7			1.7			14.5		1	0.7			1.7			14.4		1
08/11/22 0:00	0.7			1.7			14.5		1	0.6			1.7			14.4		1
08/11/22 1:00	0.7			1.7			14.5		1	0.7			1.7			14.4		1
08/11/22 2:00	0.7			1.7			14.4		1	0.7			1.7			14.3		1
08/11/22 3:00	0.7			1.8			14.4		1	0.7			1.8			14.4		1
08/11/22 4:00	0.7			1.7			14.5		1	0.7			1.7			14.4		1
08/11/22 5:00	0.7			1.6			14.5		1	0.7			1.6			14.4		1
08/11/22 6:00	0.7			1.6			14.5		1	0.7			1.6			14.4		1
08/11/22 7:00	0.6			1.5			14.5		1	0.7			1.4			14.4		1
08/11/22 8:00	0.5			1.6			14.7		1	0.6			1.6			14.6		1
08/11/22 9:00	0.5			1.6			14.8		1	0.6			1.6			14.6		1
08/11/22 10:00	0.5			1.6			14.8		1	0.6			1.6			14.7		1
08/11/22 11:00	0.6			1.6			14.6		1	0.6			1.5			14.5		1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/11/22 12:00	1			1.6			14.4		1	1.1			1.5			14.4		1
08/11/22 13:00	0.5			1.6			13.2		1	0.8			1.6			13.1		1
08/11/22 14:00	0.7			1.6			13.6		1	0.9			1.6			13.5		1
08/11/22 15:00	0.5			1.6			13.2		1	0.7			1.6			13.1		1
08/11/22 16:00	0.5			1.6			13.2		1	0.7			1.6			13.1		1
08/11/22 17:00	0.4			1.6			13.1		1	0.7			1.7			13		1
08/11/22 18:00	0.3			1.7			12.8		1	0.6			1.7			12.8		1
08/11/22 19:00	0.4			1.7			13.1		1	0.7			1.7			13		1
08/11/22 20:00	0.3			1.7			12.7		1	0.5			1.7			12.6		1
08/11/22 21:00	1.2			1.7			14.1		1	1.1			1.7			14		1
08/11/22 22:00	0.7			1.7			14.5		1	0.7			1.7			14.4		1
08/11/22 23:00	0.7			1.7			14.5		1	0.7			1.7			14.4		1
08/12/22 0:00	0.6			1.7			14.5		1	0.7			1.7			14.4		1
08/12/22 1:00	0.7			1.7			14.5		1	0.7			1.7			14.4		1
08/12/22 2:00	0.7			1.7			14.4		1	0.7			1.7			14.3		1
08/12/22 3:00	0.7			1.7			14.5		1	0.7			1.7			14.4		1
08/12/22 4:00	0.7			1.7			14.5		1	0.7			1.7			14.4		1
08/12/22 5:00	0.7			1.6			14.5		1	0.7			1.6			14.4		1
08/12/22 6:00	0.7			1.6			14.5		1	0.7			1.6			14.4		1
08/12/22 7:00	0.6			1.6			14.6		1	0.6			1.5			14.5		1
08/12/22 8:00	0.5			1.6			14.8		1	0.5			1.6			14.7		1
08/12/22 9:00	0.5			1.7			14.8		1	0.6			1.7			14.7		1
08/12/22 10:00	0.5			1.6			14.8		1	0.6			1.6			14.7		1
08/12/22 11:00	0.5			1.6			14.8		1	0.6			1.6			14.7		1
08/12/22 12:00	0.7			1.5			14.6		1	0.9			1.5			14.5		1
08/12/22 13:00	1			1.5			14		1	1			1.5			13.8		1
08/12/22 14:00	0.9			1.5			13.9		1	1			1.5			13.8		1
08/12/22 15:00	0.9			1.5			13.9		1	0.9			1.5			13.8		1
08/12/22 16:00	0.9			1.5			13.9		1	1			1.5			13.9		1
08/12/22 17:00	0.4			1.5			13.1		1	0.6			1.5			13.1		1
08/12/22 18:00	0.2			1.7			12.7		1	0.5			1.7			12.7		1
08/12/22 19:00	0.5			1.7			13.3		1	0.7			1.6			13.2		1
08/12/22 20:00	0.7			1.7			13.6		1	0.9			1.7			13.5		1
08/12/22 21:00	1.1			1.6			14		1	1.1			1.6			14		1
08/12/22 22:00	0.7			1.6			14.4		1	0.7			1.6			14.3		1
08/12/22 23:00	0.7			1.6			14.5		1	0.7			1.6			14.4		1
08/13/22 0:00	0.7			1.7			14.5		1	0.7			1.7			14.4		1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/13/22 1:00	0.7			1.7			14.5		1	0.7			1.7			14.4		1
08/13/22 2:00	0.7			1.8			14.4		1	0.7			1.8			14.4		1
08/13/22 3:00	0.8			1.6			14.4		1	0.7			1.6			14.3		1
08/13/22 4:00	0.7			1.6			14.5		1	0.7			1.6			14.4		1
08/13/22 5:00	0.7			1.6			14.5		1	0.7			1.6			14.4		1
08/13/22 6:00	0.7			1.6			14.5		1	0.7			1.6			14.4		1
08/13/22 7:00	0.5			1.6			14.7		1	0.6			1.6			14.7		1
08/13/22 8:00	0.5			1.5			14.8		1	0.5			1.6			14.7		1
08/13/22 9:00	0.6			1.6			14.8		1	0.6			1.6			14.7		1
08/13/22 10:00	0.5			1.5			14.8		1	0.6			1.4			14.7		1
08/13/22 11:00	0.5			1.6			14.8		1	0.6			1.6			14.7		1
08/13/22 12:00	0.6			1.5			14.7		1	0.7			1.4			14.5		1
08/13/22 13:00	0.9			1.6			14.4		1	1			1.5			14.3		1
08/13/22 14:00	1.1			1.6			14		1	1			1.6			13.9		1
08/13/22 15:00	1			1.6			14		1	1			1.6			13.9		1
08/13/22 16:00	1			1.6			13.9		1	1			1.6			13.9		1
08/13/22 17:00	0.6			1.6			13.3		1	0.7			1.6			13.3		1
08/13/22 18:00	0.6			1.6			13.6		1	0.8			1.6			13.5		1
08/13/22 19:00	1.1			1.6			14		1	1			1.6			13.9		1
08/13/22 20:00	0.9			1.6			14.2		1	0.9			1.6			14.1		1
08/13/22 21:00	0.6			1.6			14.7		1	0.7			1.6			14.6		1
08/13/22 22:00	0.7			1.5			14.5		1	0.7			1.5			14.4		1
08/13/22 23:00	0.7			1.6			14.5		1	0.7			1.5			14.4		1
08/14/22 0:00	0.7			1.6			14.4		1	0.8			1.5			14.3		1
08/14/22 1:00	0.7			1.5			14.4		1	0.8			1.5			14.3		1
08/14/22 2:00	0.8			1.7			14.4		1	0.8			1.6			14.3		1
08/14/22 3:00	0.8			1.7			14.4		1	0.8			1.5			14.3		1
08/14/22 4:00	0.8			1.5			14.3		1	0.8			1.5			14.2		1
08/14/22 5:00	0.7			1.6			14.5		1	0.7			1.5			14.4		1
08/14/22 6:00	1.4			1.6			14.3		1	1.8			1.5			14.2		1
08/14/22 7:00	1.3			1.6			14.3		1	1.4			1.6			14.2		1
08/14/22 8:00	0.6			1.6			14.7		1	0.7			1.6			14.6		1
08/14/22 9:00	0.6			1.7			14.8		1	0.6			1.7			14.7		1
08/14/22 10:00	0.8			1.6			14.5		1	0.9			1.6			14.4		1
08/14/22 11:00	1			1.7			13.9		1	1.1			1.7			13.8		1
08/14/22 12:00	0.6			1.7			13.4		1	0.8			1.7			13.3		1
08/14/22 13:00	0.9			1.6			13.8		1	1			1.6			13.8		1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/14/22 14:00	0.7			1.5			14.7		1	0.7			1.6			14.6		1
08/14/22 15:00	0.6			1.6			14.7		1	0.7			1.5			14.6		1
08/14/22 16:00	0.6			1.6			14.6		1	0.7			1.7			14.5		1
08/14/22 17:00	0.8			1.7			14.5		1	0.9			1.7			14.4		1
08/14/22 18:00	1			1.7			13.9		1	1			1.7			13.8		1
08/14/22 19:00	1			1.7			13.9		1	1			1.7			13.8		1
08/14/22 20:00	1			1.7			14.2		1	1			1.6			14.1		1
08/14/22 21:00	0.6			1.6			14.7		1	0.7			1.6			14.6		1
08/14/22 22:00	0.7			1.6			14.8		1	0.7			1.5			14.7		1
08/14/22 23:00	0.7			1.6			14.8		1	0.7			1.6			14.7		1
08/15/22 0:00	0.6			1.7			14.7		1	0.7			1.7			14.7		1
08/15/22 1:00	0.6			1.7			14.8		1	0.6			1.7			14.7		1
08/15/22 2:00	0.6			1.7			14.8		1	0.6			1.7			14.7		1
08/15/22 3:00	0.7			1.7			14.6		1	0.7			1.6			14.5		1
08/15/22 4:00	0.7			1.6			14.6		1	0.8			1.5			14.4		1
08/15/22 5:00	0.8			1.6			14.4		1	0.8			1.6			14.3		1
08/15/22 6:00	0.7			1.6			14.6		1	0.7			1.6			14.5		1
08/15/22 7:00	0.5			1.6			14.8		1	0.6			1.6			14.7		1
08/15/22 8:00	0.5			1.7			14.9		1	0.6			1.7			14.8		1
08/15/22 9:00	0.5			1.6			14.9		1	0.6			1.6			14.8		1
08/15/22 10:00	0.6			1.6			14.7		1	0.7			1.5			14.6		1
08/15/22 11:00	0.6			1.7			14.9		1	0.7			1.7			14.8		1
08/15/22 12:00	0.6			1.6			14.8		1	0.7			1.5			14.7		1
08/15/22 13:00	0.8			1.7			14		1	1			1.7			13.9		1
08/15/22 14:00	0.3			1.7			12.7		1	0.5			1.7			12.7		1
08/15/22 15:00	0.1			1.7			12.6		1	0.5			1.6			12.6		1
08/15/22 16:00	0.1			1.7			12.5		1	0.4			1.7			12.4		1
08/15/22 17:00	0.2			1.7			12.5		1	0.5			1.7			12.4		1
08/15/22 18:00	0.1			1.6			12.5		1	0.4			1.6			12.5		1
08/15/22 19:00	0.4			1.7			13		1	0.6			1.7			13		1
08/15/22 20:00	0.8			1.6			13.9		1	0.9			1.6			13.8		1
08/15/22 21:00	0.7			1.6			14.5		1	0.8			1.6			14.4		1
08/15/22 22:00	0.7			1.6			14.6		1	0.8			1.6			14.5		1
08/15/22 23:00	0.8			1.6			14.4		1	0.8			1.5			14.3		1
08/16/22 0:00	0.8			1.7			14.4		1	0.8			1.7			14.3		1
08/16/22 1:00	0.8			1.6			14.4		1	0.8			1.6			14.3		1
08/16/22 2:00	0.8			1.5			14.4		1	0.8			1.5			14.3		1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/16/22 3:00	0.8			1.6			14.4		1	0.9			1.6			14.3		1
08/16/22 4:00	0.7			1.5			14.4		1	0.8			1.4			14.4		1
08/16/22 5:00	0.9			1.6			14.5		1	1			1.7			14.4		1
08/16/22 6:00	0.8			1.6			14.5		1	0.9			1.6			14.5		1
08/16/22 7:00	0.6			1.6			14.8		1	0.7			1.6			14.8		1
08/16/22 8:00	0.6			1.6			14.9		1	0.7			1.6			14.8		1
08/16/22 9:00	0.6			1.6			14.7		1	0.8			1.5			14.6		1
08/16/22 10:00	0.7			1.6			14.5		1	0.8			1.5			14.4		1
08/16/22 11:00	0.7			1.6			14.6		1	0.7			1.6			14.5		1
08/16/22 12:00	0.8			1.6			14.3		1	0.9			1.5			14.2		1
08/16/22 13:00	0.2			1.6			12.3		1	0.4			1.6			12.2		1
08/16/22 14:00	0.2			1.6			11.8		1	0.3			1.6			11.8		1
08/16/22 15:00	0.2			1.6			11.8		1	0.4			1.6			11.8		1
08/16/22 16:00	0.1			1.6			11.8		1	0.4			1.6			11.8		1
08/16/22 17:00	0.1			1.6			11.8		1	0.4			1.6			11.8		1
08/16/22 18:00	0.1			1.6			11.8		1	0.4			1.6			11.8		1
08/16/22 19:00	0.1			1.6			12.2		1	0.4			1.6			12.2		1
08/16/22 20:00	0.2			1.6			12.4		1	0.4			1.6			12.4		1
08/16/22 21:00	0.5			1.6			13.1		1	0.7			1.6			13		1
08/16/22 22:00	1			1.6			13.7		1	1			1.6			13.6		1
08/16/22 23:00	0.9			1.6			14.5		1	0.9			1.6			14.3		1
08/17/22 0:00	0.7			1.6			14.5		1	0.8			1.6			14.5		1
08/17/22 1:00	0.7			1.6			14.5		1	0.8			1.6			14.4		1
08/17/22 2:00	0.7			1.7			14.5		1	0.8			1.6			14.4		1
08/17/22 3:00	0.8			1.6			14.5		1	0.8			1.6			14.4		1
08/17/22 4:00	0.7			1.6			14.5		1	0.8			1.6			14.4		1
08/17/22 5:00	0.7			1.6			14.5		1	0.8			1.6			14.5		1
08/17/22 6:00	0.7			1.6			14.5		1	0.8			1.6			14.5		1
08/17/22 7:00	0.6			1.3			14.8		1	0.9			1.6			14.3		1
08/17/22 8:00	0	X		0	X		0	X	1	1.3			1.6			14		1
08/17/22 9:00	0	X		0	X		0	X	1	1.1			1.6			14.3		1
08/17/22 10:00	0	X		0	X		0	X	1	0.7			1.6			14.5		1
08/17/22 11:00	0	X		0	X		0	X	1	0.7			1.6			14.5		1
08/17/22 12:00	0	X		0	X		0	X	1	0.7			1.6			14.5		1
08/17/22 13:00	0	X		0	X		0	X	1	0.7			1.6			14.5		1
08/17/22 14:00	0	X		0	X		0	X	1	0.7			1.6			14.5		1
08/17/22 15:00	0	X		0	X		0	X	1	0.7			1.6			14.5		1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/17/22 16:00	0	X		0	X		0	X	1	0.7			1.6			14.5		1
08/17/22 17:00	0	X		0	X		0	X	1	0.7			1.6			14.5		1
08/17/22 18:00	0	X		0	X		0	X	1	0.7			1.6			14.5		1
08/17/22 19:00	0	X		0	X		0	X	1	0.8			1.6			14.5		1
08/17/22 20:00	0	X		0	X		0	X	1	0.7			1.6			14.5		1
08/17/22 21:00	0	X		0	X		0	X	1	0.8			1.6			14.5		1
08/17/22 22:00	0	X		0	X		0	X	1	0.7			1.6			14.5		1
08/17/22 23:00	0	X		0	X		0	X	1	0.7			1.6			14.5		1
08/18/22 0:00	0	X		0	X		0	X	1	0.7			1.6			14.6		1
08/18/22 1:00	0	X		0	X		0	X	1	0.7			1.6			14.6		1
08/18/22 2:00	0	X		0	X		0	X	1	0.7			1.6			14.6		1
08/18/22 3:00	0	X		0	X		0	X	1	0.7			1.6			14.6		1
08/18/22 4:00	0	X		0	X		0	X	1	0.7			1.6			14.6		1
08/18/22 5:00	0	X		0	X		0	X	1	0.8			1.6			14.5		1
08/18/22 6:00	0	X		0	X		0	X	1	0.7			1.6			14.6		1
08/18/22 7:00	0	X		0	X		0	X	1	0.7			1.6			14.7		1
08/18/22 8:00	0	X		0	X		0	X	1	0.7			1.6			14.7		1
08/18/22 9:00	0	X		0	X		0	X	1	0.7			1.6			14.7		1
08/18/22 10:00	0	X		0	X		0	X	1	0.7			1.6			14.7		1
08/18/22 11:00	0	X		0	X		0	X	1	0.7			1.6			14.8		1
08/18/22 12:00	0	X		0	X		0	X	1	0.7			1.5			14.7		1
08/18/22 13:00	0	X		0	X		0	X	1	0.9			1.4			14.4		1
08/18/22 14:00	0	X		0	X		0	X	1	1.1			1.6			13.8		1
08/18/22 15:00	0	X		0	X		0	X	1	0.7			1.6			13.1		1
08/18/22 16:00	0	X		0	X		0	X	1	0.7			1.6			13.3		1
08/18/22 17:00	0	X		0	X		0	X	1	0.6			1.6			12.9		1
08/18/22 18:00	0	X		0	X		0	X	1	1			1.7			13.8		1
08/18/22 19:00	0	X		0	X		0	X	1	1.1			1.7			14		1
08/18/22 20:00	0	X		0	X		0	X	1	1.3			1.7			14.1		1
08/18/22 21:00	0	X		0	X		0	X	1	1.4			1.7			14.1		1
08/18/22 22:00	0	X		0	X		0	X	1	1.5			1.7			14.1		1
08/18/22 23:00	0	X		0	X		0	X	1	1.5			1.7			14.2		1
08/19/22 0:00	0	X		0	X		0	X	1	1.6			1.7			14.2		1
08/19/22 1:00	0	X		0	X		0	X	1	1.5			1.7			14.2		1
08/19/22 2:00	0	X		0	X		0	X	1	1.5			1.7			14.2		1
08/19/22 3:00	0	X		0	X		0	X	1	1.6			1.7			14.2		1
08/19/22 4:00	0	X		0	X		0	X	1	1.6			1.7			14.2		1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/19/22 5:00	0	X		0	X		0	X	1	1.6			1.6			14.2		1
08/19/22 6:00	0	X		0	X		0	X	1	1.6			1.6			14.2		1
08/19/22 7:00	0	X		0	X		0	X	1	1.5			1.6			14.2		1
08/19/22 8:00	0	X		0	X		0	X	1	0.8			1.6			14.5		1
08/19/22 9:00	0	X		0	X		0	X	1	0.7			1.6			14.7		1
08/19/22 10:00	0	X		0	X		0	X	1	0.7			1.4			14.6		1
08/19/22 11:00	0			0			15.4		1	0.8			1.6			14.3		1
08/19/22 12:00	0.7			1.6			14.6		1	0.7			1.6			14.6		1
08/19/22 13:00	0.5			1.6			14.9		1	0.6			1.6			14.9		1
08/19/22 14:00	0.6			1.5			14.8		1	0.7			1.5			14.7		1
08/19/22 15:00	0.6			1.6			14.7		1	0.7			1.5			14.6		1
08/19/22 16:00	0.6			1.6			14.8		1	0.7			1.5			14.7		1
08/19/22 17:00	0.7			1.6			14.5		1	0.7			1.5			14.5		1
08/19/22 18:00	0.7			1.7			14.5		1	0.7			1.7			14.4		1
08/19/22 19:00	0.7			1.6			14.5		1	0.7			1.6			14.4		1
08/19/22 20:00	0.7			1.6			14.6		1	0.7			1.6			14.5		1
08/19/22 21:00	0.7			1.6			14.6		1	0			0			16.2		1
08/19/22 22:00	0.7			1.7			14.7		1	0	X		0	X		0	X	1
08/19/22 23:00	0.7			1.7			14.6		1	0	X		0	X		0	X	1
08/20/22 0:00	0.7			1.7			14.6		1	0	X		0	X		0	X	1
08/20/22 1:00	0.7			1.7			14.6		1	0	X		0	X		0	X	1
08/20/22 2:00	0.7			1.7			14.6		1	0	X		0	X		0	X	1
08/20/22 3:00	0.7			1.7			14.7		1	0	X		0	X		0	X	1
08/20/22 4:00	0.6			1.7			14.7		1	0	X		0	X		0	X	1
08/20/22 5:00	0.6			1.7			14.7		1	0	X		0	X		0	X	1
08/20/22 6:00	0.6			1.7			14.7		1	0	X		0	X		0	X	1
08/20/22 7:00	0.6			1.7			14.7		1	0	X		0	X		0	X	1
08/20/22 8:00	0.6			1.7			14.8		1	0	X		0	X		0	X	1
08/20/22 9:00	0.6			1.7			14.8		1	0	X		0	X		0	X	1
08/20/22 10:00	0.6			1.6			14.8		1	0	X		0	X		0	X	1
08/20/22 11:00	0.6			1.7			14.8		1	0	X		0	X		0	X	1
08/20/22 12:00	0.5			1.7			14.9		1	0	X		0	X		0	X	1
08/20/22 13:00	0.5			1.6			14.9		1	0	X		0	X		0	X	1
08/20/22 14:00	0.6			1.6			14.8		1	0	X		0	X		0	X	1
08/20/22 15:00	0.7			1.7			14.6		1	0.7			0.8			15.5		1
08/20/22 16:00	0	X		0	X		0	X	1	0.7			1.5			14.5		1
08/20/22 17:00	0	X		0	X		0	X	1	1			1.7			14.2		1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/20/22 18:00	0	X		0	X		0	X	1	0.9			1.7			13.6		1
08/20/22 19:00	0	X		0	X		0	X	1	1			1.7			13.9		1
08/20/22 20:00	0	X		0	X		0	X	1	1.1			1.7			13.9		1
08/20/22 21:00	0	X		0	X		0	X	1	1.1			1.7			13.8		1
08/20/22 22:00	0	X		0	X		0	X	1	1.1			1.7			13.8		1
08/20/22 23:00	0	X		0	X		0	X	1	1.1			1.7			13.9		1
08/21/22 0:00	0	X		0	X		0	X	1	1.2			1.7			13.9		1
08/21/22 1:00	0	X		0	X		0	X	1	1.1			1.7			14		1
08/21/22 2:00	0	X		0	X		0	X	1	1.1			1.7			14		1
08/21/22 3:00	0	X		0	X		0	X	1	0.9			1.5			14.4		1
08/21/22 4:00	0	X		0	X		0	X	1	0.7			1.7			14.6		1
08/21/22 5:00	0	X		0	X		0	X	1	0.8			1.6			14.6		1
08/21/22 6:00	0	X		0	X		0	X	1	0.7			1.7			14.5		1
08/21/22 7:00	0	X		0	X		0	X	1	0.7			1.5			14.6		1
08/21/22 8:00	0			0			15.7		1	0.7			1.7			14.5		1
08/21/22 9:00	0.5			1.6			14.8		1	0.6			1.7			14.8		1
08/21/22 10:00	0.6			1.7			14.6		1	0.7			1.6			14.5		1
08/21/22 11:00	0.6			1.6			14.6		1	0.7			1.6			14.5		1
08/21/22 12:00	0.7			1.7			14.6		1	0.7			1.7			14.5		1
08/21/22 13:00	0.7			1.7			14.6		1	0.7			1.7			14.5		1
08/21/22 14:00	0.7			1.7			14.6		1	0.7			1.7			14.4		1
08/21/22 15:00	0.7			1.7			14.6		1	0.6			1.4			14.6		1
08/21/22 16:00	0.8			1.7			14.6		1	0.8			1.6			14.7		1
08/21/22 17:00	0.8			1.6			13.4		1	0.9			1.7			13.4		1
08/21/22 18:00	0.6			1.6			13.4		1	0.7			1.6			13.4		1
08/21/22 19:00	1			1.6			13.9		1	1			1.6			13.8		1
08/21/22 20:00	0.7			1.6			14.5		1	0.7			1.6			14.4		1
08/21/22 21:00	0.6			1.6			14.5		1	0.7			1.5			14.4		1
08/21/22 22:00	0.6			1.6			14.5		1	0.7			1.3			14.4		1
08/21/22 23:00	0.6			1.6			14.5		1	0.7			1.6			14.4		1
08/22/22 0:00	0.6			1.6			14.5		1	0.7			1.6			14.4		1
08/22/22 1:00	0.7			1.6			14.6		1	0.6			1.5			14.6		1
08/22/22 2:00	0.7			1.6			14.6		1	0.5			1.6			14.7		1
08/22/22 3:00	0.9			1.6			14.6		1	0.6			1.5			14.5		1
08/22/22 4:00	0.7			1.6			14.6		1	0.7			1.4			14.4		1
08/22/22 5:00	0.7			1.6			14.6		1	0.7			1.6			14.4		1
08/22/22 6:00	0	X		0	X		0	X	1	0.7			1.7			14.4		1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/22/22 7:00	0	X		0	X		0	X	1	0.7			1.7			14.4		1
08/22/22 8:00	0	X		0	X		0	X	1	0.7			1.6			14.4		1
08/22/22 9:00	0	X		0	X		0	X	1	0.6			1.6			14.6		1
08/22/22 10:00	0	X		0	X		0	X	1	0.6			1.6			14.7		1
08/22/22 11:00	0	X		0	X		0	X	1	0.6			1.6			14.7		1
08/22/22 12:00	0	X		0	X		0	X	1	0.6			1.7			14.8		1
08/22/22 13:00	0	X		0	X		0	X	1	0.6			1.7			14.8		1
08/22/22 14:00	0	X		0	X		0	X	1	0.6			1.7			14.8		1
08/22/22 15:00	0	X		0	X		0	X	1	0.8			1.6			14.4		1
08/22/22 16:00	0	X		0	X		0	X	1	0.9			1.7			13.7		1
08/22/22 17:00	0	X		0	X		0	X	1	0.5			1.7			12.8		1
08/22/22 18:00	0	X		0	X		0	X	1	0.3			1.6			12		1
08/22/22 19:00	0	X		0	X		0	X	1	0.6			1.6			13.1		1
08/22/22 20:00	0	X		0	X		0	X	1	1			1.6			13.8		1
08/22/22 21:00	0	X		0	X		0	X	1	1.1			1.6			14		1
08/22/22 22:00	0	X		0	X		0	X	1	1.1			1.6			14		1
08/22/22 23:00	0	X		0	X		0	X	1	1.1			1.6			14		1
08/23/22 0:00	0	X		0	X		0	X	1	1.1			1.6			14		1
08/23/22 1:00	0	X		0	X		0	X	1	1.1			1.6			14		1
08/23/22 2:00	0	X		0	X		0	X	1	1.2			1.6			14.1		1
08/23/22 3:00	0	X		0	X		0	X	1	1			1.6			13.8		1
08/23/22 4:00	0	X		0	X		0	X	1	1.2			1.6			14		1
08/23/22 5:00	0	X		0	X		0	X	1	0.8			1.6			13.3		1
08/23/22 6:00	0	X		0	X		0	X	1	1.4			1.6			14.1		1
08/23/22 7:00	0	X		0	X		0	X	1	1.3			1.6			14.1		1
08/23/22 8:00	0	X		0	X		0	X	1	1.2			1.6			14		1
08/23/22 9:00	0	X		0	X		0	X	1	1			1.6			14		1
08/23/22 10:00	0	X		0	X		0	X	1	1			1.6			14		1
08/23/22 11:00	0	X		0	X		0	X	1	0.9			1.6			13.7		1
08/23/22 12:00	0	X		0	X		0	X	1	1			1.6			13.6		1
08/23/22 13:00	0	X		0	X		0	X	1	1			1.6			13.7		1
08/23/22 14:00	0	X		0	X		0	X	1	0.8			1.6			13.3		1
08/23/22 15:00	0	X		0	X		0	X	1	0.9			1.6			13.7		1
08/23/22 16:00	0	X		0	X		0	X	1	0.8			1.6			13.3		1
08/23/22 17:00	0	X		0	X		0	X	1	0.4			1.6			11.8		1
08/23/22 18:00	0	X		0	X		0	X	1	0.5			1.6			12.7		1
08/23/22 19:00	0	X		0	X		0	X	1	0.7			1.6			13.1		1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/23/22 20:00	0	X		0	X		0	X	1	0.5			1.6			12.7		1
08/23/22 21:00	0	X		0	X		0	X	1	0.9			1.6			13.5		1
08/23/22 22:00	0	X		0	X		0	X	1	1.1			1.6			14		1
08/23/22 23:00	0	X		0	X		0	X	1	1.1			1.6			14		1
08/24/22 0:00	0	X		0	X		0	X	1	1.1			1.6			13.9		1
08/24/22 1:00	0	X		0	X		0	X	1	1.1			1.6			14		1
08/24/22 2:00	0	X		0	X		0	X	1	1.1			1.6			14		1
08/24/22 3:00	0	X		0	X		0	X	1	1.2			1.6			14.1		1
08/24/22 4:00	0	X		0	X		0	X	1	1.2			1.6			14.1		1
08/24/22 5:00	0	X		0	X		0	X	1	1.2			1.6			14.1		1
08/24/22 6:00	0	X		0	X		0	X	1	1.2			1.6			14.1		1
08/24/22 7:00	0	X		0	X		0	X	1	1.1			1.6			14.1		1
08/24/22 8:00	0	X		0	X		0	X	1	1			1.6			14		1
08/24/22 9:00	0	X		0	X		0	X	1	1			1.6			14		1
08/24/22 10:00	0	X		0	X		0	X	1	1			1.6			14		1
08/24/22 11:00	0	X		0	X		0	X	1	1.1			1.6			13.9		1
08/24/22 12:00	0	X		0	X		0	X	1	1			1.6			13.8		1
08/24/22 13:00	0	X		0	X		0	X	1	1			1.6			13.8		1
08/24/22 14:00	0	X		0	X		0	X	1	0.4			1.6			12.2		1
08/24/22 15:00	0	X		0	X		0	X	1	0.8			1.6			13.4		1
08/24/22 16:00	0	X		0	X		0	X	1	0.8			1.6			13.1		1
08/24/22 17:00	0	X		0	X		0	X	1	0.5			1.6			12.3		1
08/24/22 18:00	0	X		0	X		0	X	1	0.9			1.6			13.7		1
08/24/22 19:00	0	X		0	X		0	X	1	1			1.6			14		1
08/24/22 20:00	0	X		0	X		0	X	1	1.1			1.6			14		1
08/24/22 21:00	0	X		0	X		0	X	1	1.1			1.6			14		1
08/24/22 22:00	0	X		0	X		0	X	1	1.1			1.6			14.1		1
08/24/22 23:00	0	X		0	X		0	X	1	1.2			1.6			14.1		1
08/25/22 0:00	0	X		0	X		0	X	1	1.2			1.6			14.1		1
08/25/22 1:00	0	X		0	X		0	X	1	1.2			1.6			14.1		1
08/25/22 2:00	0	X		0	X		0	X	1	1.3			1.6			14.1		1
08/25/22 3:00	0	X		0	X		0	X	1	1.4			1.6			14.1		1
08/25/22 4:00	0	X		0	X		0	X	1	1.4			1.6			14.2		1
08/25/22 5:00	0	X		0	X		0	X	1	1.4			1.6			14.2		1
08/25/22 6:00	0	X		0	X		0	X	1	1.4			1.7			14.2		1
08/25/22 7:00	0	X		0	X		0	X	1	1.4			1.7			14.2		1
08/25/22 8:00	0	X		0	X		0	X	1	1.3			1.7			14.1		1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/25/22 9:00	0	X		0	X		0	X	1	1.1			1.6			14		1
08/25/22 10:00	0	X		0	X		0	X	1	1.1			1.6			14		1
08/25/22 11:00	0	X		0	X		0	X	1	1.2			1.7			13.9		1
08/25/22 12:00	0	X		0	X		0	X	1	1.1			1.7			13.9		1
08/25/22 13:00	0	X		0	X		0	X	1	1.1			1.7			14		1
08/25/22 14:00	0	X		0	X		0	X	1	1.1			1.7			14		1
08/25/22 15:00	0	X		0	X		0	X	1	1.1			1.7			13.9		1
08/25/22 16:00	0	X		0	X		0	X	1	1.1			1.7			14		1
08/25/22 17:00	0	X		0	X		0	X	1	1			1.6			14		1
08/25/22 18:00	0	X		0	X		0	X	1	1			1.6			14		1
08/25/22 19:00	0	X		0	X		0	X	1	1.1			1.6			14		1
08/25/22 20:00	0	X		0	X		0	X	1	1.1			1.6			14		1
08/25/22 21:00	0	X		0	X		0	X	1	1.1			1.6			14.1		1
08/25/22 22:00	0	X		0	X		0	X	1	1.2			1.6			14.1		1
08/25/22 23:00	0	X		0	X		0	X	1	1.2			1.6			14.2		1
08/26/22 0:00	0	X		0	X		0	X	1	1.3			1.6			14.2		1
08/26/22 1:00	0	X		0	X		0	X	1	1.4			1.6			14.2		1
08/26/22 2:00	0	X		0	X		0	X	1	1.4			1.6			14.2		1
08/26/22 3:00	0	X		0	X		0	X	1	1.4			1.6			14.2		1
08/26/22 4:00	0	X		0	X		0	X	1	1.4			1.6			14.2		1
08/26/22 5:00	0			0			17.5		1	1.3			1.6			14.1		1
08/26/22 6:00	0.7			1.8			14.5		1	0.6			1.5			14.6		1
08/26/22 7:00	0.5			1.6			14.7		1	0.6			1.6			14.6		1
08/26/22 8:00	0.5	X		1.7			14.8		1	0.6			1.6			14.7		1
08/26/22 9:00	0.7			1.5			14.5		1	0.8			1.3			14.4		1
08/26/22 10:00	0.6			1.6			14.6		1	0.7			1.5			14.5		1
08/26/22 11:00	0.8			1.6			14.3		1	0.9			1.5			14.2		1
08/26/22 12:00	0.7			1.7			13.6		1	0.9			1.6			13.5		1
08/26/22 13:00	0.2			1.7			12.6		1	0.5			1.6			12.6		1
08/26/22 14:00	0.1			1.7			12.4		1	0.5			1.6			12.3		1
08/26/22 15:00	0.1			1.7			12.6		1	0.5			1.6			12.5		1
08/26/22 16:00	0.1			1.7			12.4		1	0.5			1.6			12.4		1
08/26/22 17:00	0.1			1.7			11.9		1	0.4			1.7			11.9		1
08/26/22 18:00	0.1			1.6			12.3		1	0.4			1.6			12.3		1
08/26/22 19:00	0.1			1.6			12.2		1	0.4			1.6			12.1		1
08/26/22 20:00	0.2			1.6			12.6		1	0.5			1.6			12.6		1
08/26/22 21:00	0.3			1.6			12.8		1	0.6			1.6			12.8		1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/26/22 22:00	0.8			1.6			13.9		1	0.9			1.6			13.8		1
08/26/22 23:00	0.6			1.6			14.5		1	0.7			1.6			14.4		1
08/27/22 0:00	0.6			1.6			14.5		1	0.7			1.6			14.4		1
08/27/22 1:00	0.6			1.6			14.5		1	0.7			1.6			14.4		1
08/27/22 2:00	0.6			1.7			14.5		1	0.7			1.5			14.4		1
08/27/22 3:00	0.7			0	X		14.5		1	0.7			1.6			14.4		1
08/27/22 4:00	0.7			1.4			14.5		1	0.7			1.6			14.4		1
08/27/22 5:00	0.6			1.5			14.5		1	0.7			1.6			14.4		1
08/27/22 6:00	0.6			1.6			14.6		1	0.6			1.6			14.5		1
08/27/22 7:00	0.5			1.6			14.8		1	0.6			1.6			14.7		1
08/27/22 8:00	0.5			1.6			14.8		1	0.6			1.6			14.7		1
08/27/22 9:00	0.5			1.6			14.8		1	0.6			1.6			14.7		1
08/27/22 10:00	0.6			1.5			14.5		1	0.7			1.4			14.4		1
08/27/22 11:00	0.8			1.6			14.4		1	0.9			1.6			14.3		1
08/27/22 12:00	0.9			1.6			13.9		1	1.1			1.6			13.8		1
08/27/22 13:00	0.9			1.6			13.8		1	1			1.6			13.7		1
08/27/22 14:00	0.9			1.6			13.8		1	1			1.6			13.7		1
08/27/22 15:00	0.9			1.6			13.8		1	1			1.6			13.7		1
08/27/22 16:00	0.6			1.6			13.4		1	0.9			1.6			13.3		1
08/27/22 17:00	0.2			1.6			12.7		1	0.8			1.6			12.6		1
08/27/22 18:00	0.1			1.6			12.3		1	0.7			1.6			12.3		1
08/27/22 19:00	0.2			1.6			12.5		1	0.7			1.6			12.5		1
08/27/22 20:00	0.3			1.6			12.8		1	0.7			1.6			12.7		1
08/27/22 21:00	0.8			1.6			13.9		1	0.9			1.6			13.8		1
08/27/22 22:00	0.7			1.5			14.5		1	0.7			1.4			14.4		1
08/27/22 23:00	0.7			1.6			14.4		1	0.8			1.5			14.3		1
08/28/22 0:00	0.6			1.6			14.7		1	0.6			1.6			14.6		1
08/28/22 1:00	0.6			1.6			14.7		1	0.7			1.6			14.6		1
08/28/22 2:00	0.6			1.7			14.7		1	0.7			1.8			14.6		1
08/28/22 3:00	0.6			1.6			14.7		1	0.7			1.6			14.6		1
08/28/22 4:00	0.6			1.6			14.7		1	0.7			1.6			14.6		1
08/28/22 5:00	0.6			1.6			14.6		1	0.6			1.6			14.5		1
08/28/22 6:00	0.5			1.7			14.7		1	0.6			1.7			14.6		1
08/28/22 7:00	0.5			1.6			14.8		1	0.6			1.7			14.7		1
08/28/22 8:00	0.5			1.7			14.8		1	0.6			1.7			14.7		1
08/28/22 9:00	0.5			1.6			14.8		1	0.6			1.7			14.7		1
08/28/22 10:00	0.5			1.6			14.8		1	0.6			1.6			14.7		1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/28/22 11:00	0.5			1.6			14.8		1	0.6			1.6			14.7		1
08/28/22 12:00	0.6			1.6			14.6		1	0.7			1.5			14.6		1
08/28/22 13:00	0.7			1.6			14.5		1	0.7			1.7			14.4		1
08/28/22 14:00	0.7			1.7			14.5		1	0.7			1.7			14.4		1
08/28/22 15:00	0.6			1.6			14.6		1	0.7			1.7			14.5		1
08/28/22 16:00	0.7			1.6			14.1		1	0.9			1.8			14		1
08/28/22 17:00	0.1			1.7			12.1		1	0.6			1.5			12		1
08/28/22 18:00	0.7			1.6			13.6		1	0.9			1.5			13.5		1
08/28/22 19:00	1			1.6			14.1		1	1			1.5			14		1
08/28/22 20:00	0.9			1.6			14.2		1	1			1.5			14.1		1
08/28/22 21:00	0.7			1.6			14.5		1	0.7			1.4			14.4		1
08/28/22 22:00	0.6			1.6			14.6		1	0.7			1.4			14.5		1
08/28/22 23:00	0.7			1.6			14.4		1	0.8			1.4			14.3		1
08/29/22 0:00	0.7			1.7			14.4		1	0.8			1.5			14.3		1
08/29/22 1:00	0.7			1.7			14.4		1	0.8			1.5			14.3		1
08/29/22 2:00	0.7			1.7			14.4		1	0.8			1.4			14.3		1
08/29/22 3:00	0.7			1.7			14.4		1	0.8			1.5			14.3		1
08/29/22 4:00	0.7			1.7			14.5		1	0.8			1.5			14.3		1
08/29/22 5:00	0.6			1.7			14.5		1	0.7			1.5			14.4		1
08/29/22 6:00	0.6			1.6			14.6		1	0.7			1.6			14.5		1
08/29/22 7:00	0.6			1.6			14.7		1	0.6			1.6			14.6		1
08/29/22 8:00	0.5			1.6			14.8		1	0.6			1.6			14.7		1
08/29/22 9:00	0.6			1.7			14.7		1	0.7			1.6			14.6		1
08/29/22 10:00	0.5			1.6			14.8		1	0.6			1.6			14.7		1
08/29/22 11:00	0.5			1.7			14.8		1	0.7			1.7			14.7		1
08/29/22 12:00	0.5			1.7			14.8		1	0.7			1.7			14.7		1
08/29/22 13:00	0.6			1.6			14.6		1	0.7			1.6			14.5		1
08/29/22 14:00	0.8			1.6			14.4		1	0.9			1.9			14.3		1
08/29/22 15:00	0.7			1.7			13.6		1	0.9			1.7			13.5		1
08/29/22 16:00	0.5			1.6			13.4		1	0.9			1.6			13.3		1
08/29/22 17:00	0.2			1.6			12.5		1	0.7			1.6			12.5		1
08/29/22 18:00	0.2			1.5			12.8		1	0.7			1.5			12.8		1
08/29/22 19:00	0.4			1.5			13.2		1	0.8			1.5			13.1		1
08/29/22 20:00	0.6			1.5			13.4		1	0.9			1.6			13.4		1
08/29/22 21:00	0.8			1.5			13.8		1	1			1.5			13.7		1
08/29/22 22:00	0.6			1.5			14.5		1	0.7			1.5			14.4		1
08/29/22 23:00	0.6			1.6			14.5		1	0.7			1.6			14.4		1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/30/22 0:00	0.7			1.6			14.5		1	0.7			1.5			14.4		1
08/30/22 1:00	0.7			1.6			14.5		1	0.8			1.6			14.4		1
08/30/22 2:00	0.7			1.6			14.5		1	0.8			1.6			14.4		1
08/30/22 3:00	0.7			1.6			14.5		1	0.8			1.6			14.4		1
08/30/22 4:00	0.7			1.6			14.5		1	0.8			1.6			14.4		1
08/30/22 5:00	0.6			1.6			14.5		1	0.7			1.5			14.4		1
08/30/22 6:00	0.6			1.5			14.6		1	0.7			1.5			14.5		1
08/30/22 7:00	0.5			1.6			14.8		1	0.6			1.6			14.7		1
08/30/22 8:00	0.6			1.5			14.7		1	0.7			1.4			14.6		1
08/30/22 9:00	0.7			1.6			14.4		1	0.8			1.6			14.3		1
08/30/22 10:00	0.7			1.6			14.5		1	0.8			1.6			14.4		1
08/30/22 11:00	0.7			1.6			14.6		1	0.7			1.6			14.5		1
08/30/22 12:00	0.7			1.6			14.6		1	0.7			1.6			14.5		1
08/30/22 13:00	0.8			1.6			14.4		1	0.9			1.6			14.3		1
08/30/22 14:00	0.2			1.6			12.4		1	0.6			1.6			12.3		1
08/30/22 15:00	0.1			1.6			12.1		1	0.5			1.6			12		1
08/30/22 16:00	0.1			1.6			12.2		1	0.5			1.6			12.1		1
08/30/22 17:00	0.1			1.6			11.7		1	0.5			1.6			11.8		1
08/30/22 18:00	0.1			1.6			11.7		1	0.5			1.6			11.7		1
08/30/22 19:00	0.1			1.6			11.9		1	0.5			1.6			11.9		1
08/30/22 20:00	0.2			1.6			12.4		1	0.6			1.6			12.4		1
08/30/22 21:00	0.3			1.6			12.8		1	0.7			1.6			12.8		1
08/30/22 22:00	0.8			1.6			13.8		1	0.9			1.6			13.7		1
08/30/22 23:00	0.7			1.6			14.5		1	0.8			1.6			14.4		1
08/31/22 0:00	0.7			1.6			14.5		1	0.7			1.6			14.4		1
08/31/22 1:00	0.7			1.6			14.5		1	0.7			1.6			14.4		1
08/31/22 2:00	0.6			1.6			14.5		1	0.7			1.6			14.4		1
08/31/22 3:00	0.7			1.6			14.5		1	0.7			1.6			14.4		1
08/31/22 4:00	0.7			1.6			14.5		1	0.8			1.6			14.4		1
08/31/22 5:00	0.7			1.6			14.5		1	0.8			1.6			14.4		1
08/31/22 6:00	0.7			1.6			14.4		1	0.8			1.6			14.4		1
08/31/22 7:00	0.7			1.6			14.4		1	0.8			1.6			14.3		1
08/31/22 8:00	0.7			1.6			14.4		1	0.8			1.6			14.3		1
08/31/22 9:00	0.7			1.6			14.5		1	0.8			1.6			14.4		1
08/31/22 10:00	0.8			1.6			14.5		1	0.9			1.6			14.4		1
08/31/22 11:00	0.3			1.6			12.6		1	0.5			1.6			12.6		1
08/31/22 12:00	0.1			1.6			12.2		1	0.5			1.6			12.2		1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/31/22 13:00	0.1			1.6			12.1		1	0.5			1.6			12		1
08/31/22 14:00	0.1			1.6			12.2		1	0.5			1.6			12.2		1
08/31/22 15:00	0.2			1.6			12.8		1	0.6			1.6			12.7		1
08/31/22 16:00	0.4			1.6			13.2		1	0.7			1.6			13.1		1
08/31/22 17:00	0.1			1.6			12.1		1	0.5			1.6			12.1		1
08/31/22 18:00	0.1			1.6			11.9		1	0.5			1.6			11.9		1
08/31/22 19:00	0.2			1.6			12.6		1	0.6			1.6			12.5		1
08/31/22 20:00	0.6			1.6			13.4		1	0.9			1.6			13.3		1
08/31/22 21:00	0.5			1.6			13.1		1	0.8			1.6			13		1
08/31/22 22:00	0.9			1.6			13.8		1	1			1.6			13.7		1
08/31/22 23:00	0.7			1.6			13.4		1	0.9			1.6			13.4		1
09/01/22 0:00	0.6			1.6			13.3		1	0.9			1.6			13.3		1
09/01/22 1:00	1			1.6			14.1		1	1.1			1.6			14		1
09/01/22 2:00	0.7			1.6			14.5		1	0.8			1.6			14.5		1
09/01/22 3:00	0.7			1.6			14.5		1	0.8			1.6			14.5		1
09/01/22 4:00	0.8			1.6			14.5		1	0.9			1.6			14.4		1
09/01/22 5:00	0.9			1.6			14.5		1	1			1.6			14.4		1
09/01/22 6:00	0.9			1.6			14.5		1	1			1.6			14.4		1
09/01/22 7:00	0.7			1.6			14.5		1	0.8			1.6			14.5		1
09/01/22 8:00	0.7			1.6			14.7		1	0.8			1.6			14.6		1
09/01/22 9:00	0.7			1.6			14.7		1	0.8			1.6			14.7		1
09/01/22 10:00	0.6			1.5			14.8		1	0.7			1.5			14.7		1
09/01/22 11:00	0.8			1.6			14.4		1	0.9			1.4			14.1		1
09/01/22 12:00	0.2			1.6			12.6		1	0.6			1.6			12.6		1
09/01/22 13:00	0.1			1.6			12.4		1	0.6			1.6			12.3		1
09/01/22 14:00	0.1			1.6			12.2		1	0.6			1.6			12.2		1
09/01/22 15:00	0.1			1.6			11.9		1	0.6			1.6			11.9		1
09/01/22 16:00	0.1			1.6			12.2		1	0.6			1.6			12.2		1
09/01/22 17:00	0.1			1.6			11.9		1	0.6			1.6			11.8		1
09/01/22 18:00	0.1			1.6			11.8		1	0.6			1.6			11.8		1
09/01/22 19:00	0.1			1.6			12.4		1	0.7			1.6			12.4		1
09/01/22 20:00	0.1			1.6			12.2		1	0.6			1.6			12.1		1
09/01/22 21:00	0.2			1.6			12.3		1	0.6			1.6			12.3		1
09/01/22 22:00	0.3			1.6			12.8		1	0.8			1.6			12.7		1
09/01/22 23:00	0.3			1.6			12.7		1	0.8			1.6			12.7		1
09/02/22 0:00	0.4			1.6			13.1		1	0.8			1.6			13		1
09/02/22 1:00	0.5			1.6			13.2		1	0.9			1.6			13.2		1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/02/22 2:00	0.6			1.6			13.4		1	0.9			1.6			13.4		1
09/02/22 3:00	0.7			1.6			13.4		1	0.9			1.6			13.4		1
09/02/22 4:00	0.5			1.6			13.2		1	0.9			1.6			13.1		1
09/02/22 5:00	0.4			1.6			12.9		1	0.8			1.6			12.9		1
09/02/22 6:00	0.9			1.6			13.7		1	1			1.6			13.7		1
09/02/22 7:00	1.1			1.6			14.1		1	1.1			1.6			14		1
09/02/22 8:00	1			1.6			13.9		1	1.1			1.6			13.8		1
09/02/22 9:00	0.6			1.6			13.4		1	1			1.6			13.3		1
09/02/22 10:00	0.4			1.6			13.1		1	0.8			1.6			13		1
09/02/22 11:00	0.3			1.6			12.9		1	0.8			1.6			12.8		1
09/02/22 12:00	0.2			1.6			12.7		1	0.8			1.6			12.6		1
09/02/22 13:00	0.1			1.6			12.3		1	0.8			1.6			12.3		1
09/02/22 14:00	0.1			1.6			12.4		1	0.8			1.6			12.3		1
09/02/22 15:00	0.4			1.6			13.2		1	0.8			1.6			13.2		1
09/02/22 16:00	0.5			1.6			13.4		1	0.9			1.6			13.3		1
09/02/22 17:00	0.5			1.6			13.3		1	0.8			1.6			13.3		1
09/02/22 18:00	0.3			1.6			13		1	0.8			1.6			13		1
09/02/22 19:00	0.3			1.6			12.8		1	0.8			1.6			12.8		1
09/02/22 20:00	0.4			1.6			12.9		1	0.8			1.6			12.9		1
09/02/22 21:00	0.7			1.6			13.5		1	1			1.6			13.4		1
09/02/22 22:00	0.9			1.6			14		1	1.1			1.6			13.9		1
09/02/22 23:00	0.7			1.6			14.5		1	0.8			1.5			14.5		1
09/03/22 0:00	0.7			1.6			14.4		1	0.8			1.6			14.3		1
09/03/22 1:00	0.6			1.6			14.7		1	0.7			1.6			14.6		1
09/03/22 2:00	0.6			1.7			14.8		1	0.7			1.5			14.7		1
09/03/22 3:00	0.6			1.6			14.7		1	0.7			1.6			14.6		1
09/03/22 4:00	0.6			1.6			14.8		1	0.7			1.6			14.7		1
09/03/22 5:00	0.6			1.6			14.7		1	0.7			1.6			14.6		1
09/03/22 6:00	0.5			1.6			14.8		1	0.6			1.6			14.7		1
09/03/22 7:00	0.5			1.6			14.8		1	0.6			1.6			14.7		1
09/03/22 8:00	0.5			1.6			14.9		1	0.6			1.6			14.8		1
09/03/22 9:00	0.5			1.6			14.9		1	0.7			1.5			14.8		1
09/03/22 10:00	0.6			1.6			14.8		1	0.7			1.6			14.7		1
09/03/22 11:00	0.5			1.6			14.9		1	0.6			1.6			14.8		1
09/03/22 12:00	0.7			1.5			14.7		1	0.8			1.4			14.6		1
09/03/22 13:00	0.9			1.6			13.8		1	1.1			1.7			13.7		1
09/03/22 14:00	0.9			1.6			13.9		1	1.1			1.6			13.8		1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/03/22 15:00	0.7			1.6			14.4		1	0.9			1.8			14.3		1
09/03/22 16:00	0.7			1.6			13.7		1	1			1.6			13.7		1
09/03/22 17:00	0.8			1.6			13.8		1	1			1.6			13.7		1
09/03/22 18:00	0.9			1.6			13.9		1	1.1			1.6			13.8		1
09/03/22 19:00	0.7			1.6			14.7		1	0.8			1.6			14.6		1
09/03/22 20:00	0.7			1.6			14.6		1	0.8			1.5			14.5		1
09/03/22 21:00	0.7			1.5			14.6		1	0.8			1.5			14.5		1
09/03/22 22:00	0.7			1.5			14.6		1	0.8			1.7			14.5		1
09/03/22 23:00	0.7			1.5			14.5		1	0.8			1.5			14.4		1
09/04/22 0:00	0.7			1.6			14.6		1	0.8			1.5			14.5		1
09/04/22 1:00	0.6			1.6			14.7		1	0.7			1.6			14.7		1
09/04/22 2:00	0.7			1.5			14.6		1	0.8			1.6			14.5		1
09/04/22 3:00	0.7			1.6			14.6		1	0.9			1.6			14.5		1
09/04/22 4:00	0.8			1.6			14.7		1	0.9			1.6			14.6		1
09/04/22 5:00	1			1.6			14.8		1	1.1			1.6			14.7		1
09/04/22 6:00	0.9			1.6			14.8		1	1			1.6			14.7		1
09/04/22 7:00	0.6			1.6			14.8		1	0.7			1.6			14.8		1
09/04/22 8:00	0.5			1.6			14.9		1	0.6			1.6			14.8		1
09/04/22 9:00	0.5			1.6			14.9		1	0.6			1.6			14.8		1
09/04/22 10:00	0.5			1.6			14.9		1	0.6			1.5			14.8		1
09/04/22 11:00	0.5			1.6			14.9		1	0.6			1.6			14.9		1
09/04/22 12:00	0.6			1.6			14.7		1	0.7			1.5			14.6		1
09/04/22 13:00	0.6			1.5			14.7		1	0.7			1.5			14.6		1
09/04/22 14:00	0.8			1.5			14.3		1	0.9			1.2			14.2		1
09/04/22 15:00	0.8			1.6			13.7		1	1			1.6			13.7		1
09/04/22 16:00	0.7			1.6			13.5		1	1			1.6			13.5		1
09/04/22 17:00	0.4			1.6			13.2		1	0.9			1.6			13.1		1
09/04/22 18:00	0.5			1.6			13.3		1	0.9			1.6			13.2		1
09/04/22 19:00	1			1.6			14.2		1	1.1			1.6			14.2		1
09/04/22 20:00	0.7			1.6			13.6		1	1			1.6			13.5		1
09/04/22 21:00	0.8			1.6			13.6		1	1			1.6			13.5		1
09/04/22 22:00	1.1			1.6			14		1	1.2			1.6			14		1
09/04/22 23:00	0.7			1.6			14.5		1	0.9			1.6			14.4		1
09/05/22 0:00	0.7			1.6			14.5		1	0.9			1.6			14.4		1
09/05/22 1:00	0.8			1.6			14.4		1	0.9			1.6			14.3		1
09/05/22 2:00	0.8			1.6			14.4		1	1			1.6			14.3		1
09/05/22 3:00	0.9			1.6			14.4		1	0.9			1.6			14.3		1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/05/22 4:00	0.9			1.6			14.4		1	1			1.6			14.3		1
09/05/22 5:00	1			1.6			14.4		1	1.1			1.6			14.3		1
09/05/22 6:00	0.7			1.6			14.7		1	0.8			1.6			14.6		1
09/05/22 7:00	0.7			1.6			14.9		1	0.8			1.6			14.8		1
09/05/22 8:00	0.6			1.6			14.9		1	0.7			1.6			14.8		1
09/05/22 9:00	0.7			1.5			14.6		1	0.8			1.1			14.5		1
09/05/22 10:00	0.7			1.6			14.6		1	0.8			1.7			14.5		1
09/05/22 11:00	0.8			1.6			14.3		1	0.9			1.6			14.3		1
09/05/22 12:00	0.5			1.6			13.2		1	0.6			1.6			13.2		1
09/05/22 13:00	0.3			1.6			12.8		1	0.6			1.6			12.7		1
09/05/22 14:00	0.1			1.6			12		1	0.5			1.6			12		1
09/05/22 15:00	0.1			1.6			11.9		1	0.5			1.6			11.9		1
09/05/22 16:00	0.1			1.6			11.9		1	0.5			1.6			11.8		1
09/05/22 17:00	0.1			1.6			11.8		1	0.6			1.6			11.7		1
09/05/22 18:00	0.1			1.6			11.9		1	0.5			1.6			11.8		1
09/05/22 19:00	0.1			1.6			11.9		1	0.5			1.6			11.9		1
09/05/22 20:00	0.1			1.6			12		1	0.5			1.6			12		1
09/05/22 21:00	0.1			1.6			12.4		1	0.7			1.6			12.3		1
09/05/22 22:00	0.2			1.6			12.4		1	0.7			1.6			12.3		1
09/05/22 23:00	0.2			1.6			12.4		1	0.6			1.6			12.3		1
09/06/22 0:00	0.4			1.6			12.9		1	0.7			1.6			12.9		1
09/06/22 1:00	0.9			1.6			13.9		1	1.1			1.6			13.9		1
09/06/22 2:00	0.7			1.7			14.6		1	0.7			1.5			14.5		1
09/06/22 3:00	0.7			1.6			14.6		1	0.8			1.6			14.5		1
09/06/22 4:00	0.7			1.6			14.5		1	0.7			1.6			14.5		1
09/06/22 5:00	0.8			1.6			14.5		1	0.8			1.6			14.5		1
09/06/22 6:00	0.9			1.6			14.5		1	1			1.6			14.4		1
09/06/22 7:00	1.1			1.6			14.5		1	1.2			1.6			14.4		1
09/06/22 8:00	0.7			1.6			14.6		1	0.8			1.6			14.5		1
09/06/22 9:00	0.7			1.6			13.8		1	1			1.6			13.7		1
09/06/22 10:00	0.4			1.6			12.9		1	0.9			1.6			12.8		1
09/06/22 11:00	0.1			1.6			11.9		1	0.7			1.6			11.9		1
09/06/22 12:00	0.1			1.6			11.8		1	0.6			1.6			11.8		1
09/06/22 13:00	0.1			1.6			11.8		1	0.6			1.6			11.8		1
09/06/22 14:00	0.1			1.6			11.8		1	0.7			1.6			11.7		1
09/06/22 15:00	0.1			1.6			11.8		1	0.7			1.6			11.7		1
09/06/22 16:00	0.1			1.6			11.8		1	0.7			1.6			11.7		1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/06/22 17:00	0.1			1.6			11.8		1	0.7			1.6			11.7		1
09/06/22 18:00	0.1			1.6			11.8		1	0.7			1.6			11.7		1
09/06/22 19:00	0.1			1.6			11.9		1	0.7			1.6			11.9		1
09/06/22 20:00	0.1			1.6			12		1	0.7			1.6			12		1
09/06/22 21:00	0.1			1.6			12.1		1	0.7			1.6			12		1
09/06/22 22:00	0.4			1.6			13.1		1	0.9			1.6			13		1
09/06/22 23:00	0.5			1.6			13.1		1	0.9			1.6			13.1		1
09/07/22 0:00	1.3			1.6			14.2		1	1.2			1.6			14.1		1
09/07/22 1:00	0.7			1.6			14.5		1	0.8			1.6			14.5		1
09/07/22 2:00	0.7			1.5			14.6		1	0.7			1.6			14.5		1
09/07/22 3:00	0.7			1.7			14.6		1	0.8			1.6			14.5		1
09/07/22 4:00	0.7			1.6			14.6		1	0.8			1.6			14.5		1
09/07/22 5:00	0.7			1.6			14.6		1	0.7			1.6			14.5		1
09/07/22 6:00	0.7			1.6			14.5		1	0.8			1.6			14.5		1
09/07/22 7:00	0.7			1.6			14.5		1	0.8			1.6			14.3		1
09/07/22 8:00	0.7			1.6			14.6		1	0.7			1.6			14.5		1
09/07/22 9:00	0.3			1.7			12.5		1	0.9			1.7			12.5		1
09/07/22 10:00	0.1			1.7			12.3		1	0.7			1.7			12.2		1
09/07/22 11:00	0.1			1.7			12.2		1	0.7			1.7			12.2		1
09/07/22 12:00	0.1			1.7			12.1		1	0.7			1.7			12.1		1
09/07/22 13:00	0.1			1.7			12.1		1	0.7			1.7			12		1
09/07/22 14:00	0.1			1.7			12		1	0.7			1.7			12		1
09/07/22 15:00	0.1			1.7			12		1	0.7			1.7			11.9		1
09/07/22 16:00	0.1			1.7			12		1	0.7			1.7			11.9		1
09/07/22 17:00	0.1			1.7			12		1	0.7			1.7			11.9		1
09/07/22 18:00	0.1			1.7			12		1	0.7			1.7			11.9		1
09/07/22 19:00	0.1			1.7			12.2		1	0.7			1.7			12.1		1
09/07/22 20:00	0.1			1.7			12.2		1	0.7			1.7			12.1		1
09/07/22 21:00	0.1			1.7			12.3		1	0.7			1.7			12.2		1
09/07/22 22:00	0.2			1.7			12.6		1	0.8			1.7			12.6		1
09/07/22 23:00	0.3			1.7			12.8		1	0.9			1.7			12.8		1
09/08/22 0:00	0.3			1.6			12.8		1	0.9			1.6			12.8		1
09/08/22 1:00	0.9			1.6			14.4		1	1			1.6			14.3		1
09/08/22 2:00	0.7			1.6			14.6		1	0.8			1.6			14.5		1
09/08/22 3:00	0.7			1.6			14.6		1	0.8			1.6			14.5		1
09/08/22 4:00	0.7			1.6			14.6		1	0.9			1.6			14.5		1
09/08/22 5:00	0.9			1.6			14.6		1	1.1			1.6			14.4		1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/08/22 6:00	0.8			1.6			14.6		1	0.9			1.6			14.4		1
09/08/22 7:00	0.8			1.6			14.5		1	0.9			1.6			14.4		1
09/08/22 8:00	0.9			1.6			14.5		1	1			1.6			14.4		1
09/08/22 9:00	0.2			1.7			12.2		1	0.8			1.7			12.2		1
09/08/22 10:00	0.1			1.7			12.1		1	0.7			1.6			12		1
09/08/22 11:00	0.1			1.7			12		1	0.7			1.6			11.9		1
09/08/22 12:00	0.1			1.7			11.9		1	0.7			1.6			11.9		1
09/08/22 13:00	0.1			1.7			11.9		1	0.7			1.6			11.8		1
09/08/22 14:00	0.1			1.7			11.8		1	0.7			1.6			11.8		1
09/08/22 15:00	0.1			1.7			11.8		1	0.7			1.6			11.8		1
09/08/22 16:00	0.1			1.7			11.8		1	0.7			1.6			11.8		1
09/08/22 17:00	0.1			1.7			11.8		1	0.7			1.6			11.8		1
09/08/22 18:00	0.1			1.6			11.9		1	0.7			1.6			11.9		1
09/08/22 19:00	0.1			1.6			11.9		1	0.7			1.6			11.9		1
09/08/22 20:00	0.1			1.6			11.8		1	0.7			1.6			11.8		1
09/08/22 21:00	0.2			1.6			11.7		1	0.7			1.6			11.7		1
09/08/22 22:00	0.2			1.6			12.1		1	0.8			1.6			12.1		1
09/08/22 23:00	0.2			1.6			12.5		1	0.9			1.6			12.5		1
09/09/22 0:00	0.2			1.6			12.5		1	0.8			1.6			12.5		1
09/09/22 1:00	0.4			1.6			12.9		1	0.9			1.6			12.9		1
09/09/22 2:00	0.4			1.4			13		1	1			1.4			12.9		1
09/09/22 3:00	0.5			1.5			13.3		1	1.1			1.5			13.2		1
09/09/22 4:00	0.4			1.6			12.9		1	1.1			1.6			12.9		1
09/09/22 5:00	0.3			1.6			12.2		1	0.9			1.6			12.2		1
09/09/22 6:00	0.3			1.6			12.5		1	1			1.6			12.5		1
09/09/22 7:00	0.3			1.6			12.6		1	1.1			1.6			12.6		1
09/09/22 8:00	0.4			1.6			12.9		1	1.1			1.6			12.8		1
09/09/22 9:00	0.5			1.6			13.1		1	1.1			1.6			13		1
09/09/22 10:00	0.2			1.6			12.4		1	1			1.6			12.4		1
09/09/22 11:00	0.5			1.6			13.2		1	1.1			1.6			13.1		1
09/09/22 12:00	0.2			1.6			12.5		1	1			1.6			12.5		1
09/09/22 13:00	0.1			1.6			12.2		1	0.9			1.6			12.1		1
09/09/22 14:00	0.2			1.6			12.5		1	0.9			1.6			12.4		1
09/09/22 15:00	0.2			1.6			12.6		1	1			1.6			12.5		1
09/09/22 16:00	0.4			1.6			13.1		1	1.2			1.6			13		1
09/09/22 17:00	0.3			1.6			12.9		1	1.2			1.6			12.8		1
09/09/22 18:00	0.5			1.6			13.2		1	1.2			1.6			13.1		1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/09/22 19:00	0.7			1.6			13.5		1	1.2			1.6			13.5		1
09/09/22 20:00	0.9			1.6			14.1		1	1.1			1.6			14		1
09/09/22 21:00	0.7			1.6			14.5		1	0.8			1.6			14.5		1
09/09/22 22:00	0.8			1.6			14.5		1	0.9			1.5			14.4		1
09/09/22 23:00	0.7			1.6			14.5		1	0.8			1.6			14.5		1
09/10/22 0:00	0.7			1.6			14.5		1	0.8			1.6			14.4		1
09/10/22 1:00	0.7			1.6			14.6		1	0.8			1.6			14.6		1
09/10/22 2:00	0.7			1.5			14.5		1	0.8			0.5			14.4		1
09/10/22 3:00	0.8			1.5			14.4		1	0.9			1.6			14.3		1
09/10/22 4:00	0.7			1.6			14.4		1	0.8			1.6			14.3		1
09/10/22 5:00	0.8			1.5			14.4		1	0.9			1.5			14.3		1
09/10/22 6:00	0.7			1.6			14.6		1	0.8			1.4			14.5		1
09/10/22 7:00	0.7			1.6			14.5		1	0.8			1.6			14.4		1
09/10/22 8:00	0.7			1.6			14.5		1	0.8			1.5			14.4		1
09/10/22 9:00	0.7			1.5			14.5		1	0.7			1.5			14.4		1
09/10/22 10:00	0.5			1.6			14.9		1	0.6			1.5			14.8		1
09/10/22 11:00	0.5			1.6			14.9		1	0.6			1.6			14.8		1
09/10/22 12:00	0.6			1.5			14.8		1	0.7			1.4			14.7		1
09/10/22 13:00	0.6			1.4			14.7		1	0.7			1.3			14.6		1
09/10/22 14:00	0.6			1.6			14.7		1	0.7			1.7			14.6		1
09/10/22 15:00	0.6			1.6			14.7		1	0.7			1.5			14.6		1
09/10/22 16:00	0.6			1.6			14.6		1	0.7			1.3			14.5		1
09/10/22 17:00	0.6			1.6			14.7		1	0.7			1.8			14.5		1
09/10/22 18:00	0.7			1.5			14.4		1	0.9			1.4			14.3		1
09/10/22 19:00	0.7			1.6			14.5		1	0.8			1.6			14.4		1
09/10/22 20:00	0.7			1.6			14.5		1	0.8			1.6			14.4		1
09/10/22 21:00	0.7			1.6			14.5		1	0.8			1.6			14.4		1
09/10/22 22:00	0.8			1.5			14.4		1	0.9			1.4			14.3		1
09/10/22 23:00	0.7			1.6			14.5		1	0.8			1.6			14.4		1
09/11/22 0:00	0.7			1.6			14.6		1	0.8			1.6			14.5		1
09/11/22 1:00	0.7			1.6			14.5		1	0.8			1.6			14.4		1
09/11/22 2:00	0.7			1.7			14.5		1	0.8			1.6			14.4		1
09/11/22 3:00	0.8			1.7			14.4		1	0.9			1.6			14.3		1
09/11/22 4:00	0.7			1.6			14.5		1	0.8			1.6			14.4		1
09/11/22 5:00	0.7			1.6			14.4		1	0.8			1.6			14.3		1
09/11/22 6:00	0.7			1.5			14.5		1	0.8			1.4			14.4		1
09/11/22 7:00	0.7			1.6			14.6		1	0.7			1.5			14.5		1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/11/22 8:00	0.6			1.5			14.8		1	0.7			1.5			14.6		1
09/11/22 9:00	0.5			1.6			14.9		1	0.7			1.6			14.7		1
09/11/22 10:00	0.6			1.6			14.8		1	0.7			1.5			14.7		1
09/11/22 11:00	0.6			1.6			14.8		1	0.7			1.6			14.7		1
09/11/22 12:00	0.6			1.4			14.7		1	0.8			1.4			14.6		1
09/11/22 13:00	0.6			1.6			14.6		1	0.8			1.8			14.5		1
09/11/22 14:00	0.7			1.5			14.5		1	0.8			1.9			14.4		1
09/11/22 15:00	0.7			1.6			14.5		1	0.8			1.6			14.4		1
09/11/22 16:00	0.8			1.6			13.9		1	1.4			1.6			14		1
09/11/22 17:00	0.5			1.6			13.3		1	1.1			1.6			13.2		1
09/11/22 18:00	0.8			1.6			13.7		1	1.2			1.6			13.7		1
09/11/22 19:00	0.8			1.6			14		1	1.1			1.6			13.9		1
09/11/22 20:00	0.7			1.6			14.5		1	0.8			1.6			14.4		1
09/11/22 21:00	0.7			1.6			14.6		1	0.8			1.6			14.5		1
09/11/22 22:00	0.7			1.6			14.6		1	0.8			1.5			14.5		1
09/11/22 23:00	0.7			1.5			14.5		1	0.8			1.5			14.4		1
09/12/22 0:00	0.7			1.5			14.4		1	0.9			1.5			14.3		1
09/12/22 1:00	0.6			1.6			14.7		1	0.7			1.6			14.6		1
09/12/22 2:00	0.6			1.7			14.8		1	0.7			1.6			14.7		1
09/12/22 3:00	0.7			1.6			14.8		1	0.7			1.6			14.7		1
09/12/22 4:00	0.7			1.6			14.6		1	0.8			1.5			14.5		1
09/12/22 5:00	0.7			1.6			14.5		1	0.8			1.6			14.5		1
09/12/22 6:00	0.7			1.6			14.5		1	0.8			1.6			14.4		1
09/12/22 7:00	0.7			1.5			14.5		1	0.8			1.4			14.4		1
09/12/22 8:00	0.6			1.6			14.7		1	0.7			1.6			14.6		1
09/12/22 9:00	0.6			1.6			14.8		1	0.7			1.6			14.7		1
09/12/22 10:00	0.6			1.6			14.7		1	0.8			1.5			14.6		1
09/12/22 11:00	0.7			1.6			14.7		1	0.8			1.5			14.6		1
09/12/22 12:00	0.7			1.6			14.6		1	0.8			1.6			14.5		1
09/12/22 13:00	0.7			1.6			14.5		1	0.9			1.6			14.4		1
09/12/22 14:00	0.7			1.6			14.5		1	0.8			1.6			14.4		1
09/12/22 15:00	0.8			1.6			14.6		1	0.9			1.5			14.5		1
09/12/22 16:00	0.8			1.6			14.5		1	0.9			1.5			14.4		1
09/12/22 17:00	0.7			1.6			14.6		1	0.8			1.6			14.5		1
09/12/22 18:00	0.7			1.6			14.5		1	0.8			1.6			14.5		1
09/12/22 19:00	0.7			1.6			14.6		1	0.8			1.6			14.5		1
09/12/22 20:00	0.7			1.6			14.6		1	0.8			1.6			14.5		1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/12/22 21:00	0.7			1.6			14.5		1	0.8			1.6			14.5		1
09/12/22 22:00	0.7			1.6			14.6		1	0.8			1.6			14.5		1
09/12/22 23:00	0.7			1.6			14.4		1	0.8			1.5			14.4		1
09/13/22 0:00	0.7			1.6			14.4		1	0.8			1.6			14.3		1
09/13/22 1:00	0.7			1.6			14.5		1	0.8			1.5			14.4		1
09/13/22 2:00	0.6			1.6			14.6		1	0.7			1.2			14.5		1
09/13/22 3:00	1.2			1.5			14.4		1	1.6			1.5			14.3		1
09/13/22 4:00	1.2			1.6			14		1	1.4			1.6			13.9		1
09/13/22 5:00	1.2			1.6			13.9		1	1.3			1.6			13.8		1
09/13/22 6:00	1			1.6			14.2		1	1.1			1.6			14.1		1
09/13/22 7:00	0.7			1.6			14.5		1	0.8			1.6			14.4		1
09/13/22 8:00	0.6			1.6			14.6		1	0.7			1.5			14.5		1
09/13/22 9:00	0.6			1.6			14.7		1	0.7			1.6			14.6		1
09/13/22 10:00	0.6			1.6			14.7		1	0.7			1.6			14.6		1
09/13/22 11:00	0.6			1.6			14.7		1	0.7			1.6			14.6		1
09/13/22 12:00	0.5			1.6			14.8		1	0.7			1.6			14.7		1
09/13/22 13:00	0.5			1.6			14.8		1	0.6			1.6			14.7		1
09/13/22 14:00	0.5			1.6			14.8		1	0.7			1.6			14.7		1
09/13/22 15:00	0.5			1.6			14.8		1	0.6			1.6			14.7		1
09/13/22 16:00	0.6			1.6			14.7		1	0.7			1.5			14.6		1
09/13/22 17:00	1.1			1.6			14		1	1.3			1.6			13.9		1
09/13/22 18:00	1.2			1.6			14.1		1	1.5			1.6			14		1
09/13/22 19:00	1.3			1.6			14.1		1	1.4			1.6			14		1
09/13/22 20:00	1.4			1.6			14.2		1	1.4			1.6			14.1		1
09/13/22 21:00	1.3			1.6			14.3		1	1.3			1.6			14.2		1
09/13/22 22:00	0.6			1.6			14.6		1	0.7			1.6			14.5		1
09/13/22 23:00	0.8			1.6			14.4		1	0.9			1.5			14.3		1
09/14/22 0:00	0.7			1.6			14.4		1	0.9			1.6			14.3		1
09/14/22 1:00	0.7			1.6			14.4		1	0.8			1.6			14.4		1
09/14/22 2:00	0.7			1.5			14.4		1	0.8			1.6			14.3		1
09/14/22 3:00	0.8			1.6			14.4		1	0.8			1.6			14.3		1
09/14/22 4:00	0.7			1.6			14.4		1	0.8			1.5			14.3		1
09/14/22 5:00	0.7			1.6			14.5		1	0.8			1.6			14.4		1
09/14/22 6:00	0.7			1.6			14.5		1	0.8			1.6			14.4		1
09/14/22 7:00	0.6			1.6			14.7		1	0.6			1.6			14.6		1
09/14/22 8:00	0.5			1.6			14.8		1	0.6			1.6			14.7		1
09/14/22 9:00	0.5			1.6			14.8		1	0.6			1.6			14.7		1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/14/22 10:00	0.5			1.6			14.8		1	0.6			1.6			14.7		1
09/14/22 11:00	0.5			1.6			14.8		1	0.6			1.6			14.7		1
09/14/22 12:00	0.5			1.6			14.8		1	0.6			1.6			14.7		1
09/14/22 13:00	0.5			1.6			14.8		1	0.6			1.6			14.8		1
09/14/22 14:00	0.5			1.6			14.8		1	0.6			1.6			14.8		1
09/14/22 15:00	0.5			1.6			14.9		1	0.6			1.6			14.8		1
09/14/22 16:00	0.5			1.6			14.8		1	0.7			1.6			14.7		1
09/14/22 17:00	0.6			1.5			14.7		1	0.7			1.5			14.6		1
09/14/22 18:00	0.7			1.6			14.4		1	0.8			1.5			14.3		1
09/14/22 19:00	0.6			1.6			14.5		1	0.8			1.5			14.4		1
09/14/22 20:00	0.7			1.6			14.5		1	0.8			1.5			14.4		1
09/14/22 21:00	0.7			1.6			14.5		1	0.8			1.5			14.4		1
09/14/22 22:00	0.6			1.6			14.7		1	0.7			1.6			14.6		1
09/14/22 23:00	0.6			1.6			14.6		1	0.7			1.6			14.5		1
09/15/22 0:00	0.6			1.6			14.7		1	0.7			1.6			14.6		1
09/15/22 1:00	0.6			1.5			14.6		1	0.7			1.4			14.5		1
09/15/22 2:00	0.6			1.5			14.6		1	0.7			1.7			14.5		1
09/15/22 3:00	0.8			1.5			14.5		1	0.9			1.5			14.4		1
09/15/22 4:00	0.7			1.6			14.5		1	0.8			1.5			14.4		1
09/15/22 5:00	0.7			1.6			14.5		1	0.8			1.6			14.4		1
09/15/22 6:00	0.6			1.6			14.6		1	0.8			1.6			14.5		1
09/15/22 7:00	0.7			1.5			14.6		1	0.8			1.5			14.5		1
09/15/22 8:00	0.5			1.6			14.8		1	0.6			1.6			14.7		1
09/15/22 9:00	0.5			1.6			14.8		1	0.6			1.6			14.7		1
09/15/22 10:00	0.9			1.5			14.4		1	1.2			1.4			14.3		1
09/15/22 11:00	1.4			1.6			14.2		1	1.5			1.6			14.1		1
09/15/22 12:00	0.7			1.6			14.6		1	0.8			1.6			14.5		1
09/15/22 13:00	0.5			1.6			14.8		1	0.7			1.6			14.7		1
09/15/22 14:00	0.6			1.5			14.7		1	0.8			1.5			14.6		1
09/15/22 15:00	0.6			1.6			14.8		1	0.7			1.6			14.7		1
09/15/22 16:00	0.5			1.6			14.8		1	0.7			1.6			14.7		1
09/15/22 17:00	0.6			1.5			14.6		1	0.8			1.4			14.5		1
09/15/22 18:00	0.6			1.6			14.7		1	0.7			1.6			14.6		1
09/15/22 19:00	0.6			1.6			14.6		1	0.7			1.5			14.5		1
09/15/22 20:00	0.6			1.6			14.6		1	0.7			1.5			14.5		1
09/15/22 21:00	0.6			1.6			14.6		1	0.8			1.5			14.5		1
09/15/22 22:00	0.6			1.6			14.6		1	0.7			1.5			14.6		1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/15/22 23:00	0.6			1.6			14.7		1	0.7			1.6			14.6		1
09/16/22 0:00	0.6			1.6			14.7		1	0.7			1.6			14.6		1
09/16/22 1:00	0.6			1.6			14.8		1	0.6			1.6			14.7		1
09/16/22 2:00	0.5			1.6			14.8		1	0.6			1.7			14.7		1
09/16/22 3:00	0.6			1.6			14.8		1	0.7			1.6			14.7		1
09/16/22 4:00	0.6			1.6			14.7		1	0.7			1.6			14.6		1
09/16/22 5:00	0.7			1.5			14.5		1	0.8			1.5			14.4		1
09/16/22 6:00	0.7			1.6			14.5		1	0.8			1.6			14.4		1
09/16/22 7:00	0.5			1.7			14.8		1	0.6			1.6			14.7		1
09/16/22 8:00	0.5			1.6			14.8		1	0.6			1.6			14.7		1
09/16/22 9:00	0.5			1.6			14.8		1	0.6			1.6			14.7		1
09/16/22 10:00	0.5			1.6			14.8		1	0.6			1.6			14.7		1
09/16/22 11:00	0.5			1.6			14.9		1	0.6			1.6			14.8		1
09/16/22 12:00	0.5			1.6			14.9		1	0.6			1.6			14.8		1
09/16/22 13:00	0.5			1.6			14.9		1	0.6			1.6			14.8		1
09/16/22 14:00	0.6			1.5			14.7		1	0.7			1.4			14.6		1
09/16/22 15:00	0.5			1.6			14.8		1	0.6			1.5			14.7		1
09/16/22 16:00	0.5			1.5			14.9		1	0.6			1.5			14.8		1
09/16/22 17:00	0.6			1.6			14.8		1	0.7			1.6			14.7		1
09/16/22 18:00	0.6			1.6			14.8		1	0.7			1.6			14.7		1
09/16/22 19:00	0.6			1.6			14.8		1	0.7			1.6			14.7		1
09/16/22 20:00	0.6			1.6			14.7		1	0.7			1.6			14.6		1
09/16/22 21:00	0.6			1.6			14.7		1	0.7			1.6			14.6		1
09/16/22 22:00	0.6			1.6			14.7		1	0.7			1.6			14.6		1
09/16/22 23:00	0.6			1.6			14.7		1	0.7			1.6			14.6		1
09/17/22 0:00	0.6			1.6			14.7		1	0.7			1.6			14.6		1
09/17/22 1:00	0.6			1.6			14.7		1	0.7			1.6			14.6		1
09/17/22 2:00	0.6			1.6			14.7		1	0.7			1.6			14.6		1
09/17/22 3:00	0.7			1.6			14.7		1	0.7			1.6			14.6		1
09/17/22 4:00	0.6			1.6			14.6		1	0.7			1.5			14.5		1
09/17/22 5:00	0.6			1.6			14.7		1	0.7			1.6			14.6		1
09/17/22 6:00	0.5			1.6			14.8		1	0.7			1.6			14.7		1
09/17/22 7:00	0.5			1.6			14.8		1	0.7			1.6			14.7		1
09/17/22 8:00	0.5			1.6			14.8		1	0.6			1.6			14.7		1
09/17/22 9:00	0.5			1.6			14.8		1	0.6			1.6			14.7		1
09/17/22 10:00	0.5			1.6			14.8		1	0.7			1.6			14.7		1
09/17/22 11:00	0.5			1.6			14.8		1	0.6			1.6			14.7		1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/17/22 12:00	0.5			1.6			14.8		1	0.6			1.6			14.7		1
09/17/22 13:00	0.5			1.6			14.8		1	0.6			1.6			14.8		1
09/17/22 14:00	0.5			1.6			14.9		1	0.6			1.6			14.8		1
09/17/22 15:00	0.5			1.6			14.9		1	0.6			1.6			14.8		1
09/17/22 16:00	0.5			1.5			14.8		1	0.7			1.5			14.7		1
09/17/22 17:00	0.7			1.6			14.6		1	0.8			1.5			14.5		1
09/17/22 18:00	0.6			1.6			14.7		1	0.7			1.6			14.6		1
09/17/22 19:00	0.5			1.6			14.8		1	0.6			1.6			14.7		1
09/17/22 20:00	0.5			1.6			14.8		1	0.7			1.6			14.7		1
09/17/22 21:00	0.7			1.6			14.5		1	0.8			1.5			14.4		1
09/17/22 22:00	0.6			1.6			14.6		1	0.7			1.5			14.5		1
09/17/22 23:00	0.6			1.6			14.7		1	0.7			1.6			14.6		1
09/18/22 0:00	0.6			1.6			14.7		1	0.7			1.6			14.6		1
09/18/22 1:00	0.6			1.6			14.7		1	0.7			1.6			14.6		1
09/18/22 2:00	0.6			1.7			14.7		1	0.7			1.6			14.6		1
09/18/22 3:00	0.6			1.6			14.7		1	0.7			1.6			14.6		1
09/18/22 4:00	0.6			1.6			14.7		1	0.7			1.6			14.7		1
09/18/22 5:00	0.5			1.6			14.8		1	0.7			1.6			14.7		1
09/18/22 6:00	0.6			1.6			14.7		1	0.7			1.6			14.6		1
09/18/22 7:00	0.6			1.6			14.6		1	0.7			1.6			14.6		1
09/18/22 8:00	0.6			1.7			14.7		1	0.7			1.7			14.6		1
09/18/22 9:00	0.6			1.7			14.7		1	0.7			1.7			14.6		1
09/18/22 10:00	0.6			1.6			14.8		1	0.7			1.6			14.7		1
09/18/22 11:00	0.6			1.6			14.7		1	0.7			1.5			14.6		1
09/18/22 12:00	0.6			1.5			14.6		1	0.8			1.4			14.5		1
09/18/22 13:00	0.7			1.6			14.5		1	0.8			1.5			14.4		1
09/18/22 14:00	0.7			1.6			14.5		1	0.8			1.5			14.4		1
09/18/22 15:00	0.6			1.6			14.6		1	0.7			1.6			14.5		1
09/18/22 16:00	0.6			1.6			14.6		1	0.7			1.5			14.5		1
09/18/22 17:00	0.7			1.7			14.4		1	0.8			1.7			14.4		1
09/18/22 18:00	0.7			1.7			14.4		1	0.8			1.7			14.3		1
09/18/22 19:00	0.7			1.7			14.5		1	0.8			1.7			14.4		1
09/18/22 20:00	0.7			1.6			14.5		1	0.8			1.7			14.4		1
09/18/22 21:00	0.7			1.7			14.5		1	0.8			1.7			14.4		1
09/18/22 22:00	0.6			1.6			14.7		1	0.6			1.6			14.6		1
09/18/22 23:00	0.6			1.6			14.7		1	0.7			1.6			14.6		1
09/19/22 0:00	0.6			1.7			14.7		1	0.7			1.7			14.6		1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/19/22 1:00	0.6			1.7			14.6		1	0.7			1.7			14.6		1
09/19/22 2:00	0.6			1.7			14.7		1	0.7			1.6			14.6		1
09/19/22 3:00	0.6			1.5			14.6		1	0.7			1.5			14.6		1
09/19/22 4:00	0.7			1.5			14.5		1	0.8			1.4			14.4		1
09/19/22 5:00	0.7			1.6			14.5		1	0.8			1.6			14.4		1
09/19/22 6:00	0.7			1.6			14.4		1	0.8			1.7			14.3		1
09/19/22 7:00	0.7			1.7			14.5		1	0.8			1.7			14.4		1
09/19/22 8:00	0.7			1.7			14.5		1	0.7			1.6			14.4		1
09/19/22 9:00	0.7			1.6			14.5		1	0.7			1.6			14.4		1
09/19/22 10:00	0.6			1.6			14.7		1	0.6			1.6			14.6		1
09/19/22 11:00	0.6			1.6			14.5		1	0.7			1.5			14.4		1
09/19/22 12:00	0.6			1.6			14.5		1	0.7			1.6			14.4		1
09/19/22 13:00	0.7			1.6			14.5		1	0.7			1.6			14.4		1
09/19/22 14:00	0.6			1.6			14.6		1	0.7			1.5			14.5		1
09/19/22 15:00	0.6			1.7			14.7		1	0.6			1.7			14.6		1
09/19/22 16:00	0.8			1.6			14.3		1	1.2			1.5			14.4		1
09/19/22 17:00	0.4			1.6			12.8		1	1.6			1.6			12.7		1
09/19/22 18:00	0.5			1.6			13.1		1	1.7			1.6			13.1		1
09/19/22 19:00	0.7			1.6			13.4		1	1.5			1.6			13.4		1
09/19/22 20:00	0.9			1.6			13.7		1	1.4			1.6			13.6		1
09/19/22 21:00	1.1			1.6			13.9		1	1.4			1.6			13.9		1
09/19/22 22:00	1.1			1.6			14.3		1	1.3			1.5			14.3		1
09/19/22 23:00	0.7			1.6			14.4		1	0.8			1.5			14.3		1
09/20/22 0:00	0.7			1.6			14.4		1	0.8			1.6			14.3		1
09/20/22 1:00	0.7			1.6			14.5		1	0.7			1.5			14.4		1
09/20/22 2:00	0.6			1.5			14.6		1	0.6			1.6			14.5		1
09/20/22 3:00	0.7			1.7			14.5		1	0.8			1.6			14.4		1
09/20/22 4:00	0.8			1.6			14.5		1	1			1.6			14.4		1
09/20/22 5:00	0.6			1.6			14.5		1	0.7			1.6			14.4		1
09/20/22 6:00	0.7			1.6			14.4		1	0.8			1.6			14.3		1
09/20/22 7:00	0.6			1.6			14.6		1	0.6			1.6			14.5		1
09/20/22 8:00	0.6			1.6			14.6		1	0.6			1.6			14.5		1
09/20/22 9:00	0.6			1.6			14.6		1	0.6			1.6			14.5		1
09/20/22 10:00	0.5			1.6			14.8		1	0.6			1.7			14.7		1
09/20/22 11:00	0.6			1.5			14.6		1	0.7			1.4			14.5		1
09/20/22 12:00	0.6			1.7			14.6		1	0.7			1.6			14.5		1
09/20/22 13:00	0.6			1.7			14.7		1	0.7			1.7			14.6		1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/20/22 14:00	0.6			1.7			14.7		1	0.7			1.6			14.6		1
09/20/22 15:00	0.5			1.6			14.7		1	0.6			1.6			14.6		1
09/20/22 16:00	0.8			1.6			14.4		1	1			1.5			14.3		1
09/20/22 17:00	0.5			1.7			13		1	1.4			1.7			12.9		1
09/20/22 18:00	0.4			1.6			12.8		1	1.4			1.6			12.8		1
09/20/22 19:00	0.5			1.6			13.2		1	1.5			1.6			13.2		1
09/20/22 20:00	0.5			1.6			13.2		1	1.5			1.6			13.1		1
09/20/22 21:00	0.6			1.6			13.2		1	2.9			1.6			13.1		1
09/20/22 22:00	0.9			1.6			13.7		1	2.4			1.6			13.6		1
09/20/22 23:00	1			1.6			14.5		1	1.1			1.6			14.5		1
09/21/22 0:00	1			1.6			14.4		1	1.1			1.6			14.4		1
09/21/22 1:00	0.8			1.6			14.4		1	0.9			1.6			14.3		1
09/21/22 2:00	0.8			1.6			14.4		1	0.9			1.6			14.4		1
09/21/22 3:00	0.7			1.6			14.5		1	0.8			1.6			14.4		1
09/21/22 4:00	0.7			1.6			14.5		1	0.8			1.6			14.4		1
09/21/22 5:00	0.7			1.6			14.5		1	0.8			1.6			14.4		1
09/21/22 6:00	0.7			1.6			14.5		1	0.8			1.5			14.4		1
09/21/22 7:00	0.7			1.6			14.5		1	0.8			1.6			14.4		1
09/21/22 8:00	0.7			1.6			14.5		1	0.8			1.6			14.4		1
09/21/22 9:00	0.7			1.6			14.5		1	0.8			1.6			14.4		1
09/21/22 10:00	0.7			1.6			14.4		1	0.8			1.4			14.3		1
09/21/22 11:00	0.7			1.6			14.4		1	0.8			1.6			14.3		1
09/21/22 12:00	0.6			1.6			14.6		1	0.7			1.5			14.5		1
09/21/22 13:00	0.6			1.6			14.7		1	0.7			1.5			14.6		1
09/21/22 14:00	0.7			1.4			14.5		1	0.8			1.4			14.4		1
09/21/22 15:00	0.6			1.6			14.7		1	0.7			1.6			14.6		1
09/21/22 16:00	0.6			1.5			14.7		1	0.7			1.5			14.6		1
09/21/22 17:00	0.6			1.6			14.5		1	0.7			1.6			14.4		1
09/21/22 18:00	0.7			1.6			14.5		1	0.8			1.6			14.5		1
09/21/22 19:00	0.7			1.6			14.5		1	0.8			1.5			14.4		1
09/21/22 20:00	0.7			1.6			14.5		1	0.8			1.5			14.4		1
09/21/22 21:00	0.6			1.6			14.7		1	0.7			1.6			14.6		1
09/21/22 22:00	0.6			1.6			14.7		1	0.7			1.6			14.6		1
09/21/22 23:00	0.7			1.6			14.7		1	0.7			1.6			14.6		1
09/22/22 0:00	0.6			1.6			14.6		1	0.7			1.6			14.6		1
09/22/22 1:00	0.6			1.6			14.6		1	0.6			1.6			14.5		1
09/22/22 2:00	0.7			1.6			14.6		1	0.7			1.6			14.5		1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/22/22 3:00	0.7			1.6			14.6		1	0.7			1.6			14.5		1
09/22/22 4:00	0.8			1.5			14.5		1	0.8			1.5			14.4		1
09/22/22 5:00	0.8			1.6			14.4		1	0.9			1.6			14.3		1
09/22/22 6:00	0.8			1.5			14.5		1	0.9			1.4			14.4		1
09/22/22 7:00	0.8			1.7			14.3		1	0.9			1.7			14.2		1
09/22/22 8:00	0.8			1.7			14.4		1	0.9			1.6			14.2		1
09/22/22 9:00	0.7			1.6			14.4		1	0.9			1.7			14.2		1
09/22/22 10:00	0.7			1.7			14.4		1	0	X		0	X		0	X	0
09/22/22 11:00	0.7			1.7			14.4		1	0.7			1.7			14.4		1
09/22/22 12:00	0.7			1.6			14.4		1	0.7			1.7			14.4		1
09/22/22 13:00	0.7			1.7			14.4		1	0.6			1.6			14.5		1
09/22/22 14:00	0.5			1.6			14.8		1	0.4			1.6			14.8		1
09/22/22 15:00	0.5			1.7			14.9		1	0.4			1.7			14.8		1
09/22/22 16:00	0.6			1.6			14.7		1	0.5			1.5			14.6		1
09/22/22 17:00	0.6			1.6			14.7		1	0.5			1.6			14.6		1
09/22/22 18:00	0.6			1.6			14.7		1	0.5			1.6			14.6		1
09/22/22 19:00	0.7			1.5			14.5		1	0.6			1.4			14.4		1
09/22/22 20:00	0.7			1.5			14.5		1	0.6			1.4			14.4		1
09/22/22 21:00	0.7			1.6			14.7		1	0.7			1.5			14.4		1
09/22/22 22:00	0	X		0	X		0	X	1	0.6			1.5			14.4		1
09/22/22 23:00	0	X		0	X		0	X	1	0			0			17.2		1
09/23/22 0:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
09/23/22 1:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
09/23/22 2:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
09/23/22 3:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
09/23/22 4:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
09/23/22 5:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
09/23/22 6:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
09/23/22 7:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
09/23/22 8:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
09/23/22 9:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
09/23/22 10:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
09/23/22 11:00	0	X		0	X		0	X	1	0	X		0	X		0	X	1
09/23/22 12:00	0			0			16.9		1	0	X		0	X		0	X	1
09/23/22 13:00	0.7			1.7			14.4		1	0	X		0	X		0	X	1
09/23/22 14:00	0.7			1.6			14.4		1	0	X		0	X		0	X	1
09/23/22 15:00	0.7			1.5			14.6		1	0			0			18.2		1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/23/22 16:00	0.7			1.5			14.5		1	0.6			1.8			14.4		1
09/23/22 17:00	1.1			1.6			13.9		1	2.4			1.7			13.7		1
09/23/22 18:00	1.1			1.6			13.9		1	1.9			1.6			13.9		1
09/23/22 19:00	1.1			1.6			14		1	1.7			1.6			13.9		1
09/23/22 20:00	1			1.6			13.7		1	2.6			1.6			13.7		1
09/23/22 21:00	0.9			1.6			13.5		1	3			1.6			13.5		1
09/23/22 22:00	1			1.6			14.3		1	1.2			1.6			14.3		1
09/23/22 23:00	0.9			1.6			14.4		1	0.9			1.6			14.3		1
09/24/22 0:00	0.8			1.6			14.5		1	0.7			1.6			14.4		1
09/24/22 1:00	0.7			1.6			14.5		1	0.7			1.5			14.4		1
09/24/22 2:00	0.8			1.7			14.4		1	0.8			1.6			14.3		1
09/24/22 3:00	0.9			1.6			14.4		1	0.8			1.6			14.3		1
09/24/22 4:00	1			1.6			14.5		1	0.9			1.6			14.4		1
09/24/22 5:00	0.9			1.6			14.4		1	0.9			1.5			14.4		1
09/24/22 6:00	0.7			1.6			14.7		1	0.7			1.6			14.6		1
09/24/22 7:00	0.7			1.6			14.8		1	0.6			1.6			14.6		1
09/24/22 8:00	0.6			1.6			14.8		1	0.5			1.6			14.7		1
09/24/22 9:00	0.6			1.6			14.9		1	0.5			1.6			14.7		1
09/24/22 10:00	0.5			1.6			14.9		1	0.4			1.6			14.8		1
09/24/22 11:00	0.5			1.6			14.9		1	0.4			1.6			14.8		1
09/24/22 12:00	0.5			1.5			14.8		1	0.4			1.5			14.7		1
09/24/22 13:00	0.6			1.6			14.8		1	0.5			1.5			14.7		1
09/24/22 14:00	0.9			1.5			14.6		1	0.8			1.5			14.5		1
09/24/22 15:00	0.8			1.6			14.5		1	0.9			1.6			14.5		1
09/24/22 16:00	0.9			1.6			14.4		1	0.9			1.5			14.3		1
09/24/22 17:00	0.9			1.6			14.5		1	0.8			1.6			14.5		1
09/24/22 18:00	0.7			1.6			14.5		1	0.7			1.6			14.4		1
09/24/22 19:00	0.7			1.6			14.5		1	0.6			1.6			14.4		1
09/24/22 20:00	0.9			1.6			14.6		1	0.8			1.6			14.5		1
09/24/22 21:00	0.8			1.6			14.5		1	0.7			1.6			14.4		1
09/24/22 22:00	0.7			1.6			14.5		1	0.7			1.6			14.4		1
09/24/22 23:00	0.8			1.6			14.4		1	0.7			1.6			14.4		1
09/25/22 0:00	0.8			1.6			14.4		1	0.8			1.6			14.4		1
09/25/22 1:00	0.8			1.5			14.5		1	0.7			1.5			14.4		1
09/25/22 2:00	0.8			1.7			14.5		1	0.7			1.7			14.4		1
09/25/22 3:00	0.7			1.6			14.6		1	0.6			1.5			14.5		1
09/25/22 4:00	0.7			1.6			14.6		1	0.6			1.5			14.5		1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/25/22 5:00	0.8			1.5			14.5		1	0.7			1.5			14.5		1
09/25/22 6:00	0.7			1.6			14.8		1	0.6			1.6			14.7		1
09/25/22 7:00	0.7			1.6			14.8		1	0.6			1.6			14.7		1
09/25/22 8:00	0.6			1.6			14.8		1	0.5			1.6			14.7		1
09/25/22 9:00	0.6			1.6			14.9		1	0.5			1.6			14.7		1
09/25/22 10:00	0.5			1.6			14.9		1	0.5			1.6			14.8		1
09/25/22 11:00	0.5			1.6			14.9		1	0.4			1.6			14.8		1
09/25/22 12:00	0.5			1.6			14.9		1	0.4			1.6			14.8		1
09/25/22 13:00	0.5			1.6			14.9		1	0.5			1.5			14.8		1
09/25/22 14:00	0.6			1.5			14.7		1	0.5			1.4			14.6		1
09/25/22 15:00	0.6			1.5			14.7		1	0.5			1.4			14.6		1
09/25/22 16:00	0.8			1.5			14.6		1	0.8			1.5			14.5		1
09/25/22 17:00	0.7			1.6			14.6		1	0.6			1.6			14.5		1
09/25/22 18:00	0.6			1.6			14.5		1	0.6			1.6			14.5		1
09/25/22 19:00	0.7			1.6			14.5		1	0.6			1.6			14.4		1
09/25/22 20:00	0.7			1.6			14.5		1	0.6			1.5			14.4		1
09/25/22 21:00	0.7			1.6			14.5		1	0.6			1.6			14.5		1
09/25/22 22:00	0.6			1.6			14.8		1	0.5			1.6			14.6		1
09/25/22 23:00	0.6			1.6			14.7		1	0.5			1.6			14.6		1
09/26/22 0:00	0.6			1.6			14.6		1	0.5			1.6			14.5		1
09/26/22 1:00	0.6			1.6			14.7		1	0.5			1.6			14.6		1
09/26/22 2:00	0.6			1.6			14.7		1	0.5			1.8			14.6		1
09/26/22 3:00	0.7			1.6			14.7		1	0.5			1.6			14.6		1
09/26/22 4:00	0.7			1.6			14.5		1	0.6			1.5			14.4		1
09/26/22 5:00	0.7			1.6			14.5		1	0.6			1.5			14.4		1
09/26/22 6:00	0.6			1.6			14.7		1	0.5			1.6			14.6		1
09/26/22 7:00	0.5			1.6			14.8		1	0.4			1.6			14.7		1
09/26/22 8:00	0.5			1.6			14.8		1	0.4			1.6			14.7		1
09/26/22 9:00	0.5			1.6			14.8		1	0.4			1.6			14.7		1
09/26/22 10:00	0.5			1.6			14.9		1	0.4			1.6			14.8		1
09/26/22 11:00	0.5			1.6			14.9		1	0.4			1.6			14.8		1
09/26/22 12:00	0.6			1.6			14.8		1	0.5			1.6			14.7		1
09/26/22 13:00	0.6			1.6			14.8		1	0.5			1.6			14.7		1
09/26/22 14:00	0.6			1.5			14.7		1	0.6			1.5			14.6		1
09/26/22 15:00	0.6			1.5			14.6		1	0.6			1.3			14.6		1
09/26/22 16:00	0.7			1.5			14.5		1	0.6			1.4			14.4		1
09/26/22 17:00	0.7			1.5			14.5		1	0.6			1.4			14.4		1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/26/22 18:00	0.6			1.6			14.8		1	0.5			1.8			14.7		1
09/26/22 19:00	0.6			1.6			14.8		1	0.5			1.6			14.7		1
09/26/22 20:00	0.6			1.6			14.8		1	0.6			1.6			14.7		1
09/26/22 21:00	0.7			1.6			14.5		1	0.6			1.4			14.5		1
09/26/22 22:00	0.7			1.6			14.6		1	0.6			1.5			14.5		1
09/26/22 23:00	1.1			1.6			13.9		1	2			1.6			13.8		1
09/27/22 0:00	0.9			1.6			13.7		1	2.3			1.6			13.6		1
09/27/22 1:00	1.1			1.6			13.8		1	2.1			1.6			13.8		1
09/27/22 2:00	1.1			1.6			13.9		1	1.9			1.5			13.8		1
09/27/22 3:00	1.2			1.6			14		1	1.6			1.6			13.9		1
09/27/22 4:00	1			1.6			13.7		1	2.4			1.6			13.6		1
09/27/22 5:00	0.7			1.6			13.4		1	3			1.6			13.4		1
09/27/22 6:00	1.1			1.6			13.8		1	1.7			1.6			14		1
09/27/22 7:00	0.8			1.6			14.4		1	1			1.6			14.3		1
09/27/22 8:00	0.4			1.6			14.8		1	0.4			1.6			14.7		1
09/27/22 9:00	0.4			1.6			14.8		1	0.4			1.6			14.7		1
09/27/22 10:00	0.4			1.6			14.8		1	0.4			1.6			14.7		1
09/27/22 11:00	0.9			1.6			14.5		1	1			1.5			14.4		1
09/27/22 12:00	0.7			1.6			13.7		1	2.9			1.6			13.6		1
09/27/22 13:00	1			1.6			14.1		1	1.7			1.6			14		1
09/27/22 14:00	1			1.6			14		1	1.8			1.6			13.9		1
09/27/22 15:00	0.9			1.6			14.2		1	1.5			1.6			14.1		1
09/27/22 16:00	0.5			1.6			14.7		1	0.6			1.5			14.6		1
09/27/22 17:00	0.5			1.5			14.7		1	0.6			1.6			14.6		1
09/27/22 18:00	1			1.6			14.1		1	1.5			1.7			14		1
09/27/22 19:00	1.1			1.6			14.1		1	1.5			1.6			14		1
09/27/22 20:00	1.2			1.6			14.1		1	1.5			1.6			14.1		1
09/27/22 21:00	1.2			1.6			14.1		1	2			1.6			14		1
09/27/22 22:00	1.3			1.6			14.2		1	1.7			1.6			14.1		1
09/27/22 23:00	0.9			1.6			14.5		1	1			1.6			14.4		1
09/28/22 0:00	0.6			1.6			14.5		1	0.6			1.6			14.4		1
09/28/22 1:00	0.6			1.6			14.5		1	0.6			1.6			14.4		1
09/28/22 2:00	0.6			1.8			14.5		1	0.7			1.5			14.4		1
09/28/22 3:00	0.7			1.6			14.5		1	0.7			1.6			14.4		1
09/28/22 4:00	0.6			1.6			14.5		1	0.7			1.6			14.4		1
09/28/22 5:00	0.6			1.6			14.5		1	0.6			1.6			14.4		1
09/28/22 6:00	0.7			1.6			14.5		1	0.7			1.6			14.4		1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/28/22 7:00	0.4			1.6			14.8		1	0.5			1.6			14.7		1
09/28/22 8:00	0.4			1.6			14.8		1	0.4			1.6			14.7		1
09/28/22 9:00	0.4			1.6			14.9		1	0.4			1.6			14.7		1
09/28/22 10:00	0.4			1.6			14.9		1	0.5			1.6			14.8		1
09/28/22 11:00	0.5			1.6			14.8		1	0.5			1.5			14.7		1
09/28/22 12:00	0.5			1.6			14.8		1	0.5			1.6			14.7		1
09/28/22 13:00	0.5			1.6			14.8		1	0.5			1.6			14.8		1
09/28/22 14:00	0.6			1.5			14.7		1	0.6			1.4			14.6		1
09/28/22 15:00	0.5			1.6			14.9		1	0.5			1.2			14.8		1
09/28/22 16:00	0.4			1.6			15		1	0.4			1.6			14.9		1
09/28/22 17:00	0.4			1.6			14.9		1	0.4			1.6			14.9		1
09/28/22 18:00	0.5			1.6			14.8		1	0.5			1.6			14.7		1
09/28/22 19:00	0.5			1.6			14.8		1	0.5			1.6			14.7		1
09/28/22 20:00	0.5			1.6			14.8		1	0.6			1.6			14.7		1
09/28/22 21:00	0.6			1.5			14.5		1	0.6			1.4			14.4		1
09/28/22 22:00	0.6			1.5			14.5		1	0.7			1.5			14.4		1
09/28/22 23:00	0.6			1.6			14.5		1	0.6			1.5			14.4		1
09/29/22 0:00	0.6			1.5			14.5		1	0.6			1.4			14.4		1
09/29/22 1:00	0.6			1.6			14.6		1	0.6			1.4			14.5		1
09/29/22 2:00	0.6			2.1			14.6		1	0.6			2.2			14.5		1
09/29/22 3:00	0.7			1.5			14.4		1	0.7			1.5			14.3		1
09/29/22 4:00	0.6			1.6			14.5		1	0.6			1.5			14.4		1
09/29/22 5:00	0.6			1.6			14.5		1	0.6			1.5			14.4		1
09/29/22 6:00	0.7			1.6			14.5		1	0.7			1.6			14.4		1
09/29/22 7:00	0.7			1.5			14.4		1	0.8			1.4			14.3		1
09/29/22 8:00	0.6			1.6			14.7		1	0.6			1.6			14.6		1
09/29/22 9:00	0.5			1.6			14.8		1	0.5			1.6			14.7		1
09/29/22 10:00	0.4			1.6			14.9		1	0.4			1.6			14.8		1
09/29/22 11:00	0.4			1.6			14.9		1	0.5			1.6			14.8		1
09/29/22 12:00	0.4			1.6			14.9		1	0.5			1.6			14.8		1
09/29/22 13:00	0.5			1.6			14.7		1	0.6			1.4			14.6		1
09/29/22 14:00	0.5			1.6			14.8		1	0.5			1.6			14.7		1
09/29/22 15:00	0.5			1.5			14.8		1	0.5			1.5			14.7		1
09/29/22 16:00	0.8			1.5			14.4		1	1.2			1.3			14.3		1
09/29/22 17:00	1			1.6			13.9		1	2.3			1.5			13.9		1
09/29/22 18:00	1.1			1.6			14		1	2			1.6			13.9		1
09/29/22 19:00	1.1			1.6			14		1	1.9			1.6			14		1

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_O2Dry_Pct_1H			CT2_CO_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT2_O2Dry_Pct_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/29/22 20:00	1			1.6			14.3		1	1.3			1.6			14.2		1
09/29/22 21:00	0.7			1.6			14.7		1	0.7			1.5			14.6		1
09/29/22 22:00	0.6			1.6			14.6		1	0.6			1.5			14.5		1
09/29/22 23:00	0.7			1.6			14.5		1	0.7			1.5			14.4		1
09/30/22 0:00	0.8			1.6			14.4		1	0.8			1.6			14.3		1
09/30/22 1:00	0.8			1.6			14.4		1	0.8			1.6			14.3		1
09/30/22 2:00	0.7			1.3			14.4		1	0.8			1.4			14.3		1
09/30/22 3:00	0.8			1.3			14.4		1	0.8			1.3			14.3		1
09/30/22 4:00	0.8			1.6			14.5		1	0.9			1.6			14.4		1
09/30/22 5:00	0.8			1.5			14.5		1	0.8			1.5			14.4		1
09/30/22 6:00	0.8			1.6			14.5		1	0.9			1.5			14.5		1
09/30/22 7:00	0.6			1.5			14.8		1	0.7			1.5			14.7		1
09/30/22 8:00	0.6			1.5			14.8		1	0.6			1.5			14.7		1
09/30/22 9:00	0.5			1.5			14.8		1	0.5			1.5			14.7		1
09/30/22 10:00	0.5			1.5			14.8		1	0.5			1.5			14.8		1
09/30/22 11:00	0.4			1.5			14.9		1	0.4			1.5			14.8		1
09/30/22 12:00	0.4			1.5			14.9		1	0.4			1.5			14.8		1
09/30/22 13:00	0.4			1.5			14.9		1	0.4			1.5			14.8		1
09/30/22 14:00	0.4			1.5			14.9		1	0.4			1.5			14.8		1
09/30/22 15:00	0.4			1.5			14.9		1	0.4			1.5			14.8		1
09/30/22 16:00	0.6			1.5			14.7		1	0.6			1.3			14.6		1
09/30/22 17:00	0.6			1.5			14.5		1	0.6			1.5			14.4		1
09/30/22 18:00	0.5			1.5			14.7		1	0.5			1.4			14.7		1
09/30/22 19:00	0.5			1.5			14.8		1	0.6			1.5			14.7		1
09/30/22 20:00	0.7			1.5			14.7		1	0.7			1.4			14.6		1
09/30/22 21:00	0.7			1.5			14.5		1	0.7			1.4			14.4		1
09/30/22 22:00	0.6			1.5			14.7		1	0.6			1.5			14.6		1
09/30/22 23:00	0.7			1.5			14.5		1	0.7			1.4			14.4		1

Tons 12 Month Rolling Summary

CT1 and CT2 Combined



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 19:15 Location: Roseville, CA

* = Excess Emission

Date	Units CT1 & CT2		Units CT1 & CT2		Units CT1 & CT2		Units CT1 & CT2		Units CT1 & CT2	
	CO, Ton		NOx, Ton		PM10, Ton		SO2, Ton		VOC, Ton	
	1 Day(s)		1 Day(s)		1 Day(s)		1 Day(s)		1 Day(s)	
	Sum	Rolling Sum	Sum	Rolling Sum	Sum	Rolling Sum	Sum	Rolling Sum	Sum	Rolling Sum
Jul 2022	0.6226	6.7916	1.5269	13.6733	0.3084	2.8936	0.1544	1.4470	0.5141	4.8240
Aug 2022	0.5968	6.7917	1.7288	13.6468	0.3466	2.8593	0.1731	1.4296	0.5774	4.7658
Sep 2022	0.5247	6.7951	1.6900	13.8458	0.3443	2.8831	0.1723	1.4414	0.5740	4.8056
Sum/Avg	6.7951		13.8458		2.8831		1.4414		4.8056	
Limit Value										

ATTACHMENT 5

AQ-33

AQ-33 The Project owner shall maintain records of Sox lb/hr, lb/day, and lb, quarter emissions. Sox emissions shall be based on fuel use records, natural gas sulfur content, and mass balance calculations.

Verification: The Project owner shall submit to the CPM all hourly, daily, and quarterly Sox emissions as part of the Quarterly Air Quality Report required by the Condition of Certification AQ-SC6

AQ33 DAILY SOX

Date/Time	CT1_SO2_Lb_1D			CT2_SO2_Lb_1D														
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/01/22 0:00	5.4			1.6														
07/02/22 0:00	4.8			0														
07/03/22 0:00	4.8			0														
07/04/22 0:00	4.8			0														
07/05/22 0:00	5.3			1.8														
07/06/22 0:00	5.2			1.4														
07/07/22 0:00	5.6			2.4														
07/08/22 0:00	5.3			1														
07/09/22 0:00	4.9			0														
07/10/22 0:00	5.5			2.5														
07/11/22 0:00	6.5			6.6														
07/12/22 0:00	6.3			6.5														
07/13/22 0:00	6.2			6.3														
07/14/22 0:00	5.9			3.1														
07/15/22 0:00	6.4			6.6														
07/16/22 0:00	6.4			6.9														
07/17/22 0:00	6.7			7.6														
07/18/22 0:00	7			7.4														
07/19/22 0:00	6			6.4														
07/20/22 0:00	5.8			6.1														
07/21/22 0:00	5.6			5.6														
07/22/22 0:00	5.4			5.3														
07/23/22 0:00	5.6			1.8														
07/24/22 0:00	5.7			4.2														
07/25/22 0:00	5.6			5.7														
07/26/22 0:00	5.8			6														
07/27/22 0:00	5.8			5.8														
07/28/22 0:00	6.4			6.6														
07/29/22 0:00	6.2			6.2														
07/30/22 0:00	6.8			7														
07/31/22 0:00	6.4			6.6														
08/01/22 0:00	6.7			6.8														
08/02/22 0:00	6.3			6.3														
08/03/22 0:00	6.4			6.4														

Date/Time	CT1_SO2_Lb_1D			CT2_SO2_Lb_1D														
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/04/22 0:00	7.1			7.2														
08/05/22 0:00	6.6			6.6														
08/06/22 0:00	5.1			5.2														
08/07/22 0:00	5.3			5.3														
08/08/22 0:00	6			6.4														
08/09/22 0:00	7			7.3														
08/10/22 0:00	6.4			6.6														
08/11/22 0:00	6.7			7.4														
08/12/22 0:00	6.4			6.6														
08/13/22 0:00	6			6.3														
08/14/22 0:00	5.7			5.7														
08/15/22 0:00	6.1			6.2														
08/16/22 0:00	6.7			7														
08/17/22 0:00	2.2			7														
08/18/22 0:00	0			5.9														
08/19/22 0:00	2.6			5.2														
08/20/22 0:00	3.1			2.6														
08/21/22 0:00	4.3			5.8														
08/22/22 0:00	1.6			6.2														
08/23/22 0:00	0			7.5														
08/24/22 0:00	0			7.4														
08/25/22 0:00	0			7.2														
08/26/22 0:00	5.6			7.7														
08/27/22 0:00	6.7			6.9														
08/28/22 0:00	5.4			5.5														
08/29/22 0:00	5.8			6.3														
08/30/22 0:00	7.3			7.6														
08/31/22 0:00	7.5			7.9														
09/01/22 0:00	7.8			8.1														
09/02/22 0:00	7.4			7.9														
09/03/22 0:00	5.3			5.3														
09/04/22 0:00	5.7			5.7														
09/05/22 0:00	7.2			7.4														
09/06/22 0:00	8.2			8.4														
09/07/22 0:00	8.5			8.6														
09/08/22 0:00	8.7			8.8														
09/09/22 0:00	7.8			8.5														

Date/Time	CT1_SO2_Lb_1D			CT2_SO2_Lb_1D														
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/10/22 0:00	5.1			5.4														
09/11/22 0:00	5.6			6														
09/12/22 0:00	5.5			5.8														
09/13/22 0:00	5.6			5.8														
09/14/22 0:00	4.9			5														
09/15/22 0:00	5			5.1														
09/16/22 0:00	4.8			4.8														
09/17/22 0:00	4.8			4.8														
09/18/22 0:00	5			5.3														
09/19/22 0:00	5.7			6.2														
09/20/22 0:00	5.9			6.2														
09/21/22 0:00	5.5			6														
09/22/22 0:00	4.4			4.7														
09/23/22 0:00	2.8			2.3														
09/24/22 0:00	5.4			6														
09/25/22 0:00	4.9			5.4														
09/26/22 0:00	4.9			4.9														
09/27/22 0:00	6.6			6.7														
09/28/22 0:00	5.4			5.6														
09/29/22 0:00	5.2			5.5														
09/30/22 0:00	4.9			5.3														

AQ33 HOURLY SOX

Date/Time	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H			Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod									
07/01/22 0:00	0.22386			0	X		0.22											
07/01/22 1:00	0.1788			0	X		0.18											
07/01/22 2:00	0.17952			0	X		0.18											
07/01/22 3:00	0.18048			0	X		0.18											
07/01/22 4:00	0.1812			0	X		0.18											
07/01/22 5:00	0.2166			0	X		0.22											
07/01/22 6:00	0.17928			0	X		0.18											
07/01/22 7:00	0.17994			0	X		0.18											
07/01/22 8:00	0.17946			0	X		0.18											
07/01/22 9:00	0.17946			0	X		0.18											
07/01/22 10:00	0.17988			0	X		0.18											
07/01/22 11:00	0.18126			0	X		0.18											
07/01/22 12:00	0.18174			0	X		0.18											
07/01/22 13:00	0.18054			0	X		0.18											
07/01/22 14:00	0.17994			0	X		0.18											
07/01/22 15:00	0.17958			0	X		0.18											
07/01/22 16:00	0.20736			0	X		0.21											
07/01/22 17:00	0.282			0.19296			0.42											
07/01/22 18:00	0.27798			0.29592			0.57											
07/01/22 19:00	0.29826			0.31548			0.61											
07/01/22 20:00	0.2958			0.3156			0.61											
07/01/22 21:00	0.29376			0.3135			0.61											
07/01/22 22:00	0.26286			0.28464			0.55											
07/01/22 23:00	0.18474			0.12738			0.2											
07/02/22 0:00	0.17802			0	X		0.18											
07/02/22 1:00	0.1779			0	X		0.18											
07/02/22 2:00	0.17856			0	X		0.18											
07/02/22 3:00	0.1794			0	X		0.18											
07/02/22 4:00	0.17934			0	X		0.18											
07/02/22 5:00	0.17826			0	X		0.18											
07/02/22 6:00	0.17814			0	X		0.18											
07/02/22 7:00	0.17856			0	X		0.18											
07/02/22 8:00	0.17868			0	X		0.18											
07/02/22 9:00	0.17886			0	X		0.18											

Date/Time	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H			Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod									
07/02/22 10:00	0.17898			0	X		0.18											
07/02/22 11:00	0.18042			0	X		0.18											
07/02/22 12:00	0.18066			0	X		0.18											
07/02/22 13:00	0.18048			0	X		0.18											
07/02/22 14:00	0.18048			0	X		0.18											
07/02/22 15:00	0.18036			0	X		0.18											
07/02/22 16:00	0.1806			0	X		0.18											
07/02/22 17:00	0.1809			0	X		0.18											
07/02/22 18:00	0.18318			0	X		0.18											
07/02/22 19:00	0.17892			0	X		0.18											
07/02/22 20:00	0.1785			0	X		0.18											
07/02/22 21:00	0.17802			0	X		0.18											
07/02/22 22:00	0.17856			0	X		0.18											
07/02/22 23:00	0.1788			0	X		0.18											
07/03/22 0:00	0.17898			0	X		0.18											
07/03/22 1:00	0.17922			0	X		0.18											
07/03/22 2:00	0.18012			0	X		0.18											
07/03/22 3:00	0.17868			0	X		0.18											
07/03/22 4:00	0.17808			0	X		0.18											
07/03/22 5:00	0.17916			0	X		0.18											
07/03/22 6:00	0.17976			0	X		0.18											
07/03/22 7:00	0.18054			0	X		0.18											
07/03/22 8:00	0.17994			0	X		0.18											
07/03/22 9:00	0.18054			0	X		0.18											
07/03/22 10:00	0.18078			0	X		0.18											
07/03/22 11:00	0.17868			0	X		0.18											
07/03/22 12:00	0.1791			0	X		0.18											
07/03/22 13:00	0.17976			0	X		0.18											
07/03/22 14:00	0.17946			0	X		0.18											
07/03/22 15:00	0.17958			0	X		0.18											
07/03/22 16:00	0.17958			0	X		0.18											
07/03/22 17:00	0.17982			0	X		0.18											
07/03/22 18:00	0.17916			0	X		0.18											
07/03/22 19:00	0.17796			0	X		0.18											
07/03/22 20:00	0.17766			0	X		0.18											
07/03/22 21:00	0.17754			0	X		0.18											
07/03/22 22:00	0.17736			0	X		0.18											

	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H											
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/03/22 23:00	0.17844			0	X		0.18											
07/04/22 0:00	0.17874			0	X		0.18											
07/04/22 1:00	0.17844			0	X		0.18											
07/04/22 2:00	0.17718			0	X		0.18											
07/04/22 3:00	0.17814			0	X		0.18											
07/04/22 4:00	0.17934			0	X		0.18											
07/04/22 5:00	0.17808			0	X		0.18											
07/04/22 6:00	0.17772			0	X		0.18											
07/04/22 7:00	0.17814			0	X		0.18											
07/04/22 8:00	0.17868			0	X		0.18											
07/04/22 9:00	0.17922			0	X		0.18											
07/04/22 10:00	0.18006			0	X		0.18											
07/04/22 11:00	0.18072			0	X		0.18											
07/04/22 12:00	0.17958			0	X		0.18											
07/04/22 13:00	0.1797			0	X		0.18											
07/04/22 14:00	0.17982			0	X		0.18											
07/04/22 15:00	0.17958			0	X		0.18											
07/04/22 16:00	0.17934			0	X		0.18											
07/04/22 17:00	0.1788			0	X		0.18											
07/04/22 18:00	0.17832			0	X		0.18											
07/04/22 19:00	0.17802			0	X		0.18											
07/04/22 20:00	0.17808			0	X		0.18											
07/04/22 21:00	0.17796			0	X		0.18											
07/04/22 22:00	0.17802			0	X		0.18											
07/04/22 23:00	0.17856			0	X		0.18											
07/05/22 0:00	0.17964			0	X		0.18											
07/05/22 1:00	0.17964			0	X		0.18											
07/05/22 2:00	0.17934			0	X		0.18											
07/05/22 3:00	0.1791			0	X		0.18											
07/05/22 4:00	0.17868			0	X		0.18											
07/05/22 5:00	0.17862			0	X		0.18											
07/05/22 6:00	0.17898			0	X		0.18											
07/05/22 7:00	0.17898			0	X		0.18											
07/05/22 8:00	0.17934			0	X		0.18											
07/05/22 9:00	0.17934			0	X		0.18											
07/05/22 10:00	0.17952			0	X		0.18											
07/05/22 11:00	0.18054			0	X		0.18											

Date/Time	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H			Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod									
07/05/22 12:00	0.18672			0	X		0.19											
07/05/22 13:00	0.17898			0	X		0.18											
07/05/22 14:00	0.20346			0	X		0.2											
07/05/22 15:00	0.23232			0.16068			0.34											
07/05/22 16:00	0.2757			0.29058			0.57											
07/05/22 17:00	0.3012			0.3162			0.62											
07/05/22 18:00	0.29862			0.3144			0.61											
07/05/22 19:00	0.29688			0.31422			0.61											
07/05/22 20:00	0.2961			0.31356			0.61											
07/05/22 21:00	0.22812			0.23598			0.46											
07/05/22 22:00	0.21906			0.07074			0.22											
07/05/22 23:00	0.20544			0	X		0.21											
07/06/22 0:00	0.17892			0	X		0.18											
07/06/22 1:00	0.17862			0	X		0.18											
07/06/22 2:00	0.17856			0	X		0.18											
07/06/22 3:00	0.17868			0	X		0.18											
07/06/22 4:00	0.17856			0	X		0.18											
07/06/22 5:00	0.17886			0	X		0.18											
07/06/22 6:00	0.17874			0	X		0.18											
07/06/22 7:00	0.17958			0	X		0.18											
07/06/22 8:00	0.1794			0	X		0.18											
07/06/22 9:00	0.17958			0	X		0.18											
07/06/22 10:00	0.17958			0	X		0.18											
07/06/22 11:00	0.17922			0	X		0.18											
07/06/22 12:00	0.17976			0	X		0.18											
07/06/22 13:00	0.18042			0	X		0.18											
07/06/22 14:00	0.1806			0	X		0.18											
07/06/22 15:00	0.18036			0	X		0.18											
07/06/22 16:00	0.20694			0.05118			0.21											
07/06/22 17:00	0.19092			0.19854			0.39											
07/06/22 18:00	0.2718			0.28956			0.56											
07/06/22 19:00	0.29442			0.31266			0.61											
07/06/22 20:00	0.29214			0.31194			0.6											
07/06/22 21:00	0.2544			0.27294			0.53											
07/06/22 22:00	0.19488			0.14502			0.23											
07/06/22 23:00	0.1785			0	X		0.18											
07/07/22 0:00	0.17856			0	X		0.18											

Date/Time	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H			Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod									
07/07/22 1:00	0.17826			0	X		0.18											
07/07/22 2:00	0.17838			0	X		0.18											
07/07/22 3:00	0.17832			0	X		0.18											
07/07/22 4:00	0.17898			0	X		0.18											
07/07/22 5:00	0.17862			0	X		0.18											
07/07/22 6:00	0.1788			0	X		0.18											
07/07/22 7:00	0.17946			0	X		0.18											
07/07/22 8:00	0.17928			0	X		0.18											
07/07/22 9:00	0.17982			0	X		0.18											
07/07/22 10:00	0.18036			0	X		0.18											
07/07/22 11:00	0.1806			0	X		0.18											
07/07/22 12:00	0.18			0	X		0.18											
07/07/22 13:00	0.17994			0	X		0.18											
07/07/22 14:00	0.25812			0.01686			0.26											
07/07/22 15:00	0.20772			0.1905			0.4											
07/07/22 16:00	0.28074			0.29616			0.58											
07/07/22 17:00	0.30786			0.32304			0.63											
07/07/22 18:00	0.31962			0.3351			0.65											
07/07/22 19:00	0.2964			0.31326			0.61											
07/07/22 20:00	0.29442			0.31272			0.61											
07/07/22 21:00	0.29478			0.31356			0.61											
07/07/22 22:00	0.28002			0.30084			0.58											
07/07/22 23:00	0.20478			0.18444			0.3											
07/08/22 0:00	0.17964			0	X		0.18											
07/08/22 1:00	0.17868			0	X		0.18											
07/08/22 2:00	0.17874			0	X		0.18											
07/08/22 3:00	0.17874			0	X		0.18											
07/08/22 4:00	0.24306			0	X		0.24											
07/08/22 5:00	0.2079			0	X		0.21											
07/08/22 6:00	0.1791			0	X		0.18											
07/08/22 7:00	0.17934			0	X		0.18											
07/08/22 8:00	0.1782			0	X		0.18											
07/08/22 9:00	0.17826			0	X		0.18											
07/08/22 10:00	0.17856			0	X		0.18											
07/08/22 11:00	0.17958			0	X		0.18											
07/08/22 12:00	0.17988			0	X		0.18											
07/08/22 13:00	0.207			0	X		0.21											

Date/Time	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H			Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod									
07/08/22 14:00	0.21822			0.1734			0.37											
07/08/22 15:00	0.25644			0.27108			0.53											
07/08/22 16:00	0.22932			0.24132			0.47											
07/08/22 17:00	0.18498			0.19512			0.38											
07/08/22 18:00	0.22548			0.16458			0.31											
07/08/22 19:00	0.24078			0	X		0.24											
07/08/22 20:00	0.28602			0	X		0.29											
07/08/22 21:00	0.28632			0	X		0.29											
07/08/22 22:00	0.28704			0	X		0.29											
07/08/22 23:00	0.2883			0	X		0.29											
07/09/22 0:00	0.28812			0	X		0.29											
07/09/22 1:00	0.1971			0	X		0.2											
07/09/22 2:00	0.17898			0	X		0.18											
07/09/22 3:00	0.17934			0	X		0.18											
07/09/22 4:00	0.19206			0	X		0.19											
07/09/22 5:00	0.1788			0	X		0.18											
07/09/22 6:00	0.17892			0	X		0.18											
07/09/22 7:00	0.17958			0	X		0.18											
07/09/22 8:00	0.17946			0	X		0.18											
07/09/22 9:00	0.17952			0	X		0.18											
07/09/22 10:00	0.18018			0	X		0.18											
07/09/22 11:00	0.18084			0	X		0.18											
07/09/22 12:00	0.1803			0	X		0.18											
07/09/22 13:00	0.18114			0	X		0.18											
07/09/22 14:00	0.17988			0	X		0.18											
07/09/22 15:00	0.17946			0	X		0.18											
07/09/22 16:00	0.20832			0	X		0.21											
07/09/22 17:00	0.17886			0	X		0.18											
07/09/22 18:00	0.17826			0	X		0.18											
07/09/22 19:00	0.17868			0	X		0.18											
07/09/22 20:00	0.1782			0	X		0.18											
07/09/22 21:00	0.17808			0	X		0.18											
07/09/22 22:00	0.17784			0	X		0.18											
07/09/22 23:00	0.17796			0	X		0.18											
07/10/22 0:00	0.1791			0	X		0.18											
07/10/22 1:00	0.17922			0	X		0.18											
07/10/22 2:00	0.17892			0	X		0.18											

Date/Time	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H			Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod									
07/10/22 3:00	0.17892			0	X		0.18											
07/10/22 4:00	0.17886			0	X		0.18											
07/10/22 5:00	0.1788			0	X		0.18											
07/10/22 6:00	0.17892			0	X		0.18											
07/10/22 7:00	0.18012			0	X		0.18											
07/10/22 8:00	0.17958			0	X		0.18											
07/10/22 9:00	0.17814			0	X		0.18											
07/10/22 10:00	0.17988			0	X		0.18											
07/10/22 11:00	0.18024			0	X		0.18											
07/10/22 12:00	0.18006			0	X		0.18											
07/10/22 13:00	0.18054			0	X		0.18											
07/10/22 14:00	0.20694			0.00918			0.21											
07/10/22 15:00	0.22122			0.19392			0.42											
07/10/22 16:00	0.23712			0.24192			0.48											
07/10/22 17:00	0.26052			0.27486			0.54											
07/10/22 18:00	0.27276			0.28644			0.56											
07/10/22 19:00	0.2721			0.28728			0.56											
07/10/22 20:00	0.27066			0.28746			0.56											
07/10/22 21:00	0.25416			0.27102			0.53											
07/10/22 22:00	0.25812			0.27696			0.54											
07/10/22 23:00	0.27054			0.29094			0.56											
07/11/22 0:00	0.27048			0.29136			0.56											
07/11/22 1:00	0.2709			0.29274			0.56											
07/11/22 2:00	0.2709			0.29202			0.56											
07/11/22 3:00	0.27042			0.29232			0.56											
07/11/22 4:00	0.26796			0.28866			0.56											
07/11/22 5:00	0.23646			0.25428			0.49											
07/11/22 6:00	0.1698			0.1809			0.35											
07/11/22 7:00	0.1662			0.17676			0.34											
07/11/22 8:00	0.16578			0.17652			0.34											
07/11/22 9:00	0.16644			0.17688			0.34											
07/11/22 10:00	0.17142			0.18174			0.35											
07/11/22 11:00	0.19824			0.21018			0.41											
07/11/22 12:00	0.29748			0.312			0.61											
07/11/22 13:00	0.31848			0.33246			0.65											
07/11/22 14:00	0.31968			0.33216			0.65											
07/11/22 15:00	0.32178			0.33504			0.66											

Date/Time	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H			Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod									
07/11/22 16:00	0.31854			0.3321			0.65											
07/11/22 17:00	0.3186			0.33204			0.65											
07/11/22 18:00	0.32352			0.33768			0.66											
07/11/22 19:00	0.32124			0.33648			0.66											
07/11/22 20:00	0.31272			0.32766			0.64											
07/11/22 21:00	0.30108			0.31854			0.62											
07/11/22 22:00	0.30456			0.32034			0.62											
07/11/22 23:00	0.29934			0.31854			0.62											
07/12/22 0:00	0.30486			0.32304			0.63											
07/12/22 1:00	0.30282			0.32088			0.62											
07/12/22 2:00	0.29778			0.31728			0.62											
07/12/22 3:00	0.3018			0.32244			0.62											
07/12/22 4:00	0.3105			0.33066			0.64											
07/12/22 5:00	0.28824			0.30882			0.6											
07/12/22 6:00	0.1965			0.21024			0.41											
07/12/22 7:00	0.16734			0.17802			0.35											
07/12/22 8:00	0.16566			0.1764			0.34											
07/12/22 9:00	0.16578			0.17634			0.34											
07/12/22 10:00	0.1698			0.18024			0.35											
07/12/22 11:00	0.17484			0.18444			0.36											
07/12/22 12:00	0.18618			0.19662			0.38											
07/12/22 13:00	0.24258			0.25542			0.5											
07/12/22 14:00	0.31596			0.32994			0.65											
07/12/22 15:00	0.30558			0.31836			0.62											
07/12/22 16:00	0.30894			0.3234			0.63											
07/12/22 17:00	0.31896			0.33282			0.65											
07/12/22 18:00	0.30804			0.32274			0.63											
07/12/22 19:00	0.28836			0.30396			0.59											
07/12/22 20:00	0.26964			0.288			0.56											
07/12/22 21:00	0.30846			0.32604			0.63											
07/12/22 22:00	0.23922			0.25632			0.5											
07/12/22 23:00	0.27354			0.29466			0.57											
07/13/22 0:00	0.27402			0.29568			0.57											
07/13/22 1:00	0.2742			0.29574			0.57											
07/13/22 2:00	0.27396			0.29568			0.57											
07/13/22 3:00	0.27618			0.2979			0.57											
07/13/22 4:00	0.33606			0.3564			0.69											

Date/Time	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H			Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod									
07/13/22 5:00	0.31362			0.33522			0.65											
07/13/22 6:00	0.2661			0.28506			0.55											
07/13/22 7:00	0.16908			0.18036			0.35											
07/13/22 8:00	0.16854			0.18			0.35											
07/13/22 9:00	0.16632			0.17724			0.34											
07/13/22 10:00	0.16632			0.177			0.34											
07/13/22 11:00	0.1668			0.17646			0.34											
07/13/22 12:00	0.16734			0.17652			0.34											
07/13/22 13:00	0.16752			0.17622			0.34											
07/13/22 14:00	0.18096			0.1911			0.37											
07/13/22 15:00	0.29112			0.30594			0.6											
07/13/22 16:00	0.30294			0.318			0.62											
07/13/22 17:00	0.2196			0.23274			0.45											
07/13/22 18:00	0.28872			0.30558			0.59											
07/13/22 19:00	0.30258			0.32016			0.62											
07/13/22 20:00	0.31992			0.3375			0.66											
07/13/22 21:00	0.3051			0.32352			0.63											
07/13/22 22:00	0.29538			0.31452			0.61											
07/13/22 23:00	0.22506			0.23568			0.46											
07/14/22 0:00	0.24672			0.05592			0.25											
07/14/22 1:00	0.21876			0		X	0.22											
07/14/22 2:00	0.20334			0		X	0.2											
07/14/22 3:00	0.21852			0		X	0.22											
07/14/22 4:00	0.24864			0		X	0.25											
07/14/22 5:00	0.25806			0		X	0.26											
07/14/22 6:00	0.21672			0		X	0.22											
07/14/22 7:00	0.19974			0		X	0.2											
07/14/22 8:00	0.1785			0		X	0.18											
07/14/22 9:00	0.17874			0		X	0.18											
07/14/22 10:00	0.1791			0		X	0.18											
07/14/22 11:00	0.1794			0		X	0.18											
07/14/22 12:00	0.20508			0		X	0.21											
07/14/22 13:00	0.21258			0.16068			0.35											
07/14/22 14:00	0.26844			0.26742			0.54											
07/14/22 15:00	0.31188			0.3252			0.64											
07/14/22 16:00	0.309			0.32064			0.63											
07/14/22 17:00	0.31818			0.33144			0.65											

	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H											
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/14/22 18:00	0.31902			0.33306			0.65											
07/14/22 19:00	0.30384			0.31962			0.62											
07/14/22 20:00	0.30228			0.31926			0.62											
07/14/22 21:00	0.2997			0.31752			0.62											
07/14/22 22:00	0.29484			0.31368			0.61											
07/14/22 23:00	0.29484			0.31434			0.61											
07/15/22 0:00	0.2457			0.2649			0.51											
07/15/22 1:00	0.27738			0.29886			0.58											
07/15/22 2:00	0.30834			0.32862			0.64											
07/15/22 3:00	0.291			0.31284			0.6											
07/15/22 4:00	0.29106			0.31236			0.6											
07/15/22 5:00	0.30198			0.32262			0.62											
07/15/22 6:00	0.22908			0.24576			0.47											
07/15/22 7:00	0.16746			0.17856			0.35											
07/15/22 8:00	0.1671			0.17814			0.35											
07/15/22 9:00	0.16722			0.17808			0.35											
07/15/22 10:00	0.17076			0.18174			0.35											
07/15/22 11:00	0.17388			0.18366			0.36											
07/15/22 12:00	0.1758			0.18516			0.36											
07/15/22 13:00	0.22668			0.2406			0.47											
07/15/22 14:00	0.30918			0.32352			0.63											
07/15/22 15:00	0.30888			0.32292			0.63											
07/15/22 16:00	0.30492			0.31884			0.62											
07/15/22 17:00	0.3213			0.33504			0.66											
07/15/22 18:00	0.3531			0.3684			0.72											
07/15/22 19:00	0.3396			0.35496			0.69											
07/15/22 20:00	0.33234			0.34872			0.68											
07/15/22 21:00	0.32898			0.34686			0.68											
07/15/22 22:00	0.33162			0.34992			0.68											
07/15/22 23:00	0.3156			0.3336			0.65											
07/16/22 0:00	0.28482			0.3042			0.59											
07/16/22 1:00	0.24888			0.26814			0.52											
07/16/22 2:00	0.27426			0.29658			0.57											
07/16/22 3:00	0.27546			0.29754			0.57											
07/16/22 4:00	0.27492			0.29736			0.57											
07/16/22 5:00	0.23862			0.25704			0.5											
07/16/22 6:00	0.19698			0.2112			0.41											

Date/Time	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H			Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod									
07/16/22 7:00	0.1665			0.17766			0.34											
07/16/22 8:00	0.16908			0.17988			0.35											
07/16/22 9:00	0.17304			0.18384			0.36											
07/16/22 10:00	0.17598			0.18684			0.36											
07/16/22 11:00	0.17436			0.18402			0.36											
07/16/22 12:00	0.17808			0.18768			0.37											
07/16/22 13:00	0.21894			0.23166			0.45											
07/16/22 14:00	0.27798			0.29922			0.58											
07/16/22 15:00	0.35274			0.36564			0.72											
07/16/22 16:00	0.3126			0.32556			0.64											
07/16/22 17:00	0.32988			0.34308			0.67											
07/16/22 18:00	0.33924			0.35316			0.69											
07/16/22 19:00	0.3126			0.3288			0.64											
07/16/22 20:00	0.34296			0.35934			0.7											
07/16/22 21:00	0.35004			0.36822			0.72											
07/16/22 22:00	0.34662			0.36558			0.71											
07/16/22 23:00	0.32712			0.34506			0.67											
07/17/22 0:00	0.34926			0.36804			0.72											
07/17/22 1:00	0.34332			0.36228			0.71											
07/17/22 2:00	0.34386			0.36342			0.71											
07/17/22 3:00	0.34536			0.3648			0.71											
07/17/22 4:00	0.33588			0.35418			0.69											
07/17/22 5:00	0.27618			0.29694			0.57											
07/17/22 6:00	0.2418			0.2592			0.5											
07/17/22 7:00	0.17388			0.18474			0.36											
07/17/22 8:00	0.19458			0.20742			0.4											
07/17/22 9:00	0.17202			0.18258			0.35											
07/17/22 10:00	0.17292			0.18324			0.36											
07/17/22 11:00	0.23706			0.25014			0.49											
07/17/22 12:00	0.3069			0.32022			0.63											
07/17/22 13:00	0.31848			0.33234			0.65											
07/17/22 14:00	0.3075			0.32154			0.63											
07/17/22 15:00	0.32994			0.34332			0.67											
07/17/22 16:00	0.32808			0.34128			0.67											
07/17/22 17:00	0.32418			0.33786			0.66											
07/17/22 18:00	0.34716			0.3618			0.71											
07/17/22 19:00	0.3444			0.36078			0.71											

Date/Time	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H			Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod									
07/17/22 20:00	0.3522			0.36852			0.72											
07/17/22 21:00	0.31914			0.33816			0.66											
07/17/22 22:00	0.29826			0.31734			0.62											
07/17/22 23:00	0.29742			0.31626			0.61											
07/18/22 0:00	0.29718			0.31506			0.61											
07/18/22 1:00	0.28452			0.30282			0.59											
07/18/22 2:00	0.17358			0.18534			0.36											
07/18/22 3:00	0.16926			0.18078			0.35											
07/18/22 4:00	0.18948			0.20316			0.39											
07/18/22 5:00	0.28746			0.30672			0.59											
07/18/22 6:00	0.297			0.31608			0.61											
07/18/22 7:00	0.22776			0.24192			0.47											
07/18/22 8:00	0.18936			0.2016			0.39											
07/18/22 9:00	0.2907			0.30738			0.6											
07/18/22 10:00	0.3018			0.31788			0.62											
07/18/22 11:00	0.30582			0.3213			0.63											
07/18/22 12:00	0.30906			0.32328			0.63											
07/18/22 13:00	0.33972			0.35346			0.69											
07/18/22 14:00	0.3216			0.33624			0.66											
07/18/22 15:00	0.3546			0.36864			0.72											
07/18/22 16:00	0.3543			0.36888			0.72											
07/18/22 17:00	0.34686			0.36156			0.71											
07/18/22 18:00	0.3528			0.36828			0.72											
07/18/22 19:00	0.34368			0.36042			0.7											
07/18/22 20:00	0.34806			0.36468			0.71											
07/18/22 21:00	0.31746			0.33486			0.65											
07/18/22 22:00	0.29574			0.3159			0.61											
07/18/22 23:00	0.25818			0.27588			0.53											
07/19/22 0:00	0.17208			0.18342			0.36											
07/19/22 1:00	0.17382			0.18558			0.36											
07/19/22 2:00	0.17454			0.18666			0.36											
07/19/22 3:00	0.17508			0.18708			0.36											
07/19/22 4:00	0.17448			0.18642			0.36											
07/19/22 5:00	0.1743			0.1863			0.36											
07/19/22 6:00	0.17034			0.18204			0.35											
07/19/22 7:00	0.16644			0.17748			0.34											
07/19/22 8:00	0.16608			0.17664			0.34											

Date/Time	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H			Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod									
07/19/22 9:00	0.1704			0.18108			0.35											
07/19/22 10:00	0.18732			0.19926			0.39											
07/19/22 11:00	0.2415			0.25542			0.5											
07/19/22 12:00	0.31782			0.33222			0.65											
07/19/22 13:00	0.30774			0.32172			0.63											
07/19/22 14:00	0.30318			0.31722			0.62											
07/19/22 15:00	0.30438			0.31914			0.62											
07/19/22 16:00	0.336			0.3507			0.69											
07/19/22 17:00	0.34404			0.35838			0.7											
07/19/22 18:00	0.3657			0.3807			0.75											
07/19/22 19:00	0.34152			0.35826			0.7											
07/19/22 20:00	0.30084			0.31836			0.62											
07/19/22 21:00	0.30246			0.32142			0.62											
07/19/22 22:00	0.29502			0.31494			0.61											
07/19/22 23:00	0.22434			0.2403			0.46											
07/20/22 0:00	0.16554			0.177			0.34											
07/20/22 1:00	0.1659			0.17736			0.34											
07/20/22 2:00	0.1659			0.17772			0.34											
07/20/22 3:00	0.16608			0.17796			0.34											
07/20/22 4:00	0.1671			0.17922			0.35											
07/20/22 5:00	0.16878			0.18102			0.35											
07/20/22 6:00	0.16896			0.18084			0.35											
07/20/22 7:00	0.17238			0.18384			0.36											
07/20/22 8:00	0.16848			0.17964			0.35											
07/20/22 9:00	0.17196			0.18336			0.36											
07/20/22 10:00	0.17064			0.18126			0.35											
07/20/22 11:00	0.17526			0.18516			0.36											
07/20/22 12:00	0.2463			0.26064			0.51											
07/20/22 13:00	0.31608			0.33018			0.65											
07/20/22 14:00	0.36942			0.38334			0.75											
07/20/22 15:00	0.30954			0.32394			0.63											
07/20/22 16:00	0.31116			0.3258			0.64											
07/20/22 17:00	0.35688			0.37098			0.73											
07/20/22 18:00	0.33786			0.35292			0.69											
07/20/22 19:00	0.3456			0.36186			0.71											
07/20/22 20:00	0.32682			0.34416			0.67											
07/20/22 21:00	0.22446			0.23958			0.46											

Date/Time	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H			Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod									
07/20/22 22:00	0.17394			0.18582			0.36											
07/20/22 23:00	0.16782			0.17922			0.35											
07/21/22 0:00	0.17178			0.18348			0.36											
07/21/22 1:00	0.16962			0.18162			0.35											
07/21/22 2:00	0.16926			0.18168			0.35											
07/21/22 3:00	0.17508			0.18792			0.36											
07/21/22 4:00	0.16848			0.18096			0.35											
07/21/22 5:00	0.1656			0.17808			0.34											
07/21/22 6:00	0.16632			0.1782			0.34											
07/21/22 7:00	0.1668			0.17808			0.34											
07/21/22 8:00	0.1665			0.17778			0.34											
07/21/22 9:00	0.16662			0.17748			0.34											
07/21/22 10:00	0.16698			0.17748			0.34											
07/21/22 11:00	0.1674			0.17682			0.34											
07/21/22 12:00	0.17112			0.1803			0.35											
07/21/22 13:00	0.21048			0.2226			0.43											
07/21/22 14:00	0.30612			0.32076			0.63											
07/21/22 15:00	0.30654			0.3204			0.63											
07/21/22 16:00	0.30612			0.32094			0.63											
07/21/22 17:00	0.31962			0.33396			0.65											
07/21/22 18:00	0.32952			0.34386			0.67											
07/21/22 19:00	0.3033			0.32058			0.62											
07/21/22 20:00	0.30426			0.32232			0.63											
07/21/22 21:00	0.25074			0.26748			0.52											
07/21/22 22:00	0.16734			0.1782			0.35											
07/21/22 23:00	0.17196			0.18324			0.36											
07/22/22 0:00	0.17436			0.1863			0.36											
07/22/22 1:00	0.17406			0.18618			0.36											
07/22/22 2:00	0.19698			0.2118			0.41											
07/22/22 3:00	0.174			0.18618			0.36											
07/22/22 4:00	0.17322			0.18564			0.36											
07/22/22 5:00	0.1725			0.18492			0.36											
07/22/22 6:00	0.16944			0.18126			0.35											
07/22/22 7:00	0.16698			0.17784			0.34											
07/22/22 8:00	0.16638			0.17742			0.34											
07/22/22 9:00	0.16626			0.17694			0.34											
07/22/22 10:00	0.16722			0.17742			0.34											

Date/Time	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H			Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod									
07/22/22 11:00	0.16722			0.1764			0.34											
07/22/22 12:00	0.1674			0.17622			0.34											
07/22/22 13:00	0.17016			0.1788			0.35											
07/22/22 14:00	0.21264			0.22422			0.44											
07/22/22 15:00	0.30528			0.3195			0.62											
07/22/22 16:00	0.30414			0.3195			0.62											
07/22/22 17:00	0.30402			0.3189			0.62											
07/22/22 18:00	0.30342			0.31806			0.62											
07/22/22 19:00	0.30066			0.31848			0.62											
07/22/22 20:00	0.2985			0.31812			0.62											
07/22/22 21:00	0.23304			0.24948			0.48											
07/22/22 22:00	0.177			0.189			0.37											
07/22/22 23:00	0.2019			0.16794			0.29											
07/23/22 0:00	0.19884			0		X	0.2											
07/23/22 1:00	0.18372			0		X	0.18											
07/23/22 2:00	0.2055			0		X	0.21											
07/23/22 3:00	0.1794			0		X	0.18											
07/23/22 4:00	0.18288			0		X	0.18											
07/23/22 5:00	0.19038			0		X	0.19											
07/23/22 6:00	0.28284			0		X	0.28											
07/23/22 7:00	0.29076			0		X	0.29											
07/23/22 8:00	0.28938			0		X	0.29											
07/23/22 9:00	0.22632			0		X	0.23											
07/23/22 10:00	0.17874			0		X	0.18											
07/23/22 11:00	0.17946			0		X	0.18											
07/23/22 12:00	0.17976			0		X	0.18											
07/23/22 13:00	0.18006			0		X	0.18											
07/23/22 14:00	0.1806			0		X	0.18											
07/23/22 15:00	0.19962			0		X	0.2											
07/23/22 16:00	0.20244			0.16626			0.36											
07/23/22 17:00	0.2247			0.23646			0.46											
07/23/22 18:00	0.33786			0.35178			0.69											
07/23/22 19:00	0.32346			0.3396			0.66											
07/23/22 20:00	0.30198			0.31794			0.62											
07/23/22 21:00	0.25722			0.27456			0.53											
07/23/22 22:00	0.2043			0.15774			0.26											
07/23/22 23:00	0.2793			0		X	0.28											

Date/Time	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H								
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/24/22 0:00	0.27186			0	X		0.27								
07/24/22 1:00	0.27228			0	X		0.27								
07/24/22 2:00	0.2751			0	X		0.28								
07/24/22 3:00	0.27678			0	X		0.28								
07/24/22 4:00	0.27486			0	X		0.27								
07/24/22 5:00	0.20742			0.16002			0.35								
07/24/22 6:00	0.17262			0.18516			0.36								
07/24/22 7:00	0.17304			0.18492			0.36								
07/24/22 8:00	0.16896			0.18048			0.35								
07/24/22 9:00	0.16668			0.17766			0.34								
07/24/22 10:00	0.1671			0.17754			0.34								
07/24/22 11:00	0.16776			0.17742			0.35								
07/24/22 12:00	0.1677			0.17658			0.34								
07/24/22 13:00	0.1677			0.17616			0.34								
07/24/22 14:00	0.1683			0.17676			0.35								
07/24/22 15:00	0.16716			0.17598			0.34								
07/24/22 16:00	0.23712			0.2502			0.49								
07/24/22 17:00	0.30774			0.32154			0.63								
07/24/22 18:00	0.30702			0.32166			0.63								
07/24/22 19:00	0.30276			0.3192			0.62								
07/24/22 20:00	0.2571			0.27312			0.53								
07/24/22 21:00	0.16764			0.17892			0.35								
07/24/22 22:00	0.16662			0.17772			0.34								
07/24/22 23:00	0.1725			0.1845			0.36								
07/25/22 0:00	0.1689			0.18102			0.35								
07/25/22 1:00	0.16608			0.17802			0.34								
07/25/22 2:00	0.16602			0.17808			0.34								
07/25/22 3:00	0.16572			0.17802			0.34								
07/25/22 4:00	0.17196			0.18462			0.36								
07/25/22 5:00	0.17376			0.18666			0.36								
07/25/22 6:00	0.17334			0.18588			0.36								
07/25/22 7:00	0.17364			0.18576			0.36								
07/25/22 8:00	0.16698			0.1785			0.35								
07/25/22 9:00	0.1659			0.17724			0.34								
07/25/22 10:00	0.16554			0.17634			0.34								
07/25/22 11:00	0.17244			0.1827			0.36								
07/25/22 12:00	0.174			0.1839			0.36								

Date/Time	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H			Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod									
07/25/22 13:00	0.24048			0.2538			0.49											
07/25/22 14:00	0.31068			0.32352			0.63											
07/25/22 15:00	0.31434			0.32826			0.64											
07/25/22 16:00	0.32178			0.336			0.66											
07/25/22 17:00	0.3288			0.34362			0.67											
07/25/22 18:00	0.33234			0.34836			0.68											
07/25/22 19:00	0.30918			0.327			0.64											
07/25/22 20:00	0.30144			0.31872			0.62											
07/25/22 21:00	0.30036			0.31878			0.62											
07/25/22 22:00	0.22728			0.24378			0.47											
07/25/22 23:00	0.2043			0.21912			0.42											
07/26/22 0:00	0.17394			0.18594			0.36											
07/26/22 1:00	0.17346			0.1857			0.36											
07/26/22 2:00	0.1737			0.18582			0.36											
07/26/22 3:00	0.17328			0.18558			0.36											
07/26/22 4:00	0.2424			0.26064			0.5											
07/26/22 5:00	0.29238			0.31476			0.61											
07/26/22 6:00	0.19968			0.2142			0.41											
07/26/22 7:00	0.1752			0.18708			0.36											
07/26/22 8:00	0.16968			0.1815			0.35											
07/26/22 9:00	0.16902			0.18036			0.35											
07/26/22 10:00	0.17346			0.18504			0.36											
07/26/22 11:00	0.16944			0.1809			0.35											
07/26/22 12:00	0.1785			0.18942			0.37											
07/26/22 13:00	0.2451			0.25938			0.5											
07/26/22 14:00	0.30468			0.31914			0.62											
07/26/22 15:00	0.30606			0.32028			0.63											
07/26/22 16:00	0.31668			0.33084			0.65											
07/26/22 17:00	0.33336			0.34818			0.68											
07/26/22 18:00	0.32136			0.33672			0.66											
07/26/22 19:00	0.30594			0.32202			0.63											
07/26/22 20:00	0.30186			0.32016			0.62											
07/26/22 21:00	0.29904			0.31818			0.62											
07/26/22 22:00	0.2973			0.31638			0.61											
07/26/22 23:00	0.22842			0.24462			0.47											
07/27/22 0:00	0.1749			0.18702			0.36											
07/27/22 1:00	0.1752			0.18756			0.36											

	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H											
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/27/22 2:00	0.17484			0.1742			0.36											
07/27/22 3:00	0.17496			0.18732			0.36											
07/27/22 4:00	0.1746			0.18732			0.36											
07/27/22 5:00	0.18276			0.19632			0.38											
07/27/22 6:00	0.19434			0.2088			0.4											
07/27/22 7:00	0.17868			0.1908			0.37											
07/27/22 8:00	0.17484			0.18672			0.36											
07/27/22 9:00	0.16896			0.18024			0.35											
07/27/22 10:00	0.17412			0.18534			0.36											
07/27/22 11:00	0.17508			0.18534			0.36											
07/27/22 12:00	0.1728			0.18234			0.36											
07/27/22 13:00	0.27552			0.29046			0.57											
07/27/22 14:00	0.3078			0.32094			0.63											
07/27/22 15:00	0.30942			0.32346			0.63											
07/27/22 16:00	0.31104			0.32508			0.64											
07/27/22 17:00	0.3525			0.36666			0.72											
07/27/22 18:00	0.3054			0.32166			0.63											
07/27/22 19:00	0.30318			0.32034			0.62											
07/27/22 20:00	0.30102			0.31896			0.62											
07/27/22 21:00	0.26568			0.28362			0.55											
07/27/22 22:00	0.21564			0.23046			0.45											
07/27/22 23:00	0.20988			0.22488			0.43											
07/28/22 0:00	0.20112			0.21588			0.42											
07/28/22 1:00	0.18126			0.19434			0.38											
07/28/22 2:00	0.17532			0.18792			0.36											
07/28/22 3:00	0.24378			0.26196			0.51											
07/28/22 4:00	0.2946			0.31548			0.61											
07/28/22 5:00	0.26124			0.28062			0.54											
07/28/22 6:00	0.23124			0.24918			0.48											
07/28/22 7:00	0.22368			0.24			0.46											
07/28/22 8:00	0.17412			0.18582			0.36											
07/28/22 9:00	0.17706			0.18894			0.37											
07/28/22 10:00	0.26016			0.2787			0.54											
07/28/22 11:00	0.30888			0.32346			0.63											
07/28/22 12:00	0.30648			0.32154			0.63											
07/28/22 13:00	0.31008			0.32406			0.63											
07/28/22 14:00	0.33492			0.34848			0.68											

Date/Time	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H			Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod									
07/28/22 15:00	0.30834			0.3225			0.63											
07/28/22 16:00	0.31206			0.3261			0.64											
07/28/22 17:00	0.34626			0.36018			0.71											
07/28/22 18:00	0.3549			0.36978			0.72											
07/28/22 19:00	0.31848			0.33528			0.65											
07/28/22 20:00	0.31374			0.33174			0.65											
07/28/22 21:00	0.29946			0.31764			0.62											
07/28/22 22:00	0.25668			0.2742			0.53											
07/28/22 23:00	0.17676			0.18876			0.37											
07/29/22 0:00	0.17106			0.18288			0.35											
07/29/22 1:00	0.17028			0.1824			0.35											
07/29/22 2:00	0.17304			0.18534			0.36											
07/29/22 3:00	0.17394			0.1866			0.36											
07/29/22 4:00	0.27156			0.29178			0.56											
07/29/22 5:00	0.29358			0.31452			0.61											
07/29/22 6:00	0.2139			0.22998			0.44											
07/29/22 7:00	0.17544			0.18726			0.36											
07/29/22 8:00	0.17514			0.1869			0.36											
07/29/22 9:00	0.1752			0.18678			0.36											
07/29/22 10:00	0.17538			0.18654			0.36											
07/29/22 11:00	0.19272			0.20484			0.4											
07/29/22 12:00	0.29772			0.31308			0.61											
07/29/22 13:00	0.30936			0.3234			0.63											
07/29/22 14:00	0.31992			0.33396			0.65											
07/29/22 15:00	0.3096			0.324			0.63											
07/29/22 16:00	0.31068			0.32484			0.64											
07/29/22 17:00	0.31824			0.33222			0.65											
07/29/22 18:00	0.30738			0.32232			0.63											
07/29/22 19:00	0.30438			0.3207			0.63											
07/29/22 20:00	0.30228			0.3198			0.62											
07/29/22 21:00	0.30582			0.32424			0.63											
07/29/22 22:00	0.29868			0.31746			0.62											
07/29/22 23:00	0.30378			0.32322			0.63											
07/30/22 0:00	0.29472			0.31458			0.61											
07/30/22 1:00	0.29298			0.31338			0.61											
07/30/22 2:00	0.2427			0.26166			0.5											
07/30/22 3:00	0.25362			0.27354			0.53											

	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H											
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/30/22 4:00	0.28788			0.30876			0.6											
07/30/22 5:00	0.29916			0.31974			0.62											
07/30/22 6:00	0.26988			0.29016			0.56											
07/30/22 7:00	0.18768			0.20034			0.39											
07/30/22 8:00	0.17424			0.18588			0.36											
07/30/22 9:00	0.1689			0.18012			0.35											
07/30/22 10:00	0.16824			0.17898			0.35											
07/30/22 11:00	0.21198			0.22458			0.44											
07/30/22 12:00	0.30696			0.32148			0.63											
07/30/22 13:00	0.30906			0.32262			0.63											
07/30/22 14:00	0.34368			0.35718			0.7											
07/30/22 15:00	0.3828			0.3963			0.78											
07/30/22 16:00	0.37008			0.38346			0.75											
07/30/22 17:00	0.33126			0.34524			0.68											
07/30/22 18:00	0.30588			0.32148			0.63											
07/30/22 19:00	0.3039			0.31992			0.62											
07/30/22 20:00	0.30042			0.31758			0.62											
07/30/22 21:00	0.31074			0.32868			0.64											
07/30/22 22:00	0.29916			0.31788			0.62											
07/30/22 23:00	0.29718			0.31608			0.61											
07/31/22 0:00	0.29658			0.31626			0.61											
07/31/22 1:00	0.2961			0.31542			0.61											
07/31/22 2:00	0.29532			0.315			0.61											
07/31/22 3:00	0.25578			0.2742			0.53											
07/31/22 4:00	0.16914			0.18108			0.35											
07/31/22 5:00	0.2196			0.23586			0.46											
07/31/22 6:00	0.23196			0.2487			0.48											
07/31/22 7:00	0.17286			0.18474			0.36											
07/31/22 8:00	0.16584			0.17736			0.34											
07/31/22 9:00	0.17208			0.18354			0.36											
07/31/22 10:00	0.23748			0.25362			0.49											
07/31/22 11:00	0.29712			0.31428			0.61											
07/31/22 12:00	0.29718			0.31404			0.61											
07/31/22 13:00	0.29832			0.31464			0.61											
07/31/22 14:00	0.32028			0.33504			0.66											
07/31/22 15:00	0.3135			0.32832			0.64											
07/31/22 16:00	0.32274			0.33768			0.66											

Date/Time	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H			Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod									
07/31/22 17:00	0.34488			0.35982			0.7											
07/31/22 18:00	0.30222			0.3183			0.62											
07/31/22 19:00	0.29862			0.3156			0.61											
07/31/22 20:00	0.3			0.31776			0.62											
07/31/22 21:00	0.30426			0.32226			0.63											
07/31/22 22:00	0.25818			0.27528			0.53											
07/31/22 23:00	0.17682			0.18906			0.37											
08/01/22 0:00	0.228			0.24486			0.47											
08/01/22 1:00	0.17286			0.18486			0.36											
08/01/22 2:00	0.1731			0.18534			0.36											
08/01/22 3:00	0.23202			0.24894			0.48											
08/01/22 4:00	0.29322			0.3129			0.61											
08/01/22 5:00	0.318			0.33786			0.66											
08/01/22 6:00	0.34182			0.36108			0.7											
08/01/22 7:00	0.29304			0.31254			0.61											
08/01/22 8:00	0.29484			0.31314			0.61											
08/01/22 9:00	0.2988			0.31584			0.61											
08/01/22 10:00	0.29694			0.31458			0.61											
08/01/22 11:00	0.29802			0.31494			0.61											
08/01/22 12:00	0.29778			0.31476			0.61											
08/01/22 13:00	0.29844			0.31506			0.61											
08/01/22 14:00	0.29898			0.3153			0.61											
08/01/22 15:00	0.30114			0.31692			0.62											
08/01/22 16:00	0.30006			0.31572			0.62											
08/01/22 17:00	0.2994			0.31566			0.62											
08/01/22 18:00	0.29904			0.31554			0.61											
08/01/22 19:00	0.29874			0.31506			0.61											
08/01/22 20:00	0.30168			0.31818			0.62											
08/01/22 21:00	0.30198			0.31872			0.62											
08/01/22 22:00	0.26166			0.27888			0.54											
08/01/22 23:00	0.17412			0.18594			0.36											
08/02/22 0:00	0.17148			0.18324			0.35											
08/02/22 1:00	0.16866			0.18042			0.35											
08/02/22 2:00	0.1656			0.1773			0.34											
08/02/22 3:00	0.1725			0.1845			0.36											
08/02/22 4:00	0.23268			0.24906			0.48											
08/02/22 5:00	0.29694			0.31536			0.61											

Date/Time	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H			Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod									
08/02/22 6:00	0.22572			0.2412			0.47											
08/02/22 7:00	0.16572			0.17664			0.34											
08/02/22 8:00	0.16578			0.17652			0.34											
08/02/22 9:00	0.1659			0.17622			0.34											
08/02/22 10:00	0.16584			0.17598			0.34											
08/02/22 11:00	0.22824			0.24222			0.47											
08/02/22 12:00	0.3105			0.32382			0.63											
08/02/22 13:00	0.31212			0.32556			0.64											
08/02/22 14:00	0.30918			0.32196			0.63											
08/02/22 15:00	0.30996			0.32346			0.63											
08/02/22 16:00	0.35034			0.36372			0.71											
08/02/22 17:00	0.37482			0.38808			0.76											
08/02/22 18:00	0.31842			0.3324			0.65											
08/02/22 19:00	0.3015			0.31716			0.62											
08/02/22 20:00	0.30558			0.32232			0.63											
08/02/22 21:00	0.297			0.31512			0.61											
08/02/22 22:00	0.29736			0.31554			0.61											
08/02/22 23:00	0.29712			0.31542			0.61											
08/03/22 0:00	0.19878			0.21252			0.41											
08/03/22 1:00	0.17334			0.18516			0.36											
08/03/22 2:00	0.17304			0.18492			0.36											
08/03/22 3:00	0.1725			0.1845			0.36											
08/03/22 4:00	0.23184			0.24786			0.48											
08/03/22 5:00	0.29268			0.31134			0.6											
08/03/22 6:00	0.20922			0.22362			0.43											
08/03/22 7:00	0.16914			0.17982			0.35											
08/03/22 8:00	0.17316			0.18432			0.36											
08/03/22 9:00	0.16824			0.17898			0.35											
08/03/22 10:00	0.1665			0.17676			0.34											
08/03/22 11:00	0.17916			0.18942			0.37											
08/03/22 12:00	0.20442			0.216			0.42											
08/03/22 13:00	0.29334			0.30678			0.6											
08/03/22 14:00	0.31422			0.32718			0.64											
08/03/22 15:00	0.30846			0.32184			0.63											
08/03/22 16:00	0.3111			0.32424			0.64											
08/03/22 17:00	0.3846			0.39606			0.78											
08/03/22 18:00	0.38538			0.39834			0.78											

Date/Time	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H			Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod									
08/03/22 19:00	0.38118			0.3954			0.78											
08/03/22 20:00	0.3534			0.369			0.72											
08/03/22 21:00	0.30216			0.31968			0.62											
08/03/22 22:00	0.2979			0.31608			0.61											
08/03/22 23:00	0.29874			0.31704			0.62											
08/04/22 0:00	0.29694			0.31458			0.61											
08/04/22 1:00	0.29598			0.31416			0.61											
08/04/22 2:00	0.28074			0.29928			0.58											
08/04/22 3:00	0.17508			0.18684			0.36											
08/04/22 4:00	0.22518			0.24114			0.47											
08/04/22 5:00	0.29562			0.3141			0.61											
08/04/22 6:00	0.27276			0.29124			0.56											
08/04/22 7:00	0.22884			0.24468			0.47											
08/04/22 8:00	0.23256			0.24762			0.48											
08/04/22 9:00	0.2979			0.3147			0.61											
08/04/22 10:00	0.29922			0.3153			0.61											
08/04/22 11:00	0.30348			0.31782			0.62											
08/04/22 12:00	0.3138			0.32772			0.64											
08/04/22 13:00	0.33594			0.34926			0.69											
08/04/22 14:00	0.38808			0.40002			0.79											
08/04/22 15:00	0.38058			0.39342			0.77											
08/04/22 16:00	0.3756			0.38916			0.76											
08/04/22 17:00	0.3666			0.38016			0.75											
08/04/22 18:00	0.3408			0.3558			0.7											
08/04/22 19:00	0.32184			0.33846			0.66											
08/04/22 20:00	0.29982			0.31752			0.62											
08/04/22 21:00	0.29586			0.31386			0.61											
08/04/22 22:00	0.29406			0.31296			0.61											
08/04/22 23:00	0.22698			0.2433			0.47											
08/05/22 0:00	0.1869			0.19974			0.39											
08/05/22 1:00	0.17538			0.18726			0.36											
08/05/22 2:00	0.19212			0.20586			0.4											
08/05/22 3:00	0.17304			0.18498			0.36											
08/05/22 4:00	0.20502			0.22014			0.43											
08/05/22 5:00	0.2913			0.31098			0.6											
08/05/22 6:00	0.2961			0.31578			0.61											
08/05/22 7:00	0.29172			0.31116			0.6											

Date/Time	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H			Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod									
08/05/22 8:00	0.29238			0.31092			0.6											
08/05/22 9:00	0.29328			0.31146			0.6											
08/05/22 10:00	0.29448			0.31212			0.61											
08/05/22 11:00	0.29784			0.31368			0.61											
08/05/22 12:00	0.29922			0.31446			0.61											
08/05/22 13:00	0.29868			0.31434			0.61											
08/05/22 14:00	0.30066			0.31542			0.62											
08/05/22 15:00	0.30078			0.31596			0.62											
08/05/22 16:00	0.3006			0.3162			0.62											
08/05/22 17:00	0.3018			0.31698			0.62											
08/05/22 18:00	0.3012			0.31674			0.62											
08/05/22 19:00	0.2997			0.31602			0.62											
08/05/22 20:00	0.29772			0.31494			0.61											
08/05/22 21:00	0.29634			0.31404			0.61											
08/05/22 22:00	0.2553			0.27282			0.53											
08/05/22 23:00	0.17106			0.18276			0.35											
08/06/22 0:00	0.17112			0.183			0.35											
08/06/22 1:00	0.16926			0.18126			0.35											
08/06/22 2:00	0.1656			0.1776			0.34											
08/06/22 3:00	0.16542			0.17748			0.34											
08/06/22 4:00	0.16578			0.17796			0.34											
08/06/22 5:00	0.16944			0.18186			0.35											
08/06/22 6:00	0.16758			0.1794			0.35											
08/06/22 7:00	0.16626			0.1773			0.34											
08/06/22 8:00	0.16572			0.1773			0.34											
08/06/22 9:00	0.16566			0.17706			0.34											
08/06/22 10:00	0.1659			0.17694			0.34											
08/06/22 11:00	0.1665			0.17652			0.34											
08/06/22 12:00	0.16668			0.17604			0.34											
08/06/22 13:00	0.16674			0.17568			0.34											
08/06/22 14:00	0.16872			0.1776			0.35											
08/06/22 15:00	0.16704			0.17622			0.34											
08/06/22 16:00	0.16974			0.17928			0.35											
08/06/22 17:00	0.17652			0.18666			0.36											
08/06/22 18:00	0.24414			0.26184			0.51											
08/06/22 19:00	0.25176			0.26982			0.52											
08/06/22 20:00	0.2943			0.31926			0.61											

Date/Time	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H			Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod									
08/06/22 21:00	0.25362			0.2733			0.53											
08/06/22 22:00	0.17058			0.18228			0.35											
08/06/22 23:00	0.17172			0.18372			0.36											
08/07/22 0:00	0.1683			0.18024			0.35											
08/07/22 1:00	0.17316			0.18534			0.36											
08/07/22 2:00	0.16902			0.18132			0.35											
08/07/22 3:00	0.16542			0.17766			0.34											
08/07/22 4:00	0.17136			0.1839			0.36											
08/07/22 5:00	0.17112			0.18384			0.35											
08/07/22 6:00	0.16842			0.1803			0.35											
08/07/22 7:00	0.16656			0.1779			0.34											
08/07/22 8:00	0.1659			0.17748			0.34											
08/07/22 9:00	0.16554			0.17688			0.34											
08/07/22 10:00	0.16548			0.17622			0.34											
08/07/22 11:00	0.16614			0.17592			0.34											
08/07/22 12:00	0.16644			0.1758			0.34											
08/07/22 13:00	0.16734			0.17628			0.34											
08/07/22 14:00	0.17022			0.17922			0.35											
08/07/22 15:00	0.1683			0.17748			0.35											
08/07/22 16:00	0.19452			0.2064			0.4											
08/07/22 17:00	0.27336			0.28866			0.56											
08/07/22 18:00	0.2982			0.3138			0.61											
08/07/22 19:00	0.29592			0.31284			0.61											
08/07/22 20:00	0.29328			0.31164			0.6											
08/07/22 21:00	0.29262			0.31218			0.6											
08/07/22 22:00	0.22572			0.24192			0.47											
08/07/22 23:00	0.17304			0.1851			0.36											
08/08/22 0:00	0.17472			0.1872			0.36											
08/08/22 1:00	0.17304			0.18528			0.36											
08/08/22 2:00	0.17274			0.18516			0.36											
08/08/22 3:00	0.1728			0.1854			0.36											
08/08/22 4:00	0.24132			0.26016			0.5											
08/08/22 5:00	0.29214			0.31266			0.6											
08/08/22 6:00	0.22554			0.2415			0.47											
08/08/22 7:00	0.1695			0.18108			0.35											
08/08/22 8:00	0.1677			0.17922			0.35											
08/08/22 9:00	0.1701			0.18156			0.35											

Date/Time	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H			Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod									
08/08/22 10:00	0.17286			0.18396			0.36											
08/08/22 11:00	0.23952			0.25338			0.49											
08/08/22 12:00	0.30336			0.31776			0.62											
08/08/22 13:00	0.20274			0.21384			0.42											
08/08/22 14:00	0.2319			0.24576			0.48											
08/08/22 15:00	0.30036			0.31494			0.62											
08/08/22 16:00	0.30228			0.31704			0.62											
08/08/22 17:00	0.32526			0.3399			0.67											
08/08/22 18:00	0.33504			0.35088			0.69											
08/08/22 19:00	0.35052			0.36732			0.72											
08/08/22 20:00	0.34332			0.36108			0.7											
08/08/22 21:00	0.30552			0.324			0.63											
08/08/22 22:00	0.29736			0.3162			0.61											
08/08/22 23:00	0.2922			0.31158			0.6											
08/09/22 0:00	0.29244			0.31194			0.6											
08/09/22 1:00	0.29196			0.31152			0.6											
08/09/22 2:00	0.29226			0.31176			0.6											
08/09/22 3:00	0.29226			0.3117			0.6											
08/09/22 4:00	0.29184			0.31212			0.6											
08/09/22 5:00	0.29178			0.31158			0.6											
08/09/22 6:00	0.2919			0.31104			0.6											
08/09/22 7:00	0.29208			0.31152			0.6											
08/09/22 8:00	0.29328			0.31224			0.61											
08/09/22 9:00	0.2946			0.3132			0.61											
08/09/22 10:00	0.2958			0.31344			0.61											
08/09/22 11:00	0.29784			0.31398			0.61											
08/09/22 12:00	0.28584			0.30216			0.59											
08/09/22 13:00	0.17904			0.1887			0.37											
08/09/22 14:00	0.23676			0.25002			0.49											
08/09/22 15:00	0.2997			0.31434			0.61											
08/09/22 16:00	0.2985			0.3135			0.61											
08/09/22 17:00	0.2997			0.31512			0.61											
08/09/22 18:00	0.34032			0.35664			0.7											
08/09/22 19:00	0.31704			0.33462			0.65											
08/09/22 20:00	0.3414			0.35988			0.7											
08/09/22 21:00	0.32184			0.3408			0.66											
08/09/22 22:00	0.31104			0.33066			0.64											

Date/Time	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H			Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod									
08/09/22 23:00	0.28686			0.30714			0.59											
08/10/22 0:00	0.25758			0.27786			0.54											
08/10/22 1:00	0.26448			0.28512			0.55											
08/10/22 2:00	0.26652			0.2871			0.55											
08/10/22 3:00	0.27954			0.30054			0.58											
08/10/22 4:00	0.32286			0.3432			0.67											
08/10/22 5:00	0.30912			0.32952			0.64											
08/10/22 6:00	0.22614			0.24228			0.47											
08/10/22 7:00	0.17136			0.18282			0.35											
08/10/22 8:00	0.17208			0.18396			0.36											
08/10/22 9:00	0.17088			0.18258			0.35											
08/10/22 10:00	0.1737			0.18498			0.36											
08/10/22 11:00	0.18804			0.19986			0.39											
08/10/22 12:00	0.17352			0.18342			0.36											
08/10/22 13:00	0.19098			0.20208			0.39											
08/10/22 14:00	0.28044			0.29538			0.58											
08/10/22 15:00	0.32208			0.3363			0.66											
08/10/22 16:00	0.29784			0.31254			0.61											
08/10/22 17:00	0.30654			0.32178			0.63											
08/10/22 18:00	0.34944			0.36426			0.71											
08/10/22 19:00	0.342			0.3582			0.7											
08/10/22 20:00	0.3243			0.3414			0.67											
08/10/22 21:00	0.3105			0.3291			0.64											
08/10/22 22:00	0.26802			0.28722			0.56											
08/10/22 23:00	0.25782			0.27768			0.54											
08/11/22 0:00	0.2595			0.27966			0.54											
08/11/22 1:00	0.25692			0.27678			0.53											
08/11/22 2:00	0.24324			0.26202			0.51											
08/11/22 3:00	0.252			0.27198			0.52											
08/11/22 4:00	0.25836			0.279			0.54											
08/11/22 5:00	0.26412			0.28536			0.55											
08/11/22 6:00	0.21822			0.234			0.45											
08/11/22 7:00	0.19506			0.20862			0.4											
08/11/22 8:00	0.17298			0.18468			0.36											
08/11/22 9:00	0.1728			0.18438			0.36											
08/11/22 10:00	0.17298			0.18414			0.36											
08/11/22 11:00	0.23532			0.25092			0.49											

Date/Time	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H			Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod									
08/11/22 12:00	0.25134			0.26718			0.52											
08/11/22 13:00	0.3393			0.35316			0.69											
08/11/22 14:00	0.31884			0.33264			0.65											
08/11/22 15:00	0.33666			0.35082			0.69											
08/11/22 16:00	0.3354			0.34998			0.69											
08/11/22 17:00	0.34194			0.35622			0.7											
08/11/22 18:00	0.35382			0.36882			0.72											
08/11/22 19:00	0.34062			0.357			0.7											
08/11/22 20:00	0.35934			0.37674			0.74											
08/11/22 21:00	0.2889			0.30852			0.6											
08/11/22 22:00	0.25866			0.27786			0.54											
08/11/22 23:00	0.25956			0.2799			0.54											
08/12/22 0:00	0.27336			0.29454			0.57											
08/12/22 1:00	0.26868			0.28962			0.56											
08/12/22 2:00	0.2484			0.26784			0.52											
08/12/22 3:00	0.25872			0.27918			0.54											
08/12/22 4:00	0.2694			0.291			0.56											
08/12/22 5:00	0.2685			0.29004			0.56											
08/12/22 6:00	0.20202			0.21654			0.42											
08/12/22 7:00	0.1971			0.21084			0.41											
08/12/22 8:00	0.16932			0.1809			0.35											
08/12/22 9:00	0.1695			0.18078			0.35											
08/12/22 10:00	0.17244			0.18354			0.36											
08/12/22 11:00	0.17148			0.18162			0.35											
08/12/22 12:00	0.20532			0.21762			0.42											
08/12/22 13:00	0.29754			0.31752			0.62											
08/12/22 14:00	0.30624			0.31998			0.63											
08/12/22 15:00	0.30432			0.31842			0.62											
08/12/22 16:00	0.3033			0.31818			0.62											
08/12/22 17:00	0.34122			0.3555			0.7											
08/12/22 18:00	0.35934			0.37392			0.73											
08/12/22 19:00	0.33006			0.34662			0.68											
08/12/22 20:00	0.31914			0.33672			0.66											
08/12/22 21:00	0.28872			0.30864			0.6											
08/12/22 22:00	0.22656			0.24366			0.47											
08/12/22 23:00	0.25506			0.27468			0.53											
08/13/22 0:00	0.2499			0.26958			0.52											

Date/Time	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H			Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod									
08/13/22 1:00	0.25212			0.27186			0.52											
08/13/22 2:00	0.25272			0.27264			0.53											
08/13/22 3:00	0.25722			0.27762			0.53											
08/13/22 4:00	0.26496			0.28596			0.55											
08/13/22 5:00	0.26262			0.28314			0.55											
08/13/22 6:00	0.20658			0.22158			0.43											
08/13/22 7:00	0.16968			0.1812			0.35											
08/13/22 8:00	0.16914			0.18096			0.35											
08/13/22 9:00	0.17244			0.18414			0.36											
08/13/22 10:00	0.17124			0.18228			0.35											
08/13/22 11:00	0.17328			0.18342			0.36											
08/13/22 12:00	0.20052			0.213			0.41											
08/13/22 13:00	0.23928			0.25236			0.49											
08/13/22 14:00	0.3			0.31422			0.61											
08/13/22 15:00	0.30078			0.31458			0.62											
08/13/22 16:00	0.30264			0.3168			0.62											
08/13/22 17:00	0.33036			0.34434			0.67											
08/13/22 18:00	0.31884			0.33342			0.65											
08/13/22 19:00	0.29844			0.31482			0.61											
08/13/22 20:00	0.26838			0.28608			0.55											
08/13/22 21:00	0.1833			0.19584			0.38											
08/13/22 22:00	0.20334			0.2178			0.42											
08/13/22 23:00	0.24372			0.26256			0.51											
08/14/22 0:00	0.21324			0.22932			0.44											
08/14/22 1:00	0.22314			0.24024			0.46											
08/14/22 2:00	0.22902			0.24702			0.48											
08/14/22 3:00	0.22836			0.24624			0.47											
08/14/22 4:00	0.21912			0.23616			0.46											
08/14/22 5:00	0.20364			0.21936			0.42											
08/14/22 6:00	0.28098			0.30024			0.58											
08/14/22 7:00	0.28188			0.30036			0.58											
08/14/22 8:00	0.1773			0.18936			0.37											
08/14/22 9:00	0.1722			0.1839			0.36											
08/14/22 10:00	0.22614			0.24132			0.47											
08/14/22 11:00	0.30546			0.3204			0.63											
08/14/22 12:00	0.32628			0.34002			0.67											
08/14/22 13:00	0.30546			0.3186			0.62											

Date/Time	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H			Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod									
08/14/22 14:00	0.201			0.21204			0.41											
08/14/22 15:00	0.20778			0.22062			0.43											
08/14/22 16:00	0.20556			0.21852			0.42											
08/14/22 17:00	0.26358			0.27966			0.54											
08/14/22 18:00	0.30132			0.31524			0.62											
08/14/22 19:00	0.30018			0.31542			0.62											
08/14/22 20:00	0.25692			0.273			0.53											
08/14/22 21:00	0.17712			0.18864			0.37											
08/14/22 22:00	0.17082			0.1821			0.35											
08/14/22 23:00	0.17298			0.1845			0.36											
08/15/22 0:00	0.17202			0.18348			0.36											
08/15/22 1:00	0.17148			0.18336			0.35											
08/15/22 2:00	0.17118			0.18342			0.35											
08/15/22 3:00	0.18174			0.19524			0.38											
08/15/22 4:00	0.204			0.21978			0.42											
08/15/22 5:00	0.231			0.24912			0.48											
08/15/22 6:00	0.18642			0.19944			0.39											
08/15/22 7:00	0.16824			0.1794			0.35											
08/15/22 8:00	0.1653			0.17634			0.34											
08/15/22 9:00	0.16956			0.18072			0.35											
08/15/22 10:00	0.18324			0.19536			0.38											
08/15/22 11:00	0.17328			0.183			0.36											
08/15/22 12:00	0.18768			0.19836			0.39											
08/15/22 13:00	0.28572			0.30066			0.59											
08/15/22 14:00	0.35772			0.3705			0.73											
08/15/22 15:00	0.36084			0.3744			0.74											
08/15/22 16:00	0.3651			0.37914			0.74											
08/15/22 17:00	0.3657			0.37932			0.75											
08/15/22 18:00	0.36234			0.37668			0.74											
08/15/22 19:00	0.34008			0.35592			0.7											
08/15/22 20:00	0.2922			0.30936			0.6											
08/15/22 21:00	0.23208			0.24918			0.48											
08/15/22 22:00	0.19692			0.2109			0.41											
08/15/22 23:00	0.22506			0.24168			0.47											
08/16/22 0:00	0.22758			0.24462			0.47											
08/16/22 1:00	0.21342			0.22944			0.44											
08/16/22 2:00	0.2073			0.2226			0.43											

Date/Time	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H			Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod									
08/16/22 3:00	0.20148			0.21636			0.42											
08/16/22 4:00	0.21672			0.23346			0.45											
08/16/22 5:00	0.24786			0.26742			0.52											
08/16/22 6:00	0.19674			0.21072			0.41											
08/16/22 7:00	0.16758			0.1788			0.35											
08/16/22 8:00	0.16938			0.18054			0.35											
08/16/22 9:00	0.1881			0.20106			0.39											
08/16/22 10:00	0.21156			0.22644			0.44											
08/16/22 11:00	0.2319			0.24546			0.48											
08/16/22 12:00	0.24474			0.25854			0.5											
08/16/22 13:00	0.37344			0.38544			0.76											
08/16/22 14:00	0.39312			0.4038			0.8											
08/16/22 15:00	0.39528			0.40536			0.8											
08/16/22 16:00	0.39396			0.40482			0.8											
08/16/22 17:00	0.39396			0.40494			0.8											
08/16/22 18:00	0.39426			0.4053			0.8											
08/16/22 19:00	0.37632			0.38964			0.77											
08/16/22 20:00	0.3645			0.37962			0.74											
08/16/22 21:00	0.33558			0.35112			0.69											
08/16/22 22:00	0.30486			0.3231			0.63											
08/16/22 23:00	0.26088			0.28146			0.54											
08/17/22 0:00	0.2646			0.28404			0.55											
08/17/22 1:00	0.2535			0.27258			0.53											
08/17/22 2:00	0.25842			0.27804			0.54											
08/17/22 3:00	0.25452			0.27354			0.53											
08/17/22 4:00	0.2562			0.27606			0.53											
08/17/22 5:00	0.26772			0.2889			0.56											
08/17/22 6:00	0.2679			0.2886			0.56											
08/17/22 7:00	0.2481			0.2394			0.33											
08/17/22 8:00	0	X		0.30096			0.3											
08/17/22 9:00	0	X		0.29406			0.29											
08/17/22 10:00	0	X		0.2895			0.29											
08/17/22 11:00	0	X		0.28968			0.29											
08/17/22 12:00	0	X		0.28794			0.29											
08/17/22 13:00	0	X		0.2862			0.29											
08/17/22 14:00	0	X		0.28536			0.29											
08/17/22 15:00	0	X		0.28488			0.28											

Date/Time	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H			Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod									
08/17/22 16:00	0	X		0.28542			0.29											
08/17/22 17:00	0	X		0.28656			0.29											
08/17/22 18:00	0	X		0.28662			0.29											
08/17/22 19:00	0	X		0.28662			0.29											
08/17/22 20:00	0	X		0.28674			0.29											
08/17/22 21:00	0	X		0.2865			0.29											
08/17/22 22:00	0	X		0.28626			0.29											
08/17/22 23:00	0	X		0.1953			0.2											
08/18/22 0:00	0	X		0.19134			0.19											
08/18/22 1:00	0	X		0.1911			0.19											
08/18/22 2:00	0	X		0.19104			0.19											
08/18/22 3:00	0	X		0.19104			0.19											
08/18/22 4:00	0	X		0.1917			0.19											
08/18/22 5:00	0	X		0.19206			0.19											
08/18/22 6:00	0	X		0.19146			0.19											
08/18/22 7:00	0	X		0.18414			0.18											
08/18/22 8:00	0	X		0.18258			0.18											
08/18/22 9:00	0	X		0.18288			0.18											
08/18/22 10:00	0	X		0.1827			0.18											
08/18/22 11:00	0	X		0.18264			0.18											
08/18/22 12:00	0	X		0.18534			0.19											
08/18/22 13:00	0	X		0.24492			0.24											
08/18/22 14:00	0	X		0.31194			0.31											
08/18/22 15:00	0	X		0.3435			0.34											
08/18/22 16:00	0	X		0.33516			0.34											
08/18/22 17:00	0	X		0.35394			0.35											
08/18/22 18:00	0	X		0.31224			0.31											
08/18/22 19:00	0	X		0.30744			0.31											
08/18/22 20:00	0	X		0.30588			0.31											
08/18/22 21:00	0	X		0.3054			0.31											
08/18/22 22:00	0	X		0.3042			0.3											
08/18/22 23:00	0	X		0.30228			0.3											
08/19/22 0:00	0	X		0.29844			0.3											
08/19/22 1:00	0	X		0.3003			0.3											
08/19/22 2:00	0	X		0.29916			0.3											
08/19/22 3:00	0	X		0.29826			0.3											
08/19/22 4:00	0	X		0.29808			0.3											

Date/Time	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H			Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod									
08/19/22 5:00	0	X		0.2982			0.3											
08/19/22 6:00	0	X		0.30528			0.31											
08/19/22 7:00	0	X		0.3033			0.3											
08/19/22 8:00	0	X		0.22602			0.23											
08/19/22 9:00	0	X		0.183			0.18											
08/19/22 10:00	0	X		0.19746			0.2											
08/19/22 11:00	0.16992			0.22974			0.39											
08/19/22 12:00	0.1785			0.18846			0.37											
08/19/22 13:00	0.1662			0.1746			0.34											
08/19/22 14:00	0.17598			0.1854			0.36											
08/19/22 15:00	0.1791			0.189			0.37											
08/19/22 16:00	0.17544			0.18528			0.36											
08/19/22 17:00	0.2424			0.25902			0.5											
08/19/22 18:00	0.24462			0.2616			0.51											
08/19/22 19:00	0.22608			0.24186			0.47											
08/19/22 20:00	0.20754			0.22164			0.43											
08/19/22 21:00	0.18768			0.09936			0.2											
08/19/22 22:00	0.17808			0	X		0.18											
08/19/22 23:00	0.18036			0	X		0.18											
08/20/22 0:00	0.18072			0	X		0.18											
08/20/22 1:00	0.17946			0	X		0.18											
08/20/22 2:00	0.17838			0	X		0.18											
08/20/22 3:00	0.17256			0	X		0.17											
08/20/22 4:00	0.1713			0	X		0.17											
08/20/22 5:00	0.17118			0	X		0.17											
08/20/22 6:00	0.1713			0	X		0.17											
08/20/22 7:00	0.17184			0	X		0.17											
08/20/22 8:00	0.17208			0	X		0.17											
08/20/22 9:00	0.17208			0	X		0.17											
08/20/22 10:00	0.17208			0	X		0.17											
08/20/22 11:00	0.17142			0	X		0.17											
08/20/22 12:00	0.17058			0	X		0.17											
08/20/22 13:00	0.17082			0	X		0.17											
08/20/22 14:00	0.19842			0	X		0.2											
08/20/22 15:00	0.25098			0.20952			0.28											
08/20/22 16:00	0	X		0.27954			0.28											
08/20/22 17:00	0	X		0.28314			0.28											

Date/Time	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H			Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod									
08/20/22 18:00	0	X		0.31848			0.32											
08/20/22 19:00	0	X		0.31302			0.31											
08/20/22 20:00	0	X		0.31182			0.31											
08/20/22 21:00	0	X		0.31518			0.32											
08/20/22 22:00	0	X		0.3162			0.32											
08/20/22 23:00	0	X		0.31596			0.32											
08/21/22 0:00	0	X		0.31494			0.31											
08/21/22 1:00	0	X		0.31386			0.31											
08/21/22 2:00	0	X		0.31254			0.31											
08/21/22 3:00	0	X		0.23298			0.23											
08/21/22 4:00	0	X		0.18348			0.18											
08/21/22 5:00	0	X		0.21414			0.21											
08/21/22 6:00	0	X		0.19998			0.2											
08/21/22 7:00	0	X		0.19848			0.2											
08/21/22 8:00	0.15414			0.23694			0.36											
08/21/22 9:00	0.16836			0.17916			0.35											
08/21/22 10:00	0.18576			0.19812			0.38											
08/21/22 11:00	0.22608			0.23922			0.47											
08/21/22 12:00	0.27384			0.28536			0.56											
08/21/22 13:00	0.27288			0.2853			0.56											
08/21/22 14:00	0.27282			0.25926			0.53											
08/21/22 15:00	0.27252			0.2313			0.5											
08/21/22 16:00	0.2718			0.21054			0.48											
08/21/22 17:00	0.3234			0.33504			0.66											
08/21/22 18:00	0.32178			0.33702			0.66											
08/21/22 19:00	0.29328			0.30624			0.6											
08/21/22 20:00	0.2742			0.25116			0.53											
08/21/22 21:00	0.27534			0.24438			0.52											
08/21/22 22:00	0.27654			0.23322			0.51											
08/21/22 23:00	0.276			0.23874			0.51											
08/22/22 0:00	0.27606			0.20166			0.48											
08/22/22 1:00	0.27588			0.18594			0.46											
08/22/22 2:00	0.27582			0.1779			0.45											
08/22/22 3:00	0.27588			0.1869			0.46											
08/22/22 4:00	0.27564			0.2136			0.49											
08/22/22 5:00	0.2739			0.29172			0.44											
08/22/22 6:00	0	X		0.29598			0.3											

Date/Time	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H			Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod									
08/22/22 7:00	0	X		0.29772			0.3											
08/22/22 8:00	0	X		0.29634			0.3											
08/22/22 9:00	0	X		0.1887			0.19											
08/22/22 10:00	0	X		0.18174			0.18											
08/22/22 11:00	0	X		0.1815			0.18											
08/22/22 12:00	0	X		0.18144			0.18											
08/22/22 13:00	0	X		0.18132			0.18											
08/22/22 14:00	0	X		0.18126			0.18											
08/22/22 15:00	0	X		0.24594			0.25											
08/22/22 16:00	0	X		0.32004			0.32											
08/22/22 17:00	0	X		0.35976			0.36											
08/22/22 18:00	0	X		0.39438			0.39											
08/22/22 19:00	0	X		0.34314			0.34											
08/22/22 20:00	0	X		0.31308			0.31											
08/22/22 21:00	0	X		0.30726			0.31											
08/22/22 22:00	0	X		0.30768			0.31											
08/22/22 23:00	0	X		0.30468			0.3											
08/23/22 0:00	0	X		0.3099			0.31											
08/23/22 1:00	0	X		0.30606			0.31											
08/23/22 2:00	0	X		0.3039			0.3											
08/23/22 3:00	0	X		0.31482			0.31											
08/23/22 4:00	0	X		0.30792			0.31											
08/23/22 5:00	0	X		0.34332			0.34											
08/23/22 6:00	0	X		0.30534			0.31											
08/23/22 7:00	0	X		0.30492			0.3											
08/23/22 8:00	0	X		0.30708			0.31											
08/23/22 9:00	0	X		0.30702			0.31											
08/23/22 10:00	0	X		0.30702			0.31											
08/23/22 11:00	0	X		0.31848			0.32											
08/23/22 12:00	0	X		0.32346			0.32											
08/23/22 13:00	0	X		0.31596			0.32											
08/23/22 14:00	0	X		0.33534			0.34											
08/23/22 15:00	0	X		0.31488			0.31											
08/23/22 16:00	0	X		0.33552			0.34											
08/23/22 17:00	0	X		0.4014			0.4											
08/23/22 18:00	0	X		0.36			0.36											
08/23/22 19:00	0	X		0.34284			0.34											

Date/Time	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H			Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod									
08/23/22 20:00	0	X		0.36504			0.37											
08/23/22 21:00	0	X		0.32694			0.33											
08/23/22 22:00	0	X		0.306			0.31											
08/23/22 23:00	0	X		0.30558			0.31											
08/24/22 0:00	0	X		0.30822			0.31											
08/24/22 1:00	0	X		0.30708			0.31											
08/24/22 2:00	0	X		0.30624			0.31											
08/24/22 3:00	0	X		0.30468			0.3											
08/24/22 4:00	0	X		0.30384			0.3											
08/24/22 5:00	0	X		0.30264			0.3											
08/24/22 6:00	0	X		0.30306			0.3											
08/24/22 7:00	0	X		0.30504			0.31											
08/24/22 8:00	0	X		0.30642			0.31											
08/24/22 9:00	0	X		0.30516			0.31											
08/24/22 10:00	0	X		0.3066			0.31											
08/24/22 11:00	0	X		0.30852			0.31											
08/24/22 12:00	0	X		0.31392			0.31											
08/24/22 13:00	0	X		0.31404			0.31											
08/24/22 14:00	0	X		0.3864			0.39											
08/24/22 15:00	0	X		0.32844			0.33											
08/24/22 16:00	0	X		0.34548			0.35											
08/24/22 17:00	0	X		0.38148			0.38											
08/24/22 18:00	0	X		0.32064			0.32											
08/24/22 19:00	0	X		0.30732			0.31											
08/24/22 20:00	0	X		0.3087			0.31											
08/24/22 21:00	0	X		0.30546			0.31											
08/24/22 22:00	0	X		0.30306			0.3											
08/24/22 23:00	0	X		0.30522			0.31											
08/25/22 0:00	0	X		0.30372			0.3											
08/25/22 1:00	0	X		0.3042			0.3											
08/25/22 2:00	0	X		0.30402			0.3											
08/25/22 3:00	0	X		0.30366			0.3											
08/25/22 4:00	0	X		0.3			0.3											
08/25/22 5:00	0	X		0.29748			0.3											
08/25/22 6:00	0	X		0.29778			0.3											
08/25/22 7:00	0	X		0.30138			0.3											
08/25/22 8:00	0	X		0.30552			0.31											

Date/Time	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H			Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod									
08/25/22 9:00	0	X		0.30708			0.31											
08/25/22 10:00	0	X		0.30972			0.31											
08/25/22 11:00	0	X		0.31182			0.31											
08/25/22 12:00	0	X		0.31164			0.31											
08/25/22 13:00	0	X		0.30684			0.31											
08/25/22 14:00	0	X		0.3063			0.31											
08/25/22 15:00	0	X		0.31086			0.31											
08/25/22 16:00	0	X		0.30672			0.31											
08/25/22 17:00	0	X		0.30678			0.31											
08/25/22 18:00	0	X		0.30618			0.31											
08/25/22 19:00	0	X		0.30684			0.31											
08/25/22 20:00	0	X		0.3069			0.31											
08/25/22 21:00	0	X		0.30546			0.31											
08/25/22 22:00	0	X		0.30384			0.3											
08/25/22 23:00	0	X		0.30264			0.3											
08/26/22 0:00	0	X		0.30036			0.3											
08/26/22 1:00	0	X		0.2967			0.3											
08/26/22 2:00	0	X		0.29706			0.3											
08/26/22 3:00	0	X		0.29742			0.3											
08/26/22 4:00	0	X		0.2979			0.3											
08/26/22 5:00	0.10722			0.29916			0.33											
08/26/22 6:00	0.2496			0.18156			0.43											
08/26/22 7:00	0.16644			0.17904			0.35											
08/26/22 8:00	0.16914			0.18042			0.35											
08/26/22 9:00	0.23586			0.25362			0.49											
08/26/22 10:00	0.21822			0.23406			0.45											
08/26/22 11:00	0.23946			0.25518			0.49											
08/26/22 12:00	0.31434			0.32916			0.64											
08/26/22 13:00	0.35916			0.37428			0.73											
08/26/22 14:00	0.3696			0.38442			0.75											
08/26/22 15:00	0.35952			0.37416			0.73											
08/26/22 16:00	0.36732			0.38196			0.75											
08/26/22 17:00	0.39024			0.40488			0.8											
08/26/22 18:00	0.37194			0.38682			0.76											
08/26/22 19:00	0.3777			0.3936			0.77											
08/26/22 20:00	0.35466			0.37152			0.73											
08/26/22 21:00	0.34164			0.35922			0.7											

Date/Time	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H			Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod									
08/26/22 22:00	0.28638			0.30528			0.59											
08/26/22 23:00	0.25818			0.27786			0.54											
08/27/22 0:00	0.25866			0.27828			0.54											
08/27/22 1:00	0.2574			0.27708			0.53											
08/27/22 2:00	0.25818			0.27804			0.54											
08/27/22 3:00	0.2583			0.27804			0.54											
08/27/22 4:00	0.2604			0.28044			0.54											
08/27/22 5:00	0.26022			0.28044			0.54											
08/27/22 6:00	0.1896			0.20274			0.39											
08/27/22 7:00	0.16374			0.17466			0.34											
08/27/22 8:00	0.16368			0.17484			0.34											
08/27/22 9:00	0.165			0.17592			0.34											
08/27/22 10:00	0.19908			0.21294			0.41											
08/27/22 11:00	0.24594			0.26238			0.51											
08/27/22 12:00	0.29964			0.31464			0.61											
08/27/22 13:00	0.30144			0.31644			0.62											
08/27/22 14:00	0.30018			0.31482			0.62											
08/27/22 15:00	0.29958			0.31428			0.61											
08/27/22 16:00	0.31896			0.33372			0.65											
08/27/22 17:00	0.35148			0.36618			0.72											
08/27/22 18:00	0.36672			0.38136			0.75											
08/27/22 19:00	0.35898			0.3753			0.73											
08/27/22 20:00	0.3471			0.36438			0.71											
08/27/22 21:00	0.28884			0.30792			0.6											
08/27/22 22:00	0.19248			0.20604			0.4											
08/27/22 23:00	0.20964			0.22512			0.43											
08/28/22 0:00	0.17196			0.18384			0.36											
08/28/22 1:00	0.17166			0.1839			0.36											
08/28/22 2:00	0.17064			0.1827			0.35											
08/28/22 3:00	0.17232			0.18456			0.36											
08/28/22 4:00	0.171			0.18324			0.35											
08/28/22 5:00	0.17388			0.18642			0.36											
08/28/22 6:00	0.16692			0.17856			0.35											
08/28/22 7:00	0.16428			0.17574			0.34											
08/28/22 8:00	0.16428			0.17574			0.34											
08/28/22 9:00	0.16452			0.1758			0.34											
08/28/22 10:00	0.16512			0.17574			0.34											

Date/Time	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H			Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod									
08/28/22 11:00	0.16638			0.17634			0.34											
08/28/22 12:00	0.21072			0.22476			0.44											
08/28/22 13:00	0.21726			0.23226			0.45											
08/28/22 14:00	0.24384			0.26112			0.5											
08/28/22 15:00	0.19218			0.20406			0.4											
08/28/22 16:00	0.26406			0.28002			0.54											
08/28/22 17:00	0.37992			0.39282			0.77											
08/28/22 18:00	0.31344			0.32946			0.64											
08/28/22 19:00	0.2931			0.31056			0.6											
08/28/22 20:00	0.25602			0.27294			0.53											
08/28/22 21:00	0.21372			0.22914			0.44											
08/28/22 22:00	0.17502			0.18702			0.36											
08/28/22 23:00	0.23064			0.24852			0.48											
08/29/22 0:00	0.22722			0.24462			0.47											
08/29/22 1:00	0.23034			0.24804			0.48											
08/29/22 2:00	0.24084			0.25926			0.5											
08/29/22 3:00	0.22848			0.24606			0.47											
08/29/22 4:00	0.2421			0.261			0.5											
08/29/22 5:00	0.25878			0.27894			0.54											
08/29/22 6:00	0.19578			0.20976			0.41											
08/29/22 7:00	0.16824			0.17964			0.35											
08/29/22 8:00	0.16476			0.1761			0.34											
08/29/22 9:00	0.1713			0.18252			0.35											
08/29/22 10:00	0.16998			0.1809			0.35											
08/29/22 11:00	0.17298			0.18324			0.36											
08/29/22 12:00	0.1722			0.18216			0.35											
08/29/22 13:00	0.20316			0.21654			0.42											
08/29/22 14:00	0.24342			0.25938			0.5											
08/29/22 15:00	0.31212			0.32634			0.64											
08/29/22 16:00	0.3219			0.33576			0.66											
08/29/22 17:00	0.3597			0.37332			0.73											
08/29/22 18:00	0.34662			0.36132			0.71											
08/29/22 19:00	0.33168			0.34752			0.68											
08/29/22 20:00	0.31908			0.3363			0.66											
08/29/22 21:00	0.29148			0.30996			0.6											
08/29/22 22:00	0.24576			0.26448			0.51											
08/29/22 23:00	0.27036			0.28968			0.56											

Date/Time	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H			Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod									
08/30/22 0:00	0.26346			0.28308			0.55											
08/30/22 1:00	0.25194			0.2712			0.52											
08/30/22 2:00	0.25008			0.26898			0.52											
08/30/22 3:00	0.2493			0.2685			0.52											
08/30/22 4:00	0.26214			0.28176			0.54											
08/30/22 5:00	0.27438			0.2946			0.57											
08/30/22 6:00	0.18582			0.1986			0.38											
08/30/22 7:00	0.16584			0.17694			0.34											
08/30/22 8:00	0.1887			0.20214			0.39											
08/30/22 9:00	0.2112			0.22632			0.44											
08/30/22 10:00	0.24288			0.2613			0.5											
08/30/22 11:00	0.26478			0.28434			0.55											
08/30/22 12:00	0.26214			0.27954			0.54											
08/30/22 13:00	0.2685			0.28494			0.55											
08/30/22 14:00	0.36522			0.3789			0.74											
08/30/22 15:00	0.37662			0.38964			0.77											
08/30/22 16:00	0.37296			0.38574			0.76											
08/30/22 17:00	0.39276			0.40458			0.8											
08/30/22 18:00	0.39402			0.40776			0.8											
08/30/22 19:00	0.38634			0.4014			0.79											
08/30/22 20:00	0.36426			0.38022			0.74											
08/30/22 21:00	0.3462			0.36312			0.71											
08/30/22 22:00	0.29178			0.31062			0.6											
08/30/22 23:00	0.27072			0.28998			0.56											
08/31/22 0:00	0.27114			0.29076			0.56											
08/31/22 1:00	0.2718			0.29196			0.56											
08/31/22 2:00	0.27216			0.29274			0.56											
08/31/22 3:00	0.2715			0.2919			0.56											
08/31/22 4:00	0.27378			0.29394			0.57											
08/31/22 5:00	0.2739			0.29478			0.57											
08/31/22 6:00	0.24792			0.26646			0.51											
08/31/22 7:00	0.22518			0.24168			0.47											
08/31/22 8:00	0.22452			0.2412			0.47											
08/31/22 9:00	0.23778			0.25566			0.49											
08/31/22 10:00	0.26406			0.28296			0.55											
08/31/22 11:00	0.35766			0.37266			0.73											
08/31/22 12:00	0.37188			0.38574			0.76											

Date/Time	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H			Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod									
08/31/22 13:00	0.37974			0.39384			0.77											
08/31/22 14:00	0.36882			0.38286			0.75											
08/31/22 15:00	0.34602			0.36			0.71											
08/31/22 16:00	0.3276			0.3414			0.67											
08/31/22 17:00	0.37644			0.39018			0.77											
08/31/22 18:00	0.38496			0.39894			0.78											
08/31/22 19:00	0.35706			0.3723			0.73											
08/31/22 20:00	0.3222			0.33864			0.66											
08/31/22 21:00	0.33378			0.35094			0.68											
08/31/22 22:00	0.30354			0.32088			0.62											
08/31/22 23:00	0.3216			0.33918			0.66											
09/01/22 0:00	0.324			0.34314			0.67											
09/01/22 1:00	0.28632			0.3054			0.59											
09/01/22 2:00	0.26274			0.28308			0.55											
09/01/22 3:00	0.2673			0.28812			0.56											
09/01/22 4:00	0.26436			0.28518			0.55											
09/01/22 5:00	0.26556			0.28632			0.55											
09/01/22 6:00	0.26112			0.2811			0.54											
09/01/22 7:00	0.26352			0.28338			0.55											
09/01/22 8:00	0.17712			0.18894			0.37											
09/01/22 9:00	0.17508			0.18666			0.36											
09/01/22 10:00	0.18096			0.19266			0.37											
09/01/22 11:00	0.24054			0.25686			0.5											
09/01/22 12:00	0.35334			0.36618			0.72											
09/01/22 13:00	0.36198			0.3753			0.74											
09/01/22 14:00	0.369			0.38178			0.75											
09/01/22 15:00	0.3825			0.39492			0.78											
09/01/22 16:00	0.36774			0.38022			0.75											
09/01/22 17:00	0.3831			0.3951			0.78											
09/01/22 18:00	0.38316			0.3957			0.78											
09/01/22 19:00	0.36162			0.37554			0.74											
09/01/22 20:00	0.3726			0.38712			0.76											
09/01/22 21:00	0.3633			0.37836			0.74											
09/01/22 22:00	0.34596			0.3615			0.71											
09/01/22 23:00	0.34878			0.3651			0.71											
09/02/22 0:00	0.33246			0.35004			0.68											
09/02/22 1:00	0.32652			0.34482			0.67											

Date/Time	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H			Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod									
09/02/22 2:00	0.3174			0.33612			0.65											
09/02/22 3:00	0.31548			0.33438			0.65											
09/02/22 4:00	0.32982			0.34848			0.68											
09/02/22 5:00	0.3438			0.36306			0.71											
09/02/22 6:00	0.30708			0.3252			0.63											
09/02/22 7:00	0.29064			0.30858			0.6											
09/02/22 8:00	0.30084			0.318			0.62											
09/02/22 9:00	0.32142			0.33708			0.66											
09/02/22 10:00	0.33456			0.3492			0.68											
09/02/22 11:00	0.34242			0.3561			0.7											
09/02/22 12:00	0.3501			0.3639			0.71											
09/02/22 13:00	0.36534			0.37968			0.75											
09/02/22 14:00	0.3648			0.37866			0.74											
09/02/22 15:00	0.3267			0.34032			0.67											
09/02/22 16:00	0.31932			0.33318			0.65											
09/02/22 17:00	0.32244			0.33636			0.66											
09/02/22 18:00	0.33588			0.34968			0.69											
09/02/22 19:00	0.34512			0.36066			0.71											
09/02/22 20:00	0.33678			0.35364			0.69											
09/02/22 21:00	0.31422			0.3318			0.65											
09/02/22 22:00	0.28632			0.30462			0.59											
09/02/22 23:00	0.2103			0.22488			0.44											
09/03/22 0:00	0.23136			0.2484			0.48											
09/03/22 1:00	0.17454			0.18636			0.36											
09/03/22 2:00	0.17004			0.18132			0.35											
09/03/22 3:00	0.17064			0.18216			0.35											
09/03/22 4:00	0.16776			0.17946			0.35											
09/03/22 5:00	0.1698			0.18174			0.35											
09/03/22 6:00	0.16392			0.17502			0.34											
09/03/22 7:00	0.16392			0.17496			0.34											
09/03/22 8:00	0.16284			0.17358			0.34											
09/03/22 9:00	0.16692			0.17766			0.34											
09/03/22 10:00	0.16758			0.17796			0.35											
09/03/22 11:00	0.16566			0.1752			0.34											
09/03/22 12:00	0.20244			0.21432			0.42											
09/03/22 13:00	0.30102			0.3153			0.62											
09/03/22 14:00	0.28872			0.30312			0.59											

Date/Time	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H			Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod									
09/03/22 15:00	0.22254			0.2343			0.46											
09/03/22 16:00	0.30276			0.3162			0.62											
09/03/22 17:00	0.3021			0.31572			0.62											
09/03/22 18:00	0.2997			0.31434			0.61											
09/03/22 19:00	0.20244			0.21498			0.42											
09/03/22 20:00	0.1806			0.19194			0.37											
09/03/22 21:00	0.19644			0.21006			0.41											
09/03/22 22:00	0.19068			0.20394			0.39											
09/03/22 23:00	0.21168			0.22704			0.44											
09/04/22 0:00	0.1983			0.21222			0.41											
09/04/22 1:00	0.17412			0.18594			0.36											
09/04/22 2:00	0.189			0.20214			0.39											
09/04/22 3:00	0.19164			0.20556			0.4											
09/04/22 4:00	0.17436			0.18642			0.36											
09/04/22 5:00	0.16638			0.17796			0.34											
09/04/22 6:00	0.16566			0.17724			0.34											
09/04/22 7:00	0.16374			0.17502			0.34											
09/04/22 8:00	0.16362			0.1746			0.34											
09/04/22 9:00	0.16362			0.17442			0.34											
09/04/22 10:00	0.16668			0.17706			0.34											
09/04/22 11:00	0.1665			0.17574			0.34											
09/04/22 12:00	0.18684			0.19764			0.38											
09/04/22 13:00	0.18372			0.1947			0.38											
09/04/22 14:00	0.231			0.2439			0.47											
09/04/22 15:00	0.3015			0.31458			0.62											
09/04/22 16:00	0.30942			0.32274			0.63											
09/04/22 17:00	0.3264			0.33918			0.67											
09/04/22 18:00	0.32268			0.33702			0.66											
09/04/22 19:00	0.27216			0.28806			0.56											
09/04/22 20:00	0.31152			0.32682			0.64											
09/04/22 21:00	0.31062			0.32574			0.64											
09/04/22 22:00	0.2844			0.30072			0.59											
09/04/22 23:00	0.25278			0.2721			0.52											
09/05/22 0:00	0.25056			0.26964			0.52											
09/05/22 1:00	0.22938			0.24642			0.48											
09/05/22 2:00	0.22008			0.23646			0.46											
09/05/22 3:00	0.228			0.24498			0.47											

Date/Time	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H			Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod									
09/05/22 4:00	0.22938			0.24636			0.48											
09/05/22 5:00	0.22278			0.2394			0.46											
09/05/22 6:00	0.16788			0.1794			0.35											
09/05/22 7:00	0.16344			0.1743			0.34											
09/05/22 8:00	0.16374			0.17472			0.34											
09/05/22 9:00	0.22128			0.23742			0.46											
09/05/22 10:00	0.24984			0.26832			0.52											
09/05/22 11:00	0.25866			0.27456			0.53											
09/05/22 12:00	0.32274			0.33522			0.66											
09/05/22 13:00	0.34098			0.35364			0.69											
09/05/22 14:00	0.37158			0.38328			0.75											
09/05/22 15:00	0.37854			0.38886			0.77											
09/05/22 16:00	0.37848			0.3891			0.77											
09/05/22 17:00	0.38154			0.39036			0.77											
09/05/22 18:00	0.37956			0.39132			0.77											
09/05/22 19:00	0.3774			0.39048			0.77											
09/05/22 20:00	0.37542			0.38928			0.76											
09/05/22 21:00	0.36006			0.37422			0.73											
09/05/22 22:00	0.35964			0.37398			0.73											
09/05/22 23:00	0.36168			0.37716			0.74											
09/06/22 0:00	0.33738			0.35406			0.69											
09/06/22 1:00	0.28266			0.30066			0.58											
09/06/22 2:00	0.2583			0.27816			0.54											
09/06/22 3:00	0.25824			0.27786			0.54											
09/06/22 4:00	0.25824			0.27828			0.54											
09/06/22 5:00	0.25824			0.27822			0.54											
09/06/22 6:00	0.25644			0.276			0.53											
09/06/22 7:00	0.24288			0.26094			0.5											
09/06/22 8:00	0.25248			0.2718			0.52											
09/06/22 9:00	0.28578			0.30228			0.59											
09/06/22 10:00	0.336			0.34908			0.69											
09/06/22 11:00	0.37908			0.39072			0.77											
09/06/22 12:00	0.3798			0.39084			0.77											
09/06/22 13:00	0.38076			0.3915			0.77											
09/06/22 14:00	0.38058			0.38898			0.77											
09/06/22 15:00	0.38088			0.3885			0.77											
09/06/22 16:00	0.38124			0.38976			0.77											

Date/Time	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H			Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod									
09/06/22 17:00	0.3813			0.3897			0.77											
09/06/22 18:00	0.38124			0.38952			0.77											
09/06/22 19:00	0.37866			0.39156			0.77											
09/06/22 20:00	0.37656			0.39018			0.77											
09/06/22 21:00	0.37326			0.38802			0.76											
09/06/22 22:00	0.32844			0.34542			0.67											
09/06/22 23:00	0.32754			0.34494			0.67											
09/07/22 0:00	0.27708			0.29466			0.57											
09/07/22 1:00	0.267			0.28482			0.55											
09/07/22 2:00	0.2655			0.28452			0.55											
09/07/22 3:00	0.26454			0.28458			0.55											
09/07/22 4:00	0.26772			0.28506			0.55											
09/07/22 5:00	0.26886			0.28632			0.56											
09/07/22 6:00	0.25848			0.27768			0.54											
09/07/22 7:00	0.23214			0.24852			0.48											
09/07/22 8:00	0.25278			0.27012			0.52											
09/07/22 9:00	0.35784			0.37416			0.73											
09/07/22 10:00	0.3717			0.38556			0.76											
09/07/22 11:00	0.37368			0.38682			0.76											
09/07/22 12:00	0.3756			0.38832			0.76											
09/07/22 13:00	0.37668			0.38964			0.77											
09/07/22 14:00	0.37776			0.39036			0.77											
09/07/22 15:00	0.37854			0.39114			0.77											
09/07/22 16:00	0.37758			0.39102			0.77											
09/07/22 17:00	0.37806			0.39132			0.77											
09/07/22 18:00	0.37722			0.39126			0.77											
09/07/22 19:00	0.37044			0.3849			0.76											
09/07/22 20:00	0.37308			0.38904			0.76											
09/07/22 21:00	0.36852			0.38592			0.75											
09/07/22 22:00	0.35352			0.37152			0.73											
09/07/22 23:00	0.34734			0.36444			0.71											
09/08/22 0:00	0.3453			0.36198			0.71											
09/08/22 1:00	0.27024			0.2874			0.56											
09/08/22 2:00	0.26898			0.28746			0.56											
09/08/22 3:00	0.26844			0.28836			0.56											
09/08/22 4:00	0.26778			0.28872			0.56											
09/08/22 5:00	0.2679			0.28962			0.56											

Date/Time	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H			Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod									
09/08/22 6:00	0.26382			0.28458			0.55											
09/08/22 7:00	0.2574			0.27654			0.53											
09/08/22 8:00	0.26478			0.28278			0.55											
09/08/22 9:00	0.37158			0.38622			0.76											
09/08/22 10:00	0.37512			0.38898			0.76											
09/08/22 11:00	0.37758			0.3903			0.77											
09/08/22 12:00	0.37782			0.39012			0.77											
09/08/22 13:00	0.37884			0.39156			0.77											
09/08/22 14:00	0.3792			0.39168			0.77											
09/08/22 15:00	0.37902			0.39174			0.77											
09/08/22 16:00	0.37914			0.3912			0.77											
09/08/22 17:00	0.37926			0.39198			0.77											
09/08/22 18:00	0.3783			0.39126			0.77											
09/08/22 19:00	0.37968			0.39276			0.77											
09/08/22 20:00	0.38418			0.39804			0.78											
09/08/22 21:00	0.38562			0.40104			0.79											
09/08/22 22:00	0.3696			0.38376			0.75											
09/08/22 23:00	0.35334			0.37002			0.72											
09/09/22 0:00	0.35466			0.37176			0.73											
09/09/22 1:00	0.3369			0.35436			0.69											
09/09/22 2:00	0.33486			0.35004			0.68											
09/09/22 3:00	0.32334			0.33966			0.66											
09/09/22 4:00	0.34116			0.35724			0.7											
09/09/22 5:00	0.37542			0.3912			0.77											
09/09/22 6:00	0.3603			0.37644			0.74											
09/09/22 7:00	0.35454			0.37032			0.72											
09/09/22 8:00	0.34326			0.35856			0.7											
09/09/22 9:00	0.32928			0.34458			0.67											
09/09/22 10:00	0.36006			0.3747			0.73											
09/09/22 11:00	0.32508			0.339			0.66											
09/09/22 12:00	0.35544			0.36882			0.72											
09/09/22 13:00	0.3696			0.38292			0.75											
09/09/22 14:00	0.3549			0.36864			0.72											
09/09/22 15:00	0.34932			0.36276			0.71											
09/09/22 16:00	0.32628			0.3399			0.67											
09/09/22 17:00	0.3381			0.35214			0.69											
09/09/22 18:00	0.32328			0.33846			0.66											

Date/Time	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H			Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod									
09/09/22 19:00	0.30666			0.32214			0.63											
09/09/22 20:00	0.2667			0.28374			0.55											
09/09/22 21:00	0.24954			0.26766			0.52											
09/09/22 22:00	0.22308			0.23886			0.46											
09/09/22 23:00	0.25206			0.27072			0.52											
09/10/22 0:00	0.2409			0.25842			0.5											
09/10/22 1:00	0.18336			0.19548			0.38											
09/10/22 2:00	0.2169			0.23238			0.45											
09/10/22 3:00	0.2046			0.21906			0.42											
09/10/22 4:00	0.23232			0.24966			0.48											
09/10/22 5:00	0.22032			0.2367			0.46											
09/10/22 6:00	0.20796			0.2229			0.43											
09/10/22 7:00	0.2583			0.2766			0.53											
09/10/22 8:00	0.23274			0.24882			0.48											
09/10/22 9:00	0.19638			0.20958			0.41											
09/10/22 10:00	0.16722			0.1773			0.34											
09/10/22 11:00	0.16632			0.1761			0.34											
09/10/22 12:00	0.17892			0.18972			0.37											
09/10/22 13:00	0.19632			0.20898			0.41											
09/10/22 14:00	0.177			0.18792			0.36											
09/10/22 15:00	0.18066			0.19218			0.37											
09/10/22 16:00	0.20178			0.21552			0.42											
09/10/22 17:00	0.17952			0.19134			0.37											
09/10/22 18:00	0.2121			0.2274			0.44											
09/10/22 19:00	0.2436			0.26202			0.51											
09/10/22 20:00	0.2496			0.26772			0.52											
09/10/22 21:00	0.25134			0.27096			0.52											
09/10/22 22:00	0.20844			0.22362			0.43											
09/10/22 23:00	0.25758			0.27726			0.53											
09/11/22 0:00	0.26172			0.28194			0.54											
09/11/22 1:00	0.2583			0.27828			0.54											
09/11/22 2:00	0.25566			0.27516			0.53											
09/11/22 3:00	0.2343			0.25224			0.49											
09/11/22 4:00	0.24408			0.2628			0.51											
09/11/22 5:00	0.23724			0.25518			0.49											
09/11/22 6:00	0.20844			0.22392			0.43											
09/11/22 7:00	0.18264			0.19542			0.38											

Date/Time	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H			Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod									
09/11/22 8:00	0.17172			0.183			0.35											
09/11/22 9:00	0.16746			0.17808			0.35											
09/11/22 10:00	0.17262			0.18366			0.36											
09/11/22 11:00	0.17442			0.1851			0.36											
09/11/22 12:00	0.19644			0.20928			0.41											
09/11/22 13:00	0.19452			0.20748			0.4											
09/11/22 14:00	0.22974			0.24492			0.47											
09/11/22 15:00	0.24012			0.2568			0.5											
09/11/22 16:00	0.29316			0.29928			0.59											
09/11/22 17:00	0.32826			0.34362			0.67											
09/11/22 18:00	0.30978			0.3258			0.64											
09/11/22 19:00	0.2904			0.30804			0.6											
09/11/22 20:00	0.25554			0.27468			0.53											
09/11/22 21:00	0.19782			0.21168			0.41											
09/11/22 22:00	0.20334			0.21798			0.42											
09/11/22 23:00	0.19698			0.21114			0.41											
09/12/22 0:00	0.22476			0.24186			0.47											
09/12/22 1:00	0.17562			0.18768			0.36											
09/12/22 2:00	0.17214			0.18402			0.36											
09/12/22 3:00	0.17112			0.18312			0.35											
09/12/22 4:00	0.2292			0.24594			0.48											
09/12/22 5:00	0.26604			0.28704			0.55											
09/12/22 6:00	0.23886			0.25692			0.5											
09/12/22 7:00	0.19314			0.20658			0.4											
09/12/22 8:00	0.1719			0.18396			0.36											
09/12/22 9:00	0.17256			0.18402			0.36											
09/12/22 10:00	0.1758			0.18708			0.36											
09/12/22 11:00	0.22344			0.23772			0.46											
09/12/22 12:00	0.26376			0.28182			0.55											
09/12/22 13:00	0.22902			0.24486			0.47											
09/12/22 14:00	0.22962			0.24564			0.48											
09/12/22 15:00	0.23172			0.24552			0.48											
09/12/22 16:00	0.23994			0.2544			0.49											
09/12/22 17:00	0.2643			0.28134			0.55											
09/12/22 18:00	0.25914			0.27756			0.54											
09/12/22 19:00	0.2604			0.28014			0.54											
09/12/22 20:00	0.26412			0.28482			0.55											

Date/Time	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H			Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod									
09/12/22 21:00	0.2613			0.28176			0.54											
09/12/22 22:00	0.21042			0.22584			0.44											
09/12/22 23:00	0.23592			0.25398			0.49											
09/13/22 0:00	0.23652			0.25452			0.49											
09/13/22 1:00	0.19572			0.20988			0.41											
09/13/22 2:00	0.1782			0.1908			0.37											
09/13/22 3:00	0.23664			0.25428			0.49											
09/13/22 4:00	0.29694			0.31704			0.61											
09/13/22 5:00	0.30306			0.32364			0.63											
09/13/22 6:00	0.27168			0.29184			0.56											
09/13/22 7:00	0.21852			0.2349			0.45											
09/13/22 8:00	0.18306			0.19626			0.38											
09/13/22 9:00	0.17034			0.18234			0.35											
09/13/22 10:00	0.17586			0.18804			0.36											
09/13/22 11:00	0.1767			0.18816			0.36											
09/13/22 12:00	0.1698			0.18036			0.35											
09/13/22 13:00	0.16818			0.17928			0.35											
09/13/22 14:00	0.17118			0.18246			0.35											
09/13/22 15:00	0.1689			0.17982			0.35											
09/13/22 16:00	0.21018			0.22422			0.43											
09/13/22 17:00	0.29862			0.31644			0.62											
09/13/22 18:00	0.29244			0.3117			0.6											
09/13/22 19:00	0.29274			0.3126			0.61											
09/13/22 20:00	0.28992			0.31032			0.6											
09/13/22 21:00	0.2814			0.30186			0.58											
09/13/22 22:00	0.18096			0.19416			0.38											
09/13/22 23:00	0.21846			0.23544			0.45											
09/14/22 0:00	0.19956			0.21474			0.41											
09/14/22 1:00	0.18852			0.20256			0.39											
09/14/22 2:00	0.19074			0.2052			0.4											
09/14/22 3:00	0.22296			0.24066			0.46											
09/14/22 4:00	0.2418			0.26118			0.5											
09/14/22 5:00	0.2619			0.28284			0.54											
09/14/22 6:00	0.21174			0.22788			0.44											
09/14/22 7:00	0.16926			0.18162			0.35											
09/14/22 8:00	0.16596			0.17808			0.34											
09/14/22 9:00	0.16494			0.17676			0.34											

Date/Time	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H			Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod									
09/14/22 10:00	0.16716			0.17874			0.35											
09/14/22 11:00	0.16818			0.17886			0.35											
09/14/22 12:00	0.1677			0.1785			0.35											
09/14/22 13:00	0.16728			0.17844			0.35											
09/14/22 14:00	0.16734			0.1785			0.35											
09/14/22 15:00	0.16722			0.17808			0.35											
09/14/22 16:00	0.17076			0.18204			0.35											
09/14/22 17:00	0.1881			0.20148			0.39											
09/14/22 18:00	0.20814			0.22338			0.43											
09/14/22 19:00	0.20946			0.225			0.43											
09/14/22 20:00	0.20682			0.22254			0.43											
09/14/22 21:00	0.20922			0.22518			0.43											
09/14/22 22:00	0.17316			0.18582			0.36											
09/14/22 23:00	0.1824			0.19602			0.38											
09/15/22 0:00	0.17298			0.18576			0.36											
09/15/22 1:00	0.17994			0.19332			0.37											
09/15/22 2:00	0.18186			0.19554			0.38											
09/15/22 3:00	0.2013			0.21678			0.42											
09/15/22 4:00	0.22776			0.24558			0.47											
09/15/22 5:00	0.25188			0.27228			0.52											
09/15/22 6:00	0.20358			0.21942			0.42											
09/15/22 7:00	0.19122			0.20562			0.4											
09/15/22 8:00	0.1677			0.17994			0.35											
09/15/22 9:00	0.16758			0.17982			0.35											
09/15/22 10:00	0.24366			0.26136			0.51											
09/15/22 11:00	0.2928			0.30966			0.6											
09/15/22 12:00	0.19956			0.21276			0.41											
09/15/22 13:00	0.1689			0.18018			0.35											
09/15/22 14:00	0.18684			0.19944			0.39											
09/15/22 15:00	0.17232			0.1836			0.36											
09/15/22 16:00	0.17196			0.18348			0.36											
09/15/22 17:00	0.20544			0.2202			0.43											
09/15/22 18:00	0.17952			0.19152			0.37											
09/15/22 19:00	0.18906			0.20262			0.39											
09/15/22 20:00	0.18312			0.1965			0.38											
09/15/22 21:00	0.18648			0.2004			0.39											
09/15/22 22:00	0.1767			0.18948			0.37											

Date/Time	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H			Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod									
09/15/22 23:00	0.17262			0.18558			0.36											
09/16/22 0:00	0.1713			0.18402			0.36											
09/16/22 1:00	0.16494			0.17748			0.34											
09/16/22 2:00	0.16488			0.17754			0.34											
09/16/22 3:00	0.16542			0.17832			0.34											
09/16/22 4:00	0.17256			0.1857			0.36											
09/16/22 5:00	0.20766			0.22446			0.43											
09/16/22 6:00	0.19398			0.20934			0.4											
09/16/22 7:00	0.16446			0.17748			0.34											
09/16/22 8:00	0.16656			0.1791			0.35											
09/16/22 9:00	0.16482			0.17676			0.34											
09/16/22 10:00	0.165			0.17658			0.34											
09/16/22 11:00	0.16614			0.1773			0.34											
09/16/22 12:00	0.16482			0.17568			0.34											
09/16/22 13:00	0.16482			0.17598			0.34											
09/16/22 14:00	0.17958			0.1917			0.37											
09/16/22 15:00	0.16806			0.17874			0.35											
09/16/22 16:00	0.16662			0.1773			0.34											
09/16/22 17:00	0.17184			0.18294			0.35											
09/16/22 18:00	0.17226			0.18372			0.36											
09/16/22 19:00	0.17202			0.18372			0.36											
09/16/22 20:00	0.17208			0.18396			0.36											
09/16/22 21:00	0.17172			0.18396			0.36											
09/16/22 22:00	0.16908			0.18114			0.35											
09/16/22 23:00	0.17142			0.18408			0.36											
09/17/22 0:00	0.17208			0.18474			0.36											
09/17/22 1:00	0.17238			0.18528			0.36											
09/17/22 2:00	0.17226			0.18522			0.36											
09/17/22 3:00	0.17232			0.18528			0.36											
09/17/22 4:00	0.17712			0.1905			0.37											
09/17/22 5:00	0.17232			0.1854			0.36											
09/17/22 6:00	0.16452			0.17718			0.34											
09/17/22 7:00	0.16482			0.17724			0.34											
09/17/22 8:00	0.16476			0.17706			0.34											
09/17/22 9:00	0.16494			0.17682			0.34											
09/17/22 10:00	0.165			0.17664			0.34											
09/17/22 11:00	0.16536			0.17652			0.34											

Date/Time	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H			Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod									
09/17/22 12:00	0.16536			0.17628			0.34											
09/17/22 13:00	0.16452			0.17544			0.34											
09/17/22 14:00	0.16434			0.1755			0.34											
09/17/22 15:00	0.16446			0.17538			0.34											
09/17/22 16:00	0.17262			0.18474			0.36											
09/17/22 17:00	0.18702			0.20046			0.39											
09/17/22 18:00	0.17208			0.18468			0.36											
09/17/22 19:00	0.16602			0.17832			0.34											
09/17/22 20:00	0.16764			0.18012			0.35											
09/17/22 21:00	0.18258			0.19632			0.38											
09/17/22 22:00	0.1815			0.19512			0.38											
09/17/22 23:00	0.1722			0.18498			0.36											
09/18/22 0:00	0.1722			0.1848			0.36											
09/18/22 1:00	0.17256			0.1851			0.36											
09/18/22 2:00	0.17262			0.18534			0.36											
09/18/22 3:00	0.17244			0.18528			0.36											
09/18/22 4:00	0.16806			0.1809			0.35											
09/18/22 5:00	0.16476			0.1773			0.34											
09/18/22 6:00	0.17232			0.18576			0.36											
09/18/22 7:00	0.1743			0.1872			0.36											
09/18/22 8:00	0.17244			0.1845			0.36											
09/18/22 9:00	0.1722			0.18408			0.36											
09/18/22 10:00	0.1701			0.18192			0.35											
09/18/22 11:00	0.1785			0.19098			0.37											
09/18/22 12:00	0.19602			0.21054			0.41											
09/18/22 13:00	0.21774			0.23556			0.45											
09/18/22 14:00	0.1878			0.20112			0.39											
09/18/22 15:00	0.1803			0.19278			0.37											
09/18/22 16:00	0.21438			0.23124			0.45											
09/18/22 17:00	0.24438			0.2649			0.51											
09/18/22 18:00	0.23934			0.25854			0.5											
09/18/22 19:00	0.24894			0.26886			0.52											
09/18/22 20:00	0.25542			0.2754			0.53											
09/18/22 21:00	0.25002			0.26886			0.52											
09/18/22 22:00	0.16866			0.18132			0.35											
09/18/22 23:00	0.17232			0.18486			0.36											
09/19/22 0:00	0.17292			0.18564			0.36											

Date/Time	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H			Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod									
09/19/22 1:00	0.17316			0.18588			0.36											
09/19/22 2:00	0.17316			0.18588			0.36											
09/19/22 3:00	0.17274			0.18576			0.36											
09/19/22 4:00	0.2058			0.22194			0.43											
09/19/22 5:00	0.25422			0.27414			0.53											
09/19/22 6:00	0.23838			0.2571			0.5											
09/19/22 7:00	0.25458			0.27408			0.53											
09/19/22 8:00	0.27636			0.29508			0.57											
09/19/22 9:00	0.20928			0.22368			0.43											
09/19/22 10:00	0.17316			0.18504			0.36											
09/19/22 11:00	0.18828			0.20214			0.39											
09/19/22 12:00	0.1806			0.19338			0.37											
09/19/22 13:00	0.18402			0.19728			0.38											
09/19/22 14:00	0.17904			0.1917			0.37											
09/19/22 15:00	0.17274			0.18516			0.36											
09/19/22 16:00	0.24312			0.2577			0.5											
09/19/22 17:00	0.3546			0.37224			0.73											
09/19/22 18:00	0.336			0.3528			0.69											
09/19/22 19:00	0.32334			0.33978			0.66											
09/19/22 20:00	0.31482			0.33132			0.65											
09/19/22 21:00	0.30126			0.31932			0.62											
09/19/22 22:00	0.24324			0.25782			0.5											
09/19/22 23:00	0.2373			0.25662			0.49											
09/20/22 0:00	0.22998			0.2484			0.48											
09/20/22 1:00	0.19524			0.21			0.41											
09/20/22 2:00	0.18312			0.19656			0.38											
09/20/22 3:00	0.25338			0.2733			0.53											
09/20/22 4:00	0.27516			0.29778			0.57											
09/20/22 5:00	0.27192			0.2943			0.57											
09/20/22 6:00	0.21096			0.2274			0.44											
09/20/22 7:00	0.1761			0.189			0.37											
09/20/22 8:00	0.17856			0.1917			0.37											
09/20/22 9:00	0.17586			0.18834			0.36											
09/20/22 10:00	0.16566			0.1773			0.34											
09/20/22 11:00	0.20454			0.21972			0.42											
09/20/22 12:00	0.17886			0.19092			0.37											
09/20/22 13:00	0.1755			0.18762			0.36											

Date/Time	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H			Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod									
09/20/22 14:00	0.17382			0.18564			0.36											
09/20/22 15:00	0.17052			0.18204			0.35											
09/20/22 16:00	0.23238			0.2478			0.48											
09/20/22 17:00	0.34806			0.36192			0.71											
09/20/22 18:00	0.35358			0.36432			0.72											
09/20/22 19:00	0.33324			0.3462			0.68											
09/20/22 20:00	0.3393			0.35262			0.69											
09/20/22 21:00	0.33732			0.34998			0.69											
09/20/22 22:00	0.31332			0.32682			0.64											
09/20/22 23:00	0.26724			0.28656			0.55											
09/21/22 0:00	0.26556			0.28398			0.55											
09/21/22 1:00	0.23562			0.25398			0.49											
09/21/22 2:00	0.2379			0.25692			0.49											
09/21/22 3:00	0.27768			0.29832			0.58											
09/21/22 4:00	0.27774			0.29868			0.58											
09/21/22 5:00	0.27516			0.29544			0.57											
09/21/22 6:00	0.22818			0.24582			0.47											
09/21/22 7:00	0.26958			0.29076			0.56											
09/21/22 8:00	0.2613			0.28254			0.54											
09/21/22 9:00	0.25494			0.2748			0.53											
09/21/22 10:00	0.2007			0.21546			0.42											
09/21/22 11:00	0.24504			0.26388			0.51											
09/21/22 12:00	0.17694			0.18906			0.37											
09/21/22 13:00	0.17328			0.18522			0.36											
09/21/22 14:00	0.2343			0.2523			0.49											
09/21/22 15:00	0.17226			0.1836			0.36											
09/21/22 16:00	0.20772			0.22248			0.43											
09/21/22 17:00	0.24684			0.2658			0.51											
09/21/22 18:00	0.22656			0.24336			0.47											
09/21/22 19:00	0.20532			0.22092			0.43											
09/21/22 20:00	0.19446			0.20934			0.4											
09/21/22 21:00	0.17238			0.18492			0.36											
09/21/22 22:00	0.16914			0.18162			0.35											
09/21/22 23:00	0.17334			0.186			0.36											
09/22/22 0:00	0.17364			0.18642			0.36											
09/22/22 1:00	0.17394			0.18666			0.36											
09/22/22 2:00	0.17322			0.18648			0.36											

Date/Time	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H			Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod									
09/22/22 3:00	0.17298			0.18636			0.36											
09/22/22 4:00	0.19494			0.21042			0.41											
09/22/22 5:00	0.21624			0.2334			0.45											
09/22/22 6:00	0.20004			0.21564			0.42											
09/22/22 7:00	0.22488			0.24288			0.47											
09/22/22 8:00	0.2223			0.24012			0.46											
09/22/22 9:00	0.22212			0.23988			0.46											
09/22/22 10:00	0.22212			0.2391			0.46											
09/22/22 11:00	0.22188			0.23826			0.46											
09/22/22 12:00	0.22242			0.23802			0.46											
09/22/22 13:00	0.20472			0.21666			0.42											
09/22/22 14:00	0.16806			0.1791			0.35											
09/22/22 15:00	0.16692			0.17808			0.35											
09/22/22 16:00	0.1866			0.19986			0.39											
09/22/22 17:00	0.17424			0.18606			0.36											
09/22/22 18:00	0.17532			0.18702			0.36											
09/22/22 19:00	0.19422			0.2079			0.4											
09/22/22 20:00	0.21138			0.22704			0.44											
09/22/22 21:00	0.20772			0.2361			0.44											
09/22/22 22:00	0	X		0.26058			0.26											
09/22/22 23:00	0	X		0.06822			0											
09/23/22 0:00	0	X		0	X		0											
09/23/22 1:00	0	X		0	X		0											
09/23/22 2:00	0	X		0	X		0											
09/23/22 3:00	0	X		0	X		0											
09/23/22 4:00	0	X		0	X		0											
09/23/22 5:00	0	X		0	X		0											
09/23/22 6:00	0	X		0	X		0											
09/23/22 7:00	0	X		0	X		0											
09/23/22 8:00	0	X		0	X		0											
09/23/22 9:00	0	X		0	X		0											
09/23/22 10:00	0	X		0	X		0											
09/23/22 11:00	0	X		0	X		0											
09/23/22 12:00	0.1299			0	X		0.05											
09/23/22 13:00	0.21888			0	X		0.22											
09/23/22 14:00	0.19452			0	X		0.19											
09/23/22 15:00	0.26466			0.08556			0.29											

Date/Time	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H			Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod									
09/23/22 16:00	0.23034			0.24636			0.48											
09/23/22 17:00	0.30108			0.31848			0.62											
09/23/22 18:00	0.29892			0.31494			0.61											
09/23/22 19:00	0.29742			0.31368			0.61											
09/23/22 20:00	0.31206			0.32202			0.63											
09/23/22 21:00	0.318			0.32784			0.65											
09/23/22 22:00	0.24768			0.2604			0.51											
09/23/22 23:00	0.2409			0.2592			0.5											
09/24/22 0:00	0.20568			0.22104			0.43											
09/24/22 1:00	0.19338			0.2079			0.4											
09/24/22 2:00	0.2244			0.24222			0.47											
09/24/22 3:00	0.24042			0.2598			0.5											
09/24/22 4:00	0.25428			0.27396			0.53											
09/24/22 5:00	0.24066			0.25962			0.5											
09/24/22 6:00	0.1773			0.19032			0.37											
09/24/22 7:00	0.16554			0.17772			0.34											
09/24/22 8:00	0.1656			0.17742			0.34											
09/24/22 9:00	0.16578			0.17712			0.34											
09/24/22 10:00	0.16584			0.17688			0.34											
09/24/22 11:00	0.16572			0.17652			0.34											
09/24/22 12:00	0.16986			0.18072			0.35											
09/24/22 13:00	0.17436			0.18552			0.36											
09/24/22 14:00	0.23154			0.24522			0.48											
09/24/22 15:00	0.2535			0.25926			0.51											
09/24/22 16:00	0.2481			0.26346			0.51											
09/24/22 17:00	0.26322			0.27528			0.54											
09/24/22 18:00	0.23922			0.25458			0.49											
09/24/22 19:00	0.24942			0.26838			0.52											
09/24/22 20:00	0.2688			0.28752			0.56											
09/24/22 21:00	0.27126			0.29016			0.56											
09/24/22 22:00	0.26166			0.28116			0.54											
09/24/22 23:00	0.243			0.2619			0.5											
09/25/22 0:00	0.22338			0.24036			0.46											
09/25/22 1:00	0.2031			0.21858			0.42											
09/25/22 2:00	0.2442			0.2631			0.51											
09/25/22 3:00	0.20544			0.2211			0.43											
09/25/22 4:00	0.17838			0.19146			0.37											

Date/Time	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H			Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod									
09/25/22 5:00	0.18306			0.1968			0.38											
09/25/22 6:00	0.16608			0.17874			0.34											
09/25/22 7:00	0.16494			0.17712			0.34											
09/25/22 8:00	0.16548			0.177			0.34											
09/25/22 9:00	0.16542			0.17676			0.34											
09/25/22 10:00	0.16566			0.17658			0.34											
09/25/22 11:00	0.16572			0.1764			0.34											
09/25/22 12:00	0.16512			0.17586			0.34											
09/25/22 13:00	0.17004			0.18078			0.35											
09/25/22 14:00	0.1812			0.19272			0.37											
09/25/22 15:00	0.19254			0.20508			0.4											
09/25/22 16:00	0.2406			0.25422			0.49											
09/25/22 17:00	0.25884			0.27252			0.53											
09/25/22 18:00	0.249			0.2673			0.52											
09/25/22 19:00	0.24144			0.25908			0.5											
09/25/22 20:00	0.24312			0.26106			0.5											
09/25/22 21:00	0.22356			0.24006			0.46											
09/25/22 22:00	0.17196			0.18372			0.36											
09/25/22 23:00	0.174			0.18624			0.36											
09/26/22 0:00	0.1779			0.1905			0.37											
09/26/22 1:00	0.17346			0.18552			0.36											
09/26/22 2:00	0.17322			0.18546			0.36											
09/26/22 3:00	0.17292			0.18552			0.36											
09/26/22 4:00	0.20898			0.22512			0.43											
09/26/22 5:00	0.20508			0.22086			0.43											
09/26/22 6:00	0.17202			0.18504			0.36											
09/26/22 7:00	0.16452			0.17652			0.34											
09/26/22 8:00	0.16452			0.17634			0.34											
09/26/22 9:00	0.16464			0.17616			0.34											
09/26/22 10:00	0.16452			0.17568			0.34											
09/26/22 11:00	0.165			0.17574			0.34											
09/26/22 12:00	0.1695			0.1806			0.35											
09/26/22 13:00	0.17274			0.18318			0.36											
09/26/22 14:00	0.18594			0.1977			0.38											
09/26/22 15:00	0.20568			0.2193			0.42											
09/26/22 16:00	0.21474			0.22812			0.44											
09/26/22 17:00	0.21684			0.23148			0.45											

	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H											
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/26/22 18:00	0.17292			0.18354			0.36											
09/26/22 19:00	0.17232			0.18324			0.36											
09/26/22 20:00	0.174			0.18552			0.36											
09/26/22 21:00	0.19998			0.2145			0.41											
09/26/22 22:00	0.21126			0.2268			0.44											
09/26/22 23:00	0.306			0.32514			0.63											
09/27/22 0:00	0.31338			0.33342			0.65											
09/27/22 1:00	0.30732			0.32652			0.63											
09/27/22 2:00	0.30408			0.32556			0.63											
09/27/22 3:00	0.30042			0.31938			0.62											
09/27/22 4:00	0.3156			0.33816			0.65											
09/27/22 5:00	0.3276			0.34866			0.68											
09/27/22 6:00	0.29754			0.318			0.62											
09/27/22 7:00	0.25434			0.27348			0.53											
09/27/22 8:00	0.16434			0.1764			0.34											
09/27/22 9:00	0.16458			0.1764			0.34											
09/27/22 10:00	0.16626			0.17784			0.34											
09/27/22 11:00	0.23958			0.25524			0.49											
09/27/22 12:00	0.31488			0.33156			0.65											
09/27/22 13:00	0.29604			0.31224			0.61											
09/27/22 14:00	0.2967			0.31242			0.61											
09/27/22 15:00	0.2829			0.29874			0.58											
09/27/22 16:00	0.18048			0.1917			0.37											
09/27/22 17:00	0.20004			0.21288			0.41											
09/27/22 18:00	0.294			0.31176			0.61											
09/27/22 19:00	0.29346			0.31182			0.61											
09/27/22 20:00	0.29304			0.31134			0.6											
09/27/22 21:00	0.29736			0.31632			0.61											
09/27/22 22:00	0.291			0.3126			0.6											
09/27/22 23:00	0.25926			0.27822			0.54											
09/28/22 0:00	0.2532			0.273			0.53											
09/28/22 1:00	0.25224			0.27216			0.52											
09/28/22 2:00	0.25278			0.27276			0.53											
09/28/22 3:00	0.255			0.27522			0.53											
09/28/22 4:00	0.25764			0.27768			0.54											
09/28/22 5:00	0.25812			0.27846			0.54											
09/28/22 6:00	0.24918			0.26808			0.52											

Date/Time	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H			Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod									
09/28/22 7:00	0.16674			0.1791			0.35											
09/28/22 8:00	0.16494			0.17682			0.34											
09/28/22 9:00	0.165			0.17664			0.34											
09/28/22 10:00	0.16668			0.17802			0.34											
09/28/22 11:00	0.17226			0.1836			0.36											
09/28/22 12:00	0.17202			0.18312			0.36											
09/28/22 13:00	0.17172			0.1827			0.35											
09/28/22 14:00	0.19818			0.21132			0.41											
09/28/22 15:00	0.17076			0.18126			0.35											
09/28/22 16:00	0.16626			0.17664			0.34											
09/28/22 17:00	0.16578			0.1764			0.34											
09/28/22 18:00	0.17082			0.18204			0.35											
09/28/22 19:00	0.1689			0.18048			0.35											
09/28/22 20:00	0.17304			0.1851			0.36											
09/28/22 21:00	0.2103			0.22626			0.44											
09/28/22 22:00	0.22386			0.2409			0.46											
09/28/22 23:00	0.24162			0.26016			0.5											
09/29/22 0:00	0.22068			0.2376			0.46											
09/29/22 1:00	0.18624			0.20016			0.39											
09/29/22 2:00	0.18222			0.19566			0.38											
09/29/22 3:00	0.1941			0.2088			0.4											
09/29/22 4:00	0.21978			0.23694			0.46											
09/29/22 5:00	0.2421			0.26166			0.5											
09/29/22 6:00	0.2238			0.24156			0.47											
09/29/22 7:00	0.23448			0.25284			0.49											
09/29/22 8:00	0.17928			0.19296			0.37											
09/29/22 9:00	0.17034			0.1824			0.35											
09/29/22 10:00	0.1653			0.17694			0.34											
09/29/22 11:00	0.16746			0.17892			0.35											
09/29/22 12:00	0.16938			0.1806			0.35											
09/29/22 13:00	0.18348			0.19596			0.38											
09/29/22 14:00	0.1734			0.18474			0.36											
09/29/22 15:00	0.1758			0.18756			0.36											
09/29/22 16:00	0.2337			0.24846			0.48											
09/29/22 17:00	0.3009			0.3147			0.62											
09/29/22 18:00	0.29754			0.31446			0.61											
09/29/22 19:00	0.29658			0.31332			0.61											

Date/Time	CT1_SO2_LbPerHr_1H			CT2_SO2_LbPerHr_1H			ALL_SO2_Lb_1H			Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod									
09/29/22 20:00	0.25686			0.27336			0.53											
09/29/22 21:00	0.1767			0.18918			0.37											
09/29/22 22:00	0.18024			0.19296			0.37											
09/29/22 23:00	0.24552			0.26484			0.51											
09/30/22 0:00	0.2346			0.25314			0.49											
09/30/22 1:00	0.22956			0.24744			0.48											
09/30/22 2:00	0.22458			0.24198			0.47											
09/30/22 3:00	0.21654			0.23352			0.45											
09/30/22 4:00	0.24948			0.26952			0.52											
09/30/22 5:00	0.2676			0.29004			0.56											
09/30/22 6:00	0.22902			0.24726			0.48											
09/30/22 7:00	0.16602			0.17868			0.34											
09/30/22 8:00	0.16722			0.17916			0.35											
09/30/22 9:00	0.16602			0.17754			0.34											
09/30/22 10:00	0.1668			0.17814			0.34											
09/30/22 11:00	0.16536			0.17628			0.34											
09/30/22 12:00	0.16716			0.1776			0.34											
09/30/22 13:00	0.16524			0.17586			0.34											
09/30/22 14:00	0.16518			0.17574			0.34											
09/30/22 15:00	0.16722			0.17766			0.34											
09/30/22 16:00	0.2172			0.23118			0.45											
09/30/22 17:00	0.23772			0.25476			0.49											
09/30/22 18:00	0.17514			0.18618			0.36											
09/30/22 19:00	0.17364			0.18558			0.36											
09/30/22 20:00	0.18378			0.1968			0.38											
09/30/22 21:00	0.22164			0.23844			0.46											
09/30/22 22:00	0.1758			0.18852			0.36											
09/30/22 23:00	0.2487			0.26814			0.52											

Tons 12 Month Rolling Summary

CT1 and CT2 Combined



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 19:15 Location: Roseville, CA

* = Excess Emission

Date	Units CT1 & CT2		Units CT1 & CT2		Units CT1 & CT2		Units CT1 & CT2		Units CT1 & CT2	
	CO, Ton		NOx, Ton		PM10, Ton		SO2, Ton		VOC, Ton	
	1 Day(s)		1 Day(s)		1 Day(s)		1 Day(s)		1 Day(s)	
	Sum	Rolling Sum	Sum	Rolling Sum	Sum	Rolling Sum	Sum	Rolling Sum	Sum	Rolling Sum
Jul 2022	0.6226	6.7916	1.5269	13.6733	0.3084	2.8936	0.1544	1.4470	0.5141	4.8240
Aug 2022	0.5968	6.7917	1.7288	13.6468	0.3466	2.8593	0.1731	1.4296	0.5774	4.7658
Sep 2022	0.5247	6.7951	1.6900	13.8458	0.3443	2.8831	0.1723	1.4414	0.5740	4.8056
Sum/Avg	6.7951		13.8458		2.8831		1.4414		4.8056	
Limit Value										

ATTACHMENT 6

AQ-34

AQ-34 the Project owner shall maintain the following records: occurrence, duration, and type of any startup, shutdown, or malfunction: performance testing, evaluations, calibrations, check, adjustments, any period during which a continuous monitoring system or monitoring device was inoperative, maintenance of any continuous emission monitor; emission measurements, total daily and rolling twelve month averages hours of operation, hourly quantity of fuel used and gross three hour average operating load.

Verification; The Project owner shall submit to the CPM all data identified in this condition as part of the Quarterly Air Quality Report required by the Condition of Certification AQ-SC6

AQ34 3HR AVG LOAD

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/01/22 0:00	1			53			31											
07/01/22 1:00	1			43			10											
07/01/22 2:00	1			37			0											
07/01/22 3:00	1			33			0											
07/01/22 4:00	1			33			0											
07/01/22 5:00	1			37			0											
07/01/22 6:00	1			37			0											
07/01/22 7:00	1			37			0											
07/01/22 8:00	1			33			0											
07/01/22 9:00	1			33			0											
07/01/22 10:00	1			33			0											
07/01/22 11:00	1			33			0											
07/01/22 12:00	1			33			0											
07/01/22 13:00	1			33			0											
07/01/22 14:00	1			33			0											
07/01/22 15:00	1			33			0											
07/01/22 16:00	1			36			0											
07/01/22 17:00	1			44			10											
07/01/22 18:00	1			54			32											
07/01/22 19:00	1			62			54											
07/01/22 20:00	1			65			66											
07/01/22 21:00	1			66			67											
07/01/22 22:00	1			64			65											
07/01/22 23:00	1			54			47											
07/02/22 0:00	1			43			24											
07/02/22 1:00	1			34			4											
07/02/22 2:00	1			33			0											
07/02/22 3:00	1			33			0											
07/02/22 4:00	1			33			0											
07/02/22 5:00	1			33			0											
07/02/22 6:00	1			33			0											
07/02/22 7:00	1			33			0											
07/02/22 8:00	1			33			0											
07/02/22 9:00	1			33			0											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/02/22 10:00	1			33			0											
07/02/22 11:00	1			33			0											
07/02/22 12:00	1			33			0											
07/02/22 13:00	1			33			0											
07/02/22 14:00	1			33			0											
07/02/22 15:00	1			33			0											
07/02/22 16:00	1			33			0											
07/02/22 17:00	1			33			0											
07/02/22 18:00	1			33			0											
07/02/22 19:00	1			33			0											
07/02/22 20:00	1			33			0											
07/02/22 21:00	1			33			0											
07/02/22 22:00	1			33			0											
07/02/22 23:00	1			33			0											
07/03/22 0:00	1			33			0											
07/03/22 1:00	1			33			0											
07/03/22 2:00	1			33			0											
07/03/22 3:00	1			33			0											
07/03/22 4:00	1			33			0											
07/03/22 5:00	1			33			0											
07/03/22 6:00	1			33			0											
07/03/22 7:00	1			33			0											
07/03/22 8:00	1			33			0											
07/03/22 9:00	1			33			0											
07/03/22 10:00	1			33			0											
07/03/22 11:00	1			33			0											
07/03/22 12:00	1			33			0											
07/03/22 13:00	1			33			0											
07/03/22 14:00	1			33			0											
07/03/22 15:00	1			33			0											
07/03/22 16:00	1			33			0											
07/03/22 17:00	1			33			0											
07/03/22 18:00	1			33			0											
07/03/22 19:00	1			33			0											
07/03/22 20:00	1			33			0											
07/03/22 21:00	1			33			0											
07/03/22 22:00	1			33			0											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/03/22 23:00	1			33			0											
07/04/22 0:00	1			33			0											
07/04/22 1:00	1			33			0											
07/04/22 2:00	1			33			0											
07/04/22 3:00	1			33			0											
07/04/22 4:00	1			33			0											
07/04/22 5:00	1			33			0											
07/04/22 6:00	1			33			0											
07/04/22 7:00	1			33			0											
07/04/22 8:00	1			33			0											
07/04/22 9:00	1			33			0											
07/04/22 10:00	1			33			0											
07/04/22 11:00	1			33			0											
07/04/22 12:00	1			33			0											
07/04/22 13:00	1			33			0											
07/04/22 14:00	1			33			0											
07/04/22 15:00	1			33			0											
07/04/22 16:00	1			33			0											
07/04/22 17:00	1			33			0											
07/04/22 18:00	1			33			0											
07/04/22 19:00	1			33			0											
07/04/22 20:00	1			33			0											
07/04/22 21:00	1			33			0											
07/04/22 22:00	1			33			0											
07/04/22 23:00	1			33			0											
07/05/22 0:00	1			33			0											
07/05/22 1:00	1			33			0											
07/05/22 2:00	1			33			0											
07/05/22 3:00	1			33			0											
07/05/22 4:00	1			33			0											
07/05/22 5:00	1			33			0											
07/05/22 6:00	1			33			0											
07/05/22 7:00	1			33			0											
07/05/22 8:00	1			33			0											
07/05/22 9:00	1			33			0											
07/05/22 10:00	1			33			0											
07/05/22 11:00	1			33			0											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/05/22 12:00	1			34			0											
07/05/22 13:00	1			34			0											
07/05/22 14:00	1			36			0											
07/05/22 15:00	1			39			7											
07/05/22 16:00	1			49			28											
07/05/22 17:00	1			58			50											
07/05/22 18:00	1			65			65											
07/05/22 19:00	1			67			67											
07/05/22 20:00	1			67			67											
07/05/22 21:00	1			61			61											
07/05/22 22:00	1			54			39											
07/05/22 23:00	1			45			16											
07/06/22 0:00	1			40			0											
07/06/22 1:00	1			36			0											
07/06/22 2:00	1			33			0											
07/06/22 3:00	1			33			0											
07/06/22 4:00	1			33			0											
07/06/22 5:00	1			33			0											
07/06/22 6:00	1			33			0											
07/06/22 7:00	1			33			0											
07/06/22 8:00	1			33			0											
07/06/22 9:00	1			33			0											
07/06/22 10:00	1			33			0											
07/06/22 11:00	1			33			0											
07/06/22 12:00	1			33			0											
07/06/22 13:00	1			33			0											
07/06/22 14:00	1			33			0											
07/06/22 15:00	1			33			0											
07/06/22 16:00	1			36			0											
07/06/22 17:00	1			36			12											
07/06/22 18:00	1			46			32											
07/06/22 19:00	1			54			54											
07/06/22 20:00	1			65			65											
07/06/22 21:00	1			63			64											
07/06/22 22:00	1			54			48											
07/06/22 23:00	1			43			25											
07/07/22 0:00	1			35			6											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/07/22 1:00	1			33			0											
07/07/22 2:00	1			33			0											
07/07/22 3:00	1			33			0											
07/07/22 4:00	1			33			0											
07/07/22 5:00	1			33			0											
07/07/22 6:00	1			33			0											
07/07/22 7:00	1			33			0											
07/07/22 8:00	1			33			0											
07/07/22 9:00	1			33			0											
07/07/22 10:00	1			33			0											
07/07/22 11:00	1			33			0											
07/07/22 12:00	1			34			0											
07/07/22 13:00	1			34			0											
07/07/22 14:00	1			41			0											
07/07/22 15:00	1			43			11											
07/07/22 16:00	1			52			32											
07/07/22 17:00	1			57			55											
07/07/22 18:00	1			67			67											
07/07/22 19:00	1			68			68											
07/07/22 20:00	1			68			68											
07/07/22 21:00	1			66			67											
07/07/22 22:00	1			65			67											
07/07/22 23:00	1			58			55											
07/08/22 0:00	1			47			32											
07/08/22 1:00	1			37			10											
07/08/22 2:00	1			33			0											
07/08/22 3:00	1			33			0											
07/08/22 4:00	1			39			0											
07/08/22 5:00	1			42			0											
07/08/22 6:00	1			42			0											
07/08/22 7:00	1			36			0											
07/08/22 8:00	1			33			0											
07/08/22 9:00	1			33			0											
07/08/22 10:00	1			33			0											
07/08/22 11:00	1			33			0											
07/08/22 12:00	1			33			0											
07/08/22 13:00	1			36			0											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/08/22 14:00	1			38			9											
07/08/22 15:00	1			46			28											
07/08/22 16:00	1			49			45											
07/08/22 17:00	1			48			49											
07/08/22 18:00	1			45			38											
07/08/22 19:00	1			45			21											
07/08/22 20:00	1			54			8											
07/08/22 21:00	1			59			0											
07/08/22 22:00	1			63			0											
07/08/22 23:00	1			63			0											
07/09/22 0:00	1			63			0											
07/09/22 1:00	1			55			0											
07/09/22 2:00	1			45			0											
07/09/22 3:00	1			36			0											
07/09/22 4:00	1			35			0											
07/09/22 5:00	1			35			0											
07/09/22 6:00	1			34			0											
07/09/22 7:00	1			33			0											
07/09/22 8:00	1			33			0											
07/09/22 9:00	1			33			0											
07/09/22 10:00	1			33			0											
07/09/22 11:00	1			33			0											
07/09/22 12:00	1			33			0											
07/09/22 13:00	1			33			0											
07/09/22 14:00	1			33			0											
07/09/22 15:00	1			33			0											
07/09/22 16:00	1			36			0											
07/09/22 17:00	1			36			0											
07/09/22 18:00	1			36			0											
07/09/22 19:00	1			33			0											
07/09/22 20:00	1			33			0											
07/09/22 21:00	1			33			0											
07/09/22 22:00	1			33			0											
07/09/22 23:00	1			33			0											
07/10/22 0:00	1			33			0											
07/10/22 1:00	1			33			0											
07/10/22 2:00	1			33			0											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/10/22 3:00	1			33			0											
07/10/22 4:00	1			33			0											
07/10/22 5:00	1			33			0											
07/10/22 6:00	1			33			0											
07/10/22 7:00	1			33			0											
07/10/22 8:00	1			33			0											
07/10/22 9:00	1			33			0											
07/10/22 10:00	1			33			0											
07/10/22 11:00	1			33			0											
07/10/22 12:00	1			33			0											
07/10/22 13:00	1			33			0											
07/10/22 14:00	1			35			0											
07/10/22 15:00	1			38			11											
07/10/22 16:00	1			44			27											
07/10/22 17:00	1			50			47											
07/10/22 18:00	1			57			56											
07/10/22 19:00	1			60			60											
07/10/22 20:00	1			61			61											
07/10/22 21:00	1			59			60											
07/10/22 22:00	1			58			59											
07/10/22 23:00	1			58			59											
07/11/22 0:00	1			60			61											
07/11/22 1:00	1			61			62											
07/11/22 2:00	1			61			62											
07/11/22 3:00	1			61			62											
07/11/22 4:00	1			61			62											
07/11/22 5:00	1			58			59											
07/11/22 6:00	1			49			50											
07/11/22 7:00	1			39			40											
07/11/22 8:00	1			32			33											
07/11/22 9:00	1			32			33											
07/11/22 10:00	1			33			33											
07/11/22 11:00	1			36			36											
07/11/22 12:00	1			47			47											
07/11/22 13:00	1			58			58											
07/11/22 14:00	1			67			67											
07/11/22 15:00	1			68			68											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/11/22 16:00	1			68			68											
07/11/22 17:00	1			68			68											
07/11/22 18:00	1			68			68											
07/11/22 19:00	1			69			69											
07/11/22 20:00	1			69			69											
07/11/22 21:00	1			68			68											
07/11/22 22:00	1			67			68											
07/11/22 23:00	1			66			67											
07/12/22 0:00	1			67			68											
07/12/22 1:00	1			67			68											
07/12/22 2:00	1			67			68											
07/12/22 3:00	1			67			68											
07/12/22 4:00	1			68			69											
07/12/22 5:00	1			67			68											
07/12/22 6:00	1			59			60											
07/12/22 7:00	1			47			47											
07/12/22 8:00	1			35			36											
07/12/22 9:00	1			32			33											
07/12/22 10:00	1			32			33											
07/12/22 11:00	1			33			34											
07/12/22 12:00	1			35			36											
07/12/22 13:00	1			42			42											
07/12/22 14:00	1			53			53											
07/12/22 15:00	1			63			63											
07/12/22 16:00	1			67			67											
07/12/22 17:00	1			68			68											
07/12/22 18:00	1			68			68											
07/12/22 19:00	1			67			68											
07/12/22 20:00	1			65			66											
07/12/22 21:00	1			65			66											
07/12/22 22:00	1			61			62											
07/12/22 23:00	1			61			62											
07/13/22 0:00	1			59			60											
07/13/22 1:00	1			62			64											
07/13/22 2:00	1			62			64											
07/13/22 3:00	1			62			64											
07/13/22 4:00	1			66			68											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/13/22 5:00	1			69			70											
07/13/22 6:00	1			68			69											
07/13/22 7:00	1			55			56											
07/13/22 8:00	1			42			43											
07/13/22 9:00	1			33			34											
07/13/22 10:00	1			32			33											
07/13/22 11:00	1			32			33											
07/13/22 12:00	1			32			33											
07/13/22 13:00	1			32			33											
07/13/22 14:00	1			33			34											
07/13/22 15:00	1			44			45											
07/13/22 16:00	1			56			56											
07/13/22 17:00	1			60			60											
07/13/22 18:00	1			60			60											
07/13/22 19:00	1			60			60											
07/13/22 20:00	1			67			68											
07/13/22 21:00	1			68			68											
07/13/22 22:00	1			68			68											
07/13/22 23:00	1			61			61											
07/14/22 0:00	1			56			39											
07/14/22 1:00	1			49			16											
07/14/22 2:00	1			46			0											
07/14/22 3:00	1			43			0											
07/14/22 4:00	1			45			0											
07/14/22 5:00	1			51			0											
07/14/22 6:00	1			51			0											
07/14/22 7:00	1			46			0											
07/14/22 8:00	1			39			0											
07/14/22 9:00	1			35			0											
07/14/22 10:00	1			33			0											
07/14/22 11:00	1			33			0											
07/14/22 12:00	1			36			0											
07/14/22 13:00	1			38			8											
07/14/22 14:00	1			47			28											
07/14/22 15:00	1			56			50											
07/14/22 16:00	1			64			64											
07/14/22 17:00	1			67			67											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/14/22 18:00	1			68			68											
07/14/22 19:00	1			68			68											
07/14/22 20:00	1			68			68											
07/14/22 21:00	1			67			67											
07/14/22 22:00	1			67			67											
07/14/22 23:00	1			66			67											
07/15/22 0:00	1			62			63											
07/15/22 1:00	1			61			62											
07/15/22 2:00	1			62			63											
07/15/22 3:00	1			66			67											
07/15/22 4:00	1			67			68											
07/15/22 5:00	1			67			68											
07/15/22 6:00	1			61			62											
07/15/22 7:00	1			50			51											
07/15/22 8:00	1			38			39											
07/15/22 9:00	1			32			33											
07/15/22 10:00	1			32			33											
07/15/22 11:00	1			33			34											
07/15/22 12:00	1			34			35											
07/15/22 13:00	1			39			40											
07/15/22 14:00	1			50			50											
07/15/22 15:00	1			61			61											
07/15/22 16:00	1			67			67											
07/15/22 17:00	1			68			68											
07/15/22 18:00	1			70			70											
07/15/22 19:00	1			72			72											
07/15/22 20:00	1			72			73											
07/15/22 21:00	1			71			72											
07/15/22 22:00	1			71			72											
07/15/22 23:00	1			70			71											
07/16/22 0:00	1			68			69											
07/16/22 1:00	1			63			64											
07/16/22 2:00	1			61			62											
07/16/22 3:00	1			60			62											
07/16/22 4:00	1			62			64											
07/16/22 5:00	1			59			61											
07/16/22 6:00	1			52			53											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/16/22 7:00	1			42			43											
07/16/22 8:00	1			35			36											
07/16/22 9:00	1			33			34											
07/16/22 10:00	1			34			35											
07/16/22 11:00	1			34			35											
07/16/22 12:00	1			35			36											
07/16/22 13:00	1			39			39											
07/16/22 14:00	1			48			49											
07/16/22 15:00	1			61			62											
07/16/22 16:00	1			68			69											
07/16/22 17:00	1			71			71											
07/16/22 18:00	1			70			70											
07/16/22 19:00	1			70			70											
07/16/22 20:00	1			71			71											
07/16/22 21:00	1			72			72											
07/16/22 22:00	1			73			74											
07/16/22 23:00	1			72			73											
07/17/22 0:00	1			72			73											
07/17/22 1:00	1			72			73											
07/17/22 2:00	1			73			75											
07/17/22 3:00	1			73			75											
07/17/22 4:00	1			73			75											
07/17/22 5:00	1			70			71											
07/17/22 6:00	1			63			65											
07/17/22 7:00	1			50			52											
07/17/22 8:00	1			42			44											
07/17/22 9:00	1			36			37											
07/17/22 10:00	1			36			37											
07/17/22 11:00	1			40			41											
07/17/22 12:00	1			51			52											
07/17/22 13:00	1			62			63											
07/17/22 14:00	1			67			67											
07/17/22 15:00	1			68			68											
07/17/22 16:00	1			69			69											
07/17/22 17:00	1			70			70											
07/17/22 18:00	1			71			71											
07/17/22 19:00	1			72			72											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/17/22 20:00	1			73			74											
07/17/22 21:00	1			72			73											
07/17/22 22:00	1			70			71											
07/17/22 23:00	1			67			68											
07/18/22 0:00	1			66			67											
07/18/22 1:00	1			66			66											
07/18/22 2:00	1			55			56											
07/18/22 3:00	1			44			45											
07/18/22 4:00	1			35			36											
07/18/22 5:00	1			45			47											
07/18/22 6:00	1			56			58											
07/18/22 7:00	1			60			61											
07/18/22 8:00	1			52			53											
07/18/22 9:00	1			51			52											
07/18/22 10:00	1			57			58											
07/18/22 11:00	1			66			67											
07/18/22 12:00	1			67			67											
07/18/22 13:00	1			69			69											
07/18/22 14:00	1			69			69											
07/18/22 15:00	1			72			72											
07/18/22 16:00	1			72			73											
07/18/22 17:00	1			74			75											
07/18/22 18:00	1			74			75											
07/18/22 19:00	1			73			74											
07/18/22 20:00	1			74			75											
07/18/22 21:00	1			72			73											
07/18/22 22:00	1			70			71											
07/18/22 23:00	1			64			65											
07/19/22 0:00	1			53			54											
07/19/22 1:00	1			42			43											
07/19/22 2:00	1			34			35											
07/19/22 3:00	1			34			35											
07/19/22 4:00	1			34			35											
07/19/22 5:00	1			34			35											
07/19/22 6:00	1			34			35											
07/19/22 7:00	1			33			34											
07/19/22 8:00	1			32			33											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/19/22 9:00	1			32			33											
07/19/22 10:00	1			34			35											
07/19/22 11:00	1			41			42											
07/19/22 12:00	1			53			54											
07/19/22 13:00	1			63			64											
07/19/22 14:00	1			68			68											
07/19/22 15:00	1			67			67											
07/19/22 16:00	1			68			69											
07/19/22 17:00	1			70			71											
07/19/22 18:00	1			73			74											
07/19/22 19:00	1			74			75											
07/19/22 20:00	1			72			73											
07/19/22 21:00	1			69			70											
07/19/22 22:00	1			66			67											
07/19/22 23:00	1			61			62											
07/20/22 0:00	1			49			50											
07/20/22 1:00	1			38			39											
07/20/22 2:00	1			32			33											
07/20/22 3:00	1			32			33											
07/20/22 4:00	1			32			33											
07/20/22 5:00	1			32			33											
07/20/22 6:00	1			33			34											
07/20/22 7:00	1			33			34											
07/20/22 8:00	1			33			34											
07/20/22 9:00	1			33			34											
07/20/22 10:00	1			33			34											
07/20/22 11:00	1			34			34											
07/20/22 12:00	1			40			41											
07/20/22 13:00	1			52			53											
07/20/22 14:00	1			66			67											
07/20/22 15:00	1			70			71											
07/20/22 16:00	1			70			71											
07/20/22 17:00	1			69			70											
07/20/22 18:00	1			71			72											
07/20/22 19:00	1			73			74											
07/20/22 20:00	1			72			72											
07/20/22 21:00	1			64			65											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/20/22 22:00	1			51			52											
07/20/22 23:00	1			39			39											
07/21/22 0:00	1			34			34											
07/21/22 1:00	1			33			34											
07/21/22 2:00	1			33			34											
07/21/22 3:00	1			33			34											
07/21/22 4:00	1			33			34											
07/21/22 5:00	1			33			34											
07/21/22 6:00	1			32			33											
07/21/22 7:00	1			32			33											
07/21/22 8:00	1			32			33											
07/21/22 9:00	1			32			33											
07/21/22 10:00	1			32			33											
07/21/22 11:00	1			32			33											
07/21/22 12:00	1			32			33											
07/21/22 13:00	1			36			37											
07/21/22 14:00	1			48			49											
07/21/22 15:00	1			59			60											
07/21/22 16:00	1			67			67											
07/21/22 17:00	1			67			68											
07/21/22 18:00	1			68			69											
07/21/22 19:00	1			68			69											
07/21/22 20:00	1			68			69											
07/21/22 21:00	1			63			64											
07/21/22 22:00	1			52			53											
07/21/22 23:00	1			40			41											
07/22/22 0:00	1			33			34											
07/22/22 1:00	1			34			35											
07/22/22 2:00	1			36			37											
07/22/22 3:00	1			36			37											
07/22/22 4:00	1			36			37											
07/22/22 5:00	1			34			35											
07/22/22 6:00	1			34			35											
07/22/22 7:00	1			33			34											
07/22/22 8:00	1			32			33											
07/22/22 9:00	1			32			33											
07/22/22 10:00	1			32			33											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/22/22 11:00	1			32			33											
07/22/22 12:00	1			32			33											
07/22/22 13:00	1			32			33											
07/22/22 14:00	1			37			38											
07/22/22 15:00	1			48			49											
07/22/22 16:00	1			59			60											
07/22/22 17:00	1			66			67											
07/22/22 18:00	1			66			67											
07/22/22 19:00	1			66			67											
07/22/22 20:00	1			66			67											
07/22/22 21:00	1			61			62											
07/22/22 22:00	1			51			52											
07/22/22 23:00	1			42			38											
07/23/22 0:00	1			38			20											
07/23/22 1:00	1			38			8											
07/23/22 2:00	1			38			0											
07/23/22 3:00	1			37			0											
07/23/22 4:00	1			36			0											
07/23/22 5:00	1			35			0											
07/23/22 6:00	1			44			0											
07/23/22 7:00	1			54			0											
07/23/22 8:00	1			63			0											
07/23/22 9:00	1			58			0											
07/23/22 10:00	1			48			0											
07/23/22 11:00	1			38			0											
07/23/22 12:00	1			33			0											
07/23/22 13:00	1			33			0											
07/23/22 14:00	1			33			0											
07/23/22 15:00	1			35			0											
07/23/22 16:00	1			36			8											
07/23/22 17:00	1			41			24											
07/23/22 18:00	1			52			48											
07/23/22 19:00	1			63			63											
07/23/22 20:00	1			69			69											
07/23/22 21:00	1			65			65											
07/23/22 22:00	1			56			49											
07/23/22 23:00	1			54			26											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/24/22 0:00	1			54			7											
07/24/22 1:00	1			60			0											
07/24/22 2:00	1			60			0											
07/24/22 3:00	1			60			0											
07/24/22 4:00	1			60			0											
07/24/22 5:00	1			53			8											
07/24/22 6:00	1			44			19											
07/24/22 7:00	1			35			31											
07/24/22 8:00	1			33			34											
07/24/22 9:00	1			32			33											
07/24/22 10:00	1			32			33											
07/24/22 11:00	1			32			33											
07/24/22 12:00	1			32			33											
07/24/22 13:00	1			32			33											
07/24/22 14:00	1			32			33											
07/24/22 15:00	1			32			33											
07/24/22 16:00	1			39			39											
07/24/22 17:00	1			50			51											
07/24/22 18:00	1			62			62											
07/24/22 19:00	1			67			67											
07/24/22 20:00	1			63			64											
07/24/22 21:00	1			52			53											
07/24/22 22:00	1			40			41											
07/24/22 23:00	1			33			34											
07/25/22 0:00	1			33			34											
07/25/22 1:00	1			33			34											
07/25/22 2:00	1			32			33											
07/25/22 3:00	1			32			33											
07/25/22 4:00	1			33			34											
07/25/22 5:00	1			33			34											
07/25/22 6:00	1			34			35											
07/25/22 7:00	1			34			35											
07/25/22 8:00	1			33			34											
07/25/22 9:00	1			33			34											
07/25/22 10:00	1			32			33											
07/25/22 11:00	1			33			33											
07/25/22 12:00	1			33			34											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/25/22 13:00	1			40			41											
07/25/22 14:00	1			51			52											
07/25/22 15:00	1			63			63											
07/25/22 16:00	1			68			68											
07/25/22 17:00	1			69			69											
07/25/22 18:00	1			70			70											
07/25/22 19:00	1			69			70											
07/25/22 20:00	1			68			69											
07/25/22 21:00	1			67			68											
07/25/22 22:00	1			61			62											
07/25/22 23:00	1			53			54											
07/26/22 0:00	1			42			43											
07/26/22 1:00	1			37			38											
07/26/22 2:00	1			34			35											
07/26/22 3:00	1			34			35											
07/26/22 4:00	1			41			42											
07/26/22 5:00	1			51			52											
07/26/22 6:00	1			54			55											
07/26/22 7:00	1			47			48											
07/26/22 8:00	1			36			37											
07/26/22 9:00	1			33			34											
07/26/22 10:00	1			33			34											
07/26/22 11:00	1			33			34											
07/26/22 12:00	1			34			35											
07/26/22 13:00	1			41			42											
07/26/22 14:00	1			52			53											
07/26/22 15:00	1			63			63											
07/26/22 16:00	1			67			67											
07/26/22 17:00	1			69			69											
07/26/22 18:00	1			69			69											
07/26/22 19:00	1			69			69											
07/26/22 20:00	1			68			68											
07/26/22 21:00	1			67			67											
07/26/22 22:00	1			66			67											
07/26/22 23:00	1			61			62											
07/27/22 0:00	1			50			51											
07/27/22 1:00	1			39			40											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/27/22 2:00	1			34			35											
07/27/22 3:00	1			34			35											
07/27/22 4:00	1			34			35											
07/27/22 5:00	1			35			36											
07/27/22 6:00	1			37			38											
07/27/22 7:00	1			37			38											
07/27/22 8:00	1			36			37											
07/27/22 9:00	1			34			35											
07/27/22 10:00	1			34			35											
07/27/22 11:00	1			34			35											
07/27/22 12:00	1			34			35											
07/27/22 13:00	1			43			44											
07/27/22 14:00	1			54			54											
07/27/22 15:00	1			65			65											
07/27/22 16:00	1			67			67											
07/27/22 17:00	1			69			69											
07/27/22 18:00	1			69			69											
07/27/22 19:00	1			68			69											
07/27/22 20:00	1			66			67											
07/27/22 21:00	1			64			65											
07/27/22 22:00	1			57			58											
07/27/22 23:00	1			50			51											
07/28/22 0:00	1			44			45											
07/28/22 1:00	1			41			42											
07/28/22 2:00	1			37			38											
07/28/22 3:00	1			41			42											
07/28/22 4:00	1			51			52											
07/28/22 5:00	1			59			60											
07/28/22 6:00	1			59			60											
07/28/22 7:00	1			53			54											
07/28/22 8:00	1			44			45											
07/28/22 9:00	1			39			40											
07/28/22 10:00	1			42			43											
07/28/22 11:00	1			53			54											
07/28/22 12:00	1			64			65											
07/28/22 13:00	1			67			67											
07/28/22 14:00	1			68			68											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/28/22 15:00	1			68			68											
07/28/22 16:00	1			68			68											
07/28/22 17:00	1			69			69											
07/28/22 18:00	1			71			71											
07/28/22 19:00	1			72			72											
07/28/22 20:00	1			70			71											
07/28/22 21:00	1			68			69											
07/28/22 22:00	1			64			65											
07/28/22 23:00	1			53			54											
07/29/22 0:00	1			42			43											
07/29/22 1:00	1			34			35											
07/29/22 2:00	1			33			34											
07/29/22 3:00	1			34			35											
07/29/22 4:00	1			43			44											
07/29/22 5:00	1			54			55											
07/29/22 6:00	1			58			59											
07/29/22 7:00	1			49			50											
07/29/22 8:00	1			38			39											
07/29/22 9:00	1			34			35											
07/29/22 10:00	1			34			35											
07/29/22 11:00	1			36			37											
07/29/22 12:00	1			46			47											
07/29/22 13:00	1			57			58											
07/29/22 14:00	1			67			67											
07/29/22 15:00	1			67			67											
07/29/22 16:00	1			67			67											
07/29/22 17:00	1			67			67											
07/29/22 18:00	1			67			67											
07/29/22 19:00	1			67			67											
07/29/22 20:00	1			66			67											
07/29/22 21:00	1			66			67											
07/29/22 22:00	1			66			67											
07/29/22 23:00	1			67			68											
07/30/22 0:00	1			66			67											
07/30/22 1:00	1			66			67											
07/30/22 2:00	1			62			63											
07/30/22 3:00	1			58			60											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/30/22 4:00	1			58			60											
07/30/22 5:00	1			63			64											
07/30/22 6:00	1			64			66											
07/30/22 7:00	1			55			57											
07/30/22 8:00	1			44			46											
07/30/22 9:00	1			35			36											
07/30/22 10:00	1			33			34											
07/30/22 11:00	1			37			37											
07/30/22 12:00	1			48			48											
07/30/22 13:00	1			60			60											
07/30/22 14:00	1			69			69											
07/30/22 15:00	1			72			72											
07/30/22 16:00	1			75			75											
07/30/22 17:00	1			75			75											
07/30/22 18:00	1			71			71											
07/30/22 19:00	1			68			68											
07/30/22 20:00	1			67			67											
07/30/22 21:00	1			67			68											
07/30/22 22:00	1			67			68											
07/30/22 23:00	1			67			68											
07/31/22 0:00	1			66			67											
07/31/22 1:00	1			66			67											
07/31/22 2:00	1			66			67											
07/31/22 3:00	1			63			64											
07/31/22 4:00	1			52			53											
07/31/22 5:00	1			46			47											
07/31/22 6:00	1			43			44											
07/31/22 7:00	1			44			45											
07/31/22 8:00	1			39			40											
07/31/22 9:00	1			33			34											
07/31/22 10:00	1			39			40											
07/31/22 11:00	1			51			52											
07/31/22 12:00	1			61			62											
07/31/22 13:00	1			66			67											
07/31/22 14:00	1			67			68											
07/31/22 15:00	1			68			69											
07/31/22 16:00	1			69			70											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/31/22 17:00	1			70			71											
07/31/22 18:00	1			70			70											
07/31/22 19:00	1			69			69											
07/31/22 20:00	1			67			67											
07/31/22 21:00	1			67			67											
07/31/22 22:00	1			64			65											
07/31/22 23:00	1			53			54											
08/01/22 0:00	1			48			49											
08/01/22 1:00	1			40			41											
08/01/22 2:00	1			39			40											
08/01/22 3:00	1			40			41											
08/01/22 4:00	1			50			51											
08/01/22 5:00	1			62			63											
08/01/22 6:00	1			70			71											
08/01/22 7:00	1			70			71											
08/01/22 8:00	1			69			70											
08/01/22 9:00	1			66			67											
08/01/22 10:00	1			67			67											
08/01/22 11:00	1			67			67											
08/01/22 12:00	1			67			67											
08/01/22 13:00	1			67			67											
08/01/22 14:00	1			66			67											
08/01/22 15:00	1			67			67											
08/01/22 16:00	1			67			67											
08/01/22 17:00	1			67			67											
08/01/22 18:00	1			67			67											
08/01/22 19:00	1			67			67											
08/01/22 20:00	1			67			67											
08/01/22 21:00	1			67			67											
08/01/22 22:00	1			65			65											
08/01/22 23:00	1			54			55											
08/02/22 0:00	1			43			44											
08/02/22 1:00	1			34			35											
08/02/22 2:00	1			33			34											
08/02/22 3:00	1			33			34											
08/02/22 4:00	1			39			40											
08/02/22 5:00	1			50			51											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/02/22 6:00	1			55			56											
08/02/22 7:00	1			49			50											
08/02/22 8:00	1			38			39											
08/02/22 9:00	1			32			33											
08/02/22 10:00	1			32			33											
08/02/22 11:00	1			38			39											
08/02/22 12:00	1			50			50											
08/02/22 13:00	1			61			62											
08/02/22 14:00	1			67			67											
08/02/22 15:00	1			67			67											
08/02/22 16:00	1			69			69											
08/02/22 17:00	1			72			72											
08/02/22 18:00	1			73			73											
08/02/22 19:00	1			71			71											
08/02/22 20:00	1			68			68											
08/02/22 21:00	1			67			67											
08/02/22 22:00	1			67			67											
08/02/22 23:00	1			66			67											
08/03/22 0:00	1			58			59											
08/03/22 1:00	1			47			48											
08/03/22 2:00	1			36			37											
08/03/22 3:00	1			34			35											
08/03/22 4:00	1			40			41											
08/03/22 5:00	1			50			51											
08/03/22 6:00	1			54			55											
08/03/22 7:00	1			48			49											
08/03/22 8:00	1			37			38											
08/03/22 9:00	1			33			34											
08/03/22 10:00	1			33			34											
08/03/22 11:00	1			34			35											
08/03/22 12:00	1			37			38											
08/03/22 13:00	1			48			48											
08/03/22 14:00	1			59			59											
08/03/22 15:00	1			67			67											
08/03/22 16:00	1			67			67											
08/03/22 17:00	1			71			71											
08/03/22 18:00	1			75			75											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/03/22 19:00	1			79			79											
08/03/22 20:00	1			78			78											
08/03/22 21:00	1			74			74											
08/03/22 22:00	1			69			70											
08/03/22 23:00	1			66			67											
08/04/22 0:00	1			66			67											
08/04/22 1:00	1			66			67											
08/04/22 2:00	1			65			66											
08/04/22 3:00	1			55			56											
08/04/22 4:00	1			49			50											
08/04/22 5:00	1			50			51											
08/04/22 6:00	1			59			60											
08/04/22 7:00	1			60			61											
08/04/22 8:00	1			55			56											
08/04/22 9:00	1			56			57											
08/04/22 10:00	1			61			62											
08/04/22 11:00	1			66			67											
08/04/22 12:00	1			67			67											
08/04/22 13:00	1			69			69											
08/04/22 14:00	1			73			73											
08/04/22 15:00	1			76			77											
08/04/22 16:00	1			78			79											
08/04/22 17:00	1			77			78											
08/04/22 18:00	1			75			76											
08/04/22 19:00	1			73			74											
08/04/22 20:00	1			70			71											
08/04/22 21:00	1			68			69											
08/04/22 22:00	1			66			67											
08/04/22 23:00	1			61			62											
08/05/22 0:00	1			51			52											
08/05/22 1:00	1			41			42											
08/05/22 2:00	1			38			39											
08/05/22 3:00	1			36			37											
08/05/22 4:00	1			39			40											
08/05/22 5:00	1			48			49											
08/05/22 6:00	1			59			60											
08/05/22 7:00	1			66			67											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/05/22 8:00	1			66			67											
08/05/22 9:00	1			66			67											
08/05/22 10:00	1			66			67											
08/05/22 11:00	1			66			67											
08/05/22 12:00	1			66			67											
08/05/22 13:00	1			67			67											
08/05/22 14:00	1			67			67											
08/05/22 15:00	1			67			67											
08/05/22 16:00	1			67			67											
08/05/22 17:00	1			67			67											
08/05/22 18:00	1			67			67											
08/05/22 19:00	1			67			67											
08/05/22 20:00	1			67			67											
08/05/22 21:00	1			67			67											
08/05/22 22:00	1			64			64											
08/05/22 23:00	1			53			54											
08/06/22 0:00	1			42			43											
08/06/22 1:00	1			34			35											
08/06/22 2:00	1			33			34											
08/06/22 3:00	1			32			33											
08/06/22 4:00	1			32			33											
08/06/22 5:00	1			32			33											
08/06/22 6:00	1			32			33											
08/06/22 7:00	1			32			33											
08/06/22 8:00	1			32			33											
08/06/22 9:00	1			32			33											
08/06/22 10:00	1			32			33											
08/06/22 11:00	1			32			33											
08/06/22 12:00	1			32			33											
08/06/22 13:00	1			32			33											
08/06/22 14:00	1			32			33											
08/06/22 15:00	1			32			33											
08/06/22 16:00	1			32			33											
08/06/22 17:00	1			33			34											
08/06/22 18:00	1			41			42											
08/06/22 19:00	1			49			50											
08/06/22 20:00	1			59			60											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/06/22 21:00	1			60			62											
08/06/22 22:00	1			52			54											
08/06/22 23:00	1			41			43											
08/07/22 0:00	1			33			35											
08/07/22 1:00	1			34			35											
08/07/22 2:00	1			33			34											
08/07/22 3:00	1			33			34											
08/07/22 4:00	1			33			34											
08/07/22 5:00	1			33			34											
08/07/22 6:00	1			34			35											
08/07/22 7:00	1			33			34											
08/07/22 8:00	1			32			33											
08/07/22 9:00	1			32			33											
08/07/22 10:00	1			32			33											
08/07/22 11:00	1			32			33											
08/07/22 12:00	1			32			33											
08/07/22 13:00	1			32			33											
08/07/22 14:00	1			32			33											
08/07/22 15:00	1			33			33											
08/07/22 16:00	1			35			36											
08/07/22 17:00	1			45			46											
08/07/22 18:00	1			56			57											
08/07/22 19:00	1			65			66											
08/07/22 20:00	1			66			67											
08/07/22 21:00	1			66			67											
08/07/22 22:00	1			60			62											
08/07/22 23:00	1			50			51											
08/08/22 0:00	1			39			41											
08/08/22 1:00	1			34			35											
08/08/22 2:00	1			34			35											
08/08/22 3:00	1			34			35											
08/08/22 4:00	1			40			42											
08/08/22 5:00	1			51			52											
08/08/22 6:00	1			56			57											
08/08/22 7:00	1			49			50											
08/08/22 8:00	1			38			39											
08/08/22 9:00	1			33			34											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/08/22 10:00	1			33			34											
08/08/22 11:00	1			40			41											
08/08/22 12:00	1			51			52											
08/08/22 13:00	1			54			54											
08/08/22 14:00	1			53			54											
08/08/22 15:00	1			53			54											
08/08/22 16:00	1			61			62											
08/08/22 17:00	1			68			68											
08/08/22 18:00	1			70			70											
08/08/22 19:00	1			72			73											
08/08/22 20:00	1			73			74											
08/08/22 21:00	1			72			73											
08/08/22 22:00	1			70			71											
08/08/22 23:00	1			67			68											
08/09/22 0:00	1			66			67											
08/09/22 1:00	1			66			67											
08/09/22 2:00	1			66			67											
08/09/22 3:00	1			66			67											
08/09/22 4:00	1			66			67											
08/09/22 5:00	1			66			67											
08/09/22 6:00	1			66			67											
08/09/22 7:00	1			66			67											
08/09/22 8:00	1			66			67											
08/09/22 9:00	1			66			67											
08/09/22 10:00	1			66			67											
08/09/22 11:00	1			66			67											
08/09/22 12:00	1			66			67											
08/09/22 13:00	1			56			57											
08/09/22 14:00	1			51			52											
08/09/22 15:00	1			52			52											
08/09/22 16:00	1			62			62											
08/09/22 17:00	1			67			67											
08/09/22 18:00	1			69			69											
08/09/22 19:00	1			70			70											
08/09/22 20:00	1			72			73											
08/09/22 21:00	1			72			73											
08/09/22 22:00	1			71			73											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/09/22 23:00	1			69			70											
08/10/22 0:00	1			64			66											
08/10/22 1:00	1			61			63											
08/10/22 2:00	1			59			61											
08/10/22 3:00	1			61			62											
08/10/22 4:00	1			65			66											
08/10/22 5:00	1			68			69											
08/10/22 6:00	1			63			64											
08/10/22 7:00	1			51			52											
08/10/22 8:00	1			39			40											
08/10/22 9:00	1			34			35											
08/10/22 10:00	1			34			35											
08/10/22 11:00	1			35			36											
08/10/22 12:00	1			35			36											
08/10/22 13:00	1			37			38											
08/10/22 14:00	1			46			46											
08/10/22 15:00	1			58			58											
08/10/22 16:00	1			67			67											
08/10/22 17:00	1			69			69											
08/10/22 18:00	1			70			70											
08/10/22 19:00	1			72			72											
08/10/22 20:00	1			73			74											
08/10/22 21:00	1			71			72											
08/10/22 22:00	1			67			68											
08/10/22 23:00	1			63			64											
08/11/22 0:00	1			59			60											
08/11/22 1:00	1			58			59											
08/11/22 2:00	1			57			58											
08/11/22 3:00	1			56			57											
08/11/22 4:00	1			56			57											
08/11/22 5:00	1			58			59											
08/11/22 6:00	1			55			56											
08/11/22 7:00	1			49			50											
08/11/22 8:00	1			40			41											
08/11/22 9:00	1			36			37											
08/11/22 10:00	1			34			35											
08/11/22 11:00	1			40			41											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/11/22 12:00	1			47			48											
08/11/22 13:00	1			60			61											
08/11/22 14:00	1			66			67											
08/11/22 15:00	1			72			72											
08/11/22 16:00	1			72			72											
08/11/22 17:00	1			73			73											
08/11/22 18:00	1			73			74											
08/11/22 19:00	1			74			75											
08/11/22 20:00	1			75			76											
08/11/22 21:00	1			72			73											
08/11/22 22:00	1			67			68											
08/11/22 23:00	1			61			62											
08/12/22 0:00	1			60			61											
08/12/22 1:00	1			61			62											
08/12/22 2:00	1			60			61											
08/12/22 3:00	1			58			60											
08/12/22 4:00	1			58			60											
08/12/22 5:00	1			60			62											
08/12/22 6:00	1			55			56											
08/12/22 7:00	1			48			49											
08/12/22 8:00	1			39			40											
08/12/22 9:00	1			36			37											
08/12/22 10:00	1			33			34											
08/12/22 11:00	1			34			34											
08/12/22 12:00	1			37			38											
08/12/22 13:00	1			48			48											
08/12/22 14:00	1			59			60											
08/12/22 15:00	1			67			68											
08/12/22 16:00	1			67			68											
08/12/22 17:00	1			69			70											
08/12/22 18:00	1			72			72											
08/12/22 19:00	1			74			74											
08/12/22 20:00	1			73			73											
08/12/22 21:00	1			69			70											
08/12/22 22:00	1			62			63											
08/12/22 23:00	1			58			59											
08/13/22 0:00	1			55			56											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/13/22 1:00	1			57			58											
08/13/22 2:00	1			57			58											
08/13/22 3:00	1			57			59											
08/13/22 4:00	1			58			60											
08/13/22 5:00	1			59			61											
08/13/22 6:00	1			54			56											
08/13/22 7:00	1			45			47											
08/13/22 8:00	1			37			38											
08/13/22 9:00	1			33			34											
08/13/22 10:00	1			33			34											
08/13/22 11:00	1			34			34											
08/13/22 12:00	1			36			37											
08/13/22 13:00	1			43			43											
08/13/22 14:00	1			54			54											
08/13/22 15:00	1			62			62											
08/13/22 16:00	1			67			67											
08/13/22 17:00	1			68			68											
08/13/22 18:00	1			69			69											
08/13/22 19:00	1			69			69											
08/13/22 20:00	1			66			66											
08/13/22 21:00	1			55			56											
08/13/22 22:00	1			47			48											
08/13/22 23:00	1			44			45											
08/14/22 0:00	1			47			48											
08/14/22 1:00	1			49			50											
08/14/22 2:00	1			48			49											
08/14/22 3:00	1			49			50											
08/14/22 4:00	1			49			50											
08/14/22 5:00	1			47			48											
08/14/22 6:00	1			51			53											
08/14/22 7:00	1			57			58											
08/14/22 8:00	1			55			56											
08/14/22 9:00	1			45			46											
08/14/22 10:00	1			40			41											
08/14/22 11:00	1			50			51											
08/14/22 12:00	1			62			63											
08/14/22 13:00	1			68			69											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/14/22 14:00	1			60			61											
08/14/22 15:00	1			51			52											
08/14/22 16:00	1			43			44											
08/14/22 17:00	1			49			50											
08/14/22 18:00	1			57			57											
08/14/22 19:00	1			64			65											
08/14/22 20:00	1			64			64											
08/14/22 21:00	1			53			54											
08/14/22 22:00	1			43			44											
08/14/22 23:00	1			35			36											
08/15/22 0:00	1			34			35											
08/15/22 1:00	1			34			35											
08/15/22 2:00	1			34			35											
08/15/22 3:00	1			35			36											
08/15/22 4:00	1			38			39											
08/15/22 5:00	1			44			45											
08/15/22 6:00	1			44			45											
08/15/22 7:00	1			40			41											
08/15/22 8:00	1			34			35											
08/15/22 9:00	1			32			33											
08/15/22 10:00	1			34			35											
08/15/22 11:00	1			35			36											
08/15/22 12:00	1			36			37											
08/15/22 13:00	1			46			46											
08/15/22 14:00	1			59			60											
08/15/22 15:00	1			72			72											
08/15/22 16:00	1			76			76											
08/15/22 17:00	1			76			77											
08/15/22 18:00	1			76			77											
08/15/22 19:00	1			75			76											
08/15/22 20:00	1			72			73											
08/15/22 21:00	1			63			64											
08/15/22 22:00	1			53			54											
08/15/22 23:00	1			47			48											
08/16/22 0:00	1			47			48											
08/16/22 1:00	1			48			49											
08/16/22 2:00	1			47			48											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/16/22 3:00	1			44			45											
08/16/22 4:00	1			45			46											
08/16/22 5:00	1			48			50											
08/16/22 6:00	1			48			49											
08/16/22 7:00	1			43			44											
08/16/22 8:00	1			36			36											
08/16/22 9:00	1			35			35											
08/16/22 10:00	1			39			40											
08/16/22 11:00	1			44			45											
08/16/22 12:00	1			50			51											
08/16/22 13:00	1			61			61											
08/16/22 14:00	1			71			71											
08/16/22 15:00	1			79			79											
08/16/22 16:00	1			81			81											
08/16/22 17:00	1			81			81											
08/16/22 18:00	1			81			81											
08/16/22 19:00	1			80			80											
08/16/22 20:00	1			78			79											
08/16/22 21:00	1			75			76											
08/16/22 22:00	1			72			73											
08/16/22 23:00	1			66			67											
08/17/22 0:00	1			62			63											
08/17/22 1:00	1			59			60											
08/17/22 2:00	1			58			59											
08/17/22 3:00	1			57			58											
08/17/22 4:00	1			58			59											
08/17/22 5:00	1			59			60											
08/17/22 6:00	1			60			61											
08/17/22 7:00	1			57			57											
08/17/22 8:00	1			36			57											
08/17/22 9:00	1			16			56											
08/17/22 10:00	1			0			60											
08/17/22 11:00	1			0			59											
08/17/22 12:00	1			0			58											
08/17/22 13:00	1			0			58											
08/17/22 14:00	1			0			57											
08/17/22 15:00	1			0			57											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/17/22 16:00	1			0			57											
08/17/22 17:00	1			0			58											
08/17/22 18:00	1			0			58											
08/17/22 19:00	1			0			58											
08/17/22 20:00	1			0			58											
08/17/22 21:00	1			0			58											
08/17/22 22:00	1			0			58											
08/17/22 23:00	1			0			50											
08/18/22 0:00	1			0			42											
08/18/22 1:00	1			0			34											
08/18/22 2:00	1			0			34											
08/18/22 3:00	1			0			34											
08/18/22 4:00	1			0			34											
08/18/22 5:00	1			0			34											
08/18/22 6:00	1			0			34											
08/18/22 7:00	1			0			33											
08/18/22 8:00	1			0			32											
08/18/22 9:00	1			0			31											
08/18/22 10:00	1			0			31											
08/18/22 11:00	1			0			31											
08/18/22 12:00	1			0			31											
08/18/22 13:00	1			0			37											
08/18/22 14:00	1			0			48											
08/18/22 15:00	1			0			60											
08/18/22 16:00	1			0			66											
08/18/22 17:00	1			0			68											
08/18/22 18:00	1			0			67											
08/18/22 19:00	1			0			65											
08/18/22 20:00	1			0			63											
08/18/22 21:00	1			0			63											
08/18/22 22:00	1			0			63											
08/18/22 23:00	1			0			63											
08/19/22 0:00	1			0			63											
08/19/22 1:00	1			0			63											
08/19/22 2:00	1			0			63											
08/19/22 3:00	1			0			63											
08/19/22 4:00	1			0			63											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/19/22 5:00	1			0			63											
08/19/22 6:00	1			0			63											
08/19/22 7:00	1			0			63											
08/19/22 8:00	1			0			56											
08/19/22 9:00	1			0			46											
08/19/22 10:00	1			0			37											
08/19/22 11:00	1			9			35											
08/19/22 12:00	1			19			36											
08/19/22 13:00	1			30			35											
08/19/22 14:00	1			33			34											
08/19/22 15:00	1			34			35											
08/19/22 16:00	1			35			36											
08/19/22 17:00	1			42			43											
08/19/22 18:00	1			48			49											
08/19/22 19:00	1			52			53											
08/19/22 20:00	1			49			50											
08/19/22 21:00	1			43			34											
08/19/22 22:00	1			38			18											
08/19/22 23:00	1			34			3											
08/20/22 0:00	1			33			0											
08/20/22 1:00	1			33			0											
08/20/22 2:00	1			33			0											
08/20/22 3:00	1			33			0											
08/20/22 4:00	1			32			0											
08/20/22 5:00	1			31			0											
08/20/22 6:00	1			31			0											
08/20/22 7:00	1			31			0											
08/20/22 8:00	1			31			0											
08/20/22 9:00	1			31			0											
08/20/22 10:00	1			31			0											
08/20/22 11:00	1			31			0											
08/20/22 12:00	1			31			0											
08/20/22 13:00	1			31			0											
08/20/22 14:00	1			34			0											
08/20/22 15:00	1			38			11											
08/20/22 16:00	1			27			29											
08/20/22 17:00	1			14			48											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/20/22 18:00	1			0			58											
08/20/22 19:00	1			0			61											
08/20/22 20:00	1			0			63											
08/20/22 21:00	1			0			63											
08/20/22 22:00	1			0			63											
08/20/22 23:00	1			0			63											
08/21/22 0:00	1			0			63											
08/21/22 1:00	1			0			63											
08/21/22 2:00	1			0			63											
08/21/22 3:00	1			0			57											
08/21/22 4:00	1			0			46											
08/21/22 5:00	1			0			39											
08/21/22 6:00	1			0			36											
08/21/22 7:00	1			0			37											
08/21/22 8:00	1			8			38											
08/21/22 9:00	1			18			37											
08/21/22 10:00	1			31			38											
08/21/22 11:00	1			39			40											
08/21/22 12:00	1			49			49											
08/21/22 13:00	1			58			57											
08/21/22 14:00	1			62			59											
08/21/22 15:00	1			62			54											
08/21/22 16:00	1			62			48											
08/21/22 17:00	1			65			53											
08/21/22 18:00	1			67			61											
08/21/22 19:00	1			69			69											
08/21/22 20:00	1			67			63											
08/21/22 21:00	1			64			57											
08/21/22 22:00	1			63			50											
08/21/22 23:00	1			63			49											
08/22/22 0:00	1			64			45											
08/22/22 1:00	1			64			41											
08/22/22 2:00	1			64			35											
08/22/22 3:00	1			64			33											
08/22/22 4:00	1			64			36											
08/22/22 5:00	1			61			46											
08/22/22 6:00	1			40			55											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/22/22 7:00	1			19			61											
08/22/22 8:00	1			0			60											
08/22/22 9:00	1			0			51											
08/22/22 10:00	1			0			41											
08/22/22 11:00	1			0			32											
08/22/22 12:00	1			0			31											
08/22/22 13:00	1			0			31											
08/22/22 14:00	1			0			31											
08/22/22 15:00	1			0			37											
08/22/22 16:00	1			0			48											
08/22/22 17:00	1			0			61											
08/22/22 18:00	1			0			70											
08/22/22 19:00	1			0			71											
08/22/22 20:00	1			0			69											
08/22/22 21:00	1			0			65											
08/22/22 22:00	1			0			63											
08/22/22 23:00	1			0			63											
08/23/22 0:00	1			0			63											
08/23/22 1:00	1			0			63											
08/23/22 2:00	1			0			63											
08/23/22 3:00	1			0			63											
08/23/22 4:00	1			0			63											
08/23/22 5:00	1			0			65											
08/23/22 6:00	1			0			65											
08/23/22 7:00	1			0			64											
08/23/22 8:00	1			0			62											
08/23/22 9:00	1			0			62											
08/23/22 10:00	1			0			62											
08/23/22 11:00	1			0			63											
08/23/22 12:00	1			0			64											
08/23/22 13:00	1			0			64											
08/23/22 14:00	1			0			65											
08/23/22 15:00	1			0			64											
08/23/22 16:00	1			0			66											
08/23/22 17:00	1			0			69											
08/23/22 18:00	1			0			72											
08/23/22 19:00	1			0			72											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/23/22 20:00	1			0			70											
08/23/22 21:00	1			0			69											
08/23/22 22:00	1			0			67											
08/23/22 23:00	1			0			63											
08/24/22 0:00	1			0			62											
08/24/22 1:00	1			0			63											
08/24/22 2:00	1			0			63											
08/24/22 3:00	1			0			63											
08/24/22 4:00	1			0			63											
08/24/22 5:00	1			0			63											
08/24/22 6:00	1			0			63											
08/24/22 7:00	1			0			63											
08/24/22 8:00	1			0			63											
08/24/22 9:00	1			0			63											
08/24/22 10:00	1			0			62											
08/24/22 11:00	1			0			62											
08/24/22 12:00	1			0			63											
08/24/22 13:00	1			0			63											
08/24/22 14:00	1			0			67											
08/24/22 15:00	1			0			68											
08/24/22 16:00	1			0			70											
08/24/22 17:00	1			0			70											
08/24/22 18:00	1			0			69											
08/24/22 19:00	1			0			67											
08/24/22 20:00	1			0			63											
08/24/22 21:00	1			0			62											
08/24/22 22:00	1			0			62											
08/24/22 23:00	1			0			62											
08/25/22 0:00	1			0			62											
08/25/22 1:00	1			0			62											
08/25/22 2:00	1			0			62											
08/25/22 3:00	1			0			62											
08/25/22 4:00	1			0			62											
08/25/22 5:00	1			0			62											
08/25/22 6:00	1			0			62											
08/25/22 7:00	1			0			62											
08/25/22 8:00	1			0			62											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/25/22 9:00	1			0			62											
08/25/22 10:00	1			0			62											
08/25/22 11:00	1			0			62											
08/25/22 12:00	1			0			62											
08/25/22 13:00	1			0			63											
08/25/22 14:00	1			0			63											
08/25/22 15:00	1			0			63											
08/25/22 16:00	1			0			63											
08/25/22 17:00	1			0			63											
08/25/22 18:00	1			0			63											
08/25/22 19:00	1			0			63											
08/25/22 20:00	1			0			63											
08/25/22 21:00	1			0			63											
08/25/22 22:00	1			0			63											
08/25/22 23:00	1			0			63											
08/26/22 0:00	1			0			63											
08/26/22 1:00	1			0			63											
08/26/22 2:00	1			0			63											
08/26/22 3:00	1			0			63											
08/26/22 4:00	1			0			63											
08/26/22 5:00	1			4			62											
08/26/22 6:00	1			19			50											
08/26/22 7:00	1			30			40											
08/26/22 8:00	1			37			31											
08/26/22 9:00	1			39			40											
08/26/22 10:00	1			43			45											
08/26/22 11:00	1			50			51											
08/26/22 12:00	1			56			57											
08/26/22 13:00	1			65			66											
08/26/22 14:00	1			73			74											
08/26/22 15:00	1			76			76											
08/26/22 16:00	1			77			77											
08/26/22 17:00	1			78			78											
08/26/22 18:00	1			79			79											
08/26/22 19:00	1			80			80											
08/26/22 20:00	1			78			79											
08/26/22 21:00	1			77			78											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/26/22 22:00	1			72			74											
08/26/22 23:00	1			66			68											
08/27/22 0:00	1			61			63											
08/27/22 1:00	1			59			61											
08/27/22 2:00	1			59			60											
08/27/22 3:00	1			59			60											
08/27/22 4:00	1			59			60											
08/27/22 5:00	1			59			61											
08/27/22 6:00	1			53			54											
08/27/22 7:00	1			44			45											
08/27/22 8:00	1			35			35											
08/27/22 9:00	1			32			33											
08/27/22 10:00	1			35			36											
08/27/22 11:00	1			43			44											
08/27/22 12:00	1			55			55											
08/27/22 13:00	1			63			64											
08/27/22 14:00	1			66			67											
08/27/22 15:00	1			66			67											
08/27/22 16:00	1			67			68											
08/27/22 17:00	1			70			71											
08/27/22 18:00	1			73			74											
08/27/22 19:00	1			76			77											
08/27/22 20:00	1			76			77											
08/27/22 21:00	1			72			74											
08/27/22 22:00	1			60			62											
08/27/22 23:00	1			50			52											
08/28/22 0:00	1			40			41											
08/28/22 1:00	1			38			39											
08/28/22 2:00	1			34			35											
08/28/22 3:00	1			34			35											
08/28/22 4:00	1			34			35											
08/28/22 5:00	1			34			35											
08/28/22 6:00	1			34			35											
08/28/22 7:00	1			33			34											
08/28/22 8:00	1			32			33											
08/28/22 9:00	1			32			33											
08/28/22 10:00	1			32			33											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/28/22 11:00	1			32			33											
08/28/22 12:00	1			36			37											
08/28/22 13:00	1			41			42											
08/28/22 14:00	1			49			50											
08/28/22 15:00	1			47			48											
08/28/22 16:00	1			52			53											
08/28/22 17:00	1			60			60											
08/28/22 18:00	1			70			70											
08/28/22 19:00	1			72			72											
08/28/22 20:00	1			65			66											
08/28/22 21:00	1			58			58											
08/28/22 22:00	1			47			48											
08/28/22 23:00	1			44			46											
08/29/22 0:00	1			45			47											
08/29/22 1:00	1			51			53											
08/29/22 2:00	1			52			53											
08/29/22 3:00	1			52			53											
08/29/22 4:00	1			53			54											
08/29/22 5:00	1			55			56											
08/29/22 6:00	1			51			53											
08/29/22 7:00	1			44			45											
08/29/22 8:00	1			35			36											
08/29/22 9:00	1			33			34											
08/29/22 10:00	1			33			34											
08/29/22 11:00	1			34			35											
08/29/22 12:00	1			34			35											
08/29/22 13:00	1			37			38											
08/29/22 14:00	1			44			45											
08/29/22 15:00	1			56			56											
08/29/22 16:00	1			65			65											
08/29/22 17:00	1			72			72											
08/29/22 18:00	1			73			74											
08/29/22 19:00	1			74			75											
08/29/22 20:00	1			72			73											
08/29/22 21:00	1			70			71											
08/29/22 22:00	1			64			65											
08/29/22 23:00	1			62			63											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/30/22 0:00	1			59			61											
08/30/22 1:00	1			60			61											
08/30/22 2:00	1			58			60											
08/30/22 3:00	1			57			58											
08/30/22 4:00	1			58			59											
08/30/22 5:00	1			60			61											
08/30/22 6:00	1			54			55											
08/30/22 7:00	1			45			46											
08/30/22 8:00	1			35			35											
08/30/22 9:00	1			34			35											
08/30/22 10:00	1			41			42											
08/30/22 11:00	1			50			51											
08/30/22 12:00	1			57			59											
08/30/22 13:00	1			60			61											
08/30/22 14:00	1			65			66											
08/30/22 15:00	1			72			72											
08/30/22 16:00	1			77			77											
08/30/22 17:00	1			79			79											
08/30/22 18:00	1			80			80											
08/30/22 19:00	1			81			81											
08/30/22 20:00	1			80			81											
08/30/22 21:00	1			78			79											
08/30/22 22:00	1			73			75											
08/30/22 23:00	1			68			69											
08/31/22 0:00	1			64			65											
08/31/22 1:00	1			62			63											
08/31/22 2:00	1			63			64											
08/31/22 3:00	1			63			64											
08/31/22 4:00	1			63			64											
08/31/22 5:00	1			63			65											
08/31/22 6:00	1			61			63											
08/31/22 7:00	1			56			58											
08/31/22 8:00	1			52			53											
08/31/22 9:00	1			51			52											
08/31/22 10:00	1			54			55											
08/31/22 11:00	1			62			63											
08/31/22 12:00	1			71			72											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/31/22 13:00	1			77			78											
08/31/22 14:00	1			78			78											
08/31/22 15:00	1			77			77											
08/31/22 16:00	1			74			74											
08/31/22 17:00	1			74			74											
08/31/22 18:00	1			76			76											
08/31/22 19:00	1			78			78											
08/31/22 20:00	1			75			76											
08/31/22 21:00	1			73			74											
08/31/22 22:00	1			71			71											
08/31/22 23:00	1			71			72											
09/01/22 0:00	1			71			71											
09/01/22 1:00	1			70			71											
09/01/22 2:00	1			66			68											
09/01/22 3:00	1			62			64											
09/01/22 4:00	1			61			62											
09/01/22 5:00	1			61			62											
09/01/22 6:00	1			61			62											
09/01/22 7:00	1			60			62											
09/01/22 8:00	1			52			53											
09/01/22 9:00	1			44			45											
09/01/22 10:00	1			36			37											
09/01/22 11:00	1			41			42											
09/01/22 12:00	1			54			55											
09/01/22 13:00	1			67			68											
09/01/22 14:00	1			75			76											
09/01/22 15:00	1			77			77											
09/01/22 16:00	1			77			78											
09/01/22 17:00	1			79			79											
09/01/22 18:00	1			79			79											
09/01/22 19:00	1			79			79											
09/01/22 20:00	1			78			79											
09/01/22 21:00	1			77			78											
09/01/22 22:00	1			76			77											
09/01/22 23:00	1			75			76											
09/02/22 0:00	1			74			75											
09/02/22 1:00	1			73			74											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/02/22 2:00	1			71			73											
09/02/22 3:00	1			71			72											
09/02/22 4:00	1			71			72											
09/02/22 5:00	1			72			74											
09/02/22 6:00	1			72			73											
09/02/22 7:00	1			70			71											
09/02/22 8:00	1			68			69											
09/02/22 9:00	1			69			69											
09/02/22 10:00	1			71			71											
09/02/22 11:00	1			73			73											
09/02/22 12:00	1			74			74											
09/02/22 13:00	1			75			75											
09/02/22 14:00	1			76			77											
09/02/22 15:00	1			75			76											
09/02/22 16:00	1			73			73											
09/02/22 17:00	1			70			71											
09/02/22 18:00	1			71			71											
09/02/22 19:00	1			72			73											
09/02/22 20:00	1			73			74											
09/02/22 21:00	1			72			73											
09/02/22 22:00	1			70			71											
09/02/22 23:00	1			61			62											
09/03/22 0:00	1			54			55											
09/03/22 1:00	1			44			45											
09/03/22 2:00	1			40			41											
09/03/22 3:00	1			34			35											
09/03/22 4:00	1			34			35											
09/03/22 5:00	1			34			35											
09/03/22 6:00	1			33			34											
09/03/22 7:00	1			33			34											
09/03/22 8:00	1			32			33											
09/03/22 9:00	1			32			33											
09/03/22 10:00	1			33			34											
09/03/22 11:00	1			33			34											
09/03/22 12:00	1			36			37											
09/03/22 13:00	1			47			48											
09/03/22 14:00	1			58			59											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/03/22 15:00	1			60			61											
09/03/22 16:00	1			60			61											
09/03/22 17:00	1			61			61											
09/03/22 18:00	1			67			67											
09/03/22 19:00	1			59			59											
09/03/22 20:00	1			49			50											
09/03/22 21:00	1			40			41											
09/03/22 22:00	1			39			40											
09/03/22 23:00	1			42			43											
09/04/22 0:00	1			43			44											
09/04/22 1:00	1			41			42											
09/04/22 2:00	1			39			40											
09/04/22 3:00	1			38			39											
09/04/22 4:00	1			38			39											
09/04/22 5:00	1			36			37											
09/04/22 6:00	1			34			35											
09/04/22 7:00	1			33			34											
09/04/22 8:00	1			32			33											
09/04/22 9:00	1			32			33											
09/04/22 10:00	1			32			33											
09/04/22 11:00	1			33			33											
09/04/22 12:00	1			35			35											
09/04/22 13:00	1			36			37											
09/04/22 14:00	1			43			43											
09/04/22 15:00	1			52			53											
09/04/22 16:00	1			62			62											
09/04/22 17:00	1			68			68											
09/04/22 18:00	1			69			69											
09/04/22 19:00	1			68			68											
09/04/22 20:00	1			67			67											
09/04/22 21:00	1			67			67											
09/04/22 22:00	1			67			68											
09/04/22 23:00	1			64			65											
09/05/22 0:00	1			60			61											
09/05/22 1:00	1			55			56											
09/05/22 2:00	1			52			53											
09/05/22 3:00	1			50			51											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/05/22 4:00	1			50			51											
09/05/22 5:00	1			50			51											
09/05/22 6:00	1			44			45											
09/05/22 7:00	1			38			39											
09/05/22 8:00	1			32			33											
09/05/22 9:00	1			37			38											
09/05/22 10:00	1			45			46											
09/05/22 11:00	1			54			55											
09/05/22 12:00	1			62			62											
09/05/22 13:00	1			67			67											
09/05/22 14:00	1			73			73											
09/05/22 15:00	1			76			76											
09/05/22 16:00	1			78			78											
09/05/22 17:00	1			78			78											
09/05/22 18:00	1			79			78											
09/05/22 19:00	1			79			78											
09/05/22 20:00	1			78			79											
09/05/22 21:00	1			77			78											
09/05/22 22:00	1			77			77											
09/05/22 23:00	1			76			76											
09/06/22 0:00	1			75			76											
09/06/22 1:00	1			71			72											
09/06/22 2:00	1			66			67											
09/06/22 3:00	1			61			62											
09/06/22 4:00	1			59			60											
09/06/22 5:00	1			59			60											
09/06/22 6:00	1			59			60											
09/06/22 7:00	1			58			59											
09/06/22 8:00	1			57			58											
09/06/22 9:00	1			59			60											
09/06/22 10:00	1			64			66											
09/06/22 11:00	1			71			72											
09/06/22 12:00	1			76			76											
09/06/22 13:00	1			78			78											
09/06/22 14:00	1			78			78											
09/06/22 15:00	1			78			78											
09/06/22 16:00	1			78			78											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/06/22 17:00	1			78			78											
09/06/22 18:00	1			78			78											
09/06/22 19:00	1			78			78											
09/06/22 20:00	1			78			79											
09/06/22 21:00	1			78			79											
09/06/22 22:00	1			76			77											
09/06/22 23:00	1			73			74											
09/07/22 0:00	1			68			69											
09/07/22 1:00	1			65			66											
09/07/22 2:00	1			62			63											
09/07/22 3:00	1			61			62											
09/07/22 4:00	1			61			62											
09/07/22 5:00	1			61			62											
09/07/22 6:00	1			61			62											
09/07/22 7:00	1			58			59											
09/07/22 8:00	1			56			58											
09/07/22 9:00	1			62			63											
09/07/22 10:00	1			70			72											
09/07/22 11:00	1			77			78											
09/07/22 12:00	1			78			79											
09/07/22 13:00	1			78			79											
09/07/22 14:00	1			78			79											
09/07/22 15:00	1			78			79											
09/07/22 16:00	1			78			79											
09/07/22 17:00	1			78			79											
09/07/22 18:00	1			78			79											
09/07/22 19:00	1			78			79											
09/07/22 20:00	1			78			79											
09/07/22 21:00	1			77			79											
09/07/22 22:00	1			77			78											
09/07/22 23:00	1			76			77											
09/08/22 0:00	1			75			76											
09/08/22 1:00	1			71			72											
09/08/22 2:00	1			66			67											
09/08/22 3:00	1			62			63											
09/08/22 4:00	1			61			63											
09/08/22 5:00	1			61			63											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/08/22 6:00	1			61			63											
09/08/22 7:00	1			60			62											
09/08/22 8:00	1			60			61											
09/08/22 9:00	1			66			67											
09/08/22 10:00	1			72			73											
09/08/22 11:00	1			78			79											
09/08/22 12:00	1			78			79											
09/08/22 13:00	1			78			79											
09/08/22 14:00	1			78			79											
09/08/22 15:00	1			78			79											
09/08/22 16:00	1			78			79											
09/08/22 17:00	1			78			79											
09/08/22 18:00	1			78			79											
09/08/22 19:00	1			78			79											
09/08/22 20:00	1			79			79											
09/08/22 21:00	1			80			80											
09/08/22 22:00	1			79			80											
09/08/22 23:00	1			78			78											
09/09/22 0:00	1			76			77											
09/09/22 1:00	1			74			76											
09/09/22 2:00	1			74			75											
09/09/22 3:00	1			72			73											
09/09/22 4:00	1			73			73											
09/09/22 5:00	1			75			75											
09/09/22 6:00	1			77			77											
09/09/22 7:00	1			77			78											
09/09/22 8:00	1			76			76											
09/09/22 9:00	1			74			74											
09/09/22 10:00	1			74			74											
09/09/22 11:00	1			73			73											
09/09/22 12:00	1			74			74											
09/09/22 13:00	1			74			75											
09/09/22 14:00	1			76			76											
09/09/22 15:00	1			75			76											
09/09/22 16:00	1			73			74											
09/09/22 17:00	1			72			73											
09/09/22 18:00	1			71			72											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/09/22 19:00	1			70			71											
09/09/22 20:00	1			66			67											
09/09/22 21:00	1			62			63											
09/09/22 22:00	1			56			57											
09/09/22 23:00	1			54			55											
09/10/22 0:00	1			53			54											
09/10/22 1:00	1			49			50											
09/10/22 2:00	1			46			47											
09/10/22 3:00	1			42			43											
09/10/22 4:00	1			47			48											
09/10/22 5:00	1			48			49											
09/10/22 6:00	1			48			49											
09/10/22 7:00	1			50			51											
09/10/22 8:00	1			50			51											
09/10/22 9:00	1			49			50											
09/10/22 10:00	1			41			42											
09/10/22 11:00	1			35			36											
09/10/22 12:00	1			33			34											
09/10/22 13:00	1			36			37											
09/10/22 14:00	1			37			37											
09/10/22 15:00	1			37			38											
09/10/22 16:00	1			38			38											
09/10/22 17:00	1			38			39											
09/10/22 18:00	1			41			42											
09/10/22 19:00	1			45			46											
09/10/22 20:00	1			51			53											
09/10/22 21:00	1			55			57											
09/10/22 22:00	1			53			54											
09/10/22 23:00	1			53			54											
09/11/22 0:00	1			54			55											
09/11/22 1:00	1			59			60											
09/11/22 2:00	1			59			60											
09/11/22 3:00	1			56			58											
09/11/22 4:00	1			55			57											
09/11/22 5:00	1			53			55											
09/11/22 6:00	1			51			52											
09/11/22 7:00	1			44			46											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/11/22 8:00	1			38			39											
09/11/22 9:00	1			34			35											
09/11/22 10:00	1			33			34											
09/11/22 11:00	1			33			34											
09/11/22 12:00	1			36			37											
09/11/22 13:00	1			38			39											
09/11/22 14:00	1			43			44											
09/11/22 15:00	1			47			48											
09/11/22 16:00	1			55			56											
09/11/22 17:00	1			62			63											
09/11/22 18:00	1			68			68											
09/11/22 19:00	1			69			69											
09/11/22 20:00	1			65			65											
09/11/22 21:00	1			56			57											
09/11/22 22:00	1			48			49											
09/11/22 23:00	1			42			43											
09/12/22 0:00	1			44			45											
09/12/22 1:00	1			42			43											
09/12/22 2:00	1			40			41											
09/12/22 3:00	1			35			36											
09/12/22 4:00	1			40			41											
09/12/22 5:00	1			48			50											
09/12/22 6:00	1			55			56											
09/12/22 7:00	1			51			53											
09/12/22 8:00	1			42			44											
09/12/22 9:00	1			36			37											
09/12/22 10:00	1			34			35											
09/12/22 11:00	1			39			40											
09/12/22 12:00	1			47			48											
09/12/22 13:00	1			52			53											
09/12/22 14:00	1			53			54											
09/12/22 15:00	1			50			51											
09/12/22 16:00	1			50			51											
09/12/22 17:00	1			54			54											
09/12/22 18:00	1			57			58											
09/12/22 19:00	1			59			60											
09/12/22 20:00	1			59			60											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/12/22 21:00	1			59			61											
09/12/22 22:00	1			55			56											
09/12/22 23:00	1			52			53											
09/13/22 0:00	1			50			51											
09/13/22 1:00	1			48			50											
09/13/22 2:00	1			43			44											
09/13/22 3:00	1			43			44											
09/13/22 4:00	1			52			53											
09/13/22 5:00	1			62			64											
09/13/22 6:00	1			66			67											
09/13/22 7:00	1			59			60											
09/13/22 8:00	1			49			50											
09/13/22 9:00	1			39			40											
09/13/22 10:00	1			35			36											
09/13/22 11:00	1			34			35											
09/13/22 12:00	1			33			34											
09/13/22 13:00	1			33			34											
09/13/22 14:00	1			32			33											
09/13/22 15:00	1			32			33											
09/13/22 16:00	1			36			37											
09/13/22 17:00	1			47			48											
09/13/22 18:00	1			59			60											
09/13/22 19:00	1			66			67											
09/13/22 20:00	1			66			67											
09/13/22 21:00	1			66			67											
09/13/22 22:00	1			56			57											
09/13/22 23:00	1			50			51											
09/14/22 0:00	1			42			43											
09/14/22 1:00	1			43			44											
09/14/22 2:00	1			40			41											
09/14/22 3:00	1			42			44											
09/14/22 4:00	1			47			49											
09/14/22 5:00	1			54			55											
09/14/22 6:00	1			53			54											
09/14/22 7:00	1			46			47											
09/14/22 8:00	1			37			38											
09/14/22 9:00	1			32			33											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/14/22 10:00	1			32			33											
09/14/22 11:00	1			32			33											
09/14/22 12:00	1			32			33											
09/14/22 13:00	1			32			33											
09/14/22 14:00	1			32			33											
09/14/22 15:00	1			32			33											
09/14/22 16:00	1			32			33											
09/14/22 17:00	1			34			35											
09/14/22 18:00	1			38			39											
09/14/22 19:00	1			42			43											
09/14/22 20:00	1			44			45											
09/14/22 21:00	1			45			46											
09/14/22 22:00	1			41			42											
09/14/22 23:00	1			38			39											
09/15/22 0:00	1			35			36											
09/15/22 1:00	1			35			36											
09/15/22 2:00	1			36			37											
09/15/22 3:00	1			38			39											
09/15/22 4:00	1			43			44											
09/15/22 5:00	1			50			51											
09/15/22 6:00	1			50			51											
09/15/22 7:00	1			47			48											
09/15/22 8:00	1			39			40											
09/15/22 9:00	1			35			36											
09/15/22 10:00	1			40			41											
09/15/22 11:00	1			51			52											
09/15/22 12:00	1			54			55											
09/15/22 13:00	1			47			48											
09/15/22 14:00	1			38			39											
09/15/22 15:00	1			35			36											
09/15/22 16:00	1			35			36											
09/15/22 17:00	1			37			38											
09/15/22 18:00	1			38			39											
09/15/22 19:00	1			39			41											
09/15/22 20:00	1			37			38											
09/15/22 21:00	1			38			39											
09/15/22 22:00	1			37			38											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/15/22 23:00	1			36			37											
09/16/22 0:00	1			35			35											
09/16/22 1:00	1			33			34											
09/16/22 2:00	1			33			34											
09/16/22 3:00	1			32			33											
09/16/22 4:00	1			33			34											
09/16/22 5:00	1			37			38											
09/16/22 6:00	1			39			40											
09/16/22 7:00	1			39			40											
09/16/22 8:00	1			35			36											
09/16/22 9:00	1			32			33											
09/16/22 10:00	1			32			33											
09/16/22 11:00	1			32			33											
09/16/22 12:00	1			32			33											
09/16/22 13:00	1			32			33											
09/16/22 14:00	1			33			34											
09/16/22 15:00	1			34			35											
09/16/22 16:00	1			34			35											
09/16/22 17:00	1			33			34											
09/16/22 18:00	1			33			34											
09/16/22 19:00	1			34			35											
09/16/22 20:00	1			34			35											
09/16/22 21:00	1			34			35											
09/16/22 22:00	1			34			35											
09/16/22 23:00	1			34			35											
09/17/22 0:00	1			34			35											
09/17/22 1:00	1			34			35											
09/17/22 2:00	1			34			35											
09/17/22 3:00	1			34			35											
09/17/22 4:00	1			34			35											
09/17/22 5:00	1			34			35											
09/17/22 6:00	1			34			35											
09/17/22 7:00	1			33			34											
09/17/22 8:00	1			32			33											
09/17/22 9:00	1			32			33											
09/17/22 10:00	1			32			33											
09/17/22 11:00	1			32			33											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/17/22 12:00	1			32			33											
09/17/22 13:00	1			32			33											
09/17/22 14:00	1			32			33											
09/17/22 15:00	1			32			33											
09/17/22 16:00	1			33			34											
09/17/22 17:00	1			35			36											
09/17/22 18:00	1			35			36											
09/17/22 19:00	1			35			36											
09/17/22 20:00	1			33			34											
09/17/22 21:00	1			34			35											
09/17/22 22:00	1			36			37											
09/17/22 23:00	1			36			37											
09/18/22 0:00	1			35			36											
09/18/22 1:00	1			34			35											
09/18/22 2:00	1			34			35											
09/18/22 3:00	1			34			35											
09/18/22 4:00	1			34			35											
09/18/22 5:00	1			33			34											
09/18/22 6:00	1			33			34											
09/18/22 7:00	1			34			34											
09/18/22 8:00	1			34			35											
09/18/22 9:00	1			34			35											
09/18/22 10:00	1			34			35											
09/18/22 11:00	1			34			35											
09/18/22 12:00	1			37			38											
09/18/22 13:00	1			41			42											
09/18/22 14:00	1			42			43											
09/18/22 15:00	1			41			42											
09/18/22 16:00	1			40			41											
09/18/22 17:00	1			45			47											
09/18/22 18:00	1			51			52											
09/18/22 19:00	1			54			56											
09/18/22 20:00	1			55			57											
09/18/22 21:00	1			56			58											
09/18/22 22:00	1			48			50											
09/18/22 23:00	1			41			42											
09/19/22 0:00	1			34			35											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/19/22 1:00	1			34			35											
09/19/22 2:00	1			34			35											
09/19/22 3:00	1			34			35											
09/19/22 4:00	1			37			38											
09/19/22 5:00	1			44			46											
09/19/22 6:00	1			45			46											
09/19/22 7:00	1			44			44											
09/19/22 8:00	1			42			42											
09/19/22 9:00	1			45			45											
09/19/22 10:00	1			43			43											
09/19/22 11:00	1			39			39											
09/19/22 12:00	1			36			37											
09/19/22 13:00	1			37			38											
09/19/22 14:00	1			36			37											
09/19/22 15:00	1			36			37											
09/19/22 16:00	1			41			42											
09/19/22 17:00	1			54			55											
09/19/22 18:00	1			67			68											
09/19/22 19:00	1			73			74											
09/19/22 20:00	1			71			72											
09/19/22 21:00	1			70			70											
09/19/22 22:00	1			64			65											
09/19/22 23:00	1			59			59											
09/20/22 0:00	1			53			54											
09/20/22 1:00	1			48			49											
09/20/22 2:00	1			43			44											
09/20/22 3:00	1			45			46											
09/20/22 4:00	1			46			47											
09/20/22 5:00	1			49			49											
09/20/22 6:00	1			43			44											
09/20/22 7:00	1			40			41											
09/20/22 8:00	1			37			38											
09/20/22 9:00	1			35			36											
09/20/22 10:00	1			34			35											
09/20/22 11:00	1			37			38											
09/20/22 12:00	1			37			38											
09/20/22 13:00	1			38			39											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/20/22 14:00	1			35			36											
09/20/22 15:00	1			34			35											
09/20/22 16:00	1			39			40											
09/20/22 17:00	1			53			53											
09/20/22 18:00	1			67			67											
09/20/22 19:00	1			74			74											
09/20/22 20:00	1			74			73											
09/20/22 21:00	1			74			73											
09/20/22 22:00	1			73			72											
09/20/22 23:00	1			68			68											
09/21/22 0:00	1			64			65											
09/21/22 1:00	1			58			59											
09/21/22 2:00	1			56			57											
09/21/22 3:00	1			56			58											
09/21/22 4:00	1			60			61											
09/21/22 5:00	1			63			64											
09/21/22 6:00	1			59			60											
09/21/22 7:00	1			58			59											
09/21/22 8:00	1			57			58											
09/21/22 9:00	1			59			60											
09/21/22 10:00	1			53			54											
09/21/22 11:00	1			51			53											
09/21/22 12:00	1			44			45											
09/21/22 13:00	1			42			42											
09/21/22 14:00	1			41			41											
09/21/22 15:00	1			40			41											
09/21/22 16:00	1			43			44											
09/21/22 17:00	1			44			45											
09/21/22 18:00	1			50			51											
09/21/22 19:00	1			50			51											
09/21/22 20:00	1			45			46											
09/21/22 21:00	1			40			41											
09/21/22 22:00	1			36			37											
09/21/22 23:00	1			34			35											
09/22/22 0:00	1			34			35											
09/22/22 1:00	1			34			35											
09/22/22 2:00	1			34			35											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/22/22 3:00	1			34			35											
09/22/22 4:00	1			36			37											
09/22/22 5:00	1			40			42											
09/22/22 6:00	1			41			42											
09/22/22 7:00	1			38			39											
09/22/22 8:00	1			34			34											
09/22/22 9:00	1			33			33											
09/22/22 10:00	1			33			33											
09/22/22 11:00	1			33			33											
09/22/22 12:00	1			33			33											
09/22/22 13:00	1			33			33											
09/22/22 14:00	1			33			33											
09/22/22 15:00	1			32			33											
09/22/22 16:00	1			34			35											
09/22/22 17:00	1			35			36											
09/22/22 18:00	1			36			37											
09/22/22 19:00	1			37			38											
09/22/22 20:00	1			40			41											
09/22/22 21:00	1			43			45											
09/22/22 22:00	1			30			48											
09/22/22 23:00	1			15			33											
09/23/22 0:00	0			0			17											
09/23/22 1:00	0			0			1											
09/23/22 2:00	0			0			0											
09/23/22 3:00	0			0			0											
09/23/22 4:00	0			0			0											
09/23/22 5:00	0			0			0											
09/23/22 6:00	0			0			0											
09/23/22 7:00	0			0			0											
09/23/22 8:00	0			0			0											
09/23/22 9:00	0			0			0											
09/23/22 10:00	0			0			0											
09/23/22 11:00	0			0			0											
09/23/22 12:00	1			4			0											
09/23/22 13:00	1			15			0											
09/23/22 14:00	1			26			0											
09/23/22 15:00	1			40			2											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/23/22 16:00	1			43			15											
09/23/22 17:00	1			54			37											
09/23/22 18:00	1			58			58											
09/23/22 19:00	1			67			67											
09/23/22 20:00	1			68			67											
09/23/22 21:00	1			69			68											
09/23/22 22:00	1			65			64											
09/23/22 23:00	1			60			60											
09/24/22 0:00	1			51			52											
09/24/22 1:00	1			45			47											
09/24/22 2:00	1			44			45											
09/24/22 3:00	1			47			49											
09/24/22 4:00	1			53			54											
09/24/22 5:00	1			54			56											
09/24/22 6:00	1			48			50											
09/24/22 7:00	1			40			41											
09/24/22 8:00	1			33			34											
09/24/22 9:00	1			32			33											
09/24/22 10:00	1			32			33											
09/24/22 11:00	1			32			33											
09/24/22 12:00	1			32			33											
09/24/22 13:00	1			33			34											
09/24/22 14:00	1			40			40											
09/24/22 15:00	1			48			47											
09/24/22 16:00	1			55			54											
09/24/22 17:00	1			58			57											
09/24/22 18:00	1			56			56											
09/24/22 19:00	1			56			57											
09/24/22 20:00	1			57			58											
09/24/22 21:00	1			60			60											
09/24/22 22:00	1			61			61											
09/24/22 23:00	1			58			59											
09/25/22 0:00	1			54			55											
09/25/22 1:00	1			49			50											
09/25/22 2:00	1			49			50											
09/25/22 3:00	1			47			48											
09/25/22 4:00	1			44			46											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/25/22 5:00	1			39			40											
09/25/22 6:00	1			35			36											
09/25/22 7:00	1			34			35											
09/25/22 8:00	1			32			33											
09/25/22 9:00	1			32			33											
09/25/22 10:00	1			32			33											
09/25/22 11:00	1			32			33											
09/25/22 12:00	1			32			33											
09/25/22 13:00	1			32			33											
09/25/22 14:00	1			34			35											
09/25/22 15:00	1			36			37											
09/25/22 16:00	1			43			44											
09/25/22 17:00	1			50			51											
09/25/22 18:00	1			56			56											
09/25/22 19:00	1			56			57											
09/25/22 20:00	1			55			56											
09/25/22 21:00	1			52			54											
09/25/22 22:00	1			46			47											
09/25/22 23:00	1			39			40											
09/26/22 0:00	1			34			35											
09/26/22 1:00	1			34			35											
09/26/22 2:00	1			34			35											
09/26/22 3:00	1			34			35											
09/26/22 4:00	1			37			39											
09/26/22 5:00	1			41			42											
09/26/22 6:00	1			41			42											
09/26/22 7:00	1			37			38											
09/26/22 8:00	1			33			34											
09/26/22 9:00	1			32			33											
09/26/22 10:00	1			32			33											
09/26/22 11:00	1			32			33											
09/26/22 12:00	1			32			33											
09/26/22 13:00	1			33			34											
09/26/22 14:00	1			35			36											
09/26/22 15:00	1			38			39											
09/26/22 16:00	1			42			43											
09/26/22 17:00	1			45			46											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/26/22 18:00	1			42			43											
09/26/22 19:00	1			38			39											
09/26/22 20:00	1			34			35											
09/26/22 21:00	1			37			38											
09/26/22 22:00	1			41			42											
09/26/22 23:00	1			52			53											
09/27/22 0:00	1			61			62											
09/27/22 1:00	1			69			70											
09/27/22 2:00	1			69			70											
09/27/22 3:00	1			68			70											
09/27/22 4:00	1			69			70											
09/27/22 5:00	1			70			72											
09/27/22 6:00	1			70			72											
09/27/22 7:00	1			66			67											
09/27/22 8:00	1			53			54											
09/27/22 9:00	1			41			42											
09/27/22 10:00	1			32			33											
09/27/22 11:00	1			39			40											
09/27/22 12:00	1			51			52											
09/27/22 13:00	1			63			64											
09/27/22 14:00	1			68			68											
09/27/22 15:00	1			66			66											
09/27/22 16:00	1			56			56											
09/27/22 17:00	1			48			48											
09/27/22 18:00	1			48			49											
09/27/22 19:00	1			58			59											
09/27/22 20:00	1			66			67											
09/27/22 21:00	1			66			67											
09/27/22 22:00	1			66			68											
09/27/22 23:00	1			64			65											
09/28/22 0:00	1			61			62											
09/28/22 1:00	1			58			59											
09/28/22 2:00	1			57			58											
09/28/22 3:00	1			57			58											
09/28/22 4:00	1			57			59											
09/28/22 5:00	1			58			59											
09/28/22 6:00	1			57			59											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/28/22 7:00	1			49			50											
09/28/22 8:00	1			40			41											
09/28/22 9:00	1			32			33											
09/28/22 10:00	1			32			33											
09/28/22 11:00	1			33			34											
09/28/22 12:00	1			33			34											
09/28/22 13:00	1			34			35											
09/28/22 14:00	1			36			37											
09/28/22 15:00	1			36			37											
09/28/22 16:00	1			36			36											
09/28/22 17:00	1			33			33											
09/28/22 18:00	1			33			34											
09/28/22 19:00	1			33			34											
09/28/22 20:00	1			34			35											
09/28/22 21:00	1			37			38											
09/28/22 22:00	1			43			44											
09/28/22 23:00	1			49			50											
09/29/22 0:00	1			50			51											
09/29/22 1:00	1			46			48											
09/29/22 2:00	1			41			42											
09/29/22 3:00	1			38			39											
09/29/22 4:00	1			41			43											
09/29/22 5:00	1			47			48											
09/29/22 6:00	1			50			51											
09/29/22 7:00	1			52			53											
09/29/22 8:00	1			46			47											
09/29/22 9:00	1			41			41											
09/29/22 10:00	1			34			35											
09/29/22 11:00	1			33			33											
09/29/22 12:00	1			32			33											
09/29/22 13:00	1			34			35											
09/29/22 14:00	1			35			36											
09/29/22 15:00	1			35			36											
09/29/22 16:00	1			40			41											
09/29/22 17:00	1			51			52											
09/29/22 18:00	1			61			62											
09/29/22 19:00	1			67			67											

	ALL_UnitOn_TF_1H			CT1_Load_Total_3Hr_MWe_1H			CT2_Load_Total_3Hr_MWe_1H											
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/29/22 20:00	1			64			64											
09/29/22 21:00	1			53			54											
09/29/22 22:00	1			43			44											
09/29/22 23:00	1			42			43											
09/30/22 0:00	1			47			48											
09/30/22 1:00	1			52			53											
09/30/22 2:00	1			50			51											
09/30/22 3:00	1			48			49											
09/30/22 4:00	1			50			51											
09/30/22 5:00	1			54			55											
09/30/22 6:00	1			55			57											
09/30/22 7:00	1			47			49											
09/30/22 8:00	1			38			39											
09/30/22 9:00	1			32			33											
09/30/22 10:00	1			32			33											
09/30/22 11:00	1			32			33											
09/30/22 12:00	1			32			33											
09/30/22 13:00	1			32			33											
09/30/22 14:00	1			32			33											
09/30/22 15:00	1			32			33											
09/30/22 16:00	1			37			38											
09/30/22 17:00	1			43			45											
09/30/22 18:00	1			44			46											
09/30/22 19:00	1			40			42											
09/30/22 20:00	1			35			36											
09/30/22 21:00	1			40			41											
09/30/22 22:00	1			40			41											
09/30/22 23:00	1			46			47											

Tons 12 Month Rolling Summary

CT1 and CT2 Combined



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 19:15 Location: Roseville, CA

* = Excess Emission

Date	Units CT1 & CT2		Units CT1 & CT2		Units CT1 & CT2		Units CT1 & CT2		Units CT1 & CT2	
	CO, Ton		NOx, Ton		PM10, Ton		SO2, Ton		VOC, Ton	
	1 Day(s)		1 Day(s)		1 Day(s)		1 Day(s)		1 Day(s)	
	Sum	Rolling Sum	Sum	Rolling Sum	Sum	Rolling Sum	Sum	Rolling Sum	Sum	Rolling Sum
Jul 2022	0.6226	6.7916	1.5269	13.6733	0.3084	2.8936	0.1544	1.4470	0.5141	4.8240
Aug 2022	0.5968	6.7917	1.7288	13.6468	0.3466	2.8593	0.1731	1.4296	0.5774	4.7658
Sep 2022	0.5247	6.7951	1.6900	13.8458	0.3443	2.8831	0.1723	1.4414	0.5740	4.8056
Sum/Avg	6.7951		13.8458		2.8831		1.4414		4.8056	
Limit Value										

Monthly Summary Report

Units CT1 and CT2



From: 07/01/2022 00:00 **To:** 09/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 10/01/2022 21:24 **Location:** Roseville, CA

Date	Unit CT1 OperatingTime, Hr		Unit CT1 DBOn, Hr		Unit CT2 OperatingTime, Hr		Unit CT2 DBOn, Hr	
	1 Hour(s)		1 Hour(s)		1 Hour(s)		1 Hour(s)	
	Sum	Running Sum	Sum	Running Sum	Sum	Running Sum	Sum	Running Sum
Jul 22	744.00	744.00	261.36	261.36	507.58	507.58	251.70	251.70
Aug 22	579.31	1,323.31	239.49	500.85	726.05	1,233.63	355.05	606.75
Sep 22	705.38	2,028.69	183.88	684.73	703.30	1,936.93	184.02	790.77
Sum/Avg	2,028.69		684.73		1,936.93		790.77	

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/01/22 02:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/01/22 02:25	200.0	175.0	171.3	R-A /Span * 100		1.9
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/01/22 02:15	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/01/22 02:20	30.0	26.7	26.4	R-A /Span * 100		1.0
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/01/22 03:08	200.0	0.0	0.1	R-A /Span * 100		0.1
	High	07/01/22 03:19	200.0	182.4	182.6	R-A /Span * 100		0.1
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/01/22 03:08	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	07/01/22 03:13	10.0	9.7	9.9	R-A /Span * 100		2.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/01/22 03:08	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/01/22 03:19	200.0	175.0	174.3	R-A /Span * 100		0.4
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/01/22 03:08	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/01/22 03:13	10.0	8.8	8.9	R-A /Span * 100		1.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	07/01/22 03:08	21.0	18.1	18.2	R-A		0.1
	Zero	07/01/22 03:13	21.0	0.0	0.0	R-A		0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/01/22 19:22	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/01/22 19:32	200.0	184.3	183.8	R-A /Span * 100		0.3
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/01/22 19:22	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/01/22 19:26	10.0	8.8	8.9	R-A /Span * 100		1.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/01/22 19:22	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/01/22 19:32	200.0	182.0	179.7	R-A /Span * 100		1.2
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/01/22 19:22	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/01/22 19:26	10.0	8.1	8.3	R-A /Span * 100		2.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	07/01/22 19:22	21.0	18.0	18.0	R-A		0.0
	Zero	07/01/22 19:26	21.0	0.0	0.0	R-A		0.0

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/02/22 02:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/02/22 02:25	200.0	175.0	171.3	R-A /Span * 100		1.9
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/02/22 02:15	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/02/22 02:20	30.0	26.7	26.4	R-A /Span * 100		1.0
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/02/22 03:14	200.0	0.0	0.1	R-A /Span * 100		0.1
	High	07/02/22 03:25	200.0	182.4	182.8	R-A /Span * 100		0.2
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/02/22 03:14	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	07/02/22 03:20	10.0	9.7	9.9	R-A /Span * 100		2.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/02/22 03:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/02/22 03:25	200.0	175.0	174.4	R-A /Span * 100		0.3
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/02/22 03:14	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/02/22 03:20	10.0	8.8	8.9	R-A /Span * 100		1.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	07/02/22 03:14	21.0	18.1	18.2	R-A		0.1
	Zero	07/02/22 03:20	21.0	0.0	0.0	R-A		0.0
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/03/22 02:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/03/22 02:25	200.0	175.0	171.4	R-A /Span * 100		1.8
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/03/22 02:14	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/03/22 02:19	30.0	26.7	26.4	R-A /Span * 100		1.0
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/03/22 03:15	200.0	0.0	0.1	R-A /Span * 100		0.1
	High	07/03/22 03:25	200.0	182.4	182.8	R-A /Span * 100		0.2
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/03/22 03:15	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	07/03/22 03:20	10.0	9.7	9.8	R-A /Span * 100		1.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/03/22 03:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/03/22 03:25	200.0	175.0	174.8	R-A /Span * 100		0.1

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/03/22 03:15	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/03/22 03:20	10.0	8.8	8.9	R-A /Span * 100		1.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	07/03/22 03:15	21.0	18.1	18.2	R-A		0.1
	Zero	07/03/22 03:20	21.0	0.0	0.0	R-A		0.0
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/04/22 02:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/04/22 02:25	200.0	175.0	171.4	R-A /Span * 100		1.8
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/04/22 02:15	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/04/22 02:19	30.0	26.7	26.5	R-A /Span * 100		0.7
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/04/22 03:14	200.0	0.0	0.1	R-A /Span * 100		0.1
	High	07/04/22 03:25	200.0	182.4	182.8	R-A /Span * 100		0.2
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/04/22 03:14	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	07/04/22 03:20	10.0	9.7	9.9	R-A /Span * 100		2.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/04/22 03:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/04/22 03:25	200.0	175.0	174.7	R-A /Span * 100		0.2
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/04/22 03:14	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/04/22 03:20	10.0	8.8	8.9	R-A /Span * 100		1.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	07/04/22 03:14	21.0	18.1	18.2	R-A		0.1
	Zero	07/04/22 03:20	21.0	0.0	0.0	R-A		0.0
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/05/22 02:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/05/22 02:25	200.0	175.0	171.0	R-A /Span * 100		2.0
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/05/22 02:14	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/05/22 02:19	30.0	26.7	26.4	R-A /Span * 100		1.0
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/05/22 03:15	200.0	0.0	0.1	R-A /Span * 100		0.1
	High	07/05/22 03:25	200.0	182.4	182.8	R-A /Span * 100		0.2

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/05/22 03:15	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	07/05/22 03:20	10.0	9.7	9.9	R-A /Span * 100		2.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/05/22 03:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/05/22 03:25	200.0	175.0	174.1	R-A /Span * 100		0.5
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/05/22 03:15	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/05/22 03:20	10.0	8.8	8.9	R-A /Span * 100		1.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	07/05/22 03:15	21.0	18.1	18.2	R-A		0.1
	Zero	07/05/22 03:20	21.0	0.0	0.0	R-A		0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/05/22 17:23	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/05/22 17:33	200.0	184.3	183.5	R-A /Span * 100		0.4
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/05/22 17:23	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	07/05/22 17:28	10.0	8.8	8.8	R-A /Span * 100		0.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/05/22 17:23	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/05/22 17:33	200.0	182.0	179.8	R-A /Span * 100		1.1
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/05/22 17:23	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/05/22 17:28	10.0	8.1	8.3	R-A /Span * 100		2.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	07/05/22 17:23	21.0	18.0	18.0	R-A		0.0
	Zero	07/05/22 17:28	21.0	0.0	0.0	R-A		0.0
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/06/22 02:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/06/22 02:24	200.0	175.0	171.5	R-A /Span * 100		1.8
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/06/22 02:14	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/06/22 02:20	30.0	26.7	26.5	R-A /Span * 100		0.7
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/06/22 03:14	200.0	0.0	0.1	R-A /Span * 100		0.1
	High	07/06/22 03:25	200.0	182.4	183.3	R-A /Span * 100		0.5

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/06/22 03:14	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	07/06/22 03:20	10.0	9.7	9.9	R-A /Span * 100		2.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/06/22 03:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/06/22 03:25	200.0	175.0	174.6	R-A /Span * 100		0.2
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/06/22 03:14	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/06/22 03:20	10.0	8.8	8.9	R-A /Span * 100		1.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	07/06/22 03:14	21.0	18.1	18.2	R-A		0.1
	Zero	07/06/22 03:20	21.0	0.0	0.0	R-A		0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/06/22 18:55	200.0	0.0	0.1	R-A /Span * 100		0.1
	High	07/06/22 19:05	200.0	184.3	183.3	R-A /Span * 100		0.5
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/06/22 18:55	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	07/06/22 19:00	10.0	8.8	8.8	R-A /Span * 100		0.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/06/22 18:55	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/06/22 19:05	200.0	182.0	179.9	R-A /Span * 100		1.1
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/06/22 18:55	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/06/22 19:00	10.0	8.1	8.3	R-A /Span * 100		2.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	07/06/22 18:55	21.0	18.0	18.0	R-A		0.0
	Zero	07/06/22 19:00	21.0	0.0	0.0	R-A		0.0
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/07/22 02:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/07/22 02:25	200.0	175.0	171.4	R-A /Span * 100		1.8
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/07/22 02:14	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/07/22 02:20	30.0	26.7	26.4	R-A /Span * 100		1.0
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/07/22 03:14	200.0	0.0	0.1	R-A /Span * 100		0.1
	High	07/07/22 03:25	200.0	182.4	183.1	R-A /Span * 100		0.4

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:26 Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

	Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/07/22 03:14	10.0	0.0		R-A /Span * 100	1.0
	High	07/07/22 03:20	10.0	9.7		R-A /Span * 100	2.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/07/22 03:14	200.0	0.0		R-A /Span * 100	0.0
	High	07/07/22 03:25	200.0	175.0		R-A /Span * 100	0.2
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/07/22 03:14	10.0	0.0		R-A /Span * 100	0.0
	High	07/07/22 03:20	10.0	8.8		R-A /Span * 100	1.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	07/07/22 03:14	21.0	18.1		R-A	0.2
	Zero	07/07/22 03:20	21.0	0.0		R-A	0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/07/22 16:27	200.0	0.0		R-A /Span * 100	0.1
	High	07/07/22 16:38	200.0	184.3		R-A /Span * 100	0.6
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/07/22 16:27	10.0	0.0		R-A /Span * 100	1.0
	High	07/07/22 16:32	10.0	8.8		R-A /Span * 100	1.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/07/22 16:27	200.0	0.0		R-A /Span * 100	0.0
	High	07/07/22 16:38	200.0	182.0		R-A /Span * 100	1.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/07/22 16:27	10.0	0.0		R-A /Span * 100	0.0
	High	07/07/22 16:32	10.0	8.1		R-A /Span * 100	2.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	07/07/22 16:27	21.0	18.0		R-A	0.0
	Zero	07/07/22 16:32	21.0	0.0		R-A	0.0
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/08/22 02:14	200.0	0.0		R-A /Span * 100	0.0
	High	07/08/22 02:25	200.0	175.0		R-A /Span * 100	1.5
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/08/22 02:14	30.0	0.0		R-A /Span * 100	0.0
	High	07/08/22 02:20	30.0	26.7		R-A /Span * 100	0.7
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/08/22 03:15	200.0	0.0		R-A /Span * 100	0.1
	High	07/08/22 03:25	200.0	182.4		R-A /Span * 100	0.4

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

	Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/08/22 03:15	10.0	0.0	0.1	R-A /Span * 100	1.0
	High	07/08/22 03:20	10.0	9.7	9.9	R-A /Span * 100	2.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/08/22 03:15	200.0	0.0	0.0	R-A /Span * 100	0.0
	High	07/08/22 03:25	200.0	175.0	174.4	R-A /Span * 100	0.3
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/08/22 03:15	10.0	0.0	0.0	R-A /Span * 100	0.0
	High	07/08/22 03:20	10.0	8.8	8.9	R-A /Span * 100	1.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	07/08/22 03:15	21.0	18.1	18.3	R-A	0.2
	Zero	07/08/22 03:20	21.0	0.0	0.0	R-A	0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/08/22 16:42	200.0	0.0	0.1	R-A /Span * 100	0.1
	High	07/08/22 16:51	200.0	184.3	182.6	R-A /Span * 100	0.9
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/08/22 16:42	10.0	0.0	0.1	R-A /Span * 100	1.0
	High	07/08/22 16:47	10.0	8.8	8.7	R-A /Span * 100	1.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/08/22 16:42	200.0	0.0	0.0	R-A /Span * 100	0.0
	High	07/08/22 16:51	200.0	182.0	179.9	R-A /Span * 100	1.1
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/08/22 16:42	10.0	0.0	0.0	R-A /Span * 100	0.0
	High	07/08/22 16:47	10.0	8.1	8.3	R-A /Span * 100	2.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	07/08/22 16:42	21.0	18.0	18.0	R-A	0.0
	Zero	07/08/22 16:47	21.0	0.0	0.0	R-A	0.0
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/09/22 02:15	200.0	0.0	0.0	R-A /Span * 100	0.0
	High	07/09/22 02:25	200.0	175.0	171.2	R-A /Span * 100	1.9
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/09/22 02:15	30.0	0.0	0.0	R-A /Span * 100	0.0
	High	07/09/22 02:20	30.0	26.7	26.4	R-A /Span * 100	1.0
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/09/22 03:14	200.0	0.0	0.1	R-A /Span * 100	0.1
	High	07/09/22 03:25	200.0	182.4	182.6	R-A /Span * 100	0.1

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

	Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/09/22 03:14	10.0	0.0		R-A /Span * 100	1.0
	High	07/09/22 03:19	10.0	9.7		R-A /Span * 100	2.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/09/22 03:14	200.0	0.0		R-A /Span * 100	0.0
	High	07/09/22 03:25	200.0	175.0		R-A /Span * 100	0.4
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/09/22 03:14	10.0	0.0		R-A /Span * 100	0.0
	High	07/09/22 03:19	10.0	8.8		R-A /Span * 100	1.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	07/09/22 03:14	21.0	18.1		R-A	0.2
	Zero	07/09/22 03:19	21.0	0.0		R-A	0.0
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/10/22 02:14	200.0	0.0		R-A /Span * 100	0.0
	High	07/10/22 02:24	200.0	175.0		R-A /Span * 100	2.0
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/10/22 02:14	30.0	0.0		R-A /Span * 100	0.0
	High	07/10/22 02:19	30.0	26.7		R-A /Span * 100	0.7
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/10/22 03:14	200.0	0.0		R-A /Span * 100	0.1
	High	07/10/22 03:25	200.0	182.4		R-A /Span * 100	0.1
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/10/22 03:14	10.0	0.0		R-A /Span * 100	1.0
	High	07/10/22 03:19	10.0	9.7		R-A /Span * 100	2.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/10/22 03:14	200.0	0.0		R-A /Span * 100	0.0
	High	07/10/22 03:25	200.0	175.0		R-A /Span * 100	0.4
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/10/22 03:14	10.0	0.0		R-A /Span * 100	0.0
	High	07/10/22 03:19	10.0	8.8		R-A /Span * 100	1.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	07/10/22 03:14	21.0	18.1		R-A	0.1
	Zero	07/10/22 03:19	21.0	0.0		R-A	0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/10/22 17:03	200.0	0.0		R-A /Span * 100	0.0
	High	07/10/22 17:13	200.0	184.3		R-A /Span * 100	0.5

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

	Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/10/22 17:03	10.0	0.0	0.1	R-A /Span * 100	1.0
	High	07/10/22 17:08	10.0	8.8	8.8	R-A /Span * 100	0.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/10/22 17:03	200.0	0.0	0.0	R-A /Span * 100	0.0
	High	07/10/22 17:13	200.0	182.0	180.8	R-A /Span * 100	0.6
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/10/22 17:03	10.0	0.0	0.0	R-A /Span * 100	0.0
	High	07/10/22 17:08	10.0	8.1	8.3	R-A /Span * 100	2.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	07/10/22 17:03	21.0	18.0	18.0	R-A	0.0
	Zero	07/10/22 17:08	21.0	0.0	0.0	R-A	0.0
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/11/22 02:14	200.0	0.0	-0.1	R-A /Span * 100	0.1
	High	07/11/22 02:24	200.0	182.0	186.9	R-A /Span * 100	2.5
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/11/22 02:14	30.0	0.0	0.0	R-A /Span * 100	0.0
	High	07/11/22 02:19	30.0	26.3	25.9	R-A /Span * 100	1.3
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/11/22 02:14	200.0	0.0	0.0	R-A /Span * 100	0.0
	High	07/11/22 02:25	200.0	175.0	171.4	R-A /Span * 100	1.8
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/11/22 02:14	30.0	0.0	0.0	R-A /Span * 100	0.0
	High	07/11/22 02:19	30.0	26.7	26.4	R-A /Span * 100	1.0
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/11/22 03:14	200.0	0.0	0.1	R-A /Span * 100	0.1
	High	07/11/22 03:24	200.0	182.4	183.5	R-A /Span * 100	0.6
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/11/22 03:14	10.0	0.0	0.1	R-A /Span * 100	1.0
	High	07/11/22 03:19	10.0	9.7	9.9	R-A /Span * 100	2.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/11/22 03:14	200.0	0.0	0.0	R-A /Span * 100	0.0
	High	07/11/22 03:24	200.0	175.0	174.1	R-A /Span * 100	0.5
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/11/22 03:14	10.0	0.0	0.0	R-A /Span * 100	0.0
	High	07/11/22 03:19	10.0	8.8	8.8	R-A /Span * 100	0.0

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

	Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	07/11/22 03:14	21.0	18.1	18.2	R-A	0.1
	Zero	07/11/22 03:19	21.0	0.0	0.0	R-A	0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/11/22 03:14	200.0	0.0	0.0	R-A /Span * 100	0.0
	High	07/11/22 03:25	200.0	184.3	183.2	R-A /Span * 100	0.6
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/11/22 03:14	10.0	0.0	0.0	R-A /Span * 100	0.0
	High	07/11/22 03:20	10.0	8.8	8.8	R-A /Span * 100	0.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/11/22 03:14	200.0	0.0	0.0	R-A /Span * 100	0.0
	High	07/11/22 03:25	200.0	182.0	179.4	R-A /Span * 100	1.3
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/11/22 03:14	10.0	0.0	0.0	R-A /Span * 100	0.0
	High	07/11/22 03:20	10.0	8.1	8.3	R-A /Span * 100	2.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	07/11/22 03:14	21.0	18.0	18.0	R-A	0.0
	Zero	07/11/22 03:20	21.0	0.0	0.0	R-A	0.0
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/12/22 02:15	200.0	0.0	0.0	R-A /Span * 100	0.0
	High	07/12/22 02:25	200.0	175.0	171.8	R-A /Span * 100	1.6
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/12/22 02:15	30.0	0.0	0.0	R-A /Span * 100	0.0
	High	07/12/22 02:20	30.0	26.7	26.4	R-A /Span * 100	1.0
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/12/22 02:15	200.0	0.0	-0.1	R-A /Span * 100	0.1
	High	07/12/22 02:25	200.0	182.0	186.1	R-A /Span * 100	2.1
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/12/22 02:15	30.0	0.0	0.1	R-A /Span * 100	0.3
	High	07/12/22 02:20	30.0	26.3	25.6	R-A /Span * 100	2.3
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/12/22 03:15	200.0	0.0	0.1	R-A /Span * 100	0.1
	High	07/12/22 03:25	200.0	182.4	183.6	R-A /Span * 100	0.6
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/12/22 03:15	10.0	0.0	0.1	R-A /Span * 100	1.0
	High	07/12/22 03:20	10.0	9.7	9.9	R-A /Span * 100	2.0

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

	Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/12/22 03:15	200.0	0.0	R-A /Span * 100		0.0
	High	07/12/22 03:25	200.0	175.0	R-A /Span * 100		0.2
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/12/22 03:15	10.0	0.0	R-A /Span * 100		0.0
	High	07/12/22 03:20	10.0	8.8	R-A /Span * 100		1.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	07/12/22 03:15	21.0	18.1	R-A		0.1
	Zero	07/12/22 03:20	21.0	0.0	R-A		0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/12/22 03:15	200.0	0.0	R-A /Span * 100		0.0
	High	07/12/22 03:24	200.0	184.3	R-A /Span * 100		0.9
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/12/22 03:15	10.0	0.0	R-A /Span * 100		0.0
	High	07/12/22 03:20	10.0	8.8	R-A /Span * 100		1.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/12/22 03:15	200.0	0.0	R-A /Span * 100		0.0
	High	07/12/22 03:24	200.0	182.0	R-A /Span * 100		1.3
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/12/22 03:15	10.0	0.0	R-A /Span * 100		0.0
	High	07/12/22 03:20	10.0	8.1	R-A /Span * 100		2.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	07/12/22 03:15	21.0	18.0	R-A		0.0
	Zero	07/12/22 03:20	21.0	0.0	R-A		0.0
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/13/22 02:14	200.0	0.0	R-A /Span * 100		0.1
	High	07/13/22 02:24	200.0	182.0	R-A /Span * 100		1.7
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/13/22 02:14	30.0	0.0	R-A /Span * 100		0.0
	High	07/13/22 02:20	30.0	26.3	R-A /Span * 100		2.7
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/13/22 02:15	200.0	0.0	R-A /Span * 100		0.0
	High	07/13/22 02:25	200.0	175.0	R-A /Span * 100		2.1
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/13/22 02:15	30.0	0.0	R-A /Span * 100		0.0
	High	07/13/22 02:20	30.0	26.7	R-A /Span * 100		1.3

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/13/22 03:15	200.0	0.0	0.1	R-A /Span * 100		0.1
	High	07/13/22 03:25	200.0	182.4	183.2	R-A /Span * 100		0.4
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/13/22 03:15	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	07/13/22 03:19	10.0	9.7	9.8	R-A /Span * 100		1.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/13/22 03:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/13/22 03:25	200.0	175.0	174.1	R-A /Span * 100		0.5
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/13/22 03:15	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/13/22 03:19	10.0	8.8	8.8	R-A /Span * 100		0.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	07/13/22 03:15	21.0	18.1	18.2	R-A		0.1
	Zero	07/13/22 03:19	21.0	0.0	0.0	R-A		0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/13/22 03:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/13/22 03:25	200.0	184.3	182.9	R-A /Span * 100		0.7
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/13/22 03:14	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/13/22 03:19	10.0	8.8	8.7	R-A /Span * 100		1.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/13/22 03:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/13/22 03:25	200.0	182.0	178.9	R-A /Span * 100		1.6
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/13/22 03:14	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/13/22 03:19	10.0	8.1	8.3	R-A /Span * 100		2.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	07/13/22 03:14	21.0	18.0	18.0	R-A		0.0
	Zero	07/13/22 03:19	21.0	0.0	0.0	R-A		0.0
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/14/22 02:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/14/22 02:25	200.0	175.0	170.4	R-A /Span * 100		2.3
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/14/22 02:15	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/14/22 02:20	30.0	26.7	26.4	R-A /Span * 100		1.0

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/14/22 03:14	200.0	0.0	0.1	R-A /Span * 100		0.1
	High	07/14/22 03:25	200.0	182.4	182.8	R-A /Span * 100		0.2
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/14/22 03:14	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	07/14/22 03:20	10.0	9.7	9.9	R-A /Span * 100		2.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/14/22 03:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/14/22 03:25	200.0	175.0	174.0	R-A /Span * 100		0.5
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/14/22 03:14	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/14/22 03:20	10.0	8.8	8.8	R-A /Span * 100		0.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	07/14/22 03:14	21.0	18.1	18.2	R-A		0.1
	Zero	07/14/22 03:20	21.0	0.0	0.0	R-A		0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/14/22 15:12	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/14/22 15:22	200.0	184.3	183.2	R-A /Span * 100		0.6
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/14/22 15:12	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	07/14/22 15:17	10.0	8.8	8.7	R-A /Span * 100		1.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/14/22 15:12	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/14/22 15:22	200.0	182.0	178.9	R-A /Span * 100		1.6
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/14/22 15:12	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/14/22 15:17	10.0	8.1	8.2	R-A /Span * 100		1.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	07/14/22 15:12	21.0	18.0	18.0	R-A		0.0
	Zero	07/14/22 15:17	21.0	0.0	0.0	R-A		0.0
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/15/22 02:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/15/22 02:24	200.0	175.0	171.0	R-A /Span * 100		2.0
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/15/22 02:14	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/15/22 02:19	30.0	26.7	26.4	R-A /Span * 100		1.0

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/15/22 02:14	200.0	0.0	-0.1	R-A /Span * 100		0.1
	High	07/15/22 02:25	200.0	182.0	185.5	R-A /Span * 100		1.8
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/15/22 02:14	30.0	0.0	0.1	R-A /Span * 100		0.3
	High	07/15/22 02:20	30.0	26.3	25.6	R-A /Span * 100		2.3
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/15/22 03:14	200.0	0.0	0.1	R-A /Span * 100		0.1
	High	07/15/22 03:24	200.0	182.4	182.8	R-A /Span * 100		0.2
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/15/22 03:14	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	07/15/22 03:19	10.0	9.7	9.9	R-A /Span * 100		2.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/15/22 03:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/15/22 03:24	200.0	175.0	174.0	R-A /Span * 100		0.5
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/15/22 03:14	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/15/22 03:19	10.0	8.8	8.9	R-A /Span * 100		1.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	07/15/22 03:14	21.0	18.1	18.2	R-A		0.1
	Zero	07/15/22 03:19	21.0	0.0	0.0	R-A		0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/15/22 03:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/15/22 03:25	200.0	184.3	182.9	R-A /Span * 100		0.7
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/15/22 03:14	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/15/22 03:20	10.0	8.8	8.7	R-A /Span * 100		1.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/15/22 03:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/15/22 03:25	200.0	182.0	178.9	R-A /Span * 100		1.6
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/15/22 03:14	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/15/22 03:20	10.0	8.1	8.3	R-A /Span * 100		2.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	07/15/22 03:14	21.0	18.0	18.0	R-A		0.0
	Zero	07/15/22 03:20	21.0	0.0	0.0	R-A		0.0

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/16/22 02:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/16/22 02:25	200.0	175.0	170.6	R-A /Span * 100		2.2
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/16/22 02:14	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/16/22 02:19	30.0	26.7	26.3	R-A /Span * 100		1.3
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/16/22 02:15	200.0	0.0	-0.1	R-A /Span * 100		0.1
	High	07/16/22 02:25	200.0	182.0	185.6	R-A /Span * 100		1.8
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/16/22 02:15	30.0	0.0	0.1	R-A /Span * 100		0.3
	High	07/16/22 02:20	30.0	26.3	25.6	R-A /Span * 100		2.3
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/16/22 03:14	200.0	0.0	0.1	R-A /Span * 100		0.1
	High	07/16/22 03:25	200.0	182.4	183.1	R-A /Span * 100		0.4
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/16/22 03:14	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	07/16/22 03:20	10.0	9.7	9.8	R-A /Span * 100		1.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/16/22 03:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/16/22 03:25	200.0	175.0	174.1	R-A /Span * 100		0.5
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/16/22 03:14	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/16/22 03:20	10.0	8.8	8.9	R-A /Span * 100		1.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	07/16/22 03:14	21.0	18.1	18.3	R-A		0.2
	Zero	07/16/22 03:20	21.0	0.0	0.0	R-A		0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/16/22 03:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/16/22 03:25	200.0	184.3	182.9	R-A /Span * 100		0.7
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/16/22 03:15	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/16/22 03:19	10.0	8.8	8.8	R-A /Span * 100		0.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/16/22 03:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/16/22 03:25	200.0	182.0	179.2	R-A /Span * 100		1.4

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

	Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/16/22 03:15	10.0	0.0	R-A /Span * 100		0.0
	High	07/16/22 03:19	10.0	8.1	R-A /Span * 100		1.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	07/16/22 03:15	21.0	18.0	R-A		0.0
	Zero	07/16/22 03:19	21.0	0.0	R-A		0.0
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/17/22 02:14	200.0	0.0	R-A /Span * 100		0.0
	High	07/17/22 02:25	200.0	170.8	R-A /Span * 100		2.1
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/17/22 02:14	30.0	0.0	R-A /Span * 100		0.0
	High	07/17/22 02:19	30.0	26.7	R-A /Span * 100		0.7
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/17/22 02:15	200.0	-0.1	R-A /Span * 100		0.1
	High	07/17/22 02:25	200.0	185.9	R-A /Span * 100		2.0
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/17/22 02:15	30.0	0.1	R-A /Span * 100		0.3
	High	07/17/22 02:20	30.0	25.8	R-A /Span * 100		1.7
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/17/22 03:14	200.0	0.1	R-A /Span * 100		0.1
	High	07/17/22 03:25	200.0	183.1	R-A /Span * 100		0.4
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/17/22 03:14	10.0	0.1	R-A /Span * 100		1.0
	High	07/17/22 03:20	10.0	9.7	R-A /Span * 100		2.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/17/22 03:14	200.0	0.0	R-A /Span * 100		0.0
	High	07/17/22 03:25	200.0	174.1	R-A /Span * 100		0.5
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/17/22 03:14	10.0	0.0	R-A /Span * 100		0.0
	High	07/17/22 03:20	10.0	8.8	R-A /Span * 100		1.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	07/17/22 03:14	21.0	18.3	R-A		0.2
	Zero	07/17/22 03:20	21.0	0.0	R-A		0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/17/22 03:15	200.0	0.0	R-A /Span * 100		0.0
	High	07/17/22 03:24	200.0	183.2	R-A /Span * 100		0.6

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

	Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/17/22 03:15	10.0	0.0	R-A /Span * 100		0.0
	High	07/17/22 03:20	10.0	8.8	R-A /Span * 100		0.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/17/22 03:15	200.0	0.0	R-A /Span * 100		0.0
	High	07/17/22 03:24	200.0	182.0	R-A /Span * 100		1.4
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/17/22 03:15	10.0	0.0	R-A /Span * 100		0.0
	High	07/17/22 03:20	10.0	8.1	R-A /Span * 100		2.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	07/17/22 03:15	21.0	18.0	R-A		0.0
	Zero	07/17/22 03:20	21.0	0.0	R-A		0.0
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/18/22 02:14	200.0	0.0	R-A /Span * 100		0.0
	High	07/18/22 02:25	200.0	175.0	R-A /Span * 100		2.3
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/18/22 02:14	30.0	0.0	R-A /Span * 100		0.0
	High	07/18/22 02:19	30.0	26.7	R-A /Span * 100		2.0
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/18/22 02:14	200.0	0.0	R-A /Span * 100		0.1
	High	07/18/22 02:25	200.0	182.0	R-A /Span * 100		1.6
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/18/22 02:14	30.0	0.0	R-A /Span * 100		0.3
	High	07/18/22 02:19	30.0	26.3	R-A /Span * 100		2.3
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/18/22 03:14	200.0	0.0	R-A /Span * 100		0.1
	High	07/18/22 03:25	200.0	182.4	R-A /Span * 100		0.3
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/18/22 03:14	10.0	0.0	R-A /Span * 100		1.0
	High	07/18/22 03:20	10.0	9.7	R-A /Span * 100		1.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/18/22 03:14	200.0	0.0	R-A /Span * 100		0.0
	High	07/18/22 03:25	200.0	175.0	R-A /Span * 100		0.6
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/18/22 03:14	10.0	0.0	R-A /Span * 100		0.0
	High	07/18/22 03:20	10.0	8.8	R-A /Span * 100		1.0

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

	Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	07/18/22 03:14	21.0	18.1	18.3	R-A	0.2
	Zero	07/18/22 03:20	21.0	0.0	0.0	R-A	0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/18/22 03:14	200.0	0.0	0.0	R-A /Span * 100	0.0
	High	07/18/22 03:24	200.0	184.3	182.6	R-A /Span * 100	0.9
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/18/22 03:14	10.0	0.0	0.1	R-A /Span * 100	1.0
	High	07/18/22 03:19	10.0	8.8	8.8	R-A /Span * 100	0.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/18/22 03:14	200.0	0.0	0.0	R-A /Span * 100	0.0
	High	07/18/22 03:24	200.0	182.0	179.0	R-A /Span * 100	1.5
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/18/22 03:14	10.0	0.0	0.0	R-A /Span * 100	0.0
	High	07/18/22 03:19	10.0	8.1	8.3	R-A /Span * 100	2.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	07/18/22 03:14	21.0	18.0	18.0	R-A	0.0
	Zero	07/18/22 03:19	21.0	0.0	0.0	R-A	0.0
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/19/22 02:15	200.0	0.0	0.1	R-A /Span * 100	0.1
	High	07/19/22 02:25	200.0	175.0	168.7	>1x Alert R-A /Span * 100	3.2
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/19/22 02:15	30.0	0.0	0.1	R-A /Span * 100	0.3
	High	07/19/22 02:20	30.0	26.7	25.5	>1x Alert R-A /Span * 100	4.0
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/19/22 02:14	200.0	0.0	-0.1	R-A /Span * 100	0.1
	High	07/19/22 02:24	200.0	182.0	184.6	R-A /Span * 100	1.3
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/19/22 02:14	30.0	0.0	0.1	R-A /Span * 100	0.3
	High	07/19/22 02:19	30.0	26.3	25.5	>1x Alert R-A /Span * 100	2.7
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/19/22 03:14	200.0	0.0	0.1	R-A /Span * 100	0.1
	High	07/19/22 03:25	200.0	182.4	182.5	R-A /Span * 100	0.1
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/19/22 03:14	10.0	0.0	0.1	R-A /Span * 100	1.0
	High	07/19/22 03:20	10.0	9.7	9.8	R-A /Span * 100	1.0

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

	Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/19/22 03:14	200.0	0.0	R-A /Span * 100		0.0
	High	07/19/22 03:25	200.0	175.0	R-A /Span * 100		0.8
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/19/22 03:14	10.0	0.0	R-A /Span * 100		0.0
	High	07/19/22 03:20	10.0	8.8	R-A /Span * 100		1.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	07/19/22 03:14	21.0	18.1	R-A		0.2
	Zero	07/19/22 03:20	21.0	0.0	R-A		0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/19/22 03:15	200.0	0.0	R-A /Span * 100		0.0
	High	07/19/22 03:25	200.0	184.3	R-A /Span * 100		0.5
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/19/22 03:15	10.0	0.0	R-A /Span * 100		1.0
	High	07/19/22 03:20	10.0	8.8	R-A /Span * 100		0.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/19/22 03:15	200.0	0.0	R-A /Span * 100		0.0
	High	07/19/22 03:25	200.0	182.0	R-A /Span * 100		1.6
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/19/22 03:15	10.0	0.0	R-A /Span * 100		0.0
	High	07/19/22 03:20	10.0	8.1	R-A /Span * 100		1.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	07/19/22 03:15	21.0	18.1	R-A		0.0
	Zero	07/19/22 03:20	21.0	0.0	R-A		0.0
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/20/22 02:15	200.0	0.0	R-A /Span * 100		0.1
	High	07/20/22 02:25	200.0	175.0	R-A /Span * 100		0.4
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/20/22 02:15	30.0	0.0	R-A /Span * 100		0.3
	High	07/20/22 02:20	30.0	26.7	R-A /Span * 100		0.7
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/20/22 02:15	200.0	0.0	R-A /Span * 100		0.1
	High	07/20/22 02:25	200.0	182.0	R-A /Span * 100		0.7
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/20/22 02:15	30.0	0.0	R-A /Span * 100		0.0
	High	07/20/22 02:20	30.0	26.3	R-A /Span * 100		1.0

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/20/22 03:15	200.0	0.0	0.1	R-A /Span * 100		0.1
	High	07/20/22 03:25	200.0	182.4	182.9	R-A /Span * 100		0.3
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/20/22 03:15	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	07/20/22 03:20	10.0	9.7	9.9	R-A /Span * 100		2.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/20/22 03:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/20/22 03:25	200.0	175.0	174.0	R-A /Span * 100		0.5
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/20/22 03:15	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/20/22 03:20	10.0	8.8	8.9	R-A /Span * 100		1.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	07/20/22 03:15	21.0	18.1	18.3	R-A		0.2
	Zero	07/20/22 03:20	21.0	0.0	0.0	R-A		0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/20/22 03:14	200.0	0.0	0.1	R-A /Span * 100		0.1
	High	07/20/22 03:24	200.0	184.3	183.5	R-A /Span * 100		0.4
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/20/22 03:14	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	07/20/22 03:20	10.0	8.8	8.7	R-A /Span * 100		1.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/20/22 03:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/20/22 03:24	200.0	182.0	179.2	R-A /Span * 100		1.4
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/20/22 03:14	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/20/22 03:20	10.0	8.1	8.3	R-A /Span * 100		2.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	07/20/22 03:14	21.0	18.1	18.1	R-A		0.0
	Zero	07/20/22 03:20	21.0	0.0	0.0	R-A		0.0
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/21/22 02:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/21/22 02:24	200.0	175.0	174.4	R-A /Span * 100		0.3
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/21/22 02:14	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/21/22 02:19	30.0	26.7	26.7	R-A /Span * 100		0.0

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/21/22 02:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/21/22 02:25	200.0	182.0	180.4	R-A /Span * 100		0.8
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/21/22 02:14	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/21/22 02:20	30.0	26.3	26.0	R-A /Span * 100		1.0
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/21/22 03:15	200.0	0.0	0.1	R-A /Span * 100		0.1
	High	07/21/22 03:25	200.0	182.4	183.1	R-A /Span * 100		0.4
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/21/22 03:15	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	07/21/22 03:20	10.0	9.7	9.9	R-A /Span * 100		2.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/21/22 03:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/21/22 03:25	200.0	175.0	174.4	R-A /Span * 100		0.3
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/21/22 03:15	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/21/22 03:20	10.0	8.8	8.9	R-A /Span * 100		1.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	07/21/22 03:15	21.0	18.1	18.3	R-A		0.2
	Zero	07/21/22 03:20	21.0	0.0	0.0	R-A		0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/21/22 03:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/21/22 03:25	200.0	184.3	182.6	R-A /Span * 100		0.9
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/21/22 03:15	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	07/21/22 03:20	10.0	8.8	8.8	R-A /Span * 100		0.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/21/22 03:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/21/22 03:25	200.0	182.0	178.8	R-A /Span * 100		1.6
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/21/22 03:15	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/21/22 03:20	10.0	8.1	8.2	R-A /Span * 100		1.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	07/21/22 03:15	21.0	18.1	18.1	R-A		0.0
	Zero	07/21/22 03:20	21.0	0.0	0.0	R-A		0.0

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/22/22 02:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/22/22 02:25	200.0	175.0	174.7	R-A /Span * 100		0.2
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/22/22 02:14	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/22/22 02:20	30.0	26.7	26.8	R-A /Span * 100		0.3
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/22/22 02:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/22/22 02:25	200.0	182.0	180.9	R-A /Span * 100		0.6
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/22/22 02:14	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/22/22 02:19	30.0	26.3	26.1	R-A /Span * 100		0.7
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/22/22 03:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/22/22 03:25	200.0	182.4	183.3	R-A /Span * 100		0.5
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/22/22 03:14	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/22/22 03:19	10.0	9.7	9.9	R-A /Span * 100		2.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/22/22 03:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/22/22 03:25	200.0	175.0	174.3	R-A /Span * 100		0.4
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/22/22 03:14	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/22/22 03:19	10.0	8.8	8.9	R-A /Span * 100		1.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	07/22/22 03:14	21.0	18.3	18.4	R-A		0.1
	Zero	07/22/22 03:19	21.0	0.0	0.0	R-A		0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/22/22 03:14	200.0	0.0	0.1	R-A /Span * 100		0.1
	High	07/22/22 03:25	200.0	184.3	183.1	R-A /Span * 100		0.6
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/22/22 03:14	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	07/22/22 03:20	10.0	8.8	8.8	R-A /Span * 100		0.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/22/22 03:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/22/22 03:25	200.0	182.0	179.1	R-A /Span * 100		1.5

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/22/22 03:14	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/22/22 03:20	10.0	8.1	8.2	R-A /Span * 100		1.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	07/22/22 03:14	21.0	18.1	18.1	R-A		0.0
	Zero	07/22/22 03:20	21.0	0.0	0.0	R-A		0.0
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/23/22 02:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/23/22 02:24	200.0	175.0	174.7	R-A /Span * 100		0.2
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/23/22 02:14	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/23/22 02:19	30.0	26.7	26.7	R-A /Span * 100		0.0
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/23/22 03:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/23/22 03:25	200.0	182.4	183.5	R-A /Span * 100		0.6
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/23/22 03:15	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/23/22 03:20	10.0	9.7	9.9	R-A /Span * 100		2.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/23/22 03:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/23/22 03:25	200.0	175.0	173.9	R-A /Span * 100		0.6
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/23/22 03:15	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/23/22 03:20	10.0	8.8	8.9	R-A /Span * 100		1.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	07/23/22 03:15	21.0	18.3	18.4	R-A		0.1
	Zero	07/23/22 03:20	21.0	0.0	0.0	R-A		0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/23/22 17:34	200.0	0.0	0.1	R-A /Span * 100		0.1
	High	07/23/22 17:45	200.0	184.3	183.6	R-A /Span * 100		0.4
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/23/22 17:34	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	07/23/22 17:40	10.0	8.8	8.8	R-A /Span * 100		0.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/23/22 17:34	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/23/22 17:45	200.0	182.0	179.5	R-A /Span * 100		1.3

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

	Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/23/22 17:34	10.0	0.0		R-A /Span * 100	0.0
	High	07/23/22 17:40	10.0	8.1		R-A /Span * 100	2.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	07/23/22 17:34	21.0	18.1		R-A	0.0
	Zero	07/23/22 17:40	21.0	0.0		R-A	0.0
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/24/22 02:14	200.0	0.0		R-A /Span * 100	0.0
	High	07/24/22 02:25	200.0	173.9		R-A /Span * 100	0.6
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/24/22 02:14	30.0	0.0		R-A /Span * 100	0.0
	High	07/24/22 02:20	30.0	26.7		R-A /Span * 100	0.3
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/24/22 03:14	200.0	0.0		R-A /Span * 100	0.0
	High	07/24/22 03:25	200.0	182.4		R-A /Span * 100	0.5
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/24/22 03:14	10.0	0.0		R-A /Span * 100	1.0
	High	07/24/22 03:20	10.0	9.7		R-A /Span * 100	2.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/24/22 03:14	200.0	0.0		R-A /Span * 100	0.0
	High	07/24/22 03:25	200.0	173.8		R-A /Span * 100	0.6
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/24/22 03:14	10.0	0.0		R-A /Span * 100	0.0
	High	07/24/22 03:20	10.0	8.8		R-A /Span * 100	0.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	07/24/22 03:14	21.0	18.3		R-A	0.1
	Zero	07/24/22 03:20	21.0	0.0		R-A	0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/24/22 08:46	200.0	0.0		R-A /Span * 100	0.0
	High	07/24/22 08:57	200.0	184.3		R-A /Span * 100	0.4
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/24/22 08:46	10.0	0.0		R-A /Span * 100	1.0
	High	07/24/22 08:52	10.0	8.8		R-A /Span * 100	0.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/24/22 08:46	200.0	0.0		R-A /Span * 100	0.0
	High	07/24/22 08:57	200.0	182.0		R-A /Span * 100	1.7

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/24/22 08:46	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/24/22 08:52	10.0	8.1	8.2	R-A /Span * 100		1.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	07/24/22 08:46	21.0	18.1	18.1	R-A		0.0
	Zero	07/24/22 08:52	21.0	0.0	0.0	R-A		0.0
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/25/22 02:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/25/22 02:24	200.0	175.0	173.6	R-A /Span * 100		0.7
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/25/22 02:14	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/25/22 02:19	30.0	26.7	26.6	R-A /Span * 100		0.3
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/25/22 02:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/25/22 02:25	200.0	182.0	180.1	R-A /Span * 100		1.0
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/25/22 02:15	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/25/22 02:20	30.0	26.3	26.0	R-A /Span * 100		1.0
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/25/22 03:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/25/22 03:25	200.0	182.4	183.3	R-A /Span * 100		0.5
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/25/22 03:14	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	07/25/22 03:19	10.0	9.7	9.9	R-A /Span * 100		2.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/25/22 03:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/25/22 03:25	200.0	175.0	174.5	R-A /Span * 100		0.3
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/25/22 03:14	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/25/22 03:19	10.0	8.8	8.9	R-A /Span * 100		1.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	07/25/22 03:14	21.0	18.3	18.4	R-A		0.1
	Zero	07/25/22 03:19	21.0	0.0	0.0	R-A		0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/25/22 03:14	200.0	0.0	0.1	R-A /Span * 100		0.1
	High	07/25/22 03:25	200.0	184.3	183.2	R-A /Span * 100		0.6

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/25/22 03:14	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	07/25/22 03:20	10.0	8.8	8.8	R-A /Span * 100		0.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/25/22 03:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/25/22 03:25	200.0	182.0	178.3	R-A /Span * 100		1.9
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/25/22 03:14	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/25/22 03:20	10.0	8.1	8.2	R-A /Span * 100		1.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	07/25/22 03:14	21.0	18.1	18.1	R-A		0.0
	Zero	07/25/22 03:20	21.0	0.0	0.0	R-A		0.0
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/26/22 02:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/26/22 02:24	200.0	182.0	180.6	R-A /Span * 100		0.7
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/26/22 02:14	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/26/22 02:19	30.0	26.3	26.0	R-A /Span * 100		1.0
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/26/22 02:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/26/22 02:25	200.0	175.0	173.7	R-A /Span * 100		0.7
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/26/22 02:15	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/26/22 02:19	30.0	26.7	26.6	R-A /Span * 100		0.3
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/26/22 03:14	200.0	0.0	0.1	R-A /Span * 100		0.1
	High	07/26/22 03:25	200.0	182.4	183.5	R-A /Span * 100		0.6
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/26/22 03:14	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	07/26/22 03:20	10.0	9.7	9.9	R-A /Span * 100		2.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/26/22 03:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/26/22 03:25	200.0	175.0	174.3	R-A /Span * 100		0.4
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/26/22 03:14	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/26/22 03:20	10.0	8.8	8.9	R-A /Span * 100		1.0

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

	Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	07/26/22 03:14	21.0	18.3	18.4	R-A	0.1
	Zero	07/26/22 03:20	21.0	0.0	0.0	R-A	0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/26/22 03:15	200.0	0.0	0.0	R-A /Span * 100	0.0
	High	07/26/22 03:24	200.0	184.3	183.1	R-A /Span * 100	0.6
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/26/22 03:15	10.0	0.0	0.1	R-A /Span * 100	1.0
	High	07/26/22 03:20	10.0	8.8	8.8	R-A /Span * 100	0.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/26/22 03:15	200.0	0.0	0.0	R-A /Span * 100	0.0
	High	07/26/22 03:24	200.0	182.0	178.6	R-A /Span * 100	1.7
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/26/22 03:15	10.0	0.0	0.0	R-A /Span * 100	0.0
	High	07/26/22 03:20	10.0	8.1	8.2	R-A /Span * 100	1.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	07/26/22 03:15	21.0	18.1	18.1	R-A	0.0
	Zero	07/26/22 03:20	21.0	0.0	0.0	R-A	0.0
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/27/22 02:14	200.0	0.0	0.0	R-A /Span * 100	0.0
	High	07/27/22 02:25	200.0	181.0	178.2	R-A /Span * 100	1.4
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/27/22 02:14	30.0	0.0	0.0	R-A /Span * 100	0.0
	High	07/27/22 02:20	30.0	26.7	26.5	R-A /Span * 100	0.7
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/27/22 02:15	200.0	0.0	0.0	R-A /Span * 100	0.0
	High	07/27/22 02:25	200.0	182.0	180.2	R-A /Span * 100	0.9
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/27/22 02:15	30.0	0.0	0.0	R-A /Span * 100	0.0
	High	07/27/22 02:20	30.0	26.3	26.0	R-A /Span * 100	1.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/27/22 03:14	200.0	0.0	0.0	R-A /Span * 100	0.0
	High	07/27/22 03:24	200.0	184.3	183.2	R-A /Span * 100	0.6
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/27/22 03:14	10.0	0.0	0.1	R-A /Span * 100	1.0
	High	07/27/22 03:19	10.0	8.8	8.8	R-A /Span * 100	0.0

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:26 Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

	Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/27/22 03:14	200.0	0.0	R-A /Span * 100		0.0
	High	07/27/22 03:24	200.0	182.0	R-A /Span * 100		1.8
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/27/22 03:14	10.0	0.0	R-A /Span * 100		0.0
	High	07/27/22 03:19	10.0	8.1	R-A /Span * 100		1.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	07/27/22 03:14	21.0	18.1	R-A		0.0
	Zero	07/27/22 03:19	21.0	0.0	R-A		0.0
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/27/22 03:15	200.0	0.0	R-A /Span * 100		0.0
	High	07/27/22 03:25	200.0	182.4	R-A /Span * 100		0.6
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/27/22 03:15	10.0	0.0	R-A /Span * 100		0.0
	High	07/27/22 03:20	10.0	9.7	R-A /Span * 100		2.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/27/22 03:15	200.0	0.0	R-A /Span * 100		0.0
	High	07/27/22 03:25	200.0	181.0	R-A /Span * 100		0.7
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/27/22 03:15	10.0	0.0	R-A /Span * 100		0.0
	High	07/27/22 03:20	10.0	8.8	R-A /Span * 100		1.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	07/27/22 03:15	21.0	18.3	R-A		0.1
	Zero	07/27/22 03:20	21.0	0.0	R-A		0.0
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/28/22 02:14	200.0	0.0	R-A /Span * 100		0.0
	High	07/28/22 02:25	200.0	181.0	R-A /Span * 100		1.3
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/28/22 02:14	30.0	0.0	R-A /Span * 100		0.0
	High	07/28/22 02:19	30.0	26.7	R-A /Span * 100		0.7
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/28/22 02:15	200.0	0.0	R-A /Span * 100		0.0
	High	07/28/22 02:25	200.0	182.0	R-A /Span * 100		0.8
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/28/22 02:15	30.0	0.0	R-A /Span * 100		0.0
	High	07/28/22 02:20	30.0	26.3	R-A /Span * 100		1.0

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/28/22 03:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/28/22 03:25	200.0	182.4	183.9	R-A /Span * 100		0.8
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/28/22 03:14	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	07/28/22 03:20	10.0	9.7	9.8	R-A /Span * 100		1.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/28/22 03:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/28/22 03:25	200.0	181.0	180.1	R-A /Span * 100		0.5
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/28/22 03:14	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/28/22 03:20	10.0	8.8	8.9	R-A /Span * 100		1.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	07/28/22 03:14	21.0	18.3	18.4	R-A		0.1
	Zero	07/28/22 03:20	21.0	0.0	0.0	R-A		0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/28/22 03:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/28/22 03:25	200.0	184.3	183.2	R-A /Span * 100		0.6
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/28/22 03:15	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	07/28/22 03:20	10.0	8.8	8.8	R-A /Span * 100		0.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/28/22 03:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/28/22 03:25	200.0	182.0	178.3	R-A /Span * 100		1.9
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/28/22 03:15	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/28/22 03:20	10.0	8.1	8.2	R-A /Span * 100		1.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	07/28/22 03:15	21.0	18.1	18.1	R-A		0.0
	Zero	07/28/22 03:20	21.0	0.0	0.0	R-A		0.0
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/29/22 02:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/29/22 02:24	200.0	181.0	178.0	R-A /Span * 100		1.5
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/29/22 02:14	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/29/22 02:20	30.0	26.7	26.4	R-A /Span * 100		1.0

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/29/22 02:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/29/22 02:25	200.0	182.0	180.2	R-A /Span * 100		0.9
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/29/22 02:14	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/29/22 02:20	30.0	26.3	26.0	R-A /Span * 100		1.0
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/29/22 03:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/29/22 03:25	200.0	182.4	184.0	R-A /Span * 100		0.8
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/29/22 03:15	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/29/22 03:19	10.0	9.7	9.9	R-A /Span * 100		2.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/29/22 03:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/29/22 03:25	200.0	181.0	180.2	R-A /Span * 100		0.4
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/29/22 03:15	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/29/22 03:19	10.0	8.8	8.9	R-A /Span * 100		1.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	07/29/22 03:15	21.0	18.3	18.4	R-A		0.1
	Zero	07/29/22 03:19	21.0	0.0	0.0	R-A		0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/29/22 03:14	200.0	0.0	0.1	R-A /Span * 100		0.1
	High	07/29/22 03:25	200.0	184.3	182.9	R-A /Span * 100		0.7
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/29/22 03:14	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	07/29/22 03:19	10.0	8.8	8.8	R-A /Span * 100		0.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	07/29/22 03:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/29/22 03:25	200.0	182.0	178.1	R-A /Span * 100		2.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	07/29/22 03:14	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	07/29/22 03:19	10.0	8.1	8.2	R-A /Span * 100		1.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	07/29/22 03:14	21.0	18.1	18.1	R-A		0.0
	Zero	07/29/22 03:19	21.0	0.0	0.0	R-A		0.0

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

	Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/30/22 02:14	200.0	0.0		R-A /Span * 100	0.0
	High	07/30/22 02:25	200.0	181.0	177.7	R-A /Span * 100	1.7
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/30/22 02:14	30.0	0.0		R-A /Span * 100	0.0
	High	07/30/22 02:20	30.0	27.5	26.6	>1x Alert R-A /Span * 100	3.0
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/30/22 02:14	200.0	0.0		R-A /Span * 100	0.0
	High	07/30/22 02:25	200.0	182.0	180.2	R-A /Span * 100	0.9
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/30/22 02:14	30.0	0.0		R-A /Span * 100	0.0
	High	07/30/22 02:20	30.0	26.3	25.9	R-A /Span * 100	1.3
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/30/22 03:14	200.0	0.0		R-A /Span * 100	0.0
	High	07/30/22 03:25	200.0	182.4	184.0	R-A /Span * 100	0.8
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/30/22 03:14	10.0	0.0		R-A /Span * 100	0.0
	High	07/30/22 03:20	10.0	9.7	9.9	R-A /Span * 100	2.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/30/22 03:14	200.0	0.0		R-A /Span * 100	0.0
	High	07/30/22 03:25	200.0	181.0	179.9	R-A /Span * 100	0.6
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/30/22 03:14	10.0	0.0		R-A /Span * 100	0.0
	High	07/30/22 03:20	10.0	8.8	8.8	R-A /Span * 100	0.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	07/30/22 03:14	21.0	18.3	18.4	R-A	0.1
	Zero	07/30/22 03:20	21.0	0.0	0.0	R-A	0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/30/22 03:14	200.0	0.0		R-A /Span * 100	0.0
	High	07/30/22 03:25	200.0	184.3	183.3	R-A /Span * 100	0.5
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/30/22 03:14	10.0	0.0	0.1	R-A /Span * 100	1.0
	High	07/30/22 03:20	10.0	8.8	8.8	R-A /Span * 100	0.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/30/22 03:14	200.0	0.0		R-A /Span * 100	0.0
	High	07/30/22 03:25	200.0	182.0	177.9	R-A /Span * 100	2.1

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

	Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/30/22 03:14	10.0	0.0		R-A /Span * 100	0.0
	High	07/30/22 03:20	10.0	8.1		R-A /Span * 100	1.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	07/30/22 03:14	21.0	18.1		R-A	0.0
	Zero	07/30/22 03:20	21.0	0.0		R-A	0.0
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/31/22 02:15	200.0	0.0		R-A /Span * 100	0.0
	High	07/31/22 02:25	200.0	181.0		R-A /Span * 100	1.8
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/31/22 02:15	30.0	0.0		R-A /Span * 100	0.0
	High	07/31/22 02:20	30.0	27.5	>1x Alert	R-A /Span * 100	2.7
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/31/22 02:15	200.0	0.0		R-A /Span * 100	0.0
	High	07/31/22 02:25	200.0	182.0		R-A /Span * 100	0.7
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/31/22 02:15	30.0	0.0		R-A /Span * 100	0.0
	High	07/31/22 02:19	30.0	27.5	>1x Alert	R-A /Span * 100	3.7
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/31/22 03:14	200.0	0.0		R-A /Span * 100	0.0
	High	07/31/22 03:25	200.0	182.4		R-A /Span * 100	0.6
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/31/22 03:14	10.0	0.0		R-A /Span * 100	0.0
	High	07/31/22 03:19	10.0	9.7		R-A /Span * 100	1.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/31/22 03:14	200.0	0.0		R-A /Span * 100	0.0
	High	07/31/22 03:25	200.0	181.0		R-A /Span * 100	0.6
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/31/22 03:14	10.0	0.0		R-A /Span * 100	0.0
	High	07/31/22 03:19	10.0	8.8		R-A /Span * 100	0.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	07/31/22 03:14	21.0	18.3		R-A	0.1
	Zero	07/31/22 03:19	21.0	0.0		R-A	0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/31/22 03:14	200.0	0.0		R-A /Span * 100	0.0
	High	07/31/22 03:25	200.0	184.3		R-A /Span * 100	0.9

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

	Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/31/22 03:14	10.0	0.0	0.1	R-A /Span * 100	1.0
	High	07/31/22 03:19	10.0	8.8	8.7	R-A /Span * 100	1.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	07/31/22 03:14	200.0	0.0	0.0	R-A /Span * 100	0.0
	High	07/31/22 03:25	200.0	182.0	178.1	R-A /Span * 100	2.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	07/31/22 03:14	10.0	0.0	0.0	R-A /Span * 100	0.0
	High	07/31/22 03:19	10.0	8.1	8.2	R-A /Span * 100	1.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	07/31/22 03:14	21.0	18.1	18.1	R-A	0.0
	Zero	07/31/22 03:19	21.0	0.0	0.0	R-A	0.0
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	08/01/22 02:14	200.0	0.0	0.0	R-A /Span * 100	0.0
	High	08/01/22 02:24	200.0	182.0	180.4	R-A /Span * 100	0.8
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	08/01/22 02:14	30.0	0.0	0.0	R-A /Span * 100	0.0
	High	08/01/22 02:20	30.0	27.5	26.4	>1x Alert R-A /Span * 100	3.7
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	08/01/22 02:15	200.0	0.0	0.0	R-A /Span * 100	0.0
	High	08/01/22 02:25	200.0	181.0	177.6	R-A /Span * 100	1.7
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	08/01/22 02:15	30.0	0.0	0.0	R-A /Span * 100	0.0
	High	08/01/22 02:20	30.0	27.5	26.8	R-A /Span * 100	2.3
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	08/01/22 03:15	200.0	0.0	0.0	R-A /Span * 100	0.0
	High	08/01/22 03:25	200.0	182.4	183.6	R-A /Span * 100	0.6
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	08/01/22 03:15	10.0	0.0	0.0	R-A /Span * 100	0.0
	High	08/01/22 03:20	10.0	9.7	9.9	R-A /Span * 100	2.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	08/01/22 03:15	200.0	0.0	0.0	R-A /Span * 100	0.0
	High	08/01/22 03:25	200.0	181.0	179.8	R-A /Span * 100	0.6
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	08/01/22 03:15	10.0	0.0	0.0	R-A /Span * 100	0.0
	High	08/01/22 03:20	10.0	8.8	8.9	R-A /Span * 100	1.0

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

	Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	08/01/22 03:15	21.0	18.3	18.4	R-A	0.1
	Zero	08/01/22 03:20	21.0	0.0	0.0	R-A	0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	08/01/22 03:14	200.0	0.0	0.0	R-A /Span * 100	0.0
	High	08/01/22 03:24	200.0	184.3	182.5	R-A /Span * 100	0.9
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	08/01/22 03:14	10.0	0.0	0.1	R-A /Span * 100	1.0
	High	08/01/22 03:20	10.0	8.8	8.8	R-A /Span * 100	0.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	08/01/22 03:14	200.0	0.0	0.0	R-A /Span * 100	0.0
	High	08/01/22 03:24	200.0	182.0	177.9	R-A /Span * 100	2.1
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	08/01/22 03:14	10.0	0.0	0.0	R-A /Span * 100	0.0
	High	08/01/22 03:20	10.0	8.1	8.2	R-A /Span * 100	1.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	08/01/22 03:14	21.0	18.1	18.1	R-A	0.0
	Zero	08/01/22 03:20	21.0	0.0	0.0	R-A	0.0
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	08/02/22 02:14	200.0	0.0	0.0	R-A /Span * 100	0.0
	High	08/02/22 02:24	200.0	182.0	180.6	R-A /Span * 100	0.7
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	08/02/22 02:14	30.0	0.0	0.0	R-A /Span * 100	0.0
	High	08/02/22 02:19	30.0	27.5	27.3	R-A /Span * 100	0.7
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	08/02/22 02:14	200.0	0.0	0.0	R-A /Span * 100	0.0
	High	08/02/22 02:25	200.0	181.0	174.5	>1x Alert R-A /Span * 100	3.3
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	08/02/22 02:14	30.0	0.0	0.0	R-A /Span * 100	0.0
	High	08/02/22 02:19	30.0	27.5	27.5	R-A /Span * 100	0.0
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	08/02/22 03:14	200.0	0.0	0.0	R-A /Span * 100	0.0
	High	08/02/22 03:24	200.0	182.4	183.3	R-A /Span * 100	0.5
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	08/02/22 03:14	10.0	0.0	0.0	R-A /Span * 100	0.0
	High	08/02/22 03:19	10.0	9.7	9.9	R-A /Span * 100	2.0

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/02/22 03:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/02/22 03:24	200.0	181.0	179.9	R-A /Span * 100		0.6
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/02/22 03:14	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/02/22 03:19	10.0	8.8	8.9	R-A /Span * 100		1.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	08/02/22 03:14	21.0	18.3	18.4	R-A		0.1
	Zero	08/02/22 03:19	21.0	0.0	0.0	R-A		0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/02/22 03:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/02/22 03:25	200.0	184.3	182.6	R-A /Span * 100		0.9
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/02/22 03:14	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	08/02/22 03:19	10.0	8.8	8.7	R-A /Span * 100		1.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/02/22 03:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/02/22 03:25	200.0	182.0	176.9	>1x Alert R-A /Span * 100		2.6
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/02/22 03:14	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/02/22 03:19	10.0	8.1	8.2	R-A /Span * 100		1.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	08/02/22 03:14	21.0	18.1	18.1	R-A		0.0
	Zero	08/02/22 03:19	21.0	0.0	0.0	R-A		0.0
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/03/22 02:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/03/22 02:24	200.0	181.0	176.1	R-A /Span * 100		2.5
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/03/22 02:15	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/03/22 02:20	30.0	27.5	27.7	R-A /Span * 100		0.7
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/03/22 02:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/03/22 02:25	200.0	182.0	181.6	R-A /Span * 100		0.2
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/03/22 02:14	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/03/22 02:19	30.0	27.5	27.5	R-A /Span * 100		0.0

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/03/22 03:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/03/22 03:24	200.0	182.4	184.3	R-A /Span * 100		1.0
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/03/22 03:14	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/03/22 03:19	10.0	9.7	9.9	R-A /Span * 100		2.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/03/22 03:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/03/22 03:24	200.0	181.0	180.5	R-A /Span * 100		0.3
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/03/22 03:14	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/03/22 03:19	10.0	8.8	8.9	R-A /Span * 100		1.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	08/03/22 03:14	21.0	18.3	18.4	R-A		0.1
	Zero	08/03/22 03:19	21.0	0.0	0.0	R-A		0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/03/22 03:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/03/22 03:25	200.0	184.3	182.6	R-A /Span * 100		0.9
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/03/22 03:14	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	08/03/22 03:19	10.0	8.8	8.8	R-A /Span * 100		0.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/03/22 03:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/03/22 03:25	200.0	182.0	178.3	R-A /Span * 100		1.9
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/03/22 03:14	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/03/22 03:19	10.0	8.1	8.2	R-A /Span * 100		1.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	08/03/22 03:14	21.0	18.1	18.1	R-A		0.0
	Zero	08/03/22 03:19	21.0	0.0	0.0	R-A		0.0
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/04/22 02:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/04/22 02:25	200.0	181.0	175.8	>1x Alert R-A /Span * 100		2.6
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/04/22 02:15	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/04/22 02:20	30.0	27.5	27.5	R-A /Span * 100		0.0

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:26 Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/04/22 02:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/04/22 02:25	200.0	182.0	180.2	R-A /Span * 100		0.9
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/04/22 02:14	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/04/22 02:19	30.0	27.5	27.5	R-A /Span * 100		0.0
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/04/22 03:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/04/22 03:24	200.0	182.4	184.4	R-A /Span * 100		1.0
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/04/22 03:14	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	08/04/22 03:19	10.0	9.7	9.9	R-A /Span * 100		2.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/04/22 03:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/04/22 03:24	200.0	181.0	180.4	R-A /Span * 100		0.3
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/04/22 03:14	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/04/22 03:19	10.0	8.8	8.8	R-A /Span * 100		0.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	08/04/22 03:14	21.0	18.3	18.4	R-A		0.1
	Zero	08/04/22 03:19	21.0	0.0	0.0	R-A		0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/04/22 03:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/04/22 03:25	200.0	184.9	185.3	R-A /Span * 100		0.2
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/04/22 03:15	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/04/22 03:19	10.0	8.8	8.8	R-A /Span * 100		0.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/04/22 03:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/04/22 03:25	200.0	182.0	181.0	R-A /Span * 100		0.5
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/04/22 03:15	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/04/22 03:19	10.0	8.1	8.1	R-A /Span * 100		0.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	08/04/22 03:15	21.0	18.1	18.1	R-A		0.0
	Zero	08/04/22 03:19	21.0	0.0	0.0	R-A		0.0

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/05/22 02:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/05/22 02:24	200.0	181.0	181.2	R-A /Span * 100		0.1
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/05/22 02:14	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/05/22 02:19	30.0	27.5	27.4	R-A /Span * 100		0.3
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/05/22 02:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/05/22 02:25	200.0	182.0	181.4	R-A /Span * 100		0.3
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/05/22 02:15	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/05/22 02:20	30.0	27.5	27.5	R-A /Span * 100		0.0
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/05/22 03:15	200.0	0.0	0.1	R-A /Span * 100		0.1
	High	08/05/22 03:25	200.0	182.4	184.3	R-A /Span * 100		1.0
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/05/22 03:15	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	08/05/22 03:19	10.0	9.7	9.9	R-A /Span * 100		2.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/05/22 03:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/05/22 03:25	200.0	181.0	180.4	R-A /Span * 100		0.3
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/05/22 03:15	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/05/22 03:19	10.0	8.8	8.9	R-A /Span * 100		1.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	08/05/22 03:15	21.0	18.3	18.4	R-A		0.1
	Zero	08/05/22 03:19	21.0	0.0	0.0	R-A		0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/05/22 03:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/05/22 03:25	200.0	184.9	185.3	R-A /Span * 100		0.2
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/05/22 03:14	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/05/22 03:20	10.0	8.8	8.8	R-A /Span * 100		0.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/05/22 03:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/05/22 03:25	200.0	182.0	181.5	R-A /Span * 100		0.3

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

	Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	08/05/22 03:14	10.0	0.0	R-A /Span * 100		0.0
	High	08/05/22 03:20	10.0	8.1	R-A /Span * 100		0.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	08/05/22 03:14	21.0	18.1	R-A		0.0
	Zero	08/05/22 03:20	21.0	0.0	R-A		0.0
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	08/06/22 02:14	200.0	0.1	R-A /Span * 100		0.1
	High	08/06/22 02:25	200.0	181.0	R-A /Span * 100		0.7
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	08/06/22 02:14	30.0	0.1	R-A /Span * 100		0.3
	High	08/06/22 02:20	30.0	27.5	R-A /Span * 100		1.0
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	08/06/22 02:15	200.0	0.0	R-A /Span * 100		0.0
	High	08/06/22 02:25	200.0	182.0	R-A /Span * 100		0.9
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	08/06/22 02:15	30.0	0.0	R-A /Span * 100		0.0
	High	08/06/22 02:20	30.0	27.5	R-A /Span * 100		0.7
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	08/06/22 03:14	200.0	0.1	R-A /Span * 100		0.1
	High	08/06/22 03:25	200.0	182.4	R-A /Span * 100		0.8
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	08/06/22 03:14	10.0	0.1	R-A /Span * 100		1.0
	High	08/06/22 03:20	10.0	9.7	R-A /Span * 100		2.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	08/06/22 03:14	200.0	0.0	R-A /Span * 100		0.0
	High	08/06/22 03:25	200.0	181.0	R-A /Span * 100		0.4
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	08/06/22 03:14	10.0	0.0	R-A /Span * 100		0.0
	High	08/06/22 03:20	10.0	8.8	R-A /Span * 100		1.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	08/06/22 03:14	21.0	18.3	R-A		0.1
	Zero	08/06/22 03:20	21.0	0.0	R-A		0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	08/06/22 03:14	200.0	0.0	R-A /Span * 100		0.0
	High	08/06/22 03:25	200.0	184.9	R-A /Span * 100		0.0

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

	Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	08/06/22 03:14	10.0	0.0	R-A /Span * 100		0.0
	High	08/06/22 03:19	10.0	8.8	R-A /Span * 100		1.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	08/06/22 03:14	200.0	0.0	R-A /Span * 100		0.0
	High	08/06/22 03:25	200.0	182.0	R-A /Span * 100		0.7
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	08/06/22 03:14	10.0	0.0	R-A /Span * 100		0.0
	High	08/06/22 03:19	10.0	8.1	R-A /Span * 100		0.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	08/06/22 03:14	21.0	18.1	R-A		0.0
	Zero	08/06/22 03:19	21.0	0.0	R-A		0.0
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	08/07/22 02:15	200.0	0.0	R-A /Span * 100		0.0
	High	08/07/22 02:25	200.0	181.0	R-A /Span * 100		0.6
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	08/07/22 02:15	30.0	0.0	R-A /Span * 100		0.0
	High	08/07/22 02:20	30.0	27.5	R-A /Span * 100		0.7
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	08/07/22 02:14	200.0	0.0	R-A /Span * 100		0.0
	High	08/07/22 02:24	200.0	182.0	R-A /Span * 100		0.9
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	08/07/22 02:14	30.0	0.0	R-A /Span * 100		0.0
	High	08/07/22 02:19	30.0	27.5	R-A /Span * 100		0.7
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	08/07/22 03:15	200.0	0.0	R-A /Span * 100		0.1
	High	08/07/22 03:25	200.0	182.4	R-A /Span * 100		0.8
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	08/07/22 03:15	10.0	0.0	R-A /Span * 100		1.0
	High	08/07/22 03:20	10.0	9.7	R-A /Span * 100		2.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	08/07/22 03:15	200.0	0.0	R-A /Span * 100		0.0
	High	08/07/22 03:25	200.0	181.0	R-A /Span * 100		0.3
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	08/07/22 03:15	10.0	0.0	R-A /Span * 100		0.0
	High	08/07/22 03:20	10.0	8.8	R-A /Span * 100		1.0

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:26 Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

	Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	08/07/22 03:15	21.0	18.2	18.3	R-A	0.1
	Zero	08/07/22 03:20	21.0	0.0	0.0	R-A	0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	08/07/22 03:14	200.0	0.0	0.0	R-A /Span * 100	0.0
	High	08/07/22 03:25	200.0	184.9	184.9	R-A /Span * 100	0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	08/07/22 03:14	10.0	0.0	0.0	R-A /Span * 100	0.0
	High	08/07/22 03:20	10.0	8.8	8.7	R-A /Span * 100	1.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	08/07/22 03:14	200.0	0.0	0.0	R-A /Span * 100	0.0
	High	08/07/22 03:25	200.0	182.0	180.9	R-A /Span * 100	0.6
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	08/07/22 03:14	10.0	0.0	0.0	R-A /Span * 100	0.0
	High	08/07/22 03:20	10.0	8.1	8.1	R-A /Span * 100	0.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	08/07/22 03:14	21.0	18.1	18.1	R-A	0.0
	Zero	08/07/22 03:20	21.0	0.0	0.0	R-A	0.0
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	08/08/22 02:14	200.0	0.0	0.0	R-A /Span * 100	0.0
	High	08/08/22 02:25	200.0	181.0	179.9	R-A /Span * 100	0.6
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	08/08/22 02:14	30.0	0.0	0.0	R-A /Span * 100	0.0
	High	08/08/22 02:20	30.0	27.5	27.2	R-A /Span * 100	1.0
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	08/08/22 02:14	200.0	0.0	0.0	R-A /Span * 100	0.0
	High	08/08/22 02:25	200.0	182.0	180.3	R-A /Span * 100	0.9
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	08/08/22 02:14	30.0	0.0	0.0	R-A /Span * 100	0.0
	High	08/08/22 02:20	30.0	27.5	27.3	R-A /Span * 100	0.7
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	08/08/22 03:15	200.0	0.0	0.1	R-A /Span * 100	0.1
	High	08/08/22 03:25	200.0	182.4	183.9	R-A /Span * 100	0.8
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	08/08/22 03:15	10.0	0.0	0.1	R-A /Span * 100	1.0
	High	08/08/22 03:20	10.0	9.7	9.9	R-A /Span * 100	2.0

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

	Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	08/08/22 03:15	200.0	0.0	R-A /Span * 100		0.0
	High	08/08/22 03:25	200.0	181.0	R-A /Span * 100		0.5
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	08/08/22 03:15	10.0	0.0	R-A /Span * 100		0.0
	High	08/08/22 03:20	10.0	8.8	R-A /Span * 100		0.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	08/08/22 03:15	21.0	18.2	R-A		0.1
	Zero	08/08/22 03:20	21.0	0.0	R-A		0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	08/08/22 03:14	200.0	0.0	R-A /Span * 100		0.0
	High	08/08/22 03:25	200.0	184.9	R-A /Span * 100		0.1
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	08/08/22 03:14	10.0	0.0	R-A /Span * 100		1.0
	High	08/08/22 03:20	10.0	8.8	R-A /Span * 100		1.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	08/08/22 03:14	200.0	0.0	R-A /Span * 100		0.0
	High	08/08/22 03:25	200.0	182.0	R-A /Span * 100		0.6
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	08/08/22 03:14	10.0	0.0	R-A /Span * 100		0.0
	High	08/08/22 03:20	10.0	8.1	R-A /Span * 100		0.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	08/08/22 03:14	21.0	18.1	R-A		0.0
	Zero	08/08/22 03:20	21.0	0.0	R-A		0.0
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	08/09/22 02:14	200.0	0.0	R-A /Span * 100		0.0
	High	08/09/22 02:25	200.0	181.0	R-A /Span * 100		0.8
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	08/09/22 02:14	30.0	0.0	R-A /Span * 100		0.0
	High	08/09/22 02:19	30.0	27.5	R-A /Span * 100		1.3
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	08/09/22 02:15	200.0	0.0	R-A /Span * 100		0.0
	High	08/09/22 02:25	200.0	182.0	R-A /Span * 100		0.5
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	08/09/22 02:15	30.0	0.0	R-A /Span * 100		0.0
	High	08/09/22 02:20	30.0	27.5	R-A /Span * 100		0.3

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/09/22 03:15	200.0	0.0	0.1	R-A /Span * 100		0.1
	High	08/09/22 03:25	200.0	182.4	184.0	R-A /Span * 100		0.8
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/09/22 03:15	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	08/09/22 03:19	10.0	9.7	9.9	R-A /Span * 100		2.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/09/22 03:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/09/22 03:25	200.0	181.0	179.9	R-A /Span * 100		0.6
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/09/22 03:15	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/09/22 03:19	10.0	8.8	8.8	R-A /Span * 100		0.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	08/09/22 03:15	21.0	18.2	18.3	R-A		0.1
	Zero	08/09/22 03:19	21.0	0.0	0.0	R-A		0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/09/22 03:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/09/22 03:25	200.0	184.9	185.4	R-A /Span * 100		0.3
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/09/22 03:15	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/09/22 03:19	10.0	8.8	8.7	R-A /Span * 100		1.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/09/22 03:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/09/22 03:25	200.0	182.0	180.9	R-A /Span * 100		0.6
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/09/22 03:15	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/09/22 03:19	10.0	8.1	8.1	R-A /Span * 100		0.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	08/09/22 03:15	21.0	18.1	18.1	R-A		0.0
	Zero	08/09/22 03:19	21.0	0.0	0.0	R-A		0.0
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/10/22 02:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/10/22 02:25	200.0	181.0	179.2	R-A /Span * 100		0.9
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/10/22 02:15	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/10/22 02:20	30.0	27.5	27.0	R-A /Span * 100		1.7

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:26 Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/10/22 02:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/10/22 02:25	200.0	182.0	181.0	R-A /Span * 100		0.5
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/10/22 02:15	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/10/22 02:19	30.0	27.5	27.4	R-A /Span * 100		0.3
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/10/22 03:14	200.0	0.0	0.1	R-A /Span * 100		0.1
	High	08/10/22 03:25	200.0	182.4	183.3	R-A /Span * 100		0.5
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/10/22 03:14	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	08/10/22 03:20	10.0	9.7	9.9	R-A /Span * 100		2.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/10/22 03:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/10/22 03:25	200.0	181.0	179.6	R-A /Span * 100		0.7
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/10/22 03:14	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/10/22 03:20	10.0	8.8	8.8	R-A /Span * 100		0.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	08/10/22 03:14	21.0	18.2	18.3	R-A		0.1
	Zero	08/10/22 03:20	21.0	0.0	0.0	R-A		0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/10/22 03:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/10/22 03:25	200.0	184.9	183.9	R-A /Span * 100		0.5
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/10/22 03:15	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/10/22 03:20	10.0	8.8	8.7	R-A /Span * 100		1.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/10/22 03:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/10/22 03:25	200.0	182.0	180.6	R-A /Span * 100		0.7
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/10/22 03:15	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/10/22 03:20	10.0	8.1	8.0	R-A /Span * 100		1.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	08/10/22 03:15	21.0	18.1	18.1	R-A		0.0
	Zero	08/10/22 03:20	21.0	0.0	0.0	R-A		0.0

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/11/22 02:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/11/22 02:24	200.0	181.0	179.3	R-A /Span * 100		0.9
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/11/22 02:15	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/11/22 02:19	30.0	27.5	27.1	R-A /Span * 100		1.3
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/11/22 02:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/11/22 02:25	200.0	182.0	181.2	R-A /Span * 100		0.4
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/11/22 02:14	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/11/22 02:20	30.0	27.5	27.5	R-A /Span * 100		0.0
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/11/22 03:15	200.0	0.0	0.1	R-A /Span * 100		0.1
	High	08/11/22 03:25	200.0	182.4	183.5	R-A /Span * 100		0.6
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/11/22 03:15	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	08/11/22 03:20	10.0	9.7	9.9	R-A /Span * 100		2.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/11/22 03:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/11/22 03:25	200.0	181.0	179.5	R-A /Span * 100		0.8
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/11/22 03:15	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/11/22 03:20	10.0	8.8	8.8	R-A /Span * 100		0.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	08/11/22 03:15	21.0	18.2	18.3	R-A		0.1
	Zero	08/11/22 03:20	21.0	0.0	0.0	R-A		0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/11/22 03:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/11/22 03:25	200.0	184.9	184.0	R-A /Span * 100		0.5
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/11/22 03:14	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/11/22 03:20	10.0	8.8	8.7	R-A /Span * 100		1.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/11/22 03:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/11/22 03:25	200.0	182.0	180.6	R-A /Span * 100		0.7

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

	Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	08/11/22 03:14	10.0	0.0	R-A /Span * 100		0.0
	High	08/11/22 03:20	10.0	8.1	R-A /Span * 100		0.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	08/11/22 03:14	21.0	18.1	R-A		0.0
	Zero	08/11/22 03:20	21.0	0.0	R-A		0.0
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	08/12/22 02:14	200.0	0.0	R-A /Span * 100		0.0
	High	08/12/22 02:25	200.0	181.0	R-A /Span * 100		0.7
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	08/12/22 02:14	30.0	0.0	R-A /Span * 100		0.0
	High	08/12/22 02:20	30.0	27.5	R-A /Span * 100		1.3
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	08/12/22 02:14	200.0	0.0	R-A /Span * 100		0.0
	High	08/12/22 02:24	200.0	182.0	R-A /Span * 100		0.5
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	08/12/22 02:14	30.0	0.0	R-A /Span * 100		0.0
	High	08/12/22 02:19	30.0	27.5	R-A /Span * 100		0.0
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	08/12/22 03:15	200.0	0.0	R-A /Span * 100		0.1
	High	08/12/22 03:25	200.0	182.4	R-A /Span * 100		0.6
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	08/12/22 03:15	10.0	0.0	R-A /Span * 100		1.0
	High	08/12/22 03:20	10.0	9.7	R-A /Span * 100		2.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	08/12/22 03:15	200.0	0.0	R-A /Span * 100		0.0
	High	08/12/22 03:25	200.0	181.0	R-A /Span * 100		0.8
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	08/12/22 03:15	10.0	0.0	R-A /Span * 100		0.0
	High	08/12/22 03:20	10.0	8.8	R-A /Span * 100		0.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	08/12/22 03:15	21.0	18.2	R-A		0.1
	Zero	08/12/22 03:20	21.0	0.0	R-A		0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	08/12/22 03:15	200.0	0.0	R-A /Span * 100		0.0
	High	08/12/22 03:25	200.0	184.9	R-A /Span * 100		0.4

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

	Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	08/12/22 03:15	10.0	0.0	R-A /Span * 100		0.0
	High	08/12/22 03:20	10.0	8.8	R-A /Span * 100		1.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	08/12/22 03:15	200.0	0.0	R-A /Span * 100		0.0
	High	08/12/22 03:25	200.0	182.0	R-A /Span * 100		0.8
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	08/12/22 03:15	10.0	0.0	R-A /Span * 100		0.0
	High	08/12/22 03:20	10.0	8.1	R-A /Span * 100		0.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	08/12/22 03:15	21.0	18.1	R-A		0.0
	Zero	08/12/22 03:20	21.0	0.0	R-A		0.0
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	08/13/22 02:14	200.0	0.0	R-A /Span * 100		0.0
	High	08/13/22 02:25	200.0	181.0	R-A /Span * 100		0.7
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	08/13/22 02:14	30.0	0.0	R-A /Span * 100		0.0
	High	08/13/22 02:20	30.0	27.5	R-A /Span * 100		1.0
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	08/13/22 02:15	200.0	0.0	R-A /Span * 100		0.0
	High	08/13/22 02:24	200.0	182.0	R-A /Span * 100		0.4
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	08/13/22 02:15	30.0	0.0	R-A /Span * 100		0.0
	High	08/13/22 02:19	30.0	27.5	R-A /Span * 100		0.0
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	08/13/22 03:15	200.0	0.0	R-A /Span * 100		0.1
	High	08/13/22 03:25	200.0	182.4	R-A /Span * 100		0.5
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	08/13/22 03:15	10.0	0.0	R-A /Span * 100		1.0
	High	08/13/22 03:20	10.0	9.7	R-A /Span * 100		2.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	08/13/22 03:15	200.0	0.0	R-A /Span * 100		0.0
	High	08/13/22 03:25	200.0	181.0	R-A /Span * 100		0.8
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	08/13/22 03:15	10.0	0.0	R-A /Span * 100		0.0
	High	08/13/22 03:20	10.0	8.8	R-A /Span * 100		0.0

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:26 Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

	Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	08/13/22 03:15	21.0	18.2	18.3	R-A	0.1
	Zero	08/13/22 03:20	21.0	0.0	0.0	R-A	0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	08/13/22 03:15	200.0	0.0	0.0	R-A /Span * 100	0.0
	High	08/13/22 03:25	200.0	184.9	184.2	R-A /Span * 100	0.4
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	08/13/22 03:15	10.0	0.0	0.0	R-A /Span * 100	0.0
	High	08/13/22 03:20	10.0	8.8	8.8	R-A /Span * 100	0.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	08/13/22 03:15	200.0	0.0	0.0	R-A /Span * 100	0.0
	High	08/13/22 03:25	200.0	182.0	180.6	R-A /Span * 100	0.7
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	08/13/22 03:15	10.0	0.0	0.0	R-A /Span * 100	0.0
	High	08/13/22 03:20	10.0	8.1	8.1	R-A /Span * 100	0.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	08/13/22 03:15	21.0	18.1	18.1	R-A	0.0
	Zero	08/13/22 03:20	21.0	0.0	0.0	R-A	0.0
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	08/14/22 02:14	200.0	0.0	0.0	R-A /Span * 100	0.0
	High	08/14/22 02:24	200.0	181.0	180.0	R-A /Span * 100	0.5
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	08/14/22 02:14	30.0	0.0	0.0	R-A /Span * 100	0.0
	High	08/14/22 02:19	30.0	27.5	27.3	R-A /Span * 100	0.7
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	08/14/22 02:14	200.0	0.0	0.0	R-A /Span * 100	0.0
	High	08/14/22 02:25	200.0	182.0	181.5	R-A /Span * 100	0.3
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	08/14/22 02:14	30.0	0.0	0.0	R-A /Span * 100	0.0
	High	08/14/22 02:19	30.0	27.5	27.6	R-A /Span * 100	0.3
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	08/14/22 03:14	200.0	0.0	0.1	R-A /Span * 100	0.1
	High	08/14/22 03:25	200.0	182.4	183.8	R-A /Span * 100	0.7
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	08/14/22 03:14	10.0	0.0	0.1	R-A /Span * 100	1.0
	High	08/14/22 03:20	10.0	9.7	9.9	R-A /Span * 100	2.0

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

	Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	08/14/22 03:14	200.0	0.0	R-A /Span * 100		0.0
	High	08/14/22 03:25	200.0	181.0	R-A /Span * 100		0.8
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	08/14/22 03:14	10.0	0.0	R-A /Span * 100		0.0
	High	08/14/22 03:20	10.0	8.8	R-A /Span * 100		0.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	08/14/22 03:14	21.0	18.2	R-A		0.1
	Zero	08/14/22 03:20	21.0	0.0	R-A		0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	08/14/22 03:15	200.0	0.0	R-A /Span * 100		0.0
	High	08/14/22 03:25	200.0	184.9	R-A /Span * 100		0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	08/14/22 03:15	10.0	0.0	R-A /Span * 100		0.0
	High	08/14/22 03:20	10.0	8.8	R-A /Span * 100		0.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	08/14/22 03:15	200.0	0.0	R-A /Span * 100		0.0
	High	08/14/22 03:25	200.0	182.0	R-A /Span * 100		0.8
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	08/14/22 03:15	10.0	0.0	R-A /Span * 100		0.0
	High	08/14/22 03:20	10.0	8.1	R-A /Span * 100		0.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	08/14/22 03:15	21.0	18.1	R-A		0.0
	Zero	08/14/22 03:20	21.0	0.0	R-A		0.0
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	08/15/22 02:14	200.0	0.0	R-A /Span * 100		0.0
	High	08/15/22 02:24	200.0	181.0	R-A /Span * 100		0.5
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	08/15/22 02:14	30.0	0.0	R-A /Span * 100		0.0
	High	08/15/22 02:19	30.0	27.5	R-A /Span * 100		0.3
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	08/15/22 02:14	200.0	0.0	R-A /Span * 100		0.0
	High	08/15/22 02:24	200.0	182.0	R-A /Span * 100		0.5
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	08/15/22 02:14	30.0	0.0	R-A /Span * 100		0.0
	High	08/15/22 02:19	30.0	27.5	R-A /Span * 100		0.0

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/15/22 03:14	200.0	0.0	0.1	R-A /Span * 100		0.1
	High	08/15/22 03:25	200.0	182.4	183.9	R-A /Span * 100		0.8
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/15/22 03:14	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	08/15/22 03:19	10.0	9.7	9.9	R-A /Span * 100		2.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/15/22 03:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/15/22 03:25	200.0	181.0	179.6	R-A /Span * 100		0.7
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/15/22 03:14	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/15/22 03:19	10.0	8.8	8.8	R-A /Span * 100		0.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	08/15/22 03:14	21.0	18.2	18.3	R-A		0.1
	Zero	08/15/22 03:19	21.0	0.0	0.0	R-A		0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/15/22 03:15	200.0	0.0	0.1	R-A /Span * 100		0.1
	High	08/15/22 03:25	200.0	184.9	185.1	R-A /Span * 100		0.1
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/15/22 03:15	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	08/15/22 03:20	10.0	8.8	8.7	R-A /Span * 100		1.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/15/22 03:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/15/22 03:25	200.0	182.0	181.0	R-A /Span * 100		0.5
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/15/22 03:15	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/15/22 03:20	10.0	8.1	8.1	R-A /Span * 100		0.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	08/15/22 03:15	21.0	18.1	18.1	R-A		0.0
	Zero	08/15/22 03:20	21.0	0.0	0.0	R-A		0.0
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/16/22 02:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/16/22 02:25	200.0	181.0	180.2	R-A /Span * 100		0.4
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/16/22 02:14	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/16/22 02:20	30.0	27.5	27.3	R-A /Span * 100		0.7

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/16/22 02:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/16/22 02:25	200.0	182.0	181.8	R-A /Span * 100		0.1
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/16/22 02:14	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/16/22 02:19	30.0	27.5	27.7	R-A /Span * 100		0.7
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/16/22 03:14	200.0	0.0	0.1	R-A /Span * 100		0.1
	High	08/16/22 03:24	200.0	182.4	184.0	R-A /Span * 100		0.8
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/16/22 03:14	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	08/16/22 03:20	10.0	9.7	9.9	R-A /Span * 100		2.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/16/22 03:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/16/22 03:24	200.0	181.0	179.3	R-A /Span * 100		0.9
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/16/22 03:14	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/16/22 03:20	10.0	8.8	8.8	R-A /Span * 100		0.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	08/16/22 03:14	21.0	18.2	18.3	R-A		0.1
	Zero	08/16/22 03:20	21.0	0.0	0.0	R-A		0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/16/22 03:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/16/22 03:25	200.0	184.9	185.1	R-A /Span * 100		0.1
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/16/22 03:14	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/16/22 03:20	10.0	8.8	8.8	R-A /Span * 100		0.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/16/22 03:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/16/22 03:25	200.0	182.0	181.1	R-A /Span * 100		0.5
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/16/22 03:14	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/16/22 03:20	10.0	8.1	8.1	R-A /Span * 100		0.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	08/16/22 03:14	21.0	18.1	18.1	R-A		0.0
	Zero	08/16/22 03:20	21.0	0.0	0.0	R-A		0.0

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/17/22 02:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/17/22 02:25	200.0	181.0	180.4	R-A /Span * 100		0.3
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/17/22 02:15	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/17/22 02:19	30.0	27.5	27.3	R-A /Span * 100		0.7
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/17/22 02:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/17/22 02:25	200.0	182.0	181.5	R-A /Span * 100		0.3
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/17/22 02:14	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/17/22 02:19	30.0	27.5	27.6	R-A /Span * 100		0.3
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/17/22 03:14	200.0	0.0	0.1	R-A /Span * 100		0.1
	High	08/17/22 03:25	200.0	182.4	184.6	R-A /Span * 100		1.1
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/17/22 03:14	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	08/17/22 03:20	10.0	9.7	9.9	R-A /Span * 100		2.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/17/22 03:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/17/22 03:25	200.0	181.0	179.7	R-A /Span * 100		0.7
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/17/22 03:14	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/17/22 03:20	10.0	8.8	8.8	R-A /Span * 100		0.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	08/17/22 03:14	21.0	18.2	18.3	R-A		0.1
	Zero	08/17/22 03:20	21.0	0.0	0.0	R-A		0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/17/22 03:14	200.0	0.0	0.1	R-A /Span * 100		0.1
	High	08/17/22 03:25	200.0	184.9	185.1	R-A /Span * 100		0.1
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/17/22 03:14	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	08/17/22 03:19	10.0	8.8	8.7	R-A /Span * 100		1.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/17/22 03:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/17/22 03:25	200.0	182.0	180.7	R-A /Span * 100		0.7

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/17/22 03:14	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/17/22 03:19	10.0	8.1	8.1	R-A /Span * 100		0.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	08/17/22 03:14	21.0	18.1	18.1	R-A		0.0
	Zero	08/17/22 03:19	21.0	0.0	0.0	R-A		0.0
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/18/22 02:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/18/22 02:24	200.0	182.0	180.9	R-A /Span * 100		0.6
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/18/22 02:15	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/18/22 02:20	30.0	27.5	27.5	R-A /Span * 100		0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/18/22 03:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/18/22 03:25	200.0	184.9	185.1	R-A /Span * 100		0.1
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/18/22 03:15	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	08/18/22 03:19	10.0	8.8	8.9	R-A /Span * 100		1.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/18/22 03:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/18/22 03:25	200.0	182.0	180.8	R-A /Span * 100		0.6
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/18/22 03:15	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/18/22 03:19	10.0	8.1	8.1	R-A /Span * 100		0.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	08/18/22 03:15	21.0	18.1	18.1	R-A		0.0
	Zero	08/18/22 03:19	21.0	0.0	0.0	R-A		0.0
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/19/22 02:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/19/22 02:25	200.0	182.0	180.5	R-A /Span * 100		0.8
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/19/22 02:15	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/19/22 02:20	30.0	27.5	27.3	R-A /Span * 100		0.7
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/19/22 03:14	200.0	0.0	0.1	R-A /Span * 100		0.1
	High	08/19/22 03:24	200.0	184.9	185.7	R-A /Span * 100		0.4

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/19/22 03:14	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	08/19/22 03:19	10.0	8.8	8.8	R-A /Span * 100		0.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/19/22 03:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/19/22 03:24	200.0	182.0	180.7	R-A /Span * 100		0.7
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/19/22 03:14	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/19/22 03:19	10.0	8.1	8.1	R-A /Span * 100		0.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	08/19/22 03:14	21.0	18.1	18.1	R-A		0.0
	Zero	08/19/22 03:19	21.0	0.0	0.0	R-A		0.0
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/19/22 12:44	200.0	0.0	0.1	R-A /Span * 100		0.1
	High	08/19/22 12:55	200.0	182.4	184.4	R-A /Span * 100		1.0
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/19/22 12:44	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	08/19/22 12:50	10.0	9.7	9.9	R-A /Span * 100		2.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/19/22 12:44	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/19/22 12:55	200.0	181.0	179.5	R-A /Span * 100		0.8
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/19/22 12:44	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/19/22 12:50	10.0	8.8	8.8	R-A /Span * 100		0.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	08/19/22 12:44	21.0	18.2	18.3	R-A		0.1
	Zero	08/19/22 12:50	21.0	0.0	0.0	R-A		0.0
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/20/22 02:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/20/22 02:25	200.0	181.0	180.3	R-A /Span * 100		0.4
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/20/22 02:15	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/20/22 02:20	30.0	27.5	27.4	R-A /Span * 100		0.3
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/20/22 03:14	200.0	0.0	0.1	R-A /Span * 100		0.1
	High	08/20/22 03:25	200.0	182.4	184.7	R-A /Span * 100		1.2

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/20/22 03:14	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	08/20/22 03:19	10.0	9.7	9.9	R-A /Span * 100		2.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/20/22 03:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/20/22 03:25	200.0	181.0	180.4	R-A /Span * 100		0.3
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/20/22 03:14	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/20/22 03:19	10.0	8.8	8.9	R-A /Span * 100		1.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	08/20/22 03:14	21.0	18.2	18.3	R-A		0.1
	Zero	08/20/22 03:19	21.0	0.0	0.0	R-A		0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/20/22 17:08	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/20/22 17:18	200.0	184.9	186.1	R-A /Span * 100		0.6
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/20/22 17:08	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	08/20/22 17:13	10.0	8.8	8.8	R-A /Span * 100		0.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/20/22 17:08	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/20/22 17:18	200.0	182.0	181.0	R-A /Span * 100		0.5
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/20/22 17:08	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/20/22 17:13	10.0	8.1	8.1	R-A /Span * 100		0.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	08/20/22 17:08	21.0	18.1	18.1	R-A		0.0
	Zero	08/20/22 17:13	21.0	0.0	0.0	R-A		0.0
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/21/22 02:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/21/22 02:25	200.0	182.0	181.8	R-A /Span * 100		0.1
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/21/22 02:14	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/21/22 02:19	30.0	27.5	27.7	R-A /Span * 100		0.7
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/21/22 03:14	200.0	0.0	0.1	R-A /Span * 100		0.1
	High	08/21/22 03:24	200.0	184.9	185.6	R-A /Span * 100		0.4

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/21/22 03:14	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	08/21/22 03:19	10.0	8.8	8.8	R-A /Span * 100		0.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/21/22 03:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/21/22 03:24	200.0	182.0	180.8	R-A /Span * 100		0.6
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/21/22 03:14	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/21/22 03:19	10.0	8.1	8.1	R-A /Span * 100		0.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	08/21/22 03:14	21.0	18.1	18.1	R-A		0.0
	Zero	08/21/22 03:19	21.0	0.0	0.0	R-A		0.0
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/21/22 10:17	200.0	0.0	0.1	R-A /Span * 100		0.1
	High	08/21/22 10:28	200.0	182.4	183.6	R-A /Span * 100		0.6
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/21/22 10:17	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	08/21/22 10:23	10.0	9.7	9.9	R-A /Span * 100		2.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/21/22 10:17	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/21/22 10:28	200.0	181.0	180.6	R-A /Span * 100		0.2
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/21/22 10:17	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/21/22 10:23	10.0	8.8	8.9	R-A /Span * 100		1.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	08/21/22 10:17	21.0	18.2	18.3	R-A		0.1
	Zero	08/21/22 10:23	21.0	0.0	0.0	R-A		0.0
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/22/22 02:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/22/22 02:25	200.0	181.0	180.1	R-A /Span * 100		0.5
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/22/22 02:14	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/22/22 02:20	30.0	27.5	27.3	R-A /Span * 100		0.7
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/22/22 02:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/22/22 02:25	200.0	182.0	180.8	R-A /Span * 100		0.6

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/22/22 02:14	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/22/22 02:20	30.0	27.5	27.4	R-A /Span * 100		0.3
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/22/22 03:15	200.0	0.0	0.1	R-A /Span * 100		0.1
	High	08/22/22 03:25	200.0	182.4	184.0	R-A /Span * 100		0.8
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/22/22 03:15	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	08/22/22 03:20	10.0	9.7	9.9	R-A /Span * 100		2.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/22/22 03:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/22/22 03:25	200.0	181.0	180.1	R-A /Span * 100		0.5
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/22/22 03:15	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/22/22 03:20	10.0	8.8	8.8	R-A /Span * 100		0.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	08/22/22 03:15	21.0	18.2	18.3	R-A		0.1
	Zero	08/22/22 03:20	21.0	0.0	0.0	R-A		0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/22/22 03:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/22/22 03:25	200.0	184.9	185.3	R-A /Span * 100		0.2
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/22/22 03:15	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	08/22/22 03:19	10.0	8.8	8.7	R-A /Span * 100		1.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/22/22 03:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/22/22 03:25	200.0	182.0	180.4	R-A /Span * 100		0.8
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/22/22 03:15	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/22/22 03:19	10.0	8.1	8.1	R-A /Span * 100		0.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	08/22/22 03:15	21.0	18.1	18.1	R-A		0.0
	Zero	08/22/22 03:19	21.0	0.0	0.0	R-A		0.0
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/23/22 02:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/23/22 02:25	200.0	182.0	180.4	R-A /Span * 100		0.8

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/23/22 02:15	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/23/22 02:20	30.0	27.5	27.4	R-A /Span * 100		0.3
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/23/22 03:14	200.0	0.0	0.1	R-A /Span * 100		0.1
	High	08/23/22 03:24	200.0	184.9	185.4	R-A /Span * 100		0.3
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/23/22 03:14	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	08/23/22 03:19	10.0	8.8	8.8	R-A /Span * 100		0.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/23/22 03:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/23/22 03:24	200.0	182.0	180.7	R-A /Span * 100		0.7
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/23/22 03:14	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/23/22 03:19	10.0	8.1	8.1	R-A /Span * 100		0.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	08/23/22 03:14	21.0	18.1	18.1	R-A		0.0
	Zero	08/23/22 03:19	21.0	0.0	0.0	R-A		0.0
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/24/22 02:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/24/22 02:24	200.0	182.0	181.1	R-A /Span * 100		0.5
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/24/22 02:15	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/24/22 02:20	30.0	27.5	27.5	R-A /Span * 100		0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/24/22 03:14	200.0	0.0	0.1	R-A /Span * 100		0.1
	High	08/24/22 03:25	200.0	184.9	185.8	R-A /Span * 100		0.5
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/24/22 03:14	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	08/24/22 03:19	10.0	8.8	8.8	R-A /Span * 100		0.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/24/22 03:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/24/22 03:25	200.0	182.0	180.3	R-A /Span * 100		0.9
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/24/22 03:14	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/24/22 03:19	10.0	8.1	8.1	R-A /Span * 100		0.0

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

	Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	08/24/22 03:14	21.0	18.1	R-A		0.0
	Zero	08/24/22 03:19	21.0	0.0	R-A		0.0
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	08/25/22 02:15	200.0	0.0	R-A /Span * 100		0.0
	High	08/25/22 02:25	200.0	180.6	R-A /Span * 100		0.7
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	08/25/22 02:15	30.0	0.0	R-A /Span * 100		0.0
	High	08/25/22 02:20	30.0	27.4	R-A /Span * 100		0.3
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	08/25/22 03:14	200.0	0.1	R-A /Span * 100		0.1
	High	08/25/22 03:25	200.0	184.9	R-A /Span * 100		0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	08/25/22 03:14	10.0	0.1	R-A /Span * 100		1.0
	High	08/25/22 03:20	10.0	8.8	R-A /Span * 100		0.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	08/25/22 03:14	200.0	0.0	R-A /Span * 100		0.0
	High	08/25/22 03:25	200.0	180.6	R-A /Span * 100		0.7
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	08/25/22 03:14	10.0	0.0	R-A /Span * 100		0.0
	High	08/25/22 03:20	10.0	8.1	R-A /Span * 100		0.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	08/25/22 03:14	21.0	18.1	R-A		0.0
	Zero	08/25/22 03:20	21.0	0.0	R-A		0.0
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	08/26/22 02:14	200.0	0.0	R-A /Span * 100		0.0
	High	08/26/22 02:24	200.0	180.2	R-A /Span * 100		0.9
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	08/26/22 02:14	30.0	0.0	R-A /Span * 100		0.0
	High	08/26/22 02:19	30.0	27.3	R-A /Span * 100		0.7
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	08/26/22 03:15	200.0	0.1	R-A /Span * 100		0.1
	High	08/26/22 03:25	200.0	185.0	R-A /Span * 100		0.1
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	08/26/22 03:15	10.0	0.1	R-A /Span * 100		1.0
	High	08/26/22 03:20	10.0	8.5	R-A /Span * 100		1.0

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/26/22 03:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/26/22 03:25	200.0	182.0	180.2	R-A /Span * 100		0.9
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/26/22 03:15	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/26/22 03:20	10.0	8.3	8.3	R-A /Span * 100		0.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	08/26/22 03:15	21.0	18.1	18.1	R-A		0.0
	Zero	08/26/22 03:20	21.0	0.0	0.0	R-A		0.0
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/26/22 07:44	200.0	0.0	0.1	R-A /Span * 100		0.1
	High	08/26/22 07:54	200.0	182.4	183.3	R-A /Span * 100		0.5
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/26/22 07:44	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	08/26/22 07:49	10.0	9.7	9.7	R-A /Span * 100		0.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/26/22 07:44	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/26/22 07:54	200.0	181.0	180.0	R-A /Span * 100		0.5
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/26/22 07:44	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/26/22 07:49	10.0	8.8	8.8	R-A /Span * 100		0.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	08/26/22 07:44	21.0	18.1	18.3	R-A		0.2
	Zero	08/26/22 07:49	21.0	0.0	0.0	R-A		0.0
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/27/22 02:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/27/22 02:24	200.0	181.0	179.5	R-A /Span * 100		0.8
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/27/22 02:14	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/27/22 02:20	30.0	27.5	27.2	R-A /Span * 100		1.0
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/27/22 02:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/27/22 02:24	200.0	182.0	181.1	R-A /Span * 100		0.5
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/27/22 02:15	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/27/22 02:20	30.0	27.5	27.5	R-A /Span * 100		0.0

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online		Fail
	Zero	08/27/22 03:15	200.0	0.0	0.1		R-A /Span * 100	0.1
	High	08/27/22 03:25	200.0	184.2	1.7	>4x	R-A /Span * 100	91.3
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online		Pass
	Zero	08/27/22 03:15	10.0	0.0	0.1		R-A /Span * 100	1.0
	High	08/27/22 03:20	10.0	9.7	9.7		R-A /Span * 100	0.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online		Fail
	Zero	08/27/22 03:15	200.0	0.0	0.0		R-A /Span * 100	0.0
	High	08/27/22 03:25	200.0	181.0	2.7	>2x	R-A /Span * 100	89.2
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online		Pass
	Zero	08/27/22 03:15	10.0	0.0	0.0		R-A /Span * 100	0.0
	High	08/27/22 03:20	10.0	8.8	8.7		R-A /Span * 100	1.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online		Pass
	High	08/27/22 03:15	21.0	18.1	18.3		R-A	0.2
	Zero	08/27/22 03:20	21.0	0.0	0.0		R-A	0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online		Pass
	Zero	08/27/22 03:15	200.0	0.0	0.1		R-A /Span * 100	0.1
	High	08/27/22 03:25	200.0	184.9	186.0		R-A /Span * 100	0.6
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online		Pass
	Zero	08/27/22 03:15	10.0	0.0	0.1		R-A /Span * 100	1.0
	High	08/27/22 03:20	10.0	8.6	8.5		R-A /Span * 100	1.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online		Pass
	Zero	08/27/22 03:15	200.0	0.0	0.0		R-A /Span * 100	0.0
	High	08/27/22 03:25	200.0	182.0	180.1		R-A /Span * 100	1.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online		Pass
	Zero	08/27/22 03:15	10.0	0.0	0.0		R-A /Span * 100	0.0
	High	08/27/22 03:20	10.0	8.3	8.3		R-A /Span * 100	0.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online		Pass
	High	08/27/22 03:15	21.0	18.1	18.1		R-A	0.0
	Zero	08/27/22 03:20	21.0	0.0	0.0		R-A	0.0
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online		Pass
	Zero	08/27/22 04:01	200.0	0.0	0.1		R-A /Span * 100	0.1
	High	08/27/22 04:11	200.0	184.2	184.6		R-A /Span * 100	0.2
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online		Pass
	Zero	08/27/22 04:01	10.0	0.0	0.1		R-A /Span * 100	1.0
	High	08/27/22 04:05	10.0	9.7	9.7		R-A /Span * 100	0.0

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

	Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	08/27/22 04:01	200.0	0.0		R-A /Span * 100	0.0
	High	08/27/22 04:11	200.0	181.5		R-A /Span * 100	0.5
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	08/27/22 04:01	10.0	0.0		R-A /Span * 100	0.0
	High	08/27/22 04:05	10.0	8.8		R-A /Span * 100	1.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	08/27/22 04:01	21.0	18.1		R-A	0.2
	Zero	08/27/22 04:05	21.0	0.0		R-A	0.0
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	08/28/22 02:14	200.0	0.0		R-A /Span * 100	0.0
	High	08/28/22 02:25	200.0	181.5		R-A /Span * 100	0.3
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	08/28/22 02:14	30.0	0.0		R-A /Span * 100	0.0
	High	08/28/22 02:20	30.0	27.5		R-A /Span * 100	1.0
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	08/28/22 02:14	200.0	0.0		R-A /Span * 100	0.0
	High	08/28/22 02:24	200.0	182.0		R-A /Span * 100	0.7
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	08/28/22 02:14	30.0	0.0		R-A /Span * 100	0.0
	High	08/28/22 02:19	30.0	27.5		R-A /Span * 100	0.3
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	08/28/22 02:54	200.0	0.0		R-A /Span * 100	0.1
	High	08/28/22 03:04	200.0	184.2		R-A /Span * 100	0.2
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	08/28/22 02:54	10.0	0.0		R-A /Span * 100	1.0
	High	08/28/22 02:59	10.0	9.7		R-A /Span * 100	0.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	08/28/22 02:54	200.0	0.0		R-A /Span * 100	0.0
	High	08/28/22 03:04	200.0	181.5		R-A /Span * 100	0.4
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	08/28/22 02:54	10.0	0.0		R-A /Span * 100	0.0
	High	08/28/22 02:59	10.0	8.8		R-A /Span * 100	1.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	08/28/22 02:54	21.0	18.1		R-A	0.2
	Zero	08/28/22 02:59	21.0	0.0		R-A	0.0

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/28/22 03:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/28/22 03:24	200.0	184.9	185.7	R-A /Span * 100		0.4
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/28/22 03:14	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	08/28/22 03:19	10.0	8.6	8.6	R-A /Span * 100		0.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/28/22 03:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/28/22 03:24	200.0	182.0	179.7	R-A /Span * 100		1.2
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/28/22 03:14	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/28/22 03:19	10.0	8.3	8.3	R-A /Span * 100		0.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	08/28/22 03:14	21.0	18.1	18.1	R-A		0.0
	Zero	08/28/22 03:19	21.0	0.0	0.0	R-A		0.0
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/29/22 02:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/29/22 02:24	200.0	181.5	180.8	R-A /Span * 100		0.4
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/29/22 02:14	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/29/22 02:20	30.0	27.5	27.2	R-A /Span * 100		1.0
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/29/22 02:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/29/22 02:25	200.0	182.0	181.0	R-A /Span * 100		0.5
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/29/22 02:15	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/29/22 02:20	30.0	27.5	27.5	R-A /Span * 100		0.0
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/29/22 03:08	200.0	0.0	0.1	R-A /Span * 100		0.1
	High	08/29/22 03:18	200.0	184.2	184.2	R-A /Span * 100		0.0
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/29/22 03:08	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	08/29/22 03:13	10.0	9.7	9.7	R-A /Span * 100		0.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/29/22 03:08	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/29/22 03:18	200.0	181.5	180.1	R-A /Span * 100		0.7

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:26 Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

	Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	08/29/22 03:08	10.0	0.0		R-A /Span * 100	0.0
	High	08/29/22 03:13	10.0	8.8		R-A /Span * 100	2.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	08/29/22 03:08	21.0	18.1		R-A	0.2
	Zero	08/29/22 03:13	21.0	0.0		R-A	0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	08/29/22 03:14	200.0	0.1		R-A /Span * 100	0.1
	High	08/29/22 03:25	200.0	184.9		R-A /Span * 100	0.3
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	08/29/22 03:14	10.0	0.1		R-A /Span * 100	1.0
	High	08/29/22 03:20	10.0	8.6		R-A /Span * 100	0.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	08/29/22 03:14	200.0	0.0		R-A /Span * 100	0.0
	High	08/29/22 03:25	200.0	182.0		R-A /Span * 100	0.9
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	08/29/22 03:14	10.0	0.0		R-A /Span * 100	0.0
	High	08/29/22 03:20	10.0	8.3		R-A /Span * 100	0.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	08/29/22 03:14	21.0	18.1		R-A	0.0
	Zero	08/29/22 03:20	21.0	0.0		R-A	0.0
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	08/30/22 02:14	200.0	0.0		R-A /Span * 100	0.0
	High	08/30/22 02:24	200.0	182.0		R-A /Span * 100	0.7
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	08/30/22 02:14	30.0	0.0		R-A /Span * 100	0.0
	High	08/30/22 02:19	30.0	27.5		R-A /Span * 100	0.3
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	08/30/22 02:15	200.0	0.0		R-A /Span * 100	0.0
	High	08/30/22 02:25	200.0	181.5		R-A /Span * 100	0.3
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	08/30/22 02:15	30.0	0.0		R-A /Span * 100	0.0
	High	08/30/22 02:19	30.0	27.5		R-A /Span * 100	1.0
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	08/30/22 03:14	200.0	0.1		R-A /Span * 100	0.1
	High	08/30/22 03:25	200.0	184.2		R-A /Span * 100	0.1

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/30/22 03:14	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	08/30/22 03:19	10.0	9.7	9.7	R-A /Span * 100		0.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/30/22 03:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/30/22 03:25	200.0	181.5	179.9	R-A /Span * 100		0.8
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/30/22 03:14	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/30/22 03:19	10.0	8.8	8.6	R-A /Span * 100		2.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	08/30/22 03:14	21.0	18.1	18.3	R-A		0.2
	Zero	08/30/22 03:19	21.0	0.0	0.0	R-A		0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/30/22 03:14	200.0	0.0	0.1	R-A /Span * 100		0.1
	High	08/30/22 03:24	200.0	184.9	185.3	R-A /Span * 100		0.2
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/30/22 03:14	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	08/30/22 03:19	10.0	8.6	8.5	R-A /Span * 100		1.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/30/22 03:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/30/22 03:24	200.0	182.0	180.2	R-A /Span * 100		0.9
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/30/22 03:14	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/30/22 03:19	10.0	8.3	8.3	R-A /Span * 100		0.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	08/30/22 03:14	21.0	18.1	18.1	R-A		0.0
	Zero	08/30/22 03:19	21.0	0.0	0.0	R-A		0.0
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/31/22 02:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/31/22 02:24	200.0	182.0	180.2	R-A /Span * 100		0.9
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/31/22 02:14	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/31/22 02:19	30.0	27.5	27.3	R-A /Span * 100		0.7
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/31/22 02:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/31/22 02:25	200.0	181.5	181.4	R-A /Span * 100		0.1

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/31/22 02:15	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/31/22 02:20	30.0	27.5	27.2	R-A /Span * 100		1.0
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/31/22 03:14	200.0	0.0	0.1	R-A /Span * 100		0.1
	High	08/31/22 03:25	200.0	184.2	184.3	R-A /Span * 100		0.1
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/31/22 03:14	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	08/31/22 03:19	10.0	9.7	9.7	R-A /Span * 100		0.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/31/22 03:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/31/22 03:25	200.0	181.5	180.3	R-A /Span * 100		0.6
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/31/22 03:14	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/31/22 03:19	10.0	8.8	8.6	R-A /Span * 100		2.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	08/31/22 03:14	21.0	18.1	18.3	R-A		0.2
	Zero	08/31/22 03:19	21.0	0.0	0.0	R-A		0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/31/22 03:14	200.0	0.0	0.1	R-A /Span * 100		0.1
	High	08/31/22 03:25	200.0	184.9	184.9	R-A /Span * 100		0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/31/22 03:14	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	08/31/22 03:20	10.0	8.6	8.6	R-A /Span * 100		0.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	08/31/22 03:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/31/22 03:25	200.0	182.0	179.9	R-A /Span * 100		1.1
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	08/31/22 03:14	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	08/31/22 03:20	10.0	8.3	8.3	R-A /Span * 100		0.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	08/31/22 03:14	21.0	18.1	18.1	R-A		0.0
	Zero	08/31/22 03:20	21.0	0.0	0.0	R-A		0.0
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/01/22 02:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/01/22 02:24	200.0	182.0	181.0	R-A /Span * 100		0.5

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/01/22 02:14	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/01/22 02:19	30.0	26.7	27.0	R-A /Span * 100		1.0
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/01/22 02:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/01/22 02:25	200.0	181.5	181.7	R-A /Span * 100		0.1
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/01/22 02:14	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/01/22 02:20	30.0	27.5	27.2	R-A /Span * 100		1.0
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/01/22 03:15	200.0	0.0	0.1	R-A /Span * 100		0.1
	High	09/01/22 03:25	200.0	184.2	184.6	R-A /Span * 100		0.2
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/01/22 03:15	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	09/01/22 03:20	10.0	9.7	9.7	R-A /Span * 100		0.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/01/22 03:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/01/22 03:25	200.0	181.5	180.5	R-A /Span * 100		0.5
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/01/22 03:15	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/01/22 03:20	10.0	8.8	8.6	R-A /Span * 100		2.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	09/01/22 03:15	21.0	18.1	18.3	R-A		0.2
	Zero	09/01/22 03:20	21.0	0.0	0.0	R-A		0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/01/22 03:14	200.0	0.0	0.1	R-A /Span * 100		0.1
	High	09/01/22 03:24	200.0	184.9	185.4	R-A /Span * 100		0.3
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/01/22 03:14	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	09/01/22 03:19	10.0	8.6	8.6	R-A /Span * 100		0.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/01/22 03:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/01/22 03:24	200.0	182.0	180.4	R-A /Span * 100		0.8
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/01/22 03:14	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/01/22 03:19	10.0	8.3	8.3	R-A /Span * 100		0.0

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

	Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	09/01/22 03:14	21.0	18.1	R-A		0.0
	Zero	09/01/22 03:19	21.0	0.0	R-A		0.0
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/02/22 02:14	200.0	0.0	R-A /Span * 100		0.0
	High	09/02/22 02:25	200.0	182.7	R-A /Span * 100		0.6
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/02/22 02:14	30.0	0.0	R-A /Span * 100		0.0
	High	09/02/22 02:19	30.0	27.5	R-A /Span * 100		0.0
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/02/22 02:15	200.0	0.0	R-A /Span * 100		0.0
	High	09/02/22 02:25	200.0	181.4	R-A /Span * 100		0.3
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/02/22 02:15	30.0	0.0	R-A /Span * 100		0.0
	High	09/02/22 02:19	30.0	26.7	R-A /Span * 100		1.7
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/02/22 03:14	200.0	0.1	R-A /Span * 100		0.1
	High	09/02/22 03:24	200.0	185.7	R-A /Span * 100		0.4
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/02/22 03:14	10.0	0.1	R-A /Span * 100		1.0
	High	09/02/22 03:19	10.0	8.6	R-A /Span * 100		0.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/02/22 03:14	200.0	0.0	R-A /Span * 100		0.0
	High	09/02/22 03:24	200.0	180.4	R-A /Span * 100		0.8
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/02/22 03:14	10.0	0.0	R-A /Span * 100		0.0
	High	09/02/22 03:19	10.0	8.3	R-A /Span * 100		0.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	09/02/22 03:14	21.0	18.1	R-A		0.0
	Zero	09/02/22 03:19	21.0	0.0	R-A		0.0
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/02/22 03:14	200.0	0.1	R-A /Span * 100		0.1
	High	09/02/22 03:25	200.0	184.9	R-A /Span * 100		0.4
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/02/22 03:14	10.0	0.1	R-A /Span * 100		1.0
	High	09/02/22 03:19	10.0	9.7	R-A /Span * 100		0.0

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

	Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/02/22 03:14	200.0	0.0		R-A /Span * 100	0.0
	High	09/02/22 03:25	200.0	181.5		R-A /Span * 100	0.5
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/02/22 03:14	10.0	0.0		R-A /Span * 100	0.0
	High	09/02/22 03:19	10.0	8.8		R-A /Span * 100	1.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	09/02/22 03:14	21.0	18.1		R-A	0.2
	Zero	09/02/22 03:19	21.0	0.0		R-A	0.0
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/03/22 02:14	200.0	0.0		R-A /Span * 100	0.0
	High	09/03/22 02:25	200.0	181.5		R-A /Span * 100	0.5
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/03/22 02:14	30.0	0.0		R-A /Span * 100	0.0
	High	09/03/22 02:19	30.0	27.5		R-A /Span * 100	0.3
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/03/22 02:15	200.0	0.0		R-A /Span * 100	0.0
	High	09/03/22 02:25	200.0	182.0		R-A /Span * 100	0.6
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/03/22 02:15	30.0	0.0		R-A /Span * 100	0.0
	High	09/03/22 02:20	30.0	26.7		R-A /Span * 100	1.0
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/03/22 03:15	200.0	0.0		R-A /Span * 100	0.1
	High	09/03/22 03:25	200.0	184.2		R-A /Span * 100	0.1
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/03/22 03:15	10.0	0.0		R-A /Span * 100	1.0
	High	09/03/22 03:20	10.0	9.7		R-A /Span * 100	0.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/03/22 03:15	200.0	0.0		R-A /Span * 100	0.0
	High	09/03/22 03:25	200.0	181.5		R-A /Span * 100	0.7
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/03/22 03:15	10.0	0.0		R-A /Span * 100	0.0
	High	09/03/22 03:20	10.0	8.8		R-A /Span * 100	2.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	09/03/22 03:15	21.0	18.1		R-A	0.2
	Zero	09/03/22 03:20	21.0	0.0		R-A	0.0

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/03/22 03:15	200.0	0.0	0.1	R-A /Span * 100		0.1
	High	09/03/22 03:25	200.0	184.9	185.3	R-A /Span * 100		0.2
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/03/22 03:15	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	09/03/22 03:19	10.0	8.6	8.6	R-A /Span * 100		0.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/03/22 03:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/03/22 03:25	200.0	182.0	180.2	R-A /Span * 100		0.9
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/03/22 03:15	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/03/22 03:19	10.0	8.3	8.3	R-A /Span * 100		0.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	09/03/22 03:15	21.0	18.1	18.1	R-A		0.0
	Zero	09/03/22 03:19	21.0	0.0	0.0	R-A		0.0
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/04/22 02:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/04/22 02:25	200.0	181.5	182.4	R-A /Span * 100		0.5
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/04/22 02:15	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/04/22 02:19	30.0	27.5	27.4	R-A /Span * 100		0.3
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/04/22 02:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/04/22 02:25	200.0	182.0	180.6	R-A /Span * 100		0.7
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/04/22 02:15	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/04/22 02:19	30.0	26.7	27.0	R-A /Span * 100		1.0
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/04/22 03:15	200.0	0.0	0.1	R-A /Span * 100		0.1
	High	09/04/22 03:25	200.0	184.2	184.3	R-A /Span * 100		0.1
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/04/22 03:15	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	09/04/22 03:20	10.0	9.7	9.7	R-A /Span * 100		0.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/04/22 03:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/04/22 03:25	200.0	181.5	179.9	R-A /Span * 100		0.8

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/04/22 03:15	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/04/22 03:20	10.0	8.8	8.6	R-A /Span * 100		2.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	09/04/22 03:15	21.0	18.1	18.3	R-A		0.2
	Zero	09/04/22 03:20	21.0	0.0	0.0	R-A		0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/04/22 03:14	200.0	0.0	0.1	R-A /Span * 100		0.1
	High	09/04/22 03:25	200.0	184.9	185.3	R-A /Span * 100		0.2
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/04/22 03:14	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	09/04/22 03:20	10.0	8.6	8.6	R-A /Span * 100		0.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/04/22 03:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/04/22 03:25	200.0	182.0	180.1	R-A /Span * 100		1.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/04/22 03:14	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/04/22 03:20	10.0	8.3	8.3	R-A /Span * 100		0.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	09/04/22 03:14	21.0	18.1	18.1	R-A		0.0
	Zero	09/04/22 03:20	21.0	0.0	0.0	R-A		0.0
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/05/22 02:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/05/22 02:24	200.0	182.0	181.1	R-A /Span * 100		0.5
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/05/22 02:14	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/05/22 02:19	30.0	26.7	27.1	R-A /Span * 100		1.3
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/05/22 02:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/05/22 02:25	200.0	181.5	182.5	R-A /Span * 100		0.5
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/05/22 02:15	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/05/22 02:20	30.0	27.5	27.4	R-A /Span * 100		0.3
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/05/22 03:14	200.0	0.0	0.1	R-A /Span * 100		0.1
	High	09/05/22 03:25	200.0	184.2	184.7	R-A /Span * 100		0.3

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

	Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/05/22 03:14	10.0	0.0		R-A /Span * 100	1.0
	High	09/05/22 03:20	10.0	9.7		R-A /Span * 100	0.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/05/22 03:14	200.0	0.0		R-A /Span * 100	0.0
	High	09/05/22 03:25	200.0	181.5		R-A /Span * 100	0.7
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/05/22 03:14	10.0	0.0		R-A /Span * 100	0.0
	High	09/05/22 03:20	10.0	8.8		R-A /Span * 100	2.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	09/05/22 03:14	21.0	18.1		R-A	0.2
	Zero	09/05/22 03:20	21.0	0.0		R-A	0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/05/22 03:15	200.0	0.0		R-A /Span * 100	0.1
	High	09/05/22 03:25	200.0	184.9		R-A /Span * 100	0.6
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/05/22 03:15	10.0	0.0		R-A /Span * 100	1.0
	High	09/05/22 03:20	10.0	8.6		R-A /Span * 100	0.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/05/22 03:15	200.0	0.0		R-A /Span * 100	0.0
	High	09/05/22 03:25	200.0	182.0		R-A /Span * 100	0.8
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/05/22 03:15	10.0	0.0		R-A /Span * 100	0.0
	High	09/05/22 03:20	10.0	8.3		R-A /Span * 100	0.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	09/05/22 03:15	21.0	18.1		R-A	0.0
	Zero	09/05/22 03:20	21.0	0.0		R-A	0.0
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/06/22 02:15	200.0	0.0		R-A /Span * 100	0.0
	High	09/06/22 02:25	200.0	181.5		R-A /Span * 100	0.2
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/06/22 02:15	30.0	0.0		R-A /Span * 100	0.0
	High	09/06/22 02:20	30.0	27.5		R-A /Span * 100	1.0
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/06/22 02:14	200.0	0.0		R-A /Span * 100	0.0
	High	09/06/22 02:24	200.0	180.0		R-A /Span * 100	0.7

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

	Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/06/22 02:14	30.0	0.0	R-A /Span * 100		0.0
	High	09/06/22 02:19	30.0	26.7	R-A /Span * 100		1.3
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/06/22 03:14	200.0	0.1	R-A /Span * 100		0.1
	High	09/06/22 03:25	200.0	184.2	R-A /Span * 100		0.4
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/06/22 03:14	10.0	0.1	R-A /Span * 100		1.0
	High	09/06/22 03:19	10.0	9.7	R-A /Span * 100		0.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/06/22 03:14	200.0	0.0	R-A /Span * 100		0.0
	High	09/06/22 03:25	200.0	181.5	R-A /Span * 100		0.6
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/06/22 03:14	10.0	0.0	R-A /Span * 100		0.0
	High	09/06/22 03:19	10.0	8.8	R-A /Span * 100		2.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	09/06/22 03:14	21.0	18.1	R-A		0.2
	Zero	09/06/22 03:19	21.0	0.0	R-A		0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/06/22 03:15	200.0	0.1	R-A /Span * 100		0.1
	High	09/06/22 03:25	200.0	183.5	R-A /Span * 100		0.6
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/06/22 03:15	10.0	0.1	R-A /Span * 100		1.0
	High	09/06/22 03:20	10.0	8.6	R-A /Span * 100		0.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/06/22 03:15	200.0	0.0	R-A /Span * 100		0.0
	High	09/06/22 03:25	200.0	180.0	R-A /Span * 100		0.7
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/06/22 03:15	10.0	0.0	R-A /Span * 100		0.0
	High	09/06/22 03:20	10.0	8.3	R-A /Span * 100		0.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	09/06/22 03:15	21.0	18.1	R-A		0.0
	Zero	09/06/22 03:20	21.0	0.0	R-A		0.0
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/07/22 02:14	200.0	0.0	R-A /Span * 100		0.0
	High	09/07/22 02:25	200.0	181.5	R-A /Span * 100		0.2

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/07/22 02:14	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/07/22 02:19	30.0	27.5	27.1	R-A /Span * 100		1.3
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/07/22 02:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/07/22 02:25	200.0	180.0	179.4	R-A /Span * 100		0.3
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/07/22 02:14	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/07/22 02:20	30.0	26.7	27.0	R-A /Span * 100		1.0
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/07/22 03:15	200.0	0.0	0.1	R-A /Span * 100		0.1
	High	09/07/22 03:25	200.0	184.2	183.9	R-A /Span * 100		0.2
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/07/22 03:15	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	09/07/22 03:19	10.0	9.7	9.7	R-A /Span * 100		0.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/07/22 03:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/07/22 03:25	200.0	181.5	179.8	R-A /Span * 100		0.9
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/07/22 03:15	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/07/22 03:19	10.0	8.8	8.6	R-A /Span * 100		2.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	09/07/22 03:15	21.0	18.1	18.3	R-A		0.2
	Zero	09/07/22 03:19	21.0	0.0	0.0	R-A		0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/07/22 03:15	200.0	0.0	0.1	R-A /Span * 100		0.1
	High	09/07/22 03:25	200.0	183.5	184.2	R-A /Span * 100		0.4
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/07/22 03:15	10.0	0.0	0.2	R-A /Span * 100		2.0
	High	09/07/22 03:20	10.0	8.6	8.7	R-A /Span * 100		1.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/07/22 03:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/07/22 03:25	200.0	180.0	178.4	R-A /Span * 100		0.8
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/07/22 03:15	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/07/22 03:20	10.0	8.3	8.3	R-A /Span * 100		0.0

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

	Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	09/07/22 03:15	21.0	18.1		R-A	0.0
	Zero	09/07/22 03:20	21.0	0.0		R-A	0.0
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/08/22 02:14	200.0	0.0		R-A /Span * 100	0.0
	High	09/08/22 02:25	200.0	181.5		R-A /Span * 100	0.2
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/08/22 02:14	30.0	0.0		R-A /Span * 100	0.0
	High	09/08/22 02:20	30.0	27.5		R-A /Span * 100	1.3
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/08/22 02:14	200.0	0.0		R-A /Span * 100	0.0
	High	09/08/22 02:25	200.0	180.0		R-A /Span * 100	0.2
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/08/22 02:14	30.0	0.0		R-A /Span * 100	0.0
	High	09/08/22 02:20	30.0	26.7		R-A /Span * 100	1.3
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/08/22 03:14	200.0	0.0		R-A /Span * 100	0.1
	High	09/08/22 03:24	200.0	184.2		R-A /Span * 100	0.2
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/08/22 03:14	10.0	0.0		R-A /Span * 100	1.0
	High	09/08/22 03:19	10.0	9.7		R-A /Span * 100	0.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/08/22 03:14	200.0	0.0		R-A /Span * 100	0.0
	High	09/08/22 03:24	200.0	181.5		R-A /Span * 100	0.8
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/08/22 03:14	10.0	0.0		R-A /Span * 100	0.0
	High	09/08/22 03:19	10.0	8.8		R-A /Span * 100	2.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	09/08/22 03:14	21.0	18.1		R-A	0.2
	Zero	09/08/22 03:19	21.0	0.0		R-A	0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/08/22 03:15	200.0	0.0		R-A /Span * 100	0.1
	High	09/08/22 03:24	200.0	183.5		R-A /Span * 100	0.6
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/08/22 03:15	10.0	0.0		R-A /Span * 100	2.0
	High	09/08/22 03:19	10.0	8.6		R-A /Span * 100	0.0

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

	Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/08/22 03:15	200.0	0.0		R-A /Span * 100	0.0
	High	09/08/22 03:24	200.0	180.0		R-A /Span * 100	0.9
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/08/22 03:15	10.0	0.0		R-A /Span * 100	0.0
	High	09/08/22 03:19	10.0	8.3		R-A /Span * 100	1.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	09/08/22 03:15	21.0	18.1		R-A	0.0
	Zero	09/08/22 03:19	21.0	0.0		R-A	0.0
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/09/22 02:15	200.0	0.0		R-A /Span * 100	0.0
	High	09/09/22 02:25	200.0	181.5		R-A /Span * 100	0.3
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/09/22 02:15	30.0	0.0		R-A /Span * 100	0.0
	High	09/09/22 02:20	30.0	27.5		R-A /Span * 100	0.3
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/09/22 02:14	200.0	0.0		R-A /Span * 100	0.0
	High	09/09/22 02:24	200.0	180.0		R-A /Span * 100	0.1
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/09/22 02:14	30.0	0.0		R-A /Span * 100	0.0
	High	09/09/22 02:19	30.0	26.7		R-A /Span * 100	1.7
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/09/22 03:14	200.0	0.0		R-A /Span * 100	0.1
	High	09/09/22 03:25	200.0	184.2		R-A /Span * 100	0.6
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/09/22 03:14	10.0	0.0		R-A /Span * 100	2.0
	High	09/09/22 03:19	10.0	9.7		R-A /Span * 100	0.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/09/22 03:14	200.0	0.0		R-A /Span * 100	0.0
	High	09/09/22 03:25	200.0	181.5		R-A /Span * 100	0.3
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/09/22 03:14	10.0	0.0		R-A /Span * 100	0.0
	High	09/09/22 03:19	10.0	8.8		R-A /Span * 100	1.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	09/09/22 03:14	21.0	18.1		R-A	0.2
	Zero	09/09/22 03:19	21.0	0.0		R-A	0.0

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/09/22 03:15	200.0	0.0	0.1	R-A /Span * 100		0.1
	High	09/09/22 03:25	200.0	183.5	185.7	R-A /Span * 100		1.1
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/09/22 03:15	10.0	0.0	0.2	R-A /Span * 100		2.0
	High	09/09/22 03:19	10.0	8.6	8.7	R-A /Span * 100		1.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/09/22 03:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/09/22 03:25	200.0	180.0	178.3	R-A /Span * 100		0.9
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/09/22 03:15	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/09/22 03:19	10.0	8.3	8.2	R-A /Span * 100		1.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	09/09/22 03:15	21.0	18.1	18.1	R-A		0.0
	Zero	09/09/22 03:19	21.0	0.0	0.0	R-A		0.0
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/10/22 02:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/10/22 02:25	200.0	181.5	182.5	R-A /Span * 100		0.5
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/10/22 02:14	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/10/22 02:19	30.0	27.5	27.4	R-A /Span * 100		0.3
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/10/22 02:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/10/22 02:25	200.0	180.0	180.2	R-A /Span * 100		0.1
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/10/22 02:14	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/10/22 02:19	30.0	26.7	27.3	R-A /Span * 100		2.0
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/10/22 03:14	200.0	0.0	0.1	R-A /Span * 100		0.1
	High	09/10/22 03:25	200.0	184.2	184.6	R-A /Span * 100		0.2
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/10/22 03:14	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	09/10/22 03:20	10.0	9.7	9.7	R-A /Span * 100		0.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/10/22 03:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/10/22 03:25	200.0	181.5	179.6	R-A /Span * 100		1.0

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

	Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/10/22 03:14	10.0	0.0		R-A /Span * 100	0.0
	High	09/10/22 03:20	10.0	8.8		R-A /Span * 100	1.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	09/10/22 03:14	21.0	18.1		R-A	0.2
	Zero	09/10/22 03:20	21.0	0.0		R-A	0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/10/22 03:14	200.0	0.1		R-A /Span * 100	0.1
	High	09/10/22 03:24	200.0	183.5		R-A /Span * 100	0.9
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/10/22 03:14	10.0	0.1		R-A /Span * 100	1.0
	High	09/10/22 03:19	10.0	8.6		R-A /Span * 100	0.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/10/22 03:14	200.0	0.0		R-A /Span * 100	0.0
	High	09/10/22 03:24	200.0	180.0		R-A /Span * 100	0.7
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/10/22 03:14	10.0	0.0		R-A /Span * 100	0.0
	High	09/10/22 03:19	10.0	8.3		R-A /Span * 100	0.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	09/10/22 03:14	21.0	18.1		R-A	0.0
	Zero	09/10/22 03:19	21.0	0.0		R-A	0.0
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/11/22 02:14	200.0	0.0		R-A /Span * 100	0.0
	High	09/11/22 02:24	200.0	181.5		R-A /Span * 100	0.1
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/11/22 02:14	30.0	0.0		R-A /Span * 100	0.0
	High	09/11/22 02:19	30.0	27.5		R-A /Span * 100	1.0
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/11/22 02:14	200.0	0.0		R-A /Span * 100	0.0
	High	09/11/22 02:24	200.0	180.0		R-A /Span * 100	0.3
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/11/22 02:14	30.0	0.0		R-A /Span * 100	0.0
	High	09/11/22 02:19	30.0	26.7		R-A /Span * 100	1.0
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/11/22 03:14	200.0	0.1		R-A /Span * 100	0.1
	High	09/11/22 03:24	200.0	184.2		R-A /Span * 100	0.2

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

	Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/11/22 03:14	10.0	0.0		R-A /Span * 100	1.0
	High	09/11/22 03:20	10.0	9.7		R-A /Span * 100	0.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/11/22 03:14	200.0	0.0		R-A /Span * 100	0.0
	High	09/11/22 03:24	200.0	181.5		R-A /Span * 100	1.2
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/11/22 03:14	10.0	0.0		R-A /Span * 100	0.0
	High	09/11/22 03:20	10.0	8.8		R-A /Span * 100	2.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	09/11/22 03:14	21.0	18.1		R-A	0.2
	Zero	09/11/22 03:20	21.0	0.0		R-A	0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/11/22 03:15	200.0	0.0		R-A /Span * 100	0.1
	High	09/11/22 03:25	200.0	183.5		R-A /Span * 100	0.3
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/11/22 03:15	10.0	0.0		R-A /Span * 100	2.0
	High	09/11/22 03:20	10.0	8.6		R-A /Span * 100	0.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/11/22 03:15	200.0	0.0		R-A /Span * 100	0.0
	High	09/11/22 03:25	200.0	180.0		R-A /Span * 100	1.1
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/11/22 03:15	10.0	0.0		R-A /Span * 100	0.0
	High	09/11/22 03:20	10.0	8.3		R-A /Span * 100	0.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	09/11/22 03:15	21.0	18.1		R-A	0.0
	Zero	09/11/22 03:20	21.0	0.0		R-A	0.0
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/12/22 02:15	200.0	0.0		R-A /Span * 100	0.0
	High	09/12/22 02:25	200.0	181.5		R-A /Span * 100	0.2
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/12/22 02:15	30.0	0.0		R-A /Span * 100	0.0
	High	09/12/22 02:20	30.0	27.5		R-A /Span * 100	0.7
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/12/22 02:14	200.0	0.0		R-A /Span * 100	0.0
	High	09/12/22 02:24	200.0	180.0		R-A /Span * 100	0.5

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/12/22 02:14	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/12/22 02:19	30.0	26.7	27.0	R-A /Span * 100		1.0
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/12/22 03:14	200.0	0.0	0.1	R-A /Span * 100		0.1
	High	09/12/22 03:24	200.0	184.2	183.9	R-A /Span * 100		0.2
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/12/22 03:14	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	09/12/22 03:20	10.0	9.7	9.7	R-A /Span * 100		0.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/12/22 03:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/12/22 03:24	200.0	181.5	179.3	R-A /Span * 100		1.1
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/12/22 03:14	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/12/22 03:20	10.0	8.8	8.6	R-A /Span * 100		2.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	09/12/22 03:14	21.0	18.1	18.3	R-A		0.2
	Zero	09/12/22 03:20	21.0	0.0	0.0	R-A		0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/12/22 03:14	200.0	0.0	0.1	R-A /Span * 100		0.1
	High	09/12/22 03:25	200.0	183.5	184.2	R-A /Span * 100		0.4
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/12/22 03:14	10.0	0.0	0.2	R-A /Span * 100		2.0
	High	09/12/22 03:20	10.0	8.6	8.6	R-A /Span * 100		0.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/12/22 03:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/12/22 03:25	200.0	180.0	178.3	R-A /Span * 100		0.9
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/12/22 03:14	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/12/22 03:20	10.0	8.3	8.3	R-A /Span * 100		0.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	09/12/22 03:14	21.0	18.1	18.1	R-A		0.0
	Zero	09/12/22 03:20	21.0	0.0	0.0	R-A		0.0
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/13/22 02:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/13/22 02:25	200.0	181.5	181.7	R-A /Span * 100		0.1

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:26 Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/13/22 02:14	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/13/22 02:19	30.0	27.5	27.3	R-A /Span * 100		0.7
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/13/22 02:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/13/22 02:24	200.0	180.0	178.5	R-A /Span * 100		0.8
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/13/22 02:15	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/13/22 02:19	30.0	26.7	26.9	R-A /Span * 100		0.7
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/13/22 03:14	200.0	0.0	0.1	R-A /Span * 100		0.1
	High	09/13/22 03:25	200.0	184.2	184.4	R-A /Span * 100		0.1
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/13/22 03:14	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	09/13/22 03:20	10.0	9.7	9.7	R-A /Span * 100		0.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/13/22 03:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/13/22 03:25	200.0	181.5	179.4	R-A /Span * 100		1.1
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/13/22 03:14	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/13/22 03:20	10.0	8.8	8.6	R-A /Span * 100		2.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	09/13/22 03:14	21.0	18.1	18.3	R-A		0.2
	Zero	09/13/22 03:20	21.0	0.0	0.0	R-A		0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/13/22 03:15	200.0	0.0	0.1	R-A /Span * 100		0.1
	High	09/13/22 03:25	200.0	183.5	185.1	R-A /Span * 100		0.8
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/13/22 03:15	10.0	0.0	0.2	R-A /Span * 100		2.0
	High	09/13/22 03:20	10.0	8.6	8.6	R-A /Span * 100		0.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/13/22 03:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/13/22 03:25	200.0	180.0	177.9	R-A /Span * 100		1.1
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/13/22 03:15	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/13/22 03:20	10.0	8.3	8.2	R-A /Span * 100		1.0

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

	Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	09/13/22 03:15	21.0	18.1		R-A	0.0
	Zero	09/13/22 03:20	21.0	0.0		R-A	0.0
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/14/22 02:14	200.0	0.0		R-A /Span * 100	0.0
	High	09/14/22 02:24	200.0	178.3		R-A /Span * 100	0.9
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/14/22 02:14	30.0	0.0		R-A /Span * 100	0.0
	High	09/14/22 02:19	30.0	26.9		R-A /Span * 100	0.7
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/14/22 02:14	200.0	0.0		R-A /Span * 100	0.0
	High	09/14/22 02:25	200.0	182.2		R-A /Span * 100	0.4
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/14/22 02:14	30.0	0.0		R-A /Span * 100	0.0
	High	09/14/22 02:19	30.0	27.4		R-A /Span * 100	0.3
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/14/22 03:14	200.0	0.1		R-A /Span * 100	0.1
	High	09/14/22 03:25	200.0	184.4		R-A /Span * 100	0.1
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/14/22 03:14	10.0	0.1		R-A /Span * 100	1.0
	High	09/14/22 03:19	10.0	9.6		R-A /Span * 100	1.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/14/22 03:14	200.0	0.0		R-A /Span * 100	0.0
	High	09/14/22 03:25	200.0	180.3		R-A /Span * 100	0.6
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/14/22 03:14	10.0	0.0		R-A /Span * 100	0.0
	High	09/14/22 03:19	10.0	8.7		R-A /Span * 100	1.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	09/14/22 03:14	21.0	18.3		R-A	0.2
	Zero	09/14/22 03:19	21.0	0.0		R-A	0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/14/22 03:14	200.0	0.1		R-A /Span * 100	0.1
	High	09/14/22 03:25	200.0	184.6		R-A /Span * 100	0.6
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/14/22 03:14	10.0	0.2		R-A /Span * 100	2.0
	High	09/14/22 03:20	10.0	8.6		R-A /Span * 100	0.0

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:26 Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

	Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/14/22 03:14	200.0	0.0		R-A /Span * 100	0.0
	High	09/14/22 03:25	200.0	180.0		R-A /Span * 100	0.8
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/14/22 03:14	10.0	0.0		R-A /Span * 100	0.0
	High	09/14/22 03:20	10.0	8.3		R-A /Span * 100	0.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	09/14/22 03:14	21.0	18.1		R-A	0.0
	Zero	09/14/22 03:20	21.0	0.0		R-A	0.0
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/15/22 02:14	200.0	0.0		R-A /Span * 100	0.0
	High	09/15/22 02:25	200.0	181.5		R-A /Span * 100	0.2
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/15/22 02:14	30.0	0.0		R-A /Span * 100	0.0
	High	09/15/22 02:19	30.0	27.5		R-A /Span * 100	0.3
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/15/22 02:14	200.0	0.0		R-A /Span * 100	0.0
	High	09/15/22 02:24	200.0	180.0		R-A /Span * 100	1.1
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/15/22 02:14	30.0	0.0		R-A /Span * 100	0.0
	High	09/15/22 02:19	30.0	26.7		R-A /Span * 100	0.3
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/15/22 03:14	200.0	0.0		R-A /Span * 100	0.1
	High	09/15/22 03:24	200.0	183.5		R-A /Span * 100	0.6
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/15/22 03:14	10.0	0.0		R-A /Span * 100	2.0
	High	09/15/22 03:19	10.0	8.6		R-A /Span * 100	1.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/15/22 03:14	200.0	0.0		R-A /Span * 100	0.0
	High	09/15/22 03:24	200.0	180.0		R-A /Span * 100	1.1
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/15/22 03:14	10.0	0.0		R-A /Span * 100	0.0
	High	09/15/22 03:19	10.0	8.3		R-A /Span * 100	1.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	09/15/22 03:14	21.0	18.1		R-A	0.0
	Zero	09/15/22 03:19	21.0	0.0		R-A	0.0

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/15/22 03:15	200.0	0.0	0.1	R-A /Span * 100		0.1
	High	09/15/22 03:24	200.0	184.2	184.3	R-A /Span * 100		0.1
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/15/22 03:15	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	09/15/22 03:19	10.0	9.7	9.6	R-A /Span * 100		1.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/15/22 03:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/15/22 03:24	200.0	181.5	180.1	R-A /Span * 100		0.7
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/15/22 03:15	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/15/22 03:19	10.0	8.8	8.8	R-A /Span * 100		0.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	09/15/22 03:15	21.0	18.1	18.3	R-A		0.2
	Zero	09/15/22 03:19	21.0	0.0	0.0	R-A		0.0
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/16/22 02:14	200.0	0.0	0.1	R-A /Span * 100		0.1
	High	09/16/22 02:24	200.0	181.5	181.8	R-A /Span * 100		0.2
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/16/22 02:14	30.0	0.0	0.1	R-A /Span * 100		0.3
	High	09/16/22 02:20	30.0	27.5	27.3	R-A /Span * 100		0.7
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/16/22 02:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/16/22 02:25	200.0	180.0	177.7	R-A /Span * 100		1.2
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/16/22 02:15	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/16/22 02:20	30.0	26.7	26.7	R-A /Span * 100		0.0
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/16/22 03:14	200.0	0.0	0.1	R-A /Span * 100		0.1
	High	09/16/22 03:25	200.0	184.2	184.3	R-A /Span * 100		0.1
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/16/22 03:14	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	09/16/22 03:19	10.0	9.7	9.6	R-A /Span * 100		1.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/16/22 03:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/16/22 03:25	200.0	181.5	180.9	R-A /Span * 100		0.3

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/16/22 03:14	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/16/22 03:19	10.0	8.8	8.9	R-A /Span * 100		1.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	09/16/22 03:14	21.0	18.1	18.3	R-A		0.2
	Zero	09/16/22 03:19	21.0	0.0	0.0	R-A		0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/16/22 03:14	200.0	0.0	0.1	R-A /Span * 100		0.1
	High	09/16/22 03:24	200.0	183.5	184.4	R-A /Span * 100		0.5
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/16/22 03:14	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	09/16/22 03:19	10.0	8.6	8.7	R-A /Span * 100		1.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/16/22 03:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/16/22 03:24	200.0	180.0	177.9	R-A /Span * 100		1.1
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/16/22 03:14	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/16/22 03:19	10.0	8.3	8.2	R-A /Span * 100		1.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	09/16/22 03:14	21.0	18.1	18.1	R-A		0.0
	Zero	09/16/22 03:19	21.0	0.0	0.0	R-A		0.0
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/17/22 02:14	200.0	0.0	0.1	R-A /Span * 100		0.1
	High	09/17/22 02:25	200.0	181.5	182.2	R-A /Span * 100		0.4
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/17/22 02:14	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/17/22 02:20	30.0	27.5	27.3	R-A /Span * 100		0.7
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/17/22 02:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/17/22 02:25	200.0	180.0	177.9	R-A /Span * 100		1.1
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/17/22 02:14	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/17/22 02:19	30.0	26.7	26.8	R-A /Span * 100		0.3
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/17/22 03:14	200.0	0.0	0.1	R-A /Span * 100		0.1
	High	09/17/22 03:25	200.0	184.2	184.6	R-A /Span * 100		0.2

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

	Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/17/22 03:14	10.0	0.0	0.1	R-A /Span * 100	1.0
	High	09/17/22 03:20	10.0	9.7	9.6	R-A /Span * 100	1.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/17/22 03:14	200.0	0.0	0.0	R-A /Span * 100	0.0
	High	09/17/22 03:25	200.0	181.5	181.0	R-A /Span * 100	0.3
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/17/22 03:14	10.0	0.0	0.0	R-A /Span * 100	0.0
	High	09/17/22 03:20	10.0	8.8	8.9	R-A /Span * 100	1.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	09/17/22 03:14	21.0	18.1	18.2	R-A	0.1
	Zero	09/17/22 03:20	21.0	0.0	0.0	R-A	0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/17/22 03:15	200.0	0.0	0.1	R-A /Span * 100	0.1
	High	09/17/22 03:25	200.0	183.5	185.3	R-A /Span * 100	0.9
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/17/22 03:15	10.0	0.0	0.1	R-A /Span * 100	1.0
	High	09/17/22 03:20	10.0	8.6	8.6	R-A /Span * 100	0.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/17/22 03:15	200.0	0.0	0.0	R-A /Span * 100	0.0
	High	09/17/22 03:25	200.0	180.0	178.2	R-A /Span * 100	0.9
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/17/22 03:15	10.0	0.0	0.0	R-A /Span * 100	0.0
	High	09/17/22 03:20	10.0	8.3	8.2	R-A /Span * 100	1.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	09/17/22 03:15	21.0	18.1	18.1	R-A	0.0
	Zero	09/17/22 03:20	21.0	0.0	0.0	R-A	0.0
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/18/22 02:15	200.0	0.0	0.0	R-A /Span * 100	0.0
	High	09/18/22 02:25	200.0	181.5	182.0	R-A /Span * 100	0.3
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/18/22 02:15	30.0	0.0	0.0	R-A /Span * 100	0.0
	High	09/18/22 02:20	30.0	27.5	27.3	R-A /Span * 100	0.7
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/18/22 02:14	200.0	0.0	0.0	R-A /Span * 100	0.0
	High	09/18/22 02:25	200.0	180.0	177.4	R-A /Span * 100	1.3

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/18/22 02:14	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/18/22 02:19	30.0	26.7	26.7	R-A /Span * 100		0.0
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/18/22 03:14	200.0	0.0	0.1	R-A /Span * 100		0.1
	High	09/18/22 03:24	200.0	184.2	185.3	R-A /Span * 100		0.6
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/18/22 03:14	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	09/18/22 03:19	10.0	9.7	9.7	R-A /Span * 100		0.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/18/22 03:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/18/22 03:24	200.0	181.5	181.0	R-A /Span * 100		0.3
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/18/22 03:14	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/18/22 03:19	10.0	8.8	8.9	R-A /Span * 100		1.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	09/18/22 03:14	21.0	18.1	18.2	R-A		0.1
	Zero	09/18/22 03:19	21.0	0.0	0.0	R-A		0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/18/22 03:15	200.0	0.0	0.1	R-A /Span * 100		0.1
	High	09/18/22 03:25	200.0	183.5	185.4	R-A /Span * 100		1.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/18/22 03:15	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	09/18/22 03:20	10.0	8.6	8.6	R-A /Span * 100		0.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/18/22 03:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/18/22 03:25	200.0	180.0	178.0	R-A /Span * 100		1.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/18/22 03:15	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/18/22 03:20	10.0	8.3	8.2	R-A /Span * 100		1.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	09/18/22 03:15	21.0	18.1	18.1	R-A		0.0
	Zero	09/18/22 03:20	21.0	0.0	0.0	R-A		0.0
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/19/22 02:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/19/22 02:25	200.0	181.5	181.6	R-A /Span * 100		0.1

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/19/22 02:14	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/19/22 02:19	30.0	27.5	27.2	R-A /Span * 100		1.0
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/19/22 02:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/19/22 02:25	200.0	180.0	177.2	R-A /Span * 100		1.4
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/19/22 02:14	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/19/22 02:19	30.0	26.7	26.7	R-A /Span * 100		0.0
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/19/22 03:14	200.0	0.0	0.1	R-A /Span * 100		0.1
	High	09/19/22 03:24	200.0	184.2	184.9	R-A /Span * 100		0.4
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/19/22 03:14	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	09/19/22 03:19	10.0	9.7	9.7	R-A /Span * 100		0.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/19/22 03:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/19/22 03:24	200.0	181.5	180.1	R-A /Span * 100		0.7
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/19/22 03:14	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/19/22 03:19	10.0	8.8	8.8	R-A /Span * 100		0.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	09/19/22 03:14	21.0	18.1	18.2	R-A		0.1
	Zero	09/19/22 03:19	21.0	0.0	0.0	R-A		0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/19/22 03:15	200.0	0.0	0.1	R-A /Span * 100		0.1
	High	09/19/22 03:25	200.0	183.5	185.0	R-A /Span * 100		0.8
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/19/22 03:15	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	09/19/22 03:20	10.0	8.6	8.6	R-A /Span * 100		0.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/19/22 03:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/19/22 03:25	200.0	180.0	177.6	R-A /Span * 100		1.2
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/19/22 03:15	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/19/22 03:20	10.0	8.3	8.2	R-A /Span * 100		1.0

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	09/19/22 03:15	21.0	18.1	18.1	R-A		0.0
	Zero	09/19/22 03:20	21.0	0.0	0.0	R-A		0.0
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/20/22 02:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/20/22 02:24	200.0	181.5	180.8	R-A /Span * 100		0.4
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/20/22 02:14	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/20/22 02:19	30.0	27.5	27.0	R-A /Span * 100		1.7
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/20/22 02:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/20/22 02:24	200.0	180.0	178.1	R-A /Span * 100		1.0
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/20/22 02:15	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/20/22 02:20	30.0	26.7	26.8	R-A /Span * 100		0.3
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/20/22 03:15	200.0	0.0	0.1	R-A /Span * 100		0.1
	High	09/20/22 03:25	200.0	184.2	184.7	R-A /Span * 100		0.3
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/20/22 03:15	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	09/20/22 03:20	10.0	9.7	9.7	R-A /Span * 100		0.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/20/22 03:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/20/22 03:25	200.0	181.5	179.9	R-A /Span * 100		0.8
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/20/22 03:15	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/20/22 03:20	10.0	8.8	8.8	R-A /Span * 100		0.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	09/20/22 03:15	21.0	18.1	18.2	R-A		0.1
	Zero	09/20/22 03:20	21.0	0.0	0.0	R-A		0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/20/22 03:15	200.0	0.0	0.1	R-A /Span * 100		0.1
	High	09/20/22 03:25	200.0	183.5	183.9	R-A /Span * 100		0.2
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/20/22 03:15	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	09/20/22 03:19	10.0	8.6	8.6	R-A /Span * 100		0.0

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

	Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/20/22 03:15	200.0	0.0		R-A /Span * 100	0.0
	High	09/20/22 03:25	200.0	180.0		R-A /Span * 100	1.3
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/20/22 03:15	10.0	0.0		R-A /Span * 100	0.0
	High	09/20/22 03:19	10.0	8.3		R-A /Span * 100	1.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	09/20/22 03:15	21.0	18.1		R-A	0.0
	Zero	09/20/22 03:19	21.0	0.0		R-A	0.0
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/21/22 02:15	200.0	0.0		R-A /Span * 100	0.0
	High	09/21/22 02:24	200.0	181.5		R-A /Span * 100	0.3
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/21/22 02:15	30.0	0.0		R-A /Span * 100	0.0
	High	09/21/22 02:19	30.0	27.5		R-A /Span * 100	1.7
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/21/22 02:14	200.0	0.0		R-A /Span * 100	0.0
	High	09/21/22 02:24	200.0	180.0		R-A /Span * 100	1.1
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/21/22 02:14	30.0	0.0		R-A /Span * 100	0.0
	High	09/21/22 02:19	30.0	26.7		R-A /Span * 100	0.3
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/21/22 03:15	200.0	0.0		R-A /Span * 100	0.1
	High	09/21/22 03:25	200.0	184.2		R-A /Span * 100	0.1
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/21/22 03:15	10.0	0.0		R-A /Span * 100	1.0
	High	09/21/22 03:20	10.0	9.7		R-A /Span * 100	1.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/21/22 03:15	200.0	0.0		R-A /Span * 100	0.0
	High	09/21/22 03:25	200.0	181.5		R-A /Span * 100	0.7
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/21/22 03:15	10.0	0.0		R-A /Span * 100	0.0
	High	09/21/22 03:20	10.0	8.8		R-A /Span * 100	1.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	09/21/22 03:15	21.0	18.1		R-A	0.1
	Zero	09/21/22 03:20	21.0	0.0		R-A	0.0

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/21/22 03:14	200.0	0.0	0.1	R-A /Span * 100		0.1
	High	09/21/22 03:25	200.0	183.5	184.3	R-A /Span * 100		0.4
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/21/22 03:14	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	09/21/22 03:19	10.0	8.6	8.6	R-A /Span * 100		0.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/21/22 03:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/21/22 03:25	200.0	180.0	177.7	R-A /Span * 100		1.2
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/21/22 03:14	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/21/22 03:19	10.0	8.3	8.2	R-A /Span * 100		1.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	09/21/22 03:14	21.0	18.1	18.1	R-A		0.0
	Zero	09/21/22 03:19	21.0	0.0	0.0	R-A		0.0
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/22/22 02:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/22/22 02:24	200.0	181.5	181.1	R-A /Span * 100		0.2
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/22/22 02:14	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/22/22 02:19	30.0	27.5	27.1	R-A /Span * 100		1.3
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/22/22 02:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/22/22 02:25	200.0	180.0	177.6	R-A /Span * 100		1.2
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/22/22 02:15	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/22/22 02:20	30.0	26.7	26.7	R-A /Span * 100		0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/22/22 03:14	200.0	0.0	0.1	R-A /Span * 100		0.1
	High	09/22/22 03:24	200.0	183.5	183.5	R-A /Span * 100		0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/22/22 03:14	10.0	0.0	0.2	R-A /Span * 100		2.0
	High	09/22/22 03:19	10.0	8.6	8.6	R-A /Span * 100		0.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/22/22 03:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/22/22 03:24	200.0	180.0	177.5	R-A /Span * 100		1.3

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

	Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/22/22 03:14	10.0	0.0	R-A /Span * 100		0.0
	High	09/22/22 03:19	10.0	8.3	R-A /Span * 100		1.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	09/22/22 03:14	21.0	18.1	R-A		0.0
	Zero	09/22/22 03:19	21.0	0.0	R-A		0.0
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/22/22 03:14	200.0	0.1	R-A /Span * 100		0.1
	High	09/22/22 03:25	200.0	184.2	R-A /Span * 100		0.2
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/22/22 03:14	10.0	0.1	R-A /Span * 100		1.0
	High	09/22/22 03:19	10.0	9.7	R-A /Span * 100		1.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/22/22 03:14	200.0	0.0	R-A /Span * 100		0.0
	High	09/22/22 03:25	200.0	181.5	R-A /Span * 100		0.6
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/22/22 03:14	10.0	0.0	R-A /Span * 100		0.0
	High	09/22/22 03:19	10.0	8.8	R-A /Span * 100		1.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	09/22/22 03:14	21.0	18.1	R-A		0.1
	Zero	09/22/22 03:19	21.0	0.0	R-A		0.0
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/23/22 14:41	200.0	0.1	R-A /Span * 100		0.1
	High	09/23/22 14:52	200.0	184.2	R-A /Span * 100		0.1
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/23/22 14:41	10.0	0.1	R-A /Span * 100		1.0
	High	09/23/22 14:46	10.0	9.7	R-A /Span * 100		1.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/23/22 14:41	200.0	0.0	R-A /Span * 100		0.0
	High	09/23/22 14:52	200.0	181.5	R-A /Span * 100		1.2
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/23/22 14:41	10.0	0.0	R-A /Span * 100		0.0
	High	09/23/22 14:46	10.0	8.8	R-A /Span * 100		0.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	09/23/22 14:41	21.0	18.1	R-A		0.2
	Zero	09/23/22 14:46	21.0	0.0	R-A		0.0

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/23/22 17:50	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/23/22 18:00	200.0	183.5	184.3	R-A /Span * 100		0.4
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/23/22 17:50	10.0	0.0	-0.1	R-A /Span * 100		1.0
	High	09/23/22 17:55	10.0	8.6	8.6	R-A /Span * 100		0.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/23/22 17:50	200.0	0.0	-0.1	R-A /Span * 100		0.1
	High	09/23/22 18:00	200.0	180.0	180.2	R-A /Span * 100		0.1
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/23/22 17:50	10.0	0.0	-0.1	R-A /Span * 100		1.0
	High	09/23/22 17:55	10.0	8.3	8.1	R-A /Span * 100		2.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	09/23/22 17:50	21.0	18.1	18.1	R-A		0.0
	Zero	09/23/22 17:55	21.0	0.0	0.0	R-A		0.0
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/24/22 02:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/24/22 02:24	200.0	180.0	180.3	R-A /Span * 100		0.2
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/24/22 02:14	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/24/22 02:20	30.0	26.7	26.7	R-A /Span * 100		0.0
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/24/22 02:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/24/22 02:25	200.0	181.5	181.1	R-A /Span * 100		0.2
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/24/22 02:14	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/24/22 02:20	30.0	27.5	27.1	R-A /Span * 100		1.3
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/24/22 03:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/24/22 03:24	200.0	183.5	184.2	R-A /Span * 100		0.4
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/24/22 03:14	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/24/22 03:19	10.0	8.6	8.5	R-A /Span * 100		1.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/24/22 03:14	200.0	0.0	-0.1	R-A /Span * 100		0.1
	High	09/24/22 03:24	200.0	180.0	180.2	R-A /Span * 100		0.1

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

	Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/24/22 03:14	10.0	0.0	-0.1	R-A /Span * 100	1.0
	High	09/24/22 03:19	10.0	8.3	8.2	R-A /Span * 100	1.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	09/24/22 03:14	21.0	18.1	18.1	R-A	0.0
	Zero	09/24/22 03:19	21.0	0.0	0.0	R-A	0.0
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/24/22 03:14	200.0	0.0	0.1	R-A /Span * 100	0.1
	High	09/24/22 03:24	200.0	184.2	184.0	R-A /Span * 100	0.1
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/24/22 03:14	10.0	0.0	0.1	R-A /Span * 100	1.0
	High	09/24/22 03:19	10.0	9.7	9.6	R-A /Span * 100	1.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/24/22 03:14	200.0	0.0	0.0	R-A /Span * 100	0.0
	High	09/24/22 03:24	200.0	181.5	179.9	R-A /Span * 100	0.8
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/24/22 03:14	10.0	0.0	0.0	R-A /Span * 100	0.0
	High	09/24/22 03:19	10.0	8.8	8.8	R-A /Span * 100	0.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	09/24/22 03:14	21.0	18.1	18.2	R-A	0.1
	Zero	09/24/22 03:19	21.0	0.0	0.0	R-A	0.0
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/25/22 02:14	200.0	0.0	0.0	R-A /Span * 100	0.0
	High	09/25/22 02:25	200.0	181.5	181.2	R-A /Span * 100	0.2
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/25/22 02:14	30.0	0.0	0.0	R-A /Span * 100	0.0
	High	09/25/22 02:20	30.0	27.5	27.2	R-A /Span * 100	1.0
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/25/22 02:15	200.0	0.0	0.0	R-A /Span * 100	0.0
	High	09/25/22 02:25	200.0	180.0	180.3	R-A /Span * 100	0.2
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/25/22 02:15	30.0	0.0	0.0	R-A /Span * 100	0.0
	High	09/25/22 02:20	30.0	26.7	26.8	R-A /Span * 100	0.3
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/25/22 03:14	200.0	0.0	0.1	R-A /Span * 100	0.1
	High	09/25/22 03:25	200.0	184.2	183.9	R-A /Span * 100	0.2

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/25/22 03:14	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	09/25/22 03:19	10.0	9.7	9.6	R-A /Span * 100		1.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/25/22 03:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/25/22 03:25	200.0	181.5	179.6	R-A /Span * 100		1.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/25/22 03:14	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/25/22 03:19	10.0	8.8	8.8	R-A /Span * 100		0.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	09/25/22 03:14	21.0	18.1	18.2	R-A		0.1
	Zero	09/25/22 03:19	21.0	0.0	0.0	R-A		0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/25/22 03:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/25/22 03:25	200.0	183.5	184.4	R-A /Span * 100		0.5
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/25/22 03:14	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/25/22 03:20	10.0	8.6	8.6	R-A /Span * 100		0.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/25/22 03:14	200.0	0.0	-0.1	R-A /Span * 100		0.1
	High	09/25/22 03:25	200.0	180.0	180.8	R-A /Span * 100		0.4
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/25/22 03:14	10.0	0.0	-0.1	R-A /Span * 100		1.0
	High	09/25/22 03:20	10.0	8.3	8.2	R-A /Span * 100		1.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	09/25/22 03:14	21.0	18.1	18.1	R-A		0.0
	Zero	09/25/22 03:20	21.0	0.0	0.0	R-A		0.0
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/26/22 02:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/26/22 02:24	200.0	180.0	179.1	R-A /Span * 100		0.5
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/26/22 02:14	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/26/22 02:19	30.0	26.7	26.5	R-A /Span * 100		0.7
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/26/22 02:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/26/22 02:24	200.0	181.5	180.9	R-A /Span * 100		0.3

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/26/22 02:14	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/26/22 02:19	30.0	27.5	27.1	R-A /Span * 100		1.3
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/26/22 03:15	200.0	0.0	0.1	R-A /Span * 100		0.1
	High	09/26/22 03:25	200.0	184.2	184.4	R-A /Span * 100		0.1
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/26/22 03:15	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	09/26/22 03:20	10.0	9.7	9.6	R-A /Span * 100		1.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/26/22 03:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/26/22 03:25	200.0	181.5	179.9	R-A /Span * 100		0.8
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/26/22 03:15	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/26/22 03:20	10.0	8.8	8.9	R-A /Span * 100		1.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	09/26/22 03:15	21.0	18.1	18.2	R-A		0.1
	Zero	09/26/22 03:20	21.0	0.0	0.0	R-A		0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/26/22 03:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/26/22 03:25	200.0	183.5	184.4	R-A /Span * 100		0.5
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/26/22 03:15	10.0	0.0	-0.1	R-A /Span * 100		1.0
	High	09/26/22 03:20	10.0	8.6	8.6	R-A /Span * 100		0.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/26/22 03:15	200.0	0.0	-0.1	R-A /Span * 100		0.1
	High	09/26/22 03:25	200.0	180.0	180.4	R-A /Span * 100		0.2
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/26/22 03:15	10.0	0.0	-0.1	R-A /Span * 100		1.0
	High	09/26/22 03:20	10.0	8.3	8.2	R-A /Span * 100		1.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	09/26/22 03:15	21.0	18.1	18.1	R-A		0.0
	Zero	09/26/22 03:20	21.0	0.0	0.0	R-A		0.0
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/27/22 02:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/27/22 02:25	200.0	181.5	181.4	R-A /Span * 100		0.1

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/27/22 02:15	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/27/22 02:20	30.0	27.5	27.2	R-A /Span * 100		1.0
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/27/22 02:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/27/22 02:25	200.0	180.0	179.6	R-A /Span * 100		0.2
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/27/22 02:14	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/27/22 02:20	30.0	26.7	26.5	R-A /Span * 100		0.7
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/27/22 03:14	200.0	0.0	0.1	R-A /Span * 100		0.1
	High	09/27/22 03:25	200.0	184.2	184.2	R-A /Span * 100		0.0
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/27/22 03:14	10.0	0.0	0.1	R-A /Span * 100		1.0
	High	09/27/22 03:20	10.0	9.7	9.6	R-A /Span * 100		1.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/27/22 03:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/27/22 03:25	200.0	181.5	180.3	R-A /Span * 100		0.6
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/27/22 03:14	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/27/22 03:20	10.0	8.8	8.9	R-A /Span * 100		1.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	09/27/22 03:14	21.0	18.1	18.2	R-A		0.1
	Zero	09/27/22 03:20	21.0	0.0	0.0	R-A		0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/27/22 03:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/27/22 03:25	200.0	183.5	184.3	R-A /Span * 100		0.4
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/27/22 03:14	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/27/22 03:19	10.0	8.6	8.7	R-A /Span * 100		1.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/27/22 03:14	200.0	0.0	-0.1	R-A /Span * 100		0.1
	High	09/27/22 03:25	200.0	180.0	180.6	R-A /Span * 100		0.3
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/27/22 03:14	10.0	0.0	-0.1	R-A /Span * 100		1.0
	High	09/27/22 03:19	10.0	8.3	8.2	R-A /Span * 100		1.0

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:26 Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

	Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	09/27/22 03:14	21.0	18.3	R-A		0.0
	Zero	09/27/22 03:19	21.0	0.0	R-A		0.0
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/28/22 02:14	200.0	0.0	R-A /Span * 100		0.0
	High	09/28/22 02:25	200.0	180.9	R-A /Span * 100		0.3
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/28/22 02:14	30.0	0.0	R-A /Span * 100		0.0
	High	09/28/22 02:20	30.0	27.3	R-A /Span * 100		0.7
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/28/22 02:14	200.0	0.0	R-A /Span * 100		0.0
	High	09/28/22 02:25	200.0	179.6	R-A /Span * 100		0.2
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/28/22 02:14	30.0	0.0	R-A /Span * 100		0.0
	High	09/28/22 02:19	30.0	26.5	R-A /Span * 100		0.7
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/28/22 03:15	200.0	0.0	R-A /Span * 100		0.0
	High	09/28/22 03:25	200.0	184.3	R-A /Span * 100		0.1
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/28/22 03:15	10.0	0.0	R-A /Span * 100		0.0
	High	09/28/22 03:19	10.0	9.6	R-A /Span * 100		1.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/28/22 03:15	200.0	0.0	R-A /Span * 100		0.0
	High	09/28/22 03:25	200.0	180.4	R-A /Span * 100		0.6
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/28/22 03:15	10.0	0.0	R-A /Span * 100		0.0
	High	09/28/22 03:19	10.0	8.7	R-A /Span * 100		1.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	09/28/22 03:15	21.0	18.3	R-A		0.2
	Zero	09/28/22 03:19	21.0	0.0	R-A		0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/28/22 03:14	200.0	0.0	R-A /Span * 100		0.0
	High	09/28/22 03:25	200.0	184.6	R-A /Span * 100		0.6
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/28/22 03:14	10.0	0.0	R-A /Span * 100		0.0
	High	09/28/22 03:19	10.0	8.7	R-A /Span * 100		1.0

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

	Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/28/22 03:14	200.0	0.0	-0.1	R-A /Span * 100	0.1
	High	09/28/22 03:25	200.0	180.0	180.7	R-A /Span * 100	0.4
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/28/22 03:14	10.0	0.0	-0.1	R-A /Span * 100	1.0
	High	09/28/22 03:19	10.0	8.3	8.2	R-A /Span * 100	1.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	09/28/22 03:14	21.0	18.3	18.3	R-A	0.0
	Zero	09/28/22 03:19	21.0	0.0	0.0	R-A	0.0
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/29/22 02:14	200.0	0.0	0.0	R-A /Span * 100	0.0
	High	09/29/22 02:25	200.0	180.0	177.3	R-A /Span * 100	1.4
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/29/22 02:14	30.0	0.0	0.0	R-A /Span * 100	0.0
	High	09/29/22 02:19	30.0	27.5	27.4	R-A /Span * 100	0.3
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/29/22 02:14	200.0	0.0	0.0	R-A /Span * 100	0.0
	High	09/29/22 02:25	200.0	180.0	179.3	R-A /Span * 100	0.4
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/29/22 02:14	30.0	0.0	0.0	R-A /Span * 100	0.0
	High	09/29/22 02:19	30.0	26.7	26.5	R-A /Span * 100	0.7
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/29/22 03:14	200.0	0.0	0.0	R-A /Span * 100	0.0
	High	09/29/22 03:24	200.0	183.7	184.0	R-A /Span * 100	0.2
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/29/22 03:14	10.0	0.0	0.0	R-A /Span * 100	0.0
	High	09/29/22 03:19	10.0	9.7	9.6	R-A /Span * 100	1.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/29/22 03:14	200.0	0.0	0.0	R-A /Span * 100	0.0
	High	09/29/22 03:24	200.0	180.0	179.1	R-A /Span * 100	0.5
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/29/22 03:14	10.0	0.0	0.0	R-A /Span * 100	0.0
	High	09/29/22 03:19	10.0	8.8	8.7	R-A /Span * 100	1.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	09/29/22 03:14	21.0	18.1	18.3	R-A	0.2
	Zero	09/29/22 03:19	21.0	0.0	0.0	R-A	0.0

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

		Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/29/22 03:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/29/22 03:25	200.0	183.5	185.0	R-A /Span * 100		0.8
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/29/22 03:15	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/29/22 03:20	10.0	8.6	8.7	R-A /Span * 100		1.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/29/22 03:15	200.0	0.0	-0.1	R-A /Span * 100		0.1
	High	09/29/22 03:25	200.0	180.0	180.4	R-A /Span * 100		0.2
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/29/22 03:15	10.0	0.0	-0.1	R-A /Span * 100		1.0
	High	09/29/22 03:20	10.0	8.3	8.1	R-A /Span * 100		2.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	High	09/29/22 03:15	21.0	18.3	18.3	R-A		0.0
	Zero	09/29/22 03:20	21.0	0.0	0.0	R-A		0.0
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/30/22 02:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/30/22 02:24	200.0	180.0	178.8	R-A /Span * 100		0.6
Part 60	CT1_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/30/22 02:14	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/30/22 02:20	30.0	27.2	26.2	>1x Alert R-A /Span * 100		3.3
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/30/22 02:14	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/30/22 02:24	200.0	180.0	180.1	R-A /Span * 100		0.1
Part 60	CT2_NOXInlet_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/30/22 02:14	30.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/30/22 02:19	30.0	26.7	26.6	R-A /Span * 100		0.3
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/30/22 03:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/30/22 03:25	200.0	183.7	184.4	R-A /Span * 100		0.4
Part 60	CT1_CODualRg_P_Instrument	Used For QA	Range: Low			Calibration Result: Online	Pass	
	Zero	09/30/22 03:15	10.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/30/22 03:20	10.0	9.7	9.6	R-A /Span * 100		1.0
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: High			Calibration Result: Online	Pass	
	Zero	09/30/22 03:15	200.0	0.0	0.0	R-A /Span * 100		0.0
	High	09/30/22 03:25	200.0	180.0	179.6	R-A /Span * 100		0.2

Daily Calibration Results

CT1 and CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY

Generated: 10/01/2022 21:26

Location: Roseville, CA



All Monitoring Sites, All Instruments, Daily Calibrations

	Calibration Time	Span	Reference	Actual	Status	Performance Specification	Deviation
Part 75	CT1_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/30/22 03:15	10.0	0.0		R-A /Span * 100	0.0
	High	09/30/22 03:20	10.0	8.8		R-A /Span * 100	1.0
Part 75	CT1_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	09/30/22 03:15	21.0	18.1		R-A	0.2
	Zero	09/30/22 03:20	21.0	0.0		R-A	0.0
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/30/22 03:15	200.0	0.0		R-A /Span * 100	0.0
	High	09/30/22 03:25	200.0	183.5		R-A /Span * 100	0.7
Part 60	CT2_CODualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/30/22 03:15	10.0	0.0		R-A /Span * 100	0.0
	High	09/30/22 03:20	10.0	8.6		R-A /Span * 100	0.0
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	Zero	09/30/22 03:15	200.0	0.0		R-A /Span * 100	0.1
	High	09/30/22 03:25	200.0	180.0		R-A /Span * 100	0.3
Part 75	CT2_NOXDualRg_P_Instrument	Used For QA	Range: Low		Calibration Result: Online	Pass	
	Zero	09/30/22 03:15	10.0	0.0		R-A /Span * 100	1.0
	High	09/30/22 03:20	10.0	8.3		R-A /Span * 100	1.0
Part 75	CT2_O2D_P_Instrument	Used For QA	Range: High		Calibration Result: Online	Pass	
	High	09/30/22 03:15	21.0	18.3		R-A	0.0
	Zero	09/30/22 03:20	21.0	0.0		R-A	0.0

CEMs Log

Date/Time	Operator	Description
09/29/22 12:47	Operator (DE)	CHANGED UNIT 1 INLET NOX BOTTLE. BOTTLE #EB0089665. NOX 27.17 PPM. EXP 7/28/24
09/29/22 12:46	Operator (DE)	CHANGED UNIT 2 INLET NOX BOTTLE. BOTTLE #EB0144513. NOX 26.7 PPM. EXP 12/29/24
09/28/22 14:12	Operator (DE)	INSTALLED UNIT 1 HI NOX/CO DAILY CALIBRATION CYLINDER EB0144763 EXP 1/6/25
09/26/22 16:39	Operator (GAB)	CHANGED OUT UNIT 2 O2 BOTTLE ID#EB0036555 EXP DATE 1/5/27
09/22/22 10:46	Operator (ME)	COMPLETED UNIT 2 CEMS PMs AND SPANNED / ZEROED GASES. ALL SAT.
09/14/22 11:36	Operator (DWN)	CHANGED UNIT 1 O2 BOTTLE. 18.13% EB0022333. EXP. 3/3/27
09/13/22 14:21	Operator (JB)	CHANGED OUT UNIT 1 STACK LOW NOX/CO BOTTLE CYLINDER NUMBER CC216294 CERT DATE 10/20/21 EXP DATE 10/21/23 NITRIC OXIDE CERT CONCENTRATION 8.813 PPM CARBON MONOXIDE CERT CONCENTRATION 9.653
09/12/22 7:19	Operator (RC)	NEW GCV VALUE UPDATE TO 104400
09/05/22 12:13	Operator (LH)	UNIT 2 HI NOX/CO COMBO BOTTLE SWAPPED # EB0144782 EXP 1/6/25
08/31/22 16:26	Operator (RG3)	SWAPPED OUT UNIT 2 INLET LOW NOX ID#EB0144800 EXP DATE 12/29/2024
08/30/22 1:27	Operator (GAB)	8/27/2022 CHANGED OUT HIGH NOX/CO CYLINDER ID EB0025011. NOX 181.5. CO 184.2 .EXP DATE 1/5/2025
08/25/22 8:19	Operator (RG3)	SWAPPED OUT UNIT 2 LOW NOX/CO 9PPM ID#EB0097894 EXP DATE 12/1/23
08/22/22 9:13	Operator (RGG)	SWAPPED OUT UNIT2 O2 ID#EB0097885 EXP DATE 10/22/2026
08/08/22 10:36	Operator (DE)	UPDATED GCV VALUE FOR AUGUST TO 103,800 FOR ALL THREE ENTRIES ON FUEL FACTOR.
08/07/22 7:53	Operator (LH)	SWAPPED OUT UNIT 1 O2 BOTTLE ID#EB0012582 EXP DATE 3/3/27
08/04/22 13:48	Operator (BRB)	CHANGED PRESSURE SWITCH AND SPANNED GASSES FOR UNIT 1 INLET.
08/03/22 14:23	Operator (RG)	CHANGED OUT HIGH SPAN BOTTLE CT2. CYLINDER ID EB0025000. NOX 182. CO 184.9.
07/30/22 23:27	Operator (DWN)	CHANGED UNIT 2 INLET NOX BOTTLE. BOTTLE #EB0144505. NOX 27.5 PPM. EXP 12-28-24
07/29/22 16:16	Operator (LHR)	CHANGED OUT 1 INLET NOX LOW RANGE ON CT-1, BOTTLE ID EB0144493. NEW VALUE - 27.50
07/26/22 21:16	Operator (RC)	CHANGED OUT 1 HIGH NOX BOTTLE CT-1 BOTTLE ID EB0144805 NEW VALUE - 181.0

Date/Time	Operator	Description
07/21/22 20:41	Operator (LH)	UNIT 1 O2 BOTTLE SWAPPED OUT 18.28% BOTTLE# EB0012592 1/5/27 EXPIRATION DATE
07/18/22 4:06	Operator (LHR)	CHANGED UNIT 2 O2 BOTTLE # EB0051727, 18.13% EXP DATE 1/5/2027
07/07/22 4:03	Operator (JB)	UPDATED GCV VALUE FOR JULY TO 104,100
07/06/22 15:19	Administrator (BRB)	ADDED REASON AND ACTION FOR EMISSIONS ALARM ON 6/30/2022

Cylinder Gas Audit

10/01/2022

Page 1

Facility:	ROSEVILLE ENERGY	Instrument	CT1_CODualRg_P_Instr
Unit/Stack:	CT1	Performance	15 Pct
Parameter/Scal	CO / Low	Test	Pass
		Alternate Spec:	5 Ppm

Date	Time	Test Level	Span Value	Reference	Measured Value	Ref Value As Pct Span
07/21/2022	11:03	L	10	2.400	2.300	24.0 %
07/21/2022	11:08	M	10	5.700	5.700	57.0 %
07/21/2022	11:15	L	10	2.400	2.300	24.0 %
07/21/2022	11:20	M	10	5.700	5.700	57.0 %
07/21/2022	11:27	L	10	2.400	2.300	24.0 %
07/21/2022	11:32	M	10	5.700	5.700	57.0 %

Summary

Cal Gas Level	Reference	Mean	CEMS Mean	Specification	Results
L	2.400		2.300	Std	4.2
M	5.700		5.700	Std	0.0

Cylinder Gas Audit

10/01/2022

Page 2

Facility:	ROSEVILLE ENERGY	Instrument	CT1_CODualRg_P_Instr
Unit/Stack:	CT1	Performance	15 Pct
Parameter/Scal	CO / High	Test	Pass
		Alternate Spec:	5 Ppm

Date	Time	Test Level	Span Value	Reference	Measured Value	Ref Value As Pct Span
07/21/2022	12:32	L	200	50.300	49.700	25.2 %
07/21/2022	12:37	M	200	112.800	114.300	56.4 %
07/21/2022	12:49	L	200	50.300	49.700	25.2 %
07/21/2022	12:54	M	200	112.800	114.200	56.4 %
07/21/2022	13:06	L	200	50.300	49.900	25.2 %
07/21/2022	13:11	M	200	112.800	114.300	56.4 %

Summary

Cal Gas Level	Reference Mean	CEMS Mean	Specification	Results
L	50.300	49.767	Std	1.1
M	112.800	114.267	Std	1.3

Cylinder Gas Audit

10/01/2022

Page 3

Facility:	ROSEVILLE ENERGY	Instrument	CT2_CODualRg_P_Instr
Unit/Stack:	CT2	Performance	15 Pct
Parameter/Scal	CO / High	Test	Pass
		Alternate Spec:	5 Ppm

Date	Time	Test Level	Span Value	Reference	Measured Value	Ref Value As Pct Span
08/03/2022	07:35	L	200	49.400	50.000	24.7 %
08/03/2022	07:40	M	200	112.700	115.800	56.4 %
08/03/2022	07:53	L	200	49.400	50.000	24.7 %
08/03/2022	07:58	M	200	112.700	116.300	56.4 %
08/03/2022	08:10	L	200	49.400	50.000	24.7 %
08/03/2022	08:15	M	200	112.700	116.100	56.4 %

Summary

Cal Gas Level	Reference Mean	CEMS Mean	Specification	Results
L	49.400	50.000	Std	1.2
M	112.700	116.067	Std	3.0

Cylinder Gas Audit

10/01/2022

Page 4

Facility:	ROSEVILLE ENERGY	Instrument	CT2_CODualRg_P_Instr
Unit/Stack:	CT2	Performance	15 Pct
Parameter/Scal	CO / Low	Test	Pass
		Alternate Spec:	5 Ppm

Date	Time	Test Level	Span Value	Reference	Measured Value	Ref Value As Pct Span
08/03/2022	12:40	L	10	2.400	2.200	24.0 %
08/03/2022	12:45	M	10	5.700	5.500	57.0 %
08/03/2022	12:53	L	10	2.400	2.200	24.0 %
08/03/2022	12:58	M	10	5.700	5.500	57.0 %
08/03/2022	13:05	L	10	2.400	2.200	24.0 %
08/03/2022	13:10	M	10	5.700	5.500	57.0 %

Summary

Cal Gas Level	Reference	Mean	CEMS Mean	Specification	Results
L	2.400		2.200	Std	8.3
M	5.700		5.500	Std	3.5

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1	Unit CT1	Unit CT1
	PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr					
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/01/2022 00:00	3,584.5	0.0	3,584.5	104,100.0	373.1	0.45	0.2	0.7
07/01/2022 01:00	2,862.9	0.0	2,862.9	104,100.0	298.0	0.36	0.2	0.6
07/01/2022 02:00	2,873.9	0.0	2,873.9	104,100.0	299.2	0.36	0.2	0.6
07/01/2022 03:00	2,889.9	0.0	2,889.9	104,100.0	300.8	0.36	0.2	0.6
07/01/2022 04:00	2,901.4	0.0	2,901.4	104,100.0	302.0	0.36	0.2	0.6
07/01/2022 05:00	3,467.8	0.0	3,467.8	104,100.0	361.0	0.43	0.2	0.7
07/01/2022 06:00	2,870.1	0.0	2,870.1	104,100.0	298.8	0.36	0.2	0.6
07/01/2022 07:00	2,880.7	0.0	2,880.7	104,100.0	299.9	0.36	0.2	0.6
07/01/2022 08:00	2,872.8	0.0	2,872.8	104,100.0	299.1	0.36	0.2	0.6
07/01/2022 09:00	2,873.6	0.0	2,873.6	104,100.0	299.1	0.36	0.2	0.6
07/01/2022 10:00	2,879.9	0.0	2,879.9	104,100.0	299.8	0.36	0.2	0.6
07/01/2022 11:00	2,901.6	0.0	2,901.6	104,100.0	302.1	0.36	0.2	0.6
07/01/2022 12:00	2,909.5	0.0	2,909.5	104,100.0	302.9	0.36	0.2	0.6
07/01/2022 13:00	2,890.3	0.0	2,890.3	104,100.0	300.9	0.36	0.2	0.6
07/01/2022 14:00	2,881.2	0.0	2,881.2	104,100.0	299.9	0.36	0.2	0.6
07/01/2022 15:00	2,875.3	0.0	2,875.3	104,100.0	299.3	0.36	0.2	0.6
07/01/2022 16:00	3,319.5	8.2	3,320.2	104,100.0	345.6	0.42	0.2	0.7
07/01/2022 17:00	4,407.2	115.4	4,514.5	104,100.0	470.0	0.57	0.3	0.9
07/01/2022 18:00	4,372.0	167.3	4,450.6	104,100.0	463.3	0.57	0.3	0.9
07/01/2022 19:00	4,443.7	331.5	4,775.2	104,100.0	497.1	0.60	0.3	1.0
07/01/2022 20:00	4,472.3	263.4	4,735.7	104,100.0	493.0	0.59	0.3	1.0
07/01/2022 21:00	4,472.0	231.0	4,703.0	104,100.0	489.6	0.59	0.3	1.0
07/01/2022 22:00	4,155.3	102.9	4,208.8	104,100.0	438.1	0.53	0.3	0.9
07/01/2022 23:00	2,957.9	0.0	2,957.9	104,100.0	307.9	0.37	0.2	0.6
Average/Sum#:	3,334.0	50.8	3,378.4	104,100.0	351.7	0.42	0.2	0.7
Minimum:	2,862.9	0.0	2,862.9	104,100.0	298.0	0.36	0.2	0.6
Maximum:	4,472.3	331.5	4,775.2	104,100.0	497.1	0.60	0.3	1.0
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1	Unit CT1	Unit CT1
	PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr					
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/02/2022 00:00	2,850.0	0.0	2,850.0	104,100.0	296.7	0.36	0.2	0.6
07/02/2022 01:00	2,848.1	0.0	2,848.1	104,100.0	296.5	0.36	0.2	0.6
07/02/2022 02:00	2,859.0	0.0	2,859.0	104,100.0	297.6	0.36	0.2	0.6
07/02/2022 03:00	2,872.6	0.0	2,872.6	104,100.0	299.0	0.36	0.2	0.6
07/02/2022 04:00	2,871.7	0.0	2,871.7	104,100.0	298.9	0.36	0.2	0.6
07/02/2022 05:00	2,854.2	0.0	2,854.2	104,100.0	297.1	0.36	0.2	0.6
07/02/2022 06:00	2,852.4	0.0	2,852.4	104,100.0	296.9	0.36	0.2	0.6
07/02/2022 07:00	2,859.2	0.0	2,859.2	104,100.0	297.6	0.36	0.2	0.6
07/02/2022 08:00	2,860.3	0.0	2,860.3	104,100.0	297.8	0.36	0.2	0.6
07/02/2022 09:00	2,863.3	0.0	2,863.3	104,100.0	298.1	0.36	0.2	0.6
07/02/2022 10:00	2,865.4	0.0	2,865.4	104,100.0	298.3	0.36	0.2	0.6
07/02/2022 11:00	2,889.0	0.0	2,889.0	104,100.0	300.7	0.36	0.2	0.6
07/02/2022 12:00	2,892.1	0.0	2,892.1	104,100.0	301.1	0.36	0.2	0.6
07/02/2022 13:00	2,889.6	0.0	2,889.6	104,100.0	300.8	0.36	0.2	0.6
07/02/2022 14:00	2,889.8	0.0	2,889.8	104,100.0	300.8	0.36	0.2	0.6
07/02/2022 15:00	2,887.8	0.0	2,887.8	104,100.0	300.6	0.36	0.2	0.6
07/02/2022 16:00	2,891.3	0.0	2,891.3	104,100.0	301.0	0.36	0.2	0.6
07/02/2022 17:00	2,896.0	0.0	2,896.0	104,100.0	301.5	0.36	0.2	0.6
07/02/2022 18:00	2,933.2	0.0	2,933.2	104,100.0	305.3	0.37	0.2	0.6
07/02/2022 19:00	2,864.8	0.0	2,864.8	104,100.0	298.2	0.36	0.2	0.6
07/02/2022 20:00	2,857.5	0.0	2,857.5	104,100.0	297.5	0.36	0.2	0.6
07/02/2022 21:00	2,850.6	0.0	2,850.6	104,100.0	296.7	0.36	0.2	0.6
07/02/2022 22:00	2,858.9	0.0	2,858.9	104,100.0	297.6	0.36	0.2	0.6
07/02/2022 23:00	2,862.6	0.0	2,862.6	104,100.0	298.0	0.36	0.2	0.6
Average/Sum#:	2,871.6	0.0	2,871.6	104,100.0	298.9	0.36	0.2	0.6
Minimum:	2,848.1	0.0	2,848.1	104,100.0	296.5	0.36	0.2	0.6
Maximum:	2,933.2	0.0	2,933.2	104,100.0	305.3	0.37	0.2	0.6
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1	Unit CT1	Unit CT1
	PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr					
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/03/2022 00:00	2,865.7	0.0	2,865.7	104,100.0	298.3	0.36	0.2	0.6
07/03/2022 01:00	2,868.9	0.0	2,868.9	104,100.0	298.7	0.36	0.2	0.6
07/03/2022 02:00	2,883.5	0.0	2,883.5	104,100.0	300.2	0.36	0.2	0.6
07/03/2022 03:00	2,860.3	0.0	2,860.3	104,100.0	297.8	0.36	0.2	0.6
07/03/2022 04:00	2,850.7	0.0	2,850.7	104,100.0	296.8	0.36	0.2	0.6
07/03/2022 05:00	2,868.4	0.0	2,868.4	104,100.0	298.6	0.36	0.2	0.6
07/03/2022 06:00	2,878.0	0.0	2,878.0	104,100.0	299.6	0.36	0.2	0.6
07/03/2022 07:00	2,890.1	0.0	2,890.1	104,100.0	300.9	0.36	0.2	0.6
07/03/2022 08:00	2,881.3	0.0	2,881.3	104,100.0	299.9	0.36	0.2	0.6
07/03/2022 09:00	2,890.4	0.0	2,890.4	104,100.0	300.9	0.36	0.2	0.6
07/03/2022 10:00	2,894.3	0.0	2,894.3	104,100.0	301.3	0.36	0.2	0.6
07/03/2022 11:00	2,860.8	0.0	2,860.8	104,100.0	297.8	0.36	0.2	0.6
07/03/2022 12:00	2,867.9	0.0	2,867.9	104,100.0	298.5	0.36	0.2	0.6
07/03/2022 13:00	2,878.2	0.0	2,878.2	104,100.0	299.6	0.36	0.2	0.6
07/03/2022 14:00	2,873.5	0.0	2,873.5	104,100.0	299.1	0.36	0.2	0.6
07/03/2022 15:00	2,875.5	0.0	2,875.5	104,100.0	299.3	0.36	0.2	0.6
07/03/2022 16:00	2,875.6	0.0	2,875.6	104,100.0	299.3	0.36	0.2	0.6
07/03/2022 17:00	2,878.9	0.0	2,878.9	104,100.0	299.7	0.36	0.2	0.6
07/03/2022 18:00	2,868.2	0.0	2,868.2	104,100.0	298.6	0.36	0.2	0.6
07/03/2022 19:00	2,849.5	0.0	2,849.5	104,100.0	296.6	0.36	0.2	0.6
07/03/2022 20:00	2,844.6	0.0	2,844.6	104,100.0	296.1	0.36	0.2	0.6
07/03/2022 21:00	2,842.9	0.0	2,842.9	104,100.0	295.9	0.35	0.2	0.6
07/03/2022 22:00	2,839.4	0.0	2,839.4	104,100.0	295.6	0.36	0.2	0.6
07/03/2022 23:00	2,857.2	0.0	2,857.2	104,100.0	297.4	0.36	0.2	0.6
Average/Sum#:	2,868.5	0.0	2,868.5	104,100.0	298.6	0.36	0.2	0.6
Minimum:	2,839.4	0.0	2,839.4	104,100.0	295.6	0.35	0.2	0.6
Maximum:	2,894.3	0.0	2,894.3	104,100.0	301.3	0.36	0.2	0.6
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1	Unit CT1	Unit CT1
	PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr					
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/04/2022 00:00	2,861.7	0.0	2,861.7	104,100.0	297.9	0.36	0.2	0.6
07/04/2022 01:00	2,857.3	0.0	2,857.3	104,100.0	297.4	0.36	0.2	0.6
07/04/2022 02:00	2,836.4	0.0	2,836.4	104,100.0	295.3	0.35	0.2	0.6
07/04/2022 03:00	2,851.8	0.0	2,851.8	104,100.0	296.9	0.36	0.2	0.6
07/04/2022 04:00	2,871.6	0.0	2,871.6	104,100.0	298.9	0.36	0.2	0.6
07/04/2022 05:00	2,851.4	0.0	2,851.4	104,100.0	296.8	0.36	0.2	0.6
07/04/2022 06:00	2,844.9	0.0	2,844.9	104,100.0	296.2	0.36	0.2	0.6
07/04/2022 07:00	2,852.3	0.0	2,852.3	104,100.0	296.9	0.36	0.2	0.6
07/04/2022 08:00	2,860.7	0.0	2,860.7	104,100.0	297.8	0.36	0.2	0.6
07/04/2022 09:00	2,868.9	0.0	2,868.9	104,100.0	298.7	0.36	0.2	0.6
07/04/2022 10:00	2,882.6	0.0	2,882.6	104,100.0	300.1	0.36	0.2	0.6
07/04/2022 11:00	2,893.8	0.0	2,893.8	104,100.0	301.2	0.36	0.2	0.6
07/04/2022 12:00	2,875.5	0.0	2,875.5	104,100.0	299.3	0.36	0.2	0.6
07/04/2022 13:00	2,877.0	0.0	2,877.0	104,100.0	299.5	0.36	0.2	0.6
07/04/2022 14:00	2,878.7	0.0	2,878.7	104,100.0	299.7	0.36	0.2	0.6
07/04/2022 15:00	2,875.6	0.0	2,875.6	104,100.0	299.3	0.36	0.2	0.6
07/04/2022 16:00	2,870.8	0.0	2,870.8	104,100.0	298.9	0.36	0.2	0.6
07/04/2022 17:00	2,862.3	0.0	2,862.3	104,100.0	298.0	0.36	0.2	0.6
07/04/2022 18:00	2,855.2	0.0	2,855.2	104,100.0	297.2	0.36	0.2	0.6
07/04/2022 19:00	2,850.6	0.0	2,850.6	104,100.0	296.7	0.36	0.2	0.6
07/04/2022 20:00	2,850.7	0.0	2,850.7	104,100.0	296.8	0.36	0.2	0.6
07/04/2022 21:00	2,849.5	0.0	2,849.5	104,100.0	296.6	0.36	0.2	0.6
07/04/2022 22:00	2,849.9	0.0	2,849.9	104,100.0	296.7	0.36	0.2	0.6
07/04/2022 23:00	2,859.2	0.0	2,859.2	104,100.0	297.6	0.36	0.2	0.6
Average/Sum#:	2,862.0	0.0	2,862.0	104,100.0	297.9	0.36	0.2	0.6
Minimum:	2,836.4	0.0	2,836.4	104,100.0	295.3	0.35	0.2	0.6
Maximum:	2,893.8	0.0	2,893.8	104,100.0	301.2	0.36	0.2	0.6
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1	Unit CT1	Unit CT1
	PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr					
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/05/2022 00:00	2,876.5	0.0	2,876.5	104,100.0	299.4	0.36	0.2	0.6
07/05/2022 01:00	2,876.2	0.0	2,876.2	104,100.0	299.4	0.36	0.2	0.6
07/05/2022 02:00	2,870.8	0.0	2,870.8	104,100.0	298.9	0.36	0.2	0.6
07/05/2022 03:00	2,867.7	0.0	2,867.7	104,100.0	298.5	0.36	0.2	0.6
07/05/2022 04:00	2,860.3	0.0	2,860.3	104,100.0	297.8	0.36	0.2	0.6
07/05/2022 05:00	2,860.1	0.0	2,860.1	104,100.0	297.7	0.36	0.2	0.6
07/05/2022 06:00	2,865.8	0.0	2,865.8	104,100.0	298.3	0.36	0.2	0.6
07/05/2022 07:00	2,865.4	0.0	2,865.4	104,100.0	298.3	0.36	0.2	0.6
07/05/2022 08:00	2,871.4	0.0	2,871.4	104,100.0	298.9	0.36	0.2	0.6
07/05/2022 09:00	2,870.9	0.0	2,870.9	104,100.0	298.9	0.36	0.2	0.6
07/05/2022 10:00	2,874.2	0.0	2,874.2	104,100.0	299.2	0.36	0.2	0.6
07/05/2022 11:00	2,890.2	0.0	2,890.2	104,100.0	300.9	0.36	0.2	0.6
07/05/2022 12:00	2,989.4	0.0	2,989.4	104,100.0	311.2	0.37	0.2	0.6
07/05/2022 13:00	2,865.6	0.0	2,865.6	104,100.0	298.3	0.36	0.2	0.6
07/05/2022 14:00	3,257.7	0.0	3,257.7	104,100.0	339.1	0.41	0.2	0.7
07/05/2022 15:00	3,719.6	0.0	3,719.6	104,100.0	387.2	0.46	0.2	0.8
07/05/2022 16:00	4,239.3	256.6	4,413.8	104,100.0	459.5	0.56	0.3	0.9
07/05/2022 17:00	4,405.3	416.9	4,822.2	104,100.0	502.0	0.60	0.3	1.0
07/05/2022 18:00	4,407.1	374.0	4,781.1	104,100.0	497.7	0.60	0.3	1.0
07/05/2022 19:00	4,419.7	333.2	4,752.9	104,100.0	494.8	0.59	0.3	1.0
07/05/2022 20:00	4,436.9	304.2	4,741.1	104,100.0	493.5	0.59	0.3	1.0
07/05/2022 21:00	3,634.9	64.1	3,652.2	104,100.0	380.2	0.46	0.2	0.8
07/05/2022 22:00	3,507.1	0.0	3,507.1	104,100.0	365.1	0.44	0.2	0.7
07/05/2022 23:00	3,288.8	0.0	3,288.8	104,100.0	342.4	0.41	0.2	0.7
Average/Sum#:	3,317.5	72.9	3,385.0	104,100.0	352.4	0.42	0.2	0.7
Minimum:	2,860.1	0.0	2,860.1	104,100.0	297.7	0.36	0.2	0.6
Maximum:	4,436.9	416.9	4,822.2	104,100.0	502.0	0.60	0.3	1.0
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1	Unit CT1	Unit CT1
	PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr					
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/06/2022 00:00	2,864.9	0.0	2,864.9	104,100.0	298.2	0.36	0.2	0.6
07/06/2022 01:00	2,859.6	0.0	2,859.6	104,100.0	297.7	0.36	0.2	0.6
07/06/2022 02:00	2,858.9	0.0	2,858.9	104,100.0	297.6	0.36	0.2	0.6
07/06/2022 03:00	2,861.1	0.0	2,861.1	104,100.0	297.8	0.36	0.2	0.6
07/06/2022 04:00	2,859.0	0.0	2,859.0	104,100.0	297.6	0.36	0.2	0.6
07/06/2022 05:00	2,863.8	0.0	2,863.8	104,100.0	298.1	0.36	0.2	0.6
07/06/2022 06:00	2,861.4	0.0	2,861.4	104,100.0	297.9	0.36	0.2	0.6
07/06/2022 07:00	2,875.0	0.0	2,875.0	104,100.0	299.3	0.36	0.2	0.6
07/06/2022 08:00	2,872.6	0.0	2,872.6	104,100.0	299.0	0.36	0.2	0.6
07/06/2022 09:00	2,874.9	0.0	2,874.9	104,100.0	299.3	0.36	0.2	0.6
07/06/2022 10:00	2,875.5	0.0	2,875.5	104,100.0	299.3	0.36	0.2	0.6
07/06/2022 11:00	2,869.6	0.0	2,869.6	104,100.0	298.7	0.36	0.2	0.6
07/06/2022 12:00	2,877.9	0.0	2,877.9	104,100.0	299.6	0.36	0.2	0.6
07/06/2022 13:00	2,888.6	0.0	2,888.6	104,100.0	300.7	0.36	0.2	0.6
07/06/2022 14:00	2,891.7	0.0	2,891.7	104,100.0	301.0	0.36	0.2	0.6
07/06/2022 15:00	2,887.6	0.0	2,887.6	104,100.0	300.6	0.36	0.2	0.6
07/06/2022 16:00	3,313.0	0.0	3,313.0	104,100.0	344.9	0.41	0.2	0.7
07/06/2022 17:00	3,056.7	0.0	3,056.7	104,100.0	318.2	0.38	0.2	0.6
07/06/2022 18:00	4,281.2	150.1	4,351.7	104,100.0	453.0	0.55	0.3	0.9
07/06/2022 19:00	4,444.8	269.2	4,714.0	104,100.0	490.7	0.59	0.3	1.0
07/06/2022 20:00	4,458.6	218.7	4,677.3	104,100.0	486.9	0.58	0.3	1.0
07/06/2022 21:00	4,020.0	101.8	4,072.9	104,100.0	424.0	0.51	0.3	0.9
07/06/2022 22:00	3,120.0	0.0	3,120.0	104,100.0	324.8	0.39	0.2	0.6
07/06/2022 23:00	2,857.6	0.0	2,857.6	104,100.0	297.5	0.36	0.2	0.6
Average/Sum#:	3,145.6	30.8	3,171.1	104,100.0	330.1	0.40	0.2	0.7
Minimum:	2,857.6	0.0	2,857.6	104,100.0	297.5	0.36	0.2	0.6
Maximum:	4,458.6	269.2	4,714.0	104,100.0	490.7	0.59	0.3	1.0
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1	Unit CT1	Unit CT1
	PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr					
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/07/2022 00:00	2,858.9	0.0	2,858.9	104,100.0	297.6	0.36	0.2	0.6
07/07/2022 01:00	2,854.1	0.0	2,854.1	104,100.0	297.1	0.36	0.2	0.6
07/07/2022 02:00	2,855.9	0.0	2,855.9	104,100.0	297.3	0.36	0.2	0.6
07/07/2022 03:00	2,855.2	0.0	2,855.2	104,100.0	297.2	0.36	0.2	0.6
07/07/2022 04:00	2,865.2	0.0	2,865.2	104,100.0	298.3	0.36	0.2	0.6
07/07/2022 05:00	2,859.6	0.0	2,859.6	104,100.0	297.7	0.36	0.2	0.6
07/07/2022 06:00	2,863.1	0.0	2,863.1	104,100.0	298.0	0.36	0.2	0.6
07/07/2022 07:00	2,873.6	0.0	2,873.6	104,100.0	299.1	0.36	0.2	0.6
07/07/2022 08:00	2,870.0	0.0	2,870.0	104,100.0	298.8	0.36	0.2	0.6
07/07/2022 09:00	2,879.0	0.0	2,879.0	104,100.0	299.7	0.36	0.2	0.6
07/07/2022 10:00	2,888.0	0.0	2,888.0	104,100.0	300.6	0.36	0.2	0.6
07/07/2022 11:00	2,891.2	0.0	2,891.2	104,100.0	301.0	0.36	0.2	0.6
07/07/2022 12:00	2,882.1	0.0	2,882.1	104,100.0	300.0	0.36	0.2	0.6
07/07/2022 13:00	2,881.0	0.0	2,881.0	104,100.0	299.9	0.36	0.2	0.6
07/07/2022 14:00	4,132.6	0.0	4,132.6	104,100.0	430.2	0.52	0.3	0.9
07/07/2022 15:00	3,325.2	0.0	3,325.2	104,100.0	346.2	0.42	0.2	0.7
07/07/2022 16:00	4,326.1	248.0	4,494.7	104,100.0	467.9	0.57	0.3	1.0
07/07/2022 17:00	4,429.7	499.6	4,929.3	104,100.0	513.1	0.62	0.3	1.0
07/07/2022 18:00	4,413.6	703.3	5,116.9	104,100.0	532.7	0.64	0.3	1.1
07/07/2022 19:00	4,425.6	320.2	4,745.8	104,100.0	494.0	0.59	0.3	1.0
07/07/2022 20:00	4,440.6	273.4	4,714.0	104,100.0	490.7	0.59	0.3	1.0
07/07/2022 21:00	4,447.1	272.2	4,719.3	104,100.0	491.3	0.59	0.3	1.0
07/07/2022 22:00	4,417.5	127.0	4,483.5	104,100.0	466.7	0.57	0.3	0.9
07/07/2022 23:00	3,278.5	0.0	3,278.5	104,100.0	341.3	0.41	0.2	0.7
Average/Sum#:	3,408.9	101.8	3,504.9	104,100.0	364.9	0.44	0.2	0.7
Minimum:	2,854.1	0.0	2,854.1	104,100.0	297.1	0.36	0.2	0.6
Maximum:	4,447.1	703.3	5,116.9	104,100.0	532.7	0.64	0.3	1.1
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1	Unit CT1	Unit CT1
	PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr					
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/08/2022 00:00	2,876.1	0.0	2,876.1	104,100.0	299.4	0.36	0.2	0.6
07/08/2022 01:00	2,861.0	0.0	2,861.0	104,100.0	297.8	0.36	0.2	0.6
07/08/2022 02:00	2,861.6	0.0	2,861.6	104,100.0	297.9	0.36	0.2	0.6
07/08/2022 03:00	2,861.2	0.0	2,861.2	104,100.0	297.9	0.36	0.2	0.6
07/08/2022 04:00	3,891.4	0.0	3,891.4	104,100.0	405.1	0.49	0.2	0.8
07/08/2022 05:00	3,328.7	0.0	3,328.7	104,100.0	346.5	0.42	0.2	0.7
07/08/2022 06:00	2,867.7	0.0	2,867.7	104,100.0	298.5	0.36	0.2	0.6
07/08/2022 07:00	2,870.9	0.0	2,870.9	104,100.0	298.9	0.36	0.2	0.6
07/08/2022 08:00	2,853.3	0.0	2,853.3	104,100.0	297.0	0.36	0.2	0.6
07/08/2022 09:00	2,853.9	0.0	2,853.9	104,100.0	297.1	0.36	0.2	0.6
07/08/2022 10:00	2,858.8	0.0	2,858.8	104,100.0	297.6	0.36	0.2	0.6
07/08/2022 11:00	2,875.1	0.0	2,875.1	104,100.0	299.3	0.36	0.2	0.6
07/08/2022 12:00	2,880.0	0.0	2,880.0	104,100.0	299.8	0.36	0.2	0.6
07/08/2022 13:00	3,314.3	0.0	3,314.3	104,100.0	345.0	0.41	0.2	0.7
07/08/2022 14:00	3,493.5	0.0	3,493.5	104,100.0	363.7	0.44	0.2	0.7
07/08/2022 15:00	4,004.7	209.8	4,105.4	104,100.0	427.4	0.53	0.3	0.9
07/08/2022 16:00	3,611.1	162.2	3,671.1	104,100.0	382.2	0.47	0.2	0.8
07/08/2022 17:00	2,961.5	0.0	2,961.5	104,100.0	308.3	0.37	0.2	0.6
07/08/2022 18:00	3,609.6	0.0	3,609.6	104,100.0	375.8	0.45	0.2	0.8
07/08/2022 19:00	3,855.2	0.0	3,855.2	104,100.0	401.3	0.48	0.2	0.8
07/08/2022 20:00	4,439.7	142.2	4,579.1	104,100.0	476.7	0.57	0.3	1.0
07/08/2022 21:00	4,455.4	128.6	4,584.0	104,100.0	477.2	0.57	0.3	1.0
07/08/2022 22:00	4,467.8	127.9	4,595.7	104,100.0	478.4	0.57	0.3	1.0
07/08/2022 23:00	4,485.8	130.2	4,616.0	104,100.0	480.5	0.58	0.3	1.0
Average/Sum#:	3,393.3	37.5	3,421.9	104,100.0	356.2	0.43	0.2	0.7
Minimum:	2,853.3	0.0	2,853.3	104,100.0	297.0	0.36	0.2	0.6
Maximum:	4,485.8	209.8	4,616.0	104,100.0	480.5	0.58	0.3	1.0
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1	Unit CT1	Unit CT1
	PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr					
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/09/2022 00:00	4,483.9	128.6	4,612.5	104,100.0	480.2	0.58	0.3	1.0
07/09/2022 01:00	3,155.9	2.0	3,155.9	104,100.0	328.5	0.39	0.2	0.7
07/09/2022 02:00	2,865.7	0.0	2,865.7	104,100.0	298.3	0.36	0.2	0.6
07/09/2022 03:00	2,871.6	0.0	2,871.6	104,100.0	298.9	0.36	0.2	0.6
07/09/2022 04:00	3,074.9	0.0	3,074.9	104,100.0	320.1	0.38	0.2	0.6
07/09/2022 05:00	2,862.7	0.0	2,862.7	104,100.0	298.0	0.36	0.2	0.6
07/09/2022 06:00	2,864.3	0.0	2,864.3	104,100.0	298.2	0.36	0.2	0.6
07/09/2022 07:00	2,875.3	0.0	2,875.3	104,100.0	299.3	0.36	0.2	0.6
07/09/2022 08:00	2,873.0	0.0	2,873.0	104,100.0	299.1	0.36	0.2	0.6
07/09/2022 09:00	2,874.6	0.0	2,874.6	104,100.0	299.2	0.36	0.2	0.6
07/09/2022 10:00	2,884.7	0.0	2,884.7	104,100.0	300.3	0.36	0.2	0.6
07/09/2022 11:00	2,895.3	0.0	2,895.3	104,100.0	301.4	0.36	0.2	0.6
07/09/2022 12:00	2,886.2	0.0	2,886.2	104,100.0	300.5	0.36	0.2	0.6
07/09/2022 13:00	2,899.8	0.0	2,899.8	104,100.0	301.9	0.36	0.2	0.6
07/09/2022 14:00	2,880.3	0.0	2,880.3	104,100.0	299.8	0.36	0.2	0.6
07/09/2022 15:00	2,873.1	0.0	2,873.1	104,100.0	299.1	0.36	0.2	0.6
07/09/2022 16:00	3,335.6	0.0	3,335.6	104,100.0	347.2	0.42	0.2	0.7
07/09/2022 17:00	2,863.5	0.0	2,863.5	104,100.0	298.1	0.36	0.2	0.6
07/09/2022 18:00	2,854.1	0.0	2,854.1	104,100.0	297.1	0.36	0.2	0.6
07/09/2022 19:00	2,860.4	0.0	2,860.4	104,100.0	297.8	0.36	0.2	0.6
07/09/2022 20:00	2,853.0	0.0	2,853.0	104,100.0	297.0	0.36	0.2	0.6
07/09/2022 21:00	2,851.4	0.0	2,851.4	104,100.0	296.8	0.36	0.2	0.6
07/09/2022 22:00	2,847.4	0.0	2,847.4	104,100.0	296.4	0.36	0.2	0.6
07/09/2022 23:00	2,848.8	0.0	2,848.8	104,100.0	296.6	0.36	0.2	0.6
Average/Sum#:	2,976.5	5.4	2,981.8	104,100.0	310.4	0.37	0.2	0.6
Minimum:	2,847.4	0.0	2,847.4	104,100.0	296.4	0.36	0.2	0.6
Maximum:	4,483.9	128.6	4,612.5	104,100.0	480.2	0.58	0.3	1.0
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1	Unit CT1	Unit CT1
	PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr					
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/10/2022 00:00	2,867.6	0.0	2,867.6	104,100.0	298.5	0.36	0.2	0.6
07/10/2022 01:00	2,869.2	0.0	2,869.2	104,100.0	298.7	0.36	0.2	0.6
07/10/2022 02:00	2,864.6	0.0	2,864.6	104,100.0	298.2	0.36	0.2	0.6
07/10/2022 03:00	2,864.3	0.0	2,864.3	104,100.0	298.2	0.36	0.2	0.6
07/10/2022 04:00	2,863.6	0.0	2,863.6	104,100.0	298.1	0.36	0.2	0.6
07/10/2022 05:00	2,862.2	0.0	2,862.2	104,100.0	298.0	0.36	0.2	0.6
07/10/2022 06:00	2,864.7	0.0	2,864.7	104,100.0	298.2	0.36	0.2	0.6
07/10/2022 07:00	2,883.4	0.0	2,883.4	104,100.0	300.2	0.36	0.2	0.6
07/10/2022 08:00	2,874.8	0.0	2,874.8	104,100.0	299.3	0.36	0.2	0.6
07/10/2022 09:00	2,851.6	0.0	2,851.6	104,100.0	296.9	0.36	0.2	0.6
07/10/2022 10:00	2,880.1	0.0	2,880.1	104,100.0	299.8	0.36	0.2	0.6
07/10/2022 11:00	2,886.1	0.0	2,886.1	104,100.0	300.4	0.36	0.2	0.6
07/10/2022 12:00	2,883.2	0.0	2,883.2	104,100.0	300.1	0.36	0.2	0.6
07/10/2022 13:00	2,890.4	0.0	2,890.4	104,100.0	300.9	0.36	0.2	0.6
07/10/2022 14:00	3,312.7	0.0	3,312.7	104,100.0	344.9	0.41	0.2	0.7
07/10/2022 15:00	3,541.8	0.0	3,541.8	104,100.0	368.7	0.44	0.2	0.7
07/10/2022 16:00	3,783.7	39.1	3,796.2	104,100.0	395.2	0.48	0.2	0.8
07/10/2022 17:00	4,171.4	0.0	4,171.4	104,100.0	434.2	0.52	0.3	0.9
07/10/2022 18:00	4,367.3	0.0	4,367.3	104,100.0	454.6	0.55	0.3	0.9
07/10/2022 19:00	4,356.8	0.0	4,356.8	104,100.0	453.5	0.55	0.3	0.9
07/10/2022 20:00	4,333.5	0.0	4,333.5	104,100.0	451.1	0.54	0.3	0.9
07/10/2022 21:00	4,069.2	0.0	4,069.2	104,100.0	423.6	0.51	0.3	0.8
07/10/2022 22:00	4,133.0	0.0	4,133.0	104,100.0	430.2	0.52	0.3	0.9
07/10/2022 23:00	4,331.8	0.0	4,331.8	104,100.0	450.9	0.54	0.3	0.9
Average/Sum#:	3,358.6	1.6	3,359.1	104,100.0	349.7	0.42	0.2	0.7
Minimum:	2,851.6	0.0	2,851.6	104,100.0	296.9	0.36	0.2	0.6
Maximum:	4,367.3	39.1	4,367.3	104,100.0	454.6	0.55	0.3	0.9
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 **To:** 09/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/11/2022 00:00	4,330.4	0.0	4,330.4	104,100.0	450.8	0.54	0.3	0.9
07/11/2022 01:00	4,336.9	0.0	4,336.9	104,100.0	451.5	0.54	0.3	0.9
07/11/2022 02:00	4,337.2	0.0	4,337.2	104,100.0	451.5	0.54	0.3	0.9
07/11/2022 03:00	4,329.3	0.0	4,329.3	104,100.0	450.7	0.54	0.3	0.9
07/11/2022 04:00	4,290.3	0.0	4,290.3	104,100.0	446.6	0.54	0.3	0.9
07/11/2022 05:00	3,785.7	0.0	3,785.7	104,100.0	394.1	0.47	0.2	0.8
07/11/2022 06:00	2,718.8	0.0	2,718.8	104,100.0	283.0	0.34	0.2	0.6
07/11/2022 07:00	2,661.1	0.0	2,661.1	104,100.0	277.0	0.33	0.2	0.6
07/11/2022 08:00	2,654.5	0.0	2,654.5	104,100.0	276.3	0.33	0.2	0.6
07/11/2022 09:00	2,664.7	0.0	2,664.7	104,100.0	277.4	0.33	0.2	0.6
07/11/2022 10:00	2,744.4	0.0	2,744.4	104,100.0	285.7	0.34	0.2	0.6
07/11/2022 11:00	3,173.9	0.0	3,173.9	104,100.0	330.4	0.40	0.2	0.7
07/11/2022 12:00	4,333.8	476.4	4,762.6	104,100.0	495.8	0.60	0.3	1.0
07/11/2022 13:00	4,314.9	784.3	5,099.2	104,100.0	530.8	0.64	0.3	1.1
07/11/2022 14:00	4,314.2	804.3	5,118.5	104,100.0	532.8	0.64	0.3	1.1
07/11/2022 15:00	4,299.1	852.4	5,151.5	104,100.0	536.3	0.64	0.3	1.1
07/11/2022 16:00	4,302.2	798.1	5,100.3	104,100.0	530.9	0.64	0.3	1.1
07/11/2022 17:00	4,298.5	802.8	5,101.3	104,100.0	531.0	0.64	0.3	1.1
07/11/2022 18:00	4,318.3	861.7	5,180.0	104,100.0	539.2	0.65	0.3	1.1
07/11/2022 19:00	4,340.4	802.6	5,143.0	104,100.0	535.4	0.64	0.3	1.1
07/11/2022 20:00	4,336.9	670.1	5,007.0	104,100.0	521.2	0.63	0.3	1.0
07/11/2022 21:00	4,344.7	475.6	4,820.3	104,100.0	501.8	0.60	0.3	1.0
07/11/2022 22:00	4,356.2	519.7	4,875.9	104,100.0	507.6	0.61	0.3	1.0
07/11/2022 23:00	4,361.7	430.9	4,792.6	104,100.0	498.9	0.60	0.3	1.0
Average/Sum#:	3,914.5	345.0	4,257.5	104,100.0	443.2	0.53	0.3	0.9
Minimum:	2,654.5	0.0	2,654.5	104,100.0	276.3	0.33	0.2	0.6
Maximum:	4,361.7	861.7	5,180.0	104,100.0	539.2	0.65	0.3	1.1
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/12/2022 00:00	4,398.8	482.3	4,881.1	104,100.0	508.1	0.61	0.3	1.0
07/12/2022 01:00	4,400.2	447.9	4,848.1	104,100.0	504.7	0.60	0.3	1.0
07/12/2022 02:00	4,416.4	351.1	4,767.5	104,100.0	496.3	0.59	0.3	1.0
07/12/2022 03:00	4,419.9	411.6	4,831.5	104,100.0	503.0	0.60	0.3	1.0
07/12/2022 04:00	4,427.8	543.7	4,971.5	104,100.0	517.5	0.62	0.3	1.0
07/12/2022 05:00	4,399.0	280.7	4,615.1	104,100.0	480.4	0.59	0.3	1.0
07/12/2022 06:00	3,145.9	0.0	3,145.9	104,100.0	327.5	0.39	0.2	0.7
07/12/2022 07:00	2,679.5	0.0	2,679.5	104,100.0	278.9	0.33	0.2	0.6
07/12/2022 08:00	2,652.7	0.0	2,652.7	104,100.0	276.1	0.33	0.2	0.6
07/12/2022 09:00	2,654.5	0.0	2,654.5	104,100.0	276.3	0.33	0.2	0.6
07/12/2022 10:00	2,718.2	0.0	2,718.2	104,100.0	283.0	0.34	0.2	0.6
07/12/2022 11:00	2,799.0	0.0	2,799.0	104,100.0	291.4	0.35	0.2	0.6
07/12/2022 12:00	2,980.7	0.0	2,980.7	104,100.0	310.3	0.37	0.2	0.6
07/12/2022 13:00	3,818.0	164.1	3,883.6	104,100.0	404.3	0.50	0.2	0.8
07/12/2022 14:00	4,340.9	718.0	5,058.9	104,100.0	526.6	0.63	0.3	1.1
07/12/2022 15:00	4,337.2	555.1	4,892.3	104,100.0	509.3	0.61	0.3	1.0
07/12/2022 16:00	4,332.5	613.4	4,945.9	104,100.0	514.9	0.62	0.3	1.0
07/12/2022 17:00	4,337.6	768.9	5,106.5	104,100.0	531.6	0.64	0.3	1.1
07/12/2022 18:00	4,338.8	593.1	4,931.9	104,100.0	513.4	0.62	0.3	1.0
07/12/2022 19:00	4,345.1	352.6	4,616.6	104,100.0	480.6	0.59	0.3	1.0
07/12/2022 20:00	4,299.2	82.8	4,317.4	104,100.0	449.4	0.55	0.3	0.9
07/12/2022 21:00	4,381.7	557.1	4,938.8	104,100.0	514.1	0.62	0.3	1.0
07/12/2022 22:00	3,829.9	1.8	3,829.9	104,100.0	398.7	0.48	0.2	0.8
07/12/2022 23:00	4,379.3	0.0	4,379.3	104,100.0	455.9	0.55	0.3	0.9
Average/Sum#:	3,868.0	288.5	4,143.6	104,100.0	431.3	0.52	0.3	0.9
Minimum:	2,652.7	0.0	2,652.7	104,100.0	276.1	0.33	0.2	0.6
Maximum:	4,427.8	768.9	5,106.5	104,100.0	531.6	0.64	0.3	1.1
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/13/2022 00:00	4,386.9	0.0	4,386.9	104,100.0	456.7	0.55	0.3	0.9
07/13/2022 01:00	4,389.8	0.0	4,389.8	104,100.0	457.0	0.55	0.3	0.9
07/13/2022 02:00	4,385.9	0.0	4,385.9	104,100.0	456.6	0.55	0.3	0.9
07/13/2022 03:00	4,411.4	45.8	4,421.5	104,100.0	460.3	0.56	0.3	0.9
07/13/2022 04:00	4,458.2	922.6	5,380.8	104,100.0	560.1	0.67	0.3	1.1
07/13/2022 05:00	4,465.0	617.7	5,020.9	104,100.0	522.7	0.64	0.3	1.1
07/13/2022 06:00	4,213.9	89.3	4,260.3	104,100.0	443.5	0.54	0.3	0.9
07/13/2022 07:00	2,706.9	0.0	2,706.9	104,100.0	281.8	0.34	0.2	0.6
07/13/2022 08:00	2,698.6	0.0	2,698.6	104,100.0	280.9	0.34	0.2	0.6
07/13/2022 09:00	2,662.6	0.0	2,662.6	104,100.0	277.2	0.33	0.2	0.6
07/13/2022 10:00	2,663.3	0.0	2,663.3	104,100.0	277.2	0.33	0.2	0.6
07/13/2022 11:00	2,670.7	0.0	2,670.7	104,100.0	278.0	0.33	0.2	0.6
07/13/2022 12:00	2,678.7	0.0	2,678.7	104,100.0	278.9	0.33	0.2	0.6
07/13/2022 13:00	2,681.7	0.0	2,681.7	104,100.0	279.2	0.33	0.2	0.6
07/13/2022 14:00	2,896.8	0.0	2,896.8	104,100.0	301.6	0.36	0.2	0.6
07/13/2022 15:00	4,392.8	343.3	4,660.6	104,100.0	485.2	0.59	0.3	1.0
07/13/2022 16:00	4,402.9	446.9	4,849.8	104,100.0	504.9	0.61	0.3	1.0
07/13/2022 17:00	3,516.2	2.1	3,516.2	104,100.0	366.0	0.44	0.2	0.7
07/13/2022 18:00	4,395.5	315.4	4,622.6	104,100.0	481.2	0.59	0.3	1.0
07/13/2022 19:00	4,410.0	434.6	4,844.6	104,100.0	504.3	0.60	0.3	1.0
07/13/2022 20:00	4,419.8	701.9	5,121.7	104,100.0	533.2	0.64	0.3	1.1
07/13/2022 21:00	4,430.5	454.4	4,884.9	104,100.0	508.5	0.61	0.3	1.0
07/13/2022 22:00	4,424.6	304.6	4,729.2	104,100.0	492.3	0.59	0.3	1.0
07/13/2022 23:00	3,603.7	1.6	3,603.7	104,100.0	375.1	0.45	0.2	0.8
Average/Sum#:	3,765.3	195.0	3,947.4	104,100.0	410.9	0.49	0.3	0.8
Minimum:	2,662.6	0.0	2,662.6	104,100.0	277.2	0.33	0.2	0.6
Maximum:	4,465.0	922.6	5,380.8	104,100.0	560.1	0.67	0.3	1.1
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1	Unit CT1	Unit CT1
						PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/14/2022 00:00	3,949.8	1.0	3,949.8	104,100.0	411.2	0.49	0.2	0.8
07/14/2022 01:00	3,502.8	0.0	3,502.8	104,100.0	364.6	0.44	0.2	0.7
07/14/2022 02:00	3,255.2	0.0	3,255.2	104,100.0	338.9	0.41	0.2	0.7
07/14/2022 03:00	3,498.7	1.6	3,498.7	104,100.0	364.2	0.44	0.2	0.7
07/14/2022 04:00	3,981.1	1.3	3,981.1	104,100.0	414.4	0.50	0.2	0.8
07/14/2022 05:00	4,131.3	0.0	4,131.3	104,100.0	430.1	0.52	0.3	0.9
07/14/2022 06:00	3,470.0	3.4	3,470.1	104,100.0	361.2	0.43	0.2	0.7
07/14/2022 07:00	3,198.3	0.0	3,198.3	104,100.0	332.9	0.40	0.2	0.7
07/14/2022 08:00	2,858.3	0.0	2,858.3	104,100.0	297.5	0.36	0.2	0.6
07/14/2022 09:00	2,861.3	0.0	2,861.3	104,100.0	297.9	0.36	0.2	0.6
07/14/2022 10:00	2,867.7	0.0	2,867.7	104,100.0	298.5	0.36	0.2	0.6
07/14/2022 11:00	2,872.0	0.0	2,872.0	104,100.0	299.0	0.36	0.2	0.6
07/14/2022 12:00	3,283.6	0.0	3,283.6	104,100.0	341.8	0.41	0.2	0.7
07/14/2022 13:00	3,403.3	0.0	3,403.3	104,100.0	354.3	0.42	0.2	0.7
07/14/2022 14:00	4,080.8	394.1	4,297.6	104,100.0	447.4	0.56	0.3	0.9
07/14/2022 15:00	4,344.4	648.6	4,993.0	104,100.0	519.8	0.62	0.3	1.0
07/14/2022 16:00	4,345.3	601.8	4,947.1	104,100.0	515.0	0.62	0.3	1.0
07/14/2022 17:00	4,340.4	753.5	5,093.9	104,100.0	530.3	0.64	0.3	1.1
07/14/2022 18:00	4,350.3	757.0	5,107.3	104,100.0	531.7	0.64	0.3	1.1
07/14/2022 19:00	4,377.9	487.1	4,865.0	104,100.0	506.4	0.61	0.3	1.0
07/14/2022 20:00	4,405.0	435.0	4,840.0	104,100.0	503.8	0.60	0.3	1.0
07/14/2022 21:00	4,425.2	372.8	4,798.0	104,100.0	499.5	0.60	0.3	1.0
07/14/2022 22:00	4,453.8	266.3	4,720.1	104,100.0	491.4	0.59	0.3	1.0
07/14/2022 23:00	4,461.8	258.6	4,720.4	104,100.0	491.4	0.59	0.3	1.0
Average/Sum#:	3,779.9	207.6	3,979.8	104,100.0	414.3	0.50	0.2	0.8
Minimum:	2,858.3	0.0	2,858.3	104,100.0	297.5	0.36	0.2	0.6
Maximum:	4,461.8	757.0	5,107.3	104,100.0	531.7	0.64	0.3	1.1
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1	Unit CT1	Unit CT1
						PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/15/2022 00:00	3,933.4	7.0	3,933.9	104,100.0	409.5	0.49	0.2	0.8
07/15/2022 01:00	4,428.7	55.7	4,441.0	104,100.0	462.3	0.56	0.3	0.9
07/15/2022 02:00	4,485.8	450.8	4,936.6	104,100.0	513.9	0.62	0.3	1.0
07/15/2022 03:00	4,488.7	170.6	4,659.3	104,100.0	485.0	0.58	0.3	1.0
07/15/2022 04:00	4,498.7	160.8	4,659.5	104,100.0	485.1	0.58	0.3	1.0
07/15/2022 05:00	4,503.4	331.8	4,835.2	104,100.0	503.3	0.60	0.3	1.0
07/15/2022 06:00	3,656.4	40.7	3,667.4	104,100.0	381.8	0.46	0.2	0.8
07/15/2022 07:00	2,681.3	0.0	2,681.3	104,100.0	279.1	0.34	0.2	0.6
07/15/2022 08:00	2,675.1	0.0	2,675.1	104,100.0	278.5	0.33	0.2	0.6
07/15/2022 09:00	2,676.8	0.0	2,676.8	104,100.0	278.7	0.33	0.2	0.6
07/15/2022 10:00	2,734.3	0.0	2,734.3	104,100.0	284.6	0.34	0.2	0.6
07/15/2022 11:00	2,783.5	0.0	2,783.5	104,100.0	289.8	0.35	0.2	0.6
07/15/2022 12:00	2,815.0	0.0	2,815.0	104,100.0	293.0	0.35	0.2	0.6
07/15/2022 13:00	3,626.3	24.9	3,629.5	104,100.0	377.8	0.46	0.2	0.8
07/15/2022 14:00	4,373.0	577.5	4,950.5	104,100.0	515.3	0.62	0.3	1.0
07/15/2022 15:00	4,359.7	585.2	4,944.9	104,100.0	514.8	0.62	0.3	1.0
07/15/2022 16:00	4,380.2	501.5	4,881.7	104,100.0	508.2	0.61	0.3	1.0
07/15/2022 17:00	4,385.3	759.1	5,144.4	104,100.0	535.5	0.64	0.3	1.1
07/15/2022 18:00	4,363.9	1,289.4	5,653.3	104,100.0	588.5	0.71	0.4	1.2
07/15/2022 19:00	4,390.9	1,045.8	5,436.7	104,100.0	566.0	0.68	0.3	1.1
07/15/2022 20:00	4,414.3	907.0	5,321.3	104,100.0	553.9	0.66	0.3	1.1
07/15/2022 21:00	4,403.5	863.5	5,267.0	104,100.0	548.3	0.66	0.3	1.1
07/15/2022 22:00	4,405.8	903.4	5,309.2	104,100.0	552.7	0.66	0.3	1.1
07/15/2022 23:00	4,427.2	625.5	5,052.7	104,100.0	526.0	0.63	0.3	1.1
Average/Sum#:	3,912.1	387.5	4,295.4	104,100.0	447.2	0.54	0.3	0.9
Minimum:	2,675.1	0.0	2,675.1	104,100.0	278.5	0.33	0.2	0.6
Maximum:	4,503.4	1,289.4	5,653.3	104,100.0	588.5	0.71	0.4	1.2
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/16/2022 00:00	4,387.2	225.0	4,560.5	104,100.0	474.7	0.58	0.3	1.0
07/16/2022 01:00	3,984.2	0.0	3,984.2	104,100.0	414.8	0.50	0.2	0.8
07/16/2022 02:00	4,390.8	0.0	4,390.8	104,100.0	457.1	0.55	0.3	0.9
07/16/2022 03:00	4,410.2	0.0	4,410.2	104,100.0	459.1	0.55	0.3	0.9
07/16/2022 04:00	4,402.0	0.0	4,402.0	104,100.0	458.2	0.55	0.3	0.9
07/16/2022 05:00	3,820.6	0.0	3,820.6	104,100.0	397.7	0.48	0.2	0.8
07/16/2022 06:00	3,153.9	0.0	3,153.9	104,100.0	328.3	0.39	0.2	0.7
07/16/2022 07:00	2,666.1	0.0	2,666.1	104,100.0	277.5	0.33	0.2	0.6
07/16/2022 08:00	2,707.0	0.0	2,707.0	104,100.0	281.8	0.34	0.2	0.6
07/16/2022 09:00	2,770.6	0.0	2,770.6	104,100.0	288.4	0.35	0.2	0.6
07/16/2022 10:00	2,817.1	0.0	2,817.1	104,100.0	293.3	0.35	0.2	0.6
07/16/2022 11:00	2,791.6	0.0	2,791.6	104,100.0	290.6	0.35	0.2	0.6
07/16/2022 12:00	2,851.5	0.0	2,851.5	104,100.0	296.8	0.36	0.2	0.6
07/16/2022 13:00	3,505.7	0.0	3,505.7	104,100.0	364.9	0.44	0.2	0.7
07/16/2022 14:00	4,321.3	227.1	4,450.7	104,100.0	463.3	0.57	0.3	0.9
07/16/2022 15:00	4,337.1	1,310.0	5,647.1	104,100.0	587.9	0.71	0.4	1.2
07/16/2022 16:00	4,345.5	659.5	5,005.0	104,100.0	521.0	0.63	0.3	1.0
07/16/2022 17:00	4,338.9	942.7	5,281.6	104,100.0	549.8	0.66	0.3	1.1
07/16/2022 18:00	4,315.0	1,115.9	5,430.9	104,100.0	565.4	0.68	0.3	1.1
07/16/2022 19:00	4,349.4	655.3	5,004.7	104,100.0	521.0	0.63	0.3	1.0
07/16/2022 20:00	4,391.4	1,099.3	5,490.7	104,100.0	571.6	0.69	0.3	1.1
07/16/2022 21:00	4,365.9	1,238.4	5,604.3	104,100.0	583.4	0.70	0.4	1.2
07/16/2022 22:00	4,355.5	1,194.0	5,549.5	104,100.0	577.7	0.69	0.3	1.2
07/16/2022 23:00	4,379.8	857.3	5,237.1	104,100.0	545.2	0.65	0.3	1.1
Average/Sum#:	3,839.9	396.9	4,230.6	104,100.0	440.4	0.53	0.3	0.9
Minimum:	2,666.1	0.0	2,666.1	104,100.0	277.5	0.33	0.2	0.6
Maximum:	4,410.2	1,310.0	5,647.1	104,100.0	587.9	0.71	0.4	1.2
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/17/2022 00:00	4,391.2	1,200.4	5,591.6	104,100.0	582.1	0.70	0.3	1.2
07/17/2022 01:00	4,384.2	1,112.6	5,496.8	104,100.0	572.2	0.69	0.3	1.1
07/17/2022 02:00	4,399.2	1,106.0	5,505.2	104,100.0	573.1	0.69	0.3	1.1
07/17/2022 03:00	4,413.4	1,116.3	5,529.7	104,100.0	575.6	0.69	0.3	1.2
07/17/2022 04:00	4,429.3	948.4	5,377.7	104,100.0	559.8	0.67	0.3	1.1
07/17/2022 05:00	4,404.0	66.7	4,422.0	104,100.0	460.3	0.56	0.3	0.9
07/17/2022 06:00	3,871.7	0.0	3,871.7	104,100.0	403.0	0.48	0.2	0.8
07/17/2022 07:00	2,784.1	0.0	2,784.1	104,100.0	289.8	0.35	0.2	0.6
07/17/2022 08:00	3,115.2	0.0	3,115.2	104,100.0	324.3	0.39	0.2	0.6
07/17/2022 09:00	2,753.9	0.0	2,753.9	104,100.0	286.7	0.34	0.2	0.6
07/17/2022 10:00	2,768.3	0.0	2,768.3	104,100.0	288.2	0.35	0.2	0.6
07/17/2022 11:00	3,733.1	165.0	3,795.8	104,100.0	395.1	0.49	0.2	0.8
07/17/2022 12:00	4,332.9	580.5	4,913.4	104,100.0	511.5	0.61	0.3	1.0
07/17/2022 13:00	4,324.9	774.1	5,099.0	104,100.0	530.8	0.64	0.3	1.1
07/17/2022 14:00	4,336.8	586.1	4,922.9	104,100.0	512.5	0.61	0.3	1.0
07/17/2022 15:00	4,328.9	953.8	5,282.7	104,100.0	549.9	0.66	0.3	1.1
07/17/2022 16:00	4,332.6	919.9	5,252.5	104,100.0	546.8	0.66	0.3	1.1
07/17/2022 17:00	4,336.7	853.9	5,190.6	104,100.0	540.3	0.65	0.3	1.1
07/17/2022 18:00	4,342.7	1,215.0	5,557.7	104,100.0	578.6	0.69	0.3	1.2
07/17/2022 19:00	4,353.1	1,161.0	5,514.1	104,100.0	574.0	0.69	0.3	1.1
07/17/2022 20:00	4,361.0	1,277.8	5,638.8	104,100.0	587.0	0.71	0.4	1.2
07/17/2022 21:00	4,367.3	741.9	5,109.2	104,100.0	531.9	0.64	0.3	1.1
07/17/2022 22:00	4,395.0	380.1	4,775.1	104,100.0	497.1	0.60	0.3	1.0
07/17/2022 23:00	4,405.9	355.4	4,761.3	104,100.0	495.7	0.60	0.3	1.0
Average/Sum#:	4,069.4	646.5	4,709.6	104,100.0	490.3	0.59	0.3	1.0
Minimum:	2,753.9	0.0	2,753.9	104,100.0	286.7	0.34	0.2	0.6
Maximum:	4,429.3	1,277.8	5,638.8	104,100.0	587.0	0.71	0.4	1.2
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1	Unit CT1	Unit CT1
						PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/18/2022 00:00	4,420.4	337.2	4,757.6	104,100.0	495.3	0.59	0.3	1.0
07/18/2022 01:00	4,365.4	246.0	4,554.8	104,100.0	474.2	0.58	0.3	1.0
07/18/2022 02:00	2,778.8	0.0	2,778.8	104,100.0	289.3	0.35	0.2	0.6
07/18/2022 03:00	2,709.8	0.0	2,709.8	104,100.0	282.1	0.34	0.2	0.6
07/18/2022 04:00	3,033.9	0.0	3,033.9	104,100.0	315.8	0.38	0.2	0.6
07/18/2022 05:00	4,435.6	232.0	4,602.6	104,100.0	479.1	0.58	0.3	1.0
07/18/2022 06:00	4,454.5	300.1	4,754.6	104,100.0	495.0	0.59	0.3	1.0
07/18/2022 07:00	3,625.7	76.8	3,646.4	104,100.0	379.6	0.46	0.2	0.8
07/18/2022 08:00	3,032.1	0.0	3,032.1	104,100.0	315.6	0.38	0.2	0.6
07/18/2022 09:00	4,408.2	314.8	4,653.7	104,100.0	484.5	0.59	0.3	1.0
07/18/2022 10:00	4,403.1	428.5	4,831.6	104,100.0	503.0	0.60	0.3	1.0
07/18/2022 11:00	4,400.9	495.2	4,896.1	104,100.0	509.7	0.61	0.3	1.0
07/18/2022 12:00	4,399.8	548.3	4,948.1	104,100.0	515.1	0.62	0.3	1.0
07/18/2022 13:00	4,389.6	1,049.4	5,439.0	104,100.0	566.2	0.68	0.3	1.1
07/18/2022 14:00	4,393.2	755.5	5,148.7	104,100.0	536.0	0.64	0.3	1.1
07/18/2022 15:00	4,393.3	1,283.9	5,677.2	104,100.0	591.0	0.71	0.4	1.2
07/18/2022 16:00	4,395.4	1,277.3	5,672.7	104,100.0	590.5	0.71	0.4	1.2
07/18/2022 17:00	4,403.3	1,150.1	5,553.4	104,100.0	578.1	0.69	0.3	1.2
07/18/2022 18:00	4,410.1	1,238.0	5,648.1	104,100.0	588.0	0.71	0.4	1.2
07/18/2022 19:00	4,394.8	1,108.0	5,502.8	104,100.0	572.8	0.69	0.3	1.1
07/18/2022 20:00	4,388.1	1,184.9	5,573.0	104,100.0	580.1	0.70	0.3	1.2
07/18/2022 21:00	4,392.8	689.6	5,082.4	104,100.0	529.1	0.63	0.3	1.1
07/18/2022 22:00	4,404.0	331.2	4,735.2	104,100.0	492.9	0.59	0.3	1.0
07/18/2022 23:00	4,055.6	149.8	4,133.5	104,100.0	430.3	0.52	0.3	0.9
Average/Sum#:	4,103.7	549.9	4,640.3	104,100.0	483.1	0.58	0.3	1.0
Minimum:	2,709.8	0.0	2,709.8	104,100.0	282.1	0.34	0.2	0.6
Maximum:	4,454.5	1,283.9	5,677.2	104,100.0	591.0	0.71	0.4	1.2
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 **To:** 09/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/19/2022 00:00	2,755.5	0.0	2,755.5	104,100.0	286.8	0.35	0.2	0.6
07/19/2022 01:00	2,782.9	0.0	2,782.9	104,100.0	289.7	0.35	0.2	0.6
07/19/2022 02:00	2,794.5	0.0	2,794.5	104,100.0	290.9	0.35	0.2	0.6
07/19/2022 03:00	2,802.8	0.0	2,802.8	104,100.0	291.8	0.35	0.2	0.6
07/19/2022 04:00	2,793.7	0.0	2,793.7	104,100.0	290.8	0.35	0.2	0.6
07/19/2022 05:00	2,790.6	0.0	2,790.6	104,100.0	290.5	0.35	0.2	0.6
07/19/2022 06:00	2,727.1	0.0	2,727.1	104,100.0	283.9	0.34	0.2	0.6
07/19/2022 07:00	2,665.2	0.0	2,665.2	104,100.0	277.4	0.33	0.2	0.6
07/19/2022 08:00	2,659.2	0.0	2,659.2	104,100.0	276.8	0.33	0.2	0.6
07/19/2022 09:00	2,727.7	0.0	2,727.7	104,100.0	284.0	0.34	0.2	0.6
07/19/2022 10:00	2,999.3	0.0	2,999.3	104,100.0	312.2	0.38	0.2	0.6
07/19/2022 11:00	3,847.6	85.3	3,866.4	104,100.0	402.5	0.49	0.2	0.8
07/19/2022 12:00	4,409.1	679.0	5,088.1	104,100.0	529.7	0.64	0.3	1.1
07/19/2022 13:00	4,397.9	528.9	4,926.8	104,100.0	512.9	0.62	0.3	1.0
07/19/2022 14:00	4,400.9	453.5	4,854.4	104,100.0	505.3	0.61	0.3	1.0
07/19/2022 15:00	4,390.2	482.6	4,872.8	104,100.0	507.3	0.61	0.3	1.0
07/19/2022 16:00	4,385.7	993.4	5,379.1	104,100.0	560.0	0.67	0.3	1.1
07/19/2022 17:00	4,389.2	1,118.5	5,507.7	104,100.0	573.4	0.69	0.3	1.1
07/19/2022 18:00	4,411.4	1,443.5	5,854.9	104,100.0	609.5	0.73	0.4	1.2
07/19/2022 19:00	4,401.3	1,066.8	5,468.1	104,100.0	569.2	0.68	0.3	1.1
07/19/2022 20:00	4,410.6	405.7	4,816.3	104,100.0	501.4	0.60	0.3	1.0
07/19/2022 21:00	4,427.4	414.6	4,842.0	104,100.0	504.1	0.61	0.3	1.0
07/19/2022 22:00	4,440.8	282.2	4,723.0	104,100.0	491.7	0.59	0.3	1.0
07/19/2022 23:00	3,574.2	64.6	3,591.6	104,100.0	373.9	0.45	0.2	0.8
Average/Sum#:	3,599.4	334.1	3,928.7	104,100.0	409.0	0.49	0.3	0.8
Minimum:	2,659.2	0.0	2,659.2	104,100.0	276.8	0.33	0.2	0.6
Maximum:	4,440.8	1,443.5	5,854.9	104,100.0	609.5	0.73	0.4	1.2
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1	Unit CT1	Unit CT1
	PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr					
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/20/2022 00:00	2,650.7	0.0	2,650.7	104,100.0	275.9	0.33	0.2	0.6
07/20/2022 01:00	2,656.2	0.0	2,656.2	104,100.0	276.5	0.33	0.2	0.6
07/20/2022 02:00	2,656.5	0.0	2,656.5	104,100.0	276.5	0.33	0.2	0.6
07/20/2022 03:00	2,658.9	0.0	2,658.9	104,100.0	276.8	0.33	0.2	0.6
07/20/2022 04:00	2,675.2	0.0	2,675.2	104,100.0	278.5	0.33	0.2	0.6
07/20/2022 05:00	2,702.0	0.0	2,702.0	104,100.0	281.3	0.34	0.2	0.6
07/20/2022 06:00	2,705.3	0.0	2,705.3	104,100.0	281.6	0.34	0.2	0.6
07/20/2022 07:00	2,759.5	0.0	2,759.5	104,100.0	287.3	0.34	0.2	0.6
07/20/2022 08:00	2,697.8	0.0	2,697.8	104,100.0	280.8	0.34	0.2	0.6
07/20/2022 09:00	2,753.2	0.0	2,753.2	104,100.0	286.6	0.35	0.2	0.6
07/20/2022 10:00	2,732.1	0.0	2,732.1	104,100.0	284.4	0.34	0.2	0.6
07/20/2022 11:00	2,806.1	0.0	2,806.1	104,100.0	292.1	0.35	0.2	0.6
07/20/2022 12:00	3,887.0	148.9	3,943.6	104,100.0	410.5	0.50	0.3	0.8
07/20/2022 13:00	4,388.1	672.1	5,060.2	104,100.0	526.8	0.63	0.3	1.1
07/20/2022 14:00	4,384.0	1,530.2	5,914.2	104,100.0	615.7	0.74	0.4	1.2
07/20/2022 15:00	4,367.5	587.9	4,955.4	104,100.0	515.9	0.62	0.3	1.0
07/20/2022 16:00	4,360.3	621.4	4,981.7	104,100.0	518.6	0.62	0.3	1.0
07/20/2022 17:00	4,358.2	1,355.3	5,713.5	104,100.0	594.8	0.71	0.4	1.2
07/20/2022 18:00	4,377.6	1,031.5	5,409.1	104,100.0	563.1	0.68	0.3	1.1
07/20/2022 19:00	4,377.4	1,155.9	5,533.3	104,100.0	576.0	0.69	0.3	1.2
07/20/2022 20:00	4,387.4	844.7	5,232.1	104,100.0	544.7	0.65	0.3	1.1
07/20/2022 21:00	3,572.8	82.9	3,593.5	104,100.0	374.1	0.46	0.2	0.8
07/20/2022 22:00	2,785.3	0.0	2,785.3	104,100.0	289.9	0.35	0.2	0.6
07/20/2022 23:00	2,687.3	0.0	2,687.3	104,100.0	279.7	0.34	0.2	0.6
Average/Sum#:	3,349.4	334.6	3,677.6	104,100.0	382.8	0.46	0.2	0.8
Minimum:	2,650.7	0.0	2,650.7	104,100.0	275.9	0.33	0.2	0.6
Maximum:	4,388.1	1,530.2	5,914.2	104,100.0	615.7	0.74	0.4	1.2
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 **To:** 09/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/21/2022 00:00	2,750.7	0.0	2,750.7	104,100.0	286.3	0.35	0.2	0.6
07/21/2022 01:00	2,715.5	0.0	2,715.5	104,100.0	282.7	0.34	0.2	0.6
07/21/2022 02:00	2,710.1	0.0	2,710.1	104,100.0	282.1	0.34	0.2	0.6
07/21/2022 03:00	2,802.8	0.0	2,802.8	104,100.0	291.8	0.35	0.2	0.6
07/21/2022 04:00	2,697.4	0.0	2,697.4	104,100.0	280.8	0.34	0.2	0.6
07/21/2022 05:00	2,651.6	0.0	2,651.6	104,100.0	276.0	0.33	0.2	0.6
07/21/2022 06:00	2,662.8	0.0	2,662.8	104,100.0	277.2	0.33	0.2	0.6
07/21/2022 07:00	2,670.9	0.0	2,670.9	104,100.0	278.0	0.33	0.2	0.6
07/21/2022 08:00	2,666.1	0.0	2,666.1	104,100.0	277.5	0.33	0.2	0.6
07/21/2022 09:00	2,667.3	0.0	2,667.3	104,100.0	277.7	0.33	0.2	0.6
07/21/2022 10:00	2,673.4	0.0	2,673.4	104,100.0	278.3	0.33	0.2	0.6
07/21/2022 11:00	2,680.0	0.0	2,680.0	104,100.0	279.0	0.33	0.2	0.6
07/21/2022 12:00	2,739.2	0.0	2,739.2	104,100.0	285.2	0.34	0.2	0.6
07/21/2022 13:00	3,369.6	8.5	3,370.0	104,100.0	350.8	0.42	0.2	0.7
07/21/2022 14:00	4,354.7	546.1	4,900.8	104,100.0	510.2	0.61	0.3	1.0
07/21/2022 15:00	4,361.8	545.7	4,907.5	104,100.0	510.9	0.61	0.3	1.0
07/21/2022 16:00	4,345.2	555.8	4,901.0	104,100.0	510.2	0.61	0.3	1.0
07/21/2022 17:00	4,358.3	758.6	5,116.9	104,100.0	532.7	0.64	0.3	1.1
07/21/2022 18:00	4,360.1	915.7	5,275.8	104,100.0	549.2	0.66	0.3	1.1
07/21/2022 19:00	4,359.6	496.6	4,856.2	104,100.0	505.5	0.61	0.3	1.0
07/21/2022 20:00	4,386.1	485.0	4,871.1	104,100.0	507.1	0.61	0.3	1.0
07/21/2022 21:00	3,919.1	184.1	4,014.8	104,100.0	417.9	0.51	0.3	0.9
07/21/2022 22:00	2,679.1	0.0	2,679.1	104,100.0	278.9	0.33	0.2	0.6
07/21/2022 23:00	2,753.3	0.0	2,753.3	104,100.0	286.6	0.34	0.2	0.6
Average/Sum#:	3,263.9	187.3	3,447.3	104,100.0	358.9	0.43	0.2	0.7
Minimum:	2,651.6	0.0	2,651.6	104,100.0	276.0	0.33	0.2	0.6
Maximum:	4,386.1	915.7	5,275.8	104,100.0	549.2	0.66	0.3	1.1
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1	Unit CT1	Unit CT1
	PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr					
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/22/2022 00:00	2,792.0	0.0	2,792.0	104,100.0	290.6	0.35	0.2	0.6
07/22/2022 01:00	2,787.0	0.0	2,787.0	104,100.0	290.1	0.35	0.2	0.6
07/22/2022 02:00	3,153.8	0.0	3,153.8	104,100.0	328.3	0.39	0.2	0.7
07/22/2022 03:00	2,786.2	0.0	2,786.2	104,100.0	290.0	0.35	0.2	0.6
07/22/2022 04:00	2,773.2	0.0	2,773.2	104,100.0	288.7	0.35	0.2	0.6
07/22/2022 05:00	2,761.8	0.0	2,761.8	104,100.0	287.5	0.35	0.2	0.6
07/22/2022 06:00	2,712.9	0.0	2,712.9	104,100.0	282.4	0.34	0.2	0.6
07/22/2022 07:00	2,673.8	0.0	2,673.8	104,100.0	278.3	0.33	0.2	0.6
07/22/2022 08:00	2,663.8	0.0	2,663.8	104,100.0	277.3	0.33	0.2	0.6
07/22/2022 09:00	2,661.8	0.0	2,661.8	104,100.0	277.1	0.33	0.2	0.6
07/22/2022 10:00	2,676.8	0.0	2,676.8	104,100.0	278.7	0.33	0.2	0.6
07/22/2022 11:00	2,677.2	0.0	2,677.2	104,100.0	278.7	0.33	0.2	0.6
07/22/2022 12:00	2,680.0	0.0	2,680.0	104,100.0	279.0	0.33	0.2	0.6
07/22/2022 13:00	2,724.4	0.0	2,724.4	104,100.0	283.6	0.34	0.2	0.6
07/22/2022 14:00	3,401.0	25.2	3,404.3	104,100.0	354.4	0.43	0.2	0.7
07/22/2022 15:00	4,376.7	511.3	4,888.0	104,100.0	508.8	0.61	0.3	1.0
07/22/2022 16:00	4,371.3	497.6	4,868.9	104,100.0	506.9	0.61	0.3	1.0
07/22/2022 17:00	4,400.1	467.3	4,867.4	104,100.0	506.7	0.61	0.3	1.0
07/22/2022 18:00	4,398.4	459.4	4,857.8	104,100.0	505.7	0.61	0.3	1.0
07/22/2022 19:00	4,396.5	417.2	4,813.7	104,100.0	501.1	0.60	0.3	1.0
07/22/2022 20:00	4,411.7	367.8	4,779.5	104,100.0	497.5	0.60	0.3	1.0
07/22/2022 21:00	3,709.5	81.6	3,731.5	104,100.0	388.4	0.47	0.2	0.8
07/22/2022 22:00	2,834.1	0.0	2,834.1	104,100.0	295.0	0.36	0.2	0.6
07/22/2022 23:00	3,232.4	1.8	3,232.4	104,100.0	336.5	0.40	0.2	0.7
Average/Sum#:	3,252.4	117.9	3,366.8	104,100.0	350.5	0.42	0.2	0.7
Minimum:	2,661.8	0.0	2,661.8	104,100.0	277.1	0.33	0.2	0.6
Maximum:	4,411.7	511.3	4,888.0	104,100.0	508.8	0.61	0.3	1.0
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1	Unit CT1	Unit CT1
						PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/23/2022 00:00	3,183.9	0.0	3,183.9	104,100.0	331.4	0.40	0.2	0.7
07/23/2022 01:00	2,941.7	0.0	2,941.7	104,100.0	306.2	0.37	0.2	0.6
07/23/2022 02:00	3,289.7	0.0	3,289.7	104,100.0	342.5	0.41	0.2	0.7
07/23/2022 03:00	2,872.0	0.0	2,872.0	104,100.0	299.0	0.36	0.2	0.6
07/23/2022 04:00	2,927.6	0.0	2,927.6	104,100.0	304.8	0.37	0.2	0.6
07/23/2022 05:00	3,048.0	0.0	3,048.0	104,100.0	317.3	0.38	0.2	0.6
07/23/2022 06:00	4,442.8	102.6	4,528.0	104,100.0	471.4	0.57	0.3	0.9
07/23/2022 07:00	4,527.6	127.9	4,655.5	104,100.0	484.6	0.58	0.3	1.0
07/23/2022 08:00	4,501.3	131.7	4,633.0	104,100.0	482.3	0.58	0.3	1.0
07/23/2022 09:00	3,616.9	28.6	3,623.5	104,100.0	377.2	0.46	0.2	0.8
07/23/2022 10:00	2,861.6	0.0	2,861.6	104,100.0	297.9	0.36	0.2	0.6
07/23/2022 11:00	2,873.2	0.0	2,873.2	104,100.0	299.1	0.36	0.2	0.6
07/23/2022 12:00	2,877.6	0.0	2,877.6	104,100.0	299.6	0.36	0.2	0.6
07/23/2022 13:00	2,883.2	0.0	2,883.2	104,100.0	300.1	0.36	0.2	0.6
07/23/2022 14:00	2,891.2	0.0	2,891.2	104,100.0	301.0	0.36	0.2	0.6
07/23/2022 15:00	3,195.7	0.0	3,195.7	104,100.0	332.7	0.40	0.2	0.7
07/23/2022 16:00	3,241.2	0.0	3,241.2	104,100.0	337.4	0.41	0.2	0.7
07/23/2022 17:00	3,589.7	38.3	3,597.4	104,100.0	374.5	0.45	0.2	0.8
07/23/2022 18:00	4,375.3	1,033.9	5,409.2	104,100.0	563.1	0.68	0.3	1.1
07/23/2022 19:00	4,406.9	772.1	5,179.0	104,100.0	539.1	0.65	0.3	1.1
07/23/2022 20:00	4,416.8	417.7	4,834.5	104,100.0	503.3	0.60	0.3	1.0
07/23/2022 21:00	4,005.5	216.4	4,118.0	104,100.0	428.7	0.53	0.3	0.9
07/23/2022 22:00	3,270.9	0.0	3,270.9	104,100.0	340.5	0.41	0.2	0.7
07/23/2022 23:00	4,409.3	89.7	4,472.1	104,100.0	465.5	0.56	0.3	0.9
Average/Sum#:	3,527.1	123.3	3,642.0	104,100.0	379.1	0.46	0.2	0.8
Minimum:	2,861.6	0.0	2,861.6	104,100.0	297.9	0.36	0.2	0.6
Maximum:	4,527.6	1,033.9	5,409.2	104,100.0	563.1	0.68	0.3	1.1
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1	Unit CT1	Unit CT1
	PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr					
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/24/2022 00:00	4,352.7	0.0	4,352.7	104,100.0	453.1	0.54	0.3	0.9
07/24/2022 01:00	4,359.0	0.0	4,359.0	104,100.0	453.8	0.54	0.3	0.9
07/24/2022 02:00	4,404.8	0.0	4,404.8	104,100.0	458.5	0.55	0.3	0.9
07/24/2022 03:00	4,431.5	0.0	4,431.5	104,100.0	461.3	0.55	0.3	0.9
07/24/2022 04:00	4,400.3	0.0	4,400.3	104,100.0	458.1	0.55	0.3	0.9
07/24/2022 05:00	3,320.5	0.0	3,320.5	104,100.0	345.7	0.41	0.2	0.7
07/24/2022 06:00	2,763.7	0.0	2,763.7	104,100.0	287.7	0.34	0.2	0.6
07/24/2022 07:00	2,770.7	0.0	2,770.7	104,100.0	288.4	0.35	0.2	0.6
07/24/2022 08:00	2,705.4	0.0	2,705.4	104,100.0	281.6	0.34	0.2	0.6
07/24/2022 09:00	2,668.5	0.0	2,668.5	104,100.0	277.8	0.33	0.2	0.6
07/24/2022 10:00	2,674.9	0.0	2,674.9	104,100.0	278.5	0.33	0.2	0.6
07/24/2022 11:00	2,685.4	0.0	2,685.4	104,100.0	279.6	0.33	0.2	0.6
07/24/2022 12:00	2,684.6	0.0	2,684.6	104,100.0	279.5	0.34	0.2	0.6
07/24/2022 13:00	2,684.6	0.0	2,684.6	104,100.0	279.5	0.34	0.2	0.6
07/24/2022 14:00	2,694.8	0.0	2,694.8	104,100.0	280.5	0.34	0.2	0.6
07/24/2022 15:00	2,676.5	0.0	2,676.5	104,100.0	278.6	0.33	0.2	0.6
07/24/2022 16:00	3,722.4	175.8	3,796.2	104,100.0	395.2	0.49	0.2	0.8
07/24/2022 17:00	4,350.7	576.2	4,926.9	104,100.0	512.9	0.62	0.3	1.0
07/24/2022 18:00	4,359.4	555.6	4,915.0	104,100.0	511.7	0.61	0.3	1.0
07/24/2022 19:00	4,409.1	438.5	4,847.6	104,100.0	504.6	0.61	0.3	1.0
07/24/2022 20:00	4,025.5	188.9	4,116.2	104,100.0	428.5	0.53	0.3	0.9
07/24/2022 21:00	2,683.9	0.0	2,683.9	104,100.0	279.4	0.33	0.2	0.6
07/24/2022 22:00	2,667.2	0.0	2,667.2	104,100.0	277.7	0.33	0.2	0.6
07/24/2022 23:00	2,761.6	0.0	2,761.6	104,100.0	287.5	0.35	0.2	0.6
Average/Sum#:	3,385.7	80.6	3,458.0	104,100.0	360.0	0.43	0.2	0.7
Minimum:	2,667.2	0.0	2,667.2	104,100.0	277.7	0.33	0.2	0.6
Maximum:	4,431.5	576.2	4,926.9	104,100.0	512.9	0.62	0.3	1.0
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 **To:** 09/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1	Unit CT1	Unit CT1
	PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr					
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/25/2022 00:00	2,704.1	0.0	2,704.1	104,100.0	281.5	0.34	0.2	0.6
07/25/2022 01:00	2,659.3	0.0	2,659.3	104,100.0	276.8	0.33	0.2	0.6
07/25/2022 02:00	2,658.3	0.0	2,658.3	104,100.0	276.7	0.33	0.2	0.6
07/25/2022 03:00	2,652.8	0.0	2,652.8	104,100.0	276.2	0.33	0.2	0.6
07/25/2022 04:00	2,753.0	0.0	2,753.0	104,100.0	286.6	0.35	0.2	0.6
07/25/2022 05:00	2,782.1	0.0	2,782.1	104,100.0	289.6	0.35	0.2	0.6
07/25/2022 06:00	2,775.3	0.0	2,775.3	104,100.0	288.9	0.35	0.2	0.6
07/25/2022 07:00	2,780.1	0.0	2,780.1	104,100.0	289.4	0.35	0.2	0.6
07/25/2022 08:00	2,673.4	0.0	2,673.4	104,100.0	278.3	0.33	0.2	0.6
07/25/2022 09:00	2,656.1	0.0	2,656.1	104,100.0	276.5	0.33	0.2	0.6
07/25/2022 10:00	2,650.2	0.0	2,650.2	104,100.0	275.9	0.33	0.2	0.6
07/25/2022 11:00	2,760.7	0.0	2,760.7	104,100.0	287.4	0.34	0.2	0.6
07/25/2022 12:00	2,785.5	0.0	2,785.5	104,100.0	290.0	0.35	0.2	0.6
07/25/2022 13:00	3,782.1	179.8	3,850.4	104,100.0	400.8	0.49	0.2	0.8
07/25/2022 14:00	4,359.5	614.3	4,973.8	104,100.0	517.8	0.62	0.3	1.0
07/25/2022 15:00	4,352.5	680.1	5,032.6	104,100.0	523.9	0.63	0.3	1.0
07/25/2022 16:00	4,354.2	797.4	5,151.6	104,100.0	536.3	0.64	0.3	1.1
07/25/2022 17:00	4,370.9	893.3	5,264.2	104,100.0	548.0	0.66	0.3	1.1
07/25/2022 18:00	4,372.3	948.1	5,320.4	104,100.0	553.9	0.66	0.3	1.1
07/25/2022 19:00	4,373.9	576.0	4,949.9	104,100.0	515.3	0.62	0.3	1.0
07/25/2022 20:00	4,390.4	435.6	4,826.0	104,100.0	502.4	0.60	0.3	1.0
07/25/2022 21:00	4,418.6	389.8	4,808.4	104,100.0	500.6	0.60	0.3	1.0
07/25/2022 22:00	3,621.9	74.2	3,639.0	104,100.0	378.8	0.46	0.2	0.8
07/25/2022 23:00	3,270.5	0.0	3,270.5	104,100.0	340.5	0.41	0.2	0.7
Average/Sum#:	3,373.2	232.9	3,599.1	104,100.0	374.7	0.45	0.2	0.8
Minimum:	2,650.2	0.0	2,650.2	104,100.0	275.9	0.33	0.2	0.6
Maximum:	4,418.6	948.1	5,320.4	104,100.0	553.9	0.66	0.3	1.1
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1	Unit CT1	Unit CT1
	PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr					
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/26/2022 00:00	2,784.7	0.0	2,784.7	104,100.0	289.9	0.35	0.2	0.6
07/26/2022 01:00	2,776.9	0.0	2,776.9	104,100.0	289.1	0.35	0.2	0.6
07/26/2022 02:00	2,780.5	0.0	2,780.5	104,100.0	289.5	0.35	0.2	0.6
07/26/2022 03:00	2,774.5	0.0	2,774.5	104,100.0	288.8	0.35	0.2	0.6
07/26/2022 04:00	3,860.9	70.5	3,880.6	104,100.0	404.0	0.49	0.2	0.8
07/26/2022 05:00	4,472.0	209.2	4,681.2	104,100.0	487.3	0.59	0.3	1.0
07/26/2022 06:00	3,197.0	1.6	3,197.0	104,100.0	332.8	0.40	0.2	0.7
07/26/2022 07:00	2,804.7	0.0	2,804.7	104,100.0	292.0	0.35	0.2	0.6
07/26/2022 08:00	2,716.4	0.0	2,716.4	104,100.0	282.8	0.34	0.2	0.6
07/26/2022 09:00	2,705.7	0.0	2,705.7	104,100.0	281.7	0.34	0.2	0.6
07/26/2022 10:00	2,776.8	0.0	2,776.8	104,100.0	289.1	0.35	0.2	0.6
07/26/2022 11:00	2,712.9	0.0	2,712.9	104,100.0	282.4	0.34	0.2	0.6
07/26/2022 12:00	2,858.3	0.0	2,858.3	104,100.0	297.5	0.36	0.2	0.6
07/26/2022 13:00	3,863.7	141.4	3,924.5	104,100.0	408.5	0.50	0.3	0.8
07/26/2022 14:00	4,392.9	485.5	4,878.4	104,100.0	507.8	0.61	0.3	1.0
07/26/2022 15:00	4,375.9	524.2	4,900.1	104,100.0	510.1	0.61	0.3	1.0
07/26/2022 16:00	4,355.0	715.6	5,070.6	104,100.0	527.8	0.63	0.3	1.1
07/26/2022 17:00	4,367.7	969.8	5,337.5	104,100.0	555.6	0.67	0.3	1.1
07/26/2022 18:00	4,389.4	755.5	5,144.9	104,100.0	535.6	0.64	0.3	1.1
07/26/2022 19:00	4,407.9	490.4	4,898.3	104,100.0	509.9	0.61	0.3	1.0
07/26/2022 20:00	4,408.4	424.8	4,833.2	104,100.0	503.1	0.60	0.3	1.0
07/26/2022 21:00	4,445.9	341.4	4,787.3	104,100.0	498.4	0.60	0.3	1.0
07/26/2022 22:00	4,468.7	291.1	4,759.8	104,100.0	495.5	0.60	0.3	1.0
07/26/2022 23:00	3,639.5	64.6	3,656.9	104,100.0	380.7	0.46	0.2	0.8
Average/Sum#:	3,597.3	228.6	3,818.4	104,100.0	397.5	0.48	0.2	0.8
Minimum:	2,705.7	0.0	2,705.7	104,100.0	281.7	0.34	0.2	0.6
Maximum:	4,472.0	969.8	5,337.5	104,100.0	555.6	0.67	0.3	1.1
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 **To:** 09/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1	Unit CT1	Unit CT1
	PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr					
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/27/2022 00:00	2,800.6	0.0	2,800.6	104,100.0	291.5	0.35	0.2	0.6
07/27/2022 01:00	2,805.4	0.0	2,805.4	104,100.0	292.0	0.35	0.2	0.6
07/27/2022 02:00	2,799.6	0.0	2,799.6	104,100.0	291.4	0.35	0.2	0.6
07/27/2022 03:00	2,800.8	0.0	2,800.8	104,100.0	291.6	0.35	0.2	0.6
07/27/2022 04:00	2,795.7	0.0	2,795.7	104,100.0	291.0	0.35	0.2	0.6
07/27/2022 05:00	2,926.2	0.0	2,926.2	104,100.0	304.6	0.37	0.2	0.6
07/27/2022 06:00	3,111.3	0.0	3,111.3	104,100.0	323.9	0.39	0.2	0.6
07/27/2022 07:00	2,860.7	0.0	2,860.7	104,100.0	297.8	0.36	0.2	0.6
07/27/2022 08:00	2,798.9	0.0	2,798.9	104,100.0	291.4	0.35	0.2	0.6
07/27/2022 09:00	2,705.3	0.0	2,705.3	104,100.0	281.6	0.34	0.2	0.6
07/27/2022 10:00	2,787.5	0.0	2,787.5	104,100.0	290.2	0.35	0.2	0.6
07/27/2022 11:00	2,803.4	0.0	2,803.4	104,100.0	291.8	0.35	0.2	0.6
07/27/2022 12:00	2,766.5	0.0	2,766.5	104,100.0	288.0	0.35	0.2	0.6
07/27/2022 13:00	4,220.3	303.5	4,411.5	104,100.0	459.2	0.57	0.3	0.9
07/27/2022 14:00	4,369.0	559.4	4,928.4	104,100.0	513.0	0.62	0.3	1.0
07/27/2022 15:00	4,341.0	612.5	4,953.5	104,100.0	515.7	0.62	0.3	1.0
07/27/2022 16:00	4,336.6	643.3	4,979.9	104,100.0	518.4	0.62	0.3	1.0
07/27/2022 17:00	4,356.7	1,286.9	5,643.6	104,100.0	587.5	0.71	0.4	1.2
07/27/2022 18:00	4,351.0	538.9	4,889.9	104,100.0	509.0	0.61	0.3	1.0
07/27/2022 19:00	4,372.5	481.8	4,854.3	104,100.0	505.3	0.61	0.3	1.0
07/27/2022 20:00	4,398.1	421.7	4,819.8	104,100.0	501.7	0.60	0.3	1.0
07/27/2022 21:00	4,159.3	181.3	4,253.6	104,100.0	442.8	0.54	0.3	0.9
07/27/2022 22:00	3,452.1	0.0	3,452.1	104,100.0	359.4	0.43	0.2	0.7
07/27/2022 23:00	3,359.9	0.0	3,359.9	104,100.0	349.8	0.42	0.2	0.7
Average/Sum#:	3,436.6	209.6	3,637.9	104,100.0	378.7	0.46	0.2	0.8
Minimum:	2,705.3	0.0	2,705.3	104,100.0	281.6	0.34	0.2	0.6
Maximum:	4,398.1	1,286.9	5,643.6	104,100.0	587.5	0.71	0.4	1.2
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 **To:** 09/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/28/2022 00:00	3,219.8	0.0	3,219.8	104,100.0	335.2	0.40	0.2	0.7
07/28/2022 01:00	2,902.3	0.0	2,902.3	104,100.0	302.1	0.36	0.2	0.6
07/28/2022 02:00	2,807.3	0.0	2,807.3	104,100.0	292.2	0.35	0.2	0.6
07/28/2022 03:00	3,891.8	51.6	3,903.2	104,100.0	406.3	0.49	0.2	0.8
07/28/2022 04:00	4,495.4	220.9	4,716.3	104,100.0	491.0	0.59	0.3	1.0
07/28/2022 05:00	4,129.3	102.1	4,182.4	104,100.0	435.4	0.53	0.3	0.9
07/28/2022 06:00	3,702.6	0.0	3,702.6	104,100.0	385.4	0.46	0.2	0.8
07/28/2022 07:00	3,581.6	0.0	3,581.6	104,100.0	372.8	0.45	0.2	0.7
07/28/2022 08:00	2,787.8	0.0	2,787.8	104,100.0	290.2	0.35	0.2	0.6
07/28/2022 09:00	2,834.6	0.0	2,834.6	104,100.0	295.1	0.36	0.2	0.6
07/28/2022 10:00	4,165.6	0.0	4,165.6	104,100.0	433.6	0.52	0.3	0.9
07/28/2022 11:00	4,402.4	559.3	4,944.9	104,100.0	514.8	0.62	0.3	1.0
07/28/2022 12:00	4,370.1	536.4	4,906.5	104,100.0	510.8	0.61	0.3	1.0
07/28/2022 13:00	4,349.8	615.0	4,964.8	104,100.0	516.8	0.62	0.3	1.0
07/28/2022 14:00	4,326.3	1,035.5	5,361.8	104,100.0	558.2	0.67	0.3	1.1
07/28/2022 15:00	4,304.5	632.2	4,936.7	104,100.0	513.9	0.62	0.3	1.0
07/28/2022 16:00	4,303.7	692.9	4,996.6	104,100.0	520.1	0.62	0.3	1.0
07/28/2022 17:00	4,313.4	1,230.0	5,543.4	104,100.0	577.1	0.69	0.3	1.2
07/28/2022 18:00	4,315.0	1,367.2	5,682.2	104,100.0	591.5	0.71	0.4	1.2
07/28/2022 19:00	4,347.7	751.0	5,098.7	104,100.0	530.8	0.64	0.3	1.1
07/28/2022 20:00	4,374.9	648.3	5,023.2	104,100.0	522.9	0.63	0.3	1.0
07/28/2022 21:00	4,391.9	402.2	4,794.1	104,100.0	499.1	0.60	0.3	1.0
07/28/2022 22:00	4,017.0	178.3	4,109.7	104,100.0	427.8	0.52	0.3	0.9
07/28/2022 23:00	2,829.5	0.0	2,829.5	104,100.0	294.6	0.35	0.2	0.6
Average/Sum#:	3,881.8	376.0	4,249.8	104,100.0	442.4	0.53	0.3	0.9
Minimum:	2,787.8	0.0	2,787.8	104,100.0	290.2	0.35	0.2	0.6
Maximum:	4,495.4	1,367.2	5,682.2	104,100.0	591.5	0.71	0.4	1.2
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 **To:** 09/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1	Unit CT1	Unit CT1
	PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr					
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/29/2022 00:00	2,738.7	0.0	2,738.7	104,100.0	285.1	0.34	0.2	0.6
07/29/2022 01:00	2,725.9	0.0	2,725.9	104,100.0	283.8	0.34	0.2	0.6
07/29/2022 02:00	2,770.8	0.0	2,770.8	104,100.0	288.4	0.35	0.2	0.6
07/29/2022 03:00	2,785.1	0.0	2,785.1	104,100.0	289.9	0.35	0.2	0.6
07/29/2022 04:00	4,279.0	130.5	4,348.2	104,100.0	452.6	0.55	0.3	0.9
07/29/2022 05:00	4,468.2	232.3	4,700.5	104,100.0	489.3	0.59	0.3	1.0
07/29/2022 06:00	3,424.3	1.7	3,424.3	104,100.0	356.5	0.43	0.2	0.7
07/29/2022 07:00	2,808.9	0.0	2,808.9	104,100.0	292.4	0.35	0.2	0.6
07/29/2022 08:00	2,803.8	0.0	2,803.8	104,100.0	291.9	0.35	0.2	0.6
07/29/2022 09:00	2,805.1	0.0	2,805.1	104,100.0	292.0	0.35	0.2	0.6
07/29/2022 10:00	2,807.5	0.0	2,807.5	104,100.0	292.3	0.35	0.2	0.6
07/29/2022 11:00	3,085.2	0.0	3,085.2	104,100.0	321.2	0.38	0.2	0.6
07/29/2022 12:00	4,364.8	446.5	4,766.7	104,100.0	496.2	0.60	0.3	1.0
07/29/2022 13:00	4,353.8	599.2	4,953.0	104,100.0	515.6	0.62	0.3	1.0
07/29/2022 14:00	4,331.3	791.1	5,122.4	104,100.0	533.2	0.64	0.3	1.1
07/29/2022 15:00	4,310.5	645.9	4,956.4	104,100.0	516.0	0.62	0.3	1.0
07/29/2022 16:00	4,300.9	673.0	4,973.9	104,100.0	517.8	0.62	0.3	1.0
07/29/2022 17:00	4,310.8	783.9	5,094.7	104,100.0	530.4	0.64	0.3	1.1
07/29/2022 18:00	4,337.8	583.6	4,921.4	104,100.0	512.3	0.62	0.3	1.0
07/29/2022 19:00	4,352.9	520.2	4,873.1	104,100.0	507.3	0.61	0.3	1.0
07/29/2022 20:00	4,372.5	467.5	4,840.0	104,100.0	503.8	0.60	0.3	1.0
07/29/2022 21:00	4,398.8	497.5	4,896.3	104,100.0	509.7	0.61	0.3	1.0
07/29/2022 22:00	4,423.3	358.8	4,782.1	104,100.0	497.8	0.60	0.3	1.0
07/29/2022 23:00	4,445.6	418.2	4,863.8	104,100.0	506.3	0.61	0.3	1.0
Average/Sum#:	3,741.9	297.9	4,035.3	104,100.0	420.1	0.51	0.3	0.8
Minimum:	2,725.9	0.0	2,725.9	104,100.0	283.8	0.34	0.2	0.6
Maximum:	4,468.2	791.1	5,122.4	104,100.0	533.2	0.64	0.3	1.1
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 **To:** 09/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/30/2022 00:00	4,454.3	264.5	4,718.8	104,100.0	491.2	0.59	0.3	1.0
07/30/2022 01:00	4,459.2	239.0	4,691.0	104,100.0	488.3	0.59	0.3	1.0
07/30/2022 02:00	3,886.1	0.0	3,886.1	104,100.0	404.5	0.49	0.2	0.8
07/30/2022 03:00	4,060.1	0.0	4,060.1	104,100.0	422.7	0.51	0.3	0.8
07/30/2022 04:00	4,465.8	178.8	4,608.8	104,100.0	479.8	0.58	0.3	1.0
07/30/2022 05:00	4,473.8	316.0	4,789.8	104,100.0	498.6	0.60	0.3	1.0
07/30/2022 06:00	4,304.8	60.7	4,321.2	104,100.0	449.8	0.55	0.3	0.9
07/30/2022 07:00	3,005.2	0.0	3,005.2	104,100.0	312.8	0.38	0.2	0.6
07/30/2022 08:00	2,789.7	0.0	2,789.7	104,100.0	290.4	0.35	0.2	0.6
07/30/2022 09:00	2,703.9	0.0	2,703.9	104,100.0	281.5	0.34	0.2	0.6
07/30/2022 10:00	2,693.1	0.0	2,693.1	104,100.0	280.4	0.33	0.2	0.6
07/30/2022 11:00	3,388.8	29.4	3,394.1	104,100.0	353.3	0.43	0.2	0.7
07/30/2022 12:00	4,371.9	542.9	4,914.8	104,100.0	511.6	0.61	0.3	1.0
07/30/2022 13:00	4,358.2	589.7	4,947.9	104,100.0	515.1	0.62	0.3	1.0
07/30/2022 14:00	4,349.5	1,152.7	5,502.2	104,100.0	572.8	0.69	0.3	1.1
07/30/2022 15:00	4,328.8	1,799.5	6,128.3	104,100.0	638.0	0.77	0.4	1.3
07/30/2022 16:00	4,330.5	1,594.8	5,925.3	104,100.0	616.8	0.74	0.4	1.2
07/30/2022 17:00	4,346.8	956.9	5,303.7	104,100.0	552.1	0.66	0.3	1.1
07/30/2022 18:00	4,361.0	535.8	4,896.8	104,100.0	509.8	0.61	0.3	1.0
07/30/2022 19:00	4,378.3	487.0	4,865.3	104,100.0	506.5	0.61	0.3	1.0
07/30/2022 20:00	4,399.1	410.7	4,809.8	104,100.0	500.7	0.60	0.3	1.0
07/30/2022 21:00	4,410.4	564.2	4,974.6	104,100.0	517.9	0.62	0.3	1.0
07/30/2022 22:00	4,423.3	366.8	4,790.1	104,100.0	498.6	0.60	0.3	1.0
07/30/2022 23:00	4,432.9	325.5	4,758.4	104,100.0	495.3	0.59	0.3	1.0
Average/Sum#:	4,049.0	434.0	4,478.3	104,100.0	466.2	0.56	0.3	0.9
Minimum:	2,693.1	0.0	2,693.1	104,100.0	280.4	0.33	0.2	0.6
Maximum:	4,473.8	1,799.5	6,128.3	104,100.0	638.0	0.77	0.4	1.3
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1	Unit CT1	Unit CT1
	PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr					
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/31/2022 00:00	4,427.5	321.1	4,748.6	104,100.0	494.3	0.59	0.3	1.0
07/31/2022 01:00	4,433.7	306.8	4,740.5	104,100.0	493.5	0.59	0.3	1.0
07/31/2022 02:00	4,434.1	294.4	4,728.5	104,100.0	492.2	0.59	0.3	1.0
07/31/2022 03:00	4,021.9	141.6	4,095.5	104,100.0	426.3	0.52	0.3	0.9
07/31/2022 04:00	2,708.0	0.0	2,708.0	104,100.0	281.9	0.34	0.2	0.6
07/31/2022 05:00	3,515.8	0.0	3,515.8	104,100.0	366.0	0.44	0.2	0.7
07/31/2022 06:00	3,714.1	0.0	3,714.1	104,100.0	386.6	0.46	0.2	0.8
07/31/2022 07:00	2,767.2	0.0	2,767.2	104,100.0	288.1	0.35	0.2	0.6
07/31/2022 08:00	2,655.5	0.0	2,655.5	104,100.0	276.4	0.33	0.2	0.6
07/31/2022 09:00	2,755.0	0.0	2,755.0	104,100.0	286.8	0.35	0.2	0.6
07/31/2022 10:00	3,785.9	71.6	3,801.7	104,100.0	395.8	0.48	0.2	0.8
07/31/2022 11:00	4,377.7	378.8	4,756.5	104,100.0	495.2	0.59	0.3	1.0
07/31/2022 12:00	4,366.0	392.4	4,758.4	104,100.0	495.3	0.59	0.3	1.0
07/31/2022 13:00	4,357.6	418.7	4,776.3	104,100.0	497.2	0.60	0.3	1.0
07/31/2022 14:00	4,345.9	781.4	5,127.3	104,100.0	533.8	0.64	0.3	1.1
07/31/2022 15:00	4,333.4	686.1	5,019.5	104,100.0	522.5	0.63	0.3	1.0
07/31/2022 16:00	4,329.9	837.5	5,167.4	104,100.0	537.9	0.65	0.3	1.1
07/31/2022 17:00	4,336.3	1,185.6	5,521.9	104,100.0	574.8	0.69	0.3	1.1
07/31/2022 18:00	4,362.7	475.5	4,838.2	104,100.0	503.7	0.61	0.3	1.0
07/31/2022 19:00	4,379.2	402.2	4,781.4	104,100.0	497.7	0.60	0.3	1.0
07/31/2022 20:00	4,396.4	406.8	4,803.2	104,100.0	500.0	0.60	0.3	1.0
07/31/2022 21:00	4,414.7	456.1	4,870.8	104,100.0	507.1	0.61	0.3	1.0
07/31/2022 22:00	4,044.7	170.7	4,133.5	104,100.0	430.3	0.53	0.3	0.9
07/31/2022 23:00	2,831.4	0.0	2,831.4	104,100.0	294.7	0.36	0.2	0.6
Average/Sum#:	3,920.6	322.0	4,234.0	104,100.0	440.8	0.53	0.3	0.9
Minimum:	2,655.5	0.0	2,655.5	104,100.0	276.4	0.33	0.2	0.6
Maximum:	4,434.1	1,185.6	5,521.9	104,100.0	574.8	0.69	0.3	1.1
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1	Unit CT1	Unit CT1
	PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr					
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/01/2022 00:00	3,661.0	0.0	3,661.0	103,800.0	380.0	0.46	0.2	0.8
08/01/2022 01:00	2,775.3	0.0	2,775.3	103,800.0	288.1	0.35	0.2	0.6
08/01/2022 02:00	2,779.2	0.0	2,779.2	103,800.0	288.5	0.35	0.2	0.6
08/01/2022 03:00	3,705.5	72.4	3,725.8	103,800.0	386.7	0.47	0.2	0.8
08/01/2022 04:00	4,463.8	244.3	4,708.1	103,800.0	488.7	0.59	0.3	1.0
08/01/2022 05:00	4,467.6	638.6	5,106.2	103,800.0	530.0	0.64	0.3	1.1
08/01/2022 06:00	4,476.3	1,011.7	5,488.0	103,800.0	569.7	0.68	0.3	1.1
08/01/2022 07:00	4,482.8	222.7	4,705.5	103,800.0	488.4	0.59	0.3	1.0
08/01/2022 08:00	4,483.2	250.9	4,734.1	103,800.0	491.4	0.59	0.3	1.0
08/01/2022 09:00	4,479.0	318.3	4,797.3	103,800.0	498.0	0.60	0.3	1.0
08/01/2022 10:00	4,469.7	298.2	4,767.9	103,800.0	494.9	0.59	0.3	1.0
08/01/2022 11:00	4,452.8	332.2	4,785.0	103,800.0	496.7	0.60	0.3	1.0
08/01/2022 12:00	4,444.2	336.9	4,781.1	103,800.0	496.3	0.60	0.3	1.0
08/01/2022 13:00	4,436.5	355.7	4,792.2	103,800.0	497.4	0.60	0.3	1.0
08/01/2022 14:00	4,424.8	376.0	4,800.8	103,800.0	498.3	0.60	0.3	1.0
08/01/2022 15:00	4,406.8	428.9	4,835.7	103,800.0	501.9	0.60	0.3	1.0
08/01/2022 16:00	4,403.6	414.7	4,818.3	103,800.0	500.1	0.60	0.3	1.0
08/01/2022 17:00	4,396.3	411.0	4,807.3	103,800.0	499.0	0.60	0.3	1.0
08/01/2022 18:00	4,399.3	402.4	4,801.7	103,800.0	498.4	0.60	0.3	1.0
08/01/2022 19:00	4,399.3	397.3	4,796.6	103,800.0	497.9	0.60	0.3	1.0
08/01/2022 20:00	4,398.5	445.5	4,844.0	103,800.0	502.8	0.60	0.3	1.0
08/01/2022 21:00	4,409.0	439.4	4,848.4	103,800.0	503.3	0.60	0.3	1.0
08/01/2022 22:00	4,111.4	173.9	4,201.8	103,800.0	436.1	0.53	0.3	0.9
08/01/2022 23:00	2,796.2	0.0	2,796.2	103,800.0	290.2	0.35	0.2	0.6
Average/Sum#:	4,155.1	315.5	4,464.9	103,800.0	463.5	0.56	0.3	0.9
Minimum:	2,775.3	0.0	2,775.3	103,800.0	288.1	0.35	0.2	0.6
Maximum:	4,483.2	1,011.7	5,488.0	103,800.0	569.7	0.68	0.3	1.1
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 **To:** 09/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1	Unit CT1	Unit CT1
	PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr					
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/02/2022 00:00	2,753.0	0.0	2,753.0	103,800.0	285.8	0.34	0.2	0.6
08/02/2022 01:00	2,708.2	0.0	2,708.2	103,800.0	281.1	0.34	0.2	0.6
08/02/2022 02:00	2,658.6	0.0	2,658.6	103,800.0	276.0	0.33	0.2	0.6
08/02/2022 03:00	2,770.0	0.0	2,770.0	103,800.0	287.5	0.35	0.2	0.6
08/02/2022 04:00	3,714.1	81.1	3,736.0	103,800.0	387.8	0.47	0.2	0.8
08/02/2022 05:00	4,450.7	317.3	4,768.0	103,800.0	494.9	0.59	0.3	1.0
08/02/2022 06:00	3,600.8	76.6	3,623.8	103,800.0	376.2	0.46	0.2	0.8
08/02/2022 07:00	2,660.7	0.0	2,660.7	103,800.0	276.2	0.33	0.2	0.6
08/02/2022 08:00	2,662.3	0.0	2,662.3	103,800.0	276.3	0.33	0.2	0.6
08/02/2022 09:00	2,663.6	0.0	2,663.6	103,800.0	276.5	0.33	0.2	0.6
08/02/2022 10:00	2,663.0	0.0	2,663.0	103,800.0	276.4	0.33	0.2	0.6
08/02/2022 11:00	3,616.2	152.5	3,665.0	103,800.0	380.4	0.47	0.2	0.8
08/02/2022 12:00	4,342.9	642.3	4,985.2	103,800.0	517.5	0.62	0.3	1.0
08/02/2022 13:00	4,335.0	676.1	5,011.1	103,800.0	520.2	0.62	0.3	1.0
08/02/2022 14:00	4,331.8	632.7	4,964.5	103,800.0	515.3	0.62	0.3	1.0
08/02/2022 15:00	4,313.7	663.1	4,976.8	103,800.0	516.6	0.62	0.3	1.0
08/02/2022 16:00	4,308.9	1,316.0	5,624.9	103,800.0	583.9	0.70	0.4	1.2
08/02/2022 17:00	4,311.6	1,706.5	6,018.1	103,800.0	624.7	0.75	0.4	1.2
08/02/2022 18:00	4,326.2	786.4	5,112.6	103,800.0	530.7	0.64	0.3	1.1
08/02/2022 19:00	4,344.0	497.2	4,841.2	103,800.0	502.5	0.60	0.3	1.0
08/02/2022 20:00	4,375.9	530.8	4,906.7	103,800.0	509.3	0.61	0.3	1.0
08/02/2022 21:00	4,383.6	384.9	4,768.5	103,800.0	495.0	0.59	0.3	1.0
08/02/2022 22:00	4,397.4	377.3	4,774.7	103,800.0	495.6	0.60	0.3	1.0
08/02/2022 23:00	4,429.2	341.2	4,770.4	103,800.0	495.2	0.59	0.3	1.0
Average/Sum#:	3,713.4	382.6	4,087.0	103,800.0	424.2	0.51	0.3	0.9
Minimum:	2,658.6	0.0	2,658.6	103,800.0	276.0	0.33	0.2	0.6
Maximum:	4,450.7	1,706.5	6,018.1	103,800.0	624.7	0.75	0.4	1.2
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1	Unit CT1	Unit CT1
	PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr					
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/03/2022 00:00	3,192.0	2.4	3,192.1	103,800.0	331.3	0.40	0.2	0.7
08/03/2022 01:00	2,783.1	0.0	2,783.1	103,800.0	288.9	0.35	0.2	0.6
08/03/2022 02:00	2,778.5	0.0	2,778.5	103,800.0	288.4	0.35	0.2	0.6
08/03/2022 03:00	2,769.9	0.0	2,769.9	103,800.0	287.5	0.35	0.2	0.6
08/03/2022 04:00	3,702.3	73.5	3,722.9	103,800.0	386.4	0.47	0.2	0.8
08/03/2022 05:00	4,461.2	238.0	4,699.2	103,800.0	487.8	0.59	0.3	1.0
08/03/2022 06:00	3,359.3	1.7	3,359.3	103,800.0	348.7	0.42	0.2	0.7
08/03/2022 07:00	2,716.0	0.0	2,716.0	103,800.0	281.9	0.34	0.2	0.6
08/03/2022 08:00	2,780.6	0.0	2,780.6	103,800.0	288.6	0.35	0.2	0.6
08/03/2022 09:00	2,701.0	0.0	2,701.0	103,800.0	280.4	0.34	0.2	0.6
08/03/2022 10:00	2,673.7	0.0	2,673.7	103,800.0	277.5	0.33	0.2	0.6
08/03/2022 11:00	2,876.4	0.0	2,876.4	103,800.0	298.6	0.36	0.2	0.6
08/03/2022 12:00	3,282.2	0.0	3,282.2	103,800.0	340.7	0.41	0.2	0.7
08/03/2022 13:00	4,318.7	471.4	4,710.0	103,800.0	488.9	0.60	0.3	1.0
08/03/2022 14:00	4,309.7	735.6	5,045.3	103,800.0	523.7	0.63	0.3	1.0
08/03/2022 15:00	4,289.2	663.7	4,952.9	103,800.0	514.1	0.62	0.3	1.0
08/03/2022 16:00	4,283.8	711.3	4,995.1	103,800.0	518.5	0.62	0.3	1.0
08/03/2022 17:00	4,275.2	1,900.4	6,175.6	103,800.0	641.0	0.77	0.4	1.3
08/03/2022 18:00	4,291.5	1,896.5	6,188.0	103,800.0	642.3	0.77	0.4	1.3
08/03/2022 19:00	4,306.1	1,814.7	6,120.8	103,800.0	635.3	0.76	0.4	1.3
08/03/2022 20:00	4,317.8	1,356.3	5,674.1	103,800.0	589.0	0.71	0.4	1.2
08/03/2022 21:00	4,327.9	524.0	4,851.9	103,800.0	503.6	0.61	0.3	1.0
08/03/2022 22:00	4,343.6	439.8	4,783.4	103,800.0	496.5	0.60	0.3	1.0
08/03/2022 23:00	4,352.2	444.7	4,796.9	103,800.0	497.9	0.60	0.3	1.0
Average/Sum#:	3,645.5	469.8	4,109.5	103,800.0	426.6	0.51	0.3	0.9
Minimum:	2,673.7	0.0	2,673.7	103,800.0	277.5	0.33	0.2	0.6
Maximum:	4,461.2	1,900.4	6,188.0	103,800.0	642.3	0.77	0.4	1.3
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 **To:** 09/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1	Unit CT1	Unit CT1
	PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr					
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/04/2022 00:00	4,379.1	388.3	4,767.4	103,800.0	494.9	0.59	0.3	1.0
08/04/2022 01:00	4,384.5	367.9	4,752.4	103,800.0	493.3	0.59	0.3	1.0
08/04/2022 02:00	4,307.7	259.3	4,507.4	103,800.0	467.9	0.57	0.3	0.9
08/04/2022 03:00	2,810.7	0.0	2,810.7	103,800.0	291.8	0.35	0.2	0.6
08/04/2022 04:00	3,598.5	76.6	3,615.4	103,800.0	375.3	0.46	0.2	0.8
08/04/2022 05:00	4,408.9	338.2	4,747.1	103,800.0	492.7	0.59	0.3	1.0
08/04/2022 06:00	4,288.5	166.3	4,380.0	103,800.0	454.6	0.56	0.3	0.9
08/04/2022 07:00	3,674.6	0.0	3,674.6	103,800.0	381.4	0.46	0.2	0.8
08/04/2022 08:00	3,679.6	136.7	3,734.3	103,800.0	387.6	0.48	0.2	0.8
08/04/2022 09:00	4,386.2	396.8	4,783.0	103,800.0	496.5	0.60	0.3	1.0
08/04/2022 10:00	4,366.4	437.6	4,804.0	103,800.0	498.7	0.60	0.3	1.0
08/04/2022 11:00	4,366.3	506.2	4,872.5	103,800.0	505.8	0.61	0.3	1.0
08/04/2022 12:00	4,340.6	697.9	5,038.5	103,800.0	523.0	0.63	0.3	1.0
08/04/2022 13:00	4,319.6	1,074.8	5,394.4	103,800.0	559.9	0.67	0.3	1.1
08/04/2022 14:00	4,312.0	1,919.0	6,231.0	103,800.0	646.8	0.78	0.4	1.3
08/04/2022 15:00	4,310.8	1,800.3	6,111.1	103,800.0	634.3	0.76	0.4	1.3
08/04/2022 16:00	4,310.1	1,720.7	6,030.8	103,800.0	626.0	0.75	0.4	1.3
08/04/2022 17:00	4,313.8	1,572.4	5,886.2	103,800.0	611.0	0.73	0.4	1.2
08/04/2022 18:00	4,334.5	1,137.9	5,472.4	103,800.0	568.0	0.68	0.3	1.1
08/04/2022 19:00	4,362.2	805.6	5,167.8	103,800.0	536.4	0.64	0.3	1.1
08/04/2022 20:00	4,384.0	429.7	4,813.7	103,800.0	499.7	0.60	0.3	1.0
08/04/2022 21:00	4,394.4	355.6	4,750.0	103,800.0	493.1	0.59	0.3	1.0
08/04/2022 22:00	4,411.9	309.3	4,721.2	103,800.0	490.1	0.59	0.3	1.0
08/04/2022 23:00	3,644.9	1.7	3,644.9	103,800.0	378.3	0.45	0.2	0.8
Average/Sum#:	4,170.4	620.8	4,779.6	103,800.0	496.1	0.60	0.3	1.0
Minimum:	2,810.7	0.0	2,810.7	103,800.0	291.8	0.35	0.2	0.6
Maximum:	4,411.9	1,919.0	6,231.0	103,800.0	646.8	0.78	0.4	1.3
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 **To:** 09/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/05/2022 00:00	3,001.2	0.0	3,001.2	103,800.0	311.5	0.37	0.2	0.6
08/05/2022 01:00	2,816.2	0.0	2,816.2	103,800.0	292.3	0.35	0.2	0.6
08/05/2022 02:00	3,084.7	0.0	3,084.7	103,800.0	320.2	0.38	0.2	0.6
08/05/2022 03:00	2,778.7	0.0	2,778.7	103,800.0	288.4	0.35	0.2	0.6
08/05/2022 04:00	3,291.6	3.0	3,291.7	103,800.0	341.7	0.41	0.2	0.7
08/05/2022 05:00	4,474.2	203.2	4,677.4	103,800.0	485.5	0.58	0.3	1.0
08/05/2022 06:00	4,478.2	276.2	4,754.4	103,800.0	493.5	0.59	0.3	1.0
08/05/2022 07:00	4,478.4	206.0	4,684.4	103,800.0	486.2	0.58	0.3	1.0
08/05/2022 08:00	4,481.8	212.9	4,694.7	103,800.0	487.3	0.58	0.3	1.0
08/05/2022 09:00	4,474.1	234.9	4,709.0	103,800.0	488.8	0.59	0.3	1.0
08/05/2022 10:00	4,445.4	283.3	4,728.7	103,800.0	490.8	0.59	0.3	1.0
08/05/2022 11:00	4,419.4	362.6	4,782.0	103,800.0	496.4	0.60	0.3	1.0
08/05/2022 12:00	4,420.0	384.4	4,804.4	103,800.0	498.7	0.60	0.3	1.0
08/05/2022 13:00	4,416.2	379.9	4,796.1	103,800.0	497.8	0.60	0.3	1.0
08/05/2022 14:00	4,394.2	432.9	4,827.1	103,800.0	501.1	0.60	0.3	1.0
08/05/2022 15:00	4,389.3	439.7	4,829.0	103,800.0	501.3	0.60	0.3	1.0
08/05/2022 16:00	4,386.8	439.5	4,826.3	103,800.0	501.0	0.60	0.3	1.0
08/05/2022 17:00	4,385.8	459.7	4,845.5	103,800.0	503.0	0.60	0.3	1.0
08/05/2022 18:00	4,383.5	452.6	4,836.1	103,800.0	502.0	0.60	0.3	1.0
08/05/2022 19:00	4,393.3	418.9	4,812.2	103,800.0	499.5	0.60	0.3	1.0
08/05/2022 20:00	4,421.4	359.2	4,780.6	103,800.0	496.2	0.60	0.3	1.0
08/05/2022 21:00	4,431.4	327.1	4,758.5	103,800.0	493.9	0.59	0.3	1.0
08/05/2022 22:00	4,019.4	152.6	4,098.8	103,800.0	425.5	0.52	0.3	0.9
08/05/2022 23:00	2,746.5	0.0	2,746.5	103,800.0	285.1	0.34	0.2	0.6
Average/Sum#:	4,042.2	251.2	4,290.2	103,800.0	445.3	0.53	0.3	0.9
Minimum:	2,746.5	0.0	2,746.5	103,800.0	285.1	0.34	0.2	0.6
Maximum:	4,481.8	459.7	4,845.5	103,800.0	503.0	0.60	0.3	1.0
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 **To:** 09/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/06/2022 00:00	2,747.2	0.0	2,747.2	103,800.0	285.2	0.34	0.2	0.6
08/06/2022 01:00	2,717.4	0.0	2,717.4	103,800.0	282.1	0.34	0.2	0.6
08/06/2022 02:00	2,658.5	0.0	2,658.5	103,800.0	276.0	0.33	0.2	0.6
08/06/2022 03:00	2,655.8	0.0	2,655.8	103,800.0	275.7	0.33	0.2	0.6
08/06/2022 04:00	2,661.5	0.0	2,661.5	103,800.0	276.3	0.33	0.2	0.6
08/06/2022 05:00	2,720.2	0.0	2,720.2	103,800.0	282.4	0.34	0.2	0.6
08/06/2022 06:00	2,691.1	0.0	2,691.1	103,800.0	279.3	0.33	0.2	0.6
08/06/2022 07:00	2,669.3	0.0	2,669.3	103,800.0	277.1	0.33	0.2	0.6
08/06/2022 08:00	2,660.5	0.0	2,660.5	103,800.0	276.2	0.33	0.2	0.6
08/06/2022 09:00	2,659.5	0.0	2,659.5	103,800.0	276.1	0.33	0.2	0.6
08/06/2022 10:00	2,664.2	0.0	2,664.2	103,800.0	276.5	0.33	0.2	0.6
08/06/2022 11:00	2,673.0	0.0	2,673.0	103,800.0	277.5	0.33	0.2	0.6
08/06/2022 12:00	2,676.6	0.0	2,676.6	103,800.0	277.8	0.33	0.2	0.6
08/06/2022 13:00	2,677.5	0.0	2,677.5	103,800.0	277.9	0.33	0.2	0.6
08/06/2022 14:00	2,708.9	0.0	2,708.9	103,800.0	281.2	0.34	0.2	0.6
08/06/2022 15:00	2,682.5	0.0	2,682.5	103,800.0	278.4	0.33	0.2	0.6
08/06/2022 16:00	2,725.9	0.0	2,725.9	103,800.0	282.9	0.34	0.2	0.6
08/06/2022 17:00	2,834.6	0.0	2,834.6	103,800.0	294.2	0.35	0.2	0.6
08/06/2022 18:00	3,920.4	0.0	3,920.4	103,800.0	406.9	0.49	0.2	0.8
08/06/2022 19:00	4,018.5	86.8	4,042.8	103,800.0	419.6	0.51	0.3	0.9
08/06/2022 20:00	4,311.2	414.1	4,725.3	103,800.0	490.5	0.59	0.3	1.0
08/06/2022 21:00	3,982.9	171.2	4,071.9	103,800.0	422.7	0.52	0.3	0.9
08/06/2022 22:00	2,739.4	0.0	2,739.4	103,800.0	284.3	0.34	0.2	0.6
08/06/2022 23:00	2,756.8	0.0	2,756.8	103,800.0	286.2	0.34	0.2	0.6
Average/Sum#:	2,925.6	28.0	2,947.5	103,800.0	306.0	0.37	0.2	0.7
Minimum:	2,655.8	0.0	2,655.8	103,800.0	275.7	0.33	0.2	0.6
Maximum:	4,311.2	414.1	4,725.3	103,800.0	490.5	0.59	0.3	1.0
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1	Unit CT1	Unit CT1
	PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr					
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/07/2022 00:00	2,702.2	0.0	2,702.2	103,800.0	280.5	0.34	0.2	0.6
08/07/2022 01:00	2,779.9	0.0	2,779.9	103,800.0	288.6	0.35	0.2	0.6
08/07/2022 02:00	2,713.7	0.0	2,713.7	103,800.0	281.7	0.34	0.2	0.6
08/07/2022 03:00	2,656.4	0.0	2,656.4	103,800.0	275.7	0.33	0.2	0.6
08/07/2022 04:00	2,751.0	0.0	2,751.0	103,800.0	285.6	0.34	0.2	0.6
08/07/2022 05:00	2,747.3	0.0	2,747.3	103,800.0	285.2	0.34	0.2	0.6
08/07/2022 06:00	2,703.8	0.0	2,703.8	103,800.0	280.7	0.34	0.2	0.6
08/07/2022 07:00	2,673.9	0.0	2,673.9	103,800.0	277.6	0.33	0.2	0.6
08/07/2022 08:00	2,664.0	0.0	2,664.0	103,800.0	276.5	0.33	0.2	0.6
08/07/2022 09:00	2,658.1	0.0	2,658.1	103,800.0	275.9	0.33	0.2	0.6
08/07/2022 10:00	2,656.6	0.0	2,656.6	103,800.0	275.8	0.33	0.2	0.6
08/07/2022 11:00	2,667.3	0.0	2,667.3	103,800.0	276.9	0.33	0.2	0.6
08/07/2022 12:00	2,672.6	0.0	2,672.6	103,800.0	277.4	0.33	0.2	0.6
08/07/2022 13:00	2,686.8	0.0	2,686.8	103,800.0	278.9	0.33	0.2	0.6
08/07/2022 14:00	2,733.5	0.0	2,733.5	103,800.0	283.7	0.34	0.2	0.6
08/07/2022 15:00	2,701.9	0.0	2,701.9	103,800.0	280.5	0.34	0.2	0.6
08/07/2022 16:00	3,122.9	0.0	3,122.9	103,800.0	324.2	0.39	0.2	0.6
08/07/2022 17:00	4,264.0	241.3	4,389.5	103,800.0	455.6	0.56	0.3	0.9
08/07/2022 18:00	4,416.8	371.3	4,788.1	103,800.0	497.0	0.60	0.3	1.0
08/07/2022 19:00	4,423.5	328.0	4,751.5	103,800.0	493.2	0.59	0.3	1.0
08/07/2022 20:00	4,434.8	273.9	4,708.7	103,800.0	488.8	0.59	0.3	1.0
08/07/2022 21:00	4,442.5	256.1	4,698.6	103,800.0	487.7	0.59	0.3	1.0
08/07/2022 22:00	3,608.5	58.8	3,624.4	103,800.0	376.2	0.46	0.2	0.8
08/07/2022 23:00	2,778.6	0.0	2,778.6	103,800.0	288.4	0.35	0.2	0.6
Average/Sum#:	3,110.9	63.7	3,168.0	103,800.0	328.8	0.40	0.2	0.7
Minimum:	2,656.4	0.0	2,656.4	103,800.0	275.7	0.33	0.2	0.6
Maximum:	4,442.5	371.3	4,788.1	103,800.0	497.0	0.60	0.3	1.0
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 **To:** 09/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/08/2022 00:00	2,805.3	0.0	2,805.3	103,800.0	291.2	0.35	0.2	0.6
08/08/2022 01:00	2,778.2	0.0	2,778.2	103,800.0	288.4	0.35	0.2	0.6
08/08/2022 02:00	2,773.5	0.0	2,773.5	103,800.0	287.9	0.35	0.2	0.6
08/08/2022 03:00	2,774.9	0.0	2,774.9	103,800.0	288.0	0.35	0.2	0.6
08/08/2022 04:00	3,863.9	49.4	3,874.8	103,800.0	402.2	0.49	0.2	0.8
08/08/2022 05:00	4,481.5	208.9	4,690.4	103,800.0	486.9	0.58	0.3	1.0
08/08/2022 06:00	3,610.3	41.8	3,621.6	103,800.0	375.9	0.46	0.2	0.8
08/08/2022 07:00	2,721.9	0.0	2,721.9	103,800.0	282.5	0.34	0.2	0.6
08/08/2022 08:00	2,693.1	0.0	2,693.1	103,800.0	279.5	0.34	0.2	0.6
08/08/2022 09:00	2,731.4	0.0	2,731.4	103,800.0	283.5	0.34	0.2	0.6
08/08/2022 10:00	2,775.5	0.0	2,775.5	103,800.0	288.1	0.35	0.2	0.6
08/08/2022 11:00	3,805.1	127.5	3,845.9	103,800.0	399.2	0.49	0.2	0.8
08/08/2022 12:00	4,406.5	464.2	4,870.7	103,800.0	505.6	0.61	0.3	1.0
08/08/2022 13:00	3,255.7	1.9	3,255.7	103,800.0	337.9	0.41	0.2	0.7
08/08/2022 14:00	3,723.0	2.8	3,723.1	103,800.0	386.5	0.46	0.2	0.8
08/08/2022 15:00	4,361.5	461.0	4,822.5	103,800.0	500.6	0.60	0.3	1.0
08/08/2022 16:00	4,373.7	479.7	4,853.4	103,800.0	503.8	0.61	0.3	1.0
08/08/2022 17:00	4,391.8	830.7	5,222.5	103,800.0	542.1	0.65	0.3	1.1
08/08/2022 18:00	4,395.1	984.3	5,379.4	103,800.0	558.4	0.67	0.3	1.1
08/08/2022 19:00	4,412.1	1,215.7	5,627.8	103,800.0	584.2	0.70	0.4	1.2
08/08/2022 20:00	4,414.4	1,098.6	5,513.0	103,800.0	572.2	0.69	0.3	1.1
08/08/2022 21:00	4,427.0	478.9	4,905.9	103,800.0	509.2	0.61	0.3	1.0
08/08/2022 22:00	4,437.2	337.1	4,774.3	103,800.0	495.6	0.60	0.3	1.0
08/08/2022 23:00	4,447.9	243.7	4,691.6	103,800.0	487.0	0.58	0.3	1.0
Average/Sum#:	3,702.5	292.8	3,988.6	103,800.0	414.0	0.50	0.3	0.8
Minimum:	2,693.1	0.0	2,693.1	103,800.0	279.5	0.34	0.2	0.6
Maximum:	4,481.5	1,215.7	5,627.8	103,800.0	584.2	0.70	0.4	1.2
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1	Unit CT1	Unit CT1
	PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr					
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/09/2022 00:00	4,459.7	235.5	4,695.2	103,800.0	487.4	0.59	0.3	1.0
08/09/2022 01:00	4,458.4	229.3	4,687.7	103,800.0	486.6	0.58	0.3	1.0
08/09/2022 02:00	4,461.1	231.6	4,692.7	103,800.0	487.1	0.58	0.3	1.0
08/09/2022 03:00	4,463.5	228.8	4,692.3	103,800.0	487.1	0.58	0.3	1.0
08/09/2022 04:00	4,463.2	222.6	4,685.8	103,800.0	486.4	0.58	0.3	1.0
08/09/2022 05:00	4,470.8	214.6	4,685.4	103,800.0	486.3	0.58	0.3	1.0
08/09/2022 06:00	4,479.4	207.5	4,686.9	103,800.0	486.5	0.58	0.3	1.0
08/09/2022 07:00	4,476.2	213.8	4,690.0	103,800.0	486.8	0.58	0.3	1.0
08/09/2022 08:00	4,466.7	242.4	4,709.1	103,800.0	488.8	0.59	0.3	1.0
08/09/2022 09:00	4,452.1	278.1	4,730.2	103,800.0	491.0	0.59	0.3	1.0
08/09/2022 10:00	4,434.4	315.3	4,749.7	103,800.0	493.0	0.59	0.3	1.0
08/09/2022 11:00	4,436.6	345.9	4,782.5	103,800.0	496.4	0.60	0.3	1.0
08/09/2022 12:00	4,375.2	278.2	4,589.4	103,800.0	476.4	0.58	0.3	1.0
08/09/2022 13:00	2,874.6	0.0	2,874.6	103,800.0	298.4	0.36	0.2	0.6
08/09/2022 14:00	3,773.1	101.7	3,801.6	103,800.0	394.6	0.48	0.2	0.8
08/09/2022 15:00	4,405.2	406.7	4,811.9	103,800.0	499.5	0.60	0.3	1.0
08/09/2022 16:00	4,408.7	384.1	4,792.8	103,800.0	497.5	0.60	0.3	1.0
08/09/2022 17:00	4,406.3	405.7	4,812.0	103,800.0	499.5	0.60	0.3	1.0
08/09/2022 18:00	4,429.9	1,034.3	5,464.2	103,800.0	567.2	0.68	0.3	1.1
08/09/2022 19:00	4,450.5	639.8	5,090.3	103,800.0	528.4	0.63	0.3	1.1
08/09/2022 20:00	4,459.0	1,022.3	5,481.3	103,800.0	569.0	0.68	0.3	1.1
08/09/2022 21:00	4,466.0	701.6	5,167.6	103,800.0	536.4	0.64	0.3	1.1
08/09/2022 22:00	4,467.3	526.7	4,994.0	103,800.0	518.4	0.62	0.3	1.0
08/09/2022 23:00	4,427.4	231.5	4,605.7	103,800.0	478.1	0.58	0.3	1.0
Average/Sum#:	4,352.7	362.4	4,707.2	103,800.0	488.6	0.59	0.3	1.0
Minimum:	2,874.6	0.0	2,874.6	103,800.0	298.4	0.36	0.2	0.6
Maximum:	4,479.4	1,034.3	5,481.3	103,800.0	569.0	0.68	0.3	1.1
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1	Unit CT1	Unit CT1
	PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr					
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/10/2022 00:00	4,136.3	0.0	4,136.3	103,800.0	429.3	0.51	0.3	0.9
08/10/2022 01:00	4,247.1	0.0	4,247.1	103,800.0	440.8	0.53	0.3	0.9
08/10/2022 02:00	4,279.8	0.0	4,279.8	103,800.0	444.2	0.53	0.3	0.9
08/10/2022 03:00	4,479.5	38.9	4,488.1	103,800.0	465.9	0.56	0.3	0.9
08/10/2022 04:00	4,487.7	696.0	5,183.7	103,800.0	538.1	0.65	0.3	1.1
08/10/2022 05:00	4,493.4	470.3	4,963.7	103,800.0	515.2	0.62	0.3	1.0
08/10/2022 06:00	3,621.3	37.4	3,631.4	103,800.0	376.9	0.46	0.2	0.8
08/10/2022 07:00	2,751.9	0.0	2,751.9	103,800.0	285.6	0.34	0.2	0.6
08/10/2022 08:00	2,762.6	0.0	2,762.6	103,800.0	286.8	0.35	0.2	0.6
08/10/2022 09:00	2,743.9	0.0	2,743.9	103,800.0	284.8	0.34	0.2	0.6
08/10/2022 10:00	2,789.1	0.0	2,789.1	103,800.0	289.5	0.35	0.2	0.6
08/10/2022 11:00	3,019.3	0.0	3,019.3	103,800.0	313.4	0.38	0.2	0.6
08/10/2022 12:00	2,786.1	0.0	2,786.1	103,800.0	289.2	0.35	0.2	0.6
08/10/2022 13:00	3,066.6	0.0	3,066.6	103,800.0	318.3	0.38	0.2	0.6
08/10/2022 14:00	4,280.3	420.7	4,503.3	103,800.0	467.4	0.59	0.3	1.0
08/10/2022 15:00	4,422.0	749.7	5,171.7	103,800.0	536.8	0.64	0.3	1.1
08/10/2022 16:00	4,428.8	353.1	4,781.9	103,800.0	496.4	0.60	0.3	1.0
08/10/2022 17:00	4,428.7	493.7	4,922.4	103,800.0	510.9	0.61	0.3	1.0
08/10/2022 18:00	4,430.2	1,180.2	5,610.4	103,800.0	582.4	0.70	0.3	1.2
08/10/2022 19:00	4,432.1	1,059.4	5,491.5	103,800.0	570.0	0.68	0.3	1.1
08/10/2022 20:00	4,442.8	764.4	5,207.2	103,800.0	540.5	0.65	0.3	1.1
08/10/2022 21:00	4,445.1	540.4	4,985.5	103,800.0	517.5	0.62	0.3	1.0
08/10/2022 22:00	4,228.3	143.6	4,303.0	103,800.0	446.7	0.54	0.3	0.9
08/10/2022 23:00	4,139.4	0.0	4,139.4	103,800.0	429.7	0.52	0.3	0.9
Average/Sum#:	3,889.3	289.5	4,165.2	103,800.0	432.3	0.52	0.3	0.9
Minimum:	2,743.9	0.0	2,743.9	103,800.0	284.8	0.34	0.2	0.6
Maximum:	4,493.4	1,180.2	5,610.4	103,800.0	582.4	0.70	0.3	1.2
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1	Unit CT1	Unit CT1
	PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr					
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/11/2022 00:00	4,166.2	0.0	4,166.2	103,800.0	432.5	0.52	0.3	0.9
08/11/2022 01:00	4,125.4	0.0	4,125.4	103,800.0	428.2	0.51	0.3	0.9
08/11/2022 02:00	3,905.4	0.0	3,905.4	103,800.0	405.4	0.49	0.2	0.8
08/11/2022 03:00	4,045.8	0.0	4,045.8	103,800.0	420.0	0.51	0.3	0.8
08/11/2022 04:00	4,147.9	0.0	4,147.9	103,800.0	430.6	0.52	0.3	0.9
08/11/2022 05:00	4,240.4	0.0	4,240.4	103,800.0	440.2	0.53	0.3	0.9
08/11/2022 06:00	3,503.7	0.0	3,503.7	103,800.0	363.7	0.44	0.2	0.7
08/11/2022 07:00	3,131.9	0.0	3,131.9	103,800.0	325.1	0.39	0.2	0.6
08/11/2022 08:00	2,777.0	0.0	2,777.0	103,800.0	288.3	0.35	0.2	0.6
08/11/2022 09:00	2,774.5	0.0	2,774.5	103,800.0	288.0	0.35	0.2	0.6
08/11/2022 10:00	2,777.9	0.0	2,777.9	103,800.0	288.3	0.35	0.2	0.6
08/11/2022 11:00	3,778.8	0.0	3,778.8	103,800.0	392.2	0.47	0.2	0.8
08/11/2022 12:00	4,025.1	38.6	4,035.9	103,800.0	418.9	0.51	0.3	0.8
08/11/2022 13:00	4,410.2	1,037.9	5,448.1	103,800.0	565.5	0.68	0.3	1.1
08/11/2022 14:00	4,412.3	707.3	5,119.6	103,800.0	531.4	0.64	0.3	1.1
08/11/2022 15:00	4,408.1	997.4	5,405.5	103,800.0	561.1	0.67	0.3	1.1
08/11/2022 16:00	4,396.3	989.2	5,385.5	103,800.0	559.0	0.67	0.3	1.1
08/11/2022 17:00	4,397.6	1,092.4	5,490.0	103,800.0	569.9	0.68	0.3	1.1
08/11/2022 18:00	4,403.6	1,277.7	5,681.3	103,800.0	589.7	0.71	0.4	1.2
08/11/2022 19:00	4,410.7	1,058.3	5,469.0	103,800.0	567.7	0.68	0.3	1.1
08/11/2022 20:00	4,427.9	1,341.4	5,769.3	103,800.0	598.9	0.72	0.4	1.2
08/11/2022 21:00	4,404.3	301.0	4,639.1	103,800.0	481.5	0.59	0.3	1.0
08/11/2022 22:00	4,153.1	0.0	4,153.1	103,800.0	431.1	0.52	0.3	0.9
08/11/2022 23:00	4,167.4	0.0	4,167.4	103,800.0	432.6	0.52	0.3	0.9
Average/Sum#:	3,974.6	368.4	4,339.1	103,800.0	450.4	0.54	0.3	0.9
Minimum:	2,774.5	0.0	2,774.5	103,800.0	288.0	0.35	0.2	0.6
Maximum:	4,427.9	1,341.4	5,769.3	103,800.0	598.9	0.72	0.4	1.2
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1	Unit CT1	Unit CT1
	PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr					
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/12/2022 00:00	4,389.6	0.0	4,389.6	103,800.0	455.6	0.55	0.3	0.9
08/12/2022 01:00	4,314.2	0.0	4,314.2	103,800.0	447.8	0.54	0.3	0.9
08/12/2022 02:00	3,988.8	0.0	3,988.8	103,800.0	414.0	0.50	0.2	0.8
08/12/2022 03:00	4,153.7	0.0	4,153.7	103,800.0	431.2	0.52	0.3	0.9
08/12/2022 04:00	4,325.6	0.0	4,325.6	103,800.0	449.0	0.54	0.3	0.9
08/12/2022 05:00	4,311.6	0.0	4,311.6	103,800.0	447.5	0.54	0.3	0.9
08/12/2022 06:00	3,243.4	0.0	3,243.4	103,800.0	336.7	0.40	0.2	0.7
08/12/2022 07:00	3,164.7	0.0	3,164.7	103,800.0	328.5	0.39	0.2	0.7
08/12/2022 08:00	2,719.1	0.0	2,719.1	103,800.0	282.2	0.34	0.2	0.6
08/12/2022 09:00	2,721.8	0.0	2,721.8	103,800.0	282.5	0.34	0.2	0.6
08/12/2022 10:00	2,768.7	0.0	2,768.7	103,800.0	287.4	0.35	0.2	0.6
08/12/2022 11:00	2,753.6	0.0	2,753.6	103,800.0	285.8	0.34	0.2	0.6
08/12/2022 12:00	3,293.3	25.5	3,296.4	103,800.0	342.2	0.41	0.2	0.7
08/12/2022 13:00	4,408.0	381.2	4,777.8	103,800.0	495.9	0.60	0.3	1.0
08/12/2022 14:00	4,397.1	520.5	4,917.6	103,800.0	510.4	0.61	0.3	1.0
08/12/2022 15:00	4,398.7	487.4	4,886.1	103,800.0	507.2	0.61	0.3	1.0
08/12/2022 16:00	4,405.0	464.5	4,869.5	103,800.0	505.5	0.61	0.3	1.0
08/12/2022 17:00	4,408.5	1,070.0	5,478.5	103,800.0	568.7	0.68	0.3	1.1
08/12/2022 18:00	4,407.1	1,362.9	5,770.0	103,800.0	598.9	0.72	0.4	1.2
08/12/2022 19:00	4,415.3	884.4	5,299.7	103,800.0	550.1	0.66	0.3	1.1
08/12/2022 20:00	4,425.8	698.2	5,124.0	103,800.0	531.9	0.64	0.3	1.1
08/12/2022 21:00	4,390.8	314.3	4,636.0	103,800.0	481.2	0.59	0.3	1.0
08/12/2022 22:00	3,637.4	0.0	3,637.4	103,800.0	377.6	0.45	0.2	0.8
08/12/2022 23:00	4,095.8	0.0	4,095.8	103,800.0	425.1	0.51	0.3	0.9
Average/Sum#:	3,897.4	258.7	4,151.8	103,800.0	431.0	0.52	0.3	0.9
Minimum:	2,719.1	0.0	2,719.1	103,800.0	282.2	0.34	0.2	0.6
Maximum:	4,425.8	1,362.9	5,770.0	103,800.0	598.9	0.72	0.4	1.2
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1	Unit CT1	Unit CT1
	PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr					
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/13/2022 00:00	4,012.6	0.0	4,012.6	103,800.0	416.5	0.50	0.2	0.8
08/13/2022 01:00	4,047.7	0.0	4,047.7	103,800.0	420.2	0.50	0.3	0.8
08/13/2022 02:00	4,057.8	0.0	4,057.8	103,800.0	421.2	0.50	0.3	0.8
08/13/2022 03:00	4,130.0	0.0	4,130.0	103,800.0	428.7	0.51	0.3	0.9
08/13/2022 04:00	4,254.3	0.0	4,254.3	103,800.0	441.6	0.53	0.3	0.9
08/13/2022 05:00	4,216.8	0.0	4,216.8	103,800.0	437.7	0.52	0.3	0.9
08/13/2022 06:00	3,317.3	0.0	3,317.3	103,800.0	344.3	0.41	0.2	0.7
08/13/2022 07:00	2,724.2	0.0	2,724.2	103,800.0	282.8	0.34	0.2	0.6
08/13/2022 08:00	2,715.4	0.0	2,715.4	103,800.0	281.9	0.34	0.2	0.6
08/13/2022 09:00	2,768.6	0.0	2,768.6	103,800.0	287.4	0.35	0.2	0.6
08/13/2022 10:00	2,749.7	0.0	2,749.7	103,800.0	285.4	0.34	0.2	0.6
08/13/2022 11:00	2,782.1	0.0	2,782.1	103,800.0	288.8	0.35	0.2	0.6
08/13/2022 12:00	3,219.8	0.0	3,219.8	103,800.0	334.2	0.40	0.2	0.7
08/13/2022 13:00	3,786.8	138.3	3,842.1	103,800.0	398.8	0.49	0.2	0.8
08/13/2022 14:00	4,420.2	396.9	4,817.1	103,800.0	500.0	0.60	0.3	1.0
08/13/2022 15:00	4,400.6	429.3	4,829.9	103,800.0	501.3	0.60	0.3	1.0
08/13/2022 16:00	4,389.3	470.0	4,859.3	103,800.0	504.4	0.60	0.3	1.0
08/13/2022 17:00	4,390.6	913.5	5,304.1	103,800.0	550.6	0.66	0.3	1.1
08/13/2022 18:00	4,392.1	727.1	5,119.2	103,800.0	531.4	0.64	0.3	1.1
08/13/2022 19:00	4,401.8	390.3	4,792.1	103,800.0	497.4	0.60	0.3	1.0
08/13/2022 20:00	4,199.3	211.5	4,309.3	103,800.0	447.3	0.55	0.3	0.9
08/13/2022 21:00	2,943.6	0.0	2,943.6	103,800.0	305.5	0.37	0.2	0.6
08/13/2022 22:00	3,264.6	0.0	3,264.6	103,800.0	338.9	0.41	0.2	0.7
08/13/2022 23:00	3,913.0	0.0	3,913.0	103,800.0	406.2	0.49	0.2	0.8
Average/Sum#:	3,729.1	153.2	3,874.6	103,800.0	402.2	0.48	0.3	0.8
Minimum:	2,715.4	0.0	2,715.4	103,800.0	281.9	0.34	0.2	0.6
Maximum:	4,420.2	913.5	5,304.1	103,800.0	550.6	0.66	0.3	1.1
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 **To:** 09/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/14/2022 00:00	3,424.0	0.0	3,424.0	103,800.0	355.4	0.43	0.2	0.7
08/14/2022 01:00	3,582.6	0.0	3,582.6	103,800.0	371.9	0.45	0.2	0.7
08/14/2022 02:00	3,677.5	0.0	3,677.5	103,800.0	381.7	0.46	0.2	0.8
08/14/2022 03:00	3,666.4	0.0	3,666.4	103,800.0	380.6	0.46	0.2	0.8
08/14/2022 04:00	3,518.3	0.0	3,518.3	103,800.0	365.2	0.44	0.2	0.7
08/14/2022 05:00	3,269.4	0.0	3,269.4	103,800.0	339.4	0.41	0.2	0.7
08/14/2022 06:00	4,416.9	131.8	4,511.8	103,800.0	468.3	0.57	0.3	0.9
08/14/2022 07:00	4,427.1	128.2	4,525.8	103,800.0	469.8	0.57	0.3	0.9
08/14/2022 08:00	2,846.5	0.0	2,846.5	103,800.0	295.5	0.35	0.2	0.6
08/14/2022 09:00	2,765.4	0.0	2,765.4	103,800.0	287.0	0.34	0.2	0.6
08/14/2022 10:00	3,602.1	103.7	3,631.1	103,800.0	376.9	0.46	0.2	0.8
08/14/2022 11:00	4,412.2	492.0	4,904.2	103,800.0	509.1	0.61	0.3	1.0
08/14/2022 12:00	4,396.7	842.3	5,239.0	103,800.0	543.8	0.65	0.3	1.1
08/14/2022 13:00	4,390.0	514.5	4,904.5	103,800.0	509.1	0.61	0.3	1.0
08/14/2022 14:00	3,227.2	2.4	3,227.2	103,800.0	335.0	0.40	0.2	0.7
08/14/2022 15:00	3,336.7	0.0	3,336.7	103,800.0	346.3	0.42	0.2	0.7
08/14/2022 16:00	3,300.6	0.0	3,300.6	103,800.0	342.6	0.41	0.2	0.7
08/14/2022 17:00	4,211.3	96.9	4,232.6	103,800.0	439.3	0.54	0.3	0.9
08/14/2022 18:00	4,356.7	481.1	4,837.8	103,800.0	502.2	0.60	0.3	1.0
08/14/2022 19:00	4,356.2	463.7	4,819.9	103,800.0	500.3	0.60	0.3	1.0
08/14/2022 20:00	4,016.7	209.5	4,125.6	103,800.0	428.2	0.53	0.3	0.9
08/14/2022 21:00	2,843.6	0.0	2,843.6	103,800.0	295.2	0.36	0.2	0.6
08/14/2022 22:00	2,742.4	0.0	2,742.4	103,800.0	284.7	0.34	0.2	0.6
08/14/2022 23:00	2,777.7	0.0	2,777.7	103,800.0	288.3	0.34	0.2	0.6
Average/Sum#:	3,648.5	144.4	3,779.6	103,800.0	392.3	0.47	0.2	0.8
Minimum:	2,742.4	0.0	2,742.4	103,800.0	284.7	0.34	0.2	0.6
Maximum:	4,427.1	842.3	5,239.0	103,800.0	543.8	0.65	0.3	1.1
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1	Unit CT1	Unit CT1
	PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr					
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/15/2022 00:00	2,762.2	0.0	2,762.2	103,800.0	286.7	0.34	0.2	0.6
08/15/2022 01:00	2,753.0	0.0	2,753.0	103,800.0	285.8	0.34	0.2	0.6
08/15/2022 02:00	2,748.5	0.0	2,748.5	103,800.0	285.3	0.34	0.2	0.6
08/15/2022 03:00	2,918.3	0.0	2,918.3	103,800.0	302.9	0.36	0.2	0.6
08/15/2022 04:00	3,275.4	0.0	3,275.4	103,800.0	340.0	0.41	0.2	0.7
08/15/2022 05:00	3,709.0	0.0	3,709.0	103,800.0	385.0	0.46	0.2	0.8
08/15/2022 06:00	2,993.4	0.0	2,993.4	103,800.0	310.7	0.37	0.2	0.6
08/15/2022 07:00	2,701.6	0.0	2,701.6	103,800.0	280.4	0.34	0.2	0.6
08/15/2022 08:00	2,654.2	0.0	2,654.2	103,800.0	275.5	0.33	0.2	0.6
08/15/2022 09:00	2,722.9	0.0	2,722.9	103,800.0	282.6	0.34	0.2	0.6
08/15/2022 10:00	2,942.1	0.0	2,942.1	103,800.0	305.4	0.37	0.2	0.6
08/15/2022 11:00	2,782.3	0.0	2,782.3	103,800.0	288.8	0.35	0.2	0.6
08/15/2022 12:00	3,013.1	0.0	3,013.1	103,800.0	312.8	0.38	0.2	0.6
08/15/2022 13:00	4,301.3	440.8	4,587.8	103,800.0	476.2	0.59	0.3	1.0
08/15/2022 14:00	4,370.2	1,373.4	5,743.6	103,800.0	596.2	0.72	0.4	1.2
08/15/2022 15:00	4,356.8	1,436.9	5,793.7	103,800.0	601.4	0.72	0.4	1.2
08/15/2022 16:00	4,338.8	1,523.1	5,861.9	103,800.0	608.5	0.73	0.4	1.2
08/15/2022 17:00	4,334.8	1,537.3	5,872.1	103,800.0	609.5	0.73	0.4	1.2
08/15/2022 18:00	4,328.7	1,489.7	5,818.4	103,800.0	603.9	0.73	0.4	1.2
08/15/2022 19:00	4,345.3	1,115.4	5,460.7	103,800.0	566.8	0.68	0.3	1.1
08/15/2022 20:00	4,321.0	481.6	4,691.8	103,800.0	487.0	0.60	0.3	1.0
08/15/2022 21:00	3,726.7	0.0	3,726.7	103,800.0	386.8	0.46	0.2	0.8
08/15/2022 22:00	3,161.7	0.0	3,161.7	103,800.0	328.2	0.39	0.2	0.7
08/15/2022 23:00	3,614.1	0.0	3,614.1	103,800.0	375.1	0.45	0.2	0.7
Average/Sum#:	3,465.6	391.6	3,846.2	103,800.0	399.2	0.48	0.3	0.8
Minimum:	2,654.2	0.0	2,654.2	103,800.0	275.5	0.33	0.2	0.6
Maximum:	4,370.2	1,537.3	5,872.1	103,800.0	609.5	0.73	0.4	1.2
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1	Unit CT1	Unit CT1
	PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr					
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/16/2022 00:00	3,653.7	0.0	3,653.7	103,800.0	379.3	0.46	0.2	0.8
08/16/2022 01:00	3,427.2	0.0	3,427.2	103,800.0	355.7	0.43	0.2	0.7
08/16/2022 02:00	3,328.4	0.0	3,328.4	103,800.0	345.5	0.41	0.2	0.7
08/16/2022 03:00	3,234.6	0.0	3,234.6	103,800.0	335.8	0.40	0.2	0.7
08/16/2022 04:00	3,480.2	0.0	3,480.2	103,800.0	361.2	0.43	0.2	0.7
08/16/2022 05:00	3,979.6	0.0	3,979.6	103,800.0	413.1	0.50	0.2	0.8
08/16/2022 06:00	3,159.0	0.0	3,159.0	103,800.0	327.9	0.39	0.2	0.7
08/16/2022 07:00	2,690.8	0.0	2,690.8	103,800.0	279.3	0.34	0.2	0.6
08/16/2022 08:00	2,720.1	0.0	2,720.1	103,800.0	282.3	0.34	0.2	0.6
08/16/2022 09:00	3,020.7	0.0	3,020.7	103,800.0	313.5	0.38	0.2	0.6
08/16/2022 10:00	3,397.3	0.0	3,397.3	103,800.0	352.6	0.42	0.2	0.7
08/16/2022 11:00	3,723.7	0.0	3,723.7	103,800.0	386.5	0.46	0.2	0.8
08/16/2022 12:00	3,882.4	167.9	3,929.4	103,800.0	407.9	0.51	0.3	0.8
08/16/2022 13:00	4,324.0	1,671.7	5,995.7	103,800.0	622.4	0.75	0.4	1.2
08/16/2022 14:00	4,324.3	1,987.8	6,312.1	103,800.0	655.2	0.79	0.4	1.3
08/16/2022 15:00	4,314.8	2,032.4	6,347.2	103,800.0	658.8	0.79	0.4	1.3
08/16/2022 16:00	4,299.6	2,026.2	6,325.8	103,800.0	656.6	0.79	0.4	1.3
08/16/2022 17:00	4,300.3	2,025.1	6,325.4	103,800.0	656.6	0.79	0.4	1.3
08/16/2022 18:00	4,298.4	2,032.4	6,330.8	103,800.0	657.1	0.79	0.4	1.3
08/16/2022 19:00	4,310.5	1,731.8	6,042.3	103,800.0	627.2	0.75	0.4	1.3
08/16/2022 20:00	4,318.8	1,533.6	5,852.4	103,800.0	607.5	0.73	0.4	1.2
08/16/2022 21:00	4,347.9	1,040.0	5,387.9	103,800.0	559.3	0.67	0.3	1.1
08/16/2022 22:00	4,342.6	569.3	4,894.8	103,800.0	508.1	0.61	0.3	1.0
08/16/2022 23:00	4,186.8	19.9	4,188.4	103,800.0	434.8	0.52	0.3	0.9
Average/Sum#:	3,794.4	701.6	4,489.5	103,800.0	466.0	0.56	0.3	0.9
Minimum:	2,690.8	0.0	2,690.8	103,800.0	279.3	0.34	0.2	0.6
Maximum:	4,347.9	2,032.4	6,347.2	103,800.0	658.8	0.79	0.4	1.3
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1	Unit CT1	Unit CT1
						PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/17/2022 00:00	4,248.8	0.0	4,248.8	103,800.0	441.0	0.53	0.3	0.9
08/17/2022 01:00	4,069.9	0.0	4,069.9	103,800.0	422.5	0.51	0.3	0.8
08/17/2022 02:00	4,149.4	0.0	4,149.4	103,800.0	430.7	0.52	0.3	0.9
08/17/2022 03:00	4,086.5	0.0	4,086.5	103,800.0	424.2	0.51	0.3	0.8
08/17/2022 04:00	4,113.2	0.0	4,113.2	103,800.0	427.0	0.51	0.3	0.9
08/17/2022 05:00	4,298.4	0.0	4,298.4	103,800.0	446.2	0.54	0.3	0.9
08/17/2022 06:00	4,301.7	0.0	4,301.7	103,800.0	446.5	0.53	0.3	0.9
08/17/2022 07:00	3,983.2	0.0	3,983.2	103,800.0	413.5	0.51	0.3	0.9
08/17/2022 08:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/17/2022 09:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/17/2022 10:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/17/2022 11:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/17/2022 12:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/17/2022 13:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/17/2022 14:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/17/2022 15:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/17/2022 16:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/17/2022 17:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/17/2022 18:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/17/2022 19:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/17/2022 20:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/17/2022 21:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/17/2022 22:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/17/2022 23:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Average/Sum#:	4,156.4	0.0	4,156.4	103,800.0	431.5	0.52	0.3	0.9
Minimum:	3,983.2	0.0	3,983.2	103,800.0	413.5	0.51	0.3	0.8
Maximum:	4,301.7	0.0	4,301.7	103,800.0	446.5	0.54	0.3	0.9
%SI	66.67	66.67	66.67	0.00	66.67	66.67	66.67	66.67

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	> 4.73 Unit CT1 PM10_Norm, LbPerHr	> 1 Unit CT1 SO2_Norm, LbPerHr	> 1.8 Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/18/2022 00:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/18/2022 01:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/18/2022 02:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/18/2022 03:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/18/2022 04:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/18/2022 05:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/18/2022 06:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/18/2022 07:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/18/2022 08:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/18/2022 09:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/18/2022 10:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/18/2022 11:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/18/2022 12:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/18/2022 13:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/18/2022 14:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/18/2022 15:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/18/2022 16:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/18/2022 17:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/18/2022 18:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/18/2022 19:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/18/2022 20:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/18/2022 21:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/18/2022 22:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/18/2022 23:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Minimum:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Maximum:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1	Unit CT1	Unit CT1
	PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr					
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/19/2022 00:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/19/2022 01:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/19/2022 02:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/19/2022 03:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/19/2022 04:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/19/2022 05:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/19/2022 06:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/19/2022 07:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/19/2022 08:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/19/2022 09:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/19/2022 10:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/19/2022 11:00	2,728.8	0.0	2,728.8	103,800.0	283.2	0.00	0.0	0.0
08/19/2022 12:00	2,866.4	0.0	2,866.4	103,800.0	297.5	0.36	0.2	0.6
08/19/2022 13:00	2,668.4	0.0	2,668.4	103,800.0	277.0	0.33	0.2	0.6
08/19/2022 14:00	2,825.5	0.0	2,825.5	103,800.0	293.3	0.35	0.2	0.6
08/19/2022 15:00	2,875.4	0.0	2,875.4	103,800.0	298.5	0.36	0.2	0.6
08/19/2022 16:00	2,816.8	0.0	2,816.8	103,800.0	292.4	0.35	0.2	0.6
08/19/2022 17:00	3,892.3	0.0	3,892.3	103,800.0	404.0	0.48	0.2	0.8
08/19/2022 18:00	3,928.1	0.0	3,928.1	103,800.0	407.7	0.49	0.2	0.8
08/19/2022 19:00	3,629.9	0.0	3,629.9	103,800.0	376.8	0.45	0.2	0.8
08/19/2022 20:00	3,332.2	0.0	3,332.2	103,800.0	345.9	0.42	0.2	0.7
08/19/2022 21:00	3,013.2	0.0	3,013.2	103,800.0	312.8	0.38	0.2	0.6
08/19/2022 22:00	2,859.3	0.0	2,859.3	103,800.0	296.8	0.36	0.2	0.6
08/19/2022 23:00	2,895.7	0.0	2,895.7	103,800.0	300.6	0.36	0.2	0.6
Average/Sum#:	3,102.5	0.0	3,102.5	103,800.0	322.0	0.39	0.2	0.7
Minimum:	2,668.4	0.0	2,668.4	103,800.0	277.0	0.33	0.2	0.6
Maximum:	3,928.1	0.0	3,928.1	103,800.0	407.7	0.49	0.2	0.8
%SI	45.83	45.83	45.83	0.00	45.83	50.00	50.00	50.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1	Unit CT1	Unit CT1
	PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr					
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/20/2022 00:00	2,901.6	0.0	2,901.6	103,800.0	301.2	0.36	0.2	0.6
08/20/2022 01:00	2,881.9	0.0	2,881.9	103,800.0	299.1	0.36	0.2	0.6
08/20/2022 02:00	2,864.2	0.0	2,864.2	103,800.0	297.3	0.36	0.2	0.6
08/20/2022 03:00	2,770.6	0.0	2,770.6	103,800.0	287.6	0.34	0.2	0.6
08/20/2022 04:00	2,750.7	0.0	2,750.7	103,800.0	285.5	0.34	0.2	0.6
08/20/2022 05:00	2,748.9	0.0	2,748.9	103,800.0	285.3	0.34	0.2	0.6
08/20/2022 06:00	2,750.2	0.0	2,750.2	103,800.0	285.5	0.34	0.2	0.6
08/20/2022 07:00	2,759.0	0.0	2,759.0	103,800.0	286.4	0.34	0.2	0.6
08/20/2022 08:00	2,763.4	0.0	2,763.4	103,800.0	286.8	0.34	0.2	0.6
08/20/2022 09:00	2,762.9	0.0	2,762.9	103,800.0	286.8	0.34	0.2	0.6
08/20/2022 10:00	2,762.6	0.0	2,762.6	103,800.0	286.8	0.34	0.2	0.6
08/20/2022 11:00	2,752.0	0.0	2,752.0	103,800.0	285.7	0.34	0.2	0.6
08/20/2022 12:00	2,739.4	0.0	2,739.4	103,800.0	284.3	0.34	0.2	0.6
08/20/2022 13:00	2,742.3	0.0	2,742.3	103,800.0	284.7	0.34	0.2	0.6
08/20/2022 14:00	3,186.4	0.0	3,186.4	103,800.0	330.7	0.40	0.2	0.7
08/20/2022 15:00	4,030.3	0.0	4,030.3	103,800.0	418.3	0.52	0.3	0.9
08/20/2022 16:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/20/2022 17:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/20/2022 18:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/20/2022 19:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/20/2022 20:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/20/2022 21:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/20/2022 22:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/20/2022 23:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Average/Sum#:	2,885.4	0.0	2,885.4	103,800.0	299.5	0.36	0.2	0.6
Minimum:	2,739.4	0.0	2,739.4	103,800.0	284.3	0.34	0.2	0.6
Maximum:	4,030.3	0.0	4,030.3	103,800.0	418.3	0.52	0.3	0.9
%SI	33.33	33.33	33.33	0.00	33.33	33.33	33.33	33.33

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	> 4.73 Unit CT1 PM10_Norm, LbPerHr	> 1 Unit CT1 SO2_Norm, LbPerHr	> 1.8 Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/21/2022 00:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/21/2022 01:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/21/2022 02:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/21/2022 03:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/21/2022 04:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/21/2022 05:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/21/2022 06:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/21/2022 07:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/21/2022 08:00	2,474.5	0.0	2,474.5	103,800.0	256.9	0.00	0.0	0.0
08/21/2022 09:00	2,703.3	0.0	2,703.3	103,800.0	280.6	0.34	0.2	0.6
08/21/2022 10:00	2,982.2	0.0	2,982.2	103,800.0	309.6	0.37	0.2	0.6
08/21/2022 11:00	3,630.5	0.0	3,630.5	103,800.0	376.8	0.45	0.2	0.8
08/21/2022 12:00	4,397.1	0.0	4,397.1	103,800.0	456.4	0.55	0.3	0.9
08/21/2022 13:00	4,381.8	0.0	4,381.8	103,800.0	454.8	0.55	0.3	0.9
08/21/2022 14:00	4,380.7	0.0	4,380.7	103,800.0	454.7	0.55	0.3	0.9
08/21/2022 15:00	4,375.8	0.0	4,375.8	103,800.0	454.2	0.55	0.3	0.9
08/21/2022 16:00	4,362.9	11.9	4,364.3	103,800.0	453.0	0.54	0.3	0.9
08/21/2022 17:00	4,359.6	833.5	5,193.1	103,800.0	539.0	0.65	0.3	1.1
08/21/2022 18:00	4,374.6	792.0	5,166.6	103,800.0	536.3	0.64	0.3	1.1
08/21/2022 19:00	4,376.1	415.9	4,708.8	103,800.0	488.8	0.60	0.3	1.0
08/21/2022 20:00	4,402.6	1.4	4,402.6	103,800.0	457.0	0.55	0.3	0.9
08/21/2022 21:00	4,421.2	0.0	4,421.2	103,800.0	458.9	0.55	0.3	0.9
08/21/2022 22:00	4,439.8	0.0	4,439.8	103,800.0	460.9	0.55	0.3	0.9
08/21/2022 23:00	4,431.9	0.0	4,431.9	103,800.0	460.0	0.55	0.3	0.9
Average/Sum#:	4,030.9	128.4	4,153.4	103,800.0	431.1	0.53	0.3	0.9
Minimum:	2,474.5	0.0	2,474.5	103,800.0	256.9	0.34	0.2	0.6
Maximum:	4,439.8	833.5	5,193.1	103,800.0	539.0	0.65	0.3	1.1
%SI	33.33	33.33	33.33	0.00	33.33	37.50	37.50	37.50

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/22/2022 00:00	4,432.4	0.0	4,432.4	103,800.0	460.1	0.55	0.3	0.9
08/22/2022 01:00	4,430.1	0.0	4,430.1	103,800.0	459.8	0.55	0.3	0.9
08/22/2022 02:00	4,428.8	0.0	4,428.8	103,800.0	459.7	0.55	0.3	0.9
08/22/2022 03:00	4,429.7	3.9	4,429.9	103,800.0	459.8	0.55	0.3	0.9
08/22/2022 04:00	4,426.1	0.0	4,426.1	103,800.0	459.4	0.55	0.3	0.9
08/22/2022 05:00	4,397.7	0.0	4,397.7	103,800.0	456.5	0.55	0.3	0.9
08/22/2022 06:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/22/2022 07:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/22/2022 08:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/22/2022 09:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/22/2022 10:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/22/2022 11:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/22/2022 12:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/22/2022 13:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/22/2022 14:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/22/2022 15:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/22/2022 16:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/22/2022 17:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/22/2022 18:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/22/2022 19:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/22/2022 20:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/22/2022 21:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/22/2022 22:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/22/2022 23:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Average/Sum#:	4,424.1	0.7	4,424.2	103,800.0	459.2	0.55	0.3	0.9
Minimum:	4,397.7	0.0	4,397.7	103,800.0	456.5	0.55	0.3	0.9
Maximum:	4,432.4	3.9	4,432.4	103,800.0	460.1	0.55	0.3	0.9
%SI	75.00	75.00	75.00	0.00	75.00	75.00	75.00	75.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	> 4.73 Unit CT1 PM10_Norm, LbPerHr	> 1 Unit CT1 SO2_Norm, LbPerHr	> 1.8 Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/23/2022 00:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/23/2022 01:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/23/2022 02:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/23/2022 03:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/23/2022 04:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/23/2022 05:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/23/2022 06:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/23/2022 07:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/23/2022 08:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/23/2022 09:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/23/2022 10:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/23/2022 11:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/23/2022 12:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/23/2022 13:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/23/2022 14:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/23/2022 15:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/23/2022 16:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/23/2022 17:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/23/2022 18:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/23/2022 19:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/23/2022 20:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/23/2022 21:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/23/2022 22:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/23/2022 23:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Minimum:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Maximum:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1	Unit CT1	Unit CT1
	PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr					
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/24/2022 00:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/24/2022 01:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/24/2022 02:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/24/2022 03:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/24/2022 04:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/24/2022 05:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/24/2022 06:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/24/2022 07:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/24/2022 08:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/24/2022 09:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/24/2022 10:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/24/2022 11:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/24/2022 12:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/24/2022 13:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/24/2022 14:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/24/2022 15:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/24/2022 16:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/24/2022 17:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/24/2022 18:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/24/2022 19:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/24/2022 20:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/24/2022 21:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/24/2022 22:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/24/2022 23:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Minimum:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Maximum:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	> 4.73 Unit CT1 PM10_Norm, LbPerHr	> 1 Unit CT1 SO2_Norm, LbPerHr	> 1.8 Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/25/2022 00:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/25/2022 01:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/25/2022 02:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/25/2022 03:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/25/2022 04:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/25/2022 05:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/25/2022 06:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/25/2022 07:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/25/2022 08:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/25/2022 09:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/25/2022 10:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/25/2022 11:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/25/2022 12:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/25/2022 13:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/25/2022 14:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/25/2022 15:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/25/2022 16:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/25/2022 17:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/25/2022 18:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/25/2022 19:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/25/2022 20:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/25/2022 21:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/25/2022 22:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/25/2022 23:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Minimum:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
Maximum:	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	> 4.73 Unit CT1 PM10_Norm, LbPerHr	> 1 Unit CT1 SO2_Norm, LbPerHr	> 1.8 Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/26/2022 00:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/26/2022 01:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/26/2022 02:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/26/2022 03:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/26/2022 04:00	0.0	0.0	0.0	103,800.0	0.0	0.00	0.0	0.0
08/26/2022 05:00	1,721.8	0.0	1,721.8	103,800.0	178.7	0.00	0.0	0.0
08/26/2022 06:00	4,007.6	0.0	4,007.6	103,800.0	416.0	0.42	0.2	0.7
08/26/2022 07:00	2,672.5	0.0	2,672.5	103,800.0	277.4	0.33	0.2	0.6
08/26/2022 08:00	2,716.1	0.0	2,716.1	103,800.0	281.9	0.34	0.2	0.6
08/26/2022 09:00	3,787.0	0.0	3,787.0	103,800.0	393.1	0.47	0.2	0.8
08/26/2022 10:00	3,503.8	0.0	3,503.8	103,800.0	363.7	0.44	0.2	0.7
08/26/2022 11:00	3,803.1	148.0	3,844.5	103,800.0	399.1	0.49	0.2	0.8
08/26/2022 12:00	4,358.0	689.3	5,047.3	103,800.0	523.9	0.63	0.3	1.0
08/26/2022 13:00	4,346.0	1,421.0	5,767.0	103,800.0	598.6	0.72	0.4	1.2
08/26/2022 14:00	4,328.7	1,606.1	5,934.8	103,800.0	616.0	0.74	0.4	1.2
08/26/2022 15:00	4,324.7	1,447.5	5,772.2	103,800.0	599.2	0.72	0.4	1.2
08/26/2022 16:00	4,324.4	1,573.9	5,898.3	103,800.0	612.2	0.73	0.4	1.2
08/26/2022 17:00	4,336.5	1,929.6	6,266.1	103,800.0	650.4	0.78	0.4	1.3
08/26/2022 18:00	4,332.1	1,639.8	5,971.9	103,800.0	619.9	0.74	0.4	1.2
08/26/2022 19:00	4,326.1	1,738.8	6,064.9	103,800.0	629.5	0.76	0.4	1.3
08/26/2022 20:00	4,327.4	1,366.8	5,694.2	103,800.0	591.1	0.71	0.4	1.2
08/26/2022 21:00	4,293.9	1,191.3	5,485.2	103,800.0	569.4	0.68	0.3	1.1
08/26/2022 22:00	4,253.7	447.1	4,598.0	103,800.0	477.3	0.59	0.3	1.0
08/26/2022 23:00	4,145.4	0.0	4,145.4	103,800.0	430.3	0.52	0.3	0.9
Average/Sum#:	3,889.9	800.0	4,678.9	103,800.0	485.7	0.60	0.3	1.0
Minimum:	1,721.8	0.0	1,721.8	103,800.0	178.7	0.33	0.2	0.6
Maximum:	4,358.0	1,929.6	6,266.1	103,800.0	650.4	0.78	0.4	1.3
%SI	20.83	20.83	20.83	0.00	20.83	25.00	25.00	25.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1	Unit CT1	Unit CT1
	PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr					
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/27/2022 00:00	4,153.5	0.0	4,153.5	103,800.0	431.1	0.52	0.3	0.9
08/27/2022 01:00	4,132.6	0.0	4,132.6	103,800.0	429.0	0.51	0.3	0.9
08/27/2022 02:00	4,145.3	0.0	4,145.3	103,800.0	430.3	0.52	0.3	0.9
08/27/2022 03:00	4,147.0	0.0	4,147.0	103,800.0	430.5	0.52	0.3	0.9
08/27/2022 04:00	4,181.3	0.0	4,181.3	103,800.0	434.0	0.52	0.3	0.9
08/27/2022 05:00	4,178.0	0.0	4,178.0	103,800.0	433.7	0.52	0.3	0.9
08/27/2022 06:00	3,044.3	0.0	3,044.3	103,800.0	316.0	0.38	0.2	0.6
08/27/2022 07:00	2,628.8	0.0	2,628.8	103,800.0	272.9	0.33	0.2	0.5
08/27/2022 08:00	2,628.0	0.0	2,628.0	103,800.0	272.8	0.33	0.2	0.5
08/27/2022 09:00	2,649.2	0.0	2,649.2	103,800.0	275.0	0.33	0.2	0.5
08/27/2022 10:00	3,196.8	0.0	3,196.8	103,800.0	331.8	0.40	0.2	0.7
08/27/2022 11:00	3,927.7	98.3	3,949.3	103,800.0	409.9	0.50	0.3	0.8
08/27/2022 12:00	4,313.8	497.5	4,811.3	103,800.0	499.4	0.60	0.3	1.0
08/27/2022 13:00	4,293.8	545.8	4,839.6	103,800.0	502.4	0.60	0.3	1.0
08/27/2022 14:00	4,292.7	527.6	4,820.3	103,800.0	500.3	0.60	0.3	1.0
08/27/2022 15:00	4,286.5	523.5	4,810.0	103,800.0	499.3	0.60	0.3	1.0
08/27/2022 16:00	4,281.5	840.2	5,121.7	103,800.0	531.6	0.64	0.3	1.1
08/27/2022 17:00	4,278.1	1,365.8	5,643.9	103,800.0	585.8	0.70	0.4	1.2
08/27/2022 18:00	4,300.4	1,587.6	5,888.0	103,800.0	611.2	0.73	0.4	1.2
08/27/2022 19:00	4,314.6	1,448.9	5,763.5	103,800.0	598.3	0.72	0.4	1.2
08/27/2022 20:00	4,333.0	1,240.6	5,573.6	103,800.0	578.5	0.69	0.3	1.2
08/27/2022 21:00	4,292.5	449.0	4,638.2	103,800.0	481.4	0.59	0.3	1.0
08/27/2022 22:00	3,090.7	0.0	3,090.7	103,800.0	320.8	0.38	0.2	0.6
08/27/2022 23:00	3,366.5	0.0	3,366.5	103,800.0	349.4	0.42	0.2	0.7
Average/Sum#:	3,852.4	380.2	4,225.1	103,800.0	438.6	0.53	0.3	0.9
Minimum:	2,628.0	0.0	2,628.0	103,800.0	272.8	0.33	0.2	0.5
Maximum:	4,333.0	1,587.6	5,888.0	103,800.0	611.2	0.73	0.4	1.2
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 **To:** 09/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1	Unit CT1	Unit CT1
	PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr					
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/28/2022 00:00	2,760.6	0.0	2,760.6	103,800.0	286.6	0.34	0.2	0.6
08/28/2022 01:00	2,756.0	0.0	2,756.0	103,800.0	286.1	0.34	0.2	0.6
08/28/2022 02:00	2,739.6	0.0	2,739.6	103,800.0	284.4	0.34	0.2	0.6
08/28/2022 03:00	2,766.7	0.0	2,766.7	103,800.0	287.2	0.34	0.2	0.6
08/28/2022 04:00	2,745.3	0.0	2,745.3	103,800.0	285.0	0.34	0.2	0.6
08/28/2022 05:00	2,792.1	0.0	2,792.1	103,800.0	289.8	0.35	0.2	0.6
08/28/2022 06:00	2,679.7	0.0	2,679.7	103,800.0	278.2	0.33	0.2	0.6
08/28/2022 07:00	2,637.8	0.0	2,637.8	103,800.0	273.8	0.33	0.2	0.5
08/28/2022 08:00	2,638.1	0.0	2,638.1	103,800.0	273.8	0.33	0.2	0.5
08/28/2022 09:00	2,641.4	0.0	2,641.4	103,800.0	274.2	0.33	0.2	0.5
08/28/2022 10:00	2,651.4	0.0	2,651.4	103,800.0	275.2	0.33	0.2	0.5
08/28/2022 11:00	2,671.1	0.0	2,671.1	103,800.0	277.3	0.33	0.2	0.6
08/28/2022 12:00	3,383.3	0.0	3,383.3	103,800.0	351.2	0.42	0.2	0.7
08/28/2022 13:00	3,488.7	0.0	3,488.7	103,800.0	362.1	0.43	0.2	0.7
08/28/2022 14:00	3,915.1	0.0	3,915.1	103,800.0	406.4	0.49	0.2	0.8
08/28/2022 15:00	3,085.6	0.0	3,085.6	103,800.0	320.3	0.38	0.2	0.6
08/28/2022 16:00	4,088.7	352.6	4,240.3	103,800.0	440.1	0.55	0.3	0.9
08/28/2022 17:00	4,301.3	1,798.7	6,100.0	103,800.0	633.2	0.76	0.4	1.3
08/28/2022 18:00	4,358.3	674.8	5,033.1	103,800.0	522.4	0.63	0.3	1.0
08/28/2022 19:00	4,378.0	328.0	4,706.0	103,800.0	488.5	0.58	0.3	1.0
08/28/2022 20:00	4,028.0	159.7	4,111.0	103,800.0	426.7	0.52	0.3	0.9
08/28/2022 21:00	3,431.3	0.0	3,431.3	103,800.0	356.2	0.43	0.2	0.7
08/28/2022 22:00	2,810.6	0.0	2,810.6	103,800.0	291.7	0.35	0.2	0.6
08/28/2022 23:00	3,703.7	0.0	3,703.7	103,800.0	384.4	0.46	0.2	0.8
Average/Sum#:	3,227.2	138.1	3,353.7	103,800.0	348.1	0.42	0.2	0.7
Minimum:	2,637.8	0.0	2,637.8	103,800.0	273.8	0.33	0.2	0.5
Maximum:	4,378.0	1,798.7	6,100.0	103,800.0	633.2	0.76	0.4	1.3
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 **To:** 09/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/29/2022 00:00	3,648.3	0.0	3,648.3	103,800.0	378.7	0.45	0.2	0.8
08/29/2022 01:00	3,698.7	0.0	3,698.7	103,800.0	383.9	0.46	0.2	0.8
08/29/2022 02:00	3,866.7	0.0	3,866.7	103,800.0	401.4	0.48	0.2	0.8
08/29/2022 03:00	3,668.4	0.0	3,668.4	103,800.0	380.8	0.46	0.2	0.8
08/29/2022 04:00	3,887.0	0.0	3,887.0	103,800.0	403.5	0.48	0.2	0.8
08/29/2022 05:00	4,154.9	0.0	4,154.9	103,800.0	431.3	0.52	0.3	0.9
08/29/2022 06:00	3,143.4	0.0	3,143.4	103,800.0	326.3	0.39	0.2	0.7
08/29/2022 07:00	2,701.6	0.0	2,701.6	103,800.0	280.4	0.34	0.2	0.6
08/29/2022 08:00	2,645.2	0.0	2,645.2	103,800.0	274.6	0.33	0.2	0.5
08/29/2022 09:00	2,750.2	0.0	2,750.2	103,800.0	285.5	0.34	0.2	0.6
08/29/2022 10:00	2,729.4	0.0	2,729.4	103,800.0	283.3	0.34	0.2	0.6
08/29/2022 11:00	2,777.0	0.0	2,777.0	103,800.0	288.3	0.35	0.2	0.6
08/29/2022 12:00	2,765.1	0.0	2,765.1	103,800.0	287.0	0.34	0.2	0.6
08/29/2022 13:00	3,261.6	0.0	3,261.6	103,800.0	338.6	0.41	0.2	0.7
08/29/2022 14:00	3,886.3	99.6	3,908.2	103,800.0	405.7	0.50	0.2	0.8
08/29/2022 15:00	4,304.2	707.1	5,011.3	103,800.0	520.2	0.63	0.3	1.0
08/29/2022 16:00	4,299.8	868.9	5,168.7	103,800.0	536.5	0.64	0.3	1.1
08/29/2022 17:00	4,296.2	1,479.1	5,775.3	103,800.0	599.5	0.72	0.4	1.2
08/29/2022 18:00	4,319.1	1,246.1	5,565.2	103,800.0	577.7	0.69	0.3	1.2
08/29/2022 19:00	4,333.7	991.5	5,325.2	103,800.0	552.8	0.66	0.3	1.1
08/29/2022 20:00	4,339.1	784.1	5,123.2	103,800.0	531.8	0.64	0.3	1.1
08/29/2022 21:00	4,295.6	499.4	4,680.1	103,800.0	485.8	0.60	0.3	1.0
08/29/2022 22:00	3,945.7	0.0	3,945.7	103,800.0	409.6	0.49	0.2	0.8
08/29/2022 23:00	4,341.5	0.0	4,341.5	103,800.0	450.6	0.54	0.3	0.9
Average/Sum#:	3,669.1	278.2	3,939.2	103,800.0	408.9	0.49	0.2	0.8
Minimum:	2,645.2	0.0	2,645.2	103,800.0	274.6	0.33	0.2	0.5
Maximum:	4,341.5	1,479.1	5,775.3	103,800.0	599.5	0.72	0.4	1.2
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1	Unit CT1	Unit CT1
	PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr					
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/30/2022 00:00	4,230.4	0.0	4,230.4	103,800.0	439.1	0.53	0.3	0.9
08/30/2022 01:00	4,045.4	0.0	4,045.4	103,800.0	419.9	0.50	0.3	0.8
08/30/2022 02:00	4,015.7	0.0	4,015.7	103,800.0	416.8	0.50	0.3	0.8
08/30/2022 03:00	4,003.1	0.0	4,003.1	103,800.0	415.5	0.50	0.2	0.8
08/30/2022 04:00	4,208.6	0.0	4,208.6	103,800.0	436.9	0.52	0.3	0.9
08/30/2022 05:00	4,405.9	0.0	4,405.9	103,800.0	457.3	0.55	0.3	0.9
08/30/2022 06:00	2,983.6	0.0	2,983.6	103,800.0	309.7	0.37	0.2	0.6
08/30/2022 07:00	2,662.4	0.0	2,662.4	103,800.0	276.4	0.33	0.2	0.6
08/30/2022 08:00	3,030.3	0.0	3,030.3	103,800.0	314.5	0.38	0.2	0.6
08/30/2022 09:00	3,390.9	0.0	3,390.9	103,800.0	352.0	0.42	0.2	0.7
08/30/2022 10:00	3,899.9	0.0	3,899.9	103,800.0	404.8	0.49	0.2	0.8
08/30/2022 11:00	4,251.0	0.0	4,251.0	103,800.0	441.3	0.53	0.3	0.9
08/30/2022 12:00	4,208.7	0.0	4,208.7	103,800.0	436.9	0.52	0.3	0.9
08/30/2022 13:00	4,259.4	184.8	4,311.1	103,800.0	447.5	0.55	0.3	0.9
08/30/2022 14:00	4,274.2	1,590.4	5,864.6	103,800.0	608.7	0.73	0.4	1.2
08/30/2022 15:00	4,262.1	1,784.7	6,046.8	103,800.0	627.7	0.75	0.4	1.3
08/30/2022 16:00	4,267.6	1,720.6	5,988.2	103,800.0	621.6	0.75	0.4	1.2
08/30/2022 17:00	4,285.2	2,021.1	6,306.3	103,800.0	654.6	0.79	0.4	1.3
08/30/2022 18:00	4,304.2	2,022.3	6,326.5	103,800.0	656.7	0.79	0.4	1.3
08/30/2022 19:00	4,309.6	1,893.3	6,202.9	103,800.0	643.9	0.77	0.4	1.3
08/30/2022 20:00	4,317.7	1,530.7	5,848.4	103,800.0	607.1	0.73	0.4	1.2
08/30/2022 21:00	4,325.9	1,232.5	5,558.4	103,800.0	577.0	0.69	0.3	1.2
08/30/2022 22:00	4,296.7	503.9	4,684.7	103,800.0	486.3	0.60	0.3	1.0
08/30/2022 23:00	4,346.9	0.7	4,346.9	103,800.0	451.2	0.54	0.3	0.9
Average/Sum#:	4,024.4	603.5	4,617.5	103,800.0	479.3	0.58	0.3	1.0
Minimum:	2,662.4	0.0	2,662.4	103,800.0	276.4	0.33	0.2	0.6
Maximum:	4,405.9	2,022.3	6,326.5	103,800.0	656.7	0.79	0.4	1.3
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1	Unit CT1	Unit CT1
	PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr					
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/31/2022 00:00	4,353.1	0.0	4,353.1	103,800.0	451.9	0.54	0.3	0.9
08/31/2022 01:00	4,364.1	0.0	4,364.1	103,800.0	453.0	0.54	0.3	0.9
08/31/2022 02:00	4,369.6	0.0	4,369.6	103,800.0	453.6	0.54	0.3	0.9
08/31/2022 03:00	4,359.7	0.0	4,359.7	103,800.0	452.5	0.55	0.3	0.9
08/31/2022 04:00	4,396.4	0.0	4,396.4	103,800.0	456.3	0.55	0.3	0.9
08/31/2022 05:00	4,398.1	0.0	4,398.1	103,800.0	456.5	0.55	0.3	0.9
08/31/2022 06:00	3,980.3	0.0	3,980.3	103,800.0	413.2	0.50	0.2	0.8
08/31/2022 07:00	3,615.8	0.0	3,615.8	103,800.0	375.3	0.45	0.2	0.8
08/31/2022 08:00	3,604.8	0.0	3,604.8	103,800.0	374.2	0.45	0.2	0.7
08/31/2022 09:00	3,817.8	0.0	3,817.8	103,800.0	396.3	0.48	0.2	0.8
08/31/2022 10:00	4,233.6	51.6	4,240.3	103,800.0	440.1	0.53	0.3	0.9
08/31/2022 11:00	4,339.0	1,403.9	5,742.9	103,800.0	596.1	0.72	0.4	1.2
08/31/2022 12:00	4,306.6	1,664.6	5,971.2	103,800.0	619.8	0.74	0.4	1.2
08/31/2022 13:00	4,283.5	1,813.9	6,097.4	103,800.0	632.9	0.76	0.4	1.3
08/31/2022 14:00	4,276.7	1,645.6	5,922.3	103,800.0	614.7	0.74	0.4	1.2
08/31/2022 15:00	4,287.0	1,268.5	5,555.5	103,800.0	576.7	0.69	0.3	1.2
08/31/2022 16:00	4,268.8	990.9	5,259.7	103,800.0	546.0	0.66	0.3	1.1
08/31/2022 17:00	4,275.6	1,768.7	6,044.3	103,800.0	627.4	0.75	0.4	1.3
08/31/2022 18:00	4,287.2	1,894.3	6,181.5	103,800.0	641.6	0.77	0.4	1.3
08/31/2022 19:00	4,307.5	1,425.8	5,733.3	103,800.0	595.1	0.71	0.4	1.2
08/31/2022 20:00	4,320.8	852.8	5,173.6	103,800.0	537.0	0.64	0.3	1.1
08/31/2022 21:00	4,317.4	1,041.6	5,359.0	103,800.0	556.3	0.67	0.3	1.1
08/31/2022 22:00	4,338.6	535.1	4,873.7	103,800.0	505.9	0.61	0.3	1.0
08/31/2022 23:00	4,349.0	814.8	5,163.8	103,800.0	536.0	0.64	0.3	1.1
Average/Sum#:	4,227.1	715.5	4,940.8	103,800.0	512.9	0.62	0.3	1.0
Minimum:	3,604.8	0.0	3,604.8	103,800.0	374.2	0.45	0.2	0.7
Maximum:	4,398.1	1,894.3	6,181.5	103,800.0	641.6	0.77	0.4	1.3
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1	Unit CT1	Unit CT1
						PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/01/2022 00:00	4,350.5	852.2	5,202.7	103,800.0	540.0	0.65	0.3	1.1
09/01/2022 01:00	4,346.6	325.0	4,596.9	103,800.0	477.2	0.58	0.3	1.0
09/01/2022 02:00	4,218.6	0.0	4,218.6	103,800.0	437.9	0.53	0.3	0.9
09/01/2022 03:00	4,292.1	0.0	4,292.1	103,800.0	445.5	0.53	0.3	0.9
09/01/2022 04:00	4,244.4	0.0	4,244.4	103,800.0	440.6	0.53	0.3	0.9
09/01/2022 05:00	4,263.9	0.0	4,263.9	103,800.0	442.6	0.53	0.3	0.9
09/01/2022 06:00	4,193.0	0.0	4,193.0	103,800.0	435.2	0.52	0.3	0.9
09/01/2022 07:00	4,231.4	0.0	4,231.4	103,800.0	439.2	0.53	0.3	0.9
09/01/2022 08:00	2,843.7	0.0	2,843.7	103,800.0	295.2	0.35	0.2	0.6
09/01/2022 09:00	2,811.6	0.0	2,811.6	103,800.0	291.8	0.35	0.2	0.6
09/01/2022 10:00	2,905.3	0.0	2,905.3	103,800.0	301.6	0.36	0.2	0.6
09/01/2022 11:00	3,824.1	134.8	3,861.8	103,800.0	400.9	0.49	0.2	0.8
09/01/2022 12:00	4,268.3	1,405.0	5,673.3	103,800.0	588.9	0.71	0.4	1.2
09/01/2022 13:00	4,240.7	1,571.0	5,811.7	103,800.0	603.3	0.72	0.4	1.2
09/01/2022 14:00	4,234.2	1,691.0	5,925.2	103,800.0	615.0	0.74	0.4	1.2
09/01/2022 15:00	4,221.7	1,919.8	6,141.5	103,800.0	637.5	0.76	0.4	1.3
09/01/2022 16:00	4,220.1	1,684.1	5,904.2	103,800.0	612.9	0.74	0.4	1.2
09/01/2022 17:00	4,211.9	1,939.4	6,151.3	103,800.0	638.5	0.77	0.4	1.3
09/01/2022 18:00	4,223.4	1,929.1	6,152.5	103,800.0	638.6	0.77	0.4	1.3
09/01/2022 19:00	4,237.7	1,569.1	5,806.8	103,800.0	602.7	0.72	0.4	1.2
09/01/2022 20:00	4,271.2	1,711.2	5,982.4	103,800.0	621.0	0.74	0.4	1.2
09/01/2022 21:00	4,259.7	1,573.4	5,833.1	103,800.0	605.5	0.73	0.4	1.2
09/01/2022 22:00	4,279.3	1,275.2	5,554.5	103,800.0	576.6	0.69	0.3	1.2
09/01/2022 23:00	4,296.7	1,303.5	5,600.2	103,800.0	581.3	0.70	0.3	1.2
Average/Sum#:	4,062.1	870.2	4,925.1	103,800.0	511.2	0.61	0.3	1.0
Minimum:	2,811.6	0.0	2,811.6	103,800.0	291.8	0.35	0.2	0.6
Maximum:	4,350.5	1,939.4	6,152.5	103,800.0	638.6	0.77	0.4	1.3
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 **To:** 09/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/02/2022 00:00	4,291.8	1,046.0	5,337.8	103,800.0	554.1	0.67	0.3	1.1
09/02/2022 01:00	4,302.7	940.1	5,242.8	103,800.0	544.2	0.65	0.3	1.1
09/02/2022 02:00	4,320.0	776.8	5,096.8	103,800.0	529.0	0.64	0.3	1.1
09/02/2022 03:00	4,308.3	756.8	5,065.1	103,800.0	525.8	0.63	0.3	1.1
09/02/2022 04:00	4,326.2	969.2	5,295.4	103,800.0	549.7	0.66	0.3	1.1
09/02/2022 05:00	4,341.6	1,179.1	5,520.7	103,800.0	573.0	0.69	0.3	1.1
09/02/2022 06:00	4,369.8	560.4	4,930.2	103,800.0	511.8	0.61	0.3	1.0
09/02/2022 07:00	4,372.1	294.9	4,667.0	103,800.0	484.4	0.58	0.3	1.0
09/02/2022 08:00	4,350.0	480.2	4,830.2	103,800.0	501.4	0.60	0.3	1.0
09/02/2022 09:00	4,326.6	834.3	5,160.9	103,800.0	535.7	0.64	0.3	1.1
09/02/2022 10:00	4,307.3	1,064.8	5,372.1	103,800.0	557.6	0.67	0.3	1.1
09/02/2022 11:00	4,289.9	1,208.2	5,498.1	103,800.0	570.7	0.69	0.3	1.1
09/02/2022 12:00	4,265.1	1,356.5	5,621.6	103,800.0	583.5	0.70	0.4	1.2
09/02/2022 13:00	4,249.2	1,617.2	5,866.4	103,800.0	608.9	0.73	0.4	1.2
09/02/2022 14:00	4,250.9	1,606.1	5,857.0	103,800.0	608.0	0.73	0.4	1.2
09/02/2022 15:00	4,253.0	992.7	5,245.7	103,800.0	544.5	0.65	0.3	1.1
09/02/2022 16:00	4,250.1	877.3	5,127.4	103,800.0	532.2	0.64	0.3	1.1
09/02/2022 17:00	4,250.2	926.9	5,177.1	103,800.0	537.4	0.64	0.3	1.1
09/02/2022 18:00	4,274.2	1,118.9	5,393.1	103,800.0	559.8	0.67	0.3	1.1
09/02/2022 19:00	4,281.2	1,259.9	5,541.1	103,800.0	575.2	0.69	0.3	1.2
09/02/2022 20:00	4,277.0	1,130.1	5,407.1	103,800.0	561.3	0.67	0.3	1.1
09/02/2022 21:00	4,289.4	756.2	5,045.6	103,800.0	523.7	0.63	0.3	1.0
09/02/2022 22:00	4,305.2	379.9	4,597.7	103,800.0	477.2	0.58	0.3	1.0
09/02/2022 23:00	3,376.4	0.0	3,376.4	103,800.0	350.5	0.42	0.2	0.7
Average/Sum#:	4,259.5	922.2	5,178.1	103,800.0	537.5	0.65	0.3	1.1
Minimum:	3,376.4	0.0	3,376.4	103,800.0	350.5	0.42	0.2	0.7
Maximum:	4,372.1	1,617.2	5,866.4	103,800.0	608.9	0.73	0.4	1.2
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1	Unit CT1	Unit CT1
	PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr					
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/03/2022 00:00	3,714.8	0.0	3,714.8	103,800.0	385.6	0.46	0.2	0.8
09/03/2022 01:00	2,802.2	0.0	2,802.2	103,800.0	290.9	0.35	0.2	0.6
09/03/2022 02:00	2,729.8	0.0	2,729.8	103,800.0	283.4	0.34	0.2	0.6
09/03/2022 03:00	2,739.5	0.0	2,739.5	103,800.0	284.4	0.34	0.2	0.6
09/03/2022 04:00	2,693.6	0.0	2,693.6	103,800.0	279.6	0.34	0.2	0.6
09/03/2022 05:00	2,726.4	0.0	2,726.4	103,800.0	283.0	0.34	0.2	0.6
09/03/2022 06:00	2,631.7	0.0	2,631.7	103,800.0	273.2	0.33	0.2	0.5
09/03/2022 07:00	2,631.8	0.0	2,631.8	103,800.0	273.2	0.33	0.2	0.5
09/03/2022 08:00	2,614.6	0.0	2,614.6	103,800.0	271.4	0.33	0.2	0.5
09/03/2022 09:00	2,680.0	0.0	2,680.0	103,800.0	278.2	0.33	0.2	0.6
09/03/2022 10:00	2,691.1	0.0	2,691.1	103,800.0	279.3	0.34	0.2	0.6
09/03/2022 11:00	2,659.9	0.0	2,659.9	103,800.0	276.1	0.33	0.2	0.6
09/03/2022 12:00	3,243.9	49.3	3,250.3	103,800.0	337.4	0.41	0.2	0.7
09/03/2022 13:00	4,282.7	550.3	4,833.0	103,800.0	501.7	0.60	0.3	1.0
09/03/2022 14:00	4,243.9	445.9	4,636.3	103,800.0	481.2	0.58	0.3	1.0
09/03/2022 15:00	3,500.5	196.5	3,573.2	103,800.0	370.9	0.46	0.2	0.8
09/03/2022 16:00	4,259.0	602.3	4,861.3	103,800.0	504.6	0.61	0.3	1.0
09/03/2022 17:00	4,276.7	573.6	4,850.3	103,800.0	503.5	0.60	0.3	1.0
09/03/2022 18:00	4,304.7	507.8	4,812.5	103,800.0	499.5	0.60	0.3	1.0
09/03/2022 19:00	3,250.6	4.4	3,250.7	103,800.0	337.4	0.40	0.2	0.7
09/03/2022 20:00	2,899.6	0.0	2,899.6	103,800.0	301.0	0.36	0.2	0.6
09/03/2022 21:00	3,153.8	0.0	3,153.8	103,800.0	327.4	0.39	0.2	0.7
09/03/2022 22:00	3,061.7	0.0	3,061.7	103,800.0	317.8	0.38	0.2	0.6
09/03/2022 23:00	3,398.8	0.0	3,398.8	103,800.0	352.8	0.42	0.2	0.7
Average/Sum#:	3,216.3	122.1	3,329.0	103,800.0	345.6	0.42	0.2	0.7
Minimum:	2,614.6	0.0	2,614.6	103,800.0	271.4	0.33	0.2	0.5
Maximum:	4,304.7	602.3	4,861.3	103,800.0	504.6	0.61	0.3	1.0
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 **To:** 09/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/04/2022 00:00	3,183.9	0.0	3,183.9	103,800.0	330.5	0.40	0.2	0.7
09/04/2022 01:00	2,796.2	0.0	2,796.2	103,800.0	290.2	0.35	0.2	0.6
09/04/2022 02:00	3,034.9	0.0	3,034.9	103,800.0	315.0	0.38	0.2	0.6
09/04/2022 03:00	3,076.7	0.0	3,076.7	103,800.0	319.4	0.38	0.2	0.6
09/04/2022 04:00	2,799.9	0.0	2,799.9	103,800.0	290.6	0.35	0.2	0.6
09/04/2022 05:00	2,671.2	0.0	2,671.2	103,800.0	277.3	0.33	0.2	0.6
09/04/2022 06:00	2,659.6	0.0	2,659.6	103,800.0	276.1	0.33	0.2	0.6
09/04/2022 07:00	2,629.2	0.0	2,629.2	103,800.0	272.9	0.33	0.2	0.5
09/04/2022 08:00	2,627.3	0.0	2,627.3	103,800.0	272.7	0.33	0.2	0.5
09/04/2022 09:00	2,627.1	0.0	2,627.1	103,800.0	272.7	0.33	0.2	0.5
09/04/2022 10:00	2,675.9	0.0	2,675.9	103,800.0	277.8	0.33	0.2	0.6
09/04/2022 11:00	2,673.4	0.0	2,673.4	103,800.0	277.5	0.33	0.2	0.6
09/04/2022 12:00	2,999.7	0.0	2,999.7	103,800.0	311.4	0.37	0.2	0.6
09/04/2022 13:00	2,949.6	0.0	2,949.6	103,800.0	306.2	0.37	0.2	0.6
09/04/2022 14:00	3,628.5	201.7	3,709.2	103,800.0	385.0	0.48	0.2	0.8
09/04/2022 15:00	4,249.5	591.2	4,840.7	103,800.0	502.5	0.60	0.3	1.0
09/04/2022 16:00	4,237.3	730.8	4,968.1	103,800.0	515.7	0.62	0.3	1.0
09/04/2022 17:00	4,250.3	990.3	5,240.6	103,800.0	544.0	0.65	0.3	1.1
09/04/2022 18:00	4,253.9	926.9	5,180.8	103,800.0	537.8	0.65	0.3	1.1
09/04/2022 19:00	4,224.6	234.5	4,370.0	103,800.0	453.6	0.56	0.3	0.9
09/04/2022 20:00	4,282.8	719.5	5,002.3	103,800.0	519.2	0.62	0.3	1.0
09/04/2022 21:00	4,304.6	682.6	4,987.2	103,800.0	517.7	0.62	0.3	1.0
09/04/2022 22:00	4,305.4	339.4	4,566.7	103,800.0	474.0	0.58	0.3	1.0
09/04/2022 23:00	4,058.9	0.0	4,058.9	103,800.0	421.3	0.51	0.3	0.8
Average/Sum#:	3,383.4	225.7	3,597.0	103,800.0	373.4	0.45	0.2	0.7
Minimum:	2,627.1	0.0	2,627.1	103,800.0	272.7	0.33	0.2	0.5
Maximum:	4,305.4	990.3	5,240.6	103,800.0	544.0	0.65	0.3	1.1
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1	Unit CT1	Unit CT1
	PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr					
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/05/2022 00:00	4,023.1	0.0	4,023.1	103,800.0	417.6	0.50	0.3	0.8
09/05/2022 01:00	3,683.1	0.0	3,683.1	103,800.0	382.3	0.46	0.2	0.8
09/05/2022 02:00	3,533.7	0.0	3,533.7	103,800.0	366.8	0.44	0.2	0.7
09/05/2022 03:00	3,661.1	0.0	3,661.1	103,800.0	380.0	0.46	0.2	0.8
09/05/2022 04:00	3,682.6	0.0	3,682.6	103,800.0	382.3	0.46	0.2	0.8
09/05/2022 05:00	3,577.3	0.0	3,577.3	103,800.0	371.3	0.45	0.2	0.7
09/05/2022 06:00	2,695.7	0.0	2,695.7	103,800.0	279.8	0.34	0.2	0.6
09/05/2022 07:00	2,624.6	0.0	2,624.6	103,800.0	272.4	0.33	0.2	0.5
09/05/2022 08:00	2,629.5	0.0	2,629.5	103,800.0	272.9	0.33	0.2	0.5
09/05/2022 09:00	3,553.3	0.0	3,553.3	103,800.0	368.8	0.44	0.2	0.7
09/05/2022 10:00	4,011.3	0.0	4,011.3	103,800.0	416.4	0.50	0.2	0.8
09/05/2022 11:00	4,105.1	171.7	4,153.2	103,800.0	431.1	0.53	0.3	0.9
09/05/2022 12:00	4,242.0	939.9	5,181.9	103,800.0	537.9	0.64	0.3	1.1
09/05/2022 13:00	4,197.1	1,277.9	5,475.0	103,800.0	568.3	0.68	0.3	1.1
09/05/2022 14:00	4,179.2	1,787.0	5,966.2	103,800.0	619.3	0.74	0.4	1.2
09/05/2022 15:00	4,166.9	1,911.0	6,077.9	103,800.0	630.9	0.76	0.4	1.3
09/05/2022 16:00	4,161.7	1,915.0	6,076.7	103,800.0	630.8	0.76	0.4	1.3
09/05/2022 17:00	4,167.8	1,958.7	6,126.5	103,800.0	635.9	0.76	0.4	1.3
09/05/2022 18:00	4,185.9	1,908.6	6,094.5	103,800.0	632.6	0.76	0.4	1.3
09/05/2022 19:00	4,200.3	1,859.0	6,059.3	103,800.0	629.0	0.75	0.4	1.3
09/05/2022 20:00	4,227.8	1,800.5	6,028.3	103,800.0	625.7	0.75	0.4	1.3
09/05/2022 21:00	4,241.5	1,540.0	5,781.5	103,800.0	600.1	0.72	0.4	1.2
09/05/2022 22:00	4,247.9	1,526.6	5,774.5	103,800.0	599.4	0.72	0.4	1.2
09/05/2022 23:00	4,255.4	1,552.4	5,807.8	103,800.0	602.8	0.72	0.4	1.2
Average/Sum#:	3,843.9	839.5	4,678.3	103,800.0	485.6	0.58	0.3	1.0
Minimum:	2,624.6	0.0	2,624.6	103,800.0	272.4	0.33	0.2	0.5
Maximum:	4,255.4	1,958.7	6,126.5	103,800.0	635.9	0.76	0.4	1.3
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1	Unit CT1	Unit CT1
	PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr					
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/06/2022 00:00	4,265.0	1,151.7	5,416.7	103,800.0	562.3	0.68	0.3	1.1
09/06/2022 01:00	4,237.5	391.4	4,538.9	103,800.0	471.1	0.58	0.3	1.0
09/06/2022 02:00	4,147.4	0.0	4,147.4	103,800.0	430.5	0.52	0.3	0.9
09/06/2022 03:00	4,146.6	0.0	4,146.6	103,800.0	430.4	0.52	0.3	0.9
09/06/2022 04:00	4,146.2	0.0	4,146.2	103,800.0	430.4	0.52	0.3	0.9
09/06/2022 05:00	4,146.4	0.0	4,146.4	103,800.0	430.4	0.52	0.3	0.9
09/06/2022 06:00	4,117.1	0.0	4,117.1	103,800.0	427.4	0.51	0.3	0.9
09/06/2022 07:00	3,900.2	0.0	3,900.2	103,800.0	404.8	0.49	0.2	0.8
09/06/2022 08:00	4,054.1	0.0	4,054.1	103,800.0	420.8	0.51	0.3	0.8
09/06/2022 09:00	4,213.2	536.4	4,588.7	103,800.0	476.3	0.59	0.3	1.0
09/06/2022 10:00	4,208.1	1,186.6	5,394.7	103,800.0	560.0	0.67	0.3	1.1
09/06/2022 11:00	4,212.5	1,873.9	6,086.4	103,800.0	631.8	0.76	0.4	1.3
09/06/2022 12:00	4,190.8	1,907.5	6,098.3	103,800.0	633.0	0.76	0.4	1.3
09/06/2022 13:00	4,165.7	1,948.3	6,114.0	103,800.0	634.6	0.76	0.4	1.3
09/06/2022 14:00	4,149.5	1,961.4	6,110.9	103,800.0	634.3	0.76	0.4	1.3
09/06/2022 15:00	4,150.5	1,965.4	6,115.9	103,800.0	634.8	0.76	0.4	1.3
09/06/2022 16:00	4,162.2	1,959.3	6,121.5	103,800.0	635.4	0.76	0.4	1.3
09/06/2022 17:00	4,158.7	1,963.6	6,122.3	103,800.0	635.5	0.76	0.4	1.3
09/06/2022 18:00	4,176.0	1,945.8	6,121.8	103,800.0	635.4	0.76	0.4	1.3
09/06/2022 19:00	4,201.2	1,878.6	6,079.8	103,800.0	631.1	0.76	0.4	1.3
09/06/2022 20:00	4,233.5	1,812.4	6,045.9	103,800.0	627.6	0.75	0.4	1.3
09/06/2022 21:00	4,249.4	1,743.8	5,993.2	103,800.0	622.1	0.75	0.4	1.2
09/06/2022 22:00	4,242.3	1,031.0	5,273.3	103,800.0	547.4	0.66	0.3	1.1
09/06/2022 23:00	4,262.4	996.3	5,258.7	103,800.0	545.9	0.65	0.3	1.1
Average/Sum#:	4,172.4	1,093.9	5,255.8	103,800.0	545.6	0.66	0.3	1.1
Minimum:	3,900.2	0.0	3,900.2	103,800.0	404.8	0.49	0.2	0.8
Maximum:	4,265.0	1,965.4	6,122.3	103,800.0	635.5	0.76	0.4	1.3
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 **To:** 09/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/07/2022 00:00	4,278.4	185.0	4,448.6	103,800.0	461.8	0.56	0.3	0.9
09/07/2022 01:00	4,286.7	0.0	4,286.7	103,800.0	445.0	0.53	0.3	0.9
09/07/2022 02:00	4,263.1	0.0	4,263.1	103,800.0	442.5	0.53	0.3	0.9
09/07/2022 03:00	4,247.2	0.0	4,247.2	103,800.0	440.9	0.53	0.3	0.9
09/07/2022 04:00	4,298.5	0.0	4,298.5	103,800.0	446.2	0.54	0.3	0.9
09/07/2022 05:00	4,317.0	0.0	4,317.0	103,800.0	448.1	0.54	0.3	0.9
09/07/2022 06:00	4,150.6	0.0	4,150.6	103,800.0	430.8	0.52	0.3	0.9
09/07/2022 07:00	3,727.8	0.0	3,727.8	103,800.0	386.9	0.46	0.2	0.8
09/07/2022 08:00	4,058.3	0.0	4,058.3	103,800.0	421.3	0.51	0.3	0.8
09/07/2022 09:00	4,294.8	1,495.4	5,745.3	103,800.0	596.4	0.72	0.4	1.2
09/07/2022 10:00	4,295.2	1,673.4	5,968.6	103,800.0	619.5	0.74	0.4	1.2
09/07/2022 11:00	4,279.9	1,720.2	6,000.1	103,800.0	622.8	0.75	0.4	1.2
09/07/2022 12:00	4,259.5	1,771.8	6,031.3	103,800.0	626.0	0.75	0.4	1.3
09/07/2022 13:00	4,238.3	1,809.7	6,048.0	103,800.0	627.8	0.75	0.4	1.3
09/07/2022 14:00	4,219.8	1,845.6	6,065.4	103,800.0	629.6	0.76	0.4	1.3
09/07/2022 15:00	4,219.9	1,858.5	6,078.4	103,800.0	630.9	0.76	0.4	1.3
09/07/2022 16:00	4,218.5	1,844.3	6,062.8	103,800.0	629.3	0.76	0.4	1.3
09/07/2022 17:00	4,217.0	1,853.4	6,070.4	103,800.0	630.1	0.76	0.4	1.3
09/07/2022 18:00	4,221.7	1,835.5	6,057.2	103,800.0	628.7	0.75	0.4	1.3
09/07/2022 19:00	4,256.1	1,692.2	5,948.3	103,800.0	617.4	0.74	0.4	1.2
09/07/2022 20:00	4,268.3	1,722.3	5,990.6	103,800.0	621.8	0.75	0.4	1.2
09/07/2022 21:00	4,267.7	1,649.3	5,917.0	103,800.0	614.2	0.74	0.4	1.2
09/07/2022 22:00	4,277.5	1,398.8	5,676.3	103,800.0	589.2	0.71	0.4	1.2
09/07/2022 23:00	4,308.9	1,267.8	5,576.7	103,800.0	578.9	0.69	0.3	1.2
Average/Sum#:	4,227.9	1,067.6	5,293.1	103,800.0	549.4	0.66	0.4	1.1
Minimum:	3,727.8	0.0	3,727.8	103,800.0	386.9	0.46	0.2	0.8
Maximum:	4,317.0	1,858.5	6,078.4	103,800.0	630.9	0.76	0.4	1.3
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1	Unit CT1	Unit CT1
	PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr					
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/08/2022 00:00	4,316.3	1,228.3	5,544.6	103,800.0	575.5	0.69	0.3	1.2
09/08/2022 01:00	4,312.1	99.1	4,338.9	103,800.0	450.4	0.55	0.3	0.9
09/08/2022 02:00	4,318.7	0.0	4,318.7	103,800.0	448.3	0.54	0.3	0.9
09/08/2022 03:00	4,310.6	0.0	4,310.6	103,800.0	447.4	0.54	0.3	0.9
09/08/2022 04:00	4,299.2	0.0	4,299.2	103,800.0	446.3	0.54	0.3	0.9
09/08/2022 05:00	4,301.1	0.0	4,301.1	103,800.0	446.5	0.54	0.3	0.9
09/08/2022 06:00	4,236.3	0.0	4,236.3	103,800.0	439.7	0.53	0.3	0.9
09/08/2022 07:00	4,133.4	0.0	4,133.4	103,800.0	429.0	0.52	0.3	0.9
09/08/2022 08:00	4,248.6	27.1	4,251.3	103,800.0	441.3	0.53	0.3	0.9
09/08/2022 09:00	4,271.8	1,694.6	5,966.4	103,800.0	619.3	0.74	0.4	1.2
09/08/2022 10:00	4,237.9	1,785.6	6,023.5	103,800.0	625.2	0.75	0.4	1.3
09/08/2022 11:00	4,221.9	1,840.4	6,062.3	103,800.0	629.3	0.76	0.4	1.3
09/08/2022 12:00	4,207.4	1,859.5	6,066.9	103,800.0	629.7	0.76	0.4	1.3
09/08/2022 13:00	4,180.4	1,902.9	6,083.3	103,800.0	631.4	0.76	0.4	1.3
09/08/2022 14:00	4,165.9	1,922.3	6,088.2	103,800.0	632.0	0.76	0.4	1.3
09/08/2022 15:00	4,162.2	1,924.0	6,086.2	103,800.0	631.7	0.76	0.4	1.3
09/08/2022 16:00	4,156.3	1,931.2	6,087.5	103,800.0	631.9	0.76	0.4	1.3
09/08/2022 17:00	4,152.9	1,936.9	6,089.8	103,800.0	632.1	0.76	0.4	1.3
09/08/2022 18:00	4,179.8	1,894.8	6,074.6	103,800.0	630.5	0.76	0.4	1.3
09/08/2022 19:00	4,199.8	1,896.4	6,096.2	103,800.0	632.8	0.76	0.4	1.3
09/08/2022 20:00	4,219.2	1,949.2	6,168.4	103,800.0	640.3	0.77	0.4	1.3
09/08/2022 21:00	4,210.9	1,980.7	6,191.6	103,800.0	642.7	0.77	0.4	1.3
09/08/2022 22:00	4,236.5	1,698.3	5,934.8	103,800.0	616.0	0.74	0.4	1.2
09/08/2022 23:00	4,239.6	1,433.6	5,673.2	103,800.0	588.9	0.71	0.4	1.2
Average/Sum#:	4,230.0	1,208.5	5,434.5	103,800.0	564.1	0.68	0.4	1.2
Minimum:	4,133.4	0.0	4,133.4	103,800.0	429.0	0.52	0.3	0.9
Maximum:	4,318.7	1,980.7	6,191.6	103,800.0	642.7	0.77	0.4	1.3
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/09/2022 00:00	4,259.4	1,435.0	5,694.4	103,800.0	591.1	0.71	0.4	1.2
09/09/2022 01:00	4,259.3	1,150.4	5,409.7	103,800.0	561.5	0.67	0.3	1.1
09/09/2022 02:00	4,288.8	1,087.7	5,376.5	103,800.0	558.1	0.67	0.3	1.1
09/09/2022 03:00	4,293.8	898.2	5,192.0	103,800.0	538.9	0.65	0.3	1.1
09/09/2022 04:00	4,334.5	1,143.8	5,478.3	103,800.0	568.6	0.68	0.3	1.1
09/09/2022 05:00	4,345.2	1,683.2	6,028.4	103,800.0	625.7	0.75	0.4	1.3
09/09/2022 06:00	4,335.6	1,449.6	5,785.2	103,800.0	600.5	0.72	0.4	1.2
09/09/2022 07:00	4,335.2	1,357.5	5,692.7	103,800.0	590.9	0.71	0.4	1.2
09/09/2022 08:00	4,307.6	1,203.8	5,511.4	103,800.0	572.1	0.69	0.3	1.1
09/09/2022 09:00	4,279.7	1,007.1	5,286.8	103,800.0	548.8	0.66	0.3	1.1
09/09/2022 10:00	4,255.3	1,526.0	5,781.3	103,800.0	600.1	0.72	0.4	1.2
09/09/2022 11:00	4,249.7	970.3	5,220.0	103,800.0	541.8	0.65	0.3	1.1
09/09/2022 12:00	4,242.8	1,464.2	5,707.0	103,800.0	592.4	0.71	0.4	1.2
09/09/2022 13:00	4,219.9	1,714.7	5,934.6	103,800.0	616.0	0.74	0.4	1.2
09/09/2022 14:00	4,211.2	1,487.1	5,698.3	103,800.0	591.5	0.71	0.4	1.2
09/09/2022 15:00	4,202.8	1,406.3	5,609.1	103,800.0	582.2	0.70	0.3	1.2
09/09/2022 16:00	4,198.3	1,040.4	5,238.7	103,800.0	543.8	0.65	0.3	1.1
09/09/2022 17:00	4,201.7	1,227.2	5,428.9	103,800.0	563.5	0.68	0.3	1.1
09/09/2022 18:00	4,192.2	998.2	5,190.4	103,800.0	538.8	0.65	0.3	1.1
09/09/2022 19:00	4,210.6	713.1	4,923.7	103,800.0	511.1	0.61	0.3	1.0
09/09/2022 20:00	4,114.9	316.5	4,282.6	103,800.0	444.5	0.55	0.3	0.9
09/09/2022 21:00	4,006.6	0.0	4,006.6	103,800.0	415.9	0.50	0.2	0.8
09/09/2022 22:00	3,581.5	0.0	3,581.5	103,800.0	371.8	0.45	0.2	0.7
09/09/2022 23:00	4,047.1	0.0	4,047.1	103,800.0	420.1	0.50	0.3	0.8
Average/Sum#:	4,207.2	1,053.3	5,254.4	103,800.0	545.4	0.66	0.3	1.1
Minimum:	3,581.5	0.0	3,581.5	103,800.0	371.8	0.45	0.2	0.7
Maximum:	4,345.2	1,714.7	6,028.4	103,800.0	625.7	0.75	0.4	1.3
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1	Unit CT1	Unit CT1
	PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr					
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/10/2022 00:00	3,867.7	0.0	3,867.7	103,800.0	401.5	0.48	0.2	0.8
09/10/2022 01:00	2,944.2	0.0	2,944.2	103,800.0	305.6	0.37	0.2	0.6
09/10/2022 02:00	3,482.8	0.0	3,482.8	103,800.0	361.5	0.43	0.2	0.7
09/10/2022 03:00	3,284.9	0.0	3,284.9	103,800.0	341.0	0.41	0.2	0.7
09/10/2022 04:00	3,730.0	0.0	3,730.0	103,800.0	387.2	0.47	0.2	0.8
09/10/2022 05:00	3,537.3	0.0	3,537.3	103,800.0	367.2	0.44	0.2	0.7
09/10/2022 06:00	3,338.7	0.0	3,338.7	103,800.0	346.6	0.41	0.2	0.7
09/10/2022 07:00	4,147.8	0.0	4,147.8	103,800.0	430.5	0.52	0.3	0.9
09/10/2022 08:00	3,736.7	0.0	3,736.7	103,800.0	387.9	0.46	0.2	0.8
09/10/2022 09:00	3,153.0	0.0	3,153.0	103,800.0	327.3	0.39	0.2	0.7
09/10/2022 10:00	2,685.0	0.0	2,685.0	103,800.0	278.7	0.33	0.2	0.6
09/10/2022 11:00	2,670.3	0.0	2,670.3	103,800.0	277.2	0.33	0.2	0.6
09/10/2022 12:00	2,873.0	0.0	2,873.0	103,800.0	298.2	0.36	0.2	0.6
09/10/2022 13:00	3,152.5	0.0	3,152.5	103,800.0	327.2	0.39	0.2	0.7
09/10/2022 14:00	2,842.1	0.0	2,842.1	103,800.0	295.0	0.35	0.2	0.6
09/10/2022 15:00	2,900.4	0.0	2,900.4	103,800.0	301.1	0.36	0.2	0.6
09/10/2022 16:00	3,240.0	0.0	3,240.0	103,800.0	336.3	0.40	0.2	0.7
09/10/2022 17:00	2,882.8	0.0	2,882.8	103,800.0	299.2	0.36	0.2	0.6
09/10/2022 18:00	3,405.6	0.0	3,405.6	103,800.0	353.5	0.42	0.2	0.7
09/10/2022 19:00	3,911.2	0.0	3,911.2	103,800.0	406.0	0.49	0.2	0.8
09/10/2022 20:00	4,008.1	0.0	4,008.1	103,800.0	416.0	0.50	0.2	0.8
09/10/2022 21:00	4,035.3	0.0	4,035.3	103,800.0	418.9	0.50	0.3	0.8
09/10/2022 22:00	3,347.0	0.0	3,347.0	103,800.0	347.4	0.42	0.2	0.7
09/10/2022 23:00	4,136.2	0.0	4,136.2	103,800.0	429.3	0.51	0.3	0.9
Average/Sum#:	3,388.0	0.0	3,388.0	103,800.0	351.7	0.42	0.2	0.7
Minimum:	2,670.3	0.0	2,670.3	103,800.0	277.2	0.33	0.2	0.6
Maximum:	4,147.8	0.0	4,147.8	103,800.0	430.5	0.52	0.3	0.9
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 **To:** 09/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1	Unit CT1	Unit CT1
						PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/11/2022 00:00	4,202.5	0.0	4,202.5	103,800.0	436.2	0.52	0.3	0.9
09/11/2022 01:00	4,147.8	0.0	4,147.8	103,800.0	430.5	0.52	0.3	0.9
09/11/2022 02:00	4,104.9	0.0	4,104.9	103,800.0	426.1	0.51	0.3	0.9
09/11/2022 03:00	3,761.9	0.0	3,761.9	103,800.0	390.5	0.47	0.2	0.8
09/11/2022 04:00	3,918.8	0.0	3,918.8	103,800.0	406.8	0.49	0.2	0.8
09/11/2022 05:00	3,809.2	0.0	3,809.2	103,800.0	395.4	0.47	0.2	0.8
09/11/2022 06:00	3,347.3	0.0	3,347.3	103,800.0	347.4	0.42	0.2	0.7
09/11/2022 07:00	2,932.2	0.0	2,932.2	103,800.0	304.4	0.36	0.2	0.6
09/11/2022 08:00	2,756.8	0.0	2,756.8	103,800.0	286.2	0.34	0.2	0.6
09/11/2022 09:00	2,688.8	0.0	2,688.8	103,800.0	279.1	0.33	0.2	0.6
09/11/2022 10:00	2,772.0	0.0	2,772.0	103,800.0	287.7	0.35	0.2	0.6
09/11/2022 11:00	2,800.5	0.0	2,800.5	103,800.0	290.7	0.35	0.2	0.6
09/11/2022 12:00	3,154.3	0.0	3,154.3	103,800.0	327.4	0.39	0.2	0.7
09/11/2022 13:00	3,122.9	0.0	3,122.9	103,800.0	324.2	0.39	0.2	0.6
09/11/2022 14:00	3,688.7	0.0	3,688.7	103,800.0	382.9	0.46	0.2	0.8
09/11/2022 15:00	3,855.2	0.0	3,855.2	103,800.0	400.2	0.48	0.2	0.8
09/11/2022 16:00	4,347.4	537.0	4,707.2	103,800.0	488.6	0.61	0.3	1.0
09/11/2022 17:00	4,358.9	911.9	5,270.8	103,800.0	547.1	0.66	0.3	1.1
09/11/2022 18:00	4,383.6	590.7	4,974.3	103,800.0	516.3	0.62	0.3	1.0
09/11/2022 19:00	4,368.3	383.0	4,663.2	103,800.0	484.0	0.59	0.3	1.0
09/11/2022 20:00	4,103.1	0.0	4,103.1	103,800.0	425.9	0.51	0.3	0.9
09/11/2022 21:00	3,175.9	0.0	3,175.9	103,800.0	329.7	0.40	0.2	0.7
09/11/2022 22:00	3,265.0	0.0	3,265.0	103,800.0	338.9	0.41	0.2	0.7
09/11/2022 23:00	3,163.2	0.0	3,163.2	103,800.0	328.3	0.39	0.2	0.7
Average/Sum#:	3,592.9	100.9	3,682.8	103,800.0	382.3	0.46	0.2	0.8
Minimum:	2,688.8	0.0	2,688.8	103,800.0	279.1	0.33	0.2	0.6
Maximum:	4,383.6	911.9	5,270.8	103,800.0	547.1	0.66	0.3	1.1
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1	Unit CT1	Unit CT1
						PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/12/2022 00:00	3,609.3	0.0	3,609.3	103,800.0	374.6	0.45	0.2	0.7
09/12/2022 01:00	2,819.7	0.0	2,819.7	103,800.0	292.7	0.35	0.2	0.6
09/12/2022 02:00	2,764.1	0.0	2,764.1	103,800.0	286.9	0.34	0.2	0.6
09/12/2022 03:00	2,747.2	0.0	2,747.2	103,800.0	285.2	0.34	0.2	0.6
09/12/2022 04:00	3,679.7	0.0	3,679.7	103,800.0	382.0	0.46	0.2	0.8
09/12/2022 05:00	4,271.9	0.0	4,271.9	103,800.0	443.4	0.53	0.3	0.9
09/12/2022 06:00	3,835.3	0.0	3,835.3	103,800.0	398.1	0.48	0.2	0.8
09/12/2022 07:00	3,083.6	0.0	3,083.6	104,400.0	321.9	0.39	0.2	0.6
09/12/2022 08:00	2,743.9	0.0	2,743.9	104,400.0	286.5	0.34	0.2	0.6
09/12/2022 09:00	2,755.0	0.0	2,755.0	104,400.0	287.6	0.35	0.2	0.6
09/12/2022 10:00	2,806.2	0.0	2,806.2	104,400.0	293.0	0.35	0.2	0.6
09/12/2022 11:00	3,566.6	0.0	3,566.6	104,400.0	372.4	0.45	0.2	0.7
09/12/2022 12:00	4,210.9	0.0	4,210.9	104,400.0	439.6	0.53	0.3	0.9
09/12/2022 13:00	3,656.1	0.0	3,656.1	104,400.0	381.7	0.46	0.2	0.8
09/12/2022 14:00	3,665.6	0.0	3,665.6	104,400.0	382.7	0.46	0.2	0.8
09/12/2022 15:00	3,699.7	1.6	3,699.7	104,400.0	386.2	0.46	0.2	0.8
09/12/2022 16:00	3,830.7	0.5	3,830.7	104,400.0	399.9	0.48	0.2	0.8
09/12/2022 17:00	4,218.9	0.0	4,218.9	104,400.0	440.5	0.53	0.3	0.9
09/12/2022 18:00	4,137.2	0.0	4,137.2	104,400.0	431.9	0.52	0.3	0.9
09/12/2022 19:00	4,157.3	0.0	4,157.3	104,400.0	434.0	0.52	0.3	0.9
09/12/2022 20:00	4,216.4	0.0	4,216.4	104,400.0	440.2	0.53	0.3	0.9
09/12/2022 21:00	4,171.7	0.0	4,171.7	104,400.0	435.5	0.52	0.3	0.9
09/12/2022 22:00	3,359.0	0.0	3,359.0	104,400.0	350.7	0.42	0.2	0.7
09/12/2022 23:00	3,766.4	0.0	3,766.4	104,400.0	393.2	0.47	0.2	0.8
Average/Sum#:	3,573.9	0.1	3,573.9	104,225.0	372.5	0.45	0.2	0.8
Minimum:	2,743.9	0.0	2,743.9	103,800.0	285.2	0.34	0.2	0.6
Maximum:	4,271.9	1.6	4,271.9	104,400.0	443.4	0.53	0.3	0.9
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1	Unit CT1	Unit CT1
	PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr					
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/13/2022 00:00	3,775.8	0.0	3,775.8	104,400.0	394.2	0.47	0.2	0.8
09/13/2022 01:00	3,124.8	0.0	3,124.8	104,400.0	326.2	0.39	0.2	0.7
09/13/2022 02:00	2,844.7	0.0	2,844.7	104,400.0	297.0	0.36	0.2	0.6
09/13/2022 03:00	3,771.7	29.2	3,778.1	104,400.0	394.4	0.48	0.2	0.8
09/13/2022 04:00	4,414.3	326.0	4,740.3	104,400.0	494.9	0.59	0.3	1.0
09/13/2022 05:00	4,420.0	417.8	4,837.8	104,400.0	505.1	0.61	0.3	1.0
09/13/2022 06:00	4,241.6	184.2	4,337.4	104,400.0	452.8	0.55	0.3	0.9
09/13/2022 07:00	3,488.5	0.0	3,488.5	104,400.0	364.2	0.44	0.2	0.7
09/13/2022 08:00	2,922.2	0.0	2,922.2	104,400.0	305.1	0.37	0.2	0.6
09/13/2022 09:00	2,719.7	0.0	2,719.7	104,400.0	283.9	0.34	0.2	0.6
09/13/2022 10:00	2,807.6	0.0	2,807.6	104,400.0	293.1	0.35	0.2	0.6
09/13/2022 11:00	2,820.5	0.0	2,820.5	104,400.0	294.5	0.35	0.2	0.6
09/13/2022 12:00	2,710.7	0.0	2,710.7	104,400.0	283.0	0.34	0.2	0.6
09/13/2022 13:00	2,685.2	0.0	2,685.2	104,400.0	280.3	0.34	0.2	0.6
09/13/2022 14:00	2,732.8	0.0	2,732.8	104,400.0	285.3	0.34	0.2	0.6
09/13/2022 15:00	2,696.3	0.0	2,696.3	104,400.0	281.5	0.34	0.2	0.6
09/13/2022 16:00	3,355.5	0.0	3,355.5	104,400.0	350.3	0.42	0.2	0.7
09/13/2022 17:00	4,390.4	384.2	4,766.9	104,400.0	497.7	0.60	0.3	1.0
09/13/2022 18:00	4,401.7	267.1	4,668.8	104,400.0	487.4	0.58	0.3	1.0
09/13/2022 19:00	4,406.6	267.1	4,673.7	104,400.0	487.9	0.58	0.3	1.0
09/13/2022 20:00	4,412.8	216.0	4,628.8	104,400.0	483.2	0.58	0.3	1.0
09/13/2022 21:00	4,374.0	154.1	4,492.7	104,400.0	469.0	0.57	0.3	0.9
09/13/2022 22:00	2,888.9	0.0	2,888.9	104,400.0	301.6	0.36	0.2	0.6
09/13/2022 23:00	3,487.2	0.0	3,487.2	104,400.0	364.1	0.44	0.2	0.7
Average/Sum#:	3,495.6	93.6	3,582.7	104,400.0	374.0	0.45	0.2	0.8
Minimum:	2,685.2	0.0	2,685.2	104,400.0	280.3	0.34	0.2	0.6
Maximum:	4,420.0	417.8	4,837.8	104,400.0	505.1	0.61	0.3	1.0
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/14/2022 00:00	3,185.7	0.0	3,185.7	104,400.0	332.6	0.40	0.2	0.7
09/14/2022 01:00	3,009.2	0.0	3,009.2	104,400.0	314.2	0.38	0.2	0.6
09/14/2022 02:00	3,045.2	0.0	3,045.2	104,400.0	317.9	0.38	0.2	0.6
09/14/2022 03:00	3,559.6	0.0	3,559.6	104,400.0	371.6	0.45	0.2	0.7
09/14/2022 04:00	3,860.5	0.0	3,860.5	104,400.0	403.0	0.48	0.2	0.8
09/14/2022 05:00	4,181.0	0.0	4,181.0	104,400.0	436.5	0.52	0.3	0.9
09/14/2022 06:00	3,379.8	0.0	3,379.8	104,400.0	352.9	0.42	0.2	0.7
09/14/2022 07:00	2,701.7	0.0	2,701.7	104,400.0	282.1	0.34	0.2	0.6
09/14/2022 08:00	2,649.0	0.0	2,649.0	104,400.0	276.6	0.33	0.2	0.6
09/14/2022 09:00	2,633.2	0.0	2,633.2	104,400.0	274.9	0.33	0.2	0.6
09/14/2022 10:00	2,668.5	0.0	2,668.5	104,400.0	278.6	0.34	0.2	0.6
09/14/2022 11:00	2,684.8	0.0	2,684.8	104,400.0	280.3	0.34	0.2	0.6
09/14/2022 12:00	2,677.1	0.0	2,677.1	104,400.0	279.5	0.34	0.2	0.6
09/14/2022 13:00	2,670.4	0.0	2,670.4	104,400.0	278.8	0.33	0.2	0.6
09/14/2022 14:00	2,671.7	0.0	2,671.7	104,400.0	278.9	0.33	0.2	0.6
09/14/2022 15:00	2,669.7	0.0	2,669.7	104,400.0	278.7	0.33	0.2	0.6
09/14/2022 16:00	2,726.0	0.0	2,726.0	104,400.0	284.6	0.34	0.2	0.6
09/14/2022 17:00	3,003.3	0.0	3,003.3	104,400.0	313.5	0.38	0.2	0.6
09/14/2022 18:00	3,323.1	0.0	3,323.1	104,400.0	346.9	0.42	0.2	0.7
09/14/2022 19:00	3,344.2	0.0	3,344.2	104,400.0	349.1	0.42	0.2	0.7
09/14/2022 20:00	3,302.2	0.0	3,302.2	104,400.0	344.7	0.41	0.2	0.7
09/14/2022 21:00	3,340.3	0.0	3,340.3	104,400.0	348.7	0.42	0.2	0.7
09/14/2022 22:00	2,764.4	0.0	2,764.4	104,400.0	288.6	0.35	0.2	0.6
09/14/2022 23:00	2,911.4	0.0	2,911.4	104,400.0	304.0	0.36	0.2	0.6
Average/Sum#:	3,040.1	0.0	3,040.1	104,400.0	317.4	0.38	0.2	0.7
Minimum:	2,633.2	0.0	2,633.2	104,400.0	274.9	0.33	0.2	0.6
Maximum:	4,181.0	0.0	4,181.0	104,400.0	436.5	0.52	0.3	0.9
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1	Unit CT1	Unit CT1
	PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr					
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/15/2022 00:00	2,761.7	0.0	2,761.7	104,400.0	288.3	0.35	0.2	0.6
09/15/2022 01:00	2,872.2	0.0	2,872.2	104,400.0	299.9	0.36	0.2	0.6
09/15/2022 02:00	2,903.3	0.0	2,903.3	104,400.0	303.1	0.37	0.2	0.6
09/15/2022 03:00	3,213.4	0.0	3,213.4	104,400.0	335.5	0.40	0.2	0.7
09/15/2022 04:00	3,636.4	0.0	3,636.4	104,400.0	379.6	0.46	0.2	0.8
09/15/2022 05:00	4,021.4	0.0	4,021.4	104,400.0	419.8	0.50	0.3	0.8
09/15/2022 06:00	3,250.1	0.0	3,250.1	104,400.0	339.3	0.41	0.2	0.7
09/15/2022 07:00	3,052.6	0.0	3,052.6	104,400.0	318.7	0.38	0.2	0.6
09/15/2022 08:00	2,677.0	0.0	2,677.0	104,400.0	279.5	0.34	0.2	0.6
09/15/2022 09:00	2,674.9	0.0	2,674.9	104,400.0	279.3	0.34	0.2	0.6
09/15/2022 10:00	3,871.5	64.4	3,889.5	104,400.0	406.1	0.49	0.2	0.8
09/15/2022 11:00	4,450.0	224.4	4,674.4	104,400.0	488.0	0.59	0.3	1.0
09/15/2022 12:00	3,185.7	1.6	3,185.7	104,400.0	332.6	0.40	0.2	0.7
09/15/2022 13:00	2,696.4	0.0	2,696.4	104,400.0	281.5	0.34	0.2	0.6
09/15/2022 14:00	2,982.5	0.0	2,982.5	104,400.0	311.4	0.37	0.2	0.6
09/15/2022 15:00	2,751.1	0.0	2,751.1	104,400.0	287.2	0.34	0.2	0.6
09/15/2022 16:00	2,744.9	0.0	2,744.9	104,400.0	286.6	0.34	0.2	0.6
09/15/2022 17:00	3,279.9	0.0	3,279.9	104,400.0	342.4	0.41	0.2	0.7
09/15/2022 18:00	2,865.6	0.0	2,865.6	104,400.0	299.2	0.36	0.2	0.6
09/15/2022 19:00	3,018.2	0.0	3,018.2	104,400.0	315.1	0.38	0.2	0.6
09/15/2022 20:00	2,923.1	0.0	2,923.1	104,400.0	305.2	0.37	0.2	0.6
09/15/2022 21:00	2,977.1	0.0	2,977.1	104,400.0	310.8	0.37	0.2	0.6
09/15/2022 22:00	2,820.8	0.0	2,820.8	104,400.0	294.5	0.35	0.2	0.6
09/15/2022 23:00	2,756.2	0.0	2,756.2	104,400.0	287.7	0.35	0.2	0.6
Average/Sum#:	3,099.4	12.1	3,109.5	104,400.0	324.6	0.39	0.2	0.7
Minimum:	2,674.9	0.0	2,674.9	104,400.0	279.3	0.34	0.2	0.6
Maximum:	4,450.0	224.4	4,674.4	104,400.0	488.0	0.59	0.3	1.0
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1	Unit CT1	Unit CT1
						PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/16/2022 00:00	2,734.2	0.0	2,734.2	104,400.0	285.5	0.34	0.2	0.6
09/16/2022 01:00	2,633.5	0.0	2,633.5	104,400.0	274.9	0.33	0.2	0.6
09/16/2022 02:00	2,632.0	0.0	2,632.0	104,400.0	274.8	0.33	0.2	0.6
09/16/2022 03:00	2,640.5	0.0	2,640.5	104,400.0	275.7	0.33	0.2	0.6
09/16/2022 04:00	2,754.9	0.0	2,754.9	104,400.0	287.6	0.35	0.2	0.6
09/16/2022 05:00	3,314.7	0.0	3,314.7	104,400.0	346.1	0.41	0.2	0.7
09/16/2022 06:00	3,096.5	0.0	3,096.5	104,400.0	323.3	0.39	0.2	0.6
09/16/2022 07:00	2,625.7	0.0	2,625.7	104,400.0	274.1	0.33	0.2	0.6
09/16/2022 08:00	2,659.3	0.0	2,659.3	104,400.0	277.6	0.33	0.2	0.6
09/16/2022 09:00	2,630.9	0.0	2,630.9	104,400.0	274.7	0.33	0.2	0.6
09/16/2022 10:00	2,634.5	0.0	2,634.5	104,400.0	275.0	0.33	0.2	0.6
09/16/2022 11:00	2,652.1	0.0	2,652.1	104,400.0	276.9	0.33	0.2	0.6
09/16/2022 12:00	2,631.7	0.0	2,631.7	104,400.0	274.7	0.33	0.2	0.6
09/16/2022 13:00	2,631.4	0.0	2,631.4	104,400.0	274.7	0.33	0.2	0.6
09/16/2022 14:00	2,866.5	0.0	2,866.5	104,400.0	299.3	0.36	0.2	0.6
09/16/2022 15:00	2,682.6	0.0	2,682.6	104,400.0	280.1	0.34	0.2	0.6
09/16/2022 16:00	2,660.2	0.0	2,660.2	104,400.0	277.7	0.33	0.2	0.6
09/16/2022 17:00	2,743.7	0.0	2,743.7	104,400.0	286.4	0.34	0.2	0.6
09/16/2022 18:00	2,749.9	0.0	2,749.9	104,400.0	287.1	0.34	0.2	0.6
09/16/2022 19:00	2,746.0	0.0	2,746.0	104,400.0	286.7	0.34	0.2	0.6
09/16/2022 20:00	2,747.4	0.0	2,747.4	104,400.0	286.8	0.34	0.2	0.6
09/16/2022 21:00	2,741.4	0.0	2,741.4	104,400.0	286.2	0.34	0.2	0.6
09/16/2022 22:00	2,699.6	0.0	2,699.6	104,400.0	281.8	0.34	0.2	0.6
09/16/2022 23:00	2,736.4	0.0	2,736.4	104,400.0	285.7	0.34	0.2	0.6
Average/Sum#:	2,735.2	0.0	2,735.2	104,400.0	285.6	0.34	0.2	0.6
Minimum:	2,625.7	0.0	2,625.7	104,400.0	274.1	0.33	0.2	0.6
Maximum:	3,314.7	0.0	3,314.7	104,400.0	346.1	0.41	0.2	0.7
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1	Unit CT1	Unit CT1
	PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr					
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/17/2022 00:00	2,747.0	0.0	2,747.0	104,400.0	286.8	0.34	0.2	0.6
09/17/2022 01:00	2,752.2	0.0	2,752.2	104,400.0	287.3	0.34	0.2	0.6
09/17/2022 02:00	2,750.3	0.0	2,750.3	104,400.0	287.1	0.34	0.2	0.6
09/17/2022 03:00	2,750.6	0.0	2,750.6	104,400.0	287.2	0.34	0.2	0.6
09/17/2022 04:00	2,827.2	0.0	2,827.2	104,400.0	295.2	0.35	0.2	0.6
09/17/2022 05:00	2,750.8	0.0	2,750.8	104,400.0	287.2	0.34	0.2	0.6
09/17/2022 06:00	2,626.6	0.0	2,626.6	104,400.0	274.2	0.33	0.2	0.6
09/17/2022 07:00	2,630.9	0.0	2,630.9	104,400.0	274.7	0.33	0.2	0.6
09/17/2022 08:00	2,630.1	0.0	2,630.1	104,400.0	274.6	0.33	0.2	0.6
09/17/2022 09:00	2,632.8	0.0	2,632.8	104,400.0	274.9	0.33	0.2	0.6
09/17/2022 10:00	2,634.1	0.0	2,634.1	104,400.0	275.0	0.33	0.2	0.6
09/17/2022 11:00	2,639.5	0.0	2,639.5	104,400.0	275.6	0.33	0.2	0.6
09/17/2022 12:00	2,639.5	0.0	2,639.5	104,400.0	275.6	0.33	0.2	0.6
09/17/2022 13:00	2,626.1	0.0	2,626.1	104,400.0	274.2	0.33	0.2	0.5
09/17/2022 14:00	2,623.9	0.0	2,623.9	104,400.0	273.9	0.33	0.2	0.5
09/17/2022 15:00	2,625.2	0.0	2,625.2	104,400.0	274.1	0.33	0.2	0.5
09/17/2022 16:00	2,755.8	0.0	2,755.8	104,400.0	287.7	0.35	0.2	0.6
09/17/2022 17:00	2,985.4	0.0	2,985.4	104,400.0	311.7	0.37	0.2	0.6
09/17/2022 18:00	2,746.9	0.0	2,746.9	104,400.0	286.8	0.34	0.2	0.6
09/17/2022 19:00	2,650.2	0.0	2,650.2	104,400.0	276.7	0.33	0.2	0.6
09/17/2022 20:00	2,676.4	0.0	2,676.4	104,400.0	279.4	0.34	0.2	0.6
09/17/2022 21:00	2,915.2	0.0	2,915.2	104,400.0	304.3	0.37	0.2	0.6
09/17/2022 22:00	2,897.1	0.0	2,897.1	104,400.0	302.5	0.36	0.2	0.6
09/17/2022 23:00	2,748.8	0.0	2,748.8	104,400.0	287.0	0.34	0.2	0.6
Average/Sum#:	2,719.3	0.0	2,719.3	104,400.0	283.9	0.34	0.2	0.6
Minimum:	2,623.9	0.0	2,623.9	104,400.0	273.9	0.33	0.2	0.5
Maximum:	2,985.4	0.0	2,985.4	104,400.0	311.7	0.37	0.2	0.6
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1	Unit CT1	Unit CT1
						PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/18/2022 00:00	2,748.9	0.0	2,748.9	104,400.0	287.0	0.34	0.2	0.6
09/18/2022 01:00	2,754.4	0.0	2,754.4	104,400.0	287.6	0.35	0.2	0.6
09/18/2022 02:00	2,756.0	0.0	2,756.0	104,400.0	287.7	0.35	0.2	0.6
09/18/2022 03:00	2,752.7	0.0	2,752.7	104,400.0	287.4	0.34	0.2	0.6
09/18/2022 04:00	2,683.4	0.0	2,683.4	104,400.0	280.1	0.34	0.2	0.6
09/18/2022 05:00	2,630.3	0.0	2,630.3	104,400.0	274.6	0.33	0.2	0.6
09/18/2022 06:00	2,751.2	0.0	2,751.2	104,400.0	287.2	0.35	0.2	0.6
09/18/2022 07:00	2,782.2	0.0	2,782.2	104,400.0	290.5	0.35	0.2	0.6
09/18/2022 08:00	2,752.9	0.0	2,752.9	104,400.0	287.4	0.35	0.2	0.6
09/18/2022 09:00	2,748.7	0.0	2,748.7	104,400.0	287.0	0.34	0.2	0.6
09/18/2022 10:00	2,715.6	0.0	2,715.6	104,400.0	283.5	0.34	0.2	0.6
09/18/2022 11:00	2,849.4	0.0	2,849.4	104,400.0	297.5	0.36	0.2	0.6
09/18/2022 12:00	3,129.2	0.0	3,129.2	104,400.0	326.7	0.39	0.2	0.7
09/18/2022 13:00	3,475.8	0.0	3,475.8	104,400.0	362.9	0.44	0.2	0.7
09/18/2022 14:00	2,998.5	0.0	2,998.5	104,400.0	313.0	0.37	0.2	0.6
09/18/2022 15:00	2,878.3	0.0	2,878.3	104,400.0	300.5	0.36	0.2	0.6
09/18/2022 16:00	3,422.8	0.0	3,422.8	104,400.0	357.3	0.43	0.2	0.7
09/18/2022 17:00	3,901.5	0.0	3,901.5	104,400.0	407.3	0.49	0.2	0.8
09/18/2022 18:00	3,820.6	0.0	3,820.6	104,400.0	398.9	0.48	0.2	0.8
09/18/2022 19:00	3,973.9	0.0	3,973.9	104,400.0	414.9	0.50	0.2	0.8
09/18/2022 20:00	4,077.4	0.0	4,077.4	104,400.0	425.7	0.51	0.3	0.9
09/18/2022 21:00	3,991.7	0.0	3,991.7	104,400.0	416.7	0.50	0.3	0.8
09/18/2022 22:00	2,692.7	0.0	2,692.7	104,400.0	281.1	0.34	0.2	0.6
09/18/2022 23:00	2,750.9	0.0	2,750.9	104,400.0	287.2	0.34	0.2	0.6
Average/Sum#:	3,085.0	0.0	3,085.0	104,400.0	322.1	0.39	0.2	0.7
Minimum:	2,630.3	0.0	2,630.3	104,400.0	274.6	0.33	0.2	0.6
Maximum:	4,077.4	0.0	4,077.4	104,400.0	425.7	0.51	0.3	0.9
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1	Unit CT1	Unit CT1
	PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr					
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/19/2022 00:00	2,760.7	0.0	2,760.7	104,400.0	288.2	0.35	0.2	0.6
09/19/2022 01:00	2,764.7	0.0	2,764.7	104,400.0	288.6	0.35	0.2	0.6
09/19/2022 02:00	2,764.3	0.0	2,764.3	104,400.0	288.6	0.35	0.2	0.6
09/19/2022 03:00	2,758.0	0.0	2,758.0	104,400.0	287.9	0.35	0.2	0.6
09/19/2022 04:00	3,285.6	0.0	3,285.6	104,400.0	343.0	0.41	0.2	0.7
09/19/2022 05:00	4,058.9	0.0	4,058.9	104,400.0	423.7	0.51	0.3	0.8
09/19/2022 06:00	3,805.1	0.0	3,805.1	104,400.0	397.3	0.48	0.2	0.8
09/19/2022 07:00	4,063.7	0.0	4,063.7	104,400.0	424.3	0.51	0.3	0.8
09/19/2022 08:00	4,412.0	0.0	4,412.0	104,400.0	460.6	0.55	0.3	0.9
09/19/2022 09:00	3,340.8	0.0	3,340.8	104,400.0	348.8	0.42	0.2	0.7
09/19/2022 10:00	2,764.0	0.0	2,764.0	104,400.0	288.6	0.35	0.2	0.6
09/19/2022 11:00	3,006.0	0.0	3,006.0	104,400.0	313.8	0.38	0.2	0.6
09/19/2022 12:00	2,883.3	0.0	2,883.3	104,400.0	301.0	0.36	0.2	0.6
09/19/2022 13:00	2,937.4	0.0	2,937.4	104,400.0	306.7	0.37	0.2	0.6
09/19/2022 14:00	2,858.1	0.0	2,858.1	104,400.0	298.4	0.36	0.2	0.6
09/19/2022 15:00	2,757.8	0.0	2,757.8	104,400.0	287.9	0.34	0.2	0.6
09/19/2022 16:00	3,824.4	172.1	3,881.2	104,400.0	405.2	0.50	0.3	0.8
09/19/2022 17:00	4,392.5	1,268.2	5,660.7	104,400.0	591.0	0.71	0.4	1.2
09/19/2022 18:00	4,391.7	972.4	5,364.1	104,400.0	560.0	0.67	0.3	1.1
09/19/2022 19:00	4,402.6	759.5	5,162.1	104,400.0	538.9	0.65	0.3	1.1
09/19/2022 20:00	4,425.3	600.2	5,025.5	104,400.0	524.7	0.63	0.3	1.0
09/19/2022 21:00	4,433.5	375.5	4,809.0	104,400.0	502.1	0.60	0.3	1.0
09/19/2022 22:00	3,846.9	83.6	3,882.8	104,400.0	405.4	0.49	0.2	0.8
09/19/2022 23:00	3,788.5	0.0	3,788.5	104,400.0	395.5	0.47	0.2	0.8
Average/Sum#:	3,530.2	176.3	3,699.8	104,400.0	386.3	0.47	0.2	0.8
Minimum:	2,757.8	0.0	2,757.8	104,400.0	287.9	0.34	0.2	0.6
Maximum:	4,433.5	1,268.2	5,660.7	104,400.0	591.0	0.71	0.4	1.2
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1	Unit CT1	Unit CT1
	PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr					
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/20/2022 00:00	3,671.8	0.0	3,671.8	104,400.0	383.3	0.46	0.2	0.8
09/20/2022 01:00	3,117.1	0.0	3,117.1	104,400.0	325.4	0.39	0.2	0.7
09/20/2022 02:00	2,922.9	0.0	2,922.9	104,400.0	305.2	0.37	0.2	0.6
09/20/2022 03:00	4,044.8	0.0	4,044.8	104,400.0	422.3	0.51	0.3	0.8
09/20/2022 04:00	4,392.3	7.8	4,392.7	104,400.0	458.6	0.55	0.3	0.9
09/20/2022 05:00	4,341.1	0.0	4,341.1	104,400.0	453.2	0.55	0.3	0.9
09/20/2022 06:00	3,367.9	0.0	3,367.9	104,400.0	351.6	0.42	0.2	0.7
09/20/2022 07:00	2,811.3	0.0	2,811.3	104,400.0	293.5	0.35	0.2	0.6
09/20/2022 08:00	2,851.0	0.0	2,851.0	104,400.0	297.6	0.36	0.2	0.6
09/20/2022 09:00	2,807.6	0.0	2,807.6	104,400.0	293.1	0.35	0.2	0.6
09/20/2022 10:00	2,644.7	0.0	2,644.7	104,400.0	276.1	0.33	0.2	0.6
09/20/2022 11:00	3,265.3	0.0	3,265.3	104,400.0	340.9	0.41	0.2	0.7
09/20/2022 12:00	2,855.0	0.0	2,855.0	104,400.0	298.1	0.36	0.2	0.6
09/20/2022 13:00	2,801.8	0.0	2,801.8	104,400.0	292.5	0.35	0.2	0.6
09/20/2022 14:00	2,775.3	0.0	2,775.3	104,400.0	289.7	0.35	0.2	0.6
09/20/2022 15:00	2,722.6	0.0	2,722.6	104,400.0	284.2	0.34	0.2	0.6
09/20/2022 16:00	3,680.3	106.8	3,710.2	104,400.0	387.3	0.47	0.2	0.8
09/20/2022 17:00	4,415.0	1,141.1	5,556.1	104,400.0	580.1	0.70	0.3	1.2
09/20/2022 18:00	4,415.2	1,229.6	5,644.8	104,400.0	589.3	0.71	0.4	1.2
09/20/2022 19:00	4,421.1	899.3	5,320.4	104,400.0	555.4	0.67	0.3	1.1
09/20/2022 20:00	4,415.2	1,001.4	5,416.6	104,400.0	565.5	0.68	0.3	1.1
09/20/2022 21:00	4,421.1	963.8	5,384.9	104,400.0	562.2	0.67	0.3	1.1
09/20/2022 22:00	4,424.7	577.4	5,002.1	104,400.0	522.2	0.63	0.3	1.0
09/20/2022 23:00	4,266.6	2.1	4,266.6	104,400.0	445.4	0.53	0.3	0.9
Average/Sum#:	3,577.2	247.1	3,820.6	104,400.0	398.9	0.48	0.2	0.8
Minimum:	2,644.7	0.0	2,644.7	104,400.0	276.1	0.33	0.2	0.6
Maximum:	4,424.7	1,229.6	5,644.8	104,400.0	589.3	0.71	0.4	1.2
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1	Unit CT1	Unit CT1
	PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr					
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/21/2022 00:00	4,239.2	0.0	4,239.2	104,400.0	442.6	0.53	0.3	0.9
09/21/2022 01:00	3,761.5	0.0	3,761.5	104,400.0	392.7	0.47	0.2	0.8
09/21/2022 02:00	3,798.2	0.0	3,798.2	104,400.0	396.5	0.47	0.2	0.8
09/21/2022 03:00	4,432.9	0.0	4,432.9	104,400.0	462.8	0.56	0.3	0.9
09/21/2022 04:00	4,433.6	0.0	4,433.6	104,400.0	462.9	0.56	0.3	0.9
09/21/2022 05:00	4,392.9	0.0	4,392.9	104,400.0	458.6	0.55	0.3	0.9
09/21/2022 06:00	3,642.8	0.0	3,642.8	104,400.0	380.3	0.46	0.2	0.8
09/21/2022 07:00	4,303.8	0.0	4,303.8	104,400.0	449.3	0.54	0.3	0.9
09/21/2022 08:00	4,171.4	0.0	4,171.4	104,400.0	435.5	0.52	0.3	0.9
09/21/2022 09:00	4,069.9	0.0	4,069.9	104,400.0	424.9	0.51	0.3	0.8
09/21/2022 10:00	3,204.4	0.0	3,204.4	104,400.0	334.5	0.40	0.2	0.7
09/21/2022 11:00	3,912.3	0.0	3,912.3	104,400.0	408.4	0.49	0.2	0.8
09/21/2022 12:00	2,824.9	0.0	2,824.9	104,400.0	294.9	0.35	0.2	0.6
09/21/2022 13:00	2,766.3	0.0	2,766.3	104,400.0	288.8	0.35	0.2	0.6
09/21/2022 14:00	3,740.3	0.0	3,740.3	104,400.0	390.5	0.47	0.2	0.8
09/21/2022 15:00	2,749.7	0.0	2,749.7	104,400.0	287.1	0.34	0.2	0.6
09/21/2022 16:00	3,315.9	0.0	3,315.9	104,400.0	346.2	0.42	0.2	0.7
09/21/2022 17:00	3,940.7	0.0	3,940.7	104,400.0	411.4	0.50	0.2	0.8
09/21/2022 18:00	3,616.9	0.0	3,616.9	104,400.0	377.6	0.45	0.2	0.8
09/21/2022 19:00	3,277.6	0.0	3,277.6	104,400.0	342.2	0.41	0.2	0.7
09/21/2022 20:00	3,104.6	0.0	3,104.6	104,400.0	324.1	0.39	0.2	0.6
09/21/2022 21:00	2,752.3	0.0	2,752.3	104,400.0	287.3	0.34	0.2	0.6
09/21/2022 22:00	2,700.0	0.0	2,700.0	104,400.0	281.9	0.34	0.2	0.6
09/21/2022 23:00	2,767.0	0.0	2,767.0	104,400.0	288.9	0.35	0.2	0.6
Average/Sum#:	3,580.0	0.0	3,580.0	104,400.0	373.7	0.45	0.2	0.8
Minimum:	2,700.0	0.0	2,700.0	104,400.0	281.9	0.34	0.2	0.6
Maximum:	4,433.6	0.0	4,433.6	104,400.0	462.9	0.56	0.3	0.9
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 **To:** 09/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1	Unit CT1	Unit CT1
	PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr					
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/22/2022 00:00	2,772.5	0.0	2,772.5	104,400.0	289.4	0.35	0.2	0.6
09/22/2022 01:00	2,776.6	0.0	2,776.6	104,400.0	289.9	0.35	0.2	0.6
09/22/2022 02:00	2,765.5	0.0	2,765.5	104,400.0	288.7	0.35	0.2	0.6
09/22/2022 03:00	2,761.1	0.0	2,761.1	104,400.0	288.3	0.35	0.2	0.6
09/22/2022 04:00	3,112.5	0.0	3,112.5	104,400.0	324.9	0.39	0.2	0.7
09/22/2022 05:00	3,452.1	0.0	3,452.1	104,400.0	360.4	0.43	0.2	0.7
09/22/2022 06:00	3,193.6	0.0	3,193.6	104,400.0	333.4	0.40	0.2	0.7
09/22/2022 07:00	3,590.2	0.0	3,590.2	104,400.0	374.8	0.45	0.2	0.7
09/22/2022 08:00	3,549.3	0.0	3,549.3	104,400.0	370.5	0.44	0.2	0.7
09/22/2022 09:00	3,546.1	0.0	3,546.1	104,400.0	370.2	0.44	0.2	0.7
09/22/2022 10:00	3,545.7	0.0	3,545.7	104,400.0	370.2	0.44	0.2	0.7
09/22/2022 11:00	3,542.6	0.0	3,542.6	104,400.0	369.8	0.44	0.2	0.7
09/22/2022 12:00	3,550.3	0.0	3,550.3	104,400.0	370.7	0.44	0.2	0.7
09/22/2022 13:00	3,268.2	0.0	3,268.2	104,400.0	341.2	0.41	0.2	0.7
09/22/2022 14:00	2,683.2	0.0	2,683.2	104,400.0	280.1	0.34	0.2	0.6
09/22/2022 15:00	2,664.8	0.0	2,664.8	104,400.0	278.2	0.33	0.2	0.6
09/22/2022 16:00	2,979.1	0.0	2,979.1	104,400.0	311.0	0.37	0.2	0.6
09/22/2022 17:00	2,781.6	0.0	2,781.6	104,400.0	290.4	0.35	0.2	0.6
09/22/2022 18:00	2,798.5	0.0	2,798.5	104,400.0	292.2	0.35	0.2	0.6
09/22/2022 19:00	3,100.7	0.0	3,100.7	104,400.0	323.7	0.39	0.2	0.6
09/22/2022 20:00	3,374.3	0.0	3,374.3	104,400.0	352.3	0.42	0.2	0.7
09/22/2022 21:00	3,316.2	0.0	3,316.2	104,400.0	346.2	0.45	0.2	0.7
09/22/2022 22:00	0.0	0.0	0.0	104,400.0	0.0	0.00	0.0	0.0
09/22/2022 23:00	0.0	0.0	0.0	104,400.0	0.0	0.00	0.0	0.0
Average/Sum#:	3,142.0	0.0	3,142.0	104,400.0	328.0	0.39	0.2	0.7
Minimum:	2,664.8	0.0	2,664.8	104,400.0	278.2	0.33	0.2	0.6
Maximum:	3,590.2	0.0	3,590.2	104,400.0	374.8	0.45	0.2	0.7
%SI	8.33	8.33	8.33	0.00	8.33	8.33	8.33	8.33

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1 GasFlow, _CT, 100scfh	Unit CT1 GasFlow, _DB, 100scfh	Unit CT1 GasFlowTotal, 100scfh	Unit CT1 GCVGas, BtuPer100scf	Unit CT1 HI, MBtuPerHr	> 4.73 Unit CT1 PM10_Norm, LbPerHr	> 1 Unit CT1 SO2_Norm, LbPerHr	> 1.8 Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/23/2022 00:00	0.0	0.0	0.0	104,400.0	0.0	0.00	0.0	0.0
09/23/2022 01:00	0.0	0.0	0.0	104,400.0	0.0	0.00	0.0	0.0
09/23/2022 02:00	0.0	0.0	0.0	104,400.0	0.0	0.00	0.0	0.0
09/23/2022 03:00	0.0	0.0	0.0	104,400.0	0.0	0.00	0.0	0.0
09/23/2022 04:00	0.0	0.0	0.0	104,400.0	0.0	0.00	0.0	0.0
09/23/2022 05:00	0.0	0.0	0.0	104,400.0	0.0	0.00	0.0	0.0
09/23/2022 06:00	0.0	0.0	0.0	104,400.0	0.0	0.00	0.0	0.0
09/23/2022 07:00	0.0	0.0	0.0	104,400.0	0.0	0.00	0.0	0.0
09/23/2022 08:00	0.0	0.0	0.0	104,400.0	0.0	0.00	0.0	0.0
09/23/2022 09:00	0.0	0.0	0.0	104,400.0	0.0	0.00	0.0	0.0
09/23/2022 10:00	0.0	0.0	0.0	104,400.0	0.0	0.00	0.0	0.0
09/23/2022 11:00	0.0	0.0	0.0	104,400.0	0.0	0.00	0.0	0.0
09/23/2022 12:00	2,073.6	0.0	2,073.6	104,400.0	216.5	0.00	0.0	0.0
09/23/2022 13:00	3,494.3	0.0	3,494.3	104,400.0	364.8	0.44	0.2	0.7
09/23/2022 14:00	3,105.6	0.0	3,105.6	104,400.0	324.2	0.39	0.2	0.6
09/23/2022 15:00	4,225.0	0.0	4,225.0	104,400.0	441.1	0.53	0.3	0.9
09/23/2022 16:00	3,677.1	0.0	3,677.1	104,400.0	383.9	0.46	0.2	0.8
09/23/2022 17:00	4,344.4	461.7	4,806.1	104,400.0	501.8	0.60	0.3	1.0
09/23/2022 18:00	4,356.1	416.3	4,772.4	104,400.0	498.2	0.60	0.3	1.0
09/23/2022 19:00	4,362.8	385.3	4,748.1	104,400.0	495.7	0.59	0.3	1.0
09/23/2022 20:00	4,381.0	600.7	4,981.7	104,400.0	520.1	0.62	0.3	1.0
09/23/2022 21:00	4,382.6	694.2	5,076.8	104,400.0	530.0	0.64	0.3	1.1
09/23/2022 22:00	3,927.1	95.4	3,953.8	104,400.0	412.8	0.50	0.3	0.8
09/23/2022 23:00	3,845.8	0.0	3,845.8	104,400.0	401.5	0.48	0.2	0.8
Average/Sum#:	3,848.0	221.1	4,063.4	104,400.0	424.2	0.53	0.3	0.9
Minimum:	2,073.6	0.0	2,073.6	104,400.0	216.5	0.39	0.2	0.6
Maximum:	4,382.6	694.2	5,076.8	104,400.0	530.0	0.64	0.3	1.1
%SI	50.00	50.00	50.00	0.00	50.00	54.17	54.17	54.17

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1	Unit CT1	Unit CT1
						PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/24/2022 00:00	3,283.2	0.0	3,283.2	104,400.0	342.8	0.41	0.2	0.7
09/24/2022 01:00	3,087.0	0.0	3,087.0	104,400.0	322.3	0.39	0.2	0.6
09/24/2022 02:00	3,582.3	0.0	3,582.3	104,400.0	374.0	0.45	0.2	0.7
09/24/2022 03:00	3,838.0	0.0	3,838.0	104,400.0	400.7	0.48	0.2	0.8
09/24/2022 04:00	4,059.7	0.0	4,059.7	104,400.0	423.8	0.51	0.3	0.8
09/24/2022 05:00	3,842.1	0.0	3,842.1	104,400.0	401.1	0.48	0.2	0.8
09/24/2022 06:00	2,830.4	0.0	2,830.4	104,400.0	295.5	0.35	0.2	0.6
09/24/2022 07:00	2,642.6	0.0	2,642.6	104,400.0	275.9	0.33	0.2	0.6
09/24/2022 08:00	2,643.9	0.0	2,643.9	104,400.0	276.0	0.33	0.2	0.6
09/24/2022 09:00	2,646.3	0.0	2,646.3	104,400.0	276.3	0.33	0.2	0.6
09/24/2022 10:00	2,647.8	0.0	2,647.8	104,400.0	276.4	0.33	0.2	0.6
09/24/2022 11:00	2,645.8	0.0	2,645.8	104,400.0	276.2	0.33	0.2	0.6
09/24/2022 12:00	2,711.6	0.0	2,711.6	104,400.0	283.1	0.34	0.2	0.6
09/24/2022 13:00	2,783.2	0.0	2,783.2	104,400.0	290.6	0.35	0.2	0.6
09/24/2022 14:00	3,681.5	52.7	3,696.3	104,400.0	385.9	0.47	0.2	0.8
09/24/2022 15:00	4,037.7	55.4	4,047.1	104,400.0	422.5	0.51	0.3	0.9
09/24/2022 16:00	3,944.9	57.1	3,960.9	104,400.0	413.5	0.50	0.3	0.8
09/24/2022 17:00	4,195.5	37.4	4,202.2	104,400.0	438.7	0.53	0.3	0.9
09/24/2022 18:00	3,819.0	0.0	3,819.0	104,400.0	398.7	0.48	0.2	0.8
09/24/2022 19:00	3,981.5	0.0	3,981.5	104,400.0	415.7	0.50	0.2	0.8
09/24/2022 20:00	4,290.9	0.0	4,290.9	104,400.0	448.0	0.54	0.3	0.9
09/24/2022 21:00	4,330.4	0.0	4,330.4	104,400.0	452.1	0.54	0.3	0.9
09/24/2022 22:00	4,177.5	0.0	4,177.5	104,400.0	436.1	0.52	0.3	0.9
09/24/2022 23:00	3,879.1	0.0	3,879.1	104,400.0	405.0	0.49	0.2	0.8
Average/Sum#:	3,482.6	8.4	3,484.5	104,400.0	363.8	0.44	0.2	0.7
Minimum:	2,642.6	0.0	2,642.6	104,400.0	275.9	0.33	0.2	0.6
Maximum:	4,330.4	57.1	4,330.4	104,400.0	452.1	0.54	0.3	0.9
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1	Unit CT1	Unit CT1
	PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr					
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/25/2022 00:00	3,566.0	0.0	3,566.0	104,400.0	372.3	0.45	0.2	0.7
09/25/2022 01:00	3,242.6	0.0	3,242.6	104,400.0	338.5	0.41	0.2	0.7
09/25/2022 02:00	3,898.5	0.0	3,898.5	104,400.0	407.0	0.49	0.2	0.8
09/25/2022 03:00	3,280.1	0.0	3,280.1	104,400.0	342.4	0.41	0.2	0.7
09/25/2022 04:00	2,847.5	0.0	2,847.5	104,400.0	297.3	0.36	0.2	0.6
09/25/2022 05:00	2,922.3	0.0	2,922.3	104,400.0	305.1	0.37	0.2	0.6
09/25/2022 06:00	2,651.3	0.0	2,651.3	104,400.0	276.8	0.33	0.2	0.6
09/25/2022 07:00	2,633.4	0.0	2,633.4	104,400.0	274.9	0.33	0.2	0.6
09/25/2022 08:00	2,641.7	0.0	2,641.7	104,400.0	275.8	0.33	0.2	0.6
09/25/2022 09:00	2,640.9	0.0	2,640.9	104,400.0	275.7	0.33	0.2	0.6
09/25/2022 10:00	2,644.5	0.0	2,644.5	104,400.0	276.1	0.33	0.2	0.6
09/25/2022 11:00	2,645.7	0.0	2,645.7	104,400.0	276.2	0.33	0.2	0.6
09/25/2022 12:00	2,636.3	0.0	2,636.3	104,400.0	275.2	0.33	0.2	0.6
09/25/2022 13:00	2,714.4	0.0	2,714.4	104,400.0	283.4	0.34	0.2	0.6
09/25/2022 14:00	2,892.8	0.0	2,892.8	104,400.0	302.0	0.36	0.2	0.6
09/25/2022 15:00	3,074.1	0.0	3,074.1	104,400.0	320.9	0.39	0.2	0.6
09/25/2022 16:00	3,839.7	14.6	3,840.7	104,400.0	401.0	0.48	0.2	0.8
09/25/2022 17:00	4,132.6	0.0	4,132.6	104,400.0	431.4	0.52	0.3	0.9
09/25/2022 18:00	3,975.5	0.0	3,975.5	104,400.0	415.0	0.50	0.2	0.8
09/25/2022 19:00	3,854.7	0.0	3,854.7	104,400.0	402.4	0.48	0.2	0.8
09/25/2022 20:00	3,881.3	0.0	3,881.3	104,400.0	405.2	0.49	0.2	0.8
09/25/2022 21:00	3,568.6	0.0	3,568.6	104,400.0	372.6	0.45	0.2	0.7
09/25/2022 22:00	2,745.2	0.0	2,745.2	104,400.0	286.6	0.34	0.2	0.6
09/25/2022 23:00	2,777.8	0.0	2,777.8	104,400.0	290.0	0.35	0.2	0.6
Average/Sum#:	3,154.5	0.6	3,154.5	104,400.0	329.3	0.40	0.2	0.7
Minimum:	2,633.4	0.0	2,633.4	104,400.0	274.9	0.33	0.2	0.6
Maximum:	4,132.6	14.6	4,132.6	104,400.0	431.4	0.52	0.3	0.9
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1	Unit CT1	Unit CT1
	PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr					
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/26/2022 00:00	2,840.3	0.0	2,840.3	104,400.0	296.5	0.36	0.2	0.6
09/26/2022 01:00	2,769.6	0.0	2,769.6	104,400.0	289.1	0.35	0.2	0.6
09/26/2022 02:00	2,765.2	0.0	2,765.2	104,400.0	288.7	0.35	0.2	0.6
09/26/2022 03:00	2,760.8	0.0	2,760.8	104,400.0	288.2	0.35	0.2	0.6
09/26/2022 04:00	3,335.8	0.0	3,335.8	104,400.0	348.3	0.42	0.2	0.7
09/26/2022 05:00	3,274.4	0.0	3,274.4	104,400.0	341.8	0.41	0.2	0.7
09/26/2022 06:00	2,746.5	0.0	2,746.5	104,400.0	286.7	0.34	0.2	0.6
09/26/2022 07:00	2,626.2	0.0	2,626.2	104,400.0	274.2	0.33	0.2	0.6
09/26/2022 08:00	2,626.9	0.0	2,626.9	104,400.0	274.2	0.33	0.2	0.6
09/26/2022 09:00	2,628.5	0.0	2,628.5	104,400.0	274.4	0.33	0.2	0.6
09/26/2022 10:00	2,626.5	0.0	2,626.5	104,400.0	274.2	0.33	0.2	0.6
09/26/2022 11:00	2,634.0	0.0	2,634.0	104,400.0	275.0	0.33	0.2	0.6
09/26/2022 12:00	2,705.7	0.0	2,705.7	104,400.0	282.5	0.34	0.2	0.6
09/26/2022 13:00	2,757.2	0.0	2,757.2	104,400.0	287.9	0.35	0.2	0.6
09/26/2022 14:00	2,968.2	0.0	2,968.2	104,400.0	309.9	0.37	0.2	0.6
09/26/2022 15:00	3,283.7	0.0	3,283.7	104,400.0	342.8	0.41	0.2	0.7
09/26/2022 16:00	3,428.2	0.0	3,428.2	104,400.0	357.9	0.43	0.2	0.7
09/26/2022 17:00	3,461.8	0.0	3,461.8	104,400.0	361.4	0.43	0.2	0.7
09/26/2022 18:00	2,760.5	0.0	2,760.5	104,400.0	288.2	0.35	0.2	0.6
09/26/2022 19:00	2,751.3	0.0	2,751.3	104,400.0	287.2	0.34	0.2	0.6
09/26/2022 20:00	2,777.8	0.0	2,777.8	104,400.0	290.0	0.35	0.2	0.6
09/26/2022 21:00	3,192.4	0.0	3,192.4	104,400.0	333.3	0.40	0.2	0.7
09/26/2022 22:00	3,372.6	4.2	3,372.7	104,400.0	352.1	0.42	0.2	0.7
09/26/2022 23:00	4,399.7	485.7	4,885.4	104,400.0	510.0	0.61	0.3	1.0
Average/Sum#:	2,978.9	20.4	2,999.2	104,400.0	313.1	0.38	0.2	0.6
Minimum:	2,626.2	0.0	2,626.2	104,400.0	274.2	0.33	0.2	0.6
Maximum:	4,399.7	485.7	4,885.4	104,400.0	510.0	0.61	0.3	1.0
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1 PM10_Norm, LbPerHr	Unit CT1 SO2_Norm, LbPerHr	Unit CT1 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/27/2022 00:00	4,409.9	592.7	5,002.6	104,400.0	522.3	0.63	0.3	1.0
09/27/2022 01:00	4,427.4	479.2	4,906.6	104,400.0	512.2	0.62	0.3	1.0
09/27/2022 02:00	4,427.5	426.5	4,854.0	104,400.0	506.8	0.61	0.3	1.0
09/27/2022 03:00	4,445.6	350.8	4,796.4	104,400.0	500.7	0.60	0.3	1.0
09/27/2022 04:00	4,451.1	587.1	5,038.2	104,400.0	526.0	0.63	0.3	1.1
09/27/2022 05:00	4,449.4	780.5	5,229.9	104,400.0	546.0	0.66	0.3	1.1
09/27/2022 06:00	4,466.1	284.2	4,750.3	104,400.0	495.9	0.60	0.3	1.0
09/27/2022 07:00	4,028.4	64.0	4,060.4	104,400.0	423.9	0.51	0.3	0.9
09/27/2022 08:00	2,623.5	0.0	2,623.5	104,400.0	273.9	0.33	0.2	0.6
09/27/2022 09:00	2,627.1	0.0	2,627.1	104,400.0	274.3	0.33	0.2	0.6
09/27/2022 10:00	2,653.9	0.0	2,653.9	104,400.0	277.1	0.33	0.2	0.6
09/27/2022 11:00	3,788.9	94.8	3,824.9	104,400.0	399.3	0.49	0.2	0.8
09/27/2022 12:00	4,407.7	619.1	5,026.8	104,400.0	524.8	0.63	0.3	1.0
09/27/2022 13:00	4,380.3	346.1	4,726.4	104,400.0	493.4	0.59	0.3	1.0
09/27/2022 14:00	4,360.8	375.5	4,736.3	104,400.0	494.5	0.59	0.3	1.0
09/27/2022 15:00	4,323.7	264.4	4,516.7	104,400.0	471.5	0.58	0.3	1.0
09/27/2022 16:00	2,880.9	0.0	2,880.9	104,400.0	300.8	0.36	0.2	0.6
09/27/2022 17:00	3,193.9	0.0	3,193.9	104,400.0	333.4	0.40	0.2	0.7
09/27/2022 18:00	4,397.0	305.9	4,693.7	104,400.0	490.0	0.59	0.3	1.0
09/27/2022 19:00	4,398.5	286.5	4,685.0	104,400.0	489.1	0.59	0.3	1.0
09/27/2022 20:00	4,417.5	260.2	4,677.7	104,400.0	488.4	0.59	0.3	1.0
09/27/2022 21:00	4,420.1	327.0	4,747.1	104,400.0	495.6	0.59	0.3	1.0
09/27/2022 22:00	4,419.9	225.9	4,645.8	104,400.0	485.0	0.58	0.3	1.0
09/27/2022 23:00	4,135.9	18.5	4,138.7	104,400.0	432.1	0.52	0.3	0.9
Average/Sum#:	4,022.3	278.7	4,293.2	104,400.0	448.2	0.54	0.3	0.9
Minimum:	2,623.5	0.0	2,623.5	104,400.0	273.9	0.33	0.2	0.6
Maximum:	4,466.1	780.5	5,229.9	104,400.0	546.0	0.66	0.3	1.1
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1	Unit CT1	Unit CT1
	PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr					
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/28/2022 00:00	4,042.2	0.0	4,042.2	104,400.0	422.0	0.51	0.3	0.8
09/28/2022 01:00	4,027.2	0.0	4,027.2	104,400.0	420.4	0.51	0.3	0.8
09/28/2022 02:00	4,035.3	0.0	4,035.3	104,400.0	421.3	0.51	0.3	0.8
09/28/2022 03:00	4,071.3	0.0	4,071.3	104,400.0	425.0	0.51	0.3	0.8
09/28/2022 04:00	4,112.7	0.0	4,112.7	104,400.0	429.4	0.52	0.3	0.9
09/28/2022 05:00	4,120.4	0.0	4,120.4	104,400.0	430.2	0.52	0.3	0.9
09/28/2022 06:00	3,977.8	0.0	3,977.8	104,400.0	415.3	0.50	0.2	0.8
09/28/2022 07:00	2,662.0	0.0	2,662.0	104,400.0	277.9	0.33	0.2	0.6
09/28/2022 08:00	2,633.0	0.0	2,633.0	104,400.0	274.9	0.33	0.2	0.6
09/28/2022 09:00	2,634.4	0.0	2,634.4	104,400.0	275.0	0.33	0.2	0.6
09/28/2022 10:00	2,661.3	0.0	2,661.3	104,400.0	277.8	0.33	0.2	0.6
09/28/2022 11:00	2,749.8	0.0	2,749.8	104,400.0	287.1	0.35	0.2	0.6
09/28/2022 12:00	2,746.6	0.0	2,746.6	104,400.0	286.7	0.35	0.2	0.6
09/28/2022 13:00	2,741.7	0.0	2,741.7	104,400.0	286.2	0.34	0.2	0.6
09/28/2022 14:00	3,163.9	0.0	3,163.9	104,400.0	330.3	0.40	0.2	0.7
09/28/2022 15:00	2,726.0	0.0	2,726.0	104,400.0	284.6	0.34	0.2	0.6
09/28/2022 16:00	2,654.4	0.0	2,654.4	104,400.0	277.1	0.33	0.2	0.6
09/28/2022 17:00	2,646.3	0.0	2,646.3	104,400.0	276.3	0.33	0.2	0.6
09/28/2022 18:00	2,727.4	0.0	2,727.4	104,400.0	284.7	0.34	0.2	0.6
09/28/2022 19:00	2,696.8	0.0	2,696.8	104,400.0	281.5	0.34	0.2	0.6
09/28/2022 20:00	2,762.6	0.0	2,762.6	104,400.0	288.4	0.35	0.2	0.6
09/28/2022 21:00	3,357.7	0.0	3,357.7	104,400.0	350.5	0.42	0.2	0.7
09/28/2022 22:00	3,573.5	0.0	3,573.5	104,400.0	373.1	0.45	0.2	0.7
09/28/2022 23:00	3,857.1	0.0	3,857.1	104,400.0	402.7	0.48	0.2	0.8
Average/Sum#:	3,224.2	0.0	3,224.2	104,400.0	336.6	0.41	0.2	0.7
Minimum:	2,633.0	0.0	2,633.0	104,400.0	274.9	0.33	0.2	0.6
Maximum:	4,120.4	0.0	4,120.4	104,400.0	430.2	0.52	0.3	0.9
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1	Unit CT1	Unit CT1
						PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/29/2022 00:00	3,523.0	0.0	3,523.0	104,400.0	367.8	0.44	0.2	0.7
09/29/2022 01:00	2,973.6	0.0	2,973.6	104,400.0	310.4	0.37	0.2	0.6
09/29/2022 02:00	2,908.7	0.0	2,908.7	104,400.0	303.7	0.37	0.2	0.6
09/29/2022 03:00	3,098.2	0.0	3,098.2	104,400.0	323.5	0.39	0.2	0.6
09/29/2022 04:00	3,508.7	0.0	3,508.7	104,400.0	366.3	0.44	0.2	0.7
09/29/2022 05:00	3,865.0	0.0	3,865.0	104,400.0	403.5	0.48	0.2	0.8
09/29/2022 06:00	3,572.7	0.0	3,572.7	104,400.0	373.0	0.45	0.2	0.7
09/29/2022 07:00	3,743.6	0.0	3,743.6	104,400.0	390.8	0.47	0.2	0.8
09/29/2022 08:00	2,862.4	0.0	2,862.4	104,400.0	298.8	0.36	0.2	0.6
09/29/2022 09:00	2,719.3	0.0	2,719.3	104,400.0	283.9	0.34	0.2	0.6
09/29/2022 10:00	2,638.8	0.0	2,638.8	104,400.0	275.5	0.33	0.2	0.6
09/29/2022 11:00	2,673.4	0.0	2,673.4	104,400.0	279.1	0.34	0.2	0.6
09/29/2022 12:00	2,704.3	0.0	2,704.3	104,400.0	282.3	0.34	0.2	0.6
09/29/2022 13:00	2,929.1	0.0	2,929.1	104,400.0	305.8	0.37	0.2	0.6
09/29/2022 14:00	2,768.6	0.0	2,768.6	104,400.0	289.0	0.35	0.2	0.6
09/29/2022 15:00	2,806.8	0.0	2,806.8	104,400.0	293.0	0.35	0.2	0.6
09/29/2022 16:00	3,668.1	155.9	3,730.5	104,400.0	389.5	0.48	0.2	0.8
09/29/2022 17:00	4,368.7	434.9	4,803.6	104,400.0	501.5	0.60	0.3	1.0
09/29/2022 18:00	4,370.8	379.1	4,749.9	104,400.0	495.9	0.60	0.3	1.0
09/29/2022 19:00	4,379.0	355.3	4,734.3	104,400.0	494.3	0.59	0.3	1.0
09/29/2022 20:00	4,019.0	157.4	4,100.8	104,400.0	428.1	0.52	0.3	0.9
09/29/2022 21:00	2,820.8	0.0	2,820.8	104,400.0	294.5	0.35	0.2	0.6
09/29/2022 22:00	2,877.3	0.0	2,877.3	104,400.0	300.4	0.36	0.2	0.6
09/29/2022 23:00	3,919.6	0.0	3,919.6	104,400.0	409.2	0.49	0.2	0.8
Average/Sum#:	3,321.6	61.8	3,376.4	104,400.0	352.5	0.42	0.2	0.7
Minimum:	2,638.8	0.0	2,638.8	104,400.0	275.5	0.33	0.2	0.6
Maximum:	4,379.0	434.9	4,803.6	104,400.0	501.5	0.60	0.3	1.0
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:28 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT1	Unit CT1	Unit CT1
	PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr					
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/30/2022 00:00	3,745.2	0.0	3,745.2	104,400.0	391.0	0.47	0.2	0.8
09/30/2022 01:00	3,664.5	0.0	3,664.5	104,400.0	382.6	0.46	0.2	0.8
09/30/2022 02:00	3,585.1	0.0	3,585.1	104,400.0	374.3	0.45	0.2	0.7
09/30/2022 03:00	3,457.1	0.0	3,457.1	104,400.0	360.9	0.43	0.2	0.7
09/30/2022 04:00	3,982.7	0.0	3,982.7	104,400.0	415.8	0.50	0.2	0.8
09/30/2022 05:00	4,271.8	0.0	4,271.8	104,400.0	446.0	0.54	0.3	0.9
09/30/2022 06:00	3,656.4	0.0	3,656.4	104,400.0	381.7	0.46	0.2	0.8
09/30/2022 07:00	2,650.4	0.0	2,650.4	104,400.0	276.7	0.33	0.2	0.6
09/30/2022 08:00	2,669.5	0.0	2,669.5	104,400.0	278.7	0.33	0.2	0.6
09/30/2022 09:00	2,650.1	0.0	2,650.1	104,400.0	276.7	0.33	0.2	0.6
09/30/2022 10:00	2,663.0	0.0	2,663.0	104,400.0	278.0	0.33	0.2	0.6
09/30/2022 11:00	2,639.9	0.0	2,639.9	104,400.0	275.6	0.33	0.2	0.6
09/30/2022 12:00	2,668.8	0.0	2,668.8	104,400.0	278.6	0.33	0.2	0.6
09/30/2022 13:00	2,638.4	0.0	2,638.4	104,400.0	275.4	0.33	0.2	0.6
09/30/2022 14:00	2,636.8	0.0	2,636.8	104,400.0	275.3	0.33	0.2	0.6
09/30/2022 15:00	2,669.4	0.0	2,669.4	104,400.0	278.7	0.33	0.2	0.6
09/30/2022 16:00	3,467.0	0.0	3,467.0	104,400.0	362.0	0.43	0.2	0.7
09/30/2022 17:00	3,794.7	0.0	3,794.7	104,400.0	396.2	0.48	0.2	0.8
09/30/2022 18:00	2,795.5	0.0	2,795.5	104,400.0	291.9	0.35	0.2	0.6
09/30/2022 19:00	2,772.1	0.0	2,772.1	104,400.0	289.4	0.35	0.2	0.6
09/30/2022 20:00	2,934.0	0.0	2,934.0	104,400.0	306.3	0.37	0.2	0.6
09/30/2022 21:00	3,538.5	0.0	3,538.5	104,400.0	369.4	0.44	0.2	0.7
09/30/2022 22:00	2,806.2	0.0	2,806.2	104,400.0	293.0	0.35	0.2	0.6
09/30/2022 23:00	3,970.6	0.0	3,970.6	104,400.0	414.5	0.50	0.2	0.8
Average/Sum#:	3,180.3	0.0	3,180.3	104,400.0	332.0	0.40	0.2	0.7
Minimum:	2,636.8	0.0	2,636.8	104,400.0	275.3	0.33	0.2	0.6
Maximum:	4,271.8	0.0	4,271.8	104,400.0	446.0	0.54	0.3	0.9
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:29 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2	Unit CT2	Unit CT2
	PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr					
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/01/2022 00:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/01/2022 01:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/01/2022 02:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/01/2022 03:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/01/2022 04:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/01/2022 05:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/01/2022 06:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/01/2022 07:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/01/2022 08:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/01/2022 09:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/01/2022 10:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/01/2022 11:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/01/2022 12:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/01/2022 13:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/01/2022 14:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/01/2022 15:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/01/2022 16:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/01/2022 17:00	3,089.7	0.0	3,089.7	104,100.0	321.6	0.0	0.0	0.0
07/01/2022 18:00	4,665.9	160.4	4,738.1	104,100.0	493.2	0.6	0.3	1.0
07/01/2022 19:00	4,722.4	328.3	5,050.7	104,100.0	525.8	0.6	0.3	1.1
07/01/2022 20:00	4,791.1	261.4	5,052.5	104,100.0	526.0	0.6	0.3	1.1
07/01/2022 21:00	4,789.7	229.5	5,019.2	104,100.0	522.5	0.6	0.3	1.0
07/01/2022 22:00	4,505.0	101.0	4,557.5	104,100.0	474.4	0.6	0.3	1.0
07/01/2022 23:00	2,039.8	0.0	2,039.8	104,100.0	212.3	0.0	0.0	0.0
Average/Sum#:	4,086.2	154.4	4,221.1	104,100.0	439.4	0.6	0.3	1.0
Minimum:	2,039.8	0.0	2,039.8	104,100.0	212.3	0.6	0.3	1.0
Maximum:	4,791.1	328.3	5,052.5	104,100.0	526.0	0.6	0.3	1.1
%SI	70.83	70.83	70.83	0.00	70.83	79.17	79.17	79.17

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:29 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/02/2022 00:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/02/2022 01:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/02/2022 02:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/02/2022 03:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/02/2022 04:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/02/2022 05:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/02/2022 06:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/02/2022 07:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/02/2022 08:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/02/2022 09:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/02/2022 10:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/02/2022 11:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/02/2022 12:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/02/2022 13:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/02/2022 14:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/02/2022 15:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/02/2022 16:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/02/2022 17:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/02/2022 18:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/02/2022 19:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/02/2022 20:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/02/2022 21:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/02/2022 22:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/02/2022 23:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
Minimum:	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
Maximum:	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:29 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	> 4.73 Unit CT2 PM10_Norm, LbPerHr	> 1 Unit CT2 SO2_Norm, LbPerHr	> 1.8 Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/03/2022 00:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/03/2022 01:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/03/2022 02:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/03/2022 03:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/03/2022 04:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/03/2022 05:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/03/2022 06:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/03/2022 07:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/03/2022 08:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/03/2022 09:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/03/2022 10:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/03/2022 11:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/03/2022 12:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/03/2022 13:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/03/2022 14:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/03/2022 15:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/03/2022 16:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/03/2022 17:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/03/2022 18:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/03/2022 19:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/03/2022 20:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/03/2022 21:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/03/2022 22:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/03/2022 23:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
Minimum:	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
Maximum:	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:29 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/04/2022 00:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/04/2022 01:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/04/2022 02:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/04/2022 03:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/04/2022 04:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/04/2022 05:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/04/2022 06:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/04/2022 07:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/04/2022 08:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/04/2022 09:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/04/2022 10:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/04/2022 11:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/04/2022 12:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/04/2022 13:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/04/2022 14:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/04/2022 15:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/04/2022 16:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/04/2022 17:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/04/2022 18:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/04/2022 19:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/04/2022 20:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/04/2022 21:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/04/2022 22:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/04/2022 23:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
Minimum:	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
Maximum:	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:29 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	> 4.73 Unit CT2 PM10_Norm, LbPerHr	> 1 Unit CT2 SO2_Norm, LbPerHr	> 1.8 Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/05/2022 00:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/05/2022 01:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/05/2022 02:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/05/2022 03:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/05/2022 04:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/05/2022 05:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/05/2022 06:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/05/2022 07:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/05/2022 08:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/05/2022 09:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/05/2022 10:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/05/2022 11:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/05/2022 12:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/05/2022 13:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/05/2022 14:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/05/2022 15:00	2,572.5	0.0	2,572.5	104,100.0	267.8	0.0	0.0	0.0
07/05/2022 16:00	4,476.9	257.9	4,652.3	104,100.0	484.3	0.6	0.3	1.0
07/05/2022 17:00	4,649.6	413.3	5,062.9	104,100.0	527.0	0.6	0.3	1.1
07/05/2022 18:00	4,662.5	370.9	5,033.4	104,100.0	524.0	0.6	0.3	1.0
07/05/2022 19:00	4,700.3	330.3	5,030.6	104,100.0	523.7	0.6	0.3	1.0
07/05/2022 20:00	4,718.3	302.0	5,020.3	104,100.0	522.6	0.6	0.3	1.0
07/05/2022 21:00	3,760.7	64.3	3,778.1	104,100.0	393.3	0.5	0.3	0.8
07/05/2022 22:00	1,132.1	0.0	1,132.1	104,100.0	117.9	0.0	0.0	0.0
07/05/2022 23:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
Average/Sum#:	3,834.1	217.3	4,035.3	104,100.0	420.1	0.6	0.3	1.0
Minimum:	1,132.1	0.0	1,132.1	104,100.0	117.9	0.5	0.3	0.8
Maximum:	4,718.3	413.3	5,062.9	104,100.0	527.0	0.6	0.3	1.1
%SI	66.67	66.67	66.67	0.00	66.67	75.00	75.00	75.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:29 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2	Unit CT2	Unit CT2
	PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr					
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/06/2022 00:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/06/2022 01:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/06/2022 02:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/06/2022 03:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/06/2022 04:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/06/2022 05:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/06/2022 06:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/06/2022 07:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/06/2022 08:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/06/2022 09:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/06/2022 10:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/06/2022 11:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/06/2022 12:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/06/2022 13:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/06/2022 14:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/06/2022 15:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/06/2022 16:00	819.4	0.0	819.4	104,100.0	85.3	0.0	0.0	0.0
07/06/2022 17:00	3,178.3	0.0	3,178.3	104,100.0	330.9	0.5	0.2	0.8
07/06/2022 18:00	4,565.0	147.6	4,635.8	104,100.0	482.6	0.6	0.3	1.0
07/06/2022 19:00	4,737.9	267.6	5,005.5	104,100.0	521.1	0.6	0.3	1.0
07/06/2022 20:00	4,776.7	217.5	4,994.2	104,100.0	519.9	0.6	0.3	1.0
07/06/2022 21:00	4,318.2	99.3	4,369.8	104,100.0	454.9	0.6	0.3	0.9
07/06/2022 22:00	2,321.7	0.0	2,321.7	104,100.0	241.7	0.4	0.2	0.6
07/06/2022 23:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
Average/Sum#:	3,531.0	104.6	3,617.8	104,100.0	376.6	0.6	0.3	0.9
Minimum:	819.4	0.0	819.4	104,100.0	85.3	0.4	0.2	0.6
Maximum:	4,776.7	267.6	5,005.5	104,100.0	521.1	0.6	0.3	1.0
%SI	70.83	70.83	70.83	0.00	70.83	75.00	75.00	75.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:29 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2	Unit CT2	Unit CT2
	PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr					
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/07/2022 00:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/07/2022 01:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/07/2022 02:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/07/2022 03:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/07/2022 04:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/07/2022 05:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/07/2022 06:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/07/2022 07:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/07/2022 08:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/07/2022 09:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/07/2022 10:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/07/2022 11:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/07/2022 12:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/07/2022 13:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/07/2022 14:00	270.1	0.0	270.1	104,100.0	28.1	0.0	0.0	0.0
07/07/2022 15:00	3,050.1	0.0	3,050.1	104,100.0	317.5	0.4	0.2	0.7
07/07/2022 16:00	4,581.7	235.7	4,742.0	104,100.0	493.6	0.6	0.3	1.0
07/07/2022 17:00	4,676.3	495.4	5,171.7	104,100.0	538.4	0.6	0.3	1.1
07/07/2022 18:00	4,668.9	696.5	5,365.4	104,100.0	558.5	0.7	0.3	1.1
07/07/2022 19:00	4,698.4	317.4	5,015.8	104,100.0	522.1	0.6	0.3	1.0
07/07/2022 20:00	4,735.5	271.6	5,007.1	104,100.0	521.2	0.6	0.3	1.0
07/07/2022 21:00	4,750.2	270.0	5,020.2	104,100.0	522.6	0.6	0.3	1.0
07/07/2022 22:00	4,750.8	125.7	4,816.2	104,100.0	501.4	0.6	0.3	1.0
07/07/2022 23:00	2,952.9	0.0	2,952.9	104,100.0	307.4	0.4	0.2	0.7
Average/Sum#:	3,913.5	241.2	4,141.2	104,100.0	431.1	0.6	0.3	1.0
Minimum:	270.1	0.0	270.1	104,100.0	28.1	0.4	0.2	0.7
Maximum:	4,750.8	696.5	5,365.4	104,100.0	558.5	0.7	0.3	1.1
%SI	58.33	58.33	58.33	0.00	58.33	62.50	62.50	62.50

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:29 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/08/2022 00:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/08/2022 01:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/08/2022 02:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/08/2022 03:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/08/2022 04:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/08/2022 05:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/08/2022 06:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/08/2022 07:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/08/2022 08:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/08/2022 09:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/08/2022 10:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/08/2022 11:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/08/2022 12:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/08/2022 13:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/08/2022 14:00	2,776.3	0.0	2,776.3	104,100.0	289.0	0.0	0.0	0.0
07/08/2022 15:00	4,239.4	208.7	4,339.6	104,100.0	451.8	0.6	0.3	0.9
07/08/2022 16:00	3,804.4	161.2	3,864.0	104,100.0	402.2	0.5	0.2	0.8
07/08/2022 17:00	3,123.6	0.0	3,123.6	104,100.0	325.2	0.4	0.2	0.7
07/08/2022 18:00	2,634.5	0.0	2,634.5	104,100.0	274.3	0.4	0.2	0.6
07/08/2022 19:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/08/2022 20:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/08/2022 21:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/08/2022 22:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/08/2022 23:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
Average/Sum#:	3,315.6	74.0	3,347.6	104,100.0	348.5	0.5	0.2	0.8
Minimum:	2,634.5	0.0	2,634.5	104,100.0	274.3	0.4	0.2	0.6
Maximum:	4,239.4	208.7	4,339.6	104,100.0	451.8	0.6	0.3	0.9
%SI	79.17	79.17	79.17	0.00	79.17	83.33	83.33	83.33

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:29 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	> 4.73 Unit CT2 PM10_Norm, LbPerHr	> 1 Unit CT2 SO2_Norm, LbPerHr	> 1.8 Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/09/2022 00:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/09/2022 01:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/09/2022 02:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/09/2022 03:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/09/2022 04:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/09/2022 05:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/09/2022 06:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/09/2022 07:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/09/2022 08:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/09/2022 09:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/09/2022 10:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/09/2022 11:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/09/2022 12:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/09/2022 13:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/09/2022 14:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/09/2022 15:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/09/2022 16:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/09/2022 17:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/09/2022 18:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/09/2022 19:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/09/2022 20:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/09/2022 21:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/09/2022 22:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/09/2022 23:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
Average/Sum#:	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
Minimum:	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
Maximum:	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
%SI	100.00	100.00	100.00	0.00	100.00	100.00	100.00	100.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:29 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	> 4.73 Unit CT2 PM10_Norm, LbPerHr	> 1 Unit CT2 SO2_Norm, LbPerHr	> 1.8 Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/10/2022 00:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/10/2022 01:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/10/2022 02:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/10/2022 03:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/10/2022 04:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/10/2022 05:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/10/2022 06:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/10/2022 07:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/10/2022 08:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/10/2022 09:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/10/2022 10:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/10/2022 11:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/10/2022 12:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/10/2022 13:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/10/2022 14:00	147.1	0.0	147.1	104,100.0	15.3	0.0	0.0	0.0
07/10/2022 15:00	3,104.9	0.0	3,104.9	104,100.0	323.2	0.5	0.2	0.8
07/10/2022 16:00	3,865.1	25.8	3,873.6	104,100.0	403.2	0.5	0.2	0.8
07/10/2022 17:00	4,401.0	0.0	4,401.0	104,100.0	458.1	0.5	0.3	0.9
07/10/2022 18:00	4,586.0	0.0	4,586.0	104,100.0	477.4	0.6	0.3	1.0
07/10/2022 19:00	4,599.0	0.0	4,599.0	104,100.0	478.8	0.6	0.3	1.0
07/10/2022 20:00	4,602.3	0.0	4,602.3	104,100.0	479.1	0.6	0.3	1.0
07/10/2022 21:00	4,339.2	0.0	4,339.2	104,100.0	451.7	0.5	0.3	0.9
07/10/2022 22:00	4,434.0	0.0	4,434.0	104,100.0	461.6	0.6	0.3	0.9
07/10/2022 23:00	4,658.1	0.0	4,658.1	104,100.0	484.9	0.6	0.3	1.0
Average/Sum#:	3,873.7	2.6	3,874.5	104,100.0	403.3	0.6	0.3	0.9
Minimum:	147.1	0.0	147.1	104,100.0	15.3	0.5	0.2	0.8
Maximum:	4,658.1	25.8	4,658.1	104,100.0	484.9	0.6	0.3	1.0
%SI	58.33	58.33	58.33	0.00	58.33	62.50	62.50	62.50

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:29 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/11/2022 00:00	4,664.9	0.0	4,664.9	104,100.0	485.6	0.6	0.3	1.0
07/11/2022 01:00	4,686.5	0.0	4,686.5	104,100.0	487.9	0.6	0.3	1.0
07/11/2022 02:00	4,675.2	0.0	4,675.2	104,100.0	486.7	0.6	0.3	1.0
07/11/2022 03:00	4,679.7	0.0	4,679.7	104,100.0	487.2	0.6	0.3	1.0
07/11/2022 04:00	4,621.3	0.0	4,621.3	104,100.0	481.1	0.6	0.3	1.0
07/11/2022 05:00	4,070.8	0.0	4,070.8	104,100.0	423.8	0.5	0.3	0.8
07/11/2022 06:00	2,895.8	0.0	2,895.8	104,100.0	301.5	0.4	0.2	0.6
07/11/2022 07:00	2,830.0	0.0	2,830.0	104,100.0	294.6	0.4	0.2	0.6
07/11/2022 08:00	2,826.4	0.0	2,826.4	104,100.0	294.2	0.4	0.2	0.6
07/11/2022 09:00	2,832.0	0.0	2,832.0	104,100.0	294.8	0.4	0.2	0.6
07/11/2022 10:00	2,909.6	0.0	2,909.6	104,100.0	302.9	0.4	0.2	0.6
07/11/2022 11:00	3,365.1	0.0	3,365.1	104,100.0	350.3	0.4	0.2	0.7
07/11/2022 12:00	4,566.4	476.4	4,995.2	104,100.0	520.0	0.6	0.3	1.1
07/11/2022 13:00	4,545.2	777.7	5,322.9	104,100.0	554.1	0.7	0.3	1.1
07/11/2022 14:00	4,519.6	797.9	5,317.5	104,100.0	553.6	0.7	0.3	1.1
07/11/2022 15:00	4,519.2	844.9	5,364.1	104,100.0	558.4	0.7	0.3	1.1
07/11/2022 16:00	4,525.7	791.2	5,316.9	104,100.0	553.5	0.7	0.3	1.1
07/11/2022 17:00	4,520.6	795.3	5,315.9	104,100.0	553.4	0.7	0.3	1.1
07/11/2022 18:00	4,552.2	854.1	5,406.3	104,100.0	562.8	0.7	0.3	1.1
07/11/2022 19:00	4,591.7	795.8	5,387.5	104,100.0	560.8	0.7	0.3	1.1
07/11/2022 20:00	4,581.9	664.0	5,245.9	104,100.0	546.1	0.7	0.3	1.1
07/11/2022 21:00	4,628.4	471.5	5,099.9	104,100.0	530.9	0.6	0.3	1.1
07/11/2022 22:00	4,613.3	515.5	5,128.8	104,100.0	533.9	0.6	0.3	1.1
07/11/2022 23:00	4,672.9	426.8	5,099.7	104,100.0	530.9	0.6	0.3	1.1
Average/Sum#:	4,162.3	342.1	4,502.4	104,100.0	468.7	0.6	0.3	0.9
Minimum:	2,826.4	0.0	2,826.4	104,100.0	294.2	0.4	0.2	0.6
Maximum:	4,686.5	854.1	5,406.3	104,100.0	562.8	0.7	0.3	1.1
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:29 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2	Unit CT2	Unit CT2
						PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/12/2022 00:00	4,693.7	478.4	5,172.1	104,100.0	538.4	0.6	0.3	1.1
07/12/2022 01:00	4,693.6	443.7	5,137.3	104,100.0	534.8	0.6	0.3	1.1
07/12/2022 02:00	4,731.0	348.3	5,079.3	104,100.0	528.8	0.6	0.3	1.1
07/12/2022 03:00	4,754.5	408.1	5,162.6	104,100.0	537.4	0.6	0.3	1.1
07/12/2022 04:00	4,755.2	538.9	5,294.1	104,100.0	551.1	0.7	0.3	1.1
07/12/2022 05:00	4,730.5	277.7	4,944.3	104,100.0	514.7	0.6	0.3	1.0
07/12/2022 06:00	3,365.8	0.0	3,365.8	104,100.0	350.4	0.4	0.2	0.7
07/12/2022 07:00	2,850.4	0.0	2,850.4	104,100.0	296.7	0.4	0.2	0.6
07/12/2022 08:00	2,823.8	0.0	2,823.8	104,100.0	294.0	0.4	0.2	0.6
07/12/2022 09:00	2,822.8	0.0	2,822.8	104,100.0	293.9	0.4	0.2	0.6
07/12/2022 10:00	2,885.3	0.0	2,885.3	104,100.0	300.4	0.4	0.2	0.6
07/12/2022 11:00	2,953.4	0.0	2,953.4	104,100.0	307.4	0.4	0.2	0.6
07/12/2022 12:00	3,148.2	0.0	3,148.2	104,100.0	327.7	0.4	0.2	0.7
07/12/2022 13:00	4,026.8	164.6	4,089.3	104,100.0	425.7	0.5	0.3	0.9
07/12/2022 14:00	4,569.3	712.8	5,282.1	104,100.0	549.9	0.7	0.3	1.1
07/12/2022 15:00	4,546.2	550.5	5,096.7	104,100.0	530.6	0.6	0.3	1.1
07/12/2022 16:00	4,569.1	608.9	5,178.0	104,100.0	539.0	0.6	0.3	1.1
07/12/2022 17:00	4,565.9	762.6	5,328.5	104,100.0	554.7	0.7	0.3	1.1
07/12/2022 18:00	4,579.5	587.9	5,167.4	104,100.0	537.9	0.6	0.3	1.1
07/12/2022 19:00	4,597.0	349.4	4,866.0	104,100.0	506.6	0.6	0.3	1.0
07/12/2022 20:00	4,592.0	80.3	4,610.5	104,100.0	480.0	0.6	0.3	1.0
07/12/2022 21:00	4,667.1	553.0	5,220.1	104,100.0	543.4	0.7	0.3	1.1
07/12/2022 22:00	4,104.2	1.8	4,104.2	104,100.0	427.2	0.5	0.3	0.9
07/12/2022 23:00	4,717.2	0.0	4,717.2	104,100.0	491.1	0.6	0.3	1.0
Average/Sum#:	4,114.3	286.1	4,387.5	104,100.0	456.7	0.6	0.3	0.9
Minimum:	2,822.8	0.0	2,822.8	104,100.0	293.9	0.4	0.2	0.6
Maximum:	4,755.2	762.6	5,328.5	104,100.0	554.7	0.7	0.3	1.1
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:29 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2	Unit CT2	Unit CT2
						PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/13/2022 00:00	4,733.8	0.0	4,733.8	104,100.0	492.8	0.6	0.3	1.0
07/13/2022 01:00	4,734.7	0.0	4,734.7	104,100.0	492.9	0.6	0.3	1.0
07/13/2022 02:00	4,734.3	0.0	4,734.3	104,100.0	492.8	0.6	0.3	1.0
07/13/2022 03:00	4,759.0	43.5	4,769.0	104,100.0	496.5	0.6	0.3	1.0
07/13/2022 04:00	4,792.3	914.1	5,706.4	104,100.0	594.0	0.7	0.4	1.2
07/13/2022 05:00	4,804.7	611.2	5,367.0	104,100.0	558.7	0.7	0.3	1.1
07/13/2022 06:00	4,519.1	85.8	4,563.7	104,100.0	475.1	0.6	0.3	1.0
07/13/2022 07:00	2,887.5	0.0	2,887.5	104,100.0	300.6	0.4	0.2	0.6
07/13/2022 08:00	2,881.7	0.0	2,881.7	104,100.0	300.0	0.4	0.2	0.6
07/13/2022 09:00	2,837.6	0.0	2,837.6	104,100.0	295.4	0.4	0.2	0.6
07/13/2022 10:00	2,833.7	0.0	2,833.7	104,100.0	295.0	0.4	0.2	0.6
07/13/2022 11:00	2,825.2	0.0	2,825.2	104,100.0	294.1	0.4	0.2	0.6
07/13/2022 12:00	2,826.0	0.0	2,826.0	104,100.0	294.2	0.4	0.2	0.6
07/13/2022 13:00	2,821.5	0.0	2,821.5	104,100.0	293.7	0.4	0.2	0.6
07/13/2022 14:00	3,059.4	0.0	3,059.4	104,100.0	318.5	0.4	0.2	0.6
07/13/2022 15:00	4,632.4	340.8	4,898.2	104,100.0	509.9	0.6	0.3	1.0
07/13/2022 16:00	4,647.8	443.4	5,091.2	104,100.0	530.0	0.6	0.3	1.1
07/13/2022 17:00	3,726.4	2.4	3,726.4	104,100.0	387.9	0.5	0.2	0.8
07/13/2022 18:00	4,665.3	311.0	4,892.3	104,100.0	509.3	0.6	0.3	1.0
07/13/2022 19:00	4,695.0	430.9	5,125.9	104,100.0	533.6	0.6	0.3	1.1
07/13/2022 20:00	4,707.5	695.9	5,403.4	104,100.0	562.5	0.7	0.3	1.1
07/13/2022 21:00	4,729.4	450.5	5,179.9	104,100.0	539.2	0.6	0.3	1.1
07/13/2022 22:00	4,733.7	302.3	5,036.0	104,100.0	524.2	0.6	0.3	1.0
07/13/2022 23:00	3,773.5	1.3	3,773.5	104,100.0	392.8	0.5	0.2	0.8
Average/Sum#:	4,015.1	193.0	4,196.2	104,100.0	436.8	0.5	0.3	0.9
Minimum:	2,821.5	0.0	2,821.5	104,100.0	293.7	0.4	0.2	0.6
Maximum:	4,804.7	914.1	5,706.4	104,100.0	594.0	0.7	0.4	1.2
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:29 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	> 4.73 Unit CT2 PM10_Norm, LbPerHr	> 1 Unit CT2 SO2_Norm, LbPerHr	> 1.8 Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/14/2022 00:00	895.7	0.0	895.7	104,100.0	93.2	0.0	0.0	0.0
07/14/2022 01:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/14/2022 02:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/14/2022 03:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/14/2022 04:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/14/2022 05:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/14/2022 06:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/14/2022 07:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/14/2022 08:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/14/2022 09:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/14/2022 10:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/14/2022 11:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/14/2022 12:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/14/2022 13:00	2,572.4	0.0	2,572.4	104,100.0	267.8	0.4	0.2	0.7
07/14/2022 14:00	4,210.7	187.4	4,281.9	104,100.0	445.7	0.5	0.3	0.9
07/14/2022 15:00	4,563.6	643.0	5,206.6	104,100.0	542.0	0.7	0.3	1.1
07/14/2022 16:00	4,536.5	596.6	5,133.1	104,100.0	534.4	0.6	0.3	1.1
07/14/2022 17:00	4,559.0	747.1	5,306.1	104,100.0	552.4	0.7	0.3	1.1
07/14/2022 18:00	4,582.2	750.3	5,332.5	104,100.0	555.1	0.7	0.3	1.1
07/14/2022 19:00	4,634.6	482.8	5,117.4	104,100.0	532.7	0.6	0.3	1.1
07/14/2022 20:00	4,680.7	431.1	5,111.8	104,100.0	532.1	0.6	0.3	1.1
07/14/2022 21:00	4,713.9	369.4	5,083.3	104,100.0	529.2	0.6	0.3	1.1
07/14/2022 22:00	4,757.6	264.5	5,022.1	104,100.0	522.8	0.6	0.3	1.0
07/14/2022 23:00	4,775.9	256.4	5,032.3	104,100.0	523.9	0.6	0.3	1.0
Average/Sum#:	4,123.6	394.1	4,507.9	104,100.0	469.3	0.6	0.3	1.0
Minimum:	895.7	0.0	895.7	104,100.0	93.2	0.4	0.2	0.7
Maximum:	4,775.9	750.3	5,332.5	104,100.0	555.1	0.7	0.3	1.1
%SI	50.00	50.00	50.00	0.00	50.00	54.17	54.17	54.17

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:29 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2	Unit CT2	Unit CT2
						PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/15/2022 00:00	4,240.7	5.6	4,241.1	104,100.0	441.5	0.5	0.3	0.9
07/15/2022 01:00	4,772.0	54.7	4,784.6	104,100.0	498.1	0.6	0.3	1.0
07/15/2022 02:00	4,813.2	447.7	5,260.9	104,100.0	547.7	0.7	0.3	1.1
07/15/2022 03:00	4,839.4	169.3	5,008.7	104,100.0	521.4	0.6	0.3	1.0
07/15/2022 04:00	4,841.5	159.6	5,001.1	104,100.0	520.6	0.6	0.3	1.0
07/15/2022 05:00	4,836.4	328.8	5,165.2	104,100.0	537.7	0.6	0.3	1.1
07/15/2022 06:00	3,924.4	38.4	3,934.8	104,100.0	409.6	0.5	0.2	0.8
07/15/2022 07:00	2,858.5	0.0	2,858.5	104,100.0	297.6	0.4	0.2	0.6
07/15/2022 08:00	2,852.3	0.0	2,852.3	104,100.0	296.9	0.4	0.2	0.6
07/15/2022 09:00	2,851.4	0.0	2,851.4	104,100.0	296.8	0.4	0.2	0.6
07/15/2022 10:00	2,909.6	0.0	2,909.6	104,100.0	302.9	0.4	0.2	0.6
07/15/2022 11:00	2,940.8	0.0	2,940.8	104,100.0	306.1	0.4	0.2	0.6
07/15/2022 12:00	2,964.5	0.0	2,964.5	104,100.0	308.6	0.4	0.2	0.6
07/15/2022 13:00	3,847.8	25.0	3,851.6	104,100.0	401.0	0.5	0.2	0.8
07/15/2022 14:00	4,601.6	578.2	5,179.8	104,100.0	539.2	0.6	0.3	1.1
07/15/2022 15:00	4,589.0	580.8	5,169.8	104,100.0	538.2	0.6	0.3	1.1
07/15/2022 16:00	4,607.9	497.0	5,104.9	104,100.0	531.4	0.6	0.3	1.1
07/15/2022 17:00	4,611.7	752.7	5,364.4	104,100.0	558.4	0.7	0.3	1.1
07/15/2022 18:00	4,620.5	1,277.9	5,898.4	104,100.0	614.0	0.7	0.4	1.2
07/15/2022 19:00	4,646.9	1,035.9	5,682.8	104,100.0	591.6	0.7	0.4	1.2
07/15/2022 20:00	4,683.4	899.3	5,582.7	104,100.0	581.2	0.7	0.3	1.2
07/15/2022 21:00	4,697.4	856.2	5,553.6	104,100.0	578.1	0.7	0.3	1.2
07/15/2022 22:00	4,706.5	896.1	5,602.6	104,100.0	583.2	0.7	0.3	1.2
07/15/2022 23:00	4,722.0	619.4	5,341.4	104,100.0	556.0	0.7	0.3	1.1
Average/Sum#:	4,165.8	384.3	4,546.1	104,100.0	473.2	0.6	0.3	1.0
Minimum:	2,851.4	0.0	2,851.4	104,100.0	296.8	0.4	0.2	0.6
Maximum:	4,841.5	1,277.9	5,898.4	104,100.0	614.0	0.7	0.4	1.2
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:29 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2	Unit CT2	Unit CT2
						PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/16/2022 00:00	4,698.0	223.9	4,870.4	104,100.0	507.0	0.6	0.3	1.0
07/16/2022 01:00	4,293.4	0.0	4,293.4	104,100.0	446.9	0.5	0.3	0.9
07/16/2022 02:00	4,748.3	0.0	4,748.3	104,100.0	494.3	0.6	0.3	1.0
07/16/2022 03:00	4,763.9	0.0	4,763.9	104,100.0	495.9	0.6	0.3	1.0
07/16/2022 04:00	4,761.0	0.0	4,761.0	104,100.0	495.6	0.6	0.3	1.0
07/16/2022 05:00	4,115.0	0.0	4,115.0	104,100.0	428.4	0.5	0.3	0.9
07/16/2022 06:00	3,381.3	0.0	3,381.3	104,100.0	352.0	0.4	0.2	0.7
07/16/2022 07:00	2,844.4	0.0	2,844.4	104,100.0	296.1	0.4	0.2	0.6
07/16/2022 08:00	2,880.2	0.0	2,880.2	104,100.0	299.8	0.4	0.2	0.6
07/16/2022 09:00	2,943.8	0.0	2,943.8	104,100.0	306.4	0.4	0.2	0.6
07/16/2022 10:00	2,990.9	0.0	2,990.9	104,100.0	311.4	0.4	0.2	0.6
07/16/2022 11:00	2,946.1	0.0	2,946.1	104,100.0	306.7	0.4	0.2	0.6
07/16/2022 12:00	3,005.2	0.0	3,005.2	104,100.0	312.8	0.4	0.2	0.6
07/16/2022 13:00	3,708.6	0.0	3,708.6	104,100.0	386.1	0.5	0.2	0.8
07/16/2022 14:00	4,549.8	312.8	4,790.7	104,100.0	498.7	0.6	0.3	1.0
07/16/2022 15:00	4,554.6	1,299.5	5,854.1	104,100.0	609.4	0.7	0.4	1.2
07/16/2022 16:00	4,558.4	653.8	5,212.2	104,100.0	542.6	0.7	0.3	1.1
07/16/2022 17:00	4,557.4	935.0	5,492.4	104,100.0	571.8	0.7	0.3	1.1
07/16/2022 18:00	4,548.8	1,105.7	5,654.5	104,100.0	588.6	0.7	0.4	1.2
07/16/2022 19:00	4,614.5	649.3	5,263.8	104,100.0	548.0	0.7	0.3	1.1
07/16/2022 20:00	4,663.2	1,090.3	5,753.5	104,100.0	598.9	0.7	0.4	1.2
07/16/2022 21:00	4,667.4	1,228.3	5,895.7	104,100.0	613.7	0.7	0.4	1.2
07/16/2022 22:00	4,670.1	1,182.9	5,853.0	104,100.0	609.3	0.7	0.4	1.2
07/16/2022 23:00	4,674.6	850.1	5,524.7	104,100.0	575.1	0.7	0.3	1.2
Average/Sum#:	4,089.1	397.2	4,481.1	104,100.0	466.5	0.6	0.3	0.9
Minimum:	2,844.4	0.0	2,844.4	104,100.0	296.1	0.4	0.2	0.6
Maximum:	4,763.9	1,299.5	5,895.7	104,100.0	613.7	0.7	0.4	1.2
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:29 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/17/2022 00:00	4,702.7	1,190.0	5,892.7	104,100.0	613.4	0.7	0.4	1.2
07/17/2022 01:00	4,697.6	1,102.7	5,800.3	104,100.0	603.8	0.7	0.4	1.2
07/17/2022 02:00	4,721.7	1,096.7	5,818.4	104,100.0	605.7	0.7	0.4	1.2
07/17/2022 03:00	4,733.7	1,106.5	5,840.2	104,100.0	608.0	0.7	0.4	1.2
07/17/2022 04:00	4,730.7	939.9	5,670.6	104,100.0	590.3	0.7	0.4	1.2
07/17/2022 05:00	4,736.1	66.3	4,754.0	104,100.0	494.9	0.6	0.3	1.0
07/17/2022 06:00	4,149.6	0.0	4,149.6	104,100.0	432.0	0.5	0.3	0.9
07/17/2022 07:00	2,957.4	0.0	2,957.4	104,100.0	307.9	0.4	0.2	0.6
07/17/2022 08:00	3,320.8	0.0	3,320.8	104,100.0	345.7	0.4	0.2	0.7
07/17/2022 09:00	2,923.2	0.0	2,923.2	104,100.0	304.3	0.4	0.2	0.6
07/17/2022 10:00	2,933.9	0.0	2,933.9	104,100.0	305.4	0.4	0.2	0.6
07/17/2022 11:00	3,936.7	170.5	4,004.9	104,100.0	416.9	0.5	0.3	0.9
07/17/2022 12:00	4,551.5	575.4	5,126.9	104,100.0	533.7	0.6	0.3	1.1
07/17/2022 13:00	4,553.5	767.7	5,321.2	104,100.0	553.9	0.7	0.3	1.1
07/17/2022 14:00	4,567.3	580.8	5,148.1	104,100.0	535.9	0.6	0.3	1.1
07/17/2022 15:00	4,550.6	946.1	5,496.7	104,100.0	572.2	0.7	0.3	1.1
07/17/2022 16:00	4,552.1	911.9	5,464.0	104,100.0	568.8	0.7	0.3	1.1
07/17/2022 17:00	4,562.6	846.3	5,408.9	104,100.0	563.1	0.7	0.3	1.1
07/17/2022 18:00	4,589.1	1,203.8	5,792.9	104,100.0	603.0	0.7	0.4	1.2
07/17/2022 19:00	4,625.5	1,150.6	5,776.1	104,100.0	601.3	0.7	0.4	1.2
07/17/2022 20:00	4,633.4	1,266.8	5,900.2	104,100.0	614.2	0.7	0.4	1.2
07/17/2022 21:00	4,679.2	735.2	5,414.4	104,100.0	563.6	0.7	0.3	1.1
07/17/2022 22:00	4,704.1	376.7	5,080.8	104,100.0	528.9	0.6	0.3	1.1
07/17/2022 23:00	4,710.9	352.3	5,063.2	104,100.0	527.1	0.6	0.3	1.1
Average/Sum#:	4,326.0	641.1	4,960.8	104,100.0	516.4	0.6	0.3	1.0
Minimum:	2,923.2	0.0	2,923.2	104,100.0	304.3	0.4	0.2	0.6
Maximum:	4,736.1	1,266.8	5,900.2	104,100.0	614.2	0.7	0.4	1.2
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:29 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2	Unit CT2	Unit CT2
						PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/18/2022 00:00	4,709.4	334.4	5,043.8	104,100.0	525.1	0.6	0.3	1.1
07/18/2022 01:00	4,659.6	244.9	4,848.2	104,100.0	504.7	0.6	0.3	1.0
07/18/2022 02:00	2,967.7	0.0	2,967.7	104,100.0	308.9	0.4	0.2	0.6
07/18/2022 03:00	2,894.2	0.0	2,894.2	104,100.0	301.3	0.4	0.2	0.6
07/18/2022 04:00	3,252.2	0.0	3,252.2	104,100.0	338.6	0.4	0.2	0.7
07/18/2022 05:00	4,742.2	230.5	4,910.5	104,100.0	511.2	0.6	0.3	1.0
07/18/2022 06:00	4,762.7	297.7	5,060.4	104,100.0	526.8	0.6	0.3	1.1
07/18/2022 07:00	3,852.4	76.9	3,873.2	104,100.0	403.2	0.5	0.2	0.8
07/18/2022 08:00	3,228.1	0.0	3,228.1	104,100.0	336.0	0.4	0.2	0.7
07/18/2022 09:00	4,679.8	309.8	4,921.4	104,100.0	512.3	0.6	0.3	1.0
07/18/2022 10:00	4,664.6	425.1	5,089.7	104,100.0	529.8	0.6	0.3	1.1
07/18/2022 11:00	4,652.8	491.3	5,144.1	104,100.0	535.5	0.6	0.3	1.1
07/18/2022 12:00	4,632.8	543.2	5,176.0	104,100.0	538.8	0.6	0.3	1.1
07/18/2022 13:00	4,618.1	1,041.1	5,659.2	104,100.0	589.1	0.7	0.4	1.2
07/18/2022 14:00	4,633.8	749.1	5,382.9	104,100.0	560.4	0.7	0.3	1.1
07/18/2022 15:00	4,629.2	1,272.6	5,901.8	104,100.0	614.4	0.7	0.4	1.2
07/18/2022 16:00	4,639.4	1,266.0	5,905.4	104,100.0	614.8	0.7	0.4	1.2
07/18/2022 17:00	4,648.5	1,140.1	5,788.6	104,100.0	602.6	0.7	0.4	1.2
07/18/2022 18:00	4,669.1	1,227.4	5,896.5	104,100.0	613.8	0.7	0.4	1.2
07/18/2022 19:00	4,672.8	1,098.0	5,770.8	104,100.0	600.7	0.7	0.4	1.2
07/18/2022 20:00	4,664.4	1,174.5	5,838.9	104,100.0	607.8	0.7	0.4	1.2
07/18/2022 21:00	4,678.1	683.1	5,361.2	104,100.0	558.1	0.7	0.3	1.1
07/18/2022 22:00	4,729.8	328.2	5,058.0	104,100.0	526.5	0.6	0.3	1.1
07/18/2022 23:00	4,339.9	148.7	4,417.2	104,100.0	459.8	0.6	0.3	0.9
Average/Sum#:	4,359.2	545.1	4,891.3	104,100.0	509.2	0.6	0.3	1.0
Minimum:	2,894.2	0.0	2,894.2	104,100.0	301.3	0.4	0.2	0.6
Maximum:	4,762.7	1,272.6	5,905.4	104,100.0	614.8	0.7	0.4	1.2
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:29 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2	Unit CT2	Unit CT2
						PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/19/2022 00:00	2,936.4	0.0	2,936.4	104,100.0	305.7	0.4	0.2	0.6
07/19/2022 01:00	2,971.0	0.0	2,971.0	104,100.0	309.3	0.4	0.2	0.6
07/19/2022 02:00	2,988.5	0.0	2,988.5	104,100.0	311.1	0.4	0.2	0.6
07/19/2022 03:00	2,994.8	0.0	2,994.8	104,100.0	311.8	0.4	0.2	0.6
07/19/2022 04:00	2,984.4	0.0	2,984.4	104,100.0	310.7	0.4	0.2	0.6
07/19/2022 05:00	2,982.5	0.0	2,982.5	104,100.0	310.5	0.4	0.2	0.6
07/19/2022 06:00	2,914.4	0.0	2,914.4	104,100.0	303.4	0.4	0.2	0.6
07/19/2022 07:00	2,841.1	0.0	2,841.1	104,100.0	295.8	0.4	0.2	0.6
07/19/2022 08:00	2,827.7	0.0	2,827.7	104,100.0	294.4	0.4	0.2	0.6
07/19/2022 09:00	2,899.1	0.0	2,899.1	104,100.0	301.8	0.4	0.2	0.6
07/19/2022 10:00	3,190.1	0.0	3,190.1	104,100.0	332.1	0.4	0.2	0.7
07/19/2022 11:00	4,069.4	86.2	4,089.2	104,100.0	425.7	0.5	0.3	0.9
07/19/2022 12:00	4,644.6	674.0	5,318.6	104,100.0	553.7	0.7	0.3	1.1
07/19/2022 13:00	4,627.3	523.7	5,151.0	104,100.0	536.2	0.6	0.3	1.1
07/19/2022 14:00	4,629.4	449.8	5,079.2	104,100.0	528.7	0.6	0.3	1.1
07/19/2022 15:00	4,630.1	479.1	5,109.2	104,100.0	531.9	0.6	0.3	1.1
07/19/2022 16:00	4,629.3	985.4	5,614.7	104,100.0	584.5	0.7	0.4	1.2
07/19/2022 17:00	4,628.5	1,109.2	5,737.7	104,100.0	597.3	0.7	0.4	1.2
07/19/2022 18:00	4,663.7	1,431.1	6,094.8	104,100.0	634.5	0.8	0.4	1.3
07/19/2022 19:00	4,679.9	1,056.3	5,736.2	104,100.0	597.1	0.7	0.4	1.2
07/19/2022 20:00	4,694.3	402.4	5,096.7	104,100.0	530.6	0.6	0.3	1.1
07/19/2022 21:00	4,735.1	410.8	5,145.9	104,100.0	535.7	0.6	0.3	1.1
07/19/2022 22:00	4,762.5	280.2	5,042.7	104,100.0	524.9	0.6	0.3	1.0
07/19/2022 23:00	3,830.3	64.6	3,847.7	104,100.0	400.5	0.5	0.2	0.8
Average/Sum#:	3,823.1	331.4	4,149.7	104,100.0	432.0	0.5	0.3	0.9
Minimum:	2,827.7	0.0	2,827.7	104,100.0	294.4	0.4	0.2	0.6
Maximum:	4,762.5	1,431.1	6,094.8	104,100.0	634.5	0.8	0.4	1.3
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:29 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2	Unit CT2	Unit CT2
						PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/20/2022 00:00	2,833.8	0.0	2,833.8	104,100.0	295.0	0.4	0.2	0.6
07/20/2022 01:00	2,840.0	0.0	2,840.0	104,100.0	295.6	0.4	0.2	0.6
07/20/2022 02:00	2,845.8	0.0	2,845.8	104,100.0	296.2	0.4	0.2	0.6
07/20/2022 03:00	2,849.2	0.0	2,849.2	104,100.0	296.6	0.4	0.2	0.6
07/20/2022 04:00	2,868.9	0.0	2,868.9	104,100.0	298.7	0.4	0.2	0.6
07/20/2022 05:00	2,898.1	0.0	2,898.1	104,100.0	301.7	0.4	0.2	0.6
07/20/2022 06:00	2,895.5	0.0	2,895.5	104,100.0	301.4	0.4	0.2	0.6
07/20/2022 07:00	2,943.0	0.0	2,943.0	104,100.0	306.4	0.4	0.2	0.6
07/20/2022 08:00	2,875.8	0.0	2,875.8	104,100.0	299.4	0.4	0.2	0.6
07/20/2022 09:00	2,935.3	0.0	2,935.3	104,100.0	305.6	0.4	0.2	0.6
07/20/2022 10:00	2,901.9	0.0	2,901.9	104,100.0	302.1	0.4	0.2	0.6
07/20/2022 11:00	2,964.7	0.0	2,964.7	104,100.0	308.6	0.4	0.2	0.6
07/20/2022 12:00	4,111.7	153.6	4,173.1	104,100.0	434.4	0.5	0.3	0.9
07/20/2022 13:00	4,618.8	667.5	5,286.3	104,100.0	550.3	0.7	0.3	1.1
07/20/2022 14:00	4,619.6	1,517.9	6,137.5	104,100.0	638.9	0.8	0.4	1.3
07/20/2022 15:00	4,603.4	582.5	5,185.9	104,100.0	539.9	0.6	0.3	1.1
07/20/2022 16:00	4,599.8	616.3	5,216.1	104,100.0	543.0	0.7	0.3	1.1
07/20/2022 17:00	4,596.2	1,343.7	5,939.9	104,100.0	618.3	0.7	0.4	1.2
07/20/2022 18:00	4,628.4	1,022.4	5,650.8	104,100.0	588.2	0.7	0.4	1.2
07/20/2022 19:00	4,647.5	1,145.7	5,793.2	104,100.0	603.1	0.7	0.4	1.2
07/20/2022 20:00	4,672.8	837.1	5,509.9	104,100.0	573.6	0.7	0.3	1.1
07/20/2022 21:00	3,815.3	83.2	3,836.1	104,100.0	399.3	0.5	0.2	0.8
07/20/2022 22:00	2,974.7	0.0	2,974.7	104,100.0	309.7	0.4	0.2	0.6
07/20/2022 23:00	2,869.6	0.0	2,869.6	104,100.0	298.7	0.4	0.2	0.6
Average/Sum#:	3,558.7	332.1	3,884.4	104,100.0	404.4	0.5	0.3	0.8
Minimum:	2,833.8	0.0	2,833.8	104,100.0	295.0	0.4	0.2	0.6
Maximum:	4,672.8	1,517.9	6,137.5	104,100.0	638.9	0.8	0.4	1.3
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:29 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2	Unit CT2	Unit CT2
	PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr					
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/21/2022 00:00	2,937.5	0.0	2,937.5	104,100.0	305.8	0.4	0.2	0.6
07/21/2022 01:00	2,907.6	0.0	2,907.6	104,100.0	302.7	0.4	0.2	0.6
07/21/2022 02:00	2,908.5	0.0	2,908.5	104,100.0	302.8	0.4	0.2	0.6
07/21/2022 03:00	3,008.4	0.0	3,008.4	104,100.0	313.2	0.4	0.2	0.6
07/21/2022 04:00	2,897.6	0.0	2,897.6	104,100.0	301.6	0.4	0.2	0.6
07/21/2022 05:00	2,851.0	0.0	2,851.0	104,100.0	296.8	0.4	0.2	0.6
07/21/2022 06:00	2,853.3	0.0	2,853.3	104,100.0	297.0	0.4	0.2	0.6
07/21/2022 07:00	2,851.3	0.0	2,851.3	104,100.0	296.8	0.4	0.2	0.6
07/21/2022 08:00	2,846.1	0.0	2,846.1	104,100.0	296.3	0.4	0.2	0.6
07/21/2022 09:00	2,841.8	0.0	2,841.8	104,100.0	295.8	0.4	0.2	0.6
07/21/2022 10:00	2,841.1	0.0	2,841.1	104,100.0	295.8	0.4	0.2	0.6
07/21/2022 11:00	2,831.2	0.0	2,831.2	104,100.0	294.7	0.4	0.2	0.6
07/21/2022 12:00	2,886.8	0.0	2,886.8	104,100.0	300.5	0.4	0.2	0.6
07/21/2022 13:00	3,563.6	7.9	3,564.0	104,100.0	371.0	0.4	0.2	0.7
07/21/2022 14:00	4,594.7	540.8	5,135.5	104,100.0	534.6	0.6	0.3	1.1
07/21/2022 15:00	4,588.2	541.3	5,129.5	104,100.0	534.0	0.6	0.3	1.1
07/21/2022 16:00	4,586.9	551.1	5,138.0	104,100.0	534.9	0.6	0.3	1.1
07/21/2022 17:00	4,594.8	752.4	5,347.2	104,100.0	556.6	0.7	0.3	1.1
07/21/2022 18:00	4,597.5	908.1	5,505.6	104,100.0	573.1	0.7	0.3	1.1
07/21/2022 19:00	4,640.3	492.0	5,132.3	104,100.0	534.3	0.6	0.3	1.1
07/21/2022 20:00	4,679.7	480.5	5,160.2	104,100.0	537.2	0.6	0.3	1.1
07/21/2022 21:00	4,187.3	182.9	4,282.4	104,100.0	445.8	0.5	0.3	0.9
07/21/2022 22:00	2,853.5	0.0	2,853.5	104,100.0	297.0	0.4	0.2	0.6
07/21/2022 23:00	2,934.1	0.0	2,934.1	104,100.0	305.4	0.4	0.2	0.6
Average/Sum#:	3,470.1	185.7	3,651.9	104,100.0	380.2	0.5	0.2	0.8
Minimum:	2,831.2	0.0	2,831.2	104,100.0	294.7	0.4	0.2	0.6
Maximum:	4,679.7	908.1	5,505.6	104,100.0	573.1	0.7	0.3	1.1
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:29 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2	Unit CT2	Unit CT2
						PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/22/2022 00:00	2,982.4	0.0	2,982.4	104,100.0	310.5	0.4	0.2	0.6
07/22/2022 01:00	2,980.6	0.0	2,980.6	104,100.0	310.3	0.4	0.2	0.6
07/22/2022 02:00	3,390.8	0.0	3,390.8	104,100.0	353.0	0.4	0.2	0.7
07/22/2022 03:00	2,981.1	0.0	2,981.1	104,100.0	310.3	0.4	0.2	0.6
07/22/2022 04:00	2,972.3	0.0	2,972.3	104,100.0	309.4	0.4	0.2	0.6
07/22/2022 05:00	2,960.6	0.0	2,960.6	104,100.0	308.2	0.4	0.2	0.6
07/22/2022 06:00	2,901.6	0.0	2,901.6	104,100.0	302.1	0.4	0.2	0.6
07/22/2022 07:00	2,847.6	0.0	2,847.6	104,100.0	296.4	0.4	0.2	0.6
07/22/2022 08:00	2,840.3	0.0	2,840.3	104,100.0	295.7	0.4	0.2	0.6
07/22/2022 09:00	2,832.9	0.0	2,832.9	104,100.0	294.9	0.4	0.2	0.6
07/22/2022 10:00	2,840.1	0.0	2,840.1	104,100.0	295.7	0.4	0.2	0.6
07/22/2022 11:00	2,824.0	0.0	2,824.0	104,100.0	294.0	0.4	0.2	0.6
07/22/2022 12:00	2,821.4	0.0	2,821.4	104,100.0	293.7	0.4	0.2	0.6
07/22/2022 13:00	2,862.3	0.0	2,862.3	104,100.0	298.0	0.4	0.2	0.6
07/22/2022 14:00	3,585.8	27.5	3,589.9	104,100.0	373.7	0.5	0.2	0.8
07/22/2022 15:00	4,602.0	513.4	5,115.4	104,100.0	532.5	0.6	0.3	1.1
07/22/2022 16:00	4,621.7	493.4	5,115.1	104,100.0	532.5	0.6	0.3	1.1
07/22/2022 17:00	4,641.9	463.4	5,105.3	104,100.0	531.5	0.6	0.3	1.1
07/22/2022 18:00	4,636.2	455.8	5,092.0	104,100.0	530.1	0.6	0.3	1.1
07/22/2022 19:00	4,685.3	413.6	5,098.9	104,100.0	530.8	0.6	0.3	1.1
07/22/2022 20:00	4,728.7	364.7	5,093.4	104,100.0	530.2	0.6	0.3	1.1
07/22/2022 21:00	3,972.2	81.5	3,994.2	104,100.0	415.8	0.5	0.3	0.8
07/22/2022 22:00	3,025.8	0.0	3,025.8	104,100.0	315.0	0.4	0.2	0.6
07/22/2022 23:00	2,688.8	0.0	2,688.8	104,100.0	279.9	0.4	0.2	0.6
Average/Sum#:	3,426.1	117.2	3,539.9	104,100.0	368.5	0.5	0.2	0.7
Minimum:	2,688.8	0.0	2,688.8	104,100.0	279.9	0.4	0.2	0.6
Maximum:	4,728.7	513.4	5,115.4	104,100.0	532.5	0.6	0.3	1.1
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:29 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2	Unit CT2	Unit CT2
	PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr					
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/23/2022 00:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/23/2022 01:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/23/2022 02:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/23/2022 03:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/23/2022 04:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/23/2022 05:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/23/2022 06:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/23/2022 07:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/23/2022 08:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/23/2022 09:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/23/2022 10:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/23/2022 11:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/23/2022 12:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/23/2022 13:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/23/2022 14:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/23/2022 15:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/23/2022 16:00	2,661.6	0.0	2,661.6	104,100.0	277.1	0.4	0.2	0.6
07/23/2022 17:00	3,779.5	36.3	3,786.0	104,100.0	394.1	0.5	0.2	0.8
07/23/2022 18:00	4,599.7	1,032.4	5,632.1	104,100.0	586.3	0.7	0.4	1.2
07/23/2022 19:00	4,671.8	765.0	5,436.8	104,100.0	566.0	0.7	0.3	1.1
07/23/2022 20:00	4,676.7	413.4	5,090.1	104,100.0	529.9	0.6	0.3	1.1
07/23/2022 21:00	4,283.6	215.0	4,395.4	104,100.0	457.6	0.6	0.3	0.9
07/23/2022 22:00	2,525.7	0.0	2,525.7	104,100.0	262.9	0.4	0.2	0.6
07/23/2022 23:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
Average/Sum#:	3,885.5	351.7	4,218.2	104,100.0	439.1	0.6	0.3	0.9
Minimum:	2,525.7	0.0	2,525.7	104,100.0	262.9	0.4	0.2	0.6
Maximum:	4,676.7	1,032.4	5,632.1	104,100.0	586.3	0.7	0.4	1.2
%SI	70.83	70.83	70.83	0.00	70.83	70.83	70.83	70.83

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:29 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	> 4.73 Unit CT2 PM10_Norm, LbPerHr	> 1 Unit CT2 SO2_Norm, LbPerHr	> 1.8 Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/24/2022 00:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/24/2022 01:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/24/2022 02:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/24/2022 03:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/24/2022 04:00	0.0	0.0	0.0	104,100.0	0.0	0.0	0.0	0.0
07/24/2022 05:00	2,562.1	0.0	2,562.1	104,100.0	266.7	0.0	0.0	0.0
07/24/2022 06:00	2,964.8	0.0	2,964.8	104,100.0	308.6	0.4	0.2	0.6
07/24/2022 07:00	2,960.2	0.0	2,960.2	104,100.0	308.2	0.4	0.2	0.6
07/24/2022 08:00	2,889.1	0.0	2,889.1	104,100.0	300.8	0.4	0.2	0.6
07/24/2022 09:00	2,844.6	0.0	2,844.6	104,100.0	296.1	0.4	0.2	0.6
07/24/2022 10:00	2,842.7	0.0	2,842.7	104,100.0	295.9	0.4	0.2	0.6
07/24/2022 11:00	2,840.8	0.0	2,840.8	104,100.0	295.7	0.4	0.2	0.6
07/24/2022 12:00	2,827.1	0.0	2,827.1	104,100.0	294.3	0.4	0.2	0.6
07/24/2022 13:00	2,820.0	0.0	2,820.0	104,100.0	293.6	0.4	0.2	0.6
07/24/2022 14:00	2,829.8	0.0	2,829.8	104,100.0	294.6	0.4	0.2	0.6
07/24/2022 15:00	2,817.1	0.0	2,817.1	104,100.0	293.3	0.4	0.2	0.6
07/24/2022 16:00	3,930.2	179.8	4,005.7	104,100.0	417.0	0.5	0.3	0.9
07/24/2022 17:00	4,576.9	571.0	5,147.9	104,100.0	535.9	0.6	0.3	1.1
07/24/2022 18:00	4,598.4	551.2	5,149.6	104,100.0	536.1	0.6	0.3	1.1
07/24/2022 19:00	4,675.8	434.8	5,110.6	104,100.0	532.0	0.6	0.3	1.1
07/24/2022 20:00	4,282.8	188.1	4,373.1	104,100.0	455.2	0.6	0.3	0.9
07/24/2022 21:00	2,864.4	0.0	2,864.4	104,100.0	298.2	0.4	0.2	0.6
07/24/2022 22:00	2,845.2	0.0	2,845.2	104,100.0	296.2	0.4	0.2	0.6
07/24/2022 23:00	2,953.7	0.0	2,953.7	104,100.0	307.5	0.4	0.2	0.6
Average/Sum#:	3,259.2	101.3	3,349.9	104,100.0	348.7	0.5	0.2	0.7
Minimum:	2,562.1	0.0	2,562.1	104,100.0	266.7	0.4	0.2	0.6
Maximum:	4,675.8	571.0	5,149.6	104,100.0	536.1	0.6	0.3	1.1
%SI	20.83	20.83	20.83	0.00	20.83	25.00	25.00	25.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:29 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2	Unit CT2	Unit CT2
						PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/25/2022 00:00	2,898.2	0.0	2,898.2	104,100.0	301.7	0.4	0.2	0.6
07/25/2022 01:00	2,850.0	0.0	2,850.0	104,100.0	296.7	0.4	0.2	0.6
07/25/2022 02:00	2,851.1	0.0	2,851.1	104,100.0	296.8	0.4	0.2	0.6
07/25/2022 03:00	2,850.3	0.0	2,850.3	104,100.0	296.7	0.4	0.2	0.6
07/25/2022 04:00	2,955.5	0.0	2,955.5	104,100.0	307.7	0.4	0.2	0.6
07/25/2022 05:00	2,988.0	0.0	2,988.0	104,100.0	311.1	0.4	0.2	0.6
07/25/2022 06:00	2,976.2	0.0	2,976.2	104,100.0	309.8	0.4	0.2	0.6
07/25/2022 07:00	2,974.2	0.0	2,974.2	104,100.0	309.6	0.4	0.2	0.6
07/25/2022 08:00	2,858.3	0.0	2,858.3	104,100.0	297.5	0.4	0.2	0.6
07/25/2022 09:00	2,838.1	0.0	2,838.1	104,100.0	295.4	0.4	0.2	0.6
07/25/2022 10:00	2,823.6	0.0	2,823.6	104,100.0	293.9	0.4	0.2	0.6
07/25/2022 11:00	2,924.7	0.0	2,924.7	104,100.0	304.5	0.4	0.2	0.6
07/25/2022 12:00	2,944.0	0.0	2,944.0	104,100.0	306.5	0.4	0.2	0.6
07/25/2022 13:00	3,987.7	188.9	4,063.3	104,100.0	423.0	0.5	0.3	0.9
07/25/2022 14:00	4,570.7	609.4	5,180.1	104,100.0	539.2	0.6	0.3	1.1
07/25/2022 15:00	4,581.6	674.2	5,255.8	104,100.0	547.1	0.7	0.3	1.1
07/25/2022 16:00	4,589.1	790.5	5,379.6	104,100.0	560.0	0.7	0.3	1.1
07/25/2022 17:00	4,615.4	885.6	5,501.0	104,100.0	572.7	0.7	0.3	1.1
07/25/2022 18:00	4,637.5	939.7	5,577.2	104,100.0	580.6	0.7	0.3	1.2
07/25/2022 19:00	4,664.8	570.4	5,235.2	104,100.0	545.0	0.7	0.3	1.1
07/25/2022 20:00	4,671.2	431.8	5,103.0	104,100.0	531.2	0.6	0.3	1.1
07/25/2022 21:00	4,717.2	386.4	5,103.6	104,100.0	531.3	0.6	0.3	1.1
07/25/2022 22:00	3,885.4	74.4	3,902.5	104,100.0	406.3	0.5	0.2	0.8
07/25/2022 23:00	3,508.1	0.0	3,508.1	104,100.0	365.2	0.4	0.2	0.7
Average/Sum#:	3,590.0	231.3	3,814.2	104,100.0	397.1	0.5	0.2	0.8
Minimum:	2,823.6	0.0	2,823.6	104,100.0	293.9	0.4	0.2	0.6
Maximum:	4,717.2	939.7	5,577.2	104,100.0	580.6	0.7	0.3	1.2
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:29 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2	Unit CT2	Unit CT2
						PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/26/2022 00:00	2,977.0	0.0	2,977.0	104,100.0	309.9	0.4	0.2	0.6
07/26/2022 01:00	2,973.2	0.0	2,973.2	104,100.0	309.5	0.4	0.2	0.6
07/26/2022 02:00	2,975.0	0.0	2,975.0	104,100.0	309.7	0.4	0.2	0.6
07/26/2022 03:00	2,971.4	0.0	2,971.4	104,100.0	309.3	0.4	0.2	0.6
07/26/2022 04:00	4,151.6	74.5	4,172.5	104,100.0	434.4	0.5	0.3	0.9
07/26/2022 05:00	4,831.8	207.9	5,039.7	104,100.0	524.6	0.6	0.3	1.0
07/26/2022 06:00	3,429.7	1.0	3,429.7	104,100.0	357.0	0.4	0.2	0.7
07/26/2022 07:00	2,995.4	0.0	2,995.4	104,100.0	311.8	0.4	0.2	0.6
07/26/2022 08:00	2,905.7	0.0	2,905.7	104,100.0	302.5	0.4	0.2	0.6
07/26/2022 09:00	2,887.6	0.0	2,887.6	104,100.0	300.6	0.4	0.2	0.6
07/26/2022 10:00	2,962.8	0.0	2,962.8	104,100.0	308.4	0.4	0.2	0.6
07/26/2022 11:00	2,896.7	0.0	2,896.7	104,100.0	301.5	0.4	0.2	0.6
07/26/2022 12:00	3,032.7	0.0	3,032.7	104,100.0	315.7	0.4	0.2	0.6
07/26/2022 13:00	4,096.6	131.0	4,152.9	104,100.0	432.3	0.5	0.3	0.9
07/26/2022 14:00	4,628.4	481.2	5,109.6	104,100.0	531.9	0.6	0.3	1.1
07/26/2022 15:00	4,608.1	519.8	5,127.9	104,100.0	533.8	0.6	0.3	1.1
07/26/2022 16:00	4,586.9	709.8	5,296.7	104,100.0	551.4	0.7	0.3	1.1
07/26/2022 17:00	4,614.0	960.6	5,574.6	104,100.0	580.3	0.7	0.3	1.2
07/26/2022 18:00	4,641.6	749.0	5,390.6	104,100.0	561.2	0.7	0.3	1.1
07/26/2022 19:00	4,669.4	486.0	5,155.4	104,100.0	536.7	0.6	0.3	1.1
07/26/2022 20:00	4,703.9	421.8	5,125.7	104,100.0	533.6	0.6	0.3	1.1
07/26/2022 21:00	4,755.8	338.2	5,094.0	104,100.0	530.3	0.6	0.3	1.1
07/26/2022 22:00	4,776.6	288.9	5,065.5	104,100.0	527.3	0.6	0.3	1.1
07/26/2022 23:00	3,899.2	64.1	3,916.5	104,100.0	407.7	0.5	0.2	0.8
Average/Sum#:	3,832.1	226.4	4,051.2	104,100.0	421.7	0.5	0.3	0.8
Minimum:	2,887.6	0.0	2,887.6	104,100.0	300.6	0.4	0.2	0.6
Maximum:	4,831.8	960.6	5,574.6	104,100.0	580.3	0.7	0.3	1.2
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:29 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2	Unit CT2	Unit CT2
						PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/27/2022 00:00	2,994.7	0.0	2,994.7	104,100.0	311.7	0.4	0.2	0.6
07/27/2022 01:00	3,003.2	0.0	3,003.2	104,100.0	312.6	0.4	0.2	0.6
07/27/2022 02:00	2,997.1	0.0	2,997.1	104,100.0	312.0	0.4	0.2	0.6
07/27/2022 03:00	2,999.1	0.0	2,999.1	104,100.0	312.2	0.4	0.2	0.6
07/27/2022 04:00	2,998.7	0.0	2,998.7	104,100.0	312.2	0.4	0.2	0.6
07/27/2022 05:00	3,143.3	0.0	3,143.3	104,100.0	327.2	0.4	0.2	0.7
07/27/2022 06:00	3,343.2	0.0	3,343.2	104,100.0	348.0	0.4	0.2	0.7
07/27/2022 07:00	3,054.9	0.0	3,054.9	104,100.0	318.0	0.4	0.2	0.6
07/27/2022 08:00	2,989.4	0.0	2,989.4	104,100.0	311.2	0.4	0.2	0.6
07/27/2022 09:00	2,885.7	0.0	2,885.7	104,100.0	300.4	0.4	0.2	0.6
07/27/2022 10:00	2,966.9	0.0	2,966.9	104,100.0	308.9	0.4	0.2	0.6
07/27/2022 11:00	2,967.1	0.0	2,967.1	104,100.0	308.9	0.4	0.2	0.6
07/27/2022 12:00	2,919.3	0.0	2,919.3	104,100.0	303.9	0.4	0.2	0.6
07/27/2022 13:00	4,450.7	307.4	4,650.5	104,100.0	484.1	0.6	0.3	1.0
07/27/2022 14:00	4,583.8	554.4	5,138.2	104,100.0	534.9	0.6	0.3	1.1
07/27/2022 15:00	4,571.7	607.3	5,179.0	104,100.0	539.1	0.6	0.3	1.1
07/27/2022 16:00	4,567.3	637.5	5,204.8	104,100.0	541.8	0.6	0.3	1.1
07/27/2022 17:00	4,594.3	1,276.4	5,870.7	104,100.0	611.1	0.7	0.4	1.2
07/27/2022 18:00	4,616.3	533.9	5,150.2	104,100.0	536.1	0.6	0.3	1.1
07/27/2022 19:00	4,651.1	477.3	5,128.4	104,100.0	533.9	0.6	0.3	1.1
07/27/2022 20:00	4,688.6	418.0	5,106.6	104,100.0	531.6	0.6	0.3	1.1
07/27/2022 21:00	4,446.5	180.5	4,540.4	104,100.0	472.7	0.6	0.3	1.0
07/27/2022 22:00	3,690.1	0.0	3,690.1	104,100.0	384.1	0.5	0.2	0.8
07/27/2022 23:00	3,600.8	0.0	3,600.8	104,100.0	374.8	0.4	0.2	0.8
Average/Sum#:	3,655.2	208.0	3,855.1	104,100.0	401.3	0.5	0.2	0.8
Minimum:	2,885.7	0.0	2,885.7	104,100.0	300.4	0.4	0.2	0.6
Maximum:	4,688.6	1,276.4	5,870.7	104,100.0	611.1	0.7	0.4	1.2
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:29 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2	Unit CT2	Unit CT2
						PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/28/2022 00:00	3,456.7	0.0	3,456.7	104,100.0	359.8	0.4	0.2	0.7
07/28/2022 01:00	3,111.7	0.0	3,111.7	104,100.0	323.9	0.4	0.2	0.6
07/28/2022 02:00	3,008.4	0.0	3,008.4	104,100.0	313.2	0.4	0.2	0.6
07/28/2022 03:00	4,182.1	49.8	4,193.6	104,100.0	436.6	0.5	0.3	0.9
07/28/2022 04:00	4,831.4	219.1	5,050.5	104,100.0	525.8	0.6	0.3	1.1
07/28/2022 05:00	4,441.4	99.6	4,493.2	104,100.0	467.7	0.6	0.3	0.9
07/28/2022 06:00	3,989.2	0.0	3,989.2	104,100.0	415.3	0.5	0.2	0.8
07/28/2022 07:00	3,842.5	0.0	3,842.5	104,100.0	400.0	0.5	0.2	0.8
07/28/2022 08:00	2,975.1	0.0	2,975.1	104,100.0	309.7	0.4	0.2	0.6
07/28/2022 09:00	3,025.1	0.0	3,025.1	104,100.0	314.9	0.4	0.2	0.6
07/28/2022 10:00	4,462.4	0.0	4,462.4	104,100.0	464.5	0.6	0.3	0.9
07/28/2022 11:00	4,635.7	554.5	5,179.1	104,100.0	539.1	0.6	0.3	1.1
07/28/2022 12:00	4,616.5	531.7	5,148.2	104,100.0	535.9	0.6	0.3	1.1
07/28/2022 13:00	4,578.8	609.5	5,188.3	104,100.0	540.1	0.6	0.3	1.1
07/28/2022 14:00	4,552.8	1,026.9	5,579.7	104,100.0	580.8	0.7	0.3	1.2
07/28/2022 15:00	4,536.8	626.7	5,163.5	104,100.0	537.5	0.6	0.3	1.1
07/28/2022 16:00	4,534.3	686.5	5,220.8	104,100.0	543.5	0.7	0.3	1.1
07/28/2022 17:00	4,545.4	1,220.8	5,766.2	104,100.0	600.3	0.7	0.4	1.2
07/28/2022 18:00	4,565.8	1,354.7	5,920.5	104,100.0	616.3	0.7	0.4	1.2
07/28/2022 19:00	4,623.5	744.2	5,367.7	104,100.0	558.8	0.7	0.3	1.1
07/28/2022 20:00	4,668.2	643.3	5,311.5	104,100.0	552.9	0.7	0.3	1.1
07/28/2022 21:00	4,686.7	399.1	5,085.8	104,100.0	529.4	0.6	0.3	1.1
07/28/2022 22:00	4,297.4	177.6	4,389.8	104,100.0	457.0	0.6	0.3	0.9
07/28/2022 23:00	3,022.2	0.0	3,022.2	104,100.0	314.6	0.4	0.2	0.6
Average/Sum#:	4,132.9	372.7	4,498.0	104,100.0	468.2	0.6	0.3	0.9
Minimum:	2,975.1	0.0	2,975.1	104,100.0	309.7	0.4	0.2	0.6
Maximum:	4,831.4	1,354.7	5,920.5	104,100.0	616.3	0.7	0.4	1.2
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:29 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2	Unit CT2	Unit CT2
						PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/29/2022 00:00	2,928.2	0.0	2,928.2	104,100.0	304.8	0.4	0.2	0.6
07/29/2022 01:00	2,919.9	0.0	2,919.9	104,100.0	304.0	0.4	0.2	0.6
07/29/2022 02:00	2,967.4	0.0	2,967.4	104,100.0	308.9	0.4	0.2	0.6
07/29/2022 03:00	2,987.9	0.0	2,987.9	104,100.0	311.0	0.4	0.2	0.6
07/29/2022 04:00	4,603.4	127.6	4,671.0	104,100.0	486.3	0.6	0.3	1.0
07/29/2022 05:00	4,805.2	230.6	5,035.8	104,100.0	524.2	0.6	0.3	1.0
07/29/2022 06:00	3,682.5	1.1	3,682.5	104,100.0	383.3	0.5	0.2	0.8
07/29/2022 07:00	2,998.4	0.0	2,998.4	104,100.0	312.1	0.4	0.2	0.6
07/29/2022 08:00	2,992.5	0.0	2,992.5	104,100.0	311.5	0.4	0.2	0.6
07/29/2022 09:00	2,990.3	0.0	2,990.3	104,100.0	311.3	0.4	0.2	0.6
07/29/2022 10:00	2,986.4	0.0	2,986.4	104,100.0	310.9	0.4	0.2	0.6
07/29/2022 11:00	3,279.1	0.0	3,279.1	104,100.0	341.4	0.4	0.2	0.7
07/29/2022 12:00	4,609.8	447.3	5,012.4	104,100.0	521.8	0.6	0.3	1.1
07/29/2022 13:00	4,584.1	594.0	5,178.1	104,100.0	539.0	0.6	0.3	1.1
07/29/2022 14:00	4,561.8	784.7	5,346.5	104,100.0	556.6	0.7	0.3	1.1
07/29/2022 15:00	4,547.4	639.9	5,187.3	104,100.0	540.0	0.6	0.3	1.1
07/29/2022 16:00	4,533.7	666.7	5,200.4	104,100.0	541.4	0.6	0.3	1.1
07/29/2022 17:00	4,540.7	777.8	5,318.5	104,100.0	553.7	0.7	0.3	1.1
07/29/2022 18:00	4,581.9	578.4	5,160.3	104,100.0	537.2	0.6	0.3	1.1
07/29/2022 19:00	4,618.6	515.7	5,134.3	104,100.0	534.5	0.6	0.3	1.1
07/29/2022 20:00	4,657.4	463.0	5,120.4	104,100.0	533.0	0.6	0.3	1.1
07/29/2022 21:00	4,697.8	493.8	5,191.6	104,100.0	540.4	0.6	0.3	1.1
07/29/2022 22:00	4,726.7	355.5	5,082.2	104,100.0	529.1	0.6	0.3	1.1
07/29/2022 23:00	4,761.0	414.2	5,175.2	104,100.0	538.7	0.6	0.3	1.1
Average/Sum#:	3,981.8	295.4	4,272.8	104,100.0	444.8	0.5	0.3	0.9
Minimum:	2,919.9	0.0	2,919.9	104,100.0	304.0	0.4	0.2	0.6
Maximum:	4,805.2	784.7	5,346.5	104,100.0	556.6	0.7	0.3	1.1
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:29 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/30/2022 00:00	4,774.4	262.5	5,036.9	104,100.0	524.3	0.6	0.3	1.0
07/30/2022 01:00	4,786.5	237.6	5,017.0	104,100.0	522.3	0.6	0.3	1.0
07/30/2022 02:00	4,189.0	0.0	4,189.0	104,100.0	436.1	0.5	0.3	0.9
07/30/2022 03:00	4,379.5	0.0	4,379.5	104,100.0	455.9	0.5	0.3	0.9
07/30/2022 04:00	4,802.6	175.4	4,942.9	104,100.0	514.6	0.6	0.3	1.0
07/30/2022 05:00	4,806.8	312.5	5,119.3	104,100.0	532.9	0.6	0.3	1.1
07/30/2022 06:00	4,629.1	59.5	4,645.2	104,100.0	483.6	0.6	0.3	1.0
07/30/2022 07:00	3,207.3	0.0	3,207.3	104,100.0	333.9	0.4	0.2	0.7
07/30/2022 08:00	2,976.4	0.0	2,976.4	104,100.0	309.8	0.4	0.2	0.6
07/30/2022 09:00	2,884.2	0.0	2,884.2	104,100.0	300.2	0.4	0.2	0.6
07/30/2022 10:00	2,865.4	0.0	2,865.4	104,100.0	298.3	0.4	0.2	0.6
07/30/2022 11:00	3,590.6	25.6	3,595.2	104,100.0	374.3	0.5	0.2	0.8
07/30/2022 12:00	4,608.0	538.5	5,146.5	104,100.0	535.8	0.6	0.3	1.1
07/30/2022 13:00	4,580.9	584.8	5,165.7	104,100.0	537.7	0.6	0.3	1.1
07/30/2022 14:00	4,575.7	1,143.3	5,719.0	104,100.0	595.3	0.7	0.4	1.2
07/30/2022 15:00	4,563.5	1,781.8	6,345.3	104,100.0	660.5	0.8	0.4	1.3
07/30/2022 16:00	4,559.7	1,579.8	6,139.5	104,100.0	639.1	0.8	0.4	1.3
07/30/2022 17:00	4,580.9	946.8	5,527.7	104,100.0	575.4	0.7	0.3	1.2
07/30/2022 18:00	4,616.5	530.9	5,147.4	104,100.0	535.8	0.6	0.3	1.1
07/30/2022 19:00	4,639.7	482.3	5,122.0	104,100.0	533.2	0.6	0.3	1.1
07/30/2022 20:00	4,677.9	406.9	5,084.8	104,100.0	529.3	0.6	0.3	1.1
07/30/2022 21:00	4,702.5	559.8	5,262.3	104,100.0	547.8	0.7	0.3	1.1
07/30/2022 22:00	4,725.6	363.7	5,089.3	104,100.0	529.8	0.6	0.3	1.1
07/30/2022 23:00	4,737.5	322.6	5,060.1	104,100.0	526.8	0.6	0.3	1.1
Average/Sum#:	4,310.8	429.8	4,736.2	104,100.0	493.0	0.6	0.3	1.0
Minimum:	2,865.4	0.0	2,865.4	104,100.0	298.3	0.4	0.2	0.6
Maximum:	4,806.8	1,781.8	6,345.3	104,100.0	660.5	0.8	0.4	1.3
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:29 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2	Unit CT2	Unit CT2
						PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/31/2022 00:00	4,745.3	318.2	5,063.5	104,100.0	527.1	0.6	0.3	1.1
07/31/2022 01:00	4,746.0	304.3	5,050.3	104,100.0	525.7	0.6	0.3	1.1
07/31/2022 02:00	4,751.0	292.0	5,043.0	104,100.0	525.0	0.6	0.3	1.1
07/31/2022 03:00	4,316.9	140.6	4,390.0	104,100.0	457.0	0.6	0.3	0.9
07/31/2022 04:00	2,898.9	0.0	2,898.9	104,100.0	301.8	0.4	0.2	0.6
07/31/2022 05:00	3,776.0	0.0	3,776.0	104,100.0	393.1	0.5	0.2	0.8
07/31/2022 06:00	3,981.9	0.0	3,981.9	104,100.0	414.5	0.5	0.2	0.8
07/31/2022 07:00	2,958.0	0.0	2,958.0	104,100.0	307.9	0.4	0.2	0.6
07/31/2022 08:00	2,839.1	0.0	2,839.1	104,100.0	295.6	0.4	0.2	0.6
07/31/2022 09:00	2,938.3	0.0	2,938.3	104,100.0	305.9	0.4	0.2	0.6
07/31/2022 10:00	4,044.1	70.2	4,060.2	104,100.0	422.7	0.5	0.3	0.9
07/31/2022 11:00	4,656.2	375.8	5,032.0	104,100.0	523.8	0.6	0.3	1.0
07/31/2022 12:00	4,639.1	388.8	5,027.9	104,100.0	523.4	0.6	0.3	1.0
07/31/2022 13:00	4,622.2	415.1	5,037.3	104,100.0	524.4	0.6	0.3	1.0
07/31/2022 14:00	4,589.6	774.6	5,364.2	104,100.0	558.4	0.7	0.3	1.1
07/31/2022 15:00	4,576.9	679.5	5,256.4	104,100.0	547.2	0.7	0.3	1.1
07/31/2022 16:00	4,575.8	830.1	5,405.9	104,100.0	562.8	0.7	0.3	1.1
07/31/2022 17:00	4,585.9	1,174.6	5,760.5	104,100.0	599.7	0.7	0.4	1.2
07/31/2022 18:00	4,625.3	470.9	5,096.2	104,100.0	530.5	0.6	0.3	1.1
07/31/2022 19:00	4,653.7	398.7	5,052.4	104,100.0	526.0	0.6	0.3	1.1
07/31/2022 20:00	4,684.5	402.7	5,087.2	104,100.0	529.6	0.6	0.3	1.1
07/31/2022 21:00	4,707.1	452.2	5,159.3	104,100.0	537.1	0.6	0.3	1.1
07/31/2022 22:00	4,318.8	169.9	4,407.1	104,100.0	458.8	0.6	0.3	0.9
07/31/2022 23:00	3,026.6	0.0	3,026.6	104,100.0	315.1	0.4	0.2	0.6
Average/Sum#:	4,177.4	319.1	4,488.0	104,100.0	467.2	0.6	0.3	0.9
Minimum:	2,839.1	0.0	2,839.1	104,100.0	295.6	0.4	0.2	0.6
Maximum:	4,751.0	1,174.6	5,760.5	104,100.0	599.7	0.7	0.4	1.2
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:29 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2	Unit CT2	Unit CT2
						PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/01/2022 00:00	3,931.5	0.0	3,931.5	103,800.0	408.1	0.5	0.2	0.8
08/01/2022 01:00	2,968.3	0.0	2,968.3	103,800.0	308.1	0.4	0.2	0.6
08/01/2022 02:00	2,975.5	0.0	2,975.5	103,800.0	308.9	0.4	0.2	0.6
08/01/2022 03:00	3,978.1	68.1	3,997.2	103,800.0	414.9	0.5	0.3	0.8
08/01/2022 04:00	4,781.9	242.6	5,024.5	103,800.0	521.5	0.6	0.3	1.0
08/01/2022 05:00	4,791.3	633.8	5,425.1	103,800.0	563.1	0.7	0.3	1.1
08/01/2022 06:00	4,795.0	1,002.6	5,797.6	103,800.0	601.8	0.7	0.4	1.2
08/01/2022 07:00	4,797.3	220.9	5,018.2	103,800.0	520.9	0.6	0.3	1.0
08/01/2022 08:00	4,779.4	248.9	5,028.3	103,800.0	521.9	0.6	0.3	1.0
08/01/2022 09:00	4,756.2	315.3	5,071.5	103,800.0	526.4	0.6	0.3	1.1
08/01/2022 10:00	4,755.4	295.5	5,050.9	103,800.0	524.3	0.6	0.3	1.0
08/01/2022 11:00	4,727.5	329.4	5,056.9	103,800.0	524.9	0.6	0.3	1.1
08/01/2022 12:00	4,720.1	334.2	5,054.3	103,800.0	524.6	0.6	0.3	1.1
08/01/2022 13:00	4,705.8	353.1	5,058.9	103,800.0	525.1	0.6	0.3	1.1
08/01/2022 14:00	4,689.6	373.0	5,062.6	103,800.0	525.5	0.6	0.3	1.1
08/01/2022 15:00	4,662.9	425.3	5,088.2	103,800.0	528.2	0.6	0.3	1.1
08/01/2022 16:00	4,657.8	411.2	5,069.0	103,800.0	526.2	0.6	0.3	1.1
08/01/2022 17:00	4,660.7	407.6	5,068.3	103,800.0	526.1	0.6	0.3	1.1
08/01/2022 18:00	4,667.2	399.1	5,066.3	103,800.0	525.9	0.6	0.3	1.1
08/01/2022 19:00	4,665.0	393.9	5,058.9	103,800.0	525.1	0.6	0.3	1.1
08/01/2022 20:00	4,667.5	440.9	5,108.4	103,800.0	530.3	0.6	0.3	1.1
08/01/2022 21:00	4,681.2	436.2	5,117.4	103,800.0	531.2	0.6	0.3	1.1
08/01/2022 22:00	4,387.9	172.8	4,477.8	103,800.0	464.8	0.6	0.3	0.9
08/01/2022 23:00	2,985.7	0.0	2,985.7	103,800.0	309.9	0.4	0.2	0.6
Average/Sum#:	4,424.5	312.7	4,731.7	103,800.0	491.2	0.6	0.3	1.0
Minimum:	2,968.3	0.0	2,968.3	103,800.0	308.1	0.4	0.2	0.6
Maximum:	4,797.3	1,002.6	5,797.6	103,800.0	601.8	0.7	0.4	1.2
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:29 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2	Unit CT2	Unit CT2
	PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr					
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/02/2022 00:00	2,941.8	0.0	2,941.8	103,800.0	305.4	0.4	0.2	0.6
08/02/2022 01:00	2,896.6	0.0	2,896.6	103,800.0	300.7	0.4	0.2	0.6
08/02/2022 02:00	2,847.0	0.0	2,847.0	103,800.0	295.5	0.4	0.2	0.6
08/02/2022 03:00	2,962.6	0.0	2,962.6	103,800.0	307.5	0.4	0.2	0.6
08/02/2022 04:00	3,976.2	82.6	3,999.3	103,800.0	415.1	0.5	0.3	0.8
08/02/2022 05:00	4,748.2	315.0	5,063.2	103,800.0	525.6	0.6	0.3	1.1
08/02/2022 06:00	3,850.3	76.6	3,873.3	103,800.0	402.0	0.5	0.2	0.8
08/02/2022 07:00	2,836.5	0.0	2,836.5	103,800.0	294.4	0.4	0.2	0.6
08/02/2022 08:00	2,834.0	0.0	2,834.0	103,800.0	294.2	0.4	0.2	0.6
08/02/2022 09:00	2,829.5	0.0	2,829.5	103,800.0	293.7	0.4	0.2	0.6
08/02/2022 10:00	2,825.6	0.0	2,825.6	103,800.0	293.3	0.4	0.2	0.6
08/02/2022 11:00	3,821.9	182.3	3,889.4	103,800.0	403.7	0.5	0.2	0.8
08/02/2022 12:00	4,562.1	637.4	5,199.5	103,800.0	539.7	0.6	0.3	1.1
08/02/2022 13:00	4,550.9	676.1	5,227.0	103,800.0	542.6	0.7	0.3	1.1
08/02/2022 14:00	4,542.3	627.2	5,169.5	103,800.0	536.6	0.6	0.3	1.1
08/02/2022 15:00	4,536.5	657.5	5,194.0	103,800.0	539.1	0.6	0.3	1.1
08/02/2022 16:00	4,536.6	1,303.8	5,840.4	103,800.0	606.2	0.7	0.4	1.2
08/02/2022 17:00	4,541.5	1,689.6	6,231.1	103,800.0	646.8	0.8	0.4	1.3
08/02/2022 18:00	4,560.1	777.1	5,337.2	103,800.0	554.0	0.7	0.3	1.1
08/02/2022 19:00	4,598.8	493.3	5,092.1	103,800.0	528.6	0.6	0.3	1.1
08/02/2022 20:00	4,648.2	526.7	5,174.9	103,800.0	537.2	0.6	0.3	1.1
08/02/2022 21:00	4,677.5	381.9	5,059.4	103,800.0	525.2	0.6	0.3	1.1
08/02/2022 22:00	4,692.2	374.2	5,066.4	103,800.0	525.9	0.6	0.3	1.1
08/02/2022 23:00	4,725.5	338.9	5,064.4	103,800.0	525.7	0.6	0.3	1.1
Average/Sum#:	3,939.3	380.8	4,310.6	103,800.0	447.4	0.5	0.3	0.9
Minimum:	2,825.6	0.0	2,825.6	103,800.0	293.3	0.4	0.2	0.6
Maximum:	4,748.2	1,689.6	6,231.1	103,800.0	646.8	0.8	0.4	1.3
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:29 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2	Unit CT2	Unit CT2
						PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/03/2022 00:00	3,411.8	2.0	3,411.9	103,800.0	354.2	0.4	0.2	0.7
08/03/2022 01:00	2,973.4	0.0	2,973.4	103,800.0	308.6	0.4	0.2	0.6
08/03/2022 02:00	2,969.1	0.0	2,969.1	103,800.0	308.2	0.4	0.2	0.6
08/03/2022 03:00	2,962.6	0.0	2,962.6	103,800.0	307.5	0.4	0.2	0.6
08/03/2022 04:00	3,959.2	72.7	3,979.6	103,800.0	413.1	0.5	0.3	0.8
08/03/2022 05:00	4,762.4	236.9	4,999.3	103,800.0	518.9	0.6	0.3	1.0
08/03/2022 06:00	3,590.7	1.1	3,590.7	103,800.0	372.7	0.4	0.2	0.7
08/03/2022 07:00	2,887.3	0.0	2,887.3	103,800.0	299.7	0.4	0.2	0.6
08/03/2022 08:00	2,959.7	0.0	2,959.7	103,800.0	307.2	0.4	0.2	0.6
08/03/2022 09:00	2,873.5	0.0	2,873.5	103,800.0	298.3	0.4	0.2	0.6
08/03/2022 10:00	2,838.0	0.0	2,838.0	103,800.0	294.6	0.4	0.2	0.6
08/03/2022 11:00	3,041.4	0.0	3,041.4	103,800.0	315.7	0.4	0.2	0.6
08/03/2022 12:00	3,467.8	0.0	3,467.8	103,800.0	360.0	0.4	0.2	0.7
08/03/2022 13:00	4,541.4	462.7	4,925.4	103,800.0	511.3	0.6	0.3	1.0
08/03/2022 14:00	4,523.1	730.4	5,253.5	103,800.0	545.3	0.7	0.3	1.1
08/03/2022 15:00	4,509.9	658.1	5,168.0	103,800.0	536.4	0.6	0.3	1.1
08/03/2022 16:00	4,501.3	704.5	5,205.8	103,800.0	540.4	0.6	0.3	1.1
08/03/2022 17:00	4,497.6	1,861.6	6,359.2	103,800.0	660.1	0.8	0.4	1.3
08/03/2022 18:00	4,525.1	1,870.6	6,395.7	103,800.0	663.9	0.8	0.4	1.3
08/03/2022 19:00	4,550.8	1,797.7	6,348.5	103,800.0	659.0	0.8	0.4	1.3
08/03/2022 20:00	4,580.7	1,344.2	5,924.9	103,800.0	615.0	0.7	0.4	1.2
08/03/2022 21:00	4,614.3	518.9	5,133.2	103,800.0	532.8	0.6	0.3	1.1
08/03/2022 22:00	4,639.3	436.1	5,075.4	103,800.0	526.8	0.6	0.3	1.1
08/03/2022 23:00	4,649.3	440.9	5,090.2	103,800.0	528.4	0.6	0.3	1.1
Average/Sum#:	3,867.9	464.1	4,326.4	103,800.0	449.1	0.5	0.3	0.9
Minimum:	2,838.0	0.0	2,838.0	103,800.0	294.6	0.4	0.2	0.6
Maximum:	4,762.4	1,870.6	6,395.7	103,800.0	663.9	0.8	0.4	1.3
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:29 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2	Unit CT2	Unit CT2
						PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/04/2022 00:00	4,665.6	385.1	5,050.7	103,800.0	524.3	0.6	0.3	1.0
08/04/2022 01:00	4,679.5	364.9	5,044.4	103,800.0	523.6	0.6	0.3	1.0
08/04/2022 02:00	4,607.5	257.5	4,805.8	103,800.0	498.8	0.6	0.3	1.0
08/04/2022 03:00	3,000.2	0.0	3,000.2	103,800.0	311.4	0.4	0.2	0.6
08/04/2022 04:00	3,853.5	77.7	3,871.4	103,800.0	401.9	0.5	0.2	0.8
08/04/2022 05:00	4,708.1	335.5	5,043.6	103,800.0	523.5	0.6	0.3	1.0
08/04/2022 06:00	4,585.6	165.7	4,676.7	103,800.0	485.4	0.6	0.3	1.0
08/04/2022 07:00	3,928.5	0.0	3,928.5	103,800.0	407.8	0.5	0.2	0.8
08/04/2022 08:00	3,919.9	139.5	3,975.7	103,800.0	412.7	0.5	0.3	0.8
08/04/2022 09:00	4,659.8	393.6	5,053.4	103,800.0	524.5	0.6	0.3	1.0
08/04/2022 10:00	4,629.4	433.7	5,063.1	103,800.0	525.5	0.6	0.3	1.1
08/04/2022 11:00	4,600.9	502.2	5,103.1	103,800.0	529.7	0.6	0.3	1.1
08/04/2022 12:00	4,570.2	692.0	5,262.2	103,800.0	546.2	0.7	0.3	1.1
08/04/2022 13:00	4,541.1	1,066.4	5,607.5	103,800.0	582.1	0.7	0.3	1.2
08/04/2022 14:00	4,534.4	1,888.3	6,422.7	103,800.0	666.7	0.8	0.4	1.3
08/04/2022 15:00	4,539.8	1,777.5	6,317.3	103,800.0	655.7	0.8	0.4	1.3
08/04/2022 16:00	4,548.3	1,700.4	6,248.7	103,800.0	648.6	0.8	0.4	1.3
08/04/2022 17:00	4,553.1	1,550.9	6,104.0	103,800.0	633.6	0.8	0.4	1.3
08/04/2022 18:00	4,585.3	1,127.3	5,712.6	103,800.0	593.0	0.7	0.4	1.2
08/04/2022 19:00	4,635.8	798.8	5,434.6	103,800.0	564.1	0.7	0.3	1.1
08/04/2022 20:00	4,672.1	426.4	5,098.5	103,800.0	529.2	0.6	0.3	1.1
08/04/2022 21:00	4,687.2	352.7	5,039.9	103,800.0	523.1	0.6	0.3	1.0
08/04/2022 22:00	4,717.0	307.6	5,024.6	103,800.0	521.6	0.6	0.3	1.0
08/04/2022 23:00	3,906.8	1.6	3,906.8	103,800.0	405.5	0.5	0.2	0.8
Average/Sum#:	4,430.4	614.4	5,033.2	103,800.0	522.4	0.6	0.3	1.0
Minimum:	3,000.2	0.0	3,000.2	103,800.0	311.4	0.4	0.2	0.6
Maximum:	4,717.0	1,888.3	6,422.7	103,800.0	666.7	0.8	0.4	1.3
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:29 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2	Unit CT2	Unit CT2
						PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/05/2022 00:00	3,207.5	0.0	3,207.5	103,800.0	332.9	0.4	0.2	0.7
08/05/2022 01:00	3,006.7	0.0	3,006.7	103,800.0	312.1	0.4	0.2	0.6
08/05/2022 02:00	3,305.6	0.0	3,305.6	103,800.0	343.1	0.4	0.2	0.7
08/05/2022 03:00	2,970.2	0.0	2,970.2	103,800.0	308.3	0.4	0.2	0.6
08/05/2022 04:00	3,534.5	2.7	3,534.6	103,800.0	366.9	0.4	0.2	0.7
08/05/2022 05:00	4,793.4	200.0	4,993.4	103,800.0	518.3	0.6	0.3	1.0
08/05/2022 06:00	4,796.7	274.0	5,070.7	103,800.0	526.3	0.6	0.3	1.1
08/05/2022 07:00	4,792.5	204.1	4,996.6	103,800.0	518.6	0.6	0.3	1.0
08/05/2022 08:00	4,781.2	211.3	4,992.5	103,800.0	518.2	0.6	0.3	1.0
08/05/2022 09:00	4,768.5	232.4	5,000.9	103,800.0	519.1	0.6	0.3	1.0
08/05/2022 10:00	4,730.6	280.6	5,011.2	103,800.0	520.2	0.6	0.3	1.0
08/05/2022 11:00	4,676.9	360.1	5,037.0	103,800.0	522.8	0.6	0.3	1.0
08/05/2022 12:00	4,668.1	381.1	5,049.2	103,800.0	524.1	0.6	0.3	1.0
08/05/2022 13:00	4,670.1	376.8	5,046.9	103,800.0	523.9	0.6	0.3	1.0
08/05/2022 14:00	4,635.2	429.3	5,064.5	103,800.0	525.7	0.6	0.3	1.1
08/05/2022 15:00	4,637.1	436.0	5,073.1	103,800.0	526.6	0.6	0.3	1.1
08/05/2022 16:00	4,640.9	435.8	5,076.7	103,800.0	527.0	0.6	0.3	1.1
08/05/2022 17:00	4,633.5	455.9	5,089.4	103,800.0	528.3	0.6	0.3	1.1
08/05/2022 18:00	4,637.2	448.9	5,086.1	103,800.0	527.9	0.6	0.3	1.1
08/05/2022 19:00	4,659.1	415.3	5,074.4	103,800.0	526.7	0.6	0.3	1.1
08/05/2022 20:00	4,700.6	356.1	5,056.7	103,800.0	524.9	0.6	0.3	1.1
08/05/2022 21:00	4,717.9	324.4	5,042.3	103,800.0	523.4	0.6	0.3	1.0
08/05/2022 22:00	4,301.7	152.3	4,380.9	103,800.0	454.7	0.6	0.3	0.9
08/05/2022 23:00	2,934.1	0.0	2,934.1	103,800.0	304.6	0.4	0.2	0.6
Average/Sum#:	4,300.0	249.0	4,545.9	103,800.0	471.9	0.6	0.3	0.9
Minimum:	2,934.1	0.0	2,934.1	103,800.0	304.6	0.4	0.2	0.6
Maximum:	4,796.7	455.9	5,089.4	103,800.0	528.3	0.6	0.3	1.1
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:29 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2	Unit CT2	Unit CT2
	PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr					
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/06/2022 00:00	2,938.8	0.0	2,938.8	103,800.0	305.0	0.4	0.2	0.6
08/06/2022 01:00	2,910.5	0.0	2,910.5	103,800.0	302.1	0.4	0.2	0.6
08/06/2022 02:00	2,851.3	0.0	2,851.3	103,800.0	296.0	0.4	0.2	0.6
08/06/2022 03:00	2,849.5	0.0	2,849.5	103,800.0	295.8	0.4	0.2	0.6
08/06/2022 04:00	2,857.7	0.0	2,857.7	103,800.0	296.6	0.4	0.2	0.6
08/06/2022 05:00	2,919.8	0.0	2,919.8	103,800.0	303.1	0.4	0.2	0.6
08/06/2022 06:00	2,881.0	0.0	2,881.0	103,800.0	299.0	0.4	0.2	0.6
08/06/2022 07:00	2,847.2	0.0	2,847.2	103,800.0	295.5	0.4	0.2	0.6
08/06/2022 08:00	2,847.1	0.0	2,847.1	103,800.0	295.5	0.4	0.2	0.6
08/06/2022 09:00	2,843.1	0.0	2,843.1	103,800.0	295.1	0.4	0.2	0.6
08/06/2022 10:00	2,841.5	0.0	2,841.5	103,800.0	294.9	0.4	0.2	0.6
08/06/2022 11:00	2,833.9	0.0	2,833.9	103,800.0	294.2	0.4	0.2	0.6
08/06/2022 12:00	2,826.7	0.0	2,826.7	103,800.0	293.4	0.4	0.2	0.6
08/06/2022 13:00	2,820.4	0.0	2,820.4	103,800.0	292.8	0.4	0.2	0.6
08/06/2022 14:00	2,852.0	0.0	2,852.0	103,800.0	296.0	0.4	0.2	0.6
08/06/2022 15:00	2,829.4	0.0	2,829.4	103,800.0	293.7	0.4	0.2	0.6
08/06/2022 16:00	2,878.2	0.0	2,878.2	103,800.0	298.8	0.4	0.2	0.6
08/06/2022 17:00	2,997.4	0.0	2,997.4	103,800.0	311.1	0.4	0.2	0.6
08/06/2022 18:00	4,204.0	0.0	4,204.0	103,800.0	436.4	0.5	0.3	0.9
08/06/2022 19:00	4,308.8	84.8	4,332.5	103,800.0	449.7	0.5	0.3	0.9
08/06/2022 20:00	4,715.7	410.7	5,126.4	103,800.0	532.1	0.6	0.3	1.1
08/06/2022 21:00	4,299.3	170.4	4,387.9	103,800.0	455.5	0.6	0.3	0.9
08/06/2022 22:00	2,927.1	0.0	2,927.1	103,800.0	303.8	0.4	0.2	0.6
08/06/2022 23:00	2,950.1	0.0	2,950.1	103,800.0	306.2	0.4	0.2	0.6
Average/Sum#:	3,126.3	27.7	3,148.1	103,800.0	326.8	0.4	0.2	0.7
Minimum:	2,820.4	0.0	2,820.4	103,800.0	292.8	0.4	0.2	0.6
Maximum:	4,715.7	410.7	5,126.4	103,800.0	532.1	0.6	0.3	1.1
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:29 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2	Unit CT2	Unit CT2
	PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr					
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/07/2022 00:00	2,894.5	0.0	2,894.5	103,800.0	300.4	0.4	0.2	0.6
08/07/2022 01:00	2,975.5	0.0	2,975.5	103,800.0	308.9	0.4	0.2	0.6
08/07/2022 02:00	2,911.7	0.0	2,911.7	103,800.0	302.2	0.4	0.2	0.6
08/07/2022 03:00	2,852.9	0.0	2,852.9	103,800.0	296.1	0.4	0.2	0.6
08/07/2022 04:00	2,953.2	0.0	2,953.2	103,800.0	306.5	0.4	0.2	0.6
08/07/2022 05:00	2,952.0	0.0	2,952.0	103,800.0	306.4	0.4	0.2	0.6
08/07/2022 06:00	2,895.1	0.0	2,895.1	103,800.0	300.5	0.4	0.2	0.6
08/07/2022 07:00	2,856.0	0.0	2,856.0	103,800.0	296.5	0.4	0.2	0.6
08/07/2022 08:00	2,849.5	0.0	2,849.5	103,800.0	295.8	0.4	0.2	0.6
08/07/2022 09:00	2,840.3	0.0	2,840.3	103,800.0	294.8	0.4	0.2	0.6
08/07/2022 10:00	2,829.2	0.0	2,829.2	103,800.0	293.7	0.4	0.2	0.6
08/07/2022 11:00	2,824.9	0.0	2,824.9	103,800.0	293.2	0.4	0.2	0.6
08/07/2022 12:00	2,822.8	0.0	2,822.8	103,800.0	293.0	0.4	0.2	0.6
08/07/2022 13:00	2,830.2	0.0	2,830.2	103,800.0	293.8	0.4	0.2	0.6
08/07/2022 14:00	2,877.4	0.0	2,877.4	103,800.0	298.7	0.4	0.2	0.6
08/07/2022 15:00	2,850.1	0.0	2,850.1	103,800.0	295.8	0.4	0.2	0.6
08/07/2022 16:00	3,314.5	0.0	3,314.5	103,800.0	344.0	0.4	0.2	0.7
08/07/2022 17:00	4,511.8	236.2	4,634.6	103,800.0	481.1	0.6	0.3	1.0
08/07/2022 18:00	4,670.6	368.0	5,038.6	103,800.0	523.0	0.6	0.3	1.0
08/07/2022 19:00	4,698.0	325.2	5,023.2	103,800.0	521.4	0.6	0.3	1.0
08/07/2022 20:00	4,731.5	272.1	5,003.6	103,800.0	519.4	0.6	0.3	1.0
08/07/2022 21:00	4,758.3	254.2	5,012.5	103,800.0	520.3	0.6	0.3	1.0
08/07/2022 22:00	3,868.7	57.7	3,884.3	103,800.0	403.2	0.5	0.2	0.8
08/07/2022 23:00	2,971.6	0.0	2,971.6	103,800.0	308.5	0.4	0.2	0.6
Average/Sum#:	3,314.2	63.1	3,370.8	103,800.0	349.9	0.4	0.2	0.7
Minimum:	2,822.8	0.0	2,822.8	103,800.0	293.0	0.4	0.2	0.6
Maximum:	4,758.3	368.0	5,038.6	103,800.0	523.0	0.6	0.3	1.0
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:29 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/08/2022 00:00	3,005.6	0.0	3,005.6	103,800.0	312.0	0.4	0.2	0.6
08/08/2022 01:00	2,974.5	0.0	2,974.5	103,800.0	308.8	0.4	0.2	0.6
08/08/2022 02:00	2,972.8	0.0	2,972.8	103,800.0	308.6	0.4	0.2	0.6
08/08/2022 03:00	2,976.6	0.0	2,976.6	103,800.0	309.0	0.4	0.2	0.6
08/08/2022 04:00	4,165.8	47.7	4,176.8	103,800.0	433.6	0.5	0.3	0.9
08/08/2022 05:00	4,811.6	208.2	5,019.8	103,800.0	521.1	0.6	0.3	1.0
08/08/2022 06:00	3,867.2	39.5	3,877.9	103,800.0	402.5	0.5	0.2	0.8
08/08/2022 07:00	2,907.7	0.0	2,907.7	103,800.0	301.8	0.4	0.2	0.6
08/08/2022 08:00	2,878.0	0.0	2,878.0	103,800.0	298.7	0.4	0.2	0.6
08/08/2022 09:00	2,914.9	0.0	2,914.9	103,800.0	302.6	0.4	0.2	0.6
08/08/2022 10:00	2,953.5	0.0	2,953.5	103,800.0	306.6	0.4	0.2	0.6
08/08/2022 11:00	4,028.8	124.1	4,068.5	103,800.0	422.3	0.5	0.3	0.9
08/08/2022 12:00	4,641.6	460.3	5,101.9	103,800.0	529.6	0.6	0.3	1.1
08/08/2022 13:00	3,433.6	2.8	3,433.7	103,800.0	356.4	0.4	0.2	0.7
08/08/2022 14:00	3,946.0	3.0	3,946.1	103,800.0	409.6	0.5	0.2	0.8
08/08/2022 15:00	4,599.4	457.0	5,056.4	103,800.0	524.9	0.6	0.3	1.0
08/08/2022 16:00	4,614.8	475.9	5,090.7	103,800.0	528.4	0.6	0.3	1.1
08/08/2022 17:00	4,635.4	822.6	5,458.0	103,800.0	566.5	0.7	0.3	1.1
08/08/2022 18:00	4,658.4	975.3	5,633.7	103,800.0	584.8	0.7	0.4	1.2
08/08/2022 19:00	4,685.3	1,212.2	5,897.5	103,800.0	612.2	0.7	0.4	1.2
08/08/2022 20:00	4,709.0	1,088.8	5,797.8	103,800.0	601.8	0.7	0.4	1.2
08/08/2022 21:00	4,727.7	474.8	5,202.5	103,800.0	540.0	0.6	0.3	1.1
08/08/2022 22:00	4,742.3	334.7	5,077.0	103,800.0	527.0	0.6	0.3	1.1
08/08/2022 23:00	4,761.5	241.5	5,003.0	103,800.0	519.3	0.6	0.3	1.0
Average/Sum#:	3,942.2	290.4	4,226.0	103,800.0	438.7	0.5	0.3	0.9
Minimum:	2,878.0	0.0	2,878.0	103,800.0	298.7	0.4	0.2	0.6
Maximum:	4,811.6	1,212.2	5,897.5	103,800.0	612.2	0.7	0.4	1.2
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:29 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2	Unit CT2	Unit CT2
	PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr					
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/09/2022 00:00	4,775.3	233.3	5,008.6	103,800.0	519.9	0.6	0.3	1.0
08/09/2022 01:00	4,774.7	227.3	5,002.0	103,800.0	519.2	0.6	0.3	1.0
08/09/2022 02:00	4,776.2	229.4	5,005.6	103,800.0	519.6	0.6	0.3	1.0
08/09/2022 03:00	4,778.2	226.7	5,004.9	103,800.0	519.5	0.6	0.3	1.0
08/09/2022 04:00	4,790.6	220.5	5,011.1	103,800.0	520.2	0.6	0.3	1.0
08/09/2022 05:00	4,789.5	213.1	5,002.6	103,800.0	519.3	0.6	0.3	1.0
08/09/2022 06:00	4,788.5	205.3	4,993.8	103,800.0	518.4	0.6	0.3	1.0
08/09/2022 07:00	4,790.8	211.6	5,002.4	103,800.0	519.2	0.6	0.3	1.0
08/09/2022 08:00	4,774.1	239.8	5,013.9	103,800.0	520.4	0.6	0.3	1.0
08/09/2022 09:00	4,753.2	275.6	5,028.8	103,800.0	522.0	0.6	0.3	1.0
08/09/2022 10:00	4,720.2	312.4	5,032.6	103,800.0	522.4	0.6	0.3	1.0
08/09/2022 11:00	4,698.4	342.9	5,041.3	103,800.0	523.3	0.6	0.3	1.0
08/09/2022 12:00	4,639.0	276.3	4,851.8	103,800.0	503.6	0.6	0.3	1.0
08/09/2022 13:00	3,029.7	0.0	3,029.7	103,800.0	314.5	0.4	0.2	0.6
08/09/2022 14:00	3,985.2	103.1	4,014.1	103,800.0	416.7	0.5	0.3	0.8
08/09/2022 15:00	4,643.9	403.2	5,047.1	103,800.0	523.9	0.6	0.3	1.0
08/09/2022 16:00	4,652.6	380.7	5,033.3	103,800.0	522.5	0.6	0.3	1.0
08/09/2022 17:00	4,657.8	402.0	5,059.8	103,800.0	525.2	0.6	0.3	1.1
08/09/2022 18:00	4,700.6	1,026.1	5,726.7	103,800.0	594.4	0.7	0.4	1.2
08/09/2022 19:00	4,739.9	633.3	5,373.2	103,800.0	557.7	0.7	0.3	1.1
08/09/2022 20:00	4,765.5	1,013.4	5,778.9	103,800.0	599.8	0.7	0.4	1.2
08/09/2022 21:00	4,776.6	695.6	5,472.2	103,800.0	568.0	0.7	0.3	1.1
08/09/2022 22:00	4,786.4	522.5	5,308.9	103,800.0	551.1	0.7	0.3	1.1
08/09/2022 23:00	4,756.2	228.0	4,931.8	103,800.0	511.9	0.6	0.3	1.0
Average/Sum#:	4,639.3	359.3	4,990.6	103,800.0	518.0	0.6	0.3	1.0
Minimum:	3,029.7	0.0	3,029.7	103,800.0	314.5	0.4	0.2	0.6
Maximum:	4,790.8	1,026.1	5,778.9	103,800.0	599.8	0.7	0.4	1.2
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:29 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2	Unit CT2	Unit CT2
						PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/10/2022 00:00	4,461.0	0.0	4,461.0	103,800.0	463.1	0.6	0.3	0.9
08/10/2022 01:00	4,578.5	0.0	4,578.5	103,800.0	475.2	0.6	0.3	1.0
08/10/2022 02:00	4,610.0	0.0	4,610.0	103,800.0	478.5	0.6	0.3	1.0
08/10/2022 03:00	4,817.2	36.5	4,825.6	103,800.0	500.9	0.6	0.3	1.0
08/10/2022 04:00	4,820.5	689.9	5,510.4	103,800.0	572.0	0.7	0.3	1.1
08/10/2022 05:00	4,826.3	465.1	5,291.4	103,800.0	549.2	0.7	0.3	1.1
08/10/2022 06:00	3,881.0	33.3	3,890.0	103,800.0	403.8	0.5	0.2	0.8
08/10/2022 07:00	2,935.4	0.0	2,935.4	103,800.0	304.7	0.4	0.2	0.6
08/10/2022 08:00	2,953.5	0.0	2,953.5	103,800.0	306.6	0.4	0.2	0.6
08/10/2022 09:00	2,931.8	0.0	2,931.8	103,800.0	304.3	0.4	0.2	0.6
08/10/2022 10:00	2,970.1	0.0	2,970.1	103,800.0	308.3	0.4	0.2	0.6
08/10/2022 11:00	3,208.9	0.0	3,208.9	103,800.0	333.1	0.4	0.2	0.7
08/10/2022 12:00	2,945.2	0.0	2,945.2	103,800.0	305.7	0.4	0.2	0.6
08/10/2022 13:00	3,244.7	0.0	3,244.7	103,800.0	336.8	0.4	0.2	0.7
08/10/2022 14:00	4,521.6	417.1	4,742.7	103,800.0	492.3	0.6	0.3	1.0
08/10/2022 15:00	4,656.9	742.5	5,399.4	103,800.0	560.5	0.7	0.3	1.1
08/10/2022 16:00	4,668.3	350.2	5,018.5	103,800.0	520.9	0.6	0.3	1.0
08/10/2022 17:00	4,677.7	489.1	5,166.8	103,800.0	536.3	0.6	0.3	1.1
08/10/2022 18:00	4,677.8	1,170.7	5,848.5	103,800.0	607.1	0.7	0.4	1.2
08/10/2022 19:00	4,702.2	1,049.6	5,751.8	103,800.0	597.0	0.7	0.4	1.2
08/10/2022 20:00	4,724.5	757.6	5,482.1	103,800.0	569.0	0.7	0.3	1.1
08/10/2022 21:00	4,748.3	536.2	5,284.5	103,800.0	548.5	0.7	0.3	1.1
08/10/2022 22:00	4,537.2	142.9	4,611.5	103,800.0	478.7	0.6	0.3	1.0
08/10/2022 23:00	4,458.9	0.0	4,458.9	103,800.0	462.8	0.6	0.3	0.9
Average/Sum#:	4,148.2	286.7	4,421.7	103,800.0	459.0	0.6	0.3	0.9
Minimum:	2,931.8	0.0	2,931.8	103,800.0	304.3	0.4	0.2	0.6
Maximum:	4,826.3	1,170.7	5,848.5	103,800.0	607.1	0.7	0.4	1.2
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:29 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/11/2022 00:00	4,490.3	0.0	4,490.3	103,800.0	466.1	0.6	0.3	0.9
08/11/2022 01:00	4,444.4	0.0	4,444.4	103,800.0	461.3	0.6	0.3	0.9
08/11/2022 02:00	4,207.2	0.0	4,207.2	103,800.0	436.7	0.5	0.3	0.9
08/11/2022 03:00	4,367.1	0.0	4,367.1	103,800.0	453.3	0.5	0.3	0.9
08/11/2022 04:00	4,479.9	0.0	4,479.9	103,800.0	465.0	0.6	0.3	0.9
08/11/2022 05:00	4,581.5	0.0	4,581.5	103,800.0	475.6	0.6	0.3	1.0
08/11/2022 06:00	3,757.5	0.0	3,757.5	103,800.0	390.0	0.5	0.2	0.8
08/11/2022 07:00	3,349.9	0.0	3,349.9	103,800.0	347.7	0.4	0.2	0.7
08/11/2022 08:00	2,965.6	0.0	2,965.6	103,800.0	307.8	0.4	0.2	0.6
08/11/2022 09:00	2,960.6	0.0	2,960.6	103,800.0	307.3	0.4	0.2	0.6
08/11/2022 10:00	2,956.4	0.0	2,956.4	103,800.0	306.9	0.4	0.2	0.6
08/11/2022 11:00	4,028.5	0.0	4,028.5	103,800.0	418.2	0.5	0.3	0.8
08/11/2022 12:00	4,279.4	37.1	4,289.8	103,800.0	445.3	0.5	0.3	0.9
08/11/2022 13:00	4,641.1	1,029.3	5,670.4	103,800.0	588.6	0.7	0.4	1.2
08/11/2022 14:00	4,640.0	700.8	5,340.8	103,800.0	554.4	0.7	0.3	1.1
08/11/2022 15:00	4,644.6	988.8	5,633.4	103,800.0	584.7	0.7	0.4	1.2
08/11/2022 16:00	4,638.3	980.8	5,619.1	103,800.0	583.3	0.7	0.3	1.2
08/11/2022 17:00	4,636.6	1,082.6	5,719.2	103,800.0	593.7	0.7	0.4	1.2
08/11/2022 18:00	4,655.6	1,266.4	5,922.0	103,800.0	614.7	0.7	0.4	1.2
08/11/2022 19:00	4,683.8	1,048.8	5,732.6	103,800.0	595.0	0.7	0.4	1.2
08/11/2022 20:00	4,719.0	1,330.0	6,049.0	103,800.0	627.9	0.8	0.4	1.3
08/11/2022 21:00	4,715.7	297.3	4,953.5	103,800.0	514.2	0.6	0.3	1.0
08/11/2022 22:00	4,461.1	0.0	4,461.1	103,800.0	463.1	0.6	0.3	0.9
08/11/2022 23:00	4,493.9	0.0	4,493.9	103,800.0	466.5	0.6	0.3	0.9
Average/Sum#:	4,241.6	365.1	4,603.1	103,800.0	477.8	0.6	0.3	1.0
Minimum:	2,956.4	0.0	2,956.4	103,800.0	306.9	0.4	0.2	0.6
Maximum:	4,719.0	1,330.0	6,049.0	103,800.0	627.9	0.8	0.4	1.3
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:29 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/12/2022 00:00	4,729.2	0.0	4,729.2	103,800.0	490.9	0.6	0.3	1.0
08/12/2022 01:00	4,650.5	0.0	4,650.5	103,800.0	482.7	0.6	0.3	1.0
08/12/2022 02:00	4,300.2	0.0	4,300.2	103,800.0	446.4	0.5	0.3	0.9
08/12/2022 03:00	4,482.3	0.0	4,482.3	103,800.0	465.3	0.6	0.3	0.9
08/12/2022 04:00	4,672.4	0.0	4,672.4	103,800.0	485.0	0.6	0.3	1.0
08/12/2022 05:00	4,656.9	0.0	4,656.9	103,800.0	483.4	0.6	0.3	1.0
08/12/2022 06:00	3,476.4	0.0	3,476.4	103,800.0	360.9	0.4	0.2	0.7
08/12/2022 07:00	3,385.8	0.0	3,385.8	103,800.0	351.4	0.4	0.2	0.7
08/12/2022 08:00	2,904.4	0.0	2,904.4	103,800.0	301.5	0.4	0.2	0.6
08/12/2022 09:00	2,903.0	0.0	2,903.0	103,800.0	301.3	0.4	0.2	0.6
08/12/2022 10:00	2,947.0	0.0	2,947.0	103,800.0	305.9	0.4	0.2	0.6
08/12/2022 11:00	2,916.3	0.0	2,916.3	103,800.0	302.7	0.4	0.2	0.6
08/12/2022 12:00	3,489.2	33.5	3,494.2	103,800.0	362.7	0.4	0.2	0.7
08/12/2022 13:00	4,638.9	459.4	5,098.3	103,800.0	529.2	0.6	0.3	1.1
08/12/2022 14:00	4,621.0	516.4	5,137.4	103,800.0	533.3	0.6	0.3	1.1
08/12/2022 15:00	4,630.3	482.7	5,113.0	103,800.0	530.7	0.6	0.3	1.1
08/12/2022 16:00	4,648.2	460.6	5,108.8	103,800.0	530.3	0.6	0.3	1.1
08/12/2022 17:00	4,646.4	1,061.7	5,708.1	103,800.0	592.5	0.7	0.4	1.2
08/12/2022 18:00	4,652.6	1,350.8	6,003.4	103,800.0	623.2	0.7	0.4	1.2
08/12/2022 19:00	4,689.3	875.9	5,565.2	103,800.0	577.7	0.7	0.3	1.2
08/12/2022 20:00	4,714.7	691.9	5,406.6	103,800.0	561.2	0.7	0.3	1.1
08/12/2022 21:00	4,706.2	311.8	4,955.6	103,800.0	514.4	0.6	0.3	1.0
08/12/2022 22:00	3,911.9	0.0	3,911.9	103,800.0	406.1	0.5	0.2	0.8
08/12/2022 23:00	4,410.2	0.0	4,410.2	103,800.0	457.8	0.5	0.3	0.9
Average/Sum#:	4,157.6	260.2	4,414.0	103,800.0	458.2	0.5	0.3	0.9
Minimum:	2,903.0	0.0	2,903.0	103,800.0	301.3	0.4	0.2	0.6
Maximum:	4,729.2	1,350.8	6,003.4	103,800.0	623.2	0.7	0.4	1.2
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:29 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2	Unit CT2	Unit CT2
						PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/13/2022 00:00	4,328.6	0.0	4,328.6	103,800.0	449.3	0.5	0.3	0.9
08/13/2022 01:00	4,364.9	0.0	4,364.9	103,800.0	453.1	0.5	0.3	0.9
08/13/2022 02:00	4,378.0	0.0	4,378.0	103,800.0	454.4	0.5	0.3	0.9
08/13/2022 03:00	4,457.5	0.0	4,457.5	103,800.0	462.7	0.6	0.3	0.9
08/13/2022 04:00	4,591.9	0.0	4,591.9	103,800.0	476.6	0.6	0.3	1.0
08/13/2022 05:00	4,546.5	0.0	4,546.5	103,800.0	471.9	0.6	0.3	0.9
08/13/2022 06:00	3,557.4	0.0	3,557.4	103,800.0	369.3	0.4	0.2	0.7
08/13/2022 07:00	2,909.0	0.0	2,909.0	103,800.0	302.0	0.4	0.2	0.6
08/13/2022 08:00	2,905.8	0.0	2,905.8	103,800.0	301.6	0.4	0.2	0.6
08/13/2022 09:00	2,956.2	0.0	2,956.2	103,800.0	306.9	0.4	0.2	0.6
08/13/2022 10:00	2,927.2	0.0	2,927.2	103,800.0	303.8	0.4	0.2	0.6
08/13/2022 11:00	2,944.7	0.0	2,944.7	103,800.0	305.7	0.4	0.2	0.6
08/13/2022 12:00	3,420.4	0.0	3,420.4	103,800.0	355.0	0.4	0.2	0.7
08/13/2022 13:00	3,995.7	141.2	4,052.2	103,800.0	420.6	0.5	0.3	0.9
08/13/2022 14:00	4,651.6	393.4	5,045.0	103,800.0	523.7	0.6	0.3	1.0
08/13/2022 15:00	4,624.7	425.9	5,050.6	103,800.0	524.3	0.6	0.3	1.0
08/13/2022 16:00	4,620.1	466.2	5,086.3	103,800.0	528.0	0.6	0.3	1.1
08/13/2022 17:00	4,623.3	905.6	5,528.9	103,800.0	573.9	0.7	0.3	1.1
08/13/2022 18:00	4,633.2	720.3	5,353.5	103,800.0	555.7	0.7	0.3	1.1
08/13/2022 19:00	4,668.0	386.6	5,054.6	103,800.0	524.7	0.6	0.3	1.0
08/13/2022 20:00	4,484.2	210.0	4,593.4	103,800.0	476.8	0.6	0.3	1.0
08/13/2022 21:00	3,144.8	0.0	3,144.8	103,800.0	326.4	0.4	0.2	0.7
08/13/2022 22:00	3,497.1	0.0	3,497.1	103,800.0	363.0	0.4	0.2	0.7
08/13/2022 23:00	4,215.9	0.0	4,215.9	103,800.0	437.6	0.5	0.3	0.9
Average/Sum#:	3,976.9	152.1	4,121.3	103,800.0	427.8	0.5	0.3	0.9
Minimum:	2,905.8	0.0	2,905.8	103,800.0	301.6	0.4	0.2	0.6
Maximum:	4,668.0	905.6	5,528.9	103,800.0	573.9	0.7	0.3	1.1
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:29 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2	Unit CT2	Unit CT2
						PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/14/2022 00:00	3,682.0	0.0	3,682.0	103,800.0	382.2	0.5	0.2	0.8
08/14/2022 01:00	3,857.6	0.0	3,857.6	103,800.0	400.4	0.5	0.2	0.8
08/14/2022 02:00	3,965.8	0.0	3,965.8	103,800.0	411.7	0.5	0.2	0.8
08/14/2022 03:00	3,953.8	0.0	3,953.8	103,800.0	410.4	0.5	0.2	0.8
08/14/2022 04:00	3,792.3	0.0	3,792.3	103,800.0	393.6	0.5	0.2	0.8
08/14/2022 05:00	3,521.7	0.0	3,521.7	103,800.0	365.6	0.4	0.2	0.7
08/14/2022 06:00	4,726.0	129.4	4,820.5	103,800.0	500.4	0.6	0.3	1.0
08/14/2022 07:00	4,725.3	126.4	4,822.6	103,800.0	500.6	0.6	0.3	1.0
08/14/2022 08:00	3,040.7	0.0	3,040.7	103,800.0	315.6	0.4	0.2	0.6
08/14/2022 09:00	2,952.9	0.0	2,952.9	103,800.0	306.5	0.4	0.2	0.6
08/14/2022 10:00	3,845.6	103.1	3,874.5	103,800.0	402.2	0.5	0.2	0.8
08/14/2022 11:00	4,657.0	487.8	5,144.8	103,800.0	534.0	0.6	0.3	1.1
08/14/2022 12:00	4,623.4	835.9	5,459.3	103,800.0	566.7	0.7	0.3	1.1
08/14/2022 13:00	4,606.6	509.3	5,115.9	103,800.0	531.0	0.6	0.3	1.1
08/14/2022 14:00	3,404.1	2.5	3,404.2	103,800.0	353.4	0.4	0.2	0.7
08/14/2022 15:00	3,542.8	0.0	3,542.8	103,800.0	367.7	0.4	0.2	0.7
08/14/2022 16:00	3,508.6	0.0	3,508.6	103,800.0	364.2	0.4	0.2	0.7
08/14/2022 17:00	4,468.4	95.5	4,490.4	103,800.0	466.1	0.6	0.3	0.9
08/14/2022 18:00	4,584.8	476.9	5,061.7	103,800.0	525.4	0.6	0.3	1.1
08/14/2022 19:00	4,605.1	459.8	5,064.9	103,800.0	525.7	0.6	0.3	1.1
08/14/2022 20:00	4,275.4	208.1	4,383.6	103,800.0	455.0	0.6	0.3	0.9
08/14/2022 21:00	3,028.7	0.0	3,028.7	103,800.0	314.4	0.4	0.2	0.6
08/14/2022 22:00	2,924.2	0.0	2,924.2	103,800.0	303.5	0.4	0.2	0.6
08/14/2022 23:00	2,962.4	0.0	2,962.4	103,800.0	307.5	0.4	0.2	0.6
Average/Sum#:	3,885.6	143.1	4,015.7	103,800.0	416.8	0.5	0.2	0.8
Minimum:	2,924.2	0.0	2,924.2	103,800.0	303.5	0.4	0.2	0.6
Maximum:	4,726.0	835.9	5,459.3	103,800.0	566.7	0.7	0.3	1.1
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:29 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/15/2022 00:00	2,945.9	0.0	2,945.9	103,800.0	305.8	0.4	0.2	0.6
08/15/2022 01:00	2,944.1	0.0	2,944.1	103,800.0	305.6	0.4	0.2	0.6
08/15/2022 02:00	2,945.2	0.0	2,945.2	103,800.0	305.7	0.4	0.2	0.6
08/15/2022 03:00	3,135.2	0.0	3,135.2	103,800.0	325.4	0.4	0.2	0.7
08/15/2022 04:00	3,528.9	0.0	3,528.9	103,800.0	366.3	0.4	0.2	0.7
08/15/2022 05:00	4,000.4	0.0	4,000.4	103,800.0	415.2	0.5	0.2	0.8
08/15/2022 06:00	3,202.3	0.0	3,202.3	103,800.0	332.4	0.4	0.2	0.7
08/15/2022 07:00	2,880.6	0.0	2,880.6	103,800.0	299.0	0.4	0.2	0.6
08/15/2022 08:00	2,831.0	0.0	2,831.0	103,800.0	293.9	0.4	0.2	0.6
08/15/2022 09:00	2,901.5	0.0	2,901.5	103,800.0	301.2	0.4	0.2	0.6
08/15/2022 10:00	3,137.2	0.0	3,137.2	103,800.0	325.6	0.4	0.2	0.7
08/15/2022 11:00	2,938.8	0.0	2,938.8	103,800.0	305.0	0.4	0.2	0.6
08/15/2022 12:00	3,185.2	0.0	3,185.2	103,800.0	330.6	0.4	0.2	0.7
08/15/2022 13:00	4,539.7	442.3	4,827.2	103,800.0	501.1	0.6	0.3	1.0
08/15/2022 14:00	4,587.1	1,362.2	5,949.3	103,800.0	617.5	0.7	0.4	1.2
08/15/2022 15:00	4,587.7	1,423.9	6,011.6	103,800.0	624.0	0.7	0.4	1.2
08/15/2022 16:00	4,577.5	1,510.0	6,087.5	103,800.0	631.9	0.8	0.4	1.3
08/15/2022 17:00	4,570.4	1,519.9	6,090.3	103,800.0	632.2	0.8	0.4	1.3
08/15/2022 18:00	4,571.8	1,476.1	6,047.9	103,800.0	627.8	0.8	0.4	1.3
08/15/2022 19:00	4,610.0	1,105.3	5,715.3	103,800.0	593.2	0.7	0.4	1.2
08/15/2022 20:00	4,599.0	477.8	4,966.9	103,800.0	515.6	0.6	0.3	1.1
08/15/2022 21:00	4,000.7	0.0	4,000.7	103,800.0	415.3	0.5	0.2	0.8
08/15/2022 22:00	3,386.1	0.0	3,386.1	103,800.0	351.5	0.4	0.2	0.7
08/15/2022 23:00	3,880.7	0.0	3,880.7	103,800.0	402.8	0.5	0.2	0.8
Average/Sum#:	3,687.0	388.2	4,064.2	103,800.0	421.9	0.5	0.3	0.9
Minimum:	2,831.0	0.0	2,831.0	103,800.0	293.9	0.4	0.2	0.6
Maximum:	4,610.0	1,519.9	6,090.3	103,800.0	632.2	0.8	0.4	1.3
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:29 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/16/2022 00:00	3,927.6	0.0	3,927.6	103,800.0	407.7	0.5	0.2	0.8
08/16/2022 01:00	3,684.3	0.0	3,684.3	103,800.0	382.4	0.5	0.2	0.8
08/16/2022 02:00	3,574.6	0.0	3,574.6	103,800.0	371.0	0.4	0.2	0.7
08/16/2022 03:00	3,473.6	0.0	3,473.6	103,800.0	360.6	0.4	0.2	0.7
08/16/2022 04:00	3,748.9	0.0	3,748.9	103,800.0	389.1	0.5	0.2	0.8
08/16/2022 05:00	4,294.3	0.0	4,294.3	103,800.0	445.7	0.5	0.3	0.9
08/16/2022 06:00	3,383.4	0.0	3,383.4	103,800.0	351.2	0.4	0.2	0.7
08/16/2022 07:00	2,870.7	0.0	2,870.7	103,800.0	298.0	0.4	0.2	0.6
08/16/2022 08:00	2,899.3	0.0	2,899.3	103,800.0	300.9	0.4	0.2	0.6
08/16/2022 09:00	3,228.2	0.0	3,228.2	103,800.0	335.1	0.4	0.2	0.7
08/16/2022 10:00	3,635.8	0.0	3,635.8	103,800.0	377.4	0.5	0.2	0.8
08/16/2022 11:00	3,941.0	0.0	3,941.0	103,800.0	409.1	0.5	0.2	0.8
08/16/2022 12:00	4,103.1	170.9	4,151.0	103,800.0	430.9	0.5	0.3	0.9
08/16/2022 13:00	4,537.4	1,651.6	6,189.0	103,800.0	642.4	0.8	0.4	1.3
08/16/2022 14:00	4,537.4	1,946.0	6,483.4	103,800.0	673.0	0.8	0.4	1.3
08/16/2022 15:00	4,528.1	1,980.7	6,508.8	103,800.0	675.6	0.8	0.4	1.4
08/16/2022 16:00	4,519.6	1,980.4	6,500.0	103,800.0	674.7	0.8	0.4	1.3
08/16/2022 17:00	4,523.6	1,978.6	6,502.2	103,800.0	674.9	0.8	0.4	1.3
08/16/2022 18:00	4,519.3	1,988.3	6,507.6	103,800.0	675.5	0.8	0.4	1.4
08/16/2022 19:00	4,543.8	1,712.9	6,256.7	103,800.0	649.4	0.8	0.4	1.3
08/16/2022 20:00	4,575.0	1,520.7	6,095.7	103,800.0	632.7	0.8	0.4	1.3
08/16/2022 21:00	4,607.8	1,030.4	5,638.2	103,800.0	585.2	0.7	0.4	1.2
08/16/2022 22:00	4,613.3	574.9	5,188.2	103,800.0	538.5	0.6	0.3	1.1
08/16/2022 23:00	4,501.4	80.6	4,519.1	103,800.0	469.1	0.6	0.3	1.0
Average/Sum#:	4,032.1	692.3	4,716.7	103,800.0	489.6	0.6	0.3	1.0
Minimum:	2,870.7	0.0	2,870.7	103,800.0	298.0	0.4	0.2	0.6
Maximum:	4,613.3	1,988.3	6,508.8	103,800.0	675.6	0.8	0.4	1.4
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:29 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2	Unit CT2	Unit CT2
						PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/17/2022 00:00	4,560.8	0.0	4,560.8	103,800.0	473.4	0.6	0.3	0.9
08/17/2022 01:00	4,376.4	0.0	4,376.4	103,800.0	454.3	0.5	0.3	0.9
08/17/2022 02:00	4,464.5	0.0	4,464.5	103,800.0	463.4	0.6	0.3	0.9
08/17/2022 03:00	4,392.5	0.0	4,392.5	103,800.0	455.9	0.5	0.3	0.9
08/17/2022 04:00	4,432.1	0.0	4,432.1	103,800.0	460.1	0.6	0.3	0.9
08/17/2022 05:00	4,638.5	0.0	4,638.5	103,800.0	481.5	0.6	0.3	1.0
08/17/2022 06:00	4,634.2	0.0	4,634.2	103,800.0	481.0	0.6	0.3	1.0
08/17/2022 07:00	3,844.2	0.0	3,844.2	103,800.0	399.0	0.5	0.2	0.8
08/17/2022 08:00	4,586.8	319.4	4,832.7	103,800.0	501.6	0.6	0.3	1.0
08/17/2022 09:00	4,647.7	139.2	4,721.5	103,800.0	490.1	0.6	0.3	1.0
08/17/2022 10:00	4,648.0	0.0	4,648.0	103,800.0	482.5	0.6	0.3	1.0
08/17/2022 11:00	4,651.7	0.0	4,651.7	103,800.0	482.8	0.6	0.3	1.0
08/17/2022 12:00	4,623.2	0.0	4,623.2	103,800.0	479.9	0.6	0.3	1.0
08/17/2022 13:00	4,595.6	0.0	4,595.6	103,800.0	477.0	0.6	0.3	1.0
08/17/2022 14:00	4,581.6	0.0	4,581.6	103,800.0	475.6	0.6	0.3	1.0
08/17/2022 15:00	4,573.7	0.0	4,573.7	103,800.0	474.8	0.6	0.3	0.9
08/17/2022 16:00	4,583.2	0.0	4,583.2	103,800.0	475.7	0.6	0.3	1.0
08/17/2022 17:00	4,600.8	0.0	4,600.8	103,800.0	477.6	0.6	0.3	1.0
08/17/2022 18:00	4,602.5	0.0	4,602.5	103,800.0	477.7	0.6	0.3	1.0
08/17/2022 19:00	4,602.1	0.0	4,602.1	103,800.0	477.7	0.6	0.3	1.0
08/17/2022 20:00	4,604.0	0.0	4,604.0	103,800.0	477.9	0.6	0.3	1.0
08/17/2022 21:00	4,600.5	0.0	4,600.5	103,800.0	477.5	0.6	0.3	1.0
08/17/2022 22:00	4,596.8	0.0	4,596.8	103,800.0	477.1	0.6	0.3	1.0
08/17/2022 23:00	3,135.9	0.0	3,135.9	103,800.0	325.5	0.4	0.2	0.7
Average/Sum#:	4,482.4	19.1	4,495.7	103,800.0	466.7	0.6	0.3	1.0
Minimum:	3,135.9	0.0	3,135.9	103,800.0	325.5	0.4	0.2	0.7
Maximum:	4,651.7	319.4	4,832.7	103,800.0	501.6	0.6	0.3	1.0
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:29 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2	Unit CT2	Unit CT2
	PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr					
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/18/2022 00:00	3,072.0	0.0	3,072.0	103,800.0	318.9	0.4	0.2	0.6
08/18/2022 01:00	3,068.4	0.0	3,068.4	103,800.0	318.5	0.4	0.2	0.6
08/18/2022 02:00	3,067.5	0.0	3,067.5	103,800.0	318.4	0.4	0.2	0.6
08/18/2022 03:00	3,067.8	0.0	3,067.8	103,800.0	318.4	0.4	0.2	0.6
08/18/2022 04:00	3,078.4	0.0	3,078.4	103,800.0	319.5	0.4	0.2	0.6
08/18/2022 05:00	3,084.2	0.0	3,084.2	103,800.0	320.1	0.4	0.2	0.6
08/18/2022 06:00	3,074.3	0.0	3,074.3	103,800.0	319.1	0.4	0.2	0.6
08/18/2022 07:00	2,956.9	0.0	2,956.9	103,800.0	306.9	0.4	0.2	0.6
08/18/2022 08:00	2,931.8	0.0	2,931.8	103,800.0	304.3	0.4	0.2	0.6
08/18/2022 09:00	2,936.4	0.0	2,936.4	103,800.0	304.8	0.4	0.2	0.6
08/18/2022 10:00	2,933.7	0.0	2,933.7	103,800.0	304.5	0.4	0.2	0.6
08/18/2022 11:00	2,932.6	0.0	2,932.6	103,800.0	304.4	0.4	0.2	0.6
08/18/2022 12:00	2,975.7	0.0	2,975.7	103,800.0	308.9	0.4	0.2	0.6
08/18/2022 13:00	3,909.1	92.3	3,932.2	103,800.0	408.2	0.5	0.2	0.8
08/18/2022 14:00	4,508.1	500.7	5,008.8	103,800.0	519.9	0.6	0.3	1.0
08/18/2022 15:00	4,505.1	1,010.1	5,515.2	103,800.0	572.5	0.7	0.3	1.1
08/18/2022 16:00	4,506.2	875.4	5,381.6	103,800.0	558.6	0.7	0.3	1.1
08/18/2022 17:00	4,534.0	1,148.6	5,682.6	103,800.0	589.9	0.7	0.4	1.2
08/18/2022 18:00	4,579.0	434.5	5,013.5	103,800.0	520.4	0.6	0.3	1.0
08/18/2022 19:00	4,607.5	328.8	4,936.3	103,800.0	512.4	0.6	0.3	1.0
08/18/2022 20:00	4,651.6	259.3	4,910.9	103,800.0	509.8	0.6	0.3	1.0
08/18/2022 21:00	4,676.9	227.0	4,903.9	103,800.0	509.0	0.6	0.3	1.0
08/18/2022 22:00	4,698.3	186.4	4,884.7	103,800.0	507.0	0.6	0.3	1.0
08/18/2022 23:00	4,719.9	134.0	4,853.9	103,800.0	503.8	0.6	0.3	1.0
Average/Sum#:	3,711.5	216.5	3,925.1	103,800.0	407.4	0.5	0.2	0.8
Minimum:	2,931.8	0.0	2,931.8	103,800.0	304.3	0.4	0.2	0.6
Maximum:	4,719.9	1,148.6	5,682.6	103,800.0	589.9	0.7	0.4	1.2
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:29 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2	Unit CT2	Unit CT2
						PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/19/2022 00:00	4,738.0	53.5	4,791.5	103,800.0	497.4	0.6	0.3	1.0
08/19/2022 01:00	4,749.1	72.2	4,821.3	103,800.0	500.5	0.6	0.3	1.0
08/19/2022 02:00	4,761.6	42.3	4,803.9	103,800.0	498.6	0.6	0.3	1.0
08/19/2022 03:00	4,767.5	21.2	4,788.7	103,800.0	497.1	0.6	0.3	1.0
08/19/2022 04:00	4,774.3	11.5	4,785.8	103,800.0	496.8	0.6	0.3	1.0
08/19/2022 05:00	4,777.4	10.9	4,788.3	103,800.0	497.0	0.6	0.3	1.0
08/19/2022 06:00	4,771.4	130.5	4,901.9	103,800.0	508.8	0.6	0.3	1.0
08/19/2022 07:00	4,744.2	125.8	4,870.0	103,800.0	505.5	0.6	0.3	1.0
08/19/2022 08:00	3,629.2	2.8	3,629.3	103,800.0	376.7	0.5	0.2	0.8
08/19/2022 09:00	2,938.3	0.0	2,938.3	103,800.0	305.0	0.4	0.2	0.6
08/19/2022 10:00	3,170.6	0.0	3,170.6	103,800.0	329.1	0.4	0.2	0.7
08/19/2022 11:00	3,688.6	0.0	3,688.6	103,800.0	382.9	0.5	0.2	0.8
08/19/2022 12:00	3,026.4	0.0	3,026.4	103,800.0	314.1	0.4	0.2	0.6
08/19/2022 13:00	2,803.3	0.0	2,803.3	103,800.0	291.0	0.4	0.2	0.6
08/19/2022 14:00	2,976.8	0.0	2,976.8	103,800.0	309.0	0.4	0.2	0.6
08/19/2022 15:00	3,034.3	0.0	3,034.3	103,800.0	315.0	0.4	0.2	0.6
08/19/2022 16:00	2,974.5	0.0	2,974.5	103,800.0	308.8	0.4	0.2	0.6
08/19/2022 17:00	4,158.9	0.0	4,158.9	103,800.0	431.7	0.5	0.3	0.9
08/19/2022 18:00	4,200.4	0.0	4,200.4	103,800.0	436.0	0.5	0.3	0.9
08/19/2022 19:00	3,883.6	0.0	3,883.6	103,800.0	403.1	0.5	0.2	0.8
08/19/2022 20:00	3,559.1	0.0	3,559.1	103,800.0	369.4	0.4	0.2	0.7
08/19/2022 21:00	1,595.1	0.0	1,595.1	103,800.0	165.6	0.0	0.0	0.0
08/19/2022 22:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
08/19/2022 23:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
Average/Sum#:	3,805.6	21.4	3,826.8	103,800.0	397.2	0.5	0.2	0.8
Minimum:	1,595.1	0.0	1,595.1	103,800.0	165.6	0.4	0.2	0.6
Maximum:	4,777.4	130.5	4,901.9	103,800.0	508.8	0.6	0.3	1.0
%SI	8.33	8.33	8.33	0.00	8.33	12.50	12.50	12.50

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:29 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	> 4.73 Unit CT2 PM10_Norm, LbPerHr	> 1 Unit CT2 SO2_Norm, LbPerHr	> 1.8 Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/20/2022 00:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
08/20/2022 01:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
08/20/2022 02:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
08/20/2022 03:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
08/20/2022 04:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
08/20/2022 05:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
08/20/2022 06:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
08/20/2022 07:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
08/20/2022 08:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
08/20/2022 09:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
08/20/2022 10:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
08/20/2022 11:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
08/20/2022 12:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
08/20/2022 13:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
08/20/2022 14:00	0.0	0.0	0.0	103,800.0	0.0	0.0	0.0	0.0
08/20/2022 15:00	3,364.1	0.0	3,364.1	103,800.0	349.2	0.6	0.3	0.9
08/20/2022 16:00	4,488.5	0.0	4,488.5	103,800.0	465.9	0.6	0.3	0.9
08/20/2022 17:00	4,504.2	151.9	4,546.7	103,800.0	471.9	0.6	0.3	1.0
08/20/2022 18:00	4,527.2	586.2	5,113.4	103,800.0	530.8	0.6	0.3	1.1
08/20/2022 19:00	4,596.4	429.9	5,026.3	103,800.0	521.7	0.6	0.3	1.0
08/20/2022 20:00	4,613.1	393.5	5,006.6	103,800.0	519.7	0.6	0.3	1.0
08/20/2022 21:00	4,620.7	440.1	5,060.8	103,800.0	525.3	0.6	0.3	1.1
08/20/2022 22:00	4,641.7	435.1	5,076.8	103,800.0	527.0	0.6	0.3	1.1
08/20/2022 23:00	4,663.3	410.0	5,073.3	103,800.0	526.6	0.6	0.3	1.1
Average/Sum#:	4,446.6	316.3	4,750.7	103,800.0	493.1	0.6	0.3	1.0
Minimum:	3,364.1	0.0	3,364.1	103,800.0	349.2	0.6	0.3	0.9
Maximum:	4,663.3	586.2	5,113.4	103,800.0	530.8	0.6	0.3	1.1
%SI	62.50	62.50	62.50	0.00	62.50	62.50	62.50	62.50

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:29 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2	Unit CT2	Unit CT2
						PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/21/2022 00:00	4,682.0	374.4	5,056.4	103,800.0	524.9	0.6	0.3	1.1
08/21/2022 01:00	4,704.8	335.0	5,039.8	103,800.0	523.1	0.6	0.3	1.0
08/21/2022 02:00	4,721.5	296.6	5,018.1	103,800.0	520.9	0.6	0.3	1.0
08/21/2022 03:00	3,735.2	38.4	3,741.0	103,800.0	388.3	0.5	0.2	0.8
08/21/2022 04:00	2,945.7	0.0	2,945.7	103,800.0	305.8	0.4	0.2	0.6
08/21/2022 05:00	3,438.6	0.7	3,438.6	103,800.0	356.9	0.4	0.2	0.7
08/21/2022 06:00	3,211.4	0.0	3,211.4	103,800.0	333.3	0.4	0.2	0.7
08/21/2022 07:00	3,186.9	0.0	3,186.9	103,800.0	330.8	0.4	0.2	0.7
08/21/2022 08:00	3,804.0	0.0	3,804.0	103,800.0	394.9	0.5	0.2	0.8
08/21/2022 09:00	2,876.8	0.0	2,876.8	103,800.0	298.6	0.4	0.2	0.6
08/21/2022 10:00	3,181.5	0.0	3,181.5	103,800.0	330.2	0.4	0.2	0.7
08/21/2022 11:00	3,840.7	0.0	3,840.7	103,800.0	398.7	0.5	0.2	0.8
08/21/2022 12:00	4,581.7	0.0	4,581.7	103,800.0	475.6	0.6	0.3	1.0
08/21/2022 13:00	4,581.0	0.0	4,581.0	103,800.0	475.5	0.6	0.3	1.0
08/21/2022 14:00	4,162.4	0.0	4,162.4	103,800.0	432.1	0.5	0.3	0.9
08/21/2022 15:00	3,714.1	0.0	3,714.1	103,800.0	385.5	0.5	0.2	0.8
08/21/2022 16:00	3,380.0	2.1	3,380.3	103,800.0	350.9	0.4	0.2	0.7
08/21/2022 17:00	4,577.6	801.8	5,379.4	103,800.0	558.4	0.7	0.3	1.1
08/21/2022 18:00	4,626.8	784.8	5,411.6	103,800.0	561.7	0.7	0.3	1.1
08/21/2022 19:00	4,588.2	411.3	4,917.2	103,800.0	510.4	0.6	0.3	1.0
08/21/2022 20:00	4,032.3	0.0	4,032.3	103,800.0	418.6	0.5	0.3	0.8
08/21/2022 21:00	3,923.5	0.0	3,923.5	103,800.0	407.3	0.5	0.2	0.8
08/21/2022 22:00	3,745.1	0.0	3,745.1	103,800.0	388.7	0.5	0.2	0.8
08/21/2022 23:00	3,833.6	0.0	3,833.6	103,800.0	397.9	0.5	0.2	0.8
Average/Sum#:	3,919.8	126.9	4,041.8	103,800.0	419.5	0.5	0.2	0.8
Minimum:	2,876.8	0.0	2,876.8	103,800.0	298.6	0.4	0.2	0.6
Maximum:	4,721.5	801.8	5,411.6	103,800.0	561.7	0.7	0.3	1.1
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:29 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2	Unit CT2	Unit CT2
						PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/22/2022 00:00	3,237.8	0.0	3,237.8	103,800.0	336.1	0.4	0.2	0.7
08/22/2022 01:00	2,985.2	0.0	2,985.2	103,800.0	309.9	0.4	0.2	0.6
08/22/2022 02:00	2,856.1	0.0	2,856.1	103,800.0	296.5	0.4	0.2	0.6
08/22/2022 03:00	3,000.5	0.0	3,000.5	103,800.0	311.5	0.4	0.2	0.6
08/22/2022 04:00	3,430.1	0.0	3,430.1	103,800.0	356.0	0.4	0.2	0.7
08/22/2022 05:00	4,683.7	0.0	4,683.7	103,800.0	486.2	0.6	0.3	1.0
08/22/2022 06:00	4,752.0	0.0	4,752.0	103,800.0	493.3	0.6	0.3	1.0
08/22/2022 07:00	4,780.1	0.0	4,780.1	103,800.0	496.2	0.6	0.3	1.0
08/22/2022 08:00	4,757.8	0.0	4,757.8	103,800.0	493.9	0.6	0.3	1.0
08/22/2022 09:00	3,029.9	0.0	3,029.9	103,800.0	314.5	0.4	0.2	0.6
08/22/2022 10:00	2,917.7	0.0	2,917.7	103,800.0	302.9	0.4	0.2	0.6
08/22/2022 11:00	2,914.1	0.0	2,914.1	103,800.0	302.5	0.4	0.2	0.6
08/22/2022 12:00	2,913.5	0.0	2,913.5	103,800.0	302.4	0.4	0.2	0.6
08/22/2022 13:00	2,911.6	0.0	2,911.6	103,800.0	302.2	0.4	0.2	0.6
08/22/2022 14:00	2,910.7	0.0	2,910.7	103,800.0	302.1	0.4	0.2	0.6
08/22/2022 15:00	3,908.8	134.0	3,949.0	103,800.0	409.9	0.5	0.3	0.8
08/22/2022 16:00	4,556.4	582.0	5,138.4	103,800.0	533.4	0.6	0.3	1.1
08/22/2022 17:00	4,557.3	1,218.8	5,776.1	103,800.0	599.6	0.7	0.4	1.2
08/22/2022 18:00	4,566.4	1,765.6	6,332.0	103,800.0	657.3	0.8	0.4	1.3
08/22/2022 19:00	4,580.4	929.4	5,509.8	103,800.0	571.9	0.7	0.3	1.1
08/22/2022 20:00	4,597.4	429.9	5,027.3	103,800.0	521.8	0.6	0.3	1.0
08/22/2022 21:00	4,614.1	319.0	4,933.1	103,800.0	512.1	0.6	0.3	1.0
08/22/2022 22:00	4,637.4	303.3	4,940.7	103,800.0	512.8	0.6	0.3	1.0
08/22/2022 23:00	4,652.7	239.7	4,892.4	103,800.0	507.8	0.6	0.3	1.0
Average/Sum#:	3,864.7	246.7	4,107.5	103,800.0	426.4	0.5	0.3	0.8
Minimum:	2,856.1	0.0	2,856.1	103,800.0	296.5	0.4	0.2	0.6
Maximum:	4,780.1	1,765.6	6,332.0	103,800.0	657.3	0.8	0.4	1.3
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:29 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2	Unit CT2	Unit CT2
						PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/23/2022 00:00	4,665.4	310.6	4,976.0	103,800.0	516.5	0.6	0.3	1.0
08/23/2022 01:00	4,675.3	238.8	4,914.1	103,800.0	510.1	0.6	0.3	1.0
08/23/2022 02:00	4,688.2	191.8	4,880.0	103,800.0	506.5	0.6	0.3	1.0
08/23/2022 03:00	4,695.8	359.2	5,055.0	103,800.0	524.7	0.6	0.3	1.0
08/23/2022 04:00	4,704.5	239.7	4,944.2	103,800.0	513.2	0.6	0.3	1.0
08/23/2022 05:00	4,709.8	802.5	5,512.3	103,800.0	572.2	0.7	0.3	1.1
08/23/2022 06:00	4,704.8	198.2	4,903.0	103,800.0	508.9	0.6	0.3	1.0
08/23/2022 07:00	4,674.2	222.0	4,896.2	103,800.0	508.2	0.6	0.3	1.0
08/23/2022 08:00	4,660.6	270.5	4,931.1	103,800.0	511.8	0.6	0.3	1.0
08/23/2022 09:00	4,644.5	285.0	4,929.5	103,800.0	511.7	0.6	0.3	1.0
08/23/2022 10:00	4,611.5	317.9	4,929.4	103,800.0	511.7	0.6	0.3	1.0
08/23/2022 11:00	4,583.3	530.7	5,114.0	103,800.0	530.8	0.6	0.3	1.1
08/23/2022 12:00	4,548.5	645.5	5,194.0	103,800.0	539.1	0.6	0.3	1.1
08/23/2022 13:00	4,528.1	545.5	5,073.6	103,800.0	526.6	0.6	0.3	1.1
08/23/2022 14:00	4,518.0	866.6	5,384.6	103,800.0	558.9	0.7	0.3	1.1
08/23/2022 15:00	4,512.1	543.3	5,055.4	103,800.0	524.8	0.6	0.3	1.1
08/23/2022 16:00	4,507.3	880.1	5,387.4	103,800.0	559.2	0.7	0.3	1.1
08/23/2022 17:00	4,508.5	1,937.0	6,445.5	103,800.0	669.0	0.8	0.4	1.3
08/23/2022 18:00	4,529.9	1,250.1	5,780.0	103,800.0	600.0	0.7	0.4	1.2
08/23/2022 19:00	4,548.9	956.2	5,505.1	103,800.0	571.4	0.7	0.3	1.1
08/23/2022 20:00	4,576.1	1,285.5	5,861.6	103,800.0	608.4	0.7	0.4	1.2
08/23/2022 21:00	4,577.3	672.0	5,249.3	103,800.0	544.9	0.7	0.3	1.1
08/23/2022 22:00	4,587.4	326.1	4,913.5	103,800.0	510.0	0.6	0.3	1.0
08/23/2022 23:00	4,600.8	305.6	4,906.4	103,800.0	509.3	0.6	0.3	1.0
Average/Sum#:	4,606.7	590.9	5,197.6	103,800.0	539.5	0.6	0.3	1.1
Minimum:	4,507.3	191.8	4,880.0	103,800.0	506.5	0.6	0.3	1.0
Maximum:	4,709.8	1,937.0	6,445.5	103,800.0	669.0	0.8	0.4	1.3
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:29 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2	Unit CT2	Unit CT2
						PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/24/2022 00:00	4,617.1	331.8	4,948.9	103,800.0	513.7	0.6	0.3	1.0
08/24/2022 01:00	4,637.8	292.9	4,930.7	103,800.0	511.8	0.6	0.3	1.0
08/24/2022 02:00	4,657.7	259.7	4,917.4	103,800.0	510.4	0.6	0.3	1.0
08/24/2022 03:00	4,670.5	221.5	4,892.0	103,800.0	507.8	0.6	0.3	1.0
08/24/2022 04:00	4,687.0	191.6	4,878.6	103,800.0	506.4	0.6	0.3	1.0
08/24/2022 05:00	4,701.4	158.3	4,859.7	103,800.0	504.4	0.6	0.3	1.0
08/24/2022 06:00	4,695.3	170.4	4,865.7	103,800.0	505.1	0.6	0.3	1.0
08/24/2022 07:00	4,678.6	219.4	4,898.0	103,800.0	508.4	0.6	0.3	1.0
08/24/2022 08:00	4,646.7	273.3	4,920.0	103,800.0	510.7	0.6	0.3	1.0
08/24/2022 09:00	4,615.6	283.8	4,899.4	103,800.0	508.6	0.6	0.3	1.0
08/24/2022 10:00	4,589.7	333.5	4,923.2	103,800.0	511.0	0.6	0.3	1.0
08/24/2022 11:00	4,563.7	389.7	4,953.4	103,800.0	514.2	0.6	0.3	1.0
08/24/2022 12:00	4,554.3	486.0	5,040.3	103,800.0	523.2	0.6	0.3	1.0
08/24/2022 13:00	4,546.2	495.8	5,042.0	103,800.0	523.4	0.6	0.3	1.0
08/24/2022 14:00	4,535.6	1,668.4	6,204.0	103,800.0	644.0	0.8	0.4	1.3
08/24/2022 15:00	4,538.8	734.4	5,273.2	103,800.0	547.4	0.7	0.3	1.1
08/24/2022 16:00	4,530.2	1,016.6	5,546.8	103,800.0	575.8	0.7	0.3	1.2
08/24/2022 17:00	4,543.0	1,582.2	6,125.2	103,800.0	635.8	0.8	0.4	1.3
08/24/2022 18:00	4,587.2	560.7	5,147.9	103,800.0	534.4	0.6	0.3	1.1
08/24/2022 19:00	4,602.8	332.0	4,934.8	103,800.0	512.2	0.6	0.3	1.0
08/24/2022 20:00	4,621.2	335.4	4,956.6	103,800.0	514.5	0.6	0.3	1.0
08/24/2022 21:00	4,644.5	259.9	4,904.4	103,800.0	509.1	0.6	0.3	1.0
08/24/2022 22:00	4,666.8	199.2	4,866.0	103,800.0	505.1	0.6	0.3	1.0
08/24/2022 23:00	4,692.2	209.0	4,901.2	103,800.0	508.7	0.6	0.3	1.0
Average/Sum#:	4,617.7	458.6	5,076.2	103,800.0	526.9	0.6	0.3	1.0
Minimum:	4,530.2	158.3	4,859.7	103,800.0	504.4	0.6	0.3	1.0
Maximum:	4,701.4	1,668.4	6,204.0	103,800.0	644.0	0.8	0.4	1.3
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:29 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2	Unit CT2	Unit CT2
						PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/25/2022 00:00	4,713.1	164.0	4,877.1	103,800.0	506.2	0.6	0.3	1.0
08/25/2022 01:00	4,724.8	159.5	4,884.3	103,800.0	507.0	0.6	0.3	1.0
08/25/2022 02:00	4,727.6	153.5	4,881.1	103,800.0	506.7	0.6	0.3	1.0
08/25/2022 03:00	4,745.6	129.7	4,875.3	103,800.0	506.1	0.6	0.3	1.0
08/25/2022 04:00	4,759.5	57.7	4,817.2	103,800.0	500.0	0.6	0.3	1.0
08/25/2022 05:00	4,767.5	8.8	4,776.3	103,800.0	495.8	0.6	0.3	1.0
08/25/2022 06:00	4,773.0	8.1	4,781.1	103,800.0	496.3	0.6	0.3	1.0
08/25/2022 07:00	4,753.9	84.8	4,838.7	103,800.0	502.3	0.6	0.3	1.0
08/25/2022 08:00	4,722.4	183.5	4,905.9	103,800.0	509.2	0.6	0.3	1.0
08/25/2022 09:00	4,688.1	242.8	4,930.9	103,800.0	511.8	0.6	0.3	1.0
08/25/2022 10:00	4,656.9	316.1	4,973.0	103,800.0	516.2	0.6	0.3	1.0
08/25/2022 11:00	4,626.4	380.1	5,006.5	103,800.0	519.7	0.6	0.3	1.0
08/25/2022 12:00	4,605.1	398.9	5,004.0	103,800.0	519.4	0.6	0.3	1.0
08/25/2022 13:00	4,593.1	333.5	4,926.6	103,800.0	511.4	0.6	0.3	1.0
08/25/2022 14:00	4,585.7	332.5	4,918.2	103,800.0	510.5	0.6	0.3	1.0
08/25/2022 15:00	4,581.9	409.7	4,991.6	103,800.0	518.1	0.6	0.3	1.0
08/25/2022 16:00	4,578.2	346.6	4,924.8	103,800.0	511.2	0.6	0.3	1.0
08/25/2022 17:00	4,585.4	340.0	4,925.4	103,800.0	511.3	0.6	0.3	1.0
08/25/2022 18:00	4,607.2	308.8	4,916.0	103,800.0	510.3	0.6	0.3	1.0
08/25/2022 19:00	4,632.5	294.5	4,927.0	103,800.0	511.4	0.6	0.3	1.0
08/25/2022 20:00	4,655.0	272.4	4,927.4	103,800.0	511.5	0.6	0.3	1.0
08/25/2022 21:00	4,681.3	223.6	4,904.9	103,800.0	509.1	0.6	0.3	1.0
08/25/2022 22:00	4,697.1	181.7	4,878.8	103,800.0	506.4	0.6	0.3	1.0
08/25/2022 23:00	4,710.3	149.2	4,859.5	103,800.0	504.4	0.6	0.3	1.0
Average/Sum#:	4,673.8	228.3	4,902.2	103,800.0	508.8	0.6	0.3	1.0
Minimum:	4,578.2	8.1	4,776.3	103,800.0	495.8	0.6	0.3	1.0
Maximum:	4,773.0	409.7	5,006.5	103,800.0	519.7	0.6	0.3	1.0
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:29 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/26/2022 00:00	4,727.6	95.5	4,823.1	103,800.0	500.6	0.6	0.3	1.0
08/26/2022 01:00	4,744.0	20.4	4,764.4	103,800.0	494.5	0.6	0.3	1.0
08/26/2022 02:00	4,763.3	6.8	4,770.1	103,800.0	495.1	0.6	0.3	1.0
08/26/2022 03:00	4,769.5	5.7	4,775.2	103,800.0	495.7	0.6	0.3	1.0
08/26/2022 04:00	4,774.3	9.0	4,783.3	103,800.0	496.5	0.6	0.3	1.0
08/26/2022 05:00	4,707.7	109.2	4,803.8	103,800.0	498.6	0.6	0.3	1.0
08/26/2022 06:00	2,914.9	0.0	2,914.9	103,800.0	302.6	0.4	0.2	0.6
08/26/2022 07:00	2,874.7	0.0	2,874.7	103,800.0	298.4	0.4	0.2	0.6
08/26/2022 08:00	2,896.6	0.0	2,896.6	103,800.0	300.7	0.4	0.2	0.6
08/26/2022 09:00	4,072.7	0.0	4,072.7	103,800.0	422.7	0.5	0.3	0.8
08/26/2022 10:00	3,758.6	0.0	3,758.6	103,800.0	390.1	0.5	0.2	0.8
08/26/2022 11:00	4,055.9	147.5	4,097.2	103,800.0	425.3	0.5	0.3	0.9
08/26/2022 12:00	4,602.4	682.9	5,285.3	103,800.0	548.6	0.7	0.3	1.1
08/26/2022 13:00	4,600.7	1,409.1	6,009.8	103,800.0	623.8	0.7	0.4	1.2
08/26/2022 14:00	4,579.6	1,592.5	6,172.1	103,800.0	640.7	0.8	0.4	1.3
08/26/2022 15:00	4,573.1	1,434.7	6,007.8	103,800.0	623.6	0.7	0.4	1.2
08/26/2022 16:00	4,571.9	1,561.3	6,133.2	103,800.0	636.6	0.8	0.4	1.3
08/26/2022 17:00	4,590.0	1,911.4	6,501.4	103,800.0	674.8	0.8	0.4	1.3
08/26/2022 18:00	4,587.7	1,623.5	6,211.2	103,800.0	644.7	0.8	0.4	1.3
08/26/2022 19:00	4,595.7	1,724.4	6,320.1	103,800.0	656.0	0.8	0.4	1.3
08/26/2022 20:00	4,610.5	1,354.7	5,965.2	103,800.0	619.2	0.7	0.4	1.2
08/26/2022 21:00	4,586.8	1,181.3	5,768.1	103,800.0	598.7	0.7	0.4	1.2
08/26/2022 22:00	4,560.4	443.1	4,901.6	103,800.0	508.8	0.6	0.3	1.0
08/26/2022 23:00	4,461.3	0.0	4,461.3	103,800.0	463.1	0.6	0.3	0.9
Average/Sum#:	4,332.5	638.0	4,961.3	103,800.0	515.0	0.6	0.3	1.0
Minimum:	2,874.7	0.0	2,874.7	103,800.0	298.4	0.4	0.2	0.6
Maximum:	4,774.3	1,911.4	6,501.4	103,800.0	674.8	0.8	0.4	1.3
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:29 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2	Unit CT2	Unit CT2
						PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/27/2022 00:00	4,468.1	0.0	4,468.1	103,800.0	463.8	0.6	0.3	0.9
08/27/2022 01:00	4,449.2	0.0	4,449.2	103,800.0	461.8	0.6	0.3	0.9
08/27/2022 02:00	4,464.5	0.0	4,464.5	103,800.0	463.4	0.6	0.3	0.9
08/27/2022 03:00	4,463.9	0.0	4,463.9	103,800.0	463.4	0.6	0.3	0.9
08/27/2022 04:00	4,502.7	0.0	4,502.7	103,800.0	467.4	0.6	0.3	0.9
08/27/2022 05:00	4,503.3	0.0	4,503.3	103,800.0	467.4	0.6	0.3	0.9
08/27/2022 06:00	3,255.5	0.0	3,255.5	103,800.0	337.9	0.4	0.2	0.7
08/27/2022 07:00	2,804.1	0.0	2,804.1	103,800.0	291.1	0.4	0.2	0.6
08/27/2022 08:00	2,807.0	0.0	2,807.0	103,800.0	291.4	0.4	0.2	0.6
08/27/2022 09:00	2,825.0	0.0	2,825.0	103,800.0	293.2	0.4	0.2	0.6
08/27/2022 10:00	3,419.4	0.0	3,419.4	103,800.0	354.9	0.4	0.2	0.7
08/27/2022 11:00	4,190.3	97.7	4,212.8	103,800.0	437.3	0.5	0.3	0.9
08/27/2022 12:00	4,558.3	493.3	5,051.6	103,800.0	524.4	0.6	0.3	1.0
08/27/2022 13:00	4,540.2	541.0	5,081.2	103,800.0	527.4	0.6	0.3	1.1
08/27/2022 14:00	4,532.1	523.1	5,055.2	103,800.0	524.7	0.6	0.3	1.0
08/27/2022 15:00	4,527.3	518.9	5,046.2	103,800.0	523.8	0.6	0.3	1.0
08/27/2022 16:00	4,525.7	832.7	5,358.4	103,800.0	556.2	0.7	0.3	1.1
08/27/2022 17:00	4,525.7	1,354.1	5,879.8	103,800.0	610.3	0.7	0.4	1.2
08/27/2022 18:00	4,550.3	1,572.8	6,123.1	103,800.0	635.6	0.8	0.4	1.3
08/27/2022 19:00	4,588.6	1,437.4	6,026.0	103,800.0	625.5	0.7	0.4	1.3
08/27/2022 20:00	4,620.7	1,229.8	5,850.5	103,800.0	607.3	0.7	0.4	1.2
08/27/2022 21:00	4,601.5	445.6	4,944.6	103,800.0	513.2	0.6	0.3	1.0
08/27/2022 22:00	3,308.3	0.0	3,308.3	103,800.0	343.4	0.4	0.2	0.7
08/27/2022 23:00	3,614.8	0.0	3,614.8	103,800.0	375.2	0.5	0.2	0.8
Average/Sum#:	4,110.3	376.9	4,479.8	103,800.0	465.0	0.6	0.3	0.9
Minimum:	2,804.1	0.0	2,804.1	103,800.0	291.1	0.4	0.2	0.6
Maximum:	4,620.7	1,572.8	6,123.1	103,800.0	635.6	0.8	0.4	1.3
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:29 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2	Unit CT2	Unit CT2
						PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/28/2022 00:00	2,951.7	0.0	2,951.7	103,800.0	306.4	0.4	0.2	0.6
08/28/2022 01:00	2,952.5	0.0	2,952.5	103,800.0	306.5	0.4	0.2	0.6
08/28/2022 02:00	2,933.6	0.0	2,933.6	103,800.0	304.5	0.4	0.2	0.6
08/28/2022 03:00	2,963.7	0.0	2,963.7	103,800.0	307.6	0.4	0.2	0.6
08/28/2022 04:00	2,942.4	0.0	2,942.4	103,800.0	305.4	0.4	0.2	0.6
08/28/2022 05:00	2,993.4	0.0	2,993.4	103,800.0	310.7	0.4	0.2	0.6
08/28/2022 06:00	2,867.4	0.0	2,867.4	103,800.0	297.6	0.4	0.2	0.6
08/28/2022 07:00	2,821.9	0.0	2,821.9	103,800.0	292.9	0.4	0.2	0.6
08/28/2022 08:00	2,822.0	0.0	2,822.0	103,800.0	292.9	0.4	0.2	0.6
08/28/2022 09:00	2,822.8	0.0	2,822.8	103,800.0	293.0	0.4	0.2	0.6
08/28/2022 10:00	2,822.0	0.0	2,822.0	103,800.0	292.9	0.4	0.2	0.6
08/28/2022 11:00	2,831.3	0.0	2,831.3	103,800.0	293.9	0.4	0.2	0.6
08/28/2022 12:00	3,608.8	0.0	3,608.8	103,800.0	374.6	0.4	0.2	0.7
08/28/2022 13:00	3,729.2	0.0	3,729.2	103,800.0	387.1	0.5	0.2	0.8
08/28/2022 14:00	4,192.6	0.0	4,192.6	103,800.0	435.2	0.5	0.3	0.9
08/28/2022 15:00	3,276.7	0.0	3,276.7	103,800.0	340.1	0.4	0.2	0.7
08/28/2022 16:00	4,345.8	350.4	4,496.5	103,800.0	466.7	0.6	0.3	1.0
08/28/2022 17:00	4,540.0	1,767.6	6,307.6	103,800.0	654.7	0.8	0.4	1.3
08/28/2022 18:00	4,621.7	668.4	5,290.1	103,800.0	549.1	0.7	0.3	1.1
08/28/2022 19:00	4,662.1	324.8	4,986.9	103,800.0	517.6	0.6	0.3	1.0
08/28/2022 20:00	4,299.7	158.9	4,382.3	103,800.0	454.9	0.6	0.3	0.9
08/28/2022 21:00	3,679.6	0.0	3,679.6	103,800.0	381.9	0.5	0.2	0.8
08/28/2022 22:00	3,003.2	0.0	3,003.2	103,800.0	311.7	0.4	0.2	0.6
08/28/2022 23:00	3,990.1	0.0	3,990.1	103,800.0	414.2	0.5	0.2	0.8
Average/Sum#:	3,444.8	136.3	3,569.5	103,800.0	370.5	0.5	0.2	0.7
Minimum:	2,821.9	0.0	2,821.9	103,800.0	292.9	0.4	0.2	0.6
Maximum:	4,662.1	1,767.6	6,307.6	103,800.0	654.7	0.8	0.4	1.3
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:29 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2	Unit CT2	Unit CT2
						PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/29/2022 00:00	3,927.9	0.0	3,927.9	103,800.0	407.7	0.5	0.2	0.8
08/29/2022 01:00	3,982.2	0.0	3,982.2	103,800.0	413.4	0.5	0.2	0.8
08/29/2022 02:00	4,162.9	0.0	4,162.9	103,800.0	432.1	0.5	0.3	0.9
08/29/2022 03:00	3,950.8	0.0	3,950.8	103,800.0	410.1	0.5	0.2	0.8
08/29/2022 04:00	4,191.0	0.0	4,191.0	103,800.0	435.0	0.5	0.3	0.9
08/29/2022 05:00	4,478.9	0.0	4,478.9	103,800.0	464.9	0.6	0.3	0.9
08/29/2022 06:00	3,367.8	0.0	3,367.8	103,800.0	349.6	0.4	0.2	0.7
08/29/2022 07:00	2,884.5	0.0	2,884.5	103,800.0	299.4	0.4	0.2	0.6
08/29/2022 08:00	2,827.4	0.0	2,827.4	103,800.0	293.5	0.4	0.2	0.6
08/29/2022 09:00	2,930.3	0.0	2,930.3	103,800.0	304.2	0.4	0.2	0.6
08/29/2022 10:00	2,904.9	0.0	2,904.9	103,800.0	301.5	0.4	0.2	0.6
08/29/2022 11:00	2,941.9	0.0	2,941.9	103,800.0	305.4	0.4	0.2	0.6
08/29/2022 12:00	2,924.8	0.0	2,924.8	103,800.0	303.6	0.4	0.2	0.6
08/29/2022 13:00	3,476.4	0.0	3,476.4	103,800.0	360.9	0.4	0.2	0.7
08/29/2022 14:00	4,141.5	99.1	4,164.3	103,800.0	432.3	0.5	0.3	0.9
08/29/2022 15:00	4,538.2	701.7	5,239.9	103,800.0	543.9	0.7	0.3	1.1
08/29/2022 16:00	4,530.8	860.7	5,391.5	103,800.0	559.6	0.7	0.3	1.1
08/29/2022 17:00	4,529.7	1,464.6	5,994.3	103,800.0	622.2	0.7	0.4	1.2
08/29/2022 18:00	4,567.3	1,234.3	5,801.6	103,800.0	602.2	0.7	0.4	1.2
08/29/2022 19:00	4,596.6	982.9	5,579.5	103,800.0	579.2	0.7	0.3	1.2
08/29/2022 20:00	4,622.8	776.9	5,399.7	103,800.0	560.5	0.7	0.3	1.1
08/29/2022 21:00	4,595.2	495.4	4,976.7	103,800.0	516.6	0.6	0.3	1.1
08/29/2022 22:00	4,246.3	0.0	4,246.3	103,800.0	440.8	0.5	0.3	0.9
08/29/2022 23:00	4,651.5	0.0	4,651.5	103,800.0	482.8	0.6	0.3	1.0
Average/Sum#:	3,915.5	275.7	4,183.2	103,800.0	434.2	0.5	0.3	0.9
Minimum:	2,827.4	0.0	2,827.4	103,800.0	293.5	0.4	0.2	0.6
Maximum:	4,651.5	1,464.6	5,994.3	103,800.0	622.2	0.7	0.4	1.2
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:29 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2	Unit CT2	Unit CT2
						PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/30/2022 00:00	4,545.4	0.0	4,545.4	103,800.0	471.8	0.6	0.3	0.9
08/30/2022 01:00	4,354.8	0.0	4,354.8	103,800.0	452.0	0.5	0.3	0.9
08/30/2022 02:00	4,319.3	0.0	4,319.3	103,800.0	448.3	0.5	0.3	0.9
08/30/2022 03:00	4,311.6	0.0	4,311.6	103,800.0	447.5	0.5	0.3	0.9
08/30/2022 04:00	4,524.1	0.0	4,524.1	103,800.0	469.6	0.6	0.3	0.9
08/30/2022 05:00	4,729.8	0.0	4,729.8	103,800.0	491.0	0.6	0.3	1.0
08/30/2022 06:00	3,188.8	0.0	3,188.8	103,800.0	331.0	0.4	0.2	0.7
08/30/2022 07:00	2,841.3	0.0	2,841.3	103,800.0	294.9	0.4	0.2	0.6
08/30/2022 08:00	3,246.1	0.0	3,246.1	103,800.0	336.9	0.4	0.2	0.7
08/30/2022 09:00	3,634.2	0.0	3,634.2	103,800.0	377.2	0.5	0.2	0.8
08/30/2022 10:00	4,195.5	0.0	4,195.5	103,800.0	435.5	0.5	0.3	0.9
08/30/2022 11:00	4,565.9	0.0	4,565.9	103,800.0	473.9	0.6	0.3	0.9
08/30/2022 12:00	4,488.6	0.0	4,488.6	103,800.0	465.9	0.6	0.3	0.9
08/30/2022 13:00	4,525.4	178.2	4,575.3	103,800.0	474.9	0.6	0.3	1.0
08/30/2022 14:00	4,509.4	1,574.1	6,083.5	103,800.0	631.5	0.8	0.4	1.3
08/30/2022 15:00	4,494.1	1,761.7	6,255.8	103,800.0	649.4	0.8	0.4	1.3
08/30/2022 16:00	4,497.5	1,695.9	6,193.4	103,800.0	642.9	0.8	0.4	1.3
08/30/2022 17:00	4,520.2	1,976.4	6,496.6	103,800.0	674.3	0.8	0.4	1.3
08/30/2022 18:00	4,553.1	1,993.9	6,547.0	103,800.0	679.6	0.8	0.4	1.4
08/30/2022 19:00	4,571.0	1,874.5	6,445.5	103,800.0	669.0	0.8	0.4	1.3
08/30/2022 20:00	4,587.7	1,517.5	6,105.2	103,800.0	633.7	0.8	0.4	1.3
08/30/2022 21:00	4,609.1	1,221.6	5,830.7	103,800.0	605.2	0.7	0.4	1.2
08/30/2022 22:00	4,602.1	500.2	4,987.3	103,800.0	517.7	0.6	0.3	1.1
08/30/2022 23:00	4,655.8	1.7	4,655.9	103,800.0	483.3	0.6	0.3	1.0
Average/Sum#:	4,294.6	595.7	4,880.1	103,800.0	506.5	0.6	0.3	1.0
Minimum:	2,841.3	0.0	2,841.3	103,800.0	294.9	0.4	0.2	0.6
Maximum:	4,729.8	1,993.9	6,547.0	103,800.0	679.6	0.8	0.4	1.4
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:29 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2	Unit CT2	Unit CT2
	PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr					
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/31/2022 00:00	4,668.4	0.0	4,668.4	103,800.0	484.6	0.6	0.3	1.0
08/31/2022 01:00	4,687.7	0.0	4,687.7	103,800.0	486.6	0.6	0.3	1.0
08/31/2022 02:00	4,700.2	0.0	4,700.2	103,800.0	487.9	0.6	0.3	1.0
08/31/2022 03:00	4,686.9	0.0	4,686.9	103,800.0	486.5	0.6	0.3	1.0
08/31/2022 04:00	4,720.1	0.0	4,720.1	103,800.0	489.9	0.6	0.3	1.0
08/31/2022 05:00	4,732.7	0.0	4,732.7	103,800.0	491.3	0.6	0.3	1.0
08/31/2022 06:00	4,278.4	0.0	4,278.4	103,800.0	444.1	0.5	0.3	0.9
08/31/2022 07:00	3,880.4	0.0	3,880.4	103,800.0	402.8	0.5	0.2	0.8
08/31/2022 08:00	3,872.6	0.0	3,872.6	103,800.0	402.0	0.5	0.2	0.8
08/31/2022 09:00	4,105.4	0.0	4,105.4	103,800.0	426.1	0.5	0.3	0.9
08/31/2022 10:00	4,537.6	46.8	4,543.7	103,800.0	471.6	0.6	0.3	1.0
08/31/2022 11:00	4,590.7	1,393.2	5,983.9	103,800.0	621.1	0.7	0.4	1.2
08/31/2022 12:00	4,544.0	1,650.0	6,194.0	103,800.0	642.9	0.8	0.4	1.3
08/31/2022 13:00	4,527.6	1,796.0	6,323.6	103,800.0	656.4	0.8	0.4	1.3
08/31/2022 14:00	4,517.4	1,629.7	6,147.1	103,800.0	638.1	0.8	0.4	1.3
08/31/2022 15:00	4,522.6	1,257.4	5,780.0	103,800.0	600.0	0.7	0.4	1.2
08/31/2022 16:00	4,499.1	982.2	5,481.3	103,800.0	569.0	0.7	0.3	1.1
08/31/2022 17:00	4,511.7	1,753.3	6,265.0	103,800.0	650.3	0.8	0.4	1.3
08/31/2022 18:00	4,529.8	1,875.8	6,405.6	103,800.0	664.9	0.8	0.4	1.3
08/31/2022 19:00	4,565.1	1,413.1	5,978.2	103,800.0	620.5	0.7	0.4	1.2
08/31/2022 20:00	4,592.8	844.6	5,437.4	103,800.0	564.4	0.7	0.3	1.1
08/31/2022 21:00	4,602.2	1,032.8	5,635.0	103,800.0	584.9	0.7	0.4	1.2
08/31/2022 22:00	4,622.0	530.0	5,152.0	103,800.0	534.8	0.6	0.3	1.1
08/31/2022 23:00	4,637.0	808.9	5,445.9	103,800.0	565.3	0.7	0.3	1.1
Average/Sum#:	4,505.5	708.9	5,212.7	103,800.0	541.1	0.7	0.3	1.1
Minimum:	3,872.6	0.0	3,872.6	103,800.0	402.0	0.5	0.2	0.8
Maximum:	4,732.7	1,875.8	6,405.6	103,800.0	664.9	0.8	0.4	1.3
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:29 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/01/2022 00:00	4,665.2	844.5	5,509.7	103,800.0	571.9	0.7	0.3	1.1
09/01/2022 01:00	4,655.7	321.5	4,903.3	103,800.0	509.0	0.6	0.3	1.0
09/01/2022 02:00	4,544.8	0.0	4,544.8	103,800.0	471.8	0.6	0.3	0.9
09/01/2022 03:00	4,625.9	0.0	4,625.9	103,800.0	480.2	0.6	0.3	1.0
09/01/2022 04:00	4,578.7	0.0	4,578.7	103,800.0	475.3	0.6	0.3	1.0
09/01/2022 05:00	4,597.6	0.0	4,597.6	103,800.0	477.2	0.6	0.3	1.0
09/01/2022 06:00	4,513.9	0.0	4,513.9	103,800.0	468.5	0.6	0.3	0.9
09/01/2022 07:00	4,550.4	0.0	4,550.4	103,800.0	472.3	0.6	0.3	0.9
09/01/2022 08:00	3,033.9	0.0	3,033.9	103,800.0	314.9	0.4	0.2	0.6
09/01/2022 09:00	2,997.0	0.0	2,997.0	103,800.0	311.1	0.4	0.2	0.6
09/01/2022 10:00	3,093.7	0.0	3,093.7	103,800.0	321.1	0.4	0.2	0.6
09/01/2022 11:00	4,039.9	255.1	4,124.1	103,800.0	428.1	0.5	0.3	0.9
09/01/2022 12:00	4,485.6	1,393.5	5,879.1	103,800.0	610.3	0.7	0.4	1.2
09/01/2022 13:00	4,468.8	1,557.3	6,026.1	103,800.0	625.5	0.8	0.4	1.3
09/01/2022 14:00	4,454.0	1,675.7	6,129.7	103,800.0	636.3	0.8	0.4	1.3
09/01/2022 15:00	4,446.9	1,894.0	6,340.9	103,800.0	658.2	0.8	0.4	1.3
09/01/2022 16:00	4,437.7	1,667.1	6,104.8	103,800.0	633.7	0.8	0.4	1.3
09/01/2022 17:00	4,432.9	1,911.3	6,344.2	103,800.0	658.5	0.8	0.4	1.3
09/01/2022 18:00	4,446.1	1,907.9	6,354.0	103,800.0	659.5	0.8	0.4	1.3
09/01/2022 19:00	4,476.9	1,552.7	6,029.6	103,800.0	625.9	0.8	0.4	1.3
09/01/2022 20:00	4,518.8	1,696.8	6,215.6	103,800.0	645.2	0.8	0.4	1.3
09/01/2022 21:00	4,515.9	1,559.4	6,075.3	103,800.0	630.6	0.8	0.4	1.3
09/01/2022 22:00	4,540.1	1,263.9	5,804.0	103,800.0	602.5	0.7	0.4	1.2
09/01/2022 23:00	4,569.9	1,292.5	5,862.4	103,800.0	608.5	0.7	0.4	1.2
Average/Sum#:	4,320.4	866.4	5,176.6	103,800.0	537.3	0.7	0.3	1.1
Minimum:	2,997.0	0.0	2,997.0	103,800.0	311.1	0.4	0.2	0.6
Maximum:	4,665.2	1,911.3	6,354.0	103,800.0	659.5	0.8	0.4	1.3
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:30 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2	Unit CT2	Unit CT2
						PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/02/2022 00:00	4,583.8	1,037.0	5,620.8	103,800.0	583.4	0.7	0.4	1.2
09/02/2022 01:00	4,604.2	932.6	5,536.8	103,800.0	574.7	0.7	0.3	1.1
09/02/2022 02:00	4,626.3	770.4	5,396.7	103,800.0	560.2	0.7	0.3	1.1
09/02/2022 03:00	4,618.3	750.5	5,368.8	103,800.0	557.3	0.7	0.3	1.1
09/02/2022 04:00	4,634.2	960.9	5,595.1	103,800.0	580.8	0.7	0.3	1.2
09/02/2022 05:00	4,660.3	1,168.8	5,829.1	103,800.0	605.1	0.7	0.4	1.2
09/02/2022 06:00	4,666.1	555.1	5,221.2	103,800.0	542.0	0.7	0.3	1.1
09/02/2022 07:00	4,661.9	292.5	4,954.4	103,800.0	514.3	0.6	0.3	1.0
09/02/2022 08:00	4,629.6	476.1	5,105.7	103,800.0	530.0	0.6	0.3	1.1
09/02/2022 09:00	4,585.0	827.7	5,412.7	103,800.0	561.8	0.7	0.3	1.1
09/02/2022 10:00	4,551.3	1,055.7	5,607.0	103,800.0	582.0	0.7	0.3	1.2
09/02/2022 11:00	4,520.5	1,197.3	5,717.8	103,800.0	593.5	0.7	0.4	1.2
09/02/2022 12:00	4,498.2	1,344.7	5,842.9	103,800.0	606.5	0.7	0.4	1.2
09/02/2022 13:00	4,493.3	1,602.8	6,096.1	103,800.0	632.8	0.8	0.4	1.3
09/02/2022 14:00	4,488.0	1,592.4	6,080.4	103,800.0	631.1	0.8	0.4	1.3
09/02/2022 15:00	4,481.1	983.7	5,464.8	103,800.0	567.2	0.7	0.3	1.1
09/02/2022 16:00	4,479.7	870.2	5,349.9	103,800.0	555.3	0.7	0.3	1.1
09/02/2022 17:00	4,482.4	918.5	5,400.9	103,800.0	560.6	0.7	0.3	1.1
09/02/2022 18:00	4,506.2	1,108.9	5,615.1	103,800.0	582.8	0.7	0.3	1.2
09/02/2022 19:00	4,541.3	1,249.9	5,791.2	103,800.0	601.1	0.7	0.4	1.2
09/02/2022 20:00	4,557.7	1,121.0	5,678.7	103,800.0	589.4	0.7	0.4	1.2
09/02/2022 21:00	4,577.6	749.8	5,327.4	103,800.0	553.0	0.7	0.3	1.1
09/02/2022 22:00	4,600.8	376.9	4,891.0	103,800.0	507.7	0.6	0.3	1.0
09/02/2022 23:00	3,611.1	0.0	3,611.1	103,800.0	374.8	0.4	0.2	0.7
Average/Sum#:	4,527.5	914.3	5,438.2	103,800.0	564.5	0.7	0.3	1.1
Minimum:	3,611.1	0.0	3,611.1	103,800.0	374.8	0.4	0.2	0.7
Maximum:	4,666.1	1,602.8	6,096.1	103,800.0	632.8	0.8	0.4	1.3
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:30 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/03/2022 00:00	3,988.4	0.0	3,988.4	103,800.0	414.0	0.5	0.2	0.8
09/03/2022 01:00	2,992.0	0.0	2,992.0	103,800.0	310.6	0.4	0.2	0.6
09/03/2022 02:00	2,911.2	0.0	2,911.2	103,800.0	302.2	0.4	0.2	0.6
09/03/2022 03:00	2,925.2	0.0	2,925.2	103,800.0	303.6	0.4	0.2	0.6
09/03/2022 04:00	2,881.6	0.0	2,881.6	103,800.0	299.1	0.4	0.2	0.6
09/03/2022 05:00	2,918.2	0.0	2,918.2	103,800.0	302.9	0.4	0.2	0.6
09/03/2022 06:00	2,810.3	0.0	2,810.3	103,800.0	291.7	0.4	0.2	0.6
09/03/2022 07:00	2,809.1	0.0	2,809.1	103,800.0	291.6	0.4	0.2	0.6
09/03/2022 08:00	2,787.3	0.0	2,787.3	103,800.0	289.3	0.3	0.2	0.6
09/03/2022 09:00	2,852.3	0.0	2,852.3	103,800.0	296.1	0.4	0.2	0.6
09/03/2022 10:00	2,857.2	0.0	2,857.2	103,800.0	296.6	0.4	0.2	0.6
09/03/2022 11:00	2,813.4	0.0	2,813.4	103,800.0	292.0	0.4	0.2	0.6
09/03/2022 12:00	3,434.8	46.3	3,440.8	103,800.0	357.2	0.4	0.2	0.7
09/03/2022 13:00	4,516.7	546.0	5,062.7	103,800.0	525.5	0.6	0.3	1.1
09/03/2022 14:00	4,478.3	442.0	4,867.3	103,800.0	505.2	0.6	0.3	1.0
09/03/2022 15:00	3,689.8	194.4	3,761.7	103,800.0	390.5	0.5	0.2	0.8
09/03/2022 16:00	4,480.3	597.2	5,077.5	103,800.0	527.0	0.6	0.3	1.1
09/03/2022 17:00	4,500.2	568.9	5,069.1	103,800.0	526.2	0.6	0.3	1.1
09/03/2022 18:00	4,543.4	503.5	5,046.9	103,800.0	523.9	0.6	0.3	1.0
09/03/2022 19:00	3,451.5	5.3	3,451.7	103,800.0	358.3	0.4	0.2	0.7
09/03/2022 20:00	3,081.7	0.0	3,081.7	103,800.0	319.9	0.4	0.2	0.6
09/03/2022 21:00	3,372.6	0.0	3,372.6	103,800.0	350.1	0.4	0.2	0.7
09/03/2022 22:00	3,274.2	0.0	3,274.2	103,800.0	339.9	0.4	0.2	0.7
09/03/2022 23:00	3,645.0	0.0	3,645.0	103,800.0	378.4	0.5	0.2	0.8
Average/Sum#:	3,417.3	121.0	3,529.1	103,800.0	366.3	0.5	0.2	0.7
Minimum:	2,787.3	0.0	2,787.3	103,800.0	289.3	0.3	0.2	0.6
Maximum:	4,543.4	597.2	5,077.5	103,800.0	527.0	0.6	0.3	1.1
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:30 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2	Unit CT2	Unit CT2
	PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr					
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/04/2022 00:00	3,407.9	0.0	3,407.9	103,800.0	353.7	0.4	0.2	0.7
09/04/2022 01:00	2,985.5	0.0	2,985.5	103,800.0	309.9	0.4	0.2	0.6
09/04/2022 02:00	3,245.5	0.0	3,245.5	103,800.0	336.9	0.4	0.2	0.7
09/04/2022 03:00	3,300.2	0.0	3,300.2	103,800.0	342.6	0.4	0.2	0.7
09/04/2022 04:00	2,993.7	0.0	2,993.7	103,800.0	310.7	0.4	0.2	0.6
09/04/2022 05:00	2,857.3	0.0	2,857.3	103,800.0	296.6	0.4	0.2	0.6
09/04/2022 06:00	2,846.1	0.0	2,846.1	103,800.0	295.4	0.4	0.2	0.6
09/04/2022 07:00	2,810.4	0.0	2,810.4	103,800.0	291.7	0.4	0.2	0.6
09/04/2022 08:00	2,803.8	0.0	2,803.8	103,800.0	291.0	0.4	0.2	0.6
09/04/2022 09:00	2,800.2	0.0	2,800.2	103,800.0	290.7	0.4	0.2	0.6
09/04/2022 10:00	2,842.7	0.0	2,842.7	103,800.0	295.1	0.4	0.2	0.6
09/04/2022 11:00	2,822.1	0.0	2,822.1	103,800.0	292.9	0.4	0.2	0.6
09/04/2022 12:00	3,173.3	0.0	3,173.3	103,800.0	329.4	0.4	0.2	0.7
09/04/2022 13:00	3,126.5	0.0	3,126.5	103,800.0	324.5	0.4	0.2	0.6
09/04/2022 14:00	3,833.4	207.1	3,916.2	103,800.0	406.5	0.5	0.3	0.8
09/04/2022 15:00	4,464.6	586.3	5,050.9	103,800.0	524.3	0.6	0.3	1.0
09/04/2022 16:00	4,458.0	724.3	5,182.3	103,800.0	537.9	0.6	0.3	1.1
09/04/2022 17:00	4,463.5	982.1	5,445.6	103,800.0	565.3	0.7	0.3	1.1
09/04/2022 18:00	4,491.9	919.0	5,410.9	103,800.0	561.7	0.7	0.3	1.1
09/04/2022 19:00	4,480.5	229.5	4,625.1	103,800.0	480.1	0.6	0.3	1.0
09/04/2022 20:00	4,534.0	713.3	5,247.3	103,800.0	544.7	0.7	0.3	1.1
09/04/2022 21:00	4,553.0	677.2	5,230.2	103,800.0	542.9	0.7	0.3	1.1
09/04/2022 22:00	4,569.2	336.9	4,828.6	103,800.0	501.2	0.6	0.3	1.0
09/04/2022 23:00	4,369.3	0.0	4,369.3	103,800.0	453.5	0.5	0.3	0.9
Average/Sum#:	3,593.0	224.0	3,805.1	103,800.0	395.0	0.5	0.2	0.8
Minimum:	2,800.2	0.0	2,800.2	103,800.0	290.7	0.4	0.2	0.6
Maximum:	4,569.2	982.1	5,445.6	103,800.0	565.3	0.7	0.3	1.1
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:30 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/05/2022 00:00	4,329.1	0.0	4,329.1	103,800.0	449.4	0.5	0.3	0.9
09/05/2022 01:00	3,956.9	0.0	3,956.9	103,800.0	410.7	0.5	0.2	0.8
09/05/2022 02:00	3,797.2	0.0	3,797.2	103,800.0	394.1	0.5	0.2	0.8
09/05/2022 03:00	3,933.1	0.0	3,933.1	103,800.0	408.3	0.5	0.2	0.8
09/05/2022 04:00	3,955.9	0.0	3,955.9	103,800.0	410.6	0.5	0.2	0.8
09/05/2022 05:00	3,844.3	0.0	3,844.3	103,800.0	399.0	0.5	0.2	0.8
09/05/2022 06:00	2,880.3	0.0	2,880.3	103,800.0	299.0	0.4	0.2	0.6
09/05/2022 07:00	2,798.9	0.0	2,798.9	103,800.0	290.5	0.4	0.2	0.6
09/05/2022 08:00	2,805.7	0.0	2,805.7	103,800.0	291.2	0.4	0.2	0.6
09/05/2022 09:00	3,812.4	0.0	3,812.4	103,800.0	395.7	0.5	0.2	0.8
09/05/2022 10:00	4,308.5	0.0	4,308.5	103,800.0	447.2	0.5	0.3	0.9
09/05/2022 11:00	4,362.3	165.4	4,408.6	103,800.0	457.6	0.6	0.3	0.9
09/05/2022 12:00	4,450.2	931.9	5,382.1	103,800.0	558.7	0.7	0.3	1.1
09/05/2022 13:00	4,411.5	1,266.7	5,678.2	103,800.0	589.4	0.7	0.4	1.2
09/05/2022 14:00	4,390.3	1,763.7	6,154.0	103,800.0	638.8	0.8	0.4	1.3
09/05/2022 15:00	4,372.4	1,871.6	6,244.0	103,800.0	648.1	0.8	0.4	1.3
09/05/2022 16:00	4,362.3	1,885.4	6,247.7	103,800.0	648.5	0.8	0.4	1.3
09/05/2022 17:00	4,343.1	1,925.0	6,268.1	103,800.0	650.6	0.8	0.4	1.3
09/05/2022 18:00	4,393.4	1,889.5	6,282.9	103,800.0	652.2	0.8	0.4	1.3
09/05/2022 19:00	4,427.2	1,842.4	6,269.6	103,800.0	650.8	0.8	0.4	1.3
09/05/2022 20:00	4,465.1	1,785.1	6,250.2	103,800.0	648.8	0.8	0.4	1.3
09/05/2022 21:00	4,483.4	1,525.6	6,009.0	103,800.0	623.7	0.7	0.4	1.2
09/05/2022 22:00	4,491.4	1,513.4	6,004.8	103,800.0	623.3	0.7	0.4	1.2
09/05/2022 23:00	4,516.9	1,538.9	6,055.8	103,800.0	628.6	0.8	0.4	1.3
Average/Sum#:	4,078.8	829.4	4,903.2	103,800.0	509.0	0.6	0.3	1.0
Minimum:	2,798.9	0.0	2,798.9	103,800.0	290.5	0.4	0.2	0.6
Maximum:	4,516.9	1,925.0	6,282.9	103,800.0	652.2	0.8	0.4	1.3
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:30 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2	Unit CT2	Unit CT2
						PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/06/2022 00:00	4,543.8	1,141.0	5,684.8	103,800.0	590.1	0.7	0.4	1.2
09/06/2022 01:00	4,527.9	388.7	4,827.2	103,800.0	501.1	0.6	0.3	1.0
09/06/2022 02:00	4,466.3	0.0	4,466.3	103,800.0	463.6	0.6	0.3	0.9
09/06/2022 03:00	4,461.2	0.0	4,461.2	103,800.0	463.1	0.6	0.3	0.9
09/06/2022 04:00	4,468.0	0.0	4,468.0	103,800.0	463.8	0.6	0.3	0.9
09/06/2022 05:00	4,467.5	0.0	4,467.5	103,800.0	463.7	0.6	0.3	0.9
09/06/2022 06:00	4,431.5	0.0	4,431.5	103,800.0	460.0	0.6	0.3	0.9
09/06/2022 07:00	4,189.4	0.0	4,189.4	103,800.0	434.9	0.5	0.3	0.9
09/06/2022 08:00	4,363.7	0.0	4,363.7	103,800.0	453.0	0.5	0.3	0.9
09/06/2022 09:00	4,466.3	537.5	4,853.3	103,800.0	503.8	0.6	0.3	1.0
09/06/2022 10:00	4,430.2	1,174.8	5,605.0	103,800.0	581.8	0.7	0.3	1.2
09/06/2022 11:00	4,418.3	1,855.1	6,273.4	103,800.0	651.2	0.8	0.4	1.3
09/06/2022 12:00	4,388.1	1,887.8	6,275.9	103,800.0	651.4	0.8	0.4	1.3
09/06/2022 13:00	4,374.5	1,911.3	6,285.8	103,800.0	652.5	0.8	0.4	1.3
09/06/2022 14:00	4,334.4	1,911.3	6,245.7	103,800.0	648.3	0.8	0.4	1.3
09/06/2022 15:00	4,324.9	1,912.9	6,237.8	103,800.0	647.5	0.8	0.4	1.3
09/06/2022 16:00	4,347.5	1,910.9	6,258.4	103,800.0	649.6	0.8	0.4	1.3
09/06/2022 17:00	4,336.0	1,921.1	6,257.1	103,800.0	649.5	0.8	0.4	1.3
09/06/2022 18:00	4,350.5	1,903.8	6,254.3	103,800.0	649.2	0.8	0.4	1.3
09/06/2022 19:00	4,426.8	1,860.3	6,287.1	103,800.0	652.6	0.8	0.4	1.3
09/06/2022 20:00	4,468.7	1,796.4	6,265.1	103,800.0	650.3	0.8	0.4	1.3
09/06/2022 21:00	4,501.6	1,728.9	6,230.5	103,800.0	646.7	0.8	0.4	1.3
09/06/2022 22:00	4,524.7	1,021.4	5,546.1	103,800.0	575.7	0.7	0.3	1.2
09/06/2022 23:00	4,550.6	988.2	5,538.8	103,800.0	574.9	0.7	0.3	1.2
Average/Sum#:	4,423.4	1,077.1	5,490.6	103,800.0	569.9	0.7	0.4	1.1
Minimum:	4,189.4	0.0	4,189.4	103,800.0	434.9	0.5	0.3	0.9
Maximum:	4,550.6	1,921.1	6,287.1	103,800.0	652.6	0.8	0.4	1.3
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:30 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2	Unit CT2	Unit CT2
	PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr					
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/07/2022 00:00	4,562.0	183.9	4,731.2	103,800.0	491.1	0.6	0.3	1.0
09/07/2022 01:00	4,573.3	0.0	4,573.3	103,800.0	474.7	0.6	0.3	0.9
09/07/2022 02:00	4,568.2	0.0	4,568.2	103,800.0	474.2	0.6	0.3	0.9
09/07/2022 03:00	4,569.6	0.0	4,569.6	103,800.0	474.3	0.6	0.3	0.9
09/07/2022 04:00	4,576.9	0.0	4,576.9	103,800.0	475.1	0.6	0.3	1.0
09/07/2022 05:00	4,597.5	0.0	4,597.5	103,800.0	477.2	0.6	0.3	1.0
09/07/2022 06:00	4,458.4	0.0	4,458.4	103,800.0	462.8	0.6	0.3	0.9
09/07/2022 07:00	3,990.2	0.0	3,990.2	103,800.0	414.2	0.5	0.2	0.8
09/07/2022 08:00	4,337.1	0.0	4,337.1	103,800.0	450.2	0.5	0.3	0.9
09/07/2022 09:00	4,543.6	1,493.9	6,007.6	103,800.0	623.6	0.8	0.4	1.3
09/07/2022 10:00	4,532.6	1,658.6	6,191.2	103,800.0	642.6	0.8	0.4	1.3
09/07/2022 11:00	4,506.0	1,705.4	6,211.4	103,800.0	644.7	0.8	0.4	1.3
09/07/2022 12:00	4,479.0	1,756.4	6,235.4	103,800.0	647.2	0.8	0.4	1.3
09/07/2022 13:00	4,462.7	1,793.9	6,256.6	103,800.0	649.4	0.8	0.4	1.3
09/07/2022 14:00	4,438.9	1,828.9	6,267.8	103,800.0	650.6	0.8	0.4	1.3
09/07/2022 15:00	4,439.0	1,841.2	6,280.2	103,800.0	651.9	0.8	0.4	1.3
09/07/2022 16:00	4,450.6	1,827.6	6,278.2	103,800.0	651.7	0.8	0.4	1.3
09/07/2022 17:00	4,446.6	1,836.8	6,283.4	103,800.0	652.2	0.8	0.4	1.3
09/07/2022 18:00	4,462.8	1,819.3	6,282.1	103,800.0	652.1	0.8	0.4	1.3
09/07/2022 19:00	4,503.4	1,676.9	6,180.3	103,800.0	641.5	0.8	0.4	1.3
09/07/2022 20:00	4,539.3	1,707.3	6,246.6	103,800.0	648.4	0.8	0.4	1.3
09/07/2022 21:00	4,561.6	1,635.2	6,196.8	103,800.0	643.2	0.8	0.4	1.3
09/07/2022 22:00	4,578.7	1,386.6	5,965.3	103,800.0	619.2	0.7	0.4	1.2
09/07/2022 23:00	4,594.7	1,256.6	5,851.3	103,800.0	607.4	0.7	0.4	1.2
Average/Sum#:	4,490.5	1,058.7	5,547.4	103,800.0	575.8	0.7	0.4	1.2
Minimum:	3,990.2	0.0	3,990.2	103,800.0	414.2	0.5	0.2	0.8
Maximum:	4,597.5	1,841.2	6,283.4	103,800.0	652.2	0.8	0.4	1.3
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:30 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2	Unit CT2	Unit CT2
						PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/08/2022 00:00	4,593.8	1,218.1	5,811.9	103,800.0	603.3	0.7	0.4	1.2
09/08/2022 01:00	4,587.9	98.8	4,614.6	103,800.0	479.0	0.6	0.3	1.0
09/08/2022 02:00	4,615.2	0.0	4,615.2	103,800.0	479.1	0.6	0.3	1.0
09/08/2022 03:00	4,629.7	0.0	4,629.7	103,800.0	480.6	0.6	0.3	1.0
09/08/2022 04:00	4,636.1	0.0	4,636.1	103,800.0	481.2	0.6	0.3	1.0
09/08/2022 05:00	4,650.2	0.0	4,650.2	103,800.0	482.7	0.6	0.3	1.0
09/08/2022 06:00	4,569.1	0.0	4,569.1	103,800.0	474.3	0.6	0.3	0.9
09/08/2022 07:00	4,440.0	0.0	4,440.0	103,800.0	460.9	0.6	0.3	0.9
09/08/2022 08:00	4,538.7	21.9	4,540.9	103,800.0	471.3	0.6	0.3	0.9
09/08/2022 09:00	4,518.8	1,682.4	6,201.2	103,800.0	643.7	0.8	0.4	1.3
09/08/2022 10:00	4,476.2	1,769.7	6,245.9	103,800.0	648.3	0.8	0.4	1.3
09/08/2022 11:00	4,443.4	1,823.8	6,267.2	103,800.0	650.5	0.8	0.4	1.3
09/08/2022 12:00	4,421.5	1,842.2	6,263.7	103,800.0	650.2	0.8	0.4	1.3
09/08/2022 13:00	4,402.5	1,884.4	6,286.9	103,800.0	652.6	0.8	0.4	1.3
09/08/2022 14:00	4,387.6	1,901.4	6,289.0	103,800.0	652.8	0.8	0.4	1.3
09/08/2022 15:00	4,386.6	1,902.9	6,289.5	103,800.0	652.9	0.8	0.4	1.3
09/08/2022 16:00	4,377.1	1,904.2	6,281.3	103,800.0	652.0	0.8	0.4	1.3
09/08/2022 17:00	4,380.3	1,913.5	6,293.8	103,800.0	653.3	0.8	0.4	1.3
09/08/2022 18:00	4,407.3	1,874.8	6,282.1	103,800.0	652.1	0.8	0.4	1.3
09/08/2022 19:00	4,439.7	1,866.6	6,306.3	103,800.0	654.6	0.8	0.4	1.3
09/08/2022 20:00	4,466.8	1,924.1	6,390.9	103,800.0	663.4	0.8	0.4	1.3
09/08/2022 21:00	4,478.2	1,960.8	6,439.0	103,800.0	668.4	0.8	0.4	1.3
09/08/2022 22:00	4,483.2	1,678.5	6,161.7	103,800.0	639.6	0.8	0.4	1.3
09/08/2022 23:00	4,520.8	1,420.9	5,941.7	103,800.0	616.7	0.7	0.4	1.2
Average/Sum#:	4,493.8	1,195.4	5,685.3	103,800.0	590.1	0.7	0.4	1.2
Minimum:	4,377.1	0.0	4,440.0	103,800.0	460.9	0.6	0.3	0.9
Maximum:	4,650.2	1,960.8	6,439.0	103,800.0	668.4	0.8	0.4	1.3
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:30 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2	Unit CT2	Unit CT2
						PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/09/2022 00:00	4,546.9	1,422.4	5,969.3	103,800.0	619.6	0.7	0.4	1.2
09/09/2022 01:00	4,549.9	1,140.2	5,690.1	103,800.0	590.6	0.7	0.4	1.2
09/09/2022 02:00	4,542.5	1,077.9	5,620.4	103,800.0	583.4	0.7	0.4	1.2
09/09/2022 03:00	4,563.4	889.9	5,453.3	103,800.0	566.1	0.7	0.3	1.1
09/09/2022 04:00	4,601.4	1,134.3	5,735.7	103,800.0	595.4	0.7	0.4	1.2
09/09/2022 05:00	4,611.5	1,669.9	6,281.4	103,800.0	652.0	0.8	0.4	1.3
09/09/2022 06:00	4,607.9	1,436.5	6,044.4	103,800.0	627.4	0.8	0.4	1.3
09/09/2022 07:00	4,600.8	1,345.5	5,946.3	103,800.0	617.2	0.7	0.4	1.2
09/09/2022 08:00	4,563.8	1,193.2	5,757.0	103,800.0	597.6	0.7	0.4	1.2
09/09/2022 09:00	4,534.7	998.2	5,532.9	103,800.0	574.3	0.7	0.3	1.1
09/09/2022 10:00	4,503.5	1,512.6	6,016.1	103,800.0	624.5	0.7	0.4	1.2
09/09/2022 11:00	4,481.3	961.5	5,442.8	103,800.0	565.0	0.7	0.3	1.1
09/09/2022 12:00	4,470.9	1,450.9	5,921.8	103,800.0	614.7	0.7	0.4	1.2
09/09/2022 13:00	4,450.2	1,698.6	6,148.8	103,800.0	638.2	0.8	0.4	1.3
09/09/2022 14:00	4,445.9	1,473.4	5,919.3	103,800.0	614.4	0.7	0.4	1.2
09/09/2022 15:00	4,431.0	1,394.1	5,825.1	103,800.0	604.6	0.7	0.4	1.2
09/09/2022 16:00	4,426.5	1,031.3	5,457.8	103,800.0	566.5	0.7	0.3	1.1
09/09/2022 17:00	4,437.9	1,216.7	5,654.6	103,800.0	586.9	0.7	0.4	1.2
09/09/2022 18:00	4,445.1	989.2	5,434.3	103,800.0	564.1	0.7	0.3	1.1
09/09/2022 19:00	4,465.7	706.7	5,172.4	103,800.0	536.9	0.6	0.3	1.1
09/09/2022 20:00	4,389.2	314.2	4,555.7	103,800.0	472.9	0.6	0.3	1.0
09/09/2022 21:00	4,297.8	0.0	4,297.8	103,800.0	446.1	0.5	0.3	0.9
09/09/2022 22:00	3,835.5	0.0	3,835.5	103,800.0	398.1	0.5	0.2	0.8
09/09/2022 23:00	4,347.1	0.0	4,347.1	103,800.0	451.2	0.5	0.3	0.9
Average/Sum#:	4,464.6	1,044.1	5,502.5	103,800.0	571.2	0.7	0.4	1.1
Minimum:	3,835.5	0.0	3,835.5	103,800.0	398.1	0.5	0.2	0.8
Maximum:	4,611.5	1,698.6	6,281.4	103,800.0	652.0	0.8	0.4	1.3
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:30 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2	Unit CT2	Unit CT2
						PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/10/2022 00:00	4,149.4	0.0	4,149.4	103,800.0	430.7	0.5	0.3	0.9
09/10/2022 01:00	3,138.8	0.0	3,138.8	103,800.0	325.8	0.4	0.2	0.7
09/10/2022 02:00	3,731.5	0.0	3,731.5	103,800.0	387.3	0.5	0.2	0.8
09/10/2022 03:00	3,517.8	0.0	3,517.8	103,800.0	365.1	0.4	0.2	0.7
09/10/2022 04:00	4,008.5	0.0	4,008.5	103,800.0	416.1	0.5	0.2	0.8
09/10/2022 05:00	3,800.3	0.0	3,800.3	103,800.0	394.5	0.5	0.2	0.8
09/10/2022 06:00	3,579.2	0.0	3,579.2	103,800.0	371.5	0.4	0.2	0.7
09/10/2022 07:00	4,441.4	0.0	4,441.4	103,800.0	461.0	0.6	0.3	0.9
09/10/2022 08:00	3,995.3	0.0	3,995.3	103,800.0	414.7	0.5	0.2	0.8
09/10/2022 09:00	3,365.0	0.0	3,365.0	103,800.0	349.3	0.4	0.2	0.7
09/10/2022 10:00	2,847.3	0.0	2,847.3	103,800.0	295.5	0.4	0.2	0.6
09/10/2022 11:00	2,827.4	0.0	2,827.4	103,800.0	293.5	0.4	0.2	0.6
09/10/2022 12:00	3,046.0	0.0	3,046.0	103,800.0	316.2	0.4	0.2	0.6
09/10/2022 13:00	3,355.3	0.0	3,355.3	103,800.0	348.3	0.4	0.2	0.7
09/10/2022 14:00	3,017.3	0.0	3,017.3	103,800.0	313.2	0.4	0.2	0.6
09/10/2022 15:00	3,086.0	0.0	3,086.0	103,800.0	320.3	0.4	0.2	0.6
09/10/2022 16:00	3,460.3	0.0	3,460.3	103,800.0	359.2	0.4	0.2	0.7
09/10/2022 17:00	3,072.6	0.0	3,072.6	103,800.0	318.9	0.4	0.2	0.6
09/10/2022 18:00	3,650.8	0.0	3,650.8	103,800.0	379.0	0.5	0.2	0.8
09/10/2022 19:00	4,207.2	0.0	4,207.2	103,800.0	436.7	0.5	0.3	0.9
09/10/2022 20:00	4,298.6	0.0	4,298.6	103,800.0	446.2	0.5	0.3	0.9
09/10/2022 21:00	4,350.6	0.0	4,350.6	103,800.0	451.6	0.5	0.3	0.9
09/10/2022 22:00	3,590.1	0.0	3,590.1	103,800.0	372.7	0.4	0.2	0.7
09/10/2022 23:00	4,452.2	0.0	4,452.2	103,800.0	462.1	0.6	0.3	0.9
Average/Sum#:	3,624.5	0.0	3,624.5	103,800.0	376.2	0.5	0.2	0.7
Minimum:	2,827.4	0.0	2,827.4	103,800.0	293.5	0.4	0.2	0.6
Maximum:	4,452.2	0.0	4,452.2	103,800.0	462.1	0.6	0.3	0.9
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:30 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2	Unit CT2	Unit CT2
	PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr					
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/11/2022 00:00	4,527.3	0.0	4,527.3	103,800.0	469.9	0.6	0.3	0.9
09/11/2022 01:00	4,467.8	0.0	4,467.8	103,800.0	463.8	0.6	0.3	0.9
09/11/2022 02:00	4,418.3	0.0	4,418.3	103,800.0	458.6	0.6	0.3	0.9
09/11/2022 03:00	4,050.4	0.0	4,050.4	103,800.0	420.4	0.5	0.3	0.8
09/11/2022 04:00	4,220.0	0.0	4,220.0	103,800.0	438.0	0.5	0.3	0.9
09/11/2022 05:00	4,097.5	0.0	4,097.5	103,800.0	425.3	0.5	0.3	0.9
09/11/2022 06:00	3,594.9	0.0	3,594.9	103,800.0	373.2	0.4	0.2	0.7
09/11/2022 07:00	3,137.3	0.0	3,137.3	103,800.0	325.7	0.4	0.2	0.7
09/11/2022 08:00	2,938.3	0.0	2,938.3	103,800.0	305.0	0.4	0.2	0.6
09/11/2022 09:00	2,859.8	0.0	2,859.8	103,800.0	296.8	0.4	0.2	0.6
09/11/2022 10:00	2,949.2	0.0	2,949.2	103,800.0	306.1	0.4	0.2	0.6
09/11/2022 11:00	2,971.7	0.0	2,971.7	103,800.0	308.5	0.4	0.2	0.6
09/11/2022 12:00	3,360.7	0.0	3,360.7	103,800.0	348.8	0.4	0.2	0.7
09/11/2022 13:00	3,331.0	0.0	3,331.0	103,800.0	345.8	0.4	0.2	0.7
09/11/2022 14:00	3,932.7	0.0	3,932.7	103,800.0	408.2	0.5	0.2	0.8
09/11/2022 15:00	4,123.1	0.0	4,123.1	103,800.0	428.0	0.5	0.3	0.9
09/11/2022 16:00	4,593.3	352.8	4,805.0	103,800.0	498.8	0.6	0.3	1.0
09/11/2022 17:00	4,613.7	903.9	5,517.6	103,800.0	572.7	0.7	0.3	1.1
09/11/2022 18:00	4,646.6	584.8	5,231.4	103,800.0	543.0	0.7	0.3	1.1
09/11/2022 19:00	4,653.6	379.7	4,946.0	103,800.0	513.4	0.6	0.3	1.0
09/11/2022 20:00	4,410.0	0.0	4,410.0	103,800.0	457.8	0.5	0.3	0.9
09/11/2022 21:00	3,398.6	0.0	3,398.6	103,800.0	352.8	0.4	0.2	0.7
09/11/2022 22:00	3,499.6	0.0	3,499.6	103,800.0	363.3	0.4	0.2	0.7
09/11/2022 23:00	3,389.8	0.0	3,389.8	103,800.0	351.9	0.4	0.2	0.7
Average/Sum#:	3,841.1	92.6	3,924.1	103,800.0	407.3	0.5	0.3	0.8
Minimum:	2,859.8	0.0	2,859.8	103,800.0	296.8	0.4	0.2	0.6
Maximum:	4,653.6	903.9	5,517.6	103,800.0	572.7	0.7	0.3	1.1
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 **To:** 09/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 10/01/2022 21:30 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/12/2022 00:00	3,883.9	0.0	3,883.9	103,800.0	403.1	0.5	0.2	0.8
09/12/2022 01:00	3,013.1	0.0	3,013.1	103,800.0	312.8	0.4	0.2	0.6
09/12/2022 02:00	2,954.5	0.0	2,954.5	103,800.0	306.7	0.4	0.2	0.6
09/12/2022 03:00	2,940.3	0.0	2,940.3	103,800.0	305.2	0.4	0.2	0.6
09/12/2022 04:00	3,948.6	0.0	3,948.6	103,800.0	409.9	0.5	0.2	0.8
09/12/2022 05:00	4,608.4	0.0	4,608.4	103,800.0	478.4	0.6	0.3	1.0
09/12/2022 06:00	4,125.6	0.0	4,125.6	103,800.0	428.2	0.5	0.3	0.9
09/12/2022 07:00	3,298.1	0.0	3,298.1	104,400.0	344.3	0.4	0.2	0.7
09/12/2022 08:00	2,936.9	0.0	2,936.9	104,400.0	306.6	0.4	0.2	0.6
09/12/2022 09:00	2,937.7	0.0	2,937.7	104,400.0	306.7	0.4	0.2	0.6
09/12/2022 10:00	2,986.8	0.0	2,986.8	104,400.0	311.8	0.4	0.2	0.6
09/12/2022 11:00	3,794.9	0.0	3,794.9	104,400.0	396.2	0.5	0.2	0.8
09/12/2022 12:00	4,498.9	0.0	4,498.9	104,400.0	469.7	0.6	0.3	0.9
09/12/2022 13:00	3,909.3	0.0	3,909.3	104,400.0	408.1	0.5	0.2	0.8
09/12/2022 14:00	3,921.1	0.0	3,921.1	104,400.0	409.4	0.5	0.2	0.8
09/12/2022 15:00	3,919.7	1.9	3,919.8	104,400.0	409.2	0.5	0.2	0.8
09/12/2022 16:00	4,061.4	1.1	4,061.5	104,400.0	424.0	0.5	0.3	0.8
09/12/2022 17:00	4,491.4	0.0	4,491.4	104,400.0	468.9	0.6	0.3	0.9
09/12/2022 18:00	4,430.8	0.0	4,430.8	104,400.0	462.6	0.6	0.3	0.9
09/12/2022 19:00	4,472.5	0.0	4,472.5	104,400.0	466.9	0.6	0.3	0.9
09/12/2022 20:00	4,546.6	0.0	4,546.6	104,400.0	474.7	0.6	0.3	0.9
09/12/2022 21:00	4,498.3	0.0	4,498.3	104,400.0	469.6	0.6	0.3	0.9
09/12/2022 22:00	3,605.1	0.0	3,605.1	104,400.0	376.4	0.5	0.2	0.8
09/12/2022 23:00	4,054.9	0.0	4,054.9	104,400.0	423.3	0.5	0.3	0.8
Average/Sum#:	3,826.6	0.1	3,826.6	104,225.0	398.9	0.5	0.2	0.8
Minimum:	2,936.9	0.0	2,936.9	103,800.0	305.2	0.4	0.2	0.6
Maximum:	4,608.4	1.9	4,608.4	104,400.0	478.4	0.6	0.3	1.0
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:30 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2	Unit CT2	Unit CT2
						PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/13/2022 00:00	4,062.8	0.0	4,062.8	104,400.0	424.2	0.5	0.3	0.8
09/13/2022 01:00	3,350.1	0.0	3,350.1	104,400.0	349.8	0.4	0.2	0.7
09/13/2022 02:00	3,045.6	0.0	3,045.6	104,400.0	318.0	0.4	0.2	0.6
09/13/2022 03:00	4,058.0	6.0	4,059.3	104,400.0	423.8	0.5	0.3	0.8
09/13/2022 04:00	4,739.6	321.9	5,061.5	104,400.0	528.4	0.6	0.3	1.1
09/13/2022 05:00	4,752.2	414.7	5,166.9	104,400.0	539.4	0.6	0.3	1.1
09/13/2022 06:00	4,565.6	180.3	4,659.4	104,400.0	486.4	0.6	0.3	1.0
09/13/2022 07:00	3,750.4	0.0	3,750.4	104,400.0	391.5	0.5	0.2	0.8
09/13/2022 08:00	3,133.2	0.0	3,133.2	104,400.0	327.1	0.4	0.2	0.7
09/13/2022 09:00	2,911.3	0.0	2,911.3	104,400.0	303.9	0.4	0.2	0.6
09/13/2022 10:00	3,001.7	0.0	3,001.7	104,400.0	313.4	0.4	0.2	0.6
09/13/2022 11:00	3,003.6	0.0	3,003.6	104,400.0	313.6	0.4	0.2	0.6
09/13/2022 12:00	2,879.5	0.0	2,879.5	104,400.0	300.6	0.4	0.2	0.6
09/13/2022 13:00	2,862.2	0.0	2,862.2	104,400.0	298.8	0.4	0.2	0.6
09/13/2022 14:00	2,913.0	0.0	2,913.0	104,400.0	304.1	0.4	0.2	0.6
09/13/2022 15:00	2,870.3	0.0	2,870.3	104,400.0	299.7	0.4	0.2	0.6
09/13/2022 16:00	3,579.9	0.0	3,579.9	104,400.0	373.7	0.4	0.2	0.7
09/13/2022 17:00	4,682.5	376.7	5,051.7	104,400.0	527.4	0.6	0.3	1.1
09/13/2022 18:00	4,711.6	264.5	4,976.1	104,400.0	519.5	0.6	0.3	1.0
09/13/2022 19:00	4,725.2	265.4	4,990.6	104,400.0	521.0	0.6	0.3	1.0
09/13/2022 20:00	4,739.7	214.5	4,954.2	104,400.0	517.2	0.6	0.3	1.0
09/13/2022 21:00	4,702.6	151.1	4,818.9	104,400.0	503.1	0.6	0.3	1.0
09/13/2022 22:00	3,099.9	0.0	3,099.9	104,400.0	323.6	0.4	0.2	0.6
09/13/2022 23:00	3,758.6	0.0	3,758.6	104,400.0	392.4	0.5	0.2	0.8
Average/Sum#:	3,745.8	91.5	3,831.7	104,400.0	400.0	0.5	0.2	0.8
Minimum:	2,862.2	0.0	2,862.2	104,400.0	298.8	0.4	0.2	0.6
Maximum:	4,752.2	414.7	5,166.9	104,400.0	539.4	0.6	0.3	1.1
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:30 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2	Unit CT2	Unit CT2
						PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/14/2022 00:00	3,428.6	0.0	3,428.6	104,400.0	357.9	0.4	0.2	0.7
09/14/2022 01:00	3,233.6	0.0	3,233.6	104,400.0	337.6	0.4	0.2	0.7
09/14/2022 02:00	3,275.8	0.0	3,275.8	104,400.0	342.0	0.4	0.2	0.7
09/14/2022 03:00	3,842.2	0.0	3,842.2	104,400.0	401.1	0.5	0.2	0.8
09/14/2022 04:00	4,169.6	0.0	4,169.6	104,400.0	435.3	0.5	0.3	0.9
09/14/2022 05:00	4,515.8	0.0	4,515.8	104,400.0	471.4	0.6	0.3	0.9
09/14/2022 06:00	3,638.4	0.0	3,638.4	104,400.0	379.8	0.5	0.2	0.8
09/14/2022 07:00	2,899.2	0.0	2,899.2	104,400.0	302.7	0.4	0.2	0.6
09/14/2022 08:00	2,842.6	0.0	2,842.6	104,400.0	296.8	0.4	0.2	0.6
09/14/2022 09:00	2,822.3	0.0	2,822.3	104,400.0	294.6	0.4	0.2	0.6
09/14/2022 10:00	2,853.3	0.0	2,853.3	104,400.0	297.9	0.4	0.2	0.6
09/14/2022 11:00	2,855.4	0.0	2,855.4	104,400.0	298.1	0.4	0.2	0.6
09/14/2022 12:00	2,849.2	0.0	2,849.2	104,400.0	297.5	0.4	0.2	0.6
09/14/2022 13:00	2,848.7	0.0	2,848.7	104,400.0	297.4	0.4	0.2	0.6
09/14/2022 14:00	2,849.6	0.0	2,849.6	104,400.0	297.5	0.4	0.2	0.6
09/14/2022 15:00	2,842.5	0.0	2,842.5	104,400.0	296.8	0.4	0.2	0.6
09/14/2022 16:00	2,905.9	0.0	2,905.9	104,400.0	303.4	0.4	0.2	0.6
09/14/2022 17:00	3,216.2	0.0	3,216.2	104,400.0	335.8	0.4	0.2	0.7
09/14/2022 18:00	3,566.1	0.0	3,566.1	104,400.0	372.3	0.4	0.2	0.7
09/14/2022 19:00	3,591.7	0.0	3,591.7	104,400.0	375.0	0.4	0.2	0.8
09/14/2022 20:00	3,552.8	0.0	3,552.8	104,400.0	370.9	0.4	0.2	0.7
09/14/2022 21:00	3,595.3	0.0	3,595.3	104,400.0	375.3	0.4	0.2	0.8
09/14/2022 22:00	2,966.8	0.0	2,966.8	104,400.0	309.7	0.4	0.2	0.6
09/14/2022 23:00	3,129.4	0.0	3,129.4	104,400.0	326.7	0.4	0.2	0.7
Average/Sum#:	3,262.1	0.0	3,262.1	104,400.0	340.6	0.4	0.2	0.7
Minimum:	2,822.3	0.0	2,822.3	104,400.0	294.6	0.4	0.2	0.6
Maximum:	4,515.8	0.0	4,515.8	104,400.0	471.4	0.6	0.3	0.9
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:30 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2	Unit CT2	Unit CT2
						PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/15/2022 00:00	2,965.9	0.0	2,965.9	104,400.0	309.6	0.4	0.2	0.6
09/15/2022 01:00	3,086.3	0.0	3,086.3	104,400.0	322.2	0.4	0.2	0.6
09/15/2022 02:00	3,122.1	0.0	3,122.1	104,400.0	325.9	0.4	0.2	0.7
09/15/2022 03:00	3,461.1	0.0	3,461.1	104,400.0	361.3	0.4	0.2	0.7
09/15/2022 04:00	3,920.9	0.0	3,920.9	104,400.0	409.3	0.5	0.2	0.8
09/15/2022 05:00	4,347.1	0.0	4,347.1	104,400.0	453.8	0.5	0.3	0.9
09/15/2022 06:00	3,503.1	0.0	3,503.1	104,400.0	365.7	0.4	0.2	0.7
09/15/2022 07:00	3,282.8	0.0	3,282.8	104,400.0	342.7	0.4	0.2	0.7
09/15/2022 08:00	2,872.5	0.0	2,872.5	104,400.0	299.9	0.4	0.2	0.6
09/15/2022 09:00	2,870.4	0.0	2,870.4	104,400.0	299.7	0.4	0.2	0.6
09/15/2022 10:00	4,154.7	61.7	4,172.0	104,400.0	435.6	0.5	0.3	0.9
09/15/2022 11:00	4,721.0	222.8	4,943.8	104,400.0	516.1	0.6	0.3	1.0
09/15/2022 12:00	3,396.5	1.3	3,396.5	104,400.0	354.6	0.4	0.2	0.7
09/15/2022 13:00	2,876.7	0.0	2,876.7	104,400.0	300.3	0.4	0.2	0.6
09/15/2022 14:00	3,183.7	0.0	3,183.7	104,400.0	332.4	0.4	0.2	0.7
09/15/2022 15:00	2,930.9	0.0	2,930.9	104,400.0	306.0	0.4	0.2	0.6
09/15/2022 16:00	2,928.9	0.0	2,928.9	104,400.0	305.8	0.4	0.2	0.6
09/15/2022 17:00	3,515.6	0.0	3,515.6	104,400.0	367.0	0.4	0.2	0.7
09/15/2022 18:00	3,057.3	0.0	3,057.3	104,400.0	319.2	0.4	0.2	0.6
09/15/2022 19:00	3,234.4	0.0	3,234.4	104,400.0	337.7	0.4	0.2	0.7
09/15/2022 20:00	3,137.1	0.0	3,137.1	104,400.0	327.5	0.4	0.2	0.7
09/15/2022 21:00	3,199.3	0.0	3,199.3	104,400.0	334.0	0.4	0.2	0.7
09/15/2022 22:00	3,024.8	0.0	3,024.8	104,400.0	315.8	0.4	0.2	0.6
09/15/2022 23:00	2,962.8	0.0	2,962.8	104,400.0	309.3	0.4	0.2	0.6
Average/Sum#:	3,323.2	11.9	3,333.2	104,400.0	348.0	0.4	0.2	0.7
Minimum:	2,870.4	0.0	2,870.4	104,400.0	299.7	0.4	0.2	0.6
Maximum:	4,721.0	222.8	4,943.8	104,400.0	516.1	0.6	0.3	1.0
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:30 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2	Unit CT2	Unit CT2
						PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/16/2022 00:00	2,937.4	0.0	2,937.4	104,400.0	306.7	0.4	0.2	0.6
09/16/2022 01:00	2,833.2	0.0	2,833.2	104,400.0	295.8	0.4	0.2	0.6
09/16/2022 02:00	2,834.0	0.0	2,834.0	104,400.0	295.9	0.4	0.2	0.6
09/16/2022 03:00	2,846.4	0.0	2,846.4	104,400.0	297.2	0.4	0.2	0.6
09/16/2022 04:00	2,964.3	0.0	2,964.3	104,400.0	309.5	0.4	0.2	0.6
09/16/2022 05:00	3,583.1	0.0	3,583.1	104,400.0	374.1	0.4	0.2	0.7
09/16/2022 06:00	3,342.2	0.0	3,342.2	104,400.0	348.9	0.4	0.2	0.7
09/16/2022 07:00	2,833.0	0.0	2,833.0	104,400.0	295.8	0.4	0.2	0.6
09/16/2022 08:00	2,859.0	0.0	2,859.0	104,400.0	298.5	0.4	0.2	0.6
09/16/2022 09:00	2,822.2	0.0	2,822.2	104,400.0	294.6	0.4	0.2	0.6
09/16/2022 10:00	2,819.4	0.0	2,819.4	104,400.0	294.3	0.4	0.2	0.6
09/16/2022 11:00	2,830.1	0.0	2,830.1	104,400.0	295.5	0.4	0.2	0.6
09/16/2022 12:00	2,804.2	0.0	2,804.2	104,400.0	292.8	0.4	0.2	0.6
09/16/2022 13:00	2,809.7	0.0	2,809.7	104,400.0	293.3	0.4	0.2	0.6
09/16/2022 14:00	3,060.0	0.0	3,060.0	104,400.0	319.5	0.4	0.2	0.6
09/16/2022 15:00	2,853.4	0.0	2,853.4	104,400.0	297.9	0.4	0.2	0.6
09/16/2022 16:00	2,830.9	0.0	2,830.9	104,400.0	295.5	0.4	0.2	0.6
09/16/2022 17:00	2,920.5	0.0	2,920.5	104,400.0	304.9	0.4	0.2	0.6
09/16/2022 18:00	2,933.3	0.0	2,933.3	104,400.0	306.2	0.4	0.2	0.6
09/16/2022 19:00	2,932.8	0.0	2,932.8	104,400.0	306.2	0.4	0.2	0.6
09/16/2022 20:00	2,937.1	0.0	2,937.1	104,400.0	306.6	0.4	0.2	0.6
09/16/2022 21:00	2,936.6	0.0	2,936.6	104,400.0	306.6	0.4	0.2	0.6
09/16/2022 22:00	2,892.1	0.0	2,892.1	104,400.0	301.9	0.4	0.2	0.6
09/16/2022 23:00	2,938.3	0.0	2,938.3	104,400.0	306.8	0.4	0.2	0.6
Average/Sum#:	2,931.4	0.0	2,931.4	104,400.0	306.0	0.4	0.2	0.6
Minimum:	2,804.2	0.0	2,804.2	104,400.0	292.8	0.4	0.2	0.6
Maximum:	3,583.1	0.0	3,583.1	104,400.0	374.1	0.4	0.2	0.7
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:30 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2	Unit CT2	Unit CT2
						PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/17/2022 00:00	2,949.4	0.0	2,949.4	104,400.0	307.9	0.4	0.2	0.6
09/17/2022 01:00	2,958.0	0.0	2,958.0	104,400.0	308.8	0.4	0.2	0.6
09/17/2022 02:00	2,957.3	0.0	2,957.3	104,400.0	308.7	0.4	0.2	0.6
09/17/2022 03:00	2,958.0	0.0	2,958.0	104,400.0	308.8	0.4	0.2	0.6
09/17/2022 04:00	3,040.8	0.0	3,040.8	104,400.0	317.5	0.4	0.2	0.6
09/17/2022 05:00	2,959.5	0.0	2,959.5	104,400.0	309.0	0.4	0.2	0.6
09/17/2022 06:00	2,828.1	0.0	2,828.1	104,400.0	295.3	0.4	0.2	0.6
09/17/2022 07:00	2,829.5	0.0	2,829.5	104,400.0	295.4	0.4	0.2	0.6
09/17/2022 08:00	2,826.6	0.0	2,826.6	104,400.0	295.1	0.4	0.2	0.6
09/17/2022 09:00	2,822.4	0.0	2,822.4	104,400.0	294.7	0.4	0.2	0.6
09/17/2022 10:00	2,819.8	0.0	2,819.8	104,400.0	294.4	0.4	0.2	0.6
09/17/2022 11:00	2,818.4	0.0	2,818.4	104,400.0	294.2	0.4	0.2	0.6
09/17/2022 12:00	2,813.8	0.0	2,813.8	104,400.0	293.8	0.4	0.2	0.6
09/17/2022 13:00	2,801.0	0.0	2,801.0	104,400.0	292.4	0.4	0.2	0.6
09/17/2022 14:00	2,802.1	0.0	2,802.1	104,400.0	292.5	0.4	0.2	0.6
09/17/2022 15:00	2,800.1	0.0	2,800.1	104,400.0	292.3	0.4	0.2	0.6
09/17/2022 16:00	2,948.8	0.0	2,948.8	104,400.0	307.9	0.4	0.2	0.6
09/17/2022 17:00	3,199.9	0.0	3,199.9	104,400.0	334.1	0.4	0.2	0.7
09/17/2022 18:00	2,948.3	0.0	2,948.3	104,400.0	307.8	0.4	0.2	0.6
09/17/2022 19:00	2,846.4	0.0	2,846.4	104,400.0	297.2	0.4	0.2	0.6
09/17/2022 20:00	2,875.1	0.0	2,875.1	104,400.0	300.2	0.4	0.2	0.6
09/17/2022 21:00	3,133.7	0.0	3,133.7	104,400.0	327.2	0.4	0.2	0.7
09/17/2022 22:00	3,115.4	0.0	3,115.4	104,400.0	325.2	0.4	0.2	0.7
09/17/2022 23:00	2,952.6	0.0	2,952.6	104,400.0	308.3	0.4	0.2	0.6
Average/Sum#:	2,916.9	0.0	2,916.9	104,400.0	304.5	0.4	0.2	0.6
Minimum:	2,800.1	0.0	2,800.1	104,400.0	292.3	0.4	0.2	0.6
Maximum:	3,199.9	0.0	3,199.9	104,400.0	334.1	0.4	0.2	0.7
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:30 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2	Unit CT2	Unit CT2
						PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/18/2022 00:00	2,950.3	0.0	2,950.3	104,400.0	308.0	0.4	0.2	0.6
09/18/2022 01:00	2,955.1	0.0	2,955.1	104,400.0	308.5	0.4	0.2	0.6
09/18/2022 02:00	2,958.5	0.0	2,958.5	104,400.0	308.9	0.4	0.2	0.6
09/18/2022 03:00	2,957.5	0.0	2,957.5	104,400.0	308.8	0.4	0.2	0.6
09/18/2022 04:00	2,888.1	0.0	2,888.1	104,400.0	301.5	0.4	0.2	0.6
09/18/2022 05:00	2,830.0	0.0	2,830.0	104,400.0	295.5	0.4	0.2	0.6
09/18/2022 06:00	2,965.1	0.0	2,965.1	104,400.0	309.6	0.4	0.2	0.6
09/18/2022 07:00	2,988.2	0.0	2,988.2	104,400.0	312.0	0.4	0.2	0.6
09/18/2022 08:00	2,945.7	0.0	2,945.7	104,400.0	307.5	0.4	0.2	0.6
09/18/2022 09:00	2,939.1	0.0	2,939.1	104,400.0	306.8	0.4	0.2	0.6
09/18/2022 10:00	2,903.8	0.0	2,903.8	104,400.0	303.2	0.4	0.2	0.6
09/18/2022 11:00	3,049.3	0.0	3,049.3	104,400.0	318.3	0.4	0.2	0.6
09/18/2022 12:00	3,361.1	0.0	3,361.1	104,400.0	350.9	0.4	0.2	0.7
09/18/2022 13:00	3,760.4	0.0	3,760.4	104,400.0	392.6	0.5	0.2	0.8
09/18/2022 14:00	3,210.6	0.0	3,210.6	104,400.0	335.2	0.4	0.2	0.7
09/18/2022 15:00	3,078.0	0.0	3,078.0	104,400.0	321.3	0.4	0.2	0.6
09/18/2022 16:00	3,691.4	0.0	3,691.4	104,400.0	385.4	0.5	0.2	0.8
09/18/2022 17:00	4,228.7	0.0	4,228.7	104,400.0	441.5	0.5	0.3	0.9
09/18/2022 18:00	4,127.1	0.0	4,127.1	104,400.0	430.9	0.5	0.3	0.9
09/18/2022 19:00	4,291.7	0.0	4,291.7	104,400.0	448.1	0.5	0.3	0.9
09/18/2022 20:00	4,396.3	0.0	4,396.3	104,400.0	459.0	0.6	0.3	0.9
09/18/2022 21:00	4,291.9	0.0	4,291.9	104,400.0	448.1	0.5	0.3	0.9
09/18/2022 22:00	2,894.9	0.0	2,894.9	104,400.0	302.2	0.4	0.2	0.6
09/18/2022 23:00	2,951.3	0.0	2,951.3	104,400.0	308.1	0.4	0.2	0.6
Average/Sum#:	3,317.3	0.0	3,317.3	104,400.0	346.3	0.4	0.2	0.7
Minimum:	2,830.0	0.0	2,830.0	104,400.0	295.5	0.4	0.2	0.6
Maximum:	4,396.3	0.0	4,396.3	104,400.0	459.0	0.6	0.3	0.9
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:30 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2	Unit CT2	Unit CT2
						PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/19/2022 00:00	2,963.7	0.0	2,963.7	104,400.0	309.4	0.4	0.2	0.6
09/19/2022 01:00	2,967.3	0.0	2,967.3	104,400.0	309.8	0.4	0.2	0.6
09/19/2022 02:00	2,967.0	0.0	2,967.0	104,400.0	309.8	0.4	0.2	0.6
09/19/2022 03:00	2,965.1	0.0	2,965.1	104,400.0	309.6	0.4	0.2	0.6
09/19/2022 04:00	3,543.4	0.0	3,543.4	104,400.0	369.9	0.4	0.2	0.7
09/19/2022 05:00	4,376.3	0.0	4,376.3	104,400.0	456.9	0.5	0.3	0.9
09/19/2022 06:00	4,104.7	0.0	4,104.7	104,400.0	428.5	0.5	0.3	0.9
09/19/2022 07:00	4,375.9	0.0	4,375.9	104,400.0	456.8	0.5	0.3	0.9
09/19/2022 08:00	4,710.8	0.0	4,710.8	104,400.0	491.8	0.6	0.3	1.0
09/19/2022 09:00	3,571.2	0.0	3,571.2	104,400.0	372.8	0.4	0.2	0.7
09/19/2022 10:00	2,954.1	0.0	2,954.1	104,400.0	308.4	0.4	0.2	0.6
09/19/2022 11:00	3,226.9	0.0	3,226.9	104,400.0	336.9	0.4	0.2	0.7
09/19/2022 12:00	3,086.9	0.0	3,086.9	104,400.0	322.3	0.4	0.2	0.6
09/19/2022 13:00	3,149.4	0.0	3,149.4	104,400.0	328.8	0.4	0.2	0.7
09/19/2022 14:00	3,060.7	0.0	3,060.7	104,400.0	319.5	0.4	0.2	0.6
09/19/2022 15:00	2,955.5	0.0	2,955.5	104,400.0	308.6	0.4	0.2	0.6
09/19/2022 16:00	4,093.5	74.5	4,114.4	104,400.0	429.5	0.5	0.3	0.9
09/19/2022 17:00	4,684.0	1,258.5	5,942.5	104,400.0	620.4	0.7	0.4	1.2
09/19/2022 18:00	4,669.2	963.3	5,632.5	104,400.0	588.0	0.7	0.4	1.2
09/19/2022 19:00	4,671.1	753.0	5,424.1	104,400.0	566.3	0.7	0.3	1.1
09/19/2022 20:00	4,694.3	594.5	5,288.8	104,400.0	552.2	0.7	0.3	1.1
09/19/2022 21:00	4,725.4	372.7	5,098.1	104,400.0	532.2	0.6	0.3	1.1
09/19/2022 22:00	4,089.3	61.1	4,115.6	104,400.0	429.7	0.5	0.3	0.9
09/19/2022 23:00	4,097.0	0.0	4,097.0	104,400.0	427.7	0.5	0.3	0.9
Average/Sum#:	3,779.3	169.9	3,945.5	104,400.0	411.9	0.5	0.3	0.8
Minimum:	2,954.1	0.0	2,954.1	104,400.0	308.4	0.4	0.2	0.6
Maximum:	4,725.4	1,258.5	5,942.5	104,400.0	620.4	0.7	0.4	1.2
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:30 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/20/2022 00:00	3,965.8	0.0	3,965.8	104,400.0	414.0	0.5	0.2	0.8
09/20/2022 01:00	3,352.5	0.0	3,352.5	104,400.0	350.0	0.4	0.2	0.7
09/20/2022 02:00	3,137.8	0.0	3,137.8	104,400.0	327.6	0.4	0.2	0.7
09/20/2022 03:00	4,362.9	0.0	4,362.9	104,400.0	455.5	0.5	0.3	0.9
09/20/2022 04:00	4,753.4	5.7	4,753.7	104,400.0	496.3	0.6	0.3	1.0
09/20/2022 05:00	4,698.6	0.0	4,698.6	104,400.0	490.5	0.6	0.3	1.0
09/20/2022 06:00	3,630.1	0.0	3,630.1	104,400.0	379.0	0.5	0.2	0.8
09/20/2022 07:00	3,017.2	0.0	3,017.2	104,400.0	315.0	0.4	0.2	0.6
09/20/2022 08:00	3,060.0	0.0	3,060.0	104,400.0	319.5	0.4	0.2	0.6
09/20/2022 09:00	3,007.1	0.0	3,007.1	104,400.0	313.9	0.4	0.2	0.6
09/20/2022 10:00	2,830.0	0.0	2,830.0	104,400.0	295.5	0.4	0.2	0.6
09/20/2022 11:00	3,507.9	0.0	3,507.9	104,400.0	366.2	0.4	0.2	0.7
09/20/2022 12:00	3,047.8	0.0	3,047.8	104,400.0	318.2	0.4	0.2	0.6
09/20/2022 13:00	2,994.8	0.0	2,994.8	104,400.0	312.7	0.4	0.2	0.6
09/20/2022 14:00	2,963.4	0.0	2,963.4	104,400.0	309.4	0.4	0.2	0.6
09/20/2022 15:00	2,905.7	0.0	2,905.7	104,400.0	303.4	0.4	0.2	0.6
09/20/2022 16:00	3,927.2	102.7	3,956.0	104,400.0	413.0	0.5	0.3	0.8
09/20/2022 17:00	4,645.8	1,131.6	5,777.4	104,400.0	603.2	0.7	0.4	1.2
09/20/2022 18:00	4,598.4	1,217.8	5,816.2	104,400.0	607.2	0.7	0.4	1.2
09/20/2022 19:00	4,634.7	891.8	5,526.5	104,400.0	577.0	0.7	0.3	1.2
09/20/2022 20:00	4,636.8	992.6	5,629.4	104,400.0	587.7	0.7	0.4	1.2
09/20/2022 21:00	4,632.2	955.3	5,587.5	104,400.0	583.3	0.7	0.4	1.2
09/20/2022 22:00	4,645.2	572.5	5,217.7	104,400.0	544.7	0.7	0.3	1.1
09/20/2022 23:00	4,575.1	1.6	4,575.1	104,400.0	477.6	0.6	0.3	1.0
Average/Sum#:	3,813.8	244.7	4,055.0	104,400.0	423.4	0.5	0.3	0.8
Minimum:	2,830.0	0.0	2,830.0	104,400.0	295.5	0.4	0.2	0.6
Maximum:	4,753.4	1,217.8	5,816.2	104,400.0	607.2	0.7	0.4	1.2
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:30 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2	Unit CT2	Unit CT2
						PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/21/2022 00:00	4,533.8	0.0	4,533.8	104,400.0	473.3	0.6	0.3	0.9
09/21/2022 01:00	4,054.7	0.0	4,054.7	104,400.0	423.3	0.5	0.3	0.8
09/21/2022 02:00	4,101.7	0.0	4,101.7	104,400.0	428.2	0.5	0.3	0.9
09/21/2022 03:00	4,762.1	0.0	4,762.1	104,400.0	497.2	0.6	0.3	1.0
09/21/2022 04:00	4,768.1	0.0	4,768.1	104,400.0	497.8	0.6	0.3	1.0
09/21/2022 05:00	4,716.8	0.0	4,716.8	104,400.0	492.4	0.6	0.3	1.0
09/21/2022 06:00	3,924.4	0.0	3,924.4	104,400.0	409.7	0.5	0.2	0.8
09/21/2022 07:00	4,642.2	0.0	4,642.2	104,400.0	484.6	0.6	0.3	1.0
09/21/2022 08:00	4,510.8	0.0	4,510.8	104,400.0	470.9	0.6	0.3	0.9
09/21/2022 09:00	4,386.6	0.0	4,386.6	104,400.0	458.0	0.5	0.3	0.9
09/21/2022 10:00	3,439.4	0.0	3,439.4	104,400.0	359.1	0.4	0.2	0.7
09/21/2022 11:00	4,212.2	0.0	4,212.2	104,400.0	439.8	0.5	0.3	0.9
09/21/2022 12:00	3,017.9	0.0	3,017.9	104,400.0	315.1	0.4	0.2	0.6
09/21/2022 13:00	2,957.1	0.0	2,957.1	104,400.0	308.7	0.4	0.2	0.6
09/21/2022 14:00	4,027.7	0.0	4,027.7	104,400.0	420.5	0.5	0.3	0.8
09/21/2022 15:00	2,931.4	0.0	2,931.4	104,400.0	306.0	0.4	0.2	0.6
09/21/2022 16:00	3,551.7	0.0	3,551.7	104,400.0	370.8	0.4	0.2	0.7
09/21/2022 17:00	4,243.4	0.0	4,243.4	104,400.0	443.0	0.5	0.3	0.9
09/21/2022 18:00	3,884.9	0.0	3,884.9	104,400.0	405.6	0.5	0.2	0.8
09/21/2022 19:00	3,526.6	0.0	3,526.6	104,400.0	368.2	0.4	0.2	0.7
09/21/2022 20:00	3,341.5	0.0	3,341.5	104,400.0	348.9	0.4	0.2	0.7
09/21/2022 21:00	2,952.2	0.0	2,952.2	104,400.0	308.2	0.4	0.2	0.6
09/21/2022 22:00	2,899.3	0.0	2,899.3	104,400.0	302.7	0.4	0.2	0.6
09/21/2022 23:00	2,969.1	0.0	2,969.1	104,400.0	310.0	0.4	0.2	0.6
Average/Sum#:	3,848.2	0.0	3,848.2	104,400.0	401.8	0.5	0.3	0.8
Minimum:	2,899.3	0.0	2,899.3	104,400.0	302.7	0.4	0.2	0.6
Maximum:	4,768.1	0.0	4,768.1	104,400.0	497.8	0.6	0.3	1.0
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:30 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2	Unit CT2	Unit CT2
						PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/22/2022 00:00	2,975.8	0.0	2,975.8	104,400.0	310.7	0.4	0.2	0.6
09/22/2022 01:00	2,979.5	0.0	2,979.5	104,400.0	311.1	0.4	0.2	0.6
09/22/2022 02:00	2,976.6	0.0	2,976.6	104,400.0	310.8	0.4	0.2	0.6
09/22/2022 03:00	2,974.7	0.0	2,974.7	104,400.0	310.6	0.4	0.2	0.6
09/22/2022 04:00	3,359.0	0.0	3,359.0	104,400.0	350.7	0.4	0.2	0.7
09/22/2022 05:00	3,725.6	0.0	3,725.6	104,400.0	389.0	0.5	0.2	0.8
09/22/2022 06:00	3,442.3	0.0	3,442.3	104,400.0	359.4	0.4	0.2	0.7
09/22/2022 07:00	3,877.1	0.0	3,877.1	104,400.0	404.8	0.5	0.2	0.8
09/22/2022 08:00	3,833.2	0.0	3,833.2	104,400.0	400.2	0.5	0.2	0.8
09/22/2022 09:00	3,829.2	0.0	3,829.2	104,400.0	399.8	0.5	0.2	0.8
09/22/2022 10:00	3,817.4	0.0	3,817.4	104,400.0	398.5	0.5	0.2	0.8
09/22/2022 11:00	3,803.8	0.0	3,803.8	104,400.0	397.1	0.5	0.2	0.8
09/22/2022 12:00	3,799.6	0.0	3,799.6	104,400.0	396.7	0.5	0.2	0.8
09/22/2022 13:00	3,458.4	0.0	3,458.4	104,400.0	361.1	0.4	0.2	0.7
09/22/2022 14:00	2,859.3	0.0	2,859.3	104,400.0	298.5	0.4	0.2	0.6
09/22/2022 15:00	2,843.2	0.0	2,843.2	104,400.0	296.8	0.4	0.2	0.6
09/22/2022 16:00	3,191.0	0.0	3,191.0	104,400.0	333.1	0.4	0.2	0.7
09/22/2022 17:00	2,970.6	0.0	2,970.6	104,400.0	310.1	0.4	0.2	0.6
09/22/2022 18:00	2,986.0	0.0	2,986.0	104,400.0	311.7	0.4	0.2	0.6
09/22/2022 19:00	3,319.0	0.0	3,319.0	104,400.0	346.5	0.4	0.2	0.7
09/22/2022 20:00	3,624.4	0.0	3,624.4	104,400.0	378.4	0.5	0.2	0.8
09/22/2022 21:00	3,768.7	0.0	3,768.7	104,400.0	393.5	0.5	0.2	0.8
09/22/2022 22:00	4,159.8	0.0	4,159.8	104,400.0	434.3	0.6	0.3	0.9
09/22/2022 23:00	1,089.0	0.0	1,089.0	104,400.0	113.7	0.0	0.0	0.0
Average/Sum#:	3,319.3	0.0	3,319.3	104,400.0	346.5	0.4	0.2	0.7
Minimum:	1,089.0	0.0	1,089.0	104,400.0	113.7	0.4	0.2	0.6
Maximum:	4,159.8	0.0	4,159.8	104,400.0	434.3	0.6	0.3	0.9
%SI	0.00	0.00	0.00	0.00	0.00	4.17	4.17	4.17

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:30 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2 GasFlow, _CT, 100scfh	Unit CT2 GasFlow, _DB, 100scfh	Unit CT2 GasFlowTotal, 100scfh	Unit CT2 GCVGas, BtuPer100scf	Unit CT2 HI, MBtuPerHr	> 4.73 Unit CT2 PM10_Norm, LbPerHr	> 1 Unit CT2 SO2_Norm, LbPerHr	> 1.8 Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/23/2022 00:00	0.0	0.0	0.0	104,400.0	0.0	0.0	0.0	0.0
09/23/2022 01:00	0.0	0.0	0.0	104,400.0	0.0	0.0	0.0	0.0
09/23/2022 02:00	0.0	0.0	0.0	104,400.0	0.0	0.0	0.0	0.0
09/23/2022 03:00	0.0	0.0	0.0	104,400.0	0.0	0.0	0.0	0.0
09/23/2022 04:00	0.0	0.0	0.0	104,400.0	0.0	0.0	0.0	0.0
09/23/2022 05:00	0.0	0.0	0.0	104,400.0	0.0	0.0	0.0	0.0
09/23/2022 06:00	0.0	0.0	0.0	104,400.0	0.0	0.0	0.0	0.0
09/23/2022 07:00	0.0	0.0	0.0	104,400.0	0.0	0.0	0.0	0.0
09/23/2022 08:00	0.0	0.0	0.0	104,400.0	0.0	0.0	0.0	0.0
09/23/2022 09:00	0.0	0.0	0.0	104,400.0	0.0	0.0	0.0	0.0
09/23/2022 10:00	0.0	0.0	0.0	104,400.0	0.0	0.0	0.0	0.0
09/23/2022 11:00	0.0	0.0	0.0	104,400.0	0.0	0.0	0.0	0.0
09/23/2022 12:00	0.0	0.0	0.0	104,400.0	0.0	0.0	0.0	0.0
09/23/2022 13:00	0.0	0.0	0.0	104,400.0	0.0	0.0	0.0	0.0
09/23/2022 14:00	0.0	0.0	0.0	104,400.0	0.0	0.0	0.0	0.0
09/23/2022 15:00	1,366.3	0.0	1,366.3	104,400.0	142.6	0.0	0.0	0.0
09/23/2022 16:00	3,932.5	0.0	3,932.5	104,400.0	410.6	0.6	0.3	0.9
09/23/2022 17:00	4,565.8	534.6	5,084.4	104,400.0	530.8	0.6	0.3	1.1
09/23/2022 18:00	4,615.2	412.5	5,027.7	104,400.0	524.9	0.6	0.3	1.0
09/23/2022 19:00	4,625.7	381.7	5,007.4	104,400.0	522.8	0.6	0.3	1.0
09/23/2022 20:00	4,544.5	595.9	5,140.4	104,400.0	536.7	0.6	0.3	1.1
09/23/2022 21:00	4,545.4	688.4	5,233.8	104,400.0	546.4	0.7	0.3	1.1
09/23/2022 22:00	4,128.5	95.1	4,157.0	104,400.0	434.0	0.5	0.3	0.9
09/23/2022 23:00	4,138.0	0.0	4,138.0	104,400.0	432.0	0.5	0.3	0.9
Average/Sum#:	4,051.3	300.9	4,343.1	104,400.0	453.4	0.6	0.3	1.0
Minimum:	1,366.3	0.0	1,366.3	104,400.0	142.6	0.5	0.3	0.9
Maximum:	4,625.7	688.4	5,233.8	104,400.0	546.4	0.7	0.3	1.1
%SI	62.50	62.50	62.50	0.00	62.50	66.67	66.67	66.67

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:30 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2	Unit CT2	Unit CT2
						PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/24/2022 00:00	3,529.2	0.0	3,529.2	104,400.0	368.4	0.4	0.2	0.7
09/24/2022 01:00	3,318.9	0.0	3,318.9	104,400.0	346.5	0.4	0.2	0.7
09/24/2022 02:00	3,866.8	0.0	3,866.8	104,400.0	403.7	0.5	0.2	0.8
09/24/2022 03:00	4,147.1	0.0	4,147.1	104,400.0	433.0	0.5	0.3	0.9
09/24/2022 04:00	4,373.9	0.0	4,373.9	104,400.0	456.6	0.5	0.3	0.9
09/24/2022 05:00	4,144.7	0.0	4,144.7	104,400.0	432.7	0.5	0.3	0.9
09/24/2022 06:00	3,038.5	0.0	3,038.5	104,400.0	317.2	0.4	0.2	0.6
09/24/2022 07:00	2,837.0	0.0	2,837.0	104,400.0	296.2	0.4	0.2	0.6
09/24/2022 08:00	2,832.8	0.0	2,832.8	104,400.0	295.7	0.4	0.2	0.6
09/24/2022 09:00	2,827.7	0.0	2,827.7	104,400.0	295.2	0.4	0.2	0.6
09/24/2022 10:00	2,823.7	0.0	2,823.7	104,400.0	294.8	0.4	0.2	0.6
09/24/2022 11:00	2,817.8	0.0	2,817.8	104,400.0	294.2	0.4	0.2	0.6
09/24/2022 12:00	2,885.3	0.0	2,885.3	104,400.0	301.2	0.4	0.2	0.6
09/24/2022 13:00	2,961.8	0.0	2,961.8	104,400.0	309.2	0.4	0.2	0.6
09/24/2022 14:00	3,899.7	49.9	3,914.7	104,400.0	408.7	0.5	0.2	0.8
09/24/2022 15:00	4,129.5	54.5	4,139.3	104,400.0	432.1	0.5	0.3	0.9
09/24/2022 16:00	4,190.3	52.4	4,206.0	104,400.0	439.1	0.5	0.3	0.9
09/24/2022 17:00	4,387.0	36.7	4,394.3	104,400.0	458.8	0.6	0.3	0.9
09/24/2022 18:00	4,064.4	0.0	4,064.4	104,400.0	424.3	0.5	0.3	0.8
09/24/2022 19:00	4,284.8	0.0	4,284.8	104,400.0	447.3	0.5	0.3	0.9
09/24/2022 20:00	4,590.0	0.0	4,590.0	104,400.0	479.2	0.6	0.3	1.0
09/24/2022 21:00	4,632.4	0.0	4,632.4	104,400.0	483.6	0.6	0.3	1.0
09/24/2022 22:00	4,488.9	0.0	4,488.9	104,400.0	468.6	0.6	0.3	0.9
09/24/2022 23:00	4,180.8	0.0	4,180.8	104,400.0	436.5	0.5	0.3	0.9
Average/Sum#:	3,718.9	8.1	3,720.9	104,400.0	388.5	0.5	0.3	0.8
Minimum:	2,817.8	0.0	2,817.8	104,400.0	294.2	0.4	0.2	0.6
Maximum:	4,632.4	54.5	4,632.4	104,400.0	483.6	0.6	0.3	1.0
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:30 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2	Unit CT2	Unit CT2
						PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/25/2022 00:00	3,837.3	0.0	3,837.3	104,400.0	400.6	0.5	0.2	0.8
09/25/2022 01:00	3,489.7	0.0	3,489.7	104,400.0	364.3	0.4	0.2	0.7
09/25/2022 02:00	4,200.3	0.0	4,200.3	104,400.0	438.5	0.5	0.3	0.9
09/25/2022 03:00	3,529.6	0.0	3,529.6	104,400.0	368.5	0.4	0.2	0.7
09/25/2022 04:00	3,056.4	0.0	3,056.4	104,400.0	319.1	0.4	0.2	0.6
09/25/2022 05:00	3,141.9	0.0	3,141.9	104,400.0	328.0	0.4	0.2	0.7
09/25/2022 06:00	2,853.7	0.0	2,853.7	104,400.0	297.9	0.4	0.2	0.6
09/25/2022 07:00	2,827.4	0.0	2,827.4	104,400.0	295.2	0.4	0.2	0.6
09/25/2022 08:00	2,825.5	0.0	2,825.5	104,400.0	295.0	0.4	0.2	0.6
09/25/2022 09:00	2,821.7	0.0	2,821.7	104,400.0	294.6	0.4	0.2	0.6
09/25/2022 10:00	2,819.1	0.0	2,819.1	104,400.0	294.3	0.4	0.2	0.6
09/25/2022 11:00	2,816.4	0.0	2,816.4	104,400.0	294.0	0.4	0.2	0.6
09/25/2022 12:00	2,807.1	0.0	2,807.1	104,400.0	293.1	0.4	0.2	0.6
09/25/2022 13:00	2,885.6	0.0	2,885.6	104,400.0	301.3	0.4	0.2	0.6
09/25/2022 14:00	3,076.7	0.0	3,076.7	104,400.0	321.2	0.4	0.2	0.6
09/25/2022 15:00	3,273.9	0.0	3,273.9	104,400.0	341.8	0.4	0.2	0.7
09/25/2022 16:00	4,057.5	12.5	4,058.8	104,400.0	423.7	0.5	0.3	0.9
09/25/2022 17:00	4,350.3	0.0	4,350.3	104,400.0	454.2	0.5	0.3	0.9
09/25/2022 18:00	4,267.0	0.0	4,267.0	104,400.0	445.5	0.5	0.3	0.9
09/25/2022 19:00	4,135.8	0.0	4,135.8	104,400.0	431.8	0.5	0.3	0.9
09/25/2022 20:00	4,167.6	0.0	4,167.6	104,400.0	435.1	0.5	0.3	0.9
09/25/2022 21:00	3,831.9	0.0	3,831.9	104,400.0	400.1	0.5	0.2	0.8
09/25/2022 22:00	2,932.6	0.0	2,932.6	104,400.0	306.2	0.4	0.2	0.6
09/25/2022 23:00	2,972.9	0.0	2,972.9	104,400.0	310.4	0.4	0.2	0.6
Average/Sum#:	3,374.1	0.5	3,374.1	104,400.0	352.3	0.4	0.2	0.7
Minimum:	2,807.1	0.0	2,807.1	104,400.0	293.1	0.4	0.2	0.6
Maximum:	4,350.3	12.5	4,350.3	104,400.0	454.2	0.5	0.3	0.9
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:30 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2	Unit CT2	Unit CT2
	PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr					
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/26/2022 00:00	3,041.5	0.0	3,041.5	104,400.0	317.5	0.4	0.2	0.6
09/26/2022 01:00	2,961.6	0.0	2,961.6	104,400.0	309.2	0.4	0.2	0.6
09/26/2022 02:00	2,960.3	0.0	2,960.3	104,400.0	309.1	0.4	0.2	0.6
09/26/2022 03:00	2,961.5	0.0	2,961.5	104,400.0	309.2	0.4	0.2	0.6
09/26/2022 04:00	3,593.5	0.0	3,593.5	104,400.0	375.2	0.4	0.2	0.8
09/26/2022 05:00	3,525.9	0.0	3,525.9	104,400.0	368.1	0.4	0.2	0.7
09/26/2022 06:00	2,954.1	0.0	2,954.1	104,400.0	308.4	0.4	0.2	0.6
09/26/2022 07:00	2,817.9	0.0	2,817.9	104,400.0	294.2	0.4	0.2	0.6
09/26/2022 08:00	2,815.5	0.0	2,815.5	104,400.0	293.9	0.4	0.2	0.6
09/26/2022 09:00	2,812.5	0.0	2,812.5	104,400.0	293.6	0.4	0.2	0.6
09/26/2022 10:00	2,804.3	0.0	2,804.3	104,400.0	292.8	0.4	0.2	0.6
09/26/2022 11:00	2,805.5	0.0	2,805.5	104,400.0	292.9	0.4	0.2	0.6
09/26/2022 12:00	2,882.8	0.0	2,882.8	104,400.0	301.0	0.4	0.2	0.6
09/26/2022 13:00	2,924.7	0.0	2,924.7	104,400.0	305.3	0.4	0.2	0.6
09/26/2022 14:00	3,155.8	0.0	3,155.8	104,400.0	329.5	0.4	0.2	0.7
09/26/2022 15:00	3,501.0	0.0	3,501.0	104,400.0	365.5	0.4	0.2	0.7
09/26/2022 16:00	3,641.8	0.0	3,641.8	104,400.0	380.2	0.5	0.2	0.8
09/26/2022 17:00	3,695.5	0.0	3,695.5	104,400.0	385.8	0.5	0.2	0.8
09/26/2022 18:00	2,930.2	0.0	2,930.2	104,400.0	305.9	0.4	0.2	0.6
09/26/2022 19:00	2,925.7	0.0	2,925.7	104,400.0	305.4	0.4	0.2	0.6
09/26/2022 20:00	2,961.9	0.0	2,961.9	104,400.0	309.2	0.4	0.2	0.6
09/26/2022 21:00	3,424.2	0.0	3,424.2	104,400.0	357.5	0.4	0.2	0.7
09/26/2022 22:00	3,620.6	2.9	3,620.7	104,400.0	378.0	0.5	0.2	0.8
09/26/2022 23:00	4,715.1	475.6	5,190.7	104,400.0	541.9	0.7	0.3	1.1
Average/Sum#:	3,184.7	19.9	3,204.5	104,400.0	334.6	0.4	0.2	0.7
Minimum:	2,804.3	0.0	2,804.3	104,400.0	292.8	0.4	0.2	0.6
Maximum:	4,715.1	475.6	5,190.7	104,400.0	541.9	0.7	0.3	1.1
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:30 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2 PM10_Norm, LbPerHr	Unit CT2 SO2_Norm, LbPerHr	Unit CT2 VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/27/2022 00:00	4,734.8	588.0	5,322.8	104,400.0	555.7	0.7	0.3	1.1
09/27/2022 01:00	4,737.1	475.1	5,212.2	104,400.0	544.2	0.7	0.3	1.1
09/27/2022 02:00	4,774.1	423.0	5,197.1	104,400.0	542.6	0.7	0.3	1.1
09/27/2022 03:00	4,750.4	348.6	5,099.0	104,400.0	532.3	0.6	0.3	1.1
09/27/2022 04:00	4,815.0	583.2	5,398.2	104,400.0	563.6	0.7	0.3	1.1
09/27/2022 05:00	4,791.8	774.2	5,566.0	104,400.0	581.1	0.7	0.3	1.2
09/27/2022 06:00	4,817.4	259.2	5,076.6	104,400.0	530.0	0.6	0.3	1.1
09/27/2022 07:00	4,344.9	41.5	4,365.7	104,400.0	455.8	0.5	0.3	0.9
09/27/2022 08:00	2,815.8	0.0	2,815.8	104,400.0	294.0	0.4	0.2	0.6
09/27/2022 09:00	2,816.0	0.0	2,816.0	104,400.0	294.0	0.4	0.2	0.6
09/27/2022 10:00	2,838.8	0.0	2,838.8	104,400.0	296.4	0.4	0.2	0.6
09/27/2022 11:00	4,041.5	88.3	4,075.1	104,400.0	425.4	0.5	0.3	0.9
09/27/2022 12:00	4,678.4	614.9	5,293.3	104,400.0	552.6	0.7	0.3	1.1
09/27/2022 13:00	4,641.5	342.7	4,984.2	104,400.0	520.4	0.6	0.3	1.0
09/27/2022 14:00	4,615.0	372.6	4,987.6	104,400.0	520.7	0.6	0.3	1.0
09/27/2022 15:00	4,578.1	262.3	4,769.6	104,400.0	497.9	0.6	0.3	1.0
09/27/2022 16:00	3,060.2	0.0	3,060.2	104,400.0	319.5	0.4	0.2	0.6
09/27/2022 17:00	3,398.3	0.0	3,398.3	104,400.0	354.8	0.4	0.2	0.7
09/27/2022 18:00	4,686.1	296.8	4,977.0	104,400.0	519.6	0.6	0.3	1.0
09/27/2022 19:00	4,693.4	284.5	4,977.9	104,400.0	519.7	0.6	0.3	1.0
09/27/2022 20:00	4,711.1	258.8	4,969.9	104,400.0	518.9	0.6	0.3	1.0
09/27/2022 21:00	4,725.2	324.6	5,049.8	104,400.0	527.2	0.6	0.3	1.1
09/27/2022 22:00	4,765.7	224.5	4,990.2	104,400.0	521.0	0.6	0.3	1.0
09/27/2022 23:00	4,441.3	1.3	4,441.5	104,400.0	463.7	0.6	0.3	0.9
Average/Sum#:	4,303.0	273.5	4,570.1	104,400.0	477.1	0.6	0.3	1.0
Minimum:	2,815.8	0.0	2,815.8	104,400.0	294.0	0.4	0.2	0.6
Maximum:	4,817.4	774.2	5,566.0	104,400.0	581.1	0.7	0.3	1.2
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:30 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2	Unit CT2	Unit CT2
	PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr					
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/28/2022 00:00	4,357.9	0.0	4,357.9	104,400.0	455.0	0.5	0.3	0.9
09/28/2022 01:00	4,345.0	0.0	4,345.0	104,400.0	453.6	0.5	0.3	0.9
09/28/2022 02:00	4,354.6	0.0	4,354.6	104,400.0	454.6	0.5	0.3	0.9
09/28/2022 03:00	4,393.9	0.0	4,393.9	104,400.0	458.7	0.6	0.3	0.9
09/28/2022 04:00	4,432.7	0.0	4,432.7	104,400.0	462.8	0.6	0.3	0.9
09/28/2022 05:00	4,445.8	0.0	4,445.8	104,400.0	464.1	0.6	0.3	0.9
09/28/2022 06:00	4,279.8	0.0	4,279.8	104,400.0	446.8	0.5	0.3	0.9
09/28/2022 07:00	2,858.8	0.0	2,858.8	104,400.0	298.5	0.4	0.2	0.6
09/28/2022 08:00	2,822.7	0.0	2,822.7	104,400.0	294.7	0.4	0.2	0.6
09/28/2022 09:00	2,819.6	0.0	2,819.6	104,400.0	294.4	0.4	0.2	0.6
09/28/2022 10:00	2,842.4	0.0	2,842.4	104,400.0	296.7	0.4	0.2	0.6
09/28/2022 11:00	2,930.9	0.0	2,930.9	104,400.0	306.0	0.4	0.2	0.6
09/28/2022 12:00	2,922.9	0.0	2,922.9	104,400.0	305.2	0.4	0.2	0.6
09/28/2022 13:00	2,916.7	0.0	2,916.7	104,400.0	304.5	0.4	0.2	0.6
09/28/2022 14:00	3,373.8	0.0	3,373.8	104,400.0	352.2	0.4	0.2	0.7
09/28/2022 15:00	2,893.4	0.0	2,893.4	104,400.0	302.1	0.4	0.2	0.6
09/28/2022 16:00	2,819.9	0.0	2,819.9	104,400.0	294.4	0.4	0.2	0.6
09/28/2022 17:00	2,816.1	0.0	2,816.1	104,400.0	294.0	0.4	0.2	0.6
09/28/2022 18:00	2,905.7	0.0	2,905.7	104,400.0	303.4	0.4	0.2	0.6
09/28/2022 19:00	2,881.7	0.0	2,881.7	104,400.0	300.8	0.4	0.2	0.6
09/28/2022 20:00	2,954.7	0.0	2,954.7	104,400.0	308.5	0.4	0.2	0.6
09/28/2022 21:00	3,611.6	0.0	3,611.6	104,400.0	377.1	0.5	0.2	0.8
09/28/2022 22:00	3,846.0	0.0	3,846.0	104,400.0	401.5	0.5	0.2	0.8
09/28/2022 23:00	4,153.7	0.0	4,153.7	104,400.0	433.6	0.5	0.3	0.9
Average/Sum#:	3,457.5	0.0	3,457.5	104,400.0	361.0	0.5	0.2	0.7
Minimum:	2,816.1	0.0	2,816.1	104,400.0	294.0	0.4	0.2	0.6
Maximum:	4,445.8	0.0	4,445.8	104,400.0	464.1	0.6	0.3	0.9
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:30 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2	Unit CT2	Unit CT2
						PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/29/2022 00:00	3,792.7	0.0	3,792.7	104,400.0	396.0	0.5	0.2	0.8
09/29/2022 01:00	3,195.3	0.0	3,195.3	104,400.0	333.6	0.4	0.2	0.7
09/29/2022 02:00	3,123.4	0.0	3,123.4	104,400.0	326.1	0.4	0.2	0.7
09/29/2022 03:00	3,333.4	0.0	3,333.4	104,400.0	348.0	0.4	0.2	0.7
09/29/2022 04:00	3,782.9	0.0	3,782.9	104,400.0	394.9	0.5	0.2	0.8
09/29/2022 05:00	4,177.0	0.0	4,177.0	104,400.0	436.1	0.5	0.3	0.9
09/29/2022 06:00	3,856.0	0.0	3,856.0	104,400.0	402.6	0.5	0.2	0.8
09/29/2022 07:00	4,036.8	0.0	4,036.8	104,400.0	421.4	0.5	0.3	0.8
09/29/2022 08:00	3,080.0	0.0	3,080.0	104,400.0	321.6	0.4	0.2	0.6
09/29/2022 09:00	2,911.6	0.0	2,911.6	104,400.0	304.0	0.4	0.2	0.6
09/29/2022 10:00	2,824.7	0.0	2,824.7	104,400.0	294.9	0.4	0.2	0.6
09/29/2022 11:00	2,856.8	0.0	2,856.8	104,400.0	298.2	0.4	0.2	0.6
09/29/2022 12:00	2,883.2	0.0	2,883.2	104,400.0	301.0	0.4	0.2	0.6
09/29/2022 13:00	3,128.7	0.0	3,128.7	104,400.0	326.6	0.4	0.2	0.7
09/29/2022 14:00	2,949.6	0.0	2,949.6	104,400.0	307.9	0.4	0.2	0.6
09/29/2022 15:00	2,994.4	0.0	2,994.4	104,400.0	312.6	0.4	0.2	0.6
09/29/2022 16:00	3,902.6	159.2	3,966.3	104,400.0	414.1	0.5	0.3	0.8
09/29/2022 17:00	4,592.7	431.0	5,023.7	104,400.0	524.5	0.6	0.3	1.0
09/29/2022 18:00	4,643.6	376.3	5,019.9	104,400.0	524.1	0.6	0.3	1.0
09/29/2022 19:00	4,649.7	352.4	5,002.1	104,400.0	522.2	0.6	0.3	1.0
09/29/2022 20:00	4,282.6	156.7	4,364.1	104,400.0	455.6	0.6	0.3	0.9
09/29/2022 21:00	3,020.1	0.0	3,020.1	104,400.0	315.3	0.4	0.2	0.6
09/29/2022 22:00	3,080.1	0.0	3,080.1	104,400.0	321.6	0.4	0.2	0.6
09/29/2022 23:00	4,228.3	0.0	4,228.3	104,400.0	441.4	0.5	0.3	0.9
Average/Sum#:	3,555.3	61.5	3,609.6	104,400.0	376.8	0.5	0.2	0.7
Minimum:	2,824.7	0.0	2,824.7	104,400.0	294.9	0.4	0.2	0.6
Maximum:	4,649.7	431.0	5,023.7	104,400.0	524.5	0.6	0.3	1.0
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Fuel Gas and Emissions Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:30 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	> 4.73	> 1	> 1.8
	GasFlow, _CT, 100scfh	GasFlow, _DB, 100scfh	GasFlowTotal, 100scfh	GCVGas, BtuPer100scf	HI, MBtuPerHr	Unit CT2	Unit CT2	Unit CT2
						PM10_Norm, LbPerHr	SO2_Norm, LbPerHr	VOC_Norm, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/30/2022 00:00	4,041.3	0.0	4,041.3	104,400.0	421.9	0.5	0.3	0.8
09/30/2022 01:00	3,950.3	0.0	3,950.3	104,400.0	412.4	0.5	0.2	0.8
09/30/2022 02:00	3,863.3	0.0	3,863.3	104,400.0	403.3	0.5	0.2	0.8
09/30/2022 03:00	3,728.4	0.0	3,728.4	104,400.0	389.2	0.5	0.2	0.8
09/30/2022 04:00	4,302.4	0.0	4,302.4	104,400.0	449.2	0.5	0.3	0.9
09/30/2022 05:00	4,630.4	0.0	4,630.4	104,400.0	483.4	0.6	0.3	1.0
09/30/2022 06:00	3,947.1	0.0	3,947.1	104,400.0	412.1	0.5	0.2	0.8
09/30/2022 07:00	2,852.6	0.0	2,852.6	104,400.0	297.8	0.4	0.2	0.6
09/30/2022 08:00	2,860.4	0.0	2,860.4	104,400.0	298.6	0.4	0.2	0.6
09/30/2022 09:00	2,834.5	0.0	2,834.5	104,400.0	295.9	0.4	0.2	0.6
09/30/2022 10:00	2,843.9	0.0	2,843.9	104,400.0	296.9	0.4	0.2	0.6
09/30/2022 11:00	2,814.1	0.0	2,814.1	104,400.0	293.8	0.4	0.2	0.6
09/30/2022 12:00	2,834.8	0.0	2,834.8	104,400.0	296.0	0.4	0.2	0.6
09/30/2022 13:00	2,807.9	0.0	2,807.9	104,400.0	293.1	0.4	0.2	0.6
09/30/2022 14:00	2,805.3	0.0	2,805.3	104,400.0	292.9	0.4	0.2	0.6
09/30/2022 15:00	2,836.4	0.0	2,836.4	104,400.0	296.1	0.4	0.2	0.6
09/30/2022 16:00	3,690.4	0.0	3,690.4	104,400.0	385.3	0.5	0.2	0.8
09/30/2022 17:00	4,067.4	0.0	4,067.4	104,400.0	424.6	0.5	0.3	0.8
09/30/2022 18:00	2,972.1	0.0	2,972.1	104,400.0	310.3	0.4	0.2	0.6
09/30/2022 19:00	2,962.3	0.0	2,962.3	104,400.0	309.3	0.4	0.2	0.6
09/30/2022 20:00	3,141.7	0.0	3,141.7	104,400.0	328.0	0.4	0.2	0.7
09/30/2022 21:00	3,806.3	0.0	3,806.3	104,400.0	397.4	0.5	0.2	0.8
09/30/2022 22:00	3,009.7	0.0	3,009.7	104,400.0	314.2	0.4	0.2	0.6
09/30/2022 23:00	4,280.6	0.0	4,280.6	104,400.0	446.9	0.5	0.3	0.9
Average/Sum#:	3,411.8	0.0	3,411.8	104,400.0	356.2	0.5	0.2	0.7
Minimum:	2,805.3	0.0	2,805.3	104,400.0	292.9	0.4	0.2	0.6
Maximum:	4,630.4	0.0	4,630.4	104,400.0	483.4	0.6	0.3	1.0
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Linearity Report

10/01/2022

Page 1

ORIS Code:	56298	Facility Name:	ROSEVILLE ENERGY	ReasonForTes	QA
EDR Site ID:	CT001	Component ID:	A15	Grace Period:	0
		Component Type:	NOXA		
Instrument	CT1_NOXDualRg_P_Instr	Test End	07/21/2022	Scale:	High
Performance	5 %	Test No.:	118	Highest	3.1
		Status	Passed		

Date	Time	Cal Gas Level	Span Value	Ref Value	Meas Value	Aborted Test Indicator	Ref Value As Pct Span
07/21/2022	1232	L	200.0	47.8	46.6		23.9 %
07/21/2022	1237	M	200.0	105.0	108.1		52.5 %
07/21/2022	1242	H	200.0	175.0	176.2		87.5 %
07/21/2022	1249	L	200.0	47.8	49.0		23.9 %
07/21/2022	1254	M	200.0	105.0	108.4		52.5 %
07/21/2022	1259	H	200.0	175.0	176.0		87.5 %
07/21/2022	1306	L	200.0	47.8	49.3		23.9 %
07/21/2022	1311	M	200.0	105.0	108.3		52.5 %
07/21/2022	1316	H	200.0	175.0	175.8		87.5 %

Summary

Cal Gas Level	Reference Mean	CEMS Mean	Alt Perf Spec	Results
L	47.800	48.300	No	1.0
M	105.000	108.267	No	3.1
H	175.000	176.000	No	0.6

Linearity Report

10/01/2022

Page 2

ORIS Code:	56298	Facility Name:	ROSEVILLE ENERGY	ReasonForTes	QA
EDR Site ID:	CT001	Component ID:	A16	Grace Period:	0
		Component Type:	O2D		
Instrument	CT1_O2D_P_Instrument	Test End	07/21/2022	Scale:	High
Performance	5 %	Test No.:	119	Highest	1.8
		Status	Passed		

Date	Time	Cal Gas Level	Span Value	Ref Value	Meas Value	Aborted Test Indicator	Ref Value As Pct Span
07/21/2022	1428	L	21.0	5.5	5.6		26.2 %
07/21/2022	1433	M	21.0	11.1	11.1		52.9 %
07/21/2022	1438	H	21.0	18.1	18.2		86.2 %
07/21/2022	1445	L	21.0	5.5	5.6		26.2 %
07/21/2022	1450	M	21.0	11.1	11.1		52.9 %
07/21/2022	1455	H	21.0	18.1	18.2		86.2 %
07/21/2022	1502	L	21.0	5.5	5.6		26.2 %
07/21/2022	1507	M	21.0	11.1	11.1		52.9 %
07/21/2022	1512	H	21.0	18.1	18.2		86.2 %

Summary

Cal Gas Level	Reference Mean	CEMS Mean	Alt Perf Spec	Results
L	5.500	5.600	No	1.8
M	11.100	11.100	No	0.0
H	18.100	18.200	No	0.6

Linearity Report

10/01/2022

Page 3

ORIS Code:	56298	Facility Name:	ROSEVILLE ENERGY	ReasonForTes	QA
EDR Site ID:	CT002	Component ID:	A21	Grace Period:	0
		Component Type:	NOXA		
Instrument	CT2_NOXDualRg_P_Instr	Test End	08/03/2022	Scale:	High
Performance	5 %	Test No.:	121	Highest	2.5
		Status	Passed		

Date	Time	Cal Gas Level	Span Value	Ref Value	Meas Value	Aborted Test Indicator	Ref Value As Pct Span
08/03/2022	0735	L	200.0	48.2	47.4		24.1 %
08/03/2022	0740	M	200.0	106.0	108.7		53.0 %
08/03/2022	0746	H	200.0	182.0	182.1		91.0 %
08/03/2022	0753	L	200.0	48.2	47.9		24.1 %
08/03/2022	0758	M	200.0	106.0	108.6		53.0 %
08/03/2022	0803	H	200.0	182.0	182.0		91.0 %
08/03/2022	0810	L	200.0	48.2	48.5		24.1 %
08/03/2022	0815	M	200.0	106.0	108.7		53.0 %
08/03/2022	0820	H	200.0	182.0	182.1		91.0 %

Summary

Cal Gas Level	Reference Mean	CEMS Mean	Alt Perf Spec	Results
L	48.200	47.933	No	0.6
M	106.000	108.667	No	2.5
H	182.000	182.067	No	0.0

Linearity Report

10/01/2022

Page 4

ORIS Code:	56298	Facility Name:	ROSEVILLE ENERGY	ReasonForTes	QA
EDR Site ID:	CT002	Component ID:	A22	Grace Period:	0
		Component Type:	O2D		
Instrument	CT2_O2D_P_Instrument	Test End	08/03/2022	Scale:	High
Performance	5 %	Test No.:	122	Highest	0.0
		Status	Passed		

Date	Time	Cal Gas Level	Span Value	Ref Value	Meas Value	Aborted Test Indicator	Ref Value As Pct Span
08/03/2022	1026	L	21.0	5.0	5.0		23.8 %
08/03/2022	1031	M	21.0	11.2	11.2		53.3 %
08/03/2022	1036	H	21.0	18.1	18.1		86.2 %
08/03/2022	1043	L	21.0	5.0	5.0		23.8 %
08/03/2022	1048	M	21.0	11.2	11.2		53.3 %
08/03/2022	1053	H	21.0	18.1	18.1		86.2 %
08/03/2022	1100	L	21.0	5.0	5.0		23.8 %
08/03/2022	1105	M	21.0	11.2	11.2		53.3 %
08/03/2022	1110	H	21.0	18.1	18.1		86.2 %

Summary

Cal Gas Level	Reference Mean	CEMS Mean	Alt Perf Spec	Results
L	5.000	5.000	No	0.0
M	11.200	11.200	No	0.0
H	18.100	18.100	No	0.0

Roseville Energy Park Revision History

RegPerfect® by Teledyne Monitor Labs, Inc.

Teledyne Monitor Labs, Inc.

35 Inverness Drive East

Englewood, CO 80112-5189

Telephone: (800) 846-6062

<http://www.teledyne-ml.com/>

<http://www.regperfect.com/>

©1998-2005 Teledyne Monitor Labs, Inc. All rights reserved.

RegPerfect® is a registered trademark of Teledyne Monitor Labs, Inc.

NOTE: This server's C drive is only 20 GB in size!! Do not place large files on this drive.

9/6/22 Taylor Sullivan

EDR check

7/22,28/22 Taylor Sullivan

Q2 EDRs

7/1/22 William Vanhorn

Checking to see if the NOx excess emissions are correct on 6/30.

CO Ppmvdc EDS/CMS Summary Report

CT1



From: 07/01/2022 00:00 **To:** 09/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 10/01/2022 21:34 **Location:** Roseville, CA
Description: Electric Utility

CMS Data from: CT1_CO_Ppmvdc_1H
EDS Data from: CT1_CO_Ppmvdc_3H
Emission Limitation: 4
No Value Exclusions Allowed
Monitor Manufacturer and Model No.: TELEDYNE MONITOR LABS INC, TML30
Date of Latest CMS Certification or Audit: 04/09/2006 14:00
Process Unit(s) Description:
Operating time for EDS: 2,032.00 Hour(s)
Operating time for CMS: 2,032.00 Hour(s)

Emission Data Summary

1. Duration of excess emission in reporting period due to:	
a. Startup/shutdown	0
b. Control equipment problems	0
c. Process Problems	0
d. Other known causes	0
e. Unknown causes	0
2. Upset Conditions	0
3. Total Duration (Subtracts Exclusions and Upset Conditions)	0
4. Time of Excess Emission as a percentage of operating time	0.00
5. Time in compliance as percentage of operating time	100.00

CMS Performance Summary

1. CMS downtime in reporting period due to:	
a. Monitor equipment malfunctions	0
b. Non-Monitor equipment malfunctions	0
c. Quality assurance calibration	0
d. Other known causes	0
e. Unknown causes	1
2. Total CMS Downtime	1
3. Total Downtime as a percentage of operating time	0.05
4. Total Availability as a percentage of operating time	99.95

Note: The total duration of EDS (<1%) and CMS (<5%) incidents meets federal standard 40CFR60.7(d), therefore the excess emission detail report may not be required as part of the quarterly/semi-annual submission unless requested by the Administrator.

NOx Ppmvdc EDS/CMS Summary Report

CT1



From: 07/01/2022 00:00 **To:** 09/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 10/01/2022 21:35 **Location:** Roseville, CA
Description: Electric Utility

CMS Data from: CT1_NOx_Ppmvdc_1H
EDS Data from: CT1_NOx_Ppmvdc_1H
Emission Limitation: 2.0
No Value Exclusions Allowed
Monitor Manufacturer and Model No.: TELEDYNE MONITOR LABS INC, TML41-02
Date of Latest CMS Certification or Audit: 04/09/2006 14:00
Process Unit(s) Description:
Operating time for EDS: 2,032.00 Hour(s)
Operating time for CMS: 2,032.00 Hour(s)

Emission Data Summary

1. Duration of excess emission in reporting period due to:	
a. Startup/shutdown	0
b. Control equipment problems	0
c. Process Problems	0
d. Other known causes	1
e. Unknown causes	0
2. Upset Conditions	0
3. Total Duration (Subtracts Exclusions and Upset Conditions)	1
4. Time of Excess Emission as a percentage of operating time	0.05
5. Time in compliance as percentage of operating time	99.95

CMS Performance Summary

1. CMS downtime in reporting period due to:	
a. Monitor equipment malfunctions	0
b. Non-Monitor equipment malfunctions	0
c. Quality assurance calibration	0
d. Other known causes	0
e. Unknown causes	1
2. Total CMS Downtime	1
3. Total Downtime as a percentage of operating time	0.05
4. Total Availability as a percentage of operating time	99.95

Note: The total duration of EDS (<1%) and CMS (<5%) incidents meets federal standard 40CFR60.7(d), therefore the excess emission detail report may not be required as part of the quarterly/semi-annual submission unless requested by the Administrator.

CO Ppmvdc EDS/CMS Summary Report

CT2



From: 07/01/2022 00:00 **To:** 09/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 10/01/2022 21:36 **Location:** Roseville, CA
Description: Electric Utility

CMS Data from: CT2_CO_Ppmvdc_1H
EDS Data from: CT2_CO_Ppmvdc_3H
Emission Limitation: 4
No Value Exclusions Allowed
Monitor Manufacturer and Model No.: TELEDYNE MONITOR LABS INC, TML30
Date of Latest CMS Certification or Audit: 04/10/2006 07:00
Process Unit(s) Description:
Operating time for EDS: 1,949.00 Hour(s)
Operating time for CMS: 1,949.00 Hour(s)

Emission Data Summary

1. Duration of excess emission in reporting period due to:	
a. Startup/shutdown	0
b. Control equipment problems	0
c. Process Problems	0
d. Other known causes	0
e. Unknown causes	0
2. Upset Conditions	0
3. Total Duration (Subtracts Exclusions and Upset Conditions)	0
4. Time of Excess Emission as a percentage of operating time	0.00
5. Time in compliance as percentage of operating time	100.00

CMS Performance Summary

1. CMS downtime in reporting period due to:	
a. Monitor equipment malfunctions	0
b. Non-Monitor equipment malfunctions	0
c. Quality assurance calibration	0
d. Other known causes	0
e. Unknown causes	1
2. Total CMS Downtime	1
3. Total Downtime as a percentage of operating time	0.05
4. Total Availability as a percentage of operating time	99.95

Note: The total duration of EDS (<1%) and CMS (<5%) incidents meets federal standard 40CFR60.7(d), therefore the excess emission detail report may not be required as part of the quarterly/semi-annual submission unless requested by the Administrator.

NOx Ppmvdc EDS/CMS Summary Report

CT2



From: 07/01/2022 00:00 **To:** 09/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 10/01/2022 21:36 **Location:** Roseville, CA
Description: Electric Utility

CMS Data from: CT2_NOx_Ppmvdc_1H
EDS Data from: CT2_NOx_Ppmvdc_1H
Emission Limitation: 2.0
No Value Exclusions Allowed
Monitor Manufacturer and Model No.: TELEDYNE MONITOR LABS INC, TML41-02
Date of Latest CMS Certification or Audit: 04/10/2006 07:00
Process Unit(s) Description:
Operating time for EDS: 1,949.00 Hour(s)
Operating time for CMS: 1,949.00 Hour(s)

Emission Data Summary

1. Duration of excess emission in reporting period due to:	
a. Startup/shutdown	0
b. Control equipment problems	0
c. Process Problems	0
d. Other known causes	1
e. Unknown causes	0
2. Upset Conditions	0
3. Total Duration (Subtracts Exclusions and Upset Conditions)	1
4. Time of Excess Emission as a percentage of operating time	0.05
5. Time in compliance as percentage of operating time	99.95

CMS Performance Summary

1. CMS downtime in reporting period due to:	
a. Monitor equipment malfunctions	0
b. Non-Monitor equipment malfunctions	0
c. Quality assurance calibration	0
d. Other known causes	0
e. Unknown causes	1
2. Total CMS Downtime	1
3. Total Downtime as a percentage of operating time	0.05
4. Total Availability as a percentage of operating time	99.95

Note: The total duration of EDS (<1%) and CMS (<5%) incidents meets federal standard 40CFR60.7(d), therefore the excess emission detail report may not be required as part of the quarterly/semi-annual submission unless requested by the Administrator.

CO Invalid Data

CT1

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:37 Location: Roseville, CA



Tag Name: CT1_CO_Ppm_1H
Total Operating Time: 2,032.00 Hour(s)
Non-Operating Time: 176.00 Hour(s) Report Time: 2,208.00 Hour(s)

Inc No	Start Time	End Time	Duration in Hour(s)	Reason Code - Description	Action Code - Description
1	08/26/2022 08:00	08/26/2022 08:59	1		

Total Operating Time:	2,032.00 Hour(s)
Total Monitor Downtime (Online only):	1.00 Hour(s)
Percent Monitor Availability:	99.95 %
Percent Monitor Downtime:	0.05 %

NOx Invalid Data

CT1

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:38 Location: Roseville, CA



Tag Name: CT1_NOx_Ppm_1H
Total Operating Time: 2,032.00 Hour(s)
Non-Operating Time: 176.00 Hour(s) Report Time: 2,208.00 Hour(s)

Inc No	Start Time	End Time	Duration in Hour(s)	Reason Code - Description	Action Code - Description
1	08/27/2022 03:00	08/27/2022 03:59	1	3 - Quality assurance calibration	

Total Operating Time:	2,032.00 Hour(s)
Total Monitor Downtime (Online only):	1.00 Hour(s)
Percent Monitor Availability:	99.95 %
Percent Monitor Downtime:	0.05 %

Report Code	Type	Text	Duration	Duration Percent
3	Reason	Quality assurance calibration	1	100.00

NOx SCR Invalid Data



CT1

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:39 Location: Roseville, CA

Tag Name: CT1_NOx_SCR_Ppm_1H
Total Operating Time: 2,032.00 Hour(s)
Non-Operating Time: 176.00 Hour(s) Report Time: 2,208.00 Hour(s)

No incidents have been reported for this reporting period. Monitor has 100% availability.

Total Operating Time:	2,032.00 Hour(s)
Total Monitor Downtime (Online only):	0.00 Hour(s)
Percent Monitor Availability:	100.00 %
Percent Monitor Downtime:	0.00 %

O2 Invalid Data

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:40 Location: Roseville, CA

Tag Name: CT1_O2Dry_Pct_1H
Total Operating Time: 2,032.00 Hour(s)
Non-Operating Time: 176.00 Hour(s) Report Time: 2,208.00 Hour(s)

No incidents have been reported for this reporting period. Monitor has 100% availability.

Total Operating Time:	2,032.00 Hour(s)
Total Monitor Downtime (Online only):	0.00 Hour(s)
Percent Monitor Availability:	100.00 %
Percent Monitor Downtime:	0.00 %

CO Invalid Data

CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:41 Location: Roseville, CA



Tag Name: CT2_CO_Ppm_1H
Total Operating Time: 1,949.00 Hour(s)
Non-Operating Time: 259.00 Hour(s) Report Time: 2,208.00 Hour(s)

Inc No	Start Time	End Time	Duration in Hour(s)	Reason Code - Description	Action Code - Description
1	09/22/2022 10:00	09/22/2022 10:59	1	23 - Maintenance	13 - Unit is offline. Performing analyzer maintenance. Not OOC

Total Operating Time:	1,949.00 Hour(s)
Total Monitor Downtime (Online only):	1.00 Hour(s)
Percent Monitor Availability:	99.95 %
Percent Monitor Downtime:	0.05 %

Report Code	Type	Text	Duration	Duration Percent
23	Reason	Maintenance	1	100.00
13	Action	Unit is offline. Performing analyzer maintenance. Not OOC	1	100.00

NOx Invalid Data

CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:42 Location: Roseville, CA



Tag Name: CT2_NOx_Ppm_1H
Total Operating Time: 1,949.00 Hour(s)
Non-Operating Time: 259.00 Hour(s) Report Time: 2,208.00 Hour(s)

Inc No	Start Time	End Time	Duration in Hour(s)	Reason Code - Description	Action Code - Description
1	09/22/2022 10:00	09/22/2022 10:59	1	23 - Maintenance	13 - Unit is offline. Performing analyzer maintenance. Not OOC

Total Operating Time:	1,949.00 Hour(s)
Total Monitor Downtime (Online only):	1.00 Hour(s)
Percent Monitor Availability:	99.95 %
Percent Monitor Downtime:	0.05 %

Report Code	Type	Text	Duration	Duration Percent
23	Reason	Maintenance	1	100.00
13	Action	Unit is offline. Performing analyzer maintenance. Not OOC	1	100.00

NOx SCR Invalid Data

CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:42 Location: Roseville, CA



Tag Name: CT2_NOx_SCR_Ppm_1H
Total Operating Time: 1,949.00 Hour(s)
Non-Operating Time: 259.00 Hour(s) Report Time: 2,208.00 Hour(s)

Inc No	Start Time	End Time	Duration in Hour(s)	Reason Code - Description	Action Code - Description
1	09/22/2022 10:00	09/22/2022 10:59	1	23 - Maintenance	13 - Unit is offline. Performing analyzer maintenance. Not OOC

Total Operating Time:	1,949.00 Hour(s)
Total Monitor Downtime (Online only):	1.00 Hour(s)
Percent Monitor Availability:	99.95 %
Percent Monitor Downtime:	0.05 %

Report Code	Type	Text	Duration	Duration Percent
23	Reason	Maintenance	1	100.00
13	Action	Unit is offline. Performing analyzer maintenance. Not OOC	1	100.00

02 Invalid Data

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:43 Location: Roseville, CA

Tag Name: CT2_O2Dry_Pct_1H
Total Operating Time: 1,949.00 Hour(s)
Non-Operating Time: 259.00 Hour(s) Report Time: 2,208.00 Hour(s)

Inc No	Start Time	End Time	Duration in Hour(s)	Reason Code - Description	Action Code - Description
1	09/22/2022 10:00	09/22/2022 10:59	1	23 - Maintenance	13 - Unit is offline. Performing analyzer maintenance. Not OOC

Total Operating Time:	1,949.00 Hour(s)
Total Monitor Downtime (Online only):	1.00 Hour(s)
Percent Monitor Availability:	99.95 %
Percent Monitor Downtime:	0.05 %

Report Code	Type	Text	Duration	Duration Percent
23	Reason	Maintenance	1	100.00
13	Action	Unit is offline. Performing analyzer maintenance. Not OOC	1	100.00

ATTACHMENT 7

AQ-36

AQ-36: The project owner shall notify the _PCAPCD of any breakdown condition as soon as reasonably possible, but no later than two PCAPCD business hours after its detection.

Verification: The Project owner shall include the identification of all breakdowns, PCAPCD notification, resulting excess emission (if any) and corrective actions taken (if any) as part of the Quarterly Air Quality Report required in Condition of Certification AQ-SC6



Year Non-Compliance
Event Number 2022007

110 Maple Street, Auburn, CA 95603 • (530) 745-2330 • Fax (530) 745-2373 • www.placerair.org

Erik C. White, Air Pollution Control Officer

NON-COMPLIANCE EVENT NOTIFICATION FORM – PART I

submit within 2 business hours after detection of the Non-Compliance Event

1. Company Name	ROSEVILLE ENERGY PARK	5120 PHILLIP ROAD						
2. Title V Source Status	Major Yes ☒ No ☐	Synthetic Minor Yes ☐ No ☒						
3. For Title V Sources, is the Non-Compliance Event the Result of an Emergency under District Rule 507, Section 402.2(l)	Yes ☐ No ☒							
4. Emission Exceedances	NOx ☒	SOx ☐	PM ☐	VOC ☐	CO ☐	Opacity ☐	None ☐	check all that apply
5. CEMS / COMS / CMS Breakdown	Yes ☐ No ☒							
6. Detection of Non-Compliance Event	Date	9-29-22	Time	04:00	☒ AM ☐ PM			
7. Start of Non-Compliance Event	Date	9-29-22	Time	03:00	☒ AM ☐ PM ☐ Not known			
8. Violation	Permit No. REPR-20-01 & 02	Condition No. 49	Rule	Section				
9. Unit / Equipment Involved	CT1 - CT2							
10. Description / Cause of Non-Compliance Event	NOx PPMVDC exceedance after attached					☐ additional information		
11. Immediate Corrective Actions	none ☒ additional information attached							
12. Was the Non-Compliance Event an Emission Violation or Monitoring Equipment Failure or Malfunction Yes ☐ No ☐								
If yes, do you Request that the Violation, Failure or Malfunction be Shielded from Enforcement Action as an Upset / Breakdown Pursuant to District Rule 404								
Yes ☐		No ☒		Not Able to Determine at this Time ☐		If "Yes", complete and submit the Upset / Breakdown Checklist Form with Part I		
13. Submitted By	Tony Johnson		Telephone		(916) 746 - 1656			
Signature			Date	9-29-22	Time	10:00	☒ AM ☐ PM	

NON-COMPLIANCE EVENT NOTIFICATION FORM – PART II

submit within 7 calendar days after end of the Non-Compliance Event

14. End of Non-Compliance Event	Date	9-29-22	Time	04:00	☒ AM ☐ PM		
15. Duration of Non-Compliance Event	Hours	1	Minutes				
16. Excess Emissions Estimates	NOx 2.1 & 2.2 ppmvdc		SOx		PM		
	VOC	CO	Opacity	%, for	minutes	Other	
17. Variance in Effect	Yes ☐ Variance #		No ☒				
18. Corrective and Preventative Actions Taken (a) Minimize Emissions Increased ammonia flow to control NOx . EVENT SHIELDED UNDER OPERATING CONDITION 50.(A) (1) (a) (b) Correct Event (c) Prevent Future Events ☒ additional information attached							
19. If Not Able to Determine in Item 12 of Part I, Was the Non-Compliance Event an Emission Violation or Monitoring Equipment Failure or Malfunction							
If yes, do you Request that the Violation, Failure or Malfunction be Shielded from Enforcement Action as an Upset / Breakdown Under District Rule 404							
Yes ☐		No ☒		If "Yes", complete and submit the Upset / Breakdown Checklist Form if not previously submitted with Part I			
20. Submitted By	Tony Johnson		Telephone		(916) 746 - 1656		
I certify under penalty of law that I am the responsible official for this facility, or his/her duly designated representative, and based on information and belief formed after reasonable inquiry, the statements and information in this document are true, accurate, and complete.							
Signature			Date	9-29-22	Time	10:00	☐ AM ☐ PM

NOx Ppmvdc 1-Hour Block Excess Emissions

CT1
From: 09/29/2022 00:00 To: 09/29/2022 05:35 Facility Name: ROSEVILLE ENERGY
Generated: 09/29/2022 05:36 Location: Roseville, CA



Tag Name: CT1_NOx_Ppmvdc_1H
Total Operating Time: 5.00 Hour(s) No Exclusions Allowed
Non-Operating Time: 1.00 Hour(s) Report Time: 6.00 Hour(s)

Inc No	Start Time	End Time	Duration in Hour(s)	Tag Value	Limit	Reason Code	Action Code
1	09/29/22 02:00	09/29/22 02:59	1	2.1	2.0		

Total Operating Time:	5.00 Hour(s)
Total Duration (Online only):	1.00 Hour(s)
Time in exceedance as a percentage of operating time:	20.00 %
Time in compliance as a percentage of operating time:	80.00 %



Roseville Electric
Roseville Energy Park
5120 Phillip Road
Roseville, California 95747

Tony Johnson
Operations and Maintenance Supervisor
Roseville Energy Park
5120 Phillip Road
Roseville, California 95747

Subject: Non-Compliance Event notification form #2022-007

To Whom It May Concern:

This memo is to provide additional information for Non-Compliance Event Notification form #2022-007.

On September 29, 2022 at approximately 03:00, Roseville Energy Park Combustion Turbine Generator (CTG) 1 and (CTG) 2 were online, operating at various loads initiated by the California ISO under Automatic Generation Control. The plant ramped down from 112 MW's at about 03:00 to 66 MW's at 03:13.

At 03:10 both unit's Continuous Emissions Monitoring Systems (CEMS) began their automatic scheduled daily calibrations. When the calibration period begins the NOx control system locks in the flow of ammonia, controlling to the last value recorded by the CEMS. In this case, load was at 86 MW's and descending rapidly, with the NOx climbing due to the descending load. Normally the calibration period ends and the NOx control system returns to normal and feeds ammonia according to the CEMS's NOx reading that is closer to the last good value. Today the NOx control system was attempting to control more NOx than it could manage, created by the ramp down to 66 MW's.

The result of this steep ramping initiated by CAISO was a violation of Condition 49 NOx limitation of 2.0 ppmvdc of Operating Permit #REPR-20-01 and #REPR-20-02, as detailed in the attached CEMS reports.

We respectfully request shielding of this exceedance based on Condition 50 (A) (1) (a) "Rapid combustion load changes due to the following conditions: Load changes initiated by the California ISO...when the plant is operating under Automatic Generation Control".

Let me know if you have any questions.

Sincerely,

A handwritten signature in black ink, appearing to read "Tony Johnson".

Tony Johnson

NOx Ppmvdc 1-Hour Block Excess Emissions

CT2
From: 09/29/2022 00:00 To: 09/29/2022 05:35 Facility Name: ROSEVILLE ENERGY
Generated: 09/29/2022 05:36 Location: Roseville, CA



Tag Name: CT2_NOx_Ppmvdc_1H
Total Operating Time: 5.00 Hour(s) No Exclusions Allowed
Non-Operating Time: 1.00 Hour(s) Report Time: 6.00 Hour(s)

Inc No	Start Time	End Time	Duration in Hour(s)	Tag Value	Limit	Reason Code	Action Code
1	09/29/22 02:00	09/29/22 02:59	1	2.2	2.0		

Total Operating Time:	5.00 Hour(s)
Total Duration (Online only):	1.00 Hour(s)
Time in exceedance as a percentage of operating time:	20.00 %
Time in compliance as a percentage of operating time:	80.00 %

Constant Name	Category	Data Type	Units	Current Value
CT1_AutoCalStart_SCR	DailyCalStartTime	Time	Time	02:10:00
CT1_AutoCalStart_Stack	DailyCalStartTime	Time	Time	03:10:00
CT2_AutoCalStart_SCR	DailyCalStartTime	Time	Time	02:10:00
CT2_AutoCalStart_Stack	DailyCalStartTime	Time	Time	03:10:00

Category Filter

DailyCalStartTime

Calibration Type Filter

Site Filter

Calibration Level Filter

Usage Filter

Instrument Range Filt

Remove All Filters

☐ Sort E

☒ Sort E

☒ Asce

☐ Descr

CT1 CT2 NOX EXCEEDANCE 9-29-22


Date/Time	CT1_NOx_Ppmvdc_1M			CT1_Load_CT_MWe_1M			CT2_NOx_Ppmvdc_1M			CT2_Load_Total_MWe_1M			Value	SI	Mod	Value	SI	Mod
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod						
09/29/22 1:58	1.72			27			1.43			43.1								
09/29/22 1:59	1.63			29.9			1.43			46.5								
09/29/22 2:00	1.54			32.3			1.34			50.2								
09/29/22 2:01	1.38			33.3			1.07			51.5								
09/29/22 2:02	1.2			33.6			1			51.5								
09/29/22 2:03	1.18			32.8			1.07			50								
09/29/22 2:04	1.36			30.2			1.16			46.6								
09/29/22 2:05	1.52			28.6			1.32			44.6								
09/29/22 2:06	1.61			28.5			1.32			44.6								
09/29/22 2:07	1.52			28.9			1.32			44.8								
09/29/22 2:08	1.52			29			1.32			44.9								
09/29/22 2:09	1.52			29			1.32			44.8								
09/29/22 2:10	1.52			28.9			1.41			45								
09/29/22 2:11	1.52			28.8			1.41			45.2								
09/29/22 2:12	1.61			28.6			1.5			45.1								
09/29/22 2:13	1.61			27			1.5			43.3								
09/29/22 2:14	1.7			24.2			1.67			39.4								
09/29/22 2:15	1.82			21.4			1.88			36								
09/29/22 2:16	1.97			20.2			2.4			34.5								
09/29/22 2:17	2.66			20.6			3.09			34.8								
09/29/22 2:18	2.76			20.8			3.18			35								
09/29/22 2:19	2.81			20.9			3.28			34.9								
09/29/22 2:20	2.81			20.9			3.37			35								
09/29/22 2:21	2.9			20.9			3.47			35.1								
09/29/22 2:22	3.05			20.9			3.56			35.1								
09/29/22 2:23	3.05			20.9			3.65			35.1								
09/29/22 2:24	3.14			20.9			3.84			35.2								
09/29/22 2:25	3.14			20.8			3.84			35.1								
09/29/22 2:26	3.24			20.6			3.93			35.3								
09/29/22 2:27	3.24			20.5			4.03			35								
09/29/22 2:28	3.24			20.5			4.12			34.8								
09/29/22 2:29	3.24			20.5			4.31			34.8								
09/29/22 2:30	3.24			20.5			4.21			34.6								
09/29/22 2:31	2.76			20.6			3.09			35								

BEGIN CEMS TIME
ACTUAL TIME 3:00

Date/Time	CT1_NOx_Ppmvdc_1M			CT1_Load_CT_MWe_1M			CT2_NOx_Ppmvdc_1M			CT2_Load_Total_MWe_1M			Value	SI	Mod	Value	SI	Mod
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod						
09/29/22 3:46	2			25.9			1.88			41.8								
09/29/22 3:47	2			26			1.52			41.9								
09/29/22 3:48	1.82			28			1.43			43.5								
09/29/22 3:49	1.72			30.4			1.34			47.2								
09/29/22 3:50	1.27			31.3			1.16			48.8								
09/29/22 3:51	1.09			31.4			0.98			48.7								
09/29/22 3:52	1.09			31.1			1.07			48.2								
09/29/22 3:53	1.16			29.9			1.14			46.7								
09/29/22 3:54	1.34			28.6			1.23			45								
09/29/22 3:55	1.34			28.5			1.32			44.8								
09/29/22 3:56	1.43			28.6			1.41			45.1								
09/29/22 3:57	1.43			28.9			1.5			45								
09/29/22 3:58	1.43			28			1.5			43.9								
09/29/22 3:59	1.52			25			1.59			40.5								
09/29/22 4:00	1.61			21.9			1.79			36.9								
09/29/22 4:01	1.75			20.2			1.82			34.4								
09/29/22 4:02	1.81			20.5			1.87			34.6								
09/29/22 4:03	1.9			20.9			1.97			35.1								
09/29/22 4:04	1.9			20.9			1.5			35.3								
09/29/22 4:05	1.69			20.9			1.22			35.2								
09/29/22 4:06	1.4			20.9			1.12			35								
09/29/22 4:07	1.31			20.7			1.12			34.9								
09/29/22 4:08	1.24			20.6			1.22			34.8								
09/29/22 4:09	1.24			20.6			1.31			34.9								
09/29/22 4:10	1.24			20.5			1.4			34.9								
09/29/22 4:11	1.33			20.6			1.5			35								
09/29/22 4:12	1.43			20.5			1.5			35								
09/29/22 4:13	1.52			20.6			1.59			35								
09/29/22 4:14	1.62			20.6			1.59			34.8								
09/29/22 4:15	1.71			20.6			1.69			34.9								
09/29/22 4:16	1.71			20.6			1.69			35								
09/29/22 4:17	1.71			20.9			1.69			35.2								
09/29/22 4:18	1.71			22			1.69			36.6								
09/29/22 4:19	1.69			24.7			1.57			40.2								
09/29/22 4:20	1.57			27.8			1.36			43.8								
09/29/22 4:21	1.45			29			1.25			45.7								
09/29/22 4:22	1.36			28.4			1.14			45.1								

Start Time : 09/29/2022 00:00:00
End Time : 09/29/2022 06:25:16

	G	Point Name	Historian	Processing Type	Description	End Value	Units	S	Low Scale	High Scale
1	☒	(A) 10AGC-ISO_MW_SPT_COR.UNIT1@NET0	Auto Historian	Actual	AGC ISO MW STPT CORRECTED CURRENT	112.0	MW	☒	50	120
2	☒	(A) 10AGC-NET_MW.UNIT1@NET0	Auto Historian	Actual	PLANT NET MW	110.9	MW	☒	-50	120
3	☒	(A) 213-AT-2001-PV.UNIT1@NET0	Auto Historian	Actual	HRSG2 CEMS STACK NOX @15% O2	0.95	PPMVDC	☒	0	6
4	☒	(A) 213-AT-1001-PV.UNIT1@NET0	Auto Historian	Actual	HRSG1 CEMS STACK NOX @ 15% O2	1.32	PPMVDC	☒	0	6

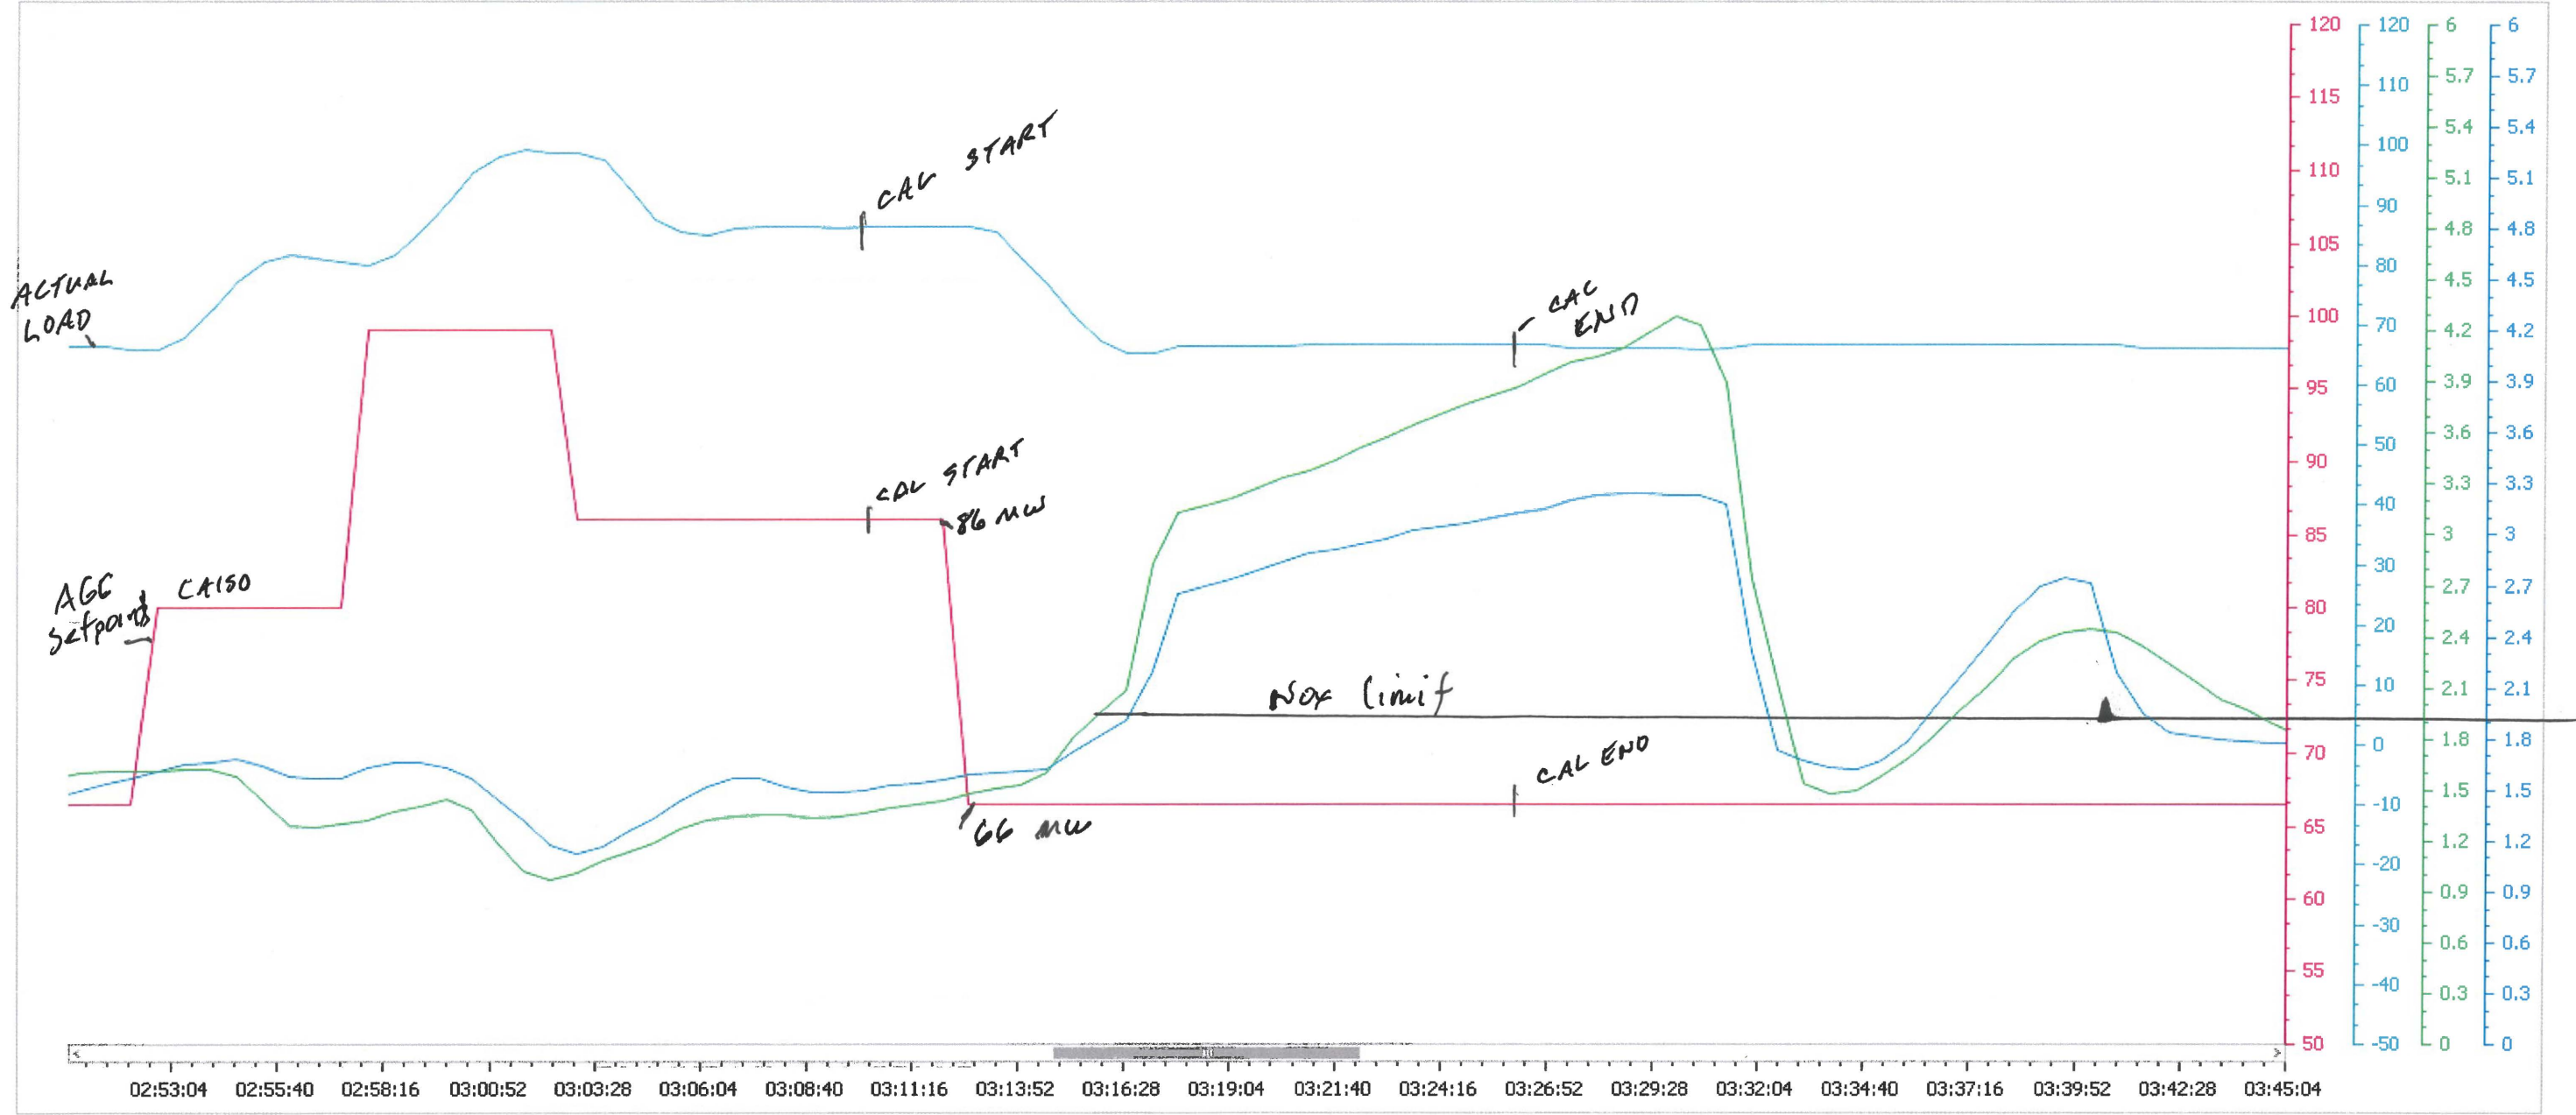

ATTACHMENT 8

AQ-37

AQ-37 Any Violation of any emission standard listed in this permit which is indicated by the CEMS shall be reported to the PCAPCD no later than 96 hours after such occurrence as per California Health and Safety Code 42706

Verification: The Project owner shall include all violations of emissions standards and corresponding PCAPCD notifications in the Quarterly Air Quality Report required by the Condition of Certification AQ-SC6

All Notices of Non Compliance are included in AQ-41.

ATTACHMENT 9

AQ-40

AQ-40 The Project owner shall comply with the applicable requirements for quality assurance testing and maintenance of the continuous emission monitor equipment in accordance with the procedures and guidance specified in 40 CFR Part 60, Appendix F.

Verification: The Project owner shall include all CEMS quality assurance test failures that required corrective action as part of the Quarterly Air Quality Report required by the Condition of Certification AQ-SC6

Cylinder Gas Audit

10/01/2022

Page 1

Facility: ROSEVILLE ENERGY
Unit/Stack: CT1
Parameter/Scal CO / Low

Test Date: 07/21/2022
Test **Pass**

Instrument CT1_CODualRg_P_Instr
Performance 15 Pct
Alternate Spec: 5 Ppm

Date	Time	Test Level	Span Value	Reference	Measured Value	Ref Value As Pct Span
07/21/2022	11:03	L	10	2.400	2.300	24.0 %
07/21/2022	11:08	M	10	5.700	5.700	57.0 %
07/21/2022	11:15	L	10	2.400	2.300	24.0 %
07/21/2022	11:20	M	10	5.700	5.700	57.0 %
07/21/2022	11:27	L	10	2.400	2.300	24.0 %
07/21/2022	11:32	M	10	5.700	5.700	57.0 %

Summary

Cal Gas Level	Reference Mean	CEMS Mean	Specification	Results
L	2.400	2.300	Std	4.2
M	5.700	5.700	Std	0.0

Cylinder Gas Audit

10/01/2022

Page 2

Facility:	ROSEVILLE ENERGY	Instrument	CT1_CODualRg_P_Instr
Unit/Stack:	CT1	Performance	15 Pct
Parameter/Scal	CO / High	Test	Pass
		Alternate Spec:	5 Ppm

Date	Time	Test Level	Span Value	Reference	Measured Value	Ref Value As Pct Span
07/21/2022	12:32	L	200	50.300	49.700	25.2 %
07/21/2022	12:37	M	200	112.800	114.300	56.4 %
07/21/2022	12:49	L	200	50.300	49.700	25.2 %
07/21/2022	12:54	M	200	112.800	114.200	56.4 %
07/21/2022	13:06	L	200	50.300	49.900	25.2 %
07/21/2022	13:11	M	200	112.800	114.300	56.4 %

Summary

Cal Gas Level	Reference Mean	CEMS Mean	Specification	Results
L	50.300	49.767	Std	1.1
M	112.800	114.267	Std	1.3

Cylinder Gas Audit

10/01/2022

Page 3

Facility:	ROSEVILLE ENERGY	Instrument	CT2_CODualRg_P_Instr
Unit/Stack:	CT2	Performance	15 Pct
Parameter/Scal	CO / High	Test	Pass
		Alternate Spec:	5 Ppm

Date	Time	Test Level	Span Value	Reference	Measured Value	Ref Value As Pct Span
08/03/2022	07:35	L	200	49.400	50.000	24.7 %
08/03/2022	07:40	M	200	112.700	115.800	56.4 %
08/03/2022	07:53	L	200	49.400	50.000	24.7 %
08/03/2022	07:58	M	200	112.700	116.300	56.4 %
08/03/2022	08:10	L	200	49.400	50.000	24.7 %
08/03/2022	08:15	M	200	112.700	116.100	56.4 %

Summary

Cal Gas Level	Reference Mean	CEMS Mean	Specification	Results
L	49.400	50.000	Std	1.2
M	112.700	116.067	Std	3.0

Cylinder Gas Audit

10/01/2022

Page 4

Facility:	ROSEVILLE ENERGY	Instrument	CT2_CODualRg_P_Instr
Unit/Stack:	CT2	Performance	15 Pct
Parameter/Scal	CO / Low	Test	Pass
		Alternate Spec:	5 Ppm

Date	Time	Test Level	Span Value	Reference	Measured Value	Ref Value As Pct Span
08/03/2022	12:40	L	10	2.400	2.200	24.0 %
08/03/2022	12:45	M	10	5.700	5.500	57.0 %
08/03/2022	12:53	L	10	2.400	2.200	24.0 %
08/03/2022	12:58	M	10	5.700	5.500	57.0 %
08/03/2022	13:05	L	10	2.400	2.200	24.0 %
08/03/2022	13:10	M	10	5.700	5.500	57.0 %

Summary

Cal Gas Level	Reference	Mean	CEMS Mean	Specification	Results
L	2.400		2.200	Std	8.3
M	5.700		5.500	Std	3.5

Linearity Report

10/01/2022

Page 1

ORIS Code:	56298	Facility Name:	ROSEVILLE ENERGY	ReasonForTes	QA
EDR Site ID:	CT001	Component ID:	A15	Grace Period:	0
		Component Type:	NOXA		
Instrument	CT1_NOXDualRg_P_Instr	Test End	07/21/2022	Scale:	High
Performance	5 %	Test No.:	118	Highest	3.1
		Status	Passed		

Date	Time	Cal Gas Level	Span Value	Ref Value	Meas Value	Aborted Test Indicator	Ref Value As Pct Span
07/21/2022	1232	L	200.0	47.8	46.6		23.9 %
07/21/2022	1237	M	200.0	105.0	108.1		52.5 %
07/21/2022	1242	H	200.0	175.0	176.2		87.5 %
07/21/2022	1249	L	200.0	47.8	49.0		23.9 %
07/21/2022	1254	M	200.0	105.0	108.4		52.5 %
07/21/2022	1259	H	200.0	175.0	176.0		87.5 %
07/21/2022	1306	L	200.0	47.8	49.3		23.9 %
07/21/2022	1311	M	200.0	105.0	108.3		52.5 %
07/21/2022	1316	H	200.0	175.0	175.8		87.5 %

Summary

Cal Gas Level	Reference Mean	CEMS Mean	Alt Perf Spec	Results
L	47.800	48.300	No	1.0
M	105.000	108.267	No	3.1
H	175.000	176.000	No	0.6

Linearity Report

10/01/2022

Page 2

ORIS Code:	56298	Facility Name:	ROSEVILLE ENERGY	ReasonForTes	QA
EDR Site ID:	CT001	Component ID:	A16	Grace Period:	0
		Component Type:	O2D		
Instrument	CT1_O2D_P_Instrument	Test End	07/21/2022	Scale:	High
Performance	5 %	Test No.:	119	Highest	1.8
		Status	Passed		

Date	Time	Cal Gas Level	Span Value	Ref Value	Meas Value	Aborted Test Indicator	Ref Value As Pct Span
07/21/2022	1428	L	21.0	5.5	5.6		26.2 %
07/21/2022	1433	M	21.0	11.1	11.1		52.9 %
07/21/2022	1438	H	21.0	18.1	18.2		86.2 %
07/21/2022	1445	L	21.0	5.5	5.6		26.2 %
07/21/2022	1450	M	21.0	11.1	11.1		52.9 %
07/21/2022	1455	H	21.0	18.1	18.2		86.2 %
07/21/2022	1502	L	21.0	5.5	5.6		26.2 %
07/21/2022	1507	M	21.0	11.1	11.1		52.9 %
07/21/2022	1512	H	21.0	18.1	18.2		86.2 %

Summary

Cal Gas Level	Reference Mean	CEMS Mean	Alt Perf Spec	Results
L	5.500	5.600	No	1.8
M	11.100	11.100	No	0.0
H	18.100	18.200	No	0.6

Linearity Report

10/01/2022

Page 3

ORIS Code:	56298	Facility Name:	ROSEVILLE ENERGY	ReasonForTes	QA
EDR Site ID:	CT002	Component ID:	A21	Grace Period:	0
		Component Type:	NOXA		
Instrument	CT2_NOXDualRg_P_Instr	Test End	08/03/2022	Scale:	High
Performance	5 %	Test No.:	121	Highest	2.5
		Status	Passed		

Date	Time	Cal Gas Level	Span Value	Ref Value	Meas Value	Aborted Test Indicator	Ref Value As Pct Span
08/03/2022	0735	L	200.0	48.2	47.4		24.1 %
08/03/2022	0740	M	200.0	106.0	108.7		53.0 %
08/03/2022	0746	H	200.0	182.0	182.1		91.0 %
08/03/2022	0753	L	200.0	48.2	47.9		24.1 %
08/03/2022	0758	M	200.0	106.0	108.6		53.0 %
08/03/2022	0803	H	200.0	182.0	182.0		91.0 %
08/03/2022	0810	L	200.0	48.2	48.5		24.1 %
08/03/2022	0815	M	200.0	106.0	108.7		53.0 %
08/03/2022	0820	H	200.0	182.0	182.1		91.0 %

Summary

Cal Gas Level	Reference Mean	CEMS Mean	Alt Perf Spec	Results
L	48.200	47.933	No	0.6
M	106.000	108.667	No	2.5
H	182.000	182.067	No	0.0

Linearity Report

10/01/2022

Page 4

ORIS Code:	56298	Facility Name:	ROSEVILLE ENERGY	ReasonForTes	QA
EDR Site ID:	CT002	Component ID:	A22	Grace Period:	0
		Component Type:	O2D		
Instrument	CT2_O2D_P_Instrument	Test End	08/03/2022	Scale:	High
Performance	5 %	Test No.:	122	Highest	0.0
		Status	Passed		

Date	Time	Cal Gas Level	Span Value	Ref Value	Meas Value	Aborted Test Indicator	Ref Value As Pct Span
08/03/2022	1026	L	21.0	5.0	5.0		23.8 %
08/03/2022	1031	M	21.0	11.2	11.2		53.3 %
08/03/2022	1036	H	21.0	18.1	18.1		86.2 %
08/03/2022	1043	L	21.0	5.0	5.0		23.8 %
08/03/2022	1048	M	21.0	11.2	11.2		53.3 %
08/03/2022	1053	H	21.0	18.1	18.1		86.2 %
08/03/2022	1100	L	21.0	5.0	5.0		23.8 %
08/03/2022	1105	M	21.0	11.2	11.2		53.3 %
08/03/2022	1110	H	21.0	18.1	18.1		86.2 %

Summary

Cal Gas Level	Reference Mean	CEMS Mean	Alt Perf Spec	Results
L	5.000	5.000	No	0.0
M	11.200	11.200	No	0.0
H	18.100	18.100	No	0.0

Roseville Energy Park Revision History

RegPerfect® by Teledyne Monitor Labs, Inc.

Teledyne Monitor Labs, Inc.

35 Inverness Drive East

Englewood, CO 80112-5189

Telephone: (800) 846-6062

<http://www.teledyne-ml.com/>

<http://www.regperfect.com/>

©1998-2005 Teledyne Monitor Labs, Inc. All rights reserved.

RegPerfect® is a registered trademark of Teledyne Monitor Labs, Inc.

NOTE: This server's C drive is only 20 GB in size!! Do not place large files on this drive.

9/6/22 Taylor Sullivan

EDR check

7/22,28/22 Taylor Sullivan

Q2 EDRs

7/1/22 William Vanhorn

Checking to see if the NOx excess emissions are correct on 6/30.

ATTACHMENT 10

AQ-41

AQ-41The Project owner shall submit a written report to the APCO and the CPM for each calendar quarter, within 30 days of the end of the quarter, including: time intervals, data and magnitude of excess emissions, nature and cause of excess (if known), corrective actions taken and preventive measures adopted; averaging period used for data reporting shall correspond to the averaging period for each respective emission standard; applicable time and date of each period during which the CEMS was inoperative (except for zero and span checks) and the nature of the system repairs and adjustments; and a negative declaration when no excess emission occurred.

Verification: The Project owner shall include the excess emission report as part of the Quarterly Air Quality Report required in Condition of Certification AQ-SC6

Excess Emission Report



From: 07/01/2022 00:00 **To:** 09/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 10/01/2022 21:52 **Location:** Roseville, CA

Tag Name: ALL_CO_Lb_1D
Total Operating Time: 92.00 Day(s) **No Exclusions Allowed**
Non-Operating Time: 0.00 Day(s) Report Time: 92.00 Day(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

Total Operating Time:	92.00 Day(s)
Total Duration (Online only):	0.00 Day(s)
Time in exceedance as a percentage of operating time:	0.00 %
Time in compliance as a percentage of operating time:	100.00 %

Excess Emission Report



From: 07/01/2022 00:00 **To:** 09/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 10/01/2022 21:54 **Location:** Roseville, CA

Tag Name: ALL_NOX_Lb_1D
Total Operating Time: 92.00 Day(s) **No Exclusions Allowed**
Non-Operating Time: 0.00 Day(s) Report Time: 92.00 Day(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

Total Operating Time:	92.00 Day(s)
Total Duration (Online only):	0.00 Day(s)
Time in exceedance as a percentage of operating time:	0.00 %
Time in compliance as a percentage of operating time:	100.00 %

Excess Emission Report



From: 07/01/2022 00:00 **To:** 09/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 10/01/2022 21:54 **Location:** Roseville, CA

Tag Name: ALL_PM10_Lb_1D
Total Operating Time: 92.00 Day(s) **No Exclusions Allowed**
Non-Operating Time: 0.00 Day(s) Report Time: 92.00 Day(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

Total Operating Time:	92.00 Day(s)
Total Duration (Online only):	0.00 Day(s)
Time in exceedance as a percentage of operating time:	0.00 %
Time in compliance as a percentage of operating time:	100.00 %

Excess Emission Report



From: 07/01/2022 00:00 **To:** 09/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 10/01/2022 21:55 **Location:** Roseville, CA

Tag Name: ALL_SO2_Lb_1D
Total Operating Time: 92.00 Day(s) **No Exclusions Allowed**
Non-Operating Time: 0.00 Day(s) Report Time: 92.00 Day(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

Total Operating Time:	92.00 Day(s)
Total Duration (Online only):	0.00 Day(s)
Time in exceedance as a percentage of operating time:	0.00 %
Time in compliance as a percentage of operating time:	100.00 %

Excess Emission Report



From: 07/01/2022 00:00 **To:** 09/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 10/01/2022 21:55 **Location:** Roseville, CA

Tag Name: ALL_VOC_Lb_1D
Total Operating Time: 92.00 Day(s) **No Exclusions Allowed**
Non-Operating Time: 0.00 Day(s) Report Time: 92.00 Day(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

Total Operating Time:	92.00 Day(s)
Total Duration (Online only):	0.00 Day(s)
Time in exceedance as a percentage of operating time:	0.00 %
Time in compliance as a percentage of operating time:	100.00 %

CO LbPerHr 3-Hour Rolling Excess Emissions

CT1

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:56 Location: Roseville, CA



Tag Name: CT1_CO_3Hr_LbPerHr_1H
Total Operating Time: 2,032.00 Hour(s) No Exclusions Allowed
Non-Operating Time: 176.00 Hour(s) Report Time: 2,208.00 Hour(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

Total Operating Time:	2,032.00 Hour(s)
Total Duration (Online only):	0.00 Hour(s)
Time in exceedance as a percentage of operating time:	0.00 %
Time in compliance as a percentage of operating time:	100.00 %

CO Ppmvdc 3-Hour Block Excess Emissions



CT1

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:56 Location: Roseville, CA

Tag Name: CT1_CO_Ppmvdc_3H
Total Operating Time: 2,032.00 Hour(s) No Exclusions Allowed
Non-Operating Time: 176.00 Hour(s) Report Time: 2,208.00 Hour(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

Total Operating Time:	2,032.00 Hour(s)
Total Duration (Online only):	0.00 Hour(s)
Time in exceedance as a percentage of operating time:	0.00 %
Time in compliance as a percentage of operating time:	100.00 %

CO LbPerHr SUSd 1-Hour Block Excess Emissions



CT1

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:57 Location: Roseville, CA

Tag Name: CT1_CO_SUSd_LbPerHr_1H
Total Operating Time: 2,032.00 Hour(s) No Exclusions Allowed
Non-Operating Time: 176.00 Hour(s) Report Time: 2,208.00 Hour(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

Total Operating Time:	2,032.00 Hour(s)
Total Duration (Online only):	0.00 Hour(s)
Time in exceedance as a percentage of operating time:	0.00 %
Time in compliance as a percentage of operating time:	100.00 %

NH3 Slip Ppmvdc 1-Hour Block Excess Emissions



CT1

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:57 Location: Roseville, CA

Tag Name: CT1_NH3Slip_Ppmvdc_1H
Total Operating Time: 2,032.00 Hour(s) No Exclusions Allowed
Non-Operating Time: 176.00 Hour(s) Report Time: 2,208.00 Hour(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

Total Operating Time:	2,032.00 Hour(s)
Total Duration (Online only):	0.00 Hour(s)
Time in exceedance as a percentage of operating time:	0.00 %
Time in compliance as a percentage of operating time:	100.00 %

NOx LbPerHr 1-Hour Block Excess Emissions



CT1

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:58 Location: Roseville, CA

Tag Name: CT1_NOx_Norm_LbPerHr_1H
Total Operating Time: 2,032.00 Hour(s) No Exclusions Allowed
Non-Operating Time: 176.00 Hour(s) Report Time: 2,208.00 Hour(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

Total Operating Time:	2,032.00 Hour(s)
Total Duration (Online only):	0.00 Hour(s)
Time in exceedance as a percentage of operating time:	0.00 %
Time in compliance as a percentage of operating time:	100.00 %

NOx Ppmvdc 1-Hour Block Excess Emissions

CT1

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:58 Location: Roseville, CA



Tag Name: CT1_NOx_Ppmvdc_1H

Total Operating Time: 2,032.00 Hour(s)

No Exclusions Allowed

Non-Operating Time: 176.00 Hour(s) Report Time: 2,208.00 Hour(s)

Inc No	Start Time	End Time	Duration in Hour(s)	Tag Value	Limit	Reason Code	Action Code
1	09/29/22 02:00	09/29/22 02:59	1	2.1	2.0		

Total Operating Time:	2,032.00 Hour(s)
Total Duration (Online only):	1.00 Hour(s)
Time in exceedance as a percentage of operating time:	0.05 %
Time in compliance as a percentage of operating time:	99.95 %

NOx LbPerHr SUSd 1-Hour Block Excess Emissions



CT1

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:59 Location: Roseville, CA

Tag Name: CT1_NOx_SUSd_LbPerHr_1H
Total Operating Time: 2,032.00 Hour(s) No Exclusions Allowed
Non-Operating Time: 176.00 Hour(s) Report Time: 2,208.00 Hour(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

Total Operating Time:	2,032.00 Hour(s)
Total Duration (Online only):	0.00 Hour(s)
Time in exceedance as a percentage of operating time:	0.00 %
Time in compliance as a percentage of operating time:	100.00 %

PM10 LbPerHr 1-Hour Block Excess Emissions

CT1

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 21:59 Location: Roseville, CA



Tag Name: CT1_PM10_Norm_LbPerHr_1H
Total Operating Time: 2,032.00 Hour(s) No Exclusions Allowed
Non-Operating Time: 176.00 Hour(s) Report Time: 2,208.00 Hour(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

Total Operating Time:	2,032.00 Hour(s)
Total Duration (Online only):	0.00 Hour(s)
Time in exceedance as a percentage of operating time:	0.00 %
Time in compliance as a percentage of operating time:	100.00 %

S02 LbPerHr 1-Hour Block Excess Emissions



CT1

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:00 Location: Roseville, CA

Tag Name: CT1_S02_Norm_LbPerHr_1H
Total Operating Time: 2,032.00 Hour(s) No Exclusions Allowed
Non-Operating Time: 176.00 Hour(s) Report Time: 2,208.00 Hour(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

Total Operating Time:	2,032.00 Hour(s)
Total Duration (Online only):	0.00 Hour(s)
Time in exceedance as a percentage of operating time:	0.00 %
Time in compliance as a percentage of operating time:	100.00 %

VOC LbPerHr 1-Hour Block Excess Emissions



CT1

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:00 Location: Roseville, CA

Tag Name: CT1_VOC_Norm_LbPerHr_1H
Total Operating Time: 2,032.00 Hour(s) No Exclusions Allowed
Non-Operating Time: 176.00 Hour(s) Report Time: 2,208.00 Hour(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

Total Operating Time:	2,032.00 Hour(s)
Total Duration (Online only):	0.00 Hour(s)
Time in exceedance as a percentage of operating time:	0.00 %
Time in compliance as a percentage of operating time:	100.00 %

CO LbPerHr 3-Hour Rolling Excess Emissions

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:03 Location: Roseville, CA

Tag Name: CT2_CO_3Hr_LbPerHr_1H
Total Operating Time: 1,949.00 Hour(s) No Exclusions Allowed
Non-Operating Time: 259.00 Hour(s) Report Time: 2,208.00 Hour(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

Total Operating Time:	1,949.00 Hour(s)
Total Duration (Online only):	0.00 Hour(s)
Time in exceedance as a percentage of operating time:	0.00 %
Time in compliance as a percentage of operating time:	100.00 %

CO Ppmvdc 3-Hour Block Excess Emissions

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:04 Location: Roseville, CA

Tag Name: CT2_CO_Ppmvdc_3H
Total Operating Time: 1,949.00 Hour(s) No Exclusions Allowed
Non-Operating Time: 259.00 Hour(s) Report Time: 2,208.00 Hour(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

Total Operating Time:	1,949.00 Hour(s)
Total Duration (Online only):	0.00 Hour(s)
Time in exceedance as a percentage of operating time:	0.00 %
Time in compliance as a percentage of operating time:	100.00 %

CO LbPerHr SUSd 1-Hour Block Excess Emissions



CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:04 Location: Roseville, CA

Tag Name: CT2_CO_SUSd_LbPerHr_1H
Total Operating Time: 1,949.00 Hour(s) No Exclusions Allowed
Non-Operating Time: 259.00 Hour(s) Report Time: 2,208.00 Hour(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

Total Operating Time:	1,949.00 Hour(s)
Total Duration (Online only):	0.00 Hour(s)
Time in exceedance as a percentage of operating time:	0.00 %
Time in compliance as a percentage of operating time:	100.00 %

NH3 Slip Ppmvdc 1-Hour Block Excess Emissions



CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:05 Location: Roseville, CA

Tag Name: CT2_NH3Slip_Ppmvdc_1H
Total Operating Time: 1,949.00 Hour(s) No Exclusions Allowed
Non-Operating Time: 259.00 Hour(s) Report Time: 2,208.00 Hour(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

Total Operating Time:	1,949.00 Hour(s)
Total Duration (Online only):	0.00 Hour(s)
Time in exceedance as a percentage of operating time:	0.00 %
Time in compliance as a percentage of operating time:	100.00 %

NOx LbPerHr 1-Hour Block Excess Emissions

CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:06 Location: Roseville, CA



Tag Name: CT2_NOx_Norm_LbPerHr_1H
Total Operating Time: 1,949.00 Hour(s) No Exclusions Allowed
Non-Operating Time: 259.00 Hour(s) Report Time: 2,208.00 Hour(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

Total Operating Time:	1,949.00 Hour(s)
Total Duration (Online only):	0.00 Hour(s)
Time in exceedance as a percentage of operating time:	0.00 %
Time in compliance as a percentage of operating time:	100.00 %

NOx Ppmvdc 1-Hour Block Excess Emissions

CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:06 Location: Roseville, CA



Tag Name: CT2_NOx_Ppmvdc_1H

Total Operating Time: 1,949.00 Hour(s)

No Exclusions Allowed

Non-Operating Time: 259.00 Hour(s) Report Time: 2,208.00 Hour(s)

Inc No	Start Time	End Time	Duration in Hour(s)	Tag Value	Limit	Reason Code	Action Code
1	09/29/22 02:00	09/29/22 02:59	1	2.2	2.0		

Total Operating Time:	1,949.00 Hour(s)
Total Duration (Online only):	1.00 Hour(s)
Time in exceedance as a percentage of operating time:	0.05 %
Time in compliance as a percentage of operating time:	99.95 %

NOx LbPerHr SUSd 1-Hour Block Excess Emissions



CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:07 Location: Roseville, CA

Tag Name: CT2_NOx_SUSd_LbPerHr_1H
Total Operating Time: 1,949.00 Hour(s) No Exclusions Allowed
Non-Operating Time: 259.00 Hour(s) Report Time: 2,208.00 Hour(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

Total Operating Time:	1,949.00 Hour(s)
Total Duration (Online only):	0.00 Hour(s)
Time in exceedance as a percentage of operating time:	0.00 %
Time in compliance as a percentage of operating time:	100.00 %

PM10 LbPerHr 1-Hour Block Excess Emissions

CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:08 Location: Roseville, CA



Tag Name: CT2_PM10_Norm_LbPerHr_1H
Total Operating Time: 1,949.00 Hour(s) No Exclusions Allowed
Non-Operating Time: 259.00 Hour(s) Report Time: 2,208.00 Hour(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

Total Operating Time:	1,949.00 Hour(s)
Total Duration (Online only):	0.00 Hour(s)
Time in exceedance as a percentage of operating time:	0.00 %
Time in compliance as a percentage of operating time:	100.00 %

S02 LbPerHr 1-Hour Block Excess Emissions

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:08 Location: Roseville, CA

Tag Name: CT2_S02_Norm_LbPerHr_1H
Total Operating Time: 1,949.00 Hour(s) No Exclusions Allowed
Non-Operating Time: 259.00 Hour(s) Report Time: 2,208.00 Hour(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

Total Operating Time:	1,949.00 Hour(s)
Total Duration (Online only):	0.00 Hour(s)
Time in exceedance as a percentage of operating time:	0.00 %
Time in compliance as a percentage of operating time:	100.00 %

VOC LbPerHr 1-Hour Block Excess Emissions

CT2

From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:09 Location: Roseville, CA



Tag Name: CT2_VOC_Norm_LbPerHr_1H
Total Operating Time: 1,949.00 Hour(s) No Exclusions Allowed
Non-Operating Time: 259.00 Hour(s) Report Time: 2,208.00 Hour(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

Total Operating Time:	1,949.00 Hour(s)
Total Duration (Online only):	0.00 Hour(s)
Time in exceedance as a percentage of operating time:	0.00 %
Time in compliance as a percentage of operating time:	100.00 %

ATTACHMENT 11

AQ-42

AQ-42 The Project owner shall provide the PCAPCD and CPM with a written emission statement showing actual emissions of volatile organic compounds and oxides of nitrogen. Pursuant to PCAPCD Rule 503 the Project owner shall submit this emission statement on a form or in a format specified by the Air Pollution Control Officer. The statement shall contain the following information:

- a) Information contained in the California Air Resources Board's Emission Inventory Turn Around Document as described in Instructions for the Emission Data System Review and Update Report;
- b) Actual emissions of volatile organic compounds and oxides of nitrogen, in tons per year, for the calendar year prior to the preparation of the emission statement;
- c) Information regarding seasonal or diurnal peaks in the emission of affected pollutants; and
- d) Certification by a responsible official of the Project owner that the information contained in the emission statement is accurate to the best knowledge of the individual certifying the emission statement.

Verification: The Project owner shall submit to the CPM the emission statement described herein prior to the beginning of March each year.

12 Month Running Summary Report

AQ42 12 Month Running Summary Report



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:15 Location: Roseville, CA

Date	Units CT1 & CT2		Units CT1 & CT2	
	NOx, Ton		VOC, Ton	
	1 Day(s)		1 Day(s)	
	Sum	Running Sum	Sum	Running Sum
Jul 22	1.5269	1.5269	0.5141	0.5141
Aug 22	1.7288	3.2557	0.5774	1.0915
Sep 22	1.6900	4.9457	0.5740	1.6655
Sum/Avg	4.9457		1.6655	

Roseville Energy Park Quarterly Emissions Summary

for PCAPCD



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:11 Location: Roseville, CA

* = Excess Emission

Date	Unit CT1 CO, Ton		Unit CT1 NOx, Ton		Unit CT1 OperatingTime, Hrs		Unit CT2 CO, Ton		Unit CT2 NOx, Ton		Unit CT2 OperatingTime, Hrs	
	1 Day(s)		1 Day(s)		1 Day(s)		1 Day(s)		1 Day(s)		1 Day(s)	
	Sum	Rolling Sum	Sum	Rolling Sum	Sum	Rolling Sum	Sum	Rolling Sum	Sum	Rolling Sum	Sum	Rolling Sum
Jul 2022	0.2344	2.9888	0.8321	6.6000	744.00	6,159.69	0.3882	3.7699	0.6952	7.0729	507.58	6,150.21
Aug 2022	0.2567	2.9505	0.7409	6.4856	579.31	5,995.00	0.3404	3.8085	0.9883	7.1610	726.05	6,140.93
Sep 2022	0.2230	2.9220	0.8239	6.5490	705.38	5,997.07	0.3020	3.8403	0.8660	7.2966	703.30	6,198.86
Sum/Avg	2.9220		6.5490		5,997.07		3.8403		7.2966		6,198.86	
Limit Value												

ATTACHMENT 12

AQ-47

AQ-47 No emissions are permitted, from any source, which are a nuisance per PCAPCD Rule 205, Nuisance.

Verification: The Project owner shall report all violations of this condition as noticed by the PCAPCD as well as any offsite nuisance complaints as part of the Quarterly Air Quality Report in Condition of Certification AQ-SC6

In regards to AQ-47 of Roseville Energy Park's 3Q22 QAQR, there were no violations of PCAPCD's Rule 205 for nuisance.

ATTACHMENT 13

AQ-48

AQ-48 Stack emission opacity as dark as Ringelmann No. 1 (20% opacity) for periods aggregating more than 3 minutes in any one hour is prohibited and is in violation of PCAPCD Rule 202, Visible Emissions.

Verification: The Project owner shall report all violations of this condition as noticed by the PCAPCD as well as any offsite nuisance complaints as part of the Quarterly Air Quality Report in Condition of Certification AQ-SC6

In regards to AQ-48 of Roseville Energy Park's 3Q22 QAQR, there were no violations of PCAPCD's Rule 202 for opacity.

ATTACHMENT 14

AQ-51

AQ-51 The ammonia slip shall not exceed 10 ppmv @ 15% O₂ averaged over one hour. The SCR catalyst shall be replaced, repaired or otherwise reconditioned within 24 months of the ammonia slip reaching 7 ppm @ 15% O₂ averaged over 24 hours. The SCR ammonia injection grid replacement, repair or reconditioning scheduled event may be cancelled if the Project owner can demonstrate to the CPM that, subsequent to the initial exceedance, the ammonia slip consistently remains below 7 ppm @ 15% O₂ averaged over 24 hours and that the initial exceedance does not accurately indicate expected future operating conditions.

Compliance with ammonia slip limits shall be demonstrated by using the following calculation procedure:

$$\text{Ammonia slip ppmv @ 15\% O}_2 = ((a - (b \times c / 1,000,000)) \times 1,000,000 / b) \times d,$$

Where

a = ammonia injection rate (lb/hr)/17(lb/lb mol)

b = dry exhaust gas flow rate (lb/hr)/ (29(lb/lb mol)

c = change in measured NOX conc. Ppmv @ 15% O₂ across catalyst, and

d = correction factor

The correction factor shall be derived annually during compliance testing by comparing the measured and calculated ammonia slip.

Verification: The Project owner shall include the ammonia slip concentrations averaged on an hourly and 24 hour basis calculated via the protocol provided as part of the Quarterly Air Quality Report required in Condition of Certification AQ-SC6. The Project owner shall notify the CPM within 10 days of an exceedance of the 7 ppm ammonia slip limit herein. The Project owner shall notify the CPM no less than 30 days prior to the scheduled date of the SCR catalyst replacement, repair or reconditioning event. If the Project owner finds that the exceedance of the 7 ppm slip limit does not accurately reflect the expected future operations provided for in this condition, the Project owner shall submit all relevant information to the CPM no less than 30 days prior to the scheduled date of the SCR catalyst replacement, repair or reconditioning event in order to cancel the event.

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:21 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:	> 10							
	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1
	NH3Slip, Ppmvdc	NOx, Ppm	NOx, _SCR, Ppm	O2, Dry, Pct	NH3Inj, LbPerHr	ExhaustFlow, LbPerHr	SUSD, Hr	OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/01/2022 00:00	2	1.6	8.0	14.5	17.0	798,331.6	0.00	1.00
07/01/2022 01:00	2	1.6	9.5	14.6	17.5	647,759.5	0.00	1.00
07/01/2022 02:00	1	1.5	10.1	14.6	17.7	650,367.9	0.00	1.00
07/01/2022 03:00	2	1.6	9.7	14.6	17.7	653,845.8	0.00	1.00
07/01/2022 04:00	2	1.6	9.6	14.6	17.9	656,454.2	0.00	1.00
07/01/2022 05:00	1	1.6	8.3	14.5	15.6	772,440.9	0.00	1.00
07/01/2022 06:00	2	1.6	9.7	14.6	17.1	649,498.4	0.00	1.00
07/01/2022 07:00	1	1.6	9.2	14.6	15.2	651,889.5	0.00	1.00
07/01/2022 08:00	1	1.6	8.9	14.6	14.7	650,150.5	0.00	1.00
07/01/2022 09:00	1	1.6	8.6	14.7	14.1	660,636.8	0.00	1.00
07/01/2022 10:00	1	1.6	8.4	14.7	13.7	662,183.0	0.00	1.00
07/01/2022 11:00	1	1.6	8.1	14.7	13.2	667,263.1	0.00	1.00
07/01/2022 12:00	1	1.6	7.9	14.7	12.4	669,030.1	0.00	1.00
07/01/2022 13:00	1	1.6	7.9	14.7	12.1	664,612.6	0.00	1.00
07/01/2022 14:00	1	1.6	8.0	14.8	12.5	673,262.9	0.00	1.00
07/01/2022 15:00	1	1.6	8.2	14.8	13.0	671,915.9	0.00	1.00
07/01/2022 16:00	1	1.5	7.8	14.7	12.8	763,343.7	0.00	1.00
07/01/2022 17:00	1	1.7	7.5	14.3	16.5	975,196.2	0.00	1.00
07/01/2022 18:00	1	1.7	7.2	14.3	15.7	961,294.4	0.00	1.00
07/01/2022 19:00	1	1.7	8.3	14.1	18.9	1,001,089.5	0.00	1.00
07/01/2022 20:00	1	1.7	8.0	14.1	18.7	992,832.7	0.00	1.00
07/01/2022 21:00	1	1.7	7.9	14.2	19.2	1,000,701.8	0.00	1.00
07/01/2022 22:00	1	1.7	7.5	14.3	18.0	909,007.3	0.00	1.00
07/01/2022 23:00	2	1.6	8.9	14.5	15.9	658,821.5	0.00	1.00
Average/Sum#:	1	1.6	8.5	14.5	15.7	752,580.4	0.00 #	24.00 #
Minimum:	1	1.5	7.2	14.1	12.1	647,759.5	0.00	1.00
Maximum:	2	1.7	10.1	14.8	19.2	1,001,089.5	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 **To:** 09/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 10/01/2022 22:21 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOX, Ppm	Unit CT1 NOX, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/02/2022 00:00	2	1.6	9.5	14.6	17.2	644,933.7	0.00	1.00
07/02/2022 01:00	2	1.6	9.8	14.6	18.4	644,498.9	0.00	1.00
07/02/2022 02:00	2	1.6	10.1	14.6	18.3	646,890.0	0.00	1.00
07/02/2022 03:00	2	1.6	9.7	14.6	18.7	649,933.2	0.00	1.00
07/02/2022 04:00	2	1.6	9.7	14.6	18.9	649,715.8	0.00	1.00
07/02/2022 05:00	2	1.6	10.0	14.6	19.2	645,803.1	0.00	1.00
07/02/2022 06:00	2	1.6	9.8	14.6	17.3	645,368.4	0.00	1.00
07/02/2022 07:00	1	1.6	9.5	14.6	15.8	646,890.0	0.00	1.00
07/02/2022 08:00	1	1.6	9.2	14.6	15.2	647,324.7	0.00	1.00
07/02/2022 09:00	1	1.6	8.9	14.6	14.8	647,976.8	0.00	1.00
07/02/2022 10:00	1	1.6	8.6	14.7	14.6	658,869.8	0.00	1.00
07/02/2022 11:00	1	1.6	8.3	14.7	13.8	664,170.8	0.00	1.00
07/02/2022 12:00	1	1.6	8.3	14.7	13.7	665,054.3	0.00	1.00
07/02/2022 13:00	1	1.6	8.2	14.7	13.0	664,391.7	0.00	1.00
07/02/2022 14:00	1	1.6	8.1	14.7	12.2	664,391.7	0.00	1.00
07/02/2022 15:00	1	1.6	8.1	14.7	12.7	663,950.0	0.00	1.00
07/02/2022 16:00	1	1.6	7.9	14.7	12.4	664,833.5	0.00	1.00
07/02/2022 17:00	1	1.6	8.0	14.7	12.9	665,937.8	0.00	1.00
07/02/2022 18:00	1	1.6	8.0	14.6	12.9	663,627.4	0.00	1.00
07/02/2022 19:00	2	1.6	8.4	14.6	14.8	648,194.2	0.00	1.00
07/02/2022 20:00	2	1.6	8.9	14.6	16.2	646,672.6	0.00	1.00
07/02/2022 21:00	2	1.6	9.3	14.6	17.1	644,933.7	0.00	1.00
07/02/2022 22:00	2	1.6	9.4	14.6	16.7	646,890.0	0.00	1.00
07/02/2022 23:00	2	1.6	9.4	14.6	17.1	647,759.5	0.00	1.00
Average/Sum#:	2	1.6	9.0	14.6	15.6	653,292.2	0.00 #	24.00 #
Minimum:	1	1.6	7.9	14.6	12.2	644,498.9	0.00	1.00
Maximum:	2	1.6	10.1	14.7	19.2	665,937.8	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:21 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOx, Ppm	Unit CT1 NOx, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/03/2022 00:00	2	1.6	9.5	14.6	17.4	648,411.6	0.00	1.00
07/03/2022 01:00	2	1.6	9.4	14.6	17.6	649,281.1	0.00	1.00
07/03/2022 02:00	2	1.5	9.6	14.6	17.9	652,541.6	0.00	1.00
07/03/2022 03:00	2	1.6	9.8	14.6	18.1	647,324.7	0.00	1.00
07/03/2022 04:00	2	1.6	9.8	14.6	18.7	645,151.0	0.00	1.00
07/03/2022 05:00	2	1.6	9.5	14.6	17.8	649,063.7	0.00	1.00
07/03/2022 06:00	2	1.6	9.4	14.6	17.1	651,237.4	0.00	1.00
07/03/2022 07:00	2	1.6	9.1	14.6	16.1	654,063.2	0.00	1.00
07/03/2022 08:00	2	1.6	9.0	14.6	15.8	651,889.5	0.00	1.00
07/03/2022 09:00	1	1.6	8.7	14.6	14.8	654,063.2	0.00	1.00
07/03/2022 10:00	1	1.6	8.4	14.6	14.2	654,932.6	0.00	1.00
07/03/2022 11:00	1	1.6	8.7	14.7	15.1	657,765.5	0.00	1.00
07/03/2022 12:00	1	1.6	8.6	14.7	14.3	659,311.6	0.00	1.00
07/03/2022 13:00	1	1.6	8.4	14.7	13.8	661,741.2	0.00	1.00
07/03/2022 14:00	1	1.6	8.4	14.7	13.2	660,636.8	0.00	1.00
07/03/2022 15:00	1	1.6	8.2	14.7	13.1	661,078.6	0.00	1.00
07/03/2022 16:00	1	1.6	8.1	14.7	13.3	661,078.6	0.00	1.00
07/03/2022 17:00	1	1.6	8.2	14.7	13.4	661,962.1	0.00	1.00
07/03/2022 18:00	1	1.6	8.3	14.7	13.8	659,532.5	0.00	1.00
07/03/2022 19:00	2	1.6	8.5	14.7	15.1	655,115.0	0.00	1.00
07/03/2022 20:00	2	1.6	9.2	14.7	16.8	654,010.6	0.00	1.00
07/03/2022 21:00	2	1.6	9.4	14.6	17.2	643,194.7	0.00	1.00
07/03/2022 22:00	2	1.6	9.7	14.6	17.3	642,542.6	0.00	1.00
07/03/2022 23:00	2	1.6	9.5	14.6	17.2	646,455.3	0.00	1.00
Average/Sum#:	2	1.6	9.0	14.6	15.8	653,432.7	0.00 #	24.00 #
Minimum:	1	1.5	8.1	14.6	13.1	642,542.6	0.00	1.00
Maximum:	2	1.6	9.8	14.7	18.7	661,962.1	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:21 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOx, Ppm	Unit CT1 NOx, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/04/2022 00:00	2	1.6	9.5	14.6	17.5	647,542.1	0.00	1.00
07/04/2022 01:00	2	1.6	9.5	14.6	17.4	646,455.3	0.00	1.00
07/04/2022 02:00	2	1.8	10.3	14.6	17.9	641,890.5	0.00	1.00
07/04/2022 03:00	2	1.6	9.9	14.6	17.8	645,368.4	0.00	1.00
07/04/2022 04:00	2	1.6	9.7	14.6	18.3	649,715.8	0.00	1.00
07/04/2022 05:00	2	1.6	9.9	14.6	18.6	645,151.0	0.00	1.00
07/04/2022 06:00	2	1.6	9.7	14.6	17.4	643,846.8	0.00	1.00
07/04/2022 07:00	1	1.7	9.3	14.6	14.2	645,368.4	0.00	1.00
07/04/2022 08:00	1	1.8	8.7	14.6	13.4	647,324.7	0.00	1.00
07/04/2022 09:00	1	1.8	8.2	14.7	12.4	659,753.3	0.00	1.00
07/04/2022 10:00	1	1.8	8.0	14.7	12.2	662,845.6	0.00	1.00
07/04/2022 11:00	1	1.8	7.9	14.7	11.7	665,275.2	0.00	1.00
07/04/2022 12:00	1	1.7	7.8	14.7	11.2	661,078.6	0.00	1.00
07/04/2022 13:00	0	1.7	7.8	14.7	8.9	661,520.3	0.00	1.00
07/04/2022 14:00	0	1.7	7.7	14.7	8.8	661,962.1	0.00	1.00
07/04/2022 15:00	0	1.7	7.5	14.7	9.3	661,078.6	0.00	1.00
07/04/2022 16:00	0	1.7	7.6	14.7	8.8	660,195.1	0.00	1.00
07/04/2022 17:00	0	1.7	7.5	14.7	8.8	658,207.2	0.00	1.00
07/04/2022 18:00	0	1.7	7.5	14.7	8.4	656,440.2	0.00	1.00
07/04/2022 19:00	1	1.7	7.6	14.7	10.8	655,335.8	0.00	1.00
07/04/2022 20:00	1	1.7	7.8	14.7	11.9	655,556.7	0.00	1.00
07/04/2022 21:00	1	1.7	7.9	14.7	12.3	655,115.0	0.00	1.00
07/04/2022 22:00	1	1.7	8.1	14.6	13.1	644,933.7	0.00	1.00
07/04/2022 23:00	1	1.7	7.9	14.6	12.6	646,890.0	0.00	1.00
Average/Sum#:	1	1.7	8.5	14.7	13.1	653,285.4	0.00 #	24.00 #
Minimum:	0	1.6	7.5	14.6	8.4	641,890.5	0.00	1.00
Maximum:	2	1.8	10.3	14.7	18.6	665,275.2	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:21 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOx, Ppm	Unit CT1 NOx, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/05/2022 00:00	1	1.7	7.7	14.6	12.1	650,802.6	0.00	1.00
07/05/2022 01:00	1	1.7	7.7	14.6	12.7	650,802.6	0.00	1.00
07/05/2022 02:00	1	1.7	8.1	14.6	13.4	649,715.8	0.00	1.00
07/05/2022 03:00	1	1.7	8.0	14.6	13.4	648,846.3	0.00	1.00
07/05/2022 04:00	1	1.7	8.0	14.6	13.6	647,324.7	0.00	1.00
07/05/2022 05:00	1	1.6	8.1	14.6	14.0	647,107.4	0.00	1.00
07/05/2022 06:00	1	1.6	7.9	14.6	13.5	648,411.6	0.00	1.00
07/05/2022 07:00	1	1.6	7.8	14.6	12.1	648,411.6	0.00	1.00
07/05/2022 08:00	1	1.6	7.6	14.6	10.2	649,715.8	0.00	1.00
07/05/2022 09:00	0	1.6	7.5	14.7	8.2	660,195.1	0.00	1.00
07/05/2022 10:00	1	1.6	7.4	14.7	10.8	660,857.7	0.00	1.00
07/05/2022 11:00	0	1.6	7.4	14.7	8.6	664,612.6	0.00	1.00
07/05/2022 12:00	0	1.6	7.1	14.7	7.7	687,362.7	0.00	1.00
07/05/2022 13:00	1	1.6	7.5	14.7	10.1	658,869.8	0.00	1.00
07/05/2022 14:00	0	1.6	7.1	14.7	8.8	748,986.8	0.00	1.00
07/05/2022 15:00	1	1.6	6.9	14.5	11.3	828,501.8	0.00	1.00
07/05/2022 16:00	1	1.7	7.1	14.2	13.9	939,179.9	0.00	1.00
07/05/2022 17:00	1	1.8	8.1	13.9	17.3	982,072.9	0.00	1.00
07/05/2022 18:00	1	1.8	7.9	14.0	17.2	987,771.8	0.00	1.00
07/05/2022 19:00	1	1.8	7.8	14.0	17.5	982,016.2	0.00	1.00
07/05/2022 20:00	1	1.7	7.8	14.1	17.8	993,839.6	0.00	1.00
07/05/2022 21:00	2	1.6	8.1	14.4	16.5	801,007.9	0.00	1.00
07/05/2022 22:00	1	1.5	7.0	14.5	10.6	781,213.8	0.00	1.00
07/05/2022 23:00	1	1.6	7.6	14.5	13.7	732,642.0	0.00	1.00
Average/Sum#:	1	1.7	7.6	14.5	12.7	747,927.9	0.00 #	24.00 #
Minimum:	0	1.5	6.9	13.9	7.7	647,107.4	0.00	1.00
Maximum:	2	1.8	8.1	14.7	17.8	993,839.6	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 **To:** 09/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 10/01/2022 22:21 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOx, Ppm	Unit CT1 NOx, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/06/2022 00:00	2	1.6	8.3	14.6	14.9	648,194.2	0.00	1.00
07/06/2022 01:00	2	1.6	8.6	14.6	15.6	647,107.4	0.00	1.00
07/06/2022 02:00	2	1.6	9.0	14.6	15.9	646,890.0	0.00	1.00
07/06/2022 03:00	2	1.6	8.9	14.6	16.4	647,324.7	0.00	1.00
07/06/2022 04:00	2	1.6	8.9	14.6	16.5	646,890.0	0.00	1.00
07/06/2022 05:00	2	1.6	8.8	14.6	15.8	647,976.8	0.00	1.00
07/06/2022 06:00	2	1.6	8.7	14.6	15.0	647,542.1	0.00	1.00
07/06/2022 07:00	1	1.6	8.5	14.6	14.0	650,585.3	0.00	1.00
07/06/2022 08:00	1	1.6	8.3	14.6	13.2	649,933.2	0.00	1.00
07/06/2022 09:00	1	1.6	8.0	14.7	12.4	661,078.6	0.00	1.00
07/06/2022 10:00	1	1.6	7.9	14.7	12.7	661,078.6	0.00	1.00
07/06/2022 11:00	1	1.6	8.0	14.7	13.0	659,753.3	0.00	1.00
07/06/2022 12:00	1	1.6	8.0	14.7	12.8	661,741.2	0.00	1.00
07/06/2022 13:00	0	1.6	7.8	14.7	10.4	664,170.8	0.00	1.00
07/06/2022 14:00	1	1.6	7.8	14.7	10.1	664,833.5	0.00	1.00
07/06/2022 15:00	1	1.6	7.8	14.7	11.1	663,950.0	0.00	1.00
07/06/2022 16:00	1	1.6	7.2	14.7	10.9	761,797.5	0.00	1.00
07/06/2022 17:00	1	1.5	8.4	14.6	13.5	691,668.0	0.00	1.00
07/06/2022 18:00	1	1.7	6.9	14.3	13.4	939,923.1	0.00	1.00
07/06/2022 19:00	1	1.7	7.6	14.1	17.5	988,200.8	0.00	1.00
07/06/2022 20:00	1	1.7	7.4	14.2	18.0	995,183.2	0.00	1.00
07/06/2022 21:00	2	1.7	7.6	14.3	18.9	879,751.4	0.00	1.00
07/06/2022 22:00	1	1.5	8.4	14.6	13.7	706,014.3	0.00	1.00
07/06/2022 23:00	2	1.6	8.5	14.6	15.5	646,672.6	0.00	1.00
Average/Sum#:	1	1.6	8.1	14.6	14.2	711,594.2	0.00 #	24.00 #
Minimum:	0	1.5	6.9	14.1	10.1	646,672.6	0.00	1.00
Maximum:	2	1.7	9.0	14.7	18.9	995,183.2	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:21 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOx, Ppm	Unit CT1 NOx, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/07/2022 00:00	2	1.6	8.7	14.6	16.2	646,890.0	0.00	1.00
07/07/2022 01:00	2	1.6	8.9	14.6	16.6	645,803.1	0.00	1.00
07/07/2022 02:00	2	1.5	9.1	14.6	16.7	646,237.9	0.00	1.00
07/07/2022 03:00	2	1.6	9.1	14.6	16.9	646,020.5	0.00	1.00
07/07/2022 04:00	2	1.6	9.0	14.6	16.6	648,411.6	0.00	1.00
07/07/2022 05:00	2	1.6	9.1	14.6	17.0	647,107.4	0.00	1.00
07/07/2022 06:00	2	1.6	8.9	14.6	15.6	647,759.5	0.00	1.00
07/07/2022 07:00	1	1.6	8.7	14.6	14.7	650,150.5	0.00	1.00
07/07/2022 08:00	1	1.6	8.5	14.6	13.7	649,498.4	0.00	1.00
07/07/2022 09:00	1	1.6	8.1	14.6	12.5	651,454.7	0.00	1.00
07/07/2022 10:00	1	1.6	7.8	14.7	12.6	663,950.0	0.00	1.00
07/07/2022 11:00	1	1.6	7.8	14.7	12.3	664,833.5	0.00	1.00
07/07/2022 12:00	1	1.6	7.9	14.7	11.8	662,624.7	0.00	1.00
07/07/2022 13:00	1	1.6	7.9	14.7	11.6	662,403.8	0.00	1.00
07/07/2022 14:00	0	1.5	6.3	14.6	10.6	935,121.2	0.00	1.00
07/07/2022 15:00	1	1.5	7.8	14.5	13.1	740,773.0	0.00	1.00
07/07/2022 16:00	1	1.7	7.3	14.2	15.5	956,348.8	0.00	1.00
07/07/2022 17:00	1	1.8	8.5	13.9	19.1	1,003,788.1	0.00	1.00
07/07/2022 18:00	1	1.9	8.8	13.6	19.9	999,304.6	0.00	1.00
07/07/2022 19:00	1	1.7	7.8	14.1	17.4	994,846.5	0.00	1.00
07/07/2022 20:00	1	1.7	7.7	14.1	17.7	988,200.8	0.00	1.00
07/07/2022 21:00	1	1.7	7.7	14.1	17.9	989,409.1	0.00	1.00
07/07/2022 22:00	1	1.7	7.0	14.3	16.2	968,349.0	0.00	1.00
07/07/2022 23:00	1	1.5	8.2	14.5	14.6	730,288.3	0.00	1.00
Average/Sum#:	1	1.6	8.2	14.4	15.3	768,315.6	0.00 #	24.00 #
Minimum:	0	1.5	6.3	13.6	10.6	645,803.1	0.00	1.00
Maximum:	2	1.9	9.1	14.7	19.9	1,003,788.1	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:21 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOx, Ppm	Unit CT1 NOx, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/08/2022 00:00	1	1.6	8.3	14.6	14.4	650,802.6	0.00	1.00
07/08/2022 01:00	1	1.6	8.4	14.7	14.6	657,765.5	0.00	1.00
07/08/2022 02:00	1	1.6	8.8	14.6	15.3	647,542.1	0.00	1.00
07/08/2022 03:00	2	1.6	8.7	14.6	15.7	647,542.1	0.00	1.00
07/08/2022 04:00	1	1.6	7.0	14.5	13.9	866,802.8	0.00	1.00
07/08/2022 05:00	2	1.6	8.1	14.5	16.1	741,414.9	0.00	1.00
07/08/2022 06:00	1	1.6	8.6	14.6	14.1	648,846.3	0.00	1.00
07/08/2022 07:00	1	1.6	8.3	14.7	13.1	660,195.1	0.00	1.00
07/08/2022 08:00	1	1.6	8.2	14.7	12.4	655,998.5	0.00	1.00
07/08/2022 09:00	1	1.6	7.9	14.7	12.1	656,219.3	0.00	1.00
07/08/2022 10:00	1	1.6	7.7	14.7	11.7	657,323.7	0.00	1.00
07/08/2022 11:00	1	1.6	7.6	14.7	9.9	661,078.6	0.00	1.00
07/08/2022 12:00	0	1.6	7.6	14.7	9.8	662,183.0	0.00	1.00
07/08/2022 13:00	0	1.6	7.0	14.7	8.9	762,018.4	0.00	1.00
07/08/2022 14:00	1	1.6	7.4	14.5	13.0	778,218.2	0.00	1.00
07/08/2022 15:00	1	1.7	7.4	14.3	13.0	886,806.0	0.00	1.00
07/08/2022 16:00	1	1.6	8.0	14.3	14.2	793,021.2	0.00	1.00
07/08/2022 17:00	1	1.5	8.1	14.8	11.8	692,120.6	0.00	1.00
07/08/2022 18:00	1	1.5	8.0	14.7	13.5	830,047.9	0.00	1.00
07/08/2022 19:00	0	1.6	6.6	14.5	10.2	858,671.9	0.00	1.00
07/08/2022 20:00	1	1.7	7.2	14.3	16.7	989,097.9	0.00	1.00
07/08/2022 21:00	1	1.7	7.2	14.3	17.0	990,135.3	0.00	1.00
07/08/2022 22:00	1	1.7	7.3	14.3	17.6	992,625.2	0.00	1.00
07/08/2022 23:00	1	1.7	7.4	14.3	18.4	996,982.4	0.00	1.00
Average/Sum#:	1	1.6	7.8	14.6	13.6	765,977.5	0.00 #	24.00 #
Minimum:	0	1.5	6.6	14.3	8.9	647,542.1	0.00	1.00
Maximum:	2	1.7	8.8	14.8	18.4	996,982.4	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:21 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOX, Ppm	Unit CT1 NOX, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/09/2022 00:00	1	1.7	7.3	14.3	18.6	996,360.0	0.00	1.00
07/09/2022 01:00	2	1.6	8.1	14.5	15.3	702,899.9	0.00	1.00
07/09/2022 02:00	2	1.7	8.8	14.6	14.9	648,411.6	0.00	1.00
07/09/2022 03:00	2	1.6	8.8	14.6	15.9	649,715.8	0.00	1.00
07/09/2022 04:00	2	1.7	8.3	14.4	15.4	674,388.8	0.00	1.00
07/09/2022 05:00	2	1.6	9.0	14.6	16.6	647,759.5	0.00	1.00
07/09/2022 06:00	1	1.6	8.6	14.6	14.6	648,194.2	0.00	1.00
07/09/2022 07:00	1	1.6	8.3	14.6	13.5	650,585.3	0.00	1.00
07/09/2022 08:00	1	1.6	8.1	14.7	13.0	660,636.8	0.00	1.00
07/09/2022 09:00	1	1.6	7.9	14.7	12.2	660,857.7	0.00	1.00
07/09/2022 10:00	1	1.6	7.6	14.7	11.4	663,287.3	0.00	1.00
07/09/2022 11:00	1	1.6	7.5	14.7	10.6	665,717.0	0.00	1.00
07/09/2022 12:00	1	1.6	7.5	14.8	10.0	674,609.9	0.00	1.00
07/09/2022 13:00	0	1.6	7.6	14.8	9.5	677,752.8	0.00	1.00
07/09/2022 14:00	1	1.6	7.6	14.8	11.0	673,038.4	0.00	1.00
07/09/2022 15:00	1	1.6	7.7	14.8	11.1	671,466.9	0.00	1.00
07/09/2022 16:00	0	1.6	6.8	14.6	9.6	754,705.0	0.00	1.00
07/09/2022 17:00	1	1.6	7.6	14.8	10.9	669,222.0	0.00	1.00
07/09/2022 18:00	0	1.6	7.5	14.8	8.5	666,977.0	0.00	1.00
07/09/2022 19:00	1	1.6	7.5	14.7	10.8	657,765.5	0.00	1.00
07/09/2022 20:00	1	1.6	7.7	14.7	11.8	655,998.5	0.00	1.00
07/09/2022 21:00	1	1.6	7.9	14.7	12.6	655,556.7	0.00	1.00
07/09/2022 22:00	1	1.6	8.1	14.7	13.1	654,673.2	0.00	1.00
07/09/2022 23:00	1	1.6	8.2	14.7	13.7	655,115.0	0.00	1.00
Average/Sum#:	1	1.6	7.9	14.7	12.7	680,654.0	0.00 #	24.00 #
Minimum:	0	1.6	6.8	14.3	8.5	647,759.5	0.00	1.00
Maximum:	2	1.7	9.0	14.8	18.6	996,360.0	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:21 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:	> 10							
	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1
	NH3Slip, Ppmvdc	NOx, Ppm	NOx, _SCR, Ppm	O2, Dry, Pct	NH3Inj, LbPerHr	ExhaustFlow, LbPerHr	SUSD, Hr	OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/10/2022 00:00	1	1.6	8.2	14.7	14.1	659,311.6	0.00	1.00
07/10/2022 01:00	2	1.6	8.3	14.6	14.7	649,281.1	0.00	1.00
07/10/2022 02:00	1	1.5	8.7	14.6	15.1	648,194.2	0.00	1.00
07/10/2022 03:00	2	1.6	8.7	14.6	16.1	648,194.2	0.00	1.00
07/10/2022 04:00	2	1.6	8.6	14.6	15.8	647,976.8	0.00	1.00
07/10/2022 05:00	2	1.6	8.7	14.6	15.8	647,759.5	0.00	1.00
07/10/2022 06:00	1	1.6	8.4	14.6	13.5	648,194.2	0.00	1.00
07/10/2022 07:00	1	1.6	8.1	14.7	12.6	663,066.5	0.00	1.00
07/10/2022 08:00	1	1.6	7.9	14.7	11.6	661,078.6	0.00	1.00
07/10/2022 09:00	1	1.6	8.1	14.7	12.2	655,777.6	0.00	1.00
07/10/2022 10:00	0	1.6	7.6	14.7	9.1	662,183.0	0.00	1.00
07/10/2022 11:00	0	1.6	7.5	14.8	9.0	674,385.4	0.00	1.00
07/10/2022 12:00	0	1.6	7.5	14.8	7.7	673,711.9	0.00	1.00
07/10/2022 13:00	0	1.6	7.5	14.8	9.4	675,507.9	0.00	1.00
07/10/2022 14:00	1	1.5	7.1	14.7	10.2	761,797.5	0.00	1.00
07/10/2022 15:00	1	1.6	7.2	14.5	12.2	788,916.8	0.00	1.00
07/10/2022 16:00	1	1.6	7.2	14.5	12.1	845,619.6	0.00	1.00
07/10/2022 17:00	1	1.6	6.6	14.6	12.0	943,816.0	0.00	1.00
07/10/2022 18:00	1	1.6	6.7	14.6	14.1	988,159.2	0.00	1.00
07/10/2022 19:00	1	1.6	6.6	14.6	13.7	985,768.2	0.00	1.00
07/10/2022 20:00	1	1.6	6.3	14.6	12.8	980,551.3	0.00	1.00
07/10/2022 21:00	0	1.6	6.4	14.5	11.0	906,387.8	0.00	1.00
07/10/2022 22:00	1	1.6	6.0	14.5	10.5	920,510.0	0.00	1.00
07/10/2022 23:00	1	1.6	6.0	14.6	12.0	980,116.6	0.00	1.00
Average/Sum#:	1	1.6	7.5	14.6	12.4	763,177.7	0.00 #	24.00 #
Minimum:	0	1.5	6.0	14.5	7.7	647,759.5	0.00	1.00
Maximum:	2	1.6	8.7	14.8	16.1	988,159.2	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:21 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOx, Ppm	Unit CT1 NOx, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/11/2022 00:00	1	1.6	6.0	14.6	12.4	979,899.2	0.00	1.00
07/11/2022 01:00	1	1.6	6.1	14.6	13.1	981,420.8	0.00	1.00
07/11/2022 02:00	1	1.7	6.5	14.6	13.1	981,420.8	0.00	1.00
07/11/2022 03:00	1	1.6	6.3	14.5	13.4	964,374.3	0.00	1.00
07/11/2022 04:00	1	1.6	6.2	14.5	13.6	955,601.5	0.00	1.00
07/11/2022 05:00	1	1.6	7.0	14.5	14.3	843,265.9	0.00	1.00
07/11/2022 06:00	2	1.6	10.0	14.8	17.9	635,323.1	0.00	1.00
07/11/2022 07:00	1	1.5	10.6	14.9	17.2	632,217.6	0.00	1.00
07/11/2022 08:00	2	1.5	10.5	14.9	17.4	630,619.9	0.00	1.00
07/11/2022 09:00	1	1.5	9.6	14.9	14.7	633,130.5	0.00	1.00
07/11/2022 10:00	0	1.5	8.1	14.8	7.8	641,384.5	0.00	1.00
07/11/2022 11:00	0	1.6	6.5	14.6	6.0	718,187.0	0.00	1.00
07/11/2022 12:00	1	1.8	7.7	13.9	15.3	969,943.7	0.00	1.00
07/11/2022 13:00	1	1.9	8.7	13.5	18.6	982,284.4	0.00	1.00
07/11/2022 14:00	1	1.9	8.8	13.4	19.3	972,839.1	0.00	1.00
07/11/2022 15:00	1	1.9	8.9	13.4	19.3	979,229.7	0.00	1.00
07/11/2022 16:00	1	1.9	8.7	13.4	19.2	969,369.9	0.00	1.00
07/11/2022 17:00	1	1.9	8.7	13.5	18.9	982,654.5	0.00	1.00
07/11/2022 18:00	1	1.9	9.0	13.3	19.8	971,570.6	0.00	1.00
07/11/2022 19:00	1	1.9	8.9	13.4	19.9	977,586.4	0.00	1.00
07/11/2022 20:00	1	1.9	8.5	13.6	18.9	977,731.5	0.00	1.00
07/11/2022 21:00	1	1.8	7.7	13.9	16.9	981,681.7	0.00	1.00
07/11/2022 22:00	1	1.8	7.9	13.8	17.5	979,042.0	0.00	1.00
07/11/2022 23:00	1	1.8	7.7	13.9	17.3	976,008.3	0.00	1.00
Average/Sum#:	1	1.7	8.1	14.1	15.9	888,199.5	0.00 #	24.00 #
Minimum:	0	1.5	6.0	13.3	6.0	630,619.9	0.00	1.00
Maximum:	2	1.9	10.6	14.9	19.9	982,654.5	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:21 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:	> 10							
	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1
	NH3Slip, Ppmvdc	NOx, Ppm	NOx, _SCR, Ppm	O2, Dry, Pct	NH3Inj, LbPerHr	ExhaustFlow, LbPerHr	SUSD, Hr	OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/12/2022 00:00	1	1.8	8.2	13.9	18.2	994,006.5	0.00	1.00
07/12/2022 01:00	1	1.8	8.0	13.9	18.4	987,355.0	0.00	1.00
07/12/2022 02:00	1	1.8	8.2	14.0	17.9	984,993.2	0.00	1.00
07/12/2022 03:00	1	1.8	8.4	13.8	19.5	970,169.7	0.00	1.00
07/12/2022 04:00	1	1.8	8.8	13.8	20.4	998,136.8	0.00	1.00
07/12/2022 05:00	1	1.7	7.8	14.1	17.6	967,458.1	0.00	1.00
07/12/2022 06:00	2	1.6	9.6	14.6	19.0	711,883.3	0.00	1.00
07/12/2022 07:00	2	1.5	11.1	14.8	18.6	626,118.8	0.00	1.00
07/12/2022 08:00	2	1.5	11.0	14.9	18.7	630,163.5	0.00	1.00
07/12/2022 09:00	2	1.5	10.6	14.9	17.9	630,619.9	0.00	1.00
07/12/2022 10:00	-1	1.4	7.5	14.8	13.1	635,323.1	0.00	1.00
07/12/2022 11:00	0	1.6	7.6	14.8	6.6	654,180.8	0.00	1.00
07/12/2022 12:00	0	1.5	7.1	14.7	6.9	685,374.8	0.00	1.00
07/12/2022 13:00	1	1.6	7.1	14.4	12.2	851,782.0	0.00	1.00
07/12/2022 14:00	1	1.9	9.0	13.6	19.4	987,861.5	0.00	1.00
07/12/2022 15:00	1	1.8	8.4	13.8	17.0	982,320.9	0.00	1.00
07/12/2022 16:00	1	1.8	8.5	13.7	18.3	979,328.6	0.00	1.00
07/12/2022 17:00	1	1.9	8.8	13.5	19.7	983,764.9	0.00	1.00
07/12/2022 18:00	1	1.8	8.1	13.7	18.1	976,475.7	0.00	1.00
07/12/2022 19:00	1	1.8	7.3	14.0	15.2	953,833.9	0.00	1.00
07/12/2022 20:00	1	1.8	6.6	14.4	12.4	946,799.0	0.00	1.00
07/12/2022 21:00	1	2.0	8.3	13.7	18.3	977,807.0	0.00	1.00
07/12/2022 22:00	1	1.7	6.7	14.5	11.3	853,108.6	0.00	1.00
07/12/2022 23:00	1	1.8	6.3	14.6	13.6	990,985.0	0.00	1.00
Average/Sum#:	1	1.7	8.3	14.2	16.2	873,327.1	0.00 #	24.00 #
Minimum:	-1	1.4	6.3	13.5	6.6	626,118.8	0.00	1.00
Maximum:	2	2.0	11.1	14.9	20.4	998,136.8	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:21 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOx, Ppm	Unit CT1 NOx, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/13/2022 00:00	1	1.8	6.4	14.6	14.5	992,724.0	0.00	1.00
07/13/2022 01:00	1	1.8	6.4	14.5	15.1	977,854.6	0.00	1.00
07/13/2022 02:00	1	1.7	6.7	14.5	15.5	976,998.7	0.00	1.00
07/13/2022 03:00	1	1.8	6.9	14.4	17.3	969,763.1	0.00	1.00
07/13/2022 04:00	2	2.2	10.0	13.3	24.7	1,009,229.7	0.00	1.00
07/13/2022 05:00	2	2.0	9.1	13.6	21.8	980,545.4	0.00	1.00
07/13/2022 06:00	1	1.8	7.2	14.3	15.1	920,211.7	0.00	1.00
07/13/2022 07:00	2	1.7	11.1	14.7	20.8	622,425.5	0.00	1.00
07/13/2022 08:00	2	1.6	10.7	14.8	17.8	630,608.7	0.00	1.00
07/13/2022 09:00	2	1.7	11.2	14.8	19.0	622,302.4	0.00	1.00
07/13/2022 10:00	2	1.7	10.8	14.8	18.6	622,302.4	0.00	1.00
07/13/2022 11:00	2	1.7	10.6	14.9	17.9	634,500.0	0.00	1.00
07/13/2022 12:00	1	1.7	10.3	14.9	17.0	636,554.1	0.00	1.00
07/13/2022 13:00	1	1.7	10.1	14.9	16.2	637,238.8	0.00	1.00
07/13/2022 14:00	1	1.6	8.9	14.8	12.6	677,079.3	0.00	1.00
07/13/2022 15:00	1	1.9	7.6	14.1	13.1	977,124.6	0.00	1.00
07/13/2022 16:00	1	2.0	8.1	13.9	16.1	987,746.2	0.00	1.00
07/13/2022 17:00	1	1.6	7.2	14.5	10.8	783,139.6	0.00	1.00
07/13/2022 18:00	1	1.9	7.6	14.2	15.4	983,532.9	0.00	1.00
07/13/2022 19:00	1	2.0	8.1	14.0	17.0	1,000,870.6	0.00	1.00
07/13/2022 20:00	1	2.1	8.8	13.5	19.1	986,725.8	0.00	1.00
07/13/2022 21:00	1	2.0	7.9	13.9	17.4	994,789.0	0.00	1.00
07/13/2022 22:00	1	1.9	7.7	14.1	17.0	991,423.0	0.00	1.00
07/13/2022 23:00	1	1.7	7.5	14.5	14.3	802,611.1	0.00	1.00
Average/Sum#:	1	1.8	8.6	14.4	16.8	850,762.6	0.00 #	24.00 #
Minimum:	1	1.6	6.4	13.3	10.8	622,302.4	0.00	1.00
Maximum:	2	2.2	11.2	14.9	24.7	1,009,229.7	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:21 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOx, Ppm	Unit CT1 NOx, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/14/2022 00:00	1	1.7	6.2	14.5	10.2	879,855.2	0.00	1.00
07/14/2022 01:00	1	1.8	7.0	14.5	12.9	780,144.0	0.00	1.00
07/14/2022 02:00	1	1.9	7.9	14.5	11.7	725,153.0	0.00	1.00
07/14/2022 03:00	1	1.8	7.2	14.5	12.7	779,288.1	0.00	1.00
07/14/2022 04:00	1	1.8	6.9	14.5	14.3	886,702.3	0.00	1.00
07/14/2022 05:00	1	1.8	6.7	14.5	14.6	920,296.0	0.00	1.00
07/14/2022 06:00	1	1.8	7.3	14.5	12.2	772,868.9	0.00	1.00
07/14/2022 07:00	1	1.7	7.4	14.5	10.8	712,314.7	0.00	1.00
07/14/2022 08:00	0	1.7	7.6	14.7	8.0	657,102.8	0.00	1.00
07/14/2022 09:00	0	1.7	7.4	14.7	7.0	657,986.3	0.00	1.00
07/14/2022 10:00	0	1.7	7.2	14.7	6.8	659,311.6	0.00	1.00
07/14/2022 11:00	0	1.7	7.2	14.7	6.8	660,416.0	0.00	1.00
07/14/2022 12:00	0	1.7	6.6	14.7	7.0	754,950.4	0.00	1.00
07/14/2022 13:00	1	1.7	7.5	14.6	11.8	770,138.2	0.00	1.00
07/14/2022 14:00	1	1.7	7.5	14.0	15.2	887,942.7	0.00	1.00
07/14/2022 15:00	1	1.8	8.3	13.7	18.0	988,648.3	0.00	1.00
07/14/2022 16:00	1	1.8	8.0	13.7	17.6	979,518.8	0.00	1.00
07/14/2022 17:00	1	2.0	8.5	13.5	18.2	981,359.1	0.00	1.00
07/14/2022 18:00	1	2.1	8.5	13.5	17.5	983,949.9	0.00	1.00
07/14/2022 19:00	1	2.0	7.6	13.9	16.8	990,680.7	0.00	1.00
07/14/2022 20:00	1	1.9	7.6	13.9	17.0	985,594.3	0.00	1.00
07/14/2022 21:00	1	1.9	7.8	14.0	17.6	991,344.2	0.00	1.00
07/14/2022 22:00	1	1.8	7.8	14.1	17.8	989,610.5	0.00	1.00
07/14/2022 23:00	1	1.8	7.8	14.1	18.1	989,610.5	0.00	1.00
Average/Sum#:	1	1.8	7.5	14.3	13.4	849,366.1	0.00 #	24.00 #
Minimum:	0	1.7	6.2	13.5	6.8	657,102.8	0.00	1.00
Maximum:	1	2.1	8.5	14.7	18.2	991,344.2	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:	> 10							
	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1
	NH3Slip, Ppmvdc	NOx, Ppm	NOx, _SCR, Ppm	O2, Dry, Pct	NH3Inj, LbPerHr	ExhaustFlow, LbPerHr	SUSD, Hr	OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/15/2022 00:00	1	1.7	6.6	14.4	12.9	862,737.4	0.00	1.00
07/15/2022 01:00	1	1.8	6.7	14.5	16.5	989,195.1	0.00	1.00
07/15/2022 02:00	1	2.2	8.7	13.9	19.0	1,005,353.1	0.00	1.00
07/15/2022 03:00	1	1.8	7.8	14.2	19.8	991,299.7	0.00	1.00
07/15/2022 04:00	1	1.8	7.6	14.2	19.2	991,504.1	0.00	1.00
07/15/2022 05:00	1	1.9	8.0	14.0	20.0	998,885.9	0.00	1.00
07/15/2022 06:00	2	1.7	8.9	14.5	19.4	816,947.2	0.00	1.00
07/15/2022 07:00	2	1.7	11.9	14.8	20.7	626,567.8	0.00	1.00
07/15/2022 08:00	2	1.7	11.4	14.8	19.4	625,220.8	0.00	1.00
07/15/2022 09:00	2	1.6	10.9	14.8	18.1	625,669.8	0.00	1.00
07/15/2022 10:00	1	1.6	9.2	14.8	11.5	638,915.0	0.00	1.00
07/15/2022 11:00	0	1.6	8.3	14.8	8.5	650,588.8	0.00	1.00
07/15/2022 12:00	0	1.7	7.4	14.8	6.1	657,772.7	0.00	1.00
07/15/2022 13:00	0	1.7	6.4	14.6	8.1	821,219.9	0.00	1.00
07/15/2022 14:00	1	2.0	8.3	13.8	17.2	993,893.5	0.00	1.00
07/15/2022 15:00	1	1.9	8.4	13.7	17.0	979,138.4	0.00	1.00
07/15/2022 16:00	1	1.9	7.9	13.9	17.5	994,202.1	0.00	1.00
07/15/2022 17:00	1	2.0	8.9	13.5	20.3	990,982.1	0.00	1.00
07/15/2022 18:00	2	2.2	11.0	12.8	24.9	994,946.0	0.00	1.00
07/15/2022 19:00	2	2.1	10.0	13.1	22.1	993,710.5	0.00	1.00
07/15/2022 20:00	1	2.2	9.5	13.3	20.4	998,058.1	0.00	1.00
07/15/2022 21:00	1	2.2	9.3	13.3	19.8	987,967.6	0.00	1.00
07/15/2022 22:00	1	2.2	9.5	13.3	20.3	995,895.9	0.00	1.00
07/15/2022 23:00	1	2.1	8.5	13.7	18.7	1,000,440.6	0.00	1.00
Average/Sum#:	1	1.9	8.8	14.1	17.4	884,629.7	0.00 #	24.00 #
Minimum:	0	1.6	6.4	12.8	6.1	625,220.8	0.00	1.00
Maximum:	2	2.2	11.9	14.8	24.9	1,005,353.1	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOx, Ppm	Unit CT1 NOx, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/16/2022 00:00	1	1.9	7.4	14.2	15.7	970,247.4	0.00	1.00
07/16/2022 01:00	1	1.8	6.3	14.5	11.1	887,558.2	0.00	1.00
07/16/2022 02:00	1	1.7	6.6	14.6	14.6	993,593.5	0.00	1.00
07/16/2022 03:00	1	1.8	6.5	14.6	14.4	997,940.8	0.00	1.00
07/16/2022 04:00	1	1.8	6.5	14.5	15.0	980,422.3	0.00	1.00
07/16/2022 05:00	1	1.7	7.4	14.5	15.3	850,968.9	0.00	1.00
07/16/2022 06:00	2	1.7	9.0	14.6	16.8	713,622.3	0.00	1.00
07/16/2022 07:00	2	1.7	11.5	14.8	19.6	622,975.8	0.00	1.00
07/16/2022 08:00	1	1.6	9.9	14.8	14.8	632,629.2	0.00	1.00
07/16/2022 09:00	0	1.6	8.4	14.8	9.7	647,445.9	0.00	1.00
07/16/2022 10:00	0	1.6	7.6	14.8	8.6	658,446.2	0.00	1.00
07/16/2022 11:00	0	1.6	7.7	14.8	8.6	652,384.8	0.00	1.00
07/16/2022 12:00	0	1.6	7.1	14.8	6.5	666,303.5	0.00	1.00
07/16/2022 13:00	0	1.6	6.5	14.7	8.7	805,972.5	0.00	1.00
07/16/2022 14:00	1	1.8	7.1	14.3	14.7	961,294.4	0.00	1.00
07/16/2022 15:00	2	2.2	11.4	12.8	25.2	993,931.6	0.00	1.00
07/16/2022 16:00	1	2.0	8.7	13.7	18.6	990,930.7	0.00	1.00
07/16/2022 17:00	2	2.1	9.8	13.3	21.7	990,670.4	0.00	1.00
07/16/2022 18:00	2	2.1	10.4	13.0	22.0	980,091.8	0.00	1.00
07/16/2022 19:00	1	2.0	8.7	13.7	18.3	990,930.7	0.00	1.00
07/16/2022 20:00	2	2.1	10.7	13.1	24.4	1,003,542.3	0.00	1.00
07/16/2022 21:00	2	2.2	11.1	12.8	24.7	986,323.7	0.00	1.00
07/16/2022 22:00	2	2.2	10.8	12.9	23.7	988,895.6	0.00	1.00
07/16/2022 23:00	1	2.1	9.5	13.3	20.2	982,381.8	0.00	1.00
Average/Sum#:	1	1.9	8.6	14.1	16.4	872,896.0	0.00 #	24.00 #
Minimum:	0	1.6	6.3	12.8	6.5	622,975.8	0.00	1.00
Maximum:	2	2.2	11.5	14.8	25.2	1,003,542.3	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 **To:** 09/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOX, Ppm	Unit CT1 NOX, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/17/2022 00:00	2	2.2	10.9	12.9	24.6	996,427.4	0.00	1.00
07/17/2022 01:00	2	2.2	10.5	13.0	23.6	991,879.3	0.00	1.00
07/17/2022 02:00	2	1.9	10.8	13.0	25.6	993,439.4	0.00	1.00
07/17/2022 03:00	2	2.2	10.8	13.0	24.6	997,773.0	0.00	1.00
07/17/2022 04:00	2	2.1	10.1	13.2	23.1	995,589.3	0.00	1.00
07/17/2022 05:00	1	1.7	6.8	14.5	14.3	984,915.7	0.00	1.00
07/17/2022 06:00	1	1.7	6.9	14.5	12.2	862,309.4	0.00	1.00
07/17/2022 07:00	1	1.7	8.4	14.8	11.5	650,588.8	0.00	1.00
07/17/2022 08:00	0	1.7	7.3	14.6	8.7	704,927.5	0.00	1.00
07/17/2022 09:00	1	1.6	8.4	14.8	11.3	643,629.5	0.00	1.00
07/17/2022 10:00	0	1.6	7.9	14.8	8.3	646,996.9	0.00	1.00
07/17/2022 11:00	0	1.7	6.9	14.4	10.0	832,399.3	0.00	1.00
07/17/2022 12:00	1	1.9	8.2	13.8	16.4	986,564.2	0.00	1.00
07/17/2022 13:00	1	2.0	8.7	13.5	18.6	982,284.4	0.00	1.00
07/17/2022 14:00	1	1.9	8.1	13.8	17.5	988,493.0	0.00	1.00
07/17/2022 15:00	2	2.1	9.5	13.3	21.3	990,850.6	0.00	1.00
07/17/2022 16:00	2	2.1	9.5	13.3	21.0	985,264.8	0.00	1.00
07/17/2022 17:00	2	2.0	9.0	13.4	20.5	986,533.3	0.00	1.00
07/17/2022 18:00	2	2.2	10.6	12.9	23.9	990,436.2	0.00	1.00
07/17/2022 19:00	2	2.1	10.5	13.0	23.7	994,999.5	0.00	1.00
07/17/2022 20:00	2	2.2	11.0	12.8	25.2	992,410.0	0.00	1.00
07/17/2022 21:00	1	2.0	9.1	13.5	19.3	984,320.0	0.00	1.00
07/17/2022 22:00	1	1.9	8.0	14.0	16.9	986,581.0	0.00	1.00
07/17/2022 23:00	1	1.9	7.9	14.0	17.0	983,802.4	0.00	1.00
Average/Sum#:	1	1.9	9.0	13.7	18.3	923,059.0	0.00 #	24.00 #
Minimum:	0	1.6	6.8	12.8	8.3	643,629.5	0.00	1.00
Maximum:	2	2.2	11.0	14.8	25.6	997,773.0	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOx, Ppm	Unit CT1 NOx, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/18/2022 00:00	1	1.9	7.9	14.1	17.2	997,464.6	0.00	1.00
07/18/2022 01:00	1	1.8	7.6	14.2	16.3	969,225.4	0.00	1.00
07/18/2022 02:00	2	1.9	10.0	14.7	14.3	638,991.1	0.00	1.00
07/18/2022 03:00	2	1.6	9.9	14.9	16.4	643,857.7	0.00	1.00
07/18/2022 04:00	0	1.6	7.8	14.7	9.2	697,522.9	0.00	1.00
07/18/2022 05:00	1	1.8	7.6	14.2	16.2	979,240.6	0.00	1.00
07/18/2022 06:00	1	1.9	7.8	14.1	16.8	996,860.4	0.00	1.00
07/18/2022 07:00	1	1.7	7.6	14.5	13.0	812,239.8	0.00	1.00
07/18/2022 08:00	1	1.6	7.6	14.7	9.8	697,081.2	0.00	1.00
07/18/2022 09:00	1	1.9	7.6	14.1	16.0	975,714.9	0.00	1.00
07/18/2022 10:00	1	1.9	7.9	13.9	16.7	984,029.2	0.00	1.00
07/18/2022 11:00	1	1.9	8.0	13.9	17.2	997,136.6	0.00	1.00
07/18/2022 12:00	1	1.9	7.8	13.8	16.9	993,507.7	0.00	1.00
07/18/2022 13:00	2	2.1	9.8	13.1	22.4	994,061.6	0.00	1.00
07/18/2022 14:00	1	2.0	8.8	13.6	20.0	1,005,495.2	0.00	1.00
07/18/2022 15:00	2	2.2	11.0	12.8	25.9	999,172.6	0.00	1.00
07/18/2022 16:00	2	2.2	11.1	12.8	26.1	998,327.3	0.00	1.00
07/18/2022 17:00	2	2.2	10.5	13.0	23.6	1,002,106.6	0.00	1.00
07/18/2022 18:00	2	2.3	11.0	12.9	24.9	1,006,526.9	0.00	1.00
07/18/2022 19:00	2	2.3	10.4	13.0	22.9	992,919.4	0.00	1.00
07/18/2022 20:00	2	2.3	10.6	12.9	23.7	993,003.9	0.00	1.00
07/18/2022 21:00	1	2.1	8.9	13.6	18.3	992,551.3	0.00	1.00
07/18/2022 22:00	1	2.0	8.0	14.1	16.5	992,631.3	0.00	1.00
07/18/2022 23:00	1	1.9	7.5	14.3	13.9	892,823.2	0.00	1.00
Average/Sum#:	1	2.0	8.9	13.8	18.1	927,187.1	0.00 #	24.00 #
Minimum:	0	1.6	7.5	12.8	9.2	638,991.1	0.00	1.00
Maximum:	2	2.3	11.1	14.9	26.1	1,006,526.9	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOx, Ppm	Unit CT1 NOx, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/19/2022 00:00	1	1.7	9.5	14.8	15.2	643,854.0	0.00	1.00
07/19/2022 01:00	1	1.8	8.7	14.8	14.0	650,364.3	0.00	1.00
07/19/2022 02:00	1	1.8	9.0	14.7	10.6	642,525.1	0.00	1.00
07/19/2022 03:00	1	1.8	8.9	14.7	14.0	644,513.0	0.00	1.00
07/19/2022 04:00	1	1.8	8.9	14.7	14.6	642,304.2	0.00	1.00
07/19/2022 05:00	1	1.8	9.0	14.7	14.8	641,641.6	0.00	1.00
07/19/2022 06:00	2	1.8	10.5	14.8	19.2	637,343.6	0.00	1.00
07/19/2022 07:00	2	1.7	11.6	14.9	19.7	633,130.5	0.00	1.00
07/19/2022 08:00	2	1.7	11.2	14.9	18.2	631,761.1	0.00	1.00
07/19/2022 09:00	1	1.7	9.4	14.9	11.8	648,194.2	0.00	1.00
07/19/2022 10:00	0	1.7	7.3	14.7	7.0	689,571.4	0.00	1.00
07/19/2022 11:00	1	1.6	7.7	14.6	9.9	874,910.0	0.00	1.00
07/19/2022 12:00	1	2.1	9.4	13.7	18.6	1,007,477.9	0.00	1.00
07/19/2022 13:00	1	2.0	8.2	13.8	16.7	989,264.5	0.00	1.00
07/19/2022 14:00	1	2.0	8.2	14.0	17.0	1,002,855.3	0.00	1.00
07/19/2022 15:00	1	2.0	8.4	13.9	17.3	992,441.4	0.00	1.00
07/19/2022 16:00	2	2.2	10.4	13.2	22.3	995,945.0	0.00	1.00
07/19/2022 17:00	2	2.3	10.7	13.1	23.4	1,006,702.5	0.00	1.00
07/19/2022 18:00	2	2.4	12.3	12.6	28.0	1,005,619.5	0.00	1.00
07/19/2022 19:00	2	2.0	10.7	13.1	24.5	999,328.7	0.00	1.00
07/19/2022 20:00	1	1.8	8.1	14.0	17.6	995,115.1	0.00	1.00
07/19/2022 21:00	1	1.8	8.3	13.9	18.2	986,181.2	0.00	1.00
07/19/2022 22:00	1	1.7	8.0	14.1	17.7	990,214.7	0.00	1.00
07/19/2022 23:00	2	1.6	9.2	14.5	19.3	800,043.4	0.00	1.00
Average/Sum#:	1	1.9	9.3	14.2	17.1	822,970.9	0.00 #	24.00 #
Minimum:	0	1.6	7.3	12.6	7.0	631,761.1	0.00	1.00
Maximum:	2	2.4	12.3	14.9	28.0	1,007,477.9	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:	> 10							
	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1
	NH3Slip, Ppmvdc	NOx, Ppm	NOx, _SCR, Ppm	O2, Dry, Pct	NH3Inj, LbPerHr	ExhaustFlow, LbPerHr	SUSD, Hr	OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/20/2022 00:00	2	1.6	12.5	14.9	21.7	629,707.0	0.00	1.00
07/20/2022 01:00	2	1.6	12.1	14.9	21.2	631,076.4	0.00	1.00
07/20/2022 02:00	2	1.7	12.7	14.9	21.7	631,076.4	0.00	1.00
07/20/2022 03:00	3	1.7	12.6	14.8	22.9	621,404.4	0.00	1.00
07/20/2022 04:00	2	1.6	12.1	14.8	21.1	625,220.8	0.00	1.00
07/20/2022 05:00	2	1.5	11.6	14.8	21.3	631,506.7	0.00	1.00
07/20/2022 06:00	2	1.5	11.5	14.8	20.0	632,180.2	0.00	1.00
07/20/2022 07:00	1	1.5	9.9	14.8	15.7	644,976.4	0.00	1.00
07/20/2022 08:00	1	1.5	10.9	14.9	17.6	640,890.6	0.00	1.00
07/20/2022 09:00	1	1.5	9.4	14.8	13.0	643,405.0	0.00	1.00
07/20/2022 10:00	1	1.5	9.5	14.9	13.8	649,107.2	0.00	1.00
07/20/2022 11:00	0	1.6	7.7	14.8	6.8	655,752.2	0.00	1.00
07/20/2022 12:00	0	1.6	6.9	14.4	10.1	864,844.2	0.00	1.00
07/20/2022 13:00	1	1.9	8.8	13.7	18.8	1,001,962.2	0.00	1.00
07/20/2022 14:00	2	2.1	11.9	12.5	29.3	1,003,755.5	0.00	1.00
07/20/2022 15:00	1	1.8	8.3	13.7	17.7	981,230.6	0.00	1.00
07/20/2022 16:00	1	1.8	8.3	13.7	19.2	986,366.0	0.00	1.00
07/20/2022 17:00	2	2.1	11.1	12.7	26.5	993,333.7	0.00	1.00
07/20/2022 18:00	2	1.9	10.1	13.2	23.6	1,001,458.3	0.00	1.00
07/20/2022 19:00	2	2.0	10.7	13.0	24.6	998,466.4	0.00	1.00
07/20/2022 20:00	1	1.9	9.5	13.4	20.7	994,567.3	0.00	1.00
07/20/2022 21:00	1	1.6	8.5	14.5	16.1	800,471.3	0.00	1.00
07/20/2022 22:00	1	1.5	9.8	14.8	15.9	650,813.3	0.00	1.00
07/20/2022 23:00	2	1.5	10.7	14.9	18.4	638,380.0	0.00	1.00
Average/Sum#:	1	1.7	10.3	14.3	19.1	772,998.0	0.00 #	24.00 #
Minimum:	0	1.5	6.9	12.5	6.8	621,404.4	0.00	1.00
Maximum:	3	2.1	12.7	14.9	29.3	1,003,755.5	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOx, Ppm	Unit CT1 NOx, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/21/2022 00:00	2	1.5	9.7	14.8	16.0	642,731.5	0.00	1.00
07/21/2022 01:00	2	1.5	10.6	14.8	18.0	634,649.6	0.00	1.00
07/21/2022 02:00	2	1.4	11.6	14.8	21.0	633,302.7	0.00	1.00
07/21/2022 03:00	1	1.5	10.0	14.7	16.0	644,513.0	0.00	1.00
07/21/2022 04:00	3	1.5	11.6	14.8	22.8	630,384.2	0.00	1.00
07/21/2022 05:00	3	1.6	12.7	14.8	23.8	619,608.4	0.00	1.00
07/21/2022 06:00	2	1.7	12.6	14.8	22.4	622,302.4	0.00	1.00
07/21/2022 07:00	2	1.6	12.2	14.8	21.0	624,098.3	0.00	1.00
07/21/2022 08:00	2	1.6	11.6	14.9	19.1	633,358.8	0.00	1.00
07/21/2022 09:00	2	1.6	11.0	14.9	18.0	633,815.3	0.00	1.00
07/21/2022 10:00	1	1.6	10.5	14.9	17.6	635,184.7	0.00	1.00
07/21/2022 11:00	0	1.6	10.2	14.9	16.3	636,782.3	0.00	1.00
07/21/2022 12:00	1	1.6	8.7	14.9	10.8	650,933.1	0.00	1.00
07/21/2022 13:00	0	1.7	7.2	14.6	7.4	762,530.3	0.00	1.00
07/21/2022 14:00	1	2.0	8.3	13.8	16.4	984,056.8	0.00	1.00
07/21/2022 15:00	1	1.9	8.3	13.8	16.7	985,406.9	0.00	1.00
07/21/2022 16:00	1	1.9	8.3	13.8	16.8	984,056.8	0.00	1.00
07/21/2022 17:00	1	2.0	8.8	13.5	18.6	985,800.5	0.00	1.00
07/21/2022 18:00	1	2.1	9.5	13.3	20.2	989,589.3	0.00	1.00
07/21/2022 19:00	1	1.9	8.1	13.8	16.5	974,991.6	0.00	1.00
07/21/2022 20:00	1	1.9	8.3	13.9	17.0	992,050.2	0.00	1.00
07/21/2022 21:00	1	1.8	8.1	14.3	16.6	867,094.6	0.00	1.00
07/21/2022 22:00	2	1.6	11.1	14.9	18.6	636,554.1	0.00	1.00
07/21/2022 23:00	1	1.6	9.7	14.8	15.3	643,405.0	0.00	1.00
Average/Sum#:	1	1.7	9.9	14.5	17.6	751,966.7	0.00 #	24.00 #
Minimum:	0	1.4	7.2	13.3	7.4	619,608.4	0.00	1.00
Maximum:	3	2.1	12.7	14.9	23.8	992,050.2	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOx, Ppm	Unit CT1 NOx, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/22/2022 00:00	1	1.6	9.1	14.7	13.3	641,862.5	0.00	1.00
07/22/2022 01:00	1	1.7	9.2	14.8	15.4	651,262.3	0.00	1.00
07/22/2022 02:00	0	1.7	7.8	14.5	11.6	702,471.9	0.00	1.00
07/22/2022 03:00	3	1.7	10.2	14.7	18.2	640,537.2	0.00	1.00
07/22/2022 04:00	2	1.6	9.8	14.7	17.0	637,665.8	0.00	1.00
07/22/2022 05:00	2	1.6	10.3	14.7	18.1	635,015.3	0.00	1.00
07/22/2022 06:00	2	1.7	11.5	14.8	20.8	633,976.1	0.00	1.00
07/22/2022 07:00	2	1.6	12.2	14.8	20.9	624,771.8	0.00	1.00
07/22/2022 08:00	2	1.6	11.6	14.9	19.6	632,902.3	0.00	1.00
07/22/2022 09:00	2	1.6	11.3	14.9	18.9	632,445.8	0.00	1.00
07/22/2022 10:00	1	1.6	10.5	14.9	17.0	636,097.6	0.00	1.00
07/22/2022 11:00	1	1.6	10.2	14.9	16.3	636,097.6	0.00	1.00
07/22/2022 12:00	1	1.6	9.7	14.9	14.8	636,782.3	0.00	1.00
07/22/2022 13:00	1	1.6	8.7	15.0	11.8	658,252.1	0.00	1.00
07/22/2022 14:00	0	1.6	6.7	14.7	8.2	782,780.6	0.00	1.00
07/22/2022 15:00	1	1.9	8.4	13.9	16.2	995,375.9	0.00	1.00
07/22/2022 16:00	1	1.9	8.5	13.9	17.3	991,658.9	0.00	1.00
07/22/2022 17:00	1	1.9	8.4	13.9	17.2	991,267.6	0.00	1.00
07/22/2022 18:00	1	1.9	8.3	13.9	17.2	989,311.3	0.00	1.00
07/22/2022 19:00	1	1.9	8.2	14.0	17.2	994,519.7	0.00	1.00
07/22/2022 20:00	1	1.9	8.1	14.0	17.1	987,374.8	0.00	1.00
07/22/2022 21:00	1	1.7	7.9	14.4	14.0	818,283.7	0.00	1.00
07/22/2022 22:00	1	1.6	9.1	14.7	14.8	651,581.0	0.00	1.00
07/22/2022 23:00	1	1.5	8.7	14.6	13.7	731,446.5	0.00	1.00
Average/Sum#:	1	1.7	9.4	14.6	16.1	747,239.2	0.00 #	24.00 #
Minimum:	0	1.5	6.7	13.9	8.2	624,771.8	0.00	1.00
Maximum:	3	1.9	12.2	15.0	20.9	995,375.9	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOx, Ppm	Unit CT1 NOx, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/23/2022 00:00	1	1.7	7.6	14.5	11.2	709,105.1	0.00	1.00
07/23/2022 01:00	1	1.7	8.1	14.6	12.9	665,583.7	0.00	1.00
07/23/2022 02:00	2	1.7	8.4	14.6	14.8	744,488.7	0.00	1.00
07/23/2022 03:00	1	1.6	8.7	14.6	13.1	649,933.2	0.00	1.00
07/23/2022 04:00	1	1.6	8.5	14.6	14.4	662,540.6	0.00	1.00
07/23/2022 05:00	1	1.7	8.5	14.5	13.8	678,934.9	0.00	1.00
07/23/2022 06:00	1	1.7	7.5	14.4	16.0	993,148.7	0.00	1.00
07/23/2022 07:00	1	1.8	7.6	14.3	17.0	1,005,489.5	0.00	1.00
07/23/2022 08:00	1	1.8	7.3	14.3	16.3	1,000,717.2	0.00	1.00
07/23/2022 09:00	1	1.7	7.5	14.5	13.1	807,104.5	0.00	1.00
07/23/2022 10:00	1	1.7	7.7	14.7	10.1	657,986.3	0.00	1.00
07/23/2022 11:00	0	1.7	7.6	14.8	8.9	671,466.9	0.00	1.00
07/23/2022 12:00	0	1.7	7.5	14.8	8.9	672,589.4	0.00	1.00
07/23/2022 13:00	0	1.6	7.5	14.8	9.1	673,711.9	0.00	1.00
07/23/2022 14:00	1	1.6	7.5	14.8	10.0	675,732.4	0.00	1.00
07/23/2022 15:00	0	1.6	7.1	14.7	9.6	734,850.8	0.00	1.00
07/23/2022 16:00	1	1.7	8.1	14.6	13.1	733,402.8	0.00	1.00
07/23/2022 17:00	1	1.7	7.2	14.7	10.9	827,176.5	0.00	1.00
07/23/2022 18:00	2	2.1	10.2	13.2	22.1	1,001,458.3	0.00	1.00
07/23/2022 19:00	1	2.0	9.1	13.5	19.5	997,644.2	0.00	1.00
07/23/2022 20:00	1	1.9	8.1	14.0	16.9	998,885.9	0.00	1.00
07/23/2022 21:00	1	1.8	7.3	14.2	12.8	876,227.2	0.00	1.00
07/23/2022 22:00	1	1.6	7.7	14.6	10.3	740,141.3	0.00	1.00
07/23/2022 23:00	1	1.7	6.7	14.4	14.4	980,718.5	0.00	1.00
Average/Sum#:	1	1.7	7.9	14.4	13.3	798,293.3	0.00 #	24.00 #
Minimum:	0	1.6	6.7	13.2	8.9	649,933.2	0.00	1.00
Maximum:	2	2.1	10.2	14.8	22.1	1,005,489.5	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 **To:** 09/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOx, Ppm	Unit CT1 NOx, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/24/2022 00:00	1	1.7	6.2	14.5	13.7	969,509.7	0.00	1.00
07/24/2022 01:00	1	1.7	6.3	14.5	14.4	971,007.5	0.00	1.00
07/24/2022 02:00	1	1.7	6.8	14.5	15.2	981,064.2	0.00	1.00
07/24/2022 03:00	1	1.7	6.7	14.5	16.1	987,055.4	0.00	1.00
07/24/2022 04:00	1	1.7	6.6	14.5	16.0	980,208.3	0.00	1.00
07/24/2022 05:00	2	1.7	9.6	14.6	20.4	751,444.5	0.00	1.00
07/24/2022 06:00	2	1.6	10.4	14.7	16.6	635,457.1	0.00	1.00
07/24/2022 07:00	1	1.6	9.8	14.7	15.4	637,003.2	0.00	1.00
07/24/2022 08:00	1	1.6	10.6	14.8	16.7	632,180.2	0.00	1.00
07/24/2022 09:00	2	1.6	10.9	14.9	18.3	634,043.5	0.00	1.00
07/24/2022 10:00	1	1.6	10.5	14.9	17.1	635,641.2	0.00	1.00
07/24/2022 11:00	1	1.6	9.7	14.9	14.8	638,151.8	0.00	1.00
07/24/2022 12:00	1	1.6	9.3	14.9	13.5	637,923.5	0.00	1.00
07/24/2022 13:00	1	1.6	8.8	14.9	12.8	637,923.5	0.00	1.00
07/24/2022 14:00	0	1.6	8.0	15.0	9.8	651,056.8	0.00	1.00
07/24/2022 15:00	1	1.6	8.5	15.0	12.2	646,646.8	0.00	1.00
07/24/2022 16:00	0	1.7	7.3	14.4	11.2	832,610.0	0.00	1.00
07/24/2022 17:00	1	1.9	8.6	13.8	16.5	989,264.5	0.00	1.00
07/24/2022 18:00	1	1.9	8.4	13.8	16.5	986,949.9	0.00	1.00
07/24/2022 19:00	1	1.9	8.2	13.9	17.0	987,159.3	0.00	1.00
07/24/2022 20:00	1	1.8	7.7	14.2	16.0	875,818.4	0.00	1.00
07/24/2022 21:00	1	1.5	10.0	14.9	15.5	637,695.3	0.00	1.00
07/24/2022 22:00	2	1.5	10.4	14.9	17.6	633,815.3	0.00	1.00
07/24/2022 23:00	1	1.5	8.6	14.7	12.0	635,015.3	0.00	1.00
Average/Sum#:	1	1.7	8.7	14.6	15.2	775,193.6	0.00 #	24.00 #
Minimum:	0	1.5	6.2	13.8	9.8	632,180.2	0.00	1.00
Maximum:	2	1.9	10.9	15.0	20.4	989,264.5	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOx, Ppm	Unit CT1 NOx, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/25/2022 00:00	2	1.5	10.1	14.8	17.0	631,955.7	0.00	1.00
07/25/2022 01:00	2	1.5	11.3	14.8	20.6	621,404.4	0.00	1.00
07/25/2022 02:00	2	1.6	12.2	14.8	21.8	621,179.9	0.00	1.00
07/25/2022 03:00	3	1.6	12.4	14.8	23.4	620,057.4	0.00	1.00
07/25/2022 04:00	2	1.6	10.2	14.7	16.7	633,027.5	0.00	1.00
07/25/2022 05:00	2	1.6	9.8	14.7	17.6	639,653.7	0.00	1.00
07/25/2022 06:00	2	1.6	9.9	14.7	18.6	638,107.6	0.00	1.00
07/25/2022 07:00	2	1.6	9.8	14.7	16.4	639,212.0	0.00	1.00
07/25/2022 08:00	2	1.5	11.6	14.8	20.3	624,771.8	0.00	1.00
07/25/2022 09:00	2	1.6	11.3	14.8	19.5	620,730.9	0.00	1.00
07/25/2022 10:00	2	1.5	10.9	14.9	18.7	629,707.0	0.00	1.00
07/25/2022 11:00	0	1.5	8.7	14.8	9.9	645,200.9	0.00	1.00
07/25/2022 12:00	0	1.5	7.8	14.8	7.8	651,037.8	0.00	1.00
07/25/2022 13:00	0	1.6	6.9	14.4	9.2	844,408.1	0.00	1.00
07/25/2022 14:00	1	1.9	8.3	13.7	17.1	984,844.4	0.00	1.00
07/25/2022 15:00	1	1.9	8.3	13.6	18.0	982,796.5	0.00	1.00
07/25/2022 16:00	1	1.9	8.7	13.4	19.5	979,229.7	0.00	1.00
07/25/2022 17:00	1	1.9	9.2	13.3	20.6	987,427.1	0.00	1.00
07/25/2022 18:00	2	2.0	9.5	13.2	21.5	985,096.3	0.00	1.00
07/25/2022 19:00	1	1.8	8.1	13.7	17.9	980,089.4	0.00	1.00
07/25/2022 20:00	1	1.8	7.5	13.9	17.3	982,855.4	0.00	1.00
07/25/2022 21:00	1	1.8	7.8	14.0	17.7	993,527.3	0.00	1.00
07/25/2022 22:00	1	1.6	7.7	14.4	14.7	798,058.4	0.00	1.00
07/25/2022 23:00	1	1.6	7.6	14.5	12.3	728,576.6	0.00	1.00
Average/Sum#:	1	1.7	9.4	14.3	17.3	769,289.8	0.00 #	24.00 #
Minimum:	0	1.5	6.9	13.2	7.8	620,057.4	0.00	1.00
Maximum:	3	2.0	12.4	14.9	23.4	993,527.3	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOx, Ppm	Unit CT1 NOx, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/26/2022 00:00	2	1.6	9.1	14.7	15.4	640,316.3	0.00	1.00
07/26/2022 01:00	2	1.6	9.1	14.7	15.8	638,549.3	0.00	1.00
07/26/2022 02:00	2	1.5	9.6	14.7	16.4	639,432.8	0.00	1.00
07/26/2022 03:00	2	1.6	9.5	14.7	16.6	637,886.7	0.00	1.00
07/26/2022 04:00	1	1.6	7.6	14.5	14.2	864,449.1	0.00	1.00
07/26/2022 05:00	1	1.7	7.5	14.2	18.6	996,000.7	0.00	1.00
07/26/2022 06:00	2	1.6	8.7	14.6	18.2	723,403.9	0.00	1.00
07/26/2022 07:00	1	1.5	9.0	14.7	13.5	644,954.7	0.00	1.00
07/26/2022 08:00	2	1.6	10.5	14.8	20.0	634,874.1	0.00	1.00
07/26/2022 09:00	2	1.5	11.0	14.8	19.6	632,404.7	0.00	1.00
07/26/2022 10:00	1	1.5	9.1	14.7	12.8	638,549.3	0.00	1.00
07/26/2022 11:00	2	1.5	10.8	14.8	18.7	633,976.1	0.00	1.00
07/26/2022 12:00	1	1.6	8.1	14.7	11.6	657,102.8	0.00	1.00
07/26/2022 13:00	0	1.6	7.1	14.4	10.9	860,630.6	0.00	1.00
07/26/2022 14:00	1	1.8	8.0	13.9	16.9	993,419.6	0.00	1.00
07/26/2022 15:00	1	1.8	8.1	13.8	17.2	983,863.9	0.00	1.00
07/26/2022 16:00	1	1.9	8.6	13.6	19.0	990,112.6	0.00	1.00
07/26/2022 17:00	2	2.0	9.5	13.2	21.3	988,119.7	0.00	1.00
07/26/2022 18:00	1	1.9	8.6	13.5	20.0	991,167.2	0.00	1.00
07/26/2022 19:00	1	1.8	7.9	13.8	17.7	983,478.2	0.00	1.00
07/26/2022 20:00	1	1.8	7.6	13.9	17.6	984,224.9	0.00	1.00
07/26/2022 21:00	1	1.8	7.6	14.0	17.8	989,161.0	0.00	1.00
07/26/2022 22:00	1	1.7	7.6	14.1	18.1	997,867.3	0.00	1.00
07/26/2022 23:00	1	1.6	7.8	14.4	16.2	802,061.3	0.00	1.00
Average/Sum#:	1	1.7	8.7	14.3	16.8	814,417.0	0.00 #	24.00 #
Minimum:	0	1.5	7.1	13.2	10.9	632,404.7	0.00	1.00
Maximum:	2	2.0	11.0	14.8	21.3	997,867.3	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOX, Ppm	Unit CT1 NOX, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/27/2022 00:00	2	1.6	9.0	14.7	15.7	643,850.3	0.00	1.00
07/27/2022 01:00	2	1.6	9.1	14.7	16.2	644,954.7	0.00	1.00
07/27/2022 02:00	2	1.5	9.8	14.7	17.0	643,629.5	0.00	1.00
07/27/2022 03:00	2	1.6	9.6	14.7	17.5	644,071.2	0.00	1.00
07/27/2022 04:00	2	1.6	9.7	14.7	17.8	642,746.0	0.00	1.00
07/27/2022 05:00	1	1.6	9.1	14.6	14.8	662,105.8	0.00	1.00
07/27/2022 06:00	2	1.7	9.5	14.6	17.6	704,058.0	0.00	1.00
07/27/2022 07:00	1	1.7	9.3	14.7	13.4	657,765.5	0.00	1.00
07/27/2022 08:00	1	1.7	9.0	14.7	13.8	643,629.5	0.00	1.00
07/27/2022 09:00	2	1.7	10.5	14.8	16.8	632,180.2	0.00	1.00
07/27/2022 10:00	0	1.7	8.3	14.8	9.2	651,486.8	0.00	1.00
07/27/2022 11:00	0	1.7	8.0	14.8	9.2	655,078.7	0.00	1.00
07/27/2022 12:00	1	1.6	8.4	14.8	11.6	646,547.9	0.00	1.00
07/27/2022 13:00	0	1.8	7.0	14.2	11.3	938,566.7	0.00	1.00
07/27/2022 14:00	1	2.0	8.2	13.8	16.4	989,457.3	0.00	1.00
07/27/2022 15:00	1	2.0	8.2	13.7	16.4	980,850.2	0.00	1.00
07/27/2022 16:00	1	2.0	8.2	13.7	16.6	985,985.6	0.00	1.00
07/27/2022 17:00	2	2.3	10.6	12.8	23.7	993,255.3	0.00	1.00
07/27/2022 18:00	1	2.0	7.8	13.8	16.3	981,742.3	0.00	1.00
07/27/2022 19:00	1	2.0	7.6	13.9	16.6	988,528.8	0.00	1.00
07/27/2022 20:00	1	1.9	7.5	13.9	16.5	981,486.0	0.00	1.00
07/27/2022 21:00	1	1.8	7.3	14.2	14.2	905,046.4	0.00	1.00
07/27/2022 22:00	1	1.7	7.6	14.6	12.7	781,224.0	0.00	1.00
07/27/2022 23:00	1	1.8	8.0	14.6	14.8	760,356.6	0.00	1.00
Average/Sum#:	1	1.8	8.6	14.4	15.3	781,608.5	0.00 #	24.00 #
Minimum:	0	1.5	7.0	12.8	9.2	632,180.2	0.00	1.00
Maximum:	2	2.3	10.6	14.8	23.7	993,255.3	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 **To:** 09/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOx, Ppm	Unit CT1 NOx, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/28/2022 00:00	2	1.6	7.8	14.5	13.7	717,236.0	0.00	1.00
07/28/2022 01:00	1	1.7	8.7	14.6	12.7	656,671.6	0.00	1.00
07/28/2022 02:00	1	1.7	9.2	14.7	15.1	645,396.5	0.00	1.00
07/28/2022 03:00	1	1.8	7.6	14.4	15.1	855,995.6	0.00	1.00
07/28/2022 04:00	1	1.9	7.6	14.2	18.8	1,003,563.2	0.00	1.00
07/28/2022 05:00	1	1.8	7.3	14.3	16.2	903,405.1	0.00	1.00
07/28/2022 06:00	1	1.7	6.6	14.4	11.6	811,963.3	0.00	1.00
07/28/2022 07:00	1	1.8	7.3	14.5	13.7	797,689.7	0.00	1.00
07/28/2022 08:00	1	1.7	9.1	14.7	14.4	640,979.0	0.00	1.00
07/28/2022 09:00	1	1.7	8.6	14.7	12.5	651,801.8	0.00	1.00
07/28/2022 10:00	0	1.8	6.1	14.5	9.9	927,785.0	0.00	1.00
07/28/2022 11:00	1	2.0	8.1	13.8	17.6	992,929.1	0.00	1.00
07/28/2022 12:00	1	2.0	7.5	13.8	15.7	985,214.0	0.00	1.00
07/28/2022 13:00	1	2.0	7.8	13.7	17.1	982,942.4	0.00	1.00
07/28/2022 14:00	2	2.2	9.5	13.1	20.8	980,016.3	0.00	1.00
07/28/2022 15:00	1	2.0	7.9	13.7	16.8	977,426.7	0.00	1.00
07/28/2022 16:00	1	2.0	8.1	13.6	16.9	975,668.0	0.00	1.00
07/28/2022 17:00	2	2.3	10.0	12.9	23.1	987,868.5	0.00	1.00
07/28/2022 18:00	2	2.2	10.8	12.6	25.2	975,921.1	0.00	1.00
07/28/2022 19:00	1	2.0	8.7	13.5	18.6	982,284.4	0.00	1.00
07/28/2022 20:00	1	2.0	8.3	13.6	18.3	980,920.6	0.00	1.00
07/28/2022 21:00	1	1.9	7.7	14.0	17.2	990,550.3	0.00	1.00
07/28/2022 22:00	1	1.8	7.4	14.2	15.0	874,387.7	0.00	1.00
07/28/2022 23:00	1	1.7	8.6	14.6	14.0	640,368.9	0.00	1.00
Average/Sum#:	1	1.9	8.2	14.0	16.3	872,457.7	0.00 #	24.00 #
Minimum:	0	1.6	6.1	12.6	9.9	640,368.9	0.00	1.00
Maximum:	2	2.3	10.8	14.7	25.2	1,003,563.2	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOX, Ppm	Unit CT1 NOX, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/29/2022 00:00	2	1.7	9.6	14.7	18.0	629,714.3	0.00	1.00
07/29/2022 01:00	2	1.7	10.2	14.7	18.2	626,843.0	0.00	1.00
07/29/2022 02:00	1	1.7	9.3	14.7	14.3	637,003.2	0.00	1.00
07/29/2022 03:00	2	1.7	9.4	14.7	16.7	640,316.3	0.00	1.00
07/29/2022 04:00	1	1.8	7.2	14.3	15.1	939,093.1	0.00	1.00
07/29/2022 05:00	1	1.8	7.6	14.1	18.9	985,381.4	0.00	1.00
07/29/2022 06:00	1	1.7	7.8	14.5	14.0	762,812.2	0.00	1.00
07/29/2022 07:00	2	1.7	9.1	14.6	15.4	635,586.8	0.00	1.00
07/29/2022 08:00	1	1.7	8.6	14.7	13.3	644,733.8	0.00	1.00
07/29/2022 09:00	1	1.7	8.2	14.7	12.5	644,954.7	0.00	1.00
07/29/2022 10:00	0	1.7	7.7	14.7	9.4	645,617.3	0.00	1.00
07/29/2022 11:00	0	1.7	7.0	14.7	6.4	709,450.2	0.00	1.00
07/29/2022 12:00	1	1.9	7.6	14.0	14.8	984,794.8	0.00	1.00
07/29/2022 13:00	1	2.0	8.1	13.7	16.2	980,660.0	0.00	1.00
07/29/2022 14:00	1	2.0	8.5	13.5	18.4	986,725.8	0.00	1.00
07/29/2022 15:00	1	2.0	7.9	13.6	16.7	967,976.7	0.00	1.00
07/29/2022 16:00	1	2.0	7.8	13.6	16.6	971,353.4	0.00	1.00
07/29/2022 17:00	1	2.0	8.4	13.4	17.4	968,456.9	0.00	1.00
07/29/2022 18:00	1	2.0	7.7	13.7	16.6	974,383.5	0.00	1.00
07/29/2022 19:00	1	1.9	7.5	13.8	16.8	978,463.4	0.00	1.00
07/29/2022 20:00	1	1.9	7.3	13.9	16.8	985,594.3	0.00	1.00
07/29/2022 21:00	1	1.9	7.7	13.8	17.9	983,092.4	0.00	1.00
07/29/2022 22:00	1	1.9	7.6	14.0	17.6	987,970.2	0.00	1.00
07/29/2022 23:00	1	1.9	7.8	13.9	18.9	990,485.1	0.00	1.00
Average/Sum#:	1	1.8	8.2	14.2	15.7	844,227.6	0.00 #	24.00 #
Minimum:	0	1.7	7.0	13.4	6.4	626,843.0	0.00	1.00
Maximum:	2	2.0	10.2	14.7	18.9	990,485.1	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:	> 10							
	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1
	NH3Slip, Ppmvdc	NOx, Ppm	NOx, _SCR, Ppm	O2, Dry, Pct	NH3Inj, LbPerHr	ExhaustFlow, LbPerHr	SUSD, Hr	OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/30/2022 00:00	1	1.8	7.4	14.1	18.3	989,207.7	0.00	1.00
07/30/2022 01:00	1	1.8	7.4	14.1	18.4	983,367.5	0.00	1.00
07/30/2022 02:00	1	1.6	6.5	14.4	12.9	852,203.3	0.00	1.00
07/30/2022 03:00	1	1.7	6.4	14.4	14.4	890,547.2	0.00	1.00
07/30/2022 04:00	1	1.8	7.4	14.2	19.2	980,671.4	0.00	1.00
07/30/2022 05:00	1	1.9	7.9	14.0	19.3	989,558.0	0.00	1.00
07/30/2022 06:00	1	1.9	6.8	14.4	15.0	947,641.7	0.00	1.00
07/30/2022 07:00	1	1.8	8.2	14.5	12.8	669,306.2	0.00	1.00
07/30/2022 08:00	1	1.8	8.7	14.7	13.0	641,420.7	0.00	1.00
07/30/2022 09:00	2	1.8	9.9	14.8	16.8	631,955.7	0.00	1.00
07/30/2022 10:00	2	1.7	9.9	14.8	16.1	629,486.2	0.00	1.00
07/30/2022 11:00	0	1.7	8.1	14.6	10.2	767,964.5	0.00	1.00
07/30/2022 12:00	1	2.1	7.9	13.8	14.9	986,757.1	0.00	1.00
07/30/2022 13:00	1	2.1	8.0	13.7	15.4	979,709.0	0.00	1.00
07/30/2022 14:00	2	2.3	9.9	13.0	22.0	992,919.4	0.00	1.00
07/30/2022 15:00	3	2.6	11.8	12.0	29.7	981,677.3	0.00	1.00
07/30/2022 16:00	2	2.5	11.2	12.3	26.6	982,163.9	0.00	1.00
07/30/2022 17:00	1	2.2	9.2	13.2	18.6	981,895.1	0.00	1.00
07/30/2022 18:00	1	2.0	7.7	13.8	16.6	983,285.3	0.00	1.00
07/30/2022 19:00	1	1.9	7.6	13.8	16.9	976,920.4	0.00	1.00
07/30/2022 20:00	1	1.9	7.7	13.9	17.1	979,529.7	0.00	1.00
07/30/2022 21:00	1	2.0	8.2	13.7	18.6	985,034.6	0.00	1.00
07/30/2022 22:00	1	1.9	7.8	14.0	17.9	989,558.0	0.00	1.00
07/30/2022 23:00	1	1.9	7.7	14.0	17.8	983,008.5	0.00	1.00
Average/Sum#:	1	1.9	8.3	13.9	17.4	907,324.5	0.00 #	24.00 #
Minimum:	0	1.6	6.4	12.0	10.2	629,486.2	0.00	1.00
Maximum:	3	2.6	11.8	14.8	29.7	992,919.4	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOx, Ppm	Unit CT1 NOx, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/31/2022 00:00	1	1.9	7.7	14.0	17.7	981,023.9	0.00	1.00
07/31/2022 01:00	1	1.9	7.6	14.1	17.8	993,839.6	0.00	1.00
07/31/2022 02:00	1	1.9	8.0	14.1	17.7	991,221.6	0.00	1.00
07/31/2022 03:00	1	1.8	7.5	14.4	16.2	898,131.7	0.00	1.00
07/31/2022 04:00	2	1.6	10.3	14.7	19.1	622,646.3	0.00	1.00
07/31/2022 05:00	1	1.6	8.5	14.6	14.3	795,570.4	0.00	1.00
07/31/2022 06:00	1	1.7	7.0	14.5	12.7	827,217.9	0.00	1.00
07/31/2022 07:00	2	1.7	10.4	14.7	20.4	636,340.6	0.00	1.00
07/31/2022 08:00	2	1.7	11.5	14.8	20.1	620,506.4	0.00	1.00
07/31/2022 09:00	1	1.6	9.2	14.7	12.9	633,469.2	0.00	1.00
07/31/2022 10:00	1	1.7	7.2	14.5	11.0	846,903.4	0.00	1.00
07/31/2022 11:00	1	1.9	7.7	14.0	16.4	982,810.1	0.00	1.00
07/31/2022 12:00	1	1.9	7.7	14.0	16.8	983,008.5	0.00	1.00
07/31/2022 13:00	1	1.9	7.8	13.9	16.6	972,682.6	0.00	1.00
07/31/2022 14:00	1	2.0	8.9	13.5	19.0	987,836.1	0.00	1.00
07/31/2022 15:00	1	2.0	8.3	13.6	17.8	980,170.2	0.00	1.00
07/31/2022 16:00	2	2.0	8.8	13.4	20.1	982,151.2	0.00	1.00
07/31/2022 17:00	2	2.2	10.1	12.9	23.2	983,931.4	0.00	1.00
07/31/2022 18:00	1	1.9	7.8	13.8	16.7	971,519.8	0.00	1.00
07/31/2022 19:00	1	1.9	7.8	13.9	17.0	973,660.7	0.00	1.00
07/31/2022 20:00	1	1.9	7.8	14.0	17.3	992,336.5	0.00	1.00
07/31/2022 21:00	1	1.9	7.8	13.9	18.2	992,050.2	0.00	1.00
07/31/2022 22:00	1	1.8	7.1	14.2	14.0	879,497.5	0.00	1.00
07/31/2022 23:00	1	1.7	8.3	14.7	13.8	650,918.3	0.00	1.00
Average/Sum#:	1	1.8	8.4	14.1	17.0	882,476.8	0.00 #	24.00 #
Minimum:	1	1.6	7.0	12.9	11.0	620,506.4	0.00	1.00
Maximum:	2	2.2	11.5	14.8	23.2	993,839.6	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOx, Ppm	Unit CT1 NOx, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/01/2022 00:00	1	1.7	6.4	14.4	11.0	800,586.6	0.00	1.00
08/01/2022 01:00	2	1.7	8.9	14.7	15.1	636,340.6	0.00	1.00
08/01/2022 02:00	2	1.7	9.1	14.7	14.9	637,224.1	0.00	1.00
08/01/2022 03:00	1	1.8	7.5	14.4	14.0	814,702.2	0.00	1.00
08/01/2022 04:00	1	1.8	7.7	14.1	18.7	984,173.1	0.00	1.00
08/01/2022 05:00	2	2.0	8.9	13.7	24.3	1,008,048.5	0.00	1.00
08/01/2022 06:00	3	1.4	11.7	12.6	29.3	939,953.1	0.00	1.00
08/01/2022 07:00	0	1.8	8.2	14.2	18.5	998,249.1	0.00	1.00
08/01/2022 08:00	1	2.0	7.9	14.1	15.9	989,610.5	0.00	1.00
08/01/2022 09:00	1	2.0	8.0	14.1	17.1	1,002,902.0	0.00	1.00
08/01/2022 10:00	1	2.0	7.9	14.1	17.0	996,659.0	0.00	1.00
08/01/2022 11:00	1	2.0	7.9	14.0	16.7	985,787.1	0.00	1.00
08/01/2022 12:00	1	2.0	7.9	14.0	16.6	984,993.2	0.00	1.00
08/01/2022 13:00	1	2.0	7.9	14.0	16.4	987,176.4	0.00	1.00
08/01/2022 14:00	1	2.0	7.9	14.0	16.0	988,962.6	0.00	1.00
08/01/2022 15:00	1	2.0	8.0	13.9	16.0	981,877.3	0.00	1.00
08/01/2022 16:00	1	2.0	8.0	13.9	16.2	978,355.9	0.00	1.00
08/01/2022 17:00	1	2.0	8.0	13.9	16.5	976,204.0	0.00	1.00
08/01/2022 18:00	1	2.0	8.0	13.9	16.8	975,030.2	0.00	1.00
08/01/2022 19:00	1	2.0	8.0	13.9	16.7	974,052.0	0.00	1.00
08/01/2022 20:00	1	2.0	8.1	13.9	16.9	983,638.0	0.00	1.00
08/01/2022 21:00	1	2.0	8.0	13.9	17.9	984,616.1	0.00	1.00
08/01/2022 22:00	1	1.9	7.4	14.2	14.9	891,352.2	0.00	1.00
08/01/2022 23:00	2	1.8	8.8	14.6	16.0	630,804.7	0.00	1.00
Average/Sum#:	1	1.9	8.2	14.1	17.1	922,137.4	0.00 #	24.00 #
Minimum:	0	1.4	6.4	12.6	11.0	630,804.7	0.00	1.00
Maximum:	3	2.0	11.7	14.7	29.3	1,008,048.5	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOx, Ppm	Unit CT1 NOx, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/02/2022 00:00	1	1.7	9.4	14.7	14.4	631,260.5	0.00	1.00
08/02/2022 01:00	2	1.8	10.4	14.7	17.8	620,879.3	0.00	1.00
08/02/2022 02:00	2	1.7	12.0	14.8	20.2	619,608.4	0.00	1.00
08/02/2022 03:00	1	1.7	9.5	14.7	12.5	635,015.3	0.00	1.00
08/02/2022 04:00	1	1.8	7.6	14.4	11.5	817,019.7	0.00	1.00
08/02/2022 05:00	1	1.9	8.0	14.0	17.7	982,214.7	0.00	1.00
08/02/2022 06:00	2	1.7	8.8	14.4	17.5	792,580.7	0.00	1.00
08/02/2022 07:00	2	1.7	11.3	14.8	18.4	620,057.4	0.00	1.00
08/02/2022 08:00	1	1.7	10.4	14.8	15.6	620,281.9	0.00	1.00
08/02/2022 09:00	1	1.7	9.9	14.8	15.2	620,730.9	0.00	1.00
08/02/2022 10:00	1	1.6	9.5	14.8	13.9	620,506.4	0.00	1.00
08/02/2022 11:00	0	1.7	7.5	14.4	9.6	801,429.3	0.00	1.00
08/02/2022 12:00	1	2.0	8.4	13.6	16.0	970,790.6	0.00	1.00
08/02/2022 13:00	1	2.0	8.3	13.6	16.4	975,855.6	0.00	1.00
08/02/2022 14:00	1	2.0	8.2	13.7	16.9	980,089.4	0.00	1.00
08/02/2022 15:00	1	2.0	8.3	13.6	17.6	969,102.2	0.00	1.00
08/02/2022 16:00	2	2.2	11.1	12.7	24.3	975,130.4	0.00	1.00
08/02/2022 17:00	3	2.4	12.4	12.2	29.8	983,309.7	0.00	1.00
08/02/2022 18:00	1	2.0	9.1	13.4	18.3	969,004.7	0.00	1.00
08/02/2022 19:00	1	1.9	8.1	13.8	16.6	969,205.3	0.00	1.00
08/02/2022 20:00	1	1.9	8.5	13.8	17.5	982,320.9	0.00	1.00
08/02/2022 21:00	1	1.9	8.2	14.0	16.4	982,413.1	0.00	1.00
08/02/2022 22:00	1	1.9	8.2	14.0	16.5	983,603.9	0.00	1.00
08/02/2022 23:00	1	1.9	8.2	14.0	17.1	982,810.1	0.00	1.00
Average/Sum#:	1	1.9	9.2	14.1	17.0	837,717.5	0.00 #	24.00 #
Minimum:	0	1.6	7.5	12.2	9.6	619,608.4	0.00	1.00
Maximum:	3	2.4	12.4	14.8	29.8	983,603.9	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOx, Ppm	Unit CT1 NOx, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/03/2022 00:00	1	1.7	8.8	14.6	15.0	720,143.3	0.00	1.00
08/03/2022 01:00	1	1.7	8.7	14.7	12.1	638,107.6	0.00	1.00
08/03/2022 02:00	1	1.7	9.2	14.7	13.5	637,003.2	0.00	1.00
08/03/2022 03:00	2	1.7	9.4	14.7	12.3	635,015.3	0.00	1.00
08/03/2022 04:00	1	1.7	7.9	14.4	12.0	814,070.1	0.00	1.00
08/03/2022 05:00	1	1.8	8.0	14.1	17.7	982,360.6	0.00	1.00
08/03/2022 06:00	1	1.7	8.3	14.5	14.4	746,122.3	0.00	1.00
08/03/2022 07:00	2	1.7	10.3	14.8	17.5	632,853.7	0.00	1.00
08/03/2022 08:00	0	1.6	8.4	14.8	8.5	647,894.9	0.00	1.00
08/03/2022 09:00	1	1.6	9.5	14.9	15.1	639,977.7	0.00	1.00
08/03/2022 10:00	1	1.6	9.7	14.9	14.5	633,358.8	0.00	1.00
08/03/2022 11:00	0	1.7	7.3	14.7	7.5	659,532.5	0.00	1.00
08/03/2022 12:00	0	1.7	6.8	14.7	8.2	752,520.8	0.00	1.00
08/03/2022 13:00	1	1.9	7.9	13.9	14.4	956,445.1	0.00	1.00
08/03/2022 14:00	1	2.0	8.7	13.5	17.9	969,145.3	0.00	1.00
08/03/2022 15:00	1	2.0	8.3	13.6	17.4	964,412.4	0.00	1.00
08/03/2022 16:00	1	2.0	8.5	13.6	17.5	972,666.5	0.00	1.00
08/03/2022 17:00	3	2.5	12.3	11.9	31.5	975,334.5	0.00	1.00
08/03/2022 18:00	3	2.4	12.3	11.9	32.0	977,312.5	0.00	1.00
08/03/2022 19:00	3	2.4	12.1	12.0	31.1	977,522.8	0.00	1.00
08/03/2022 20:00	2	2.2	11.2	12.6	24.1	971,796.3	0.00	1.00
08/03/2022 21:00	1	1.9	8.0	13.8	16.0	971,326.9	0.00	1.00
08/03/2022 22:00	1	1.9	8.1	13.9	16.0	971,313.2	0.00	1.00
08/03/2022 23:00	1	1.9	8.3	13.9	16.1	974,052.0	0.00	1.00
Average/Sum#:	1	1.9	9.1	14.0	16.8	825,845.3	0.00 #	24.00 #
Minimum:	0	1.6	6.8	11.9	7.5	632,853.7	0.00	1.00
Maximum:	3	2.5	12.3	14.9	32.0	982,360.6	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOx, Ppm	Unit CT1 NOx, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/04/2022 00:00	1	1.9	8.2	14.0	16.5	982,214.7	0.00	1.00
08/04/2022 01:00	1	1.9	8.1	14.0	16.5	979,039.2	0.00	1.00
08/04/2022 02:00	1	1.8	7.8	14.1	15.2	942,284.8	0.00	1.00
08/04/2022 03:00	0	1.6	8.4	14.6	12.0	634,282.6	0.00	1.00
08/04/2022 04:00	0	1.7	7.5	14.5	10.9	803,039.0	0.00	1.00
08/04/2022 05:00	1	1.9	8.3	14.0	17.0	977,848.4	0.00	1.00
08/04/2022 06:00	1	1.8	7.4	14.2	13.9	929,164.7	0.00	1.00
08/04/2022 07:00	1	1.7	7.1	14.5	11.9	816,091.3	0.00	1.00
08/04/2022 08:00	0	1.7	7.6	14.4	10.9	816,598.3	0.00	1.00
08/04/2022 09:00	1	1.9	8.3	14.0	17.2	985,390.2	0.00	1.00
08/04/2022 10:00	1	1.9	8.3	13.9	16.6	975,617.1	0.00	1.00
08/04/2022 11:00	1	1.9	8.4	13.8	16.5	975,570.2	0.00	1.00
08/04/2022 12:00	1	2.0	8.7	13.6	18.0	981,108.2	0.00	1.00
08/04/2022 13:00	1	2.0	11.2	12.7	24.7	935,049.6	0.00	1.00
08/04/2022 14:00	3	2.6	12.5	11.9	32.2	984,159.7	0.00	1.00
08/04/2022 15:00	3	2.4	12.3	12.0	32.2	975,984.1	0.00	1.00
08/04/2022 16:00	3	2.4	11.9	12.2	30.8	985,355.9	0.00	1.00
08/04/2022 17:00	3	2.3	11.5	12.3	27.8	972,928.3	0.00	1.00
08/04/2022 18:00	2	2.2	10.4	13.0	22.7	984,598.8	0.00	1.00
08/04/2022 19:00	1	2.0	9.3	13.4	19.8	979,412.3	0.00	1.00
08/04/2022 20:00	1	1.9	8.3	13.9	16.8	977,573.4	0.00	1.00
08/04/2022 21:00	1	1.9	8.1	14.0	16.7	978,642.3	0.00	1.00
08/04/2022 22:00	1	1.9	8.0	14.1	17.0	986,992.5	0.00	1.00
08/04/2022 23:00	1	1.7	7.3	14.5	12.9	809,458.2	0.00	1.00
Average/Sum#:	1	2.0	9.0	13.7	18.6	932,016.8	0.00 #	24.00 #
Minimum:	0	1.6	7.1	11.9	10.9	634,282.6	0.00	1.00
Maximum:	3	2.6	12.5	14.6	32.2	986,992.5	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:	> 10							
	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1
	NH3Slip, Ppmvdc	NOx, Ppm	NOx, _SCR, Ppm	O2, Dry, Pct	NH3Inj, LbPerHr	ExhaustFlow, LbPerHr	SUSD, Hr	OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/05/2022 00:00	1	1.6	8.6	14.6	13.2	677,104.3	0.00	1.00
08/05/2022 01:00	1	1.7	9.2	14.7	14.4	645,617.3	0.00	1.00
08/05/2022 02:00	1	1.7	9.0	14.6	12.3	696,015.4	0.00	1.00
08/05/2022 03:00	2	1.6	9.4	14.7	16.1	637,003.2	0.00	1.00
08/05/2022 04:00	1	1.6	8.1	14.6	12.9	742,749.7	0.00	1.00
08/05/2022 05:00	1	1.7	7.8	14.2	19.0	992,321.7	0.00	1.00
08/05/2022 06:00	1	1.7	8.1	14.1	19.2	993,839.6	0.00	1.00
08/05/2022 07:00	1	1.7	7.8	14.2	18.3	993,752.4	0.00	1.00
08/05/2022 08:00	1	1.7	7.8	14.2	18.4	996,000.7	0.00	1.00
08/05/2022 09:00	1	1.7	7.8	14.1	18.2	984,374.5	0.00	1.00
08/05/2022 10:00	1	1.7	7.9	14.1	17.8	988,402.2	0.00	1.00
08/05/2022 11:00	1	1.8	8.0	14.0	17.1	985,191.7	0.00	1.00
08/05/2022 12:00	1	1.8	8.0	14.0	17.3	989,756.4	0.00	1.00
08/05/2022 13:00	1	1.8	8.0	14.0	17.1	987,970.2	0.00	1.00
08/05/2022 14:00	1	1.8	8.0	13.9	16.5	980,312.2	0.00	1.00
08/05/2022 15:00	1	1.8	8.1	13.9	17.0	980,703.5	0.00	1.00
08/05/2022 16:00	1	1.8	8.2	13.9	17.1	980,116.6	0.00	1.00
08/05/2022 17:00	1	1.8	8.1	13.9	17.0	984,029.2	0.00	1.00
08/05/2022 18:00	1	1.8	8.0	13.9	16.9	982,072.9	0.00	1.00
08/05/2022 19:00	1	1.8	8.0	13.9	17.1	977,182.1	0.00	1.00
08/05/2022 20:00	1	1.8	8.0	14.0	17.5	984,794.8	0.00	1.00
08/05/2022 21:00	1	1.8	7.9	14.0	17.6	980,230.0	0.00	1.00
08/05/2022 22:00	1	1.7	7.5	14.3	15.6	882,863.8	0.00	1.00
08/05/2022 23:00	2	1.6	9.7	14.7	17.7	629,714.3	0.00	1.00
Average/Sum#:	1	1.7	8.2	14.2	16.7	903,004.9	0.00 #	24.00 #
Minimum:	1	1.6	7.5	13.9	12.3	629,714.3	0.00	1.00
Maximum:	2	1.8	9.7	14.7	19.2	996,000.7	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOx, Ppm	Unit CT1 NOx, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/06/2022 00:00	2	1.6	9.7	14.7	16.7	629,935.2	0.00	1.00
08/06/2022 01:00	2	1.6	10.5	14.7	19.2	623,088.1	0.00	1.00
08/06/2022 02:00	2	1.6	12.6	14.8	22.8	619,608.4	0.00	1.00
08/06/2022 03:00	3	1.6	12.5	14.8	23.7	618,934.9	0.00	1.00
08/06/2022 04:00	3	1.6	12.5	14.8	23.4	620,281.9	0.00	1.00
08/06/2022 05:00	2	1.6	11.0	14.7	19.6	623,750.7	0.00	1.00
08/06/2022 06:00	2	1.5	11.7	14.8	21.3	627,016.8	0.00	1.00
08/06/2022 07:00	2	1.6	12.2	14.8	21.5	622,077.9	0.00	1.00
08/06/2022 08:00	2	1.6	11.6	14.8	20.1	620,057.4	0.00	1.00
08/06/2022 09:00	2	1.6	11.2	14.8	19.4	619,832.9	0.00	1.00
08/06/2022 10:00	2	1.5	10.9	14.9	18.4	631,076.4	0.00	1.00
08/06/2022 11:00	2	1.5	10.6	14.9	17.7	633,358.8	0.00	1.00
08/06/2022 12:00	1	1.5	10.1	14.9	16.3	634,043.5	0.00	1.00
08/06/2022 13:00	1	1.5	9.8	14.9	15.5	634,271.7	0.00	1.00
08/06/2022 14:00	1	1.5	8.9	14.9	13.0	641,803.6	0.00	1.00
08/06/2022 15:00	1	1.5	9.1	14.9	14.4	635,412.9	0.00	1.00
08/06/2022 16:00	1	1.5	8.5	14.9	11.8	645,683.6	0.00	1.00
08/06/2022 17:00	0	1.6	7.9	14.8	9.6	660,466.6	0.00	1.00
08/06/2022 18:00	0	1.8	6.2	14.7	8.6	898,740.0	0.00	1.00
08/06/2022 19:00	1	1.8	6.9	14.4	12.2	884,016.1	0.00	1.00
08/06/2022 20:00	1	2.0	8.6	14.0	17.6	973,482.1	0.00	1.00
08/06/2022 21:00	1	1.9	7.8	14.3	14.9	877,054.1	0.00	1.00
08/06/2022 22:00	2	1.8	9.8	14.7	17.2	627,947.3	0.00	1.00
08/06/2022 23:00	2	1.7	9.5	14.7	15.3	632,144.0	0.00	1.00
Average/Sum#:	2	1.6	10.0	14.7	17.1	676,420.2	0.00 #	24.00 #
Minimum:	0	1.5	6.2	14.0	8.6	618,934.9	0.00	1.00
Maximum:	3	2.0	12.6	14.9	23.7	973,482.1	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:	> 10							
	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1
	NH3Slip, Ppmvdc	NOx, Ppm	NOx, _SCR, Ppm	O2, Dry, Pct	NH3Inj, LbPerHr	ExhaustFlow, LbPerHr	SUSD, Hr	OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/07/2022 00:00	2	1.7	11.0	14.8	19.0	629,710.7	0.00	1.00
08/07/2022 01:00	1	1.8	9.3	14.7	14.0	637,445.0	0.00	1.00
08/07/2022 02:00	3	1.9	12.0	14.8	19.7	632,404.7	0.00	1.00
08/07/2022 03:00	3	1.8	12.6	14.8	22.9	618,934.9	0.00	1.00
08/07/2022 04:00	2	1.8	10.6	14.7	16.9	630,818.7	0.00	1.00
08/07/2022 05:00	2	1.8	10.6	14.7	19.8	629,935.2	0.00	1.00
08/07/2022 06:00	2	1.8	11.7	14.8	20.3	630,159.7	0.00	1.00
08/07/2022 07:00	2	1.8	12.2	14.8	20.8	623,200.3	0.00	1.00
08/07/2022 08:00	2	1.8	11.8	14.8	19.5	620,730.9	0.00	1.00
08/07/2022 09:00	2	1.8	11.5	14.8	19.2	619,383.9	0.00	1.00
08/07/2022 10:00	2	1.7	11.4	14.9	19.2	629,478.7	0.00	1.00
08/07/2022 11:00	2	1.7	11.1	14.9	18.0	631,989.4	0.00	1.00
08/07/2022 12:00	1	1.7	10.2	14.9	15.7	633,130.5	0.00	1.00
08/07/2022 13:00	1	1.7	9.6	14.9	14.5	636,554.1	0.00	1.00
08/07/2022 14:00	1	1.7	8.6	14.9	10.8	647,509.5	0.00	1.00
08/07/2022 15:00	1	1.7	8.8	14.9	12.7	640,205.9	0.00	1.00
08/07/2022 16:00	0	1.7	6.8	14.7	7.5	716,076.4	0.00	1.00
08/07/2022 17:00	1	1.9	7.5	14.2	13.7	931,208.6	0.00	1.00
08/07/2022 18:00	1	2.0	8.3	14.0	16.1	986,382.5	0.00	1.00
08/07/2022 19:00	1	2.0	8.1	14.0	16.6	978,840.7	0.00	1.00
08/07/2022 20:00	1	2.0	8.0	14.1	16.8	984,374.5	0.00	1.00
08/07/2022 21:00	1	2.0	7.9	14.1	17.0	982,159.2	0.00	1.00
08/07/2022 22:00	1	1.8	8.1	14.4	14.9	792,580.7	0.00	1.00
08/07/2022 23:00	2	1.8	9.3	14.7	15.4	637,003.2	0.00	1.00
Average/Sum#:	2	1.8	9.9	14.6	16.7	712,509.1	0.00 #	24.00 #
Minimum:	0	1.7	6.8	14.0	7.5	618,934.9	0.00	1.00
Maximum:	3	2.0	12.6	14.9	22.9	986,382.5	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOx, Ppm	Unit CT1 NOx, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/08/2022 00:00	2	1.8	9.4	14.7	16.2	643,187.7	0.00	1.00
08/08/2022 01:00	1	1.8	9.7	14.7	15.6	637,003.2	0.00	1.00
08/08/2022 02:00	2	1.7	10.1	14.7	16.6	635,898.8	0.00	1.00
08/08/2022 03:00	2	1.8	9.9	14.7	17.0	636,119.7	0.00	1.00
08/08/2022 04:00	1	1.8	7.8	14.5	13.7	860,597.6	0.00	1.00
08/08/2022 05:00	1	1.9	7.9	14.2	18.8	995,183.2	0.00	1.00
08/08/2022 06:00	1	1.7	8.4	14.4	16.8	791,948.7	0.00	1.00
08/08/2022 07:00	2	1.7	10.9	14.7	20.2	623,971.6	0.00	1.00
08/08/2022 08:00	2	1.6	10.8	14.8	18.1	627,465.8	0.00	1.00
08/08/2022 09:00	1	1.6	9.8	14.8	15.1	636,445.6	0.00	1.00
08/08/2022 10:00	1	1.6	8.6	14.8	11.3	646,772.4	0.00	1.00
08/08/2022 11:00	1	1.7	7.2	14.4	10.9	841,037.3	0.00	1.00
08/08/2022 12:00	1	1.9	8.3	13.9	16.8	989,115.7	0.00	1.00
08/08/2022 13:00	1	1.6	7.6	14.6	11.8	734,489.7	0.00	1.00
08/08/2022 14:00	1	1.7	6.5	14.6	10.1	840,131.0	0.00	1.00
08/08/2022 15:00	1	1.9	8.3	13.9	17.5	979,334.1	0.00	1.00
08/08/2022 16:00	1	1.9	8.5	13.9	17.9	985,594.3	0.00	1.00
08/08/2022 17:00	2	2.0	9.7	13.4	21.8	989,819.9	0.00	1.00
08/08/2022 18:00	2	2.1	10.1	13.2	22.7	993,099.4	0.00	1.00
08/08/2022 19:00	2	2.2	10.7	12.9	25.5	1,000,022.2	0.00	1.00
08/08/2022 20:00	2	2.1	10.4	13.0	25.0	991,879.3	0.00	1.00
08/08/2022 21:00	1	1.9	8.4	13.9	18.5	996,158.4	0.00	1.00
08/08/2022 22:00	1	1.9	8.1	14.0	17.8	983,603.9	0.00	1.00
08/08/2022 23:00	1	1.8	7.8	14.1	17.7	980,749.5	0.00	1.00
Average/Sum#:	1	1.8	9.0	14.2	17.2	834,984.5	0.00 #	24.00 #
Minimum:	1	1.6	6.5	12.9	10.1	623,971.6	0.00	1.00
Maximum:	2	2.2	10.9	14.8	25.5	1,000,022.2	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOx, Ppm	Unit CT1 NOx, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/09/2022 00:00	1	1.8	7.8	14.1	18.2	981,555.1	0.00	1.00
08/09/2022 01:00	1	1.8	7.7	14.2	18.2	994,570.0	0.00	1.00
08/09/2022 02:00	1	1.8	8.1	14.2	18.3	995,592.0	0.00	1.00
08/09/2022 03:00	1	1.8	7.9	14.1	18.7	980,950.9	0.00	1.00
08/09/2022 04:00	1	1.8	7.8	14.2	18.5	994,161.2	0.00	1.00
08/09/2022 05:00	1	1.8	7.7	14.2	18.6	993,956.8	0.00	1.00
08/09/2022 06:00	1	1.8	7.6	14.2	18.1	994,365.6	0.00	1.00
08/09/2022 07:00	1	1.8	7.6	14.2	18.0	994,978.8	0.00	1.00
08/09/2022 08:00	1	1.8	7.7	14.1	17.6	984,374.5	0.00	1.00
08/09/2022 09:00	1	1.8	7.8	14.1	17.3	988,805.0	0.00	1.00
08/09/2022 10:00	1	1.9	7.8	14.1	17.3	992,832.7	0.00	1.00
08/09/2022 11:00	1	1.9	7.9	14.0	17.2	985,191.7	0.00	1.00
08/09/2022 12:00	1	1.8	7.5	14.1	15.2	959,402.6	0.00	1.00
08/09/2022 13:00	1	1.6	7.9	14.7	10.5	659,090.7	0.00	1.00
08/09/2022 14:00	1	1.8	7.1	14.5	11.4	844,335.7	0.00	1.00
08/09/2022 15:00	1	1.9	8.2	14.0	18.0	991,344.2	0.00	1.00
08/09/2022 16:00	1	1.9	8.2	14.0	17.8	987,374.8	0.00	1.00
08/09/2022 17:00	1	1.9	8.1	14.0	17.1	991,344.2	0.00	1.00
08/09/2022 18:00	2	2.3	10.2	13.2	23.6	1,008,750.0	0.00	1.00
08/09/2022 19:00	1	2.1	9.0	13.6	20.1	991,238.1	0.00	1.00
08/09/2022 20:00	2	2.3	10.3	13.1	23.0	998,977.5	0.00	1.00
08/09/2022 21:00	2	2.1	9.1	13.5	21.1	992,647.6	0.00	1.00
08/09/2022 22:00	1	2.0	8.5	13.8	19.6	999,872.7	0.00	1.00
08/09/2022 23:00	1	1.9	7.6	14.1	17.0	962,826.2	0.00	1.00
Average/Sum#:	1	1.9	8.1	14.0	17.9	969,522.4	0.00 #	24.00 #
Minimum:	1	1.6	7.1	13.1	10.5	659,090.7	0.00	1.00
Maximum:	2	2.3	10.3	14.7	23.6	1,008,750.0	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:	> 10							
	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1
	NH3Slip, Ppmvdc	NOx, Ppm	NOx, _SCR, Ppm	O2, Dry, Pct	NH3Inj, LbPerHr	ExhaustFlow, LbPerHr	SUSD, Hr	OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/10/2022 00:00	1	1.8	6.3	14.5	13.1	918,584.2	0.00	1.00
08/10/2022 01:00	1	1.9	6.4	14.5	14.1	943,191.0	0.00	1.00
08/10/2022 02:00	1	1.9	7.2	14.5	15.5	950,466.1	0.00	1.00
08/10/2022 03:00	1	1.9	7.4	14.4	18.1	981,561.3	0.00	1.00
08/10/2022 04:00	2	2.1	9.5	13.6	22.5	1,009,434.6	0.00	1.00
08/10/2022 05:00	1	2.0	8.6	13.8	20.5	993,700.6	0.00	1.00
08/10/2022 06:00	2	1.8	8.8	14.5	18.7	806,462.6	0.00	1.00
08/10/2022 07:00	2	1.7	10.1	14.7	16.1	630,818.7	0.00	1.00
08/10/2022 08:00	1	1.7	9.3	14.7	13.7	633,469.2	0.00	1.00
08/10/2022 09:00	1	1.7	9.5	14.8	14.3	639,364.0	0.00	1.00
08/10/2022 10:00	1	1.8	8.6	14.8	13.3	649,915.3	0.00	1.00
08/10/2022 11:00	1	1.7	7.8	14.7	11.8	692,221.9	0.00	1.00
08/10/2022 12:00	1	1.7	8.8	14.8	13.5	649,241.9	0.00	1.00
08/10/2022 13:00	1	1.7	7.5	14.7	10.0	703,044.8	0.00	1.00
08/10/2022 14:00	1	2.0	7.9	14.0	15.6	927,636.2	0.00	1.00
08/10/2022 15:00	1	2.1	9.6	13.5	20.3	993,387.9	0.00	1.00
08/10/2022 16:00	1	2.0	8.3	14.1	17.7	999,679.8	0.00	1.00
08/10/2022 17:00	1	2.0	8.7	13.9	18.5	999,484.2	0.00	1.00
08/10/2022 18:00	2	2.3	11.0	13.0	25.1	1,009,560.5	0.00	1.00
08/10/2022 19:00	2	2.3	10.5	13.1	23.6	1,000,733.2	0.00	1.00
08/10/2022 20:00	1	2.1	9.3	13.5	20.5	1,000,235.0	0.00	1.00
08/10/2022 21:00	1	2.1	8.8	13.7	19.1	984,273.8	0.00	1.00
08/10/2022 22:00	1	1.9	7.4	14.3	14.7	926,851.3	0.00	1.00
08/10/2022 23:00	1	1.8	6.2	14.5	12.6	919,440.1	0.00	1.00
Average/Sum#:	1	1.9	8.5	14.2	16.8	873,448.3	0.00 #	24.00 #
Minimum:	1	1.7	6.2	13.0	10.0	630,818.7	0.00	1.00
Maximum:	2	2.3	11.0	14.8	25.1	1,009,560.5	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOx, Ppm	Unit CT1 NOx, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/11/2022 00:00	1	1.9	6.3	14.5	13.6	925,431.3	0.00	1.00
08/11/2022 01:00	1	1.9	6.3	14.5	13.7	916,230.5	0.00	1.00
08/11/2022 02:00	1	1.9	6.8	14.4	12.6	854,099.5	0.00	1.00
08/11/2022 03:00	1	1.9	6.5	14.4	11.3	884,858.8	0.00	1.00
08/11/2022 04:00	1	1.9	6.5	14.5	14.5	921,365.8	0.00	1.00
08/11/2022 05:00	1	1.8	6.5	14.5	15.1	941,907.2	0.00	1.00
08/11/2022 06:00	1	1.7	7.7	14.5	14.5	778,218.2	0.00	1.00
08/11/2022 07:00	1	1.6	8.0	14.5	12.5	695,624.8	0.00	1.00
08/11/2022 08:00	1	1.7	9.0	14.7	14.0	636,782.3	0.00	1.00
08/11/2022 09:00	1	1.7	8.6	14.8	13.4	646,547.9	0.00	1.00
08/11/2022 10:00	1	1.7	8.3	14.8	13.1	647,221.4	0.00	1.00
08/11/2022 11:00	0	1.7	6.6	14.6	9.7	852,521.0	0.00	1.00
08/11/2022 12:00	1	1.7	6.5	14.4	11.7	882,541.3	0.00	1.00
08/11/2022 13:00	2	2.1	10.2	13.2	23.3	1,005,726.6	0.00	1.00
08/11/2022 14:00	1	2.0	9.0	13.6	20.3	996,865.9	0.00	1.00
08/11/2022 15:00	2	2.1	10.3	13.2	23.9	997,901.3	0.00	1.00
08/11/2022 16:00	2	2.1	10.2	13.2	24.0	994,166.5	0.00	1.00
08/11/2022 17:00	2	2.2	10.5	13.1	23.7	1,000,557.6	0.00	1.00
08/11/2022 18:00	2	2.3	11.3	12.8	25.5	996,974.8	0.00	1.00
08/11/2022 19:00	2	2.2	10.4	13.1	23.2	996,695.2	0.00	1.00
08/11/2022 20:00	2	2.4	11.4	12.7	26.4	1,000,180.8	0.00	1.00
08/11/2022 21:00	1	1.9	7.8	14.1	16.4	969,673.3	0.00	1.00
08/11/2022 22:00	1	1.8	6.7	14.5	12.6	922,435.7	0.00	1.00
08/11/2022 23:00	1	1.8	6.3	14.5	13.0	925,645.3	0.00	1.00
Average/Sum#:	1	1.9	8.2	14.0	16.8	891,257.2	0.00 #	24.00 #
Minimum:	0	1.6	6.3	12.7	9.7	636,782.3	0.00	1.00
Maximum:	2	2.4	11.4	14.8	26.4	1,005,726.6	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOx, Ppm	Unit CT1 NOx, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/12/2022 00:00	1	1.8	6.8	14.5	15.6	974,859.0	0.00	1.00
08/12/2022 01:00	1	1.9	6.6	14.5	14.9	958,169.1	0.00	1.00
08/12/2022 02:00	1	1.8	6.9	14.4	14.0	872,218.0	0.00	1.00
08/12/2022 03:00	1	1.9	6.6	14.5	14.0	922,649.7	0.00	1.00
08/12/2022 04:00	1	1.8	6.8	14.5	16.4	960,736.8	0.00	1.00
08/12/2022 05:00	1	1.8	6.7	14.5	15.9	957,527.2	0.00	1.00
08/12/2022 06:00	1	1.8	8.2	14.5	13.8	720,445.6	0.00	1.00
08/12/2022 07:00	2	1.7	8.9	14.6	15.4	714,057.0	0.00	1.00
08/12/2022 08:00	1	1.7	10.6	14.8	16.1	633,527.1	0.00	1.00
08/12/2022 09:00	2	1.7	9.9	14.8	17.3	634,200.6	0.00	1.00
08/12/2022 10:00	1	1.6	8.7	14.8	11.4	645,200.9	0.00	1.00
08/12/2022 11:00	1	1.7	8.8	14.8	13.6	641,609.0	0.00	1.00
08/12/2022 12:00	0	1.6	7.0	14.6	9.2	743,836.5	0.00	1.00
08/12/2022 13:00	1	1.8	8.1	14.0	17.9	984,199.4	0.00	1.00
08/12/2022 14:00	1	1.8	8.5	13.9	19.4	998,506.0	0.00	1.00
08/12/2022 15:00	1	1.8	8.4	13.9	19.4	992,245.8	0.00	1.00
08/12/2022 16:00	1	1.8	8.5	13.9	19.7	988,920.0	0.00	1.00
08/12/2022 17:00	2	2.0	10.6	13.1	25.9	998,450.8	0.00	1.00
08/12/2022 18:00	2	2.3	11.7	12.7	27.3	1,000,180.8	0.00	1.00
08/12/2022 19:00	2	2.1	9.8	13.3	22.1	991,211.0	0.00	1.00
08/12/2022 20:00	1	2.1	8.9	13.6	20.3	997,803.9	0.00	1.00
08/12/2022 21:00	1	1.9	7.9	14.0	17.2	955,024.7	0.00	1.00
08/12/2022 22:00	1	1.8	6.6	14.4	10.3	795,530.2	0.00	1.00
08/12/2022 23:00	1	1.8	6.3	14.5	13.3	909,597.4	0.00	1.00
Average/Sum#:	1	1.8	8.2	14.2	16.7	874,612.8	0.00 #	24.00 #
Minimum:	0	1.6	6.3	12.7	9.2	633,527.1	0.00	1.00
Maximum:	2	2.3	11.7	14.8	27.3	1,000,180.8	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOx, Ppm	Unit CT1 NOx, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/13/2022 00:00	1	1.8	6.4	14.5	13.2	891,195.7	0.00	1.00
08/13/2022 01:00	1	1.8	6.3	14.5	13.7	899,112.7	0.00	1.00
08/13/2022 02:00	1	1.9	6.8	14.4	12.7	887,387.0	0.00	1.00
08/13/2022 03:00	1	1.8	6.7	14.4	15.4	903,188.1	0.00	1.00
08/13/2022 04:00	1	1.7	6.5	14.5	15.5	944,902.8	0.00	1.00
08/13/2022 05:00	1	1.7	6.6	14.5	15.5	936,557.9	0.00	1.00
08/13/2022 06:00	2	1.7	9.1	14.5	19.1	736,707.5	0.00	1.00
08/13/2022 07:00	2	1.6	10.9	14.7	18.3	624,634.2	0.00	1.00
08/13/2022 08:00	2	1.6	10.5	14.8	17.4	632,853.7	0.00	1.00
08/13/2022 09:00	1	1.6	8.9	14.8	13.8	645,200.9	0.00	1.00
08/13/2022 10:00	1	1.5	9.0	14.8	13.0	640,711.0	0.00	1.00
08/13/2022 11:00	1	1.6	8.6	14.8	12.6	648,343.9	0.00	1.00
08/13/2022 12:00	0	1.6	7.0	14.7	9.2	738,163.9	0.00	1.00
08/13/2022 13:00	1	1.7	7.3	14.4	12.6	840,194.5	0.00	1.00
08/13/2022 14:00	1	1.9	8.4	14.0	18.3	992,336.5	0.00	1.00
08/13/2022 15:00	1	1.9	8.5	14.0	18.5	994,916.6	0.00	1.00
08/13/2022 16:00	1	1.9	8.6	13.9	18.9	986,768.1	0.00	1.00
08/13/2022 17:00	2	2.1	10.0	13.3	23.2	992,111.9	0.00	1.00
08/13/2022 18:00	1	2.0	9.3	13.6	20.8	996,865.9	0.00	1.00
08/13/2022 19:00	1	1.9	8.3	14.0	17.8	987,176.4	0.00	1.00
08/13/2022 20:00	1	1.8	7.5	14.2	14.4	914,244.1	0.00	1.00
08/13/2022 21:00	1	1.7	8.4	14.7	13.7	674,772.8	0.00	1.00
08/13/2022 22:00	1	1.7	7.5	14.5	11.2	725,153.0	0.00	1.00
08/13/2022 23:00	1	1.7	6.3	14.5	10.1	869,156.5	0.00	1.00
Average/Sum#:	1	1.8	8.1	14.4	15.4	837,610.7	0.00 #	24.00 #
Minimum:	0	1.5	6.3	13.3	9.2	624,634.2	0.00	1.00
Maximum:	2	2.1	10.9	14.8	23.2	996,865.9	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOx, Ppm	Unit CT1 NOx, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/14/2022 00:00	1	1.7	7.4	14.4	12.9	748,759.1	0.00	1.00
08/14/2022 01:00	1	1.7	6.7	14.4	10.1	783,521.4	0.00	1.00
08/14/2022 02:00	1	1.8	7.1	14.4	11.0	804,168.1	0.00	1.00
08/14/2022 03:00	2	1.9	7.0	14.4	11.1	801,850.6	0.00	1.00
08/14/2022 04:00	1	1.7	6.9	14.3	12.6	757,748.2	0.00	1.00
08/14/2022 05:00	1	1.7	8.0	14.5	13.9	726,222.9	0.00	1.00
08/14/2022 06:00	1	1.8	7.4	14.3	17.0	971,668.8	0.00	1.00
08/14/2022 07:00	1	1.8	7.5	14.3	16.8	974,781.2	0.00	1.00
08/14/2022 08:00	1	1.7	9.1	14.7	14.8	652,685.3	0.00	1.00
08/14/2022 09:00	1	1.7	8.7	14.8	13.8	644,302.9	0.00	1.00
08/14/2022 10:00	1	1.8	7.5	14.5	12.1	806,462.6	0.00	1.00
08/14/2022 11:00	1	2.0	8.6	13.9	18.2	995,962.8	0.00	1.00
08/14/2022 12:00	1	2.1	9.5	13.4	20.7	992,924.0	0.00	1.00
08/14/2022 13:00	1	1.9	8.2	13.8	17.5	981,935.1	0.00	1.00
08/14/2022 14:00	1	1.6	7.7	14.7	12.8	739,930.9	0.00	1.00
08/14/2022 15:00	0	1.7	6.8	14.7	9.1	764,889.8	0.00	1.00
08/14/2022 16:00	1	1.7	7.2	14.6	11.3	744,706.0	0.00	1.00
08/14/2022 17:00	1	1.8	6.8	14.5	14.1	939,981.5	0.00	1.00
08/14/2022 18:00	1	2.0	8.7	13.9	18.5	982,464.2	0.00	1.00
08/14/2022 19:00	1	2.0	8.6	13.9	17.9	978,747.2	0.00	1.00
08/14/2022 20:00	1	1.9	7.7	14.2	14.6	875,205.3	0.00	1.00
08/14/2022 21:00	1	1.7	8.2	14.7	12.2	652,022.7	0.00	1.00
08/14/2022 22:00	1	1.6	8.9	14.8	12.3	639,139.5	0.00	1.00
08/14/2022 23:00	1	1.7	8.4	14.8	11.5	647,221.4	0.00	1.00
Average/Sum#:	1	1.8	7.9	14.4	14.0	816,970.9	0.00 #	24.00 #
Minimum:	0	1.6	6.7	13.4	9.1	639,139.5	0.00	1.00
Maximum:	2	2.1	9.5	14.8	20.7	995,962.8	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:	> 10							
	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1
	NH3Slip, Ppmvdc	NOx, Ppm	NOx, _SCR, Ppm	O2, Dry, Pct	NH3Inj, LbPerHr	ExhaustFlow, LbPerHr	SUSD, Hr	OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/15/2022 00:00	1	1.7	8.8	14.7	13.8	633,248.3	0.00	1.00
08/15/2022 01:00	1	1.7	9.1	14.8	14.4	641,609.0	0.00	1.00
08/15/2022 02:00	1	1.7	9.8	14.8	15.4	640,486.5	0.00	1.00
08/15/2022 03:00	1	1.8	8.9	14.6	13.7	658,410.5	0.00	1.00
08/15/2022 04:00	1	1.7	7.7	14.6	10.4	739,054.4	0.00	1.00
08/15/2022 05:00	1	1.8	6.7	14.4	12.0	811,120.6	0.00	1.00
08/15/2022 06:00	2	1.7	10.2	14.6	19.4	675,365.3	0.00	1.00
08/15/2022 07:00	2	1.7	10.9	14.8	18.1	629,486.2	0.00	1.00
08/15/2022 08:00	2	1.7	11.4	14.9	19.4	628,794.0	0.00	1.00
08/15/2022 09:00	1	1.6	9.7	14.9	12.7	644,998.9	0.00	1.00
08/15/2022 10:00	1	1.7	8.2	14.7	11.4	674,551.9	0.00	1.00
08/15/2022 11:00	0	1.7	8.0	14.9	8.6	659,149.6	0.00	1.00
08/15/2022 12:00	0	1.6	7.2	14.8	8.2	702,222.9	0.00	1.00
08/15/2022 13:00	1	1.9	8.0	14.0	16.1	945,101.3	0.00	1.00
08/15/2022 14:00	2	2.3	11.7	12.7	27.9	995,671.7	0.00	1.00
08/15/2022 15:00	2	2.3	12.3	12.6	29.3	992,255.2	0.00	1.00
08/15/2022 16:00	3	2.4	12.3	12.5	30.7	992,017.5	0.00	1.00
08/15/2022 17:00	3	2.4	12.0	12.5	30.4	993,647.8	0.00	1.00
08/15/2022 18:00	2	2.3	12.2	12.5	29.4	984,518.3	0.00	1.00
08/15/2022 19:00	2	2.2	10.8	13.0	24.0	982,518.7	0.00	1.00
08/15/2022 20:00	1	1.9	8.2	13.9	16.4	952,728.1	0.00	1.00
08/15/2022 21:00	0	1.8	6.5	14.5	8.8	827,645.9	0.00	1.00
08/15/2022 22:00	1	1.7	7.6	14.6	11.1	713,404.9	0.00	1.00
08/15/2022 23:00	0	1.8	6.2	14.4	6.2	790,263.2	0.00	1.00
Average/Sum#:	1	1.9	9.4	14.1	17.0	787,844.6	0.00 #	24.00 #
Minimum:	0	1.6	6.2	12.5	6.2	628,794.0	0.00	1.00
Maximum:	3	2.4	12.3	14.9	30.7	995,671.7	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOx, Ppm	Unit CT1 NOx, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/16/2022 00:00	0	1.8	6.4	14.4	8.2	799,111.8	0.00	1.00
08/16/2022 01:00	1	1.8	6.9	14.4	9.7	749,391.2	0.00	1.00
08/16/2022 02:00	0	1.6	7.4	14.4	10.1	727,901.7	0.00	1.00
08/16/2022 03:00	1	1.7	7.4	14.4	11.0	707,465.7	0.00	1.00
08/16/2022 04:00	1	1.7	7.3	14.4	12.0	760,978.6	0.00	1.00
08/16/2022 05:00	1	1.8	6.7	14.5	14.2	883,920.6	0.00	1.00
08/16/2022 06:00	2	1.7	9.0	14.5	17.2	701,616.0	0.00	1.00
08/16/2022 07:00	2	1.6	11.1	14.8	19.7	627,016.8	0.00	1.00
08/16/2022 08:00	1	1.6	9.8	14.9	13.4	644,314.2	0.00	1.00
08/16/2022 09:00	0	1.7	7.5	14.7	9.6	692,442.8	0.00	1.00
08/16/2022 10:00	0	1.7	6.8	14.5	8.4	754,467.2	0.00	1.00
08/16/2022 11:00	1	1.7	7.0	14.6	11.9	840,131.0	0.00	1.00
08/16/2022 12:00	1	1.7	7.2	14.3	13.2	846,345.8	0.00	1.00
08/16/2022 13:00	3	2.4	12.1	12.3	31.4	991,081.1	0.00	1.00
08/16/2022 14:00	4	2.5	12.7	11.8	37.1	985,985.6	0.00	1.00
08/16/2022 15:00	4	2.5	12.6	11.8	38.4	991,403.1	0.00	1.00
08/16/2022 16:00	4	2.5	12.7	11.8	38.6	988,092.4	0.00	1.00
08/16/2022 17:00	4	2.5	12.7	11.8	38.1	988,092.4	0.00	1.00
08/16/2022 18:00	4	2.5	12.7	11.8	38.0	988,844.8	0.00	1.00
08/16/2022 19:00	3	2.3	12.6	12.2	33.4	987,244.8	0.00	1.00
08/16/2022 20:00	3	2.3	12.3	12.4	30.0	978,735.7	0.00	1.00
08/16/2022 21:00	2	2.1	10.4	13.1	23.9	981,947.5	0.00	1.00
08/16/2022 22:00	1	2.0	8.6	13.7	18.4	966,395.2	0.00	1.00
08/16/2022 23:00	0	1.7	6.3	14.5	10.1	930,352.7	0.00	1.00
Average/Sum#:	2	2.0	9.4	13.6	20.7	854,719.9	0.00 #	24.00 #
Minimum:	0	1.6	6.3	11.8	8.2	627,016.8	0.00	1.00
Maximum:	4	2.5	12.7	14.9	38.6	991,403.1	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOx, Ppm	Unit CT1 NOx, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/17/2022 00:00	1	1.7	6.6	14.5	12.1	943,619.0	0.00	1.00
08/17/2022 01:00	1	1.8	6.3	14.5	12.1	904,034.1	0.00	1.00
08/17/2022 02:00	1	1.8	6.7	14.5	11.6	921,579.8	0.00	1.00
08/17/2022 03:00	1	1.8	6.5	14.5	11.5	907,671.6	0.00	1.00
08/17/2022 04:00	1	1.8	6.6	14.5	13.5	913,662.8	0.00	1.00
08/17/2022 05:00	1	1.7	6.7	14.5	14.4	954,745.6	0.00	1.00
08/17/2022 06:00	1	1.7	6.7	14.5	14.3	955,387.5	0.00	1.00
08/17/2022 07:00	1	1.3	4.8	14.8	8.7	928,290.1	0.02	0.37
08/17/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/17/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/17/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/17/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/17/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/17/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/17/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/17/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/17/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/17/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/17/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/17/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/17/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/17/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/17/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/17/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	1	1.7	6.4	14.5	12.3	928,623.8	0.02 #	7.37 #
Minimum:	1	1.3	4.8	14.5	8.7	904,034.1	0.00	0.00
Maximum:	1	1.8	6.7	14.8	14.4	955,387.5	0.02	1.00
%SI	66.67	66.67	66.67	66.67	66.67	66.67	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOx, Ppm	Unit CT1 NOx, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/18/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/18/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/18/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/18/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/18/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/18/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/18/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/18/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/18/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/18/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/18/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/18/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/18/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/18/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/18/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/18/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/18/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/18/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/18/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/18/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/18/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/18/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/18/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/18/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOx, Ppm	Unit CT1 NOx, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/19/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/19/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/19/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/19/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/19/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/19/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/19/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/19/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/19/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/19/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/19/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/19/2022 11:00	0	10.0	13.6	15.4	4.0	705,129.1	0.97	0.97
08/19/2022 12:00	2	1.7	10.0	14.6	16.1	646,672.6	0.03	1.00
08/19/2022 13:00	1	1.6	9.7	14.9	15.5	632,217.6	0.00	1.00
08/19/2022 14:00	1	1.6	8.1	14.8	10.9	658,446.2	0.00	1.00
08/19/2022 15:00	1	1.6	8.2	14.7	12.2	659,311.6	0.00	1.00
08/19/2022 16:00	1	1.6	8.1	14.8	12.4	656,425.7	0.00	1.00
08/19/2022 17:00	0	1.7	6.2	14.5	8.6	864,449.1	0.00	1.00
08/19/2022 18:00	1	1.8	6.4	14.5	10.3	872,366.1	0.00	1.00
08/19/2022 19:00	1	1.7	6.9	14.5	11.2	806,248.6	0.00	1.00
08/19/2022 20:00	1	1.7	8.0	14.6	13.7	751,879.2	0.00	1.00
08/19/2022 21:00	1	1.7	8.0	14.6	11.6	679,930.1	0.00	1.00
08/19/2022 22:00	1	1.7	8.5	14.7	13.3	655,556.7	0.00	1.00
08/19/2022 23:00	1	1.8	8.6	14.6	13.6	653,411.1	0.00	1.00
Average/Sum#:	1	2.3	8.5	14.7	11.8	710,926.4	1.00 #	12.97 #
Minimum:	0	1.6	6.2	14.5	4.0	632,217.6	0.00	0.00
Maximum:	2	10.0	13.6	15.4	16.1	872,366.1	0.97	1.00
%SI	50.00	45.83	45.83	45.83	45.83	45.83	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOx, Ppm	Unit CT1 NOx, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/20/2022 00:00	1	1.8	8.6	14.6	13.9	654,715.3	0.00	1.00
08/20/2022 01:00	1	1.8	8.7	14.6	14.2	650,150.5	0.00	1.00
08/20/2022 02:00	1	1.8	9.2	14.6	14.0	646,237.9	0.00	1.00
08/20/2022 03:00	2	1.7	10.1	14.7	17.5	635,236.2	0.00	1.00
08/20/2022 04:00	2	1.7	10.5	14.7	18.2	630,597.8	0.00	1.00
08/20/2022 05:00	2	1.7	10.5	14.7	18.4	630,156.1	0.00	1.00
08/20/2022 06:00	2	1.7	10.4	14.7	17.3	630,597.8	0.00	1.00
08/20/2022 07:00	1	1.7	10.0	14.7	15.2	632,585.7	0.00	1.00
08/20/2022 08:00	1	1.7	9.5	14.8	14.1	643,854.0	0.00	1.00
08/20/2022 09:00	1	1.7	9.3	14.8	14.4	643,854.0	0.00	1.00
08/20/2022 10:00	1	1.7	8.8	14.8	13.3	643,854.0	0.00	1.00
08/20/2022 11:00	1	1.7	8.5	14.8	12.2	641,384.5	0.00	1.00
08/20/2022 12:00	1	1.7	8.3	14.9	12.0	648,878.9	0.00	1.00
08/20/2022 13:00	1	1.7	8.2	14.9	10.7	649,791.9	0.00	1.00
08/20/2022 14:00	1	1.7	7.5	14.8	10.1	742,407.6	0.00	1.00
08/20/2022 15:00	1	1.7	6.4	14.6	11.3	909,254.3	0.03	0.33
08/20/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/20/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/20/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/20/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/20/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/20/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/20/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/20/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	1	1.7	9.0	14.7	14.2	664,597.3	0.03 #	15.33 #
Minimum:	1	1.7	6.4	14.6	10.1	630,156.1	0.00	0.00
Maximum:	2	1.8	10.5	14.9	18.4	909,254.3	0.03	1.00
%SI	33.33	33.33	33.33	33.33	33.33	33.33	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOx, Ppm	Unit CT1 NOx, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/21/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/21/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/21/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/21/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/21/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/21/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/21/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/21/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/21/2022 08:00	0	11.3	16.0	15.7	2.7	676,548.3	0.78	0.78
08/21/2022 09:00	1	1.9	12.4	14.8	20.3	629,935.2	0.23	1.00
08/21/2022 10:00	1	1.8	10.0	14.6	11.1	672,974.3	0.00	1.00
08/21/2022 11:00	1	1.7	8.7	14.6	12.4	819,046.2	0.00	1.00
08/21/2022 12:00	0	1.8	7.8	14.6	14.1	992,071.9	0.00	1.00
08/21/2022 13:00	1	1.8	7.7	14.6	14.2	988,594.0	0.00	1.00
08/21/2022 14:00	1	1.8	7.6	14.6	14.2	988,376.6	0.00	1.00
08/21/2022 15:00	1	1.8	7.5	14.6	14.6	987,289.8	0.00	1.00
08/21/2022 16:00	1	1.8	7.5	14.6	14.8	984,681.3	0.00	1.00
08/21/2022 17:00	1	2.1	10.0	13.4	21.8	984,159.7	0.00	1.00
08/21/2022 18:00	1	2.0	9.7	13.4	20.1	979,229.7	0.00	1.00
08/21/2022 19:00	1	1.9	8.4	13.9	17.1	956,249.5	0.00	1.00
08/21/2022 20:00	1	1.7	7.2	14.5	15.3	977,854.6	0.00	1.00
08/21/2022 21:00	1	1.7	7.3	14.5	15.6	981,920.1	0.00	1.00
08/21/2022 22:00	1	1.7	7.3	14.5	16.1	986,199.5	0.00	1.00
08/21/2022 23:00	1	1.7	7.0	14.5	15.6	984,273.8	0.00	1.00
Average/Sum#:	1	2.4	8.9	14.5	15.0	911,837.8	1.01 #	15.78 #
Minimum:	0	1.7	7.0	13.4	2.7	629,935.2	0.00	0.00
Maximum:	1	11.3	16.0	15.7	21.8	992,071.9	0.78	1.00
%SI	37.50	33.33	33.33	33.33	33.33	33.33	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOx, Ppm	Unit CT1 NOx, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/22/2022 00:00	1	1.7	6.9	14.5	15.6	984,487.7	0.00	1.00
08/22/2022 01:00	1	1.7	6.8	14.6	15.6	999,462.4	0.00	1.00
08/22/2022 02:00	1	1.7	7.0	14.6	15.4	999,245.1	0.00	1.00
08/22/2022 03:00	1	1.7	6.8	14.6	16.1	999,462.4	0.00	1.00
08/22/2022 04:00	1	1.7	6.6	14.6	15.6	998,593.0	0.00	1.00
08/22/2022 05:00	1	1.7	6.5	14.6	15.1	992,289.3	0.02	0.53
08/22/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/22/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/22/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/22/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/22/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/22/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/22/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/22/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/22/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/22/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/22/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/22/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/22/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/22/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/22/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/22/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/22/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/22/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	1	1.7	6.8	14.6	15.6	995,590.0	0.02 #	5.53 #
Minimum:	1	1.7	6.5	14.5	15.1	984,487.7	0.00	0.00
Maximum:	1	1.7	7.0	14.6	16.1	999,462.4	0.02	1.00
%SI	75.00	75.00	75.00	75.00	75.00	75.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOx, Ppm	Unit CT1 NOx, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/23/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/23/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/23/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/23/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/23/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/23/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/23/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/23/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/23/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/23/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/23/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/23/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/23/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/23/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/23/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/23/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/23/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/23/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/23/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/23/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/23/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/23/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/23/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/23/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOx, Ppm	Unit CT1 NOx, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/24/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/24/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/24/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/24/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/24/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/24/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/24/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/24/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/24/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/24/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/24/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/24/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/24/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/24/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/24/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/24/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/24/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/24/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/24/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/24/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/24/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/24/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/24/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/24/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOx, Ppm	Unit CT1 NOx, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/25/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/25/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/25/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/25/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/25/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/25/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/25/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/25/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/25/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/25/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/25/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/25/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/25/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/25/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/25/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/25/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/25/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/25/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/25/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/25/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/25/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/25/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/25/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/25/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:	> 10							
	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1
	NH3Slip, Ppmvdc	NOx, Ppm	NOx, _SCR, Ppm	O2, Dry, Pct	NH3Inj, LbPerHr	ExhaustFlow, LbPerHr	SUSD, Hr	OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/26/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/26/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/26/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/26/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/26/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/26/2022 05:00	0	18.1	19.4	17.5	0.0	719,753.3	0.33	0.33
08/26/2022 06:00	4	3.5	9.0	14.5	15.5	890,125.8	0.67	1.00
08/26/2022 07:00	2	1.7	13.5	14.7	23.1	612,707.0	0.00	1.00
08/26/2022 08:00	2	1.8	11.8	14.8	19.1	632,853.7	0.00	1.00
08/26/2022 09:00	0	1.7	7.2	14.5	9.3	841,126.1	0.00	1.00
08/26/2022 10:00	1	1.7	7.9	14.6	12.3	790,570.9	0.00	1.00
08/26/2022 11:00	1	1.8	7.6	14.3	13.4	828,086.8	0.00	1.00
08/26/2022 12:00	1	2.1	9.2	13.6	19.8	982,796.5	0.00	1.00
08/26/2022 13:00	2	2.4	12.1	12.6	27.5	987,635.5	0.00	1.00
08/26/2022 14:00	3	2.5	12.7	12.4	29.8	992,429.9	0.00	1.00
08/26/2022 15:00	2	2.4	12.1	12.6	28.2	988,625.4	0.00	1.00
08/26/2022 16:00	3	2.5	12.5	12.4	30.8	986,307.8	0.00	1.00
08/26/2022 17:00	4	2.6	12.9	11.9	36.6	989,637.4	0.00	1.00
08/26/2022 18:00	3	2.4	12.4	12.3	32.1	987,100.2	0.00	1.00
08/26/2022 19:00	3	2.4	12.8	12.2	34.3	990,865.1	0.00	1.00
08/26/2022 20:00	2	2.2	11.9	12.6	28.7	975,261.1	0.00	1.00
08/26/2022 21:00	2	2.2	11.1	12.8	25.2	962,654.6	0.00	1.00
08/26/2022 22:00	1	1.9	8.1	13.9	17.1	933,751.8	0.00	1.00
08/26/2022 23:00	1	1.7	6.3	14.5	13.0	920,723.9	0.00	1.00
Average/Sum#:	2	3.0	11.1	13.6	21.9	895,421.7	1.00 #	18.33 #
Minimum:	0	1.7	6.3	11.9	0.0	612,707.0	0.00	0.00
Maximum:	4	18.1	19.4	17.5	36.6	992,429.9	0.67	1.00
%SI	25.00	20.83	20.83	20.83	20.83	20.83	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:	> 10							
	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1
	NH3Slip, Ppmvdc	NOx, Ppm	NOx, _SCR, Ppm	O2, Dry, Pct	NH3Inj, LbPerHr	ExhaustFlow, LbPerHr	SUSD, Hr	OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/27/2022 00:00	1	1.7	6.4	14.5	14.0	922,435.7	0.00	1.00
08/27/2022 01:00	1	1.7	6.5	14.5	14.1	917,942.3	0.00	1.00
08/27/2022 02:00	1	1.8	6.8	14.5	13.7	920,723.9	0.00	1.00
08/27/2022 03:00	0	0.0	6.8	14.5	12.8	921,151.9	0.00	1.00
08/27/2022 04:00	2	1.5	6.7	14.5	17.2	928,640.9	0.00	1.00
08/27/2022 05:00	1	1.6	6.7	14.5	14.5	927,999.0	0.00	1.00
08/27/2022 06:00	2	1.7	10.5	14.6	21.3	686,885.9	0.00	1.00
08/27/2022 07:00	2	1.7	12.6	14.8	22.2	612,649.0	0.00	1.00
08/27/2022 08:00	2	1.7	11.9	14.8	20.1	612,424.5	0.00	1.00
08/27/2022 09:00	2	1.7	11.5	14.8	19.9	617,363.5	0.00	1.00
08/27/2022 10:00	0	1.6	8.0	14.5	9.2	709,961.0	0.00	1.00
08/27/2022 11:00	1	1.7	6.8	14.4	10.9	863,580.1	0.00	1.00
08/27/2022 12:00	1	1.9	8.4	13.9	17.5	976,986.5	0.00	1.00
08/27/2022 13:00	1	1.9	8.4	13.8	17.9	969,012.4	0.00	1.00
08/27/2022 14:00	1	1.9	8.2	13.8	18.0	964,962.0	0.00	1.00
08/27/2022 15:00	1	1.9	8.2	13.8	18.4	963,033.2	0.00	1.00
08/27/2022 16:00	2	2.1	9.5	13.4	22.2	970,648.0	0.00	1.00
08/27/2022 17:00	2	2.2	11.4	12.7	27.0	978,303.4	0.00	1.00
08/27/2022 18:00	3	2.3	11.9	12.3	30.5	973,246.7	0.00	1.00
08/27/2022 19:00	2	2.3	11.7	12.5	28.0	975,388.8	0.00	1.00
08/27/2022 20:00	2	2.2	11.1	12.8	25.7	978,039.5	0.00	1.00
08/27/2022 21:00	1	1.9	8.1	13.9	17.0	941,772.7	0.00	1.00
08/27/2022 22:00	1	1.7	8.3	14.5	13.9	686,424.0	0.00	1.00
08/27/2022 23:00	1	1.7	7.0	14.4	9.3	736,118.3	0.00	1.00
Average/Sum#:	1	1.8	8.9	14.0	18.1	864,820.6	0.00 #	24.00 #
Minimum:	0	1.5	6.4	12.3	9.2	612,424.5	0.00	1.00
Maximum:	3	2.3	12.6	14.8	30.5	978,303.4	0.00	1.00
%SI	4.17	4.17	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:	> 10							
	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1
	NH3Slip, Ppmvdc	NOx, Ppm	NOx, _SCR, Ppm	O2, Dry, Pct	NH3Inj, LbPerHr	ExhaustFlow, LbPerHr	SUSD, Hr	OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/28/2022 00:00	2	1.7	10.0	14.7	17.1	633,027.5	0.00	1.00
08/28/2022 01:00	2	1.7	10.1	14.7	17.8	631,923.1	0.00	1.00
08/28/2022 02:00	2	1.7	11.2	14.7	19.8	628,168.2	0.00	1.00
08/28/2022 03:00	2	1.7	10.3	14.7	18.2	634,352.7	0.00	1.00
08/28/2022 04:00	2	1.7	10.8	14.7	19.9	629,493.5	0.00	1.00
08/28/2022 05:00	2	1.7	10.6	14.6	19.4	629,935.2	0.00	1.00
08/28/2022 06:00	3	1.7	12.5	14.7	24.3	614,474.0	0.00	1.00
08/28/2022 07:00	3	1.7	12.8	14.8	23.2	614,669.5	0.00	1.00
08/28/2022 08:00	2	1.7	12.2	14.8	21.1	614,669.5	0.00	1.00
08/28/2022 09:00	2	1.7	11.6	14.8	19.8	615,567.5	0.00	1.00
08/28/2022 10:00	2	1.7	11.1	14.8	18.6	617,812.4	0.00	1.00
08/28/2022 11:00	1	1.7	10.4	14.8	16.4	622,526.9	0.00	1.00
08/28/2022 12:00	0	1.7	7.7	14.6	9.5	763,399.8	0.00	1.00
08/28/2022 13:00	1	1.7	7.0	14.5	9.8	774,794.6	0.00	1.00
08/28/2022 14:00	1	1.8	6.4	14.5	10.3	869,584.5	0.00	1.00
08/28/2022 15:00	1	1.7	8.0	14.6	12.6	696,232.7	0.00	1.00
08/28/2022 16:00	1	1.8	7.6	14.1	15.6	886,299.5	0.00	1.00
08/28/2022 17:00	3	2.5	12.4	12.1	32.8	985,363.1	0.00	1.00
08/28/2022 18:00	1	2.0	9.2	13.6	20.0	979,982.6	0.00	1.00
08/28/2022 19:00	1	1.9	8.3	14.1	18.1	983,770.3	0.00	1.00
08/28/2022 20:00	1	1.8	7.6	14.2	14.3	872,139.4	0.00	1.00
08/28/2022 21:00	1	1.8	7.7	14.5	13.0	762,170.3	0.00	1.00
08/28/2022 22:00	1	1.7	9.3	14.6	14.6	634,065.2	0.00	1.00
08/28/2022 23:00	0	1.8	6.4	14.4	7.3	809,856.5	0.00	1.00
Average/Sum#:	2	1.8	9.6	14.4	17.2	729,344.9	0.00 #	24.00 #
Minimum:	0	1.7	6.4	12.1	7.3	614,474.0	0.00	1.00
Maximum:	3	2.5	12.8	14.8	32.8	985,363.1	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOx, Ppm	Unit CT1 NOx, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/29/2022 00:00	1	1.8	6.5	14.4	10.1	797,847.7	0.00	1.00
08/29/2022 01:00	1	1.8	6.5	14.4	11.4	808,803.1	0.00	1.00
08/29/2022 02:00	1	1.9	7.0	14.4	13.5	845,672.2	0.00	1.00
08/29/2022 03:00	1	1.8	6.7	14.4	11.4	802,272.0	0.00	1.00
08/29/2022 04:00	1	1.8	6.6	14.5	13.1	863,379.3	0.00	1.00
08/29/2022 05:00	1	1.8	6.7	14.5	15.2	922,863.7	0.00	1.00
08/29/2022 06:00	2	1.7	10.0	14.6	19.9	709,274.9	0.00	1.00
08/29/2022 07:00	2	1.7	11.3	14.7	19.2	619,333.2	0.00	1.00
08/29/2022 08:00	2	1.7	12.0	14.8	20.0	616,465.5	0.00	1.00
08/29/2022 09:00	1	1.7	9.8	14.7	15.5	630,597.8	0.00	1.00
08/29/2022 10:00	1	1.7	9.8	14.8	15.6	635,996.6	0.00	1.00
08/29/2022 11:00	1	1.7	9.1	14.8	14.6	647,221.4	0.00	1.00
08/29/2022 12:00	1	1.7	8.7	14.8	13.2	644,302.9	0.00	1.00
08/29/2022 13:00	0	1.7	7.3	14.6	9.4	736,011.3	0.00	1.00
08/29/2022 14:00	1	1.8	6.8	14.4	11.1	854,731.5	0.00	1.00
08/29/2022 15:00	1	2.1	9.3	13.6	19.8	975,855.6	0.00	1.00
08/29/2022 16:00	2	2.1	9.7	13.4	22.6	979,594.9	0.00	1.00
08/29/2022 17:00	3	2.2	11.9	12.5	30.4	977,345.1	0.00	1.00
08/29/2022 18:00	2	2.1	11.2	12.8	26.1	976,687.0	0.00	1.00
08/29/2022 19:00	2	2.0	10.2	13.2	23.0	983,140.0	0.00	1.00
08/29/2022 20:00	2	2.0	9.4	13.4	21.3	971,013.2	0.00	1.00
08/29/2022 21:00	1	1.8	8.5	13.8	18.4	936,994.9	0.00	1.00
08/29/2022 22:00	1	1.7	6.5	14.5	11.6	876,431.6	0.00	1.00
08/29/2022 23:00	1	1.7	7.0	14.5	15.9	964,160.4	0.00	1.00
Average/Sum#:	1	1.8	8.7	14.2	16.8	823,999.8	0.00 #	24.00 #
Minimum:	0	1.7	6.5	12.5	9.4	616,465.5	0.00	1.00
Maximum:	3	2.2	12.0	14.8	30.4	983,140.0	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOx, Ppm	Unit CT1 NOx, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/30/2022 00:00	1	1.7	6.8	14.5	15.1	939,553.5	0.00	1.00
08/30/2022 01:00	1	1.7	6.5	14.5	14.0	898,470.8	0.00	1.00
08/30/2022 02:00	1	1.7	6.8	14.5	14.2	891,837.6	0.00	1.00
08/30/2022 03:00	1	1.7	6.8	14.5	13.4	889,056.0	0.00	1.00
08/30/2022 04:00	1	1.7	6.9	14.5	16.7	934,846.1	0.00	1.00
08/30/2022 05:00	1	1.7	7.3	14.5	18.2	978,496.5	0.00	1.00
08/30/2022 06:00	2	1.7	9.9	14.6	18.7	673,191.6	0.00	1.00
08/30/2022 07:00	2	1.6	11.7	14.8	20.2	620,506.4	0.00	1.00
08/30/2022 08:00	1	1.6	9.8	14.7	13.6	694,651.6	0.00	1.00
08/30/2022 09:00	0	1.8	7.2	14.4	8.9	741,596.0	0.00	1.00
08/30/2022 10:00	1	1.7	6.4	14.5	9.6	866,160.9	0.00	1.00
08/30/2022 11:00	1	1.7	6.3	14.6	13.2	959,249.2	0.00	1.00
08/30/2022 12:00	1	1.7	6.2	14.6	12.5	949,684.9	0.00	1.00
08/30/2022 13:00	1	1.8	6.9	14.4	15.3	942,796.0	0.00	1.00
08/30/2022 14:00	3	2.4	12.2	12.4	30.8	980,669.0	0.00	1.00
08/30/2022 15:00	3	2.4	12.6	12.1	33.4	976,804.2	0.00	1.00
08/30/2022 16:00	3	2.4	12.5	12.2	32.8	978,430.1	0.00	1.00
08/30/2022 17:00	4	2.5	12.8	11.7	37.9	974,375.2	0.00	1.00
08/30/2022 18:00	4	2.5	12.8	11.7	38.2	977,501.1	0.00	1.00
08/30/2022 19:00	4	2.4	12.7	11.9	36.5	979,747.1	0.00	1.00
08/30/2022 20:00	3	2.3	12.2	12.4	30.5	978,091.2	0.00	1.00
08/30/2022 21:00	2	2.2	11.3	12.8	26.2	975,503.5	0.00	1.00
08/30/2022 22:00	1	1.9	8.6	13.8	17.9	937,959.3	0.00	1.00
08/30/2022 23:00	1	1.7	7.0	14.5	15.8	965,444.2	0.00	1.00
Average/Sum#:	2	1.9	9.2	13.7	21.0	904,359.3	0.00 #	24.00 #
Minimum:	0	1.6	6.2	11.7	8.9	620,506.4	0.00	1.00
Maximum:	4	2.5	12.8	14.8	38.2	980,669.0	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 **To:** 09/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOx, Ppm	Unit CT1 NOx, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/31/2022 00:00	1	1.7	7.1	14.5	15.9	966,942.0	0.00	1.00
08/31/2022 01:00	1	1.7	7.1	14.5	16.4	969,295.7	0.00	1.00
08/31/2022 02:00	1	1.7	7.4	14.5	16.6	970,579.5	0.00	1.00
08/31/2022 03:00	1	1.7	7.3	14.5	16.8	968,225.8	0.00	1.00
08/31/2022 04:00	1	1.7	7.3	14.5	17.6	976,356.8	0.00	1.00
08/31/2022 05:00	1	1.7	7.2	14.5	17.5	976,784.7	0.00	1.00
08/31/2022 06:00	1	1.7	6.9	14.4	12.2	870,532.5	0.00	1.00
08/31/2022 07:00	0	1.8	6.8	14.4	9.6	790,684.6	0.00	1.00
08/31/2022 08:00	0	1.8	6.5	14.4	8.3	788,367.1	0.00	1.00
08/31/2022 09:00	1	1.8	6.5	14.5	11.1	847,973.3	0.00	1.00
08/31/2022 10:00	1	1.8	6.7	14.5	14.7	941,693.2	0.00	1.00
08/31/2022 11:00	2	2.3	11.8	12.6	28.9	983,510.7	0.00	1.00
08/31/2022 12:00	3	2.4	12.4	12.2	31.3	975,596.8	0.00	1.00
08/31/2022 13:00	3	2.4	12.5	12.1	33.3	984,896.2	0.00	1.00
08/31/2022 14:00	3	2.3	12.4	12.2	31.7	967,569.2	0.00	1.00
08/31/2022 15:00	2	2.2	11.4	12.8	26.8	974,996.3	0.00	1.00
08/31/2022 16:00	2	2.1	10.1	13.2	23.5	971,046.4	0.00	1.00
08/31/2022 17:00	3	2.4	12.8	12.1	34.1	976,337.3	0.00	1.00
08/31/2022 18:00	4	2.4	13.1	11.9	37.1	976,247.4	0.00	1.00
08/31/2022 19:00	3	2.2	12.0	12.6	29.7	981,860.8	0.00	1.00
08/31/2022 20:00	2	2.0	9.8	13.4	22.4	980,507.9	0.00	1.00
08/31/2022 21:00	2	2.1	10.7	13.1	24.6	976,680.5	0.00	1.00
08/31/2022 22:00	1	1.9	8.9	13.8	20.2	975,763.1	0.00	1.00
08/31/2022 23:00	2	2.0	9.8	13.4	23.6	978,682.0	0.00	1.00
Average/Sum#:	2	2.0	9.4	13.5	21.8	948,797.1	0.00 #	24.00 #
Minimum:	0	1.7	6.5	11.9	8.3	788,367.1	0.00	1.00
Maximum:	4	2.4	13.1	14.5	37.1	984,896.2	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOx, Ppm	Unit CT1 NOx, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/01/2022 00:00	2	2.0	10.0	13.3	22.7	973,012.1	0.00	1.00
09/01/2022 01:00	1	1.8	8.2	14.1	18.9	961,013.7	0.00	1.00
09/01/2022 02:00	1	1.8	6.9	14.5	14.4	936,985.8	0.00	1.00
09/01/2022 03:00	1	1.7	7.0	14.5	16.0	953,247.8	0.00	1.00
09/01/2022 04:00	1	1.7	7.0	14.5	16.3	942,763.1	0.00	1.00
09/01/2022 05:00	1	1.7	6.9	14.5	16.4	947,042.6	0.00	1.00
09/01/2022 06:00	1	1.7	6.8	14.5	15.6	931,208.6	0.00	1.00
09/01/2022 07:00	1	1.7	6.7	14.5	14.7	939,767.5	0.00	1.00
09/01/2022 08:00	1	1.7	9.2	14.7	14.8	652,022.7	0.00	1.00
09/01/2022 09:00	1	1.7	8.8	14.7	13.7	644,513.0	0.00	1.00
09/01/2022 10:00	1	1.6	8.7	14.8	13.1	677,079.3	0.00	1.00
09/01/2022 11:00	1	1.7	7.2	14.4	12.3	844,618.8	0.00	1.00
09/01/2022 12:00	2	2.3	11.9	12.6	27.9	971,631.3	0.00	1.00
09/01/2022 13:00	3	2.3	12.5	12.4	29.7	971,969.1	0.00	1.00
09/01/2022 14:00	3	2.4	12.7	12.2	32.5	968,041.4	0.00	1.00
09/01/2022 15:00	4	2.5	12.8	11.9	36.3	970,008.9	0.00	1.00
09/01/2022 16:00	3	2.4	12.6	12.2	32.5	964,735.9	0.00	1.00
09/01/2022 17:00	4	2.5	12.8	11.9	36.1	971,530.5	0.00	1.00
09/01/2022 18:00	4	2.5	12.8	11.8	36.3	961,004.8	0.00	1.00
09/01/2022 19:00	3	2.3	12.6	12.4	30.3	971,002.4	0.00	1.00
09/01/2022 20:00	3	2.4	12.8	12.2	33.0	977,485.7	0.00	1.00
09/01/2022 21:00	3	2.3	12.3	12.3	30.4	964,170.3	0.00	1.00
09/01/2022 22:00	2	2.2	11.6	12.8	26.3	974,827.3	0.00	1.00
09/01/2022 23:00	2	2.2	11.7	12.7	27.0	970,788.3	0.00	1.00
Average/Sum#:	2	2.0	10.1	13.4	23.6	918,353.0	0.00 #	24.00 #
Minimum:	1	1.6	6.7	11.8	12.3	644,513.0	0.00	1.00
Maximum:	4	2.5	12.8	14.8	36.3	977,485.7	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOx, Ppm	Unit CT1 NOx, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/02/2022 00:00	2	2.1	10.7	13.1	23.6	972,818.0	0.00	1.00
09/02/2022 01:00	2	2.1	10.3	13.2	22.6	967,845.1	0.00	1.00
09/02/2022 02:00	1	2.0	10.0	13.4	21.7	965,900.7	0.00	1.00
09/02/2022 03:00	2	2.0	9.7	13.4	21.4	960,057.8	0.00	1.00
09/02/2022 04:00	2	2.1	10.5	13.2	24.2	977,626.7	0.00	1.00
09/02/2022 05:00	2	2.2	11.6	12.9	26.8	980,850.2	0.00	1.00
09/02/2022 06:00	1	1.9	9.2	13.7	20.3	973,432.5	0.00	1.00
09/02/2022 07:00	1	1.8	8.5	14.1	18.2	975,513.5	0.00	1.00
09/02/2022 08:00	1	1.9	8.8	13.9	19.2	980,899.1	0.00	1.00
09/02/2022 09:00	2	2.0	9.8	13.4	22.6	978,134.2	0.00	1.00
09/02/2022 10:00	2	2.1	10.8	13.1	24.5	978,962.9	0.00	1.00
09/02/2022 11:00	2	2.2	11.4	12.9	26.2	976,913.1	0.00	1.00
09/02/2022 12:00	2	2.2	12.0	12.7	27.8	974,462.4	0.00	1.00
09/02/2022 13:00	3	2.4	12.8	12.3	32.1	969,584.3	0.00	1.00
09/02/2022 14:00	3	2.3	13.0	12.4	32.2	979,541.2	0.00	1.00
09/02/2022 15:00	2	2.1	10.5	13.2	23.6	968,378.7	0.00	1.00
09/02/2022 16:00	2	2.0	10.1	13.4	22.7	971,743.5	0.00	1.00
09/02/2022 17:00	2	2.1	10.1	13.3	22.8	968,327.2	0.00	1.00
09/02/2022 18:00	2	2.1	11.2	13.0	25.6	970,384.5	0.00	1.00
09/02/2022 19:00	2	2.2	11.7	12.8	26.8	972,460.4	0.00	1.00
09/02/2022 20:00	2	2.2	10.9	12.9	24.6	960,822.4	0.00	1.00
09/02/2022 21:00	1	2.0	9.6	13.5	20.5	969,145.3	0.00	1.00
09/02/2022 22:00	1	1.9	8.2	14.0	17.3	947,086.0	0.00	1.00
09/02/2022 23:00	1	1.7	7.9	14.5	12.4	749,973.8	0.00	1.00
Average/Sum#:	2	2.1	10.4	13.3	23.3	962,119.3	0.00 #	24.00 #
Minimum:	1	1.7	7.9	12.3	12.4	749,973.8	0.00	1.00
Maximum:	3	2.4	13.0	14.5	32.2	980,899.1	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOx, Ppm	Unit CT1 NOx, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/03/2022 00:00	0	1.7	6.5	14.4	9.5	812,384.7	0.00	1.00
09/03/2022 01:00	2	1.7	9.5	14.7	16.9	642,525.1	0.00	1.00
09/03/2022 02:00	1	1.8	10.1	14.8	16.6	636,221.1	0.00	1.00
09/03/2022 03:00	2	1.7	10.2	14.7	17.5	628,168.2	0.00	1.00
09/03/2022 04:00	2	1.6	10.9	14.8	19.0	627,690.3	0.00	1.00
09/03/2022 05:00	2	1.7	10.2	14.7	17.8	625,076.0	0.00	1.00
09/03/2022 06:00	3	1.6	12.3	14.8	22.9	613,322.5	0.00	1.00
09/03/2022 07:00	2	1.6	12.0	14.8	20.9	613,322.5	0.00	1.00
09/03/2022 08:00	2	1.6	11.9	14.9	20.7	619,436.3	0.00	1.00
09/03/2022 09:00	1	1.6	10.4	14.9	16.0	634,956.4	0.00	1.00
09/03/2022 10:00	2	1.6	9.7	14.8	16.6	627,016.8	0.00	1.00
09/03/2022 11:00	1	1.6	10.4	14.9	16.8	630,163.5	0.00	1.00
09/03/2022 12:00	0	1.6	7.6	14.7	9.3	745,231.9	0.00	1.00
09/03/2022 13:00	1	2.0	8.8	13.8	16.8	967,662.3	0.00	1.00
09/03/2022 14:00	1	1.9	8.5	13.9	17.0	941,381.4	0.00	1.00
09/03/2022 15:00	1	1.7	8.4	14.4	14.6	781,414.6	0.00	1.00
09/03/2022 16:00	1	1.9	9.0	13.7	18.7	959,738.3	0.00	1.00
09/03/2022 17:00	1	1.9	9.0	13.8	18.7	971,134.1	0.00	1.00
09/03/2022 18:00	1	1.9	9.0	13.9	18.9	977,182.1	0.00	1.00
09/03/2022 19:00	1	1.7	8.3	14.7	13.7	745,231.9	0.00	1.00
09/03/2022 20:00	1	1.7	8.5	14.6	11.8	654,280.5	0.00	1.00
09/03/2022 21:00	1	1.6	7.6	14.6	11.4	711,665.9	0.00	1.00
09/03/2022 22:00	1	1.6	8.1	14.6	12.0	690,798.5	0.00	1.00
09/03/2022 23:00	0	1.6	7.2	14.5	9.4	754,895.2	0.00	1.00
Average/Sum#:	1	1.7	9.3	14.5	16.0	733,787.5	0.00 #	24.00 #
Minimum:	0	1.6	6.5	13.7	9.3	613,322.5	0.00	1.00
Maximum:	3	2.0	12.3	14.9	22.9	977,182.1	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOx, Ppm	Unit CT1 NOx, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/04/2022 00:00	1	1.7	7.9	14.6	12.5	718,404.4	0.00	1.00
09/04/2022 01:00	1	1.7	9.3	14.7	15.0	640,979.0	0.00	1.00
09/04/2022 02:00	1	1.6	8.9	14.6	14.7	684,712.2	0.00	1.00
09/04/2022 03:00	1	1.7	8.5	14.6	12.8	694,276.4	0.00	1.00
09/04/2022 04:00	2	1.7	9.9	14.7	18.1	641,862.5	0.00	1.00
09/04/2022 05:00	3	1.7	11.6	14.8	23.1	622,526.9	0.00	1.00
09/04/2022 06:00	2	1.7	12.1	14.8	21.9	619,832.9	0.00	1.00
09/04/2022 07:00	2	1.6	12.3	14.8	21.8	612,649.0	0.00	1.00
09/04/2022 08:00	2	1.6	11.6	14.9	19.9	622,403.4	0.00	1.00
09/04/2022 09:00	2	1.6	11.0	14.9	18.5	622,403.4	0.00	1.00
09/04/2022 10:00	1	1.6	9.7	14.9	14.4	634,043.5	0.00	1.00
09/04/2022 11:00	1	1.6	9.4	14.9	13.3	633,358.8	0.00	1.00
09/04/2022 12:00	0	1.6	7.4	14.7	7.6	687,804.4	0.00	1.00
09/04/2022 13:00	1	1.6	7.9	14.7	11.4	676,318.9	0.00	1.00
09/04/2022 14:00	1	1.7	7.7	14.3	12.3	798,830.9	0.00	1.00
09/04/2022 15:00	1	2.0	9.0	13.7	18.0	955,744.1	0.00	1.00
09/04/2022 16:00	1	2.0	9.3	13.5	19.5	954,340.7	0.00	1.00
09/04/2022 17:00	2	2.1	10.2	13.2	22.5	967,489.4	0.00	1.00
09/04/2022 18:00	1	2.1	9.9	13.3	20.7	969,047.9	0.00	1.00
09/04/2022 19:00	1	1.8	7.3	14.2	13.8	927,120.7	0.00	1.00
09/04/2022 20:00	1	2.0	9.2	13.6	20.5	973,979.6	0.00	1.00
09/04/2022 21:00	1	2.0	9.1	13.6	20.1	971,165.8	0.00	1.00
09/04/2022 22:00	1	1.8	8.0	14.0	16.5	940,735.0	0.00	1.00
09/04/2022 23:00	1	1.7	6.4	14.5	11.1	901,466.4	0.00	1.00
Average/Sum#:	1	1.8	9.3	14.4	16.7	769,645.7	0.00 #	24.00 #
Minimum:	0	1.6	6.4	13.2	7.6	612,649.0	0.00	1.00
Maximum:	3	2.1	12.3	14.9	23.1	973,979.6	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOx, Ppm	Unit CT1 NOx, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/05/2022 00:00	1	1.8	6.4	14.5	11.6	893,549.4	0.00	1.00
09/05/2022 01:00	1	1.8	6.8	14.4	12.0	805,432.2	0.00	1.00
09/05/2022 02:00	1	1.8	6.9	14.4	8.2	772,776.7	0.00	1.00
09/05/2022 03:00	1	1.8	6.6	14.4	10.3	800,586.6	0.00	1.00
09/05/2022 04:00	1	1.8	6.6	14.4	11.2	805,432.2	0.00	1.00
09/05/2022 05:00	1	1.8	6.8	14.4	12.5	782,257.3	0.00	1.00
09/05/2022 06:00	3	1.7	11.4	14.7	21.7	618,008.0	0.00	1.00
09/05/2022 07:00	2	1.6	11.9	14.9	20.3	621,718.7	0.00	1.00
09/05/2022 08:00	2	1.6	11.0	14.9	18.1	622,859.9	0.00	1.00
09/05/2022 09:00	0	1.6	6.9	14.6	6.7	801,656.7	0.00	1.00
09/05/2022 10:00	0	1.7	6.2	14.6	8.5	905,124.3	0.00	1.00
09/05/2022 11:00	1	1.8	6.8	14.3	12.5	894,483.1	0.00	1.00
09/05/2022 12:00	2	2.1	9.8	13.2	20.9	956,640.7	0.00	1.00
09/05/2022 13:00	2	2.2	10.8	12.8	24.6	960,794.9	0.00	1.00
09/05/2022 14:00	3	2.4	12.6	12.0	31.9	952,904.0	0.00	1.00
09/05/2022 15:00	3	2.5	12.6	11.9	33.7	959,966.5	0.00	1.00
09/05/2022 16:00	4	2.5	12.6	11.9	34.1	959,814.3	0.00	1.00
09/05/2022 17:00	4	2.5	12.5	11.8	34.7	956,941.7	0.00	1.00
09/05/2022 18:00	4	2.4	12.5	11.9	34.2	962,553.2	0.00	1.00
09/05/2022 19:00	3	2.4	12.5	11.9	33.4	957,075.5	0.00	1.00
09/05/2022 20:00	3	2.4	12.5	12.0	32.8	962,751.5	0.00	1.00
09/05/2022 21:00	3	2.3	12.1	12.4	28.6	966,813.6	0.00	1.00
09/05/2022 22:00	3	2.3	12.1	12.4	28.6	965,685.9	0.00	1.00
09/05/2022 23:00	3	2.3	12.4	12.4	29.0	971,163.6	0.00	1.00
Average/Sum#:	2	2.0	10.0	13.4	21.7	869,041.3	0.00 #	24.00 #
Minimum:	0	1.6	6.2	11.8	6.7	618,008.0	0.00	1.00
Maximum:	4	2.5	12.6	14.9	34.7	971,163.6	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10								
	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOx, Ppm	Unit CT1 NOx, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/06/2022 00:00	2	2.2	10.8	12.9	23.4	962,534.2	0.00	1.00
09/06/2022 01:00	1	1.9	7.8	13.9	14.7	921,622.6	0.00	1.00
09/06/2022 02:00	0	1.8	6.4	14.6	9.4	935,773.3	0.00	1.00
09/06/2022 03:00	1	1.7	6.4	14.6	12.1	935,556.0	0.00	1.00
09/06/2022 04:00	1	1.7	6.3	14.5	13.2	920,937.9	0.00	1.00
09/06/2022 05:00	1	1.7	6.4	14.5	13.7	920,937.9	0.00	1.00
09/06/2022 06:00	1	1.7	6.4	14.5	12.8	914,518.7	0.00	1.00
09/06/2022 07:00	1	1.7	6.3	14.5	10.5	866,160.9	0.00	1.00
09/06/2022 08:00	0	1.7	6.0	14.6	9.4	914,688.5	0.00	1.00
09/06/2022 09:00	1	1.9	8.2	13.8	18.0	918,671.6	0.00	1.00
09/06/2022 10:00	2	2.2	10.3	12.9	23.2	958,597.1	0.00	1.00
09/06/2022 11:00	3	2.5	12.6	11.9	33.4	961,335.9	0.00	1.00
09/06/2022 12:00	3	2.5	12.5	11.8	33.6	952,577.6	0.00	1.00
09/06/2022 13:00	4	2.5	12.4	11.8	34.0	954,985.4	0.00	1.00
09/06/2022 14:00	4	2.5	12.4	11.8	34.2	954,533.9	0.00	1.00
09/06/2022 15:00	4	2.5	12.4	11.8	34.7	955,286.4	0.00	1.00
09/06/2022 16:00	4	2.5	12.3	11.8	34.6	956,189.3	0.00	1.00
09/06/2022 17:00	4	2.5	12.4	11.8	35.0	956,339.8	0.00	1.00
09/06/2022 18:00	4	2.5	12.4	11.8	34.6	956,189.3	0.00	1.00
09/06/2022 19:00	3	2.4	12.3	11.9	33.0	960,270.8	0.00	1.00
09/06/2022 20:00	3	2.4	12.3	12.0	32.4	965,675.0	0.00	1.00
09/06/2022 21:00	3	2.4	12.4	12.1	31.7	968,089.7	0.00	1.00
09/06/2022 22:00	2	2.1	9.9	13.1	21.1	961,055.0	0.00	1.00
09/06/2022 23:00	2	2.1	10.1	13.1	21.5	958,421.5	0.00	1.00
Average/Sum#:	2	2.2	9.9	13.0	23.9	942,956.2	0.00 #	24.00 #
Minimum:	0	1.7	6.0	11.8	9.4	866,160.9	0.00	1.00
Maximum:	4	2.5	12.6	14.6	35.0	968,089.7	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOx, Ppm	Unit CT1 NOx, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/07/2022 00:00	1	1.8	7.3	14.2	14.6	943,880.9	0.00	1.00
09/07/2022 01:00	1	1.7	6.7	14.5	13.0	952,177.9	0.00	1.00
09/07/2022 02:00	0	1.6	6.7	14.6	12.1	961,857.6	0.00	1.00
09/07/2022 03:00	1	1.8	6.4	14.6	9.5	958,379.7	0.00	1.00
09/07/2022 04:00	1	1.7	6.8	14.6	14.3	969,900.3	0.00	1.00
09/07/2022 05:00	1	1.7	7.0	14.6	14.8	974,030.3	0.00	1.00
09/07/2022 06:00	0	1.7	6.5	14.5	11.2	921,793.8	0.00	1.00
09/07/2022 07:00	1	1.7	6.6	14.5	10.0	827,859.8	0.00	1.00
09/07/2022 08:00	0	1.7	6.3	14.6	10.5	915,775.4	0.00	1.00
09/07/2022 09:00	2	2.5	12.2	12.5	29.1	972,291.3	0.00	1.00
09/07/2022 10:00	3	2.5	12.9	12.3	31.8	986,463.3	0.00	1.00
09/07/2022 11:00	3	2.5	12.9	12.2	32.1	980,319.0	0.00	1.00
09/07/2022 12:00	3	2.5	12.7	12.1	32.2	974,158.7	0.00	1.00
09/07/2022 13:00	3	2.6	12.5	12.1	32.2	976,959.8	0.00	1.00
09/07/2022 14:00	3	2.6	12.5	12.0	32.7	968,752.4	0.00	1.00
09/07/2022 15:00	3	2.6	12.5	12.0	33.1	970,752.6	0.00	1.00
09/07/2022 16:00	3	2.6	12.5	12.0	33.1	968,290.7	0.00	1.00
09/07/2022 17:00	3	2.6	12.6	12.0	33.0	969,521.7	0.00	1.00
09/07/2022 18:00	3	2.6	12.6	12.0	32.3	967,367.5	0.00	1.00
09/07/2022 19:00	3	2.5	12.3	12.2	30.2	971,819.1	0.00	1.00
09/07/2022 20:00	3	2.5	12.7	12.2	30.9	978,744.9	0.00	1.00
09/07/2022 21:00	3	2.5	12.5	12.3	29.6	978,023.8	0.00	1.00
09/07/2022 22:00	2	2.4	11.8	12.6	25.9	972,126.3	0.00	1.00
09/07/2022 23:00	2	2.4	11.4	12.8	26.0	978,715.8	0.00	1.00
Average/Sum#:	2	2.2	10.3	13.1	23.9	959,998.4	0.00 #	24.00 #
Minimum:	0	1.6	6.3	12.0	9.5	827,859.8	0.00	1.00
Maximum:	3	2.6	12.9	14.6	33.1	986,463.3	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOx, Ppm	Unit CT1 NOx, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/08/2022 00:00	2	2.2	11.3	12.8	25.6	972,967.6	0.00	1.00
09/08/2022 01:00	1	1.7	7.0	14.4	14.2	948,905.8	0.00	1.00
09/08/2022 02:00	1	1.7	7.0	14.6	14.5	974,465.0	0.00	1.00
09/08/2022 03:00	1	1.7	6.8	14.6	14.2	972,508.7	0.00	1.00
09/08/2022 04:00	1	1.7	6.7	14.6	14.6	970,117.6	0.00	1.00
09/08/2022 05:00	1	1.7	6.6	14.6	14.8	970,552.4	0.00	1.00
09/08/2022 06:00	1	1.7	6.5	14.6	13.7	955,771.3	0.00	1.00
09/08/2022 07:00	1	1.7	6.3	14.5	11.3	917,942.3	0.00	1.00
09/08/2022 08:00	1	1.7	6.6	14.5	13.7	944,260.9	0.00	1.00
09/08/2022 09:00	3	2.5	12.6	12.2	30.5	974,809.8	0.00	1.00
09/08/2022 10:00	3	2.6	12.6	12.1	31.4	972,913.8	0.00	1.00
09/08/2022 11:00	3	2.6	12.3	12.0	31.8	968,290.7	0.00	1.00
09/08/2022 12:00	3	2.6	12.3	11.9	32.5	958,140.6	0.00	1.00
09/08/2022 13:00	3	2.6	12.3	11.9	32.8	960,727.3	0.00	1.00
09/08/2022 14:00	3	2.6	12.3	11.8	33.0	951,072.8	0.00	1.00
09/08/2022 15:00	3	2.6	12.3	11.8	33.3	950,621.3	0.00	1.00
09/08/2022 16:00	4	2.6	12.4	11.8	33.6	950,922.3	0.00	1.00
09/08/2022 17:00	4	2.6	12.3	11.8	33.6	951,223.2	0.00	1.00
09/08/2022 18:00	4	2.4	12.3	11.9	33.9	959,357.9	0.00	1.00
09/08/2022 19:00	3	2.5	12.4	11.9	33.8	962,857.5	0.00	1.00
09/08/2022 20:00	4	2.5	12.3	11.8	35.3	963,563.1	0.00	1.00
09/08/2022 21:00	4	2.5	12.4	11.7	35.2	956,662.0	0.00	1.00
09/08/2022 22:00	3	2.3	12.1	12.1	30.4	958,597.1	0.00	1.00
09/08/2022 23:00	2	2.3	11.8	12.5	27.1	960,064.3	0.00	1.00
Average/Sum#:	2	2.2	10.4	12.9	26.0	959,471.5	0.00 #	24.00 #
Minimum:	1	1.7	6.3	11.7	11.3	917,942.3	0.00	1.00
Maximum:	4	2.6	12.6	14.6	35.3	974,809.8	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOx, Ppm	Unit CT1 NOx, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/09/2022 00:00	2	2.3	12.1	12.5	27.7	963,650.9	0.00	1.00
09/09/2022 01:00	2	2.1	10.8	12.9	23.8	961,164.7	0.00	1.00
09/09/2022 02:00	1	1.9	10.6	13.0	25.7	967,437.7	0.00	1.00
09/09/2022 03:00	1	2.0	10.0	13.3	24.5	971,030.0	0.00	1.00
09/09/2022 04:00	2	2.2	11.0	12.9	25.9	973,318.4	0.00	1.00
09/09/2022 05:00	3	2.4	12.7	12.2	33.8	984,883.7	0.00	1.00
09/09/2022 06:00	3	2.3	12.0	12.5	29.7	978,975.4	0.00	1.00
09/09/2022 07:00	2	2.2	11.7	12.6	28.1	974,931.2	0.00	1.00
09/09/2022 08:00	2	2.2	11.0	12.9	25.5	979,309.6	0.00	1.00
09/09/2022 09:00	2	2.1	10.2	13.1	22.7	963,513.0	0.00	1.00
09/09/2022 10:00	3	2.3	12.0	12.4	28.3	966,813.6	0.00	1.00
09/09/2022 11:00	2	2.1	9.8	13.2	21.7	963,576.8	0.00	1.00
09/09/2022 12:00	2	2.3	11.9	12.5	28.5	965,770.2	0.00	1.00
09/09/2022 13:00	3	2.4	12.5	12.2	32.1	969,615.4	0.00	1.00
09/09/2022 14:00	2	2.3	12.0	12.5	28.4	964,303.0	0.00	1.00
09/09/2022 15:00	2	2.3	11.8	12.6	27.8	960,577.0	0.00	1.00
09/09/2022 16:00	2	2.1	10.3	13.1	22.3	954,734.6	0.00	1.00
09/09/2022 17:00	2	2.2	11.1	12.9	24.8	964,588.3	0.00	1.00
09/09/2022 18:00	2	2.1	10.0	13.2	21.2	958,241.4	0.00	1.00
09/09/2022 19:00	1	2.0	8.9	13.5	18.5	945,828.1	0.00	1.00
09/09/2022 20:00	1	1.8	7.4	14.1	12.8	895,160.5	0.00	1.00
09/09/2022 21:00	0	1.7	6.1	14.5	8.7	889,911.9	0.00	1.00
09/09/2022 22:00	1	1.7	6.6	14.5	9.3	795,550.0	0.00	1.00
09/09/2022 23:00	1	1.7	6.1	14.5	10.7	898,898.7	0.00	1.00
Average/Sum#:	2	2.1	10.4	13.1	23.4	950,491.0	0.00 #	24.00 #
Minimum:	0	1.7	6.1	12.2	8.7	795,550.0	0.00	1.00
Maximum:	3	2.4	12.7	14.5	33.8	984,883.7	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOx, Ppm	Unit CT1 NOx, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/10/2022 00:00	1	1.7	6.5	14.5	10.4	859,099.8	0.00	1.00
09/10/2022 01:00	2	1.7	9.0	14.6	15.4	664,279.5	0.00	1.00
09/10/2022 02:00	1	1.6	8.1	14.5	10.4	773,510.8	0.00	1.00
09/10/2022 03:00	1	1.7	8.2	14.4	12.1	718,421.1	0.00	1.00
09/10/2022 04:00	1	1.8	6.6	14.4	10.8	815,755.6	0.00	1.00
09/10/2022 05:00	1	1.7	6.7	14.4	10.3	773,619.4	0.00	1.00
09/10/2022 06:00	1	1.7	8.1	14.6	13.1	753,400.8	0.00	1.00
09/10/2022 07:00	1	1.7	6.9	14.5	14.3	921,151.9	0.00	1.00
09/10/2022 08:00	1	1.7	7.3	14.5	13.8	829,999.6	0.00	1.00
09/10/2022 09:00	1	1.6	7.9	14.5	13.1	700,332.2	0.00	1.00
09/10/2022 10:00	2	1.6	10.2	14.9	16.7	636,097.6	0.00	1.00
09/10/2022 11:00	2	1.6	10.4	14.9	17.2	632,674.1	0.00	1.00
09/10/2022 12:00	1	1.6	9.4	14.8	15.1	669,446.5	0.00	1.00
09/10/2022 13:00	1	1.5	8.4	14.7	12.0	722,702.7	0.00	1.00
09/10/2022 14:00	1	1.7	8.9	14.7	14.0	651,581.0	0.00	1.00
09/10/2022 15:00	1	1.6	8.1	14.7	11.4	665,054.3	0.00	1.00
09/10/2022 16:00	1	1.7	7.4	14.6	10.5	731,011.8	0.00	1.00
09/10/2022 17:00	1	1.7	8.3	14.7	13.6	660,857.7	0.00	1.00
09/10/2022 18:00	1	1.7	6.8	14.4	9.6	744,756.2	0.00	1.00
09/10/2022 19:00	1	1.7	6.4	14.5	10.9	868,728.6	0.00	1.00
09/10/2022 20:00	1	1.7	6.7	14.5	11.8	890,125.8	0.00	1.00
09/10/2022 21:00	1	1.7	6.5	14.5	11.9	896,331.1	0.00	1.00
09/10/2022 22:00	1	1.7	7.1	14.4	10.7	731,904.7	0.00	1.00
09/10/2022 23:00	1	1.7	6.4	14.5	12.4	918,584.2	0.00	1.00
Average/Sum#:	1	1.7	7.8	14.6	12.6	759,559.5	0.00 #	24.00 #
Minimum:	1	1.5	6.4	14.4	9.6	632,674.1	0.00	1.00
Maximum:	2	1.8	10.4	14.9	17.2	921,151.9	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOX, Ppm	Unit CT1 NOX, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/11/2022 00:00	1	1.7	6.5	14.6	13.5	948,163.4	0.00	1.00
09/11/2022 01:00	1	1.7	6.5	14.5	13.7	921,151.9	0.00	1.00
09/11/2022 02:00	1	1.8	6.8	14.5	13.4	911,737.1	0.00	1.00
09/11/2022 03:00	1	1.8	6.6	14.4	9.2	822,708.0	0.00	1.00
09/11/2022 04:00	1	1.7	6.4	14.5	12.6	870,440.4	0.00	1.00
09/11/2022 05:00	1	1.7	6.9	14.4	13.5	833,031.4	0.00	1.00
09/11/2022 06:00	1	1.6	8.0	14.5	13.4	743,340.7	0.00	1.00
09/11/2022 07:00	2	1.7	9.4	14.6	17.0	661,671.1	0.00	1.00
09/11/2022 08:00	1	1.6	9.5	14.8	15.2	642,507.0	0.00	1.00
09/11/2022 09:00	2	1.6	10.7	14.9	17.2	637,010.6	0.00	1.00
09/11/2022 10:00	0	1.6	9.1	14.8	10.8	645,874.4	0.00	1.00
09/11/2022 11:00	1	1.7	8.7	14.8	13.9	652,609.3	0.00	1.00
09/11/2022 12:00	0	1.5	7.9	14.7	8.6	723,144.4	0.00	1.00
09/11/2022 13:00	1	1.7	7.8	14.6	11.0	704,710.1	0.00	1.00
09/11/2022 14:00	0	1.7	6.7	14.5	9.2	819,300.9	0.00	1.00
09/11/2022 15:00	0	1.7	6.4	14.5	8.8	856,318.2	0.00	1.00
09/11/2022 16:00	1	1.9	8.7	13.9	19.2	955,858.2	0.00	1.00
09/11/2022 17:00	2	2.1	9.9	13.3	21.5	985,805.4	0.00	1.00
09/11/2022 18:00	1	1.9	8.8	13.7	19.5	981,991.4	0.00	1.00
09/11/2022 19:00	1	1.9	8.1	14.0	17.5	960,581.7	0.00	1.00
09/11/2022 20:00	1	1.7	6.4	14.5	12.1	911,309.1	0.00	1.00
09/11/2022 21:00	1	1.7	8.2	14.6	12.2	716,665.4	0.00	1.00
09/11/2022 22:00	1	1.7	8.4	14.6	13.9	736,663.4	0.00	1.00
09/11/2022 23:00	1	1.6	7.8	14.5	10.5	702,471.9	0.00	1.00
Average/Sum#:	1	1.7	7.9	14.4	13.6	806,044.4	0.00 #	24.00 #
Minimum:	0	1.5	6.4	13.3	8.6	637,010.6	0.00	1.00
Maximum:	2	2.1	10.7	14.9	21.5	985,805.4	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOx, Ppm	Unit CT1 NOx, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/12/2022 00:00	0	1.7	6.6	14.4	8.4	789,209.8	0.00	1.00
09/12/2022 01:00	2	1.7	9.7	14.7	17.5	646,500.8	0.00	1.00
09/12/2022 02:00	1	1.7	10.0	14.8	16.0	644,078.5	0.00	1.00
09/12/2022 03:00	2	1.7	10.1	14.8	17.3	640,262.0	0.00	1.00
09/12/2022 04:00	0	1.7	7.7	14.6	11.3	830,349.4	0.00	1.00
09/12/2022 05:00	1	1.7	6.7	14.5	13.8	948,754.3	0.00	1.00
09/12/2022 06:00	1	1.7	7.4	14.5	14.8	851,824.8	0.00	1.00
09/12/2022 07:00	1	1.6	8.7	14.5	13.7	688,777.7	0.00	1.00
09/12/2022 08:00	2	1.7	10.1	14.7	17.4	632,806.6	0.00	1.00
09/12/2022 09:00	1	1.7	9.3	14.8	14.7	645,649.9	0.00	1.00
09/12/2022 10:00	1	1.6	8.9	14.7	13.7	647,163.5	0.00	1.00
09/12/2022 11:00	0	1.6	7.5	14.7	10.7	822,538.1	0.00	1.00
09/12/2022 12:00	0	1.7	6.5	14.6	10.7	955,553.9	0.00	1.00
09/12/2022 13:00	0	1.7	6.3	14.5	7.9	816,733.3	0.00	1.00
09/12/2022 14:00	0	1.7	6.2	14.5	7.1	818,873.0	0.00	1.00
09/12/2022 15:00	1	1.7	7.0	14.6	11.5	839,478.9	0.00	1.00
09/12/2022 16:00	1	1.7	6.8	14.5	11.2	855,676.3	0.00	1.00
09/12/2022 17:00	0	1.7	6.5	14.6	11.3	957,510.2	0.00	1.00
09/12/2022 18:00	1	1.7	6.3	14.5	12.0	924,147.5	0.00	1.00
09/12/2022 19:00	1	1.7	6.3	14.6	13.0	943,381.2	0.00	1.00
09/12/2022 20:00	1	1.7	6.4	14.6	13.5	956,858.1	0.00	1.00
09/12/2022 21:00	1	1.7	6.6	14.5	14.0	931,850.5	0.00	1.00
09/12/2022 22:00	1	1.7	8.5	14.6	15.8	762,312.9	0.00	1.00
09/12/2022 23:00	1	1.7	6.3	14.4	9.9	828,396.4	0.00	1.00
Average/Sum#:	1	1.7	7.6	14.6	12.8	807,445.3	0.00 #	24.00 #
Minimum:	0	1.6	6.2	14.4	7.1	632,806.6	0.00	1.00
Maximum:	2	1.7	10.1	14.8	17.5	957,510.2	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOx, Ppm	Unit CT1 NOx, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/13/2022 00:00	1	1.8	6.5	14.4	11.6	830,503.2	0.00	1.00
09/13/2022 01:00	1	1.7	8.3	14.5	14.8	697,978.5	0.00	1.00
09/13/2022 02:00	2	1.7	10.2	14.6	17.7	645,585.8	0.00	1.00
09/13/2022 03:00	1	1.6	7.0	14.4	10.3	830,924.6	0.00	1.00
09/13/2022 04:00	1	1.9	8.4	14.0	20.5	982,214.7	0.00	1.00
09/13/2022 05:00	2	1.9	8.7	13.9	21.5	988,137.5	0.00	1.00
09/13/2022 06:00	1	1.8	7.6	14.2	17.0	925,485.6	0.00	1.00
09/13/2022 07:00	1	1.7	7.9	14.5	14.6	779,288.1	0.00	1.00
09/13/2022 08:00	2	1.7	9.4	14.6	17.4	663,192.7	0.00	1.00
09/13/2022 09:00	2	1.6	10.5	14.7	17.6	627,063.8	0.00	1.00
09/13/2022 10:00	1	1.7	8.8	14.7	13.0	647,384.3	0.00	1.00
09/13/2022 11:00	1	1.7	8.6	14.7	14.0	650,476.6	0.00	1.00
09/13/2022 12:00	2	1.6	10.1	14.8	17.3	635,323.1	0.00	1.00
09/13/2022 13:00	2	1.6	10.2	14.8	17.1	629,261.7	0.00	1.00
09/13/2022 14:00	1	1.7	9.5	14.8	15.1	640,486.5	0.00	1.00
09/13/2022 15:00	1	1.6	10.0	14.8	16.3	631,955.7	0.00	1.00
09/13/2022 16:00	1	1.6	8.6	14.7	12.7	773,724.8	0.00	1.00
09/13/2022 17:00	1	1.9	8.5	14.0	18.0	987,771.8	0.00	1.00
09/13/2022 18:00	1	1.8	8.2	14.1	18.9	981,555.1	0.00	1.00
09/13/2022 19:00	1	1.8	8.1	14.1	19.1	982,562.0	0.00	1.00
09/13/2022 20:00	1	1.8	7.9	14.2	19.2	987,620.7	0.00	1.00
09/13/2022 21:00	1	1.8	7.6	14.3	18.4	973,121.3	0.00	1.00
09/13/2022 22:00	2	1.7	9.8	14.6	18.3	655,584.8	0.00	1.00
09/13/2022 23:00	0	1.7	6.7	14.4	8.8	767,088.3	0.00	1.00
Average/Sum#:	1	1.7	8.6	14.5	16.2	788,095.5	0.00 #	24.00 #
Minimum:	0	1.6	6.5	13.9	8.8	627,063.8	0.00	1.00
Maximum:	2	1.9	10.5	14.8	21.5	988,137.5	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOx, Ppm	Unit CT1 NOx, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/14/2022 00:00	2	1.8	8.0	14.4	14.9	700,723.9	0.00	1.00
09/14/2022 01:00	2	1.8	8.9	14.4	16.4	661,958.7	0.00	1.00
09/14/2022 02:00	1	1.7	8.6	14.4	15.2	669,753.9	0.00	1.00
09/14/2022 03:00	2	1.8	7.2	14.4	13.5	782,889.4	0.00	1.00
09/14/2022 04:00	1	1.7	6.9	14.4	14.9	849,043.1	0.00	1.00
09/14/2022 05:00	1	1.7	6.7	14.5	16.5	933,990.2	0.00	1.00
09/14/2022 06:00	2	1.7	9.4	14.5	21.0	755,109.2	0.00	1.00
09/14/2022 07:00	3	1.7	11.9	14.7	22.3	623,088.1	0.00	1.00
09/14/2022 08:00	3	1.6	12.5	14.8	23.1	620,955.4	0.00	1.00
09/14/2022 09:00	3	1.7	12.5	14.8	23.2	617,139.0	0.00	1.00
09/14/2022 10:00	2	1.7	11.8	14.8	20.7	625,445.3	0.00	1.00
09/14/2022 11:00	2	1.7	11.2	14.8	19.7	629,261.7	0.00	1.00
09/14/2022 12:00	2	1.7	11.1	14.8	19.3	627,465.8	0.00	1.00
09/14/2022 13:00	2	1.6	11.1	14.8	19.3	625,894.3	0.00	1.00
09/14/2022 14:00	2	1.6	11.1	14.8	19.2	626,118.8	0.00	1.00
09/14/2022 15:00	2	1.6	10.9	14.9	18.5	636,097.6	0.00	1.00
09/14/2022 16:00	1	1.6	10.1	14.8	15.3	638,915.0	0.00	1.00
09/14/2022 17:00	1	1.6	8.2	14.7	12.0	692,442.8	0.00	1.00
09/14/2022 18:00	1	1.7	7.4	14.4	10.0	730,851.3	0.00	1.00
09/14/2022 19:00	1	1.7	8.2	14.5	15.2	746,978.2	0.00	1.00
09/14/2022 20:00	1	1.7	8.1	14.5	14.3	737,563.4	0.00	1.00
09/14/2022 21:00	2	1.7	8.0	14.5	14.9	746,122.3	0.00	1.00
09/14/2022 22:00	2	1.7	10.1	14.7	18.3	637,445.0	0.00	1.00
09/14/2022 23:00	2	1.7	8.9	14.6	15.4	660,801.6	0.00	1.00
Average/Sum#:	2	1.7	9.5	14.6	17.2	690,668.9	0.00 #	24.00 #
Minimum:	1	1.6	6.7	14.4	10.0	617,139.0	0.00	1.00
Maximum:	3	1.8	12.5	14.9	23.2	933,990.2	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:	> 10							
	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1
	NH3Slip, Ppmvdc	NOx, Ppm	NOx, _SCR, Ppm	O2, Dry, Pct	NH3Inj, LbPerHr	ExhaustFlow, LbPerHr	SUSD, Hr	OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/15/2022 00:00	2	1.7	10.3	14.7	19.8	636,782.3	0.00	1.00
09/15/2022 01:00	1	1.6	9.3	14.6	15.4	651,889.5	0.00	1.00
09/15/2022 02:00	2	1.6	9.3	14.6	17.8	658,845.3	0.00	1.00
09/15/2022 03:00	1	1.7	8.4	14.5	13.8	717,877.9	0.00	1.00
09/15/2022 04:00	1	1.7	7.4	14.5	14.9	812,239.8	0.00	1.00
09/15/2022 05:00	1	1.8	6.7	14.5	15.5	898,256.8	0.00	1.00
09/15/2022 06:00	3	1.7	10.0	14.6	23.6	737,532.8	0.00	1.00
09/15/2022 07:00	1	1.6	9.3	14.6	14.5	692,754.8	0.00	1.00
09/15/2022 08:00	3	1.6	12.2	14.8	22.6	627,465.8	0.00	1.00
09/15/2022 09:00	3	1.6	12.6	14.8	23.4	627,016.8	0.00	1.00
09/15/2022 10:00	0	1.6	7.3	14.4	9.2	855,574.2	0.00	1.00
09/15/2022 11:00	1	1.8	8.0	14.2	18.1	997,431.5	0.00	1.00
09/15/2022 12:00	2	1.7	9.1	14.6	16.6	722,969.1	0.00	1.00
09/15/2022 13:00	2	1.6	10.9	14.8	19.2	631,955.7	0.00	1.00
09/15/2022 14:00	1	1.6	8.7	14.7	12.4	687,804.4	0.00	1.00
09/15/2022 15:00	2	1.7	9.7	14.8	16.7	644,751.9	0.00	1.00
09/15/2022 16:00	2	1.6	10.7	14.8	17.7	643,405.0	0.00	1.00
09/15/2022 17:00	1	1.6	7.9	14.6	10.9	744,271.3	0.00	1.00
09/15/2022 18:00	2	1.7	9.6	14.7	16.9	660,857.7	0.00	1.00
09/15/2022 19:00	2	1.7	9.0	14.6	15.5	684,929.6	0.00	1.00
09/15/2022 20:00	2	1.7	9.6	14.6	16.5	663,410.0	0.00	1.00
09/15/2022 21:00	2	1.7	9.4	14.6	17.6	675,582.7	0.00	1.00
09/15/2022 22:00	2	1.7	10.3	14.6	18.1	640,151.6	0.00	1.00
09/15/2022 23:00	2	1.7	10.5	14.7	20.0	635,457.1	0.00	1.00
Average/Sum#:	2	1.7	9.4	14.6	16.9	706,217.2	0.00 #	24.00 #
Minimum:	0	1.6	6.7	14.2	9.2	627,016.8	0.00	1.00
Maximum:	3	1.8	12.6	14.8	23.6	997,431.5	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:	> 10							
	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1
	NH3Slip, Ppmvdc	NOx, Ppm	NOx, _SCR, Ppm	O2, Dry, Pct	NH3Inj, LbPerHr	ExhaustFlow, LbPerHr	SUSD, Hr	OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/16/2022 00:00	3	1.7	10.9	14.7	21.8	630,597.8	0.00	1.00
09/16/2022 01:00	3	1.7	13.2	14.8	25.8	617,139.0	0.00	1.00
09/16/2022 02:00	3	1.6	13.9	14.8	27.1	616,914.5	0.00	1.00
09/16/2022 03:00	3	1.6	13.5	14.8	25.8	618,934.9	0.00	1.00
09/16/2022 04:00	2	1.7	11.0	14.7	20.8	635,236.2	0.00	1.00
09/16/2022 05:00	1	1.7	8.7	14.5	14.7	740,559.0	0.00	1.00
09/16/2022 06:00	3	1.7	10.7	14.5	23.1	691,773.3	0.00	1.00
09/16/2022 07:00	4	1.7	14.4	14.8	30.4	615,343.0	0.00	1.00
09/16/2022 08:00	3	1.6	12.6	14.8	22.9	623,200.3	0.00	1.00
09/16/2022 09:00	3	1.7	12.8	14.8	23.6	616,690.0	0.00	1.00
09/16/2022 10:00	2	1.7	12.3	14.8	22.3	617,363.5	0.00	1.00
09/16/2022 11:00	2	1.6	11.7	14.9	20.0	631,989.4	0.00	1.00
09/16/2022 12:00	2	1.6	12.0	14.9	22.3	626,968.1	0.00	1.00
09/16/2022 13:00	2	1.6	11.7	14.9	20.1	626,968.1	0.00	1.00
09/16/2022 14:00	1	1.5	9.3	14.7	12.7	661,078.6	0.00	1.00
09/16/2022 15:00	2	1.6	11.2	14.8	20.7	628,812.7	0.00	1.00
09/16/2022 16:00	2	1.6	11.2	14.9	18.0	633,815.3	0.00	1.00
09/16/2022 17:00	1	1.6	9.4	14.8	14.2	642,956.0	0.00	1.00
09/16/2022 18:00	1	1.7	9.2	14.8	14.7	644,527.4	0.00	1.00
09/16/2022 19:00	1	1.7	9.6	14.8	15.8	643,629.5	0.00	1.00
09/16/2022 20:00	2	1.7	9.9	14.7	17.4	633,469.2	0.00	1.00
09/16/2022 21:00	2	1.7	9.9	14.7	17.4	632,144.0	0.00	1.00
09/16/2022 22:00	2	1.6	10.7	14.7	19.4	622,425.5	0.00	1.00
09/16/2022 23:00	2	1.7	10.4	14.7	18.4	631,039.6	0.00	1.00
Average/Sum#:	2	1.7	11.3	14.8	20.4	636,815.6	0.00 #	24.00 #
Minimum:	1	1.5	8.7	14.5	12.7	615,343.0	0.00	1.00
Maximum:	4	1.7	14.4	14.9	30.4	740,559.0	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:	> 10							
	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1
	NH3Slip, Ppmvdc	NOx, Ppm	NOx, _SCR, Ppm	O2, Dry, Pct	NH3Inj, LbPerHr	ExhaustFlow, LbPerHr	SUSD, Hr	OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/17/2022 00:00	2	1.7	10.6	14.7	19.3	633,469.2	0.00	1.00
09/17/2022 01:00	2	1.7	10.7	14.7	20.0	634,573.6	0.00	1.00
09/17/2022 02:00	2	1.7	11.3	14.7	20.5	634,131.8	0.00	1.00
09/17/2022 03:00	3	1.7	10.9	14.7	20.7	634,352.7	0.00	1.00
09/17/2022 04:00	2	1.7	10.3	14.6	19.2	641,673.1	0.00	1.00
09/17/2022 05:00	2	1.7	10.9	14.7	21.1	634,352.7	0.00	1.00
09/17/2022 06:00	4	1.7	13.8	14.8	28.6	615,567.5	0.00	1.00
09/17/2022 07:00	3	1.7	13.2	14.8	24.6	616,690.0	0.00	1.00
09/17/2022 08:00	3	1.7	12.6	14.8	22.9	616,465.5	0.00	1.00
09/17/2022 09:00	2	1.7	12.2	14.8	22.3	617,139.0	0.00	1.00
09/17/2022 10:00	2	1.7	11.9	14.8	21.0	617,363.5	0.00	1.00
09/17/2022 11:00	2	1.7	11.6	14.8	20.4	618,710.4	0.00	1.00
09/17/2022 12:00	2	1.6	11.6	14.8	20.2	618,710.4	0.00	1.00
09/17/2022 13:00	2	1.6	11.8	14.8	20.6	615,567.5	0.00	1.00
09/17/2022 14:00	2	1.6	11.7	14.9	20.2	625,142.2	0.00	1.00
09/17/2022 15:00	2	1.6	11.9	14.9	20.7	625,598.7	0.00	1.00
09/17/2022 16:00	1	1.6	10.9	14.8	16.6	645,874.4	0.00	1.00
09/17/2022 17:00	1	1.7	8.8	14.6	13.4	677,539.0	0.00	1.00
09/17/2022 18:00	2	1.7	10.3	14.7	19.4	633,469.2	0.00	1.00
09/17/2022 19:00	3	1.7	12.1	14.8	24.2	621,179.9	0.00	1.00
09/17/2022 20:00	2	1.6	11.8	14.8	21.0	627,241.3	0.00	1.00
09/17/2022 21:00	2	1.7	9.5	14.5	15.6	651,118.5	0.00	1.00
09/17/2022 22:00	2	1.7	9.7	14.6	17.8	657,541.1	0.00	1.00
09/17/2022 23:00	2	1.7	10.5	14.7	19.6	633,911.0	0.00	1.00
Average/Sum#:	2	1.7	11.3	14.7	20.4	631,140.9	0.00 #	24.00 #
Minimum:	1	1.6	8.8	14.5	13.4	615,567.5	0.00	1.00
Maximum:	4	1.7	13.8	14.9	28.6	677,539.0	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10								
	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOx, Ppm	Unit CT1 NOx, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/18/2022 00:00	2	1.7	10.5	14.7	19.7	633,911.0	0.00	1.00
09/18/2022 01:00	2	1.7	10.3	14.7	19.4	635,236.2	0.00	1.00
09/18/2022 02:00	2	1.7	10.5	14.7	18.6	635,457.1	0.00	1.00
09/18/2022 03:00	2	1.7	10.4	14.7	19.8	634,794.5	0.00	1.00
09/18/2022 04:00	3	1.7	11.6	14.7	23.4	618,670.6	0.00	1.00
09/18/2022 05:00	3	1.7	12.6	14.8	24.3	616,465.5	0.00	1.00
09/18/2022 06:00	2	1.7	10.6	14.7	17.7	634,352.7	0.00	1.00
09/18/2022 07:00	2	1.7	10.2	14.6	16.8	631,456.8	0.00	1.00
09/18/2022 08:00	2	1.7	10.3	14.7	18.4	634,794.5	0.00	1.00
09/18/2022 09:00	2	1.7	10.0	14.7	17.2	633,911.0	0.00	1.00
09/18/2022 10:00	2	1.7	10.6	14.8	18.0	636,445.6	0.00	1.00
09/18/2022 11:00	1	1.7	9.5	14.7	14.3	657,102.8	0.00	1.00
09/18/2022 12:00	1	1.6	9.0	14.6	14.4	710,144.4	0.00	1.00
09/18/2022 13:00	1	1.7	7.7	14.5	13.4	776,506.4	0.00	1.00
09/18/2022 14:00	1	1.7	8.4	14.5	13.1	669,734.1	0.00	1.00
09/18/2022 15:00	2	1.7	9.2	14.6	16.7	653,193.7	0.00	1.00
09/18/2022 16:00	1	1.7	8.7	14.6	14.5	776,659.3	0.00	1.00
09/18/2022 17:00	1	1.8	6.4	14.4	12.9	858,102.4	0.00	1.00
09/18/2022 18:00	1	1.8	6.3	14.4	12.7	840,405.2	0.00	1.00
09/18/2022 19:00	1	1.8	6.4	14.5	14.4	887,772.2	0.00	1.00
09/18/2022 20:00	1	1.8	6.6	14.5	14.8	910,881.2	0.00	1.00
09/18/2022 21:00	2	1.8	7.6	14.5	19.1	891,623.7	0.00	1.00
09/18/2022 22:00	3	1.7	10.9	14.7	21.1	620,879.3	0.00	1.00
09/18/2022 23:00	2	1.7	9.7	14.7	17.0	634,352.7	0.00	1.00
Average/Sum#:	2	1.7	9.3	14.6	17.2	701,368.9	0.00 #	24.00 #
Minimum:	1	1.6	6.3	14.4	12.7	616,465.5	0.00	1.00
Maximum:	3	1.8	12.6	14.8	24.3	910,881.2	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOx, Ppm	Unit CT1 NOx, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/19/2022 00:00	2	1.8	9.6	14.7	18.6	636,561.5	0.00	1.00
09/19/2022 01:00	2	1.8	9.7	14.6	18.7	627,326.8	0.00	1.00
09/19/2022 02:00	2	1.8	9.9	14.7	18.0	637,445.0	0.00	1.00
09/19/2022 03:00	3	1.6	10.0	14.6	20.7	625,805.2	0.00	1.00
09/19/2022 04:00	1	1.6	7.9	14.5	14.3	733,925.9	0.00	1.00
09/19/2022 05:00	1	1.8	6.4	14.5	15.5	906,601.7	0.00	1.00
09/19/2022 06:00	1	1.8	6.5	14.4	13.8	837,034.3	0.00	1.00
09/19/2022 07:00	1	1.8	6.7	14.5	16.1	907,885.6	0.00	1.00
09/19/2022 08:00	2	1.8	7.2	14.5	19.6	985,557.6	0.00	1.00
09/19/2022 09:00	2	1.8	7.9	14.5	16.3	746,336.3	0.00	1.00
09/19/2022 10:00	2	1.7	9.3	14.7	16.2	637,445.0	0.00	1.00
09/19/2022 11:00	1	1.7	8.5	14.5	13.9	671,445.9	0.00	1.00
09/19/2022 12:00	2	1.8	8.7	14.5	15.6	644,057.4	0.00	1.00
09/19/2022 13:00	2	1.8	8.5	14.5	14.7	656,253.8	0.00	1.00
09/19/2022 14:00	2	1.7	8.9	14.6	15.6	648,628.9	0.00	1.00
09/19/2022 15:00	2	1.8	9.3	14.7	16.9	635,898.8	0.00	1.00
09/19/2022 16:00	1	1.8	7.8	14.3	15.0	840,743.6	0.00	1.00
09/19/2022 17:00	2	2.2	11.3	12.8	28.4	999,172.6	0.00	1.00
09/19/2022 18:00	2	2.1	10.2	13.1	26.2	983,176.5	0.00	1.00
09/19/2022 19:00	2	2.0	9.5	13.4	24.7	983,977.1	0.00	1.00
09/19/2022 20:00	2	2.0	8.9	13.7	23.9	997,968.0	0.00	1.00
09/19/2022 21:00	2	1.9	8.2	13.9	21.0	982,268.5	0.00	1.00
09/19/2022 22:00	2	1.7	7.8	14.3	18.4	841,158.6	0.00	1.00
09/19/2022 23:00	1	1.8	6.2	14.4	13.4	833,242.1	0.00	1.00
Average/Sum#:	2	1.8	8.5	14.3	18.1	791,663.2	0.00 #	24.00 #
Minimum:	1	1.6	6.2	12.8	13.4	625,805.2	0.00	1.00
Maximum:	3	2.2	11.3	14.7	28.4	999,172.6	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:	> 10							
	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1
	NH3Slip, Ppmvdc	NOx, Ppm	NOx, _SCR, Ppm	O2, Dry, Pct	NH3Inj, LbPerHr	ExhaustFlow, LbPerHr	SUSD, Hr	OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/20/2022 00:00	2	1.8	6.4	14.4	15.4	807,539.0	0.00	1.00
09/20/2022 01:00	3	1.7	7.8	14.5	18.6	696,266.7	0.00	1.00
09/20/2022 02:00	1	1.6	9.5	14.6	18.4	663,410.0	0.00	1.00
09/20/2022 03:00	2	1.8	6.7	14.5	15.8	903,606.1	0.00	1.00
09/20/2022 04:00	1	1.7	6.8	14.5	18.2	981,278.2	0.00	1.00
09/20/2022 05:00	2	1.8	6.8	14.5	18.4	969,723.6	0.00	1.00
09/20/2022 06:00	2	1.8	7.8	14.4	17.9	740,753.3	0.00	1.00
09/20/2022 07:00	3	1.7	10.0	14.6	20.2	637,977.9	0.00	1.00
09/20/2022 08:00	2	1.7	10.0	14.6	17.8	646,890.0	0.00	1.00
09/20/2022 09:00	2	1.8	9.8	14.6	17.6	637,108.4	0.00	1.00
09/20/2022 10:00	3	1.7	12.2	14.8	23.7	619,832.9	0.00	1.00
09/20/2022 11:00	1	1.6	8.0	14.6	10.2	741,010.7	0.00	1.00
09/20/2022 12:00	2	1.8	9.3	14.6	16.1	647,976.8	0.00	1.00
09/20/2022 13:00	2	1.8	9.4	14.7	16.6	646,059.1	0.00	1.00
09/20/2022 14:00	2	1.7	9.2	14.7	15.3	639,874.6	0.00	1.00
09/20/2022 15:00	2	1.7	10.1	14.7	17.1	627,726.5	0.00	1.00
09/20/2022 16:00	1	1.7	8.1	14.4	12.0	815,966.3	0.00	1.00
09/20/2022 17:00	2	2.2	11.1	13.0	25.6	1,005,573.5	0.00	1.00
09/20/2022 18:00	2	2.2	11.4	12.8	27.9	996,298.5	0.00	1.00
09/20/2022 19:00	2	2.1	10.2	13.2	25.3	987,764.0	0.00	1.00
09/20/2022 20:00	2	2.1	10.5	13.2	26.9	1,005,726.6	0.00	1.00
09/20/2022 21:00	2	2.1	10.4	13.2	27.2	999,857.6	0.00	1.00
09/20/2022 22:00	2	2.0	9.0	13.7	24.2	993,213.1	0.00	1.00
09/20/2022 23:00	1	1.7	6.6	14.5	16.4	953,033.8	0.00	1.00
Average/Sum#:	2	1.8	9.0	14.2	19.3	806,852.8	0.00 #	24.00 #
Minimum:	1	1.6	6.4	12.8	10.2	619,832.9	0.00	1.00
Maximum:	3	2.2	12.2	14.8	27.9	1,005,726.6	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOx, Ppm	Unit CT1 NOx, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/21/2022 00:00	2	1.8	6.8	14.4	18.1	932,472.7	0.00	1.00
09/21/2022 01:00	2	1.8	6.6	14.4	15.7	827,343.0	0.00	1.00
09/21/2022 02:00	2	1.7	7.2	14.4	15.0	835,348.9	0.00	1.00
09/21/2022 03:00	2	1.7	7.4	14.5	20.5	990,265.0	0.00	1.00
09/21/2022 04:00	2	1.7	7.3	14.5	19.8	990,479.0	0.00	1.00
09/21/2022 05:00	2	1.8	7.3	14.5	20.3	981,278.2	0.00	1.00
09/21/2022 06:00	2	1.7	8.0	14.5	18.5	813,737.6	0.00	1.00
09/21/2022 07:00	1	1.7	6.9	14.5	17.6	961,378.7	0.00	1.00
09/21/2022 08:00	1	1.7	6.5	14.5	16.1	931,850.5	0.00	1.00
09/21/2022 09:00	2	1.8	6.4	14.5	16.6	909,169.4	0.00	1.00
09/21/2022 10:00	1	1.7	8.0	14.4	14.1	704,726.9	0.00	1.00
09/21/2022 11:00	1	1.7	6.4	14.4	13.8	860,419.9	0.00	1.00
09/21/2022 12:00	2	1.7	9.4	14.6	17.2	641,021.0	0.00	1.00
09/21/2022 13:00	2	1.6	10.6	14.7	19.6	637,886.7	0.00	1.00
09/21/2022 14:00	0	1.6	6.7	14.5	9.9	835,562.8	0.00	1.00
09/21/2022 15:00	2	1.7	10.1	14.7	18.5	634,131.8	0.00	1.00
09/21/2022 16:00	1	1.6	8.9	14.7	13.7	764,668.9	0.00	1.00
09/21/2022 17:00	1	1.7	6.4	14.5	11.9	880,283.1	0.00	1.00
09/21/2022 18:00	1	1.7	7.1	14.5	14.1	807,960.4	0.00	1.00
09/21/2022 19:00	2	1.7	8.3	14.5	17.2	732,214.1	0.00	1.00
09/21/2022 20:00	2	1.7	8.6	14.5	17.1	693,485.1	0.00	1.00
09/21/2022 21:00	2	1.7	10.2	14.7	20.4	634,573.6	0.00	1.00
09/21/2022 22:00	3	1.7	11.7	14.7	25.4	622,646.3	0.00	1.00
09/21/2022 23:00	2	1.7	10.3	14.7	19.3	638,107.6	0.00	1.00
Average/Sum#:	2	1.7	8.0	14.5	17.1	802,542.1	0.00 #	24.00 #
Minimum:	0	1.6	6.4	14.4	9.9	622,646.3	0.00	1.00
Maximum:	3	1.8	11.7	14.7	25.4	990,479.0	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOx, Ppm	Unit CT1 NOx, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/22/2022 00:00	3	1.7	10.5	14.6	21.0	629,065.7	0.00	1.00
09/22/2022 01:00	3	1.7	10.4	14.6	21.1	630,152.6	0.00	1.00
09/22/2022 02:00	3	1.7	11.0	14.6	22.0	627,544.2	0.00	1.00
09/22/2022 03:00	3	1.7	11.5	14.6	24.0	626,674.7	0.00	1.00
09/22/2022 04:00	2	1.7	9.6	14.5	17.5	695,196.8	0.00	1.00
09/22/2022 05:00	2	1.7	7.6	14.4	14.8	759,293.2	0.00	1.00
09/22/2022 06:00	2	1.6	9.6	14.5	19.7	713,384.5	0.00	1.00
09/22/2022 07:00	1	1.9	6.8	14.3	11.3	777,667.1	0.00	1.00
09/22/2022 08:00	1	1.8	6.7	14.4	13.1	780,571.9	0.00	1.00
09/22/2022 09:00	1	1.8	6.6	14.4	12.4	779,939.9	0.00	1.00
09/22/2022 10:00	1	1.8	6.5	14.4	11.9	779,939.9	0.00	1.00
09/22/2022 11:00	1	1.8	6.5	14.4	11.5	779,097.1	0.00	1.00
09/22/2022 12:00	1	1.8	6.4	14.4	10.4	780,993.3	0.00	1.00
09/22/2022 13:00	2	1.8	7.6	14.4	15.0	718,842.5	0.00	1.00
09/22/2022 14:00	2	1.7	10.8	14.8	18.5	628,812.7	0.00	1.00
09/22/2022 15:00	2	1.7	10.7	14.9	18.8	634,956.4	0.00	1.00
09/22/2022 16:00	1	1.6	9.3	14.7	13.1	686,920.9	0.00	1.00
09/22/2022 17:00	2	1.7	9.2	14.7	16.4	641,420.7	0.00	1.00
09/22/2022 18:00	2	1.7	9.1	14.7	15.6	645,396.5	0.00	1.00
09/22/2022 19:00	1	1.6	8.2	14.5	12.6	692,629.2	0.00	1.00
09/22/2022 20:00	1	1.7	7.6	14.5	13.4	753,825.3	0.00	1.00
09/22/2022 21:00	2	2.9	9.5	14.7	12.5	764,668.9	0.15	1.00
09/22/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
09/22/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	2	1.8	8.7	14.5	15.8	705,772.5	0.15 #	22.00 #
Minimum:	1	1.6	6.4	14.3	10.4	626,674.7	0.00	0.00
Maximum:	3	2.9	11.5	14.9	24.0	780,993.3	0.15	1.00
%SI	8.33	8.33	8.33	8.33	8.33	8.33	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:	> 10							
	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1	Unit CT1
	NH3Slip, Ppmvdc	NOx, Ppm	NOx, _SCR, Ppm	O2, Dry, Pct	NH3Inj, LbPerHr	ExhaustFlow, LbPerHr	SUSD, Hr	OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/23/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
09/23/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
09/23/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
09/23/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
09/23/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
09/23/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
09/23/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
09/23/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
09/23/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
09/23/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
09/23/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
09/23/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
09/23/2022 12:00	0	16.1	19.3	16.9	0.0	741,200.9	0.38	0.38
09/23/2022 13:00	1	2.9	7.3	14.4	8.3	768,563.1	0.58	1.00
09/23/2022 14:00	2	1.8	8.4	14.4	15.1	683,026.7	0.00	1.00
09/23/2022 15:00	1	1.7	7.1	14.6	13.6	958,814.4	0.00	1.00
09/23/2022 16:00	1	1.7	7.5	14.5	13.2	821,440.7	0.00	1.00
09/23/2022 17:00	1	1.9	8.5	13.9	18.7	981,681.7	0.00	1.00
09/23/2022 18:00	1	1.9	8.2	13.9	18.8	974,638.9	0.00	1.00
09/23/2022 19:00	1	1.9	8.1	14.0	19.3	983,802.4	0.00	1.00
09/23/2022 20:00	2	2.0	9.1	13.7	21.6	989,218.9	0.00	1.00
09/23/2022 21:00	2	2.0	9.3	13.5	23.1	980,804.0	0.00	1.00
09/23/2022 22:00	1	1.8	7.4	14.3	16.5	856,512.7	0.00	1.00
09/23/2022 23:00	1	1.8	6.5	14.4	13.2	845,882.9	0.00	1.00
Average/Sum#:	1	3.1	8.9	14.4	15.1	882,132.3	0.96 #	11.38 #
Minimum:	1	1.7	6.5	13.5	0.0	683,026.7	0.00	0.00
Maximum:	2	16.1	19.3	16.9	23.1	989,218.9	0.58	1.00
%SI	54.17	50.00	50.00	50.00	50.00	50.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOX, Ppm	Unit CT1 NOX, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/24/2022 00:00	2	1.7	8.0	14.5	17.8	733,497.9	0.00	1.00
09/24/2022 01:00	2	1.7	8.9	14.5	17.0	689,633.6	0.00	1.00
09/24/2022 02:00	1	1.8	7.1	14.4	11.6	787,945.7	0.00	1.00
09/24/2022 03:00	2	1.8	6.8	14.4	16.3	844,197.5	0.00	1.00
09/24/2022 04:00	2	1.8	6.9	14.5	18.0	906,815.7	0.00	1.00
09/24/2022 05:00	2	1.7	7.1	14.4	16.8	845,040.2	0.00	1.00
09/24/2022 06:00	4	1.7	13.1	14.7	30.7	652,685.3	0.00	1.00
09/24/2022 07:00	3	1.7	13.6	14.8	25.4	619,383.9	0.00	1.00
09/24/2022 08:00	3	1.7	12.5	14.8	23.2	619,608.4	0.00	1.00
09/24/2022 09:00	2	1.6	11.8	14.9	21.1	630,619.9	0.00	1.00
09/24/2022 10:00	2	1.6	11.3	14.9	19.7	630,848.2	0.00	1.00
09/24/2022 11:00	2	1.6	11.1	14.9	19.1	630,391.7	0.00	1.00
09/24/2022 12:00	1	1.6	10.4	14.8	16.5	635,547.6	0.00	1.00
09/24/2022 13:00	1	1.6	9.0	14.8	11.9	652,384.8	0.00	1.00
09/24/2022 14:00	0	1.6	7.6	14.6	10.8	838,826.8	0.00	1.00
09/24/2022 15:00	0	1.8	6.7	14.5	9.7	904,034.1	0.00	1.00
09/24/2022 16:00	1	1.8	6.9	14.4	11.6	871,164.6	0.00	1.00
09/24/2022 17:00	1	1.7	6.6	14.5	12.6	938,697.6	0.00	1.00
09/24/2022 18:00	1	1.7	6.4	14.5	11.0	853,108.6	0.00	1.00
09/24/2022 19:00	1	1.8	6.4	14.5	13.5	889,483.9	0.00	1.00
09/24/2022 20:00	1	1.7	6.9	14.6	16.0	973,812.9	0.00	1.00
09/24/2022 21:00	1	1.7	7.0	14.5	16.9	967,369.9	0.00	1.00
09/24/2022 22:00	1	1.7	6.8	14.5	16.0	933,134.3	0.00	1.00
09/24/2022 23:00	1	1.7	6.7	14.4	14.8	853,256.7	0.00	1.00
Average/Sum#:	2	1.7	8.6	14.6	16.6	787,562.1	0.00 #	24.00 #
Minimum:	0	1.6	6.4	14.4	9.7	619,383.9	0.00	1.00
Maximum:	4	1.8	13.6	14.9	30.7	973,812.9	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOx, Ppm	Unit CT1 NOx, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/25/2022 00:00	2	1.7	7.7	14.4	16.8	784,364.2	0.00	1.00
09/25/2022 01:00	2	1.6	8.6	14.5	17.2	724,297.1	0.00	1.00
09/25/2022 02:00	1	1.9	7.2	14.5	13.3	870,868.3	0.00	1.00
09/25/2022 03:00	2	1.7	8.7	14.6	19.5	744,271.3	0.00	1.00
09/25/2022 04:00	2	1.7	10.3	14.6	19.8	646,237.9	0.00	1.00
09/25/2022 05:00	3	1.6	10.3	14.5	21.5	652,830.3	0.00	1.00
09/25/2022 06:00	4	1.7	13.7	14.8	29.7	621,404.4	0.00	1.00
09/25/2022 07:00	3	1.7	13.1	14.8	24.2	617,139.0	0.00	1.00
09/25/2022 08:00	2	1.7	12.5	14.8	22.9	619,159.4	0.00	1.00
09/25/2022 09:00	2	1.6	11.6	14.9	20.4	629,250.5	0.00	1.00
09/25/2022 10:00	2	1.6	11.2	14.9	19.3	630,163.5	0.00	1.00
09/25/2022 11:00	2	1.6	10.8	14.9	18.5	630,391.7	0.00	1.00
09/25/2022 12:00	1	1.6	10.5	14.9	16.7	628,109.3	0.00	1.00
09/25/2022 13:00	0	1.6	9.1	14.9	11.2	646,824.8	0.00	1.00
09/25/2022 14:00	1	1.6	8.0	14.7	10.8	667,042.2	0.00	1.00
09/25/2022 15:00	1	1.6	8.1	14.7	11.1	708,787.6	0.00	1.00
09/25/2022 16:00	1	1.6	7.1	14.6	12.3	871,649.5	0.00	1.00
09/25/2022 17:00	0	1.7	6.4	14.6	11.0	937,729.6	0.00	1.00
09/25/2022 18:00	1	1.7	6.2	14.5	11.5	887,986.1	0.00	1.00
09/25/2022 19:00	1	1.7	6.4	14.5	11.7	861,025.6	0.00	1.00
09/25/2022 20:00	1	1.7	6.7	14.5	13.0	867,016.8	0.00	1.00
09/25/2022 21:00	1	1.7	7.5	14.5	14.7	797,261.8	0.00	1.00
09/25/2022 22:00	2	1.7	9.5	14.8	16.1	643,405.0	0.00	1.00
09/25/2022 23:00	2	1.7	9.3	14.7	16.0	640,537.2	0.00	1.00
Average/Sum#:	2	1.7	9.2	14.7	16.6	721,989.7	0.00 #	24.00 #
Minimum:	0	1.6	6.2	14.4	10.8	617,139.0	0.00	1.00
Maximum:	4	1.9	13.7	14.9	29.7	937,729.6	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOx, Ppm	Unit CT1 NOx, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/26/2022 00:00	2	1.7	9.3	14.6	15.8	644,498.9	0.00	1.00
09/26/2022 01:00	2	1.7	9.8	14.7	18.0	638,549.3	0.00	1.00
09/26/2022 02:00	2	1.7	10.3	14.7	18.8	637,665.8	0.00	1.00
09/26/2022 03:00	2	1.7	10.3	14.7	19.3	636,561.5	0.00	1.00
09/26/2022 04:00	1	1.7	8.2	14.5	14.1	745,266.4	0.00	1.00
09/26/2022 05:00	2	1.7	8.3	14.5	15.6	731,358.2	0.00	1.00
09/26/2022 06:00	3	1.7	11.5	14.7	25.5	633,248.3	0.00	1.00
09/26/2022 07:00	3	1.7	13.1	14.8	24.8	615,567.5	0.00	1.00
09/26/2022 08:00	3	1.7	12.7	14.8	23.9	615,567.5	0.00	1.00
09/26/2022 09:00	2	1.6	12.2	14.8	22.0	616,016.5	0.00	1.00
09/26/2022 10:00	2	1.6	11.6	14.9	20.4	625,826.9	0.00	1.00
09/26/2022 11:00	2	1.6	11.1	14.9	18.7	627,652.8	0.00	1.00
09/26/2022 12:00	0	1.6	9.4	14.8	11.6	634,200.6	0.00	1.00
09/26/2022 13:00	1	1.7	8.4	14.8	12.0	646,323.4	0.00	1.00
09/26/2022 14:00	1	1.6	7.8	14.7	10.1	684,491.3	0.00	1.00
09/26/2022 15:00	1	1.6	7.4	14.6	10.5	745,140.8	0.00	1.00
09/26/2022 16:00	1	1.7	7.3	14.5	10.2	765,807.8	0.00	1.00
09/26/2022 17:00	1	1.6	6.9	14.5	10.5	773,296.8	0.00	1.00
09/26/2022 18:00	1	1.7	8.9	14.8	14.8	646,996.9	0.00	1.00
09/26/2022 19:00	1	1.7	9.1	14.8	15.0	644,751.9	0.00	1.00
09/26/2022 20:00	2	1.7	9.4	14.8	16.1	651,037.8	0.00	1.00
09/26/2022 21:00	1	1.7	8.2	14.5	13.6	713,170.5	0.00	1.00
09/26/2022 22:00	1	1.7	8.4	14.6	13.8	765,356.1	0.00	1.00
09/26/2022 23:00	1	1.9	8.9	13.9	20.5	997,723.5	0.00	1.00
Average/Sum#:	2	1.7	9.5	14.7	16.5	684,836.5	0.00 #	24.00 #
Minimum:	0	1.6	6.9	13.9	10.1	615,567.5	0.00	1.00
Maximum:	3	1.9	13.1	14.9	25.5	997,723.5	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOx, Ppm	Unit CT1 NOx, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/27/2022 00:00	2	2.0	9.2	13.7	22.1	993,403.3	0.00	1.00
09/27/2022 01:00	2	1.9	9.1	13.8	22.3	987,914.3	0.00	1.00
09/27/2022 02:00	1	1.9	9.4	13.9	22.7	991,463.3	0.00	1.00
09/27/2022 03:00	2	1.9	8.9	14.0	22.9	993,725.8	0.00	1.00
09/27/2022 04:00	2	2.0	9.6	13.7	24.3	1,000,440.6	0.00	1.00
09/27/2022 05:00	2	2.0	10.0	13.4	26.7	996,941.0	0.00	1.00
09/27/2022 06:00	2	1.9	8.9	13.8	23.0	956,475.4	0.00	1.00
09/27/2022 07:00	2	1.8	8.9	14.4	21.5	893,075.4	0.00	1.00
09/27/2022 08:00	3	1.7	14.7	14.8	28.8	614,894.0	0.00	1.00
09/27/2022 09:00	3	1.6	13.5	14.8	25.0	615,792.0	0.00	1.00
09/27/2022 10:00	2	1.6	12.4	14.8	21.1	622,077.9	0.00	1.00
09/27/2022 11:00	0	1.7	7.9	14.5	11.2	854,392.4	0.00	1.00
09/27/2022 12:00	1	2.0	9.2	13.7	19.8	998,158.2	0.00	1.00
09/27/2022 13:00	1	1.9	8.1	14.1	18.3	993,638.2	0.00	1.00
09/27/2022 14:00	1	1.9	8.1	14.0	18.4	981,420.8	0.00	1.00
09/27/2022 15:00	1	1.8	7.8	14.2	17.2	963,706.9	0.00	1.00
09/27/2022 16:00	2	1.6	10.6	14.7	18.8	664,391.7	0.00	1.00
09/27/2022 17:00	1	1.6	9.6	14.7	15.0	736,396.9	0.00	1.00
09/27/2022 18:00	1	1.9	8.4	14.1	18.1	986,791.1	0.00	1.00
09/27/2022 19:00	1	1.8	8.4	14.1	19.2	984,978.6	0.00	1.00
09/27/2022 20:00	1	1.8	8.3	14.1	19.6	983,568.9	0.00	1.00
09/27/2022 21:00	1	1.9	8.6	14.1	20.3	998,068.7	0.00	1.00
09/27/2022 22:00	1	1.8	8.2	14.2	19.9	991,299.7	0.00	1.00
09/27/2022 23:00	1	1.7	6.9	14.5	16.2	924,575.4	0.00	1.00
Average/Sum#:	2	1.8	9.4	14.2	20.5	905,316.3	0.00 #	24.00 #
Minimum:	0	1.6	6.9	13.4	11.2	614,894.0	0.00	1.00
Maximum:	3	2.0	14.7	14.8	28.8	1,000,440.6	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOx, Ppm	Unit CT1 NOx, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/28/2022 00:00	1	1.7	6.8	14.5	16.2	902,964.2	0.00	1.00
09/28/2022 01:00	1	1.7	6.9	14.5	16.5	899,540.6	0.00	1.00
09/28/2022 02:00	1	1.9	7.3	14.5	16.0	901,466.4	0.00	1.00
09/28/2022 03:00	2	1.8	7.4	14.5	18.5	909,383.4	0.00	1.00
09/28/2022 04:00	2	1.7	7.4	14.5	18.7	918,798.2	0.00	1.00
09/28/2022 05:00	2	1.7	7.1	14.5	18.0	920,510.0	0.00	1.00
09/28/2022 06:00	2	1.7	7.8	14.5	18.7	888,628.0	0.00	1.00
09/28/2022 07:00	3	1.7	12.7	14.8	25.7	623,873.8	0.00	1.00
09/28/2022 08:00	3	1.7	13.3	14.8	25.1	617,139.0	0.00	1.00
09/28/2022 09:00	2	1.6	12.8	14.9	23.6	627,652.8	0.00	1.00
09/28/2022 10:00	2	1.6	11.9	14.9	20.8	634,043.5	0.00	1.00
09/28/2022 11:00	1	1.6	9.9	14.8	15.0	644,527.4	0.00	1.00
09/28/2022 12:00	1	1.6	9.7	14.8	14.9	643,629.5	0.00	1.00
09/28/2022 13:00	1	1.6	9.7	14.8	15.2	642,507.0	0.00	1.00
09/28/2022 14:00	1	1.6	8.2	14.7	11.8	729,549.8	0.00	1.00
09/28/2022 15:00	2	1.6	10.4	14.9	17.3	649,563.6	0.00	1.00
09/28/2022 16:00	2	1.6	11.7	15.0	20.6	643,165.2	0.00	1.00
09/28/2022 17:00	2	1.6	11.9	14.9	21.8	630,619.9	0.00	1.00
09/28/2022 18:00	1	1.6	10.0	14.8	15.9	639,139.5	0.00	1.00
09/28/2022 19:00	1	1.6	10.5	14.8	16.8	631,955.7	0.00	1.00
09/28/2022 20:00	1	1.7	9.5	14.8	15.6	647,445.9	0.00	1.00
09/28/2022 21:00	1	1.7	7.4	14.5	10.7	749,973.8	0.00	1.00
09/28/2022 22:00	1	1.7	7.2	14.5	12.0	798,331.6	0.00	1.00
09/28/2022 23:00	1	1.7	6.9	14.5	14.0	861,667.5	0.00	1.00
Average/Sum#:	2	1.7	9.4	14.7	17.5	739,836.5	0.00 #	24.00 #
Minimum:	1	1.6	6.8	14.5	10.7	617,139.0	0.00	1.00
Maximum:	3	1.9	13.3	15.0	25.7	920,510.0	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOx, Ppm	Unit CT1 NOx, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/29/2022 00:00	2	1.7	7.5	14.5	15.1	786,991.1	0.00	1.00
09/29/2022 01:00	2	1.7	9.2	14.6	16.7	674,713.2	0.00	1.00
09/29/2022 02:00	2	2.2	9.9	14.6	15.8	660,149.5	0.00	1.00
09/29/2022 03:00	2	1.7	8.8	14.4	15.7	681,552.0	0.00	1.00
09/29/2022 04:00	1	1.7	8.1	14.5	15.7	783,781.5	0.00	1.00
09/29/2022 05:00	2	1.7	7.4	14.5	16.4	863,379.3	0.00	1.00
09/29/2022 06:00	2	1.7	8.9	14.5	21.7	798,117.6	0.00	1.00
09/29/2022 07:00	1	1.7	6.9	14.4	10.8	823,340.1	0.00	1.00
09/29/2022 08:00	3	1.7	10.7	14.7	21.8	659,974.2	0.00	1.00
09/29/2022 09:00	2	1.7	11.2	14.8	21.3	637,343.6	0.00	1.00
09/29/2022 10:00	2	1.6	12.6	14.9	23.6	628,794.0	0.00	1.00
09/29/2022 11:00	2	1.6	11.3	14.9	18.6	637,010.6	0.00	1.00
09/29/2022 12:00	2	1.6	10.4	14.9	17.2	644,314.2	0.00	1.00
09/29/2022 13:00	1	1.6	8.6	14.7	12.2	675,435.4	0.00	1.00
09/29/2022 14:00	1	1.7	8.9	14.8	13.6	648,792.9	0.00	1.00
09/29/2022 15:00	1	1.6	9.4	14.8	14.2	657,772.7	0.00	1.00
09/29/2022 16:00	1	1.7	7.9	14.4	11.5	820,601.2	0.00	1.00
09/29/2022 17:00	1	1.9	8.7	13.9	17.4	981,094.8	0.00	1.00
09/29/2022 18:00	1	1.9	8.5	14.0	18.0	984,199.4	0.00	1.00
09/29/2022 19:00	1	1.9	8.4	14.0	18.9	981,023.9	0.00	1.00
09/29/2022 20:00	2	1.8	8.1	14.3	18.6	888,258.5	0.00	1.00
09/29/2022 21:00	2	1.7	9.9	14.7	16.9	650,476.6	0.00	1.00
09/29/2022 22:00	2	1.6	9.6	14.6	17.5	652,976.3	0.00	1.00
09/29/2022 23:00	1	1.7	6.5	14.5	12.4	875,575.7	0.00	1.00
Average/Sum#:	2	1.7	9.1	14.5	16.7	753,986.2	0.00 #	24.00 #
Minimum:	1	1.6	6.5	13.9	10.8	628,794.0	0.00	1.00
Maximum:	3	2.2	12.6	14.9	23.6	984,199.4	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT1



From: 07/01/2022 00:00 **To:** 09/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 10/01/2022 22:22 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT1 NH3Slip, Ppmvdc	Unit CT1 NOx, Ppm	Unit CT1 NOx, _SCR, Ppm	Unit CT1 O2, Dry, Pct	Unit CT1 NH3Inj, LbPerHr	Unit CT1 ExhaustFlow, LbPerHr	Unit CT1 SUSD, Hr	Unit CT1 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/30/2022 00:00	1	1.8	7.1	14.4	15.3	823,761.4	0.00	1.00
09/30/2022 01:00	2	1.8	6.8	14.4	15.3	806,064.3	0.00	1.00
09/30/2022 02:00	2	1.5	7.1	14.4	16.5	788,577.8	0.00	1.00
09/30/2022 03:00	2	1.5	7.8	14.4	17.8	760,346.6	0.00	1.00
09/30/2022 04:00	1	1.8	6.8	14.5	15.8	889,697.9	0.00	1.00
09/30/2022 05:00	2	1.7	7.0	14.5	19.0	954,317.6	0.00	1.00
09/30/2022 06:00	3	1.7	9.4	14.5	23.9	816,733.3	0.00	1.00
09/30/2022 07:00	3	1.5	14.1	14.8	28.0	621,179.9	0.00	1.00
09/30/2022 08:00	2	1.6	12.3	14.8	22.3	625,669.8	0.00	1.00
09/30/2022 09:00	2	1.5	12.2	14.8	22.5	621,179.9	0.00	1.00
09/30/2022 10:00	2	1.5	11.7	14.8	20.3	624,098.3	0.00	1.00
09/30/2022 11:00	2	1.5	11.8	14.9	21.9	629,022.3	0.00	1.00
09/30/2022 12:00	2	1.5	11.2	14.9	18.2	635,869.4	0.00	1.00
09/30/2022 13:00	2	1.5	11.4	14.9	20.6	628,565.8	0.00	1.00
09/30/2022 14:00	2	1.5	11.2	14.9	19.2	628,337.6	0.00	1.00
09/30/2022 15:00	1	1.5	10.6	14.9	16.3	636,097.6	0.00	1.00
09/30/2022 16:00	1	1.5	8.2	14.7	11.2	799,567.1	0.00	1.00
09/30/2022 17:00	0	1.7	6.7	14.5	8.4	847,759.3	0.00	1.00
09/30/2022 18:00	2	1.6	9.5	14.7	16.2	644,733.8	0.00	1.00
09/30/2022 19:00	2	1.6	9.6	14.8	16.9	649,690.8	0.00	1.00
09/30/2022 20:00	2	1.5	9.3	14.7	16.3	676,539.8	0.00	1.00
09/30/2022 21:00	1	1.6	7.7	14.5	14.2	790,414.6	0.00	1.00
09/30/2022 22:00	2	1.6	10.0	14.7	17.3	647,163.5	0.00	1.00
09/30/2022 23:00	1	1.6	6.6	14.5	12.2	886,916.3	0.00	1.00
Average/Sum#:	2	1.6	9.4	14.7	17.7	726,346.0	0.00 #	24.00 #
Minimum:	0	1.5	6.6	14.4	8.4	621,179.9	0.00	1.00
Maximum:	3	1.8	14.1	14.9	28.0	954,317.6	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:	> 10							
	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2
	NH3Slip, Ppmvdc	NOx, Ppm	NOx, _SCR, Ppm	O2, Dry, Pct	NH3Inj, LbPerHr	ExhaustFlow, LbPerHr	SUSD, Hr	OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/01/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/01/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/01/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/01/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/01/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/01/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/01/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/01/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/01/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/01/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/01/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/01/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/01/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/01/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/01/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/01/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/01/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/01/2022 17:00	0	11.9	15.8	15.7	2.1	846,936.3	0.72	0.72
07/01/2022 18:00	1	1.8	8.5	14.3	17.3	1,023,333.5	0.15	1.00
07/01/2022 19:00	1	1.8	9.3	14.0	18.7	1,043,541.1	0.00	1.00
07/01/2022 20:00	1	1.8	9.3	14.0	18.8	1,043,938.0	0.00	1.00
07/01/2022 21:00	1	1.8	9.3	14.1	18.9	1,052,241.5	0.00	1.00
07/01/2022 22:00	1	1.7	8.7	14.2	17.1	969,634.2	0.02	1.00
07/01/2022 23:00	0	11.0	29.3	15.7	0.0	559,093.8	0.13	0.13
Average/Sum#:	1	4.5	12.9	14.6	13.3	934,102.6	1.02 #	5.85 #
Minimum:	1	1.7	8.5	14.0	0.0	559,093.8	0.00	0.00
Maximum:	1	11.9	29.3	15.7	18.9	1,052,241.5	0.72	1.00
%SI	79.17	70.83	70.83	70.83	70.83	70.83	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT2 NH3Slip, Ppmvdc	Unit CT2 NOx, Ppm	Unit CT2 NOx, _SCR, Ppm	Unit CT2 O2, Dry, Pct	Unit CT2 NH3Inj, LbPerHr	Unit CT2 ExhaustFlow, LbPerHr	Unit CT2 SUSD, Hr	Unit CT2 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/02/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/02/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/02/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/02/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/02/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/02/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/02/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/02/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/02/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/02/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/02/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/02/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/02/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/02/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/02/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/02/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/02/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/02/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/02/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/02/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/02/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/02/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/02/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/02/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:	> 10							
	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2
	NH3Slip, Ppmvdc	NOx, Ppm	NOx, _SCR, Ppm	O2, Dry, Pct	NH3Inj, LbPerHr	ExhaustFlow, LbPerHr	SUSD, Hr	OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/03/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/03/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/03/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/03/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/03/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/03/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/03/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/03/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/03/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/03/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/03/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/03/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/03/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/03/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/03/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/03/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/03/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/03/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/03/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/03/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/03/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/03/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/03/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/03/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:	> 10							
	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2
	NH3Slip, Ppmvdc	NOx, Ppm	NOx, _SCR, Ppm	O2, Dry, Pct	NH3Inj, LbPerHr	ExhaustFlow, LbPerHr	SUSD, Hr	OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/04/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/04/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/04/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/04/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/04/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/04/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/04/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/04/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/04/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/04/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/04/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/04/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/04/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/04/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/04/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/04/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/04/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/04/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/04/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/04/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/04/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/04/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/04/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/04/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT2 NH3Slip, Ppmvdc	Unit CT2 NOx, Ppm	Unit CT2 NOx, _SCR, Ppm	Unit CT2 O2, Dry, Pct	Unit CT2 NH3Inj, LbPerHr	Unit CT2 ExhaustFlow, LbPerHr	Unit CT2 SUSD, Hr	Unit CT2 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/05/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/05/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/05/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/05/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/05/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/05/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/05/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/05/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/05/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/05/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/05/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/05/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/05/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/05/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/05/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/05/2022 15:00	0	12.9	15.5	15.8	0.1	719,082.1	0.70	0.70
07/05/2022 16:00	1	2.5	8.6	14.1	14.5	975,312.1	0.42	1.00
07/05/2022 17:00	0	1.8	9.5	13.9	17.8	1,030,980.9	0.00	1.00
07/05/2022 18:00	0	1.8	9.4	13.9	17.7	1,025,112.0	0.00	1.00
07/05/2022 19:00	0	1.8	9.3	14.0	17.7	1,039,373.3	0.00	1.00
07/05/2022 20:00	0	1.8	9.3	14.0	17.8	1,037,190.1	0.00	1.00
07/05/2022 21:00	1	2.2	12.4	14.4	16.5	828,607.1	0.12	1.00
07/05/2022 22:00	0	14.3	29.7	17.3	0.0	448,486.5	0.02	0.02
07/05/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	4.9	13.0	14.7	12.8	888,018.0	1.26 #	6.72 #
Minimum:	0	1.8	8.6	13.9	0.0	448,486.5	0.00	0.00
Maximum:	1	14.3	29.7	17.3	17.8	1,039,373.3	0.70	1.00
%SI	75.00	66.67	66.67	66.67	66.67	66.67	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:	> 10							
	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2
	NH3Slip, Ppmvdc	NOx, Ppm	NOx, _SCR, Ppm	O2, Dry, Pct	NH3Inj, LbPerHr	ExhaustFlow, LbPerHr	SUSD, Hr	OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/06/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/06/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/06/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/06/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/06/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/06/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/06/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/06/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/06/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/06/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/06/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/06/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/06/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/06/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/06/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/06/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/06/2022 16:00	0	10.2	12.2	19.3	0.0	730,074.4	0.15	0.15
07/06/2022 17:00	0	9.0	14.7	14.6	10.1	719,273.9	0.82	1.00
07/06/2022 18:00	0	1.6	8.4	14.3	12.8	1,001,339.7	0.00	1.00
07/06/2022 19:00	0	1.7	9.2	14.0	18.1	1,034,213.1	0.00	1.00
07/06/2022 20:00	0	1.7	9.1	14.1	18.3	1,047,005.5	0.00	1.00
07/06/2022 21:00	1	1.7	9.4	14.2	19.2	929,777.8	0.00	1.00
07/06/2022 22:00	0	5.1	22.5	15.4	9.8	601,799.8	0.15	0.27
07/06/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	4.4	12.2	15.1	12.6	866,212.0	1.12 #	5.42 #
Minimum:	0	1.6	8.4	14.0	0.0	601,799.8	0.00	0.00
Maximum:	1	10.2	22.5	19.3	19.2	1,047,005.5	0.82	1.00
%SI	75.00	70.83	70.83	70.83	70.83	70.83	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:	> 10							
	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2
	NH3Slip, Ppmvdc	NOx, Ppm	NOx, _SCR, Ppm	O2, Dry, Pct	NH3Inj, LbPerHr	ExhaustFlow, LbPerHr	SUSD, Hr	OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/07/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/07/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/07/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/07/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/07/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/07/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/07/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/07/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/07/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/07/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/07/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/07/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/07/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/07/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/07/2022 14:00	0	1.6	3.0	20.4	0.0	769,616.5	0.07	0.07
07/07/2022 15:00	1	9.7	15.4	14.9	6.8	724,653.7	0.82	1.00
07/07/2022 16:00	0	1.7	8.5	14.2	15.5	1,008,877.4	0.00	1.00
07/07/2022 17:00	1	1.8	9.8	13.8	19.6	1,038,448.0	0.00	1.00
07/07/2022 18:00	1	1.9	10.3	13.5	19.6	1,033,545.3	0.00	1.00
07/07/2022 19:00	1	1.8	9.1	14.0	18.0	1,036,197.8	0.00	1.00
07/07/2022 20:00	1	1.8	9.1	14.0	18.2	1,034,411.6	0.00	1.00
07/07/2022 21:00	1	1.8	9.0	14.0	18.3	1,037,190.1	0.00	1.00
07/07/2022 22:00	0	1.7	8.4	14.2	16.8	1,024,820.0	0.00	1.00
07/07/2022 23:00	2	3.2	16.1	14.8	17.6	690,100.1	0.13	0.53
Average/Sum#:	1	2.7	9.9	14.8	15.0	939,786.1	1.02 #	8.60 #
Minimum:	0	1.6	3.0	13.5	0.0	690,100.1	0.00	0.00
Maximum:	2	9.7	16.1	20.4	19.6	1,038,448.0	0.82	1.00
%SI	62.50	58.33	58.33	58.33	58.33	58.33	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:	> 10							
	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2
	NH3Slip, Ppmvdc	NOx, Ppm	NOx, _SCR, Ppm	O2, Dry, Pct	NH3Inj, LbPerHr	ExhaustFlow, LbPerHr	SUSD, Hr	OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/08/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/08/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/08/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/08/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/08/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/08/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/08/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/08/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/08/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/08/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/08/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/08/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/08/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/08/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/08/2022 14:00	0	9.9	14.5	15.3	5.6	706,720.8	0.88	0.88
07/08/2022 15:00	0	1.7	9.0	14.2	14.8	923,441.7	0.07	1.00
07/08/2022 16:00	0	1.7	10.0	14.0	18.7	798,235.5	0.00	1.00
07/08/2022 17:00	0	1.4	10.8	14.7	13.1	718,285.2	0.00	1.00
07/08/2022 18:00	1	3.5	18.0	15.0	17.1	636,666.3	0.13	0.50
07/08/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/08/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/08/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/08/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/08/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	3.6	12.5	14.6	13.9	756,669.9	1.08 #	4.38 #
Minimum:	0	1.4	9.0	14.0	5.6	636,666.3	0.00	0.00
Maximum:	1	9.9	18.0	15.3	18.7	923,441.7	0.88	1.00
%SI	83.33	79.17	79.17	79.17	79.17	79.17	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT2 NH3Slip, Ppmvdc	Unit CT2 NOx, Ppm	Unit CT2 NOx, _SCR, Ppm	Unit CT2 O2, Dry, Pct	Unit CT2 NH3Inj, LbPerHr	Unit CT2 ExhaustFlow, LbPerHr	Unit CT2 SUSD, Hr	Unit CT2 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/09/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/09/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/09/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/09/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/09/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/09/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/09/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/09/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/09/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/09/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/09/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/09/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/09/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/09/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/09/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/09/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/09/2022 16:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/09/2022 17:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/09/2022 18:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/09/2022 19:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/09/2022 20:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/09/2022 21:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/09/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/09/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	0.0	0.0	0.0	0.0	0.0	0.00 #	0.00 #
Minimum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Maximum:	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
%SI	100.00	100.00	100.00	100.00	100.00	100.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:	> 10							
	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2
	NH3Slip, Ppmvdc	NOx, Ppm	NOx, _SCR, Ppm	O2, Dry, Pct	NH3Inj, LbPerHr	ExhaustFlow, LbPerHr	SUSD, Hr	OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/10/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/10/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/10/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/10/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/10/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/10/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/10/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/10/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/10/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/10/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/10/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/10/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/10/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/10/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/10/2022 14:00	0	0.0	0.6	20.9	0.0	0.0	0.03	0.03
07/10/2022 15:00	1	9.1	14.1	15.2	5.9	776,487.7	0.75	1.00
07/10/2022 16:00	1	1.2	8.4	14.5	15.3	862,737.4	0.00	1.00
07/10/2022 17:00	0	1.5	8.0	14.5	13.1	980,208.3	0.00	1.00
07/10/2022 18:00	0	1.6	8.1	14.5	15.2	1,021,505.0	0.00	1.00
07/10/2022 19:00	0	1.6	8.0	14.5	14.7	1,024,500.6	0.00	1.00
07/10/2022 20:00	0	1.6	7.7	14.5	13.7	1,025,142.5	0.00	1.00
07/10/2022 21:00	0	1.6	7.8	14.4	13.7	951,644.6	0.00	1.00
07/10/2022 22:00	0	1.6	7.3	14.5	12.2	987,697.3	0.00	1.00
07/10/2022 23:00	0	1.6	7.8	14.5	14.5	1,037,552.9	0.00	1.00
Average/Sum#:	0	2.1	7.8	15.2	11.8	866,747.6	0.78 #	9.03 #
Minimum:	0	0.0	0.6	14.4	0.0	0.0	0.00	0.00
Maximum:	1	9.1	14.1	20.9	15.3	1,037,552.9	0.75	1.00
%SI	62.50	58.33	58.33	58.33	58.33	58.33	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10								
	Unit CT2 NH3Slip, Ppmvdc	Unit CT2 NOx, Ppm	Unit CT2 NOx, _SCR, Ppm	Unit CT2 O2, Dry, Pct	Unit CT2 NH3Inj, LbPerHr	Unit CT2 ExhaustFlow, LbPerHr	Unit CT2 SUSD, Hr	Unit CT2 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/11/2022 00:00	0	1.6	7.7	14.5	14.7	1,039,050.8	0.00	1.00
07/11/2022 01:00	0	1.6	7.7	14.5	15.2	1,043,972.1	0.00	1.00
07/11/2022 02:00	0	1.9	7.9	14.5	14.0	1,041,404.4	0.00	1.00
07/11/2022 03:00	0	1.6	7.6	14.5	14.3	1,042,474.3	0.00	1.00
07/11/2022 04:00	0	1.6	7.4	14.5	14.2	1,029,422.0	0.00	1.00
07/11/2022 05:00	1	1.6	8.7	14.5	15.8	906,815.7	0.00	1.00
07/11/2022 06:00	1	1.6	13.2	14.7	20.7	665,937.8	0.00	1.00
07/11/2022 07:00	1	1.6	13.9	14.8	20.7	661,364.6	0.00	1.00
07/11/2022 08:00	1	1.6	13.4	14.8	19.9	660,466.6	0.00	1.00
07/11/2022 09:00	1	1.5	12.6	14.8	18.9	661,813.6	0.00	1.00
07/11/2022 10:00	0	1.5	10.6	14.7	13.7	669,030.1	0.00	1.00
07/11/2022 11:00	0	1.5	8.2	14.6	8.9	761,443.4	0.00	1.00
07/11/2022 12:00	0	1.8	8.5	13.8	15.5	1,002,958.7	0.00	1.00
07/11/2022 13:00	1	1.9	9.5	13.4	19.3	1,011,730.7	0.00	1.00
07/11/2022 14:00	1	1.9	9.7	13.3	19.6	997,517.6	0.00	1.00
07/11/2022 15:00	1	1.9	9.8	13.3	20.1	1,006,166.5	0.00	1.00
07/11/2022 16:00	1	1.9	9.6	13.4	19.6	1,010,635.2	0.00	1.00
07/11/2022 17:00	1	1.9	9.7	13.4	19.7	1,010,452.6	0.00	1.00
07/11/2022 18:00	1	1.9	10.0	13.3	20.3	1,014,094.8	0.00	1.00
07/11/2022 19:00	1	1.9	9.9	13.4	20.3	1,023,964.3	0.00	1.00
07/11/2022 20:00	1	1.9	9.6	13.5	19.2	1,010,598.2	0.00	1.00
07/11/2022 21:00	1	1.8	9.0	13.8	18.1	1,023,982.3	0.00	1.00
07/11/2022 22:00	1	1.8	9.2	13.7	18.5	1,015,466.2	0.00	1.00
07/11/2022 23:00	1	1.8	9.0	13.8	18.1	1,023,982.3	0.00	1.00
Average/Sum#:	1	1.7	9.7	14.1	17.5	930,614.4	0.00 #	24.00 #
Minimum:	0	1.5	7.4	13.3	8.9	660,466.6	0.00	1.00
Maximum:	1	1.9	13.9	14.8	20.7	1,043,972.1	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
 Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:	> 10							
	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2
	NH3Slip, Ppmvdc	NOx, Ppm	NOx, _SCR, Ppm	O2, Dry, Pct	NH3Inj, LbPerHr	ExhaustFlow, LbPerHr	SUSD, Hr	OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/12/2022 00:00	1	1.8	9.3	13.8	19.2	1,038,448.0	0.00	1.00
07/12/2022 01:00	1	1.8	9.3	13.8	19.4	1,031,504.5	0.00	1.00
07/12/2022 02:00	1	1.9	9.2	13.9	18.5	1,034,502.3	0.00	1.00
07/12/2022 03:00	1	1.8	9.4	13.8	19.5	1,036,519.2	0.00	1.00
07/12/2022 04:00	1	1.8	9.8	13.7	20.4	1,048,180.2	0.00	1.00
07/12/2022 05:00	1	1.7	8.9	14.0	18.0	1,021,511.2	0.00	1.00
07/12/2022 06:00	1	1.6	12.1	14.5	21.7	749,759.9	0.00	1.00
07/12/2022 07:00	1	1.6	14.4	14.7	22.3	655,335.8	0.00	1.00
07/12/2022 08:00	1	1.6	14.4	14.8	22.3	660,017.7	0.00	1.00
07/12/2022 09:00	1	1.6	13.9	14.8	21.4	659,793.2	0.00	1.00
07/12/2022 10:00	1	1.5	12.0	14.8	16.7	674,385.4	0.00	1.00
07/12/2022 11:00	1	1.6	10.1	14.7	14.1	678,969.4	0.00	1.00
07/12/2022 12:00	1	1.5	9.2	14.6	12.3	712,318.0	0.00	1.00
07/12/2022 13:00	1	1.6	8.4	14.3	13.2	883,278.7	0.00	1.00
07/12/2022 14:00	1	1.9	9.5	13.5	19.7	1,017,630.4	0.00	1.00
07/12/2022 15:00	1	1.8	9.0	13.7	18.0	1,009,189.7	0.00	1.00
07/12/2022 16:00	1	1.8	9.2	13.6	19.0	1,011,122.9	0.00	1.00
07/12/2022 17:00	1	1.9	9.8	13.4	20.3	1,012,826.3	0.00	1.00
07/12/2022 18:00	1	1.9	9.3	13.6	18.9	1,009,059.4	0.00	1.00
07/12/2022 19:00	0	1.8	8.5	14.0	15.7	1,005,435.4	0.00	1.00
07/12/2022 20:00	0	1.8	7.6	14.3	14.5	995,945.0	0.00	1.00
07/12/2022 21:00	1	2.0	9.4	13.6	18.4	1,019,377.0	0.00	1.00
07/12/2022 22:00	0	1.7	8.2	14.4	13.0	900,027.8	0.00	1.00
07/12/2022 23:00	0	1.8	7.8	14.4	14.8	1,034,652.8	0.00	1.00
Average/Sum#:	1	1.7	9.9	14.1	18.0	912,491.3	0.00 #	24.00 #
Minimum:	0	1.5	7.6	13.4	12.3	655,335.8	0.00	1.00
Maximum:	1	2.0	14.4	14.8	22.3	1,048,180.2	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
 Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT2 NH3Slip, Ppmvdc	Unit CT2 NOx, Ppm	Unit CT2 NOx, _SCR, Ppm	Unit CT2 O2, Dry, Pct	Unit CT2 NH3Inj, LbPerHr	Unit CT2 ExhaustFlow, LbPerHr	Unit CT2 SUSD, Hr	Unit CT2 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/13/2022 00:00	0	1.8	7.8	14.4	15.8	1,038,234.4	0.00	1.00
07/13/2022 01:00	0	1.8	7.6	14.4	15.2	1,038,445.0	0.00	1.00
07/13/2022 02:00	0	1.7	7.8	14.4	15.6	1,038,234.4	0.00	1.00
07/13/2022 03:00	0	1.9	8.0	14.3	16.3	1,030,180.6	0.00	1.00
07/13/2022 04:00	1	2.2	11.1	13.2	23.7	1,056,413.1	0.00	1.00
07/13/2022 05:00	1	2.1	10.3	13.5	21.3	1,033,915.4	0.00	1.00
07/13/2022 06:00	1	1.9	8.3	14.2	16.4	971,065.0	0.00	1.00
07/13/2022 07:00	1	1.7	14.5	14.6	23.8	653,411.1	0.00	1.00
07/13/2022 08:00	1	1.7	14.1	14.7	21.5	662,624.7	0.00	1.00
07/13/2022 09:00	1	1.7	14.6	14.7	22.1	652,464.5	0.00	1.00
07/13/2022 10:00	1	1.7	13.9	14.7	21.4	651,581.0	0.00	1.00
07/13/2022 11:00	1	1.7	13.8	14.8	21.0	660,242.1	0.00	1.00
07/13/2022 12:00	1	1.7	13.5	14.8	20.2	660,466.6	0.00	1.00
07/13/2022 13:00	1	1.7	13.1	14.8	19.6	659,344.2	0.00	1.00
07/13/2022 14:00	1	1.6	11.5	14.7	16.1	703,486.6	0.00	1.00
07/13/2022 15:00	0	1.9	8.2	14.0	12.3	1,011,984.8	0.00	1.00
07/13/2022 16:00	1	2.0	8.8	13.8	16.8	1,022,246.4	0.00	1.00
07/13/2022 17:00	1	1.5	8.7	14.4	12.2	817,230.3	0.00	1.00
07/13/2022 18:00	0	2.0	8.4	14.1	15.2	1,025,658.6	0.00	1.00
07/13/2022 19:00	1	2.0	8.9	13.9	17.9	1,043,892.6	0.00	1.00
07/13/2022 20:00	1	2.1	9.8	13.5	19.5	1,040,947.6	0.00	1.00
07/13/2022 21:00	1	2.0	9.1	13.8	18.3	1,039,991.0	0.00	1.00
07/13/2022 22:00	1	1.9	8.8	14.0	18.0	1,040,365.6	0.00	1.00
07/13/2022 23:00	1	2.3	11.0	14.5	14.8	840,484.2	0.10	1.00
Average/Sum#:	1	1.9	10.5	14.3	18.1	891,371.2	0.10 #	24.00 #
Minimum:	0	1.5	7.6	13.2	12.2	651,581.0	0.00	1.00
Maximum:	1	2.3	14.6	14.8	23.8	1,056,413.1	0.10	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:	> 10							
	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2
	NH3Slip, Ppmvdc	NOx, Ppm	NOx, _SCR, Ppm	O2, Dry, Pct	NH3Inj, LbPerHr	ExhaustFlow, LbPerHr	SUSD, Hr	OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/14/2022 00:00	0	15.6	27.9	17.4	0.0	364,658.2	0.03	0.03
07/14/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/14/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/14/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/14/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/14/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/14/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/14/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/14/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/14/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/14/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/14/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/14/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/14/2022 13:00	4	10.1	14.9	15.6	10.8	691,946.9	0.75	0.87
07/14/2022 14:00	0	1.1	8.0	14.3	8.5	924,776.4	0.00	1.00
07/14/2022 15:00	1	1.9	9.5	13.5	19.1	1,003,010.8	0.00	1.00
07/14/2022 16:00	1	1.8	9.3	13.7	18.3	1,016,417.2	0.00	1.00
07/14/2022 17:00	1	2.0	9.7	13.4	18.6	1,008,626.7	0.00	1.00
07/14/2022 18:00	1	2.1	9.7	13.4	18.0	1,013,556.6	0.00	1.00
07/14/2022 19:00	1	2.0	9.0	13.8	17.3	1,027,454.0	0.00	1.00
07/14/2022 20:00	1	1.9	9.1	13.8	17.5	1,026,296.8	0.00	1.00
07/14/2022 21:00	1	1.9	9.1	13.9	18.1	1,035,284.8	0.00	1.00
07/14/2022 22:00	1	1.9	9.0	14.0	18.4	1,037,587.1	0.00	1.00
07/14/2022 23:00	1	1.9	8.9	14.0	18.3	1,039,770.2	0.00	1.00
Average/Sum#:	1	3.7	11.2	14.2	15.2	932,448.8	0.78 #	10.90 #
Minimum:	0	1.1	8.0	13.4	0.0	364,658.2	0.00	0.00
Maximum:	4	15.6	27.9	17.4	19.1	1,039,770.2	0.75	1.00
%SI	54.17	50.00	50.00	50.00	50.00	50.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10								
	Unit CT2 NH3Slip, Ppmvdc	Unit CT2 NOx, Ppm	Unit CT2 NOx, _SCR, Ppm	Unit CT2 O2, Dry, Pct	Unit CT2 NH3Inj, LbPerHr	Unit CT2 ExhaustFlow, LbPerHr	Unit CT2 SUSD, Hr	Unit CT2 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/15/2022 00:00	0	1.7	7.9	14.3	13.2	916,061.9	0.00	1.00
07/15/2022 01:00	0	1.8	8.0	14.4	16.2	1,049,400.4	0.00	1.00
07/15/2022 02:00	1	2.3	9.6	13.8	18.8	1,056,385.5	0.00	1.00
07/15/2022 03:00	1	1.8	8.9	14.1	18.6	1,050,026.3	0.00	1.00
07/15/2022 04:00	1	1.8	8.8	14.1	18.6	1,048,415.2	0.00	1.00
07/15/2022 05:00	1	1.9	9.3	13.9	19.6	1,051,913.6	0.00	1.00
07/15/2022 06:00	1	1.7	10.7	14.4	20.2	862,948.0	0.00	1.00
07/15/2022 07:00	1	1.7	14.9	14.7	23.3	657,323.7	0.00	1.00
07/15/2022 08:00	1	1.7	14.6	14.7	22.4	655,777.6	0.00	1.00
07/15/2022 09:00	1	1.7	14.1	14.7	21.2	655,556.7	0.00	1.00
07/15/2022 10:00	1	1.7	12.2	14.7	17.8	669,030.1	0.00	1.00
07/15/2022 11:00	0	1.6	11.1	14.7	14.6	676,098.1	0.00	1.00
07/15/2022 12:00	0	1.7	9.9	14.7	13.5	681,619.9	0.00	1.00
07/15/2022 13:00	0	1.6	7.8	14.5	10.2	858,030.0	0.00	1.00
07/15/2022 14:00	1	2.0	8.9	13.7	17.1	1,025,546.7	0.00	1.00
07/15/2022 15:00	1	2.0	9.0	13.7	17.9	1,023,644.7	0.00	1.00
07/15/2022 16:00	1	1.9	9.0	13.8	18.2	1,024,946.6	0.00	1.00
07/15/2022 17:00	1	2.0	9.8	13.5	20.7	1,033,360.2	0.00	1.00
07/15/2022 18:00	1	2.2	11.4	12.7	24.7	1,025,398.3	0.00	1.00
07/15/2022 19:00	1	2.1	10.8	13.0	22.3	1,025,508.2	0.00	1.00
07/15/2022 20:00	1	2.2	10.4	13.2	20.7	1,033,648.6	0.00	1.00
07/15/2022 21:00	1	2.2	10.3	13.3	20.4	1,041,663.5	0.00	1.00
07/15/2022 22:00	1	2.2	10.5	13.2	20.7	1,037,205.6	0.00	1.00
07/15/2022 23:00	1	2.1	9.7	13.6	19.1	1,043,013.6	0.00	1.00
Average/Sum#:	1	1.9	10.3	14.0	18.8	925,105.1	0.00 #	24.00 #
Minimum:	0	1.6	7.8	12.7	10.2	655,556.7	0.00	1.00
Maximum:	1	2.3	14.9	14.7	24.7	1,056,385.5	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10								
	Unit CT2 NH3Slip, Ppmvdc	Unit CT2 NOx, Ppm	Unit CT2 NOx, _SCR, Ppm	Unit CT2 O2, Dry, Pct	Unit CT2 NH3Inj, LbPerHr	Unit CT2 ExhaustFlow, LbPerHr	Unit CT2 SUSD, Hr	Unit CT2 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/16/2022 00:00	0	2.0	8.6	14.1	16.2	1,021,026.7	0.00	1.00
07/16/2022 01:00	0	1.9	7.3	14.4	10.9	941,531.9	0.00	1.00
07/16/2022 02:00	0	1.7	7.9	14.4	16.0	1,041,394.6	0.00	1.00
07/16/2022 03:00	1	1.9	8.0	14.4	14.3	1,044,765.5	0.00	1.00
07/16/2022 04:00	0	1.9	7.8	14.4	15.1	1,044,133.4	0.00	1.00
07/16/2022 05:00	1	1.7	9.0	14.4	15.5	902,556.0	0.00	1.00
07/16/2022 06:00	1	1.7	11.4	14.5	18.1	753,183.4	0.00	1.00
07/16/2022 07:00	1	1.7	14.3	14.7	21.6	654,010.6	0.00	1.00
07/16/2022 08:00	1	1.6	12.7	14.7	18.0	662,183.0	0.00	1.00
07/16/2022 09:00	0	1.6	11.1	14.7	15.1	676,760.7	0.00	1.00
07/16/2022 10:00	1	1.6	10.2	14.7	14.5	687,804.4	0.00	1.00
07/16/2022 11:00	0	1.7	10.2	14.7	13.6	677,423.3	0.00	1.00
07/16/2022 12:00	0	1.7	9.4	14.7	12.7	690,896.7	0.00	1.00
07/16/2022 13:00	0	1.6	7.9	14.6	9.4	839,261.5	0.00	1.00
07/16/2022 14:00	1	1.9	8.2	14.1	16.2	1,004,311.7	0.00	1.00
07/16/2022 15:00	1	2.3	11.4	12.7	24.9	1,017,716.1	0.00	1.00
07/16/2022 16:00	1	2.0	9.6	13.6	18.7	1,017,876.3	0.00	1.00
07/16/2022 17:00	1	2.1	10.3	13.2	21.8	1,016,931.0	0.00	1.00
07/16/2022 18:00	1	2.1	10.9	13.0	22.3	1,020,307.8	0.00	1.00
07/16/2022 19:00	1	2.0	9.7	13.6	18.8	1,028,006.2	0.00	1.00
07/16/2022 20:00	1	2.1	11.4	13.0	24.4	1,038,162.4	0.00	1.00
07/16/2022 21:00	1	2.2	11.6	12.8	24.8	1,037,550.3	0.00	1.00
07/16/2022 22:00	1	2.2	11.4	12.9	24.0	1,042,987.8	0.00	1.00
07/16/2022 23:00	1	2.1	10.4	13.3	21.1	1,036,257.8	0.00	1.00
Average/Sum#:	1	1.9	10.0	14.0	17.8	912,376.6	0.00 #	24.00 #
Minimum:	0	1.6	7.3	12.7	9.4	654,010.6	0.00	1.00
Maximum:	1	2.3	14.3	14.7	24.9	1,044,765.5	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:	> 10							
	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2
	NH3Slip, Ppmvdc	NOx, Ppm	NOx, _SCR, Ppm	O2, Dry, Pct	NH3Inj, LbPerHr	ExhaustFlow, LbPerHr	SUSD, Hr	OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/17/2022 00:00	1	2.2	11.5	12.8	24.6	1,037,043.1	0.00	1.00
07/17/2022 01:00	1	2.2	11.4	12.9	24.0	1,033,573.1	0.00	1.00
07/17/2022 02:00	1	1.7	11.5	13.0	26.1	1,049,949.8	0.00	1.00
07/17/2022 03:00	1	2.2	11.7	12.9	24.4	1,040,762.5	0.00	1.00
07/17/2022 04:00	1	2.1	11.2	13.1	23.0	1,036,373.4	0.00	1.00
07/17/2022 05:00	0	1.8	8.3	14.3	16.4	1,026,860.8	0.00	1.00
07/17/2022 06:00	1	1.7	8.7	14.4	15.4	910,140.5	0.00	1.00
07/17/2022 07:00	1	1.7	11.7	14.6	17.0	669,279.0	0.00	1.00
07/17/2022 08:00	0	1.6	9.6	14.5	12.5	739,703.1	0.00	1.00
07/17/2022 09:00	1	1.6	11.6	14.7	17.7	672,122.3	0.00	1.00
07/17/2022 10:00	0	1.6	10.7	14.7	14.0	674,551.9	0.00	1.00
07/17/2022 11:00	0	1.7	8.6	14.3	11.9	865,019.7	0.00	1.00
07/17/2022 12:00	1	2.0	9.1	13.7	17.3	1,015,085.8	0.00	1.00
07/17/2022 13:00	1	2.0	9.7	13.4	19.5	1,011,365.6	0.00	1.00
07/17/2022 14:00	1	2.0	9.4	13.7	18.9	1,019,270.2	0.00	1.00
07/17/2022 15:00	1	2.1	10.4	13.2	22.4	1,017,642.4	0.00	1.00
07/17/2022 16:00	1	2.1	10.5	13.2	21.1	1,011,595.6	0.00	1.00
07/17/2022 17:00	1	2.1	10.1	13.3	21.1	1,014,635.4	0.00	1.00
07/17/2022 18:00	1	2.2	11.3	12.8	24.4	1,019,460.4	0.00	1.00
07/17/2022 19:00	1	2.2	11.3	12.9	24.0	1,029,293.6	0.00	1.00
07/17/2022 20:00	1	2.2	11.6	12.7	25.2	1,025,732.3	0.00	1.00
07/17/2022 21:00	1	2.0	10.2	13.4	20.2	1,029,076.8	0.00	1.00
07/17/2022 22:00	1	1.9	9.1	13.9	18.0	1,034,697.9	0.00	1.00
07/17/2022 23:00	1	1.9	9.1	13.9	18.1	1,031,176.6	0.00	1.00
Average/Sum#:	1	2.0	10.3	13.6	19.9	958,933.8	0.00 #	24.00 #
Minimum:	0	1.6	8.3	12.7	11.9	669,279.0	0.00	1.00
Maximum:	1	2.2	11.7	14.7	26.1	1,049,949.8	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT2 NH3Slip, Ppmvdc	Unit CT2 NOx, Ppm	Unit CT2 NOx, _SCR, Ppm	Unit CT2 O2, Dry, Pct	Unit CT2 NH3Inj, LbPerHr	Unit CT2 ExhaustFlow, LbPerHr	Unit CT2 SUSD, Hr	Unit CT2 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/18/2022 00:00	1	1.9	9.0	14.0	18.2	1,042,151.8	0.00	1.00
07/18/2022 01:00	0	1.8	8.7	14.1	16.9	1,016,394.8	0.00	1.00
07/18/2022 02:00	1	1.6	13.3	14.6	21.5	671,452.7	0.00	1.00
07/18/2022 03:00	1	1.6	13.5	14.8	19.9	676,405.8	0.00	1.00
07/18/2022 04:00	0	1.6	10.6	14.6	12.4	736,011.3	0.00	1.00
07/18/2022 05:00	0	1.9	8.5	14.1	16.1	1,029,484.9	0.00	1.00
07/18/2022 06:00	1	1.9	8.7	14.0	17.5	1,045,525.7	0.00	1.00
07/18/2022 07:00	1	1.7	9.7	14.3	16.9	836,593.8	0.00	1.00
07/18/2022 08:00	0	1.6	10.3	14.6	13.5	730,359.7	0.00	1.00
07/18/2022 09:00	0	1.9	8.5	14.0	16.6	1,016,748.0	0.00	1.00
07/18/2022 10:00	1	1.9	9.0	13.9	17.4	1,036,458.6	0.00	1.00
07/18/2022 11:00	1	1.9	9.1	13.8	17.9	1,032,854.6	0.00	1.00
07/18/2022 12:00	1	1.9	9.1	13.7	17.8	1,024,785.9	0.00	1.00
07/18/2022 13:00	1	2.1	10.7	13.1	23.1	1,034,266.5	0.00	1.00
07/18/2022 14:00	1	2.0	9.9	13.5	21.1	1,037,061.4	0.00	1.00
07/18/2022 15:00	1	2.2	11.6	12.8	26.1	1,038,733.8	0.00	1.00
07/18/2022 16:00	1	2.2	11.7	12.8	25.9	1,039,410.0	0.00	1.00
07/18/2022 17:00	1	2.3	11.4	12.9	24.1	1,031,518.9	0.00	1.00
07/18/2022 18:00	1	2.3	11.7	12.8	25.1	1,037,719.4	0.00	1.00
07/18/2022 19:00	1	2.3	11.3	13.0	23.2	1,041,282.6	0.00	1.00
07/18/2022 20:00	1	2.3	11.4	12.9	23.9	1,040,420.2	0.00	1.00
07/18/2022 21:00	1	2.2	10.0	13.5	19.6	1,032,805.1	0.00	1.00
07/18/2022 22:00	1	2.0	9.1	14.0	18.0	1,044,930.3	0.00	1.00
07/18/2022 23:00	1	1.9	9.0	14.2	17.7	939,793.0	0.00	1.00
Average/Sum#:	1	2.0	10.2	13.8	19.6	967,215.4	0.00 #	24.00 #
Minimum:	0	1.6	8.5	12.8	12.4	671,452.7	0.00	1.00
Maximum:	1	2.3	13.5	14.8	26.1	1,045,525.7	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT2 NH3Slip, Ppmvdc	Unit CT2 NOx, Ppm	Unit CT2 NOx, _SCR, Ppm	Unit CT2 O2, Dry, Pct	Unit CT2 NH3Inj, LbPerHr	Unit CT2 ExhaustFlow, LbPerHr	Unit CT2 SUSD, Hr	Unit CT2 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/19/2022 00:00	1	1.8	12.9	14.7	19.2	675,214.6	0.00	1.00
07/19/2022 01:00	1	1.8	12.1	14.7	18.3	683,166.1	0.00	1.00
07/19/2022 02:00	0	1.8	11.9	14.6	15.4	676,234.8	0.00	1.00
07/19/2022 03:00	1	1.8	11.7	14.6	17.0	677,756.4	0.00	1.00
07/19/2022 04:00	1	1.8	12.0	14.6	17.9	675,365.3	0.00	1.00
07/19/2022 05:00	1	1.8	12.3	14.6	18.5	674,930.6	0.00	1.00
07/19/2022 06:00	1	1.8	13.9	14.7	22.1	670,134.4	0.00	1.00
07/19/2022 07:00	1	1.8	15.0	14.8	22.8	664,058.6	0.00	1.00
07/19/2022 08:00	1	1.8	14.7	14.8	22.1	660,915.6	0.00	1.00
07/19/2022 09:00	1	1.7	12.6	14.8	17.4	677,528.3	0.00	1.00
07/19/2022 10:00	0	1.6	9.8	14.6	11.8	721,882.3	0.00	1.00
07/19/2022 11:00	1	1.6	8.7	14.4	13.4	896,867.6	0.00	1.00
07/19/2022 12:00	1	1.8	9.2	13.9	19.5	1,083,214.7	0.00	1.00
07/19/2022 13:00	0	2.0	9.5	13.8	18.3	1,034,204.7	0.00	1.00
07/19/2022 14:00	1	2.0	9.5	13.9	18.5	1,034,306.7	0.00	1.00
07/19/2022 15:00	1	2.0	9.5	13.8	18.9	1,025,911.0	0.00	1.00
07/19/2022 16:00	1	2.2	11.0	13.2	22.7	1,039,517.6	0.00	1.00
07/19/2022 17:00	1	2.3	11.4	13.0	24.0	1,035,388.8	0.00	1.00
07/19/2022 18:00	1	2.4	12.4	12.6	27.9	1,046,867.2	0.00	1.00
07/19/2022 19:00	1	2.1	11.3	13.0	24.7	1,035,042.2	0.00	1.00
07/19/2022 20:00	1	1.8	9.2	13.9	18.7	1,038,023.7	0.00	1.00
07/19/2022 21:00	1	1.8	9.5	13.9	19.1	1,048,000.9	0.00	1.00
07/19/2022 22:00	1	1.8	9.2	14.0	18.9	1,041,754.9	0.00	1.00
07/19/2022 23:00	1	1.6	11.3	14.4	21.2	843,776.1	0.00	1.00
Average/Sum#:	1	1.9	11.3	14.1	19.5	860,836.0	0.00 #	24.00 #
Minimum:	0	1.6	8.7	12.6	11.8	660,915.6	0.00	1.00
Maximum:	1	2.4	15.0	14.8	27.9	1,083,214.7	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:	> 10							
	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2
	NH3Slip, Ppmvdc	NOx, Ppm	NOx, _SCR, Ppm	O2, Dry, Pct	NH3Inj, LbPerHr	ExhaustFlow, LbPerHr	SUSD, Hr	OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/20/2022 00:00	1	1.7	15.9	14.8	24.7	662,262.6	0.00	1.00
07/20/2022 01:00	1	1.7	15.7	14.8	24.3	663,609.6	0.00	1.00
07/20/2022 02:00	1	1.6	16.2	14.8	24.7	664,956.6	0.00	1.00
07/20/2022 03:00	1	1.7	16.2	14.7	25.1	655,115.0	0.00	1.00
07/20/2022 04:00	1	1.7	15.7	14.7	23.3	659,753.3	0.00	1.00
07/20/2022 05:00	1	1.6	15.1	14.7	23.9	666,379.6	0.00	1.00
07/20/2022 06:00	1	1.6	14.9	14.7	23.2	665,717.0	0.00	1.00
07/20/2022 07:00	1	1.6	13.5	14.7	20.4	676,760.7	0.00	1.00
07/20/2022 08:00	1	1.6	14.4	14.8	22.1	672,140.4	0.00	1.00
07/20/2022 09:00	1	1.5	12.7	14.7	17.8	674,993.7	0.00	1.00
07/20/2022 10:00	1	1.5	12.5	14.8	18.0	678,201.8	0.00	1.00
07/20/2022 11:00	0	1.6	10.4	14.7	14.3	681,619.9	0.00	1.00
07/20/2022 12:00	0	1.6	8.2	14.3	11.6	901,330.2	0.00	1.00
07/20/2022 13:00	1	1.9	9.5	13.6	19.1	1,032,320.9	0.00	1.00
07/20/2022 14:00	2	2.2	11.9	12.4	28.4	1,029,323.8	0.00	1.00
07/20/2022 15:00	1	1.8	9.5	13.7	18.8	1,026,878.1	0.00	1.00
07/20/2022 16:00	1	1.8	9.5	13.7	19.7	1,032,774.2	0.00	1.00
07/20/2022 17:00	1	2.1	11.6	12.6	26.4	1,020,138.7	0.00	1.00
07/20/2022 18:00	1	2.0	11.0	13.1	23.3	1,032,686.4	0.00	1.00
07/20/2022 19:00	1	2.0	11.4	12.9	24.8	1,032,374.8	0.00	1.00
07/20/2022 20:00	1	1.9	10.5	13.3	21.2	1,033,555.0	0.00	1.00
07/20/2022 21:00	1	1.6	10.6	14.4	19.2	841,247.9	0.00	1.00
07/20/2022 22:00	1	1.5	13.3	14.7	20.0	684,049.6	0.00	1.00
07/20/2022 23:00	1	1.5	14.7	14.8	22.8	670,569.0	0.00	1.00
Average/Sum#:	1	1.7	12.7	14.2	21.5	806,615.0	0.00 #	24.00 #
Minimum:	0	1.5	8.2	12.4	11.6	655,115.0	0.00	1.00
Maximum:	2	2.2	16.2	14.8	28.4	1,033,555.0	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT2 NH3Slip, Ppmvdc	Unit CT2 NOx, Ppm	Unit CT2 NOx, _SCR, Ppm	Unit CT2 O2, Dry, Pct	Unit CT2 NH3Inj, LbPerHr	Unit CT2 ExhaustFlow, LbPerHr	Unit CT2 SUSD, Hr	Unit CT2 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/21/2022 00:00	1	1.6	13.6	14.7	20.8	675,435.4	0.00	1.00
07/21/2022 01:00	1	1.5	14.3	14.7	21.7	668,588.3	0.00	1.00
07/21/2022 02:00	1	1.4	15.3	14.7	24.2	668,809.2	0.00	1.00
07/21/2022 03:00	1	1.6	13.3	14.6	18.9	680,799.6	0.00	1.00
07/21/2022 04:00	1	1.6	15.2	14.7	24.4	666,158.7	0.00	1.00
07/21/2022 05:00	1	1.6	16.3	14.7	25.1	655,556.7	0.00	1.00
07/21/2022 06:00	1	1.7	15.9	14.7	24.5	655,998.5	0.00	1.00
07/21/2022 07:00	1	1.7	15.7	14.7	23.8	655,556.7	0.00	1.00
07/21/2022 08:00	1	1.7	15.1	14.8	22.8	665,181.1	0.00	1.00
07/21/2022 09:00	1	1.7	14.5	14.8	21.9	664,058.6	0.00	1.00
07/21/2022 10:00	1	1.7	13.8	14.8	20.3	664,058.6	0.00	1.00
07/21/2022 11:00	1	1.7	13.4	14.8	19.5	661,589.1	0.00	1.00
07/21/2022 12:00	0	1.6	11.6	14.8	15.3	674,609.9	0.00	1.00
07/21/2022 13:00	0	1.5	9.2	14.6	10.9	806,438.8	0.00	1.00
07/21/2022 14:00	0	2.0	9.0	13.7	16.4	1,016,797.6	0.00	1.00
07/21/2022 15:00	1	2.0	9.1	13.7	17.7	1,015,656.4	0.00	1.00
07/21/2022 16:00	1	2.0	9.2	13.7	17.8	1,017,368.2	0.00	1.00
07/21/2022 17:00	1	2.0	9.8	13.4	19.3	1,016,295.5	0.00	1.00
07/21/2022 18:00	1	2.1	10.4	13.2	20.7	1,019,243.0	0.00	1.00
07/21/2022 19:00	1	1.9	9.1	13.8	17.5	1,030,540.1	0.00	1.00
07/21/2022 20:00	1	1.9	9.3	13.8	17.9	1,036,133.5	0.00	1.00
07/21/2022 21:00	1	1.8	9.6	14.2	18.7	911,178.2	0.00	1.00
07/21/2022 22:00	1	1.6	14.6	14.8	22.1	666,752.5	0.00	1.00
07/21/2022 23:00	1	1.7	13.2	14.7	19.8	674,551.9	0.00	1.00
Average/Sum#:	1	1.7	12.5	14.4	20.1	786,139.8	0.00 #	24.00 #
Minimum:	0	1.4	9.0	13.2	10.9	655,556.7	0.00	1.00
Maximum:	1	2.1	16.3	14.8	25.1	1,036,133.5	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT2 NH3Slip, Ppmvdc	Unit CT2 NOx, Ppm	Unit CT2 NOx, _SCR, Ppm	Unit CT2 O2, Dry, Pct	Unit CT2 NH3Inj, LbPerHr	Unit CT2 ExhaustFlow, LbPerHr	Unit CT2 SUSD, Hr	Unit CT2 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/22/2022 00:00	1	1.7	12.4	14.7	17.5	685,816.6	0.00	1.00
07/22/2022 01:00	1	1.7	12.6	14.7	19.0	685,374.8	0.00	1.00
07/22/2022 02:00	0	1.5	9.6	14.4	13.4	743,702.8	0.00	1.00
07/22/2022 03:00	2	1.7	13.8	14.6	21.3	674,495.9	0.00	1.00
07/22/2022 04:00	1	1.7	13.9	14.6	21.0	672,539.5	0.00	1.00
07/22/2022 05:00	1	1.7	14.3	14.6	21.8	669,931.1	0.00	1.00
07/22/2022 06:00	1	1.7	15.2	14.7	24.1	667,263.1	0.00	1.00
07/22/2022 07:00	1	1.7	15.9	14.8	24.4	665,405.6	0.00	1.00
07/22/2022 08:00	1	1.7	15.4	14.8	23.4	663,834.1	0.00	1.00
07/22/2022 09:00	1	1.7	14.8	14.8	22.5	662,038.1	0.00	1.00
07/22/2022 10:00	1	1.6	14.1	14.8	21.1	663,834.1	0.00	1.00
07/22/2022 11:00	1	1.6	13.7	14.8	19.9	660,017.7	0.00	1.00
07/22/2022 12:00	1	1.6	13.0	14.9	18.8	670,333.2	0.00	1.00
07/22/2022 13:00	0	1.6	11.5	14.9	15.7	680,147.4	0.00	1.00
07/22/2022 14:00	0	1.5	8.8	14.6	11.6	812,307.8	0.00	1.00
07/22/2022 15:00	0	2.0	9.2	13.8	16.8	1,027,068.3	0.00	1.00
07/22/2022 16:00	1	1.9	9.3	13.8	17.9	1,027,068.3	0.00	1.00
07/22/2022 17:00	1	1.9	9.3	13.8	18.3	1,025,139.5	0.00	1.00
07/22/2022 18:00	1	1.9	9.2	13.8	18.1	1,022,439.2	0.00	1.00
07/22/2022 19:00	1	1.9	9.1	13.9	18.1	1,038,414.9	0.00	1.00
07/22/2022 20:00	1	1.9	9.1	13.9	18.3	1,037,241.2	0.00	1.00
07/22/2022 21:00	1	1.6	9.7	14.3	16.4	862,737.4	0.00	1.00
07/22/2022 22:00	1	1.6	12.5	14.6	19.0	684,712.2	0.00	1.00
07/22/2022 23:00	1	3.4	18.3	15.0	16.3	649,664.2	0.15	0.50
Average/Sum#:	1	1.8	12.3	14.5	18.9	777,147.0	0.15 #	23.50 #
Minimum:	0	1.5	8.8	13.8	11.6	649,664.2	0.00	0.50
Maximum:	2	3.4	18.3	15.0	24.4	1,038,414.9	0.15	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT2 NH3Slip, Ppmvdc	Unit CT2 NOx, Ppm	Unit CT2 NOx, _SCR, Ppm	Unit CT2 O2, Dry, Pct	Unit CT2 NH3Inj, LbPerHr	Unit CT2 ExhaustFlow, LbPerHr	Unit CT2 SUSD, Hr	Unit CT2 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/23/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/23/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/23/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/23/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/23/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/23/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/23/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/23/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/23/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/23/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/23/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/23/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/23/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/23/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/23/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/23/2022 15:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/23/2022 16:00	2	8.4	14.3	15.5	9.5	702,717.6	0.78	0.93
07/23/2022 17:00	0	1.5	9.3	14.7	8.9	870,468.0	0.00	1.00
07/23/2022 18:00	1	2.2	11.3	13.1	23.4	1,029,350.7	0.00	1.00
07/23/2022 19:00	1	2.0	10.6	13.4	20.5	1,033,458.9	0.00	1.00
07/23/2022 20:00	0	1.9	9.5	13.9	17.9	1,036,654.3	0.00	1.00
07/23/2022 21:00	1	1.8	9.2	14.1	16.5	921,542.1	0.00	1.00
07/23/2022 22:00	1	4.5	20.5	15.1	14.8	620,727.0	0.13	0.35
07/23/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	1	3.2	12.1	14.3	15.9	887,845.5	0.91 #	6.28 #
Minimum:	0	1.5	9.2	13.1	8.9	620,727.0	0.00	0.00
Maximum:	2	8.4	20.5	15.5	23.4	1,036,654.3	0.78	1.00
%SI	70.83	70.83	70.83	70.83	70.83	70.83	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT2 NH3Slip, Ppmvdc	Unit CT2 NOx, Ppm	Unit CT2 NOx, _SCR, Ppm	Unit CT2 O2, Dry, Pct	Unit CT2 NH3Inj, LbPerHr	Unit CT2 ExhaustFlow, LbPerHr	Unit CT2 SUSD, Hr	Unit CT2 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/24/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/24/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/24/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/24/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/24/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
07/24/2022 05:00	0	9.9	17.7	15.6	12.3	689,104.7	0.90	0.90
07/24/2022 06:00	1	1.5	14.1	14.6	20.6	670,800.6	0.15	1.00
07/24/2022 07:00	1	1.7	13.4	14.6	19.1	669,931.1	0.00	1.00
07/24/2022 08:00	1	1.6	14.1	14.7	21.0	664,391.7	0.00	1.00
07/24/2022 09:00	1	1.7	14.3	14.8	20.9	664,732.1	0.00	1.00
07/24/2022 10:00	1	1.7	13.7	14.8	20.0	664,283.1	0.00	1.00
07/24/2022 11:00	1	1.7	12.8	14.8	18.4	663,834.1	0.00	1.00
07/24/2022 12:00	1	1.7	12.2	14.8	17.3	660,691.1	0.00	1.00
07/24/2022 13:00	0	1.6	11.3	14.9	15.8	670,105.0	0.00	1.00
07/24/2022 14:00	1	1.7	10.2	14.9	14.4	672,387.4	0.00	1.00
07/24/2022 15:00	0	1.6	10.6	14.9	14.8	669,420.3	0.00	1.00
07/24/2022 16:00	0	1.7	8.4	14.3	11.7	865,227.2	0.00	1.00
07/24/2022 17:00	1	2.0	9.2	13.7	17.2	1,019,270.2	0.00	1.00
07/24/2022 18:00	1	2.0	9.2	13.7	17.6	1,019,650.6	0.00	1.00
07/24/2022 19:00	1	1.9	9.1	13.9	17.8	1,040,762.5	0.00	1.00
07/24/2022 20:00	1	1.8	9.1	14.2	18.6	930,391.0	0.00	1.00
07/24/2022 21:00	1	1.5	13.8	14.8	20.6	669,446.5	0.00	1.00
07/24/2022 22:00	1	1.6	14.3	14.8	21.9	664,956.6	0.00	1.00
07/24/2022 23:00	1	1.6	12.0	14.7	17.9	679,190.3	0.00	1.00
Average/Sum#:	1	2.1	12.1	14.6	17.8	749,925.1	1.05 #	18.90 #
Minimum:	0	1.5	8.4	13.7	11.7	660,691.1	0.00	0.00
Maximum:	1	9.9	17.7	15.6	21.9	1,040,762.5	0.90	1.00
%SI	25.00	20.83	20.83	20.83	20.83	20.83	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT2 NH3Slip, Ppmvdc	Unit CT2 NOx, Ppm	Unit CT2 NOx, _SCR, Ppm	Unit CT2 O2, Dry, Pct	Unit CT2 NH3Inj, LbPerHr	Unit CT2 ExhaustFlow, LbPerHr	Unit CT2 SUSD, Hr	Unit CT2 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/25/2022 00:00	1	1.5	13.7	14.7	21.3	666,379.6	0.00	1.00
07/25/2022 01:00	1	1.6	14.9	14.7	23.4	655,335.8	0.00	1.00
07/25/2022 02:00	1	1.6	15.7	14.7	24.1	655,556.7	0.00	1.00
07/25/2022 03:00	1	1.6	15.9	14.7	25.3	655,335.8	0.00	1.00
07/25/2022 04:00	1	1.6	13.8	14.6	20.2	668,844.3	0.00	1.00
07/25/2022 05:00	1	1.6	13.2	14.6	20.6	676,234.8	0.00	1.00
07/25/2022 06:00	1	1.6	13.5	14.6	21.6	673,409.0	0.00	1.00
07/25/2022 07:00	1	1.6	13.1	14.6	20.2	672,974.3	0.00	1.00
07/25/2022 08:00	1	1.5	15.1	14.7	23.4	657,102.8	0.00	1.00
07/25/2022 09:00	1	1.6	14.7	14.7	22.9	652,464.5	0.00	1.00
07/25/2022 10:00	1	1.6	14.3	14.8	21.9	659,793.2	0.00	1.00
07/25/2022 11:00	0	1.5	11.8	14.7	15.8	672,564.1	0.00	1.00
07/25/2022 12:00	1	1.5	10.8	14.7	15.0	676,981.6	0.00	1.00
07/25/2022 13:00	0	1.6	8.3	14.3	10.4	877,676.5	0.00	1.00
07/25/2022 14:00	1	1.9	9.1	13.6	17.0	1,011,498.1	0.00	1.00
07/25/2022 15:00	1	1.9	9.3	13.5	17.9	1,012,448.8	0.00	1.00
07/25/2022 16:00	1	1.9	9.7	13.4	19.4	1,022,503.5	0.00	1.00
07/25/2022 17:00	1	2.0	10.1	13.2	20.7	1,018,531.6	0.00	1.00
07/25/2022 18:00	1	2.0	10.5	13.2	21.1	1,032,581.6	0.00	1.00
07/25/2022 19:00	1	1.8	9.4	13.6	18.4	1,022,378.5	0.00	1.00
07/25/2022 20:00	1	1.8	9.0	13.8	17.7	1,024,560.9	0.00	1.00
07/25/2022 21:00	1	1.8	9.1	13.9	17.9	1,039,393.1	0.00	1.00
07/25/2022 22:00	1	1.6	9.8	14.3	17.4	843,026.0	0.00	1.00
07/25/2022 23:00	1	1.5	9.8	14.4	14.5	769,405.8	0.00	1.00
Average/Sum#:	1	1.7	11.9	14.3	19.5	804,874.2	0.00 #	24.00 #
Minimum:	0	1.5	8.3	13.2	10.4	652,464.5	0.00	1.00
Maximum:	1	2.0	15.9	14.8	25.3	1,039,393.1	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:	> 10							
	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2
	NH3Slip, Ppmvdc	NOx, Ppm	NOx, _SCR, Ppm	O2, Dry, Pct	NH3Inj, LbPerHr	ExhaustFlow, LbPerHr	SUSD, Hr	OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/26/2022 00:00	1	1.6	12.6	14.6	19.4	673,626.4	0.00	1.00
07/26/2022 01:00	1	1.6	12.7	14.6	19.6	672,756.9	0.00	1.00
07/26/2022 02:00	1	1.6	13.2	14.6	19.7	673,191.6	0.00	1.00
07/26/2022 03:00	1	1.6	13.1	14.6	20.1	672,322.2	0.00	1.00
07/26/2022 04:00	0	1.6	9.3	14.3	13.1	901,330.2	0.00	1.00
07/26/2022 05:00	0	1.8	8.6	14.1	17.5	1,056,470.6	0.00	1.00
07/26/2022 06:00	1	1.6	11.3	14.5	20.4	763,882.0	0.00	1.00
07/26/2022 07:00	1	1.6	12.3	14.6	17.9	677,756.4	0.00	1.00
07/26/2022 08:00	1	1.6	14.0	14.7	22.8	668,146.6	0.00	1.00
07/26/2022 09:00	1	1.6	14.4	14.7	22.4	663,950.0	0.00	1.00
07/26/2022 10:00	1	1.5	12.4	14.6	17.9	670,365.8	0.00	1.00
07/26/2022 11:00	1	1.6	14.0	14.7	21.2	665,937.8	0.00	1.00
07/26/2022 12:00	1	1.6	11.2	14.6	15.4	686,233.8	0.00	1.00
07/26/2022 13:00	0	1.5	8.5	14.3	11.3	896,973.0	0.00	1.00
07/26/2022 14:00	0	1.8	8.8	13.8	16.6	1,025,911.0	0.00	1.00
07/26/2022 15:00	1	1.8	8.8	13.7	17.6	1,015,276.0	0.00	1.00
07/26/2022 16:00	1	1.9	9.4	13.5	18.8	1,020,406.2	0.00	1.00
07/26/2022 17:00	1	2.0	10.2	13.1	21.1	1,018,816.6	0.00	1.00
07/26/2022 18:00	1	1.9	9.7	13.4	19.8	1,024,694.6	0.00	1.00
07/26/2022 19:00	1	1.8	9.0	13.7	17.6	1,020,791.8	0.00	1.00
07/26/2022 20:00	1	1.8	8.9	13.8	17.9	1,029,189.9	0.00	1.00
07/26/2022 21:00	1	1.8	8.8	13.9	18.1	1,037,436.8	0.00	1.00
07/26/2022 22:00	1	1.8	8.8	14.0	18.2	1,046,518.1	0.00	1.00
07/26/2022 23:00	1	1.6	9.8	14.3	17.9	845,930.8	0.00	1.00
Average/Sum#:	1	1.7	10.8	14.2	18.4	851,163.1	0.00 #	24.00 #
Minimum:	0	1.5	8.5	13.1	11.3	663,950.0	0.00	1.00
Maximum:	1	2.0	14.4	14.7	22.8	1,056,470.6	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:	> 10							
	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2
	NH3Slip, Ppmvdc	NOx, Ppm	NOx, _SCR, Ppm	O2, Dry, Pct	NH3Inj, LbPerHr	ExhaustFlow, LbPerHr	SUSD, Hr	OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/27/2022 00:00	1	1.6	12.3	14.6	19.2	677,539.0	0.00	1.00
07/27/2022 01:00	1	1.6	12.4	14.6	19.1	679,495.3	0.00	1.00
07/27/2022 02:00	1	1.7	13.1	14.6	19.7	678,191.1	0.00	1.00
07/27/2022 03:00	1	1.6	13.1	14.6	20.0	678,625.9	0.00	1.00
07/27/2022 04:00	1	1.6	13.0	14.6	20.1	678,625.9	0.00	1.00
07/27/2022 05:00	1	1.6	11.9	14.5	16.4	700,118.2	0.00	1.00
07/27/2022 06:00	1	1.7	12.0	14.5	18.2	744,624.5	0.00	1.00
07/27/2022 07:00	1	1.7	12.3	14.5	16.8	680,432.7	0.00	1.00
07/27/2022 08:00	1	1.8	12.3	14.6	18.2	676,452.2	0.00	1.00
07/27/2022 09:00	1	1.7	14.0	14.7	20.6	663,508.2	0.00	1.00
07/27/2022 10:00	1	1.7	11.5	14.7	16.4	682,282.6	0.00	1.00
07/27/2022 11:00	0	1.7	11.1	14.7	14.8	682,282.6	0.00	1.00
07/27/2022 12:00	1	1.6	11.5	14.7	16.9	671,238.8	0.00	1.00
07/27/2022 13:00	0	1.7	7.9	14.1	9.5	974,909.3	0.00	1.00
07/27/2022 14:00	1	2.0	8.9	13.7	16.6	1,017,368.2	0.00	1.00
07/27/2022 15:00	1	2.0	8.9	13.6	16.8	1,011,310.5	0.00	1.00
07/27/2022 16:00	1	2.1	8.9	13.6	17.0	1,016,375.5	0.00	1.00
07/27/2022 17:00	1	2.3	11.0	12.7	23.2	1,020,555.2	0.00	1.00
07/27/2022 18:00	1	2.0	9.0	13.7	16.7	1,019,650.6	0.00	1.00
07/27/2022 19:00	1	2.0	8.9	13.8	17.2	1,029,768.6	0.00	1.00
07/27/2022 20:00	1	2.0	8.9	13.9	17.1	1,039,980.0	0.00	1.00
07/27/2022 21:00	1	1.9	8.5	14.1	16.1	951,951.3	0.00	1.00
07/27/2022 22:00	0	1.7	9.9	14.5	13.8	821,868.6	0.00	1.00
07/27/2022 23:00	1	1.8	10.4	14.5	17.7	801,969.2	0.00	1.00
Average/Sum#:	1	1.8	10.9	14.3	17.4	816,630.2	0.00 #	24.00 #
Minimum:	0	1.6	7.9	12.7	9.5	663,508.2	0.00	1.00
Maximum:	1	2.3	14.0	14.7	23.2	1,039,980.0	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT2 NH3Slip, Ppmvdc	Unit CT2 NOx, Ppm	Unit CT2 NOx, _SCR, Ppm	Unit CT2 O2, Dry, Pct	Unit CT2 NH3Inj, LbPerHr	Unit CT2 ExhaustFlow, LbPerHr	Unit CT2 SUSD, Hr	Unit CT2 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/28/2022 00:00	1	1.5	9.9	14.4	13.9	758,029.1	0.00	1.00
07/28/2022 01:00	0	1.7	11.5	14.5	15.1	693,057.1	0.00	1.00
07/28/2022 02:00	1	1.8	12.6	14.6	18.1	680,799.6	0.00	1.00
07/28/2022 03:00	0	1.9	9.2	14.3	12.5	905,895.0	0.00	1.00
07/28/2022 04:00	1	1.9	8.7	14.1	17.5	1,058,887.3	0.00	1.00
07/28/2022 05:00	1	1.8	8.7	14.2	16.1	955,940.0	0.00	1.00
07/28/2022 06:00	0	1.8	8.0	14.3	11.0	861,699.9	0.00	1.00
07/28/2022 07:00	0	1.4	10.9	14.4	24.0	842,722.7	0.00	1.00
07/28/2022 08:00	0	1.6	12.6	14.6	8.7	673,191.6	0.00	1.00
07/28/2022 09:00	1	1.6	12.3	14.6	18.2	684,494.8	0.00	1.00
07/28/2022 10:00	0	1.6	7.2	14.4	7.8	978,611.7	0.00	1.00
07/28/2022 11:00	1	2.0	9.2	13.7	16.8	1,025,356.5	0.00	1.00
07/28/2022 12:00	0	2.0	9.0	13.7	16.3	1,019,270.2	0.00	1.00
07/28/2022 13:00	1	2.0	9.1	13.6	17.6	1,013,186.5	0.00	1.00
07/28/2022 14:00	1	2.2	10.3	13.0	20.9	1,006,786.9	0.00	1.00
07/28/2022 15:00	1	2.0	9.1	13.6	17.3	1,008,309.0	0.00	1.00
07/28/2022 16:00	1	2.1	9.2	13.5	17.1	1,005,786.7	0.00	1.00
07/28/2022 17:00	1	2.2	10.6	12.8	22.7	1,014,895.6	0.00	1.00
07/28/2022 18:00	1	2.2	11.2	12.6	24.5	1,016,838.9	0.00	1.00
07/28/2022 19:00	1	2.0	9.8	13.4	19.1	1,020,312.5	0.00	1.00
07/28/2022 20:00	1	2.0	9.7	13.5	18.4	1,023,182.1	0.00	1.00
07/28/2022 21:00	1	1.9	9.0	13.9	17.4	1,035,676.1	0.00	1.00
07/28/2022 22:00	1	1.8	8.9	14.1	17.1	920,333.7	0.00	1.00
07/28/2022 23:00	1	1.6	11.8	14.5	17.3	673,157.7	0.00	1.00
Average/Sum#:	1	1.9	9.9	13.9	16.9	911,517.6	0.00 #	24.00 #
Minimum:	0	1.4	7.2	12.6	7.8	673,157.7	0.00	1.00
Maximum:	1	2.2	12.6	14.6	24.5	1,058,887.3	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:	> 10							
	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2
	NH3Slip, Ppmvdc	NOx, Ppm	NOx, _SCR, Ppm	O2, Dry, Pct	NH3Inj, LbPerHr	ExhaustFlow, LbPerHr	SUSD, Hr	OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/29/2022 00:00	1	1.7	13.3	14.6	20.9	662,540.6	0.00	1.00
07/29/2022 01:00	1	1.7	13.7	14.6	20.7	660,801.6	0.00	1.00
07/29/2022 02:00	0	1.3	12.9	14.6	17.5	671,452.7	0.00	1.00
07/29/2022 03:00	1	1.8	12.9	14.6	18.8	676,017.4	0.00	1.00
07/29/2022 04:00	0	1.7	8.3	14.2	12.8	993,956.8	0.00	1.00
07/29/2022 05:00	1	1.9	8.7	14.0	17.6	1,040,365.6	0.00	1.00
07/29/2022 06:00	1	1.7	9.8	14.4	15.9	807,539.0	0.00	1.00
07/29/2022 07:00	1	1.7	12.4	14.5	19.2	667,808.4	0.00	1.00
07/29/2022 08:00	1	1.7	12.0	14.6	17.4	677,104.3	0.00	1.00
07/29/2022 09:00	1	1.7	11.4	14.6	16.5	676,669.5	0.00	1.00
07/29/2022 10:00	1	1.7	10.8	14.6	15.4	675,800.1	0.00	1.00
07/29/2022 11:00	0	1.6	9.5	14.6	11.6	742,097.6	0.00	1.00
07/29/2022 12:00	0	1.9	8.4	13.9	14.5	1,020,808.1	0.00	1.00
07/29/2022 13:00	1	2.0	8.9	13.6	16.9	1,011,122.9	0.00	1.00
07/29/2022 14:00	1	2.1	9.5	13.4	18.8	1,016,295.5	0.00	1.00
07/29/2022 15:00	1	2.0	9.0	13.6	17.2	1,012,998.9	0.00	1.00
07/29/2022 16:00	1	2.0	9.0	13.5	17.1	1,001,900.5	0.00	1.00
07/29/2022 17:00	1	2.0	9.4	13.4	17.8	1,011,000.4	0.00	1.00
07/29/2022 18:00	1	2.0	8.9	13.6	17.0	1,007,746.3	0.00	1.00
07/29/2022 19:00	1	2.0	8.8	13.7	16.9	1,016,607.4	0.00	1.00
07/29/2022 20:00	1	1.9	8.8	13.8	17.2	1,028,032.7	0.00	1.00
07/29/2022 21:00	1	2.0	9.1	13.7	18.1	1,027,829.1	0.00	1.00
07/29/2022 22:00	1	1.9	8.8	13.9	17.8	1,035,089.2	0.00	1.00
07/29/2022 23:00	1	1.9	9.1	13.8	18.2	1,039,026.6	0.00	1.00
Average/Sum#:	1	1.8	10.1	14.1	17.2	882,525.5	0.00 #	24.00 #
Minimum:	0	1.3	8.3	13.4	11.6	660,801.6	0.00	1.00
Maximum:	1	2.1	13.7	14.6	20.9	1,040,365.6	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
 Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT2 NH3Slip, Ppmvdc	Unit CT2 NOx, Ppm	Unit CT2 NOx, _SCR, Ppm	Unit CT2 O2, Dry, Pct	Unit CT2 NH3Inj, LbPerHr	Unit CT2 ExhaustFlow, LbPerHr	Unit CT2 SUSD, Hr	Unit CT2 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/30/2022 00:00	1	1.9	8.7	14.0	18.1	1,040,564.1	0.00	1.00
07/30/2022 01:00	1	1.9	8.6	14.0	17.9	1,036,594.7	0.00	1.00
07/30/2022 02:00	0	1.9	7.5	14.3	11.4	904,857.5	0.00	1.00
07/30/2022 03:00	0	1.8	7.3	14.3	12.8	945,940.3	0.00	1.00
07/30/2022 04:00	1	1.9	8.5	14.1	18.0	1,036,332.0	0.00	1.00
07/30/2022 05:00	1	1.9	9.0	13.9	18.2	1,042,523.2	0.00	1.00
07/30/2022 06:00	0	1.9	8.0	14.3	14.8	1,003,414.6	0.00	1.00
07/30/2022 07:00	1	1.8	11.1	14.4	17.3	703,462.8	0.00	1.00
07/30/2022 08:00	1	1.8	12.3	14.6	17.7	673,409.0	0.00	1.00
07/30/2022 09:00	1	1.8	13.5	14.7	20.9	663,066.5	0.00	1.00
07/30/2022 10:00	1	1.7	13.3	14.7	19.4	658,869.8	0.00	1.00
07/30/2022 11:00	0	1.6	10.1	14.5	9.6	800,899.3	0.00	1.00
07/30/2022 12:00	0	2.1	8.7	13.7	14.9	1,019,080.0	0.00	1.00
07/30/2022 13:00	1	2.1	8.7	13.6	16.0	1,008,684.2	0.00	1.00
07/30/2022 14:00	1	2.3	10.1	12.9	21.7	1,019,022.9	0.00	1.00
07/30/2022 15:00	2	2.6	11.4	12.0	28.3	1,016,297.5	0.00	1.00
07/30/2022 16:00	1	2.5	11.1	12.3	25.5	1,017,673.4	0.00	1.00
07/30/2022 17:00	1	2.2	10.0	13.1	18.1	1,010,213.8	0.00	1.00
07/30/2022 18:00	1	2.0	8.9	13.7	16.5	1,019,080.0	0.00	1.00
07/30/2022 19:00	1	1.9	8.8	13.8	16.8	1,028,418.4	0.00	1.00
07/30/2022 20:00	1	1.9	8.7	13.9	17.1	1,035,480.5	0.00	1.00
07/30/2022 21:00	1	2.0	9.2	13.6	18.3	1,027,631.1	0.00	1.00
07/30/2022 22:00	1	1.9	8.8	13.9	17.5	1,036,458.6	0.00	1.00
07/30/2022 23:00	1	1.9	8.7	13.9	17.6	1,030,589.7	0.00	1.00
Average/Sum#:	1	2.0	9.6	13.8	17.7	949,106.8	0.00 #	24.00 #
Minimum:	0	1.6	7.3	12.0	9.6	658,869.8	0.00	1.00
Maximum:	2	2.6	13.5	14.7	28.3	1,042,523.2	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT2 NH3Slip, Ppmvdc	Unit CT2 NOx, Ppm	Unit CT2 NOx, _SCR, Ppm	Unit CT2 O2, Dry, Pct	Unit CT2 NH3Inj, LbPerHr	Unit CT2 ExhaustFlow, LbPerHr	Unit CT2 SUSD, Hr	Unit CT2 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/31/2022 00:00	1	1.9	8.7	13.9	17.6	1,031,176.6	0.00	1.00
07/31/2022 01:00	1	1.9	8.7	14.0	17.7	1,043,342.6	0.00	1.00
07/31/2022 02:00	1	1.9	8.9	14.0	17.7	1,041,953.3	0.00	1.00
07/31/2022 03:00	1	1.8	9.0	14.3	17.8	948,222.6	0.00	1.00
07/31/2022 04:00	1	1.6	14.0	14.6	21.2	656,019.5	0.00	1.00
07/31/2022 05:00	0	1.6	10.7	14.5	13.1	841,126.1	0.00	1.00
07/31/2022 06:00	0	1.6	8.6	14.4	12.8	873,271.4	0.00	1.00
07/31/2022 07:00	1	1.7	13.5	14.6	23.2	669,279.0	0.00	1.00
07/31/2022 08:00	1	1.7	14.8	14.7	22.6	652,906.2	0.00	1.00
07/31/2022 09:00	1	1.7	12.5	14.6	17.5	664,931.6	0.00	1.00
07/31/2022 10:00	0	1.6	8.8	14.4	10.4	890,547.2	0.00	1.00
07/31/2022 11:00	1	1.9	8.4	13.9	16.1	1,024,720.7	0.00	1.00
07/31/2022 12:00	1	1.9	8.4	13.9	16.5	1,023,938.2	0.00	1.00
07/31/2022 13:00	1	1.9	8.7	13.8	16.5	1,011,445.3	0.00	1.00
07/31/2022 14:00	1	2.0	9.6	13.4	18.9	1,019,582.1	0.00	1.00
07/31/2022 15:00	1	2.0	9.3	13.5	17.7	1,012,633.8	0.00	1.00
07/31/2022 16:00	1	2.1	9.6	13.3	19.9	1,014,094.8	0.00	1.00
07/31/2022 17:00	1	2.2	10.6	12.8	22.4	1,013,881.2	0.00	1.00
07/31/2022 18:00	1	1.9	8.8	13.7	16.7	1,008,999.5	0.00	1.00
07/31/2022 19:00	1	1.9	8.7	13.9	17.0	1,029,024.6	0.00	1.00
07/31/2022 20:00	1	1.9	8.7	13.9	17.1	1,036,067.4	0.00	1.00
07/31/2022 21:00	1	1.9	8.9	13.8	17.9	1,035,940.6	0.00	1.00
07/31/2022 22:00	1	1.8	8.5	14.1	15.7	923,958.7	0.00	1.00
07/31/2022 23:00	1	1.7	11.6	14.6	17.1	684,929.6	0.00	1.00
Average/Sum#:	1	1.8	9.9	14.0	17.5	922,999.7	0.00 #	24.00 #
Minimum:	0	1.6	8.4	12.8	10.4	652,906.2	0.00	1.00
Maximum:	1	2.2	14.8	14.7	23.2	1,043,342.6	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
 Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:	> 10							
	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2
	NH3Slip, Ppmvdc	NOx, Ppm	NOx, _SCR, Ppm	O2, Dry, Pct	NH3Inj, LbPerHr	ExhaustFlow, LbPerHr	SUSD, Hr	OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/01/2022 00:00	1	1.7	8.0	14.3	12.0	846,760.7	0.00	1.00
08/01/2022 01:00	1	1.7	12.4	14.6	18.2	669,713.7	0.00	1.00
08/01/2022 02:00	1	1.6	12.6	14.6	18.9	671,452.7	0.00	1.00
08/01/2022 03:00	0	1.8	9.3	14.3	12.5	860,870.0	0.00	1.00
08/01/2022 04:00	1	1.9	8.5	14.0	17.0	1,035,007.0	0.00	1.00
08/01/2022 05:00	1	2.0	8.7	14.0	18.5	1,117,569.4	0.00	1.00
08/01/2022 06:00	0	1.8	11.4	13.1	26.8	1,056,563.6	0.00	1.00
08/01/2022 07:00	0	2.0	8.9	14.1	17.3	1,049,019.4	0.00	1.00
08/01/2022 08:00	0	2.0	8.9	14.0	17.0	1,035,800.8	0.00	1.00
08/01/2022 09:00	0	2.0	8.9	14.0	17.0	1,044,731.9	0.00	1.00
08/01/2022 10:00	0	2.0	8.8	14.0	16.9	1,040,564.1	0.00	1.00
08/01/2022 11:00	0	2.0	8.8	14.0	16.4	1,041,754.9	0.00	1.00
08/01/2022 12:00	0	2.0	8.7	13.9	16.4	1,026,285.8	0.00	1.00
08/01/2022 13:00	0	2.0	8.7	13.9	16.3	1,027,263.9	0.00	1.00
08/01/2022 14:00	0	2.0	8.7	13.9	16.1	1,028,046.4	0.00	1.00
08/01/2022 15:00	0	2.0	8.8	13.8	16.2	1,018,774.6	0.00	1.00
08/01/2022 16:00	0	2.0	8.7	13.8	16.1	1,014,917.1	0.00	1.00
08/01/2022 17:00	0	2.0	8.7	13.8	15.9	1,014,724.2	0.00	1.00
08/01/2022 18:00	0	2.0	8.8	13.9	16.1	1,028,829.0	0.00	1.00
08/01/2022 19:00	0	2.0	8.7	13.9	15.9	1,027,263.9	0.00	1.00
08/01/2022 20:00	0	2.0	8.9	13.8	15.9	1,022,825.0	0.00	1.00
08/01/2022 21:00	1	2.0	8.9	13.8	16.5	1,024,560.9	0.00	1.00
08/01/2022 22:00	0	1.9	8.3	14.1	13.8	936,041.8	0.00	1.00
08/01/2022 23:00	1	1.8	12.1	14.6	18.5	673,626.4	0.00	1.00
Average/Sum#:	0	1.9	9.3	14.0	16.8	971,373.6	0.00 #	24.00 #
Minimum:	0	1.6	8.0	13.1	12.0	669,713.7	0.00	1.00
Maximum:	1	2.0	12.6	14.6	26.8	1,117,569.4	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
 Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:	> 10							
	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2
	NH3Slip, Ppmvdc	NOx, Ppm	NOx, _SCR, Ppm	O2, Dry, Pct	NH3Inj, LbPerHr	ExhaustFlow, LbPerHr	SUSD, Hr	OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/02/2022 00:00	1	1.8	12.6	14.6	17.0	663,844.8	0.00	1.00
08/02/2022 01:00	1	1.8	13.7	14.7	19.4	664,170.8	0.00	1.00
08/02/2022 02:00	1	1.8	15.1	14.7	21.0	652,685.3	0.00	1.00
08/02/2022 03:00	0	1.8	12.8	14.6	16.2	668,409.5	0.00	1.00
08/02/2022 04:00	0	1.8	9.4	14.3	11.1	861,284.9	0.00	1.00
08/02/2022 05:00	0	1.9	8.7	14.0	16.1	1,043,144.1	0.00	1.00
08/02/2022 06:00	1	1.7	10.5	14.3	18.1	834,103.9	0.00	1.00
08/02/2022 07:00	1	1.7	14.5	14.7	20.5	650,255.7	0.00	1.00
08/02/2022 08:00	1	1.7	13.8	14.7	19.1	649,814.0	0.00	1.00
08/02/2022 09:00	1	1.7	13.3	14.8	18.5	659,344.2	0.00	1.00
08/02/2022 10:00	1	1.7	12.8	14.8	17.4	658,446.2	0.00	1.00
08/02/2022 11:00	0	1.7	9.1	14.3	10.3	837,631.2	0.00	1.00
08/02/2022 12:00	0	2.0	9.2	13.6	15.9	1,012,436.1	0.00	1.00
08/02/2022 13:00	1	1.9	9.4	13.5	16.9	1,004,121.2	0.00	1.00
08/02/2022 14:00	1	2.0	9.3	13.6	17.0	1,006,620.7	0.00	1.00
08/02/2022 15:00	1	2.0	9.3	13.6	17.8	1,011,310.5	0.00	1.00
08/02/2022 16:00	1	2.2	11.3	12.7	23.0	1,012,372.0	0.00	1.00
08/02/2022 17:00	2	2.4	12.1	12.1	28.2	1,006,526.9	0.00	1.00
08/02/2022 18:00	1	2.0	10.0	13.3	18.1	998,238.3	0.00	1.00
08/02/2022 19:00	0	1.9	9.2	13.8	16.9	1,019,546.1	0.00	1.00
08/02/2022 20:00	1	2.0	9.5	13.7	17.7	1,021,742.7	0.00	1.00
08/02/2022 21:00	0	1.9	9.2	13.9	17.2	1,027,459.6	0.00	1.00
08/02/2022 22:00	0	1.9	9.1	13.9	17.2	1,028,829.0	0.00	1.00
08/02/2022 23:00	1	1.9	9.2	14.0	17.7	1,043,342.6	0.00	1.00
Average/Sum#:	1	1.9	11.0	14.0	17.8	876,486.7	0.00 #	24.00 #
Minimum:	0	1.7	8.7	12.1	10.3	649,814.0	0.00	1.00
Maximum:	2	2.4	15.1	14.8	28.2	1,043,342.6	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10								
	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2
	NH3Slip, Ppmvdc	NOx, Ppm	NOx, _SCR, Ppm	O2, Dry, Pct	NH3Inj, LbPerHr	ExhaustFlow, LbPerHr	SUSD, Hr	OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/03/2022 00:00	1	1.7	11.9	14.5	19.6	757,890.8	0.00	1.00
08/03/2022 01:00	1	1.7	12.6	14.6	17.4	670,800.6	0.00	1.00
08/03/2022 02:00	1	1.8	13.2	14.6	18.6	669,931.1	0.00	1.00
08/03/2022 03:00	1	1.7	13.3	14.6	18.5	668,409.5	0.00	1.00
08/03/2022 04:00	0	1.6	10.0	14.3	13.1	857,135.2	0.00	1.00
08/03/2022 05:00	0	1.9	9.0	14.1	17.2	1,044,991.6	0.00	1.00
08/03/2022 06:00	1	1.7	11.7	14.5	17.5	797,475.7	0.00	1.00
08/03/2022 07:00	1	1.7	14.3	14.7	16.8	661,962.1	0.00	1.00
08/03/2022 08:00	4	0.7	12.2	14.7	20.9	678,527.7	0.00	1.00
08/03/2022 09:00	1	1.1	13.4	14.8	12.5	669,671.0	0.00	1.00
08/03/2022 10:00	1	1.0	13.5	14.8	20.6	661,364.6	0.00	1.00
08/03/2022 11:00	1	1.0	10.1	14.6	14.5	686,233.8	0.00	1.00
08/03/2022 12:00	1	1.0	8.9	14.7	11.4	795,149.6	0.00	1.00
08/03/2022 13:00	1	1.4	8.7	13.6	14.3	959,159.8	0.00	1.00
08/03/2022 14:00	1	1.9	9.6	13.4	16.0	995,662.8	0.00	1.00
08/03/2022 15:00	1	2.0	9.3	13.5	17.1	992,647.6	0.00	1.00
08/03/2022 16:00	1	2.0	9.4	13.5	16.9	1,000,049.9	0.00	1.00
08/03/2022 17:00	2	2.5	11.9	11.9	29.2	1,004,396.7	0.00	1.00
08/03/2022 18:00	2	2.4	12.0	11.9	29.8	1,010,178.7	0.00	1.00
08/03/2022 19:00	2	2.4	12.0	12.0	29.0	1,013,989.5	0.00	1.00
08/03/2022 20:00	1	2.3	11.6	12.6	23.6	1,014,694.0	0.00	1.00
08/03/2022 21:00	0	2.0	9.4	13.7	16.5	1,013,374.0	0.00	1.00
08/03/2022 22:00	0	1.9	9.2	13.8	16.8	1,016,074.3	0.00	1.00
08/03/2022 23:00	0	1.9	9.3	13.8	16.9	1,019,160.3	0.00	1.00
Average/Sum#:	1	1.7	11.1	13.9	18.5	860,788.8	0.00 #	24.00 #
Minimum:	0	0.7	8.7	11.9	11.4	661,364.6	0.00	1.00
Maximum:	4	2.5	14.3	14.8	29.8	1,044,991.6	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10								
	Unit CT2 NH3Slip, Ppmvdc	Unit CT2 NOx, Ppm	Unit CT2 NOx, _SCR, Ppm	Unit CT2 O2, Dry, Pct	Unit CT2 NH3Inj, LbPerHr	Unit CT2 ExhaustFlow, LbPerHr	Unit CT2 SUSD, Hr	Unit CT2 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/04/2022 00:00	0	1.9	9.1	13.9	17.0	1,025,698.9	0.00	1.00
08/04/2022 01:00	0	1.9	9.1	13.9	17.1	1,024,329.4	0.00	1.00
08/04/2022 02:00	0	1.8	8.8	14.0	15.7	989,954.9	0.00	1.00
08/04/2022 03:00	1	1.7	12.1	14.6	18.1	676,886.9	0.00	1.00
08/04/2022 04:00	0	1.7	9.5	14.4	13.1	846,725.6	0.00	1.00
08/04/2022 05:00	0	1.9	9.1	14.0	17.1	1,038,976.3	0.00	1.00
08/04/2022 06:00	0	1.8	8.3	14.2	14.4	992,117.3	0.00	1.00
08/04/2022 07:00	1	1.7	9.0	14.4	14.6	859,155.8	0.00	1.00
08/04/2022 08:00	0	1.7	9.5	14.3	12.2	856,305.2	0.00	1.00
08/04/2022 09:00	0	1.9	9.3	13.9	17.2	1,026,090.1	0.00	1.00
08/04/2022 10:00	0	1.9	9.3	13.9	16.9	1,028,046.4	0.00	1.00
08/04/2022 11:00	0	1.9	9.3	13.8	16.6	1,021,667.7	0.00	1.00
08/04/2022 12:00	1	2.0	9.6	13.5	18.0	1,010,783.2	0.00	1.00
08/04/2022 13:00	1	2.2	10.7	13.0	20.8	1,009,040.4	0.00	1.00
08/04/2022 14:00	2	2.5	12.5	11.9	31.2	1,014,439.2	0.00	1.00
08/04/2022 15:00	2	2.4	12.5	12.0	30.2	1,008,911.9	0.00	1.00
08/04/2022 16:00	2	2.4	12.4	12.1	28.9	1,009,328.0	0.00	1.00
08/04/2022 17:00	1	2.3	12.0	12.3	26.3	1,008,915.5	0.00	1.00
08/04/2022 18:00	1	2.2	11.3	12.9	21.8	1,015,085.8	0.00	1.00
08/04/2022 19:00	1	2.1	10.5	13.3	20.1	1,016,437.2	0.00	1.00
08/04/2022 20:00	0	1.9	9.5	13.8	17.4	1,020,703.4	0.00	1.00
08/04/2022 21:00	0	1.9	9.4	13.9	17.4	1,023,351.3	0.00	1.00
08/04/2022 22:00	0	1.9	9.5	14.0	17.9	1,035,205.4	0.00	1.00
08/04/2022 23:00	1	1.7	9.5	14.4	15.6	854,310.1	0.00	1.00
Average/Sum#:	1	2.0	10.1	13.6	19.0	975,519.4	0.00 #	24.00 #
Minimum:	0	1.7	8.3	11.9	12.2	676,886.9	0.00	1.00
Maximum:	2	2.5	12.5	14.6	31.2	1,038,976.3	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT2 NH3Slip, Ppmvdc	Unit CT2 NOx, Ppm	Unit CT2 NOx, _SCR, Ppm	Unit CT2 O2, Dry, Pct	Unit CT2 NH3Inj, LbPerHr	Unit CT2 ExhaustFlow, LbPerHr	Unit CT2 SUSD, Hr	Unit CT2 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/05/2022 00:00	1	1.6	11.7	14.5	16.1	712,314.7	0.00	1.00
08/05/2022 01:00	1	1.7	13.0	14.7	18.2	689,350.6	0.00	1.00
08/05/2022 02:00	1	1.4	12.3	14.5	12.1	734,139.9	0.00	1.00
08/05/2022 03:00	1	1.7	13.5	14.6	20.6	670,148.5	0.00	1.00
08/05/2022 04:00	0	1.6	11.1	14.5	14.9	785,065.3	0.00	1.00
08/05/2022 05:00	0	1.7	8.9	14.1	17.1	1,043,783.3	0.00	1.00
08/05/2022 06:00	1	1.8	9.2	14.0	18.3	1,044,533.4	0.00	1.00
08/05/2022 07:00	1	1.7	8.9	14.1	18.0	1,044,387.5	0.00	1.00
08/05/2022 08:00	1	1.7	8.8	14.1	17.9	1,043,581.9	0.00	1.00
08/05/2022 09:00	1	1.7	8.8	14.1	17.8	1,045,394.4	0.00	1.00
08/05/2022 10:00	1	1.8	8.8	14.0	17.4	1,032,426.9	0.00	1.00
08/05/2022 11:00	0	1.8	8.8	13.9	16.7	1,022,764.4	0.00	1.00
08/05/2022 12:00	0	1.8	8.8	13.9	16.9	1,025,307.6	0.00	1.00
08/05/2022 13:00	1	1.8	8.8	13.9	17.0	1,024,916.3	0.00	1.00
08/05/2022 14:00	0	1.8	8.8	13.8	16.6	1,013,952.7	0.00	1.00
08/05/2022 15:00	1	1.8	8.9	13.8	17.1	1,015,688.6	0.00	1.00
08/05/2022 16:00	0	1.8	8.9	13.8	16.9	1,016,460.1	0.00	1.00
08/05/2022 17:00	1	1.8	8.9	13.8	16.9	1,018,967.5	0.00	1.00
08/05/2022 18:00	0	1.8	8.9	13.8	16.7	1,018,196.0	0.00	1.00
08/05/2022 19:00	1	1.8	8.8	13.8	16.9	1,015,881.4	0.00	1.00
08/05/2022 20:00	1	1.8	8.8	13.9	17.3	1,026,872.7	0.00	1.00
08/05/2022 21:00	1	1.8	8.8	14.0	17.4	1,038,777.9	0.00	1.00
08/05/2022 22:00	1	1.7	9.0	14.2	17.3	929,369.1	0.00	1.00
08/05/2022 23:00	1	1.6	13.5	14.6	20.7	662,105.8	0.00	1.00
Average/Sum#:	1	1.7	9.8	14.1	17.2	944,766.1	0.00 #	24.00 #
Minimum:	0	1.4	8.8	13.8	12.1	662,105.8	0.00	1.00
Maximum:	1	1.8	13.5	14.7	20.7	1,045,394.4	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:	> 10							
	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2
	NH3Slip, Ppmvdc	NOx, Ppm	NOx, _SCR, Ppm	O2, Dry, Pct	NH3Inj, LbPerHr	ExhaustFlow, LbPerHr	SUSD, Hr	OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/06/2022 00:00	1	1.6	13.7	14.6	20.3	662,975.3	0.00	1.00
08/06/2022 01:00	1	1.6	14.5	14.7	21.8	667,263.1	0.00	1.00
08/06/2022 02:00	1	1.6	16.4	14.7	24.5	653,789.7	0.00	1.00
08/06/2022 03:00	1	1.6	16.4	14.7	24.7	653,348.0	0.00	1.00
08/06/2022 04:00	1	1.6	16.3	14.7	24.7	655,115.0	0.00	1.00
08/06/2022 05:00	1	1.6	15.0	14.7	22.2	669,471.8	0.00	1.00
08/06/2022 06:00	1	1.6	15.7	14.7	23.6	660,416.0	0.00	1.00
08/06/2022 07:00	1	1.6	16.0	14.7	24.0	652,685.3	0.00	1.00
08/06/2022 08:00	1	1.6	15.6	14.7	23.2	652,685.3	0.00	1.00
08/06/2022 09:00	1	1.6	15.1	14.7	22.3	651,801.8	0.00	1.00
08/06/2022 10:00	1	1.6	14.8	14.8	21.7	662,038.1	0.00	1.00
08/06/2022 11:00	1	1.6	14.4	14.8	20.8	660,466.6	0.00	1.00
08/06/2022 12:00	1	1.6	13.9	14.8	19.8	658,670.7	0.00	1.00
08/06/2022 13:00	1	1.6	13.5	14.8	19.0	657,323.7	0.00	1.00
08/06/2022 14:00	1	1.5	12.5	14.8	17.9	664,507.6	0.00	1.00
08/06/2022 15:00	1	1.5	12.8	14.8	18.2	659,344.2	0.00	1.00
08/06/2022 16:00	0	1.5	11.9	14.8	15.1	670,793.5	0.00	1.00
08/06/2022 17:00	0	1.6	11.0	14.7	13.5	687,141.8	0.00	1.00
08/06/2022 18:00	0	1.8	6.9	14.4	4.8	919,410.5	0.00	1.00
08/06/2022 19:00	0	1.8	7.9	14.3	11.8	933,076.0	0.00	1.00
08/06/2022 20:00	0	2.0	9.3	13.9	16.8	1,040,958.2	0.00	1.00
08/06/2022 21:00	1	1.9	9.3	14.2	16.6	931,004.2	0.00	1.00
08/06/2022 22:00	1	1.8	13.7	14.6	20.5	660,366.9	0.00	1.00
08/06/2022 23:00	1	1.8	13.4	14.6	19.1	665,583.7	0.00	1.00
Average/Sum#:	1	1.7	13.3	14.6	19.5	710,426.5	0.00 #	24.00 #
Minimum:	0	1.5	6.9	13.9	4.8	651,801.8	0.00	1.00
Maximum:	1	2.0	16.4	14.8	24.7	1,040,958.2	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT2 NH3Slip, Ppmvdc	Unit CT2 NOx, Ppm	Unit CT2 NOx, _SCR, Ppm	Unit CT2 O2, Dry, Pct	Unit CT2 NH3Inj, LbPerHr	Unit CT2 ExhaustFlow, LbPerHr	Unit CT2 SUSD, Hr	Unit CT2 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/07/2022 00:00	1	1.8	15.0	14.7	21.7	663,508.2	0.00	1.00
08/07/2022 01:00	1	1.8	13.3	14.6	18.3	671,452.7	0.00	1.00
08/07/2022 02:00	1	1.8	16.0	14.7	22.7	667,483.9	0.00	1.00
08/07/2022 03:00	1	1.8	16.7	14.7	24.3	654,010.6	0.00	1.00
08/07/2022 04:00	1	1.8	14.5	14.6	19.9	666,235.8	0.00	1.00
08/07/2022 05:00	1	1.8	14.6	14.6	21.9	666,018.5	0.00	1.00
08/07/2022 06:00	1	1.8	15.6	14.7	22.6	663,729.1	0.00	1.00
08/07/2022 07:00	1	1.8	16.1	14.7	23.4	654,894.1	0.00	1.00
08/07/2022 08:00	1	1.8	15.7	14.7	22.6	653,348.0	0.00	1.00
08/07/2022 09:00	1	1.8	15.5	14.7	22.4	651,139.2	0.00	1.00
08/07/2022 10:00	1	1.8	15.2	14.8	21.6	659,344.2	0.00	1.00
08/07/2022 11:00	1	1.8	14.8	14.8	20.9	658,221.7	0.00	1.00
08/07/2022 12:00	1	1.8	14.1	14.8	19.4	657,772.7	0.00	1.00
08/07/2022 13:00	1	1.7	13.4	14.8	18.5	659,568.7	0.00	1.00
08/07/2022 14:00	0	1.7	12.0	14.8	14.8	670,569.0	0.00	1.00
08/07/2022 15:00	1	1.7	12.4	14.8	17.1	664,058.6	0.00	1.00
08/07/2022 16:00	0	1.6	9.2	14.7	9.6	759,809.7	0.00	1.00
08/07/2022 17:00	0	1.9	8.2	14.1	11.9	968,867.8	0.00	1.00
08/07/2022 18:00	0	2.0	9.0	13.9	15.5	1,023,155.6	0.00	1.00
08/07/2022 19:00	0	2.0	8.9	14.0	16.3	1,034,808.5	0.00	1.00
08/07/2022 20:00	0	2.0	8.9	14.0	16.8	1,030,839.2	0.00	1.00
08/07/2022 21:00	0	2.0	8.9	14.0	17.1	1,032,625.4	0.00	1.00
08/07/2022 22:00	1	1.9	10.3	14.4	17.5	849,464.5	0.00	1.00
08/07/2022 23:00	1	1.8	13.3	14.6	19.1	670,583.2	0.00	1.00
Average/Sum#:	1	1.8	13.0	14.6	19.0	747,979.5	0.00 #	24.00 #
Minimum:	0	1.6	8.2	13.9	9.6	651,139.2	0.00	1.00
Maximum:	1	2.0	16.7	14.8	24.3	1,034,808.5	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:	> 10							
	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2
	NH3Slip, Ppmvdc	NOx, Ppm	NOx, _SCR, Ppm	O2, Dry, Pct	NH3Inj, LbPerHr	ExhaustFlow, LbPerHr	SUSD, Hr	OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/08/2022 00:00	1	1.8	13.2	14.6	19.2	678,191.1	0.00	1.00
08/08/2022 01:00	1	1.8	13.5	14.6	19.0	671,235.3	0.00	1.00
08/08/2022 02:00	1	1.9	14.0	14.6	19.3	670,800.6	0.00	1.00
08/08/2022 03:00	1	1.8	13.9	14.6	19.8	671,670.1	0.00	1.00
08/08/2022 04:00	0	1.8	9.5	14.4	12.0	913,511.4	0.00	1.00
08/08/2022 05:00	0	1.9	8.8	14.1	16.8	1,049,422.1	0.00	1.00
08/08/2022 06:00	1	1.7	10.7	14.4	18.5	847,989.7	0.00	1.00
08/08/2022 07:00	1	1.7	14.9	14.7	23.0	666,600.5	0.00	1.00
08/08/2022 08:00	1	1.7	14.9	14.7	21.4	659,753.3	0.00	1.00
08/08/2022 09:00	1	1.7	13.7	14.7	19.4	668,367.4	0.00	1.00
08/08/2022 10:00	0	1.6	12.3	14.7	15.8	677,202.4	0.00	1.00
08/08/2022 11:00	0	1.7	8.8	14.3	9.8	876,224.1	0.00	1.00
08/08/2022 12:00	0	1.9	9.1	13.8	15.7	1,021,474.9	0.00	1.00
08/08/2022 13:00	0	1.7	10.2	14.5	14.6	762,598.2	0.00	1.00
08/08/2022 14:00	0	1.6	8.0	14.5	8.7	876,431.6	0.00	1.00
08/08/2022 15:00	0	1.9	9.1	13.9	16.8	1,026,872.7	0.00	1.00
08/08/2022 16:00	0	1.9	9.3	13.8	17.1	1,019,160.3	0.00	1.00
08/08/2022 17:00	1	2.1	10.4	13.4	20.9	1,034,371.9	0.00	1.00
08/08/2022 18:00	1	2.1	11.0	13.1	20.3	1,026,717.2	0.00	1.00
08/08/2022 19:00	1	2.2	11.4	12.8	24.4	1,035,014.3	0.00	1.00
08/08/2022 20:00	1	2.1	11.2	12.9	23.9	1,030,149.5	0.00	1.00
08/08/2022 21:00	1	1.9	9.6	13.8	18.3	1,041,534.0	0.00	1.00
08/08/2022 22:00	1	1.9	9.3	13.9	17.7	1,030,980.9	0.00	1.00
08/08/2022 23:00	0	1.9	9.1	14.1	17.5	1,045,797.2	0.00	1.00
Average/Sum#:	1	1.8	11.1	14.1	17.9	875,086.3	0.00 #	24.00 #
Minimum:	0	1.6	8.0	12.8	8.7	659,753.3	0.00	1.00
Maximum:	1	2.2	14.9	14.7	24.4	1,049,422.1	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
 Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT2 NH3Slip, Ppmvdc	Unit CT2 NOx, Ppm	Unit CT2 NOx, _SCR, Ppm	Unit CT2 O2, Dry, Pct	Unit CT2 NH3Inj, LbPerHr	Unit CT2 ExhaustFlow, LbPerHr	Unit CT2 SUSD, Hr	Unit CT2 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/09/2022 00:00	0	1.9	9.1	14.1	17.8	1,047,005.5	0.00	1.00
08/09/2022 01:00	1	1.9	9.0	14.1	17.7	1,045,595.8	0.00	1.00
08/09/2022 02:00	0	1.9	9.3	14.1	17.7	1,046,401.3	0.00	1.00
08/09/2022 03:00	1	1.9	9.2	14.0	17.8	1,031,037.6	0.00	1.00
08/09/2022 04:00	0	1.9	9.1	14.1	17.7	1,047,609.7	0.00	1.00
08/09/2022 05:00	0	1.9	9.1	14.1	17.6	1,045,797.2	0.00	1.00
08/09/2022 06:00	0	1.9	8.9	14.1	17.5	1,043,984.7	0.00	1.00
08/09/2022 07:00	0	1.9	8.9	14.1	17.5	1,045,595.8	0.00	1.00
08/09/2022 08:00	0	1.9	8.9	14.0	17.2	1,032,823.8	0.00	1.00
08/09/2022 09:00	0	1.9	8.9	14.0	17.2	1,035,999.3	0.00	1.00
08/09/2022 10:00	0	1.9	9.0	14.0	17.0	1,036,793.2	0.00	1.00
08/09/2022 11:00	0	1.9	9.0	13.9	16.7	1,023,742.5	0.00	1.00
08/09/2022 12:00	0	1.8	8.7	14.0	14.9	999,481.3	0.00	1.00
08/09/2022 13:00	1	1.6	11.6	14.6	16.7	683,625.3	0.00	1.00
08/09/2022 14:00	0	1.7	8.9	14.4	11.8	877,906.4	0.00	1.00
08/09/2022 15:00	0	1.9	9.2	13.9	17.1	1,024,916.3	0.00	1.00
08/09/2022 16:00	0	1.9	9.1	13.9	17.2	1,022,177.5	0.00	1.00
08/09/2022 17:00	0	1.9	9.1	13.9	17.1	1,027,459.6	0.00	1.00
08/09/2022 18:00	1	2.3	11.0	13.1	22.5	1,043,571.6	0.00	1.00
08/09/2022 19:00	1	2.1	10.3	13.6	19.9	1,046,202.7	0.00	1.00
08/09/2022 20:00	1	2.3	11.4	13.1	22.6	1,053,052.2	0.00	1.00
08/09/2022 21:00	1	2.2	10.5	13.5	20.7	1,051,125.7	0.00	1.00
08/09/2022 22:00	1	2.1	10.0	13.7	18.2	1,048,180.2	0.00	1.00
08/09/2022 23:00	0	2.0	9.0	14.1	16.5	1,030,894.6	0.00	1.00
Average/Sum#:	0	1.9	9.5	13.9	17.7	1,016,290.8	0.00 #	24.00 #
Minimum:	0	1.6	8.7	13.1	11.8	683,625.3	0.00	1.00
Maximum:	1	2.3	11.6	14.6	22.6	1,053,052.2	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:	> 10							
	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2
	NH3Slip, Ppmvdc	NOx, Ppm	NOx, _SCR, Ppm	O2, Dry, Pct	NH3Inj, LbPerHr	ExhaustFlow, LbPerHr	SUSD, Hr	OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/10/2022 00:00	0	1.9	7.6	14.4	11.9	975,662.2	0.00	1.00
08/10/2022 01:00	0	1.9	7.7	14.4	13.4	1,001,154.6	0.00	1.00
08/10/2022 02:00	0	1.9	8.3	14.4	14.4	1,008,107.0	0.00	1.00
08/10/2022 03:00	0	1.9	8.6	14.3	16.1	1,039,310.1	0.00	1.00
08/10/2022 04:00	1	2.2	10.5	13.5	20.9	1,058,528.0	0.00	1.00
08/10/2022 05:00	1	2.1	9.9	13.7	18.8	1,044,566.5	0.00	1.00
08/10/2022 06:00	1	1.8	11.3	14.4	20.3	850,728.6	0.00	1.00
08/10/2022 07:00	1	1.8	14.3	14.6	20.1	662,323.2	0.00	1.00
08/10/2022 08:00	1	1.8	13.6	14.6	18.4	666,453.2	0.00	1.00
08/10/2022 09:00	1	1.8	13.6	14.6	18.7	661,453.7	0.00	1.00
08/10/2022 10:00	1	1.8	12.5	14.7	17.1	680,957.3	0.00	1.00
08/10/2022 11:00	0	1.7	10.9	14.6	14.4	724,056.0	0.00	1.00
08/10/2022 12:00	1	1.7	12.6	14.7	17.3	675,214.6	0.00	1.00
08/10/2022 13:00	0	1.7	10.6	14.6	12.1	732,098.6	0.00	1.00
08/10/2022 14:00	0	2.1	8.7	13.9	12.7	963,096.6	0.00	1.00
08/10/2022 15:00	1	2.2	10.3	13.4	18.8	1,023,416.5	0.00	1.00
08/10/2022 16:00	0	2.0	9.0	14.0	16.3	1,033,816.2	0.00	1.00
08/10/2022 17:00	0	2.1	9.5	13.8	17.3	1,034,397.6	0.00	1.00
08/10/2022 18:00	1	2.3	11.5	12.9	23.2	1,039,221.9	0.00	1.00
08/10/2022 19:00	1	2.3	11.3	13.0	21.8	1,034,868.8	0.00	1.00
08/10/2022 20:00	1	2.1	10.4	13.4	19.2	1,038,936.6	0.00	1.00
08/10/2022 21:00	1	2.1	9.8	13.7	18.4	1,043,235.1	0.00	1.00
08/10/2022 22:00	0	1.9	8.4	14.2	14.0	978,423.1	0.00	1.00
08/10/2022 23:00	0	1.9	7.3	14.4	11.9	975,030.2	0.00	1.00
Average/Sum#:	1	2.0	10.3	14.1	17.0	914,377.3	0.00 #	24.00 #
Minimum:	0	1.7	7.3	12.9	11.9	661,453.7	0.00	1.00
Maximum:	1	2.3	14.3	14.7	23.2	1,058,528.0	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10								
	Unit CT2 NH3Slip, Ppmvdc	Unit CT2 NOx, Ppm	Unit CT2 NOx, _SCR, Ppm	Unit CT2 O2, Dry, Pct	Unit CT2 NH3Inj, LbPerHr	Unit CT2 ExhaustFlow, LbPerHr	Unit CT2 SUSD, Hr	Unit CT2 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/11/2022 00:00	0	1.9	7.4	14.4	12.6	981,982.6	0.00	1.00
08/11/2022 01:00	0	1.9	7.5	14.4	12.4	971,870.0	0.00	1.00
08/11/2022 02:00	0	1.9	7.8	14.3	11.3	906,102.5	0.00	1.00
08/11/2022 03:00	0	1.9	7.5	14.4	10.0	955,015.5	0.00	1.00
08/11/2022 04:00	0	1.9	7.6	14.4	12.7	979,665.1	0.00	1.00
08/11/2022 05:00	0	1.8	7.7	14.4	13.7	1,001,997.3	0.00	1.00
08/11/2022 06:00	1	1.7	10.0	14.4	16.1	821,654.6	0.00	1.00
08/11/2022 07:00	0	1.6	10.8	14.4	13.9	732,536.7	0.00	1.00
08/11/2022 08:00	1	1.7	13.0	14.6	18.3	669,061.6	0.00	1.00
08/11/2022 09:00	1	1.7	12.6	14.6	17.6	667,974.8	0.00	1.00
08/11/2022 10:00	0	1.7	12.2	14.7	16.7	677,865.1	0.00	1.00
08/11/2022 11:00	0	1.6	8.1	14.5	7.2	894,833.2	0.00	1.00
08/11/2022 12:00	0	1.7	7.7	14.4	10.3	938,161.0	0.00	1.00
08/11/2022 13:00	1	2.1	10.8	13.1	21.6	1,033,388.7	0.00	1.00
08/11/2022 14:00	1	2.0	10.0	13.5	18.8	1,025,957.9	0.00	1.00
08/11/2022 15:00	1	2.1	11.0	13.1	21.6	1,026,541.6	0.00	1.00
08/11/2022 16:00	1	2.1	11.1	13.1	21.9	1,024,083.6	0.00	1.00
08/11/2022 17:00	1	2.2	11.3	13.0	22.2	1,029,148.4	0.00	1.00
08/11/2022 18:00	1	2.4	11.9	12.8	23.5	1,039,240.9	0.00	1.00
08/11/2022 19:00	1	2.3	11.2	13.0	21.5	1,031,401.9	0.00	1.00
08/11/2022 20:00	1	2.4	12.1	12.6	25.2	1,035,977.8	0.00	1.00
08/11/2022 21:00	0	2.0	9.2	14.0	15.6	1,020,518.9	0.00	1.00
08/11/2022 22:00	0	1.9	7.8	14.4	12.0	975,662.2	0.00	1.00
08/11/2022 23:00	0	1.9	7.4	14.4	12.4	982,825.3	0.00	1.00
Average/Sum#:	0	1.9	9.7	14.0	16.2	934,311.1	0.00 #	24.00 #
Minimum:	0	1.6	7.4	12.6	7.2	667,974.8	0.00	1.00
Maximum:	1	2.4	13.0	14.7	25.2	1,039,240.9	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:	> 10							
	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2
	NH3Slip, Ppmvdc	NOx, Ppm	NOx, _SCR, Ppm	O2, Dry, Pct	NH3Inj, LbPerHr	ExhaustFlow, LbPerHr	SUSD, Hr	OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/12/2022 00:00	0	1.9	8.1	14.4	14.8	1,034,231.4	0.00	1.00
08/12/2022 01:00	0	1.9	7.8	14.4	14.1	1,016,955.6	0.00	1.00
08/12/2022 02:00	0	1.9	7.9	14.3	12.5	926,228.9	0.00	1.00
08/12/2022 03:00	0	1.9	7.7	14.4	13.2	980,297.2	0.00	1.00
08/12/2022 04:00	0	1.9	8.1	14.4	15.0	1,021,801.3	0.00	1.00
08/12/2022 05:00	0	1.8	8.0	14.4	14.3	1,018,430.4	0.00	1.00
08/12/2022 06:00	1	1.8	10.9	14.4	16.6	760,346.6	0.00	1.00
08/12/2022 07:00	1	1.7	11.7	14.5	17.2	751,899.6	0.00	1.00
08/12/2022 08:00	1	1.7	14.5	14.7	19.8	665,937.8	0.00	1.00
08/12/2022 09:00	1	1.7	14.0	14.7	21.0	665,496.1	0.00	1.00
08/12/2022 10:00	0	1.7	12.6	14.7	16.5	675,656.3	0.00	1.00
08/12/2022 11:00	1	1.7	12.9	14.7	17.8	668,588.3	0.00	1.00
08/12/2022 12:00	0	1.6	9.8	14.5	11.4	776,078.5	0.00	1.00
08/12/2022 13:00	0	1.8	9.1	13.8	16.2	1,020,703.4	0.00	1.00
08/12/2022 14:00	1	1.8	9.2	13.8	17.7	1,028,611.3	0.00	1.00
08/12/2022 15:00	1	1.8	9.4	13.8	18.0	1,023,596.5	0.00	1.00
08/12/2022 16:00	0	1.8	9.4	13.9	18.0	1,037,436.8	0.00	1.00
08/12/2022 17:00	1	2.0	11.3	13.1	23.3	1,040,235.8	0.00	1.00
08/12/2022 18:00	1	2.3	12.1	12.7	25.3	1,040,762.5	0.00	1.00
08/12/2022 19:00	1	2.1	10.8	13.2	20.5	1,027,424.0	0.00	1.00
08/12/2022 20:00	1	2.1	10.3	13.5	19.4	1,038,541.8	0.00	1.00
08/12/2022 21:00	0	1.9	9.2	14.0	16.8	1,020,915.8	0.00	1.00
08/12/2022 22:00	0	1.8	8.1	14.3	11.8	842,611.0	0.00	1.00
08/12/2022 23:00	0	1.8	7.5	14.4	11.9	964,496.1	0.00	1.00
Average/Sum#:	0	1.9	10.0	14.1	16.8	918,636.8	0.00 #	24.00 #
Minimum:	0	1.6	7.5	12.7	11.4	665,496.1	0.00	1.00
Maximum:	1	2.3	14.5	14.7	25.3	1,040,762.5	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT2 NH3Slip, Ppmvdc	Unit CT2 NOx, Ppm	Unit CT2 NOx, _SCR, Ppm	Unit CT2 O2, Dry, Pct	Unit CT2 NH3Inj, LbPerHr	Unit CT2 ExhaustFlow, LbPerHr	Unit CT2 SUSD, Hr	Unit CT2 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/13/2022 00:00	0	1.8	7.5	14.4	12.4	946,588.3	0.00	1.00
08/13/2022 01:00	0	1.9	7.5	14.4	12.7	954,594.1	0.00	1.00
08/13/2022 02:00	0	2.0	7.9	14.4	12.6	957,333.0	0.00	1.00
08/13/2022 03:00	0	1.8	7.8	14.3	13.7	960,049.5	0.00	1.00
08/13/2022 04:00	0	1.8	7.7	14.4	14.0	1,004,104.1	0.00	1.00
08/13/2022 05:00	0	1.8	7.8	14.4	13.9	994,202.1	0.00	1.00
08/13/2022 06:00	1	1.7	12.0	14.4	20.6	778,043.7	0.00	1.00
08/13/2022 07:00	1	1.7	15.2	14.7	21.9	667,042.2	0.00	1.00
08/13/2022 08:00	1	1.7	14.7	14.7	20.9	666,158.7	0.00	1.00
08/13/2022 09:00	1	1.6	13.0	14.7	18.4	677,865.1	0.00	1.00
08/13/2022 10:00	1	1.5	13.0	14.7	17.5	671,017.9	0.00	1.00
08/13/2022 11:00	0	1.6	12.3	14.7	16.3	675,214.6	0.00	1.00
08/13/2022 12:00	0	1.6	9.5	14.5	9.5	759,602.6	0.00	1.00
08/13/2022 13:00	0	1.7	9.0	14.3	12.3	872,696.8	0.00	1.00
08/13/2022 14:00	0	1.9	9.3	13.9	16.8	1,024,525.1	0.00	1.00
08/13/2022 15:00	0	1.9	9.3	13.9	17.1	1,025,698.9	0.00	1.00
08/13/2022 16:00	0	1.9	9.5	13.9	17.5	1,032,937.2	0.00	1.00
08/13/2022 17:00	1	2.1	10.8	13.3	21.5	1,034,095.6	0.00	1.00
08/13/2022 18:00	1	2.0	10.3	13.5	18.5	1,028,363.7	0.00	1.00
08/13/2022 19:00	0	1.9	9.2	13.9	17.0	1,026,481.4	0.00	1.00
08/13/2022 20:00	0	1.8	8.5	14.1	14.4	960,208.2	0.00	1.00
08/13/2022 21:00	1	1.7	12.0	14.6	18.9	709,492.3	0.00	1.00
08/13/2022 22:00	0	1.6	10.2	14.4	11.9	764,770.8	0.00	1.00
08/13/2022 23:00	0	1.7	7.5	14.4	8.7	921,938.6	0.00	1.00
Average/Sum#:	0	1.8	10.1	14.3	15.8	879,709.4	0.00 #	24.00 #
Minimum:	0	1.5	7.5	13.3	8.7	666,158.7	0.00	1.00
Maximum:	1	2.1	15.2	14.7	21.9	1,034,095.6	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:	> 10							
	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2
	NH3Slip, Ppmvdc	NOx, Ppm	NOx, _SCR, Ppm	O2, Dry, Pct	NH3Inj, LbPerHr	ExhaustFlow, LbPerHr	SUSD, Hr	OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/14/2022 00:00	1	1.7	9.5	14.3	14.9	793,021.2	0.00	1.00
08/14/2022 01:00	0	1.7	8.3	14.3	9.2	830,784.1	0.00	1.00
08/14/2022 02:00	0	1.8	8.7	14.3	10.5	854,230.3	0.00	1.00
08/14/2022 03:00	1	1.7	8.5	14.3	11.6	851,533.0	0.00	1.00
08/14/2022 04:00	0	1.6	8.6	14.2	10.3	804,485.7	0.00	1.00
08/14/2022 05:00	1	1.7	10.4	14.4	15.7	770,248.5	0.00	1.00
08/14/2022 06:00	0	1.8	8.5	14.2	14.3	1,022,776.1	0.00	1.00
08/14/2022 07:00	0	1.8	8.6	14.2	15.8	1,023,184.8	0.00	1.00
08/14/2022 08:00	1	1.7	12.9	14.6	20.2	686,016.4	0.00	1.00
08/14/2022 09:00	1	1.7	12.9	14.7	18.5	676,981.6	0.00	1.00
08/14/2022 10:00	0	1.8	9.7	14.4	12.4	847,357.7	0.00	1.00
08/14/2022 11:00	0	2.0	9.3	13.8	16.7	1,029,961.4	0.00	1.00
08/14/2022 12:00	1	2.1	10.5	13.3	19.6	1,021,122.1	0.00	1.00
08/14/2022 13:00	0	2.0	9.5	13.8	16.9	1,024,175.1	0.00	1.00
08/14/2022 14:00	1	1.7	10.5	14.6	15.6	768,181.9	0.00	1.00
08/14/2022 15:00	0	1.6	9.0	14.6	9.8	799,265.6	0.00	1.00
08/14/2022 16:00	1	1.8	9.5	14.5	11.7	779,288.1	0.00	1.00
08/14/2022 17:00	0	1.9	8.0	14.4	14.0	981,982.6	0.00	1.00
08/14/2022 18:00	1	2.0	9.6	13.8	17.6	1,013,374.0	0.00	1.00
08/14/2022 19:00	0	2.0	9.5	13.8	17.3	1,013,952.7	0.00	1.00
08/14/2022 20:00	1	1.9	9.1	14.1	16.0	916,306.0	0.00	1.00
08/14/2022 21:00	1	1.7	11.9	14.6	16.4	683,408.0	0.00	1.00
08/14/2022 22:00	1	1.6	13.1	14.7	17.8	670,355.3	0.00	1.00
08/14/2022 23:00	1	1.7	12.7	14.7	17.9	679,190.3	0.00	1.00
Average/Sum#:	1	1.8	10.0	14.3	15.0	855,882.6	0.00 #	24.00 #
Minimum:	0	1.6	8.0	13.3	9.2	670,355.3	0.00	1.00
Maximum:	1	2.1	13.1	14.7	20.2	1,029,961.4	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT2 NH3Slip, Ppmvdc	Unit CT2 NOx, Ppm	Unit CT2 NOx, _SCR, Ppm	Unit CT2 O2, Dry, Pct	Unit CT2 NH3Inj, LbPerHr	Unit CT2 ExhaustFlow, LbPerHr	Unit CT2 SUSD, Hr	Unit CT2 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/15/2022 00:00	1	1.8	13.4	14.7	19.1	675,435.4	0.00	1.00
08/15/2022 01:00	1	1.7	13.7	14.7	20.0	674,993.7	0.00	1.00
08/15/2022 02:00	1	1.8	14.3	14.7	20.0	675,214.6	0.00	1.00
08/15/2022 03:00	0	1.7	12.5	14.5	16.8	696,266.7	0.00	1.00
08/15/2022 04:00	0	1.7	10.2	14.4	10.3	771,723.3	0.00	1.00
08/15/2022 05:00	0	1.8	7.8	14.3	10.2	861,492.4	0.00	1.00
08/15/2022 06:00	1	1.8	13.2	14.5	21.5	711,244.8	0.00	1.00
08/15/2022 07:00	1	1.7	15.3	14.7	22.3	660,416.0	0.00	1.00
08/15/2022 08:00	1	1.7	16.2	14.8	23.6	659,793.2	0.00	1.00
08/15/2022 09:00	1	1.7	13.8	14.8	18.7	676,181.4	0.00	1.00
08/15/2022 10:00	0	1.6	11.3	14.6	14.8	707,753.3	0.00	1.00
08/15/2022 11:00	0	1.7	11.5	14.8	15.2	684,712.2	0.00	1.00
08/15/2022 12:00	0	1.6	10.1	14.7	12.2	730,212.4	0.00	1.00
08/15/2022 13:00	0	2.0	9.0	13.9	14.2	980,312.2	0.00	1.00
08/15/2022 14:00	1	2.4	12.2	12.7	25.8	1,031,243.4	0.00	1.00
08/15/2022 15:00	1	2.3	12.6	12.6	27.1	1,029,543.2	0.00	1.00
08/15/2022 16:00	1	2.4	12.7	12.4	28.0	1,018,046.2	0.00	1.00
08/15/2022 17:00	1	2.4	12.5	12.4	28.1	1,018,529.5	0.00	1.00
08/15/2022 18:00	1	2.3	12.6	12.5	27.0	1,023,481.7	0.00	1.00
08/15/2022 19:00	1	2.2	11.8	13.0	22.9	1,028,281.7	0.00	1.00
08/15/2022 20:00	0	2.0	9.6	13.8	16.2	994,472.1	0.00	1.00
08/15/2022 21:00	0	1.8	8.0	14.4	12.2	874,956.8	0.00	1.00
08/15/2022 22:00	0	1.7	10.4	14.5	13.8	752,113.5	0.00	1.00
08/15/2022 23:00	0	1.7	7.7	14.3	6.5	835,763.9	0.00	1.00
Average/Sum#:	1	1.9	11.8	14.0	18.6	823,841.0	0.00 #	24.00 #
Minimum:	0	1.6	7.7	12.4	6.5	659,793.2	0.00	1.00
Maximum:	1	2.4	16.2	14.8	28.1	1,031,243.4	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10								
	Unit CT2 NH3Slip, Ppmvdc	Unit CT2 NOx, Ppm	Unit CT2 NOx, _SCR, Ppm	Unit CT2 O2, Dry, Pct	Unit CT2 NH3Inj, LbPerHr	Unit CT2 ExhaustFlow, LbPerHr	Unit CT2 SUSD, Hr	Unit CT2 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/16/2022 00:00	0	1.8	7.7	14.3	10.7	845,930.8	0.00	1.00
08/16/2022 01:00	1	1.8	8.9	14.3	13.5	793,436.2	0.00	1.00
08/16/2022 02:00	0	1.7	10.2	14.3	12.4	769,782.5	0.00	1.00
08/16/2022 03:00	0	1.8	9.9	14.3	12.2	748,203.7	0.00	1.00
08/16/2022 04:00	0	1.6	9.1	14.4	9.8	819,758.5	0.00	1.00
08/16/2022 05:00	0	1.8	7.9	14.4	12.7	939,003.8	0.00	1.00
08/16/2022 06:00	1	1.7	11.9	14.5	19.3	751,471.6	0.00	1.00
08/16/2022 07:00	1	1.7	15.3	14.8	22.8	668,997.5	0.00	1.00
08/16/2022 08:00	0	1.6	13.8	14.8	18.4	675,507.9	0.00	1.00
08/16/2022 09:00	0	1.5	10.5	14.6	12.2	728,403.4	0.00	1.00
08/16/2022 10:00	0	1.7	8.5	14.4	6.6	795,108.9	0.00	1.00
08/16/2022 11:00	0	1.7	8.6	14.5	11.5	875,361.7	0.00	1.00
08/16/2022 12:00	0	1.7	8.6	14.2	12.9	880,723.8	0.00	1.00
08/16/2022 13:00	2	2.4	12.4	12.2	29.1	1,011,170.4	0.00	1.00
08/16/2022 14:00	2	2.5	13.0	11.8	33.8	1,012,772.1	0.00	1.00
08/16/2022 15:00	2	2.5	13.0	11.8	34.7	1,016,684.7	0.00	1.00
08/16/2022 16:00	2	2.5	12.9	11.8	34.5	1,015,330.4	0.00	1.00
08/16/2022 17:00	2	2.5	13.0	11.8	34.6	1,015,631.3	0.00	1.00
08/16/2022 18:00	2	2.5	12.9	11.8	34.7	1,016,534.3	0.00	1.00
08/16/2022 19:00	2	2.4	12.8	12.2	30.5	1,022,188.7	0.00	1.00
08/16/2022 20:00	1	2.3	12.6	12.4	28.0	1,019,335.1	0.00	1.00
08/16/2022 21:00	1	2.1	11.4	13.0	23.0	1,014,414.1	0.00	1.00
08/16/2022 22:00	1	2.0	10.0	13.6	18.3	1,010,185.0	0.00	1.00
08/16/2022 23:00	0	1.8	7.9	14.3	13.1	973,328.8	0.00	1.00
Average/Sum#:	1	2.0	11.0	13.5	20.4	892,469.4	0.00 #	24.00 #
Minimum:	0	1.5	7.7	11.8	6.6	668,997.5	0.00	1.00
Maximum:	2	2.5	15.3	14.8	34.7	1,022,188.7	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10								
	Unit CT2 NH3Slip, Ppmvdc	Unit CT2 NOx, Ppm	Unit CT2 NOx, _SCR, Ppm	Unit CT2 O2, Dry, Pct	Unit CT2 NH3Inj, LbPerHr	Unit CT2 ExhaustFlow, LbPerHr	Unit CT2 SUSD, Hr	Unit CT2 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/17/2022 00:00	0	1.8	8.0	14.5	14.2	1,012,946.1	0.00	1.00
08/17/2022 01:00	0	1.8	7.4	14.4	12.5	957,122.3	0.00	1.00
08/17/2022 02:00	0	1.7	7.9	14.4	13.4	976,294.2	0.00	1.00
08/17/2022 03:00	0	1.8	7.7	14.4	13.0	960,493.2	0.00	1.00
08/17/2022 04:00	0	1.8	7.7	14.4	13.4	969,341.8	0.00	1.00
08/17/2022 05:00	0	1.8	7.7	14.5	14.3	1,030,277.9	0.00	1.00
08/17/2022 06:00	0	1.8	7.7	14.5	14.1	1,029,208.0	0.00	1.00
08/17/2022 07:00	0	1.8	9.3	14.3	14.2	827,879.3	0.00	1.00
08/17/2022 08:00	0	1.8	8.7	14.0	15.7	995,512.0	0.00	1.00
08/17/2022 09:00	0	1.8	8.3	14.3	15.7	1,016,901.3	0.00	1.00
08/17/2022 10:00	0	1.8	7.8	14.5	14.8	1,032,417.6	0.00	1.00
08/17/2022 11:00	0	1.8	7.8	14.5	15.1	1,033,059.5	0.00	1.00
08/17/2022 12:00	0	1.8	7.7	14.5	14.5	1,026,854.3	0.00	1.00
08/17/2022 13:00	0	1.7	7.6	14.5	14.4	1,020,649.1	0.00	1.00
08/17/2022 14:00	0	1.7	7.5	14.5	13.6	1,017,653.5	0.00	1.00
08/17/2022 15:00	0	1.8	7.5	14.5	13.8	1,015,941.7	0.00	1.00
08/17/2022 16:00	0	1.7	7.5	14.5	13.8	1,017,867.5	0.00	1.00
08/17/2022 17:00	0	1.7	7.8	14.5	14.6	1,021,932.9	0.00	1.00
08/17/2022 18:00	0	1.7	7.7	14.5	14.5	1,022,146.9	0.00	1.00
08/17/2022 19:00	0	1.7	7.7	14.5	14.1	1,022,146.9	0.00	1.00
08/17/2022 20:00	0	1.7	7.5	14.5	13.8	1,022,574.9	0.00	1.00
08/17/2022 21:00	0	1.8	7.4	14.5	13.5	1,021,719.0	0.00	1.00
08/17/2022 22:00	0	1.8	7.3	14.5	13.4	1,020,863.1	0.00	1.00
08/17/2022 23:00	1	1.7	10.8	14.5	16.5	696,480.7	0.00	1.00
Average/Sum#:	0	1.8	7.9	14.4	14.2	990,345.2	0.00 #	24.00 #
Minimum:	0	1.7	7.3	14.0	12.5	696,480.7	0.00	1.00
Maximum:	1	1.8	10.8	14.5	16.5	1,033,059.5	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
 Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT2 NH3Slip, Ppmvdc	Unit CT2 NOx, Ppm	Unit CT2 NOx, _SCR, Ppm	Unit CT2 O2, Dry, Pct	Unit CT2 NH3Inj, LbPerHr	Unit CT2 ExhaustFlow, LbPerHr	Unit CT2 SUSD, Hr	Unit CT2 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/18/2022 00:00	1	1.7	11.1	14.6	16.0	693,189.6	0.00	1.00
08/18/2022 01:00	1	1.7	11.2	14.6	16.2	692,320.1	0.00	1.00
08/18/2022 02:00	1	1.7	11.6	14.6	16.3	692,102.7	0.00	1.00
08/18/2022 03:00	1	1.7	11.5	14.6	16.4	692,102.7	0.00	1.00
08/18/2022 04:00	1	1.7	11.5	14.6	16.3	694,493.8	0.00	1.00
08/18/2022 05:00	1	1.7	11.5	14.5	16.5	684,926.2	0.00	1.00
08/18/2022 06:00	1	1.7	11.6	14.6	16.4	693,624.3	0.00	1.00
08/18/2022 07:00	1	1.7	12.9	14.7	18.5	677,865.1	0.00	1.00
08/18/2022 08:00	0	1.7	13.0	14.7	17.3	672,122.3	0.00	1.00
08/18/2022 09:00	0	1.6	12.3	14.7	15.7	673,226.7	0.00	1.00
08/18/2022 10:00	0	1.7	11.4	14.7	14.8	672,564.1	0.00	1.00
08/18/2022 11:00	0	1.7	10.6	14.8	13.8	683,365.2	0.00	1.00
08/18/2022 12:00	0	1.6	10.2	14.7	13.1	682,282.6	0.00	1.00
08/18/2022 13:00	0	1.6	8.3	14.4	10.3	859,998.5	0.00	1.00
08/18/2022 14:00	0	2.0	8.9	13.8	16.0	1,002,765.8	0.00	1.00
08/18/2022 15:00	1	2.1	10.3	13.1	22.4	1,005,122.4	0.00	1.00
08/18/2022 16:00	1	2.1	10.3	13.3	19.4	1,006,526.9	0.00	1.00
08/18/2022 17:00	1	2.2	11.3	12.9	22.4	1,009,779.3	0.00	1.00
08/18/2022 18:00	0	2.0	9.3	13.8	15.8	1,003,730.2	0.00	1.00
08/18/2022 19:00	0	2.0	8.9	14.0	15.9	1,016,946.5	0.00	1.00
08/18/2022 20:00	0	2.0	8.8	14.1	16.2	1,026,665.5	0.00	1.00
08/18/2022 21:00	0	2.0	8.8	14.1	16.4	1,025,054.4	0.00	1.00
08/18/2022 22:00	0	2.0	8.7	14.1	16.5	1,021,026.7	0.00	1.00
08/18/2022 23:00	0	1.9	8.7	14.2	16.7	1,029,725.4	0.00	1.00
Average/Sum#:	0	1.8	10.5	14.3	16.5	829,647.0	0.00 #	24.00 #
Minimum:	0	1.6	8.3	12.9	10.3	672,122.3	0.00	1.00
Maximum:	1	2.2	13.0	14.8	22.4	1,029,725.4	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT2 NH3Slip, Ppmvdc	Unit CT2 NOx, Ppm	Unit CT2 NOx, _SCR, Ppm	Unit CT2 O2, Dry, Pct	Unit CT2 NH3Inj, LbPerHr	Unit CT2 ExhaustFlow, LbPerHr	Unit CT2 SUSD, Hr	Unit CT2 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/19/2022 00:00	1	1.9	8.7	14.2	16.8	1,016,644.3	0.00	1.00
08/19/2022 01:00	0	1.9	8.7	14.2	16.9	1,022,980.5	0.00	1.00
08/19/2022 02:00	0	2.0	9.0	14.2	16.8	1,019,097.0	0.00	1.00
08/19/2022 03:00	1	1.9	8.9	14.2	17.3	1,016,031.1	0.00	1.00
08/19/2022 04:00	0	1.9	8.8	14.2	17.1	1,015,418.0	0.00	1.00
08/19/2022 05:00	1	1.9	8.8	14.2	17.8	1,015,826.7	0.00	1.00
08/19/2022 06:00	0	1.8	8.8	14.2	17.6	1,039,945.0	0.00	1.00
08/19/2022 07:00	0	1.8	8.6	14.2	16.7	1,033,200.0	0.00	1.00
08/19/2022 08:00	1	1.7	10.9	14.5	18.1	806,034.6	0.00	1.00
08/19/2022 09:00	0	1.7	12.5	14.7	16.7	673,668.4	0.00	1.00
08/19/2022 10:00	0	1.5	10.8	14.6	12.8	715,361.2	0.00	1.00
08/19/2022 11:00	0	1.8	9.2	14.3	11.2	794,473.6	0.00	1.00
08/19/2022 12:00	1	1.7	12.0	14.6	17.9	682,755.9	0.00	1.00
08/19/2022 13:00	0	1.7	11.7	14.9	15.3	664,170.8	0.00	1.00
08/19/2022 14:00	0	1.6	10.0	14.7	13.3	682,503.4	0.00	1.00
08/19/2022 15:00	1	1.6	10.3	14.6	14.1	684,712.2	0.00	1.00
08/19/2022 16:00	0	1.6	10.2	14.7	12.9	682,061.7	0.00	1.00
08/19/2022 17:00	0	1.7	6.9	14.5	6.2	923,719.5	0.00	1.00
08/19/2022 18:00	0	1.8	7.0	14.4	10.3	918,567.7	0.00	1.00
08/19/2022 19:00	0	1.8	7.9	14.4	10.7	849,253.8	0.00	1.00
08/19/2022 20:00	1	1.7	10.0	14.5	14.3	790,414.6	0.03	1.00
08/19/2022 21:00	0	13.4	31.9	16.2	0.0	482,503.6	0.12	0.12
08/19/2022 22:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/19/2022 23:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
Average/Sum#:	0	2.3	10.5	14.5	14.1	842,242.9	0.15 #	21.12 #
Minimum:	0	1.5	6.9	14.2	0.0	482,503.6	0.00	0.00
Maximum:	1	13.4	31.9	16.2	18.1	1,039,945.0	0.12	1.00
%SI	12.50	8.33	8.33	8.33	8.33	8.33	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT2 NH3Slip, Ppmvdc	Unit CT2 NOx, Ppm	Unit CT2 NOx, _SCR, Ppm	Unit CT2 O2, Dry, Pct	Unit CT2 NH3Inj, LbPerHr	Unit CT2 ExhaustFlow, LbPerHr	Unit CT2 SUSD, Hr	Unit CT2 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/20/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/20/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/20/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/20/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/20/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/20/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/20/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/20/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/20/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/20/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/20/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/20/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/20/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/20/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/20/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
08/20/2022 15:00	1	9.5	13.8	15.5	8.1	885,561.1	0.80	0.93
08/20/2022 16:00	0	1.6	7.9	14.5	10.8	996,898.2	0.00	1.00
08/20/2022 17:00	0	1.9	8.3	14.2	15.5	964,524.4	0.00	1.00
08/20/2022 18:00	1	2.1	9.8	13.6	17.3	995,740.4	0.00	1.00
08/20/2022 19:00	0	2.0	9.7	13.9	17.4	1,020,612.4	0.00	1.00
08/20/2022 20:00	0	2.0	9.5	13.9	16.9	1,016,699.8	0.00	1.00
08/20/2022 21:00	0	2.0	9.5	13.8	17.0	1,013,181.2	0.00	1.00
08/20/2022 22:00	0	2.0	9.4	13.8	16.9	1,016,460.1	0.00	1.00
08/20/2022 23:00	0	2.0	9.4	13.9	17.2	1,030,198.4	0.00	1.00
Average/Sum#:	0	2.8	9.7	14.1	15.2	993,319.6	0.80 #	8.93 #
Minimum:	0	1.6	7.9	13.6	8.1	885,561.1	0.00	0.00
Maximum:	1	9.5	13.8	15.5	17.4	1,030,198.4	0.80	1.00
%SI	62.50	62.50	62.50	62.50	62.50	62.50	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10								
	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2
	NH3Slip, Ppmvdc	NOx, Ppm	NOx, _SCR, Ppm	O2, Dry, Pct	NH3Inj, LbPerHr	ExhaustFlow, LbPerHr	SUSD, Hr	OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/21/2022 00:00	0	2.0	9.4	13.9	17.3	1,026,872.7	0.00	1.00
08/21/2022 01:00	0	2.0	9.4	14.0	17.6	1,038,182.5	0.00	1.00
08/21/2022 02:00	0	1.9	9.5	14.0	17.7	1,033,816.2	0.00	1.00
08/21/2022 03:00	1	1.7	10.3	14.4	17.2	818,073.1	0.00	1.00
08/21/2022 04:00	1	1.8	14.0	14.6	19.9	664,714.2	0.00	1.00
08/21/2022 05:00	0	1.7	12.1	14.6	15.7	775,789.8	0.00	1.00
08/21/2022 06:00	1	1.8	12.7	14.5	19.5	713,170.5	0.00	1.00
08/21/2022 07:00	1	1.6	12.0	14.6	14.8	719,056.5	0.00	1.00
08/21/2022 08:00	1	1.8	9.9	14.5	16.0	844,977.6	0.00	1.00
08/21/2022 09:00	1	1.7	14.1	14.8	19.7	670,344.5	0.00	1.00
08/21/2022 10:00	0	1.7	10.9	14.5	12.5	706,537.4	0.00	1.00
08/21/2022 11:00	0	1.7	9.0	14.5	10.4	853,108.6	0.00	1.00
08/21/2022 12:00	0	1.9	7.5	14.5	11.6	1,017,653.5	0.00	1.00
08/21/2022 13:00	0	1.9	7.6	14.5	12.4	1,017,439.5	0.00	1.00
08/21/2022 14:00	0	1.8	7.3	14.4	9.4	910,351.2	0.00	1.00
08/21/2022 15:00	1	1.5	10.3	14.6	14.9	837,957.3	0.00	1.00
08/21/2022 16:00	1	1.7	11.5	14.7	15.5	775,050.0	0.00	1.00
08/21/2022 17:00	1	2.1	10.0	13.4	18.3	1,019,582.1	0.00	1.00
08/21/2022 18:00	1	2.0	10.2	13.4	19.3	1,025,607.6	0.00	1.00
08/21/2022 19:00	0	1.9	9.1	13.8	16.1	984,442.5	0.00	1.00
08/21/2022 20:00	0	1.7	7.7	14.4	11.5	881,909.3	0.00	1.00
08/21/2022 21:00	1	1.7	8.3	14.4	13.7	858,102.4	0.00	1.00
08/21/2022 22:00	0	1.4	9.3	14.4	8.7	818,915.8	0.00	1.00
08/21/2022 23:00	0	1.8	8.6	14.4	13.2	838,298.4	0.00	1.00
Average/Sum#:	0	1.8	10.0	14.3	15.1	868,748.1	0.00 #	24.00 #
Minimum:	0	1.4	7.3	13.4	8.7	664,714.2	0.00	1.00
Maximum:	1	2.1	14.1	14.8	19.9	1,038,182.5	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT2 NH3Slip, Ppmvdc	Unit CT2 NOx, Ppm	Unit CT2 NOx, _SCR, Ppm	Unit CT2 O2, Dry, Pct	Unit CT2 NH3Inj, LbPerHr	Unit CT2 ExhaustFlow, LbPerHr	Unit CT2 SUSD, Hr	Unit CT2 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/22/2022 00:00	1	1.7	10.6	14.4	15.4	708,097.7	0.00	1.00
08/22/2022 01:00	1	1.6	14.4	14.6	23.2	673,626.4	0.00	1.00
08/22/2022 02:00	1	1.6	16.7	14.7	25.0	654,894.1	0.00	1.00
08/22/2022 03:00	0	1.6	14.3	14.5	19.0	666,524.5	0.00	1.00
08/22/2022 04:00	0	1.6	10.9	14.4	13.0	750,023.2	0.00	1.00
08/22/2022 05:00	0	1.8	8.2	14.4	12.6	1,024,329.4	0.00	1.00
08/22/2022 06:00	0	1.8	8.0	14.4	14.6	1,039,287.8	0.00	1.00
08/22/2022 07:00	0	1.8	8.4	14.4	15.7	1,045,397.5	0.00	1.00
08/22/2022 08:00	0	1.8	8.4	14.4	15.6	1,040,551.9	0.00	1.00
08/22/2022 09:00	1	1.7	12.8	14.6	19.5	683,625.3	0.00	1.00
08/22/2022 10:00	1	1.7	13.0	14.7	17.6	669,030.1	0.00	1.00
08/22/2022 11:00	0	1.7	12.4	14.7	15.1	668,146.6	0.00	1.00
08/22/2022 12:00	0	1.7	11.6	14.8	14.1	678,875.3	0.00	1.00
08/22/2022 13:00	0	1.7	10.9	14.8	14.1	678,426.3	0.00	1.00
08/22/2022 14:00	0	1.7	10.5	14.8	13.6	678,201.8	0.00	1.00
08/22/2022 15:00	0	1.7	8.7	14.4	12.3	863,580.1	0.00	1.00
08/22/2022 16:00	1	2.0	9.4	13.7	17.2	1,014,515.2	0.00	1.00
08/22/2022 17:00	1	2.3	11.2	12.8	24.6	1,013,712.2	0.00	1.00
08/22/2022 18:00	2	2.4	12.4	12.0	30.0	1,011,373.8	0.00	1.00
08/22/2022 19:00	1	2.1	10.6	13.1	18.8	1,004,069.0	0.00	1.00
08/22/2022 20:00	0	1.9	9.0	13.8	15.7	1,006,430.5	0.00	1.00
08/22/2022 21:00	0	1.9	8.7	14.0	15.6	1,016,351.1	0.00	1.00
08/22/2022 22:00	0	1.9	8.8	14.0	16.2	1,017,740.3	0.00	1.00
08/22/2022 23:00	0	1.9	8.6	14.0	16.1	1,007,817.0	0.00	1.00
Average/Sum#:	0	1.8	10.8	14.2	17.3	858,942.8	0.00 #	24.00 #
Minimum:	0	1.6	8.0	12.0	12.3	654,894.1	0.00	1.00
Maximum:	2	2.4	16.7	14.8	30.0	1,045,397.5	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
 Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT2 NH3Slip, Ppmvdc	Unit CT2 NOx, Ppm	Unit CT2 NOx, _SCR, Ppm	Unit CT2 O2, Dry, Pct	Unit CT2 NH3Inj, LbPerHr	Unit CT2 ExhaustFlow, LbPerHr	Unit CT2 SUSD, Hr	Unit CT2 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/23/2022 00:00	1	1.9	8.8	14.0	17.0	1,025,083.6	0.00	1.00
08/23/2022 01:00	0	1.9	8.7	14.0	16.4	1,012,381.7	0.00	1.00
08/23/2022 02:00	0	1.8	8.9	14.1	16.6	1,020,019.8	0.00	1.00
08/23/2022 03:00	1	2.0	9.3	13.8	18.5	1,012,023.9	0.00	1.00
08/23/2022 04:00	0	1.9	8.9	14.0	17.0	1,018,534.2	0.00	1.00
08/23/2022 05:00	1	2.1	10.6	13.3	21.4	1,031,032.4	0.00	1.00
08/23/2022 06:00	0	1.9	8.8	14.1	16.2	1,024,853.0	0.00	1.00
08/23/2022 07:00	0	1.9	8.7	14.1	16.3	1,023,443.3	0.00	1.00
08/23/2022 08:00	0	1.9	8.7	14.0	16.4	1,015,755.7	0.00	1.00
08/23/2022 09:00	0	1.9	8.7	14.0	16.5	1,015,557.2	0.00	1.00
08/23/2022 10:00	1	1.9	8.6	14.0	16.4	1,015,557.2	0.00	1.00
08/23/2022 11:00	1	2.0	9.3	13.7	17.8	1,009,570.1	0.00	1.00
08/23/2022 12:00	1	2.0	9.6	13.6	17.5	1,011,310.5	0.00	1.00
08/23/2022 13:00	1	2.0	9.2	13.7	17.1	1,001,581.8	0.00	1.00
08/23/2022 14:00	1	2.1	10.2	13.3	20.8	1,007,067.5	0.00	1.00
08/23/2022 15:00	0	2.0	9.3	13.7	16.4	998,158.2	0.00	1.00
08/23/2022 16:00	1	2.1	10.1	13.3	21.5	1,007,608.0	0.00	1.00
08/23/2022 17:00	2	2.5	12.5	11.8	33.1	1,006,752.7	0.00	1.00
08/23/2022 18:00	1	2.2	11.7	12.7	22.7	1,002,017.8	0.00	1.00
08/23/2022 19:00	1	2.1	10.7	13.1	21.4	1,003,191.1	0.00	1.00
08/23/2022 20:00	1	2.2	11.9	12.7	24.4	1,016,046.1	0.00	1.00
08/23/2022 21:00	0	2.0	10.1	13.5	17.3	1,008,377.5	0.00	1.00
08/23/2022 22:00	0	1.9	9.0	14.0	15.9	1,012,183.2	0.00	1.00
08/23/2022 23:00	0	1.9	8.9	14.0	16.3	1,010,794.0	0.00	1.00
Average/Sum#:	1	2.0	9.6	13.6	18.8	1,012,870.9	0.00 #	24.00 #
Minimum:	0	1.8	8.6	11.8	15.9	998,158.2	0.00	1.00
Maximum:	2	2.5	12.5	14.1	33.1	1,031,032.4	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT2 NH3Slip, Ppmvdc	Unit CT2 NOx, Ppm	Unit CT2 NOx, _SCR, Ppm	Unit CT2 O2, Dry, Pct	Unit CT2 NH3Inj, LbPerHr	Unit CT2 ExhaustFlow, LbPerHr	Unit CT2 SUSD, Hr	Unit CT2 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/24/2022 00:00	0	1.9	9.0	13.9	16.7	1,004,961.9	0.00	1.00
08/24/2022 01:00	0	1.9	9.0	14.0	17.0	1,015,755.7	0.00	1.00
08/24/2022 02:00	0	1.9	9.2	14.0	17.1	1,012,977.1	0.00	1.00
08/24/2022 03:00	0	1.9	9.1	14.1	17.2	1,022,637.8	0.00	1.00
08/24/2022 04:00	0	1.9	9.0	14.1	17.4	1,019,818.4	0.00	1.00
08/24/2022 05:00	0	1.8	8.9	14.1	17.0	1,015,790.7	0.00	1.00
08/24/2022 06:00	0	1.8	8.8	14.1	16.8	1,017,200.4	0.00	1.00
08/24/2022 07:00	0	1.9	8.8	14.1	16.6	1,023,846.1	0.00	1.00
08/24/2022 08:00	0	1.9	8.7	14.0	16.5	1,013,572.5	0.00	1.00
08/24/2022 09:00	0	1.9	8.7	14.0	16.2	1,009,404.7	0.00	1.00
08/24/2022 10:00	0	1.9	8.7	14.0	16.1	1,014,167.9	0.00	1.00
08/24/2022 11:00	1	1.9	8.9	13.9	16.6	1,005,940.0	0.00	1.00
08/24/2022 12:00	0	1.9	9.1	13.8	16.6	1,009,130.8	0.00	1.00
08/24/2022 13:00	1	1.9	9.2	13.8	17.8	1,009,516.5	0.00	1.00
08/24/2022 14:00	2	2.4	12.3	12.2	30.2	1,013,688.9	0.00	1.00
08/24/2022 15:00	1	2.0	10.3	13.4	18.0	999,497.2	0.00	1.00
08/24/2022 16:00	1	2.1	10.9	13.1	23.7	1,010,916.1	0.00	1.00
08/24/2022 17:00	2	2.3	12.7	12.3	28.7	1,012,418.6	0.00	1.00
08/24/2022 18:00	0	2.0	10.1	13.7	16.9	1,016,417.2	0.00	1.00
08/24/2022 19:00	0	1.9	9.1	14.0	16.4	1,016,549.5	0.00	1.00
08/24/2022 20:00	0	1.9	9.0	14.0	16.6	1,021,114.3	0.00	1.00
08/24/2022 21:00	0	1.9	8.9	14.0	16.6	1,010,397.0	0.00	1.00
08/24/2022 22:00	0	1.9	8.8	14.1	16.7	1,017,200.4	0.00	1.00
08/24/2022 23:00	0	1.8	8.9	14.1	17.2	1,024,450.3	0.00	1.00
Average/Sum#:	0	1.9	9.4	13.8	18.2	1,014,057.1	0.00 #	24.00 #
Minimum:	0	1.8	8.7	12.2	16.1	999,497.2	0.00	1.00
Maximum:	2	2.4	12.7	14.1	30.2	1,024,450.3	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
 Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:	> 10							
	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2
	NH3Slip, Ppmvdc	NOx, Ppm	NOx, _SCR, Ppm	O2, Dry, Pct	NH3Inj, LbPerHr	ExhaustFlow, LbPerHr	SUSD, Hr	OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/25/2022 00:00	1	1.8	8.9	14.1	17.2	1,019,415.6	0.00	1.00
08/25/2022 01:00	1	1.8	8.9	14.1	17.4	1,021,026.7	0.00	1.00
08/25/2022 02:00	0	1.8	9.1	14.1	17.3	1,020,422.6	0.00	1.00
08/25/2022 03:00	1	1.8	9.0	14.1	17.6	1,019,214.2	0.00	1.00
08/25/2022 04:00	0	1.8	9.0	14.2	17.6	1,021,958.5	0.00	1.00
08/25/2022 05:00	1	1.9	8.9	14.2	17.3	1,013,374.0	0.00	1.00
08/25/2022 06:00	1	1.9	8.9	14.2	17.4	1,014,396.0	0.00	1.00
08/25/2022 07:00	0	1.9	8.8	14.2	16.8	1,026,659.5	0.00	1.00
08/25/2022 08:00	0	1.9	8.8	14.1	16.9	1,025,457.2	0.00	1.00
08/25/2022 09:00	0	1.9	8.9	14.0	16.9	1,015,755.7	0.00	1.00
08/25/2022 10:00	0	1.9	8.9	14.0	16.7	1,024,488.2	0.00	1.00
08/25/2022 11:00	0	2.0	9.0	13.9	16.6	1,016,699.8	0.00	1.00
08/25/2022 12:00	0	2.0	9.1	13.9	16.6	1,016,112.9	0.00	1.00
08/25/2022 13:00	0	1.9	8.9	14.0	16.3	1,014,961.8	0.00	1.00
08/25/2022 14:00	0	1.9	8.9	14.0	16.4	1,013,175.6	0.00	1.00
08/25/2022 15:00	1	2.0	9.2	13.9	17.2	1,013,569.7	0.00	1.00
08/25/2022 16:00	0	1.9	8.9	14.0	16.3	1,014,564.8	0.00	1.00
08/25/2022 17:00	0	1.9	8.9	14.0	16.7	1,014,763.3	0.00	1.00
08/25/2022 18:00	0	1.9	8.8	14.0	16.7	1,012,778.6	0.00	1.00
08/25/2022 19:00	1	1.9	8.8	14.0	16.7	1,014,961.8	0.00	1.00
08/25/2022 20:00	1	1.9	8.9	14.0	17.0	1,015,160.2	0.00	1.00
08/25/2022 21:00	0	1.9	8.9	14.1	17.2	1,025,255.8	0.00	1.00
08/25/2022 22:00	1	1.8	8.8	14.1	17.1	1,019,818.4	0.00	1.00
08/25/2022 23:00	1	1.8	8.8	14.2	17.3	1,030,951.7	0.00	1.00
Average/Sum#:	0	1.9	8.9	14.1	17.0	1,018,539.3	0.00 #	24.00 #
Minimum:	0	1.8	8.8	13.9	16.3	1,012,778.6	0.00	1.00
Maximum:	1	2.0	9.2	14.2	17.6	1,030,951.7	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT2 NH3Slip, Ppmvdc	Unit CT2 NOx, Ppm	Unit CT2 NOx, _SCR, Ppm	Unit CT2 O2, Dry, Pct	Unit CT2 NH3Inj, LbPerHr	Unit CT2 ExhaustFlow, LbPerHr	Unit CT2 SUSD, Hr	Unit CT2 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/26/2022 00:00	1	1.8	8.8	14.2	17.3	1,023,184.8	0.00	1.00
08/26/2022 01:00	1	1.8	8.7	14.2	17.4	1,010,717.0	0.00	1.00
08/26/2022 02:00	1	1.8	9.1	14.2	17.6	1,011,943.3	0.00	1.00
08/26/2022 03:00	1	1.8	9.0	14.2	17.8	1,013,169.7	0.00	1.00
08/26/2022 04:00	1	1.8	8.8	14.2	17.6	1,014,804.8	0.00	1.00
08/26/2022 05:00	1	1.8	9.1	14.1	18.0	1,004,110.3	0.00	1.00
08/26/2022 06:00	1	1.6	15.8	14.6	25.0	657,758.4	0.00	1.00
08/26/2022 07:00	1	1.7	15.8	14.6	24.2	648,628.9	0.00	1.00
08/26/2022 08:00	1	1.7	14.8	14.7	21.3	664,170.8	0.00	1.00
08/26/2022 09:00	0	1.5	8.0	14.4	6.2	890,547.2	0.00	1.00
08/26/2022 10:00	0	1.6	9.5	14.5	11.8	834,707.0	0.00	1.00
08/26/2022 11:00	0	1.7	8.8	14.2	12.9	869,277.9	0.00	1.00
08/26/2022 12:00	1	2.0	9.9	13.5	18.7	1,015,224.6	0.00	1.00
08/26/2022 13:00	1	2.3	12.2	12.6	25.8	1,029,213.2	0.00	1.00
08/26/2022 14:00	1	2.4	12.4	12.3	28.1	1,020,221.2	0.00	1.00
08/26/2022 15:00	1	2.3	12.2	12.5	26.6	1,016,634.6	0.00	1.00
08/26/2022 16:00	2	2.4	12.5	12.4	28.5	1,025,618.3	0.00	1.00
08/26/2022 17:00	2	2.5	12.8	11.9	33.1	1,026,764.0	0.00	1.00
08/26/2022 18:00	2	2.4	12.7	12.3	29.5	1,026,590.6	0.00	1.00
08/26/2022 19:00	2	2.4	12.9	12.1	31.3	1,020,843.6	0.00	1.00
08/26/2022 20:00	1	2.2	12.4	12.6	26.8	1,021,623.6	0.00	1.00
08/26/2022 21:00	1	2.2	11.8	12.8	23.9	1,012,190.6	0.00	1.00
08/26/2022 22:00	0	1.9	9.4	13.8	16.9	981,356.5	0.00	1.00
08/26/2022 23:00	0	1.8	7.4	14.4	13.0	975,662.2	0.00	1.00
Average/Sum#:	1	2.0	11.0	13.6	21.2	950,623.5	0.00 #	24.00 #
Minimum:	0	1.5	7.4	11.9	6.2	648,628.9	0.00	1.00
Maximum:	2	2.5	15.8	14.7	33.1	1,029,213.2	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
 Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT2 NH3Slip, Ppmvdc	Unit CT2 NOx, Ppm	Unit CT2 NOx, _SCR, Ppm	Unit CT2 O2, Dry, Pct	Unit CT2 NH3Inj, LbPerHr	Unit CT2 ExhaustFlow, LbPerHr	Unit CT2 SUSD, Hr	Unit CT2 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/27/2022 00:00	0	1.8	7.4	14.4	13.2	977,137.0	0.00	1.00
08/27/2022 01:00	0	1.8	7.5	14.4	13.3	972,923.4	0.00	1.00
08/27/2022 02:00	0	1.7	7.8	14.4	13.9	976,294.2	0.00	1.00
08/27/2022 03:00	0	1.8	7.7	14.4	13.9	976,294.2	0.00	1.00
08/27/2022 04:00	0	1.8	7.8	14.4	14.1	984,721.5	0.00	1.00
08/27/2022 05:00	0	1.8	7.8	14.4	14.1	984,721.5	0.00	1.00
08/27/2022 06:00	1	1.7	13.6	14.5	23.4	723,013.3	0.00	1.00
08/27/2022 07:00	1	1.7	16.7	14.7	24.9	642,966.8	0.00	1.00
08/27/2022 08:00	1	1.7	16.0	14.7	23.6	643,629.5	0.00	1.00
08/27/2022 09:00	1	1.7	15.3	14.7	22.4	647,605.2	0.00	1.00
08/27/2022 10:00	0	1.5	10.0	14.4	8.3	747,705.7	0.00	1.00
08/27/2022 11:00	0	1.8	7.9	14.3	9.2	907,347.4	0.00	1.00
08/27/2022 12:00	0	2.0	9.5	13.8	17.0	1,011,445.3	0.00	1.00
08/27/2022 13:00	0	2.0	9.5	13.7	17.1	1,003,103.4	0.00	1.00
08/27/2022 14:00	1	2.0	9.5	13.7	17.6	997,968.0	0.00	1.00
08/27/2022 15:00	1	2.0	9.5	13.7	18.0	996,256.2	0.00	1.00
08/27/2022 16:00	1	2.1	10.5	13.3	20.3	1,002,202.4	0.00	1.00
08/27/2022 17:00	1	2.3	11.9	12.6	25.4	1,006,939.4	0.00	1.00
08/27/2022 18:00	2	2.3	12.3	12.3	28.2	1,012,100.2	0.00	1.00
08/27/2022 19:00	1	2.3	12.3	12.5	26.9	1,019,732.1	0.00	1.00
08/27/2022 20:00	1	2.2	11.9	12.7	24.4	1,014,209.1	0.00	1.00
08/27/2022 21:00	0	1.9	9.6	13.8	17.1	989,843.1	0.00	1.00
08/27/2022 22:00	1	1.6	10.7	14.4	16.5	723,477.4	0.00	1.00
08/27/2022 23:00	0	1.7	8.7	14.3	10.4	778,497.0	0.00	1.00
Average/Sum#:	1	1.9	10.5	13.9	18.1	905,838.9	0.00 #	24.00 #
Minimum:	0	1.5	7.4	12.3	8.3	642,966.8	0.00	1.00
Maximum:	2	2.3	16.7	14.7	28.2	1,019,732.1	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT2 NH3Slip, Ppmvdc	Unit CT2 NOx, Ppm	Unit CT2 NOx, _SCR, Ppm	Unit CT2 O2, Dry, Pct	Unit CT2 NH3Inj, LbPerHr	Unit CT2 ExhaustFlow, LbPerHr	Unit CT2 SUSD, Hr	Unit CT2 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/28/2022 00:00	1	1.7	13.6	14.6	19.7	666,018.5	0.00	1.00
08/28/2022 01:00	1	1.7	13.5	14.6	19.8	666,235.8	0.00	1.00
08/28/2022 02:00	1	1.9	14.5	14.6	20.5	661,888.5	0.00	1.00
08/28/2022 03:00	1	1.7	13.7	14.6	19.3	668,626.9	0.00	1.00
08/28/2022 04:00	1	1.7	14.1	14.6	20.9	663,844.8	0.00	1.00
08/28/2022 05:00	1	1.7	13.8	14.5	20.3	664,812.7	0.00	1.00
08/28/2022 06:00	1	1.8	16.1	14.6	25.1	646,890.0	0.00	1.00
08/28/2022 07:00	1	1.7	16.5	14.7	24.5	646,942.6	0.00	1.00
08/28/2022 08:00	1	1.8	15.9	14.7	23.4	646,942.6	0.00	1.00
08/28/2022 09:00	1	1.7	15.2	14.7	21.9	647,163.5	0.00	1.00
08/28/2022 10:00	1	1.7	14.5	14.7	20.7	646,942.6	0.00	1.00
08/28/2022 11:00	1	1.7	14.0	14.7	19.4	649,151.3	0.00	1.00
08/28/2022 12:00	0	1.6	9.7	14.6	9.3	814,264.1	0.00	1.00
08/28/2022 13:00	0	1.9	8.6	14.4	9.2	815,544.9	0.00	1.00
08/28/2022 14:00	0	1.8	7.2	14.4	10.0	916,882.3	0.00	1.00
08/28/2022 15:00	1	1.8	10.5	14.5	12.1	727,720.7	0.00	1.00
08/28/2022 16:00	1	2.1	9.9	14.0	16.6	926,246.9	0.00	1.00
08/28/2022 17:00	2	2.3	12.7	12.0	31.7	1,007,373.2	0.00	1.00
08/28/2022 18:00	1	1.8	10.5	13.5	20.4	1,016,149.9	0.00	1.00
08/28/2022 19:00	1	1.8	9.6	14.0	18.9	1,027,266.8	0.00	1.00
08/28/2022 20:00	0	1.7	8.9	14.1	15.4	916,104.6	0.00	1.00
08/28/2022 21:00	1	1.6	9.7	14.4	15.9	804,589.5	0.00	1.00
08/28/2022 22:00	1	1.5	12.7	14.5	18.6	666,952.5	0.00	1.00
08/28/2022 23:00	0	1.6	7.6	14.3	8.9	859,417.5	0.00	1.00
Average/Sum#:	1	1.8	12.2	14.3	18.4	765,582.2	0.00 #	24.00 #
Minimum:	0	1.5	7.2	12.0	8.9	646,890.0	0.00	1.00
Maximum:	2	2.3	16.5	14.7	31.7	1,027,266.8	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10								
	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2
	NH3Slip, Ppmvdc	NOx, Ppm	NOx, _SCR, Ppm	O2, Dry, Pct	NH3Inj, LbPerHr	ExhaustFlow, LbPerHr	SUSD, Hr	OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/29/2022 00:00	0	1.7	7.8	14.3	11.9	845,930.8	0.00	1.00
08/29/2022 01:00	0	1.7	7.8	14.3	12.4	857,757.6	0.00	1.00
08/29/2022 02:00	0	1.6	8.0	14.3	13.5	896,558.0	0.00	1.00
08/29/2022 03:00	0	1.7	8.1	14.3	13.0	850,910.5	0.00	1.00
08/29/2022 04:00	0	1.7	7.8	14.3	13.1	902,575.2	0.00	1.00
08/29/2022 05:00	0	1.7	7.9	14.4	14.3	979,454.5	0.00	1.00
08/29/2022 06:00	1	1.8	13.1	14.5	22.6	748,048.1	0.00	1.00
08/29/2022 07:00	1	1.7	15.2	14.6	22.1	650,802.6	0.00	1.00
08/29/2022 08:00	1	1.7	16.1	14.7	23.0	648,267.8	0.00	1.00
08/29/2022 09:00	1	1.7	13.3	14.6	18.2	661,236.3	0.00	1.00
08/29/2022 10:00	1	1.7	13.3	14.7	18.7	665,937.8	0.00	1.00
08/29/2022 11:00	1	1.8	12.2	14.7	16.6	674,551.9	0.00	1.00
08/29/2022 12:00	0	1.8	11.6	14.7	15.5	670,576.2	0.00	1.00
08/29/2022 13:00	0	1.7	9.2	14.5	9.6	772,227.0	0.00	1.00
08/29/2022 14:00	0	2.2	8.1	14.3	10.3	896,973.0	0.00	1.00
08/29/2022 15:00	1	2.1	10.1	13.5	19.3	1,006,526.9	0.00	1.00
08/29/2022 16:00	1	2.1	10.7	13.3	20.8	1,008,328.8	0.00	1.00
08/29/2022 17:00	1	2.2	12.2	12.5	27.8	1,014,352.2	0.00	1.00
08/29/2022 18:00	1	2.1	12.0	12.8	24.9	1,018,107.9	0.00	1.00
08/29/2022 19:00	1	2.0	11.2	13.1	22.0	1,016,885.4	0.00	1.00
08/29/2022 20:00	1	2.0	10.7	13.4	20.6	1,023,416.5	0.00	1.00
08/29/2022 21:00	1	1.9	9.7	13.7	18.1	982,562.0	0.00	1.00
08/29/2022 22:00	0	1.7	7.7	14.4	12.7	928,680.4	0.00	1.00
08/29/2022 23:00	0	1.7	8.4	14.4	16.4	1,017,166.3	0.00	1.00
Average/Sum#:	1	1.8	10.5	14.1	17.4	864,076.4	0.00 #	24.00 #
Minimum:	0	1.6	7.7	12.5	9.6	648,267.8	0.00	1.00
Maximum:	1	2.2	16.1	14.7	27.8	1,023,416.5	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
 Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10								
	Unit CT2 NH3Slip, Ppmvdc	Unit CT2 NOx, Ppm	Unit CT2 NOx, _SCR, Ppm	Unit CT2 O2, Dry, Pct	Unit CT2 NH3Inj, LbPerHr	Unit CT2 ExhaustFlow, LbPerHr	Unit CT2 SUSD, Hr	Unit CT2 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/30/2022 00:00	0	1.7	8.1	14.4	14.8	993,991.4	0.00	1.00
08/30/2022 01:00	0	1.7	7.7	14.4	13.7	952,276.6	0.00	1.00
08/30/2022 02:00	0	1.7	7.9	14.4	13.6	944,481.5	0.00	1.00
08/30/2022 03:00	0	1.7	7.9	14.4	13.1	942,796.0	0.00	1.00
08/30/2022 04:00	0	1.7	8.3	14.4	16.0	989,356.4	0.00	1.00
08/30/2022 05:00	0	1.7	8.9	14.4	17.6	1,034,442.1	0.00	1.00
08/30/2022 06:00	1	1.6	12.6	14.5	20.8	708,249.2	0.00	1.00
08/30/2022 07:00	1	1.7	15.4	14.7	22.7	651,360.1	0.00	1.00
08/30/2022 08:00	0	1.5	12.5	14.6	13.8	732,316.0	0.00	1.00
08/30/2022 09:00	0	1.8	8.7	14.3	9.8	782,646.8	0.00	1.00
08/30/2022 10:00	0	1.7	7.6	14.4	8.8	917,514.3	0.00	1.00
08/30/2022 11:00	0	1.8	8.0	14.5	14.3	1,014,016.0	0.00	1.00
08/30/2022 12:00	0	1.7	7.7	14.5	13.3	996,898.2	0.00	1.00
08/30/2022 13:00	0	1.8	8.3	14.3	15.3	985,363.1	0.00	1.00
08/30/2022 14:00	2	2.4	12.3	12.3	28.0	1,005,571.5	0.00	1.00
08/30/2022 15:00	2	2.4	12.6	12.0	30.6	999,218.2	0.00	1.00
08/30/2022 16:00	2	2.4	12.6	12.1	29.7	1,000,457.9	0.00	1.00
08/30/2022 17:00	2	2.5	12.9	11.8	34.3	1,014,728.4	0.00	1.00
08/30/2022 18:00	2	2.5	12.9	11.7	34.8	1,011,587.8	0.00	1.00
08/30/2022 19:00	2	2.4	12.8	11.9	33.2	1,017,938.8	0.00	1.00
08/30/2022 20:00	1	2.3	12.5	12.4	28.4	1,020,946.2	0.00	1.00
08/30/2022 21:00	1	2.2	12.0	12.8	24.7	1,023,179.8	0.00	1.00
08/30/2022 22:00	1	1.9	9.8	13.7	18.0	984,654.2	0.00	1.00
08/30/2022 23:00	0	1.8	8.4	14.4	16.1	1,018,219.7	0.00	1.00
Average/Sum#:	1	1.9	10.4	13.6	20.2	947,592.1	0.00 #	24.00 #
Minimum:	0	1.5	7.6	11.7	8.8	651,360.1	0.00	1.00
Maximum:	2	2.5	15.4	14.7	34.8	1,034,442.1	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
 Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT2 NH3Slip, Ppmvdc	Unit CT2 NOx, Ppm	Unit CT2 NOx, _SCR, Ppm	Unit CT2 O2, Dry, Pct	Unit CT2 NH3Inj, LbPerHr	Unit CT2 ExhaustFlow, LbPerHr	Unit CT2 SUSD, Hr	Unit CT2 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/31/2022 00:00	0	1.8	8.4	14.4	16.1	1,020,958.5	0.00	1.00
08/31/2022 01:00	0	1.8	8.5	14.4	16.6	1,025,172.2	0.00	1.00
08/31/2022 02:00	0	1.8	8.8	14.4	16.7	1,027,911.0	0.00	1.00
08/31/2022 03:00	0	1.8	8.7	14.4	16.6	1,024,961.5	0.00	1.00
08/31/2022 04:00	0	1.8	8.8	14.4	17.3	1,032,124.6	0.00	1.00
08/31/2022 05:00	0	1.8	8.8	14.4	17.3	1,035,074.2	0.00	1.00
08/31/2022 06:00	0	1.8	8.2	14.4	13.5	935,632.9	0.00	1.00
08/31/2022 07:00	0	1.8	8.1	14.3	11.9	835,763.9	0.00	1.00
08/31/2022 08:00	0	1.8	7.6	14.3	10.8	834,103.9	0.00	1.00
08/31/2022 09:00	0	1.8	7.6	14.4	11.7	897,710.4	0.00	1.00
08/31/2022 10:00	0	1.8	7.9	14.4	14.1	993,570.1	0.00	1.00
08/31/2022 11:00	1	2.3	12.2	12.6	26.2	1,024,758.4	0.00	1.00
08/31/2022 12:00	2	2.4	12.6	12.2	28.9	1,011,957.4	0.00	1.00
08/31/2022 13:00	2	2.4	12.7	12.0	30.6	1,009,989.0	0.00	1.00
08/31/2022 14:00	2	2.3	12.6	12.2	29.0	1,004,402.0	0.00	1.00
08/31/2022 15:00	1	2.2	12.1	12.7	25.1	1,002,017.8	0.00	1.00
08/31/2022 16:00	1	2.1	11.2	13.1	21.7	998,977.5	0.00	1.00
08/31/2022 17:00	2	2.4	12.9	12.1	31.7	1,011,973.5	0.00	1.00
08/31/2022 18:00	2	2.4	13.0	11.9	33.7	1,011,700.3	0.00	1.00
08/31/2022 19:00	1	2.2	12.5	12.5	27.5	1,011,580.8	0.00	1.00
08/31/2022 20:00	1	2.1	11.0	13.3	21.1	1,016,977.8	0.00	1.00
08/31/2022 21:00	1	2.2	11.6	13.0	23.2	1,013,894.1	0.00	1.00
08/31/2022 22:00	1	2.0	10.1	13.7	19.2	1,017,178.0	0.00	1.00
08/31/2022 23:00	1	2.1	11.0	13.4	22.1	1,032,180.8	0.00	1.00
Average/Sum#:	1	2.0	10.3	13.5	20.9	992,940.4	0.00 #	24.00 #
Minimum:	0	1.8	7.6	11.9	10.8	834,103.9	0.00	1.00
Maximum:	2	2.4	13.0	14.4	33.7	1,035,074.2	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
 Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:	> 10							
	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2
	NH3Slip, Ppmvdc	NOx, Ppm	NOx, _SCR, Ppm	O2, Dry, Pct	NH3Inj, LbPerHr	ExhaustFlow, LbPerHr	SUSD, Hr	OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/01/2022 00:00	1	2.1	11.3	13.3	22.2	1,030,491.8	0.00	1.00
09/01/2022 01:00	0	1.9	9.6	14.0	18.1	1,010,198.6	0.00	1.00
09/01/2022 02:00	0	1.8	8.1	14.5	14.4	1,009,522.5	0.00	1.00
09/01/2022 03:00	0	1.8	8.1	14.5	14.9	1,027,496.2	0.00	1.00
09/01/2022 04:00	0	1.8	8.1	14.4	15.0	1,001,365.2	0.00	1.00
09/01/2022 05:00	0	1.8	8.1	14.4	15.1	1,005,368.2	0.00	1.00
09/01/2022 06:00	0	1.8	8.0	14.4	14.4	987,039.0	0.00	1.00
09/01/2022 07:00	0	1.8	7.9	14.5	13.9	1,010,592.4	0.00	1.00
09/01/2022 08:00	1	1.7	11.9	14.6	17.5	684,494.8	0.00	1.00
09/01/2022 09:00	1	1.7	11.5	14.7	16.5	687,141.8	0.00	1.00
09/01/2022 10:00	0	1.6	11.2	14.7	14.6	709,229.3	0.00	1.00
09/01/2022 11:00	1	1.7	9.3	14.1	12.1	862,133.2	0.00	1.00
09/01/2022 12:00	1	2.3	12.0	12.6	25.0	1,006,939.4	0.00	1.00
09/01/2022 13:00	2	2.3	12.3	12.3	27.6	996,017.4	0.00	1.00
09/01/2022 14:00	2	2.4	12.6	12.2	29.7	1,001,568.7	0.00	1.00
09/01/2022 15:00	2	2.5	12.8	11.9	33.1	1,001,505.7	0.00	1.00
09/01/2022 16:00	2	2.4	12.5	12.2	29.5	997,476.1	0.00	1.00
09/01/2022 17:00	2	2.5	12.8	11.8	33.1	990,951.6	0.00	1.00
09/01/2022 18:00	2	2.5	12.7	11.8	33.1	992,456.5	0.00	1.00
09/01/2022 19:00	1	2.3	12.4	12.4	27.5	1,008,379.7	0.00	1.00
09/01/2022 20:00	2	2.4	12.7	12.1	30.3	1,004,037.1	0.00	1.00
09/01/2022 21:00	2	2.3	12.5	12.3	28.1	1,004,138.4	0.00	1.00
09/01/2022 22:00	1	2.2	11.9	12.7	24.5	1,006,192.9	0.00	1.00
09/01/2022 23:00	1	2.2	12.1	12.7	25.1	1,016,213.1	0.00	1.00
Average/Sum#:	1	2.1	10.9	13.3	22.3	960,456.2	0.00 #	24.00 #
Minimum:	0	1.6	7.9	11.8	12.1	684,494.8	0.00	1.00
Maximum:	2	2.5	12.8	14.7	33.1	1,030,491.8	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:	> 10							
	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2
	NH3Slip, Ppmvdc	NOx, Ppm	NOx, _SCR, Ppm	O2, Dry, Pct	NH3Inj, LbPerHr	ExhaustFlow, LbPerHr	SUSD, Hr	OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/02/2022 00:00	1	2.1	11.5	13.0	22.5	1,011,293.9	0.00	1.00
09/02/2022 01:00	1	2.1	11.3	13.2	22.0	1,022,088.6	0.00	1.00
09/02/2022 02:00	1	2.0	11.1	13.4	21.0	1,022,868.7	0.00	1.00
09/02/2022 03:00	1	2.0	10.8	13.4	20.8	1,017,573.6	0.00	1.00
09/02/2022 04:00	1	2.1	11.5	13.1	22.9	1,019,694.5	0.00	1.00
09/02/2022 05:00	1	2.2	12.5	12.9	25.8	1,035,798.4	0.00	1.00
09/02/2022 06:00	1	2.0	10.5	13.7	19.8	1,030,872.2	0.00	1.00
09/02/2022 07:00	0	1.9	9.5	14.0	17.8	1,020,717.3	0.00	1.00
09/02/2022 08:00	1	1.9	9.9	13.8	18.5	1,022,246.4	0.00	1.00
09/02/2022 09:00	1	2.1	10.8	13.3	21.2	1,012,292.9	0.00	1.00
09/02/2022 10:00	1	2.1	11.5	13.0	22.4	1,008,867.1	0.00	1.00
09/02/2022 11:00	1	2.2	11.8	12.8	24.0	1,003,399.2	0.00	1.00
09/02/2022 12:00	1	2.2	12.3	12.6	25.8	1,000,669.7	0.00	1.00
09/02/2022 13:00	2	2.4	12.8	12.3	29.8	1,007,641.6	0.00	1.00
09/02/2022 14:00	2	2.3	12.9	12.3	29.7	1,004,934.6	0.00	1.00
09/02/2022 15:00	1	2.1	11.5	13.2	22.1	1,008,750.0	0.00	1.00
09/02/2022 16:00	1	2.1	11.1	13.3	21.3	1,000,580.7	0.00	1.00
09/02/2022 17:00	1	2.1	11.1	13.3	21.5	1,010,130.7	0.00	1.00
09/02/2022 18:00	1	2.2	11.7	13.0	23.7	1,010,253.8	0.00	1.00
09/02/2022 19:00	1	2.2	12.0	12.8	25.0	1,016,248.1	0.00	1.00
09/02/2022 20:00	1	2.2	11.6	12.9	23.6	1,008,923.4	0.00	1.00
09/02/2022 21:00	1	2.0	10.6	13.4	20.0	1,009,722.2	0.00	1.00
09/02/2022 22:00	0	1.9	9.5	13.9	17.0	993,223.9	0.00	1.00
09/02/2022 23:00	1	1.7	10.0	14.5	14.9	801,969.2	0.00	1.00
Average/Sum#:	1	2.1	11.2	13.2	22.2	1,004,198.4	0.00 #	24.00 #
Minimum:	0	1.7	9.5	12.3	14.9	801,969.2	0.00	1.00
Maximum:	2	2.4	12.9	14.5	29.8	1,035,798.4	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT2 NH3Slip, Ppmvdc	Unit CT2 NOx, Ppm	Unit CT2 NOx, _SCR, Ppm	Unit CT2 O2, Dry, Pct	Unit CT2 NH3Inj, LbPerHr	Unit CT2 ExhaustFlow, LbPerHr	Unit CT2 SUSD, Hr	Unit CT2 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/03/2022 00:00	0	1.7	7.7	14.3	10.1	859,002.6	0.00	1.00
09/03/2022 01:00	1	1.7	12.7	14.6	19.7	675,148.0	0.00	1.00
09/03/2022 02:00	0	1.6	13.4	14.7	20.0	667,483.9	0.00	1.00
09/03/2022 03:00	1	1.7	13.6	14.6	19.6	659,932.1	0.00	1.00
09/03/2022 04:00	1	1.7	14.7	14.7	21.3	660,636.8	0.00	1.00
09/03/2022 05:00	1	1.7	13.9	14.6	20.4	658,410.5	0.00	1.00
09/03/2022 06:00	1	1.7	16.3	14.7	24.9	644,292.1	0.00	1.00
09/03/2022 07:00	1	1.7	15.9	14.7	23.4	644,071.2	0.00	1.00
09/03/2022 08:00	1	1.7	15.8	14.8	23.2	649,466.4	0.00	1.00
09/03/2022 09:00	1	1.6	13.7	14.8	18.3	664,732.1	0.00	1.00
09/03/2022 10:00	1	1.7	12.8	14.7	18.9	655,115.0	0.00	1.00
09/03/2022 11:00	1	1.6	13.5	14.8	18.9	655,527.7	0.00	1.00
09/03/2022 12:00	0	1.5	9.5	14.6	9.8	776,441.9	0.00	1.00
09/03/2022 13:00	0	2.0	9.4	13.7	16.0	999,489.6	0.00	1.00
09/03/2022 14:00	0	1.9	9.0	13.8	16.2	974,413.0	0.00	1.00
09/03/2022 15:00	1	2.0	10.2	14.3	14.3	810,242.8	0.00	1.00
09/03/2022 16:00	1	2.0	9.4	13.7	17.7	1,002,342.6	0.00	1.00
09/03/2022 17:00	1	2.0	9.5	13.7	17.9	1,000,821.0	0.00	1.00
09/03/2022 18:00	1	1.9	9.5	13.8	18.2	1,010,480.9	0.00	1.00
09/03/2022 19:00	1	1.8	10.7	14.6	16.5	778,832.9	0.00	1.00
09/03/2022 20:00	1	1.6	11.2	14.5	14.7	684,498.2	0.00	1.00
09/03/2022 21:00	0	1.6	9.8	14.5	12.3	749,117.9	0.00	1.00
09/03/2022 22:00	1	1.8	10.7	14.5	13.3	727,292.7	0.00	1.00
09/03/2022 23:00	0	1.6	8.9	14.4	9.8	797,215.7	0.00	1.00
Average/Sum#:	1	1.7	11.7	14.4	17.3	766,875.3	0.00 #	24.00 #
Minimum:	0	1.5	7.7	13.7	9.8	644,071.2	0.00	1.00
Maximum:	1	2.0	16.3	14.8	24.9	1,010,480.9	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:	> 10							
	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2
	NH3Slip, Ppmvdc	NOx, Ppm	NOx, _SCR, Ppm	O2, Dry, Pct	NH3Inj, LbPerHr	ExhaustFlow, LbPerHr	SUSD, Hr	OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/04/2022 00:00	1	1.7	10.5	14.5	13.7	756,820.9	0.00	1.00
09/04/2022 01:00	1	1.7	12.3	14.7	17.3	684,491.3	0.00	1.00
09/04/2022 02:00	1	1.7	10.9	14.5	14.2	720,873.6	0.00	1.00
09/04/2022 03:00	1	1.7	10.5	14.5	13.4	733,070.0	0.00	1.00
09/04/2022 04:00	1	1.7	12.6	14.6	18.8	675,365.3	0.00	1.00
09/04/2022 05:00	1	1.7	15.0	14.7	23.5	655,115.0	0.00	1.00
09/04/2022 06:00	1	1.7	15.3	14.7	23.0	652,464.5	0.00	1.00
09/04/2022 07:00	1	1.7	15.8	14.8	22.9	654,854.3	0.00	1.00
09/04/2022 08:00	1	1.7	15.2	14.8	22.1	653,282.8	0.00	1.00
09/04/2022 09:00	1	1.7	14.5	14.8	20.8	652,609.3	0.00	1.00
09/04/2022 10:00	1	1.6	12.6	14.8	17.2	662,487.1	0.00	1.00
09/04/2022 11:00	0	1.6	12.0	14.9	15.3	668,507.3	0.00	1.00
09/04/2022 12:00	0	1.6	9.4	14.6	10.0	716,013.3	0.00	1.00
09/04/2022 13:00	1	1.6	10.5	14.6	16.7	705,362.2	0.00	1.00
09/04/2022 14:00	0	1.3	9.3	14.2	10.5	830,852.3	0.00	1.00
09/04/2022 15:00	1	2.0	9.4	13.7	16.9	997,207.2	0.00	1.00
09/04/2022 16:00	1	2.0	9.8	13.5	18.4	995,423.5	0.00	1.00
09/04/2022 17:00	1	2.1	10.7	13.1	21.0	992,481.5	0.00	1.00
09/04/2022 18:00	1	2.1	10.7	13.2	20.2	998,968.4	0.00	1.00
09/04/2022 19:00	0	1.8	8.3	14.2	14.4	981,284.5	0.00	1.00
09/04/2022 20:00	1	2.0	10.0	13.5	19.4	1,008,007.4	0.00	1.00
09/04/2022 21:00	1	2.0	10.0	13.5	18.5	1,004,676.3	0.00	1.00
09/04/2022 22:00	0	1.9	8.9	14.0	15.5	994,718.1	0.00	1.00
09/04/2022 23:00	0	1.8	7.3	14.4	11.9	955,436.9	0.00	1.00
Average/Sum#:	1	1.8	11.3	14.3	17.3	806,265.5	0.00 #	24.00 #
Minimum:	0	1.3	7.3	13.1	10.0	652,464.5	0.00	1.00
Maximum:	1	2.1	15.8	14.9	23.5	1,008,007.4	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:	> 10							
	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2
	NH3Slip, Ppmvdc	NOx, Ppm	NOx, _SCR, Ppm	O2, Dry, Pct	NH3Inj, LbPerHr	ExhaustFlow, LbPerHr	SUSD, Hr	OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/05/2022 00:00	0	1.8	7.2	14.4	12.0	946,799.0	0.00	1.00
09/05/2022 01:00	1	1.8	7.9	14.3	13.3	852,155.4	0.00	1.00
09/05/2022 02:00	0	1.7	8.3	14.3	7.3	817,712.3	0.00	1.00
09/05/2022 03:00	0	1.8	7.7	14.3	11.1	847,175.7	0.00	1.00
09/05/2022 04:00	0	1.8	7.7	14.3	11.2	851,948.0	0.00	1.00
09/05/2022 05:00	1	1.8	8.1	14.3	13.1	827,879.3	0.00	1.00
09/05/2022 06:00	1	1.7	14.5	14.6	22.5	649,933.2	0.00	1.00
09/05/2022 07:00	1	1.7	15.5	14.8	21.9	652,160.3	0.00	1.00
09/05/2022 08:00	1	1.7	14.6	14.8	20.7	653,731.8	0.00	1.00
09/05/2022 09:00	0	1.2	9.1	14.5	9.4	846,689.4	0.00	1.00
09/05/2022 10:00	0	1.8	7.0	14.5	8.9	956,885.3	0.00	1.00
09/05/2022 11:00	0	1.8	7.8	14.3	13.6	949,467.6	0.00	1.00
09/05/2022 12:00	1	2.1	10.5	13.2	19.9	993,633.0	0.00	1.00
09/05/2022 13:00	1	2.2	11.0	12.7	23.0	984,315.5	0.00	1.00
09/05/2022 14:00	2	2.4	12.1	12.0	29.5	982,908.2	0.00	1.00
09/05/2022 15:00	2	2.5	12.1	11.9	30.7	986,137.7	0.00	1.00
09/05/2022 16:00	2	2.5	12.1	11.8	31.3	975,903.0	0.00	1.00
09/05/2022 17:00	2	2.5	12.1	11.7	31.6	968,421.2	0.00	1.00
09/05/2022 18:00	2	2.5	12.2	11.8	31.5	981,471.0	0.00	1.00
09/05/2022 19:00	2	2.4	12.3	11.9	31.0	990,246.0	0.00	1.00
09/05/2022 20:00	2	2.4	12.4	12.0	30.4	998,295.0	0.00	1.00
09/05/2022 21:00	1	2.3	12.3	12.3	26.7	993,151.1	0.00	1.00
09/05/2022 22:00	1	2.3	12.1	12.3	25.9	992,514.2	0.00	1.00
09/05/2022 23:00	1	2.3	12.4	12.3	27.1	1,000,953.7	0.00	1.00
Average/Sum#:	1	2.0	10.8	13.3	21.0	904,187.0	0.00 #	24.00 #
Minimum:	0	1.2	7.0	11.7	7.3	649,933.2	0.00	1.00
Maximum:	2	2.5	15.5	14.8	31.6	1,000,953.7	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT2 NH3Slip, Ppmvdc	Unit CT2 NOx, Ppm	Unit CT2 NOx, _SCR, Ppm	Unit CT2 O2, Dry, Pct	Unit CT2 NH3Inj, LbPerHr	Unit CT2 ExhaustFlow, LbPerHr	Unit CT2 SUSD, Hr	Unit CT2 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/06/2022 00:00	1	2.2	11.5	12.9	22.5	1,010,121.7	0.00	1.00
09/06/2022 01:00	0	1.9	9.1	13.9	15.2	980,312.2	0.00	1.00
09/06/2022 02:00	0	1.6	7.4	14.5	12.7	991,976.8	0.00	1.00
09/06/2022 03:00	0	1.8	7.3	14.5	12.4	990,906.9	0.00	1.00
09/06/2022 04:00	0	1.8	7.3	14.5	12.5	992,404.7	0.00	1.00
09/06/2022 05:00	0	1.8	7.3	14.5	12.8	992,190.8	0.00	1.00
09/06/2022 06:00	0	1.8	7.4	14.4	12.5	969,131.1	0.00	1.00
09/06/2022 07:00	0	1.8	7.3	14.4	10.9	916,250.3	0.00	1.00
09/06/2022 08:00	0	1.8	7.0	14.5	12.0	969,295.7	0.00	1.00
09/06/2022 09:00	1	1.9	9.2	13.7	17.1	958,216.7	0.00	1.00
09/06/2022 10:00	1	2.2	10.7	12.8	21.8	983,618.7	0.00	1.00
09/06/2022 11:00	2	2.5	12.2	11.9	30.6	990,854.6	0.00	1.00
09/06/2022 12:00	2	2.5	12.2	11.8	31.0	980,267.1	0.00	1.00
09/06/2022 13:00	2	2.5	12.1	11.8	31.2	981,922.4	0.00	1.00
09/06/2022 14:00	2	2.5	12.2	11.7	31.4	964,997.6	0.00	1.00
09/06/2022 15:00	2	2.5	12.2	11.7	31.4	963,806.8	0.00	1.00
09/06/2022 16:00	2	2.5	12.1	11.7	31.4	966,932.7	0.00	1.00
09/06/2022 17:00	2	2.5	12.1	11.7	31.5	966,783.8	0.00	1.00
09/06/2022 18:00	2	2.5	11.9	11.7	30.7	966,337.3	0.00	1.00
09/06/2022 19:00	2	2.5	12.2	11.9	30.9	992,984.8	0.00	1.00
09/06/2022 20:00	2	2.4	12.3	12.0	30.2	1,000,603.0	0.00	1.00
09/06/2022 21:00	2	2.4	12.5	12.0	30.0	995,063.8	0.00	1.00
09/06/2022 22:00	1	2.1	11.1	13.0	20.9	997,946.4	0.00	1.00
09/06/2022 23:00	1	2.1	11.1	13.1	21.6	1,009,336.0	0.00	1.00
Average/Sum#:	1	2.2	10.3	12.9	22.7	980,510.9	0.00 #	24.00 #
Minimum:	0	1.6	7.0	11.7	10.9	916,250.3	0.00	1.00
Maximum:	2	2.5	12.5	14.5	31.5	1,010,121.7	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT2 NH3Slip, Ppmvdc	Unit CT2 NOx, Ppm	Unit CT2 NOx, _SCR, Ppm	Unit CT2 O2, Dry, Pct	Unit CT2 NH3Inj, LbPerHr	Unit CT2 ExhaustFlow, LbPerHr	Unit CT2 SUSD, Hr	Unit CT2 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/07/2022 00:00	0	1.8	8.6	14.1	15.0	989,006.3	0.00	1.00
09/07/2022 01:00	0	1.8	8.0	14.5	14.1	1,015,727.7	0.00	1.00
09/07/2022 02:00	0	1.7	8.0	14.5	13.7	1,014,657.9	0.00	1.00
09/07/2022 03:00	0	1.7	8.0	14.5	13.7	1,014,871.9	0.00	1.00
09/07/2022 04:00	0	1.8	8.1	14.5	14.4	1,016,583.6	0.00	1.00
09/07/2022 05:00	0	1.8	8.2	14.5	15.0	1,021,077.1	0.00	1.00
09/07/2022 06:00	0	1.7	7.9	14.5	13.2	990,265.0	0.00	1.00
09/07/2022 07:00	0	1.7	7.9	14.3	11.9	859,417.5	0.00	1.00
09/07/2022 08:00	0	1.7	7.4	14.5	11.4	963,304.5	0.00	1.00
09/07/2022 09:00	1	2.5	12.5	12.5	27.3	1,016,634.6	0.00	1.00
09/07/2022 10:00	2	2.5	13.1	12.2	29.4	1,011,485.2	0.00	1.00
09/07/2022 11:00	2	2.5	13.1	12.2	30.1	1,014,790.7	0.00	1.00
09/07/2022 12:00	2	2.6	12.8	12.1	30.1	1,007,149.4	0.00	1.00
09/07/2022 13:00	2	2.6	12.6	12.0	30.3	999,218.2	0.00	1.00
09/07/2022 14:00	2	2.6	12.5	12.0	30.5	1,001,064.6	0.00	1.00
09/07/2022 15:00	2	2.6	12.5	11.9	30.7	991,919.7	0.00	1.00
09/07/2022 16:00	2	2.6	12.7	11.9	31.3	991,615.4	0.00	1.00
09/07/2022 17:00	2	2.6	12.5	11.9	30.9	992,376.2	0.00	1.00
09/07/2022 18:00	2	2.6	12.5	11.9	30.4	992,224.0	0.00	1.00
09/07/2022 19:00	2	2.5	12.4	12.1	28.3	998,279.3	0.00	1.00
09/07/2022 20:00	2	2.6	12.7	12.1	29.4	1,009,016.8	0.00	1.00
09/07/2022 21:00	2	2.5	12.8	12.2	28.7	1,012,429.6	0.00	1.00
09/07/2022 22:00	1	2.4	12.4	12.6	26.0	1,021,623.6	0.00	1.00
09/07/2022 23:00	1	2.3	12.2	12.8	25.4	1,026,899.2	0.00	1.00
Average/Sum#:	1	2.2	10.9	13.0	23.4	998,818.3	0.00 #	24.00 #
Minimum:	0	1.7	7.4	11.9	11.4	859,417.5	0.00	1.00
Maximum:	2	2.6	13.1	14.5	31.3	1,026,899.2	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
 Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:	> 10							
	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2
	NH3Slip, Ppmvdc	NOx, Ppm	NOx, _SCR, Ppm	O2, Dry, Pct	NH3Inj, LbPerHr	ExhaustFlow, LbPerHr	SUSD, Hr	OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/08/2022 00:00	1	2.2	12.1	12.8	24.1	1,019,967.6	0.00	1.00
09/08/2022 01:00	0	1.8	8.5	14.3	14.9	993,870.1	0.00	1.00
09/08/2022 02:00	0	1.8	8.5	14.5	15.1	1,025,142.5	0.00	1.00
09/08/2022 03:00	0	1.8	8.6	14.5	15.6	1,028,352.1	0.00	1.00
09/08/2022 04:00	0	1.8	8.2	14.5	14.7	1,029,636.0	0.00	1.00
09/08/2022 05:00	0	1.8	8.5	14.4	15.7	1,016,955.6	0.00	1.00
09/08/2022 06:00	0	1.7	8.1	14.4	13.8	999,258.4	0.00	1.00
09/08/2022 07:00	0	1.8	7.6	14.4	12.7	971,027.2	0.00	1.00
09/08/2022 08:00	0	1.8	7.9	14.4	14.5	992,938.0	0.00	1.00
09/08/2022 09:00	2	2.5	12.5	12.2	28.8	1,013,216.6	0.00	1.00
09/08/2022 10:00	2	2.4	12.5	12.0	30.0	997,525.6	0.00	1.00
09/08/2022 11:00	2	2.4	12.4	11.9	30.4	989,789.5	0.00	1.00
09/08/2022 12:00	2	2.4	12.4	11.9	31.1	989,333.0	0.00	1.00
09/08/2022 13:00	2	2.5	12.4	11.8	31.4	982,072.9	0.00	1.00
09/08/2022 14:00	2	2.5	12.3	11.8	31.7	982,373.9	0.00	1.00
09/08/2022 15:00	2	2.5	12.3	11.8	31.9	982,524.4	0.00	1.00
09/08/2022 16:00	2	2.5	12.4	11.8	32.0	981,170.0	0.00	1.00
09/08/2022 17:00	2	2.5	12.3	11.8	32.0	983,126.3	0.00	1.00
09/08/2022 18:00	2	2.5	12.3	11.9	31.6	992,224.0	0.00	1.00
09/08/2022 19:00	2	2.5	12.5	11.9	31.4	996,028.0	0.00	1.00
09/08/2022 20:00	2	2.5	12.6	11.8	32.4	998,325.4	0.00	1.00
09/08/2022 21:00	2	2.5	12.6	11.7	33.0	994,916.6	0.00	1.00
09/08/2022 22:00	2	2.4	12.3	12.1	28.4	995,322.5	0.00	1.00
09/08/2022 23:00	1	2.3	12.3	12.5	26.1	1,005,385.7	0.00	1.00
Average/Sum#:	1	2.2	11.0	12.8	25.1	998,353.4	0.00 #	24.00 #
Minimum:	0	1.7	7.6	11.7	12.7	971,027.2	0.00	1.00
Maximum:	2	2.5	12.6	14.5	33.0	1,029,636.0	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:	> 10							
	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2
	NH3Slip, Ppmvdc	NOx, Ppm	NOx, _SCR, Ppm	O2, Dry, Pct	NH3Inj, LbPerHr	ExhaustFlow, LbPerHr	SUSD, Hr	OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/09/2022 00:00	1	2.3	12.5	12.5	26.7	1,010,113.5	0.00	1.00
09/09/2022 01:00	1	2.2	11.7	12.9	23.1	1,010,977.6	0.00	1.00
09/09/2022 02:00	1	1.9	11.4	12.9	23.4	998,652.7	0.00	1.00
09/09/2022 03:00	0	2.0	11.2	13.2	21.9	1,006,793.7	0.00	1.00
09/09/2022 04:00	1	2.2	11.9	12.9	24.3	1,019,194.1	0.00	1.00
09/09/2022 05:00	2	2.4	13.0	12.2	30.8	1,026,281.3	0.00	1.00
09/09/2022 06:00	1	2.3	12.6	12.5	27.6	1,022,829.6	0.00	1.00
09/09/2022 07:00	1	2.3	12.4	12.6	26.0	1,018,323.8	0.00	1.00
09/09/2022 08:00	1	2.2	11.9	12.8	23.5	1,010,330.9	0.00	1.00
09/09/2022 09:00	1	2.1	11.3	13.0	21.6	995,519.5	0.00	1.00
09/09/2022 10:00	1	2.3	12.2	12.4	26.7	1,006,124.2	0.00	1.00
09/09/2022 11:00	1	2.1	10.9	13.1	20.4	991,954.8	0.00	1.00
09/09/2022 12:00	1	2.3	12.2	12.5	26.6	1,002,125.2	0.00	1.00
09/09/2022 13:00	2	2.4	12.6	12.1	29.7	993,143.9	0.00	1.00
09/09/2022 14:00	1	2.3	12.3	12.4	26.9	989,852.2	0.00	1.00
09/09/2022 15:00	1	2.3	12.2	12.5	26.4	985,659.5	0.00	1.00
09/09/2022 16:00	1	2.1	11.3	13.0	21.5	981,998.6	0.00	1.00
09/09/2022 17:00	1	2.2	11.8	12.8	23.9	992,241.0	0.00	1.00
09/09/2022 18:00	1	2.1	11.1	13.1	20.7	990,374.7	0.00	1.00
09/09/2022 19:00	1	2.0	10.1	13.5	18.3	993,572.9	0.00	1.00
09/09/2022 20:00	0	1.9	8.7	14.0	13.6	938,551.9	0.00	1.00
09/09/2022 21:00	0	1.8	7.3	14.5	11.6	954,531.6	0.00	1.00
09/09/2022 22:00	0	1.7	8.2	14.4	12.2	838,719.8	0.00	1.00
09/09/2022 23:00	0	1.7	7.2	14.5	10.4	965,444.2	0.00	1.00
Average/Sum#:	1	2.1	11.2	13.0	22.4	989,304.6	0.00 #	24.00 #
Minimum:	0	1.7	7.2	12.1	10.4	838,719.8	0.00	1.00
Maximum:	2	2.4	13.0	14.5	30.8	1,026,281.3	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT2 NH3Slip, Ppmvdc	Unit CT2 NOx, Ppm	Unit CT2 NOx, _SCR, Ppm	Unit CT2 O2, Dry, Pct	Unit CT2 NH3Inj, LbPerHr	Unit CT2 ExhaustFlow, LbPerHr	Unit CT2 SUSD, Hr	Unit CT2 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/10/2022 00:00	0	1.8	7.7	14.4	11.4	907,401.7	0.00	1.00
09/10/2022 01:00	1	1.7	11.8	14.6	18.0	708,188.0	0.00	1.00
09/10/2022 02:00	0	0.6	10.1	14.4	18.8	815,966.3	0.00	1.00
09/10/2022 03:00	0	1.8	10.0	14.3	4.5	757,540.7	0.00	1.00
09/10/2022 04:00	0	1.8	8.0	14.3	12.2	863,359.8	0.00	1.00
09/10/2022 05:00	0	1.7	8.4	14.3	10.6	818,542.3	0.00	1.00
09/10/2022 06:00	1	1.6	10.7	14.5	14.5	794,908.1	0.00	1.00
09/10/2022 07:00	0	1.8	8.3	14.4	13.7	971,237.9	0.00	1.00
09/10/2022 08:00	0	1.7	8.9	14.4	13.8	873,692.8	0.00	1.00
09/10/2022 09:00	1	1.6	10.1	14.4	14.0	735,907.6	0.00	1.00
09/10/2022 10:00	1	1.6	13.9	14.8	19.8	663,385.1	0.00	1.00
09/10/2022 11:00	1	1.7	14.0	14.8	20.0	658,895.2	0.00	1.00
09/10/2022 12:00	1	1.5	12.5	14.7	17.9	698,406.4	0.00	1.00
09/10/2022 13:00	0	1.4	11.6	14.6	14.3	757,096.1	0.00	1.00
09/10/2022 14:00	1	1.8	11.9	14.6	15.8	680,799.6	0.00	1.00
09/10/2022 15:00	1	1.6	10.8	14.6	14.4	696,232.7	0.00	1.00
09/10/2022 16:00	1	1.4	9.7	14.5	11.7	768,589.4	0.00	1.00
09/10/2022 17:00	1	1.9	11.4	14.5	15.6	682,358.5	0.00	1.00
09/10/2022 18:00	0	1.6	8.4	14.3	7.6	786,381.6	0.00	1.00
09/10/2022 19:00	0	1.8	7.6	14.4	10.7	920,042.5	0.00	1.00
09/10/2022 20:00	0	1.8	7.9	14.4	12.7	940,057.2	0.00	1.00
09/10/2022 21:00	0	1.8	7.9	14.4	12.8	951,433.9	0.00	1.00
09/10/2022 22:00	1	1.6	9.1	14.3	12.7	773,309.8	0.00	1.00
09/10/2022 23:00	0	1.7	7.6	14.4	11.2	973,555.4	0.00	1.00
Average/Sum#:	0	1.6	9.9	14.5	13.7	799,887.0	0.00 #	24.00 #
Minimum:	0	0.6	7.6	14.3	4.5	658,895.2	0.00	1.00
Maximum:	1	1.9	14.0	14.8	20.0	973,555.4	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
 Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:	> 10							
	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2
	NH3Slip, Ppmvdc	NOx, Ppm	NOx, _SCR, Ppm	O2, Dry, Pct	NH3Inj, LbPerHr	ExhaustFlow, LbPerHr	SUSD, Hr	OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/11/2022 00:00	0	1.8	7.8	14.5	13.5	1,005,457.1	0.00	1.00
09/11/2022 01:00	0	1.8	7.8	14.4	13.4	977,137.0	0.00	1.00
09/11/2022 02:00	0	1.7	8.0	14.4	13.4	966,181.6	0.00	1.00
09/11/2022 03:00	0	1.8	8.0	14.3	9.4	872,281.8	0.00	1.00
09/11/2022 04:00	0	1.8	7.7	14.4	12.1	922,781.4	0.00	1.00
09/11/2022 05:00	1	1.7	8.4	14.3	14.8	882,448.8	0.00	1.00
09/11/2022 06:00	0	1.5	10.2	14.4	11.9	786,260.3	0.00	1.00
09/11/2022 07:00	1	1.6	12.2	14.5	18.4	696,908.6	0.00	1.00
09/11/2022 08:00	1	1.6	12.8	14.6	18.3	662,975.3	0.00	1.00
09/11/2022 09:00	1	1.6	14.3	14.7	20.2	655,556.7	0.00	1.00
09/11/2022 10:00	0	1.6	11.9	14.7	14.8	676,098.1	0.00	1.00
09/11/2022 11:00	1	1.7	11.2	14.7	16.4	681,399.1	0.00	1.00
09/11/2022 12:00	0	1.5	10.1	14.6	10.8	758,182.9	0.00	1.00
09/11/2022 13:00	0	2.0	10.0	14.5	10.9	739,917.1	0.00	1.00
09/11/2022 14:00	1	2.1	8.8	14.4	9.3	859,998.5	0.00	1.00
09/11/2022 15:00	0	1.8	7.4	14.4	10.6	901,713.3	0.00	1.00
09/11/2022 16:00	1	1.9	9.1	14.0	17.7	989,954.9	0.00	1.00
09/11/2022 17:00	1	2.1	11.0	13.2	21.3	1,018,531.6	0.00	1.00
09/11/2022 18:00	1	2.0	10.2	13.7	19.5	1,032,774.2	0.00	1.00
09/11/2022 19:00	0	1.9	9.5	13.9	17.4	1,004,375.0	0.00	1.00
09/11/2022 20:00	0	1.7	7.8	14.4	12.6	964,496.1	0.00	1.00
09/11/2022 21:00	1	1.7	10.9	14.5	17.1	754,895.2	0.00	1.00
09/11/2022 22:00	0	1.6	10.7	14.5	13.4	777,362.3	0.00	1.00
09/11/2022 23:00	1	1.6	10.4	14.4	13.3	741,385.3	0.00	1.00
Average/Sum#:	0	1.8	9.8	14.4	14.6	847,044.7	0.00 #	24.00 #
Minimum:	0	1.5	7.4	13.2	9.3	655,556.7	0.00	1.00
Maximum:	1	2.1	14.3	14.7	21.3	1,032,774.2	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10								
	Unit CT2 NH3Slip, Ppmvdc	Unit CT2 NOx, Ppm	Unit CT2 NOx, _SCR, Ppm	Unit CT2 O2, Dry, Pct	Unit CT2 NH3Inj, LbPerHr	Unit CT2 ExhaustFlow, LbPerHr	Unit CT2 SUSD, Hr	Unit CT2 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/12/2022 00:00	0	1.6	8.0	14.3	8.1	836,386.3	0.00	1.00
09/12/2022 01:00	1	1.7	13.0	14.6	20.3	679,930.1	0.00	1.00
09/12/2022 02:00	0	1.7	13.5	14.7	19.0	677,423.3	0.00	1.00
09/12/2022 03:00	1	1.7	13.8	14.7	19.6	674,110.2	0.00	1.00
09/12/2022 04:00	0	1.6	9.6	14.5	10.7	877,073.5	0.00	1.00
09/12/2022 05:00	0	1.8	8.0	14.5	13.6	1,023,644.7	0.00	1.00
09/12/2022 06:00	0	1.7	8.9	14.4	14.9	902,134.6	0.00	1.00
09/12/2022 07:00	1	1.6	11.2	14.4	16.0	725,373.6	0.00	1.00
09/12/2022 08:00	1	1.7	13.2	14.6	19.6	666,453.2	0.00	1.00
09/12/2022 09:00	1	1.7	12.7	14.7	17.9	677,423.3	0.00	1.00
09/12/2022 10:00	1	1.6	12.1	14.6	17.2	677,756.4	0.00	1.00
09/12/2022 11:00	0	1.6	9.7	14.6	13.1	861,215.8	0.00	1.00
09/12/2022 12:00	0	1.8	7.7	14.5	12.5	1,005,029.1	0.00	1.00
09/12/2022 13:00	0	1.8	7.5	14.4	10.1	859,787.8	0.00	1.00
09/12/2022 14:00	0	1.8	7.3	14.4	10.1	862,526.7	0.00	1.00
09/12/2022 15:00	1	1.6	8.8	14.5	14.0	875,575.7	0.00	1.00
09/12/2022 16:00	0	1.7	8.3	14.4	12.8	893,286.1	0.00	1.00
09/12/2022 17:00	0	1.8	7.6	14.5	13.8	1,003,317.3	0.00	1.00
09/12/2022 18:00	0	1.7	7.5	14.5	13.0	989,837.1	0.00	1.00
09/12/2022 19:00	0	1.8	7.6	14.5	13.9	999,037.9	0.00	1.00
09/12/2022 20:00	0	1.8	7.7	14.5	14.4	1,015,727.7	0.00	1.00
09/12/2022 21:00	0	1.7	7.7	14.5	13.8	1,004,815.1	0.00	1.00
09/12/2022 22:00	1	1.7	10.6	14.5	17.2	805,392.7	0.00	1.00
09/12/2022 23:00	0	1.7	7.5	14.4	10.1	891,811.3	0.00	1.00
Average/Sum#:	0	1.7	9.6	14.5	14.4	853,544.6	0.00 #	24.00 #
Minimum:	0	1.6	7.3	14.3	8.1	666,453.2	0.00	1.00
Maximum:	1	1.8	13.8	14.7	20.3	1,023,644.7	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT2 NH3Slip, Ppmvdc	Unit CT2 NOx, Ppm	Unit CT2 NOx, _SCR, Ppm	Unit CT2 O2, Dry, Pct	Unit CT2 NH3Inj, LbPerHr	Unit CT2 ExhaustFlow, LbPerHr	Unit CT2 SUSD, Hr	Unit CT2 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/13/2022 00:00	0	1.8	7.8	14.3	12.2	880,166.4	0.00	1.00
09/13/2022 01:00	1	1.7	10.6	14.4	17.3	736,961.0	0.00	1.00
09/13/2022 02:00	1	1.3	13.2	14.5	20.6	680,432.7	0.00	1.00
09/13/2022 03:00	0	1.7	8.4	14.3	6.1	879,336.4	0.00	1.00
09/13/2022 04:00	1	1.9	9.6	13.9	19.2	1,033,719.8	0.00	1.00
09/13/2022 05:00	1	1.9	9.8	13.8	19.5	1,040,376.8	0.00	1.00
09/13/2022 06:00	0	1.8	8.8	14.1	16.1	979,541.2	0.00	1.00
09/13/2022 07:00	1	1.7	9.6	14.4	15.8	824,814.8	0.00	1.00
09/13/2022 08:00	1	1.7	12.4	14.5	19.6	699,904.2	0.00	1.00
09/13/2022 09:00	1	1.6	14.0	14.6	20.1	660,584.2	0.00	1.00
09/13/2022 10:00	0	1.7	11.6	14.6	15.5	681,234.3	0.00	1.00
09/13/2022 11:00	1	1.7	11.3	14.6	16.0	681,669.0	0.00	1.00
09/13/2022 12:00	1	1.7	13.5	14.7	20.5	663,950.0	0.00	1.00
09/13/2022 13:00	1	1.7	13.8	14.7	20.2	659,974.2	0.00	1.00
09/13/2022 14:00	1	1.7	12.7	14.7	17.8	671,680.6	0.00	1.00
09/13/2022 15:00	1	1.7	13.6	14.7	20.1	661,962.1	0.00	1.00
09/13/2022 16:00	0	1.5	10.9	14.6	13.0	812,307.8	0.00	1.00
09/13/2022 17:00	0	1.9	9.3	13.9	16.7	1,031,763.5	0.00	1.00
09/13/2022 18:00	1	1.9	9.2	14.0	18.0	1,031,037.6	0.00	1.00
09/13/2022 19:00	1	1.9	9.2	14.0	18.2	1,034,014.6	0.00	1.00
09/13/2022 20:00	1	1.9	9.1	14.1	18.3	1,041,568.1	0.00	1.00
09/13/2022 21:00	0	1.8	8.7	14.2	17.0	1,028,294.6	0.00	1.00
09/13/2022 22:00	1	1.7	12.8	14.5	20.7	692,415.2	0.00	1.00
09/13/2022 23:00	0	1.7	8.2	14.3	8.8	814,185.0	0.00	1.00
Average/Sum#:	1	1.7	10.8	14.4	17.0	830,078.9	0.00 #	24.00 #
Minimum:	0	1.3	7.8	13.8	6.1	659,974.2	0.00	1.00
Maximum:	1	1.9	14.0	14.7	20.7	1,041,568.1	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:	> 10							
	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2
	NH3Slip, Ppmvdc	NOx, Ppm	NOx, _SCR, Ppm	O2, Dry, Pct	NH3Inj, LbPerHr	ExhaustFlow, LbPerHr	SUSD, Hr	OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/14/2022 00:00	1	1.8	10.1	14.3	15.6	742,601.5	0.00	1.00
09/14/2022 01:00	1	1.8	11.1	14.4	16.5	711,258.0	0.00	1.00
09/14/2022 02:00	0	1.7	10.8	14.3	15.3	709,610.8	0.00	1.00
09/14/2022 03:00	1	1.8	8.7	14.3	9.3	832,236.5	0.00	1.00
09/14/2022 04:00	0	1.7	8.1	14.3	12.6	903,197.6	0.00	1.00
09/14/2022 05:00	0	1.8	7.9	14.4	14.4	993,148.7	0.00	1.00
09/14/2022 06:00	1	1.7	11.6	14.4	20.8	800,165.2	0.00	1.00
09/14/2022 07:00	1	1.7	15.4	14.6	23.7	657,975.8	0.00	1.00
09/14/2022 08:00	1	1.7	16.1	14.7	24.3	655,556.7	0.00	1.00
09/14/2022 09:00	1	1.7	16.2	14.7	24.6	650,697.5	0.00	1.00
09/14/2022 10:00	1	1.7	15.2	14.7	22.5	657,986.3	0.00	1.00
09/14/2022 11:00	1	1.7	14.7	14.7	21.8	658,428.1	0.00	1.00
09/14/2022 12:00	1	1.7	14.8	14.7	21.9	657,102.8	0.00	1.00
09/14/2022 13:00	1	1.7	14.6	14.8	21.7	667,650.5	0.00	1.00
09/14/2022 14:00	1	1.7	14.6	14.8	21.5	667,875.0	0.00	1.00
09/14/2022 15:00	1	1.7	14.4	14.8	21.3	666,303.5	0.00	1.00
09/14/2022 16:00	1	1.7	13.2	14.7	18.0	670,134.4	0.00	1.00
09/14/2022 17:00	0	1.6	10.5	14.6	12.7	729,924.9	0.00	1.00
09/14/2022 18:00	0	1.7	9.0	14.3	10.5	772,479.8	0.00	1.00
09/14/2022 19:00	1	1.7	10.1	14.4	14.7	790,052.5	0.00	1.00
09/14/2022 20:00	1	1.6	10.1	14.4	14.1	781,414.6	0.00	1.00
09/14/2022 21:00	1	1.7	9.8	14.4	14.1	790,684.6	0.00	1.00
09/14/2022 22:00	1	1.7	13.4	14.6	20.1	673,191.6	0.00	1.00
09/14/2022 23:00	1	1.7	11.4	14.5	16.1	699,048.4	0.00	1.00
Average/Sum#:	1	1.7	12.2	14.5	17.8	730,780.2	0.00 #	24.00 #
Minimum:	0	1.6	7.9	14.3	9.3	650,697.5	0.00	1.00
Maximum:	1	1.8	16.2	14.8	24.6	993,148.7	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:	> 10							
	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2
	NH3Slip, Ppmvdc	NOx, Ppm	NOx, _SCR, Ppm	O2, Dry, Pct	NH3Inj, LbPerHr	ExhaustFlow, LbPerHr	SUSD, Hr	OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/15/2022 00:00	1	1.7	13.6	14.6	20.7	672,974.3	0.00	1.00
09/15/2022 01:00	0	1.6	11.8	14.5	15.1	689,419.6	0.00	1.00
09/15/2022 02:00	1	1.9	11.9	14.5	17.1	697,336.6	0.00	1.00
09/15/2022 03:00	0	1.7	10.6	14.4	11.6	761,189.3	0.00	1.00
09/15/2022 04:00	0	1.7	9.0	14.4	13.3	862,316.0	0.00	1.00
09/15/2022 05:00	0	1.8	7.8	14.4	12.9	956,068.9	0.00	1.00
09/15/2022 06:00	1	1.7	12.4	14.5	22.7	782,497.7	0.00	1.00
09/15/2022 07:00	0	1.6	12.0	14.5	15.6	733,284.0	0.00	1.00
09/15/2022 08:00	1	1.7	15.9	14.7	24.0	662,403.8	0.00	1.00
09/15/2022 09:00	1	1.7	16.0	14.7	24.1	661,962.1	0.00	1.00
09/15/2022 10:00	0	1.5	8.7	14.3	9.5	903,820.1	0.00	1.00
09/15/2022 11:00	0	1.9	9.0	14.1	17.1	1,039,352.8	0.00	1.00
09/15/2022 12:00	1	1.7	11.7	14.5	19.0	758,746.7	0.00	1.00
09/15/2022 13:00	1	1.7	14.4	14.7	22.0	663,287.3	0.00	1.00
09/15/2022 14:00	0	1.6	11.4	14.6	13.9	722,534.4	0.00	1.00
09/15/2022 15:00	1	1.7	13.0	14.7	19.9	675,877.2	0.00	1.00
09/15/2022 16:00	1	1.6	13.9	14.7	19.5	675,435.4	0.00	1.00
09/15/2022 17:00	0	1.5	9.8	14.5	10.0	785,279.3	0.00	1.00
09/15/2022 18:00	1	1.7	12.5	14.6	18.8	693,841.7	0.00	1.00
09/15/2022 19:00	1	1.6	11.5	14.5	16.2	722,585.3	0.00	1.00
09/15/2022 20:00	1	1.6	12.4	14.5	16.9	700,760.1	0.00	1.00
09/15/2022 21:00	1	1.6	12.3	14.5	18.3	714,668.4	0.00	1.00
09/15/2022 22:00	1	1.7	13.4	14.6	19.2	686,451.1	0.00	1.00
09/15/2022 23:00	1	1.7	14.0	14.6	21.7	672,322.2	0.00	1.00
Average/Sum#:	1	1.7	12.0	14.5	17.5	745,600.6	0.00 #	24.00 #
Minimum:	0	1.5	7.8	14.1	9.5	661,962.1	0.00	1.00
Maximum:	1	1.9	16.0	14.7	24.1	1,039,352.8	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT2 NH3Slip, Ppmvdc	Unit CT2 NOx, Ppm	Unit CT2 NOx, _SCR, Ppm	Unit CT2 O2, Dry, Pct	Unit CT2 NH3Inj, LbPerHr	Unit CT2 ExhaustFlow, LbPerHr	Unit CT2 SUSD, Hr	Unit CT2 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/16/2022 00:00	1	1.7	14.5	14.6	22.8	666,670.6	0.00	1.00
09/16/2022 01:00	1	1.7	16.9	14.7	26.4	653,348.0	0.00	1.00
09/16/2022 02:00	1	1.8	17.5	14.7	25.9	653,568.8	0.00	1.00
09/16/2022 03:00	1	1.7	17.0	14.7	24.9	656,440.2	0.00	1.00
09/16/2022 04:00	1	1.7	14.4	14.6	21.6	672,756.9	0.00	1.00
09/16/2022 05:00	0	1.6	10.7	14.4	12.3	788,156.4	0.00	1.00
09/16/2022 06:00	1	1.7	12.8	14.4	20.7	735,064.9	0.00	1.00
09/16/2022 07:00	2	1.7	17.6	14.7	29.0	653,348.0	0.00	1.00
09/16/2022 08:00	1	1.7	16.0	14.7	23.8	659,311.6	0.00	1.00
09/16/2022 09:00	1	1.7	16.3	14.7	24.7	650,697.5	0.00	1.00
09/16/2022 10:00	1	1.7	15.8	14.7	23.7	650,034.8	0.00	1.00
09/16/2022 11:00	1	1.7	15.2	14.8	22.1	663,385.1	0.00	1.00
09/16/2022 12:00	1	1.7	15.5	14.8	23.3	657,323.7	0.00	1.00
09/16/2022 13:00	1	1.7	15.1	14.8	22.3	658,446.2	0.00	1.00
09/16/2022 14:00	0	1.5	12.1	14.6	14.4	694,493.8	0.00	1.00
09/16/2022 15:00	1	1.6	14.3	14.7	22.8	657,986.3	0.00	1.00
09/16/2022 16:00	1	1.6	14.4	14.8	20.5	663,385.1	0.00	1.00
09/16/2022 17:00	1	1.6	12.5	14.7	17.2	673,447.6	0.00	1.00
09/16/2022 18:00	1	1.7	12.4	14.7	17.6	676,318.9	0.00	1.00
09/16/2022 19:00	1	1.7	12.6	14.7	18.1	676,318.9	0.00	1.00
09/16/2022 20:00	1	1.7	13.0	14.6	19.3	666,453.2	0.00	1.00
09/16/2022 21:00	1	1.7	13.4	14.6	19.8	666,453.2	0.00	1.00
09/16/2022 22:00	1	1.7	14.5	14.6	21.9	656,236.9	0.00	1.00
09/16/2022 23:00	1	1.7	13.8	14.6	20.5	666,887.9	0.00	1.00
Average/Sum#:	1	1.7	14.5	14.7	21.5	671,522.3	0.00 #	24.00 #
Minimum:	0	1.5	10.7	14.4	12.3	650,034.8	0.00	1.00
Maximum:	2	1.8	17.6	14.8	29.0	788,156.4	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT2 NH3Slip, Ppmvdc	Unit CT2 NOx, Ppm	Unit CT2 NOx, _SCR, Ppm	Unit CT2 O2, Dry, Pct	Unit CT2 NH3Inj, LbPerHr	Unit CT2 ExhaustFlow, LbPerHr	Unit CT2 SUSD, Hr	Unit CT2 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/17/2022 00:00	1	1.7	13.9	14.6	20.7	669,279.0	0.00	1.00
09/17/2022 01:00	1	1.7	14.0	14.6	21.1	671,235.3	0.00	1.00
09/17/2022 02:00	1	1.7	14.5	14.6	21.3	671,017.9	0.00	1.00
09/17/2022 03:00	1	1.7	14.4	14.6	21.5	671,235.3	0.00	1.00
09/17/2022 04:00	1	1.6	13.4	14.5	19.6	679,362.9	0.00	1.00
09/17/2022 05:00	1	1.7	14.4	14.6	21.8	671,670.1	0.00	1.00
09/17/2022 06:00	1	1.7	17.1	14.7	27.2	652,243.6	0.00	1.00
09/17/2022 07:00	1	1.7	16.6	14.7	25.2	652,464.5	0.00	1.00
09/17/2022 08:00	1	1.7	16.2	14.7	24.5	651,801.8	0.00	1.00
09/17/2022 09:00	1	1.7	15.8	14.7	24.0	650,918.3	0.00	1.00
09/17/2022 10:00	1	1.7	15.5	14.7	23.2	650,255.7	0.00	1.00
09/17/2022 11:00	1	1.7	15.2	14.7	22.7	649,814.0	0.00	1.00
09/17/2022 12:00	1	1.7	15.1	14.7	22.5	648,930.5	0.00	1.00
09/17/2022 13:00	1	1.7	15.3	14.8	22.9	656,425.7	0.00	1.00
09/17/2022 14:00	1	1.7	15.2	14.8	22.6	656,650.2	0.00	1.00
09/17/2022 15:00	1	1.7	15.5	14.8	23.5	656,201.2	0.00	1.00
09/17/2022 16:00	1	1.6	14.0	14.7	18.3	680,073.8	0.00	1.00
09/17/2022 17:00	1	1.6	11.2	14.5	14.0	714,882.3	0.00	1.00
09/17/2022 18:00	1	1.7	13.5	14.6	21.2	669,061.6	0.00	1.00
09/17/2022 19:00	1	1.7	15.6	14.7	24.6	656,440.2	0.00	1.00
09/17/2022 20:00	1	1.7	15.3	14.7	22.2	663,066.5	0.00	1.00
09/17/2022 21:00	1	1.6	12.0	14.4	16.2	689,347.2	0.00	1.00
09/17/2022 22:00	1	1.6	12.6	14.5	18.4	695,838.8	0.00	1.00
09/17/2022 23:00	1	1.7	13.9	14.6	20.8	670,148.5	0.00	1.00
Average/Sum#:	1	1.7	14.6	14.6	21.7	666,598.5	0.00 #	24.00 #
Minimum:	1	1.6	11.2	14.4	14.0	648,930.5	0.00	1.00
Maximum:	1	1.7	17.1	14.8	27.2	714,882.3	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
 Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:	> 10							
	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2
	NH3Slip, Ppmvdc	NOx, Ppm	NOx, _SCR, Ppm	O2, Dry, Pct	NH3Inj, LbPerHr	ExhaustFlow, LbPerHr	SUSD, Hr	OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/18/2022 00:00	1	1.7	13.8	14.6	20.6	669,496.4	0.00	1.00
09/18/2022 01:00	1	1.7	13.7	14.6	20.3	670,583.2	0.00	1.00
09/18/2022 02:00	1	1.7	13.8	14.6	20.3	671,452.7	0.00	1.00
09/18/2022 03:00	1	1.7	13.8	14.6	19.9	671,235.3	0.00	1.00
09/18/2022 04:00	1	1.7	15.1	14.7	23.6	665,937.8	0.00	1.00
09/18/2022 05:00	1	1.7	16.1	14.7	24.2	652,685.3	0.00	1.00
09/18/2022 06:00	1	1.7	13.7	14.6	18.5	672,974.3	0.00	1.00
09/18/2022 07:00	1	1.7	13.4	14.6	19.0	678,191.1	0.00	1.00
09/18/2022 08:00	1	1.8	13.7	14.6	21.0	668,409.5	0.00	1.00
09/18/2022 09:00	1	1.8	13.4	14.6	19.5	666,887.9	0.00	1.00
09/18/2022 10:00	1	1.7	14.1	14.7	20.3	669,692.7	0.00	1.00
09/18/2022 11:00	1	1.7	12.4	14.6	16.1	691,885.4	0.00	1.00
09/18/2022 12:00	0	1.6	11.2	14.5	13.3	750,829.7	0.00	1.00
09/18/2022 13:00	0	1.6	9.3	14.4	11.3	827,132.3	0.00	1.00
09/18/2022 14:00	1	1.7	10.8	14.4	14.4	706,201.6	0.00	1.00
09/18/2022 15:00	1	1.7	12.0	14.5	18.0	687,493.8	0.00	1.00
09/18/2022 16:00	0	1.6	10.8	14.5	13.3	824,650.2	0.00	1.00
09/18/2022 17:00	0	1.8	7.5	14.4	10.4	930,155.2	0.00	1.00
09/18/2022 18:00	0	1.8	7.6	14.3	11.4	894,068.1	0.00	1.00
09/18/2022 19:00	0	1.8	7.6	14.4	12.5	944,060.1	0.00	1.00
09/18/2022 20:00	0	1.8	7.6	14.4	13.1	967,024.3	0.00	1.00
09/18/2022 21:00	1	1.8	8.9	14.4	18.3	944,060.1	0.00	1.00
09/18/2022 22:00	1	1.7	14.3	14.6	20.8	656,889.0	0.00	1.00
09/18/2022 23:00	1	1.8	13.1	14.6	18.4	669,713.7	0.00	1.00
Average/Sum#:	1	1.7	12.0	14.5	17.4	743,821.2	0.00 #	24.00 #
Minimum:	0	1.6	7.5	14.3	10.4	652,685.3	0.00	1.00
Maximum:	1	1.8	16.1	14.7	24.2	967,024.3	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT2 NH3Slip, Ppmvdc	Unit CT2 NOx, Ppm	Unit CT2 NOx, _SCR, Ppm	Unit CT2 O2, Dry, Pct	Unit CT2 NH3Inj, LbPerHr	Unit CT2 ExhaustFlow, LbPerHr	Unit CT2 SUSD, Hr	Unit CT2 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/19/2022 00:00	1	1.8	12.7	14.6	18.5	672,539.5	0.00	1.00
09/19/2022 01:00	1	1.8	12.7	14.6	18.7	673,409.0	0.00	1.00
09/19/2022 02:00	1	1.7	13.0	14.6	19.3	673,409.0	0.00	1.00
09/19/2022 03:00	1	1.6	13.0	14.6	19.5	672,974.3	0.00	1.00
09/19/2022 04:00	0	1.6	9.8	14.4	9.8	779,307.8	0.00	1.00
09/19/2022 05:00	0	1.8	7.3	14.4	11.6	962,600.0	0.00	1.00
09/19/2022 06:00	0	1.8	7.5	14.3	10.7	889,088.4	0.00	1.00
09/19/2022 07:00	0	1.8	7.5	14.4	12.2	962,389.3	0.00	1.00
09/19/2022 08:00	0	1.8	8.0	14.4	15.4	1,036,127.6	0.00	1.00
09/19/2022 09:00	1	1.8	10.1	14.4	16.4	785,417.6	0.00	1.00
09/19/2022 10:00	1	1.7	12.6	14.6	18.2	670,365.8	0.00	1.00
09/19/2022 11:00	0	1.7	10.7	14.4	12.2	709,783.2	0.00	1.00
09/19/2022 12:00	1	1.7	11.1	14.4	15.7	679,023.8	0.00	1.00
09/19/2022 13:00	1	1.8	10.7	14.4	14.4	692,718.1	0.00	1.00
09/19/2022 14:00	1	1.7	11.3	14.5	16.1	683,642.3	0.00	1.00
09/19/2022 15:00	1	1.8	12.2	14.6	16.7	670,800.6	0.00	1.00
09/19/2022 16:00	0	1.7	8.8	14.4	11.3	904,873.5	0.00	1.00
09/19/2022 17:00	1	2.3	11.5	12.7	24.3	1,036,086.4	0.00	1.00
09/19/2022 18:00	1	2.1	11.0	13.1	21.9	1,032,335.3	0.00	1.00
09/19/2022 19:00	1	2.0	10.6	13.4	20.9	1,034,006.7	0.00	1.00
09/19/2022 20:00	1	2.0	10.1	13.6	20.1	1,035,885.1	0.00	1.00
09/19/2022 21:00	1	1.9	9.4	13.9	18.6	1,041,153.8	0.00	1.00
09/19/2022 22:00	1	1.7	9.2	14.3	16.0	891,578.3	0.00	1.00
09/19/2022 23:00	0	1.7	7.3	14.3	10.0	887,428.5	0.00	1.00
Average/Sum#:	1	1.8	10.3	14.2	16.2	836,539.3	0.00 #	24.00 #
Minimum:	0	1.6	7.3	12.7	9.8	670,365.8	0.00	1.00
Maximum:	1	2.3	13.0	14.6	24.3	1,041,153.8	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT2 NH3Slip, Ppmvdc	Unit CT2 NOx, Ppm	Unit CT2 NOx, _SCR, Ppm	Unit CT2 O2, Dry, Pct	Unit CT2 NH3Inj, LbPerHr	Unit CT2 ExhaustFlow, LbPerHr	Unit CT2 SUSD, Hr	Unit CT2 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/20/2022 00:00	0	1.8	7.6	14.3	11.9	859,002.6	0.00	1.00
09/20/2022 01:00	1	1.7	9.8	14.4	16.4	737,382.4	0.00	1.00
09/20/2022 02:00	0	1.8	12.0	14.5	15.5	700,974.1	0.00	1.00
09/20/2022 03:00	0	1.8	7.7	14.4	7.9	959,650.5	0.00	1.00
09/20/2022 04:00	0	1.8	8.2	14.4	15.7	1,045,608.2	0.00	1.00
09/20/2022 05:00	0	1.8	7.9	14.4	14.7	1,033,388.7	0.00	1.00
09/20/2022 06:00	1	1.8	10.0	14.3	16.9	786,381.6	0.00	1.00
09/20/2022 07:00	1	1.7	13.3	14.5	19.8	674,013.6	0.00	1.00
09/20/2022 08:00	1	1.7	12.9	14.5	17.4	683,642.3	0.00	1.00
09/20/2022 09:00	1	1.8	12.6	14.5	18.5	671,659.9	0.00	1.00
09/20/2022 10:00	1	1.7	15.6	14.7	23.9	652,685.3	0.00	1.00
09/20/2022 11:00	0	1.6	10.3	14.5	9.5	783,567.5	0.00	1.00
09/20/2022 12:00	1	1.8	11.9	14.5	17.4	680,860.7	0.00	1.00
09/20/2022 13:00	1	1.8	12.0	14.6	17.6	679,712.7	0.00	1.00
09/20/2022 14:00	1	1.8	12.1	14.6	17.1	672,539.5	0.00	1.00
09/20/2022 15:00	1	1.7	13.2	14.6	19.2	659,497.4	0.00	1.00
09/20/2022 16:00	0	1.7	9.6	14.3	11.0	856,927.7	0.00	1.00
09/20/2022 17:00	1	2.2	11.5	12.9	23.6	1,032,546.0	0.00	1.00
09/20/2022 18:00	1	2.2	12.1	12.8	25.0	1,026,561.1	0.00	1.00
09/20/2022 19:00	1	2.1	11.2	13.2	22.4	1,026,179.1	0.00	1.00
09/20/2022 20:00	1	2.1	11.4	13.1	23.6	1,031,808.6	0.00	1.00
09/20/2022 21:00	1	2.1	11.2	13.1	22.8	1,024,083.6	0.00	1.00
09/20/2022 22:00	1	2.0	10.1	13.6	19.9	1,021,815.7	0.00	1.00
09/20/2022 23:00	0	1.7	7.9	14.5	14.5	1,021,932.9	0.00	1.00
Average/Sum#:	1	1.8	10.9	14.1	17.6	846,767.6	0.00 #	24.00 #
Minimum:	0	1.6	7.6	12.8	7.9	652,685.3	0.00	1.00
Maximum:	1	2.2	15.6	14.7	25.0	1,045,608.2	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT2 NH3Slip, Ppmvdc	Unit CT2 NOx, Ppm	Unit CT2 NOx, _SCR, Ppm	Unit CT2 O2, Dry, Pct	Unit CT2 NH3Inj, LbPerHr	Unit CT2 ExhaustFlow, LbPerHr	Unit CT2 SUSD, Hr	Unit CT2 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/21/2022 00:00	0	1.8	8.0	14.4	15.1	997,151.6	0.00	1.00
09/21/2022 01:00	1	1.8	7.9	14.3	13.7	878,299.0	0.00	1.00
09/21/2022 02:00	0	1.7	8.4	14.4	8.4	902,134.6	0.00	1.00
09/21/2022 03:00	0	1.8	8.6	14.4	17.2	1,047,504.3	0.00	1.00
09/21/2022 04:00	0	1.8	8.6	14.4	16.7	1,048,768.4	0.00	1.00
09/21/2022 05:00	0	1.8	8.3	14.4	16.0	1,037,391.6	0.00	1.00
09/21/2022 06:00	1	1.7	9.8	14.4	16.2	863,158.7	0.00	1.00
09/21/2022 07:00	0	1.7	7.8	14.4	13.4	1,020,958.5	0.00	1.00
09/21/2022 08:00	0	1.8	7.6	14.4	13.6	992,095.3	0.00	1.00
09/21/2022 09:00	0	1.8	7.6	14.4	13.5	964,917.5	0.00	1.00
09/21/2022 10:00	1	1.6	10.0	14.3	13.9	745,091.4	0.00	1.00
09/21/2022 11:00	0	1.7	7.4	14.3	10.5	912,534.6	0.00	1.00
09/21/2022 12:00	1	1.6	12.7	14.5	20.2	674,227.5	0.00	1.00
09/21/2022 13:00	1	1.6	13.9	14.6	20.3	671,017.9	0.00	1.00
09/21/2022 14:00	0	1.5	7.8	14.4	6.9	885,912.2	0.00	1.00
09/21/2022 15:00	1	1.7	13.6	14.6	21.9	665,149.0	0.00	1.00
09/21/2022 16:00	0	1.6	11.5	14.6	13.9	806,004.1	0.00	1.00
09/21/2022 17:00	0	1.8	7.4	14.4	11.0	933,315.4	0.00	1.00
09/21/2022 18:00	0	1.7	8.6	14.5	13.9	867,872.7	0.00	1.00
09/21/2022 19:00	1	1.7	10.1	14.4	16.0	775,726.2	0.00	1.00
09/21/2022 20:00	1	1.7	10.9	14.4	15.3	735,064.9	0.00	1.00
09/21/2022 21:00	1	1.7	13.7	14.6	20.7	669,931.1	0.00	1.00
09/21/2022 22:00	1	1.7	15.2	14.6	24.3	657,975.8	0.00	1.00
09/21/2022 23:00	1	1.7	13.7	14.6	19.8	673,843.7	0.00	1.00
Average/Sum#:	0	1.7	10.0	14.4	15.5	851,085.3	0.00 #	24.00 #
Minimum:	0	1.5	7.4	14.3	6.9	657,975.8	0.00	1.00
Maximum:	1	1.8	15.2	14.6	24.3	1,048,768.4	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT2 NH3Slip, Ppmvdc	Unit CT2 NOx, Ppm	Unit CT2 NOx, _SCR, Ppm	Unit CT2 O2, Dry, Pct	Unit CT2 NH3Inj, LbPerHr	Unit CT2 ExhaustFlow, LbPerHr	Unit CT2 SUSD, Hr	Unit CT2 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/22/2022 00:00	1	1.7	13.9	14.6	21.2	675,365.3	0.00	1.00
09/22/2022 01:00	1	1.7	13.9	14.5	21.2	665,668.6	0.00	1.00
09/22/2022 02:00	1	1.7	14.4	14.5	21.5	665,026.7	0.00	1.00
09/22/2022 03:00	1	1.7	14.6	14.5	22.2	664,598.8	0.00	1.00
09/22/2022 04:00	0	1.6	11.7	14.4	13.6	738,857.1	0.00	1.00
09/22/2022 05:00	0	1.7	9.2	14.3	10.5	807,130.4	0.00	1.00
09/22/2022 06:00	1	1.6	11.8	14.4	16.5	757,186.3	0.00	1.00
09/22/2022 07:00	0	1.9	7.9	14.2	8.8	827,377.6	0.00	1.00
09/22/2022 08:00	0	1.9	7.8	14.2	11.3	817,975.6	0.00	1.00
09/22/2022 09:00	0	1.9	7.8	14.2	11.3	817,158.0	0.00	1.00
09/22/2022 10:00	0	0.0	0.0	0.0	11.4	261,108.0	0.00	1.00
09/22/2022 11:00	0	1.8	8.0	14.4	11.6	836,613.0	0.00	1.00
09/22/2022 12:00	0	1.8	7.9	14.4	11.6	835,770.2	0.00	1.00
09/22/2022 13:00	1	1.7	10.7	14.5	18.2	772,654.9	0.00	1.00
09/22/2022 14:00	1	1.7	14.2	14.8	20.7	670,120.0	0.00	1.00
09/22/2022 15:00	1	1.7	14.3	14.8	20.8	666,303.5	0.00	1.00
09/22/2022 16:00	0	1.6	11.8	14.6	13.3	724,056.0	0.00	1.00
09/22/2022 17:00	1	1.7	12.1	14.6	18.2	674,061.1	0.00	1.00
09/22/2022 18:00	1	1.7	12.2	14.6	16.8	677,539.0	0.00	1.00
09/22/2022 19:00	0	1.5	10.3	14.4	13.1	730,008.5	0.00	1.00
09/22/2022 20:00	0	1.6	9.5	14.4	11.8	797,215.7	0.00	1.00
09/22/2022 21:00	1	1.6	9.0	14.4	11.7	829,028.5	0.00	1.00
09/22/2022 22:00	0	2.5	10.0	14.4	10.3	914,986.2	0.17	1.00
09/22/2022 23:00	0	21.8	30.3	17.2	0.0	420,820.4	0.05	0.05
Average/Sum#:	1	2.6	11.9	14.6	14.5	738,500.9	0.22 #	23.05 #
Minimum:	0	1.5	7.8	14.2	0.0	420,820.4	0.00	0.05
Maximum:	1	21.8	30.3	17.2	22.2	914,986.2	0.17	1.00
%SI	8.33	4.17	4.17	4.17	0.00	4.17	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT2 NH3Slip, Ppmvdc	Unit CT2 NOx, Ppm	Unit CT2 NOx, _SCR, Ppm	Unit CT2 O2, Dry, Pct	Unit CT2 NH3Inj, LbPerHr	Unit CT2 ExhaustFlow, LbPerHr	Unit CT2 SUSD, Hr	Unit CT2 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/23/2022 00:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
09/23/2022 01:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
09/23/2022 02:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
09/23/2022 03:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
09/23/2022 04:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
09/23/2022 05:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
09/23/2022 06:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
09/23/2022 07:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
09/23/2022 08:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
09/23/2022 09:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
09/23/2022 10:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
09/23/2022 11:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
09/23/2022 12:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
09/23/2022 13:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
09/23/2022 14:00	0	0.0	0.0	0.0	0.0	0.0	0.00	0.00
09/23/2022 15:00	0	21.0	24.9	18.2	0.0	723,259.0	0.25	0.25
09/23/2022 16:00	1	5.3	9.4	14.4	6.0	865,054.8	0.88	1.00
09/23/2022 17:00	0	2.0	9.6	13.7	18.6	1,009,570.1	0.00	1.00
09/23/2022 18:00	0	1.9	9.3	13.9	15.4	1,026,872.7	0.00	1.00
09/23/2022 19:00	0	1.9	9.1	13.9	17.0	1,022,764.4	0.00	1.00
09/23/2022 20:00	1	2.0	9.9	13.7	18.9	1,020,791.8	0.00	1.00
09/23/2022 21:00	1	2.0	10.4	13.5	20.0	1,011,153.4	0.00	1.00
09/23/2022 22:00	0	1.7	8.7	14.3	14.7	900,500.3	0.00	1.00
09/23/2022 23:00	0	1.8	7.5	14.3	10.9	896,350.5	0.00	1.00
Average/Sum#:	0	4.4	11.0	14.4	13.5	941,813.0	1.13 #	8.25 #
Minimum:	0	1.7	7.5	13.5	0.0	723,259.0	0.00	0.00
Maximum:	1	21.0	24.9	18.2	20.0	1,026,872.7	0.88	1.00
%SI	66.67	62.50	62.50	62.50	62.50	62.50	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT2 NH3Slip, Ppmvdc	Unit CT2 NOx, Ppm	Unit CT2 NOx, _SCR, Ppm	Unit CT2 O2, Dry, Pct	Unit CT2 NH3Inj, LbPerHr	Unit CT2 ExhaustFlow, LbPerHr	Unit CT2 SUSD, Hr	Unit CT2 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/24/2022 00:00	1	1.8	9.9	14.4	16.4	776,147.6	0.00	1.00
09/24/2022 01:00	0	1.6	11.1	14.4	14.2	730,008.5	0.00	1.00
09/24/2022 02:00	0	1.8	8.1	14.3	6.7	837,631.2	0.00	1.00
09/24/2022 03:00	0	1.8	7.7	14.3	12.4	898,425.4	0.00	1.00
09/24/2022 04:00	0	1.8	7.9	14.4	13.9	961,968.0	0.00	1.00
09/24/2022 05:00	0	1.7	8.1	14.4	13.1	911,615.3	0.00	1.00
09/24/2022 06:00	2	1.7	16.0	14.6	27.9	689,494.3	0.00	1.00
09/24/2022 07:00	1	1.7	17.0	14.6	25.4	643,846.8	0.00	1.00
09/24/2022 08:00	1	1.7	15.8	14.7	23.6	653,127.1	0.00	1.00
09/24/2022 09:00	1	1.7	15.3	14.7	22.5	652,022.7	0.00	1.00
09/24/2022 10:00	1	1.7	14.5	14.8	21.1	661,813.6	0.00	1.00
09/24/2022 11:00	1	1.7	14.3	14.8	21.0	660,466.6	0.00	1.00
09/24/2022 12:00	1	1.6	13.1	14.7	18.0	665,275.2	0.00	1.00
09/24/2022 13:00	0	1.6	11.3	14.7	14.9	682,945.2	0.00	1.00
09/24/2022 14:00	0	1.6	9.0	14.5	12.1	874,505.9	0.00	1.00
09/24/2022 15:00	0	1.7	7.6	14.5	11.5	924,575.4	0.00	1.00
09/24/2022 16:00	0	1.7	7.8	14.3	12.1	911,082.2	0.00	1.00
09/24/2022 17:00	0	1.7	7.5	14.5	12.3	981,706.1	0.00	1.00
09/24/2022 18:00	0	1.7	7.4	14.4	10.7	893,918.1	0.00	1.00
09/24/2022 19:00	0	1.8	6.9	14.4	11.4	942,374.7	0.00	1.00
09/24/2022 20:00	0	1.8	7.8	14.5	14.0	1,025,356.5	0.00	1.00
09/24/2022 21:00	0	1.8	7.9	14.4	14.3	1,018,851.7	0.00	1.00
09/24/2022 22:00	0	1.8	7.5	14.4	13.6	987,249.6	0.00	1.00
09/24/2022 23:00	0	1.8	7.4	14.4	12.1	919,621.1	0.00	1.00
Average/Sum#:	0	1.7	10.3	14.5	15.6	829,334.5	0.00 #	24.00 #
Minimum:	0	1.6	6.9	14.3	6.7	643,846.8	0.00	1.00
Maximum:	2	1.8	17.0	14.8	27.9	1,025,356.5	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT2 NH3Slip, Ppmvdc	Unit CT2 NOx, Ppm	Unit CT2 NOx, _SCR, Ppm	Unit CT2 O2, Dry, Pct	Unit CT2 NH3Inj, LbPerHr	Unit CT2 ExhaustFlow, LbPerHr	Unit CT2 SUSD, Hr	Unit CT2 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/25/2022 00:00	1	1.7	8.8	14.4	14.4	843,986.8	0.00	1.00
09/25/2022 01:00	1	1.6	10.2	14.4	14.3	767,509.7	0.00	1.00
09/25/2022 02:00	0	1.8	7.8	14.4	8.3	923,834.8	0.00	1.00
09/25/2022 03:00	1	1.6	10.4	14.5	17.5	788,488.9	0.00	1.00
09/25/2022 04:00	1	1.6	13.0	14.5	18.7	682,786.4	0.00	1.00
09/25/2022 05:00	1	1.6	12.6	14.5	19.0	701,830.0	0.00	1.00
09/25/2022 06:00	1	1.7	16.6	14.7	26.3	657,986.3	0.00	1.00
09/25/2022 07:00	1	1.7	16.2	14.7	24.7	652,022.7	0.00	1.00
09/25/2022 08:00	1	1.7	15.7	14.7	23.3	651,581.0	0.00	1.00
09/25/2022 09:00	1	1.7	14.9	14.7	21.8	650,697.5	0.00	1.00
09/25/2022 10:00	1	1.7	14.4	14.8	20.9	660,691.1	0.00	1.00
09/25/2022 11:00	1	1.7	13.9	14.8	19.8	660,017.7	0.00	1.00
09/25/2022 12:00	1	1.6	13.4	14.8	19.0	657,997.2	0.00	1.00
09/25/2022 13:00	0	1.6	11.5	14.8	15.2	676,405.8	0.00	1.00
09/25/2022 14:00	0	1.5	9.9	14.6	12.5	698,189.1	0.00	1.00
09/25/2022 15:00	1	1.5	9.9	14.6	13.2	742,967.1	0.00	1.00
09/25/2022 16:00	0	1.6	8.1	14.5	11.3	906,601.7	0.00	1.00
09/25/2022 17:00	0	1.7	7.2	14.5	10.7	971,863.4	0.00	1.00
09/25/2022 18:00	0	1.8	6.9	14.5	10.8	953,247.8	0.00	1.00
09/25/2022 19:00	0	1.7	7.2	14.4	10.8	909,719.2	0.00	1.00
09/25/2022 20:00	0	1.7	7.4	14.4	11.7	916,671.6	0.00	1.00
09/25/2022 21:00	1	1.7	9.0	14.5	14.1	856,104.2	0.00	1.00
09/25/2022 22:00	1	1.7	12.5	14.6	18.1	665,583.7	0.00	1.00
09/25/2022 23:00	1	1.7	12.2	14.6	17.6	674,713.2	0.00	1.00
Average/Sum#:	1	1.7	11.2	14.6	16.4	761,312.4	0.00 #	24.00 #
Minimum:	0	1.5	6.9	14.4	8.3	650,697.5	0.00	1.00
Maximum:	1	1.8	16.6	14.8	26.3	971,863.4	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag: > 10								
	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2
	NH3Slip, Ppmvdc	NOx, Ppm	NOx, _SCR, Ppm	O2, Dry, Pct	NH3Inj, LbPerHr	ExhaustFlow, LbPerHr	SUSD, Hr	OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/26/2022 00:00	1	1.7	11.8	14.5	16.6	679,362.9	0.00	1.00
09/26/2022 01:00	1	1.7	12.8	14.6	18.7	672,104.8	0.00	1.00
09/26/2022 02:00	1	1.9	13.3	14.6	18.4	671,887.4	0.00	1.00
09/26/2022 03:00	1	1.7	13.4	14.6	19.5	672,104.8	0.00	1.00
09/26/2022 04:00	0	1.6	9.9	14.4	11.1	790,473.9	0.00	1.00
09/26/2022 05:00	0	1.6	9.9	14.4	11.9	775,515.6	0.00	1.00
09/26/2022 06:00	1	1.7	14.5	14.6	24.7	670,365.8	0.00	1.00
09/26/2022 07:00	1	1.7	16.3	14.7	24.5	649,814.0	0.00	1.00
09/26/2022 08:00	1	1.7	15.8	14.7	23.8	649,151.3	0.00	1.00
09/26/2022 09:00	1	1.7	15.2	14.7	22.5	648,488.7	0.00	1.00
09/26/2022 10:00	1	1.7	14.7	14.8	21.3	657,323.7	0.00	1.00
09/26/2022 11:00	1	1.7	14.1	14.8	19.9	657,548.2	0.00	1.00
09/26/2022 12:00	0	1.6	11.8	14.7	15.0	664,833.5	0.00	1.00
09/26/2022 13:00	0	1.7	10.5	14.7	13.8	674,331.1	0.00	1.00
09/26/2022 14:00	0	1.6	9.5	14.6	11.8	716,230.7	0.00	1.00
09/26/2022 15:00	1	1.4	9.0	14.6	10.6	794,483.5	0.00	1.00
09/26/2022 16:00	0	1.5	8.2	14.4	10.5	801,007.9	0.00	1.00
09/26/2022 17:00	0	1.5	8.2	14.4	10.1	812,806.0	0.00	1.00
09/26/2022 18:00	1	1.9	11.2	14.7	14.9	675,656.3	0.00	1.00
09/26/2022 19:00	1	1.7	11.8	14.7	17.0	674,551.9	0.00	1.00
09/26/2022 20:00	1	1.7	12.0	14.7	17.1	682,945.2	0.00	1.00
09/26/2022 21:00	0	1.6	10.0	14.5	12.5	764,951.9	0.00	1.00
09/26/2022 22:00	0	1.6	10.4	14.5	13.3	808,816.3	0.00	1.00
09/26/2022 23:00	0	2.0	9.4	13.8	17.7	1,045,198.7	0.00	1.00
Average/Sum#:	1	1.7	11.8	14.6	16.6	721,248.1	0.00 #	24.00 #
Minimum:	0	1.4	8.2	13.8	10.1	648,488.7	0.00	1.00
Maximum:	1	2.0	16.3	14.8	24.7	1,045,198.7	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:	> 10							
	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2
	NH3Slip, Ppmvdc	NOx, Ppm	NOx, _SCR, Ppm	O2, Dry, Pct	NH3Inj, LbPerHr	ExhaustFlow, LbPerHr	SUSD, Hr	OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/27/2022 00:00	1	2.0	9.8	13.6	19.5	1,042,450.9	0.00	1.00
09/27/2022 01:00	1	1.9	9.6	13.8	19.5	1,049,634.9	0.00	1.00
09/27/2022 02:00	1	1.8	9.8	13.8	19.9	1,046,548.8	0.00	1.00
09/27/2022 03:00	1	1.9	9.5	13.9	18.5	1,041,349.4	0.00	1.00
09/27/2022 04:00	1	2.0	10.1	13.6	20.8	1,057,270.7	0.00	1.00
09/27/2022 05:00	1	2.1	10.8	13.4	23.0	1,061,030.0	0.00	1.00
09/27/2022 06:00	1	1.9	9.4	14.0	19.5	1,051,876.7	0.00	1.00
09/27/2022 07:00	1	1.8	9.4	14.3	20.5	945,732.8	0.00	1.00
09/27/2022 08:00	1	1.7	17.5	14.7	26.9	649,372.2	0.00	1.00
09/27/2022 09:00	1	1.7	16.5	14.7	25.8	649,372.2	0.00	1.00
09/27/2022 10:00	1	1.6	15.5	14.7	22.6	654,673.2	0.00	1.00
09/27/2022 11:00	0	1.6	9.1	14.4	9.8	896,235.6	0.00	1.00
09/27/2022 12:00	1	2.0	9.7	13.6	17.8	1,036,635.5	0.00	1.00
09/27/2022 13:00	0	1.9	8.8	14.0	16.4	1,032,823.8	0.00	1.00
09/27/2022 14:00	0	1.9	8.8	13.9	16.8	1,018,656.1	0.00	1.00
09/27/2022 15:00	0	1.8	8.5	14.1	15.6	1,002,700.6	0.00	1.00
09/27/2022 16:00	1	1.6	13.2	14.6	21.1	694,493.8	0.00	1.00
09/27/2022 17:00	0	1.8	11.7	14.6	12.9	771,225.0	0.00	1.00
09/27/2022 18:00	0	1.9	9.0	14.0	17.3	1,031,236.1	0.00	1.00
09/27/2022 19:00	1	1.9	9.1	14.0	18.0	1,031,434.6	0.00	1.00
09/27/2022 20:00	1	1.9	9.1	14.1	18.2	1,044,991.6	0.00	1.00
09/27/2022 21:00	1	1.9	9.3	14.0	18.6	1,046,319.6	0.00	1.00
09/27/2022 22:00	1	1.9	9.0	14.1	18.3	1,049,220.7	0.00	1.00
09/27/2022 23:00	0	1.8	7.6	14.4	13.7	976,926.3	0.00	1.00
Average/Sum#:	1	1.8	10.5	14.1	18.8	953,425.5	0.00 #	24.00 #
Minimum:	0	1.6	7.6	13.4	9.8	649,372.2	0.00	1.00
Maximum:	1	2.1	17.5	14.7	26.9	1,061,030.0	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT2 NH3Slip, Ppmvdc	Unit CT2 NOx, Ppm	Unit CT2 NOx, _SCR, Ppm	Unit CT2 O2, Dry, Pct	Unit CT2 NH3Inj, LbPerHr	Unit CT2 ExhaustFlow, LbPerHr	Unit CT2 SUSD, Hr	Unit CT2 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/28/2022 00:00	0	1.8	7.5	14.4	13.5	958,597.1	0.00	1.00
09/28/2022 01:00	0	1.8	7.4	14.4	13.3	955,647.5	0.00	1.00
09/28/2022 02:00	0	1.7	7.9	14.4	14.1	957,754.3	0.00	1.00
09/28/2022 03:00	0	1.8	7.9	14.4	13.8	966,392.3	0.00	1.00
09/28/2022 04:00	0	1.8	7.8	14.4	14.3	975,030.2	0.00	1.00
09/28/2022 05:00	0	1.8	7.8	14.4	14.5	977,769.0	0.00	1.00
09/28/2022 06:00	1	1.7	9.0	14.4	16.8	941,321.3	0.00	1.00
09/28/2022 07:00	2	1.7	16.5	14.7	27.4	659,311.6	0.00	1.00
09/28/2022 08:00	1	1.7	16.8	14.7	26.0	650,918.3	0.00	1.00
09/28/2022 09:00	1	1.7	16.3	14.7	24.9	650,255.7	0.00	1.00
09/28/2022 10:00	1	1.7	15.2	14.8	22.8	666,079.0	0.00	1.00
09/28/2022 11:00	0	1.6	12.8	14.7	17.1	675,877.2	0.00	1.00
09/28/2022 12:00	1	1.6	12.4	14.7	17.6	674,110.2	0.00	1.00
09/28/2022 13:00	1	1.6	12.4	14.8	17.2	683,589.7	0.00	1.00
09/28/2022 14:00	0	1.5	10.5	14.6	13.1	765,573.4	0.00	1.00
09/28/2022 15:00	1	1.3	13.2	14.8	20.2	678,201.8	0.00	1.00
09/28/2022 16:00	1	1.6	14.9	14.9	21.9	671,930.9	0.00	1.00
09/28/2022 17:00	1	1.6	15.4	14.9	23.7	671,017.9	0.00	1.00
09/28/2022 18:00	1	1.6	13.2	14.7	18.9	670,134.4	0.00	1.00
09/28/2022 19:00	1	1.6	13.7	14.7	19.1	664,391.7	0.00	1.00
09/28/2022 20:00	1	1.7	12.4	14.7	17.3	681,399.1	0.00	1.00
09/28/2022 21:00	0	1.6	8.9	14.4	9.2	794,476.8	0.00	1.00
09/28/2022 22:00	0	1.6	8.3	14.4	9.8	845,882.9	0.00	1.00
09/28/2022 23:00	0	1.7	7.7	14.4	12.2	913,511.4	0.00	1.00
Average/Sum#:	1	1.7	11.5	14.6	17.4	781,215.6	0.00 #	24.00 #
Minimum:	0	1.3	7.4	14.4	9.2	650,255.7	0.00	1.00
Maximum:	2	1.8	16.8	14.9	27.4	977,769.0	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:	> 10							
	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2	Unit CT2
	NH3Slip, Ppmvdc	NOx, Ppm	NOx, _SCR, Ppm	O2, Dry, Pct	NH3Inj, LbPerHr	ExhaustFlow, LbPerHr	SUSD, Hr	OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/29/2022 00:00	1	1.5	8.8	14.4	12.8	834,295.5	0.00	1.00
09/29/2022 01:00	1	1.6	11.8	14.5	16.2	713,812.5	0.00	1.00
09/29/2022 02:00	1	2.3	12.7	14.5	16.3	697,764.5	0.00	1.00
09/29/2022 03:00	0	1.7	11.1	14.3	14.0	722,060.1	0.00	1.00
09/29/2022 04:00	0	1.6	9.7	14.4	12.5	831,978.0	0.00	1.00
09/29/2022 05:00	0	1.6	8.5	14.4	12.3	918,778.4	0.00	1.00
09/29/2022 06:00	1	1.7	10.6	14.4	19.1	848,200.4	0.00	1.00
09/29/2022 07:00	0	1.6	7.8	14.3	8.4	874,356.7	0.00	1.00
09/29/2022 08:00	1	1.7	13.4	14.6	22.6	699,058.5	0.00	1.00
09/29/2022 09:00	1	1.7	14.4	14.7	22.4	671,459.7	0.00	1.00
09/29/2022 10:00	1	1.7	15.7	14.8	23.7	662,038.1	0.00	1.00
09/29/2022 11:00	1	1.6	14.4	14.8	20.5	669,446.5	0.00	1.00
09/29/2022 12:00	1	1.6	13.4	14.8	19.0	675,732.4	0.00	1.00
09/29/2022 13:00	0	1.5	10.7	14.6	13.8	709,927.0	0.00	1.00
09/29/2022 14:00	0	1.7	11.1	14.7	15.0	680,073.8	0.00	1.00
09/29/2022 15:00	1	1.5	11.9	14.7	16.3	690,454.9	0.00	1.00
09/29/2022 16:00	1	1.4	9.2	14.3	15.4	859,210.1	0.00	1.00
09/29/2022 17:00	0	1.7	9.0	13.9	12.6	1,026,090.1	0.00	1.00
09/29/2022 18:00	1	1.9	8.9	13.9	16.8	1,025,307.6	0.00	1.00
09/29/2022 19:00	1	1.9	8.8	14.0	17.5	1,036,396.3	0.00	1.00
09/29/2022 20:00	1	1.8	9.0	14.2	18.0	931,208.6	0.00	1.00
09/29/2022 21:00	1	1.7	12.4	14.6	17.3	685,364.3	0.00	1.00
09/29/2022 22:00	1	1.6	11.8	14.5	16.9	688,135.8	0.00	1.00
09/29/2022 23:00	0	1.7	7.2	14.4	9.2	929,944.5	0.00	1.00
Average/Sum#:	1	1.7	10.9	14.4	16.2	795,045.6	0.00 #	24.00 #
Minimum:	0	1.4	7.2	13.9	8.4	662,038.1	0.00	1.00
Maximum:	1	2.3	15.7	14.8	23.7	1,036,396.3	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

NH3 Slip Daily Summary

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:24 Location: Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Const. Value/Limit Tag:

> 10

	Unit CT2 NH3Slip, Ppmvdc	Unit CT2 NOX, Ppm	Unit CT2 NOX, _SCR, Ppm	Unit CT2 O2, Dry, Pct	Unit CT2 NH3Inj, LbPerHr	Unit CT2 ExhaustFlow, LbPerHr	Unit CT2 SUSD, Hr	Unit CT2 OperatingTime, Hr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/30/2022 00:00	0	1.8	7.6	14.3	11.9	875,394.2	0.00	1.00
09/30/2022 01:00	0	1.8	7.5	14.3	11.5	855,682.8	0.00	1.00
09/30/2022 02:00	0	1.6	8.0	14.3	12.6	836,801.3	0.00	1.00
09/30/2022 03:00	1	1.5	9.1	14.3	13.6	807,545.4	0.00	1.00
09/30/2022 04:00	0	1.8	7.8	14.4	12.4	946,377.6	0.00	1.00
09/30/2022 05:00	0	1.7	8.2	14.4	16.2	1,018,430.4	0.00	1.00
09/30/2022 06:00	1	1.6	11.0	14.5	21.6	881,780.9	0.00	1.00
09/30/2022 07:00	1	1.6	16.8	14.7	25.9	657,765.5	0.00	1.00
09/30/2022 08:00	1	1.6	15.6	14.7	23.5	659,532.5	0.00	1.00
09/30/2022 09:00	1	1.6	15.5	14.7	23.9	653,568.8	0.00	1.00
09/30/2022 10:00	1	1.5	14.9	14.8	21.6	666,528.0	0.00	1.00
09/30/2022 11:00	1	1.6	15.2	14.8	23.1	659,568.7	0.00	1.00
09/30/2022 12:00	1	1.5	14.5	14.8	20.7	664,507.6	0.00	1.00
09/30/2022 13:00	1	1.5	14.8	14.8	22.4	657,997.2	0.00	1.00
09/30/2022 14:00	1	1.5	14.3	14.8	20.6	657,548.2	0.00	1.00
09/30/2022 15:00	1	1.5	13.3	14.8	18.5	664,732.1	0.00	1.00
09/30/2022 16:00	0	1.3	10.1	14.6	11.9	837,522.6	0.00	1.00
09/30/2022 17:00	0	1.7	7.4	14.4	8.4	894,550.1	0.00	1.00
09/30/2022 18:00	1	1.5	11.9	14.7	17.6	685,374.8	0.00	1.00
09/30/2022 19:00	1	1.6	12.0	14.7	17.2	683,166.1	0.00	1.00
09/30/2022 20:00	0	1.5	11.4	14.6	15.3	712,970.2	0.00	1.00
09/30/2022 21:00	0	1.6	8.8	14.4	11.4	837,245.0	0.00	1.00
09/30/2022 22:00	1	1.6	12.7	14.6	17.8	682,973.2	0.00	1.00
09/30/2022 23:00	0	1.6	7.2	14.4	8.2	941,531.9	0.00	1.00
Average/Sum#:	1	1.6	11.5	14.6	17.0	768,295.6	0.00 #	24.00 #
Minimum:	0	1.3	7.2	14.3	8.2	653,568.8	0.00	1.00
Maximum:	1	1.8	16.8	14.8	25.9	1,018,430.4	0.00	1.00
%SI	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

ATTACHMENT 15

AQ-55

AQ-55 The emissions rates from each gas turbine and heat recovery steam generator exhaust during startup and shutdown shall not exceed the following:

Turbine emissions limitations during Startup and Shutdown		
Pollutant	Max Lbs/ Hr (worst case turbine)	Pounds per Startup or Shutdown (both turbines combined)
NO_x	37.1	122.8
CO	89.5	204.8

Verification: The Project owner shall include all necessary emissions data to demonstrate compliance with the emissions limits provided in this Condition as part of the Quarterly Air Quality Report required in Condition of Certification AQ-SC6.

Startup / Shutdown Events

CT1



From: 07/01/2022 00:00 **To:** 09/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 10/01/2022 19:11 **Location:** Roseville, CA

Unit offline

Tag Name: CT1_UnitOn_TF_1H

Offline Periods		
Start Time	End Time	Duration in Hour(s)
08/17/2022 08:00	08/19/2022 10:00	51
08/20/2022 16:00	08/21/2022 07:00	16
08/22/2022 06:00	08/26/2022 04:00	95
09/22/2022 22:00	09/23/2022 11:00	14

Startup / Shutdown Events

CT1



From: 07/01/2022 00:00 **To:** 09/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 10/01/2022 19:11 **Location:** Roseville, CA

Operating Time Summary

Available Data for Report (excludes missing data):	2,208.00 Hour(s)
Total Offline:	176.00 Hour(s)
Offline Percentage:	7.97 %
Total Online:	2,032.00 Hour(s)
Online Percentage:	92.03 %

Startup / Shutdown Events

CT1



From: 07/01/2022 00:00 **To:** 09/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 10/01/2022 19:11 **Location:** Roseville, CA

Startup/Shutdown

Number	Start Time	End Time	Event Type	Duration
1	08/17/2022 07:21	08/17/2022 07:21	Shutdown	1
2	08/19/2022 11:02	08/19/2022 12:01	cold Startup	60
3	08/20/2022 15:18	08/20/2022 15:19	Shutdown	2
4	08/21/2022 08:13	08/21/2022 09:13	cold Startup	61
5	08/22/2022 05:31	08/22/2022 05:31	Shutdown	1
6	08/26/2022 05:40	08/26/2022 06:39	cold Startup	60
7	09/22/2022 21:51	09/22/2022 21:59	Shutdown	9
8	09/23/2022 12:37	09/23/2022 13:34	cold Startup	58

Startup / Shutdown Events

CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 19:11 Location: Roseville, CA

Startup/Shutdown Event Summary

	# Events	Duration	Duration %
Cold Startup	4	239	0.20
Warm Startup	0		0.00
Shutdown	4	13	0.01
Total Process Events:	8	252	0.21

Total Report Time:	2,207.98 Hour(s)
Total Operating Time:	2,028.70 Hour(s)
Total Startup Time:	239 Minute(s)
Total Shutdown Time:	13 Minute(s)
Total Startup/Shutdown Time:	252 Minute(s)
Total Startup/Shutdown Time as a Percentage of Total Operating Time:	0.21 %

Startup / Shutdown Events

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 19:12 Location: Roseville, CA

Unit offline

Tag Name: CT2_UnitOn_TF_1H

Offline Periods		
Start Time	End Time	Duration in Hour(s)
07/01/2022 00:00	07/01/2022 16:00	17
07/02/2022 00:00	07/05/2022 14:00	87
07/05/2022 23:00	07/06/2022 15:00	17
07/06/2022 23:00	07/07/2022 13:00	15
07/08/2022 00:00	07/08/2022 13:00	14
07/08/2022 19:00	07/10/2022 13:00	43
07/14/2022 01:00	07/14/2022 12:00	12
07/23/2022 00:00	07/23/2022 15:00	16
07/23/2022 23:00	07/24/2022 04:00	6
08/19/2022 22:00	08/20/2022 14:00	17
09/23/2022 00:00	09/23/2022 14:00	15

Startup / Shutdown Events

CT2



From: 07/01/2022 00:00 **To:** 09/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 10/01/2022 19:12 **Location:** Roseville, CA

Operating Time Summary

Available Data for Report (excludes missing data):	2,208.00 Hour(s)
Total Offline:	259.00 Hour(s)
Offline Percentage:	11.73 %
Total Online:	1,949.00 Hour(s)
Online Percentage:	88.27 %

Startup / Shutdown Events

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 19:12 Location: Roseville, CA

Startup/Shutdown

Number	Start Time	End Time	Event Type	Duration
1	07/01/2022 17:17	07/01/2022 18:08	Cold Startup	52
2	07/01/2022 22:59	07/01/2022 23:07	Shutdown	9
3	07/05/2022 15:18	07/05/2022 16:24	Cold Startup	67
4	07/05/2022 21:53	07/05/2022 22:00	Shutdown	8
5	07/06/2022 16:51	07/06/2022 17:48	Cold Startup	58
6	07/06/2022 22:07	07/06/2022 22:15	Shutdown	9
7	07/07/2022 14:56	07/07/2022 15:48	Cold Startup	53
8	07/07/2022 23:24	07/07/2022 23:31	Shutdown	8
9	07/08/2022 14:07	07/08/2022 15:03	Cold Startup	57
10	07/08/2022 18:22	07/08/2022 18:29	Shutdown	8
11	07/10/2022 14:58	07/10/2022 15:44	Cold Startup	47
12	07/13/2022 23:54	07/14/2022 00:01	Shutdown	8
13	07/14/2022 13:08	07/14/2022 13:52	Cold Startup	45
14	07/22/2022 23:21	07/22/2022 23:29	Shutdown	9
15	07/23/2022 16:04	07/23/2022 16:50	Cold Startup	47
16	07/23/2022 22:13	07/23/2022 22:20	Shutdown	8
17	07/24/2022 05:06	07/24/2022 06:08	Cold Startup	63
18	08/19/2022 20:58	08/19/2022 21:06	Shutdown	9
19	08/20/2022 15:04	08/20/2022 15:51	Cold Startup	48
20	09/22/2022 22:50	09/22/2022 23:02	Shutdown	13
21	09/23/2022 15:45	09/23/2022 16:52	Cold Startup	68

Startup / Shutdown Events

CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 19:12 Location: Roseville, CA

Startup/Shutdown Event Summary

	# Events	Duration	Duration %
Cold Startup	11	605	0.52
Warm Startup	0		0.00
Shutdown	10	89	0.08
Total Process Events:	21	694	0.6

Total Report Time:	2,207.98 Hour(s)
Total Operating Time:	1,936.93 Hour(s)
Total Startup Time:	605 Minute(s)
Total Shutdown Time:	89 Minute(s)
Total Startup/Shutdown Time:	694 Minute(s)
Total Startup/Shutdown Time as a Percentage of Total Operating Time:	0.60 %

Monthly Summary By Day Report



From: 07/01/2022 00:00 **To:** 09/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 10/01/2022 19:13 **Location:** Roseville, CA

Red = Invalid Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Limit Value:

	Unit CT1 CO_SUSD, LbPerHr	Unit CT1 NOX_SUSD, LbPerHr	Unit CT2 CO_SUSD, LbPerHr	Unit CT2 NOX_SUSD, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
07/01/2022	0.0	0.0	42.5	12.1
07/02/2022	0.0	0.0	0.0	0.0
07/03/2022	0.0	0.0	0.0	0.0
07/04/2022	0.0	0.0	0.0	0.0
07/05/2022	0.0	0.0	45.0	13.3
07/06/2022	0.0	0.0	28.9	11.3
07/07/2022	0.0	0.0	35.9	11.6
07/08/2022	0.0	0.0	26.5	11.2
07/09/2022	0.0	0.0	0.0	0.0
07/10/2022	0.0	0.0	15.1	10.1
07/11/2022	0.0	0.0	0.0	0.0
07/12/2022	0.0	0.0	0.0	0.0
07/13/2022	0.0	0.0	2.4	0.6
07/14/2022	0.0	0.0	36.6	9.8
07/15/2022	0.0	0.0	0.0	0.0
07/16/2022	0.0	0.0	0.0	0.0
07/17/2022	0.0	0.0	0.0	0.0
07/18/2022	0.0	0.0	0.0	0.0
07/19/2022	0.0	0.0	0.0	0.0
07/20/2022	0.0	0.0	0.0	0.0
07/21/2022	0.0	0.0	0.0	0.0
07/22/2022	0.0	0.0	8.3	0.9
07/23/2022	0.0	0.0	23.6	9.9
07/24/2022	0.0	0.0	39.5	10.5
07/25/2022	0.0	0.0	0.0	0.0
07/26/2022	0.0	0.0	0.0	0.0
07/27/2022	0.0	0.0	0.0	0.0
07/28/2022	0.0	0.0	0.0	0.0
07/29/2022	0.0	0.0	0.0	0.0
07/30/2022	0.0	0.0	0.0	0.0
07/31/2022	0.0	0.0	0.0	0.0
Monthly Avg/Sum*:	0.0 *	0.0 *	304.3 *	101.3 *
Daily Min:	0.0	0.0	0.0	0.0
Daily Max:	0.0	0.0	45.0	13.3
Jul 2022 - Jul 2022	0.0	0.0	304.3	101.3
QTD:	0.0 *	0.0 *	304.3 *	101.3 *
YTD 2022:	1,747.8 *	276.5 *	2,161.0 *	474.5 *

Monthly Summary By Day Report



From: 07/01/2022 00:00 **To:** 09/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 10/01/2022 19:13 **Location:** Roseville, CA

Red = Invalid Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Limit Value:

	Unit CT1 CO_SUSD, LbPerHr	Unit CT1 NOX_SUSD, LbPerHr	Unit CT2 CO_SUSD, LbPerHr	Unit CT2 NOX_SUSD, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
08/01/2022	0.0	0.0	0.0	0.0
08/02/2022	0.0	0.0	0.0	0.0
08/03/2022	0.0	0.0	0.0	0.0
08/04/2022	0.0	0.0	0.0	0.0
08/05/2022	0.0	0.0	0.0	0.0
08/06/2022	0.0	0.0	0.0	0.0
08/07/2022	0.0	0.0	0.0	0.0
08/08/2022	0.0	0.0	0.0	0.0
08/09/2022	0.0	0.0	0.0	0.0
08/10/2022	0.0	0.0	0.0	0.0
08/11/2022	0.0	0.0	0.0	0.0
08/12/2022	0.0	0.0	0.0	0.0
08/13/2022	0.0	0.0	0.0	0.0
08/14/2022	0.0	0.0	0.0	0.0
08/15/2022	0.0	0.0	0.0	0.0
08/16/2022	0.0	0.0	0.0	0.0
08/17/2022	0.0	0.0	0.0	0.0
08/18/2022	0.0	0.0	0.0	0.0
08/19/2022	47.9	11.0	8.4	1.2
08/20/2022	0.1	0.0	28.9	10.4
08/21/2022	43.0	10.5	0.0	0.0
08/22/2022	2.7	0.3	0.0	0.0
08/23/2022	0.0	0.0	0.0	0.0
08/24/2022	0.0	0.0	0.0	0.0
08/25/2022	0.0	0.0	0.0	0.0
08/26/2022	47.2	11.2	0.0	0.0
08/27/2022	0.0	0.0	0.0	0.0
08/28/2022	0.0	0.0	0.0	0.0
08/29/2022	0.0	0.0	0.0	0.0
08/30/2022	0.0	0.0	0.0	0.0
08/31/2022	0.0	0.0	0.0	0.0
Monthly Avg/Sum*:	140.9 *	33.0 *	37.3 *	11.6 *
Daily Min:	0.0	0.0	0.0	0.0
Daily Max:	47.9	11.2	28.9	10.4
Jul 2022 - Aug 2022	140.9	33.0	341.6	112.9
QTD:	140.9 *	33.0 *	341.6 *	112.9 *
YTD 2022:	1,888.7 *	309.5 *	2,198.3 *	486.1 *

Monthly Summary By Day Report



From: 07/01/2022 00:00 **To:** 09/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 10/01/2022 19:13 **Location:** Roseville, CA

Red = Invalid Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Limit Value:

	Unit CT1 CO_SUSD, LbPerHr	Unit CT1 NOX_SUSD, LbPerHr	Unit CT2 CO_SUSD, LbPerHr	Unit CT2 NOX_SUSD, LbPerHr
	1 Hour(s)	1 Hour(s)	1 Hour(s)	1 Hour(s)
09/01/2022	0.0	0.0	0.0	0.0
09/02/2022	0.0	0.0	0.0	0.0
09/03/2022	0.0	0.0	0.0	0.0
09/04/2022	0.0	0.0	0.0	0.0
09/05/2022	0.0	0.0	0.0	0.0
09/06/2022	0.0	0.0	0.0	0.0
09/07/2022	0.0	0.0	0.0	0.0
09/08/2022	0.0	0.0	0.0	0.0
09/09/2022	0.0	0.0	0.0	0.0
09/10/2022	0.0	0.0	0.0	0.0
09/11/2022	0.0	0.0	0.0	0.0
09/12/2022	0.0	0.0	0.0	0.0
09/13/2022	0.0	0.0	0.0	0.0
09/14/2022	0.0	0.0	0.0	0.0
09/15/2022	0.0	0.0	0.0	0.0
09/16/2022	0.0	0.0	0.0	0.0
09/17/2022	0.0	0.0	0.0	0.0
09/18/2022	0.0	0.0	0.0	0.0
09/19/2022	0.0	0.0	0.0	0.0
09/20/2022	0.0	0.0	0.0	0.0
09/21/2022	0.0	0.0	0.0	0.0
09/22/2022	18.1	1.1	11.6	1.7
09/23/2022	45.5	9.6	31.1	12.2
09/24/2022	0.0	0.0	0.0	0.0
09/25/2022	0.0	0.0	0.0	0.0
09/26/2022	0.0	0.0	0.0	0.0
09/27/2022	0.0	0.0	0.0	0.0
09/28/2022	0.0	0.0	0.0	0.0
09/29/2022	0.0	0.0	0.0	0.0
09/30/2022	0.0	0.0	0.0	0.0
Monthly Avg/Sum*:	63.6 *	10.7 *	42.7 *	13.9 *
Daily Min:	0.0	0.0	0.0	0.0
Daily Max:	45.5	9.6	31.1	12.2
Jul 2022 - Sep 2022	204.5	43.7	384.3	126.8
QTD:	204.5 *	43.7 *	384.3 *	126.8 *
YTD 2022:	1,952.3 *	320.2 *	2,241.0 *	500.0 *

Monthly Summary By Day Report

Units CT1 and CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 19:14 Location: Roseville, CA

Red = Invalid Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Limit Value:	Units CT1 & CT2 CO, Lb 1 Hour(s)	Units CT1 & CT2 NOx, Lb 1 Hour(s)	Units CT1 & CT2 SO2, Lb 1 Hour(s)	Units CT1 & CT2 PM10, Lb 1 Hour(s)	Units CT1 & CT2 VOC, Lb 1 Hour(s)
07/01/2022	74.79	73.87	6.74	13.49	22.50
07/02/2022	9.07	39.83	4.32	8.65	14.36
07/03/2022	8.89	39.70	4.32	8.63	14.34
07/04/2022	8.49	42.20	4.32	8.63	14.29
07/05/2022	70.69	76.30	6.98	13.95	23.28
07/06/2022	59.76	67.78	6.19	12.40	20.67
07/07/2022	73.55	81.52	7.75	15.52	25.80
07/08/2022	50.69	65.00	6.10	12.17	20.24
07/09/2022	10.51	41.85	4.49	8.97	14.90
07/10/2022	36.72	76.83	7.48	14.88	24.85
07/11/2022	34.40	120.88	13.11	26.23	43.76
07/12/2022	40.01	119.09	12.79	25.60	42.64
07/13/2022	40.41	123.57	12.18	24.41	40.72
07/14/2022	67.24	98.49	9.29	18.57	30.91
07/15/2022	38.77	132.48	13.25	26.51	44.22
07/16/2022	29.71	129.21	13.06	26.16	43.55
07/17/2022	32.75	141.03	14.51	28.99	48.32
07/18/2022	39.64	142.88	14.26	28.57	47.65
07/19/2022	32.34	121.45	12.10	24.18	40.33
07/20/2022	24.57	104.69	11.34	22.66	37.77
07/21/2022	27.95	102.48	10.62	21.25	35.46
07/22/2022	50.00	100.13	10.25	20.53	34.25
07/23/2022	54.52	77.89	7.19	14.39	23.97
07/24/2022	61.79	96.48	9.14	18.29	30.52
07/25/2022	29.76	101.95	11.10	22.23	37.02
07/26/2022	38.02	108.18	11.79	23.58	39.33
07/27/2022	29.89	110.66	11.23	22.46	37.44
07/28/2022	40.03	128.85	13.12	26.23	43.72
07/29/2022	40.70	121.99	12.44	24.90	41.49
07/30/2022	45.90	139.63	13.83	27.66	46.07
07/31/2022	43.49	127.65	13.07	26.15	43.58
Monthly Avg/Sum*:	1,245.05 *	3,054.54 *	308.36 *	616.84 *	1,027.95 *
Daily Min:	8.49	39.70	4.32	8.63	14.29
Daily Max:	74.79	142.88	14.51	28.99	48.32
Jul 2022 - Jul 2022	1,245.05	3,054.54	308.36	616.84	1,027.95
QTD:	1,245.05 *	3,054.54 *	308.36 *	616.84 *	1,027.95 *
YTD 2022:	8,468.47 *	12,330.53 *	1,255.89 *	2,512.65 *	4,188.71 *

Monthly Summary By Day Report

Units CT1 and CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 19:14 Location: Roseville, CA

Red = Invalid Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Limit Value:	Units CT1 & CT2 CO, Lb 1 Hour(s)	Units CT1 & CT2 NOx, Lb 1 Hour(s)	Units CT1 & CT2 SO2, Lb 1 Hour(s)	Units CT1 & CT2 PM10, Lb 1 Hour(s)	Units CT1 & CT2 VOC, Lb 1 Hour(s)
08/01/2022	57.30	138.87	13.74	27.53	45.83
08/02/2022	40.01	124.00	12.52	25.06	41.84
08/03/2022	32.09	118.48	12.61	25.25	42.08
08/04/2022	44.22	143.63	14.66	29.37	48.92
08/05/2022	52.52	122.37	13.21	26.38	44.03
08/06/2022	21.07	87.42	9.08	18.18	30.36
08/07/2022	25.81	101.87	9.75	19.54	32.58
08/08/2022	38.44	120.83	12.29	24.55	40.93
08/09/2022	59.53	145.47	14.46	28.92	48.32
08/10/2022	37.06	133.62	12.86	25.69	42.77
08/11/2022	33.13	135.37	13.39	26.75	44.59
08/12/2022	34.85	126.91	12.83	25.63	42.69
08/13/2022	34.31	117.04	11.94	23.93	39.83
08/14/2022	38.21	115.24	11.66	23.29	38.83
08/15/2022	25.39	118.55	11.85	23.64	39.40
08/16/2022	28.68	134.56	13.78	27.53	45.87
08/17/2022	25.79	85.33	8.68	17.29	28.80
08/18/2022	19.99	58.67	5.84	11.72	19.58
08/19/2022	88.65	85.89	7.68	15.34	25.54
08/20/2022	53.66	64.73	5.35	10.70	17.82
08/21/2022	67.71	109.02	10.13	20.32	33.82
08/22/2022	20.54	75.20	7.66	15.31	25.53
08/23/2022	27.40	77.29	7.79	15.53	25.89
08/24/2022	28.36	75.00	7.61	15.18	25.30
08/25/2022	32.79	73.08	7.34	14.63	24.39
08/26/2022	72.41	136.70	12.88	25.76	42.95
08/27/2022	33.87	124.44	13.01	26.03	43.36
08/28/2022	25.17	101.72	10.34	20.69	34.49
08/29/2022	30.65	119.02	12.14	24.27	40.47
08/30/2022	30.52	138.25	14.18	28.39	47.30
08/31/2022	33.36	149.46	15.16	30.35	50.57
Monthly Avg/Sum*:	1,193.49 *	3,458.03 *	346.42 *	692.75 *	1,154.68 *
Daily Min:	19.99	58.67	5.35	10.70	17.82
Daily Max:	88.65	149.46	15.16	30.35	50.57
Jul 2022 - Aug 2022	2,438.54	6,512.57	654.78	1,309.59	2,182.63
QTD:	2,438.54 *	6,512.57 *	654.78 *	1,309.59 *	2,182.63 *
YTD 2022:	9,661.96 *	15,788.56 *	1,602.31 *	3,205.40 *	5,343.39 *

Monthly Summary By Day Report

Units CT1 and CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 19:14 Location: Roseville, CA

Red = Invalid Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Limit Value:

	Units CT1 & CT2 CO, Lb 1 Hour(s)	Units CT1 & CT2 NOx, Lb 1 Hour(s)	Units CT1 & CT2 SO2, Lb 1 Hour(s)	Units CT1 & CT2 PM10, Lb 1 Hour(s)	Units CT1 & CT2 VOC, Lb 1 Hour(s)
09/01/2022	32.98	148.87	15.12	30.21	50.34
09/02/2022	41.38	155.87	15.88	31.71	52.89
09/03/2022	29.00	99.58	10.26	20.50	34.16
09/04/2022	32.33	107.43	11.06	22.11	36.91
09/05/2022	29.28	140.29	14.32	28.66	47.76
09/06/2022	35.09	158.54	16.06	32.14	53.54
09/07/2022	33.02	166.75	16.21	32.42	54.00
09/08/2022	34.92	166.17	16.63	33.26	55.41
09/09/2022	42.81	157.17	16.05	32.17	53.57
09/10/2022	28.90	98.50	10.47	20.94	34.90
09/11/2022	33.28	110.37	11.38	22.76	37.93
09/12/2022	31.16	107.51	11.13	22.21	37.04
09/13/2022	40.09	107.60	11.13	22.28	37.18
09/14/2022	23.60	92.08	9.47	18.96	31.61
09/15/2022	26.94	92.59	9.71	19.38	32.29
09/16/2022	18.99	82.94	8.52	17.02	28.38
09/17/2022	19.09	82.90	8.49	16.89	28.25
09/18/2022	24.61	94.86	9.65	19.24	32.08
09/19/2022	36.18	113.34	11.50	23.01	38.33
09/20/2022	38.99	116.89	11.84	23.68	39.50
09/21/2022	31.59	107.78	11.18	22.34	37.26
09/22/2022	63.62	90.80	9.26	18.50	30.84
09/23/2022	105.13	71.62	5.36	10.72	17.85
09/24/2022	29.80	105.73	10.82	21.66	36.11
09/25/2022	23.06	94.28	9.79	19.63	32.69
09/26/2022	21.84	89.93	9.33	18.66	31.14
09/27/2022	64.71	130.96	13.32	26.66	44.41
09/28/2022	21.14	96.87	10.05	20.09	33.48
09/29/2022	32.06	100.81	10.51	21.01	35.03
09/30/2022	23.82	90.89	9.90	19.82	33.03
Monthly Avg/Sum*:	1,049.41 *	3,379.92 *	344.40 *	688.64 *	1,147.91 *
Daily Min:	18.99	71.62	5.36	10.72	17.85
Daily Max:	105.13	166.75	16.63	33.26	55.41
Jul 2022 - Sep 2022	3,487.95	9,892.49	999.18	1,998.23	3,330.54
QTD:	3,487.95 *	9,892.49 *	999.18 *	1,998.23 *	3,330.54 *
YTD 2022:	10,711.37 *	19,168.48 *	1,946.71 *	3,894.04 *	6,491.30 *

CT1 SUSD EVENT 1

Date/Time	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/17/22 7:16	377224.2			0.6			0.51			0.54			0.73			0		
08/17/22 7:17	378687.5			0.5			0.42			0.46			0.61			0		
08/17/22 7:18	375144.8			0.4			0.32			0.37			0.45			0		
08/17/22 7:19	364978.7			0.4			0.32			0.36			0.44			0		
08/17/22 7:20	363207.3			0.4			0.32			0.36			0.45			0		
08/17/22 7:21	156496.5			0.5			0.22			0.2			0.13			1		
08/17/22 7:22	34734.2			0			0.94			0.48			0.13			0		
08/17/22 7:23	35273.3			0			0			0			0			0		
08/17/22 7:24	35658.4			0			0			0			0			0		
08/17/22 7:25	35889.4			0			0			0			0			0		
08/17/22 7:26	36043.5			0			0			0			0			0		

CT1 SUSD EVENT 2

Date/Time	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/19/22 10:57	41973.7			0			0			0			0			0		
08/19/22 10:58	42358.8			0			0			0			0			0		
08/19/22 10:59	42358.8			0			0			0			0			0		
08/19/22 11:00	42435.8			0			0			0			0			0		
08/19/22 11:01	42743.9			0			0			0			0			0		
08/19/22 11:02	47749.9			0.2			0			0			0			1		
08/19/22 11:03	50137.4			0.2			0			0			0			1		
08/19/22 11:04	57068.8			64.9			31.47			8.6			6.86			1		
08/19/22 11:05	66079.7			1157.2			15.17			177.7			3.83			1		
08/19/22 11:06	76322.8			701.8			20.82			124.41			6.08			1		
08/19/22 11:07	99042.5			360.2			25.67			82.89			9.72			1		
08/19/22 11:08	138474.7			204.9			33.25			65.91			17.6			1		
08/19/22 11:09	142402.5			125.4			48.29			41.5			26.29			1		
08/19/22 11:10	148794.9			810			51.39			279.96			29.23			1		
08/19/22 11:11	157959.8			2046			51.96			751.09			31.39			1		
08/19/22 11:12	174749.2			1922			58.82			780.43			39.31			1		
08/19/22 11:13	197160.9			979.2			68.01			448.7			51.29			1		
08/19/22 11:14	220958.8			135.3			61.11			69.47			51.64			1		
08/19/22 11:15	240212.8			9.6			55.56			5.35			51.03			1		
08/19/22 11:16	267553.5			2.3			51.43			1.45			52.62			1		
08/19/22 11:17	289965.1			2			24.58			1.33			27.26			1		
08/19/22 11:18	308294.9			1.9			14.34			1.37			16.91			1		
08/19/22 11:19	314148.2			2			10.37			1.44			12.46			1		
08/19/22 11:20	311298.6			2			9.21			1.42			10.96			1		
08/19/22 11:21	320925.6			1.8			7.78			1.33			9.54			1		
08/19/22 11:22	322157.8			1.7			7.24			1.27			8.92			1		
08/19/22 11:23	322311.8			1.5			6.34			1.12			7.82			1		
08/19/22 11:24	322080.8			1.4			5.81			1.05			7.16			1		
08/19/22 11:25	322465.9			1.3			5.37			0.99			6.62			1		
08/19/22 11:26	319693.3			1.3			5.01			0.93			6.12			1		
08/19/22 11:27	321618.7			1.2			4.92			0.87			6.05			1		
08/19/22 11:28	322465.9			1.2			4.83			0.87			5.95			1		
08/19/22 11:29	323005			1.1			4.65			0.81			5.74			1		
08/19/22 11:30	322542.9			1.1			4.65			0.8			5.73			1		

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/19/22 11:31	322696.9			1.1			4.65			0.8			5.74			1		
08/19/22 11:32	320540.5			1			4.56			0.73			5.59			1		
08/19/22 11:33	319693.3			1			4.56			0.73			5.57			1		
08/19/22 11:34	320001.4			1			4.56			0.73			5.58			1		
08/19/22 11:35	318923.2			0.9			4.56			0.66			5.56			1		
08/19/22 11:36	319308.2			0.9			4.56			0.66			5.57			1		
08/19/22 11:37	320463.5			0.9			4.65			0.67			5.7			1		
08/19/22 11:38	320078.4			0.9			4.65			0.66			5.69			1		
08/19/22 11:39	321387.7			0.9			4.83			0.67			5.93			1		
08/19/22 11:40	320848.5			0.9			4.92			0.67			6.03			1		
08/19/22 11:41	321079.6			0.9			5.1			0.67			6.26			1		
08/19/22 11:42	321156.6			0.9			5.18			0.67			6.37			1		
08/19/22 11:43	319770.3			0.8			5.27			0.6			6.45			1		
08/19/22 11:44	320771.5			0.8			5.36			0.6			6.58			1		
08/19/22 11:45	321156.6			0.8			5.54			0.61			6.8			1		
08/19/22 11:46	320771.5			0.8			5.54			0.61			6.79			1		
08/19/22 11:47	319462.3			0.8			5.1			0.6			6.22			1		
08/19/22 11:48	319385.3			0.8			3.99			0.61			4.88			1		
08/19/22 11:49	319693.3			0.8			3.36			0.61			4.11			1		
08/19/22 11:50	319616.3			0.8			3.45			0.61			4.22			1		
08/19/22 11:51	321387.7			0.8			4.18			0.61			5.13			1		
08/19/22 11:52	321772.7			0.8			4.18			0.61			5.14			1		
08/19/22 11:53	322619.9			0.8			3.27			0.61			4.03			1		
08/19/22 11:54	321387.7			0.8			2.9			0.61			3.57			1		
08/19/22 11:55	320386.4			0.8			2.72			0.61			3.34			1		
08/19/22 11:56	319847.3			0.8			2.45			0.61			3			1		
08/19/22 11:57	321772.7			0.8			2.27			0.61			2.79			1		
08/19/22 11:58	322157.8			0.8			2.18			0.61			2.68			1		
08/19/22 11:59	321387.7			0.8			2			0.61			2.45			1		
08/19/22 12:00	319770.3			0.8			1.91			0.61			2.33			1		
08/19/22 12:01	319154.2			0.8			1.91			0.61			2.33			1		
08/19/22 12:02	319847.3			0.8			1.82			0.61			2.22			0		
08/19/22 12:03	321002.6			0.8			1.72			0.61			2.12			0		
08/19/22 12:04	320771.5			0.7			1.72			0.54			2.12			0		
08/19/22 12:05	321310.6			0.7			1.63			0.54			2.01			0		
08/19/22 12:06	322234.8			0.7			1.63			0.54			2.01			0		

CT1 SUSD EVENT 3

CT1_GasFlow_CT_scfh_1M				CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/20/22 15:13	429749.1			0.7			1.69			0.65			2.77			0		
08/20/22 15:14	424435			0.7			1.69			0.65			2.74			0		
08/20/22 15:15	406567.3			0.7			1.69			0.62			2.62			0		
08/20/22 15:16	385464.9			0.7			1.69			0.59			2.48			0		
08/20/22 15:17	363977.5			0.7			1.63			0.61			2.27			0		
08/20/22 15:18	341334.8			0.7			1.38			0.58			1.8			1		
08/20/22 15:19	130234			0.7			0.68			0.2			0.34			1		
08/20/22 15:20	54989.4			0			1.64			2.39			0.34			0		
08/20/22 15:21	54681.3			0			0.3			0			0			0		
08/20/22 15:22	54450.3			0			0.1			0			0			0		
08/20/22 15:23	54065.2			0			0			0			0			0		
08/20/22 15:24	53988.2			0			0			0			0			0		

CT1 SUSD EVENT 4

Date/Time	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/21/22 8:08	32038.6			0			0			0			0			0		
08/21/22 8:09	32115.7			0			0			0			0			0		
08/21/22 8:10	31961.6			0			0			0			0			0		
08/21/22 8:11	32115.7			0			0			0			0			0		
08/21/22 8:12	33039.9			0			0			0			0			0		
08/21/22 8:13	35735.4			0.2			0			0			0			1		
08/21/22 8:14	41588.6			0.2			0			0			0			1		
08/21/22 8:15	50599.5			75.5			28.32			8.88			5.48			1		
08/21/22 8:16	60611.6			1178.4			16.52			165.92			3.83			1		
08/21/22 8:17	70854.7			691.6			24.58			113.79			6.66			1		
08/21/22 8:18	96193			399.1			28.62			89.17			10.52			1		
08/21/22 8:19	136857.4			244			41.03			77.63			21.48			1		
08/21/22 8:20	142171.5			161.5			56.6			53.35			30.77			1		
08/21/22 8:21	153338.8			974.1			55.57			347.12			32.59			1		
08/21/22 8:22	170436.3			2025			55.95			801.88			36.47			1		
08/21/22 8:23	190614.5			1503.2			57.82			665.88			42.15			1		
08/21/22 8:24	215182.6			313			58.12			156.52			47.83			1		
08/21/22 8:25	235206.8			27.8			54.64			15.21			49.13			1		
08/21/22 8:26	259774.9			5.9			49.36			3.56			49.02			1		
08/21/22 8:27	285344.2			5			33.95			3.29			37.05			1		
08/21/22 8:28	304213.1			4.6			15.67			3.26			18.23			1		
08/21/22 8:29	313532			4.8			11.1			3.53			13.3			1		
08/21/22 8:30	312068.7			5.5			10.3			4.02			12.29			1		
08/21/22 8:31	310451.4			6.4			9.07			4.64			10.77			1		
08/21/22 8:32	309681.2			7.5			9.12			5.4			10.8			1		
08/21/22 8:33	309296.2			8			8.22			5.78			9.73			1		
08/21/22 8:34	307524.8			7.9			7.96			5.62			9.36			1		
08/21/22 8:35	306754.6			7.3			6.88			5.22			8.07			1		
08/21/22 8:36	306600.6			6.6			6.35			4.71			7.44			1		
08/21/22 8:37	306292.5			5.8			5.81			4.13			6.81			1		
08/21/22 8:38	305753.4			5.1			5.45			3.61			6.37			1		
08/21/22 8:39	306908.7			4.3			4.9			3.04			5.75			1		
08/21/22 8:40	305753.4			3.5			4.81			2.52			5.63			1		
08/21/22 8:41	305214.3			2.8			4.72			2			5.51			1		

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/21/22 8:42	304598.2			2.4			4.54			1.67			5.29			1		
08/21/22 8:43	304136.1			2.1			4.27			1.48			4.96			1		
08/21/22 8:44	303828			1.9			4.18			1.35			4.85			1		
08/21/22 8:45	303674			1.8			4.15			1.24			4.82			1		
08/21/22 8:46	303365.9			1.6			4.06			1.1			4.71			1		
08/21/22 8:47	303211.9			1.5			4.15			1.04			4.81			1		
08/21/22 8:48	302980.8			1.4			4.24			0.97			4.91			1		
08/21/22 8:49	303057.8			1.2			4.33			0.84			5.02			1		
08/21/22 8:50	301748.6			1.1			4.5			0.79			5.19			1		
08/21/22 8:51	283803.8			1			4.43			0.67			4.8			1		
08/21/22 8:52	277873.6			0.9			4.5			0.6			4.78			1		
08/21/22 8:53	274407.9			0.9			5.14			0.55			5.39			1		
08/21/22 8:54	268169.6			0.8			5.52			0.47			5.66			1		
08/21/22 8:55	267784.5			0.7			5.61			0.41			5.75			1		
08/21/22 8:56	267014.4			0.7			5.71			0.42			5.83			1		
08/21/22 8:57	266783.3			0.6			5.42			0.36			5.53			1		
08/21/22 8:58	266937.4			0.6			4.74			0.36			4.84			1		
08/21/22 8:59	272097.4			0.6			4.55			0.37			4.73			1		
08/21/22 9:00	272790.6			0.6			4.26			0.37			4.44			1		
08/21/22 9:01	272867.6			0.6			3.62			0.36			3.77			1		
08/21/22 9:02	270788.2			0.6			3.52			0.36			3.65			1		
08/21/22 9:03	270557.1			0.6			3.48			0.36			3.6			1		
08/21/22 9:04	271712.3			0.6			3.19			0.37			3.32			1		
08/21/22 9:05	272790.6			0.6			3			0.37			3.13			1		
08/21/22 9:06	272097.4			0.6			2.9			0.37			3.02			1		
08/21/22 9:07	272020.4			0.6			2.71			0.37			2.82			1		
08/21/22 9:08	271866.4			0.6			2.51			0.37			2.61			1		
08/21/22 9:09	271712.3			0.6			2.32			0.37			2.41			1		
08/21/22 9:10	272097.4			0.6			2.13			0.37			2.21			1		
08/21/22 9:11	271789.4			0.6			1.93			0.37			2.01			1		
08/21/22 9:12	271943.4			0.6			1.84			0.37			1.91			1		
08/21/22 9:13	271404.3			0.6			1.74			0.37			1.81			1		
08/21/22 9:14	271712.3			0.6			1.64			0.37			1.71			0		
08/21/22 9:15	271481.3			0.6			1.55			0.37			1.61			0		
08/21/22 9:16	271327.3			0.6			1.45			0.37			1.51			0		
08/21/22 9:17	271096.2			0.5			1.45			0.3			1.5			0		
08/21/22 9:18	269401.9			0.6			1.35			0.36			1.39			0		

CT1 SUSD EVENT 5

Date/Time	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/22/22 5:26	441609.6			0.7			1.59			0.67			2.69			0		
08/22/22 5:27	442533.8			0.7			1.59			0.67			2.69			0		
08/22/22 5:28	440762.4			0.7			1.59			0.67			2.68			0		
08/22/22 5:29	443997.1			0.7			1.59			0.68			2.7			0		
08/22/22 5:30	441378.5			0.7			1.69			0.67			2.85			0		
08/22/22 5:31	368675.5			0.7			1.69			0.56			2.38			1		
08/22/22 5:32	23952			0			2.43			0.04			0.22			0		
08/22/22 5:33	24029			0			167.17			162.89			15.33			0		
08/22/22 5:34	23875			0			0.1			0			0			0		
08/22/22 5:35	23720.9			0			0.1			0			0			0		
08/22/22 5:36	24260			0			0			0			0			0		

CT1 SUSD EVENT 6

Date/Time	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/26/22 5:35	3157.7			0			0			0			0			0		
08/26/22 5:36	0			0			0			0			0			0		
08/26/22 5:37	3157.7			0			0			0			0			0		
08/26/22 5:38	2002.4			0			0			0			0			0		
08/26/22 5:39	37891.9			0			0			0			0			0		
08/26/22 5:40	28187.8			0.1			0			0			0			1		
08/26/22 5:41	33347.9			0.1			0			0			0			1		
08/26/22 5:42	41357.6			1			0.2			0			0			1		
08/26/22 5:43	50753.5			1405.7			18.44			165.82			3.58			1		
08/26/22 5:44	61689.8			1146.2			16.52			164.2			3.89			1		
08/26/22 5:45	75783.7			657.5			21.31			115.83			6.18			1		
08/26/22 5:46	112135.3			430.7			25.37			112.22			10.88			1		
08/26/22 5:47	141863.4			292.1			34.6			96.3			18.77			1		
08/26/22 5:48	143095.7			205.7			46.36			68.36			25.36			1		
08/26/22 5:49	159654.1			1647.7			39.53			611.14			24.13			1		
08/26/22 5:50	178369			1960.1			44.43			812.14			30.3			1		
08/26/22 5:51	199856.5			1150.8			55.65			534.53			42.54			1		
08/26/22 5:52	223269.3			206.1			63.35			106.93			54.1			1		
08/26/22 5:53	243293.5			15.4			58.14			8.68			54.08			1		
08/26/22 5:54	270172			2.6			53.32			1.61			55.08			1		
08/26/22 5:55	290042.2			2			30.2			1.35			33.5			1		
08/26/22 5:56	294740.1			1.9			16.43			1.31			18.51			1		
08/26/22 5:57	294124			1.9			12.42			1.32			13.96			1		
08/26/22 5:58	294278			1.9			10.66			1.32			11.99			1		
08/26/22 5:59	307678.8			1.8			9.83			1.28			11.57			1		
08/26/22 6:00	324930.4			1.6			8.58			1.21			10.66			1		
08/26/22 6:01	343260.2			1.5			8.19			1.19			10.75			1		
08/26/22 6:02	360357.7			1.5			5.99			1.25			8.25			1		
08/26/22 6:03	378148.4			1.4			4.63			1.2			6.69			1		
08/26/22 6:04	400560.1			1.2			4.33			1.12			6.64			1		
08/26/22 6:05	422355.6			1			4.15			1			6.7			1		
08/26/22 6:06	443380.9			0.9			3.93			0.96			6.67			1		
08/26/22 6:07	446923.7			0.8			4.12			0.88			7.04			1		
08/26/22 6:08	445383.4			0.8			4.61			0.86			7.85			1		

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/26/22 6:09	445075.3			0.8			4.61			0.86			7.85			1		
08/26/22 6:10	445691.4			0.8			4.61			0.86			7.86			1		
08/26/22 6:11	445460.4			0.8			4.52			0.86			7.69			1		
08/26/22 6:12	444844.3			0.8			4.52			0.86			7.68			1		
08/26/22 6:13	445691.4			0.7			4.52			0.76			7.7			1		
08/26/22 6:14	444921.3			0.7			4.7			0.76			8			1		
08/26/22 6:15	445614.4			0.7			4.79			0.76			8.17			1		
08/26/22 6:16	445460.4			0.7			4.89			0.76			8.32			1		
08/26/22 6:17	445152.3			0.7			4.98			0.76			8.47			1		
08/26/22 6:18	445306.3			0.7			5.07			0.76			8.63			1		
08/26/22 6:19	445075.3			0.7			5.16			0.76			8.79			1		
08/26/22 6:20	445922.5			0.7			5.16			0.76			8.8			1		
08/26/22 6:21	446076.5			0.7			5.16			0.76			8.81			1		
08/26/22 6:22	445229.3			0.7			3.69			0.76			6.28			1		
08/26/22 6:23	445999.5			0.7			2.67			0.76			4.56			1		
08/26/22 6:24	446384.6			0.7			2.49			0.76			4.25			1		
08/26/22 6:25	445768.4			0.7			3.04			0.76			5.19			1		
08/26/22 6:26	445383.4			0.7			3.5			0.76			5.97			1		
08/26/22 6:27	445614.4			0.7			3.6			0.76			6.13			1		
08/26/22 6:28	445460.4			0.7			3.04			0.76			5.18			1		
08/26/22 6:29	445922.5			0.6			2.4			0.67			4.09			1		
08/26/22 6:30	446769.7			0.6			2.21			0.67			3.78			1		
08/26/22 6:31	446230.5			0.7			2.12			0.76			3.62			1		
08/26/22 6:32	446307.6			0.7			2.21			0.76			3.78			1		
08/26/22 6:33	445845.5			0.6			2.4			0.67			4.09			1		
08/26/22 6:34	446615.6			0.6			2.58			0.67			4.41			1		
08/26/22 6:35	446923.7			0.6			2.67			0.67			4.57			1		
08/26/22 6:36	439530.2			0.6			2.4			0.66			4.03			1		
08/26/22 6:37	424049.9			0.6			1.66			0.64			2.69			1		
08/26/22 6:38	415732.2			0.7			1.57			0.71			2.49			1		
08/26/22 6:39	399404.8			0.7			1.54			0.67			2.36			1		
08/26/22 6:40	387852.4			0.7			1.72			0.65			2.56			0		
08/26/22 6:41	382461.3			0.7			1.79			0.64			2.61			0		
08/26/22 6:42	381152			0.8			1.91			0.72			2.78			0		
08/26/22 6:43	378533.5			0.8			1.82			0.72			2.63			0		
08/26/22 6:44	377840.4			0.7			1.82			0.64			2.62			0		

CT1 SUSD EVENT 7

Date/Time	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/22/22 21:46	279028.9			0.7			1.69			0.43			1.81			0		
09/22/22 21:47	279645			0.6			1.78			0.37			1.91			0		
09/22/22 21:48	279491			0.6			1.69			0.37			1.81			0		
09/22/22 21:49	279028.9			0.6			1.69			0.37			1.81			0		
09/22/22 21:50	279722			0.6			1.5			0.37			1.61			0		
09/22/22 21:51	278951.8			0.6			1.5			0.37			1.61			1		
09/22/22 21:52	263240.6			0.6			1.4			0.35			1.42			1		
09/22/22 21:53	239519.7			0.6			1.71			0.32			1.58			1		
09/22/22 21:54	218648.3			0.5			5.5			0.26			4.63			1		
09/22/22 21:55	193310.1			0.4			14.03			0.2			10.43			1		
09/22/22 21:56	171745.6			4.9			18.19			1.97			12.02			1		
09/22/22 21:57	153569.8			339.8			21.35			121.93			12.61			1		
09/22/22 21:58	135086			1351.6			24.72			426.59			12.84			1		
09/22/22 21:59	27725.8			2021			28.36			131.2			3.03			1		
09/22/22 22:00	27340.7			0			44.25			399.64			4.65			0		
09/22/22 22:01	27571.7			0			0.2			0			0			0		
09/22/22 22:02	27494.7			0			0.1			0			0			0		
09/22/22 22:03	27648.7			0			0.1			0			0			0		
09/22/22 22:04	27725.8			0			0.1			0			0			0		

CT1 SUSD EVENT 8

Date/Time	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/23/22 12:31	32808.8			0			0			0			0			0		
09/23/22 12:32	32731.8			0			0			0			0			0		
09/23/22 12:33	32885.8			0			0			0			0			0		
09/23/22 12:34	32962.8			0			0			0			0			0		
09/23/22 12:35	32962.8			0			0			0			0			0		
09/23/22 12:36	33501.9			0			0			0			0			0		
09/23/22 12:37	40279.4			0.1			0			0			0			1		
09/23/22 12:38	43822.1			0.9			0.1			0			0			1		
09/23/22 12:39	52293.8			1175.6			20.65			143.68			4.15			1		
09/23/22 12:40	62151.9			1050.6			18.49			152.63			4.42			1		
09/23/22 12:41	73858.3			562.8			25.57			97.13			7.26			1		
09/23/22 12:42	102123.2			291.1			26.97			69.45			10.59			1		
09/23/22 12:43	138320.7			172.9			40.79			55.89			21.7			1		
09/23/22 12:44	147485.6			102.9			54.52			35.49			30.93			1		
09/23/22 12:45	148871.9			1331.5			50.25			463.17			28.76			1		
09/23/22 12:46	161194.4			1898.5			47.2			715.25			29.26			1		
09/23/22 12:47	180987.5			1660.9			50.15			702.65			34.92			1		
09/23/22 12:48	203091.1			477.4			49.92			226.57			38.99			1		
09/23/22 12:49	225425.8			57.7			50.28			30.37			43.59			1		
09/23/22 12:50	248299.5			3.8			46.37			2.19			44.28			1		
09/23/22 12:51	273483.7			2			37.72			1.28			39.67			1		
09/23/22 12:52	288732.9			1.8			16.75			1.22			18.6			1		
09/23/22 12:53	300285.3			1.7			11			1.19			12.7			1		
09/23/22 12:54	319077.2			1.7			9.08			1.29			11.14			1		
09/23/22 12:55	337715			1.6			8.67			1.27			11.26			1		
09/23/22 12:56	351038.8			1.4			6.35			1.17			8.57			1		
09/23/22 12:57	355351.7			1.4			5.54			1.13			7.57			1		
09/23/22 12:58	357816.2			1.2			5.36			0.97			7.38			1		
09/23/22 12:59	357508.2			1.1			5.27			0.9			7.25			1		
09/23/22 13:00	353580.3			1			5.1			0.81			6.93			1		
09/23/22 13:01	350191.6			1			5.01			0.8			6.74			1		
09/23/22 13:02	350191.6			1			4.92			0.8			6.62			1		
09/23/22 13:03	353580.3			0.9			4.56			0.74			6.2			1		
09/23/22 13:04	354658.6			0.9			4.45			0.75			6.07			1		

	CT1_GasFlow_CT_scfh_1M			CT1_CO_Ppmvdc_1M			CT1_NOx_Ppmvdc_1M			CT1_CO_LbPerHr_1M			CT1_NOx_LbPerHr_1M			CT1_SUSD_TF_1M		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/23/22 13:05	351346.9			0.8			4.45			0.67			6.01			1		
09/23/22 13:06	347419.1			0.8			4.38			0.65			5.85			1		
09/23/22 13:07	345955.8			0.8			4.47			0.65			5.95			1		
09/23/22 13:08	349113.4			0.8			4.47			0.66			6			1		
09/23/22 13:09	352502.1			0.8			4.45			0.67			6.03			1		
09/23/22 13:10	354812.6			0.7			4.36			0.6			5.95			1		
09/23/22 13:11	354042.4			0.7			4.36			0.6			5.93			1		
09/23/22 13:12	350961.8			0.7			4.45			0.6			6			1		
09/23/22 13:13	348035.2			0.7			4.54			0.59			6.08			1		
09/23/22 13:14	346186.8			0.7			4.63			0.59			6.16			1		
09/23/22 13:15	346802.9			0.7			4.36			0.59			5.81			1		
09/23/22 13:16	350345.7			0.7			3			0.59			4.04			1		
09/23/22 13:17	352887.2			0.7			2.27			0.6			3.08			1		
09/23/22 13:18	351346.9			0.7			2.36			0.6			3.19			1		
09/23/22 13:19	348112.2			0.7			3			0.59			4.01			1		
09/23/22 13:20	346032.8			0.7			3.18			0.59			4.23			1		
09/23/22 13:21	348882.3			0.7			3.27			0.59			4.38			1		
09/23/22 13:22	352271.1			0.7			2.72			0.6			3.69			1		
09/23/22 13:23	352656.1			0.7			2.27			0.6			3.08			1		
09/23/22 13:24	348035.2			0.7			2.18			0.59			2.92			1		
09/23/22 13:25	345647.7			0.7			2.18			0.59			2.9			1		
09/23/22 13:26	346725.9			0.7			2.27			0.59			3.03			1		
09/23/22 13:27	350268.7			0.7			2.36			0.59			3.18			1		
09/23/22 13:28	352733.2			0.7			2.45			0.6			3.33			1		
09/23/22 13:29	350191.6			0.7			2.36			0.59			3.18			1		
09/23/22 13:30	346725.9			0.7			2.27			0.59			3.03			1		
09/23/22 13:31	344492.4			0.7			2			0.58			2.65			1		
09/23/22 13:32	347419.1			0.7			1.82			0.59			2.43			1		
09/23/22 13:33	350730.8			0.7			1.63			0.6			2.2			1		
09/23/22 13:34	352733.2			0.7			1.54			0.6			2.09			1		
09/23/22 13:35	350037.6			0.7			1.63			0.59			2.2			0		
09/23/22 13:36	346340.8			0.7			1.72			0.59			2.3			0		
09/23/22 13:37	345185.6			0.7			1.82			0.59			2.41			0		
09/23/22 13:38	348728.3			0.7			1.91			0.59			2.56			0		
09/23/22 13:39	352964.2			0.7			1.91			0.6			2.59			0		

CT2 SUSD EVENT 1

Date/Time	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/01/22 17:12	0			0			0			0			0			0		
07/01/22 17:13	0			0			0			0			0			0		
07/01/22 17:14	0			0			0			0			0			0		
07/01/22 17:15	0			0			0			0			0			0		
07/01/22 17:16	0			0			0			0			0			0		
07/01/22 17:17	3773.8			0			0			0			0			1		
07/01/22 17:18	21333.4			0.3			0			0			0			1		
07/01/22 17:19	36274.5			67.9			26.55			5.74			3.7			1		
07/01/22 17:20	49444.3			979.8			18.81			112.95			3.57			1		
07/01/22 17:21	62228.9			588.8			26.08			85.4			6.23			1		
07/01/22 17:22	78787.3			365			28.1			66.99			8.49			1		
07/01/22 17:23	126075.1			227.8			37.45			66.9			18.1			1		
07/01/22 17:24	149334			132.9			52.88			46.25			30.29			1		
07/01/22 17:25	152491.6			378.7			58.45			134.53			34.17			1		
07/01/22 17:26	170667.4			1516.7			53.46			603.29			35			1		
07/01/22 17:27	190768.6			1007.3			55.56			447.79			40.65			1		
07/01/22 17:28	217262.1			316.5			56.79			160.27			47.32			1		
07/01/22 17:29	240828.9			33.3			56.95			18.71			52.6			1		
07/01/22 17:30	269016.8			2.6			55.6			1.64			57.35			1		
07/01/22 17:31	293507.9			1.5			40.38			1.04			45.45			1		
07/01/22 17:32	318538.1			1.5			17.79			1.09			21.74			1		
07/01/22 17:33	335866.7			1.7			11.8			1.33			15.2			1		
07/01/22 17:34	336559.8			1.8			10.1			1.4			13.04			1		
07/01/22 17:35	335866.7			1.7			8.31			1.33			10.71			1		
07/01/22 17:36	336713.8			1.5			8.01			1.17			10.35			1		
07/01/22 17:37	335712.6			1.3			7.93			1.03			10.2			1		
07/01/22 17:38	340333.6			1.2			7.66			0.98			10			1		
07/01/22 17:39	356044.8			1.1			7.4			0.95			10.1			1		
07/01/22 17:40	375760.9			1.1			6.08			1			8.76			1		
07/01/22 17:41	397479.4			1.1			4.74			0.99			7.22			1		
07/01/22 17:42	421739.5			1.1			4.08			1.07			6.61			1		
07/01/22 17:43	447308.8			0.9			4.06			0.96			6.96			1		
07/01/22 17:44	466100.7			0.8			4.12			0.92			7.37			1		
07/01/22 17:45	459092.2			0.8			5.16			0.89			9.09			1		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/01/22 17:46	458168			0.7			4.98			0.79			8.75			1		
07/01/22 17:47	466408.7			0.7			5.07			0.8			9.07			1		
07/01/22 17:48	466639.8			0.8			5.16			0.9			9.24			1		
07/01/22 17:49	452776.9			0.8			5.16			0.88			8.96			1		
07/01/22 17:50	442764.8			0.7			4.98			0.76			8.45			1		
07/01/22 17:51	453547.1			0.7			5.16			0.78			8.98			1		
07/01/22 17:52	441994.7			0.7			4.98			0.76			8.44			1		
07/01/22 17:53	417041.5			0.7			5.35			0.72			8.55			1		
07/01/22 17:54	396863.3			0.7			4.99			0.67			7.6			1		
07/01/22 17:55	383539.5			0.8			2.32			0.72			3.42			1		
07/01/22 17:56	381383.1			0.9			1.67			0.78			2.45			1		
07/01/22 17:57	384155.7			0.9			1.79			0.8			2.63			1		
07/01/22 17:58	396247.2			0.9			1.97			0.83			2.99			1		
07/01/22 17:59	419274.9			0.8			2.09			0.8			3.36			1		
07/01/22 18:00	440839.4			0.8			2.12			0.85			3.58			1		
07/01/22 18:01	456550.7			0.7			2.4			0.78			4.2			1		
07/01/22 18:02	459554.3			0.6			3.23			0.69			5.69			1		
07/01/22 18:03	460786.6			0.7			3.32			0.79			5.86			1		
07/01/22 18:04	457860			0.7			2.21			0.79			3.88			1		
07/01/22 18:05	458322.1			0.7			1.94			0.79			3.4			1		
07/01/22 18:06	466254.7			0.7			1.75			0.8			3.13			1		
07/01/22 18:07	470182.5			0.7			1.75			0.81			3.16			1		
07/01/22 18:08	466023.7			0.7			1.94			0.8			3.46			1		
07/01/22 18:09	467332.9			0.7			2.12			0.8			3.8			0		
07/01/22 18:10	470336.5			0.7			2.21			0.81			3.99			0		
07/01/22 18:11	468565.2			0.7			2.03			0.81			3.64			0		
07/01/22 18:12	469027.3			0.7			1.75			0.81			3.15			0		
07/01/22 18:13	468565.2			0.7			1.48			0.81			2.65			0		

CT2 SUSD EVENT 2

Date/Time	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/01/22 22:54	364516.6			0.9			1.48			0.74			2.06			0		
07/01/22 22:55	341873.9			0.9			1.21			0.69			1.59			0		
07/01/22 22:56	330244.5			1			1.21			0.73			1.54			0		
07/01/22 22:57	328704.2			1			1.43			0.75			1.8			0		
07/01/22 22:58	328319.1			0.9			1.43			0.68			1.8			0		
07/01/22 22:59	314148.2			0.8			1.25			0.59			1.51			1		
07/01/22 23:00	292352.6			0.8			1.27			0.56			1.42			1		
07/01/22 23:01	268554.7			0.7			1.48			0.46			1.52			1		
07/01/22 23:02	244525.7			0.7			3.87			0.39			3.63			1		
07/01/22 23:03	218879.4			0.5			9.48			0.27			7.96			1		
07/01/22 23:04	194696.4			3.2			19.32			1.47			14.43			1		
07/01/22 23:05	172977.9			222.1			23.73			89.54			15.75			1		
07/01/22 23:06	152337.6			949.9			27.99			337.23			16.35			1		
07/01/22 23:07	87490.1			1666.4			32.8			339.82			11.01			1		
07/01/22 23:08	0			0			38.89			0			0			0		
07/01/22 23:09	0			0			11.8			0			0			0		
07/01/22 23:10	0			0			0.1			0			0			0		
07/01/22 23:11	0			0			0.1			0			0			0		
07/01/22 23:12	0			0			0.1			0			0			0		

CT2 SUSD EVENT 3

Date/Time	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/05/22 15:13	0			0			0			0			0			0		
07/05/22 15:14	0			0			0			0			0			0		
07/05/22 15:15	0			0			0			0			0			0		
07/05/22 15:16	0			0			0			0			0			0		
07/05/22 15:17	0			0			0			0			0			0		
07/05/22 15:18	1078.2			0			0			0			0			1		
07/05/22 15:19	9473			-0.1			0			0			0			1		
07/05/22 15:20	29420.1			53.1			35.4			3.64			3.99			1		
07/05/22 15:21	43822.1			1236.5			14.75			126.22			2.48			1		
07/05/22 15:22	55143.4			932.9			16.31			119.87			3.45			1		
07/05/22 15:23	68390.2			544.9			19.77			86.84			5.18			1		
07/05/22 15:24	101353			361.8			23.33			85.44			9.07			1		
07/05/22 15:25	142402.5			217.6			24.09			72.17			13.15			1		
07/05/22 15:26	147485.6			147.5			44.25			50.68			25.02			1		
07/05/22 15:27	163890			1031.8			39.64			394.01			24.91			1		
07/05/22 15:28	184376.2			1503.1			44.88			645.66			31.73			1		
07/05/22 15:29	208174.2			671.5			55.89			325.73			44.62			1		
07/05/22 15:30	234359.6			115.3			59			62.99			53.03			1		
07/05/22 15:31	258465.6			7.9			57.7			4.76			57.2			1		
07/05/22 15:32	286114.3			1.9			50.57			1.26			55.48			1		
07/05/22 15:33	306677.6			1.6			24.17			1.16			28.43			1		
07/05/22 15:34	313994.1			1.6			15.02			1.18			18.09			1		
07/05/22 15:35	326085.6			1.7			12.34			1.29			15.43			1		
07/05/22 15:36	324237.3			1.6			11.8			1.22			14.67			1		
07/05/22 15:37	323082			1.5			10.91			1.14			13.51			1		
07/05/22 15:38	322157.8			1.5			10.19			1.14			12.59			1		
07/05/22 15:39	321849.8			1.4			9.74			1.07			12.03			1		
07/05/22 15:40	319539.3			1.3			9.26			0.95			11.34			1		
07/05/22 15:41	320694.5			1.2			8.71			0.88			10.72			1		
07/05/22 15:42	319385.3			1.2			8.26			0.88			10.12			1		
07/05/22 15:43	330321.5			1.1			7.9			0.84			10			1		
07/05/22 15:44	340256.6			1			7.81			0.79			10.19			1		
07/05/22 15:45	337638			1			7.06			0.77			9.14			1		
07/05/22 15:46	338100.1			1			6.88			0.77			8.93			1		

CT2_GasFlow_CT_scfh_1M				CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/05/22 15:47	336559.8			1			6.79			0.77			8.77			1		
07/05/22 15:48	335481.6			1			6.9			0.78			8.87			1		
07/05/22 15:49	333710.2			0.9			6.81			0.71			8.71			1		
07/05/22 15:50	334018.3			0.9			6.81			0.71			8.72			1		
07/05/22 15:51	337407			0.9			6.9			0.71			8.93			1		
07/05/22 15:52	335404.6			0.9			6.9			0.71			8.87			1		
07/05/22 15:53	336097.7			0.9			6.72			0.71			8.66			1		
07/05/22 15:54	338023.1			0.9			6.72			0.72			8.71			1		
07/05/22 15:55	334634.4			0.9			6.54			0.71			8.39			1		
07/05/22 15:56	318923.2			0.9			6.44			0.67			7.88			1		
07/05/22 15:57	316535.7			0.8			6.9			0.6			8.37			1		
07/05/22 15:58	323929.2			0.7			6.91			0.56			8.59			1		
07/05/22 15:59	345647.7			0.7			7.17			0.58			9.5			1		
07/05/22 16:00	358124.3			0.7			6.62			0.6			9.09			1		
07/05/22 16:01	350730.8			0.7			5.1			0.58			6.85			1		
07/05/22 16:02	346032.8			0.8			5.01			0.65			6.64			1		
07/05/22 16:03	353195.3			0.8			5.11			0.65			6.92			1		
07/05/22 16:04	372988.3			0.8			4.14			0.69			5.92			1		
07/05/22 16:05	391703.3			0.8			3.04			0.73			4.57			1		
07/05/22 16:06	402870.6			0.7			2.81			0.68			4.35			1		
07/05/22 16:07	405027			0.7			2.77			0.7			4.3			1		
07/05/22 16:08	416964.5			0.6			3			0.62			4.79			1		
07/05/22 16:09	437758.8			0.6			3.18			0.65			5.33			1		
07/05/22 16:10	458784.2			0.6			3.13			0.69			5.51			1		
07/05/22 16:11	465407.5			0.7			3.37			0.71			6.02			1		
07/05/22 16:12	465330.5			0.6			3.69			0.7			6.58			1		
07/05/22 16:13	460940.6			0.6			2.4			0.69			4.24			1		
07/05/22 16:14	457705.9			0.6			1.84			0.69			3.24			1		
07/05/22 16:15	462789			0.6			1.75			0.7			3.11			1		
07/05/22 16:16	465484.5			0.6			1.94			0.7			3.46			1		
07/05/22 16:17	460324.5			0.7			2.21			0.79			3.91			1		
07/05/22 16:18	454394.3			0.7			2.4			0.78			4.18			1		
07/05/22 16:19	462943			0.7			2.58			0.8			4.59			1		
07/05/22 16:20	465561.6			0.7			2.3			0.81			4.19			1		
07/05/22 16:21	460478.5			1.4			1.88			1.59			3.43			1		
07/05/22 16:22	453547.1			2.7			1.59			2.99			2.86			1		
07/05/22 16:23	454779.3			3.3			1.41			3.69			2.56			1		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/05/22 16:24	466331.7			2.7			1.5			3.07			2.77			1		
07/05/22 16:25	466331.7			2.2			1.67			2.47			3.09			0		
07/05/22 16:26	463020			2.1			1.85			2.35			3.38			0		
07/05/22 16:27	457860			2			2.03			2.23			3.67			0		
07/05/22 16:28	453932.1			1.9			2.2			2.15			4.02			0		
07/05/22 16:29	459169.2			1.7			2.17			1.98			4.07			0		

CT2 SUSD EVENT 4

Date/Time	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/05/22 21:48	287346.6			0.6			1.43			0.38			1.57			0		
07/05/22 21:49	287038.5			0.6			1.31			0.38			1.44			0		
07/05/22 21:50	289272			0.6			1.31			0.38			1.45			0		
07/05/22 21:51	287038.5			0.6			1.31			0.38			1.44			0		
07/05/22 21:52	287038.5			0.6			1.31			0.38			1.44			0		
07/05/22 21:53	287038.5			0.6			1.43			0.38			1.57			1		
07/05/22 21:54	273175.7			0.6			1.43			0.36			1.5			1		
07/05/22 21:55	247760.4			0.5			2.13			0.28			2.02			1		
07/05/22 21:56	224270.5			0.5			7.35			0.27			6.32			1		
07/05/22 21:57	199163.3			2.4			11.12			1.11			8.49			1		
07/05/22 21:58	174903.3			127			15.65			51.76			10.5			1		
07/05/22 21:59	154956.1			700			19.77			252.76			11.74			1		
07/05/22 22:00	113213.5			1392.9			23.44			367.6			10.18			1		
07/05/22 22:01	0			0			28.63			0			0			0		
07/05/22 22:02	0			0			23.6			0			0			0		
07/05/22 22:03	0			0			0.2			0			0			0		
07/05/22 22:04	0			0			0.1			0			0			0		
07/05/22 22:05	0			0			0.1			0			0			0		

CT2 SUSD EVENT 5

Date/Time	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/06/22 16:46	0			0			0			0			0			0		
07/06/22 16:47	0			0			0			0			0			0		
07/06/22 16:48	0			0			0			0			0			0		
07/06/22 16:49	0			0			0			0			0			0		
07/06/22 16:50	0			0			0			0			0			0		
07/06/22 16:51	1155.2			0			0			0			0			1		
07/06/22 16:52	22719.7			1.2			0.1			0			0			1		
07/06/22 16:53	37660.8			1222			20.65			107.23			2.98			1		
07/06/22 16:54	50214.4			1090.4			18.07			127.65			3.48			1		
07/06/22 16:55	62151.9			673.5			23.6			97.55			5.63			1		
07/06/22 16:56	81945			429.3			26.41			81.97			8.3			1		
07/06/22 16:57	130003			287.6			34.37			87.09			17.13			1		
07/06/22 16:58	154879.1			177.7			50.48			64.11			29.98			1		
07/06/22 16:59	196698.8			431.3			56.23			197.7			42.43			1		
07/06/22 17:00	223269.3			470.8			60.24			244.9			51.58			1		
07/06/22 17:01	247144.3			39.5			55.36			22.77			52.47			1		
07/06/22 17:02	272482.5			1.8			55.33			1.13			57.82			1		
07/06/22 17:03	299130			1.2			39.37			0.85			45.16			1		
07/06/22 17:04	321541.7			1.1			17.98			0.83			22.17			1		
07/06/22 17:05	331322.7			1.3			12.5			1.02			15.89			1		
07/06/22 17:06	330244.5			1.4			11.54			1.08			14.61			1		
07/06/22 17:07	332015.8			1.5			9.95			1.16			12.67			1		
07/06/22 17:08	327163.8			1.4			9.07			1.07			11.38			1		
07/06/22 17:09	324930.4			1.3			8.1			1			10.1			1		
07/06/22 17:10	325392.5			1.2			7.87			0.88			9.82			1		
07/06/22 17:11	326855.8			1.1			7.24			0.82			9.08			1		
07/06/22 17:12	323852.2			1			7.06			0.74			8.77			1		
07/06/22 17:13	323313.1			1			6.79			0.74			8.42			1		
07/06/22 17:14	321156.6			1			6.62			0.74			8.15			1		
07/06/22 17:15	321310.6			0.9			6.7			0.67			8.26			1		
07/06/22 17:16	320078.4			0.9			6.63			0.68			8.13			1		
07/06/22 17:17	318769.1			0.9			6.72			0.67			8.21			1		
07/06/22 17:18	319462.3			0.8			6.72			0.61			8.23			1		
07/06/22 17:19	319385.3			0.8			6.72			0.61			8.23			1		

CT2_GasFlow_CT_scfh_1M				CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/06/22 17:20	319770.3			0.8			6.81			0.61			8.35			1		
07/06/22 17:21	319847.3			0.8			7.01			0.62			8.6			1		
07/06/22 17:22	320232.4			0.8			7.01			0.62			8.61			1		
07/06/22 17:23	314687.3			0.7			7.1			0.54			8.57			1		
07/06/22 17:24	294201			0.7			7.1			0.51			8.01			1		
07/06/22 17:25	285190.2			0.7			8.15			0.5			8.91			1		
07/06/22 17:26	284188.9			0.7			10.37			0.44			11.3			1		
07/06/22 17:27	282725.6			0.6			10.75			0.38			11.66			1		
07/06/22 17:28	283572.8			0.6			11.04			0.38			12			1		
07/06/22 17:29	284034.9			0.6			11.23			0.38			12.23			1		
07/06/22 17:30	283803.8			0.6			11.32			0.38			12.32			1		
07/06/22 17:31	284497			0.6			10.37			0.38			11.32			1		
07/06/22 17:32	283264.8			1	X		7.81	X		0.69	X		8.48	X		1		
07/06/22 17:33	283033.7			0.6	X		5.57	X		0.37	X		6.04	X		1		
07/06/22 17:34	282879.7			0.5	X		4.74	X		0.32	X		5.14	X		1		
07/06/22 17:35	283033.7			0.6	X		4.35	X		0.38	X		4.72	X		1		
07/06/22 17:36	284343			0.6	X		4.06	X		0.38	X		4.43	X		1		
07/06/22 17:37	284266			0.6	X		3.68	X		0.38	X		4.01	X		1		
07/06/22 17:38	282571.6			0.6	X		3.39	X		0.38	X		3.67	X		1		
07/06/22 17:39	283110.7			0.5	X		3.1	X		0.32	X		3.36	X		1		
07/06/22 17:40	282725.6			0.5			2.9			0.32			3.15			1		
07/06/22 17:41	282725.6			0.5			2.71			0.32			2.94			1		
07/06/22 17:42	282725.6			0.5			2.61			0.32			2.83			1		
07/06/22 17:43	284034.9			0.5			2.42			0.32			2.63			1		
07/06/22 17:44	299438.1			0.5			2.32			0.34			2.67			1		
07/06/22 17:45	315765.5			0.5			2.09			0.35			2.54			1		
07/06/22 17:46	316458.6			0.6			1.59			0.41			1.93			1		
07/06/22 17:47	311914.7			0.6			1.38			0.4			1.65			1		
07/06/22 17:48	321849.8			0.7			1.22			0.49			1.5			1		
07/06/22 17:49	343645.3			0.6			1.11			0.52			1.46			0		
07/06/22 17:50	361590			0.7			1.09			0.61			1.51			0		
07/06/22 17:51	373450.4			0.7			0.82			0.63			1.17			0		
07/06/22 17:52	371294			0.8			0.64			0.71			0.9			0		
07/06/22 17:53	379765.8			0.7			0.63			0.63			0.91			0		

CT2 SUSD EVENT 6

Date/Time	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/06/22 22:02	285575.2			0.5			1.24			0.32			1.35			0		
07/06/22 22:03	284651			0.5			1.24			0.32			1.35			0		
07/06/22 22:04	284651			0.5			1.33			0.32			1.45			0		
07/06/22 22:05	285113.1			0.5			1.33			0.32			1.46			0		
07/06/22 22:06	284343			0.5			1.43			0.32			1.56			0		
07/06/22 22:07	286422.4			0.5			1.52			0.32			1.67			1		
07/06/22 22:08	275255.1			0.5			1.4			0.3			1.48			1		
07/06/22 22:09	250995			0.6			1.9			0.33			1.83			1		
07/06/22 22:10	229276.5			0.5			6			0.27			5.28			1		
07/06/22 22:11	201704.8			2.5			10.55			1.17			8.16			1		
07/06/22 22:12	179139.2			2.8			14.19			1.15			9.75			1		
07/06/22 22:13	157189.6			627.6			17.7			229.82			10.67			1		
07/06/22 22:14	138166.7			1383.1			22.13			445.19			11.72			1		
07/06/22 22:15	0			1775.5			27.6			0			0			1		
07/06/22 22:16	0			0			23.6			0			0			0		
07/06/22 22:17	0			0			0.1			0			0			0		
07/06/22 22:18	0			0			0.1			0			0			0		
07/06/22 22:19	0			0			0.1			0			0			0		
07/06/22 22:20	0			0			0.1			0			0			0		

CT2 SUSD EVENT 7

Date/Time	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/07/22 14:51	0			0			0			0			0			0		
07/07/22 14:52	0			0			0			0			0			0		
07/07/22 14:53	0			0			0			0			0			0		
07/07/22 14:54	0			0			0			0			0			0		
07/07/22 14:55	0			0			0			0			0			0		
07/07/22 14:56	4158.9			0			0			0			0			1		
07/07/22 14:57	19947.1			0			0			0			0			1		
07/07/22 14:58	35658.4			44.8			24.78			3.72			3.39			1		
07/07/22 14:59	48289			1124.1			16.91			126.57			3.13			1		
07/07/22 15:00	59533.3			729			23.6			101.17			5.39			1		
07/07/22 15:01	73242.2			423.1			26.13			72.17			7.33			1		
07/07/22 15:02	116448.1			286.7			34.33			77.78			15.33			1		
07/07/22 15:03	148486.8			164.3			45.38			56.86			25.85			1		
07/07/22 15:04	155110.2			180.8			58.24			65.36			34.65			1		
07/07/22 15:05	174287.1			1248.8			52.92			507.1			35.37			1		
07/07/22 15:06	196544.8			841.8			54.38			385.53			40.99			1		
07/07/22 15:07	223500.3			221.4			55.21			115.32			47.33			1		
07/07/22 15:08	249762.8			18.3			55.19			10.66			52.86			1		
07/07/22 15:09	274793			2			53.54			1.26			56.43			1		
07/07/22 15:10	301671.6			1.5			30.9			1.05			35.74			1		
07/07/22 15:11	319847.3			1.5			15.52			1.08			19.04			1		
07/07/22 15:12	340872.7			1.5			11.17			1.21			14.61			1		
07/07/22 15:13	342336			1.6			9.92			1.28			13.03			1		
07/07/22 15:14	344261.4			1.5			8.01			1.2			10.58			1		
07/07/22 15:15	342182			1.4			7.75			1.12			10.17			1		
07/07/22 15:16	344954.5			1.3			7.49			1.06			9.9			1		
07/07/22 15:17	343953.3			1.2			7.22			0.99			9.53			1		
07/07/22 15:18	342952.1			1.1			6.96			0.91			9.15			1		
07/07/22 15:19	342875.1			1.1			6.87			0.91			9.03			1		
07/07/22 15:20	342644.1			1.1			6.78			0.84			8.91			1		
07/07/22 15:21	341873.9			1.1			6.69			0.84			8.77			1		
07/07/22 15:22	340718.7			1			6.69			0.77			8.75			1		
07/07/22 15:23	341873.9			1			6.79			0.78			8.91			1		
07/07/22 15:24	340487.6			1			6.79			0.78			8.87			1		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/07/22 15:25	339948.5			0.9			6.79			0.71			8.86			1		
07/07/22 15:26	340564.6			0.9			6.79			0.71			8.87			1		
07/07/22 15:27	341488.8			0.9			6.88			0.71			9.01			1		
07/07/22 15:28	342104.9			0.9			6.88			0.71			9.03			1		
07/07/22 15:29	343183.2			0.9			6.88			0.71			9.06			1		
07/07/22 15:30	343106.2			0.9			6.88			0.71			9.06			1		
07/07/22 15:31	339255.3			0.9			6.79			0.71			8.84			1		
07/07/22 15:32	320925.6			0.8			6.88			0.6			8.47			1		
07/07/22 15:33	315534.4			0.8			7.17			0.6			8.68			1		
07/07/22 15:34	309681.2			0.7			6.91			0.53			8.21			1		
07/07/22 15:35	302441.7			0.7			5.16			0.52			5.99			1		
07/07/22 15:36	297204.6			0.6			4.79			0.45			5.46			1		
07/07/22 15:37	291890.5			0.7			5.43			0.45			6.08			1		
07/07/22 15:38	285729.3			0.7			4.31			0.44			4.72			1		
07/07/22 15:39	285498.2			0.6			3.62			0.38			3.96			1		
07/07/22 15:40	284728.1			0.6			3.33			0.38			3.64			1		
07/07/22 15:41	284343			0.5			3.24			0.32			3.53			1		
07/07/22 15:42	284805.1			0.5			3.33			0.32			3.64			1		
07/07/22 15:43	297666.7			0.6			3.33			0.4			3.8			1		
07/07/22 15:44	317767.9			0.6			2.76			0.42			3.36			1		
07/07/22 15:45	341642.8			0.6			1.87			0.45			2.45			1		
07/07/22 15:46	352271.1			0.6			1.84			0.53			2.49			1		
07/07/22 15:47	351038.8			0.8			1.54			0.67			2.08			1		
07/07/22 15:48	349421.5			0.8			1.34			0.66			1.8			1		
07/07/22 15:49	350576.7			0.8			1.52			0.66			2.04			0		
07/07/22 15:50	347650.1			0.8			1.61			0.65			2.15			0		
07/07/22 15:51	353503.3			0.8			1.7			0.66			2.3			0		
07/07/22 15:52	351038.8			0.8			1.79			0.66			2.41			0		
07/07/22 15:53	352271.1			0.8			1.88			0.66			2.54			0		

CT2 SUSD EVENT 8

CT2_GasFlow_CT_scfh_1M				CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/07/22 23:19	283264.8			0.5			1.33			0.31			1.45			0		
07/07/22 23:20	282648.6			0.5			1.24			0.31			1.34			0		
07/07/22 23:21	283341.8			0.5			1.24			0.31			1.34			0		
07/07/22 23:22	284111.9			0.5			1.24			0.32			1.35			0		
07/07/22 23:23	282494.6			0.5			1.24			0.31			1.34			0		
07/07/22 23:24	278258.7			0.5			1.33			0.31			1.42			1		
07/07/22 23:25	255308			0.5			1.43			0.28			1.4			1		
07/07/22 23:26	230585.8			0.4			4.58			0.22			4.05			1		
07/07/22 23:27	204400.4			1.2			9.46			0.58			7.42			1		
07/07/22 23:28	180910.5			9.2			12.43			3.86			8.62			1		
07/07/22 23:29	160886.4			496.2			15.59			186.03			9.62			1		
07/07/22 23:30	140939.2			1242			20.57			407.86			11.12			1		
07/07/22 23:31	0			1727			26			0			0			1		
07/07/22 23:32	0			0			28.03			0			0			0		
07/07/22 23:33	0			0			0.1			0			0			0		
07/07/22 23:34	0			0			0.1			0			0			0		
07/07/22 23:35	0			0			0.1			0			0			0		
07/07/22 23:36	0			0			0.1			0			0			0		

CT2 SUSD EVENT 9

Date/Time	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/08/22 14:02	0			0			0			0			0			0		
07/08/22 14:03	0			0			0			0			0			0		
07/08/22 14:04	0			0			0			0			0			0		
07/08/22 14:05	0			0			0			0			0			0		
07/08/22 14:06	0			0			0			0			0			0		
07/08/22 14:07	6469.3			0			0			0			0			1		
07/08/22 14:08	23720.9			0.8			0.1			0			0			1		
07/08/22 14:09	38508			1135.4			17.04			101.92			2.52			1		
07/08/22 14:10	50753.5			1048.7			17.33			123.95			3.37			1		
07/08/22 14:11	62768			620.1			22.98			90.64			5.53			1		
07/08/22 14:12	85179.7			367.1			25.21			72.9			8.24			1		
07/08/22 14:13	131697.3			240.1			34.12			73.69			17.23			1		
07/08/22 14:14	150874.3			140.5			48.89			49.42			28.29			1		
07/08/22 14:15	190229.5			427.8			52.92			189.63			38.6			1		
07/08/22 14:16	220111.7			527.9			58.53			270.72			49.4			1		
07/08/22 14:17	246759.2			32.9			57.37			18.91			54.29			1		
07/08/22 14:18	274099.8			1.7			54.52			1.12			57.3			1		
07/08/22 14:19	299900.2			1.2			37.8			0.84			43.48			1		
07/08/22 14:20	307909.8			1.2			16.61			0.85			19.61			1		
07/08/22 14:21	308294.9			1.3			11			0.96			13			1		
07/08/22 14:22	309373.2			1.4			10.17			0.98			12.06			1		
07/08/22 14:23	307678.8			1.3			9.17			0.91			10.82			1		
07/08/22 14:24	318615.1			1.2			8.94			0.89			10.93			1		
07/08/22 14:25	339717.5			1.1			8.48			0.88			11.05			1		
07/08/22 14:26	344877.5			1.1			7.44			0.88			9.84			1		
07/08/22 14:27	343183.2			1.1			5.99			0.86			7.88			1		
07/08/22 14:28	343183.2			1.1			5.9			0.85			7.77			1		
07/08/22 14:29	338947.3			1.1			6.08			0.83			7.9			1		
07/08/22 14:30	340179.6			1			6.08			0.77			7.93			1		
07/08/22 14:31	338793.3			1			6.17			0.78			8.01			1		
07/08/22 14:32	339024.3			0.9			6.26			0.71			8.14			1		
07/08/22 14:33	337869.1			0.9			6.26			0.7			8.11			1		
07/08/22 14:34	339409.4			0.9			6.35			0.71			8.26			1		
07/08/22 14:35	338254.2			0.8			6.35			0.63			8.23			1		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/08/22 14:36	340256.6			0.8			6.35			0.64			8.28			1		
07/08/22 14:37	340410.6			0.8			6.35			0.64			8.29			1		
07/08/22 14:38	337869.1			0.8			6.35			0.63			8.22			1		
07/08/22 14:39	338870.3			0.8			6.44			0.64			8.37			1		
07/08/22 14:40	342413			0.8			6.62			0.64			8.69			1		
07/08/22 14:41	340179.6			0.8			6.62			0.64			8.63			1		
07/08/22 14:42	331014.7			0.8			6.53			0.62			8.28			1		
07/08/22 14:43	333633.2			0.8			6.97			0.63			8.92			1		
07/08/22 14:44	332015.8			0.8			6.81			0.63			8.67			1		
07/08/22 14:45	323852.2			0.8			4.74			0.61			5.88			1		
07/08/22 14:46	321695.7			0.8			4.08			0.61			5.04			1		
07/08/22 14:47	314456.2			0.7			4.18			0.53			5.04			1		
07/08/22 14:48	308526			0.7			4.43			0.53			5.24			1		
07/08/22 14:49	304675.2			0.6			4.52			0.46			5.28			1		
07/08/22 14:50	302210.7			0.6			4.52			0.45			5.24			1		
07/08/22 14:51	300901.4			0.7			3.75			0.46			4.32			1		
07/08/22 14:52	301517.5			0.6			2.53			0.39			2.92			1		
07/08/22 14:53	300978.4			0.6			2.15			0.39			2.49			1		
07/08/22 14:54	300208.3			0.6			2.25			0.39			2.59			1		
07/08/22 14:55	299438.1			0.6			2.43			0.39			2.8			1		
07/08/22 14:56	296357.5			0.6			2.66			0.39			3.03			1		
07/08/22 14:57	297050.6			0.6			2.76			0.4			3.14			1		
07/08/22 14:58	306215.5			0.6			2.76			0.41			3.24			1		
07/08/22 14:59	323467.1			0.6			2.28			0.43			2.83			1		
07/08/22 15:00	327009.8			0.6			1.87			0.43			2.35			1		
07/08/22 15:01	323698.1			0.6			1.57			0.49			1.95			1		
07/08/22 15:02	321926.8			0.6			1.38			0.48			1.71			1		
07/08/22 15:03	323544.1			0.6			1.38			0.49			1.72			1		
07/08/22 15:04	324776.3			0.6			1.48			0.49			1.84			0		
07/08/22 15:05	324930.4			0.6			1.54			0.48			1.92			0		
07/08/22 15:06	324853.4			0.6			1.72			0.48			2.15			0		
07/08/22 15:07	323621.1			0.6			1.82			0.48			2.25			0		
07/08/22 15:08	326316.7			0.7			1.82			0.55			2.27			0		

CT2 SUSD EVENT 10

CT2_GasFlow_CT_scfh_1M				CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/08/22 18:17	286422.4			0.5			1.35			0.32			1.49			0		
07/08/22 18:18	282571.6			0.5			1.35			0.32			1.47			0		
07/08/22 18:19	283957.9			0.5			1.45			0.32			1.58			0		
07/08/22 18:20	283495.8			0.5			1.45			0.32			1.58			0		
07/08/22 18:21	283495.8			0.5			1.55			0.32			1.68			0		
07/08/22 18:22	281108.3			0.5			1.55			0.32			1.67			1		
07/08/22 18:23	264549.9			0.5			1.55			0.3			1.57			1		
07/08/22 18:24	239288.6			0.5			2.75			0.27			2.53			1		
07/08/22 18:25	213026.2			0.4			8.32			0.21			6.8			1		
07/08/22 18:26	187456.9			2.2			15.96			0.96			11.47			1		
07/08/22 18:27	166123.5			115.5			19.4			44.71			12.36			1		
07/08/22 18:28	143326.7			690.9			22.69			230.75			12.47			1		
07/08/22 18:29	84255.5			1486.6			26.38			291.84			8.52			1		
07/08/22 18:30	0			0			28.1			0			0			0		
07/08/22 18:31	0			0			0.2			0			0			0		
07/08/22 18:32	0			0			0.1			0			0			0		
07/08/22 18:33	0			0			0.1			0			0			0		
07/08/22 18:34	0			0			0.1			0			0			0		

CT2 SUSD EVENT 11

Date/Time	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/10/22 14:53	0			0			0			0			0			0		
07/10/22 14:54	0			0			0			0			0			0		
07/10/22 14:55	0			0			0			0			0			0		
07/10/22 14:56	0			0			0			0			0			0		
07/10/22 14:57	1848.4			0			0			0			0			0		
07/10/22 14:58	6161.3			0			0			0			0			1		
07/10/22 14:59	23258.8			0			0			0			0			1		
07/10/22 15:00	36890.7			47.2			21.24			4.06			3			1		
07/10/22 15:01	50060.4			1008.5			14.01			117.62			2.69			1		
07/10/22 15:02	61535.8			633.2			18.01			90.85			4.25			1		
07/10/22 15:03	78094.2			370			23.32			67.34			6.98			1		
07/10/22 15:04	123841.7			219.6			25.14			63.36			11.94			1		
07/10/22 15:05	149642			125.9			44.36			43.9			25.46			1		
07/10/22 15:06	174364.2			206.7			56.05			83.97			37.48			1		
07/10/22 15:07	193618.2			656.7			59.98			296.35			44.55			1		
07/10/22 15:08	218802.4			200.5			65.04			102.22			54.59			1		
07/10/22 15:09	244679.8			18.7			63.02			10.66			59.13			1		
07/10/22 15:10	270634.1			1.4			60			0.91			62.27			1		
07/10/22 15:11	295741.3			1			41.91			0.7			47.54			1		
07/10/22 15:12	320694.5			1.1			18.53			0.83			22.79			1		
07/10/22 15:13	340256.6			1.3			12.6			0.99			16.45			1		
07/10/22 15:14	347573.1			1.4			10.37			1.16			13.82			1		
07/10/22 15:15	344646.5			1.4			9.03			1.15			11.93			1		
07/10/22 15:16	346879.9			1.4			7.96			1.16			10.58			1		
07/10/22 15:17	342875.1			1.4			7.33			1.14			9.64			1		
07/10/22 15:18	342875.1			1.3			6.53			1.07			8.58			1		
07/10/22 15:19	339948.5			1.3			5.99			0.99			7.81			1		
07/10/22 15:20	342721.1			1.2			5.63			0.94			7.4			1		
07/10/22 15:21	340256.6			1.1			5.45			0.86			7.11			1		
07/10/22 15:22	337561			1			5.26			0.79			6.82			1		
07/10/22 15:23	338716.3			1			5.08			0.79			6.6			1		
07/10/22 15:24	337561			1			4.9			0.79			6.35			1		
07/10/22 15:25	335866.7			1			4.81			0.78			6.2			1		
07/10/22 15:26	335866.7			0.9			4.89			0.72			6.29			1		

CT2_GasFlow_CT_scfh_1M				CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/10/22 15:27	333787.2			0.8			4.79			0.65			6.14			1		
07/10/22 15:28	335789.6			0.9			4.79			0.72			6.17			1		
07/10/22 15:29	334172.3			0.9			4.7			0.72			6.03			1		
07/10/22 15:30	337021.9			0.9			4.7			0.72			6.08			1		
07/10/22 15:31	336174.7			0.8			4.7			0.65			6.06			1		
07/10/22 15:32	336482.8			0.8			4.79			0.65			6.19			1		
07/10/22 15:33	337869.1			0.8			4.79			0.65			6.21			1		
07/10/22 15:34	334865.4			0.8			4.89			0.65			6.27			1		
07/10/22 15:35	338023.1			0.8			4.98			0.65			6.45			1		
07/10/22 15:36	340564.6			0.8			5.07			0.66			6.62			1		
07/10/22 15:37	324776.3			0.8			5.25			0.63			6.54			1		
07/10/22 15:38	316612.7			0.8			4.89			0.61			5.93			1		
07/10/22 15:39	316920.7			0.8			7.02			0.62			8.54			1		
07/10/22 15:40	311221.5			0.7			6.46			0.54			7.71			1		
07/10/22 15:41	304983.3			0.8			2.66			0.54			3.12			1		
07/10/22 15:42	299515.1			0.7			1.05			0.46			1.2			1		
07/10/22 15:43	304675.2			0.7			1.16			0.48			1.36			1		
07/10/22 15:44	326162.7			0.7			1.35			0.51			1.69			1		
07/10/22 15:45	347804.1			0.7			2.47			0.54			3.3			0		
07/10/22 15:46	356892			0.7			2.12			0.61			2.9			0		
07/10/22 15:47	358663.4			0.7			1.03			0.63			1.42			0		
07/10/22 15:48	365363.8			0.7			1.03			0.64			1.44			0		
07/10/22 15:49	381999.2			0.7			1.12			0.67			1.65			0		

CT2 SUSD EVENT 12

Date/Time	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/13/22 23:49	285652.3			0.6			1.22			0.37			1.33			0		
07/13/22 23:50	285113.1			0.5			1.22			0.31			1.33			0		
07/13/22 23:51	285344.2			0.5			1.22			0.31			1.33			0		
07/13/22 23:52	283880.9			0.5			1.31			0.31			1.43			0		
07/13/22 23:53	284343			0.5			1.4			0.31			1.53			0		
07/13/22 23:54	281955.5			0.5			1.5			0.31			1.62			1		
07/13/22 23:55	259543.8			0.5			1.71			0.29			1.71			1		
07/13/22 23:56	235745.9			0.4			4.52			0.22			4.09			1		
07/13/22 23:57	210484.7			0.4			9.87			0.21			7.97			1		
07/13/22 23:58	186455.7			5.2			15.77			2.25			11.28			1		
07/13/22 23:59	164198			362.5			18.93			138.68			11.92			1		
07/14/22 0:00	144790			1044			23.6			352.18			13.1			1		
07/14/22 0:01	34349.1			1659.3			28.43			132.97			3.75			1		
07/14/22 0:02	0			0			35.4			0			0			0		
07/14/22 0:03	0			0			0.2			0			0			0		
07/14/22 0:04	0			0			0.1			0			0			0		
07/14/22 0:05	0			0			0.1			0			0			0		
07/14/22 0:06	0			0			0.1			0			0			0		

CT2 SUSD EVENT 13

Date/Time	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/14/22 13:03	0			0			0			0			0			0		
07/14/22 13:04	0			0			0			0			0			0		
07/14/22 13:05	0			0			0			0			0			0		
07/14/22 13:06	0			0			0			0			0			0		
07/14/22 13:07	0			0			0			0			0			0		
07/14/22 13:08	6777.4			0			0			0			0			1		
07/14/22 13:09	19793.1			0			0			0			0			1		
07/14/22 13:10	36428.6			65.9			21.63			5.59			3.02			1		
07/14/22 13:11	47903.9			1083.4			14.75			121.01			2.71			1		
07/14/22 13:12	59379.3			687.8			21.43			95.15			4.88			1		
07/14/22 13:13	76091.8			412.2			25.57			73.07			7.46			1		
07/14/22 13:14	118989.7			260.9			31.55			72.35			14.4			1		
07/14/22 13:15	146099.3			142.7			45.01			48.58			25.22			1		
07/14/22 13:16	150027.1			242.1			52.92			84.64			30.45			1		
07/14/22 13:17	164737.2			1397.6			49.35			536.53			31.18			1		
07/14/22 13:18	185993.6			1051.8			50.97			455.83			36.35			1		
07/14/22 13:19	212718.1			342.8			52.36			169.89			42.71			1		
07/14/22 13:20	239134.6			44			52.46			24.51			48.1			1		
07/14/22 13:21	264703.9			3.1			51.28			1.89			52.07			1		
07/14/22 13:22	290966.3			1.6			37.64			1.1			42			1		
07/14/22 13:23	301825.6			1.6			16.04			1.1			18.57			1		
07/14/22 13:24	321464.7			1.6			10.62			1.22			13.09			1		
07/14/22 13:25	335712.6			1.5			9.35			1.21			12.04			1		
07/14/22 13:26	332400.9			1.4			7.87			1.11			10.03			1		
07/14/22 13:27	331784.8			1.3			6.88			1.04			8.76			1		
07/14/22 13:28	333094.1			1.3			6.7			0.97			8.56			1		
07/14/22 13:29	330090.5			1.3			6.63			0.98			8.39			1		
07/14/22 13:30	329705.4			1.2			6.26			0.91			7.92			1		
07/14/22 13:31	328242.1			1.1			6.17			0.83			7.77			1		
07/14/22 13:32	327625.9			1			5.99			0.76			7.53			1		
07/14/22 13:33	324545.3			1			5.9			0.76			7.34			1		
07/14/22 13:34	305907.4			0.9			5.9			0.66			6.92			1		
07/14/22 13:35	292275.6			0.8			6.55			0.57			7.34			1		
07/14/22 13:36	286268.4			0.8			7.33			0.51			8.04			1		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/14/22 13:37	283495.8			0.8			8.09			0.5			8.79			1		
07/14/22 13:38	284497			0.7			8.85			0.44			9.66			1		
07/14/22 13:39	283726.8			0.7			9.09			0.45			9.89			1		
07/14/22 13:40	283572.8			0.6			9.09			0.38			9.89			1		
07/14/22 13:41	284420			0.6			9.19			0.38			10.02			1		
07/14/22 13:42	284497			0.6			9.29			0.38			10.13			1		
07/14/22 13:43	285960.3			0.6			9.48			0.39			10.4			1		
07/14/22 13:44	289349			0.6			8.22			0.39			9.12			1		
07/14/22 13:45	291197.4			0.6			4.35			0.39			4.86			1		
07/14/22 13:46	292044.6			0.6			3.71			0.39			4.16			1		
07/14/22 13:47	288963.9			0.6			3.43			0.38			3.8			1		
07/14/22 13:48	288039.8			0.6			2.71			0.39			2.99			1		
07/14/22 13:49	286961.5			0.6			2.03			0.39			2.24			1		
07/14/22 13:50	285421.2			0.6			1.74			0.39			1.91			1		
07/14/22 13:51	283495.8			0.6			1.55			0.38			1.68			1		
07/14/22 13:52	286114.3			0.6			1.45			0.39			1.59			1		
07/14/22 13:53	298513.9			0.6			1.26			0.4			1.44			0		
07/14/22 13:54	322234.8			0.6			1.16			0.44			1.43			0		
07/14/22 13:55	343029.1			0.6			0.94			0.45			1.23			0		
07/14/22 13:56	348343.3			0.6			0.74			0.52			0.99			0		
07/14/22 13:57	343491.3			0.7			0.65			0.59			0.85			0		

CT2 SUSD EVENT 14

Date/Time	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/22/22 23:16	289118			0.6			1.22			0.38			1.35			0		
07/22/22 23:17	289503			0.6			1.24			0.39			1.37			0		
07/22/22 23:18	288193.8			0.6			1.33			0.38			1.47			0		
07/22/22 23:19	285960.3			0.6			1.43			0.38			1.57			0		
07/22/22 23:20	285421.2			0.6			1.52			0.38			1.67			0		
07/22/22 23:21	288655.9			0.6			1.52			0.38			1.69			1		
07/22/22 23:22	278412.8			0.6			1.62			0.37			1.73			1		
07/22/22 23:23	254383.8			0.6			1.81			0.34			1.76			1		
07/22/22 23:24	231741.1			0.6			5.8			0.32			5.15			1		
07/22/22 23:25	203399.2			0.6			10.69			0.26			8.33			1		
07/22/22 23:26	180217.4			5.4			15.61			2.27			10.79			1		
07/22/22 23:27	158575.9			384.2			18.4			141.99			11.19			1		
07/22/22 23:28	138936.8			1082.4			21.37			350.36			11.38			1		
07/22/22 23:29	0			1684.2			25.31			0			0			1		
07/22/22 23:30	0			0			25.57			0			0			0		
07/22/22 23:31	0			0			0.1			0			0			0		
07/22/22 23:32	0			0			0.1			0			0			0		
07/22/22 23:33	0			0			0.1			0			0			0		
07/22/22 23:34	0			0			0.1			0			0			0		

CT2 SUSD EVENT 15

Date/Time	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/23/22 15:59	0			0			0			0			0			0		
07/23/22 16:00	0			0			0			0			0			0		
07/23/22 16:01	0			0			0			0			0			0		
07/23/22 16:02	0			0			0			0			0			0		
07/23/22 16:03	0			0			0			0			0			0		
07/23/22 16:04	4158.9			0.1			0			0			0			1		
07/23/22 16:05	15634.2			0.1			0			0			0			1		
07/23/22 16:06	33887			53.1			24.78			4.2			3.22			1		
07/23/22 16:07	46825.7			1010			16.96			110.33			3.05			1		
07/23/22 16:08	57376.9			637.5			23.29			85.19			5.12			1		
07/23/22 16:09	73935.3			371.1			26.97			63.97			7.65			1		
07/23/22 16:10	116063.1			227			33.86			61.39			15.07			1		
07/23/22 16:11	145560.2			129.1			47.65			43.79			26.6			1		
07/23/22 16:12	176366.6			152.8			58.45			62.82			39.53			1		
07/23/22 16:13	212025			665.9			61.7			328.95			50.16			1		
07/23/22 16:14	239134.6			57.7			62.49			32.12			57.3			1		
07/23/22 16:15	263548.7			2.6			61.16			1.6			61.82			1		
07/23/22 16:16	292660.7			1			48.83			0.69			54.81			1		
07/23/22 16:17	315688.5			1.1			20			0.81			24.22			1		
07/23/22 16:18	338331.2			1.3			11.62			1.06			15.08			1		
07/23/22 16:19	345031.6			1.5			8.94			1.22			11.83			1		
07/23/22 16:20	333017.1			1.5			8.05			1.18			10.28			1		
07/23/22 16:21	330013.4			1.5			6.53			1.17			8.26			1		
07/23/22 16:22	329474.3			1.4			5.99			1.05			7.57			1		
07/23/22 16:23	331168.7			1.3			5.36			0.98			6.8			1		
07/23/22 16:24	329936.4			1.1			4.99			0.84			6.32			1		
07/23/22 16:25	328550.1			1.1			4.7			0.85			5.92			1		
07/23/22 16:26	328627.2			1.1			4.43			0.85			5.58			1		
07/23/22 16:27	324160.2			1.1			4.33			0.84			5.39			1		
07/23/22 16:28	324468.3			1			4.24			0.77			5.28			1		
07/23/22 16:29	324930.4			1			4.24			0.77			5.29			1		
07/23/22 16:30	325392.5			0.9			4.31			0.71			5.38			1		
07/23/22 16:31	325238.4			0.9			4.21			0.71			5.26			1		
07/23/22 16:32	325007.4			0.9			4.12			0.71			5.14			1		

CT2_GasFlow_CT_scfh_1M				CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/23/22 16:33	325238.4			0.9			4.03			0.71			5.02			1		
07/23/22 16:34	324545.3			0.9			3.93			0.71			4.9			1		
07/23/22 16:35	321310.6			0.9			3.93			0.7			4.85			1		
07/23/22 16:36	321772.7			0.8			3.93			0.63			4.85			1		
07/23/22 16:37	321849.8			0.8			4.12			0.63			5.09			1		
07/23/22 16:38	324930.4			0.8			4.12			0.64			5.14			1		
07/23/22 16:39	325546.5			0.8			4.03			0.64			5.03			1		
07/23/22 16:40	307755.8			0.8			4.03			0.6			4.75			1		
07/23/22 16:41	295741.3			0.9			5.33			0.59			6.04			1		
07/23/22 16:42	293045.8			0.8			9.09			0.53			10.22			1		
07/23/22 16:43	286499.4			0.8			3.58			0.52			3.93			1		
07/23/22 16:44	283726.8			0.7			2.8			0.45			3.05			1		
07/23/22 16:45	282879.7			0.7			2.46			0.45			2.67			1		
07/23/22 16:46	282571.6			0.7			2.16			0.45			2.34			1		
07/23/22 16:47	283187.7			0.6			1.97			0.39			2.14			1		
07/23/22 16:48	282109.5			0.6			1.77			0.39			1.92			1		
07/23/22 16:49	282109.5			0.6			1.57			0.39			1.7			1		
07/23/22 16:50	282802.7			0.6			1.48			0.39			1.6			1		
07/23/22 16:51	282417.6			0.6			1.38			0.39			1.49			0		
07/23/22 16:52	281878.5			0.6			1.28			0.39			1.38			0		
07/23/22 16:53	282494.6			0.6			1.18			0.39			1.28			0		
07/23/22 16:54	282032.5			0.6			1.08			0.39			1.17			0		
07/23/22 16:55	283418.8			0.6			1.08			0.39			1.18			0		

CT2 SUSD EVENT 16

Date/Time	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/23/22 22:08	286191.3			0.6			1.43			0.38			1.57			0		
07/23/22 22:09	285729.3			0.6			1.43			0.38			1.56			0		
07/23/22 22:10	286730.5			0.6			1.52			0.38			1.67			0		
07/23/22 22:11	285652.3			0.6			1.52			0.38			1.67			0		
07/23/22 22:12	285421.2			0.6			1.52			0.38			1.67			0		
07/23/22 22:13	284420			0.6			1.62			0.38			1.76			1		
07/23/22 22:14	265782.1			0.6			1.62			0.35			1.65			1		
07/23/22 22:15	241291			0.6			2.9			0.33			2.69			1		
07/23/22 22:16	216568.9			0.6			7.69			0.32			6.39			1		
07/23/22 22:17	190845.6			2.5			16.31			1.13			11.94			1		
07/23/22 22:18	167971.8			136.7			19.67			53.54			12.67			1		
07/23/22 22:19	146946.5			780.8			23.3			267.4			13.13			1		
07/23/22 22:20	74474.4			1584.7			27.94			274.91			7.98			1		
07/23/22 22:21	0			0			32.31			0			0			0		
07/23/22 22:22	0			0			0.2			0			0			0		
07/23/22 22:23	0			0			0.1			0			0			0		
07/23/22 22:24	0			0			0.1			0			0			0		
07/23/22 22:25	0			0			0.1			0			0			0		

CT2 SUSD EVENT 17

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/24/22 5:01	0			0			0			0			0			0		
07/24/22 5:02	0			0			0			0			0			0		
07/24/22 5:03	0			0			0			0			0			0		
07/24/22 5:04	0			0			0			0			0			0		
07/24/22 5:05	0			0			0			0			0			0		
07/24/22 5:06	4852			0			0			0			0			1		
07/24/22 5:07	22719.7			0			0			0			0			1		
07/24/22 5:08	36813.6			13.8			14.75			1.18			2.08			1		
07/24/22 5:09	50137.4			1270.9			11.41			148.5			2.19			1		
07/24/22 5:10	62305.9			839.4			15.73			121.95			3.76			1		
07/24/22 5:11	77555.1			541.6			19.77			97.84			5.88			1		
07/24/22 5:12	118835.6			430.1			23.88			119.1			10.88			1		
07/24/22 5:13	152106.5			270.5			34.46			95.84			20.09			1		
07/24/22 5:14	159423.1			270.6			43.77			100.57			26.77			1		
07/24/22 5:15	171976.7			1610			42.59			645.09			28.09			1		
07/24/22 5:16	192077.8			1418.5			45.18			635.06			33.29			1		
07/24/22 5:17	218340.3			604.5			45.99			307.58			38.51			1		
07/24/22 5:18	242523.3			120.8			46.8			68.29			43.53			1		
07/24/22 5:19	265474.1			8.1			47.08			5.04			47.94			1		
07/24/22 5:20	295279.3			1.9			41.83			1.3			47.37			1		
07/24/22 5:21	319154.2			1.6			18.84			1.2			23.06			1		
07/24/22 5:22	332632			1.5			12.94			1.16			16.51			1		
07/24/22 5:23	333787.2			1.6			10.33			1.21			13.22			1		
07/24/22 5:24	336482.8			1.6			9.77			1.24			12.61			1		
07/24/22 5:25	333479.2			1.5			9.51			1.16			12.16			1		
07/24/22 5:26	332477.9			1.4			9.33			1.09			11.9			1		
07/24/22 5:27	332632			1.2			9.07			0.96			11.57			1		
07/24/22 5:28	331168.7			1.2			8.94			0.9			11.35			1		
07/24/22 5:29	328858.2			1.2			8.67			0.89			10.93			1		
07/24/22 5:30	328935.2			1.1			8.49			0.82			10.71			1		
07/24/22 5:31	329012.2			1			8.4			0.75			10.6			1		
07/24/22 5:32	325392.5			1			8.4			0.75			10.48			1		
07/24/22 5:33	309912.3			0.9			8.53			0.66			10.14			1		
07/24/22 5:34	301363.5			0.9			8.62			0.64			9.97			1		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/24/22 5:35	297666.7			0.8			10.97			0.58			12.52			1		
07/24/22 5:36	291736.5			0.7			11.33			0.51			12.68			1		
07/24/22 5:37	289195			0.7			8.99			0.44			9.97			1		
07/24/22 5:38	288501.8			0.7			5.99			0.44			6.63			1		
07/24/22 5:39	288424.8			0.7			5.62			0.44			6.21			1		
07/24/22 5:40	287269.6			0.6			5.52			0.38			6.08			1		
07/24/22 5:41	288501.8			0.6			5.23			0.38			5.79			1		
07/24/22 5:42	286576.4			0.6			4.85			0.38			5.33			1		
07/24/22 5:43	286345.4			0.6			4.57			0.38			5.02			1		
07/24/22 5:44	286576.4			0.6			4.28			0.38			4.71			1		
07/24/22 5:45	286807.5			0.6			4.09			0.38			4.5			1		
07/24/22 5:46	286884.5			0.6			3.9			0.38			4.29			1		
07/24/22 5:47	286884.5			0.6			3.71			0.38			4.08			1		
07/24/22 5:48	286114.3			0.6			3.52			0.38			3.86			1		
07/24/22 5:49	285960.3			0.6			3.43			0.38			3.76			1		
07/24/22 5:50	286884.5			0.5			3.24			0.32			3.56			1		
07/24/22 5:51	286499.4			0.5			3.14			0.32			3.45			1		
07/24/22 5:52	286499.4			0.6			2.95			0.38			3.24			1		
07/24/22 5:53	286037.3			0.6			2.95			0.38			3.24			1		
07/24/22 5:54	285960.3			0.6			2.76			0.38			3.03			1		
07/24/22 5:55	287577.6			0.6			2.76			0.38			3.04			1		
07/24/22 5:56	285729.3			0.6			2.66			0.38			2.92			1		
07/24/22 5:57	287115.5			0.6			2.57			0.38			2.83			1		
07/24/22 5:58	286730.5			0.6			2.47			0.38			2.72			1		
07/24/22 5:59	286961.5			0.6			2.38			0.38			2.62			1		
07/24/22 6:00	285960.3			0.6			2.38			0.38			2.61			1		
07/24/22 6:01	286268.4			0.6			2.28			0.38			2.51			1		
07/24/22 6:02	286268.4			0.6			2.28			0.38			2.51			1		
07/24/22 6:03	286345.4			0.6			2.19			0.38			2.4			1		
07/24/22 6:04	285729.3			0.6			2.09			0.38			2.29			1		
07/24/22 6:05	286191.3			0.6			2			0.38			2.19			1		
07/24/22 6:06	286345.4			0.5			1.9			0.32			2.09			1		
07/24/22 6:07	286730.5			0.6			1.71			0.38			1.88			1		
07/24/22 6:08	288655.9			0.6			1.71			0.38			1.9			1		
07/24/22 6:09	301671.6			0.6			1.52			0.4			1.76			0		
07/24/22 6:10	305522.4			0.6			1.4			0.4			1.65			0		
07/24/22 6:11	302441.7			0.7			1.12			0.46			1.3			0		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/24/22 6:12	301748.6			0.7			0.94			0.46			1.08			0		
07/24/22 6:13	290889.3			0.7			0.94			0.44			1.04			0		

CT2 SUSD EVENT 18

Date/Time	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/19/22 20:53	285498.2			0.7			1.43			0.44			1.56			0		
08/19/22 20:54	284805.1			0.7			1.43			0.44			1.55			0		
08/19/22 20:55	283880.9			0.7			1.52			0.44			1.65			0		
08/19/22 20:56	281878.5			0.7			1.62			0.44			1.74			0		
08/19/22 20:57	283957.9			0.7			1.62			0.44			1.76			0		
08/19/22 20:58	281339.3			0.7			1.62			0.44			1.74			1		
08/19/22 20:59	269864			0.6			1.74			0.36			1.8			1		
08/19/22 21:00	247452.3			0.6			2.13			0.33			2.01			1		
08/19/22 21:01	224501.6			0.6			6.21			0.32			5.33			1		
08/19/22 21:02	196313.7			0.6			16.92			0.25			12.7			1		
08/19/22 21:03	173363			7.8			22.09			3.13			14.64			1		
08/19/22 21:04	151644.5			404			25			142.35			14.5			1		
08/19/22 21:05	123302.6			1251			29.66			358.43			13.99			1		
08/19/22 21:06	0			1747.7			31.97			0			0			1		
08/19/22 21:07	0			0			44.25			0			0			0		
08/19/22 21:08	0			0			0.1			0			0			0		
08/19/22 21:09	0			0			0.1			0			0			0		
08/19/22 21:10	0			0			0.1			0			0			0		
08/19/22 21:11	0			0			0.1			0			0			0		

CT2 SUSD EVENT 19

Date/Time	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/20/22 14:59	0			0			0			0			0			0		
08/20/22 15:00	0			0			0			0			0			0		
08/20/22 15:01	0			0			0			0			0			0		
08/20/22 15:02	0			0			0			0			0			0		
08/20/22 15:03	0			0			0			0			0			0		
08/20/22 15:04	5853.2			0			0			0			0			1		
08/20/22 15:05	26493.5			1.6			0.2			0			0			1		
08/20/22 15:06	39509.2			1085			21.24			99.58			3.21			1		
08/20/22 15:07	52601.9			896.1			20.82			109.52			4.19			1		
08/20/22 15:08	63615.2			501.8			25.67			74.13			6.24			1		
08/20/22 15:09	88876.4			273.8			33.25			56.57			11.31			1		
08/20/22 15:10	136241.3			152.7			43.27			48.32			22.54			1		
08/20/22 15:11	141478.3			90.1			58.19			29.64			31.49			1		
08/20/22 15:12	146869.5			607.7			57.75			207.45			32.44			1		
08/20/22 15:13	166200.5			1546.7			56.6			597.24			35.97			1		
08/20/22 15:14	186994.8			851.6			58.84			369.99			42.07			1		
08/20/22 15:15	216260.8			202.9			61.01			101.97			50.46			1		
08/20/22 15:16	239981.8			19			61.26			10.57			56.22			1		
08/20/22 15:17	267168.4			2.2			61			1.38			62.32			1		
08/20/22 15:18	294586.1			1.6			35.9			1.1			40.44			1		
08/20/22 15:19	318846.1			1.6			15.21			1.16			18.55			1		
08/20/22 15:20	329243.3			1.6			9.44			1.25			11.89			1		
08/20/22 15:21	328704.2			1.7			7.33			1.3			9.21			1		
08/20/22 15:22	335327.5			1.6			6.99			1.27			8.96			1		
08/20/22 15:23	352733.2			1.5			6.63			1.19			8.94			1		
08/20/22 15:24	372372.2			1.4			6.17			1.18			8.79			1		
08/20/22 15:25	384925.8			1.3			5.53			1.15			8.14			1		
08/20/22 15:26	382769.4			1.2			6.08			1.07			8.91			1		
08/20/22 15:27	382230.3			1.1			5.9			0.98			8.62			1		
08/20/22 15:28	382307.3			1.1			5.72			0.98			8.36			1		
08/20/22 15:29	381691.2			1			5.53			0.9			8.07			1		
08/20/22 15:30	381075			1			5.35			0.9			7.79			1		
08/20/22 15:31	380767			1			5.35			0.9			7.78			1		
08/20/22 15:32	379688.8			0.9			5.43			0.83			7.89			1		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/20/22 15:33	379303.7			0.9			5.34			0.83			7.74			1		
08/20/22 15:34	377532.3			0.9			5.34			0.82			7.71			1		
08/20/22 15:35	379303.7			0.9			5.43			0.83			7.88			1		
08/20/22 15:36	382846.4			0.9			5.43			0.83			7.95			1		
08/20/22 15:37	400945.2			0.8			3.93			0.79			6.03			1		
08/20/22 15:38	417657.6			0.9			3.52			0.83			5.62			1		
08/20/22 15:39	427284.6			0.8			4.09			0.76			6.69			1		
08/20/22 15:40	434755.2			0.7			3.93			0.66			6.54			1		
08/20/22 15:41	440069.3			0.7			2.34			0.67			3.94			1		
08/20/22 15:42	441994.7			0.7			1.97			0.67			3.32			1		
08/20/22 15:43	442610.8			0.7			2.15			0.67			3.65			1		
08/20/22 15:44	443997.1			0.7			2.43			0.77			4.13			1		
08/20/22 15:45	445537.4			0.7			2.72			0.78			4.63			1		
08/20/22 15:46	445460.4			0.7			2.81			0.78			4.79			1		
08/20/22 15:47	446461.6			0.7			2.72			0.78			4.64			1		
08/20/22 15:48	446923.7			0.7			1.97			0.78			3.36			1		
08/20/22 15:49	446461.6			0.7			1.59			0.78			2.72			1		
08/20/22 15:50	447616.8			0.7			1.4			0.78			2.4			1		
08/20/22 15:51	447077.7			0.7			1.22			0.78			2.08			1		
08/20/22 15:52	447693.8			0.7			1.03			0.78			1.76			0		
08/20/22 15:53	448695.1			0.7			0.94			0.78			1.61			0		
08/20/22 15:54	445999.5			0.7			0.83			0.76			1.41			0		
08/20/22 15:55	447770.9			0.7			0.74			0.77			1.26			0		
08/20/22 15:56	446769.7			0.7			0.74			0.77			1.26			0		

CT2 SUSD EVENT 20

Date/Time	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/22/22 22:45	311683.6			0.6			1.54			0.46			1.85			0		
09/22/22 22:46	324699.3			0.6			1.36			0.48			1.7			0		
09/22/22 22:47	345262.6			0.6			1.36			0.51			1.81			0		
09/22/22 22:48	365440.8			0.6			1.41			0.53			1.98			0		
09/22/22 22:49	375760.9			0.7			1.23			0.62			1.78			0		
09/22/22 22:50	377994.4			0.7			1.07			0.63			1.56			1		
09/22/22 22:51	367982.3			0.7			1.14			0.61			1.62			1		
09/22/22 22:52	347958.2			0.7			1.23			0.57			1.65			1		
09/22/22 22:53	323929.2			0.8			1.39			0.59			1.73			1		
09/22/22 22:54	302364.7			0.8			1.88			0.57			2.18			1		
09/22/22 22:55	277950.7			0.7			2.36			0.47			2.52			1		
09/22/22 22:56	253921.7			0.6			4.03			0.33			3.93			1		
09/22/22 22:57	231664			0.4			8			0.22			7.13			1		
09/22/22 22:58	206171.8			0.3			24.69			0.16			19.58			1		
09/22/22 22:59	182527.9			7.9			29.38			3.36			20.63			1		
09/22/22 23:00	162118.6			470.2			33.15			178.18			20.68			1		
09/22/22 23:01	140323.1			1243.1			35.24			407.67			19.02			1		
09/22/22 23:02	24260			1800.1			36.14			101.94			3.37			1		
09/22/22 23:03	0			0			39.83			0			0			0		
09/22/22 23:04	0			0			5.9			0			0			0		
09/22/22 23:05	0			0			0.1			0			0			0		
09/22/22 23:06	0			0			0.1			0			0			0		
09/22/22 23:07	0			0			0			0			0			0		

CT2 SUSD EVENT 21

Date/Time	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/23/22 15:40	0			0			-0.1			0			0			0		
09/23/22 15:41	0			0			-0.1			0			0			0		
09/23/22 15:42	0			0			-0.1			0			0			0		
09/23/22 15:43	0			0			-0.1			0			0			0		
09/23/22 15:44	0			0			-0.1			0			0			0		
09/23/22 15:45	3696.8			-0.1			-0.1			0			0			1		
09/23/22 15:46	20794.3			-0.2			-0.1			0			0			1		
09/23/22 15:47	35889.4			47.2			25.96			3.96			3.59			1		
09/23/22 15:48	48058			1135.9			17.31			127.65			3.2			1		
09/23/22 15:49	59764.4			701.8			22.36			98.03			5.14			1		
09/23/22 15:50	74859.5			438.3			25.57			76.72			7.37			1		
09/23/22 15:51	118219.5			287			33.6			79.29			15.28			1		
09/23/22 15:52	147254.5			171.1			47.43			58.87			26.85			1		
09/23/22 15:53	153338.8			208.9			56.97			74.86			33.6			1		
09/23/22 15:54	170359.3			1503.1			50.78			598.56			33.28			1		
09/23/22 15:55	193464.1			1143.3			54.25			516.96			40.37			1		
09/23/22 15:56	220188.7			333.1			54.11			171.44			45.83			1		
09/23/22 15:57	241907.2			36.8			53.6			20.8			49.88			1		
09/23/22 15:58	268015.6			2.6			53.66			1.6			55.31			1		
09/23/22 15:59	293584.9			1.4			37.84			0.98			42.73			1		
09/23/22 16:00	317844.9			1.4			17.7			1.03			21.64			1		
09/23/22 16:01	331091.7			1.5			12.25			1.18			15.6			1		
09/23/22 16:02	330244.5			1.6			10.92			1.22			13.87			1		
09/23/22 16:03	332477.9			1.5			9.21			1.18			11.77			1		
09/23/22 16:04	333017.1			1.3			8.76			1.04			11.22			1		
09/23/22 16:05	333479.2			1.2			8.37			0.96			10.73			1		
09/23/22 16:06	332323.9			1.1			8.01			0.89			10.24			1		
09/23/22 16:07	330860.6			1.1			7.75			0.82			9.86			1		
09/23/22 16:08	330475.5			1			7.6			0.76			9.66			1		
09/23/22 16:09	328704.2			1			7.42			0.76			9.38			1		
09/23/22 16:10	326239.7			0.9			7.24			0.68			9.09			1		
09/23/22 16:11	327703			0.9			7.06			0.68			8.9			1		
09/23/22 16:12	328550.1			0.8			6.97			0.62			8.81			1		
09/23/22 16:13	338408.2			0.8			6.97			0.64			9.08			1		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/23/22 16:14	338947.3			0.8			7.06			0.64			9.21			1		
09/23/22 16:15	339409.4			0.8			6.69			0.63			8.74			1		
09/23/22 16:16	340795.7			0.8			6.62			0.64			8.67			1		
09/23/22 16:17	339948.5			0.8			6.53			0.64			8.53			1		
09/23/22 16:18	339794.5			0.8			6.44			0.64			8.41			1		
09/23/22 16:19	339948.5			0.8			6.53			0.64			8.53			1		
09/23/22 16:20	339024.3			0.7			6.53			0.57			8.51			1		
09/23/22 16:21	342721.1			0.7			6.53			0.57			8.6			1		
09/23/22 16:22	340872.7			0.7			6.62			0.57			8.67			1		
09/23/22 16:23	350422.7			0.8			6.53			0.66			8.79			1		
09/23/22 16:24	368829.5			0.8			5.9			0.69			8.37			1		
09/23/22 16:25	388314.5			0.7			4.11			0.65			6.14			1		
09/23/22 16:26	404256.8			0.6			3.27			0.6			5.08			1		
09/23/22 16:27	404641.9			0.6			3.23			0.61			5.02			1		
09/23/22 16:28	400252			0.6			3.41			0.52			5.25			1		
09/23/22 16:29	384848.8			0.5			3.54			0.49			5.24			1		
09/23/22 16:30	376454.1			0.6			4.02			0.55			5.82			1		
09/23/22 16:31	373065.4			0.6			3.31			0.55			4.75			1		
09/23/22 16:32	371679.1			0.7			2.77			0.62			3.96			1		
09/23/22 16:33	382076.3			0.7			2.77			0.64			4.07			1		
09/23/22 16:34	400714.1			0.7			2.68			0.67			4.13			1		
09/23/22 16:35	426745.5			0.6			2.4			0.64			3.93			1		
09/23/22 16:36	441070.5			0.6			2.49			0.67			4.22			1		
09/23/22 16:37	450004.3			0.6			2.62			0.59			4.54			1		
09/23/22 16:38	457551.9			0.6			2.81			0.6			4.94			1		
09/23/22 16:39	456627.7			0.6			3.32			0.59			5.83			1		
09/23/22 16:40	452314.8			0.6			2.86			0.58			4.97			1		
09/23/22 16:41	450158.3			0.6			1.84			0.58			3.19			1		
09/23/22 16:42	452314.8			0.6			1.75			0.58			3.05			1		
09/23/22 16:43	453239			0.6			1.84			0.59			3.21			1		
09/23/22 16:44	458707.1			0.6			2.03			0.59			3.58			1		
09/23/22 16:45	457397.8			0.6			2.3			0.59			4.05			1		
09/23/22 16:46	457397.8			0.6			2.4			0.59			4.22			1		
09/23/22 16:47	451544.7			0.6			2.4			0.58			4.16			1		
09/23/22 16:48	455164.4			0.6			2.3			0.59			4.03			1		
09/23/22 16:49	460247.4			0.6			1.94			0.59			3.43			1		
09/23/22 16:50	455549.5			0.6			1.75			0.59			3.07			1		

	CT2_GasFlow_CT_scfh_1M			CT2_CO_Ppmvdc_1M			CT2_NOx_Ppmvdc_1M			CT2_CO_LbPerHr_1M			CT2_NOx_LbPerHr_1M			CT2_SUSD_TF_1M		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/23/22 16:51	459323.3			0.6			1.66			0.59			2.93			1		
09/23/22 16:52	458938.2			0.6			1.75			0.59			3.09			1		
09/23/22 16:53	460093.4			0.6			1.94			0.59			3.43			0		
09/23/22 16:54	451467.6			0.6			2.03			0.58			3.52			0		
09/23/22 16:55	449003.1			0.6			1.94			0.58			3.34			0		
09/23/22 16:56	442687.8			0.6			1.84			0.57			3.14			0		
09/23/22 16:57	452468.8			0.6			1.75			0.68			3.05			0		

ATTACHMENT 16

AQ-57

AQ-57 The emissions rates from each gas turbine and heat recovery steam generator exhaust during startup and shutdown or excursions shall not exceed the following:

Combustion Turbine emissions limitations per Turbine excluding Startup and Shutdown	
Pollutant	Pounds/Hour
CO	6.2 3hr rolling
NOX	5.1 1 hour rolling
PM-10	4.7
SOX	1.0
VOC	1.8

Verification: The Project owner shall include all necessary emissions data to demonstrate compliance with the emissions limits provided in this Condition as part of the Quarterly Air Quality Report required in Condition of Certification AQ-SC6

AQ-57 If the Alstom GX100 turbines are selected for the Project, emission rates from each gas turbine and heat recovery steam generator exhaust, except during startup and/or shutdown, or excursions shall not exceed the following:

Alstom GTX100 - COMBUSTION TURBINE EMISSION LIMITATIONS PER TURBINE EXCLUDING STARTUP AND SHUTDOWN	
POLLUTANT	POUNDS/HOUR
Carbon Monoxide (CO)	6.2 (three-hour rolling average)
Nitrogen Oxides (NO _x)	5.1 (one-hour average)
PM10	4.7
Sulfur Oxides (SO _x)	1.0
Volatile Organic Compounds (VOCs)	1.8

Verification: The Project owner shall include all necessary emissions data to demonstrate compliance with the emission limits provided in this Condition as part of the Quarterly Air Quality Report required in Condition of Certification AQ-SC6.

AQ57 CT1 HOURLY EMISSIONS

Date/Time	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/01/22 0:00	0.6			1.5			2			0.45			0.22386			0.75		
07/01/22 1:00	0.6			1.5			2			0.36			0.1788			0.6		
07/01/22 2:00	0.6			1.4			1			0.36			0.17952			0.6		
07/01/22 3:00	0.7			1.5			2			0.36			0.18048			0.6		
07/01/22 4:00	0.7			1.5			2			0.36			0.1812			0.6		
07/01/22 5:00	0.7			1.5			1			0.43			0.2166			0.72		
07/01/22 6:00	0.6			1.5			2			0.36			0.17928			0.6		
07/01/22 7:00	0.6			1.5			1			0.36			0.17994			0.6		
07/01/22 8:00	0.6			1.5			1			0.36			0.17946			0.6		
07/01/22 9:00	0.6			1.5			1			0.36			0.17946			0.6		
07/01/22 10:00	0.6			1.5			1			0.36			0.17988			0.6		
07/01/22 11:00	0.6			1.5			1			0.36			0.18126			0.6		
07/01/22 12:00	0.6			1.5			1			0.36			0.18174			0.61		
07/01/22 13:00	0.6			1.5			1			0.36			0.18054			0.6		
07/01/22 14:00	0.6			1.5			1			0.36			0.17994			0.6		
07/01/22 15:00	0.5			1.5			1			0.36			0.17958			0.6		
07/01/22 16:00	0.6			1.5			1			0.41			0.20736			0.69		
07/01/22 17:00	1.6			1.5			1			0.56			0.282			0.94		
07/01/22 18:00	0.9			1.5			1			0.56			0.27798			0.93		
07/01/22 19:00	1			1.5			1			0.6			0.29826			0.99		
07/01/22 20:00	1.3			1.5			1			0.59			0.2958			0.99		
07/01/22 21:00	1.5			1.5			1			0.59			0.29376			0.98		
07/01/22 22:00	1.2			1.5			1			0.53			0.26286			0.88		
07/01/22 23:00	0.6			1.4			2			0.37			0.18474			0.62		
07/02/22 0:00	0.6			1.5			2			0.36			0.17802			0.59		
07/02/22 1:00	0.6			1.5			2			0.36			0.1779			0.59		
07/02/22 2:00	0.6			1.5			2			0.36			0.17856			0.6		
07/02/22 3:00	0.7			1.5			2			0.36			0.1794			0.6		
07/02/22 4:00	0.6			1.5			2			0.36			0.17934			0.6		
07/02/22 5:00	0.6			1.5			2			0.36			0.17826			0.59		
07/02/22 6:00	0.6			1.5			2			0.36			0.17814			0.59		
07/02/22 7:00	0.6			1.5			1			0.36			0.17856			0.6		
07/02/22 8:00	0.6			1.5			1			0.36			0.17868			0.6		
07/02/22 9:00	0.6			1.5			1			0.36			0.17886			0.6		

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/02/22 10:00	0.6			1.5			1			0.36			0.17898			0.6		
07/02/22 11:00	0.6			1.5			1			0.36			0.18042			0.6		
07/02/22 12:00	0.6			1.5			1			0.36			0.18066			0.6		
07/02/22 13:00	0.6			1.5			1			0.36			0.18048			0.6		
07/02/22 14:00	0.6			1.5			1			0.36			0.18048			0.6		
07/02/22 15:00	0.6			1.5			1			0.36			0.18036			0.6		
07/02/22 16:00	0.6			1.5			1			0.36			0.1806			0.6		
07/02/22 17:00	0.6			1.5			1			0.36			0.1809			0.6		
07/02/22 18:00	0.6			1.5			1			0.37			0.18318			0.61		
07/02/22 19:00	0.6			1.5			2			0.36			0.17892			0.6		
07/02/22 20:00	0.6			1.5			2			0.36			0.1785			0.6		
07/02/22 21:00	0.6			1.5			2			0.36			0.17802			0.59		
07/02/22 22:00	0.6			1.5			2			0.36			0.17856			0.6		
07/02/22 23:00	0.6			1.5			2			0.36			0.1788			0.6		
07/03/22 0:00	0.6			1.5			2			0.36			0.17898			0.6		
07/03/22 1:00	0.6			1.5			2			0.36			0.17922			0.6		
07/03/22 2:00	0.6			1.4			2			0.36			0.18012			0.6		
07/03/22 3:00	0.6			1.5			2			0.36			0.17868			0.6		
07/03/22 4:00	0.6			1.5			2			0.36			0.17808			0.59		
07/03/22 5:00	0.6			1.5			2			0.36			0.17916			0.6		
07/03/22 6:00	0.6			1.5			2			0.36			0.17976			0.6		
07/03/22 7:00	0.6			1.5			2			0.36			0.18054			0.6		
07/03/22 8:00	0.6			1.5			2			0.36			0.17994			0.6		
07/03/22 9:00	0.6			1.5			1			0.36			0.18054			0.6		
07/03/22 10:00	0.6			1.5			1			0.36			0.18078			0.6		
07/03/22 11:00	0.5			1.5			1			0.36			0.17868			0.6		
07/03/22 12:00	0.5			1.5			1			0.36			0.1791			0.6		
07/03/22 13:00	0.6			1.5			1			0.36			0.17976			0.6		
07/03/22 14:00	0.6			1.5			1			0.36			0.17946			0.6		
07/03/22 15:00	0.6			1.5			1			0.36			0.17958			0.6		
07/03/22 16:00	0.6			1.5			1			0.36			0.17958			0.6		
07/03/22 17:00	0.5			1.5			1			0.36			0.17982			0.6		
07/03/22 18:00	0.6			1.5			1			0.36			0.17916			0.6		
07/03/22 19:00	0.6			1.5			2			0.36			0.17796			0.59		
07/03/22 20:00	0.6			1.5			2			0.36			0.17766			0.59		
07/03/22 21:00	0.6			1.5			2			0.36			0.17754			0.59		
07/03/22 22:00	0.6			1.5			2			0.35			0.17736			0.59		

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/03/22 23:00	0.6			1.5			2			0.36			0.17844			0.59		
07/04/22 0:00	0.6			1.5			2			0.36			0.17874			0.6		
07/04/22 1:00	0.6			1.5			2			0.36			0.17844			0.59		
07/04/22 2:00	0.6			1.7			2			0.35			0.17718			0.59		
07/04/22 3:00	0.7			1.5			2			0.36			0.17814			0.59		
07/04/22 4:00	0.6			1.5			2			0.36			0.17934			0.6		
07/04/22 5:00	0.6			1.5			2			0.36			0.17808			0.59		
07/04/22 6:00	0.6			1.5			2			0.36			0.17772			0.59		
07/04/22 7:00	0.6			1.6			1			0.36			0.17814			0.59		
07/04/22 8:00	0.6			1.7			1			0.36			0.17868			0.6		
07/04/22 9:00	0.6			1.7			1			0.36			0.17922			0.6		
07/04/22 10:00	0.6			1.7			1			0.36			0.18006			0.6		
07/04/22 11:00	0.5			1.7			1			0.36			0.18072			0.6		
07/04/22 12:00	0.5			1.7			1			0.36			0.17958			0.6		
07/04/22 13:00	0.5			1.7			0			0.36			0.1797			0.6		
07/04/22 14:00	0.5			1.7			0			0.36			0.17982			0.6		
07/04/22 15:00	0.5			1.7			0			0.36			0.17958			0.6		
07/04/22 16:00	0.5			1.7			0			0.36			0.17934			0.6		
07/04/22 17:00	0.5			1.6			0			0.36			0.1788			0.6		
07/04/22 18:00	0.5			1.6			0			0.36			0.17832			0.59		
07/04/22 19:00	0.5			1.6			1			0.36			0.17802			0.59		
07/04/22 20:00	0.5			1.6			1			0.36			0.17808			0.59		
07/04/22 21:00	0.6			1.6			1			0.36			0.17796			0.59		
07/04/22 22:00	0.6			1.6			1			0.36			0.17802			0.59		
07/04/22 23:00	0.6			1.6			1			0.36			0.17856			0.6		
07/05/22 0:00	0.6			1.6			1			0.36			0.17964			0.6		
07/05/22 1:00	0.6			1.6			1			0.36			0.17964			0.6		
07/05/22 2:00	0.6			1.6			1			0.36			0.17934			0.6		
07/05/22 3:00	0.6			1.6			1			0.36			0.1791			0.6		
07/05/22 4:00	0.6			1.6			1			0.36			0.17868			0.6		
07/05/22 5:00	0.6			1.5			1			0.36			0.17862			0.6		
07/05/22 6:00	0.6			1.5			1			0.36			0.17898			0.6		
07/05/22 7:00	0.6			1.5			1			0.36			0.17898			0.6		
07/05/22 8:00	0.6			1.5			1			0.36			0.17934			0.6		
07/05/22 9:00	0.6			1.5			0			0.36			0.17934			0.6		
07/05/22 10:00	0.5			1.5			1			0.36			0.17952			0.6		
07/05/22 11:00	0.5			1.5			0			0.36			0.18054			0.6		

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/05/22 12:00	0.5			1.5			0			0.37			0.18672			0.62		
07/05/22 13:00	0.5			1.5			1			0.36			0.17898			0.6		
07/05/22 14:00	0.5			1.5			0			0.41			0.20346			0.68		
07/05/22 15:00	0.6			1.5			1			0.46			0.23232			0.77		
07/05/22 16:00	1			1.5			1			0.55			0.2757			0.92		
07/05/22 17:00	1			1.5			1			0.6			0.3012			1		
07/05/22 18:00	1.1			1.5			1			0.6			0.29862			1		
07/05/22 19:00	1.1			1.5			1			0.59			0.29688			0.99		
07/05/22 20:00	1.1			1.5			1			0.59			0.2961			0.99		
07/05/22 21:00	0.9			1.5			2			0.46			0.22812			0.76		
07/05/22 22:00	0.7			1.4			1			0.44			0.21906			0.73		
07/05/22 23:00	0.7			1.5			1			0.41			0.20544			0.68		
07/06/22 0:00	0.6			1.5			2			0.36			0.17892			0.6		
07/06/22 1:00	0.6			1.5			2			0.36			0.17862			0.6		
07/06/22 2:00	0.6			1.5			2			0.36			0.17856			0.6		
07/06/22 3:00	0.6			1.5			2			0.36			0.17868			0.6		
07/06/22 4:00	0.6			1.5			2			0.36			0.17856			0.6		
07/06/22 5:00	0.6			1.5			2			0.36			0.17886			0.6		
07/06/22 6:00	0.6			1.5			2			0.36			0.17874			0.6		
07/06/22 7:00	0.6			1.5			1			0.36			0.17958			0.6		
07/06/22 8:00	0.6			1.5			1			0.36			0.1794			0.6		
07/06/22 9:00	0.6			1.5			1			0.36			0.17958			0.6		
07/06/22 10:00	0.6			1.5			1			0.36			0.17958			0.6		
07/06/22 11:00	0.6			1.5			1			0.36			0.17922			0.6		
07/06/22 12:00	0.6			1.5			1			0.36			0.17976			0.6		
07/06/22 13:00	0.6			1.5			0			0.36			0.18042			0.6		
07/06/22 14:00	0.6			1.5			1			0.36			0.1806			0.6		
07/06/22 15:00	0.6			1.5			1			0.36			0.18036			0.6		
07/06/22 16:00	0.6			1.5			1			0.41			0.20694			0.69		
07/06/22 17:00	0.6			1.4			1			0.38			0.19092			0.64		
07/06/22 18:00	0.9			1.5			1			0.54			0.2718			0.91		
07/06/22 19:00	1.2			1.5			1			0.59			0.29442			0.98		
07/06/22 20:00	1.5			1.5			1			0.58			0.29214			0.97		
07/06/22 21:00	1.2			1.5			2			0.51			0.2544			0.85		
07/06/22 22:00	0.6			1.4			1			0.39			0.19488			0.65		
07/06/22 23:00	0.6			1.5			2			0.36			0.1785			0.6		
07/07/22 0:00	0.6			1.5			2			0.36			0.17856			0.6		

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/07/22 1:00	0.6			1.5			2			0.36			0.17826			0.59		
07/07/22 2:00	0.6			1.5			2			0.36			0.17838			0.59		
07/07/22 3:00	0.6			1.5			2			0.36			0.17832			0.59		
07/07/22 4:00	0.6			1.5			2			0.36			0.17898			0.6		
07/07/22 5:00	0.6			1.5			2			0.36			0.17862			0.6		
07/07/22 6:00	0.6			1.5			2			0.36			0.1788			0.6		
07/07/22 7:00	0.6			1.5			1			0.36			0.17946			0.6		
07/07/22 8:00	0.6			1.5			1			0.36			0.17928			0.6		
07/07/22 9:00	0.6			1.5			1			0.36			0.17982			0.6		
07/07/22 10:00	0.6			1.5			1			0.36			0.18036			0.6		
07/07/22 11:00	0.6			1.5			1			0.36			0.1806			0.6		
07/07/22 12:00	0.6			1.5			1			0.36			0.18			0.6		
07/07/22 13:00	0.6			1.5			1			0.36			0.17994			0.6		
07/07/22 14:00	0.6			1.5			0			0.52			0.25812			0.86		
07/07/22 15:00	0.6			1.4			1			0.42			0.20772			0.69		
07/07/22 16:00	1			1.5			1			0.56			0.28074			0.94		
07/07/22 17:00	0.9			1.5			1			0.62			0.30786			1.03		
07/07/22 18:00	0.7			1.5			1			0.64			0.31962			1.07		
07/07/22 19:00	1.1			1.5			1			0.59			0.2964			0.99		
07/07/22 20:00	1.2			1.5			1			0.59			0.29442			0.98		
07/07/22 21:00	1.2			1.5			1			0.59			0.29478			0.98		
07/07/22 22:00	1.1			1.5			1			0.56			0.28002			0.93		
07/07/22 23:00	0.7			1.4			1			0.41			0.20478			0.68		
07/08/22 0:00	0.6			1.5			1			0.36			0.17964			0.6		
07/08/22 1:00	0.6			1.5			1			0.36			0.17868			0.6		
07/08/22 2:00	0.6			1.5			1			0.36			0.17874			0.6		
07/08/22 3:00	0.7			1.5			2			0.36			0.17874			0.6		
07/08/22 4:00	0.6			1.5			1			0.49			0.24306			0.81		
07/08/22 5:00	0.7			1.5			2			0.42			0.2079			0.69		
07/08/22 6:00	0.6			1.5			1			0.36			0.1791			0.6		
07/08/22 7:00	0.6			1.5			1			0.36			0.17934			0.6		
07/08/22 8:00	0.6			1.5			1			0.36			0.1782			0.59		
07/08/22 9:00	0.6			1.5			1			0.36			0.17826			0.59		
07/08/22 10:00	0.6			1.5			1			0.36			0.17856			0.6		
07/08/22 11:00	0.6			1.5			1			0.36			0.17958			0.6		
07/08/22 12:00	0.6			1.5			0			0.36			0.17988			0.6		
07/08/22 13:00	0.6			1.5			0			0.41			0.207			0.69		

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/08/22 14:00	0.6			1.5			1			0.44			0.21822			0.73		
07/08/22 15:00	0.8			1.5			1			0.51			0.25644			0.85		
07/08/22 16:00	0.8			1.5			1			0.46			0.22932			0.76		
07/08/22 17:00	0.5			1.5			1			0.37			0.18498			0.62		
07/08/22 18:00	0.6			1.4			1			0.45			0.22548			0.75		
07/08/22 19:00	0.7			1.4			0			0.48			0.24078			0.8		
07/08/22 20:00	1.6			1.5			1			0.57			0.28602			0.95		
07/08/22 21:00	1.5			1.5			1			0.57			0.28632			0.95		
07/08/22 22:00	1.5			1.5			1			0.57			0.28704			0.96		
07/08/22 23:00	1.5			1.5			1			0.58			0.2883			0.96		
07/09/22 0:00	1.5			1.5			1			0.58			0.28812			0.96		
07/09/22 1:00	0.7			1.5			2			0.39			0.1971			0.66		
07/09/22 2:00	0.6			1.6			2			0.36			0.17898			0.6		
07/09/22 3:00	0.6			1.5			2			0.36			0.17934			0.6		
07/09/22 4:00	0.7			1.5			2			0.38			0.19206			0.64		
07/09/22 5:00	0.6			1.5			2			0.36			0.1788			0.6		
07/09/22 6:00	0.6			1.5			1			0.36			0.17892			0.6		
07/09/22 7:00	0.6			1.5			1			0.36			0.17958			0.6		
07/09/22 8:00	0.6			1.5			1			0.36			0.17946			0.6		
07/09/22 9:00	0.6			1.5			1			0.36			0.17952			0.6		
07/09/22 10:00	0.6			1.5			1			0.36			0.18018			0.6		
07/09/22 11:00	0.6			1.5			1			0.36			0.18084			0.6		
07/09/22 12:00	0.6			1.5			1			0.36			0.1803			0.6		
07/09/22 13:00	0.6			1.5			0			0.36			0.18114			0.6		
07/09/22 14:00	0.6			1.5			1			0.36			0.17988			0.6		
07/09/22 15:00	0.5			1.5			1			0.36			0.17946			0.6		
07/09/22 16:00	0.6			1.5			0			0.42			0.20832			0.69		
07/09/22 17:00	0.5			1.5			1			0.36			0.17886			0.6		
07/09/22 18:00	0.5			1.5			0			0.36			0.17826			0.59		
07/09/22 19:00	0.6			1.5			1			0.36			0.17868			0.6		
07/09/22 20:00	0.6			1.5			1			0.36			0.1782			0.59		
07/09/22 21:00	0.6			1.5			1			0.36			0.17808			0.59		
07/09/22 22:00	0.6			1.5			1			0.36			0.17784			0.59		
07/09/22 23:00	0.6			1.5			1			0.36			0.17796			0.59		
07/10/22 0:00	0.7			1.5			1			0.36			0.1791			0.6		
07/10/22 1:00	0.6			1.5			2			0.36			0.17922			0.6		
07/10/22 2:00	0.6			1.5			1			0.36			0.17892			0.6		

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/10/22 3:00	0.7			1.5			2			0.36			0.17892			0.6		
07/10/22 4:00	0.6			1.5			2			0.36			0.17886			0.6		
07/10/22 5:00	0.6			1.5			2			0.36			0.1788			0.6		
07/10/22 6:00	0.6			1.5			1			0.36			0.17892			0.6		
07/10/22 7:00	0.6			1.5			1			0.36			0.18012			0.6		
07/10/22 8:00	0.6			1.5			1			0.36			0.17958			0.6		
07/10/22 9:00	0.6			1.5			1			0.36			0.17814			0.59		
07/10/22 10:00	0.6			1.5			0			0.36			0.17988			0.6		
07/10/22 11:00	0.6			1.5			0			0.36			0.18024			0.6		
07/10/22 12:00	0.6			1.5			0			0.36			0.18006			0.6		
07/10/22 13:00	0.6			1.5			0			0.36			0.18054			0.6		
07/10/22 14:00	0.6			1.5			1			0.41			0.20694			0.69		
07/10/22 15:00	0.7			1.5			1			0.44			0.22122			0.74		
07/10/22 16:00	1			1.5			1			0.47			0.23712			0.79		
07/10/22 17:00	0.7			1.5			1			0.52			0.26052			0.87		
07/10/22 18:00	0.7			1.5			1			0.55			0.27276			0.91		
07/10/22 19:00	0.7			1.5			1			0.54			0.2721			0.91		
07/10/22 20:00	0.7			1.5			1			0.54			0.27066			0.9		
07/10/22 21:00	0.7			1.5			0			0.51			0.25416			0.85		
07/10/22 22:00	0.7			1.5			1			0.52			0.25812			0.86		
07/10/22 23:00	0.7			1.5			1			0.54			0.27054			0.9		
07/11/22 0:00	0.7			1.5			1			0.54			0.27048			0.9		
07/11/22 1:00	0.7			1.5			1			0.54			0.2709			0.9		
07/11/22 2:00	0.7			1.6			1			0.54			0.2709			0.9		
07/11/22 3:00	0.7			1.5			1			0.54			0.27042			0.9		
07/11/22 4:00	0.7			1.5			1			0.54			0.26796			0.89		
07/11/22 5:00	0.7			1.5			1			0.47			0.23646			0.79		
07/11/22 6:00	0.6			1.5			2			0.34			0.1698			0.57		
07/11/22 7:00	0.5			1.5			1			0.33			0.1662			0.55		
07/11/22 8:00	0.5			1.5			2			0.33			0.16578			0.55		
07/11/22 9:00	0.5			1.5			1			0.33			0.16644			0.55		
07/11/22 10:00	0.6			1.5			0			0.34			0.17142			0.57		
07/11/22 11:00	0.6			1.5			0			0.4			0.19824			0.66		
07/11/22 12:00	1			1.5			1			0.59			0.29748			0.99		
07/11/22 13:00	0.6			1.5			1			0.64			0.31848			1.06		
07/11/22 14:00	0.6			1.5			1			0.64			0.31968			1.07		
07/11/22 15:00	0.5			1.5			1			0.64			0.32178			1.07		

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/11/22 16:00	0.6			1.5			1			0.64			0.31854			1.06		
07/11/22 17:00	0.6			1.5			1			0.64			0.3186			1.06		
07/11/22 18:00	0.5			1.5			1			0.65			0.32352			1.08		
07/11/22 19:00	0.6			1.5			1			0.64			0.32124			1.07		
07/11/22 20:00	0.7			1.5			1			0.63			0.31272			1.04		
07/11/22 21:00	1			1.5			1			0.6			0.30108			1		
07/11/22 22:00	1			1.5			1			0.61			0.30456			1.02		
07/11/22 23:00	1.1			1.5			1			0.6			0.29934			1		
07/12/22 0:00	1.1			1.5			1			0.61			0.30486			1.02		
07/12/22 1:00	1.1			1.5			1			0.61			0.30282			1.01		
07/12/22 2:00	1.2			1.5			1			0.6			0.29778			0.99		
07/12/22 3:00	1.1			1.5			1			0.6			0.3018			1.01		
07/12/22 4:00	1			1.5			1			0.62			0.3105			1.04		
07/12/22 5:00	1.1			1.5			1			0.58			0.28824			0.96		
07/12/22 6:00	0.6			1.5			2			0.39			0.1965			0.66		
07/12/22 7:00	0.5			1.5			2			0.33			0.16734			0.56		
07/12/22 8:00	0.5			1.5			2			0.33			0.16566			0.55		
07/12/22 9:00	0.5			1.5			2			0.33			0.16578			0.55		
07/12/22 10:00	0.6			1.3			-1			0.34			0.1698			0.57		
07/12/22 11:00	0.5			1.5			0			0.35			0.17484			0.58		
07/12/22 12:00	0.6			1.5			0			0.37			0.18618			0.62		
07/12/22 13:00	0.9			1.5			1			0.49			0.24258			0.81		
07/12/22 14:00	0.7			1.5			1			0.63			0.31596			1.05		
07/12/22 15:00	0.8			1.5			1			0.61			0.30558			1.02		
07/12/22 16:00	0.8			1.5			1			0.62			0.30894			1.03		
07/12/22 17:00	0.7			1.5			1			0.64			0.31896			1.06		
07/12/22 18:00	0.8			1.5			1			0.62			0.30804			1.03		
07/12/22 19:00	0.9			1.6			1			0.58			0.28836			0.96		
07/12/22 20:00	0.8			1.7			1			0.54			0.26964			0.9		
07/12/22 21:00	0.9			1.7			1			0.62			0.30846			1.03		
07/12/22 22:00	0.7			1.6			1			0.48			0.23922			0.8		
07/12/22 23:00	0.7			1.7			1			0.55			0.27354			0.91		
07/13/22 0:00	0.7			1.7			1			0.55			0.27402			0.91		
07/13/22 1:00	0.6			1.7			1			0.55			0.2742			0.91		
07/13/22 2:00	0.6			1.6			1			0.55			0.27396			0.91		
07/13/22 3:00	1.2			1.7			1			0.55			0.27618			0.92		
07/13/22 4:00	0.6			1.7			2			0.67			0.33606			1.12		

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/13/22 5:00	0.9			1.6			2			0.63			0.31362			1.05		
07/13/22 6:00	1.3			1.6			1			0.53			0.2661			0.89		
07/13/22 7:00	0.5			1.6			2			0.34			0.16908			0.56		
07/13/22 8:00	0.5			1.6			2			0.34			0.16854			0.56		
07/13/22 9:00	0.5			1.7			2			0.33			0.16632			0.55		
07/13/22 10:00	0.4			1.7			2			0.33			0.16632			0.55		
07/13/22 11:00	0.4			1.7			2			0.33			0.1668			0.56		
07/13/22 12:00	0.4			1.7			1			0.33			0.16734			0.56		
07/13/22 13:00	0.4			1.7			1			0.34			0.16752			0.56		
07/13/22 14:00	0.5			1.6			1			0.36			0.18096			0.6		
07/13/22 15:00	0.9			1.7			1			0.58			0.29112			0.97		
07/13/22 16:00	1			1.7			1			0.61			0.30294			1.01		
07/13/22 17:00	0.7			1.5			1			0.44			0.2196			0.73		
07/13/22 18:00	0.9			1.7			1			0.58			0.28872			0.96		
07/13/22 19:00	1			1.7			1			0.61			0.30258			1.01		
07/13/22 20:00	0.7			1.7			1			0.64			0.31992			1.07		
07/13/22 21:00	1			1.6			1			0.61			0.3051			1.02		
07/13/22 22:00	1.2			1.6			1			0.59			0.29538			0.98		
07/13/22 23:00	0.7			1.6			1			0.45			0.22506			0.75		
07/14/22 0:00	0.8			1.5			1			0.49			0.24672			0.82		
07/14/22 1:00	0.7			1.6			1			0.44			0.21876			0.73		
07/14/22 2:00	0.7			1.7			1			0.41			0.20334			0.68		
07/14/22 3:00	0.7			1.6			1			0.44			0.21852			0.73		
07/14/22 4:00	0.7			1.7			1			0.5			0.24864			0.83		
07/14/22 5:00	0.6			1.6			1			0.52			0.25806			0.86		
07/14/22 6:00	0.8			1.6			1			0.43			0.21672			0.72		
07/14/22 7:00	0.6			1.6			1			0.4			0.19974			0.67		
07/14/22 8:00	0.6			1.6			0			0.36			0.1785			0.6		
07/14/22 9:00	0.6			1.7			0			0.36			0.17874			0.6		
07/14/22 10:00	0.6			1.7			0			0.36			0.1791			0.6		
07/14/22 11:00	0.6			1.6			0			0.36			0.1794			0.6		
07/14/22 12:00	0.6			1.6			0			0.41			0.20508			0.68		
07/14/22 13:00	0.6			1.6			1			0.43			0.21258			0.71		
07/14/22 14:00	0.7			1.4			1			0.54			0.26844			0.89		
07/14/22 15:00	0.7			1.5			1			0.62			0.31188			1.04		
07/14/22 16:00	0.8			1.5			1			0.62			0.309			1.03		
07/14/22 17:00	0.6			1.6			1			0.64			0.31818			1.06		

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/14/22 18:00	0.6			1.6			1			0.64			0.31902			1.06		
07/14/22 19:00	1			1.6			1			0.61			0.30384			1.01		
07/14/22 20:00	1			1.6			1			0.6			0.30228			1.01		
07/14/22 21:00	1.1			1.6			1			0.6			0.2997			1		
07/14/22 22:00	1.3			1.6			1			0.59			0.29484			0.98		
07/14/22 23:00	1.4			1.6			1			0.59			0.29484			0.98		
07/15/22 0:00	0.8			1.6			1			0.49			0.2457			0.82		
07/15/22 1:00	0.9			1.6			1			0.55			0.27738			0.92		
07/15/22 2:00	1.2			1.8			1			0.62			0.30834			1.03		
07/15/22 3:00	1.5			1.6			1			0.58			0.291			0.97		
07/15/22 4:00	1.5			1.6			1			0.58			0.29106			0.97		
07/15/22 5:00	1.3			1.6			1			0.6			0.30198			1.01		
07/15/22 6:00	0.9			1.6			2			0.46			0.22908			0.76		
07/15/22 7:00	0.5			1.6			2			0.33			0.16746			0.56		
07/15/22 8:00	0.5			1.6			2			0.33			0.1671			0.56		
07/15/22 9:00	0.5			1.6			2			0.33			0.16722			0.56		
07/15/22 10:00	0.5			1.6			1			0.34			0.17076			0.57		
07/15/22 11:00	0.5			1.6			0			0.35			0.17388			0.58		
07/15/22 12:00	0.5			1.6			0			0.35			0.1758			0.59		
07/15/22 13:00	0.8			1.6			0			0.45			0.22668			0.76		
07/15/22 14:00	0.9			1.6			1			0.62			0.30918			1.03		
07/15/22 15:00	0.8			1.6			1			0.62			0.30888			1.03		
07/15/22 16:00	0.9			1.6			1			0.61			0.30492			1.02		
07/15/22 17:00	0.7			1.6			1			0.64			0.3213			1.07		
07/15/22 18:00	0.2			1.6			2			0.71			0.3531			1.18		
07/15/22 19:00	0.4			1.6			2			0.68			0.3396			1.13		
07/15/22 20:00	0.5			1.7			1			0.66			0.33234			1.11		
07/15/22 21:00	0.6			1.7			1			0.66			0.32898			1.1		
07/15/22 22:00	0.5			1.7			1			0.66			0.33162			1.11		
07/15/22 23:00	0.8			1.7			1			0.63			0.3156			1.05		
07/16/22 0:00	1.2			1.7			1			0.57			0.28482			0.95		
07/16/22 1:00	0.7			1.7			1			0.5			0.24888			0.83		
07/16/22 2:00	0.7			1.6			1			0.55			0.27426			0.91		
07/16/22 3:00	0.7			1.7			1			0.55			0.27546			0.92		
07/16/22 4:00	0.6			1.7			1			0.55			0.27492			0.92		
07/16/22 5:00	0.6			1.6			1			0.48			0.23862			0.8		
07/16/22 6:00	0.6			1.6			2			0.39			0.19698			0.66		

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/16/22 7:00	0.5			1.6			2			0.33			0.1665			0.56		
07/16/22 8:00	0.5			1.5			1			0.34			0.16908			0.56		
07/16/22 9:00	0.5			1.6			0			0.35			0.17304			0.58		
07/16/22 10:00	0.5			1.6			0			0.35			0.17598			0.59		
07/16/22 11:00	0.6			1.6			0			0.35			0.17436			0.58		
07/16/22 12:00	0.6			1.6			0			0.36			0.17808			0.59		
07/16/22 13:00	0.6			1.6			0			0.44			0.21894			0.73		
07/16/22 14:00	1.2			1.6			1			0.56			0.27798			0.93		
07/16/22 15:00	0.2			1.6			2			0.71			0.35274			1.18		
07/16/22 16:00	0.7			1.6			1			0.63			0.3126			1.04		
07/16/22 17:00	0.5			1.6			2			0.66			0.32988			1.1		
07/16/22 18:00	0.3			1.6			2			0.68			0.33924			1.13		
07/16/22 19:00	0.7			1.6			1			0.63			0.3126			1.04		
07/16/22 20:00	0.4			1.6			2			0.69			0.34296			1.14		
07/16/22 21:00	0.3			1.6			2			0.7			0.35004			1.17		
07/16/22 22:00	0.3			1.6			2			0.69			0.34662			1.16		
07/16/22 23:00	0.6			1.6			1			0.65			0.32712			1.09		
07/17/22 0:00	0.3			1.6			2			0.7			0.34926			1.16		
07/17/22 1:00	0.4			1.6			2			0.69			0.34332			1.14		
07/17/22 2:00	0.4			1.4			2			0.69			0.34386			1.15		
07/17/22 3:00	0.4			1.6			2			0.69			0.34536			1.15		
07/17/22 4:00	0.5			1.6			2			0.67			0.33588			1.12		
07/17/22 5:00	0.9			1.6			1			0.55			0.27618			0.92		
07/17/22 6:00	0.7			1.6			1			0.48			0.2418			0.81		
07/17/22 7:00	0.6			1.6			1			0.35			0.17388			0.58		
07/17/22 8:00	0.6			1.6			0			0.39			0.19458			0.65		
07/17/22 9:00	0.5			1.6			1			0.34			0.17202			0.57		
07/17/22 10:00	0.5			1.5			0			0.35			0.17292			0.58		
07/17/22 11:00	0.8			1.6			0			0.47			0.23706			0.79		
07/17/22 12:00	0.8			1.6			1			0.61			0.3069			1.02		
07/17/22 13:00	0.6			1.6			1			0.64			0.31848			1.06		
07/17/22 14:00	0.8			1.6			1			0.62			0.3075			1.03		
07/17/22 15:00	0.5			1.6			2			0.66			0.32994			1.1		
07/17/22 16:00	0.4			1.6			2			0.66			0.32808			1.09		
07/17/22 17:00	0.5			1.6			2			0.65			0.32418			1.08		
07/17/22 18:00	0.3			1.6			2			0.69			0.34716			1.16		
07/17/22 19:00	0.3			1.6			2			0.69			0.3444			1.15		

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/17/22 20:00	0.2			1.6			2			0.7			0.3522			1.17		
07/17/22 21:00	0.7			1.6			1			0.64			0.31914			1.06		
07/17/22 22:00	1.1			1.6			1			0.6			0.29826			0.99		
07/17/22 23:00	1.2			1.6			1			0.59			0.29742			0.99		
07/18/22 0:00	1.2			1.6			1			0.59			0.29718			0.99		
07/18/22 1:00	1.1			1.6			1			0.57			0.28452			0.95		
07/18/22 2:00	0.6			1.8			2			0.35			0.17358			0.58		
07/18/22 3:00	0.5			1.6			2			0.34			0.16926			0.56		
07/18/22 4:00	0.6			1.5			0			0.38			0.18948			0.63		
07/18/22 5:00	1.1			1.6			1			0.57			0.28746			0.96		
07/18/22 6:00	1.2			1.6			1			0.59			0.297			0.99		
07/18/22 7:00	0.8			1.6			1			0.46			0.22776			0.76		
07/18/22 8:00	0.6			1.6			1			0.38			0.18936			0.63		
07/18/22 9:00	1			1.6			1			0.58			0.2907			0.97		
07/18/22 10:00	1			1.6			1			0.6			0.3018			1.01		
07/18/22 11:00	1			1.6			1			0.61			0.30582			1.02		
07/18/22 12:00	0.9			1.6			1			0.62			0.30906			1.03		
07/18/22 13:00	0.4			1.6			2			0.68			0.33972			1.13		
07/18/22 14:00	0.6			1.6			1			0.64			0.3216			1.07		
07/18/22 15:00	0.2			1.6			2			0.71			0.3546			1.18		
07/18/22 16:00	0.2			1.6			2			0.71			0.3543			1.18		
07/18/22 17:00	0.3			1.7			2			0.69			0.34686			1.16		
07/18/22 18:00	0.2			1.7			2			0.71			0.3528			1.18		
07/18/22 19:00	0.3			1.7			2			0.69			0.34368			1.15		
07/18/22 20:00	0.3			1.7			2			0.7			0.34806			1.16		
07/18/22 21:00	0.7			1.7			1			0.63			0.31746			1.06		
07/18/22 22:00	1.2			1.7			1			0.59			0.29574			0.99		
07/18/22 23:00	1			1.7			1			0.52			0.25818			0.86		
07/19/22 0:00	0.6			1.7			1			0.34			0.17208			0.57		
07/19/22 1:00	0.6			1.7			1			0.35			0.17382			0.58		
07/19/22 2:00	0.6			1.7			1			0.35			0.17454			0.58		
07/19/22 3:00	0.6			1.7			1			0.35			0.17508			0.58		
07/19/22 4:00	0.6			1.7			1			0.35			0.17448			0.58		
07/19/22 5:00	0.6			1.7			1			0.35			0.1743			0.58		
07/19/22 6:00	0.5			1.7			2			0.34			0.17034			0.57		
07/19/22 7:00	0.5			1.7			2			0.33			0.16644			0.55		
07/19/22 8:00	0.5			1.7			2			0.33			0.16608			0.55		

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/19/22 9:00	0.5			1.6			1			0.34			0.1704			0.57		
07/19/22 10:00	0.6			1.7			0			0.37			0.18732			0.62		
07/19/22 11:00	0.6			1.5			1			0.48			0.2415			0.81		
07/19/22 12:00	0.8			1.7			1			0.64			0.31782			1.06		
07/19/22 13:00	0.8			1.7			1			0.62			0.30774			1.03		
07/19/22 14:00	0.9			1.7			1			0.61			0.30318			1.01		
07/19/22 15:00	0.9			1.7			1			0.61			0.30438			1.01		
07/19/22 16:00	0.5			1.7			2			0.67			0.336			1.12		
07/19/22 17:00	0.4			1.7			2			0.69			0.34404			1.15		
07/19/22 18:00	0.1			1.7			2			0.73			0.3657			1.22		
07/19/22 19:00	0.4			1.5			2			0.68			0.34152			1.14		
07/19/22 20:00	1.1			1.5			1			0.6			0.30084			1		
07/19/22 21:00	1.1			1.5			1			0.6			0.30246			1.01		
07/19/22 22:00	1.3			1.5			1			0.59			0.29502			0.98		
07/19/22 23:00	0.9			1.5			2			0.45			0.22434			0.75		
07/20/22 0:00	0.5			1.6			2			0.33			0.16554			0.55		
07/20/22 1:00	0.5			1.6			2			0.33			0.1659			0.55		
07/20/22 2:00	0.5			1.6			2			0.33			0.1659			0.55		
07/20/22 3:00	0.5			1.6			3			0.33			0.16608			0.55		
07/20/22 4:00	0.5			1.6			2			0.33			0.1671			0.56		
07/20/22 5:00	0.5			1.5			2			0.34			0.16878			0.56		
07/20/22 6:00	0.5			1.5			2			0.34			0.16896			0.56		
07/20/22 7:00	0.6			1.5			1			0.34			0.17238			0.57		
07/20/22 8:00	0.5			1.5			1			0.34			0.16848			0.56		
07/20/22 9:00	0.5			1.5			1			0.34			0.17196			0.57		
07/20/22 10:00	0.5			1.5			1			0.34			0.17064			0.57		
07/20/22 11:00	0.5			1.5			0			0.35			0.17526			0.58		
07/20/22 12:00	0.9			1.4			0			0.49			0.2463			0.82		
07/20/22 13:00	0.8			1.5			1			0.63			0.31608			1.05		
07/20/22 14:00	0.2			1.5			2			0.74			0.36942			1.23		
07/20/22 15:00	0.8			1.5			1			0.62			0.30954			1.03		
07/20/22 16:00	0.8			1.5			1			0.62			0.31116			1.04		
07/20/22 17:00	0.2			1.5			2			0.71			0.35688			1.19		
07/20/22 18:00	0.4			1.5			2			0.68			0.33786			1.13		
07/20/22 19:00	0.3			1.5			2			0.69			0.3456			1.15		
07/20/22 20:00	0.6			1.5			1			0.65			0.32682			1.09		
07/20/22 21:00	0.8			1.5			1			0.45			0.22446			0.75		

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/20/22 22:00	0.6			1.4			1			0.35			0.17394			0.58		
07/20/22 23:00	0.5			1.5			2			0.34			0.16782			0.56		
07/21/22 0:00	0.6			1.5			2			0.34			0.17178			0.57		
07/21/22 1:00	0.5			1.5			2			0.34			0.16962			0.57		
07/21/22 2:00	0.5			1.4			2			0.34			0.16926			0.56		
07/21/22 3:00	0.6			1.4			1			0.35			0.17508			0.58		
07/21/22 4:00	0.5			1.5			3			0.34			0.16848			0.56		
07/21/22 5:00	0.5			1.5			3			0.33			0.1656			0.55		
07/21/22 6:00	0.5			1.6			2			0.33			0.16632			0.55		
07/21/22 7:00	0.5			1.6			2			0.33			0.1668			0.56		
07/21/22 8:00	0.5			1.6			2			0.33			0.1665			0.56		
07/21/22 9:00	0.5			1.6			2			0.33			0.16662			0.56		
07/21/22 10:00	0.5			1.6			1			0.33			0.16698			0.56		
07/21/22 11:00	0.5			1.6			0			0.33			0.1674			0.56		
07/21/22 12:00	0.5			1.6			1			0.34			0.17112			0.57		
07/21/22 13:00	0.7			1.6			0			0.42			0.21048			0.7		
07/21/22 14:00	1			1.6			1			0.61			0.30612			1.02		
07/21/22 15:00	0.9			1.6			1			0.61			0.30654			1.02		
07/21/22 16:00	0.9			1.6			1			0.61			0.30612			1.02		
07/21/22 17:00	0.7			1.6			1			0.64			0.31962			1.07		
07/21/22 18:00	0.5			1.6			1			0.66			0.32952			1.1		
07/21/22 19:00	1			1.6			1			0.61			0.3033			1.01		
07/21/22 20:00	1.1			1.6			1			0.61			0.30426			1.01		
07/21/22 21:00	1			1.6			1			0.5			0.25074			0.84		
07/21/22 22:00	0.5			1.6			2			0.33			0.16734			0.56		
07/21/22 23:00	0.6			1.6			1			0.34			0.17196			0.57		
07/22/22 0:00	0.6			1.6			1			0.35			0.17436			0.58		
07/22/22 1:00	0.6			1.6			1			0.35			0.17406			0.58		
07/22/22 2:00	0.7			1.6			0			0.39			0.19698			0.66		
07/22/22 3:00	0.6			1.6			3			0.35			0.174			0.58		
07/22/22 4:00	0.6			1.6			2			0.35			0.17322			0.58		
07/22/22 5:00	0.6			1.6			2			0.35			0.1725			0.58		
07/22/22 6:00	0.5			1.6			2			0.34			0.16944			0.56		
07/22/22 7:00	0.5			1.6			2			0.33			0.16698			0.56		
07/22/22 8:00	0.5			1.6			2			0.33			0.16638			0.55		
07/22/22 9:00	0.5			1.6			2			0.33			0.16626			0.55		
07/22/22 10:00	0.5			1.6			1			0.33			0.16722			0.56		

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/22/22 11:00	0.5			1.6			1			0.33			0.16722			0.56		
07/22/22 12:00	0.4			1.6			1			0.33			0.1674			0.56		
07/22/22 13:00	0.5			1.6			1			0.34			0.17016			0.57		
07/22/22 14:00	0.8			1.5			0			0.43			0.21264			0.71		
07/22/22 15:00	1			1.6			1			0.61			0.30528			1.02		
07/22/22 16:00	1			1.6			1			0.61			0.30414			1.01		
07/22/22 17:00	1			1.6			1			0.61			0.30402			1.01		
07/22/22 18:00	1			1.6			1			0.61			0.30342			1.01		
07/22/22 19:00	1.1			1.6			1			0.6			0.30066			1		
07/22/22 20:00	1.2			1.6			1			0.6			0.2985			1		
07/22/22 21:00	0.9			1.5			1			0.47			0.23304			0.78		
07/22/22 22:00	0.6			1.5			1			0.35			0.177			0.59		
07/22/22 23:00	0.7			1.4			1			0.4			0.2019			0.67		
07/23/22 0:00	0.7			1.6			1			0.4			0.19884			0.66		
07/23/22 1:00	0.6			1.6			1			0.37			0.18372			0.61		
07/23/22 2:00	0.7			1.6			2			0.41			0.2055			0.69		
07/23/22 3:00	0.6			1.5			1			0.36			0.1794			0.6		
07/23/22 4:00	0.7			1.5			1			0.37			0.18288			0.61		
07/23/22 5:00	0.7			1.5			1			0.38			0.19038			0.63		
07/23/22 6:00	1.9			1.6			1			0.57			0.28284			0.94		
07/23/22 7:00	2			1.6			1			0.58			0.29076			0.97		
07/23/22 8:00	2			1.6			1			0.58			0.28938			0.96		
07/23/22 9:00	1			1.6			1			0.45			0.22632			0.75		
07/23/22 10:00	0.6			1.6			1			0.36			0.17874			0.6		
07/23/22 11:00	0.6			1.6			0			0.36			0.17946			0.6		
07/23/22 12:00	0.6			1.6			0			0.36			0.17976			0.6		
07/23/22 13:00	0.6			1.6			0			0.36			0.18006			0.6		
07/23/22 14:00	0.6			1.6			1			0.36			0.1806			0.6		
07/23/22 15:00	0.6			1.5			0			0.4			0.19962			0.67		
07/23/22 16:00	0.6			1.6			1			0.4			0.20244			0.67		
07/23/22 17:00	0.8			1.6			1			0.45			0.2247			0.75		
07/23/22 18:00	0.5			1.6			2			0.68			0.33786			1.13		
07/23/22 19:00	0.6			1.6			1			0.65			0.32346			1.08		
07/23/22 20:00	1.2			1.6			1			0.6			0.30198			1.01		
07/23/22 21:00	1			1.6			1			0.51			0.25722			0.86		
07/23/22 22:00	0.7			1.5			1			0.41			0.2043			0.68		
07/23/22 23:00	1.7			1.6			1			0.56			0.2793			0.93		

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/24/22 0:00	0.7			1.6			1			0.54			0.27186			0.91		
07/24/22 1:00	0.7			1.6			1			0.54			0.27228			0.91		
07/24/22 2:00	0.7			1.6			1			0.55			0.2751			0.92		
07/24/22 3:00	0.7			1.6			1			0.55			0.27678			0.92		
07/24/22 4:00	0.6			1.6			1			0.55			0.27486			0.92		
07/24/22 5:00	0.6			1.6			2			0.41			0.20742			0.69		
07/24/22 6:00	0.6			1.5			2			0.35			0.17262			0.58		
07/24/22 7:00	0.6			1.6			1			0.35			0.17304			0.58		
07/24/22 8:00	0.5			1.6			1			0.34			0.16896			0.56		
07/24/22 9:00	0.5			1.6			2			0.33			0.16668			0.56		
07/24/22 10:00	0.5			1.6			1			0.33			0.1671			0.56		
07/24/22 11:00	0.5			1.6			1			0.34			0.16776			0.56		
07/24/22 12:00	0.5			1.6			1			0.34			0.1677			0.56		
07/24/22 13:00	0.5			1.6			1			0.34			0.1677			0.56		
07/24/22 14:00	0.5			1.6			0			0.34			0.1683			0.56		
07/24/22 15:00	0.5			1.6			1			0.33			0.16716			0.56		
07/24/22 16:00	0.9			1.6			0			0.47			0.23712			0.79		
07/24/22 17:00	0.8			1.6			1			0.62			0.30774			1.03		
07/24/22 18:00	0.9			1.6			1			0.61			0.30702			1.02		
07/24/22 19:00	1.1			1.6			1			0.61			0.30276			1.01		
07/24/22 20:00	1			1.6			1			0.51			0.2571			0.86		
07/24/22 21:00	0.6			1.5			1			0.34			0.16764			0.56		
07/24/22 22:00	0.5			1.5			2			0.33			0.16662			0.56		
07/24/22 23:00	0.6			1.5			1			0.35			0.1725			0.58		
07/25/22 0:00	0.5			1.5			2			0.34			0.1689			0.56		
07/25/22 1:00	0.5			1.5			2			0.33			0.16608			0.55		
07/25/22 2:00	0.5			1.5			2			0.33			0.16602			0.55		
07/25/22 3:00	0.6			1.5			3			0.33			0.16572			0.55		
07/25/22 4:00	0.6			1.5			2			0.34			0.17196			0.57		
07/25/22 5:00	0.6			1.5			2			0.35			0.17376			0.58		
07/25/22 6:00	0.6			1.5			2			0.35			0.17334			0.58		
07/25/22 7:00	0.6			1.5			2			0.35			0.17364			0.58		
07/25/22 8:00	0.5			1.5			2			0.33			0.16698			0.56		
07/25/22 9:00	0.5			1.5			2			0.33			0.1659			0.55		
07/25/22 10:00	0.5			1.5			2			0.33			0.16554			0.55		
07/25/22 11:00	0.6			1.4			0			0.34			0.17244			0.57		
07/25/22 12:00	0.6			1.5			0			0.35			0.174			0.58		

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/25/22 13:00	0.8			1.5			0			0.48			0.24048			0.8		
07/25/22 14:00	0.8			1.5			1			0.62			0.31068			1.04		
07/25/22 15:00	0.8			1.5			1			0.63			0.31434			1.05		
07/25/22 16:00	0.7			1.5			1			0.64			0.32178			1.07		
07/25/22 17:00	0.6			1.5			1			0.66			0.3288			1.1		
07/25/22 18:00	0.5			1.5			2			0.66			0.33234			1.11		
07/25/22 19:00	0.9			1.5			1			0.62			0.30918			1.03		
07/25/22 20:00	1.2			1.5			1			0.6			0.30144			1		
07/25/22 21:00	1.2			1.5			1			0.6			0.30036			1		
07/25/22 22:00	0.9			1.5			1			0.45			0.22728			0.76		
07/25/22 23:00	0.7			1.5			1			0.41			0.2043			0.68		
07/26/22 0:00	0.6			1.5			2			0.35			0.17394			0.58		
07/26/22 1:00	0.6			1.5			2			0.35			0.17346			0.58		
07/26/22 2:00	0.6			1.5			2			0.35			0.1737			0.58		
07/26/22 3:00	0.6			1.5			2			0.35			0.17328			0.58		
07/26/22 4:00	0.9			1.5			1			0.48			0.2424			0.81		
07/26/22 5:00	1.7			1.5			1			0.58			0.29238			0.97		
07/26/22 6:00	0.7			1.5			2			0.4			0.19968			0.67		
07/26/22 7:00	0.6			1.5			1			0.35			0.1752			0.58		
07/26/22 8:00	0.5			1.5			2			0.34			0.16968			0.57		
07/26/22 9:00	0.5			1.5			2			0.34			0.16902			0.56		
07/26/22 10:00	0.6			1.4			1			0.35			0.17346			0.58		
07/26/22 11:00	0.5			1.5			2			0.34			0.16944			0.56		
07/26/22 12:00	0.6			1.5			1			0.36			0.1785			0.6		
07/26/22 13:00	1			1.4			0			0.49			0.2451			0.82		
07/26/22 14:00	1			1.5			1			0.61			0.30468			1.02		
07/26/22 15:00	1			1.5			1			0.61			0.30606			1.02		
07/26/22 16:00	0.7			1.5			1			0.63			0.31668			1.06		
07/26/22 17:00	0.4			1.5			2			0.67			0.33336			1.11		
07/26/22 18:00	0.6			1.5			1			0.64			0.32136			1.07		
07/26/22 19:00	1			1.5			1			0.61			0.30594			1.02		
07/26/22 20:00	1.1			1.5			1			0.6			0.30186			1.01		
07/26/22 21:00	1.3			1.5			1			0.6			0.29904			1		
07/26/22 22:00	1.4			1.5			1			0.59			0.2973			0.99		
07/26/22 23:00	0.9			1.5			1			0.46			0.22842			0.76		
07/27/22 0:00	0.6			1.5			2			0.35			0.1749			0.58		
07/27/22 1:00	0.6			1.5			2			0.35			0.1752			0.58		

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/27/22 2:00	0.6			1.5			2			0.35			0.17484			0.58		
07/27/22 3:00	0.6			1.5			2			0.35			0.17496			0.58		
07/27/22 4:00	0.6			1.5			2			0.35			0.1746			0.58		
07/27/22 5:00	0.6			1.5			1			0.37			0.18276			0.61		
07/27/22 6:00	0.6			1.6			2			0.39			0.19434			0.65		
07/27/22 7:00	0.6			1.6			1			0.36			0.17868			0.6		
07/27/22 8:00	0.5			1.7			1			0.35			0.17484			0.58		
07/27/22 9:00	0.5			1.6			2			0.34			0.16896			0.56		
07/27/22 10:00	0.5			1.6			0			0.35			0.17412			0.58		
07/27/22 11:00	0.5			1.6			0			0.35			0.17508			0.58		
07/27/22 12:00	0.5			1.6			1			0.35			0.1728			0.58		
07/27/22 13:00	1			1.6			0			0.55			0.27552			0.92		
07/27/22 14:00	0.9			1.7			1			0.62			0.3078			1.03		
07/27/22 15:00	0.7			1.6			1			0.62			0.30942			1.03		
07/27/22 16:00	0.7			1.7			1			0.62			0.31104			1.04		
07/27/22 17:00	0.2			1.7			2			0.71			0.3525			1.18		
07/27/22 18:00	0.9			1.6			1			0.61			0.3054			1.02		
07/27/22 19:00	1			1.7			1			0.61			0.30318			1.01		
07/27/22 20:00	1.1			1.7			1			0.6			0.30102			1		
07/27/22 21:00	1			1.6			1			0.53			0.26568			0.89		
07/27/22 22:00	0.6			1.6			1			0.43			0.21564			0.72		
07/27/22 23:00	0.6			1.7			1			0.42			0.20988			0.7		
07/28/22 0:00	0.7			1.5			2			0.4			0.20112			0.67		
07/28/22 1:00	0.6			1.6			1			0.36			0.18126			0.6		
07/28/22 2:00	0.6			1.6			1			0.35			0.17532			0.58		
07/28/22 3:00	1.2			1.7			1			0.49			0.24378			0.81		
07/28/22 4:00	1.7			1.7			1			0.59			0.2946			0.98		
07/28/22 5:00	1.3			1.6			1			0.52			0.26124			0.87		
07/28/22 6:00	0.7			1.6			1			0.46			0.23124			0.77		
07/28/22 7:00	0.7			1.6			1			0.45			0.22368			0.75		
07/28/22 8:00	0.5			1.6			1			0.35			0.17412			0.58		
07/28/22 9:00	0.5			1.6			1			0.35			0.17706			0.59		
07/28/22 10:00	0.7			1.6			0			0.52			0.26016			0.87		
07/28/22 11:00	0.9			1.7			1			0.62			0.30888			1.03		
07/28/22 12:00	0.9			1.7			1			0.61			0.30648			1.02		
07/28/22 13:00	0.8			1.7			1			0.62			0.31008			1.03		
07/28/22 14:00	0.4			1.7			2			0.67			0.33492			1.12		

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/28/22 15:00	0.7			1.7			1			0.62			0.30834			1.03		
07/28/22 16:00	0.7			1.7			1			0.62			0.31206			1.04		
07/28/22 17:00	0.4			1.7			2			0.69			0.34626			1.15		
07/28/22 18:00	0.2			1.6			2			0.71			0.3549			1.18		
07/28/22 19:00	0.7			1.6			1			0.64			0.31848			1.06		
07/28/22 20:00	0.8			1.6			1			0.63			0.31374			1.05		
07/28/22 21:00	1.2			1.6			1			0.6			0.29946			1		
07/28/22 22:00	1			1.6			1			0.51			0.25668			0.86		
07/28/22 23:00	0.6			1.6			1			0.35			0.17676			0.59		
07/29/22 0:00	0.6			1.6			2			0.34			0.17106			0.57		
07/29/22 1:00	0.6			1.6			2			0.34			0.17028			0.57		
07/29/22 2:00	0.6			1.6			1			0.35			0.17304			0.58		
07/29/22 3:00	0.6			1.6			2			0.35			0.17394			0.58		
07/29/22 4:00	1.2			1.6			1			0.54			0.27156			0.91		
07/29/22 5:00	1.6			1.6			1			0.59			0.29358			0.98		
07/29/22 6:00	0.8			1.6			1			0.43			0.2139			0.71		
07/29/22 7:00	0.6			1.6			2			0.35			0.17544			0.58		
07/29/22 8:00	0.6			1.6			1			0.35			0.17514			0.58		
07/29/22 9:00	0.5			1.6			1			0.35			0.1752			0.58		
07/29/22 10:00	0.6			1.6			0			0.35			0.17538			0.58		
07/29/22 11:00	0.6			1.6			0			0.39			0.19272			0.64		
07/29/22 12:00	1.1			1.6			1			0.6			0.29772			0.99		
07/29/22 13:00	0.8			1.6			1			0.62			0.30936			1.03		
07/29/22 14:00	0.6			1.6			1			0.64			0.31992			1.07		
07/29/22 15:00	0.7			1.6			1			0.62			0.3096			1.03		
07/29/22 16:00	0.6			1.6			1			0.62			0.31068			1.04		
07/29/22 17:00	0.6			1.6			1			0.64			0.31824			1.06		
07/29/22 18:00	0.8			1.6			1			0.61			0.30738			1.02		
07/29/22 19:00	1			1.6			1			0.61			0.30438			1.01		
07/29/22 20:00	1.1			1.6			1			0.6			0.30228			1.01		
07/29/22 21:00	1			1.6			1			0.61			0.30582			1.02		
07/29/22 22:00	1.2			1.6			1			0.6			0.29868			1		
07/29/22 23:00	1.1			1.6			1			0.61			0.30378			1.01		
07/30/22 0:00	1.3			1.6			1			0.59			0.29472			0.98		
07/30/22 1:00	1.4			1.6			1			0.59			0.29298			0.98		
07/30/22 2:00	0.7			1.5			1			0.49			0.2427			0.81		
07/30/22 3:00	0.7			1.6			1			0.51			0.25362			0.85		

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/30/22 4:00	1.5			1.6			1			0.58			0.28788			0.96		
07/30/22 5:00	1.5			1.6			1			0.6			0.29916			1		
07/30/22 6:00	1			1.7			1			0.54			0.26988			0.9		
07/30/22 7:00	0.6			1.7			1			0.38			0.18768			0.63		
07/30/22 8:00	0.5			1.7			1			0.35			0.17424			0.58		
07/30/22 9:00	0.5			1.7			2			0.34			0.1689			0.56		
07/30/22 10:00	0.5			1.6			2			0.34			0.16824			0.56		
07/30/22 11:00	0.8			1.6			0			0.42			0.21198			0.71		
07/30/22 12:00	1			1.7			1			0.61			0.30696			1.02		
07/30/22 13:00	0.8			1.7			1			0.62			0.30906			1.03		
07/30/22 14:00	0.5			1.7			2			0.69			0.34368			1.15		
07/30/22 15:00	0.1			1.7			3			0.77			0.3828			1.28		
07/30/22 16:00	0.2			1.7			2			0.74			0.37008			1.23		
07/30/22 17:00	0.4			1.7			1			0.66			0.33126			1.1		
07/30/22 18:00	0.9			1.6			1			0.61			0.30588			1.02		
07/30/22 19:00	1			1.6			1			0.61			0.3039			1.01		
07/30/22 20:00	1.2			1.6			1			0.6			0.30042			1		
07/30/22 21:00	0.9			1.6			1			0.62			0.31074			1.04		
07/30/22 22:00	1.2			1.6			1			0.6			0.29916			1		
07/30/22 23:00	1.2			1.6			1			0.59			0.29718			0.99		
07/31/22 0:00	1.3			1.6			1			0.59			0.29658			0.99		
07/31/22 1:00	1.3			1.6			1			0.59			0.2961			0.99		
07/31/22 2:00	1.3			1.6			1			0.59			0.29532			0.98		
07/31/22 3:00	1			1.6			1			0.51			0.25578			0.85		
07/31/22 4:00	0.5			1.5			2			0.34			0.16914			0.56		
07/31/22 5:00	0.6			1.5			1			0.44			0.2196			0.73		
07/31/22 6:00	0.7			1.6			1			0.46			0.23196			0.77		
07/31/22 7:00	0.6			1.6			2			0.35			0.17286			0.58		
07/31/22 8:00	0.5			1.6			2			0.33			0.16584			0.55		
07/31/22 9:00	0.5			1.6			1			0.34			0.17208			0.57		
07/31/22 10:00	0.8			1.5			1			0.47			0.23748			0.79		
07/31/22 11:00	1.1			1.6			1			0.59			0.29712			0.99		
07/31/22 12:00	1.1			1.6			1			0.59			0.29718			0.99		
07/31/22 13:00	1.1			1.6			1			0.6			0.29832			0.99		
07/31/22 14:00	0.7			1.6			1			0.64			0.32028			1.07		
07/31/22 15:00	0.7			1.6			1			0.63			0.3135			1.05		
07/31/22 16:00	0.7			1.6			2			0.65			0.32274			1.08		

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/31/22 17:00	0.3			1.6			2			0.69			0.34488			1.15		
07/31/22 18:00	0.9			1.6			1			0.6			0.30222			1.01		
07/31/22 19:00	1.1			1.6			1			0.6			0.29862			1		
07/31/22 20:00	1.1			1.6			1			0.6			0.3			1		
07/31/22 21:00	1			1.6			1			0.61			0.30426			1.01		
07/31/22 22:00	1			1.6			1			0.52			0.25818			0.86		
07/31/22 23:00	0.6			1.6			1			0.35			0.17682			0.59		
08/01/22 0:00	0.7			1.5			1			0.46			0.228			0.76		
08/01/22 1:00	0.6			1.6			2			0.35			0.17286			0.58		
08/01/22 2:00	0.6			1.6			2			0.35			0.1731			0.58		
08/01/22 3:00	1			1.6			1			0.46			0.23202			0.77		
08/01/22 4:00	1.5			1.6			1			0.59			0.29322			0.98		
08/01/22 5:00	1			1.7			2			0.64			0.318			1.06		
08/01/22 6:00	0.3			1			3			0.68			0.34182			1.14		
08/01/22 7:00	1.5			1.6			0			0.59			0.29304			0.98		
08/01/22 8:00	1.3			1.8			1			0.59			0.29484			0.98		
08/01/22 9:00	1.2			1.7			1			0.6			0.2988			1		
08/01/22 10:00	1.2			1.7			1			0.59			0.29694			0.99		
08/01/22 11:00	1.1			1.7			1			0.6			0.29802			0.99		
08/01/22 12:00	1.2			1.7			1			0.6			0.29778			0.99		
08/01/22 13:00	1.2			1.7			1			0.6			0.29844			0.99		
08/01/22 14:00	1.2			1.7			1			0.6			0.29898			1		
08/01/22 15:00	1.1			1.7			1			0.6			0.30114			1		
08/01/22 16:00	1.1			1.7			1			0.6			0.30006			1		
08/01/22 17:00	1.2			1.7			1			0.6			0.2994			1		
08/01/22 18:00	1.2			1.7			1			0.6			0.29904			1		
08/01/22 19:00	1.3			1.7			1			0.6			0.29874			1		
08/01/22 20:00	1.2			1.7			1			0.6			0.30168			1.01		
08/01/22 21:00	1.2			1.7			1			0.6			0.30198			1.01		
08/01/22 22:00	1.2			1.7			1			0.52			0.26166			0.87		
08/01/22 23:00	0.8			1.7			2			0.35			0.17412			0.58		
08/02/22 0:00	0.8			1.7			1			0.34			0.17148			0.57		
08/02/22 1:00	0.9			1.7			2			0.34			0.16866			0.56		
08/02/22 2:00	1			1.7			2			0.33			0.1656			0.55		
08/02/22 3:00	1			1.6			1			0.35			0.1725			0.58		
08/02/22 4:00	1.2			1.7			1			0.47			0.23268			0.78		
08/02/22 5:00	1.3			1.7			1			0.59			0.29694			0.99		

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/02/22 6:00	1.1			1.6			2			0.45			0.22572			0.75		
08/02/22 7:00	0.7			1.6			2			0.33			0.16572			0.55		
08/02/22 8:00	0.6			1.6			1			0.33			0.16578			0.55		
08/02/22 9:00	0.5			1.6			1			0.33			0.1659			0.55		
08/02/22 10:00	0.5			1.6			1			0.33			0.16584			0.55		
08/02/22 11:00	0.8			1.5			0			0.46			0.22824			0.76		
08/02/22 12:00	0.8			1.6			1			0.62			0.3105			1.04		
08/02/22 13:00	0.7			1.6			1			0.62			0.31212			1.04		
08/02/22 14:00	0.7			1.6			1			0.62			0.30918			1.03		
08/02/22 15:00	0.7			1.6			1			0.62			0.30996			1.03		
08/02/22 16:00	0.2			1.6			2			0.7			0.35034			1.17		
08/02/22 17:00	0.1			1.6			3			0.75			0.37482			1.25		
08/02/22 18:00	0.6			1.6			1			0.64			0.31842			1.06		
08/02/22 19:00	0.9			1.6			1			0.6			0.3015			1.01		
08/02/22 20:00	0.9			1.6			1			0.61			0.30558			1.02		
08/02/22 21:00	1.2			1.6			1			0.59			0.297			0.99		
08/02/22 22:00	1.2			1.6			1			0.59			0.29736			0.99		
08/02/22 23:00	1.3			1.6			1			0.59			0.29712			0.99		
08/03/22 0:00	0.8			1.6			1			0.4			0.19878			0.66		
08/03/22 1:00	0.6			1.6			1			0.35			0.17334			0.58		
08/03/22 2:00	0.6			1.7			1			0.35			0.17304			0.58		
08/03/22 3:00	0.6			1.6			2			0.35			0.1725			0.58		
08/03/22 4:00	0.9			1.5			1			0.46			0.23184			0.77		
08/03/22 5:00	1.5			1.6			1			0.59			0.29268			0.98		
08/03/22 6:00	0.8			1.6			1			0.42			0.20922			0.7		
08/03/22 7:00	0.5			1.6			2			0.34			0.16914			0.56		
08/03/22 8:00	0.6			1.6			0			0.35			0.17316			0.58		
08/03/22 9:00	0.5			1.6			1			0.34			0.16824			0.56		
08/03/22 10:00	0.5			1.6			1			0.33			0.1665			0.56		
08/03/22 11:00	0.6			1.6			0			0.36			0.17916			0.6		
08/03/22 12:00	0.6			1.6			0			0.41			0.20442			0.68		
08/03/22 13:00	0.9			1.6			1			0.59			0.29334			0.98		
08/03/22 14:00	0.6			1.6			1			0.63			0.31422			1.05		
08/03/22 15:00	0.7			1.6			1			0.62			0.30846			1.03		
08/03/22 16:00	0.7			1.6			1			0.62			0.3111			1.04		
08/03/22 17:00	0.2			1.6			3			0.77			0.3846			1.28		
08/03/22 18:00	0.2			1.6			3			0.77			0.38538			1.28		

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/03/22 19:00	0.2			1.6			3			0.76			0.38118			1.27		
08/03/22 20:00	0.2			1.6			2			0.71			0.3534			1.18		
08/03/22 21:00	1			1.6			1			0.6			0.30216			1.01		
08/03/22 22:00	1.1			1.6			1			0.6			0.2979			0.99		
08/03/22 23:00	1.1			1.6			1			0.6			0.29874			1		
08/04/22 0:00	1.2			1.6			1			0.59			0.29694			0.99		
08/04/22 1:00	1.2			1.6			1			0.59			0.29598			0.99		
08/04/22 2:00	1.2			1.6			1			0.56			0.28074			0.94		
08/04/22 3:00	0.7			1.5			0			0.35			0.17508			0.58		
08/04/22 4:00	0.8			1.6			0			0.45			0.22518			0.75		
08/04/22 5:00	1.2			1.6			1			0.59			0.29562			0.99		
08/04/22 6:00	1.1			1.6			1			0.55			0.27276			0.91		
08/04/22 7:00	0.7			1.6			1			0.46			0.22884			0.76		
08/04/22 8:00	0.9			1.6			0			0.47			0.23256			0.78		
08/04/22 9:00	1.1			1.6			1			0.6			0.2979			0.99		
08/04/22 10:00	1.1			1.6			1			0.6			0.29922			1		
08/04/22 11:00	1			1.6			1			0.61			0.30348			1.01		
08/04/22 12:00	0.8			1.6			1			0.63			0.3138			1.05		
08/04/22 13:00	0.2			1.5			1			0.67			0.33594			1.12		
08/04/22 14:00	0.2			1.7			3			0.78			0.38808			1.29		
08/04/22 15:00	0.1			1.6			3			0.76			0.38058			1.27		
08/04/22 16:00	0.2			1.6			3			0.75			0.3756			1.25		
08/04/22 17:00	0.2			1.6			3			0.73			0.3666			1.22		
08/04/22 18:00	0.4			1.6			2			0.68			0.3408			1.14		
08/04/22 19:00	0.7			1.6			1			0.64			0.32184			1.07		
08/04/22 20:00	1.1			1.6			1			0.6			0.29982			1		
08/04/22 21:00	1.2			1.6			1			0.59			0.29586			0.99		
08/04/22 22:00	1.3			1.6			1			0.59			0.29406			0.98		
08/04/22 23:00	0.8			1.6			1			0.45			0.22698			0.76		
08/05/22 0:00	0.6			1.5			1			0.37			0.1869			0.62		
08/05/22 1:00	0.6			1.6			1			0.35			0.17538			0.58		
08/05/22 2:00	0.6			1.6			1			0.38			0.19212			0.64		
08/05/22 3:00	0.6			1.5			2			0.35			0.17304			0.58		
08/05/22 4:00	0.7			1.5			1			0.41			0.20502			0.68		
08/05/22 5:00	1.7			1.5			1			0.58			0.2913			0.97		
08/05/22 6:00	1.5			1.5			1			0.59			0.2961			0.99		
08/05/22 7:00	1.4			1.5			1			0.58			0.29172			0.97		

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/05/22 8:00	1.3			1.5			1			0.58			0.29238			0.97		
08/05/22 9:00	1.2			1.5			1			0.59			0.29328			0.98		
08/05/22 10:00	1.1			1.5			1			0.59			0.29448			0.98		
08/05/22 11:00	1.1			1.5			1			0.6			0.29784			0.99		
08/05/22 12:00	1.1			1.5			1			0.6			0.29922			1		
08/05/22 13:00	1			1.5			1			0.6			0.29868			1		
08/05/22 14:00	1.1			1.5			1			0.6			0.30066			1		
08/05/22 15:00	1.1			1.5			1			0.6			0.30078			1		
08/05/22 16:00	1.1			1.5			1			0.6			0.3006			1		
08/05/22 17:00	1			1.5			1			0.6			0.3018			1.01		
08/05/22 18:00	1			1.5			1			0.6			0.3012			1		
08/05/22 19:00	1.1			1.5			1			0.6			0.2997			1		
08/05/22 20:00	1.2			1.5			1			0.6			0.29772			0.99		
08/05/22 21:00	1.2			1.5			1			0.59			0.29634			0.99		
08/05/22 22:00	1.1			1.5			1			0.51			0.2553			0.85		
08/05/22 23:00	0.6			1.5			2			0.34			0.17106			0.57		
08/06/22 0:00	0.6			1.5			2			0.34			0.17112			0.57		
08/06/22 1:00	0.6			1.5			2			0.34			0.16926			0.56		
08/06/22 2:00	0.5			1.5			2			0.33			0.1656			0.55		
08/06/22 3:00	0.5			1.5			3			0.33			0.16542			0.55		
08/06/22 4:00	0.5			1.5			3			0.33			0.16578			0.55		
08/06/22 5:00	0.5			1.5			2			0.34			0.16944			0.56		
08/06/22 6:00	0.5			1.5			2			0.34			0.16758			0.56		
08/06/22 7:00	0.5			1.5			2			0.33			0.16626			0.55		
08/06/22 8:00	0.5			1.5			2			0.33			0.16572			0.55		
08/06/22 9:00	0.5			1.5			2			0.33			0.16566			0.55		
08/06/22 10:00	0.5			1.5			2			0.33			0.1659			0.55		
08/06/22 11:00	0.5			1.5			2			0.33			0.1665			0.56		
08/06/22 12:00	0.5			1.5			1			0.33			0.16668			0.56		
08/06/22 13:00	0.5			1.5			1			0.33			0.16674			0.56		
08/06/22 14:00	0.5			1.5			1			0.34			0.16872			0.56		
08/06/22 15:00	0.5			1.5			1			0.33			0.16704			0.56		
08/06/22 16:00	0.5			1.5			1			0.34			0.16974			0.57		
08/06/22 17:00	0.6			1.5			0			0.35			0.17652			0.59		
08/06/22 18:00	0.7			1.7			0			0.49			0.24414			0.81		
08/06/22 19:00	0.9			1.7			1			0.5			0.25176			0.84		
08/06/22 20:00	1			1.7			1			0.59			0.2943			0.98		

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/06/22 21:00	1			1.7			1			0.51			0.25362			0.85		
08/06/22 22:00	0.6			1.7			2			0.34			0.17058			0.57		
08/06/22 23:00	0.6			1.7			2			0.34			0.17172			0.57		
08/07/22 0:00	0.5			1.7			2			0.34			0.1683			0.56		
08/07/22 1:00	0.6			1.7			1			0.35			0.17316			0.58		
08/07/22 2:00	0.6			1.8			3			0.34			0.16902			0.56		
08/07/22 3:00	0.5			1.7			3			0.33			0.16542			0.55		
08/07/22 4:00	0.6			1.7			2			0.34			0.17136			0.57		
08/07/22 5:00	0.6			1.7			2			0.34			0.17112			0.57		
08/07/22 6:00	0.5			1.7			2			0.34			0.16842			0.56		
08/07/22 7:00	0.5			1.7			2			0.33			0.16656			0.56		
08/07/22 8:00	0.5			1.7			2			0.33			0.1659			0.55		
08/07/22 9:00	0.5			1.7			2			0.33			0.16554			0.55		
08/07/22 10:00	0.5			1.7			2			0.33			0.16548			0.55		
08/07/22 11:00	0.5			1.7			2			0.33			0.16614			0.55		
08/07/22 12:00	0.5			1.7			1			0.33			0.16644			0.55		
08/07/22 13:00	0.5			1.7			1			0.33			0.16734			0.56		
08/07/22 14:00	0.5			1.7			1			0.34			0.17022			0.57		
08/07/22 15:00	0.5			1.7			1			0.34			0.1683			0.56		
08/07/22 16:00	0.6			1.7			0			0.39			0.19452			0.65		
08/07/22 17:00	0.9			1.7			1			0.55			0.27336			0.91		
08/07/22 18:00	1.1			1.7			1			0.6			0.2982			0.99		
08/07/22 19:00	1.2			1.7			1			0.59			0.29592			0.99		
08/07/22 20:00	1.2			1.7			1			0.59			0.29328			0.98		
08/07/22 21:00	1.3			1.7			1			0.59			0.29262			0.98		
08/07/22 22:00	0.9			1.7			1			0.45			0.22572			0.75		
08/07/22 23:00	0.6			1.7			2			0.35			0.17304			0.58		
08/08/22 0:00	0.6			1.7			2			0.35			0.17472			0.58		
08/08/22 1:00	0.6			1.7			1			0.35			0.17304			0.58		
08/08/22 2:00	0.6			1.7			2			0.35			0.17274			0.58		
08/08/22 3:00	0.6			1.7			2			0.35			0.1728			0.58		
08/08/22 4:00	0.9			1.7			1			0.48			0.24132			0.8		
08/08/22 5:00	1.6			1.7			1			0.58			0.29214			0.97		
08/08/22 6:00	1			1.5			1			0.45			0.22554			0.75		
08/08/22 7:00	0.6			1.6			2			0.34			0.1695			0.57		
08/08/22 8:00	0.5			1.5			2			0.34			0.1677			0.56		
08/08/22 9:00	0.6			1.6			1			0.34			0.1701			0.57		

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/08/22 10:00	0.6			1.5			1			0.35			0.17286			0.58		
08/08/22 11:00	0.9			1.6			1			0.48			0.23952			0.8		
08/08/22 12:00	1			1.6			1			0.61			0.30336			1.01		
08/08/22 13:00	0.7			1.5			1			0.41			0.20274			0.68		
08/08/22 14:00	0.7			1.6			1			0.46			0.2319			0.77		
08/08/22 15:00	1.1			1.6			1			0.6			0.30036			1		
08/08/22 16:00	1			1.6			1			0.6			0.30228			1.01		
08/08/22 17:00	0.7			1.6			2			0.65			0.32526			1.08		
08/08/22 18:00	0.5			1.6			2			0.67			0.33504			1.12		
08/08/22 19:00	0.4			1.6			2			0.7			0.35052			1.17		
08/08/22 20:00	0.5			1.6			2			0.69			0.34332			1.14		
08/08/22 21:00	1.1			1.6			1			0.61			0.30552			1.02		
08/08/22 22:00	1.2			1.6			1			0.59			0.29736			0.99		
08/08/22 23:00	1.4			1.6			1			0.58			0.2922			0.97		
08/09/22 0:00	1.5			1.6			1			0.58			0.29244			0.97		
08/09/22 1:00	1.5			1.6			1			0.58			0.29196			0.97		
08/09/22 2:00	1.5			1.6			1			0.58			0.29226			0.97		
08/09/22 3:00	1.5			1.6			1			0.58			0.29226			0.97		
08/09/22 4:00	1.6			1.6			1			0.58			0.29184			0.97		
08/09/22 5:00	1.5			1.6			1			0.58			0.29178			0.97		
08/09/22 6:00	1.4			1.6			1			0.58			0.2919			0.97		
08/09/22 7:00	1.4			1.6			1			0.58			0.29208			0.97		
08/09/22 8:00	1.3			1.6			1			0.59			0.29328			0.98		
08/09/22 9:00	1.1			1.6			1			0.59			0.2946			0.98		
08/09/22 10:00	1.1			1.6			1			0.59			0.2958			0.99		
08/09/22 11:00	1.1			1.6			1			0.6			0.29784			0.99		
08/09/22 12:00	1.1			1.6			1			0.57			0.28584			0.95		
08/09/22 13:00	0.6			1.6			1			0.36			0.17904			0.6		
08/09/22 14:00	0.8			1.6			1			0.47			0.23676			0.79		
08/09/22 15:00	1			1.6			1			0.6			0.2997			1		
08/09/22 16:00	1			1.6			1			0.6			0.2985			1		
08/09/22 17:00	1			1.7			1			0.6			0.2997			1		
08/09/22 18:00	0.6			1.7			2			0.68			0.34032			1.13		
08/09/22 19:00	0.8			1.7			1			0.63			0.31704			1.06		
08/09/22 20:00	0.5			1.7			2			0.68			0.3414			1.14		
08/09/22 21:00	0.8			1.7			2			0.64			0.32184			1.07		
08/09/22 22:00	1			1.7			1			0.62			0.31104			1.04		

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/09/22 23:00	1.3			1.7			1			0.57			0.28686			0.96		
08/10/22 0:00	0.7			1.7			1			0.52			0.25758			0.86		
08/10/22 1:00	0.7			1.7			1			0.53			0.26448			0.88		
08/10/22 2:00	0.7			1.8			1			0.53			0.26652			0.89		
08/10/22 3:00	1.2			1.7			1			0.56			0.27954			0.93		
08/10/22 4:00	0.8			1.7			2			0.65			0.32286			1.08		
08/10/22 5:00	1.1			1.7			1			0.62			0.30912			1.03		
08/10/22 6:00	0.9			1.7			2			0.45			0.22614			0.75		
08/10/22 7:00	0.6			1.6			2			0.34			0.17136			0.57		
08/10/22 8:00	0.6			1.7			1			0.34			0.17208			0.57		
08/10/22 9:00	0.5			1.6			1			0.34			0.17088			0.57		
08/10/22 10:00	0.5			1.7			1			0.35			0.1737			0.58		
08/10/22 11:00	0.6			1.6			1			0.38			0.18804			0.63		
08/10/22 12:00	0.5			1.6			1			0.35			0.17352			0.58		
08/10/22 13:00	0.5			1.6			1			0.38			0.19098			0.64		
08/10/22 14:00	0.8			1.7			1			0.56			0.28044			0.93		
08/10/22 15:00	0.6			1.7			1			0.64			0.32208			1.07		
08/10/22 16:00	1			1.7			1			0.6			0.29784			0.99		
08/10/22 17:00	0.9			1.7			1			0.61			0.30654			1.02		
08/10/22 18:00	0.4			1.7			2			0.7			0.34944			1.16		
08/10/22 19:00	0.4			1.7			2			0.68			0.342			1.14		
08/10/22 20:00	0.6			1.7			1			0.65			0.3243			1.08		
08/10/22 21:00	1			1.7			1			0.62			0.3105			1.04		
08/10/22 22:00	1			1.7			1			0.54			0.26802			0.89		
08/10/22 23:00	0.7			1.7			1			0.52			0.25782			0.86		
08/11/22 0:00	0.7			1.7			1			0.52			0.2595			0.87		
08/11/22 1:00	0.7			1.7			1			0.51			0.25692			0.86		
08/11/22 2:00	0.7			1.7			1			0.49			0.24324			0.81		
08/11/22 3:00	0.7			1.8			1			0.5			0.252			0.84		
08/11/22 4:00	0.7			1.7			1			0.52			0.25836			0.86		
08/11/22 5:00	0.7			1.6			1			0.53			0.26412			0.88		
08/11/22 6:00	0.7			1.6			1			0.44			0.21822			0.73		
08/11/22 7:00	0.6			1.5			1			0.39			0.19506			0.65		
08/11/22 8:00	0.5			1.6			1			0.35			0.17298			0.58		
08/11/22 9:00	0.5			1.6			1			0.35			0.1728			0.58		
08/11/22 10:00	0.5			1.6			1			0.35			0.17298			0.58		
08/11/22 11:00	0.6			1.6			0			0.47			0.23532			0.78		

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/11/22 12:00	1			1.6			1			0.5			0.25134			0.84		
08/11/22 13:00	0.5			1.6			2			0.68			0.3393			1.13		
08/11/22 14:00	0.7			1.6			1			0.64			0.31884			1.06		
08/11/22 15:00	0.5			1.6			2			0.67			0.33666			1.12		
08/11/22 16:00	0.5			1.6			2			0.67			0.3354			1.12		
08/11/22 17:00	0.4			1.6			2			0.68			0.34194			1.14		
08/11/22 18:00	0.3			1.7			2			0.71			0.35382			1.18		
08/11/22 19:00	0.4			1.7			2			0.68			0.34062			1.14		
08/11/22 20:00	0.3			1.7			2			0.72			0.35934			1.2		
08/11/22 21:00	1.2			1.7			1			0.58			0.2889			0.96		
08/11/22 22:00	0.7			1.7			1			0.52			0.25866			0.86		
08/11/22 23:00	0.7			1.7			1			0.52			0.25956			0.87		
08/12/22 0:00	0.6			1.7			1			0.55			0.27336			0.91		
08/12/22 1:00	0.7			1.7			1			0.54			0.26868			0.9		
08/12/22 2:00	0.7			1.7			1			0.5			0.2484			0.83		
08/12/22 3:00	0.7			1.7			1			0.52			0.25872			0.86		
08/12/22 4:00	0.7			1.7			1			0.54			0.2694			0.9		
08/12/22 5:00	0.7			1.6			1			0.54			0.2685			0.9		
08/12/22 6:00	0.7			1.6			1			0.4			0.20202			0.67		
08/12/22 7:00	0.6			1.6			2			0.39			0.1971			0.66		
08/12/22 8:00	0.5			1.6			1			0.34			0.16932			0.56		
08/12/22 9:00	0.5			1.7			2			0.34			0.1695			0.57		
08/12/22 10:00	0.5			1.6			1			0.34			0.17244			0.57		
08/12/22 11:00	0.5			1.6			1			0.34			0.17148			0.57		
08/12/22 12:00	0.7			1.5			0			0.41			0.20532			0.68		
08/12/22 13:00	1			1.5			1			0.6			0.29754			0.99		
08/12/22 14:00	0.9			1.5			1			0.61			0.30624			1.02		
08/12/22 15:00	0.9			1.5			1			0.61			0.30432			1.01		
08/12/22 16:00	0.9			1.5			1			0.61			0.3033			1.01		
08/12/22 17:00	0.4			1.5			2			0.68			0.34122			1.14		
08/12/22 18:00	0.2			1.7			2			0.72			0.35934			1.2		
08/12/22 19:00	0.5			1.7			2			0.66			0.33006			1.1		
08/12/22 20:00	0.7			1.7			1			0.64			0.31914			1.06		
08/12/22 21:00	1.1			1.6			1			0.58			0.28872			0.96		
08/12/22 22:00	0.7			1.6			1			0.45			0.22656			0.76		
08/12/22 23:00	0.7			1.6			1			0.51			0.25506			0.85		
08/13/22 0:00	0.7			1.7			1			0.5			0.2499			0.83		

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/13/22 1:00	0.7			1.7			1			0.5			0.25212			0.84		
08/13/22 2:00	0.7			1.8			1			0.51			0.25272			0.84		
08/13/22 3:00	0.8			1.6			1			0.51			0.25722			0.86		
08/13/22 4:00	0.7			1.6			1			0.53			0.26496			0.88		
08/13/22 5:00	0.7			1.6			1			0.53			0.26262			0.88		
08/13/22 6:00	0.7			1.6			2			0.41			0.20658			0.69		
08/13/22 7:00	0.5			1.6			2			0.34			0.16968			0.57		
08/13/22 8:00	0.5			1.5			2			0.34			0.16914			0.56		
08/13/22 9:00	0.6			1.6			1			0.34			0.17244			0.57		
08/13/22 10:00	0.5			1.5			1			0.34			0.17124			0.57		
08/13/22 11:00	0.5			1.6			1			0.35			0.17328			0.58		
08/13/22 12:00	0.6			1.5			0			0.4			0.20052			0.67		
08/13/22 13:00	0.9			1.6			1			0.48			0.23928			0.8		
08/13/22 14:00	1.1			1.6			1			0.6			0.3			1		
08/13/22 15:00	1			1.6			1			0.6			0.30078			1		
08/13/22 16:00	1			1.6			1			0.61			0.30264			1.01		
08/13/22 17:00	0.6			1.6			2			0.66			0.33036			1.1		
08/13/22 18:00	0.6			1.6			1			0.64			0.31884			1.06		
08/13/22 19:00	1.1			1.6			1			0.6			0.29844			0.99		
08/13/22 20:00	0.9			1.6			1			0.54			0.26838			0.89		
08/13/22 21:00	0.6			1.6			1			0.37			0.1833			0.61		
08/13/22 22:00	0.7			1.5			1			0.41			0.20334			0.68		
08/13/22 23:00	0.7			1.6			1			0.49			0.24372			0.81		
08/14/22 0:00	0.7			1.6			1			0.43			0.21324			0.71		
08/14/22 1:00	0.7			1.5			1			0.45			0.22314			0.74		
08/14/22 2:00	0.8			1.7			1			0.46			0.22902			0.76		
08/14/22 3:00	0.8			1.7			2			0.46			0.22836			0.76		
08/14/22 4:00	0.8			1.5			1			0.44			0.21912			0.73		
08/14/22 5:00	0.7			1.6			1			0.41			0.20364			0.68		
08/14/22 6:00	1.4			1.6			1			0.56			0.28098			0.94		
08/14/22 7:00	1.3			1.6			1			0.56			0.28188			0.94		
08/14/22 8:00	0.6			1.6			1			0.35			0.1773			0.59		
08/14/22 9:00	0.6			1.7			1			0.34			0.1722			0.57		
08/14/22 10:00	0.8			1.6			1			0.45			0.22614			0.75		
08/14/22 11:00	1			1.7			1			0.61			0.30546			1.02		
08/14/22 12:00	0.6			1.7			1			0.65			0.32628			1.09		
08/14/22 13:00	0.9			1.6			1			0.61			0.30546			1.02		

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/14/22 14:00	0.7			1.5			1			0.4			0.201			0.67		
08/14/22 15:00	0.6			1.6			0			0.42			0.20778			0.69		
08/14/22 16:00	0.6			1.6			1			0.41			0.20556			0.69		
08/14/22 17:00	0.8			1.7			1			0.53			0.26358			0.88		
08/14/22 18:00	1			1.7			1			0.6			0.30132			1		
08/14/22 19:00	1			1.7			1			0.6			0.30018			1		
08/14/22 20:00	1			1.7			1			0.51			0.25692			0.86		
08/14/22 21:00	0.6			1.6			1			0.35			0.17712			0.59		
08/14/22 22:00	0.7			1.6			1			0.34			0.17082			0.57		
08/14/22 23:00	0.7			1.6			1			0.35			0.17298			0.58		
08/15/22 0:00	0.6			1.7			1			0.34			0.17202			0.57		
08/15/22 1:00	0.6			1.7			1			0.34			0.17148			0.57		
08/15/22 2:00	0.6			1.7			1			0.34			0.17118			0.57		
08/15/22 3:00	0.7			1.7			1			0.36			0.18174			0.61		
08/15/22 4:00	0.7			1.6			1			0.41			0.204			0.68		
08/15/22 5:00	0.8			1.6			1			0.46			0.231			0.77		
08/15/22 6:00	0.7			1.6			2			0.37			0.18642			0.62		
08/15/22 7:00	0.5			1.6			2			0.34			0.16824			0.56		
08/15/22 8:00	0.5			1.7			2			0.33			0.1653			0.55		
08/15/22 9:00	0.5			1.6			1			0.34			0.16956			0.57		
08/15/22 10:00	0.6			1.6			1			0.37			0.18324			0.61		
08/15/22 11:00	0.6			1.7			0			0.35			0.17328			0.58		
08/15/22 12:00	0.6			1.6			0			0.38			0.18768			0.63		
08/15/22 13:00	0.8			1.7			1			0.57			0.28572			0.95		
08/15/22 14:00	0.3			1.7			2			0.72			0.35772			1.19		
08/15/22 15:00	0.1			1.7			2			0.72			0.36084			1.2		
08/15/22 16:00	0.1			1.7			3			0.73			0.3651			1.22		
08/15/22 17:00	0.2			1.7			3			0.73			0.3657			1.22		
08/15/22 18:00	0.1			1.6			2			0.72			0.36234			1.21		
08/15/22 19:00	0.4			1.7			2			0.68			0.34008			1.13		
08/15/22 20:00	0.8			1.6			1			0.58			0.2922			0.97		
08/15/22 21:00	0.7			1.6			0			0.46			0.23208			0.77		
08/15/22 22:00	0.7			1.6			1			0.39			0.19692			0.66		
08/15/22 23:00	0.8			1.6			0			0.45			0.22506			0.75		
08/16/22 0:00	0.8			1.7			0			0.46			0.22758			0.76		
08/16/22 1:00	0.8			1.6			1			0.43			0.21342			0.71		
08/16/22 2:00	0.8			1.5			0			0.41			0.2073			0.69		

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/16/22 3:00	0.8			1.6			1			0.4			0.20148			0.67		
08/16/22 4:00	0.7			1.5			1			0.43			0.21672			0.72		
08/16/22 5:00	0.9			1.6			1			0.5			0.24786			0.83		
08/16/22 6:00	0.8			1.6			2			0.39			0.19674			0.66		
08/16/22 7:00	0.6			1.6			2			0.34			0.16758			0.56		
08/16/22 8:00	0.6			1.6			1			0.34			0.16938			0.56		
08/16/22 9:00	0.6			1.6			0			0.38			0.1881			0.63		
08/16/22 10:00	0.7			1.6			0			0.42			0.21156			0.71		
08/16/22 11:00	0.7			1.6			1			0.46			0.2319			0.77		
08/16/22 12:00	0.8			1.6			1			0.49			0.24474			0.82		
08/16/22 13:00	0.2			1.6			3			0.75			0.37344			1.24		
08/16/22 14:00	0.2			1.6			4			0.79			0.39312			1.31		
08/16/22 15:00	0.2			1.6			4			0.79			0.39528			1.32		
08/16/22 16:00	0.1			1.6			4			0.79			0.39396			1.31		
08/16/22 17:00	0.1			1.6			4			0.79			0.39396			1.31		
08/16/22 18:00	0.1			1.6			4			0.79			0.39426			1.31		
08/16/22 19:00	0.1			1.6			3			0.75			0.37632			1.25		
08/16/22 20:00	0.2			1.6			3			0.73			0.3645			1.22		
08/16/22 21:00	0.5			1.6			2			0.67			0.33558			1.12		
08/16/22 22:00	1			1.6			1			0.61			0.30486			1.02		
08/16/22 23:00	0.9			1.6			0			0.52			0.26088			0.87		
08/17/22 0:00	0.7			1.6			1			0.53			0.2646			0.88		
08/17/22 1:00	0.7			1.6			1			0.51			0.2535			0.85		
08/17/22 2:00	0.7			1.7			1			0.52			0.25842			0.86		
08/17/22 3:00	0.8			1.6			1			0.51			0.25452			0.85		
08/17/22 4:00	0.7			1.6			1			0.51			0.2562			0.85		
08/17/22 5:00	0.7			1.6			1			0.54			0.26772			0.89		
08/17/22 6:00	0.7			1.6			1			0.54			0.2679			0.89		
08/17/22 7:00	0.6			1.3			1			0.5			0.2481			0.83		
08/17/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/17/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/17/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/17/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/17/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/17/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/17/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/17/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/17/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/17/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/17/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/17/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/17/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/17/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/17/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/17/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/18/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/18/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/18/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/18/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/18/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/18/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/18/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/18/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/18/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/18/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/18/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/18/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/18/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/18/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/18/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/18/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/18/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/18/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/18/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/18/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/18/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/18/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/18/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/18/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/19/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/19/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/19/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/19/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/19/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/19/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/19/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/19/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/19/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/19/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/19/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/19/22 11:00	0			0			0	X		0.34			0.16992			0.57		
08/19/22 12:00	0.7			1.6			2			0.36			0.1785			0.6		
08/19/22 13:00	0.5			1.6			1			0.33			0.1662			0.55		
08/19/22 14:00	0.6			1.5			1			0.35			0.17598			0.59		
08/19/22 15:00	0.6			1.6			1			0.36			0.1791			0.6		
08/19/22 16:00	0.6			1.6			1			0.35			0.17544			0.58		
08/19/22 17:00	0.7			1.6			0			0.48			0.2424			0.81		
08/19/22 18:00	0.7			1.7			1			0.49			0.24462			0.82		
08/19/22 19:00	0.7			1.6			1			0.45			0.22608			0.75		
08/19/22 20:00	0.7			1.6			1			0.42			0.20754			0.69		
08/19/22 21:00	0.7			1.6			1			0.38			0.18768			0.63		
08/19/22 22:00	0.7			1.7			1			0.36			0.17808			0.59		
08/19/22 23:00	0.7			1.7			1			0.36			0.18036			0.6		
08/20/22 0:00	0.7			1.7			1			0.36			0.18072			0.6		
08/20/22 1:00	0.7			1.7			1			0.36			0.17946			0.6		
08/20/22 2:00	0.7			1.7			1			0.36			0.17838			0.59		
08/20/22 3:00	0.7			1.7			2			0.35			0.17256			0.58		
08/20/22 4:00	0.6			1.7			2			0.34			0.1713			0.57		
08/20/22 5:00	0.6			1.7			2			0.34			0.17118			0.57		
08/20/22 6:00	0.6			1.7			2			0.34			0.1713			0.57		
08/20/22 7:00	0.6			1.7			1			0.34			0.17184			0.57		
08/20/22 8:00	0.6			1.7			1			0.34			0.17208			0.57		
08/20/22 9:00	0.6			1.7			1			0.34			0.17208			0.57		
08/20/22 10:00	0.6			1.6			1			0.34			0.17208			0.57		
08/20/22 11:00	0.6			1.7			1			0.34			0.17142			0.57		
08/20/22 12:00	0.5			1.7			1			0.34			0.17058			0.57		
08/20/22 13:00	0.5			1.6			1			0.34			0.17082			0.57		
08/20/22 14:00	0.6			1.6			1			0.4			0.19842			0.66		
08/20/22 15:00	0.7			1.7			1			0.5			0.25098			0.84		
08/20/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/20/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/20/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/20/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/20/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/20/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/20/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/20/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/21/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/21/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/21/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/21/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/21/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/21/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/21/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/21/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/21/22 8:00	0			0			0	X		0.31			0.15414			0.51		
08/21/22 9:00	0.5			1.6			1			0.34			0.16836			0.56		
08/21/22 10:00	0.6			1.7			1			0.37			0.18576			0.62		
08/21/22 11:00	0.6			1.6			1			0.45			0.22608			0.75		
08/21/22 12:00	0.7			1.7			0			0.55			0.27384			0.91		
08/21/22 13:00	0.7			1.7			1			0.55			0.27288			0.91		
08/21/22 14:00	0.7			1.7			1			0.55			0.27282			0.91		
08/21/22 15:00	0.7			1.7			1			0.55			0.27252			0.91		
08/21/22 16:00	0.8			1.7			1			0.54			0.2718			0.91		
08/21/22 17:00	0.8			1.6			1			0.65			0.3234			1.08		
08/21/22 18:00	0.6			1.6			1			0.64			0.32178			1.07		
08/21/22 19:00	1			1.6			1			0.59			0.29328			0.98		
08/21/22 20:00	0.7			1.6			1			0.55			0.2742			0.91		
08/21/22 21:00	0.6			1.6			1			0.55			0.27534			0.92		
08/21/22 22:00	0.6			1.6			1			0.55			0.27654			0.92		
08/21/22 23:00	0.6			1.6			1			0.55			0.276			0.92		
08/22/22 0:00	0.6			1.6			1			0.55			0.27606			0.92		
08/22/22 1:00	0.7			1.6			1			0.55			0.27588			0.92		
08/22/22 2:00	0.7			1.6			1			0.55			0.27582			0.92		
08/22/22 3:00	0.9			1.6			1			0.55			0.27588			0.92		
08/22/22 4:00	0.7			1.6			1			0.55			0.27564			0.92		
08/22/22 5:00	0.7			1.6			1			0.55			0.2739			0.91		
08/22/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/22/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/22/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/22/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/22/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/22/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/22/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/22/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/22/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/22/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/22/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/22/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/22/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/22/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/22/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/22/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/22/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/22/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/23/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/23/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/23/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/23/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/23/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/23/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/23/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/23/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/23/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/23/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/23/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/23/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/23/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/23/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/23/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/23/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/23/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/23/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/23/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/23/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/23/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/23/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/23/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/23/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/24/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/24/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/24/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/24/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/24/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/24/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/24/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/24/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/24/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/24/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/24/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/24/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/24/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/24/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/24/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/24/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/24/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/24/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/24/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/24/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/24/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/24/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/24/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/24/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/25/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/25/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/25/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/25/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/25/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/25/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/25/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/25/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/25/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/25/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/25/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/25/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/25/22 12:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/25/22 13:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/25/22 14:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/25/22 15:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/25/22 16:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/25/22 17:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/25/22 18:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/25/22 19:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/25/22 20:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/25/22 21:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/25/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/25/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/26/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/26/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/26/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/26/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/26/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
08/26/22 5:00	0			0			0	X		0.21			0.10722			0.36		
08/26/22 6:00	0.7			1.8			4			0.5			0.2496			0.83		
08/26/22 7:00	0.5			1.6			2			0.33			0.16644			0.55		
08/26/22 8:00	0.5	X		1.7			2			0.34			0.16914			0.56		
08/26/22 9:00	0.7			1.5			0			0.47			0.23586			0.79		
08/26/22 10:00	0.6			1.6			1			0.44			0.21822			0.73		
08/26/22 11:00	0.8			1.6			1			0.48			0.23946			0.8		
08/26/22 12:00	0.7			1.7			1			0.63			0.31434			1.05		
08/26/22 13:00	0.2			1.7			2			0.72			0.35916			1.2		
08/26/22 14:00	0.1			1.7			3			0.74			0.3696			1.23		
08/26/22 15:00	0.1			1.7			2			0.72			0.35952			1.2		
08/26/22 16:00	0.1			1.7			3			0.73			0.36732			1.22		
08/26/22 17:00	0.1			1.7			4			0.78			0.39024			1.3		
08/26/22 18:00	0.1			1.6			3			0.74			0.37194			1.24		
08/26/22 19:00	0.1			1.6			3			0.76			0.3777			1.26		
08/26/22 20:00	0.2			1.6			2			0.71			0.35466			1.18		
08/26/22 21:00	0.3			1.6			2			0.68			0.34164			1.14		

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/26/22 22:00	0.8			1.6			1			0.57			0.28638			0.95		
08/26/22 23:00	0.6			1.6			1			0.52			0.25818			0.86		
08/27/22 0:00	0.6			1.6			1			0.52			0.25866			0.86		
08/27/22 1:00	0.6			1.6			1			0.51			0.2574			0.86		
08/27/22 2:00	0.6			1.7			1			0.52			0.25818			0.86		
08/27/22 3:00	0.7			0	X		0	X		0.52			0.2583			0.86		
08/27/22 4:00	0.7			1.4			2			0.52			0.2604			0.87		
08/27/22 5:00	0.6			1.5			1			0.52			0.26022			0.87		
08/27/22 6:00	0.6			1.6			2			0.38			0.1896			0.63		
08/27/22 7:00	0.5			1.6			2			0.33			0.16374			0.55		
08/27/22 8:00	0.5			1.6			2			0.33			0.16368			0.55		
08/27/22 9:00	0.5			1.6			2			0.33			0.165			0.55		
08/27/22 10:00	0.6			1.5			0			0.4			0.19908			0.66		
08/27/22 11:00	0.8			1.6			1			0.49			0.24594			0.82		
08/27/22 12:00	0.9			1.6			1			0.6			0.29964			1		
08/27/22 13:00	0.9			1.6			1			0.6			0.30144			1		
08/27/22 14:00	0.9			1.6			1			0.6			0.30018			1		
08/27/22 15:00	0.9			1.6			1			0.6			0.29958			1		
08/27/22 16:00	0.6			1.6			2			0.64			0.31896			1.06		
08/27/22 17:00	0.2			1.6			2			0.7			0.35148			1.17		
08/27/22 18:00	0.1			1.6			3			0.73			0.36672			1.22		
08/27/22 19:00	0.2			1.6			2			0.72			0.35898			1.2		
08/27/22 20:00	0.3			1.6			2			0.69			0.3471			1.16		
08/27/22 21:00	0.8			1.6			1			0.58			0.28884			0.96		
08/27/22 22:00	0.7			1.5			1			0.38			0.19248			0.64		
08/27/22 23:00	0.7			1.6			1			0.42			0.20964			0.7		
08/28/22 0:00	0.6			1.6			2			0.34			0.17196			0.57		
08/28/22 1:00	0.6			1.6			2			0.34			0.17166			0.57		
08/28/22 2:00	0.6			1.7			2			0.34			0.17064			0.57		
08/28/22 3:00	0.6			1.6			2			0.34			0.17232			0.57		
08/28/22 4:00	0.6			1.6			2			0.34			0.171			0.57		
08/28/22 5:00	0.6			1.6			2			0.35			0.17388			0.58		
08/28/22 6:00	0.5			1.7			3			0.33			0.16692			0.56		
08/28/22 7:00	0.5			1.6			3			0.33			0.16428			0.55		
08/28/22 8:00	0.5			1.7			2			0.33			0.16428			0.55		
08/28/22 9:00	0.5			1.6			2			0.33			0.16452			0.55		
08/28/22 10:00	0.5			1.6			2			0.33			0.16512			0.55		

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/28/22 11:00	0.5			1.6			1			0.33			0.16638			0.55		
08/28/22 12:00	0.6			1.6			0			0.42			0.21072			0.7		
08/28/22 13:00	0.7			1.6			1			0.43			0.21726			0.72		
08/28/22 14:00	0.7			1.7			1			0.49			0.24384			0.81		
08/28/22 15:00	0.6			1.6			1			0.38			0.19218			0.64		
08/28/22 16:00	0.7			1.6			1			0.53			0.26406			0.88		
08/28/22 17:00	0.1			1.7			3			0.76			0.37992			1.27		
08/28/22 18:00	0.7			1.6			1			0.63			0.31344			1.04		
08/28/22 19:00	1			1.6			1			0.59			0.2931			0.98		
08/28/22 20:00	0.9			1.6			1			0.51			0.25602			0.85		
08/28/22 21:00	0.7			1.6			1			0.43			0.21372			0.71		
08/28/22 22:00	0.6			1.6			1			0.35			0.17502			0.58		
08/28/22 23:00	0.7			1.6			0			0.46			0.23064			0.77		
08/29/22 0:00	0.7			1.7			1			0.45			0.22722			0.76		
08/29/22 1:00	0.7			1.7			1			0.46			0.23034			0.77		
08/29/22 2:00	0.7			1.7			1			0.48			0.24084			0.8		
08/29/22 3:00	0.7			1.7			1			0.46			0.22848			0.76		
08/29/22 4:00	0.7			1.7			1			0.48			0.2421			0.81		
08/29/22 5:00	0.6			1.7			1			0.52			0.25878			0.86		
08/29/22 6:00	0.6			1.6			2			0.39			0.19578			0.65		
08/29/22 7:00	0.6			1.6			2			0.34			0.16824			0.56		
08/29/22 8:00	0.5			1.6			2			0.33			0.16476			0.55		
08/29/22 9:00	0.6			1.7			1			0.34			0.1713			0.57		
08/29/22 10:00	0.5			1.6			1			0.34			0.16998			0.57		
08/29/22 11:00	0.5			1.7			1			0.35			0.17298			0.58		
08/29/22 12:00	0.5			1.7			1			0.34			0.1722			0.57		
08/29/22 13:00	0.6			1.6			0			0.41			0.20316			0.68		
08/29/22 14:00	0.8			1.6			1			0.49			0.24342			0.81		
08/29/22 15:00	0.7			1.7			1			0.62			0.31212			1.04		
08/29/22 16:00	0.5			1.6			2			0.64			0.3219			1.07		
08/29/22 17:00	0.2			1.6			3			0.72			0.3597			1.2		
08/29/22 18:00	0.2			1.5			2			0.69			0.34662			1.16		
08/29/22 19:00	0.4			1.5			2			0.66			0.33168			1.11		
08/29/22 20:00	0.6			1.5			2			0.64			0.31908			1.06		
08/29/22 21:00	0.8			1.5			1			0.58			0.29148			0.97		
08/29/22 22:00	0.6			1.5			1			0.49			0.24576			0.82		
08/29/22 23:00	0.6			1.6			1			0.54			0.27036			0.9		

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/30/22 0:00	0.7			1.6			1			0.53			0.26346			0.88		
08/30/22 1:00	0.7			1.6			1			0.5			0.25194			0.84		
08/30/22 2:00	0.7			1.6			1			0.5			0.25008			0.83		
08/30/22 3:00	0.7			1.6			1			0.5			0.2493			0.83		
08/30/22 4:00	0.7			1.6			1			0.52			0.26214			0.87		
08/30/22 5:00	0.6			1.6			1			0.55			0.27438			0.91		
08/30/22 6:00	0.6			1.5			2			0.37			0.18582			0.62		
08/30/22 7:00	0.5			1.6			2			0.33			0.16584			0.55		
08/30/22 8:00	0.6			1.5			1			0.38			0.1887			0.63		
08/30/22 9:00	0.7			1.6			0			0.42			0.2112			0.7		
08/30/22 10:00	0.7			1.6			1			0.49			0.24288			0.81		
08/30/22 11:00	0.7			1.6			1			0.53			0.26478			0.88		
08/30/22 12:00	0.7			1.6			1			0.52			0.26214			0.87		
08/30/22 13:00	0.8			1.6			1			0.54			0.2685			0.9		
08/30/22 14:00	0.2			1.6			3			0.73			0.36522			1.22		
08/30/22 15:00	0.1			1.6			3			0.75			0.37662			1.26		
08/30/22 16:00	0.1			1.6			3			0.75			0.37296			1.24		
08/30/22 17:00	0.1			1.6			4			0.79			0.39276			1.31		
08/30/22 18:00	0.1			1.6			4			0.79			0.39402			1.31		
08/30/22 19:00	0.1			1.6			4			0.77			0.38634			1.29		
08/30/22 20:00	0.2			1.6			3			0.73			0.36426			1.21		
08/30/22 21:00	0.3			1.6			2			0.69			0.3462			1.15		
08/30/22 22:00	0.8			1.6			1			0.58			0.29178			0.97		
08/30/22 23:00	0.7			1.6			1			0.54			0.27072			0.9		
08/31/22 0:00	0.7			1.6			1			0.54			0.27114			0.9		
08/31/22 1:00	0.7			1.6			1			0.54			0.2718			0.91		
08/31/22 2:00	0.6			1.6			1			0.54			0.27216			0.91		
08/31/22 3:00	0.7			1.6			1			0.54			0.2715			0.91		
08/31/22 4:00	0.7			1.6			1			0.55			0.27378			0.91		
08/31/22 5:00	0.7			1.6			1			0.55			0.2739			0.91		
08/31/22 6:00	0.7			1.6			1			0.5			0.24792			0.83		
08/31/22 7:00	0.7			1.6			0			0.45			0.22518			0.75		
08/31/22 8:00	0.7			1.6			0			0.45			0.22452			0.75		
08/31/22 9:00	0.7			1.6			1			0.48			0.23778			0.79		
08/31/22 10:00	0.8			1.6			1			0.53			0.26406			0.88		
08/31/22 11:00	0.3			1.6			2			0.72			0.35766			1.19		
08/31/22 12:00	0.1			1.6			3			0.74			0.37188			1.24		

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/31/22 13:00	0.1			1.6			3			0.76			0.37974			1.27		
08/31/22 14:00	0.1			1.6			3			0.74			0.36882			1.23		
08/31/22 15:00	0.2			1.6			2			0.69			0.34602			1.15		
08/31/22 16:00	0.4			1.6			2			0.66			0.3276			1.09		
08/31/22 17:00	0.1			1.6			3			0.75			0.37644			1.25		
08/31/22 18:00	0.1			1.6			4			0.77			0.38496			1.28		
08/31/22 19:00	0.2			1.6			3			0.71			0.35706			1.19		
08/31/22 20:00	0.6			1.6			2			0.64			0.3222			1.07		
08/31/22 21:00	0.5			1.6			2			0.67			0.33378			1.11		
08/31/22 22:00	0.9			1.6			1			0.61			0.30354			1.01		
08/31/22 23:00	0.7			1.6			2			0.64			0.3216			1.07		
09/01/22 0:00	0.6			1.6			2			0.65			0.324			1.08		
09/01/22 1:00	1			1.6			1			0.57			0.28632			0.95		
09/01/22 2:00	0.7			1.6			1			0.53			0.26274			0.88		
09/01/22 3:00	0.7			1.6			1			0.53			0.2673			0.89		
09/01/22 4:00	0.8			1.6			1			0.53			0.26436			0.88		
09/01/22 5:00	0.9			1.6			1			0.53			0.26556			0.89		
09/01/22 6:00	0.9			1.6			1			0.52			0.26112			0.87		
09/01/22 7:00	0.7			1.6			1			0.53			0.26352			0.88		
09/01/22 8:00	0.7			1.6			1			0.35			0.17712			0.59		
09/01/22 9:00	0.7			1.6			1			0.35			0.17508			0.58		
09/01/22 10:00	0.6			1.5			1			0.36			0.18096			0.6		
09/01/22 11:00	0.8			1.6			1			0.48			0.24054			0.8		
09/01/22 12:00	0.2			1.6			2			0.71			0.35334			1.18		
09/01/22 13:00	0.1			1.6			3			0.72			0.36198			1.21		
09/01/22 14:00	0.1			1.6			3			0.74			0.369			1.23		
09/01/22 15:00	0.1			1.6			4			0.77			0.3825			1.28		
09/01/22 16:00	0.1			1.6			3			0.74			0.36774			1.23		
09/01/22 17:00	0.1			1.6			4			0.77			0.3831			1.28		
09/01/22 18:00	0.1			1.6			4			0.77			0.38316			1.28		
09/01/22 19:00	0.1			1.6			3			0.72			0.36162			1.21		
09/01/22 20:00	0.1			1.6			3			0.75			0.3726			1.24		
09/01/22 21:00	0.2			1.6			3			0.73			0.3633			1.21		
09/01/22 22:00	0.3			1.6			2			0.69			0.34596			1.15		
09/01/22 23:00	0.3			1.6			2			0.7			0.34878			1.16		
09/02/22 0:00	0.4			1.6			2			0.66			0.33246			1.11		
09/02/22 1:00	0.5			1.6			2			0.65			0.32652			1.09		

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/02/22 2:00	0.6			1.6			1			0.63			0.3174			1.06		
09/02/22 3:00	0.7			1.6			2			0.63			0.31548			1.05		
09/02/22 4:00	0.5			1.6			2			0.66			0.32982			1.1		
09/02/22 5:00	0.4			1.6			2			0.69			0.3438			1.15		
09/02/22 6:00	0.9			1.6			1			0.61			0.30708			1.02		
09/02/22 7:00	1.1			1.6			1			0.58			0.29064			0.97		
09/02/22 8:00	1			1.6			1			0.6			0.30084			1		
09/02/22 9:00	0.6			1.6			2			0.64			0.32142			1.07		
09/02/22 10:00	0.4			1.6			2			0.67			0.33456			1.12		
09/02/22 11:00	0.3			1.6			2			0.68			0.34242			1.14		
09/02/22 12:00	0.2			1.6			2			0.7			0.3501			1.17		
09/02/22 13:00	0.1			1.6			3			0.73			0.36534			1.22		
09/02/22 14:00	0.1			1.6			3			0.73			0.3648			1.22		
09/02/22 15:00	0.4			1.6			2			0.65			0.3267			1.09		
09/02/22 16:00	0.5			1.6			2			0.64			0.31932			1.06		
09/02/22 17:00	0.5			1.6			2			0.64			0.32244			1.07		
09/02/22 18:00	0.3			1.6			2			0.67			0.33588			1.12		
09/02/22 19:00	0.3			1.6			2			0.69			0.34512			1.15		
09/02/22 20:00	0.4			1.6			2			0.67			0.33678			1.12		
09/02/22 21:00	0.7			1.6			1			0.63			0.31422			1.05		
09/02/22 22:00	0.9			1.6			1			0.57			0.28632			0.95		
09/02/22 23:00	0.7			1.6			1			0.42			0.2103			0.7		
09/03/22 0:00	0.7			1.6			0			0.46			0.23136			0.77		
09/03/22 1:00	0.6			1.6			2			0.35			0.17454			0.58		
09/03/22 2:00	0.6			1.7			1			0.34			0.17004			0.57		
09/03/22 3:00	0.6			1.6			2			0.34			0.17064			0.57		
09/03/22 4:00	0.6			1.6			2			0.34			0.16776			0.56		
09/03/22 5:00	0.6			1.6			2			0.34			0.1698			0.57		
09/03/22 6:00	0.5			1.6			3			0.33			0.16392			0.55		
09/03/22 7:00	0.5			1.6			2			0.33			0.16392			0.55		
09/03/22 8:00	0.5			1.6			2			0.33			0.16284			0.54		
09/03/22 9:00	0.5			1.6			1			0.33			0.16692			0.56		
09/03/22 10:00	0.6			1.6			2			0.34			0.16758			0.56		
09/03/22 11:00	0.5			1.6			1			0.33			0.16566			0.55		
09/03/22 12:00	0.7			1.5			0			0.4			0.20244			0.67		
09/03/22 13:00	0.9			1.6			1			0.6			0.30102			1		
09/03/22 14:00	0.9			1.6			1			0.58			0.28872			0.96		

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/03/22 15:00	0.7			1.6			1			0.45			0.22254			0.74		
09/03/22 16:00	0.7			1.6			1			0.61			0.30276			1.01		
09/03/22 17:00	0.8			1.6			1			0.6			0.3021			1.01		
09/03/22 18:00	0.9			1.6			1			0.6			0.2997			1		
09/03/22 19:00	0.7			1.6			1			0.4			0.20244			0.67		
09/03/22 20:00	0.7			1.6			1			0.36			0.1806			0.6		
09/03/22 21:00	0.7			1.5			1			0.39			0.19644			0.65		
09/03/22 22:00	0.7			1.5			1			0.38			0.19068			0.64		
09/03/22 23:00	0.7			1.5			0			0.42			0.21168			0.71		
09/04/22 0:00	0.7			1.6			1			0.4			0.1983			0.66		
09/04/22 1:00	0.6			1.6			1			0.35			0.17412			0.58		
09/04/22 2:00	0.7			1.5			1			0.38			0.189			0.63		
09/04/22 3:00	0.7			1.6			1			0.38			0.19164			0.64		
09/04/22 4:00	0.8			1.6			2			0.35			0.17436			0.58		
09/04/22 5:00	1			1.6			3			0.33			0.16638			0.55		
09/04/22 6:00	0.9			1.6			2			0.33			0.16566			0.55		
09/04/22 7:00	0.6			1.6			2			0.33			0.16374			0.55		
09/04/22 8:00	0.5			1.6			2			0.33			0.16362			0.55		
09/04/22 9:00	0.5			1.6			2			0.33			0.16362			0.55		
09/04/22 10:00	0.5			1.6			1			0.33			0.16668			0.56		
09/04/22 11:00	0.5			1.6			1			0.33			0.1665			0.56		
09/04/22 12:00	0.6			1.6			0			0.37			0.18684			0.62		
09/04/22 13:00	0.6			1.5			1			0.37			0.18372			0.61		
09/04/22 14:00	0.8			1.5			1			0.46			0.231			0.77		
09/04/22 15:00	0.8			1.6			1			0.6			0.3015			1.01		
09/04/22 16:00	0.7			1.6			1			0.62			0.30942			1.03		
09/04/22 17:00	0.4			1.6			2			0.65			0.3264			1.09		
09/04/22 18:00	0.5			1.6			1			0.65			0.32268			1.08		
09/04/22 19:00	1			1.6			1			0.54			0.27216			0.91		
09/04/22 20:00	0.7			1.6			1			0.62			0.31152			1.04		
09/04/22 21:00	0.8			1.6			1			0.62			0.31062			1.04		
09/04/22 22:00	1.1			1.6			1			0.57			0.2844			0.95		
09/04/22 23:00	0.7			1.6			1			0.51			0.25278			0.84		
09/05/22 0:00	0.7			1.6			1			0.5			0.25056			0.84		
09/05/22 1:00	0.8			1.6			1			0.46			0.22938			0.76		
09/05/22 2:00	0.8			1.6			1			0.44			0.22008			0.73		
09/05/22 3:00	0.9			1.6			1			0.46			0.228			0.76		

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/05/22 4:00	0.9			1.6			1			0.46			0.22938			0.76		
09/05/22 5:00	1			1.6			1			0.45			0.22278			0.74		
09/05/22 6:00	0.7			1.6			3			0.34			0.16788			0.56		
09/05/22 7:00	0.7			1.6			2			0.33			0.16344			0.54		
09/05/22 8:00	0.6			1.6			2			0.33			0.16374			0.55		
09/05/22 9:00	0.7			1.5			0			0.44			0.22128			0.74		
09/05/22 10:00	0.7			1.6			0			0.5			0.24984			0.83		
09/05/22 11:00	0.8			1.6			1			0.52			0.25866			0.86		
09/05/22 12:00	0.5			1.6			2			0.65			0.32274			1.08		
09/05/22 13:00	0.3			1.6			2			0.68			0.34098			1.14		
09/05/22 14:00	0.1			1.6			3			0.74			0.37158			1.24		
09/05/22 15:00	0.1			1.6			3			0.76			0.37854			1.26		
09/05/22 16:00	0.1			1.6			4			0.76			0.37848			1.26		
09/05/22 17:00	0.1			1.6			4			0.76			0.38154			1.27		
09/05/22 18:00	0.1			1.6			4			0.76			0.37956			1.27		
09/05/22 19:00	0.1			1.6			3			0.75			0.3774			1.26		
09/05/22 20:00	0.1			1.6			3			0.75			0.37542			1.25		
09/05/22 21:00	0.1			1.6			3			0.72			0.36006			1.2		
09/05/22 22:00	0.2			1.6			3			0.72			0.35964			1.2		
09/05/22 23:00	0.2			1.6			3			0.72			0.36168			1.21		
09/06/22 0:00	0.4			1.6			2			0.67			0.33738			1.12		
09/06/22 1:00	0.9			1.6			1			0.57			0.28266			0.94		
09/06/22 2:00	0.7			1.7			0			0.52			0.2583			0.86		
09/06/22 3:00	0.7			1.6			1			0.52			0.25824			0.86		
09/06/22 4:00	0.7			1.6			1			0.52			0.25824			0.86		
09/06/22 5:00	0.8			1.6			1			0.52			0.25824			0.86		
09/06/22 6:00	0.9			1.6			1			0.51			0.25644			0.85		
09/06/22 7:00	1.1			1.6			1			0.49			0.24288			0.81		
09/06/22 8:00	0.7			1.6			0			0.5			0.25248			0.84		
09/06/22 9:00	0.7			1.6			1			0.57			0.28578			0.95		
09/06/22 10:00	0.4			1.6			2			0.67			0.336			1.12		
09/06/22 11:00	0.1			1.6			3			0.76			0.37908			1.26		
09/06/22 12:00	0.1			1.6			3			0.76			0.3798			1.27		
09/06/22 13:00	0.1			1.6			4			0.76			0.38076			1.27		
09/06/22 14:00	0.1			1.6			4			0.76			0.38058			1.27		
09/06/22 15:00	0.1			1.6			4			0.76			0.38088			1.27		
09/06/22 16:00	0.1			1.6			4			0.76			0.38124			1.27		

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/06/22 17:00	0.1			1.6			4			0.76			0.3813			1.27		
09/06/22 18:00	0.1			1.6			4			0.76			0.38124			1.27		
09/06/22 19:00	0.1			1.6			3			0.76			0.37866			1.26		
09/06/22 20:00	0.1			1.6			3			0.75			0.37656			1.26		
09/06/22 21:00	0.1			1.6			3			0.75			0.37326			1.24		
09/06/22 22:00	0.4			1.6			2			0.66			0.32844			1.09		
09/06/22 23:00	0.5			1.6			2			0.66			0.32754			1.09		
09/07/22 0:00	1.3			1.6			1			0.55			0.27708			0.92		
09/07/22 1:00	0.7			1.6			1			0.53			0.267			0.89		
09/07/22 2:00	0.7			1.5			0			0.53			0.2655			0.89		
09/07/22 3:00	0.7			1.7			1			0.53			0.26454			0.88		
09/07/22 4:00	0.7			1.6			1			0.54			0.26772			0.89		
09/07/22 5:00	0.7			1.6			1			0.54			0.26886			0.9		
09/07/22 6:00	0.7			1.6			0			0.52			0.25848			0.86		
09/07/22 7:00	0.7			1.6			1			0.46			0.23214			0.77		
09/07/22 8:00	0.7			1.6			0			0.51			0.25278			0.84		
09/07/22 9:00	0.3			1.7			2			0.72			0.35784			1.19		
09/07/22 10:00	0.1			1.7			3			0.74			0.3717			1.24		
09/07/22 11:00	0.1			1.7			3			0.75			0.37368			1.25		
09/07/22 12:00	0.1			1.7			3			0.75			0.3756			1.25		
09/07/22 13:00	0.1			1.7			3			0.75			0.37668			1.26		
09/07/22 14:00	0.1			1.7			3			0.76			0.37776			1.26		
09/07/22 15:00	0.1			1.7			3			0.76			0.37854			1.26		
09/07/22 16:00	0.1			1.7			3			0.76			0.37758			1.26		
09/07/22 17:00	0.1			1.7			3			0.76			0.37806			1.26		
09/07/22 18:00	0.1			1.7			3			0.75			0.37722			1.26		
09/07/22 19:00	0.1			1.7			3			0.74			0.37044			1.23		
09/07/22 20:00	0.1			1.7			3			0.75			0.37308			1.24		
09/07/22 21:00	0.1			1.7			3			0.74			0.36852			1.23		
09/07/22 22:00	0.2			1.7			2			0.71			0.35352			1.18		
09/07/22 23:00	0.3			1.7			2			0.69			0.34734			1.16		
09/08/22 0:00	0.3			1.6			2			0.69			0.3453			1.15		
09/08/22 1:00	0.9			1.6			1			0.54			0.27024			0.9		
09/08/22 2:00	0.7			1.6			1			0.54			0.26898			0.9		
09/08/22 3:00	0.7			1.6			1			0.54			0.26844			0.89		
09/08/22 4:00	0.7			1.6			1			0.54			0.26778			0.89		
09/08/22 5:00	0.9			1.6			1			0.54			0.2679			0.89		

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/08/22 6:00	0.8			1.6			1			0.53			0.26382			0.88		
09/08/22 7:00	0.8			1.6			1			0.51			0.2574			0.86		
09/08/22 8:00	0.9			1.6			1			0.53			0.26478			0.88		
09/08/22 9:00	0.2			1.7			3			0.74			0.37158			1.24		
09/08/22 10:00	0.1			1.7			3			0.75			0.37512			1.25		
09/08/22 11:00	0.1			1.7			3			0.76			0.37758			1.26		
09/08/22 12:00	0.1			1.7			3			0.76			0.37782			1.26		
09/08/22 13:00	0.1			1.7			3			0.76			0.37884			1.26		
09/08/22 14:00	0.1			1.7			3			0.76			0.3792			1.26		
09/08/22 15:00	0.1			1.7			3			0.76			0.37902			1.26		
09/08/22 16:00	0.1			1.7			4			0.76			0.37914			1.26		
09/08/22 17:00	0.1			1.7			4			0.76			0.37926			1.26		
09/08/22 18:00	0.1			1.6			4			0.76			0.3783			1.26		
09/08/22 19:00	0.1			1.6			3			0.76			0.37968			1.27		
09/08/22 20:00	0.1			1.6			4			0.77			0.38418			1.28		
09/08/22 21:00	0.2			1.6			4			0.77			0.38562			1.29		
09/08/22 22:00	0.2			1.6			3			0.74			0.3696			1.23		
09/08/22 23:00	0.2			1.6			2			0.71			0.35334			1.18		
09/09/22 0:00	0.2			1.6			2			0.71			0.35466			1.18		
09/09/22 1:00	0.4			1.6			2			0.67			0.3369			1.12		
09/09/22 2:00	0.4			1.4			1			0.67			0.33486			1.12		
09/09/22 3:00	0.5			1.5			1			0.65			0.32334			1.08		
09/09/22 4:00	0.4			1.6			2			0.68			0.34116			1.14		
09/09/22 5:00	0.3			1.6			3			0.75			0.37542			1.25		
09/09/22 6:00	0.3			1.6			3			0.72			0.3603			1.2		
09/09/22 7:00	0.3			1.6			2			0.71			0.35454			1.18		
09/09/22 8:00	0.4			1.6			2			0.69			0.34326			1.14		
09/09/22 9:00	0.5			1.6			2			0.66			0.32928			1.1		
09/09/22 10:00	0.2			1.6			3			0.72			0.36006			1.2		
09/09/22 11:00	0.5			1.6			2			0.65			0.32508			1.08		
09/09/22 12:00	0.2			1.6			2			0.71			0.35544			1.18		
09/09/22 13:00	0.1			1.6			3			0.74			0.3696			1.23		
09/09/22 14:00	0.2			1.6			2			0.71			0.3549			1.18		
09/09/22 15:00	0.2			1.6			2			0.7			0.34932			1.16		
09/09/22 16:00	0.4			1.6			2			0.65			0.32628			1.09		
09/09/22 17:00	0.3			1.6			2			0.68			0.3381			1.13		
09/09/22 18:00	0.5			1.6			2			0.65			0.32328			1.08		

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/09/22 19:00	0.7			1.6			1			0.61			0.30666			1.02		
09/09/22 20:00	0.9			1.6			1			0.53			0.2667			0.89		
09/09/22 21:00	0.7			1.6			0			0.5			0.24954			0.83		
09/09/22 22:00	0.8			1.6			1			0.45			0.22308			0.74		
09/09/22 23:00	0.7			1.6			1			0.5			0.25206			0.84		
09/10/22 0:00	0.7			1.6			1			0.48			0.2409			0.8		
09/10/22 1:00	0.7			1.6			2			0.37			0.18336			0.61		
09/10/22 2:00	0.7			1.5			1			0.43			0.2169			0.72		
09/10/22 3:00	0.8			1.5			1			0.41			0.2046			0.68		
09/10/22 4:00	0.7			1.6			1			0.46			0.23232			0.77		
09/10/22 5:00	0.8			1.5			1			0.44			0.22032			0.73		
09/10/22 6:00	0.7			1.6			1			0.42			0.20796			0.69		
09/10/22 7:00	0.7			1.6			1			0.52			0.2583			0.86		
09/10/22 8:00	0.7			1.6			1			0.47			0.23274			0.78		
09/10/22 9:00	0.7			1.5			1			0.39			0.19638			0.65		
09/10/22 10:00	0.5			1.6			2			0.33			0.16722			0.56		
09/10/22 11:00	0.5			1.6			2			0.33			0.16632			0.55		
09/10/22 12:00	0.6			1.5			1			0.36			0.17892			0.6		
09/10/22 13:00	0.6			1.4			1			0.39			0.19632			0.65		
09/10/22 14:00	0.6			1.6			1			0.35			0.177			0.59		
09/10/22 15:00	0.6			1.6			1			0.36			0.18066			0.6		
09/10/22 16:00	0.6			1.6			1			0.4			0.20178			0.67		
09/10/22 17:00	0.6			1.6			1			0.36			0.17952			0.6		
09/10/22 18:00	0.7			1.5			1			0.42			0.2121			0.71		
09/10/22 19:00	0.7			1.6			1			0.49			0.2436			0.81		
09/10/22 20:00	0.7			1.6			1			0.5			0.2496			0.83		
09/10/22 21:00	0.7			1.6			1			0.5			0.25134			0.84		
09/10/22 22:00	0.8			1.5			1			0.42			0.20844			0.69		
09/10/22 23:00	0.7			1.6			1			0.52			0.25758			0.86		
09/11/22 0:00	0.7			1.6			1			0.52			0.26172			0.87		
09/11/22 1:00	0.7			1.6			1			0.52			0.2583			0.86		
09/11/22 2:00	0.7			1.7			1			0.51			0.25566			0.85		
09/11/22 3:00	0.8			1.7			1			0.47			0.2343			0.78		
09/11/22 4:00	0.7			1.6			1			0.49			0.24408			0.81		
09/11/22 5:00	0.7			1.6			1			0.47			0.23724			0.79		
09/11/22 6:00	0.7			1.5			1			0.42			0.20844			0.69		
09/11/22 7:00	0.7			1.6			2			0.37			0.18264			0.61		

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/11/22 8:00	0.6			1.5			1			0.34			0.17172			0.57		
09/11/22 9:00	0.5			1.6			2			0.33			0.16746			0.56		
09/11/22 10:00	0.6			1.6			0			0.35			0.17262			0.58		
09/11/22 11:00	0.6			1.6			1			0.35			0.17442			0.58		
09/11/22 12:00	0.6			1.4			0			0.39			0.19644			0.65		
09/11/22 13:00	0.6			1.6			1			0.39			0.19452			0.65		
09/11/22 14:00	0.7			1.5			0			0.46			0.22974			0.77		
09/11/22 15:00	0.7			1.6			0			0.48			0.24012			0.8		
09/11/22 16:00	0.8			1.6			1			0.59			0.29316			0.98		
09/11/22 17:00	0.5			1.6			2			0.66			0.32826			1.09		
09/11/22 18:00	0.8			1.6			1			0.62			0.30978			1.03		
09/11/22 19:00	0.8			1.6			1			0.58			0.2904			0.97		
09/11/22 20:00	0.7			1.6			1			0.51			0.25554			0.85		
09/11/22 21:00	0.7			1.6			1			0.4			0.19782			0.66		
09/11/22 22:00	0.7			1.6			1			0.41			0.20334			0.68		
09/11/22 23:00	0.7			1.5			1			0.39			0.19698			0.66		
09/12/22 0:00	0.7			1.5			0			0.45			0.22476			0.75		
09/12/22 1:00	0.6			1.6			2			0.35			0.17562			0.59		
09/12/22 2:00	0.6			1.7			1			0.34			0.17214			0.57		
09/12/22 3:00	0.7			1.6			2			0.34			0.17112			0.57		
09/12/22 4:00	0.7			1.6			0			0.46			0.2292			0.76		
09/12/22 5:00	0.7			1.6			1			0.53			0.26604			0.89		
09/12/22 6:00	0.7			1.6			1			0.48			0.23886			0.8		
09/12/22 7:00	0.7			1.5			1			0.39			0.19314			0.64		
09/12/22 8:00	0.6			1.6			2			0.34			0.1719			0.57		
09/12/22 9:00	0.6			1.6			1			0.35			0.17256			0.58		
09/12/22 10:00	0.6			1.6			1			0.35			0.1758			0.59		
09/12/22 11:00	0.7			1.6			0			0.45			0.22344			0.74		
09/12/22 12:00	0.7			1.6			0			0.53			0.26376			0.88		
09/12/22 13:00	0.7			1.6			0			0.46			0.22902			0.76		
09/12/22 14:00	0.7			1.6			0			0.46			0.22962			0.77		
09/12/22 15:00	0.8			1.6			1			0.46			0.23172			0.77		
09/12/22 16:00	0.8			1.6			1			0.48			0.23994			0.8		
09/12/22 17:00	0.7			1.6			0			0.53			0.2643			0.88		
09/12/22 18:00	0.7			1.6			1			0.52			0.25914			0.86		
09/12/22 19:00	0.7			1.6			1			0.52			0.2604			0.87		
09/12/22 20:00	0.7			1.6			1			0.53			0.26412			0.88		

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/12/22 21:00	0.7			1.6			1			0.52			0.2613			0.87		
09/12/22 22:00	0.7			1.6			1			0.42			0.21042			0.7		
09/12/22 23:00	0.7			1.6			1			0.47			0.23592			0.79		
09/13/22 0:00	0.7			1.6			1			0.47			0.23652			0.79		
09/13/22 1:00	0.7			1.6			1			0.39			0.19572			0.65		
09/13/22 2:00	0.6			1.6			2			0.36			0.1782			0.59		
09/13/22 3:00	1.2			1.5			1			0.47			0.23664			0.79		
09/13/22 4:00	1.2			1.6			1			0.59			0.29694			0.99		
09/13/22 5:00	1.2			1.6			2			0.61			0.30306			1.01		
09/13/22 6:00	1			1.6			1			0.54			0.27168			0.91		
09/13/22 7:00	0.7			1.6			1			0.44			0.21852			0.73		
09/13/22 8:00	0.6			1.6			2			0.37			0.18306			0.61		
09/13/22 9:00	0.6			1.6			2			0.34			0.17034			0.57		
09/13/22 10:00	0.6			1.6			1			0.35			0.17586			0.59		
09/13/22 11:00	0.6			1.6			1			0.35			0.1767			0.59		
09/13/22 12:00	0.5			1.6			2			0.34			0.1698			0.57		
09/13/22 13:00	0.5			1.6			2			0.34			0.16818			0.56		
09/13/22 14:00	0.5			1.6			1			0.34			0.17118			0.57		
09/13/22 15:00	0.5			1.6			1			0.34			0.1689			0.56		
09/13/22 16:00	0.6			1.6			1			0.42			0.21018			0.7		
09/13/22 17:00	1.1			1.6			1			0.6			0.29862			1		
09/13/22 18:00	1.2			1.6			1			0.58			0.29244			0.97		
09/13/22 19:00	1.3			1.6			1			0.59			0.29274			0.98		
09/13/22 20:00	1.4			1.6			1			0.58			0.28992			0.97		
09/13/22 21:00	1.3			1.6			1			0.56			0.2814			0.94		
09/13/22 22:00	0.6			1.6			2			0.36			0.18096			0.6		
09/13/22 23:00	0.8			1.6			0			0.44			0.21846			0.73		
09/14/22 0:00	0.7			1.6			2			0.4			0.19956			0.67		
09/14/22 1:00	0.7			1.6			2			0.38			0.18852			0.63		
09/14/22 2:00	0.7			1.5			1			0.38			0.19074			0.64		
09/14/22 3:00	0.8			1.6			2			0.45			0.22296			0.74		
09/14/22 4:00	0.7			1.6			1			0.48			0.2418			0.81		
09/14/22 5:00	0.7			1.6			1			0.52			0.2619			0.87		
09/14/22 6:00	0.7			1.6			2			0.42			0.21174			0.71		
09/14/22 7:00	0.6			1.6			3			0.34			0.16926			0.56		
09/14/22 8:00	0.5			1.6			3			0.33			0.16596			0.55		
09/14/22 9:00	0.5			1.6			3			0.33			0.16494			0.55		

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/14/22 10:00	0.5			1.6			2			0.33			0.16716			0.56		
09/14/22 11:00	0.5			1.6			2			0.34			0.16818			0.56		
09/14/22 12:00	0.5			1.6			2			0.34			0.1677			0.56		
09/14/22 13:00	0.5			1.6			2			0.33			0.16728			0.56		
09/14/22 14:00	0.5			1.6			2			0.33			0.16734			0.56		
09/14/22 15:00	0.5			1.6			2			0.33			0.16722			0.56		
09/14/22 16:00	0.5			1.6			1			0.34			0.17076			0.57		
09/14/22 17:00	0.6			1.5			1			0.38			0.1881			0.63		
09/14/22 18:00	0.7			1.6			1			0.42			0.20814			0.69		
09/14/22 19:00	0.6			1.6			1			0.42			0.20946			0.7		
09/14/22 20:00	0.7			1.6			1			0.41			0.20682			0.69		
09/14/22 21:00	0.7			1.6			2			0.42			0.20922			0.7		
09/14/22 22:00	0.6			1.6			2			0.35			0.17316			0.58		
09/14/22 23:00	0.6			1.6			2			0.36			0.1824			0.61		
09/15/22 0:00	0.6			1.6			2			0.35			0.17298			0.58		
09/15/22 1:00	0.6			1.5			1			0.36			0.17994			0.6		
09/15/22 2:00	0.6			1.5			2			0.36			0.18186			0.61		
09/15/22 3:00	0.8			1.5			1			0.4			0.2013			0.67		
09/15/22 4:00	0.7			1.6			1			0.46			0.22776			0.76		
09/15/22 5:00	0.7			1.6			1			0.5			0.25188			0.84		
09/15/22 6:00	0.6			1.6			3			0.41			0.20358			0.68		
09/15/22 7:00	0.7			1.5			1			0.38			0.19122			0.64		
09/15/22 8:00	0.5			1.6			3			0.34			0.1677			0.56		
09/15/22 9:00	0.5			1.6			3			0.34			0.16758			0.56		
09/15/22 10:00	0.9			1.5			0			0.49			0.24366			0.81		
09/15/22 11:00	1.4			1.6			1			0.59			0.2928			0.98		
09/15/22 12:00	0.7			1.6			2			0.4			0.19956			0.67		
09/15/22 13:00	0.5			1.6			2			0.34			0.1689			0.56		
09/15/22 14:00	0.6			1.5			1			0.37			0.18684			0.62		
09/15/22 15:00	0.6			1.6			2			0.34			0.17232			0.57		
09/15/22 16:00	0.5			1.6			2			0.34			0.17196			0.57		
09/15/22 17:00	0.6			1.5			1			0.41			0.20544			0.68		
09/15/22 18:00	0.6			1.6			2			0.36			0.17952			0.6		
09/15/22 19:00	0.6			1.6			2			0.38			0.18906			0.63		
09/15/22 20:00	0.6			1.6			2			0.37			0.18312			0.61		
09/15/22 21:00	0.6			1.6			2			0.37			0.18648			0.62		
09/15/22 22:00	0.6			1.6			2			0.35			0.1767			0.59		

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/15/22 23:00	0.6			1.6			2			0.35			0.17262			0.58		
09/16/22 0:00	0.6			1.6			3			0.34			0.1713			0.57		
09/16/22 1:00	0.6			1.6			3			0.33			0.16494			0.55		
09/16/22 2:00	0.5			1.6			3			0.33			0.16488			0.55		
09/16/22 3:00	0.6			1.6			3			0.33			0.16542			0.55		
09/16/22 4:00	0.6			1.6			2			0.35			0.17256			0.58		
09/16/22 5:00	0.7			1.5			1			0.42			0.20766			0.69		
09/16/22 6:00	0.7			1.6			3			0.39			0.19398			0.65		
09/16/22 7:00	0.5			1.7			4			0.33			0.16446			0.55		
09/16/22 8:00	0.5			1.6			3			0.33			0.16656			0.56		
09/16/22 9:00	0.5			1.6			3			0.33			0.16482			0.55		
09/16/22 10:00	0.5			1.6			2			0.33			0.165			0.55		
09/16/22 11:00	0.5			1.6			2			0.33			0.16614			0.55		
09/16/22 12:00	0.5			1.6			2			0.33			0.16482			0.55		
09/16/22 13:00	0.5			1.6			2			0.33			0.16482			0.55		
09/16/22 14:00	0.6			1.5			1			0.36			0.17958			0.6		
09/16/22 15:00	0.5			1.6			2			0.34			0.16806			0.56		
09/16/22 16:00	0.5			1.5			2			0.33			0.16662			0.56		
09/16/22 17:00	0.6			1.6			1			0.34			0.17184			0.57		
09/16/22 18:00	0.6			1.6			1			0.34			0.17226			0.57		
09/16/22 19:00	0.6			1.6			1			0.34			0.17202			0.57		
09/16/22 20:00	0.6			1.6			2			0.34			0.17208			0.57		
09/16/22 21:00	0.6			1.6			2			0.34			0.17172			0.57		
09/16/22 22:00	0.6			1.6			2			0.34			0.16908			0.56		
09/16/22 23:00	0.6			1.6			2			0.34			0.17142			0.57		
09/17/22 0:00	0.6			1.6			2			0.34			0.17208			0.57		
09/17/22 1:00	0.6			1.6			2			0.34			0.17238			0.57		
09/17/22 2:00	0.6			1.6			2			0.34			0.17226			0.57		
09/17/22 3:00	0.7			1.6			3			0.34			0.17232			0.57		
09/17/22 4:00	0.6			1.6			2			0.35			0.17712			0.59		
09/17/22 5:00	0.6			1.6			2			0.34			0.17232			0.57		
09/17/22 6:00	0.5			1.6			4			0.33			0.16452			0.55		
09/17/22 7:00	0.5			1.6			3			0.33			0.16482			0.55		
09/17/22 8:00	0.5			1.6			3			0.33			0.16476			0.55		
09/17/22 9:00	0.5			1.6			2			0.33			0.16494			0.55		
09/17/22 10:00	0.5			1.6			2			0.33			0.165			0.55		
09/17/22 11:00	0.5			1.6			2			0.33			0.16536			0.55		

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/17/22 12:00	0.5			1.6			2			0.33			0.16536			0.55		
09/17/22 13:00	0.5			1.6			2			0.33			0.16452			0.55		
09/17/22 14:00	0.5			1.6			2			0.33			0.16434			0.55		
09/17/22 15:00	0.5			1.6			2			0.33			0.16446			0.55		
09/17/22 16:00	0.5			1.5			1			0.35			0.17262			0.58		
09/17/22 17:00	0.7			1.6			1			0.37			0.18702			0.62		
09/17/22 18:00	0.6			1.6			2			0.34			0.17208			0.57		
09/17/22 19:00	0.5			1.6			3			0.33			0.16602			0.55		
09/17/22 20:00	0.5			1.6			2			0.34			0.16764			0.56		
09/17/22 21:00	0.7			1.6			2			0.37			0.18258			0.61		
09/17/22 22:00	0.6			1.6			2			0.36			0.1815			0.61		
09/17/22 23:00	0.6			1.6			2			0.34			0.1722			0.57		
09/18/22 0:00	0.6			1.6			2			0.34			0.1722			0.57		
09/18/22 1:00	0.6			1.6			2			0.35			0.17256			0.58		
09/18/22 2:00	0.6			1.7			2			0.35			0.17262			0.58		
09/18/22 3:00	0.6			1.6			2			0.34			0.17244			0.57		
09/18/22 4:00	0.6			1.6			3			0.34			0.16806			0.56		
09/18/22 5:00	0.5			1.6			3			0.33			0.16476			0.55		
09/18/22 6:00	0.6			1.6			2			0.34			0.17232			0.57		
09/18/22 7:00	0.6			1.6			2			0.35			0.1743			0.58		
09/18/22 8:00	0.6			1.7			2			0.34			0.17244			0.57		
09/18/22 9:00	0.6			1.7			2			0.34			0.1722			0.57		
09/18/22 10:00	0.6			1.6			2			0.34			0.1701			0.57		
09/18/22 11:00	0.6			1.6			1			0.36			0.1785			0.6		
09/18/22 12:00	0.6			1.5			1			0.39			0.19602			0.65		
09/18/22 13:00	0.7			1.6			1			0.44			0.21774			0.73		
09/18/22 14:00	0.7			1.6			1			0.38			0.1878			0.63		
09/18/22 15:00	0.6			1.6			2			0.36			0.1803			0.6		
09/18/22 16:00	0.6			1.6			1			0.43			0.21438			0.71		
09/18/22 17:00	0.7			1.7			1			0.49			0.24438			0.81		
09/18/22 18:00	0.7			1.7			1			0.48			0.23934			0.8		
09/18/22 19:00	0.7			1.7			1			0.5			0.24894			0.83		
09/18/22 20:00	0.7			1.6			1			0.51			0.25542			0.85		
09/18/22 21:00	0.7			1.7			2			0.5			0.25002			0.83		
09/18/22 22:00	0.6			1.6			3			0.34			0.16866			0.56		
09/18/22 23:00	0.6			1.6			2			0.34			0.17232			0.57		
09/19/22 0:00	0.6			1.7			2			0.35			0.17292			0.58		

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/19/22 1:00	0.6			1.7			2			0.35			0.17316			0.58		
09/19/22 2:00	0.6			1.7			2			0.35			0.17316			0.58		
09/19/22 3:00	0.6			1.5			3			0.35			0.17274			0.58		
09/19/22 4:00	0.7			1.5			1			0.41			0.2058			0.69		
09/19/22 5:00	0.7			1.6			1			0.51			0.25422			0.85		
09/19/22 6:00	0.7			1.6			1			0.48			0.23838			0.79		
09/19/22 7:00	0.7			1.7			1			0.51			0.25458			0.85		
09/19/22 8:00	0.7			1.7			2			0.55			0.27636			0.92		
09/19/22 9:00	0.7			1.6			2			0.42			0.20928			0.7		
09/19/22 10:00	0.6			1.6			2			0.35			0.17316			0.58		
09/19/22 11:00	0.6			1.6			1			0.38			0.18828			0.63		
09/19/22 12:00	0.6			1.6			2			0.36			0.1806			0.6		
09/19/22 13:00	0.7			1.6			2			0.37			0.18402			0.61		
09/19/22 14:00	0.6			1.6			2			0.36			0.17904			0.6		
09/19/22 15:00	0.6			1.7			2			0.35			0.17274			0.58		
09/19/22 16:00	0.8			1.6			1			0.49			0.24312			0.81		
09/19/22 17:00	0.4			1.6			2			0.71			0.3546			1.18		
09/19/22 18:00	0.5			1.6			2			0.67			0.336			1.12		
09/19/22 19:00	0.7			1.6			2			0.65			0.32334			1.08		
09/19/22 20:00	0.9			1.6			2			0.63			0.31482			1.05		
09/19/22 21:00	1.1			1.6			2			0.6			0.30126			1		
09/19/22 22:00	1.1			1.6			2			0.49			0.24324			0.81		
09/19/22 23:00	0.7			1.6			1			0.47			0.2373			0.79		
09/20/22 0:00	0.7			1.6			2			0.46			0.22998			0.77		
09/20/22 1:00	0.7			1.6			3			0.39			0.19524			0.65		
09/20/22 2:00	0.6			1.5			1			0.37			0.18312			0.61		
09/20/22 3:00	0.7			1.7			2			0.51			0.25338			0.84		
09/20/22 4:00	0.8			1.6			1			0.55			0.27516			0.92		
09/20/22 5:00	0.6			1.6			2			0.54			0.27192			0.91		
09/20/22 6:00	0.7			1.6			2			0.42			0.21096			0.7		
09/20/22 7:00	0.6			1.6			3			0.35			0.1761			0.59		
09/20/22 8:00	0.6			1.6			2			0.36			0.17856			0.6		
09/20/22 9:00	0.6			1.6			2			0.35			0.17586			0.59		
09/20/22 10:00	0.5			1.6			3			0.33			0.16566			0.55		
09/20/22 11:00	0.6			1.5			1			0.41			0.20454			0.68		
09/20/22 12:00	0.6			1.7			2			0.36			0.17886			0.6		
09/20/22 13:00	0.6			1.7			2			0.35			0.1755			0.59		

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/20/22 14:00	0.6			1.7			2			0.35			0.17382			0.58		
09/20/22 15:00	0.5			1.6			2			0.34			0.17052			0.57		
09/20/22 16:00	0.8			1.6			1			0.46			0.23238			0.77		
09/20/22 17:00	0.5			1.7			2			0.7			0.34806			1.16		
09/20/22 18:00	0.4			1.6			2			0.71			0.35358			1.18		
09/20/22 19:00	0.5			1.6			2			0.67			0.33324			1.11		
09/20/22 20:00	0.5			1.6			2			0.68			0.3393			1.13		
09/20/22 21:00	0.6			1.6			2			0.67			0.33732			1.12		
09/20/22 22:00	0.9			1.6			2			0.63			0.31332			1.04		
09/20/22 23:00	1			1.6			1			0.53			0.26724			0.89		
09/21/22 0:00	1			1.6			2			0.53			0.26556			0.89		
09/21/22 1:00	0.8			1.6			2			0.47			0.23562			0.79		
09/21/22 2:00	0.8			1.6			2			0.48			0.2379			0.79		
09/21/22 3:00	0.7			1.6			2			0.56			0.27768			0.93		
09/21/22 4:00	0.7			1.6			2			0.56			0.27774			0.93		
09/21/22 5:00	0.7			1.6			2			0.55			0.27516			0.92		
09/21/22 6:00	0.7			1.6			2			0.46			0.22818			0.76		
09/21/22 7:00	0.7			1.6			1			0.54			0.26958			0.9		
09/21/22 8:00	0.7			1.6			1			0.52			0.2613			0.87		
09/21/22 9:00	0.7			1.6			2			0.51			0.25494			0.85		
09/21/22 10:00	0.7			1.6			1			0.4			0.2007			0.67		
09/21/22 11:00	0.7			1.6			1			0.49			0.24504			0.82		
09/21/22 12:00	0.6			1.6			2			0.35			0.17694			0.59		
09/21/22 13:00	0.6			1.6			2			0.35			0.17328			0.58		
09/21/22 14:00	0.7			1.4			0			0.47			0.2343			0.78		
09/21/22 15:00	0.6			1.6			2			0.34			0.17226			0.57		
09/21/22 16:00	0.6			1.5			1			0.42			0.20772			0.69		
09/21/22 17:00	0.6			1.6			1			0.49			0.24684			0.82		
09/21/22 18:00	0.7			1.6			1			0.45			0.22656			0.76		
09/21/22 19:00	0.7			1.6			2			0.41			0.20532			0.68		
09/21/22 20:00	0.7			1.6			2			0.39			0.19446			0.65		
09/21/22 21:00	0.6			1.6			2			0.34			0.17238			0.57		
09/21/22 22:00	0.6			1.6			3			0.34			0.16914			0.56		
09/21/22 23:00	0.7			1.6			2			0.35			0.17334			0.58		
09/22/22 0:00	0.6			1.6			3			0.35			0.17364			0.58		
09/22/22 1:00	0.6			1.6			3			0.35			0.17394			0.58		
09/22/22 2:00	0.7			1.6			3			0.35			0.17322			0.58		

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/22/22 3:00	0.7			1.6			3			0.35			0.17298			0.58		
09/22/22 4:00	0.8			1.5			2			0.39			0.19494			0.65		
09/22/22 5:00	0.8			1.6			2			0.43			0.21624			0.72		
09/22/22 6:00	0.8			1.5			2			0.4			0.20004			0.67		
09/22/22 7:00	0.8			1.7			1			0.45			0.22488			0.75		
09/22/22 8:00	0.8			1.7			1			0.44			0.2223			0.74		
09/22/22 9:00	0.7			1.6			1			0.44			0.22212			0.74		
09/22/22 10:00	0.7			1.7			1			0.44			0.22212			0.74		
09/22/22 11:00	0.7			1.7			1			0.44			0.22188			0.74		
09/22/22 12:00	0.7			1.6			1			0.44			0.22242			0.74		
09/22/22 13:00	0.7			1.7			2			0.41			0.20472			0.68		
09/22/22 14:00	0.5			1.6			2			0.34			0.16806			0.56		
09/22/22 15:00	0.5			1.7			2			0.33			0.16692			0.56		
09/22/22 16:00	0.6			1.6			1			0.37			0.1866			0.62		
09/22/22 17:00	0.6			1.6			2			0.35			0.17424			0.58		
09/22/22 18:00	0.6			1.6			2			0.35			0.17532			0.58		
09/22/22 19:00	0.7			1.5			1			0.39			0.19422			0.65		
09/22/22 20:00	0.7			1.5			1			0.42			0.21138			0.7		
09/22/22 21:00	0.7			1.6			2			0.42			0.20772			0.69		
09/22/22 22:00	0	X		0	X		0	X		0	X		0	X		0	X	
09/22/22 23:00	0	X		0	X		0	X		0	X		0	X		0	X	
09/23/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
09/23/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
09/23/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
09/23/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
09/23/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
09/23/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
09/23/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
09/23/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
09/23/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
09/23/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
09/23/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
09/23/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
09/23/22 12:00	0			0			0	X		0.26			0.1299			0.43		
09/23/22 13:00	0.7			1.7			1			0.44			0.21888			0.73		
09/23/22 14:00	0.7			1.6			2			0.39			0.19452			0.65		
09/23/22 15:00	0.7			1.5			1			0.53			0.26466			0.88		

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/23/22 16:00	0.7			1.5			1			0.46			0.23034			0.77		
09/23/22 17:00	1.1			1.6			1			0.6			0.30108			1		
09/23/22 18:00	1.1			1.6			1			0.6			0.29892			1		
09/23/22 19:00	1.1			1.6			1			0.59			0.29742			0.99		
09/23/22 20:00	1			1.6			2			0.62			0.31206			1.04		
09/23/22 21:00	0.9			1.6			2			0.64			0.318			1.06		
09/23/22 22:00	1			1.6			1			0.5			0.24768			0.83		
09/23/22 23:00	0.9			1.6			1			0.48			0.2409			0.8		
09/24/22 0:00	0.8			1.6			2			0.41			0.20568			0.69		
09/24/22 1:00	0.7			1.6			2			0.39			0.19338			0.64		
09/24/22 2:00	0.8			1.7			1			0.45			0.2244			0.75		
09/24/22 3:00	0.9			1.6			2			0.48			0.24042			0.8		
09/24/22 4:00	1			1.6			2			0.51			0.25428			0.85		
09/24/22 5:00	0.9			1.6			2			0.48			0.24066			0.8		
09/24/22 6:00	0.7			1.6			4			0.35			0.1773			0.59		
09/24/22 7:00	0.7			1.6			3			0.33			0.16554			0.55		
09/24/22 8:00	0.6			1.6			3			0.33			0.1656			0.55		
09/24/22 9:00	0.6			1.6			2			0.33			0.16578			0.55		
09/24/22 10:00	0.5			1.6			2			0.33			0.16584			0.55		
09/24/22 11:00	0.5			1.6			2			0.33			0.16572			0.55		
09/24/22 12:00	0.5			1.5			1			0.34			0.16986			0.57		
09/24/22 13:00	0.6			1.6			1			0.35			0.17436			0.58		
09/24/22 14:00	0.9			1.5			0			0.46			0.23154			0.77		
09/24/22 15:00	0.8			1.6			0			0.51			0.2535			0.85		
09/24/22 16:00	0.9			1.6			1			0.5			0.2481			0.83		
09/24/22 17:00	0.9			1.6			1			0.53			0.26322			0.88		
09/24/22 18:00	0.7			1.6			1			0.48			0.23922			0.8		
09/24/22 19:00	0.7			1.6			1			0.5			0.24942			0.83		
09/24/22 20:00	0.9			1.6			1			0.54			0.2688			0.9		
09/24/22 21:00	0.8			1.6			1			0.54			0.27126			0.9		
09/24/22 22:00	0.7			1.6			1			0.52			0.26166			0.87		
09/24/22 23:00	0.8			1.6			1			0.49			0.243			0.81		
09/25/22 0:00	0.8			1.6			2			0.45			0.22338			0.74		
09/25/22 1:00	0.8			1.5			2			0.41			0.2031			0.68		
09/25/22 2:00	0.8			1.7			1			0.49			0.2442			0.81		
09/25/22 3:00	0.7			1.6			2			0.41			0.20544			0.68		
09/25/22 4:00	0.7			1.6			2			0.36			0.17838			0.59		

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/25/22 5:00	0.8			1.5			3			0.37			0.18306			0.61		
09/25/22 6:00	0.7			1.6			4			0.33			0.16608			0.55		
09/25/22 7:00	0.7			1.6			3			0.33			0.16494			0.55		
09/25/22 8:00	0.6			1.6			2			0.33			0.16548			0.55		
09/25/22 9:00	0.6			1.6			2			0.33			0.16542			0.55		
09/25/22 10:00	0.5			1.6			2			0.33			0.16566			0.55		
09/25/22 11:00	0.5			1.6			2			0.33			0.16572			0.55		
09/25/22 12:00	0.5			1.6			1			0.33			0.16512			0.55		
09/25/22 13:00	0.5			1.6			0			0.34			0.17004			0.57		
09/25/22 14:00	0.6			1.5			1			0.36			0.1812			0.6		
09/25/22 15:00	0.6			1.5			1			0.39			0.19254			0.64		
09/25/22 16:00	0.8			1.5			1			0.48			0.2406			0.8		
09/25/22 17:00	0.7			1.6			0			0.52			0.25884			0.86		
09/25/22 18:00	0.6			1.6			1			0.5			0.249			0.83		
09/25/22 19:00	0.7			1.6			1			0.48			0.24144			0.8		
09/25/22 20:00	0.7			1.6			1			0.49			0.24312			0.81		
09/25/22 21:00	0.7			1.6			1			0.45			0.22356			0.75		
09/25/22 22:00	0.6			1.6			2			0.34			0.17196			0.57		
09/25/22 23:00	0.6			1.6			2			0.35			0.174			0.58		
09/26/22 0:00	0.6			1.6			2			0.36			0.1779			0.59		
09/26/22 1:00	0.6			1.6			2			0.35			0.17346			0.58		
09/26/22 2:00	0.6			1.6			2			0.35			0.17322			0.58		
09/26/22 3:00	0.7			1.6			2			0.35			0.17292			0.58		
09/26/22 4:00	0.7			1.6			1			0.42			0.20898			0.7		
09/26/22 5:00	0.7			1.6			2			0.41			0.20508			0.68		
09/26/22 6:00	0.6			1.6			3			0.34			0.17202			0.57		
09/26/22 7:00	0.5			1.6			3			0.33			0.16452			0.55		
09/26/22 8:00	0.5			1.6			3			0.33			0.16452			0.55		
09/26/22 9:00	0.5			1.6			2			0.33			0.16464			0.55		
09/26/22 10:00	0.5			1.6			2			0.33			0.16452			0.55		
09/26/22 11:00	0.5			1.6			2			0.33			0.165			0.55		
09/26/22 12:00	0.6			1.6			0			0.34			0.1695			0.57		
09/26/22 13:00	0.6			1.6			1			0.35			0.17274			0.58		
09/26/22 14:00	0.6			1.5			1			0.37			0.18594			0.62		
09/26/22 15:00	0.6			1.5			1			0.41			0.20568			0.69		
09/26/22 16:00	0.7			1.5			1			0.43			0.21474			0.72		
09/26/22 17:00	0.7			1.5			1			0.43			0.21684			0.72		

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/26/22 18:00	0.6			1.6			1			0.35			0.17292			0.58		
09/26/22 19:00	0.6			1.6			1			0.34			0.17232			0.57		
09/26/22 20:00	0.6			1.6			2			0.35			0.174			0.58		
09/26/22 21:00	0.7			1.6			1			0.4			0.19998			0.67		
09/26/22 22:00	0.7			1.6			1			0.42			0.21126			0.7		
09/26/22 23:00	1.1			1.6			1			0.61			0.306			1.02		
09/27/22 0:00	0.9			1.6			2			0.63			0.31338			1.04		
09/27/22 1:00	1.1			1.6			2			0.61			0.30732			1.02		
09/27/22 2:00	1.1			1.6			1			0.61			0.30408			1.01		
09/27/22 3:00	1.2			1.6			2			0.6			0.30042			1		
09/27/22 4:00	1			1.6			2			0.63			0.3156			1.05		
09/27/22 5:00	0.7			1.6			2			0.66			0.3276			1.09		
09/27/22 6:00	1.1			1.6			2			0.6			0.29754			0.99		
09/27/22 7:00	0.8			1.6			2			0.51			0.25434			0.85		
09/27/22 8:00	0.4			1.6			3			0.33			0.16434			0.55		
09/27/22 9:00	0.4			1.6			3			0.33			0.16458			0.55		
09/27/22 10:00	0.4			1.6			2			0.33			0.16626			0.55		
09/27/22 11:00	0.9			1.6			0			0.48			0.23958			0.8		
09/27/22 12:00	0.7			1.6			1			0.63			0.31488			1.05		
09/27/22 13:00	1			1.6			1			0.59			0.29604			0.99		
09/27/22 14:00	1			1.6			1			0.59			0.2967			0.99		
09/27/22 15:00	0.9			1.6			1			0.57			0.2829			0.94		
09/27/22 16:00	0.5			1.6			2			0.36			0.18048			0.6		
09/27/22 17:00	0.5			1.5			1			0.4			0.20004			0.67		
09/27/22 18:00	1			1.6			1			0.59			0.294			0.98		
09/27/22 19:00	1.1			1.6			1			0.59			0.29346			0.98		
09/27/22 20:00	1.2			1.6			1			0.59			0.29304			0.98		
09/27/22 21:00	1.2			1.6			1			0.59			0.29736			0.99		
09/27/22 22:00	1.3			1.6			1			0.58			0.291			0.97		
09/27/22 23:00	0.9			1.6			1			0.52			0.25926			0.86		
09/28/22 0:00	0.6			1.6			1			0.51			0.2532			0.84		
09/28/22 1:00	0.6			1.6			1			0.5			0.25224			0.84		
09/28/22 2:00	0.6			1.8			1			0.51			0.25278			0.84		
09/28/22 3:00	0.7			1.6			2			0.51			0.255			0.85		
09/28/22 4:00	0.6			1.6			2			0.52			0.25764			0.86		
09/28/22 5:00	0.6			1.6			2			0.52			0.25812			0.86		
09/28/22 6:00	0.7			1.6			2			0.5			0.24918			0.83		

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/28/22 7:00	0.4			1.6			3			0.33			0.16674			0.56		
09/28/22 8:00	0.4			1.6			3			0.33			0.16494			0.55		
09/28/22 9:00	0.4			1.6			2			0.33			0.165			0.55		
09/28/22 10:00	0.4			1.6			2			0.33			0.16668			0.56		
09/28/22 11:00	0.5			1.6			1			0.34			0.17226			0.57		
09/28/22 12:00	0.5			1.6			1			0.34			0.17202			0.57		
09/28/22 13:00	0.5			1.6			1			0.34			0.17172			0.57		
09/28/22 14:00	0.6			1.5			1			0.4			0.19818			0.66		
09/28/22 15:00	0.5			1.6			2			0.34			0.17076			0.57		
09/28/22 16:00	0.4			1.6			2			0.33			0.16626			0.55		
09/28/22 17:00	0.4			1.6			2			0.33			0.16578			0.55		
09/28/22 18:00	0.5			1.6			1			0.34			0.17082			0.57		
09/28/22 19:00	0.5			1.6			1			0.34			0.1689			0.56		
09/28/22 20:00	0.5			1.6			1			0.35			0.17304			0.58		
09/28/22 21:00	0.6			1.5			1			0.42			0.2103			0.7		
09/28/22 22:00	0.6			1.5			1			0.45			0.22386			0.75		
09/28/22 23:00	0.6			1.6			1			0.48			0.24162			0.81		
09/29/22 0:00	0.6			1.5			2			0.44			0.22068			0.74		
09/29/22 1:00	0.6			1.6			2			0.37			0.18624			0.62		
09/29/22 2:00	0.6			2.1			2			0.36			0.18222			0.61		
09/29/22 3:00	0.7			1.5			2			0.39			0.1941			0.65		
09/29/22 4:00	0.6			1.6			1			0.44			0.21978			0.73		
09/29/22 5:00	0.6			1.6			2			0.48			0.2421			0.81		
09/29/22 6:00	0.7			1.6			2			0.45			0.2238			0.75		
09/29/22 7:00	0.7			1.5			1			0.47			0.23448			0.78		
09/29/22 8:00	0.6			1.6			3			0.36			0.17928			0.6		
09/29/22 9:00	0.5			1.6			2			0.34			0.17034			0.57		
09/29/22 10:00	0.4			1.6			2			0.33			0.1653			0.55		
09/29/22 11:00	0.4			1.6			2			0.33			0.16746			0.56		
09/29/22 12:00	0.4			1.6			2			0.34			0.16938			0.56		
09/29/22 13:00	0.5			1.6			1			0.37			0.18348			0.61		
09/29/22 14:00	0.5			1.6			1			0.35			0.1734			0.58		
09/29/22 15:00	0.5			1.5			1			0.35			0.1758			0.59		
09/29/22 16:00	0.8			1.5			1			0.47			0.2337			0.78		
09/29/22 17:00	1			1.6			1			0.6			0.3009			1		
09/29/22 18:00	1.1			1.6			1			0.6			0.29754			0.99		
09/29/22 19:00	1.1			1.6			1			0.59			0.29658			0.99		

	CT1_CO_Ppmvdc_1H			CT1_NOx_Ppmvdc_1H			CT1_NH3Slip_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT1_SO2_LbPerHr_1H			CT1_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/29/22 20:00	1			1.6			2			0.51			0.25686			0.86		
09/29/22 21:00	0.7			1.6			2			0.35			0.1767			0.59		
09/29/22 22:00	0.6			1.6			2			0.36			0.18024			0.6		
09/29/22 23:00	0.7			1.6			1			0.49			0.24552			0.82		
09/30/22 0:00	0.8			1.6			1			0.47			0.2346			0.78		
09/30/22 1:00	0.8			1.6			2			0.46			0.22956			0.77		
09/30/22 2:00	0.7			1.3			2			0.45			0.22458			0.75		
09/30/22 3:00	0.8			1.3			2			0.43			0.21654			0.72		
09/30/22 4:00	0.8			1.6			1			0.5			0.24948			0.83		
09/30/22 5:00	0.8			1.5			2			0.54			0.2676			0.89		
09/30/22 6:00	0.8			1.6			3			0.46			0.22902			0.76		
09/30/22 7:00	0.6			1.5			3			0.33			0.16602			0.55		
09/30/22 8:00	0.6			1.5			2			0.33			0.16722			0.56		
09/30/22 9:00	0.5			1.5			2			0.33			0.16602			0.55		
09/30/22 10:00	0.5			1.5			2			0.33			0.1668			0.56		
09/30/22 11:00	0.4			1.5			2			0.33			0.16536			0.55		
09/30/22 12:00	0.4			1.5			2			0.33			0.16716			0.56		
09/30/22 13:00	0.4			1.5			2			0.33			0.16524			0.55		
09/30/22 14:00	0.4			1.5			2			0.33			0.16518			0.55		
09/30/22 15:00	0.4			1.5			1			0.33			0.16722			0.56		
09/30/22 16:00	0.6			1.5			1			0.43			0.2172			0.72		
09/30/22 17:00	0.6			1.5			0			0.48			0.23772			0.79		
09/30/22 18:00	0.5			1.5			2			0.35			0.17514			0.58		
09/30/22 19:00	0.5			1.5			2			0.35			0.17364			0.58		
09/30/22 20:00	0.7			1.5			2			0.37			0.18378			0.61		
09/30/22 21:00	0.7			1.5			1			0.44			0.22164			0.74		
09/30/22 22:00	0.6			1.5			2			0.35			0.1758			0.59		
09/30/22 23:00	0.7			1.5			1			0.5			0.2487			0.83		

AQ57 CT2 HOURLY EMISSIONS

Date/Time	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/01/22 0:00	0	X		0	X		0	X		0.45			0	X		0	X	
07/01/22 1:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/01/22 2:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/01/22 3:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/01/22 4:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/01/22 5:00	0	X		0	X		0	X		0.43			0	X		0	X	
07/01/22 6:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/01/22 7:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/01/22 8:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/01/22 9:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/01/22 10:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/01/22 11:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/01/22 12:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/01/22 13:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/01/22 14:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/01/22 15:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/01/22 16:00	0	X		0	X		0	X		0.41			0	X		0	X	
07/01/22 17:00	0			0	X		0			0.56			0.19296			0.64		
07/01/22 18:00	1.1			1			1.5			0.56			0.29592			0.99		
07/01/22 19:00	1.4			1			1.5			0.6			0.31548			1.05		
07/01/22 20:00	1.4			1			1.5			0.59			0.3156			1.05		
07/01/22 21:00	1.4			1			1.5			0.59			0.3135			1.05		
07/01/22 22:00	1.2			1			1.5			0.53			0.28464			0.95		
07/01/22 23:00	0			0	X		0			0.37			0.12738			0.42		
07/02/22 0:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/02/22 1:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/02/22 2:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/02/22 3:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/02/22 4:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/02/22 5:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/02/22 6:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/02/22 7:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/02/22 8:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/02/22 9:00	0	X		0	X		0	X		0.36			0	X		0	X	

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/02/22 10:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/02/22 11:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/02/22 12:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/02/22 13:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/02/22 14:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/02/22 15:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/02/22 16:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/02/22 17:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/02/22 18:00	0	X		0	X		0	X		0.37			0	X		0	X	
07/02/22 19:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/02/22 20:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/02/22 21:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/02/22 22:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/02/22 23:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/03/22 0:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/03/22 1:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/03/22 2:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/03/22 3:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/03/22 4:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/03/22 5:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/03/22 6:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/03/22 7:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/03/22 8:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/03/22 9:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/03/22 10:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/03/22 11:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/03/22 12:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/03/22 13:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/03/22 14:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/03/22 15:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/03/22 16:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/03/22 17:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/03/22 18:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/03/22 19:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/03/22 20:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/03/22 21:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/03/22 22:00	0	X		0	X		0	X		0.35			0	X		0	X	

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/03/22 23:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/04/22 0:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/04/22 1:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/04/22 2:00	0	X		0	X		0	X		0.35			0	X		0	X	
07/04/22 3:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/04/22 4:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/04/22 5:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/04/22 6:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/04/22 7:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/04/22 8:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/04/22 9:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/04/22 10:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/04/22 11:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/04/22 12:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/04/22 13:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/04/22 14:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/04/22 15:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/04/22 16:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/04/22 17:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/04/22 18:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/04/22 19:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/04/22 20:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/04/22 21:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/04/22 22:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/04/22 23:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/05/22 0:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/05/22 1:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/05/22 2:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/05/22 3:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/05/22 4:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/05/22 5:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/05/22 6:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/05/22 7:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/05/22 8:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/05/22 9:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/05/22 10:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/05/22 11:00	0	X		0	X		0	X		0.36			0	X		0	X	

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/05/22 12:00	0	X		0	X		0	X		0.37			0	X		0	X	
07/05/22 13:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/05/22 14:00	0	X		0	X		0	X		0.41			0	X		0	X	
07/05/22 15:00	0			0	X		0			0.46			0.16068			0.54		
07/05/22 16:00	1.2			1			1.6			0.55			0.29058			0.97		
07/05/22 17:00	1.1			0			1.5			0.6			0.3162			1.05		
07/05/22 18:00	1.2			0			1.5			0.6			0.3144			1.05		
07/05/22 19:00	1.2			0			1.5			0.59			0.31422			1.05		
07/05/22 20:00	1.3			0			1.5			0.59			0.31356			1.05		
07/05/22 21:00	1			1			1.5			0.46			0.23598			0.79		
07/05/22 22:00	0			0	X		0			0.44			0.07074			0.24		
07/05/22 23:00	0	X		0	X		0	X		0.41			0	X		0	X	
07/06/22 0:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/06/22 1:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/06/22 2:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/06/22 3:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/06/22 4:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/06/22 5:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/06/22 6:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/06/22 7:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/06/22 8:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/06/22 9:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/06/22 10:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/06/22 11:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/06/22 12:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/06/22 13:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/06/22 14:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/06/22 15:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/06/22 16:00	0			0	X		0			0.41			0.05118			0.17		
07/06/22 17:00	0.7			0			0.8			0.38			0.19854			0.66		
07/06/22 18:00	1			0			1.4			0.54			0.28956			0.97		
07/06/22 19:00	1.3			0			1.5			0.59			0.31266			1.04		
07/06/22 20:00	1.4			0			1.5			0.58			0.31194			1.04		
07/06/22 21:00	1.2			1			1.5			0.51			0.27294			0.91		
07/06/22 22:00	0.5			0			1.3			0.39			0.14502			0.48		
07/06/22 23:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/07/22 0:00	0	X		0	X		0	X		0.36			0	X		0	X	

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/07/22 1:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/07/22 2:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/07/22 3:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/07/22 4:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/07/22 5:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/07/22 6:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/07/22 7:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/07/22 8:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/07/22 9:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/07/22 10:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/07/22 11:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/07/22 12:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/07/22 13:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/07/22 14:00	0			0	X		0			0.52			0.01686			0.06		
07/07/22 15:00	0.8			1			1.8			0.42			0.1905			0.64		
07/07/22 16:00	0.9			0			1.5			0.56			0.29616			0.99		
07/07/22 17:00	0.9			1			1.5			0.62			0.32304			1.08		
07/07/22 18:00	0.7			1			1.5			0.64			0.3351			1.12		
07/07/22 19:00	1			1			1.5			0.59			0.31326			1.04		
07/07/22 20:00	1			1			1.5			0.59			0.31272			1.04		
07/07/22 21:00	1			1			1.5			0.59			0.31356			1.05		
07/07/22 22:00	0.9			0			1.5			0.56			0.30084			1		
07/07/22 23:00	0.7			2			1.4			0.41			0.18444			0.61		
07/08/22 0:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/08/22 1:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/08/22 2:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/08/22 3:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/08/22 4:00	0	X		0	X		0	X		0.49			0	X		0	X	
07/08/22 5:00	0	X		0	X		0	X		0.42			0	X		0	X	
07/08/22 6:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/08/22 7:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/08/22 8:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/08/22 9:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/08/22 10:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/08/22 11:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/08/22 12:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/08/22 13:00	0	X		0	X		0	X		0.41			0	X		0	X	

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/08/22 14:00	0			0	X		0			0.44			0.1734			0.58		
07/08/22 15:00	0.9			0			1.5			0.51			0.27108			0.9		
07/08/22 16:00	1			0			1.5			0.46			0.24132			0.8		
07/08/22 17:00	0.6			0			1.4			0.37			0.19512			0.65		
07/08/22 18:00	0.6			1			1.4			0.45			0.16458			0.55		
07/08/22 19:00	0	X		0	X		0	X		0.48			0	X		0	X	
07/08/22 20:00	0	X		0	X		0	X		0.57			0	X		0	X	
07/08/22 21:00	0	X		0	X		0	X		0.57			0	X		0	X	
07/08/22 22:00	0	X		0	X		0	X		0.57			0	X		0	X	
07/08/22 23:00	0	X		0	X		0	X		0.58			0	X		0	X	
07/09/22 0:00	0	X		0	X		0	X		0.58			0	X		0	X	
07/09/22 1:00	0	X		0	X		0	X		0.39			0	X		0	X	
07/09/22 2:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/09/22 3:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/09/22 4:00	0	X		0	X		0	X		0.38			0	X		0	X	
07/09/22 5:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/09/22 6:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/09/22 7:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/09/22 8:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/09/22 9:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/09/22 10:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/09/22 11:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/09/22 12:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/09/22 13:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/09/22 14:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/09/22 15:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/09/22 16:00	0	X		0	X		0	X		0.42			0	X		0	X	
07/09/22 17:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/09/22 18:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/09/22 19:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/09/22 20:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/09/22 21:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/09/22 22:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/09/22 23:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/10/22 0:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/10/22 1:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/10/22 2:00	0	X		0	X		0	X		0.36			0	X		0	X	

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/10/22 3:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/10/22 4:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/10/22 5:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/10/22 6:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/10/22 7:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/10/22 8:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/10/22 9:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/10/22 10:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/10/22 11:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/10/22 12:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/10/22 13:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/10/22 14:00	0			0	X		0			0.41			0.00918			0.03		
07/10/22 15:00	0.7			1			1.8			0.44			0.19392			0.65		
07/10/22 16:00	0.9			1			1.1			0.47			0.24192			0.81		
07/10/22 17:00	0.7			0			1.4			0.52			0.27486			0.92		
07/10/22 18:00	0.7			0			1.5			0.55			0.28644			0.95		
07/10/22 19:00	0.7			0			1.5			0.54			0.28728			0.96		
07/10/22 20:00	0.7			0			1.5			0.54			0.28746			0.96		
07/10/22 21:00	0.7			0			1.5			0.51			0.27102			0.9		
07/10/22 22:00	0.7			0			1.5			0.52			0.27696			0.92		
07/10/22 23:00	0.7			0			1.5			0.54			0.29094			0.97		
07/11/22 0:00	0.7			0			1.5			0.54			0.29136			0.97		
07/11/22 1:00	0.7			0			1.5			0.54			0.29274			0.98		
07/11/22 2:00	0.7			0			1.7			0.54			0.29202			0.97		
07/11/22 3:00	0.7			0			1.5			0.54			0.29232			0.97		
07/11/22 4:00	0.7			0			1.5			0.54			0.28866			0.96		
07/11/22 5:00	0.7			1			1.5			0.47			0.25428			0.85		
07/11/22 6:00	0.6			1			1.5			0.34			0.1809			0.6		
07/11/22 7:00	0.6			1			1.5			0.33			0.17676			0.59		
07/11/22 8:00	0.6			1			1.5			0.33			0.17652			0.59		
07/11/22 9:00	0.6			1			1.5			0.33			0.17688			0.59		
07/11/22 10:00	0.6			0			1.5			0.34			0.18174			0.61		
07/11/22 11:00	0.7			0			1.4			0.4			0.21018			0.7		
07/11/22 12:00	1.1			0			1.5			0.59			0.312			1.04		
07/11/22 13:00	0.7			1			1.5			0.64			0.33246			1.11		
07/11/22 14:00	0.6			1			1.5			0.64			0.33216			1.11		
07/11/22 15:00	0.6			1			1.5			0.64			0.33504			1.12		

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/11/22 16:00	0.6			1			1.5			0.64			0.3321			1.11		
07/11/22 17:00	0.6			1			1.5			0.64			0.33204			1.11		
07/11/22 18:00	0.5			1			1.5			0.65			0.33768			1.13		
07/11/22 19:00	0.6			1			1.5			0.64			0.33648			1.12		
07/11/22 20:00	0.7			1			1.5			0.63			0.32766			1.09		
07/11/22 21:00	1			1			1.5			0.6			0.31854			1.06		
07/11/22 22:00	0.9			1			1.5			0.61			0.32034			1.07		
07/11/22 23:00	1			1			1.5			0.6			0.31854			1.06		
07/12/22 0:00	1			1			1.5			0.61			0.32304			1.08		
07/12/22 1:00	1			1			1.5			0.61			0.32088			1.07		
07/12/22 2:00	1.2			1			1.6			0.6			0.31728			1.06		
07/12/22 3:00	1.1			1			1.5			0.6			0.32244			1.07		
07/12/22 4:00	1.1			1			1.5			0.62			0.33066			1.1		
07/12/22 5:00	1.1			1			1.5			0.58			0.30882			1.03		
07/12/22 6:00	0.7			1			1.5			0.39			0.21024			0.7		
07/12/22 7:00	0.6			1			1.5			0.33			0.17802			0.59		
07/12/22 8:00	0.5			1			1.5			0.33			0.1764			0.59		
07/12/22 9:00	0.5			1			1.5			0.33			0.17634			0.59		
07/12/22 10:00	0.5			1			1.5			0.34			0.18024			0.6		
07/12/22 11:00	0.6			1			1.5			0.35			0.18444			0.61		
07/12/22 12:00	0.6			1			1.4			0.37			0.19662			0.66		
07/12/22 13:00	1			1			1.5			0.49			0.25542			0.85		
07/12/22 14:00	0.8			1			1.5			0.63			0.32994			1.1		
07/12/22 15:00	0.8			1			1.5			0.61			0.31836			1.06		
07/12/22 16:00	0.8			1			1.5			0.62			0.3234			1.08		
07/12/22 17:00	0.7			1			1.5			0.64			0.33282			1.11		
07/12/22 18:00	0.8			1			1.5			0.62			0.32274			1.08		
07/12/22 19:00	0.9			0			1.6			0.58			0.30396			1.01		
07/12/22 20:00	0.9			0			1.7			0.54			0.288			0.96		
07/12/22 21:00	0.9			1			1.7			0.62			0.32604			1.09		
07/12/22 22:00	0.8			0			1.5			0.48			0.25632			0.85		
07/12/22 23:00	0.7			0			1.6			0.55			0.29466			0.98		
07/13/22 0:00	0.7			0			1.7			0.55			0.29568			0.99		
07/13/22 1:00	0.6			0			1.6			0.55			0.29574			0.99		
07/13/22 2:00	0.6			0			1.6			0.55			0.29568			0.99		
07/13/22 3:00	1.4			0			1.7			0.55			0.2979			0.99		
07/13/22 4:00	0.7			1			1.7			0.67			0.3564			1.19		

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/13/22 5:00	1.1			1			1.6			0.63			0.33522			1.12		
07/13/22 6:00	1.3			1			1.6			0.53			0.28506			0.95		
07/13/22 7:00	0.5			1			1.6			0.34			0.18036			0.6		
07/13/22 8:00	0.5			1			1.6			0.34			0.18			0.6		
07/13/22 9:00	0.5			1			1.6			0.33			0.17724			0.59		
07/13/22 10:00	0.5			1			1.6			0.33			0.177			0.59		
07/13/22 11:00	0.5			1			1.7			0.33			0.17646			0.59		
07/13/22 12:00	0.5			1			1.7			0.33			0.17652			0.59		
07/13/22 13:00	0.5			1			1.7			0.34			0.17622			0.59		
07/13/22 14:00	0.5			1			1.5			0.36			0.1911			0.64		
07/13/22 15:00	1.1			0			1.6			0.58			0.30594			1.02		
07/13/22 16:00	1.1			1			1.7			0.61			0.318			1.06		
07/13/22 17:00	0.7			1			1.3			0.44			0.23274			0.78		
07/13/22 18:00	1			0			1.7			0.58			0.30558			1.02		
07/13/22 19:00	1			1			1.7			0.61			0.32016			1.07		
07/13/22 20:00	0.8			1			1.7			0.64			0.3375			1.13		
07/13/22 21:00	1			1			1.7			0.61			0.32352			1.08		
07/13/22 22:00	1			1			1.7			0.59			0.31452			1.05		
07/13/22 23:00	0.8			1			1.6			0.45			0.23568			0.79		
07/14/22 0:00	0			0	X		0			0.49			0.05592			0.19		
07/14/22 1:00	0	X		0	X		0	X		0.44			0	X		0	X	
07/14/22 2:00	0	X		0	X		0	X		0.41			0	X		0	X	
07/14/22 3:00	0	X		0	X		0	X		0.44			0	X		0	X	
07/14/22 4:00	0	X		0	X		0	X		0.5			0	X		0	X	
07/14/22 5:00	0	X		0	X		0	X		0.52			0	X		0	X	
07/14/22 6:00	0	X		0	X		0	X		0.43			0	X		0	X	
07/14/22 7:00	0	X		0	X		0	X		0.4			0	X		0	X	
07/14/22 8:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/14/22 9:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/14/22 10:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/14/22 11:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/14/22 12:00	0	X		0	X		0	X		0.41			0	X		0	X	
07/14/22 13:00	0.7			4			0.8			0.43			0.16068			0.54		
07/14/22 14:00	0.8			0			1			0.54			0.26742			0.89		
07/14/22 15:00	0.7			1			1.5			0.62			0.3252			1.08		
07/14/22 16:00	0.8			1			1.5			0.62			0.32064			1.07		
07/14/22 17:00	0.7			1			1.6			0.64			0.33144			1.1		

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/14/22 18:00	0.7			1			1.7			0.64			0.33306			1.11		
07/14/22 19:00	1			1			1.6			0.61			0.31962			1.07		
07/14/22 20:00	1			1			1.6			0.6			0.31926			1.06		
07/14/22 21:00	1.1			1			1.6			0.6			0.31752			1.06		
07/14/22 22:00	1.3			1			1.6			0.59			0.31368			1.05		
07/14/22 23:00	1.4			1			1.6			0.59			0.31434			1.05		
07/15/22 0:00	0.8			0			1.5			0.49			0.2649			0.88		
07/15/22 1:00	1.1			0			1.6			0.55			0.29886			1		
07/15/22 2:00	1.1			1			1.9			0.62			0.32862			1.1		
07/15/22 3:00	1.4			1			1.6			0.58			0.31284			1.04		
07/15/22 4:00	1.4			1			1.6			0.58			0.31236			1.04		
07/15/22 5:00	1.3			1			1.6			0.6			0.32262			1.08		
07/15/22 6:00	0.9			1			1.5			0.46			0.24576			0.82		
07/15/22 7:00	0.5			1			1.6			0.33			0.17856			0.6		
07/15/22 8:00	0.5			1			1.6			0.33			0.17814			0.59		
07/15/22 9:00	0.5			1			1.6			0.33			0.17808			0.59		
07/15/22 10:00	0.5			1			1.6			0.34			0.18174			0.61		
07/15/22 11:00	0.6			0			1.6			0.35			0.18366			0.61		
07/15/22 12:00	0.6			0			1.6			0.35			0.18516			0.62		
07/15/22 13:00	0.9			0			1.5			0.45			0.2406			0.8		
07/15/22 14:00	0.9			1			1.6			0.62			0.32352			1.08		
07/15/22 15:00	0.8			1			1.6			0.62			0.32292			1.08		
07/15/22 16:00	0.9			1			1.6			0.61			0.31884			1.06		
07/15/22 17:00	0.7			1			1.6			0.64			0.33504			1.12		
07/15/22 18:00	0.4			1			1.6			0.71			0.3684			1.23		
07/15/22 19:00	0.5			1			1.6			0.68			0.35496			1.18		
07/15/22 20:00	0.6			1			1.7			0.66			0.34872			1.16		
07/15/22 21:00	0.6			1			1.7			0.66			0.34686			1.16		
07/15/22 22:00	0.6			1			1.7			0.66			0.34992			1.17		
07/15/22 23:00	0.9			1			1.7			0.63			0.3336			1.11		
07/16/22 0:00	1.2			0			1.7			0.57			0.3042			1.01		
07/16/22 1:00	0.7			0			1.7			0.5			0.26814			0.89		
07/16/22 2:00	0.7			0			1.5			0.55			0.29658			0.99		
07/16/22 3:00	0.7			1			1.7			0.55			0.29754			0.99		
07/16/22 4:00	0.6			0			1.7			0.55			0.29736			0.99		
07/16/22 5:00	0.7			1			1.5			0.48			0.25704			0.86		
07/16/22 6:00	0.6			1			1.5			0.39			0.2112			0.7		

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/16/22 7:00	0.5			1			1.6			0.33			0.17766			0.59		
07/16/22 8:00	0.5			1			1.5			0.34			0.17988			0.6		
07/16/22 9:00	0.6			0			1.5			0.35			0.18384			0.61		
07/16/22 10:00	0.6			1			1.5			0.35			0.18684			0.62		
07/16/22 11:00	0.6			0			1.6			0.35			0.18402			0.61		
07/16/22 12:00	0.6			0			1.6			0.36			0.18768			0.63		
07/16/22 13:00	0.6			0			1.5			0.44			0.23166			0.77		
07/16/22 14:00	1.1			1			1.6			0.56			0.29922			1		
07/16/22 15:00	0.4			1			1.6			0.71			0.36564			1.22		
07/16/22 16:00	0.7			1			1.6			0.63			0.32556			1.09		
07/16/22 17:00	0.6			1			1.6			0.66			0.34308			1.14		
07/16/22 18:00	0.4			1			1.6			0.68			0.35316			1.18		
07/16/22 19:00	0.8			1			1.6			0.63			0.3288			1.1		
07/16/22 20:00	0.5			1			1.6			0.69			0.35934			1.2		
07/16/22 21:00	0.4			1			1.6			0.7			0.36822			1.23		
07/16/22 22:00	0.4			1			1.6			0.69			0.36558			1.22		
07/16/22 23:00	0.7			1			1.6			0.65			0.34506			1.15		
07/17/22 0:00	0.4			1			1.6			0.7			0.36804			1.23		
07/17/22 1:00	0.5			1			1.6			0.69			0.36228			1.21		
07/17/22 2:00	0.5			1			1.3			0.69			0.36342			1.21		
07/17/22 3:00	0.5			1			1.6			0.69			0.3648			1.22		
07/17/22 4:00	0.6			1			1.6			0.67			0.35418			1.18		
07/17/22 5:00	0.9			0			1.6			0.55			0.29694			0.99		
07/17/22 6:00	0.7			1			1.6			0.48			0.2592			0.86		
07/17/22 7:00	0.6			1			1.6			0.35			0.18474			0.62		
07/17/22 8:00	0.6			0			1.5			0.39			0.20742			0.69		
07/17/22 9:00	0.6			1			1.6			0.34			0.18258			0.61		
07/17/22 10:00	0.6			0			1.5			0.35			0.18324			0.61		
07/17/22 11:00	1			0			1.5			0.47			0.25014			0.83		
07/17/22 12:00	0.8			1			1.6			0.61			0.32022			1.07		
07/17/22 13:00	0.7			1			1.6			0.64			0.33234			1.11		
07/17/22 14:00	0.8			1			1.6			0.62			0.32154			1.07		
07/17/22 15:00	0.6			1			1.6			0.66			0.34332			1.14		
07/17/22 16:00	0.6			1			1.6			0.66			0.34128			1.14		
07/17/22 17:00	0.6			1			1.6			0.65			0.33786			1.13		
07/17/22 18:00	0.4			1			1.6			0.69			0.3618			1.21		
07/17/22 19:00	0.4			1			1.6			0.69			0.36078			1.2		

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/17/22 20:00	0.4			1			1.6			0.7			0.36852			1.23		
07/17/22 21:00	0.7			1			1.6			0.64			0.33816			1.13		
07/17/22 22:00	1.1			1			1.6			0.6			0.31734			1.06		
07/17/22 23:00	1.1			1			1.6			0.59			0.31626			1.05		
07/18/22 0:00	1.1			1			1.6			0.59			0.31506			1.05		
07/18/22 1:00	1			0			1.6			0.57			0.30282			1.01		
07/18/22 2:00	0.7			1			1.5			0.35			0.18534			0.62		
07/18/22 3:00	0.6			1			1.6			0.34			0.18078			0.6		
07/18/22 4:00	0.6			0			1.5			0.38			0.20316			0.68		
07/18/22 5:00	1.3			0			1.6			0.57			0.30672			1.02		
07/18/22 6:00	1.4			1			1.6			0.59			0.31608			1.05		
07/18/22 7:00	0.9			1			1.6			0.46			0.24192			0.81		
07/18/22 8:00	0.6			0			1.5			0.38			0.2016			0.67		
07/18/22 9:00	1.2			0			1.6			0.58			0.30738			1.02		
07/18/22 10:00	1.2			1			1.6			0.6			0.31788			1.06		
07/18/22 11:00	1.2			1			1.6			0.61			0.3213			1.07		
07/18/22 12:00	0.9			1			1.6			0.62			0.32328			1.08		
07/18/22 13:00	0.5			1			1.6			0.68			0.35346			1.18		
07/18/22 14:00	0.7			1			1.6			0.64			0.33624			1.12		
07/18/22 15:00	0.4			1			1.6			0.71			0.36864			1.23		
07/18/22 16:00	0.4			1			1.6			0.71			0.36888			1.23		
07/18/22 17:00	0.4			1			1.7			0.69			0.36156			1.21		
07/18/22 18:00	0.4			1			1.7			0.71			0.36828			1.23		
07/18/22 19:00	0.5			1			1.7			0.69			0.36042			1.2		
07/18/22 20:00	0.4			1			1.7			0.7			0.36468			1.22		
07/18/22 21:00	0.8			1			1.7			0.63			0.33486			1.12		
07/18/22 22:00	1			1			1.7			0.59			0.3159			1.05		
07/18/22 23:00	1			1			1.7			0.52			0.27588			0.92		
07/19/22 0:00	0.6			1			1.7			0.34			0.18342			0.61		
07/19/22 1:00	0.6			1			1.7			0.35			0.18558			0.62		
07/19/22 2:00	0.6			0			1.7			0.35			0.18666			0.62		
07/19/22 3:00	0.6			1			1.7			0.35			0.18708			0.62		
07/19/22 4:00	0.6			1			1.7			0.35			0.18642			0.62		
07/19/22 5:00	0.6			1			1.7			0.35			0.1863			0.62		
07/19/22 6:00	0.6			1			1.7			0.34			0.18204			0.61		
07/19/22 7:00	0.5			1			1.7			0.33			0.17748			0.59		
07/19/22 8:00	0.5			1			1.7			0.33			0.17664			0.59		

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/19/22 9:00	0.6			1			1.7			0.34			0.18108			0.6		
07/19/22 10:00	0.7			0			1.5			0.37			0.19926			0.66		
07/19/22 11:00	0.9			1			1.4			0.48			0.25542			0.85		
07/19/22 12:00	1.3			1			1.5			0.64			0.33222			1.11		
07/19/22 13:00	0.9			0			1.7			0.62			0.32172			1.07		
07/19/22 14:00	1			1			1.7			0.61			0.31722			1.06		
07/19/22 15:00	1			1			1.7			0.61			0.31914			1.06		
07/19/22 16:00	0.7			1			1.7			0.67			0.3507			1.17		
07/19/22 17:00	0.5			1			1.7			0.69			0.35838			1.19		
07/19/22 18:00	0.4			1			1.7			0.73			0.3807			1.27		
07/19/22 19:00	0.6			1			1.5			0.68			0.35826			1.19		
07/19/22 20:00	1.1			1			1.5			0.6			0.31836			1.06		
07/19/22 21:00	1			1			1.5			0.6			0.32142			1.07		
07/19/22 22:00	1.1			1			1.5			0.59			0.31494			1.05		
07/19/22 23:00	0.9			1			1.4			0.45			0.2403			0.8		
07/20/22 0:00	0.6			1			1.6			0.33			0.177			0.59		
07/20/22 1:00	0.6			1			1.6			0.33			0.17736			0.59		
07/20/22 2:00	0.6			1			1.6			0.33			0.17772			0.59		
07/20/22 3:00	0.6			1			1.6			0.33			0.17796			0.59		
07/20/22 4:00	0.6			1			1.6			0.33			0.17922			0.6		
07/20/22 5:00	0.6			1			1.5			0.34			0.18102			0.6		
07/20/22 6:00	0.6			1			1.5			0.34			0.18084			0.6		
07/20/22 7:00	0.6			1			1.5			0.34			0.18384			0.61		
07/20/22 8:00	0.6			1			1.5			0.34			0.17964			0.6		
07/20/22 9:00	0.6			1			1.5			0.34			0.18336			0.61		
07/20/22 10:00	0.6			1			1.5			0.34			0.18126			0.6		
07/20/22 11:00	0.6			0			1.5			0.35			0.18516			0.62		
07/20/22 12:00	1.1			0			1.4			0.49			0.26064			0.87		
07/20/22 13:00	1			1			1.5			0.63			0.33018			1.1		
07/20/22 14:00	0.3			2			1.5			0.74			0.38334			1.28		
07/20/22 15:00	0.8			1			1.5			0.62			0.32394			1.08		
07/20/22 16:00	0.9			1			1.5			0.62			0.3258			1.09		
07/20/22 17:00	0.4			1			1.5			0.71			0.37098			1.24		
07/20/22 18:00	0.5			1			1.5			0.68			0.35292			1.18		
07/20/22 19:00	0.5			1			1.5			0.69			0.36186			1.21		
07/20/22 20:00	0.7			1			1.5			0.65			0.34416			1.15		
07/20/22 21:00	0.8			1			1.5			0.45			0.23958			0.8		

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/20/22 22:00	0.6			1			1.4			0.35			0.18582			0.62		
07/20/22 23:00	0.6			1			1.5			0.34			0.17922			0.6		
07/21/22 0:00	0.6			1			1.5			0.34			0.18348			0.61		
07/21/22 1:00	0.6			1			1.5			0.34			0.18162			0.61		
07/21/22 2:00	0.6			1			1.4			0.34			0.18168			0.61		
07/21/22 3:00	0.6			1			1.5			0.35			0.18792			0.63		
07/21/22 4:00	0.6			1			1.5			0.34			0.18096			0.6		
07/21/22 5:00	0.6			1			1.5			0.33			0.17808			0.59		
07/21/22 6:00	0.6			1			1.6			0.33			0.1782			0.59		
07/21/22 7:00	0.6			1			1.6			0.33			0.17808			0.59		
07/21/22 8:00	0.6			1			1.6			0.33			0.17778			0.59		
07/21/22 9:00	0.6			1			1.6			0.33			0.17748			0.59		
07/21/22 10:00	0.6			1			1.6			0.33			0.17748			0.59		
07/21/22 11:00	0.5			1			1.6			0.33			0.17682			0.59		
07/21/22 12:00	0.6			0			1.6			0.34			0.1803			0.6		
07/21/22 13:00	0.7			0			1.4			0.42			0.2226			0.74		
07/21/22 14:00	1			0			1.6			0.61			0.32076			1.07		
07/21/22 15:00	0.9			1			1.6			0.61			0.3204			1.07		
07/21/22 16:00	0.9			1			1.6			0.61			0.32094			1.07		
07/21/22 17:00	0.7			1			1.6			0.64			0.33396			1.11		
07/21/22 18:00	0.6			1			1.6			0.66			0.34386			1.15		
07/21/22 19:00	1			1			1.6			0.61			0.32058			1.07		
07/21/22 20:00	1			1			1.6			0.61			0.32232			1.07		
07/21/22 21:00	1			1			1.6			0.5			0.26748			0.89		
07/21/22 22:00	0.6			1			1.6			0.33			0.1782			0.59		
07/21/22 23:00	0.6			1			1.6			0.34			0.18324			0.61		
07/22/22 0:00	0.7			1			1.6			0.35			0.1863			0.62		
07/22/22 1:00	0.7			1			1.6			0.35			0.18618			0.62		
07/22/22 2:00	0.8			0			1.4			0.39			0.2118			0.71		
07/22/22 3:00	0.7			2			1.6			0.35			0.18618			0.62		
07/22/22 4:00	0.7			1			1.6			0.35			0.18564			0.62		
07/22/22 5:00	0.7			1			1.6			0.35			0.18492			0.62		
07/22/22 6:00	0.6			1			1.6			0.34			0.18126			0.6		
07/22/22 7:00	0.6			1			1.6			0.33			0.17784			0.59		
07/22/22 8:00	0.6			1			1.6			0.33			0.17742			0.59		
07/22/22 9:00	0.6			1			1.6			0.33			0.17694			0.59		
07/22/22 10:00	0.6			1			1.6			0.33			0.17742			0.59		

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/22/22 11:00	0.6			1			1.6			0.33			0.1764			0.59		
07/22/22 12:00	0.6			1			1.6			0.33			0.17622			0.59		
07/22/22 13:00	0.6			0			1.6			0.34			0.1788			0.6		
07/22/22 14:00	0.9			0			1.4			0.43			0.22422			0.75		
07/22/22 15:00	1.1			0			1.6			0.61			0.3195			1.07		
07/22/22 16:00	1.1			1			1.6			0.61			0.3195			1.07		
07/22/22 17:00	1.2			1			1.6			0.61			0.3189			1.06		
07/22/22 18:00	1.2			1			1.6			0.61			0.31806			1.06		
07/22/22 19:00	1.2			1			1.6			0.6			0.31848			1.06		
07/22/22 20:00	1.3			1			1.6			0.6			0.31812			1.06		
07/22/22 21:00	1			1			1.5			0.47			0.24948			0.83		
07/22/22 22:00	0.7			1			1.5			0.35			0.189			0.63		
07/22/22 23:00	0.7			1			1.2			0.4			0.16794			0.56		
07/23/22 0:00	0	X		0	X		0	X		0.4			0	X		0	X	
07/23/22 1:00	0	X		0	X		0	X		0.37			0	X		0	X	
07/23/22 2:00	0	X		0	X		0	X		0.41			0	X		0	X	
07/23/22 3:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/23/22 4:00	0	X		0	X		0	X		0.37			0	X		0	X	
07/23/22 5:00	0	X		0	X		0	X		0.38			0	X		0	X	
07/23/22 6:00	0	X		0	X		0	X		0.57			0	X		0	X	
07/23/22 7:00	0	X		0	X		0	X		0.58			0	X		0	X	
07/23/22 8:00	0	X		0	X		0	X		0.58			0	X		0	X	
07/23/22 9:00	0	X		0	X		0	X		0.45			0	X		0	X	
07/23/22 10:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/23/22 11:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/23/22 12:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/23/22 13:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/23/22 14:00	0	X		0	X		0	X		0.36			0	X		0	X	
07/23/22 15:00	0	X		0	X		0	X		0.4			0	X		0	X	
07/23/22 16:00	0.6			2			1.1			0.4			0.16626			0.55		
07/23/22 17:00	0.9			0			1.5			0.45			0.23646			0.79		
07/23/22 18:00	0.6			1			1.6			0.68			0.35178			1.17		
07/23/22 19:00	0.7			1			1.6			0.65			0.3396			1.13		
07/23/22 20:00	1.1			0			1.6			0.6			0.31794			1.06		
07/23/22 21:00	1			1			1.6			0.51			0.27456			0.92		
07/23/22 22:00	0.6			1			1.5			0.41			0.15774			0.53		
07/23/22 23:00	0	X		0	X		0	X		0.56			0	X		0	X	

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/24/22 0:00	0	X		0	X		0	X		0.54			0	X		0	X	
07/24/22 1:00	0	X		0	X		0	X		0.54			0	X		0	X	
07/24/22 2:00	0	X		0	X		0	X		0.55			0	X		0	X	
07/24/22 3:00	0	X		0	X		0	X		0.55			0	X		0	X	
07/24/22 4:00	0	X		0	X		0	X		0.55			0	X		0	X	
07/24/22 5:00	0			0	X		0			0.41			0.16002			0.53		
07/24/22 6:00	0.6			1			1.3			0.35			0.18516			0.62		
07/24/22 7:00	0.6			1			1.6			0.35			0.18492			0.62		
07/24/22 8:00	0.6			1			1.6			0.34			0.18048			0.6		
07/24/22 9:00	0.6			1			1.6			0.33			0.17766			0.59		
07/24/22 10:00	0.6			1			1.6			0.33			0.17754			0.59		
07/24/22 11:00	0.6			1			1.6			0.34			0.17742			0.59		
07/24/22 12:00	0.6			1			1.6			0.34			0.17658			0.59		
07/24/22 13:00	0.6			0			1.6			0.34			0.17616			0.59		
07/24/22 14:00	0.6			1			1.6			0.34			0.17676			0.59		
07/24/22 15:00	0.6			0			1.6			0.33			0.17598			0.59		
07/24/22 16:00	1			0			1.5			0.47			0.2502			0.83		
07/24/22 17:00	0.9			1			1.6			0.62			0.32154			1.07		
07/24/22 18:00	0.9			1			1.6			0.61			0.32166			1.07		
07/24/22 19:00	1.1			1			1.6			0.61			0.3192			1.06		
07/24/22 20:00	1			1			1.6			0.51			0.27312			0.91		
07/24/22 21:00	0.6			1			1.4			0.34			0.17892			0.6		
07/24/22 22:00	0.6			1			1.5			0.33			0.17772			0.59		
07/24/22 23:00	0.7			1			1.5			0.35			0.1845			0.62		
07/25/22 0:00	0.6			1			1.5			0.34			0.18102			0.6		
07/25/22 1:00	0.6			1			1.5			0.33			0.17802			0.59		
07/25/22 2:00	0.6			1			1.5			0.33			0.17808			0.59		
07/25/22 3:00	0.6			1			1.5			0.33			0.17802			0.59		
07/25/22 4:00	0.7			1			1.5			0.34			0.18462			0.62		
07/25/22 5:00	0.7			1			1.5			0.35			0.18666			0.62		
07/25/22 6:00	0.7			1			1.5			0.35			0.18588			0.62		
07/25/22 7:00	0.7			1			1.5			0.35			0.18576			0.62		
07/25/22 8:00	0.6			1			1.5			0.33			0.1785			0.6		
07/25/22 9:00	0.6			1			1.5			0.33			0.17724			0.59		
07/25/22 10:00	0.6			1			1.5			0.33			0.17634			0.59		
07/25/22 11:00	0.6			0			1.4			0.34			0.1827			0.61		
07/25/22 12:00	0.7			1			1.5			0.35			0.1839			0.61		

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/25/22 13:00	1			0			1.4			0.48			0.2538			0.85		
07/25/22 14:00	1			1			1.5			0.62			0.32352			1.08		
07/25/22 15:00	0.8			1			1.5			0.63			0.32826			1.09		
07/25/22 16:00	0.7			1			1.5			0.64			0.336			1.12		
07/25/22 17:00	0.6			1			1.5			0.66			0.34362			1.15		
07/25/22 18:00	0.6			1			1.5			0.66			0.34836			1.16		
07/25/22 19:00	0.9			1			1.5			0.62			0.327			1.09		
07/25/22 20:00	1.1			1			1.5			0.6			0.31872			1.06		
07/25/22 21:00	1.1			1			1.5			0.6			0.31878			1.06		
07/25/22 22:00	0.8			1			1.5			0.45			0.24378			0.81		
07/25/22 23:00	0.7			1			1.4			0.41			0.21912			0.73		
07/26/22 0:00	0.6			1			1.5			0.35			0.18594			0.62		
07/26/22 1:00	0.6			1			1.5			0.35			0.1857			0.62		
07/26/22 2:00	0.6			1			1.5			0.35			0.18582			0.62		
07/26/22 3:00	0.6			1			1.5			0.35			0.18558			0.62		
07/26/22 4:00	1			0			1.4			0.48			0.26064			0.87		
07/26/22 5:00	1.7			0			1.5			0.58			0.31476			1.05		
07/26/22 6:00	0.8			1			1.5			0.4			0.2142			0.71		
07/26/22 7:00	0.6			1			1.5			0.35			0.18708			0.62		
07/26/22 8:00	0.6			1			1.5			0.34			0.1815			0.61		
07/26/22 9:00	0.6			1			1.5			0.34			0.18036			0.6		
07/26/22 10:00	0.6			1			1.4			0.35			0.18504			0.62		
07/26/22 11:00	0.6			1			1.5			0.34			0.1809			0.6		
07/26/22 12:00	0.7			1			1.5			0.36			0.18942			0.63		
07/26/22 13:00	1.2			0			1.4			0.49			0.25938			0.86		
07/26/22 14:00	1			0			1.5			0.61			0.31914			1.06		
07/26/22 15:00	0.9			1			1.5			0.61			0.32028			1.07		
07/26/22 16:00	0.8			1			1.5			0.63			0.33084			1.1		
07/26/22 17:00	0.6			1			1.5			0.67			0.34818			1.16		
07/26/22 18:00	0.8			1			1.5			0.64			0.33672			1.12		
07/26/22 19:00	1			1			1.5			0.61			0.32202			1.07		
07/26/22 20:00	1.1			1			1.5			0.6			0.32016			1.07		
07/26/22 21:00	1.2			1			1.5			0.6			0.31818			1.06		
07/26/22 22:00	1.1			1			1.5			0.59			0.31638			1.05		
07/26/22 23:00	0.9			1			1.5			0.46			0.24462			0.82		
07/27/22 0:00	0.6			1			1.5			0.35			0.18702			0.62		
07/27/22 1:00	0.6			1			1.5			0.35			0.18756			0.63		

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/27/22 2:00	0.6			1			1.6			0.35			0.1872			0.62		
07/27/22 3:00	0.6			1			1.5			0.35			0.18732			0.62		
07/27/22 4:00	0.6			1			1.5			0.35			0.18732			0.62		
07/27/22 5:00	0.7			1			1.4			0.37			0.19632			0.65		
07/27/22 6:00	0.7			1			1.6			0.39			0.2088			0.7		
07/27/22 7:00	0.6			1			1.6			0.36			0.1908			0.64		
07/27/22 8:00	0.6			1			1.7			0.35			0.18672			0.62		
07/27/22 9:00	0.6			1			1.6			0.34			0.18024			0.6		
07/27/22 10:00	0.6			1			1.6			0.35			0.18534			0.62		
07/27/22 11:00	0.6			0			1.6			0.35			0.18534			0.62		
07/27/22 12:00	0.6			1			1.6			0.35			0.18234			0.61		
07/27/22 13:00	1.2			0			1.5			0.55			0.29046			0.97		
07/27/22 14:00	0.9			1			1.7			0.62			0.32094			1.07		
07/27/22 15:00	0.8			1			1.7			0.62			0.32346			1.08		
07/27/22 16:00	0.8			1			1.7			0.62			0.32508			1.08		
07/27/22 17:00	0.4			1			1.7			0.71			0.36666			1.22		
07/27/22 18:00	0.9			1			1.6			0.61			0.32166			1.07		
07/27/22 19:00	1			1			1.7			0.61			0.32034			1.07		
07/27/22 20:00	1.1			1			1.7			0.6			0.31896			1.06		
07/27/22 21:00	1			1			1.6			0.53			0.28362			0.95		
07/27/22 22:00	0.7			0			1.5			0.43			0.23046			0.77		
07/27/22 23:00	0.7			1			1.6			0.42			0.22488			0.75		
07/28/22 0:00	0.7			1			1.3			0.4			0.21588			0.72		
07/28/22 1:00	0.7			0			1.6			0.36			0.19434			0.65		
07/28/22 2:00	0.6			1			1.7			0.35			0.18792			0.63		
07/28/22 3:00	1.3			0			1.7			0.49			0.26196			0.87		
07/28/22 4:00	1.9			1			1.7			0.59			0.31548			1.05		
07/28/22 5:00	1.5			1			1.6			0.52			0.28062			0.94		
07/28/22 6:00	0.8			0			1.6			0.46			0.24918			0.83		
07/28/22 7:00	0.7			0			1.2			0.45			0.24			0.8		
07/28/22 8:00	0.6			0			1.5			0.35			0.18582			0.62		
07/28/22 9:00	0.6			1			1.5			0.35			0.18894			0.63		
07/28/22 10:00	0.7			0			1.5			0.52			0.2787			0.93		
07/28/22 11:00	1.1			1			1.7			0.62			0.32346			1.08		
07/28/22 12:00	1			0			1.7			0.61			0.32154			1.07		
07/28/22 13:00	0.9			1			1.7			0.62			0.32406			1.08		
07/28/22 14:00	0.6			1			1.7			0.67			0.34848			1.16		

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/28/22 15:00	0.9			1			1.7			0.62			0.3225			1.08		
07/28/22 16:00	0.8			1			1.6			0.62			0.3261			1.09		
07/28/22 17:00	0.5			1			1.6			0.69			0.36018			1.2		
07/28/22 18:00	0.4			1			1.6			0.71			0.36978			1.23		
07/28/22 19:00	0.8			1			1.6			0.64			0.33528			1.12		
07/28/22 20:00	0.8			1			1.6			0.63			0.33174			1.11		
07/28/22 21:00	1.1			1			1.6			0.6			0.31764			1.06		
07/28/22 22:00	1			1			1.6			0.51			0.2742			0.91		
07/28/22 23:00	0.6			1			1.5			0.35			0.18876			0.63		
07/29/22 0:00	0.6			1			1.6			0.34			0.18288			0.61		
07/29/22 1:00	0.6			1			1.6			0.34			0.1824			0.61		
07/29/22 2:00	0.6			0			1.3			0.35			0.18534			0.62		
07/29/22 3:00	0.6			1			1.7			0.35			0.1866			0.62		
07/29/22 4:00	1.4			0			1.5			0.54			0.29178			0.97		
07/29/22 5:00	1.6			1			1.6			0.59			0.31452			1.05		
07/29/22 6:00	0.8			1			1.5			0.43			0.22998			0.77		
07/29/22 7:00	0.6			1			1.6			0.35			0.18726			0.62		
07/29/22 8:00	0.6			1			1.6			0.35			0.1869			0.62		
07/29/22 9:00	0.6			1			1.6			0.35			0.18678			0.62		
07/29/22 10:00	0.6			1			1.6			0.35			0.18654			0.62		
07/29/22 11:00	0.6			0			1.5			0.39			0.20484			0.68		
07/29/22 12:00	1.2			0			1.6			0.6			0.31308			1.04		
07/29/22 13:00	0.9			1			1.6			0.62			0.3234			1.08		
07/29/22 14:00	0.8			1			1.6			0.64			0.33396			1.11		
07/29/22 15:00	0.8			1			1.6			0.62			0.324			1.08		
07/29/22 16:00	0.8			1			1.6			0.62			0.32484			1.08		
07/29/22 17:00	0.7			1			1.6			0.64			0.33222			1.11		
07/29/22 18:00	0.9			1			1.6			0.61			0.32232			1.07		
07/29/22 19:00	1			1			1.6			0.61			0.3207			1.07		
07/29/22 20:00	1.1			1			1.6			0.6			0.3198			1.07		
07/29/22 21:00	1			1			1.6			0.61			0.32424			1.08		
07/29/22 22:00	1.2			1			1.6			0.6			0.31746			1.06		
07/29/22 23:00	1.2			1			1.6			0.61			0.32322			1.08		
07/30/22 0:00	1.5			1			1.6			0.59			0.31458			1.05		
07/30/22 1:00	1.5			1			1.6			0.59			0.31338			1.04		
07/30/22 2:00	0.8			0			1.7			0.49			0.26166			0.87		
07/30/22 3:00	0.7			0			1.6			0.51			0.27354			0.91		

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/30/22 4:00	1.8			1			1.6			0.58			0.30876			1.03		
07/30/22 5:00	1.6			1			1.6			0.6			0.31974			1.07		
07/30/22 6:00	1			0			1.7			0.54			0.29016			0.97		
07/30/22 7:00	0.7			1			1.7			0.38			0.20034			0.67		
07/30/22 8:00	0.6			1			1.7			0.35			0.18588			0.62		
07/30/22 9:00	0.6			1			1.7			0.34			0.18012			0.6		
07/30/22 10:00	0.5			1			1.6			0.34			0.17898			0.6		
07/30/22 11:00	1			0			1.5			0.42			0.22458			0.75		
07/30/22 12:00	1			0			1.8			0.61			0.32148			1.07		
07/30/22 13:00	0.9			1			1.7			0.62			0.32262			1.08		
07/30/22 14:00	0.6			1			1.7			0.69			0.35718			1.19		
07/30/22 15:00	0.3			2			1.7			0.77			0.3963			1.32		
07/30/22 16:00	0.4			1			1.7			0.74			0.38346			1.28		
07/30/22 17:00	0.6			1			1.7			0.66			0.34524			1.15		
07/30/22 18:00	0.9			1			1.6			0.61			0.32148			1.07		
07/30/22 19:00	1			1			1.6			0.61			0.31992			1.07		
07/30/22 20:00	1			1			1.6			0.6			0.31758			1.06		
07/30/22 21:00	1			1			1.6			0.62			0.32868			1.1		
07/30/22 22:00	1.1			1			1.6			0.6			0.31788			1.06		
07/30/22 23:00	1.1			1			1.6			0.59			0.31608			1.05		
07/31/22 0:00	1.1			1			1.6			0.59			0.31626			1.05		
07/31/22 1:00	1.1			1			1.6			0.59			0.31542			1.05		
07/31/22 2:00	1.1			1			1.6			0.59			0.315			1.05		
07/31/22 3:00	0.9			1			1.6			0.51			0.2742			0.91		
07/31/22 4:00	0.6			1			1.5			0.34			0.18108			0.6		
07/31/22 5:00	0.6			0			1.5			0.44			0.23586			0.79		
07/31/22 6:00	0.7			0			1.5			0.46			0.2487			0.83		
07/31/22 7:00	0.6			1			1.6			0.35			0.18474			0.62		
07/31/22 8:00	0.5			1			1.6			0.33			0.17736			0.59		
07/31/22 9:00	0.6			1			1.6			0.34			0.18354			0.61		
07/31/22 10:00	0.9			0			1.5			0.47			0.25362			0.85		
07/31/22 11:00	1.3			1			1.6			0.59			0.31428			1.05		
07/31/22 12:00	1.3			1			1.6			0.59			0.31404			1.05		
07/31/22 13:00	1.2			1			1.6			0.6			0.31464			1.05		
07/31/22 14:00	0.9			1			1.6			0.64			0.33504			1.12		
07/31/22 15:00	0.8			1			1.6			0.63			0.32832			1.09		
07/31/22 16:00	0.7			1			1.6			0.65			0.33768			1.13		

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
07/31/22 17:00	0.5			1			1.6			0.69			0.35982			1.2		
07/31/22 18:00	0.9			1			1.6			0.6			0.3183			1.06		
07/31/22 19:00	1			1			1.6			0.6			0.3156			1.05		
07/31/22 20:00	1.1			1			1.6			0.6			0.31776			1.06		
07/31/22 21:00	1			1			1.6			0.61			0.32226			1.07		
07/31/22 22:00	1			1			1.6			0.52			0.27528			0.92		
07/31/22 23:00	0.6			1			1.6			0.35			0.18906			0.63		
08/01/22 0:00	0.7			1			1.5			0.46			0.24486			0.82		
08/01/22 1:00	0.6			1			1.6			0.35			0.18486			0.62		
08/01/22 2:00	0.6			1			1.5			0.35			0.18534			0.62		
08/01/22 3:00	1.3			0			1.6			0.46			0.24894			0.83		
08/01/22 4:00	1.6			1			1.6			0.59			0.3129			1.04		
08/01/22 5:00	1.6			1			1.7			0.64			0.33786			1.13		
08/01/22 6:00	0.8			0			1.4			0.68			0.36108			1.2		
08/01/22 7:00	1.6			0			1.7			0.59			0.31254			1.04		
08/01/22 8:00	1.5			0			1.7			0.59			0.31314			1.04		
08/01/22 9:00	1.3			0			1.7			0.6			0.31584			1.05		
08/01/22 10:00	1.1			0			1.7			0.59			0.31458			1.05		
08/01/22 11:00	1.1			0			1.7			0.6			0.31494			1.05		
08/01/22 12:00	1.1			0			1.7			0.6			0.31476			1.05		
08/01/22 13:00	1			0			1.7			0.6			0.31506			1.05		
08/01/22 14:00	1.1			0			1.7			0.6			0.3153			1.05		
08/01/22 15:00	1.1			0			1.7			0.6			0.31692			1.06		
08/01/22 16:00	1.1			0			1.7			0.6			0.31572			1.05		
08/01/22 17:00	1.1			0			1.7			0.6			0.31566			1.05		
08/01/22 18:00	1.1			0			1.7			0.6			0.31554			1.05		
08/01/22 19:00	1.1			0			1.7			0.6			0.31506			1.05		
08/01/22 20:00	1.1			0			1.7			0.6			0.31818			1.06		
08/01/22 21:00	1.2			1			1.7			0.6			0.31872			1.06		
08/01/22 22:00	1.2			0			1.6			0.52			0.27888			0.93		
08/01/22 23:00	0.8			1			1.7			0.35			0.18594			0.62		
08/02/22 0:00	0.9			1			1.7			0.34			0.18324			0.61		
08/02/22 1:00	0.9			1			1.7			0.34			0.18042			0.6		
08/02/22 2:00	1			1			1.7			0.33			0.1773			0.59		
08/02/22 3:00	1			0			1.6			0.35			0.1845			0.62		
08/02/22 4:00	1.4			0			1.6			0.47			0.24906			0.83		
08/02/22 5:00	1.6			0			1.6			0.59			0.31536			1.05		

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/02/22 6:00	1.3			1			1.6			0.45			0.2412			0.8		
08/02/22 7:00	0.7			1			1.6			0.33			0.17664			0.59		
08/02/22 8:00	0.6			1			1.6			0.33			0.17652			0.59		
08/02/22 9:00	0.6			1			1.6			0.33			0.17622			0.59		
08/02/22 10:00	0.6			1			1.6			0.33			0.17598			0.59		
08/02/22 11:00	0.9			0			1.5			0.46			0.24222			0.81		
08/02/22 12:00	0.9			0			1.6			0.62			0.32382			1.08		
08/02/22 13:00	0.8			1			1.6			0.62			0.32556			1.09		
08/02/22 14:00	0.9			1			1.6			0.62			0.32196			1.07		
08/02/22 15:00	0.9			1			1.6			0.62			0.32346			1.08		
08/02/22 16:00	0.4			1			1.6			0.7			0.36372			1.21		
08/02/22 17:00	0.3			2			1.6			0.75			0.38808			1.29		
08/02/22 18:00	0.7			1			1.6			0.64			0.3324			1.11		
08/02/22 19:00	0.9			0			1.6			0.6			0.31716			1.06		
08/02/22 20:00	0.9			1			1.6			0.61			0.32232			1.07		
08/02/22 21:00	1			0			1.6			0.59			0.31512			1.05		
08/02/22 22:00	1.1			0			1.6			0.59			0.31554			1.05		
08/02/22 23:00	1.1			1			1.6			0.59			0.31542			1.05		
08/03/22 0:00	0.8			1			1.6			0.4			0.21252			0.71		
08/03/22 1:00	0.6			1			1.6			0.35			0.18516			0.62		
08/03/22 2:00	0.6			1			1.6			0.35			0.18492			0.62		
08/03/22 3:00	0.6			1			1.6			0.35			0.1845			0.62		
08/03/22 4:00	1			0			1.5			0.46			0.24786			0.83		
08/03/22 5:00	1.6			0			1.6			0.59			0.31134			1.04		
08/03/22 6:00	0.7			1			1.5			0.42			0.22362			0.75		
08/03/22 7:00	0.6			1			1.6			0.34			0.17982			0.6		
08/03/22 8:00	0.7			4			0.7			0.35			0.18432			0.61		
08/03/22 9:00	0.5			1			1.1			0.34			0.17898			0.6		
08/03/22 10:00	0.5			1			1			0.33			0.17676			0.59		
08/03/22 11:00	0.6			1			1			0.36			0.18942			0.63		
08/03/22 12:00	0.6			1			1			0.41			0.216			0.72		
08/03/22 13:00	0.9			1			1.1			0.59			0.30678			1.02		
08/03/22 14:00	0.8			1			1.5			0.63			0.32718			1.09		
08/03/22 15:00	0.8			1			1.6			0.62			0.32184			1.07		
08/03/22 16:00	0.8			1			1.6			0.62			0.32424			1.08		
08/03/22 17:00	0.4			2			1.6			0.77			0.39606			1.32		
08/03/22 18:00	0.4			2			1.6			0.77			0.39834			1.33		

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/03/22 19:00	0.4			2			1.6			0.76			0.3954			1.32		
08/03/22 20:00	0.5			1			1.6			0.71			0.369			1.23		
08/03/22 21:00	0.9			0			1.6			0.6			0.31968			1.07		
08/03/22 22:00	1			0			1.6			0.6			0.31608			1.05		
08/03/22 23:00	1			0			1.6			0.6			0.31704			1.06		
08/04/22 0:00	1.1			0			1.6			0.59			0.31458			1.05		
08/04/22 1:00	1.1			0			1.6			0.59			0.31416			1.05		
08/04/22 2:00	1.1			0			1.6			0.56			0.29928			1		
08/04/22 3:00	0.7			1			1.6			0.35			0.18684			0.62		
08/04/22 4:00	0.9			0			1.5			0.45			0.24114			0.8		
08/04/22 5:00	1.4			0			1.6			0.59			0.3141			1.05		
08/04/22 6:00	1.2			0			1.6			0.55			0.29124			0.97		
08/04/22 7:00	0.7			1			1.6			0.46			0.24468			0.82		
08/04/22 8:00	1			0			1.5			0.47			0.24762			0.83		
08/04/22 9:00	1.1			0			1.6			0.6			0.3147			1.05		
08/04/22 10:00	1			0			1.6			0.6			0.3153			1.05		
08/04/22 11:00	1			0			1.6			0.61			0.31782			1.06		
08/04/22 12:00	0.8			1			1.6			0.63			0.32772			1.09		
08/04/22 13:00	0.6			1			1.6			0.67			0.34926			1.16		
08/04/22 14:00	0.4			2			1.6			0.78			0.40002			1.33		
08/04/22 15:00	0.4			2			1.6			0.76			0.39342			1.31		
08/04/22 16:00	0.4			2			1.6			0.75			0.38916			1.3		
08/04/22 17:00	0.5			1			1.6			0.73			0.38016			1.27		
08/04/22 18:00	0.6			1			1.6			0.68			0.3558			1.19		
08/04/22 19:00	0.8			1			1.6			0.64			0.33846			1.13		
08/04/22 20:00	1			0			1.6			0.6			0.31752			1.06		
08/04/22 21:00	1			0			1.6			0.59			0.31386			1.05		
08/04/22 22:00	1			0			1.6			0.59			0.31296			1.04		
08/04/22 23:00	0.8			1			1.6			0.45			0.2433			0.81		
08/05/22 0:00	0.7			1			1.5			0.37			0.19974			0.67		
08/05/22 1:00	0.6			1			1.6			0.35			0.18726			0.62		
08/05/22 2:00	0.7			1			1.3			0.38			0.20586			0.69		
08/05/22 3:00	0.6			1			1.6			0.35			0.18498			0.62		
08/05/22 4:00	0.7			0			1.4			0.41			0.22014			0.73		
08/05/22 5:00	2.1			0			1.5			0.58			0.31098			1.04		
08/05/22 6:00	1.4			1			1.5			0.59			0.31578			1.05		
08/05/22 7:00	1.3			1			1.5			0.58			0.31116			1.04		

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/05/22 8:00	1.3			1			1.5			0.58			0.31092			1.04		
08/05/22 9:00	1.2			1			1.5			0.59			0.31146			1.04		
08/05/22 10:00	1.1			1			1.5			0.59			0.31212			1.04		
08/05/22 11:00	1			0			1.5			0.6			0.31368			1.05		
08/05/22 12:00	1			0			1.5			0.6			0.31446			1.05		
08/05/22 13:00	1			1			1.5			0.6			0.31434			1.05		
08/05/22 14:00	1			0			1.5			0.6			0.31542			1.05		
08/05/22 15:00	1			1			1.5			0.6			0.31596			1.05		
08/05/22 16:00	1			0			1.5			0.6			0.3162			1.05		
08/05/22 17:00	1			1			1.5			0.6			0.31698			1.06		
08/05/22 18:00	1			0			1.5			0.6			0.31674			1.06		
08/05/22 19:00	1			1			1.5			0.6			0.31602			1.05		
08/05/22 20:00	1			1			1.5			0.6			0.31494			1.05		
08/05/22 21:00	1			1			1.5			0.59			0.31404			1.05		
08/05/22 22:00	1			1			1.5			0.51			0.27282			0.91		
08/05/22 23:00	0.7			1			1.5			0.34			0.18276			0.61		
08/06/22 0:00	0.6			1			1.5			0.34			0.183			0.61		
08/06/22 1:00	0.6			1			1.5			0.34			0.18126			0.6		
08/06/22 2:00	0.5			1			1.5			0.33			0.1776			0.59		
08/06/22 3:00	0.5			1			1.5			0.33			0.17748			0.59		
08/06/22 4:00	0.5			1			1.5			0.33			0.17796			0.59		
08/06/22 5:00	0.6			1			1.5			0.34			0.18186			0.61		
08/06/22 6:00	0.5			1			1.5			0.34			0.1794			0.6		
08/06/22 7:00	0.5			1			1.5			0.33			0.1773			0.59		
08/06/22 8:00	0.5			1			1.5			0.33			0.1773			0.59		
08/06/22 9:00	0.5			1			1.5			0.33			0.17706			0.59		
08/06/22 10:00	0.5			1			1.5			0.33			0.17694			0.59		
08/06/22 11:00	0.5			1			1.5			0.33			0.17652			0.59		
08/06/22 12:00	0.5			1			1.5			0.33			0.17604			0.59		
08/06/22 13:00	0.5			1			1.5			0.33			0.17568			0.59		
08/06/22 14:00	0.5			1			1.5			0.34			0.1776			0.59		
08/06/22 15:00	0.5			1			1.5			0.33			0.17622			0.59		
08/06/22 16:00	0.5			0			1.4			0.34			0.17928			0.6		
08/06/22 17:00	0.6			0			1.5			0.35			0.18666			0.62		
08/06/22 18:00	0.7			0			1.6			0.49			0.26184			0.87		
08/06/22 19:00	1			0			1.6			0.5			0.26982			0.9		
08/06/22 20:00	1.3			0			1.7			0.59			0.31926			1.06		

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/06/22 21:00	1.1			1			1.7			0.51			0.2733			0.91		
08/06/22 22:00	0.6			1			1.7			0.34			0.18228			0.61		
08/06/22 23:00	0.6			1			1.7			0.34			0.18372			0.61		
08/07/22 0:00	0.5			1			1.7			0.34			0.18024			0.6		
08/07/22 1:00	0.6			1			1.7			0.35			0.18534			0.62		
08/07/22 2:00	0.6			1			1.7			0.34			0.18132			0.6		
08/07/22 3:00	0.5			1			1.7			0.33			0.17766			0.59		
08/07/22 4:00	0.6			1			1.7			0.34			0.1839			0.61		
08/07/22 5:00	0.6			1			1.7			0.34			0.18384			0.61		
08/07/22 6:00	0.5			1			1.7			0.34			0.1803			0.6		
08/07/22 7:00	0.5			1			1.7			0.33			0.1779			0.59		
08/07/22 8:00	0.5			1			1.7			0.33			0.17748			0.59		
08/07/22 9:00	0.5			1			1.7			0.33			0.17688			0.59		
08/07/22 10:00	0.5			1			1.7			0.33			0.17622			0.59		
08/07/22 11:00	0.5			1			1.7			0.33			0.17592			0.59		
08/07/22 12:00	0.5			1			1.7			0.33			0.1758			0.59		
08/07/22 13:00	0.5			1			1.7			0.33			0.17628			0.59		
08/07/22 14:00	0.5			0			1.7			0.34			0.17922			0.6		
08/07/22 15:00	0.5			1			1.7			0.34			0.17748			0.59		
08/07/22 16:00	0.6			0			1.6			0.39			0.2064			0.69		
08/07/22 17:00	1			0			1.7			0.55			0.28866			0.96		
08/07/22 18:00	1			0			1.7			0.6			0.3138			1.05		
08/07/22 19:00	1			0			1.7			0.59			0.31284			1.04		
08/07/22 20:00	1.1			0			1.7			0.59			0.31164			1.04		
08/07/22 21:00	1.1			0			1.7			0.59			0.31218			1.04		
08/07/22 22:00	0.8			1			1.7			0.45			0.24192			0.81		
08/07/22 23:00	0.6			1			1.7			0.35			0.1851			0.62		
08/08/22 0:00	0.6			1			1.7			0.35			0.1872			0.62		
08/08/22 1:00	0.6			1			1.7			0.35			0.18528			0.62		
08/08/22 2:00	0.6			1			1.8			0.35			0.18516			0.62		
08/08/22 3:00	0.6			1			1.7			0.35			0.1854			0.62		
08/08/22 4:00	1.1			0			1.6			0.48			0.26016			0.87		
08/08/22 5:00	1.9			0			1.7			0.58			0.31266			1.04		
08/08/22 6:00	1.2			1			1.5			0.45			0.2415			0.81		
08/08/22 7:00	0.6			1			1.6			0.34			0.18108			0.6		
08/08/22 8:00	0.5			1			1.6			0.34			0.17922			0.6		
08/08/22 9:00	0.6			1			1.6			0.34			0.18156			0.61		

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/08/22 10:00	0.6			0			1.5			0.35			0.18396			0.61		
08/08/22 11:00	0.9			0			1.5			0.48			0.25338			0.84		
08/08/22 12:00	1.1			0			1.6			0.61			0.31776			1.06		
08/08/22 13:00	0.7			0			1.5			0.41			0.21384			0.71		
08/08/22 14:00	0.7			0			1.5			0.46			0.24576			0.82		
08/08/22 15:00	1.2			0			1.6			0.6			0.31494			1.05		
08/08/22 16:00	1.1			0			1.6			0.6			0.31704			1.06		
08/08/22 17:00	0.7			1			1.6			0.65			0.3399			1.13		
08/08/22 18:00	0.5			1			1.6			0.67			0.35088			1.17		
08/08/22 19:00	0.5			1			1.6			0.7			0.36732			1.22		
08/08/22 20:00	0.6			1			1.6			0.69			0.36108			1.2		
08/08/22 21:00	1.1			1			1.6			0.61			0.324			1.08		
08/08/22 22:00	1.1			1			1.6			0.59			0.3162			1.05		
08/08/22 23:00	1.2			0			1.6			0.58			0.31158			1.04		
08/09/22 0:00	1.2			0			1.6			0.58			0.31194			1.04		
08/09/22 1:00	1.2			1			1.6			0.58			0.31152			1.04		
08/09/22 2:00	1.2			0			1.6			0.58			0.31176			1.04		
08/09/22 3:00	1.2			1			1.6			0.58			0.3117			1.04		
08/09/22 4:00	1.2			0			1.6			0.58			0.31212			1.04		
08/09/22 5:00	1.3			0			1.6			0.58			0.31158			1.04		
08/09/22 6:00	1.3			0			1.6			0.58			0.31104			1.04		
08/09/22 7:00	1.3			0			1.6			0.58			0.31152			1.04		
08/09/22 8:00	1.3			0			1.6			0.59			0.31224			1.04		
08/09/22 9:00	1.2			0			1.6			0.59			0.3132			1.04		
08/09/22 10:00	1.2			0			1.6			0.59			0.31344			1.04		
08/09/22 11:00	1.2			0			1.6			0.6			0.31398			1.05		
08/09/22 12:00	1.1			0			1.6			0.57			0.30216			1.01		
08/09/22 13:00	0.6			1			1.5			0.36			0.1887			0.63		
08/09/22 14:00	0.9			0			1.5			0.47			0.25002			0.83		
08/09/22 15:00	1.2			0			1.6			0.6			0.31434			1.05		
08/09/22 16:00	1.2			0			1.6			0.6			0.3135			1.05		
08/09/22 17:00	1.2			0			1.6			0.6			0.31512			1.05		
08/09/22 18:00	0.6			1			1.7			0.68			0.35664			1.19		
08/09/22 19:00	0.9			1			1.7			0.63			0.33462			1.12		
08/09/22 20:00	0.6			1			1.7			0.68			0.35988			1.2		
08/09/22 21:00	0.9			1			1.7			0.64			0.3408			1.14		
08/09/22 22:00	1			1			1.7			0.62			0.33066			1.1		

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/09/22 23:00	1.1			0			1.7			0.57			0.30714			1.02		
08/10/22 0:00	0.7			0			1.7			0.52			0.27786			0.93		
08/10/22 1:00	0.7			0			1.7			0.53			0.28512			0.95		
08/10/22 2:00	0.7			0			1.8			0.53			0.2871			0.96		
08/10/22 3:00	1.6			0			1.7			0.56			0.30054			1		
08/10/22 4:00	0.9			1			1.7			0.65			0.3432			1.14		
08/10/22 5:00	1.1			1			1.7			0.62			0.32952			1.1		
08/10/22 6:00	0.9			1			1.7			0.45			0.24228			0.81		
08/10/22 7:00	0.6			1			1.7			0.34			0.18282			0.61		
08/10/22 8:00	0.6			1			1.7			0.34			0.18396			0.61		
08/10/22 9:00	0.6			1			1.7			0.34			0.18258			0.61		
08/10/22 10:00	0.6			1			1.7			0.35			0.18498			0.62		
08/10/22 11:00	0.6			0			1.5			0.38			0.19986			0.67		
08/10/22 12:00	0.6			1			1.6			0.35			0.18342			0.61		
08/10/22 13:00	0.6			0			1.6			0.38			0.20208			0.67		
08/10/22 14:00	0.8			0			1.8			0.56			0.29538			0.98		
08/10/22 15:00	0.7			1			1.7			0.64			0.3363			1.12		
08/10/22 16:00	1			0			1.7			0.6			0.31254			1.04		
08/10/22 17:00	0.9			0			1.7			0.61			0.32178			1.07		
08/10/22 18:00	0.5			1			1.7			0.7			0.36426			1.21		
08/10/22 19:00	0.5			1			1.7			0.68			0.3582			1.19		
08/10/22 20:00	0.8			1			1.7			0.65			0.3414			1.14		
08/10/22 21:00	1			1			1.7			0.62			0.3291			1.1		
08/10/22 22:00	1			0			1.7			0.54			0.28722			0.96		
08/10/22 23:00	0.7			0			1.7			0.52			0.27768			0.93		
08/11/22 0:00	0.6			0			1.7			0.52			0.27966			0.93		
08/11/22 1:00	0.7			0			1.7			0.51			0.27678			0.92		
08/11/22 2:00	0.7			0			1.7			0.49			0.26202			0.87		
08/11/22 3:00	0.7			0			1.8			0.5			0.27198			0.91		
08/11/22 4:00	0.7			0			1.7			0.52			0.279			0.93		
08/11/22 5:00	0.7			0			1.6			0.53			0.28536			0.95		
08/11/22 6:00	0.7			1			1.6			0.44			0.234			0.78		
08/11/22 7:00	0.7			0			1.4			0.39			0.20862			0.7		
08/11/22 8:00	0.6			1			1.6			0.35			0.18468			0.62		
08/11/22 9:00	0.6			1			1.6			0.35			0.18438			0.61		
08/11/22 10:00	0.6			0			1.6			0.35			0.18414			0.61		
08/11/22 11:00	0.6			0			1.5			0.47			0.25092			0.84		

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/11/22 12:00	1.1			0			1.5			0.5			0.26718			0.89		
08/11/22 13:00	0.8			1			1.6			0.68			0.35316			1.18		
08/11/22 14:00	0.9			1			1.6			0.64			0.33264			1.11		
08/11/22 15:00	0.7			1			1.6			0.67			0.35082			1.17		
08/11/22 16:00	0.7			1			1.6			0.67			0.34998			1.17		
08/11/22 17:00	0.7			1			1.7			0.68			0.35622			1.19		
08/11/22 18:00	0.6			1			1.7			0.71			0.36882			1.23		
08/11/22 19:00	0.7			1			1.7			0.68			0.357			1.19		
08/11/22 20:00	0.5			1			1.7			0.72			0.37674			1.26		
08/11/22 21:00	1.1			0			1.7			0.58			0.30852			1.03		
08/11/22 22:00	0.7			0			1.7			0.52			0.27786			0.93		
08/11/22 23:00	0.7			0			1.7			0.52			0.2799			0.93		
08/12/22 0:00	0.7			0			1.7			0.55			0.29454			0.98		
08/12/22 1:00	0.7			0			1.7			0.54			0.28962			0.97		
08/12/22 2:00	0.7			0			1.7			0.5			0.26784			0.89		
08/12/22 3:00	0.7			0			1.7			0.52			0.27918			0.93		
08/12/22 4:00	0.7			0			1.7			0.54			0.291			0.97		
08/12/22 5:00	0.7			0			1.6			0.54			0.29004			0.97		
08/12/22 6:00	0.7			1			1.6			0.4			0.21654			0.72		
08/12/22 7:00	0.6			1			1.5			0.39			0.21084			0.7		
08/12/22 8:00	0.5			1			1.6			0.34			0.1809			0.6		
08/12/22 9:00	0.6			1			1.7			0.34			0.18078			0.6		
08/12/22 10:00	0.6			0			1.6			0.34			0.18354			0.61		
08/12/22 11:00	0.6			1			1.6			0.34			0.18162			0.61		
08/12/22 12:00	0.9			0			1.5			0.41			0.21762			0.73		
08/12/22 13:00	1			0			1.5			0.6			0.31752			1.06		
08/12/22 14:00	1			1			1.5			0.61			0.31998			1.07		
08/12/22 15:00	0.9			1			1.5			0.61			0.31842			1.06		
08/12/22 16:00	1			0			1.5			0.61			0.31818			1.06		
08/12/22 17:00	0.6			1			1.5			0.68			0.3555			1.19		
08/12/22 18:00	0.5			1			1.7			0.72			0.37392			1.25		
08/12/22 19:00	0.7			1			1.6			0.66			0.34662			1.16		
08/12/22 20:00	0.9			1			1.7			0.64			0.33672			1.12		
08/12/22 21:00	1.1			0			1.6			0.58			0.30864			1.03		
08/12/22 22:00	0.7			0			1.6			0.45			0.24366			0.81		
08/12/22 23:00	0.7			0			1.6			0.51			0.27468			0.92		
08/13/22 0:00	0.7			0			1.7			0.5			0.26958			0.9		

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/13/22 1:00	0.7			0			1.7			0.5			0.27186			0.91		
08/13/22 2:00	0.7			0			1.8			0.51			0.27264			0.91		
08/13/22 3:00	0.7			0			1.6			0.51			0.27762			0.93		
08/13/22 4:00	0.7			0			1.6			0.53			0.28596			0.95		
08/13/22 5:00	0.7			0			1.6			0.53			0.28314			0.94		
08/13/22 6:00	0.7			1			1.6			0.41			0.22158			0.74		
08/13/22 7:00	0.6			1			1.6			0.34			0.1812			0.6		
08/13/22 8:00	0.5			1			1.6			0.34			0.18096			0.6		
08/13/22 9:00	0.6			1			1.6			0.34			0.18414			0.61		
08/13/22 10:00	0.6			1			1.4			0.34			0.18228			0.61		
08/13/22 11:00	0.6			0			1.6			0.35			0.18342			0.61		
08/13/22 12:00	0.7			0			1.4			0.4			0.213			0.71		
08/13/22 13:00	1			0			1.5			0.48			0.25236			0.84		
08/13/22 14:00	1			0			1.6			0.6			0.31422			1.05		
08/13/22 15:00	1			0			1.6			0.6			0.31458			1.05		
08/13/22 16:00	1			0			1.6			0.61			0.3168			1.06		
08/13/22 17:00	0.7			1			1.6			0.66			0.34434			1.15		
08/13/22 18:00	0.8			1			1.6			0.64			0.33342			1.11		
08/13/22 19:00	1			0			1.6			0.6			0.31482			1.05		
08/13/22 20:00	0.9			0			1.6			0.54			0.28608			0.95		
08/13/22 21:00	0.7			1			1.6			0.37			0.19584			0.65		
08/13/22 22:00	0.7			0			1.5			0.41			0.2178			0.73		
08/13/22 23:00	0.7			0			1.5			0.49			0.26256			0.88		
08/14/22 0:00	0.8			1			1.5			0.43			0.22932			0.76		
08/14/22 1:00	0.8			0			1.5			0.45			0.24024			0.8		
08/14/22 2:00	0.8			0			1.6			0.46			0.24702			0.82		
08/14/22 3:00	0.8			1			1.5			0.46			0.24624			0.82		
08/14/22 4:00	0.8			0			1.5			0.44			0.23616			0.79		
08/14/22 5:00	0.7			1			1.5			0.41			0.21936			0.73		
08/14/22 6:00	1.8			0			1.5			0.56			0.30024			1		
08/14/22 7:00	1.4			0			1.6			0.56			0.30036			1		
08/14/22 8:00	0.7			1			1.6			0.35			0.18936			0.63		
08/14/22 9:00	0.6			1			1.7			0.34			0.1839			0.61		
08/14/22 10:00	0.9			0			1.6			0.45			0.24132			0.8		
08/14/22 11:00	1.1			0			1.7			0.61			0.3204			1.07		
08/14/22 12:00	0.8			1			1.7			0.65			0.34002			1.13		
08/14/22 13:00	1			0			1.6			0.61			0.3186			1.06		

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/14/22 14:00	0.7			1			1.6			0.4			0.21204			0.71		
08/14/22 15:00	0.7			0			1.5			0.42			0.22062			0.74		
08/14/22 16:00	0.7			1			1.7			0.41			0.21852			0.73		
08/14/22 17:00	0.9			0			1.7			0.53			0.27966			0.93		
08/14/22 18:00	1			1			1.7			0.6			0.31524			1.05		
08/14/22 19:00	1			0			1.7			0.6			0.31542			1.05		
08/14/22 20:00	1			1			1.6			0.51			0.273			0.91		
08/14/22 21:00	0.7			1			1.6			0.35			0.18864			0.63		
08/14/22 22:00	0.7			1			1.5			0.34			0.1821			0.61		
08/14/22 23:00	0.7			1			1.6			0.35			0.1845			0.62		
08/15/22 0:00	0.7			1			1.7			0.34			0.18348			0.61		
08/15/22 1:00	0.6			1			1.7			0.34			0.18336			0.61		
08/15/22 2:00	0.6			1			1.7			0.34			0.18342			0.61		
08/15/22 3:00	0.7			0			1.6			0.36			0.19524			0.65		
08/15/22 4:00	0.8			0			1.5			0.41			0.21978			0.73		
08/15/22 5:00	0.8			0			1.6			0.46			0.24912			0.83		
08/15/22 6:00	0.7			1			1.6			0.37			0.19944			0.66		
08/15/22 7:00	0.6			1			1.6			0.34			0.1794			0.6		
08/15/22 8:00	0.6			1			1.7			0.33			0.17634			0.59		
08/15/22 9:00	0.6			1			1.6			0.34			0.18072			0.6		
08/15/22 10:00	0.7			0			1.5			0.37			0.19536			0.65		
08/15/22 11:00	0.7			0			1.7			0.35			0.183			0.61		
08/15/22 12:00	0.7			0			1.5			0.38			0.19836			0.66		
08/15/22 13:00	1			0			1.7			0.57			0.30066			1		
08/15/22 14:00	0.5			1			1.7			0.72			0.3705			1.24		
08/15/22 15:00	0.5			1			1.6			0.72			0.3744			1.25		
08/15/22 16:00	0.4			1			1.7			0.73			0.37914			1.26		
08/15/22 17:00	0.5			1			1.7			0.73			0.37932			1.26		
08/15/22 18:00	0.4			1			1.6			0.72			0.37668			1.26		
08/15/22 19:00	0.6			1			1.7			0.68			0.35592			1.19		
08/15/22 20:00	0.9			0			1.6			0.58			0.30936			1.03		
08/15/22 21:00	0.8			0			1.6			0.46			0.24918			0.83		
08/15/22 22:00	0.8			0			1.6			0.39			0.2109			0.7		
08/15/22 23:00	0.8			0			1.5			0.45			0.24168			0.81		
08/16/22 0:00	0.8			0			1.7			0.46			0.24462			0.82		
08/16/22 1:00	0.8			1			1.6			0.43			0.22944			0.76		
08/16/22 2:00	0.8			0			1.5			0.41			0.2226			0.74		

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/16/22 3:00	0.9			0			1.6			0.4			0.21636			0.72		
08/16/22 4:00	0.8			0			1.4			0.43			0.23346			0.78		
08/16/22 5:00	1			0			1.7			0.5			0.26742			0.89		
08/16/22 6:00	0.9			1			1.6			0.39			0.21072			0.7		
08/16/22 7:00	0.7			1			1.6			0.34			0.1788			0.6		
08/16/22 8:00	0.7			0			1.6			0.34			0.18054			0.6		
08/16/22 9:00	0.8			0			1.5			0.38			0.20106			0.67		
08/16/22 10:00	0.8			0			1.5			0.42			0.22644			0.75		
08/16/22 11:00	0.7			0			1.6			0.46			0.24546			0.82		
08/16/22 12:00	0.9			0			1.5			0.49			0.25854			0.86		
08/16/22 13:00	0.4			2			1.6			0.75			0.38544			1.28		
08/16/22 14:00	0.3			2			1.6			0.79			0.4038			1.35		
08/16/22 15:00	0.4			2			1.6			0.79			0.40536			1.35		
08/16/22 16:00	0.4			2			1.6			0.79			0.40482			1.35		
08/16/22 17:00	0.4			2			1.6			0.79			0.40494			1.35		
08/16/22 18:00	0.4			2			1.6			0.79			0.4053			1.35		
08/16/22 19:00	0.4			2			1.6			0.75			0.38964			1.3		
08/16/22 20:00	0.4			1			1.6			0.73			0.37962			1.27		
08/16/22 21:00	0.7			1			1.6			0.67			0.35112			1.17		
08/16/22 22:00	1			1			1.6			0.61			0.3231			1.08		
08/16/22 23:00	0.9			0			1.6			0.52			0.28146			0.94		
08/17/22 0:00	0.8			0			1.6			0.53			0.28404			0.95		
08/17/22 1:00	0.8			0			1.6			0.51			0.27258			0.91		
08/17/22 2:00	0.8			0			1.6			0.52			0.27804			0.93		
08/17/22 3:00	0.8			0			1.6			0.51			0.27354			0.91		
08/17/22 4:00	0.8			0			1.6			0.51			0.27606			0.92		
08/17/22 5:00	0.8			0			1.6			0.54			0.2889			0.96		
08/17/22 6:00	0.8			0			1.6			0.54			0.2886			0.96		
08/17/22 7:00	0.9			0			1.6			0.5			0.2394			0.8		
08/17/22 8:00	1.3			0			1.6			0	X		0.30096			1		
08/17/22 9:00	1.1			0			1.6			0	X		0.29406			0.98		
08/17/22 10:00	0.7			0			1.6			0	X		0.2895			0.97		
08/17/22 11:00	0.7			0			1.6			0	X		0.28968			0.97		
08/17/22 12:00	0.7			0			1.6			0	X		0.28794			0.96		
08/17/22 13:00	0.7			0			1.6			0	X		0.2862			0.95		
08/17/22 14:00	0.7			0			1.6			0	X		0.28536			0.95		
08/17/22 15:00	0.7			0			1.6			0	X		0.28488			0.95		

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/17/22 16:00	0.7			0			1.6			0	X		0.28542			0.95		
08/17/22 17:00	0.7			0			1.6			0	X		0.28656			0.96		
08/17/22 18:00	0.7			0			1.6			0	X		0.28662			0.96		
08/17/22 19:00	0.8			0			1.6			0	X		0.28662			0.96		
08/17/22 20:00	0.7			0			1.6			0	X		0.28674			0.96		
08/17/22 21:00	0.8			0			1.6			0	X		0.2865			0.96		
08/17/22 22:00	0.7			0			1.6			0	X		0.28626			0.95		
08/17/22 23:00	0.7			1			1.6			0	X		0.1953			0.65		
08/18/22 0:00	0.7			1			1.6			0	X		0.19134			0.64		
08/18/22 1:00	0.7			1			1.6			0	X		0.1911			0.64		
08/18/22 2:00	0.7			1			1.6			0	X		0.19104			0.64		
08/18/22 3:00	0.7			1			1.6			0	X		0.19104			0.64		
08/18/22 4:00	0.7			1			1.6			0	X		0.1917			0.64		
08/18/22 5:00	0.8			1			1.6			0	X		0.19206			0.64		
08/18/22 6:00	0.7			1			1.6			0	X		0.19146			0.64		
08/18/22 7:00	0.7			1			1.6			0	X		0.18414			0.61		
08/18/22 8:00	0.7			0			1.6			0	X		0.18258			0.61		
08/18/22 9:00	0.7			0			1.6			0	X		0.18288			0.61		
08/18/22 10:00	0.7			0			1.6			0	X		0.1827			0.61		
08/18/22 11:00	0.7			0			1.6			0	X		0.18264			0.61		
08/18/22 12:00	0.7			0			1.5			0	X		0.18534			0.62		
08/18/22 13:00	0.9			0			1.4			0	X		0.24492			0.82		
08/18/22 14:00	1.1			0			1.6			0	X		0.31194			1.04		
08/18/22 15:00	0.7			1			1.6			0	X		0.3435			1.15		
08/18/22 16:00	0.7			1			1.6			0	X		0.33516			1.12		
08/18/22 17:00	0.6			1			1.6			0	X		0.35394			1.18		
08/18/22 18:00	1			0			1.7			0	X		0.31224			1.04		
08/18/22 19:00	1.1			0			1.7			0	X		0.30744			1.02		
08/18/22 20:00	1.3			0			1.7			0	X		0.30588			1.02		
08/18/22 21:00	1.4			0			1.7			0	X		0.3054			1.02		
08/18/22 22:00	1.5			0			1.7			0	X		0.3042			1.01		
08/18/22 23:00	1.5			0			1.7			0	X		0.30228			1.01		
08/19/22 0:00	1.6			1			1.7			0	X		0.29844			0.99		
08/19/22 1:00	1.5			0			1.7			0	X		0.3003			1		
08/19/22 2:00	1.5			0			1.7			0	X		0.29916			1		
08/19/22 3:00	1.6			1			1.7			0	X		0.29826			0.99		
08/19/22 4:00	1.6			0			1.7			0	X		0.29808			0.99		

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/19/22 5:00	1.6			1			1.6			0	X		0.2982			0.99		
08/19/22 6:00	1.6			0			1.6			0	X		0.30528			1.02		
08/19/22 7:00	1.5			0			1.6			0	X		0.3033			1.01		
08/19/22 8:00	0.8			1			1.6			0	X		0.22602			0.75		
08/19/22 9:00	0.7			0			1.6			0	X		0.183			0.61		
08/19/22 10:00	0.7			0			1.4			0	X		0.19746			0.66		
08/19/22 11:00	0.8			0			1.6			0.34			0.22974			0.77		
08/19/22 12:00	0.7			1			1.6			0.36			0.18846			0.63		
08/19/22 13:00	0.6			0			1.6			0.33			0.1746			0.58		
08/19/22 14:00	0.7			0			1.5			0.35			0.1854			0.62		
08/19/22 15:00	0.7			1			1.5			0.36			0.189			0.63		
08/19/22 16:00	0.7			0			1.5			0.35			0.18528			0.62		
08/19/22 17:00	0.7			0			1.5			0.48			0.25902			0.86		
08/19/22 18:00	0.7			0			1.7			0.49			0.2616			0.87		
08/19/22 19:00	0.7			0			1.6			0.45			0.24186			0.81		
08/19/22 20:00	0.7			1			1.6			0.42			0.22164			0.74		
08/19/22 21:00	0			0	X		0			0.38			0.09936			0.33		
08/19/22 22:00	0	X		0	X		0	X		0.36			0	X		0	X	
08/19/22 23:00	0	X		0	X		0	X		0.36			0	X		0	X	
08/20/22 0:00	0	X		0	X		0	X		0.36			0	X		0	X	
08/20/22 1:00	0	X		0	X		0	X		0.36			0	X		0	X	
08/20/22 2:00	0	X		0	X		0	X		0.36			0	X		0	X	
08/20/22 3:00	0	X		0	X		0	X		0.35			0	X		0	X	
08/20/22 4:00	0	X		0	X		0	X		0.34			0	X		0	X	
08/20/22 5:00	0	X		0	X		0	X		0.34			0	X		0	X	
08/20/22 6:00	0	X		0	X		0	X		0.34			0	X		0	X	
08/20/22 7:00	0	X		0	X		0	X		0.34			0	X		0	X	
08/20/22 8:00	0	X		0	X		0	X		0.34			0	X		0	X	
08/20/22 9:00	0	X		0	X		0	X		0.34			0	X		0	X	
08/20/22 10:00	0	X		0	X		0	X		0.34			0	X		0	X	
08/20/22 11:00	0	X		0	X		0	X		0.34			0	X		0	X	
08/20/22 12:00	0	X		0	X		0	X		0.34			0	X		0	X	
08/20/22 13:00	0	X		0	X		0	X		0.34			0	X		0	X	
08/20/22 14:00	0	X		0	X		0	X		0.4			0	X		0	X	
08/20/22 15:00	0.7			1			0.8			0.5			0.20952			0.7		
08/20/22 16:00	0.7			0			1.5			0	X		0.27954			0.93		
08/20/22 17:00	1			0			1.7			0	X		0.28314			0.94		

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/20/22 18:00	0.9			1			1.7			0	X		0.31848			1.06		
08/20/22 19:00	1			0			1.7			0	X		0.31302			1.04		
08/20/22 20:00	1.1			0			1.7			0	X		0.31182			1.04		
08/20/22 21:00	1.1			0			1.7			0	X		0.31518			1.05		
08/20/22 22:00	1.1			0			1.7			0	X		0.3162			1.05		
08/20/22 23:00	1.1			0			1.7			0	X		0.31596			1.05		
08/21/22 0:00	1.2			0			1.7			0	X		0.31494			1.05		
08/21/22 1:00	1.1			0			1.7			0	X		0.31386			1.05		
08/21/22 2:00	1.1			0			1.7			0	X		0.31254			1.04		
08/21/22 3:00	0.9			1			1.5			0	X		0.23298			0.78		
08/21/22 4:00	0.7			1			1.7			0	X		0.18348			0.61		
08/21/22 5:00	0.8			0			1.6			0	X		0.21414			0.71		
08/21/22 6:00	0.7			1			1.7			0	X		0.19998			0.67		
08/21/22 7:00	0.7			1			1.5			0	X		0.19848			0.66		
08/21/22 8:00	0.7			1			1.7			0.31			0.23694			0.79		
08/21/22 9:00	0.6			1			1.7			0.34			0.17916			0.6		
08/21/22 10:00	0.7			0			1.6			0.37			0.19812			0.66		
08/21/22 11:00	0.7			0			1.6			0.45			0.23922			0.8		
08/21/22 12:00	0.7			0			1.7			0.55			0.28536			0.95		
08/21/22 13:00	0.7			0			1.7			0.55			0.2853			0.95		
08/21/22 14:00	0.7			0			1.7			0.55			0.25926			0.86		
08/21/22 15:00	0.6			1			1.4			0.55			0.2313			0.77		
08/21/22 16:00	0.8			1			1.6			0.54			0.21054			0.7		
08/21/22 17:00	0.9			1			1.7			0.65			0.33504			1.12		
08/21/22 18:00	0.7			1			1.6			0.64			0.33702			1.12		
08/21/22 19:00	1			0			1.6			0.59			0.30624			1.02		
08/21/22 20:00	0.7			0			1.6			0.55			0.25116			0.84		
08/21/22 21:00	0.7			1			1.5			0.55			0.24438			0.81		
08/21/22 22:00	0.7			0			1.3			0.55			0.23322			0.78		
08/21/22 23:00	0.7			0			1.6			0.55			0.23874			0.8		
08/22/22 0:00	0.7			1			1.6			0.55			0.20166			0.67		
08/22/22 1:00	0.6			1			1.5			0.55			0.18594			0.62		
08/22/22 2:00	0.5			1			1.6			0.55			0.1779			0.59		
08/22/22 3:00	0.6			0			1.5			0.55			0.1869			0.62		
08/22/22 4:00	0.7			0			1.4			0.55			0.2136			0.71		
08/22/22 5:00	0.7			0			1.6			0.55			0.29172			0.97		
08/22/22 6:00	0.7			0			1.7			0	X		0.29598			0.99		

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/22/22 7:00	0.7			0			1.7			0	X		0.29772			0.99		
08/22/22 8:00	0.7			0			1.6			0	X		0.29634			0.99		
08/22/22 9:00	0.6			1			1.6			0	X		0.1887			0.63		
08/22/22 10:00	0.6			1			1.6			0	X		0.18174			0.61		
08/22/22 11:00	0.6			0			1.6			0	X		0.1815			0.61		
08/22/22 12:00	0.6			0			1.7			0	X		0.18144			0.6		
08/22/22 13:00	0.6			0			1.7			0	X		0.18132			0.6		
08/22/22 14:00	0.6			0			1.7			0	X		0.18126			0.6		
08/22/22 15:00	0.8			0			1.6			0	X		0.24594			0.82		
08/22/22 16:00	0.9			1			1.7			0	X		0.32004			1.07		
08/22/22 17:00	0.5			1			1.7			0	X		0.35976			1.2		
08/22/22 18:00	0.3			2			1.6			0	X		0.39438			1.31		
08/22/22 19:00	0.6			1			1.6			0	X		0.34314			1.14		
08/22/22 20:00	1			0			1.6			0	X		0.31308			1.04		
08/22/22 21:00	1.1			0			1.6			0	X		0.30726			1.02		
08/22/22 22:00	1.1			0			1.6			0	X		0.30768			1.03		
08/22/22 23:00	1.1			0			1.6			0	X		0.30468			1.02		
08/23/22 0:00	1.1			1			1.6			0	X		0.3099			1.03		
08/23/22 1:00	1.1			0			1.6			0	X		0.30606			1.02		
08/23/22 2:00	1.2			0			1.6			0	X		0.3039			1.01		
08/23/22 3:00	1			1			1.6			0	X		0.31482			1.05		
08/23/22 4:00	1.2			0			1.6			0	X		0.30792			1.03		
08/23/22 5:00	0.8			1			1.6			0	X		0.34332			1.14		
08/23/22 6:00	1.4			0			1.6			0	X		0.30534			1.02		
08/23/22 7:00	1.3			0			1.6			0	X		0.30492			1.02		
08/23/22 8:00	1.2			0			1.6			0	X		0.30708			1.02		
08/23/22 9:00	1			0			1.6			0	X		0.30702			1.02		
08/23/22 10:00	1			1			1.6			0	X		0.30702			1.02		
08/23/22 11:00	0.9			1			1.6			0	X		0.31848			1.06		
08/23/22 12:00	1			1			1.6			0	X		0.32346			1.08		
08/23/22 13:00	1			1			1.6			0	X		0.31596			1.05		
08/23/22 14:00	0.8			1			1.6			0	X		0.33534			1.12		
08/23/22 15:00	0.9			0			1.6			0	X		0.31488			1.05		
08/23/22 16:00	0.8			1			1.6			0	X		0.33552			1.12		
08/23/22 17:00	0.4			2			1.6			0	X		0.4014			1.34		
08/23/22 18:00	0.5			1			1.6			0	X		0.36			1.2		
08/23/22 19:00	0.7			1			1.6			0	X		0.34284			1.14		

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/23/22 20:00	0.5			1			1.6			0	X		0.36504			1.22		
08/23/22 21:00	0.9			0			1.6			0	X		0.32694			1.09		
08/23/22 22:00	1.1			0			1.6			0	X		0.306			1.02		
08/23/22 23:00	1.1			0			1.6			0	X		0.30558			1.02		
08/24/22 0:00	1.1			0			1.6			0	X		0.30822			1.03		
08/24/22 1:00	1.1			0			1.6			0	X		0.30708			1.02		
08/24/22 2:00	1.1			0			1.6			0	X		0.30624			1.02		
08/24/22 3:00	1.2			0			1.6			0	X		0.30468			1.02		
08/24/22 4:00	1.2			0			1.6			0	X		0.30384			1.01		
08/24/22 5:00	1.2			0			1.6			0	X		0.30264			1.01		
08/24/22 6:00	1.2			0			1.6			0	X		0.30306			1.01		
08/24/22 7:00	1.1			0			1.6			0	X		0.30504			1.02		
08/24/22 8:00	1			0			1.6			0	X		0.30642			1.02		
08/24/22 9:00	1			0			1.6			0	X		0.30516			1.02		
08/24/22 10:00	1			0			1.6			0	X		0.3066			1.02		
08/24/22 11:00	1.1			1			1.6			0	X		0.30852			1.03		
08/24/22 12:00	1			0			1.6			0	X		0.31392			1.05		
08/24/22 13:00	1			1			1.6			0	X		0.31404			1.05		
08/24/22 14:00	0.4			2			1.6			0	X		0.3864			1.29		
08/24/22 15:00	0.8			1			1.6			0	X		0.32844			1.09		
08/24/22 16:00	0.8			1			1.6			0	X		0.34548			1.15		
08/24/22 17:00	0.5			2			1.6			0	X		0.38148			1.27		
08/24/22 18:00	0.9			0			1.6			0	X		0.32064			1.07		
08/24/22 19:00	1			0			1.6			0	X		0.30732			1.02		
08/24/22 20:00	1.1			0			1.6			0	X		0.3087			1.03		
08/24/22 21:00	1.1			0			1.6			0	X		0.30546			1.02		
08/24/22 22:00	1.1			0			1.6			0	X		0.30306			1.01		
08/24/22 23:00	1.2			0			1.6			0	X		0.30522			1.02		
08/25/22 0:00	1.2			1			1.6			0	X		0.30372			1.01		
08/25/22 1:00	1.2			1			1.6			0	X		0.3042			1.01		
08/25/22 2:00	1.3			0			1.6			0	X		0.30402			1.01		
08/25/22 3:00	1.4			1			1.6			0	X		0.30366			1.01		
08/25/22 4:00	1.4			0			1.6			0	X		0.3			1		
08/25/22 5:00	1.4			1			1.6			0	X		0.29748			0.99		
08/25/22 6:00	1.4			1			1.7			0	X		0.29778			0.99		
08/25/22 7:00	1.4			0			1.7			0	X		0.30138			1		
08/25/22 8:00	1.3			0			1.7			0	X		0.30552			1.02		

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/25/22 9:00	1.1			0			1.6			0	X		0.30708			1.02		
08/25/22 10:00	1.1			0			1.6			0	X		0.30972			1.03		
08/25/22 11:00	1.2			0			1.7			0	X		0.31182			1.04		
08/25/22 12:00	1.1			0			1.7			0	X		0.31164			1.04		
08/25/22 13:00	1.1			0			1.7			0	X		0.30684			1.02		
08/25/22 14:00	1.1			0			1.7			0	X		0.3063			1.02		
08/25/22 15:00	1.1			1			1.7			0	X		0.31086			1.04		
08/25/22 16:00	1.1			0			1.7			0	X		0.30672			1.02		
08/25/22 17:00	1			0			1.6			0	X		0.30678			1.02		
08/25/22 18:00	1			0			1.6			0	X		0.30618			1.02		
08/25/22 19:00	1.1			1			1.6			0	X		0.30684			1.02		
08/25/22 20:00	1.1			1			1.6			0	X		0.3069			1.02		
08/25/22 21:00	1.1			0			1.6			0	X		0.30546			1.02		
08/25/22 22:00	1.2			1			1.6			0	X		0.30384			1.01		
08/25/22 23:00	1.2			1			1.6			0	X		0.30264			1.01		
08/26/22 0:00	1.3			1			1.6			0	X		0.30036			1		
08/26/22 1:00	1.4			1			1.6			0	X		0.2967			0.99		
08/26/22 2:00	1.4			1			1.6			0	X		0.29706			0.99		
08/26/22 3:00	1.4			1			1.6			0	X		0.29742			0.99		
08/26/22 4:00	1.4			1			1.6			0	X		0.2979			0.99		
08/26/22 5:00	1.3			1			1.6			0.21			0.29916			1		
08/26/22 6:00	0.6			1			1.5			0.5			0.18156			0.61		
08/26/22 7:00	0.6			1			1.6			0.33			0.17904			0.6		
08/26/22 8:00	0.6			1			1.6			0.34			0.18042			0.6		
08/26/22 9:00	0.8			0			1.3			0.47			0.25362			0.85		
08/26/22 10:00	0.7			0			1.5			0.44			0.23406			0.78		
08/26/22 11:00	0.9			0			1.5			0.48			0.25518			0.85		
08/26/22 12:00	0.9			1			1.6			0.63			0.32916			1.1		
08/26/22 13:00	0.5			1			1.6			0.72			0.37428			1.25		
08/26/22 14:00	0.5			1			1.6			0.74			0.38442			1.28		
08/26/22 15:00	0.5			1			1.6			0.72			0.37416			1.25		
08/26/22 16:00	0.5			2			1.6			0.73			0.38196			1.27		
08/26/22 17:00	0.4			2			1.7			0.78			0.40488			1.35		
08/26/22 18:00	0.4			2			1.6			0.74			0.38682			1.29		
08/26/22 19:00	0.4			2			1.6			0.76			0.3936			1.31		
08/26/22 20:00	0.5			1			1.6			0.71			0.37152			1.24		
08/26/22 21:00	0.6			1			1.6			0.68			0.35922			1.2		

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/26/22 22:00	0.9			0			1.6			0.57			0.30528			1.02		
08/26/22 23:00	0.7			0			1.6			0.52			0.27786			0.93		
08/27/22 0:00	0.7			0			1.6			0.52			0.27828			0.93		
08/27/22 1:00	0.7			0			1.6			0.51			0.27708			0.92		
08/27/22 2:00	0.7			0			1.5			0.52			0.27804			0.93		
08/27/22 3:00	0.7			0			1.6			0.52			0.27804			0.93		
08/27/22 4:00	0.7			0			1.6			0.52			0.28044			0.93		
08/27/22 5:00	0.7			0			1.6			0.52			0.28044			0.93		
08/27/22 6:00	0.6			1			1.6			0.38			0.20274			0.68		
08/27/22 7:00	0.6			1			1.6			0.33			0.17466			0.58		
08/27/22 8:00	0.6			1			1.6			0.33			0.17484			0.58		
08/27/22 9:00	0.6			1			1.6			0.33			0.17592			0.59		
08/27/22 10:00	0.7			0			1.4			0.4			0.21294			0.71		
08/27/22 11:00	0.9			0			1.6			0.49			0.26238			0.87		
08/27/22 12:00	1.1			0			1.6			0.6			0.31464			1.05		
08/27/22 13:00	1			0			1.6			0.6			0.31644			1.05		
08/27/22 14:00	1			1			1.6			0.6			0.31482			1.05		
08/27/22 15:00	1			1			1.6			0.6			0.31428			1.05		
08/27/22 16:00	0.9			1			1.6			0.64			0.33372			1.11		
08/27/22 17:00	0.8			1			1.6			0.7			0.36618			1.22		
08/27/22 18:00	0.7			2			1.6			0.73			0.38136			1.27		
08/27/22 19:00	0.7			1			1.6			0.72			0.3753			1.25		
08/27/22 20:00	0.7			1			1.6			0.69			0.36438			1.21		
08/27/22 21:00	0.9			0			1.6			0.58			0.30792			1.03		
08/27/22 22:00	0.7			1			1.4			0.38			0.20604			0.69		
08/27/22 23:00	0.8			0			1.5			0.42			0.22512			0.75		
08/28/22 0:00	0.6			1			1.6			0.34			0.18384			0.61		
08/28/22 1:00	0.7			1			1.6			0.34			0.1839			0.61		
08/28/22 2:00	0.7			1			1.8			0.34			0.1827			0.61		
08/28/22 3:00	0.7			1			1.6			0.34			0.18456			0.62		
08/28/22 4:00	0.7			1			1.6			0.34			0.18324			0.61		
08/28/22 5:00	0.6			1			1.6			0.35			0.18642			0.62		
08/28/22 6:00	0.6			1			1.7			0.33			0.17856			0.6		
08/28/22 7:00	0.6			1			1.7			0.33			0.17574			0.59		
08/28/22 8:00	0.6			1			1.7			0.33			0.17574			0.59		
08/28/22 9:00	0.6			1			1.7			0.33			0.1758			0.59		
08/28/22 10:00	0.6			1			1.6			0.33			0.17574			0.59		

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/28/22 11:00	0.6			1			1.6			0.33			0.17634			0.59		
08/28/22 12:00	0.7			0			1.5			0.42			0.22476			0.75		
08/28/22 13:00	0.7			0			1.7			0.43			0.23226			0.77		
08/28/22 14:00	0.7			0			1.7			0.49			0.26112			0.87		
08/28/22 15:00	0.7			1			1.7			0.38			0.20406			0.68		
08/28/22 16:00	0.9			1			1.8			0.53			0.28002			0.93		
08/28/22 17:00	0.6			2			1.5			0.76			0.39282			1.31		
08/28/22 18:00	0.9			1			1.5			0.63			0.32946			1.1		
08/28/22 19:00	1			1			1.5			0.59			0.31056			1.04		
08/28/22 20:00	1			0			1.5			0.51			0.27294			0.91		
08/28/22 21:00	0.7			1			1.4			0.43			0.22914			0.76		
08/28/22 22:00	0.7			1			1.4			0.35			0.18702			0.62		
08/28/22 23:00	0.8			0			1.4			0.46			0.24852			0.83		
08/29/22 0:00	0.8			0			1.5			0.45			0.24462			0.82		
08/29/22 1:00	0.8			0			1.5			0.46			0.24804			0.83		
08/29/22 2:00	0.8			0			1.4			0.48			0.25926			0.86		
08/29/22 3:00	0.8			0			1.5			0.46			0.24606			0.82		
08/29/22 4:00	0.8			0			1.5			0.48			0.261			0.87		
08/29/22 5:00	0.7			0			1.5			0.52			0.27894			0.93		
08/29/22 6:00	0.7			1			1.6			0.39			0.20976			0.7		
08/29/22 7:00	0.6			1			1.6			0.34			0.17964			0.6		
08/29/22 8:00	0.6			1			1.6			0.33			0.1761			0.59		
08/29/22 9:00	0.7			1			1.6			0.34			0.18252			0.61		
08/29/22 10:00	0.6			1			1.6			0.34			0.1809			0.6		
08/29/22 11:00	0.7			1			1.7			0.35			0.18324			0.61		
08/29/22 12:00	0.7			0			1.7			0.34			0.18216			0.61		
08/29/22 13:00	0.7			0			1.6			0.41			0.21654			0.72		
08/29/22 14:00	0.9			0			1.9			0.49			0.25938			0.86		
08/29/22 15:00	0.9			1			1.7			0.62			0.32634			1.09		
08/29/22 16:00	0.9			1			1.6			0.64			0.33576			1.12		
08/29/22 17:00	0.7			1			1.6			0.72			0.37332			1.24		
08/29/22 18:00	0.7			1			1.5			0.69			0.36132			1.2		
08/29/22 19:00	0.8			1			1.5			0.66			0.34752			1.16		
08/29/22 20:00	0.9			1			1.6			0.64			0.3363			1.12		
08/29/22 21:00	1			1			1.5			0.58			0.30996			1.03		
08/29/22 22:00	0.7			0			1.5			0.49			0.26448			0.88		
08/29/22 23:00	0.7			0			1.6			0.54			0.28968			0.97		

Date/Time	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/30/22 0:00	0.7			0			1.5			0.53			0.28308			0.94		
08/30/22 1:00	0.8			0			1.6			0.5			0.2712			0.9		
08/30/22 2:00	0.8			0			1.6			0.5			0.26898			0.9		
08/30/22 3:00	0.8			0			1.6			0.5			0.2685			0.9		
08/30/22 4:00	0.8			0			1.6			0.52			0.28176			0.94		
08/30/22 5:00	0.7			0			1.5			0.55			0.2946			0.98		
08/30/22 6:00	0.7			1			1.5			0.37			0.1986			0.66		
08/30/22 7:00	0.6			1			1.6			0.33			0.17694			0.59		
08/30/22 8:00	0.7			0			1.4			0.38			0.20214			0.67		
08/30/22 9:00	0.8			0			1.6			0.42			0.22632			0.75		
08/30/22 10:00	0.8			0			1.6			0.49			0.2613			0.87		
08/30/22 11:00	0.7			0			1.6			0.53			0.28434			0.95		
08/30/22 12:00	0.7			0			1.6			0.52			0.27954			0.93		
08/30/22 13:00	0.9			0			1.6			0.54			0.28494			0.95		
08/30/22 14:00	0.6			2			1.6			0.73			0.3789			1.26		
08/30/22 15:00	0.5			2			1.6			0.75			0.38964			1.3		
08/30/22 16:00	0.5			2			1.6			0.75			0.38574			1.29		
08/30/22 17:00	0.5			2			1.6			0.79			0.40458			1.35		
08/30/22 18:00	0.5			2			1.6			0.79			0.40776			1.36		
08/30/22 19:00	0.5			2			1.6			0.77			0.4014			1.34		
08/30/22 20:00	0.6			1			1.6			0.73			0.38022			1.27		
08/30/22 21:00	0.7			1			1.6			0.69			0.36312			1.21		
08/30/22 22:00	0.9			1			1.6			0.58			0.31062			1.04		
08/30/22 23:00	0.8			0			1.6			0.54			0.28998			0.97		
08/31/22 0:00	0.7			0			1.6			0.54			0.29076			0.97		
08/31/22 1:00	0.7			0			1.6			0.54			0.29196			0.97		
08/31/22 2:00	0.7			0			1.6			0.54			0.29274			0.98		
08/31/22 3:00	0.7			0			1.6			0.54			0.2919			0.97		
08/31/22 4:00	0.8			0			1.6			0.55			0.29394			0.98		
08/31/22 5:00	0.8			0			1.6			0.55			0.29478			0.98		
08/31/22 6:00	0.8			0			1.6			0.5			0.26646			0.89		
08/31/22 7:00	0.8			0			1.6			0.45			0.24168			0.81		
08/31/22 8:00	0.8			0			1.6			0.45			0.2412			0.8		
08/31/22 9:00	0.8			0			1.6			0.48			0.25566			0.85		
08/31/22 10:00	0.9			0			1.6			0.53			0.28296			0.94		
08/31/22 11:00	0.5			1			1.6			0.72			0.37266			1.24		
08/31/22 12:00	0.5			2			1.6			0.74			0.38574			1.29		

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
08/31/22 13:00	0.5			2			1.6			0.76			0.39384			1.31		
08/31/22 14:00	0.5			2			1.6			0.74			0.38286			1.28		
08/31/22 15:00	0.6			1			1.6			0.69			0.36			1.2		
08/31/22 16:00	0.7			1			1.6			0.66			0.3414			1.14		
08/31/22 17:00	0.5			2			1.6			0.75			0.39018			1.3		
08/31/22 18:00	0.5			2			1.6			0.77			0.39894			1.33		
08/31/22 19:00	0.6			1			1.6			0.71			0.3723			1.24		
08/31/22 20:00	0.9			1			1.6			0.64			0.33864			1.13		
08/31/22 21:00	0.8			1			1.6			0.67			0.35094			1.17		
08/31/22 22:00	1			1			1.6			0.61			0.32088			1.07		
08/31/22 23:00	0.9			1			1.6			0.64			0.33918			1.13		
09/01/22 0:00	0.9			1			1.6			0.65			0.34314			1.14		
09/01/22 1:00	1.1			0			1.6			0.57			0.3054			1.02		
09/01/22 2:00	0.8			0			1.6			0.53			0.28308			0.94		
09/01/22 3:00	0.8			0			1.6			0.53			0.28812			0.96		
09/01/22 4:00	0.9			0			1.6			0.53			0.28518			0.95		
09/01/22 5:00	1			0			1.6			0.53			0.28632			0.95		
09/01/22 6:00	1			0			1.6			0.52			0.2811			0.94		
09/01/22 7:00	0.8			0			1.6			0.53			0.28338			0.94		
09/01/22 8:00	0.8			1			1.6			0.35			0.18894			0.63		
09/01/22 9:00	0.8			1			1.6			0.35			0.18666			0.62		
09/01/22 10:00	0.7			0			1.5			0.36			0.19266			0.64		
09/01/22 11:00	0.9			1			1.4			0.48			0.25686			0.86		
09/01/22 12:00	0.6			1			1.6			0.71			0.36618			1.22		
09/01/22 13:00	0.6			2			1.6			0.72			0.3753			1.25		
09/01/22 14:00	0.6			2			1.6			0.74			0.38178			1.27		
09/01/22 15:00	0.6			2			1.6			0.77			0.39492			1.32		
09/01/22 16:00	0.6			2			1.6			0.74			0.38022			1.27		
09/01/22 17:00	0.6			2			1.6			0.77			0.3951			1.32		
09/01/22 18:00	0.6			2			1.6			0.77			0.3957			1.32		
09/01/22 19:00	0.7			1			1.6			0.72			0.37554			1.25		
09/01/22 20:00	0.6			2			1.6			0.75			0.38712			1.29		
09/01/22 21:00	0.6			2			1.6			0.73			0.37836			1.26		
09/01/22 22:00	0.8			1			1.6			0.69			0.3615			1.21		
09/01/22 23:00	0.8			1			1.6			0.7			0.3651			1.22		
09/02/22 0:00	0.8			1			1.6			0.66			0.35004			1.17		
09/02/22 1:00	0.9			1			1.6			0.65			0.34482			1.15		

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/02/22 2:00	0.9			1			1.6			0.63			0.33612			1.12		
09/02/22 3:00	0.9			1			1.6			0.63			0.33438			1.11		
09/02/22 4:00	0.9			1			1.6			0.66			0.34848			1.16		
09/02/22 5:00	0.8			1			1.6			0.69			0.36306			1.21		
09/02/22 6:00	1			1			1.6			0.61			0.3252			1.08		
09/02/22 7:00	1.1			0			1.6			0.58			0.30858			1.03		
09/02/22 8:00	1.1			1			1.6			0.6			0.318			1.06		
09/02/22 9:00	1			1			1.6			0.64			0.33708			1.12		
09/02/22 10:00	0.8			1			1.6			0.67			0.3492			1.16		
09/02/22 11:00	0.8			1			1.6			0.68			0.3561			1.19		
09/02/22 12:00	0.8			1			1.6			0.7			0.3639			1.21		
09/02/22 13:00	0.8			2			1.6			0.73			0.37968			1.27		
09/02/22 14:00	0.8			2			1.6			0.73			0.37866			1.26		
09/02/22 15:00	0.8			1			1.6			0.65			0.34032			1.13		
09/02/22 16:00	0.9			1			1.6			0.64			0.33318			1.11		
09/02/22 17:00	0.8			1			1.6			0.64			0.33636			1.12		
09/02/22 18:00	0.8			1			1.6			0.67			0.34968			1.17		
09/02/22 19:00	0.8			1			1.6			0.69			0.36066			1.2		
09/02/22 20:00	0.8			1			1.6			0.67			0.35364			1.18		
09/02/22 21:00	1			1			1.6			0.63			0.3318			1.11		
09/02/22 22:00	1.1			0			1.6			0.57			0.30462			1.02		
09/02/22 23:00	0.8			1			1.5			0.42			0.22488			0.75		
09/03/22 0:00	0.8			0			1.6			0.46			0.2484			0.83		
09/03/22 1:00	0.7			1			1.6			0.35			0.18636			0.62		
09/03/22 2:00	0.7			0			1.5			0.34			0.18132			0.6		
09/03/22 3:00	0.7			1			1.6			0.34			0.18216			0.61		
09/03/22 4:00	0.7			1			1.6			0.34			0.17946			0.6		
09/03/22 5:00	0.7			1			1.6			0.34			0.18174			0.61		
09/03/22 6:00	0.6			1			1.6			0.33			0.17502			0.58		
09/03/22 7:00	0.6			1			1.6			0.33			0.17496			0.58		
09/03/22 8:00	0.6			1			1.6			0.33			0.17358			0.58		
09/03/22 9:00	0.7			1			1.5			0.33			0.17766			0.59		
09/03/22 10:00	0.7			1			1.6			0.34			0.17796			0.59		
09/03/22 11:00	0.6			1			1.6			0.33			0.1752			0.58		
09/03/22 12:00	0.8			0			1.4			0.4			0.21432			0.71		
09/03/22 13:00	1.1			0			1.7			0.6			0.3153			1.05		
09/03/22 14:00	1.1			0			1.6			0.58			0.30312			1.01		

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/03/22 15:00	0.9			1			1.8			0.45			0.2343			0.78		
09/03/22 16:00	1			1			1.6			0.61			0.3162			1.05		
09/03/22 17:00	1			1			1.6			0.6			0.31572			1.05		
09/03/22 18:00	1.1			1			1.6			0.6			0.31434			1.05		
09/03/22 19:00	0.8			1			1.6			0.4			0.21498			0.72		
09/03/22 20:00	0.8			1			1.5			0.36			0.19194			0.64		
09/03/22 21:00	0.8			0			1.5			0.39			0.21006			0.7		
09/03/22 22:00	0.8			1			1.7			0.38			0.20394			0.68		
09/03/22 23:00	0.8			0			1.5			0.42			0.22704			0.76		
09/04/22 0:00	0.8			1			1.5			0.4			0.21222			0.71		
09/04/22 1:00	0.7			1			1.6			0.35			0.18594			0.62		
09/04/22 2:00	0.8			1			1.6			0.38			0.20214			0.67		
09/04/22 3:00	0.9			1			1.6			0.38			0.20556			0.69		
09/04/22 4:00	0.9			1			1.6			0.35			0.18642			0.62		
09/04/22 5:00	1.1			1			1.6			0.33			0.17796			0.59		
09/04/22 6:00	1			1			1.6			0.33			0.17724			0.59		
09/04/22 7:00	0.7			1			1.6			0.33			0.17502			0.58		
09/04/22 8:00	0.6			1			1.6			0.33			0.1746			0.58		
09/04/22 9:00	0.6			1			1.6			0.33			0.17442			0.58		
09/04/22 10:00	0.6			1			1.5			0.33			0.17706			0.59		
09/04/22 11:00	0.6			0			1.6			0.33			0.17574			0.59		
09/04/22 12:00	0.7			0			1.5			0.37			0.19764			0.66		
09/04/22 13:00	0.7			1			1.5			0.37			0.1947			0.65		
09/04/22 14:00	0.9			0			1.2			0.46			0.2439			0.81		
09/04/22 15:00	1			1			1.6			0.6			0.31458			1.05		
09/04/22 16:00	1			1			1.6			0.62			0.32274			1.08		
09/04/22 17:00	0.9			1			1.6			0.65			0.33918			1.13		
09/04/22 18:00	0.9			1			1.6			0.65			0.33702			1.12		
09/04/22 19:00	1.1			0			1.6			0.54			0.28806			0.96		
09/04/22 20:00	1			1			1.6			0.62			0.32682			1.09		
09/04/22 21:00	1			1			1.6			0.62			0.32574			1.09		
09/04/22 22:00	1.2			0			1.6			0.57			0.30072			1		
09/04/22 23:00	0.9			0			1.6			0.51			0.2721			0.91		
09/05/22 0:00	0.9			0			1.6			0.5			0.26964			0.9		
09/05/22 1:00	0.9			1			1.6			0.46			0.24642			0.82		
09/05/22 2:00	1			0			1.6			0.44			0.23646			0.79		
09/05/22 3:00	0.9			0			1.6			0.46			0.24498			0.82		

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/05/22 4:00	1			0			1.6			0.46			0.24636			0.82		
09/05/22 5:00	1.1			1			1.6			0.45			0.2394			0.8		
09/05/22 6:00	0.8			1			1.6			0.34			0.1794			0.6		
09/05/22 7:00	0.8			1			1.6			0.33			0.1743			0.58		
09/05/22 8:00	0.7			1			1.6			0.33			0.17472			0.58		
09/05/22 9:00	0.8			0			1.1			0.44			0.23742			0.79		
09/05/22 10:00	0.8			0			1.7			0.5			0.26832			0.89		
09/05/22 11:00	0.9			0			1.6			0.52			0.27456			0.92		
09/05/22 12:00	0.6			1			1.6			0.65			0.33522			1.12		
09/05/22 13:00	0.6			1			1.6			0.68			0.35364			1.18		
09/05/22 14:00	0.5			2			1.6			0.74			0.38328			1.28		
09/05/22 15:00	0.5			2			1.6			0.76			0.38886			1.3		
09/05/22 16:00	0.5			2			1.6			0.76			0.3891			1.3		
09/05/22 17:00	0.6			2			1.6			0.76			0.39036			1.3		
09/05/22 18:00	0.5			2			1.6			0.76			0.39132			1.3		
09/05/22 19:00	0.5			2			1.6			0.75			0.39048			1.3		
09/05/22 20:00	0.5			2			1.6			0.75			0.38928			1.3		
09/05/22 21:00	0.7			1			1.6			0.72			0.37422			1.25		
09/05/22 22:00	0.7			1			1.6			0.72			0.37398			1.25		
09/05/22 23:00	0.6			1			1.6			0.72			0.37716			1.26		
09/06/22 0:00	0.7			1			1.6			0.67			0.35406			1.18		
09/06/22 1:00	1.1			0			1.6			0.57			0.30066			1		
09/06/22 2:00	0.7			0			1.5			0.52			0.27816			0.93		
09/06/22 3:00	0.8			0			1.6			0.52			0.27786			0.93		
09/06/22 4:00	0.7			0			1.6			0.52			0.27828			0.93		
09/06/22 5:00	0.8			0			1.6			0.52			0.27822			0.93		
09/06/22 6:00	1			0			1.6			0.51			0.276			0.92		
09/06/22 7:00	1.2			0			1.6			0.49			0.26094			0.87		
09/06/22 8:00	0.8			0			1.6			0.5			0.2718			0.91		
09/06/22 9:00	1			1			1.6			0.57			0.30228			1.01		
09/06/22 10:00	0.9			1			1.6			0.67			0.34908			1.16		
09/06/22 11:00	0.7			2			1.6			0.76			0.39072			1.3		
09/06/22 12:00	0.6			2			1.6			0.76			0.39084			1.3		
09/06/22 13:00	0.6			2			1.6			0.76			0.3915			1.31		
09/06/22 14:00	0.7			2			1.6			0.76			0.38898			1.3		
09/06/22 15:00	0.7			2			1.6			0.76			0.3885			1.3		
09/06/22 16:00	0.7			2			1.6			0.76			0.38976			1.3		

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/06/22 17:00	0.7			2			1.6			0.76			0.3897			1.3		
09/06/22 18:00	0.7			2			1.6			0.76			0.38952			1.3		
09/06/22 19:00	0.7			2			1.6			0.76			0.39156			1.31		
09/06/22 20:00	0.7			2			1.6			0.75			0.39018			1.3		
09/06/22 21:00	0.7			2			1.6			0.75			0.38802			1.29		
09/06/22 22:00	0.9			1			1.6			0.66			0.34542			1.15		
09/06/22 23:00	0.9			1			1.6			0.66			0.34494			1.15		
09/07/22 0:00	1.2			0			1.6			0.55			0.29466			0.98		
09/07/22 1:00	0.8			0			1.6			0.53			0.28482			0.95		
09/07/22 2:00	0.7			0			1.6			0.53			0.28452			0.95		
09/07/22 3:00	0.8			0			1.6			0.53			0.28458			0.95		
09/07/22 4:00	0.8			0			1.6			0.54			0.28506			0.95		
09/07/22 5:00	0.7			0			1.6			0.54			0.28632			0.95		
09/07/22 6:00	0.8			0			1.6			0.52			0.27768			0.93		
09/07/22 7:00	0.8			0			1.6			0.46			0.24852			0.83		
09/07/22 8:00	0.7			0			1.6			0.51			0.27012			0.9		
09/07/22 9:00	0.9			1			1.7			0.72			0.37416			1.25		
09/07/22 10:00	0.7			2			1.7			0.74			0.38556			1.29		
09/07/22 11:00	0.7			2			1.7			0.75			0.38682			1.29		
09/07/22 12:00	0.7			2			1.7			0.75			0.38832			1.29		
09/07/22 13:00	0.7			2			1.7			0.75			0.38964			1.3		
09/07/22 14:00	0.7			2			1.7			0.76			0.39036			1.3		
09/07/22 15:00	0.7			2			1.7			0.76			0.39114			1.3		
09/07/22 16:00	0.7			2			1.7			0.76			0.39102			1.3		
09/07/22 17:00	0.7			2			1.7			0.76			0.39132			1.3		
09/07/22 18:00	0.7			2			1.7			0.75			0.39126			1.3		
09/07/22 19:00	0.7			2			1.7			0.74			0.3849			1.28		
09/07/22 20:00	0.7			2			1.7			0.75			0.38904			1.3		
09/07/22 21:00	0.7			2			1.7			0.74			0.38592			1.29		
09/07/22 22:00	0.8			1			1.7			0.71			0.37152			1.24		
09/07/22 23:00	0.9			1			1.7			0.69			0.36444			1.21		
09/08/22 0:00	0.9			1			1.6			0.69			0.36198			1.21		
09/08/22 1:00	1			0			1.6			0.54			0.2874			0.96		
09/08/22 2:00	0.8			0			1.6			0.54			0.28746			0.96		
09/08/22 3:00	0.8			0			1.6			0.54			0.28836			0.96		
09/08/22 4:00	0.9			0			1.6			0.54			0.28872			0.96		
09/08/22 5:00	1.1			0			1.6			0.54			0.28962			0.97		

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/08/22 6:00	0.9			0			1.6			0.53			0.28458			0.95		
09/08/22 7:00	0.9			0			1.6			0.51			0.27654			0.92		
09/08/22 8:00	1			0			1.6			0.53			0.28278			0.94		
09/08/22 9:00	0.8			2			1.7			0.74			0.38622			1.29		
09/08/22 10:00	0.7			2			1.6			0.75			0.38898			1.3		
09/08/22 11:00	0.7			2			1.6			0.76			0.3903			1.3		
09/08/22 12:00	0.7			2			1.6			0.76			0.39012			1.3		
09/08/22 13:00	0.7			2			1.6			0.76			0.39156			1.31		
09/08/22 14:00	0.7			2			1.6			0.76			0.39168			1.31		
09/08/22 15:00	0.7			2			1.6			0.76			0.39174			1.31		
09/08/22 16:00	0.7			2			1.6			0.76			0.3912			1.3		
09/08/22 17:00	0.7			2			1.6			0.76			0.39198			1.31		
09/08/22 18:00	0.7			2			1.6			0.76			0.39126			1.3		
09/08/22 19:00	0.7			2			1.6			0.76			0.39276			1.31		
09/08/22 20:00	0.7			2			1.6			0.77			0.39804			1.33		
09/08/22 21:00	0.7			2			1.6			0.77			0.40104			1.34		
09/08/22 22:00	0.8			2			1.6			0.74			0.38376			1.28		
09/08/22 23:00	0.9			1			1.6			0.71			0.37002			1.23		
09/09/22 0:00	0.8			1			1.6			0.71			0.37176			1.24		
09/09/22 1:00	0.9			1			1.6			0.67			0.35436			1.18		
09/09/22 2:00	1			1			1.4			0.67			0.35004			1.17		
09/09/22 3:00	1.1			0			1.5			0.65			0.33966			1.13		
09/09/22 4:00	1.1			1			1.6			0.68			0.35724			1.19		
09/09/22 5:00	0.9			2			1.6			0.75			0.3912			1.3		
09/09/22 6:00	1			1			1.6			0.72			0.37644			1.25		
09/09/22 7:00	1.1			1			1.6			0.71			0.37032			1.23		
09/09/22 8:00	1.1			1			1.6			0.69			0.35856			1.2		
09/09/22 9:00	1.1			1			1.6			0.66			0.34458			1.15		
09/09/22 10:00	1			1			1.6			0.72			0.3747			1.25		
09/09/22 11:00	1.1			1			1.6			0.65			0.339			1.13		
09/09/22 12:00	1			1			1.6			0.71			0.36882			1.23		
09/09/22 13:00	0.9			2			1.6			0.74			0.38292			1.28		
09/09/22 14:00	0.9			1			1.6			0.71			0.36864			1.23		
09/09/22 15:00	1			1			1.6			0.7			0.36276			1.21		
09/09/22 16:00	1.2			1			1.6			0.65			0.3399			1.13		
09/09/22 17:00	1.2			1			1.6			0.68			0.35214			1.17		
09/09/22 18:00	1.2			1			1.6			0.65			0.33846			1.13		

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/09/22 19:00	1.2			1			1.6			0.61			0.32214			1.07		
09/09/22 20:00	1.1			0			1.6			0.53			0.28374			0.95		
09/09/22 21:00	0.8			0			1.6			0.5			0.26766			0.89		
09/09/22 22:00	0.9			0			1.5			0.45			0.23886			0.8		
09/09/22 23:00	0.8			0			1.6			0.5			0.27072			0.9		
09/10/22 0:00	0.8			0			1.6			0.48			0.25842			0.86		
09/10/22 1:00	0.8			1			1.6			0.37			0.19548			0.65		
09/10/22 2:00	0.8			0			0.5			0.43			0.23238			0.77		
09/10/22 3:00	0.9			0			1.6			0.41			0.21906			0.73		
09/10/22 4:00	0.8			0			1.6			0.46			0.24966			0.83		
09/10/22 5:00	0.9			0			1.5			0.44			0.2367			0.79		
09/10/22 6:00	0.8			1			1.4			0.42			0.2229			0.74		
09/10/22 7:00	0.8			0			1.6			0.52			0.2766			0.92		
09/10/22 8:00	0.8			0			1.5			0.47			0.24882			0.83		
09/10/22 9:00	0.7			1			1.5			0.39			0.20958			0.7		
09/10/22 10:00	0.6			1			1.5			0.33			0.1773			0.59		
09/10/22 11:00	0.6			1			1.6			0.33			0.1761			0.59		
09/10/22 12:00	0.7			1			1.4			0.36			0.18972			0.63		
09/10/22 13:00	0.7			0			1.3			0.39			0.20898			0.7		
09/10/22 14:00	0.7			1			1.7			0.35			0.18792			0.63		
09/10/22 15:00	0.7			1			1.5			0.36			0.19218			0.64		
09/10/22 16:00	0.7			1			1.3			0.4			0.21552			0.72		
09/10/22 17:00	0.7			1			1.8			0.36			0.19134			0.64		
09/10/22 18:00	0.9			0			1.4			0.42			0.2274			0.76		
09/10/22 19:00	0.8			0			1.6			0.49			0.26202			0.87		
09/10/22 20:00	0.8			0			1.6			0.5			0.26772			0.89		
09/10/22 21:00	0.8			0			1.6			0.5			0.27096			0.9		
09/10/22 22:00	0.9			1			1.4			0.42			0.22362			0.75		
09/10/22 23:00	0.8			0			1.6			0.52			0.27726			0.92		
09/11/22 0:00	0.8			0			1.6			0.52			0.28194			0.94		
09/11/22 1:00	0.8			0			1.6			0.52			0.27828			0.93		
09/11/22 2:00	0.8			0			1.6			0.51			0.27516			0.92		
09/11/22 3:00	0.9			0			1.6			0.47			0.25224			0.84		
09/11/22 4:00	0.8			0			1.6			0.49			0.2628			0.88		
09/11/22 5:00	0.8			1			1.6			0.47			0.25518			0.85		
09/11/22 6:00	0.8			0			1.4			0.42			0.22392			0.75		
09/11/22 7:00	0.7			1			1.5			0.37			0.19542			0.65		

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/11/22 8:00	0.7			1			1.5			0.34			0.183			0.61		
09/11/22 9:00	0.7			1			1.6			0.33			0.17808			0.59		
09/11/22 10:00	0.7			0			1.5			0.35			0.18366			0.61		
09/11/22 11:00	0.7			1			1.6			0.35			0.1851			0.62		
09/11/22 12:00	0.8			0			1.4			0.39			0.20928			0.7		
09/11/22 13:00	0.8			0			1.8			0.39			0.20748			0.69		
09/11/22 14:00	0.8			1			1.9			0.46			0.24492			0.82		
09/11/22 15:00	0.8			0			1.6			0.48			0.2568			0.86		
09/11/22 16:00	1.4			1			1.6			0.59			0.29928			1		
09/11/22 17:00	1.1			1			1.6			0.66			0.34362			1.15		
09/11/22 18:00	1.2			1			1.6			0.62			0.3258			1.09		
09/11/22 19:00	1.1			0			1.6			0.58			0.30804			1.03		
09/11/22 20:00	0.8			0			1.6			0.51			0.27468			0.92		
09/11/22 21:00	0.8			1			1.6			0.4			0.21168			0.71		
09/11/22 22:00	0.8			0			1.5			0.41			0.21798			0.73		
09/11/22 23:00	0.8			1			1.5			0.39			0.21114			0.7		
09/12/22 0:00	0.9			0			1.5			0.45			0.24186			0.81		
09/12/22 1:00	0.7			1			1.6			0.35			0.18768			0.63		
09/12/22 2:00	0.7			0			1.6			0.34			0.18402			0.61		
09/12/22 3:00	0.7			1			1.6			0.34			0.18312			0.61		
09/12/22 4:00	0.8			0			1.5			0.46			0.24594			0.82		
09/12/22 5:00	0.8			0			1.6			0.53			0.28704			0.96		
09/12/22 6:00	0.8			0			1.6			0.48			0.25692			0.86		
09/12/22 7:00	0.8			1			1.4			0.39			0.20658			0.69		
09/12/22 8:00	0.7			1			1.6			0.34			0.18396			0.61		
09/12/22 9:00	0.7			1			1.6			0.35			0.18402			0.61		
09/12/22 10:00	0.8			1			1.5			0.35			0.18708			0.62		
09/12/22 11:00	0.8			0			1.5			0.45			0.23772			0.79		
09/12/22 12:00	0.8			0			1.6			0.53			0.28182			0.94		
09/12/22 13:00	0.9			0			1.6			0.46			0.24486			0.82		
09/12/22 14:00	0.8			0			1.6			0.46			0.24564			0.82		
09/12/22 15:00	0.9			1			1.5			0.46			0.24552			0.82		
09/12/22 16:00	0.9			0			1.5			0.48			0.2544			0.85		
09/12/22 17:00	0.8			0			1.6			0.53			0.28134			0.94		
09/12/22 18:00	0.8			0			1.6			0.52			0.27756			0.93		
09/12/22 19:00	0.8			0			1.6			0.52			0.28014			0.93		
09/12/22 20:00	0.8			0			1.6			0.53			0.28482			0.95		

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/12/22 21:00	0.8			0			1.6			0.52			0.28176			0.94		
09/12/22 22:00	0.8			1			1.6			0.42			0.22584			0.75		
09/12/22 23:00	0.8			0			1.5			0.47			0.25398			0.85		
09/13/22 0:00	0.8			0			1.6			0.47			0.25452			0.85		
09/13/22 1:00	0.8			1			1.5			0.39			0.20988			0.7		
09/13/22 2:00	0.7			1			1.2			0.36			0.1908			0.64		
09/13/22 3:00	1.6			0			1.5			0.47			0.25428			0.85		
09/13/22 4:00	1.4			1			1.6			0.59			0.31704			1.06		
09/13/22 5:00	1.3			1			1.6			0.61			0.32364			1.08		
09/13/22 6:00	1.1			0			1.6			0.54			0.29184			0.97		
09/13/22 7:00	0.8			1			1.6			0.44			0.2349			0.78		
09/13/22 8:00	0.7			1			1.5			0.37			0.19626			0.65		
09/13/22 9:00	0.7			1			1.6			0.34			0.18234			0.61		
09/13/22 10:00	0.7			0			1.6			0.35			0.18804			0.63		
09/13/22 11:00	0.7			1			1.6			0.35			0.18816			0.63		
09/13/22 12:00	0.7			1			1.6			0.34			0.18036			0.6		
09/13/22 13:00	0.6			1			1.6			0.34			0.17928			0.6		
09/13/22 14:00	0.7			1			1.6			0.34			0.18246			0.61		
09/13/22 15:00	0.6			1			1.6			0.34			0.17982			0.6		
09/13/22 16:00	0.7			0			1.5			0.42			0.22422			0.75		
09/13/22 17:00	1.3			0			1.6			0.6			0.31644			1.05		
09/13/22 18:00	1.5			1			1.6			0.58			0.3117			1.04		
09/13/22 19:00	1.4			1			1.6			0.59			0.3126			1.04		
09/13/22 20:00	1.4			1			1.6			0.58			0.31032			1.03		
09/13/22 21:00	1.3			0			1.6			0.56			0.30186			1.01		
09/13/22 22:00	0.7			1			1.6			0.36			0.19416			0.65		
09/13/22 23:00	0.9			0			1.5			0.44			0.23544			0.78		
09/14/22 0:00	0.9			1			1.6			0.4			0.21474			0.72		
09/14/22 1:00	0.8			1			1.6			0.38			0.20256			0.68		
09/14/22 2:00	0.8			0			1.6			0.38			0.2052			0.68		
09/14/22 3:00	0.8			1			1.6			0.45			0.24066			0.8		
09/14/22 4:00	0.8			0			1.5			0.48			0.26118			0.87		
09/14/22 5:00	0.8			0			1.6			0.52			0.28284			0.94		
09/14/22 6:00	0.8			1			1.6			0.42			0.22788			0.76		
09/14/22 7:00	0.6			1			1.6			0.34			0.18162			0.61		
09/14/22 8:00	0.6			1			1.6			0.33			0.17808			0.59		
09/14/22 9:00	0.6			1			1.6			0.33			0.17676			0.59		

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/14/22 10:00	0.6			1			1.6			0.33			0.17874			0.6		
09/14/22 11:00	0.6			1			1.6			0.34			0.17886			0.6		
09/14/22 12:00	0.6			1			1.6			0.34			0.1785			0.6		
09/14/22 13:00	0.6			1			1.6			0.33			0.17844			0.59		
09/14/22 14:00	0.6			1			1.6			0.33			0.1785			0.6		
09/14/22 15:00	0.6			1			1.6			0.33			0.17808			0.59		
09/14/22 16:00	0.7			1			1.6			0.34			0.18204			0.61		
09/14/22 17:00	0.7			0			1.5			0.38			0.20148			0.67		
09/14/22 18:00	0.8			0			1.5			0.42			0.22338			0.74		
09/14/22 19:00	0.8			1			1.5			0.42			0.225			0.75		
09/14/22 20:00	0.8			1			1.5			0.41			0.22254			0.74		
09/14/22 21:00	0.8			1			1.5			0.42			0.22518			0.75		
09/14/22 22:00	0.7			1			1.6			0.35			0.18582			0.62		
09/14/22 23:00	0.7			1			1.6			0.36			0.19602			0.65		
09/15/22 0:00	0.7			1			1.6			0.35			0.18576			0.62		
09/15/22 1:00	0.7			0			1.4			0.36			0.19332			0.64		
09/15/22 2:00	0.7			1			1.7			0.36			0.19554			0.65		
09/15/22 3:00	0.9			0			1.5			0.4			0.21678			0.72		
09/15/22 4:00	0.8			0			1.5			0.46			0.24558			0.82		
09/15/22 5:00	0.8			0			1.6			0.5			0.27228			0.91		
09/15/22 6:00	0.8			1			1.6			0.41			0.21942			0.73		
09/15/22 7:00	0.8			0			1.5			0.38			0.20562			0.69		
09/15/22 8:00	0.6			1			1.6			0.34			0.17994			0.6		
09/15/22 9:00	0.6			1			1.6			0.34			0.17982			0.6		
09/15/22 10:00	1.2			0			1.4			0.49			0.26136			0.87		
09/15/22 11:00	1.5			0			1.6			0.59			0.30966			1.03		
09/15/22 12:00	0.8			1			1.6			0.4			0.21276			0.71		
09/15/22 13:00	0.7			1			1.6			0.34			0.18018			0.6		
09/15/22 14:00	0.8			0			1.5			0.37			0.19944			0.66		
09/15/22 15:00	0.7			1			1.6			0.34			0.1836			0.61		
09/15/22 16:00	0.7			1			1.6			0.34			0.18348			0.61		
09/15/22 17:00	0.8			0			1.4			0.41			0.2202			0.73		
09/15/22 18:00	0.7			1			1.6			0.36			0.19152			0.64		
09/15/22 19:00	0.7			1			1.5			0.38			0.20262			0.68		
09/15/22 20:00	0.7			1			1.5			0.37			0.1965			0.66		
09/15/22 21:00	0.8			1			1.5			0.37			0.2004			0.67		
09/15/22 22:00	0.7			1			1.5			0.35			0.18948			0.63		

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/15/22 23:00	0.7			1			1.6			0.35			0.18558			0.62		
09/16/22 0:00	0.7			1			1.6			0.34			0.18402			0.61		
09/16/22 1:00	0.6			1			1.6			0.33			0.17748			0.59		
09/16/22 2:00	0.6			1			1.7			0.33			0.17754			0.59		
09/16/22 3:00	0.7			1			1.6			0.33			0.17832			0.59		
09/16/22 4:00	0.7			1			1.6			0.35			0.1857			0.62		
09/16/22 5:00	0.8			0			1.5			0.42			0.22446			0.75		
09/16/22 6:00	0.8			1			1.6			0.39			0.20934			0.7		
09/16/22 7:00	0.6			2			1.6			0.33			0.17748			0.59		
09/16/22 8:00	0.6			1			1.6			0.33			0.1791			0.6		
09/16/22 9:00	0.6			1			1.6			0.33			0.17676			0.59		
09/16/22 10:00	0.6			1			1.6			0.33			0.17658			0.59		
09/16/22 11:00	0.6			1			1.6			0.33			0.1773			0.59		
09/16/22 12:00	0.6			1			1.6			0.33			0.17568			0.59		
09/16/22 13:00	0.6			1			1.6			0.33			0.17598			0.59		
09/16/22 14:00	0.7			0			1.4			0.36			0.1917			0.64		
09/16/22 15:00	0.6			1			1.5			0.34			0.17874			0.6		
09/16/22 16:00	0.6			1			1.5			0.33			0.1773			0.59		
09/16/22 17:00	0.7			1			1.6			0.34			0.18294			0.61		
09/16/22 18:00	0.7			1			1.6			0.34			0.18372			0.61		
09/16/22 19:00	0.7			1			1.6			0.34			0.18372			0.61		
09/16/22 20:00	0.7			1			1.6			0.34			0.18396			0.61		
09/16/22 21:00	0.7			1			1.6			0.34			0.18396			0.61		
09/16/22 22:00	0.7			1			1.6			0.34			0.18114			0.6		
09/16/22 23:00	0.7			1			1.6			0.34			0.18408			0.61		
09/17/22 0:00	0.7			1			1.6			0.34			0.18474			0.62		
09/17/22 1:00	0.7			1			1.6			0.34			0.18528			0.62		
09/17/22 2:00	0.7			1			1.6			0.34			0.18522			0.62		
09/17/22 3:00	0.7			1			1.6			0.34			0.18528			0.62		
09/17/22 4:00	0.7			1			1.5			0.35			0.1905			0.64		
09/17/22 5:00	0.7			1			1.6			0.34			0.1854			0.62		
09/17/22 6:00	0.7			1			1.6			0.33			0.17718			0.59		
09/17/22 7:00	0.7			1			1.6			0.33			0.17724			0.59		
09/17/22 8:00	0.6			1			1.6			0.33			0.17706			0.59		
09/17/22 9:00	0.6			1			1.6			0.33			0.17682			0.59		
09/17/22 10:00	0.7			1			1.6			0.33			0.17664			0.59		
09/17/22 11:00	0.6			1			1.6			0.33			0.17652			0.59		

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/17/22 12:00	0.6			1			1.6			0.33			0.17628			0.59		
09/17/22 13:00	0.6			1			1.6			0.33			0.17544			0.58		
09/17/22 14:00	0.6			1			1.6			0.33			0.1755			0.59		
09/17/22 15:00	0.6			1			1.6			0.33			0.17538			0.58		
09/17/22 16:00	0.7			1			1.5			0.35			0.18474			0.62		
09/17/22 17:00	0.8			1			1.5			0.37			0.20046			0.67		
09/17/22 18:00	0.7			1			1.6			0.34			0.18468			0.62		
09/17/22 19:00	0.6			1			1.6			0.33			0.17832			0.59		
09/17/22 20:00	0.7			1			1.6			0.34			0.18012			0.6		
09/17/22 21:00	0.8			1			1.5			0.37			0.19632			0.65		
09/17/22 22:00	0.7			1			1.5			0.36			0.19512			0.65		
09/17/22 23:00	0.7			1			1.6			0.34			0.18498			0.62		
09/18/22 0:00	0.7			1			1.6			0.34			0.1848			0.62		
09/18/22 1:00	0.7			1			1.6			0.35			0.1851			0.62		
09/18/22 2:00	0.7			1			1.6			0.35			0.18534			0.62		
09/18/22 3:00	0.7			1			1.6			0.34			0.18528			0.62		
09/18/22 4:00	0.7			1			1.6			0.34			0.1809			0.6		
09/18/22 5:00	0.7			1			1.6			0.33			0.1773			0.59		
09/18/22 6:00	0.7			1			1.6			0.34			0.18576			0.62		
09/18/22 7:00	0.7			1			1.6			0.35			0.1872			0.62		
09/18/22 8:00	0.7			1			1.7			0.34			0.1845			0.62		
09/18/22 9:00	0.7			1			1.7			0.34			0.18408			0.61		
09/18/22 10:00	0.7			1			1.6			0.34			0.18192			0.61		
09/18/22 11:00	0.7			1			1.5			0.36			0.19098			0.64		
09/18/22 12:00	0.8			0			1.4			0.39			0.21054			0.7		
09/18/22 13:00	0.8			0			1.5			0.44			0.23556			0.79		
09/18/22 14:00	0.8			1			1.5			0.38			0.20112			0.67		
09/18/22 15:00	0.7			1			1.6			0.36			0.19278			0.64		
09/18/22 16:00	0.7			0			1.5			0.43			0.23124			0.77		
09/18/22 17:00	0.8			0			1.7			0.49			0.2649			0.88		
09/18/22 18:00	0.8			0			1.7			0.48			0.25854			0.86		
09/18/22 19:00	0.8			0			1.7			0.5			0.26886			0.9		
09/18/22 20:00	0.8			0			1.7			0.51			0.2754			0.92		
09/18/22 21:00	0.8			1			1.7			0.5			0.26886			0.9		
09/18/22 22:00	0.6			1			1.6			0.34			0.18132			0.6		
09/18/22 23:00	0.7			1			1.6			0.34			0.18486			0.62		
09/19/22 0:00	0.7			1			1.7			0.35			0.18564			0.62		

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/19/22 1:00	0.7			1			1.7			0.35			0.18588			0.62		
09/19/22 2:00	0.7			1			1.6			0.35			0.18588			0.62		
09/19/22 3:00	0.7			1			1.5			0.35			0.18576			0.62		
09/19/22 4:00	0.8			0			1.4			0.41			0.22194			0.74		
09/19/22 5:00	0.8			0			1.6			0.51			0.27414			0.91		
09/19/22 6:00	0.8			0			1.7			0.48			0.2571			0.86		
09/19/22 7:00	0.8			0			1.7			0.51			0.27408			0.91		
09/19/22 8:00	0.7			0			1.6			0.55			0.29508			0.98		
09/19/22 9:00	0.7			1			1.6			0.42			0.22368			0.75		
09/19/22 10:00	0.6			1			1.6			0.35			0.18504			0.62		
09/19/22 11:00	0.7			0			1.5			0.38			0.20214			0.67		
09/19/22 12:00	0.7			1			1.6			0.36			0.19338			0.64		
09/19/22 13:00	0.7			1			1.6			0.37			0.19728			0.66		
09/19/22 14:00	0.7			1			1.5			0.36			0.1917			0.64		
09/19/22 15:00	0.6			1			1.7			0.35			0.18516			0.62		
09/19/22 16:00	1.2			0			1.5			0.49			0.2577			0.86		
09/19/22 17:00	1.6			1			1.6			0.71			0.37224			1.24		
09/19/22 18:00	1.7			1			1.6			0.67			0.3528			1.18		
09/19/22 19:00	1.5			1			1.6			0.65			0.33978			1.13		
09/19/22 20:00	1.4			1			1.6			0.63			0.33132			1.1		
09/19/22 21:00	1.4			1			1.6			0.6			0.31932			1.06		
09/19/22 22:00	1.3			1			1.5			0.49			0.25782			0.86		
09/19/22 23:00	0.8			0			1.5			0.47			0.25662			0.86		
09/20/22 0:00	0.8			0			1.6			0.46			0.2484			0.83		
09/20/22 1:00	0.7			1			1.5			0.39			0.21			0.7		
09/20/22 2:00	0.6			0			1.6			0.37			0.19656			0.66		
09/20/22 3:00	0.8			0			1.6			0.51			0.2733			0.91		
09/20/22 4:00	1			0			1.6			0.55			0.29778			0.99		
09/20/22 5:00	0.7			0			1.6			0.54			0.2943			0.98		
09/20/22 6:00	0.8			1			1.6			0.42			0.2274			0.76		
09/20/22 7:00	0.6			1			1.6			0.35			0.189			0.63		
09/20/22 8:00	0.6			1			1.6			0.36			0.1917			0.64		
09/20/22 9:00	0.6			1			1.6			0.35			0.18834			0.63		
09/20/22 10:00	0.6			1			1.7			0.33			0.1773			0.59		
09/20/22 11:00	0.7			0			1.4			0.41			0.21972			0.73		
09/20/22 12:00	0.7			1			1.6			0.36			0.19092			0.64		
09/20/22 13:00	0.7			1			1.7			0.35			0.18762			0.63		

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/20/22 14:00	0.7			1			1.6			0.35			0.18564			0.62		
09/20/22 15:00	0.6			1			1.6			0.34			0.18204			0.61		
09/20/22 16:00	1			0			1.5			0.46			0.2478			0.83		
09/20/22 17:00	1.4			1			1.7			0.7			0.36192			1.21		
09/20/22 18:00	1.4			1			1.6			0.71			0.36432			1.21		
09/20/22 19:00	1.5			1			1.6			0.67			0.3462			1.15		
09/20/22 20:00	1.5			1			1.6			0.68			0.35262			1.18		
09/20/22 21:00	2.9			1			1.6			0.67			0.34998			1.17		
09/20/22 22:00	2.4			1			1.6			0.63			0.32682			1.09		
09/20/22 23:00	1.1			0			1.6			0.53			0.28656			0.96		
09/21/22 0:00	1.1			0			1.6			0.53			0.28398			0.95		
09/21/22 1:00	0.9			1			1.6			0.47			0.25398			0.85		
09/21/22 2:00	0.9			0			1.6			0.48			0.25692			0.86		
09/21/22 3:00	0.8			0			1.6			0.56			0.29832			0.99		
09/21/22 4:00	0.8			0			1.6			0.56			0.29868			1		
09/21/22 5:00	0.8			0			1.6			0.55			0.29544			0.98		
09/21/22 6:00	0.8			1			1.5			0.46			0.24582			0.82		
09/21/22 7:00	0.8			0			1.6			0.54			0.29076			0.97		
09/21/22 8:00	0.8			0			1.6			0.52			0.28254			0.94		
09/21/22 9:00	0.8			0			1.6			0.51			0.2748			0.92		
09/21/22 10:00	0.8			1			1.4			0.4			0.21546			0.72		
09/21/22 11:00	0.8			0			1.6			0.49			0.26388			0.88		
09/21/22 12:00	0.7			1			1.5			0.35			0.18906			0.63		
09/21/22 13:00	0.7			1			1.5			0.35			0.18522			0.62		
09/21/22 14:00	0.8			0			1.4			0.47			0.2523			0.84		
09/21/22 15:00	0.7			1			1.6			0.34			0.1836			0.61		
09/21/22 16:00	0.7			0			1.5			0.42			0.22248			0.74		
09/21/22 17:00	0.7			0			1.6			0.49			0.2658			0.89		
09/21/22 18:00	0.8			0			1.6			0.45			0.24336			0.81		
09/21/22 19:00	0.8			1			1.5			0.41			0.22092			0.74		
09/21/22 20:00	0.8			1			1.5			0.39			0.20934			0.7		
09/21/22 21:00	0.7			1			1.6			0.34			0.18492			0.62		
09/21/22 22:00	0.7			1			1.6			0.34			0.18162			0.61		
09/21/22 23:00	0.7			1			1.6			0.35			0.186			0.62		
09/22/22 0:00	0.7			1			1.6			0.35			0.18642			0.62		
09/22/22 1:00	0.6			1			1.6			0.35			0.18666			0.62		
09/22/22 2:00	0.7			1			1.6			0.35			0.18648			0.62		

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/22/22 3:00	0.7			1			1.6			0.35			0.18636			0.62		
09/22/22 4:00	0.8			0			1.5			0.39			0.21042			0.7		
09/22/22 5:00	0.9			0			1.6			0.43			0.2334			0.78		
09/22/22 6:00	0.9			1			1.4			0.4			0.21564			0.72		
09/22/22 7:00	0.9			0			1.7			0.45			0.24288			0.81		
09/22/22 8:00	0.9			0			1.6			0.44			0.24012			0.8		
09/22/22 9:00	0.9			0			1.7			0.44			0.23988			0.8		
09/22/22 10:00	0	X		0	X		0	X		0.44			0.2391			0.8		
09/22/22 11:00	0.7			0			1.7			0.44			0.23826			0.79		
09/22/22 12:00	0.7			0			1.7			0.44			0.23802			0.79		
09/22/22 13:00	0.6			1			1.6			0.41			0.21666			0.72		
09/22/22 14:00	0.4			1			1.6			0.34			0.1791			0.6		
09/22/22 15:00	0.4			1			1.7			0.33			0.17808			0.59		
09/22/22 16:00	0.5			0			1.5			0.37			0.19986			0.67		
09/22/22 17:00	0.5			1			1.6			0.35			0.18606			0.62		
09/22/22 18:00	0.5			1			1.6			0.35			0.18702			0.62		
09/22/22 19:00	0.6			0			1.4			0.39			0.2079			0.69		
09/22/22 20:00	0.6			0			1.4			0.42			0.22704			0.76		
09/22/22 21:00	0.7			1			1.5			0.42			0.2361			0.79		
09/22/22 22:00	0.6			0			1.5			0	X		0.26058			0.87		
09/22/22 23:00	0			0	X		0			0	X		0.06822			0.23		
09/23/22 0:00	0	X		0	X		0	X		0	X		0	X		0	X	
09/23/22 1:00	0	X		0	X		0	X		0	X		0	X		0	X	
09/23/22 2:00	0	X		0	X		0	X		0	X		0	X		0	X	
09/23/22 3:00	0	X		0	X		0	X		0	X		0	X		0	X	
09/23/22 4:00	0	X		0	X		0	X		0	X		0	X		0	X	
09/23/22 5:00	0	X		0	X		0	X		0	X		0	X		0	X	
09/23/22 6:00	0	X		0	X		0	X		0	X		0	X		0	X	
09/23/22 7:00	0	X		0	X		0	X		0	X		0	X		0	X	
09/23/22 8:00	0	X		0	X		0	X		0	X		0	X		0	X	
09/23/22 9:00	0	X		0	X		0	X		0	X		0	X		0	X	
09/23/22 10:00	0	X		0	X		0	X		0	X		0	X		0	X	
09/23/22 11:00	0	X		0	X		0	X		0	X		0	X		0	X	
09/23/22 12:00	0	X		0	X		0	X		0.26			0	X		0	X	
09/23/22 13:00	0	X		0	X		0	X		0.44			0	X		0	X	
09/23/22 14:00	0	X		0	X		0	X		0.39			0	X		0	X	
09/23/22 15:00	0			0	X		0			0.53			0.08556			0.29		

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/23/22 16:00	0.6			1			1.8			0.46			0.24636			0.82		
09/23/22 17:00	2.4			0			1.7			0.6			0.31848			1.06		
09/23/22 18:00	1.9			0			1.6			0.6			0.31494			1.05		
09/23/22 19:00	1.7			0			1.6			0.59			0.31368			1.05		
09/23/22 20:00	2.6			1			1.6			0.62			0.32202			1.07		
09/23/22 21:00	3			1			1.6			0.64			0.32784			1.09		
09/23/22 22:00	1.2			0			1.6			0.5			0.2604			0.87		
09/23/22 23:00	0.9			0			1.6			0.48			0.2592			0.86		
09/24/22 0:00	0.7			1			1.6			0.41			0.22104			0.74		
09/24/22 1:00	0.7			0			1.5			0.39			0.2079			0.69		
09/24/22 2:00	0.8			0			1.6			0.45			0.24222			0.81		
09/24/22 3:00	0.8			0			1.6			0.48			0.2598			0.87		
09/24/22 4:00	0.9			0			1.6			0.51			0.27396			0.91		
09/24/22 5:00	0.9			0			1.5			0.48			0.25962			0.87		
09/24/22 6:00	0.7			2			1.6			0.35			0.19032			0.63		
09/24/22 7:00	0.6			1			1.6			0.33			0.17772			0.59		
09/24/22 8:00	0.5			1			1.6			0.33			0.17742			0.59		
09/24/22 9:00	0.5			1			1.6			0.33			0.17712			0.59		
09/24/22 10:00	0.4			1			1.6			0.33			0.17688			0.59		
09/24/22 11:00	0.4			1			1.6			0.33			0.17652			0.59		
09/24/22 12:00	0.4			1			1.5			0.34			0.18072			0.6		
09/24/22 13:00	0.5			0			1.5			0.35			0.18552			0.62		
09/24/22 14:00	0.8			0			1.5			0.46			0.24522			0.82		
09/24/22 15:00	0.9			0			1.6			0.51			0.25926			0.86		
09/24/22 16:00	0.9			0			1.5			0.5			0.26346			0.88		
09/24/22 17:00	0.8			0			1.6			0.53			0.27528			0.92		
09/24/22 18:00	0.7			0			1.6			0.48			0.25458			0.85		
09/24/22 19:00	0.6			0			1.6			0.5			0.26838			0.89		
09/24/22 20:00	0.8			0			1.6			0.54			0.28752			0.96		
09/24/22 21:00	0.7			0			1.6			0.54			0.29016			0.97		
09/24/22 22:00	0.7			0			1.6			0.52			0.28116			0.94		
09/24/22 23:00	0.7			0			1.6			0.49			0.2619			0.87		
09/25/22 0:00	0.8			1			1.6			0.45			0.24036			0.8		
09/25/22 1:00	0.7			1			1.5			0.41			0.21858			0.73		
09/25/22 2:00	0.7			0			1.7			0.49			0.2631			0.88		
09/25/22 3:00	0.6			1			1.5			0.41			0.2211			0.74		
09/25/22 4:00	0.6			1			1.5			0.36			0.19146			0.64		

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/25/22 5:00	0.7			1			1.5			0.37			0.1968			0.66		
09/25/22 6:00	0.6			1			1.6			0.33			0.17874			0.6		
09/25/22 7:00	0.6			1			1.6			0.33			0.17712			0.59		
09/25/22 8:00	0.5			1			1.6			0.33			0.177			0.59		
09/25/22 9:00	0.5			1			1.6			0.33			0.17676			0.59		
09/25/22 10:00	0.5			1			1.6			0.33			0.17658			0.59		
09/25/22 11:00	0.4			1			1.6			0.33			0.1764			0.59		
09/25/22 12:00	0.4			1			1.6			0.33			0.17586			0.59		
09/25/22 13:00	0.5			0			1.5			0.34			0.18078			0.6		
09/25/22 14:00	0.5			0			1.4			0.36			0.19272			0.64		
09/25/22 15:00	0.5			1			1.4			0.39			0.20508			0.68		
09/25/22 16:00	0.8			0			1.5			0.48			0.25422			0.85		
09/25/22 17:00	0.6			0			1.6			0.52			0.27252			0.91		
09/25/22 18:00	0.6			0			1.6			0.5			0.2673			0.89		
09/25/22 19:00	0.6			0			1.6			0.48			0.25908			0.86		
09/25/22 20:00	0.6			0			1.5			0.49			0.26106			0.87		
09/25/22 21:00	0.6			1			1.6			0.45			0.24006			0.8		
09/25/22 22:00	0.5			1			1.6			0.34			0.18372			0.61		
09/25/22 23:00	0.5			1			1.6			0.35			0.18624			0.62		
09/26/22 0:00	0.5			1			1.6			0.36			0.1905			0.64		
09/26/22 1:00	0.5			1			1.6			0.35			0.18552			0.62		
09/26/22 2:00	0.5			1			1.8			0.35			0.18546			0.62		
09/26/22 3:00	0.5			1			1.6			0.35			0.18552			0.62		
09/26/22 4:00	0.6			0			1.5			0.42			0.22512			0.75		
09/26/22 5:00	0.6			0			1.5			0.41			0.22086			0.74		
09/26/22 6:00	0.5			1			1.6			0.34			0.18504			0.62		
09/26/22 7:00	0.4			1			1.6			0.33			0.17652			0.59		
09/26/22 8:00	0.4			1			1.6			0.33			0.17634			0.59		
09/26/22 9:00	0.4			1			1.6			0.33			0.17616			0.59		
09/26/22 10:00	0.4			1			1.6			0.33			0.17568			0.59		
09/26/22 11:00	0.4			1			1.6			0.33			0.17574			0.59		
09/26/22 12:00	0.5			0			1.6			0.34			0.1806			0.6		
09/26/22 13:00	0.5			0			1.6			0.35			0.18318			0.61		
09/26/22 14:00	0.6			0			1.5			0.37			0.1977			0.66		
09/26/22 15:00	0.6			1			1.3			0.41			0.2193			0.73		
09/26/22 16:00	0.6			0			1.4			0.43			0.22812			0.76		
09/26/22 17:00	0.6			0			1.4			0.43			0.23148			0.77		

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/26/22 18:00	0.5			1			1.8			0.35			0.18354			0.61		
09/26/22 19:00	0.5			1			1.6			0.34			0.18324			0.61		
09/26/22 20:00	0.6			1			1.6			0.35			0.18552			0.62		
09/26/22 21:00	0.6			0			1.4			0.4			0.2145			0.72		
09/26/22 22:00	0.6			0			1.5			0.42			0.2268			0.76		
09/26/22 23:00	2			0			1.6			0.61			0.32514			1.08		
09/27/22 0:00	2.3			1			1.6			0.63			0.33342			1.11		
09/27/22 1:00	2.1			1			1.6			0.61			0.32652			1.09		
09/27/22 2:00	1.9			1			1.5			0.61			0.32556			1.09		
09/27/22 3:00	1.6			1			1.6			0.6			0.31938			1.06		
09/27/22 4:00	2.4			1			1.6			0.63			0.33816			1.13		
09/27/22 5:00	3			1			1.6			0.66			0.34866			1.16		
09/27/22 6:00	1.7			1			1.6			0.6			0.318			1.06		
09/27/22 7:00	1			1			1.6			0.51			0.27348			0.91		
09/27/22 8:00	0.4			1			1.6			0.33			0.1764			0.59		
09/27/22 9:00	0.4			1			1.6			0.33			0.1764			0.59		
09/27/22 10:00	0.4			1			1.6			0.33			0.17784			0.59		
09/27/22 11:00	1			0			1.5			0.48			0.25524			0.85		
09/27/22 12:00	2.9			1			1.6			0.63			0.33156			1.11		
09/27/22 13:00	1.7			0			1.6			0.59			0.31224			1.04		
09/27/22 14:00	1.8			0			1.6			0.59			0.31242			1.04		
09/27/22 15:00	1.5			0			1.6			0.57			0.29874			1		
09/27/22 16:00	0.6			1			1.5			0.36			0.1917			0.64		
09/27/22 17:00	0.6			0			1.6			0.4			0.21288			0.71		
09/27/22 18:00	1.5			0			1.7			0.59			0.31176			1.04		
09/27/22 19:00	1.5			1			1.6			0.59			0.31182			1.04		
09/27/22 20:00	1.5			1			1.6			0.59			0.31134			1.04		
09/27/22 21:00	2			1			1.6			0.59			0.31632			1.05		
09/27/22 22:00	1.7			1			1.6			0.58			0.3126			1.04		
09/27/22 23:00	1			0			1.6			0.52			0.27822			0.93		
09/28/22 0:00	0.6			0			1.6			0.51			0.273			0.91		
09/28/22 1:00	0.6			0			1.6			0.5			0.27216			0.91		
09/28/22 2:00	0.7			0			1.5			0.51			0.27276			0.91		
09/28/22 3:00	0.7			0			1.6			0.51			0.27522			0.92		
09/28/22 4:00	0.7			0			1.6			0.52			0.27768			0.93		
09/28/22 5:00	0.6			0			1.6			0.52			0.27846			0.93		
09/28/22 6:00	0.7			1			1.6			0.5			0.26808			0.89		

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/28/22 7:00	0.5			2			1.6			0.33			0.1791			0.6		
09/28/22 8:00	0.4			1			1.6			0.33			0.17682			0.59		
09/28/22 9:00	0.4			1			1.6			0.33			0.17664			0.59		
09/28/22 10:00	0.5			1			1.6			0.33			0.17802			0.59		
09/28/22 11:00	0.5			0			1.5			0.34			0.1836			0.61		
09/28/22 12:00	0.5			1			1.6			0.34			0.18312			0.61		
09/28/22 13:00	0.5			1			1.6			0.34			0.1827			0.61		
09/28/22 14:00	0.6			0			1.4			0.4			0.21132			0.7		
09/28/22 15:00	0.5			1			1.2			0.34			0.18126			0.6		
09/28/22 16:00	0.4			1			1.6			0.33			0.17664			0.59		
09/28/22 17:00	0.4			1			1.6			0.33			0.1764			0.59		
09/28/22 18:00	0.5			1			1.6			0.34			0.18204			0.61		
09/28/22 19:00	0.5			1			1.6			0.34			0.18048			0.6		
09/28/22 20:00	0.6			1			1.6			0.35			0.1851			0.62		
09/28/22 21:00	0.6			0			1.4			0.42			0.22626			0.75		
09/28/22 22:00	0.7			0			1.5			0.45			0.2409			0.8		
09/28/22 23:00	0.6			0			1.5			0.48			0.26016			0.87		
09/29/22 0:00	0.6			1			1.4			0.44			0.2376			0.79		
09/29/22 1:00	0.6			1			1.4			0.37			0.20016			0.67		
09/29/22 2:00	0.6			1			2.2			0.36			0.19566			0.65		
09/29/22 3:00	0.7			0			1.5			0.39			0.2088			0.7		
09/29/22 4:00	0.6			0			1.5			0.44			0.23694			0.79		
09/29/22 5:00	0.6			0			1.5			0.48			0.26166			0.87		
09/29/22 6:00	0.7			1			1.6			0.45			0.24156			0.81		
09/29/22 7:00	0.8			0			1.4			0.47			0.25284			0.84		
09/29/22 8:00	0.6			1			1.6			0.36			0.19296			0.64		
09/29/22 9:00	0.5			1			1.6			0.34			0.1824			0.61		
09/29/22 10:00	0.4			1			1.6			0.33			0.17694			0.59		
09/29/22 11:00	0.5			1			1.6			0.33			0.17892			0.6		
09/29/22 12:00	0.5			1			1.6			0.34			0.1806			0.6		
09/29/22 13:00	0.6			0			1.4			0.37			0.19596			0.65		
09/29/22 14:00	0.5			0			1.6			0.35			0.18474			0.62		
09/29/22 15:00	0.5			1			1.5			0.35			0.18756			0.63		
09/29/22 16:00	1.2			1			1.3			0.47			0.24846			0.83		
09/29/22 17:00	2.3			0			1.5			0.6			0.3147			1.05		
09/29/22 18:00	2			1			1.6			0.6			0.31446			1.05		
09/29/22 19:00	1.9			1			1.6			0.59			0.31332			1.04		

	CT2_CO_Ppmvdc_1H			CT2_NH3Slip_Ppmvdc_1H			CT2_NOx_Ppmvdc_1H			CT1_PM10_LbPerHr_1H			CT2_SO2_LbPerHr_1H			CT2_VOC_LbPerHr_1H		
Date/Time	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod	Value	SI	Mod
09/29/22 20:00	1.3			1			1.6			0.51			0.27336			0.91		
09/29/22 21:00	0.7			1			1.5			0.35			0.18918			0.63		
09/29/22 22:00	0.6			1			1.5			0.36			0.19296			0.64		
09/29/22 23:00	0.7			0			1.5			0.49			0.26484			0.88		
09/30/22 0:00	0.8			0			1.6			0.47			0.25314			0.84		
09/30/22 1:00	0.8			0			1.6			0.46			0.24744			0.82		
09/30/22 2:00	0.8			0			1.4			0.45			0.24198			0.81		
09/30/22 3:00	0.8			1			1.3			0.43			0.23352			0.78		
09/30/22 4:00	0.9			0			1.6			0.5			0.26952			0.9		
09/30/22 5:00	0.8			0			1.5			0.54			0.29004			0.97		
09/30/22 6:00	0.9			1			1.5			0.46			0.24726			0.82		
09/30/22 7:00	0.7			1			1.5			0.33			0.17868			0.6		
09/30/22 8:00	0.6			1			1.5			0.33			0.17916			0.6		
09/30/22 9:00	0.5			1			1.5			0.33			0.17754			0.59		
09/30/22 10:00	0.5			1			1.5			0.33			0.17814			0.59		
09/30/22 11:00	0.4			1			1.5			0.33			0.17628			0.59		
09/30/22 12:00	0.4			1			1.5			0.33			0.1776			0.59		
09/30/22 13:00	0.4			1			1.5			0.33			0.17586			0.59		
09/30/22 14:00	0.4			1			1.5			0.33			0.17574			0.59		
09/30/22 15:00	0.4			1			1.5			0.33			0.17766			0.59		
09/30/22 16:00	0.6			0			1.3			0.43			0.23118			0.77		
09/30/22 17:00	0.6			0			1.5			0.48			0.25476			0.85		
09/30/22 18:00	0.5			1			1.4			0.35			0.18618			0.62		
09/30/22 19:00	0.6			1			1.5			0.35			0.18558			0.62		
09/30/22 20:00	0.7			0			1.4			0.37			0.1968			0.66		
09/30/22 21:00	0.7			0			1.4			0.44			0.23844			0.79		
09/30/22 22:00	0.6			1			1.5			0.35			0.18852			0.63		
09/30/22 23:00	0.7			0			1.4			0.5			0.26814			0.89		

ATTACHMENT 17

AQ-59

AQ-59 The Daily Emissions shall not exceed the following rates:

POLLUTANT	TWO TURBINES	AUX BOILER	COOLING TOWER	EMERGENCY DIESEL GENERATOR	DIESEL FIRE PUMP
NOX	406.0	16.8	-	4.31	1.72
CO	629.5	52.8	-	0.84	0.09
VOC	223.1	7.2	-	0.16	0.05
PM-10	226.8	14.4	16.3	0.14	0.03
SO2	47.1	1.92	-	0.10	0.19

Verification: The Project owner shall include all necessary emissions data to demonstrate compliance with the emissions limits provided in this Condition as part of the Quarterly Air Quality Report required in Condition of Certification AQ-SC6

Monthly Summary By Day Report

Unit CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:26 Location: Roseville, CA

Red = Invalid Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Limit Value:	Unit CT1 CO, Lb 1 Hour(s)	Unit CT1 NOx, Lb 1 Hour(s)	Unit CT1 SO2, Lb 1 Hour(s)	Unit CT1 PM10, Lb 1 Hour(s)	Unit CT1 VOC, Lb 1 Hour(s)
07/01/2022	15.25	46.57	5.4	10.13	16.90
07/02/2022	9.07	39.83	4.8	8.65	14.36
07/03/2022	8.89	39.70	4.8	8.63	14.34
07/04/2022	8.49	42.20	4.8	8.63	14.29
07/05/2022	13.73	47.23	5.3	10.16	16.94
07/06/2022	12.79	43.76	5.2	9.52	15.89
07/07/2022	14.67	47.90	5.6	10.54	17.52
07/08/2022	15.90	47.22	5.3	10.28	17.10
07/09/2022	10.51	41.85	4.9	8.97	14.90
07/10/2022	12.05	46.29	5.5	10.08	16.81
07/11/2022	16.31	58.84	6.5	12.76	21.25
07/12/2022	19.16	57.87	6.3	12.44	20.72
07/13/2022	17.16	59.65	6.2	11.84	19.71
07/14/2022	17.49	58.72	5.9	11.96	19.89
07/15/2022	18.30	64.56	6.4	12.85	21.49
07/16/2022	13.70	62.62	6.4	12.71	21.16
07/17/2022	14.81	69.02	6.7	14.12	23.52
07/18/2022	18.22	69.86	7.0	13.91	23.20
07/19/2022	14.83	59.36	6.0	11.77	19.62
07/20/2022	10.92	50.79	5.8	11.01	18.35
07/21/2022	13.32	49.62	5.6	10.30	17.23
07/22/2022	14.24	48.83	5.4	10.09	16.83
07/23/2022	19.35	52.93	5.6	10.93	18.20
07/24/2022	13.42	49.66	5.7	10.37	17.32
07/25/2022	13.89	49.72	5.6	10.77	17.97
07/26/2022	18.33	52.62	5.8	11.45	19.10
07/27/2022	14.12	53.83	5.8	10.93	18.18
07/28/2022	18.18	63.49	6.4	12.73	21.23
07/29/2022	18.97	59.61	6.2	12.11	20.15
07/30/2022	21.46	67.81	6.8	13.45	22.39
07/31/2022	20.94	62.42	6.4	12.68	21.15
Monthly Avg/Sum*:	468.47 *	1,664.38 *	180.1 *	346.77 *	577.71 *
Daily Min:	8.49	39.70	4.8	8.63	14.29
Daily Max:	21.46	69.86	7.0	14.12	23.52
Jul 2022 - Jul 2022	468.47	1,664.38	180.1	346.77	577.71
QTD:	468.47 *	1,664.38 *	180.1 *	346.77 *	577.71 *
YTD 2022:	3,625.55 *	6,001.37 *	641.7 *	1,231.20 *	2,053.41 *

Monthly Summary By Day Report

Unit CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:26 Location: Roseville, CA

Red = Invalid Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Limit Value:

	Unit CT1 CO, Lb 1 Hour(s)	Unit CT1 NOx, Lb 1 Hour(s)	Unit CT1 SO2, Lb 1 Hour(s)	Unit CT1 PM10, Lb 1 Hour(s)	Unit CT1 VOC, Lb 1 Hour(s)
08/01/2022	27.23	67.15	6.7	13.37	22.26
08/02/2022	18.53	60.40	6.3	12.20	20.36
08/03/2022	14.80	60.13	6.4	12.32	20.50
08/04/2022	20.37	70.00	7.1	14.29	23.83
08/05/2022	26.01	59.77	6.6	12.81	21.36
08/06/2022	9.91	42.31	5.1	8.79	14.68
08/07/2022	12.86	49.54	5.3	9.48	15.78
08/08/2022	18.14	58.66	6.0	11.93	19.88
08/09/2022	29.44	70.02	7.0	14.03	23.44
08/10/2022	17.34	64.59	6.4	12.46	20.74
08/11/2022	14.73	65.80	6.7	12.99	21.64
08/12/2022	16.14	61.62	6.4	12.42	20.68
08/13/2022	16.43	56.77	6.0	11.60	19.29
08/14/2022	17.89	56.28	5.7	11.29	18.83
08/15/2022	10.75	57.70	6.1	11.48	19.16
08/16/2022	12.05	65.74	6.7	13.43	22.37
08/17/2022	5.34	18.83	2.2	3.85	6.38
08/18/2022	0.00	0.00	0.0	0.00	0.00
08/19/2022	51.84	33.71	2.6	5.02	8.36
08/20/2022	5.93	27.36	3.1	5.40	9.01
08/21/2022	49.56	49.47	4.3	8.22	13.68
08/22/2022	3.90	14.87	1.6	3.04	5.08
08/23/2022	0.00	0.00	0.0	0.00	0.00
08/24/2022	0.00	0.00	0.0	0.00	0.00
08/25/2022	0.00	0.00	0.0	0.00	0.00
08/26/2022	50.97	64.33	5.6	10.93	18.21
08/27/2022	14.10	58.67	6.7	12.63	21.05
08/28/2022	11.04	49.93	5.4	10.01	16.69
08/29/2022	12.74	58.15	5.8	11.76	19.63
08/30/2022	11.66	67.47	7.3	13.80	22.98
08/31/2022	13.16	72.22	7.5	14.77	24.60
Monthly Avg/Sum*:	512.86 *	1,481.49 *	152.6 *	294.32 *	490.47 *
Daily Min:	3.90	14.87	1.6	3.04	5.08
Daily Max:	51.84	72.22	7.5	14.77	24.60
Jul 2022 - Aug 2022	981.33	3,145.87	332.7	641.09	1,068.18
QTD:	981.33 *	3,145.87 *	332.7 *	641.09 *	1,068.18 *
YTD 2022:	4,138.41 *	7,482.86 *	794.3 *	1,525.52 *	2,543.88 *

Monthly Summary By Day Report

Unit CT1



From: 07/01/2022 00:00 **To:** 09/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 10/01/2022 22:26 **Location:** Roseville, CA

Red = Invalid Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Limit Value:

	Unit CT1 CO, Lb 1 Hour(s)	Unit CT1 NOx, Lb 1 Hour(s)	Unit CT1 SO2, Lb 1 Hour(s)	Unit CT1 PM10, Lb 1 Hour(s)	Unit CT1 VOC, Lb 1 Hour(s)
09/01/2022	11.51	72.29	7.8	14.74	24.55
09/02/2022	14.70	75.89	7.4	15.44	25.80
09/03/2022	12.93	48.14	5.3	9.95	16.59
09/04/2022	13.75	52.38	5.7	10.75	17.95
09/05/2022	10.60	68.94	7.2	14.00	23.31
09/06/2022	11.27	77.44	8.2	15.72	26.16
09/07/2022	9.11	81.50	8.5	15.84	26.37
09/08/2022	10.00	81.63	8.7	16.28	27.06
09/09/2022	11.60	76.74	7.8	15.71	26.16
09/10/2022	13.13	48.44	5.1	10.12	16.85
09/11/2022	14.29	53.26	5.6	11.02	18.34
09/12/2022	13.66	51.95	5.5	10.73	17.88
09/13/2022	18.26	52.20	5.6	10.77	17.97
09/14/2022	10.50	44.47	4.9	9.13	15.26
09/15/2022	11.98	44.94	5.0	9.36	15.59
09/16/2022	8.39	40.03	4.8	8.21	13.70
09/17/2022	8.39	40.27	4.8	8.15	13.61
09/18/2022	10.89	45.99	5.0	9.28	15.44
09/19/2022	14.24	55.28	5.7	11.16	18.56
09/20/2022	13.41	56.83	5.9	11.49	19.15
09/21/2022	14.36	52.17	5.5	10.77	17.95
09/22/2022	37.46	44.00	4.4	8.65	14.43
09/23/2022	56.25	37.49	2.8	5.95	9.91
09/24/2022	15.15	51.17	5.4	10.48	17.46
09/25/2022	11.74	45.97	4.9	9.50	15.77
09/26/2022	10.79	43.91	4.9	9.03	15.05
09/27/2022	22.65	63.37	6.6	12.92	21.50
09/28/2022	10.03	47.19	5.4	9.69	16.15
09/29/2022	13.41	49.82	5.2	10.14	16.94
09/30/2022	11.31	44.20	4.9	9.55	15.93
Monthly Avg/Sum*:	445.76 *	1,647.90 *	174.5 *	334.53 *	557.39 *
Daily Min:	8.39	37.49	2.8	5.95	9.91
Daily Max:	56.25	81.63	8.7	16.28	27.06
Jul 2022 - Sep 2022	1,427.09	4,793.77	507.2	975.62	1,625.57
QTD:	1,427.09 *	4,793.77 *	507.2 *	975.62 *	1,625.57 *
YTD 2022:	4,584.17 *	9,130.76 *	968.8 *	1,860.05 *	3,101.27 *

Monthly Summary By Day Report

Unit CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:25 Location: Roseville, CA

Red = Invalid Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Limit Value:

	Unit CT2 CO, Lb 1 Hour(s)	Unit CT2 NOx, Lb 1 Hour(s)	Unit CT2 SO2, Lb 1 Hour(s)	Unit CT2 PM10, Lb 1 Hour(s)	Unit CT2 VOC, Lb 1 Hour(s)
07/01/2022	59.54	27.30	1.6	3.36	5.60
07/02/2022	0.00	0.00	0.0	0.00	0.00
07/03/2022	0.00	0.00	0.0	0.00	0.00
07/04/2022	0.00	0.00	0.0	0.00	0.00
07/05/2022	56.96	29.07	1.8	3.79	6.34
07/06/2022	46.97	24.02	1.4	2.88	4.78
07/07/2022	58.88	33.62	2.4	4.98	8.28
07/08/2022	34.79	17.78	1.0	1.89	3.14
07/09/2022	0.00	0.00	0.0	0.00	0.00
07/10/2022	24.67	30.54	2.5	4.80	8.04
07/11/2022	18.09	62.04	6.6	13.47	22.51
07/12/2022	20.85	61.22	6.5	13.16	21.92
07/13/2022	23.25	63.92	6.3	12.57	21.01
07/14/2022	49.75	39.77	3.1	6.61	11.02
07/15/2022	20.47	67.92	6.6	13.66	22.73
07/16/2022	16.01	66.59	6.9	13.45	22.39
07/17/2022	17.94	72.01	7.6	14.87	24.80
07/18/2022	21.42	73.02	7.4	14.66	24.45
07/19/2022	17.51	62.09	6.4	12.41	20.71
07/20/2022	13.65	53.90	6.1	11.65	19.42
07/21/2022	14.63	52.86	5.6	10.95	18.23
07/22/2022	35.76	51.30	5.3	10.44	17.42
07/23/2022	35.17	24.96	1.8	3.46	5.77
07/24/2022	48.37	46.82	4.2	7.92	13.20
07/25/2022	15.87	52.23	5.7	11.46	19.05
07/26/2022	19.69	55.56	6.0	12.13	20.23
07/27/2022	15.77	56.83	5.8	11.53	19.26
07/28/2022	21.85	65.36	6.6	13.50	22.49
07/29/2022	21.73	62.38	6.2	12.79	21.34
07/30/2022	24.44	71.82	7.0	14.21	23.68
07/31/2022	22.55	65.23	6.6	13.47	22.43
Monthly Avg/Sum*:	776.58 *	1,390.16 *	135.0 *	270.07 *	450.24 *
Daily Min:	13.65	17.78	1.0	1.89	3.14
Daily Max:	59.54	73.02	7.6	14.87	24.80
Jul 2022 - Jul 2022	776.58	1,390.16	135.0	270.07	450.24
QTD:	776.58 *	1,390.16 *	135.0 *	270.07 *	450.24 *
YTD 2022:	4,773.84 *	6,329.16 *	639.6 *	1,281.45 *	2,135.30 *

Monthly Summary By Day Report

Unit CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:25 Location: Roseville, CA

Red = Invalid Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Limit Value:

	Unit CT2 CO, Lb 1 Hour(s)	Unit CT2 NOx, Lb 1 Hour(s)	Unit CT2 SO2, Lb 1 Hour(s)	Unit CT2 PM10, Lb 1 Hour(s)	Unit CT2 VOC, Lb 1 Hour(s)
08/01/2022	30.07	71.72	6.8	14.16	23.57
08/02/2022	21.48	63.60	6.3	12.86	21.48
08/03/2022	17.29	58.35	6.4	12.93	21.58
08/04/2022	23.85	73.63	7.2	15.08	25.09
08/05/2022	26.51	62.60	6.6	13.57	22.67
08/06/2022	11.16	45.11	5.2	9.39	15.68
08/07/2022	12.95	52.33	5.3	10.06	16.80
08/08/2022	20.30	62.17	6.4	12.62	21.05
08/09/2022	30.09	75.45	7.3	14.89	24.88
08/10/2022	19.72	69.03	6.6	13.23	22.03
08/11/2022	18.40	69.57	7.4	13.76	22.95
08/12/2022	18.71	65.29	6.6	13.21	22.01
08/13/2022	17.88	60.27	6.3	12.33	20.54
08/14/2022	20.32	58.96	5.7	12.00	20.00
08/15/2022	14.64	60.85	6.2	12.16	20.24
08/16/2022	16.63	68.82	7.0	14.10	23.50
08/17/2022	20.45	66.50	7.0	13.44	22.42
08/18/2022	19.99	58.67	5.9	11.72	19.58
08/19/2022	36.81	52.18	5.2	10.32	17.18
08/20/2022	47.73	37.37	2.6	5.30	8.81
08/21/2022	18.15	59.55	5.8	12.10	20.14
08/22/2022	16.64	60.33	6.2	12.27	20.45
08/23/2022	27.40	77.29	7.5	15.53	25.89
08/24/2022	28.36	75.00	7.4	15.18	25.30
08/25/2022	32.79	73.08	7.2	14.63	24.39
08/26/2022	21.44	72.37	7.7	14.83	24.74
08/27/2022	19.77	65.77	6.9	13.40	22.31
08/28/2022	14.13	51.79	5.5	10.68	17.80
08/29/2022	17.91	60.87	6.3	12.51	20.84
08/30/2022	18.86	70.78	7.6	14.59	24.32
08/31/2022	20.20	77.24	7.9	15.58	25.97
Monthly Avg/Sum*:	680.63 *	1,976.54 *	200.0 *	398.43 *	664.21 *
Daily Min:	11.16	37.37	2.6	5.30	8.81
Daily Max:	47.73	77.29	7.9	15.58	25.97
Jul 2022 - Aug 2022	1,457.21	3,366.70	335.0	668.50	1,114.45
QTD:	1,457.21 *	3,366.70 *	335.0 *	668.50 *	1,114.45 *
YTD 2022:	5,454.47 *	8,305.70 *	839.6 *	1,679.88 *	2,799.51 *

Monthly Summary By Day Report

Unit CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:25 Location: Roseville, CA

Red = Invalid Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Limit Value:

	Unit CT2 CO, Lb 1 Hour(s)	Unit CT2 NOx, Lb 1 Hour(s)	Unit CT2 SO2, Lb 1 Hour(s)	Unit CT2 PM10, Lb 1 Hour(s)	Unit CT2 VOC, Lb 1 Hour(s)
09/01/2022	21.47	76.58	8.1	15.47	25.79
09/02/2022	26.68	79.98	7.9	16.27	27.09
09/03/2022	16.07	51.44	5.3	10.55	17.57
09/04/2022	18.58	55.05	5.7	11.36	18.96
09/05/2022	18.68	71.35	7.4	14.66	24.45
09/06/2022	23.82	81.10	8.4	16.42	27.38
09/07/2022	23.91	85.25	8.6	16.58	27.63
09/08/2022	24.92	84.54	8.8	16.98	28.35
09/09/2022	31.21	80.43	8.5	16.46	27.41
09/10/2022	15.77	50.06	5.4	10.82	18.05
09/11/2022	18.99	57.11	6.0	11.74	19.59
09/12/2022	17.50	55.56	5.8	11.48	19.16
09/13/2022	21.83	55.40	5.8	11.51	19.21
09/14/2022	13.10	47.61	5.0	9.83	16.35
09/15/2022	14.96	47.65	5.1	10.02	16.70
09/16/2022	10.60	42.91	4.8	8.81	14.68
09/17/2022	10.70	42.63	4.8	8.74	14.64
09/18/2022	13.72	48.87	5.3	9.96	16.64
09/19/2022	21.94	58.06	6.2	11.85	19.77
09/20/2022	25.58	60.06	6.2	12.19	20.35
09/21/2022	17.23	55.61	6.0	11.57	19.31
09/22/2022	26.16	46.80	4.7	9.85	16.41
09/23/2022	48.88	34.13	2.3	4.77	7.94
09/24/2022	14.65	54.56	6.0	11.18	18.65
09/25/2022	11.32	48.31	5.4	10.13	16.92
09/26/2022	11.05	46.02	4.9	9.63	16.09
09/27/2022	42.06	67.59	6.7	13.74	22.91
09/28/2022	11.11	49.68	5.6	10.40	17.33
09/29/2022	18.65	50.99	5.5	10.87	18.09
09/30/2022	12.51	46.69	5.3	10.27	17.10
Monthly Avg/Sum*:	603.65 *	1,732.02 *	181.5 *	354.11 *	590.52 *
Daily Min:	10.60	34.13	2.3	4.77	7.94
Daily Max:	48.88	85.25	8.8	16.98	28.35
Jul 2022 - Sep 2022	2,060.86	5,098.72	516.5	1,022.61	1,704.97
QTD:	2,060.86 *	5,098.72 *	516.5 *	1,022.61 *	1,704.97 *
YTD 2022:	6,058.12 *	10,037.72 *	1,021.1 *	2,033.99 *	3,390.03 *

Monthly Summary By Day Report

Units CT1 and CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 19:14 Location: Roseville, CA

Red = Invalid Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Limit Value:

	Units CT1 & CT2 CO, Lb 1 Hour(s)	Units CT1 & CT2 NOx, Lb 1 Hour(s)	Units CT1 & CT2 SO2, Lb 1 Hour(s)	Units CT1 & CT2 PM10, Lb 1 Hour(s)	Units CT1 & CT2 VOC, Lb 1 Hour(s)
07/01/2022	74.79	73.87	6.74	13.49	22.50
07/02/2022	9.07	39.83	4.32	8.65	14.36
07/03/2022	8.89	39.70	4.32	8.63	14.34
07/04/2022	8.49	42.20	4.32	8.63	14.29
07/05/2022	70.69	76.30	6.98	13.95	23.28
07/06/2022	59.76	67.78	6.19	12.40	20.67
07/07/2022	73.55	81.52	7.75	15.52	25.80
07/08/2022	50.69	65.00	6.10	12.17	20.24
07/09/2022	10.51	41.85	4.49	8.97	14.90
07/10/2022	36.72	76.83	7.48	14.88	24.85
07/11/2022	34.40	120.88	13.11	26.23	43.76
07/12/2022	40.01	119.09	12.79	25.60	42.64
07/13/2022	40.41	123.57	12.18	24.41	40.72
07/14/2022	67.24	98.49	9.29	18.57	30.91
07/15/2022	38.77	132.48	13.25	26.51	44.22
07/16/2022	29.71	129.21	13.06	26.16	43.55
07/17/2022	32.75	141.03	14.51	28.99	48.32
07/18/2022	39.64	142.88	14.26	28.57	47.65
07/19/2022	32.34	121.45	12.10	24.18	40.33
07/20/2022	24.57	104.69	11.34	22.66	37.77
07/21/2022	27.95	102.48	10.62	21.25	35.46
07/22/2022	50.00	100.13	10.25	20.53	34.25
07/23/2022	54.52	77.89	7.19	14.39	23.97
07/24/2022	61.79	96.48	9.14	18.29	30.52
07/25/2022	29.76	101.95	11.10	22.23	37.02
07/26/2022	38.02	108.18	11.79	23.58	39.33
07/27/2022	29.89	110.66	11.23	22.46	37.44
07/28/2022	40.03	128.85	13.12	26.23	43.72
07/29/2022	40.70	121.99	12.44	24.90	41.49
07/30/2022	45.90	139.63	13.83	27.66	46.07
07/31/2022	43.49	127.65	13.07	26.15	43.58
Monthly Avg/Sum*:	1,245.05 *	3,054.54 *	308.36 *	616.84 *	1,027.95 *
Daily Min:	8.49	39.70	4.32	8.63	14.29
Daily Max:	74.79	142.88	14.51	28.99	48.32
Jul 2022 - Jul 2022	1,245.05	3,054.54	308.36	616.84	1,027.95
QTD:	1,245.05 *	3,054.54 *	308.36 *	616.84 *	1,027.95 *
YTD 2022:	8,468.47 *	12,330.53 *	1,255.89 *	2,512.65 *	4,188.71 *

Monthly Summary By Day Report

Units CT1 and CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 19:14 Location: Roseville, CA

Red = Invalid Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Limit Value:	Units CT1 & CT2 CO, Lb 1 Hour(s)	Units CT1 & CT2 NOx, Lb 1 Hour(s)	Units CT1 & CT2 SO2, Lb 1 Hour(s)	Units CT1 & CT2 PM10, Lb 1 Hour(s)	Units CT1 & CT2 VOC, Lb 1 Hour(s)
08/01/2022	57.30	138.87	13.74	27.53	45.83
08/02/2022	40.01	124.00	12.52	25.06	41.84
08/03/2022	32.09	118.48	12.61	25.25	42.08
08/04/2022	44.22	143.63	14.66	29.37	48.92
08/05/2022	52.52	122.37	13.21	26.38	44.03
08/06/2022	21.07	87.42	9.08	18.18	30.36
08/07/2022	25.81	101.87	9.75	19.54	32.58
08/08/2022	38.44	120.83	12.29	24.55	40.93
08/09/2022	59.53	145.47	14.46	28.92	48.32
08/10/2022	37.06	133.62	12.86	25.69	42.77
08/11/2022	33.13	135.37	13.39	26.75	44.59
08/12/2022	34.85	126.91	12.83	25.63	42.69
08/13/2022	34.31	117.04	11.94	23.93	39.83
08/14/2022	38.21	115.24	11.66	23.29	38.83
08/15/2022	25.39	118.55	11.85	23.64	39.40
08/16/2022	28.68	134.56	13.78	27.53	45.87
08/17/2022	25.79	85.33	8.68	17.29	28.80
08/18/2022	19.99	58.67	5.84	11.72	19.58
08/19/2022	88.65	85.89	7.68	15.34	25.54
08/20/2022	53.66	64.73	5.35	10.70	17.82
08/21/2022	67.71	109.02	10.13	20.32	33.82
08/22/2022	20.54	75.20	7.66	15.31	25.53
08/23/2022	27.40	77.29	7.79	15.53	25.89
08/24/2022	28.36	75.00	7.61	15.18	25.30
08/25/2022	32.79	73.08	7.34	14.63	24.39
08/26/2022	72.41	136.70	12.88	25.76	42.95
08/27/2022	33.87	124.44	13.01	26.03	43.36
08/28/2022	25.17	101.72	10.34	20.69	34.49
08/29/2022	30.65	119.02	12.14	24.27	40.47
08/30/2022	30.52	138.25	14.18	28.39	47.30
08/31/2022	33.36	149.46	15.16	30.35	50.57
Monthly Avg/Sum*:	1,193.49 *	3,458.03 *	346.42 *	692.75 *	1,154.68 *
Daily Min:	19.99	58.67	5.35	10.70	17.82
Daily Max:	88.65	149.46	15.16	30.35	50.57
Jul 2022 - Aug 2022	2,438.54	6,512.57	654.78	1,309.59	2,182.63
QTD:	2,438.54 *	6,512.57 *	654.78 *	1,309.59 *	2,182.63 *
YTD 2022:	9,661.96 *	15,788.56 *	1,602.31 *	3,205.40 *	5,343.39 *

Monthly Summary By Day Report

Units CT1 and CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 19:14 Location: Roseville, CA

Red = Invalid Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Limit Value:	Units CT1 & CT2 CO, Lb 1 Hour(s)	Units CT1 & CT2 NOx, Lb 1 Hour(s)	Units CT1 & CT2 SO2, Lb 1 Hour(s)	Units CT1 & CT2 PM10, Lb 1 Hour(s)	Units CT1 & CT2 VOC, Lb 1 Hour(s)
09/01/2022	32.98	148.87	15.12	30.21	50.34
09/02/2022	41.38	155.87	15.88	31.71	52.89
09/03/2022	29.00	99.58	10.26	20.50	34.16
09/04/2022	32.33	107.43	11.06	22.11	36.91
09/05/2022	29.28	140.29	14.32	28.66	47.76
09/06/2022	35.09	158.54	16.06	32.14	53.54
09/07/2022	33.02	166.75	16.21	32.42	54.00
09/08/2022	34.92	166.17	16.63	33.26	55.41
09/09/2022	42.81	157.17	16.05	32.17	53.57
09/10/2022	28.90	98.50	10.47	20.94	34.90
09/11/2022	33.28	110.37	11.38	22.76	37.93
09/12/2022	31.16	107.51	11.13	22.21	37.04
09/13/2022	40.09	107.60	11.13	22.28	37.18
09/14/2022	23.60	92.08	9.47	18.96	31.61
09/15/2022	26.94	92.59	9.71	19.38	32.29
09/16/2022	18.99	82.94	8.52	17.02	28.38
09/17/2022	19.09	82.90	8.49	16.89	28.25
09/18/2022	24.61	94.86	9.65	19.24	32.08
09/19/2022	36.18	113.34	11.50	23.01	38.33
09/20/2022	38.99	116.89	11.84	23.68	39.50
09/21/2022	31.59	107.78	11.18	22.34	37.26
09/22/2022	63.62	90.80	9.26	18.50	30.84
09/23/2022	105.13	71.62	5.36	10.72	17.85
09/24/2022	29.80	105.73	10.82	21.66	36.11
09/25/2022	23.06	94.28	9.79	19.63	32.69
09/26/2022	21.84	89.93	9.33	18.66	31.14
09/27/2022	64.71	130.96	13.32	26.66	44.41
09/28/2022	21.14	96.87	10.05	20.09	33.48
09/29/2022	32.06	100.81	10.51	21.01	35.03
09/30/2022	23.82	90.89	9.90	19.82	33.03
Monthly Avg/Sum*:	1,049.41 *	3,379.92 *	344.40 *	688.64 *	1,147.91 *
Daily Min:	18.99	71.62	5.36	10.72	17.85
Daily Max:	105.13	166.75	16.63	33.26	55.41
Jul 2022 - Sep 2022	3,487.95	9,892.49	999.18	1,998.23	3,330.54
QTD:	3,487.95 *	9,892.49 *	999.18 *	1,998.23 *	3,330.54 *
YTD 2022:	10,711.37 *	19,168.48 *	1,946.71 *	3,894.04 *	6,491.30 *

ATTACHMENT 18

AQ-60

AQ-60 If the Alstom GTX100 turbine are selected, the quarterly emissions shall not exceed the levels shown below:

Alstom GTX100 Gas Turbines					
Pollutant	Quarter 1 (lbs/quarter) Two turbines	Quarter 2 (lbs/quarter) Two Turbines	Quarter 3 (lbs/quarter) Two turbines	Quarter 4 (lbs/quarter) Two Turbines	Tons/ Year Two Turbines
NOx	15,399	12,965	17,496	15,422	30.64
CO	26,787	32,590	28,175	29,862	58.71
VOCs	5,791	7,306	6,630	6,848	13.29
PM10	16,300	13,692	17,789	17,569	32.67
SOx	3,385	2,843	3,694	3,648	6.78

Verification: The Project owner shall include all necessary emissions data to demonstrate compliance with the emission limits provided in this Condition as part of the Quarterly Air Quality Report required in Condition of Certification AQ-SC6.

Monthly Summary By Day Report

Unit CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:26 Location: Roseville, CA

Red = Invalid Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Limit Value:

	Unit CT1 CO, Lb 1 Hour(s)	Unit CT1 NOx, Lb 1 Hour(s)	Unit CT1 SO2, Lb 1 Hour(s)	Unit CT1 PM10, Lb 1 Hour(s)	Unit CT1 VOC, Lb 1 Hour(s)
07/01/2022	15.25	46.57	5.4	10.13	16.90
07/02/2022	9.07	39.83	4.8	8.65	14.36
07/03/2022	8.89	39.70	4.8	8.63	14.34
07/04/2022	8.49	42.20	4.8	8.63	14.29
07/05/2022	13.73	47.23	5.3	10.16	16.94
07/06/2022	12.79	43.76	5.2	9.52	15.89
07/07/2022	14.67	47.90	5.6	10.54	17.52
07/08/2022	15.90	47.22	5.3	10.28	17.10
07/09/2022	10.51	41.85	4.9	8.97	14.90
07/10/2022	12.05	46.29	5.5	10.08	16.81
07/11/2022	16.31	58.84	6.5	12.76	21.25
07/12/2022	19.16	57.87	6.3	12.44	20.72
07/13/2022	17.16	59.65	6.2	11.84	19.71
07/14/2022	17.49	58.72	5.9	11.96	19.89
07/15/2022	18.30	64.56	6.4	12.85	21.49
07/16/2022	13.70	62.62	6.4	12.71	21.16
07/17/2022	14.81	69.02	6.7	14.12	23.52
07/18/2022	18.22	69.86	7.0	13.91	23.20
07/19/2022	14.83	59.36	6.0	11.77	19.62
07/20/2022	10.92	50.79	5.8	11.01	18.35
07/21/2022	13.32	49.62	5.6	10.30	17.23
07/22/2022	14.24	48.83	5.4	10.09	16.83
07/23/2022	19.35	52.93	5.6	10.93	18.20
07/24/2022	13.42	49.66	5.7	10.37	17.32
07/25/2022	13.89	49.72	5.6	10.77	17.97
07/26/2022	18.33	52.62	5.8	11.45	19.10
07/27/2022	14.12	53.83	5.8	10.93	18.18
07/28/2022	18.18	63.49	6.4	12.73	21.23
07/29/2022	18.97	59.61	6.2	12.11	20.15
07/30/2022	21.46	67.81	6.8	13.45	22.39
07/31/2022	20.94	62.42	6.4	12.68	21.15
Monthly Avg/Sum*:	468.47 *	1,664.38 *	180.1 *	346.77 *	577.71 *
Daily Min:	8.49	39.70	4.8	8.63	14.29
Daily Max:	21.46	69.86	7.0	14.12	23.52
Jul 2022 - Jul 2022	468.47	1,664.38	180.1	346.77	577.71
QTD:	468.47 *	1,664.38 *	180.1 *	346.77 *	577.71 *
YTD 2022:	3,625.55 *	6,001.37 *	641.7 *	1,231.20 *	2,053.41 *

Monthly Summary By Day Report

Unit CT1



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:26 Location: Roseville, CA

Red = Invalid Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Limit Value:

	Unit CT1 CO, Lb 1 Hour(s)	Unit CT1 NOx, Lb 1 Hour(s)	Unit CT1 SO2, Lb 1 Hour(s)	Unit CT1 PM10, Lb 1 Hour(s)	Unit CT1 VOC, Lb 1 Hour(s)
08/01/2022	27.23	67.15	6.7	13.37	22.26
08/02/2022	18.53	60.40	6.3	12.20	20.36
08/03/2022	14.80	60.13	6.4	12.32	20.50
08/04/2022	20.37	70.00	7.1	14.29	23.83
08/05/2022	26.01	59.77	6.6	12.81	21.36
08/06/2022	9.91	42.31	5.1	8.79	14.68
08/07/2022	12.86	49.54	5.3	9.48	15.78
08/08/2022	18.14	58.66	6.0	11.93	19.88
08/09/2022	29.44	70.02	7.0	14.03	23.44
08/10/2022	17.34	64.59	6.4	12.46	20.74
08/11/2022	14.73	65.80	6.7	12.99	21.64
08/12/2022	16.14	61.62	6.4	12.42	20.68
08/13/2022	16.43	56.77	6.0	11.60	19.29
08/14/2022	17.89	56.28	5.7	11.29	18.83
08/15/2022	10.75	57.70	6.1	11.48	19.16
08/16/2022	12.05	65.74	6.7	13.43	22.37
08/17/2022	5.34	18.83	2.2	3.85	6.38
08/18/2022	0.00	0.00	0.0	0.00	0.00
08/19/2022	51.84	33.71	2.6	5.02	8.36
08/20/2022	5.93	27.36	3.1	5.40	9.01
08/21/2022	49.56	49.47	4.3	8.22	13.68
08/22/2022	3.90	14.87	1.6	3.04	5.08
08/23/2022	0.00	0.00	0.0	0.00	0.00
08/24/2022	0.00	0.00	0.0	0.00	0.00
08/25/2022	0.00	0.00	0.0	0.00	0.00
08/26/2022	50.97	64.33	5.6	10.93	18.21
08/27/2022	14.10	58.67	6.7	12.63	21.05
08/28/2022	11.04	49.93	5.4	10.01	16.69
08/29/2022	12.74	58.15	5.8	11.76	19.63
08/30/2022	11.66	67.47	7.3	13.80	22.98
08/31/2022	13.16	72.22	7.5	14.77	24.60
Monthly Avg/Sum*:	512.86 *	1,481.49 *	152.6 *	294.32 *	490.47 *
Daily Min:	3.90	14.87	1.6	3.04	5.08
Daily Max:	51.84	72.22	7.5	14.77	24.60
Jul 2022 - Aug 2022	981.33	3,145.87	332.7	641.09	1,068.18
QTD:	981.33 *	3,145.87 *	332.7 *	641.09 *	1,068.18 *
YTD 2022:	4,138.41 *	7,482.86 *	794.3 *	1,525.52 *	2,543.88 *

Monthly Summary By Day Report

Unit CT1



From: 07/01/2022 00:00 **To:** 09/30/2022 23:59 **Facility Name:** ROSEVILLE ENERGY
Generated: 10/01/2022 22:26 **Location:** Roseville, CA

Red = Invalid Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Limit Value:

	Unit CT1 CO, Lb 1 Hour(s)	Unit CT1 NOx, Lb 1 Hour(s)	Unit CT1 SO2, Lb 1 Hour(s)	Unit CT1 PM10, Lb 1 Hour(s)	Unit CT1 VOC, Lb 1 Hour(s)
09/01/2022	11.51	72.29	7.8	14.74	24.55
09/02/2022	14.70	75.89	7.4	15.44	25.80
09/03/2022	12.93	48.14	5.3	9.95	16.59
09/04/2022	13.75	52.38	5.7	10.75	17.95
09/05/2022	10.60	68.94	7.2	14.00	23.31
09/06/2022	11.27	77.44	8.2	15.72	26.16
09/07/2022	9.11	81.50	8.5	15.84	26.37
09/08/2022	10.00	81.63	8.7	16.28	27.06
09/09/2022	11.60	76.74	7.8	15.71	26.16
09/10/2022	13.13	48.44	5.1	10.12	16.85
09/11/2022	14.29	53.26	5.6	11.02	18.34
09/12/2022	13.66	51.95	5.5	10.73	17.88
09/13/2022	18.26	52.20	5.6	10.77	17.97
09/14/2022	10.50	44.47	4.9	9.13	15.26
09/15/2022	11.98	44.94	5.0	9.36	15.59
09/16/2022	8.39	40.03	4.8	8.21	13.70
09/17/2022	8.39	40.27	4.8	8.15	13.61
09/18/2022	10.89	45.99	5.0	9.28	15.44
09/19/2022	14.24	55.28	5.7	11.16	18.56
09/20/2022	13.41	56.83	5.9	11.49	19.15
09/21/2022	14.36	52.17	5.5	10.77	17.95
09/22/2022	37.46	44.00	4.4	8.65	14.43
09/23/2022	56.25	37.49	2.8	5.95	9.91
09/24/2022	15.15	51.17	5.4	10.48	17.46
09/25/2022	11.74	45.97	4.9	9.50	15.77
09/26/2022	10.79	43.91	4.9	9.03	15.05
09/27/2022	22.65	63.37	6.6	12.92	21.50
09/28/2022	10.03	47.19	5.4	9.69	16.15
09/29/2022	13.41	49.82	5.2	10.14	16.94
09/30/2022	11.31	44.20	4.9	9.55	15.93
Monthly Avg/Sum*:	445.76 *	1,647.90 *	174.5 *	334.53 *	557.39 *
Daily Min:	8.39	37.49	2.8	5.95	9.91
Daily Max:	56.25	81.63	8.7	16.28	27.06
Jul 2022 - Sep 2022	1,427.09	4,793.77	507.2	975.62	1,625.57
QTD:	1,427.09 *	4,793.77 *	507.2 *	975.62 *	1,625.57 *
YTD 2022:	4,584.17 *	9,130.76 *	968.8 *	1,860.05 *	3,101.27 *

Monthly Summary By Day Report

Unit CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:25 Location: Roseville, CA

Red = Invalid Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Limit Value:

	Unit CT2 CO, Lb 1 Hour(s)	Unit CT2 NOx, Lb 1 Hour(s)	Unit CT2 SO2, Lb 1 Hour(s)	Unit CT2 PM10, Lb 1 Hour(s)	Unit CT2 VOC, Lb 1 Hour(s)
07/01/2022	59.54	27.30	1.6	3.36	5.60
07/02/2022	0.00	0.00	0.0	0.00	0.00
07/03/2022	0.00	0.00	0.0	0.00	0.00
07/04/2022	0.00	0.00	0.0	0.00	0.00
07/05/2022	56.96	29.07	1.8	3.79	6.34
07/06/2022	46.97	24.02	1.4	2.88	4.78
07/07/2022	58.88	33.62	2.4	4.98	8.28
07/08/2022	34.79	17.78	1.0	1.89	3.14
07/09/2022	0.00	0.00	0.0	0.00	0.00
07/10/2022	24.67	30.54	2.5	4.80	8.04
07/11/2022	18.09	62.04	6.6	13.47	22.51
07/12/2022	20.85	61.22	6.5	13.16	21.92
07/13/2022	23.25	63.92	6.3	12.57	21.01
07/14/2022	49.75	39.77	3.1	6.61	11.02
07/15/2022	20.47	67.92	6.6	13.66	22.73
07/16/2022	16.01	66.59	6.9	13.45	22.39
07/17/2022	17.94	72.01	7.6	14.87	24.80
07/18/2022	21.42	73.02	7.4	14.66	24.45
07/19/2022	17.51	62.09	6.4	12.41	20.71
07/20/2022	13.65	53.90	6.1	11.65	19.42
07/21/2022	14.63	52.86	5.6	10.95	18.23
07/22/2022	35.76	51.30	5.3	10.44	17.42
07/23/2022	35.17	24.96	1.8	3.46	5.77
07/24/2022	48.37	46.82	4.2	7.92	13.20
07/25/2022	15.87	52.23	5.7	11.46	19.05
07/26/2022	19.69	55.56	6.0	12.13	20.23
07/27/2022	15.77	56.83	5.8	11.53	19.26
07/28/2022	21.85	65.36	6.6	13.50	22.49
07/29/2022	21.73	62.38	6.2	12.79	21.34
07/30/2022	24.44	71.82	7.0	14.21	23.68
07/31/2022	22.55	65.23	6.6	13.47	22.43
Monthly Avg/Sum*:	776.58 *	1,390.16 *	135.0 *	270.07 *	450.24 *
Daily Min:	13.65	17.78	1.0	1.89	3.14
Daily Max:	59.54	73.02	7.6	14.87	24.80
Jul 2022 - Jul 2022	776.58	1,390.16	135.0	270.07	450.24
QTD:	776.58 *	1,390.16 *	135.0 *	270.07 *	450.24 *
YTD 2022:	4,773.84 *	6,329.16 *	639.6 *	1,281.45 *	2,135.30 *

Monthly Summary By Day Report

Unit CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:25 Location: Roseville, CA

Red = Invalid Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Limit Value:

	Unit CT2 CO, Lb 1 Hour(s)	Unit CT2 NOx, Lb 1 Hour(s)	Unit CT2 SO2, Lb 1 Hour(s)	Unit CT2 PM10, Lb 1 Hour(s)	Unit CT2 VOC, Lb 1 Hour(s)
08/01/2022	30.07	71.72	6.8	14.16	23.57
08/02/2022	21.48	63.60	6.3	12.86	21.48
08/03/2022	17.29	58.35	6.4	12.93	21.58
08/04/2022	23.85	73.63	7.2	15.08	25.09
08/05/2022	26.51	62.60	6.6	13.57	22.67
08/06/2022	11.16	45.11	5.2	9.39	15.68
08/07/2022	12.95	52.33	5.3	10.06	16.80
08/08/2022	20.30	62.17	6.4	12.62	21.05
08/09/2022	30.09	75.45	7.3	14.89	24.88
08/10/2022	19.72	69.03	6.6	13.23	22.03
08/11/2022	18.40	69.57	7.4	13.76	22.95
08/12/2022	18.71	65.29	6.6	13.21	22.01
08/13/2022	17.88	60.27	6.3	12.33	20.54
08/14/2022	20.32	58.96	5.7	12.00	20.00
08/15/2022	14.64	60.85	6.2	12.16	20.24
08/16/2022	16.63	68.82	7.0	14.10	23.50
08/17/2022	20.45	66.50	7.0	13.44	22.42
08/18/2022	19.99	58.67	5.9	11.72	19.58
08/19/2022	36.81	52.18	5.2	10.32	17.18
08/20/2022	47.73	37.37	2.6	5.30	8.81
08/21/2022	18.15	59.55	5.8	12.10	20.14
08/22/2022	16.64	60.33	6.2	12.27	20.45
08/23/2022	27.40	77.29	7.5	15.53	25.89
08/24/2022	28.36	75.00	7.4	15.18	25.30
08/25/2022	32.79	73.08	7.2	14.63	24.39
08/26/2022	21.44	72.37	7.7	14.83	24.74
08/27/2022	19.77	65.77	6.9	13.40	22.31
08/28/2022	14.13	51.79	5.5	10.68	17.80
08/29/2022	17.91	60.87	6.3	12.51	20.84
08/30/2022	18.86	70.78	7.6	14.59	24.32
08/31/2022	20.20	77.24	7.9	15.58	25.97
Monthly Avg/Sum*:	680.63 *	1,976.54 *	200.0 *	398.43 *	664.21 *
Daily Min:	11.16	37.37	2.6	5.30	8.81
Daily Max:	47.73	77.29	7.9	15.58	25.97
Jul 2022 - Aug 2022	1,457.21	3,366.70	335.0	668.50	1,114.45
QTD:	1,457.21 *	3,366.70 *	335.0 *	668.50 *	1,114.45 *
YTD 2022:	5,454.47 *	8,305.70 *	839.6 *	1,679.88 *	2,799.51 *

Monthly Summary By Day Report

Unit CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 22:25 Location: Roseville, CA

Red = Invalid Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Limit Value:

	Unit CT2 CO, Lb 1 Hour(s)	Unit CT2 NOx, Lb 1 Hour(s)	Unit CT2 SO2, Lb 1 Hour(s)	Unit CT2 PM10, Lb 1 Hour(s)	Unit CT2 VOC, Lb 1 Hour(s)
09/01/2022	21.47	76.58	8.1	15.47	25.79
09/02/2022	26.68	79.98	7.9	16.27	27.09
09/03/2022	16.07	51.44	5.3	10.55	17.57
09/04/2022	18.58	55.05	5.7	11.36	18.96
09/05/2022	18.68	71.35	7.4	14.66	24.45
09/06/2022	23.82	81.10	8.4	16.42	27.38
09/07/2022	23.91	85.25	8.6	16.58	27.63
09/08/2022	24.92	84.54	8.8	16.98	28.35
09/09/2022	31.21	80.43	8.5	16.46	27.41
09/10/2022	15.77	50.06	5.4	10.82	18.05
09/11/2022	18.99	57.11	6.0	11.74	19.59
09/12/2022	17.50	55.56	5.8	11.48	19.16
09/13/2022	21.83	55.40	5.8	11.51	19.21
09/14/2022	13.10	47.61	5.0	9.83	16.35
09/15/2022	14.96	47.65	5.1	10.02	16.70
09/16/2022	10.60	42.91	4.8	8.81	14.68
09/17/2022	10.70	42.63	4.8	8.74	14.64
09/18/2022	13.72	48.87	5.3	9.96	16.64
09/19/2022	21.94	58.06	6.2	11.85	19.77
09/20/2022	25.58	60.06	6.2	12.19	20.35
09/21/2022	17.23	55.61	6.0	11.57	19.31
09/22/2022	26.16	46.80	4.7	9.85	16.41
09/23/2022	48.88	34.13	2.3	4.77	7.94
09/24/2022	14.65	54.56	6.0	11.18	18.65
09/25/2022	11.32	48.31	5.4	10.13	16.92
09/26/2022	11.05	46.02	4.9	9.63	16.09
09/27/2022	42.06	67.59	6.7	13.74	22.91
09/28/2022	11.11	49.68	5.6	10.40	17.33
09/29/2022	18.65	50.99	5.5	10.87	18.09
09/30/2022	12.51	46.69	5.3	10.27	17.10
Monthly Avg/Sum*:	603.65 *	1,732.02 *	181.5 *	354.11 *	590.52 *
Daily Min:	10.60	34.13	2.3	4.77	7.94
Daily Max:	48.88	85.25	8.8	16.98	28.35
Jul 2022 - Sep 2022	2,060.86	5,098.72	516.5	1,022.61	1,704.97
QTD:	2,060.86 *	5,098.72 *	516.5 *	1,022.61 *	1,704.97 *
YTD 2022:	6,058.12 *	10,037.72 *	1,021.1 *	2,033.99 *	3,390.03 *

Monthly Summary By Day Report

Units CT1 and CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 19:14 Location: Roseville, CA

Red = Invalid Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Limit Value:

	Units CT1 & CT2 CO, Lb 1 Hour(s)	Units CT1 & CT2 NOx, Lb 1 Hour(s)	Units CT1 & CT2 SO2, Lb 1 Hour(s)	Units CT1 & CT2 PM10, Lb 1 Hour(s)	Units CT1 & CT2 VOC, Lb 1 Hour(s)
07/01/2022	74.79	73.87	6.74	13.49	22.50
07/02/2022	9.07	39.83	4.32	8.65	14.36
07/03/2022	8.89	39.70	4.32	8.63	14.34
07/04/2022	8.49	42.20	4.32	8.63	14.29
07/05/2022	70.69	76.30	6.98	13.95	23.28
07/06/2022	59.76	67.78	6.19	12.40	20.67
07/07/2022	73.55	81.52	7.75	15.52	25.80
07/08/2022	50.69	65.00	6.10	12.17	20.24
07/09/2022	10.51	41.85	4.49	8.97	14.90
07/10/2022	36.72	76.83	7.48	14.88	24.85
07/11/2022	34.40	120.88	13.11	26.23	43.76
07/12/2022	40.01	119.09	12.79	25.60	42.64
07/13/2022	40.41	123.57	12.18	24.41	40.72
07/14/2022	67.24	98.49	9.29	18.57	30.91
07/15/2022	38.77	132.48	13.25	26.51	44.22
07/16/2022	29.71	129.21	13.06	26.16	43.55
07/17/2022	32.75	141.03	14.51	28.99	48.32
07/18/2022	39.64	142.88	14.26	28.57	47.65
07/19/2022	32.34	121.45	12.10	24.18	40.33
07/20/2022	24.57	104.69	11.34	22.66	37.77
07/21/2022	27.95	102.48	10.62	21.25	35.46
07/22/2022	50.00	100.13	10.25	20.53	34.25
07/23/2022	54.52	77.89	7.19	14.39	23.97
07/24/2022	61.79	96.48	9.14	18.29	30.52
07/25/2022	29.76	101.95	11.10	22.23	37.02
07/26/2022	38.02	108.18	11.79	23.58	39.33
07/27/2022	29.89	110.66	11.23	22.46	37.44
07/28/2022	40.03	128.85	13.12	26.23	43.72
07/29/2022	40.70	121.99	12.44	24.90	41.49
07/30/2022	45.90	139.63	13.83	27.66	46.07
07/31/2022	43.49	127.65	13.07	26.15	43.58
Monthly Avg/Sum*:	1,245.05 *	3,054.54 *	308.36 *	616.84 *	1,027.95 *
Daily Min:	8.49	39.70	4.32	8.63	14.29
Daily Max:	74.79	142.88	14.51	28.99	48.32
Jul 2022 - Jul 2022	1,245.05	3,054.54	308.36	616.84	1,027.95
QTD:	1,245.05 *	3,054.54 *	308.36 *	616.84 *	1,027.95 *
YTD 2022:	8,468.47 *	12,330.53 *	1,255.89 *	2,512.65 *	4,188.71 *

Monthly Summary By Day Report

Units CT1 and CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 19:14 Location: Roseville, CA

Red = Invalid Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Limit Value:	Units CT1 & CT2 CO, Lb 1 Hour(s)	Units CT1 & CT2 NOx, Lb 1 Hour(s)	Units CT1 & CT2 SO2, Lb 1 Hour(s)	Units CT1 & CT2 PM10, Lb 1 Hour(s)	Units CT1 & CT2 VOC, Lb 1 Hour(s)
08/01/2022	57.30	138.87	13.74	27.53	45.83
08/02/2022	40.01	124.00	12.52	25.06	41.84
08/03/2022	32.09	118.48	12.61	25.25	42.08
08/04/2022	44.22	143.63	14.66	29.37	48.92
08/05/2022	52.52	122.37	13.21	26.38	44.03
08/06/2022	21.07	87.42	9.08	18.18	30.36
08/07/2022	25.81	101.87	9.75	19.54	32.58
08/08/2022	38.44	120.83	12.29	24.55	40.93
08/09/2022	59.53	145.47	14.46	28.92	48.32
08/10/2022	37.06	133.62	12.86	25.69	42.77
08/11/2022	33.13	135.37	13.39	26.75	44.59
08/12/2022	34.85	126.91	12.83	25.63	42.69
08/13/2022	34.31	117.04	11.94	23.93	39.83
08/14/2022	38.21	115.24	11.66	23.29	38.83
08/15/2022	25.39	118.55	11.85	23.64	39.40
08/16/2022	28.68	134.56	13.78	27.53	45.87
08/17/2022	25.79	85.33	8.68	17.29	28.80
08/18/2022	19.99	58.67	5.84	11.72	19.58
08/19/2022	88.65	85.89	7.68	15.34	25.54
08/20/2022	53.66	64.73	5.35	10.70	17.82
08/21/2022	67.71	109.02	10.13	20.32	33.82
08/22/2022	20.54	75.20	7.66	15.31	25.53
08/23/2022	27.40	77.29	7.79	15.53	25.89
08/24/2022	28.36	75.00	7.61	15.18	25.30
08/25/2022	32.79	73.08	7.34	14.63	24.39
08/26/2022	72.41	136.70	12.88	25.76	42.95
08/27/2022	33.87	124.44	13.01	26.03	43.36
08/28/2022	25.17	101.72	10.34	20.69	34.49
08/29/2022	30.65	119.02	12.14	24.27	40.47
08/30/2022	30.52	138.25	14.18	28.39	47.30
08/31/2022	33.36	149.46	15.16	30.35	50.57
Monthly Avg/Sum*:	1,193.49 *	3,458.03 *	346.42 *	692.75 *	1,154.68 *
Daily Min:	19.99	58.67	5.35	10.70	17.82
Daily Max:	88.65	149.46	15.16	30.35	50.57
Jul 2022 - Aug 2022	2,438.54	6,512.57	654.78	1,309.59	2,182.63
QTD:	2,438.54 *	6,512.57 *	654.78 *	1,309.59 *	2,182.63 *
YTD 2022:	9,661.96 *	15,788.56 *	1,602.31 *	3,205.40 *	5,343.39 *

Monthly Summary By Day Report

Units CT1 and CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 19:14 Location: Roseville, CA

Red = Invalid Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Limit Value:

	Units CT1 & CT2 CO, Lb 1 Hour(s)	Units CT1 & CT2 NOx, Lb 1 Hour(s)	Units CT1 & CT2 SO2, Lb 1 Hour(s)	Units CT1 & CT2 PM10, Lb 1 Hour(s)	Units CT1 & CT2 VOC, Lb 1 Hour(s)
09/01/2022	32.98	148.87	15.12	30.21	50.34
09/02/2022	41.38	155.87	15.88	31.71	52.89
09/03/2022	29.00	99.58	10.26	20.50	34.16
09/04/2022	32.33	107.43	11.06	22.11	36.91
09/05/2022	29.28	140.29	14.32	28.66	47.76
09/06/2022	35.09	158.54	16.06	32.14	53.54
09/07/2022	33.02	166.75	16.21	32.42	54.00
09/08/2022	34.92	166.17	16.63	33.26	55.41
09/09/2022	42.81	157.17	16.05	32.17	53.57
09/10/2022	28.90	98.50	10.47	20.94	34.90
09/11/2022	33.28	110.37	11.38	22.76	37.93
09/12/2022	31.16	107.51	11.13	22.21	37.04
09/13/2022	40.09	107.60	11.13	22.28	37.18
09/14/2022	23.60	92.08	9.47	18.96	31.61
09/15/2022	26.94	92.59	9.71	19.38	32.29
09/16/2022	18.99	82.94	8.52	17.02	28.38
09/17/2022	19.09	82.90	8.49	16.89	28.25
09/18/2022	24.61	94.86	9.65	19.24	32.08
09/19/2022	36.18	113.34	11.50	23.01	38.33
09/20/2022	38.99	116.89	11.84	23.68	39.50
09/21/2022	31.59	107.78	11.18	22.34	37.26
09/22/2022	63.62	90.80	9.26	18.50	30.84
09/23/2022	105.13	71.62	5.36	10.72	17.85
09/24/2022	29.80	105.73	10.82	21.66	36.11
09/25/2022	23.06	94.28	9.79	19.63	32.69
09/26/2022	21.84	89.93	9.33	18.66	31.14
09/27/2022	64.71	130.96	13.32	26.66	44.41
09/28/2022	21.14	96.87	10.05	20.09	33.48
09/29/2022	32.06	100.81	10.51	21.01	35.03
09/30/2022	23.82	90.89	9.90	19.82	33.03
Monthly Avg/Sum*:	1,049.41 *	3,379.92 *	344.40 *	688.64 *	1,147.91 *
Daily Min:	18.99	71.62	5.36	10.72	17.85
Daily Max:	105.13	166.75	16.63	33.26	55.41
Jul 2022 - Sep 2022	3,487.95	9,892.49	999.18	1,998.23	3,330.54
QTD:	3,487.95 *	9,892.49 *	999.18 *	1,998.23 *	3,330.54 *
YTD 2022:	10,711.37 *	19,168.48 *	1,946.71 *	3,894.04 *	6,491.30 *

ATTACHMENT 19

AQ-63

AQ-63 The Total Facility Emissions shall not exceed the following quarterly emissions rates.

POLLUTANT	Q1 (LBS)	Q2 (LBS)	Q3 (LBS)	Q4 (LBS)	TONS/YEAR
NOX	15546	13412	17646	15572	31.09
CO	27121	33872	28515	30202	59.86
VOC	5832	7455	6672	6890	13.42
PM-10	17854	15513	19378	19158	35.95
SO2	3400	2893	3709	3663	6.83

Verification: The Project owner shall include all necessary emissions data to demonstrate compliance with the emissions limits provided in this Condition as part of the Quarterly Air Quality Report required in Condition of Certification AQ-SC6

Monthly Summary By Day Report

Units CT1 and CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 19:14 Location: Roseville, CA

Red = Invalid Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Limit Value:

	Units CT1 & CT2 CO, Lb 1 Hour(s)	Units CT1 & CT2 NOx, Lb 1 Hour(s)	Units CT1 & CT2 SO2, Lb 1 Hour(s)	Units CT1 & CT2 PM10, Lb 1 Hour(s)	Units CT1 & CT2 VOC, Lb 1 Hour(s)
07/01/2022	74.79	73.87	6.74	13.49	22.50
07/02/2022	9.07	39.83	4.32	8.65	14.36
07/03/2022	8.89	39.70	4.32	8.63	14.34
07/04/2022	8.49	42.20	4.32	8.63	14.29
07/05/2022	70.69	76.30	6.98	13.95	23.28
07/06/2022	59.76	67.78	6.19	12.40	20.67
07/07/2022	73.55	81.52	7.75	15.52	25.80
07/08/2022	50.69	65.00	6.10	12.17	20.24
07/09/2022	10.51	41.85	4.49	8.97	14.90
07/10/2022	36.72	76.83	7.48	14.88	24.85
07/11/2022	34.40	120.88	13.11	26.23	43.76
07/12/2022	40.01	119.09	12.79	25.60	42.64
07/13/2022	40.41	123.57	12.18	24.41	40.72
07/14/2022	67.24	98.49	9.29	18.57	30.91
07/15/2022	38.77	132.48	13.25	26.51	44.22
07/16/2022	29.71	129.21	13.06	26.16	43.55
07/17/2022	32.75	141.03	14.51	28.99	48.32
07/18/2022	39.64	142.88	14.26	28.57	47.65
07/19/2022	32.34	121.45	12.10	24.18	40.33
07/20/2022	24.57	104.69	11.34	22.66	37.77
07/21/2022	27.95	102.48	10.62	21.25	35.46
07/22/2022	50.00	100.13	10.25	20.53	34.25
07/23/2022	54.52	77.89	7.19	14.39	23.97
07/24/2022	61.79	96.48	9.14	18.29	30.52
07/25/2022	29.76	101.95	11.10	22.23	37.02
07/26/2022	38.02	108.18	11.79	23.58	39.33
07/27/2022	29.89	110.66	11.23	22.46	37.44
07/28/2022	40.03	128.85	13.12	26.23	43.72
07/29/2022	40.70	121.99	12.44	24.90	41.49
07/30/2022	45.90	139.63	13.83	27.66	46.07
07/31/2022	43.49	127.65	13.07	26.15	43.58
Monthly Avg/Sum*:	1,245.05 *	3,054.54 *	308.36 *	616.84 *	1,027.95 *
Daily Min:	8.49	39.70	4.32	8.63	14.29
Daily Max:	74.79	142.88	14.51	28.99	48.32
Jul 2022 - Jul 2022	1,245.05	3,054.54	308.36	616.84	1,027.95
QTD:	1,245.05 *	3,054.54 *	308.36 *	616.84 *	1,027.95 *
YTD 2022:	8,468.47 *	12,330.53 *	1,255.89 *	2,512.65 *	4,188.71 *

Monthly Summary By Day Report

Units CT1 and CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 19:14 Location: Roseville, CA

Red = Invalid Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Limit Value:	Units CT1 & CT2 CO, Lb 1 Hour(s)	Units CT1 & CT2 NOx, Lb 1 Hour(s)	Units CT1 & CT2 SO2, Lb 1 Hour(s)	Units CT1 & CT2 PM10, Lb 1 Hour(s)	Units CT1 & CT2 VOC, Lb 1 Hour(s)
08/01/2022	57.30	138.87	13.74	27.53	45.83
08/02/2022	40.01	124.00	12.52	25.06	41.84
08/03/2022	32.09	118.48	12.61	25.25	42.08
08/04/2022	44.22	143.63	14.66	29.37	48.92
08/05/2022	52.52	122.37	13.21	26.38	44.03
08/06/2022	21.07	87.42	9.08	18.18	30.36
08/07/2022	25.81	101.87	9.75	19.54	32.58
08/08/2022	38.44	120.83	12.29	24.55	40.93
08/09/2022	59.53	145.47	14.46	28.92	48.32
08/10/2022	37.06	133.62	12.86	25.69	42.77
08/11/2022	33.13	135.37	13.39	26.75	44.59
08/12/2022	34.85	126.91	12.83	25.63	42.69
08/13/2022	34.31	117.04	11.94	23.93	39.83
08/14/2022	38.21	115.24	11.66	23.29	38.83
08/15/2022	25.39	118.55	11.85	23.64	39.40
08/16/2022	28.68	134.56	13.78	27.53	45.87
08/17/2022	25.79	85.33	8.68	17.29	28.80
08/18/2022	19.99	58.67	5.84	11.72	19.58
08/19/2022	88.65	85.89	7.68	15.34	25.54
08/20/2022	53.66	64.73	5.35	10.70	17.82
08/21/2022	67.71	109.02	10.13	20.32	33.82
08/22/2022	20.54	75.20	7.66	15.31	25.53
08/23/2022	27.40	77.29	7.79	15.53	25.89
08/24/2022	28.36	75.00	7.61	15.18	25.30
08/25/2022	32.79	73.08	7.34	14.63	24.39
08/26/2022	72.41	136.70	12.88	25.76	42.95
08/27/2022	33.87	124.44	13.01	26.03	43.36
08/28/2022	25.17	101.72	10.34	20.69	34.49
08/29/2022	30.65	119.02	12.14	24.27	40.47
08/30/2022	30.52	138.25	14.18	28.39	47.30
08/31/2022	33.36	149.46	15.16	30.35	50.57
Monthly Avg/Sum*:	1,193.49 *	3,458.03 *	346.42 *	692.75 *	1,154.68 *
Daily Min:	19.99	58.67	5.35	10.70	17.82
Daily Max:	88.65	149.46	15.16	30.35	50.57
Jul 2022 - Aug 2022	2,438.54	6,512.57	654.78	1,309.59	2,182.63
QTD:	2,438.54 *	6,512.57 *	654.78 *	1,309.59 *	2,182.63 *
YTD 2022:	9,661.96 *	15,788.56 *	1,602.31 *	3,205.40 *	5,343.39 *

Monthly Summary By Day Report

Units CT1 and CT2



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 19:14 Location: Roseville, CA

Red = Invalid Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

Limit Value:

	Units CT1 & CT2 CO, Lb 1 Hour(s)	Units CT1 & CT2 NOx, Lb 1 Hour(s)	Units CT1 & CT2 SO2, Lb 1 Hour(s)	Units CT1 & CT2 PM10, Lb 1 Hour(s)	Units CT1 & CT2 VOC, Lb 1 Hour(s)
09/01/2022	32.98	148.87	15.12	30.21	50.34
09/02/2022	41.38	155.87	15.88	31.71	52.89
09/03/2022	29.00	99.58	10.26	20.50	34.16
09/04/2022	32.33	107.43	11.06	22.11	36.91
09/05/2022	29.28	140.29	14.32	28.66	47.76
09/06/2022	35.09	158.54	16.06	32.14	53.54
09/07/2022	33.02	166.75	16.21	32.42	54.00
09/08/2022	34.92	166.17	16.63	33.26	55.41
09/09/2022	42.81	157.17	16.05	32.17	53.57
09/10/2022	28.90	98.50	10.47	20.94	34.90
09/11/2022	33.28	110.37	11.38	22.76	37.93
09/12/2022	31.16	107.51	11.13	22.21	37.04
09/13/2022	40.09	107.60	11.13	22.28	37.18
09/14/2022	23.60	92.08	9.47	18.96	31.61
09/15/2022	26.94	92.59	9.71	19.38	32.29
09/16/2022	18.99	82.94	8.52	17.02	28.38
09/17/2022	19.09	82.90	8.49	16.89	28.25
09/18/2022	24.61	94.86	9.65	19.24	32.08
09/19/2022	36.18	113.34	11.50	23.01	38.33
09/20/2022	38.99	116.89	11.84	23.68	39.50
09/21/2022	31.59	107.78	11.18	22.34	37.26
09/22/2022	63.62	90.80	9.26	18.50	30.84
09/23/2022	105.13	71.62	5.36	10.72	17.85
09/24/2022	29.80	105.73	10.82	21.66	36.11
09/25/2022	23.06	94.28	9.79	19.63	32.69
09/26/2022	21.84	89.93	9.33	18.66	31.14
09/27/2022	64.71	130.96	13.32	26.66	44.41
09/28/2022	21.14	96.87	10.05	20.09	33.48
09/29/2022	32.06	100.81	10.51	21.01	35.03
09/30/2022	23.82	90.89	9.90	19.82	33.03
Monthly Avg/Sum*:	1,049.41 *	3,379.92 *	344.40 *	688.64 *	1,147.91 *
Daily Min:	18.99	71.62	5.36	10.72	17.85
Daily Max:	105.13	166.75	16.63	33.26	55.41
Jul 2022 - Sep 2022	3,487.95	9,892.49	999.18	1,998.23	3,330.54
QTD:	3,487.95 *	9,892.49 *	999.18 *	1,998.23 *	3,330.54 *
YTD 2022:	10,711.37 *	19,168.48 *	1,946.71 *	3,894.04 *	6,491.30 *

Tons 12 Month Rolling Summary

CT1 and CT2 Combined



From: 07/01/2022 00:00 To: 09/30/2022 23:59 Facility Name: ROSEVILLE ENERGY
Generated: 10/01/2022 19:15 Location: Roseville, CA

* = Excess Emission

Date	Units CT1 & CT2		Units CT1 & CT2		Units CT1 & CT2		Units CT1 & CT2		Units CT1 & CT2	
	CO, Ton		NOx, Ton		PM10, Ton		SO2, Ton		VOC, Ton	
	1 Day(s)		1 Day(s)		1 Day(s)		1 Day(s)		1 Day(s)	
	Sum	Rolling Sum	Sum	Rolling Sum	Sum	Rolling Sum	Sum	Rolling Sum	Sum	Rolling Sum
Jul 2022	0.6226	6.7916	1.5269	13.6733	0.3084	2.8936	0.1544	1.4470	0.5141	4.8240
Aug 2022	0.5968	6.7917	1.7288	13.6468	0.3466	2.8593	0.1731	1.4296	0.5774	4.7658
Sep 2022	0.5247	6.7951	1.6900	13.8458	0.3443	2.8831	0.1723	1.4414	0.5740	4.8056
Sum/Avg	6.7951		13.8458		2.8831		1.4414		4.8056	
Limit Value										

Replace the dates with the ones you need

7/1/2022 0:00

9/30/2022 0:00

1D

TOWER AVG.

519-AIT-9504-1

3794

7/1/22 0:00	3445.4
7/2/22 0:00	2912.0
7/3/22 0:00	2689.4
7/4/22 0:00	2989.2
7/5/22 0:00	2879.7
7/6/22 0:00	3054.2
7/7/22 0:00	2908.1
7/8/22 0:00	2681.1
7/9/22 0:00	2961.5
7/10/22 0:00	3010.8
7/11/22 0:00	2898.4
7/12/22 0:00	3096.7
7/13/22 0:00	3583.1
7/14/22 0:00	3392.0
7/15/22 0:00	3521.2
7/16/22 0:00	3839.4
7/17/22 0:00	3641.8
7/18/22 0:00	4096.6
7/19/22 0:00	3747.9
7/20/22 0:00	3864.2
7/21/22 0:00	4070.4
7/22/22 0:00	3965.6
7/23/22 0:00	4279.4
7/24/22 0:00	4009.8
7/25/22 0:00	4087.0
7/26/22 0:00	4040.9
7/27/22 0:00	4457.6
7/28/22 0:00	4336.2
7/29/22 0:00	4033.5
7/30/22 0:00	4014.4
7/31/22 0:00	4076.0
8/1/22 0:00	4532.2
8/2/22 0:00	4435.9
8/3/22 0:00	4687.5
8/4/22 0:00	5134.2
8/5/22 0:00	4574.1
8/6/22 0:00	4986.1
8/7/22 0:00	4511.8
8/8/22 0:00	4789.1
8/9/22 0:00	4409.6
8/10/22 0:00	4103.4
8/11/22 0:00	5084.8
8/12/22 0:00	3807.0
8/13/22 0:00	4237.2
8/14/22 0:00	3990.2
8/15/22 0:00	4090.9
8/16/22 0:00	4506.9
8/17/22 0:00	4174.9
8/18/22 0:00	4196.7

8/19/22 0:00	4155.9
8/20/22 0:00	4028.6
8/21/22 0:00	3966.2
8/22/22 0:00	3466.9
8/23/22 0:00	3499.1
8/24/22 0:00	3456.5
8/25/22 0:00	3415.1
8/26/22 0:00	3095.4
8/27/22 0:00	3411.4
8/28/22 0:00	3559.4
8/29/22 0:00	3214.4
8/30/22 0:00	3186.3
8/31/22 0:00	3497.9
9/1/22 0:00	3366.6
9/2/22 0:00	4001.0
9/3/22 0:00	3702.4
9/4/22 0:00	4452.0
9/5/22 0:00	4376.9
9/6/22 0:00	4322.3
9/7/22 0:00	4338.1
9/8/22 0:00	4430.2
9/9/22 0:00	5090.6
9/10/22 0:00	4696.3
9/11/22 0:00	4059.9
9/12/22 0:00	4362.7
9/13/22 0:00	4197.0
9/14/22 0:00	4146.0
9/15/22 0:00	3674.2
9/16/22 0:00	3730.2
9/17/22 0:00	3861.8
9/18/22 0:00	3488.7
9/19/22 0:00	3807.4
9/20/22 0:00	3158.7
9/21/22 0:00	3282.6
9/22/22 0:00	3382.9
9/23/22 0:00	3003.2
9/24/22 0:00	2596.5
9/25/22 0:00	2449.0
9/26/22 0:00	3047.1
9/27/22 0:00	2696.0
9/28/22 0:00	2989.8

Resize to show all values

ROSEVILLE ENERGY PARK COOLING TOWER EMISSIONS

POLLUTANT	LBS PER DAY	QUARTER 1	QUARTER 2	QUARTER 3	QUARTER 4
PM-10	16.3	1471	1487	1504	1504

Whereas compliance with the PM-10 emission limit shall be demonstrated as;
Cooling tower recirculation rate * total dissolved solids of blowdown * design drift rate

<u>Circ pump flow rate</u>	53814	Gallons per minute
	* 8.33	Pounds per gallon
	* 1440	Minutes per day
	64,550,969	Pounds per day

<u>Total dissolved solids</u>	3794	Average daily conductivity umhos
	0.00000064	Conversion to TDS ppm
	0.00242816	

<u>Design drift rate</u>	0.005%

PM-10 pounds per day	7.84

92	Days in quarter

PM-10 pounds this quarter	721	3Q22

fill only these

ATTACHMENT 20

AQ68

AQ68 A water sample analysis of cooling tower water shall be performed within 180 days of initial operation and annually thereafter.

Verification: The Project owner shall submit to the CPM and the PCAPCD the initial and annual cooling tower water sample analysis for approval no later than 60 days following the date of test performance.

The Cooling Tower Water Analysis was reported with the 2Q21 QAQR.

ATTACHMENT 21

AQ-69

AQ-69 No emissions are permitted, from any source, which are a nuisance per PCAPCD Rule 205, Nuisance.

Verification: The Project owner shall report all violations of this condition as noticed by the PCAPCD as well as any offsite nuisance complaints as part of the Quarterly Air Quality Report in Condition of Certification AQ-SC6

In regards to AQ-69 of Roseville Energy Park's 3Q22 QAQR, there were no violations of PCAPCD's Rule 205 for nuisance.

ATTACHMENT 22

AQ-70

AQ-70 PM-10 emission rates from the cooling tower shall not exceed the following limits

Cooling Tower Emissions Limitations					
Pollutant	Lbs/day	Quarter 1	Quarter 2	Quarter 3	Quarter 4
PM 10	16.3	1471	1487	1504	1504

Verification: the Project owner shall include all the necessary emissions data to demonstrate compliance with the emissions limits provided in this Condition as part of the Quarterly air Quality Report required in condition of Certification AQ-SC6.

Replace the dates with the ones you need

7/1/2022 0:00

9/30/2022 0:00

1D

TOWER AVG.

519-AIT-9504-1

3794

7/1/22 0:00	3445.4
7/2/22 0:00	2912.0
7/3/22 0:00	2689.4
7/4/22 0:00	2989.2
7/5/22 0:00	2879.7
7/6/22 0:00	3054.2
7/7/22 0:00	2908.1
7/8/22 0:00	2681.1
7/9/22 0:00	2961.5
7/10/22 0:00	3010.8
7/11/22 0:00	2898.4
7/12/22 0:00	3096.7
7/13/22 0:00	3583.1
7/14/22 0:00	3392.0
7/15/22 0:00	3521.2
7/16/22 0:00	3839.4
7/17/22 0:00	3641.8
7/18/22 0:00	4096.6
7/19/22 0:00	3747.9
7/20/22 0:00	3864.2
7/21/22 0:00	4070.4
7/22/22 0:00	3965.6
7/23/22 0:00	4279.4
7/24/22 0:00	4009.8
7/25/22 0:00	4087.0
7/26/22 0:00	4040.9
7/27/22 0:00	4457.6
7/28/22 0:00	4336.2
7/29/22 0:00	4033.5
7/30/22 0:00	4014.4
7/31/22 0:00	4076.0
8/1/22 0:00	4532.2
8/2/22 0:00	4435.9
8/3/22 0:00	4687.5
8/4/22 0:00	5134.2
8/5/22 0:00	4574.1
8/6/22 0:00	4986.1
8/7/22 0:00	4511.8
8/8/22 0:00	4789.1
8/9/22 0:00	4409.6
8/10/22 0:00	4103.4
8/11/22 0:00	5084.8
8/12/22 0:00	3807.0
8/13/22 0:00	4237.2
8/14/22 0:00	3990.2
8/15/22 0:00	4090.9
8/16/22 0:00	4506.9
8/17/22 0:00	4174.9
8/18/22 0:00	4196.7

8/19/22 0:00	4155.9
8/20/22 0:00	4028.6
8/21/22 0:00	3966.2
8/22/22 0:00	3466.9
8/23/22 0:00	3499.1
8/24/22 0:00	3456.5
8/25/22 0:00	3415.1
8/26/22 0:00	3095.4
8/27/22 0:00	3411.4
8/28/22 0:00	3559.4
8/29/22 0:00	3214.4
8/30/22 0:00	3186.3
8/31/22 0:00	3497.9
9/1/22 0:00	3366.6
9/2/22 0:00	4001.0
9/3/22 0:00	3702.4
9/4/22 0:00	4452.0
9/5/22 0:00	4376.9
9/6/22 0:00	4322.3
9/7/22 0:00	4338.1
9/8/22 0:00	4430.2
9/9/22 0:00	5090.6
9/10/22 0:00	4696.3
9/11/22 0:00	4059.9
9/12/22 0:00	4362.7
9/13/22 0:00	4197.0
9/14/22 0:00	4146.0
9/15/22 0:00	3674.2
9/16/22 0:00	3730.2
9/17/22 0:00	3861.8
9/18/22 0:00	3488.7
9/19/22 0:00	3807.4
9/20/22 0:00	3158.7
9/21/22 0:00	3282.6
9/22/22 0:00	3382.9
9/23/22 0:00	3003.2
9/24/22 0:00	2596.5
9/25/22 0:00	2449.0
9/26/22 0:00	3047.1
9/27/22 0:00	2696.0
9/28/22 0:00	2989.8

Resize to show all values

ROSEVILLE ENERGY PARK COOLING TOWER EMISSIONS

POLLUTANT	LBS PER DAY	QUARTER 1	QUARTER 2	QUARTER 3	QUARTER 4
PM-10	16.3	1471	1487	1504	1504

Whereas compliance with the PM-10 emission limit shall be demonstrated as;
Cooling tower recirculation rate * total dissolved solids of blowdown * design drift rate

<u>Circ pump flow rate</u>	53814	Gallons per minute
	* 8.33	Pounds per gallon
	* 1440	Minutes per day
	64,550,969	Pounds per day

<u>Total dissolved solids</u>	3794	Average daily conductivity umhos
	0.00000064	Conversion to TDS ppm
	0.00242816	

<u>Design drift rate</u>	0.005%

PM-10 pounds per day	7.84

92	Days in quarter

PM-10 pounds this quarter	721	3Q22

fill only these

ATTACHMENT 23

AQ-71

AQ-71 Compliance with the cooling tower PM-10 emission limit shall be demonstrated as follows: $\text{PM-10} = \text{cooling water recirculation rate} * \text{total dissolved solids concentration in the blow down water} * \text{design drift rate}$.

Verification: the Project owner shall include all the necessary emissions data to demonstrate compliance with the emissions limits provided in this Condition as part of the Quarterly air Quality Report required in condition of Certification AQ-SC6.

Replace the dates with the ones you need

7/1/2022 0:00

9/30/2022 0:00

1D

TOWER AVG.

519-AIT-9504-1

3794

7/1/22 0:00	3445.4
7/2/22 0:00	2912.0
7/3/22 0:00	2689.4
7/4/22 0:00	2989.2
7/5/22 0:00	2879.7
7/6/22 0:00	3054.2
7/7/22 0:00	2908.1
7/8/22 0:00	2681.1
7/9/22 0:00	2961.5
7/10/22 0:00	3010.8
7/11/22 0:00	2898.4
7/12/22 0:00	3096.7
7/13/22 0:00	3583.1
7/14/22 0:00	3392.0
7/15/22 0:00	3521.2
7/16/22 0:00	3839.4
7/17/22 0:00	3641.8
7/18/22 0:00	4096.6
7/19/22 0:00	3747.9
7/20/22 0:00	3864.2
7/21/22 0:00	4070.4
7/22/22 0:00	3965.6
7/23/22 0:00	4279.4
7/24/22 0:00	4009.8
7/25/22 0:00	4087.0
7/26/22 0:00	4040.9
7/27/22 0:00	4457.6
7/28/22 0:00	4336.2
7/29/22 0:00	4033.5
7/30/22 0:00	4014.4
7/31/22 0:00	4076.0
8/1/22 0:00	4532.2
8/2/22 0:00	4435.9
8/3/22 0:00	4687.5
8/4/22 0:00	5134.2
8/5/22 0:00	4574.1
8/6/22 0:00	4986.1
8/7/22 0:00	4511.8
8/8/22 0:00	4789.1
8/9/22 0:00	4409.6
8/10/22 0:00	4103.4
8/11/22 0:00	5084.8
8/12/22 0:00	3807.0
8/13/22 0:00	4237.2
8/14/22 0:00	3990.2
8/15/22 0:00	4090.9
8/16/22 0:00	4506.9
8/17/22 0:00	4174.9
8/18/22 0:00	4196.7

8/19/22 0:00	4155.9
8/20/22 0:00	4028.6
8/21/22 0:00	3966.2
8/22/22 0:00	3466.9
8/23/22 0:00	3499.1
8/24/22 0:00	3456.5
8/25/22 0:00	3415.1
8/26/22 0:00	3095.4
8/27/22 0:00	3411.4
8/28/22 0:00	3559.4
8/29/22 0:00	3214.4
8/30/22 0:00	3186.3
8/31/22 0:00	3497.9
9/1/22 0:00	3366.6
9/2/22 0:00	4001.0
9/3/22 0:00	3702.4
9/4/22 0:00	4452.0
9/5/22 0:00	4376.9
9/6/22 0:00	4322.3
9/7/22 0:00	4338.1
9/8/22 0:00	4430.2
9/9/22 0:00	5090.6
9/10/22 0:00	4696.3
9/11/22 0:00	4059.9
9/12/22 0:00	4362.7
9/13/22 0:00	4197.0
9/14/22 0:00	4146.0
9/15/22 0:00	3674.2
9/16/22 0:00	3730.2
9/17/22 0:00	3861.8
9/18/22 0:00	3488.7
9/19/22 0:00	3807.4
9/20/22 0:00	3158.7
9/21/22 0:00	3282.6
9/22/22 0:00	3382.9
9/23/22 0:00	3003.2
9/24/22 0:00	2596.5
9/25/22 0:00	2449.0
9/26/22 0:00	3047.1
9/27/22 0:00	2696.0
9/28/22 0:00	2989.8

Resize to show all values

ROSEVILLE ENERGY PARK COOLING TOWER EMISSIONS

POLLUTANT	LBS PER DAY	QUARTER 1	QUARTER 2	QUARTER 3	QUARTER 4
PM-10	16.3	1471	1487	1504	1504

Whereas compliance with the PM-10 emission limit shall be demonstrated as;
Cooling tower recirculation rate * total dissolved solids of blowdown * design drift rate

<u>Circ pump flow rate</u>	53814	Gallons per minute
	* 8.33	Pounds per gallon
	* 1440	Minutes per day
	64,550,969	Pounds per day

<u>Total dissolved solids</u>	3794	Average daily conductivity umhos
	0.00000064	Conversion to TDS ppm
	0.00242816	

<u>Design drift rate</u>	0.005%

PM-10 pounds per day	7.84

92	Days in quarter

PM-10 pounds this quarter	721	3Q22

fill only these

ATTACHMENT 24

AQ-86

AQ-86 Operation for maintenance and testing of the emergency diesel engine and generator shall be limited to 50 hours per year.

Verification: The Project owner shall include all necessary operational data to demonstrate compliance with the limits provided in this Condition as part of the Quarterly Air Quality Report required in Condition of Certification AQ-SC6.

DATE	INITIALS	START	END	REASON	HOURS TOTAL	MINUTES YTD
7/10/22	DE	1120	1150	BI-WEEKLY TEST RUN	125	395
7/20/22	DWN	1455	1525	Bi-Weekly Test Run	125	425
8/7/22	DE	1212	1242	BI-WEEKLY TEST RUN	126	455
8.21.22	CYC	1655	1755	Bi-weekly Test Run	126	485
8/31/22	DE	0952	1012	CD POWER POST MAINTENANCE RUN	127	505
9-17-22	DN	1410	1440	Bi-weekly test Run	127	535
9.24.22	CYC	1520	1534	Aborted. Redundant Test Run	127	550
10/2/22	DE	1230	1300	BI-WEEKLY TEST RUN	128	580

ATTACHMENT 25

AQ-87

AQ-87 Operation for other than maintenance and testing purposes shall be limited to involuntary interruptions of electrical power. Operation shall not exceed 24 hours without prior authorization by the Air Pollution Control Officer.

Verification: The Project owner shall include all necessary operational data to demonstrate compliance with the limits provided in this Condition as part of the Quarterly Air Quality Report required in Condition of Certification AQ-SC6.

24

Date

Time
Start

Reason

Time
Stop

Initials

Total
Hours

2020: 199.3

YTD
Hours

8/3/21	1519	Weekly Test Run	1549	ZKR	212.1	12.8
8-21-21	1131	Weekly test Run	1201	JM	212.6	12.8
9-2-21	0902	Weekly Test Run	0932	LH	213.1	13.3
9-12-2021	1628	WEEKLY TEST RUN	1658	JAB	213.6	13.8
9-19-21	1150	Weekly Test Run	1220	DWN	214.1	14.8
9-25-21	1239	Weekly Test Run	1309	JM	214.6	15.3
10-3-21	1410	Weekly Test Run	1440	KRO	215.1	15.8
10-11-2021	1640	WEEKLY TEST RUN	1710	JAB	215.6	16.3
10-16-21	1307	Weekly test Run	1330	JM	216.1	16.8
10-24-21	1553	WEEKLY TEST RUN	1623	RL	216.6	17.3
10-31-21	1351	Weekly test Run	1421	KRO	217.1	17.8
11-7-2021	1354	WEEKLY TEST RUN	1424	JAB	217.6	18.3
11-14-2021	1444	WEEKLY TEST RUN	1514	JAB	218.1	18.8
11-21-21	1203	Weekly Test Run	1233	DE	218.6	19.3
11-24-21	09:46	Fill Diesel TANK	09:48	LH	80 gallons	
11-28-21	1347	Weekly Test Run	1417	DE	219.1	19.8
12/5/2021	1445	WEEKLY TEST RUN	1515	JAB	219.6	20.3
12-12-21	1150	Weekly Test Run	1220	DWN	220.1	20.8
12-19-21	1553	WEEKLY TEST RUN	1623	RL	220.6	21.3
12-26-21	1514	Weekly Test Run	1544	LH	221.1	21.8
1-2-2022	1547	WEEKLY TEST RUN	1617	JAB	221.6	22.3

2022

Starting Hours 221.1

1-2-22	1547	Weekly Test Run	1617	JAB	221.6	0.5
1/10/22	0330	Weekly Test Run	0400	DE	222.1	1.0
1/16/22	1318	Weekly Test Run	1348	ZKR	222.6	1.5
1/23/22	1223	Weekly test Run	1253	KRO	223.1	2.0
1-25-22	16:10	Weekly Test Run	16:40	LH	223.6	2.5
2-5-22	1415	Weekly test Run	1445	JM	224.1	3
2-14-22	1205	Weekly Test Run	1235	ZKR	224.6	3.5
2-21-2022	1430	WEEKLY TEST RUN	1500	JAB	225.1	4.0
2-27-2022	1405	WEEKLY TEST RUN	1435	JAB	225.6	4.5
3-5-22	1454	Weekly test Run	1524	JM	226.1	5.0
3-11-22	0915	DIESEL FUEL DELIVERY	48 GALS	AB		
3/13/22	1213	WEEKLY TEST RUN	1243	DE	226.6	5.5
3/20/22	1310	WEEKLY TEST RUN	1340	DE	227.1	6.0
3-27-2022	1320	WEEKLY TEST RUN	1350	JAB	227.6	6.5

25

DATE

START

REASON

STOP

TOTAL HRS

YTD

INITIALS


4-3-22	1500	Weekly Test Run	1530	228.1	7.0	DWN
4-30-22	0855	Weekly test Run	0925	230.4	9.0	JM
5-8-22	1444	Weekly Test Run	1512	230.6	9.5	ZKR
5-15-22	14:55	WEEKLY TEST RUN	15:25	231.1	10.0	ED
5-22-2022	1311	WEEKLY TEST RUN	1341	231.6	10.5	JAB
5-28-22	1510	Weekly test Run	1540	232.1	11	JM
6-5-22	1440	WEEKLY TEST RUN	1510	232.6	11.5	RL
6-12-22	16:20	WEEKLY Test Run	16:50	233.1	12.0	LH
6-20-22	1200	WEEKLY TEST RUN	1230	233.6	12.5	RL
6-25-22	1042	Weekly test Run	1112	234.1	13	JM
7/3/22	1326	WEEKLY TEST RUN	1356	234.6	13.5	DE
7/10/22	1040	WEEKLY TEST RUN	1110	235.1	14.0	DE
7/17/2022	1342	WEEKLY TEST RUN	1412	235.6	14.5	JAB
7-21-22	1139	Weekly test Run	1209	236.1	15	RL
7-31-22	1320	WEEKLY TEST RUN	1350	236.6	15.5	RL
8/7/22	1317	WEEKLY TEST RUN	1347	237.1	16.0	DE
8-14-2022	1338	WEEKLY TEST RUN	1408	237.6	16.5	JAB
8-21-22	1609	Weekly Test Run	1639	238.1	17.0	JM
8-28-22	1454	Weekly Test Run	1524	238.6	17.5	ZKR
9-6-22	0949	Weekly Test Run	1019	239.1	18.0	LH
9-11-22	13:33	WEEKLY TEST RUN	1403	239.6	18.5	RL
9-17-22	10:52	Weekly test Run	11:22	240.1	19	JM
9-25-22	11:55	Weekly Test Run	12:25	240.6	19.5	ZKR
10/2/22	1310	WEEKLY TEST RUN	1340	241.1	20.0	DE

ATTACHMENT 26

AQ-88

AQ-88 The Sulfur content of the Diesel fuel used shall not exceed 15 ppm by weight.

Verification: The Project owner shall include a summary of diesel fuel purchase records showing amounts delivered, date delivered and fuel type with the Quarterly Air Quality Report as required in Condition of Certification AQ-SC6.

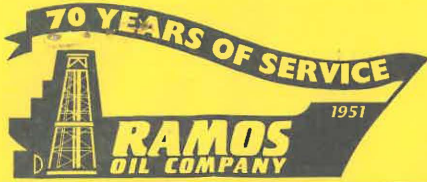

01 Sacramento	916-371-2570	10 Rio Vista Shell	707-374-5620
02 Clarksburg	916-744-1012	11 Marysville	530-743-4647
03 Dixon	707-678-2061	14 Lincoln	916-645-2179
04 Fairfield	707-425-5780	24 San Jose	408-321-8242
06 Woodland	530-661-1200	27 Stockton	209-465-6255
08 Williams	530-473-2811		
09 Isleton	916-777-5545		

P.O. BOX 401 • WEST SACRAMENTO, CA 95691 • (916) 371-2570 • FOR FUELS CALL 916-371-6495

REMIT TO: Ramos Oil Co., Inc.
PO Box 401
West Sacramento, CA 95691

HAZARDOUS MATERIAL EMERGENCY
CALL 1-800-456-7745

DEF (Diesel Exhaust Fluid)
NOW AVAILABLE!

TO PAY ONLINE GO TO OUR WEBSITE
www.ramosoil.com

SOLD TO: ROSEVILLE ENERGY PARK
CITY OF ROSEVILLE
5120 PHILLIP RD
ROSEVILLE, CA 95747

SHIP TO: ROSEVILLE ENERGY PARK
CITY OF ROSEVILLE
5120 PHILLIP RD
ROSEVILLE, CA 95747

CUST. PURCHASE ORDER NUMBER		SALESMAN		TERMS		DEL. ZONE		DUE DATE	
0007936		JOSH GRAVES		Net 30 Days		0		10-30-22	
DELIVERY DATE		DRIVER		TRUCK NUMBER		TERMINAL		B / L NUMBER	
09-30-22		751		29180		11			
NO. OF PKG'S	BULK OR SIZE	PRODUCT DELIVERED	ORDERED	DELIVERED	TAXES		PRICE	AMOUNT	
		NA1993, RED DYED DIESEL COMBUSTIBLE, 3, PGIII #2D 15ppm sulfur (maximum) Dyed Diesel fuel non taxable use only, penalty for taxable use. BULK DSL #2 DYED CARB ULTRA LOW REG CA OIL SPILL TAX L.U.S.T. TAX FED OIL SPILL TAX AB 32 DSL IMPLEMENTATION FEE ENVIRONMENTAL SURCHARGE *** DELIVERY MESSAGE *** PO REQUIRED RED DSL FORM ON FILE	100	52					
LOAD		UNLOADING		MISC. CHARGES		TRIP MILES			
ARRIVED		ARRIVED		PUMP		TERMINAL TO CUSTOMER			
BEGAN LOADING		BEGAN UNLOADING		DEM. HRS.					
FINISHED		FINISHED		SPLIT DEL.					
TOTAL TIME		TOTAL TIME		SPLIT LOAD					
				BRIDGE TOLL					
COMMENTS									
PRODUCT		PREMIUM		UNLEADED PLUS		UNLEADED		DIESEL	
GROSS								SALES TAX	
NET								TOTAL	
CUSTOMER AGREES TO PAY FINANCE CHARGE ON PAST DUE BALANCE OF 1.5% PER MONTH OR THE MAXIMUM RATE ALLOWED IN CUSTOMER'S STATE OF RESIDENCE. WHICHEVER IS LESS; AND FURTHER AGREES TO PAY REASONABLE ATTORNEY'S FEES AND COSTS IF COLLECTION IS REQUIRED. VENUE FOR PURPOSES OF ENDORSEMENT OF THIS OBLIGATION SHALL BE YOLO COUNTY.									
ALL CLAIMS FOR ENVIRONMENTAL DAMAGE DURING DELIVERY OF ANY RAMOS OIL PRODUCT MUST BE MADE WITHIN 15 DAYS FOLLOWING DELIVERY.									
DELIVERED BY (SIGNATURE IN FULL) X					RECEIVED IN GOOD ORDER X				

ATTACHMENT 27


AQ-89

AQ-89 Records of operation and maintenance shall be kept by the owner or Operator for a period of five years and shall be made available to the PCAPCD upon request. Information required for reporting to the PCAPCD includes, but is not limited to:

1. The hours of operation the engine was run for maintenance and testing;
2. The hours of operation the engine was run during interruption of electrical power; and
3. Records of the sulfur content of the diesel used.

VERIFICATION: The Project owner shall include these records as part of the Quarterly Air Quality Report required in Condition of Certification AQ-SC6.

DATE	INITIALS	START	END	REASON	HOURS TOTAL	MINUTES YTD
7/10/22	DE	1120	1150	Bi-Weekly Test Run	125	395
7/20/22	DWN	1455	1525	Bi-Weekly Test Run	125	425
8/7/22	DE	1212	1242	Bi-Weekly Test Run	126	455
8.21.22	CYC	1655	1755	Bi-Weekly Test Run	126	485
8/31/22	DE	0952	1012	CD POWER POST MAINTENANCE RUN	127	505
9-17-22	DN	1410	1440	Bi-weekly test Run	127	535
9.24.22	CYC	1520	1534	Aborted. Redundant Test Run	127	550
10/2/22	DE	1230	1300	Bi-Weekly Test Run	128	580

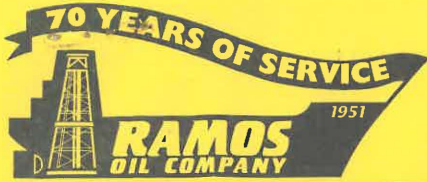

01 Sacramento	916-371-2570	10 Rio Vista Shell	707-374-5620
02 Clarksburg	916-744-1012	11 Marysville	530-743-4647
03 Dixon	707-678-2061	14 Lincoln	916-645-2179
04 Fairfield	707-425-5780	24 San Jose	408-321-8242
06 Woodland	530-661-1200	27 Stockton	209-465-6255
08 Williams	530-473-2811		
09 Isleton	916-777-5545		

P.O. BOX 401 • WEST SACRAMENTO, CA 95691 • (916) 371-2570 • FOR FUELS CALL 916-371-6495

REMIT TO: Ramos Oil Co., Inc.
PO Box 401
West Sacramento, CA 95691

HAZARDOUS MATERIAL EMERGENCY
CALL 1-800-456-7745

DEF (Diesel Exhaust Fluid)
NOW AVAILABLE!

TO PAY ONLINE GO TO OUR WEBSITE
www.ramosoil.com

SOLD TO: ROSEVILLE ENERGY PARK
CITY OF ROSEVILLE
5120 PHILLIP RD
ROSEVILLE, CA 95747

SHIP TO: ROSEVILLE ENERGY PARK
CITY OF ROSEVILLE
5120 PHILLIP RD
ROSEVILLE, CA 95747

CUST. PURCHASE ORDER NUMBER		SALESMAN		TERMS		DEL. ZONE		DUE DATE	
0007936		JOSH GRAVES		Net 30 Days		0		10-30-22	
DELIVERY DATE		DRIVER		TRUCK NUMBER		TERMINAL		B / L NUMBER	
09-30-22		751		29180		11			
NO. OF PKG'S	BULK OR SIZE	PRODUCT DELIVERED	ORDERED	DELIVERED	TAXES		PRICE	AMOUNT	
		NA1993, RED DYED DIESEL COMBUSTIBLE, 3, PGIII #2D 15ppm sulfur (maximum) Dyed Diesel fuel non taxable use only, penalty for taxable use. BULK DSL #2 DYED CARB ULTRA LOW REG CA OIL SPILL TAX L.U.S.T. TAX FED OIL SPILL TAX AB 32 DSL IMPLEMENTATION FEE ENVIRONMENTAL SURCHARGE *** DELIVERY MESSAGE *** PO REQUIRED RED DSL FORM ON FILE	100	52					
LOAD		UNLOADING		MISC. CHARGES		TRIP MILES			
ARRIVED		ARRIVED		PUMP		TERMINAL TO CUSTOMER			
BEGAN LOADING		BEGAN UNLOADING		DEM. HRS.					
FINISHED		FINISHED		SPLIT DEL.					
TOTAL TIME		TOTAL TIME		SPLIT LOAD					
				BRIDGE TOLL					
COMMENTS									
PRODUCT		PREMIUM		UNLEADED PLUS		UNLEADED		DIESEL	
GROSS								SALES TAX	
NET								TOTAL	
CUSTOMER AGREES TO PAY FINANCE CHARGE ON PAST DUE BALANCE OF 1.5% PER MONTH OR THE MAXIMUM RATE ALLOWED IN CUSTOMER'S STATE OF RESIDENCE. WHICHEVER IS LESS; AND FURTHER AGREES TO PAY REASONABLE ATTORNEY'S FEES AND COSTS IF COLLECTION IS REQUIRED. VENUE FOR PURPOSES OF ENDORSEMENT OF THIS OBLIGATION SHALL BE YOLO COUNTY.									
ALL CLAIMS FOR ENVIRONMENTAL DAMAGE DURING DELIVERY OF ANY RAMOS OIL PRODUCT MUST BE MADE WITHIN 15 DAYS FOLLOWING DELIVERY.									
DELIVERED BY (SIGNATURE IN FULL) X					RECEIVED IN GOOD ORDER X				

ATTACHMENT 28

AQ-90

AQ-90 No emissions are permitted, from any source, which are a nuisance per PCAPCD Rule 205, Nuisance.

Verification: The Project owner shall report all violations of this condition as noticed by the PCAPCD as well as any offsite nuisance complaints as part of the Quarterly Air Quality Report in Condition of Certification AQ-SC6.

In regards to AQ-90 of Roseville Energy Park's 3Q22 QAQR, there were no violations of PCAPCD's Rule 205 for nuisance.

ATTACHMENT 29

AQ-91

AQ-91 Stack emission opacity as dark as Ringelmann No. 1 (20% opacity) for periods aggregating more than 3 minutes in any one hour is prohibited and is in violation of PCAPCD Rule 202, Visible Emissions.

Verification: The Project owner shall report all violations of this condition as noticed by the PCAPCD as well as any offsite nuisance complaints as part of the Quarterly Air Quality Report in Condition of Certification AQ-SC6.

In regards to AQ-91 of Roseville Energy Park's 3Q22 QAQR, there were no violations of PCAPCD's Rule 202 for opacity from the diesel fire pump.

ATTACHMENT 30

AQ-99

AQ-99 Operation for maintenance and testing of the emergency diesel engine and generator shall be limited to 50 hours per year.

Verification: The Project shall include all necessary operational data to demonstrate compliance with the limits provided as part of the Quarterly Air Quality Report in Condition of Certification AQ-SC6

DATE	INITIALS	START	END	REASON	HOURS TOTAL	MINUTES YTD
7/10/22	DE	1120	1150	BI-WEEKLY TEST RUN	125	395
7/20/22	DWN	1455	1525	Bi-Weekly Test Run	125	425
8/7/22	DE	1212	1242	BI-WEEKLY TEST RUN	126	455
8.21.22	CYC	1655	1755	Bi-weekly Test Run	126	485
8/31/22	DE	0952	1012	CD POWER POST MAINTENANCE RUN	127	505
9-17-22	DN	1410	1440	Bi-weekly test Run	127	535
9.24.22	CYC	1520	1534	Aborted. Redundant Test Run	127	550
10/2/22	DE	1230	1300	BI-WEEKLY TEST RUN	128	580

ATTACHMENT 31

AQ-100

AQ-100 In regards to the Emergency diesel Generator; Operation for other than maintenance and testing purposes shall be limited to involuntary interruptions of electrical power. Operation shall not exceed 24 hours without prior authorization by the Air Pollution Control Officer.


DATE	INITIALS	START	END	REASON	HOURS TOTAL	MINUTES YTD
7/10/22	DE	1120	1150	Bi-weekly Test Run	125	395
7/20/22	DWN	1455	1525	Bi-weekly Test Run	125	425
8/7/22	DE	1212	1242	Bi-weekly Test Run	126	455
8.21.22	CYC	1655	1755	Bi-weekly Test Run	126	485
8/31/22	DE	0952	1012	CD POWER POST MAINTENANCE RUN	127	505
9-17-22	DN	1410	1440	Bi-weekly Test Run	127	535
9.24.22	CYC	1520	1534	Aborted. Redundant Test Run	127	550
10/2/22	DE	1230	1300	Bi-weekly Test Run	128	580

ATTACHMENT 32

AQ-101

AQ-101 The sulfur content of the diesel used shall not exceed 15ppm by weight

Verification: The Project owner shall include a summary of diesel fuel purchase records showing amounts delivered, date delivered and fuel type with the Quarterly Air Quality Report in Condition of Certification AQ-SC6

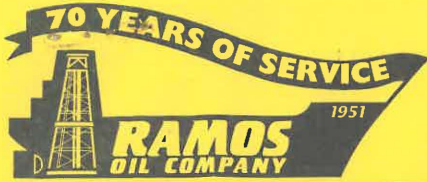

01 Sacramento	916-371-2570	10 Rio Vista Shell	707-374-5620
02 Clarksburg	916-744-1012	11 Marysville	530-743-4647
03 Dixon	707-678-2061	14 Lincoln	916-645-2179
04 Fairfield	707-425-5780	24 San Jose	408-321-8242
06 Woodland	530-661-1200	27 Stockton	209-465-6255
08 Williams	530-473-2811		
09 Isleton	916-777-5545		

P.O. BOX 401 • WEST SACRAMENTO, CA 95691 • (916) 371-2570 • FOR FUELS CALL 916-371-6495

REMIT TO: Ramos Oil Co., Inc.
PO Box 401
West Sacramento, CA 95691

HAZARDOUS MATERIAL EMERGENCY
CALL 1-800-456-7745

DEF (Diesel Exhaust Fluid)
NOW AVAILABLE!

TO PAY ONLINE GO TO OUR WEBSITE
www.ramosoil.com

SOLD TO: ROSEVILLE ENERGY PARK
CITY OF ROSEVILLE
5120 PHILLIP RD
ROSEVILLE, CA 95747

SHIP TO: ROSEVILLE ENERGY PARK
CITY OF ROSEVILLE
5120 PHILLIP RD
ROSEVILLE, CA 95747

CUST. PURCHASE ORDER NUMBER		SALESMAN		TERMS		DEL. ZONE		DUE DATE	
0007936		JOSH GRAVES		Net 30 Days		0		10-30-22	
DELIVERY DATE		DRIVER		TRUCK NUMBER		TERMINAL		B / L NUMBER	
09-30-22		751		29180		11			
NO. OF PKG'S	BULK OR SIZE	PRODUCT DELIVERED	ORDERED	DELIVERED	TAXES		PRICE	AMOUNT	
		NA1993, RED DYED DIESEL COMBUSTIBLE, 3, PGIII #2D 15ppm sulfur (maximum) Dyed Diesel fuel non taxable use only, penalty for taxable use. BULK DSL #2 DYED CARB ULTRA LOW REG CA OIL SPILL TAX L.U.S.T. TAX FED OIL SPILL TAX AB 32 DSL IMPLEMENTATION FEE ENVIRONMENTAL SURCHARGE *** DELIVERY MESSAGE *** PO REQUIRED RED DSL FORM ON FILE	100	52					
LOAD		UNLOADING		MISC. CHARGES		TRIP MILES			
ARRIVED		ARRIVED		PUMP		TERMINAL TO CUSTOMER			
BEGAN LOADING		BEGAN UNLOADING		DEM. HRS.					
FINISHED		FINISHED		SPLIT DEL.					
TOTAL TIME		TOTAL TIME		SPLIT LOAD					
				BRIDGE TOLL					
COMMENTS									
PRODUCT		PREMIUM		UNLEADED PLUS		UNLEADED		DIESEL	
GROSS								SALES TAX	
NET								TOTAL	
CUSTOMER AGREES TO PAY FINANCE CHARGE ON PAST DUE BALANCE OF 1.5% PER MONTH OR THE MAXIMUM RATE ALLOWED IN CUSTOMER'S STATE OF RESIDENCE. WHICHEVER IS LESS; AND FURTHER AGREES TO PAY REASONABLE ATTORNEY'S FEES AND COSTS IF COLLECTION IS REQUIRED. VENUE FOR PURPOSES OF ENDORSEMENT OF THIS OBLIGATION SHALL BE YOLO COUNTY.									
ALL CLAIMS FOR ENVIRONMENTAL DAMAGE DURING DELIVERY OF ANY RAMOS OIL PRODUCT MUST BE MADE WITHIN 15 DAYS FOLLOWING DELIVERY.									
DELIVERED BY (SIGNATURE IN FULL) X					RECEIVED IN GOOD ORDER X				

ATTACHMENT 33


AQ-102

AQ-102 Records of operation and maintenance shall be kept by the owner or operator for a period of five years and shall be made available to the PCAPCD by request. Information required for reporting to the PCAPCD includes, but is not limited to:

- A. Hours of operation the engine was run for maintenance and testing
- B. Hours of operation the engine was run during interruption of electrical power
- C. Records of sulfur content of the diesel fuel used

Verification: The Project owner shall include these records as part of the Quarterly Air Quality Report in Condition of Certification AQ-SC6

DATE	INITIALS	START	END	REASON	HOURS TOTAL	MINUTES YTD
7/10/22	DE	1120	1150	Bi-weekly Test Run	125	395
7/20/22	DWN	1455	1525	Bi-weekly Test Run	125	425
8/7/22	DE	1212	1242	Bi-weekly Test Run	126	455
8.21.22	CYC	1655	1755	Bi-weekly Test Run	126	485
8/31/22	DE	0952	1012	CD POWER POST MAINTENANCE RUN	127	505
9-17-22	DN	1410	1440	Bi-weekly Test Run	127	535
9.24.22	CYC	1520	1534	Aborted. Redundant Test Run	127	550
10/2/22	DE	1230	1300	Bi-weekly Test Run	128	580

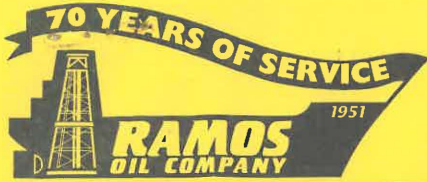

01 Sacramento	916-371-2570	10 Rio Vista Shell	707-374-5620
02 Clarksburg	916-744-1012	11 Marysville	530-743-4647
03 Dixon	707-678-2061	14 Lincoln	916-645-2179
04 Fairfield	707-425-5780	24 San Jose	408-321-8242
06 Woodland	530-661-1200	27 Stockton	209-465-6255
08 Williams	530-473-2811		
09 Isleton	916-777-5545		

P.O. BOX 401 • WEST SACRAMENTO, CA 95691 • (916) 371-2570 • FOR FUELS CALL 916-371-6495

REMIT TO: Ramos Oil Co., Inc.
PO Box 401
West Sacramento, CA 95691

HAZARDOUS MATERIAL EMERGENCY
CALL 1-800-456-7745

DEF (Diesel Exhaust Fluid)
NOW AVAILABLE!

TO PAY ONLINE GO TO OUR WEBSITE
www.ramosoil.com

SOLD TO: ROSEVILLE ENERGY PARK
CITY OF ROSEVILLE
5120 PHILLIP RD
ROSEVILLE, CA 95747

SHIP TO: ROSEVILLE ENERGY PARK
CITY OF ROSEVILLE
5120 PHILLIP RD
ROSEVILLE, CA 95747

CUST. PURCHASE ORDER NUMBER		SALESMAN		TERMS		DEL. ZONE		DUE DATE	
0007936		JOSH GRAVES		Net 30 Days		0		10-30-22	
DELIVERY DATE		DRIVER		TRUCK NUMBER		TERMINAL		B / L NUMBER	
09-30-22		751		29180		11			
NO. OF PKG'S	BULK OR SIZE	PRODUCT DELIVERED	ORDERED	DELIVERED	TAXES			PRICE	AMOUNT
		NA1993, RED DYED DIESEL COMBUSTIBLE, 3, PGIII #2D 15ppm sulfur (maximum) Dyed Diesel fuel non taxable use only, penalty for taxable use. BULK DSL #2 DYED CARB ULTRA LOW REG CA OIL SPILL TAX L.U.S.T. TAX FED OIL SPILL TAX AB 32 DSL IMPLEMENTATION FEE ENVIRONMENTAL SURCHARGE *** DELIVERY MESSAGE *** PO REQUIRED RED DSL FORM ON FILE	100	52					
LOAD		UNLOADING		MISC. CHARGES		TRIP MILES			
ARRIVED		ARRIVED		PUMP		TERMINAL TO CUSTOMER			
BEGAN LOADING		BEGAN UNLOADING		DEM. HRS.					
FINISHED		FINISHED		SPLIT DEL.					
TOTAL TIME		TOTAL TIME		SPLIT LOAD					
				BRIDGE TOLL					
COMMENTS									
PRODUCT		PREMIUM		UNLEADED PLUS		UNLEADED		DIESEL	
GROSS								SALES TAX	
NET								TOTAL	
CUSTOMER AGREES TO PAY FINANCE CHARGE ON PAST DUE BALANCE OF 1.5% PER MONTH OR THE MAXIMUM RATE ALLOWED IN CUSTOMER'S STATE OF RESIDENCE. WHICHEVER IS LESS; AND FURTHER AGREES TO PAY REASONABLE ATTORNEY'S FEES AND COSTS IF COLLECTION IS REQUIRED. VENUE FOR PURPOSES OF ENDORSEMENT OF THIS OBLIGATION SHALL BE YOLO COUNTY.									
ALL CLAIMS FOR ENVIRONMENTAL DAMAGE DURING DELIVERY OF ANY RAMOS OIL PRODUCT MUST BE MADE WITHIN 15 DAYS FOLLOWING DELIVERY.									
DELIVERED BY (SIGNATURE IN FULL) X					RECEIVED IN GOOD ORDER X				

ATTACHMENT 34

AQ-103

AQ-103 No emissions are permitted, from any source, which are a nuisance per PCAPCD Rule 205, Nuisance.

Verification: The Project owner shall report all violations of this condition as noticed by the PCAPCD as well as any offsite nuisance complaints as part of the Quarterly Air Quality Report in Condition of Certification AQ-SC6.

In regards to AQ-103 of Roseville Energy Park's 3Q22 QAQR, there were no violations of PCAPCD's Rule 205 for nuisance.

ATTACHMENT 35

AQ-104

AQ-104 Stack emission opacity as dark as Ringelmann No. 1 (20% opacity) for periods aggregating more than 3 minutes in any one hour is prohibited and is in violation of PCAPCD Rule 202, Visible Emissions.

Verification: The Project owner shall report all violations of this condition as noticed by the PCAPCD as well as any offsite opacity complaints as part of the Quarterly Air Quality Report in Condition of Certification AQ-SC6

In regards to AQ-104 of Roseville Energy Park's 3Q22 QAQR, there were no violations of PCAPCD's Rule 202 for opacity from stack emissions of the emergency diesel generator.