| DOCKETED | |
|---|---|
| **Docket Number:** | 03-AFC-01C |
| **Project Title:** | Roseville Energy Park Compliance |
| **TN #:** | 251188 |
| **Document Title:** | Roseville Energy Park Quarterly Air Quality Report - Q2 2023 |
| **Description:** | N/A |
| **Filer:** | Roseville Electric Compliance |
| **Organization:** | Roseville Electric |
| **Submitter Role:** | Public Agency |
| **Submission Date:** | 7/26/2023 4:15:54 PM |
| **Docketed Date:** | 7/26/2023 |

# Quarterly Operational Report

# Roseville Energy Park (03-AFC-01C)

# Second Quarter 2023

**Submitted to:**

**California Energy Commission**

# List of Attachments

**Attachment 1: AQ15 –** SCR Installed before commissioning in 2007

**Attachment 2: AQ20** - The gas turbine engine shall be fired exclusively on pipeline quality natural gas with sulfur content no greater than 0.50 grains of sulfur compounds per 100 dry scf of natural gas

**Attachment 3: AQ21** – Startups and Shutdowns

**Attachment 4: AQ32** – All hourly, quarter NOx and CO emissions AQ-SC6

**Attachment 5: AQ33** – All hourly, daily, and quarterly Sox AQ-SC6

**Attachment 6: AQ34** – Start Up and Shut downs

**Attachment 7: AQ36** – Breakdown condition

**Attachment 8: AQ37** – Violations of Emissions

**Attachment 9: AQ40** – CEMS quality assurance test failures

**Attachment 10: AQ41** – Excess Emissions

**Attachment 11: AQ42** – Running 12 month summary

**Attachment 12: AQ47** – All nuisance violations

N/A for this report period

**Attachment 13: AQ48** – Nuisance complaints and stack emission opacity as dark as Ringlemann No. 1 (20% opacity) for periods aggregating more than 3 min.

N/A for this report period

**Attachment 14: AQ51** – Ammonia slip exceedances

**Attachment 15: AQ55** – Emission rates from each gas turbine and heat recovery steam generator exhaust during startup and shutdown – NOx and CO

**Attachment 16: AQ57** – Emission exceedance rates during startup and shutdown – CO, NOX, PM-10, SOX, and VOC

**Attachment 17: AQ59** – Emission limit exceedances – NOX, CO, VOC, PM-10, SO2

**Attachment 18: AQ60** – Quarterly emission exceedances for Alstom GTX100 turbine – NOx, CO, VOCs, PMO, Sox

**Attachment 19: AQ63** – Total facility emission exceedances – NOX, CO, VOC, PM-10, SO2

**Attachment 20: AQ68** – Annual water sample analysis of cooling tower water

**Attachment 21: AQ69** – Nuisance complaints

N/A for this report period

**Attachment 22: AQ70** – PM-10 quarterly emission rate exceedances from cooling tower

**Attachment 23: AQ71** – Exceedance of cooling tower PM-10 emission limit – PM-10 = cooling water recirculation rate*total dissolved solids concentration in the blow own water* design drift rate

**Attachment 24: AQ86** – Limits for operation for maintenance and testing of emergency diesel engine and generator limited to 50 hours per year

**Attachment 25: AQ87** – Operation for maintenance and testing purposes shall be limited to involuntary interruptions of electrical power. Operation shall not exceed 24 hours

**Attachment 26: AQ88** – Sulfur content of diesel fuel used shall not exceed 15 ppm by weight

N/A for this report period

**Attachment 27: AQ89** – Records of hours of operation engine run for maintenance and testing, during interruption of electrical power, records of sulfur content of diesel used for five years

**Attachment 28: AQ90** – No emissions are permitted, from any source, which are a nuisance per PCAPCD Rule 205, Nuisance

N/A for this report period

**Attachment 29: AQ91** – Stack emission opacity as dark as Ringelmann No. 1 (20% opacity) for periods aggregating more than 3 minutes in any one hour is prohibited and is in violation of PCAPCD Rule 202, Visible Emissions

N/A for this report period

**Attachment 30: AQ99 –** Operation for maintenance and testing of the emergency diesel engine and generator shall be limited to 50 hours per year.

**Attachment 31: AQ100** – Emergency diesel Generator; Operation for other than maintenance and testing purposes shall be limited to involuntary interruptions of electrical power

**Attachment 32: AQ101** - The sulfur content of the diesel used shall not exceed 15ppm by weight

N/A for this report period

**Attachment 33: AQ102** – Records of operation and maintenance shall be kept by the owner or operator for a period of five years

**Attachment 34: AQ103** – No emissions are permitted, from any source, which are a nuisance

N/A for this report period

**Attachment 35: AQ104** – Stack emission opacity as dark as Ringelmann No. 1 (20% opacity) for periods aggregating more than 3 minutes in any one hour is prohibited

N/A for this report period

**ATTACHMENT 1**

# AQ-15

**AQ-15** The Project owner shall install a selective catalytic reduction (SCR) system and an oxidation catalyst on the gas turbine. The SCR and oxidation catalyst equipment shall be operated whenever the gas turbine is operated.

**Verification:** The Project owner shall submit to the CPM a written statement by a California registered Professional Engineer stating that said engineer has reviewed the as built deigns or inspected the identified equipment and certifies that it is operational and air tight. The Project owner shall include the operational status of the SCR and oxidation catalyst during all hours of operation as part of the Quarterly Air Quality Report required by the Condition of Certification AQ-SC6

This document is on file from the 2007 4Q QAQR.

**ATTACHMENT 2**

# AQ-20

**AQ-20** The gas turbine engine shall be fired exclusively on pipeline quality natural gas with sulfur content no greater than 0.50 grains of sulfur compounds per 100 dry scf of natural gas.

**Verification:** The Project owner shall submit to the CPM the most recent fuel testing analysis performed as part of the Quarterly Air Quality Report required by the Condition of Certification AQ-SC6

# Gas System Sulfur Survey Results

Note: Starting Q4 2022, we began breaking sulfur data down monthly. Data will still be updated on a quarterly basis just with additional granularity.

| Date | Total Sulfur Maximum | | Total Sulfur Average all sites | |
|---|---|---|---|---|
| | PPMv | gr/100 scf | PPMv | gr/100 scf |
| 2023 | | | | |
| First Quarter | 4.3 | 0.25 | 2.9 | 0.17 |
| First Quarter - January | 3.5 | 0.21 | 2.9 | 0.17 |
| First Quarter - February | 4.3 | 0.25 | 3.0 | 0.18 |
| First Quarter - March | 3.5 | 0.21 | 3.0 | 0.18 |

AQ20 ROSEVILLE ENERGY PARK

**2Q23**

Fuel Quality Analysis BTU values

http://www.pge.com/pi

| | APR | MAY | JUN |
|---|---|---|---|
| 1 | 1039.80 | 1047.57 | 1069.45 |
| 2 | 1038.52 | 1047.57 | 1069.45 |
| 3 | 1035.80 | 1047.57 | 1069.45 |
| 4 | 1043.66 | 1047.57 | 1069.45 |
| 5 | 1046.48 | 1047.57 | 1069.45 |
| 6 | 1047.01 | 1047.57 | 1069.45 |
| 7 | 1045.29 | 1047.57 | 1069.45 |
| 8 | 1044.47 | 1047.57 | 1071.38 |
| 9 | 1038.36 | 1047.57 | 1071.38 |
| 10 | 1039.50 | 1047.57 | 1071.38 |
| 11 | 1040.91 | 956.99 | 1071.38 |
| 12 | 1044.71 | 956.99 | 1071.38 |
| 13 | 1045.18 | 956.99 | 1071.38 |
| 14 | 1044.45 | 956.99 | 1071.38 |
| 15 | 1045.41 | 956.99 | 1049.66 |
| 16 | 1047.14 | 956.99 | 1049.66 |
| 17 | 1047.05 | 956.99 | 1049.66 |
| 18 | 1041.29 | 956.99 | 1049.66 |
| 19 | 1044.88 | 1079.88 | 1049.66 |
| 20 | 1044.88 | 1079.88 | 1049.66 |
| 21 | 1044.88 | 1079.88 | 1049.66 |
| 22 | 1044.38 | 1079.88 | 1054.88 |
| 23 | 1044.38 | 1079.88 | 1054.88 |
| 24 | 1044.38 | 1014.35 | 1054.88 |
| 25 | 1044.38 | 1014.35 | 1054.88 |
| 26 | 1047.57 | 1014.35 | 1054.88 |
| 27 | 1047.57 | 1014.35 | 1054.88 |
| 28 | 1047.57 | 1014.35 | 1054.88 |
| 29 | 1047.57 | 1014.35 | 1020.85 |
| 30 | 1017.57 | 1014.35 | 1020.85 |
| 31 | N/A | 1069.45 | N/A |

**ATTACHMENT 3**

# AQ-21

**AQ-21** Startup is defined as the period beginning with the turbine light-off until the unit meets the lb/hr and ppmv emission limits in Conditions of Certification AQ-52, -54 and -55. Shutdown is defined as the period beginning with initiation of turbine shutdown sequence and ending with cessation of firing of the gas turbine engine. Startup and shutdown durations shall not exceed 3.0 hours and one hour, respectively, per occurrence.

**Verification:** The Project owner shall identify and submit to the CPM as part of the Quarterly Air Quality Report all startups and shutdowns for all units including the maximum hourly emission rate, total emissions and duration.

# Monthly Summary By Day Report

## Units CT1 and CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 21:40 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Limit Value:**

| | Units CT1 & CT2 CO, Lb 1 Hour(s) | Units CT1 & CT2 NOx, Lb 1 Hour(s) | Units CT1 & CT2 SO2, Lb 1 Hour(s) | Units CT1 & CT2 PM10, Lb 1 Hour(s) | Units CT1 & CT2 VOC, Lb 1 Hour(s) |
|---|---|---|---|---|---|
| 04/01/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/02/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/03/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/04/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/05/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/06/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/07/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/08/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/09/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/10/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/11/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/12/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/13/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/14/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/15/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/16/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/17/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/18/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/19/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/20/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/21/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/22/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/23/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/24/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/25/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/26/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/27/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/28/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/29/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/30/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| Monthly Avg/Sum: | 0.00 sum | 0.00 sum | 0.00 sum | 0.00 sum | 0.00 sum |
| Daily Min: | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| Daily Max: | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| Apr 2023 - Apr 2023 | 0.00 sum | 0.00 sum | 0.00 sum | 0.00 sum | 0.00 sum |
| **QTD:** | 0.00 sum | 0.00 sum | 0.00 sum | 0.00 sum | 0.00 sum |
| **YTD 2023:** | 5,382.86 sum | 6,277.77 sum | 625.15 sum | 1,248.91 sum | 2,081.24 sum |

# Monthly Summary By Day Report

## Units CT1 and CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 21:40 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Limit Value:**

| | Units CT1 & CT2 CO, Lb 1 Hour(s) | Units CT1 & CT2 NOx, Lb 1 Hour(s) | Units CT1 & CT2 SO2, Lb 1 Hour(s) | Units CT1 & CT2 PM10, Lb 1 Hour(s) | Units CT1 & CT2 VOC, Lb 1 Hour(s) |
|---|---|---|---|---|---|
| 05/01/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/02/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/03/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/04/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/05/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/06/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/07/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/08/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/09/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/10/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/11/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/12/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/13/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/14/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/15/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/16/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/17/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/18/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/19/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/20/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/21/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/22/2023 | 412.55 | 31.76 | 0.19 | 0.36 | 0.61 |
| 05/23/2023 | 14.14 | 10.48 | 1.23 | 2.43 | 4.06 |
| 05/24/2023 | 50.78 | 19.62 | 0.90 | 1.83 | 3.05 |
| 05/25/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/26/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/27/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/28/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/29/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/30/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/31/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| Monthly Avg/Sum: | 477.47 sum | 61.86 sum | 2.32 sum | 4.62 sum | 7.72 sum |
| Daily Min: | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| Daily Max: | 412.55 | 31.76 | 1.23 | 2.43 | 4.06 |
| Apr 2023 - May 2023 | 477.47 sum | 61.86 sum | 2.32 sum | 4.62 sum | 7.72 sum |
| **QTD:** | 477.47 sum | 61.86 sum | 2.32 sum | 4.62 sum | 7.72 sum |
| **YTD 2023:** | 5,860.33 sum | 6,339.63 sum | 627.47 sum | 1,253.53 sum | 2,088.96 sum |

# Monthly Summary By Day Report

## Units CT1 and CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 21:40 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Limit Value:**

| | Units CT1 & CT2 CO, Lb 1 Hour(s) | Units CT1 & CT2 NOx, Lb 1 Hour(s) | Units CT1 & CT2 SO2, Lb 1 Hour(s) | Units CT1 & CT2 PM10, Lb 1 Hour(s) | Units CT1 & CT2 VOC, Lb 1 Hour(s) |
|---|---|---|---|---|---|
| 06/01/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/02/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/03/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/04/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/05/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/06/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/07/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/08/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/09/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/10/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/11/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/12/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/13/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/14/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/15/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/16/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/17/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/18/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/19/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/20/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/21/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/22/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/23/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/24/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/25/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/26/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/27/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/28/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/29/2023 | 55.41 | 49.90 | 4.41 | 8.86 | 14.75 |
| 06/30/2023 | 17.21 | 65.68 | 7.08 | 14.19 | 23.63 |
| Monthly Avg/Sum: | 72.62 sum | 115.58 sum | 11.49 sum | 23.05 sum | 38.38 sum |
| Daily Min: | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| Daily Max: | 55.41 | 65.68 | 7.08 | 14.19 | 23.63 |
| Apr 2023 - Jun 2023 | 550.09 sum | 177.44 sum | 13.81 sum | 27.67 sum | 46.10 sum |
| **QTD:** | 550.09 sum | 177.44 sum | 13.81 sum | 27.67 sum | 46.10 sum |
| **YTD 2023:** | 5,932.95 sum | 6,455.21 sum | 638.96 sum | 1,276.58 sum | 2,127.34 sum |

# Monthly Summary By Day Report

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY
**Generated:** 07/07/2023 21:40 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Limit Value:**

| | Unit CT1 CO_SUSD, LbPerHr 1 Hour(s) | Unit CT1 NOx_SUSD, LbPerHr 1 Hour(s) | Unit CT2 CO_SUSD, LbPerHr 1 Hour(s) | Unit CT2 NOx_SUSD, LbPerHr 1 Hour(s) |
|---|---|---|---|---|
| 04/01/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/02/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/03/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/04/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/05/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/06/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/07/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/08/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/09/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/10/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/11/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/12/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/13/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/14/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/15/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/16/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/17/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/18/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/19/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/20/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/21/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/22/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/23/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/24/2023 | 0.1 | 0.0 | 0.0 | 0.0 |
| 04/25/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/26/2023 | 0.1 | 0.0 | 0.0 | 0.0 |
| 04/27/2023 | 3.7 | 0.0 | 0.0 | 0.0 |
| 04/28/2023 | 0.5 | 0.0 | 0.0 | 0.0 |
| 04/29/2023 | 0.3 | 0.0 | 0.0 | 0.0 |
| 04/30/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| Monthly Avg/Sum: | 4.7 sum | 0.0 sum | 0.0 sum | 0.0 sum |
| Daily Min: | 0.0 | 0.0 | 0.0 | 0.0 |
| Daily Max: | 3.7 | 0.0 | 0.0 | 0.0 |
| Apr 2023 - Apr 2023 | 4.7 sum | 0.0 sum | 0.0 sum | 0.0 sum |
| **QTD:** | 4.7 sum | 0.0 sum | 0.0 sum | 0.0 sum |
| **YTD 2023:** | 1,638.9 sum | 282.3 sum | 1,430.4 sum | 337.0 sum |

# Monthly Summary By Day Report

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY
**Generated:** 07/07/2023 21:40 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Limit Value:**

| | Unit CT1 CO_SUSD, LbPerHr 1 Hour(s) | Unit CT1 NOx_SUSD, LbPerHr 1 Hour(s) | Unit CT2 CO_SUSD, LbPerHr 1 Hour(s) | Unit CT2 NOx_SUSD, LbPerHr 1 Hour(s) |
|---|---|---|---|---|
| 05/01/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/02/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/03/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/04/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/05/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/06/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/07/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/08/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/09/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/10/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/11/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/12/2023 | 0.3 | 0.0 | 0.0 | 0.0 |
| 05/13/2023 | 3.2 | 0.0 | 0.0 | 0.0 |
| 05/14/2023 | 0.9 | 0.0 | 0.0 | 0.0 |
| 05/15/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/16/2023 | 1.2 | 0.0 | 0.0 | 0.0 |
| 05/17/2023 | 2.0 | 0.0 | 0.0 | 0.0 |
| 05/18/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/19/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/20/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/21/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/22/2023 | 397.9 | 30.5 | 0.0 | 0.0 |
| 05/23/2023 | 28.2 | 1.7 | 0.0 | 0.0 |
| 05/24/2023 | 47.9 | 13.3 | 0.0 | 0.0 |
| 05/25/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/26/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/27/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/28/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/29/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/30/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/31/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| Monthly Avg/Sum: | 481.6 sum | 45.5 sum | 0.0 sum | 0.0 sum |
| Daily Min: | 0.0 | 0.0 | 0.0 | 0.0 |
| Daily Max: | 397.9 | 30.5 | 0.0 | 0.0 |
| Apr 2023 - May 2023 | 486.3 sum | 45.5 sum | 0.0 sum | 0.0 sum |
| **QTD:** | 486.3 sum | 45.5 sum | 0.0 sum | 0.0 sum |
| **YTD 2023:** | 2,120.5 sum | 327.8 sum | 1,430.4 sum | 337.0 sum |

# Monthly Summary By Day Report

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY
**Generated:** 07/07/2023 21:40 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Limit Value:**

| | Unit CT1 CO_SUSD, LbPerHr 1 Hour(s) | Unit CT1 NOx_SUSD, LbPerHr 1 Hour(s) | Unit CT2 CO_SUSD, LbPerHr 1 Hour(s) | Unit CT2 NOx_SUSD, LbPerHr 1 Hour(s) |
|---|---|---|---|---|
| 06/01/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/02/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/03/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/04/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/05/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/06/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/07/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/08/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/09/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/10/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/11/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/12/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/13/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/14/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/15/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/16/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/17/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/18/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/19/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/20/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/21/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/22/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/23/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/24/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/25/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/26/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/27/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/28/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/29/2023 | 43.5 | 10.6 | 0.0 | 0.0 |
| 06/30/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| Monthly Avg/Sum: | 43.5 sum | 10.6 sum | 0.0 sum | 0.0 sum |
| Daily Min: | 0.0 | 0.0 | 0.0 | 0.0 |
| Daily Max: | 43.5 | 10.6 | 0.0 | 0.0 |
| Apr 2023 - Jun 2023 | 529.8 sum | 56.1 sum | 0.0 sum | 0.0 sum |
| **QTD:** | 529.8 sum | 56.1 sum | 0.0 sum | 0.0 sum |
| **YTD 2023:** | 2,164.0 sum | 338.4 sum | 1,430.4 sum | 337.0 sum |

# Startup / Shutdown Events

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY
**Generated:** 07/07/2023 21:30 **Location:** Roseville, CA

### Unit Offline

**Tag Name:** CT1_UnitOn_TF_1H

| Offline Periods | | |
|---|---|---|
| **Start Time** | **End Time** | **Duration in Hour(s)** |
| 04/01/2023 00:00 | 05/22/2023 14:00 | 1239 |
| 05/22/2023 17:00 | 05/23/2023 11:00 | 19 |
| 05/23/2023 19:00 | 05/24/2023 08:00 | 14 |
| 05/24/2023 15:00 | 06/29/2023 06:00 | 856 |

# Startup / Shutdown Events

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY
**Generated:** 07/07/2023 21:30 **Location:** Roseville, CA

| Operating Time Summary | |
|---|---|
| Available Data for Report (excludes missing data): | 2,184.00 Hour(s) |
| Total Offline: | 2,128.00 Hour(s) |
| Offline Percentage: | 97.44 % |
| Total Online: | 56.00 Hour(s) |
| Online Percentage: | 2.56 % |

# Startup / Shutdown Events

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY
**Generated:** 07/07/2023 21:30 **Location:** Roseville, CA

### Startup/Shutdown

| Number | Start Time | End Time | Event Type | Duration |
|---|---|---|---|---|
| 1 | 05/22/2023 15:22 | 05/22/2023 16:42 | Cold Startup | 81 |
| 2 | 05/22/2023 16:51 | 05/22/2023 16:51 | Shutdown | 1 |
| 3 | 05/23/2023 12:43 | 05/23/2023 13:36 | Cold Startup | 54 |
| 4 | 05/23/2023 17:57 | 05/23/2023 18:07 | Shutdown | 11 |
| 5 | 05/24/2023 09:44 | 05/24/2023 10:46 | Cold Startup | 63 |
| 6 | 05/24/2023 13:54 | 05/24/2023 14:06 | Shutdown | 13 |
| 7 | 06/29/2023 07:26 | 06/29/2023 08:33 | Cold Startup | 68 |

# Startup / Shutdown Events

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY
**Generated:** 07/07/2023 21:30 **Location:** Roseville, CA

### Startup/Shutdown Event Summary

| | # Events | Duration | Duration % |
|---|---|---|---|
| Cold Startup | 4 | 266 | 8.55 |
| Warm Startup | 0 | | 0.00 |
| Shutdown | 3 | 25 | 0.80 |
| Total Process Events: | 7 | 291 | 9.35 |

| | |
|---|---|
| Total Report Time: | 2,183.98 Hour(s) |
| Total Operating Time: | 51.87 Hour(s) |
| Total Startup Time: | 266 Minute(s) |
| Total Shutdown Time: | 25 Minute(s) |
| Total Startup/Shutdown Time: | 291 Minute(s) |
| Total Startup/Shutdown Time as a Percentage of Total Operating Time: | 9.35 % |

# Startup / Shutdown Events

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY
**Generated:** 07/07/2023 21:39 **Location:** Roseville, CA

## Unit Offline

**Tag Name:** CT2_UnitOn_TF_1H

| Offline Periods | | |
|---|---|---|
| **Start Time** | **End Time** | **Duration in Hour(s)** |
| 04/01/2023 00:00 | 06/30/2023 23:00 | 2184 |

# Startup / Shutdown Events

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY
**Generated:** 07/07/2023 21:39 **Location:** Roseville, CA

| Operating Time Summary | |
|---|---|
| Available Data for Report (excludes missing data): | 2,184.00 Hour(s) |
| Total Offline: | 2,184.00 Hour(s) |
| Offline Percentage: | 100.00 % |
| Total Online: | 0.00 Hour(s) |
| Online Percentage: | 0.00 % |

# Startup / Shutdown Events

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY
**Generated:** 07/07/2023 21:39 **Location:** Roseville, CA

No startup/shutdown events found.

# CT1 SUSD EVENT 1

| | CT1_GasFlow_CT_scfh_1M | | | CT1_CO_Ppmvdc_1M | | | CT1_NOx_Ppmvdc_1M | | | CT1_CO_LbPerHr_1M | | | CT1_NOx_LbPerHr_1M | | | CT1_SUSD_TF_1M | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 05/22/23 15:17 | 51831.8 | | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | |
| 05/22/23 15:18 | 51831.8 | | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | |
| 05/22/23 15:19 | 51754.7 | | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | |
| 05/22/23 15:20 | 51754.7 | | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | |
| 05/22/23 15:21 | 58147.1 | | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | |
| 05/22/23 15:22 | 57685 | | | 0 | | | 0 | | | 0 | | | 0 | | | 1 | |
| 05/22/23 15:23 | 57453.9 | | | 0 | | | 0 | | | 0 | | | 0 | | | 1 | |
| 05/22/23 15:24 | 60380.5 | | | 1.1 | | | 0 | | | 0 | | | 0 | | | 1 | |
| 05/22/23 15:25 | 67312 | | | 981.6 | | | 11.8 | | | 154.25 | | | 3.05 | | | 1 | |
| 05/22/23 15:26 | 76091.8 | | | 830.9 | | | 13.88 | | | 147.67 | | | 4.06 | | | 1 | |
| 05/22/23 15:27 | 86951 | | | 417.4 | | | 20.06 | | | 84.75 | | | 6.7 | | | 1 | |
| 05/22/23 15:28 | 119528.8 | | | 206 | | | 24.94 | | | 57.49 | | | 11.46 | | | 1 | |
| 05/22/23 15:29 | 143942.9 | | | 107.6 | | | 42.95 | | | 36.16 | | | 23.75 | | | 1 | |
| 05/22/23 15:30 | 140785.2 | | | 65.5 | | | 59.95 | | | 21.51 | | | 32.42 | | | 1 | |
| 05/22/23 15:31 | 137242.5 | | | 1468.2 | | | 44.43 | | | 470.29 | | | 23.42 | | | 1 | |
| 05/22/23 15:32 | 137550.5 | | | 2044.1 | | | 43.58 | | | 656.59 | | | 23.04 | | | 1 | |
| 05/22/23 15:33 | 136241.3 | | | 2112.2 | | | 45.63 | | | 671.86 | | | 23.89 | | | 1 | |
| 05/22/23 15:34 | 136395.3 | | | 2112.2 | | | 47.79 | | | 672.81 | | | 25.05 | | | 1 | |
| 05/22/23 15:35 | 135009 | | | 2112.2 | | | 53.69 | | | 665.71 | | | 27.85 | | | 1 | |
| 05/22/23 15:36 | 135394.1 | | | 2112.2 | | | 60.38 | | | 667.61 | | | 31.41 | | | 1 | |
| 05/22/23 15:37 | 134392.9 | | | 2185 | | | 66.32 | | | 685.73 | | | 34.26 | | | 1 | |
| 05/22/23 15:38 | 134392.9 | | | 2185 | | | 66.73 | | | 685.73 | | | 34.47 | | | 1 | |
| 05/22/23 15:39 | 134700.9 | | | 2185 | | | 65.92 | | | 687.2 | | | 34.12 | | | 1 | |
| 05/22/23 15:40 | 133468.7 | | | 2185 | | | 64.7 | | | 680.84 | | | 33.18 | | | 1 | |
| 05/22/23 15:41 | 134084.8 | | | 2185 | | | 63.27 | | | 683.78 | | | 32.59 | | | 1 | |
| 05/22/23 15:42 | 133314.6 | | | 2185 | | | 62.26 | | | 679.87 | | | 31.88 | | | 1 | |
| 05/22/23 15:43 | 133314.6 | | | 2185 | | | 61.64 | | | 679.87 | | | 31.57 | | | 1 | |
| 05/22/23 15:44 | 133160.6 | | | 2185 | | | 60.63 | | | 679.38 | | | 31.02 | | | 1 | |
| 05/22/23 15:45 | 132544.5 | | | 2185 | | | 59.61 | | | 675.95 | | | 30.35 | | | 1 | |
| 05/22/23 15:46 | 133391.7 | | | 2185 | | | 58.8 | | | 680.35 | | | 30.13 | | | 1 | |
| 05/22/23 15:47 | 132698.5 | | | 2185 | | | 57.78 | | | 676.93 | | | 29.46 | | | 1 | |
| 05/22/23 15:48 | 133006.6 | | | 2185 | | | 56.97 | | | 678.4 | | | 29.11 | | | 1 | |

| | CT1_GasFlow_CT_scfh_1M | | | CT1_CO_Ppmvdc_1M | | | CT1_NOx_Ppmvdc_1M | | | CT1_CO_LbPerHr_1M | | | CT1_NOx_LbPerHr_1M | | | CT1_SUSD_TF_1M | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 05/22/23 15:49 | 132159.4 | | | 2185 | | | 56.15 | | | 674 | | | 28.51 | | | 1 | |
| 05/22/23 15:50 | 132621.5 | | | 2185 | | | 55.13 | | | 676.44 | | | 28.09 | | | 1 | |
| 05/22/23 15:51 | 131697.3 | | | 2185 | | | 54.52 | | | 672.04 | | | 27.6 | | | 1 | |
| 05/22/23 15:52 | 132313.4 | | | 2263.9 | | | 55.63 | | | 699.34 | | | 28.28 | | | 1 | |
| 05/22/23 15:53 | 131697.3 | | | 2265.2 | | | 55 | | | 696.69 | | | 27.84 | | | 1 | |
| 05/22/23 15:54 | 132082.4 | | | 2265.2 | | | 54.36 | | | 698.72 | | | 27.6 | | | 1 | |
| 05/22/23 15:55 | 131697.3 | | | 2265.2 | | | 53.73 | | | 696.69 | | | 27.2 | | | 1 | |
| 05/22/23 15:56 | 131235.2 | | | 2265.2 | | | 53.1 | | | 694.15 | | | 26.78 | | | 1 | |
| 05/22/23 15:57 | 132005.4 | | | 2265 | | | 52.68 | | | 698.15 | | | 26.72 | | | 1 | |
| 05/22/23 15:58 | 131543.3 | | | 2263.9 | | | 52.05 | | | 695.29 | | | 26.31 | | | 1 | |
| 05/22/23 15:59 | 131081.2 | | | 2263.1 | | | 51.41 | | | 692.49 | | | 25.89 | | | 1 | |
| 05/22/23 16:00 | 131466.3 | | | 2265 | | | 50.99 | | | 695.1 | | | 25.76 | | | 1 | |
| 05/22/23 16:01 | 131543.3 | | | 2265.2 | | | 50.36 | | | 695.68 | | | 25.45 | | | 1 | |
| 05/22/23 16:02 | 130927.2 | | | 2265.2 | | | 49.94 | | | 692.63 | | | 25.13 | | | 1 | |
| 05/22/23 16:03 | 169589.2 | | | 2265.2 | | | 49.52 | | | 896.97 | | | 32.27 | | | 1 | |
| 05/22/23 16:04 | 185685.5 | | | 1375.6 | | | 57.93 | | | 596.44 | | | 41.34 | | | 1 | |
| 05/22/23 16:05 | 196775.8 | | | 168.5 | | | 50.08 | | | 77.4 | | | 37.86 | | | 1 | |
| 05/22/23 16:06 | 197931 | | | 23.2 | | | 45.79 | | | 10.73 | | | 34.82 | | | 1 | |
| 05/22/23 16:07 | 198316.1 | | | 10.4 | | | 45.94 | | | 4.82 | | | 35 | | | 1 | |
| 05/22/23 16:08 | 198778.2 | | | 9.5 | | | 46.32 | | | 4.43 | | | 35.38 | | | 1 | |
| 05/22/23 16:09 | 198547.2 | | | 9 | | | 46.07 | | | 4.19 | | | 35.15 | | | 1 | |
| 05/22/23 16:10 | 198778.2 | | | 8.4 | | | 45.94 | | | 3.9 | | | 35.09 | | | 1 | |
| 05/22/23 16:11 | 198239.1 | | | 8 | | | 46.07 | | | 3.72 | | | 35.1 | | | 1 | |
| 05/22/23 16:12 | 198547.2 | | | 7.7 | | | 46.32 | | | 3.55 | | | 35.34 | | | 1 | |
| 05/22/23 16:13 | 199163.3 | | | 7.5 | | | 46.82 | | | 3.5 | | | 35.83 | | | 1 | |
| 05/22/23 16:14 | 199086.3 | | | 7.5 | | | 47.45 | | | 3.5 | | | 36.31 | | | 1 | |
| 05/22/23 16:15 | 198624.2 | | | 7.5 | | | 48.33 | | | 3.49 | | | 36.89 | | | 1 | |
| 05/22/23 16:16 | 198239.1 | | | 7.4 | | | 49.33 | | | 3.43 | | | 37.58 | | | 1 | |
| 05/22/23 16:17 | 201704.8 | | | 7.3 | | | 50.59 | | | 3.43 | | | 39.21 | | | 1 | |
| 05/22/23 16:18 | 220419.7 | | | 7 | | | 53.35 | | | 3.62 | | | 45.19 | | | 1 | |
| 05/22/23 16:19 | 243909.6 | | | 5.8 | | | 56.17 | | | 3.29 | | | 52.64 | | | 1 | |
| 05/22/23 16:20 | 267707.5 | | | 4.3 | | | 47.63 | | | 2.68 | | | 48.99 | | | 1 | |
| 05/22/23 16:21 | 274253.9 | | | 3.2 | | | 19.89 | | | 2.07 | | | 20.96 | | | 1 | |
| 05/22/23 16:22 | 275486.1 | | | 3.4 | | | 13 | | | 2.19 | | | 13.76 | | | 1 | |

| | CT1_GasFlow_CT_scfh_1M | | | CT1_CO_Ppmvdc_1M | | | CT1_NOx_Ppmvdc_1M | | | CT1_CO_LbPerHr_1M | | | CT1_NOx_LbPerHr_1M | | | CT1_SUSD_TF_1M | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 05/22/23 16:23 | 317382.8 | | | 4.1 | | | 11.8 | | | 3.05 | | | 14.39 | | | 1 | |
| 05/22/23 16:24 | 342875.1 | | | 4.4 | | | 11.24 | | | 3.52 | | | 14.8 | | | 1 | |
| 05/22/23 16:25 | 285421.2 | | | 4.2 | | | 11.14 | | | 2.81 | | | 12.22 | | | 1 | |
| 05/22/23 16:26 | 278104.7 | | | 3.9 | | | 9.42 | | | 2.53 | | | 10.07 | | | 1 | |
| 05/22/23 16:27 | 279259.9 | | | 3.8 | | | 5.9 | | | 2.48 | | | 6.33 | | | 1 | |
| 05/22/23 16:28 | 286961.5 | | | 3.8 | | | 5.04 | | | 2.55 | | | 5.56 | | | 1 | |
| 05/22/23 16:29 | 274793 | | | 3.7 | | | 5.71 | | | 2.38 | | | 6.03 | | | 1 | |
| 05/22/23 16:30 | 278104.7 | | | 3.4 | | | 6.85 | | | 2.22 | | | 7.32 | | | 1 | |
| 05/22/23 16:31 | 282571.6 | | | 3.3 | | | 5.9 | | | 2.2 | | | 6.41 | | | 1 | |
| 05/22/23 16:32 | 278412.8 | | | 3.5 | | | 2.47 | | | 2.29 | | | 2.65 | | | 1 | |
| 05/22/23 16:33 | 285267.2 | | | 3.6 | | | 1.71 | | | 2.41 | | | 1.88 | | | 1 | |
| 05/22/23 16:34 | 291197.4 | | | 3.4 | | | 2.19 | | | 2.33 | | | 2.45 | | | 1 | |
| 05/22/23 16:35 | 286191.3 | | | 3.3 | | | 2.95 | | | 2.23 | | | 3.24 | | | 1 | |
| 05/22/23 16:36 | 314148.2 | | | 3.2 | | | 3.05 | | | 2.37 | | | 3.68 | | | 1 | |
| 05/22/23 16:37 | 290504.3 | | | 3.2 | | | 2.28 | | | 2.19 | | | 2.55 | | | 1 | |
| 05/22/23 16:38 | 285960.3 | | | 3.1 | | | 2 | | | 2.1 | | | 2.2 | | | 1 | |
| 05/22/23 16:39 | 313455 | | | 3.2 | | | 1.81 | | | 2.37 | | | 2.18 | | | 1 | |
| 05/22/23 16:40 | 281724.4 | | | 3.3 | | | 1.52 | | | 2.19 | | | 1.65 | | | 1 | |
| 05/22/23 16:41 | 286730.5 | | | 3.5 | | | 1.24 | | | 2.36 | | | 1.36 | | | 1 | |
| 05/22/23 16:42 | 305137.3 | | | 3.4 | | | 1.05 | | | 2.44 | | | 1.23 | | | 1 | |
| 05/22/23 16:43 | 286961.5 | | | 3.1 | | | 0.95 | | | 2.1 | | | 1.05 | | | 0 | |
| 05/22/23 16:44 | 280107.1 | | | 3.2 | | | 0.86 | | | 2.12 | | | 0.92 | | | 0 | |
| 05/22/23 16:45 | 297281.7 | | | 3.4 | | | 0.76 | | | 2.38 | | | 0.87 | | | 0 | |
| 05/22/23 16:46 | 283726.8 | | | 3.4 | | | 0.76 | | | 2.27 | | | 0.83 | | | 0 | |
| 05/22/23 16:47 | 294509.1 | | | 3.3 | | | 0.67 | | | 2.29 | | | 0.75 | | | 0 | |

# CT1 SUSD EVENT 2

| | CT1_GasFlow_CT_scfh_1M | | | CT1_CO_Ppmvdc_1M | | | CT1_NOx_Ppmvdc_1M | | | CT1_CO_LbPerHr_1M | | | CT1_NOx_LbPerHr_1M | | | CT1_SUSD_TF_1M | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 05/22/23 16:46 | 283726.8 | | | 3.4 | | | 0.76 | | | 2.27 | | | 0.83 | | | 0 | |
| 05/22/23 16:47 | 294509.1 | | | 3.3 | | | 0.67 | | | 2.29 | | | 0.75 | | | 0 | |
| 05/22/23 16:48 | 296434.5 | | | 3 | | | 0.67 | | | 2.11 | | | 0.76 | | | 0 | |
| 05/22/23 16:49 | 309296.2 | | | 3.1 | | | 0.58 | | | 2.24 | | | 0.69 | | | 0 | |
| 05/22/23 16:50 | 289272 | | | 3.1 | | | 0.57 | | | 2.12 | | | 0.63 | | | 0 | |
| 05/22/23 16:51 | 170282.3 | | | 3.2 | | | 0.57 | | | 1.29 | | | 0.37 | | | 1 | |
| 05/22/23 16:52 | 52678.9 | | | 0 | | | 0.78 | | | 0.8 | | | 0.16 | | | 0 | |
| 05/22/23 16:53 | 52524.9 | | | 0 | | | 23.6 | | | 26.78 | | | 4.76 | | | 0 | |
| 05/22/23 16:54 | 52293.8 | | | 0 | | | 0.2 | | | 0 | | | 0 | | | 0 | |
| 05/22/23 16:55 | 52062.8 | | | 0 | | | 0 | | | 0 | | | 0 | | | 0 | |
| 05/22/23 16:56 | 51908.8 | | | 0 | | | 0 | | | 0 | | | 0 | | | 0 | |

# CT1 SUSD EVENT 3

| | CT1_GasFlow_CT_scfh_1M | | | CT1_CO_Ppmvdc_1M | | | CT1_NOx_Ppmvdc_1M | | | CT1_CO_LbPerHr_1M | | | CT1_NOx_LbPerHr_1M | | | CT1_SUSD_TF_1M | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 05/23/23 12:38 | 14941.1 | | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | |
| 05/23/23 12:39 | 15018.1 | | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | |
| 05/23/23 12:40 | 15557.2 | | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | |
| 05/23/23 12:41 | 15942.3 | | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | |
| 05/23/23 12:42 | 20255.2 | | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | |
| 05/23/23 12:43 | 26108.4 | | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 1 | |
| 05/23/23 12:44 | 29574.1 | | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 1 | |
| 05/23/23 12:45 | 38431 | | | 64.9 | X | | 41.3 | X | | 5.83 | X | | 6.1 | X | | 1 | |
| 05/23/23 12:46 | 49983.4 | | | 1083.8 | X | | 14.07 | X | | 126.4 | X | | 2.7 | X | | 1 | |
| 05/23/23 12:47 | 61689.8 | | | 813.2 | X | | 17.7 | X | | 117.04 | X | | 4.19 | X | | 1 | |
| 05/23/23 12:48 | 78864.4 | | | 416.2 | X | | 23.01 | X | | 76.68 | X | | 6.98 | X | | 1 | |
| 05/23/23 12:49 | 120530 | | | 243.2 | X | | 25.75 | X | | 68.44 | X | | 11.92 | X | | 1 | |
| 05/23/23 12:50 | 137396.5 | | | 149.1 | X | | 40.39 | X | | 47.82 | X | | 21.32 | X | | 1 | |
| 05/23/23 12:51 | 146253.3 | | | 307.8 | X | | 52.15 | X | | 105.06 | X | | 29.3 | X | | 1 | |
| 05/23/23 12:52 | 163890 | | | 1949.6 | X | | 47.38 | X | | 745.82 | X | | 29.83 | X | | 1 | |
| 05/23/23 12:53 | 186455.7 | | | 1601.9 | X | | 49.82 | X | | 697.42 | X | | 35.7 | X | | 1 | |
| 05/23/23 12:54 | 209714.5 | | | 315.7 | X | | 50.51 | X | | 154.56 | X | | 40.69 | X | | 1 | |
| 05/23/23 12:55 | 229507.6 | | | 35.9 | X | | 49.08 | X | | 19.24 | X | | 43.29 | X | | 1 | |
| 05/23/23 12:56 | 255230.9 | | | 2.3 | X | | 44.53 | X | | 1.39 | X | | 43.67 | X | | 1 | |
| 05/23/23 12:57 | 276410.3 | | | 1.5 | X | | 35.71 | X | | 0.98 | X | | 37.92 | X | | 1 | |
| 05/23/23 12:58 | 278335.7 | | | 1.5 | X | | 16.07 | X | | 0.94 | X | | 17.18 | X | | 1 | |
| 05/23/23 12:59 | 277488.6 | | | 1.6 | X | | 11.63 | X | | 1.01 | X | | 12.4 | X | | 1 | |
| 05/23/23 13:00 | 276102.3 | | | 1.6 | X | | 9.77 | X | | 1.02 | X | | 10.37 | X | | 1 | |
| 05/23/23 13:01 | 276256.3 | | | 1.4 | X | | 8.58 | X | | 0.92 | X | | 9.11 | X | | 1 | |
| 05/23/23 13:02 | 275640.2 | | | 1.3 | X | | 7.44 | X | | 0.82 | X | | 7.88 | X | | 1 | |
| 05/23/23 13:03 | 274793 | | | 1.2 | X | | 6.63 | X | | 0.76 | X | | 7 | X | | 1 | |
| 05/23/23 13:04 | 275024 | | | 1 | X | | 6.08 | X | | 0.64 | X | | 6.43 | X | | 1 | |
| 05/23/23 13:05 | 274561.9 | | | 0.9 | X | | 5.53 | X | | 0.59 | X | | 5.84 | X | | 1 | |
| 05/23/23 13:06 | 273560.7 | | | 0.8 | X | | 5.16 | X | | 0.53 | X | | 5.43 | X | | 1 | |
| 05/23/23 13:07 | 273868.8 | | | 0.7 | X | | 5.07 | X | | 0.47 | X | | 5.33 | X | | 1 | |
| 05/23/23 13:08 | 273483.7 | | | 0.7 | X | | 4.79 | X | | 0.47 | X | | 5.04 | X | | 1 | |
| 05/23/23 13:09 | 272867.6 | | | 0.6 | X | | 4.61 | X | | 0.41 | X | | 4.83 | X | | 1 | |

| | CT1_GasFlow_CT_scfh_1M | | | CT1_CO_Ppmvdc_1M | | | CT1_NOx_Ppmvdc_1M | | | CT1_CO_LbPerHr_1M | | | CT1_NOx_LbPerHr_1M | | | CT1_SUSD_TF_1M | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 05/23/23 13:10 | 272944.6 | | | 0.6 | X | | 4.43 | X | | 0.41 | X | | 4.64 | X | | 1 | |
| 05/23/23 13:11 | 272944.6 | | | 0.6 | X | | 4.31 | X | | 0.36 | X | | 4.52 | X | | 1 | |
| 05/23/23 13:12 | 271866.4 | | | 0.6 | X | | 4.21 | X | | 0.36 | X | | 4.4 | X | | 1 | |
| 05/23/23 13:13 | 271866.4 | | | 0.6 | X | | 4.21 | X | | 0.36 | X | | 4.4 | X | | 1 | |
| 05/23/23 13:14 | 272097.4 | | | 0.6 | X | | 4.12 | X | | 0.36 | X | | 4.31 | X | | 1 | |
| 05/23/23 13:15 | 272790.6 | | | 0.6 | X | | 4.12 | X | | 0.36 | X | | 4.32 | X | | 1 | |
| 05/23/23 13:16 | 270942.2 | | | 0.6 | X | | 4.12 | X | | 0.36 | X | | 4.29 | X | | 1 | |
| 05/23/23 13:17 | 271481.3 | | | 0.5 | X | | 4.21 | X | | 0.3 | X | | 4.4 | X | | 1 | |
| 05/23/23 13:18 | 271558.3 | | | 0.5 | X | | 4.4 | X | | 0.3 | X | | 4.59 | X | | 1 | |
| 05/23/23 13:19 | 270711.2 | | | 0.5 | X | | 4.59 | X | | 0.3 | X | | 4.77 | X | | 1 | |
| 05/23/23 13:20 | 270865.2 | | | 0.5 | X | | 4.87 | X | | 0.3 | X | | 5.07 | X | | 1 | |
| 05/23/23 13:21 | 270788.2 | | | 0.5 | X | | 5.15 | X | | 0.3 | X | | 5.36 | X | | 1 | |
| 05/23/23 13:22 | 271481.3 | | | 0.5 | X | | 5.43 | X | | 0.3 | X | | 5.67 | X | | 1 | |
| 05/23/23 13:23 | 270942.2 | | | 0.5 | X | | 5.62 | X | | 0.3 | X | | 5.85 | X | | 1 | |
| 05/23/23 13:24 | 270172 | | | 0.5 | X | | 5.9 | X | | 0.3 | X | | 6.13 | X | | 1 | |
| 05/23/23 13:25 | 270557.1 | | | 0.5 | X | | 6.18 | X | | 0.3 | X | | 6.43 | X | | 1 | |
| 05/23/23 13:26 | 270711.2 | | | 0.5 | X | | 6.46 | X | | 0.3 | X | | 6.72 | X | | 1 | |
| 05/23/23 13:27 | 270788.2 | | | 0.5 | X | | 6.65 | X | | 0.3 | X | | 6.92 | X | | 1 | |
| 05/23/23 13:28 | 269941 | | | 0.4 | X | | 6.93 | X | | 0.24 | X | | 7.19 | X | | 1 | |
| 05/23/23 13:29 | 271481.3 | | | 0.4 | X | | 6.18 | X | | 0.24 | X | | 6.45 | X | | 1 | |
| 05/23/23 13:30 | 285960.3 | | | 0.4 | X | | 4.78 | X | | 0.25 | X | | 5.25 | X | | 1 | |
| 05/23/23 13:31 | 304906.2 | | | 0.4 | X | | 3.65 | X | | 0.27 | X | | 4.28 | X | | 1 | |
| 05/23/23 13:32 | 322234.8 | | | 0.5 | X | | 2.58 | X | | 0.35 | X | | 3.2 | X | | 1 | |
| 05/23/23 13:33 | 333402.2 | | | 0.6 | X | | 1.84 | X | | 0.43 | X | | 2.36 | X | | 1 | |
| 05/23/23 13:34 | 337715 | | | 0.6 | X | | 1.2 | X | | 0.44 | X | | 1.55 | X | | 1 | |
| 05/23/23 13:35 | 338177.1 | | | 0.6 | X | | 1.2 | X | | 0.44 | X | | 1.56 | X | | 1 | |
| 05/23/23 13:36 | 338100.1 | | | 0.5 | X | | 1.09 | X | | 0.43 | X | | 1.41 | X | | 1 | |
| 05/23/23 13:37 | 338716.3 | | | 0.6 | X | | 1 | X | | 0.5 | X | | 1.3 | X | | 0 | |
| 05/23/23 13:38 | 337792.1 | | | 0.5 | X | | 0.91 | X | | 0.43 | X | | 1.18 | X | | 0 | |
| 05/23/23 13:39 | 337484 | | | 0.5 | X | | 0.82 | X | | 0.43 | X | | 1.06 | X | | 0 | |
| 05/23/23 13:40 | 338100.1 | | | 0.5 | X | | 0.82 | X | | 0.43 | X | | 1.06 | X | | 0 | |
| 05/23/23 13:41 | 337715 | | | 0.5 | X | | 0.82 | X | | 0.43 | X | | 1.06 | X | | 0 | |

# CT1 SUSD EVENT 4

| | CT1_GasFlow_CT_scfh_1M | | | CT1_CO_Ppmvdc_1M | | | CT1_NOx_Ppmvdc_1M | | | CT1_CO_LbPerHr_1M | | | CT1_NOx_LbPerHr_1M | | | CT1_SUSD_TF_1M | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 05/23/23 17:52 | 338100.1 | | | 0.6 | | | 1.54 | | | 0.5 | | | 2 | | | 0 | |
| 05/23/23 17:53 | 338639.2 | | | 0.5 | | | 1.54 | | | 0.43 | | | 2.01 | | | 0 | |
| 05/23/23 17:54 | 338408.2 | | | 0.5 | | | 1.45 | | | 0.43 | | | 1.89 | | | 0 | |
| 05/23/23 17:55 | 337946.1 | | | 0.5 | | | 1.54 | | | 0.43 | | | 2 | | | 0 | |
| 05/23/23 17:56 | 338100.1 | | | 0.5 | | | 1.54 | | | 0.43 | | | 2 | | | 0 | |
| 05/23/23 17:57 | 338793.3 | | | 0.5 | | | 1.54 | | | 0.43 | | | 2.01 | | | 1 | |
| 05/23/23 17:58 | 328088 | | | 0.5 | | | 1.54 | | | 0.42 | | | 1.95 | | | 1 | |
| 05/23/23 17:59 | 307524.8 | | | 0.5 | | | 1.52 | | | 0.39 | | | 1.8 | | | 1 | |
| 05/23/23 18:00 | 284188.9 | | | 0.6 | | | 2.15 | | | 0.42 | | | 2.34 | | | 1 | |
| 05/23/23 18:01 | 260545 | | | 0.6 | | | 2.49 | | | 0.39 | | | 2.49 | | | 1 | |
| 05/23/23 18:02 | 239519.7 | | | 0.6 | | | 3.33 | | | 0.32 | | | 3.07 | | | 1 | |
| 05/23/23 18:03 | 217262.1 | | | 0.4 | | | 6.1 | | | 0.2 | | | 5.09 | | | 1 | |
| 05/23/23 18:04 | 194003.2 | | | 0.2 | | | 24.24 | | | 0.1 | | | 18.07 | | | 1 | |
| 05/23/23 18:05 | 170667.4 | | | 2.8 | | | 29.03 | | | 1.13 | | | 19.04 | | | 1 | |
| 05/23/23 18:06 | 151490.4 | | | 173.2 | | | 32.99 | | | 61.27 | | | 19.2 | | | 1 | |
| 05/23/23 18:07 | 116140.1 | | | 1032 | | | 35.24 | | | 279.76 | | | 15.72 | | | 1 | |
| 05/23/23 18:08 | 34811.2 | | | 0 | | | 31.71 | | | 161.22 | | | 4.24 | | | 0 | |
| 05/23/23 18:09 | 34580.2 | | | 0 | | | 64.9 | | | 1188.59 | | | 8.63 | | | 0 | |
| 05/23/23 18:10 | 34580.2 | | | 0 | | | 0.3 | | | 0 | | | 0 | | | 0 | |
| 05/23/23 18:11 | 34272.1 | | | 0 | | | 0.2 | | | 0 | | | 0 | | | 0 | |
| 05/23/23 18:12 | 34118.1 | | | 0 | | | 0.2 | | | 0 | | | 0 | | | 0 | |

# CT1 SUSD EVENT 5

| | CT1_GasFlow_CT_scfh_1M | | | CT1_CO_Ppmvdc_1M | | | CT1_NOx_Ppmvdc_1M | | | CT1_CO_LbPerHr_1M | | | CT1_NOx_LbPerHr_1M | | | CT1_SUSD_TF_1M | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 05/24/23 9:39 | 0 | | | 0 | | | 0 | | | 0 | | | 0 | | | 0 | |
| 05/24/23 9:40 | 0 | | | 0 | | | 0 | | | 0 | | | 0 | | | 0 | |
| 05/24/23 9:41 | 0 | | | 0 | | | 0 | | | 0 | | | 0 | | | 0 | |
| 05/24/23 9:42 | 0 | | | 0 | | | 0 | | | 0 | | | 0 | | | 0 | |
| 05/24/23 9:43 | 0 | | | 0 | | | 0 | | | 0 | | | 0 | | | 0 | |
| 05/24/23 9:44 | 0 | | | 0 | | | 0 | | | 0 | | | 0 | | | 1 | |
| 05/24/23 9:45 | 0 | | | 0 | | | 0 | | | 0 | | | 0 | | | 1 | |
| 05/24/23 9:46 | 18637.9 | | | 45.2 | | | 25.57 | | | 1.96 | | | 1.83 | | | 1 | |
| 05/24/23 9:47 | 39047.1 | | | 1139.1 | | | 12.19 | | | 103.78 | | | 1.83 | | | 1 | |
| 05/24/23 9:48 | 53834.2 | | | 769 | | | 17.37 | | | 96.57 | | | 3.59 | | | 1 | |
| 05/24/23 9:49 | 76168.8 | | | 452.2 | | | 22.42 | | | 80.38 | | | 6.56 | | | 1 | |
| 05/24/23 9:50 | 122070.3 | | | 298.8 | | | 24.94 | | | 85.13 | | | 11.7 | | | 1 | |
| 05/24/23 9:51 | 139398.9 | | | 191.1 | | | 45.61 | | | 62.19 | | | 24.43 | | | 1 | |
| 05/24/23 9:52 | 150566.2 | | | 502.8 | | | 55.76 | | | 176.71 | | | 32.25 | | | 1 | |
| 05/24/23 9:53 | 169204.1 | | | 1904.1 | | | 52.38 | | | 752.28 | | | 34.06 | | | 1 | |
| 05/24/23 9:54 | 191230.7 | | | 1477.2 | | | 56.93 | | | 659.69 | | | 41.84 | | | 1 | |
| 05/24/23 9:55 | 213565.3 | | | 259.5 | | | 57.31 | | | 129.4 | | | 47.04 | | | 1 | |
| 05/24/23 9:56 | 233897.5 | | | 25.6 | | | 55.07 | | | 13.96 | | | 49.5 | | | 1 | |
| 05/24/23 9:57 | 262547.4 | | | 2.2 | | | 52.54 | | | 1.36 | | | 53 | | | 1 | |
| 05/24/23 9:58 | 286576.4 | | | 1.5 | | | 38.6 | | | 1 | | | 42.5 | | | 1 | |
| 05/24/23 9:59 | 306292.5 | | | 1.4 | | | 18.77 | | | 1.02 | | | 22.1 | | | 1 | |
| 05/24/23 10:00 | 324083.2 | | | 1.5 | | | 13.17 | | | 1.1 | | | 16.4 | | | 1 | |
| 05/24/23 10:01 | 339332.4 | | | 1.6 | | | 11.46 | | | 1.29 | | | 14.94 | | | 1 | |
| 05/24/23 10:02 | 344338.4 | | | 1.5 | | | 8.47 | | | 1.24 | | | 11.2 | | | 1 | |
| 05/24/23 10:03 | 346571.9 | | | 1.4 | | | 7.98 | | | 1.12 | | | 10.63 | | | 1 | |
| 05/24/23 10:04 | 345416.6 | | | 1.2 | | | 8.21 | | | 0.97 | | | 10.9 | | | 1 | |
| 05/24/23 10:05 | 346109.8 | | | 1.1 | | | 8.59 | | | 0.91 | | | 11.42 | | | 1 | |
| 05/24/23 10:06 | 345185.6 | | | 1 | | | 8.5 | | | 0.84 | | | 11.28 | | | 1 | |
| 05/24/23 10:07 | 344877.5 | | | 1 | | | 8.33 | | | 0.77 | | | 11.04 | | | 1 | |
| 05/24/23 10:08 | 344877.5 | | | 0.9 | | | 8.07 | | | 0.7 | | | 10.69 | | | 1 | |
| 05/24/23 10:09 | 343645.3 | | | 0.9 | | | 7.81 | | | 0.7 | | | 10.31 | | | 1 | |
| 05/24/23 10:10 | 344030.3 | | | 0.8 | | | 7.64 | | | 0.63 | | | 10.09 | | | 1 | |

| | CT1_GasFlow_CT_scfh_1M | | | CT1_CO_Ppmvdc_1M | | | CT1_NOx_Ppmvdc_1M | | | CT1_CO_LbPerHr_1M | | | CT1_NOx_LbPerHr_1M | | | CT1_SUSD_TF_1M | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 05/24/23 10:11 | 342644.1 | | | 0.8 | | | 7.57 | | | 0.63 | | | 9.97 | | | 1 | |
| 05/24/23 10:12 | 343260.2 | | | 0.8 | | | 7.4 | | | 0.64 | | | 9.76 | | | 1 | |
| 05/24/23 10:13 | 342259 | | | 0.7 | | | 7.31 | | | 0.56 | | | 9.61 | | | 1 | |
| 05/24/23 10:14 | 342875.1 | | | 0.7 | | | 7.22 | | | 0.56 | | | 9.51 | | | 1 | |
| 05/24/23 10:15 | 342027.9 | | | 0.7 | | | 7.22 | | | 0.56 | | | 9.49 | | | 1 | |
| 05/24/23 10:16 | 342490 | | | 0.7 | | | 7.13 | | | 0.56 | | | 9.39 | | | 1 | |
| 05/24/23 10:17 | 341411.8 | | | 0.7 | | | 5.99 | | | 0.56 | | | 7.86 | | | 1 | |
| 05/24/23 10:18 | 342182 | | | 0.6 | | | 5.55 | | | 0.49 | | | 7.29 | | | 1 | |
| 05/24/23 10:19 | 341103.8 | | | 0.6 | | | 5.55 | | | 0.49 | | | 7.27 | | | 1 | |
| 05/24/23 10:20 | 341334.8 | | | 0.6 | | | 5.46 | | | 0.49 | | | 7.16 | | | 1 | |
| 05/24/23 10:21 | 340333.6 | | | 0.6 | | | 5.46 | | | 0.49 | | | 7.14 | | | 1 | |
| 05/24/23 10:22 | 340795.7 | | | 0.6 | | | 5.37 | | | 0.49 | | | 7.03 | | | 1 | |
| 05/24/23 10:23 | 339948.5 | | | 0.6 | | | 5.37 | | | 0.49 | | | 7.02 | | | 1 | |
| 05/24/23 10:24 | 340872.7 | | | 0.6 | | | 4.92 | | | 0.5 | | | 6.44 | | | 1 | |
| 05/24/23 10:25 | 340333.6 | | | 0.6 | | | 3.26 | | | 0.49 | | | 4.26 | | | 1 | |
| 05/24/23 10:26 | 340641.7 | | | 0.6 | | | 2.47 | | | 0.49 | | | 3.23 | | | 1 | |
| 05/24/23 10:27 | 340025.5 | | | 0.6 | | | 2.55 | | | 0.49 | | | 3.34 | | | 1 | |
| 05/24/23 10:28 | 339948.5 | | | 0.6 | | | 3.4 | | | 0.5 | | | 4.44 | | | 1 | |
| 05/24/23 10:29 | 340487.6 | | | 0.6 | | | 3.67 | | | 0.5 | | | 4.79 | | | 1 | |
| 05/24/23 10:30 | 340179.6 | | | 0.6 | | | 3.7 | | | 0.49 | | | 4.83 | | | 1 | |
| 05/24/23 10:31 | 339332.4 | | | 0.6 | | | 3.26 | | | 0.49 | | | 4.25 | | | 1 | |
| 05/24/23 10:32 | 340102.5 | | | 0.6 | | | 2.91 | | | 0.49 | | | 3.8 | | | 1 | |
| 05/24/23 10:33 | 339486.4 | | | 0.6 | | | 2.77 | | | 0.5 | | | 3.62 | | | 1 | |
| 05/24/23 10:34 | 340025.5 | | | 0.6 | | | 2.59 | | | 0.5 | | | 3.39 | | | 1 | |
| 05/24/23 10:35 | 339178.3 | | | 0.6 | | | 2.32 | | | 0.5 | | | 3.03 | | | 1 | |
| 05/24/23 10:36 | 339486.4 | | | 0.6 | | | 2.23 | | | 0.5 | | | 2.92 | | | 1 | |
| 05/24/23 10:37 | 339486.4 | | | 0.6 | | | 2.15 | | | 0.5 | | | 2.8 | | | 1 | |
| 05/24/23 10:38 | 339024.3 | | | 0.6 | | | 2.15 | | | 0.5 | | | 2.79 | | | 1 | |
| 05/24/23 10:39 | 338331.2 | | | 0.6 | | | 2.15 | | | 0.49 | | | 2.79 | | | 1 | |
| 05/24/23 10:40 | 338562.2 | | | 0.6 | | | 2.15 | | | 0.49 | | | 2.79 | | | 1 | |
| 05/24/23 10:41 | 337407 | | | 0.6 | | | 2.06 | | | 0.49 | | | 2.67 | | | 1 | |
| 05/24/23 10:42 | 337792.1 | | | 0.6 | | | 1.97 | | | 0.49 | | | 2.55 | | | 1 | |
| 05/24/23 10:43 | 337407 | | | 0.6 | | | 1.79 | | | 0.49 | | | 2.32 | | | 1 | |
| 05/24/23 10:44 | 336944.9 | | | 0.6 | | | 1.7 | | | 0.49 | | | 2.2 | | | 1 | |

| | CT1_GasFlow_CT_scfh_1M | | | CT1_CO_Ppmvdc_1M | | | CT1_NOx_Ppmvdc_1M | | | CT1_CO_LbPerHr_1M | | | CT1_NOx_LbPerHr_1M | | | CT1_SUSD_TF_1M | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 05/24/23 10:45 | 337252.9 | | | 0.6 | | | 1.61 | | | 0.49 | | | 2.09 | | | 1 | |
| 05/24/23 10:46 | 336867.9 | | | 0.6 | | | 1.7 | | | 0.49 | | | 2.2 | | | 1 | |
| 05/24/23 10:47 | 336790.8 | | | 0.6 | | | 1.79 | | | 0.49 | | | 2.31 | | | 0 | |
| 05/24/23 10:48 | 337484 | | | 0.6 | | | 1.79 | | | 0.49 | | | 2.32 | | | 0 | |
| 05/24/23 10:49 | 336944.9 | | | 0.6 | | | 1.79 | | | 0.49 | | | 2.31 | | | 0 | |
| 05/24/23 10:50 | 337638 | | | 0.6 | | | 1.61 | | | 0.49 | | | 2.09 | | | 0 | |
| 05/24/23 10:51 | 337561 | | | 0.6 | | | 1.52 | | | 0.49 | | | 1.97 | | | 0 | |

# CT1 SUSD EVENT 6

| | CT1_GasFlow_CT_scfh_1M | | | CT1_CO_Ppmvdc_1M | | | CT1_NOx_Ppmvdc_1M | | | CT1_CO_LbPerHr_1M | | | CT1_NOx_LbPerHr_1M | | | CT1_SUSD_TF_1M | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 05/24/23 13:49 | 351500.9 | | | 0.5 | | | 1.54 | | | 0.45 | | | 2.08 | | | 0 | |
| 05/24/23 13:50 | 350345.7 | | | 0.5 | | | 1.52 | | | 0.44 | | | 2.05 | | | 0 | |
| 05/24/23 13:51 | 355890.8 | | | 0.5 | | | 1.52 | | | 0.45 | | | 2.08 | | | 0 | |
| 05/24/23 13:52 | 357123.1 | | | 0.5 | | | 1.54 | | | 0.45 | | | 2.12 | | | 0 | |
| 05/24/23 13:53 | 358124.3 | | | 0.5 | | | 1.45 | | | 0.46 | | | 2 | | | 0 | |
| 05/24/23 13:54 | 359279.5 | | | 0.5 | | | 1.45 | | | 0.46 | | | 2 | | | 1 | |
| 05/24/23 13:55 | 351269.8 | | | 0.5 | | | 1.45 | | | 0.45 | | | 1.96 | | | 1 | |
| 05/24/23 13:56 | 336559.8 | | | 0.5 | | | 1.54 | | | 0.43 | | | 2 | | | 1 | |
| 05/24/23 13:57 | 314841.3 | | | 0.5 | | | 1.85 | | | 0.39 | | | 2.24 | | | 1 | |
| 05/24/23 13:58 | 291582.5 | | | 0.6 | | | 2.11 | | | 0.42 | | | 2.37 | | | 1 | |
| 05/24/23 13:59 | 268169.6 | | | 0.6 | | | 2.68 | | | 0.39 | | | 2.76 | | | 1 | |
| 05/24/23 14:00 | 247144.3 | | | 0.6 | | | 3.37 | | | 0.32 | | | 3.2 | | | 1 | |
| 05/24/23 14:01 | 223115.3 | | | 0.4 | | | 6.09 | | | 0.2 | | | 5.22 | | | 1 | |
| 05/24/23 14:02 | 203091.1 | | | 0.3 | | | 20.6 | | | 0.15 | | | 16.07 | | | 1 | |
| 05/24/23 14:03 | 177906.9 | | | 1.3 | | | 30.54 | | | 0.53 | | | 20.88 | | | 1 | |
| 05/24/23 14:04 | 156419.4 | | | 1.4 | | | 35.14 | | | 0.53 | | | 21.11 | | | 1 | |
| 05/24/23 14:05 | 139321.9 | | | 685 | | | 37.61 | | | 222.79 | | | 20.13 | | | 1 | |
| 05/24/23 14:06 | 61689.8 | | | 1748.3 | | | 38.27 | | | 251.63 | | | 9.06 | | | 1 | |
| 05/24/23 14:07 | 28649.9 | | | 0 | | | 39.46 | | | 199.29 | | | 4.35 | | | 0 | |
| 05/24/23 14:08 | 28341.9 | | | 0 | | | 0.4 | | | 0 | | | 0 | | | 0 | |
| 05/24/23 14:09 | 28264.9 | | | 0 | | | 0.3 | | | 0 | | | 0 | | | 0 | |
| 05/24/23 14:10 | 28033.8 | | | 0 | | | 0.2 | | | 0 | | | 0 | | | 0 | |
| 05/24/23 14:11 | 27879.8 | | | 0 | | | 0.2 | | | 0 | | | 0 | | | 0 | |

# CT1 SUSD EVENT 7

| | CT1_GasFlow_CT_scfh_1M | | | CT1_CO_Ppmvdc_1M | | | CT1_NOx_Ppmvdc_1M | | | CT1_CO_LbPerHr_1M | | | CT1_NOx_LbPerHr_1M | | | CT1_SUSD_TF_1M | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 06/29/23 7:21 | 0 | | | 0 | | | 0 | | | 0 | | | 0 | | | 0 | |
| 06/29/23 7:22 | 0 | | | 0 | | | 0 | | | 0 | | | 0 | | | 0 | |
| 06/29/23 7:23 | 0 | | | 0 | | | 0 | | | 0 | | | 0 | | | 0 | |
| 06/29/23 7:24 | 0 | | | 0 | | | 0 | | | 0 | | | 0 | | | 0 | |
| 06/29/23 7:25 | 0 | | | 0 | | | 0 | | | 0 | | | 0 | | | 0 | |
| 06/29/23 7:26 | 0 | | | 0 | | | 0 | | | 0 | | | 0 | | | 1 | |
| 06/29/23 7:27 | 6007.2 | | | 0 | | | 0 | | | 0 | | | 0 | | | 1 | |
| 06/29/23 7:28 | 28187.8 | | | 47.2 | | | 17.7 | | | 3.04 | | | 1.88 | | | 1 | |
| 06/29/23 7:29 | 44053.1 | | | 1183 | | | 11.38 | | | 119.42 | | | 1.89 | | | 1 | |
| 06/29/23 7:30 | 58301.1 | | | 783.1 | | | 14.42 | | | 104.47 | | | 3.17 | | | 1 | |
| 06/29/23 7:31 | 83947.4 | | | 461.1 | | | 17.11 | | | 88.66 | | | 5.41 | | | 1 | |
| 06/29/23 7:32 | 128385.6 | | | 299.8 | | | 20.11 | | | 88.12 | | | 9.73 | | | 1 | |
| 06/29/23 7:33 | 139475.9 | | | 186.6 | | | 33.43 | | | 59.61 | | | 17.58 | | | 1 | |
| 06/29/23 7:34 | 149257 | | | 861.2 | | | 34.11 | | | 294.37 | | | 19.19 | | | 1 | |
| 06/29/23 7:35 | 166970.6 | | | 1895.2 | | | 28.61 | | | 724.57 | | | 18 | | | 1 | |
| 06/29/23 7:36 | 186455.7 | | | 1737.2 | | | 34.42 | | | 741.58 | | | 24.18 | | | 1 | |
| 06/29/23 7:37 | 210022.6 | | | 657.9 | | | 44.9 | | | 316.49 | | | 35.54 | | | 1 | |
| 06/29/23 7:38 | 230970.9 | | | 54 | | | 49.46 | | | 28.55 | | | 43.06 | | | 1 | |
| 06/29/23 7:39 | 255924.1 | | | 4 | | | 51.97 | | | 2.33 | | | 50.12 | | | 1 | |
| 06/29/23 7:40 | 280492.2 | | | 2 | | | 44.35 | | | 1.31 | | | 46.88 | | | 1 | |
| 06/29/23 7:41 | 301517.5 | | | 1.8 | | | 21.2 | | | 1.27 | | | 24.1 | | | 1 | |
| 06/29/23 7:42 | 320232.4 | | | 1.8 | | | 15.44 | | | 1.34 | | | 18.64 | | | 1 | |
| 06/29/23 7:43 | 336790.8 | | | 1.9 | | | 13.08 | | | 1.45 | | | 16.6 | | | 1 | |
| 06/29/23 7:44 | 343260.2 | | | 1.8 | | | 9.49 | | | 1.41 | | | 12.28 | | | 1 | |
| 06/29/23 7:45 | 344492.4 | | | 1.6 | | | 8.5 | | | 1.3 | | | 11.04 | | | 1 | |
| 06/29/23 7:46 | 344569.5 | | | 1.6 | | | 8.42 | | | 1.23 | | | 10.93 | | | 1 | |
| 06/29/23 7:47 | 344338.4 | | | 1.4 | | | 7.9 | | | 1.09 | | | 10.25 | | | 1 | |
| 06/29/23 7:48 | 344030.3 | | | 1.3 | | | 7.2 | | | 1.03 | | | 9.34 | | | 1 | |
| 06/29/23 7:49 | 343953.3 | | | 1.2 | | | 6.85 | | | 0.96 | | | 8.89 | | | 1 | |
| 06/29/23 7:50 | 343799.3 | | | 1.1 | | | 6.42 | | | 0.89 | | | 8.32 | | | 1 | |
| 06/29/23 7:51 | 343799.3 | | | 1.1 | | | 6.43 | | | 0.83 | | | 8.33 | | | 1 | |
| 06/29/23 7:52 | 343722.3 | | | 1.1 | | | 6.16 | | | 0.83 | | | 7.98 | | | 1 | |

| | CT1_GasFlow_CT_scfh_1M | | | CT1_CO_Ppmvdc_1M | | | CT1_NOx_Ppmvdc_1M | | | CT1_CO_LbPerHr_1M | | | CT1_NOx_LbPerHr_1M | | | CT1_SUSD_TF_1M | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 06/29/23 7:53 | 343491.3 | | | 1 | | | 5.9 | | | 0.76 | | | 7.64 | | | 1 | |
| 06/29/23 7:54 | 343645.3 | | | 0.9 | | | 5.72 | | | 0.69 | | | 7.41 | | | 1 | |
| 06/29/23 7:55 | 343799.3 | | | 0.9 | | | 5.55 | | | 0.69 | | | 7.19 | | | 1 | |
| 06/29/23 7:56 | 344107.4 | | | 0.9 | | | 5.46 | | | 0.69 | | | 7.08 | | | 1 | |
| 06/29/23 7:57 | 343876.3 | | | 0.9 | | | 5.28 | | | 0.69 | | | 6.85 | | | 1 | |
| 06/29/23 7:58 | 343876.3 | | | 0.9 | | | 5.27 | | | 0.7 | | | 6.84 | | | 1 | |
| 06/29/23 7:59 | 344107.4 | | | 0.8 | | | 5.18 | | | 0.63 | | | 6.72 | | | 1 | |
| 06/29/23 8:00 | 344184.4 | | | 0.8 | | | 5.18 | | | 0.63 | | | 6.73 | | | 1 | |
| 06/29/23 8:01 | 344261.4 | | | 0.8 | | | 5.1 | | | 0.63 | | | 6.61 | | | 1 | |
| 06/29/23 8:02 | 344415.4 | | | 0.7 | | | 5.1 | | | 0.56 | | | 6.61 | | | 1 | |
| 06/29/23 8:03 | 343953.3 | | | 0.7 | | | 5.18 | | | 0.56 | | | 6.72 | | | 1 | |
| 06/29/23 8:04 | 343953.3 | | | 0.8 | | | 5.18 | | | 0.63 | | | 6.72 | | | 1 | |
| 06/29/23 8:05 | 344107.4 | | | 0.8 | | | 5.18 | | | 0.63 | | | 6.72 | | | 1 | |
| 06/29/23 8:06 | 344800.5 | | | 0.7 | | | 5.18 | | | 0.56 | | | 6.74 | | | 1 | |
| 06/29/23 8:07 | 355120.7 | | | 0.7 | | | 5.18 | | | 0.58 | | | 6.94 | | | 1 | |
| 06/29/23 8:08 | 372988.3 | | | 0.7 | | | 4.63 | | | 0.62 | | | 6.51 | | | 1 | |
| 06/29/23 8:09 | 392319.4 | | | 0.6 | | | 4.52 | | | 0.58 | | | 6.68 | | | 1 | |
| 06/29/23 8:10 | 392627.4 | | | 0.6 | | | 4.52 | | | 0.58 | | | 6.68 | | | 1 | |
| 06/29/23 8:11 | 393474.6 | | | 0.6 | | | 5.62 | | | 0.58 | | | 8.34 | | | 1 | |
| 06/29/23 8:12 | 411727.4 | | | 0.6 | | | 3.72 | | | 0.6 | | | 5.77 | | | 1 | |
| 06/29/23 8:13 | 434293.1 | | | 0.7 | | | 1.59 | | | 0.65 | | | 2.61 | | | 1 | |
| 06/29/23 8:14 | 440608.4 | | | 0.6 | | | 1.5 | | | 0.57 | | | 2.49 | | | 1 | |
| 06/29/23 8:15 | 437219.7 | | | 0.6 | | | 2.3 | | | 0.55 | | | 3.8 | | | 1 | |
| 06/29/23 8:16 | 436834.6 | | | 0.6 | | | 2.4 | | | 0.55 | | | 3.95 | | | 1 | |
| 06/29/23 8:17 | 437989.8 | | | 0.6 | | | 3.13 | | | 0.55 | | | 5.17 | | | 1 | |
| 06/29/23 8:18 | 439684.2 | | | 0.6 | | | 3.41 | | | 0.56 | | | 5.65 | | | 1 | |
| 06/29/23 8:19 | 441301.5 | | | 0.6 | | | 3.5 | | | 0.56 | | | 5.83 | | | 1 | |
| 06/29/23 8:20 | 441994.7 | | | 0.6 | | | 2.58 | | | 0.65 | | | 4.3 | | | 1 | |
| 06/29/23 8:21 | 442533.8 | | | 0.6 | | | 2.12 | | | 0.65 | | | 3.54 | | | 1 | |
| 06/29/23 8:22 | 442610.8 | | | 0.6 | | | 2.03 | | | 0.65 | | | 3.38 | | | 1 | |
| 06/29/23 8:23 | 442533.8 | | | 0.6 | | | 2.03 | | | 0.65 | | | 3.38 | | | 1 | |
| 06/29/23 8:24 | 442764.8 | | | 0.6 | | | 2.12 | | | 0.65 | | | 3.54 | | | 1 | |
| 06/29/23 8:25 | 442379.8 | | | 0.6 | | | 2.3 | | | 0.65 | | | 3.84 | | | 1 | |
| 06/29/23 8:26 | 442379.8 | | | 0.6 | | | 2.36 | | | 0.64 | | | 3.93 | | | 1 | |

| | CT1_GasFlow_CT_scfh_1M | | | CT1_CO_Ppmvdc_1M | | | CT1_NOx_Ppmvdc_1M | | | CT1_CO_LbPerHr_1M | | | CT1_NOx_LbPerHr_1M | | | CT1_SUSD_TF_1M | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 06/29/23 8:27 | 443535 | | | 0.6 | | | 2.49 | | | 0.66 | | | 4.16 | | | 1 | |
| 06/29/23 8:28 | 443149.9 | | | 0.6 | | | 2.3 | | | 0.65 | | | 3.85 | | | 1 | |
| 06/29/23 8:29 | 442995.9 | | | 0.6 | | | 2.03 | | | 0.65 | | | 3.39 | | | 1 | |
| 06/29/23 8:30 | 443226.9 | | | 0.6 | | | 1.75 | | | 0.65 | | | 2.93 | | | 1 | |
| 06/29/23 8:31 | 443303.9 | | | 0.6 | | | 1.57 | | | 0.66 | | | 2.62 | | | 1 | |
| 06/29/23 8:32 | 443458 | | | 0.6 | | | 1.45 | | | 0.65 | | | 2.43 | | | 1 | |
| 06/29/23 8:33 | 443612 | | | 0.6 | | | 1.45 | | | 0.65 | | | 2.43 | | | 1 | |
| 06/29/23 8:34 | 443380.9 | | | 0.6 | | | 1.54 | | | 0.65 | | | 2.58 | | | 0 | |
| 06/29/23 8:35 | 443303.9 | | | 0.6 | | | 1.72 | | | 0.65 | | | 2.88 | | | 0 | |
| 06/29/23 8:36 | 443303.9 | | | 0.6 | | | 1.82 | | | 0.65 | | | 3.03 | | | 0 | |
| 06/29/23 8:37 | 443612 | | | 0.6 | | | 1.82 | | | 0.65 | | | 3.03 | | | 0 | |
| 06/29/23 8:38 | 443612 | | | 0.6 | | | 1.82 | | | 0.65 | | | 3.03 | | | 0 | |

**ATTACHMENT 4**

# AQ-32

AQ-32 The Project owner shall maintain hourly records of NOx and CO emission concentrations (ppmv @ 15% O2), and hourly, daily, and quarterly records of NOx and CO emissions. Ongoing compliance with the CO emission limits during normal operation shall be deemed compliance with the VOC emission limits during normal operation.

**Verification:** The project owner shall submit to the CPM all concentration, hourly, daily, and quarter NOx and CO emissions as part of the Quarterly Air Quality Report required by Condition of Certification AQ-SC6

# Tons 12 Month Rolling Summary

## CT1 and CT2 Combined

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:12 **Location:** Roseville, CA

* = Excess Emission

| Date | Units CT1 & CT2 CO, Ton 1 Day(s) Sum | Rolling Sum | Units CT1 & CT2 NOx, Ton 1 Day(s) Sum | Rolling Sum | Units CT1 & CT2 PM10, Ton 1 Day(s) Sum | Rolling Sum | Units CT1 & CT2 SO2, Ton 1 Day(s) Sum | Rolling Sum | Units CT1 & CT2 VOC, Ton 1 Day(s) Sum | Rolling Sum |
|---|---|---|---|---|---|---|---|---|---|---|
| Apr 2023 | 0.0000 | 7.6802 | 0.0000 | 14.7491 | 0.0000 | 3.0357 | 0.0000 | 1.5194 | 0.0000 | 5.0594 |
| May 2023 | 0.2388 | 7.4747 | 0.0309 | 14.1876 | 0.0023 | 2.9186 | 0.0012 | 1.4610 | 0.0038 | 4.8643 |
| Jun 2023 | 0.0363 | 6.7942 | 0.0578 | 13.1511 | 0.0115 | 2.7118 | 0.0057 | 1.3575 | 0.0192 | 4.5191 |
| **Sum/Avg** | 6.7942 | | 13.1511 | | 2.7118 | | 1.3575 | | 4.5191 | |
| **Limit Value** | | | | | | | | | | |

# AQ32 DAILY NOX CO

| | CT1_CO_Lb_1D | | | CT1_NOx_Lb_1D | | | CT2_CO_Lb_1D | | | CT2_NOx_Lb_1D | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 04/01/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 04/02/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 04/03/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 04/04/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 04/05/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 04/06/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 04/07/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 04/08/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 04/09/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 04/10/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 04/11/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 04/12/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 04/13/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 04/14/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 04/15/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 04/16/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 04/17/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 04/18/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 04/19/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 04/20/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 04/21/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 04/22/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 04/23/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 04/24/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 04/25/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 04/26/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 04/27/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 04/28/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 04/29/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 04/30/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 05/01/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 05/02/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |

| | CT1_CO_Lb_1D | | | CT1_NOx_Lb_1D | | | CT2_CO_Lb_1D | | | CT2_NOx_Lb_1D | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 05/03/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 05/04/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 05/05/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 05/06/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 05/07/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 05/08/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 05/09/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 05/10/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 05/11/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 05/12/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 05/13/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 05/14/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 05/15/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 05/16/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 05/17/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 05/18/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 05/19/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 05/20/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 05/21/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 05/22/23 0:00 | 412.55 | | | 31.76 | | | 0 | | | 0 | | | | | | | |
| 05/23/23 0:00 | 8.72 | | | 10.48 | | | 0 | | | 0 | | | | | | | |
| 05/24/23 0:00 | 50.78 | | | 19.62 | | | 0 | | | 0 | | | | | | | |
| 05/25/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 05/26/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 05/27/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 05/28/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 05/29/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 05/30/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 05/31/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 06/01/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 06/02/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 06/03/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 06/04/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 06/05/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |

| | CT1_CO_Lb_1D | | | CT1_NOx_Lb_1D | | | CT2_CO_Lb_1D | | | CT2_NOx_Lb_1D | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 06/06/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 06/07/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 06/08/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 06/09/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 06/10/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 06/11/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 06/12/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 06/13/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 06/14/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 06/15/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 06/16/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 06/17/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 06/18/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 06/19/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 06/20/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 06/21/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 06/22/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 06/23/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 06/24/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 06/25/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 06/26/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 06/27/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 06/28/23 0:00 | 0 | | | 0 | | | 0 | | | 0 | | | | | | | |
| 06/29/23 0:00 | 55.41 | | | 49.9 | | | 0 | | | 0 | | | | | | | |
| 06/30/23 0:00 | 17.21 | | | 65.68 | | | 0 | | | 0 | | | | | | | |

# AQ32 HOURLY NOX CO

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_O2Dry_Pct_1H | | | CT2_CO_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT2_O2Dry_Pct_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 04/01/23 0:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/01/23 1:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/01/23 2:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/01/23 3:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/01/23 4:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/01/23 5:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/01/23 6:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/01/23 7:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/01/23 8:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/01/23 9:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/01/23 10:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/01/23 11:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/01/23 12:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/01/23 13:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/01/23 14:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/01/23 15:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/01/23 16:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/01/23 17:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/01/23 18:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |

| | | | | | | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 04/01/23 19:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | 1 |
| 04/01/23 20:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | 1 |
| 04/01/23 21:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | 1 |
| 04/01/23 22:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | 1 |
| 04/01/23 23:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | 1 |
| 04/02/23 0:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | 1 |
| 04/02/23 1:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | 1 |
| 04/02/23 2:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | 1 |
| 04/02/23 3:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | 1 |
| 04/02/23 4:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | 1 |
| 04/02/23 5:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | 1 |
| 04/02/23 6:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | 1 |
| 04/02/23 7:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | 1 |



| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_O2Dry_Pct_1H | | | CT2_CO_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT2_O2Dry_Pct_1H | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** |
| 04/02/23 8:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | 1 |
| 04/02/23 9:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | 1 |
| 04/02/23 10:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | 1 |
| 04/02/23 11:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | 1 |
| 04/02/23 12:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | 1 |
| 04/02/23 13:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | 1 |

| | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 04/02/23 14:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/02/23 15:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/02/23 16:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/02/23 17:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/02/23 18:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/02/23 19:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/02/23 20:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/02/23 21:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/02/23 22:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/02/23 23:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/03/23 0:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/03/23 1:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/03/23 2:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/03/23 3:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/03/23 4:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/03/23 5:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/03/23 6:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/03/23 7:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/03/23 8:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/03/23 9:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/03/23 10:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/03/23 11:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/03/23 12:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |

| | | | | | | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 04/03/23 13:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 04/03/23 14:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 04/03/23 15:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 04/03/23 16:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 04/03/23 17:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |



| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_O2Dry_Pct_1H | | | CT2_CO_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT2_O2Dry_Pct_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 04/03/23 18:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/03/23 19:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/03/23 20:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/03/23 21:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/03/23 22:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/03/23 23:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/04/23 0:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/04/23 1:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/04/23 2:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/04/23 3:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/04/23 4:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/04/23 5:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/04/23 6:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/04/23 7:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |

| | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 1 | | | | | | | | | | | | | |
| 04/04/23 8:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/04/23 9:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/04/23 10:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/04/23 11:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/04/23 12:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/04/23 13:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/04/23 14:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/04/23 15:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/04/23 16:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/04/23 17:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/04/23 18:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/04/23 19:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/04/23 20:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/04/23 21:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/04/23 22:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/04/23 23:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/05/23 0:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/05/23 1:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/05/23 2:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/05/23 3:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_O2Dry_Pct_1H | | | CT2_CO_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT2_O2Dry_Pct_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 04/05/23 4:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/05/23 5:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/05/23 6:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/05/23 7:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/05/23 8:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/05/23 9:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/05/23 10:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/05/23 11:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/05/23 12:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/05/23 13:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/05/23 14:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/05/23 15:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/05/23 16:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/05/23 17:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/05/23 18:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/05/23 19:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/05/23 20:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/05/23 21:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/05/23 22:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/05/23 23:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/06/23 0:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |

| | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 04/06/23 1:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 04/06/23 2:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 04/06/23 3:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 04/06/23 4:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 04/06/23 5:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 04/06/23 6:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 04/06/23 7:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 04/06/23 8:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 04/06/23 9:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 04/06/23 10:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 04/06/23 11:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 04/06/23 12:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 04/06/23 13:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |



| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_O2Dry_Pct_1H | | | CT2_CO_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT2_O2Dry_Pct_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 04/06/23 14:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/06/23 15:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/06/23 16:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/06/23 17:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/06/23 18:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/06/23 19:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |

| | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 1 | | | | | | | | | | | | | |
| 04/06/23 20:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/06/23 21:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/06/23 22:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/06/23 23:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/07/23 0:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/07/23 1:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/07/23 2:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/07/23 3:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/07/23 4:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/07/23 5:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/07/23 6:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/07/23 7:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/07/23 8:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/07/23 9:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/07/23 10:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/07/23 11:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/07/23 12:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/07/23 13:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/07/23 14:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/07/23 15:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/07/23 16:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/07/23 17:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/07/23 18:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |

| | | | | | | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 1 | | | | | | | | | | | | | | | | | | |
| 04/07/23 19:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 04/07/23 20:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 04/07/23 21:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 04/07/23 22:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 04/07/23 23:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |



| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_O2Dry_Pct_1H | | | CT2_CO_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT2_O2Dry_Pct_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 04/08/23 0:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/08/23 1:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/08/23 2:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/08/23 3:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/08/23 4:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/08/23 5:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/08/23 6:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/08/23 7:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/08/23 8:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/08/23 9:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/08/23 10:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/08/23 11:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/08/23 12:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |

| | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 04/08/23 13:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/08/23 14:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/08/23 15:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/08/23 16:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/08/23 17:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/08/23 18:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/08/23 19:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/08/23 20:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/08/23 21:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/08/23 22:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/08/23 23:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/09/23 0:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/09/23 1:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/09/23 2:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/09/23 3:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/09/23 4:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/09/23 5:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/09/23 6:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/09/23 7:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/09/23 8:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/09/23 9:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_O2Dry_Pct_1H | | | CT2_CO_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT2_O2Dry_Pct_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 04/09/23 10:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/09/23 11:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/09/23 12:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/09/23 13:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/09/23 14:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/09/23 15:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/09/23 16:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/09/23 17:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/09/23 18:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/09/23 19:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/09/23 20:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/09/23 21:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/09/23 22:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/09/23 23:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/10/23 0:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/10/23 1:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/10/23 2:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/10/23 3:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/10/23 4:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/10/23 5:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/10/23 6:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |

| | | | | | | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 04/10/23 7:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 04/10/23 8:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 04/10/23 9:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 04/10/23 10:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 04/10/23 11:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 04/10/23 12:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 04/10/23 13:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 04/10/23 14:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 04/10/23 15:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 04/10/23 16:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 04/10/23 17:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 04/10/23 18:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 04/10/23 19:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |



| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_O2Dry_Pct_1H | | | CT2_CO_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT2_O2Dry_Pct_1H | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** |
| 04/10/23 20:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 04/10/23 21:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 04/10/23 22:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 04/10/23 23:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 04/11/23 0:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 04/11/23 1:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |

| | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 1 | | | | | | | | | | | | | |
| 04/11/23 2:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/11/23 3:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/11/23 4:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/11/23 5:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/11/23 6:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/11/23 7:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/11/23 8:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/11/23 9:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/11/23 10:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/11/23 11:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/11/23 12:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/11/23 13:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/11/23 14:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/11/23 15:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/11/23 16:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/11/23 17:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/11/23 18:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/11/23 19:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/11/23 20:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/11/23 21:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/11/23 22:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/11/23 23:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/12/23 0:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |

| | | | | | | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 1 | | | | | | | | | | | | | | | | | | |
| 04/12/23 1:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 04/12/23 2:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 04/12/23 3:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 04/12/23 4:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 04/12/23 5:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |



| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_O2Dry_Pct_1H | | | CT2_CO_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT2_O2Dry_Pct_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 04/12/23 6:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/12/23 7:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/12/23 8:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/12/23 9:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/12/23 10:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/12/23 11:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/12/23 12:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/12/23 13:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/12/23 14:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/12/23 15:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/12/23 16:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/12/23 17:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/12/23 18:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |

| | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 04/12/23 19:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/12/23 20:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/12/23 21:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/12/23 22:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/12/23 23:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/13/23 0:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/13/23 1:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/13/23 2:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/13/23 3:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/13/23 4:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/13/23 5:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/13/23 6:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/13/23 7:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/13/23 8:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/13/23 9:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/13/23 10:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/13/23 11:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/13/23 12:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/13/23 13:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/13/23 14:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/13/23 15:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_O2Dry_Pct_1H | | | CT2_CO_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT2_O2Dry_Pct_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 04/13/23 16:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/13/23 17:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/13/23 18:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/13/23 19:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/13/23 20:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/13/23 21:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/13/23 22:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/13/23 23:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/14/23 0:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/14/23 1:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/14/23 2:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/14/23 3:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/14/23 4:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/14/23 5:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/14/23 6:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/14/23 7:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/14/23 8:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/14/23 9:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/14/23 10:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/14/23 11:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/14/23 12:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |

| | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 04/14/23 13:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/14/23 14:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/14/23 15:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/14/23 16:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/14/23 17:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/14/23 18:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/14/23 19:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/14/23 20:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/14/23 21:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/14/23 22:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/14/23 23:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/15/23 0:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/15/23 1:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |



| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_O2Dry_Pct_1H | | | CT2_CO_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT2_O2Dry_Pct_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 04/15/23 2:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/15/23 3:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/15/23 4:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/15/23 5:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/15/23 6:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/15/23 7:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |

| | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 1 | | | | | | | | | | | | | |
| 04/15/23 8:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/15/23 9:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/15/23 10:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/15/23 11:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/15/23 12:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/15/23 13:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/15/23 14:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/15/23 15:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/15/23 16:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/15/23 17:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/15/23 18:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/15/23 19:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/15/23 20:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/15/23 21:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/15/23 22:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/15/23 23:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/16/23 0:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/16/23 1:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/16/23 2:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/16/23 3:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/16/23 4:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/16/23 5:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/16/23 6:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |

| | | | | | | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 1 | | | | | | | | | | | | | | | | | | |
| 04/16/23 7:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 04/16/23 8:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 04/16/23 9:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 04/16/23 10:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 04/16/23 11:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |



| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_O2Dry_Pct_1H | | | CT2_CO_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT2_O2Dry_Pct_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 04/16/23 12:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/16/23 13:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/16/23 14:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/16/23 15:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/16/23 16:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/16/23 17:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/16/23 18:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/16/23 19:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/16/23 20:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/16/23 21:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/16/23 22:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/16/23 23:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/17/23 0:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |

| | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 04/17/23 1:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/17/23 2:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/17/23 3:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/17/23 4:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/17/23 5:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/17/23 6:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/17/23 7:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/17/23 8:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/17/23 9:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/17/23 10:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/17/23 11:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/17/23 12:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/17/23 13:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/17/23 14:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/17/23 15:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/17/23 16:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/17/23 17:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/17/23 18:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/17/23 19:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/17/23 20:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/17/23 21:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_O2Dry_Pct_1H | | | CT2_CO_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT2_O2Dry_Pct_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 04/17/23 22:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/17/23 23:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/18/23 0:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/18/23 1:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/18/23 2:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/18/23 3:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/18/23 4:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/18/23 5:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/18/23 6:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/18/23 7:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/18/23 8:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/18/23 9:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/18/23 10:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/18/23 11:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/18/23 12:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/18/23 13:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/18/23 14:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/18/23 15:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/18/23 16:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/18/23 17:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/18/23 18:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |

| | | | | | | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 04/18/23 19:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 04/18/23 20:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 04/18/23 21:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 04/18/23 22:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 04/18/23 23:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 04/19/23 0:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 04/19/23 1:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 04/19/23 2:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 04/19/23 3:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 04/19/23 4:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 04/19/23 5:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 04/19/23 6:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 04/19/23 7:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |



| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_O2Dry_Pct_1H | | | CT2_CO_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT2_O2Dry_Pct_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 04/19/23 8:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/19/23 9:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/19/23 10:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/19/23 11:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/19/23 12:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/19/23 13:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |

| | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 1 | | | | | | | | | | | | | |
| 04/19/23 14:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/19/23 15:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/19/23 16:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/19/23 17:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/19/23 18:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/19/23 19:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/19/23 20:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/19/23 21:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/19/23 22:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/19/23 23:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/20/23 0:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/20/23 1:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/20/23 2:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/20/23 3:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/20/23 4:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/20/23 5:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/20/23 6:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/20/23 7:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/20/23 8:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/20/23 9:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/20/23 10:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/20/23 11:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/20/23 12:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |

| | | | | | | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 1 | | | | | | | | | | | | | | | | | | |
| 04/20/23 13:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 04/20/23 14:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 04/20/23 15:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 04/20/23 16:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 04/20/23 17:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |



| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_O2Dry_Pct_1H | | | CT2_CO_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT2_O2Dry_Pct_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 04/20/23 18:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/20/23 19:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/20/23 20:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/20/23 21:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/20/23 22:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/20/23 23:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/21/23 0:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/21/23 1:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/21/23 2:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/21/23 3:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/21/23 4:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/21/23 5:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/21/23 6:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |

| | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 04/21/23 7:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/21/23 8:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/21/23 9:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/21/23 10:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/21/23 11:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/21/23 12:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/21/23 13:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/21/23 14:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/21/23 15:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/21/23 16:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/21/23 17:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/21/23 18:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/21/23 19:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/21/23 20:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/21/23 21:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/21/23 22:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/21/23 23:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/22/23 0:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/22/23 1:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/22/23 2:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/22/23 3:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_O2Dry_Pct_1H | | | CT2_CO_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT2_O2Dry_Pct_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 04/22/23 4:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/22/23 5:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/22/23 6:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/22/23 7:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/22/23 8:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/22/23 9:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/22/23 10:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/22/23 11:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/22/23 12:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/22/23 13:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/22/23 14:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/22/23 15:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/22/23 16:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/22/23 17:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/22/23 18:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/22/23 19:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/22/23 20:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/22/23 21:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/22/23 22:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/22/23 23:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/23/23 0:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |

| | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 04/23/23 1:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 04/23/23 2:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 04/23/23 3:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 04/23/23 4:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 04/23/23 5:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 04/23/23 6:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 04/23/23 7:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 04/23/23 8:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 04/23/23 9:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 04/23/23 10:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 04/23/23 11:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 04/23/23 12:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 04/23/23 13:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |



| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_O2Dry_Pct_1H | | | CT2_CO_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT2_O2Dry_Pct_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 04/23/23 14:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/23/23 15:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/23/23 16:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/23/23 17:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/23/23 18:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/23/23 19:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |

| | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 1 | | | | | | | | | | | | | |
| 04/23/23 20:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/23/23 21:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/23/23 22:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/23/23 23:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/24/23 0:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/24/23 1:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/24/23 2:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/24/23 3:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/24/23 4:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/24/23 5:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/24/23 6:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/24/23 7:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/24/23 8:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/24/23 9:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/24/23 10:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/24/23 11:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/24/23 12:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/24/23 13:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/24/23 14:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/24/23 15:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/24/23 16:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/24/23 17:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/24/23 18:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |

| | | | | | | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 1 | | | | | | | | | | | | | | | | | | |
| 04/24/23 19:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 04/24/23 20:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 04/24/23 21:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 04/24/23 22:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 04/24/23 23:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |



| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_O2Dry_Pct_1H | | | CT2_CO_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT2_O2Dry_Pct_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 04/25/23 0:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/25/23 1:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/25/23 2:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/25/23 3:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/25/23 4:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/25/23 5:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/25/23 6:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/25/23 7:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/25/23 8:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/25/23 9:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/25/23 10:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/25/23 11:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/25/23 12:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |

| | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 04/25/23 13:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/25/23 14:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/25/23 15:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/25/23 16:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/25/23 17:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/25/23 18:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/25/23 19:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/25/23 20:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/25/23 21:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/25/23 22:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/25/23 23:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/26/23 0:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/26/23 1:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/26/23 2:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/26/23 3:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/26/23 4:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/26/23 5:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/26/23 6:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/26/23 7:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/26/23 8:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/26/23 9:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_O2Dry_Pct_1H | | | CT2_CO_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT2_O2Dry_Pct_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 04/26/23 10:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/26/23 11:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/26/23 12:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/26/23 13:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/26/23 14:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/26/23 15:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/26/23 16:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/26/23 17:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/26/23 18:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/26/23 19:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/26/23 20:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/26/23 21:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/26/23 22:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/26/23 23:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/27/23 0:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/27/23 1:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/27/23 2:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/27/23 3:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/27/23 4:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/27/23 5:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/27/23 6:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |

| | | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 04/27/23 7:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 04/27/23 8:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 04/27/23 9:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 04/27/23 10:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 04/27/23 11:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 04/27/23 12:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 04/27/23 13:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 04/27/23 14:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 04/27/23 15:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 04/27/23 16:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 04/27/23 17:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 04/27/23 18:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 04/27/23 19:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |



| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_O2Dry_Pct_1H | | | CT2_CO_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT2_O2Dry_Pct_1H | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** |
| 04/27/23 20:00 | 0 | X | 1 | 0 | X | 1 | 0 | X | 1 | 0 | X | 1 | 0 | X | 1 | 0 | X | 1 |
| 04/27/23 21:00 | 0 | X | 1 | 0 | X | 1 | 0 | X | 1 | 0 | X | 1 | 0 | X | 1 | 0 | X | 1 |
| 04/27/23 22:00 | 0 | X | 1 | 0 | X | 1 | 0 | X | 1 | 0 | X | 1 | 0 | X | 1 | 0 | X | 1 |
| 04/27/23 23:00 | 0 | X | 1 | 0 | X | 1 | 0 | X | 1 | 0 | X | 1 | 0 | X | 1 | 0 | X | 1 |
| 04/28/23 0:00 | 0 | X | 1 | 0 | X | 1 | 0 | X | 1 | 0 | X | 1 | 0 | X | 1 | 0 | X | 1 |
| 04/28/23 1:00 | 0 | X | 1 | 0 | X | 1 | 0 | X | 1 | 0 | X | 1 | 0 | X | 1 | 0 | X | 1 |

| | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 1 | | | | | | | | | | | | | |
| 04/28/23 2:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/28/23 3:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/28/23 4:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/28/23 5:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/28/23 6:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/28/23 7:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/28/23 8:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/28/23 9:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/28/23 10:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/28/23 11:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/28/23 12:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/28/23 13:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/28/23 14:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/28/23 15:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/28/23 16:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/28/23 17:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/28/23 18:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/28/23 19:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/28/23 20:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/28/23 21:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/28/23 22:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/28/23 23:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/29/23 0:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |

| | | | | | | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 1 | | | | | | | | | | | | | | | | | | |
| 04/29/23 1:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 04/29/23 2:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 04/29/23 3:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 04/29/23 4:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 04/29/23 5:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |



| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_O2Dry_Pct_1H | | | CT2_CO_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT2_O2Dry_Pct_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 04/29/23 6:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/29/23 7:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/29/23 8:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/29/23 9:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/29/23 10:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/29/23 11:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/29/23 12:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/29/23 13:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/29/23 14:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/29/23 15:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/29/23 16:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/29/23 17:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 04/29/23 18:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |

| | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 04/29/23 19:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/29/23 20:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/29/23 21:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/29/23 22:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/29/23 23:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/30/23 0:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/30/23 1:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/30/23 2:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/30/23 3:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/30/23 4:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/30/23 5:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/30/23 6:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/30/23 7:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/30/23 8:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/30/23 9:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/30/23 10:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/30/23 11:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/30/23 12:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/30/23 13:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/30/23 14:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 04/30/23 15:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_O2Dry_Pct_1H | | | CT2_CO_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT2_O2Dry_Pct_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 04/30/23 16:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/30/23 17:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/30/23 18:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/30/23 19:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/30/23 20:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/30/23 21:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/30/23 22:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 04/30/23 23:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/01/23 0:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/01/23 1:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/01/23 2:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/01/23 3:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/01/23 4:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/01/23 5:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/01/23 6:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/01/23 7:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/01/23 8:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/01/23 9:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/01/23 10:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/01/23 11:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/01/23 12:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |

| | | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 05/01/23 13:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 05/01/23 14:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 05/01/23 15:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 05/01/23 16:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 05/01/23 17:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 05/01/23 18:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 05/01/23 19:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 05/01/23 20:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 05/01/23 21:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 05/01/23 22:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 05/01/23 23:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 05/02/23 0:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 05/02/23 1:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |



| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_O2Dry_Pct_1H | | | CT2_CO_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT2_O2Dry_Pct_1H | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** |
| 05/02/23 2:00 | 0 | X | 1 | 0 | X | 1 | 0 | X | 1 | 0 | X | 1 | 0 | X | 1 | 0 | X | 1 |
| 05/02/23 3:00 | 0 | X | 1 | 0 | X | 1 | 0 | X | 1 | 0 | X | 1 | 0 | X | 1 | 0 | X | 1 |
| 05/02/23 4:00 | 0 | X | 1 | 0 | X | 1 | 0 | X | 1 | 0 | X | 1 | 0 | X | 1 | 0 | X | 1 |
| 05/02/23 5:00 | 0 | X | 1 | 0 | X | 1 | 0 | X | 1 | 0 | X | 1 | 0 | X | 1 | 0 | X | 1 |
| 05/02/23 6:00 | 0 | X | 1 | 0 | X | 1 | 0 | X | 1 | 0 | X | 1 | 0 | X | 1 | 0 | X | 1 |
| 05/02/23 7:00 | 0 | X | 1 | 0 | X | 1 | 0 | X | 1 | 0 | X | 1 | 0 | X | 1 | 0 | X | 1 |

| | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 1 | | | | | | | | | | | | | |
| 05/02/23 8:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/02/23 9:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/02/23 10:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/02/23 11:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/02/23 12:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/02/23 13:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/02/23 14:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/02/23 15:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/02/23 16:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/02/23 17:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/02/23 18:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/02/23 19:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/02/23 20:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/02/23 21:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/02/23 22:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/02/23 23:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/03/23 0:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/03/23 1:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/03/23 2:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/03/23 3:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/03/23 4:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/03/23 5:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/03/23 6:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |

| | | | | | | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 1 | | | | | | | | | | | | | | | | | | |
| 05/03/23 7:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 05/03/23 8:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 05/03/23 9:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 05/03/23 10:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 05/03/23 11:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |



| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_O2Dry_Pct_1H | | | CT2_CO_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT2_O2Dry_Pct_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 05/03/23 12:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/03/23 13:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/03/23 14:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/03/23 15:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/03/23 16:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/03/23 17:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/03/23 18:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/03/23 19:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/03/23 20:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/03/23 21:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/03/23 22:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/03/23 23:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/04/23 0:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |

| | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 05/04/23 1:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/04/23 2:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/04/23 3:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/04/23 4:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/04/23 5:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/04/23 6:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/04/23 7:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/04/23 8:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/04/23 9:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/04/23 10:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/04/23 11:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/04/23 12:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/04/23 13:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/04/23 14:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/04/23 15:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/04/23 16:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/04/23 17:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/04/23 18:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/04/23 19:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/04/23 20:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/04/23 21:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_O2Dry_Pct_1H | | | CT2_CO_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT2_O2Dry_Pct_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 05/04/23 22:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/04/23 23:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/05/23 0:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/05/23 1:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/05/23 2:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/05/23 3:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/05/23 4:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/05/23 5:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/05/23 6:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/05/23 7:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/05/23 8:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/05/23 9:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/05/23 10:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/05/23 11:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/05/23 12:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/05/23 13:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/05/23 14:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/05/23 15:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/05/23 16:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/05/23 17:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/05/23 18:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |

| | | | | | | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 05/05/23 19:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 05/05/23 20:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 05/05/23 21:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 05/05/23 22:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 05/05/23 23:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 05/06/23 0:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 05/06/23 1:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 05/06/23 2:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 05/06/23 3:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 05/06/23 4:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 05/06/23 5:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 05/06/23 6:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 05/06/23 7:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |



| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_O2Dry_Pct_1H | | | CT2_CO_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT2_O2Dry_Pct_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 05/06/23 8:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/06/23 9:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/06/23 10:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/06/23 11:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/06/23 12:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/06/23 13:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |

| | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 1 | | | | | | | | | | | | | |
| 05/06/23 14:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/06/23 15:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/06/23 16:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/06/23 17:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/06/23 18:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/06/23 19:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/06/23 20:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/06/23 21:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/06/23 22:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/06/23 23:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/07/23 0:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/07/23 1:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/07/23 2:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/07/23 3:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/07/23 4:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/07/23 5:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/07/23 6:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/07/23 7:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/07/23 8:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/07/23 9:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/07/23 10:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/07/23 11:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/07/23 12:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |

| | | | | | | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 1 | | | | | | | | | | | | | | | | | | |
| 05/07/23 13:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 05/07/23 14:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 05/07/23 15:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 05/07/23 16:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 05/07/23 17:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |



| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_O2Dry_Pct_1H | | | CT2_CO_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT2_O2Dry_Pct_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 05/07/23 18:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/07/23 19:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/07/23 20:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/07/23 21:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/07/23 22:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/07/23 23:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/08/23 0:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/08/23 1:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/08/23 2:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/08/23 3:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/08/23 4:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/08/23 5:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/08/23 6:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |

| | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 05/08/23 7:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/08/23 8:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/08/23 9:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/08/23 10:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/08/23 11:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/08/23 12:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/08/23 13:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/08/23 14:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/08/23 15:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/08/23 16:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/08/23 17:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/08/23 18:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/08/23 19:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/08/23 20:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/08/23 21:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/08/23 22:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/08/23 23:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/09/23 0:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/09/23 1:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/09/23 2:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/09/23 3:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_O2Dry_Pct_1H | | | CT2_CO_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT2_O2Dry_Pct_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 05/09/23 4:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/09/23 5:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/09/23 6:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/09/23 7:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/09/23 8:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/09/23 9:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/09/23 10:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/09/23 11:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/09/23 12:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/09/23 13:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/09/23 14:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/09/23 15:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/09/23 16:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/09/23 17:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/09/23 18:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/09/23 19:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/09/23 20:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/09/23 21:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/09/23 22:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/09/23 23:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/10/23 0:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |

| | | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 05/10/23 1:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 05/10/23 2:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 05/10/23 3:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 05/10/23 4:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 05/10/23 5:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 05/10/23 6:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 05/10/23 7:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 05/10/23 8:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 05/10/23 9:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 05/10/23 10:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 05/10/23 11:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 05/10/23 12:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 05/10/23 13:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |



| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_O2Dry_Pct_1H | | | CT2_CO_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT2_O2Dry_Pct_1H | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** |
| 05/10/23 14:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 05/10/23 15:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 05/10/23 16:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 05/10/23 17:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 05/10/23 18:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 05/10/23 19:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |

| | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 1 | | | | | | | | | | | | | |
| 05/10/23 20:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/10/23 21:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/10/23 22:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/10/23 23:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/11/23 0:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/11/23 1:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/11/23 2:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/11/23 3:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/11/23 4:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/11/23 5:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/11/23 6:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/11/23 7:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/11/23 8:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/11/23 9:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/11/23 10:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/11/23 11:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/11/23 12:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/11/23 13:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/11/23 14:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/11/23 15:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/11/23 16:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/11/23 17:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/11/23 18:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |

| | | | | | | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 1 | | | | | | | | | | | | | | | | | | |
| 05/11/23 19:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 05/11/23 20:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 05/11/23 21:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 05/11/23 22:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 05/11/23 23:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |



| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_O2Dry_Pct_1H | | | CT2_CO_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT2_O2Dry_Pct_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 05/12/23 0:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/12/23 1:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/12/23 2:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/12/23 3:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/12/23 4:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/12/23 5:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/12/23 6:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/12/23 7:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/12/23 8:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/12/23 9:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/12/23 10:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/12/23 11:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/12/23 12:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |

| | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 05/12/23 13:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/12/23 14:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/12/23 15:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/12/23 16:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/12/23 17:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/12/23 18:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/12/23 19:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/12/23 20:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/12/23 21:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/12/23 22:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/12/23 23:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/13/23 0:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/13/23 1:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/13/23 2:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/13/23 3:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/13/23 4:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/13/23 5:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/13/23 6:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/13/23 7:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/13/23 8:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/13/23 9:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_O2Dry_Pct_1H | | | CT2_CO_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT2_O2Dry_Pct_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 05/13/23 10:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/13/23 11:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/13/23 12:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/13/23 13:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/13/23 14:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/13/23 15:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/13/23 16:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/13/23 17:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/13/23 18:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/13/23 19:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/13/23 20:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/13/23 21:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/13/23 22:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/13/23 23:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/14/23 0:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/14/23 1:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/14/23 2:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/14/23 3:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/14/23 4:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/14/23 5:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/14/23 6:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |

| | | | | | | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 05/14/23 7:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 05/14/23 8:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 05/14/23 9:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 05/14/23 10:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 05/14/23 11:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 05/14/23 12:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 05/14/23 13:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 05/14/23 14:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 05/14/23 15:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 05/14/23 16:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 05/14/23 17:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 05/14/23 18:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 05/14/23 19:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |



| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_O2Dry_Pct_1H | | | CT2_CO_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT2_O2Dry_Pct_1H | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** |
| 05/14/23 20:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 05/14/23 21:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 05/14/23 22:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 05/14/23 23:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 05/15/23 0:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 05/15/23 1:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |

| | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 1 | | | | | | | | | | | | | |
| 05/15/23 2:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/15/23 3:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/15/23 4:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/15/23 5:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/15/23 6:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/15/23 7:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/15/23 8:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/15/23 9:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/15/23 10:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/15/23 11:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/15/23 12:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/15/23 13:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/15/23 14:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/15/23 15:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/15/23 16:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/15/23 17:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/15/23 18:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/15/23 19:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/15/23 20:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/15/23 21:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/15/23 22:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/15/23 23:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/16/23 0:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |

| | | | | | | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 1 | | | | | | | | | | | | | | | | | | |
| 05/16/23 1:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 05/16/23 2:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 05/16/23 3:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 05/16/23 4:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 05/16/23 5:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |



| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_O2Dry_Pct_1H | | | CT2_CO_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT2_O2Dry_Pct_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 05/16/23 6:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/16/23 7:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/16/23 8:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/16/23 9:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/16/23 10:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/16/23 11:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/16/23 12:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/16/23 13:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/16/23 14:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/16/23 15:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/16/23 16:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/16/23 17:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/16/23 18:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |

| | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 05/16/23 19:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/16/23 20:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/16/23 21:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/16/23 22:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/16/23 23:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/17/23 0:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/17/23 1:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/17/23 2:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/17/23 3:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/17/23 4:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/17/23 5:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/17/23 6:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/17/23 7:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/17/23 8:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/17/23 9:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/17/23 10:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/17/23 11:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/17/23 12:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/17/23 13:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/17/23 14:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/17/23 15:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_O2Dry_Pct_1H | | | CT2_CO_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT2_O2Dry_Pct_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 05/17/23 16:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/17/23 17:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/17/23 18:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/17/23 19:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/17/23 20:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/17/23 21:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/17/23 22:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/17/23 23:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/18/23 0:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/18/23 1:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/18/23 2:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/18/23 3:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/18/23 4:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/18/23 5:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/18/23 6:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/18/23 7:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/18/23 8:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/18/23 9:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/18/23 10:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/18/23 11:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/18/23 12:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |

| | | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 05/18/23 13:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 05/18/23 14:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 05/18/23 15:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 05/18/23 16:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 05/18/23 17:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 05/18/23 18:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 05/18/23 19:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 05/18/23 20:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 05/18/23 21:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 05/18/23 22:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 05/18/23 23:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 05/19/23 0:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 05/19/23 1:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |



| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_O2Dry_Pct_1H | | | CT2_CO_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT2_O2Dry_Pct_1H | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** |
| 05/19/23 2:00 | 0 | X | 1 | 0 | X | 1 | 0 | X | 1 | 0 | X | 1 | 0 | X | 1 | 0 | X | 1 |
| 05/19/23 3:00 | 0 | X | 1 | 0 | X | 1 | 0 | X | 1 | 0 | X | 1 | 0 | X | 1 | 0 | X | 1 |
| 05/19/23 4:00 | 0 | X | 1 | 0 | X | 1 | 0 | X | 1 | 0 | X | 1 | 0 | X | 1 | 0 | X | 1 |
| 05/19/23 5:00 | 0 | X | 1 | 0 | X | 1 | 0 | X | 1 | 0 | X | 1 | 0 | X | 1 | 0 | X | 1 |
| 05/19/23 6:00 | 0 | X | 1 | 0 | X | 1 | 0 | X | 1 | 0 | X | 1 | 0 | X | 1 | 0 | X | 1 |
| 05/19/23 7:00 | 0 | X | 1 | 0 | X | 1 | 0 | X | 1 | 0 | X | 1 | 0 | X | 1 | 0 | X | 1 |

| | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 1 | | | | | | | | | | | | | |
| 05/19/23 8:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/19/23 9:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/19/23 10:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/19/23 11:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/19/23 12:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/19/23 13:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/19/23 14:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/19/23 15:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/19/23 16:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/19/23 17:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/19/23 18:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/19/23 19:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/19/23 20:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/19/23 21:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/19/23 22:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/19/23 23:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/20/23 0:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/20/23 1:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/20/23 2:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/20/23 3:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/20/23 4:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/20/23 5:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/20/23 6:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |

| | | | | | | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 1 | | | | | | | | | | | | | | | | | | |
| 05/20/23 7:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 05/20/23 8:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 05/20/23 9:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 05/20/23 10:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 05/20/23 11:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |



| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_O2Dry_Pct_1H | | | CT2_CO_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT2_O2Dry_Pct_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 05/20/23 12:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/20/23 13:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/20/23 14:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/20/23 15:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/20/23 16:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/20/23 17:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/20/23 18:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/20/23 19:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/20/23 20:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/20/23 21:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/20/23 22:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/20/23 23:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/21/23 0:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |

| | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 05/21/23 1:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/21/23 2:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/21/23 3:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/21/23 4:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/21/23 5:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/21/23 6:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/21/23 7:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/21/23 8:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/21/23 9:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/21/23 10:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/21/23 11:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/21/23 12:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/21/23 13:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/21/23 14:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/21/23 15:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/21/23 16:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/21/23 17:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/21/23 18:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/21/23 19:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/21/23 20:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/21/23 21:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_O2Dry_Pct_1H | | | CT2_CO_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT2_O2Dry_Pct_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 05/21/23 22:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/21/23 23:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/22/23 0:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/22/23 1:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/22/23 2:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/22/23 3:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/22/23 4:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/22/23 5:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/22/23 6:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/22/23 7:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/22/23 8:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/22/23 9:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/22/23 10:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/22/23 11:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/22/23 12:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/22/23 13:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/22/23 14:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/22/23 15:00 | 0 | | | 0 | | | 18.4 | | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/22/23 16:00 | 3.2 | | | 0.7 | | | 15.5 | | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/22/23 17:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/22/23 18:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |

| | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 05/22/23 19:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/22/23 20:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/22/23 21:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/22/23 22:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/22/23 23:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/23/23 0:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/23/23 1:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/23/23 2:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/23/23 3:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/23/23 4:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/23/23 5:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/23/23 6:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/23/23 7:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |



| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_O2Dry_Pct_1H | | | CT2_CO_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT2_O2Dry_Pct_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 05/23/23 8:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/23/23 9:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/23/23 10:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/23/23 11:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/23/23 12:00 | 0 | X | | 0 | X | | 0 | X | 0 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/23/23 13:00 | 0 | X | | 0 | X | | 0 | X | 0 | 0 | X | | 0 | X | | 0 | X |

| | | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 1 | | | | | | | | | | | | | | |
| 05/23/23 14:00 | 0.6 | | 1.5 | | 14.5 | | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 05/23/23 15:00 | 0.6 | | 1.5 | | 14.5 | | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 05/23/23 16:00 | 0.6 | | 1.5 | | 14.4 | | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 05/23/23 17:00 | 0.6 | | 1.5 | | 14.3 | | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 05/23/23 18:00 | 0 | | 0 | | 15.4 | | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 05/23/23 19:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 05/23/23 20:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 05/23/23 21:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 05/23/23 22:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 05/23/23 23:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 05/24/23 0:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 05/24/23 1:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 05/24/23 2:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 05/24/23 3:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 05/24/23 4:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 05/24/23 5:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 05/24/23 6:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 05/24/23 7:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 05/24/23 8:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 05/24/23 9:00 | 0 | | 0 | | 17.9 | | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 05/24/23 10:00 | 0.6 | | 1.6 | | 14.2 | | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 05/24/23 11:00 | 0.5 | | 1.5 | | 14.3 | | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 05/24/23 12:00 | 0.5 | | 1.5 | | 14.3 | | 1 | 0 | X | 0 | X | 0 | X | |

| | | | | | | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 1 | | | | | | | | | | | | | | | | | | |
| 05/24/23 13:00 | 0.5 | | | 1.5 | | | 14.3 | | | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | | |
| 05/24/23 14:00 | 0 | | | 0 | | | 15.9 | | | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | | |
| 05/24/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | | |
| 05/24/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | | |
| 05/24/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | | |



| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_O2Dry_Pct_1H | | | CT2_CO_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT2_O2Dry_Pct_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 05/24/23 18:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/24/23 19:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/24/23 20:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/24/23 21:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/24/23 22:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/24/23 23:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/25/23 0:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/25/23 1:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/25/23 2:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/25/23 3:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/25/23 4:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/25/23 5:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/25/23 6:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |

| | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 05/25/23 7:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/25/23 8:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/25/23 9:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/25/23 10:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/25/23 11:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/25/23 12:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/25/23 13:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/25/23 14:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/25/23 15:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/25/23 16:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/25/23 17:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/25/23 18:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/25/23 19:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/25/23 20:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/25/23 21:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/25/23 22:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/25/23 23:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/26/23 0:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/26/23 1:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/26/23 2:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/26/23 3:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_O2Dry_Pct_1H | | | CT2_CO_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT2_O2Dry_Pct_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 05/26/23 4:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/26/23 5:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/26/23 6:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/26/23 7:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/26/23 8:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/26/23 9:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/26/23 10:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/26/23 11:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/26/23 12:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/26/23 13:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/26/23 14:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/26/23 15:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/26/23 16:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/26/23 17:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/26/23 18:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/26/23 19:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/26/23 20:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/26/23 21:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/26/23 22:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/26/23 23:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/27/23 0:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |

| | | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 05/27/23 1:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 05/27/23 2:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 05/27/23 3:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 05/27/23 4:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 05/27/23 5:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 05/27/23 6:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 05/27/23 7:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 05/27/23 8:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 05/27/23 9:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 05/27/23 10:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 05/27/23 11:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 05/27/23 12:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 05/27/23 13:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |



| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_O2Dry_Pct_1H | | | CT2_CO_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT2_O2Dry_Pct_1H | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** |
| 05/27/23 14:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | 1 |
| 05/27/23 15:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | 1 |
| 05/27/23 16:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | 1 |
| 05/27/23 17:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | 1 |
| 05/27/23 18:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | 1 |
| 05/27/23 19:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | 1 |

| | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 1 | | | | | | | | | | | | | |
| 05/27/23 20:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/27/23 21:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/27/23 22:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/27/23 23:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/28/23 0:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/28/23 1:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/28/23 2:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/28/23 3:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/28/23 4:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/28/23 5:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/28/23 6:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/28/23 7:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/28/23 8:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/28/23 9:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/28/23 10:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/28/23 11:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/28/23 12:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/28/23 13:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/28/23 14:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/28/23 15:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/28/23 16:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/28/23 17:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/28/23 18:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |

| | | | | | | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 1 | | | | | | | | | | | | | | | | | | |
| 05/28/23 19:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 05/28/23 20:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 05/28/23 21:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 05/28/23 22:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 05/28/23 23:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |



| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_O2Dry_Pct_1H | | | CT2_CO_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT2_O2Dry_Pct_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 05/29/23 0:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/29/23 1:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/29/23 2:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/29/23 3:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/29/23 4:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/29/23 5:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/29/23 6:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/29/23 7:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/29/23 8:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/29/23 9:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/29/23 10:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/29/23 11:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 05/29/23 12:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |

| | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 05/29/23 13:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/29/23 14:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/29/23 15:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/29/23 16:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/29/23 17:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/29/23 18:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/29/23 19:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/29/23 20:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/29/23 21:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/29/23 22:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/29/23 23:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/30/23 0:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/30/23 1:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/30/23 2:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/30/23 3:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/30/23 4:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/30/23 5:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/30/23 6:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/30/23 7:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/30/23 8:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 05/30/23 9:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_O2Dry_Pct_1H | | | CT2_CO_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT2_O2Dry_Pct_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 05/30/23 10:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/30/23 11:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/30/23 12:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/30/23 13:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/30/23 14:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/30/23 15:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/30/23 16:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/30/23 17:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/30/23 18:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/30/23 19:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/30/23 20:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/30/23 21:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/30/23 22:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/30/23 23:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/31/23 0:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/31/23 1:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/31/23 2:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/31/23 3:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/31/23 4:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/31/23 5:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 05/31/23 6:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |

| | | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 05/31/23 7:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 05/31/23 8:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 05/31/23 9:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 05/31/23 10:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 05/31/23 11:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 05/31/23 12:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 05/31/23 13:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 05/31/23 14:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 05/31/23 15:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 05/31/23 16:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 05/31/23 17:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 05/31/23 18:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 05/31/23 19:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |



| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_O2Dry_Pct_1H | | | CT2_CO_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT2_O2Dry_Pct_1H | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** |
| 05/31/23 20:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | 1 |
| 05/31/23 21:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | 1 |
| 05/31/23 22:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | 1 |
| 05/31/23 23:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | 1 |
| 06/01/23 0:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | 1 |
| 06/01/23 1:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | 1 |

| | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 1 | | | | | | | | | | | | | |
| 06/01/23 2:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/01/23 3:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/01/23 4:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/01/23 5:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/01/23 6:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/01/23 7:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/01/23 8:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/01/23 9:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/01/23 10:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/01/23 11:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/01/23 12:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/01/23 13:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/01/23 14:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/01/23 15:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/01/23 16:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/01/23 17:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/01/23 18:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/01/23 19:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/01/23 20:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/01/23 21:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/01/23 22:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/01/23 23:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/02/23 0:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |

| | | | | | | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 1 | | | | | | | | | | | | | | | | | | |
| 06/02/23 1:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 06/02/23 2:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 06/02/23 3:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 06/02/23 4:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 06/02/23 5:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |



| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_O2Dry_Pct_1H | | | CT2_CO_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT2_O2Dry_Pct_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 06/02/23 6:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/02/23 7:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/02/23 8:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/02/23 9:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/02/23 10:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/02/23 11:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/02/23 12:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/02/23 13:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/02/23 14:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/02/23 15:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/02/23 16:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/02/23 17:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/02/23 18:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |

| | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 06/02/23 19:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/02/23 20:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/02/23 21:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/02/23 22:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/02/23 23:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/03/23 0:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/03/23 1:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/03/23 2:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/03/23 3:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/03/23 4:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/03/23 5:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/03/23 6:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/03/23 7:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/03/23 8:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/03/23 9:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/03/23 10:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/03/23 11:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/03/23 12:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/03/23 13:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/03/23 14:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/03/23 15:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_O2Dry_Pct_1H | | | CT2_CO_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT2_O2Dry_Pct_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 06/03/23 16:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/03/23 17:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/03/23 18:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/03/23 19:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/03/23 20:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/03/23 21:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/03/23 22:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/03/23 23:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/04/23 0:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/04/23 1:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/04/23 2:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/04/23 3:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/04/23 4:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/04/23 5:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/04/23 6:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/04/23 7:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/04/23 8:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/04/23 9:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/04/23 10:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/04/23 11:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/04/23 12:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |

| | | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 06/04/23 13:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 06/04/23 14:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 06/04/23 15:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 06/04/23 16:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 06/04/23 17:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 06/04/23 18:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 06/04/23 19:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 06/04/23 20:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 06/04/23 21:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 06/04/23 22:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 06/04/23 23:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 06/05/23 0:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 06/05/23 1:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |



| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_O2Dry_Pct_1H | | | CT2_CO_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT2_O2Dry_Pct_1H | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** |
| 06/05/23 2:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | 1 |
| 06/05/23 3:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | 1 |
| 06/05/23 4:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | 1 |
| 06/05/23 5:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | 1 |
| 06/05/23 6:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | 1 |
| 06/05/23 7:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | 1 |

| | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 1 | | | | | | | | | | | | | |
| 06/05/23 8:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/05/23 9:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/05/23 10:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/05/23 11:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/05/23 12:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/05/23 13:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/05/23 14:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/05/23 15:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/05/23 16:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/05/23 17:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/05/23 18:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/05/23 19:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/05/23 20:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/05/23 21:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/05/23 22:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/05/23 23:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/06/23 0:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/06/23 1:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/06/23 2:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/06/23 3:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/06/23 4:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/06/23 5:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/06/23 6:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |

| | | | | | | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 1 | | | | | | | | | | | | | | | | | | |
| 06/06/23 7:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 06/06/23 8:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 06/06/23 9:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 06/06/23 10:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 06/06/23 11:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |



| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_O2Dry_Pct_1H | | | CT2_CO_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT2_O2Dry_Pct_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 06/06/23 12:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/06/23 13:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/06/23 14:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/06/23 15:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/06/23 16:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/06/23 17:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/06/23 18:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/06/23 19:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/06/23 20:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/06/23 21:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/06/23 22:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/06/23 23:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/07/23 0:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |

| | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 06/07/23 1:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/07/23 2:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/07/23 3:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/07/23 4:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/07/23 5:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/07/23 6:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/07/23 7:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/07/23 8:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/07/23 9:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/07/23 10:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/07/23 11:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/07/23 12:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/07/23 13:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/07/23 14:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/07/23 15:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/07/23 16:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/07/23 17:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/07/23 18:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/07/23 19:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/07/23 20:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/07/23 21:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_O2Dry_Pct_1H | | | CT2_CO_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT2_O2Dry_Pct_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 06/07/23 22:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/07/23 23:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/08/23 0:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/08/23 1:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/08/23 2:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/08/23 3:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/08/23 4:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/08/23 5:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/08/23 6:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/08/23 7:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/08/23 8:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/08/23 9:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/08/23 10:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/08/23 11:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/08/23 12:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/08/23 13:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/08/23 14:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/08/23 15:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/08/23 16:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/08/23 17:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/08/23 18:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |

| | | | | | | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 06/08/23 19:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 06/08/23 20:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 06/08/23 21:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 06/08/23 22:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 06/08/23 23:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 06/09/23 0:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 06/09/23 1:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 06/09/23 2:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 06/09/23 3:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 06/09/23 4:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 06/09/23 5:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 06/09/23 6:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 06/09/23 7:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |



| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_O2Dry_Pct_1H | | | CT2_CO_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT2_O2Dry_Pct_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 06/09/23 8:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/09/23 9:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/09/23 10:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/09/23 11:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/09/23 12:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/09/23 13:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |

| | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 1 | | | | | | | | | | | | | |
| 06/09/23 14:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/09/23 15:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/09/23 16:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/09/23 17:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/09/23 18:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/09/23 19:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/09/23 20:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/09/23 21:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/09/23 22:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/09/23 23:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/10/23 0:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/10/23 1:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/10/23 2:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/10/23 3:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/10/23 4:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/10/23 5:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/10/23 6:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/10/23 7:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/10/23 8:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/10/23 9:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/10/23 10:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/10/23 11:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/10/23 12:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |

| | | | | | | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 1 | | | | | | | | | | | | | | | | | | |
| 06/10/23 13:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 06/10/23 14:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 06/10/23 15:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 06/10/23 16:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 06/10/23 17:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |



| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_O2Dry_Pct_1H | | | CT2_CO_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT2_O2Dry_Pct_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 06/10/23 18:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/10/23 19:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/10/23 20:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/10/23 21:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/10/23 22:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/10/23 23:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/11/23 0:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/11/23 1:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/11/23 2:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/11/23 3:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/11/23 4:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/11/23 5:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/11/23 6:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |

| | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 06/11/23 7:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/11/23 8:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/11/23 9:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/11/23 10:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/11/23 11:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/11/23 12:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/11/23 13:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/11/23 14:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/11/23 15:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/11/23 16:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/11/23 17:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/11/23 18:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/11/23 19:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/11/23 20:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/11/23 21:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/11/23 22:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/11/23 23:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/12/23 0:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/12/23 1:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/12/23 2:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/12/23 3:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_O2Dry_Pct_1H | | | CT2_CO_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT2_O2Dry_Pct_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 06/12/23 4:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/12/23 5:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/12/23 6:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/12/23 7:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/12/23 8:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/12/23 9:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/12/23 10:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/12/23 11:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/12/23 12:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/12/23 13:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/12/23 14:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/12/23 15:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/12/23 16:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/12/23 17:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/12/23 18:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/12/23 19:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/12/23 20:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/12/23 21:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/12/23 22:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/12/23 23:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/13/23 0:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |

| | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 06/13/23 1:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 06/13/23 2:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 06/13/23 3:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 06/13/23 4:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 06/13/23 5:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 06/13/23 6:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 06/13/23 7:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 06/13/23 8:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 06/13/23 9:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 06/13/23 10:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 06/13/23 11:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 06/13/23 12:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 06/13/23 13:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |



| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_O2Dry_Pct_1H | | | CT2_CO_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT2_O2Dry_Pct_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 06/13/23 14:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/13/23 15:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/13/23 16:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/13/23 17:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/13/23 18:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/13/23 19:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |

| | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 1 | | | | | | | | | | | | | |
| 06/13/23 20:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/13/23 21:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/13/23 22:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/13/23 23:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/14/23 0:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/14/23 1:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/14/23 2:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/14/23 3:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/14/23 4:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/14/23 5:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/14/23 6:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/14/23 7:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/14/23 8:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/14/23 9:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/14/23 10:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/14/23 11:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/14/23 12:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/14/23 13:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/14/23 14:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/14/23 15:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/14/23 16:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/14/23 17:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/14/23 18:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |

| | | | | | | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 1 | | | | | | | | | | | | | | | | | | |
| 06/14/23 19:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 06/14/23 20:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 06/14/23 21:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 06/14/23 22:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 06/14/23 23:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |



| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_O2Dry_Pct_1H | | | CT2_CO_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT2_O2Dry_Pct_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 06/15/23 0:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/15/23 1:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/15/23 2:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/15/23 3:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/15/23 4:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/15/23 5:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/15/23 6:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/15/23 7:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/15/23 8:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/15/23 9:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/15/23 10:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/15/23 11:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/15/23 12:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |

| | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 06/15/23 13:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/15/23 14:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/15/23 15:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/15/23 16:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/15/23 17:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/15/23 18:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/15/23 19:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/15/23 20:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/15/23 21:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/15/23 22:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/15/23 23:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/16/23 0:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/16/23 1:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/16/23 2:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/16/23 3:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/16/23 4:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/16/23 5:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/16/23 6:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/16/23 7:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/16/23 8:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/16/23 9:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_O2Dry_Pct_1H | | | CT2_CO_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT2_O2Dry_Pct_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 06/16/23 10:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/16/23 11:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/16/23 12:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/16/23 13:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/16/23 14:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/16/23 15:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/16/23 16:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/16/23 17:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/16/23 18:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/16/23 19:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/16/23 20:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/16/23 21:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/16/23 22:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/16/23 23:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/17/23 0:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/17/23 1:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/17/23 2:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/17/23 3:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/17/23 4:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/17/23 5:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/17/23 6:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |

| | | | | | | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 06/17/23 7:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 06/17/23 8:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 06/17/23 9:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 06/17/23 10:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 06/17/23 11:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 06/17/23 12:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 06/17/23 13:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 06/17/23 14:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 06/17/23 15:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 06/17/23 16:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 06/17/23 17:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 06/17/23 18:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 06/17/23 19:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |



| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_O2Dry_Pct_1H | | | CT2_CO_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT2_O2Dry_Pct_1H | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** |
| 06/17/23 20:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 06/17/23 21:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 06/17/23 22:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 06/17/23 23:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 06/18/23 0:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 06/18/23 1:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |

| | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 1 | | | | | | | | | | | | | |
| 06/18/23 2:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/18/23 3:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/18/23 4:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/18/23 5:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/18/23 6:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/18/23 7:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/18/23 8:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/18/23 9:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/18/23 10:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/18/23 11:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/18/23 12:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/18/23 13:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/18/23 14:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/18/23 15:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/18/23 16:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/18/23 17:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/18/23 18:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/18/23 19:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/18/23 20:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/18/23 21:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/18/23 22:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/18/23 23:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/19/23 0:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |

| | | | | | | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 1 | | | | | | | | | | | | | | | | | | |
| 06/19/23 1:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 06/19/23 2:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 06/19/23 3:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 06/19/23 4:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 06/19/23 5:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |



| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_O2Dry_Pct_1H | | | CT2_CO_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT2_O2Dry_Pct_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 06/19/23 6:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/19/23 7:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/19/23 8:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/19/23 9:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/19/23 10:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/19/23 11:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/19/23 12:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/19/23 13:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/19/23 14:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/19/23 15:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/19/23 16:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/19/23 17:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/19/23 18:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |

| | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 06/19/23 19:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/19/23 20:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/19/23 21:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/19/23 22:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/19/23 23:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/20/23 0:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/20/23 1:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/20/23 2:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/20/23 3:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/20/23 4:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/20/23 5:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/20/23 6:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/20/23 7:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/20/23 8:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/20/23 9:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/20/23 10:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/20/23 11:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/20/23 12:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/20/23 13:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/20/23 14:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/20/23 15:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_O2Dry_Pct_1H | | | CT2_CO_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT2_O2Dry_Pct_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 06/20/23 16:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/20/23 17:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/20/23 18:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/20/23 19:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/20/23 20:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/20/23 21:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/20/23 22:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/20/23 23:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/21/23 0:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/21/23 1:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/21/23 2:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/21/23 3:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/21/23 4:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/21/23 5:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/21/23 6:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/21/23 7:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/21/23 8:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/21/23 9:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/21/23 10:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/21/23 11:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/21/23 12:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |

| | | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 06/21/23 13:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 06/21/23 14:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 06/21/23 15:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 06/21/23 16:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 06/21/23 17:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 06/21/23 18:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 06/21/23 19:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 06/21/23 20:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 06/21/23 21:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 06/21/23 22:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 06/21/23 23:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 06/22/23 0:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 06/22/23 1:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |



| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_O2Dry_Pct_1H | | | CT2_CO_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT2_O2Dry_Pct_1H | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** |
| 06/22/23 2:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | 1 |
| 06/22/23 3:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | 1 |
| 06/22/23 4:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | 1 |
| 06/22/23 5:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | 1 |
| 06/22/23 6:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | 1 |
| 06/22/23 7:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | 1 |

| | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 1 | | | | | | | | | | | | | |
| 06/22/23 8:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/22/23 9:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/22/23 10:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/22/23 11:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/22/23 12:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/22/23 13:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/22/23 14:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/22/23 15:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/22/23 16:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/22/23 17:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/22/23 18:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/22/23 19:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/22/23 20:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/22/23 21:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/22/23 22:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/22/23 23:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/23/23 0:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/23/23 1:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/23/23 2:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/23/23 3:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/23/23 4:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/23/23 5:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/23/23 6:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |

| | | | | | | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 1 | | | | | | | | | | | | | | | | | | |
| 06/23/23 7:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 06/23/23 8:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 06/23/23 9:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 06/23/23 10:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 06/23/23 11:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |



| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_O2Dry_Pct_1H | | | CT2_CO_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT2_O2Dry_Pct_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 06/23/23 12:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/23/23 13:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/23/23 14:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/23/23 15:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/23/23 16:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/23/23 17:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/23/23 18:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/23/23 19:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/23/23 20:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/23/23 21:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/23/23 22:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/23/23 23:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/24/23 0:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |

| | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 06/24/23 1:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/24/23 2:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/24/23 3:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/24/23 4:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/24/23 5:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/24/23 6:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/24/23 7:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/24/23 8:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/24/23 9:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/24/23 10:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/24/23 11:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/24/23 12:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/24/23 13:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/24/23 14:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/24/23 15:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/24/23 16:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/24/23 17:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/24/23 18:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/24/23 19:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/24/23 20:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/24/23 21:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_O2Dry_Pct_1H | | | CT2_CO_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT2_O2Dry_Pct_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 06/24/23 22:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/24/23 23:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/25/23 0:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/25/23 1:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/25/23 2:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/25/23 3:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/25/23 4:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/25/23 5:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/25/23 6:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/25/23 7:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/25/23 8:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/25/23 9:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/25/23 10:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/25/23 11:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/25/23 12:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/25/23 13:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/25/23 14:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/25/23 15:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/25/23 16:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/25/23 17:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/25/23 18:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |

| | | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 06/25/23 19:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 06/25/23 20:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 06/25/23 21:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 06/25/23 22:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 06/25/23 23:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 06/26/23 0:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 06/26/23 1:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 06/26/23 2:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 06/26/23 3:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 06/26/23 4:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 06/26/23 5:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 06/26/23 6:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |
| 06/26/23 7:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X | 1 |



| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_O2Dry_Pct_1H | | | CT2_CO_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT2_O2Dry_Pct_1H | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** |
| 06/26/23 8:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | 1 |
| 06/26/23 9:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | 1 |
| 06/26/23 10:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | 1 |
| 06/26/23 11:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | 1 |
| 06/26/23 12:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | 1 |
| 06/26/23 13:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | 1 |

| | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 1 | | | | | | | | | | | | | |
| 06/26/23 14:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/26/23 15:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/26/23 16:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/26/23 17:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/26/23 18:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/26/23 19:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/26/23 20:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/26/23 21:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/26/23 22:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/26/23 23:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/27/23 0:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/27/23 1:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/27/23 2:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/27/23 3:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/27/23 4:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/27/23 5:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/27/23 6:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/27/23 7:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/27/23 8:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/27/23 9:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/27/23 10:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/27/23 11:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/27/23 12:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |

| | | | | | | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 1 | | | | | | | | | | | | | | | | | | |
| 06/27/23 13:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 06/27/23 14:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 06/27/23 15:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 06/27/23 16:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |
| 06/27/23 17:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X | |
| 1 | | | | | | | | | | | | | | | | | | |



| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_O2Dry_Pct_1H | | | CT2_CO_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT2_O2Dry_Pct_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 06/27/23 18:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/27/23 19:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/27/23 20:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/27/23 21:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/27/23 22:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/27/23 23:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/28/23 0:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/28/23 1:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/28/23 2:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/28/23 3:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/28/23 4:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/28/23 5:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/28/23 6:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |

| | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 06/28/23 7:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/28/23 8:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/28/23 9:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/28/23 10:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/28/23 11:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/28/23 12:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/28/23 13:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/28/23 14:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/28/23 15:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/28/23 16:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/28/23 17:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/28/23 18:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/28/23 19:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/28/23 20:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/28/23 21:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/28/23 22:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/28/23 23:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/29/23 0:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/29/23 1:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/29/23 2:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |
| 06/29/23 3:00 | 0 | X | 0 | X | 0 | X | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | | |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_O2Dry_Pct_1H | | | CT2_CO_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT2_O2Dry_Pct_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 06/29/23 4:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/29/23 5:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/29/23 6:00 | 0 | X | | 0 | X | | 0 | X | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/29/23 7:00 | 0 | | | 0 | | | 16 | | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/29/23 8:00 | 0.6 | | | 1.6 | | | 14.4 | | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/29/23 9:00 | 0.6 | | | 1.4 | | | 14.4 | | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/29/23 10:00 | 1 | | | 1.6 | | | 13.9 | | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/29/23 11:00 | 0.8 | | | 1.5 | | | 14.2 | | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/29/23 12:00 | 0.6 | | | 1.5 | | | 14.3 | | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/29/23 13:00 | 0.6 | | | 1.5 | | | 14.3 | | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/29/23 14:00 | 0.6 | | | 1.5 | | | 14.3 | | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/29/23 15:00 | 0.6 | | | 1.5 | | | 14.3 | | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/29/23 16:00 | 0.8 | | | 1.6 | | | 14.1 | | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/29/23 17:00 | 0.5 | | | 1.5 | | | 13.2 | | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/29/23 18:00 | 0.4 | | | 1.5 | | | 13 | | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/29/23 19:00 | 0.3 | | | 1.5 | | | 12.8 | | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/29/23 20:00 | 0.5 | | | 1.5 | | | 13.2 | | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/29/23 21:00 | 0.5 | | | 1.5 | | | 13.3 | | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/29/23 22:00 | 0.6 | | | 1.5 | | | 13.3 | | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/29/23 23:00 | 0.6 | | | 1.5 | | | 13.4 | | 1 | 0 | X | | 0 | X | | 0 | X |
| 06/30/23 0:00 | 0.7 | | | 1.5 | | | 13.5 | | 1 | 0 | X | | 0 | X | | 0 | X |

| | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 06/30/23 1:00 | 0.8 | | 1.5 | | 13.5 | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | |
| 06/30/23 2:00 | 0.8 | | 1.5 | | 13.6 | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | |
| 06/30/23 3:00 | 0.9 | | 1.5 | | 13.6 | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | |
| 06/30/23 4:00 | 0.9 | | 1.5 | | 13.6 | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | |
| 06/30/23 5:00 | 0.9 | | 1.5 | | 13.7 | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | |
| 06/30/23 6:00 | 1 | | 1.5 | | 13.7 | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | |
| 06/30/23 7:00 | 1 | | 1.5 | | 13.9 | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | |
| 06/30/23 8:00 | 0.7 | | 1.4 | | 14.3 | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | |
| 06/30/23 9:00 | 0.7 | | 1.5 | | 14.3 | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | |
| 06/30/23 10:00 | 0.6 | | 1.5 | | 14.3 | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | |
| 06/30/23 11:00 | 1 | | 1.5 | | 14.1 | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | |
| 06/30/23 12:00 | 0.6 | | 1.5 | | 13.4 | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | |
| 06/30/23 13:00 | 0.6 | | 1.5 | | 13.3 | 1 | 0 | X | 0 | X | 0 | X |
| 1 | | | | | | | | | | | | |



| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_O2Dry_Pct_1H | | | CT2_CO_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT2_O2Dry_Pct_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 06/30/23 14:00 | 0.6 | | | 1.5 | | | 13.2 | | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/30/23 15:00 | 0.5 | | | 1.5 | | | 13.3 | | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/30/23 16:00 | 0.5 | | | 1.5 | | | 13.2 | | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/30/23 17:00 | 0.5 | | | 1.5 | | | 13.2 | | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/30/23 18:00 | 0.4 | | | 1.5 | | | 13.1 | | 1 | 0 | X | | 0 | X | | 0 | X |
| 1 | | | | | | | | | | | | | | | | | |
| 06/30/23 19:00 | 0.2 | | | 1.5 | | | 12.2 | | 1 | 0 | X | | 0 | X | | 0 | X |

| | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|
| 1 | | | | | | | | | | | |
| 06/30/23 20:00 | 0.4 | 1.5 | 13 | 1 | 0 | X | 0 | X | 0 | X | |
| 1 | | | | | | | | | | | |
| 06/30/23 21:00 | 0.5 | 1.5 | 13.3 | 1 | 0 | X | 0 | X | 0 | X | |
| 1 | | | | | | | | | | | |
| 06/30/23 22:00 | 0.5 | 1.5 | 13.3 | 1 | 0 | X | 0 | X | 0 | X | |
| 1 | | | | | | | | | | | |
| 06/30/23 23:00 | 0.7 | 1.5 | 13.4 | 1 | 0 | X | 0 | X | 0 | X | |
| 1 | | | | | | | | | | | |

**ATTACHMENT 5**

# AQ-33

**AQ-33** The Project owner shall maintain records of Sox lb/hr, lb/day, and lb, quarter emissions. Sox emissions shall be based on fuel use records, natural gas sulfur content, and mass balance calculations.

**Verification:** The Project owner shall submit to the CPM all hourly, daily, and quarterly Sox emissions as part of the Quarterly Air Quality Report required by the Condition of Certification AQ-SC6

# Tons 12 Month Rolling Summary

## CT1 and CT2 Combined

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:12 **Location:** Roseville, CA

* = Excess Emission

| Date | Units CT1 & CT2 CO, Ton 1 Day(s) Sum | Rolling Sum | Units CT1 & CT2 NOx, Ton 1 Day(s) Sum | Rolling Sum | Units CT1 & CT2 PM10, Ton 1 Day(s) Sum | Rolling Sum | Units CT1 & CT2 SO2, Ton 1 Day(s) Sum | Rolling Sum | Units CT1 & CT2 VOC, Ton 1 Day(s) Sum | Rolling Sum |
|---|---|---|---|---|---|---|---|---|---|---|
| Apr 2023 | 0.0000 | 7.6802 | 0.0000 | 14.7491 | 0.0000 | 3.0357 | 0.0000 | 1.5194 | 0.0000 | 5.0594 |
| May 2023 | 0.2388 | 7.4747 | 0.0309 | 14.1876 | 0.0023 | 2.9186 | 0.0012 | 1.4610 | 0.0038 | 4.8643 |
| Jun 2023 | 0.0363 | 6.7942 | 0.0578 | 13.1511 | 0.0115 | 2.7118 | 0.0057 | 1.3575 | 0.0192 | 4.5191 |
| **Sum/Avg** | 6.7942 | | 13.1511 | | 2.7118 | | 1.3575 | | 4.5191 | |
| **Limit Value** | | | | | | | | | | |

# AQ33 DAILY SOX

| | CT1_SO2_Lb_1D | | | CT2_SO2_Lb_1D | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 04/01/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 04/02/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 04/03/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 04/04/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 04/05/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 04/06/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 04/07/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 04/08/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 04/09/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 04/10/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 04/11/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 04/12/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 04/13/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 04/14/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 04/15/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 04/16/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 04/17/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 04/18/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 04/19/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 04/20/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 04/21/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 04/22/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 04/23/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 04/24/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 04/25/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 04/26/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 04/27/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 04/28/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 04/29/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 04/30/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 05/01/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 05/02/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |

| | CT1_SO2_Lb_1D | | | CT2_SO2_Lb_1D | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 05/03/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 05/04/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 05/05/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 05/06/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 05/07/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 05/08/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 05/09/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 05/10/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 05/11/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 05/12/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 05/13/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 05/14/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 05/15/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 05/16/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 05/17/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 05/18/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 05/19/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 05/20/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 05/21/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 05/22/23 0:00 | 0.1 | | | 0 | | | | | | | | | | | | | |
| 05/23/23 0:00 | 1.2 | | | 0 | | | | | | | | | | | | | |
| 05/24/23 0:00 | 0.8 | | | 0 | | | | | | | | | | | | | |
| 05/25/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 05/26/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 05/27/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 05/28/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 05/29/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 05/30/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 05/31/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 06/01/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 06/02/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 06/03/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 06/04/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 06/05/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |

| | CT1_SO2_Lb_1D | | | CT2_SO2_Lb_1D | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 06/06/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 06/07/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 06/08/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 06/09/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 06/10/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 06/11/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 06/12/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 06/13/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 06/14/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 06/15/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 06/16/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 06/17/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 06/18/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 06/19/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 06/20/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 06/21/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 06/22/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 06/23/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 06/24/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 06/25/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 06/26/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 06/27/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 06/28/23 0:00 | 0 | | | 0 | | | | | | | | | | | | | |
| 06/29/23 0:00 | 4.3 | | | 0 | | | | | | | | | | | | | |
| 06/30/23 0:00 | 6.9 | | | 0 | | | | | | | | | | | | | |

# AQ33 HOURLY SOX

| | CT1_SO2_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | ALL_SO2_Lb_1H | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 04/01/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/01/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/01/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/01/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/01/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/01/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/01/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/01/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/01/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/01/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/01/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/01/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/01/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/01/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/01/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/01/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/01/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/01/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/01/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/01/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/01/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/01/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/01/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/01/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/02/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/02/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/02/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/02/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/02/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/02/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/02/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/02/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |

| | CT1_SO2_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | ALL_SO2_Lb_1H | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 04/02/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/02/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/02/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/02/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/02/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/02/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/02/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/02/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/02/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/02/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/02/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/02/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/02/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/02/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/02/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/02/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/03/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/03/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/03/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/03/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/03/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/03/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/03/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/03/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/03/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/03/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/03/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/03/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/03/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/03/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/03/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/03/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/03/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/03/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |

| | CT1_SO2_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | ALL_SO2_Lb_1H | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 04/03/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/03/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/03/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/03/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/03/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/03/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/04/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/04/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/04/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/04/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/04/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/04/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/04/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/04/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/04/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/04/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/04/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/04/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/04/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/04/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/04/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/04/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/04/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/04/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/04/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/04/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/04/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/04/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/04/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/04/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/05/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/05/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/05/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/05/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |

| | CT1_SO2_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | ALL_SO2_Lb_1H | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 04/05/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/05/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/05/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/05/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/05/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/05/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/05/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/05/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/05/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/05/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/05/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/05/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/05/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/05/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/05/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/05/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/05/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/05/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/05/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/05/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/06/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/06/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/06/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/06/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/06/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/06/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/06/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/06/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/06/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/06/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/06/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/06/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/06/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/06/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |

| | CT1_SO2_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | ALL_SO2_Lb_1H | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| Date/Tim | Value | SI | Mod | Value | SI | Mod | Value | SI | Mod | Value | SI | Mod | Value | SI | Mod | Value | SI |
| Mod | | | | | | | | | | | | | | | | | |
| 04/06/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/06/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/06/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/06/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/06/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/06/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/06/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/06/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/06/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/06/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/07/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/07/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/07/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/07/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/07/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/07/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/07/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/07/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/07/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/07/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/07/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/07/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/07/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/07/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/07/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/07/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/07/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/07/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/07/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/07/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/07/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/07/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/07/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/07/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |

| | CT1_SO2_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | ALL_SO2_Lb_1H | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 04/08/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/08/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/08/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/08/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/08/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/08/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/08/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/08/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/08/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/08/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/08/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/08/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/08/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/08/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/08/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/08/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/08/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/08/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/08/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/08/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/08/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/08/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/08/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/08/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/09/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/09/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/09/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/09/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/09/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/09/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/09/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/09/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/09/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/09/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |

| | CT1_SO2_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | ALL_SO2_Lb_1H | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| Date/Tim | Value | SI | Mod | Value | SI | Mod | Value | SI | Mod | Value | SI | Mod | Value | SI | Mod | Value | SI |
| Mod | | | | | | | | | | | | | | | | | |
| 04/09/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/09/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/09/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/09/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/09/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/09/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/09/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/09/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/09/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/09/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/09/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/09/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/09/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/09/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/10/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/10/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/10/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/10/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/10/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/10/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/10/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/10/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/10/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/10/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/10/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/10/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/10/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/10/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/10/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/10/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/10/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/10/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/10/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/10/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |

| | CT1_SO2_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | ALL_SO2_Lb_1H | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 04/10/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/10/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/10/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/10/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/11/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/11/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/11/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/11/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/11/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/11/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/11/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/11/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/11/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/11/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/11/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/11/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/11/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/11/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/11/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/11/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/11/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/11/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/11/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/11/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/11/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/11/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/11/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/11/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/12/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/12/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/12/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/12/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/12/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/12/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |

| | CT1_SO2_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | ALL_SO2_Lb_1H | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 04/12/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/12/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/12/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/12/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/12/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/12/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/12/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/12/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/12/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/12/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/12/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/12/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/12/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/12/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/12/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/12/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/12/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/12/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/13/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/13/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/13/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/13/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/13/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/13/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/13/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/13/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/13/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/13/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/13/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/13/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/13/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/13/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/13/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/13/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |

| | CT1_SO2_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | ALL_SO2_Lb_1H | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 04/13/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/13/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/13/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/13/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/13/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/13/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/13/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/13/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/14/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/14/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/14/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/14/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/14/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/14/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/14/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/14/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/14/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/14/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/14/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/14/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/14/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/14/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/14/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/14/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/14/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/14/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/14/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/14/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/14/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/14/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/14/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/14/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/15/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/15/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |

| | CT1_SO2_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | ALL_SO2_Lb_1H | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 04/15/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/15/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/15/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/15/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/15/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/15/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/15/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/15/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/15/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/15/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/15/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/15/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/15/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/15/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/15/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/15/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/15/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/15/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/15/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/15/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/15/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/15/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/16/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/16/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/16/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/16/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/16/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/16/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/16/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/16/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/16/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/16/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/16/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/16/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |

| | CT1_SO2_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | ALL_SO2_Lb_1H | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| Date/Tim | Value | SI | Mod | Value | SI | Mod | Value | SI | Mod | Value | SI | Mod | Value | SI | Mod | Value | SI |
| Mod | | | | | | | | | | | | | | | | | |
| 04/16/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/16/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/16/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/16/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/16/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/16/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/16/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/16/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/16/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/16/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/16/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/16/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/17/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/17/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/17/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/17/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/17/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/17/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/17/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/17/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/17/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/17/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/17/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/17/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/17/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/17/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/17/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/17/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/17/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/17/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/17/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/17/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/17/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/17/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |

| | CT1_SO2_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | ALL_SO2_Lb_1H | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 04/17/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/17/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/18/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/18/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/18/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/18/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/18/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/18/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/18/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/18/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/18/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/18/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/18/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/18/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/18/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/18/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/18/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/18/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/18/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/18/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/18/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/18/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/18/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/18/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/18/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/18/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/19/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/19/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/19/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/19/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/19/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/19/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/19/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/19/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |

| | CT1_SO2_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | ALL_SO2_Lb_1H | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 04/19/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/19/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/19/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/19/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/19/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/19/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/19/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/19/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/19/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/19/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/19/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/19/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/19/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/19/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/19/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/19/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/20/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/20/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/20/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/20/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/20/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/20/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/20/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/20/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/20/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/20/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/20/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/20/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/20/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/20/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/20/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/20/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/20/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/20/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |

| | CT1_SO2_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | ALL_SO2_Lb_1H | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 04/20/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/20/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/20/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/20/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/20/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/20/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/21/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/21/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/21/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/21/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/21/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/21/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/21/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/21/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/21/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/21/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/21/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/21/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/21/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/21/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/21/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/21/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/21/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/21/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/21/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/21/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/21/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/21/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/21/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/21/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/22/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/22/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/22/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/22/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |

| | CT1_SO2_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | ALL_SO2_Lb_1H | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 04/22/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/22/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/22/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/22/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/22/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/22/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/22/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/22/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/22/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/22/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/22/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/22/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/22/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/22/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/22/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/22/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/22/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/22/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/22/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/22/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/23/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/23/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/23/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/23/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/23/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/23/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/23/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/23/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/23/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/23/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/23/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/23/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/23/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/23/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |

| | CT1_SO2_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | ALL_SO2_Lb_1H | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 04/23/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/23/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/23/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/23/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/23/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/23/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/23/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/23/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/23/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/23/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/24/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/24/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/24/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/24/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/24/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/24/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/24/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/24/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/24/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/24/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/24/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/24/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/24/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/24/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/24/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/24/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/24/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/24/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/24/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/24/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/24/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/24/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/24/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/24/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |

| | CT1_SO2_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | ALL_SO2_Lb_1H | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 04/25/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/25/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/25/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/25/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/25/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/25/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/25/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/25/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/25/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/25/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/25/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/25/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/25/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/25/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/25/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/25/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/25/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/25/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/25/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/25/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/25/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/25/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/25/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/25/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/26/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/26/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/26/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/26/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/26/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/26/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/26/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/26/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/26/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/26/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |

| | CT1_SO2_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | ALL_SO2_Lb_1H | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 04/26/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/26/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/26/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/26/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/26/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/26/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/26/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/26/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/26/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/26/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/26/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/26/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/26/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/26/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/27/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/27/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/27/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/27/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/27/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/27/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/27/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/27/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/27/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/27/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/27/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/27/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/27/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/27/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/27/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/27/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/27/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/27/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/27/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/27/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |

| | CT1_SO2_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | ALL_SO2_Lb_1H | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 04/27/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/27/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/27/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/27/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/28/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/28/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/28/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/28/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/28/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/28/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/28/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/28/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/28/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/28/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/28/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/28/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/28/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/28/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/28/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/28/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/28/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/28/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/28/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/28/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/28/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/28/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/28/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/28/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/29/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/29/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/29/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/29/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/29/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/29/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |

| | CT1_SO2_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | ALL_SO2_Lb_1H | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 04/29/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/29/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/29/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/29/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/29/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/29/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/29/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/29/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/29/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/29/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/29/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/29/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/29/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/29/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/29/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/29/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/29/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/29/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/30/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/30/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/30/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/30/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/30/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/30/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/30/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/30/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/30/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/30/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/30/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/30/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/30/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/30/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/30/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/30/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |

| | CT1_SO2_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | ALL_SO2_Lb_1H | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 04/30/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/30/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/30/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/30/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/30/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/30/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/30/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 04/30/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/01/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/01/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/01/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/01/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/01/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/01/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/01/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/01/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/01/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/01/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/01/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/01/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/01/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/01/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/01/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/01/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/01/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/01/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/01/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/01/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/01/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/01/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/01/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/01/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/02/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/02/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |

| | CT1_SO2_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | ALL_SO2_Lb_1H | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 05/02/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/02/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/02/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/02/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/02/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/02/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/02/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/02/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/02/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/02/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/02/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/02/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/02/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/02/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/02/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/02/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/02/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/02/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/02/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/02/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/02/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/02/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/03/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/03/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/03/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/03/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/03/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/03/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/03/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/03/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/03/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/03/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/03/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/03/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |

| | CT1_SO2_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | ALL_SO2_Lb_1H | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| Date/Tim | Value | SI | Mod | Value | SI | Mod | Value | SI | Mod | Value | SI | Mod | Value | SI | Mod | Value | SI |
| Mod | | | | | | | | | | | | | | | | | |
| 05/03/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/03/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/03/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/03/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/03/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/03/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/03/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/03/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/03/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/03/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/03/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/03/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/04/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/04/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/04/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/04/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/04/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/04/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/04/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/04/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/04/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/04/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/04/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/04/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/04/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/04/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/04/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/04/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/04/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/04/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/04/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/04/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/04/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/04/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |

| | CT1_SO2_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | ALL_SO2_Lb_1H | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| Date/Tim | Value | SI | Mod | Value | SI | Mod | Value | SI | Mod | Value | SI | Mod | Value | SI | Mod | Value | SI |
| Mod | | | | | | | | | | | | | | | | | |
| 05/04/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/04/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/05/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/05/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/05/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/05/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/05/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/05/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/05/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/05/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/05/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/05/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/05/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/05/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/05/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/05/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/05/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/05/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/05/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/05/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/05/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/05/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/05/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/05/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/05/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/05/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/06/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/06/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/06/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/06/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/06/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/06/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/06/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/06/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |

| | CT1_SO2_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | ALL_SO2_Lb_1H | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 05/06/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/06/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/06/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/06/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/06/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/06/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/06/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/06/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/06/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/06/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/06/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/06/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/06/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/06/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/06/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/06/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/07/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/07/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/07/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/07/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/07/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/07/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/07/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/07/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/07/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/07/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/07/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/07/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/07/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/07/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/07/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/07/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/07/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/07/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |

| | CT1_SO2_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | ALL_SO2_Lb_1H | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| Date/Tim | Value | SI | Mod | Value | SI | Mod | Value | SI | Mod | Value | SI | Mod | Value | SI | Mod | Value | SI |
| Mod | | | | | | | | | | | | | | | | | |
| 05/07/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/07/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/07/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/07/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/07/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/07/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/08/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/08/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/08/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/08/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/08/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/08/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/08/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/08/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/08/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/08/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/08/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/08/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/08/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/08/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/08/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/08/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/08/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/08/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/08/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/08/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/08/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/08/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/08/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/08/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/09/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/09/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/09/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/09/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |

| | CT1_SO2_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | ALL_SO2_Lb_1H | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 05/09/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/09/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/09/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/09/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/09/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/09/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/09/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/09/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/09/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/09/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/09/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/09/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/09/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/09/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/09/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/09/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/09/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/09/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/09/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/09/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/10/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/10/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/10/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/10/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/10/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/10/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/10/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/10/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/10/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/10/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/10/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/10/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/10/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/10/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |

| | CT1_SO2_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | ALL_SO2_Lb_1H | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 05/10/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/10/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/10/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/10/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/10/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/10/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/10/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/10/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/10/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/10/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/11/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/11/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/11/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/11/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/11/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/11/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/11/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/11/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/11/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/11/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/11/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/11/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/11/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/11/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/11/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/11/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/11/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/11/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/11/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/11/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/11/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/11/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/11/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/11/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |

| | CT1_SO2_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | ALL_SO2_Lb_1H | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 05/12/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/12/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/12/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/12/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/12/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/12/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/12/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/12/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/12/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/12/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/12/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/12/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/12/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/12/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/12/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/12/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/12/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/12/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/12/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/12/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/12/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/12/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/12/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/12/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/13/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/13/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/13/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/13/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/13/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/13/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/13/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/13/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/13/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/13/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |

| | CT1_SO2_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | ALL_SO2_Lb_1H | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 05/13/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/13/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/13/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/13/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/13/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/13/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/13/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/13/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/13/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/13/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/13/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/13/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/13/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/13/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/14/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/14/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/14/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/14/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/14/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/14/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/14/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/14/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/14/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/14/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/14/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/14/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/14/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/14/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/14/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/14/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/14/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/14/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/14/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/14/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |

| | CT1_SO2_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | ALL_SO2_Lb_1H | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| Date/Tim | Value | SI | Mod | Value | SI | Mod | Value | SI | Mod | Value | SI | Mod | Value | SI | Mod | Value | SI |
| Mod | | | | | | | | | | | | | | | | | |
| 05/14/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/14/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/14/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/14/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/15/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/15/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/15/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/15/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/15/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/15/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/15/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/15/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/15/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/15/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/15/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/15/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/15/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/15/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/15/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/15/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/15/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/15/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/15/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/15/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/15/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/15/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/15/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/15/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/16/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/16/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/16/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/16/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/16/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/16/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |

| | CT1_SO2_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | ALL_SO2_Lb_1H | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 05/16/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/16/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/16/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/16/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/16/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/16/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/16/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/16/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/16/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/16/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/16/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/16/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/16/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/16/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/16/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/16/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/16/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/16/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/17/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/17/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/17/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/17/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/17/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/17/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/17/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/17/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/17/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/17/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/17/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/17/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/17/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/17/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/17/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/17/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |

| | CT1_SO2_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | ALL_SO2_Lb_1H | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 05/17/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/17/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/17/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/17/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/17/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/17/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/17/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/17/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/18/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/18/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/18/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/18/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/18/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/18/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/18/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/18/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/18/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/18/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/18/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/18/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/18/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/18/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/18/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/18/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/18/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/18/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/18/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/18/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/18/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/18/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/18/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/18/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/19/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/19/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |

| | CT1_SO2_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | ALL_SO2_Lb_1H | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 05/19/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/19/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/19/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/19/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/19/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/19/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/19/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/19/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/19/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/19/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/19/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/19/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/19/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/19/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/19/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/19/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/19/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/19/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/19/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/19/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/19/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/19/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/20/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/20/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/20/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/20/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/20/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/20/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/20/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/20/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/20/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/20/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/20/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/20/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |

| | CT1_SO2_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | ALL_SO2_Lb_1H | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 05/20/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/20/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/20/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/20/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/20/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/20/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/20/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/20/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/20/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/20/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/20/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/20/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/21/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/21/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/21/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/21/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/21/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/21/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/21/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/21/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/21/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/21/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/21/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/21/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/21/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/21/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/21/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/21/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/21/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/21/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/21/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/21/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/21/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/21/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |

| | CT1_SO2_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | ALL_SO2_Lb_1H | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 05/21/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/21/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/22/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/22/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/22/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/22/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/22/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/22/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/22/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/22/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/22/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/22/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/22/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/22/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/22/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/22/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/22/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/22/23 15:00 | 0.0771 | | | 0 | X | | 0.05 | | | | | | | | | | |
| 05/22/23 16:00 | 0.15606 | | | 0 | X | | 0.14 | | | | | | | | | | |
| 05/22/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/22/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/22/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/22/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/22/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/22/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/22/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/23/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/23/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/23/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/23/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/23/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/23/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/23/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/23/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |

| | CT1_SO2_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | ALL_SO2_Lb_1H | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| Date/Tim | Value | SI | Mod | Value | SI | Mod | Value | SI | Mod | Value | SI | Mod | Value | SI | Mod | Value | SI |
| Mod | | | | | | | | | | | | | | | | | |
| 05/23/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/23/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/23/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/23/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/23/23 12:00 | 0.09444 | | | 0 | X | | 0.03 | | | | | | | | | | |
| 05/23/23 13:00 | 0.18972 | | | 0 | X | | 0.19 | | | | | | | | | | |
| 05/23/23 14:00 | 0.26244 | | | 0 | X | | 0.26 | | | | | | | | | | |
| 05/23/23 15:00 | 0.26832 | | | 0 | X | | 0.27 | | | | | | | | | | |
| 05/23/23 16:00 | 0.24666 | | | 0 | X | | 0.25 | | | | | | | | | | |
| 05/23/23 17:00 | 0.21096 | | | 0 | X | | 0.21 | | | | | | | | | | |
| 05/23/23 18:00 | 0.1278 | | | 0 | X | | 0.02 | | | | | | | | | | |
| 05/23/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/23/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/23/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/23/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/23/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/24/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/24/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/24/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/24/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/24/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/24/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/24/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/24/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/24/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/24/23 9:00 | 0.0885 | | | 0 | X | | 0.02 | | | | | | | | | | |
| 05/24/23 10:00 | 0.21348 | | | 0 | X | | 0.21 | | | | | | | | | | |
| 05/24/23 11:00 | 0.22182 | | | 0 | X | | 0.22 | | | | | | | | | | |
| 05/24/23 12:00 | 0.2223 | | | 0 | X | | 0.22 | | | | | | | | | | |
| 05/24/23 13:00 | 0.22068 | | | 0 | X | | 0.22 | | | | | | | | | | |
| 05/24/23 14:00 | 0.10806 | | | 0 | X | | 0.01 | | | | | | | | | | |
| 05/24/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/24/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/24/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |

| | CT1_SO2_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | ALL_SO2_Lb_1H | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 05/24/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/24/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/24/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/24/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/24/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/24/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/25/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/25/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/25/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/25/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/25/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/25/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/25/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/25/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/25/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/25/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/25/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/25/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/25/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/25/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/25/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/25/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/25/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/25/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/25/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/25/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/25/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/25/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/25/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/25/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/26/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/26/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/26/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/26/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |

| | CT1_SO2_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | ALL_SO2_Lb_1H | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 05/26/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/26/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/26/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/26/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/26/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/26/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/26/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/26/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/26/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/26/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/26/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/26/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/26/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/26/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/26/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/26/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/26/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/26/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/26/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/26/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/27/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/27/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/27/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/27/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/27/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/27/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/27/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/27/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/27/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/27/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/27/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/27/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/27/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/27/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |

| | CT1_SO2_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | ALL_SO2_Lb_1H | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 05/27/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/27/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/27/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/27/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/27/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/27/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/27/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/27/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/27/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/27/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/28/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/28/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/28/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/28/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/28/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/28/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/28/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/28/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/28/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/28/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/28/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/28/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/28/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/28/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/28/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/28/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/28/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/28/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/28/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/28/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/28/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/28/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/28/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/28/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |

| | CT1_SO2_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | ALL_SO2_Lb_1H | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 05/29/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/29/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/29/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/29/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/29/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/29/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/29/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/29/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/29/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/29/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/29/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/29/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/29/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/29/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/29/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/29/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/29/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/29/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/29/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/29/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/29/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/29/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/29/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/29/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/30/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/30/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/30/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/30/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/30/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/30/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/30/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/30/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/30/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/30/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |

| | CT1_SO2_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | ALL_SO2_Lb_1H | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 05/30/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/30/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/30/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/30/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/30/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/30/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/30/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/30/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/30/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/30/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/30/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/30/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/30/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/30/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/31/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/31/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/31/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/31/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/31/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/31/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/31/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/31/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/31/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/31/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/31/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/31/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/31/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/31/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/31/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/31/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/31/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/31/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/31/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/31/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |

| | CT1_SO2_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | ALL_SO2_Lb_1H | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 05/31/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/31/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/31/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 05/31/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/01/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/01/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/01/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/01/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/01/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/01/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/01/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/01/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/01/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/01/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/01/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/01/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/01/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/01/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/01/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/01/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/01/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/01/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/01/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/01/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/01/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/01/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/01/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/01/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/02/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/02/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/02/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/02/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/02/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/02/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |

| | CT1_SO2_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | ALL_SO2_Lb_1H | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 06/02/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/02/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/02/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/02/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/02/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/02/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/02/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/02/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/02/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/02/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/02/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/02/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/02/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/02/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/02/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/02/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/02/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/02/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/03/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/03/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/03/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/03/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/03/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/03/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/03/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/03/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/03/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/03/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/03/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/03/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/03/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/03/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/03/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/03/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |

| | CT1_SO2_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | ALL_SO2_Lb_1H | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| Date/Tim | Value | SI | Mod | Value | SI | Mod | Value | SI | Mod | Value | SI | Mod | Value | SI | Mod | Value | SI |
| Mod | | | | | | | | | | | | | | | | | |
| 06/03/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/03/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/03/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/03/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/03/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/03/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/03/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/03/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/04/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/04/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/04/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/04/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/04/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/04/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/04/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/04/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/04/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/04/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/04/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/04/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/04/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/04/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/04/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/04/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/04/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/04/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/04/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/04/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/04/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/04/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/04/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/04/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/05/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/05/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |

| | CT1_SO2_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | ALL_SO2_Lb_1H | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 06/05/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/05/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/05/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/05/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/05/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/05/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/05/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/05/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/05/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/05/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/05/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/05/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/05/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/05/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/05/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/05/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/05/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/05/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/05/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/05/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/05/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/05/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/06/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/06/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/06/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/06/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/06/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/06/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/06/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/06/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/06/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/06/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/06/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/06/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |

| | CT1_SO2_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | ALL_SO2_Lb_1H | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 06/06/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/06/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/06/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/06/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/06/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/06/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/06/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/06/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/06/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/06/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/06/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/06/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/07/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/07/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/07/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/07/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/07/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/07/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/07/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/07/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/07/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/07/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/07/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/07/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/07/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/07/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/07/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/07/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/07/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/07/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/07/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/07/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/07/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/07/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |

| | CT1_SO2_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | ALL_SO2_Lb_1H | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| Date/Tim | Value | SI | Mod | Value | SI | Mod | Value | SI | Mod | Value | SI | Mod | Value | SI | Mod | Value | SI |
| Mod | | | | | | | | | | | | | | | | | |
| 06/07/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/07/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/08/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/08/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/08/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/08/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/08/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/08/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/08/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/08/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/08/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/08/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/08/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/08/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/08/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/08/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/08/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/08/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/08/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/08/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/08/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/08/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/08/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/08/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/08/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/08/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/09/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/09/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/09/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/09/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/09/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/09/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/09/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/09/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |

| | CT1_SO2_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | ALL_SO2_Lb_1H | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 06/09/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/09/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/09/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/09/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/09/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/09/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/09/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/09/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/09/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/09/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/09/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/09/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/09/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/09/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/09/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/09/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/10/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/10/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/10/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/10/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/10/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/10/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/10/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/10/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/10/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/10/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/10/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/10/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/10/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/10/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/10/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/10/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/10/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/10/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |

| | CT1_SO2_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | ALL_SO2_Lb_1H | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 06/10/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/10/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/10/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/10/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/10/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/10/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/11/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/11/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/11/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/11/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/11/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/11/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/11/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/11/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/11/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/11/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/11/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/11/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/11/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/11/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/11/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/11/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/11/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/11/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/11/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/11/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/11/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/11/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/11/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/11/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/12/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/12/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/12/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/12/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |

| | CT1_SO2_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | ALL_SO2_Lb_1H | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 06/12/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/12/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/12/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/12/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/12/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/12/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/12/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/12/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/12/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/12/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/12/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/12/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/12/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/12/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/12/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/12/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/12/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/12/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/12/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/12/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/13/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/13/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/13/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/13/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/13/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/13/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/13/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/13/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/13/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/13/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/13/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/13/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/13/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/13/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |

| | CT1_SO2_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | ALL_SO2_Lb_1H | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 06/13/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/13/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/13/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/13/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/13/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/13/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/13/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/13/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/13/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/13/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/14/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/14/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/14/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/14/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/14/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/14/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/14/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/14/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/14/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/14/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/14/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/14/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/14/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/14/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/14/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/14/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/14/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/14/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/14/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/14/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/14/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/14/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/14/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/14/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |

| | CT1_SO2_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | ALL_SO2_Lb_1H | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 06/15/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/15/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/15/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/15/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/15/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/15/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/15/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/15/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/15/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/15/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/15/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/15/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/15/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/15/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/15/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/15/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/15/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/15/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/15/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/15/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/15/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/15/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/15/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/15/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/16/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/16/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/16/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/16/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/16/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/16/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/16/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/16/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/16/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/16/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |

| | CT1_SO2_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | ALL_SO2_Lb_1H | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 06/16/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/16/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/16/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/16/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/16/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/16/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/16/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/16/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/16/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/16/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/16/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/16/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/16/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/16/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/17/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/17/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/17/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/17/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/17/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/17/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/17/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/17/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/17/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/17/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/17/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/17/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/17/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/17/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/17/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/17/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/17/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/17/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/17/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/17/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |

| | CT1_SO2_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | ALL_SO2_Lb_1H | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 06/17/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/17/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/17/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/17/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/18/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/18/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/18/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/18/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/18/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/18/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/18/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/18/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/18/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/18/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/18/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/18/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/18/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/18/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/18/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/18/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/18/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/18/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/18/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/18/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/18/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/18/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/18/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/18/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/19/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/19/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/19/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/19/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/19/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/19/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |

| | CT1_SO2_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | ALL_SO2_Lb_1H | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 06/19/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/19/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/19/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/19/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/19/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/19/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/19/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/19/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/19/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/19/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/19/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/19/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/19/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/19/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/19/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/19/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/19/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/19/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/20/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/20/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/20/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/20/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/20/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/20/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/20/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/20/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/20/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/20/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/20/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/20/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/20/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/20/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/20/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/20/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |

| | CT1_SO2_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | ALL_SO2_Lb_1H | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 06/20/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/20/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/20/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/20/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/20/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/20/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/20/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/20/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/21/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/21/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/21/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/21/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/21/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/21/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/21/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/21/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/21/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/21/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/21/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/21/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/21/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/21/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/21/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/21/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/21/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/21/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/21/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/21/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/21/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/21/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/21/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/21/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/22/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/22/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |

| | CT1_SO2_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | ALL_SO2_Lb_1H | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 06/22/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/22/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/22/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/22/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/22/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/22/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/22/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/22/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/22/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/22/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/22/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/22/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/22/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/22/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/22/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/22/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/22/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/22/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/22/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/22/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/22/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/22/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/23/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/23/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/23/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/23/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/23/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/23/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/23/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/23/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/23/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/23/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/23/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/23/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |

| | CT1_SO2_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | ALL_SO2_Lb_1H | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 06/23/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/23/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/23/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/23/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/23/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/23/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/23/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/23/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/23/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/23/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/23/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/23/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/24/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/24/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/24/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/24/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/24/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/24/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/24/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/24/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/24/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/24/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/24/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/24/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/24/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/24/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/24/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/24/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/24/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/24/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/24/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/24/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/24/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/24/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |

| | CT1_SO2_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | ALL_SO2_Lb_1H | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 06/24/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/24/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/25/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/25/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/25/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/25/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/25/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/25/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/25/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/25/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/25/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/25/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/25/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/25/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/25/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/25/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/25/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/25/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/25/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/25/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/25/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/25/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/25/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/25/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/25/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/25/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/26/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/26/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/26/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/26/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/26/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/26/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/26/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/26/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |

| | CT1_SO2_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | ALL_SO2_Lb_1H | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 06/26/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/26/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/26/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/26/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/26/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/26/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/26/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/26/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/26/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/26/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/26/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/26/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/26/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/26/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/26/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/26/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/27/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/27/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/27/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/27/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/27/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/27/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/27/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/27/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/27/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/27/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/27/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/27/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/27/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/27/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/27/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/27/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/27/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/27/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |

| | CT1_SO2_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | ALL_SO2_Lb_1H | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 06/27/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/27/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/27/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/27/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/27/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/27/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/28/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/28/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/28/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/28/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/28/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/28/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/28/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/28/23 7:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/28/23 8:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/28/23 9:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/28/23 10:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/28/23 11:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/28/23 12:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/28/23 13:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/28/23 14:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/28/23 15:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/28/23 16:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/28/23 17:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/28/23 18:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/28/23 19:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/28/23 20:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/28/23 21:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/28/23 22:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/28/23 23:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/29/23 0:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/29/23 1:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/29/23 2:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/29/23 3:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |

| | CT1_SO2_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | ALL_SO2_Lb_1H | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 06/29/23 4:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/29/23 5:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/29/23 6:00 | 0 | X | | 0 | X | | 0 | | | | | | | | | | |
| 06/29/23 7:00 | 0.15216 | | | 0 | X | | 0.09 | | | | | | | | | | |
| 06/29/23 8:00 | 0.26094 | | | 0 | X | | 0.26 | | | | | | | | | | |
| 06/29/23 9:00 | 0.25914 | | | 0 | X | | 0.26 | | | | | | | | | | |
| 06/29/23 10:00 | 0.2766 | | | 0 | X | | 0.28 | | | | | | | | | | |
| 06/29/23 11:00 | 0.22872 | | | 0 | X | | 0.23 | | | | | | | | | | |
| 06/29/23 12:00 | 0.21234 | | | 0 | X | | 0.21 | | | | | | | | | | |
| 06/29/23 13:00 | 0.21306 | | | 0 | X | | 0.21 | | | | | | | | | | |
| 06/29/23 14:00 | 0.21348 | | | 0 | X | | 0.21 | | | | | | | | | | |
| 06/29/23 15:00 | 0.21342 | | | 0 | X | | 0.21 | | | | | | | | | | |
| 06/29/23 16:00 | 0.24768 | | | 0 | X | | 0.25 | | | | | | | | | | |
| 06/29/23 17:00 | 0.31482 | | | 0 | X | | 0.31 | | | | | | | | | | |
| 06/29/23 18:00 | 0.32448 | | | 0 | X | | 0.32 | | | | | | | | | | |
| 06/29/23 19:00 | 0.32892 | | | 0 | X | | 0.33 | | | | | | | | | | |
| 06/29/23 20:00 | 0.31374 | | | 0 | X | | 0.31 | | | | | | | | | | |
| 06/29/23 21:00 | 0.31092 | | | 0 | X | | 0.31 | | | | | | | | | | |
| 06/29/23 22:00 | 0.30948 | | | 0 | X | | 0.31 | | | | | | | | | | |
| 06/29/23 23:00 | 0.30828 | | | 0 | X | | 0.31 | | | | | | | | | | |
| 06/30/23 0:00 | 0.30708 | | | 0 | X | | 0.31 | | | | | | | | | | |
| 06/30/23 1:00 | 0.3054 | | | 0 | X | | 0.31 | | | | | | | | | | |
| 06/30/23 2:00 | 0.30444 | | | 0 | X | | 0.3 | | | | | | | | | | |
| 06/30/23 3:00 | 0.30372 | | | 0 | X | | 0.3 | | | | | | | | | | |
| 06/30/23 4:00 | 0.3027 | | | 0 | X | | 0.3 | | | | | | | | | | |
| 06/30/23 5:00 | 0.30156 | | | 0 | X | | 0.3 | | | | | | | | | | |
| 06/30/23 6:00 | 0.30084 | | | 0 | X | | 0.3 | | | | | | | | | | |
| 06/30/23 7:00 | 0.28584 | | | 0 | X | | 0.29 | | | | | | | | | | |
| 06/30/23 8:00 | 0.21276 | | | 0 | X | | 0.21 | | | | | | | | | | |
| 06/30/23 9:00 | 0.21252 | | | 0 | X | | 0.21 | | | | | | | | | | |
| 06/30/23 10:00 | 0.21294 | | | 0 | X | | 0.21 | | | | | | | | | | |
| 06/30/23 11:00 | 0.24726 | | | 0 | X | | 0.25 | | | | | | | | | | |
| 06/30/23 12:00 | 0.30948 | | | 0 | X | | 0.31 | | | | | | | | | | |
| 06/30/23 13:00 | 0.31134 | | | 0 | X | | 0.31 | | | | | | | | | | |

| | CT1_SO2_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | ALL_SO2_Lb_1H | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 06/30/23 14:00 | 0.318 | | | 0 | X | | 0.32 | | | | | | | | | | |
| 06/30/23 15:00 | 0.31254 | | | 0 | X | | 0.31 | | | | | | | | | | |
| 06/30/23 16:00 | 0.312 | | | 0 | X | | 0.31 | | | | | | | | | | |
| 06/30/23 17:00 | 0.31134 | | | 0 | X | | 0.31 | | | | | | | | | | |
| 06/30/23 18:00 | 0.3192 | | | 0 | X | | 0.32 | | | | | | | | | | |
| 06/30/23 19:00 | 0.3543 | | | 0 | X | | 0.35 | | | | | | | | | | |
| 06/30/23 20:00 | 0.31908 | | | 0 | X | | 0.32 | | | | | | | | | | |
| 06/30/23 21:00 | 0.31152 | | | 0 | X | | 0.31 | | | | | | | | | | |
| 06/30/23 22:00 | 0.31086 | | | 0 | X | | 0.31 | | | | | | | | | | |
| 06/30/23 23:00 | 0.30516 | | | 0 | X | | 0.31 | | | | | | | | | | |

**ATTACHMENT 6**

# AQ-34

**AQ-34** the Project owner shall maintain the following records: occurrence, duration, and type of any startup, shutdown, or malfunction: performance testing, evaluations, calibrations, check, adjustments, any period during which a continuous monitoring system or monitoring device was inoperative, maintenance of any continuous emission monitor; emission measurements, total daily and rolling twelve month averages hours of operation, hourly quantity of fuel used and gross three hour average operating load.

**Verification;** The Project owner shall submit to the CPM all data identified in this condition as part of the Quarterly Air Quality Report required by the Condition of Certification AQ-SC6

# AQ34 3HR AVG LOAD

| | ALL_UnitOn_TF_1H | | | CT1_Load_Total_3Hr_MWe | | | CT2_Load_Total_3Hr_MWe | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 04/01/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/01/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/01/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/01/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/01/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/01/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/01/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/01/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/01/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/01/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/01/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/01/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/01/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/01/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/01/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/01/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/01/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/01/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/01/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/01/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/01/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/01/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/01/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/01/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/02/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/02/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/02/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/02/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/02/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/02/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/02/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/02/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |

| | ALL_UnitOn_TF_1H | | | CT1_Load_Total_3Hr_MWe | | | CT2_Load_Total_3Hr_MWe | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 04/02/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/02/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/02/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/02/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/02/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/02/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/02/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/02/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/02/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/02/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/02/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/02/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/02/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/02/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/02/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/02/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/03/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/03/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/03/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/03/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/03/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/03/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/03/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/03/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/03/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/03/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/03/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/03/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/03/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/03/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/03/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/03/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/03/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/03/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |

| | ALL_UnitOn_TF_1H | | | CT1_Load_Total_3Hr_MWe | | | CT2_Load_Total_3Hr_MWe | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 04/03/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/03/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/03/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/03/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/03/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/03/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/04/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/04/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/04/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/04/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/04/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/04/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/04/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/04/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/04/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/04/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/04/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/04/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/04/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/04/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/04/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/04/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/04/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/04/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/04/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/04/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/04/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/04/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/04/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/04/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/05/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/05/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/05/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/05/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |

| | ALL_UnitOn_TF_1H | | | CT1_Load_Total_3Hr_MWe | | | CT2_Load_Total_3Hr_MWe | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 04/05/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/05/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/05/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/05/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/05/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/05/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/05/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/05/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/05/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/05/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/05/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/05/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/05/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/05/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/05/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/05/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/05/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/05/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/05/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/05/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/06/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/06/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/06/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/06/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/06/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/06/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/06/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/06/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/06/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/06/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/06/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/06/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/06/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/06/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |

| | ALL_UnitOn_TF_1H | | | CT1_Load_Total_3Hr_MWe | | | CT2_Load_Total_3Hr_MWe | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 04/06/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/06/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/06/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/06/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/06/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/06/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/06/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/06/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/06/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/06/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/07/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/07/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/07/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/07/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/07/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/07/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/07/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/07/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/07/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/07/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/07/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/07/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/07/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/07/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/07/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/07/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/07/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/07/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/07/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/07/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/07/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/07/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/07/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/07/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |

| | ALL_UnitOn_TF_1H | | | CT1_Load_Total_3Hr_MWe | | | CT2_Load_Total_3Hr_MWe | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 04/08/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/08/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/08/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/08/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/08/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/08/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/08/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/08/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/08/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/08/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/08/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/08/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/08/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/08/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/08/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/08/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/08/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/08/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/08/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/08/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/08/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/08/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/08/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/08/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/09/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/09/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/09/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/09/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/09/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/09/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/09/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/09/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/09/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/09/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |

| | ALL_UnitOn_TF_1H | | | CT1_Load_Total_3Hr_MWe | | | CT2_Load_Total_3Hr_MWe | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 04/09/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/09/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/09/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/09/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/09/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/09/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/09/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/09/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/09/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/09/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/09/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/09/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/09/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/09/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/10/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/10/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/10/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/10/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/10/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/10/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/10/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/10/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/10/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/10/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/10/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/10/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/10/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/10/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/10/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/10/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/10/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/10/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/10/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/10/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |

| | ALL_UnitOn_TF_1H | | | CT1_Load_Total_3Hr_MWe | | | CT2_Load_Total_3Hr_MWe | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 04/10/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/10/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/10/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/10/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/11/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/11/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/11/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/11/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/11/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/11/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/11/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/11/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/11/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/11/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/11/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/11/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/11/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/11/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/11/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/11/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/11/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/11/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/11/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/11/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/11/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/11/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/11/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/11/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/12/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/12/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/12/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/12/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/12/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/12/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |

| | ALL_UnitOn_TF_1H | | | CT1_Load_Total_3Hr_MWe | | | CT2_Load_Total_3Hr_MWe | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 04/12/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/12/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/12/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/12/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/12/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/12/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/12/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/12/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/12/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/12/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/12/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/12/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/12/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/12/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/12/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/12/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/12/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/12/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/13/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/13/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/13/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/13/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/13/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/13/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/13/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/13/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/13/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/13/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/13/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/13/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/13/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/13/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/13/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/13/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |

| | ALL_UnitOn_TF_1H | | | CT1_Load_Total_3Hr_MWe | | | CT2_Load_Total_3Hr_MWe | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 04/13/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/13/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/13/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/13/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/13/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/13/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/13/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/13/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/14/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/14/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/14/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/14/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/14/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/14/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/14/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/14/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/14/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/14/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/14/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/14/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/14/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/14/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/14/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/14/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/14/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/14/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/14/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/14/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/14/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/14/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/14/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/14/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/15/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/15/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |

| | ALL_UnitOn_TF_1H | | | CT1_Load_Total_3Hr_MWe | | | CT2_Load_Total_3Hr_MWe | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 04/15/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/15/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/15/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/15/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/15/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/15/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/15/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/15/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/15/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/15/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/15/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/15/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/15/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/15/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/15/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/15/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/15/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/15/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/15/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/15/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/15/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/15/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/16/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/16/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/16/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/16/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/16/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/16/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/16/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/16/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/16/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/16/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/16/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/16/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |

| | ALL_UnitOn_TF_1H | | | CT1_Load_Total_3Hr_MWe | | | CT2_Load_Total_3Hr_MWe | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 04/16/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/16/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/16/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/16/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/16/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/16/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/16/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/16/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/16/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/16/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/16/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/16/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/17/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/17/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/17/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/17/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/17/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/17/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/17/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/17/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/17/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/17/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/17/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/17/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/17/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/17/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/17/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/17/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/17/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/17/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/17/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/17/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/17/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/17/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |

| | ALL_UnitOn_TF_1H | | | CT1_Load_Total_3Hr_MWe | | | CT2_Load_Total_3Hr_MWe | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 04/17/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/17/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/18/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/18/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/18/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/18/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/18/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/18/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/18/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/18/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/18/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/18/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/18/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/18/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/18/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/18/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/18/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/18/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/18/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/18/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/18/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/18/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/18/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/18/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/18/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/18/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/19/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/19/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/19/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/19/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/19/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/19/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/19/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/19/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |

| | ALL_UnitOn_TF_1H | | | CT1_Load_Total_3Hr_MWe | | | CT2_Load_Total_3Hr_MWe | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 04/19/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/19/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/19/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/19/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/19/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/19/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/19/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/19/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/19/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/19/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/19/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/19/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/19/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/19/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/19/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/19/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/20/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/20/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/20/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/20/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/20/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/20/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/20/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/20/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/20/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/20/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/20/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/20/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/20/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/20/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/20/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/20/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/20/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/20/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |

| | ALL_UnitOn_TF_1H | | | CT1_Load_Total_3Hr_MWe | | | CT2_Load_Total_3Hr_MWe | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 04/20/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/20/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/20/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/20/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/20/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/20/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/21/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/21/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/21/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/21/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/21/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/21/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/21/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/21/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/21/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/21/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/21/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/21/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/21/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/21/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/21/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/21/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/21/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/21/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/21/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/21/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/21/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/21/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/21/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/21/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/22/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/22/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/22/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/22/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |

| | ALL_UnitOn_TF_1H | | | CT1_Load_Total_3Hr_MWe | | | CT2_Load_Total_3Hr_MWe | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 04/22/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/22/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/22/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/22/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/22/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/22/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/22/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/22/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/22/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/22/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/22/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/22/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/22/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/22/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/22/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/22/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/22/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/22/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/22/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/22/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/23/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/23/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/23/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/23/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/23/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/23/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/23/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/23/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/23/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/23/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/23/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/23/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/23/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/23/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |

| | ALL_UnitOn_TF_1H | | | CT1_Load_Total_3Hr_MWe | | | CT2_Load_Total_3Hr_MWe | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 04/23/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/23/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/23/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/23/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/23/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/23/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/23/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/23/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/23/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/23/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/24/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/24/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/24/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/24/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/24/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/24/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/24/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/24/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/24/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/24/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/24/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/24/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/24/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/24/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/24/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/24/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/24/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/24/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/24/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/24/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/24/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/24/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/24/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/24/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |

| | ALL_UnitOn_TF_1H | | | CT1_Load_Total_3Hr_MWe | | | CT2_Load_Total_3Hr_MWe | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 04/25/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/25/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/25/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/25/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/25/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/25/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/25/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/25/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/25/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/25/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/25/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/25/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/25/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/25/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/25/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/25/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/25/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/25/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/25/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/25/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/25/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/25/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/25/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/25/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/26/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/26/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/26/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/26/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/26/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/26/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/26/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/26/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/26/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/26/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |

| | ALL_UnitOn_TF_1H | | | CT1_Load_Total_3Hr_MWe | | | CT2_Load_Total_3Hr_MWe | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 04/26/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/26/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/26/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/26/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/26/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/26/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/26/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/26/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/26/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/26/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/26/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/26/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/26/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/26/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/27/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/27/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/27/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/27/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/27/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/27/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/27/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/27/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/27/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/27/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/27/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/27/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/27/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/27/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/27/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/27/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/27/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/27/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/27/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/27/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |

| | ALL_UnitOn_TF_1H | | | CT1_Load_Total_3Hr_MWe | | | CT2_Load_Total_3Hr_MWe | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 04/27/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/27/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/27/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/27/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/28/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/28/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/28/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/28/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/28/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/28/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/28/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/28/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/28/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/28/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/28/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/28/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/28/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/28/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/28/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/28/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/28/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/28/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/28/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/28/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/28/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/28/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/28/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/28/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/29/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/29/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/29/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/29/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/29/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/29/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |

| | ALL_UnitOn_TF_1H | | | CT1_Load_Total_3Hr_MWe | | | CT2_Load_Total_3Hr_MWe | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 04/29/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/29/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/29/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/29/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/29/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/29/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/29/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/29/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/29/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/29/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/29/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/29/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/29/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/29/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/29/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/29/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/29/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/29/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/30/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/30/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/30/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/30/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/30/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/30/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/30/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/30/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/30/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/30/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/30/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/30/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/30/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/30/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/30/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/30/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |

| | ALL_UnitOn_TF_1H | | | CT1_Load_Total_3Hr_MWe | | | CT2_Load_Total_3Hr_MWe | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 04/30/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/30/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/30/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/30/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/30/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/30/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/30/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 04/30/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/01/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/01/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/01/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/01/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/01/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/01/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/01/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/01/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/01/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/01/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/01/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/01/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/01/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/01/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/01/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/01/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/01/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/01/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/01/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/01/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/01/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/01/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/01/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/01/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/02/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/02/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |

| | ALL_UnitOn_TF_1H | | | CT1_Load_Total_3Hr_MWe | | | CT2_Load_Total_3Hr_MWe | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 05/02/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/02/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/02/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/02/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/02/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/02/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/02/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/02/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/02/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/02/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/02/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/02/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/02/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/02/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/02/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/02/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/02/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/02/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/02/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/02/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/02/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/02/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/03/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/03/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/03/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/03/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/03/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/03/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/03/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/03/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/03/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/03/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/03/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/03/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |

| | ALL_UnitOn_TF_1H | | | CT1_Load_Total_3Hr_MWe | | | CT2_Load_Total_3Hr_MWe | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 05/03/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/03/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/03/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/03/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/03/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/03/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/03/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/03/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/03/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/03/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/03/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/03/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/04/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/04/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/04/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/04/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/04/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/04/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/04/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/04/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/04/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/04/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/04/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/04/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/04/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/04/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/04/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/04/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/04/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/04/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/04/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/04/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/04/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/04/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |

| | ALL_UnitOn_TF_1H | | | CT1_Load_Total_3Hr_MWe | | | CT2_Load_Total_3Hr_MWe | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 05/04/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/04/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/05/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/05/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/05/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/05/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/05/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/05/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/05/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/05/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/05/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/05/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/05/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/05/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/05/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/05/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/05/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/05/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/05/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/05/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/05/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/05/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/05/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/05/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/05/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/05/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/06/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/06/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/06/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/06/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/06/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/06/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/06/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/06/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |

| | ALL_UnitOn_TF_1H | | | CT1_Load_Total_3Hr_MWe | | | CT2_Load_Total_3Hr_MWe | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 05/06/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/06/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/06/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/06/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/06/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/06/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/06/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/06/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/06/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/06/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/06/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/06/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/06/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/06/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/06/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/06/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/07/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/07/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/07/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/07/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/07/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/07/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/07/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/07/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/07/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/07/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/07/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/07/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/07/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/07/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/07/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/07/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/07/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/07/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |

| | ALL_UnitOn_TF_1H | | | CT1_Load_Total_3Hr_MWe | | | CT2_Load_Total_3Hr_MWe | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 05/07/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/07/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/07/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/07/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/07/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/07/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/08/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/08/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/08/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/08/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/08/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/08/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/08/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/08/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/08/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/08/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/08/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/08/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/08/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/08/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/08/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/08/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/08/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/08/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/08/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/08/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/08/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/08/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/08/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/08/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/09/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/09/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/09/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/09/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |

| | ALL_UnitOn_TF_1H | | | CT1_Load_Total_3Hr_MWe | | | CT2_Load_Total_3Hr_MWe | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 05/09/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/09/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/09/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/09/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/09/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/09/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/09/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/09/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/09/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/09/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/09/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/09/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/09/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/09/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/09/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/09/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/09/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/09/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/09/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/09/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/10/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/10/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/10/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/10/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/10/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/10/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/10/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/10/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/10/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/10/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/10/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/10/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/10/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/10/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |

| | ALL_UnitOn_TF_1H | | | CT1_Load_Total_3Hr_MWe | | | CT2_Load_Total_3Hr_MWe | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 05/10/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/10/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/10/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/10/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/10/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/10/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/10/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/10/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/10/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/10/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/11/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/11/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/11/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/11/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/11/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/11/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/11/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/11/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/11/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/11/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/11/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/11/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/11/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/11/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/11/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/11/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/11/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/11/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/11/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/11/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/11/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/11/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/11/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/11/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |

| | ALL_UnitOn_TF_1H | | | CT1_Load_Total_3Hr_MWe | | | CT2_Load_Total_3Hr_MWe | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 05/12/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/12/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/12/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/12/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/12/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/12/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/12/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/12/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/12/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/12/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/12/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/12/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/12/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/12/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/12/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/12/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/12/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/12/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/12/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/12/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/12/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/12/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/12/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/12/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/13/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/13/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/13/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/13/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/13/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/13/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/13/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/13/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/13/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/13/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |

| | ALL_UnitOn_TF_1H | | | CT1_Load_Total_3Hr_MWe | | | CT2_Load_Total_3Hr_MWe | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 05/13/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/13/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/13/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/13/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/13/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/13/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/13/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/13/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/13/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/13/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/13/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/13/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/13/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/13/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/14/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/14/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/14/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/14/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/14/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/14/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/14/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/14/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/14/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/14/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/14/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/14/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/14/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/14/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/14/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/14/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/14/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/14/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/14/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/14/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |

| | ALL_UnitOn_TF_1H | | | CT1_Load_Total_3Hr_MWe | | | CT2_Load_Total_3Hr_MWe | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 05/14/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/14/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/14/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/14/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/15/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/15/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/15/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/15/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/15/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/15/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/15/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/15/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/15/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/15/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/15/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/15/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/15/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/15/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/15/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/15/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/15/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/15/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/15/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/15/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/15/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/15/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/15/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/15/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/16/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/16/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/16/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/16/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/16/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/16/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |

| | ALL_UnitOn_TF_1H | | | CT1_Load_Total_3Hr_MWe | | | CT2_Load_Total_3Hr_MWe | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 05/16/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/16/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/16/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/16/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/16/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/16/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/16/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/16/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/16/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/16/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/16/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/16/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/16/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/16/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/16/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/16/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/16/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/16/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/17/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/17/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/17/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/17/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/17/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/17/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/17/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/17/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/17/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/17/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/17/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/17/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/17/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/17/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/17/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/17/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |

| | ALL_UnitOn_TF_1H | | | CT1_Load_Total_3Hr_MWe | | | CT2_Load_Total_3Hr_MWe | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 05/17/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/17/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/17/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/17/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/17/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/17/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/17/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/17/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/18/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/18/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/18/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/18/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/18/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/18/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/18/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/18/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/18/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/18/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/18/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/18/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/18/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/18/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/18/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/18/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/18/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/18/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/18/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/18/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/18/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/18/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/18/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/18/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/19/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/19/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |

| | ALL_UnitOn_TF_1H | | | CT1_Load_Total_3Hr_MWe | | | CT2_Load_Total_3Hr_MWe | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 05/19/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/19/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/19/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/19/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/19/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/19/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/19/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/19/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/19/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/19/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/19/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/19/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/19/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/19/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/19/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/19/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/19/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/19/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/19/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/19/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/19/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/19/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/20/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/20/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/20/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/20/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/20/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/20/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/20/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/20/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/20/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/20/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/20/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/20/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |

| | ALL_UnitOn_TF_1H | | | CT1_Load_Total_3Hr_MWe | | | CT2_Load_Total_3Hr_MWe | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 05/20/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/20/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/20/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/20/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/20/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/20/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/20/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/20/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/20/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/20/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/20/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/20/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/21/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/21/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/21/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/21/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/21/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/21/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/21/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/21/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/21/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/21/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/21/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/21/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/21/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/21/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/21/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/21/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/21/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/21/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/21/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/21/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/21/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/21/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |

| | ALL_UnitOn_TF_1H | | | CT1_Load_Total_3Hr_MWe | | | CT2_Load_Total_3Hr_MWe | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 05/21/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/21/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/22/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/22/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/22/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/22/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/22/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/22/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/22/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/22/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/22/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/22/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/22/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/22/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/22/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/22/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/22/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/22/23 15:00 | 1 | | | 0 | | | 0 | | | | | | | | | | |
| 05/22/23 16:00 | 1 | | | 5 | | | 0 | | | | | | | | | | |
| 05/22/23 17:00 | 0 | | | 5 | | | 0 | | | | | | | | | | |
| 05/22/23 18:00 | 0 | | | 5 | | | 0 | | | | | | | | | | |
| 05/22/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/22/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/22/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/22/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/22/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/23/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/23/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/23/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/23/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/23/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/23/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/23/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/23/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |

| | ALL_UnitOn_TF_1H | | | CT1_Load_Total_3Hr_MWe | | | CT2_Load_Total_3Hr_MWe | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 05/23/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/23/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/23/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/23/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/23/23 12:00 | 1 | | | 2 | | | 0 | | | | | | | | | | |
| 05/23/23 13:00 | 1 | | | 11 | | | 0 | | | | | | | | | | |
| 05/23/23 14:00 | 1 | | | 24 | | | 0 | | | | | | | | | | |
| 05/23/23 15:00 | 1 | | | 36 | | | 0 | | | | | | | | | | |
| 05/23/23 16:00 | 1 | | | 40 | | | 0 | | | | | | | | | | |
| 05/23/23 17:00 | 1 | | | 37 | | | 0 | | | | | | | | | | |
| 05/23/23 18:00 | 1 | | | 27 | | | 0 | | | | | | | | | | |
| 05/23/23 19:00 | 0 | | | 14 | | | 0 | | | | | | | | | | |
| 05/23/23 20:00 | 0 | | | 4 | | | 0 | | | | | | | | | | |
| 05/23/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/23/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/23/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/24/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/24/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/24/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/24/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/24/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/24/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/24/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/24/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/24/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/24/23 9:00 | 1 | | | 2 | | | 0 | | | | | | | | | | |
| 05/24/23 10:00 | 1 | | | 12 | | | 0 | | | | | | | | | | |
| 05/24/23 11:00 | 1 | | | 23 | | | 0 | | | | | | | | | | |
| 05/24/23 12:00 | 1 | | | 36 | | | 0 | | | | | | | | | | |
| 05/24/23 13:00 | 1 | | | 40 | | | 0 | | | | | | | | | | |
| 05/24/23 14:00 | 1 | | | 33 | | | 0 | | | | | | | | | | |
| 05/24/23 15:00 | 0 | | | 18 | | | 0 | | | | | | | | | | |
| 05/24/23 16:00 | 0 | | | 3 | | | 0 | | | | | | | | | | |
| 05/24/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |

| | ALL_UnitOn_TF_1H | | | CT1_Load_Total_3Hr_MWe | | | CT2_Load_Total_3Hr_MWe | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 05/24/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/24/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/24/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/24/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/24/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/24/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/25/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/25/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/25/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/25/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/25/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/25/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/25/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/25/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/25/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/25/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/25/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/25/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/25/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/25/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/25/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/25/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/25/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/25/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/25/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/25/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/25/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/25/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/25/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/25/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/26/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/26/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/26/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/26/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |

| | ALL_UnitOn_TF_1H | | | CT1_Load_Total_3Hr_MWe | | | CT2_Load_Total_3Hr_MWe | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 05/26/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/26/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/26/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/26/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/26/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/26/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/26/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/26/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/26/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/26/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/26/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/26/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/26/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/26/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/26/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/26/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/26/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/26/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/26/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/26/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/27/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/27/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/27/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/27/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/27/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/27/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/27/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/27/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/27/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/27/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/27/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/27/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/27/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/27/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |

| | ALL_UnitOn_TF_1H | | | CT1_Load_Total_3Hr_MWe | | | CT2_Load_Total_3Hr_MWe | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 05/27/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/27/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/27/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/27/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/27/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/27/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/27/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/27/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/27/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/27/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/28/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/28/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/28/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/28/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/28/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/28/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/28/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/28/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/28/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/28/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/28/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/28/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/28/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/28/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/28/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/28/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/28/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/28/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/28/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/28/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/28/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/28/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/28/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/28/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |

| | ALL_UnitOn_TF_1H | | | CT1_Load_Total_3Hr_MWe | | | CT2_Load_Total_3Hr_MWe | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 05/29/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/29/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/29/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/29/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/29/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/29/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/29/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/29/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/29/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/29/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/29/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/29/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/29/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/29/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/29/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/29/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/29/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/29/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/29/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/29/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/29/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/29/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/29/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/29/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/30/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/30/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/30/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/30/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/30/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/30/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/30/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/30/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/30/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/30/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |

| | ALL_UnitOn_TF_1H | | | CT1_Load_Total_3Hr_MWe | | | CT2_Load_Total_3Hr_MWe | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 05/30/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/30/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/30/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/30/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/30/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/30/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/30/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/30/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/30/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/30/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/30/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/30/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/30/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/30/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/31/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/31/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/31/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/31/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/31/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/31/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/31/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/31/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/31/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/31/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/31/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/31/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/31/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/31/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/31/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/31/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/31/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/31/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/31/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/31/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |

| | ALL_UnitOn_TF_1H | | | CT1_Load_Total_3Hr_MWe | | | CT2_Load_Total_3Hr_MWe | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 05/31/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/31/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/31/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 05/31/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/01/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/01/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/01/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/01/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/01/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/01/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/01/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/01/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/01/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/01/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/01/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/01/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/01/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/01/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/01/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/01/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/01/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/01/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/01/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/01/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/01/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/01/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/01/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/01/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/02/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/02/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/02/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/02/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/02/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/02/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |

| | ALL_UnitOn_TF_1H | | | CT1_Load_Total_3Hr_MWe | | | CT2_Load_Total_3Hr_MWe | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 06/02/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/02/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/02/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/02/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/02/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/02/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/02/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/02/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/02/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/02/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/02/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/02/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/02/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/02/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/02/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/02/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/02/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/02/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/03/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/03/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/03/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/03/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/03/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/03/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/03/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/03/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/03/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/03/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/03/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/03/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/03/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/03/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/03/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/03/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |

| | ALL_UnitOn_TF_1H | | | CT1_Load_Total_3Hr_MWe | | | CT2_Load_Total_3Hr_MWe | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 06/03/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/03/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/03/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/03/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/03/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/03/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/03/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/03/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/04/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/04/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/04/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/04/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/04/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/04/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/04/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/04/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/04/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/04/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/04/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/04/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/04/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/04/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/04/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/04/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/04/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/04/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/04/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/04/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/04/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/04/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/04/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/04/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/05/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/05/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |

| | ALL_UnitOn_TF_1H | | | CT1_Load_Total_3Hr_MWe | | | CT2_Load_Total_3Hr_MWe | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 06/05/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/05/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/05/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/05/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/05/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/05/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/05/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/05/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/05/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/05/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/05/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/05/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/05/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/05/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/05/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/05/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/05/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/05/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/05/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/05/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/05/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/05/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/06/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/06/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/06/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/06/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/06/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/06/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/06/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/06/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/06/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/06/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/06/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/06/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |

| | ALL_UnitOn_TF_1H | | | CT1_Load_Total_3Hr_MWe | | | CT2_Load_Total_3Hr_MWe | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 06/06/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/06/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/06/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/06/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/06/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/06/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/06/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/06/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/06/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/06/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/06/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/06/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/07/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/07/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/07/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/07/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/07/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/07/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/07/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/07/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/07/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/07/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/07/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/07/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/07/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/07/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/07/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/07/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/07/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/07/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/07/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/07/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/07/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/07/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |

| | ALL_UnitOn_TF_1H | | | CT1_Load_Total_3Hr_MWe | | | CT2_Load_Total_3Hr_MWe | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 06/07/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/07/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/08/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/08/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/08/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/08/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/08/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/08/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/08/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/08/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/08/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/08/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/08/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/08/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/08/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/08/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/08/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/08/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/08/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/08/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/08/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/08/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/08/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/08/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/08/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/08/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/09/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/09/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/09/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/09/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/09/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/09/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/09/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/09/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |

| | ALL_UnitOn_TF_1H | | | CT1_Load_Total_3Hr_MWe | | | CT2_Load_Total_3Hr_MWe | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 06/09/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/09/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/09/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/09/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/09/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/09/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/09/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/09/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/09/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/09/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/09/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/09/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/09/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/09/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/09/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/09/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/10/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/10/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/10/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/10/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/10/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/10/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/10/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/10/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/10/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/10/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/10/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/10/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/10/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/10/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/10/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/10/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/10/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/10/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |

| | ALL_UnitOn_TF_1H | | | CT1_Load_Total_3Hr_MWe | | | CT2_Load_Total_3Hr_MWe | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 06/10/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/10/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/10/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/10/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/10/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/10/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/11/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/11/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/11/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/11/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/11/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/11/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/11/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/11/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/11/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/11/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/11/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/11/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/11/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/11/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/11/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/11/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/11/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/11/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/11/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/11/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/11/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/11/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/11/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/11/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/12/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/12/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/12/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/12/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |

| | ALL_UnitOn_TF_1H | | | CT1_Load_Total_3Hr_MWe | | | CT2_Load_Total_3Hr_MWe | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 06/12/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/12/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/12/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/12/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/12/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/12/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/12/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/12/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/12/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/12/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/12/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/12/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/12/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/12/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/12/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/12/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/12/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/12/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/12/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/12/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/13/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/13/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/13/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/13/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/13/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/13/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/13/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/13/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/13/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/13/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/13/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/13/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/13/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/13/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |

| | ALL_UnitOn_TF_1H | | | CT1_Load_Total_3Hr_MWe | | | CT2_Load_Total_3Hr_MWe | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 06/13/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/13/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/13/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/13/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/13/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/13/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/13/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/13/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/13/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/13/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/14/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/14/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/14/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/14/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/14/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/14/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/14/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/14/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/14/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/14/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/14/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/14/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/14/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/14/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/14/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/14/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/14/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/14/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/14/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/14/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/14/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/14/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/14/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/14/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |

| | ALL_UnitOn_TF_1H | | | CT1_Load_Total_3Hr_MWe | | | CT2_Load_Total_3Hr_MWe | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 06/15/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/15/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/15/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/15/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/15/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/15/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/15/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/15/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/15/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/15/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/15/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/15/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/15/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/15/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/15/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/15/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/15/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/15/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/15/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/15/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/15/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/15/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/15/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/15/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/16/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/16/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/16/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/16/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/16/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/16/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/16/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/16/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/16/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/16/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |

| | ALL_UnitOn_TF_1H | | | CT1_Load_Total_3Hr_MWe | | | CT2_Load_Total_3Hr_MWe | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 06/16/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/16/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/16/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/16/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/16/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/16/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/16/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/16/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/16/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/16/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/16/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/16/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/16/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/16/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/17/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/17/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/17/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/17/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/17/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/17/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/17/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/17/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/17/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/17/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/17/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/17/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/17/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/17/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/17/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/17/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/17/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/17/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/17/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/17/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |

| | ALL_UnitOn_TF_1H | | | CT1_Load_Total_3Hr_MWe | | | CT2_Load_Total_3Hr_MWe | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 06/17/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/17/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/17/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/17/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/18/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/18/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/18/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/18/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/18/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/18/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/18/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/18/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/18/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/18/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/18/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/18/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/18/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/18/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/18/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/18/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/18/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/18/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/18/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/18/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/18/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/18/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/18/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/18/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/19/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/19/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/19/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/19/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/19/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/19/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |

| | ALL_UnitOn_TF_1H | | | CT1_Load_Total_3Hr_MWe | | | CT2_Load_Total_3Hr_MWe | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 06/19/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/19/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/19/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/19/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/19/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/19/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/19/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/19/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/19/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/19/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/19/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/19/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/19/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/19/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/19/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/19/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/19/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/19/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/20/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/20/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/20/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/20/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/20/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/20/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/20/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/20/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/20/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/20/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/20/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/20/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/20/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/20/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/20/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/20/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |

| | ALL_UnitOn_TF_1H | | | CT1_Load_Total_3Hr_MWe | | | CT2_Load_Total_3Hr_MWe | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 06/20/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/20/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/20/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/20/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/20/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/20/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/20/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/20/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/21/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/21/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/21/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/21/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/21/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/21/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/21/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/21/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/21/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/21/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/21/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/21/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/21/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/21/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/21/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/21/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/21/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/21/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/21/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/21/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/21/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/21/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/21/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/21/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/22/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/22/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |

| | ALL_UnitOn_TF_1H | | | CT1_Load_Total_3Hr_MWe | | | CT2_Load_Total_3Hr_MWe | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 06/22/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/22/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/22/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/22/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/22/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/22/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/22/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/22/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/22/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/22/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/22/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/22/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/22/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/22/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/22/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/22/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/22/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/22/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/22/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/22/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/22/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/22/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/23/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/23/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/23/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/23/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/23/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/23/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/23/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/23/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/23/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/23/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/23/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/23/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |

| | ALL_UnitOn_TF_1H | | | CT1_Load_Total_3Hr_MWe | | | CT2_Load_Total_3Hr_MWe | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 06/23/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/23/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/23/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/23/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/23/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/23/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/23/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/23/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/23/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/23/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/23/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/23/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/24/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/24/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/24/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/24/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/24/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/24/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/24/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/24/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/24/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/24/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/24/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/24/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/24/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/24/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/24/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/24/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/24/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/24/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/24/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/24/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/24/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/24/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |

| | ALL_UnitOn_TF_1H | | | CT1_Load_Total_3Hr_MWe | | | CT2_Load_Total_3Hr_MWe | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 06/24/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/24/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/25/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/25/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/25/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/25/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/25/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/25/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/25/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/25/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/25/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/25/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/25/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/25/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/25/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/25/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/25/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/25/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/25/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/25/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/25/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/25/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/25/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/25/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/25/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/25/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/26/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/26/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/26/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/26/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/26/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/26/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/26/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/26/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |

| | ALL_UnitOn_TF_1H | | | CT1_Load_Total_3Hr_MWe | | | CT2_Load_Total_3Hr_MWe | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 06/26/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/26/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/26/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/26/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/26/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/26/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/26/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/26/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/26/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/26/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/26/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/26/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/26/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/26/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/26/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/26/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/27/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/27/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/27/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/27/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/27/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/27/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/27/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/27/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/27/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/27/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/27/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/27/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/27/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/27/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/27/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/27/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/27/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/27/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |

| | ALL_UnitOn_TF_1H | | | CT1_Load_Total_3Hr_MWe | | | CT2_Load_Total_3Hr_MWe | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 06/27/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/27/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/27/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/27/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/27/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/27/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/28/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/28/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/28/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/28/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/28/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/28/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/28/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/28/23 7:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/28/23 8:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/28/23 9:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/28/23 10:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/28/23 11:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/28/23 12:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/28/23 13:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/28/23 14:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/28/23 15:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/28/23 16:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/28/23 17:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/28/23 18:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/28/23 19:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/28/23 20:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/28/23 21:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/28/23 22:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/28/23 23:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/29/23 0:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/29/23 1:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/29/23 2:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/29/23 3:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |

| | ALL_UnitOn_TF_1H | | | CT1_Load_Total_3Hr_MWe | | | CT2_Load_Total_3Hr_MWe | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 06/29/23 4:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/29/23 5:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/29/23 6:00 | 0 | | | 0 | | | 0 | | | | | | | | | | |
| 06/29/23 7:00 | 1 | | | 6 | | | 0 | | | | | | | | | | |
| 06/29/23 8:00 | 1 | | | 20 | | | 0 | | | | | | | | | | |
| 06/29/23 9:00 | 1 | | | 35 | | | 0 | | | | | | | | | | |
| 06/29/23 10:00 | 1 | | | 48 | | | 0 | | | | | | | | | | |
| 06/29/23 11:00 | 1 | | | 50 | | | 0 | | | | | | | | | | |
| 06/29/23 12:00 | 1 | | | 50 | | | 0 | | | | | | | | | | |
| 06/29/23 13:00 | 1 | | | 45 | | | 0 | | | | | | | | | | |
| 06/29/23 14:00 | 1 | | | 44 | | | 0 | | | | | | | | | | |
| 06/29/23 15:00 | 1 | | | 44 | | | 0 | | | | | | | | | | |
| 06/29/23 16:00 | 1 | | | 47 | | | 0 | | | | | | | | | | |
| 06/29/23 17:00 | 1 | | | 54 | | | 0 | | | | | | | | | | |
| 06/29/23 18:00 | 1 | | | 62 | | | 0 | | | | | | | | | | |
| 06/29/23 19:00 | 1 | | | 66 | | | 0 | | | | | | | | | | |
| 06/29/23 20:00 | 1 | | | 66 | | | 0 | | | | | | | | | | |
| 06/29/23 21:00 | 1 | | | 66 | | | 0 | | | | | | | | | | |
| 06/29/23 22:00 | 1 | | | 65 | | | 0 | | | | | | | | | | |
| 06/29/23 23:00 | 1 | | | 65 | | | 0 | | | | | | | | | | |
| 06/30/23 0:00 | 1 | | | 65 | | | 0 | | | | | | | | | | |
| 06/30/23 1:00 | 1 | | | 65 | | | 0 | | | | | | | | | | |
| 06/30/23 2:00 | 1 | | | 65 | | | 0 | | | | | | | | | | |
| 06/30/23 3:00 | 1 | | | 65 | | | 0 | | | | | | | | | | |
| 06/30/23 4:00 | 1 | | | 65 | | | 0 | | | | | | | | | | |
| 06/30/23 5:00 | 1 | | | 65 | | | 0 | | | | | | | | | | |
| 06/30/23 6:00 | 1 | | | 65 | | | 0 | | | | | | | | | | |
| 06/30/23 7:00 | 1 | | | 64 | | | 0 | | | | | | | | | | |
| 06/30/23 8:00 | 1 | | | 57 | | | 0 | | | | | | | | | | |
| 06/30/23 9:00 | 1 | | | 50 | | | 0 | | | | | | | | | | |
| 06/30/23 10:00 | 1 | | | 44 | | | 0 | | | | | | | | | | |
| 06/30/23 11:00 | 1 | | | 47 | | | 0 | | | | | | | | | | |
| 06/30/23 12:00 | 1 | | | 54 | | | 0 | | | | | | | | | | |
| 06/30/23 13:00 | 1 | | | 61 | | | 0 | | | | | | | | | | |

| | ALL_UnitOn_TF_1H | | | CT1_Load_Total_3Hr_MWe | | | CT2_Load_Total_3Hr_MWe | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 06/30/23 14:00 | 1 | | | 65 | | | 0 | | | | | | | | | | |
| 06/30/23 15:00 | 1 | | | 65 | | | 0 | | | | | | | | | | |
| 06/30/23 16:00 | 1 | | | 65 | | | 0 | | | | | | | | | | |
| 06/30/23 17:00 | 1 | | | 65 | | | 0 | | | | | | | | | | |
| 06/30/23 18:00 | 1 | | | 66 | | | 0 | | | | | | | | | | |
| 06/30/23 19:00 | 1 | | | 68 | | | 0 | | | | | | | | | | |
| 06/30/23 20:00 | 1 | | | 68 | | | 0 | | | | | | | | | | |
| 06/30/23 21:00 | 1 | | | 68 | | | 0 | | | | | | | | | | |
| 06/30/23 22:00 | 1 | | | 65 | | | 0 | | | | | | | | | | |
| 06/30/23 23:00 | 1 | | | 65 | | | 0 | | | | | | | | | | |

# Daily Calibration Results

## CT1 and CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:54 **Location:** Roseville, CA

**All Monitoring Sites, All Instruments, Daily Calibrations**

| | | Calibration Time | Span | Reference | Actual | Status | Performance Specification | Deviation |
|---|---|---|---|---|---|---|---|---|
| **Part 60** | **CT1_CODualRg_P_Instrument** | **Used For QA** | **Range: High** | | | **Calibration Result: Online** | **Pass** | |
| | Zero | 05/23/23 14:17 | 200.0 | 0.0 | 0.0 | | \|R-A\|/Span * 100 | 0.0 |
| | High | 05/23/23 14:28 | 200.0 | 178.7 | 179.0 | | \|R-A\|/Span * 100 | 0.2 |
| **Part 60** | **CT1_CODualRg_P_Instrument** | **Used For QA** | **Range: Low** | | | **Calibration Result: Online** | **Pass** | |
| | Zero | 05/23/23 14:17 | 10.0 | 0.0 | 0.0 | | \|R-A\|/Span * 100 | 0.0 |
| | High | 05/23/23 14:22 | 10.0 | 8.7 | 8.7 | | \|R-A\|/Span * 100 | 0.0 |
| **Part 75** | **CT1_NOXDualRg_P_Instrument** | **Used For QA** | **Range: High** | | | **Calibration Result: Online** | **Pass** | |
| | Zero | 05/23/23 14:17 | 200.0 | 0.0 | 0.0 | | \|R-A\|/Span * 100 | 0.0 |
| | High | 05/23/23 14:28 | 200.0 | 181.9 | 180.8 | | \|R-A\|/Span * 100 | 0.6 |
| **Part 75** | **CT1_NOXDualRg_P_Instrument** | **Used For QA** | **Range: Low** | | | **Calibration Result: Online** | **Pass** | |
| | Zero | 05/23/23 14:17 | 10.0 | 0.0 | 0.0 | | \|R-A\|/Span * 100 | 0.0 |
| | High | 05/23/23 14:22 | 10.0 | 8.4 | 8.1 | >1x Alert | \|R-A\|/Span * 100 | 3.0 |
| **Part 75** | **CT1_O2D_P_Instrument** | **Used For QA** | **Range: High** | | | **Calibration Result: Online** | **Pass** | |
| | High | 05/23/23 14:17 | 21.0 | 18.1 | 18.0 | | \|R-A\| | 0.1 |
| | Zero | 05/23/23 14:22 | 21.0 | 0.0 | 0.0 | | \|R-A\| | 0.0 |
| **Part 60** | **CT1_CODualRg_P_Instrument** | **Used For QA** | **Range: High** | | | **Calibration Result: Online** | **Pass** | |
| | Zero | 06/29/23 09:31 | 200.0 | 0.0 | 0.0 | | \|R-A\|/Span * 100 | 0.0 |
| | High | 06/29/23 09:41 | 200.0 | 178.7 | 180.6 | | \|R-A\|/Span * 100 | 1.0 |
| **Part 60** | **CT1_CODualRg_P_Instrument** | **Used For QA** | **Range: Low** | | | **Calibration Result: Online** | **Pass** | |
| | Zero | 06/29/23 09:31 | 10.0 | 0.0 | 0.0 | | \|R-A\|/Span * 100 | 0.0 |
| | High | 06/29/23 09:36 | 10.0 | 8.7 | 8.8 | | \|R-A\|/Span * 100 | 1.0 |
| **Part 75** | **CT1_NOXDualRg_P_Instrument** | **Used For QA** | **Range: High** | | | **Calibration Result: Online** | **Pass** | |
| | Zero | 06/29/23 09:31 | 200.0 | 0.0 | 0.0 | | \|R-A\|/Span * 100 | 0.0 |
| | High | 06/29/23 09:41 | 200.0 | 182.1 | 177.3 | | \|R-A\|/Span * 100 | 2.4 |
| **Part 75** | **CT1_NOXDualRg_P_Instrument** | **Used For QA** | **Range: Low** | | | **Calibration Result: Online** | **Pass** | |
| | Zero | 06/29/23 09:31 | 10.0 | 0.0 | 0.0 | | \|R-A\|/Span * 100 | 0.0 |
| | High | 06/29/23 09:36 | 10.0 | 8.4 | 8.1 | >1x Alert | \|R-A\|/Span * 100 | 3.0 |
| **Part 75** | **CT1_O2D_P_Instrument** | **Used For QA** | **Range: High** | | | **Calibration Result: Online** | **Pass** | |
| | High | 06/29/23 09:31 | 21.0 | 18.1 | 18.0 | | \|R-A\| | 0.1 |
| | Zero | 06/29/23 09:36 | 21.0 | 0.0 | 0.0 | | \|R-A\| | 0.0 |
| **Part 60** | **CT1_NOXInlet_P_Instrument** | **Used For QA** | **Range: High** | | | **Calibration Result: Online** | **Pass** | |
| | Zero | 06/30/23 02:14 | 200.0 | 0.0 | 0.1 | | \|R-A\|/Span * 100 | 0.1 |
| | High | 06/30/23 02:25 | 200.0 | 182.1 | 178.1 | | \|R-A\|/Span * 100 | 2.0 |
| **Part 60** | **CT1_NOXInlet_P_Instrument** | **Used For QA** | **Range: Low** | | | **Calibration Result: Online** | **Pass** | |
| | Zero | 06/30/23 02:14 | 30.0 | 0.0 | 0.1 | | \|R-A\|/Span * 100 | 0.3 |
| | High | 06/30/23 02:20 | 30.0 | 25.2 | 23.8 | >1x Alert | \|R-A\|/Span * 100 | 4.7 |

# Daily Calibration Results

## CT1 and CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:54 **Location:** Roseville, CA

**All Monitoring Sites, All Instruments, Daily Calibrations**

| | | Calibration Time | Span | Reference | Actual | Status | Performance Specification | Deviation |
|---|---|---|---|---|---|---|---|---|
| **Part 60** | **CT1_CODualRg_P_Instrument** | **Used For QA** | **Range: High** | | | **Calibration Result: Online** | | **Pass** |
| | Zero | 06/30/23 03:14 | 200.0 | 0.0 | 0.1 | | \|R-A\|/Span * 100 | 0.1 |
| | High | 06/30/23 03:25 | 200.0 | 178.7 | 180.7 | | \|R-A\|/Span * 100 | 1.0 |
| **Part 60** | **CT1_CODualRg_P_Instrument** | **Used For QA** | **Range: Low** | | | **Calibration Result: Online** | | **Pass** |
| | Zero | 06/30/23 03:14 | 10.0 | 0.0 | 0.1 | | \|R-A\|/Span * 100 | 1.0 |
| | High | 06/30/23 03:20 | 10.0 | 8.7 | 8.8 | | \|R-A\|/Span * 100 | 1.0 |
| **Part 75** | **CT1_NOXDualRg_P_Instrument** | **Used For QA** | **Range: High** | | | **Calibration Result: Online** | | **Pass** |
| | Zero | 06/30/23 03:14 | 200.0 | 0.0 | 0.0 | | \|R-A\|/Span * 100 | 0.0 |
| | High | 06/30/23 03:25 | 200.0 | 182.1 | 177.5 | | \|R-A\|/Span * 100 | 2.3 |
| **Part 75** | **CT1_NOXDualRg_P_Instrument** | **Used For QA** | **Range: Low** | | | **Calibration Result: Online** | | **Pass** |
| | Zero | 06/30/23 03:14 | 10.0 | 0.0 | 0.0 | | \|R-A\|/Span * 100 | 0.0 |
| | High | 06/30/23 03:20 | 10.0 | 8.4 | 7.9 | >1x Alert | \|R-A\|/Span * 100 | 5.0 |
| **Part 75** | **CT1_O2D_P_Instrument** | **Used For QA** | **Range: High** | | | **Calibration Result: Online** | | **Pass** |
| | High | 06/30/23 03:14 | 21.0 | 18.1 | 18.0 | | \|R-A\| | 0.1 |
| | Zero | 06/30/23 03:20 | 21.0 | 0.0 | 0.0 | | \|R-A\| | 0.0 |

# Monthly Summary Report

## Units CT1 and CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY
**Generated:** 07/07/2023 22:53 **Location:** Roseville, CA

| Date | Unit CT1 OperatingTime, Hr | | Unit CT1 DBOn, Hr | | Unit CT2 OperatingTime, Hr | | Unit CT2 DBOn, Hr | |
|---|---|---|---|---|---|---|---|---|
| | 1 Hour(s) | | 1 Hour(s) | | 1 Hour(s) | | 1 Hour(s) | |
| | Sum | Running Sum | Sum | Running Sum | Sum | Running Sum | Sum | Running Sum |
| Apr 23 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| May 23 | 11.30 | 11.30 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| Jun 23 | 40.57 | 51.87 | 28.69 | 28.69 | 0.00 | 0.00 | 0.00 | 0.00 |
| Sum/Avg | 51.87 | | 28.69 | | 0.00 | | 0.00 | |

# Tons 12 Month Rolling Summary

## CT1 and CT2 Combined

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:12 **Location:** Roseville, CA

* = Excess Emission

| Date | Units CT1 & CT2 CO, Ton 1 Day(s) Sum | Rolling Sum | Units CT1 & CT2 NOx, Ton 1 Day(s) Sum | Rolling Sum | Units CT1 & CT2 PM10, Ton 1 Day(s) Sum | Rolling Sum | Units CT1 & CT2 SO2, Ton 1 Day(s) Sum | Rolling Sum | Units CT1 & CT2 VOC, Ton 1 Day(s) Sum | Rolling Sum |
|---|---|---|---|---|---|---|---|---|---|---|
| Apr 2023 | 0.0000 | 7.6802 | 0.0000 | 14.7491 | 0.0000 | 3.0357 | 0.0000 | 1.5194 | 0.0000 | 5.0594 |
| May 2023 | 0.2388 | 7.4747 | 0.0309 | 14.1876 | 0.0023 | 2.9186 | 0.0012 | 1.4610 | 0.0038 | 4.8643 |
| Jun 2023 | 0.0363 | 6.7942 | 0.0578 | 13.1511 | 0.0115 | 2.7118 | 0.0057 | 1.3575 | 0.0192 | 4.5191 |
| **Sum/Avg** | 6.7942 | | 13.1511 | | 2.7118 | | 1.3575 | | 4.5191 | |
| **Limit Value** | | | | | | | | | | |

# CEMs Log

| Date/Time | Operator | Description |
|---|---|---|
| 04/03/23 11:05 | Operator (DWN) | UPDATED GCV FOR APRIL FOR EACH UNIT TO 104600 |

# Cylinder Gas Audit



| | | | | | |
|---|---|---|---|---|---|
| Facility: | ROSEVILLE ENERGY | | | Instrument | CT1_CODualRg_P_Instr |
| Unit/Stack: | CT1 | Test Date: | 06/21/2023 | Performance | 15 Pct |
| Parameter/Scal | CO / Low | Test | **Pass** | Alternate Spec: | 5 Ppm |

| Date | Time | Test Level | Span Value | Reference | Measured Value | Ref Value As Pct Span |
|---|---|---|---|---|---|---|
| 06/21/2023 | 12:57 | L | 10 | 2.400 | 2.100 | 24.0 % |
| 06/21/2023 | 13:02 | M | 10 | 5.700 | 5.500 | 57.0 % |
| 06/21/2023 | 13:09 | L | 10 | 2.400 | 2.100 | 24.0 % |
| 06/21/2023 | 13:14 | M | 10 | 5.700 | 5.500 | 57.0 % |
| 06/21/2023 | 13:21 | L | 10 | 2.400 | 2.200 | 24.0 % |
| 06/21/2023 | 13:26 | M | 10 | 5.700 | 5.500 | 57.0 % |

**Summary**

| Cal Gas Level | Reference | Mean | CEMS Mean | Specification | Results |
|---|---|---|---|---|---|
| L | 2.400 | | 2.133 | Std | **11.1** |
| M | 5.700 | | 5.500 | Std | **3.5** |

# Cylinder Gas Audit



| | | | | | |
|---|---|---|---|---|---|
| Facility: | ROSEVILLE ENERGY | | | Instrument | CT1_CODualRg_P_Instr |
| Unit/Stack: | CT1 | Test Date: | 06/21/2023 | Performance | 15 Pct |
| Parameter/Scal | CO / High | Test | **Pass** | Alternate Spec: | 5 Ppm |

| Date | Time | Test Level | Span Value | Reference | Measured Value | Ref Value As Pct Span |
|---|---|---|---|---|---|---|

| | | | | | | |
|---|---|---|---|---|---|---|
| 06/21/2023 | 13:54 | L | 200 | 49.800 | 45.100 | 24.9 % |
| 06/21/2023 | 13:59 | M | 200 | 109.200 | 106.000 | 54.6 % |
| 06/21/2023 | 14:11 | L | 200 | 49.800 | 45.300 | 24.9 % |
| 06/21/2023 | 14:16 | M | 200 | 109.200 | 106.000 | 54.6 % |
| 06/21/2023 | 14:28 | L | 200 | 49.800 | 45.100 | 24.9 % |
| 06/21/2023 | 14:33 | M | 200 | 109.200 | 106.000 | 54.6 % |

**Summary**

| Cal Gas Level | Reference Mean | CEMS Mean | Specification | Results |
|---|---|---|---|---|
| L | 49.800 | 45.167 | Std | **9.3** |
| M | 109.200 | 106.000 | Std | **2.9** |

# Cylinder Gas Audit



Facility: ROSEVILLE ENERGY
Unit/Stack: CT2
Parameter/Scal: CO / High
Test Date: 06/21/2023
Test **Pass**
Instrument: CT2_CODualRg_P_Instr
Performance: 15 Pct
Alternate Spec: 5 Ppm

| Date | Time | Test Level | Span Value | Reference | Measured Value | Ref Value As Pct Span |
|---|---|---|---|---|---|---|
| 06/21/2023 | 14:20 | L | 200 | 49.700 | 50.300 | 24.9 % |
| 06/21/2023 | 14:25 | M | 200 | 109.100 | 113.800 | 54.6 % |
| 06/21/2023 | 14:38 | L | 200 | 49.700 | 50.300 | 24.9 % |
| 06/21/2023 | 14:43 | M | 200 | 109.100 | 114.000 | 54.6 % |
| 06/21/2023 | 14:55 | L | 200 | 49.700 | 50.400 | 24.9 % |
| 06/21/2023 | 15:00 | M | 200 | 109.100 | 114.200 | 54.6 % |

**Summary**

| Cal Gas Level | Reference Mean | CEMS Mean | Specification | Results |
|---|---|---|---|---|
| L | 49.700 | 50.333 | Std | **1.3** |
| M | 109.100 | 114.000 | Std | **4.5** |

# Cylinder Gas Audit



Facility: ROSEVILLE ENERGY
Unit/Stack: CT2
Parameter/Scal CO / Low
Test Date: 06/21/2023
Test **Pass**
Instrument CT2_CODualRg_P_Instr
Performance 15 Pct
Alternate Spec: 5 Ppm

| Date | Time | Test Level | Span Value | Reference | Measured Value | Ref Value As Pct Span |
|---|---|---|---|---|---|---|
| 06/21/2023 | 15:22 | L | 10 | 2.400 | 2.400 | 24.0 % |
| 06/21/2023 | 15:27 | M | 10 | 5.700 | 5.800 | 57.0 % |
| 06/21/2023 | 15:34 | L | 10 | 2.400 | 2.300 | 24.0 % |
| 06/21/2023 | 15:39 | M | 10 | 5.700 | 5.900 | 57.0 % |
| 06/21/2023 | 15:46 | L | 10 | 2.400 | 2.400 | 24.0 % |
| 06/21/2023 | 15:51 | M | 10 | 5.700 | 5.900 | 57.0 % |

**Summary**

| Cal Gas Level | Reference Mean | CEMS Mean | Specification | Results |
|---|---|---|---|---|
| L | 2.400 | 2.367 | Std | **1.4** |
| M | 5.700 | 5.867 | Std | **2.9** |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 04/01/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/01/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/01/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/01/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/01/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/01/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/01/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/01/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/01/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/01/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/01/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/01/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/01/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/01/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/01/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/01/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/01/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/01/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/01/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/01/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/01/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/01/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/01/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/01/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 04/02/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/02/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/02/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/02/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/02/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/02/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/02/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/02/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/02/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/02/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/02/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/02/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/02/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/02/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/02/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/02/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/02/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/02/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/02/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/02/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/02/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/02/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/02/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/02/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 04/03/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/03/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/03/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/03/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/03/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/03/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/03/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/03/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/03/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/03/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/03/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/03/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/03/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/03/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/03/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/03/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/03/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/03/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/03/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/03/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/03/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/03/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/03/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/03/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,462.5 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 04/04/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/04/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/04/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/04/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/04/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/04/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/04/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/04/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/04/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/04/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/04/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/04/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/04/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/04/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/04/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/04/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/04/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/04/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/04/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/04/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/04/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/04/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/04/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/04/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 04/05/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/05/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/05/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/05/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/05/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/05/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/05/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/05/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/05/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/05/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/05/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/05/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/05/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/05/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/05/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/05/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/05/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/05/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/05/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/05/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/05/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/05/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/05/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/05/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 04/06/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/06/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/06/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/06/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/06/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/06/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/06/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/06/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/06/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/06/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/06/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/06/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/06/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/06/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/06/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/06/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/06/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/06/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/06/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/06/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/06/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/06/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/06/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/06/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 04/07/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/07/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/07/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/07/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/07/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/07/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/07/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/07/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/07/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/07/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/07/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/07/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/07/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/07/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/07/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/07/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/07/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/07/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/07/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/07/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/07/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/07/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/07/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/07/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 04/08/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/08/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/08/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/08/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/08/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/08/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/08/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/08/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/08/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/08/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/08/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/08/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/08/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/08/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/08/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/08/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/08/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/08/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/08/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/08/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/08/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/08/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/08/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/08/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 04/09/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/09/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/09/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/09/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/09/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/09/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/09/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/09/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/09/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/09/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/09/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/09/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/09/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/09/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/09/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/09/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/09/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/09/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/09/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/09/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/09/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/09/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/09/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/09/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 04/10/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/10/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/10/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/10/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/10/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/10/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/10/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/10/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/10/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/10/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/10/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/10/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/10/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/10/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/10/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/10/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/10/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/10/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/10/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/10/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/10/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/10/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/10/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/10/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 04/11/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/11/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/11/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/11/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/11/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/11/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/11/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/11/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/11/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/11/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/11/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/11/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/11/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/11/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/11/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/11/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/11/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/11/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/11/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/11/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/11/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/11/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/11/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/11/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 04/12/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/12/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/12/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/12/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/12/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/12/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/12/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/12/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/12/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/12/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/12/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/12/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/12/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/12/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/12/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/12/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/12/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/12/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/12/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/12/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/12/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/12/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/12/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/12/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 04/13/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/13/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/13/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/13/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/13/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/13/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/13/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/13/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/13/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/13/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/13/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/13/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/13/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/13/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/13/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/13/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/13/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/13/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/13/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/13/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/13/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/13/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/13/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/13/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 04/14/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/14/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/14/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/14/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/14/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/14/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/14/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/14/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/14/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/14/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/14/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/14/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/14/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/14/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/14/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/14/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/14/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/14/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/14/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/14/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/14/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/14/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/14/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/14/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 04/15/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/15/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/15/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/15/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/15/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/15/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/15/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/15/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/15/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/15/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/15/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/15/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/15/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/15/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/15/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/15/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/15/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/15/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/15/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/15/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/15/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/15/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/15/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/15/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 04/16/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/16/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/16/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/16/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/16/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/16/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/16/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/16/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/16/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/16/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/16/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/16/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/16/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/16/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/16/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/16/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/16/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/16/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/16/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/16/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/16/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/16/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/16/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/16/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 04/17/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/17/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/17/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/17/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/17/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/17/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/17/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/17/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/17/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/17/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/17/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/17/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/17/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/17/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/17/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/17/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/17/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/17/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/17/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/17/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/17/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/17/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/17/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/17/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 04/18/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/18/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/18/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/18/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/18/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/18/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/18/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/18/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/18/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/18/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/18/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/18/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/18/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/18/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/18/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/18/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/18/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/18/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/18/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/18/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/18/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/18/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/18/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/18/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 04/19/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/19/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/19/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/19/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/19/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/19/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/19/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/19/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/19/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/19/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/19/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/19/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/19/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/19/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/19/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/19/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/19/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/19/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/19/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/19/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/19/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/19/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/19/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/19/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 04/20/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/20/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/20/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/20/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/20/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/20/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/20/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/20/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/20/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/20/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/20/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/20/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/20/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/20/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/20/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/20/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/20/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/20/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/20/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/20/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/20/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/20/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/20/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/20/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 04/21/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/21/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/21/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/21/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/21/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/21/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/21/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/21/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/21/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/21/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/21/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/21/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/21/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/21/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/21/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/21/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/21/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/21/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/21/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/21/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/21/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/21/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/21/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/21/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 04/22/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/22/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/22/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/22/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/22/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/22/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/22/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/22/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/22/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/22/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/22/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/22/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/22/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/22/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/22/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/22/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/22/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/22/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/22/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/22/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/22/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/22/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/22/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/22/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 04/23/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/23/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/23/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/23/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/23/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/23/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/23/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/23/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/23/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/23/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/23/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/23/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/23/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/23/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/23/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/23/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/23/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/23/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/23/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/23/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/23/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/23/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/23/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/23/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 04/24/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/24/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/24/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/24/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/24/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/24/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/24/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/24/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/24/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/24/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/24/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/24/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/24/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/24/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/24/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/24/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/24/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/24/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/24/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/24/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/24/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/24/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/24/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/24/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 04/25/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/25/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/25/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/25/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/25/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/25/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/25/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/25/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/25/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/25/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/25/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/25/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/25/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/25/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/25/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/25/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/25/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/25/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/25/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/25/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/25/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/25/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/25/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/25/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 04/26/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/26/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/26/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/26/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/26/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/26/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/26/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/26/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/26/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/26/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/26/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/26/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/26/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/26/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/26/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/26/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/26/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/26/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/26/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/26/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/26/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/26/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/26/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/26/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 04/27/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/27/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/27/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/27/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/27/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/27/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/27/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/27/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/27/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/27/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/27/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/27/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/27/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/27/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/27/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/27/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/27/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/27/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/27/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/27/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/27/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/27/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/27/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/27/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 04/28/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/28/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/28/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/28/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/28/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/28/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/28/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/28/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/28/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/28/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/28/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/28/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/28/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/28/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/28/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/28/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/28/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/28/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/28/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/28/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/28/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/28/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/28/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/28/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 04/29/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/29/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/29/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/29/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/29/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/29/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/29/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/29/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/29/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/29/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/29/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/29/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/29/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/29/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/29/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/29/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/29/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/29/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/29/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/29/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/29/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/29/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/29/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/29/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 04/30/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/30/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/30/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/30/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/30/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/30/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/30/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/30/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/30/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/30/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/30/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/30/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/30/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/30/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/30/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/30/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/30/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/30/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/30/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/30/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/30/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/30/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/30/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 04/30/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 05/01/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/01/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/01/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/01/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/01/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/01/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/01/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/01/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/01/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/01/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/01/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/01/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/01/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/01/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/01/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/01/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/01/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/01/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/01/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/01/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/01/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/01/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/01/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/01/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 05/02/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/02/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/02/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/02/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/02/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/02/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/02/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/02/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/02/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/02/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/02/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/02/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/02/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/02/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/02/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/02/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/02/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/02/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/02/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/02/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/02/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/02/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/02/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/02/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 05/03/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/03/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/03/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/03/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/03/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/03/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/03/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/03/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/03/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/03/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/03/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/03/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/03/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/03/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/03/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/03/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/03/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/03/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/03/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/03/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/03/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/03/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/03/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/03/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,412.5 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 05/04/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/04/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/04/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/04/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/04/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/04/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/04/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/04/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/04/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/04/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/04/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/04/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/04/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/04/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/04/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/04/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/04/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/04/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/04/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/04/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/04/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/04/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/04/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/04/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 05/05/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/05/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/05/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/05/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/05/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/05/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/05/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/05/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/05/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/05/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/05/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/05/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/05/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/05/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/05/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/05/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/05/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/05/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/05/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/05/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/05/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/05/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/05/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/05/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 05/06/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/06/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/06/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/06/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/06/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/06/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/06/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/06/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/06/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/06/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/06/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/06/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/06/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/06/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/06/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/06/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/06/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/06/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/06/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/06/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/06/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/06/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/06/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/06/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 05/07/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/07/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/07/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/07/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/07/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/07/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/07/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/07/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/07/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/07/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/07/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/07/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/07/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/07/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/07/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/07/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/07/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/07/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/07/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/07/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/07/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/07/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/07/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/07/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 05/08/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/08/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/08/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/08/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/08/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/08/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/08/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/08/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/08/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/08/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/08/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/08/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/08/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/08/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/08/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/08/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/08/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/08/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/08/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/08/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/08/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/08/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/08/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/08/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 05/09/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/09/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/09/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/09/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/09/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/09/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/09/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/09/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/09/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/09/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/09/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/09/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/09/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/09/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/09/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/09/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/09/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/09/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/09/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/09/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/09/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/09/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/09/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/09/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 05/10/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/10/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/10/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/10/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/10/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/10/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/10/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/10/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/10/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/10/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/10/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/10/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/10/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/10/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/10/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/10/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/10/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/10/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/10/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/10/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/10/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/10/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/10/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/10/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 05/11/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/11/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/11/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/11/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/11/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/11/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/11/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/11/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/11/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/11/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/11/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/11/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/11/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/11/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/11/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/11/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/11/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/11/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/11/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/11/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/11/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/11/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/11/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/11/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 05/12/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/12/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/12/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/12/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/12/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/12/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/12/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/12/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/12/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/12/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/12/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/12/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/12/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/12/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/12/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/12/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/12/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/12/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/12/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/12/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/12/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/12/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/12/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/12/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 05/13/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/13/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/13/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/13/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/13/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/13/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/13/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/13/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/13/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/13/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/13/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/13/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/13/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/13/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/13/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/13/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/13/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/13/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/13/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/13/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/13/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/13/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/13/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/13/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 05/14/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/14/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/14/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/14/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/14/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/14/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/14/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/14/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/14/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/14/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/14/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/14/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/14/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/14/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/14/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/14/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/14/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/14/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/14/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/14/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/14/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/14/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/14/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/14/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 05/15/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/15/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/15/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/15/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/15/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/15/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/15/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/15/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/15/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/15/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/15/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/15/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/15/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/15/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/15/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/15/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/15/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/15/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/15/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/15/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/15/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/15/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/15/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/15/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 05/16/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/16/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/16/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/16/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/16/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/16/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/16/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/16/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/16/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/16/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/16/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/16/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/16/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/16/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/16/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/16/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/16/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/16/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/16/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/16/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/16/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/16/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/16/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/16/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 05/17/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/17/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/17/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/17/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/17/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/17/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/17/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/17/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/17/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/17/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/17/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/17/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/17/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/17/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/17/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/17/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/17/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/17/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/17/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/17/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/17/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/17/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/17/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/17/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 05/18/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/18/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/18/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/18/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/18/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/18/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/18/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/18/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/18/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/18/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/18/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/18/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/18/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/18/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/18/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/18/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/18/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/18/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/18/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/18/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/18/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/18/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/18/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/18/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 05/19/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/19/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/19/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/19/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/19/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/19/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/19/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/19/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/19/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/19/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/19/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/19/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/19/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/19/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/19/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/19/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/19/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/19/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/19/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/19/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/19/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/19/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/19/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/19/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 05/20/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/20/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/20/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/20/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/20/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/20/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/20/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/20/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/20/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/20/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/20/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/20/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/20/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/20/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/20/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/20/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/20/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/20/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/20/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/20/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/20/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/20/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/20/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/20/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 05/21/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/21/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/21/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/21/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/21/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/21/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/21/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/21/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/21/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/21/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/21/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/21/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/21/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/21/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/21/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/21/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/21/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/21/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/21/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/21/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/21/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/21/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/21/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/21/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 05/22/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/22/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/22/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/22/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/22/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/22/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/22/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/22/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/22/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/22/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/22/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/22/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/22/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/22/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/22/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/22/2023 15:00 | 1,231.7 | 0.0 | 1,231.7 | 104,300.0 | 128.5 | 0.00 | 0.0 | 0.0 |
| 05/22/2023 16:00 | 2,493.4 | 0.0 | 2,493.4 | 104,300.0 | 260.1 | 0.37 | 0.2 | 0.6 |
| 05/22/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/22/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/22/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/22/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/22/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/22/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/22/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 1,862.6 | 0.0 | 1,862.6 | 104,300.0 | 194.3 | 0.37 | 0.2 | 0.6 |
| Minimum: | 1,231.7 | 0.0 | 1,231.7 | 104,300.0 | 128.5 | 0.37 | 0.2 | 0.6 |
| Maximum: | 2,493.4 | 0.0 | 2,493.4 | 104,300.0 | 260.1 | 0.37 | 0.2 | 0.6 |
| %SI | 91.67 | 91.67 | 91.67 | 0.00 | 91.67 | 95.83 | 95.83 | 95.83 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 05/23/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/23/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/23/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/23/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/23/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/23/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/23/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/23/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/23/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/23/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/23/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/23/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/23/2023 12:00 | 1,509.3 | 0.0 | 1,509.3 | 104,300.0 | 157.4 | 0.00 | 0.0 | 0.0 |
| 05/23/2023 13:00 | 3,031.5 | 0.0 | 3,031.5 | 104,300.0 | 316.2 | 0.42 | 0.2 | 0.7 |
| 05/23/2023 14:00 | 4,193.8 | 0.0 | 4,193.8 | 104,300.0 | 437.4 | 0.53 | 0.3 | 0.9 |
| 05/23/2023 15:00 | 4,287.3 | 0.0 | 4,287.3 | 104,300.0 | 447.2 | 0.54 | 0.3 | 0.9 |
| 05/23/2023 16:00 | 3,941.1 | 0.0 | 3,941.1 | 104,300.0 | 411.1 | 0.49 | 0.2 | 0.8 |
| 05/23/2023 17:00 | 3,370.7 | 0.0 | 3,370.7 | 104,300.0 | 351.6 | 0.42 | 0.2 | 0.7 |
| 05/23/2023 18:00 | 2,042.3 | 0.0 | 2,042.3 | 104,300.0 | 213.0 | 0.00 | 0.0 | 0.0 |
| 05/23/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/23/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/23/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/23/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/23/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 3,196.6 | 0.0 | 3,196.6 | 104,300.0 | 333.4 | 0.48 | 0.2 | 0.8 |
| Minimum: | 1,509.3 | 0.0 | 1,509.3 | 104,300.0 | 157.4 | 0.42 | 0.2 | 0.7 |
| Maximum: | 4,287.3 | 0.0 | 4,287.3 | 104,300.0 | 447.2 | 0.54 | 0.3 | 0.9 |
| %SI | 70.83 | 70.83 | 70.83 | 0.00 | 70.83 | 79.17 | 79.17 | 79.17 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 05/24/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/24/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/24/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/24/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/24/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/24/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/24/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/24/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/24/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/24/2023 09:00 | 1,414.4 | 0.0 | 1,414.4 | 104,300.0 | 147.5 | 0.00 | 0.0 | 0.0 |
| 05/24/2023 10:00 | 3,411.3 | 0.0 | 3,411.3 | 104,300.0 | 355.8 | 0.43 | 0.2 | 0.7 |
| 05/24/2023 11:00 | 3,544.5 | 0.0 | 3,544.5 | 104,300.0 | 369.7 | 0.44 | 0.2 | 0.7 |
| 05/24/2023 12:00 | 3,552.6 | 0.0 | 3,552.6 | 104,300.0 | 370.5 | 0.45 | 0.2 | 0.7 |
| 05/24/2023 13:00 | 3,525.9 | 0.0 | 3,525.9 | 104,300.0 | 367.8 | 0.45 | 0.2 | 0.7 |
| 05/24/2023 14:00 | 1,726.7 | 0.0 | 1,726.7 | 104,300.0 | 180.1 | 0.00 | 0.0 | 0.0 |
| 05/24/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/24/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/24/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/24/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/24/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/24/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/24/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/24/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/24/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 2,862.6 | 0.0 | 2,862.6 | 104,300.0 | 298.6 | 0.44 | 0.2 | 0.7 |
| Minimum: | 1,414.4 | 0.0 | 1,414.4 | 104,300.0 | 147.5 | 0.43 | 0.2 | 0.7 |
| Maximum: | 3,552.6 | 0.0 | 3,552.6 | 104,300.0 | 370.5 | 0.45 | 0.2 | 0.7 |
| %SI | 75.00 | 75.00 | 75.00 | 0.00 | 75.00 | 83.33 | 83.33 | 83.33 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 05/25/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/25/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/25/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/25/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/25/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/25/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/25/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/25/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/25/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/25/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/25/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/25/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/25/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/25/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/25/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/25/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/25/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/25/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/25/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/25/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/25/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/25/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/25/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/25/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 05/26/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/26/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/26/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/26/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/26/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/26/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/26/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/26/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/26/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/26/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/26/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/26/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/26/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/26/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/26/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/26/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/26/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/26/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/26/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/26/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/26/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/26/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/26/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/26/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 05/27/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/27/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/27/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/27/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/27/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/27/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/27/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/27/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/27/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/27/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/27/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/27/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/27/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/27/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/27/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/27/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/27/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/27/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/27/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/27/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/27/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/27/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/27/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/27/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 05/28/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/28/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/28/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/28/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/28/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/28/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/28/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/28/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/28/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/28/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/28/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/28/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/28/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/28/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/28/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/28/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/28/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/28/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/28/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/28/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/28/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/28/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/28/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/28/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 05/29/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/29/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/29/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/29/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/29/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/29/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/29/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/29/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/29/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/29/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/29/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/29/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/29/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/29/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/29/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/29/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/29/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/29/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/29/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/29/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/29/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/29/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/29/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/29/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 05/30/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/30/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/30/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/30/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/30/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/30/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/30/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/30/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/30/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/30/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/30/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/30/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/30/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/30/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/30/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/30/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/30/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/30/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/30/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/30/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/30/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/30/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/30/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/30/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 05/31/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/31/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/31/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/31/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/31/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/31/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/31/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/31/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/31/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/31/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/31/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/31/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/31/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/31/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/31/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/31/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/31/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/31/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/31/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/31/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/31/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/31/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/31/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 05/31/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 06/01/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/01/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/01/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/01/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/01/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/01/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/01/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/01/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/01/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/01/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/01/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/01/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/01/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/01/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/01/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/01/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/01/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/01/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/01/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/01/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/01/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/01/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/01/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/01/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 06/02/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/02/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/02/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/02/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/02/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/02/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/02/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/02/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/02/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/02/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/02/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/02/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/02/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/02/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/02/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/02/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/02/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/02/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/02/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/02/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/02/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/02/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/02/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/02/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 06/03/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/03/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/03/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/03/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/03/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/03/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/03/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/03/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/03/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/03/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/03/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/03/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/03/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/03/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/03/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/03/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/03/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/03/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/03/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/03/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/03/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/03/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/03/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/03/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 06/04/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/04/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/04/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/04/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/04/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/04/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/04/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/04/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/04/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/04/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/04/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/04/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/04/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/04/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/04/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/04/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/04/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/04/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/04/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/04/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/04/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/04/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/04/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/04/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 06/05/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/05/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/05/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/05/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/05/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/05/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/05/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/05/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/05/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/05/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/05/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/05/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/05/2023 12:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/05/2023 13:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/05/2023 14:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/05/2023 15:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/05/2023 16:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/05/2023 17:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/05/2023 18:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/05/2023 19:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/05/2023 20:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/05/2023 21:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/05/2023 22:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/05/2023 23:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 103,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 06/06/2023 00:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/06/2023 01:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/06/2023 02:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/06/2023 03:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/06/2023 04:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/06/2023 05:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/06/2023 06:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/06/2023 07:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/06/2023 08:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/06/2023 09:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/06/2023 10:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/06/2023 11:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/06/2023 12:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/06/2023 13:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/06/2023 14:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/06/2023 15:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/06/2023 16:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/06/2023 17:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/06/2023 18:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/06/2023 19:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/06/2023 20:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/06/2023 21:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/06/2023 22:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/06/2023 23:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 06/07/2023 00:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/07/2023 01:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/07/2023 02:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/07/2023 03:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/07/2023 04:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/07/2023 05:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/07/2023 06:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/07/2023 07:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/07/2023 08:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/07/2023 09:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/07/2023 10:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/07/2023 11:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/07/2023 12:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/07/2023 13:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/07/2023 14:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/07/2023 15:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/07/2023 16:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/07/2023 17:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/07/2023 18:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/07/2023 19:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/07/2023 20:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/07/2023 21:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/07/2023 22:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/07/2023 23:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 06/08/2023 00:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/08/2023 01:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/08/2023 02:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/08/2023 03:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/08/2023 04:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/08/2023 05:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/08/2023 06:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/08/2023 07:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/08/2023 08:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/08/2023 09:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/08/2023 10:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/08/2023 11:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/08/2023 12:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/08/2023 13:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/08/2023 14:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/08/2023 15:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/08/2023 16:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/08/2023 17:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/08/2023 18:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/08/2023 19:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/08/2023 20:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/08/2023 21:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/08/2023 22:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/08/2023 23:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 06/09/2023 00:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/09/2023 01:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/09/2023 02:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/09/2023 03:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/09/2023 04:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/09/2023 05:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/09/2023 06:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/09/2023 07:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/09/2023 08:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/09/2023 09:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/09/2023 10:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/09/2023 11:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/09/2023 12:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/09/2023 13:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/09/2023 14:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/09/2023 15:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/09/2023 16:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/09/2023 17:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/09/2023 18:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/09/2023 19:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/09/2023 20:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/09/2023 21:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/09/2023 22:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/09/2023 23:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 06/10/2023 00:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/10/2023 01:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/10/2023 02:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/10/2023 03:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/10/2023 04:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/10/2023 05:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/10/2023 06:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/10/2023 07:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/10/2023 08:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/10/2023 09:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/10/2023 10:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/10/2023 11:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/10/2023 12:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/10/2023 13:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/10/2023 14:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/10/2023 15:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/10/2023 16:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/10/2023 17:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/10/2023 18:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/10/2023 19:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/10/2023 20:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/10/2023 21:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/10/2023 22:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/10/2023 23:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 06/11/2023 00:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/11/2023 01:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/11/2023 02:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/11/2023 03:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/11/2023 04:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/11/2023 05:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/11/2023 06:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/11/2023 07:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/11/2023 08:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/11/2023 09:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/11/2023 10:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/11/2023 11:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/11/2023 12:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/11/2023 13:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/11/2023 14:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/11/2023 15:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/11/2023 16:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/11/2023 17:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/11/2023 18:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/11/2023 19:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/11/2023 20:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/11/2023 21:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/11/2023 22:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/11/2023 23:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 06/12/2023 00:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/12/2023 01:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/12/2023 02:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/12/2023 03:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/12/2023 04:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/12/2023 05:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/12/2023 06:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/12/2023 07:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/12/2023 08:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/12/2023 09:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/12/2023 10:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/12/2023 11:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/12/2023 12:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/12/2023 13:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/12/2023 14:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/12/2023 15:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/12/2023 16:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/12/2023 17:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/12/2023 18:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/12/2023 19:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/12/2023 20:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/12/2023 21:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/12/2023 22:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/12/2023 23:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 06/13/2023 00:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/13/2023 01:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/13/2023 02:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/13/2023 03:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/13/2023 04:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/13/2023 05:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/13/2023 06:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/13/2023 07:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/13/2023 08:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/13/2023 09:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/13/2023 10:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/13/2023 11:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/13/2023 12:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/13/2023 13:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/13/2023 14:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/13/2023 15:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/13/2023 16:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/13/2023 17:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/13/2023 18:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/13/2023 19:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/13/2023 20:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/13/2023 21:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/13/2023 22:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/13/2023 23:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 06/14/2023 00:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/14/2023 01:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/14/2023 02:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/14/2023 03:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/14/2023 04:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/14/2023 05:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/14/2023 06:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/14/2023 07:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/14/2023 08:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/14/2023 09:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/14/2023 10:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/14/2023 11:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/14/2023 12:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/14/2023 13:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/14/2023 14:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/14/2023 15:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/14/2023 16:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/14/2023 17:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/14/2023 18:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/14/2023 19:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/14/2023 20:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/14/2023 21:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/14/2023 22:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/14/2023 23:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 06/15/2023 00:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/15/2023 01:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/15/2023 02:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/15/2023 03:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/15/2023 04:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/15/2023 05:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/15/2023 06:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/15/2023 07:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/15/2023 08:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/15/2023 09:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/15/2023 10:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/15/2023 11:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/15/2023 12:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/15/2023 13:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/15/2023 14:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/15/2023 15:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/15/2023 16:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/15/2023 17:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/15/2023 18:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/15/2023 19:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/15/2023 20:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/15/2023 21:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/15/2023 22:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/15/2023 23:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 06/16/2023 00:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/16/2023 01:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/16/2023 02:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/16/2023 03:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/16/2023 04:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/16/2023 05:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/16/2023 06:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/16/2023 07:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/16/2023 08:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/16/2023 09:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/16/2023 10:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/16/2023 11:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/16/2023 12:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/16/2023 13:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/16/2023 14:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/16/2023 15:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/16/2023 16:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/16/2023 17:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/16/2023 18:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/16/2023 19:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/16/2023 20:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/16/2023 21:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/16/2023 22:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/16/2023 23:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 06/17/2023 00:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/17/2023 01:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/17/2023 02:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/17/2023 03:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/17/2023 04:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/17/2023 05:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/17/2023 06:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/17/2023 07:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/17/2023 08:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/17/2023 09:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/17/2023 10:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/17/2023 11:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/17/2023 12:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/17/2023 13:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/17/2023 14:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/17/2023 15:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/17/2023 16:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/17/2023 17:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/17/2023 18:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/17/2023 19:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/17/2023 20:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/17/2023 21:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/17/2023 22:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/17/2023 23:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 06/18/2023 00:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/18/2023 01:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/18/2023 02:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/18/2023 03:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/18/2023 04:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/18/2023 05:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/18/2023 06:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/18/2023 07:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/18/2023 08:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/18/2023 09:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/18/2023 10:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/18/2023 11:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/18/2023 12:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/18/2023 13:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/18/2023 14:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/18/2023 15:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/18/2023 16:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/18/2023 17:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/18/2023 18:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/18/2023 19:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/18/2023 20:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/18/2023 21:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/18/2023 22:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/18/2023 23:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 06/19/2023 00:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/19/2023 01:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/19/2023 02:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/19/2023 03:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/19/2023 04:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/19/2023 05:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/19/2023 06:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/19/2023 07:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/19/2023 08:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/19/2023 09:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/19/2023 10:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/19/2023 11:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/19/2023 12:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/19/2023 13:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/19/2023 14:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/19/2023 15:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/19/2023 16:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/19/2023 17:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/19/2023 18:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/19/2023 19:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/19/2023 20:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/19/2023 21:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/19/2023 22:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/19/2023 23:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 06/20/2023 00:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/20/2023 01:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/20/2023 02:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/20/2023 03:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/20/2023 04:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/20/2023 05:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/20/2023 06:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/20/2023 07:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/20/2023 08:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/20/2023 09:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/20/2023 10:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/20/2023 11:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/20/2023 12:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/20/2023 13:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/20/2023 14:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/20/2023 15:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/20/2023 16:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/20/2023 17:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/20/2023 18:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/20/2023 19:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/20/2023 20:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/20/2023 21:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/20/2023 22:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/20/2023 23:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 06/21/2023 00:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/21/2023 01:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/21/2023 02:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/21/2023 03:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/21/2023 04:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/21/2023 05:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/21/2023 06:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/21/2023 07:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/21/2023 08:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/21/2023 09:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/21/2023 10:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/21/2023 11:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/21/2023 12:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/21/2023 13:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/21/2023 14:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/21/2023 15:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/21/2023 16:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/21/2023 17:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/21/2023 18:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/21/2023 19:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/21/2023 20:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/21/2023 21:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/21/2023 22:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/21/2023 23:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 06/22/2023 00:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/22/2023 01:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/22/2023 02:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/22/2023 03:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/22/2023 04:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/22/2023 05:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/22/2023 06:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/22/2023 07:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/22/2023 08:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/22/2023 09:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/22/2023 10:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/22/2023 11:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/22/2023 12:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/22/2023 13:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/22/2023 14:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/22/2023 15:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/22/2023 16:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/22/2023 17:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/22/2023 18:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/22/2023 19:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/22/2023 20:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/22/2023 21:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/22/2023 22:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/22/2023 23:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 06/23/2023 00:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/23/2023 01:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/23/2023 02:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/23/2023 03:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/23/2023 04:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/23/2023 05:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/23/2023 06:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/23/2023 07:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/23/2023 08:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/23/2023 09:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/23/2023 10:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/23/2023 11:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/23/2023 12:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/23/2023 13:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/23/2023 14:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/23/2023 15:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/23/2023 16:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/23/2023 17:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/23/2023 18:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/23/2023 19:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/23/2023 20:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/23/2023 21:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/23/2023 22:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/23/2023 23:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 06/24/2023 00:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/24/2023 01:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/24/2023 02:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/24/2023 03:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/24/2023 04:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/24/2023 05:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/24/2023 06:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/24/2023 07:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/24/2023 08:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/24/2023 09:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/24/2023 10:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/24/2023 11:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/24/2023 12:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/24/2023 13:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/24/2023 14:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/24/2023 15:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/24/2023 16:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/24/2023 17:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/24/2023 18:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/24/2023 19:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/24/2023 20:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/24/2023 21:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/24/2023 22:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/24/2023 23:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 06/25/2023 00:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/25/2023 01:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/25/2023 02:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/25/2023 03:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/25/2023 04:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/25/2023 05:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/25/2023 06:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/25/2023 07:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/25/2023 08:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/25/2023 09:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/25/2023 10:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/25/2023 11:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/25/2023 12:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/25/2023 13:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/25/2023 14:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/25/2023 15:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/25/2023 16:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/25/2023 17:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/25/2023 18:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/25/2023 19:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/25/2023 20:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/25/2023 21:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/25/2023 22:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/25/2023 23:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 06/26/2023 00:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/26/2023 01:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/26/2023 02:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/26/2023 03:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/26/2023 04:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/26/2023 05:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/26/2023 06:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/26/2023 07:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/26/2023 08:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/26/2023 09:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/26/2023 10:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/26/2023 11:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/26/2023 12:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/26/2023 13:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/26/2023 14:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/26/2023 15:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/26/2023 16:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/26/2023 17:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/26/2023 18:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/26/2023 19:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/26/2023 20:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/26/2023 21:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/26/2023 22:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/26/2023 23:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 06/27/2023 00:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/27/2023 01:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/27/2023 02:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/27/2023 03:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/27/2023 04:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/27/2023 05:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/27/2023 06:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/27/2023 07:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/27/2023 08:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/27/2023 09:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/27/2023 10:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/27/2023 11:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/27/2023 12:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/27/2023 13:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/27/2023 14:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/27/2023 15:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/27/2023 16:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/27/2023 17:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/27/2023 18:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/27/2023 19:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/27/2023 20:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/27/2023 21:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/27/2023 22:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/27/2023 23:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 06/28/2023 00:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/28/2023 01:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/28/2023 02:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/28/2023 03:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/28/2023 04:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/28/2023 05:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/28/2023 06:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/28/2023 07:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/28/2023 08:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/28/2023 09:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/28/2023 10:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/28/2023 11:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/28/2023 12:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/28/2023 13:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/28/2023 14:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/28/2023 15:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/28/2023 16:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/28/2023 17:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/28/2023 18:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/28/2023 19:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/28/2023 20:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/28/2023 21:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/28/2023 22:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/28/2023 23:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 06/29/2023 00:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/29/2023 01:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/29/2023 02:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/29/2023 03:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/29/2023 04:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/29/2023 05:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/29/2023 06:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.00 | 0.0 | 0.0 |
| 06/29/2023 07:00 | 2,479.4 | 0.0 | 2,479.4 | 102,300.0 | 253.6 | 0.00 | 0.0 | 0.0 |
| 06/29/2023 08:00 | 4,251.4 | 0.0 | 4,251.4 | 102,300.0 | 434.9 | 0.54 | 0.3 | 0.9 |
| 06/29/2023 09:00 | 4,221.9 | 0.0 | 4,221.9 | 102,300.0 | 431.9 | 0.52 | 0.3 | 0.9 |
| 06/29/2023 10:00 | 4,222.2 | 379.2 | 4,506.6 | 102,300.0 | 461.0 | 0.56 | 0.3 | 0.9 |
| 06/29/2023 11:00 | 3,709.5 | 74.6 | 3,725.9 | 102,300.0 | 381.2 | 0.46 | 0.2 | 0.8 |
| 06/29/2023 12:00 | 3,459.6 | 0.0 | 3,459.6 | 102,300.0 | 353.9 | 0.42 | 0.2 | 0.7 |
| 06/29/2023 13:00 | 3,471.3 | 0.0 | 3,471.3 | 102,300.0 | 355.1 | 0.43 | 0.2 | 0.7 |
| 06/29/2023 14:00 | 3,478.4 | 0.0 | 3,478.4 | 102,300.0 | 355.8 | 0.43 | 0.2 | 0.7 |
| 06/29/2023 15:00 | 3,476.8 | 0.0 | 3,476.8 | 102,300.0 | 355.7 | 0.43 | 0.2 | 0.7 |
| 06/29/2023 16:00 | 3,900.9 | 284.8 | 4,034.8 | 102,300.0 | 412.8 | 0.51 | 0.3 | 0.9 |
| 06/29/2023 17:00 | 4,217.1 | 911.6 | 5,128.7 | 102,300.0 | 524.7 | 0.63 | 0.3 | 1.0 |
| 06/29/2023 18:00 | 4,209.8 | 1,076.9 | 5,286.7 | 102,300.0 | 540.8 | 0.65 | 0.3 | 1.1 |
| 06/29/2023 19:00 | 4,200.0 | 1,158.3 | 5,358.3 | 102,300.0 | 548.2 | 0.66 | 0.3 | 1.1 |
| 06/29/2023 20:00 | 4,218.9 | 892.8 | 5,111.7 | 102,300.0 | 522.9 | 0.63 | 0.3 | 1.0 |
| 06/29/2023 21:00 | 4,254.2 | 811.0 | 5,065.2 | 102,300.0 | 518.2 | 0.62 | 0.3 | 1.0 |
| 06/29/2023 22:00 | 4,262.3 | 779.3 | 5,041.6 | 102,300.0 | 515.8 | 0.62 | 0.3 | 1.0 |
| 06/29/2023 23:00 | 4,272.2 | 749.8 | 5,022.0 | 102,300.0 | 513.8 | 0.62 | 0.3 | 1.0 |
| Average/Sum#: | 3,900.3 | 418.7 | 4,301.2 | 102,300.0 | 440.0 | 0.55 | 0.3 | 0.9 |
| Minimum: | 2,479.4 | 0.0 | 2,479.4 | 102,300.0 | 253.6 | 0.42 | 0.2 | 0.7 |
| Maximum: | 4,272.2 | 1,158.3 | 5,358.3 | 102,300.0 | 548.2 | 0.66 | 0.3 | 1.1 |
| %SI | 29.17 | 29.17 | 29.17 | 0.00 | 29.17 | 33.33 | 33.33 | 33.33 |

# Fuel Gas and Emissions Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:55 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT1 GasFlow, _CT, 100scfh | Unit CT1 GasFlow, _DB, 100scfh | Unit CT1 GasFlowTotal, 100scfh | Unit CT1 GCVGas, BtuPer100scf | Unit CT1 HI, MBtuPerHr | Unit CT1 PM10_Norm, LbPerHr | Unit CT1 SO2_Norm, LbPerHr | Unit CT1 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 06/30/2023 00:00 | 4,299.6 | 703.3 | 5,002.9 | 102,300.0 | 511.8 | 0.61 | 0.3 | 1.0 |
| 06/30/2023 01:00 | 4,323.5 | 651.6 | 4,975.1 | 102,300.0 | 509.0 | 0.61 | 0.3 | 1.0 |
| 06/30/2023 02:00 | 4,337.7 | 622.7 | 4,960.4 | 102,300.0 | 507.4 | 0.61 | 0.3 | 1.0 |
| 06/30/2023 03:00 | 4,354.5 | 593.3 | 4,947.8 | 102,300.0 | 506.2 | 0.61 | 0.3 | 1.0 |
| 06/30/2023 04:00 | 4,371.8 | 560.1 | 4,931.9 | 102,300.0 | 504.5 | 0.61 | 0.3 | 1.0 |
| 06/30/2023 05:00 | 4,386.2 | 527.0 | 4,913.2 | 102,300.0 | 502.6 | 0.60 | 0.3 | 1.0 |
| 06/30/2023 06:00 | 4,401.0 | 500.7 | 4,901.7 | 102,300.0 | 501.4 | 0.60 | 0.3 | 1.0 |
| 06/30/2023 07:00 | 4,355.5 | 377.2 | 4,657.3 | 102,300.0 | 476.4 | 0.58 | 0.3 | 1.0 |
| 06/30/2023 08:00 | 3,465.9 | 0.0 | 3,465.9 | 102,300.0 | 354.6 | 0.43 | 0.2 | 0.7 |
| 06/30/2023 09:00 | 3,462.1 | 0.0 | 3,462.1 | 102,300.0 | 354.2 | 0.43 | 0.2 | 0.7 |
| 06/30/2023 10:00 | 3,468.9 | 0.0 | 3,468.9 | 102,300.0 | 354.9 | 0.43 | 0.2 | 0.7 |
| 06/30/2023 11:00 | 3,919.9 | 242.0 | 4,028.8 | 102,300.0 | 412.1 | 0.51 | 0.3 | 0.9 |
| 06/30/2023 12:00 | 4,252.5 | 789.4 | 5,041.9 | 102,300.0 | 515.8 | 0.62 | 0.3 | 1.0 |
| 06/30/2023 13:00 | 4,228.4 | 844.4 | 5,072.8 | 102,300.0 | 518.9 | 0.62 | 0.3 | 1.0 |
| 06/30/2023 14:00 | 4,227.6 | 953.4 | 5,181.0 | 102,300.0 | 530.0 | 0.64 | 0.3 | 1.1 |
| 06/30/2023 15:00 | 4,226.4 | 865.1 | 5,091.5 | 102,300.0 | 520.9 | 0.62 | 0.3 | 1.0 |
| 06/30/2023 16:00 | 4,193.6 | 889.6 | 5,083.2 | 102,300.0 | 520.0 | 0.62 | 0.3 | 1.0 |
| 06/30/2023 17:00 | 4,183.3 | 888.6 | 5,071.9 | 102,300.0 | 518.9 | 0.62 | 0.3 | 1.0 |
| 06/30/2023 18:00 | 4,185.2 | 1,014.8 | 5,200.0 | 102,300.0 | 532.0 | 0.64 | 0.3 | 1.1 |
| 06/30/2023 19:00 | 4,171.0 | 1,601.3 | 5,772.3 | 102,300.0 | 590.5 | 0.71 | 0.4 | 1.2 |
| 06/30/2023 20:00 | 4,185.3 | 1,012.8 | 5,198.1 | 102,300.0 | 531.8 | 0.64 | 0.3 | 1.1 |
| 06/30/2023 21:00 | 4,206.8 | 868.4 | 5,075.2 | 102,300.0 | 519.2 | 0.62 | 0.3 | 1.0 |
| 06/30/2023 22:00 | 4,224.0 | 840.1 | 5,064.1 | 102,300.0 | 518.1 | 0.62 | 0.3 | 1.0 |
| 06/30/2023 23:00 | 4,248.0 | 724.0 | 4,972.0 | 102,300.0 | 508.6 | 0.61 | 0.3 | 1.0 |
| Average/Sum#: | 4,153.3 | 669.6 | 4,814.2 | 102,300.0 | 492.5 | 0.59 | 0.3 | 1.0 |
| Minimum: | 3,462.1 | 0.0 | 3,462.1 | 102,300.0 | 354.2 | 0.43 | 0.2 | 0.7 |
| Maximum: | 4,401.0 | 1,601.3 | 5,772.3 | 102,300.0 | 590.5 | 0.71 | 0.4 | 1.2 |
| %SI | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 04/01/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/01/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/01/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/01/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/01/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/01/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/01/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/01/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/01/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/01/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/01/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/01/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/01/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/01/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/01/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/01/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/01/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/01/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/01/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/01/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/01/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/01/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/01/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/01/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 04/02/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/02/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/02/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/02/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/02/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/02/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/02/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/02/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/02/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/02/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/02/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/02/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/02/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/02/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/02/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/02/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/02/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/02/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/02/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/02/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/02/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/02/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/02/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/02/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 04/03/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/03/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/03/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/03/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/03/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/03/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/03/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/03/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/03/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/03/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/03/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/03/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/03/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/03/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/03/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/03/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/03/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/03/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/03/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/03/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/03/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/03/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/03/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/03/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,462.5 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 04/04/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/04/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/04/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/04/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/04/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/04/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/04/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/04/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/04/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/04/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/04/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/04/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/04/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/04/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/04/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/04/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/04/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/04/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/04/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/04/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/04/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/04/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/04/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/04/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 04/05/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/05/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/05/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/05/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/05/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/05/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/05/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/05/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/05/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/05/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/05/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/05/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/05/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/05/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/05/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/05/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/05/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/05/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/05/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/05/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/05/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/05/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/05/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/05/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 04/06/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/06/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/06/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/06/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/06/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/06/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/06/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/06/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/06/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/06/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/06/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/06/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/06/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/06/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/06/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/06/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/06/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/06/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/06/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/06/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/06/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/06/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/06/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/06/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 04/07/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/07/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/07/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/07/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/07/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/07/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/07/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/07/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/07/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/07/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/07/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/07/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/07/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/07/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/07/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/07/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/07/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/07/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/07/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/07/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/07/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/07/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/07/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/07/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 04/08/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/08/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/08/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/08/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/08/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/08/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/08/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/08/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/08/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/08/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/08/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/08/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/08/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/08/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/08/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/08/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/08/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/08/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/08/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/08/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/08/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/08/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/08/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/08/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 04/09/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/09/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/09/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/09/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/09/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/09/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/09/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/09/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/09/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/09/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/09/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/09/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/09/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/09/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/09/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/09/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/09/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/09/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/09/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/09/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/09/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/09/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/09/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/09/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 04/10/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/10/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/10/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/10/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/10/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/10/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/10/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/10/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/10/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/10/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/10/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/10/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/10/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/10/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/10/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/10/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/10/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/10/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/10/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/10/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/10/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/10/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/10/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/10/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 04/11/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/11/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/11/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/11/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/11/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/11/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/11/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/11/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/11/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/11/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/11/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/11/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/11/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/11/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/11/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/11/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/11/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/11/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/11/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/11/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/11/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/11/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/11/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/11/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 04/12/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/12/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/12/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/12/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/12/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/12/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/12/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/12/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/12/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/12/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/12/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/12/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/12/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/12/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/12/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/12/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/12/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/12/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/12/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/12/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/12/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/12/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/12/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/12/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 04/13/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/13/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/13/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/13/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/13/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/13/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/13/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/13/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/13/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/13/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/13/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/13/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/13/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/13/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/13/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/13/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/13/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/13/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/13/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/13/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/13/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/13/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/13/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/13/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 04/14/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/14/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/14/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/14/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/14/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/14/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/14/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/14/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/14/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/14/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/14/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/14/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/14/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/14/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/14/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/14/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/14/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/14/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/14/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/14/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/14/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/14/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/14/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/14/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 04/15/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/15/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/15/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/15/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/15/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/15/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/15/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/15/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/15/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/15/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/15/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/15/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/15/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/15/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/15/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/15/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/15/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/15/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/15/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/15/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/15/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/15/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/15/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/15/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 04/16/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/16/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/16/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/16/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/16/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/16/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/16/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/16/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/16/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/16/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/16/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/16/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/16/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/16/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/16/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/16/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/16/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/16/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/16/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/16/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/16/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/16/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/16/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/16/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 04/17/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/17/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/17/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/17/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/17/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/17/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/17/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/17/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/17/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/17/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/17/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/17/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/17/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/17/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/17/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/17/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/17/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/17/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/17/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/17/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/17/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/17/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/17/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/17/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 04/18/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/18/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/18/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/18/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/18/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/18/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/18/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/18/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/18/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/18/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/18/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/18/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/18/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/18/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/18/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/18/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/18/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/18/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/18/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/18/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/18/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/18/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/18/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/18/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 04/19/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/19/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/19/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/19/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/19/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/19/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/19/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/19/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/19/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/19/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/19/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/19/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/19/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/19/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/19/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/19/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/19/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/19/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/19/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/19/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/19/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/19/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/19/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/19/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 04/20/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/20/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/20/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/20/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/20/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/20/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/20/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/20/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/20/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/20/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/20/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/20/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/20/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/20/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/20/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/20/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/20/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/20/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/20/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/20/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/20/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/20/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/20/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/20/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 04/21/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/21/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/21/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/21/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/21/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/21/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/21/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/21/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/21/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/21/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/21/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/21/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/21/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/21/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/21/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/21/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/21/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/21/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/21/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/21/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/21/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/21/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/21/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/21/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 04/22/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/22/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/22/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/22/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/22/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/22/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/22/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/22/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/22/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/22/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/22/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/22/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/22/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/22/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/22/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/22/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/22/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/22/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/22/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/22/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/22/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/22/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/22/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/22/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 04/23/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/23/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/23/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/23/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/23/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/23/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/23/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/23/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/23/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/23/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/23/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/23/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/23/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/23/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/23/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/23/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/23/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/23/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/23/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/23/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/23/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/23/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/23/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/23/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 04/24/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/24/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/24/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/24/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/24/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/24/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/24/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/24/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/24/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/24/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/24/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/24/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/24/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/24/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/24/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/24/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/24/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/24/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/24/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/24/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/24/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/24/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/24/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/24/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 04/25/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/25/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/25/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/25/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/25/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/25/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/25/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/25/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/25/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/25/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/25/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/25/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/25/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/25/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/25/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/25/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/25/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/25/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/25/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/25/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/25/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/25/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/25/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/25/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 04/26/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/26/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/26/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/26/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/26/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/26/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/26/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/26/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/26/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/26/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/26/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/26/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/26/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/26/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/26/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/26/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/26/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/26/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/26/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/26/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/26/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/26/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/26/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/26/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 04/27/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/27/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/27/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/27/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/27/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/27/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/27/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/27/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/27/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/27/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/27/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/27/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/27/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/27/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/27/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/27/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/27/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/27/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/27/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/27/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/27/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/27/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/27/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/27/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 04/28/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/28/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/28/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/28/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/28/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/28/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/28/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/28/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/28/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/28/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/28/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/28/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/28/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/28/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/28/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/28/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/28/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/28/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/28/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/28/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/28/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/28/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/28/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/28/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 04/29/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/29/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/29/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/29/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/29/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/29/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/29/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/29/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/29/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/29/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/29/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/29/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/29/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/29/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/29/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/29/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/29/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/29/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/29/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/29/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/29/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/29/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/29/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/29/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 04/30/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/30/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/30/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/30/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/30/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/30/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/30/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/30/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/30/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/30/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/30/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/30/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/30/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/30/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/30/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/30/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/30/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/30/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/30/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/30/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/30/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/30/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/30/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/30/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 05/01/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/01/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/01/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/01/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/01/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/01/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/01/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/01/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/01/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/01/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/01/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/01/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/01/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/01/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/01/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/01/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/01/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/01/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/01/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/01/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/01/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/01/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/01/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/01/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 05/02/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/02/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/02/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/02/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/02/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/02/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/02/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/02/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/02/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/02/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/02/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/02/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/02/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/02/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/02/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/02/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/02/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/02/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/02/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/02/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/02/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/02/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/02/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/02/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 05/03/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/03/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/03/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/03/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/03/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/03/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/03/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/03/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/03/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/03/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/03/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/03/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/03/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/03/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/03/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/03/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/03/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/03/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/03/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/03/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/03/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/03/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/03/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/03/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,412.5 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,600.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 05/04/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/04/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/04/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/04/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/04/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/04/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/04/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/04/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/04/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/04/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/04/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/04/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/04/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/04/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/04/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/04/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/04/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/04/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/04/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/04/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/04/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/04/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/04/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/04/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 05/05/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/05/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/05/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/05/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/05/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/05/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/05/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/05/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/05/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/05/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/05/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/05/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/05/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/05/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/05/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/05/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/05/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/05/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/05/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/05/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/05/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/05/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/05/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/05/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 05/06/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/06/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/06/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/06/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/06/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/06/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/06/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/06/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/06/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/06/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/06/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/06/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/06/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/06/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/06/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/06/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/06/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/06/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/06/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/06/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/06/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/06/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/06/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/06/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 05/07/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/07/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/07/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/07/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/07/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/07/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/07/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/07/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/07/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/07/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/07/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/07/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/07/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/07/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/07/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/07/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/07/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/07/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/07/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/07/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/07/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/07/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/07/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/07/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 05/08/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/08/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/08/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/08/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/08/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/08/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/08/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/08/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/08/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/08/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/08/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/08/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/08/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/08/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/08/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/08/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/08/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/08/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/08/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/08/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/08/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/08/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/08/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/08/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 05/09/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/09/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/09/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/09/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/09/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/09/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/09/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/09/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/09/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/09/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/09/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/09/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/09/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/09/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/09/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/09/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/09/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/09/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/09/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/09/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/09/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/09/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/09/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/09/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 05/10/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/10/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/10/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/10/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/10/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/10/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/10/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/10/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/10/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/10/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/10/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/10/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/10/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/10/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/10/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/10/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/10/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/10/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/10/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/10/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/10/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/10/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/10/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/10/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 05/11/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/11/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/11/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/11/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/11/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/11/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/11/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/11/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/11/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/11/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/11/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/11/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/11/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/11/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/11/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/11/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/11/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/11/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/11/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/11/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/11/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/11/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/11/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/11/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 05/12/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/12/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/12/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/12/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/12/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/12/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/12/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/12/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/12/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/12/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/12/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/12/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/12/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/12/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/12/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/12/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/12/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/12/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/12/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/12/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/12/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/12/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/12/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/12/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 05/13/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/13/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/13/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/13/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/13/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/13/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/13/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/13/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/13/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/13/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/13/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/13/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/13/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/13/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/13/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/13/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/13/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/13/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/13/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/13/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/13/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/13/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/13/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/13/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 05/14/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/14/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/14/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/14/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/14/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/14/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/14/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/14/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/14/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/14/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/14/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/14/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/14/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/14/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/14/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/14/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/14/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/14/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/14/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/14/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/14/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/14/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/14/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/14/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 05/15/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/15/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/15/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/15/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/15/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/15/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/15/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/15/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/15/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/15/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/15/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/15/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/15/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/15/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/15/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/15/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/15/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/15/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/15/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/15/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/15/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/15/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/15/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/15/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 05/16/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/16/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/16/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/16/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/16/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/16/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/16/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/16/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/16/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/16/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/16/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/16/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/16/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/16/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/16/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/16/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/16/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/16/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/16/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/16/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/16/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/16/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/16/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/16/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 05/17/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/17/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/17/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/17/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/17/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/17/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/17/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/17/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/17/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/17/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/17/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/17/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/17/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/17/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/17/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/17/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/17/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/17/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/17/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/17/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/17/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/17/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/17/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/17/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 05/18/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/18/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/18/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/18/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/18/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/18/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/18/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/18/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/18/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/18/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/18/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/18/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/18/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/18/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/18/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/18/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/18/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/18/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/18/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/18/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/18/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/18/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/18/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/18/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 05/19/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/19/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/19/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/19/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/19/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/19/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/19/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/19/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/19/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/19/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/19/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/19/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/19/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/19/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/19/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/19/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/19/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/19/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/19/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/19/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/19/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/19/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/19/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/19/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 05/20/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/20/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/20/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/20/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/20/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/20/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/20/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/20/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/20/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/20/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/20/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/20/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/20/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/20/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/20/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/20/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/20/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/20/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/20/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/20/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/20/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/20/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/20/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/20/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 05/21/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/21/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/21/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/21/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/21/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/21/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/21/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/21/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/21/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/21/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/21/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/21/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/21/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/21/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/21/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/21/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/21/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/21/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/21/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/21/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/21/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/21/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/21/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/21/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 05/22/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/22/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/22/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/22/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/22/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/22/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/22/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/22/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/22/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/22/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/22/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/22/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/22/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/22/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/22/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/22/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/22/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/22/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/22/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/22/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/22/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/22/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/22/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/22/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 05/23/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/23/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/23/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/23/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/23/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/23/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/23/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/23/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/23/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/23/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/23/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/23/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/23/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/23/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/23/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/23/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/23/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/23/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/23/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/23/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/23/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/23/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/23/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/23/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 05/24/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/24/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/24/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/24/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/24/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/24/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/24/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/24/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/24/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/24/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/24/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/24/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/24/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/24/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/24/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/24/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/24/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/24/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/24/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/24/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/24/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/24/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/24/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/24/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 05/25/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/25/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/25/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/25/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/25/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/25/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/25/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/25/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/25/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/25/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/25/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/25/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/25/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/25/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/25/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/25/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/25/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/25/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/25/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/25/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/25/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/25/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/25/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/25/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 05/26/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/26/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/26/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/26/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/26/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/26/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/26/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/26/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/26/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/26/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/26/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/26/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/26/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/26/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/26/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/26/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/26/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/26/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/26/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/26/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/26/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/26/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/26/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/26/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 05/27/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/27/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/27/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/27/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/27/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/27/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/27/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/27/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/27/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/27/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/27/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/27/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/27/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/27/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/27/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/27/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/27/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/27/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/27/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/27/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/27/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/27/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/27/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/27/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 05/28/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/28/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/28/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/28/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/28/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/28/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/28/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/28/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/28/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/28/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/28/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/28/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/28/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/28/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/28/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/28/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/28/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/28/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/28/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/28/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/28/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/28/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/28/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/28/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 05/29/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/29/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/29/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/29/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/29/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/29/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/29/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/29/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/29/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/29/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/29/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/29/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/29/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/29/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/29/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/29/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/29/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/29/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/29/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/29/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/29/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/29/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/29/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/29/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 05/30/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/30/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/30/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/30/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/30/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/30/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/30/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/30/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/30/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/30/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/30/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/30/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/30/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/30/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/30/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/30/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/30/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/30/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/30/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/30/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/30/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/30/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/30/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/30/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 05/31/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/31/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/31/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/31/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/31/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/31/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/31/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/31/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/31/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/31/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/31/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/31/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/31/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/31/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/31/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/31/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/31/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/31/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/31/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/31/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/31/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/31/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/31/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/31/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 06/01/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/01/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/01/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/01/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/01/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/01/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/01/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/01/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/01/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/01/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/01/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/01/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/01/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/01/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/01/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/01/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/01/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/01/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/01/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/01/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/01/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/01/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/01/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/01/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 06/02/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/02/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/02/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/02/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/02/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/02/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/02/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/02/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/02/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/02/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/02/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/02/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/02/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/02/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/02/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/02/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/02/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/02/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/02/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/02/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/02/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/02/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/02/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/02/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 06/03/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/03/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/03/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/03/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/03/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/03/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/03/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/03/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/03/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/03/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/03/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/03/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/03/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/03/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/03/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/03/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/03/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/03/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/03/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/03/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/03/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/03/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/03/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/03/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 06/04/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/04/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/04/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/04/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/04/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/04/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/04/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/04/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/04/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/04/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/04/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/04/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/04/2023 12:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/04/2023 13:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/04/2023 14:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/04/2023 15:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/04/2023 16:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/04/2023 17:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/04/2023 18:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/04/2023 19:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/04/2023 20:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/04/2023 21:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/04/2023 22:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/04/2023 23:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 06/05/2023 00:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/05/2023 01:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/05/2023 02:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/05/2023 03:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/05/2023 04:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/05/2023 05:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/05/2023 06:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/05/2023 07:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/05/2023 08:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/05/2023 09:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/05/2023 10:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/05/2023 11:00 | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/05/2023 12:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/05/2023 13:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/05/2023 14:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/05/2023 15:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/05/2023 16:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/05/2023 17:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/05/2023 18:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/05/2023 19:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/05/2023 20:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/05/2023 21:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/05/2023 22:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/05/2023 23:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 103,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 104,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 06/06/2023 00:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/06/2023 01:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/06/2023 02:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/06/2023 03:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/06/2023 04:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/06/2023 05:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/06/2023 06:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/06/2023 07:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/06/2023 08:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/06/2023 09:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/06/2023 10:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/06/2023 11:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/06/2023 12:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/06/2023 13:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/06/2023 14:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/06/2023 15:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/06/2023 16:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/06/2023 17:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/06/2023 18:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/06/2023 19:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/06/2023 20:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/06/2023 21:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/06/2023 22:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/06/2023 23:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 06/07/2023 00:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/07/2023 01:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/07/2023 02:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/07/2023 03:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/07/2023 04:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/07/2023 05:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/07/2023 06:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/07/2023 07:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/07/2023 08:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/07/2023 09:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/07/2023 10:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/07/2023 11:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/07/2023 12:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/07/2023 13:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/07/2023 14:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/07/2023 15:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/07/2023 16:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/07/2023 17:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/07/2023 18:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/07/2023 19:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/07/2023 20:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/07/2023 21:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/07/2023 22:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/07/2023 23:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 06/08/2023 00:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/08/2023 01:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/08/2023 02:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/08/2023 03:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/08/2023 04:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/08/2023 05:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/08/2023 06:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/08/2023 07:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/08/2023 08:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/08/2023 09:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/08/2023 10:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/08/2023 11:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/08/2023 12:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/08/2023 13:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/08/2023 14:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/08/2023 15:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/08/2023 16:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/08/2023 17:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/08/2023 18:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/08/2023 19:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/08/2023 20:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/08/2023 21:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/08/2023 22:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/08/2023 23:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 06/09/2023 00:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/09/2023 01:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/09/2023 02:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/09/2023 03:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/09/2023 04:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/09/2023 05:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/09/2023 06:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/09/2023 07:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/09/2023 08:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/09/2023 09:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/09/2023 10:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/09/2023 11:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/09/2023 12:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/09/2023 13:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/09/2023 14:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/09/2023 15:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/09/2023 16:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/09/2023 17:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/09/2023 18:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/09/2023 19:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/09/2023 20:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/09/2023 21:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/09/2023 22:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/09/2023 23:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 06/10/2023 00:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/10/2023 01:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/10/2023 02:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/10/2023 03:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/10/2023 04:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/10/2023 05:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/10/2023 06:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/10/2023 07:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/10/2023 08:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/10/2023 09:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/10/2023 10:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/10/2023 11:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/10/2023 12:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/10/2023 13:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/10/2023 14:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/10/2023 15:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/10/2023 16:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/10/2023 17:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/10/2023 18:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/10/2023 19:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/10/2023 20:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/10/2023 21:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/10/2023 22:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/10/2023 23:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 06/11/2023 00:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/11/2023 01:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/11/2023 02:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/11/2023 03:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/11/2023 04:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/11/2023 05:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/11/2023 06:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/11/2023 07:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/11/2023 08:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/11/2023 09:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/11/2023 10:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/11/2023 11:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/11/2023 12:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/11/2023 13:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/11/2023 14:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/11/2023 15:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/11/2023 16:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/11/2023 17:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/11/2023 18:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/11/2023 19:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/11/2023 20:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/11/2023 21:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/11/2023 22:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/11/2023 23:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 06/12/2023 00:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/12/2023 01:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/12/2023 02:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/12/2023 03:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/12/2023 04:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/12/2023 05:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/12/2023 06:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/12/2023 07:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/12/2023 08:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/12/2023 09:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/12/2023 10:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/12/2023 11:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/12/2023 12:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/12/2023 13:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/12/2023 14:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/12/2023 15:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/12/2023 16:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/12/2023 17:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/12/2023 18:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/12/2023 19:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/12/2023 20:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/12/2023 21:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/12/2023 22:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/12/2023 23:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 06/13/2023 00:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/13/2023 01:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/13/2023 02:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/13/2023 03:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/13/2023 04:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/13/2023 05:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/13/2023 06:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/13/2023 07:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/13/2023 08:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/13/2023 09:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/13/2023 10:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/13/2023 11:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/13/2023 12:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/13/2023 13:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/13/2023 14:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/13/2023 15:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/13/2023 16:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/13/2023 17:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/13/2023 18:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/13/2023 19:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/13/2023 20:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/13/2023 21:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/13/2023 22:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/13/2023 23:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 06/14/2023 00:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/14/2023 01:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/14/2023 02:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/14/2023 03:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/14/2023 04:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/14/2023 05:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/14/2023 06:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/14/2023 07:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/14/2023 08:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/14/2023 09:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/14/2023 10:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/14/2023 11:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/14/2023 12:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/14/2023 13:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/14/2023 14:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/14/2023 15:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/14/2023 16:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/14/2023 17:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/14/2023 18:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/14/2023 19:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/14/2023 20:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/14/2023 21:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/14/2023 22:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/14/2023 23:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 06/15/2023 00:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/15/2023 01:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/15/2023 02:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/15/2023 03:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/15/2023 04:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/15/2023 05:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/15/2023 06:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/15/2023 07:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/15/2023 08:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/15/2023 09:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/15/2023 10:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/15/2023 11:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/15/2023 12:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/15/2023 13:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/15/2023 14:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/15/2023 15:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/15/2023 16:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/15/2023 17:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/15/2023 18:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/15/2023 19:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/15/2023 20:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/15/2023 21:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/15/2023 22:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/15/2023 23:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 06/16/2023 00:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/16/2023 01:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/16/2023 02:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/16/2023 03:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/16/2023 04:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/16/2023 05:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/16/2023 06:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/16/2023 07:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/16/2023 08:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/16/2023 09:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/16/2023 10:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/16/2023 11:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/16/2023 12:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/16/2023 13:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/16/2023 14:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/16/2023 15:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/16/2023 16:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/16/2023 17:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/16/2023 18:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/16/2023 19:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/16/2023 20:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/16/2023 21:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/16/2023 22:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/16/2023 23:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 06/17/2023 00:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/17/2023 01:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/17/2023 02:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/17/2023 03:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/17/2023 04:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/17/2023 05:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/17/2023 06:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/17/2023 07:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/17/2023 08:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/17/2023 09:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/17/2023 10:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/17/2023 11:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/17/2023 12:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/17/2023 13:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/17/2023 14:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/17/2023 15:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/17/2023 16:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/17/2023 17:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/17/2023 18:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/17/2023 19:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/17/2023 20:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/17/2023 21:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/17/2023 22:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/17/2023 23:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 06/18/2023 00:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/18/2023 01:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/18/2023 02:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/18/2023 03:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/18/2023 04:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/18/2023 05:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/18/2023 06:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/18/2023 07:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/18/2023 08:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/18/2023 09:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/18/2023 10:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/18/2023 11:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/18/2023 12:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/18/2023 13:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/18/2023 14:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/18/2023 15:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/18/2023 16:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/18/2023 17:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/18/2023 18:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/18/2023 19:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/18/2023 20:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/18/2023 21:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/18/2023 22:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/18/2023 23:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 06/19/2023 00:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/19/2023 01:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/19/2023 02:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/19/2023 03:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/19/2023 04:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/19/2023 05:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/19/2023 06:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/19/2023 07:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/19/2023 08:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/19/2023 09:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/19/2023 10:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/19/2023 11:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/19/2023 12:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/19/2023 13:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/19/2023 14:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/19/2023 15:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/19/2023 16:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/19/2023 17:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/19/2023 18:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/19/2023 19:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/19/2023 20:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/19/2023 21:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/19/2023 22:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/19/2023 23:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 06/20/2023 00:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/20/2023 01:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/20/2023 02:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/20/2023 03:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/20/2023 04:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/20/2023 05:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/20/2023 06:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/20/2023 07:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/20/2023 08:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/20/2023 09:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/20/2023 10:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/20/2023 11:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/20/2023 12:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/20/2023 13:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/20/2023 14:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/20/2023 15:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/20/2023 16:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/20/2023 17:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/20/2023 18:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/20/2023 19:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/20/2023 20:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/20/2023 21:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/20/2023 22:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/20/2023 23:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 06/21/2023 00:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/21/2023 01:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/21/2023 02:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/21/2023 03:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/21/2023 04:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/21/2023 05:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/21/2023 06:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/21/2023 07:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/21/2023 08:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/21/2023 09:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/21/2023 10:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/21/2023 11:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/21/2023 12:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/21/2023 13:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/21/2023 14:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/21/2023 15:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/21/2023 16:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/21/2023 17:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/21/2023 18:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/21/2023 19:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/21/2023 20:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/21/2023 21:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/21/2023 22:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/21/2023 23:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 06/22/2023 00:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/22/2023 01:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/22/2023 02:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/22/2023 03:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/22/2023 04:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/22/2023 05:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/22/2023 06:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/22/2023 07:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/22/2023 08:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/22/2023 09:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/22/2023 10:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/22/2023 11:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/22/2023 12:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/22/2023 13:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/22/2023 14:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/22/2023 15:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/22/2023 16:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/22/2023 17:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/22/2023 18:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/22/2023 19:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/22/2023 20:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/22/2023 21:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/22/2023 22:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/22/2023 23:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 06/23/2023 00:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/23/2023 01:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/23/2023 02:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/23/2023 03:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/23/2023 04:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/23/2023 05:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/23/2023 06:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/23/2023 07:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/23/2023 08:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/23/2023 09:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/23/2023 10:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/23/2023 11:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/23/2023 12:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/23/2023 13:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/23/2023 14:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/23/2023 15:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/23/2023 16:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/23/2023 17:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/23/2023 18:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/23/2023 19:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/23/2023 20:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/23/2023 21:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/23/2023 22:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/23/2023 23:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 06/24/2023 00:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/24/2023 01:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/24/2023 02:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/24/2023 03:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/24/2023 04:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/24/2023 05:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/24/2023 06:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/24/2023 07:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/24/2023 08:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/24/2023 09:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/24/2023 10:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/24/2023 11:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/24/2023 12:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/24/2023 13:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/24/2023 14:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/24/2023 15:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/24/2023 16:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/24/2023 17:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/24/2023 18:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/24/2023 19:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/24/2023 20:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/24/2023 21:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/24/2023 22:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/24/2023 23:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 06/25/2023 00:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/25/2023 01:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/25/2023 02:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/25/2023 03:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/25/2023 04:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/25/2023 05:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/25/2023 06:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/25/2023 07:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/25/2023 08:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/25/2023 09:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/25/2023 10:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/25/2023 11:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/25/2023 12:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/25/2023 13:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/25/2023 14:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/25/2023 15:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/25/2023 16:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/25/2023 17:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/25/2023 18:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/25/2023 19:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/25/2023 20:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/25/2023 21:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/25/2023 22:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/25/2023 23:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 06/26/2023 00:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/26/2023 01:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/26/2023 02:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/26/2023 03:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/26/2023 04:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/26/2023 05:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/26/2023 06:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/26/2023 07:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/26/2023 08:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/26/2023 09:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/26/2023 10:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/26/2023 11:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/26/2023 12:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/26/2023 13:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/26/2023 14:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/26/2023 15:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/26/2023 16:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/26/2023 17:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/26/2023 18:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/26/2023 19:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/26/2023 20:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/26/2023 21:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/26/2023 22:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/26/2023 23:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 06/27/2023 00:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/27/2023 01:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/27/2023 02:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/27/2023 03:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/27/2023 04:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/27/2023 05:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/27/2023 06:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/27/2023 07:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/27/2023 08:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/27/2023 09:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/27/2023 10:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/27/2023 11:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/27/2023 12:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/27/2023 13:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/27/2023 14:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/27/2023 15:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/27/2023 16:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/27/2023 17:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/27/2023 18:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/27/2023 19:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/27/2023 20:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/27/2023 21:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/27/2023 22:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/27/2023 23:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 06/28/2023 00:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/28/2023 01:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/28/2023 02:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/28/2023 03:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/28/2023 04:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/28/2023 05:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/28/2023 06:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/28/2023 07:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/28/2023 08:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/28/2023 09:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/28/2023 10:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/28/2023 11:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/28/2023 12:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/28/2023 13:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/28/2023 14:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/28/2023 15:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/28/2023 16:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/28/2023 17:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/28/2023 18:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/28/2023 19:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/28/2023 20:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/28/2023 21:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/28/2023 22:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/28/2023 23:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 06/29/2023 00:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/29/2023 01:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/29/2023 02:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/29/2023 03:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/29/2023 04:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/29/2023 05:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/29/2023 06:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/29/2023 07:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/29/2023 08:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/29/2023 09:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/29/2023 10:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/29/2023 11:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/29/2023 12:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/29/2023 13:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/29/2023 14:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/29/2023 15:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/29/2023 16:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/29/2023 17:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/29/2023 18:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/29/2023 19:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/29/2023 20:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/29/2023 21:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/29/2023 22:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/29/2023 23:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# Fuel Gas and Emissions Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:04 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

| Const. Value/Limit Tag: | | | | | | > 4.73 | > 1 | > 1.8 |
|---|---|---|---|---|---|---|---|---|
| | Unit CT2 GasFlow, _CT, 100scfh | Unit CT2 GasFlow, _DB, 100scfh | Unit CT2 GasFlowTotal, 100scfh | Unit CT2 GCVGas, BtuPer100scf | Unit CT2 HI, MBtuPerHr | Unit CT2 PM10_Norm, LbPerHr | Unit CT2 SO2_Norm, LbPerHr | Unit CT2 VOC_Norm, LbPerHr |
| | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) | 1 Hour(s) |
| 06/30/2023 00:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/30/2023 01:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/30/2023 02:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/30/2023 03:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/30/2023 04:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/30/2023 05:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/30/2023 06:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/30/2023 07:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/30/2023 08:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/30/2023 09:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/30/2023 10:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/30/2023 11:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/30/2023 12:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/30/2023 13:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/30/2023 14:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/30/2023 15:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/30/2023 16:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/30/2023 17:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/30/2023 18:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/30/2023 19:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/30/2023 20:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/30/2023 21:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/30/2023 22:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/30/2023 23:00 | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Average/Sum#: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Minimum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Maximum: | 0.0 | 0.0 | 0.0 | 102,300.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| %SI | 100.00 | 100.00 | 100.00 | 0.00 | 100.00 | 100.00 | 100.00 | 100.00 |

# CO Ppmvdc EDS/CMS Summary Report

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59
**Generated:** 07/07/2023 23:05

**Facility Name:** ROSEVILLE ENERGY
**Location:** Roseville, CA
**Description:** Electric Utility

---

**CMS Data from:** CT1_CO_Ppmvdc_1H, CT1_UnitOn_TF_1H
**EDS Data from:** CT1_CO_Ppmvdc_3H, CT1_UnitOn_TF_1H
**Emission Limitation:** 4
**No Value Exclusions Allowed**
**Monitor Manufacturer and Model No.:** TELEDYNE MONITOR LABS INC, TML30
**Date of Latest CMS Certification or Audit:** 04/09/2006 14:00
**Process Unit(s) Description:**
**Operating time for EDS:** 56.00 Hour(s)
**Operating time for CMS:** 56.00 Hour(s)

| Emission Data Summary | |
|---|---|
| 1. Duration of excess emission in reporting period due to: | |
| a. Startup/shutdown | 0 |
| b. Control equipment problems | 0 |
| c. Process Problems | 0 |
| d. Other known causes | 0 |
| e. Unknown causes | 0 |
| 2. Upset Conditions | 0 |
| 3. Total Duration (Subtracts Exclusions and Upset Conditions) | 0 |
| 4. Time of Excess Emission as a percentage of operating time | 0.00 |
| 5. Time in compliance as percentage of operating time | 100.00 |

| CMS Performance Summary | |
|---|---|
| 1. CMS downtime in reporting period due to: | |
| a. Monitor equipment malfunctions | 0 |
| b. Non-Monitor equipment malfunctions | 0 |
| c. Quality assurance calibration | 0 |
| d. Other known causes | 0 |
| e. Unknown causes | 2 |
| 2. Total CMS Downtime | 2 |
| 3. Total Downtime as a percentage of operating time | 3.57 |
| 4. Total Availability as a percentage of operating time | 96.43 |

*Note: The total duration of EDS (<1%) and CMS (<5%) incidents meets federal standard 40CFR60.7(d), therefore the excess emmission detail report may not be required as part of the quarterly/semi-annual submission unless requested by the Administrator.*

# NOx Ppmvdc EDS/CMS Summary Report

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59
**Generated:** 07/07/2023 23:06

**Facility Name:** ROSEVILLE ENERGY
**Location:** Roseville, CA
**Description:** Electric Utility

---

**CMS Data from:** CT1_NOx_Ppmvdc_1H, CT1_UnitOn_TF_1H
**EDS Data from:** CT1_NOx_Ppmvdc_1H, CT1_UnitOn_TF_1H
**Emission Limitation:** 2.0
**No Value Exclusions Allowed**
**Monitor Manufacturer and Model No.:** TELEDYNE MONITOR LABS INC, TML41-O2
**Date of Latest CMS Certification or Audit:** 04/09/2006 14:00
**Process Unit(s) Description:**
**Operating time for EDS:** 56.00 Hour(s)
**Operating time for CMS:** 56.00 Hour(s)

| Emission Data Summary | |
|---|---|
| 1. Duration of excess emission in reporting period due to: | |
| a. Startup/shutdown | 0 |
| b. Control equipment problems | 0 |
| c. Process Problems | 0 |
| d. Other known causes | 0 |
| e. Unknown causes | 0 |
| 2. Upset Conditions | 0 |
| 3. Total Duration (Subtracts Exclusions and Upset Conditions) | 0 |
| 4. Time of Excess Emission as a percentage of operating time | 0.00 |
| 5. Time in compliance as percentage of operating time | 100.00 |

| CMS Performance Summary | |
|---|---|
| 1. CMS downtime in reporting period due to: | |
| a. Monitor equipment malfunctions | 0 |
| b. Non-Monitor equipment malfunctions | 0 |
| c. Quality assurance calibration | 0 |
| d. Other known causes | 0 |
| e. Unknown causes | 2 |
| 2. Total CMS Downtime | 2 |
| 3. Total Downtime as a percentage of operating time | 3.57 |
| 4. Total Availability as a percentage of operating time | 96.43 |

*Note: The total duration of EDS (<1%) and CMS (<5%) incidents meets federal standard 40CFR60.7(d), therefore the excess emmission detail report may not be required as part of the quarterly/semi-annual submission unless requested by the Administrator.*

# CO Ppmvdc EDS/CMS Summary Report

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59
**Generated:** 07/07/2023 23:07

**Facility Name:** ROSEVILLE ENERGY
**Location:** Roseville, CA
**Description:** Electric Utility

---

**CMS Data from:** CT2_CO_Ppmvdc_1H, CT2_UnitOn_TF_1H
**EDS Data from:** CT2_CO_Ppmvdc_3H, CT2_UnitOn_TF_1H
**Emission Limitation:** 4
**No Value Exclusions Allowed**
**Monitor Manufacturer and Model No.:** TELEDYNE MONITOR LABS INC, TML30
**Date of Latest CMS Certification or Audit:** 04/10/2006 07:00
**Process Unit(s) Description:**
**Operating time for EDS:** 0.00 Hour(s)
**Operating time for CMS:** 0.00 Hour(s)

| Emission Data Summary | |
|---|---|
| 1. Duration of excess emission in reporting period due to: | |
| a. Startup/shutdown | 0 |
| b. Control equipment problems | 0 |
| c. Process Problems | 0 |
| d. Other known causes | 0 |
| e. Unknown causes | 0 |
| 2. Upset Conditions | 0 |
| 3. Total Duration (Subtracts Exclusions and Upset Conditions) | 0 |
| 4. Time of Excess Emission as a percentage of operating time | 0.00 |
| 5. Time in compliance as percentage of operating time | 100.00 |

| CMS Performance Summary | |
|---|---|
| 1. CMS downtime in reporting period due to: | |
| a. Monitor equipment malfunctions | 0 |
| b. Non-Monitor equipment malfunctions | 0 |
| c. Quality assurance calibration | 0 |
| d. Other known causes | 0 |
| e. Unknown causes | 0 |
| 2. Total CMS Downtime | 0 |
| 3. Total Downtime as a percentage of operating time | 0.00 |
| 4. Total Availability as a percentage of operating time | 100.00 |

*Note: The total duration of EDS (<1%) and CMS (<5%) incidents meets federal standard 40CFR60.7(d), therefore the excess emmission detail report may not be required as part of the quarterly/semi-annual submission unless requested by the Administrator.*

# NOx Ppmvdc EDS/CMS Summary Report

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59
**Generated:** 07/07/2023 23:07

**Facility Name:** ROSEVILLE ENERGY
**Location:** Roseville, CA
**Description:** Electric Utility

---

**CMS Data from:** CT2_NOx_Ppmvdc_1H, CT2_UnitOn_TF_1H
**EDS Data from:** CT2_NOx_Ppmvdc_1H, CT2_UnitOn_TF_1H
**Emission Limitation:** 2.0
**No Value Exclusions Allowed**
**Monitor Manufacturer and Model No.:** TELEDYNE MONITOR LABS INC, TML41-O2
**Date of Latest CMS Certification or Audit:** 04/10/2006 07:00
**Process Unit(s) Description:**
**Operating time for EDS:** 0.00 Hour(s)
**Operating time for CMS:** 0.00 Hour(s)

| Emission Data Summary | |
|---|---|
| 1. Duration of excess emission in reporting period due to: | |
| a. Startup/shutdown | 0 |
| b. Control equipment problems | 0 |
| c. Process Problems | 0 |
| d. Other known causes | 0 |
| e. Unknown causes | 0 |
| 2. Upset Conditions | 0 |
| 3. Total Duration (Subtracts Exclusions and Upset Conditions) | 0 |
| 4. Time of Excess Emission as a percentage of operating time | 0.00 |
| 5. Time in compliance as percentage of operating time | 100.00 |

| CMS Performance Summary | |
|---|---|
| 1. CMS downtime in reporting period due to: | |
| a. Monitor equipment malfunctions | 0 |
| b. Non-Monitor equipment malfunctions | 0 |
| c. Quality assurance calibration | 0 |
| d. Other known causes | 0 |
| e. Unknown causes | 0 |
| 2. Total CMS Downtime | 0 |
| 3. Total Downtime as a percentage of operating time | 0.00 |
| 4. Total Availability as a percentage of operating time | 100.00 |

*Note: The total duration of EDS (<1%) and CMS (<5%) incidents meets federal standard 40CFR60.7(d), therefore the excess emmission detail report may not be required as part of the quarterly/semi-annual submission unless requested by the Administrator.*

# CO Invalid Data

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY
**Generated:** 07/07/2023 23:09 **Location:** Roseville, CA

---

**Tag Name:** CT1_CO_Ppm_1H
**Total Operating Time:** 56.00 Hour(s)
Non-Operating Time: 2,128.00 Hour(s) Report Time: 2,184.00 Hour(s)

No incidents have been reported for this reporting period. Monitor has 100% availability.

| | |
|---|---|
| **Total Operating Time:** | **56.00 Hour(s)** |
| **Total Monitor Downtime (Online only):** | **0.00 Hour(s)** |
| **Percent Monitor Availability:** | **100.00 %** |
| **Percent Monitor Downtime:** | **0.00 %** |

# NOx Invalid Data

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY
**Generated:** 07/07/2023 23:09 **Location:** Roseville, CA

---

**Tag Name:** CT1_NOx_Ppm_1H
**Total Operating Time:** 56.00 Hour(s)
Non-Operating Time: 2,128.00 Hour(s) Report Time: 2,184.00 Hour(s)

| Inc No | Start Time | End Time | Duration in Hour(s) | Reason Code - Description | Action Code - Description |
|---|---|---|---|---|---|
| 1 | 05/23/2023 12:00 | 05/23/2023 12:59 | 1 | 36 - NO CALIBRATION PRIOR TO STARTING UP - UNIT TRIPPED OFF LINE. | |
| 2 | 05/23/2023 13:00 | 05/23/2023 13:59 | 1 | 36 - NO CALIBRATION PRIOR TO STARTING UP - UNIT TRIPPED OFF LINE. | |

| | |
|---|---|
| **Total Operating Time:** | 56.00 Hour(s) |
| **Total Monitor Downtime (Online only):** | 2.00 Hour(s) |
| **Percent Monitor Availability:** | 96.43 % |
| **Percent Monitor Downtime:** | 3.57 % |

| Report Code | Type | Text | Duration | Duration Percent |
|---|---|---|---|---|
| 36 | Reason | NO CALIBRATION PRIOR TO STARTING UP - UNIT TRIPPED OFF LINE. | 2 | 100.00 |

# NOx SCR Invalid Data

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY
**Generated:** 07/07/2023 23:12 **Location:** Roseville, CA

---

**Tag Name:** CT1_NOx_SCR_Ppm_1H
**Total Operating Time:** 56.00 Hour(s)
Non-Operating Time: 2,128.00 Hour(s) Report Time: 2,184.00 Hour(s)

No incidents have been reported for this reporting period. Monitor has 100% availability.

| | |
|---|---|
| **Total Operating Time:** | **56.00 Hour(s)** |
| **Total Monitor Downtime (Online only):** | **0.00 Hour(s)** |
| **Percent Monitor Availability:** | **100.00 %** |
| **Percent Monitor Downtime:** | **0.00 %** |

# O2 Invalid Data

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY
**Generated:** 07/07/2023 23:12 **Location:** Roseville, CA

---

**Tag Name:** CT1_O2Dry_Pct_1H
**Total Operating Time:** 56.00 Hour(s)
Non-Operating Time: 2,128.00 Hour(s) Report Time: 2,184.00 Hour(s)

| Inc No | Start Time | End Time | Duration in Hour(s) | Reason Code - Description | Action Code - Description |
|---|---|---|---|---|---|
| 1 | 05/23/2023 12:00 | 05/23/2023 12:59 | 1 | 36 - NO CALIBRATION PRIOR TO STARTING UP - UNIT TRIPPED OFF LINE. | |
| 2 | 05/23/2023 13:00 | 05/23/2023 13:59 | 1 | 36 - NO CALIBRATION PRIOR TO STARTING UP - UNIT TRIPPED OFF LINE. | |

| | |
|---|---|
| **Total Operating Time:** | **56.00 Hour(s)** |
| **Total Monitor Downtime (Online only):** | **2.00 Hour(s)** |
| **Percent Monitor Availability:** | **96.43 %** |
| **Percent Monitor Downtime:** | **3.57 %** |

| Report Code | Type | Text | Duration | Duration Percent |
|---|---|---|---|---|
| 36 | Reason | NO CALIBRATION PRIOR TO STARTING UP - UNIT TRIPPED OFF LINE. | 2 | 100.00 |

# CO Invalid Data

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY
**Generated:** 07/07/2023 23:13 **Location:** Roseville, CA

---

**Tag Name:** CT2_CO_Ppm_1H
**Total Operating Time:** 0.00 Hour(s)
Non-Operating Time: 2,184.00 Hour(s) Report Time: 2,184.00 Hour(s)

No incidents have been reported for this reporting period. Monitor has 100% availability.

| | |
|---|---|
| **Total Operating Time:** | **0.00 Hour(s)** |
| **Total Monitor Downtime (Online only):** | **0.00 Hour(s)** |
| **Percent Monitor Availability:** | **100.00 %** |
| **Percent Monitor Downtime:** | **0.00 %** |

# NOx Invalid Data

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY
**Generated:** 07/07/2023 23:14 **Location:** Roseville, CA

---

**Tag Name:** CT2_NOx_Ppm_1H
**Total Operating Time:** 0.00 Hour(s)
Non-Operating Time: 2,184.00 Hour(s) Report Time: 2,184.00 Hour(s)

No incidents have been reported for this reporting period. Monitor has 100% availability.

| | |
|---|---|
| **Total Operating Time:** | **0.00 Hour(s)** |
| **Total Monitor Downtime (Online only):** | **0.00 Hour(s)** |
| **Percent Monitor Availability:** | **100.00 %** |
| **Percent Monitor Downtime:** | **0.00 %** |

# NOx SCR Invalid Data

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY
**Generated:** 07/07/2023 23:14 **Location:** Roseville, CA

---

**Tag Name:** CT2_NOx_SCR_Ppm_1H
**Total Operating Time:** 0.00 Hour(s)
Non-Operating Time: 2,184.00 Hour(s) Report Time: 2,184.00 Hour(s)

No incidents have been reported for this reporting period. Monitor has 100% availability.

| | |
|---|---|
| **Total Operating Time:** | **0.00 Hour(s)** |
| **Total Monitor Downtime (Online only):** | **0.00 Hour(s)** |
| **Percent Monitor Availability:** | **100.00 %** |
| **Percent Monitor Downtime:** | **0.00 %** |

# O2 Invalid Data

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY
**Generated:** 07/07/2023 23:15 **Location:** Roseville, CA

---

**Tag Name:** CT2_O2Dry_Pct_1H
**Total Operating Time:** 0.00 Hour(s)
Non-Operating Time: 2,184.00 Hour(s) Report Time: 2,184.00 Hour(s)

No incidents have been reported for this reporting period. Monitor has 100% availability.

| | |
|---|---|
| **Total Operating Time:** | **0.00 Hour(s)** |
| **Total Monitor Downtime (Online only):** | **0.00 Hour(s)** |
| **Percent Monitor Availability:** | **100.00 %** |
| **Percent Monitor Downtime:** | **0.00 %** |

**ATTACHMENT 7**

# AQ-36

**AQ-36**: The project owner shall notify the _PCAPCD of any breakdown condition as soon as reasonably possible, but no later than two PCAPCD business hours after its detection.

**Verification:** The Project owner shall include the identification of all breakdowns, PCAPCD notification, resulting excess emission (if any) and corrective actions taken (if any) as part of the Quarterly Air Quality Report required in Condition of Certification AQ-SC6

| | | | | - | | 2 0 2 3 | 0 0 9 |
|---|---|---|---|---|---|---|---|

Year Non-Compliance Event Number

Placer County AIR POLLUTION CONTROL DISTRICT

110 Maple Street, Auburn, CA 95603 • (530) 745-2330 • Fax (530) 745-2373 • www.placerair.org

Erik C. White, Air Pollution Control Officer

# NON-COMPLIANCE EVENT NOTIFICATION FORM – PART I

**submit within 2 business hours after detection of the Non-Compliance Event**

| | | | | | | | | |
|---|---|---|---|---|---|---|---|---|
| 1. **Company Name** | **ROSEVILLE ENERGY PARK** | | | | **5120 PHILLIP ROAD** | | | |
| 2. **Title V Source Status** | **Major Yes** ☑ | No ☐ | **Synthetic Minor** Yes ☐ | No ☑ | | | | |
| 3. **For Title V Sources, is the Non-Compliance Event the Result of an Emergency under District Rule 507, Section 402.2(I)** | Yes ☐ | No ☐ | | | | | | |
| 4. **Emission Exceedances** | NOx ☐ | SOx ☐ | PM ☐ | VOC ☐ | CO ☑ | Opacity ☐ | None ☐ | check all that apply |
| 5. **CEMS / COMS / CMS Breakdown** | Yes ☐ | No ☑ | | | | | | |
| 6. **Detection of Non-Compliance Event** | **Date** 5-22-23 | **Time** 16:00 | ☐ AM ☑ PM | | | | | |
| 7. **Start of Non-Compliance Event** | **Date** 5-22-23 | **Time** 15:00 | ☐ AM ☑ PM | ☐ Not known | | | | |
| 8. **Violation** | **Permit No. REPR-20-1** | **Condition No. 51** | **Rule** | **Section** | | | | |
| 9. **Unit / Equipment Involved** | **CT1** | | | | | | | |
| 10. **Description / Cause of Non-Compliance Event** additional information attached | **Gas leaks in CT package caused Emergency shut-down** ☑ | | | | | | | |
| 11. **Immediate Corrective Actions** | **Shut down unit** ☑ additional information attached | | | | | | | |
| 12. **Was the Non-Compliance Event an Emission Violation or Monitoring Equipment Failure or Malfunction** Yes ☑ No ☐ **If yes, do you Request that the Violation, Failure or Malfunction be Shielded from Enforcement Action as an Upset / Breakdown Pursuant to District Rule 404** | | | | | | | | |
| | Yes ☑ | No ☐ | Not Able to Determine at this Time ☐ | If "Yes", complete and submit the Upset / Breakdown Checklist Form with Part I | | | | |
| 13. **Submitted By** | **Tony Johnson** | | | **Telephone** | **(916) 746 - 1656** | | | |
| **Signature** | Tony Johnson | **Date** 5-23-23 | **Time** 13:00 | ☐ AM ☑ PM | | | | |

# NON-COMPLIANCE EVENT NOTIFICATION FORM – PART II

**submit within 7 calendar days after end of the Non-Compliance Event**

| | | | | | |
|---|---|---|---|---|---|
| 14. **End of Non-Compliance Event** | **Date** 5-22-23 | **Time** 16:00 | ☐ AM ☑ PM | | |
| 15. **Duration of Non-Compliance Event** | **Hours** 1 | **Minutes** 20 | | | |
| 16. **Excess Emissions Estimates** | NOx | SOx | PM | | |
| VOC | CO 334.6 lbs. | Opacity | %, for minutes | Other | |
| 17. **Variance in Effect** | Yes ☐ | Variance # | No ☑ | | |
| 18. **Corrective and Preventative Actions Taken (a) Minimize Emissions (b) Correct Event (c) Prevent Future Events** ☑ additional information attached | | | | | |
| 19. **If Not Able to Determine in Item 12 of Part I, Was the Non-Compliance Event an Emission Violation or Monitoring Equipment Failure or Malfunction If yes, do you Request that the Violation, Failure or Malfunction be Shielded from Enforcement Action as an Upset / Breakdown Under District Rule 404** | | | | | |
| Yes ☑ | No ☐ | If "Yes", complete and submit the Upset / Breakdown Checklist Form if not previously submitted with Part I | | | |
| 20. **Submitted By** | **Tony Johnson** | | **Telephone** | **(916) 746 - 1656** | |
| I certify under penalty of law that I am the responsible official for this facility, or his/her duly designated representative, and based on information and belief formed after reasonable inquiry, the statements and information in this document are true, accurate, and complete. | | | | | |
| **Signature** | Tony Johnson | **Date** 5-23-23 | **Time** 13:00 | ☐ AM ☑ PM | |

Year 2023 - 009
Non-Compliance Event Number

# UPSET / BREAKDOWN AND EMERGENCY CHECKLIST

| | | | | | |
|---|---|---|---|---|---|
| **Company Name** | Roseville Energy Park | | **Address** | 5120 Phillip Road | |
| **Detection of Non-Compliance Event** | **Date** | 5-22-23 | **Time** | 16:00 | ☐ AM ☐ PM |

Complete the following questions associated with determining whether an event is an "Upset/Breakdown" Event pursuant to Rule 404, and/or an "Emergency" Event pursuant to Rule 507. To be considered as a legitimate Upset / Breakdown or Emergency event, all of the checklist questions must be answered with a "Yes" checkmark.

| Yes | No | | |
|---|---|---|---|
| ☑ | ☐ | 1. | Equipment associated with the breakdown event have been designed, maintained, and operated in a manner consistent with minimizing emissions. |
| ☑ | ☐ | 2. | The amount and duration of emissions as a result of the event have been minimized. |
| ☑ | ☐ | 3. | The event is not part of a recurring pattern of previous breakdowns of the same equipment for same/similar reasons that are indicative of inadequate equipment design, operation, or maintenance. |
| ☑ | ☐ | 4. | The event is not the result of operator error, negligence, carelessness, or willful misconduct (i.e., the facility is being properly operated). |
| ☑ | ☐ | 5. | The event is not the result of improper equipment design. |
| ☑ | ☐ | 6. | The event is not the result of improper preventative maintenance of equipment. |
| ☑ | ☐ | 7. | The event is the result of a sudden, unavoidable breakdown of equipment, beyond the control of the operator. |
| ☑ | ☐ | 8. | The event could not have been foreseen or avoided or planned for, and could not have been avoided or prevented by better operating and maintenance practices. |
| ☑ | ☐ | 9. | The event has not resulted in a nuisance. |
| ☑ | ☐ | 10. | The event is not the result of the disregard of air pollution rules or regulations. |
| ☑ | ☐ | 11. | This Upset / Breakdown form has been completed and submitted to the District in a timely manner -- within 7 calendar days from the end of the Non-Compliance Event. |
| ☑ | ☐ | 12. | Immediate corrective actions have been taken to minimize emissions, as described in Item 11 on the Part I Non-Compliance Event Notification Form. |

I certify under penalty of law that I am the responsible official for this facility, or his/her duly designated representative, and based on information and belief formed after reasonable inquiry, the statements and information in this document are true, accurate, and complete.

Signature Tony Johns

You are requesting that the District not take enforcement action because the Non-Compliance Event is the result of an "Upset / Breakdown" Event under District Rule 404. A breakdown condition means an unforeseeable failure or malfunction of 1) any air pollution control equipment or related operating equipment which causes a violation of any emission limitations or restriction prescribed by the District Rules and Regulations, or by State law, or 2) any in-stack continuous monitoring equipment, where such failure or malfunction: (1) is not the result of neglect or disregard of any air pollution control law or rule or regulation; (2) is not intentional or the result of negligence; (3) is not the result of improper maintenance; (4) does not constitute a nuisance; (5) is not a recurrent breakdown of the same equipment. You have the burden of providing sufficient information to demonstrate that the Upset / Breakdown was an unforeseeable equipment failure or malfunction that meets the above listed criteria. This checklist must be completed and returned to the District with either the Part 1 or Part II Non-Compliance Event Notification form to attest to your having made this determination. Submission of a request for shielding from enforcement action does not by itself confer such a shield. If breakdown or emission exceeding operations continue after the breakdown or emission exceedance is identified, the possibility exists that the District after consideration of the information provided, the timeliness and completeness of the submittals, and a comparison to other like breakdowns, may ultimately determine that the Non-Compliance Event was not the result of a legitimate Upset / Breakdown event and may elect to take enforcement action. Action to return to compliance should be accomplished as expeditiously as possible. Thus, you are advised to: (1) assure that the breakdown meets the criteria for an unforeseeable failure or malfunction; (2) minimize emissions resulting from the event to the maximum degree possible; and (3) assure that the required failure and malfunction information and information on the corrective actions taken is provided to the District in a complete and timely manner.

Roseville Electric
**Roseville Energy Park**
5120 Phillip Road
Roseville, California 95747

Tony Johnson
Operations and Maintenance Supervisor
Roseville Energy Park
5120 Phillip Road
Roseville, California 95747

Subject: Non-Compliance Event notification form 2023-009

To Whom It May Concern:

This memo is to provide additional information for Non-Compliance Event Notification form 2023-009.

On May 22nd, 2023, at approximately 15:00, Roseville Electric staff performed a start of Combustion Turbine #1 (CT1) to commission it after an extensive maintenance outage in which the exhaust end of the CT was repaired. As the turbine rolled up to operating speed, elevated gas levels were detected inside the turbine building by monitoring instruments. The CT was held at synch speed while Siemens and Roseville technicians entered the building with handheld gas detectors to find and remedy the leak. A few fittings had vibrated loose and were tightened by staff and gas levels improved. It is normal to try to find the leak while the gas is flowing to verify the effectiveness of the repair.

After seeing improvement in the gas detection level, (see attached trend) the decision was made to go ahead and synchronize the CT to continue with the commissioning on the repaired turbine. At approximately 16:00 the CT synchronized and ramped up in load to 20 megawatts and held for about 40 minutes when gas detection levels increased again. Technicians went into the turbine building again and found a loose fitting on the underside of the turbine. While attempting to tighten the fitting on the leaking valve the gas tubing liberated and disconnected, at which time staff pushed in the Emergency Stop button. This action tripped the turbine to an immediate halt at approximately 16:50. The attempted commissioning run of the CT resulted in excess emissions of CO pounds during startup; condition #51 of Operating Permit #REPR-20-1.

Siemens and Roseville staff reviewed all the gas fittings for tightness and attempted a start today at 13:00 and the unit is currently online with low gas level detection.

Let me know if you have any questions.

Sincerely,

Tony Johnson

(916) 746-1656 • *Fax* (916) 746-1655 • ajohnson@roseville.ca.us

# CO LbPerHr SUSD 1-Hour Block Excess Emissions

## CT1

**From:** 05/22/2023 00:00 **To:** 05/22/2023 23:59 **Facility Name:** ROSEVILLE ENERGY
**Generated:** 05/23/2023 09:03 **Location:** Roseville, CA

**Tag Name:** CT1_CO_SUSD_LbPerHr_1H
**Total Operating Time:** 2.00 Hour(s)
Non-Operating Time: 22.00 Hour(s) Report Time: 24.00 Hour(s)

**No Exclusions Allowed**

| Inc No | Start Time | End Time | Duration in Hour(s) | Tag Value | Limit | Reason Code | Action Code |
|---|---|---|---|---|---|---|---|
| 1 | 05/22/23 15:00 | 05/22/23 15:59 | 1 | 334.6 | 89.5 | 19 - COMMISSIONING | 3 - RETURN TO NORMAL OPERATIONS |

| | |
|---|---|
| **Total Operating Time:** | **2.00 Hour(s)** |
| **Total Duration (Online only):** | **1.00 Hour(s)** |
| **Time in exceedance as a percentage of operating time:** | **50.00 %** |
| **Time in compliance as a percentage of operating time:** | **50.00 %** |

| Report Code | Type | Text | Duration | Duration Percent |
|---|---|---|---|---|
| 19 | Reason | COMMISSIONING | 1 | 100.00 |
| 3 | Action | RETURN TO NORMAL OPERATIONS | 1 | 100.00 |

# SUSD REP CT1 5-22-23

| | CT1_CO_SUSD_Lbs_1M_None | | | CT1_Load_CT_MWe_1M | | | CT1_SUSD_TF_1M | | | CT1_NOx_SUSD_Lbs_1M | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** |
| **Value** | | | | | | | | | | | | |
| 05/22/23 15:10 | 0 | | | 0 | | | 0 | | | 0 | | |
| 05/22/23 15:11 | 0 | | | 0 | | | 0 | | | 0 | | |
| 05/22/23 15:12 | 0 | | | 0 | | | 0 | | | 0 | | |
| 05/22/23 15:13 | 0 | | | 0 | | | 0 | | | 0 | | |
| 05/22/23 15:14 | 0 | | | 0 | | | 0 | | | 0 | | |
| 05/22/23 15:15 | 0 | | | 0 | | | 0 | | | 0 | | |
| 05/22/23 15:16 | 0 | | | 0 | | | 0 | | | 0 | | |
| 05/22/23 15:17 | 0 | | | 0 | | | 0 | | | 0 | | |
| 05/22/23 15:18 | 0 | | | 0 | | | 0 | | | 0 | | |
| 05/22/23 15:19 | 0 | | | 0 | | | 0 | | | 0 | | |
| 05/22/23 15:20 | 0 | | | 0 | | | 0 | | | 0 | | |
| 05/22/23 15:21 | 0 | | | 0 | | | 0 | | | 0 | | |
| 05/22/23 15:22 | 0 | | | 0 | | | 1 | | | 0 | | |
| 05/22/23 15:23 | 0 | | | 0 | | | 1 | | | 0 | | |
| 05/22/23 15:24 | 0 | | | 0 | | | 1 | | | 0 | | |
| 05/22/23 15:25 | 2.57 | | | 0 | | | 1 | | | 0.05 | | |
| 05/22/23 15:26 | 5.03 | | | 0 | | | 1 | | | 0.12 | | |
| 05/22/23 15:27 | 6.44 | | | 0 | | | 1 | | | 0.23 | | |
| 05/22/23 15:28 | 7.4 | | | 0 | | | 1 | | | 0.42 | | |
| 05/22/23 15:29 | 8 | | | 0 | | | 1 | | | 0.82 | | |
| 05/22/23 15:30 | 8.36 | | | 0 | | | 1 | | | 1.36 | | |
| 05/22/23 15:31 | 16.2 | | | 0 | | | 1 | | | 1.75 | | |
| 05/22/23 15:32 | 27.14 | | | 0 | | | 1 | | | 2.13 | | |
| 05/22/23 15:33 | 38.34 | | | 0 | | | 1 | | | 2.53 | | |
| 05/22/23 15:34 | 49.55 | | | 0 | | | 1 | | | 2.95 | | |
| 05/22/23 15:35 | 60.65 | | | 0 | | | 1 | | | 3.41 | | |
| 05/22/23 15:36 | 71.78 | | | 0 | | | 1 | | | 3.93 | | |
| 05/22/23 15:37 | 83.21 | | | 0 | | | 1 | | | 4.5 | | |
| 05/22/23 15:38 | 94.64 | | | 0 | | | 1 | | | 5.07 | | |
| 05/22/23 15:39 | 106.09 | | | 0 | | | 1 | | | 5.64 | | |
| 05/22/23 15:40 | 117.44 | | | 0 | | | 1 | | | 6.19 | | |
| 05/22/23 15:41 | 128.84 | | | 0 | | | 1 | | | 6.73 | | |

| | CT1_CO_SUSD_Lbs_1M_None | | | CT1_Load_CT_MWe_1M | | | CT1_SUSD_TF_1M | | | CT1_NOx_SUSD_Lbs_1M | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim Value** | **Value** | **SI** | **Mod Value** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** |
| 05/22/23 15:42 | 140.17 | | | 0 | | | 1 | | | 7.26 | | |
| 05/22/23 15:43 | 151.5 | | | 0 | | | 1 | | | 7.79 | | |
| 05/22/23 15:44 | 162.82 | | | 0 | | | 1 | | | 8.31 | | |
| 05/22/23 15:45 | 174.09 | | | 0 | | | 1 | | | 8.82 | | |
| 05/22/23 15:46 | 185.43 | | | 0 | | | 1 | | | 9.32 | | |
| 05/22/23 15:47 | 196.71 | | | 0 | | | 1 | | | 9.81 | | |
| 05/22/23 15:48 | 208.02 | | | 0 | | | 1 | | | 10.3 | | |
| 05/22/23 15:49 | 219.25 | | | 0 | | | 1 | | | 10.78 | | |
| 05/22/23 15:50 | 230.52 | | | 0 | | | 1 | | | 11.25 | | |
| 05/22/23 15:51 | 241.72 | | | 0 | | | 1 | | | 11.71 | | |
| 05/22/23 15:52 | 253.38 | | | 0 | | | 1 | | | 12.18 | | |
| 05/22/23 15:53 | 264.99 | | | 0 | | | 1 | | | 12.64 | | |
| 05/22/23 15:54 | 276.64 | | | 0 | | | 1 | | | 13.1 | | |
| 05/22/23 15:55 | 288.25 | | | 0 | | | 1 | | | 13.55 | | |
| 05/22/23 15:56 | 299.82 | | | 0 | | | 1 | | | 14 | | |
| 05/22/23 15:57 | 311.46 | | | 0 | | | 1 | | | 14.45 | | |
| 05/22/23 15:58 | 323.05 | | | 0 | | | 1 | | | 14.89 | | |
| 05/22/23 15:59 | 334.59 | | | 0 | | | 1 | | | 15.32 | | |
| 05/22/23 16:00 | 346.18 | | | 0 | | | 1 | | | 15.75 | | |
| 05/22/23 16:01 | 357.77 | | | 0 | | | 1 | | | 16.17 | | |
| 05/22/23 16:02 | 369.31 | | | 0 | | | 1 | | | 16.59 | | |
| 05/22/23 16:03 | 384.26 | | | 6 | | | 1 | | | 17.13 | | |
| 05/22/23 16:04 | 394.2 | | | 8.2 | | | 1 | | | 17.82 | | |
| 05/22/23 16:05 | 395.49 | | | 9.8 | | | 1 | | | 18.45 | | |
| 05/22/23 16:06 | 395.67 | | | 10 | | | 1 | | | 19.03 | | |
| 05/22/23 16:07 | 395.75 | | | 10 | | | 1 | | | 19.61 | | |
| 05/22/23 16:08 | 395.82 | | | 10 | | | 1 | | | 20.2 | | |
| 05/22/23 16:09 | 395.89 | | | 10 | | | 1 | | | 20.79 | | |
| 05/22/23 16:10 | 395.96 | | | 10 | | | 1 | | | 21.37 | | |
| 05/22/23 16:11 | 396.02 | | | 10 | | | 1 | | | 21.96 | | |
| 05/22/23 16:12 | 396.08 | | | 10 | | | 1 | | | 22.55 | | |
| 05/22/23 16:13 | 396.14 | | | 10 | | | 1 | | | 23.15 | | |
| 05/22/23 16:14 | 396.2 | | | 10 | | | 1 | | | 23.76 | | |
| 05/22/23 16:15 | 396.26 | | | 10 | | | 1 | | | 24.37 | | |

| | CT1_CO_SUSD_Lbs_1M _None | | | CT1_Load_CT_MWe_1M | | | CT1_SUSD_TF_1M | | | CT1_NOx_SUSD_Lbs_1M | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim Value** | **Value** | **SI** | **Mod Value** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** |
| 05/22/23 16:16 | 396.32 | | | 10 | | | 1 | | | 25 | | |
| 05/22/23 16:17 | 396.38 | | | 10.4 | | | 1 | | | 25.65 | | |
| 05/22/23 16:18 | 396.44 | | | 12.8 | | | 1 | | | 26.4 | | |
| 05/22/23 16:19 | 396.49 | | | 15.7 | | | 1 | | | 27.28 | | |
| 05/22/23 16:20 | 396.53 | | | 18.8 | | | 1 | | | 28.1 | | |
| 05/22/23 16:21 | 396.56 | | | 19.9 | | | 1 | | | 28.45 | | |
| 05/22/23 16:22 | 396.6 | | | 20 | | | 1 | | | 28.68 | | |
| 05/22/23 16:23 | 396.65 | | | 20 | | | 1 | | | 28.92 | | |
| 05/22/23 16:24 | 396.71 | | | 20 | | | 1 | | | 29.17 | | |
| 05/22/23 16:25 | 396.76 | | | 20 | | | 1 | | | 29.37 | | |
| 05/22/23 16:26 | 396.8 | | | 20 | | | 1 | | | 29.54 | | |
| 05/22/23 16:27 | 396.84 | | | 20 | | | 1 | | | 29.65 | | |
| 05/22/23 16:28 | 396.88 | | | 20 | | | 1 | | | 29.74 | | |
| 05/22/23 16:29 | 396.92 | | | 20 | | | 1 | | | 29.84 | | |
| 05/22/23 16:30 | 396.96 | | | 20 | | | 1 | | | 29.96 | | |
| 05/22/23 16:31 | 397 | | | 20 | | | 1 | | | 30.07 | | |
| 05/22/23 16:32 | 397.04 | | | 20 | | | 1 | | | 30.11 | | |
| 05/22/23 16:33 | 397.08 | | | 20 | | | 1 | | | 30.14 | | |
| 05/22/23 16:34 | 397.12 | | | 20 | | | 1 | | | 30.18 | | |
| 05/22/23 16:35 | 397.16 | | | 20 | | | 1 | | | 30.23 | | |
| 05/22/23 16:36 | 397.2 | | | 20 | | | 1 | | | 30.29 | | |
| 05/22/23 16:37 | 397.24 | | | 20 | | | 1 | | | 30.33 | | |
| 05/22/23 16:38 | 397.28 | | | 20 | | | 1 | | | 30.37 | | |
| 05/22/23 16:39 | 397.32 | | | 20 | | | 1 | | | 30.41 | | |
| 05/22/23 16:40 | 397.36 | | | 20 | | | 1 | | | 30.44 | | |
| 05/22/23 16:41 | 397.4 | | | 20 | | | 1 | | | 30.46 | | |
| 05/22/23 16:42 | 397.44 | | | 20 | | | 1 | | | 30.48 | | |
| 05/22/23 16:43 | 0 | | | 20 | | | 0 | | | 0 | | |
| 05/22/23 16:44 | 0 | | | 20 | | | 0 | | | 0 | | |
| 05/22/23 16:45 | 0 | | | 20 | | | 0 | | | 0 | | |
| 05/22/23 16:46 | 0 | | | 20 | | | 0 | | | 0 | | |
| 05/22/23 16:47 | 0 | | | 20 | | | 0 | | | 0 | | |
| 05/22/23 16:48 | 0 | | | 20 | | | 0 | | | 0 | | |
| 05/22/23 16:49 | 0 | | | 20 | | | 0 | | | 0 | | |

| | CT1_CO_SUSD_Lbs_1M_None | | | CT1_Load_CT_MWe_1M | | | CT1_SUSD_TF_1M | | | CT1_NOx_SUSD_Lbs_1M | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** |
| **Value** | | | | | | | | | | | | |
| 05/22/23 16:50 | 0 | | | 20 | | | 0 | | | 0 | | |
| 05/22/23 16:51 | 0.02 | | | 9.1 | | | 1 | | | 0.01 | | |
| 05/22/23 16:52 | 0 | | | 0 | | | 0 | | | 0 | | |
| 05/22/23 16:53 | 0 | | | 0 | | | 0 | | | 0 | | |
| 05/22/23 16:54 | 0 | | | 0 | | | 0 | | | 0 | | |
| 05/22/23 16:55 | 0 | | | 0 | | | 0 | | | 0 | | |
| 05/22/23 16:56 | 0 | | | 0 | | | 0 | | | 0 | | |
| 05/22/23 16:57 | 0 | | | 0 | | | 0 | | | 0 | | |
| 05/22/23 16:58 | 0 | | | 0 | | | 0 | | | 0 | | |
| 05/22/23 16:59 | 0 | | | 0 | | | 0 | | | 0 | | |
| 05/22/23 17:00 | 0 | | | 0 | | | 0 | | | 0 | | |

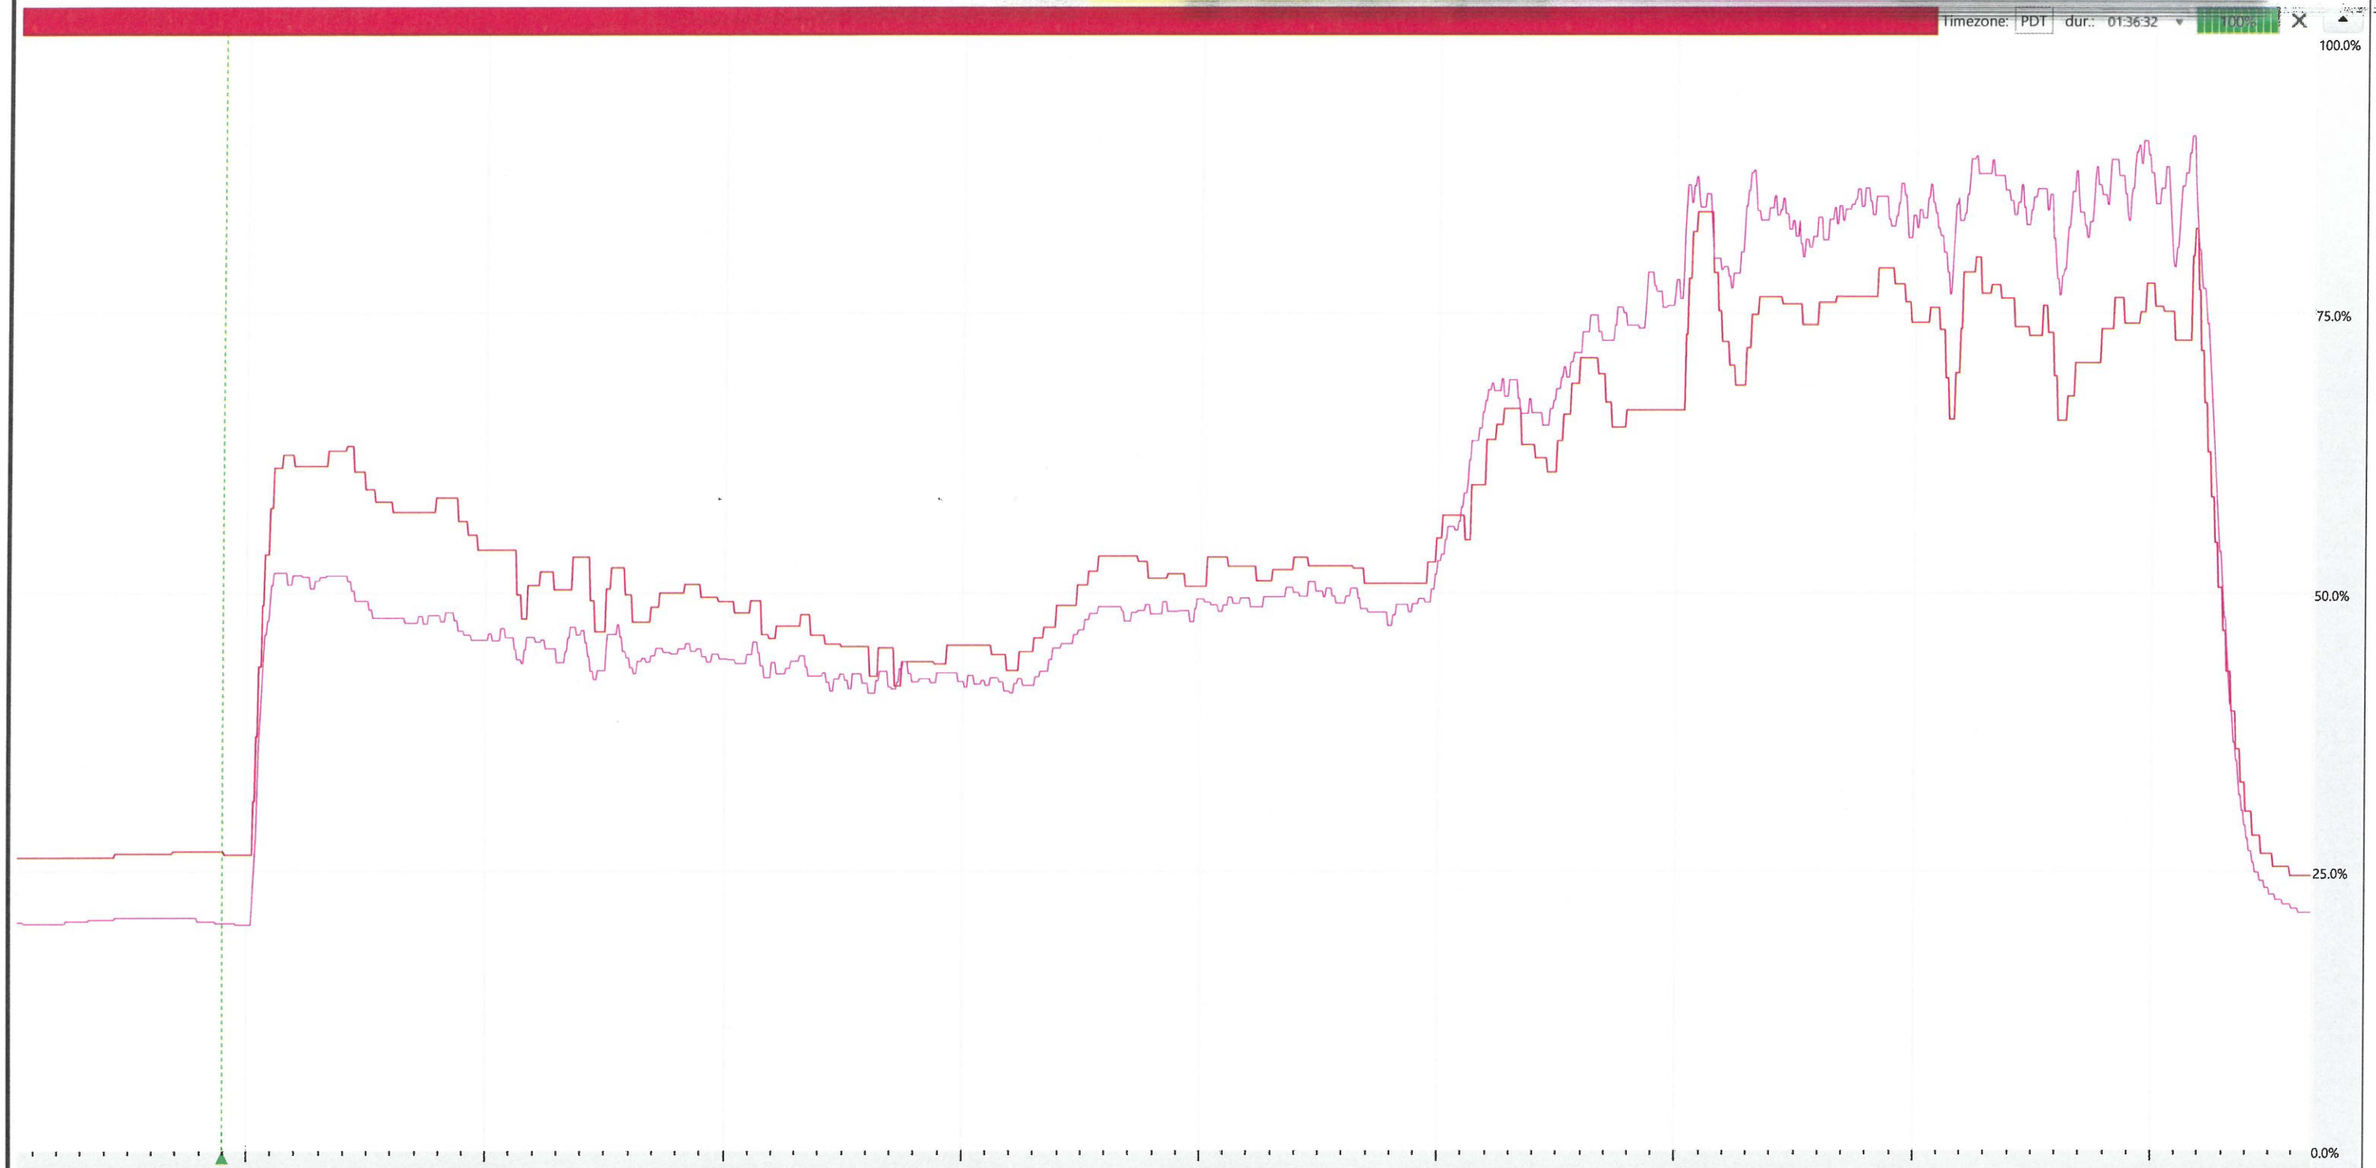


| SIGNAL TAG | DESIGNATION | RANGE LOW | RANGE HI | CURSOR 1 | CURSOR 2 | Y DIFF | UNIT | LAST |
|---|---|---|---|---|---|---|---|---|
| A1SFY10CQ005\|\|XQ01 | Gas Detection | 0.0000 | 5.0000 | 1.3405 | | | % LEL | 1.2311 |
| A1SFY10CO020IIXO01 | Gas Detection | 0.0000 | 5.0000 | 1.0199 | | | % LEL | 1.0666 |

| | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|
| Rev 1 | RFT | 16/12/20 | MN | Date | 16/11/30 | | | = | A1_01 UNIT OPERATION |
| | | | | Drawn By | | | | + | |
| | | | | Checked By | | | | | Page 1 |
| State | Change | Date | Editor | Standard | | | | | Pg. 1 |

SIEMENS energy

01 Unit Operation

Trend Display A1SFY10CQ005|XQ01

en

Siemens Energy is a trademark licensed by Siemens AG.

© 2020 Siemens Energy Global GmbH & Co. KG · All Rights Reserved

2023/05/23 01:24:29 PM

**ATTACHMENT 8**

# AQ-37

**AQ-37** Any Violation of any emission standard listed in this permit which is indicated by the CEMS shall be reported to the PCAPCD no later than 96 hours after such occurrence as per California Health and Safety Code 42706

**Verification:** The Project owner shall include all violations of emissions standards and corresponding PCAPCD notifications in the Quarterly Air Quality Report required by the Condition of Certification AQ-SC6

All Notices of Non Compliance are included in AQ-41.

**ATTACHMENT 9**

# AQ-40

**AQ-40** The Project owner shall comply with the applicable requirements for quality assurance testing and maintenance of the continuous emission monitor equipment in accordance with the procedures and guidance specified in 40 CFR Part 60, Appendix F.

**Verification:** The Project owner shall include all CEMS quality assurance test failures that required corrective action as part of the Quarterly Air Quality Report required by the Condition of Certification AQ-SC6

# Cylinder Gas Audit



| | | | | | |
|---|---|---|---|---|---|
| Facility: | ROSEVILLE ENERGY | | | Instrument | CT1_CODualRg_P_Instr |
| Unit/Stack: | CT1 | Test Date: | 06/21/2023 | Performance | 15 Pct |
| Parameter/Scal | CO / Low | Test | **Pass** | Alternate Spec: | 5 Ppm |

| Date | Time | Test Level | Span Value | Reference | Measured Value | Ref Value As Pct Span |
|---|---|---|---|---|---|---|
| 06/21/2023 | 12:57 | L | 10 | 2.400 | 2.100 | 24.0 % |
| 06/21/2023 | 13:02 | M | 10 | 5.700 | 5.500 | 57.0 % |
| 06/21/2023 | 13:09 | L | 10 | 2.400 | 2.100 | 24.0 % |
| 06/21/2023 | 13:14 | M | 10 | 5.700 | 5.500 | 57.0 % |
| 06/21/2023 | 13:21 | L | 10 | 2.400 | 2.200 | 24.0 % |
| 06/21/2023 | 13:26 | M | 10 | 5.700 | 5.500 | 57.0 % |

**Summary**

| Cal Gas Level | Reference | Mean | CEMS Mean | Specification | Results |
|---|---|---|---|---|---|
| L | 2.400 | | 2.133 | Std | **11.1** |
| M | 5.700 | | 5.500 | Std | **3.5** |

# Cylinder Gas Audit



| | | | | | |
|---|---|---|---|---|---|
| Facility: | ROSEVILLE ENERGY | | | Instrument | CT1_CODualRg_P_Instr |
| Unit/Stack: | CT1 | Test Date: | 06/21/2023 | Performance | 15 Pct |
| Parameter/Scal | CO / High | Test | **Pass** | Alternate Spec: | 5 Ppm |

| Date | Time | Test Level | Span Value | Reference | Measured Value | Ref Value As Pct Span |
|---|---|---|---|---|---|---|

| | | | | | | |
|---|---|---|---|---|---|---|
| 06/21/2023 | 13:54 | L | 200 | 49.800 | 45.100 | 24.9 % |
| 06/21/2023 | 13:59 | M | 200 | 109.200 | 106.000 | 54.6 % |
| 06/21/2023 | 14:11 | L | 200 | 49.800 | 45.300 | 24.9 % |
| 06/21/2023 | 14:16 | M | 200 | 109.200 | 106.000 | 54.6 % |
| 06/21/2023 | 14:28 | L | 200 | 49.800 | 45.100 | 24.9 % |
| 06/21/2023 | 14:33 | M | 200 | 109.200 | 106.000 | 54.6 % |

**Summary**

| Cal Gas Level | Reference Mean | CEMS Mean | Specification | Results |
|---|---|---|---|---|
| L | 49.800 | 45.167 | Std | **9.3** |
| M | 109.200 | 106.000 | Std | **2.9** |

# Cylinder Gas Audit



Facility: ROSEVILLE ENERGY
Unit/Stack: CT2
Parameter/Scal: CO / High
Test Date: 06/21/2023
Test **Pass**
Instrument: CT2_CODualRg_P_Instr
Performance: 15 Pct
Alternate Spec: 5 Ppm

| Date | Time | Test Level | Span Value | Reference | Measured Value | Ref Value As Pct Span |
|---|---|---|---|---|---|---|
| 06/21/2023 | 14:20 | L | 200 | 49.700 | 50.300 | 24.9 % |
| 06/21/2023 | 14:25 | M | 200 | 109.100 | 113.800 | 54.6 % |
| 06/21/2023 | 14:38 | L | 200 | 49.700 | 50.300 | 24.9 % |
| 06/21/2023 | 14:43 | M | 200 | 109.100 | 114.000 | 54.6 % |
| 06/21/2023 | 14:55 | L | 200 | 49.700 | 50.400 | 24.9 % |
| 06/21/2023 | 15:00 | M | 200 | 109.100 | 114.200 | 54.6 % |

**Summary**

| Cal Gas Level | Reference Mean | CEMS Mean | Specification | Results |
|---|---|---|---|---|
| L | 49.700 | 50.333 | Std | **1.3** |
| M | 109.100 | 114.000 | Std | **4.5** |

# Cylinder Gas Audit



Facility: ROSEVILLE ENERGY
Unit/Stack: CT2
Parameter/Scal CO / Low
Test Date: 06/21/2023
Test **Pass**
Instrument CT2_CODualRg_P_Instr
Performance 15 Pct
Alternate Spec: 5 Ppm

| Date | Time | Test Level | Span Value | Reference | Measured Value | Ref Value As Pct Span |
|---|---|---|---|---|---|---|
| 06/21/2023 | 15:22 | L | 10 | 2.400 | 2.400 | 24.0 % |
| 06/21/2023 | 15:27 | M | 10 | 5.700 | 5.800 | 57.0 % |
| 06/21/2023 | 15:34 | L | 10 | 2.400 | 2.300 | 24.0 % |
| 06/21/2023 | 15:39 | M | 10 | 5.700 | 5.900 | 57.0 % |
| 06/21/2023 | 15:46 | L | 10 | 2.400 | 2.400 | 24.0 % |
| 06/21/2023 | 15:51 | M | 10 | 5.700 | 5.900 | 57.0 % |

**Summary**

| Cal Gas Level | Reference Mean | CEMS Mean | Specification | Results |
|---|---|---|---|---|
| L | 2.400 | 2.367 | Std | **1.4** |
| M | 5.700 | 5.867 | Std | **2.9** |

**ATTACHMENT 10**

# AQ-41

**AQ-41**The Project owner shall submit a written report to the APCO and the CPM for each calendar quarter, within 30 days of the end of the quarter, including: time intervals, data and magnitude of excess emissions, nature and cause of excess (if known), corrective actions taken and preventive measures adopted; averaging period used for data reporting shall correspond to the averaging period for each respective emission standard; applicable time and date of each period during which the CEMS was inoperative (except for zero and span checks) and the nature of the system repairs and adjustments; and a negative declaration when no excess emission occurred.

**Verification:** The Project owner shall include the excess emission report as part of the Quarterly Air Quality Report required in Condition of Certification AQ-SC6

# Excess Emission Report

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY
**Generated:** 07/07/2023 23:18 **Location:** Roseville, CA

---

**Tag Name:** ALL_CO_Lb_1D
**Total Operating Time:** 5.00 Day(s) **No Exclusions Allowed**
Non-Operating Time: 86.00 Day(s) Report Time: 91.00 Day(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

| | |
|---|---|
| **Total Operating Time:** | **5.00 Day(s)** |
| **Total Duration (Online only):** | **0.00 Day(s)** |
| **Time in exceedance as a percentage of operating time:** | **0.00 %** |
| **Time in compliance as a percentage of operating time:** | **100.00 %** |

# Excess Emission Report

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY
**Generated:** 07/07/2023 23:19 **Location:** Roseville, CA

---

**Tag Name:** ALL_NOx_Lb_1D
**Total Operating Time:** 5.00 Day(s) **No Exclusions Allowed**
Non-Operating Time: 86.00 Day(s) Report Time: 91.00 Day(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

| | |
|---|---|
| **Total Operating Time:** | **5.00 Day(s)** |
| **Total Duration (Online only):** | **0.00 Day(s)** |
| **Time in exceedance as a percentage of operating time:** | **0.00 %** |
| **Time in compliance as a percentage of operating time:** | **100.00 %** |

# Excess Emission Report

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY
**Generated:** 07/07/2023 23:19 **Location:** Roseville, CA

---

**Tag Name:** ALL_PM10_Lb_1D
**Total Operating Time:** 5.00 Day(s) **No Exclusions Allowed**
Non-Operating Time: 86.00 Day(s) Report Time: 91.00 Day(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

| | |
|---|---|
| **Total Operating Time:** | **5.00 Day(s)** |
| **Total Duration (Online only):** | **0.00 Day(s)** |
| **Time in exceedance as a percentage of operating time:** | **0.00 %** |
| **Time in compliance as a percentage of operating time:** | **100.00 %** |

# Excess Emission Report

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY
**Generated:** 07/07/2023 23:20 **Location:** Roseville, CA

---

**Tag Name:** ALL_SO2_Lb_1D
**Total Operating Time:** 5.00 Day(s) **No Exclusions Allowed**
Non-Operating Time: 86.00 Day(s) Report Time: 91.00 Day(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

| | |
|---|---|
| **Total Operating Time:** | **5.00 Day(s)** |
| **Total Duration (Online only):** | **0.00 Day(s)** |
| **Time in exceedance as a percentage of operating time:** | **0.00 %** |
| **Time in compliance as a percentage of operating time:** | **100.00 %** |

# Excess Emission Report

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY
**Generated:** 07/07/2023 23:21 **Location:** Roseville, CA

---

**Tag Name:** ALL_VOC_Lb_1D
**Total Operating Time:** 5.00 Day(s) **No Exclusions Allowed**
Non-Operating Time: 86.00 Day(s) Report Time: 91.00 Day(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

| | |
|---|---|
| **Total Operating Time:** | **5.00 Day(s)** |
| **Total Duration (Online only):** | **0.00 Day(s)** |
| **Time in exceedance as a percentage of operating time:** | **0.00 %** |
| **Time in compliance as a percentage of operating time:** | **100.00 %** |

# CO LbPerHr 3-Hour Rolling Excess Emissions

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY
**Generated:** 07/07/2023 23:23 **Location:** Roseville, CA

---

**Tag Name:** CT1_CO_3Hr_LbPerHr_1H
**Total Operating Time:** 56.00 Hour(s) **No Exclusions Allowed**
Non-Operating Time: 2,128.00 Hour(s) Report Time: 2,184.00 Hour(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

| | |
|---|---|
| **Total Operating Time:** | **56.00 Hour(s)** |
| **Total Duration (Online only):** | **0.00 Hour(s)** |
| **Time in exceedance as a percentage of operating time:** | **0.00 %** |
| **Time in compliance as a percentage of operating time:** | **100.00 %** |

# CO Ppmvdc 3-Hour Block Excess Emissions

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY
**Generated:** 07/07/2023 23:23 **Location:** Roseville, CA

---

**Tag Name:** CT1_CO_Ppmvdc_3H
**Total Operating Time:** 56.00 Hour(s) **No Exclusions Allowed**
Non-Operating Time: 2,128.00 Hour(s) Report Time: 2,184.00 Hour(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

| | |
|---|---|
| **Total Operating Time:** | **56.00 Hour(s)** |
| **Total Duration (Online only):** | **0.00 Hour(s)** |
| **Time in exceedance as a percentage of operating time:** | **0.00 %** |
| **Time in compliance as a percentage of operating time:** | **100.00 %** |

# CO LbPerHr SUSD 1-Hour Block Excess Emissions

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY
**Generated:** 07/07/2023 23:24 **Location:** Roseville, CA

**Tag Name:** CT1_CO_SUSD_LbPerHr_1H
**Total Operating Time:** 56.00 Hour(s) **No Exclusions Allowed**
Non-Operating Time: 2,128.00 Hour(s) Report Time: 2,184.00 Hour(s)

| Inc No | Start Time | End Time | Duration in Hour(s) | Tag Value | Limit | Reason Code | Action Code |
|---|---|---|---|---|---|---|---|
| 1 | 05/22/23 15:00 | 05/22/23 15:59 | 1 | 334.6 | 89.5 | 19 - COMMISSIONING | 3 - RETURN TO NORMAL OPERATIONS |

| | |
|---|---|
| **Total Operating Time:** | **56.00 Hour(s)** |
| **Total Duration (Online only):** | **1.00 Hour(s)** |
| **Time in exceedance as a percentage of operating time:** | **1.79 %** |
| **Time in compliance as a percentage of operating time:** | **98.21 %** |

| Report Code | Type | Text | Duration | Duration Percent |
|---|---|---|---|---|
| 19 | Reason | COMMISSIONING | 1 | 100.00 |
| 3 | Action | RETURN TO NORMAL OPERATIONS | 1 | 100.00 |

# NH3 Slip Ppmvdc 1-Hour Block Excess Emissions

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY
**Generated:** 07/07/2023 23:26 **Location:** Roseville, CA

---

**Tag Name:** CT1_NH3Slip_Ppmvdc_1H
**Total Operating Time:** 56.00 Hour(s) **No Exclusions Allowed**
Non-Operating Time: 2,128.00 Hour(s) Report Time: 2,184.00 Hour(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

| | |
|---|---|
| **Total Operating Time:** | **56.00 Hour(s)** |
| **Total Duration (Online only):** | **0.00 Hour(s)** |
| **Time in exceedance as a percentage of operating time:** | **0.00 %** |
| **Time in compliance as a percentage of operating time:** | **100.00 %** |

# NOx LbPerHr 1-Hour Block Excess Emissions

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY
**Generated:** 07/07/2023 23:26 **Location:** Roseville, CA

---

**Tag Name:** CT1_NOx_Norm_LbPerHr_1H
**Total Operating Time:** 56.00 Hour(s) **No Exclusions Allowed**
Non-Operating Time: 2,128.00 Hour(s) Report Time: 2,184.00 Hour(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

| | |
|---|---|
| **Total Operating Time:** | **56.00 Hour(s)** |
| **Total Duration (Online only):** | **0.00 Hour(s)** |
| **Time in exceedance as a percentage of operating time:** | **0.00 %** |
| **Time in compliance as a percentage of operating time:** | **100.00 %** |

# NOx Ppmvdc 1-Hour Block Excess Emissions

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY
**Generated:** 07/07/2023 23:27 **Location:** Roseville, CA

---

**Tag Name:** CT1_NOx_Ppmvdc_1H
**Total Operating Time:** 56.00 Hour(s) **No Exclusions Allowed**
Non-Operating Time: 2,128.00 Hour(s) Report Time: 2,184.00 Hour(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

| | |
|---|---|
| **Total Operating Time:** | **56.00 Hour(s)** |
| **Total Duration (Online only):** | **0.00 Hour(s)** |
| **Time in exceedance as a percentage of operating time:** | **0.00 %** |
| **Time in compliance as a percentage of operating time:** | **100.00 %** |

# NOx LbPerHr SUSD 1-Hour Block Excess Emissions

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY
**Generated:** 07/07/2023 23:27 **Location:** Roseville, CA

---

**Tag Name:** CT1_NOx_SUSD_LbPerHr_1H
**Total Operating Time:** 56.00 Hour(s) **No Exclusions Allowed**
Non-Operating Time: 2,128.00 Hour(s) Report Time: 2,184.00 Hour(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

| | |
|---|---|
| **Total Operating Time:** | **56.00 Hour(s)** |
| **Total Duration (Online only):** | **0.00 Hour(s)** |
| **Time in exceedance as a percentage of operating time:** | **0.00 %** |
| **Time in compliance as a percentage of operating time:** | **100.00 %** |

# PM10 LbPerHr 1-Hour Block Excess Emissions

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY
**Generated:** 07/07/2023 23:29 **Location:** Roseville, CA

---

**Tag Name:** CT1_PM10_Norm_LbPerHr_1H
**Total Operating Time:** 56.00 Hour(s) **No Exclusions Allowed**
Non-Operating Time: 2,128.00 Hour(s) Report Time: 2,184.00 Hour(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

| | |
|---|---|
| **Total Operating Time:** | **56.00 Hour(s)** |
| **Total Duration (Online only):** | **0.00 Hour(s)** |
| **Time in exceedance as a percentage of operating time:** | **0.00 %** |
| **Time in compliance as a percentage of operating time:** | **100.00 %** |

# SO2 LbPerHr 1-Hour Block Excess Emissions

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY
**Generated:** 07/07/2023 23:30 **Location:** Roseville, CA

---

**Tag Name:** CT1_SO2_Norm_LbPerHr_1H
**Total Operating Time:** 56.00 Hour(s) **No Exclusions Allowed**
Non-Operating Time: 2,128.00 Hour(s) Report Time: 2,184.00 Hour(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

| | |
|---|---|
| **Total Operating Time:** | **56.00 Hour(s)** |
| **Total Duration (Online only):** | **0.00 Hour(s)** |
| **Time in exceedance as a percentage of operating time:** | **0.00 %** |
| **Time in compliance as a percentage of operating time:** | **100.00 %** |

# VOC LbPerHr 1-Hour Block Excess Emissions

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY
**Generated:** 07/07/2023 23:30 **Location:** Roseville, CA

---

**Tag Name:** CT1_VOC_Norm_LbPerHr_1H
**Total Operating Time:** 56.00 Hour(s) **No Exclusions Allowed**
Non-Operating Time: 2,128.00 Hour(s) Report Time: 2,184.00 Hour(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

| | |
|---|---|
| **Total Operating Time:** | **56.00 Hour(s)** |
| **Total Duration (Online only):** | **0.00 Hour(s)** |
| **Time in exceedance as a percentage of operating time:** | **0.00 %** |
| **Time in compliance as a percentage of operating time:** | **100.00 %** |

# CO LbPerHr 3-Hour Rolling Excess Emissions

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY
**Generated:** 07/07/2023 23:31 **Location:** Roseville, CA

---

**Tag Name:** CT2_CO_3Hr_LbPerHr_1H
**Total Operating Time:** 0.00 Hour(s) **No Exclusions Allowed**
Non-Operating Time: 2,184.00 Hour(s) Report Time: 2,184.00 Hour(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

| | |
|---|---|
| **Total Operating Time:** | **0.00 Hour(s)** |
| **Total Duration (Online only):** | **0.00 Hour(s)** |
| **Time in exceedance as a percentage of operating time:** | **0.00 %** |
| **Time in compliance as a percentage of operating time:** | **100.00 %** |

# CO Ppmvdc 3-Hour Block Excess Emissions

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY
**Generated:** 07/07/2023 23:32 **Location:** Roseville, CA

---

**Tag Name:** CT2_CO_Ppmvdc_3H
**Total Operating Time:** 0.00 Hour(s) **No Exclusions Allowed**
Non-Operating Time: 2,184.00 Hour(s) Report Time: 2,184.00 Hour(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

| | |
|---|---|
| **Total Operating Time:** | **0.00 Hour(s)** |
| **Total Duration (Online only):** | **0.00 Hour(s)** |
| **Time in exceedance as a percentage of operating time:** | **0.00 %** |
| **Time in compliance as a percentage of operating time:** | **100.00 %** |

# CO LbPerHr SUSD 1-Hour Block Excess Emissions

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY
**Generated:** 07/07/2023 23:33 **Location:** Roseville, CA

---

**Tag Name:** CT2_CO_SUSD_LbPerHr_1H
**Total Operating Time:** 0.00 Hour(s) **No Exclusions Allowed**
Non-Operating Time: 2,184.00 Hour(s) Report Time: 2,184.00 Hour(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

| | |
|---|---|
| **Total Operating Time:** | **0.00 Hour(s)** |
| **Total Duration (Online only):** | **0.00 Hour(s)** |
| **Time in exceedance as a percentage of operating time:** | **0.00 %** |
| **Time in compliance as a percentage of operating time:** | **100.00 %** |

# NH3 Slip Ppmvdc 1-Hour Block Excess Emissions

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY
**Generated:** 07/07/2023 23:33 **Location:** Roseville, CA

---

**Tag Name:** CT2_NH3Slip_Ppmvdc_1H
**Total Operating Time:** 0.00 Hour(s) **No Exclusions Allowed**
Non-Operating Time: 2,184.00 Hour(s) Report Time: 2,184.00 Hour(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

| | |
|---|---|
| **Total Operating Time:** | **0.00 Hour(s)** |
| **Total Duration (Online only):** | **0.00 Hour(s)** |
| **Time in exceedance as a percentage of operating time:** | **0.00 %** |
| **Time in compliance as a percentage of operating time:** | **100.00 %** |

# NOx LbPerHr 1-Hour Block Excess Emissions

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY
**Generated:** 07/07/2023 23:34 **Location:** Roseville, CA

---

**Tag Name:** CT2_NOx_Norm_LbPerHr_1H
**Total Operating Time:** 0.00 Hour(s) **No Exclusions Allowed**
Non-Operating Time: 2,184.00 Hour(s) Report Time: 2,184.00 Hour(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

| | |
|---|---|
| **Total Operating Time:** | **0.00 Hour(s)** |
| **Total Duration (Online only):** | **0.00 Hour(s)** |
| **Time in exceedance as a percentage of operating time:** | **0.00 %** |
| **Time in compliance as a percentage of operating time:** | **100.00 %** |

# NOx Ppmvdc 1-Hour Block Excess Emissions

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY
**Generated:** 07/07/2023 23:35 **Location:** Roseville, CA

---

**Tag Name:** CT2_NOx_Ppmvdc_1H
**Total Operating Time:** 0.00 Hour(s) **No Exclusions Allowed**
Non-Operating Time: 2,184.00 Hour(s) Report Time: 2,184.00 Hour(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

| | |
|---|---|
| **Total Operating Time:** | **0.00 Hour(s)** |
| **Total Duration (Online only):** | **0.00 Hour(s)** |
| **Time in exceedance as a percentage of operating time:** | **0.00 %** |
| **Time in compliance as a percentage of operating time:** | **100.00 %** |

# NOx LbPerHr SUSD 1-Hour Block Excess Emissions

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY
**Generated:** 07/07/2023 23:35 **Location:** Roseville, CA

---

**Tag Name:** CT2_NOx_SUSD_LbPerHr_1H
**Total Operating Time:** 0.00 Hour(s) **No Exclusions Allowed**
Non-Operating Time: 2,184.00 Hour(s) Report Time: 2,184.00 Hour(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

| | |
|---|---|
| **Total Operating Time:** | **0.00 Hour(s)** |
| **Total Duration (Online only):** | **0.00 Hour(s)** |
| **Time in exceedance as a percentage of operating time:** | **0.00 %** |
| **Time in compliance as a percentage of operating time:** | **100.00 %** |

# PM10 LbPerHr 1-Hour Block Excess Emissions

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY
**Generated:** 07/07/2023 23:36 **Location:** Roseville, CA

---

**Tag Name:** CT2_PM10_Norm_LbPerHr_1H
**Total Operating Time:** 0.00 Hour(s) **No Exclusions Allowed**
Non-Operating Time: 2,184.00 Hour(s) Report Time: 2,184.00 Hour(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

| | |
|---|---|
| **Total Operating Time:** | **0.00 Hour(s)** |
| **Total Duration (Online only):** | **0.00 Hour(s)** |
| **Time in exceedance as a percentage of operating time:** | **0.00 %** |
| **Time in compliance as a percentage of operating time:** | **100.00 %** |

# SO2 LbPerHr 1-Hour Block Excess Emissions

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY
**Generated:** 07/07/2023 23:36 **Location:** Roseville, CA

---

**Tag Name:** CT2_SO2_Norm_LbPerHr_1H
**Total Operating Time:** 0.00 Hour(s) **No Exclusions Allowed**
Non-Operating Time: 2,184.00 Hour(s) Report Time: 2,184.00 Hour(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

| | |
|---|---|
| **Total Operating Time:** | **0.00 Hour(s)** |
| **Total Duration (Online only):** | **0.00 Hour(s)** |
| **Time in exceedance as a percentage of operating time:** | **0.00 %** |
| **Time in compliance as a percentage of operating time:** | **100.00 %** |

# VOC LbPerHr 1-Hour Block Excess Emissions

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY
**Generated:** 07/07/2023 23:37 **Location:** Roseville, CA

---

**Tag Name:** CT2_VOC_Norm_LbPerHr_1H
**Total Operating Time:** 0.00 Hour(s) **No Exclusions Allowed**
Non-Operating Time: 2,184.00 Hour(s) Report Time: 2,184.00 Hour(s)

No incidents have been reported for this reporting period. Data is 100% in compliance.

| | |
|---|---|
| **Total Operating Time:** | **0.00 Hour(s)** |
| **Total Duration (Online only):** | **0.00 Hour(s)** |
| **Time in exceedance as a percentage of operating time:** | **0.00 %** |
| **Time in compliance as a percentage of operating time:** | **100.00 %** |

**ATTACHMENT 11**

# AQ-42

**AQ-42** The Project owner shall provide the PCAPCD and CPM with a written emission statement showing actual emissions of volatile organic compounds and oxides of nitrogen. Pursuant to PCAPCD Rule 503 the Project owner shall submit this emission statement on a form or in a format specified by the Air Pollution Control Officer. The statement shall contain the following information:

a) Information contained in the California Air Resources Board's Emission Inventory Turn Around Document as described in Instructions for the Emission Data System Review and Update Report;
b) Actual emissions of volatile organic compounds and oxides of nitrogen, in tons per year, for the calendar year prior to the preparation of the emission statement;
c) Information regarding seasonal or diurnal peaks in the emission of affected pollutants; and
d) Certification by a responsible official of the Project owner that the information contained in the emission statement is accurate to the best knowledge of the individual certifying the emission statement.

**Verification:** The Project owner shall submit to the CPM the emission statement described herein prior to the beginning of March each year.

# Roseville Energy Park Quarterly Emissions Summary
## for PCAPCD

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY
**Generated:** 07/07/2023 22:19 **Location:** Roseville, CA

* = Excess Emission

| Date | Unit CT1 CO, Ton | | Unit CT1 NOx, Ton | | Unit CT1 OperatingTime, Hrs | | Unit CT2 CO, Ton | | Unit CT2 NOx, Ton | | Unit CT2 OperatingTime, Hrs | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|
| | 1 Day(s) | | 1 Day(s) | | 1 Day(s) | | 1 Day(s) | | 1 Day(s) | | 1 Day(s) | |
| | Sum | Rolling Sum | Sum | Rolling Sum | Sum | Rolling Sum | Sum | Rolling Sum | Sum | Rolling Sum | Sum | Rolling Sum |
| Apr 2023 | 0.0000 | 3.4836 | 0.0000 | 7.3210 | 0.00 | 6,031.41 | 0.0000 | 4.1942 | 0.0000 | 7.4296 | 0.00 | 5,687.66 |
| May 2023 | 0.2361 | 3.4343 | 0.0309 | 7.0398 | 11.30 | 5,785.79 | 0.0000 | 4.0352 | 0.0000 | 7.1491 | 0.00 | 5,460.72 |
| Jun 2023 | 0.0363 | 3.2165 | 0.0578 | 6.5397 | 40.57 | 5,358.47 | 0.0000 | 3.5760 | 0.0000 | 6.6131 | 0.00 | 5,066.45 |
| **Sum/Avg** | 3.2165 | | 6.5397 | | 5,358.47 | | 3.5760 | | 6.6131 | | 5,066.45 | |
| **Limit Value** | | | | | | | | | | | | |

# Tons 12 Month Rolling Summary

## CT1 and CT2 Combined

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:12 **Location:** Roseville, CA

* = Excess Emission

| Date | Units CT1 & CT2 CO, Ton 1 Day(s) Sum | Rolling Sum | Units CT1 & CT2 NOx, Ton 1 Day(s) Sum | Rolling Sum | Units CT1 & CT2 PM10, Ton 1 Day(s) Sum | Rolling Sum | Units CT1 & CT2 SO2, Ton 1 Day(s) Sum | Rolling Sum | Units CT1 & CT2 VOC, Ton 1 Day(s) Sum | Rolling Sum |
|---|---|---|---|---|---|---|---|---|---|---|
| Apr 2023 | 0.0000 | 7.6802 | 0.0000 | 14.7491 | 0.0000 | 3.0357 | 0.0000 | 1.5194 | 0.0000 | 5.0594 |
| May 2023 | 0.2388 | 7.4747 | 0.0309 | 14.1876 | 0.0023 | 2.9186 | 0.0012 | 1.4610 | 0.0038 | 4.8643 |
| Jun 2023 | 0.0363 | 6.7942 | 0.0578 | 13.1511 | 0.0115 | 2.7118 | 0.0057 | 1.3575 | 0.0192 | 4.5191 |
| **Sum/Avg** | 6.7942 | | 13.1511 | | 2.7118 | | 1.3575 | | 4.5191 | |
| **Limit Value** | | | | | | | | | | |

**ATTACHMENT 12**

# AQ-47

**AQ-47** No emissions are permitted, from any source, which are a nuisance per PCAPCD Rule 205, Nuisance.

**Verification:** The Project owner shall report all violations of this condition as noticed by the PCAPCD as well as any offsite nuisance complaints as part of the Quarterly Air Quality Report in Condition of Certification AQ-SC6

In regards to AQ-47of Roseville Energy Park's 2Q23 QAQR, there were no violations of PCAPCD's Rule 205 for nuisance.

**ATTACHMENT 13**

# AQ-48

**AQ-48** Stack emission opacity as dark as Ringelmann No. 1 (20% opacity) for periods aggregating more than 3 minutes in any one hour is prohibited and is in violation of PCAPCD Rule 202, Visible Emissions.

**Verification:** The Project owner shall report all violations of this condition as noticed by the PCAPCD as well as any offsite nuisance complaints as part of the Quarterly Air Quality Report in Condition of Certification AQ-SC6

In regards to AQ-48 of Roseville Energy Park's 2Q23 QAQR, there were no violations of PCAPCD's Rule 202 for opacity.

**ATTACHMENT 14**

# AQ-51

**AQ-51** The ammonia slip shall not exceed 10 ppmv @ 15% o2 averaged over one hour. The SCR catalyst shall be replaced, repaired or otherwise reconditioned within 24 months of the ammonia slip reaching 7 ppm @ 15% O2 averaged over 24 hours. The SCR ammonia injection grid replacement, repair or reconditioning scheduled event may be cancelled if the Project owner can demonstrate to the CPM that, subsequent to the initial exceedance, the ammonia slip consistently remains below 7 ppm @ 15% O2 averaged over 24 hours and that the initial exceedance does not accurately indicate expected future operating conditions.

Compliance with ammonia slip limits shall be demonstrated by using the following calculation procedure:

Ammonia slip ppmv @ 15% O2 = ((a-(bxc/1,000,000)) x 1,000,000/b) x d,

Where

a = ammonia injection rate (lb/hr)/17(lb/lb mol)

b = dry exhaust gas flow rate (lb/hr)/ (29(lb/lb mol)

c = change in measured NOX conc. Ppmv @ 15% O2 across catalyst, and

d = correction factor

The correction factor shall be derived annually during compliance testing by comparing the measured and calculated ammonia slip.

**Verification:** The Project owner shall include the ammonia slip concentrations averaged on an hourly and 24 hour basis calculated via the protocol provided as part of the Quarterly Air Quality Report required in Condition of Certification AQ-SC6. The Project owner shall notify the CPM within 10 days of an exceedance of the 7 ppm ammonia slip limit herein. The Project owner shall notify the CPM no less than 30 days prior to the scheduled date of the SCR catalyst replacement, repair or reconditioning event. If the Project owner finds that the exceedance of the 7 ppm slip limit does not accurately reflect the expected future operations provided for in this condition, the Project owner shall submit all relevant information to the CPM no less than 30 days prior to the scheduled date of the SCR catalyst replacement, repair or reconditioning event in order to cancel the event.

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 04/01/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/01/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/01/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/01/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/01/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/01/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/01/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/01/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/01/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/01/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/01/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/01/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/01/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/01/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/01/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/01/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/01/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/01/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/01/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/01/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/01/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/01/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/01/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/01/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 04/02/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/02/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/02/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/02/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/02/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/02/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/02/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/02/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/02/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/02/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/02/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/02/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/02/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/02/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/02/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/02/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/02/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/02/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/02/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/02/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/02/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/02/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/02/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/02/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 04/03/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/03/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/03/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/03/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/03/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/03/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/03/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/03/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/03/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/03/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/03/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/03/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/03/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/03/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/03/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/03/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/03/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/03/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/03/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/03/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/03/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/03/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/03/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/03/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 04/04/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/04/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/04/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/04/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/04/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/04/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/04/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/04/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/04/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/04/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/04/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/04/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/04/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/04/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/04/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/04/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/04/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/04/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/04/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/04/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/04/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/04/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/04/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/04/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 04/05/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/05/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/05/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/05/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/05/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/05/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/05/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/05/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/05/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/05/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/05/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/05/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/05/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/05/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/05/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/05/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/05/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/05/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/05/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/05/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/05/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/05/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/05/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/05/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 04/06/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/06/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/06/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/06/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/06/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/06/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/06/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/06/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/06/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/06/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/06/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/06/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/06/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/06/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/06/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/06/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/06/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/06/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/06/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/06/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/06/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/06/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/06/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/06/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 04/07/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/07/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/07/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/07/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/07/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/07/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/07/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/07/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/07/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/07/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/07/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/07/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/07/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/07/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/07/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/07/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/07/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/07/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/07/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/07/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/07/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/07/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/07/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/07/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 04/08/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/08/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/08/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/08/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/08/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/08/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/08/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/08/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/08/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/08/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/08/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/08/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/08/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/08/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/08/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/08/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/08/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/08/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/08/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/08/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/08/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/08/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/08/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/08/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 04/09/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/09/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/09/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/09/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/09/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/09/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/09/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/09/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/09/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/09/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/09/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/09/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/09/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/09/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/09/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/09/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/09/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/09/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/09/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/09/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/09/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/09/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/09/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/09/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 04/10/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/10/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/10/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/10/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/10/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/10/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/10/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/10/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/10/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/10/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/10/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/10/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/10/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/10/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/10/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/10/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/10/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/10/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/10/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/10/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/10/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/10/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/10/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/10/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 04/11/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/11/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/11/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/11/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/11/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/11/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/11/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/11/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/11/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/11/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/11/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/11/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/11/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/11/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/11/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/11/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/11/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/11/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/11/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/11/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/11/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/11/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/11/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/11/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 04/12/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/12/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/12/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/12/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/12/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/12/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/12/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/12/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/12/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/12/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/12/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/12/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/12/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/12/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/12/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/12/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/12/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/12/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/12/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/12/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/12/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/12/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/12/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/12/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 04/13/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/13/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/13/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/13/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/13/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/13/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/13/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/13/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/13/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/13/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/13/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/13/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/13/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/13/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/13/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/13/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/13/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/13/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/13/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/13/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/13/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/13/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/13/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/13/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 04/14/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/14/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/14/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/14/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/14/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/14/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/14/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/14/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/14/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/14/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/14/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/14/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/14/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/14/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/14/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/14/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/14/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/14/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/14/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/14/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/14/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/14/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/14/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/14/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 04/15/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/15/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/15/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/15/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/15/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/15/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/15/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/15/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/15/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/15/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/15/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/15/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/15/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/15/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/15/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/15/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/15/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/15/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/15/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/15/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/15/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/15/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/15/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/15/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 04/16/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/16/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/16/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/16/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/16/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/16/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/16/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/16/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/16/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/16/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/16/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/16/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/16/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/16/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/16/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/16/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/16/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/16/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/16/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/16/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/16/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/16/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/16/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/16/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 04/17/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/17/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/17/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/17/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/17/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/17/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/17/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/17/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/17/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/17/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/17/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/17/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/17/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/17/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/17/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/17/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/17/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/17/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/17/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/17/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/17/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/17/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/17/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/17/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 04/18/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/18/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/18/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/18/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/18/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/18/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/18/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/18/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/18/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/18/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/18/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/18/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/18/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/18/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/18/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/18/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/18/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/18/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/18/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/18/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/18/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/18/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/18/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/18/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 04/19/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/19/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/19/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/19/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/19/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/19/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/19/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/19/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/19/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/19/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/19/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/19/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/19/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/19/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/19/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/19/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/19/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/19/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/19/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/19/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/19/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/19/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/19/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/19/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 04/20/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/20/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/20/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/20/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/20/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/20/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/20/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/20/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/20/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/20/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/20/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/20/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/20/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/20/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/20/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/20/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/20/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/20/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/20/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/20/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/20/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/20/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/20/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/20/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 04/21/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/21/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/21/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/21/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/21/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/21/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/21/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/21/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/21/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/21/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/21/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/21/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/21/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/21/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/21/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/21/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/21/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/21/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/21/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/21/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/21/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/21/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/21/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/21/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 04/22/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/22/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/22/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/22/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/22/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/22/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/22/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/22/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/22/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/22/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/22/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/22/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/22/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/22/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/22/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/22/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/22/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/22/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/22/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/22/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/22/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/22/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/22/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/22/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 04/23/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/23/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/23/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/23/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/23/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/23/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/23/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/23/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/23/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/23/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/23/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/23/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/23/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/23/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/23/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/23/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/23/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/23/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/23/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/23/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/23/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/23/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/23/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/23/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 04/24/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/24/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/24/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/24/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/24/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/24/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/24/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/24/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/24/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/24/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/24/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/24/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/24/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/24/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/24/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/24/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/24/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/24/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/24/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/24/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/24/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/24/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/24/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/24/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 04/25/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/25/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/25/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/25/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/25/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/25/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/25/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/25/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/25/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/25/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/25/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/25/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/25/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/25/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/25/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/25/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/25/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/25/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/25/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/25/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/25/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/25/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/25/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/25/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 04/26/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/26/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/26/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/26/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/26/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/26/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/26/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/26/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/26/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/26/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/26/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/26/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/26/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/26/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/26/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/26/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/26/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/26/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/26/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/26/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/26/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/26/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/26/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/26/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 04/27/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/27/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/27/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/27/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/27/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/27/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/27/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/27/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/27/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/27/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/27/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/27/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/27/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/27/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/27/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/27/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/27/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/27/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/27/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/27/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/27/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/27/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/27/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/27/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 04/28/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/28/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/28/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/28/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/28/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/28/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/28/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/28/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/28/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/28/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/28/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/28/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/28/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/28/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/28/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/28/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/28/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/28/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/28/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/28/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/28/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/28/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/28/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/28/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 04/29/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/29/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/29/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/29/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/29/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/29/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/29/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/29/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/29/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/29/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/29/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/29/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/29/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/29/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/29/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/29/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/29/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/29/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/29/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/29/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/29/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/29/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/29/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/29/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 04/30/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/30/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/30/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/30/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/30/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/30/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/30/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/30/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/30/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/30/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/30/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/30/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/30/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/30/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/30/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/30/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/30/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/30/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/30/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/30/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/30/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/30/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/30/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/30/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 05/01/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/01/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/01/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/01/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/01/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/01/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/01/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/01/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/01/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/01/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/01/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/01/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/01/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/01/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/01/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/01/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/01/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/01/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/01/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/01/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/01/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/01/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/01/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/01/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 05/02/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/02/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/02/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/02/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/02/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/02/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/02/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/02/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/02/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/02/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/02/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/02/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/02/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/02/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/02/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/02/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/02/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/02/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/02/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/02/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/02/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/02/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/02/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/02/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 05/03/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/03/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/03/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/03/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/03/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/03/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/03/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/03/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/03/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/03/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/03/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/03/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/03/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/03/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/03/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/03/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/03/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/03/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/03/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/03/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/03/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/03/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/03/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/03/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 05/04/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/04/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/04/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/04/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/04/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/04/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/04/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/04/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/04/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/04/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/04/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/04/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/04/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/04/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/04/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/04/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/04/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/04/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/04/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/04/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/04/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/04/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/04/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/04/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 05/05/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/05/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/05/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/05/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/05/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/05/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/05/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/05/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/05/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/05/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/05/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/05/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/05/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/05/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/05/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/05/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/05/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/05/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/05/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/05/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/05/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/05/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/05/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/05/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 05/06/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/06/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/06/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/06/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/06/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/06/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/06/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/06/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/06/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/06/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/06/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/06/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/06/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/06/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/06/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/06/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/06/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/06/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/06/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/06/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/06/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/06/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/06/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/06/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 05/07/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/07/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/07/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/07/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/07/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/07/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/07/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/07/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/07/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/07/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/07/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/07/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/07/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/07/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/07/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/07/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/07/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/07/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/07/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/07/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/07/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/07/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/07/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/07/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 05/08/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/08/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/08/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/08/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/08/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/08/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/08/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/08/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/08/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/08/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/08/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/08/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/08/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/08/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/08/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/08/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/08/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/08/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/08/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/08/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/08/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/08/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/08/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/08/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 05/09/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/09/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/09/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/09/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/09/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/09/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/09/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/09/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/09/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/09/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/09/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/09/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/09/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/09/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/09/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/09/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/09/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/09/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/09/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/09/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/09/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/09/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/09/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/09/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 05/10/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/10/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/10/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/10/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/10/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/10/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/10/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/10/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/10/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/10/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/10/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/10/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/10/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/10/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/10/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/10/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/10/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/10/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/10/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/10/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/10/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/10/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/10/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/10/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 05/11/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/11/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/11/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/11/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/11/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/11/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/11/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/11/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/11/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/11/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/11/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/11/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/11/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/11/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/11/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/11/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/11/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/11/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/11/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/11/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/11/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/11/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/11/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/11/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 05/12/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/12/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/12/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/12/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/12/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/12/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/12/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/12/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/12/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/12/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/12/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/12/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/12/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/12/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/12/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/12/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/12/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/12/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/12/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/12/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/12/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/12/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/12/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/12/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 05/13/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/13/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/13/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/13/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/13/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/13/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/13/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/13/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/13/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/13/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/13/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/13/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/13/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/13/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/13/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/13/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/13/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/13/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/13/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/13/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/13/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/13/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/13/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/13/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 05/14/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/14/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/14/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/14/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/14/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/14/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/14/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/14/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/14/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/14/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/14/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/14/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/14/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/14/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/14/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/14/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/14/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/14/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/14/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/14/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/14/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/14/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/14/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/14/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 05/15/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/15/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/15/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/15/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/15/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/15/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/15/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/15/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/15/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/15/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/15/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/15/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/15/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/15/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/15/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/15/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/15/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/15/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/15/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/15/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/15/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/15/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/15/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/15/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 05/16/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/16/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/16/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/16/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/16/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/16/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/16/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/16/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/16/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/16/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/16/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/16/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/16/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/16/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/16/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/16/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/16/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/16/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/16/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/16/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/16/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/16/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/16/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/16/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 05/17/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/17/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/17/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/17/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/17/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/17/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/17/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/17/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/17/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/17/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/17/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/17/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/17/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/17/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/17/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/17/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/17/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/17/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/17/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/17/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/17/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/17/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/17/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/17/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 05/18/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/18/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/18/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/18/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/18/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/18/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/18/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/18/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/18/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/18/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/18/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/18/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/18/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/18/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/18/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/18/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/18/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/18/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/18/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/18/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/18/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/18/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/18/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/18/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 05/19/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/19/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/19/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/19/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/19/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/19/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/19/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/19/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/19/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/19/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/19/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/19/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/19/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/19/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/19/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/19/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/19/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/19/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/19/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/19/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/19/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/19/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/19/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/19/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 05/20/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/20/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/20/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/20/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/20/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/20/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/20/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/20/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/20/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/20/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/20/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/20/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/20/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/20/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/20/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/20/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/20/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/20/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/20/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/20/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/20/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/20/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/20/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/20/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 05/21/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/21/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/21/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/21/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/21/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/21/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/21/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/21/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/21/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/21/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/21/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/21/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/21/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/21/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/21/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/21/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/21/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/21/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/21/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/21/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/21/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/21/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/21/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/21/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 05/22/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/22/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/22/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/22/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/22/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/22/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/22/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/22/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/22/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/22/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/22/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/22/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/22/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/22/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/22/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/22/2023 15:00 | 0 | 23.0 | 21.4 | 18.4 | 0.0 | 703,884.1 | 0.63 | 0.63 |
| 05/22/2023 16:00 | 3 | 17.1 | 22.6 | 15.5 | 13.9 | 659,606.1 | 0.73 | 0.87 |
| 05/22/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/22/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/22/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/22/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/22/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/22/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/22/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 3 | 20.1 | 22.0 | 17.0 | 7.0 | 681,745.1 | 1.36 # | 1.50 # |
| Minimum: | 3 | 17.1 | 21.4 | 15.5 | 0.0 | 659,606.1 | 0.00 | 0.00 |
| Maximum: | 3 | 23.0 | 22.6 | 18.4 | 13.9 | 703,884.1 | 0.73 | 0.87 |
| %SI | 95.83 | 91.67 | 91.67 | 91.67 | 91.67 | 91.67 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 05/23/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/23/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/23/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/23/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/23/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/23/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/23/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/23/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/23/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/23/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/23/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/23/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/23/2023 12:00 | 0 | 0.0 | 22.6 | 0.0 | 0.0 | 103,132.7 | 0.28 | 0.28 |
| 05/23/2023 13:00 | 0 | 0.0 | 10.4 | 0.0 | 11.2 | 207,182.8 | 0.62 | 1.00 |
| 05/23/2023 14:00 | 0 | 1.6 | 7.5 | 14.5 | 15.9 | 935,916.0 | 0.00 | 1.00 |
| 05/23/2023 15:00 | 0 | 1.6 | 7.3 | 14.5 | 14.2 | 956,885.3 | 0.00 | 1.00 |
| 05/23/2023 16:00 | 0 | 1.6 | 7.2 | 14.4 | 12.3 | 866,108.3 | 0.00 | 1.00 |
| 05/23/2023 17:00 | 0 | 1.7 | 7.1 | 14.3 | 5.7 | 729,529.7 | 0.05 | 1.00 |
| 05/23/2023 18:00 | 0 | 13.7 | 25.3 | 15.4 | 0.0 | 530,340.7 | 0.13 | 0.13 |
| 05/23/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/23/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/23/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/23/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/23/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 4.0 | 12.5 | 14.6 | 8.5 | 803,756.0 | 1.08 # | 5.41 # |
| Minimum: | 0 | 1.6 | 7.1 | 14.3 | 0.0 | 530,340.7 | 0.00 | 0.00 |
| Maximum: | 0 | 13.7 | 25.3 | 15.4 | 15.9 | 956,885.3 | 0.62 | 1.00 |
| %SI | 83.33 | 79.17 | 70.83 | 79.17 | 70.83 | 79.17 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 05/24/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/24/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/24/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/24/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/24/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/24/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/24/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/24/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/24/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/24/2023 09:00 | 0 | 20.8 | 22.6 | 17.9 | 0.0 | 673,300.3 | 0.27 | 0.27 |
| 05/24/2023 10:00 | 1 | 4.9 | 9.2 | 14.2 | 9.1 | 727,225.7 | 0.78 | 1.00 |
| 05/24/2023 11:00 | 1 | 1.7 | 7.5 | 14.3 | 12.9 | 767,085.1 | 0.00 | 1.00 |
| 05/24/2023 12:00 | 0 | 1.7 | 7.2 | 14.3 | 11.8 | 768,745.1 | 0.00 | 1.00 |
| 05/24/2023 13:00 | 0 | 1.7 | 7.1 | 14.3 | 10.1 | 763,142.9 | 0.10 | 1.00 |
| 05/24/2023 14:00 | 0 | 18.7 | 30.3 | 15.9 | 0.0 | 493,266.7 | 0.12 | 0.12 |
| 05/24/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/24/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/24/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/24/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/24/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/24/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/24/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/24/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/24/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 1 | 8.3 | 14.0 | 15.2 | 7.3 | 698,794.3 | 1.27 # | 4.39 # |
| Minimum: | 0 | 1.7 | 7.1 | 14.2 | 0.0 | 493,266.7 | 0.00 | 0.00 |
| Maximum: | 1 | 20.8 | 30.3 | 17.9 | 12.9 | 768,745.1 | 0.78 | 1.00 |
| %SI | 83.33 | 75.00 | 75.00 | 75.00 | 75.00 | 75.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 05/25/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/25/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/25/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/25/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/25/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/25/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/25/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/25/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/25/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/25/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/25/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/25/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/25/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/25/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/25/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/25/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/25/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/25/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/25/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/25/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/25/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/25/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/25/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/25/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 05/26/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/26/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/26/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/26/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/26/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/26/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/26/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/26/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/26/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/26/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/26/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/26/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/26/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/26/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/26/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/26/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/26/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/26/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/26/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/26/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/26/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/26/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/26/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/26/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 05/27/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/27/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/27/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/27/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/27/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/27/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/27/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/27/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/27/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/27/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/27/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/27/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/27/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/27/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/27/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/27/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/27/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/27/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/27/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/27/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/27/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/27/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/27/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/27/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 05/28/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/28/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/28/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/28/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/28/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/28/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/28/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/28/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/28/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/28/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/28/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/28/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/28/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/28/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/28/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/28/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/28/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/28/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/28/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/28/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/28/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/28/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/28/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/28/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 05/29/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/29/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/29/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/29/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/29/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/29/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/29/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/29/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/29/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/29/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/29/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/29/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/29/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/29/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/29/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/29/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/29/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/29/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/29/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/29/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/29/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/29/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/29/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/29/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 05/30/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/30/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/30/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/30/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/30/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/30/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/30/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/30/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/30/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/30/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/30/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/30/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/30/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/30/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/30/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/30/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/30/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/30/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/30/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/30/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/30/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/30/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/30/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/30/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 05/31/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/31/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/31/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/31/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/31/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/31/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/31/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/31/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/31/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/31/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/31/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/31/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/31/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/31/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/31/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/31/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/31/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/31/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/31/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/31/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/31/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/31/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/31/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/31/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 06/01/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/01/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/01/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/01/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/01/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/01/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/01/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/01/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/01/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/01/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/01/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/01/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/01/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/01/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/01/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/01/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/01/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/01/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/01/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/01/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/01/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/01/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/01/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/01/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 06/02/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/02/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/02/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/02/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/02/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/02/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/02/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/02/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/02/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/02/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/02/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/02/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/02/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/02/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/02/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/02/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/02/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/02/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/02/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/02/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/02/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/02/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/02/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/02/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 06/03/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/03/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/03/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/03/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/03/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/03/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/03/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/03/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/03/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/03/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/03/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/03/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/03/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/03/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/03/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/03/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/03/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/03/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/03/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/03/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/03/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/03/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/03/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/03/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 06/04/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/04/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/04/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/04/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/04/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/04/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/04/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/04/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/04/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/04/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/04/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/04/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/04/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/04/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/04/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/04/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/04/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/04/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/04/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/04/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/04/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/04/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/04/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/04/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 06/05/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/05/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/05/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/05/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/05/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/05/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/05/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/05/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/05/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/05/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/05/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/05/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/05/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/05/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/05/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/05/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/05/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/05/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/05/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/05/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/05/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/05/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/05/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/05/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 06/06/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/06/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/06/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/06/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/06/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/06/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/06/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/06/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/06/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/06/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/06/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/06/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/06/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/06/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/06/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/06/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/06/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/06/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/06/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/06/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/06/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/06/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/06/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/06/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 06/07/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/07/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/07/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/07/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/07/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/07/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/07/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/07/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/07/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/07/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/07/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/07/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/07/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/07/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/07/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/07/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/07/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/07/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/07/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/07/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/07/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/07/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/07/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/07/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 06/08/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/08/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/08/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/08/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/08/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/08/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/08/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/08/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/08/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/08/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/08/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/08/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/08/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/08/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/08/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/08/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/08/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/08/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/08/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/08/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/08/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/08/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/08/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/08/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 06/09/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/09/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/09/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/09/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/09/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/09/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/09/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/09/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/09/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/09/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/09/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/09/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/09/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/09/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/09/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/09/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/09/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/09/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/09/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/09/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/09/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/09/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/09/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/09/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 06/10/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/10/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/10/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/10/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/10/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/10/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/10/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/10/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/10/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/10/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/10/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/10/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/10/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/10/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/10/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/10/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/10/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/10/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/10/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/10/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/10/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/10/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/10/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/10/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 06/11/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/11/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/11/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/11/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/11/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/11/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/11/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/11/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/11/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/11/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/11/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/11/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/11/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/11/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/11/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/11/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/11/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/11/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/11/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/11/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/11/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/11/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/11/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/11/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 06/12/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/12/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/12/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/12/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/12/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/12/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/12/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/12/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/12/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/12/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/12/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/12/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/12/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/12/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/12/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/12/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/12/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/12/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/12/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/12/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/12/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/12/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/12/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/12/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 06/13/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/13/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/13/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/13/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/13/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/13/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/13/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/13/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/13/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/13/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/13/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/13/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/13/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/13/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/13/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/13/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/13/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/13/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/13/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/13/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/13/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/13/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/13/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/13/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 06/14/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/14/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/14/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/14/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/14/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/14/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/14/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/14/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/14/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/14/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/14/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/14/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/14/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/14/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/14/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/14/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/14/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/14/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/14/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/14/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/14/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/14/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/14/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/14/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 06/15/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/15/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/15/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/15/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/15/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/15/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/15/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/15/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/15/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/15/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/15/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/15/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/15/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/15/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/15/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/15/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/15/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/15/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/15/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/15/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/15/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/15/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/15/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/15/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 06/16/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/16/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/16/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/16/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/16/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/16/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/16/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/16/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/16/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/16/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/16/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/16/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/16/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/16/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/16/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/16/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/16/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/16/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/16/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/16/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/16/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/16/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/16/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/16/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 06/17/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/17/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/17/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/17/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/17/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/17/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/17/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/17/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/17/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/17/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/17/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/17/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/17/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/17/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/17/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/17/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/17/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/17/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/17/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/17/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/17/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/17/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/17/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/17/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 06/18/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/18/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/18/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/18/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/18/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/18/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/18/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/18/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/18/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/18/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/18/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/18/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/18/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/18/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/18/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/18/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/18/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/18/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/18/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/18/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/18/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/18/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/18/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/18/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 06/19/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/19/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/19/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/19/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/19/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/19/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/19/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/19/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/19/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/19/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/19/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/19/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/19/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/19/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/19/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/19/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/19/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/19/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/19/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/19/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/19/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/19/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/19/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/19/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 06/20/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/20/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/20/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/20/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/20/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/20/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/20/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/20/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/20/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/20/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/20/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/20/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/20/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/20/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/20/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/20/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/20/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/20/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/20/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/20/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/20/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/20/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/20/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/20/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 06/21/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/21/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/21/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/21/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/21/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/21/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/21/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/21/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/21/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/21/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/21/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/21/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/21/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/21/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/21/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/21/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/21/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/21/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/21/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/21/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/21/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/21/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/21/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/21/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 06/22/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/22/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/22/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/22/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/22/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/22/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/22/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/22/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/22/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/22/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/22/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/22/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/22/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/22/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/22/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/22/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/22/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/22/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/22/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/22/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/22/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/22/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/22/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/22/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 06/23/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/23/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/23/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/23/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/23/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/23/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/23/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/23/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/23/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/23/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/23/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/23/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/23/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/23/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/23/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/23/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/23/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/23/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/23/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/23/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/23/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/23/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/23/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/23/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 06/24/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/24/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/24/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/24/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/24/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/24/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/24/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/24/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/24/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/24/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/24/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/24/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/24/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/24/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/24/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/24/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/24/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/24/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/24/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/24/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/24/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/24/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/24/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/24/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 06/25/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/25/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/25/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/25/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/25/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/25/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/25/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/25/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/25/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/25/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/25/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/25/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/25/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/25/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/25/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/25/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/25/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/25/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/25/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/25/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/25/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/25/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/25/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/25/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 06/26/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/26/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/26/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/26/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/26/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/26/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/26/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/26/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/26/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/26/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/26/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/26/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/26/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/26/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/26/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/26/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/26/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/26/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/26/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/26/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/26/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/26/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/26/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/26/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 06/27/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/27/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/27/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/27/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/27/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/27/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/27/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/27/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/27/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/27/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/27/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/27/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/27/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/27/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/27/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/27/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/27/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/27/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/27/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/27/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/27/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/27/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/27/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/27/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 06/28/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/28/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/28/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/28/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/28/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/28/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/28/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/28/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/28/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/28/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/28/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/28/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/28/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/28/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/28/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/28/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/28/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/28/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/28/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/28/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/28/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/28/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/28/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/28/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 06/29/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/29/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/29/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/29/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/29/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/29/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/29/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/29/2023 07:00 | 0 | 12.6 | 15.7 | 16.0 | 0.0 | 708,747.0 | 0.57 | 0.57 |
| 06/29/2023 08:00 | 1 | 2.8 | 7.8 | 14.4 | 15.6 | 916,250.3 | 0.57 | 1.00 |
| 06/29/2023 09:00 | 0 | 1.6 | 7.8 | 14.4 | 15.5 | 909,929.8 | 0.00 | 1.00 |
| 06/29/2023 10:00 | 1 | 1.8 | 8.1 | 13.9 | 17.3 | 901,863.8 | 0.00 | 1.00 |
| 06/29/2023 11:00 | 0 | 1.7 | 7.2 | 14.2 | 10.5 | 779,141.2 | 0.00 | 1.00 |
| 06/29/2023 12:00 | 0 | 1.7 | 6.6 | 14.3 | 8.2 | 734,302.0 | 0.00 | 1.00 |
| 06/29/2023 13:00 | 0 | 1.7 | 6.5 | 14.3 | 8.2 | 736,791.8 | 0.00 | 1.00 |
| 06/29/2023 14:00 | 0 | 1.7 | 6.5 | 14.3 | 7.9 | 738,244.2 | 0.00 | 1.00 |
| 06/29/2023 15:00 | 0 | 1.7 | 6.6 | 14.3 | 7.6 | 738,036.7 | 0.00 | 1.00 |
| 06/29/2023 16:00 | 0 | 1.8 | 7.4 | 14.1 | 13.9 | 831,321.2 | 0.00 | 1.00 |
| 06/29/2023 17:00 | 1 | 2.0 | 9.7 | 13.2 | 21.4 | 933,164.9 | 0.00 | 1.00 |
| 06/29/2023 18:00 | 1 | 2.0 | 10.4 | 13.0 | 23.3 | 937,449.0 | 0.00 | 1.00 |
| 06/29/2023 19:00 | 1 | 2.1 | 10.7 | 12.8 | 23.8 | 926,812.9 | 0.00 | 1.00 |
| 06/29/2023 20:00 | 1 | 2.0 | 9.6 | 13.2 | 21.0 | 929,963.6 | 0.00 | 1.00 |
| 06/29/2023 21:00 | 1 | 1.9 | 9.2 | 13.3 | 20.2 | 933,731.2 | 0.00 | 1.00 |
| 06/29/2023 22:00 | 1 | 1.9 | 9.0 | 13.3 | 20.3 | 929,406.7 | 0.00 | 1.00 |
| 06/29/2023 23:00 | 1 | 1.9 | 8.9 | 13.4 | 20.0 | 938,147.0 | 0.00 | 1.00 |
| Average/Sum#: | 1 | 2.5 | 8.7 | 13.9 | 15.0 | 854,312.0 | 1.14 # | 16.57 # |
| Minimum: | 0 | 1.6 | 6.5 | 12.8 | 0.0 | 708,747.0 | 0.00 | 0.00 |
| Maximum: | 1 | 12.6 | 15.7 | 16.0 | 23.8 | 938,147.0 | 0.57 | 1.00 |
| %SI | 33.33 | 29.17 | 29.17 | 29.17 | 29.17 | 29.17 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:57 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT1 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT1 NOx, Ppm 1 Hour(s) | Unit CT1 NOx, _SCR, Ppm 1 Hour(s) | Unit CT1 O2, Dry, Pct 1 Hour(s) | Unit CT1 NH3Inj, LbPerHr 1 Hour(s) | Unit CT1 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT1 SUSD, Hr 1 Hour(s) | Unit CT1 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 06/30/2023 00:00 | 1 | 1.9 | 8.7 | 13.5 | 20.1 | 947,123.5 | 0.00 | 1.00 |
| 06/30/2023 01:00 | 1 | 1.9 | 8.5 | 13.5 | 20.2 | 941,941.9 | 0.00 | 1.00 |
| 06/30/2023 02:00 | 1 | 1.9 | 8.8 | 13.6 | 20.2 | 951,843.7 | 0.00 | 1.00 |
| 06/30/2023 03:00 | 1 | 1.9 | 8.5 | 13.6 | 20.5 | 949,592.6 | 0.00 | 1.00 |
| 06/30/2023 04:00 | 1 | 1.9 | 8.3 | 13.6 | 20.6 | 946,403.6 | 0.00 | 1.00 |
| 06/30/2023 05:00 | 1 | 1.8 | 8.2 | 13.7 | 20.6 | 955,934.3 | 0.00 | 1.00 |
| 06/30/2023 06:00 | 1 | 1.8 | 8.1 | 13.7 | 20.6 | 953,651.9 | 0.00 | 1.00 |
| 06/30/2023 07:00 | 1 | 1.8 | 7.8 | 13.9 | 19.3 | 931,991.1 | 0.00 | 1.00 |
| 06/30/2023 08:00 | 0 | 1.6 | 7.0 | 14.3 | 9.8 | 735,754.4 | 0.00 | 1.00 |
| 06/30/2023 09:00 | 0 | 1.7 | 7.0 | 14.3 | 9.7 | 734,924.4 | 0.00 | 1.00 |
| 06/30/2023 10:00 | 0 | 1.7 | 6.8 | 14.3 | 9.4 | 736,376.8 | 0.00 | 1.00 |
| 06/30/2023 11:00 | 1 | 1.8 | 7.4 | 14.1 | 15.6 | 829,911.5 | 0.00 | 1.00 |
| 06/30/2023 12:00 | 1 | 1.9 | 9.5 | 13.4 | 21.2 | 941,798.8 | 0.00 | 1.00 |
| 06/30/2023 13:00 | 1 | 1.9 | 9.6 | 13.3 | 21.1 | 934,992.5 | 0.00 | 1.00 |
| 06/30/2023 14:00 | 1 | 2.0 | 10.2 | 13.2 | 22.1 | 942,590.8 | 0.00 | 1.00 |
| 06/30/2023 15:00 | 1 | 1.9 | 9.8 | 13.3 | 20.9 | 938,596.3 | 0.00 | 1.00 |
| 06/30/2023 16:00 | 1 | 2.0 | 9.8 | 13.2 | 21.1 | 924,806.1 | 0.00 | 1.00 |
| 06/30/2023 17:00 | 1 | 2.0 | 9.9 | 13.2 | 21.8 | 922,849.8 | 0.00 | 1.00 |
| 06/30/2023 18:00 | 1 | 2.0 | 10.5 | 13.1 | 24.6 | 934,017.7 | 0.00 | 1.00 |
| 06/30/2023 19:00 | 2 | 2.2 | 12.7 | 12.2 | 32.0 | 929,477.1 | 0.00 | 1.00 |
| 06/30/2023 20:00 | 1 | 2.0 | 10.7 | 13.0 | 22.3 | 921,848.0 | 0.00 | 1.00 |
| 06/30/2023 21:00 | 1 | 2.0 | 9.9 | 13.3 | 21.3 | 935,533.1 | 0.00 | 1.00 |
| 06/30/2023 22:00 | 1 | 1.9 | 9.7 | 13.3 | 20.7 | 933,551.0 | 0.00 | 1.00 |
| 06/30/2023 23:00 | 1 | 1.9 | 9.0 | 13.4 | 19.7 | 928,652.3 | 0.00 | 1.00 |
| Average/Sum#: | 1 | 1.9 | 9.0 | 13.5 | 19.8 | 908,506.8 | 0.00 # | 24.00 # |
| Minimum: | 0 | 1.6 | 6.8 | 12.2 | 9.4 | 734,924.4 | 0.00 | 1.00 |
| Maximum: | 2 | 2.2 | 12.7 | 14.3 | 32.0 | 955,934.3 | 0.00 | 1.00 |
| %SI | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 04/01/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/01/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/01/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/01/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/01/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/01/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/01/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/01/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/01/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/01/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/01/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/01/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/01/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/01/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/01/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/01/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/01/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/01/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/01/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/01/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/01/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/01/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/01/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/01/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 04/02/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/02/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/02/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/02/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/02/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/02/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/02/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/02/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/02/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/02/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/02/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/02/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/02/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/02/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/02/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/02/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/02/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/02/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/02/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/02/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/02/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/02/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/02/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/02/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 04/03/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/03/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/03/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/03/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/03/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/03/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/03/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/03/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/03/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/03/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/03/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/03/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/03/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/03/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/03/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/03/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/03/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/03/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/03/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/03/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/03/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/03/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/03/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/03/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 04/04/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/04/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/04/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/04/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/04/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/04/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/04/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/04/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/04/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/04/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/04/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/04/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/04/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/04/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/04/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/04/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/04/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/04/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/04/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/04/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/04/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/04/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/04/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/04/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 04/05/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/05/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/05/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/05/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/05/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/05/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/05/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/05/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/05/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/05/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/05/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/05/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/05/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/05/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/05/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/05/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/05/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/05/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/05/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/05/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/05/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/05/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/05/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/05/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 04/06/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/06/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/06/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/06/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/06/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/06/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/06/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/06/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/06/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/06/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/06/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/06/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/06/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/06/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/06/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/06/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/06/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/06/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/06/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/06/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/06/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/06/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/06/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/06/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 04/07/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/07/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/07/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/07/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/07/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/07/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/07/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/07/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/07/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/07/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/07/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/07/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/07/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/07/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/07/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/07/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/07/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/07/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/07/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/07/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/07/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/07/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/07/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/07/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 04/08/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/08/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/08/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/08/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/08/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/08/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/08/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/08/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/08/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/08/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/08/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/08/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/08/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/08/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/08/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/08/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/08/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/08/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/08/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/08/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/08/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/08/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/08/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/08/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 04/09/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/09/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/09/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/09/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/09/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/09/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/09/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/09/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/09/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/09/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/09/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/09/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/09/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/09/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/09/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/09/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/09/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/09/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/09/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/09/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/09/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/09/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/09/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/09/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 04/10/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/10/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/10/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/10/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/10/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/10/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/10/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/10/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/10/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/10/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/10/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/10/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/10/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/10/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/10/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/10/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/10/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/10/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/10/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/10/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/10/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/10/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/10/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/10/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 04/11/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/11/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/11/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/11/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/11/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/11/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/11/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/11/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/11/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/11/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/11/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/11/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/11/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/11/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/11/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/11/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/11/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/11/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/11/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/11/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/11/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/11/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/11/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/11/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 04/12/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/12/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/12/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/12/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/12/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/12/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/12/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/12/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/12/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/12/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/12/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/12/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/12/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/12/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/12/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/12/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/12/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/12/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/12/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/12/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/12/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/12/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/12/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/12/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 04/13/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/13/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/13/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/13/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/13/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/13/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/13/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/13/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/13/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/13/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/13/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/13/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/13/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/13/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/13/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/13/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/13/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/13/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/13/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/13/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/13/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/13/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/13/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/13/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 04/14/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/14/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/14/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/14/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/14/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/14/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/14/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/14/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/14/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/14/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/14/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/14/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/14/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/14/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/14/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/14/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/14/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/14/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/14/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/14/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/14/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/14/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/14/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/14/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 04/15/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/15/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/15/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/15/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/15/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/15/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/15/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/15/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/15/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/15/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/15/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/15/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/15/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/15/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/15/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/15/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/15/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/15/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/15/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/15/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/15/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/15/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/15/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/15/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 04/16/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/16/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/16/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/16/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/16/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/16/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/16/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/16/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/16/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/16/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/16/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/16/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/16/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/16/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/16/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/16/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/16/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/16/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/16/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/16/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/16/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/16/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/16/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/16/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 04/17/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/17/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/17/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/17/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/17/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/17/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/17/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/17/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/17/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/17/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/17/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/17/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/17/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/17/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/17/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/17/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/17/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/17/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/17/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/17/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/17/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/17/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/17/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/17/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 04/18/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/18/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/18/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/18/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/18/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/18/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/18/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/18/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/18/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/18/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/18/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/18/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/18/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/18/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/18/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/18/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/18/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/18/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/18/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/18/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/18/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/18/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/18/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/18/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 04/19/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/19/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/19/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/19/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/19/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/19/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/19/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/19/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/19/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/19/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/19/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/19/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/19/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/19/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/19/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/19/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/19/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/19/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/19/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/19/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/19/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/19/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/19/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/19/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 04/20/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/20/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/20/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/20/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/20/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/20/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/20/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/20/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/20/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/20/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/20/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/20/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/20/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/20/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/20/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/20/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/20/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/20/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/20/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/20/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/20/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/20/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/20/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/20/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 04/21/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/21/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/21/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/21/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/21/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/21/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/21/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/21/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/21/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/21/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/21/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/21/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/21/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/21/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/21/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/21/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/21/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/21/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/21/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/21/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/21/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/21/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/21/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/21/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 04/22/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/22/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/22/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/22/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/22/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/22/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/22/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/22/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/22/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/22/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/22/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/22/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/22/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/22/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/22/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/22/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/22/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/22/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/22/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/22/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/22/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/22/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/22/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/22/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 04/23/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/23/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/23/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/23/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/23/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/23/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/23/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/23/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/23/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/23/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/23/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/23/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/23/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/23/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/23/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/23/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/23/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/23/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/23/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/23/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/23/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/23/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/23/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/23/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 04/24/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/24/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/24/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/24/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/24/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/24/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/24/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/24/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/24/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/24/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/24/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/24/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/24/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/24/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/24/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/24/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/24/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/24/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/24/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/24/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/24/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/24/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/24/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/24/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 04/25/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/25/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/25/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/25/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/25/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/25/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/25/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/25/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/25/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/25/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/25/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/25/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/25/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/25/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/25/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/25/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/25/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/25/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/25/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/25/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/25/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/25/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/25/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/25/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 04/26/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/26/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/26/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/26/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/26/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/26/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/26/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/26/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/26/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/26/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/26/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/26/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/26/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/26/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/26/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/26/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/26/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/26/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/26/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/26/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/26/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/26/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/26/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/26/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 04/27/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/27/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/27/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/27/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/27/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/27/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/27/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/27/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/27/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/27/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/27/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/27/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/27/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/27/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/27/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/27/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/27/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/27/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/27/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/27/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/27/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/27/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/27/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/27/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 04/28/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/28/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/28/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/28/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/28/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/28/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/28/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/28/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/28/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/28/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/28/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/28/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/28/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/28/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/28/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/28/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/28/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/28/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/28/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/28/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/28/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/28/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/28/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/28/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 04/29/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/29/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/29/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/29/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/29/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/29/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/29/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/29/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/29/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/29/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/29/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/29/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/29/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/29/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/29/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/29/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/29/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/29/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/29/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/29/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/29/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/29/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/29/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/29/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 04/30/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/30/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/30/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/30/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/30/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/30/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/30/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/30/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/30/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/30/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/30/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/30/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/30/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/30/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/30/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/30/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/30/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/30/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/30/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/30/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/30/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/30/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/30/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 04/30/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 05/01/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/01/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/01/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/01/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/01/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/01/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/01/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/01/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/01/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/01/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/01/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/01/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/01/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/01/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/01/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/01/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/01/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/01/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/01/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/01/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/01/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/01/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/01/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/01/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 05/02/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/02/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/02/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/02/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/02/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/02/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/02/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/02/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/02/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/02/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/02/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/02/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/02/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/02/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/02/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/02/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/02/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/02/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/02/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/02/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/02/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/02/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/02/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/02/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 05/03/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/03/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/03/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/03/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/03/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/03/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/03/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/03/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/03/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/03/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/03/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/03/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/03/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/03/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/03/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/03/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/03/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/03/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/03/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/03/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/03/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/03/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/03/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/03/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 05/04/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/04/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/04/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/04/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/04/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/04/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/04/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/04/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/04/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/04/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/04/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/04/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/04/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/04/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/04/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/04/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/04/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/04/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/04/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/04/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/04/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/04/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/04/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/04/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 05/05/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/05/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/05/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/05/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/05/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/05/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/05/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/05/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/05/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/05/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/05/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/05/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/05/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/05/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/05/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/05/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/05/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/05/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/05/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/05/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/05/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/05/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/05/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/05/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 05/06/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/06/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/06/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/06/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/06/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/06/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/06/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/06/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/06/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/06/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/06/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/06/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/06/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/06/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/06/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/06/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/06/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/06/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/06/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/06/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/06/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/06/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/06/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/06/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 05/07/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/07/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/07/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/07/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/07/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/07/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/07/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/07/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/07/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/07/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/07/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/07/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/07/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/07/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/07/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/07/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/07/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/07/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/07/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/07/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/07/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/07/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/07/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/07/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 05/08/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/08/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/08/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/08/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/08/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/08/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/08/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/08/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/08/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/08/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/08/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/08/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/08/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/08/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/08/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/08/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/08/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/08/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/08/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/08/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/08/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/08/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/08/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/08/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 05/09/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/09/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/09/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/09/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/09/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/09/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/09/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/09/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/09/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/09/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/09/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/09/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/09/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/09/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/09/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/09/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/09/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/09/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/09/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/09/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/09/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/09/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/09/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/09/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 05/10/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/10/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/10/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/10/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/10/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/10/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/10/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/10/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/10/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/10/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/10/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/10/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/10/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/10/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/10/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/10/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/10/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/10/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/10/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/10/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/10/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/10/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/10/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/10/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 05/11/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/11/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/11/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/11/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/11/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/11/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/11/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/11/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/11/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/11/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/11/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/11/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/11/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/11/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/11/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/11/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/11/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/11/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/11/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/11/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/11/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/11/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/11/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/11/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 05/12/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/12/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/12/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/12/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/12/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/12/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/12/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/12/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/12/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/12/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/12/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/12/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/12/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/12/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/12/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/12/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/12/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/12/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/12/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/12/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/12/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/12/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/12/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/12/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 05/13/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/13/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/13/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/13/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/13/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/13/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/13/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/13/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/13/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/13/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/13/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/13/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/13/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/13/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/13/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/13/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/13/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/13/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/13/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/13/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/13/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/13/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/13/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/13/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 05/14/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/14/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/14/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/14/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/14/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/14/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/14/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/14/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/14/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/14/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/14/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/14/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/14/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/14/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/14/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/14/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/14/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/14/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/14/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/14/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/14/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/14/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/14/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/14/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 05/15/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/15/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/15/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/15/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/15/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/15/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/15/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/15/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/15/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/15/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/15/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/15/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/15/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/15/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/15/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/15/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/15/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/15/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/15/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/15/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/15/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/15/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/15/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/15/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 05/16/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/16/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/16/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/16/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/16/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/16/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/16/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/16/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/16/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/16/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/16/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/16/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/16/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/16/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/16/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/16/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/16/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/16/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/16/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/16/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/16/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/16/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/16/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/16/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 05/17/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/17/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/17/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/17/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/17/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/17/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/17/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/17/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/17/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/17/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/17/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/17/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/17/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/17/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/17/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/17/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/17/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/17/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/17/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/17/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/17/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/17/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/17/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/17/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 05/18/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/18/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/18/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/18/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/18/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/18/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/18/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/18/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/18/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/18/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/18/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/18/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/18/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/18/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/18/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/18/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/18/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/18/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/18/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/18/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/18/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/18/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/18/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/18/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 05/19/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/19/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/19/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/19/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/19/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/19/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/19/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/19/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/19/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/19/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/19/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/19/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/19/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/19/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/19/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/19/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/19/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/19/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/19/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/19/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/19/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/19/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/19/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/19/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 05/20/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/20/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/20/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/20/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/20/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/20/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/20/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/20/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/20/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/20/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/20/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/20/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/20/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/20/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/20/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/20/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/20/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/20/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/20/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/20/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/20/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/20/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/20/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/20/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 05/21/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/21/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/21/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/21/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/21/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/21/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/21/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/21/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/21/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/21/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/21/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/21/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/21/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/21/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/21/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/21/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/21/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/21/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/21/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/21/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/21/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/21/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/21/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/21/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 05/22/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/22/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/22/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/22/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/22/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/22/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/22/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/22/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/22/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/22/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/22/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/22/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/22/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/22/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/22/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/22/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/22/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/22/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/22/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/22/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/22/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/22/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/22/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/22/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 05/23/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/23/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/23/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/23/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/23/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/23/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/23/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/23/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/23/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/23/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/23/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/23/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/23/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/23/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/23/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/23/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/23/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/23/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/23/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/23/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/23/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/23/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/23/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/23/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 05/24/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/24/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/24/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/24/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/24/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/24/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/24/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/24/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/24/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/24/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/24/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/24/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/24/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/24/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/24/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/24/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/24/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/24/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/24/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/24/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/24/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/24/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/24/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/24/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 05/25/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/25/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/25/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/25/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/25/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/25/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/25/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/25/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/25/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/25/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/25/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/25/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/25/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/25/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/25/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/25/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/25/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/25/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/25/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/25/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/25/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/25/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/25/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/25/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 05/26/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/26/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/26/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/26/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/26/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/26/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/26/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/26/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/26/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/26/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/26/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/26/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/26/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/26/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/26/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/26/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/26/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/26/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/26/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/26/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/26/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/26/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/26/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/26/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 05/27/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/27/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/27/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/27/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/27/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/27/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/27/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/27/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/27/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/27/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/27/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/27/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/27/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/27/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/27/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/27/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/27/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/27/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/27/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/27/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/27/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/27/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/27/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/27/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 05/28/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/28/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/28/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/28/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/28/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/28/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/28/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/28/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/28/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/28/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/28/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/28/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/28/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/28/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/28/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/28/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/28/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/28/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/28/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/28/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/28/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/28/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/28/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/28/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 05/29/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/29/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/29/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/29/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/29/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/29/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/29/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/29/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/29/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/29/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/29/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/29/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/29/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/29/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/29/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/29/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/29/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/29/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/29/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/29/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/29/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/29/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/29/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/29/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 05/30/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/30/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/30/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/30/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/30/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/30/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/30/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/30/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/30/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/30/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/30/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/30/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/30/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/30/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/30/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/30/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/30/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/30/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/30/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/30/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/30/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/30/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/30/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/30/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 05/31/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/31/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/31/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/31/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/31/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/31/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/31/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/31/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/31/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/31/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/31/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/31/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/31/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/31/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/31/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/31/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/31/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/31/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/31/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/31/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/31/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/31/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/31/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 05/31/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 06/01/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/01/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/01/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/01/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/01/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/01/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/01/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/01/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/01/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/01/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/01/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/01/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/01/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/01/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/01/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/01/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/01/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/01/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/01/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/01/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/01/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/01/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/01/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/01/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 06/02/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/02/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/02/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/02/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/02/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/02/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/02/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/02/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/02/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/02/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/02/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/02/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/02/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/02/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/02/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/02/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/02/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/02/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/02/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/02/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/02/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/02/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/02/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/02/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 06/03/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/03/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/03/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/03/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/03/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/03/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/03/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/03/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/03/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/03/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/03/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/03/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/03/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/03/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/03/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/03/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/03/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/03/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/03/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/03/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/03/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/03/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/03/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/03/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 06/04/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/04/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/04/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/04/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/04/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/04/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/04/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/04/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/04/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/04/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/04/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/04/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/04/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/04/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/04/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/04/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/04/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/04/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/04/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/04/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/04/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/04/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/04/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/04/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 06/05/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/05/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/05/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/05/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/05/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/05/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/05/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/05/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/05/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/05/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/05/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/05/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/05/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/05/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/05/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/05/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/05/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/05/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/05/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/05/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/05/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/05/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/05/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/05/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 06/06/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/06/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/06/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/06/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/06/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/06/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/06/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/06/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/06/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/06/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/06/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/06/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/06/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/06/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/06/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/06/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/06/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/06/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/06/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/06/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/06/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/06/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/06/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/06/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 06/07/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/07/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/07/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/07/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/07/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/07/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/07/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/07/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/07/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/07/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/07/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/07/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/07/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/07/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/07/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/07/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/07/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/07/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/07/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/07/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/07/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/07/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/07/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/07/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 06/08/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/08/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/08/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/08/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/08/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/08/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/08/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/08/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/08/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/08/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/08/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/08/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/08/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/08/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/08/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/08/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/08/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/08/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/08/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/08/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/08/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/08/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/08/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/08/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 06/09/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/09/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/09/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/09/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/09/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/09/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/09/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/09/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/09/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/09/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/09/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/09/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/09/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/09/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/09/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/09/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/09/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/09/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/09/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/09/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/09/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/09/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/09/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/09/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 06/10/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/10/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/10/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/10/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/10/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/10/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/10/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/10/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/10/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/10/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/10/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/10/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/10/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/10/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/10/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/10/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/10/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/10/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/10/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/10/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/10/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/10/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/10/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/10/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 06/11/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/11/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/11/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/11/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/11/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/11/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/11/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/11/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/11/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/11/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/11/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/11/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/11/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/11/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/11/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/11/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/11/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/11/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/11/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/11/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/11/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/11/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/11/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/11/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 06/12/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/12/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/12/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/12/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/12/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/12/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/12/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/12/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/12/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/12/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/12/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/12/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/12/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/12/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/12/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/12/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/12/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/12/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/12/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/12/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/12/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/12/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/12/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/12/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 06/13/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/13/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/13/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/13/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/13/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/13/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/13/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/13/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/13/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/13/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/13/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/13/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/13/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/13/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/13/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/13/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/13/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/13/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/13/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/13/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/13/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/13/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/13/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/13/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 06/14/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/14/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/14/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/14/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/14/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/14/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/14/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/14/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/14/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/14/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/14/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/14/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/14/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/14/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/14/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/14/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/14/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/14/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/14/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/14/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/14/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/14/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/14/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/14/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 06/15/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/15/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/15/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/15/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/15/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/15/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/15/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/15/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/15/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/15/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/15/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/15/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/15/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/15/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/15/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/15/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/15/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/15/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/15/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/15/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/15/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/15/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/15/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/15/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 06/16/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/16/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/16/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/16/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/16/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/16/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/16/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/16/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/16/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/16/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/16/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/16/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/16/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/16/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/16/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/16/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/16/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/16/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/16/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/16/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/16/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/16/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/16/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/16/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 06/17/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/17/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/17/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/17/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/17/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/17/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/17/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/17/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/17/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/17/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/17/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/17/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/17/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/17/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/17/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/17/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/17/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/17/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/17/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/17/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/17/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/17/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/17/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/17/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 06/18/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/18/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/18/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/18/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/18/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/18/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/18/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/18/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/18/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/18/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/18/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/18/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/18/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/18/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/18/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/18/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/18/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/18/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/18/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/18/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/18/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/18/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/18/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/18/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 06/19/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/19/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/19/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/19/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/19/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/19/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/19/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/19/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/19/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/19/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/19/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/19/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/19/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/19/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/19/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/19/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/19/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/19/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/19/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/19/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/19/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/19/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/19/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/19/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 06/20/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/20/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/20/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/20/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/20/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/20/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/20/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/20/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/20/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/20/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/20/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/20/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/20/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/20/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/20/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/20/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/20/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/20/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/20/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/20/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/20/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/20/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/20/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/20/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 06/21/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/21/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/21/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/21/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/21/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/21/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/21/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/21/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/21/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/21/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/21/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/21/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/21/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/21/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/21/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/21/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/21/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/21/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/21/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/21/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/21/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/21/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/21/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/21/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 06/22/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/22/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/22/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/22/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/22/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/22/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/22/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/22/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/22/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/22/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/22/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/22/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/22/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/22/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/22/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/22/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/22/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/22/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/22/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/22/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/22/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/22/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/22/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/22/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 06/23/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/23/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/23/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/23/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/23/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/23/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/23/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/23/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/23/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/23/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/23/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/23/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/23/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/23/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/23/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/23/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/23/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/23/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/23/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/23/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/23/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/23/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/23/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/23/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 06/24/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/24/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/24/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/24/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/24/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/24/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/24/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/24/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/24/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/24/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/24/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/24/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/24/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/24/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/24/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/24/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/24/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/24/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/24/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/24/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/24/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/24/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/24/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/24/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 06/25/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/25/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/25/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/25/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/25/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/25/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/25/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/25/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/25/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/25/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/25/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/25/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/25/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/25/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/25/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/25/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/25/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/25/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/25/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/25/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/25/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/25/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/25/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/25/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 06/26/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/26/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/26/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/26/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/26/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/26/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/26/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/26/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/26/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/26/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/26/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/26/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/26/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/26/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/26/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/26/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/26/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/26/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/26/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/26/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/26/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/26/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/26/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/26/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 06/27/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/27/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/27/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/27/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/27/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/27/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/27/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/27/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/27/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/27/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/27/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/27/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/27/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/27/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/27/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/27/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/27/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/27/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/27/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/27/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/27/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/27/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/27/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/27/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 06/28/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/28/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/28/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/28/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/28/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/28/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/28/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/28/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/28/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/28/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/28/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/28/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/28/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/28/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/28/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/28/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/28/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/28/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/28/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/28/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/28/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/28/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/28/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/28/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 06/29/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/29/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/29/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/29/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/29/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/29/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/29/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/29/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/29/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/29/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/29/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/29/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/29/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/29/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/29/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/29/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/29/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/29/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/29/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/29/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/29/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/29/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/29/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/29/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

# NH3 Slip Daily Summary

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:00 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Const. Value/Limit Tag:** > 10

| | Unit CT2 NH3Slip, Ppmvdc 1 Hour(s) | Unit CT2 NOx, Ppm 1 Hour(s) | Unit CT2 NOx, _SCR, Ppm 1 Hour(s) | Unit CT2 O2, Dry, Pct 1 Hour(s) | Unit CT2 NH3Inj, LbPerHr 1 Hour(s) | Unit CT2 ExhaustFlow, LbPerHr 1 Hour(s) | Unit CT2 SUSD, Hr 1 Hour(s) | Unit CT2 OperatingTime, Hr 1 Hour(s) |
|---|---|---|---|---|---|---|---|---|
| 06/30/2023 00:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/30/2023 01:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/30/2023 02:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/30/2023 03:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/30/2023 04:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/30/2023 05:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/30/2023 06:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/30/2023 07:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/30/2023 08:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/30/2023 09:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/30/2023 10:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/30/2023 11:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/30/2023 12:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/30/2023 13:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/30/2023 14:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/30/2023 15:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/30/2023 16:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/30/2023 17:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/30/2023 18:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/30/2023 19:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/30/2023 20:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/30/2023 21:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/30/2023 22:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| 06/30/2023 23:00 | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Average/Sum#: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 # | 0.00 # |
| Minimum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| Maximum: | 0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 |
| %SI | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 100.00 | 0.00 | 0.00 |

**ATTACHMENT 15**

# AQ-55

**AQ-55** The emissions rates from each gas turbine and heat recovery steam generator exhaust during startup and shutdown shall not exceed the following:

| **Turbine emissions limitations during Startup and Shutdown** | | |
|---|---|---|
| **Pollutant** | **Max Lbs/ Hr (worst case turbine** | **Pounds per Startup or Shutdown (both turbines combined)** |
| **NOx** | **37.1** | **122.8** |
| **CO** | **89.5** | **204.8** |

**Verification:** The Project owner shall include all necessary emissions data to demonstrate compliance with the emissions limits provided in this Condition as part of the Quarterly Air Quality Report required in Condition of Certification AQ-SC6.

# Monthly Summary By Day Report

## Units CT1 and CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 21:40 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Limit Value:**

| | Units CT1 & CT2 CO, Lb 1 Hour(s) | Units CT1 & CT2 NOx, Lb 1 Hour(s) | Units CT1 & CT2 SO2, Lb 1 Hour(s) | Units CT1 & CT2 PM10, Lb 1 Hour(s) | Units CT1 & CT2 VOC, Lb 1 Hour(s) |
|---|---|---|---|---|---|
| 04/01/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/02/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/03/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/04/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/05/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/06/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/07/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/08/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/09/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/10/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/11/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/12/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/13/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/14/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/15/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/16/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/17/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/18/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/19/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/20/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/21/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/22/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/23/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/24/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/25/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/26/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/27/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/28/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/29/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/30/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| Monthly Avg/Sum: | 0.00 sum | 0.00 sum | 0.00 sum | 0.00 sum | 0.00 sum |
| Daily Min: | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| Daily Max: | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| Apr 2023 - Apr 2023 | 0.00 sum | 0.00 sum | 0.00 sum | 0.00 sum | 0.00 sum |
| **QTD:** | 0.00 sum | 0.00 sum | 0.00 sum | 0.00 sum | 0.00 sum |
| **YTD 2023:** | 5,382.86 sum | 6,277.77 sum | 625.15 sum | 1,248.91 sum | 2,081.24 sum |

# Monthly Summary By Day Report

## Units CT1 and CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 21:40 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Limit Value:**

| | Units CT1 & CT2 CO, Lb 1 Hour(s) | Units CT1 & CT2 NOx, Lb 1 Hour(s) | Units CT1 & CT2 SO2, Lb 1 Hour(s) | Units CT1 & CT2 PM10, Lb 1 Hour(s) | Units CT1 & CT2 VOC, Lb 1 Hour(s) |
|---|---|---|---|---|---|
| 05/01/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/02/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/03/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/04/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/05/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/06/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/07/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/08/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/09/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/10/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/11/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/12/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/13/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/14/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/15/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/16/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/17/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/18/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/19/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/20/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/21/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/22/2023 | 412.55 | 31.76 | 0.19 | 0.36 | 0.61 |
| 05/23/2023 | 14.14 | 10.48 | 1.23 | 2.43 | 4.06 |
| 05/24/2023 | 50.78 | 19.62 | 0.90 | 1.83 | 3.05 |
| 05/25/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/26/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/27/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/28/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/29/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/30/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/31/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| Monthly Avg/Sum: | 477.47 sum | 61.86 sum | 2.32 sum | 4.62 sum | 7.72 sum |
| Daily Min: | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| Daily Max: | 412.55 | 31.76 | 1.23 | 2.43 | 4.06 |
| Apr 2023 - May 2023 | 477.47 sum | 61.86 sum | 2.32 sum | 4.62 sum | 7.72 sum |
| **QTD:** | 477.47 sum | 61.86 sum | 2.32 sum | 4.62 sum | 7.72 sum |
| **YTD 2023:** | 5,860.33 sum | 6,339.63 sum | 627.47 sum | 1,253.53 sum | 2,088.96 sum |

# Monthly Summary By Day Report

## Units CT1 and CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 21:40 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Limit Value:**

| | Units CT1 & CT2 CO, Lb 1 Hour(s) | Units CT1 & CT2 NOx, Lb 1 Hour(s) | Units CT1 & CT2 SO2, Lb 1 Hour(s) | Units CT1 & CT2 PM10, Lb 1 Hour(s) | Units CT1 & CT2 VOC, Lb 1 Hour(s) |
|---|---|---|---|---|---|
| 06/01/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/02/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/03/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/04/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/05/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/06/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/07/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/08/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/09/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/10/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/11/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/12/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/13/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/14/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/15/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/16/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/17/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/18/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/19/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/20/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/21/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/22/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/23/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/24/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/25/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/26/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/27/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/28/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/29/2023 | 55.41 | 49.90 | 4.41 | 8.86 | 14.75 |
| 06/30/2023 | 17.21 | 65.68 | 7.08 | 14.19 | 23.63 |
| Monthly Avg/Sum: | 72.62 sum | 115.58 sum | 11.49 sum | 23.05 sum | 38.38 sum |
| Daily Min: | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| Daily Max: | 55.41 | 65.68 | 7.08 | 14.19 | 23.63 |
| Apr 2023 - Jun 2023 | 550.09 sum | 177.44 sum | 13.81 sum | 27.67 sum | 46.10 sum |
| **QTD:** | 550.09 sum | 177.44 sum | 13.81 sum | 27.67 sum | 46.10 sum |
| **YTD 2023:** | 5,932.95 sum | 6,455.21 sum | 638.96 sum | 1,276.58 sum | 2,127.34 sum |

# Monthly Summary By Day Report

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY
**Generated:** 07/07/2023 21:40 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Limit Value:**

| | Unit CT1 CO_SUSD, LbPerHr 1 Hour(s) | Unit CT1 NOx_SUSD, LbPerHr 1 Hour(s) | Unit CT2 CO_SUSD, LbPerHr 1 Hour(s) | Unit CT2 NOx_SUSD, LbPerHr 1 Hour(s) |
|---|---|---|---|---|
| 04/01/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/02/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/03/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/04/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/05/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/06/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/07/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/08/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/09/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/10/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/11/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/12/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/13/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/14/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/15/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/16/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/17/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/18/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/19/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/20/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/21/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/22/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/23/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/24/2023 | 0.1 | 0.0 | 0.0 | 0.0 |
| 04/25/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 04/26/2023 | 0.1 | 0.0 | 0.0 | 0.0 |
| 04/27/2023 | 3.7 | 0.0 | 0.0 | 0.0 |
| 04/28/2023 | 0.5 | 0.0 | 0.0 | 0.0 |
| 04/29/2023 | 0.3 | 0.0 | 0.0 | 0.0 |
| 04/30/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| Monthly Avg/Sum: | 4.7 sum | 0.0 sum | 0.0 sum | 0.0 sum |
| Daily Min: | 0.0 | 0.0 | 0.0 | 0.0 |
| Daily Max: | 3.7 | 0.0 | 0.0 | 0.0 |
| Apr 2023 - Apr 2023 | 4.7 sum | 0.0 sum | 0.0 sum | 0.0 sum |
| **QTD:** | 4.7 sum | 0.0 sum | 0.0 sum | 0.0 sum |
| **YTD 2023:** | 1,638.9 sum | 282.3 sum | 1,430.4 sum | 337.0 sum |

# Monthly Summary By Day Report

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY
**Generated:** 07/07/2023 21:40 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Limit Value:**

| | Unit CT1 CO_SUSD, LbPerHr 1 Hour(s) | Unit CT1 NOx_SUSD, LbPerHr 1 Hour(s) | Unit CT2 CO_SUSD, LbPerHr 1 Hour(s) | Unit CT2 NOx_SUSD, LbPerHr 1 Hour(s) |
|---|---|---|---|---|
| 05/01/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/02/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/03/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/04/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/05/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/06/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/07/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/08/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/09/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/10/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/11/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/12/2023 | 0.3 | 0.0 | 0.0 | 0.0 |
| 05/13/2023 | 3.2 | 0.0 | 0.0 | 0.0 |
| 05/14/2023 | 0.9 | 0.0 | 0.0 | 0.0 |
| 05/15/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/16/2023 | 1.2 | 0.0 | 0.0 | 0.0 |
| 05/17/2023 | 2.0 | 0.0 | 0.0 | 0.0 |
| 05/18/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/19/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/20/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/21/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/22/2023 | 397.9 | 30.5 | 0.0 | 0.0 |
| 05/23/2023 | 28.2 | 1.7 | 0.0 | 0.0 |
| 05/24/2023 | 47.9 | 13.3 | 0.0 | 0.0 |
| 05/25/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/26/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/27/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/28/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/29/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/30/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 05/31/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| Monthly Avg/Sum: | 481.6 sum | 45.5 sum | 0.0 sum | 0.0 sum |
| Daily Min: | 0.0 | 0.0 | 0.0 | 0.0 |
| Daily Max: | 397.9 | 30.5 | 0.0 | 0.0 |
| Apr 2023 - May 2023 | 486.3 sum | 45.5 sum | 0.0 sum | 0.0 sum |
| **QTD:** | 486.3 sum | 45.5 sum | 0.0 sum | 0.0 sum |
| **YTD 2023:** | 2,120.5 sum | 327.8 sum | 1,430.4 sum | 337.0 sum |

# Monthly Summary By Day Report

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY
**Generated:** 07/07/2023 21:40 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Limit Value:**

| | Unit CT1 CO_SUSD, LbPerHr 1 Hour(s) | Unit CT1 NOx_SUSD, LbPerHr 1 Hour(s) | Unit CT2 CO_SUSD, LbPerHr 1 Hour(s) | Unit CT2 NOx_SUSD, LbPerHr 1 Hour(s) |
|---|---|---|---|---|
| 06/01/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/02/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/03/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/04/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/05/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/06/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/07/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/08/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/09/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/10/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/11/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/12/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/13/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/14/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/15/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/16/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/17/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/18/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/19/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/20/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/21/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/22/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/23/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/24/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/25/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/26/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/27/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/28/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| 06/29/2023 | 43.5 | 10.6 | 0.0 | 0.0 |
| 06/30/2023 | 0.0 | 0.0 | 0.0 | 0.0 |
| Monthly Avg/Sum: | 43.5 sum | 10.6 sum | 0.0 sum | 0.0 sum |
| Daily Min: | 0.0 | 0.0 | 0.0 | 0.0 |
| Daily Max: | 43.5 | 10.6 | 0.0 | 0.0 |
| Apr 2023 - Jun 2023 | 529.8 sum | 56.1 sum | 0.0 sum | 0.0 sum |
| **QTD:** | 529.8 sum | 56.1 sum | 0.0 sum | 0.0 sum |
| **YTD 2023:** | 2,164.0 sum | 338.4 sum | 1,430.4 sum | 337.0 sum |

# Startup / Shutdown Events

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY
**Generated:** 07/07/2023 21:30 **Location:** Roseville, CA

### Unit Offline

**Tag Name:** CT1_UnitOn_TF_1H

| Offline Periods | | |
|---|---|---|
| **Start Time** | **End Time** | **Duration in Hour(s)** |
| 04/01/2023 00:00 | 05/22/2023 14:00 | 1239 |
| 05/22/2023 17:00 | 05/23/2023 11:00 | 19 |
| 05/23/2023 19:00 | 05/24/2023 08:00 | 14 |
| 05/24/2023 15:00 | 06/29/2023 06:00 | 856 |

# Startup / Shutdown Events

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY
**Generated:** 07/07/2023 21:30 **Location:** Roseville, CA

| Operating Time Summary | |
|---|---|
| Available Data for Report (excludes missing data): | 2,184.00 Hour(s) |
| Total Offline: | 2,128.00 Hour(s) |
| Offline Percentage: | 97.44 % |
| Total Online: | 56.00 Hour(s) |
| Online Percentage: | 2.56 % |

# Startup / Shutdown Events

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY
**Generated:** 07/07/2023 21:30 **Location:** Roseville, CA

### Startup/Shutdown

| Number | Start Time | End Time | Event Type | Duration |
|---|---|---|---|---|
| 1 | 05/22/2023 15:22 | 05/22/2023 16:42 | Cold Startup | 81 |
| 2 | 05/22/2023 16:51 | 05/22/2023 16:51 | Shutdown | 1 |
| 3 | 05/23/2023 12:43 | 05/23/2023 13:36 | Cold Startup | 54 |
| 4 | 05/23/2023 17:57 | 05/23/2023 18:07 | Shutdown | 11 |
| 5 | 05/24/2023 09:44 | 05/24/2023 10:46 | Cold Startup | 63 |
| 6 | 05/24/2023 13:54 | 05/24/2023 14:06 | Shutdown | 13 |
| 7 | 06/29/2023 07:26 | 06/29/2023 08:33 | Cold Startup | 68 |

# Startup / Shutdown Events

## CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY
**Generated:** 07/07/2023 21:30 **Location:** Roseville, CA

### Startup/Shutdown Event Summary

| | # Events | Duration | Duration % |
|---|---|---|---|
| Cold Startup | 4 | 266 | 8.55 |
| Warm Startup | 0 | | 0.00 |
| Shutdown | 3 | 25 | 0.80 |
| Total Process Events: | 7 | 291 | 9.35 |

| | |
|---|---|
| Total Report Time: | 2,183.98 Hour(s) |
| Total Operating Time: | 51.87 Hour(s) |
| Total Startup Time: | 266 Minute(s) |
| Total Shutdown Time: | 25 Minute(s) |
| Total Startup/Shutdown Time: | 291 Minute(s) |
| Total Startup/Shutdown Time as a Percentage of Total Operating Time: | 9.35 % |

# Startup / Shutdown Events

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY
**Generated:** 07/07/2023 21:39 **Location:** Roseville, CA

## Unit Offline

**Tag Name:** CT2_UnitOn_TF_1H

| Offline Periods | | |
|---|---|---|
| **Start Time** | **End Time** | **Duration in Hour(s)** |
| 04/01/2023 00:00 | 06/30/2023 23:00 | 2184 |

# Startup / Shutdown Events

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY
**Generated:** 07/07/2023 21:39 **Location:** Roseville, CA

| Operating Time Summary | |
|---|---|
| Available Data for Report (excludes missing data): | 2,184.00 Hour(s) |
| Total Offline: | 2,184.00 Hour(s) |
| Offline Percentage: | 100.00 % |
| Total Online: | 0.00 Hour(s) |
| Online Percentage: | 0.00 % |

# Startup / Shutdown Events

## CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY
**Generated:** 07/07/2023 21:39 **Location:** Roseville, CA

No startup/shutdown events found.

# CT1 SUSD EVENT 1

| | CT1_GasFlow_CT_scfh_1M | | | CT1_CO_Ppmvdc_1M | | | CT1_NOx_Ppmvdc_1M | | | CT1_CO_LbPerHr_1M | | | CT1_NOx_LbPerHr_1M | | | CT1_SUSD_TF_1M | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 05/22/23 15:17 | 51831.8 | | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | |
| 05/22/23 15:18 | 51831.8 | | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | |
| 05/22/23 15:19 | 51754.7 | | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | |
| 05/22/23 15:20 | 51754.7 | | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | |
| 05/22/23 15:21 | 58147.1 | | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | |
| 05/22/23 15:22 | 57685 | | | 0 | | | 0 | | | 0 | | | 0 | | | 1 | |
| 05/22/23 15:23 | 57453.9 | | | 0 | | | 0 | | | 0 | | | 0 | | | 1 | |
| 05/22/23 15:24 | 60380.5 | | | 1.1 | | | 0 | | | 0 | | | 0 | | | 1 | |
| 05/22/23 15:25 | 67312 | | | 981.6 | | | 11.8 | | | 154.25 | | | 3.05 | | | 1 | |
| 05/22/23 15:26 | 76091.8 | | | 830.9 | | | 13.88 | | | 147.67 | | | 4.06 | | | 1 | |
| 05/22/23 15:27 | 86951 | | | 417.4 | | | 20.06 | | | 84.75 | | | 6.7 | | | 1 | |
| 05/22/23 15:28 | 119528.8 | | | 206 | | | 24.94 | | | 57.49 | | | 11.46 | | | 1 | |
| 05/22/23 15:29 | 143942.9 | | | 107.6 | | | 42.95 | | | 36.16 | | | 23.75 | | | 1 | |
| 05/22/23 15:30 | 140785.2 | | | 65.5 | | | 59.95 | | | 21.51 | | | 32.42 | | | 1 | |
| 05/22/23 15:31 | 137242.5 | | | 1468.2 | | | 44.43 | | | 470.29 | | | 23.42 | | | 1 | |
| 05/22/23 15:32 | 137550.5 | | | 2044.1 | | | 43.58 | | | 656.59 | | | 23.04 | | | 1 | |
| 05/22/23 15:33 | 136241.3 | | | 2112.2 | | | 45.63 | | | 671.86 | | | 23.89 | | | 1 | |
| 05/22/23 15:34 | 136395.3 | | | 2112.2 | | | 47.79 | | | 672.81 | | | 25.05 | | | 1 | |
| 05/22/23 15:35 | 135009 | | | 2112.2 | | | 53.69 | | | 665.71 | | | 27.85 | | | 1 | |
| 05/22/23 15:36 | 135394.1 | | | 2112.2 | | | 60.38 | | | 667.61 | | | 31.41 | | | 1 | |
| 05/22/23 15:37 | 134392.9 | | | 2185 | | | 66.32 | | | 685.73 | | | 34.26 | | | 1 | |
| 05/22/23 15:38 | 134392.9 | | | 2185 | | | 66.73 | | | 685.73 | | | 34.47 | | | 1 | |
| 05/22/23 15:39 | 134700.9 | | | 2185 | | | 65.92 | | | 687.2 | | | 34.12 | | | 1 | |
| 05/22/23 15:40 | 133468.7 | | | 2185 | | | 64.7 | | | 680.84 | | | 33.18 | | | 1 | |
| 05/22/23 15:41 | 134084.8 | | | 2185 | | | 63.27 | | | 683.78 | | | 32.59 | | | 1 | |
| 05/22/23 15:42 | 133314.6 | | | 2185 | | | 62.26 | | | 679.87 | | | 31.88 | | | 1 | |
| 05/22/23 15:43 | 133314.6 | | | 2185 | | | 61.64 | | | 679.87 | | | 31.57 | | | 1 | |
| 05/22/23 15:44 | 133160.6 | | | 2185 | | | 60.63 | | | 679.38 | | | 31.02 | | | 1 | |
| 05/22/23 15:45 | 132544.5 | | | 2185 | | | 59.61 | | | 675.95 | | | 30.35 | | | 1 | |
| 05/22/23 15:46 | 133391.7 | | | 2185 | | | 58.8 | | | 680.35 | | | 30.13 | | | 1 | |
| 05/22/23 15:47 | 132698.5 | | | 2185 | | | 57.78 | | | 676.93 | | | 29.46 | | | 1 | |
| 05/22/23 15:48 | 133006.6 | | | 2185 | | | 56.97 | | | 678.4 | | | 29.11 | | | 1 | |

| | CT1_GasFlow_CT_scfh_1M | | | CT1_CO_Ppmvdc_1M | | | CT1_NOx_Ppmvdc_1M | | | CT1_CO_LbPerHr_1M | | | CT1_NOx_LbPerHr_1M | | | CT1_SUSD_TF_1M | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 05/22/23 15:49 | 132159.4 | | | 2185 | | | 56.15 | | | 674 | | | 28.51 | | | 1 | |
| 05/22/23 15:50 | 132621.5 | | | 2185 | | | 55.13 | | | 676.44 | | | 28.09 | | | 1 | |
| 05/22/23 15:51 | 131697.3 | | | 2185 | | | 54.52 | | | 672.04 | | | 27.6 | | | 1 | |
| 05/22/23 15:52 | 132313.4 | | | 2263.9 | | | 55.63 | | | 699.34 | | | 28.28 | | | 1 | |
| 05/22/23 15:53 | 131697.3 | | | 2265.2 | | | 55 | | | 696.69 | | | 27.84 | | | 1 | |
| 05/22/23 15:54 | 132082.4 | | | 2265.2 | | | 54.36 | | | 698.72 | | | 27.6 | | | 1 | |
| 05/22/23 15:55 | 131697.3 | | | 2265.2 | | | 53.73 | | | 696.69 | | | 27.2 | | | 1 | |
| 05/22/23 15:56 | 131235.2 | | | 2265.2 | | | 53.1 | | | 694.15 | | | 26.78 | | | 1 | |
| 05/22/23 15:57 | 132005.4 | | | 2265 | | | 52.68 | | | 698.15 | | | 26.72 | | | 1 | |
| 05/22/23 15:58 | 131543.3 | | | 2263.9 | | | 52.05 | | | 695.29 | | | 26.31 | | | 1 | |
| 05/22/23 15:59 | 131081.2 | | | 2263.1 | | | 51.41 | | | 692.49 | | | 25.89 | | | 1 | |
| 05/22/23 16:00 | 131466.3 | | | 2265 | | | 50.99 | | | 695.1 | | | 25.76 | | | 1 | |
| 05/22/23 16:01 | 131543.3 | | | 2265.2 | | | 50.36 | | | 695.68 | | | 25.45 | | | 1 | |
| 05/22/23 16:02 | 130927.2 | | | 2265.2 | | | 49.94 | | | 692.63 | | | 25.13 | | | 1 | |
| 05/22/23 16:03 | 169589.2 | | | 2265.2 | | | 49.52 | | | 896.97 | | | 32.27 | | | 1 | |
| 05/22/23 16:04 | 185685.5 | | | 1375.6 | | | 57.93 | | | 596.44 | | | 41.34 | | | 1 | |
| 05/22/23 16:05 | 196775.8 | | | 168.5 | | | 50.08 | | | 77.4 | | | 37.86 | | | 1 | |
| 05/22/23 16:06 | 197931 | | | 23.2 | | | 45.79 | | | 10.73 | | | 34.82 | | | 1 | |
| 05/22/23 16:07 | 198316.1 | | | 10.4 | | | 45.94 | | | 4.82 | | | 35 | | | 1 | |
| 05/22/23 16:08 | 198778.2 | | | 9.5 | | | 46.32 | | | 4.43 | | | 35.38 | | | 1 | |
| 05/22/23 16:09 | 198547.2 | | | 9 | | | 46.07 | | | 4.19 | | | 35.15 | | | 1 | |
| 05/22/23 16:10 | 198778.2 | | | 8.4 | | | 45.94 | | | 3.9 | | | 35.09 | | | 1 | |
| 05/22/23 16:11 | 198239.1 | | | 8 | | | 46.07 | | | 3.72 | | | 35.1 | | | 1 | |
| 05/22/23 16:12 | 198547.2 | | | 7.7 | | | 46.32 | | | 3.55 | | | 35.34 | | | 1 | |
| 05/22/23 16:13 | 199163.3 | | | 7.5 | | | 46.82 | | | 3.5 | | | 35.83 | | | 1 | |
| 05/22/23 16:14 | 199086.3 | | | 7.5 | | | 47.45 | | | 3.5 | | | 36.31 | | | 1 | |
| 05/22/23 16:15 | 198624.2 | | | 7.5 | | | 48.33 | | | 3.49 | | | 36.89 | | | 1 | |
| 05/22/23 16:16 | 198239.1 | | | 7.4 | | | 49.33 | | | 3.43 | | | 37.58 | | | 1 | |
| 05/22/23 16:17 | 201704.8 | | | 7.3 | | | 50.59 | | | 3.43 | | | 39.21 | | | 1 | |
| 05/22/23 16:18 | 220419.7 | | | 7 | | | 53.35 | | | 3.62 | | | 45.19 | | | 1 | |
| 05/22/23 16:19 | 243909.6 | | | 5.8 | | | 56.17 | | | 3.29 | | | 52.64 | | | 1 | |
| 05/22/23 16:20 | 267707.5 | | | 4.3 | | | 47.63 | | | 2.68 | | | 48.99 | | | 1 | |
| 05/22/23 16:21 | 274253.9 | | | 3.2 | | | 19.89 | | | 2.07 | | | 20.96 | | | 1 | |
| 05/22/23 16:22 | 275486.1 | | | 3.4 | | | 13 | | | 2.19 | | | 13.76 | | | 1 | |

| | CT1_GasFlow_CT_scfh_1M | | | CT1_CO_Ppmvdc_1M | | | CT1_NOx_Ppmvdc_1M | | | CT1_CO_LbPerHr_1M | | | CT1_NOx_LbPerHr_1M | | | CT1_SUSD_TF_1M | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 05/22/23 16:23 | 317382.8 | | | 4.1 | | | 11.8 | | | 3.05 | | | 14.39 | | | 1 | |
| 05/22/23 16:24 | 342875.1 | | | 4.4 | | | 11.24 | | | 3.52 | | | 14.8 | | | 1 | |
| 05/22/23 16:25 | 285421.2 | | | 4.2 | | | 11.14 | | | 2.81 | | | 12.22 | | | 1 | |
| 05/22/23 16:26 | 278104.7 | | | 3.9 | | | 9.42 | | | 2.53 | | | 10.07 | | | 1 | |
| 05/22/23 16:27 | 279259.9 | | | 3.8 | | | 5.9 | | | 2.48 | | | 6.33 | | | 1 | |
| 05/22/23 16:28 | 286961.5 | | | 3.8 | | | 5.04 | | | 2.55 | | | 5.56 | | | 1 | |
| 05/22/23 16:29 | 274793 | | | 3.7 | | | 5.71 | | | 2.38 | | | 6.03 | | | 1 | |
| 05/22/23 16:30 | 278104.7 | | | 3.4 | | | 6.85 | | | 2.22 | | | 7.32 | | | 1 | |
| 05/22/23 16:31 | 282571.6 | | | 3.3 | | | 5.9 | | | 2.2 | | | 6.41 | | | 1 | |
| 05/22/23 16:32 | 278412.8 | | | 3.5 | | | 2.47 | | | 2.29 | | | 2.65 | | | 1 | |
| 05/22/23 16:33 | 285267.2 | | | 3.6 | | | 1.71 | | | 2.41 | | | 1.88 | | | 1 | |
| 05/22/23 16:34 | 291197.4 | | | 3.4 | | | 2.19 | | | 2.33 | | | 2.45 | | | 1 | |
| 05/22/23 16:35 | 286191.3 | | | 3.3 | | | 2.95 | | | 2.23 | | | 3.24 | | | 1 | |
| 05/22/23 16:36 | 314148.2 | | | 3.2 | | | 3.05 | | | 2.37 | | | 3.68 | | | 1 | |
| 05/22/23 16:37 | 290504.3 | | | 3.2 | | | 2.28 | | | 2.19 | | | 2.55 | | | 1 | |
| 05/22/23 16:38 | 285960.3 | | | 3.1 | | | 2 | | | 2.1 | | | 2.2 | | | 1 | |
| 05/22/23 16:39 | 313455 | | | 3.2 | | | 1.81 | | | 2.37 | | | 2.18 | | | 1 | |
| 05/22/23 16:40 | 281724.4 | | | 3.3 | | | 1.52 | | | 2.19 | | | 1.65 | | | 1 | |
| 05/22/23 16:41 | 286730.5 | | | 3.5 | | | 1.24 | | | 2.36 | | | 1.36 | | | 1 | |
| 05/22/23 16:42 | 305137.3 | | | 3.4 | | | 1.05 | | | 2.44 | | | 1.23 | | | 1 | |
| 05/22/23 16:43 | 286961.5 | | | 3.1 | | | 0.95 | | | 2.1 | | | 1.05 | | | 0 | |
| 05/22/23 16:44 | 280107.1 | | | 3.2 | | | 0.86 | | | 2.12 | | | 0.92 | | | 0 | |
| 05/22/23 16:45 | 297281.7 | | | 3.4 | | | 0.76 | | | 2.38 | | | 0.87 | | | 0 | |
| 05/22/23 16:46 | 283726.8 | | | 3.4 | | | 0.76 | | | 2.27 | | | 0.83 | | | 0 | |
| 05/22/23 16:47 | 294509.1 | | | 3.3 | | | 0.67 | | | 2.29 | | | 0.75 | | | 0 | |

# CT1 SUSD EVENT 2

| | CT1_GasFlow_CT_scfh_1M | | | CT1_CO_Ppmvdc_1M | | | CT1_NOx_Ppmvdc_1M | | | CT1_CO_LbPerHr_1M | | | CT1_NOx_LbPerHr_1M | | | CT1_SUSD_TF_1M | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 05/22/23 16:46 | 283726.8 | | | 3.4 | | | 0.76 | | | 2.27 | | | 0.83 | | | 0 | |
| 05/22/23 16:47 | 294509.1 | | | 3.3 | | | 0.67 | | | 2.29 | | | 0.75 | | | 0 | |
| 05/22/23 16:48 | 296434.5 | | | 3 | | | 0.67 | | | 2.11 | | | 0.76 | | | 0 | |
| 05/22/23 16:49 | 309296.2 | | | 3.1 | | | 0.58 | | | 2.24 | | | 0.69 | | | 0 | |
| 05/22/23 16:50 | 289272 | | | 3.1 | | | 0.57 | | | 2.12 | | | 0.63 | | | 0 | |
| 05/22/23 16:51 | 170282.3 | | | 3.2 | | | 0.57 | | | 1.29 | | | 0.37 | | | 1 | |
| 05/22/23 16:52 | 52678.9 | | | 0 | | | 0.78 | | | 0.8 | | | 0.16 | | | 0 | |
| 05/22/23 16:53 | 52524.9 | | | 0 | | | 23.6 | | | 26.78 | | | 4.76 | | | 0 | |
| 05/22/23 16:54 | 52293.8 | | | 0 | | | 0.2 | | | 0 | | | 0 | | | 0 | |
| 05/22/23 16:55 | 52062.8 | | | 0 | | | 0 | | | 0 | | | 0 | | | 0 | |
| 05/22/23 16:56 | 51908.8 | | | 0 | | | 0 | | | 0 | | | 0 | | | 0 | |

# CT1 SUSD EVENT 3

| | CT1_GasFlow_CT_scfh_1M | | | CT1_CO_Ppmvdc_1M | | | CT1_NOx_Ppmvdc_1M | | | CT1_CO_LbPerHr_1M | | | CT1_NOx_LbPerHr_1M | | | CT1_SUSD_TF_1M | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 05/23/23 12:38 | 14941.1 | | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | |
| 05/23/23 12:39 | 15018.1 | | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | |
| 05/23/23 12:40 | 15557.2 | | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | |
| 05/23/23 12:41 | 15942.3 | | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | |
| 05/23/23 12:42 | 20255.2 | | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | |
| 05/23/23 12:43 | 26108.4 | | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 1 | |
| 05/23/23 12:44 | 29574.1 | | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 1 | |
| 05/23/23 12:45 | 38431 | | | 64.9 | X | | 41.3 | X | | 5.83 | X | | 6.1 | X | | 1 | |
| 05/23/23 12:46 | 49983.4 | | | 1083.8 | X | | 14.07 | X | | 126.4 | X | | 2.7 | X | | 1 | |
| 05/23/23 12:47 | 61689.8 | | | 813.2 | X | | 17.7 | X | | 117.04 | X | | 4.19 | X | | 1 | |
| 05/23/23 12:48 | 78864.4 | | | 416.2 | X | | 23.01 | X | | 76.68 | X | | 6.98 | X | | 1 | |
| 05/23/23 12:49 | 120530 | | | 243.2 | X | | 25.75 | X | | 68.44 | X | | 11.92 | X | | 1 | |
| 05/23/23 12:50 | 137396.5 | | | 149.1 | X | | 40.39 | X | | 47.82 | X | | 21.32 | X | | 1 | |
| 05/23/23 12:51 | 146253.3 | | | 307.8 | X | | 52.15 | X | | 105.06 | X | | 29.3 | X | | 1 | |
| 05/23/23 12:52 | 163890 | | | 1949.6 | X | | 47.38 | X | | 745.82 | X | | 29.83 | X | | 1 | |
| 05/23/23 12:53 | 186455.7 | | | 1601.9 | X | | 49.82 | X | | 697.42 | X | | 35.7 | X | | 1 | |
| 05/23/23 12:54 | 209714.5 | | | 315.7 | X | | 50.51 | X | | 154.56 | X | | 40.69 | X | | 1 | |
| 05/23/23 12:55 | 229507.6 | | | 35.9 | X | | 49.08 | X | | 19.24 | X | | 43.29 | X | | 1 | |
| 05/23/23 12:56 | 255230.9 | | | 2.3 | X | | 44.53 | X | | 1.39 | X | | 43.67 | X | | 1 | |
| 05/23/23 12:57 | 276410.3 | | | 1.5 | X | | 35.71 | X | | 0.98 | X | | 37.92 | X | | 1 | |
| 05/23/23 12:58 | 278335.7 | | | 1.5 | X | | 16.07 | X | | 0.94 | X | | 17.18 | X | | 1 | |
| 05/23/23 12:59 | 277488.6 | | | 1.6 | X | | 11.63 | X | | 1.01 | X | | 12.4 | X | | 1 | |
| 05/23/23 13:00 | 276102.3 | | | 1.6 | X | | 9.77 | X | | 1.02 | X | | 10.37 | X | | 1 | |
| 05/23/23 13:01 | 276256.3 | | | 1.4 | X | | 8.58 | X | | 0.92 | X | | 9.11 | X | | 1 | |
| 05/23/23 13:02 | 275640.2 | | | 1.3 | X | | 7.44 | X | | 0.82 | X | | 7.88 | X | | 1 | |
| 05/23/23 13:03 | 274793 | | | 1.2 | X | | 6.63 | X | | 0.76 | X | | 7 | X | | 1 | |
| 05/23/23 13:04 | 275024 | | | 1 | X | | 6.08 | X | | 0.64 | X | | 6.43 | X | | 1 | |
| 05/23/23 13:05 | 274561.9 | | | 0.9 | X | | 5.53 | X | | 0.59 | X | | 5.84 | X | | 1 | |
| 05/23/23 13:06 | 273560.7 | | | 0.8 | X | | 5.16 | X | | 0.53 | X | | 5.43 | X | | 1 | |
| 05/23/23 13:07 | 273868.8 | | | 0.7 | X | | 5.07 | X | | 0.47 | X | | 5.33 | X | | 1 | |
| 05/23/23 13:08 | 273483.7 | | | 0.7 | X | | 4.79 | X | | 0.47 | X | | 5.04 | X | | 1 | |
| 05/23/23 13:09 | 272867.6 | | | 0.6 | X | | 4.61 | X | | 0.41 | X | | 4.83 | X | | 1 | |

| | CT1_GasFlow_CT_scfh_1M | | | CT1_CO_Ppmvdc_1M | | | CT1_NOx_Ppmvdc_1M | | | CT1_CO_LbPerHr_1M | | | CT1_NOx_LbPerHr_1M | | | CT1_SUSD_TF_1M | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 05/23/23 13:10 | 272944.6 | | | 0.6 | X | | 4.43 | X | | 0.41 | X | | 4.64 | X | | 1 | |
| 05/23/23 13:11 | 272944.6 | | | 0.6 | X | | 4.31 | X | | 0.36 | X | | 4.52 | X | | 1 | |
| 05/23/23 13:12 | 271866.4 | | | 0.6 | X | | 4.21 | X | | 0.36 | X | | 4.4 | X | | 1 | |
| 05/23/23 13:13 | 271866.4 | | | 0.6 | X | | 4.21 | X | | 0.36 | X | | 4.4 | X | | 1 | |
| 05/23/23 13:14 | 272097.4 | | | 0.6 | X | | 4.12 | X | | 0.36 | X | | 4.31 | X | | 1 | |
| 05/23/23 13:15 | 272790.6 | | | 0.6 | X | | 4.12 | X | | 0.36 | X | | 4.32 | X | | 1 | |
| 05/23/23 13:16 | 270942.2 | | | 0.6 | X | | 4.12 | X | | 0.36 | X | | 4.29 | X | | 1 | |
| 05/23/23 13:17 | 271481.3 | | | 0.5 | X | | 4.21 | X | | 0.3 | X | | 4.4 | X | | 1 | |
| 05/23/23 13:18 | 271558.3 | | | 0.5 | X | | 4.4 | X | | 0.3 | X | | 4.59 | X | | 1 | |
| 05/23/23 13:19 | 270711.2 | | | 0.5 | X | | 4.59 | X | | 0.3 | X | | 4.77 | X | | 1 | |
| 05/23/23 13:20 | 270865.2 | | | 0.5 | X | | 4.87 | X | | 0.3 | X | | 5.07 | X | | 1 | |
| 05/23/23 13:21 | 270788.2 | | | 0.5 | X | | 5.15 | X | | 0.3 | X | | 5.36 | X | | 1 | |
| 05/23/23 13:22 | 271481.3 | | | 0.5 | X | | 5.43 | X | | 0.3 | X | | 5.67 | X | | 1 | |
| 05/23/23 13:23 | 270942.2 | | | 0.5 | X | | 5.62 | X | | 0.3 | X | | 5.85 | X | | 1 | |
| 05/23/23 13:24 | 270172 | | | 0.5 | X | | 5.9 | X | | 0.3 | X | | 6.13 | X | | 1 | |
| 05/23/23 13:25 | 270557.1 | | | 0.5 | X | | 6.18 | X | | 0.3 | X | | 6.43 | X | | 1 | |
| 05/23/23 13:26 | 270711.2 | | | 0.5 | X | | 6.46 | X | | 0.3 | X | | 6.72 | X | | 1 | |
| 05/23/23 13:27 | 270788.2 | | | 0.5 | X | | 6.65 | X | | 0.3 | X | | 6.92 | X | | 1 | |
| 05/23/23 13:28 | 269941 | | | 0.4 | X | | 6.93 | X | | 0.24 | X | | 7.19 | X | | 1 | |
| 05/23/23 13:29 | 271481.3 | | | 0.4 | X | | 6.18 | X | | 0.24 | X | | 6.45 | X | | 1 | |
| 05/23/23 13:30 | 285960.3 | | | 0.4 | X | | 4.78 | X | | 0.25 | X | | 5.25 | X | | 1 | |
| 05/23/23 13:31 | 304906.2 | | | 0.4 | X | | 3.65 | X | | 0.27 | X | | 4.28 | X | | 1 | |
| 05/23/23 13:32 | 322234.8 | | | 0.5 | X | | 2.58 | X | | 0.35 | X | | 3.2 | X | | 1 | |
| 05/23/23 13:33 | 333402.2 | | | 0.6 | X | | 1.84 | X | | 0.43 | X | | 2.36 | X | | 1 | |
| 05/23/23 13:34 | 337715 | | | 0.6 | X | | 1.2 | X | | 0.44 | X | | 1.55 | X | | 1 | |
| 05/23/23 13:35 | 338177.1 | | | 0.6 | X | | 1.2 | X | | 0.44 | X | | 1.56 | X | | 1 | |
| 05/23/23 13:36 | 338100.1 | | | 0.5 | X | | 1.09 | X | | 0.43 | X | | 1.41 | X | | 1 | |
| 05/23/23 13:37 | 338716.3 | | | 0.6 | X | | 1 | X | | 0.5 | X | | 1.3 | X | | 0 | |
| 05/23/23 13:38 | 337792.1 | | | 0.5 | X | | 0.91 | X | | 0.43 | X | | 1.18 | X | | 0 | |
| 05/23/23 13:39 | 337484 | | | 0.5 | X | | 0.82 | X | | 0.43 | X | | 1.06 | X | | 0 | |
| 05/23/23 13:40 | 338100.1 | | | 0.5 | X | | 0.82 | X | | 0.43 | X | | 1.06 | X | | 0 | |
| 05/23/23 13:41 | 337715 | | | 0.5 | X | | 0.82 | X | | 0.43 | X | | 1.06 | X | | 0 | |

# CT1 SUSD EVENT 4

| | CT1_GasFlow_CT_scfh_1M | | | CT1_CO_Ppmvdc_1M | | | CT1_NOx_Ppmvdc_1M | | | CT1_CO_LbPerHr_1M | | | CT1_NOx_LbPerHr_1M | | | CT1_SUSD_TF_1M | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 05/23/23 17:52 | 338100.1 | | | 0.6 | | | 1.54 | | | 0.5 | | | 2 | | | 0 | |
| 05/23/23 17:53 | 338639.2 | | | 0.5 | | | 1.54 | | | 0.43 | | | 2.01 | | | 0 | |
| 05/23/23 17:54 | 338408.2 | | | 0.5 | | | 1.45 | | | 0.43 | | | 1.89 | | | 0 | |
| 05/23/23 17:55 | 337946.1 | | | 0.5 | | | 1.54 | | | 0.43 | | | 2 | | | 0 | |
| 05/23/23 17:56 | 338100.1 | | | 0.5 | | | 1.54 | | | 0.43 | | | 2 | | | 0 | |
| 05/23/23 17:57 | 338793.3 | | | 0.5 | | | 1.54 | | | 0.43 | | | 2.01 | | | 1 | |
| 05/23/23 17:58 | 328088 | | | 0.5 | | | 1.54 | | | 0.42 | | | 1.95 | | | 1 | |
| 05/23/23 17:59 | 307524.8 | | | 0.5 | | | 1.52 | | | 0.39 | | | 1.8 | | | 1 | |
| 05/23/23 18:00 | 284188.9 | | | 0.6 | | | 2.15 | | | 0.42 | | | 2.34 | | | 1 | |
| 05/23/23 18:01 | 260545 | | | 0.6 | | | 2.49 | | | 0.39 | | | 2.49 | | | 1 | |
| 05/23/23 18:02 | 239519.7 | | | 0.6 | | | 3.33 | | | 0.32 | | | 3.07 | | | 1 | |
| 05/23/23 18:03 | 217262.1 | | | 0.4 | | | 6.1 | | | 0.2 | | | 5.09 | | | 1 | |
| 05/23/23 18:04 | 194003.2 | | | 0.2 | | | 24.24 | | | 0.1 | | | 18.07 | | | 1 | |
| 05/23/23 18:05 | 170667.4 | | | 2.8 | | | 29.03 | | | 1.13 | | | 19.04 | | | 1 | |
| 05/23/23 18:06 | 151490.4 | | | 173.2 | | | 32.99 | | | 61.27 | | | 19.2 | | | 1 | |
| 05/23/23 18:07 | 116140.1 | | | 1032 | | | 35.24 | | | 279.76 | | | 15.72 | | | 1 | |
| 05/23/23 18:08 | 34811.2 | | | 0 | | | 31.71 | | | 161.22 | | | 4.24 | | | 0 | |
| 05/23/23 18:09 | 34580.2 | | | 0 | | | 64.9 | | | 1188.59 | | | 8.63 | | | 0 | |
| 05/23/23 18:10 | 34580.2 | | | 0 | | | 0.3 | | | 0 | | | 0 | | | 0 | |
| 05/23/23 18:11 | 34272.1 | | | 0 | | | 0.2 | | | 0 | | | 0 | | | 0 | |
| 05/23/23 18:12 | 34118.1 | | | 0 | | | 0.2 | | | 0 | | | 0 | | | 0 | |

# CT1 SUSD EVENT 5

| | CT1_GasFlow_CT_scfh_1M | | | CT1_CO_Ppmvdc_1M | | | CT1_NOx_Ppmvdc_1M | | | CT1_CO_LbPerHr_1M | | | CT1_NOx_LbPerHr_1M | | | CT1_SUSD_TF_1M | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 05/24/23 9:39 | 0 | | | 0 | | | 0 | | | 0 | | | 0 | | | 0 | |
| 05/24/23 9:40 | 0 | | | 0 | | | 0 | | | 0 | | | 0 | | | 0 | |
| 05/24/23 9:41 | 0 | | | 0 | | | 0 | | | 0 | | | 0 | | | 0 | |
| 05/24/23 9:42 | 0 | | | 0 | | | 0 | | | 0 | | | 0 | | | 0 | |
| 05/24/23 9:43 | 0 | | | 0 | | | 0 | | | 0 | | | 0 | | | 0 | |
| 05/24/23 9:44 | 0 | | | 0 | | | 0 | | | 0 | | | 0 | | | 1 | |
| 05/24/23 9:45 | 0 | | | 0 | | | 0 | | | 0 | | | 0 | | | 1 | |
| 05/24/23 9:46 | 18637.9 | | | 45.2 | | | 25.57 | | | 1.96 | | | 1.83 | | | 1 | |
| 05/24/23 9:47 | 39047.1 | | | 1139.1 | | | 12.19 | | | 103.78 | | | 1.83 | | | 1 | |
| 05/24/23 9:48 | 53834.2 | | | 769 | | | 17.37 | | | 96.57 | | | 3.59 | | | 1 | |
| 05/24/23 9:49 | 76168.8 | | | 452.2 | | | 22.42 | | | 80.38 | | | 6.56 | | | 1 | |
| 05/24/23 9:50 | 122070.3 | | | 298.8 | | | 24.94 | | | 85.13 | | | 11.7 | | | 1 | |
| 05/24/23 9:51 | 139398.9 | | | 191.1 | | | 45.61 | | | 62.19 | | | 24.43 | | | 1 | |
| 05/24/23 9:52 | 150566.2 | | | 502.8 | | | 55.76 | | | 176.71 | | | 32.25 | | | 1 | |
| 05/24/23 9:53 | 169204.1 | | | 1904.1 | | | 52.38 | | | 752.28 | | | 34.06 | | | 1 | |
| 05/24/23 9:54 | 191230.7 | | | 1477.2 | | | 56.93 | | | 659.69 | | | 41.84 | | | 1 | |
| 05/24/23 9:55 | 213565.3 | | | 259.5 | | | 57.31 | | | 129.4 | | | 47.04 | | | 1 | |
| 05/24/23 9:56 | 233897.5 | | | 25.6 | | | 55.07 | | | 13.96 | | | 49.5 | | | 1 | |
| 05/24/23 9:57 | 262547.4 | | | 2.2 | | | 52.54 | | | 1.36 | | | 53 | | | 1 | |
| 05/24/23 9:58 | 286576.4 | | | 1.5 | | | 38.6 | | | 1 | | | 42.5 | | | 1 | |
| 05/24/23 9:59 | 306292.5 | | | 1.4 | | | 18.77 | | | 1.02 | | | 22.1 | | | 1 | |
| 05/24/23 10:00 | 324083.2 | | | 1.5 | | | 13.17 | | | 1.1 | | | 16.4 | | | 1 | |
| 05/24/23 10:01 | 339332.4 | | | 1.6 | | | 11.46 | | | 1.29 | | | 14.94 | | | 1 | |
| 05/24/23 10:02 | 344338.4 | | | 1.5 | | | 8.47 | | | 1.24 | | | 11.2 | | | 1 | |
| 05/24/23 10:03 | 346571.9 | | | 1.4 | | | 7.98 | | | 1.12 | | | 10.63 | | | 1 | |
| 05/24/23 10:04 | 345416.6 | | | 1.2 | | | 8.21 | | | 0.97 | | | 10.9 | | | 1 | |
| 05/24/23 10:05 | 346109.8 | | | 1.1 | | | 8.59 | | | 0.91 | | | 11.42 | | | 1 | |
| 05/24/23 10:06 | 345185.6 | | | 1 | | | 8.5 | | | 0.84 | | | 11.28 | | | 1 | |
| 05/24/23 10:07 | 344877.5 | | | 1 | | | 8.33 | | | 0.77 | | | 11.04 | | | 1 | |
| 05/24/23 10:08 | 344877.5 | | | 0.9 | | | 8.07 | | | 0.7 | | | 10.69 | | | 1 | |
| 05/24/23 10:09 | 343645.3 | | | 0.9 | | | 7.81 | | | 0.7 | | | 10.31 | | | 1 | |
| 05/24/23 10:10 | 344030.3 | | | 0.8 | | | 7.64 | | | 0.63 | | | 10.09 | | | 1 | |

| | CT1_GasFlow_CT_scfh_1M | | | CT1_CO_Ppmvdc_1M | | | CT1_NOx_Ppmvdc_1M | | | CT1_CO_LbPerHr_1M | | | CT1_NOx_LbPerHr_1M | | | CT1_SUSD_TF_1M | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 05/24/23 10:11 | 342644.1 | | | 0.8 | | | 7.57 | | | 0.63 | | | 9.97 | | | 1 | |
| 05/24/23 10:12 | 343260.2 | | | 0.8 | | | 7.4 | | | 0.64 | | | 9.76 | | | 1 | |
| 05/24/23 10:13 | 342259 | | | 0.7 | | | 7.31 | | | 0.56 | | | 9.61 | | | 1 | |
| 05/24/23 10:14 | 342875.1 | | | 0.7 | | | 7.22 | | | 0.56 | | | 9.51 | | | 1 | |
| 05/24/23 10:15 | 342027.9 | | | 0.7 | | | 7.22 | | | 0.56 | | | 9.49 | | | 1 | |
| 05/24/23 10:16 | 342490 | | | 0.7 | | | 7.13 | | | 0.56 | | | 9.39 | | | 1 | |
| 05/24/23 10:17 | 341411.8 | | | 0.7 | | | 5.99 | | | 0.56 | | | 7.86 | | | 1 | |
| 05/24/23 10:18 | 342182 | | | 0.6 | | | 5.55 | | | 0.49 | | | 7.29 | | | 1 | |
| 05/24/23 10:19 | 341103.8 | | | 0.6 | | | 5.55 | | | 0.49 | | | 7.27 | | | 1 | |
| 05/24/23 10:20 | 341334.8 | | | 0.6 | | | 5.46 | | | 0.49 | | | 7.16 | | | 1 | |
| 05/24/23 10:21 | 340333.6 | | | 0.6 | | | 5.46 | | | 0.49 | | | 7.14 | | | 1 | |
| 05/24/23 10:22 | 340795.7 | | | 0.6 | | | 5.37 | | | 0.49 | | | 7.03 | | | 1 | |
| 05/24/23 10:23 | 339948.5 | | | 0.6 | | | 5.37 | | | 0.49 | | | 7.02 | | | 1 | |
| 05/24/23 10:24 | 340872.7 | | | 0.6 | | | 4.92 | | | 0.5 | | | 6.44 | | | 1 | |
| 05/24/23 10:25 | 340333.6 | | | 0.6 | | | 3.26 | | | 0.49 | | | 4.26 | | | 1 | |
| 05/24/23 10:26 | 340641.7 | | | 0.6 | | | 2.47 | | | 0.49 | | | 3.23 | | | 1 | |
| 05/24/23 10:27 | 340025.5 | | | 0.6 | | | 2.55 | | | 0.49 | | | 3.34 | | | 1 | |
| 05/24/23 10:28 | 339948.5 | | | 0.6 | | | 3.4 | | | 0.5 | | | 4.44 | | | 1 | |
| 05/24/23 10:29 | 340487.6 | | | 0.6 | | | 3.67 | | | 0.5 | | | 4.79 | | | 1 | |
| 05/24/23 10:30 | 340179.6 | | | 0.6 | | | 3.7 | | | 0.49 | | | 4.83 | | | 1 | |
| 05/24/23 10:31 | 339332.4 | | | 0.6 | | | 3.26 | | | 0.49 | | | 4.25 | | | 1 | |
| 05/24/23 10:32 | 340102.5 | | | 0.6 | | | 2.91 | | | 0.49 | | | 3.8 | | | 1 | |
| 05/24/23 10:33 | 339486.4 | | | 0.6 | | | 2.77 | | | 0.5 | | | 3.62 | | | 1 | |
| 05/24/23 10:34 | 340025.5 | | | 0.6 | | | 2.59 | | | 0.5 | | | 3.39 | | | 1 | |
| 05/24/23 10:35 | 339178.3 | | | 0.6 | | | 2.32 | | | 0.5 | | | 3.03 | | | 1 | |
| 05/24/23 10:36 | 339486.4 | | | 0.6 | | | 2.23 | | | 0.5 | | | 2.92 | | | 1 | |
| 05/24/23 10:37 | 339486.4 | | | 0.6 | | | 2.15 | | | 0.5 | | | 2.8 | | | 1 | |
| 05/24/23 10:38 | 339024.3 | | | 0.6 | | | 2.15 | | | 0.5 | | | 2.79 | | | 1 | |
| 05/24/23 10:39 | 338331.2 | | | 0.6 | | | 2.15 | | | 0.49 | | | 2.79 | | | 1 | |
| 05/24/23 10:40 | 338562.2 | | | 0.6 | | | 2.15 | | | 0.49 | | | 2.79 | | | 1 | |
| 05/24/23 10:41 | 337407 | | | 0.6 | | | 2.06 | | | 0.49 | | | 2.67 | | | 1 | |
| 05/24/23 10:42 | 337792.1 | | | 0.6 | | | 1.97 | | | 0.49 | | | 2.55 | | | 1 | |
| 05/24/23 10:43 | 337407 | | | 0.6 | | | 1.79 | | | 0.49 | | | 2.32 | | | 1 | |
| 05/24/23 10:44 | 336944.9 | | | 0.6 | | | 1.7 | | | 0.49 | | | 2.2 | | | 1 | |

| | CT1_GasFlow_CT_scfh_1M | | | CT1_CO_Ppmvdc_1M | | | CT1_NOx_Ppmvdc_1M | | | CT1_CO_LbPerHr_1M | | | CT1_NOx_LbPerHr_1M | | | CT1_SUSD_TF_1M | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 05/24/23 10:45 | 337252.9 | | | 0.6 | | | 1.61 | | | 0.49 | | | 2.09 | | | 1 | |
| 05/24/23 10:46 | 336867.9 | | | 0.6 | | | 1.7 | | | 0.49 | | | 2.2 | | | 1 | |
| 05/24/23 10:47 | 336790.8 | | | 0.6 | | | 1.79 | | | 0.49 | | | 2.31 | | | 0 | |
| 05/24/23 10:48 | 337484 | | | 0.6 | | | 1.79 | | | 0.49 | | | 2.32 | | | 0 | |
| 05/24/23 10:49 | 336944.9 | | | 0.6 | | | 1.79 | | | 0.49 | | | 2.31 | | | 0 | |
| 05/24/23 10:50 | 337638 | | | 0.6 | | | 1.61 | | | 0.49 | | | 2.09 | | | 0 | |
| 05/24/23 10:51 | 337561 | | | 0.6 | | | 1.52 | | | 0.49 | | | 1.97 | | | 0 | |

# CT1 SUSD EVENT 6

| | CT1_GasFlow_CT_scfh_1M | | | CT1_CO_Ppmvdc_1M | | | CT1_NOx_Ppmvdc_1M | | | CT1_CO_LbPerHr_1M | | | CT1_NOx_LbPerHr_1M | | | CT1_SUSD_TF_1M | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 05/24/23 13:49 | 351500.9 | | | 0.5 | | | 1.54 | | | 0.45 | | | 2.08 | | | 0 | |
| 05/24/23 13:50 | 350345.7 | | | 0.5 | | | 1.52 | | | 0.44 | | | 2.05 | | | 0 | |
| 05/24/23 13:51 | 355890.8 | | | 0.5 | | | 1.52 | | | 0.45 | | | 2.08 | | | 0 | |
| 05/24/23 13:52 | 357123.1 | | | 0.5 | | | 1.54 | | | 0.45 | | | 2.12 | | | 0 | |
| 05/24/23 13:53 | 358124.3 | | | 0.5 | | | 1.45 | | | 0.46 | | | 2 | | | 0 | |
| 05/24/23 13:54 | 359279.5 | | | 0.5 | | | 1.45 | | | 0.46 | | | 2 | | | 1 | |
| 05/24/23 13:55 | 351269.8 | | | 0.5 | | | 1.45 | | | 0.45 | | | 1.96 | | | 1 | |
| 05/24/23 13:56 | 336559.8 | | | 0.5 | | | 1.54 | | | 0.43 | | | 2 | | | 1 | |
| 05/24/23 13:57 | 314841.3 | | | 0.5 | | | 1.85 | | | 0.39 | | | 2.24 | | | 1 | |
| 05/24/23 13:58 | 291582.5 | | | 0.6 | | | 2.11 | | | 0.42 | | | 2.37 | | | 1 | |
| 05/24/23 13:59 | 268169.6 | | | 0.6 | | | 2.68 | | | 0.39 | | | 2.76 | | | 1 | |
| 05/24/23 14:00 | 247144.3 | | | 0.6 | | | 3.37 | | | 0.32 | | | 3.2 | | | 1 | |
| 05/24/23 14:01 | 223115.3 | | | 0.4 | | | 6.09 | | | 0.2 | | | 5.22 | | | 1 | |
| 05/24/23 14:02 | 203091.1 | | | 0.3 | | | 20.6 | | | 0.15 | | | 16.07 | | | 1 | |
| 05/24/23 14:03 | 177906.9 | | | 1.3 | | | 30.54 | | | 0.53 | | | 20.88 | | | 1 | |
| 05/24/23 14:04 | 156419.4 | | | 1.4 | | | 35.14 | | | 0.53 | | | 21.11 | | | 1 | |
| 05/24/23 14:05 | 139321.9 | | | 685 | | | 37.61 | | | 222.79 | | | 20.13 | | | 1 | |
| 05/24/23 14:06 | 61689.8 | | | 1748.3 | | | 38.27 | | | 251.63 | | | 9.06 | | | 1 | |
| 05/24/23 14:07 | 28649.9 | | | 0 | | | 39.46 | | | 199.29 | | | 4.35 | | | 0 | |
| 05/24/23 14:08 | 28341.9 | | | 0 | | | 0.4 | | | 0 | | | 0 | | | 0 | |
| 05/24/23 14:09 | 28264.9 | | | 0 | | | 0.3 | | | 0 | | | 0 | | | 0 | |
| 05/24/23 14:10 | 28033.8 | | | 0 | | | 0.2 | | | 0 | | | 0 | | | 0 | |
| 05/24/23 14:11 | 27879.8 | | | 0 | | | 0.2 | | | 0 | | | 0 | | | 0 | |

# CT1 SUSD EVENT 7

| | CT1_GasFlow_CT_scfh_1M | | | CT1_CO_Ppmvdc_1M | | | CT1_NOx_Ppmvdc_1M | | | CT1_CO_LbPerHr_1M | | | CT1_NOx_LbPerHr_1M | | | CT1_SUSD_TF_1M | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 06/29/23 7:21 | 0 | | | 0 | | | 0 | | | 0 | | | 0 | | | 0 | |
| 06/29/23 7:22 | 0 | | | 0 | | | 0 | | | 0 | | | 0 | | | 0 | |
| 06/29/23 7:23 | 0 | | | 0 | | | 0 | | | 0 | | | 0 | | | 0 | |
| 06/29/23 7:24 | 0 | | | 0 | | | 0 | | | 0 | | | 0 | | | 0 | |
| 06/29/23 7:25 | 0 | | | 0 | | | 0 | | | 0 | | | 0 | | | 0 | |
| 06/29/23 7:26 | 0 | | | 0 | | | 0 | | | 0 | | | 0 | | | 1 | |
| 06/29/23 7:27 | 6007.2 | | | 0 | | | 0 | | | 0 | | | 0 | | | 1 | |
| 06/29/23 7:28 | 28187.8 | | | 47.2 | | | 17.7 | | | 3.04 | | | 1.88 | | | 1 | |
| 06/29/23 7:29 | 44053.1 | | | 1183 | | | 11.38 | | | 119.42 | | | 1.89 | | | 1 | |
| 06/29/23 7:30 | 58301.1 | | | 783.1 | | | 14.42 | | | 104.47 | | | 3.17 | | | 1 | |
| 06/29/23 7:31 | 83947.4 | | | 461.1 | | | 17.11 | | | 88.66 | | | 5.41 | | | 1 | |
| 06/29/23 7:32 | 128385.6 | | | 299.8 | | | 20.11 | | | 88.12 | | | 9.73 | | | 1 | |
| 06/29/23 7:33 | 139475.9 | | | 186.6 | | | 33.43 | | | 59.61 | | | 17.58 | | | 1 | |
| 06/29/23 7:34 | 149257 | | | 861.2 | | | 34.11 | | | 294.37 | | | 19.19 | | | 1 | |
| 06/29/23 7:35 | 166970.6 | | | 1895.2 | | | 28.61 | | | 724.57 | | | 18 | | | 1 | |
| 06/29/23 7:36 | 186455.7 | | | 1737.2 | | | 34.42 | | | 741.58 | | | 24.18 | | | 1 | |
| 06/29/23 7:37 | 210022.6 | | | 657.9 | | | 44.9 | | | 316.49 | | | 35.54 | | | 1 | |
| 06/29/23 7:38 | 230970.9 | | | 54 | | | 49.46 | | | 28.55 | | | 43.06 | | | 1 | |
| 06/29/23 7:39 | 255924.1 | | | 4 | | | 51.97 | | | 2.33 | | | 50.12 | | | 1 | |
| 06/29/23 7:40 | 280492.2 | | | 2 | | | 44.35 | | | 1.31 | | | 46.88 | | | 1 | |
| 06/29/23 7:41 | 301517.5 | | | 1.8 | | | 21.2 | | | 1.27 | | | 24.1 | | | 1 | |
| 06/29/23 7:42 | 320232.4 | | | 1.8 | | | 15.44 | | | 1.34 | | | 18.64 | | | 1 | |
| 06/29/23 7:43 | 336790.8 | | | 1.9 | | | 13.08 | | | 1.45 | | | 16.6 | | | 1 | |
| 06/29/23 7:44 | 343260.2 | | | 1.8 | | | 9.49 | | | 1.41 | | | 12.28 | | | 1 | |
| 06/29/23 7:45 | 344492.4 | | | 1.6 | | | 8.5 | | | 1.3 | | | 11.04 | | | 1 | |
| 06/29/23 7:46 | 344569.5 | | | 1.6 | | | 8.42 | | | 1.23 | | | 10.93 | | | 1 | |
| 06/29/23 7:47 | 344338.4 | | | 1.4 | | | 7.9 | | | 1.09 | | | 10.25 | | | 1 | |
| 06/29/23 7:48 | 344030.3 | | | 1.3 | | | 7.2 | | | 1.03 | | | 9.34 | | | 1 | |
| 06/29/23 7:49 | 343953.3 | | | 1.2 | | | 6.85 | | | 0.96 | | | 8.89 | | | 1 | |
| 06/29/23 7:50 | 343799.3 | | | 1.1 | | | 6.42 | | | 0.89 | | | 8.32 | | | 1 | |
| 06/29/23 7:51 | 343799.3 | | | 1.1 | | | 6.43 | | | 0.83 | | | 8.33 | | | 1 | |
| 06/29/23 7:52 | 343722.3 | | | 1.1 | | | 6.16 | | | 0.83 | | | 7.98 | | | 1 | |

| | CT1_GasFlow_CT_scfh_1M | | | CT1_CO_Ppmvdc_1M | | | CT1_NOx_Ppmvdc_1M | | | CT1_CO_LbPerHr_1M | | | CT1_NOx_LbPerHr_1M | | | CT1_SUSD_TF_1M | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 06/29/23 7:53 | 343491.3 | | | 1 | | | 5.9 | | | 0.76 | | | 7.64 | | | 1 | |
| 06/29/23 7:54 | 343645.3 | | | 0.9 | | | 5.72 | | | 0.69 | | | 7.41 | | | 1 | |
| 06/29/23 7:55 | 343799.3 | | | 0.9 | | | 5.55 | | | 0.69 | | | 7.19 | | | 1 | |
| 06/29/23 7:56 | 344107.4 | | | 0.9 | | | 5.46 | | | 0.69 | | | 7.08 | | | 1 | |
| 06/29/23 7:57 | 343876.3 | | | 0.9 | | | 5.28 | | | 0.69 | | | 6.85 | | | 1 | |
| 06/29/23 7:58 | 343876.3 | | | 0.9 | | | 5.27 | | | 0.7 | | | 6.84 | | | 1 | |
| 06/29/23 7:59 | 344107.4 | | | 0.8 | | | 5.18 | | | 0.63 | | | 6.72 | | | 1 | |
| 06/29/23 8:00 | 344184.4 | | | 0.8 | | | 5.18 | | | 0.63 | | | 6.73 | | | 1 | |
| 06/29/23 8:01 | 344261.4 | | | 0.8 | | | 5.1 | | | 0.63 | | | 6.61 | | | 1 | |
| 06/29/23 8:02 | 344415.4 | | | 0.7 | | | 5.1 | | | 0.56 | | | 6.61 | | | 1 | |
| 06/29/23 8:03 | 343953.3 | | | 0.7 | | | 5.18 | | | 0.56 | | | 6.72 | | | 1 | |
| 06/29/23 8:04 | 343953.3 | | | 0.8 | | | 5.18 | | | 0.63 | | | 6.72 | | | 1 | |
| 06/29/23 8:05 | 344107.4 | | | 0.8 | | | 5.18 | | | 0.63 | | | 6.72 | | | 1 | |
| 06/29/23 8:06 | 344800.5 | | | 0.7 | | | 5.18 | | | 0.56 | | | 6.74 | | | 1 | |
| 06/29/23 8:07 | 355120.7 | | | 0.7 | | | 5.18 | | | 0.58 | | | 6.94 | | | 1 | |
| 06/29/23 8:08 | 372988.3 | | | 0.7 | | | 4.63 | | | 0.62 | | | 6.51 | | | 1 | |
| 06/29/23 8:09 | 392319.4 | | | 0.6 | | | 4.52 | | | 0.58 | | | 6.68 | | | 1 | |
| 06/29/23 8:10 | 392627.4 | | | 0.6 | | | 4.52 | | | 0.58 | | | 6.68 | | | 1 | |
| 06/29/23 8:11 | 393474.6 | | | 0.6 | | | 5.62 | | | 0.58 | | | 8.34 | | | 1 | |
| 06/29/23 8:12 | 411727.4 | | | 0.6 | | | 3.72 | | | 0.6 | | | 5.77 | | | 1 | |
| 06/29/23 8:13 | 434293.1 | | | 0.7 | | | 1.59 | | | 0.65 | | | 2.61 | | | 1 | |
| 06/29/23 8:14 | 440608.4 | | | 0.6 | | | 1.5 | | | 0.57 | | | 2.49 | | | 1 | |
| 06/29/23 8:15 | 437219.7 | | | 0.6 | | | 2.3 | | | 0.55 | | | 3.8 | | | 1 | |
| 06/29/23 8:16 | 436834.6 | | | 0.6 | | | 2.4 | | | 0.55 | | | 3.95 | | | 1 | |
| 06/29/23 8:17 | 437989.8 | | | 0.6 | | | 3.13 | | | 0.55 | | | 5.17 | | | 1 | |
| 06/29/23 8:18 | 439684.2 | | | 0.6 | | | 3.41 | | | 0.56 | | | 5.65 | | | 1 | |
| 06/29/23 8:19 | 441301.5 | | | 0.6 | | | 3.5 | | | 0.56 | | | 5.83 | | | 1 | |
| 06/29/23 8:20 | 441994.7 | | | 0.6 | | | 2.58 | | | 0.65 | | | 4.3 | | | 1 | |
| 06/29/23 8:21 | 442533.8 | | | 0.6 | | | 2.12 | | | 0.65 | | | 3.54 | | | 1 | |
| 06/29/23 8:22 | 442610.8 | | | 0.6 | | | 2.03 | | | 0.65 | | | 3.38 | | | 1 | |
| 06/29/23 8:23 | 442533.8 | | | 0.6 | | | 2.03 | | | 0.65 | | | 3.38 | | | 1 | |
| 06/29/23 8:24 | 442764.8 | | | 0.6 | | | 2.12 | | | 0.65 | | | 3.54 | | | 1 | |
| 06/29/23 8:25 | 442379.8 | | | 0.6 | | | 2.3 | | | 0.65 | | | 3.84 | | | 1 | |
| 06/29/23 8:26 | 442379.8 | | | 0.6 | | | 2.36 | | | 0.64 | | | 3.93 | | | 1 | |

| | CT1_GasFlow_CT_scfh_1M | | | CT1_CO_Ppmvdc_1M | | | CT1_NOx_Ppmvdc_1M | | | CT1_CO_LbPerHr_1M | | | CT1_NOx_LbPerHr_1M | | | CT1_SUSD_TF_1M | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| **Mod** | | | | | | | | | | | | | | | | | |
| 06/29/23 8:27 | 443535 | | | 0.6 | | | 2.49 | | | 0.66 | | | 4.16 | | | 1 | |
| 06/29/23 8:28 | 443149.9 | | | 0.6 | | | 2.3 | | | 0.65 | | | 3.85 | | | 1 | |
| 06/29/23 8:29 | 442995.9 | | | 0.6 | | | 2.03 | | | 0.65 | | | 3.39 | | | 1 | |
| 06/29/23 8:30 | 443226.9 | | | 0.6 | | | 1.75 | | | 0.65 | | | 2.93 | | | 1 | |
| 06/29/23 8:31 | 443303.9 | | | 0.6 | | | 1.57 | | | 0.66 | | | 2.62 | | | 1 | |
| 06/29/23 8:32 | 443458 | | | 0.6 | | | 1.45 | | | 0.65 | | | 2.43 | | | 1 | |
| 06/29/23 8:33 | 443612 | | | 0.6 | | | 1.45 | | | 0.65 | | | 2.43 | | | 1 | |
| 06/29/23 8:34 | 443380.9 | | | 0.6 | | | 1.54 | | | 0.65 | | | 2.58 | | | 0 | |
| 06/29/23 8:35 | 443303.9 | | | 0.6 | | | 1.72 | | | 0.65 | | | 2.88 | | | 0 | |
| 06/29/23 8:36 | 443303.9 | | | 0.6 | | | 1.82 | | | 0.65 | | | 3.03 | | | 0 | |
| 06/29/23 8:37 | 443612 | | | 0.6 | | | 1.82 | | | 0.65 | | | 3.03 | | | 0 | |
| 06/29/23 8:38 | 443612 | | | 0.6 | | | 1.82 | | | 0.65 | | | 3.03 | | | 0 | |

**ATTACHMENT 16**

# AQ-57

**AQ-57** The emissions rates from each gas turbine and heat recovery steam generator exhaust during startup and shutdown or excursions shall not exceed the following:

| **Combustion Turbine emissions limitations per Turbine excluding Startup and Shutdown** | |
|---|---|
| **Pollutant** | **Pounds/Hour** |
| CO | 6.2 3hr rolling |
| NOX | 5.1 1 hour rolling |
| PM-10 | 4.7 |
| SOX | 1.0 |
| VOC | 1.8 |

**Verification:** The Project owner shall include all necessary emissions data to demonstrate compliance with the emissions limits provided in this Condition as part of the Quarterly Air Quality Report required in Condition of Certification AQ-SC6

AQ-57 If the Alstom GX100 turbines are selected for the Project, emission rates from each gas turbine and heat recovery steam generator exhaust, except during startup and/or shutdown, or excursions shall not exceed the following:

| Alstom GTX100 - COMBUSTION TURBINE EMISSION LIMITATIONS PER TURBINE EXCLUDING STARTUP AND SHUTDOWN | |
|---|---|
| POLLUTANT | POUNDS/HOUR |
| Carbon Monoxide (CO) | 6.2 (three-hour rolling average) |
| Nitrogen Oxides (NOx) | 5.1 (one-hour average) |
| PM10 | 4.7 |
| Sulfur Oxides (SOx) | 1.0 |
| Volatile Organic Compounds (VOCs) | 1.8 |

**Verification:** The Project owner shall include all necessary emissions data to demonstrate compliance with the emission limits provided in this Condition as part of the Quarterly Air Quality Report required in Condition of Certification AQ-SC6.

# AQ57 CT1 HOURLY EMISSIONS

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_NH3Slip_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT1_SO2_LbPerHr_1H | | | CT1_VOC_LbPerHr_1H | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** |
| 04/01/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/01/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/01/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/01/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/01/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/01/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/01/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/01/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/01/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/01/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/01/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/01/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/01/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/01/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/01/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/01/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/01/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/01/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/01/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/01/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/01/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/01/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/01/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/01/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/02/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/02/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/02/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/02/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/02/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/02/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/02/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/02/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_NH3Slip_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT1_SO2_LbPerHr_1H | | | CT1_VOC_LbPerHr_1H | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** |
| 04/02/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/02/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/02/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/02/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/02/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/02/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/02/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/02/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/02/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/02/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/02/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/02/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/02/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/02/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/02/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/02/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/03/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/03/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/03/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/03/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/03/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/03/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/03/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/03/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/03/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/03/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/03/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/03/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/03/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/03/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/03/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/03/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/03/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/03/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_NH3Slip_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT1_SO2_LbPerHr_1H | | | CT1_VOC_LbPerHr_1H | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** |
| 04/03/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/03/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/03/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/03/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/03/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/03/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/04/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/04/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/04/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/04/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/04/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/04/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/04/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/04/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/04/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/04/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/04/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/04/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/04/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/04/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/04/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/04/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/04/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/04/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/04/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/04/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/04/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/04/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/04/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/04/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/05/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/05/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/05/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/05/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_NH3Slip_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT1_SO2_LbPerHr_1H | | | CT1_VOC_LbPerHr_1H | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** |
| 04/05/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/05/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/05/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/05/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/05/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/05/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/05/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/05/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/05/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/05/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/05/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/05/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/05/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/05/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/05/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/05/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/05/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/05/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/05/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/05/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/06/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/06/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/06/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/06/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/06/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/06/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/06/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/06/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/06/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/06/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/06/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/06/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/06/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/06/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_NH3Slip_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT1_SO2_LbPerHr_1H | | | CT1_VOC_LbPerHr_1H | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** |
| 04/06/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/06/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/06/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/06/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/06/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/06/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/06/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/06/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/06/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/06/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/07/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/07/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/07/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/07/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/07/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/07/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/07/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/07/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/07/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/07/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/07/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/07/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/07/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/07/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/07/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/07/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/07/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/07/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/07/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/07/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/07/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/07/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/07/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/07/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_NH3Slip_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT1_SO2_LbPerHr_1H | | | CT1_VOC_LbPerHr_1H | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** |
| 04/08/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/08/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/08/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/08/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/08/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/08/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/08/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/08/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/08/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/08/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/08/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/08/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/08/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/08/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/08/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/08/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/08/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/08/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/08/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/08/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/08/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/08/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/08/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/08/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/09/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/09/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/09/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/09/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/09/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/09/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/09/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/09/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/09/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/09/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_NH3Slip_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT1_SO2_LbPerHr_1H | | | CT1_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 04/09/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/09/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/09/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/09/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/09/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/09/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/09/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/09/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/09/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/09/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/09/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/09/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/09/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/09/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/10/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/10/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/10/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/10/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/10/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/10/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/10/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/10/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/10/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/10/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/10/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/10/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/10/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/10/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/10/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/10/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/10/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/10/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/10/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/10/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_NH3Slip_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT1_SO2_LbPerHr_1H | | | CT1_VOC_LbPerHr_1H | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** |
| 04/10/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/10/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/10/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/10/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/11/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/11/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/11/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/11/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/11/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/11/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/11/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/11/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/11/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/11/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/11/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/11/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/11/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/11/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/11/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/11/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/11/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/11/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/11/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/11/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/11/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/11/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/11/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/11/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/12/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/12/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/12/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/12/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/12/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/12/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_NH3Slip_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT1_SO2_LbPerHr_1H | | | CT1_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 04/12/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/12/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/12/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/12/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/12/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/12/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/12/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/12/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/12/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/12/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/12/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/12/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/12/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/12/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/12/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/12/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/12/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/12/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/13/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/13/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/13/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/13/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/13/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/13/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/13/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/13/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/13/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/13/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/13/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/13/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/13/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/13/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/13/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/13/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_NH3Slip_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT1_SO2_LbPerHr_1H | | | CT1_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 04/13/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/13/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/13/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/13/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/13/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/13/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/13/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/13/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/14/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/14/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/14/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/14/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/14/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/14/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/14/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/14/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/14/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/14/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/14/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/14/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/14/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/14/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/14/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/14/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/14/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/14/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/14/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/14/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/14/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/14/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/14/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/14/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/15/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/15/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_NH3Slip_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT1_SO2_LbPerHr_1H | | | CT1_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 04/15/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/15/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/15/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/15/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/15/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/15/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/15/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/15/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/15/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/15/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/15/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/15/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/15/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/15/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/15/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/15/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/15/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/15/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/15/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/15/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/15/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/15/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/16/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/16/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/16/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/16/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/16/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/16/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/16/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/16/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/16/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/16/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/16/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/16/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_NH3Slip_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT1_SO2_LbPerHr_1H | | | CT1_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 04/16/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/16/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/16/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/16/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/16/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/16/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/16/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/16/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/16/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/16/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/16/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/16/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/17/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/17/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/17/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/17/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/17/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/17/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/17/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/17/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/17/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/17/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/17/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/17/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/17/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/17/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/17/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/17/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/17/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/17/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/17/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/17/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/17/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/17/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_NH3Slip_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT1_SO2_LbPerHr_1H | | | CT1_VOC_LbPerHr_1H | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** |
| 04/17/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/17/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/18/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/18/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/18/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/18/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/18/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/18/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/18/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/18/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/18/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/18/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/18/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/18/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/18/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/18/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/18/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/18/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/18/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/18/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/18/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/18/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/18/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/18/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/18/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/18/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/19/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/19/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/19/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/19/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/19/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/19/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/19/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/19/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_NH3Slip_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT1_SO2_LbPerHr_1H | | | CT1_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 04/19/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/19/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/19/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/19/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/19/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/19/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/19/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/19/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/19/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/19/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/19/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/19/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/19/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/19/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/19/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/19/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/20/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/20/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/20/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/20/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/20/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/20/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/20/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/20/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/20/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/20/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/20/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/20/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/20/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/20/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/20/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/20/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/20/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/20/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_NH3Slip_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT1_SO2_LbPerHr_1H | | | CT1_VOC_LbPerHr_1H | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** |
| 04/20/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/20/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/20/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/20/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/20/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/20/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/21/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/21/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/21/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/21/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/21/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/21/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/21/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/21/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/21/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/21/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/21/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/21/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/21/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/21/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/21/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/21/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/21/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/21/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/21/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/21/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/21/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/21/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/21/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/21/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/22/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/22/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/22/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/22/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_NH3Slip_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT1_SO2_LbPerHr_1H | | | CT1_VOC_LbPerHr_1H | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** |
| 04/22/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/22/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/22/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/22/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/22/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/22/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/22/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/22/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/22/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/22/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/22/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/22/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/22/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/22/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/22/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/22/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/22/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/22/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/22/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/22/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/23/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/23/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/23/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/23/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/23/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/23/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/23/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/23/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/23/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/23/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/23/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/23/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/23/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/23/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_NH3Slip_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT1_SO2_LbPerHr_1H | | | CT1_VOC_LbPerHr_1H | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** |
| 04/23/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/23/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/23/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/23/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/23/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/23/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/23/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/23/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/23/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/23/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/24/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/24/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/24/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/24/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/24/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/24/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/24/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/24/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/24/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/24/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/24/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/24/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/24/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/24/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/24/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/24/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/24/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/24/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/24/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/24/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/24/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/24/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/24/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/24/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_NH3Slip_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT1_SO2_LbPerHr_1H | | | CT1_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 04/25/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/25/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/25/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/25/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/25/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/25/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/25/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/25/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/25/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/25/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/25/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/25/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/25/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/25/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/25/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/25/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/25/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/25/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/25/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/25/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/25/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/25/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/25/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/25/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/26/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/26/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/26/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/26/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/26/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/26/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/26/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/26/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/26/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/26/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_NH3Slip_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT1_SO2_LbPerHr_1H | | | CT1_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 04/26/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/26/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/26/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/26/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/26/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/26/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/26/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/26/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/26/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/26/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/26/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/26/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/26/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/26/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/27/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/27/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/27/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/27/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/27/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/27/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/27/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/27/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/27/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/27/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/27/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/27/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/27/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/27/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/27/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/27/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/27/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/27/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/27/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/27/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_NH3Slip_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT1_SO2_LbPerHr_1H | | | CT1_VOC_LbPerHr_1H | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** |
| 04/27/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/27/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/27/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/27/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/28/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/28/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/28/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/28/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/28/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/28/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/28/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/28/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/28/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/28/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/28/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/28/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/28/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/28/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/28/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/28/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/28/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/28/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/28/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/28/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/28/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/28/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/28/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/28/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/29/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/29/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/29/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/29/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/29/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/29/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_NH3Slip_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT1_SO2_LbPerHr_1H | | | CT1_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 04/29/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/29/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/29/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/29/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/29/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/29/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/29/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/29/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/29/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/29/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/29/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/29/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/29/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/29/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/29/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/29/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/29/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/29/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/30/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/30/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/30/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/30/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/30/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/30/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/30/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/30/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/30/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/30/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/30/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/30/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/30/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/30/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/30/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/30/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_NH3Slip_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT1_SO2_LbPerHr_1H | | | CT1_VOC_LbPerHr_1H | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** |
| 04/30/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/30/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/30/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/30/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/30/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/30/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/30/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/30/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/01/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/01/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/01/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/01/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/01/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/01/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/01/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/01/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/01/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/01/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/01/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/01/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/01/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/01/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/01/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/01/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/01/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/01/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/01/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/01/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/01/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/01/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/01/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/01/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/02/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/02/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_NH3Slip_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT1_SO2_LbPerHr_1H | | | CT1_VOC_LbPerHr_1H | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** |
| 05/02/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/02/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/02/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/02/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/02/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/02/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/02/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/02/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/02/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/02/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/02/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/02/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/02/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/02/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/02/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/02/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/02/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/02/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/02/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/02/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/02/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/02/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/03/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/03/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/03/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/03/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/03/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/03/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/03/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/03/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/03/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/03/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/03/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/03/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_NH3Slip_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT1_SO2_LbPerHr_1H | | | CT1_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 05/03/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/03/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/03/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/03/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/03/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/03/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/03/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/03/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/03/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/03/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/03/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/03/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/04/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/04/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/04/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/04/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/04/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/04/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/04/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/04/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/04/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/04/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/04/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/04/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/04/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/04/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/04/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/04/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/04/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/04/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/04/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/04/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/04/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/04/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_NH3Slip_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT1_SO2_LbPerHr_1H | | | CT1_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 05/04/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/04/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/05/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/05/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/05/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/05/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/05/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/05/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/05/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/05/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/05/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/05/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/05/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/05/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/05/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/05/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/05/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/05/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/05/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/05/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/05/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/05/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/05/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/05/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/05/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/05/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/06/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/06/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/06/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/06/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/06/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/06/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/06/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/06/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_NH3Slip_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT1_SO2_LbPerHr_1H | | | CT1_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 05/06/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/06/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/06/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/06/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/06/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/06/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/06/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/06/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/06/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/06/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/06/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/06/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/06/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/06/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/06/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/06/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/07/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/07/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/07/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/07/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/07/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/07/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/07/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/07/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/07/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/07/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/07/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/07/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/07/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/07/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/07/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/07/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/07/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/07/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_NH3Slip_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT1_SO2_LbPerHr_1H | | | CT1_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 05/07/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/07/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/07/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/07/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/07/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/07/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/08/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/08/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/08/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/08/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/08/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/08/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/08/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/08/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/08/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/08/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/08/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/08/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/08/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/08/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/08/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/08/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/08/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/08/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/08/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/08/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/08/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/08/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/08/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/08/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/09/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/09/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/09/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/09/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_NH3Slip_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT1_SO2_LbPerHr_1H | | | CT1_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 05/09/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/09/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/09/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/09/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/09/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/09/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/09/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/09/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/09/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/09/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/09/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/09/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/09/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/09/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/09/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/09/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/09/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/09/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/09/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/09/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/10/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/10/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/10/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/10/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/10/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/10/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/10/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/10/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/10/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/10/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/10/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/10/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/10/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/10/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_NH3Slip_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT1_SO2_LbPerHr_1H | | | CT1_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 05/10/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/10/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/10/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/10/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/10/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/10/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/10/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/10/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/10/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/10/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/11/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/11/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/11/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/11/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/11/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/11/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/11/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/11/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/11/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/11/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/11/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/11/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/11/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/11/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/11/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/11/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/11/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/11/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/11/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/11/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/11/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/11/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/11/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/11/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_NH3Slip_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT1_SO2_LbPerHr_1H | | | CT1_VOC_LbPerHr_1H | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** |
| 05/12/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/12/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/12/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/12/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/12/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/12/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/12/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/12/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/12/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/12/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/12/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/12/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/12/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/12/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/12/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/12/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/12/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/12/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/12/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/12/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/12/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/12/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/12/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/12/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/13/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/13/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/13/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/13/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/13/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/13/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/13/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/13/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/13/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/13/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_NH3Slip_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT1_SO2_LbPerHr_1H | | | CT1_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 05/13/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/13/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/13/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/13/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/13/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/13/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/13/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/13/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/13/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/13/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/13/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/13/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/13/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/13/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/14/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/14/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/14/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/14/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/14/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/14/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/14/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/14/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/14/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/14/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/14/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/14/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/14/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/14/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/14/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/14/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/14/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/14/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/14/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/14/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_NH3Slip_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT1_SO2_LbPerHr_1H | | | CT1_VOC_LbPerHr_1H | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** |
| 05/14/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/14/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/14/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/14/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/15/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/15/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/15/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/15/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/15/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/15/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/15/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/15/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/15/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/15/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/15/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/15/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/15/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/15/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/15/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/15/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/15/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/15/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/15/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/15/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/15/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/15/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/15/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/15/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/16/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/16/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/16/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/16/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/16/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/16/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_NH3Slip_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT1_SO2_LbPerHr_1H | | | CT1_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 05/16/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/16/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/16/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/16/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/16/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/16/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/16/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/16/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/16/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/16/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/16/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/16/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/16/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/16/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/16/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/16/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/16/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/16/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/17/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/17/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/17/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/17/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/17/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/17/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/17/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/17/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/17/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/17/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/17/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/17/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/17/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/17/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/17/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/17/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_NH3Slip_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT1_SO2_LbPerHr_1H | | | CT1_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 05/17/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/17/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/17/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/17/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/17/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/17/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/17/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/17/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/18/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/18/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/18/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/18/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/18/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/18/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/18/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/18/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/18/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/18/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/18/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/18/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/18/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/18/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/18/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/18/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/18/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/18/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/18/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/18/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/18/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/18/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/18/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/18/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/19/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/19/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_NH3Slip_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT1_SO2_LbPerHr_1H | | | CT1_VOC_LbPerHr_1H | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** |
| 05/19/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/19/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/19/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/19/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/19/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/19/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/19/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/19/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/19/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/19/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/19/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/19/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/19/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/19/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/19/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/19/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/19/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/19/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/19/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/19/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/19/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/19/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/20/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/20/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/20/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/20/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/20/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/20/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/20/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/20/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/20/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/20/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/20/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/20/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_NH3Slip_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT1_SO2_LbPerHr_1H | | | CT1_VOC_LbPerHr_1H | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** |
| 05/20/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/20/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/20/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/20/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/20/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/20/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/20/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/20/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/20/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/20/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/20/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/20/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/21/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/21/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/21/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/21/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/21/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/21/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/21/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/21/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/21/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/21/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/21/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/21/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/21/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/21/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/21/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/21/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/21/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/21/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/21/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/21/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/21/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/21/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_NH3Slip_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT1_SO2_LbPerHr_1H | | | CT1_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 05/21/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/21/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/22/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/22/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/22/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/22/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/22/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/22/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/22/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/22/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/22/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/22/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/22/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/22/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/22/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/22/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/22/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/22/23 15:00 | 0 | | | 0 | | | 0 | X | | 0.15 | | | 0.0771 | | | 0.26 | |
| 05/22/23 16:00 | 3.2 | | | 0.7 | | | 3 | | | 0.31 | | | 0.15606 | | | 0.52 | |
| 05/22/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/22/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/22/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/22/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/22/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/22/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/22/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/23/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/23/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/23/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/23/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/23/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/23/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/23/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/23/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_NH3Slip_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT1_SO2_LbPerHr_1H | | | CT1_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 05/23/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/23/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/23/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/23/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/23/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0.19 | | | 0.09444 | | | 0.31 | |
| 05/23/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0.38 | | | 0.18972 | | | 0.63 | |
| 05/23/23 14:00 | 0.6 | | | 1.5 | | | 0 | | | 0.52 | | | 0.26244 | | | 0.87 | |
| 05/23/23 15:00 | 0.6 | | | 1.5 | | | 0 | | | 0.54 | | | 0.26832 | | | 0.89 | |
| 05/23/23 16:00 | 0.6 | | | 1.5 | | | 0 | | | 0.49 | | | 0.24666 | | | 0.82 | |
| 05/23/23 17:00 | 0.6 | | | 1.5 | | | 0 | | | 0.42 | | | 0.21096 | | | 0.7 | |
| 05/23/23 18:00 | 0 | | | 0 | | | 0 | X | | 0.26 | | | 0.1278 | | | 0.43 | |
| 05/23/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/23/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/23/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/23/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/23/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/24/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/24/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/24/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/24/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/24/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/24/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/24/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/24/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/24/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/24/23 9:00 | 0 | | | 0 | | | 0 | X | | 0.18 | | | 0.0885 | | | 0.3 | |
| 05/24/23 10:00 | 0.6 | | | 1.6 | | | 1 | | | 0.43 | | | 0.21348 | | | 0.71 | |
| 05/24/23 11:00 | 0.5 | | | 1.5 | | | 1 | | | 0.44 | | | 0.22182 | | | 0.74 | |
| 05/24/23 12:00 | 0.5 | | | 1.5 | | | 0 | | | 0.44 | | | 0.2223 | | | 0.74 | |
| 05/24/23 13:00 | 0.5 | | | 1.5 | | | 0 | | | 0.44 | | | 0.22068 | | | 0.74 | |
| 05/24/23 14:00 | 0 | | | 0 | | | 0 | X | | 0.22 | | | 0.10806 | | | 0.36 | |
| 05/24/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/24/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/24/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_NH3Slip_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT1_SO2_LbPerHr_1H | | | CT1_VOC_LbPerHr_1H | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** |
| 05/24/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/24/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/24/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/24/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/24/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/24/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/25/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/25/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/25/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/25/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/25/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/25/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/25/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/25/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/25/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/25/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/25/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/25/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/25/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/25/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/25/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/25/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/25/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/25/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/25/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/25/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/25/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/25/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/25/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/25/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/26/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/26/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/26/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/26/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_NH3Slip_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT1_SO2_LbPerHr_1H | | | CT1_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 05/26/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/26/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/26/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/26/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/26/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/26/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/26/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/26/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/26/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/26/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/26/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/26/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/26/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/26/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/26/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/26/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/26/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/26/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/26/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/26/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/27/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/27/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/27/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/27/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/27/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/27/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/27/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/27/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/27/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/27/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/27/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/27/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/27/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/27/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_NH3Slip_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT1_SO2_LbPerHr_1H | | | CT1_VOC_LbPerHr_1H | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** |
| 05/27/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/27/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/27/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/27/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/27/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/27/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/27/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/27/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/27/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/27/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/28/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/28/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/28/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/28/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/28/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/28/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/28/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/28/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/28/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/28/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/28/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/28/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/28/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/28/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/28/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/28/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/28/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/28/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/28/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/28/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/28/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/28/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/28/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/28/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_NH3Slip_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT1_SO2_LbPerHr_1H | | | CT1_VOC_LbPerHr_1H | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** |
| 05/29/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/29/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/29/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/29/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/29/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/29/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/29/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/29/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/29/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/29/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/29/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/29/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/29/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/29/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/29/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/29/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/29/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/29/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/29/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/29/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/29/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/29/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/29/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/29/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/30/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/30/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/30/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/30/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/30/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/30/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/30/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/30/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/30/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 05/30/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_NH3Slip_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT1_SO2_LbPerHr_1H | | | CT1_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 05/30/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/30/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/30/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/30/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/30/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/30/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/30/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/30/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/30/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/30/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/30/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/30/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/30/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/30/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/31/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/31/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/31/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/31/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/31/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/31/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/31/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/31/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/31/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/31/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/31/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/31/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/31/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/31/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/31/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/31/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/31/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/31/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/31/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/31/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_NH3Slip_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT1_SO2_LbPerHr_1H | | | CT1_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 05/31/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/31/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/31/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/31/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/01/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/01/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/01/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/01/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/01/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/01/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/01/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/01/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/01/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/01/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/01/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/01/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/01/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/01/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/01/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/01/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/01/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/01/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/01/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/01/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/01/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/01/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/01/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/01/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/02/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/02/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/02/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/02/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/02/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/02/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_NH3Slip_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT1_SO2_LbPerHr_1H | | | CT1_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 06/02/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/02/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/02/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/02/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/02/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/02/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/02/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/02/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/02/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/02/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/02/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/02/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/02/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/02/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/02/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/02/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/02/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/02/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/03/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/03/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/03/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/03/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/03/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/03/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/03/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/03/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/03/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/03/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/03/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/03/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/03/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/03/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/03/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/03/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_NH3Slip_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT1_SO2_LbPerHr_1H | | | CT1_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 06/03/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/03/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/03/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/03/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/03/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/03/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/03/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/03/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/04/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/04/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/04/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/04/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/04/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/04/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/04/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/04/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/04/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/04/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/04/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/04/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/04/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/04/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/04/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/04/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/04/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/04/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/04/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/04/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/04/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/04/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/04/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/04/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/05/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/05/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_NH3Slip_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT1_SO2_LbPerHr_1H | | | CT1_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 06/05/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/05/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/05/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/05/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/05/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/05/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/05/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/05/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/05/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/05/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/05/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/05/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/05/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/05/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/05/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/05/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/05/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/05/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/05/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/05/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/05/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/05/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/06/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/06/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/06/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/06/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/06/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/06/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/06/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/06/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/06/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/06/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/06/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/06/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_NH3Slip_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT1_SO2_LbPerHr_1H | | | CT1_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 06/06/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/06/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/06/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/06/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/06/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/06/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/06/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/06/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/06/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/06/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/06/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/06/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/07/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/07/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/07/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/07/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/07/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/07/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/07/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/07/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/07/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/07/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/07/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/07/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/07/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/07/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/07/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/07/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/07/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/07/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/07/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/07/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/07/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/07/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_NH3Slip_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT1_SO2_LbPerHr_1H | | | CT1_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 06/07/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/07/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/08/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/08/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/08/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/08/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/08/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/08/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/08/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/08/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/08/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/08/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/08/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/08/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/08/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/08/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/08/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/08/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/08/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/08/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/08/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/08/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/08/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/08/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/08/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/08/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/09/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/09/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/09/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/09/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/09/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/09/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/09/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/09/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_NH3Slip_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT1_SO2_LbPerHr_1H | | | CT1_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 06/09/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/09/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/09/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/09/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/09/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/09/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/09/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/09/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/09/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/09/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/09/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/09/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/09/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/09/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/09/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/09/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/10/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/10/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/10/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/10/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/10/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/10/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/10/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/10/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/10/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/10/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/10/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/10/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/10/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/10/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/10/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/10/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/10/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/10/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_NH3Slip_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT1_SO2_LbPerHr_1H | | | CT1_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 06/10/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/10/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/10/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/10/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/10/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/10/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/11/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/11/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/11/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/11/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/11/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/11/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/11/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/11/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/11/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/11/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/11/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/11/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/11/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/11/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/11/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/11/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/11/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/11/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/11/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/11/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/11/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/11/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/11/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/11/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/12/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/12/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/12/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/12/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_NH3Slip_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT1_SO2_LbPerHr_1H | | | CT1_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 06/12/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/12/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/12/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/12/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/12/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/12/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/12/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/12/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/12/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/12/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/12/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/12/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/12/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/12/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/12/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/12/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/12/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/12/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/12/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/12/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/13/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/13/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/13/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/13/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/13/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/13/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/13/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/13/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/13/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/13/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/13/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/13/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/13/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/13/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_NH3Slip_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT1_SO2_LbPerHr_1H | | | CT1_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 06/13/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/13/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/13/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/13/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/13/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/13/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/13/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/13/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/13/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/13/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/14/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/14/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/14/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/14/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/14/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/14/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/14/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/14/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/14/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/14/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/14/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/14/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/14/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/14/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/14/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/14/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/14/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/14/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/14/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/14/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/14/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/14/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/14/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/14/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_NH3Slip_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT1_SO2_LbPerHr_1H | | | CT1_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 06/15/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/15/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/15/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/15/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/15/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/15/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/15/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/15/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/15/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/15/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/15/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/15/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/15/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/15/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/15/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/15/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/15/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/15/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/15/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/15/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/15/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/15/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/15/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/15/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/16/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/16/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/16/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/16/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/16/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/16/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/16/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/16/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/16/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/16/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_NH3Slip_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT1_SO2_LbPerHr_1H | | | CT1_VOC_LbPerHr_1H | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** |
| 06/16/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 06/16/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 06/16/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 06/16/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 06/16/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 06/16/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 06/16/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 06/16/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 06/16/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 06/16/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 06/16/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 06/16/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 06/16/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 06/16/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 06/17/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 06/17/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 06/17/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 06/17/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 06/17/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 06/17/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 06/17/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 06/17/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 06/17/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 06/17/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 06/17/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 06/17/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 06/17/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 06/17/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 06/17/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 06/17/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 06/17/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 06/17/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 06/17/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 06/17/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_NH3Slip_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT1_SO2_LbPerHr_1H | | | CT1_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 06/17/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/17/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/17/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/17/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/18/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/18/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/18/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/18/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/18/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/18/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/18/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/18/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/18/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/18/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/18/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/18/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/18/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/18/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/18/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/18/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/18/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/18/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/18/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/18/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/18/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/18/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/18/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/18/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/19/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/19/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/19/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/19/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/19/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/19/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_NH3Slip_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT1_SO2_LbPerHr_1H | | | CT1_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 06/19/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/19/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/19/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/19/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/19/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/19/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/19/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/19/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/19/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/19/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/19/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/19/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/19/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/19/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/19/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/19/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/19/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/19/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/20/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/20/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/20/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/20/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/20/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/20/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/20/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/20/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/20/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/20/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/20/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/20/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/20/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/20/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/20/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/20/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_NH3Slip_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT1_SO2_LbPerHr_1H | | | CT1_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 06/20/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/20/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/20/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/20/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/20/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/20/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/20/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/20/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/21/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/21/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/21/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/21/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/21/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/21/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/21/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/21/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/21/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/21/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/21/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/21/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/21/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/21/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/21/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/21/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/21/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/21/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/21/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/21/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/21/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/21/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/21/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/21/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/22/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/22/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_NH3Slip_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT1_SO2_LbPerHr_1H | | | CT1_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 06/22/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/22/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/22/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/22/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/22/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/22/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/22/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/22/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/22/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/22/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/22/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/22/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/22/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/22/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/22/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/22/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/22/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/22/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/22/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/22/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/22/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/22/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/23/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/23/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/23/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/23/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/23/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/23/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/23/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/23/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/23/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/23/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/23/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/23/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_NH3Slip_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT1_SO2_LbPerHr_1H | | | CT1_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 06/23/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/23/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/23/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/23/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/23/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/23/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/23/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/23/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/23/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/23/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/23/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/23/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/24/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/24/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/24/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/24/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/24/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/24/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/24/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/24/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/24/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/24/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/24/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/24/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/24/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/24/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/24/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/24/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/24/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/24/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/24/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/24/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/24/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/24/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| **Mod** | | | | | | | | | | | | | | | | | |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_NH3Slip_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT1_SO2_LbPerHr_1H | | | CT1_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 06/24/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/24/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/25/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/25/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/25/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/25/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/25/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/25/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/25/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/25/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/25/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/25/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/25/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/25/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/25/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/25/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/25/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/25/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/25/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/25/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/25/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/25/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/25/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/25/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/25/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/25/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/26/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/26/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/26/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/26/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/26/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/26/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/26/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/26/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_NH3Slip_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT1_SO2_LbPerHr_1H | | | CT1_VOC_LbPerHr_1H | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** |
| 06/26/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 06/26/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 06/26/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 06/26/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 06/26/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 06/26/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 06/26/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 06/26/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 06/26/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 06/26/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 06/26/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 06/26/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 06/26/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 06/26/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 06/26/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 06/26/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 06/27/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 06/27/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 06/27/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 06/27/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 06/27/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 06/27/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 06/27/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 06/27/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 06/27/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 06/27/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 06/27/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 06/27/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 06/27/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 06/27/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 06/27/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 06/27/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 06/27/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 06/27/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_NH3Slip_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT1_SO2_LbPerHr_1H | | | CT1_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 06/27/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/27/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/27/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/27/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/27/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/27/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/28/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/28/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/28/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/28/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/28/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/28/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/28/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/28/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/28/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/28/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/28/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/28/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/28/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/28/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/28/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/28/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/28/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/28/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/28/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/28/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/28/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/28/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/28/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/28/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/29/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/29/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/29/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/29/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_NH3Slip_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT1_SO2_LbPerHr_1H | | | CT1_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 06/29/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/29/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/29/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/29/23 7:00 | 0 | | | 0 | | | 0 | X | | 0.3 | | | 0.15216 | | | 0.51 | |
| 06/29/23 8:00 | 0.6 | | | 1.6 | | | 1 | | | 0.52 | | | 0.26094 | | | 0.87 | |
| 06/29/23 9:00 | 0.6 | | | 1.4 | | | 0 | | | 0.52 | | | 0.25914 | | | 0.86 | |
| 06/29/23 10:00 | 1 | | | 1.6 | | | 1 | | | 0.55 | | | 0.2766 | | | 0.92 | |
| 06/29/23 11:00 | 0.8 | | | 1.5 | | | 0 | | | 0.46 | | | 0.22872 | | | 0.76 | |
| 06/29/23 12:00 | 0.6 | | | 1.5 | | | 0 | | | 0.42 | | | 0.21234 | | | 0.71 | |
| 06/29/23 13:00 | 0.6 | | | 1.5 | | | 0 | | | 0.43 | | | 0.21306 | | | 0.71 | |
| 06/29/23 14:00 | 0.6 | | | 1.5 | | | 0 | | | 0.43 | | | 0.21348 | | | 0.71 | |
| 06/29/23 15:00 | 0.6 | | | 1.5 | | | 0 | | | 0.43 | | | 0.21342 | | | 0.71 | |
| 06/29/23 16:00 | 0.8 | | | 1.6 | | | 0 | | | 0.5 | | | 0.24768 | | | 0.83 | |
| 06/29/23 17:00 | 0.5 | | | 1.5 | | | 1 | | | 0.63 | | | 0.31482 | | | 1.05 | |
| 06/29/23 18:00 | 0.4 | | | 1.5 | | | 1 | | | 0.65 | | | 0.32448 | | | 1.08 | |
| 06/29/23 19:00 | 0.3 | | | 1.5 | | | 1 | | | 0.66 | | | 0.32892 | | | 1.1 | |
| 06/29/23 20:00 | 0.5 | | | 1.5 | | | 1 | | | 0.63 | | | 0.31374 | | | 1.05 | |
| 06/29/23 21:00 | 0.5 | | | 1.5 | | | 1 | | | 0.62 | | | 0.31092 | | | 1.04 | |
| 06/29/23 22:00 | 0.6 | | | 1.5 | | | 1 | | | 0.62 | | | 0.30948 | | | 1.03 | |
| 06/29/23 23:00 | 0.6 | | | 1.5 | | | 1 | | | 0.62 | | | 0.30828 | | | 1.03 | |
| 06/30/23 0:00 | 0.7 | | | 1.5 | | | 1 | | | 0.61 | | | 0.30708 | | | 1.02 | |
| 06/30/23 1:00 | 0.8 | | | 1.5 | | | 1 | | | 0.61 | | | 0.3054 | | | 1.02 | |
| 06/30/23 2:00 | 0.8 | | | 1.5 | | | 1 | | | 0.61 | | | 0.30444 | | | 1.01 | |
| 06/30/23 3:00 | 0.9 | | | 1.5 | | | 1 | | | 0.61 | | | 0.30372 | | | 1.01 | |
| 06/30/23 4:00 | 0.9 | | | 1.5 | | | 1 | | | 0.61 | | | 0.3027 | | | 1.01 | |
| 06/30/23 5:00 | 0.9 | | | 1.5 | | | 1 | | | 0.6 | | | 0.30156 | | | 1.01 | |
| 06/30/23 6:00 | 1 | | | 1.5 | | | 1 | | | 0.6 | | | 0.30084 | | | 1 | |
| 06/30/23 7:00 | 1 | | | 1.5 | | | 1 | | | 0.57 | | | 0.28584 | | | 0.95 | |
| 06/30/23 8:00 | 0.7 | | | 1.4 | | | 0 | | | 0.43 | | | 0.21276 | | | 0.71 | |
| 06/30/23 9:00 | 0.7 | | | 1.5 | | | 0 | | | 0.43 | | | 0.21252 | | | 0.71 | |
| 06/30/23 10:00 | 0.6 | | | 1.5 | | | 0 | | | 0.43 | | | 0.21294 | | | 0.71 | |
| 06/30/23 11:00 | 1 | | | 1.5 | | | 1 | | | 0.49 | | | 0.24726 | | | 0.82 | |
| 06/30/23 12:00 | 0.6 | | | 1.5 | | | 1 | | | 0.62 | | | 0.30948 | | | 1.03 | |
| 06/30/23 13:00 | 0.6 | | | 1.5 | | | 1 | | | 0.62 | | | 0.31134 | | | 1.04 | |

| | CT1_CO_Ppmvdc_1H | | | CT1_NOx_Ppmvdc_1H | | | CT1_NH3Slip_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT1_SO2_LbPerHr_1H | | | CT1_VOC_LbPerHr_1H | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** |
| 06/30/23 14:00 | 0.6 | | | 1.5 | | | 1 | | | 0.64 | | | 0.318 | | | 1.06 | | |
| 06/30/23 15:00 | 0.5 | | | 1.5 | | | 1 | | | 0.63 | | | 0.31254 | | | 1.04 | | |
| 06/30/23 16:00 | 0.5 | | | 1.5 | | | 1 | | | 0.62 | | | 0.312 | | | 1.04 | | |
| 06/30/23 17:00 | 0.5 | | | 1.5 | | | 1 | | | 0.62 | | | 0.31134 | | | 1.04 | | |
| 06/30/23 18:00 | 0.4 | | | 1.5 | | | 1 | | | 0.64 | | | 0.3192 | | | 1.06 | | |
| 06/30/23 19:00 | 0.2 | | | 1.5 | | | 2 | | | 0.71 | | | 0.3543 | | | 1.18 | | |
| 06/30/23 20:00 | 0.4 | | | 1.5 | | | 1 | | | 0.64 | | | 0.31908 | | | 1.06 | | |
| 06/30/23 21:00 | 0.5 | | | 1.5 | | | 1 | | | 0.62 | | | 0.31152 | | | 1.04 | | |
| 06/30/23 22:00 | 0.5 | | | 1.5 | | | 1 | | | 0.62 | | | 0.31086 | | | 1.04 | | |
| 06/30/23 23:00 | 0.7 | | | 1.5 | | | 1 | | | 0.61 | | | 0.30516 | | | 1.02 | | |

# AQ57 CT2 HOURLY EMISSIONS

| | CT2_CO_Ppmvdc_1H | | | CT2_NH3Slip_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | CT2_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 04/01/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/01/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/01/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/01/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/01/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/01/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/01/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/01/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/01/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/01/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/01/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/01/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/01/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/01/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/01/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/01/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/01/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/01/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/01/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/01/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/01/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/01/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/01/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/01/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/02/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/02/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/02/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/02/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/02/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/02/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/02/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/02/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT2_CO_Ppmvdc_1H | | | CT2_NH3Slip_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | CT2_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 04/02/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/02/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/02/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/02/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/02/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/02/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/02/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/02/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/02/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/02/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/02/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/02/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/02/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/02/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/02/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/02/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/03/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/03/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/03/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/03/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/03/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/03/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/03/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/03/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/03/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/03/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/03/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/03/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/03/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/03/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/03/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/03/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/03/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/03/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT2_CO_Ppmvdc_1H | | | CT2_NH3Slip_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | CT2_VOC_LbPerHr_1H | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** |
| 04/03/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/03/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/03/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/03/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/03/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/03/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/04/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/04/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/04/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/04/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/04/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/04/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/04/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/04/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/04/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/04/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/04/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/04/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/04/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/04/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/04/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/04/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/04/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/04/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/04/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/04/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/04/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/04/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/04/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/04/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/05/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/05/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/05/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/05/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |

| | CT2_CO_Ppmvdc_1H | | | CT2_NH3Slip_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | CT2_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 04/05/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/05/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/05/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/05/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/05/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/05/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/05/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/05/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/05/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/05/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/05/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/05/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/05/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/05/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/05/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/05/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/05/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/05/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/05/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/05/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/06/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/06/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/06/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/06/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/06/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/06/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/06/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/06/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/06/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/06/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/06/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/06/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/06/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/06/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT2_CO_Ppmvdc_1H | | | CT2_NH3Slip_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | CT2_VOC_LbPerHr_1H | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** |
| 04/06/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/06/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/06/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/06/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/06/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/06/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/06/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/06/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/06/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/06/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/07/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/07/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/07/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/07/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/07/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/07/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/07/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/07/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/07/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/07/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/07/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/07/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/07/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/07/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/07/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/07/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/07/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/07/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/07/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/07/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/07/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/07/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/07/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |
| 04/07/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | |

| | CT2_CO_Ppmvdc_1H | | | CT2_NH3Slip_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | CT2_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 04/08/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/08/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/08/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/08/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/08/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/08/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/08/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/08/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/08/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/08/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/08/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/08/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/08/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/08/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/08/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/08/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/08/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/08/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/08/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/08/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/08/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/08/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/08/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/08/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/09/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/09/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/09/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/09/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/09/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/09/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/09/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/09/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/09/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/09/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT2_CO_Ppmvdc_1H | | | CT2_NH3Slip_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | CT2_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 04/09/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/09/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/09/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/09/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/09/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/09/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/09/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/09/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/09/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/09/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/09/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/09/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/09/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/09/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/10/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/10/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/10/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/10/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/10/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/10/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/10/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/10/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/10/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/10/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/10/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/10/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/10/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/10/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/10/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/10/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/10/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/10/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/10/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/10/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT2_CO_Ppmvdc_1H | | | CT2_NH3Slip_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | CT2_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 04/10/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/10/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/10/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/10/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/11/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/11/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/11/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/11/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/11/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/11/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/11/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/11/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/11/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/11/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/11/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/11/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/11/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/11/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/11/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/11/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/11/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/11/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/11/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/11/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/11/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/11/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/11/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/11/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/12/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/12/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/12/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/12/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/12/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/12/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT2_CO_Ppmvdc_1H | | | CT2_NH3Slip_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | CT2_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 04/12/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/12/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/12/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/12/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/12/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/12/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/12/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/12/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/12/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/12/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/12/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/12/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/12/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/12/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/12/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/12/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/12/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/12/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/13/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/13/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/13/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/13/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/13/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/13/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/13/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/13/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/13/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/13/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/13/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/13/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/13/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/13/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/13/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/13/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT2_CO_Ppmvdc_1H | | | CT2_NH3Slip_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | CT2_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 04/13/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/13/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/13/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/13/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/13/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/13/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/13/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/13/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/14/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/14/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/14/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/14/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/14/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/14/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/14/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/14/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/14/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/14/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/14/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/14/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/14/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/14/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/14/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/14/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/14/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/14/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/14/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/14/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/14/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/14/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/14/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/14/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/15/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/15/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT2_CO_Ppmvdc_1H | | | CT2_NH3Slip_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | CT2_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 04/15/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/15/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/15/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/15/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/15/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/15/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/15/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/15/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/15/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/15/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/15/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/15/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/15/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/15/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/15/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/15/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/15/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/15/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/15/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/15/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/15/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/15/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/16/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/16/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/16/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/16/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/16/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/16/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/16/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/16/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/16/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/16/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/16/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/16/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT2_CO_Ppmvdc_1H | | | CT2_NH3Slip_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | CT2_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 04/16/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/16/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/16/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/16/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/16/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/16/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/16/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/16/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/16/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/16/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/16/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/16/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/17/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/17/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/17/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/17/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/17/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/17/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/17/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/17/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/17/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/17/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/17/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/17/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/17/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/17/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/17/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/17/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/17/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/17/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/17/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/17/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/17/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/17/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT2_CO_Ppmvdc_1H | | | CT2_NH3Slip_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | CT2_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 04/17/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/17/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/18/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/18/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/18/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/18/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/18/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/18/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/18/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/18/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/18/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/18/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/18/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/18/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/18/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/18/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/18/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/18/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/18/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/18/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/18/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/18/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/18/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/18/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/18/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/18/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/19/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/19/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/19/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/19/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/19/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/19/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/19/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/19/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT2_CO_Ppmvdc_1H | | | CT2_NH3Slip_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | CT2_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 04/19/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/19/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/19/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/19/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/19/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/19/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/19/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/19/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/19/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/19/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/19/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/19/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/19/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/19/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/19/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/19/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/20/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/20/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/20/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/20/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/20/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/20/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/20/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/20/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/20/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/20/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/20/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/20/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/20/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/20/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/20/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/20/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/20/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/20/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT2_CO_Ppmvdc_1H | | | CT2_NH3Slip_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | CT2_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 04/20/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/20/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/20/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/20/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/20/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/20/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/21/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/21/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/21/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/21/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/21/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/21/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/21/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/21/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/21/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/21/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/21/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/21/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/21/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/21/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/21/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/21/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/21/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/21/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/21/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/21/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/21/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/21/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/21/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/21/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/22/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/22/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/22/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/22/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT2_CO_Ppmvdc_1H | | | CT2_NH3Slip_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | CT2_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 04/22/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/22/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/22/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/22/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/22/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/22/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/22/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/22/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/22/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/22/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/22/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/22/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/22/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/22/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/22/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/22/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/22/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/22/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/22/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/22/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/23/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/23/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/23/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/23/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/23/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/23/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/23/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/23/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/23/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/23/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/23/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/23/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/23/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/23/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT2_CO_Ppmvdc_1H | | | CT2_NH3Slip_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | CT2_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 04/23/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/23/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/23/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/23/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/23/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/23/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/23/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/23/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/23/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/23/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/24/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/24/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/24/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/24/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/24/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/24/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/24/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/24/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/24/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/24/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/24/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/24/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/24/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/24/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/24/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/24/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/24/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/24/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/24/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/24/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/24/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/24/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/24/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/24/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT2_CO_Ppmvdc_1H | | | CT2_NH3Slip_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | CT2_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 04/25/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/25/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/25/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/25/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/25/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/25/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/25/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/25/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/25/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/25/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/25/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/25/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/25/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/25/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/25/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/25/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/25/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/25/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/25/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/25/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/25/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/25/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/25/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/25/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/26/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/26/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/26/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/26/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/26/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/26/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/26/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/26/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/26/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/26/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT2_CO_Ppmvdc_1H | | | CT2_NH3Slip_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | CT2_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 04/26/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/26/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/26/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/26/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/26/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/26/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/26/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/26/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/26/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/26/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/26/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/26/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/26/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/26/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/27/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/27/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/27/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/27/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/27/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/27/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/27/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/27/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/27/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/27/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/27/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/27/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/27/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/27/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/27/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/27/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/27/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/27/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/27/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/27/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT2_CO_Ppmvdc_1H | | | CT2_NH3Slip_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | CT2_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 04/27/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/27/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/27/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/27/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/28/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/28/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/28/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/28/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/28/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/28/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/28/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/28/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/28/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/28/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/28/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/28/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/28/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/28/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/28/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/28/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/28/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/28/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/28/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/28/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/28/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/28/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/28/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/28/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/29/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/29/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/29/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/29/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/29/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/29/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT2_CO_Ppmvdc_1H | | | CT2_NH3Slip_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | CT2_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 04/29/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/29/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/29/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/29/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/29/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/29/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/29/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/29/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/29/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/29/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/29/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/29/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/29/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/29/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/29/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/29/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/29/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/29/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/30/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/30/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/30/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/30/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/30/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/30/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/30/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/30/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/30/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/30/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/30/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/30/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/30/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/30/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/30/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/30/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT2_CO_Ppmvdc_1H | | | CT2_NH3Slip_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | CT2_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 04/30/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/30/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/30/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/30/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/30/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/30/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/30/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 04/30/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/01/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/01/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/01/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/01/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/01/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/01/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/01/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/01/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/01/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/01/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/01/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/01/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/01/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/01/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/01/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/01/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/01/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/01/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/01/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/01/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/01/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/01/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/01/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/01/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/02/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/02/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT2_CO_Ppmvdc_1H | | | CT2_NH3Slip_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | CT2_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 05/02/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/02/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/02/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/02/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/02/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/02/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/02/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/02/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/02/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/02/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/02/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/02/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/02/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/02/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/02/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/02/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/02/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/02/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/02/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/02/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/02/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/02/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/03/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/03/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/03/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/03/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/03/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/03/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/03/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/03/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/03/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/03/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/03/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/03/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT2_CO_Ppmvdc_1H | | | CT2_NH3Slip_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | CT2_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 05/03/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/03/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/03/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/03/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/03/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/03/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/03/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/03/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/03/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/03/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/03/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/03/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/04/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/04/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/04/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/04/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/04/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/04/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/04/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/04/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/04/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/04/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/04/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/04/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/04/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/04/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/04/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/04/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/04/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/04/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/04/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/04/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/04/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/04/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT2_CO_Ppmvdc_1H | | | CT2_NH3Slip_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | CT2_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 05/04/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/04/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/05/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/05/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/05/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/05/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/05/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/05/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/05/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/05/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/05/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/05/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/05/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/05/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/05/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/05/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/05/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/05/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/05/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/05/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/05/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/05/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/05/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/05/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/05/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/05/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/06/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/06/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/06/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/06/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/06/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/06/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/06/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/06/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT2_CO_Ppmvdc_1H | | | CT2_NH3Slip_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | CT2_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 05/06/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/06/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/06/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/06/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/06/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/06/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/06/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/06/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/06/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/06/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/06/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/06/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/06/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/06/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/06/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/06/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/07/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/07/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/07/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/07/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/07/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/07/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/07/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/07/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/07/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/07/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/07/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/07/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/07/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/07/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/07/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/07/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/07/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/07/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT2_CO_Ppmvdc_1H | | | CT2_NH3Slip_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | CT2_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 05/07/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/07/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/07/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/07/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/07/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/07/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/08/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/08/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/08/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/08/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/08/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/08/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/08/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/08/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/08/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/08/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/08/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/08/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/08/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/08/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/08/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/08/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/08/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/08/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/08/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/08/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/08/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/08/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/08/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/08/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/09/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/09/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/09/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/09/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT2_CO_Ppmvdc_1H | | | CT2_NH3Slip_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | CT2_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 05/09/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/09/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/09/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/09/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/09/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/09/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/09/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/09/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/09/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/09/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/09/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/09/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/09/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/09/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/09/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/09/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/09/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/09/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/09/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/09/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/10/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/10/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/10/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/10/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/10/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/10/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/10/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/10/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/10/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/10/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/10/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/10/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/10/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/10/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT2_CO_Ppmvdc_1H | | | CT2_NH3Slip_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | CT2_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 05/10/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/10/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/10/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/10/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/10/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/10/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/10/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/10/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/10/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/10/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/11/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/11/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/11/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/11/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/11/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/11/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/11/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/11/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/11/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/11/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/11/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/11/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/11/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/11/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/11/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/11/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/11/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/11/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/11/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/11/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/11/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/11/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/11/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/11/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT2_CO_Ppmvdc_1H | | | CT2_NH3Slip_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | CT2_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 05/12/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/12/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/12/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/12/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/12/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/12/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/12/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/12/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/12/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/12/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/12/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/12/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/12/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/12/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/12/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/12/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/12/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/12/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/12/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/12/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/12/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/12/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/12/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/12/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/13/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/13/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/13/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/13/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/13/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/13/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/13/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/13/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/13/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/13/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT2_CO_Ppmvdc_1H | | | CT2_NH3Slip_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | CT2_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 05/13/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/13/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/13/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/13/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/13/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/13/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/13/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/13/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/13/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/13/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/13/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/13/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/13/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/13/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/14/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/14/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/14/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/14/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/14/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/14/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/14/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/14/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/14/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/14/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/14/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/14/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/14/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/14/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/14/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/14/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/14/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/14/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/14/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/14/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT2_CO_Ppmvdc_1H | | | CT2_NH3Slip_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | CT2_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 05/14/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/14/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/14/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/14/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/15/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/15/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/15/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/15/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/15/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/15/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/15/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/15/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/15/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/15/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/15/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/15/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/15/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/15/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/15/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/15/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/15/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/15/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/15/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/15/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/15/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/15/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/15/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/15/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/16/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/16/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/16/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/16/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/16/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/16/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT2_CO_Ppmvdc_1H | | | CT2_NH3Slip_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | CT2_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 05/16/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/16/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/16/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/16/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/16/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/16/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/16/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/16/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/16/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/16/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/16/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/16/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/16/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/16/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/16/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/16/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/16/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/16/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/17/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/17/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/17/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/17/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/17/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/17/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/17/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/17/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/17/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/17/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/17/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/17/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/17/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/17/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/17/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/17/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT2_CO_Ppmvdc_1H | | | CT2_NH3Slip_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | CT2_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 05/17/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/17/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/17/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/17/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/17/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/17/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/17/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/17/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/18/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/18/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/18/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/18/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/18/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/18/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/18/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/18/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/18/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/18/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/18/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/18/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/18/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/18/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/18/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/18/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/18/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/18/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/18/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/18/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/18/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/18/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/18/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/18/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/19/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/19/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT2_CO_Ppmvdc_1H | | | CT2_NH3Slip_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | CT2_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 05/19/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/19/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/19/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/19/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/19/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/19/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/19/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/19/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/19/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/19/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/19/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/19/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/19/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/19/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/19/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/19/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/19/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/19/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/19/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/19/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/19/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/19/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/20/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/20/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/20/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/20/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/20/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/20/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/20/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/20/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/20/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/20/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/20/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/20/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT2_CO_Ppmvdc_1H | | | CT2_NH3Slip_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | CT2_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 05/20/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/20/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/20/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/20/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/20/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/20/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/20/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/20/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/20/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/20/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/20/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/20/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/21/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/21/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/21/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/21/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/21/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/21/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/21/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/21/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/21/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/21/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/21/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/21/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/21/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/21/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/21/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/21/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/21/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/21/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/21/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/21/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/21/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/21/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT2_CO_Ppmvdc_1H | | | CT2_NH3Slip_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | CT2_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 05/21/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/21/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/22/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/22/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/22/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/22/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/22/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/22/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/22/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/22/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/22/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/22/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/22/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/22/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/22/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/22/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/22/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/22/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0.15 | | | 0 | X | | 0 | X |
| 05/22/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0.31 | | | 0 | X | | 0 | X |
| 05/22/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/22/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/22/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/22/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/22/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/22/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/22/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/23/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/23/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/23/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/23/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/23/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/23/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/23/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/23/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT2_CO_Ppmvdc_1H | | | CT2_NH3Slip_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | CT2_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 05/23/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/23/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/23/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/23/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/23/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0.19 | | | 0 | X | | 0 | X |
| 05/23/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0.38 | | | 0 | X | | 0 | X |
| 05/23/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0.52 | | | 0 | X | | 0 | X |
| 05/23/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0.54 | | | 0 | X | | 0 | X |
| 05/23/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0.49 | | | 0 | X | | 0 | X |
| 05/23/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0.42 | | | 0 | X | | 0 | X |
| 05/23/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0.26 | | | 0 | X | | 0 | X |
| 05/23/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/23/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/23/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/23/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/23/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/24/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/24/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/24/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/24/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/24/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/24/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/24/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/24/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/24/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/24/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0.18 | | | 0 | X | | 0 | X |
| 05/24/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0.43 | | | 0 | X | | 0 | X |
| 05/24/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0.44 | | | 0 | X | | 0 | X |
| 05/24/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0.44 | | | 0 | X | | 0 | X |
| 05/24/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0.44 | | | 0 | X | | 0 | X |
| 05/24/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0.22 | | | 0 | X | | 0 | X |
| 05/24/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/24/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/24/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT2_CO_Ppmvdc_1H | | | CT2_NH3Slip_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | CT2_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 05/24/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/24/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/24/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/24/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/24/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/24/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/25/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/25/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/25/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/25/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/25/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/25/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/25/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/25/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/25/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/25/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/25/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/25/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/25/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/25/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/25/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/25/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/25/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/25/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/25/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/25/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/25/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/25/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/25/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/25/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/26/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/26/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/26/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/26/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT2_CO_Ppmvdc_1H | | | CT2_NH3Slip_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | CT2_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 05/26/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/26/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/26/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/26/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/26/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/26/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/26/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/26/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/26/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/26/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/26/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/26/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/26/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/26/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/26/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/26/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/26/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/26/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/26/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/26/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/27/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/27/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/27/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/27/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/27/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/27/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/27/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/27/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/27/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/27/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/27/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/27/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/27/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/27/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT2_CO_Ppmvdc_1H | | | CT2_NH3Slip_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | CT2_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 05/27/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/27/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/27/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/27/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/27/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/27/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/27/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/27/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/27/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/27/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/28/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/28/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/28/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/28/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/28/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/28/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/28/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/28/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/28/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/28/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/28/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/28/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/28/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/28/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/28/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/28/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/28/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/28/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/28/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/28/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/28/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/28/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/28/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/28/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT2_CO_Ppmvdc_1H | | | CT2_NH3Slip_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | CT2_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 05/29/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/29/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/29/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/29/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/29/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/29/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/29/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/29/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/29/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/29/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/29/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/29/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/29/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/29/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/29/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/29/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/29/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/29/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/29/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/29/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/29/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/29/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/29/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/29/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/30/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/30/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/30/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/30/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/30/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/30/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/30/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/30/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/30/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/30/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT2_CO_Ppmvdc_1H | | | CT2_NH3Slip_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | CT2_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 05/30/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/30/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/30/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/30/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/30/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/30/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/30/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/30/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/30/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/30/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/30/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/30/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/30/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/30/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/31/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/31/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/31/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/31/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/31/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/31/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/31/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/31/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/31/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/31/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/31/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/31/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/31/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/31/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/31/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/31/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/31/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/31/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/31/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/31/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT2_CO_Ppmvdc_1H | | | CT2_NH3Slip_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | CT2_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 05/31/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/31/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/31/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 05/31/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/01/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/01/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/01/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/01/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/01/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/01/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/01/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/01/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/01/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/01/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/01/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/01/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/01/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/01/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/01/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/01/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/01/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/01/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/01/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/01/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/01/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/01/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/01/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/01/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/02/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/02/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/02/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/02/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/02/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/02/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT2_CO_Ppmvdc_1H | | | CT2_NH3Slip_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | CT2_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 06/02/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/02/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/02/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/02/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/02/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/02/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/02/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/02/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/02/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/02/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/02/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/02/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/02/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/02/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/02/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/02/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/02/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/02/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/03/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/03/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/03/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/03/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/03/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/03/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/03/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/03/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/03/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/03/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/03/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/03/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/03/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/03/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/03/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/03/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT2_CO_Ppmvdc_1H | | | CT2_NH3Slip_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | CT2_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 06/03/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/03/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/03/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/03/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/03/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/03/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/03/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/03/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/04/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/04/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/04/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/04/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/04/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/04/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/04/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/04/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/04/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/04/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/04/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/04/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/04/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/04/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/04/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/04/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/04/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/04/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/04/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/04/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/04/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/04/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/04/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/04/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/05/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/05/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT2_CO_Ppmvdc_1H | | | CT2_NH3Slip_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | CT2_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 06/05/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/05/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/05/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/05/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/05/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/05/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/05/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/05/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/05/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/05/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/05/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/05/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/05/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/05/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/05/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/05/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/05/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/05/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/05/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/05/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/05/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/05/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/06/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/06/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/06/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/06/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/06/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/06/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/06/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/06/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/06/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/06/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/06/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/06/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT2_CO_Ppmvdc_1H | | | CT2_NH3Slip_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | CT2_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 06/06/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/06/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/06/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/06/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/06/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/06/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/06/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/06/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/06/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/06/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/06/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/06/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/07/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/07/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/07/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/07/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/07/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/07/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/07/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/07/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/07/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/07/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/07/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/07/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/07/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/07/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/07/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/07/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/07/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/07/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/07/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/07/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/07/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/07/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT2_CO_Ppmvdc_1H | | | CT2_NH3Slip_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | CT2_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 06/07/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/07/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/08/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/08/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/08/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/08/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/08/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/08/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/08/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/08/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/08/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/08/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/08/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/08/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/08/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/08/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/08/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/08/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/08/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/08/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/08/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/08/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/08/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/08/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/08/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/08/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/09/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/09/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/09/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/09/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/09/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/09/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/09/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/09/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT2_CO_Ppmvdc_1H | | | CT2_NH3Slip_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | CT2_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 06/09/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/09/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/09/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/09/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/09/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/09/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/09/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/09/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/09/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/09/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/09/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/09/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/09/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/09/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/09/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/09/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/10/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/10/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/10/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/10/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/10/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/10/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/10/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/10/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/10/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/10/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/10/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/10/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/10/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/10/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/10/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/10/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/10/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/10/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT2_CO_Ppmvdc_1H | | | CT2_NH3Slip_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | CT2_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 06/10/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/10/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/10/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/10/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/10/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/10/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/11/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/11/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/11/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/11/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/11/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/11/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/11/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/11/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/11/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/11/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/11/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/11/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/11/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/11/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/11/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/11/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/11/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/11/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/11/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/11/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/11/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/11/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/11/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/11/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/12/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/12/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/12/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/12/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT2_CO_Ppmvdc_1H | | | CT2_NH3Slip_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | CT2_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 06/12/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/12/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/12/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/12/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/12/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/12/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/12/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/12/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/12/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/12/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/12/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/12/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/12/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/12/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/12/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/12/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/12/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/12/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/12/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/12/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/13/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/13/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/13/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/13/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/13/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/13/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/13/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/13/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/13/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/13/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/13/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/13/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/13/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/13/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT2_CO_Ppmvdc_1H | | | CT2_NH3Slip_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | CT2_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 06/13/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/13/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/13/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/13/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/13/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/13/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/13/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/13/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/13/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/13/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/14/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/14/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/14/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/14/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/14/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/14/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/14/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/14/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/14/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/14/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/14/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/14/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/14/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/14/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/14/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/14/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/14/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/14/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/14/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/14/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/14/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/14/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/14/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/14/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT2_CO_Ppmvdc_1H | | | CT2_NH3Slip_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | CT2_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 06/15/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/15/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/15/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/15/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/15/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/15/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/15/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/15/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/15/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/15/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/15/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/15/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/15/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/15/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/15/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/15/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/15/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/15/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/15/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/15/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/15/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/15/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/15/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/15/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/16/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/16/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/16/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/16/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/16/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/16/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/16/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/16/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/16/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/16/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT2_CO_Ppmvdc_1H | | | CT2_NH3Slip_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | CT2_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 06/16/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/16/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/16/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/16/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/16/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/16/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/16/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/16/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/16/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/16/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/16/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/16/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/16/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/16/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/17/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/17/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/17/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/17/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/17/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/17/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/17/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/17/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/17/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/17/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/17/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/17/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/17/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/17/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/17/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/17/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/17/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/17/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/17/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/17/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT2_CO_Ppmvdc_1H | | | CT2_NH3Slip_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | CT2_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 06/17/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/17/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/17/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/17/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/18/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/18/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/18/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/18/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/18/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/18/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/18/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/18/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/18/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/18/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/18/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/18/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/18/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/18/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/18/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/18/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/18/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/18/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/18/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/18/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/18/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/18/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/18/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/18/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/19/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/19/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/19/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/19/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/19/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/19/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT2_CO_Ppmvdc_1H | | | CT2_NH3Slip_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | CT2_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 06/19/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/19/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/19/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/19/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/19/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/19/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/19/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/19/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/19/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/19/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/19/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/19/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/19/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/19/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/19/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/19/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/19/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/19/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/20/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/20/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/20/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/20/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/20/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/20/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/20/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/20/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/20/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/20/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/20/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/20/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/20/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/20/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/20/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/20/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT2_CO_Ppmvdc_1H | | | CT2_NH3Slip_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | CT2_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 06/20/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/20/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/20/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/20/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/20/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/20/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/20/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/20/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/21/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/21/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/21/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/21/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/21/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/21/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/21/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/21/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/21/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/21/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/21/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/21/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/21/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/21/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/21/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/21/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/21/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/21/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/21/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/21/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/21/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/21/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/21/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/21/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/22/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/22/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT2_CO_Ppmvdc_1H | | | CT2_NH3Slip_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | CT2_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 06/22/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/22/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/22/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/22/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/22/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/22/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/22/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/22/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/22/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/22/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/22/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/22/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/22/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/22/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/22/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/22/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/22/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/22/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/22/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/22/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/22/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/22/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/23/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/23/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/23/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/23/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/23/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/23/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/23/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/23/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/23/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/23/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/23/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/23/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT2_CO_Ppmvdc_1H | | | CT2_NH3Slip_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | CT2_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 06/23/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/23/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/23/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/23/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/23/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/23/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/23/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/23/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/23/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/23/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/23/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/23/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/24/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/24/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/24/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/24/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/24/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/24/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/24/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/24/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/24/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/24/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/24/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/24/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/24/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/24/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/24/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/24/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/24/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/24/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/24/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/24/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/24/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/24/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT2_CO_Ppmvdc_1H | | | CT2_NH3Slip_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | CT2_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 06/24/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/24/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/25/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/25/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/25/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/25/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/25/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/25/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/25/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/25/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/25/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/25/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/25/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/25/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/25/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/25/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/25/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/25/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/25/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/25/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/25/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/25/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/25/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/25/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/25/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/25/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/26/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/26/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/26/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/26/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/26/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/26/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/26/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/26/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT2_CO_Ppmvdc_1H | | | CT2_NH3Slip_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | CT2_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 06/26/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/26/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/26/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/26/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/26/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/26/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/26/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/26/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/26/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/26/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/26/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/26/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/26/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/26/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/26/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/26/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/27/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/27/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/27/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/27/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/27/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/27/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/27/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/27/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/27/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/27/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/27/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/27/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/27/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/27/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/27/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/27/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/27/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/27/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT2_CO_Ppmvdc_1H | | | CT2_NH3Slip_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | CT2_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 06/27/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/27/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/27/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/27/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/27/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/27/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/28/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/28/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/28/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/28/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/28/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/28/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/28/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/28/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/28/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/28/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/28/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/28/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/28/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/28/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/28/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/28/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/28/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/28/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/28/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/28/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/28/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/28/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/28/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/28/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/29/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/29/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/29/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/29/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |

| | CT2_CO_Ppmvdc_1H | | | CT2_NH3Slip_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | CT2_VOC_LbPerHr_1H | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** |
| 06/29/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/29/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/29/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X | | 0 | X |
| 06/29/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0.3 | | | 0 | X | | 0 | X |
| 06/29/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0.52 | | | 0 | X | | 0 | X |
| 06/29/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0.52 | | | 0 | X | | 0 | X |
| 06/29/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0.55 | | | 0 | X | | 0 | X |
| 06/29/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0.46 | | | 0 | X | | 0 | X |
| 06/29/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0.42 | | | 0 | X | | 0 | X |
| 06/29/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0.43 | | | 0 | X | | 0 | X |
| 06/29/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0.43 | | | 0 | X | | 0 | X |
| 06/29/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0.43 | | | 0 | X | | 0 | X |
| 06/29/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0.5 | | | 0 | X | | 0 | X |
| 06/29/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0.63 | | | 0 | X | | 0 | X |
| 06/29/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0.65 | | | 0 | X | | 0 | X |
| 06/29/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0.66 | | | 0 | X | | 0 | X |
| 06/29/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0.63 | | | 0 | X | | 0 | X |
| 06/29/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0.62 | | | 0 | X | | 0 | X |
| 06/29/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0.62 | | | 0 | X | | 0 | X |
| 06/29/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0.62 | | | 0 | X | | 0 | X |
| 06/30/23 0:00 | 0 | X | | 0 | X | | 0 | X | | 0.61 | | | 0 | X | | 0 | X |
| 06/30/23 1:00 | 0 | X | | 0 | X | | 0 | X | | 0.61 | | | 0 | X | | 0 | X |
| 06/30/23 2:00 | 0 | X | | 0 | X | | 0 | X | | 0.61 | | | 0 | X | | 0 | X |
| 06/30/23 3:00 | 0 | X | | 0 | X | | 0 | X | | 0.61 | | | 0 | X | | 0 | X |
| 06/30/23 4:00 | 0 | X | | 0 | X | | 0 | X | | 0.61 | | | 0 | X | | 0 | X |
| 06/30/23 5:00 | 0 | X | | 0 | X | | 0 | X | | 0.6 | | | 0 | X | | 0 | X |
| 06/30/23 6:00 | 0 | X | | 0 | X | | 0 | X | | 0.6 | | | 0 | X | | 0 | X |
| 06/30/23 7:00 | 0 | X | | 0 | X | | 0 | X | | 0.57 | | | 0 | X | | 0 | X |
| 06/30/23 8:00 | 0 | X | | 0 | X | | 0 | X | | 0.43 | | | 0 | X | | 0 | X |
| 06/30/23 9:00 | 0 | X | | 0 | X | | 0 | X | | 0.43 | | | 0 | X | | 0 | X |
| 06/30/23 10:00 | 0 | X | | 0 | X | | 0 | X | | 0.43 | | | 0 | X | | 0 | X |
| 06/30/23 11:00 | 0 | X | | 0 | X | | 0 | X | | 0.49 | | | 0 | X | | 0 | X |
| 06/30/23 12:00 | 0 | X | | 0 | X | | 0 | X | | 0.62 | | | 0 | X | | 0 | X |
| 06/30/23 13:00 | 0 | X | | 0 | X | | 0 | X | | 0.62 | | | 0 | X | | 0 | X |

| | CT2_CO_Ppmvdc_1H | | | CT2_NH3Slip_Ppmvdc_1H | | | CT2_NOx_Ppmvdc_1H | | | CT1_PM10_LbPerHr_1H | | | CT2_SO2_LbPerHr_1H | | | CT2_VOC_LbPerHr_1H | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Date/Tim** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** | **Value** | **SI** | **Mod** |
| 06/30/23 14:00 | 0 | X | | 0 | X | | 0 | X | | 0.64 | | | 0 | X | | 0 | X | |
| 06/30/23 15:00 | 0 | X | | 0 | X | | 0 | X | | 0.63 | | | 0 | X | | 0 | X | |
| 06/30/23 16:00 | 0 | X | | 0 | X | | 0 | X | | 0.62 | | | 0 | X | | 0 | X | |
| 06/30/23 17:00 | 0 | X | | 0 | X | | 0 | X | | 0.62 | | | 0 | X | | 0 | X | |
| 06/30/23 18:00 | 0 | X | | 0 | X | | 0 | X | | 0.64 | | | 0 | X | | 0 | X | |
| 06/30/23 19:00 | 0 | X | | 0 | X | | 0 | X | | 0.71 | | | 0 | X | | 0 | X | |
| 06/30/23 20:00 | 0 | X | | 0 | X | | 0 | X | | 0.64 | | | 0 | X | | 0 | X | |
| 06/30/23 21:00 | 0 | X | | 0 | X | | 0 | X | | 0.62 | | | 0 | X | | 0 | X | |
| 06/30/23 22:00 | 0 | X | | 0 | X | | 0 | X | | 0.62 | | | 0 | X | | 0 | X | |
| 06/30/23 23:00 | 0 | X | | 0 | X | | 0 | X | | 0.61 | | | 0 | X | | 0 | X | |

**ATTACHMENT 17**

# AQ-59

**AQ-59** The Daily Emissions shall not exceed the following rates:

| POLLUTANT | TWO TURBINES | AUX BOILER | COOLING TOWER | EMERGENCY DIESEL GENERATOR | DIESEL FIRE PUMP |
|---|---|---|---|---|---|
| NOX | 406.0 | 16.8 | - | 4.31 | 1.72 |
| CO | 629.5 | 52.8 | - | 0.84 | 0.09 |
| VOC | 223.1 | 7.2 | - | 0.16 | 0.05 |
| PM-10 | 226.8 | 14.4 | 16.3 | 0.14 | 0.03 |
| SO2 | 47.1 | 1.92 | - | 0.10 | 0.19 |

**Verification:** The Project owner shall include all necessary emissions data to demonstrate compliance with the emissions limits provided in this Condition as part of the Quarterly Air Quality Report required in Condition of Certification AQ-SC6

# Monthly Summary By Day Report

## Units CT1 and CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 21:40 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Limit Value:**

| | Units CT1 & CT2 CO, Lb 1 Hour(s) | Units CT1 & CT2 NOx, Lb 1 Hour(s) | Units CT1 & CT2 SO2, Lb 1 Hour(s) | Units CT1 & CT2 PM10, Lb 1 Hour(s) | Units CT1 & CT2 VOC, Lb 1 Hour(s) |
|---|---|---|---|---|---|
| 04/01/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/02/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/03/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/04/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/05/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/06/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/07/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/08/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/09/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/10/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/11/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/12/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/13/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/14/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/15/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/16/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/17/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/18/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/19/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/20/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/21/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/22/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/23/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/24/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/25/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/26/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/27/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/28/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/29/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/30/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| Monthly Avg/Sum: | 0.00 sum | 0.00 sum | 0.00 sum | 0.00 sum | 0.00 sum |
| Daily Min: | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| Daily Max: | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| Apr 2023 - Apr 2023 | 0.00 sum | 0.00 sum | 0.00 sum | 0.00 sum | 0.00 sum |
| **QTD:** | 0.00 sum | 0.00 sum | 0.00 sum | 0.00 sum | 0.00 sum |
| **YTD 2023:** | 5,382.86 sum | 6,277.77 sum | 625.15 sum | 1,248.91 sum | 2,081.24 sum |

# Monthly Summary By Day Report

## Units CT1 and CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 21:40 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Limit Value:**

| | Units CT1 & CT2 CO, Lb 1 Hour(s) | Units CT1 & CT2 NOx, Lb 1 Hour(s) | Units CT1 & CT2 SO2, Lb 1 Hour(s) | Units CT1 & CT2 PM10, Lb 1 Hour(s) | Units CT1 & CT2 VOC, Lb 1 Hour(s) |
|---|---|---|---|---|---|
| 05/01/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/02/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/03/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/04/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/05/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/06/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/07/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/08/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/09/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/10/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/11/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/12/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/13/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/14/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/15/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/16/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/17/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/18/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/19/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/20/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/21/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/22/2023 | 412.55 | 31.76 | 0.19 | 0.36 | 0.61 |
| 05/23/2023 | 14.14 | 10.48 | 1.23 | 2.43 | 4.06 |
| 05/24/2023 | 50.78 | 19.62 | 0.90 | 1.83 | 3.05 |
| 05/25/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/26/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/27/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/28/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/29/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/30/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/31/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| Monthly Avg/Sum: | 477.47 sum | 61.86 sum | 2.32 sum | 4.62 sum | 7.72 sum |
| Daily Min: | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| Daily Max: | 412.55 | 31.76 | 1.23 | 2.43 | 4.06 |
| Apr 2023 - May 2023 | 477.47 sum | 61.86 sum | 2.32 sum | 4.62 sum | 7.72 sum |
| **QTD:** | 477.47 sum | 61.86 sum | 2.32 sum | 4.62 sum | 7.72 sum |
| **YTD 2023:** | 5,860.33 sum | 6,339.63 sum | 627.47 sum | 1,253.53 sum | 2,088.96 sum |

# Monthly Summary By Day Report

## Units CT1 and CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 21:40 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Limit Value:**

| | Units CT1 & CT2 CO, Lb 1 Hour(s) | Units CT1 & CT2 NOx, Lb 1 Hour(s) | Units CT1 & CT2 SO2, Lb 1 Hour(s) | Units CT1 & CT2 PM10, Lb 1 Hour(s) | Units CT1 & CT2 VOC, Lb 1 Hour(s) |
|---|---|---|---|---|---|
| 06/01/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/02/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/03/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/04/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/05/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/06/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/07/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/08/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/09/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/10/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/11/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/12/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/13/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/14/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/15/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/16/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/17/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/18/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/19/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/20/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/21/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/22/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/23/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/24/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/25/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/26/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/27/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/28/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/29/2023 | 55.41 | 49.90 | 4.41 | 8.86 | 14.75 |
| 06/30/2023 | 17.21 | 65.68 | 7.08 | 14.19 | 23.63 |
| Monthly Avg/Sum: | 72.62 sum | 115.58 sum | 11.49 sum | 23.05 sum | 38.38 sum |
| Daily Min: | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| Daily Max: | 55.41 | 65.68 | 7.08 | 14.19 | 23.63 |
| Apr 2023 - Jun 2023 | 550.09 sum | 177.44 sum | 13.81 sum | 27.67 sum | 46.10 sum |
| **QTD:** | 550.09 sum | 177.44 sum | 13.81 sum | 27.67 sum | 46.10 sum |
| **YTD 2023:** | 5,932.95 sum | 6,455.21 sum | 638.96 sum | 1,276.58 sum | 2,127.34 sum |

# Monthly Summary By Day Report

## Unit CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:58 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Limit Value:**

| | Unit CT1 CO, Lb 1 Hour(s) | Unit CT1 NOx, Lb 1 Hour(s) | Unit CT1 SO2, Lb 1 Hour(s) | Unit CT1 PM10, Lb 1 Hour(s) | Unit CT1 VOC, Lb 1 Hour(s) |
|---|---|---|---|---|---|
| 04/01/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/02/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/03/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/04/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/05/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/06/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/07/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/08/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/09/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/10/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/11/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/12/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/13/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/14/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/15/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/16/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/17/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/18/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/19/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/20/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/21/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/22/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/23/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/24/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/25/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/26/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/27/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/28/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/29/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/30/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| Monthly Avg/Sum: | - | - | - | - | - |
| Daily Min: | - | - | - | - | - |
| Daily Max: | - | - | - | - | - |
| Apr 2023 - Apr 2023 | - | - | - | - | - |
| **QTD:** | 0.00 sum | 0.00 sum | 0.0 sum | 0.00 sum | 0.00 sum |
| **YTD 2023:** | 2,479.43 sum | 2,892.26 sum | 299.2 sum | 577.45 sum | 961.50 sum |

# Monthly Summary By Day Report

## Unit CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:58 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Limit Value:**

| | Unit CT1 CO, Lb 1 Hour(s) | Unit CT1 NOx, Lb 1 Hour(s) | Unit CT1 SO2, Lb 1 Hour(s) | Unit CT1 PM10, Lb 1 Hour(s) | Unit CT1 VOC, Lb 1 Hour(s) |
|---|---|---|---|---|---|
| 05/01/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/02/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/03/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/04/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/05/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/06/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/07/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/08/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/09/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/10/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/11/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/12/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/13/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/14/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/15/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/16/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/17/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/18/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/19/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/20/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/21/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/22/2023 | 412.55 | 31.76 | 0.1 | 0.36 | 0.61 |
| 05/23/2023 | 8.72 | 10.48 | 1.2 | 2.43 | 4.06 |
| 05/24/2023 | 50.78 | 19.62 | 0.8 | 1.83 | 3.05 |
| 05/25/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/26/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/27/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/28/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/29/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/30/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/31/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| Monthly Avg/Sum: | 472.05 sum | 61.86 sum | 2.1 sum | 4.62 sum | 7.72 sum |
| Daily Min: | 8.72 | 10.48 | 0.1 | 0.36 | 0.61 |
| Daily Max: | 412.55 | 31.76 | 1.2 | 2.43 | 4.06 |
| Apr 2023 - May 2023 | 472.05 sum | 61.86 sum | 2.1 sum | 4.62 sum | 7.72 sum |
| **QTD:** | 472.05 sum | 61.86 sum | 2.1 sum | 4.62 sum | 7.72 sum |
| **YTD 2023:** | 2,951.48 sum | 2,954.12 sum | 301.3 sum | 582.07 sum | 969.22 sum |

# Monthly Summary By Day Report

## Unit CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:58 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Limit Value:**

| | Unit CT1 CO, Lb 1 Hour(s) | Unit CT1 NOx, Lb 1 Hour(s) | Unit CT1 SO2, Lb 1 Hour(s) | Unit CT1 PM10, Lb 1 Hour(s) | Unit CT1 VOC, Lb 1 Hour(s) |
|---|---|---|---|---|---|
| 06/01/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/02/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/03/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/04/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/05/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/06/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/07/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/08/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/09/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/10/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/11/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/12/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/13/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/14/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/15/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/16/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/17/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/18/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/19/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/20/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/21/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/22/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/23/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/24/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/25/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/26/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/27/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/28/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/29/2023 | 55.41 | 49.90 | 4.3 | 8.86 | 14.75 |
| 06/30/2023 | 17.21 | 65.68 | 6.9 | 14.19 | 23.63 |
| Monthly Avg/Sum: | 72.62 sum | 115.58 sum | 11.2 sum | 23.05 sum | 38.38 sum |
| Daily Min: | 17.21 | 49.90 | 4.3 | 8.86 | 14.75 |
| Daily Max: | 55.41 | 65.68 | 6.9 | 14.19 | 23.63 |
| Apr 2023 - Jun 2023 | 544.67 sum | 177.44 sum | 13.3 sum | 27.67 sum | 46.10 sum |
| **QTD:** | 544.67 sum | 177.44 sum | 13.3 sum | 27.67 sum | 46.10 sum |
| **YTD 2023:** | 3,024.10 sum | 3,069.70 sum | 312.5 sum | 605.12 sum | 1,007.60 sum |

# Monthly Summary By Day Report

## Unit CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:01 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Limit Value:**

| | Unit CT2 CO, Lb 1 Hour(s) | Unit CT2 NOx, Lb 1 Hour(s) | Unit CT2 SO2, Lb 1 Hour(s) | Unit CT2 PM10, Lb 1 Hour(s) | Unit CT2 VOC, Lb 1 Hour(s) |
|---|---|---|---|---|---|
| 04/01/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/02/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/03/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/04/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/05/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/06/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/07/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/08/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/09/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/10/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/11/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/12/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/13/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/14/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/15/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/16/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/17/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/18/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/19/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/20/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/21/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/22/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/23/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/24/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/25/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/26/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/27/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/28/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/29/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/30/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| Monthly Avg/Sum: | - | - | - | - | - |
| Daily Min: | - | - | - | - | - |
| Daily Max: | - | - | - | - | - |
| Apr 2023 - Apr 2023 | - | - | - | - | - |
| **QTD:** | 0.00 sum | 0.00 sum | 0.0 sum | 0.00 sum | 0.00 sum |
| **YTD 2023:** | 2,903.43 sum | 3,385.51 sum | 340.1 sum | 671.46 sum | 1,119.74 sum |

# Monthly Summary By Day Report

## Unit CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:01 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Limit Value:**

| | Unit CT2 CO, Lb 1 Hour(s) | Unit CT2 NOx, Lb 1 Hour(s) | Unit CT2 SO2, Lb 1 Hour(s) | Unit CT2 PM10, Lb 1 Hour(s) | Unit CT2 VOC, Lb 1 Hour(s) |
|---|---|---|---|---|---|
| 05/01/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/02/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/03/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/04/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/05/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/06/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/07/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/08/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/09/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/10/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/11/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/12/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/13/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/14/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/15/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/16/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/17/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/18/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/19/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/20/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/21/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/22/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/23/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/24/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/25/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/26/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/27/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/28/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/29/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/30/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/31/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| Monthly Avg/Sum: | - | - | - | - | - |
| Daily Min: | - | - | - | - | - |
| Daily Max: | - | - | - | - | - |
| Apr 2023 - May 2023 | - | - | - | - | - |
| **QTD:** | 0.00 sum | 0.00 sum | 0.0 sum | 0.00 sum | 0.00 sum |
| **YTD 2023:** | 2,903.43 sum | 3,385.51 sum | 340.1 sum | 671.46 sum | 1,119.74 sum |

# Monthly Summary By Day Report

## Unit CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:01 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Limit Value:**

| | Unit CT2 CO, Lb 1 Hour(s) | Unit CT2 NOx, Lb 1 Hour(s) | Unit CT2 SO2, Lb 1 Hour(s) | Unit CT2 PM10, Lb 1 Hour(s) | Unit CT2 VOC, Lb 1 Hour(s) |
|---|---|---|---|---|---|
| 06/01/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/02/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/03/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/04/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/05/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/06/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/07/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/08/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/09/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/10/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/11/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/12/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/13/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/14/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/15/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/16/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/17/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/18/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/19/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/20/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/21/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/22/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/23/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/24/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/25/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/26/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/27/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/28/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/29/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/30/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| Monthly Avg/Sum: | - | - | - | - | - |
| Daily Min: | - | - | - | - | - |
| Daily Max: | - | - | - | - | - |
| Apr 2023 - Jun 2023 | - | - | - | - | - |
| **QTD:** | 0.00 sum | 0.00 sum | 0.0 sum | 0.00 sum | 0.00 sum |
| **YTD 2023:** | 2,903.43 sum | 3,385.51 sum | 340.1 sum | 671.46 sum | 1,119.74 sum |

**ATTACHMENT 18**

# AQ-60

**AQ-60** If the Alstom GTX100 turbine are selected, the quarterly emissions shall not exceed the levels shown below:

| Alstom GTX100 Gas Turbines | | | | | |
|---|---|---|---|---|---|
| Pollutant | Quarter 1 (lbs/quarter) Two turbines | Quarter 2 (lbs/quarter) Two Turbines | Quarter 3 (lbs/quarter) Two turbines | Quarter 4 (lbs/quarter) Two Turbines | Tons/ Year Two Turbines |
| NOx | 15,399 | 12,965 | 17,496 | 15,422 | 30.64 |
| CO | 26,787 | 32,590 | 28,175 | 29,862 | 58.71 |
| VOCs | 5,791 | 7,306 | 6,630 | 6,848 | 13.29 |
| PM0 | 16,300 | 13,692 | 17,789 | 17,569 | 32.67 |
| SOx | 3,385 | 2,843 | 3,694 | 3,648 | 6.78 |

**Verification:** The Project owner shall include all necessary emissions data to demonstrate compliance with the emission limits provided in this Condition as part of the Quarterly Air Quality Report required in Condition of Certification AQ-SC6.

# Monthly Summary By Day Report

## Units CT1 and CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 21:40 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Limit Value:**

| | Units CT1 & CT2 CO, Lb 1 Hour(s) | Units CT1 & CT2 NOx, Lb 1 Hour(s) | Units CT1 & CT2 SO2, Lb 1 Hour(s) | Units CT1 & CT2 PM10, Lb 1 Hour(s) | Units CT1 & CT2 VOC, Lb 1 Hour(s) |
|---|---|---|---|---|---|
| 04/01/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/02/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/03/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/04/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/05/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/06/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/07/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/08/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/09/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/10/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/11/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/12/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/13/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/14/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/15/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/16/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/17/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/18/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/19/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/20/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/21/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/22/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/23/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/24/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/25/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/26/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/27/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/28/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/29/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/30/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| Monthly Avg/Sum: | 0.00 sum | 0.00 sum | 0.00 sum | 0.00 sum | 0.00 sum |
| Daily Min: | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| Daily Max: | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| Apr 2023 - Apr 2023 | 0.00 sum | 0.00 sum | 0.00 sum | 0.00 sum | 0.00 sum |
| **QTD:** | 0.00 sum | 0.00 sum | 0.00 sum | 0.00 sum | 0.00 sum |
| **YTD 2023:** | 5,382.86 sum | 6,277.77 sum | 625.15 sum | 1,248.91 sum | 2,081.24 sum |

# Monthly Summary By Day Report

## Units CT1 and CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 21:40 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Limit Value:**

| | Units CT1 & CT2 CO, Lb 1 Hour(s) | Units CT1 & CT2 NOx, Lb 1 Hour(s) | Units CT1 & CT2 SO2, Lb 1 Hour(s) | Units CT1 & CT2 PM10, Lb 1 Hour(s) | Units CT1 & CT2 VOC, Lb 1 Hour(s) |
|---|---|---|---|---|---|
| 05/01/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/02/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/03/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/04/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/05/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/06/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/07/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/08/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/09/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/10/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/11/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/12/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/13/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/14/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/15/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/16/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/17/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/18/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/19/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/20/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/21/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/22/2023 | 412.55 | 31.76 | 0.19 | 0.36 | 0.61 |
| 05/23/2023 | 14.14 | 10.48 | 1.23 | 2.43 | 4.06 |
| 05/24/2023 | 50.78 | 19.62 | 0.90 | 1.83 | 3.05 |
| 05/25/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/26/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/27/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/28/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/29/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/30/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/31/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| Monthly Avg/Sum: | 477.47 sum | 61.86 sum | 2.32 sum | 4.62 sum | 7.72 sum |
| Daily Min: | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| Daily Max: | 412.55 | 31.76 | 1.23 | 2.43 | 4.06 |
| Apr 2023 - May 2023 | 477.47 sum | 61.86 sum | 2.32 sum | 4.62 sum | 7.72 sum |
| **QTD:** | 477.47 sum | 61.86 sum | 2.32 sum | 4.62 sum | 7.72 sum |
| **YTD 2023:** | 5,860.33 sum | 6,339.63 sum | 627.47 sum | 1,253.53 sum | 2,088.96 sum |

# Monthly Summary By Day Report

## Units CT1 and CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 21:40 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Limit Value:**

| | Units CT1 & CT2 CO, Lb 1 Hour(s) | Units CT1 & CT2 NOx, Lb 1 Hour(s) | Units CT1 & CT2 SO2, Lb 1 Hour(s) | Units CT1 & CT2 PM10, Lb 1 Hour(s) | Units CT1 & CT2 VOC, Lb 1 Hour(s) |
|---|---|---|---|---|---|
| 06/01/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/02/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/03/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/04/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/05/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/06/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/07/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/08/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/09/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/10/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/11/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/12/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/13/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/14/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/15/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/16/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/17/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/18/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/19/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/20/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/21/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/22/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/23/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/24/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/25/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/26/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/27/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/28/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/29/2023 | 55.41 | 49.90 | 4.41 | 8.86 | 14.75 |
| 06/30/2023 | 17.21 | 65.68 | 7.08 | 14.19 | 23.63 |
| Monthly Avg/Sum: | 72.62 sum | 115.58 sum | 11.49 sum | 23.05 sum | 38.38 sum |
| Daily Min: | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| Daily Max: | 55.41 | 65.68 | 7.08 | 14.19 | 23.63 |
| Apr 2023 - Jun 2023 | 550.09 sum | 177.44 sum | 13.81 sum | 27.67 sum | 46.10 sum |
| **QTD:** | 550.09 sum | 177.44 sum | 13.81 sum | 27.67 sum | 46.10 sum |
| **YTD 2023:** | 5,932.95 sum | 6,455.21 sum | 638.96 sum | 1,276.58 sum | 2,127.34 sum |

# Monthly Summary By Day Report

## Unit CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:58 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Limit Value:**

| | Unit CT1 CO, Lb 1 Hour(s) | Unit CT1 NOx, Lb 1 Hour(s) | Unit CT1 SO2, Lb 1 Hour(s) | Unit CT1 PM10, Lb 1 Hour(s) | Unit CT1 VOC, Lb 1 Hour(s) |
|---|---|---|---|---|---|
| 04/01/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/02/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/03/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/04/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/05/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/06/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/07/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/08/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/09/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/10/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/11/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/12/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/13/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/14/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/15/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/16/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/17/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/18/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/19/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/20/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/21/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/22/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/23/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/24/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/25/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/26/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/27/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/28/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/29/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/30/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| Monthly Avg/Sum: | - | - | - | - | - |
| Daily Min: | - | - | - | - | - |
| Daily Max: | - | - | - | - | - |
| Apr 2023 - Apr 2023 | - | - | - | - | - |
| **QTD:** | 0.00 sum | 0.00 sum | 0.0 sum | 0.00 sum | 0.00 sum |
| **YTD 2023:** | 2,479.43 sum | 2,892.26 sum | 299.2 sum | 577.45 sum | 961.50 sum |

# Monthly Summary By Day Report

## Unit CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:58 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Limit Value:**

| | Unit CT1 CO, Lb 1 Hour(s) | Unit CT1 NOx, Lb 1 Hour(s) | Unit CT1 SO2, Lb 1 Hour(s) | Unit CT1 PM10, Lb 1 Hour(s) | Unit CT1 VOC, Lb 1 Hour(s) |
|---|---|---|---|---|---|
| 05/01/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/02/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/03/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/04/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/05/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/06/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/07/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/08/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/09/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/10/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/11/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/12/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/13/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/14/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/15/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/16/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/17/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/18/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/19/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/20/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/21/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/22/2023 | 412.55 | 31.76 | 0.1 | 0.36 | 0.61 |
| 05/23/2023 | 8.72 | 10.48 | 1.2 | 2.43 | 4.06 |
| 05/24/2023 | 50.78 | 19.62 | 0.8 | 1.83 | 3.05 |
| 05/25/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/26/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/27/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/28/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/29/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/30/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/31/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| Monthly Avg/Sum: | 472.05 sum | 61.86 sum | 2.1 sum | 4.62 sum | 7.72 sum |
| Daily Min: | 8.72 | 10.48 | 0.1 | 0.36 | 0.61 |
| Daily Max: | 412.55 | 31.76 | 1.2 | 2.43 | 4.06 |
| Apr 2023 - May 2023 | 472.05 sum | 61.86 sum | 2.1 sum | 4.62 sum | 7.72 sum |
| **QTD:** | 472.05 sum | 61.86 sum | 2.1 sum | 4.62 sum | 7.72 sum |
| **YTD 2023:** | 2,951.48 sum | 2,954.12 sum | 301.3 sum | 582.07 sum | 969.22 sum |

# Monthly Summary By Day Report

## Unit CT1

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:58 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Limit Value:**

| | Unit CT1 CO, Lb 1 Hour(s) | Unit CT1 NOx, Lb 1 Hour(s) | Unit CT1 SO2, Lb 1 Hour(s) | Unit CT1 PM10, Lb 1 Hour(s) | Unit CT1 VOC, Lb 1 Hour(s) |
|---|---|---|---|---|---|
| 06/01/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/02/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/03/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/04/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/05/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/06/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/07/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/08/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/09/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/10/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/11/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/12/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/13/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/14/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/15/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/16/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/17/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/18/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/19/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/20/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/21/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/22/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/23/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/24/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/25/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/26/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/27/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/28/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/29/2023 | 55.41 | 49.90 | 4.3 | 8.86 | 14.75 |
| 06/30/2023 | 17.21 | 65.68 | 6.9 | 14.19 | 23.63 |
| Monthly Avg/Sum: | 72.62 sum | 115.58 sum | 11.2 sum | 23.05 sum | 38.38 sum |
| Daily Min: | 17.21 | 49.90 | 4.3 | 8.86 | 14.75 |
| Daily Max: | 55.41 | 65.68 | 6.9 | 14.19 | 23.63 |
| Apr 2023 - Jun 2023 | 544.67 sum | 177.44 sum | 13.3 sum | 27.67 sum | 46.10 sum |
| **QTD:** | 544.67 sum | 177.44 sum | 13.3 sum | 27.67 sum | 46.10 sum |
| **YTD 2023:** | 3,024.10 sum | 3,069.70 sum | 312.5 sum | 605.12 sum | 1,007.60 sum |

# Monthly Summary By Day Report

## Unit CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:01 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Limit Value:**

| | Unit CT2 CO, Lb 1 Hour(s) | Unit CT2 NOx, Lb 1 Hour(s) | Unit CT2 SO2, Lb 1 Hour(s) | Unit CT2 PM10, Lb 1 Hour(s) | Unit CT2 VOC, Lb 1 Hour(s) |
|---|---|---|---|---|---|
| 04/01/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/02/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/03/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/04/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/05/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/06/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/07/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/08/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/09/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/10/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/11/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/12/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/13/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/14/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/15/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/16/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/17/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/18/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/19/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/20/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/21/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/22/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/23/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/24/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/25/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/26/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/27/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/28/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/29/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 04/30/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| Monthly Avg/Sum: | - | - | - | - | - |
| Daily Min: | - | - | - | - | - |
| Daily Max: | - | - | - | - | - |
| Apr 2023 - Apr 2023 | - | - | - | - | - |
| **QTD:** | 0.00 sum | 0.00 sum | 0.0 sum | 0.00 sum | 0.00 sum |
| **YTD 2023:** | 2,903.43 sum | 3,385.51 sum | 340.1 sum | 671.46 sum | 1,119.74 sum |

# Monthly Summary By Day Report

## Unit CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:01 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Limit Value:**

| | Unit CT2 CO, Lb 1 Hour(s) | Unit CT2 NOx, Lb 1 Hour(s) | Unit CT2 SO2, Lb 1 Hour(s) | Unit CT2 PM10, Lb 1 Hour(s) | Unit CT2 VOC, Lb 1 Hour(s) |
|---|---|---|---|---|---|
| 05/01/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/02/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/03/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/04/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/05/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/06/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/07/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/08/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/09/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/10/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/11/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/12/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/13/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/14/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/15/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/16/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/17/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/18/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/19/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/20/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/21/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/22/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/23/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/24/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/25/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/26/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/27/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/28/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/29/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/30/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 05/31/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| Monthly Avg/Sum: | - | - | - | - | - |
| Daily Min: | - | - | - | - | - |
| Daily Max: | - | - | - | - | - |
| Apr 2023 - May 2023 | - | - | - | - | - |
| **QTD:** | 0.00 sum | 0.00 sum | 0.0 sum | 0.00 sum | 0.00 sum |
| **YTD 2023:** | 2,903.43 sum | 3,385.51 sum | 340.1 sum | 671.46 sum | 1,119.74 sum |

# Monthly Summary By Day Report

## Unit CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 23:01 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Limit Value:**

| | Unit CT2 CO, Lb 1 Hour(s) | Unit CT2 NOx, Lb 1 Hour(s) | Unit CT2 SO2, Lb 1 Hour(s) | Unit CT2 PM10, Lb 1 Hour(s) | Unit CT2 VOC, Lb 1 Hour(s) |
|---|---|---|---|---|---|
| 06/01/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/02/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/03/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/04/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/05/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/06/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/07/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/08/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/09/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/10/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/11/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/12/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/13/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/14/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/15/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/16/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/17/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/18/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/19/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/20/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/21/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/22/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/23/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/24/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/25/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/26/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/27/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/28/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/29/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| 06/30/2023 | 0.00 | 0.00 | 0.0 | 0.00 | 0.00 |
| Monthly Avg/Sum: | - | - | - | - | - |
| Daily Min: | - | - | - | - | - |
| Daily Max: | - | - | - | - | - |
| Apr 2023 - Jun 2023 | - | - | - | - | - |
| **QTD:** | 0.00 sum | 0.00 sum | 0.0 sum | 0.00 sum | 0.00 sum |
| **YTD 2023:** | 2,903.43 sum | 3,385.51 sum | 340.1 sum | 671.46 sum | 1,119.74 sum |

**ATTACHMENT 19**

# AQ-63

**AQ-63** The Total Facility Emissions shall not exceed the following quarterly emissions rates.

| POLLUTANT | Q1 (LBS) | Q2 (LBS) | Q3 (LBS) | Q4 (LBS) | TONS/YEAR |
|---|---|---|---|---|---|
| NOX | 15546 | 13412 | 17646 | 15572 | 31.09 |
| CO | 27121 | 33872 | 28515 | 30202 | 59.86 |
| VOC | 5832 | 7455 | 6672 | 6890 | 13.42 |
| PM-10 | 17854 | 15513 | 19378 | 19158 | 35.95 |
| SO2 | 3400 | 2893 | 3709 | 3663 | 6.83 |

**Verification:** The Project owner shall include all necessary emissions data to demonstrate compliance with the emissions limits provided in this Condition as part of the Quarterly Air Quality Report required in Condition of Certification AQ-SC6

# Monthly Summary By Day Report

## Units CT1 and CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 21:40 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Limit Value:**

| | Units CT1 & CT2 CO, Lb 1 Hour(s) | Units CT1 & CT2 NOx, Lb 1 Hour(s) | Units CT1 & CT2 SO2, Lb 1 Hour(s) | Units CT1 & CT2 PM10, Lb 1 Hour(s) | Units CT1 & CT2 VOC, Lb 1 Hour(s) |
|---|---|---|---|---|---|
| 04/01/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/02/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/03/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/04/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/05/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/06/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/07/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/08/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/09/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/10/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/11/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/12/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/13/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/14/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/15/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/16/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/17/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/18/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/19/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/20/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/21/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/22/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/23/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/24/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/25/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/26/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/27/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/28/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/29/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 04/30/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| Monthly Avg/Sum: | 0.00 sum | 0.00 sum | 0.00 sum | 0.00 sum | 0.00 sum |
| Daily Min: | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| Daily Max: | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| Apr 2023 - Apr 2023 | 0.00 sum | 0.00 sum | 0.00 sum | 0.00 sum | 0.00 sum |
| **QTD:** | 0.00 sum | 0.00 sum | 0.00 sum | 0.00 sum | 0.00 sum |
| **YTD 2023:** | 5,382.86 sum | 6,277.77 sum | 625.15 sum | 1,248.91 sum | 2,081.24 sum |

# Monthly Summary By Day Report

## Units CT1 and CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 21:40 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Limit Value:**

| | Units CT1 & CT2 CO, Lb 1 Hour(s) | Units CT1 & CT2 NOx, Lb 1 Hour(s) | Units CT1 & CT2 SO2, Lb 1 Hour(s) | Units CT1 & CT2 PM10, Lb 1 Hour(s) | Units CT1 & CT2 VOC, Lb 1 Hour(s) |
|---|---|---|---|---|---|
| 05/01/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/02/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/03/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/04/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/05/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/06/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/07/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/08/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/09/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/10/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/11/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/12/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/13/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/14/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/15/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/16/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/17/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/18/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/19/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/20/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/21/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/22/2023 | 412.55 | 31.76 | 0.19 | 0.36 | 0.61 |
| 05/23/2023 | 14.14 | 10.48 | 1.23 | 2.43 | 4.06 |
| 05/24/2023 | 50.78 | 19.62 | 0.90 | 1.83 | 3.05 |
| 05/25/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/26/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/27/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/28/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/29/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/30/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 05/31/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| Monthly Avg/Sum: | 477.47 sum | 61.86 sum | 2.32 sum | 4.62 sum | 7.72 sum |
| Daily Min: | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| Daily Max: | 412.55 | 31.76 | 1.23 | 2.43 | 4.06 |
| Apr 2023 - May 2023 | 477.47 sum | 61.86 sum | 2.32 sum | 4.62 sum | 7.72 sum |
| **QTD:** | 477.47 sum | 61.86 sum | 2.32 sum | 4.62 sum | 7.72 sum |
| **YTD 2023:** | 5,860.33 sum | 6,339.63 sum | 627.47 sum | 1,253.53 sum | 2,088.96 sum |

# Monthly Summary By Day Report

## Units CT1 and CT2

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 21:40 **Location:** Roseville, CA

Red = Invalid or Excluded Data | Green = Edited Status | Blue = Edited Value | * = Excess Emission

**Limit Value:**

| | Units CT1 & CT2 CO, Lb 1 Hour(s) | Units CT1 & CT2 NOx, Lb 1 Hour(s) | Units CT1 & CT2 SO2, Lb 1 Hour(s) | Units CT1 & CT2 PM10, Lb 1 Hour(s) | Units CT1 & CT2 VOC, Lb 1 Hour(s) |
|---|---|---|---|---|---|
| 06/01/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/02/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/03/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/04/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/05/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/06/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/07/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/08/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/09/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/10/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/11/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/12/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/13/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/14/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/15/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/16/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/17/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/18/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/19/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/20/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/21/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/22/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/23/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/24/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/25/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/26/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/27/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/28/2023 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 06/29/2023 | 55.41 | 49.90 | 4.41 | 8.86 | 14.75 |
| 06/30/2023 | 17.21 | 65.68 | 7.08 | 14.19 | 23.63 |
| Monthly Avg/Sum: | 72.62 sum | 115.58 sum | 11.49 sum | 23.05 sum | 38.38 sum |
| Daily Min: | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| Daily Max: | 55.41 | 65.68 | 7.08 | 14.19 | 23.63 |
| Apr 2023 - Jun 2023 | 550.09 sum | 177.44 sum | 13.81 sum | 27.67 sum | 46.10 sum |
| **QTD:** | 550.09 sum | 177.44 sum | 13.81 sum | 27.67 sum | 46.10 sum |
| **YTD 2023:** | 5,932.95 sum | 6,455.21 sum | 638.96 sum | 1,276.58 sum | 2,127.34 sum |

# Tons 12 Month Rolling Summary

## CT1 and CT2 Combined

**From:** 04/01/2023 00:00 **To:** 06/30/2023 23:59 **Facility Name:** ROSEVILLE ENERGY

**Generated:** 07/07/2023 22:12 **Location:** Roseville, CA

* = Excess Emission

| Date | Units CT1 & CT2 CO, Ton 1 Day(s) Sum | Rolling Sum | Units CT1 & CT2 NOx, Ton 1 Day(s) Sum | Rolling Sum | Units CT1 & CT2 PM10, Ton 1 Day(s) Sum | Rolling Sum | Units CT1 & CT2 SO2, Ton 1 Day(s) Sum | Rolling Sum | Units CT1 & CT2 VOC, Ton 1 Day(s) Sum | Rolling Sum |
|---|---|---|---|---|---|---|---|---|---|---|
| Apr 2023 | 0.0000 | 7.6802 | 0.0000 | 14.7491 | 0.0000 | 3.0357 | 0.0000 | 1.5194 | 0.0000 | 5.0594 |
| May 2023 | 0.2388 | 7.4747 | 0.0309 | 14.1876 | 0.0023 | 2.9186 | 0.0012 | 1.4610 | 0.0038 | 4.8643 |
| Jun 2023 | 0.0363 | 6.7942 | 0.0578 | 13.1511 | 0.0115 | 2.7118 | 0.0057 | 1.3575 | 0.0192 | 4.5191 |
| **Sum/Avg** | 6.7942 | | 13.1511 | | 2.7118 | | 1.3575 | | 4.5191 | |
| **Limit Value** | | | | | | | | | | |

Replace the dates with the ones you need

4/1/2023 0:00
6/30/2023 0:00

1D

TOWER AVG.

1844

| | 519-AIT-9504-1 |
|---|---|
| 4/1/23 0:00 | 1872.2 |
| 4/2/23 0:00 | 1916.9 |
| 4/3/23 0:00 | 1780.1 |
| 4/4/23 0:00 | 1709.5 |
| 4/5/23 0:00 | 1784.0 |
| 4/6/23 0:00 | 1837.3 |
| 4/7/23 0:00 | 1887.6 |
| 4/8/23 0:00 | 1873.6 |
| 4/9/23 0:00 | 1903.6 |
| 4/10/23 0:00 | 2007.0 |
| 4/11/23 0:00 | 2008.0 |
| 4/12/23 0:00 | 1921.1 |
| 4/13/23 0:00 | 1846.9 |
| 4/14/23 0:00 | 1871.3 |
| 4/15/23 0:00 | 1915.9 |
| 4/16/23 0:00 | 1924.9 |
| 4/17/23 0:00 | 1909.1 |
| 4/18/23 0:00 | 1791.0 |
| 4/19/23 0:00 | 1803.3 |
| 4/20/23 0:00 | 1869.5 |
| 4/21/23 0:00 | 1976.1 |
| 4/22/23 0:00 | 2033.6 |
| 4/23/23 0:00 | 2090.3 |
| 4/24/23 0:00 | 1495.6 |
| 4/25/23 0:00 | 1696.9 |
| 4/26/23 0:00 | 1747.2 |
| 4/27/23 0:00 | 1806.5 |
| 4/28/23 0:00 | 1801.3 |
| 4/29/23 0:00 | 1793.8 |
| 4/30/23 0:00 | 1777.0 |
| 5/1/23 0:00 | 1662.3 |
| 5/2/23 0:00 | 1565.1 |
| 5/3/23 0:00 | 1698.7 |
| 5/4/23 0:00 | 1799.9 |
| 5/5/23 0:00 | 1621.0 |
| 5/6/23 0:00 | 1570.1 |
| 5/7/23 0:00 | 1561.4 |
| 5/8/23 0:00 | 1704.7 |
| 5/9/23 0:00 | 1709.1 |
| 5/10/23 0:00 | 1747.7 |
| 5/11/23 0:00 | 1728.7 |
| 5/12/23 0:00 | 1724.5 |
| 5/13/23 0:00 | 1753.7 |
| 5/14/23 0:00 | 1960.6 |
| 5/15/23 0:00 | 1921.0 |
| 5/16/23 0:00 | 1991.6 |
| 5/17/23 0:00 | 1996.7 |
| 5/18/23 0:00 | 1969.3 |
| 5/19/23 0:00 | 1954.7 |

| | |
|---|---|
| 5/20/23 0:00 | 1976.3 |
| 5/21/23 0:00 | 1941.1 |
| 5/22/23 0:00 | 2022.6 |
| 5/23/23 0:00 | 1901.2 |
| 5/24/23 0:00 | 1674.7 |
| 5/25/23 0:00 | 1741.3 |
| 5/26/23 0:00 | 1597.3 |
| 5/27/23 0:00 | 1628.7 |
| 5/28/23 0:00 | 1679.2 |
| 5/29/23 0:00 | 1739.6 |
| 5/30/23 0:00 | 1772.0 |
| 5/31/23 0:00 | 1628.6 |
| 6/1/23 0:00 | 1688.5 |
| 6/2/23 0:00 | 1723.5 |
| 6/3/23 0:00 | 1822.1 |
| 6/4/23 0:00 | 1935.6 |
| 6/5/23 0:00 | 1964.4 |
| 6/6/23 0:00 | 1933.9 |
| 6/7/23 0:00 | 1853.1 |
| 6/8/23 0:00 | 1831.6 |
| 6/9/23 0:00 | 1852.9 |
| 6/10/23 0:00 | 1861.5 |
| 6/11/23 0:00 | 1965.2 |
| 6/12/23 0:00 | 1905.8 |
| 6/13/23 0:00 | 1913.6 |
| 6/14/23 0:00 | 1909.4 |
| 6/15/23 0:00 | 1929.6 |
| 6/16/23 0:00 | 1927.5 |
| 6/17/23 0:00 | 1936.8 |
| 6/18/23 0:00 | 1996.4 |
| 6/19/23 0:00 | 1897.4 |
| 6/20/23 0:00 | 1844.9 |
| 6/21/23 0:00 | 1854.2 |
| 6/22/23 0:00 | 1871.8 |
| 6/23/23 0:00 | 1868.5 |
| 6/24/23 0:00 | 1836.6 |
| 6/25/23 0:00 | 1780.8 |
| 6/26/23 0:00 | 1774.7 |
| 6/27/23 0:00 | 1761.6 |
| 6/28/23 0:00 | 1801.2 |
| 6/29/23 0:00 | 1797.8 |
| 6/30/23 0:00 | 3173.1 |

# ROSEVILLE ENERGY PARK COOLING TOWER EMISSIONS

| POLLUTANT | LBS PER DAY | QUARTER 1 | QUARTER 2 | QUARTER 3 | QUARTER 4 |
|---|---|---|---|---|---|
| PM-10 | 16.3 | 1471 | 1487 | 1504 | 1504 |

Whereas compliance with the PM-10 emission limit shall be demonstrated as;
Cooling tower recirculation rate * total dissolved solids of blowdown ***** design drift rate

| | | |
|---|---|---|
| | 53814 | Gallons per minute |
| | * 8.33 | Pounds per gallon |
| | * 1440 | Minutes per day |
| Circ pump flow rate | **64,550,969** | Pounds per day |

| | | |
|---|---|---|
| | 1844 | Average daily conductivity umhos |
| | 0.00000064 | Conversion to TDS ppm |
| Total dissolved solids | **0.00118016** | |

| | |
|---|---|
| Design drift rate | **0.005%** |
| **PM-10 pounds per day** | **3.81** |

| | | |
|---|---|---|
| | 91 | Days in quarter |
| **PM-10 pounds this quarter** | **347** | 2Q23 |

fill only these

**ATTACHMENT 20**

# AQ68

**AQ68** A water sample analysis of cooling tower water shall be performed within 180 days of initial operation and annually thereafter.

**Verification;** The Project owner shall submit to the CPM and the PCAPCD the initial and annual cooling tower water sample analysis for approval no later than 60 days following the date of test performance.

The Cooling Tower Water Analysis was reported with the 1Q23 QAQR.

**ATTACHMENT 21**

# AQ-69

**AQ-69** No emissions are permitted, from any source, which are a nuisance per PCAPCD Rule 205, Nuisance.

**Verification:** The Project owner shall report all violations of this condition as noticed by the PCAPCD as well as any offsite nuisance complaints as part of the Quarterly Air Quality Report in Condition of Certification AQ-SC6

In regards to AQ-69 of Roseville Energy Park's 2Q23 QAQR, there were no violations of PCAPCD's Rule 205 for nuisance.

**ATTACHMENT 22**

# AQ-70

**AQ-70** PM-10 emission rates from the cooling tower shall not exceed the following limits

| Cooling Tower Emissions Limitations | | | | | |
|---|---|---|---|---|---|
| Pollutant | Lbs/day | Quarter 1 | Quarter 2 | Quarter 3 | Quarter 4 |
| PM 10 | 16.3 | 1471 | 1487 | 1504 | 1504 |

**Verification:** the Project owner shall include all the necessary emissions data to demonstrate compliance with the emissions limits provided in this Condition as part of the Quarterly air Quality Report required in condition of Certification AQ-SC6.

Replace the dates with the ones you need

4/1/2023 0:00
6/30/2023 0:00

1D

TOWER AVG.

1844

| | 519-AIT-9504-1 |
|---|---|
| 4/1/23 0:00 | 1872.2 |
| 4/2/23 0:00 | 1916.9 |
| 4/3/23 0:00 | 1780.1 |
| 4/4/23 0:00 | 1709.5 |
| 4/5/23 0:00 | 1784.0 |
| 4/6/23 0:00 | 1837.3 |
| 4/7/23 0:00 | 1887.6 |
| 4/8/23 0:00 | 1873.6 |
| 4/9/23 0:00 | 1903.6 |
| 4/10/23 0:00 | 2007.0 |
| 4/11/23 0:00 | 2008.0 |
| 4/12/23 0:00 | 1921.1 |
| 4/13/23 0:00 | 1846.9 |
| 4/14/23 0:00 | 1871.3 |
| 4/15/23 0:00 | 1915.9 |
| 4/16/23 0:00 | 1924.9 |
| 4/17/23 0:00 | 1909.1 |
| 4/18/23 0:00 | 1791.0 |
| 4/19/23 0:00 | 1803.3 |
| 4/20/23 0:00 | 1869.5 |
| 4/21/23 0:00 | 1976.1 |
| 4/22/23 0:00 | 2033.6 |
| 4/23/23 0:00 | 2090.3 |
| 4/24/23 0:00 | 1495.6 |
| 4/25/23 0:00 | 1696.9 |
| 4/26/23 0:00 | 1747.2 |
| 4/27/23 0:00 | 1806.5 |
| 4/28/23 0:00 | 1801.3 |
| 4/29/23 0:00 | 1793.8 |
| 4/30/23 0:00 | 1777.0 |
| 5/1/23 0:00 | 1662.3 |
| 5/2/23 0:00 | 1565.1 |
| 5/3/23 0:00 | 1698.7 |
| 5/4/23 0:00 | 1799.9 |
| 5/5/23 0:00 | 1621.0 |
| 5/6/23 0:00 | 1570.1 |
| 5/7/23 0:00 | 1561.4 |
| 5/8/23 0:00 | 1704.7 |
| 5/9/23 0:00 | 1709.1 |
| 5/10/23 0:00 | 1747.7 |
| 5/11/23 0:00 | 1728.7 |
| 5/12/23 0:00 | 1724.5 |
| 5/13/23 0:00 | 1753.7 |
| 5/14/23 0:00 | 1960.6 |
| 5/15/23 0:00 | 1921.0 |
| 5/16/23 0:00 | 1991.6 |
| 5/17/23 0:00 | 1996.7 |
| 5/18/23 0:00 | 1969.3 |
| 5/19/23 0:00 | 1954.7 |

| | |
|---|---|
| 5/20/23 0:00 | 1976.3 |
| 5/21/23 0:00 | 1941.1 |
| 5/22/23 0:00 | 2022.6 |
| 5/23/23 0:00 | 1901.2 |
| 5/24/23 0:00 | 1674.7 |
| 5/25/23 0:00 | 1741.3 |
| 5/26/23 0:00 | 1597.3 |
| 5/27/23 0:00 | 1628.7 |
| 5/28/23 0:00 | 1679.2 |
| 5/29/23 0:00 | 1739.6 |
| 5/30/23 0:00 | 1772.0 |
| 5/31/23 0:00 | 1628.6 |
| 6/1/23 0:00 | 1688.5 |
| 6/2/23 0:00 | 1723.5 |
| 6/3/23 0:00 | 1822.1 |
| 6/4/23 0:00 | 1935.6 |
| 6/5/23 0:00 | 1964.4 |
| 6/6/23 0:00 | 1933.9 |
| 6/7/23 0:00 | 1853.1 |
| 6/8/23 0:00 | 1831.6 |
| 6/9/23 0:00 | 1852.9 |
| 6/10/23 0:00 | 1861.5 |
| 6/11/23 0:00 | 1965.2 |
| 6/12/23 0:00 | 1905.8 |
| 6/13/23 0:00 | 1913.6 |
| 6/14/23 0:00 | 1909.4 |
| 6/15/23 0:00 | 1929.6 |
| 6/16/23 0:00 | 1927.5 |
| 6/17/23 0:00 | 1936.8 |
| 6/18/23 0:00 | 1996.4 |
| 6/19/23 0:00 | 1897.4 |
| 6/20/23 0:00 | 1844.9 |
| 6/21/23 0:00 | 1854.2 |
| 6/22/23 0:00 | 1871.8 |
| 6/23/23 0:00 | 1868.5 |
| 6/24/23 0:00 | 1836.6 |
| 6/25/23 0:00 | 1780.8 |
| 6/26/23 0:00 | 1774.7 |
| 6/27/23 0:00 | 1761.6 |
| 6/28/23 0:00 | 1801.2 |
| 6/29/23 0:00 | 1797.8 |
| 6/30/23 0:00 | 3173.1 |

# ROSEVILLE ENERGY PARK COOLING TOWER EMISSIONS

| POLLUTANT | LBS PER DAY | QUARTER 1 | QUARTER 2 | QUARTER 3 | QUARTER 4 |
|---|---|---|---|---|---|
| PM-10 | 16.3 | 1471 | 1487 | 1504 | 1504 |

Whereas compliance with the PM-10 emission limit shall be demonstrated as;
Cooling tower recirculation rate * total dissolved solids of blowdown ***** design drift rate

| | | |
|---|---|---|
| | 53814 | Gallons per minute |
| | * 8.33 | Pounds per gallon |
| | * 1440 | Minutes per day |
| Circ pump flow rate | **64,550,969** | Pounds per day |

| | | |
|---|---|---|
| | 1844 | Average daily conductivity umhos |
| | 0.00000064 | Conversion to TDS ppm |
| Total dissolved solids | **0.00118016** | |

| | |
|---|---|
| Design drift rate | **0.005%** |
| **PM-10 pounds per day** | **3.81** |

| | | |
|---|---|---|
| | 91 | Days in quarter |
| **PM-10 pounds this quarter** | **347** | 2Q23 |

fill only these

**ATTACHMENT 23**

# AQ-71

**AQ-71** Compliance with the cooling tower PM-10 emission limit shall be demonstrated as follows: PM-10 = cooling water recirculation rate* total dissolved solids concentration in the blow own water* design drift rate.

**Verification:** the Project owner shall include all the necessary emissions data to demonstrate compliance with the emissions limits provided in this Condition as part of the Quarterly air Quality Report required in condition of Certification AQ-SC6.

Replace the dates with the ones you need

4/1/2023 0:00
6/30/2023 0:00

1D

TOWER AVG.

1844

| | 519-AIT-9504-1 |
|---|---|
| 4/1/23 0:00 | 1872.2 |
| 4/2/23 0:00 | 1916.9 |
| 4/3/23 0:00 | 1780.1 |
| 4/4/23 0:00 | 1709.5 |
| 4/5/23 0:00 | 1784.0 |
| 4/6/23 0:00 | 1837.3 |
| 4/7/23 0:00 | 1887.6 |
| 4/8/23 0:00 | 1873.6 |
| 4/9/23 0:00 | 1903.6 |
| 4/10/23 0:00 | 2007.0 |
| 4/11/23 0:00 | 2008.0 |
| 4/12/23 0:00 | 1921.1 |
| 4/13/23 0:00 | 1846.9 |
| 4/14/23 0:00 | 1871.3 |
| 4/15/23 0:00 | 1915.9 |
| 4/16/23 0:00 | 1924.9 |
| 4/17/23 0:00 | 1909.1 |
| 4/18/23 0:00 | 1791.0 |
| 4/19/23 0:00 | 1803.3 |
| 4/20/23 0:00 | 1869.5 |
| 4/21/23 0:00 | 1976.1 |
| 4/22/23 0:00 | 2033.6 |
| 4/23/23 0:00 | 2090.3 |
| 4/24/23 0:00 | 1495.6 |
| 4/25/23 0:00 | 1696.9 |
| 4/26/23 0:00 | 1747.2 |
| 4/27/23 0:00 | 1806.5 |
| 4/28/23 0:00 | 1801.3 |
| 4/29/23 0:00 | 1793.8 |
| 4/30/23 0:00 | 1777.0 |
| 5/1/23 0:00 | 1662.3 |
| 5/2/23 0:00 | 1565.1 |
| 5/3/23 0:00 | 1698.7 |
| 5/4/23 0:00 | 1799.9 |
| 5/5/23 0:00 | 1621.0 |
| 5/6/23 0:00 | 1570.1 |
| 5/7/23 0:00 | 1561.4 |
| 5/8/23 0:00 | 1704.7 |
| 5/9/23 0:00 | 1709.1 |
| 5/10/23 0:00 | 1747.7 |
| 5/11/23 0:00 | 1728.7 |
| 5/12/23 0:00 | 1724.5 |
| 5/13/23 0:00 | 1753.7 |
| 5/14/23 0:00 | 1960.6 |
| 5/15/23 0:00 | 1921.0 |
| 5/16/23 0:00 | 1991.6 |
| 5/17/23 0:00 | 1996.7 |
| 5/18/23 0:00 | 1969.3 |
| 5/19/23 0:00 | 1954.7 |

| | |
|---|---|
| 5/20/23 0:00 | 1976.3 |
| 5/21/23 0:00 | 1941.1 |
| 5/22/23 0:00 | 2022.6 |
| 5/23/23 0:00 | 1901.2 |
| 5/24/23 0:00 | 1674.7 |
| 5/25/23 0:00 | 1741.3 |
| 5/26/23 0:00 | 1597.3 |
| 5/27/23 0:00 | 1628.7 |
| 5/28/23 0:00 | 1679.2 |
| 5/29/23 0:00 | 1739.6 |
| 5/30/23 0:00 | 1772.0 |
| 5/31/23 0:00 | 1628.6 |
| 6/1/23 0:00 | 1688.5 |
| 6/2/23 0:00 | 1723.5 |
| 6/3/23 0:00 | 1822.1 |
| 6/4/23 0:00 | 1935.6 |
| 6/5/23 0:00 | 1964.4 |
| 6/6/23 0:00 | 1933.9 |
| 6/7/23 0:00 | 1853.1 |
| 6/8/23 0:00 | 1831.6 |
| 6/9/23 0:00 | 1852.9 |
| 6/10/23 0:00 | 1861.5 |
| 6/11/23 0:00 | 1965.2 |
| 6/12/23 0:00 | 1905.8 |
| 6/13/23 0:00 | 1913.6 |
| 6/14/23 0:00 | 1909.4 |
| 6/15/23 0:00 | 1929.6 |
| 6/16/23 0:00 | 1927.5 |
| 6/17/23 0:00 | 1936.8 |
| 6/18/23 0:00 | 1996.4 |
| 6/19/23 0:00 | 1897.4 |
| 6/20/23 0:00 | 1844.9 |
| 6/21/23 0:00 | 1854.2 |
| 6/22/23 0:00 | 1871.8 |
| 6/23/23 0:00 | 1868.5 |
| 6/24/23 0:00 | 1836.6 |
| 6/25/23 0:00 | 1780.8 |
| 6/26/23 0:00 | 1774.7 |
| 6/27/23 0:00 | 1761.6 |
| 6/28/23 0:00 | 1801.2 |
| 6/29/23 0:00 | 1797.8 |
| 6/30/23 0:00 | 3173.1 |

# ROSEVILLE ENERGY PARK COOLING TOWER EMISSIONS

| POLLUTANT | LBS PER DAY | QUARTER 1 | QUARTER 2 | QUARTER 3 | QUARTER 4 |
|---|---|---|---|---|---|
| PM-10 | 16.3 | 1471 | 1487 | 1504 | 1504 |

Whereas compliance with the PM-10 emission limit shall be demonstrated as;
Cooling tower recirculation rate * total dissolved solids of blowdown ***** design drift rate

| | | |
|---|---|---|
| | 53814 | Gallons per minute |
| | * 8.33 | Pounds per gallon |
| | * 1440 | Minutes per day |
| Circ pump flow rate | **64,550,969** | Pounds per day |

| | | |
|---|---|---|
| | 1844 | Average daily conductivity umhos |
| | 0.00000064 | Conversion to TDS ppm |
| Total dissolved solids | **0.00118016** | |

| | |
|---|---|
| Design drift rate | **0.005%** |
| **PM-10 pounds per day** | **3.81** |

| | | |
|---|---|---|
| | 91 | Days in quarter |
| **PM-10 pounds this quarter** | **347** | 2Q23 |

fill only these

**ATTACHMENT 24**

# AQ-86

**AQ-86** Operation for maintenance and testing of the emergency diesel engine and generator shall be limited to 50 hours per year.

**Verification**: The Project owner shall include all necessary operational data to demonstrate compliance with the limits provided in this Condition as part of the Quarterly Air Quality Report required in Condition of Certification AQ-SC6.

| DATE | INITIALS | START | END | REASON | HOURS TOTAL | MINUTES YTD |
|---|---|---|---|---|---|---|
| 7/10/22 | DE | 1120 | 1150 | BI-WEEKLY TEST RUN | 125 | 395 |
| 7/20/22 | DWN | 1455 | 1525 | Bi-Weekly Test Run | 125 | 425 |
| 8/7/22 | DE | 1212 | 1242 | BI-WEEKLY TEST RUN | 126 | 455 |
| 8.21.22 | CmC | 1655 | 1755 | Bi-weekly Test Run | 126 | 485 |
| 8/31/22 | DE | 0952 | 1012 | CD POWER POST MAINTENANCE RUN | 127 | 505 |
| 9.17.22 | JM | 1410 | 1440 | Bi-weekly test Run | 127 | 535 |
| 9.24.22 | CmC | 1520 | 1534 | Aborted. Redundant Test Run | 127 | 550 |
| 10/2/22 | DE | 1230 | 1300 | BI-WEEKLY TEST RUN | 128 | 580 |
| 10.15.22 | JM | 1314 | 1344 | Bi weekly test Run | 128 | 010 |
| 10/30/2022 | KAB | 1449 | 1519 | BI-WEEKLY TEST RUN | 129 | 640 |
| 11-12-22 | JM | 1238 | 1308 | Bi weekly test Run | 129 | 670 |
| 11-27-22 | CmC | 1011 | 1041 | Bi-Weekly Test Run | 130 | 700 |
| 12-10-22 | JM | 1200 | 1230 | Bi-weekly test Run | 130 | 730 |
| | | | | 2023 | 130 | 0 |
| 1-8-23 | LH | 13:13 | 13:43 | Biweekly Test Run | 131 | 30 |
| 1-22-23 | KAB | 1453 | 1523 | BIWEEKLY TEST RUN | 131 | 60 |
| 2.3.23 | DE | 1110 | 1144 | BIWEEKLY TEST RUN | 132 | 94 |
| 2-19-23 | KAB | 1459 | 1529 | BI WEEKLY TEST RUN | 132 | 124 |
| 3-5-23 | LH | 13:00 | 13:30 | Bi Weekly Test Run | 133 | 154 |
| 3-18-23 | KAB | 1114 | 1144 | BI WEEKLY TEST RUN | 133 | 184 |
| 5.2.23 | CmC | 1344 | 1405 | Transfer from Alt to Norm feed | 134 | 205 |
| 5.7.23 | CmC | 1040 | 1110 | Bi-Weekly Test Run | 134 | 235 |
| 5-13-23 | LH | 21:22 | 21:52 | Bi-weekly Test Run | 135 | 265 |
| 5-28-23 | DWN | 0810 | 0840 | Bi-Weekly Test Run | 135 | 295 |
| 6-8-23 | KAB | 0831 | 0901 | BI-WEEKLY TEST RUN | 136 | 325 |
| 6-15-23 | EO | 14:25 | 14:37 | REPLACE COOLANT HOSE TEST RUN | 136 | 337 |
| 6-25-23 | DWN | 1230 | 1300 | Bi-Weekly Test Run | 137 | 367 |

**ATTACHMENT 25**

# AQ-87

**AQ-87** Operation for other than maintenance and testing purposes shall be limited to involuntary interruptions of electrical power. Operation shall not exceed 24 hours without prior authorization by the Air Pollution Control Officer.

**Verification:** The Project owner shall include all necessary operational data to demonstrate compliance with the limits provided in this Condition as part of the Quarterly Air Quality Report required in Condition of Certification AQ-SC6.

| DATE | TIME START | Reason | TIME STOP | Total Hrs | YTD Hrs | initials |
|---|---|---|---|---|---|---|
| 12-17-22 | 1406 | Weekly Test Run | 1436 | 247.5 | 26.9 | |
| 12-25-22 | 0152 | WEEKLY TEST RUN | 0222 | 248.0 | 26.9 | |
| 12-31-22 | 1614 | Weekly test Run | 1644 | 248.5 | 27.4 | |
| | | 2023 Starting Hours | | 248.5 | | |
| 1-8-23 | 14:00 | Weekly Test Run | 14:30 | 249 | .5 | |
| 1-15-23 | 17:10 | Weekly Test Run | 17:40 | 249.5 | 1.0 | |
| 1-22-23 | 1623 | WEEKLY TEST RUN | 1653 | 250 | 1.5 | |
| 1-28-23 | 0836 | Weekly test Run | 0906 | 250.5 | 2 | |
| 2-5-23 | 1110 | Weekly Test Run | 1140 | 251.0 | 2.5 | DWN |
| 2/12/23 | 1355 | WEEKLY TEST RUN | 1425 | 251.5 | 3.0 | DE |
| 2-19-23 | 1420 | WEEKLY TEST RUN | 1450 | 252.0 | 3.5 | |
| 2-26-23 | 1355 | WEEKLY TEST RUN | 1425 | 252.5 | 4.0 | |
| 3-5-23 | 1220 | Weekly Test Run | 1250 | 253.0 | 4.5 | LH |
| 3-12-23 | 1113 | Weekly Test Run | 1148 | 253.5 | 5.0 | |
| 3-18-23 | 1518 | WEEKLY TEST RUN | 1548 | 254.0 | 5.5 | |
| 4-2-23 | 1015 | WEEKLY TEST RUN | 1045 | 254.5 | 6.0 | RC |
| 4-30-23 | 1550 | WEEKLY TEST RUN | 1620 | 255.2 | 6.7 | RC |
| 5-1-23 | 1530 | COSCO ANNUAL TEST | 1600 | 255.7 | 7.2 | RC |
| 5-2-23 | 1245 | COSCO ANNUAL TEST | 1300 | 256.0 | 7.5 | |
| 5-7-23 | 1415 | WEEKLY TEST RUN | 1445 | 256.5 | 8 | |
| 5-14-23 | 0929 | WEEKLY TEST RUN | 0959 | 257.0 | 8.5 | |
| 5-20-23 | 0818 | Weekly test Run | 0848 | 257.5 | 9.0 | |
| 5-28-23 | 0900 | Weekly Test Run | 0930 | 258.0 | 9.5 | DWN |
| 6-4-23 | 14:20 | Weekly test Run | 14:50 | 258.5 | 10.0 | KRB |
| 6/10/23 | 13:55 | Weekly Test Run | 14:25 | 259.0 | 10.5 | DE |
| 6-17-23 | 10:24 | Weekly test Run | 10:54 | 259.5 | 11 | |
| 6-25-23 | 1315 | Weekly Test Run | 1345 | 260.0 | 11.5 | DWN |
| 7-02-23 | 1010 | Weekly Test Run | 1030 | 260.5 | 12.0 | |

**ATTACHMENT 26**

# AQ-88

**AQ-88** The Sulfur content of the Diesel fuel used shall not exceed 15 ppm by weight.

**Verification:** The Project owner shall include a summary of diesel fuel purchase records showing amounts delivered, date delivered and fuel type with the Quarterly Air Quality Report as required in Condition of Certification AQ-SC6.

**ATTACHMENT 27**

# AQ-89

AQ-89 Records of operation and maintenance shall be kept by the owner or Operator for a period of five years and shall be made available to the PCAPCD upon request. Information required for reporting to the PCAPCD includes, but is not limited to:

1. The hours of operation the engine was run for maintenance and testing;
2. The hours of operation the engine was run during interruption of electrical power; and
3. Records of the sulfur content of the diesel used.

VERIFICATION: The Project owner shall include these records as part of the Quarterly Air Quality Report required in Condition of Certification AQ-SC6.

| DATE | INITIALS | START | END | REASON | HOURS TOTAL | MINUTES YTD |
|---|---|---|---|---|---|---|
| 7/10/22 | DE | 1120 | 1150 | BI-WEEKLY TEST RUN | 125 | 395 |
| 7/20/22 | DWN | 1455 | 1525 | Bi-Weekly Test Run | 125 | 425 |
| 8/7/22 | DE | 1212 | 1242 | BI-WEEKLY TEST RUN | 126 | 455 |
| 8.21.22 | CmC | 1655 | 1755 | Bi-weekly Test Run | 126 | 485 |
| 8/31/22 | DE | 0952 | 1012 | CD POWER POST MAINTENANCE RUN | 127 | 505 |
| 9.17.22 | JM | 1410 | 1440 | Bi-weekly test Run | 127 | 535 |
| 9.24.22 | CmC | 1520 | 1534 | Aborted. Redundant Test Run | 127 | 550 |
| 10/2/22 | DE | 1230 | 1300 | BI-WEEKLY TEST RUN | 128 | 580 |
| 10.15.22 | JM | 1314 | 1344 | Bi weekly test Run | 128 | 010 |
| 10/30/2022 | KAB | 1449 | 1519 | BI-WEEKLY TEST RUN | 129 | 640 |
| 11-12-22 | JM | 1238 | 1308 | Bi weekly test Run | 129 | 670 |
| 11-27-22 | CmC | 1011 | 1041 | Bi-Weekly Test Run | 130 | 700 |
| 12-10-22 | JM | 1200 | 1230 | Bi-weekly test Run | 130 | 730 |
| | | | | 2023 | 130 | 0 |
| 1-8-23 | LH | 13:13 | 13:43 | Biweekly Test Run | 131 | 30 |
| 1-22-23 | KAB | 1453 | 1523 | BIWEEKLY TEST RUN | 131 | 60 |
| 2.3.23 | DE | 1110 | 1144 | BIWEEKLY TEST RUN | 132 | 94 |
| 2-19-23 | KAB | 1459 | 1529 | BI WEEKLY TEST RUN | 132 | 124 |
| 3-5-23 | LH | 13:00 | 13:30 | Bi Weekly Test Run | 133 | 154 |
| 3-18-23 | KAB | 1114 | 1144 | BI WEEKLY TEST RUN | 133 | 184 |
| 5.2.23 | CmC | 1344 | 1405 | Transfer from Alt to Norm feed | 134 | 205 |
| 5.7.23 | CmC | 1040 | 1110 | Bi-Weekly Test Run | 134 | 235 |
| 5-13-23 | LH | 21:22 | 21:52 | Bi-weekly Test Run | 135 | 265 |
| 5-28-23 | DWN | 0810 | 0840 | Bi-Weekly Test Run | 135 | 295 |
| 6-8-23 | KAB | 0831 | 0901 | BI-WEEKLY TEST RUN | 136 | 325 |
| 6-15-23 | EO | 14:25 | 14:37 | REPLACE COOLANT HOSE TEST RUN | 136 | 337 |
| 6-25-23 | DWN | 1230 | 1300 | Bi-Weekly Test Run | 137 | 367 |

**ATTACHMENT 28**

# AQ-90

**AQ-90** No emissions are permitted, from any source, which are a nuisance per PCAPCD Rule 205, Nuisance.

**Verification:** The Project owner shall report all violations of this condition as noticed by the PCAPCD as well as any offsite nuisance complaints as part of the Quarterly Air Quality Report in Condition of Certification AQ-SC6.

In regards to AQ-90of Roseville Energy Park's 2Q23 QAQR, there were no violations of PCAPCD's Rule 205 for nuisance.

**ATTACHMENT 29**

# AQ-91

**AQ-91** Stack emission opacity as dark as Ringelmann No. 1 (20% opacity) for periods aggregating more than 3 minutes in any one hour is prohibited and is in violation of PCAPCD Rule 202, Visible Emissions.

**Verification:** The Project owner shall report all violations of this condition as noticed by the PCAPCD as well as any offsite nuisance complaints as part of the Quarterly Air Quality Report in Condition of Certification AQ-SC6.

In regards to AQ-91of Roseville Energy Park's 2Q23 QAQR, there were no violations of PCAPCD's Rule 202 for opacity from the diesel fire pump.

**ATTACHMENT 30**

# AQ-99

**AQ-99** Operation for maintenance and testing of the emergency diesel engine and generator shall be limited to 50 hours per year.

**Verification:** The Project shall include all necessary operational data to demonstrate compliance with the limits provided as part of the Quarterly Air Quality Report in Condition of Certification AQ-SC6

| DATE | INITIALS | START | END | REASON | HOURS TOTAL | MINUTES YTD |
|---|---|---|---|---|---|---|
| 7/10/22 | DE | 1120 | 1150 | BI-WEEKLY TEST RUN | 125 | 395 |
| 7/20/22 | DWN | 1455 | 1525 | Bi-Weekly Test Run | 125 | 425 |
| 8/7/22 | DE | 1212 | 1242 | BI-WEEKLY TEST RUN | 126 | 455 |
| 8.21.22 | CmC | 1655 | 1755 | Bi-weekly Test Run | 126 | 485 |
| 8/31/22 | DE | 0952 | 1012 | CD POWER POST MAINTENANCE RUN | 127 | 505 |
| 9.17.22 | JM | 1410 | 1440 | Bi-weekly test Run | 127 | 535 |
| 9.24.22 | CmC | 1520 | 1534 | Aborted. Redundant Test Run | 127 | 550 |
| 10/2/22 | DE | 1230 | 1300 | BI-WEEKLY TEST RUN | 128 | 580 |
| 10.15.22 | JM | 1314 | 1344 | Bi weekly test Run | 128 | 010 |
| 10/30/2022 | KAB | 1449 | 1519 | BI-WEEKLY TEST RUN | 129 | 640 |
| 11-12-22 | JM | 1238 | 1308 | Bi weekly test Run | 129 | 670 |
| 11-27-22 | CmC | 1011 | 1041 | Bi-Weekly Test Run | 130 | 700 |
| 12-10-22 | JM | 1200 | 1230 | Bi-weekly test Run | 130 | 730 |
| | | | | 2023 | 130 | 0 |
| 1-8-23 | LH | 13:13 | 13:43 | Biweekly Test Run | 131 | 30 |
| 1-22-23 | KAB | 1453 | 1523 | BIWEEKLY TEST RUN | 131 | 60 |
| 2.3.23 | DE | 1110 | 1144 | BIWEEKLY TEST RUN | 132 | 94 |
| 2-19-23 | KAB | 1459 | 1529 | BI WEEKLY TEST RUN | 132 | 124 |
| 3-5-23 | LH | 13:00 | 13:30 | Bi Weekly Test Run | 133 | 154 |
| 3-18-23 | KAB | 1114 | 1144 | BI WEEKLY TEST RUN | 133 | 184 |
| 5.2.23 | CmC | 1344 | 1405 | Transfer from Alt to Norm feed | 134 | 205 |
| 5.7.23 | CmC | 1040 | 1110 | Bi-Weekly Test Run | 134 | 235 |
| 5-13-23 | LH | 21:22 | 21:52 | Bi-weekly Test Run | 135 | 265 |
| 5-28-23 | DWN | 0810 | 0840 | Bi-Weekly Test Run | 135 | 295 |
| 6-8-23 | KAB | 0831 | 0901 | BI-WEEKLY TEST RUN | 136 | 325 |
| 6-15-23 | EO | 14:25 | 14:37 | REPLACE COOLANT HOSE TEST RUN | 136 | 337 |
| 6-25-23 | DWN | 1230 | 1300 | Bi-Weekly Test Run | 137 | 367 |

**ATTACHMENT 31**

# AQ-100

**AQ-100** In regards to the Emergency diesel Generator; Operation for other than maintenance and testing purposes shall be limited to involuntary interruptions of electrical power. Operation shall not exceed 24 hours without prior authorization by the Air Pollution Control Officer.

| DATE | INITIALS | START | END | REASON | HOURS TOTAL | MINUTES YTD |
|---|---|---|---|---|---|---|
| 7/10/22 | DE | 1120 | 1150 | BI-WEEKLY TEST RUN | 125 | 395 |
| 7/20/22 | DWN | 1455 | 1525 | Bi-Weekly Test Run | 125 | 425 |
| 8/7/22 | DE | 1212 | 1242 | BI-WEEKLY TEST RUN | 126 | 455 |
| 8.21.22 | CmC | 1655 | 1755 | Bi-weekly Test Run | 126 | 485 |
| 8/31/22 | DE | 0952 | 1012 | CD POWER POST MAINTENANCE RUN | 127 | 505 |
| 9.17.22 | JM | 1410 | 1440 | Bi-weekly test Run | 127 | 535 |
| 9.24.22 | CmC | 1520 | 1534 | Aborted. Redundant Test Run | 127 | 550 |
| 10/2/22 | DE | 1230 | 1300 | BI-WEEKLY TEST RUN | 128 | 580 |
| 10.15.22 | JM | 1314 | 1344 | Bi weekly test Run | 128 | 010 |
| 10/30/2022 | KAB | 1449 | 1519 | BI-WEEKLY TEST RUN | 129 | 640 |
| 11-12-22 | JM | 1238 | 1308 | Bi weekly test Run | 129 | 670 |
| 11-27-22 | CmC | 1011 | 1041 | Bi-Weekly Test Run | 130 | 700 |
| 12-10-22 | JM | 1200 | 1230 | Bi-weekly test Run | 130 | 730 |
| | | | | 2023 | 130 | 0 |
| 1-8-23 | LH | 13:13 | 13:43 | Biweekly Test Run | 131 | 30 |
| 1-22-23 | KAB | 1453 | 1523 | BIWEEKLY TEST RUN | 131 | 60 |
| 2.3.23 | DE | 1110 | 1144 | BIWEEKLY TEST RUN | 132 | 94 |
| 2-19-23 | KAB | 1459 | 1529 | BI WEEKLY TEST RUN | 132 | 124 |
| 3-5-23 | LH | 13:00 | 13:30 | Bi Weekly Test Run | 133 | 154 |
| 3-18-23 | KAB | 1114 | 1144 | BI WEEKLY TEST RUN | 133 | 184 |
| 5.2.23 | CmC | 1344 | 1405 | Transfer from Alt to Norm feed | 134 | 205 |
| 5.7.23 | CmC | 1040 | 1110 | Bi-Weekly Test Run | 134 | 235 |
| 5-13-23 | LH | 21:22 | 21:52 | Bi-weekly Test Run | 135 | 265 |
| 5-28-23 | DWN | 0810 | 0840 | Bi-Weekly Test Run | 135 | 295 |
| 6-8-23 | KAB | 0831 | 0901 | BI-WEEKLY TEST RUN | 136 | 325 |
| 6-15-23 | EO | 14:25 | 14:37 | REPLACE COOLANT HOSE TEST RUN | 136 | 337 |
| 6-25-23 | DWN | 1230 | 1300 | Bi-Weekly Test Run | 137 | 367 |

**ATTACHMENT 32**

# AQ-101

**AQ-101** The sulfur content of the diesel used shall not exceed 15ppm by weight

**Verification:** The Project owner shall include a summary of diesel fuel purchase records showing amounts delivered, date delivered and fuel type with the Quarterly Air Quality Report in Condition of Certification AQ-SC6

**ATTACHMENT 33**

# AQ-102

**AQ-102** Records of operation and maintenance shall be kept by the owner or operator for a period of five years and shall be made available to the PCAPCD by request. Information required for reporting to the PCAPCD includes, but is not limited to:

A. Hours of operation the engine was run for maintenance and testing
B. Hours of operation the engine was run during interruption of electrical power
C. Records of sulfur content of the diesel fuel used

**Verification:** The Project owner shall include these records as part of the Quarterly Air Quality Report in Condition of Certification AQ-SC6

| DATE | INITIALS | START | END | REASON | HOURS TOTAL | MINUTES YTD |
|---|---|---|---|---|---|---|
| 7/10/22 | DE | 1120 | 1150 | BI-WEEKLY TEST RUN | 125 | 395 |
| 7/20/22 | DWN | 1455 | 1525 | Bi-Weekly Test Run | 125 | 425 |
| 8/7/22 | DE | 1212 | 1242 | BI-WEEKLY TEST RUN | 126 | 455 |
| 8.21.22 | CmC | 1655 | 1755 | Bi-weekly Test Run | 126 | 485 |
| 8/31/22 | DE | 0952 | 1012 | CD POWER POST MAINTENANCE RUN | 127 | 505 |
| 9.17.22 | JM | 1410 | 1440 | Bi-weekly test Run | 127 | 535 |
| 9.24.22 | CmC | 1520 | 1534 | Aborted. Redundant Test Run | 127 | 550 |
| 10/2/22 | DE | 1230 | 1300 | BI-WEEKLY TEST RUN | 128 | 580 |
| 10.15.22 | JM | 1314 | 1344 | Bi weekly test Run | 128 | 010 |
| 10/30/2022 | KAB | 1449 | 1519 | BI-WEEKLY TEST RUN | 129 | 640 |
| 11-12-22 | JM | 1238 | 1308 | Bi weekly test Run | 129 | 670 |
| 11-27-22 | CmC | 1011 | 1041 | Bi-Weekly Test Run | 130 | 700 |
| 12-10-22 | JM | 1200 | 1230 | Bi-weekly test Run | 130 | 730 |
| | | | | 2023 | 130 | 0 |
| 1-8-23 | LH | 13:13 | 13:43 | Biweekly Test Run | 131 | 30 |
| 1-22-23 | KAB | 1453 | 1523 | BIWEEKLY TEST RUN | 131 | 60 |
| 2.3.23 | DE | 1110 | 1144 | BIWEEKLY TEST RUN | 132 | 94 |
| 2-19-23 | KAB | 1459 | 1529 | BI WEEKLY TEST RUN | 132 | 124 |
| 3-5-23 | LH | 13:00 | 13:30 | Bi Weekly Test Run | 133 | 154 |
| 3-18-23 | KAB | 1114 | 1144 | BI WEEKLY TEST RUN | 133 | 184 |
| 5.2.23 | CmC | 1344 | 1405 | Transfer from Alt to Norm feed | 134 | 205 |
| 5.7.23 | CmC | 1040 | 1110 | Bi-Weekly Test Run | 134 | 235 |
| 5-13-23 | LH | 21:22 | 21:52 | Bi-weekly Test Run | 135 | 265 |
| 5-28-23 | DWN | 0810 | 0840 | Bi-Weekly Test Run | 135 | 295 |
| 6-8-23 | KAB | 0831 | 0901 | BI-WEEKLY TEST RUN | 136 | 325 |
| 6-15-23 | EO | 14:25 | 14:37 | REPLACE COOLANT HOSE TEST RUN | 136 | 337 |
| 6-25-23 | DWN | 1230 | 1300 | Bi-Weekly Test Run | 137 | 367 |

**ATTACHMENT 34**

# AQ-103

**AQ-103** No emissions are permitted, from any source, which are a nuisance per PCAPCD Rule 205, Nuisance.

**Verification:** The Project owner shall report all violations of this condition as noticed by the PCAPCD as well as any offsite nuisance complaints as part of the Quarterly Air Quality Report in Condition of Certification AQ-SC6.

In regards to AQ-103 of Roseville Energy Park's 2Q23 QAQR, there were no violations of PCAPCD's Rule 205 for nuisance.

**ATTACHMENT 35**

# AQ-104

**AQ-104** Stack emission opacity as dark as Ringelmann No. 1 (20% opacity) for periods aggregating more than 3 minutes in any one hour is prohibited and is in violation of PCAPCD Rule 202, Visible Emissions.

**Verification:** The Project owner shall report all violations of this condition as noticed by the PCAPCD as well as any offsite opacity complaints as part of the Quarterly Air Quality Report in Condition of Certification AQ-SC6

In regards to AQ-104 of Roseville Energy Park's 2Q23 QAQR, there were no violations of PCAPCD's Rule 202 for opacity from stack emissions of the emergency diesel generator.