

DOCKETED

Docket Number:	79-AFC-04C
Project Title:	Compliance - Application for Certification of DWR Bottlerock Geothermal Project
TN #:	252241
Document Title:	2022 ANNUAL COMPLIANCE REPORT
Description:	2022 ANNUAL COMPLIANCE REPORT
Filer:	Anwar Ali
Organization:	California Energy Commission
Submitter Role:	Commission Staff
Submission Date:	9/13/2023 5:15:17 PM
Docketed Date:	9/14/2023



**2022 ANNUAL CALIFORNIA ENERGY COMMISSION
INTERIM CONDITIONS OF COMPLIANCE REPORT**

**BOTTLE ROCK POWER, LLC
GEOTHERMAL FACILITY**



2022 CEC INTERIM CONDITIONS OF COMPLIANCE REPORT

BOTTLE ROCK POWER, LLC

TABLE OF CONTENTS

1.0 Introduction.....	3
2.0 Verification of Conditions of Compliance.....	3
3.0 Attachments	26

LIST OF ATTACHMENTS:

Appendix 1: Interim Conditions of Compliance

Compliance Matrix

Annual Energy Facility Compliance Fee - Proof of Payment

Appendix 2: Renewed LCAQMD ATC's and PTO's

GAMP Participation – Proof of Payment

Appendix 3: Figure 1 - Vegetation Monitoring Map

Table 1 - Vegetation and Soil Boron Analytical Results

Vegetation and Soil Boron Analytical Reports

Figure 2 - Water Monitoring Map

Table 2 - Groundwater and Surface Water Analytical Results

Groundwater and Surface Water Analytical Reports



2022 CEC ANNUAL COMPLIANCE REPORT

BOTTLE ROCK POWER

1.0 Introduction

This report presents the 2022 compliance verification results for the Bottle Rock Power, LLC (BRP) geothermal facility located at 7385 High Valley Road in Cobb, California. For the purposes of this document the facility will be referred to as BRP. However, plant operations were transferred to Mayacma Geothermal (Mayacma) on March 20, 2023, so for future submittals the facility will be referred to as Mayacma.

The Bottle Rock Power, LLC facility suspended operations on March 31, 2015. Clean Energy Partners, LLC acquired 100% of the equity ownership interest in BRP Holdco, LLC on November 20, 2015, but the actual ownership of the Facility did not change. BRP continued to own the Facility on November 20, 2015 and continues to own it today. Additionally, operational control of the Facility has not changed. BRP contracts for certain select services such as security with a third party, but Baseload Clean Energy Partners, LLC/ Bottle Rock Power, LLC remain responsible for daily compliance with the Interim Conditions of Certification for the non-operational status of the Facility.

This verification is conducted in accordance with the Interim Conditions of Certification summarized in the California Energy Commission (CEC) letter addressed to BCEP on January 28, 2016. In this letter, energy commission staff determined which of the original Conditions of Compliance (COC's) were applicable during BRP's non-operational status. For ease of reference, this Letter is attached as Appendix 1; and the below report re-states the line-item detail of the applicable COC's found in the CEC Decision on the Petition to Amend the Conditions of Certification for the Bottle Rock Geothermal Power Plant, Docket 79-AFC-04C.

2.0 Annual Verification of Interim Conditions of Compliance

COM-1 Unrestricted Access

The project owner shall ensure that Energy Commission staff, and delegated agencies or consultants have unrestricted access to the facility site and the records maintained on-site.

The Bottle Rock Power, LLC geothermal power plant has been off-line since March 2015. There are no longer any employees, and the building is no longer in active use. The facility doors, perimeter fencing, and access road gates are all locked and secured. A caretaker is contracted to periodically visit and inspect the grounds or accompany any scheduled agency site inspections.



2022 CEC INTERIM CONDITIONS OF COMPLIANCE REPORT

BOTTLE ROCK POWER, LLC

COM-2 Compliance Record

The project owner must maintain copies of all project files and submittals.

Bottle Rock Power, LLC maintains copies of all project files and submittals, in either hard-copy, electronic PDF, or both.

COM-3 Compliance Verification Submittals

The project owner is responsible for the content and delivery of all verification submittals to the Compliance Project Manager (CPM).

The project owner for Bottle Rock Power, LLC acknowledges that they are responsible for the content and delivery of all verification submittals to the CPM.

COM-5 Compliance Matrix

The project owner must submit a compliance matrix to the CPM with each Annual Compliance Report.

A one-year compliance matrix is included with this report in Appendix 1.

COM-6 Monthly Compliance Report/Key Event List

During project initiation, construction or closure the project owner will submit a Monthly Compliance Report.

Bottle Rock Power, LLC recognizes that in the event of re-purposing or closure of the project, Monthly Compliance Reports will be submitted to the CPM during construction or closure activities.

COM-7 Annual Compliance Report

After construction is complete the project owner must submit Annual Compliance Reports instead of Monthly Compliance Reports. Annual Compliance Reports are due for each year of commercial operation and may be required for a specified period after decommissioning to monitor closure compliance.



2022 CEC INTERIM CONDITIONS OF COMPLIANCE REPORT

BOTTLE ROCK POWER, LLC

Bottle Rock Power, LLC recognizes that Annual Compliance Reports are due for each year of commercial operation and may be required for a specified period after decommissioning to monitor closure compliance. Although the Bottle Rock Power, LLC facility was not in commercial operation in 2022 the intention is to seek opportunities to repurpose the facility as an energy production facility and not decommission the project. This annual report for 2022 has been prepared for submittal to the CPM with the intention to continue to pursue productive options for the project.

COM-9 Annual Energy Facility Compliance Fee

Pursuant to the provisions of Section 25806(b) of the Public Resources Code, the project owner is required to pay an annually adjusted compliance fee.

The Annual Energy Facility Compliance Fee of \$30,554 was paid by Bottle Rock Power, LLC to the CEC on June 17th, 2022. A copy of this proof of payment is included in Appendix 1.

COM-10 Amendments, Ownership Changes, Staff-Approved Project Modifications, and Verification Changes

The project owner must petition the Energy Commission pursuant to Title 20, California Code of Regulations, section 1769, to modify the design, operation, or performance requirements of the project, or to transfer ownership or operational control of the facility.

Bottle Rock Power, LLC acknowledges this condition. Currently no amendments, ownership changes or modification are scheduled.

COM-11 Reporting of Complaints, Notices and Citations

The project owner shall provide posted telephone number, and if not staffed twenty-four hours per day, must include automatic answering. The project owner must respond to all recorded complaints, and notify the CPM of any complaints, official notices, warnings, citations, court orders or fines. Copies of all relevant information must be included in the Annual Compliance Report.

The Bottle Rock Power, LLC facility ceased operations including wellfield steam production in March 2015. Since this time, BRP has maintained a 24-hour accessible phone number that includes automatic answering/recording and is carried by the contracted caretaker. This number is clearly posted on access gate signage. All received calls/messages are forwarded to contracted project managers by the caretaker; and promptly addressed.

Bottle Rock Power, LLC acknowledges CPM notification of any complaints, official notices, warnings, court orders or fines. No complaints were received by BRP during the year of non-operational status in 2022, and no notification to the CPM was required.



2022 CEC INTERIM CONDITIONS OF COMPLIANCE REPORT

BOTTLE ROCK POWER, LLC

COM-12 Emergency Response Site Contingency Plan

Prior to the start of commercial operation, the project owner must submit for CPM review and approval, an Emergency Response Site Contingency Plan.

An Emergency Response Site Contingency Plan had been previously submitted for CPM review prior to the original Bottle Rock Power, LLC start-up in 1983, and re-start-up in 2007.

COM-13 Incident Reporting Requirements

Within 12 hours the project owner must notify the CPM, by telephone and email, of any incident at the power plant that results or could result in emergency reporting to any federal, state, or local agency.

Bottle Rock Power, LLC acknowledges this condition. No incidents occurred during BRP's year of non-operational status in 2022 that required emergency reporting to any Federal, State, or local agency, or CPM notification.

COM-14 Non-Operation

If the facility ceases operation temporarily, either planned or unplanned, for longer than one week, but less than three months, the project owner must notify the CPM.

Bottle Rock Power, LLC provided notification to the CPM of their indefinite length, suspended operations, prior to the stoppage of power production and shutting-in the wellfield on March 31, 2015. Bottle Rock Power, LLC remained in non-operational status in 2022 along with informing the CPM of the intent on re-purposing and not decommissioning the project.

COM-15 Closure Planning

To ensure that a facility's closure and long-term maintenance do not pose a threat to public health and safety or to environmental quality, the project owner must coordinate with the Energy Commission to plan and prepare for eventual permanent closure.

A Closure Plan generated by Dames & Moore in 1996 for Bottle Rock Power, LLC is on file with the CEC. Additionally, decommissioning tasks and cost estimates were updated and submitted for CEC review in 2013.



2022 CEC INTERIM CONDITIONS OF COMPLIANCE REPORT

BOTTLE ROCK POWER, LLC

COM-16 Closure Financial Assurances

A. Financial Surety Mechanism: Surety Bond

The project owner must provide financial assurances to the Energy Commission, guaranteeing adequate and readily available funds to finance interim operation, and facility closure, as needed. The financial assurances shall be in the form of an irrevocable closure surety bond and standby trust fund. The standby trust fund shall have as its Beneficiary the California State Energy Resources Conservation and Development Commission. Alternatively, a trust account, letter of credit, restricted bank account or other mechanism may be used if the mechanism and its provisions, including the institution involved, are approved by the CPM as providing an equivalent level of financial assurance.

The required level of financial assurance was set at \$1,341,500 by CEC staff in December 2013, to be escalated 5% over 5-Years for contingency, as follows:

2014	\$1,341,500
2015	\$1,408,575
2016	\$1,475,650
2017	\$1,542,725
2018	\$1,609,800
2019–On	\$1,676,875 (no further contingency escalation required).

The level of financial assurance required for 2019 was not escalated further. The Bond was replaced with a Letter of Credit, issued by BRP, and held by Silicon Valley Bank, in San Jose CA.

AQ 1-1

The project owner shall summarize in an annual compliance report any interactions with the LCAQMD. The project owner shall immediately inform the CEC CPM and APB in writing of any formal appeals filed with the LCAQMD.

BRP maintained their on-going working relationship with the LCAQMD throughout the year. BRP continued to comply with the conditions delineated on each Authority to Construct (ATC) or Permit to Operate (PTO). An Annual Throughput report was completed, and fees paid to



2022 CEC INTERIM CONDITIONS OF COMPLIANCE REPORT

BOTTLE ROCK POWER, LLC

renew the project's PTOs and ATCs for the 2022 year; and the Quarterly Air Quality Reports were submitted. BRP continues to participate with the GAMP program.

AQ 1-6

The project owner shall furnish proof of installation and maintenance of the meteorological station and submission of the data there from in a form acceptable to the LCAQMD. The submittals shall be noted in periodic compliance reports filed with the CEC CPM.

Bottle Rock Power, LLC operated and maintained an onsite meteorological station, and data was available to LCAQMD, as requested.

AQ 1-7

The project owner shall submit in the Annual Compliance Report a statement describing project owner's participation in GAMP.

During 2022, Bottle Rock Power, LLC attended GAMP quarterly meetings via representative. GAMP VI Year 17 (2022) Cost Share was invoiced for \$10,919 and paid on January 28th, 2022. Receipt for payment of this amount is included in Appendix 2.

AQ 1-8

The project owner shall submit in the Annual Compliance Report to the CEC CPM appropriate confirmation from the LCAQMD that all ATCs and PTOs are current and active under the Terms and Conditions of LCAQMD Rules and Regulations. The project owner shall also include in this report a statement identifying any complaints and actions of resolution for air quality for the Bottle Rock facility.

Bottle Rock Power, LLC complied with all Authority to Construct (ATC) and Permit to Operate (PTO) conditions, in accordance with LCAQMD rules and regulations. Annual throughput calculations and report were submitted to LCAQMD, and fees paid to renew the project's PTOs and ATCs for the 2022 year (Appendix 2). No nuisance odor complaints, or actions of resolution for air quality were received in 2022.

AQ AC21-5, AC22-4, AC24-6, AC25-6, AC26-6

The operator shall provide safe access for representatives of the District, ARB, or EPA to inspect, review records, or collect samples as approved by the APCO, from this facility.



2022 CEC INTERIM CONDITIONS OF COMPLIANCE REPORT

BOTTLE ROCK POWER, LLC

Should the plant be secured by locks or gates, the District shall be provided keys, combinations, or other means to gain immediate access for purpose of testing or inspection.

The Bottle Rock Power, LLC geothermal power plant has been off-line since March 31, 2015. There are no longer any employees, and the building is no longer in active use. The facility doors, perimeter fencing, and access road gates are all locked and secured. A caretaker is contracted to periodically visit and inspect the grounds; or accompany any scheduled or requested agency site inspection. The cell number to reach the contracted caretaker is clearly posted on the facility access gates. Additionally, this phone number was provided to LCAQMD to provide communication with the Caretaker for site access to maintain the District's ambient air quality monitoring stations located on the project grounds.

CR4-5

Project owner shall ensure that the existing fence on the north side of site CA-LAK-609 is maintained. A statement verifying compliance shall be provided in each Annual Compliance Report filed with the CEC CPM.

Bottle Rock Power, LLC, inspected the fence on the north side of site CA-LAK-609. Bottle Rock Power, LLC also inspected the border fencing for an archeological site located on the Binkley Leasehold. The fencing around this site had degraded over time principally due to tree limb falls and erosion along creek beds. In the pictures below new fencing piles and tie-downs





2022 CEC INTERIM CONDITIONS OF COMPLIANCE REPORT

BOTTLE ROCK POWER, LLC

were installed to reinforce the perimeter fencing. There is now continuous fencing around the Arch site.

Fence surrounding the west corner of archeological site.



Fencing repair work

BR 5-1f & 5-3h

Annually, the project owner shall inspect all previously disturbed areas for soil erosion impacts and shall take corrective action whenever necessary. The project owner shall submit to the CEC CPM in the Annual Compliance Report the results of the monitoring and an explanation that verifies compliance with this condition.

No earth moving activities were performed in 2022, but Bottle Rock Power, LLC recognizes that such activities are restricted to the dry months (April to October).

In 2022 BRP completed drainage inspections on the access road to the West Coleman pad. The lack of significant rainwater on the slopes and roads this season has resulted in no change in the condition of the slopes from last season. Drains along the roads are clear except for light leaf content. Lack of water may determine whether seeding and vegetation on slopes and near pads will survive to next fall winter.



2022 CEC INTERIM CONDITIONS OF COMPLIANCE REPORT

BOTTLE ROCK POWER, LLC

High Valley Road Photos of roads appear as they did in 2019. No additional work was performed in 2022, BRP will continue monitoring for changes.



Lower re-seeded section of High Valley Road



Upper re-seeded section of High Valley Road



2022 CEC INTERIM CONDITIONS OF COMPLIANCE REPORT

BOTTLE ROCK POWER, LLC

West Coleman Road: Photos of roads appear as they in 2019. Drainage ditches, energy dispersers, culverts, inlets, outlets, and diversions were inspected, and the road surface was clear. No further work was indicated or performed for 2022.



Area around West Coleman Road



2022 CEC INTERIM CONDITIONS OF COMPLIANCE REPORT

BOTTLE ROCK POWER, LLC

The Francisco Spoils Pile and Steam field yard sedimentation areas: Photos appear as they did in 2019. Inspections indicated that the hydro-seeding was successful, completely covered with new growth; basin controls (inlets, outlets, diversions, weirs, spillways) were in good working order. No additional work was performed in 2022.



Area around Francisco Spoils



2022 CEC INTERIM CONDITIONS OF COMPLIANCE REPORT

BOTTLE ROCK POWER, LLC

Re-Injection line: Photos of roads appear as they did in 2019. Additional anchoring supports installed in 2014 continued to prevent the line from expanding into the access road and stabilized the line on the roadway crossing Cow Creek. No additional work was performed in 2022.



Injection Line Area

BR 5-2

One year prior to power plant deactivation, the project owner shall include in the decommissioning plan a biological resources element identifying mitigation measures. The project owner shall submit the biological resources element of the decommissioning plan in consultation with CDFG of adequacy and acceptability.

Bottle Rock Power, LLC remained in non-operational status in 2022 and the intent is to re-purpose, not decommission, the project. However, BRP recognizes that one-year prior to



2022 CEC INTERIM CONDITIONS OF COMPLIANCE REPORT

BOTTLE ROCK POWER, LLC

closure of the project, BRP will include a biological resources element in the decommissioning plan.

BR 5-3a

The project owner shall include the results and a discussion of the year's required monitoring (visual inspections; soil/needle tissue boron analysis) in the Annual Compliance Report.


Bottle Rock Power, LLC continued monitoring vegetation in the project area in 2022. Needle and understory soil samples were collected and analyzed for boron concentration. Samples were collected of both canopy needles. BRP monitors the same trees each year, and locations are shown in Figure 1, Appendix 3. Analytical results are presented in Table 1, Appendix 3. Associated Laboratory reports are presented in Appendix 3.

Coleman Pad and surrounding area

There were no significant changes in tree health from 2019 to 2022, so photos of trees appear the same as they did in 2019. Since inter-pad access roads (asphalt and dirt) are not utilized as they were during operations, there are no emissions in the area to impact the adjacent vegetation. At the Coleman Pad and surrounding area, the trees in the area were in good health with new needle growth. Smaller trees in more sun-exposed slopes still exhibit some drought stress, indicated by reduced needle length and reduced needle density. The monitored trees (A-1 and A-2) both had bare bottoms (3/4 of trees), and the rest of the trees looked healthy with green pine needles. A-1 had a few brown needles peppered throughout. with no needle browning appreciated. Normal lower canopy, shaded understory needle and branch shedding has continued A-1, and this medium-sized tree no longer had any accessible branches for needle collection and analysis.



Tree A- 1

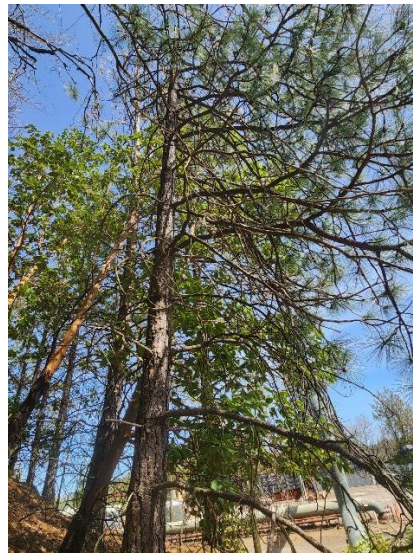

Tree A- 2



2022 CEC INTERIM CONDITIONS OF COMPLIANCE REPORT

BOTTLE ROCK POWER, LLC

West Coleman Road

There were no significant changes in tree health from 2019 to 2022, so photos of trees appear the same as they did in 2019. Since inter-pad access roads (asphalt and dirt) are not utilized as they were during operations, there are no emissions in the area to impact the adjacent vegetation. At the West Coleman Pad and surrounding area, the trees were in good health with new needle growth. Smaller trees in more sun-exposed slopes still exhibit drought stress, as indicated by reduced needle length and reduced needle density. Trees designated as B-1 and B-2 are younger trees, showing more needle browning compared to the 2019. The overall health of B-1 and B-2 trees is struggling, about half of pine needles are green, and the other half are brown. The west side of the B-1 tree has very few branches. The monitored trees varied in drought-related health. The tree designated as B-3 is a mature tree, the top 2/3 of the tree looks healthy and green and the bottom 1/3 has brown pine needles and several bare branches.



Tree B- 1



Tree B- 2



Tree B- 3



2022 CEC INTERIM CONDITIONS OF COMPLIANCE REPORT

BOTTLE ROCK POWER, LLC

Access Road

There were no significant changes in tree health from 2019 to 2022, so photos of trees appear the same as they did in 2019. Since inter-pad access roads (asphalt and dirt) are not utilized as they were during operations, there are no emissions in the area to impact the adjacent vegetation. Inter-pad access road and surrounding area has relatively young trees. C-1 tree overall health is good, it is mostly green with a few highlights of brown needles scattered in various places of the tree. C-2 north bottom half side is bare and the bottom 1/3 has bare branches. The top 2/3 looks healthy with green pine needles and some browning only on the tips of needles. Both trees appear to have marginal vigor. Smaller trees in more sun-exposed slopes exhibit more drought stress, as indicated by reduced needle length and reduced needle density. Normal lower canopy, shaded understory needle and branch shedding has continued.



Tree C-1



Tree C-2

North of Plant fence line


There were no significant changes in tree health from 2019 to 2022, so photos of trees appear the same as they did in 2019. Since inter-pad access roads (asphalt and dirt) are not utilized as they were during operations, there are no emissions in the area to impact the adjacent vegetation. Near the main plant and surrounding area, the trees are overall in good health. D-1 and D-2 on




2022 CEC INTERIM CONDITIONS OF COMPLIANCE REPORT

BOTTLE ROCK POWER, LLC

the uppermost slope with greatest sun exposure, are young trees. No needle browning was noted, both trees look healthy and green. D-1 has a lot of sap. The tallest tree (D-3, > 10 meters) downslope is more shaded, the top half of the tree looks healthy, the bottom half has very few needles on branches. D-3 shaded understory needle and branch shedding has continued, and this large tree did not have any accessible branches for needle collection.

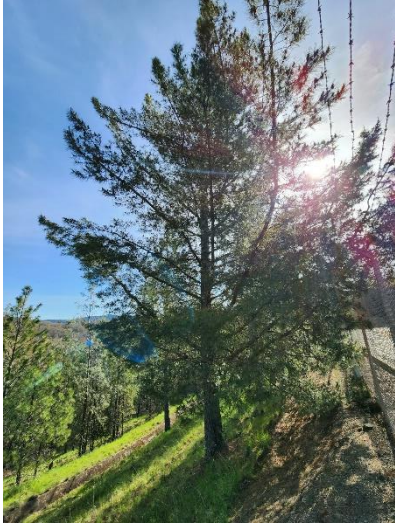

Tree D-1

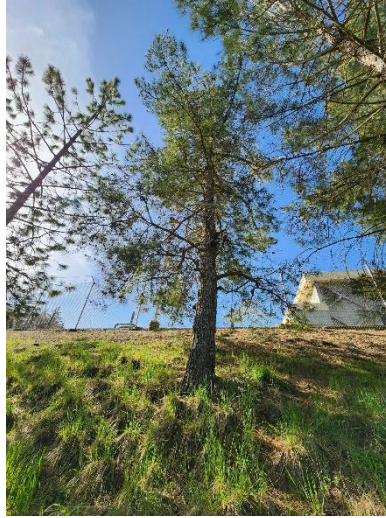

Tree D-2



Tree D-3

BR 5-3b

The project owner shall include the results and a discussion of the year's required monitoring (surface water sampling and analysis) in the Annual Compliance Report.

Regional surface water quality was monitored through the quarterly sampling of the following locations: Kelsey Creek near Kelseyville (SW-6), Kelsey Creek above High Valley Road (SW-7), High Valley Creek above Kelsey Creek (SW-8), Adler Creek above Glenbrook (SW-9), and Kelsey Creek above Glenbrook (SW-10). Water monitoring locations are shown in Figure 2, Appendix 3.

Sampling procedures were consistent with EPA ground surface water sampling protocols. Data collected and analyzed include physical water quality parameters, selected major/minor element concentrations, dissolved metals concentrations and coliform bacteria. Samples were collected in reagent prepared containers provided by analytical laboratories Analytical Sciences of Petaluma and Alpha Analytical Laboratories, also of Petaluma. These included two, one-liter Nalgene for cations and anions; two, 250 ml Nalgene for total coliform and turbidity; and a 100 ml glass vial for dissolved oxygen. Date and time were recorded with each sample collection. Samples were labeled in the field and placed in an ice chest for transportation to the laboratory along with the proper chain of custody documentation.



2022 CEC INTERIM CONDITIONS OF COMPLIANCE REPORT

BOTTLE ROCK POWER, LLC

Surface water monitoring analytical results for 2022 are summarized in Table 2 in Appendix 3. Laboratory reports are presented in Appendix 3.

BR 5-3c

The project owner shall include the results and a discussion of the year's required monitoring (groundwater sampling and analysis) in the Annual Compliance Report.

Regional groundwater quality was monitored through the quarterly sampling of the following locations: Barrett Spring (GW-1) and Francisco Well (GW-3). Figure 1 shows all groundwater and surface water sampling locations. Sampling of Union Spring (GW-2) has not been conducted in many years due to unsafe access and large amounts of poison oak in the area. Access to Coleman Well (GW-4) and Wright Spring (GW-5) was not available in 2022 due to closed and posted gate. Additionally, sites GW-2 and GW-5 are located on leases managed by the Calpine Corporation and access is restricted.

Sampling procedures were consistent with EPA ground surface water sampling protocols. Data collected and analyzed include physical water quality parameters, selected major/minor element concentrations, dissolved metals concentrations and coliform bacteria. Samples were collected in reagent prepared containers provided by analytical laboratories Analytical Sciences of Petaluma and Alpha Analytical Laboratories, also of Petaluma. These included two, one-liter Nalgene for cations and anions; and one, 250 ml Nalgene for turbidity. Date and time were recorded with each sample collection. Samples were labeled in the field and placed in an ice chest for transportation to the laboratory along with the proper chain of custody documentation.

Groundwater monitoring analytical results for 2022 are summarized in Table 2 in Appendix 3. Laboratory reports are presented in Appendix 3.

BR 5-3d

The project owner shall include the results and a discussion of the year's required monitoring (biennial wildlife) in the Annual Compliance Report.

Since 1984, Bottle Rock Power, LLC has monitored wildlife use of the guzzlers and nesting boxes installed as part of the original construction mitigation plan. After over thirty years, the disturbance incurred during original construction has long since passed, and the wildlife prefer to utilize the natural environment rather than the man-made boxes and water sources. Therefore, in 2022, wildlife monitoring was not conducted. BRP still maintains the water trough behind WW-1 as a default source of water for wildlife.



2022 CEC INTERIM CONDITIONS OF COMPLIANCE REPORT

BOTTLE ROCK POWER, LLC

BR 5-3i

The Annual Compliance Report will collate and summarize all monitoring results including methodologies used to satisfy conditions 5-3a – 5-3h.

Methodologies used to satisfy conditions 5-3a – 5-3d are detailed in each respective section of this Annual Report.

The monitoring results for Soil/Needle Tissue Boron analysis are shown in Table 1, Appendix 3.

The monitoring results for Surface Water analysis are shown in Table 3, Appendix 3.

The monitoring results for Groundwater analysis are shown in Table 3, Appendix 3.

BR 5-3j

The project owner in consultation with CEC CPM will take action to correct any specific mitigation measure or monitoring program is determined to be ineffective, or if the CEC CPM receives any submittal, complaints, or other information from the project owner, other agencies, or the public, that indicates one or more significant impacts are occurring on the leasehold subject to CEC jurisdiction.

Bottle Rock Power, LLC acknowledges this condition.

WR 6-1

Project owner shall, during any period of suspension, utilize no new surface water as the source for any maintenance or other necessary activity without first notifying and obtaining the required authorization from the appropriate federal, state, county, or local agencies.

Bottle Rock Power, LLC acknowledges this condition. BRP maintains WW-1 and WW-2 for water supply to the Field Maintenance Shop and emergency water for the plant, should that be required, such as Injector de-pressurization.

WR 6-2

Project owner shall maintain on file the Spill Contingency and Containment Plan (SCCP) originally required by the CVRWQCB.



2022 CEC INTERIM CONDITIONS OF COMPLIANCE REPORT

BOTTLE ROCK POWER, LLC

Bottle Rock Power, LLC maintains, and updates as needed their Spill Prevention Countermeasure Control Plan. The plan was updated in 2022. A copy of this plan is available upon request.

WR 6-3

Project owner shall submit annually to the CVRWQCB and to the CEC CPM, via the Annual Compliance Report, a record of maintenance and corrective measures to the spill containment system.

There are five (5) storm water collection sumps located within the BRP facility yard. These sumps flow into the cooling tower overflow pits, and gravity drain into the Coleman Pad injection well. BRP contractors conduct inspections during and after stormwater events to ensure the system is operating correctly. All pumps were serviced in 2022, including periodic use of portable electric sump pumps and cleaning of injection well and cooling tower filter screens. In addition to the operating pumps BRPP acquired two spare pumps (new) and a stand-by generator to provide power in 2020. PG&E initiated many power outages for line repairs as well as for declared line safety events which required the need for the standby power unit. To maximize stormwater collection and retention from the main plant yard, the upper cooling tower weir was removed in 2018. This allowed the level of the cooling tower basin that could gravity drain to the injection well to be lowered an additional 3 feet, adding significant stormwater collection capacity during rainfall events. The cooling tower water remains the best source for containment of surface water run-off and serves the dual purpose of providing water needed to keep the injection well de-pressurized.

WR 6-4

Project owner shall submit annually to the CVRWQCB and to the CEC CPM, via the Annual Compliance Report, a record of maintenance and corrective measures to the wastewater disposal system.

In 2022, the Bottle Rock Power, LLC facility was not operating. Consequently, the domestic water waste disposal system did not receive much use or require any maintenance.

WR 6-5

Project owner shall maintain quarterly records of the volume of water pumped from the on-site supply well.

Bottle Rock Power, LLC maintained records in 2022 of monthly water pumping from domestic wells #1 and #2. BRP also maintains a running tally of water injected into the injection well.



2022 CEC INTERIM CONDITIONS OF COMPLIANCE REPORT

BOTTLE ROCK POWER, LLC

WR 6-6

Project owner shall submit annually to the CEC CPM a record of maintenance and operation of the drainage sump pump discharge to the injection wells(s).

There are five (5) storm water collection sumps located within the BRP facility yard. These sumps flow into the cooling tower overflow pits, and gravity drain into the Coleman Pad injection well. BRP contractors conduct inspections during and after stormwater events to ensure the system is operating correctly. During 2019 and into 2022, BRP modified and secured the operation of the injection well at the Coleman Pad. New piping was installed in 2020, and updated controls and control panel were added, which provide remote surveillance of pump and line status. To maximize stormwater collection and retention from the main plant yard, the upper cooling tower weir was removed in 2018. This allowed the level of the cooling tower basin that could gravity drain to the injection well to be lowered an additional 3 feet, adding significant stormwater collection capacity during rainfall events.

S 8-4

At least six months prior to scheduled decommissioning, the project owner shall submit site restoration plans to the CEC CPM for review and approval.

Bottle Rock Power, LLC remained in non-operational status in 2022 and is actively working on re-purposing, not decommissioning the project. However, BRP recognizes that six months prior to scheduled decommissioning, BRP will submit site restoration plans to the CEC CPM.

CE 9-5

At least six months prior to scheduled decommissioning, the project owner shall submit its site reclamation plan to the CEC CPM for review and approval.

Bottle Rock Power, LLC remained in non-operational status in 2022 and intent on re-purposing, not decommissioning the project. However, BRP recognizes that six months prior to scheduled decommissioning, BRP will submit site reclamation plan to the CEC CPM.

SWM 11-7

The project owner shall notify the CEC CPM in writing within 10 days of becoming aware of an impending (waste management -related) enforcement action.

Bottle Rock Power, LLC acknowledges this condition.



2022 CEC INTERIM CONDITIONS OF COMPLIANCE REPORT

BOTTLE ROCK POWER, LLC

SWM 11-8

The project shall include the results of sludge testing in a report provided to the CEC CPM.

In 2020, the Bottle Rock Power, LLC facility was not operating. Consequently, the cooling tower was not in use for heat rejection from power generation or condensation of produced steam. The cooling tower was cleaned in 2015, but no sludge removal and disposal were performed in 2022. BRP keeps a minimum level in the cooling tower to mitigate exposing the cooling tower basin floor and allowing drying and maintain dust control.

S 12-8

Project owner shall notify the CEC CPM of any changes to the approved accident prevention program and provide verification of California Occupational Safety and Health Administration (Cal/OSHA) approval of said changes.

Bottle Rock Power, LLC acknowledges this condition.

S 12-9

During any suspension, the project owner shall notify the CEC CPM in writing in the event of a violation that could involve DOSHA action, and the necessary corrective action.

Bottle Rock Power, LLC acknowledges this condition.

S 12-10

Within 90 days of suspending operations, the project owner shall submit the following to the CEC CPM: (1) a list of all hazardous chemicals and the quantities that are to remain on site during any suspension, and (2) the signature of the responsible Plant Manger certifying compliance with this condition.

In 2016 an updated Hazardous Materials Inventory list was provided to the CPM. Additionally, in 2022 the Hazardous Materials Inventory list was updated and filed with Lake County CUPA.



2022 CEC INTERIM CONDITIONS OF COMPLIANCE REPORT

BOTTLE ROCK POWER, LLC

TS&N 13-2

The project owner shall also inspect the transmission line annually to ensure that the line maintains required clearances especially during the fire season. In the event that noncompliance is determined by the CDF, the CDF shall require the project owner to take measures necessary to correct the noncompliance.

The Transmission Line (T-Line) corridor tower and vegetation maintenance is the responsibility of PG&E and their designated contractors. PG&E, over the past 3 years, has engaged in extensive vegetation management on the 230kV line as well as the 12kV distribution line that supplies power to the well pads. The line continues thru the project to supply private residences in the valley.

During 2022, PG&E has conducted clearing of the T-Line and continues to assess growth and engage in supplemental trimming.

N 16-1

Project owner shall comply with Lake County's noise ordinance, which is 55 dBA Ld. and 45 dBA Ln at any point beyond the property line of the source.

Bottle Rock Power, LLC was not operating in 2022. No noise complaints were received in 2022.



2022 CEC ANNUAL COMPLIANCE
REPORT BOTTLE ROCK POWER

Appendix 1

Interim Conditions of Certification

Compliance Matrix (Separate File)

***Annual Energy Facility Compliance Fee – Proof of
Payment***

2016 Summary of BRP's Interim Conditions of Certification

COC #	COC Summary: Compliance	Comments
COM-1	Unrestricted Site Access	Staff has reviewed all BRP Compliance COCs and recommends that these COCs are required during BRP's non-operational status.
COM-2	Ongoing Compliance Records	
COM-3	Compliance Verification Submittals	
COM-5	Compliance Matrix	
COM-6	Monthly Compliance Reporting and Key Event List	
COM-7	Annual Compliance Reporting	
COM-9	Annual Energy Compliance Fee	
COM-10	Amendments, Ownership Changes, Staff Approved Project Modifications and Verification Changes	COM-10 notification requirements are also required and remain applicable during BRP's non-operational status.
COM-11	Compliant, Notice and Citation Reporting	Staff has reviewed all BRP Compliance COCs and recommends that these COCs are required during BRP's non-operational status.
COM-12	Emergency Response Site Contingency Plan	
COM-13	Incident Reporting Requirements	
COM-14	Non-Operation Requirements	COM-14 Executive Director oversight for suspension/closure determinations are required during BRP's non-operational status.
COM-15	Closure Planning Requirements	Staff has reviewed all BRP Compliance COCs and recommends that these COCs are required during BRP's non-operational status.
COM-16	Closure Financial Assurances	
COC #	COC Summary: Air Quality (AQ)	Comments
AQ 1-1	The Lake County Air Quality Management District (LCAQMD) shall perform all duties and functions normally conducted by the APCD District and shall have authority to issue a Permit to Operate...	Maintenance activities are required and permitted equipment (such as the emergency engine) may operate during the interim period, therefore staff recommends retaining these COCs to ensure current or future plant activity during non-operation is properly regulated. With compliance of these AQ COCs the project remains in compliance with all
AQ 1-6	Operate/maintain on-site meteorological station	
AQ 1-7	Geysers' Air Monitoring Program (GAMP) participation	
AQ 1-8	Maintain all Authorities to Construct (ATCs) and Permits to Operate	

	(PTOs)	applicable laws, ordinances, regulations, and standards (LORS) and ensures no significant direct or cumulative impact to the environment will occur.
AC21-5	Maintain immediate and safe facility access for regulatory agency inspection, record review, sampling and testing.	Staff has reviewed all BRP AQ COCs and recommends that these COCs are required during BRP's non-operational status.
AC22-4		
AC24-6		
AC25-6		
AC26-6		
COC #	COC Summary: Cultural Resources	Comments
4-5	Existing fence maintenance	Staff has reviewed all BRP Cultural Resource COCs and recommends that this COC is required during BRP's non-operational status.
COC #	COC Summary: Biological Resources	Comments
5-1f	Annual Erosion Control Report	Staff has reviewed all BRP Biological Resource COCs and recommends that these COCs are required during BRP's non-operational status.
5-2	Decommissioning Plan	
5-3a	Boron Drift/Leaf Tissue Monitoring	
5-3b	Surface Water Sampling	
5-3c	Groundwater Sampling	
5-3d	Nest box and Wildlife Water Basin Maintenance	
5-3h	Erosion Monitoring	
5-3i	Biological Resources Mitigation and Monitoring Status Report	
5-3j	Ineffective Mitigation Determination and Response	

COC #	COC Summary: Water Resources	Comments
6-1	Notification of New Surface Water Utilization	Staff has reviewed all BRP Water Resource COCs and recommends that these COCs are required during BRP's non-operational status.
6-2	Spill Contingency and Containment Plan	
6-3	Impermeable spill collection-containment system	
6-4	Domestic Waste Water and Control Systems Maintenance	
6-5	Quarterly recordation of onsite well water pumping volume	
6-6	Storm water discharge	
COC #	COC Summary: Soils	Comments
8-4	Decommissioning Site Restoration Plan	Staff has reviewed all BRP Soil COCs and recommends that this COC is required during BRP's non-operational status.
COC #	COC Summary: Civil Engineering	Comments
9-5	Site Reclamation Plan	Staff has reviewed all BRP Civil Engineering COCs and recommends that this COC is required during BRP's non-operational status.
COC #	COC Summary: Solid Waste Management	Comments
11-7	Impending Waste Management-related Enforcement Action Notification	Staff has reviewed all BRP Solid Waste Management COCs and approves Calpine's recommendation that these COCs are required during BRP's non-operational status.
11-8	Cooling Tower Sludge Testing and Reporting	

COC #	COC Summary: Safety	Comments
12-8	Accident Prevention Program Compliance	Staff has reviewed all BRP Safety COCs and approves Calpine's recommendation that these COCs are required during BRP's non-operational status.
12-9	California Department of Occupational Safety and health Administration (Cal/DOSHA) on-site safety inspections	
12-10	Non-essential chemicals, solvents and lubricant removal	
COC #	COC Summary: Transmission Line Safety & Nuisance (TLSN)	Comments
13-2	Transmission line code maintenance	Staff has reviewed all BRP TLSN COCs and recommends that this COC is required during BRP's non-operational status.
COC #	COC Summary: Noise	Comments
16-1	Compliance with Lake County's noise ordinance compliance and complaint investigation	Staff has reviewed all BRP Noise COCs and recommends that this COC is required during BRP's non-operational status.

BRP 2022 Compliance Snapshot

	Due Date											
	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Lake County Air Quality Management District												
Annual Throughput Report										31		
ATC & PTO Renewal										31		
Quarterly Power Plant Report		15				30			30		30	
Serpentine Dust Control Plan Update											30	
GAMP Meeting			X			X			X			X
California Air Resources Board (CARB)												
Greenhouse Gas Emissions Report (GHGRP)				10								
DOORS Report (Diesel Fleet Emissions - ROAR)			1									
SF6 Facility Report			30									
California Geologic Energy Management Division (CalGEM)- ex CDGGR												
Production Report	31	28	31	30	31	30	31	31	30	31	30	31
Injection Well MIT (2-Year)											15	
Annual Well Assessment			31					15				
Central Valley Regional Water Quality Control Board												
Semi-Annual Injectate Report	X						X					
Annual Injectate Sampling												X
Lake County Community Development												
Emergency Response Contingency Plan Update (Internal Doc)	15						15					
Lake County Environmental Health												
Site Inspection (3-Year)(2022)						X						
AB2185 Hazardous Materials Business Plan - Chemical Inventory Update						30						31
CAL FIRE Hazardous Materials Storage Update & Permit Renewal						30						
Lake County Unified Hazardous Materials/Waste Permit Renewal	31											
CA BOE Hazardous Waste Generation Annual Final-Fee		28										
CA BOE Occupational Lead Poisoning Prevention Fee		28										
CA BOE Waste Manifest Verification & Annual Pre-Payment								31				
Hazardous Waste Management Plan (4-Y)												
California Energy Commission												
Annual Compliance Report				X								
Energy Facility Compliance Annual Fee						30						
1304 Generation & Sales Report	31			30			31			31		
Vegetational Sampling				X								
Soil Sampling											X	
Erosion Control Inspection				X						X		
Cooling Tower Bacteria Sampling (Legionella - When Operating)				X	X	X	X	X	X			
SW & GW Sampling	X			X		X	X			X		X
Department of Energy												
EIA 860 Report		28										
EIA 906 Report	NA											
EIA 923 Report			25									
DOSH												
Pressure Vessel & Propane Tank Permit Renewal (2022)											26	
FCC												
Radio License Renewal (10-Year)(2026)			14									
OSHA												
300 Recordable Incident Log (When Operating)	31											
Bridge Crane Load Test (Before Use)										30		
CAISO												
Generator Model Data (if applicable)				29								
CALFIRE												
Wildland Fire Operating Plan (reviewed annually or as needed)				30								



Account Details

Print

Account

Enter or select account

Balances

Opening Day Balance	64,741.27 USD	As of 12/06/2022
Available Balance	64,741.27 USD	
Interest Earned This Period	0.00 USD	
Interest Paid Year to Date	0.00 USD	

Account Activity

Filters Applied

Withdrawals/Debits only; Custom Date Range; 11/10/2022 - 11/10/2022

1 to 2
of 2

Date	Description	Amount USD
11/10/2022	CHECK # 8863	(64,743.78)
11/10/2022	Bill.com Payables 016JLTHOT2FTHJU DiDrill Survey Services. Inc. Bill.com 016JLTHOT21204895317 016JLTHOT2FTHJU 0R00000091003655296683	(25,581.44)

Download

Pending transactions may not be included in Available Balance.
If transactions for the entire date range selected do not appear, please further expand date range to see all transactions.



2021 CEC ANNUAL COMPLIANCE REPORT

BOTTLE ROCK POWER

Appendix 2

***Current Year LCAQMD Authorities to Construct and
Permits to Operate***

GAMP Participation – Proof of Payment



PERMIT TO OPERATE

Lake County Air Quality Management District

2617 S. Main Street, Lakeport, CA 95453 (707) 263-7000, Fax (707) 263-0421

Permit # P/O 2010-09

By: Douglas G. Gearhart
Douglas G. Gearhart, APCO

Type of Issuance: Renewal

Issuance Date: 10/31/2020 Valid through: 10/31/2021 Category: VIIb

Operations under this permit must be conducted in compliance with all specifications and data included with the application under which this permit was issued. Equipment must be properly maintained and kept in good condition at all times. Post this permit or a facsimile (with conditions) in a conspicuous location on or near the equipment.

Contact: Ms. Alice Bray
Owner: Bottle Rock Power, LLC
Mailing: 4010 Stone Way N, Suite 400
Address: Seattle, WA 98103

Facility: Bottle Rock Power Plant
Location: 7557 High Valley Rd., Cobb, CA.
Sec 5, T11N, R8W, MDB&M Lake County
Francisco/Coleman Leasehold

Name and Equipment Description: Bottle Rock Power Plant

One (1) fifty-five (55) megawatt geothermal power plant with abatement equipment installed and operated as described in conditions attached to the Modified Determination of Compliance dated February 22, 1982. Two (2) mechanical vacuum pumps of 50% capacity to the surface condenser non-condensable gas removal systems. Equipment piping and valves on AECS for Stretford Delay Tank skimmer pipe and Oxidizer Tank air spargers. Up to two (2) mercury scrubbing/absorption columns vessels with activated carbon media, associated piping and valves. Condensate H₂S abatement system (pumps, piping, & valving) including condensate line reroute valving and piping to cooling tower basin; a condensate sparging system in the cooling tower basin; position and/or orientation changes of the distribution header to increase contact time and efficiency, and use of Iron Chelate (Fe•HEDTA) catalyst. Distributed Control System, incorporating a central control system for the steamfield, power plant, and abatement systems with an Allen Bradley Control Logix automated processor.

Permit Conditions

Condition 1: Emissions

- A. The emissions limitations contained below shall apply during normal power plant operation, outages, and/or curtailments. All equipment shall be regularly maintained in good working order and operated in a manner to prevent or minimize air emissions.
- B. Hydrogen sulfide (H₂S) emissions from the Bottle Rock Power Plant shall be limited to a maximum of five (5) pounds per hour during power plant generation and all outages. All untreated steam or condensate shall be returned to a treatment or re-injection point to ensure this level of emissions is maintained.
- C. The H₂S content in the sweet gas from the Stretford shall not exceed 10ppmv, prior to dilution in the cooling tower.
- D. The H₂S concentration from the gland Steam Seal System vent shall not exceed 250 ppmw, and the H₂S emission rate shall not exceed 0.1 lbs/hr.
- E. Upon failure of the AECS, Bottle Rock Power, LLC (BRP) shall curtail operations to a level necessary to comply with the five (5) lbs/hr H₂S emissions limitation.
- F. In the event of generalized atmospheric conditions or localized dangerous contamination of such a nature as to constitute an emergency creating a danger to the health and welfare of the citizens of Lake County, the Air Pollution Control Officer (APCO) will take immediate action by requiring BRP to reduce H₂S or other emissions, or to discontinue emissions entirely.
- G. The off-gas vent to the atmosphere shall not be utilized at any time. The turbine by-pass, mechanical vacuum pumps, or other Lake County Air Quality Management District (LCAQMD) approved method shall be used to avoid direct venting into the atmosphere of undiluted non-condensables. The LCAQMD shall be notified when cold start-ups in excess of five (5) lbs H₂S/hr are to occur and may cancel such activity if deemed necessary.
- H. The access road from Bottle Rock Road to the power plant shall be paved to ensure that the generation of fugitive particulate matter is minimized. This shall apply to the primary access roads, should the primary access routes change.
- I. The permit holder shall properly install and maintain a properly sized, winterized condensate (cooling tower working water, condensate reroute valving and piping) H₂S abatement system modification incorporating the availability of an iron chelate (Fe•HEDTA) catalyst, hydrogen peroxide, and other additives as approved by the APCO, to achieve an overall emissions rate specified in this permit.

Condition 2: Administrative

- A. Bottle Rock Power (BRP) shall maintain and operate the power plant, Air Emissions Control System (AECS), and associated ancillary equipment as described in submitted specifications and drawings and subsequent permit modifications in accordance with good operating practices and procedures to meet the emissions limit in Condition 1. The power plant and abatement system components shall be adequately maintained and winterized.
- B. The AECS system shall consist of: A) A surface condenser to facilitate the partitioning of H₂S into the non condensable gas phase; B) A Stretford Abatement System (SAS) as modified to include a 10 inch diameter skimming pipe on the delay tank and two oxidizer tank air spargers and with the ability to return the H₂S gas treatment components of the AECS operation to the pre-modification operation.; C) Secondary condensate treatment which includes iron chelate and/or other approved secondary abatement chemical, and reaction time to ensure the power plant will comply with the emission limitation specified in Condition #1; D) A turbine by-pass system sufficiently sized to accept 100% of full steam flow during generating outages so that the power plant AECS can be utilized to treat steam normally stacked during the outage; E) If a solids removal system is necessary as a result of solids formation in the condensate, such facility shall be incorporated into the system; F) In the event of generation loss, an alternate source of power to enable continued use of the AECS specified above shall be available; and G) A properly permitted, compliant stand by generator or alternate power supply capable of sustaining station power and the Emergency Stacking System shall be available for use in case of concurrent transmission line and generator failure.
- C. The major components of the AECS, Stretford, Turbine by-pass, and condensate abatement system shall have a 99% operating availability excluding scheduled maintenance on these individual major components.
- D. BRP shall maintain alarms and switches on the following units to ensure immediate corrective action is initiated to prevent outages and potential stacking: **Turbine Generator Unit** – 1) Excessive vibration switch, alarm and trip; 2) Lateral motion switch on the turbine shaft, alarm and trip; 3) High lube oil temperature switch, alarm and trip; 4) Low lube oil pressure switch with indicating light in control room; **Main Lube Oil Reservoir low level, alarm** – 1) Over-speed switch, alarm and trip; 2) High hydrogen gas temperature and low purity hydrogen alarm and trip; 3) Seal oil level switch and alarm; 4) Differential pressure switch to prevent low differential pressure between the seal oil and hydrogen pressure, alarm and trip; 5) Generator moisture detector and alarm; 6) Vacuum switch to prevent low vacuum in the seal oil detaining tank, alarm and trip; 7) Turbine bearing metal temperature alarm and trip; **Condensers** – 1) Pressure switch to prevent condenser pressures from exceeding design levels, alarm and trip; 2) Condensate level switches to start and stop pump, prevent excessively high condensate levels in hot well; 3) High or low condensate levels alarms; **Cooling Towers** – 1) Float indicators to indicate levels and associated low, low-low, high, and high-high alarms; 2) Vibration switches and alarms on each cooling tower fan. **Electrical System** – 1) Generator differential current trip and alarm; 2) Generator over-current trip and alarm; 3) Generator ground fault trip and alarm; 4) Generator anti-motoring trip and alarm; 5) Generator field ground trip and alarm; 6) Generator stator over temperature alarm and trip; 7) Loss of excitation trip and alarm; 8) System negative phase sequence trip and alarm; 9) Transformer differential current trip and alarm; 10) Transformer over-current trip and alarm; 11) Transformer ground fault trip

(Conditions 2 through 6 are continued on the back of this card)

THIS PERMIT BECOMES VOID UPON CHANGE OF OWNERSHIP OR LOCATION

This permit does not authorize the emission of air contaminants in excess of those allowed by the California Health and Safety Code or the Regulations of the Lake County Air Quality Management District. This permit cannot be considered permission to violate existing laws, ordinances, regulations, or statutes of other government agencies. The provisions of this Permit are severable. If any provision of this Permit is held invalid, the remainder of this Permit shall not be affected thereby.



AUTHORITY TO CONSTRUCT

Lake County Air Quality Management District

2617 S. Main Street, Lakeport, CA 95453 (707) 263-7000, Fax (707) 263-0421

Permit # A/C 2006-11

By: Douglas G. Gearhart
Douglas G. Gearhart, APCO

Type of Issuance: Renewal Issuance Date: 10/31/2020 Valid through: 10/31/2021 Category: IV

Operations under this permit must be conducted in compliance with all specifications and data included with the application under which this permit was issued. Equipment must be properly maintained and kept in good condition at all times. Post this permit or a facsimile (with conditions) in a conspicuous location on or near the equipment.

Contact: Ms. Alice Bray
Owner: Bottle Rock Power, LLC
Mailing: 4010 Stone Way N, Suite 400
Address: Seattle, WA 98103

Facility: Coleman Padsite
Location: 600m N of S, 320m E of W, Section 5, T11N, R8W, MDB&M, Lake County
Coleman Pad, Bottle Rock / Francisco
Leasehold, Cobb Valley, CA

Name and Equipment Description: Coleman 1A-5 Re-Drill

Geothermal drilling rig and accessories (NCPA Rig #1), Four electrical generators (CAT D-398TA 750 HP diesel engines PERP Registered), three air compressors (Cummins QSK19-C700 700 HP turbocharged diesel powered air compressors), one down hole misting pump; hydrogen sulfide abatement system utilizing high pressure injection of NaOH and H₂O₂; and particulate control equipment consisting of misting down hole, constricting and non constricting venturi contactors, low pressure water spray, expanding blooie line, properly sized, smoothed, tangential wet cyclone, properly designed drop or hopper, water treatment and management systems, necessary metering and measuring devices and associated equipment.

Permit Conditions

Condition 1: Emissions

- A. Bottle Rock Power, LLC (BRP) shall limit hydrogen sulfide (H₂S) emissions during drilling, clean out, and testing to no more than five (5) pounds of H₂S per hour and no more than twenty-four (24) pounds per day during all other phases of this project. During verifiable breakdown and for any hot-liner runs, Rule 510 and procedures shall apply. In the event of atmospheric conditions (e.g., drainage, limited mixing, fumigation, downwash, etc.) that result in complaints and concern in receptor areas from high levels of H₂S, BRP agrees to reduce the H₂S emission limit to two (2) pounds of H₂S using abatement plan at the request of the Air Pollution Control Officer (APCO). Certain exceptions to the H₂S emission limitations may be allowed by the APCO, in writing, for resource testing if such tests are 12 hours or less in duration and coincide with acceptable meteorological conditions verified by the APCO to ensure good dispersion.
- B. If excessively high H₂S levels are encountered during drilling, BRP will either: 1) Place into operation additional H₂S abatement capacity, or 2) Cease operation and close in the well according to appropriate standards of operation. For the purposes of this permit, excessively high levels of H₂S means abated emissions greater than five (5) pounds of H₂S per hour or abated emission levels in excess of 500 ppmv.
- C. Visible emissions shall not exceed the values listed below for more than three (3) minutes in any one (1) hour: • Ringelmann 0.5 (10% opacity) for detached plume at the cyclone; • Ringelmann 0.5 (10% opacity) for combustion emissions of engine exhaust; and • Ringelmann 1 (20% opacity) for road and pad dust emissions.
- D. On commencement of air drilling in significant serpentine, the well logger shall obtain bulk samples that shall be analyzed for asbestos content using TEM, SEM or PLM (California Air Resources Board [ARB] Method 435 Procedures). For the purpose of defining a significant serpentine deposit during geothermal air drilling: "Significant Serpentine" shall mean; drill cutting samples from two consecutive ten-foot interval-drilling sections identified as having 10% or greater serpentine or other asbestos containing ore. The Lake County Air Quality Management District (LCAQMD) shall be promptly notified by phone at 263-7000, provided samples of the drilled material, and unless otherwise agreed upon in writing, notified of the bulk asbestos analysis results within ten working days of sampling.
- E. During drilling in significant serpentine visible emissions shall not exceed Ringelmann 0.25 (5% opacity) for detached plume at the cyclone. BRP shall: 1) Increase down hole misting; 2) Increase water loading at the venturi; 3) Reducing the drilling rate; 4) Use wetting agents; and/or 5) Implement additional solids filtration of working water. Such additional effort shall continue until drilling is clear of significant serpentine/asbestos.

Condition 2: Administrative

- A. This permit has been issued as a modification to include cleanout, forking or deepening of the well as described in the application and permit review. This permit does not establish a precedent for the issuance of additional permits.
- B. The submitted BRP (Tecton) H₂S abatement plan approved by the APCO shall be implemented and followed, and is incorporated herein by reference. Logbook entries shall be made a minimum of four (4) times daily while drilling on air or in steam.
- C. Diesel fuel utilized shall be California Low Sulfur Diesel containing less than 15ppmw sulfur.
- D. If a vapor dominated resource is encountered and it is determined that emissions cannot be maintained pursuant to Parts A & B of LCAQMD Rule 421; or the APCO determines that the well on stand-by (bleed) status will violate the intent of LCAQMD Rule 602 or the associated steamfield permit, then BRP shall with approval of the APCO, install and utilize additional abatement equipment as necessary to bring emissions into compliance. This may include, but is not limited to, immediate conversion to an injector, gas capping, down-hole plugging, and/or the complete closing in of any well in violation of LCAQMD Rules and Regulations.
- E. BRP shall utilize the same particulate abatement system described in the permitting review(s) and includes the following configuration: 1) A non-constricting venturi in the smallest diameter portion of the blooie line (non-constricting venturi 12"-15") for use when flow of at least 20,000 lbs/hr air/steam and a converging venturi scrubber when drilling in less than 20,000 lbs/hr of steam, or when the pressure drop exceeds 4 PSI across the

(Conditions 2 through 6 are continued on the back of this card)

THIS PERMIT BECOMES VOID UPON CHANGE OF OWNERSHIP OR LOCATION

This permit does not authorize the emission of air contaminants in excess of those allowed by the California Health and Safety Code or the Regulations of the Lake County Air Quality Management District. This permit cannot be considered permission to violate existing laws, ordinances, regulations, or statutes of other government agencies. The provisions of this Permit are severable. If any provision of this Permit is held invalid, the remainder of this Permit shall not be affected thereby.



AUTHORITY TO CONSTRUCT

Lake County Air Quality Management District

2617 S. Main Street, Lakeport, CA 95453 (707) 263-7000, Fax (707) 263-0421

Permit # A/C 2006-05

By: Douglas Gearhart
Douglas G. Gearhart, APCO

Type of Issuance: Renewal Issuance Date: 10/31/2020 Valid through: 10/31/2021 Category: IV

Operations under this permit must be conducted in compliance with all specifications and data included with the application under which this permit was issued. Equipment must be properly maintained and kept in good condition at all times. Post this permit or a facsimile (with conditions) in a conspicuous location on or near the equipment.

Contact: Ms. Alice Bray
Owner: Bottle Rock Power, LLC
Mailing: 4010 Stone Way N, Suite 400
Address: Seattle, WA 98103

Facility: Coleman Padsite
Location: 600m N of S, 320m E of W, Section 5, T11N,
R8W, MDB&M, Lake County
Coleman Pad, Bottle Rock / Francisco
Leasehold, Cobb Valley, CA

Name and Equipment Description: Coleman 3-5 Re-Drill

Geothermal drilling rig and accessories (NCPA Rig #1), Four electrical generators (CAT D-398TA 750 HP diesel engines PERP Registered), three air compressors (Cummins QSK19-C700 700 HP turbocharged diesel powered air compressors), one down hole misting pump; hydrogen sulfide abatement system utilizing high pressure injection of NaOH and H₂O₂; and particulate control equipment consisting of misting down hole, constricting and non constricting venturi contactors, low pressure water spray, expanding blooie line, properly sized, smoothed, tangential wet cyclone, properly designed drop or hopper, water treatment and management systems, necessary metering and measuring devices and associated equipment.

Permit Conditions

Condition 1: Emissions

A. Bottle Rock Power, LLC (BRP) shall limit hydrogen sulfide (H₂S) emissions during drilling, clean out, and testing to no more than five (5) pounds of H₂S per hour and no more than twenty-four (24) pounds per day during all other phases of this project. During verifiable breakdown and for any hot-liner runs, Rule 510 and procedures shall apply. In the event of atmospheric conditions (e.g., drainage, limited mixing, fumigation, downwash, etc.) that result in complaints and concern in receptor areas from high levels of H₂S, BRP agrees to reduce the H₂S emission limit to two (2) pounds of H₂S using abatement plan at the request of the Air Pollution Control Officer (APCO). Certain exceptions to the H₂S emission limitations may be allowed by the APCO, in writing, for resource testing if such tests are 12 hours or less in duration and coincide with acceptable meteorological conditions verified by the APCO to ensure good dispersion.

B. If excessively high H₂S levels are encountered during drilling, BRP will either: 1) Place into operation additional H₂S abatement capacity, or 2) Cease operation and close in the well according to appropriate standards of operation. For the purposes of this permit, excessively high levels of H₂S means abated emissions greater than five (5) pounds of H₂S per hour or abated emission levels in excess of 500 ppmv.

C. Visible emissions shall not exceed the values listed below for more than three (3) minutes in any one (1) hour: • Ringelmann 0.5 (10% opacity) for detached plume at the cyclone; • Ringelmann 0.5 (10% opacity) for combustion emissions of engine exhaust; and • Ringelmann 1 (20% opacity) for road and pad dust emissions.

D. On commencement of air drilling in significant serpentine, the well logger shall obtain bulk samples that shall be analyzed for asbestos content using TEM, SEM or PLM (California Air Resources Board [ARB] Method 435 Procedures). For the purpose of defining a significant serpentine deposit during geothermal air drilling: "Significant Serpentine" shall mean; drill cutting samples from two consecutive ten-foot interval-drilling sections identified as having 10% or greater serpentine or other asbestos containing ore. The Lake County Air Quality Management District (LCAQMD) shall be promptly notified by phone at 263-7000, provided samples of the drilled material, and unless otherwise agreed upon in writing, notified of the bulk asbestos analysis results within ten working days of sampling.

E. During drilling in significant serpentine visible emissions shall not exceed Ringelmann 0.25 (5% opacity) for detached plume at the cyclone. BRP shall: 1) Increase down hole misting; 2) Increase water loading at the venturi; 3) Reducing the drilling rate; 4) Use wetting agents; and/or 5) Implement additional solids filtration of working water. Such additional effort shall continue until drilling is clear of significant serpentine/asbestos.

Condition 2: Administrative

A. This permit has been issued as a modification to include cleanout, forking or deepening of the well as described in the application and permit review. This permit does not establish a precedent for the issuance of additional permits.

B. The submitted BRP (Tecton) H₂S abatement plan approved by the APCO shall be implemented and followed, and is incorporated herein by reference. Logbook entries shall be made a minimum of four (4) times daily while drilling on air or in steam.

C. Diesel fuel utilized shall be California Low Sulfur Diesel containing less than 15ppmw sulfur.

D. If a vapor dominated resource is encountered and it is determined that emissions cannot be maintained pursuant to Parts A & B of LCAQMD Rule 421; or the APCO determines that the well on stand-by (bleed) status will violate the intent of LCAQMD Rule 602 or the associated steamfield permit, then BRP shall with approval of the APCO, install and utilize additional abatement equipment as necessary to bring emissions into compliance. This may include, but is not limited to, immediate conversion to an injector, gas capping, down-hole plugging, and/or the complete closing in of any well in violation of LCAQMD Rules and Regulations.

E. BRP shall utilize the same particulate abatement system described in the permitting review(s) and includes the following configuration: 1) A non-constricting venturi in the smallest diameter portion of the blooie line (non-constricting venturi 12"-15") for use when flow of at least 20,000 lbs/hr air/steam and a converging venturi scrubber when drilling in less than 20,000 lbs/hr of steam, or when the pressure drop exceeds 4 PSI across the

(Conditions 2 through 6 are continued on the back of this card)

THIS PERMIT BECOMES VOID UPON CHANGE OF OWNERSHIP OR LOCATION

This permit does not authorize the emission of air contaminants in excess of those allowed by the California Health and Safety Code or the Regulations of the Lake County Air Quality Management District. This permit cannot be considered permission to violate existing laws, ordinances, regulations, or statutes of other government agencies. The provisions of this Permit are severable. If any provision of this Permit is held invalid, the remainder of this Permit shall not be affected thereby.



PERMIT TO OPERATE

Lake County Air Quality Management District

2617 S. Main Street, Lakeport, CA 95453 (707) 263-7000, Fax (707) 263-0421

Permit # P/O 85-034A

By: Douglas G. Gearhart
Douglas G. Gearhart, APCO

Type of Issuance: Renewal

Issuance Date: 10/31/2020 Valid through: 10/31/2021 Category: IV

Operations under this permit must be conducted in compliance with all specifications and data included with the application under which this permit was issued. Equipment must be properly maintained and kept in good condition at all times. Post this permit or a facsimile (with conditions) in a conspicuous location on or near the equipment.

Contact: Ms. Alice Bray
Owner: Bottle Rock Power, LLC
Mailing: 4010 Stone Way N, Suite 400
Address: Seattle, WA 98103

Facility: Coleman Padsite
Location: 600m N of S, 320m E of W, Section 5, T11N,
R8W, MDB&M, Lake County
Coleman Pad, Bottle Rock / Francisco
Leasehold, Cobb Valley, CA

Name and Equipment Description: Coleman 4-5

One (1) geothermal production well, associated valving, condensate and rock removal (catcher), and bleed muffler servicing the Bottle Rock Geothermal Power Plant.

Permit Conditions

Condition 1 The herein permitted well shall be operated in compliance and consistent with the steam transmission and power plant Authority to Construct (A/C) and Permit to Operate (P/O) conditions where applicable. The herein permitted well shall be operated in compliance with all Lake County Air Quality Management District (LCAQMD), State, and Federal laws and regulations.

Condition 2 Bottle Rock Power, LLC (BRP) shall notify the LCAQMD at least twenty-four (24) hours prior to initiating the planned venting of any well or group of wells in the LCAQMD owned or operated by BRP in an amount in excess of either 3,000 lbs of steam per hour per well or 20,000 lbs of steam per hour total. Testing to characterize emissions may be required by the Air Pollution Control Officer (APCO) for significant well bleeds or vents. In the event source testing of any geothermal well is deemed necessary by the APCO, BRP will provide safe access and sampling ports.

Condition 3 BRP shall submit to the LCAQMD an application for, and receive, an A/C or modify permit prior to constructing, erecting, altering or replacing any equipment which may cause, potentially cause, reduce, control or eliminate the issuance of air contaminants. This does not include normal and routine maintenance nor well clean out and repairs. It does include deepening, altering or increasing the well bore size in a manner to constitute a modification of the source. BRP shall notify the LCAQMD in advance of, and receive approval for, any planned reworking/maintenance of any of the herein permitted production wells. Conditions for approval of such maintenance work will consider the level and duration of emissions, and the conditions incorporated in current BRP A/C permits and performance plans. BRP shall within thirty (30) days after the completion of re-drilling, reworking or flow testing submit to the LCAQMD the results of any routine or required chemical analysis and/or testing accomplished for the herein listed geothermal development wells that indicate emissions or potential emissions into the air.

(Conditions 4 through 12 are continued on the back of this card)

THIS PERMIT BECOMES VOID UPON CHANGE OF OWNERSHIP OR LOCATION

This permit does not authorize the emission of air contaminants in excess of those allowed by the California Health and Safety Code or the Regulations of the Lake County Air Quality Management District. This permit cannot be considered permission to violate existing laws, ordinances, regulations, or statutes of other government agencies. The provisions of this Permit are severable. If any provision of this Permit is held invalid, the remainder of this Permit shall not be affected thereby.



AUTHORITY TO CONSTRUCT

Lake County Air Quality Management District

2617 S. Main Street, Lakeport, CA 95453 (707) 263-7000, Fax (707) 263-0421

Permit # A/C 2006-06

By: Douglas Gearhart
Douglas G. Gearhart, APCO

Type of Issuance: Renewal Issuance Date: 10/31/2020 Valid through: 10/31/2021 Category: IV

Operations under this permit must be conducted in compliance with all specifications and data included with the application under which this permit was issued. Equipment must be properly maintained and kept in good condition at all times. Post this permit or a facsimile (with conditions) in a conspicuous location on or near the equipment.

Contact:	Ms. Alice Bray	Facility:	Coleman Padsite
Owner:	Bottle Rock Power, LLC	Location:	600m N of S, 320m E of W, Section 5, T11N,
Mailing:	4010 Stone Way N, Suite 400		R8W, MDB&M, Lake County
Address:	Seattle, WA 98103		Coleman Pad, Bottle Rock / Francisco
			Leasehold, Cobb Valley, CA

Name and Equipment Description: Coleman 5-5 Re-Drill

Geothermal drilling rig and accessories (NCPA Rig #1), Four electrical generators (CAT D-398TA 750 HP diesel engines PERP Registered), three air compressors (Cummins QSK19-C700 700 HP turbocharged diesel powered air compressors), one down hole misting pump; hydrogen sulfide abatement system utilizing high pressure injection of NaOH and H₂O₂; and particulate control equipment consisting of misting down hole, constricting and non constricting venturi contactors, low pressure water spray, expanding blooie line, properly sized, smoothed, tangential wet cyclone, properly designed drop or hopper, water treatment and management systems, necessary metering and measuring devices and associated equipment.

Permit Conditions

Condition 1: Emissions

- A. Bottle Rock Power, LLC (BRP) shall limit hydrogen sulfide (H₂S) emissions during drilling, clean out, and testing to no more than five (5) pounds of H₂S per hour and no more than twenty-four (24) pounds per day during all other phases of this project. During verifiable breakdown and for any hot-liner runs, Rule 510 and procedures shall apply. In the event of atmospheric conditions (e.g., drainage, limited mixing, fumigation, downwash, etc.) that result in complaints and concern in receptor areas from high levels of H₂S, BRP agrees to reduce the H₂S emission limit to two (2) pounds of H₂S using abatement plan at the request of the Air Pollution Control Officer (APCO). Certain exceptions to the H₂S emission limitations may be allowed by the APCO, in writing, for resource testing if such tests are 12 hours or less in duration and coincide with acceptable meteorological conditions verified by the APCO to ensure good dispersion.
- B. If excessively high H₂S levels are encountered during drilling, BRP will either: 1) Place into operation additional H₂S abatement capacity, or 2) Cease operation and close in the well according to appropriate standards of operation. For the purposes of this permit, excessively high levels of H₂S means abated emissions greater than five (5) pounds of H₂S per hour or abated emission levels in excess of 500 ppmv.
- C. Visible emissions shall not exceed the values listed below for more than three (3) minutes in any one (1) hour: • Ringelmann 0.5 (10% opacity) for detached plume at the cyclone; • Ringelmann 0.5 (10% opacity) for combustion emissions of engine exhaust; and • Ringelmann 1 (20% opacity) for road and pad dust emissions.
- D. On commencement of air drilling in significant serpentine, the well logger shall obtain bulk samples that shall be analyzed for asbestos content using TEM, SEM or PLM (California Air Resources Board [ARB] Method 435 Procedures). For the purpose of defining a significant serpentine deposit during geothermal air drilling: "Significant Serpentine" shall mean; drill cutting samples from two consecutive ten-foot interval-drilling sections identified as having 10% or greater serpentine or other asbestos containing ore. The Lake County Air Quality Management District (LCAQMD) shall be promptly notified by phone at 263-7000, provided samples of the drilled material, and unless otherwise agreed upon in writing, notified of the bulk asbestos analysis results within ten working days of sampling.
- E. During drilling in significant serpentine visible emissions shall not exceed Ringelmann 0.25 (5% opacity) for detached plume at the cyclone. BRP shall: 1) Increase down hole misting; 2) Increase water loading at the venturi; 3) Reducing the drilling rate; 4) Use wetting agents; and/or 5) Implement additional solids filtration of working water. Such additional effort shall continue until drilling is clear of significant serpentine/asbestos.

Condition 2: Administrative

- A. This permit has been issued as a modification to include cleanout, forking or deepening of the well as described in the application and permit review. This permit does not establish a precedent for the issuance of additional permits.
- B. The submitted BRP (Tecton) H₂S abatement plan approved by the APCO shall be implemented and followed, and is incorporated herein by reference. Logbook entries shall be made a minimum of four (4) times daily while drilling on air or in steam.
- C. Diesel fuel utilized shall be California Low Sulfur Diesel containing less than 15ppmw sulfur.
- D. If a vapor dominated resource is encountered and it is determined that emissions cannot be maintained pursuant to Parts A & B of LCAQMD Rule 421; or the APCO determines that the well on stand-by (bleed) status will violate the intent of LCAQMD Rule 602 or the associated steamfield permit, then BRP shall with approval of the APCO, install and utilize additional abatement equipment as necessary to bring emissions into compliance. This may include, but is not limited to, immediate conversion to an injector, gas capping, down-hole plugging, and/or the complete closing in of any well in violation of LCAQMD Rules and Regulations.
- E. BRP shall utilize the same particulate abatement system described in the permitting review(s) and includes the following configuration: 1) A non-constricting venturi in the smallest diameter portion of the blooie line (non-constricting venturi 12"-15") for use when flow of at least 20,000 lbs/hr

(Conditions 2 through 6 are continued on the back of this card)

THIS PERMIT BECOMES VOID UPON CHANGE OF OWNERSHIP OR LOCATION

This permit does not authorize the emission of air contaminants in excess of those allowed by the California Health and Safety Code or the Regulations of the Lake County Air Quality Management District. This permit cannot be considered permission to violate existing laws, ordinances, regulations, or statutes of other government agencies. The provisions of this Permit are severable. If any provision of this Permit is held invalid, the remainder of this Permit shall not be affected thereby.



PERMIT TO OPERATE

Lake County Air Quality Management District

2617 S. Main Street, Lakeport, CA 95453 (707) 263-7000, Fax (707) 263-0421

Permit # P/O 2014-10

By: Douglas Gearhart
Douglas G. Gearhart, APCO

Type of Issuance: Renewal Issuance Date: 10/31/2020 Valid through: 10/31/2021 Category: IV

Operations under this permit must be conducted in compliance with all specifications and data included with the application under which this permit was issued. Equipment must be properly maintained and kept in good condition at all times. Post this permit or a facsimile (with conditions) in a conspicuous location on or near the equipment.

Contact:	Ms. Alice Bray	Facility:	Coleman Padsite
Owner:	Bottle Rock Power, LLC	Location:	600m N of S, 320m E of W, Section 5, T11N,
Mailing	4010 Stone Way N, Suite 400		R8W, MDB&M, Lake County
Address:	Seattle, WA 98103		Coleman Pad, Bottle Rock / Francisco
			Leasehold, Cobb Valley, CA

Name and Equipment Description: Coleman 6-5

One (1) geothermal production/injection well, associated valving, condensate and rock removal (catcher), and bleed muffler servicing the Bottle Rock Geothermal Power Plant. One (1) geothermal production well condensate collection piping system constructed of: 20' x 36" slotted and solid pipe, with cone reducer, one (1) 12" cleanout, and two (2) knock-out pots.

Permit Conditions

Condition 1: Emissions

A. Bottle Rock Power, LLC (BRP) shall limit Hydrogen Sulfide (H₂S) emissions during drilling, clean out, and testing to no more than five (5) pounds of H₂S per hour and no more than twenty-four (24) pounds per day during all other phases of this project. During verified breakdown and for hot-liner installations, Lake County Air Quality Management District (LCAQMD) Rule 510 and procedures shall apply. In the event of atmospheric conditions (e.g., drainage, limited mixing, fumigation, downwash, etc.) that result in complaints and concern in receptor areas from high levels of H₂S, BRP agrees to reduce the H₂S emission limit to two (2) pounds or less of H₂S per hour consistent with the BRP H₂S Abatement Plan, at the request of the Air Pollution Control Officer (APCO). Certain exceptions to the H₂S emission limitations may be allowed by the APCO, in writing, for resource testing if such tests are 12 hours or less in duration and coincide with acceptable meteorological conditions verified by the APCO to ensure good dispersion.

B. If excessively high H₂S levels are encountered during drilling, BRP will either: a) Place into operation additional H₂S abatement capacity, or b) Cease operation and close in the well according to appropriate standards of operation. For the purposes of this permit, excessively high levels of H₂S means abated emissions greater than five (5) pounds of H₂S per hour or abated emission levels in excess of 500 ppm volume.

C. Visible emissions shall not exceed the values listed below for more than three (3) minutes in any one (1) hour: • Ringelmann 0.5 (10% opacity) for detached plume at the cyclone; • Ringelmann 0.5 (10% opacity) for combustion emissions engine exhaust; and • Ringelmann 1 (20% opacity) for road and pad dust emissions.

D. On commencement of air drilling in significant serpentine or upon experiencing red/pink plume exiting the cyclone, the well logger shall immediately obtain bulk samples of the drilled material and log the event in the abatement logbook, and shall be analyzed for asbestos content using TEM, SEM or PLM (California Air Resources Board [ARB] Method 435 Procedures). "Experiencing a pink/red plume" shall mean a plume of greater than 5% opacity lasting for 30 or more seconds. For the purpose of defining a significant serpentine deposit during geothermal air drilling: "Significant Serpentine" shall mean; drill cutting samples from two consecutive ten-foot interval-drilling sections identified as having 10% or greater serpentine content. The LCAQMD shall be promptly notified by phone at 263-7000, provided a portion of the divided bulk samples of the drilled material, and unless otherwise agreed upon in writing, notified of the bulk asbestos analysis results within ten (10) working days of sampling. Bulk Samples collected upon experiencing a pink/red plume shall be promptly analyzed by XRF, or other acceptable means, to include at a minimum arsenic, chrome, nickel and cadmium. BRP shall, to the extent practical attempt to collect a sample of the particulate from the pink/red plume, and/or assist the LCAQMD in such an attempt, for analysis as described.

E. During drilling in significant serpentine, or while experiencing a pink/red plume, visible emissions shall not exceed Ringelmann 0.25 (5% opacity) for detached plume at the cyclone. BRP shall: 1) Increase down hole misting; 2) Increase water loading at the venturi; 3) Reducing the drilling rate; 4) Use wetting agents; and/or 5) Implement additional solids filtration of working water. Such additional effort shall continue until drilling is clear of significant serpentine or drilling conditions contributing to the formation of pink/red plume.

Condition 2: Administrative

A. This permit has been issued for the geothermal well to function in either injection or production mode. The well is constructed at a total depth of 10,700 feet and includes a well bore, well head, valving, piping, flanges, geothermal fluid transmission line header connections, side leg kick-out, two part slotted liner, and associated corrosion mitigation injection equipment. This permit allows drilling for well maintenance; significant drilling and work overs may require an Authority to Construct permit for the modification. This permit does not establish a precedent for the issuance of additional permits.

B. The submitted BRP H₂S abatement plan approved by the APCO or subsequent approved revision, shall be implemented and followed, and is incorporated herein by reference. Logbook entries shall be made a minimum of four (4) times daily.

C. Diesel fuel utilized shall be California Low Sulfur Diesel containing less than 15 ppmw sulfur.

D. If a vapor dominated resource is encountered and it is determined that emissions cannot be maintained pursuant to Parts A & B of LCAQMD Rule 421; or the APCO

(Conditions 2 through 6 are continued on the back of this card)

THIS PERMIT BECOMES VOID UPON CHANGE OF OWNERSHIP OR LOCATION

This permit does not authorize the emission of air contaminants in excess of those allowed by the California Health and Safety Code or the Regulations of the Lake County Air Quality Management District. This permit cannot be considered permission to violate existing laws, ordinances, regulations, or statutes of other government agencies. The provisions of this Permit are severable. If any provision of this Permit is held invalid, the remainder of this Permit shall not be affected thereby.



AUTHORITY TO CONSTRUCT

Lake County Air Quality Management District

2617 S. Main Street, Lakeport, CA 95453 (707) 263-7000, Fax (707) 263-0421

Permit # A/C 2006-30

By: Douglas Gearhart
Douglas G. Gearhart, APCO

Type of Issuance: Renewal

Issuance Date: 10/31/2020 Valid through: 10/31/2021 Category: IV

Operations under this permit must be conducted in compliance with all specifications and data included with the application under which this permit was issued. Equipment must be properly maintained and kept in good condition at all times. Post this permit or a facsimile (with conditions) in a conspicuous location on or near the equipment.

Contact: Ms. Alice Bray
Owner: Bottle Rock Power, LLC
Mailing: 4010 Stone Way N, Suite 400
Address: Seattle, WA 98103

Facility: Coleman Padsite
Location: 600m N of S, 320m E of W, Section 5, T11N,
R8W, MDB&M, Lake County Coleman Pad,
Bottle Rock / Francisco Leasehold, Cobb Valley,
CA

Name and Equipment Description: Coleman 7-5

Geothermal drilling rig and accessories (NCPA Rig #1, equivalent or superior), four (4) electrical generators (CAT D-398TA 750 HP diesel engines PERP Registered), three (3) air compressors (Cummins QSK19-C700 700 HP turbocharged diesel powered air compressors), one (1) down hole misting pump; hydrogen sulfide abatement system utilizing high pressure injection of NaOH and H₂O₂; and particulate control equipment consisting of misting down hole, constricting and non constricting venturi contactors, low pressure water spray, expanding blooie line, properly sized, smoothed, tangential wet cyclone, properly designed drop or hopper, water treatment and management systems, necessary metering and measuring devices and associated equipment.

Permit Conditions

Condition 1: Emissions

- A. Bottle Rock Power, LLC (BRP) shall limit hydrogen sulfide (H₂S) emissions during drilling, clean out, and testing to no more than five (5) pounds of H₂S per hour and no more than twenty-four (24) pounds per day during all other phases of this project. During verifiable breakdown and for any hot-liner runs, Rule 510 and procedures shall apply. In the event of atmospheric conditions (e.g., drainage, limited mixing, fumigation, downwash, etc.) that result in complaints and concern in receptor areas from high levels of H₂S, BRP agrees to reduce the H₂S emission limit to two (2) pounds of H₂S per hour using the approved abatement plan at the request of the Air Pollution Control Officer (APCO). Certain exceptions to the H₂S emission limitations may be allowed by the APCO, in writing, for resource testing if such tests are 12 hours or less in duration and coincide with acceptable meteorological conditions verified by the APCO to ensure good dispersion.
- B. If excessively high H₂S levels are encountered during drilling, BRP will either: 1) Place into operation additional H₂S abatement capacity, or 2) Cease operation and close in the well according to appropriate standards of operation. For the purposes of this permit, excessively high levels of H₂S means abated emissions greater than five (5) pounds of H₂S per hour or abated emission levels in excess of 500 ppmv.
- C. Visible emissions shall not exceed the values listed below for more than three (3) minutes in any one (1) hour:
- Ringelmann 0.5 (10% opacity) for detached plume at the cyclone;
 - Ringelmann 0.5 (10% opacity) for combustion emissions of engine exhaust; and
 - Ringelmann 1 (20% opacity) for road and pad dust emissions.
- D. On commencement of air drilling in significant serpentine, the well logger shall obtain bulk samples that shall be analyzed for asbestos content using TEM, SEM or PLM (California Air Resources Board [ARB] Method 435 Procedures). For the purpose of defining a significant serpentine deposit during geothermal air drilling: "Significant Serpentine" shall mean; drill cutting samples from two consecutive ten-foot interval-drilling sections identified as having 10% or greater serpentine or other asbestos containing ore. The Lake County Air Quality Management District (LCAQMD) shall be promptly notified by phone at 263-7000, provided samples of the drilled material, and unless otherwise agreed upon in writing, notified of the bulk asbestos analysis results within ten working days of sampling.
- E. During drilling in significant serpentine visible emissions shall not exceed Ringelmann 0.25 (5% opacity) for detached plume at the cyclone. BRP shall: 1) Increase down hole misting; 2) Increase water loading at the venturi; 3) Reducing the drilling rate; 4) Use wetting agents; and/or 5) Implement additional solids filtration of working water. Such additional effort shall continue until drilling is clear of significant serpentine/asbestos.

Condition 2: Administrative

- A. This permit has been issued for the construction of a geothermal production well to include a fork leg from the main bore as described in the application and permit review. This permit does not establish a precedent for the issuance of additional permits.
- B. The submitted BRP (Tecton) H₂S abatement plan approved by the APCO shall be implemented and followed, and is incorporated herein by reference. Logbook entries shall be made a minimum of four (4) times daily while drilling on air or in steam.
- C. Diesel fuel utilized shall be California Low Sulfur Diesel containing less than 15ppmw sulfur.
- D. If a vapor dominated resource is encountered and it is determined that emissions cannot be maintained pursuant to Parts A & B of LCAQMD Rule 421; or the APCO determines that the well on stand-by (bleed) status will violate the intent of LCAQMD Rule 602 or the associated steamfield permit, then BRP shall with approval of the APCO, install and utilize additional abatement equipment as necessary to bring emissions into compliance. This may include, but is not limited to, immediate conversion to an injector, gas capping, down-hole plugging, and/or the complete closing in of any well in violation of LCAQMD Rules and Regulations.

(Conditions 2 through 6 are continued on the back of this card)

THIS PERMIT BECOMES VOID UPON CHANGE OF OWNERSHIP OR LOCATION

This permit does not authorize the emission of air contaminants in excess of those allowed by the California Health and Safety Code or the Regulations of the Lake County Air Quality Management District. This permit cannot be considered permission to violate existing laws, ordinances, regulations, or statutes of other government agencies. The provisions of this Permit are severable. If any provision of this Permit is held invalid, the remainder of this Permit shall not be affected thereby.



AUTHORITY TO CONSTRUCT

Lake County Air Quality Management District

2617 S. Main Street, Lakeport, CA 95453 (707) 263-7000, Fax (707) 263-0421

Permit # A/C 2006-31

By: Douglas Gearhart
Douglas G. Gearhart, APCO

Type of Issuance: Renewal Issuance Date: 10/31/2020 Valid through: 10/31/2021 Category: IV

Operations under this permit must be conducted in compliance with all specifications and data included with the application under which this permit was issued. Equipment must be properly maintained and kept in good condition at all times. Post this permit or a facsimile (with conditions) in a conspicuous location on or near the equipment.

Contact: Ms. Alice Bray
Owner: Bottle Rock Power, LLC
Mailing Address: 4010 Stone Way N, Suite 400
Seattle, WA 98103

Facility: Coleman Padsite
Location: 600m N of S, 320m E of W, Section 5, T11N,
R8W, MDB&M, Lake County Coleman Pad,
Bottle Rock / Francisco Leasehold, Cobb Valley,
CA

Name and Equipment Description: Coleman 8-5

Geothermal drilling rig and accessories (NCPA Rig #1, equivalent or superior), four (4) electrical generators (CAT D-398TA 750 HP diesel engines PERP Registered), three (3) air compressors (Cummins QSK19-C700 700 HP turbocharged diesel powered air compressors), one (1) down hole misting pump; hydrogen sulfide abatement system utilizing high pressure injection of NaOH and H₂O₂; and particulate control equipment consisting of misting down hole, constricting and non constricting venturi contactors, low pressure water spray, expanding blooie line, properly sized, smoothed, tangential wet cyclone, properly designed drop or hopper, water treatment and management systems, necessary metering and measuring devices and associated equipment.

Permit Conditions

Condition 1: Emissions

- A. Bottle Rock Power, LLC (BRP) shall limit hydrogen sulfide (H₂S) emissions during drilling, clean out, and testing to no more than five (5) pounds of H₂S per hour and no more than twenty-four (24) pounds per day during all other phases of this project. During verifiable breakdown and for any hot-liner runs, Rule 510 and procedures shall apply. In the event of atmospheric conditions (e.g., drainage, limited mixing, fumigation, downwash, etc.) that result in complaints and concern in receptor areas from high levels of H₂S, BRP agrees to reduce the H₂S emission limit to two (2) pounds of H₂S per hour using the approved abatement plan at the request of the Air Pollution Control Officer (APCO). Certain exceptions to the H₂S emission limitations may be allowed by the APCO, in writing, for resource testing if such tests are 12 hours or less in duration and coincide with acceptable meteorological conditions verified by the APCO to ensure good dispersion.
- B. If excessively high H₂S levels are encountered during drilling, BRP will either: 1) Place into operation additional H₂S abatement capacity, or 2) Cease operation and close in the well according to appropriate standards of operation. For the purposes of this permit, excessively high levels of H₂S means abated emissions greater than five (5) pounds of H₂S per hour or abated emission levels in excess of 500 ppmv.
- C. Visible emissions shall not exceed the values listed below for more than three (3) minutes in any one (1) hour:
- Ringelmann 0.5 (10% opacity) for detached plume at the cyclone;
 - Ringelmann 0.5 (10% opacity) for combustion emissions of engine exhaust; and
 - Ringelmann 1 (20% opacity) for road and pad dust emissions.
- D. On commencement of air drilling in significant serpentine, the well logger shall obtain bulk samples that shall be analyzed for asbestos content using TEM, SEM or PLM (California Air Resources Board [ARB] Method 435 Procedures). For the purpose of defining a significant serpentine deposit during geothermal air drilling: "Significant Serpentine" shall mean; drill cutting samples from two consecutive ten-foot interval-drilling sections identified as having 10% or greater serpentine or other asbestos containing ore. The Lake County Air Quality Management District (LCAQMD) shall be promptly notified by phone at 263-7000, provided samples of the drilled material, and unless otherwise agreed upon in writing, notified of the bulk asbestos analysis results within ten working days of sampling.
- E. During drilling in significant serpentine visible emissions shall not exceed Ringelmann 0.25 (5% opacity) for detached plume at the cyclone. BRP shall: 1) Increase down hole misting; 2) Increase water loading at the venturi; 3) Reducing the drilling rate; 4) Use wetting agents; and/or 5) Implement additional solids filtration of working water. Such additional effort shall continue until drilling is clear of significant serpentine/asbestos.

Condition 2: Administrative

- A. This permit has been issued for the construction of a geothermal production well to include a fork leg from the main bore as described in the application and permit review. This permit does not establish a precedent for the issuance of additional permits.
- B. The submitted BRP (Tecton) H₂S abatement plan approved by the APCO shall be implemented and followed, and is incorporated herein by reference. Logbook entries shall be made a minimum of four (4) times daily while drilling on air or in steam.
- C. Diesel fuel utilized shall be California Low Sulfur Diesel containing less than 15ppmw sulfur.
- D. If a vapor dominated resource is encountered and it is determined that emissions cannot be maintained pursuant to Parts A & B of LCAQMD Rule 421; or the APCO determines that the well on stand-by (bleed) status will violate the intent of LCAQMD Rule 602 or the associated steamfield permit, then BRP shall with approval of the APCO, install and utilize additional abatement equipment as necessary to bring emissions into compliance. This may include, but is not limited to, immediate conversion to an injector, gas capping, down-hole plugging, and/or the complete closing in of any well in violation of LCAQMD Rules and Regulations.

(Conditions 2 through 6 are continued on the back of this card)

THIS PERMIT BECOMES VOID UPON CHANGE OF OWNERSHIP OR LOCATION

This permit does not authorize the emission of air contaminants in excess of those allowed by the California Health and Safety Code or the Regulations of the Lake County Air Quality Management District. This permit cannot be considered permission to violate existing laws, ordinances, regulations, or statutes of other government agencies. The provisions of this Permit are severable. If any provision of this Permit is held invalid, the remainder of this Permit shall not be affected thereby.



PERMIT TO OPERATE

Lake County Air Quality Management District

2617 S. Main Street, Lakeport, CA 95453 (707) 263-7000, Fax (707) 263-0421

Permit # P/O 2014-07

By: Douglas Gearhart
Douglas G. Gearhart, APCO

Type of Issuance: Renewal Issuance Date: 10/31/2020 Valid through: 10/31/2021 Category: II

Operations under this permit must be conducted in compliance with all specifications and data included with the application under which this permit was issued. Equipment must be properly maintained and kept in good condition at all times. Post this permit or a facsimile (with conditions) in a conspicuous location on or near the equipment.

Contact: Ms. Alice Bray
Owner: Bottle Rock Power, LLC
Mailing: 4010 Stone Way N, Suite 400
Address: Seattle, WA 98103

Facility: Bottle Rock Power Plant
Location: 7557 High Valley Rd., Cobb, CA.
Sec 5, T11N, R8W, MDB&M Lake County
Francisco/Coleman Leasehold

Name and Equipment Description: Emergency Backup Diesel Generator and Propane Generator

One (1) Condec-Lima Electric Model AA90614DK generator set, powered by a 1982 model year 760hp Cummins VTA-1710-6-1 diesel engine (S/N 37106133) and one (1) Generac Model 0046742 generator set, powered by a 16hp Generac VII18 propane engine (S/N 4350062).

Permit Conditions

Condition 1: Emissions

A. All equipment shall be regularly maintained in good working order pursuant to manufacturer's guidelines and operated in a manner to prevent or minimize air emissions. The Lake County Air Quality Management District (LCAQMD) shall be notified pursuant to Rule 510, regarding equipment breakdown.

B. The total ROG, PM-10, SO_x or NO_x emission rate for this facility shall not exceed 25 tons per 12-month period. This emission rate determination shall be consistent with the methodology and assumptions used to evaluate the application under which this permit was issued.

C. Visible emissions shall not exceed Ringelmann 1 (20% opacity) from the diesel engine generator exhaust stack for more than three (3) minutes in any one (1) hour.

Condition 2: Administrative

A. This permit has been issued and is valid for emergency diesel engine generator use when neither house power nor commercial line power is available because of an emergency or line maintenance outage. Use of the generator for any other purpose will subject the source to NSR and reassessment under the Air Toxics Control Measure (ATCM) for Compression Ignition engines to include control equipment retrofit or other upgrades. The propane generator may be used for prime power when commercial line power is not available.

B. Testing and Maintenance operations are allowed for up to 20 hours per 12-month period for the diesel engine.

C. Diesel fuel utilized shall be California Low Sulfur Diesel containing less than 15ppmw sulfur.

(Conditions 2 through 6 are continued on the back of this card)

THIS PERMIT BECOMES VOID UPON CHANGE OF OWNERSHIP OR LOCATION

This permit does not authorize the emission of air contaminants in excess of those allowed by the California Health and Safety Code or the Regulations of the Lake County Air Quality Management District. This permit cannot be considered permission to violate existing laws, ordinances, regulations, or statutes of other government agencies. The provisions of this Permit are severable. If any provision of this Permit is held invalid, the remainder of this Permit shall not be affected thereby.



PERMIT TO OPERATE

Lake County Air Quality Management District

2617 S. Main Street, Lakeport, CA 95453 (707) 263-7000, Fax (707) 263-0421

Permit # P/O 2014-06

By: Douglas Gearhart
Douglas G. Gearhart, APCO

Type of Issuance: Renewal Issuance Date: 10/31/2020 Valid through: 10/31/2021 Category: II

Operations under this permit must be conducted in compliance with all specifications and data included with the application under which this permit was issued. Equipment must be properly maintained and kept in good condition at all times. Post this permit or a facsimile (with conditions) in a conspicuous location on or near the equipment.

Contact: Ms. Alice Bray
Owner: Bottle Rock Power, LLC
Mailing: 4010 Stone Way N, Suite 400
Address: Seattle, WA 98103

Facility: Bottle Rock Steamfield Office
Location: 7557 High Valley Rd.
Cobb, CA 95426

Name and Equipment Description: Emergency Backup Diesel Generators and Propane Generator

One (1) Condec generator set (S/N BC24958EG), powered by a 1982 model year 100.5 hp Deutz F6L413FR diesel engine (S/N 6710917), one (1) Air Diesel F-3592B generator set, powered by a 20 hp Deutz 2L912 diesel engine (S/N B22390FF) and one (1) Generac GH-410 (8 kW) generator set, powered by a 14.8 hp propane engine (S/N 6253552).

Permit Conditions

Condition 1: Emissions

A. All equipment shall be regularly maintained in good working order pursuant to manufacturer's guidelines and operated in a manner to prevent or minimize air emissions. The Lake County Management District (LCAQMD) shall be notified pursuant to Rule 510, regarding equipment breakdown.

B. The total ROG, PM-10, SO_x or NO_x emission rate for this facility shall not exceed 25 tons per 12-month period. This emission rate determination shall be consistent with the methodology and assumptions used to evaluate the application under which this permit was issued.

C. Visible emissions shall not exceed Ringelmann 1 (20% opacity) from the generator exhaust stack for more than three (3) minutes in any one (1) hour.

Condition 2: Administrative

A. This permit has been issued and is valid for emergency diesel engine generator use when neither house power nor commercial line power is available because of an emergency or line maintenance outage. Use of the generator for any other purpose will subject the source to NSR and reassessment under the Air Toxics Control Measure (ATCM) for Compression Ignition engines to include control equipment retrofit or other upgrades. The propane generator may be used for prime power when commercial line power is not available.

B. Testing and Maintenance operations are allowed for up to 20 hours per 12-month period per diesel engine.

C. Diesel fuel utilized shall be California Low Sulfur Diesel containing less than 15ppmw sulfur.

(Conditions 2 through 6 are continued on the back of this card)

THIS PERMIT BECOMES VOID UPON CHANGE OF OWNERSHIP OR LOCATION

This permit does not authorize the emission of air contaminants in excess of those allowed by the California Health and Safety Code or the Regulations of the Lake County Air Quality Management District. This permit cannot be considered permission to violate existing laws, ordinances, regulations, or statutes of other government agencies. The provisions of this Permit are severable. If any provision of this Permit is held invalid, the remainder of this Permit shall not be affected thereby.



PERMIT TO OPERATE

Lake County Air Quality Management District
2617 S. Main Street, Lakeport, CA 95453 (707) 263-7000, Fax (707) 263-0421

Permit # P/O 2014-08

By: Douglas Gearhart
Douglas G. Gearhart, APCO

Type of Issuance: Renewal Issuance Date: 10/31/2020 Valid through: 10/31/2021 Category: II

Operations under this permit must be conducted in compliance with all specifications and data included with the application under which this permit was issued. Equipment must be properly maintained and kept in good condition at all times. Post this permit or a facsimile (with conditions) in a conspicuous location on or near the equipment.

Contact: Ms. Alice Bray Owner: Bottle Rock Power, LLC Mailing Address: 4010 Stone Way N, Suite 400 Seattle, WA 98103	Facility: Coleman Padsite Location: 600m N of S, 320m E of W, Section 5, T11N, R8W, MDB&M, Lake County Coleman Pad, Bottle Rock / Francisco Leasehold, Cobb Valley, CA
--	---

Name and Equipment Description: Emergency Backup Propane Generator

One (1) Generac Guardian Model Generator, powered by a 32 HP, Generac 922cc V-Twin propane engine, S/N:5281627, Model Year 2008.

Permit Conditions

Condition 1: Emissions

- A. All equipment shall be regularly maintained in good working order, pursuant to manufacturer's guidelines, and operated in a manner to prevent or minimize air emissions.
- B. The total ROG, PM-10, SOx or NOx emission rate for this facility shall not exceed 25 tons per 12-month period.
- C. The Lake County Air Quality Management District (LCAQMD) shall be notified pursuant to Rule 510 regarding equipment breakdown.
- D. Visible emissions shall not exceed Ringelmann 1 (20% opacity) from the engine exhaust stack for more than three (3) minutes in any one (1) hour.

Condition 2: Administrative

- A. This permit has been issued and is valid for emergency generator use when commercial line power is not available because of an emergency or line maintenance outage. Load shedding for cost reduction is not allowed under this permit. Such anticipated use will subject the source to NSR and reassessment.
- B. Testing and maintenance operations are allowed for up to 50 hours per 12-month period.
- C. The generator shall be propane fueled only, conversion or replacement with diesel shall require reassessment and compliance with the Air Toxic Control Measure (ATCM) for Stationary Compression Ignition Engines.

(Conditions 2 through 6 are continued on the back of this card)

THIS PERMIT BECOMES VOID UPON CHANGE OF OWNERSHIP OR LOCATION

This permit does not authorize the emission of air contaminants in excess of those allowed by the California Health and Safety Code or the Regulations of the Lake County Air Quality Management District. This permit cannot be considered permission to violate existing laws, ordinances, regulations, or statutes of other government agencies. The provisions of this Permit are severable. If any provision of this Permit is held invalid, the remainder of this Permit shall not be affected thereby.



AUTHORITY TO CONSTRUCT

Lake County Air Quality Management District

2617 S. Main Street, Lakeport, CA 95453 (707) 263-7000, Fax (707) 263-0421

Permit # A/C 17-76-36A

By: Douglas Gearhart
Douglas G. Gearhart, APCO

Type of Issuance: Renewal Issuance Date: 10/31/2020 Valid through: 10/31/2021 Category: IV

Operations under this permit must be conducted in compliance with all specifications and data included with the application under which this permit was issued. Equipment must be properly maintained and kept in good condition at all times. Post this permit or a facsimile (with conditions) in a conspicuous location on or near the equipment.

Contact: Ms. Alice Bray
Owner: Bottle Rock Power, LLC
Mailing: 4010 Stone Way N, Suite 400
Address: Seattle, WA 98103

Facility: Francisco Padsite
Location: 400m S of N, 310m E of W, Sections 5, T11N,
R8W, MDB&M, Lake County
Francisco Pad, Francisco / Bottle Rock
Leasehold, Cobb Valley, CA

Name and Equipment Description: Francisco 1-5

One (1) geothermal production well, associated valving, condensate and rock removal (catcher) and bleed muffler servicing the Bottle Rock Geothermal Power Plant.

Permit Conditions

Condition 1 Bottle Rock Power, LLC (BRP) shall perform and forward to the Lake County Air Quality Management District (LCAQMD), the following characterization of hot water, steam, particulates and/or gases emanating from the subject well(s) within sixty (60) days after completion of the initial geothermal drilling and testing. If the well is abandoned, no analyses will be necessary.

STEAM CONDENSATE/TOTAL STEAM: Benzene, Ammonium (total)*, Arsenic*, Bicarbonate and Carbonate, Sulfates, Chlorides, Nitrates, Boron (total)*, Hydrogen Sulfide (H₂S) (total)*, Fluorides (total), Mercury (total), pH, Total Dissolved Solids, Total Suspended Solids, Percent Non-Condensables, and Steam Flow and Temperature*.

GAS PHASE: Benzene, Particulate in Steam (ug particulate/g of Steam, Arsenic, Lead, Cadmium, Total Sulfur, Boron), Ammonia, Mercury Vapor, Radon 222 and Daughters, Methane, Non-Methane Hydrocarbons, Carbon Dioxide, and NESHAPS pollutants as requested. Tests can be performed utilizing the bleed of the subject well(s) or during flow testing. Gas phase (non-condensables or steam diluted with air as appropriate to maintain gas phase and integrity of sample) tests are to be performed if wells are placed on long term standby bleed. The test protocol shall be submitted to the LCAQMD at least three (3) weeks before such sample collection and analytical testing is planned and shall be approved by the LCAQMD prior to actual source testing. If the well is produced immediately, the LCAQMD may delay required testing (specifically those items without an asterisk) until circumstances require a sustained bleed status of the well, this shall be at the LCAQMD's option and BRP's request.

Condition 2 BRP shall notify the LCAQMD at least twenty-four (24) hours prior to initiating the planned venting of the herein permitted well or any associated group of well(s) in the LCAQMD owned or operated by BRP.

Condition 3 In the event source testing of the herein permitted geothermal well is deemed necessary by the Air Pollution Control Officer (APCO), BRP will be available within ten (10) days after written notice to open said well for a 4-8 hour duration.

Condition 4 If chemical or particulate analysis performed as part of Condition 1 suggests the need for further study, including air dispersion analysis, BRP will assist, perform or finance such studies if deemed reasonable and necessary by the APCO.

Condition 5 If locks or unmanned gates are used to secure the project area, the LCAQMD or its representative, will be given keys or combinations and

(Conditions 5 through 19 are continued on the back of this card)

THIS PERMIT BECOMES VOID UPON CHANGE OF OWNERSHIP OR LOCATION

This permit does not authorize the emission of air contaminants in excess of those allowed by the California Health and Safety Code or the Regulations of the Lake County Air Quality Management District. This permit cannot be considered permission to violate existing laws, ordinances, regulations, or statutes of other government agencies. The provisions of this Permit are severable. If any provision of this Permit is held invalid, the remainder of this Permit shall not be affected thereby.



AUTHORITY TO CONSTRUCT

Lake County Air Quality Management District

2617 S. Main Street, Lakeport, CA 95453 (707) 263-7000, Fax (707) 263-0421

Permit # A/C 2006-07

By: Douglas Gearhart
Douglas G. Gearhart, APCO

Type of Issuance: Renewal

Issuance Date: 10/31/2020 Valid through: 10/31/2021 Category: IV

Operations under this permit must be conducted in compliance with all specifications and data included with the application under which this permit was issued. Equipment must be properly maintained and kept in good condition at all times. Post this permit or a facsimile (with conditions) in a conspicuous location on or near the equipment.

Contact: Ms. Alice Bray
Owner: Bottle Rock Power, LLC
Mailing: 4010 Stone Way N, Suite 400
Address: Seattle, WA 98103

Facility: Francisco Padsite
Location: 400m S of N, 310m E of W, Sections 5, T11N,
R8W, MDB&M, Lake County
Francisco Pad, Francisco / Bottle Rock
Leasehold, Cobb Valley, CA

Name and Equipment Description: Francisco 2-5 Re-Drill

Geothermal drilling rig and accessories (NCPA Rig #1), Four electrical generators (CAT D-398TA 750 HP diesel engines PERP Registered), three air compressors (Cummins QSK19-C700 700 HP turbocharged diesel powered air compressors), one down hole misting pump; hydrogen sulfide abatement system utilizing high pressure injection of NaOH and H₂O₂; and particulate control equipment consisting of misting down hole, constricting and non constricting venturi contactors, low pressure water spray, expanding blooie line, properly sized, smoothed, tangential wet cyclone, properly designed drop or hopper, water treatment and management systems, necessary metering and measuring devices and associated equipment.

Permit Conditions

Condition 1: Emissions

- A. Bottle Rock Power, LLC (BRP) shall limit hydrogen sulfide (H₂S) emissions during drilling, clean out, and testing to no more than five (5) pounds of H₂S per hour and no more than twenty-four (24) pounds per day during all other phases of this project. During verifiable breakdown and for any hot-liner runs, Rule 510 and procedures shall apply. In the event of atmospheric conditions (e.g., drainage, limited mixing, fumigation, downwash, etc.) that result in complaints and concern in receptor areas from high levels of H₂S, BRP agrees to reduce the H₂S emission limit to two (2) pounds of H₂S using abatement plan at the request of the Air Pollution Control Officer (APCO). Certain exceptions to the H₂S emission limitations may be allowed by the APCO, in writing, for resource testing if such tests are 12 hours or less in duration and coincide with acceptable meteorological conditions verified by the APCO to ensure good dispersion.
- B. If excessively high H₂S levels are encountered during drilling, BRP will either: 1) Place into operation additional H₂S abatement capacity, or 2) Cease operation and close in the well according to appropriate standards of operation. For the purposes of this permit, excessively high levels of H₂S means abated emissions greater than five (5) pounds of H₂S per hour or abated emission levels in excess of 500 ppmv.
- C. Visible emissions shall not exceed the values listed below for more than three (3) minutes in any one (1) hour: • Ringelmann 0.5 (10% opacity) for detached plume at the cyclone; • Ringelmann 0.5 (10% opacity) for combustion emissions of engine exhaust; and • Ringelmann 1 (20% opacity) for road and pad dust emissions.
- D. On commencement of air drilling in significant serpentine, the well logger shall obtain bulk samples that shall be analyzed for asbestos content using TEM, SEM or PLM (California Air Resources Board [ARB] Method 435 Procedures). For the purpose of defining a significant serpentine deposit during geothermal air drilling: "Significant Serpentine" shall mean; drill cutting samples from two consecutive ten-foot interval-drilling sections identified as having 10% or greater serpentine or other asbestos containing ore. The Lake County Air Quality Management District (LCAQMD) shall be promptly notified by phone at 263-7000, provided samples of the drilled material, and unless otherwise agreed upon in writing, notified of the bulk asbestos analysis results within ten working days of sampling.
- E. During drilling in significant serpentine visible emissions shall not exceed Ringelmann 0.25 (5% opacity) for detached plume at the cyclone. BRP shall: 1) Increase down hole misting; 2) Increase water loading at the venturi; 3) Reducing the drilling rate; 4) Use wetting agents; and/or 5) Implement additional solids filtration of working water. Such additional effort shall continue until drilling is clear of significant serpentine/asbestos.

Condition 2: Administrative

- A. This permit has been issued as a modification to include cleanout, forking or deepening of the well as described in the application and permit review. This permit does not establish a precedent for the issuance of additional permits.
- B. The submitted BRP (Tecton) H₂S abatement plan approved by the APCO shall be implemented and followed, and is incorporated herein by reference. Logbook entries shall be made a minimum of four (4) times daily while drilling on air or in steam.
- C. Diesel fuel utilized shall be California Low Sulfur Diesel containing less than 15ppmw sulfur.
- D. If a vapor dominated resource is encountered and it is determined that emissions cannot be maintained pursuant to Parts A & B of LCAQMD Rule 421; or the APCO determines that the well on stand-by (bleed) status will violate the intent of LCAQMD Rule 602 or the associated steamfield permit, then BRP shall with approval of the APCO, install and utilize additional abatement equipment as necessary to bring emissions into compliance. This may include, but is not limited to, immediate conversion to an injector, gas capping, down-hole plugging, and/or the complete closing in of any well in violation of LCAQMD Rules and Regulations.
- E. BRP shall utilize the same particulate abatement system described in the permitting review(s) and includes the following configuration: 1) A non-constricting venturi in the smallest diameter portion of the blooie line (non-constricting venturi 12"-15") for use when flow of at least 20,000 lbs/hr air/steam and a converging venturi scrubber when

(Conditions 2 through 6 are continued on the back of this card)

THIS PERMIT BECOMES VOID UPON CHANGE OF OWNERSHIP OR LOCATION

This permit does not authorize the emission of air contaminants in excess of those allowed by the California Health and Safety Code or the Regulations of the Lake County Air Quality Management District. This permit cannot be considered permission to violate existing laws, ordinances, regulations, or statutes of other government agencies. The provisions of this Permit are severable. If any provision of this Permit is held invalid, the remainder of this Permit shall not be affected thereby.



PERMIT TO OPERATE

Lake County Air Quality Management District

2617 S. Main Street, Lakeport, CA 95453 (707) 263-7000, Fax (707) 263-0421

Permit # P/O 85-030A

By: Douglas Gearhart

Douglas G. Gearhart, APCO

Type of Issuance: Renewal

Issuance Date: 10/31/2020 Valid through: 10/31/2021 Category: IV

Operations under this permit must be conducted in compliance with all specifications and data included with the application under which this permit was issued. Equipment must be properly maintained and kept in good condition at all times. Post this permit or a facsimile (with conditions) in a conspicuous location on or near the equipment.

Contact: Ms. Alice Bray
Owner: Bottle Rock Power, LLC
Mailing: 4010 Stone Way N, Suite 400
Address: Seattle, WA 98103

Facility: Francisco Padsite
Location: 400m S of N, 310m E of W, Sections 5, T11N, R8W, MDB&M, Lake County
Francisco Pad, Francisco / Bottle Rock
Leasehold, Cobb Valley, CA

Name and Equipment Description: Francisco 3-5

One (1) geothermal production well, associated valving, condensate and rock removal (catcher) and bleed muffler servicing the Bottle Rock Geothermal Power Plant.

Permit Conditions

Condition 1 The herein permitted well shall be operated in compliance and consistent with the steam transmission and power plant Authority to Construct (A/C) and Permit to Operate (P/O) conditions where applicable. The herein permitted well shall be operated in compliance with all Lake County Air Quality Management District (LCAQMD), State, and Federal laws and regulations.

Condition 2 Bottle Rock Power, LLC (BRP) shall notify the LCAQMD at least twenty-four (24) hours prior to initiating the planned venting of any well or group of wells in the LCAQMD owned or operated by BRP in an amount in excess of either 3,000 lbs of steam per hour per well or 20,000 lbs of steam per hour total. Testing to characterize emissions may be required by the Air Pollution Control Officer (APCO) for significant well bleeds or vents. In the event source testing of any geothermal well is deemed necessary by the APCO, BRP will provide safe access and sampling ports.

Condition 3 BRP shall submit to the LCAQMD an application for, and receive, an A/C or modify permit prior to constructing, erecting, altering or replacing any equipment which may cause, potentially cause, reduce, control or eliminate the issuance of air contaminants. This does not include normal and routine maintenance nor well clean out and repairs. It does include deepening, altering or increasing the well bore size in a manner to constitute a modification of the source. BRP shall notify the LCAQMD in advance of, and receive approval for, any planned reworking/maintenance of any of the herein permitted production wells. Conditions for approval of such maintenance work will consider the level and duration of emissions, and the conditions incorporated in current BRP A/C permits and performance plans. BRP shall within thirty (30) days after the completion of re-drilling, reworking or flow testing submit to the LCAQMD the results of any routine or required chemical analysis and/or testing accomplished for the herein listed geothermal development wells that indicate emissions or potential emissions into the air.

(Conditions 4 through 12 are continued on the back of this card)

THIS PERMIT BECOMES VOID UPON CHANGE OF OWNERSHIP OR LOCATION

This permit does not authorize the emission of air contaminants in excess of those allowed by the California Health and Safety Code or the Regulations of the Lake County Air Quality Management District. This permit cannot be considered permission to violate existing laws, ordinances, regulations, or statutes of other government agencies. The provisions of this Permit are severable. If any provision of this Permit is held invalid, the remainder of this Permit shall not be affected thereby.



AUTHORITY TO CONSTRUCT

Lake County Air Quality Management District

2617 S. Main Street, Lakeport, CA 95453 (707) 263-7000, Fax (707) 263-0421

Permit # A/C 2014-09

By: Douglas Gearhart
Douglas G. Gearhart, APCO

Type of Issuance: Renewal Issuance Date: 10/31/2020 Valid through: 10/31/2021 Category: IV

Operations under this permit must be conducted in compliance with all specifications and data included with the application under which this permit was issued. Equipment must be properly maintained and kept in good condition at all times. Post this permit or a facsimile (with conditions) in a conspicuous location on or near the equipment.

Contact: Ms. Alice Bray
Owner: Bottle Rock Power, LLC
Mailing: 4010 Stone Way N, Suite 400
Address: Seattle, WA 98103

Facility: Francisco Padsite
Location: 400m S of N, 310m E of W, Sections 5, T11N,
R8W, MDB&M, Lake County
Francisco Pad, Francisco / Bottle Rock
Leasehold, Cobb Valley, CA

Name and Equipment Description: Francisco 4-5

One (1) geothermal production/injection well, associated valving, condensate and rock removal (catcher), and bleed muffler servicing the Bottle Rock Geothermal Power Plant.

Permit Conditions

Condition 1: Emissions

- A. Bottle Rock Power, LLC (BRP) shall limit Hydrogen Sulfide (H₂S) emissions during drilling, clean out, and testing to no more than five (5) pounds of H₂S per hour and no more than twenty-four (24) pounds per day during all other phases of this project. During verified breakdown and for hot-liner installations, Lake County Air Quality Management District (LCAQMD) Rule 510 and procedures shall apply. In the event of atmospheric conditions (e.g., drainage, limited mixing, fumigation, downwash, etc.) that result in complaints and concern in receptor areas from high levels of H₂S, BRP agrees to reduce the H₂S emission limit to two (2) pounds or less of H₂S per hour, consistent with the BRP H₂S Abatement Plan, at the request of the Air Pollution Control Officer (APCO). Certain exceptions to the H₂S emission limitations may be allowed by the APCO, in writing, for resource testing if such tests are 12 hours or less in duration and coincide with acceptable meteorological conditions verified by the APCO to ensure good dispersion.
- B. If excessively high H₂S levels are encountered during drilling, BRP will either: a) Place into operation additional H₂S abatement capacity, or b) Cease operation and close in the well according to appropriate standards of operation. For the purposes of this permit, excessively high levels of H₂S means abated emissions greater than five (5) pounds of H₂S per hour or abated emission levels in excess of 500 ppm volume.
- C. Visible emissions shall not exceed the values listed below for more than three (3) minutes in any one (1) hour: • Ringelmann 0.5 (10% opacity) for detached plume at the cyclone; • Ringelmann 0.5 (10% opacity) for combustion emissions engine exhaust; and • Ringelmann 1 (20% opacity) for road and pad dust emissions.
- D. On commencement of air drilling in significant serpentine or upon experiencing red/pink plume exiting the cyclone, the well logger shall immediately obtain bulk samples of the drilled material and log the event in the abatement logbook, and shall be analyzed for asbestos content using TEM, SEM or PLM (California Air Resources Board [ARB] Method 435 Procedures). "Experiencing a pink/red plume" shall mean a plume of greater than 5% opacity lasting for 30 or more seconds. For the purpose of defining a significant serpentine deposit during geothermal air drilling: "Significant Serpentine" shall mean; drill cutting samples from two consecutive ten-foot interval-drilling sections identified as having 10% or greater serpentine content. The LCAQMD shall be promptly notified by phone at 263-7000, provided a portion of the divided bulk samples of the drilled material, and unless otherwise agreed upon in writing, notified of the bulk asbestos analysis results within ten (10) working days of sampling. Bulk Samples collected upon experiencing a pink/red plume shall be promptly analyzed by XRF, or other acceptable means, to include at a minimum arsenic, chrome, nickel and cadmium. BRP shall, to the extent practical attempt to collect a sample of the particulate from the pink/red plume, and/or assist the LCAQMD in such an attempt, for analysis as described.
- E. During drilling in significant serpentine, or while experiencing a pink/red plume, visible emissions shall not exceed Ringelmann 0.25 (5% opacity) for detached plume at the cyclone. BRP shall: 1) Increase down hole misting; 2) Increase water loading at the venturi; 3) Reducing the drilling rate; 4) Use wetting agents; and/or 5) Implement additional solids filtration of working water. Such additional effort shall continue until drilling is clear of significant serpentine or drilling conditions contributing to the formation of pink/red plume.

Condition 2: Administrative

- A. This permit has been issued for the geothermal well to function in either injection or production mode. The well is constructed at a total depth of 9,901 feet and includes a well bore, well head, valving, piping, flanges, geothermal fluid transmission line header connections, side leg kick-out, two part slotted liner, and associated corrosion mitigation injection equipment. This permit does not establish a precedent for the issuance of additional permits.
- B. The submitted BRP H₂S abatement plan approved by the APCO or subsequent approved revision, shall be implemented and followed, and is incorporated herein by reference. Logbook entries shall be made a minimum of four (4) times daily.
- C. Diesel fuel utilized shall be California Low Sulfur Diesel containing less than 15 ppmw sulfur.
- D. If a vapor dominated resource is encountered and it is determined that emissions cannot be maintained pursuant to Parts A & B of LCAQMD Rule 421; or the APCO determines that the well on stand-by (bleed) status will violate the intent of LCAQMD Rule 602, then BRP shall with approval of the APCO, install and utilize additional abatement equipment as necessary to bring emissions into compliance. This may include, but is not limited to, immediate conversion to an injector, gas capping, down-hole plugging, and/or the complete closing in of any well in violation of LCAQMD Rules and Regulations.

(Conditions 2 through 6 are continued on the back of this card)

THIS PERMIT BECOMES VOID UPON CHANGE OF OWNERSHIP OR LOCATION

This permit does not authorize the emission of air contaminants in excess of those allowed by the California Health and Safety Code or the Regulations of the Lake County Air Quality Management District. This permit cannot be considered permission to violate existing laws, ordinances, regulations, or statutes of other government agencies. The provisions of this Permit are severable. If any provision of this Permit is held invalid, the remainder of this Permit shall not be affected thereby.



PERMIT TO OPERATE

Lake County Air Quality Management District

2617 S. Main Street, Lakeport, CA 95453 (707) 263-7000, Fax (707) 263-0421

Permit # P/O 86-074A

By: Douglas G. Gearhart
Douglas G. Gearhart, APCO

Type of Issuance: Renewal Issuance Date: 10/31/2020 Valid through: 10/31/2021 Category: IV

Operations under this permit must be conducted in compliance with all specifications and data included with the application under which this permit was issued. Equipment must be properly maintained and kept in good condition at all times. Post this permit or a facsimile (with conditions) in a conspicuous location on or near the equipment.

Contact: Ms. Alice Bray
Owner: Bottle Rock Power, LLC
Mailing: 4010 Stone Way N, Suite 400
Address: Seattle, WA 98103

Facility: Francisco Padsite
Location: 400m S of N, 310m E of W, Sections 5, T11N,
R8W, MDB&M, Lake County
Francisco Pad, Francisco / Bottle Rock
Leasehold, Cobb Valley, CA

Name and Equipment Description: Francisco 5-5

One (1) geothermal production well, associated valving, condensate and rock removal (catcher) and bleed muffler servicing the Bottle Rock Geothermal Power Plant.

Permit Conditions

Condition 1 The herein permitted well shall be operated in compliance and consistent with the steam transmission and power plant Authority to Construct (A/C) and Permit to Operate (P/O) conditions where applicable. The herein permitted well shall be operated in compliance with all Lake County Air Quality Management District (LCAQMD), State, and Federal laws and regulations.

Condition 2 Bottle Rock Power, LLC (BRP) shall notify the LCAQMD at least twenty-four (24) hours prior to initiating the planned venting of any well or group of wells in the LCAQMD owned or operated by BRP in an amount in excess of either 3,000 lbs of steam per hour per well or 20,000 lbs of steam per hour total. Testing to characterize emissions may be required by the Air Pollution Control Officer (APCO) for significant well bleeds or vents. In the event source testing of any geothermal well is deemed necessary by the APCO, BRP will provide safe access and sampling ports.

Condition 3 BRP shall submit to the LCAQMD an application for, and receive, an A/C or modify permit prior to constructing, erecting, altering or replacing any equipment which may cause, potentially cause, reduce, control or eliminate the issuance of air contaminants. This does not include normal and routine maintenance nor well clean out and repairs. It does include deepening, altering or increasing the well bore size in a manner to constitute a modification of the source. BRP shall notify the LCAQMD in advance of, and receive approval for, any planned reworking/maintenance of any of the herein permitted production wells. Conditions for approval of such maintenance work will consider the level and duration of emissions, and the conditions incorporated in current BRP A/C permits and performance plans. BRP shall within thirty (30) days after the completion of re-drilling, reworking or flow testing submit to the LCAQMD the results of any routine or required chemical analysis and/or testing accomplished for the herein listed geothermal development wells that indicate emissions or potential emissions into the air.

(Conditions 4 through 12 are continued on the back of this card)

THIS PERMIT BECOMES VOID UPON CHANGE OF OWNERSHIP OR LOCATION

This permit does not authorize the emission of air contaminants in excess of those allowed by the California Health and Safety Code or the Regulations of the Lake County Air Quality Management District. This permit cannot be considered permission to violate existing laws, ordinances, regulations, or statutes of other government agencies. The provisions of this Permit are severable. If any provision of this Permit is held invalid, the remainder of this Permit shall not be affected thereby.



AUTHORITY TO CONSTRUCT

Lake County Air Quality Management District

2617 S. Main Street, Lakeport, CA 95453 (707) 263-7000, Fax (707) 263-0421

Permit # A/C 86-041A

Douglas Gearhart

By: Douglas G. Gearhart, APCO

Type of Issuance: Renewal

Issuance Date: 10/31/2020 Valid through: 10/31/2021 Category: IV

Operations under this permit must be conducted in compliance with all specifications and data included with the application under which this permit was issued. Equipment must be properly maintained and kept in good condition at all times. Post this permit or a facsimile (with conditions) in a conspicuous location on or near the equipment.

Contact: Ms. Alice Bray
Owner: Bottle Rock Power, LLC
Mailing: 4010 Stone Way N, Suite 400
Address: Seattle, WA 98103

Facility: Francisco Padsite
Location: 400m S of N, 310m E of W, Sections 5, T11N,
R8W, MDB&M, Lake County
Francisco Pad, Francisco / Bottle Rock
Leasehold, Cobb Valley, CA

Name and Equipment Description: Francisco 6-5

One (1) geothermal production well, associated valving, condensate and rock removal (catcher) and bleed muffler servicing the Bottle Rock Geothermal Power Plant.

Permit Conditions

Condition 1 Bottle Rock Power, LLC (BRP) shall perform and forward to the Lake County Air Quality Management District (LCAQMD), the following characterization of hot water, steam, particulates and/or gases emanating from the subject well(s) within sixty (60) days after completion of the initial geothermal drilling and testing. If the well is abandoned, no analyses will be necessary.

STEAM CONDENSATE/TOTAL STEAM: Benzene, Ammonium (total)*, Arsenic*, Bicarbonate and Carbonate, Sulfates, Chlorides, Nitrates, Boron (total)*, Hydrogen Sulfide (H₂S) (total)*, Fluorides (total), Mercury (total), pH, Total Dissolved Solids, Total Suspended Solids, Percent Non-Condensables, and Steam Flow and Temperature*.

GAS PHASE: Benzene, Particulate in Steam (ug particulate/g of Steam, Arsenic, Lead, Cadmium, Total Sulfur, Boron), Ammonia, Mercury Vapor, Radon 222 and Daughters, Methane, Non-Methane Hydrocarbons, Carbon Dioxide, and NESHAPS pollutants as requested. Tests can be performed utilizing the bleed of the subject well(s) or during flow testing. Gas phase (non-condensables or steam diluted with air as appropriate to maintain gas phase and integrity of sample) tests are to be performed if wells are placed on long term standby bleed. The test protocol shall be submitted to the LCAQMD at least three (3) weeks before such sample collection and analytical testing is planned and shall be approved by the LCAQMD prior to actual source testing. If the well is produced immediately, the LCAQMD may delay required testing (specifically those items without an asterisk) until circumstances require a sustained bleed status of the well, this shall be at the LCAQMD's option and BRP's request.

Condition 2 BRP shall notify the LCAQMD at least twenty-four (24) hours prior to initiating the planned venting of the herein permitted well or any associated group of well(s) in the LCAQMD owned or operated by BRP.

Condition 3 In the event source testing of the herein permitted geothermal well is deemed necessary by the Air Pollution Control Officer (APCO), BRP will be available within ten (10) days after written notice to open said well for a 4-8 hour duration.

Condition 4 If chemical or particulate analysis performed as part of Condition 1 suggests the need for further study, including air dispersion analysis, BRP will assist, perform or finance such studies if deemed reasonable and necessary by the APCO.

Condition 5 If locks or unmanned gates are used to secure the project area, the LCAQMD or its representative, will be given keys or combinations and
(Conditions 5 through 19 are continued on the back of this card)

THIS PERMIT BECOMES VOID UPON CHANGE OF OWNERSHIP OR LOCATION

This permit does not authorize the emission of air contaminants in excess of those allowed by the California Health and Safety Code or the Regulations of the Lake County Air Quality Management District. This permit cannot be considered permission to violate existing laws, ordinances, regulations, or statutes of other government agencies. The provisions of this Permit are severable. If any provision of this Permit is held invalid, the remainder of this Permit shall not be affected thereby.



AUTHORITY TO CONSTRUCT

Lake County Air Quality Management District

2617 S. Main Street, Lakeport, CA 95453 (707) 263-7000, Fax (707) 263-0421

Permit # A/C 86-042A

By: Douglas Gearhart
Douglas G. Gearhart, APCO

Type of Issuance: Renewal

Issuance Date: 10/31/2020 Valid through: 10/31/2021 Category: IV

Operations under this permit must be conducted in compliance with all specifications and data included with the application under which this permit was issued. Equipment must be properly maintained and kept in good condition at all times. Post this permit or a facsimile (with conditions) in a conspicuous location on or near the equipment.

Contact: Ms. Alice Bray
Owner: Bottle Rock Power, LLC
Mailing: 4010 Stone Way N, Suite 400
Address: Seattle, WA 98103

Facility: Francisco Padsite
Location: 400m S of N, 310m E of W, Sections 5, T11N,
R8W, MDB&M, Lake County
Francisco Pad, Francisco / Bottle Rock
Leasehold, Cobb Valley, CA

Name and Equipment Description: Francisco 7-5

One (1) geothermal production well, associated valving, condensate and rock removal (catcher) and bleed muffler servicing the Bottle Rock Geothermal Power Plant.

Permit Conditions

Condition 1 Bottle Rock Power, LLC (BRP) shall perform and forward to the Lake County Air Quality Management District (LCAQMD), the following characterization of hot water, steam, particulates and/or gases emanating from the subject well(s) within sixty (60) days after completion of the initial geothermal drilling and testing. If the well is abandoned, no analyses will be necessary.

STEAM CONDENSATE/TOTAL STEAM: Benzene, Ammonium (total)*, Arsenic*, Bicarbonate and Carbonate, Sulfates, Chlorides, Nitrates, Boron (total)*, Hydrogen Sulfide (H₂S) (total)*, Fluorides (total), Mercury (total), pH, Total Dissolved Solids, Total Suspended Solids, Percent Non-Condensables, and Steam Flow and Temperature*.

GAS PHASE: Benzene, Particulate in Steam (ug particulate/g of Steam, Arsenic, Lead, Cadmium, Total Sulfur, Boron), Ammonia, Mercury Vapor, Radon 222 and Daughters, Methane, Non-Methane Hydrocarbons, Carbon Dioxide, and NESHAPS pollutants as requested. Tests can be performed utilizing the bleed of the subject well(s) or during flow testing. Gas phase (non-condensables or steam diluted with air as appropriate to maintain gas phase and integrity of sample) tests are to be performed if wells are placed on long term standby bleed. The test protocol shall be submitted to the LCAQMD at least three (3) weeks before such sample collection and analytical testing is planned and shall be approved by the LCAQMD prior to actual source testing. If the well is produced immediately, the LCAQMD may delay required testing (specifically those items without an asterisk) until circumstances require a sustained bleed status of the well, this shall be at the LCAQMD's option and BRP's request.

Condition 2 BRP shall notify the LCAQMD at least twenty-four (24) hours prior to initiating the planned venting of the herein permitted well or any associated group of well(s) in the LCAQMD owned or operated by BRP.

Condition 3 In the event source testing of the herein permitted geothermal well is deemed necessary by the Air Pollution Control Officer (APCO), BRP will be available within ten (10) days after written notice to open said well for a 4-8 hour duration.

Condition 4 If chemical or particulate analysis performed as part of Condition 1 suggests the need for further study, including air dispersion analysis, BRP will assist, perform or finance such studies if deemed reasonable and necessary by the APCO.

Condition 5 If locks or unmanned gates are used to secure the project area, the LCAQMD or its representative, will be given keys or combinations and

(Conditions 5 through 19 are continued on the back of this card)

THIS PERMIT BECOMES VOID UPON CHANGE OF OWNERSHIP OR LOCATION

This permit does not authorize the emission of air contaminants in excess of those allowed by the California Health and Safety Code or the Regulations of the Lake County Air Quality Management District. This permit cannot be considered permission to violate existing laws, ordinances, regulations, or statutes of other government agencies. The provisions of this Permit are severable. If any provision of this Permit is held invalid, the remainder of this Permit shall not be affected thereby.



AUTHORITY TO CONSTRUCT

Lake County Air Quality Management District

2617 S. Main Street, Lakeport, CA 95453 (707) 263-7000, Fax (707) 263-0421

Permit # A/C 2008-28

By: Douglas Gearhart
Douglas G. Gearhart, APCO

Type of Issuance: Renewal

Issuance Date: 10/31/2020 Valid through: 10/31/2021 Category: IV

Operations under this permit must be conducted in compliance with all specifications and data included with the application under which this permit was issued. Equipment must be properly maintained and kept in good condition at all times. Post this permit or a facsimile (with conditions) in a conspicuous location on or near the equipment.

Contact: Ms. Alice Bray
Owner: Bottle Rock Power, LLC
Mailing: 4010 Stone Way N, Suite 400
Address: Seattle, WA 98103

Facility: Francisco Padsite
Location: 400m S of N, 310m E of W, Sections 5, T11N,
R8W, MDB&M, Lake County
Francisco Pad, Francisco / Bottle Rock
Leasehold, Cobb Valley, CA

Name and Equipment Description: Francisco 9-5

Geothermal drilling rig and accessories (ThermaSource Rig # 108 or equivalent), three (3) electrical generators (1101 Hp CAT 3512 turbocharged PERP registered diesel engines), one (1) top drive engine (1205Hp Detroit diesel model R1638K40 turbocharged and after-cooled, PERP registered diesel engine), three (3) air compressors (717 Hp CAT 900 series turbocharged and after-cooled, diesel PERP registered engines), one (1) air compressor (700 Hp CAT C-18 turbocharged and after-cooled, PERP registered diesel engine), one (1) down hole misting pump (110 Hp Cummins QSB4.5 turbocharged PERP registered diesel engine); H₂S abatement system utilizing high pressure injection of NaOH and H₂O₂; drawdown chemical flow metering devices; particulate control equipment consisting of misting down hole, constricting and non constricting venturi contactors, low pressure water spray, expanding blooie line, properly sized, smoothed, tangential wet cyclone, water treatment and management systems, and metering and measuring devices and associated equipment.

Permit Conditions

Condition 1: Emissions

A. Bottle Rock Power, LLC (BRP) shall limit Hydrogen Sulfide (H₂S) emissions during drilling, clean out, and testing to no more than five (5) pounds of H₂S per hour and no more than twenty-four (24) pounds per day during all other phases of this project. During verified breakdown and for hot-liner installations, Lake County Air Quality Management District (LCAQMD) Rule 510 and procedures shall apply. In the event of atmospheric conditions (e.g., drainage, limited mixing, fumigation, downwash, etc.) that result in complaints and concern in receptor areas from high levels of H₂S, BRP agrees to reduce the H₂S emission limit to two (2) pounds or less of H₂S per hour consistent with the BRP H₂S Abatement Plan, at the request of the Air Pollution Control Officer (APCO). Certain exceptions to the H₂S emission limitations may be allowed by the APCO, in writing, for resource testing if such tests are 12 hours or less in duration and coincide with acceptable meteorological conditions verified by the APCO to ensure good dispersion.

B. If excessively high H₂S levels are encountered during drilling, BRP will either: a) Place into operation additional H₂S abatement capacity, or b) Cease operation and close in the well according to appropriate standards of operation. For the purposes of this permit, excessively high levels of H₂S means abated emissions greater than five (5) pounds of H₂S per hour or abated emission levels in excess of 500 ppm volume.

C. Visible emissions shall not exceed the values listed below for more than three (3) minutes in any one (1) hour: • Ringelmann 0.5 (10% opacity) for detached plume at the cyclone; • Ringelmann 0.5 (10% opacity) for combustion emissions engine exhaust; and • Ringelmann 1 (20% opacity) for road and pad dust emissions.

D. On commencement of air drilling in significant serpentine or upon experiencing red/pink plume exiting the cyclone, the well logger shall immediately obtain bulk samples of the drilled material and log the event in the abatement logbook, and shall be analyzed for asbestos content using TEM, SEM or PLM (California Air Resources Board [ARB] Method 435 Procedures). "Experiencing a pink/red plume" shall mean a plume of greater than 5% opacity lasting for 30 or more seconds. For the purpose of defining a significant serpentine deposit during geothermal air drilling: "Significant Serpentine" shall mean; drill cutting samples from two consecutive ten-foot interval-drilling sections identified as having 10% or greater serpentine content. The LCAQMD shall be promptly notified by phone at 263-7000, provided a portion of the divided bulk samples of the drilled material, and unless otherwise agreed upon in writing, notified of the bulk asbestos analysis results within ten working days of sampling. Bulk Samples collected upon experiencing a pink/red plume shall be promptly analyzed by XRF, or other acceptable means, to include at a minimum arsenic, chrome, nickel and cadmium. BRP shall, to the extent practical attempt to collect a sample of the particulate from the pink/red plume, and/or assist the LCAQMD in such an attempt, for analysis as described.

E. During drilling in significant serpentine, or while experiencing a pink/red plume, visible emissions shall not exceed Ringelmann 0.25 (5% opacity) for detached plume at the cyclone. BRP shall: 1) Increase down hole misting; 2) Increase water loading at the venturi; 3) Reducing the drilling rate; 4) Use wetting agents; and/or 5) Implement additional solids filtration of working water. Such additional effort shall continue until drilling is clear of significant serpentine or drilling conditions contributing to the formation of pink/red plume.

Condition 2: Administrative

A. This permit has been issued for the construction of a geothermal production well to a total depth of 11,000 feet and includes a well bore, well head, valving, piping, flanges, geothermal fluid transmission line header connections, side leg kick-out, two part slotted liner, and associated corrosion mitigation injection equipment. This permit does not establish a precedent for the issuance of additional permits.

B. The submitted BRP H₂S abatement plan approved by the APCO or subsequent approved revision, shall be implemented and followed, and is incorporated herein by reference. Logbook entries shall be made a minimum of four (4) times daily.

(Conditions 2 through 6 are continued on the back of this card)

THIS PERMIT BECOMES VOID UPON CHANGE OF OWNERSHIP OR LOCATION

This permit does not authorize the emission of air contaminants in excess of those allowed by the California Health and Safety Code or the Regulations of the Lake County Air Quality Management District. This permit cannot be considered permission to violate existing laws, ordinances, regulations, or statutes of other government agencies. The provisions of this Permit are severable. If any provision of this Permit is held invalid, the remainder of this Permit shall not be affected thereby.



PERMIT TO OPERATE

Lake County Air Quality Management District

2617 S. Main Street, Lakeport, CA 95453 (707) 263-7000, Fax (707) 263-0421

Permit # P/O 2014-09

By: *Douglas Gearhart*

Douglas G. Gearhart, APCO

Type of Issuance: Renewal Issuance Date: 10/31/2020 Valid through: 10/31/2021 Category: II

Operations under this permit must be conducted in compliance with all specifications and data included with the application under which this permit was issued. Equipment must be properly maintained and kept in good condition at all times. Post this permit or a facsimile (with conditions) in a conspicuous location on or near the equipment.

Contact: Ms. Alice Bray
Owner: Bottle Rock Power, LLC
Mailing: 4010 Stone Way N, Suite 400
Address: Seattle, WA 98103

Facility: Bottle Rock Power Plant
Location: Bottle Rock Power Steamfield Storage Yard
7557 High Valley Rd.
Cobb, CA 95426

Name and Equipment Description: Gasoline and/or Diesel Dispensing Facility

One (1) ConVault above ground split storage tank (500 gallons unleaded and 500 gallons diesel). Phase I vapor recovery: pressure/vacuum (P/V) vent (make Husky, model 5885), 11 ft. Phase II vapor recovery: One (1) diesel dispenser and one (1) unleaded dispenser (make Fillrite, model 305AST), two (2) nozzles (make Husky, model H5010), and two (2) hoses (make Dayco, model DL 509).

Permit Conditions

Condition 1: Emissions

- A. The Phase I vapor recovery system shall be properly connected and utilized during all storage tank filling operations.
- B. The Phase II vapor recovery system shall be properly connected and utilized during all vehicle fueling.
- C. Bottle Rock Power, LLC (BRP) shall maintain all equipment in good working order pursuant to manufacturer's guidelines and applicable California Air Resources Board (ARB) certification, and operate in a manner to prevent or minimize air emissions and gasoline leaks.
- D. BRP shall immediately correct any gasoline or vapor leak, and all equipment breakdowns shall be reported to the Lake County Air Quality Management District (LCAQMD) pursuant to Section 510, LCAQMD Rules and Regulations.

Condition 2: Administrative

- A. This permit has been issued for the purpose of on site fuel dispensing (no fuel sales), with annual use not to exceed 50,000 gallons.
- B. The Phase I vapor recovery system installed on the storage tank(s) shall meet the certification requirements of the ARB.
- C. The Phase II vapor recovery system shall be maintained to meet ARB certification requirements.
- D. All gasoline storage tanks shall have submerged drop tube/fill pipes terminating a maximum of 6" from the tank bottom.

(Conditions 2 through 6 are continued on the back of this card)

THIS PERMIT BECOMES VOID UPON CHANGE OF OWNERSHIP OR LOCATION

This permit does not authorize the emission of air contaminants in excess of those allowed by the California Health and Safety Code or the Regulations of the Lake County Air Quality Management District. This permit cannot be considered permission to violate existing laws, ordinances, regulations, or statutes of other government agencies. The provisions of this Permit are severable. If any provision of this Permit is held invalid, the remainder of this Permit shall not be affected thereby.



AUTHORITY TO CONSTRUCT

Lake County Air Quality Management District

2617 S. Main Street, Lakeport, CA 95453 (707) 263-7000, Fax (707) 263-0421

Permit # A/C 2010-14

By: Douglas Gearhart
Douglas G. Gearhart, APCO

Type of Issuance: Renewal

Issuance Date: 10/31/2020 Valid through: 10/31/2021 Category: Vb

Operations under this permit must be conducted in compliance with all specifications and data included with the application under which this permit was issued. Equipment must be properly maintained and kept in good condition at all times. Post this permit or a facsimile (with conditions) in a conspicuous location on or near the equipment.

Contact: Ms. Alice Bray
Owner: Bottle Rock Power, LLC
Mailing: 4010 Stone Way N, Suite 400
Address: Seattle, WA 98103

Facility: Bottle Rock Facility
Location: Sections 5&6, T11N, R8W, MDB&M, Lake
County
Bottle Rock / Francisco Leasehold, Cobb Valley,
CA

Name and Equipment Description: Steam Transmission Line

One (1) geothermal fluid collection line, associated valving, condensate collection including re-injection line, and steam release abatement system with particulate and H₂S removal servicing the Bottle Rock Geothermal Power Plant and one (1) 2002 78hp John Deere Backhoe Loader EIN #MM5E57. Francisco Pad: one (1) 6,200 gallon vent tank, one (1) 1,500 gallon vent tank, one (1) TECO-Westinghouse (or equivalent) 20 hp electric motor, one (1) 500 gpm Gorman-Rupp (or equivalent) pump, Associated piping, instrumentation, and valves. Coleman Pad: one (1) 1,500 gallon vent tank, up to two (2) 20,000 gallon Baker tanks, one (1) TECO-Westinghouse (or equivalent) 20 hp electric motor, one (1) 500 gpm Gorman-Rupp (or equivalent) pump, associated piping, instrumentation, and valves. West Coleman Pad: one (1) 6,200 gallon vent tank, one (1) 1,500 gallon vent tank, associated piping, instrumentation, and valves.

Permit Conditions

Condition 1: Emissions

A. Condensate bleeds shall be opened and utilized only as necessary during cold start-up of the geothermal fluid transmission line. Other bleeds necessitated by continuous normal operation of this line shall total less than 0.3 lbs hydrogen sulfide (H₂S) per hour during any one hour. If necessary, abatement systems shall be installed and/or utilized to ensure fugitive H₂S emissions of less than 0.3 lbs/hr.

B. Abatement equipment to be utilized and available to prevent venting of air pollutants into the ambient air shall include an Emergency Stacking H₂S Abatement System* capable of treating 100% of the total steam flow delivered through the transmission line; a by-pass to the surface condenser of the serviced power plant and abatement to the same level of emissions as required of the power plant; and the ability to remotely and within minutes cut back steam flow to not more than 50% of full steam flow. All abatement facilities shall be used in series and individually as necessary to ensure that an emissions rate of not more than 5 lbs H₂S/hr is obtained.

* This abatement system is described in detail in a document entitled, Emergency Steam Stacking H₂S Abatement Study, Bottle Rock Steam Gathering System Final Report; February 1982, Job No. 52-3184-001 by Gibbs & Hill for MCR.

C. Dust emissions of three (3) minutes duration in any one (1) hour will be kept below 20% opacity by use of water, palliatives, or surfacing of roads, pads and parking areas during the construction and operation of condensate collection system modification.

D. In the event of generalized atmospheric conditions or localized dangerous contamination of such a nature as to constitute an emergency creating a danger to the health and welfare of the citizens of Lake County, the Lake County Air Quality Management District (LCAQMD) will take immediate action by requiring Bottle Rock Power, LLC (BRP) to reduce or discontinue air contaminant emissions immediately from fluid (steam) transmission lines. A hearing shall be held by the LCAQMD Hearing Board as soon as practical after such action has been taken to determine whether such reduction or discontinuance shall continue, and if so, under what conditions.

E. Steam stacking under normal operations shall be treated by the use of the turbine by-pass to power plant condenser and abated utilizing the power plant abatement system. A de-mister or water scrubber shall be used to ensure compliance with LCAQMD Rule 411 when venting directly downstream and utilizing the steam stacking emergency abatement system.

F. When the total accumulative emissions from this development project during construction reach the five (5) pounds per hour level, or public nuisance issues be validated, BRP shall, at the request of the Air Pollution Control Officer (APCO), assist in obtaining funding to install and maintain, or fund the LCAQMD to install and maintain, an air quality monitoring site (H₂S, wind direction, wind speed, temperature) to assist the LCAQMD in determining compliance and the validity of emission limitations as set forth in these conditions.

G. Regarding the turbine by-pass to main condenser power plant abatement system, BRP shall, to the extent possible, work to incorporate reliable and proven valves, noise attenuation of the valving, and desuperheating of by-passed steam/or account for in the design of the system, to maintain the ability to

(Conditions 1 through 6 are continued on the back of this card)

THIS PERMIT BECOMES VOID UPON CHANGE OF OWNERSHIP OR LOCATION

This permit does not authorize the emission of air contaminants in excess of those allowed by the California Health and Safety Code or the Regulations of the Lake County Air Quality Management District. This permit cannot be considered permission to violate existing laws, ordinances, regulations, or statutes of other government agencies. The provisions of this Permit are severable. If any provision of this Permit is held invalid, the remainder of this Permit shall not be affected thereby.



PERMIT TO OPERATE

Lake County Air Quality Management District

2617 S. Main Street, Lakeport, CA 95453 (707) 263-7000, Fax (707) 263-0421

Permit # P/O 2010-04

By: Douglas Gearhart
Douglas G. Gearhart, APCO

Type of Issuance: Renewal Issuance Date: 10/31/2020 Valid through: 10/31/2021 Category: IV

Operations under this permit must be conducted in compliance with all specifications and data included with the application under which this permit was issued. Equipment must be properly maintained and kept in good condition at all times. Post this permit or a facsimile (with conditions) in a conspicuous location on or near the equipment.

Contact: Ms. Alice Bray
Owner: Bottle Rock Power, LLC
Mailing: 4010 Stone Way N, Suite 400
Address: Seattle, WA 98103

Facility: Bottle Rock Facility
Location: Sec 5, T11N, R8W, MDB&M Lake County
Francisco/Coleman Leasehold, Cobb Valley, CA

Name and Equipment Description: Steam Transmission Line Modifications

Three (3) gate valves on the Steam Transmission Line to provide full isolation of the Francisco Pad, West Coleman Pad, and Power Plant. Two (2) sets of steam wash nozzles, and associated pumps, valves, and piping, located upstream of the main steam separator. Variable speed chemical feed pumps on the emergency steam stacking emissions control system connected to the Distributed Control System.

Permit Conditions

Condition 1: These modifications were done to the previously existing geothermal fluid (steam) transmission pipeline, steam wash, and emergency steam stacking system servicing the Bottle Rock Power Plant; all other permits, associated conditions, and limitations are not modified. The pipeline shall be constructed and operated in a manner to not increase steam stacking during scheduled and unscheduled power generation or transmission line outages or during power plant startups and shutdowns of the unit. Equipment utilized and/or modified which is significantly different than that described in the permit application is subject to permit application and review.

Condition 2: Pipeline cleanout, testing and startup emissions shall be consistent with the submitted project application and minimized to the extent feasible. Bottle Rock Power, LLC (BRP) shall provide the Lake County Air Quality Management District (LCAQMD) seventy-two (72) hours advance notice of scheduled cleanout and testing operations and obtain prior Air Pollution Control Officer (APCO) approval for the date and time of emissions release or obtain a variance.

Condition 3: All drain water discharged shall be directed to the rich condensate collection and disposal line.

Condition 4: This permit does not modify or make less restrictive any emission limitation, reporting, and/or monitoring/testing requirements that presently exist for this facility.

Condition 5: BRP shall provide the LCAQMD, no less than thirty (30) days subsequent to installation of the herein authorized modification, with as-built drawings for the modification, including all steam or gas vent locations.

Condition 6: BRP shall provide safe access to sampling ports that enable representatives of the LCAQMD, California Air Resources Board, or Environmental Protection Agency to collect samples, as approved by the APCO, from the steam stacking muffler, condensate collection basins, or any point release of steam, gas, or emissions to the ambient air.

THIS PERMIT BECOMES VOID UPON CHANGE OF OWNERSHIP OR LOCATION

This permit does not authorize the emission of air contaminants in excess of those allowed by the California Health and Safety Code or the Regulations of the Lake County Air Quality Management District. This permit cannot be considered permission to violate existing laws, ordinances, regulations, or statutes of other government agencies. The provisions of this Permit are severable. If any provision of this Permit is held invalid, the remainder of this Permit shall not be affected thereby.



AUTHORITY TO CONSTRUCT

Lake County Air Quality Management District

2617 S. Main Street, Lakeport, CA 95453 (707) 263-7000, Fax (707) 263-0421

Permit # A/C 90-001

By: *Douglas Gearhart*

Douglas G. Gearhart, APCO

Type of Issuance: Renewal

Issuance Date: 10/31/2020 Valid through: 10/31/2021 Category: IV

Operations under this permit must be conducted in compliance with all specifications and data included with the application under which this permit was issued. Equipment must be properly maintained and kept in good condition at all times. Post this permit or a facsimile (with conditions) in a conspicuous location on or near the equipment.

Contact: Ms. Alice Bray
Owner: Bottle Rock Power, LLC
Mailing: 4010 Stone Way N, Suite 400
Address: Seattle, WA 98103

Facility: West Coleman Padsite
Location: 640m N of S, 150m W of E, Section 6, T11N,
R8W, MDB&M, Lake County
Bottle Rock / Francisco Leasehold, Cobb Valley,
CA

Name and Equipment Description: W. Coleman 1-6 Re-Drill

One (1) geothermal production well, associated valving, condensate and rock removal (catcher) and bleed muffler servicing the Bottle Rock Geothermal Power Plant.

Permit Conditions

Condition 1 Bottle Rock Power, LLC (BRP) shall operate the proposed abatement system to limit emissions during drilling, initial clean out, and testing to a rate of no more than five (5.0) pounds of hydrogen sulfide (H₂S) per hour. Should atmospheric conditions result in nuisance complaints or H₂S monitoring at the Glenbrook monitoring station exceed 15 ppb, BRP shall limit emissions to no more than two (2) pounds H₂S per hour at the request of the Lake County Air Quality Management District (LCAQMD). Detached plume opacity shall be controlled to a 10% opacity by the injection of no less than 60 GPM and excessive splash over or carry through of drift shall be prevented by properly sizing a cyclone scrubber or other acceptable method. Should the well drilling encounter the condition described as "pink or red plume" during the air drilling, initial cleanout, or testing of the herein permitted geothermal well(s), BRP shall act promptly to enter such information into the abatement log book required as part of the performance plan and shall notify the LCAQMD within one (1) hour after such entry is made. BRP shall have posted on site with the permit, phone numbers of the LCAQMD office (263-7000) or Air Pollution Control Officer (APCO) (391-3232) for contact should such incident occur. BRP shall promptly install an improved blooie line water injection/cyclonic separator for the efficient abatement of high loading of small sized particulate (e.g. 0.5 to 5.0 micron). Said system shall be capable of a water injection capacity of a minimum of (400) GPM with as long a residence/contact time as is practicable. Alternate technological approached as proposed by BRP and approved by the APCO shall be allowed and encouraged, including a reduction in drilling rate and misting down hole.

Condition 2 Road, pad, and yard dust for three (3) minutes or more duration in any one (1) hour shall be kept below Ringelmann 0.5 at all times by making use of watering, palliatives, oiling/chip seal, or surfacing of raods used regularly. BRP shall perform or have performed, at LCAQMD request and by a LCAQMD approved method, geological sampling of serpentine exposures of the pad site and/or access road and provide analysis of the asbestos content of the material prior to the construction. BRP shall surface or otherwise cover and maintain all areas identified as containing significant amounts of asbestos which are subject to vehicular wear.

Condition 3 BRP shall promptly notify the LCAQMD in writing should they learn of or encounter conditions where toxic air emissions of concern from an occupational standpoint occur and which are allowed to disperse into the ambient air as a mitigation. BRP shall install, maintain, and operate a gas alarm at a location and as approved by the APCO.

Condition 4 The BRP H₂S abatement plan on file with the LCAQMD is accepted contingent upon changes incorporated herein and shall be followed and implemented. Entries made into an onsite log book shall occur a minimum of four (4) times daily once abatement is initiated, and entries shall be made in ink and signed by a responsible person in a format acceptable to the LCAQMD. The abatement equipment, an abatement performance plan, and log book shall be onsite prior to air drilling. The LCAQMD shall be promptly informed as to the responsible onsite person and location of the log book. The official

(Conditions 4 through 14 are continued on the back of this card)

THIS PERMIT BECOMES VOID UPON CHANGE OF OWNERSHIP OR LOCATION

This permit does not authorize the emission of air contaminants in excess of those allowed by the California Health and Safety Code or the Regulations of the Lake County Air Quality Management District. This permit cannot be considered permission to violate existing laws, ordinances, regulations, or statutes of other government agencies. The provisions of this Permit are severable. If any provision of this Permit is held invalid, the remainder of this Permit shall not be affected thereby.



AUTHORITY TO CONSTRUCT

Lake County Air Quality Management District

2617 S. Main Street, Lakeport, CA 95453 (707) 263-7000, Fax (707) 263-0421

Permit # A/C 2005-46

By: Douglas Gearhart

Douglas G. Gearhart, APCO

Type of Issuance: Renewal

Issuance Date: 10/31/2020 Valid through: 10/31/2021 Category: IV

Operations under this permit must be conducted in compliance with all specifications and data included with the application under which this permit was issued. Equipment must be properly maintained and kept in good condition at all times. Post this permit or a facsimile (with conditions) in a conspicuous location on or near the equipment.

Contact: Ms. Alice Bray
Owner: Bottle Rock Power, LLC
Mailing: 4010 Stone Way N, Suite 400
Address: Seattle, WA 98103

Facility: West Coleman Padsite
Location: West Coleman 2-6, located on Bottle Rock West Coleman Padsite (1155m So. & 134.9m W of the NE Corner Section 6, T11N, R8W, MDB&M, Lake County, N 397,334 E 1,797,546)

Name and Equipment Description: W. Coleman 2-6 Re-Drill

Geothermal drilling rig and accessories (NCPA Rig #1), Four electrical generators (CAT D-398TA 750 HP diesel engines PERP Registered), three air compressors (Cummins QSK19-C700 700 HP turbocharged diesel-powered air compressors PERP Registered), one down hole misting pump; hydrogen sulfide abatement system utilizing high pressure injection of NaOH and H₂O₂; and particulate control equipment consisting of misting down hole, constricting and non constricting venturi contactors, low pressure water spray, expanding blooie line, properly sized, smoothed, tangential wet cyclone, properly designed drop or hopper, water treatment and management systems, necessary metering and measuring devices and associated equipment.

Permit Conditions

Condition 1: Emissions

- A. Bottle Rock Power, LLC (BRP) shall limit hydrogen sulfide (H₂S) emissions during drilling, clean out, and testing to no more than five (5) pounds of H₂S per hour and no more than twenty-four (24) pounds per day during all other phases of this project. During verifiable breakdown and for any hot-liner runs, Rule 510 and procedures shall apply. In the event of atmospheric conditions (e.g., drainage, limited mixing, fumigation, downwash, etc.) that result in complaints and concern in receptor areas from high levels of H₂S, BRP agrees to reduce the H₂S emission limit to two (2) pounds of H₂S using abatement plan at the request of the Air Pollution Control Officer (APCO). Certain exceptions to the H₂S emission limitations may be allowed by the APCO, in writing, for resource testing if such tests are 12 hours or less in duration and coincide with acceptable meteorological conditions verified by the APCO to ensure good dispersion.
- B. If excessively high H₂S levels are encountered during drilling, BRP will either: 1) Place into operation additional H₂S abatement capacity, or 2) Cease operation and close in the well according to appropriate standards of operation. For the purposes of this permit, excessively high levels of H₂S means abated emissions greater than five (5) pounds of H₂S per hour or abated emission levels in excess of 500 ppmv.
- C. Visible emissions shall not exceed the values listed below for more than three (3) minutes in any one (1) hour: • Ringelmann 0.5 (10% opacity) for detached plume at the cyclone; • Ringelmann 0.5 (10% opacity) for combustion emissions of engine exhaust; and • Ringelmann 1 (20% opacity) for road and pad dust emissions.
- D. On commencement of air drilling in significant serpentine, the well logger shall obtain bulk samples that shall be analyzed for asbestos content using TEM, SEM or PLM (California Air Resources Board [ARB] Method 435 Procedures). For the purpose of defining a significant serpentine deposit during geothermal air drilling: "Significant Serpentine" shall mean; drill cutting samples from two consecutive ten-foot interval-drilling sections identified as having 10% or greater serpentine or other asbestos-containing rock. The Lake County Air Quality Management District (LCAQMD) shall be promptly notified by phone at 263-7000, provided samples of the drilled material, and unless otherwise agreed upon in writing, notified of the bulk asbestos analysis results within ten working days of sampling.
- E. During drilling in significant serpentine visible emissions shall not exceed Ringelmann 0.25 (5% opacity) for detached plume at the cyclone. BRP shall: 1) Increase down hole misting; 2) Increase water loading at the venturi; 3) Reduce the drilling rate; 4) Use wetting agents; and/or 5) Implement additional solids filtration of working water. Such additional effort shall continue until drilling is clear of significant serpentine/asbestos.

Condition 2: Administrative

- A. This permit has been issued as a modification to include cleanout, forking or deepening of the well as described in the application and permit review. This permit does not establish a precedent for the issuance of additional permits.
- B. The submitted BRP (Tecton) H₂S abatement plan approved by the APCO shall be implemented and followed, and is incorporated herein by reference. Logbook entries shall be made a minimum of four (4) times daily while drilling on air or in steam.
- C. Diesel fuel utilized shall be California Low Sulfur Diesel containing less than 15ppmw sulfur.
- D. If a vapor-dominated resource is encountered and it is determined that emissions cannot be maintained pursuant to Parts A & B of LCAQMD Rule 421; or the APCO determines that the well on stand-by (bleed) status will violate the intent of LCAQMD Rule 602 or the associated steamfield permit, then BRP shall, with approval of the APCO, install and utilize additional abatement equipment as necessary to bring emissions into compliance. This may include, but is not limited to, immediate conversion to an injector, gas capping, down-hole plugging, and/or the complete closing in of any well in violation of LCAQMD Rules and Regulations.
- E. BRP shall utilize the particulate scrubbing system as substantially described in the permitting review and includes the following configuration: 1) A smooth expansion blooie line with low-pressure constricting and non-constricting interchangeable venturis with water injection for venturi contact/scrubbing. The non-constricting venturi

(Conditions 2 through 6 are continued on the back of this card)

THIS PERMIT BECOMES VOID UPON CHANGE OF OWNERSHIP OR LOCATION

This permit does not authorize the emission of air contaminants in excess of those allowed by the California Health and Safety Code or the Regulations of the Lake County Air Quality Management District. This permit cannot be considered permission to violate existing laws, ordinances, regulations, or statutes of other government agencies. The provisions of this Permit are severable. If any provision of this Permit is held invalid, the remainder of this Permit shall not be affected thereby.



AUTHORITY TO CONSTRUCT

Lake County Air Quality Management District

2617 S. Main Street, Lakeport, CA 95453 (707) 263-7000, Fax (707) 263-0421

Permit # A/C 2005-47

By: *Douglas Gearhart*

Douglas G. Gearhart, APCO

Type of Issuance: Renewal

Issuance Date: 10/31/2020 Valid through: 10/31/2021 Category: IV

Operations under this permit must be conducted in compliance with all specifications and data included with the application under which this permit was issued. Equipment must be properly maintained and kept in good condition at all times. Post this permit or a facsimile (with conditions) in a conspicuous location on or near the equipment.

Contact: Ms. Alice Bray
Owner: Bottle Rock Power, LLC
Mailing: 4010 Stone Way N, Suite 400
Address: Seattle, WA 98103

Facility: West Coleman Padsite
Location: West Coleman 3-6, located on Bottle Rock West Coleman Padsite (1155m So. & 134.9m W of the NE Corner Section 6, T11N, R8W, MDB&M, Lake County, N 397,334 E 1,797,546)

Name and Equipment Description: W. Coleman 3-6 Re-Drill

Geothermal drilling rig and accessories (NCPA Rig #1), Four electrical generators (CAT D-398TA 750 HP diesel engines PERP Registered), three air compressors (Cummins QSK19-C700 700 HP turbocharged diesel-powered air compressors PERP Registered), one down hole misting pump; hydrogen sulfide abatement system utilizing high pressure injection of NaOH and H₂O₂; and particulate control equipment consisting of misting down hole, constricting and non constricting venturi contactors, low pressure water spray, expanding blooie line, properly sized, smoothed, tangential wet cyclone, properly designed drop or hopper, water treatment and management systems, necessary metering and measuring devices and associated equipment.

Permit Conditions

Condition 1: Emissions

- A. Bottle Rock Power, LLC (BRP) shall limit hydrogen sulfide (H₂S) emissions during drilling, clean out, and testing to no more than five (5) pounds of H₂S per hour and no more than twenty-four (24) pounds per day during all other phases of this project. During verifiable breakdown and for any hot-liner runs, Rule 510 and procedures shall apply. In the event of atmospheric conditions (e.g., drainage, limited mixing, fumigation, downwash, etc.) that result in complaints and concern in receptor areas from high levels of H₂S, BRP agrees to reduce the H₂S emission limit to two (2) pounds of H₂S using abatement plan at the request of the Air Pollution Control Officer (APCO). Certain exceptions to the H₂S emission limitations may be allowed by the APCO, in writing, for resource testing if such tests are 12 hours or less in duration and coincide with acceptable meteorological conditions verified by the APCO to ensure good dispersion.
- B. If excessively high H₂S levels are encountered during drilling, BRP will either: 1) Place into operation additional H₂S abatement capacity, or 2) Cease operation and close in the well according to appropriate standards of operation. For the purposes of this permit, excessively high levels of H₂S means abated emissions greater than five (5) pounds of H₂S per hour or abated emission levels in excess of 500 ppmv.
- C. Visible emissions shall not exceed the values listed below for more than three (3) minutes in any one (1) hour: • Ringelmann 0.5 (10% opacity) for detached plume at the cyclone; • Ringelmann 0.5 (10% opacity) for combustion emissions of engine exhaust; and • Ringelmann 1 (20% opacity) for road and pad dust emissions.
- D. On commencement of air drilling in significant serpentine, the well logger shall obtain bulk samples that shall be analyzed for asbestos content using TEM, SEM or PLM (California Air Resources Board [ARB] Method 435 Procedures). For the purpose of defining a significant serpentine deposit during geothermal air drilling: "Significant Serpentine" shall mean; drill cutting samples from two consecutive ten-foot interval-drilling sections identified as having 10% or greater serpentine or other asbestos-containing rock. The Lake County Air Quality Management District (LCAQMD) shall be promptly notified by phone at 263-7000, provided samples of the drilled material, and unless otherwise agreed upon in writing, notified of the bulk asbestos analysis results within ten working days of sampling.
- E. During drilling in significant serpentine visible emissions shall not exceed Ringelmann 0.25 (5% opacity) for detached plume at the cyclone. BRP shall: 1) Increase down hole misting; 2) Increase water loading at the venturi; 3) Reduce the drilling rate; 4) Use wetting agents; and/or 5) Implement additional solids filtration of working water. Such additional effort shall continue until drilling is clear of significant serpentine/asbestos.

Condition 2: Administrative

- A. This permit has been issued as a modification to include cleanout, forking or deepening of the well as described in the application and permit review. This permit does not establish a precedent for the issuance of additional permits.
- B. The submitted BRP (Tecton) H₂S abatement plan approved by the APCO shall be implemented and followed, and is incorporated herein by reference. Logbook entries shall be made a minimum of four (4) times daily while drilling on air or in steam.
- C. Diesel fuel utilized shall be California Low Sulfur Diesel containing less than 15ppmw sulfur.
- D. If a vapor-dominated resource is encountered and it is determined that emissions cannot be maintained pursuant to Parts A & B of LCAQMD Rule 421; or the APCO determines that the well on stand-by (bleed) status will violate the intent of LCAQMD Rule 602 or the associated steamfield permit, then BRP shall, with approval of the APCO, install and utilize additional abatement equipment as necessary to bring emissions into compliance. This may include, but is not limited to, immediate conversion to an injector, gas capping, down-hole plugging, and/or the complete closing in of any well in violation of LCAQMD Rules and Regulations.
- E. BRP shall utilize the particulate scrubbing system as substantially described in the permitting review and includes the following configuration: 1) A smooth expansion blooie line with low-pressure constricting and non-constricting interchangeable venturis with water injection for venturi contact/scrubbing. The non-constricting venturi

(Conditions 2 through 6 are continued on the back of this card)

THIS PERMIT BECOMES VOID UPON CHANGE OF OWNERSHIP OR LOCATION

This permit does not authorize the emission of air contaminants in excess of those allowed by the California Health and Safety Code or the Regulations of the Lake County Air Quality Management District. This permit cannot be considered permission to violate existing laws, ordinances, regulations, or statutes of other government agencies. The provisions of this Permit are severable. If any provision of this Permit is held invalid, the remainder of this Permit shall not be affected thereby.



AUTHORITY TO CONSTRUCT

Lake County Air Quality Management District

2617 S. Main Street, Lakeport, CA 95453 (707) 263-7000, Fax (707) 263-0421

Permit # A/C 2005-45

By: Douglas Gearhart
Douglas G. Gearhart, APCO

Type of Issuance: Renewal

Issuance Date: 10/31/2020 Valid through: 10/31/2021 Category: IV

Operations under this permit must be conducted in compliance with all specifications and data included with the application under which this permit was issued. Equipment must be properly maintained and kept in good condition at all times. Post this permit or a facsimile (with conditions) in a conspicuous location on or near the equipment.

Contact: Ms. Alice Bray
Owner: Bottle Rock Power, LLC
Mailing: 4010 Stone Way N, Suite 400
Address: Seattle, WA 98103

Facility: West Coleman Padsite
Location: West Coleman 4-6, located on Bottle Rock West Coleman Padsite (1155m So. & 134.9m W of the NE Corner Section 6, T11N, R8W, MDB&M, Lake County, N 397,334 E 1,797,546)

Name and Equipment Description: W. Coleman 4-6 Re-Drill

Geothermal drilling rig and accessories (NCPA Rig #1), Four electrical generators (CAT D-398TA 750 HP diesel engines PERP Registered), three air compressors (Cummins QSK19-C700 700 HP turbocharged diesel-powered air compressors PERP Registered), one down hole misting pump; hydrogen sulfide abatement system utilizing high pressure injection of NaOH and H₂O₂; and particulate control equipment consisting of misting down hole, constricting and non constricting venturi contactors, low pressure water spray, expanding blooie line, properly sized, smoothed, tangential wet cyclone, properly designed drop or hopper, water treatment and management systems, necessary metering and measuring devices and associated equipment.

Permit Conditions

Condition 1: Emissions

- A. Bottle Rock Power, LLC (BRP) shall limit hydrogen sulfide (H₂S) emissions during drilling, clean out, and testing to no more than five (5) pounds of H₂S per hour and no more than twenty-four (24) pounds per day during all other phases of this project. During verifiable breakdown and for any hot-liner runs, Rule 510 and procedures shall apply. In the event of atmospheric conditions (e.g., drainage, limited mixing, fumigation, downwash, etc.) that result in complaints and concern in receptor areas from high levels of H₂S, BRP agrees to reduce the H₂S emission limit to two (2) pounds of H₂S using abatement plan at the request of the Air Pollution Control Officer (APCO). Certain exceptions to the H₂S emission limitations may be allowed by the APCO, in writing, for resource testing if such tests are 12 hours or less in duration and coincide with acceptable meteorological conditions verified by the APCO to ensure good dispersion.
- B. If excessively high H₂S levels are encountered during drilling, BRP will either: 1) Place into operation additional H₂S abatement capacity, or 2) Cease operation and close in the well according to appropriate standards of operation. For the purposes of this permit, excessively high levels of H₂S means abated emissions greater than five (5) pounds of H₂S per hour or abated emission levels in excess of 500 ppmv.
- C. Visible emissions shall not exceed the values listed below for more than three (3) minutes in any one (1) hour: • Ringelmann 0.5 (10% opacity) for detached plume at the cyclone; • Ringelmann 0.5 (10% opacity) for combustion emissions of engine exhaust; and • Ringelmann 1 (20% opacity) for road and pad dust emissions.
- D. On commencement of air drilling in significant serpentine, the well logger shall obtain bulk samples that shall be analyzed for asbestos content using TEM, SEM or PLM (California Air Resources Board [ARB] Method 435 Procedures). For the purpose of defining a significant serpentine deposit during geothermal air drilling: "Significant Serpentine" shall mean; drill cutting samples from two consecutive ten-foot interval-drilling sections identified as having 10% or greater serpentine or other asbestos-containing rock. The Lake County Air Quality Management District (LCAQMD) shall be promptly notified by phone at 263-7000, provided samples of the drilled material, and unless otherwise agreed upon in writing, notified of the bulk asbestos analysis results within ten working days of sampling.
- E. During drilling in significant serpentine visible emissions shall not exceed Ringelmann 0.25 (5% opacity) for detached plume at the cyclone. BRP shall: 1) Increase down hole misting; 2) Increase water loading at the venturi; 3) Reduce the drilling rate; 4) Use wetting agents; and/or 5) Implement additional solids filtration of working water. Such additional effort shall continue until drilling is clear of significant serpentine/asbestos.

Condition 2: Administrative

- A. This permit has been issued as a modification to include cleanout, forking or deepening of the well as described in the application and permit review. This permit does not establish a precedent for the issuance of additional permits.
- B. The submitted BRP (Tecton) H₂S abatement plan approved by the APCO shall be implemented and followed, and is incorporated herein by reference. Logbook entries shall be made a minimum of four (4) times daily while drilling on air or in steam.
- C. Diesel fuel utilized shall be California Low Sulfur Diesel containing less than 15ppmw sulfur.
- D. If a vapor-dominated resource is encountered and it is determined that emissions cannot be maintained pursuant to Parts A & B of LCAQMD Rule 421; or the APCO determines that the well on stand-by (bleed) status will violate the intent of LCAQMD Rule 602 or the associated steamfield permit, then BRP shall, with approval of the APCO, install and utilize additional abatement equipment as necessary to bring emissions into compliance. This may include, but is not limited to, immediate conversion to an injector, gas capping, down-hole plugging, and/or the complete closing in of any well in violation of LCAQMD Rules and Regulations.
- E. BRP shall utilize the particulate scrubbing system as substantially described in the permitting review and includes the following configuration: 1) A smooth expansion blooie line with low-pressure constricting and non-constricting interchangeable venturis with water injection for venturi contact/scrubbing. The non-constricting venturi

(Conditions 2 through 6 are continued on the back of this card)

THIS PERMIT BECOMES VOID UPON CHANGE OF OWNERSHIP OR LOCATION

This permit does not authorize the emission of air contaminants in excess of those allowed by the California Health and Safety Code or the Regulations of the Lake County Air Quality Management District. This permit cannot be considered permission to violate existing laws, ordinances, regulations, or statutes of other government agencies. The provisions of this Permit are severable. If any provision of this Permit is held invalid, the remainder of this Permit shall not be affected thereby.



AUTHORITY TO CONSTRUCT

Lake County Air Quality Management District

2617 S. Main Street, Lakeport, CA 95453 (707) 263-7000, Fax (707) 263-0421

Permit # A/C 2005-48

By: *Douglas Gearhart*

Douglas G. Gearhart, APCO

Type of Issuance: Renewal Issuance Date: 10/31/2020 Valid through: 10/31/2021 Category: IV

Operations under this permit must be conducted in compliance with all specifications and data included with the application under which this permit was issued. Equipment must be properly maintained and kept in good condition at all times. Post this permit or a facsimile (with conditions) in a conspicuous location on or near the equipment.

Contact: Ms. Alice Bray
Owner: Bottle Rock Power, LLC
Mailing: 4010 Stone Way N, Suite 400
Address: Seattle, WA 98103

Facility: West Coleman Padsite
Location: West Coleman 5-6, located on Bottle Rock West Coleman Padsite (1155m So. & 134.9m W of the NE Corner Section 6, T11N, R8W, MDB&M, Lake County, N 397,334 E 1,797,546)

Name and Equipment Description: W. Coleman 5-6 Re-Drill

Geothermal drilling rig and accessories (NCPA Rig #1), Four electrical generators (CAT D-398TA 750 HP diesel engines PERP Registered), three air compressors (Cummins QSK19-C700 700 HP turbocharged diesel-powered air compressors PERP Registered), one down hole misting pump; hydrogen sulfide abatement system utilizing high pressure injection of NaOH and H₂O₂; and particulate control equipment consisting of misting down hole, constricting and non constricting venturi contactors, low pressure water spray, expanding blooie line, properly sized, smoothed, tangential wet cyclone, properly designed drop or hopper, water treatment and management systems, necessary metering and measuring devices and associated equipment.

Permit Conditions

Condition 1: Emissions

- A. Bottle Rock Power, LLC (BRP) shall limit hydrogen sulfide (H₂S) emissions during drilling, clean out, and testing to no more than five (5) pounds of H₂S per hour and no more than twenty-four (24) pounds per day during all other phases of this project. During verifiable breakdown and for any hot-liner runs, Rule 510 and procedures shall apply. In the event of atmospheric conditions (e.g., drainage, limited mixing, fumigation, downwash, etc.) that result in complaints and concern in receptor areas from high levels of H₂S, BRP agrees to reduce the H₂S emission limit to two (2) pounds of H₂S using abatement plan at the request of the Air Pollution Control Officer (APCO). Certain exceptions to the H₂S emission limitations may be allowed by the APCO, in writing, for resource testing if such tests are 12 hours or less in duration and coincide with acceptable meteorological conditions verified by the APCO to ensure good dispersion.
- B. If excessively high H₂S levels are encountered during drilling, BRP will either: 1) Place into operation additional H₂S abatement capacity, or 2) Cease operation and close in the well according to appropriate standards of operation. For the purposes of this permit, excessively high levels of H₂S means abated emissions greater than five (5) pounds of H₂S per hour or abated emission levels in excess of 500 ppmv.
- C. Visible emissions shall not exceed the values listed below for more than three (3) minutes in any one (1) hour: • Ringelmann 0.5 (10% opacity) for detached plume at the cyclone; • Ringelmann 0.5 (10% opacity) for combustion emissions of engine exhaust; and • Ringelmann 1 (20% opacity) for road and pad dust emissions.
- D. On commencement of air drilling in significant serpentine, the well logger shall obtain bulk samples that shall be analyzed for asbestos content using TEM, SEM or PLM (California Air Resources Board [ARB] Method 435 Procedures). For the purpose of defining a significant serpentine deposit during geothermal air drilling: "Significant Serpentine" shall mean; drill cutting samples from two consecutive ten-foot interval-drilling sections identified as having 10% or greater serpentine or other asbestos-containing rock. The Lake County Air Quality Management District (LCAQMD) shall be promptly notified by phone at 263-7000, provided samples of the drilled material, and unless otherwise agreed upon in writing, notified of the bulk asbestos analysis results within ten working days of sampling.
- E. During drilling in significant serpentine visible emissions shall not exceed Ringelmann 0.25 (5% opacity) for detached plume at the cyclone. BRP shall: 1) Increase down hole misting; 2) Increase water loading at the venturi; 3) Reduce the drilling rate; 4) Use wetting agents; and/or 5) Implement additional solids filtration of working water. Such additional effort shall continue until drilling is clear of significant serpentine/asbestos.

Condition 2: Administrative

- A. This permit has been issued as a modification to include cleanout, forking or deepening of the well as described in the application and permit review. This permit does not establish a precedent for the issuance of additional permits.
- B. The submitted BRP (Tecton) H₂S abatement plan approved by the APCO shall be implemented and followed, and is incorporated herein by reference. Logbook entries shall be made a minimum of four (4) times daily while drilling on air or in steam.
- C. Diesel fuel utilized shall be California Low Sulfur Diesel containing less than 15ppmw sulfur.
- D. If a vapor-dominated resource is encountered and it is determined that emissions cannot be maintained pursuant to Parts A & B of LCAQMD Rule 421; or the APCO determines that the well on stand-by (bleed) status will violate the intent of LCAQMD Rule 602 or the associated steamfield permit, then BRP shall, with approval of the APCO, install and utilize additional abatement equipment as necessary to bring emissions into compliance. This may include, but is not limited to, immediate conversion to an injector, gas capping, down-hole plugging, and/or the complete closing in of any well in violation of LCAQMD Rules and Regulations.
- E. BRP shall utilize the particulate scrubbing system as substantially described in the permitting review and includes the following configuration: 1) A smooth expansion blooie line with low-pressure constricting and non-constricting interchangeable venturis with water injection for venturi contact/scrubbing. The non-constricting venturi

(Conditions 2 through 6 are continued on the back of this card)

THIS PERMIT BECOMES VOID UPON CHANGE OF OWNERSHIP OR LOCATION

This permit does not authorize the emission of air contaminants in excess of those allowed by the California Health and Safety Code or the Regulations of the Lake County Air Quality Management District. This permit cannot be considered permission to violate existing laws, ordinances, regulations, or statutes of other government agencies. The provisions of this Permit are severable. If any provision of this Permit is held invalid, the remainder of this Permit shall not be affected thereby.

GAMP PARTICIPATION - PROOF OF PAYMENT

Print

Check Number 69903037

Amount USD 14,214.00

Cleared Date 05/04/23

Pay To GAMP VI c/o NSCAPCD

Bills Paid With This Check

Invoice #	Due Date	Amount	Payment Amount
VI-22-02	01/01/23	USD 14,214.00	USD 14,214.00

Page 1

Remittance Info: Inv #VI-22-02

Bottle Rock Power LLC

4010 Stone Way N

Suite 400

Seattle, WA 98103

2062850883

JPMorgan Chase Bank, N.A.

Verify: 888-237-9615

90-7162/3222

0069903037

PAY TO THE ORDER OF

GEYSERS AIR MONITORING PROGRAM

\$ 14214.00

Fourteen Thousand Two Hundred Fourteen and 00/100

DOLLARS

VOID AFTER 90 DAYS

3,9181

GEYSERS AIR MONITORING PROGRAM

150 MATHESON STREET

GEYSERS AIR MONITORING PROGRAM

HEALDSBURG, CA 95448

John Rottg

Bill.com, LLC, Issuer

MP

0069903037

322271627

215376176

Page 2

ENDORSE HERE

NORTHERN SONOMA COUNTY

AIR POLLUTION CONTROL DISTRICT

150 Matheson Street

Healdsburg, California 95443

CHECK HERE FOR DEPOSIT ONLY

NAME OF FINANCIAL INSTITUTION

DATE

DO NOT WRITE, STAMP OR SIGN BELOW THIS LINE

RESERVED FOR FINANCIAL INSTITUTION USE *

0/4/2023 00000296 2

The security features listed below, as well as those not listed, exceed industry guidelines.

Security Features:

Results of document alteration:

• All serial type numbers as defined in the provided security screen

• Stamps or spots may appear with chemical alteration

• Absence of "Original" document markings on back of check

X Payment out # P23032301 - 1465890

< Previous payment

Processed

Sent

03/24/23

03/27/23

Check

Cleared

USD 14,214.00 check payment to [GAMP VI c/o NSCAPCD](#) created by Ka

Payment out # P23032301 - 1465890

Process date

03/24/23

Arrival date ⓘ

03/30/23

Payment add

GEYSERS A

Paid from

City National Bank*****9530

Memo

Inv #VI-22-02-- bill.com Check Numb...

Total payment

USD 14,214.

Account

Bill.com Money Out Clearing

Total vendor

USD 0.00

Check #

69903037


Check date

03/27/23

Check expirat

06/25/23

Check images



[Print](#)



Appendix 3

Figure 1 - Vegetation Monitoring Map

Table 1 – Vegetation & Soil Boron Analytical Results

Vegetation & Soil Boron Analytical Reports

Figure 2 – Water Monitoring Map

Table 2 – Groundwater & Surface Water Analytical Results

Groundwater & Surface Water Analytical Reports

FIGURE 1. Bottle Rock Power, LLC - Vegetation Monitoring Locations

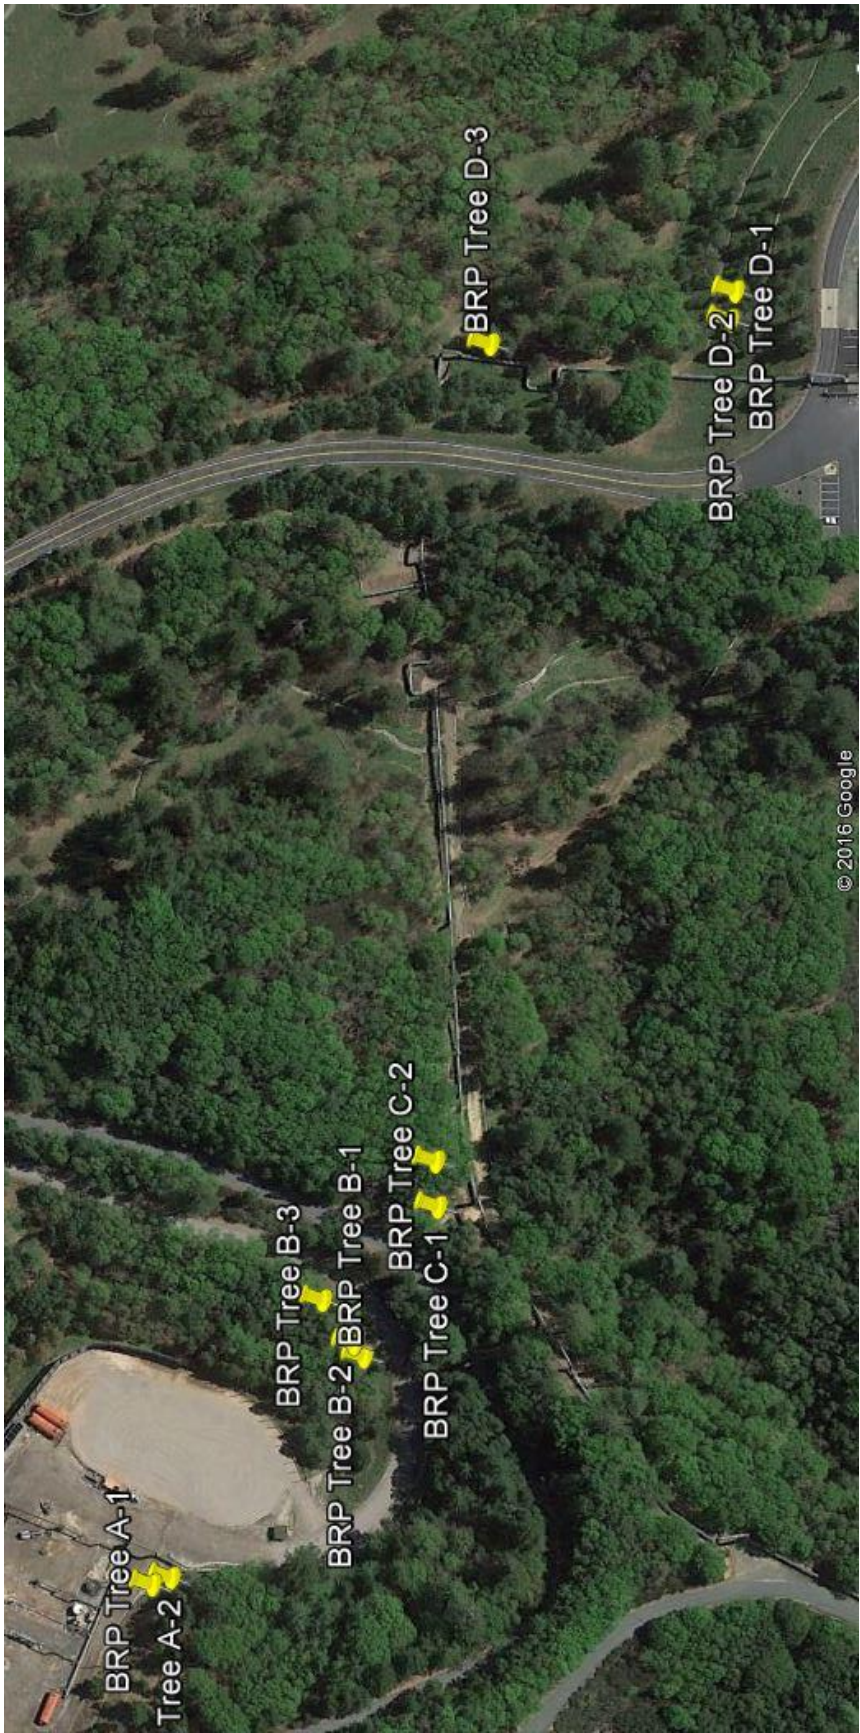


Table 1
Bottle Rock Power, LLC
2022 Vegetation Monitoring Data Needle & Soil Boron Analytical Results

Location ID	UTM Coordinates	Location Description	Sample Type	Boron (mg/kg)	Sample Type	Boron (mg/kg)
A-1	38.83734 -122.77257	Coleman Pad A3-a	Ponderosa Pine Needle	34	Base of Tree Soil	17
A-2	38.83729 -122.77255	Coleman Pad A3-b	Ponderosa Pine Needle	25	Base of Tree Soil	17
B-1	38.83675 -122.77177	West Coleman/Coleman Road BB1-a	Ponderosa Pine Needle	36	Base of Tree Soil	18
B-2	38.83678 -122.77173	West Coleman/Coleman Road (previously BB1-b) now B-2	Ponderosa Pine Needle	8	Base of Tree Soil	23
B-3	38.83687 -122.77157	West Coleman/Coleman Road previously BB1-c	Ponderosa Pine Needle	23	Base of Tree Soil	19
C-1	38.83655 -122.77121	Access Road C-1	Ponderosa Pine Needle	43	Base of Tree Soil	17
C-2	38.83655 -122.77105	Access Road C-2	Ponderosa Pine Needle	10	Base of Tree Soil	15
D-1	38.83574 -122.76807	North of Plant Fence Line D-1	Ponderosa Pine Needle	8	Base of Tree Soil	20
D-2	38.83572 -122.76796	North of Plant Fence Line D-2 (previously D-6)	Ponderosa Pine Needle	15	Base of Tree Soil	15
D-3	38.8364 -122.76813	North of Plant Fence Line DD-2 (previously DD-2a & b)	Ponderosa Pine Needle	10	Base of Tree Soil	19

ND - Not Detected

NA - Not Analyzed



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

03 January 2023

Bottle Rock Power

Attn: M. Moore

4010 Stone Way North, Suite 400

Seattle, WA 98103

RE: Annual Needles

Work Order: 22L3434

Enclosed are the results of analyses for samples received by the laboratory on 12/22/22 12:45. If you have any questions concerning this report, please feel free to contact me.

Sincerely,

Stephen F. McWeeney

Project Manager



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Annual Needles
Project Number: [none]

Reported:
01/03/23 09:33

Bay Area: 262 Rickenbacker Circle | Livermore, CA 94551 | 925-828-6226 | ELAP# 2728
Central Valley: 9090 Union Park Way Suite 113 | Elk Grove, CA 95624 | 916-686-5190 | ELAP# 2922
North Bay: 737 Southpoint Blvd Unit D | Petaluma, CA 94954 | 707-769-3128 | ELAP# 2303
San Diego: 2722 Loker Avenue West Suite A | Carlsbad, CA 92010 | 760-930-2555 | ELAP# 3055
Los Angeles: 1230 E. 223rd Street Suite 205 | Carson, CA 90745 | 424-267-5032 | Service Center

ANALYTICAL REPORT FOR SAMPLES

Sample ID	Laboratory ID	Matrix	Date Sampled	Date Received
A-1	22L3434-01	Other (W)	12/22/22 06:30	12/22/22 12:45
A-2	22L3434-02	Other (W)	12/22/22 06:40	12/22/22 12:45
B-1	22L3434-03	Other (W)	12/22/22 06:50	12/22/22 12:45
B-2	22L3434-04	Other (W)	12/22/22 07:00	12/22/22 12:45
B-3	22L3434-05	Other (W)	12/22/22 07:10	12/22/22 12:45
C-1	22L3434-06	Other (W)	12/22/22 07:20	12/22/22 12:45
C-2	22L3434-07	Other (W)	12/22/22 07:30	12/22/22 12:45
D-1	22L3434-08	Other (W)	12/22/22 07:40	12/22/22 12:45
D-2	22L3434-09	Other (W)	12/22/22 07:50	12/22/22 12:45
D-3	22L3434-10	Other (W)	12/22/22 08:00	12/22/22 12:45



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Annual Needles
Project Number: [none]

Reported:
01/03/23 09:33

	Result	Units	Reporting Limit	Dilution	Batch	Prepared	Analyzed	ELAP#	Method	Note
A-1 (22L3434-01)			Sample Type: Other (W)			Sampled: 12/22/22 06:30				
Metals by EPA 6000/7000 Series Methods										
Boron	34	mg/kg	5.0	1	AL25076	12/27/22 07:24	12/28/22 10:45	2303	EPA 6010B	
A-2 (22L3434-02)			Sample Type: Other (W)			Sampled: 12/22/22 06:40				
Metals by EPA 6000/7000 Series Methods										
Boron	25	mg/kg	5.0	1	AL25076	12/27/22 07:24	12/28/22 10:48	2303	EPA 6010B	
B-1 (22L3434-03)			Sample Type: Other (W)			Sampled: 12/22/22 06:50				
Metals by EPA 6000/7000 Series Methods										
Boron	36	mg/kg	5.0	1	AL25076	12/27/22 07:24	12/28/22 10:51	2303	EPA 6010B	
B-2 (22L3434-04)			Sample Type: Other (W)			Sampled: 12/22/22 07:00				
Metals by EPA 6000/7000 Series Methods										
Boron	7.7	mg/kg	5.0	1	AL25076	12/27/22 07:24	12/28/22 10:54	2303	EPA 6010B	
B-3 (22L3434-05)			Sample Type: Other (W)			Sampled: 12/22/22 07:10				
Metals by EPA 6000/7000 Series Methods										
Boron	23	mg/kg	5.0	1	AL25076	12/27/22 07:24	12/28/22 10:58	2303	EPA 6010B	
C-1 (22L3434-06)			Sample Type: Other (W)			Sampled: 12/22/22 07:20				
Metals by EPA 6000/7000 Series Methods										
Boron	43	mg/kg	5.0	1	AL25076	12/27/22 07:24	12/28/22 11:01	2303	EPA 6010B	
C-2 (22L3434-07)			Sample Type: Other (W)			Sampled: 12/22/22 07:30				
Metals by EPA 6000/7000 Series Methods										
Boron	10	mg/kg	5.0	1	AL25076	12/27/22 07:24	12/28/22 11:04	2303	EPA 6010B	
D-1 (22L3434-08)			Sample Type: Other (W)			Sampled: 12/22/22 07:40				
Metals by EPA 6000/7000 Series Methods										
Boron	8.4	mg/kg	5.0	1	AL25076	12/27/22 07:24	12/28/22 11:13	2303	EPA 6010B	
D-2 (22L3434-09)			Sample Type: Other (W)			Sampled: 12/22/22 07:50				
Metals by EPA 6000/7000 Series Methods										
Boron	15	mg/kg	5.0	1	AL25076	12/27/22 07:24	12/28/22 11:16	2303	EPA 6010B	
D-3 (22L3434-10)			Sample Type: Other (W)			Sampled: 12/22/22 08:00				
Metals by EPA 6000/7000 Series Methods										
Boron	10	mg/kg	5.0	1	AL25076	12/27/22 07:24	12/28/22 11:19	2303	EPA 6010B	



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Annual Needles
Project Number: [none]

Reported:
01/03/23 09:33

Metals by EPA 6000/7000 Series Methods - Quality Control

Analyte(s)	Result	Reporting Limit	Units	Spike Level	Source Result	%REC Limits	RPD	RPD Limit	Flag
Batch AL25076 - NB EPA 3050B									
Blank (AL25076-BLK1)				Prepared: 12/27/22 Analyzed: 12/28/22					
Boron	ND	5.0	mg/kg						
LCS (AL25076-BS1)				Prepared: 12/27/22 Analyzed: 12/28/22					
Boron	211	5.0	mg/kg	250		84.2	80-120		
LCS Dup (AL25076-BSD1)				Prepared: 12/27/22 Analyzed: 12/28/22					
Boron	224	5.0	mg/kg	250		89.7	80-120	6.35	20
Matrix Spike (AL25076-MS1)				Source: 22L3434-01		Prepared: 12/27/22 Analyzed: 12/28/22			
Boron	229	5.0	mg/kg	248	34.1	78.8	75-125		
Matrix Spike Dup (AL25076-MSD1)				Source: 22L3434-01		Prepared: 12/27/22 Analyzed: 12/28/22			
Boron	246	5.0	mg/kg	248	34.1	85.7	75-125	7.27	20



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Annual Needles
Project Number: [none]

Reported:
01/03/23 09:33

Notes and Definitions

- ND Analyte NOT DETECTED at or above the reporting limit
- dry Sample results reported on a dry weight basis
- REC Recovery
- RPD Relative Percent Difference

Non-accredited analytes are reported only when ELAP accreditation for a requested analyte method pair is not available. For a list of accredited analytes, view our certificates at the Company link on our website at www.alpha-labs.com or contact your Project Manager directly.



Corporate Laboratory (1551)
208 Mason Street, Ukiah CA 95482
707.468.0401 (phone)
707.468.5267 (fax)
clientservices@alpha-labs.com

North Bay Laboratory (2303)
737 Southpoint Blvd, Ste D, Petaluma 94954

Bay Area Laboratory (2728)
262 Rickenbacker Circle, Livermore CA 94551

Central Valley Laboratory (2922)
9090 Union Park Way #113, Elk Grove CA 95624

San Diego Service Center
2722 Loker Ave West, Ste A, Carlsbad CA 92010

Chain of Custody - Work Order

Reports and Invoices delivered by email in PDF format

Lab No 22L3434 Pg _____ of _____

Report to		Invoice to (if different)		Project Information		Signature below authorizes work under terms stated on reverse side.															
Company:		Contact:		Project ID:		Analysis Request															
Bottle Rock Power				Annual Pine Needles																	
Attn:		Email address:		Project No:																	
Jay Hopper																					
Address:		Address:		PO Number:																	
PO Box 326																					
Cobb, CA 95426																					
Phone/Fax:		Phone/Fax:																			
707-529-3799																					
Email Address:																					
Field Sampler - Printed Name & Signature:				Container		Preservative		Matrix		Total Number of Containers per Sample ID		Boron		Field pH		Field TDS ppm		TAT		TEMP °C	
<i>Richard Lacy</i>				40ml VOA Vial		HCl HNO3 H2SO4 Other None		Drinking Water Wastewater Soil Other										Standard 10 days		Ukiah	
Sample Identification		Sampling																RUSH:		Livermore	
		Date	Time															5 days		Elk Grove	
A-1		12/2/22	6:30								1	X						<input checked="" type="radio"/>			
A-2 A-2		1	6:40								1	X						<input type="radio"/>			
B-1			6:50								1	X						<input type="radio"/>			
B-2			7:00								1	X						<input type="radio"/>			
B-3			7:10								1	X						<input type="radio"/>			
C-1			7:20								1	X						<input type="radio"/>			
C-2			7:30								1	X						<input type="radio"/>			
A-1			7:40								1	X						<input type="radio"/>	Petaluma 21.4		
A-2			7:50								1	X						<input type="radio"/>	Carlsbad		
D-3			8:00															<input type="radio"/>			
Relinquished by				Received by				Date		Time		DDW Write On EDT Transmission? <input type="radio"/> Yes <input type="radio"/> No									
<i>Richard Lacy</i>				<i>Thomg</i>				12/2/22		1245		State System Number: _____									
												If "Y" please enter the Source Number(s) in the column above									
												CA Geotracker EDF Report? <input type="radio"/> Yes <input type="radio"/> No									
												Global ID: _____ Sampling Company Log Code: _____									
												EDF to (Email Address): _____									
												Travel and Site Time: _____ Mileage: _____ Misc. Supplies: _____									



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

03 January 2023

Bottle Rock Power

Attn: M. Moore

4010 Stone Way North, Suite 400

Seattle, WA 98103

RE: Annual Soil

Work Order: 22L3439

Enclosed are the results of analyses for samples received by the laboratory on 12/22/22 12:45. If you have any questions concerning this report, please feel free to contact me.

Sincerely,

Stephen F. McWeeney

Project Manager



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Annual Soil
Project Number: [none]

Reported:
01/03/23 09:32

Bay Area: 262 Rickenbacker Circle | Livermore, CA 94551 | 925-828-6226 | ELAP# 2728
Central Valley: 9090 Union Park Way Suite 113 | Elk Grove, CA 95624 | 916-686-5190 | ELAP# 2922
North Bay: 737 Southpoint Blvd Unit D | Petaluma, CA 94954 | 707-769-3128 | ELAP# 2303
San Diego: 2722 Loker Avenue West Suite A | Carlsbad, CA 92010 | 760-930-2555 | ELAP# 3055
Los Angeles: 1230 E. 223rd Street Suite 205 | Carson, CA 90745 | 424-267-5032 | Service Center

ANALYTICAL REPORT FOR SAMPLES

Sample ID	Laboratory ID	Matrix	Date Sampled	Date Received
A-1	22L3439-01	Soil	12/22/22 06:30	12/22/22 12:45
A-2	22L3439-02	Other (W)	12/22/22 06:40	12/22/22 12:45
B-1	22L3439-03	Other (W)	12/22/22 06:50	12/22/22 12:45
B-2	22L3439-04	Other (W)	12/22/22 07:00	12/22/22 12:45
B-3	22L3439-05	Other (W)	12/22/22 07:10	12/22/22 12:45
C-1	22L3439-06	Other (W)	12/22/22 07:20	12/22/22 12:45
C-2	22L3439-07	Other (W)	12/22/22 07:30	12/22/22 12:45
D-1	22L3439-08	Other (W)	12/22/22 07:40	12/22/22 12:45
D-2	22L3439-09	Other (W)	12/22/22 07:50	12/22/22 12:45
D-3	22L3439-10	Other (W)	12/22/22 08:00	12/22/22 12:45



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Annual Soil
Project Number: [none]

Reported:
01/03/23 09:32

	Result	Units	Reporting Limit	Dilution	Batch	Prepared	Analyzed	ELAP#	Method	Note
A-1 (22L3439-01)			Sample Type: Soil			Sampled: 12/22/22 06:30				
Metals by EPA 6000/7000 Series Methods										
Boron	17	mg/kg	5.0	1	AL25077	12/27/22 07:29	12/28/22 11:38	2303	EPA 6010B	
A-2 (22L3439-02)			Sample Type: Other (W)			Sampled: 12/22/22 06:40				
Metals by EPA 6000/7000 Series Methods										
Boron	17	mg/kg	5.0	1	AL25077	12/27/22 07:29	12/28/22 11:41	2303	EPA 6010B	
B-1 (22L3439-03)			Sample Type: Other (W)			Sampled: 12/22/22 06:50				
Metals by EPA 6000/7000 Series Methods										
Boron	18	mg/kg	5.0	1	AL25077	12/27/22 07:29	12/28/22 11:50	2303	EPA 6010B	
B-2 (22L3439-04)			Sample Type: Other (W)			Sampled: 12/22/22 07:00				
Metals by EPA 6000/7000 Series Methods										
Boron	23	mg/kg	5.0	1	AL25077	12/27/22 07:29	12/28/22 11:53	2303	EPA 6010B	
B-3 (22L3439-05)			Sample Type: Other (W)			Sampled: 12/22/22 07:10				
Metals by EPA 6000/7000 Series Methods										
Boron	19	mg/kg	5.0	1	AL25077	12/27/22 07:29	12/28/22 11:56	2303	EPA 6010B	
C-1 (22L3439-06)			Sample Type: Other (W)			Sampled: 12/22/22 07:20				
Metals by EPA 6000/7000 Series Methods										
Boron	17	mg/kg	5.0	1	AL25077	12/27/22 07:29	12/28/22 11:59	2303	EPA 6010B	
C-2 (22L3439-07)			Sample Type: Other (W)			Sampled: 12/22/22 07:30				
Metals by EPA 6000/7000 Series Methods										
Boron	15	mg/kg	5.0	1	AL25077	12/27/22 07:29	12/28/22 12:02	2303	EPA 6010B	
D-1 (22L3439-08)			Sample Type: Other (W)			Sampled: 12/22/22 07:40				
Metals by EPA 6000/7000 Series Methods										
Boron	20	mg/kg	5.0	1	AL25077	12/27/22 07:29	12/28/22 12:05	2303	EPA 6010B	
D-2 (22L3439-09)			Sample Type: Other (W)			Sampled: 12/22/22 07:50				
Metals by EPA 6000/7000 Series Methods										
Boron	15	mg/kg	5.0	1	AL25077	12/27/22 07:29	12/28/22 12:09	2303	EPA 6010B	
D-3 (22L3439-10)			Sample Type: Other (W)			Sampled: 12/22/22 08:00				
Metals by EPA 6000/7000 Series Methods										
Boron	19	mg/kg	5.0	1	AL25077	12/27/22 07:29	12/28/22 12:12	2303	EPA 6010B	



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Annual Soil
Project Number: [none]

Reported:
01/03/23 09:32

Metals by EPA 6000/7000 Series Methods - Quality Control

Analyte(s)	Result	Reporting Limit	Units	Spike Level	Source Result	%REC Limits	RPD	RPD Limit	Flag
Batch AL25077 - NB EPA 3050B									
Blank (AL25077-BLK1)				Prepared: 12/27/22 Analyzed: 12/28/22					
Boron	ND	5.0	mg/kg						
LCS (AL25077-BS1)				Prepared: 12/27/22 Analyzed: 12/28/22					
Boron	210	5.0	mg/kg	250	84.1	80-120			
LCS Dup (AL25077-BSD1)				Prepared: 12/27/22 Analyzed: 12/28/22					
Boron	220	5.0	mg/kg	250	88.2	80-120	4.77	20	
Matrix Spike (AL25077-MS1)				Source: 22L3439-01 Prepared: 12/27/22 Analyzed: 12/28/22					
Boron	205	5.0	mg/kg	248	16.5	76.1	75-125		
Matrix Spike Dup (AL25077-MSD1)				Source: 22L3439-01 Prepared: 12/27/22 Analyzed: 12/28/22					
Boron	210	5.0	mg/kg	248	16.5	78.3	75-125	2.54	20



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103


Project Manager: M. Moore
Project: Annual Soil
Project Number: [none]

Reported:
01/03/23 09:32

Notes and Definitions

- ND Analyte NOT DETECTED at or above the reporting limit
- dry Sample results reported on a dry weight basis
- REC Recovery
- RPD Relative Percent Difference

Non-accredited analytes are reported only when ELAP accreditation for a requested analyte method pair is not available. For a list of accredited analytes, view our certificates at the Company link on our website at www.alpha-labs.com or contact your Project Manager directly.

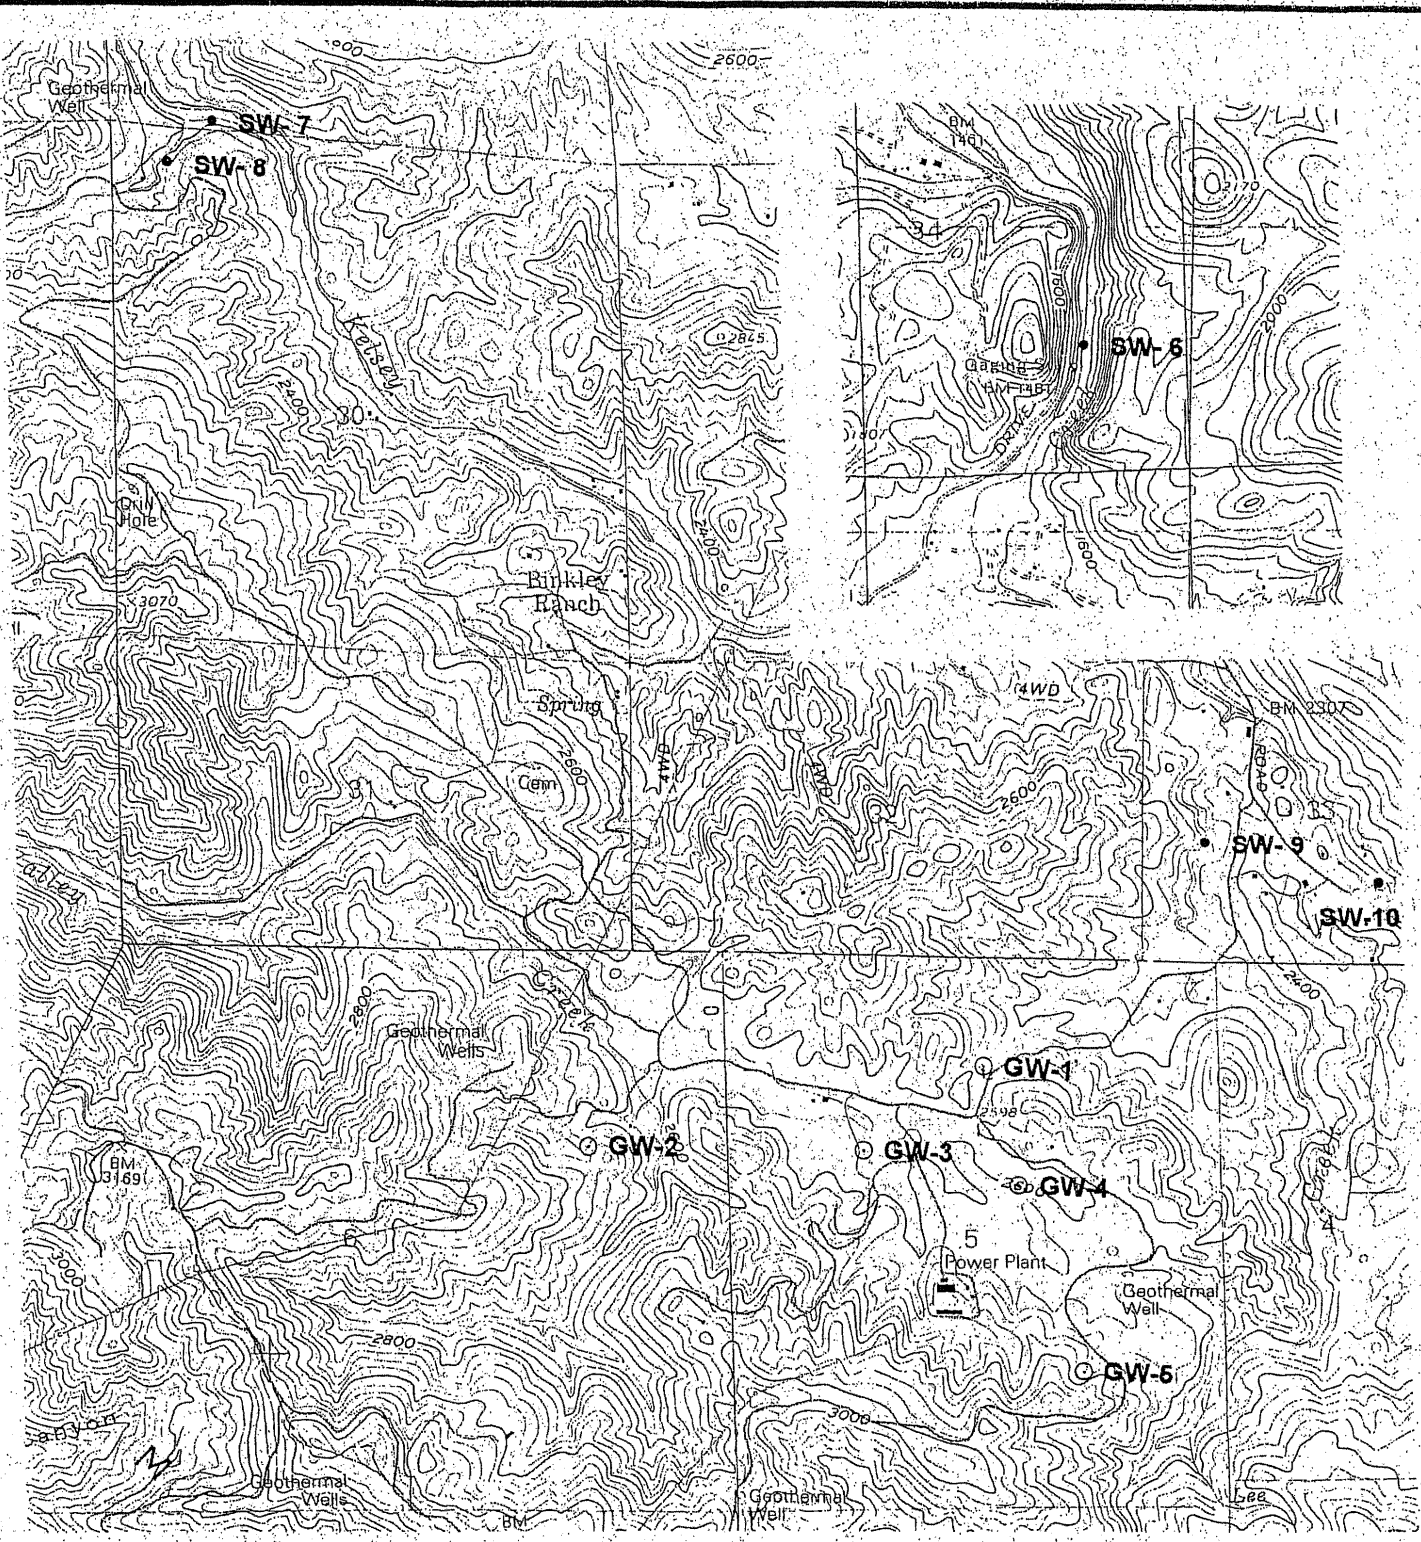

Bottle Rock Monitoring Program
Water Quality Sample
Locations

Scale: 1inch = 2000 feet

Project No: 0068-026-02

Date: June 2003

FIGURE 2

Table 2
Bottle Rock Power, LLC
2022 Ground Water and Surface Water Monitoring
1st Quarter Analytical Results

Location ID	GPS Coordinates	Location & Description	Arsenic μg/l	Calcium mg/l	Magnesium mg/l	Hardness mg/l	Boron mg/l	Copper mg/l	Iron mg/l	Lead mg/l	Manganese mg/l	Sodium mg/l	Zinc mg/l	pH	Electrical Conductivity umhos/cm	Dissolved Oxygen mg/l	Turbidity NTU	Total Alkalinity mg/l	Nitrate mg/l	Sulfate mg/l	Total Suspended Solids mg/l	Total Coliform MPN/100mL
GW-1	38 50' 27.84" N 122 45' 59.07" W	Barret Spring; Running seep at sharp turn, downslope on High Valley Road	ND	49	16	190	0.10	ND	ND	ND	0.11	8.9	ND	7.60	580	NA	ND	180	ND	20	ND	NA
GW-3	38 50' 21.57" N 122 46' 17.46 W	BRP WW1; Northern most water supply well	ND	35	11	130	0.42	ND	0.50	ND	0.11	25	ND	7.86	550	NA	1.6	170	ND	5.9	2.0	NA
SW-6	38 55' 33.58" N 122 50' 39.91" W	Kelsey Creek - Downstream; ~ 3 miles west of HWY 29 on Kelsey	ND	8.7	4.9	42	ND	ND	0.14	ND	ND	ND	ND	7.56	180	11	2.5	45	NA	2.9	1.8	1000
SW-7	38 52' 04.62" N 122 47' 43.13" W	High Valley Creek; behind Binkley Ranch House	ND	28	12	119	0.35	ND	0.23	ND	0.084	20	ND	6.97	480	6.4	1.1	140	NA	14	ND	1100
SW-8	38 52' 08.29" N 122 47' 40.01" W	Kelsey Creek - Middle; Northwest of Binkley Ranch House, upstream of confluence with High Valley Creek	ND	8.8	4.9	42	ND	ND	0.14	ND	ND	ND	ND	7.48	180	11	2.6	45	NA	2.8	2.2	120
SW-9	38 50' 40.18" N 122 45' 29.61" W	Alder Creek; Adjacent to High Valley Road bridge crossing Alder Creek	ND	8.8	4.9	42	ND	ND	0.15	ND	ND	ND	ND	7.36	180	11	2.3	45	NA	2.8	1.8	820
SW-10	38 50' 36.22" N 122 44' 57.25" W	Kelsey Creek - Upstream; ~ 0.5 miles west of High Valley Road gate on Bottle Rock Road	ND	8.8	4.9	42	ND	ND	0.15	ND	ND	ND	ND	7.44	180	11	2.5	47	NA	2.8	2.0	920

ND = Not Detected
NA = Not Analyzed

Table 2
Bottle Rock Power, LLC
2022 Ground Water and Surface Water Monitoring
2nd Quarter Analytical Results

Location ID	GPS Coordinates	Location & Description	Arsenic µg/l	Calcium mg/l	Magnesium mg/l	Hardness mg/l	Boron mg/l	Copper mg/l	Iron mg/l	Lead mg/l	Manganese mg/l	Sodium mg/l	Zinc mg/l	pH	Electrical Conductivity umhos/cm	Dissolved Oxygen mg/l	Turbidity NTU	Total Alkalinity mg/l	Nitrate mg/l	Sulfate mg/l	Total Suspended Solids mg/l	Total Coliform MPN/ 100mL
GW-1	38 50' 27.84" N 122 45' 59.07" W	Barret Spring; Running seep at sharp turn, downslope on High Valley Road	ND	48	16	184	ND	ND	0.19	ND	0.11	8.9	ND	7.70	380	NA	ND	180	ND	19	ND	NA
GW-3	38 50' 21.57" N 122 46' 17.46 W	BRP WW1; Northern most water supply well	ND	33	9.8	122	0.39	ND	1.2	ND	0.22	25	ND	7.73	340	NA	5.4	170	ND	5.4	1.6	NA
SW-6	38 55' 33.58" N 122 50' 39.91" W	Kelsey Creek - Downstream; ~ 3 miles west of HWY 29 on Kelsey	ND	7.1	4.0	34	ND	ND	ND	ND	ND	ND	ND	7.13	93	9.1	ND	42	NA	1.3	ND	>2419.6
SW-7	38 52' 04.62" N 122 47' 43.13" W	High Valley Creek; behind Binkley Ranch House	ND	7.2	4.1	35	ND	ND	ND	ND	ND	ND	ND	7.15	93	8.9	ND	44	NA	1.3	ND	>2419.6
SW-8	38 52' 08.29" N 122 47' 40.01" W	Kelsey Creek - Middle; Northwest of Binkley Ranch House, upstream of confluence with High Valley Creek	ND	7.2	4.0	34	ND	ND	ND	ND	ND	ND	ND	7.14	93	9.2	ND	43	NA	1.3	ND	>2419.6
SW-9	38 50' 40.18" N 122 45' 29.61" W	Alder Creek; Adjacent to High Valley Road bridge crossing Alder Creek	ND	24	21	147	0.22	ND	ND	ND	ND	8.6	ND	7.13	300	6.3	ND	150	NA	9.6	ND	290
SW-10	38 50' 36.22" N 122 44' 57.25" W	Kelsey Creek - Upstream; ~ 0.5 miles west of High Valley Road gate on Bottle Rock Road	ND	7.0	4.0	34	ND	ND	ND	ND	ND	ND	ND	7.10	92	9.0	ND	45	NA	1.3	ND	>2419.6

ND = Not Detected
NA = Not Analyzed

Table 2
Bottle Rock Power, LLC
2022 Ground Water and Surface Water Monitoring
3rd Quarter Analytical Results

Location ID	GPS Coordinates	Location & Description	Arsenic µg/l	Calcium mg/l	Magnesium mg/l	Hardness mg/l	Boron mg/l	Copper mg/l	Iron mg/l	Lead mg/l	Manganese mg/l	Sodium mg/l	Zinc mg/l	pH	Electrical Conductivity umhos/cm	Dissolved Oxygen mg/l	Turbidity NTU	Total Alkalinity mg/l	Nitrate mg/l	Sulfate mg/l	Total Suspended Solids mg/l	Total Coliform MPN/ 100mL
GW-1	38 50' 27.84" N 122 45' 59.07" W	Barret Spring; Running seep at sharp turn, downslope on High Valley Road	ND	6.0	3.7	30	ND	ND	ND	ND	ND	ND	ND	7.37	90	NA	ND	40	ND	2.2	ND	NA
GW-3	38 50' 21.57" N 122 46' 17.46 W	BRP WW1; Northern most water supply well	ND	34	10	127	0.41	ND	0.24	ND	0.062	25	ND	7.61	350	NA	2.4	180	ND	5.8	1.2	NA
SW-6	38 55' 33.58" N 122 50' 39.91" W	Kelsey Creek - Downstream; ~ 3 miles west of HWY 29 on Kelsey	ND	28	27	179	1.8	ND	ND	ND	0.050	13	ND	7.90	380	8.7	1.0	200	NA	13	ND	2.0
SW-7	38 52' 04.62" N 122 47' 43.13" W	High Valley Creek; behind Binkley Ranch House	ND	5.8	3.6	29	ND	ND	ND	ND	ND	ND	ND	7.19	90	9.6	ND	42	NA	2.2	ND	2400
SW-8	38 52' 08.29" N 122 47' 40.01" W	Kelsey Creek - Middle; Northwest of Binkley Ranch House, upstream of confluence with High Valley Creek	ND	5.9	3.6	30	ND	ND	ND	ND	ND	ND	ND	7.29	90	9.7	ND	40	NA	2.2	ND	2400
SW-9	38 50' 40.18" N 122 45' 29.61" W	Alder Creek; Adjacent to High Valley Road bridge crossing Alder Creek	ND	47	15	180	ND	ND	ND	ND	0.10	8.6	ND	7.59	380	8.6	ND	180	NA	20	ND	64
SW-10	38 50' 36.22" N 122 44' 57.25" W	Kelsey Creek - Upstream; ~ 0.5 miles west of High Valley Road gate on Bottle Rock Road	ND	6.5	4.0	33	ND	ND	ND	ND	ND	ND	ND	7.01	92	8.8	ND	39	NA	2.2	ND	2400

ND = Not Detected

NA = Not Analyzed

Table 2
Bottle Rock Power, LLC
2022 Ground Water and Surface Water Monitoring
4th Quarter Analytical Results

Location ID	GPS Coordinates	Location & Description	Arsenic μg/l	Calcium mg/l	Magnesium mg/l	Hardness mg/l	Boron mg/l	Copper mg/l	Iron mg/l	Lead mg/l	Manganese mg/l	Sodium mg/l	Zinc mg/l	pH	Electrical Conductivity umhos/cm	Dissolved Oxygen mg/l	Turbidity NTU	Total Alkalinity mg/l	Nitrate mg/l	Sulfate mg/l	Total Suspended Solids mg/l	Total Coliform MPN/100mL
GW-1	38 50' 27.84" N 122 45' 59.07" W	Barret Spring; Running seep at sharp turn, downslope on High Valley Road	ND	46	15	175	ND	ND	ND	ND	0.093	8.1	ND	7.63	390	NA	ND	180	ND	24	ND	NA
GW-3	38 50' 21.57" N 122 46' 17.46 W	BRP WW1; Northern most water supply well	ND	33	9.9	123	0.40	ND	0.15	ND	0.048	24	ND	7.66	360	NA	ND	180	ND	5.8	ND	NA
SW-6	38 55' 33.58" N 122 50' 39.91" W	Kelsey Creek - Downstream; ~ 3 miles west of HWY 29 on Kelsey	ND	11	6.0	53	ND	ND	ND	ND	ND	ND	ND	7.46	140	11	ND	64	NA	5.3	ND	650
SW-7	38 52' 04.62" N 122 47' 43.13" W	High Valley Creek; behind Binkley Ranch House	ND	20	22	138	0.11	ND	ND	ND	ND	ND	ND	7.49	290	10	ND	140	NA	14	ND	180
SW-8	38 52' 08.29" N 122 47' 40.01" W	Kelsey Creek - Middle; Northwest of Binkley Ranch House, upstream of confluence with High Valley Creek	ND	11	5.9	53	ND	ND	ND	ND	ND	ND	ND	7.47	140	10	ND	60	NA	5.3	ND	460
SW-9	38 50' 40.18" N 122 45' 29.61" W	Alder Creek; Adjacent to High Valley Road bridge crossing Alder Creek	ND	12	6.0	54	ND	ND	ND	ND	ND	ND	ND	7.38	140	11	ND	64	NA	5.3	ND	610
SW-10	38 50' 36.22" N 122 44' 57.25" W	Kelsey Creek - Upstream; ~ 0.5 miles west of High Valley Road gate on Bottle Rock Road	ND	19	21	136	0.11	ND	ND	ND	ND	ND	ND	7.52	290	10	ND	140	NA	14	ND	260

ND = Not Detected
NA = Not Analyzed



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

12 April 2022

Bottle Rock Power

Attn: M. Moore

4010 Stone Way North, Suite 400

Seattle, WA 98103

RE: Groundwater

Work Order: 22C3440

Enclosed are the results of analyses for samples received by the laboratory on 03/28/22 12:10. If you have any questions concerning this report, please feel free to contact me.

Sincerely,

Jeanette L. Poplin For Stephen F. McWeeney
Lab Manager



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Groundwater
Project Number: [none]

Reported:
04/12/22 13:48

Bay Area: 262 Rickenbacker Circle | Livermore, CA 94551 | T: 925-828-6226 | F: 925-828-6309 | ELAP# 2728
Central Valley: 9090 Union Park Way Suite 113 | Elk Grove, CA 95624 | T: 916-686-5190 | F: 916-686-5192 | ELAP# 2922
North Bay: 110 Liberty Street | Petaluma, CA 94952 | T: 707-769-3128 | F: 707-769-8093 | ELAP# 2303
San Diego: 2722 Loker Avenue West Suite A | Carlsbad, CA 92010 | T: 760-930-2555 | F: 760-930-2510 | ELAP# 3055

ANALYTICAL REPORT FOR SAMPLES

Sample ID	Laboratory ID	Matrix	Date Sampled	Date Received
GW-3	22C3440-01	Water	03/28/22 08:00	03/28/22 12:10
GW-1	22C3440-02	Water	03/28/22 08:40	03/28/22 12:10



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Groundwater
Project Number: [none]

Reported:
04/12/22 13:48

	Result	Units	Reporting Limit	Dilution	Batch	Prepared	Analyzed	ELAP#	Method	Note
GW-3 (22C3440-01)			Sample Type: Water			Sampled: 03/28/22 08:00				
Metals by EPA 200 Series Methods										
Arsenic	ND	ug/L	2.0	1	AC24630	03/28/22 14:21	03/29/22 12:20	2303	EPA 200.5	
Boron	0.42	mg/L	0.10	1	AC24664	03/29/22 07:42	03/29/22 08:13	2303	EPA 200.7	
Calcium	35	mg/L	0.050	1	AC24664	03/29/22 07:42	03/29/22 08:13	2303	EPA 200.7	
Copper	ND	mg/L	0.020	1	AC24664	03/29/22 07:42	03/29/22 08:13	2303	EPA 200.7	
Iron	0.50	mg/L	0.10	1	AC24664	03/29/22 07:42	03/29/22 08:13	2303	EPA 200.7	
Lead	ND	mg/L	0.020	1	AC24664	03/29/22 07:42	03/29/22 08:13	2303	EPA 200.7	
Magnesium	11	mg/L	0.050	1	AC24664	03/29/22 07:42	03/29/22 08:13	2303	EPA 200.7	
Manganese	0.11	mg/L	0.020	1	AC24664	03/29/22 07:42	03/29/22 08:13	2303	EPA 200.7	
Sodium	25	mg/L	5.0	1	AC24664	03/29/22 07:42	03/29/22 08:13	2303	EPA 200.7	
Zinc	ND	mg/L	0.050	1	AC24664	03/29/22 07:42	03/29/22 08:13	2303	EPA 200.7	
Conventional Chemistry Parameters by APHA/EPA Methods										
pH	7.86	pH Units	1.00	1	AC23600	03/28/22 13:18	03/28/22 16:00	2303	SM4500-H+ B	T-14
Specific Conductance (EC)	550	umhos/cm	10	1	AC23600	03/28/22 13:18	03/28/22 16:00	2303	SM2510B	
Total Alkalinity as CaCO3	170	mg/L	5.0	1	AC24612	03/28/22 12:59	03/30/22 13:22	2303	SM2320B	
Total Suspended Solids	2.0	mg/L	1.0	1	AC24666	03/29/22 10:15	03/29/22 16:30	1551	SM2540D	
Turbidity	1.6	NTU	1.0	1	AC23065	03/29/22 08:00	03/29/22 14:27	2303	SM2130B	
Bicarbonate Alkalinity as CaCO3	170	mg/L	5.0	1	AC24612	03/28/22 12:59	03/30/22 13:22	2303	SM2320B	
Carbonate Alkalinity as CaCO3	ND	mg/L	5.0	1	AC24612	03/28/22 12:59	03/30/22 13:22	2303	SM2320B	
Hydroxide Alkalinity as CaCO3	ND	mg/L	5.0	1	AC24612	03/28/22 12:59	03/30/22 13:22	2303	SM2320B	
Hardness, Total	130	mg/L	1	1	AC24664	03/29/22 07:42	03/29/22 08:13	2303	SM2340B	
Anions by EPA Method 300.0										
Nitrate as N	ND	mg/L	0.40	1	AC24620	03/28/22 13:36	03/28/22 14:15	2303	EPA 300.0	
Sulfate as SO4	5.9	mg/L	0.50	1	AC24620	03/28/22 13:36	03/28/22 14:15	2303	EPA 300.0	
GW-1 (22C3440-02)			Sample Type: Water			Sampled: 03/28/22 08:40				
Metals by EPA 200 Series Methods										
Arsenic	ND	ug/L	2.0	1	AC24630	03/28/22 14:21	03/29/22 12:20	2303	EPA 200.5	
Boron	0.10	mg/L	0.10	1	AC24664	03/29/22 07:42	03/29/22 08:16	2303	EPA 200.7	
Calcium	49	mg/L	0.050	1	AC24664	03/29/22 07:42	03/29/22 08:16	2303	EPA 200.7	
Copper	ND	mg/L	0.020	1	AC24664	03/29/22 07:42	03/29/22 08:16	2303	EPA 200.7	
Iron	ND	mg/L	0.10	1	AC24664	03/29/22 07:42	03/29/22 08:16	2303	EPA 200.7	
Lead	ND	mg/L	0.020	1	AC24664	03/29/22 07:42	03/29/22 08:16	2303	EPA 200.7	
Magnesium	16	mg/L	0.050	1	AC24664	03/29/22 07:42	03/29/22 08:16	2303	EPA 200.7	
Manganese	0.11	mg/L	0.020	1	AC24664	03/29/22 07:42	03/29/22 08:16	2303	EPA 200.7	
Sodium	8.9	mg/L	5.0	1	AC24664	03/29/22 07:42	03/29/22 08:16	2303	EPA 200.7	
Zinc	ND	mg/L	0.050	1	AC24664	03/29/22 07:42	03/29/22 08:16	2303	EPA 200.7	

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Groundwater
Project Number: [none]

Reported:
04/12/22 13:48

	Result	Units	Reporting Limit	Dilution	Batch	Prepared	Analyzed	ELAP#	Method	Note
GW-1 (22C3440-02)			Sample Type: Water			Sampled: 03/28/22 08:40				
Conventional Chemistry Parameters by APHA/EPA Methods										
pH	7.60	pH Units	1.00	1	AC23600	03/28/22 13:18	03/28/22 16:00	2303	SM4500-H+ B	T-14
Specific Conductance (EC)	580	umhos/cm	10	1	AC23600	03/28/22 13:18	03/28/22 16:00	2303	SM2510B	
Total Alkalinity as CaCO3	180	mg/L	5.0	1	AC24612	03/28/22 12:59	03/30/22 13:22	2303	SM2320B	
Total Suspended Solids	ND	mg/L	1.0	1	AC24666	03/29/22 10:15	03/29/22 16:30	1551	SM2540D	
Turbidity	ND	NTU	1.0	1	AC23065	03/29/22 08:00	03/29/22 14:27	2303	SM2130B	
Bicarbonate Alkalinity as CaCO3	180	mg/L	5.0	1	AC24612	03/28/22 12:59	03/30/22 13:22	2303	SM2320B	
Carbonate Alkalinity as CaCO3	ND	mg/L	5.0	1	AC24612	03/28/22 12:59	03/30/22 13:22	2303	SM2320B	
Hydroxide Alkalinity as CaCO3	ND	mg/L	5.0	1	AC24612	03/28/22 12:59	03/30/22 13:22	2303	SM2320B	
Hardness, Total	190	mg/L	1	1	AC24664	03/29/22 07:42	03/29/22 08:16	2303	SM2340B	
Anions by EPA Method 300.0										
Nitrate as N	ND	mg/L	0.40	1	AC24620	03/28/22 13:36	03/28/22 14:33	2303	EPA 300.0	
Sulfate as SO4	20	mg/L	0.50	1	AC24620	03/28/22 13:36	03/28/22 14:33	2303	EPA 300.0	



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Groundwater
Project Number: [none]

Reported:
04/12/22 13:48

Metals by EPA 200 Series Methods - Quality Control

Analyte(s)	Result	Reporting Limit	Units	Spike Level	Source Result	%REC Limits	RPD	RPD Limit	Flag
Batch AC24630 - NB EPA 200 series									
Blank (AC24630-BLK1)				Prepared: 03/28/22 Analyzed: 03/29/22					
Arsenic	ND	2.0	ug/L						
LCS (AC24630-BS1)				Prepared: 03/28/22 Analyzed: 03/29/22					
Arsenic	10.1	2.0	ug/L	10.0	101	85-115			
LCS Dup (AC24630-BSD1)				Prepared: 03/28/22 Analyzed: 03/29/22					
Arsenic	9.40	2.0	ug/L	10.0	94.0	85-115	7.23	20	
Duplicate (AC24630-DUP1)				Source: 22C3442-01		Prepared: 03/28/22 Analyzed: 03/29/22			
Arsenic	18.1	2.0	ug/L		17.3		4.44	20	
Matrix Spike (AC24630-MS1)				Source: 22C3443-01		Prepared: 03/28/22 Analyzed: 03/29/22			
Arsenic	10.8	2.0	ug/L	10.0	ND	108	70-130		

Batch AC24664 - NB EPA 200 series DA

Blank (AC24664-BLK1)				Prepared & Analyzed: 03/29/22					
Boron	ND	0.10	mg/L						
Calcium	ND	0.050	mg/L						
Copper	ND	0.020	mg/L						
Iron	ND	0.10	mg/L						
Lead	ND	0.020	mg/L						
Magnesium	ND	0.050	mg/L						
Manganese	ND	0.020	mg/L						
Sodium	ND	5.0	mg/L						
Zinc	ND	0.050	mg/L						



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Groundwater
Project Number: [none]

Reported:
04/12/22 13:48

Metals by EPA 200 Series Methods - Quality Control

Analyte(s)	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Flag
Batch AC24664 - NB EPA 200 series DA										
LCS (AC24664-BS1)				Prepared & Analyzed: 03/29/22						
Boron	0.502	0.10	mg/L	0.500		100	85-115			
Calcium	25.1	0.050	mg/L	25.5		98.4	85-115			
Copper	0.495	0.020	mg/L	0.500		99.0	85-115			
Iron	0.521	0.10	mg/L	0.500		104	85-115			
Lead	0.484	0.020	mg/L	0.500		96.8	85-115			
Magnesium	26.1	0.050	mg/L	25.5		102	85-115			
Manganese	0.537	0.020	mg/L	0.500		107	85-115			
Sodium	25.7	5.0	mg/L	25.5		101	85-115			
Zinc	0.534	0.050	mg/L	0.500		107	85-115			
LCS Dup (AC24664-BS1)				Prepared & Analyzed: 03/29/22						
Boron	0.502	0.10	mg/L	0.500		100	85-115	0.0199	20	
Calcium	25.1	0.050	mg/L	25.5		98.6	85-115	0.186	20	
Copper	0.495	0.020	mg/L	0.500		99.1	85-115	0.0808	20	
Iron	0.523	0.10	mg/L	0.500		105	85-115	0.326	20	
Lead	0.485	0.020	mg/L	0.500		96.9	85-115	0.165	20	
Magnesium	26.1	0.050	mg/L	25.5		102	85-115	0.167	20	
Manganese	0.537	0.020	mg/L	0.500		107	85-115	0.00	20	
Sodium	25.9	5.0	mg/L	25.5		101	85-115	0.543	20	
Zinc	0.539	0.050	mg/L	0.500		108	85-115	0.783	20	
Duplicate (AC24664-DUP1)				Source: 22C3440-01		Prepared & Analyzed: 03/29/22				
Boron	0.409	0.10	mg/L		0.417			2.01	20	
Calcium	34.1	0.050	mg/L		34.5			1.08	20	
Copper	ND	0.020	mg/L		ND				20	
Iron	0.501	0.10	mg/L		0.504			0.716	20	
Lead	ND	0.020	mg/L		ND				20	
Magnesium	10.4	0.050	mg/L		10.6			1.22	20	
Manganese	0.104	0.020	mg/L		0.106			2.10	20	
Sodium	25.0	5.0	mg/L		25.3			1.06	20	
Zinc	ND	0.050	mg/L		ND				20	

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Groundwater
Project Number: [none]

Reported:
04/12/22 13:48

Metals by EPA 200 Series Methods - Quality Control

Analyte(s)	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Flag
------------	--------	--------------------	-------	----------------	------------------	------	----------------	-----	--------------	------

Batch AC24664 - NB EPA 200 series DA

MRL Check (AC24664-MRL1)

Prepared & Analyzed: 03/29/22

Boron	0.0910	0.10	mg/L	0.100		91.0	0-200			
Calcium	4.49	0.050	mg/L	5.00		89.8	0-200			
Copper	0.0440	0.020	mg/L	0.0500		88.0	0-200			
Iron	0.0943	0.10	mg/L	0.100		94.3	0-200			
Magnesium	0.481	0.050	mg/L	0.500		96.3	0-200			
Manganese	0.0171	0.020	mg/L	0.0200		85.5	0-200			
Sodium	4.70	5.0	mg/L	5.00		93.9	0-200			
Zinc	0.0624	0.050	mg/L	0.0500		125	0-200			

Matrix Spike (AC24664-MS1)

Source: 22C3440-02

Prepared & Analyzed: 03/29/22

Boron	0.614	0.10	mg/L	0.500	0.101	103	70-130			
Copper	0.512	0.020	mg/L	0.500	ND	102	70-130			
Iron	0.569	0.10	mg/L	0.500	ND	114	70-130			
Lead	0.485	0.020	mg/L	0.500	ND	97.0	70-130			
Manganese	0.644	0.020	mg/L	0.500	0.110	107	70-130			
Sodium	34.7	5.0	mg/L	25.5	8.90	101	70-130			
Zinc	0.543	0.050	mg/L	0.500	ND	109	70-130			



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Groundwater
Project Number: [none]

Reported:
04/12/22 13:48

Conventional Chemistry Parameters by APHA/EPA Methods - Quality Control

Analyte(s)	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Flag
------------	--------	--------------------	-------	----------------	------------------	------	----------------	-----	--------------	------

Batch AC23600 - NB General Prep

Duplicate (AC23600-DUP1)

Source: 22C1375-01

Prepared & Analyzed: 03/09/22

Specific Conductance (EC)	776	10	umhos/cm		775			0.129	5	
pH	6.46	1.00	pH Units		6.46			0.00	20	

Batch AC24612 - NB General Prep

Blank (AC24612-BLK1)

Prepared: 03/28/22 Analyzed: 03/30/22

Total Alkalinity as CaCO ₃	ND	5.0	mg/L							
Bicarbonate Alkalinity as CaCO ₃	ND	5.0	mg/L							
Carbonate Alkalinity as CaCO ₃	ND	5.0	mg/L							
Hydroxide Alkalinity as CaCO ₃	ND	5.0	mg/L							

LCS (AC24612-BS1)

Prepared: 03/28/22 Analyzed: 03/30/22

Total Alkalinity as CaCO ₃	1010	5.0	mg/L	1020		98.7	80-120			
---------------------------------------	------	-----	------	------	--	------	--------	--	--	--

Duplicate (AC24612-DUP1)

Source: 22C3445-05

Prepared: 03/28/22 Analyzed: 03/30/22

Total Alkalinity as CaCO ₃	44.6	5.0	mg/L		44.6			0.00	20	
Bicarbonate Alkalinity as CaCO ₃	44.5	5.0	mg/L		44.5			0.00	20	
Carbonate Alkalinity as CaCO ₃	ND	5.0	mg/L		ND				20	
Hydroxide Alkalinity as CaCO ₃	ND	5.0	mg/L		ND				20	

Batch AC24664 - NB EPA 200 series DA

Blank (AC24664-BLK1)

Prepared & Analyzed: 03/29/22

Hardness, Total	ND	1	mg/L							
-----------------	----	---	------	--	--	--	--	--	--	--

Duplicate (AC24664-DUP1)

Source: 22C3440-01

Prepared & Analyzed: 03/29/22

Hardness, Total	128	1	mg/L		130			1.13	20	
-----------------	-----	---	------	--	-----	--	--	------	----	--



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Groundwater
Project Number: [none]

Reported:
04/12/22 13:48

Conventional Chemistry Parameters by APHA/EPA Methods - Quality Control

Analyte(s)	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Flag
Batch AC24666 - General Preparation										
Blank (AC24666-BLK1)				Prepared & Analyzed: 03/29/22						
Total Suspended Solids	ND	1.0	mg/L							
Duplicate (AC24666-DUP1)				Source: 22C3379-01 Prepared & Analyzed: 03/29/22						
Total Suspended Solids	62.0	1.0	mg/L		61.3			1.18	30	
Duplicate (AC24666-DUP2)				Source: 22C3510-01 Prepared & Analyzed: 03/29/22						
Total Suspended Solids	1590	1.0	mg/L		1550			2.25	30	



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Groundwater
Project Number: [none]

Reported:
04/12/22 13:48

Anions by EPA Method 300.0 - Quality Control

Analyte(s)	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Flag
Batch AC24620 - NB General Prep										
Blank (AC24620-BLK1)				Prepared & Analyzed: 03/28/22						
Nitrate as N	ND	0.40	mg/L							
Sulfate as SO4	ND	0.50	mg/L							
LCS (AC24620-BS1)				Prepared & Analyzed: 03/28/22						
Nitrate as N	1.13	0.40	mg/L	1.13		99.9	90-110			
Sulfate as SO4	4.89	0.50	mg/L	5.00		97.8	90-110			
Duplicate (AC24620-DUP1)				Source: 22C3445-04		Prepared & Analyzed: 03/28/22				
Nitrate as N	ND	0.40	mg/L		ND				20	
Sulfate as SO4	2.83	0.50	mg/L		2.78			1.88	20	
MRL Check (AC24620-MRL1)				Prepared & Analyzed: 03/28/22						
Nitrate as N	0.225	0.40	mg/L	0.226		99.8	60-140			
Sulfate as SO4	1.02	0.50	mg/L	1.00		102	60-140			
Matrix Spike (AC24620-MS1)				Source: 22C3445-05		Prepared & Analyzed: 03/28/22				
Nitrate as N	1.15	0.40	mg/L	1.13	ND	102	80-120			
Sulfate as SO4	7.92	0.50	mg/L	5.00	2.86	101	80-120			
Matrix Spike Dup (AC24620-MSD1)				Source: 22C3445-05		Prepared & Analyzed: 03/28/22				
Nitrate as N	1.16	0.40	mg/L	1.13	ND	103	80-120	0.847	20	
Sulfate as SO4	7.86	0.50	mg/L	5.00	2.86	99.9	80-120	0.757	20	



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103


Project Manager: M. Moore
Project: Groundwater
Project Number: [none]

Reported:
04/12/22 13:48

Notes and Definitions

- T-14 Residual chlorine, dissolved oxygen, sulfite, and pH must be analyzed in the field to meet the EPA specified 15 minute hold time.
- ND Analyte NOT DETECTED at or above the reporting limit
- dry Sample results reported on a dry weight basis
- REC Recovery
- RPD Relative Percent Difference

Non-accredited analytes are reported only when ELAP accreditation for a requested analyte method pair is not available. For a list of accredited analytes, view our certificates at the Company link on our website at www.alpha-labs.com or contact your Project Manager directly.

[illegible]



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

12 April 2022

Bottle Rock Power

Attn: M. Moore

4010 Stone Way North, Suite 400

Seattle, WA 98103

RE: Surface Water

Work Order: 22C3445

Enclosed are the results of analyses for samples received by the laboratory on 03/28/22 12:10. If you have any questions concerning this report, please feel free to contact me.

Sincerely,

Jeanette L. Poplin For Stephen F. McWeeney
Lab Manager



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Surface Water
Project Number: [none]

Reported:
04/12/22 13:40

Bay Area: 262 Rickenbacker Circle | Livermore, CA 94551 | T: 925-828-6226 | F: 925-828-6309 | ELAP# 2728
Central Valley: 9090 Union Park Way Suite 113 | Elk Grove, CA 95624 | T: 916-686-5190 | F: 916-686-5192 | ELAP# 2922
North Bay: 110 Liberty Street | Petaluma, CA 94952 | T: 707-769-3128 | F: 707-769-8093 | ELAP# 2303
San Diego: 2722 Loker Avenue West Suite A | Carlsbad, CA 92010 | T: 760-930-2555 | F: 760-930-2510 | ELAP# 3055

ANALYTICAL REPORT FOR SAMPLES

Sample ID	Laboratory ID	Matrix	Date Sampled	Date Received
SW-9	22C3445-01	Water	03/28/22 09:10	03/28/22 12:10
SW-7	22C3445-02	Water	03/28/22 08:15	03/28/22 12:10
SW-10	22C3445-03	Water	03/28/22 09:30	03/28/22 12:10
SW-8	22C3445-04	Water	03/28/22 10:00	03/28/22 12:10
SW-6	22C3445-05	Water	03/28/22 11:00	03/28/22 12:10



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Surface Water
Project Number: [none]

Reported:
04/12/22 13:40

	Result	Units	Reporting Limit	Dilution	Batch	Prepared	Analyzed	ELAP#	Method	Note
SW-9 (22C3445-01)			Sample Type: Water			Sampled: 03/28/22 09:10				
Metals by EPA 200 Series Methods										
Arsenic	ND	mg/L	0.020	1	AC24656	03/29/22 07:12	03/29/22 12:35	2303	EPA 200.7	
Boron	ND	mg/L	0.10	1	AC24656	03/29/22 07:12	03/29/22 12:35	2303	EPA 200.7	
Calcium	8.8	mg/L	0.050	1	AC24656	03/29/22 07:12	03/29/22 12:35	2303	EPA 200.7	
Chromium	ND	mg/L	0.010	1	AC24656	03/29/22 07:12	03/29/22 12:35	2303	EPA 200.7	
Copper	ND	mg/L	0.020	1	AC24656	03/29/22 07:12	03/29/22 12:35	2303	EPA 200.7	
Iron	0.15	mg/L	0.10	1	AC24656	03/29/22 07:12	03/29/22 12:35	2303	EPA 200.7	
Lead	ND	mg/L	0.020	1	AC24656	03/29/22 07:12	03/29/22 12:35	2303	EPA 200.7	
Magnesium	4.9	mg/L	0.050	1	AC24656	03/29/22 07:12	03/29/22 12:35	2303	EPA 200.7	
Manganese	ND	mg/L	0.020	1	AC24656	03/29/22 07:12	03/29/22 12:35	2303	EPA 200.7	
Mercury	ND	ug/L	0.20	1	AD23114	04/01/22 09:43	04/04/22 12:34	1551	EPA 245.1	
Sodium	ND	mg/L	5.0	1	AC24656	03/29/22 07:12	03/29/22 12:35	2303	EPA 200.7	
Vanadium	ND	mg/L	0.020	1	AC24656	03/29/22 07:12	03/29/22 12:35	2303	EPA 200.7	
Zinc	ND	mg/L	0.050	1	AC24656	03/29/22 07:12	03/29/22 12:35	2303	EPA 200.7	
Conventional Chemistry Parameters by APHA/EPA Methods										
Dissolved Oxygen	11	mg/L	0.20	1	AC23065	03/28/22 16:00	03/28/22 16:34	2303	SM4500-O G	T-14
pH	7.36	pH Units	1.00	1	AC23600	03/28/22 13:35	03/28/22 16:00	2303	SM4500-H+ B	T-14
Specific Conductance (EC)	180	umhos/cm	10	1	AC23600	03/28/22 13:35	03/28/22 16:00	2303	SM2510B	
Total Alkalinity as CaCO3	45	mg/L	5.0	1	AC24612	03/28/22 12:59	03/30/22 13:22	2303	SM2320B	
Total Suspended Solids	1.8	mg/L	1.0	1	AC24666	03/29/22 10:15	03/29/22 16:30	1551	SM2540D	
Turbidity	2.3	NTU	1.0	1	AC23065	03/29/22 08:00	03/29/22 14:27	2303	SM2130B	
Bicarbonate Alkalinity as CaCO3	45	mg/L	5.0	1	AC24612	03/28/22 12:59	03/30/22 13:22	2303	SM2320B	
Carbonate Alkalinity as CaCO3	ND	mg/L	5.0	1	AC24612	03/28/22 12:59	03/30/22 13:22	2303	SM2320B	
Hydroxide Alkalinity as CaCO3	ND	mg/L	5.0	1	AC24612	03/28/22 12:59	03/30/22 13:22	2303	SM2320B	
Hardness, Total	42	mg/L	1	1	AC24656	03/29/22 07:12	03/29/22 12:35	2303	SM2340B	



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Surface Water
Project Number: [none]

Reported:
04/12/22 13:40

	Result	Units	Reporting Limit	Dilution	Batch	Prepared	Analyzed	ELAP#	Method	Note
SW-9 (22C3445-01)										
			Sample Type: Water			Sampled: 03/28/22 09:10				
Anions by EPA Method 300.0										
Sulfate as SO4	2.8	mg/L	0.50	1	AC24620	03/28/22 13:36	03/28/22 14:51	2303	EPA 300.0	
Microbiological Parameters by APHA Standard Methods										
Total Coliforms	820	MPN/100mL	1.0	1	AC24700	03/28/22 16:30	03/29/22 16:30	2303	SM9223B	
E. Coli	7.4	MPN/100mL	1.0	1	AC24700	03/28/22 16:30	03/29/22 16:30	2303	SM9223B	
SW-7 (22C3445-02)										
			Sample Type: Water			Sampled: 03/28/22 08:15				
Metals by EPA 200 Series Methods										
Arsenic	ND	mg/L	0.020	1	AC24656	03/29/22 07:12	03/29/22 12:38	2303	EPA 200.7	
Boron	0.35	mg/L	0.10	1	AC24656	03/29/22 07:12	03/29/22 12:38	2303	EPA 200.7	
Calcium	28	mg/L	0.050	1	AC24656	03/29/22 07:12	03/29/22 12:38	2303	EPA 200.7	
Chromium	ND	mg/L	0.010	1	AC24656	03/29/22 07:12	03/29/22 12:38	2303	EPA 200.7	
Copper	ND	mg/L	0.020	1	AC24656	03/29/22 07:12	03/29/22 12:38	2303	EPA 200.7	
Iron	0.23	mg/L	0.10	1	AC24656	03/29/22 07:12	03/29/22 12:38	2303	EPA 200.7	
Lead	ND	mg/L	0.020	1	AC24656	03/29/22 07:12	03/29/22 12:38	2303	EPA 200.7	
Magnesium	12	mg/L	0.050	1	AC24656	03/29/22 07:12	03/29/22 12:38	2303	EPA 200.7	
Manganese	0.084	mg/L	0.020	1	AC24656	03/29/22 07:12	03/29/22 12:38	2303	EPA 200.7	
Mercury	ND	ug/L	0.20	1	AD23114	04/01/22 09:43	04/04/22 12:45	1551	EPA 245.1	
Sodium	20	mg/L	5.0	1	AC24656	03/29/22 07:12	03/29/22 12:38	2303	EPA 200.7	
Vanadium	ND	mg/L	0.020	1	AC24656	03/29/22 07:12	03/29/22 12:38	2303	EPA 200.7	
Zinc	ND	mg/L	0.050	1	AC24656	03/29/22 07:12	03/29/22 12:38	2303	EPA 200.7	



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Surface Water
Project Number: [none]

Reported:
04/12/22 13:40

	Result	Units	Reporting Limit	Dilution	Batch	Prepared	Analyzed	ELAP#	Method	Note
SW-7 (22C3445-02)			Sample Type: Water			Sampled: 03/28/22 08:15				
Conventional Chemistry Parameters by APHA/EPA Methods										
Dissolved Oxygen	6.4	mg/L	0.20	1	AC23065	03/28/22 16:00	03/28/22 16:34	2303	SM4500-O G	T-14
pH	6.97	pH Units	1.00	1	AC23600	03/28/22 13:35	03/28/22 16:00	2303	SM4500-H+ B	T-14
Specific Conductance (EC)	480	umhos/cm	10	1	AC23600	03/28/22 13:35	03/28/22 16:00	2303	SM2510B	
Total Alkalinity as CaCO3	140	mg/L	5.0	1	AC24612	03/28/22 12:59	03/30/22 13:22	2303	SM2320B	
Total Suspended Solids	ND	mg/L	1.0	1	AC24666	03/29/22 10:15	03/29/22 16:30	1551	SM2540D	
Turbidity	1.1	NTU	1.0	1	AC23065	03/29/22 08:00	03/29/22 14:27	2303	SM2130B	
Bicarbonate Alkalinity as CaCO3	140	mg/L	5.0	1	AC24612	03/28/22 12:59	03/30/22 13:22	2303	SM2320B	
Carbonate Alkalinity as CaCO3	ND	mg/L	5.0	1	AC24612	03/28/22 12:59	03/30/22 13:22	2303	SM2320B	
Hydroxide Alkalinity as CaCO3	ND	mg/L	5.0	1	AC24612	03/28/22 12:59	03/30/22 13:22	2303	SM2320B	
Hardness, Total	119	mg/L	1	1	AC24656	03/29/22 07:12	03/29/22 12:38	2303	SM2340B	
Anions by EPA Method 300.0										
Sulfate as SO4	14	mg/L	0.50	1	AC24620	03/28/22 13:36	03/28/22 15:08	2303	EPA 300.0	
Microbiological Parameters by APHA Standard Methods										
Total Coliforms	1100	MPN/100mL	1.0	1	AC24700	03/28/22 16:30	03/29/22 16:30	2303	SM9223B	
E. Coli	610	MPN/100mL	1.0	1	AC24700	03/28/22 16:30	03/29/22 16:30	2303	SM9223B	
SW-10 (22C3445-03)			Sample Type: Water			Sampled: 03/28/22 09:30				
Metals by EPA 200 Series Methods										
Arsenic	ND	mg/L	0.020	1	AC24656	03/29/22 07:12	03/29/22 12:41	2303	EPA 200.7	
Boron	ND	mg/L	0.10	1	AC24656	03/29/22 07:12	03/29/22 12:41	2303	EPA 200.7	
Calcium	8.8	mg/L	0.050	1	AC24656	03/29/22 07:12	03/29/22 12:41	2303	EPA 200.7	
Chromium	ND	mg/L	0.010	1	AC24656	03/29/22 07:12	03/29/22 12:41	2303	EPA 200.7	
Copper	ND	mg/L	0.020	1	AC24656	03/29/22 07:12	03/29/22 12:41	2303	EPA 200.7	
Iron	0.15	mg/L	0.10	1	AC24656	03/29/22 07:12	03/29/22 12:41	2303	EPA 200.7	
Lead	ND	mg/L	0.020	1	AC24656	03/29/22 07:12	03/29/22 12:41	2303	EPA 200.7	
Magnesium	4.9	mg/L	0.050	1	AC24656	03/29/22 07:12	03/29/22 12:41	2303	EPA 200.7	
Manganese	ND	mg/L	0.020	1	AC24656	03/29/22 07:12	03/29/22 12:41	2303	EPA 200.7	
Mercury	ND	ug/L	0.20	1	AD23114	04/01/22 09:43	04/04/22 12:47	1551	EPA 245.1	
Sodium	ND	mg/L	5.0	1	AC24656	03/29/22 07:12	03/29/22 12:41	2303	EPA 200.7	
Vanadium	ND	mg/L	0.020	1	AC24656	03/29/22 07:12	03/29/22 12:41	2303	EPA 200.7	
Zinc	ND	mg/L	0.050	1	AC24656	03/29/22 07:12	03/29/22 12:41	2303	EPA 200.7	

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Surface Water
Project Number: [none]

Reported:
04/12/22 13:40

	Result	Units	Reporting Limit	Dilution	Batch	Prepared	Analyzed	ELAP#	Method	Note
SW-10 (22C3445-03)										
Sample Type: Water					Sampled: 03/28/22 09:30					
Conventional Chemistry Parameters by APHA/EPA Methods										
Dissolved Oxygen	11	mg/L	0.20	1	AC23065	03/28/22 16:00	03/28/22 16:34	2303	SM4500-O G	T-14
pH	7.44	pH Units	1.00	1	AC23600	03/28/22 13:35	03/28/22 16:00	2303	SM4500-H+ B	T-14
Specific Conductance (EC)	180	umhos/cm	10	1	AC23600	03/28/22 13:35	03/28/22 16:00	2303	SM2510B	
Total Alkalinity as CaCO3	47	mg/L	5.0	1	AC24612	03/28/22 12:59	03/30/22 13:22	2303	SM2320B	
Total Suspended Solids	2.0	mg/L	1.0	1	AC24666	03/29/22 10:15	03/29/22 16:30	1551	SM2540D	
Turbidity	2.5	NTU	1.0	1	AC23065	03/29/22 08:00	03/29/22 14:27	2303	SM2130B	
Bicarbonate Alkalinity as CaCO3	46	mg/L	5.0	1	AC24612	03/28/22 12:59	03/30/22 13:22	2303	SM2320B	
Carbonate Alkalinity as CaCO3	ND	mg/L	5.0	1	AC24612	03/28/22 12:59	03/30/22 13:22	2303	SM2320B	
Hydroxide Alkalinity as CaCO3	ND	mg/L	5.0	1	AC24612	03/28/22 12:59	03/30/22 13:22	2303	SM2320B	
Hardness, Total	42	mg/L	1	1	AC24656	03/29/22 07:12	03/29/22 12:41	2303	SM2340B	
Anions by EPA Method 300.0										
Sulfate as SO4	2.8	mg/L	0.50	1	AC24620	03/28/22 13:36	03/28/22 15:26	2303	EPA 300.0	
Microbiological Parameters by APHA Standard Methods										
Total Coliforms	920	MPN/100mL	1.0	1	AC24700	03/28/22 16:30	03/29/22 16:30	2303	SM9223B	
E. Coli	7.4	MPN/100mL	1.0	1	AC24700	03/28/22 16:30	03/29/22 16:30	2303	SM9223B	
SW-8 (22C3445-04)										
Sample Type: Water					Sampled: 03/28/22 10:00					
Metals by EPA 200 Series Methods										
Arsenic	ND	mg/L	0.020	1	AC24656	03/29/22 07:12	03/29/22 12:44	2303	EPA 200.7	
Boron	ND	mg/L	0.10	1	AC24656	03/29/22 07:12	03/29/22 12:44	2303	EPA 200.7	
Calcium	8.8	mg/L	0.050	1	AC24656	03/29/22 07:12	03/29/22 12:44	2303	EPA 200.7	
Chromium	ND	mg/L	0.010	1	AC24656	03/29/22 07:12	03/29/22 12:44	2303	EPA 200.7	
Copper	ND	mg/L	0.020	1	AC24656	03/29/22 07:12	03/29/22 12:44	2303	EPA 200.7	
Iron	0.14	mg/L	0.10	1	AC24656	03/29/22 07:12	03/29/22 12:44	2303	EPA 200.7	
Lead	ND	mg/L	0.020	1	AC24656	03/29/22 07:12	03/29/22 12:44	2303	EPA 200.7	
Magnesium	4.9	mg/L	0.050	1	AC24656	03/29/22 07:12	03/29/22 12:44	2303	EPA 200.7	
Manganese	ND	mg/L	0.020	1	AC24656	03/29/22 07:12	03/29/22 12:44	2303	EPA 200.7	
Mercury	ND	ug/L	0.20	1	AD23114	04/01/22 09:43	04/04/22 13:15	1551	EPA 245.1	
Sodium	ND	mg/L	5.0	1	AC24656	03/29/22 07:12	03/29/22 12:44	2303	EPA 200.7	
Vanadium	ND	mg/L	0.020	1	AC24656	03/29/22 07:12	03/29/22 12:44	2303	EPA 200.7	
Zinc	ND	mg/L	0.050	1	AC24656	03/29/22 07:12	03/29/22 12:44	2303	EPA 200.7	

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Surface Water
Project Number: [none]

Reported:
04/12/22 13:40

	Result	Units	Reporting Limit	Dilution	Batch	Prepared	Analyzed	ELAP#	Method	Note
SW-8 (22C3445-04)			Sample Type: Water			Sampled: 03/28/22 10:00				
Conventional Chemistry Parameters by APHA/EPA Methods										
Dissolved Oxygen	11	mg/L	0.20	1	AC23065	03/28/22 16:00	03/28/22 16:34	2303	SM4500-O G	T-14
pH	7.48	pH Units	1.00	1	AC23600	03/28/22 13:35	03/28/22 16:00	2303	SM4500-H+ B	T-14
Specific Conductance (EC)	180	umhos/cm	10	1	AC23600	03/28/22 13:35	03/28/22 16:00	2303	SM2510B	
Total Alkalinity as CaCO3	45	mg/L	5.0	1	AC24612	03/28/22 12:59	03/30/22 13:22	2303	SM2320B	
Total Suspended Solids	2.2	mg/L	1.0	1	AC24666	03/29/22 10:15	03/29/22 16:30	1551	SM2540D	
Turbidity	2.6	NTU	1.0	1	AC23065	03/29/22 08:00	03/29/22 14:27	2303	SM2130B	
Bicarbonate Alkalinity as CaCO3	45	mg/L	5.0	1	AC24612	03/28/22 12:59	03/30/22 13:22	2303	SM2320B	
Carbonate Alkalinity as CaCO3	ND	mg/L	5.0	1	AC24612	03/28/22 12:59	03/30/22 13:22	2303	SM2320B	
Hydroxide Alkalinity as CaCO3	ND	mg/L	5.0	1	AC24612	03/28/22 12:59	03/30/22 13:22	2303	SM2320B	
Hardness, Total	42	mg/L	1	1	AC24656	03/29/22 07:12	03/29/22 12:44	2303	SM2340B	
Anions by EPA Method 300.0										
Sulfate as SO4	2.8	mg/L	0.50	1	AC24620	03/28/22 13:36	03/28/22 15:43	2303	EPA 300.0	
Microbiological Parameters by APHA Standard Methods										
Total Coliforms	120	MPN/100mL	1.0	1	AC24700	03/28/22 16:30	03/29/22 16:30	2303	SM9223B	
E. Coli	8.6	MPN/100mL	1.0	1	AC24700	03/28/22 16:30	03/29/22 16:30	2303	SM9223B	
SW-6 (22C3445-05)			Sample Type: Water			Sampled: 03/28/22 11:00				
Metals by EPA 200 Series Methods										
Arsenic	ND	mg/L	0.020	1	AC24656	03/29/22 07:12	03/29/22 12:47	2303	EPA 200.7	
Boron	ND	mg/L	0.10	1	AC24656	03/29/22 07:12	03/29/22 12:47	2303	EPA 200.7	
Calcium	8.7	mg/L	0.050	1	AC24656	03/29/22 07:12	03/29/22 12:47	2303	EPA 200.7	
Chromium	ND	mg/L	0.010	1	AC24656	03/29/22 07:12	03/29/22 12:47	2303	EPA 200.7	
Copper	ND	mg/L	0.020	1	AC24656	03/29/22 07:12	03/29/22 12:47	2303	EPA 200.7	
Iron	0.14	mg/L	0.10	1	AC24656	03/29/22 07:12	03/29/22 12:47	2303	EPA 200.7	
Lead	ND	mg/L	0.020	1	AC24656	03/29/22 07:12	03/29/22 12:47	2303	EPA 200.7	
Magnesium	4.9	mg/L	0.050	1	AC24656	03/29/22 07:12	03/29/22 12:47	2303	EPA 200.7	
Manganese	ND	mg/L	0.020	1	AC24656	03/29/22 07:12	03/29/22 12:47	2303	EPA 200.7	
Mercury	ND	ug/L	0.20	1	AD23114	04/01/22 09:43	04/04/22 13:18	1551	EPA 245.1	
Sodium	ND	mg/L	5.0	1	AC24656	03/29/22 07:12	03/29/22 12:47	2303	EPA 200.7	
Vanadium	ND	mg/L	0.020	1	AC24656	03/29/22 07:12	03/29/22 12:47	2303	EPA 200.7	
Zinc	ND	mg/L	0.050	1	AC24656	03/29/22 07:12	03/29/22 12:47	2303	EPA 200.7	



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Surface Water
Project Number: [none]

Reported:
04/12/22 13:40

	Result	Units	Reporting Limit	Dilution	Batch	Prepared	Analyzed	ELAP#	Method	Note
SW-6 (22C3445-05)			Sample Type: Water			Sampled: 03/28/22 11:00				
Conventional Chemistry Parameters by APHA/EPA Methods										
Dissolved Oxygen	11	mg/L	0.20	1	AC23065	03/28/22 16:00	03/28/22 16:34	2303	SM4500-O G	T-14
pH	7.56	pH Units	1.00	1	AC23600	03/28/22 13:35	03/28/22 16:00	2303	SM4500-H+ B	T-14
Specific Conductance (EC)	180	umhos/cm	10	1	AC23600	03/28/22 13:35	03/28/22 16:00	2303	SM2510B	
Total Alkalinity as CaCO3	45	mg/L	5.0	1	AC24612	03/28/22 12:59	03/30/22 13:22	2303	SM2320B	
Total Suspended Solids	1.8	mg/L	1.0	1	AC24666	03/29/22 10:15	03/29/22 16:30	1551	SM2540D	
Turbidity	2.5	NTU	1.0	1	AC23065	03/29/22 08:00	03/29/22 14:27	2303	SM2130B	
Bicarbonate Alkalinity as CaCO3	44	mg/L	5.0	1	AC24612	03/28/22 12:59	03/30/22 13:22	2303	SM2320B	
Carbonate Alkalinity as CaCO3	ND	mg/L	5.0	1	AC24612	03/28/22 12:59	03/30/22 13:22	2303	SM2320B	
Hydroxide Alkalinity as CaCO3	ND	mg/L	5.0	1	AC24612	03/28/22 12:59	03/30/22 13:22	2303	SM2320B	
Hardness, Total	42	mg/L	1	1	AC24656	03/29/22 07:12	03/29/22 12:47	2303	SM2340B	
Anions by EPA Method 300.0										
Sulfate as SO4	2.9	mg/L	0.50	1	AC24620	03/28/22 13:36	03/28/22 16:01	2303	EPA 300.0	
Microbiological Parameters by APHA Standard Methods										
Total Coliforms	1000	MPN/100mL	1.0	1	AC24700	03/28/22 16:30	03/29/22 16:30	2303	SM9223B	
E. Coli	14	MPN/100mL	1.0	1	AC24700	03/28/22 16:30	03/29/22 16:30	2303	SM9223B	



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Surface Water
Project Number: [none]

Reported:
04/12/22 13:40

Metals by EPA 200 Series Methods - Quality Control

Analyte(s)	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Flag
------------	--------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------	------

Batch AC24656 - NB EPA 200 series

Blank (AC24656-BLK1)

Prepared & Analyzed: 03/29/22

Arsenic	ND	0.020	mg/L
Boron	ND	0.10	mg/L
Calcium	ND	0.050	mg/L
Chromium	ND	0.010	mg/L
Copper	ND	0.020	mg/L
Iron	ND	0.10	mg/L
Lead	ND	0.020	mg/L
Magnesium	ND	0.050	mg/L
Manganese	ND	0.020	mg/L
Sodium	ND	5.0	mg/L
Vanadium	ND	0.020	mg/L
Zinc	ND	0.050	mg/L

LCS (AC24656-BS1)

Prepared & Analyzed: 03/29/22

Arsenic	0.526	0.020	mg/L	0.500	105	85-115
Boron	0.512	0.10	mg/L	0.500	102	85-115
Calcium	25.6	0.050	mg/L	25.5	101	85-115
Chromium	0.495	0.010	mg/L	0.500	98.9	85-115
Copper	0.496	0.020	mg/L	0.500	99.1	85-115
Iron	0.512	0.10	mg/L	0.500	102	85-115
Lead	0.481	0.020	mg/L	0.500	96.1	85-115
Magnesium	26.4	0.050	mg/L	25.5	104	85-115
Manganese	0.534	0.020	mg/L	0.500	107	85-115
Sodium	26.3	5.0	mg/L	25.5	103	85-115
Vanadium	0.502	0.020	mg/L	0.500	100	85-115
Zinc	0.552	0.050	mg/L	0.500	110	85-115

LCS Dup (AC24656-BSD1)

Prepared & Analyzed: 03/29/22

Arsenic	0.534	0.020	mg/L	0.500	107	85-115	1.60	20
Boron	0.516	0.10	mg/L	0.500	103	85-115	0.836	20
Calcium	25.3	0.050	mg/L	25.5	99.3	85-115	1.23	20
Chromium	0.500	0.010	mg/L	0.500	100	85-115	1.07	20
Copper	0.500	0.020	mg/L	0.500	100	85-115	0.904	20
Iron	0.520	0.10	mg/L	0.500	104	85-115	1.43	20
Lead	0.488	0.020	mg/L	0.500	97.5	85-115	1.43	20

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Surface Water
Project Number: [none]

Reported:
04/12/22 13:40

Metals by EPA 200 Series Methods - Quality Control

Analyte(s)	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Flag
Batch AC24656 - NB EPA 200 series										
LCS Dup (AC24656-BSD1)				Prepared & Analyzed: 03/29/22						
Magnesium	26.4	0.050	mg/L	25.5		103	85-115	0.151	20	
Manganese	0.540	0.020	mg/L	0.500		108	85-115	1.06	20	
Sodium	26.1	5.0	mg/L	25.5		102	85-115	0.728	20	
Vanadium	0.506	0.020	mg/L	0.500		101	85-115	0.793	20	
Zinc	0.561	0.050	mg/L	0.500		112	85-115	1.76	20	
Duplicate (AC24656-DUP1)				Source: 22C3445-01		Prepared & Analyzed: 03/29/22				
Arsenic	ND	0.020	mg/L		ND				20	
Boron	ND	0.10	mg/L		ND			0.884	20	
Calcium	8.78	0.050	mg/L		8.76			0.145	20	
Chromium	ND	0.010	mg/L		ND				20	
Copper	ND	0.020	mg/L		ND				20	
Iron	0.143	0.10	mg/L		0.146			2.63	20	
Magnesium	4.92	0.050	mg/L		4.91			0.159	20	
Manganese	ND	0.020	mg/L		ND			0.00	20	
Sodium	ND	5.0	mg/L		ND			0.186	20	
MRL Check (AC24656-MRL1)				Prepared & Analyzed: 03/29/22						
Boron	0.0914	0.10	mg/L	0.100		91.4	0-200			
Calcium	4.49	0.050	mg/L	5.00		89.9	0-200			
Copper	0.0439	0.020	mg/L	0.0500		87.8	0-200			
Iron	0.0941	0.10	mg/L	0.100		94.1	0-200			
Magnesium	0.490	0.050	mg/L	0.500		98.1	0-200			
Manganese	0.0170	0.020	mg/L	0.0200		85.0	0-200			
Sodium	4.70	5.0	mg/L	5.00		94.0	0-200			
Zinc	0.0734	0.050	mg/L	0.0500		147	0-200			
Matrix Spike (AC24656-MS1)				Source: 22C3445-02		Prepared & Analyzed: 03/29/22				
Arsenic	0.547	0.020	mg/L	0.500	ND	109	70-130			
Boron	0.891	0.10	mg/L	0.500	0.352	108	70-130			
Chromium	0.506	0.010	mg/L	0.500	ND	101	70-130			
Copper	0.516	0.020	mg/L	0.500	ND	103	70-130			
Iron	0.759	0.10	mg/L	0.500	0.231	106	70-130			
Lead	0.491	0.020	mg/L	0.500	ND	98.2	70-130			
Manganese	0.628	0.020	mg/L	0.500	0.0844	109	70-130			
Sodium	46.9	5.0	mg/L	25.5	20.4	104	70-130			

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Surface Water
Project Number: [none]

Reported:
04/12/22 13:40

Metals by EPA 200 Series Methods - Quality Control

Analyte(s)	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Flag
Batch AC24656 - NB EPA 200 series										
Matrix Spike (AC24656-MS1)		Source: 22C3445-02		Prepared & Analyzed: 03/29/22						
Vanadium	0.517	0.020	mg/L	0.500	ND	103	70-130			
Zinc	0.564	0.050	mg/L	0.500	ND	113	70-130			
Batch AD23114 - Hg Digest										
Blank (AD23114-BLK1)		Prepared: 04/01/22 Analyzed: 04/04/22								
Mercury	ND	0.20	ug/L							
LCS (AD23114-BS1)		Prepared: 04/01/22 Analyzed: 04/04/22								
Mercury	2.94	0.20	ug/L	2.50		117	85-115			QL-11
Duplicate (AD23114-DUP1)		Source: 22C3445-01		Prepared: 04/01/22 Analyzed: 04/04/22						
Mercury	ND	0.20	ug/L		ND			3.39	20	
Matrix Spike (AD23114-MS1)		Source: 22C3445-01		Prepared: 04/01/22 Analyzed: 04/04/22						
Mercury	3.07	0.20	ug/L	2.50	ND	119	70-130			
Matrix Spike Dup (AD23114-MSD1)		Source: 22C3445-01		Prepared: 04/01/22 Analyzed: 04/04/22						
Mercury	3.09	0.20	ug/L	2.50	ND	120	70-130	0.584	20	



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Surface Water
Project Number: [none]

Reported:
04/12/22 13:40

Conventional Chemistry Parameters by APHA/EPA Methods - Quality Control

Analyte(s)	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Flag
------------	--------	--------------------	-------	----------------	------------------	------	----------------	-----	--------------	------

Batch AC23600 - NB General Prep

Duplicate (AC23600-DUP1)

Source: 22C1375-01

Prepared & Analyzed: 03/09/22

pH	6.46	1.00	pH Units		6.46			0.00	20	
Specific Conductance (EC)	776	10	umhos/cm		775			0.129	5	

Batch AC24612 - NB General Prep

Blank (AC24612-BLK1)

Prepared: 03/28/22 Analyzed: 03/30/22

Total Alkalinity as CaCO ₃	ND	5.0	mg/L							
Bicarbonate Alkalinity as CaCO ₃	ND	5.0	mg/L							
Carbonate Alkalinity as CaCO ₃	ND	5.0	mg/L							
Hydroxide Alkalinity as CaCO ₃	ND	5.0	mg/L							

LCS (AC24612-BS1)

Prepared: 03/28/22 Analyzed: 03/30/22

Total Alkalinity as CaCO ₃	1010	5.0	mg/L	1020		98.7	80-120			
---------------------------------------	------	-----	------	------	--	------	--------	--	--	--

Duplicate (AC24612-DUP1)

Source: 22C3445-05

Prepared: 03/28/22 Analyzed: 03/30/22

Total Alkalinity as CaCO ₃	44.6	5.0	mg/L		44.6			0.00	20	
Bicarbonate Alkalinity as CaCO ₃	44.5	5.0	mg/L		44.5			0.00	20	
Carbonate Alkalinity as CaCO ₃	ND	5.0	mg/L		ND				20	
Hydroxide Alkalinity as CaCO ₃	ND	5.0	mg/L		ND				20	

Batch AC24656 - NB EPA 200 series

Blank (AC24656-BLK1)

Prepared & Analyzed: 03/29/22

Hardness, Total	ND	1	mg/L							
-----------------	----	---	------	--	--	--	--	--	--	--

Duplicate (AC24656-DUP1)

Source: 22C3445-01

Prepared & Analyzed: 03/29/22

Hardness, Total	42	1	mg/L		42			0.150	20	
-----------------	----	---	------	--	----	--	--	-------	----	--



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Surface Water
Project Number: [none]

Reported:
04/12/22 13:40

Conventional Chemistry Parameters by APHA/EPA Methods - Quality Control

Analyte(s)	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Flag
Batch AC24666 - General Preparation										
Blank (AC24666-BLK1)				Prepared & Analyzed: 03/29/22						
Total Suspended Solids	ND	1.0	mg/L							
Duplicate (AC24666-DUP1)				Source: 22C3379-01 Prepared & Analyzed: 03/29/22						
Total Suspended Solids	62.0	1.0	mg/L		61.3			1.18	30	
Duplicate (AC24666-DUP2)				Source: 22C3510-01 Prepared & Analyzed: 03/29/22						
Total Suspended Solids	1590	1.0	mg/L		1550			2.25	30	



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Surface Water
Project Number: [none]

Reported:
04/12/22 13:40

Anions by EPA Method 300.0 - Quality Control

Analyte(s)	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Flag
Batch AC24620 - NB General Prep										
Blank (AC24620-BLK1)				Prepared & Analyzed: 03/28/22						
Sulfate as SO ₄	ND	0.50	mg/L							
LCS (AC24620-BS1)				Prepared & Analyzed: 03/28/22						
Sulfate as SO ₄	4.89	0.50	mg/L	5.00		97.8	90-110			
Duplicate (AC24620-DUP1)				Source: 22C3445-04		Prepared & Analyzed: 03/28/22				
Sulfate as SO ₄	2.83	0.50	mg/L		2.78			1.88	20	
MRL Check (AC24620-MRL1)				Prepared & Analyzed: 03/28/22						
Sulfate as SO ₄	1.02	0.50	mg/L	1.00		102	60-140			
Matrix Spike (AC24620-MS1)				Source: 22C3445-05		Prepared & Analyzed: 03/28/22				
Sulfate as SO ₄	7.92	0.50	mg/L	5.00	2.86	101	80-120			
Matrix Spike Dup (AC24620-MSD1)				Source: 22C3445-05		Prepared & Analyzed: 03/28/22				
Sulfate as SO ₄	7.86	0.50	mg/L	5.00	2.86	99.9	80-120	0.757	20	



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Surface Water
Project Number: [none]

Reported:
04/12/22 13:40

Notes and Definitions

- QL-11 The LCS and/or LCSD recovery was high for this analyte. Sample results in the batch were accepted based on non-detect for the analyte.
- T-14 Residual chlorine, dissolved oxygen, sulfite, and pH must be analyzed in the field to meet the EPA specified 15 minute hold time.
- ND Analyte NOT DETECTED at or above the reporting limit
- dry Sample results reported on a dry weight basis
- REC Recovery
- RPD Relative Percent Difference

Non-accredited analytes are reported only when ELAP accreditation for a requested analyte method pair is not available. For a list of accredited analytes, view our certificates at the Company link on our website at www.alpha-labs.com or contact your Project Manager directly.

[illegible]



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

11 July 2022

Bottle Rock Power

Attn: M. Moore

4010 Stone Way North, Suite 400

Seattle, WA 98103

RE: Groundwater

Work Order: 22F3264

Enclosed are the results of analyses for samples received by the laboratory on 06/28/22 11:15. If you have any questions concerning this report, please feel free to contact me.

Sincerely,

Jeanette L. Poplin For Stephen F. McWeeney
Lab Manager



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Groundwater
Project Number: [none]

Reported:
07/11/22 13:32

Bay Area: 262 Rickenbacker Circle | Livermore, CA 94551 | T: 925-828-6226 | F: 925-828-6309 | ELAP# 2728
Central Valley: 9090 Union Park Way Suite 113 | Elk Grove, CA 95624 | T: 916-686-5190 | F: 916-686-5192 | ELAP# 2922
North Bay: 110 Liberty Street | Petaluma, CA 94952 | T: 707-769-3128 | F: 707-769-8093 | ELAP# 2303
San Diego: 2722 Loker Avenue West Suite A | Carlsbad, CA 92010 | T: 760-930-2555 | F: 760-930-2510 | ELAP# 3055

ANALYTICAL REPORT FOR SAMPLES

Sample ID	Laboratory ID	Matrix	Date Sampled	Date Received
GW-3	22F3264-01	Water	06/28/22 06:50	06/28/22 11:15
GW-1	22F3264-02	Water	06/28/22 08:00	06/28/22 11:15



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Groundwater
Project Number: [none]

Reported:
07/11/22 13:32

	Result	Units	Reporting Limit	Dilution	Batch	Prepared	Analyzed	ELAP#	Method	Note
GW-3 (22F3264-01)			Sample Type: Water			Sampled: 06/28/22 06:50				
Metals by EPA 200 Series Methods										
Arsenic	ND	ug/L	2.0	1	AF24473	06/29/22 06:25	06/29/22 13:29	2303	EPA 200.5	
Boron	0.39	mg/L	0.10	1	AF24474	06/29/22 06:41	06/29/22 09:33	2303	EPA 200.7	
Calcium	33	mg/L	5.0	1	AF24474	06/29/22 06:41	06/29/22 09:33	2303	EPA 200.7	
Copper	ND	mg/L	0.050	1	AF24474	06/29/22 06:41	06/29/22 09:33	2303	EPA 200.7	
Iron	1.2	mg/L	0.10	1	AF24474	06/29/22 06:41	06/29/22 09:33	2303	EPA 200.7	
Lead	ND	mg/L	0.020	1	AF24474	06/29/22 06:41	06/29/22 09:33	2303	EPA 200.7	
Magnesium	9.8	mg/L	0.60	1	AF24474	06/29/22 06:41	06/29/22 09:33	2303	EPA 200.7	
Manganese	0.22	mg/L	0.020	1	AF24474	06/29/22 06:41	06/29/22 09:33	2303	EPA 200.7	
Sodium	25	mg/L	6.0	1	AF24474	06/29/22 06:41	06/29/22 09:33	2303	EPA 200.7	
Zinc	ND	mg/L	0.20	1	AF24474	06/29/22 06:41	06/29/22 09:33	2303	EPA 200.7	
Conventional Chemistry Parameters by APHA/EPA Methods										
pH	7.73	pH Units	1.00	1	AF24442	06/28/22 14:00	06/28/22 14:01	2303	SM4500-H+ B	T-14
Specific Conductance (EC)	340	umhos/cm	10	1	AF24442	06/28/22 14:00	06/28/22 14:01	2303	SM2510B	
Total Alkalinity as CaCO3	170	mg/L	5.0	1	AG23175	07/01/22 08:00	07/05/22 12:01	2303	SM2320B	
Total Suspended Solids	1.6	mg/L	1.0	1	AF24563	06/30/22 14:15	07/01/22 10:15	1551	SM2540D	
Turbidity	5.4	NTU	1.0	1	AF23262	06/28/22 14:00	06/29/22 09:28	2303	SM2130B	
Bicarbonate Alkalinity as CaCO3	170	mg/L	5.0	1	AG23175	07/01/22 08:00	07/05/22 12:01	2303	SM2320B	
Carbonate Alkalinity as CaCO3	ND	mg/L	5.0	1	AG23175	07/01/22 08:00	07/05/22 12:01	2303	SM2320B	
Hydroxide Alkalinity as CaCO3	ND	mg/L	5.0	1	AG23175	07/01/22 08:00	07/05/22 12:01	2303	SM2320B	
Hardness, Total	122	mg/L	1	1	AF24474	06/29/22 06:41	06/29/22 09:33	2303	SM2340B	
Anions by EPA Method 300.0										
Nitrate as N	ND	mg/L	0.40	1	AF24454	06/28/22 15:00	06/28/22 15:39	2303	EPA 300.0	
Sulfate as SO4	5.4	mg/L	0.50	1	AF24454	06/28/22 15:00	06/28/22 15:39	2303	EPA 300.0	
GW-1 (22F3264-02)			Sample Type: Water			Sampled: 06/28/22 08:00				
Metals by EPA 200 Series Methods										
Arsenic	ND	ug/L	2.0	1	AF24473	06/29/22 06:25	06/29/22 13:29	2303	EPA 200.5	
Boron	ND	mg/L	0.10	1	AF24474	06/29/22 06:41	06/29/22 09:36	2303	EPA 200.7	
Calcium	48	mg/L	5.0	1	AF24474	06/29/22 06:41	06/29/22 09:36	2303	EPA 200.7	
Copper	ND	mg/L	0.050	1	AF24474	06/29/22 06:41	06/29/22 09:36	2303	EPA 200.7	
Iron	0.19	mg/L	0.10	1	AF24474	06/29/22 06:41	06/29/22 09:36	2303	EPA 200.7	
Lead	ND	mg/L	0.020	1	AF24474	06/29/22 06:41	06/29/22 09:36	2303	EPA 200.7	
Magnesium	16	mg/L	0.60	1	AF24474	06/29/22 06:41	06/29/22 09:36	2303	EPA 200.7	
Manganese	0.11	mg/L	0.020	1	AF24474	06/29/22 06:41	06/29/22 09:36	2303	EPA 200.7	
Sodium	8.9	mg/L	6.0	1	AF24474	06/29/22 06:41	06/29/22 09:36	2303	EPA 200.7	
Zinc	ND	mg/L	0.20	1	AF24474	06/29/22 06:41	06/29/22 09:36	2303	EPA 200.7	

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Groundwater
Project Number: [none]

Reported:
07/11/22 13:32

	Result	Units	Reporting Limit	Dilution	Batch	Prepared	Analyzed	ELAP#	Method	Note
GW-1 (22F3264-02)			Sample Type: Water			Sampled: 06/28/22 08:00				
Conventional Chemistry Parameters by APHA/EPA Methods										
pH	7.70	pH Units	1.00	1	AF24442	06/28/22 14:00	06/28/22 14:01	2303	SM4500-H+ B	T-14
Specific Conductance (EC)	380	umhos/cm	10	1	AF24442	06/28/22 14:00	06/28/22 14:01	2303	SM2510B	
Total Alkalinity as CaCO3	180	mg/L	5.0	1	AG23175	07/01/22 08:00	07/05/22 12:01	2303	SM2320B	
Total Suspended Solids	ND	mg/L	1.0	1	AF24563	06/30/22 14:15	07/01/22 10:15	1551	SM2540D	
Turbidity	ND	NTU	1.0	1	AF23262	06/28/22 14:00	06/29/22 09:28	2303	SM2130B	
Bicarbonate Alkalinity as CaCO3	180	mg/L	5.0	1	AG23175	07/01/22 08:00	07/05/22 12:01	2303	SM2320B	
Carbonate Alkalinity as CaCO3	ND	mg/L	5.0	1	AG23175	07/01/22 08:00	07/05/22 12:01	2303	SM2320B	
Hydroxide Alkalinity as CaCO3	ND	mg/L	5.0	1	AG23175	07/01/22 08:00	07/05/22 12:01	2303	SM2320B	
Hardness, Total	184	mg/L	1	1	AF24474	06/29/22 06:41	06/29/22 09:36	2303	SM2340B	
Anions by EPA Method 300.0										
Nitrate as N	ND	mg/L	0.40	1	AF24454	06/28/22 15:00	06/28/22 15:51	2303	EPA 300.0	
Sulfate as SO4	19	mg/L	0.50	1	AF24454	06/28/22 15:00	06/28/22 15:51	2303	EPA 300.0	



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Groundwater
Project Number: [none]

Reported:
07/11/22 13:32

Metals by EPA 200 Series Methods - Quality Control

Analyte(s)	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Flag
Batch AF24473 - NB EPA 200 series										
Blank (AF24473-BLK1)				Prepared & Analyzed: 06/29/22						
Arsenic	ND	2.0	ug/L							
LCS (AF24473-BS1)				Prepared & Analyzed: 06/29/22						
Arsenic	9.26	2.0	ug/L	10.0		92.6	85-115			
LCS Dup (AF24473-BSD1)				Prepared & Analyzed: 06/29/22						
Arsenic	9.47	2.0	ug/L	10.0		94.7	85-115	2.30	20	
Duplicate (AF24473-DUP1)				Source: 22F3274-01		Prepared & Analyzed: 06/29/22				
Arsenic	ND	2.0	ug/L		ND				20	
MRL Check (AF24473-MRL1)				Prepared & Analyzed: 06/29/22						
Arsenic	2.64	2.0	ug/L	2.00		132	0-200			
Matrix Spike (AF24473-MS1)				Source: 22F3284-01		Prepared & Analyzed: 06/29/22				
Arsenic	10.5	2.0	ug/L	10.0	ND	105	70-130			
Batch AF24474 - NB EPA 200 series DA										
Blank (AF24474-BLK1)				Prepared & Analyzed: 06/29/22						
Boron	ND	0.10	mg/L							
Calcium	ND	5.0	mg/L							
Copper	ND	0.050	mg/L							
Iron	ND	0.10	mg/L							
Lead	ND	0.020	mg/L							
Magnesium	ND	0.60	mg/L							
Manganese	ND	0.020	mg/L							
Sodium	ND	6.0	mg/L							
Zinc	ND	0.20	mg/L							



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Groundwater
Project Number: [none]

Reported:
07/11/22 13:32

Metals by EPA 200 Series Methods - Quality Control

Analyte(s)	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Flag
Batch AF24474 - NB EPA 200 series DA										
LCS (AF24474-BS1)				Prepared & Analyzed: 06/29/22						
Boron	0.486	0.10	mg/L	0.500		97.3	85-115			
Calcium	25.1	5.0	mg/L	25.5		98.5	85-115			
Copper	0.481	0.050	mg/L	0.500		96.2	85-115			
Iron	0.501	0.10	mg/L	0.500		100	85-115			
Lead	0.476	0.020	mg/L	0.500		95.2	85-115			
Magnesium	25.4	0.60	mg/L	25.5		99.7	85-115			
Manganese	0.514	0.020	mg/L	0.500		103	85-115			
Sodium	26.1	6.0	mg/L	25.5		102	85-115			
Zinc	0.497	0.20	mg/L	0.500		99.4	85-115			
LCS Dup (AF24474-BSD1)				Prepared & Analyzed: 06/29/22						
Boron	0.489	0.10	mg/L	0.500		97.8	85-115	0.492	20	
Calcium	25.1	5.0	mg/L	25.5		98.3	85-115	0.206	20	
Copper	0.480	0.050	mg/L	0.500		96.0	85-115	0.166	20	
Iron	0.502	0.10	mg/L	0.500		100	85-115	0.120	20	
Lead	0.475	0.020	mg/L	0.500		94.9	85-115	0.253	20	
Magnesium	25.4	0.60	mg/L	25.5		99.8	85-115	0.116	20	
Manganese	0.514	0.020	mg/L	0.500		103	85-115	0.00	20	
Sodium	26.1	6.0	mg/L	25.5		102	85-115	0.0713	20	
Zinc	0.495	0.20	mg/L	0.500		99.0	85-115	0.484	20	
Duplicate (AF24474-DUP1)				Source: 22F3187-01		Prepared & Analyzed: 06/29/22				
Boron	0.473	0.10	mg/L		0.550			15.1	20	
Calcium	25.2	5.0	mg/L		29.3			15.0	20	
Copper	ND	0.050	mg/L		ND				20	
Iron	ND	0.10	mg/L		ND				20	
Lead	ND	0.020	mg/L		ND				20	
Magnesium	16.0	0.60	mg/L		18.6			15.0	20	
Manganese	ND	0.020	mg/L		ND				20	
Sodium	45.2	6.0	mg/L		52.5			15.0	20	
Zinc	ND	0.20	mg/L		ND				20	

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Groundwater
Project Number: [none]

Reported:
07/11/22 13:32

Metals by EPA 200 Series Methods - Quality Control

Analyte(s)	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Flag
------------	--------	--------------------	-------	----------------	------------------	------	----------------	-----	--------------	------

Batch AF24474 - NB EPA 200 series DA

MRL Check (AF24474-MRL1)

Prepared & Analyzed: 06/29/22

Boron	0.0962	0.10	mg/L	0.100		96.2	0-200			
Calcium	4.91	5.0	mg/L	5.00		98.2	0-200			
Copper	0.0493	0.050	mg/L	0.0500		98.6	0-200			
Iron	0.0966	0.10	mg/L	0.100		96.6	0-200			
Magnesium	0.505	0.60	mg/L	0.500		101	0-200			
Manganese	0.0199	0.020	mg/L	0.0200		99.5	0-200			
Sodium	5.06	6.0	mg/L	5.00		101	0-200			
Zinc	ND	0.20	mg/L	0.0500			0-200			

Matrix Spike (AF24474-MS1)

Source: 22F3187-01

Prepared & Analyzed: 06/29/22

Boron	0.951	0.10	mg/L	0.500	0.550	80.1	70-130			
Copper	0.496	0.050	mg/L	0.500	ND	99.1	70-130			
Iron	0.512	0.10	mg/L	0.500	ND	102	70-130			
Lead	0.468	0.020	mg/L	0.500	ND	93.7	70-130			
Manganese	0.511	0.020	mg/L	0.500	ND	102	70-130			
Sodium	68.8	6.0	mg/L	25.5	52.5	63.8	70-130			QM-07
Zinc	0.512	0.20	mg/L	0.500	ND	102	70-130			



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Groundwater
Project Number: [none]

Reported:
07/11/22 13:32

Conventional Chemistry Parameters by APHA/EPA Methods - Quality Control

Analyte(s)	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Flag
------------	--------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------	------

Batch AF24442 - NB General Prep

Duplicate (AF24442-DUP1)

Source: 22F3264-01

Prepared & Analyzed: 06/28/22

pH	7.71	1.00	pH Units		7.73			0.259	20	
Specific Conductance (EC)	342	10	umhos/cm		342			0.00	5	

Batch AF24474 - NB EPA 200 series DA

Blank (AF24474-BLK1)

Prepared & Analyzed: 06/29/22

Hardness, Total	ND	1	mg/L							
-----------------	----	---	------	--	--	--	--	--	--	--

Duplicate (AF24474-DUP1)

Source: 22F3187-01

Prepared & Analyzed: 06/29/22

Hardness, Total	129	1	mg/L		150			15.0	20	
-----------------	-----	---	------	--	-----	--	--	------	----	--

Batch AF24563 - General Preparation

Blank (AF24563-BLK1)

Prepared: 06/30/22 Analyzed: 07/01/22

Total Suspended Solids	ND	1.0	mg/L							
------------------------	----	-----	------	--	--	--	--	--	--	--

Duplicate (AF24563-DUP1)

Source: 22F3343-01

Prepared: 06/30/22 Analyzed: 07/01/22

Total Suspended Solids	314	1.0	mg/L		317			0.982	30	
------------------------	-----	-----	------	--	-----	--	--	-------	----	--

Duplicate (AF24563-DUP2)

Source: 22F3405-03

Prepared: 06/30/22 Analyzed: 07/01/22

Total Suspended Solids	176	1.0	mg/L		179			1.57	30	
------------------------	-----	-----	------	--	-----	--	--	------	----	--

Batch AG23175 - NB General Prep

Blank (AG23175-BLK1)

Prepared: 07/01/22 Analyzed: 07/05/22

Total Alkalinity as CaCO ₃	ND	5.0	mg/L							
Bicarbonate Alkalinity as CaCO ₃	ND	5.0	mg/L							
Carbonate Alkalinity as CaCO ₃	ND	5.0	mg/L							
Hydroxide Alkalinity as CaCO ₃	ND	5.0	mg/L							



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Groundwater
Project Number: [none]

Reported:
07/11/22 13:32

Conventional Chemistry Parameters by APHA/EPA Methods - Quality Control

Analyte(s)	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Flag
------------	--------	--------------------	-------	----------------	------------------	------	----------------	-----	--------------	------

Batch AG23175 - NB General Prep

LCS (AG23175-BS1)

Prepared: 07/01/22 Analyzed: 07/05/22

Total Alkalinity as CaCO ₃	1000	5.0	mg/L	1000	100	80-120
---------------------------------------	------	-----	------	------	-----	--------

Duplicate (AG23175-DUP1)

Source: 22F3614-01

Prepared: 07/01/22 Analyzed: 07/05/22

Total Alkalinity as CaCO ₃	89.0	5.0	mg/L	89.5	0.560	20
Bicarbonate Alkalinity as CaCO ₃	88.8	5.0	mg/L	89.3	0.561	20
Carbonate Alkalinity as CaCO ₃	ND	5.0	mg/L	ND		20
Hydroxide Alkalinity as CaCO ₃	ND	5.0	mg/L	ND		20



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Groundwater
Project Number: [none]

Reported:
07/11/22 13:32

Anions by EPA Method 300.0 - Quality Control

Analyte(s)	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Flag
Batch AF24454 - NB General Prep										
Blank (AF24454-BLK1)				Prepared & Analyzed: 06/28/22						
Sulfate as SO ₄	ND	0.50	mg/L							
Nitrate as N	ND	0.40	mg/L							
LCS (AF24454-BS1)				Prepared & Analyzed: 06/28/22						
Sulfate as SO ₄	7.98	0.50	mg/L	8.00		99.7	90-110			
Nitrate as N	1.82	0.40	mg/L	1.80		101	90-110			
Duplicate (AF24454-DUP1)				Source: 22F3264-02		Prepared & Analyzed: 06/28/22				
Sulfate as SO ₄	19.3	0.50	mg/L		19.2			0.532	20	
Nitrate as N	ND	0.40	mg/L		ND				20	
MRL Check (AF24454-MRL1)				Prepared & Analyzed: 06/28/22						
Sulfate as SO ₄	1.56	0.50	mg/L	1.60		97.8	60-140			
Nitrate as N	0.396	0.40	mg/L	0.361		110	60-140			
Matrix Spike (AF24454-MS1)				Source: 22F3264-01		Prepared & Analyzed: 06/28/22				
Sulfate as SO ₄	13.4	0.50	mg/L	8.00	5.43	99.9	80-120			
Nitrate as N	1.81	0.40	mg/L	1.80	ND	100	80-120			
Matrix Spike Dup (AF24454-MSD1)				Source: 22F3264-01		Prepared & Analyzed: 06/28/22				
Sulfate as SO ₄	13.5	0.50	mg/L	8.00	5.43	100	80-120	0.260	20	
Nitrate as N	1.81	0.40	mg/L	1.80	ND	101	80-120	0.386	20	



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Groundwater
Project Number: [none]

Reported:
07/11/22 13:32

Notes and Definitions

- QM-07 The spike recovery was outside acceptance limits for the MS and/or MSD. The batch was accepted based on acceptable LCS recovery.
- T-14 Residual chlorine, dissolved oxygen, sulfite, and pH must be analyzed in the field to meet the EPA specified 15 minute hold time.
- ND Analyte NOT DETECTED at or above the reporting limit
- dry Sample results reported on a dry weight basis
- REC Recovery
- RPD Relative Percent Difference

Non-accredited analytes are reported only when ELAP accreditation for a requested analyte method pair is not available. For a list of accredited analytes, view our certificates at the Company link on our website at www.alpha-labs.com or contact your Project Manager directly.



Report to		Invoice to (if different)		Project Information		Signature below authorizes work under terms stated on reverse side.																																					
Company: Bottle Rock Power		Contact:		Project ID: Bottle Rock Monitoring-GW		<div>Analysis Request</div> <div>TAT</div> <div>TEMP °C</div> <div>Standard 10 days</div> <div><input type="radio"/></div> <div>RUSH:</div> <div>5 days</div> <div><input type="radio"/></div> <div>48 hours</div> <div><input type="radio"/></div> <div>Other:</div> <div>____ days</div> <div><input type="radio"/></div> <div>Preapproval required</div> <div>Notes / DDW Source Codes</div> <div>Ukiah</div> <div>Livermore</div> <div>Elk Grove</div> <div>Petaluma</div> <div>13.9</div> <div>Carlsbad</div>																																					
Attn: Jay Hopper Richard Lacy		Email address:		Project No:																																							
Address: PO Box 326 Cobb, CA 95426		Address:		PO Number:																																							
Phone/Fax: 707-529-3799		Phone/Fax:																																									
Email Address:																																											
Field Sampler -Printed Name & Signature: Richard Lacy Richard Lacy		Container		Preservative		Matrix		<div>Total Number of Containers per Sample ID</div> <div>ALK, Ph, ec</div> <div>Turbidity & TSS</div> <div>Hardness, SO4</div> <div>B, Cu, Fe & Pb</div> <div>Mn, Na & Zn</div> <div>As & NO3</div>																																			
Sample Identification		Sampling		40ml VOA Vial		Plastic														Glass		Sleeve		Other		HCl		HNO3		H2SO4		Other		None		Drinking Water		Wastewater		Soil		Other	
Date		Time																																									
GW-3		6/28/22 6:50am				X																																					
GW-1		6/28/22 8:00				X																																					
Relinquished by		Received by		Date		Time		DDW Write On EDT Transmission? <input type="radio"/> Yes <input type="radio"/> No																																			
Richard Lacy		[Signature]		6/28/22		1115		State System Number: _____																																			
								If "Y" please enter the Source Number(s) in the column above																																			
								CA Geotracker EDF Report? <input type="radio"/> Yes <input type="radio"/> No																																			
								Global ID: _____ Sampling Company Log Code: _____																																			
								EDF to (Email Address): _____																																			
								Travel and Site Time: _____ Mileage: _____ Misc. Supplies: _____																																			



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

15 July 2022

Bottle Rock Power

Attn: M. Moore

4010 Stone Way North, Suite 400

Seattle, WA 98103

RE: Surface Water

Work Order: 22F3263

Enclosed are the results of analyses for samples received by the laboratory on 06/28/22 11:15. If you have any questions concerning this report, please feel free to contact me.

Sincerely,

Stephen F. McWeeney

Project Manager



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Surface Water
Project Number: [none]

Reported:
07/15/22 11:12

Bay Area: 262 Rickenbacker Circle | Livermore, CA 94551 | 925-828-6226 | ELAP# 2728
Central Valley: 9090 Union Park Way Suite 113 | Elk Grove, CA 95624 | 916-686-5190 | ELAP# 2922
North Bay: 737 Southpoint Blvd Unit D | Petaluma, CA 94954 | 707-769-3128 | ELAP# 2303
San Diego: 2722 Loker Avenue West Suite A | Carlsbad, CA 92010 | 760-930-2555 | ELAP# 3055
Los Angeles: 1230 E. 223rd Street Suite 205 | Carson, CA 90745 | 424-267-5032 | Service Center

ANALYTICAL REPORT FOR SAMPLES

Sample ID	Laboratory ID	Matrix	Date Sampled	Date Received
SW-9	22F3263-01	Water	06/28/22 07:30	06/28/22 11:15
SW-7	22F3263-02	Water	06/28/22 07:10	06/28/22 11:15
SW-10	22F3263-03	Water	06/28/22 08:30	06/28/22 11:15
SW-8	22F3263-04	Water	06/28/22 09:00	06/28/22 11:15
SW-6	22F3263-05	Water	06/28/22 10:00	06/28/22 11:15



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Surface Water
Project Number: [none]

Reported:
07/15/22 11:12

	Result	Units	Reporting Limit	Dilution	Batch	Prepared	Analyzed	ELAP#	Method	Note
SW-9 (22F3263-01)			Sample Type: Water			Sampled: 06/28/22 07:30				
Metals by EPA 200 Series Methods										
Arsenic	ND	mg/L	0.020	1	AF24474	06/29/22 06:41	06/29/22 09:18	2303	EPA 200.7	
Boron	0.22	mg/L	0.10	1	AF24474	06/29/22 06:41	06/29/22 09:18	2303	EPA 200.7	
Calcium	24	mg/L	5.0	1	AF24474	06/29/22 06:41	06/29/22 09:18	2303	EPA 200.7	
Chromium	ND	mg/L	0.010	1	AF24474	06/29/22 06:41	06/29/22 09:18	2303	EPA 200.7	
Copper	ND	mg/L	0.050	1	AF24474	06/29/22 06:41	06/29/22 09:18	2303	EPA 200.7	
Iron	ND	mg/L	0.10	1	AF24474	06/29/22 06:41	06/29/22 09:18	2303	EPA 200.7	
Lead	ND	mg/L	0.020	1	AF24474	06/29/22 06:41	06/29/22 09:18	2303	EPA 200.7	
Magnesium	21	mg/L	0.60	1	AF24474	06/29/22 06:41	06/29/22 09:18	2303	EPA 200.7	
Manganese	ND	mg/L	0.020	1	AF24474	06/29/22 06:41	06/29/22 09:18	2303	EPA 200.7	
Mercury	ND	ug/L	0.20	1	AG23430	07/08/22 05:42	07/08/22 13:41	1551	EPA 245.1	
Sodium	8.6	mg/L	6.0	1	AF24474	06/29/22 06:41	06/29/22 09:18	2303	EPA 200.7	
Vanadium	ND	mg/L	0.020	1	AF24474	06/29/22 06:41	06/29/22 09:18	2303	EPA 200.7	
Zinc	ND	mg/L	0.20	1	AF24474	06/29/22 06:41	06/29/22 09:18	2303	EPA 200.7	
Conventional Chemistry Parameters by APHA/EPA Methods										
Dissolved Oxygen	6.3	mg/L	0.10	1	AF24493	06/28/22 16:00	06/28/22 17:00	1551	SM4500-O G	T-14
pH	7.13	pH Units	1.00	1	AF24033	06/28/22 12:00	06/28/22 13:59	2303	SM4500-H+ B	T-14
Specific Conductance (EC)	300	umhos/cm	10	1	AF24033	06/28/22 12:00	06/28/22 13:59	2303	SM2510B	
Total Alkalinity as CaCO3	150	mg/L	5.0	1	AG23175	07/01/22 08:00	07/05/22 12:01	2303	SM2320B	
Total Suspended Solids	ND	mg/L	1.0	1	AF24563	06/30/22 14:15	07/01/22 10:15	1551	SM2540D	
Turbidity	ND	NTU	1.0	1	AF23262	06/28/22 14:00	06/29/22 09:28	2303	SM2130B	
Bicarbonate Alkalinity as CaCO3	150	mg/L	5.0	1	AG23175	07/01/22 08:00	07/05/22 12:01	2303	SM2320B	
Carbonate Alkalinity as CaCO3	ND	mg/L	5.0	1	AG23175	07/01/22 08:00	07/05/22 12:01	2303	SM2320B	
Hydroxide Alkalinity as CaCO3	ND	mg/L	5.0	1	AG23175	07/01/22 08:00	07/05/22 12:01	2303	SM2320B	
Hardness, Total	147	mg/L	1	1	AF24474	06/29/22 06:41	06/29/22 09:18	2303	SM2340B	

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Surface Water
Project Number: [none]

Reported:
07/15/22 11:12

	Result	Units	Reporting Limit	Dilution	Batch	Prepared	Analyzed	ELAP#	Method	Note
SW-9 (22F3263-01)										
Sample Type: Water					Sampled: 06/28/22 07:30					
Anions by EPA Method 300.0										
Sulfate as SO4	9.6	mg/L	0.50	1	AF24454	06/28/22 15:00	06/28/22 16:03	2303	EPA 300.0	
Microbiological Parameters by APHA Standard Methods										
Total Coliforms	290	MPN/100mL	1.0	1	AF24450	06/28/22 15:30	06/29/22 15:35	2303	SM9223B	
E. Coli	ND	MPN/100mL	1.0	1	AF24450	06/28/22 15:30	06/29/22 15:35	2303	SM9223B	
SW-7 (22F3263-02)										
Sample Type: Water					Sampled: 06/28/22 07:10					
Metals by EPA 200 Series Methods										
Arsenic	ND	mg/L	0.020	1	AF24474	06/29/22 06:41	06/29/22 09:21	2303	EPA 200.7	
Boron	ND	mg/L	0.10	1	AF24474	06/29/22 06:41	06/29/22 09:21	2303	EPA 200.7	
Calcium	7.2	mg/L	5.0	1	AF24474	06/29/22 06:41	06/29/22 09:21	2303	EPA 200.7	
Chromium	ND	mg/L	0.010	1	AF24474	06/29/22 06:41	06/29/22 09:21	2303	EPA 200.7	
Copper	ND	mg/L	0.050	1	AF24474	06/29/22 06:41	06/29/22 09:21	2303	EPA 200.7	
Iron	ND	mg/L	0.10	1	AF24474	06/29/22 06:41	06/29/22 09:21	2303	EPA 200.7	
Lead	ND	mg/L	0.020	1	AF24474	06/29/22 06:41	06/29/22 09:21	2303	EPA 200.7	
Magnesium	4.1	mg/L	0.60	1	AF24474	06/29/22 06:41	06/29/22 09:21	2303	EPA 200.7	
Manganese	ND	mg/L	0.020	1	AF24474	06/29/22 06:41	06/29/22 09:21	2303	EPA 200.7	
Mercury	ND	ug/L	0.20	1	AG23430	07/08/22 05:42	07/08/22 13:43	1551	EPA 245.1	
Sodium	ND	mg/L	6.0	1	AF24474	06/29/22 06:41	06/29/22 09:21	2303	EPA 200.7	
Vanadium	ND	mg/L	0.020	1	AF24474	06/29/22 06:41	06/29/22 09:21	2303	EPA 200.7	
Zinc	ND	mg/L	0.20	1	AF24474	06/29/22 06:41	06/29/22 09:21	2303	EPA 200.7	



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Surface Water
Project Number: [none]

Reported:
07/15/22 11:12

	Result	Units	Reporting Limit	Dilution	Batch	Prepared	Analyzed	ELAP#	Method	Note
SW-7 (22F3263-02)										
			Sample Type: Water			Sampled: 06/28/22 07:10				
Conventional Chemistry Parameters by APHA/EPA Methods										
Dissolved Oxygen	8.9	mg/L	0.10	1	AF24493	06/28/22 16:00	06/28/22 17:00	1551	SM4500-O G	T-14
pH	7.15	pH Units	1.00	1	AF24033	06/28/22 12:00	06/28/22 13:59	2303	SM4500-H+ B	T-14
Specific Conductance (EC)	93	umhos/cm	10	1	AF24033	06/28/22 12:00	06/28/22 13:59	2303	SM2510B	
Total Alkalinity as CaCO3	44	mg/L	5.0	1	AG23175	07/01/22 08:00	07/05/22 12:01	2303	SM2320B	
Total Suspended Solids	ND	mg/L	1.0	1	AF24563	06/30/22 14:15	07/01/22 10:15	1551	SM2540D	
Turbidity	ND	NTU	1.0	1	AF23262	06/28/22 14:00	06/29/22 09:28	2303	SM2130B	
Bicarbonate Alkalinity as CaCO3	44	mg/L	5.0	1	AG23175	07/01/22 08:00	07/05/22 12:01	2303	SM2320B	
Carbonate Alkalinity as CaCO3	ND	mg/L	5.0	1	AG23175	07/01/22 08:00	07/05/22 12:01	2303	SM2320B	
Hydroxide Alkalinity as CaCO3	ND	mg/L	5.0	1	AG23175	07/01/22 08:00	07/05/22 12:01	2303	SM2320B	
Hardness, Total	35	mg/L	1	1	AF24474	06/29/22 06:41	06/29/22 09:21	2303	SM2340B	
Anions by EPA Method 300.0										
Sulfate as SO4	1.3	mg/L	0.50	1	AF24454	06/28/22 15:00	06/28/22 16:15	2303	EPA 300.0	
Microbiological Parameters by APHA Standard Methods										
Total Coliforms	>2419.6	MPN/100mL	1.0	1	AF24450	06/28/22 15:30	06/29/22 15:35	2303	SM9223B	
E. Coli	130	MPN/100mL	1.0	1	AF24450	06/28/22 15:30	06/29/22 15:35	2303	SM9223B	
SW-10 (22F3263-03)										
			Sample Type: Water			Sampled: 06/28/22 08:30				
Metals by EPA 200 Series Methods										
Arsenic	ND	mg/L	0.020	1	AF24474	06/29/22 06:41	06/29/22 09:24	2303	EPA 200.7	
Boron	ND	mg/L	0.10	1	AF24474	06/29/22 06:41	06/29/22 09:24	2303	EPA 200.7	
Calcium	7.0	mg/L	5.0	1	AF24474	06/29/22 06:41	06/29/22 09:24	2303	EPA 200.7	
Chromium	ND	mg/L	0.010	1	AF24474	06/29/22 06:41	06/29/22 09:24	2303	EPA 200.7	
Copper	ND	mg/L	0.050	1	AF24474	06/29/22 06:41	06/29/22 09:24	2303	EPA 200.7	
Iron	ND	mg/L	0.10	1	AF24474	06/29/22 06:41	06/29/22 09:24	2303	EPA 200.7	
Lead	ND	mg/L	0.020	1	AF24474	06/29/22 06:41	06/29/22 09:24	2303	EPA 200.7	
Magnesium	4.0	mg/L	0.60	1	AF24474	06/29/22 06:41	06/29/22 09:24	2303	EPA 200.7	
Manganese	ND	mg/L	0.020	1	AF24474	06/29/22 06:41	06/29/22 09:24	2303	EPA 200.7	
Mercury	ND	ug/L	0.20	1	AG23430	07/08/22 05:42	07/08/22 13:46	1551	EPA 245.1	
Sodium	ND	mg/L	6.0	1	AF24474	06/29/22 06:41	06/29/22 09:24	2303	EPA 200.7	
Vanadium	ND	mg/L	0.020	1	AF24474	06/29/22 06:41	06/29/22 09:24	2303	EPA 200.7	
Zinc	ND	mg/L	0.20	1	AF24474	06/29/22 06:41	06/29/22 09:24	2303	EPA 200.7	

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Surface Water
Project Number: [none]

Reported:
07/15/22 11:12

	Result	Units	Reporting Limit	Dilution	Batch	Prepared	Analyzed	ELAP#	Method	Note
SW-10 (22F3263-03)										
			Sample Type: Water			Sampled: 06/28/22 08:30				
Conventional Chemistry Parameters by APHA/EPA Methods										
Dissolved Oxygen	9.0	mg/L	0.10	1	AF24493	06/28/22 16:00	06/28/22 17:00	1551	SM4500-O G	T-14
pH	7.10	pH Units	1.00	1	AF24033	06/28/22 12:00	06/28/22 13:59	2303	SM4500-H+ B	T-14
Specific Conductance (EC)	92	umhos/cm	10	1	AF24033	06/28/22 12:00	06/28/22 13:59	2303	SM2510B	
Total Alkalinity as CaCO3	45	mg/L	5.0	1	AG23175	07/01/22 08:00	07/05/22 12:01	2303	SM2320B	
Total Suspended Solids	ND	mg/L	1.0	1	AF24563	06/30/22 14:15	07/01/22 10:15	1551	SM2540D	
Turbidity	ND	NTU	1.0	1	AF23262	06/28/22 14:00	06/29/22 09:28	2303	SM2130B	
Bicarbonate Alkalinity as CaCO3	45	mg/L	5.0	1	AG23175	07/01/22 08:00	07/05/22 12:01	2303	SM2320B	
Carbonate Alkalinity as CaCO3	ND	mg/L	5.0	1	AG23175	07/01/22 08:00	07/05/22 12:01	2303	SM2320B	
Hydroxide Alkalinity as CaCO3	ND	mg/L	5.0	1	AG23175	07/01/22 08:00	07/05/22 12:01	2303	SM2320B	
Hardness, Total	34	mg/L	1	1	AF24474	06/29/22 06:41	06/29/22 09:24	2303	SM2340B	
Anions by EPA Method 300.0										
Sulfate as SO4	1.3	mg/L	0.50	1	AF24454	06/28/22 15:00	06/28/22 16:39	2303	EPA 300.0	
Microbiological Parameters by APHA Standard Methods										
Total Coliforms	>2419.6	MPN/100mL	1.0	1	AF24450	06/28/22 15:30	06/29/22 15:35	2303	SM9223B	
E. Coli	160	MPN/100mL	1.0	1	AF24450	06/28/22 15:30	06/29/22 15:35	2303	SM9223B	
SW-8 (22F3263-04)										
			Sample Type: Water			Sampled: 06/28/22 09:00				
Metals by EPA 200 Series Methods										
Arsenic	ND	mg/L	0.020	1	AF24474	06/29/22 06:41	06/29/22 09:27	2303	EPA 200.7	
Boron	ND	mg/L	0.10	1	AF24474	06/29/22 06:41	06/29/22 09:27	2303	EPA 200.7	
Calcium	7.2	mg/L	5.0	1	AF24474	06/29/22 06:41	06/29/22 09:27	2303	EPA 200.7	
Chromium	ND	mg/L	0.010	1	AF24474	06/29/22 06:41	06/29/22 09:27	2303	EPA 200.7	
Copper	ND	mg/L	0.050	1	AF24474	06/29/22 06:41	06/29/22 09:27	2303	EPA 200.7	
Iron	ND	mg/L	0.10	1	AF24474	06/29/22 06:41	06/29/22 09:27	2303	EPA 200.7	
Lead	ND	mg/L	0.020	1	AF24474	06/29/22 06:41	06/29/22 09:27	2303	EPA 200.7	
Magnesium	4.0	mg/L	0.60	1	AF24474	06/29/22 06:41	06/29/22 09:27	2303	EPA 200.7	
Manganese	ND	mg/L	0.020	1	AF24474	06/29/22 06:41	06/29/22 09:27	2303	EPA 200.7	
Mercury	ND	ug/L	0.20	1	AG23430	07/08/22 05:42	07/08/22 13:49	1551	EPA 245.1	
Sodium	ND	mg/L	6.0	1	AF24474	06/29/22 06:41	06/29/22 09:27	2303	EPA 200.7	
Vanadium	ND	mg/L	0.020	1	AF24474	06/29/22 06:41	06/29/22 09:27	2303	EPA 200.7	
Zinc	ND	mg/L	0.20	1	AF24474	06/29/22 06:41	06/29/22 09:27	2303	EPA 200.7	

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Surface Water
Project Number: [none]

Reported:
07/15/22 11:12

	Result	Units	Reporting Limit	Dilution	Batch	Prepared	Analyzed	ELAP#	Method	Note
SW-8 (22F3263-04)			Sample Type: Water			Sampled: 06/28/22 09:00				
Conventional Chemistry Parameters by APHA/EPA Methods										
Dissolved Oxygen	9.2	mg/L	0.10	1	AF24493	06/28/22 16:00	06/28/22 17:00	1551	SM4500-O G	T-14
pH	7.14	pH Units	1.00	1	AF24033	06/28/22 12:00	06/28/22 13:59	2303	SM4500-H+ B	T-14
Specific Conductance (EC)	93	umhos/cm	10	1	AF24033	06/28/22 12:00	06/28/22 13:59	2303	SM2510B	
Total Alkalinity as CaCO3	43	mg/L	5.0	1	AG23175	07/01/22 08:00	07/05/22 12:01	2303	SM2320B	
Total Suspended Solids	ND	mg/L	1.0	1	AF24563	06/30/22 14:15	07/01/22 10:15	1551	SM2540D	
Turbidity	ND	NTU	1.0	1	AF23262	06/28/22 14:00	06/29/22 09:28	2303	SM2130B	
Bicarbonate Alkalinity as CaCO3	43	mg/L	5.0	1	AG23175	07/01/22 08:00	07/05/22 12:01	2303	SM2320B	
Carbonate Alkalinity as CaCO3	ND	mg/L	5.0	1	AG23175	07/01/22 08:00	07/05/22 12:01	2303	SM2320B	
Hydroxide Alkalinity as CaCO3	ND	mg/L	5.0	1	AG23175	07/01/22 08:00	07/05/22 12:01	2303	SM2320B	
Hardness, Total	34	mg/L	1	1	AF24474	06/29/22 06:41	06/29/22 09:27	2303	SM2340B	
Anions by EPA Method 300.0										
Sulfate as SO4	1.3	mg/L	0.50	1	AF24454	06/28/22 15:00	06/28/22 16:52	2303	EPA 300.0	
Microbiological Parameters by APHA Standard Methods										
Total Coliforms	>2419.6	MPN/100mL	1.0	1	AF24450	06/28/22 15:30	06/29/22 15:35	2303	SM9223B	
E. Coli	180	MPN/100mL	1.0	1	AF24450	06/28/22 15:30	06/29/22 15:35	2303	SM9223B	
SW-6 (22F3263-05)			Sample Type: Water			Sampled: 06/28/22 10:00				
Metals by EPA 200 Series Methods										
Arsenic	ND	mg/L	0.020	1	AF24474	06/29/22 06:41	06/29/22 09:30	2303	EPA 200.7	
Boron	ND	mg/L	0.10	1	AF24474	06/29/22 06:41	06/29/22 09:30	2303	EPA 200.7	
Calcium	7.1	mg/L	5.0	1	AF24474	06/29/22 06:41	06/29/22 09:30	2303	EPA 200.7	
Chromium	ND	mg/L	0.010	1	AF24474	06/29/22 06:41	06/29/22 09:30	2303	EPA 200.7	
Copper	ND	mg/L	0.050	1	AF24474	06/29/22 06:41	06/29/22 09:30	2303	EPA 200.7	
Iron	ND	mg/L	0.10	1	AF24474	06/29/22 06:41	06/29/22 09:30	2303	EPA 200.7	
Lead	ND	mg/L	0.020	1	AF24474	06/29/22 06:41	06/29/22 09:30	2303	EPA 200.7	
Magnesium	4.0	mg/L	0.60	1	AF24474	06/29/22 06:41	06/29/22 09:30	2303	EPA 200.7	
Manganese	ND	mg/L	0.020	1	AF24474	06/29/22 06:41	06/29/22 09:30	2303	EPA 200.7	
Mercury	ND	ug/L	0.20	1	AG23430	07/08/22 05:42	07/08/22 13:51	1551	EPA 245.1	
Sodium	ND	mg/L	6.0	1	AF24474	06/29/22 06:41	06/29/22 09:30	2303	EPA 200.7	
Vanadium	ND	mg/L	0.020	1	AF24474	06/29/22 06:41	06/29/22 09:30	2303	EPA 200.7	
Zinc	ND	mg/L	0.20	1	AF24474	06/29/22 06:41	06/29/22 09:30	2303	EPA 200.7	

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Surface Water
Project Number: [none]

Reported:
07/15/22 11:12

	Result	Units	Reporting Limit	Dilution	Batch	Prepared	Analyzed	ELAP#	Method	Note
SW-6 (22F3263-05)			Sample Type: Water		Sampled: 06/28/22 10:00					
Conventional Chemistry Parameters by APHA/EPA Methods										
Dissolved Oxygen	9.1	mg/L	0.10	1	AF24493	06/28/22 16:00	06/28/22 17:00	1551	SM4500-O G	T-14
pH	7.13	pH Units	1.00	1	AF24033	06/28/22 12:00	06/28/22 13:59	2303	SM4500-H+ B	T-14
Specific Conductance (EC)	93	umhos/cm	10	1	AF24033	06/28/22 12:00	06/28/22 13:59	2303	SM2510B	
Total Alkalinity as CaCO3	42	mg/L	5.0	1	AG23175	07/01/22 08:00	07/05/22 12:01	2303	SM2320B	
Total Suspended Solids	ND	mg/L	1.0	1	AF24563	06/30/22 14:15	07/01/22 10:15	1551	SM2540D	
Turbidity	ND	NTU	1.0	1	AF23262	06/28/22 14:00	06/29/22 09:28	2303	SM2130B	
Bicarbonate Alkalinity as CaCO3	42	mg/L	5.0	1	AG23175	07/01/22 08:00	07/05/22 12:01	2303	SM2320B	
Carbonate Alkalinity as CaCO3	ND	mg/L	5.0	1	AG23175	07/01/22 08:00	07/05/22 12:01	2303	SM2320B	
Hydroxide Alkalinity as CaCO3	ND	mg/L	5.0	1	AG23175	07/01/22 08:00	07/05/22 12:01	2303	SM2320B	
Hardness, Total	34	mg/L	1	1	AF24474	06/29/22 06:41	06/29/22 09:30	2303	SM2340B	
Anions by EPA Method 300.0										
Sulfate as SO4	1.3	mg/L	0.50	1	AF24454	06/28/22 15:00	06/28/22 17:03	2303	EPA 300.0	
Microbiological Parameters by APHA Standard Methods										
Total Coliforms	>2419.6	MPN/100mL	1.0	1	AF24450	06/28/22 15:30	06/29/22 15:35	2303	SM9223B	
E. Coli	180	MPN/100mL	1.0	1	AF24450	06/28/22 15:30	06/29/22 15:35	2303	SM9223B	



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Surface Water
Project Number: [none]

Reported:
07/15/22 11:12

Metals by EPA 200 Series Methods - Quality Control

Analyte(s)	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Flag
Batch AF24474 - NB EPA 200 series DA										
Blank (AF24474-BLK1)				Prepared & Analyzed: 06/29/22						
Arsenic	ND	0.020	mg/L							
Boron	ND	0.10	mg/L							
Calcium	ND	5.0	mg/L							
Chromium	ND	0.010	mg/L							
Copper	ND	0.050	mg/L							
Iron	ND	0.10	mg/L							
Lead	ND	0.020	mg/L							
Magnesium	ND	0.60	mg/L							
Manganese	ND	0.020	mg/L							
Sodium	ND	6.0	mg/L							
Vanadium	ND	0.020	mg/L							
Zinc	ND	0.20	mg/L							
LCS (AF24474-BS1)				Prepared & Analyzed: 06/29/22						
Arsenic	0.514	0.020	mg/L	0.500		103	85-115			
Boron	0.486	0.10	mg/L	0.500		97.3	85-115			
Calcium	25.1	5.0	mg/L	25.5		98.5	85-115			
Chromium	0.486	0.010	mg/L	0.500		97.2	85-115			
Copper	0.481	0.050	mg/L	0.500		96.2	85-115			
Iron	0.501	0.10	mg/L	0.500		100	85-115			
Lead	0.476	0.020	mg/L	0.500		95.2	85-115			
Magnesium	25.4	0.60	mg/L	25.5		99.7	85-115			
Manganese	0.514	0.020	mg/L	0.500		103	85-115			
Sodium	26.1	6.0	mg/L	25.5		102	85-115			
Vanadium	0.499	0.020	mg/L	0.500		99.8	85-115			
Zinc	0.497	0.20	mg/L	0.500		99.4	85-115			
LCS Dup (AF24474-BS1)				Prepared & Analyzed: 06/29/22						
Arsenic	0.511	0.020	mg/L	0.500		102	85-115	0.468	20	
Boron	0.489	0.10	mg/L	0.500		97.8	85-115	0.492	20	
Calcium	25.1	5.0	mg/L	25.5		98.3	85-115	0.206	20	
Chromium	0.484	0.010	mg/L	0.500		96.7	85-115	0.454	20	
Copper	0.480	0.050	mg/L	0.500		96.0	85-115	0.166	20	
Iron	0.502	0.10	mg/L	0.500		100	85-115	0.120	20	
Lead	0.475	0.020	mg/L	0.500		94.9	85-115	0.253	20	

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Surface Water
Project Number: [none]

Reported:
07/15/22 11:12

Metals by EPA 200 Series Methods - Quality Control

Analyte(s)	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Flag
Batch AF24474 - NB EPA 200 series DA										
LCS Dup (AF24474-BSD1)				Prepared & Analyzed: 06/29/22						
Magnesium	25.4	0.60	mg/L	25.5		99.8	85-115	0.116	20	
Manganese	0.514	0.020	mg/L	0.500		103	85-115	0.00	20	
Sodium	26.1	6.0	mg/L	25.5		102	85-115	0.0713	20	
Vanadium	0.498	0.020	mg/L	0.500		99.6	85-115	0.221	20	
Zinc	0.495	0.20	mg/L	0.500		99.0	85-115	0.484	20	
Duplicate (AF24474-DUP1)				Source: 22F3187-01		Prepared & Analyzed: 06/29/22				
Arsenic	ND	0.020	mg/L		ND				20	
Boron	0.473	0.10	mg/L		0.550			15.1	20	
Calcium	25.2	5.0	mg/L		29.3			15.0	20	
Chromium	ND	0.010	mg/L		ND				20	
Copper	ND	0.050	mg/L		ND				20	
Iron	ND	0.10	mg/L		ND				20	
Lead	ND	0.020	mg/L		ND				20	
Magnesium	16.0	0.60	mg/L		18.6			15.0	20	
Manganese	ND	0.020	mg/L		ND				20	
Sodium	45.2	6.0	mg/L		52.5			15.0	20	
Vanadium	ND	0.020	mg/L		ND			200	20	
Zinc	ND	0.20	mg/L		ND				20	
MRL Check (AF24474-MRL1)				Prepared & Analyzed: 06/29/22						
Boron	0.0962	0.10	mg/L	0.100		96.2	0-200			
Calcium	4.91	5.0	mg/L	5.00		98.2	0-200			
Chromium	ND	0.010	mg/L				0-200			
Copper	0.0493	0.050	mg/L	0.0500		98.6	0-200			
Iron	0.0966	0.10	mg/L	0.100		96.6	0-200			
Magnesium	0.505	0.60	mg/L	0.500		101	0-200			
Manganese	0.0199	0.020	mg/L	0.0200		99.5	0-200			
Sodium	5.06	6.0	mg/L	5.00		101	0-200			
Zinc	ND	0.20	mg/L	0.0500			0-200			

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Surface Water
Project Number: [none]

Reported:
07/15/22 11:12

Metals by EPA 200 Series Methods - Quality Control

Analyte(s)	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Flag
Batch AF24474 - NB EPA 200 series DA										
Matrix Spike (AF24474-MS1)		Source: 22F3187-01		Prepared & Analyzed: 06/29/22						
Arsenic	0.516	0.020	mg/L	0.500	ND	103	70-130			
Boron	0.951	0.10	mg/L	0.500	0.550	80.1	70-130			
Chromium	0.485	0.010	mg/L	0.500	ND	97.0	70-130			
Copper	0.496	0.050	mg/L	0.500	ND	99.1	70-130			
Iron	0.512	0.10	mg/L	0.500	ND	102	70-130			
Lead	0.468	0.020	mg/L	0.500	ND	93.7	70-130			
Manganese	0.511	0.020	mg/L	0.500	ND	102	70-130			
Sodium	68.8	6.0	mg/L	25.5	52.5	63.8	70-130			QM-07
Vanadium	0.505	0.020	mg/L	0.500	ND	101	70-130			
Zinc	0.512	0.20	mg/L	0.500	ND	102	70-130			

Batch AG23430 - Hg Digest

Blank (AG23430-BLK1)		Prepared & Analyzed: 07/08/22								
Mercury	ND	0.20	ug/L							
LCS (AG23430-BS1)		Prepared & Analyzed: 07/08/22								
Mercury	2.49	0.20	ug/L	2.50		99.8	85-115			
Duplicate (AG23430-DUP1)		Source: 22F3625-01		Prepared & Analyzed: 07/08/22						
Mercury	ND	0.20	ug/L		ND				20	
Matrix Spike (AG23430-MS1)		Source: 22F3625-01		Prepared & Analyzed: 07/08/22						
Mercury	2.48	0.20	ug/L	2.50	ND	99.0	70-130			
Matrix Spike (AG23430-MS2)		Source: 22F3625-02		Prepared & Analyzed: 07/08/22						
Mercury	2.51	0.20	ug/L	2.50	ND	100	70-130			



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power 4010 Stone Way North, Suite 400 Seattle, WA 98103	Project Manager: M. Moore Project: Surface Water Project Number: [none]	Reported: 07/15/22 11:12
---	---	-----------------------------

Metals by EPA 200 Series Methods - Quality Control

Analyte(s)	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Flag
------------	--------	--------------------	-------	----------------	------------------	------	----------------	-----	--------------	------

Batch AG23430 - Hg Digest

Matrix Spike Dup (AG23430-MSD1)

Source: 22F3625-01

Prepared & Analyzed: 07/08/22

Mercury	2.46	0.20	ug/L	2.50	ND	98.4	70-130	0.649	20	
---------	------	------	------	------	----	------	--------	-------	----	--



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Surface Water
Project Number: [none]

Reported:
07/15/22 11:12

Conventional Chemistry Parameters by APHA/EPA Methods - Quality Control

Analyte(s)	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Flag
Batch AF24033 - NB General Prep										
Duplicate (AF24033-DUP1)	Source: 22F2565-01		Prepared & Analyzed: 06/21/22							
pH	8.89	1.00	pH Units		8.88			0.113	20	
Specific Conductance (EC)	684	10	umhos/cm		681			0.440	5	
Batch AF24474 - NB EPA 200 series DA										
Blank (AF24474-BLK1)	Prepared & Analyzed: 06/29/22									
Hardness, Total	ND	1	mg/L							
Duplicate (AF24474-DUP1)	Source: 22F3187-01		Prepared & Analyzed: 06/29/22							
Hardness, Total	129	1	mg/L		150			15.0	20	
Batch AF24493 - General Preparation										
Duplicate (AF24493-DUP1)	Source: 22F3236-02		Prepared & Analyzed: 06/28/22							
Dissolved Oxygen	9.46	0.10	mg/L		9.44			0.212	20	T-14
Batch AF24563 - General Preparation										
Blank (AF24563-BLK1)	Prepared: 06/30/22 Analyzed: 07/01/22									
Total Suspended Solids	ND	1.0	mg/L							
Duplicate (AF24563-DUP1)	Source: 22F3343-01		Prepared: 06/30/22 Analyzed: 07/01/22							
Total Suspended Solids	314	1.0	mg/L		317			0.982	30	
Duplicate (AF24563-DUP2)	Source: 22F3405-03		Prepared: 06/30/22 Analyzed: 07/01/22							
Total Suspended Solids	176	1.0	mg/L		179			1.57	30	



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Surface Water
Project Number: [none]

Reported:
07/15/22 11:12

Conventional Chemistry Parameters by APHA/EPA Methods - Quality Control

Analyte(s)	Result	Reporting Limit	Units	Spike Level	Source Result	%REC Limits	RPD	RPD Limit	Flag
Batch AG23175 - NB General Prep									
Blank (AG23175-BLK1)				Prepared: 07/01/22 Analyzed: 07/05/22					
Total Alkalinity as CaCO ₃	ND	5.0	mg/L						
Bicarbonate Alkalinity as CaCO ₃	ND	5.0	mg/L						
Carbonate Alkalinity as CaCO ₃	ND	5.0	mg/L						
Hydroxide Alkalinity as CaCO ₃	ND	5.0	mg/L						
LCS (AG23175-BS1)				Prepared: 07/01/22 Analyzed: 07/05/22					
Total Alkalinity as CaCO ₃	1000	5.0	mg/L	1000		100 80-120			
Duplicate (AG23175-DUP1)				Prepared: 07/01/22 Analyzed: 07/05/22					
Total Alkalinity as CaCO ₃	89.0	5.0	mg/L		89.5		0.560	20	
Bicarbonate Alkalinity as CaCO ₃	88.8	5.0	mg/L		89.3		0.561	20	
Carbonate Alkalinity as CaCO ₃	ND	5.0	mg/L		ND			20	
Hydroxide Alkalinity as CaCO ₃	ND	5.0	mg/L		ND			20	



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Surface Water
Project Number: [none]

Reported:
07/15/22 11:12

Anions by EPA Method 300.0 - Quality Control

Analyte(s)	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Flag
Batch AF24454 - NB General Prep										
Blank (AF24454-BLK1)				Prepared & Analyzed: 06/28/22						
Sulfate as SO ₄	ND	0.50	mg/L							
LCS (AF24454-BS1)				Prepared & Analyzed: 06/28/22						
Sulfate as SO ₄	7.98	0.50	mg/L	8.00		99.7	90-110			
Duplicate (AF24454-DUP1)				Source: 22F3264-02		Prepared & Analyzed: 06/28/22				
Sulfate as SO ₄	19.3	0.50	mg/L		19.2			0.532	20	
MRL Check (AF24454-MRL1)				Prepared & Analyzed: 06/28/22						
Sulfate as SO ₄	1.56	0.50	mg/L	1.60		97.8	60-140			
Matrix Spike (AF24454-MS1)				Source: 22F3264-01		Prepared & Analyzed: 06/28/22				
Sulfate as SO ₄	13.4	0.50	mg/L	8.00	5.43	99.9	80-120			
Matrix Spike Dup (AF24454-MSD1)				Source: 22F3264-01		Prepared & Analyzed: 06/28/22				
Sulfate as SO ₄	13.5	0.50	mg/L	8.00	5.43	100	80-120	0.260	20	



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Surface Water
Project Number: [none]

Reported:
07/15/22 11:12

Notes and Definitions

>2419.6 >2419.6

QM-07 The spike recovery was outside acceptance limits for the MS and/or MSD. The batch was accepted based on acceptable LCS recovery.

T-14 Residual chlorine, dissolved oxygen, sulfite, and pH must be analyzed in the field to meet the EPA specified 15 minute hold time.

ND Analyte NOT DETECTED at or above the reporting limit

dry Sample results reported on a dry weight basis

REC Recovery

RPD Relative Percent Difference

Non-accredited analytes are reported only when ELAP accreditation for a requested analyte method pair is not available. For a list of accredited analytes, view our certificates at the Company link on our website at www.alpha-labs.com or contact your Project Manager directly.



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

30 September 2022

Bottle Rock Power

Attn: M. Moore

4010 Stone Way North, Suite 400

Seattle, WA 98103

RE: Groundwater

Work Order: 2212926

Enclosed are the results of analyses for samples received by the laboratory on 09/22/22 11:35. If you have any questions concerning this report, please feel free to contact me.

Sincerely,

Stephen F. McWeeney

Project Manager



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Groundwater
Project Number: [none]

Reported:
09/30/22 10:26

Bay Area: 262 Rickenbacker Circle | Livermore, CA 94551 | 925-828-6226 | ELAP# 2728
Central Valley: 9090 Union Park Way Suite 113 | Elk Grove, CA 95624 | 916-686-5190 | ELAP# 2922
North Bay: 737 Southpoint Blvd Unit D | Petaluma, CA 94954 | 707-769-3128 | ELAP# 2303
San Diego: 2722 Loker Avenue West Suite A | Carlsbad, CA 92010 | 760-930-2555 | ELAP# 3055
Los Angeles: 1230 E. 223rd Street Suite 205 | Carson, CA 90745 | 424-267-5032 | Service Center

ANALYTICAL REPORT FOR SAMPLES

Sample ID	Laboratory ID	Matrix	Date Sampled	Date Received
GW-3	22I2926-01	Water	09/22/22 07:20	09/22/22 11:35
GW-1	22I2926-02	Water	09/22/22 08:20	09/22/22 11:35



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Groundwater
Project Number: [none]

Reported:
09/30/22 10:26

	Result	Units	Reporting Limit	Dilution	Batch	Prepared	Analyzed	ELAP#	Method	Note
GW-3 (22I2926-01)			Sample Type: Water			Sampled: 09/22/22 07:20				
Metals by EPA 200 Series Methods										
Arsenic	ND	ug/L	2.0	1	AI24343	09/23/22 06:19	09/23/22 12:59	2303	EPA 200.5	
Boron	0.41	mg/L	0.10	1	AI24353	09/23/22 07:50	09/26/22 08:27	2303	EPA 200.7	
Calcium	34	mg/L	5.0	1	AI24353	09/23/22 07:50	09/26/22 08:27	2303	EPA 200.7	
Copper	ND	mg/L	0.050	1	AI24353	09/23/22 07:50	09/26/22 08:27	2303	EPA 200.7	
Iron	0.24	mg/L	0.10	1	AI24353	09/23/22 07:50	09/26/22 08:27	2303	EPA 200.7	
Lead	ND	mg/L	0.020	1	AI24353	09/23/22 07:50	09/26/22 08:27	2303	EPA 200.7	
Magnesium	10	mg/L	0.60	1	AI24353	09/23/22 07:50	09/26/22 08:27	2303	EPA 200.7	
Manganese	0.062	mg/L	0.020	1	AI24353	09/23/22 07:50	09/26/22 08:27	2303	EPA 200.7	
Sodium	25	mg/L	6.0	1	AI24353	09/23/22 07:50	09/26/22 08:27	2303	EPA 200.7	
Zinc	ND	mg/L	0.30	1	AI24353	09/23/22 07:50	09/26/22 08:27	2303	EPA 200.7	
Conventional Chemistry Parameters by APHA/EPA Methods										
pH	7.61	pH Units	1.00	1	AI24301	09/22/22 13:29	09/22/22 18:20	2303	SM4500-H+ B	T-14
Specific Conductance (EC)	350	umhos/cm	10	1	AI24301	09/22/22 13:29	09/22/22 18:20	2303	SM2510B	
Total Alkalinity as CaCO3	180	mg/L	5.0	1	AI24369	09/23/22 09:53	09/23/22 18:27	2303	SM2320B	
Total Suspended Solids	1.2	mg/L	1.0	1	AI24515	09/27/22 09:15	09/27/22 15:00	1551	SM2540D	
Turbidity	2.4	NTU	1.0	1	AI23389	09/22/22 13:46	09/22/22 17:44	2303	SM2130B	
Bicarbonate Alkalinity as CaCO3	180	mg/L	5.0	1	AI24369	09/23/22 09:53	09/23/22 18:27	2303	SM2320B	
Carbonate Alkalinity as CaCO3	ND	mg/L	5.0	1	AI24369	09/23/22 09:53	09/23/22 18:27	2303	SM2320B	
Hydroxide Alkalinity as CaCO3	ND	mg/L	5.0	1	AI24369	09/23/22 09:53	09/23/22 18:27	2303	SM2320B	
Hardness, Total	127	mg/L	1	1	AI24353	09/23/22 07:50	09/26/22 08:27	2303	SM2340B	
Anions by EPA Method 300.0										
Nitrate as N	ND	mg/L	0.40	1	AI24303	09/22/22 14:14	09/22/22 17:29	2303	EPA 300.0	
Sulfate as SO4	5.8	mg/L	0.50	1	AI24303	09/22/22 14:14	09/22/22 17:29	2303	EPA 300.0	
GW-1 (22I2926-02)			Sample Type: Water			Sampled: 09/22/22 08:20				
Metals by EPA 200 Series Methods										
Arsenic	ND	ug/L	2.0	1	AI24343	09/23/22 06:19	09/23/22 13:05	2303	EPA 200.5	
Boron	ND	mg/L	0.10	1	AI24353	09/23/22 07:50	09/26/22 08:30	2303	EPA 200.7	
Calcium	6.0	mg/L	5.0	1	AI24353	09/23/22 07:50	09/26/22 08:30	2303	EPA 200.7	
Copper	ND	mg/L	0.050	1	AI24353	09/23/22 07:50	09/26/22 08:30	2303	EPA 200.7	
Iron	ND	mg/L	0.10	1	AI24353	09/23/22 07:50	09/26/22 08:30	2303	EPA 200.7	
Lead	ND	mg/L	0.020	1	AI24353	09/23/22 07:50	09/26/22 08:30	2303	EPA 200.7	
Magnesium	3.7	mg/L	0.60	1	AI24353	09/23/22 07:50	09/26/22 08:30	2303	EPA 200.7	
Manganese	ND	mg/L	0.020	1	AI24353	09/23/22 07:50	09/26/22 08:30	2303	EPA 200.7	
Sodium	ND	mg/L	6.0	1	AI24353	09/23/22 07:50	09/26/22 08:30	2303	EPA 200.7	
Zinc	ND	mg/L	0.30	1	AI24353	09/23/22 07:50	09/26/22 08:30	2303	EPA 200.7	

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Groundwater
Project Number: [none]

Reported:
09/30/22 10:26

	Result	Units	Reporting Limit	Dilution	Batch	Prepared	Analyzed	ELAP#	Method	Note
GW-1 (22I2926-02)			Sample Type: Water			Sampled: 09/22/22 08:20				
Conventional Chemistry Parameters by APHA/EPA Methods										
pH	7.37	pH Units	1.00	1	AI24301	09/22/22 13:29	09/22/22 18:20	2303	SM4500-H+ B	T-14
Specific Conductance (EC)	90	umhos/cm	10	1	AI24301	09/22/22 13:29	09/22/22 18:20	2303	SM2510B	
Total Alkalinity as CaCO3	40	mg/L	5.0	1	AI24369	09/23/22 09:53	09/23/22 18:27	2303	SM2320B	
Total Suspended Solids	ND	mg/L	1.0	1	AI24515	09/27/22 09:15	09/27/22 15:00	1551	SM2540D	
Turbidity	ND	NTU	1.0	1	AI23389	09/22/22 13:46	09/22/22 17:44	2303	SM2130B	
Bicarbonate Alkalinity as CaCO3	40	mg/L	5.0	1	AI24369	09/23/22 09:53	09/23/22 18:27	2303	SM2320B	
Carbonate Alkalinity as CaCO3	ND	mg/L	5.0	1	AI24369	09/23/22 09:53	09/23/22 18:27	2303	SM2320B	
Hydroxide Alkalinity as CaCO3	ND	mg/L	5.0	1	AI24369	09/23/22 09:53	09/23/22 18:27	2303	SM2320B	
Hardness, Total	30	mg/L	1	1	AI24353	09/23/22 07:50	09/26/22 08:30	2303	SM2340B	
Anions by EPA Method 300.0										
Nitrate as N	ND	mg/L	0.40	1	AI24303	09/22/22 14:14	09/22/22 18:17	2303	EPA 300.0	
Sulfate as SO4	2.2	mg/L	0.50	1	AI24303	09/22/22 14:14	09/22/22 18:17	2303	EPA 300.0	



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Groundwater
Project Number: [none]

Reported:
09/30/22 10:26

Metals by EPA 200 Series Methods - Quality Control

Analyte(s)	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Flag
Batch AI24343 - NB EPA 200 series										
Blank (AI24343-BLK1)				Prepared & Analyzed: 09/23/22						
Arsenic	ND	2.0	ug/L							
LCS (AI24343-BS1)				Prepared & Analyzed: 09/23/22						
Arsenic	10.5	2.0	ug/L	10.0		105	85-115			
LCS Dup (AI24343-BSD1)				Prepared & Analyzed: 09/23/22						
Arsenic	10.0	2.0	ug/L	10.0		100	85-115	4.74	20	
Duplicate (AI24343-DUP1)				Source: 22I2960-01		Prepared & Analyzed: 09/23/22				
Arsenic	ND	2.0	ug/L		ND			200	20	
MRL Check (AI24343-MRL1)				Prepared & Analyzed: 09/23/22						
Arsenic	2.26	2.0	ug/L	2.00		113	0-200			
Matrix Spike (AI24343-MS1)				Source: 22I2947-01		Prepared & Analyzed: 09/23/22				
Arsenic	12.2	2.0	ug/L	10.0	ND	122	70-130			
Batch AI24353 - NB EPA 200 series DA										
Blank (AI24353-BLK1)				Prepared: 09/23/22 Analyzed: 09/26/22						
Boron	ND	0.10	mg/L							
Calcium	ND	5.0	mg/L							
Copper	ND	0.050	mg/L							
Iron	ND	0.10	mg/L							
Lead	ND	0.020	mg/L							
Magnesium	ND	0.60	mg/L							
Manganese	ND	0.020	mg/L							
Sodium	ND	6.0	mg/L							
Zinc	ND	0.30	mg/L							



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Groundwater
Project Number: [none]

Reported:
09/30/22 10:26

Metals by EPA 200 Series Methods - Quality Control

Analyte(s)	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Flag
Batch AI24353 - NB EPA 200 series DA										
LCS (AI24353-BS1) Prepared: 09/23/22 Analyzed: 09/26/22										
Boron	0.484	0.10	mg/L	0.500		96.8	85-115			
Calcium	23.6	5.0	mg/L	25.5		92.4	85-115			
Copper	0.472	0.050	mg/L	0.500		94.3	85-115			
Iron	0.504	0.10	mg/L	0.500		101	85-115			
Lead	0.456	0.020	mg/L	0.500		91.1	85-115			
Magnesium	24.8	0.60	mg/L	25.5		97.4	85-115			
Manganese	0.521	0.020	mg/L	0.500		104	85-115			
Sodium	25.0	6.0	mg/L	25.5		98.1	85-115			
Zinc	0.498	0.30	mg/L	0.500		99.7	85-115			
LCS Dup (AI24353-BS1) Prepared: 09/23/22 Analyzed: 09/26/22										
Boron	0.485	0.10	mg/L	0.500		96.9	85-115	0.124	20	
Calcium	23.5	5.0	mg/L	25.5		92.3	85-115	0.0874	20	
Copper	0.471	0.050	mg/L	0.500		94.2	85-115	0.127	20	
Iron	0.505	0.10	mg/L	0.500		101	85-115	0.198	20	
Lead	0.454	0.020	mg/L	0.500		90.9	85-115	0.308	20	
Magnesium	24.8	0.60	mg/L	25.5		97.1	85-115	0.265	20	
Manganese	0.520	0.020	mg/L	0.500		104	85-115	0.211	20	
Sodium	25.0	6.0	mg/L	25.5		97.9	85-115	0.177	20	
Zinc	0.500	0.30	mg/L	0.500		99.9	85-115	0.220	20	
Duplicate (AI24353-DUP1) Source: 22I2925-01 Prepared: 09/23/22 Analyzed: 09/26/22										
Boron	ND	0.10	mg/L		ND			1.02	20	
Calcium	5.90	5.0	mg/L		5.85			0.877	20	
Copper	ND	0.050	mg/L		ND				20	
Iron	ND	0.10	mg/L		ND			0.569	20	
Lead	ND	0.020	mg/L		ND				20	
Magnesium	3.63	0.60	mg/L		3.60			0.592	20	
Manganese	ND	0.020	mg/L		ND				20	
Sodium	ND	6.0	mg/L		ND			0.0823	20	
Zinc	ND	0.30	mg/L		ND				20	

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Groundwater
Project Number: [none]

Reported:
09/30/22 10:26

Metals by EPA 200 Series Methods - Quality Control

Analyte(s)	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Flag
------------	--------	--------------------	-------	----------------	------------------	------	----------------	-----	--------------	------

Batch AI24353 - NB EPA 200 series DA

MRL Check (AI24353-MRL1)

Prepared: 09/23/22 Analyzed: 09/26/22

Boron	0.0953	0.10	mg/L	0.100		95.3	0-200			
Calcium	4.32	5.0	mg/L	5.00		86.5	0-200			
Copper	0.0449	0.050	mg/L	0.0500		89.8	0-200			
Iron	0.100	0.10	mg/L	0.100		100	0-200			
Magnesium	0.451	0.60	mg/L	0.500		90.2	0-200			
Manganese	0.0197	0.020	mg/L	0.0200		98.5	0-200			
Sodium	4.93	6.0	mg/L	5.00		98.7	0-200			
Zinc	ND	0.30	mg/L	0.0500			0-200			

Matrix Spike (AI24353-MS1)

Source: 22I2925-05

Prepared: 09/23/22 Analyzed: 09/26/22

Boron	2.22	0.10	mg/L	0.500	1.84	75.8	70-130			
Copper	0.480	0.050	mg/L	0.500	ND	95.9	70-130			
Iron	0.581	0.10	mg/L	0.500	ND	100	70-130			
Lead	0.458	0.020	mg/L	0.500	ND	91.7	70-130			
Manganese	0.566	0.020	mg/L	0.500	0.0495	103	70-130			
Sodium	37.2	6.0	mg/L	25.5	13.3	93.7	70-130			
Zinc	0.502	0.30	mg/L	0.500	ND	100	70-130			



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Groundwater
Project Number: [none]

Reported:
09/30/22 10:26

Conventional Chemistry Parameters by APHA/EPA Methods - Quality Control

Analyte(s)	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Flag
Batch AI23389 - NB General Prep										
Blank (AI23389-BLK1)				Prepared & Analyzed: 09/08/22						
Turbidity	ND	1.0	NTU							
Duplicate (AI23389-DUP1)				Source: 22I0944-01		Prepared & Analyzed: 09/08/22				
Turbidity	1.23	1.0	NTU		1.26			2.41	20	
Reference (AI23389-SRM1)				Prepared & Analyzed: 09/08/22						
Turbidity	1.15	1.0	NTU	1.00		115	0-200			
Batch AI24301 - NB General Prep										
Duplicate (AI24301-DUP1)				Source: 22I2946-03		Prepared & Analyzed: 09/22/22				
pH	7.86	1.00	pH Units		7.87			0.127	20	T-14
Specific Conductance (EC)	492	10	umhos/cm		493			0.203	5	
Batch AI24353 - NB EPA 200 series DA										
Blank (AI24353-BLK1)				Prepared: 09/23/22 Analyzed: 09/26/22						
Hardness, Total	ND	1	mg/L							
Duplicate (AI24353-DUP1)				Source: 22I2925-01		Prepared: 09/23/22 Analyzed: 09/26/22				
Hardness, Total	30	1	mg/L		29			0.733	20	
Batch AI24369 - NB General Prep										
LCS (AI24369-BS1)				Prepared & Analyzed: 09/23/22						
Total Alkalinity as CaCO ₃	1010	5.0	mg/L	1000		101	80-120			



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Groundwater
Project Number: [none]

Reported:
09/30/22 10:26

Conventional Chemistry Parameters by APHA/EPA Methods - Quality Control

Analyte(s)	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Flag
------------	--------	--------------------	-------	----------------	------------------	------	----------------	-----	--------------	------

Batch AI24369 - NB General Prep

Duplicate (AI24369-DUP1)

Source: 22I2925-04

Prepared & Analyzed: 09/23/22

Total Alkalinity as CaCO ₃	40.0	5.0	mg/L		40.0			0.00	20	
Bicarbonate Alkalinity as CaCO ₃	39.9	5.0	mg/L		39.9			0.0501	20	
Carbonate Alkalinity as CaCO ₃	ND	5.0	mg/L		ND				20	
Hydroxide Alkalinity as CaCO ₃	ND	5.0	mg/L		ND				20	

Batch AI24515 - General Preparation

Blank (AI24515-BLK1)

Prepared & Analyzed: 09/27/22

Total Suspended Solids	ND	1.0	mg/L							
------------------------	----	-----	------	--	--	--	--	--	--	--

Duplicate (AI24515-DUP1)

Source: 22I2640-01

Prepared & Analyzed: 09/27/22

Total Suspended Solids	38.0	1.0	mg/L		37.6			1.06	30	
------------------------	------	-----	------	--	------	--	--	------	----	--

Duplicate (AI24515-DUP2)

Source: 22I3022-04

Prepared & Analyzed: 09/27/22

Total Suspended Solids	105	1.0	mg/L		98.3			6.37	30	
------------------------	-----	-----	------	--	------	--	--	------	----	--



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Groundwater
Project Number: [none]

Reported:
09/30/22 10:26

Anions by EPA Method 300.0 - Quality Control

Analyte(s)	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Flag
Batch AI24303 - NB General Prep										
Blank (AI24303-BLK1)				Prepared & Analyzed: 09/22/22						
Nitrate as N	ND	0.40	mg/L							
Sulfate as SO4	ND	0.50	mg/L							
LCS (AI24303-BS1)				Prepared & Analyzed: 09/22/22						
Nitrate as N	1.90	0.40	mg/L	1.80		105	90-110			
Sulfate as SO4	8.62	0.50	mg/L	8.00		108	90-110			
Duplicate (AI24303-DUP1)				Source: 22I2927-01		Prepared & Analyzed: 09/22/22				
Sulfate as SO4	19.8	0.50	mg/L		19.9			0.469	20	
Nitrate as N	ND	0.40	mg/L		ND				20	
MRL Check (AI24303-MRL1)				Prepared & Analyzed: 09/22/22						
Sulfate as SO4	1.76	0.50	mg/L	1.60		110	60-140			
Nitrate as N	0.343	0.40	mg/L	0.361		95.1	60-140			
Matrix Spike (AI24303-MS1)				Source: 22I2922-01		Prepared & Analyzed: 09/22/22				
Nitrate as N	2.22	0.40	mg/L	1.80	ND	108	80-120			
Sulfate as SO4	14.2	0.50	mg/L	8.00	5.46	109	80-120			
Matrix Spike (AI24303-MS2)				Source: 22I2925-01		Prepared & Analyzed: 09/22/22				
Nitrate as N	1.89	0.40	mg/L	1.80	ND	105	80-120			
Sulfate as SO4	10.9	0.50	mg/L	8.00	2.22	109	80-120			
Matrix Spike Dup (AI24303-MSD1)				Source: 22I2922-01		Prepared & Analyzed: 09/22/22				
Sulfate as SO4	14.2	0.50	mg/L	8.00	5.46	109	80-120	0.00774	20	
Nitrate as N	2.23	0.40	mg/L	1.80	ND	108	80-120	0.436	20	



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Groundwater
Project Number: [none]

Reported:
09/30/22 10:26

Notes and Definitions

- T-14 Residual chlorine, dissolved oxygen, sulfite, and pH must be analyzed in the field to meet the EPA specified 15 minute hold time.
- ND Analyte NOT DETECTED at or above the reporting limit
- dry Sample results reported on a dry weight basis
- REC Recovery
- RPD Relative Percent Difference

Non-accredited analytes are reported only when ELAP accreditation for a requested analyte method pair is not available. For a list of accredited analytes, view our certificates at the Company link on our website at www.alpha-labs.com or contact your Project Manager directly.

[illegible]



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

07 October 2022

Bottle Rock Power

Attn: M. Moore

4010 Stone Way North, Suite 400

Seattle, WA 98103

RE: Surface Water

Work Order: 2212925

Enclosed are the results of analyses for samples received by the laboratory on 09/22/22 11:35. If you have any questions concerning this report, please feel free to contact me.

Sincerely,

Stephen F. McWeeney

Project Manager



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Surface Water
Project Number: [none]

Reported:
10/07/22 10:18

Bay Area: 262 Rickenbacker Circle | Livermore, CA 94551 | 925-828-6226 | ELAP# 2728
Central Valley: 9090 Union Park Way Suite 113 | Elk Grove, CA 95624 | 916-686-5190 | ELAP# 2922
North Bay: 737 Southpoint Blvd Unit D | Petaluma, CA 94954 | 707-769-3128 | ELAP# 2303
San Diego: 2722 Loker Avenue West Suite A | Carlsbad, CA 92010 | 760-930-2555 | ELAP# 3055
Los Angeles: 1230 E. 223rd Street Suite 205 | Carson, CA 90745 | 424-267-5032 | Service Center

ANALYTICAL REPORT FOR SAMPLES

Sample ID	Laboratory ID	Matrix	Date Sampled	Date Received
SW-7	22I2925-01	Water	09/22/22 07:45	09/22/22 11:35
SW-9	22I2925-02	Water	09/22/22 08:00	09/22/22 11:35
SW-10	22I2925-03	Water	09/22/22 08:45	09/22/22 11:35
SW-8	22I2925-04	Water	09/22/22 09:10	09/22/22 11:35
SW-6	22I2925-05	Water	09/22/22 09:50	09/22/22 11:35



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Surface Water
Project Number: [none]

Reported:
10/07/22 10:18

	Result	Units	Reporting Limit	Dilution	Batch	Prepared	Analyzed	ELAP#	Method	Note
SW-7 (2212925-01)			Sample Type: Water			Sampled: 09/22/22 07:45				
Metals by EPA 200 Series Methods										
Arsenic	ND	mg/L	0.020	1	AI24353	09/23/22 07:50	09/26/22 08:11	2303	EPA 200.7	
Boron	ND	mg/L	0.10	1	AI24353	09/23/22 07:50	09/26/22 08:11	2303	EPA 200.7	
Calcium	5.8	mg/L	5.0	1	AI24353	09/23/22 07:50	09/26/22 08:11	2303	EPA 200.7	
Chromium	ND	mg/L	0.010	1	AI24353	09/23/22 07:50	09/26/22 08:11	2303	EPA 200.7	
Copper	ND	mg/L	0.050	1	AI24353	09/23/22 07:50	09/26/22 08:11	2303	EPA 200.7	
Iron	ND	mg/L	0.10	1	AI24353	09/23/22 07:50	09/26/22 08:11	2303	EPA 200.7	
Lead	ND	mg/L	0.020	1	AI24353	09/23/22 07:50	09/26/22 08:11	2303	EPA 200.7	
Magnesium	3.6	mg/L	0.60	1	AI24353	09/23/22 07:50	09/26/22 08:11	2303	EPA 200.7	
Manganese	ND	mg/L	0.020	1	AI24353	09/23/22 07:50	09/26/22 08:11	2303	EPA 200.7	
Mercury	ND	ug/L	0.20	1	AJ23403	10/06/22 05:37	10/06/22 13:05	1551	EPA 245.1	
Sodium	ND	mg/L	6.0	1	AI24353	09/23/22 07:50	09/26/22 08:11	2303	EPA 200.7	
Vanadium	ND	mg/L	0.020	1	AI24353	09/23/22 07:50	09/26/22 08:11	2303	EPA 200.7	
Zinc	ND	mg/L	0.30	1	AI24353	09/23/22 07:50	09/26/22 08:11	2303	EPA 200.7	
Conventional Chemistry Parameters by APHA/EPA Methods										
Dissolved Oxygen	9.6	mg/L	0.10	1	AI24489	09/23/22 16:00	09/23/22 17:00	1551	SM4500-O G	T-14
pH	7.19	pH Units	1.00	1	AI24301	09/22/22 13:29	09/22/22 18:20	2303	SM4500-H+ B	T-14
Specific Conductance (EC)	90	umhos/cm	10	1	AI24301	09/22/22 13:29	09/22/22 18:20	2303	SM2510B	
Total Alkalinity as CaCO3	42	mg/L	5.0	1	AI24369	09/23/22 09:53	09/23/22 18:27	2303	SM2320B	
Total Suspended Solids	ND	mg/L	1.0	1	AI24434	09/26/22 09:30	09/26/22 15:00	1551	SM2540D	
Turbidity	ND	NTU	1.0	1	AI23389	09/22/22 13:46	09/22/22 17:44	2303	SM2130B	
Bicarbonate Alkalinity as CaCO3	42	mg/L	5.0	1	AI24369	09/23/22 09:53	09/23/22 18:27	2303	SM2320B	
Carbonate Alkalinity as CaCO3	ND	mg/L	5.0	1	AI24369	09/23/22 09:53	09/23/22 18:27	2303	SM2320B	
Hydroxide Alkalinity as CaCO3	ND	mg/L	5.0	1	AI24369	09/23/22 09:53	09/23/22 18:27	2303	SM2320B	
Hardness, Total	29	mg/L	1	1	AI24353	09/23/22 07:50	09/26/22 08:11	2303	SM2340B	

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Surface Water
Project Number: [none]

Reported:
10/07/22 10:18

	Result	Units	Reporting Limit	Dilution	Batch	Prepared	Analyzed	ELAP#	Method	Note
SW-7 (22I2925-01)										
			Sample Type: Water			Sampled: 09/22/22 07:45				
Anions by EPA Method 300.0										
Sulfate as SO4	2.2	mg/L	0.50	1	AI24303	09/22/22 14:14	09/22/22 19:05	2303	EPA 300.0	
Microbiological Parameters by APHA Standard Methods										
Total Coliforms	2400	MPN/100mL	1.0	1	AI24307	09/22/22 16:00	09/23/22 16:15	2303	SM9223B	
E. Coli	16	MPN/100mL	1.0	1	AI24307	09/22/22 16:00	09/23/22 16:15	2303	SM9223B	
SW-9 (22I2925-02)										
			Sample Type: Water			Sampled: 09/22/22 08:00				
Metals by EPA 200 Series Methods										
Arsenic	ND	mg/L	0.020	1	AI24353	09/23/22 07:50	09/26/22 08:14	2303	EPA 200.7	
Boron	ND	mg/L	0.10	1	AI24353	09/23/22 07:50	09/26/22 08:14	2303	EPA 200.7	
Calcium	47	mg/L	5.0	1	AI24353	09/23/22 07:50	09/26/22 08:14	2303	EPA 200.7	
Chromium	ND	mg/L	0.010	1	AI24353	09/23/22 07:50	09/26/22 08:14	2303	EPA 200.7	
Copper	ND	mg/L	0.050	1	AI24353	09/23/22 07:50	09/26/22 08:14	2303	EPA 200.7	
Iron	ND	mg/L	0.10	1	AI24353	09/23/22 07:50	09/26/22 08:14	2303	EPA 200.7	
Lead	ND	mg/L	0.020	1	AI24353	09/23/22 07:50	09/26/22 08:14	2303	EPA 200.7	
Magnesium	15	mg/L	0.60	1	AI24353	09/23/22 07:50	09/26/22 08:14	2303	EPA 200.7	
Manganese	0.10	mg/L	0.020	1	AI24353	09/23/22 07:50	09/26/22 08:14	2303	EPA 200.7	
Mercury	ND	ug/L	0.20	1	AJ23403	10/06/22 05:37	10/06/22 13:08	1551	EPA 245.1	
Sodium	8.6	mg/L	6.0	1	AI24353	09/23/22 07:50	09/26/22 08:14	2303	EPA 200.7	
Vanadium	ND	mg/L	0.020	1	AI24353	09/23/22 07:50	09/26/22 08:14	2303	EPA 200.7	
Zinc	ND	mg/L	0.30	1	AI24353	09/23/22 07:50	09/26/22 08:14	2303	EPA 200.7	



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Surface Water
Project Number: [none]

Reported:
10/07/22 10:18

	Result	Units	Reporting Limit	Dilution	Batch	Prepared	Analyzed	ELAP#	Method	Note
SW-9 (22I2925-02)			Sample Type: Water			Sampled: 09/22/22 08:00				
Conventional Chemistry Parameters by APHA/EPA Methods										
Dissolved Oxygen	8.6	mg/L	0.10	1	AI24489	09/23/22 16:00	09/23/22 17:00	1551	SM4500-O G	T-14
pH	7.59	pH Units	1.00	1	AI24301	09/22/22 13:29	09/22/22 18:20	2303	SM4500-H+ B	T-14
Specific Conductance (EC)	380	umhos/cm	10	1	AI24301	09/22/22 13:29	09/22/22 18:20	2303	SM2510B	
Total Alkalinity as CaCO3	180	mg/L	5.0	1	AI24369	09/23/22 09:53	09/23/22 18:27	2303	SM2320B	
Total Suspended Solids	ND	mg/L	1.0	1	AI24434	09/26/22 09:30	09/26/22 15:00	1551	SM2540D	
Turbidity	ND	NTU	1.0	1	AI23389	09/22/22 13:46	09/22/22 17:44	2303	SM2130B	
Bicarbonate Alkalinity as CaCO3	180	mg/L	5.0	1	AI24369	09/23/22 09:53	09/23/22 18:27	2303	SM2320B	
Carbonate Alkalinity as CaCO3	ND	mg/L	5.0	1	AI24369	09/23/22 09:53	09/23/22 18:27	2303	SM2320B	
Hydroxide Alkalinity as CaCO3	ND	mg/L	5.0	1	AI24369	09/23/22 09:53	09/23/22 18:27	2303	SM2320B	
Hardness, Total	180	mg/L	1	1	AI24353	09/23/22 07:50	09/26/22 08:14	2303	SM2340B	
Anions by EPA Method 300.0										
Sulfate as SO4	20	mg/L	0.50	1	AI24303	09/22/22 14:14	09/22/22 19:17	2303	EPA 300.0	
Microbiological Parameters by APHA Standard Methods										
Total Coliforms	64	MPN/100mL	1.0	1	AI24307	09/22/22 16:00	09/23/22 16:15	2303	SM9223B	
E. Coli	ND	MPN/100mL	1.0	1	AI24307	09/22/22 16:00	09/23/22 16:15	2303	SM9223B	
SW-10 (22I2925-03)			Sample Type: Water			Sampled: 09/22/22 08:45				
Metals by EPA 200 Series Methods										
Arsenic	ND	mg/L	0.020	1	AI24353	09/23/22 07:50	09/26/22 08:17	2303	EPA 200.7	
Boron	ND	mg/L	0.10	1	AI24353	09/23/22 07:50	09/26/22 08:17	2303	EPA 200.7	
Calcium	6.5	mg/L	5.0	1	AI24353	09/23/22 07:50	09/26/22 08:17	2303	EPA 200.7	
Chromium	ND	mg/L	0.010	1	AI24353	09/23/22 07:50	09/26/22 08:17	2303	EPA 200.7	
Copper	ND	mg/L	0.050	1	AI24353	09/23/22 07:50	09/26/22 08:17	2303	EPA 200.7	
Iron	ND	mg/L	0.10	1	AI24353	09/23/22 07:50	09/26/22 08:17	2303	EPA 200.7	
Lead	ND	mg/L	0.020	1	AI24353	09/23/22 07:50	09/26/22 08:17	2303	EPA 200.7	
Magnesium	4.0	mg/L	0.60	1	AI24353	09/23/22 07:50	09/26/22 08:17	2303	EPA 200.7	
Manganese	ND	mg/L	0.020	1	AI24353	09/23/22 07:50	09/26/22 08:17	2303	EPA 200.7	
Mercury	ND	ug/L	0.20	1	AJ23403	10/06/22 05:37	10/06/22 13:10	1551	EPA 245.1	
Sodium	ND	mg/L	6.0	1	AI24353	09/23/22 07:50	09/26/22 08:17	2303	EPA 200.7	
Vanadium	ND	mg/L	0.020	1	AI24353	09/23/22 07:50	09/26/22 08:17	2303	EPA 200.7	
Zinc	ND	mg/L	0.30	1	AI24353	09/23/22 07:50	09/26/22 08:17	2303	EPA 200.7	

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Surface Water
Project Number: [none]

Reported:
10/07/22 10:18

	Result	Units	Reporting Limit	Dilution	Batch	Prepared	Analyzed	ELAP#	Method	Note
SW-10 (22I2925-03)			Sample Type: Water			Sampled: 09/22/22 08:45				
Conventional Chemistry Parameters by APHA/EPA Methods										
Dissolved Oxygen	8.8	mg/L	0.10	1	AI24489	09/23/22 16:00	09/23/22 17:00	1551	SM4500-O G	T-14
pH	7.01	pH Units	1.00	1	AI24301	09/22/22 13:29	09/22/22 18:20	2303	SM4500-H+ B	T-14
Specific Conductance (EC)	92	umhos/cm	10	1	AI24301	09/22/22 13:29	09/22/22 18:20	2303	SM2510B	
Total Alkalinity as CaCO3	39	mg/L	5.0	1	AI24369	09/23/22 09:53	09/23/22 18:27	2303	SM2320B	
Total Suspended Solids	ND	mg/L	1.0	1	AI24434	09/26/22 09:30	09/26/22 15:00	1551	SM2540D	
Turbidity	ND	NTU	1.0	1	AI23389	09/22/22 13:46	09/22/22 17:44	2303	SM2130B	
Bicarbonate Alkalinity as CaCO3	39	mg/L	5.0	1	AI24369	09/23/22 09:53	09/23/22 18:27	2303	SM2320B	
Carbonate Alkalinity as CaCO3	ND	mg/L	5.0	1	AI24369	09/23/22 09:53	09/23/22 18:27	2303	SM2320B	
Hydroxide Alkalinity as CaCO3	ND	mg/L	5.0	1	AI24369	09/23/22 09:53	09/23/22 18:27	2303	SM2320B	
Hardness, Total	33	mg/L	1	1	AI24353	09/23/22 07:50	09/26/22 08:17	2303	SM2340B	
Anions by EPA Method 300.0										
Sulfate as SO4	2.2	mg/L	0.50	1	AI24303	09/22/22 14:14	09/22/22 19:29	2303	EPA 300.0	
Microbiological Parameters by APHA Standard Methods										
Total Coliforms	2400	MPN/100mL	1.0	1	AI24307	09/22/22 16:00	09/23/22 16:15	2303	SM9223B	
E. Coli	13	MPN/100mL	1.0	1	AI24307	09/22/22 16:00	09/23/22 16:15	2303	SM9223B	
SW-8 (22I2925-04)			Sample Type: Water			Sampled: 09/22/22 09:10				
Metals by EPA 200 Series Methods										
Arsenic	ND	mg/L	0.020	1	AI24353	09/23/22 07:50	09/26/22 08:20	2303	EPA 200.7	
Boron	ND	mg/L	0.10	1	AI24353	09/23/22 07:50	09/26/22 08:20	2303	EPA 200.7	
Calcium	5.9	mg/L	5.0	1	AI24353	09/23/22 07:50	09/26/22 08:20	2303	EPA 200.7	
Chromium	ND	mg/L	0.010	1	AI24353	09/23/22 07:50	09/26/22 08:20	2303	EPA 200.7	
Copper	ND	mg/L	0.050	1	AI24353	09/23/22 07:50	09/26/22 08:20	2303	EPA 200.7	
Iron	ND	mg/L	0.10	1	AI24353	09/23/22 07:50	09/26/22 08:20	2303	EPA 200.7	
Lead	ND	mg/L	0.020	1	AI24353	09/23/22 07:50	09/26/22 08:20	2303	EPA 200.7	
Magnesium	3.6	mg/L	0.60	1	AI24353	09/23/22 07:50	09/26/22 08:20	2303	EPA 200.7	
Manganese	ND	mg/L	0.020	1	AI24353	09/23/22 07:50	09/26/22 08:20	2303	EPA 200.7	
Mercury	ND	ug/L	0.20	1	AJ23403	10/06/22 05:37	10/06/22 13:13	1551	EPA 245.1	
Sodium	ND	mg/L	6.0	1	AI24353	09/23/22 07:50	09/26/22 08:20	2303	EPA 200.7	
Vanadium	ND	mg/L	0.020	1	AI24353	09/23/22 07:50	09/26/22 08:20	2303	EPA 200.7	
Zinc	ND	mg/L	0.30	1	AI24353	09/23/22 07:50	09/26/22 08:20	2303	EPA 200.7	

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Surface Water
Project Number: [none]

Reported:
10/07/22 10:18

	Result	Units	Reporting Limit	Dilution	Batch	Prepared	Analyzed	ELAP#	Method	Note
SW-8 (22I2925-04)			Sample Type: Water			Sampled: 09/22/22 09:10				
Conventional Chemistry Parameters by APHA/EPA Methods										
Dissolved Oxygen	9.7	mg/L	0.10	1	AI24489	09/23/22 16:00	09/23/22 17:00	1551	SM4500-O G	T-14
pH	7.29	pH Units	1.00	1	AI24301	09/22/22 13:29	09/22/22 18:20	2303	SM4500-H+ B	T-14
Specific Conductance (EC)	90	umhos/cm	10	1	AI24301	09/22/22 13:29	09/22/22 18:20	2303	SM2510B	
Total Alkalinity as CaCO3	40	mg/L	5.0	1	AI24369	09/23/22 09:53	09/23/22 18:27	2303	SM2320B	
Total Suspended Solids	ND	mg/L	1.0	1	AI24434	09/26/22 09:30	09/26/22 15:00	1551	SM2540D	
Turbidity	ND	NTU	1.0	1	AI23389	09/22/22 13:46	09/22/22 17:44	2303	SM2130B	
Bicarbonate Alkalinity as CaCO3	40	mg/L	5.0	1	AI24369	09/23/22 09:53	09/23/22 18:27	2303	SM2320B	
Carbonate Alkalinity as CaCO3	ND	mg/L	5.0	1	AI24369	09/23/22 09:53	09/23/22 18:27	2303	SM2320B	
Hydroxide Alkalinity as CaCO3	ND	mg/L	5.0	1	AI24369	09/23/22 09:53	09/23/22 18:27	2303	SM2320B	
Hardness, Total	30	mg/L	1	1	AI24353	09/23/22 07:50	09/26/22 08:20	2303	SM2340B	
Anions by EPA Method 300.0										
Sulfate as SO4	2.2	mg/L	0.50	1	AI24303	09/22/22 14:14	09/22/22 19:41	2303	EPA 300.0	
Microbiological Parameters by APHA Standard Methods										
Total Coliforms	2400	MPN/100mL	1.0	1	AI24307	09/22/22 16:00	09/23/22 16:15	2303	SM9223B	
E. Coli	15	MPN/100mL	1.0	1	AI24307	09/22/22 16:00	09/23/22 16:15	2303	SM9223B	
SW-6 (22I2925-05)			Sample Type: Water			Sampled: 09/22/22 09:50				
Metals by EPA 200 Series Methods										
Arsenic	ND	mg/L	0.020	1	AI24353	09/23/22 07:50	09/26/22 08:23	2303	EPA 200.7	
Boron	1.8	mg/L	0.10	1	AI24353	09/23/22 07:50	09/26/22 08:23	2303	EPA 200.7	
Calcium	28	mg/L	5.0	1	AI24353	09/23/22 07:50	09/26/22 08:23	2303	EPA 200.7	
Chromium	ND	mg/L	0.010	1	AI24353	09/23/22 07:50	09/26/22 08:23	2303	EPA 200.7	
Copper	ND	mg/L	0.050	1	AI24353	09/23/22 07:50	09/26/22 08:23	2303	EPA 200.7	
Iron	ND	mg/L	0.10	1	AI24353	09/23/22 07:50	09/26/22 08:23	2303	EPA 200.7	
Lead	ND	mg/L	0.020	1	AI24353	09/23/22 07:50	09/26/22 08:23	2303	EPA 200.7	
Magnesium	27	mg/L	0.60	1	AI24353	09/23/22 07:50	09/26/22 08:23	2303	EPA 200.7	
Manganese	0.050	mg/L	0.020	1	AI24353	09/23/22 07:50	09/26/22 08:23	2303	EPA 200.7	
Mercury	ND	ug/L	0.20	1	AJ23403	10/06/22 05:37	10/06/22 13:16	1551	EPA 245.1	
Sodium	13	mg/L	6.0	1	AI24353	09/23/22 07:50	09/26/22 08:23	2303	EPA 200.7	
Vanadium	ND	mg/L	0.020	1	AI24353	09/23/22 07:50	09/26/22 08:23	2303	EPA 200.7	
Zinc	ND	mg/L	0.30	1	AI24353	09/23/22 07:50	09/26/22 08:23	2303	EPA 200.7	

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Surface Water
Project Number: [none]

Reported:
10/07/22 10:18

	Result	Units	Reporting Limit	Dilution	Batch	Prepared	Analyzed	ELAP#	Method	Note
SW-6 (2212925-05)			Sample Type: Water			Sampled: 09/22/22 09:50				
Conventional Chemistry Parameters by APHA/EPA Methods										
Dissolved Oxygen	8.7	mg/L	0.10	1	AI24489	09/23/22 16:00	09/23/22 17:00	1551	SM4500-O G	T-14
pH	7.90	pH Units	1.00	1	AI24301	09/22/22 13:29	09/22/22 18:20	2303	SM4500-H+ B	T-14
Specific Conductance (EC)	380	umhos/cm	10	1	AI24301	09/22/22 13:29	09/22/22 18:20	2303	SM2510B	
Total Alkalinity as CaCO3	200	mg/L	5.0	1	AI24369	09/23/22 09:53	09/23/22 18:27	2303	SM2320B	
Total Suspended Solids	ND	mg/L	1.0	1	AI24434	09/26/22 09:30	09/26/22 15:00	1551	SM2540D	
Turbidity	1.0	NTU	1.0	1	AI23389	09/22/22 13:46	09/22/22 17:44	2303	SM2130B	
Bicarbonate Alkalinity as CaCO3	200	mg/L	5.0	1	AI24369	09/23/22 09:53	09/23/22 18:27	2303	SM2320B	
Carbonate Alkalinity as CaCO3	ND	mg/L	5.0	1	AI24369	09/23/22 09:53	09/23/22 18:27	2303	SM2320B	
Hydroxide Alkalinity as CaCO3	ND	mg/L	5.0	1	AI24369	09/23/22 09:53	09/23/22 18:27	2303	SM2320B	
Hardness, Total	179	mg/L	1	1	AI24353	09/23/22 07:50	09/26/22 08:23	2303	SM2340B	
Anions by EPA Method 300.0										
Sulfate as SO4	13	mg/L	0.50	1	AI24303	09/22/22 14:14	09/22/22 20:05	2303	EPA 300.0	
Microbiological Parameters by APHA Standard Methods										
Total Coliforms	2.0	MPN/100mL	1.0	1	AI24307	09/22/22 16:00	09/23/22 16:15	2303	SM9223B	
E. Coli	ND	MPN/100mL	1.0	1	AI24307	09/22/22 16:00	09/23/22 16:15	2303	SM9223B	



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Surface Water
Project Number: [none]

Reported:
10/07/22 10:18

Metals by EPA 200 Series Methods - Quality Control

Analyte(s)	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Flag
------------	--------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------	------

Batch AI24353 - NB EPA 200 series DA

Blank (AI24353-BLK1)

Prepared: 09/23/22 Analyzed: 09/26/22

Arsenic	ND	0.020	mg/L
Boron	ND	0.10	mg/L
Calcium	ND	5.0	mg/L
Chromium	ND	0.010	mg/L
Copper	ND	0.050	mg/L
Iron	ND	0.10	mg/L
Lead	ND	0.020	mg/L
Magnesium	ND	0.60	mg/L
Manganese	ND	0.020	mg/L
Sodium	ND	6.0	mg/L
Vanadium	ND	0.020	mg/L
Zinc	ND	0.30	mg/L

LCS (AI24353-BS1)

Prepared: 09/23/22 Analyzed: 09/26/22

Arsenic	0.500	0.020	mg/L	0.500	100	85-115
Boron	0.484	0.10	mg/L	0.500	96.8	85-115
Calcium	23.6	5.0	mg/L	25.5	92.4	85-115
Chromium	0.474	0.010	mg/L	0.500	94.8	85-115
Copper	0.472	0.050	mg/L	0.500	94.3	85-115
Iron	0.504	0.10	mg/L	0.500	101	85-115
Lead	0.456	0.020	mg/L	0.500	91.1	85-115
Magnesium	24.8	0.60	mg/L	25.5	97.4	85-115
Manganese	0.521	0.020	mg/L	0.500	104	85-115
Sodium	25.0	6.0	mg/L	25.5	98.1	85-115
Vanadium	0.489	0.020	mg/L	0.500	97.8	85-115
Zinc	0.498	0.30	mg/L	0.500	99.7	85-115

LCS Dup (AI24353-BSD1)

Prepared: 09/23/22 Analyzed: 09/26/22

Arsenic	0.499	0.020	mg/L	0.500	99.8	85-115	0.200	20
Boron	0.485	0.10	mg/L	0.500	96.9	85-115	0.124	20
Calcium	23.5	5.0	mg/L	25.5	92.3	85-115	0.0874	20
Chromium	0.473	0.010	mg/L	0.500	94.7	85-115	0.148	20
Copper	0.471	0.050	mg/L	0.500	94.2	85-115	0.127	20
Iron	0.505	0.10	mg/L	0.500	101	85-115	0.198	20
Lead	0.454	0.020	mg/L	0.500	90.9	85-115	0.308	20

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Surface Water
Project Number: [none]

Reported:
10/07/22 10:18

Metals by EPA 200 Series Methods - Quality Control

Analyte(s)	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Flag
------------	--------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------	------

Batch AI24353 - NB EPA 200 series DA

LCS Dup (AI24353-BSD1)

Prepared: 09/23/22 Analyzed: 09/26/22

Magnesium	24.8	0.60	mg/L	25.5		97.1	85-115	0.265	20	
Manganese	0.520	0.020	mg/L	0.500		104	85-115	0.211	20	
Sodium	25.0	6.0	mg/L	25.5		97.9	85-115	0.177	20	
Vanadium	0.488	0.020	mg/L	0.500		97.5	85-115	0.266	20	
Zinc	0.500	0.30	mg/L	0.500		99.9	85-115	0.220	20	

Duplicate (AI24353-DUP1)

Source: 2212925-01

Prepared: 09/23/22 Analyzed: 09/26/22

Arsenic	ND	0.020	mg/L		ND				20	
Boron	ND	0.10	mg/L		ND			1.02	20	
Calcium	5.90	5.0	mg/L		5.85			0.877	20	
Chromium	ND	0.010	mg/L		ND				20	
Copper	ND	0.050	mg/L		ND				20	
Iron	ND	0.10	mg/L		ND			0.569	20	
Lead	ND	0.020	mg/L		ND				20	
Magnesium	3.63	0.60	mg/L		3.60			0.592	20	
Manganese	ND	0.020	mg/L		ND				20	
Sodium	ND	6.0	mg/L		ND			0.0823	20	
Vanadium	ND	0.020	mg/L		ND				20	
Zinc	ND	0.30	mg/L		ND				20	

MRL Check (AI24353-MRL1)

Prepared: 09/23/22 Analyzed: 09/26/22

Boron	0.0953	0.10	mg/L	0.100		95.3	0-200			
Calcium	4.32	5.0	mg/L	5.00		86.5	0-200			
Copper	0.0449	0.050	mg/L	0.0500		89.8	0-200			
Iron	0.100	0.10	mg/L	0.100		100	0-200			
Magnesium	0.451	0.60	mg/L	0.500		90.2	0-200			
Manganese	0.0197	0.020	mg/L	0.0200		98.5	0-200			
Sodium	4.93	6.0	mg/L	5.00		98.7	0-200			
Zinc	ND	0.30	mg/L	0.0500			0-200			



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Surface Water
Project Number: [none]

Reported:
10/07/22 10:18

Metals by EPA 200 Series Methods - Quality Control

Analyte(s)	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Flag
Batch AI24353 - NB EPA 200 series DA										
Matrix Spike (AI24353-MS1)		Source: 22I2925-05		Prepared: 09/23/22 Analyzed: 09/26/22						
Arsenic	0.507	0.020	mg/L	0.500	ND	101	70-130			
Boron	2.22	0.10	mg/L	0.500	1.84	75.8	70-130			
Chromium	0.477	0.010	mg/L	0.500	ND	95.4	70-130			
Copper	0.480	0.050	mg/L	0.500	ND	95.9	70-130			
Iron	0.581	0.10	mg/L	0.500	ND	100	70-130			
Lead	0.458	0.020	mg/L	0.500	ND	91.7	70-130			
Manganese	0.566	0.020	mg/L	0.500	0.0495	103	70-130			
Sodium	37.2	6.0	mg/L	25.5	13.3	93.7	70-130			
Vanadium	0.494	0.020	mg/L	0.500	ND	98.8	70-130			
Zinc	0.502	0.30	mg/L	0.500	ND	100	70-130			

Batch AJ23403 - Hg Digest

Blank (AJ23403-BLK1)

Prepared & Analyzed: 10/06/22

Mercury	ND	0.20	ug/L
---------	----	------	------

LCS (AJ23403-BS1)

Prepared & Analyzed: 10/06/22

Mercury	2.40	0.20	ug/L	2.50	96.2	85-115
---------	------	------	------	------	------	--------

Duplicate (AJ23403-DUP1)

Source: 22I3324-01

Prepared & Analyzed: 10/06/22

Mercury	ND	0.20	ug/L	ND	20
---------	----	------	------	----	----

Matrix Spike (AJ23403-MS1)

Source: 22I3324-01

Prepared & Analyzed: 10/06/22

Mercury	2.13	0.20	ug/L	2.50	ND	85.2	70-130
---------	------	------	------	------	----	------	--------

Matrix Spike (AJ23403-MS2)

Source: 22I3327-01

Prepared & Analyzed: 10/06/22

Mercury	2.27	0.20	ug/L	2.50	ND	90.7	70-130
---------	------	------	------	------	----	------	--------



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power 4010 Stone Way North, Suite 400 Seattle, WA 98103	Project Manager: M. Moore Project: Surface Water Project Number: [none]	Reported: 10/07/22 10:18
---	---	-----------------------------

Metals by EPA 200 Series Methods - Quality Control

Analyte(s)	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Flag
------------	--------	--------------------	-------	----------------	------------------	------	----------------	-----	--------------	------

Batch AJ23403 - Hg Digest

Matrix Spike Dup (AJ23403-MSD1)

Source: 2213324-01

Prepared & Analyzed: 10/06/22

Mercury	2.29	0.20	ug/L	2.50	ND	91.5	70-130	7.20	20	
---------	------	------	------	------	----	------	--------	------	----	--



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Surface Water
Project Number: [none]

Reported:
10/07/22 10:18

Conventional Chemistry Parameters by APHA/EPA Methods - Quality Control

Analyte(s)	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Flag
Batch AI23389 - NB General Prep										
Blank (AI23389-BLK1)				Prepared & Analyzed: 09/08/22						
Turbidity	ND	1.0	NTU							
Duplicate (AI23389-DUP1)				Source: 22I0944-01 Prepared & Analyzed: 09/08/22						
Turbidity	1.23	1.0	NTU		1.26			2.41	20	
Reference (AI23389-SRM1)				Prepared & Analyzed: 09/08/22						
Turbidity	1.15	1.0	NTU	1.00		115	0-200			
Batch AI24301 - NB General Prep										
Duplicate (AI24301-DUP1)				Source: 22I2946-03 Prepared & Analyzed: 09/22/22						
Specific Conductance (EC)	492	10	umhos/cm		493			0.203	5	
pH	7.86	1.00	pH Units		7.87			0.127	20	T-14
Batch AI24353 - NB EPA 200 series DA										
Blank (AI24353-BLK1)				Prepared: 09/23/22 Analyzed: 09/26/22						
Hardness, Total	ND	1	mg/L							
Duplicate (AI24353-DUP1)				Source: 22I2925-01 Prepared: 09/23/22 Analyzed: 09/26/22						
Hardness, Total	30	1	mg/L		29			0.733	20	
Batch AI24369 - NB General Prep										
LCS (AI24369-BS1)				Prepared & Analyzed: 09/23/22						
Total Alkalinity as CaCO ₃	1010	5.0	mg/L	1000		101	80-120			



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Surface Water
Project Number: [none]

Reported:
10/07/22 10:18

Conventional Chemistry Parameters by APHA/EPA Methods - Quality Control

Analyte(s)	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Flag
------------	--------	--------------------	-------	----------------	------------------	------	----------------	-----	--------------	------

Batch AI24369 - NB General Prep

Duplicate (AI24369-DUP1)		Source: 22I2925-04			Prepared & Analyzed: 09/23/22					
Total Alkalinity as CaCO ₃	40.0	5.0	mg/L		40.0		0.00		20	
Bicarbonate Alkalinity as CaCO ₃	39.9	5.0	mg/L		39.9		0.0501		20	
Carbonate Alkalinity as CaCO ₃	ND	5.0	mg/L		ND				20	
Hydroxide Alkalinity as CaCO ₃	ND	5.0	mg/L		ND				20	

Batch AI24434 - General Preparation

Blank (AI24434-BLK1)					Prepared & Analyzed: 09/26/22					
Total Suspended Solids	ND	1.0	mg/L							
Duplicate (AI24434-DUP1)		Source: 22I2628-01			Prepared & Analyzed: 09/26/22					
Total Suspended Solids	196	1.0	mg/L		188		4.17		30	
Duplicate (AI24434-DUP2)		Source: 22I2848-01			Prepared & Analyzed: 09/26/22					
Total Suspended Solids	322	1.0	mg/L		318		1.25		30	



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Surface Water
Project Number: [none]

Reported:
10/07/22 10:18

Anions by EPA Method 300.0 - Quality Control

Analyte(s)	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Flag
Batch AI24303 - NB General Prep										
Blank (AI24303-BLK1)				Prepared & Analyzed: 09/22/22						
Sulfate as SO ₄	ND	0.50	mg/L							
LCS (AI24303-BS1)				Prepared & Analyzed: 09/22/22						
Sulfate as SO ₄	8.62	0.50	mg/L	8.00		108	90-110			
Duplicate (AI24303-DUP1)				Source: 22I2927-01		Prepared & Analyzed: 09/22/22				
Sulfate as SO ₄	19.8	0.50	mg/L		19.9			0.469	20	
MRL Check (AI24303-MRL1)				Prepared & Analyzed: 09/22/22						
Sulfate as SO ₄	1.76	0.50	mg/L	1.60		110	60-140			
Matrix Spike (AI24303-MS1)				Source: 22I2922-01		Prepared & Analyzed: 09/22/22				
Sulfate as SO ₄	14.2	0.50	mg/L	8.00	5.46	109	80-120			
Matrix Spike (AI24303-MS2)				Source: 22I2925-01		Prepared & Analyzed: 09/22/22				
Sulfate as SO ₄	10.9	0.50	mg/L	8.00	2.22	109	80-120			
Matrix Spike Dup (AI24303-MSD1)				Source: 22I2922-01		Prepared & Analyzed: 09/22/22				
Sulfate as SO ₄	14.2	0.50	mg/L	8.00	5.46	109	80-120	0.00774	20	



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Surface Water
Project Number: [none]

Reported:
10/07/22 10:18

Notes and Definitions

- T-14 Residual chlorine, dissolved oxygen, sulfite, and pH must be analyzed in the field to meet the EPA specified 15 minute hold time.
- ND Analyte NOT DETECTED at or above the reporting limit
- dry Sample results reported on a dry weight basis
- REC Recovery
- RPD Relative Percent Difference

Non-accredited analytes are reported only when ELAP accreditation for a requested analyte method pair is not available. For a list of accredited analytes, view our certificates at the Company link on our website at www.alpha-labs.com or contact your Project Manager directly.

[illegible]



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

11 January 2023

Bottle Rock Power

Attn: M. Moore

4010 Stone Way North, Suite 400

Seattle, WA 98103

RE: Groundwater

Work Order: 22L3442

Enclosed are the results of analyses for samples received by the laboratory on 12/22/22 12:45. If you have any questions concerning this report, please feel free to contact me.

Sincerely,

Stephen F. McWeeney

Project Manager



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Groundwater
Project Number: [none]

Reported:
01/11/23 07:24

Bay Area: 262 Rickenbacker Circle | Livermore, CA 94551 | 925-828-6226 | ELAP# 2728
Central Valley: 9090 Union Park Way Suite 113 | Elk Grove, CA 95624 | 916-686-5190 | ELAP# 2922
North Bay: 737 Southpoint Blvd Unit D | Petaluma, CA 94954 | 707-769-3128 | ELAP# 2303
San Diego: 2722 Loker Avenue West Suite A | Carlsbad, CA 92010 | 760-930-2555 | ELAP# 3055
Los Angeles: 1230 E. 223rd Street Suite 205 | Carson, CA 90745 | 424-267-5032 | Service Center

ANALYTICAL REPORT FOR SAMPLES

Sample ID	Laboratory ID	Matrix	Date Sampled	Date Received
GW-3	22L3442-01	Water	12/22/22 08:00	12/22/22 12:45
GW-1	22L3442-02	Water	12/22/22 08:50	12/22/22 12:45



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Groundwater
Project Number: [none]

Reported:
01/11/23 07:24

	Result	Units	Reporting Limit	Dilution	Batch	Prepared	Analyzed	ELAP#	Method	Note
GW-3 (22L3442-01)			Sample Type: Water		Sampled: 12/22/22 08:00					
Metals by EPA 200 Series Methods										
Arsenic	ND	ug/L	2.0	1	AL25014	12/23/22 06:10	12/27/22 09:34	2303	EPA 200.5	
Boron	0.40	mg/L	0.10	1	AL25017	12/23/22 06:45	12/23/22 09:04	2303	EPA 200.7	
Calcium	33	mg/L	5.0	1	AL25017	12/23/22 06:45	12/23/22 09:04	2303	EPA 200.7	
Copper	ND	mg/L	0.050	1	AL25017	12/23/22 06:45	12/23/22 09:04	2303	EPA 200.7	
Iron	0.15	mg/L	0.10	1	AL25017	12/23/22 06:45	12/23/22 09:04	2303	EPA 200.7	
Lead	ND	mg/L	0.020	1	AL25017	12/23/22 06:45	12/23/22 09:04	2303	EPA 200.7	
Magnesium	9.9	mg/L	0.60	1	AL25017	12/23/22 06:45	12/23/22 09:04	2303	EPA 200.7	
Manganese	0.048	mg/L	0.020	1	AL25017	12/23/22 06:45	12/23/22 09:04	2303	EPA 200.7	
Sodium	24	mg/L	6.0	1	AL25017	12/23/22 06:45	12/23/22 09:04	2303	EPA 200.7	
Zinc	ND	mg/L	0.30	1	AL25017	12/23/22 06:45	12/23/22 09:04	2303	EPA 200.7	
Conventional Chemistry Parameters by APHA/EPA Methods										
pH	7.66	pH Units	1.00	1	AL24981	12/22/22 14:00	12/22/22 15:21	2303	SM4500-H+ B	T-14
Specific Conductance (EC)	360	umhos/cm	10	1	AL24981	12/22/22 14:00	12/22/22 15:21	2303	SM2510B	
Total Alkalinity as CaCO3	180	mg/L	5.0	1	AL25040	12/23/22 08:00	12/23/22 10:14	2303	SM2320B	
Total Suspended Solids	ND	mg/L	1.0	1	AL25211	12/28/22 09:00	12/28/22 15:30	1551	SM2540D	
Turbidity	ND	NTU	1.0	1	AL24810	12/22/22 14:00	12/22/22 15:20	2303	SM2130B	
Bicarbonate Alkalinity as CaCO3	180	mg/L	5.0	1	AL25040	12/23/22 08:00	12/23/22 10:14	2303	SM2320B	
Carbonate Alkalinity as CaCO3	ND	mg/L	5.0	1	AL25040	12/23/22 08:00	12/23/22 10:14	2303	SM2320B	
Hydroxide Alkalinity as CaCO3	ND	mg/L	5.0	1	AL25040	12/23/22 08:00	12/23/22 10:14	2303	SM2320B	
Hardness, Total	123	mg/L	1	1	AL25017	12/23/22 06:45	12/23/22 09:04	2303	SM2340B	
Anions by EPA Method 300.0										
Nitrate as N	ND	mg/L	0.40	1	AL24984	12/22/22 17:00	12/22/22 19:22	2303	EPA 300.0	
Sulfate as SO4	5.8	mg/L	0.50	1	AL24984	12/22/22 17:00	12/22/22 19:22	2303	EPA 300.0	
GW-1 (22L3442-02)			Sample Type: Water		Sampled: 12/22/22 08:50					
Metals by EPA 200 Series Methods										
Arsenic	ND	ug/L	2.0	1	AL25014	12/23/22 06:10	12/27/22 09:40	2303	EPA 200.5	
Boron	ND	mg/L	0.10	1	AL25017	12/23/22 06:45	12/23/22 09:07	2303	EPA 200.7	
Calcium	46	mg/L	5.0	1	AL25017	12/23/22 06:45	12/23/22 09:07	2303	EPA 200.7	
Copper	ND	mg/L	0.050	1	AL25017	12/23/22 06:45	12/23/22 09:07	2303	EPA 200.7	
Iron	ND	mg/L	0.10	1	AL25017	12/23/22 06:45	12/23/22 09:07	2303	EPA 200.7	
Lead	ND	mg/L	0.020	1	AL25017	12/23/22 06:45	12/23/22 09:07	2303	EPA 200.7	
Magnesium	15	mg/L	0.60	1	AL25017	12/23/22 06:45	12/23/22 09:07	2303	EPA 200.7	
Manganese	0.093	mg/L	0.020	1	AL25017	12/23/22 06:45	12/23/22 09:07	2303	EPA 200.7	
Sodium	8.1	mg/L	6.0	1	AL25017	12/23/22 06:45	12/23/22 09:07	2303	EPA 200.7	
Zinc	ND	mg/L	0.30	1	AL25017	12/23/22 06:45	12/23/22 09:07	2303	EPA 200.7	

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Groundwater
Project Number: [none]

Reported:
01/11/23 07:24

	Result	Units	Reporting Limit	Dilution	Batch	Prepared	Analyzed	ELAP#	Method	Note
GW-1 (22L3442-02)			Sample Type: Water			Sampled: 12/22/22 08:50				
Conventional Chemistry Parameters by APHA/EPA Methods										
pH	7.63	pH Units	1.00	1	AL24981	12/22/22 14:00	12/22/22 15:21	2303	SM4500-H+ B	T-14
Specific Conductance (EC)	390	umhos/cm	10	1	AL24981	12/22/22 14:00	12/22/22 15:21	2303	SM2510B	
Total Alkalinity as CaCO3	180	mg/L	5.0	1	AL25040	12/23/22 08:00	12/23/22 10:14	2303	SM2320B	
Total Suspended Solids	ND	mg/L	1.0	1	AL25211	12/28/22 09:00	12/28/22 15:30	1551	SM2540D	
Turbidity	ND	NTU	1.0	1	AL24810	12/22/22 14:00	12/22/22 15:20	2303	SM2130B	
Bicarbonate Alkalinity as CaCO3	180	mg/L	5.0	1	AL25040	12/23/22 08:00	12/23/22 10:14	2303	SM2320B	
Carbonate Alkalinity as CaCO3	ND	mg/L	5.0	1	AL25040	12/23/22 08:00	12/23/22 10:14	2303	SM2320B	
Hydroxide Alkalinity as CaCO3	ND	mg/L	5.0	1	AL25040	12/23/22 08:00	12/23/22 10:14	2303	SM2320B	
Hardness, Total	175	mg/L	1	1	AL25017	12/23/22 06:45	12/23/22 09:07	2303	SM2340B	
Anions by EPA Method 300.0										
Nitrate as N	ND	mg/L	0.40	1	AL24984	12/22/22 17:00	12/22/22 19:34	2303	EPA 300.0	
Sulfate as SO4	24	mg/L	0.50	1	AL24984	12/22/22 17:00	12/22/22 19:34	2303	EPA 300.0	



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Groundwater
Project Number: [none]

Reported:
01/11/23 07:24

Metals by EPA 200 Series Methods - Quality Control

Analyte(s)	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Flag
Batch AL25014 - NB EPA 200 series										
Blank (AL25014-BLK1)				Prepared: 12/23/22 Analyzed: 12/27/22						
Arsenic	ND	2.0	ug/L							
LCS (AL25014-BS1)				Prepared: 12/23/22 Analyzed: 12/27/22						
Arsenic	9.42	2.0	ug/L	10.0		94.2	85-115			
LCS Dup (AL25014-BSD1)				Prepared: 12/23/22 Analyzed: 12/27/22						
Arsenic	9.99	2.0	ug/L	10.0		99.9	85-115	5.87	20	
Duplicate (AL25014-DUP1)				Source: 22L3449-01 Prepared: 12/23/22 Analyzed: 12/27/22						
Arsenic	5.40	2.0	ug/L		4.48			18.6	20	
MRL Check (AL25014-MRL1)				Prepared: 12/23/22 Analyzed: 12/27/22						
Arsenic	1.75	2.0	ug/L	2.00		87.5	0-200			
Matrix Spike (AL25014-MS1)				Source: 22L3457-01 Prepared: 12/23/22 Analyzed: 12/27/22						
Arsenic	29.6	2.0	ug/L	10.0	20.4	91.9	70-130			
Batch AL25017 - NB EPA 200 series DA										
Blank (AL25017-BLK1)				Prepared & Analyzed: 12/23/22						
Boron	ND	0.10	mg/L							
Calcium	ND	5.0	mg/L							
Copper	ND	0.050	mg/L							
Iron	ND	0.10	mg/L							
Lead	ND	0.020	mg/L							
Magnesium	ND	0.60	mg/L							
Manganese	ND	0.020	mg/L							
Sodium	ND	6.0	mg/L							
Zinc	ND	0.30	mg/L							



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Groundwater
Project Number: [none]

Reported:
01/11/23 07:24

Metals by EPA 200 Series Methods - Quality Control

Analyte(s)	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Flag
Batch AL25017 - NB EPA 200 series DA										
LCS (AL25017-BS1)				Prepared & Analyzed: 12/23/22						
Boron	0.465	0.10	mg/L	0.500		93.0	85-115			
Calcium	23.4	5.0	mg/L	25.5		91.8	85-115			
Copper	0.464	0.050	mg/L	0.500		92.9	85-115			
Iron	0.498	0.10	mg/L	0.500		99.6	85-115			
Lead	0.444	0.020	mg/L	0.500		88.8	85-115			
Magnesium	23.7	0.60	mg/L	25.5		92.8	85-115			
Manganese	0.488	0.020	mg/L	0.500		97.6	85-115			
Sodium	23.8	6.0	mg/L	25.5		93.5	85-115			
Zinc	0.482	0.30	mg/L	0.500		96.4	85-115			
LCS Dup (AL25017-BSD1)				Prepared & Analyzed: 12/23/22						
Boron	0.464	0.10	mg/L	0.500		92.8	85-115	0.215	20	
Calcium	23.1	5.0	mg/L	25.5		90.5	85-115	1.41	20	
Copper	0.462	0.050	mg/L	0.500		92.5	85-115	0.453	20	
Iron	0.495	0.10	mg/L	0.500		99.0	85-115	0.584	20	
Lead	0.442	0.020	mg/L	0.500		88.4	85-115	0.429	20	
Magnesium	23.4	0.60	mg/L	25.5		91.7	85-115	1.22	20	
Manganese	0.486	0.020	mg/L	0.500		97.2	85-115	0.452	20	
Sodium	23.6	6.0	mg/L	25.5		92.4	85-115	1.22	20	
Zinc	0.480	0.30	mg/L	0.500		95.9	85-115	0.562	20	
Duplicate (AL25017-DUP1)				Source: 22L3436-04		Prepared & Analyzed: 12/23/22				
Boron	ND	0.10	mg/L		ND			0.582	20	
Calcium	11.3	5.0	mg/L		11.3			0.353	20	
Copper	ND	0.050	mg/L		ND				20	
Iron	ND	0.10	mg/L		ND				20	
Lead	ND	0.020	mg/L		ND				20	
Magnesium	5.90	0.60	mg/L		5.91			0.113	20	
Manganese	ND	0.020	mg/L		ND				20	
Sodium	ND	6.0	mg/L		ND			0.0881	20	
Zinc	ND	0.30	mg/L		ND				20	

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Groundwater
Project Number: [none]

Reported:
01/11/23 07:24

Metals by EPA 200 Series Methods - Quality Control

Analyte(s)	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Flag
Batch AL25017 - NB EPA 200 series DA										
MRL Check (AL25017-MRL1)				Prepared & Analyzed: 12/23/22						
Boron	0.0900	0.10	mg/L	0.100		90.0	0-200			
Calcium	4.65	5.0	mg/L	5.00		92.9	0-200			
Copper	0.0457	0.050	mg/L	0.0500		91.4	0-200			
Iron	0.0945	0.10	mg/L	0.100		94.5	0-200			
Magnesium	0.469	0.60	mg/L	0.500		93.8	0-200			
Manganese	0.0197	0.020	mg/L	0.0200		98.5	0-200			
Sodium	4.74	6.0	mg/L	5.00		94.9	0-200			
Zinc	ND	0.30	mg/L	0.0500			0-200			
MRL Check (AL25017-MRL2)				Prepared & Analyzed: 12/23/22						
Copper	0.0445	0.050	mg/L	0.0500		89.0	0-200			
Lead	0.0187	0.020	mg/L	0.0200		93.5	0-200			
Zinc	0.300	0.30	mg/L	0.300		100	0-200			
Matrix Spike (AL25017-MS1)				Source: 22L3436-05		Prepared & Analyzed: 12/23/22				
Boron	0.563	0.10	mg/L	0.500	ND	95.1	70-130			
Copper	0.472	0.050	mg/L	0.500	ND	94.4	70-130			
Iron	0.534	0.10	mg/L	0.500	ND	107	70-130			
Lead	0.448	0.020	mg/L	0.500	ND	89.7	70-130			
Manganese	0.493	0.020	mg/L	0.500	ND	98.6	70-130			
Sodium	28.8	6.0	mg/L	25.5	ND	93.5	70-130			
Zinc	0.480	0.30	mg/L	0.500	ND	96.1	70-130			



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Groundwater
Project Number: [none]

Reported:
01/11/23 07:24

Conventional Chemistry Parameters by APHA/EPA Methods - Quality Control

Analyte(s)	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Flag
Batch AL24981 - NB General Prep										
Duplicate (AL24981-DUP1)		Source: 22L3442-02		Prepared & Analyzed: 12/22/22						
Specific Conductance (EC)	392	10	umhos/cm		390			0.512	5	
pH	7.63	1.00	pH Units		7.63			0.00	20	
Batch AL25017 - NB EPA 200 series DA										
Blank (AL25017-BLK1)		Prepared & Analyzed: 12/23/22								
Hardness, Total	ND	1	mg/L							
Duplicate (AL25017-DUP1)		Source: 22L3436-04		Prepared & Analyzed: 12/23/22						
Hardness, Total	53	1	mg/L		53			0.137	20	
Batch AL25040 - NB General Prep										
Blank (AL25040-BLK1)		Prepared & Analyzed: 12/23/22								
Total Alkalinity as CaCO ₃	ND	5.0	mg/L							
Bicarbonate Alkalinity as CaCO ₃	ND	5.0	mg/L							
Carbonate Alkalinity as CaCO ₃	ND	5.0	mg/L							
Hydroxide Alkalinity as CaCO ₃	ND	5.0	mg/L							
LCS (AL25040-BS1)		Prepared & Analyzed: 12/23/22								
Total Alkalinity as CaCO ₃	1000	5.0	mg/L	1000		100	80-120			
Duplicate (AL25040-DUP1)		Source: 22L3436-01		Prepared & Analyzed: 12/23/22						
Total Alkalinity as CaCO ₃	140	5.0	mg/L		140			0.358	20	
Bicarbonate Alkalinity as CaCO ₃	140	5.0	mg/L		139			0.373	20	
Carbonate Alkalinity as CaCO ₃	ND	5.0	mg/L		ND				20	
Hydroxide Alkalinity as CaCO ₃	ND	5.0	mg/L		ND				20	



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Groundwater
Project Number: [none]

Reported:
01/11/23 07:24

Conventional Chemistry Parameters by APHA/EPA Methods - Quality Control

Analyte(s)	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Flag
Batch AL25211 - General Preparation										
Blank (AL25211-BLK1)				Prepared & Analyzed: 12/28/22						
Total Suspended Solids	ND	1.0	mg/L							
Duplicate (AL25211-DUP1)				Source: 22L3330-01 Prepared & Analyzed: 12/28/22						
Total Suspended Solids	151	1.0	mg/L		151			0.00	30	
Duplicate (AL25211-DUP2)				Source: 22L3498-02 Prepared & Analyzed: 12/28/22						
Total Suspended Solids	173	1.0	mg/L		163			5.94	30	



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Groundwater
Project Number: [none]

Reported:
01/11/23 07:24

Anions by EPA Method 300.0 - Quality Control

Analyte(s)	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Flag
Batch AL24984 - NB General Prep										
Blank (AL24984-BLK1)				Prepared & Analyzed: 12/22/22						
Nitrate as N	ND	0.40	mg/L							
Sulfate as SO4	ND	0.50	mg/L							
LCS (AL24984-BS1)				Prepared & Analyzed: 12/22/22						
Sulfate as SO4	8.56	0.50	mg/L	8.00		107	90-110			
Nitrate as N	1.87	0.40	mg/L	1.80		104	90-110			
Duplicate (AL24984-DUP1)				Source: 22L3436-04		Prepared & Analyzed: 12/22/22				
Sulfate as SO4	5.24	0.50	mg/L		5.26			0.339	20	
Nitrate as N	ND	0.40	mg/L		ND				20	
MRL Check (AL24984-MRL1)				Prepared & Analyzed: 12/22/22						
Nitrate as N	0.311	0.40	mg/L	0.361		86.1	60-140			
Sulfate as SO4	1.68	0.50	mg/L	1.60		105	60-140			
Matrix Spike (AL24984-MS1)				Source: 22L3453-01		Prepared & Analyzed: 12/22/22				
Nitrate as N	1.90	0.40	mg/L	1.80	ND	105	80-120			
Sulfate as SO4	16.5	0.50	mg/L	8.00	7.99	106	80-120			
Matrix Spike (AL24984-MS2)				Source: 22L3436-02		Prepared & Analyzed: 12/22/22				
Nitrate as N	1.94	0.40	mg/L	1.80	ND	107	80-120			
Sulfate as SO4	14.0	0.50	mg/L	8.00	5.26	109	80-120			
Matrix Spike Dup (AL24984-MSD1)				Source: 22L3453-01		Prepared & Analyzed: 12/22/22				
Nitrate as N	1.91	0.40	mg/L	1.80	ND	106	80-120	0.694	20	
Sulfate as SO4	16.5	0.50	mg/L	8.00	7.99	107	80-120	0.374	20	



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Groundwater
Project Number: [none]

Reported:
01/11/23 07:24

Notes and Definitions

- T-14 Residual chlorine, dissolved oxygen, sulfite, and pH must be analyzed in the field to meet the EPA specified 15 minute hold time.
- ND Analyte NOT DETECTED at or above the reporting limit
- dry Sample results reported on a dry weight basis
- REC Recovery
- RPD Relative Percent Difference

Non-accredited analytes are reported only when ELAP accreditation for a requested analyte method pair is not available. For a list of accredited analytes, view our certificates at the Company link on our website at www.alpha-labs.com or contact your Project Manager directly.

[illegible]



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

11 January 2023

Bottle Rock Power

Attn: M. Moore

4010 Stone Way North, Suite 400

Seattle, WA 98103

RE: Surface Water

Work Order: 22L3436

Enclosed are the results of analyses for samples received by the laboratory on 12/22/22 12:45. If you have any questions concerning this report, please feel free to contact me.

Sincerely,

Stephen F. McWeeney

Project Manager



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Surface Water
Project Number: [none]

Reported:
01/11/23 07:21

Bay Area: 262 Rickenbacker Circle | Livermore, CA 94551 | 925-828-6226 | ELAP# 2728
Central Valley: 9090 Union Park Way Suite 113 | Elk Grove, CA 95624 | 916-686-5190 | ELAP# 2922
North Bay: 737 Southpoint Blvd Unit D | Petaluma, CA 94954 | 707-769-3128 | ELAP# 2303
San Diego: 2722 Loker Avenue West Suite A | Carlsbad, CA 92010 | 760-930-2555 | ELAP# 3055
Los Angeles: 1230 E. 223rd Street Suite 205 | Carson, CA 90745 | 424-267-5032 | Service Center

ANALYTICAL REPORT FOR SAMPLES

Sample ID	Laboratory ID	Matrix	Date Sampled	Date Received
SW-7	22L3436-01	Water	12/22/22 08:25	12/22/22 12:45
SW-9	22L3436-02	Water	12/22/22 09:10	12/22/22 12:45
SW-10	22L3436-03	Water	12/22/22 09:20	12/22/22 12:45
SW-8	22L3436-04	Water	12/22/22 10:10	12/22/22 12:45
SW-6	22L3436-05	Water	12/22/22 11:10	12/22/22 12:45



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Surface Water
Project Number: [none]

Reported:
01/11/23 07:21

	Result	Units	Reporting Limit	Dilution	Batch	Prepared	Analyzed	ELAP#	Method	Note
SW-7 (22L3436-01)			Sample Type: Water			Sampled: 12/22/22 08:25				
Metals by EPA 200 Series Methods										
Arsenic	ND	mg/L	0.020	1	AL25017	12/23/22 06:45	12/23/22 08:40	2303	EPA 200.7	
Boron	0.11	mg/L	0.10	1	AL25017	12/23/22 06:45	12/23/22 08:40	2303	EPA 200.7	
Calcium	20	mg/L	5.0	1	AL25017	12/23/22 06:45	12/23/22 08:40	2303	EPA 200.7	
Chromium	ND	mg/L	0.010	1	AL25017	12/23/22 06:45	12/23/22 08:40	2303	EPA 200.7	
Copper	ND	mg/L	0.050	1	AL25017	12/23/22 06:45	12/23/22 08:40	2303	EPA 200.7	
Iron	ND	mg/L	0.10	1	AL25017	12/23/22 06:45	12/23/22 08:40	2303	EPA 200.7	
Lead	ND	mg/L	0.020	1	AL25017	12/23/22 06:45	12/23/22 08:40	2303	EPA 200.7	
Magnesium	22	mg/L	0.60	1	AL25017	12/23/22 06:45	12/23/22 08:40	2303	EPA 200.7	
Manganese	ND	mg/L	0.020	1	AL25017	12/23/22 06:45	12/23/22 08:40	2303	EPA 200.7	
Mercury	ND	ug/L	0.20	1	AA33399	01/05/23 05:47	01/05/23 13:28	1551	EPA 245.1	
Sodium	ND	mg/L	6.0	1	AL25017	12/23/22 06:45	12/23/22 08:40	2303	EPA 200.7	
Vanadium	ND	mg/L	0.020	1	AL25017	12/23/22 06:45	12/23/22 08:40	2303	EPA 200.7	
Zinc	ND	mg/L	0.30	1	AL25017	12/23/22 06:45	12/23/22 08:40	2303	EPA 200.7	
Conventional Chemistry Parameters by APHA/EPA Methods										
Dissolved Oxygen	10	mg/L	0.10	1	AL25083	12/23/22 16:00	12/23/22 17:00	1551	SM4500-O G	T-14
pH	7.49	pH Units	1.00	1	AL24233	12/22/22 14:00	12/22/22 15:28	2303	SM4500-H+ B	T-14
Specific Conductance (EC)	290	umhos/cm	10	1	AL24233	12/22/22 14:00	12/22/22 15:28	2303	SM2510B	
Total Alkalinity as CaCO3	140	mg/L	5.0	1	AL25040	12/23/22 08:00	12/23/22 10:14	2303	SM2320B	
Total Suspended Solids	ND	mg/L	1.0	1	AL25211	12/28/22 09:00	12/28/22 15:30	1551	SM2540D	
Turbidity	ND	NTU	1.0	1	AL24810	12/22/22 14:00	12/22/22 15:20	2303	SM2130B	
Bicarbonate Alkalinity as CaCO3	140	mg/L	5.0	1	AL25040	12/23/22 08:00	12/23/22 10:14	2303	SM2320B	
Carbonate Alkalinity as CaCO3	ND	mg/L	5.0	1	AL25040	12/23/22 08:00	12/23/22 10:14	2303	SM2320B	
Hydroxide Alkalinity as CaCO3	ND	mg/L	5.0	1	AL25040	12/23/22 08:00	12/23/22 10:14	2303	SM2320B	
Hardness, Total	138	mg/L	1	1	AL25017	12/23/22 06:45	12/23/22 08:40	2303	SM2340B	



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Surface Water
Project Number: [none]

Reported:
01/11/23 07:21

	Result	Units	Reporting Limit	Dilution	Batch	Prepared	Analyzed	ELAP#	Method	Note
SW-7 (22L3436-01)										
Sample Type: Water					Sampled: 12/22/22 08:25					
Anions by EPA Method 300.0										
Sulfate as SO4	14	mg/L	0.50	1	AL24984	12/22/22 17:00	12/22/22 19:58	2303	EPA 300.0	
Microbiological Parameters by APHA Standard Methods										
Total Coliforms	180	MPN/100mL	1.0	1	AL24999	12/22/22 15:50	12/23/22 16:35	2303	SM9223B	
E. Coli	4.1	MPN/100mL	1.0	1	AL24999	12/22/22 15:50	12/23/22 16:35	2303	SM9223B	
SW-9 (22L3436-02)										
Sample Type: Water					Sampled: 12/22/22 09:10					
Metals by EPA 200 Series Methods										
Arsenic	ND	mg/L	0.020	1	AL25017	12/23/22 06:45	12/23/22 08:43	2303	EPA 200.7	
Boron	ND	mg/L	0.10	1	AL25017	12/23/22 06:45	12/23/22 08:43	2303	EPA 200.7	
Calcium	12	mg/L	5.0	1	AL25017	12/23/22 06:45	12/23/22 08:43	2303	EPA 200.7	
Chromium	ND	mg/L	0.010	1	AL25017	12/23/22 06:45	12/23/22 08:43	2303	EPA 200.7	
Copper	ND	mg/L	0.050	1	AL25017	12/23/22 06:45	12/23/22 08:43	2303	EPA 200.7	
Iron	ND	mg/L	0.10	1	AL25017	12/23/22 06:45	12/23/22 08:43	2303	EPA 200.7	
Lead	ND	mg/L	0.020	1	AL25017	12/23/22 06:45	12/23/22 08:43	2303	EPA 200.7	
Magnesium	6.0	mg/L	0.60	1	AL25017	12/23/22 06:45	12/23/22 08:43	2303	EPA 200.7	
Manganese	ND	mg/L	0.020	1	AL25017	12/23/22 06:45	12/23/22 08:43	2303	EPA 200.7	
Mercury	ND	ug/L	0.20	1	AA33399	01/05/23 05:47	01/05/23 13:31	1551	EPA 245.1	
Sodium	ND	mg/L	6.0	1	AL25017	12/23/22 06:45	12/23/22 08:43	2303	EPA 200.7	
Vanadium	ND	mg/L	0.020	1	AL25017	12/23/22 06:45	12/23/22 08:43	2303	EPA 200.7	
Zinc	ND	mg/L	0.30	1	AL25017	12/23/22 06:45	12/23/22 08:43	2303	EPA 200.7	



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Surface Water
Project Number: [none]

Reported:
01/11/23 07:21

	Result	Units	Reporting Limit	Dilution	Batch	Prepared	Analyzed	ELAP#	Method	Note
SW-9 (22L3436-02)			Sample Type: Water			Sampled: 12/22/22 09:10				
Conventional Chemistry Parameters by APHA/EPA Methods										
Dissolved Oxygen	11	mg/L	0.10	1	AL25083	12/23/22 16:00	12/23/22 17:00	1551	SM4500-O G	T-14
pH	7.38	pH Units	1.00	1	AL24233	12/22/22 14:00	12/22/22 15:28	2303	SM4500-H+ B	T-14
Specific Conductance (EC)	140	umhos/cm	10	1	AL24233	12/22/22 14:00	12/22/22 15:28	2303	SM2510B	
Total Alkalinity as CaCO3	64	mg/L	5.0	1	AL25040	12/23/22 08:00	12/23/22 10:14	2303	SM2320B	
Total Suspended Solids	ND	mg/L	1.0	1	AL25211	12/28/22 09:00	12/28/22 15:30	1551	SM2540D	
Turbidity	ND	NTU	1.0	1	AL24810	12/22/22 14:00	12/22/22 15:20	2303	SM2130B	
Bicarbonate Alkalinity as CaCO3	64	mg/L	5.0	1	AL25040	12/23/22 08:00	12/23/22 10:14	2303	SM2320B	
Carbonate Alkalinity as CaCO3	ND	mg/L	5.0	1	AL25040	12/23/22 08:00	12/23/22 10:14	2303	SM2320B	
Hydroxide Alkalinity as CaCO3	ND	mg/L	5.0	1	AL25040	12/23/22 08:00	12/23/22 10:14	2303	SM2320B	
Hardness, Total	54	mg/L	1	1	AL25017	12/23/22 06:45	12/23/22 08:43	2303	SM2340B	
Anions by EPA Method 300.0										
Sulfate as SO4	5.3	mg/L	0.50	1	AL24984	12/22/22 17:00	12/22/22 20:10	2303	EPA 300.0	
Microbiological Parameters by APHA Standard Methods										
Total Coliforms	610	MPN/100mL	1.0	1	AL24999	12/22/22 15:50	12/23/22 16:35	2303	SM9223B	
E. Coli	4.1	MPN/100mL	1.0	1	AL24999	12/22/22 15:50	12/23/22 16:35	2303	SM9223B	
SW-10 (22L3436-03)			Sample Type: Water			Sampled: 12/22/22 09:20				
Metals by EPA 200 Series Methods										
Arsenic	ND	mg/L	0.020	1	AL25017	12/23/22 06:45	12/23/22 08:46	2303	EPA 200.7	
Boron	0.11	mg/L	0.10	1	AL25017	12/23/22 06:45	12/23/22 08:46	2303	EPA 200.7	
Calcium	19	mg/L	5.0	1	AL25017	12/23/22 06:45	12/23/22 08:46	2303	EPA 200.7	
Chromium	ND	mg/L	0.010	1	AL25017	12/23/22 06:45	12/23/22 08:46	2303	EPA 200.7	
Copper	ND	mg/L	0.050	1	AL25017	12/23/22 06:45	12/23/22 08:46	2303	EPA 200.7	
Iron	ND	mg/L	0.10	1	AL25017	12/23/22 06:45	12/23/22 08:46	2303	EPA 200.7	
Lead	ND	mg/L	0.020	1	AL25017	12/23/22 06:45	12/23/22 08:46	2303	EPA 200.7	
Magnesium	21	mg/L	0.60	1	AL25017	12/23/22 06:45	12/23/22 08:46	2303	EPA 200.7	
Manganese	ND	mg/L	0.020	1	AL25017	12/23/22 06:45	12/23/22 08:46	2303	EPA 200.7	
Mercury	ND	ug/L	0.20	1	AA33399	01/05/23 05:47	01/05/23 13:34	1551	EPA 245.1	
Sodium	ND	mg/L	6.0	1	AL25017	12/23/22 06:45	12/23/22 08:46	2303	EPA 200.7	
Vanadium	ND	mg/L	0.020	1	AL25017	12/23/22 06:45	12/23/22 08:46	2303	EPA 200.7	
Zinc	ND	mg/L	0.30	1	AL25017	12/23/22 06:45	12/23/22 08:46	2303	EPA 200.7	

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Surface Water
Project Number: [none]

Reported:
01/11/23 07:21

	Result	Units	Reporting Limit	Dilution	Batch	Prepared	Analyzed	ELAP#	Method	Note
SW-10 (22L3436-03)										
Sample Type: Water					Sampled: 12/22/22 09:20					
Conventional Chemistry Parameters by APHA/EPA Methods										
Dissolved Oxygen	10	mg/L	0.10	1	AL25083	12/23/22 16:00	12/23/22 17:00	1551	SM4500-O G	T-14
pH	7.52	pH Units	1.00	1	AL24233	12/22/22 14:00	12/22/22 15:28	2303	SM4500-H+ B	T-14
Specific Conductance (EC)	290	umhos/cm	10	1	AL24233	12/22/22 14:00	12/22/22 15:28	2303	SM2510B	
Total Alkalinity as CaCO3	140	mg/L	5.0	1	AL25040	12/23/22 08:00	12/23/22 10:14	2303	SM2320B	
Total Suspended Solids	ND	mg/L	1.0	1	AL25211	12/28/22 09:00	12/28/22 15:30	1551	SM2540D	
Turbidity	ND	NTU	1.0	1	AL24810	12/22/22 14:00	12/22/22 15:20	2303	SM2130B	
Bicarbonate Alkalinity as CaCO3	140	mg/L	5.0	1	AL25040	12/23/22 08:00	12/23/22 10:14	2303	SM2320B	
Carbonate Alkalinity as CaCO3	ND	mg/L	5.0	1	AL25040	12/23/22 08:00	12/23/22 10:14	2303	SM2320B	
Hydroxide Alkalinity as CaCO3	ND	mg/L	5.0	1	AL25040	12/23/22 08:00	12/23/22 10:14	2303	SM2320B	
Hardness, Total	136	mg/L	1	1	AL25017	12/23/22 06:45	12/23/22 08:46	2303	SM2340B	
Anions by EPA Method 300.0										
Sulfate as SO4	14	mg/L	0.50	1	AL24984	12/22/22 17:00	12/22/22 20:22	2303	EPA 300.0	
Microbiological Parameters by APHA Standard Methods										
Total Coliforms	260	MPN/100mL	1.0	1	AL24999	12/22/22 15:50	12/23/22 16:35	2303	SM9223B	
E. Coli	8.5	MPN/100mL	1.0	1	AL24999	12/22/22 15:50	12/23/22 16:35	2303	SM9223B	
SW-8 (22L3436-04)										
Sample Type: Water					Sampled: 12/22/22 10:10					
Metals by EPA 200 Series Methods										
Arsenic	ND	mg/L	0.020	1	AL25017	12/23/22 06:45	12/23/22 08:49	2303	EPA 200.7	
Boron	ND	mg/L	0.10	1	AL25017	12/23/22 06:45	12/23/22 08:49	2303	EPA 200.7	
Calcium	11	mg/L	5.0	1	AL25017	12/23/22 06:45	12/23/22 08:49	2303	EPA 200.7	
Chromium	ND	mg/L	0.010	1	AL25017	12/23/22 06:45	12/23/22 08:49	2303	EPA 200.7	
Copper	ND	mg/L	0.050	1	AL25017	12/23/22 06:45	12/23/22 08:49	2303	EPA 200.7	
Iron	ND	mg/L	0.10	1	AL25017	12/23/22 06:45	12/23/22 08:49	2303	EPA 200.7	
Lead	ND	mg/L	0.020	1	AL25017	12/23/22 06:45	12/23/22 08:49	2303	EPA 200.7	
Magnesium	5.9	mg/L	0.60	1	AL25017	12/23/22 06:45	12/23/22 08:49	2303	EPA 200.7	
Manganese	ND	mg/L	0.020	1	AL25017	12/23/22 06:45	12/23/22 08:49	2303	EPA 200.7	
Mercury	ND	ug/L	0.20	1	AA33399	01/05/23 05:47	01/05/23 13:36	1551	EPA 245.1	
Sodium	ND	mg/L	6.0	1	AL25017	12/23/22 06:45	12/23/22 08:49	2303	EPA 200.7	
Vanadium	ND	mg/L	0.020	1	AL25017	12/23/22 06:45	12/23/22 08:49	2303	EPA 200.7	
Zinc	ND	mg/L	0.30	1	AL25017	12/23/22 06:45	12/23/22 08:49	2303	EPA 200.7	

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Surface Water
Project Number: [none]

Reported:
01/11/23 07:21

	Result	Units	Reporting Limit	Dilution	Batch	Prepared	Analyzed	ELAP#	Method	Note
SW-8 (22L3436-04)										
Sample Type: Water					Sampled: 12/22/22 10:10					
Conventional Chemistry Parameters by APHA/EPA Methods										
Dissolved Oxygen	10	mg/L	0.10	1	AL25083	12/23/22 16:00	12/23/22 17:00	1551	SM4500-O G	T-14
pH	7.47	pH Units	1.00	1	AL24233	12/22/22 14:00	12/22/22 15:28	2303	SM4500-H+ B	T-14
Specific Conductance (EC)	140	umhos/cm	10	1	AL24233	12/22/22 14:00	12/22/22 15:28	2303	SM2510B	
Total Alkalinity as CaCO3	60	mg/L	5.0	1	AL25040	12/23/22 08:00	12/23/22 10:14	2303	SM2320B	
Total Suspended Solids	ND	mg/L	1.0	1	AL25211	12/28/22 09:00	12/28/22 15:30	1551	SM2540D	
Turbidity	ND	NTU	1.0	1	AL24810	12/22/22 14:00	12/22/22 15:20	2303	SM2130B	
Bicarbonate Alkalinity as CaCO3	60	mg/L	5.0	1	AL25040	12/23/22 08:00	12/23/22 10:14	2303	SM2320B	
Carbonate Alkalinity as CaCO3	ND	mg/L	5.0	1	AL25040	12/23/22 08:00	12/23/22 10:14	2303	SM2320B	
Hydroxide Alkalinity as CaCO3	ND	mg/L	5.0	1	AL25040	12/23/22 08:00	12/23/22 10:14	2303	SM2320B	
Hardness, Total	53	mg/L	1	1	AL25017	12/23/22 06:45	12/23/22 08:49	2303	SM2340B	
Anions by EPA Method 300.0										
Sulfate as SO4	5.3	mg/L	0.50	1	AL24984	12/22/22 17:00	12/22/22 20:34	2303	EPA 300.0	
Microbiological Parameters by APHA Standard Methods										
Total Coliforms	460	MPN/100mL	1.0	1	AL24999	12/22/22 15:50	12/23/22 16:35	2303	SM9223B	
E. Coli	2.0	MPN/100mL	1.0	1	AL24999	12/22/22 15:50	12/23/22 16:35	2303	SM9223B	
SW-6 (22L3436-05)										
Sample Type: Water					Sampled: 12/22/22 11:10					
Metals by EPA 200 Series Methods										
Arsenic	ND	mg/L	0.020	1	AL25017	12/23/22 06:45	12/23/22 08:52	2303	EPA 200.7	
Boron	ND	mg/L	0.10	1	AL25017	12/23/22 06:45	12/23/22 08:52	2303	EPA 200.7	
Calcium	11	mg/L	5.0	1	AL25017	12/23/22 06:45	12/23/22 08:52	2303	EPA 200.7	
Chromium	ND	mg/L	0.010	1	AL25017	12/23/22 06:45	12/23/22 08:52	2303	EPA 200.7	
Copper	ND	mg/L	0.050	1	AL25017	12/23/22 06:45	12/23/22 08:52	2303	EPA 200.7	
Iron	ND	mg/L	0.10	1	AL25017	12/23/22 06:45	12/23/22 08:52	2303	EPA 200.7	
Lead	ND	mg/L	0.020	1	AL25017	12/23/22 06:45	12/23/22 08:52	2303	EPA 200.7	
Magnesium	6.0	mg/L	0.60	1	AL25017	12/23/22 06:45	12/23/22 08:52	2303	EPA 200.7	
Manganese	ND	mg/L	0.020	1	AL25017	12/23/22 06:45	12/23/22 08:52	2303	EPA 200.7	
Mercury	ND	ug/L	0.20	1	AA33399	01/05/23 05:47	01/05/23 13:39	1551	EPA 245.1	
Sodium	ND	mg/L	6.0	1	AL25017	12/23/22 06:45	12/23/22 08:52	2303	EPA 200.7	
Vanadium	ND	mg/L	0.020	1	AL25017	12/23/22 06:45	12/23/22 08:52	2303	EPA 200.7	
Zinc	ND	mg/L	0.30	1	AL25017	12/23/22 06:45	12/23/22 08:52	2303	EPA 200.7	

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Surface Water
Project Number: [none]

Reported:
01/11/23 07:21

	Result	Units	Reporting Limit	Dilution	Batch	Prepared	Analyzed	ELAP#	Method	Note
SW-6 (22L3436-05)			Sample Type: Water			Sampled: 12/22/22 11:10				
Conventional Chemistry Parameters by APHA/EPA Methods										
Dissolved Oxygen	11	mg/L	0.10	1	AL25083	12/23/22 16:00	12/23/22 17:00	1551	SM4500-O G	T-14
pH	7.46	pH Units	1.00	1	AL24233	12/22/22 14:00	12/22/22 15:28	2303	SM4500-H+ B	T-14
Specific Conductance (EC)	140	umhos/cm	10	1	AL24233	12/22/22 14:00	12/22/22 15:28	2303	SM2510B	
Total Alkalinity as CaCO3	64	mg/L	5.0	1	AL25040	12/23/22 08:00	12/23/22 10:14	2303	SM2320B	
Total Suspended Solids	ND	mg/L	1.0	1	AL25211	12/28/22 09:00	12/28/22 15:30	1551	SM2540D	
Turbidity	ND	NTU	1.0	1	AL24810	12/22/22 14:00	12/22/22 15:20	2303	SM2130B	
Bicarbonate Alkalinity as CaCO3	64	mg/L	5.0	1	AL25040	12/23/22 08:00	12/23/22 10:14	2303	SM2320B	
Carbonate Alkalinity as CaCO3	ND	mg/L	5.0	1	AL25040	12/23/22 08:00	12/23/22 10:14	2303	SM2320B	
Hydroxide Alkalinity as CaCO3	ND	mg/L	5.0	1	AL25040	12/23/22 08:00	12/23/22 10:14	2303	SM2320B	
Hardness, Total	53	mg/L	1	1	AL25017	12/23/22 06:45	12/23/22 08:52	2303	SM2340B	
Anions by EPA Method 300.0										
Sulfate as SO4	5.3	mg/L	0.50	1	AL24984	12/22/22 17:00	12/22/22 20:46	2303	EPA 300.0	
Microbiological Parameters by APHA Standard Methods										
Total Coliforms	650	MPN/100mL	1.0	1	AL24999	12/22/22 15:50	12/23/22 16:35	2303	SM9223B	
E. Coli	4.1	MPN/100mL	1.0	1	AL24999	12/22/22 15:50	12/23/22 16:35	2303	SM9223B	



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Surface Water
Project Number: [none]

Reported:
01/11/23 07:21

Metals by EPA 200 Series Methods - Quality Control

Analyte(s)	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Flag
Batch AA33399 - Hg Digest										
Blank (AA33399-BLK1)				Prepared & Analyzed: 01/05/23						
Mercury	ND	0.20	ug/L							
LCS (AA33399-BS1)				Prepared & Analyzed: 01/05/23						
Mercury	2.46	0.20	ug/L	2.50		98.2	85-115			
Duplicate (AA33399-DUP1)				Source: 22L4065-01			Prepared & Analyzed: 01/05/23			
Mercury	ND	0.20	ug/L		ND				20	
Matrix Spike (AA33399-MS1)				Source: 22L4065-01			Prepared & Analyzed: 01/05/23			
Mercury	2.49	0.20	ug/L	2.50	ND	99.7	70-130			
Matrix Spike (AA33399-MS2)				Source: 22L4050-01			Prepared & Analyzed: 01/05/23			
Mercury	2.28	0.20	ug/L	2.50	ND	91.4	70-130			
Matrix Spike Dup (AA33399-MSD1)				Source: 22L4065-01			Prepared & Analyzed: 01/05/23			
Mercury	2.48	0.20	ug/L	2.50	ND	99.3	70-130	0.402	20	
Batch AL25017 - NB EPA 200 series DA										
Blank (AL25017-BLK1)				Prepared & Analyzed: 12/23/22						
Arsenic	ND	0.020	mg/L							
Boron	ND	0.10	mg/L							
Calcium	ND	5.0	mg/L							
Chromium	ND	0.010	mg/L							
Copper	ND	0.050	mg/L							
Iron	ND	0.10	mg/L							
Lead	ND	0.020	mg/L							
Magnesium	ND	0.60	mg/L							
Manganese	ND	0.020	mg/L							
Sodium	ND	6.0	mg/L							
Vanadium	ND	0.020	mg/L							
Zinc	ND	0.30	mg/L							

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Surface Water
Project Number: [none]

Reported:
01/11/23 07:21

Metals by EPA 200 Series Methods - Quality Control

Analyte(s)	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Flag
Batch AL25017 - NB EPA 200 series DA										
LCS (AL25017-BS1)				Prepared & Analyzed: 12/23/22						
Arsenic	0.480	0.020	mg/L	0.500		96.0	85-115			
Boron	0.465	0.10	mg/L	0.500		93.0	85-115			
Calcium	23.4	5.0	mg/L	25.5		91.8	85-115			
Chromium	0.465	0.010	mg/L	0.500		93.0	85-115			
Copper	0.464	0.050	mg/L	0.500		92.9	85-115			
Iron	0.498	0.10	mg/L	0.500		99.6	85-115			
Lead	0.444	0.020	mg/L	0.500		88.8	85-115			
Magnesium	23.7	0.60	mg/L	25.5		92.8	85-115			
Manganese	0.488	0.020	mg/L	0.500		97.6	85-115			
Sodium	23.8	6.0	mg/L	25.5		93.5	85-115			
Vanadium	0.469	0.020	mg/L	0.500		93.7	85-115			
Zinc	0.482	0.30	mg/L	0.500		96.4	85-115			
LCS Dup (AL25017-BSD1)				Prepared & Analyzed: 12/23/22						
Arsenic	0.479	0.020	mg/L	0.500		95.8	85-115	0.250	20	
Boron	0.464	0.10	mg/L	0.500		92.8	85-115	0.215	20	
Calcium	23.1	5.0	mg/L	25.5		90.5	85-115	1.41	20	
Chromium	0.462	0.010	mg/L	0.500		92.4	85-115	0.647	20	
Copper	0.462	0.050	mg/L	0.500		92.5	85-115	0.453	20	
Iron	0.495	0.10	mg/L	0.500		99.0	85-115	0.584	20	
Lead	0.442	0.020	mg/L	0.500		88.4	85-115	0.429	20	
Magnesium	23.4	0.60	mg/L	25.5		91.7	85-115	1.22	20	
Manganese	0.486	0.020	mg/L	0.500		97.2	85-115	0.452	20	
Sodium	23.6	6.0	mg/L	25.5		92.4	85-115	1.22	20	
Vanadium	0.466	0.020	mg/L	0.500		93.1	85-115	0.664	20	
Zinc	0.480	0.30	mg/L	0.500		95.9	85-115	0.562	20	
Duplicate (AL25017-DUP1)				Source: 22L3436-04		Prepared & Analyzed: 12/23/22				
Arsenic	ND	0.020	mg/L		ND			200	20	
Boron	ND	0.10	mg/L		ND			0.582	20	
Calcium	11.3	5.0	mg/L		11.3			0.353	20	
Chromium	ND	0.010	mg/L		ND				20	
Copper	ND	0.050	mg/L		ND				20	
Iron	ND	0.10	mg/L		ND				20	
Lead	ND	0.020	mg/L		ND				20	
Magnesium	5.90	0.60	mg/L		5.91			0.113	20	

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Surface Water
Project Number: [none]

Reported:
01/11/23 07:21

Metals by EPA 200 Series Methods - Quality Control

Analyte(s)	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Flag
Batch AL25017 - NB EPA 200 series DA										
Duplicate (AL25017-DUP1)		Source: 22L3436-04			Prepared & Analyzed: 12/23/22					
Manganese	ND	0.020	mg/L		ND				20	
Sodium	ND	6.0	mg/L		ND			0.0881	20	
Vanadium	ND	0.020	mg/L		ND				20	
Zinc	ND	0.30	mg/L		ND				20	
MRL Check (AL25017-MRL1)					Prepared & Analyzed: 12/23/22					
Boron	0.0900	0.10	mg/L	0.100		90.0	0-200			
Calcium	4.65	5.0	mg/L	5.00		92.9	0-200			
Copper	0.0457	0.050	mg/L	0.0500		91.4	0-200			
Iron	0.0945	0.10	mg/L	0.100		94.5	0-200			
Magnesium	0.469	0.60	mg/L	0.500		93.8	0-200			
Manganese	0.0197	0.020	mg/L	0.0200		98.5	0-200			
Sodium	4.74	6.0	mg/L	5.00		94.9	0-200			
Zinc	ND	0.30	mg/L	0.0500			0-200			
MRL Check (AL25017-MRL2)					Prepared & Analyzed: 12/23/22					
Arsenic	0.0191	0.020	mg/L	0.0200		95.5	0-200			
Chromium	0.00970	0.010	mg/L	0.0100		97.0	0-200			
Copper	0.0445	0.050	mg/L	0.0500		89.0	0-200			
Lead	0.0187	0.020	mg/L	0.0200		93.5	0-200			
Vanadium	0.0202	0.020	mg/L	0.0200		101	0-200			
Zinc	0.300	0.30	mg/L	0.300		100	0-200			
Matrix Spike (AL25017-MS1)		Source: 22L3436-05			Prepared & Analyzed: 12/23/22					
Arsenic	0.494	0.020	mg/L	0.500	ND	98.8	70-130			
Boron	0.563	0.10	mg/L	0.500	ND	95.1	70-130			
Chromium	0.469	0.010	mg/L	0.500	ND	93.8	70-130			
Copper	0.472	0.050	mg/L	0.500	ND	94.4	70-130			
Iron	0.534	0.10	mg/L	0.500	ND	107	70-130			
Lead	0.448	0.020	mg/L	0.500	ND	89.7	70-130			
Manganese	0.493	0.020	mg/L	0.500	ND	98.6	70-130			
Sodium	28.8	6.0	mg/L	25.5	ND	93.5	70-130			
Vanadium	0.475	0.020	mg/L	0.500	ND	94.9	70-130			
Zinc	0.480	0.30	mg/L	0.500	ND	96.1	70-130			

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Surface Water
Project Number: [none]

Reported:
01/11/23 07:21

Conventional Chemistry Parameters by APHA/EPA Methods - Quality Control

Analyte(s)	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Flag
------------	--------	--------------------	-------	----------------	------------------	------	----------------	-----	--------------	------

Batch AL24233 - NB General Prep

Duplicate (AL24233-DUP1)

Source: 22L2125-01

Prepared & Analyzed: 12/14/22

pH	6.03	1.00	pH Units		6.08			0.826	20	
Specific Conductance (EC)	15.8	10	umhos/cm		15.3			3.22	5	

Batch AL25017 - NB EPA 200 series DA

Blank (AL25017-BLK1)

Prepared & Analyzed: 12/23/22

Hardness, Total	ND	1	mg/L							
-----------------	----	---	------	--	--	--	--	--	--	--

Duplicate (AL25017-DUP1)

Source: 22L3436-04

Prepared & Analyzed: 12/23/22

Hardness, Total	53	1	mg/L		53			0.137	20	
-----------------	----	---	------	--	----	--	--	-------	----	--

Batch AL25040 - NB General Prep

Blank (AL25040-BLK1)

Prepared & Analyzed: 12/23/22

Total Alkalinity as CaCO ₃	ND	5.0	mg/L							
Bicarbonate Alkalinity as CaCO ₃	ND	5.0	mg/L							
Carbonate Alkalinity as CaCO ₃	ND	5.0	mg/L							
Hydroxide Alkalinity as CaCO ₃	ND	5.0	mg/L							

LCS (AL25040-BS1)

Prepared & Analyzed: 12/23/22

Total Alkalinity as CaCO ₃	1000	5.0	mg/L	1000	100	80-120				
---------------------------------------	------	-----	------	------	-----	--------	--	--	--	--

Duplicate (AL25040-DUP1)

Source: 22L3436-01

Prepared & Analyzed: 12/23/22

Total Alkalinity as CaCO ₃	140	5.0	mg/L		140			0.358	20	
Bicarbonate Alkalinity as CaCO ₃	140	5.0	mg/L		139			0.373	20	
Carbonate Alkalinity as CaCO ₃	ND	5.0	mg/L		ND				20	
Hydroxide Alkalinity as CaCO ₃	ND	5.0	mg/L		ND				20	



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Surface Water
Project Number: [none]

Reported:
01/11/23 07:21

Conventional Chemistry Parameters by APHA/EPA Methods - Quality Control

Analyte(s)	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Flag
Batch AL25083 - General Preparation										
Duplicate (AL25083-DUP1)		Source: 22L3470-01		Prepared & Analyzed: 12/23/22						
Dissolved Oxygen	10.4	0.10	mg/L		10.4			0.193	20	
Batch AL25211 - General Preparation										
Blank (AL25211-BLK1)		Prepared & Analyzed: 12/28/22								
Total Suspended Solids	ND	1.0	mg/L							
Duplicate (AL25211-DUP1)		Source: 22L3330-01		Prepared & Analyzed: 12/28/22						
Total Suspended Solids	151	1.0	mg/L		151			0.00	30	
Duplicate (AL25211-DUP2)		Source: 22L3498-02		Prepared & Analyzed: 12/28/22						
Total Suspended Solids	173	1.0	mg/L		163			5.94	30	



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Surface Water
Project Number: [none]

Reported:
01/11/23 07:21

Anions by EPA Method 300.0 - Quality Control

Analyte(s)	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Flag
Batch AL24984 - NB General Prep										
Blank (AL24984-BLK1)				Prepared & Analyzed: 12/22/22						
Sulfate as SO ₄	ND	0.50	mg/L							
LCS (AL24984-BS1)				Prepared & Analyzed: 12/22/22						
Sulfate as SO ₄	8.56	0.50	mg/L	8.00		107	90-110			
Duplicate (AL24984-DUP1)				Source: 22L3436-04		Prepared & Analyzed: 12/22/22				
Sulfate as SO ₄	5.24	0.50	mg/L		5.26			0.339	20	
MRL Check (AL24984-MRL1)				Prepared & Analyzed: 12/22/22						
Sulfate as SO ₄	1.68	0.50	mg/L	1.60		105	60-140			
Matrix Spike (AL24984-MS1)				Source: 22L3453-01		Prepared & Analyzed: 12/22/22				
Sulfate as SO ₄	16.5	0.50	mg/L	8.00	7.99	106	80-120			
Matrix Spike (AL24984-MS2)				Source: 22L3436-02		Prepared & Analyzed: 12/22/22				
Sulfate as SO ₄	14.0	0.50	mg/L	8.00	5.26	109	80-120			
Matrix Spike Dup (AL24984-MSD1)				Source: 22L3453-01		Prepared & Analyzed: 12/22/22				
Sulfate as SO ₄	16.5	0.50	mg/L	8.00	7.99	107	80-120	0.374	20	



Alpha Analytical Laboratories, Inc. email: clientservices@alpha-labs.com
Corporate: 208 Mason Street | Ukiah, CA 95482 | T: 707-468-0401 | F: 707-468-5267 | ELAP# 1551

Bottle Rock Power
4010 Stone Way North, Suite 400
Seattle, WA 98103

Project Manager: M. Moore
Project: Surface Water
Project Number: [none]

Reported:
01/11/23 07:21

Notes and Definitions

- T-14 Residual chlorine, dissolved oxygen, sulfite, and pH must be analyzed in the field to meet the EPA specified 15 minute hold time.
- ND Analyte NOT DETECTED at or above the reporting limit
- dry Sample results reported on a dry weight basis
- REC Recovery
- RPD Relative Percent Difference

Non-accredited analytes are reported only when ELAP accreditation for a requested analyte method pair is not available. For a list of accredited analytes, view our certificates at the Company link on our website at www.alpha-labs.com or contact your Project Manager directly.



Corporate Laboratory (1551)
208 Mason Street, Ukiah CA 95482
707.468.0401 (phone)
707.468.5267 (fax)
clientservices@alpha-labs.com

North Bay Laboratory (2303)
737 Southpoint Blvd, Ste D, Petaluma 94954

Bay Area Laboratory (2728)
262 Rickenbacker Circle, Livermore CA 94551

Central Valley Laboratory (2922)
9090 Union Park Way #113, Elk Grove CA 95624

San Diego Service Center
2722 Loker Ave West, Ste A, Carlsbad CA 92010

Chain of Custody - Work Order

Reports and Invoices delivered by email in PDF format

Lab No 22L3436 Pg of

Report to		Invoice to (if different)		Project Information		Signature below authorizes work under terms stated on reverse side.																																																																																																																																																																															
Company: Bottle Rock Power		Contact:		Project ID: Bottle Rock Monitoring-SW		<div style="display: flex; justify-content: space-between;"> <div style="writing-mode: vertical-rl; transform: rotate(180deg);">Total Number of Containers per Sample ID</div> <div> <table border="1" style="width:100%; border-collapse: collapse;"> <thead> <tr> <th colspan="14">Analysis Request</th> </tr> <tr> <th>ALK, Ph, ec</th> <th>Turbidity & TSS</th> <th>Hardness, SO4</th> <th>B, Cu, Fe & Pb</th> <th>Mn, Na & Zn</th> <th>Diss. Oxygen</th> <th>Bac-T</th> <th>As, Cr, V, Hg</th> <th>Field pH</th> <th>Field TDS ppm</th> </tr> </thead> <tbody> <tr><td>X</td><td>X</td><td>X</td><td>X</td><td>X</td><td>X</td><td>X</td><td>X</td><td>X</td><td>X</td></tr> <tr><td>X</td><td>X</td><td>X</td><td>X</td><td>X</td><td>X</td><td>X</td><td>X</td><td>X</td><td>X</td></tr> <tr><td>X</td><td>X</td><td>X</td><td>X</td><td>X</td><td>X</td><td>X</td><td>X</td><td>X</td><td>X</td></tr> <tr><td>X</td><td>X</td><td>X</td><td>X</td><td>X</td><td>X</td><td>X</td><td>X</td><td>X</td><td>X</td></tr> <tr><td>X</td><td>X</td><td>X</td><td>X</td><td>X</td><td>X</td><td>X</td><td>X</td><td>X</td><td>X</td></tr> </tbody> </table> </div> </div>														Analysis Request														ALK, Ph, ec	Turbidity & TSS	Hardness, SO4	B, Cu, Fe & Pb	Mn, Na & Zn	Diss. Oxygen	Bac-T	As, Cr, V, Hg	Field pH	Field TDS ppm	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X																																																																																								
Analysis Request																																																																																																																																																																																					
ALK, Ph, ec	Turbidity & TSS	Hardness, SO4	B, Cu, Fe & Pb	Mn, Na & Zn	Diss. Oxygen	Bac-T	As, Cr, V, Hg	Field pH	Field TDS ppm																																																																																																																																																																												
X	X	X	X	X	X	X	X	X	X																																																																																																																																																																												
X	X	X	X	X	X	X	X	X	X																																																																																																																																																																												
X	X	X	X	X	X	X	X	X	X																																																																																																																																																																												
X	X	X	X	X	X	X	X	X	X																																																																																																																																																																												
X	X	X	X	X	X	X	X	X	X																																																																																																																																																																												
Attn: <u>Jay Hepper</u> <u>Richard Lacy</u>		Email address:		Project No:		<div style="display: flex; justify-content: space-between;"> <div> <table border="1" style="width:100%; border-collapse: collapse;"> <thead> <tr> <th colspan="2">TAT</th> <th>TEMP °C</th> </tr> </thead> <tbody> <tr> <td>Standard 10 days</td> <td><input type="radio"/></td> <td>Ukiah</td> </tr> <tr> <td>RUSH: 5 days</td> <td><input type="radio"/></td> <td>Livermore</td> </tr> <tr> <td>48 hours</td> <td><input type="radio"/></td> <td>Elk Grove</td> </tr> <tr> <td>Other: ____ days</td> <td><input type="radio"/></td> <td>Petaluma</td> </tr> <tr> <td>Preapproval required</td> <td><input type="radio"/></td> <td>8-8 Carlsbad</td> </tr> </tbody> </table> </div> <div> <table border="1" style="width:100%; border-collapse: collapse;"> <thead> <tr> <th colspan="2">Notes / DDW Source Codes</th> </tr> </thead> <tbody> <tr><td> </td><td> </td></tr> <tr><td> </td><td> </td></tr> <tr><td> </td><td> </td></tr> <tr><td> </td><td> </td></tr> <tr><td> </td><td> </td></tr> <tr><td> </td><td> </td></tr> <tr><td> </td><td> </td></tr> <tr><td> </td><td> </td></tr> <tr><td> </td><td> </td></tr> <tr><td> </td><td> </td></tr> </tbody> </table> </div> </div>														TAT		TEMP °C	Standard 10 days	<input type="radio"/>	Ukiah	RUSH: 5 days	<input type="radio"/>	Livermore	48 hours	<input type="radio"/>	Elk Grove	Other: ____ days	<input type="radio"/>	Petaluma	Preapproval required	<input type="radio"/>	8-8 Carlsbad	Notes / DDW Source Codes																																																																																																																																															
TAT		TEMP °C																																																																																																																																																																																			
Standard 10 days	<input type="radio"/>	Ukiah																																																																																																																																																																																			
RUSH: 5 days	<input type="radio"/>	Livermore																																																																																																																																																																																			
48 hours	<input type="radio"/>	Elk Grove																																																																																																																																																																																			
Other: ____ days	<input type="radio"/>	Petaluma																																																																																																																																																																																			
Preapproval required	<input type="radio"/>	8-8 Carlsbad																																																																																																																																																																																			
Notes / DDW Source Codes																																																																																																																																																																																					
Address: PO Box 326 Cobb, CA 95426		Address:		PO Number:		<div style="display: flex; justify-content: space-between;"> <div> <table border="1" style="width:100%; border-collapse: collapse;"> <thead> <tr> <th colspan="2">Field Sampler - Printed Name & Signature: <u>Richard Lacy</u></th> <th colspan="4">Container</th> <th colspan="4">Preservative</th> <th colspan="4">Matrix</th> </tr> <tr> <th>40ml VOA Vial</th> <th>Plastic</th> <th>Glass</th> <th>Sleeve</th> <th>Other</th> <th>HCl</th> <th>HNO3</th> <th>H2SO4</th> <th>Other</th> <th>None</th> <th>Drinking Water</th> <th>Wastewater</th> <th>Soil</th> <th>Other</th> </tr> </thead> <tbody> <tr><td>X</td><td>X</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> <tr><td>X</td><td>X</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> <tr><td>X</td><td>X</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> <tr><td>X</td><td>X</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> <tr><td>X</td><td>X</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr> </tbody> </table> </div> <div> <table border="1" style="width:100%; border-collapse: collapse;"> <thead> <tr> <th colspan="2">Sample Identification</th> <th colspan="2">Sampling</th> </tr> <tr> <th> </th> <th> </th> <th>Date</th> <th>Time</th> </tr> </thead> <tbody> <tr><td>SW-7</td><td></td><td>12/22/22</td><td>8:25</td></tr> <tr><td>SW-9</td><td></td><td>12/22/22</td><td>9:10</td></tr> <tr><td>SW-10</td><td></td><td>12/22/22</td><td>9:20</td></tr> <tr><td>SW-8</td><td></td><td>12/22/22</td><td>10:10</td></tr> <tr><td>SW-6</td><td></td><td>12/22/22</td><td>11:50</td></tr> <tr><td> </td><td></td><td> </td><td> </td></tr> <tr><td> </td><td></td><td> </td><td> </td></tr> <tr><td> </td><td></td><td> </td><td> </td></tr> <tr><td> </td><td></td><td> </td><td> </td></tr> <tr><td> </td><td></td><td> </td><td> </td></tr> <tr><td> </td><td></td><td> </td><td> </td></tr> <tr><td> </td><td></td><td> </td><td> </td></tr> <tr><td> </td><td></td><td> </td><td> </td></tr> <tr><td> </td><td></td><td> </td><td> </td></tr> </tbody> </table> </div> </div>														Field Sampler - Printed Name & Signature: <u>Richard Lacy</u>		Container				Preservative				Matrix				40ml VOA Vial	Plastic	Glass	Sleeve	Other	HCl	HNO3	H2SO4	Other	None	Drinking Water	Wastewater	Soil	Other	X	X													X	X													X	X													X	X													X	X													Sample Identification		Sampling				Date	Time	SW-7		12/22/22	8:25	SW-9		12/22/22	9:10	SW-10		12/22/22	9:20	SW-8		12/22/22	10:10	SW-6		12/22/22	11:50																																				
Field Sampler - Printed Name & Signature: <u>Richard Lacy</u>		Container				Preservative				Matrix																																																																																																																																																																											
40ml VOA Vial	Plastic	Glass	Sleeve	Other	HCl	HNO3	H2SO4	Other	None	Drinking Water	Wastewater	Soil	Other																																																																																																																																																																								
X	X																																																																																																																																																																																				
X	X																																																																																																																																																																																				
X	X																																																																																																																																																																																				
X	X																																																																																																																																																																																				
X	X																																																																																																																																																																																				
Sample Identification		Sampling																																																																																																																																																																																			
		Date	Time																																																																																																																																																																																		
SW-7		12/22/22	8:25																																																																																																																																																																																		
SW-9		12/22/22	9:10																																																																																																																																																																																		
SW-10		12/22/22	9:20																																																																																																																																																																																		
SW-8		12/22/22	10:10																																																																																																																																																																																		
SW-6		12/22/22	11:50																																																																																																																																																																																		
Phone/Fax: 707-529-3799		Phone/Fax:				<div style="display: flex; justify-content: space-between;"> <div> <table border="1" style="width:100%; border-collapse: collapse;"> <thead> <tr> <th colspan="2">Relinquished by</th> <th colspan="2">Received by</th> <th>Date</th> <th>Time</th> </tr> </thead> <tbody> <tr> <td colspan="2"><u>Richard Lacy</u></td> <td colspan="2"><u>Along</u></td> <td>12/21/22</td> <td>1245</td> </tr> <tr><td colspan="2"> </td><td colspan="2"> </td><td> </td><td> </td></tr> <tr><td colspan="2"> </td><td colspan="2"> </td><td> </td><td> </td></tr> <tr><td colspan="2"> </td><td colspan="2"> </td><td> </td><td> </td></tr> <tr><td colspan="2"> </td><td colspan="2"> </td><td> </td><td> </td></tr> </tbody> </table> </div> <div> <table border="1" style="width:100%; border-collapse: collapse;"> <thead> <tr> <th colspan="2">DDW Write On EDT Transmission?</th> </tr> </thead> <tbody> <tr> <td><input type="radio"/> Yes <input type="radio"/> No</td> <td> </td> </tr> <tr> <td colspan="2">State System Number: _____</td> </tr> <tr> <td colspan="2">If "Y" please enter the Source Number(s) in the column above</td> </tr> <tr> <td colspan="2">CA Geotracker EDF Report? <input type="radio"/> Yes <input type="radio"/> No</td> </tr> <tr> <td>Global ID: _____</td> <td>Sampling Company Log Code: _____</td> </tr> <tr> <td>EDF to (Email Address): _____</td> <td> </td> </tr> <tr> <td>Travel and Site Time: _____</td> <td>Mileage: _____ Misc. Supplies: _____</td> </tr> </tbody> </table> </div> </div>														Relinquished by		Received by		Date	Time	<u>Richard Lacy</u>		<u>Along</u>		12/21/22	1245																									DDW Write On EDT Transmission?		<input type="radio"/> Yes <input type="radio"/> No		State System Number: _____		If "Y" please enter the Source Number(s) in the column above		CA Geotracker EDF Report? <input type="radio"/> Yes <input type="radio"/> No		Global ID: _____	Sampling Company Log Code: _____	EDF to (Email Address): _____		Travel and Site Time: _____	Mileage: _____ Misc. Supplies: _____																																																																																																														
Relinquished by		Received by		Date	Time																																																																																																																																																																																
<u>Richard Lacy</u>		<u>Along</u>		12/21/22	1245																																																																																																																																																																																
DDW Write On EDT Transmission?																																																																																																																																																																																					
<input type="radio"/> Yes <input type="radio"/> No																																																																																																																																																																																					
State System Number: _____																																																																																																																																																																																					
If "Y" please enter the Source Number(s) in the column above																																																																																																																																																																																					
CA Geotracker EDF Report? <input type="radio"/> Yes <input type="radio"/> No																																																																																																																																																																																					
Global ID: _____	Sampling Company Log Code: _____																																																																																																																																																																																				
EDF to (Email Address): _____																																																																																																																																																																																					
Travel and Site Time: _____	Mileage: _____ Misc. Supplies: _____																																																																																																																																																																																				