

DOCKETED

| | |
|-------------------------|---|
| Docket Number: | 17-BSTD-02 |
| Project Title: | 2019 Title 24, Part 6, Building Energy Efficiency Standards Rulemaking |
| TN #: | 223245-17 |
| Document Title: | 2019 Alternate Compliance Method (ACM) Approval Manual Appendix B Revised Express Terms |
| Description: | 2019 Alternate Compliance Method (ACM) Approval Manual Appendix B Revised Express Terms |
| Filer: | Peter Strait |
| Organization: | California Energy Commission |
| Submitter Role: | Commission Staff |
| Submission Date: | 4/20/2018 10:34:58 AM |
| Docketed Date: | 4/20/2018 |

APPENDIX B. NONRESIDENTIAL CERTIFICATION TESTS

This section contains the procedures used to test and certify vendor's Compliance Software as acceptable for compliance with Title 24 Part 6. Compliance software is expected to conform to the modeling guidelines specified in the Nonresidential ACM Reference Manual. The tests used to verify software functionality and accuracy of simulation results are referred to as the Reference Method. The tests fall into the following categories:

1. Tests to verify that the software is evaluating thermal loads and the response of the HVAC systems to these loads in a manner that is acceptable. These tests reference *ASHRAE Standard 140-2007, Standard Method of Test for Evaluation of Building Energy Analysis Computer Programs*.
2. Tests that verify that compliance software is capable of modeling envelope, lighting, HVAC and water heating efficiency features and provides precise estimates of energy tradeoffs and reasonably accurate predictions of building energy consumption.
3. Tests to verify that the Standard Design (baseline building) is created correctly, e.g. that the baseline HVAC system is properly specified, that other components of the baseline are correctly defined and that rules that fix and restrict inputs (such as schedules and plug loads) are properly applied. These tests do not verify simulation outputs, but may require simulations to be run to specify inputs that are dependent on system sizing.
4. The Reference Method is designed to cover vendor software functionality for building envelope, space uses, lighting, daylighting, HVAC and water heating, both for simulation performance and for proper implementation of ACM rules described in the Nonresidential ACM Reference manual. The California Energy Commission reserves the right to add Ruleset Implementation Tests or Software Sensitivity Tests to verify existing or future compliance software requirements. Moreover, the California Energy Commission reserves the right to adjust the passing criteria (see Test Criteria, Section 1.7) for the Software Sensitivity Tests to reflect the capabilities of commonly available energy simulation programs.

1.1 ASHRAE Standard 140-2007 Tests


This method of testing is provided for analyzing and diagnosing building energy simulation software using software-to-software and software-to-quasi-analytical-solution comparisons. The methodology allows different building energy simulation programs, representing different degrees of modeling complexity, to be tested by comparing the predictions from other building energy programs to the simulation results provided by the Compliance Software in question.

Vendor software must pass the ASHRAE 140-2007 tests and provide a written statement verifying this in the Self Certification Form (see Appendix B).

1.2 Ruleset Implementation Tests

The Ruleset Implementation Tests are labeled using the format:

(S) 0200CZ-OffSml- Run01

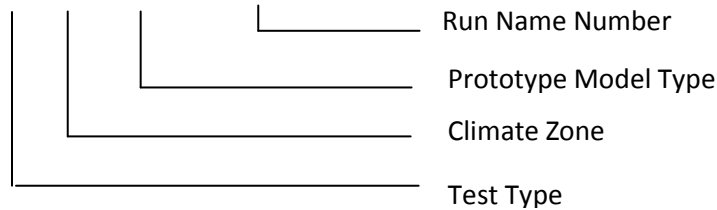

The following tests shall be performed to verify that the compliance software correctly creates the Standard Design model and applies modeling rules as per the modeling guidelines provided in the 2016 Nonresidential ACM Reference manual. The user model shall be created by modifying the appropriate Prototype Model type. The Standard Design Model for each test case shall be generated automatically by the compliance software.

The intent of each test run, characteristics of the user model and inputs to be verified in the Proposed and Standard Design models, are described below.

1. (D/S) 020006-OffSml-Run01– This test will verify that the applicant software models the wall, floor and roof construction correctly in the Standard Design model and that the envelope and fenestration performance requirements for the Standard Design are correctly modeled.
2. (D/S) 020015-OffSml-Run02– This test will verify that the applicant software models the wall, floor, roof construction and fenestrations correctly and that the envelope performance requirements for the Standard Design are correctly modeled.

The user model is a small office building in climate zone 15 with the following envelope characteristics:

3. (D) 070015-HotSml-Run03 – This test will verify that the applicant software models the wall, floor and roof construction correctly in the Standard Design model and that the envelope and fenestration performance requirements for the Standard Design are correctly modeled.

The user model is a small hotel building in climate zone 15 with the following characteristics:

4. (D/S) 030006-OffMed-Run04 – This test will verify that mandatory minimum opaque envelope insulation requirements are applied. The user model is a small office building in climate zone 6, with a metal-framed wall containing R-5 continuous insulation on the exterior and a U-factor of 0.136.
 - a. For this test, the user model should be **undefined**, and the compliance simulation should not run.

5. (D) 040006-OffLrg-Run05 – Run 05 tests whether the applicant software correctly determines the window area of the Standard Design model.

The user model is the Large office building in climate zone 6 with an overall window-to-wall ratio (WWR) of 52% made of a continuous band of glass distributed evenly across all facades.

6. (D) 040006-OffLrg-Run06 – Run 06 tests whether the applicant software correctly determines the window area of the Standard Design model.

The user model is the Large office building in climate zone 6 with overall building WWR-46% and 50% WWR in the west, 40% in South, 45% in East and 50% in the North façade.

7. (D) 080006-Whse-Run07 – This tests verifies whether the applicant software models the Standard Design skylight correctly, and checks whether the applicant software determines the skylight area of the Standard Design model correctly.
8. (D) 080006-Whse-Run08 – This test checks whether the applicant software determines the skylight area of the Standard Design model correctly.
9. (D) 080006-Whse-Run09 – This test checks whether the applicant software determines the skylight area of the Standard Design model correctly.
10. (D) 030006-OffMed-Run10 – This test verifies whether the applicant software inserts the correct Standard Design inputs for schedules, occupant density, equipment power density, lighting power density, hot water load and ventilation rates using the Complete Building lighting method.
11. (D) 040006-OffLrg-Run11 – This test verifies whether the applicant software inserts the correct Proposed Design and Standard Design inputs for schedules, occupant density, equipment power density, lighting power density, hot water load and ventilation rates. This run also tests the capability of the applicant software to model Standard Design inputs for multiple space types using the Area Category lighting method.
12. (D) 030006-OffMed-Run12 – This test verifies if the applicant software applies the requirements of the Tailored Lighting Method appropriately.
13. (D) 030006-OffMed-Run13 – This test verifies if the applicant software applies the requirements of the Tailored Lighting Method appropriately.
14. (D/S) 020006-OffSml-Run14 – This test verifies if the applicant software correctly models lighting power density and schedules for eligible California Power adjustment factors.
15. (D) 080006-Whse-Run15 – This test verifies the ability of the applicant software to correctly model daylighting controls.
16. (D) 050006-RetlMed-Run16 – This test verifies the ability of the applicant software to correctly model daylighting controls.

17. (D) 040006-OffLrg-Run17 – This test verifies if the rules for exterior lighting are applied accurately for exterior lighting power, exterior lighting control and schedules. This test also verifies if the Service Hot Water systems are modeled correctly.
18. (D/S) 020006-OffSml-Run18 – This test checks if the applicant software correctly models the Standard Design HVAC system.
19. (D) 030006-OffMed-Run19 – This test checks if the applicant software correctly models the Standard Design HVAC system.
20. (D) 040006-OffLrg-Run20 – This test checks if the applicant software correctly models the Standard Design HVAC system.
21. (D) 080006-Whse-Run21 – This test checks if the applicant software correctly models the Standard Design HVAC system.
22. (D) 07006-HotSml-Run22 – This test checks if the applicant software correctly models the Standard Design HVAC system.
23. (D) 030006-OffMed-Run23 – This test checks the Standard Design building for an existing, altered building that has the roof replaced with a metal building roof, R-15 continuous insulation, and that has the windows replaced on the South façade with low-e, double glazed windows with $U=0.40$, $SHGC=0.33$ and $VT=0.50$. The windows on the North, East and West facades are existing, unchanged single-paned windows with $U=0.55$, $SHGC=0.56$, $VT=0.6$.
24. (D) 020006-OffSml-Run24– This test checks the Standard Design building for an existing, altered building.
25. (D) 020006-OffSml-Run25– This test checks the Standard Design building for an existing, altered building.
26. (D) 020006-OffSml-Run26– This test checks the Standard Design building for an existing, altered building.
27. (D) 050006-RetlMed -Run27– This test checks the Standard Design building for an addition, modeled alone.
28. (D) 050006-RetlMed -Run28– This test checks the Standard Design building for an addition, modeled with existing, unaltered building.
29. (D) 030006-OffMed -Run29– This test checks the Standard Design building for an Envelope Only, partial compliance project.
30. (D) 020006-OffMed –Run30– This test checks the Standard Design building for a Lighting and Mechanical partial compliance project

1.2.1 Results Comparison

The applicant shall perform all tests specified in Section IV and report the outputs in their application. Forms for reporting this output are provided in the 2016 Nonresidential ACM Reference manual. Note that the Standard Design for some inputs, such as cooling efficiency and pump power, are dependent upon the autosizing of the HVAC equipment. The ruleset implementation tests do not check that the autosized capacity matches the Reference Method, but rather, that the Standard Design input is properly defined in relation to the autosized capacity.

1.3 Software Sensitivity Tests

This section details the eligibility requirements for an applicant simulation program to be approved for use as compliance software as specified in the 2016 ACM Approval Manual. A series of quantitative tests called the Software Sensitivity Tests shall be performed to measure the change in energy consumption when changing specified input parameters. Applicant software results will be compared against predetermined Reference results to demonstrate that the applicant software is acceptable for use in code compliance. There are a total of 96 tests. All the test cases described here shall be performed and results summarized in the approval application. Forms for providing this summary are provided in the 2016 Nonresidential ACM Reference Manual.

Each test case in the Software Sensitivity test is labeled uniquely to make it easier to keep track of the runs and to facilitate analysis. The following scheme is used:

XXYYZZ-Prototype-RunDescription


Where, XX denotes the Prototype Number

YY denotes Test Run Number

ZZ denotes Climate zone

Example:

05 01 15-RetIMed-EnvelopeRoofInsulation

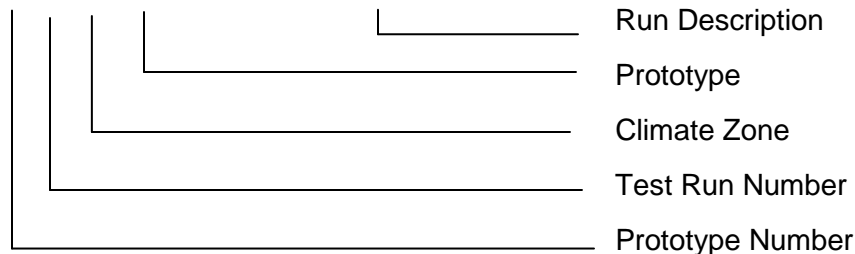

Example for Simple Geometry Test case

02 11 015-OffSml-SG-EnvRoofInsulation

| | |
|--|------------------|
| | Run Description |
| | Prototype |
| | Climate Zone |
| | Test Run Number |
| | Prototype Number |

1.3.1 Reporting Test Results

For each test case, the TDV energy use of the modeled building is reported (kBtu/ft²), along with the TDV energy use attributed to the major fuel types (electricity, gas), site energy use, and energy end use intensity for the regulated end uses (cooling, heating, lighting, etc.). The following energy totals are reported:

1. Annual TDV EUI (kBtu/ft²)
2. Annual Site EUI – Electricity (kWh/ft²)
3. Annual SiteEUI – Natural Gas (therm/ft²)
4. Annual Total End Use Site Energy EUI – kBtu/ft²

Site Energy End Uses

5. Site Energy: Heating (kBtu/ft²)
6. Site Energy: Cooling (kBtu/ft²)
7. Site Energy: Interior Lighting (kBtu/ft²)
8. Site Energy: Interior Equipment (kBtu/ft²)
9. Site Energy: Fans (kBtu/ft²) (Airside Fans, does not include tower fans)
10. Site Energy: Pumps (kBtu/ft²)
11. Site Energy: Towers (kBtu/ft²)\Water heating (kBtu/ft²)
12. **TDV % Variation** – this field is used for the compliance test
13. Total End Use Site Energy % - percentage change in site energy use
14. Pass/Fail – test fails if it does not meet passing criteria
15. Unmet load hours – these are defined as the zone with the most unmet load hours

- a. Reference Model Occupied Unmet Load Hours
- b. Applicant Model Occupied Unmet Load Hours
- c. Reference Model Number of Zones with excess unmet load hours (>150)
- d. Applicant Model Number of Zones with excess unmet load hours (>150)

1.3.2 TDV Variation Test

Compiled results shall include annual site energy consumption for each end-use, overall site energy consumption, total unmet load hours and annual TDV and % variation of annual TDV and total end use site energy.

The annual TDV % variation shall be calculated using the formula:

$$TDV_{\%} = (TDV_b - TDV_n) / TDV_b$$

Where, $TDV_{\%}$ is the TDV % variation,

TDV_n is the annual TDV for test case number n and

TDV_b is the annual TDV for the base case run.

In order to be accepted, the applicant software shall fulfill the passing criteria below:

The change in energy for each test case must be in the same direction as the Reference Method test case result, and must be equal to the Reference Method test case percentage change in TDV energy, plus or minus 0.5% of baseline TDV energy.

1.3.3 Software Sensitivity Test Cases

Test cases assess the energy impact of one or more of the building or system input characteristics on the baseline model. Each test suite consists of a series of unique test cases aimed to test the impact of a specific characteristic on building energy performance. Simulations are grouped according to test criteria and sub-grouped based on the reference model type to allow for direct comparison of results. For each test case, the applicant software will modify the applicant baseline model with specific inputs as described in the Test Case description section.

The test cases are simulated on multiple California weather files to evaluate the sensitivity of the building or system input to extremes in climate. Results of the test case runs and the TDV percent variation over the baseline run shall be compiled and compared against the reference results.

Detailed descriptions of the Standard Design models are provided in the 2016 Nonresidential ACM Reference manual. Reference Method input files for all baseline and test case models are available from the California Energy Commission upon requested. Details on each Test Description can also be found in the 2016 Nonresidential ACM Reference manual.

Table 1 – Baseline Runs for Sensitivity Test Cases

| Test Case Name | Baseline | Description |
|---|-------------------------|---|
| 050115-RetlMed-EnvelopeRoofInsulation | 050015-RetlMed-Baseline | Decrease overall U value of Roof compared to baseline case |
| 050215-RetlMed-EnvelopeWallInsulation | 050015-RetlMed-Baseline | Decrease overall U value of Exterior Wall compared to baseline case |
| 050315-RetlMed-EnvelopeHeavy | 050015-RetlMed-Baseline | Change Roof and Wall construction assembly to Wood Framed Roof and Heavy Mass wall. |
| 050416-RetlMed-EnvelopeRoofInsulation | 050016-RetlMed-Baseline | Decrease overall U value of Roof compared to baseline case |
| 050516-RetlMed-EnvelopeWallInsulation | 050016-RetlMed-Baseline | Decrease overall U value of Exterior Wall compared to baseline case |
| 050616-RetlMed-EnvelopeHeavy | 050016-RetlMed-Baseline | Change Roof and Wall construction assembly to Wood Framed Roof and Heavy Mass wall. |
| 050706-RetlMed-EnvelopeRoofInsulation | 050006-RetlMed-Baseline | Decrease overall U value of Roof compared to baseline case |
| 050806-RetlMed-RetlMed-EnvelopeWallInsulation | 050006-RetlMed-Baseline | Decrease overall U value of Exterior Wall compared to baseline case |
| 050906-RetlMed-RetlMed-EnvelopeHeavy | 050006-RetlMed-Baseline | Change Roof and Wall construction assembly to Wood Framed Roof and Heavy Mass wall. |
| 031015-OffMed-FloorSlabInsulation | 030015-OffMed-Baseline | Change slab F-factor |
| 031215-OffMed-GlazingWindowU | 030015-OffMed-Baseline | Decrease SHGC of windows by 20% compared to baseline case |
| 031315-OffMed-GlazingWindowSHGC | 030015-OffMed-Baseline | Decrease U value & SHGC of windows by 20% compared to baseline case |
| 031415-OffMed-GlazingWindowUSHGC | 030015-OffMed-Baseline | Change Floor slab F factor of perimeter zones in the bottom floor to 0.45 0.46 |
| 031516-OffMed-FloorSlabInsulation | 030016-OffMed-Baseline | Increase Exterior Wall Infiltration by 10% compared to baseline case |
| 031716-OffMed-GlazingWindowU | 030016-OffMed-Baseline | Decrease SHGC of windows by 20% compared to baseline case |
| 031816-OffMed-GlazingWindowSHGC | 030016-OffMed-Baseline | Decrease U value & SHGC of windows by 20% compared to baseline case |
| 031916-OffMed-GlazingWindowUSHGC | 030016-OffMed-Baseline | Change Floor slab F factor of perimeter zones in the bottom floor to 0.45 0.46 |
| 032006-OffMed-FloorSlabInsulation | 030006-OffMed-Baseline | Increase Exterior Wall Infiltration by 10% compared to baseline case |
| 032206-OffMed-GlazingWindowU | 030006-OffMed-Baseline | Decrease SHGC of windows by 20% compared to baseline case |
| 032306-OffMed-GlazingWindowSHGC | 030006-OffMed-Baseline | Decrease U value & SHGC of windows by 20% compared to baseline case |
| 032406-OffMed- | 030006-OffMed-Baseline | Reduce window area |

| | | |
|---|------------------------|---|
| GlazingWindowUSHGC | | |
| 042507-OffLrg-WWR20% | 040007-OffLrg-Baseline | Increase window area |
| 042607-OffLrg-WWR60% | 040007-OffLrg-Baseline | |
| 042801-OffLrg-WWR20% | 040001-OffLrg-Baseline | Increase window area |
| 042901-OffLrg-WWR60% | 040001-OffLrg-Baseline | Decrease LPD by 20% compared to baseline case |
| 033015-OffMed-LightingLowLPD | 030015-OffMed-Baseline | Increase LPD by 20% compared to baseline case |
| 033115-OffMed-LightingHighLPD | 030015-OffMed-Baseline | Decrease LPD by 20% compared to baseline case |
| 033216-OffMed-LightingLowLPD | 030016-OffMed-Baseline | Increase LPD by 20% compared to baseline case |
| 033316-OffMed-LightingHighLPD | 030016-OffMed-Baseline | Decrease LPD by 20% compared to baseline case |
| 033406-OffMed-LightingLowLPD | 030006-OffMed-Baseline | Increase LPD by 20% compared to baseline case |
| 033506-OffMed-LightingHighLPD | 030006-OffMed-Baseline | Decrease EPD by 20% compared to baseline case |
| 044207-OffLrg-Daylighting Cont.DimHighVT | 040007-OffLrg-Baseline | Change daylighting controls in Primary and Secondary daylit areas |
| 044307-OffLrg-Daylighting StepDim | 040007-OffLrg-Baseline | Change daylighting controls in Primary and Secondary daylit areas and increase visible transmittance |
| 044407-OffLrg-Daylighting StepDimHighVT | 040007-OffLrg-Baseline | Increase Visible Transmittance of windows compared to baseline case. Reduce window area |
| 044507-OffLrg-Daylighting WWR20Cont.DimHighVT | 042507-OffLrg-WWR20% | Change daylighting controls in Primary and Secondary daylit areas. Reduce window area |
| 044607-OffLrg-Daylighting WWR20StepDim | 042507-OffLrg-WWR20% | Change daylighting controls in Primary and Secondary daylit areas and increase visible transmittance of windows. Reduce window area |
| 044707-OffLrg-47CZ07LargeOffice Daylighting WWR20StepDimHighVT | 042507-OffLrg-WWR20% | Increase Visible Transmittance compared to baseline case. Increase window area |
| 044807-OffLrg-48CZ07LargeOffice Daylighting WWR60Cont.DimHighVT | 042607-OffLrg-WWR60% | Change daylighting controls in Primary and Secondary daylit areas. Increase window area |
| 044907-OffLrg-49CZ07LargeOffice Daylighting WWR60StepDim | 042607-OffLrg-WWR60% | Change daylighting controls in Primary and Secondary daylit areas and increase visible transmittance of windows. Increase window area |
| 045007-OffLrg-50CZ07LargeOffice Daylighting WWR60StepDimHighVT | 042607-OffLrg-WWR60% | Increase Visible Transmittance of windows compared to baseline case |
| 045101-OffLrg-51CZ01LargeOffice Daylighting | 040001-OffLrg-Baseline | Change daylighting controls in Primary and Secondary daylit areas |

| | | |
|---|---------------------------------|---|
| Cont.DimHighVT | | |
| 045201-OffLrg-52CZ01LargeOffice Daylighting StepDim | 040001-OffLrg-Baseline | Change daylighting controls in Primary and Secondary daylit areas and increase visible transmittance of windows |
| 045301-OffLrg-53CZ01LargeOffice Daylighting StepDimHighVT | 040001-OffLrg-Baseline | Increase Visible Transmittance of windows compared to baseline case. Reduce window area |
| 045401-OffLrg-Daylighting WWR20Cont.DimHighVT | 042801-OffLrg-WWR20% | Change daylighting controls in Primary and Secondary daylit areas. Reduce window area |
| 045501-OffLrg-Daylighting WWR20StepDim | 042801-OffLrg-WWR20% | Change daylighting controls in Primary and Secondary daylit areas and increase visible transmittance of windows. Reduce window area |
| 045601-OffLrg-Daylighting WWR20StepDimHighVT | 042801-OffLrg-WWR20% | Increase Visible Transmittance of windows compared to baseline case. Increase window area |
| 045701-OffLrg-Daylighting WWR60Cont.DimHighVT | 042901-OffLrg-WWR60% | Change daylighting controls in Primary and Secondary daylit areas. Increase window area |
| 045801-OffLrg-Daylighting WWR60StepDim | 042901-OffLrg-WWR60% | Change daylighting controls in Primary and Secondary daylit areas and increase visible transmittance of windows. Increase window area |
| 045901-OffLrg-Daylighting WWR60StepDimHighVT | 042901-OffLrg-WWR60% | Increase Visible Transmittance of skylights compared to baseline case |
| 056007-RetlMed-Daylighting SRRBaseHighVT | 050007-RetlMed-Baseline | Increase skylight area. |
| 056107-RetlMed-Daylighting SRR3.04 | 050007-RetlMed-Baseline | Increase skylight area and visible transmittance of skylights compared to baseline case. |
| 056207-RetlMed-Daylighting SRR3.04HighVT | 050007-RetlMed-Baseline | Increase Visible Transmittance of skylights compared to baseline case |
| 056301-RetlMed-Daylighting SRRBaseHighVT | 050001-RetlMed-Baseline | Increase skylight area |
| 056401-RetlMed-Daylighting SRR3.04 | 050001-RetlMed-Baseline | Increase skylight area and visible transmittance of skylights compared to baseline case |
| 056501-RetlMed-Daylighting SRR3.04HighVT | 050001-RetlMed-Baseline | Increase ductloss in the zones served by Pacakaged Single Zone systems. |
| 056616-RetlMed-HVAC DuctLoss | 050016-RetlMed-BaselineDuctLoss | |
| 056716-RetlMed-HVAC DuctLoss | 050006-RetlMed-BaselineDuctLoss | Increase ductloss in the zones served by Pacakaged Single Zone systems. |
| 036815-OffMed-HVACPVAV Design | 030015-OffMed-Baseline | Change static pressure and motor efficiency of all VAV fans. See details below |

| | | |
|--|------------------------|---|
| 036915-OffMed-HVACPVAV SATControl | 030015-OffMed-Baseline | Change supply air temperature reset based on Outside air. See details below |
| 037015-OffMed-HVACPVAV VAVControl | 030015-OffMed-Baseline | Change VAV damper control to dual maximum. |
| 037115-OffMed-HVACPVAV EconomizerType | 030015-OffMed-Baseline | Change Economizer Type to Fixed Dry bulb with 70 F high limit |
| 037216-OffMed-HVACPVAV Design | 030016-OffMed-Baseline | Change static pressure and motor efficiency of all VAV fans. See details below |
| 037316-OffMed-HVACPVAV SATControl | 030016-OffMed-Baseline | Change supply air temperature reset based on Outside air. See details below |
| 037416-OffMed-HVACPVAV VAVControl | 030016-OffMed-Baseline | Change VAV damper control to dual maximum |
| 037516-OffMed-HVACPVAV EconomizerType | 030016-OffMed-Baseline | Change Economizer Type to Fixed Dry bulb with 70 F high limit |
| 037606-OffMed-HVACPVAV Design | 030006-OffMed-Baseline | Change static pressure and motor efficiency of all VAV fans. See details below |
| 037706-OffMed-HVACPVAV SATControl | 030006-OffMed-Baseline | Change supply air temperature reset based on Outside air. See details below |
| 037806-OffMed-HVACPVAV VAVControl | 030006-OffMed-Baseline | Change VAV damper control to dual maximum. |
| 037906-OffMed-HVACPVAV EconomizerType | 030006-OffMed-Baseline | Change Economizer Type to Fixed Dry bulb with 70 F high limit |
| 048015-OffLrg-HVACVAV ChillerCOP | 040015-OffLrg-Baseline | Increase Chiller COP compared to baseline case |
| 048115-OffLrg-HVACVAV CHWdeltaT | 040015-OffLrg-Baseline | Change the Chilled water loop design temperature difference |
| 048215-OffLrg-HVACVAV CWSetpoint | 040015-OffLrg-Baseline | Change condenser water setpoint reset based on Outdoor air wet bulb temperature |
| 048315-OffLrg-HVACVAV TowerEff | 040015-OffLrg-Baseline | Change Tower Efficiency |
| 048416-OffLrg-HVACVAV ChillerCOP | 040016-OffLrg-Baseline | Increase Chiller COP |
| 048516-OffLrg-HVACVAV CHWdeltaT | 040016-OffLrg-Baseline | Change the Chilled water loop design temperature difference |
| 048616-OffLrg-HVACVAV CWSetpoint | 040016-OffLrg-Baseline | Change condenser water setpoint reset based on Outdoor air wet bulb temperature |
| 048706-OffLrg-HVACVAV TowerEff | 040016-OffLrg-Baseline | Change Tower Efficiency |
| 048806-OffLrg-HVACVAV ChillerCOP | 040006-OffLrg-Baseline | Increase Chiller COP |
| 048906-OffLrg-HVACVAV | 040006-OffLrg-Baseline | Change the Chilled water loop design |

| | | |
|---|------------------------------|---|
| CHWdeltaT | | temperature difference |
| 049006-OffLrg-HVACVAV CWSetpoint | 040006-OffLrg-Baseline | Change condenser water setpoint reset based on Outdoor air wet bulb temperature |
| 049106-OffLrg-HVACVAV TowerEff | 040006-OffLrg-Baseline | Change condenser water setpoint reset based on Outdoor air wet bulb temperature |
| 109215-RetlStrp-HVACPSZ DXCOP | 100015-RetlStrp-BaselinePSZ | Increase COP of DX coil |
| 109315-RetlStrp-HVACPSZ HeatEff | 100015-RetlStrp-BaselinePSZ | Increase efficiency of the Heating coil |
| 109415-RetlStrp-HVACPSZ EconomizerControl | 100015-RetlStrp-BaselinePSZ | Change Economizer from Integrated as in baseline to NonIntegrated. |
| 109516-RetlStrp-HVACPSZ DXCOP | 100016-RetlStrp-BaselinePSZ | Increase COP of DX coil |
| 109616-RetlStrp-HVACPSZ HeatEff | 100016-RetlStrp-BaselinePSZ | Increase efficiency of the Heating coil |
| 109716-RetlStrp-HVACPSZ EconomizerControl | 100016-RetlStrp-BaselinePSZ | Change Economizer from Integrated as in baseline to NonIntegrated. |
| 109806-RetlStrp-HVACPSZ DXCOP | 100006-RetlStrp-BaselinePSZ | Increase COP of DX coil |
| 109906-RetlStrp-HVACPSZ HeatEff | 100006-RetlStrp-BaselinePSZ | Increase efficiency of the Heating coil |
| 1010006-RetlStrp-HVACPSZ EconomizerControl | 100006-RetlStrp-BaselinePSZ | Change Economizer from Integrated as in baseline to NonIntegrated. |
| 1010115-RetlStrp-HVACPTAC DXCOP | 100015-RetlStrp-BaselinePTAC | Increase COP of DX coil |
| 1010215-RetlStrp-HVACPTAC DXCOP | 100016-RetlStrp-BaselinePTAC | Increase COP of DX coil |
| 1010315-RetlStrp-HVACPTAC DXCOP | 100006-RetlStrp-BaselinePTAC | Increase COP of DX coil |
| 1010415-RetlStrp-HVACPTAC vsFanCoil | 100015-RetlStrp-BaselinePTAC | Comparison of PTAC system with Fan Coil system |
| 1010516-RetlStrp-HVACPTAC vsFanCoil | 100016-RetlStrp-BaselinePTAC | Comparison of PTAC system with Fan Coil system |
| 1010606-RetlStrp-HVACPTAC vsFanCoil | 100006-RetlStrp-BaselinePTAC | Comparison of PTAC system with Fan Coil system |
| 0211015-OffSml-SG- EnvRoofInsulation | 0200015-OffSml-SG-Baserun | Decrease overall U value of Roof by 20% compared to baserun case |
| 0211116-OffSml-SG- EnvRoofInsulation | 0200016-OffSml-SG-Baserun | Decrease overall U value of Roof by 20% compared to baserun case |
| 0211206-OffSml-SG- EnvRoofInsulation | 0200006-OffSml-SG-Baserun | Decrease overall U value of Roof by 20% compared to baserun case |
| 0211315-OffSml-SG- EnvWallInsulation | 0200015-OffSml-SG-Baserun | Decrease overall U value of Exterior Wall by 20% compared to baseline case |
| 0211416-OffSml-SG- EnvWallInsulation | 0200016-OffSml-SG-Baserun | Decrease overall U value of Exterior Wall by 20% compared to baseline case |
| 0211506-OffSml-SG- | 0200006-OffSml-SG-Baserun | Decrease overall U value of Exterior |

| | | |
|----------------------------|----------------------------|---|
| EnvWallInsulation | | Wall by 20% compared to baseline case |
| 0311615-OffMed-SG-WWR40 | 0300015-OffMed-SG-Baseline | Change WWR from 33% to 40% |
| 0311715-OffMed-SG-WWR20 | 0300015-OffMed-SG-Baseline | Change WWR from 33% to 20% |
| 0311816-OffMed-SG-WWR40 | 0300016-OffMed-SG-Baseline | Change WWR from 33% to 40% |
| 0311916-OffMed-SG-WWR20 | 0300016-OffMed-SG-Baseline | Change WWR from 33% to 20% |
| 0312006-OffMed-SG-WWR40 | 0300006-OffMed-SG-Baseline | Change WWR from 33% to 40% |
| 0312106-OffMed-SG-WWR20 | 0300006-OffMed-SG-Baseline | Change WWR from 33% to 20% |
| 0312215-OffMed-SG-WinUSHGC | 0300015-OffMed-SG-Baseline | Decrease U value of windows by 20% compared to baseline case |
| 0312316-OffMed-SG-WinUSHGC | 0300016-OffMed-SG-Baseline | Decrease SHGC of windows by 20% compared to baseline case |
| 0312406-OffMed-SG-WinUSHGC | 0300006-OffMed-SG-Baseline | Decrease U value & SHGC of windows by 20% compared to baseline case |
| 0511615RetlMed-SG-SRR5 | 050015RetlMed-SG-Baseline | Change SRR to 5% |
| 0511716RetlMed-SG-SRR5 | 050016RetlMed-SG-Baseline | Change SRR to 5% |
| 0511806RetlMed-SG-SRR5 | 050006RetlMed-SG-Baseline | Change SRR to 5% |
| 0511915RetlMed-SG-SRR1 | 050015RetlMed-SG-Baseline | Change SRR to 1% |
| 0512016RetlMed-SG-SRR1 | 050016RetlMed-SG-Baseline | Change SRR to 1% |
| 0512106RetlMed-SG-SRR1 | 050006RetlMed-SG-Baseline | Change SRR to 1% |
| 0512215RetlMed-SG-SkyUSHGC | 050015RetlMed-SG-Baseline | Decrease U value of skylights by 20% compared to baseline case |
| 0512316RetlMed-SG-SkyUSHGC | 050016RetlMed-SG-Baseline | Decrease U value of skylights by 20% compared to baseline case |
| 0512406RetlMed-SG-SkyUSHGC | 050006RetlMed-SG-Baseline | Decrease U value of skylights by 20% compared to baseline case |