

DOCKETED	
Docket Number:	24-BSTD-03
Project Title:	2025 Energy Code Compliance Software, Manuals and Forms
TN #:	259744
Document Title:	First Draft 2025 RACM Reference Manual
Description:	The first draft of the Single-Family Alternative Calculation Method (ACM) Reference Manual. This draft focuses on updates based on the 2025 Energy Code.
Filer:	Haile Bucaneg
Organization:	California Energy Commission
Submitter Role:	Commission Staff
Submission Date:	10/29/2024 8:43:44 AM
Docketed Date:	10/29/2024



**CALIFORNIA
ENERGY COMMISSION**



California Energy Commission

STAFF REPORT

2025~~2~~ Single-Family Residential Alternative Calculation Method Reference Manual

**For the 2025~~2~~ Building Energy Efficiency Standards
Title 24, Part 6, and Associated Administrative
Regulations in Part 1**

Draft

~~June 2023 | CEC-400-2022-008-CMF-REV2~~

California Energy Commission

Haile Bucaneg

~~Thao Chau~~~~Michael Shewmaker~~

Primary Authors

Haile Bucaneg

~~Che Geiser~~

~~Michael Shewmaker~~Thao Chau

Project Managers

~~Gypsy Achong~~~~Will Vicent~~

Branch Manager

BUILDING STANDARDS BRANCH

Michael J. Sokol

Director

EFFICIENCY DIVISION

Drew Bohan

Executive Director

Draft

DISCLAIMER

Staff members of the California Energy Commission (CEC) prepared this manual, which is intended to provide guidance on how to comply with the **2025~~2~~** Building Energy Efficiency Standards. However, use of or compliance with the guidance does not assure compliance with the **2025~~2~~** Building Energy Efficiency Standards, and it is the responsibility of the user of this document to ensure compliance with the **2025~~2~~** Building Energy Efficiency Standards and all other applicable laws and regulations. The CEC, the State of California, its employees, contractors, and subcontractors make no warrant, express or implied, and assume no legal liability regarding the use of this manual; nor does any party represent that the uses of this information will not infringe upon privately owned rights. This report has not been approved or disapproved by the CEC nor has the Commission passed upon the accuracy or adequacy of the information in this report.

ACKNOWLEDGMENTS

The California Energy Commission (CEC) adopted and put into effect the first Building Energy Efficiency Standards in 1978 and has updated these standards periodically in the intervening years. The Building Energy Efficiency Standards are a unique California asset that has placed the state on the forefront of energy efficiency, sustainability, energy independence, and climate change issues. The standards also have provided a template for national standards within the United States as well as for other countries around the globe. They have benefitted from the conscientious involvement and enduring commitment to the public good of many persons and organizations along the way. The 2025~~2~~ Building Energy Efficiency Standards for residential and nonresidential buildings development and adoption process continued the long-standing practice of maintaining the standards with technical rigor, challenging but achievable design and construction practices, public engagement, and full consideration of the views of stakeholders.

The revisions in the 2025~~2~~ Building Energy Efficiency Standards for residential and nonresidential buildings were conceptualized, evaluated, and justified through the excellent work of CEC staff and consultants working under contract to the CEC. Revisions were also supported by the utility-organized Codes and Standards Enhancement Initiative and shaped by the participation of more than 150 stakeholders and the contribution of formal public comments.

CEC Efficiency Division staff would like to acknowledge Commissioner Andrew McAllister and his adviser, Bill Pennington, for their unwavering leadership throughout the standards development; ~~Payam Bozorgchami, P.E.~~ Javier Perez, who served as project manager and senior engineer for the 2025~~2~~ standards code cycle; ~~Mazi Shirakh~~ Payam Bozorgchami, P.E., who served as the senior engineer and senior technical lead for solar photovoltaic standards; ~~Will Vicent~~ Gypsy Achong, who served as the Manager for the Buildings Standards Branch; ~~Javier Perez~~, who served as the lead for multifamily buildings; ~~Peter Strait~~ Mikey Shewmaker, who served as the supervisor for the Standards Development Unit; ~~Che Geiser~~, who served as the supervisor for the Standards Tools Unit; ~~James Qaqundah~~, ~~Matt Chalmers~~, Devin Black, Josephine Crosby, ~~Justin Delacruz~~ Ana Gonzalez, Michael Murza, Albert Kim, and ~~Chester Hong~~ Isaac Serratos, who provided legal counsel and support; and technical staff contributors of the Building Standards Branch including: Haider Alhabibi; Jessica Arroyo; Ronald Balneg; Stephen Becker; Amie Brousseau; Thao Chau, P.E.; Sahar Daemi; Kyle Grewing; ~~Danuta Drozdowicz~~; Simon Lee, P.E.; Cheng Moua, P.E.; Michael Shewmaker; Elmer Motel; Gagandeep Randhawa; Anushka Raut; Muhammad Saeed; Danny Tam; Trevor Thomas; Bach Tsan; RJ Wichert, P.E.; and Allen Wong, and of the Standards Compliance Branch, including Joe Loyer; and Cheng Moua, P.E. Additional staff input and assistance came from the Energy Hotline staff and the CEC's web team. Administrative support and editing were provided by ~~Amber Beck~~; ~~Christine Collopy~~; Corrine Fishman; Tajanee Ford-Whelan; and Michi Mason.

Critical support for the staff in conceptualizing, evaluating, and reviewing this document came from consultants and stakeholders, including Bruce Wilcox, Scott Criswell, Dimitri Contoyannis, Alea German, Eric Martin, Diane Peppone, Robert Scott, Traci Meyer-Jones, and the Codes and Standards Enhancement Initiative, which is supported by a consortium of California utility providers which includes the Pacific Gas and Electric Company, Southern California Edison, San Diego Gas & Electric, Sacramento Municipal Utility District, and Los Angeles Department of Water and Power.

Draft

ABSTRACT

The California Energy Commission's (CEC) *2025~~2~~ Building Energy Efficiency Standards* for residential and nonresidential buildings allows compliance by either a prescriptive or a performance method. Performance compliance uses computer-modeling software to trade-off efficiency measures. Performance compliance is the most popular compliance method because of the flexibility it provides in the building design.

Compliance software must be certified by the CEC using the rules established for modeling software. This document establishes the rules for creating a building model, describes how the proposed design (energy use) is defined, explains how the standard design (energy budget) is established, and reports on the Performance Compliance Certificate. This document does not specify the minimum capabilities of vendor-supplied software. The CEC reserves the right to approve vendor software for limited implementations of what is documented in this manual.

This *Single-Family Residential Alternative Calculation Method Reference Manual* explains how the proposed and standard designs are determined. The explanation for multifamily residential building proposed and standard designs are described in the *Nonresidential and Multifamily Alternative Calculation Method Reference Manual*.

The 2022 compliance manager is the simulation and compliance rule implementation software specified by the CEC. The compliance manager, called California Building Energy Code Compliance Residential (CBECC-Res), models all the regulated energy performance features affecting the energy compliance of a building.

Keywords: ACM, Alternative Calculation Method, *Building Energy Efficiency Standards*, California Energy Commission, California Building Energy Code Compliance, CBECC, certificate of compliance, CF1R, compliance manager, compliance software, computer compliance, energy budget, energy code, energy use, performance compliance, design, proposed design, standard design

Bucaneg, Haile; Thao Chau; Che Geiser; Traci Meyer Jones; Cheng Moua, P.E.; Jennifer Roberts; Muhammad Saeed; Michael Shewmaker; Peter Strait; Danny Tam; Bach Tsan; RJ Wichert; and Bruce Wilcox. 2025~~2~~. *2025~~2~~ Residential Alternative Calculation Method Reference Manual*. California Energy Commission,

Draft

TABLE OF CONTENTS

1	Introduction.....	151
1.1	Purpose	151
1.2	Other Documents	151
1.3	Compliance for Newly Constructed Buildings	151
1.4	Source Energy	162
1.5	Long-term System Cost.....	172
1.6	Peak Cooling	182
1.7	Compliance for Additions and Alterations.....	182
1.8	Self-Utilization Credit	203
1.9	Demand Response.....	203
1.9.1	Precooling	223
1.9.2	Heat Pump Water Heater Load Shifting	Error! Bookmark not defined. 4
2	Proposed and Standard Design	25
2.1	Overview.....	25
2.1.1	Proposed Design.....	25
2.1.2	Standard Design	35
2.1.3	Photovoltaics Requirements.....	46
2.2	The Building.....	114
2.2.1	Climate and Weather.....	121
2.2.2	Standards Version.....	131
2.2.3	Existing Condition Verified	131
2.2.4	Air Leakage and Infiltration.....	141
2.2.5	Quality Insulation Installation	151
2.2.6	Number of Bedrooms	161
2.2.7	Front Orientation	161
2.2.8	Fuel Type	171
2.2.9	Attached Garage.....	181
2.2.10	Lighting.....	181
2.2.11	Appliances.....	181

2.3	Building Materials and Construction	1917
2.3.1	Materials	1917
2.3.2	Construction Assemblies	2119
2.3.3	Spray-Foam Insulation	2322
2.4	Building Mechanical Systems	2423
2.4.1	Heating Subsystems.....	2523
2.4.2	Combined Hydronic Space/Water Heating.....	3127
2.4.3	Special Systems — Hydronic Distribution Systems and Terminals.....	3329
2.4.4	Ground-Source Heat Pump	3430
2.4.5	Air-to-Water Heat Pumps.....	3430
2.4.6	Cooling Subsystems	3430
2.4.7	Distribution Subsystems	4639
2.4.8	Space-Conditioning Fan Subsystems	6254
2.4.9	Space-Conditioning Systems	6354
2.4.10	Indoor Air Quality Ventilation.....	6456
2.4.11	Ventilation Cooling System	7060
2.5	Conditioned Zones	7161
2.5.1	Zone Type	7161
2.5.2	Conditioned Floor Area	7262
2.5.3	Number of Stories.....	7262
2.5.4	Conditioned Zone Assumptions	7666
2.5.5	Internal Gains.....	7868
2.5.6	Exterior Surfaces.....	7868
2.6	Attics	8776
2.6.1	Attic Components.....	8777
2.6.2	Ceiling Below Attic	8978
2.6.3	Attic Roof Surface and Pitch	8979
2.6.4	Attic Conditioning.....	9079
2.6.5	Attic Edge.....	9080
2.6.6	The Roof Deck.....	9281
2.7	Crawl Spaces.....	9685

2.8	Garage/Storage	9685
2.9	Domestic Hot Water (DHW)	9686
2.9.1	Domestic Water Heating Systems.....	9988
2.9.2	Solar Thermal Water Heating Credit	10089
2.10	Additions/Alterations.....	10089
2.10.1	Accessory Dwelling Units	10189
2.10.2	Whole Building.....	10190
2.10.3	Alteration-Along Approach	10190
2.10.4	Addition-Along Approach	10190
2.10.5	Existing + Addition + Alteration Approach	10291
2.11	Documentation.....	114102
2.12	CALGreen.....	115102
1	Introduction.....	1
1.1	Purpose	1
1.2	Other Documents	1
1.3	Compliance for Newly Constructed Buildings	1
1.4	Compliance for Additions and Alterations.....	2
1.5	Energy Design Rating.....	2
1.5.1	Energy Design Rating 1 (EDR1)	2
1.5.2	Energy Design Rating 2 (EDR2)	3
1.6	Self Utilization Credit	4
1.7	Demand Response.....	4
1.7.1	Precooling	4
2	Proposed, Standard, and Reference Design	6
2.1	Overview.....	6
2.1.1	Energy Design Rating.....	6
2.1.2	Proposed Design.....	6
2.1.3	Standard Design	7
2.1.4	Reference Design.....	7
2.1.5	Photovoltaics Requirements.....	8

2.2	The Building	13
2.2.1	Climate and Weather	15
2.2.2	Standards Version	15
2.2.3	Existing Condition Verified	16
2.2.4	Air Leakage and Infiltration	16
2.2.5	Quality Insulation Installation	18
2.2.6	Number of Bedrooms	19
2.2.7	Front Orientation	20
2.2.8	Fuel Type	20
2.2.9	Attached Garage	21
2.2.10	Lighting	21
2.2.11	Appliances	22
2.3	Building Materials and Construction	22
2.3.1	Materials	22
2.3.2	Construction Assemblies	24
2.3.3	Spray Foam Insulation	27
2.4	Building Mechanical Systems	28
2.4.1	Heating Subsystems	28
2.4.2	Combined Hydronic Space/Water Heating	33
2.4.3	Special Systems — Hydronic Distribution Systems and Terminals	35
2.4.4	Ground-Source Heat Pump	36
2.4.5	Air-to-Water Heat Pumps	36
2.4.6	Cooling Subsystems	36
2.4.7	Distribution Subsystems	46
2.4.8	Space-Conditioning Fan Subsystems	63
2.4.9	Space-Conditioning Systems	64
2.4.10	Indoor Air Quality Ventilation	65
2.4.11	Ventilation Cooling System	71
2.5	Conditioned Zones	72
2.5.1	Zone Type	72
2.5.2	Conditioned Floor Area	73

2.5.3	Number of Stories	73
2.5.4	Conditioned Zone Assumptions	77
2.5.5	Internal Gains	79
2.5.6	Exterior Surfaces	79
2.6	Attics	88
2.6.1	Attic Components	89
2.6.2	Ceiling Below Attic	90
2.6.3	Attic Roof Surface and Pitch	91
2.6.4	Attic Conditioning	91
2.6.5	Attic Edge	92
2.6.6	The Roof Deck	94
2.7	Crawl Spaces	97
2.8	Garage/Storage	98
2.9	Domestic Hot Water (DHW)	98
2.9.2	Domestic Water Heating Systems	101
2.9.3	Solar Thermal Water Heating Credit	101
2.10	Additions/Alterations	102
2.10.1	Accessory Dwelling Units	102
2.10.2	Whole Building	102
2.10.3	Alteration-Along Approach	102
2.10.4	Addition-Along Approach	102
2.10.5	Existing + Addition + Alteration Approach	104
2.11	Documentation	114
3	Energy Design Rating Details	115
3.1	CALGreen	115

LIST OF FIGURES

Figure 1: Precooling Thermostat Set point	223
Figure 2: Community Solar	67
Figure 3: Surface Definitions	1211
Figure 4: Example Construction Data Screen	2120
Figure 5: Overhang Dimensions	8474
Figure 6: Sidefin Dimensions	8574
Figure 7: Attic Model Components.....	8777
Figure 8: Section at Attic Edge with Standard Truss	9180
Figure 9: Section at Attic Edge with a Raised Heel Truss	9181
Figure 10: Components of the Attic Through Roof Deck	9282
Figure 1: Precooling Thermostat Setpoint	5
Figure 2: Energy Use Details.....	9
Figure 3: Community Solar	10
Figure 4: Surface Definitions.....	15
Figure 5: Example Construction Data Screen	25
Figure 6: Overhang Dimensions	85
Figure 7: Sidefin Dimensions	86
Figure 8: Attic Model Components.....	88
Figure 9: Section at Attic Edge with Standard Truss	92
Figure 10: Section at Attic Edge with a Raised Heel Truss.....	93
Figure 11: Components of the Attic Through Roof Deck	94

LIST OF TABLES

Table 1: JA13 HPWH Basic Control Credit	21
Table 2: Self Utilization Credits	10
Table 3: Air Leakage Distribution (Percentage of Total Leakage by Surface)	15
Table 4: Modeling Rules for Unverified Insulation Installation Quality	16
Table 5: Materials List	19
Table 6: Required Thickness Spray-Foam Insulation (in inches)	24
Table 7: HVAC Heating Equipment Types	27
Table 8: Heat Pump Equipment Types.....	28
Table 9: HVAC Cooling Equipment Types (Other Than Heat Pumps).....	36
Table 10: Summary of Space Conditioning Measures Requiring Verification	39
Table 11: HVAC Distribution Type and Location Descriptors.....	48
Table 12: Summary of Verified Distribution Systems	49
Table 13: Summary of Standard Design Duct Location	51
Table 14: Location of Default Duct Surface Area	52
Table 15: Buried Duct Effective R-Values: R-8 Ducts With Blown Fiberglass Attic Insulation..	57
Table 16: Buried Duct Effective R-Values: R-8 Ducts with Blown Cellulose Attic Insulation....	57
Table 17: Buried Duct Effective R-Values: R-6 Ducts with Blown Fiberglass Attic Insulation ..	58
Table 18: Buried Duct Effective R-Values: R-6 Ducts with Blown Cellulose Attic Insulation....	58
Table 19: Buried Duct Effective R-Values: R-4.2 Ducts With Blown Fiberglass Attic Insulation	59
Table 20: Buried Duct Effective R-Values: R-4.2 Ducts with Blown Cellulose Attic Insulation .	60
Table 21: Duct/Air Handler Leakage	61
Table 22: IAQ Fans	69
Table 22: Ventilation Cooling Fans	71
Table 24: Hourly Thermostat Set Points	75
Table 25: Conditioned Zone Thermal Mass Objects	76
Table 26: Standard Design for Roofs/Ceilings	104
Table 27: Standard Design for Walls and Doors	106
Table 28: Standard Design for Fenestration (in Walls and Roofs)	108

Table 29: Standard Design for Overhangs, Sides, and Other Exterior Shading	109
Table 30: Standard Designs for Floors	110
Table 31: Standard Design for Air Leakage and Infiltration	111
Table 32: Standard Design for Space-Conditioning Systems.....	111
Table 33: Standard Design for Duct Systems	113
Table 34: Standard Design for Water Heater Systems	113
Table 1: Self Utilization Credits	9
Table 2: Air Leakage Distribution (Percentage of Total Leakage by Surface)	13
Table 3: Modeling Rules for Unverified Insulation Installation Quality	14
Table 4: Materials List	17
Table 5: Required Thickness Spray Foam Insulation (in inches)	22
Table 6: HVAC Heating Equipment Types	24
Table 7: Heat Pump Equipment Types.....	25
Table 8: HVAC Cooling Equipment Types (Other Than Heat Pumps).....	31
Table 9: Summary of Space Conditioning Measures Requiring Verification	33
Table 10: HVAC Distribution Type and Location Descriptors	40
Table 11: Summary of Verified Distribution Systems	41
Table 12: Summary of Standard Design Duct Location	43
Table 13: Location of Default Duct Surface Area	44
Table 14: Buried Duct Effective R-Values: R-8 Ducts With Blown Fiberglass Attic Insulation..	48
Table 15: Buried Duct Effective R-Values: R-8 Ducts with Blown Cellulose Attic Insulation....	49
Table 16: Buried Duct Effective R-Values: R-6 Ducts with Blown Fiberglass Attic Insulation ..	50
Table 17: Buried Duct Effective R-Values: R-6 Ducts with Blown Cellulose Attic Insulation....	50
Table 18: Buried Duct Effective R-Values: R-4.2 Ducts With Blown Fiberglass Attic Insulation	51
Table 19: Buried Duct Effective R-Values: R-4.2 Ducts with Blown Cellulose Attic Insulation ..	51
Table 20: Duct/Air Handler Leakage	53
Table 21: IAQ Fans	59
Table 22: Ventilation Cooling Fans	61
Table 23: Hourly Thermostat Set Points	65
Table 24: Conditioned Zone Thermal Mass Objects	66

Table 25: Standard Design for Roofs/Ceilings	93
Table 26: Standard Design for Walls and Doors	94
Table 27: Standard Design for Fenestration (in Walls and Roofs)	96
Table 28: Standard Design for Overhangs, Sidesfins, and Other Exterior Shading	97
Table 29: Standard Designs for Floors	98
Table 30: Standard Design for Air Leakage and Infiltration	99
Table 31: Standard Design for Space Conditioning Systems	99
Table 32: Standard Design for Duct Systems	101
Table 33: Standard Design for Water Heater Systems	101
Table 1: Self Utilization Credits	12
Table 2: Air Leakage Distribution (Percentage of Total Leakage by Surface)	18
Table 3: Modeling Rules for Unverified Insulation Installation Quality	19
Table 4: Materials List	23
Table 5: Required Thickness Spray Foam Insulation (in inches)	27
Table 6: Standard Design Heating System	29
Table 7: HVAC Heating Equipment Types	30
Table 8: Heat Pump Equipment Types	31
Table 9: HVAC Cooling Equipment Types (Other Than Heat Pumps)	37
Table 10: Summary of Space Conditioning Measures Requiring Verification	40
Table 11: HVAC Distribution Type and Location Descriptors	48
Table 12: Summary of Verified Distribution Systems	49
Table 13: Summary of Standard Design Duct Location	51
Table 14: Location of Default Duct Surface Area	52
Table 15: Buried Duct Effective R-Values: R-8 Ducts With Blown Fiberglass Attic Insulation ...	57
Table 16: Buried Duct Effective R-Values: R-8 Ducts with Blown Cellulose Attic Insulation	58
Table 17: Buried Duct Effective R-Values: R-6 Ducts with Blown Fiberglass Attic Insulation ...	58
Table 18: Buried Duct Effective R-Values: R-6 Ducts with Blown Cellulose Attic Insulation	59
Table 19: Buried Duct Effective R-Values: R-4.2 Ducts With Blown Fiberglass Attic Insulation	60
Table 20: Buried Duct Effective R-Values: R-4.2 Ducts with Blown Cellulose Attic Insulation ..	60
Table 21: Duct/Air Handler Leakage	62
Table 22: IAQ System Component Accessibility Criteria	69

Table 23: IAQ Fans	70
Table 24: Ventilation Cooling Fans	72
Table 25: Hourly Thermostat Set Points	76
Table 26: Conditioned Zone Thermal Mass Objects	77
Table 27: Standard Design for Roofs/Ceilings	106
Table 28: Standard Design for Walls and Doors	107
Table 29: Standard Design for Fenestration (in Walls and Roofs)	109
Table 30: Standard Design for Overhangs, Sidesfins, and Other Exterior Shading	110
Table 31: Standard Designs for Floors	111
Table 32: Standard Design for Air Leakage and Infiltration	112
Table 33: Standard Design for Space Conditioning Systems	112
Table 34: Standard Design for Duct Systems	114
Table 35: Standard Design for Water Heater Systems	114

Draft

1 Introduction

1.1 Purpose

This manual documents the rules used for modeling ~~single-family~~ residential buildings for performance-based compliance under California's *2025~~2~~ Building Energy Efficiency Standards* (Energy Code) for residential and nonresidential buildings. This document explains how the proposed design, and standard design, ~~and reference design~~ are established for a building and what is reported on the certificate of compliance (CF1R) compliance document.

The ~~2025~~2~~~~ compliance manager is the simulation and compliance rule implementation software specified by the California Energy Commission (CEC).

Documentation of detailed calculation algorithms is contained in the companion volume *Appendix G, 2025~~2~~ Residential Alternative Calculation Method Algorithms*.

This reference manual documents the compliance analysis modeling rules for all aspects of the CEC's Alternative Calculation Method (ACM) Reference Manual for single-family residential buildings. For modeling rules for multifamily buildings, please refer to the *Nonresidential and Multifamily Alternative Calculation Method Reference Manual*. This document **does not** specify the minimum capabilities of vendor-supplied software. The CEC reserves the right to approve vendor software for limited implementations of what is documented in this manual.

1.2 Other Documents

The basis of this document is the ~~2025~~2~~~~ Energy Code and definitions for terms used in this manual can be found in the ~~2025~~2~~~~ Energy Code. Documents also relied upon include the *Reference Appendices for the 2025~~2~~ Building Energy Efficiency Standards* (reference appendices) and the *2025~~2~~ Single-Family Residential Compliance Manual* (~~CEC 400-2022-006-CMF~~), *2025 Energy Code Accounting Methodology*.

Detailed modeling information for the software user can be found in the *California Building Energy Code Compliance Residential (CBECC-Res) User Manual*.

1.3 Compliance for Newly Constructed Buildings

Compliance for newly constructed buildings requires calculating the energy use of the proposed design, energy use, and comparing it to the standard design energy budget of the standard design use, and the reference design energy use. Energy use accounts for regulated energy end uses, including space conditioning, water heating, and mechanical ventilation. There may also be additional ~~internal~~ calculations to establish the ~~standard design~~ photovoltaics (PV) requirement of the standard design, and the respective PV requirement of the proposed design PV scaling. ~~when target energy design ratings (EDR)~~

are specified. There are two EDRs that are considered in the energy budget that are described in more detail in this chapter and Section 1.5 Energy Design Rating.

When the energy use of the proposed design is equal to or less than the energy budget of the standard design, the proposed design complies with the standards2025 Energy Code. The compliance margin is the difference between the energy budget of the standard design energy use and the energy use of the proposed design-energy use. When the compliance margin is equal to or greater than zero-or greater, the project complies with the 2025 Energy Code.

The energy use of the proposed design and the energy budget of the standard design isare expressed in units of Source Energy, Long-term System Cost (LSC), Source, and kilowatts per square foot of conditioned floor area (kTDV/ft²)peak cooling energy. The LSC consists of an Efficiency LSC, PV/flexibilityphotovoltaic and BESS LSC and Total LSC. These metrics are described in greater detail in the following sections. andEnergy use accounts for regulated energy end uses, including space heating, space coolingconditioning, water heating, and mechanical ventilation, and water heating.

The proposed building shall separately comply with the sSource eEnergy budget (expressed in British thermal units (BTU_{us})) design-rating (EDR1), the eEfficiency LSC (expressed in dollars)C-energy design-rating (Efficiency EDR2), and the tTotal LSC (expressed in dollars) -energy design-rating (Total EDR2).and peak cooling energy (expressed in kilowatt hours (kWh)). No tradeoffs are allowed between EDR1 and EDR2.

Compliance with EDR2 requires meeting two criteria. First, the proposed design Efficiency EDR2 must be equal to or less than the standard design Efficiency EDR2. Second, the proposed design Total EDR2 must be equal to or less than the standard design Total EDR2.

1.4 Source Energy

The compliance software shall calculate the long-run marginal, hourly source energy use for both the standard design and the proposed design as described in the equation below. Hourly source energy assumes utilities meet all renewables portfolio standards (RPS) and other obligations and is projected over the 30-year life of the building.

$$Source\ Energy = \sum (Electricity\ Use_i \times SE_{kWh,i}) + \sum (Gas\ Use_i \times SE_{gas,i})$$

Where:

Electricity Use_i = The electric energy used in the ith hour.

SE_{kWh,i} = The source energy factor for electricity in the ith hour.

Gas Use_i = The gas energy used in the ith hour.

SE_{gas,i} = The source energy factor for gas in the ith hour.

1.4 The hourly source energy provided by the Energy Commission is used to determine compliance. To comply through the performance compliance approach, the source energy use of the proposed design must be equal to or less than the source energy budget of the standard design. This applies to newly constructed buildings and additions alone to existing buildings projects.

1.5 Long-term System Cost

The compliance software shall calculate the LSC for both the standard design and the proposed design by applying an LSC factor for each hour of the reference year and converting the predicted site energy use to LSC to of California's energy system. LSC factors have been established by the Energy Commission for residential and nonresidential occupancies, for each of the climate zones, and for each fuel type (electricity, natural gas, and propane). The procedure for LSC approach is documented in more details in Reference Appendices, Joint Appendix JA3. The Total LSC for a single-family residential project consists of combines the LSC for all efficiency measures (Efficiency LSC) and the LSC for all photovoltaic system, battery energy storage systems, lighting, demand flexibility measures, and other plug loads (PV/flexibility LSC) as described in the following equations:-

$$Total\ LSC = Efficiency\ LSC + \sum (PV_i \times LSC_{kWh,i}) + \sum (BESS_i \times LSC_{kWh,i}) \\ + \sum (L_{unregulated,i} \times LSC_{kWh,i}) + \sum (DF_i \times LSC_{kWh,i}) + \sum (PL_i \times LSC_{kWh,i})$$

$$Efficiency\ LSC \\ = \sum (SC_{kWh,i} \times LSC_{kWh,i}) + \sum (SC_{gas,i} \times LSC_{gas,i}) + \sum (WH_{kWh,i} \times LSC_{kWh,i}) \\ + \sum (WH_{gas,i} \times LSC_{gas,i}) + \sum (MV_{kWh,i} \times LSC_{kWh,i}) + \sum (MV_{gas,i} \times LSC_{gas,i}) \\ + \sum (SUC_i \times LSC_{kWh,i})$$

Where:

PV_i = The energy generation of the photovoltaic system in the ith hour. Additional information for export considerations are described below.

LSC_{kWh,i} = The LSC factor for electricity in the ith hour.

BESS_i = Battery energy storage system energy in the ith hour.

L_{unregulated,i} = Unregulated lighting energy used in the ith hour.

DF_i = The demand flexibility energy in the ith hour.

PL_i = Plug load energy used in the ith hour.

SC_{kWh,i} = The space-conditioning electric energy used in the ith hour.

SC_{gas,i} = The space-conditioning gas energy used in the ith hour.

LSC_{gas,i} = The LSC factor for gas in the ith hour.

WH_{kwh,i} = The water heating electric energy used in the ith hour.

WH_{gas,i} = The water heating gas energy used in the ith hour.

MV_{kwh,i} = The mechanical ventilation electric energy used in the ith hour.

MV_{gas,i} = The mechanical ventilation gas energy used in the ith hour.

SUC_i = The energy associated with the self-utilization credit in the ith hour.

Whether generated energy is used on site or exported to the grid will affect the PV/flexibility photovoltaic and BESS LSC. If energy is used on site the LSC factor is based on the LSC factors as described in Reference Appendices, Joint Appendix JA3. If energy is exported to the grid, then the LSC hourly export factors provided by the CEC are used. These export factors represent the LSC avoided costs in each hour.

To comply through the performance compliance approach, the Total LSC, and the Efficiency LSC of the proposed design must be equal to or less than the Total LSC, and the Efficiency LSC of the standard design. This applies to newly constructed buildings, additions to existing buildings alone, addition plus alteration of existing buildings, and alterations of existing buildings projects.

1.6 Peak Cooling Energy

The compliance software shall calculate peak cooling energy for both the standard design and the proposed design. -Peak cooling energy is the total annual mechanical cooling site energy, in kWh, that occurs at peak hours between 4 pm and 9 pm in summer months. To comply through the performance compliance approach, the peak cooling energy of the proposed design cannot be greater than 120% of the peak cooling energy of the standard design. Peak cooling is applicable in climate zones 4 and 8 through 15.

1.7 Compliance for Additions and Alterations

Compliance for additions and alterations to existing buildings requires calculating the energy use of the proposed design, -energy use and the energy budget of the standard design-energy budget.

When the energy use of the proposed design is equal to or less than the energy budget of the standard design, the addition or alteration or both comply with the standards2025 Energy Code. The compliance margin is the difference between the energy use of the standard design energy use-time dependent valuation (LSCTDV) and the energy budget of the proposed design-energy use (LSCTDV). When the compliance margin is zero or greater, the project complies.

The energy use is expressed in units of thousand TDV (kTDV)_{LSC} per square foot of conditioned floor area (kTDV_{LSC}/ft²) and accounts for regulated energy end uses, including space heating, space cooling, ventilation, and water heating. Unregulated energy end uses are not included, such as interior lighting, appliances, cooking, plug loads, and exterior lighting. PV generation and demand flexibility measures, such as battery energy storage system (BESS), have no effect on additions and alterations to existing buildings.

Energy Design Rating

There are two independent EDR metrics based on source energy and TDV. The EDR metric based on source energy is referred to as *EDR1*, and the EDR metric based on TDV is referred to as *EDR2*. No tradeoffs are allowed between EDR1 and EDR2.

Energy Design Rating 1 (EDR1)

EDR1 is a dimensionless metric based on the hourly source energy consumption of a proposed or standard design divided by the hourly source energy consumption of the reference design. EDR1 accounts for the source energy of all end uses, including space heating, space cooling, ventilation, and water heating, interior lighting, appliances, exterior lighting, PV generation and flexibility measures, as well as the Renewables Portfolio Standards (RPS) and similar obligations.

In addition to efficiency, projects receive EDR1 benefits from generating renewable energy and shifting energy demand to times when the utility generates low-carbon electricity. The EDR1 is a way to express the energy performance of a building using a scoring system where 100 represents the energy performance of a reference design building meeting the efficiency requirements of the *2006 International Energy Conservation Code (IECC)*. A lower EDR1 score represents less source energy use. The proposed building must have an EDR1 score that is equal to or less than the EDR1 score of the standard design.

The physical bounds for source energy are about 10,500 British thermal units per kilowatt-hour (Btu/kWh) upper bound (proxy low-efficiency power plant) and 0 Btu/kWh lower bound (renewable generation). Delivery losses are the same as the delivery losses used for TDV.

Avoided source energy from incremental renewable generation varies based on RPS goals. This source energy is represented as an RPS percentage value that increases annually. The avoided source energy can further vary based on the specific resource used, such as wind, solar or energy storage.

Natural gas long-run source energy is based on the percentage of renewable gas used by utilities. Increased use of renewable gas will decrease the source energy impact of retail natural gas consumption.

Propane long-run source energy does not vary annually because there are no renewable gas offsets that can be used to support propane. The long-run marginal source energy of

propane is constant and considered to be the source energy of propane gas. This long-run marginal source energy is calculated as a direct conversion factor of 100-kBtu/therm.

The hourly source energy determined by the CEC is used to determine compliance.

Energy Design Rating 2 (EDR2)

EDR2 is a dimensionless metric based on the TDV energy consumption of a proposed or standard design divided by the TDV energy consumption of the reference design.

The EDR2 is a way to express the energy performance of a building using a scoring system where 100 represents the energy performance of a reference design building meeting the efficiency requirements of the *2006 IECC*. The EDR2 is similar to the energy rating index in the *2014 Residential Energy Services Network (RESNET)* standard. A score of zero represents a building that has zero-net energy consumption based on the TDV energy consumption. By combining high levels of energy efficiency with renewable energy generating or demand flexibility measures, a score of zero or less could be achieved.

Buildings complying with the current California Building Energy Efficiency Standards are more efficient than the 2006 IECC, so most newly constructed buildings will have EDR2 scores below 100. Buildings with renewable generation can achieve a negative score. If an EDR2 is calculated for an older, inefficient home, the score would be more than 100.

The Total EDR2 is composed of two components, Efficiency EDR2 and PV/flexibility EDR2.

The efficiency EDR2 is based on the energy efficiency features of the building. PV/flexibility EDR2 includes the effects of the PV system, battery storage system, precooling, and other demand responsive measures. Total EDR2 combines the efficiency EDR2 and PV/flexibility EDR2 into one final score.

The efficiency EDR2 does not include solar electric generation but can include a self-utilization credit for batteries. The total EDR2 includes the effects of solar generation and any battery storage beyond the self-utilization credit.

1.8 Self-Utilization Credit

When a PV system is coupled with a battery storage system BESS, the compliance software allows a portion of the PV/flexibility photovoltaic and BESS EDR2 LSC and Source to be traded against the Efficiency EDR2 LSC and Source. This modest credit can be used for tradeoffs against building envelope and efficiencies of the equipment installed in the building. More detail is provided in 2.1.5 Self-Utilization Credit. Section 2.1.5.6 "Self-Utilization Credit."

— Demand Response

Appropriate demand response controls allow building operators to reduce LSCTDV energy by automating the response of a building to changes in utility costs. Demand response is an increasingly important function as distributed energy resources become more common, as customers have access to time-of-use (TOU) electricity rates, and incentive programs

are designed to encourage customers to reduce energy use during peak demand. Demand response occurs on a range of timescales from seconds to seasons and represents any demand change in response to grid or economic needs.

1.9 Heat Pump Water Heating Load Shifting

Any Reference Appendices, Joint Appendix JA13-compliant HPWH will receive LSC credit for each climate zone according to **Error! Reference source not found.** Table 25: JA13 HPWH Basic Control Credit. The LSC percentage reduction is applied upon the completion of the compliant simulation run. Note that this reduction only applies to the water heating LSC values.

Table 125: JA13 HPWH Basic Control Credit


<u>Climate Zone</u>	<u>JA13 Credit (%)</u>
<u>1</u>	<u>6.7</u>
<u>2</u>	<u>3.7</u>
<u>3</u>	<u>7.6</u>
<u>4</u>	<u>4.0</u>
<u>5</u>	<u>8.5</u>
<u>6</u>	<u>6.8</u>
<u>7</u>	<u>8.8</u>
<u>8</u>	<u>4.4</u>
<u>9</u>	<u>4.4</u>
<u>10</u>	<u>4.4</u>
<u>11</u>	<u>4.2</u>
<u>12</u>	<u>4.7</u>
<u>13</u>	<u>8.0</u>
<u>14</u>	<u>3.1</u>
<u>15</u>	<u>8.2</u>
<u>16</u>	<u>22.7</u>

1.4.11.10 Precooling

Precooling represents a program where special thermostats in homes receive signals from the local utility that alter the occupant's normal behavior to reduce air-conditioning energy consumption during peak electricity demand periods. The house is pre-cooled to a lower-than-normal set point in the hours preceding the onset of the peak and then the thermostat is returned to the normal setting for the peak period. The thermal mass of the structure and furnishings absorbs the cooling load as the house warms up, allowing the cooling system to remain off for most, or all, of the highest peak period hours.

CBECC-Res Pprecooling simulations alter the thermostat set points only during daylight hours on days when the average daily outdoor temperature is greater than 78° F, and the peak hourly TDVelectricity values are in the top 20 for the yearhigh. On those days, the precooling period thermostat setpoint depends on the predicted outdoor temperature for the day as plotted in Figure 1: Precooling Thermostat Set pointFigure 1.

Figure 1: Precooling Thermostat Set point

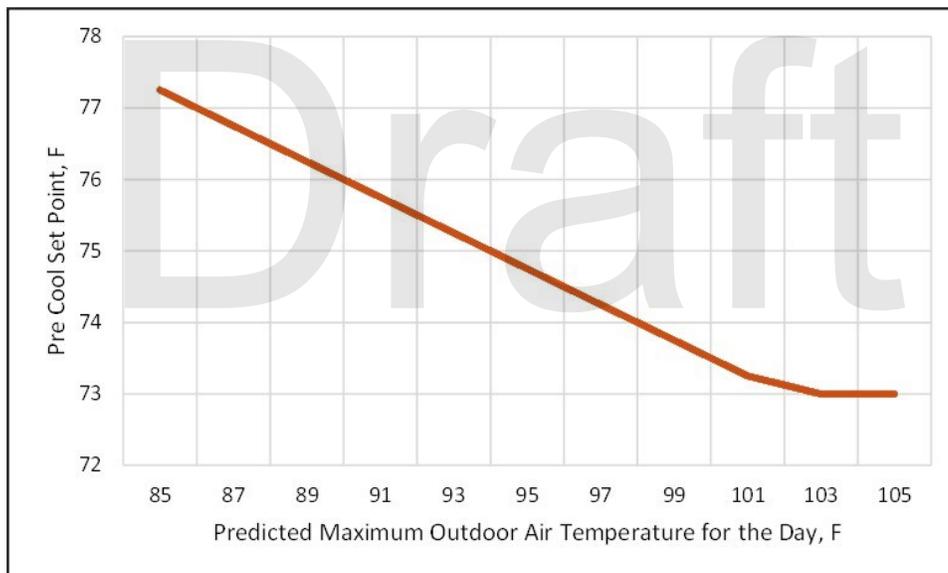

Source: California Energy Commission

The savings compliance credit due to Pprecooling are is reduced to 30% of the LSC value of perfect operation by 70% to account for unreliable occupant behavior that might reduce its effectiveness in real actual homes.

Draft

2 Proposed, and Standard, and Reference Design

2.1 Overview

This chapter describes how the EDRs are calculated, how the proposed design is modeled, and how the standard design is established.

2.1.1 Energy Design Rating

A lower EDR1 score represents lower source energy consumption. The EDR1 score is a metric of the proposed design source energy divided by the reference design source energy budget. An EDR1 score is calculated for the proposed design and a second EDR1 score is calculated for the standard design. The proposed design EDR1 must be equal to or less than the standard design EDR1.

An EDR2 score of zero represents a building that has zero net energy performance based on the TDV energy consumption, and an EDR2 score of 100 represents a building that is minimally compliant with the 2006 International Energy Conservation Code. The EDR2 score is a ratio of proposed design TDV budget to reference design TDV budget.

An Efficiency EDR2 and Total EDR2 score are calculated for the proposed design and a second Efficiency EDR2 and Total EDR2 score are calculated for the standard design. Compliance with EDR2 requires meeting two criteria:

- Proposed design Efficiency EDR2 must be equal to or less than standard design Efficiency EDR2. The EDR2 is established by the ratio of the standard design or proposed design space heating, space cooling, indoor air quality (IAQ) ventilation, water heating, self-utilization credit TDV energy consumption, and the reference design TDV energy consumption of the same end uses.
- Total EDR2 (Efficiency EDR2, plus PV/flexibility EDR2) of the proposed design must be equal to or less than the Total EDR2 of the standard design. The Total EDR2 is established by the ratio of the standard design or proposed design efficiency end uses plus interior lighting, appliances, cooking, plug loads, exterior lighting, and PV generation and flexibility measures TDV energy consumption and the reference design TDV energy consumption of the same end uses.

2.1.2.1.1 Proposed Design

The single-family residential building configuration is defined by the user through entries that include floor areas, wall areas, roof areas, ceiling areas, window areas, skylight areas, and door areas. The user also specifies performance characteristics such as R-values, solar heat gain coefficient (SHGC), solar reflectance, and thermal emittance are required inputs. Information about the orientation and tilt is also required for roofs, and exterior walls. Details about the HVAC and water heating systems, as well as any solar generation systems

and ~~battery storage~~ BESS, are also defined by the user. The user entries for all building elements should be consistent with the actual building design. If the compliance software models the specific geometry of the building by using a coordinate system or graphic entry technique, the data generated should be consistent with the actual building design.

~~2.1.3~~ 2.1.2 Standard Design

The standard design building, from which the energy budget is established, is in the same location and has the same geometry as the proposed design, except the wall and window areas are distributed equally among the four cardinal directions (north, east, south, and west). For additions and alterations, the standard design shall have the same wall and fenestration areas and orientations as the proposed building. The details are described below.

The energy budget for the residential standard design is the energy that would be used by a building ~~similar to that~~ that has all of the same features as the proposed design except the if the proposed building met minimally meets the requirements of the prescriptive standards. The compliance software generates the standard design automatically, based on fixed and restricted inputs and assumptions. Custom energy budget generation shall not be accessible to program users for modification when the program is used for compliance or when the program generates compliance forms.

The basis of the standard design is the prescriptive requirements from the Energy Code Section 150.1(c) of the Energy Code, Table 150.1-A. Prescriptive requirements vary by climate zone. Reference Appendices, Joint Appendix JA2, Table 2-1, contains the 16 California climate zones and representative cities. The climate zone is based on the zip code for the proposed building, as documented in JA2.1.1.

The following sections present the details of how the proposed design and standard design are determined. For many modeling assumptions, the standard design is the same as the proposed design. When a building has special features, for which the CEC has established alternate modeling assumptions, the standard design features will differ from the proposed design, so the building receives appropriate credit for its efficiency. When measures require verification by a ~~Home Energy Rating System (HERS)~~ Energy Code Compliance (ECC) rater or are designated as a *special feature*, the specific requirement is listed on the CF1R.

~~2.1.4~~ Reference Design

The reference design is calculated using the same inputs, assumptions, and algorithms as the standard design except for the following requirements:

- ~~Air handler power. The air handler power is 0.8 watts per cubic feet of airflow per minute (W/CFM).~~
- ~~Air infiltration rate. The air infiltration rate is 7.2 air changes per hour at 50 pascals of pressurization (ACH50).~~
- ~~Cooling airflow. The air handler airflow is 300 cubic feet of airflow per minute per ton of cooling capacity (CFM/ton).~~

- ~~Duct R value. The duct R value is R-8.~~
- ~~Duct leakage rate. The duct leakage rate is modeled as a heating, ventilation, and air-conditioning (HVAC) distribution efficiency of 80 percent.~~
- ~~Quality insulation installation (QII). QII is modeled as "Yes."~~
- ~~Wall construction. Climate Zones 2-15 have 2x4 R-13 walls. Climate Zones 1 and 16 have 2x6 R-19 walls.~~
- ~~Roof/ceiling construction. Climate Zones 2-15 have R-30 ceiling. Climate Zones 1 and 16 have R-38 ceiling. No climate zones include radiant barriers or cool roofs.~~
- ~~Raised floor construction. Climate Zones 2-15 have 2x10 R-19 floors. Climate Zones 1 and 16 have 2x10 R-30 floors.~~
- ~~Slab edge insulation. Climate Zones 1 and 16 include R-10 insulation 24 inches deep.~~
- ~~Window U factors. Climate Zones 2-15 have 0.65 U factor. Climate Zones 1 and 16 have 0.35 U factor.~~
- ~~Window SHGC. All windows have 0.4 SHGC.~~
- ~~Window area. When the window area is below 18 percent of the floor area, the reference design has the same area as the proposed design. Above 18 percent, the reference design has 18 percent.~~
- ~~HVAC equipment efficiencies. HVAC equipment meets National Appliance Energy Conservation Act (NAECA) requirements in effect in 2006 such as 78 percent AFUE for gas central furnace, and 13 SEER for central air conditioning.~~
- ~~Water heating efficiency. Water heating modeled as a 40-gallon storage water with a 0.594 energy factor (EF) if gas or a 0.9172 EF if electric.~~
- ~~Appliance and plug-load energy use and internal gains. Energy use and internal gains for appliance and miscellaneous plug loads are modeled as specified the ANSI/RESNET/ICC 301-2014 Standard.~~

2.1.52.1.3 Photovoltaics Requirements

The PV system requirements are applicable to newly constructed single-family residential buildings and described as specified in Section 150.1(c)14. PV system details are from PVWatts, which is a web application based on the publicly available System Advisor Model algorithms developed by the National Renewable Energy Laboratory. See Appendix F for more information.

STANDARD DESIGN

The standard design PV system (based on California flexible installation [CFI] assumptions) is sized according to the prescriptive table in xxx meet the requirements of Section 150.1(c)14. to generate enough electricity to offset the entire annual electricity consumption for a mixed-fuel building that meets all the 2022 prescriptive requirements.

The compliance summary tab in CBECC Res provides energy consumption information for the building, including photovoltaic and battery systems (Figure 2: Energy Use Details).

For PV system sizing calculations, the compliance software assumes The standard design is based on an azimuth of the CFI orientation 170 degrees, standard efficiency for modules, inverter efficiency of 96 percent, fixed tracking, standard zero (excluding horizon) shading no shading except for horizon shading, roof tilt of 22.61 degrees (5:12 pitch), and annual solar access percentage of 98 percent.

PROPOSED DESIGN

The proposed PV system is input by the user including sized to offset the entire annual electricity consumption of the proposed design.

For PV sizing calculations, the software includes by user-defined values for:

- Array orientation azimuth of the actual installation, or including choosing CFI1 (installation of 150–270 degrees), or CFI2 (installation of 105-300 degrees) or the actual orientation.
- Module type, including standard (for example, poly- or monocrystalline silicon modules), premium (for example, high-efficiency monocrystalline silicon modules with anti-reflective coatings), or thin film (in other words, low efficiency such as 11 percent).
- Inverter efficiency.
- Array tilt in degrees or rRoof pitch of the actual installation, or choosing CFI1 or CFI2 (installation up to 7:12).
- CFI2 reduces PV production by 10% compared to CFI1. To meet the Total LSC, the difference can be made up by increasing PV size by 10% or increasing energy efficiency features or through battery storage.
- Array tracking type including fixed, single-axis tracking, and two-axis tracking.
- Annual solar access percentage, excluding horizon shading, of the modules.

The PV system size is reported in kWdc.

Figure 2: Energy Use Details

Compliance Summary CO2 Emissions Energy Design Rating Energy Use Details CO2 Details										
End Use	Standard Design:				Proposed Design:				Compliance Margins:	
	Site (kWh)	Site (therms)	EDR1 (kBtu/ft ² -yr)	EDR2 (kTDV/ft ² -yr)	Site (kWh)	Site (therms)	EDR1 (kBtu/ft ² -yr)	EDR2 (kTDV/ft ² -yr)	EDR1 (kBtu/ft ² -yr)	EDR2 (kTDV/ft ² -yr)
Space Heating	105	154.6	6.63	29.08	106	156.2	6.69	29.32	-0.06	-0.24
Space Cooling	329		0.44	15.60	230		0.31	11.16	0.13	4.44
IAQ Ventilation	277		0.33	3.56	277		0.33	3.56	0.00	0.00
Water Heating	1,188		1.39	14.67	1,302		1.61	16.42	-0.22	-1.75
Self Util/Flexibility Credit								0.00		0.00
Compliance Total			8.79	62.91			8.94	60.46	-0.15	2.45
Photovoltaics	-4,397		-1.09	-36.96	-4,397		-1.09	-36.89		3.0%
Battery					131		-1.74	-12.00		
Flexibility										
Inside Lighting	506		0.74	7.43	506		0.74	7.43		
Appl. & Cooking	944	43.1	2.86	19.63	944	43.1	2.86	19.63		
Plug Loads	2,026		2.59	27.07	2,026		2.59	27.07		
Exterior	120		0.19	1.72	120		0.19	1.72		
TOTAL	1,098	197.7	14.08	81.80	1,244	199.3	12.49	65.42		

Total PV (kWh): 4,398 Total Export (kWh): 1,112 % Export: 25.3
 * PV System resized to 2.81 kWdc (a factor of 1.406) to achieve 'Standard Design PV' PV scaling

Source: California Energy Commission

COMMUNITY SOLAR

For projects that use an approved Neighborhood Solar Shares (NSS) program to provide the required PV system, click the "Use Community Solar" checkbox on the EDR/PV tab and select the NSS program from the drop-down list. The compliance software will automatically use the PV characteristics of the NSS program site and system to size the required NSS shares PV-system for the building.

Figure 223: Community Solar

The screenshot shows two instances of a software interface. The top instance has tabs for 'Project', 'Analysis', 'EDR / PV', 'Battery', 'Notes', 'Building', 'Appliances / DHW', 'ADU', and 'IAQ'. The 'Use Community Solar' checkbox is checked, and the 'Project' dropdown menu is open, showing '- select CS project -'. The bottom instance has tabs for 'Project', 'Analysis', 'PV', 'Battery', 'Notes', 'Building', 'Appliances / DHW', 'ADU', and 'IAQ'. The 'Use Community Solar' checkbox is also checked, and the 'Project' dropdown menu is open, showing '- select CS project -'.

Source: California Energy Commission

Exceptions to the PV Requirements

- No PV system is required if the solar access roof area (SARA) is less than 80 contiguous square feet. The SARA of the building is described in Section 150.1(c)14 of the Energy Code.
- No PV system is required when the minimum PV system size specified by Section 150.1(c)14 of the Energy Code is less than 1.8 kW_{dc}.

- Buildings with enforcement authority approved roof designs, where the enforcement authority determines it is not possible for the PV system—including panels, modules, components, supports, and attachments to the roof structure—to meet the requirements of the American Society of Civil Engineers (ASCE), Standard 7-16, Chapter 7, Snow Loads.
- For buildings that are approved by the local planning department before January 1, 2020, with mandatory conditions for approval, shading from roof designs and configurations for steep-sloped roofs, which are required by the mandatory conditions for approval, shall be considered for the annual solar access calculations and roof areas that are not allowed by the mandatory conditions for approval to have PVs shall not be considered in determining the SARA.
- PV system sizes determined using Equation 150.1-C may be reduced by 25 percent if installed in conjunction with a battery storage system. The battery storage system shall meet the qualification requirements specified in Joint Appendix JA12 and have a minimum usable capacity of 7.5 kWh.

When the solar electric generation system meets one of the prescriptive exceptions in Section 150.1(c)14, the standard design is modeled with an appropriately sized a PV system dictated by the exception limit. The proposed design is modeled with a system size shall that does not exceed the PV size required by the standard design. When the solar electric generation system size is determined based on a limited SARA, the proposed design system size shall not exceed the SARA-determined size.

VERIFICATION AND REPORTING

The PV system details are reported as special features on the CF1R.

Specifying Target Energy Design Rating

The software provides the option of specifying a PV size based on a user-specified target EDR. When this option is selected, the software calculates the required PV size based on the following parameters:

- The user-defined target EDR $\times 2$
- The size of the battery storage system and the battery control strategy
- The proposed annual kWh budget of the building

2.1.4 Battery Energy Storage System

Detailed calculations for PV and battery storage BESS are included in Appendices C and D. When a PV system and BESS are included on site, energy generated by the PV system should first prioritize offsetting site energy usage, followed by charging the BESS to be discharged to offset later site energy usage for load shifting, and lastly be sent exporting to the utility grid.

The compliance software provides credit for a battery storage system BESS, dependent on the compliance cycling capacity as specified in Reference Appendices, Joint Appendix JA12, coupled with a PV system array. If specified, the battery storage size compliance cycling

capacity must be 5 kWh or larger. For Part 6 Energy Code compliance, the PV system has no effect on energy efficiency requirements or the Efficiency EDR2 LSC or Source unless a battery storage system BESS is included, and the self-utilization credit is modeled.

The compliance including a battery storage system allows downsizing the PV system to reach a specific EDR2 target.

Software includes a checkbox option to allow excess PV system generation credit for above-code programs to the extent that excess generation is allowed by the utility. This option, combined with a battery storage system BESS, allows any PV system size with to impact full EDR2 Total LSC and Source Energy credit.

BATTERY ENERGY STORAGE SYSTEM CONTROLS

The default control strategy used is the basic control strategy as described in Referenced Appendices, Joint Appendix JA12.

The controls for separate energy storage systems BESS strategy as described in Reference Appendices, Joint Appendix JA12 is provided as an alternative control strategy when an energy storage system is installed separate from an on-site solar photovoltaic system.

The three control options available are:

- **Basic (Default Control).** A simple control strategy that provides a modest credit. The software assumes that the batteries are charged anytime PV generation (generation) is greater than the house load (load); conversely, the batteries are discharged when load exceeds generation. This control strategy does not allow the batteries to discharge into the grid.
- **Time of Use.** To qualify for the TOU control, the battery storage system shall be installed in the default operation mode to allow charging from an on-site PV system or from the utility grid if a stand-alone battery storage system. The battery storage system shall begin discharging during the highest priced TOU hours of the day, which varies by time of the year and the local utility. At a minimum, the system shall be capable of programming three seasonal TOU schedules, such as spring, summer, and winter. This option allows discharging directly into the grid.
- **Advanced Demand Flexibility Control.** To qualify for the advanced demand flexibility control, the battery storage system shall be programmed by default as basic control or TOU control, as described above. The battery storage control shall meet the demand responsive control requirements specified in Section 110.12(a). The battery storage system shall have the capability to change the charging and discharging periods in response to signals from the local utility or a third-party aggregator. Upon receiving a demand response signal from a grid operator, this option allows discharging directly into the grid.

VERIFICATION AND REPORTING

The PV required size and battery system storage BESS details are reported as special features on the CF1R.

2.1.5 Self-Utilization Credit

The 2022 Energy Code does not allow a tradeoff between the Efficiency EDR2LSC and Source and the effect of the PV system on the Total EDR2LSC/Source unless battery storage BESS is provided. When the PV system is coupled with at least a 5 kWh battery storage system JA12 BESS, the compliance software allows a portion of the PV/flexibility photovoltaic and BESS EDR2LSC and Source to be traded against the Efficiency EDR2LSC/Source. A modest self-utilization credit can be used for tradeoffs against building envelope and efficiencies of the equipment installed in the building (Table 2: Self Utilization Credits Table 1: Self Utilization Credits Table 1). A checkbox is provided in the compliance software to enable this credit.

The magnitude of the credit is equal to the 90 percent of the difference between the 20252 and 2016 Standards envelope requirements, including:

The following envelope features were used to represent the 2016 Standards:

- Below-deck batt roof insulation value of R-19 for the 2022 Standards, and R-13 for the 2016 Standard climate zones 4 and 8 – 16.
- Wall U-factor of 0.048 for the 2022 Standards and U factor of 0.051 for the 2016 Standards climate zones 1 – 5 and 8 – 16 and U-factor of 0.065 for climate zones 6 and 7.
- Window U-factor of 0.3027 for the 20252 Standards, and window U factor of 0.32 for the 2016 Standards climate zones 1 – 16.
- In cooling climate zones, Window SHGC of 0.23 for the 20252 Standards, and 0.25 for the 2016 Standards climate zones 2, 4, and 6-16, and not required in climate zones 1, 3, and 5.
- QII requirement in the 2022 standards, and No QII requirements in the 2016 Standards.

The following envelope features were used to represent the 2025 Standards:

- Below-deck batt roof insulation value of R-19 for climate zones 4 and 8-16.
- Wall U-factor of 0.048 for climate zones 1 – 5 and 8 – 16 and U-factor of 0.065 for climate zones 6 and 7.
- Window U-factor of 0.27 for climate zones 1 – 5, 11 – 14 and 16, and U-factor of 0.30 for climate zones 6 – 10 and 15.
- Window SHGC of 0.23 in climate zones 2, 4, and 6-14, SHGC of 0.20 for climate zone 15, and not required in climate zones 1, 3, 5, and 16.
- QII required in all climate zones.

Table 21: Self Utilization Credits

Climate Zone	Single-Family
01	<u>10</u> 13%
02	<u>7</u> 11%
03	<u>10</u> 11%
04	<u>9</u> 11%
05	<u>13</u> 11%
06	<u>8</u> 4%
07	<u>4</u> 6%
08	<u>10</u> 16%
09	<u>10</u> 13%
10	<u>10</u> 13%
11	<u>10</u> 13%
12	<u>10</u> 14%
13	<u>10</u> 12%
14	<u>10</u> 12%
15	<u>9</u> 11%
16	12%

Source: California Energy Commission

Carbon Dioxide Emissions

For every hour of the year, the compliance software calculates all energy end uses in the house, including HVAC, water heating, indoor air quality (IAQ), plug loads, appliances, inside and exterior lighting, and PV system generation. Based on these hourly calculations, the software calculates photovoltaic-PV electricity generation that serves the house loads (which reduces the electricity purchased from the grid) and the hourly exports back to the grid. Next, the software applies source energy factors that represent the carbon dioxide (CO₂) generation characteristics of the grid to the hourly kWh balances to calculate the CO₂ generation for each hour of the year. Finally, the software totals the hourly results to yield the annual CO₂ emissions in metric tons per year.

The software reports CO₂ generation for:

1. Total CO₂ generation.
2. CO₂ generation excluding exports to the grid (self-use only).

Peak Cooling kWh

2.2 The Building

PROPOSED DESIGN

The building is defined through entries for zones, surfaces, and equipment. Zone types include attic, conditioned space, crawl space, basements, and garages. The roof is defined as either part of the attic or part of a cathedral ceiling (also called a *rafter roof*). The software models surfaces separating conditioned space from exterior or unconditioned spaces (such as a garage or storage) as interior surfaces adjacent to the unconditioned zone. Exterior surfaces of an attached garage or storage space are modeled as part of the unconditioned zone.

The input file will include entries for floor areas, wall, door, roof and ceiling areas, and fenestration and skylight areas, as well as the water-heating, space-conditioning, ventilation, and distribution systems.

Each surface area is entered along with performance characteristics, including building materials, U-factor, and SHGC. The orientation and tilt (Figure 3: Surface Definitions~~Figure 4: Surface Definitions~~) are required for envelope elements.

Building elements are to be consistent with the actual building design and configuration.

STANDARD DESIGN

To determine the standard design for single-family residential buildings, the compliance software creates a building with the same general characteristics (number of stories, attached garage, climate zone) and with wall and window areas distributed equally among the four cardinal directions. Envelope and HVAC performance inputs are set to the prescriptive requirements in Section 150.1(c) and Table 150.1-A for single-family residential buildings. For additions and alterations, the standard design for existing features in the existing building shall have the same wall and fenestration areas and orientations as the proposed building. The details are below.

VERIFICATION AND REPORTING

All inputs that are used to establish compliance requirements are reported on the CF1R for verification.


~~REFERENCE DESIGN~~

~~To determine the reference design for single-family residential buildings, a building with the same general inputs, assumptions, and algorithms as the standard design building is modeled except for the following requirements:~~

- ~~• Duct R-value. The duct R-value is R-8.~~
- ~~• Wall construction. Climate Zones 2-15 have 2x4 R-13 walls. Climate Zones 1 and 16 have 2x6 R-19 walls.~~
- ~~• Roof/ceiling construction. Climate Zones 2-15 have R-30 ceiling. Climate Zones 1 and 16 have R-38 ceiling. No climate zones include radiant barriers or cool roofs.~~

- Floor construction. Climate Zones 2–15 have 2x10 R-19 floors. Climate Zones 1 and 16 have 2x10 R-30 floors.
- Slab edge insulation. Climate Zones 1 and 16 include R-10 insulation 24 inches deep.
- Window U factors. Climate Zones 2–15 have a U factor of 0.65. Climate Zones 1 and 16 have a U factor of 0.35.
- Window SHGC. All windows have 0.40 SHGC.
- Window area. When the window area is below 18 percent of the floor area, the reference design has the same area as the proposed design. Above 18 percent, the reference design has 18 percent.
- HVAC equipment efficiencies. HVAC equipment meets NAECA requirements in effect in 2006 such as 78 percent AFUE for gas central furnace, and 13 SEER for central AC.
- Water heating efficiency. Water heating modeled as a 40-gallon storage water with a 0.594 Energy Factor (EF) if gas, or a 0.9172 EF if electric.

Figure 334: Surface Definitions

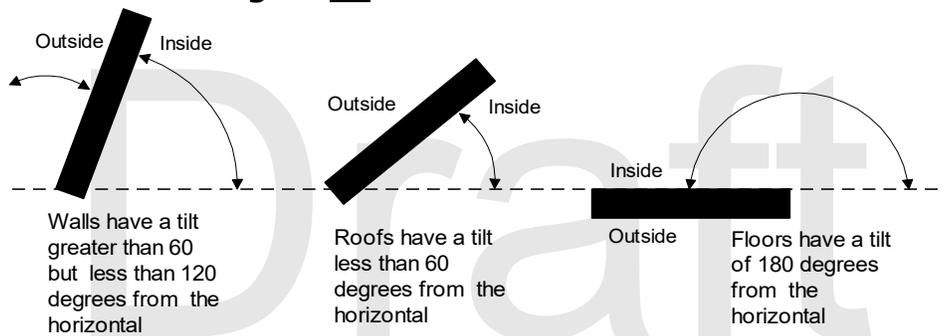

Source: California Energy Commission

2.2.1 Climate and Weather

PROPOSED DESIGN

The user specifies the climate zone based on the zip code of the proposed building. Compliance requirements, weather, design temperatures, and TDV_{LSC} of energy factors are a function of the climate zone. Compliance software assumes that the ground surrounding residential buildings has a reflectivity of 20 percent in summer and winter.

STANDARD DESIGN

The standard design climate zone is the same as the proposed design.

VERIFICATION AND REPORTING

The zip code and climate zone of the proposed design are reported on the CF1R for verification.

2.2.2 Standards Version

This input determines the appropriate federal appliance efficiency requirements for the standard design to compare with the proposed design.

PROPOSED DESIGN

The user inputs Compliance 20263.

STANDARD DESIGN

The standard design cooling and heating equipment efficiency is based on the federal requirements where applicable. A minimum SEER/SEER2 and, EER/EER2, HSPF2, Annual Fuel Utilization Efficiency (AFUE) (ifas applicable) that meet the current standard for the type of equipment are modeled.

For heat pumps less than 45,000 BTU the EER2 in the standard design is based on the EER2 of the equipment in the proposed design. When the EER2 of the equipment in the proposed design is below 11.7, then the EER2 in the standard design is equal to the EER2 of the equipment in the proposed design. When the EER2 of the equipment in the proposed design is 11.7 or greater, then the EER2 of the standard design is 11.7. Consequently, the maximum EER2 of heat pump equipment for cooling in the standard design is 11.7.

For heat pumps 45,000 BTU or larger, the EER2 in the standard design is based on the EER2 of the equipment in the proposed design. When the EER2 of the equipment in the proposed design is below 11.2, then the EER2 in the standard design is equal to the EER2 of the equipment in the proposed design. When the EER2 of the equipment in the proposed design is 11.2 or greater, then the EER2 of the standard design is 11.2. Consequently, the maximum EER2 of heat pump equipment for cooling in the standard design is 11.2.

VERIFICATION AND REPORTING

Compliance version is reported on the CF1R.

2.2.3 Existing Condition Verified

These inputs are used for additions and alterations. The standard design for existing conditions varies based on whether the existing conditions are verified by an ~~Home Energy Rating System (HERS)~~ECC rater before construction. See ~~2.10.5 Existing + Addition + Alteration Approach~~ Section 2.10.5 Existing + Addition + Alteration Approach for more information.

PROPOSED DESIGN

The user inputs either yes or no. "Yes" indicates that the existing building conditions has been, or will be, verified by a HERSECC Rater. The default assumption is "no."

STANDARD DESIGN

The standard design assumption is based on the Energy Code Section 150.2(b), Table 150.2-GD. If the user input is "no," the standard design for the existing component is based on the value in the second column (Standard Design Without Third Party Verification of Existing

Conditions Shall be Based On). If the proposed design response is "yes," the standard design value for the existing components is the value in the third column (Standard Design With Third Party Verification of Existing Conditions Shall be Based On).

VERIFICATION AND REPORTING

Verification of existing conditions is a special feature and is reported in the HERSECC-required verification listings on the CF1R.

2.2.4 Air Leakage and Infiltration

Air leakage is a building-level characteristic. The compliance software distributes the leakage over the envelope surfaces in accordance with the building configuration and constructs a pressure flow network to simulate the airflows between the conditioned zones, unconditioned zones, and outside.

Building Air Leakage and Infiltration (ACH50)

The airflow through a blower door at 50 pascals (Pa) of pressure measured in cubic feet per minute is called CFM50. CFM50 multiplied by 60 minutes, divided by the volume of conditioned space, is the air changes per hour at 50 Pa, called ACH50.

Specific data on ACH50 may be entered if the single-family home or townhouse will have verified building air leakage testing.

PROPOSED DESIGN

ACH50 defaults to 5 for newly constructed buildings in single-family houses and townhomes and 7 for all other buildings that have heating and cooling system ducts, or both, outside conditioned space, and for buildings with no cooling system. In single-family homes and townhomes with no ducts in unconditioned space, the default ACH50 is 4.4 and 6.2 for all other buildings.

Specific data on ACH50 may be entered if the single-family home or townhouse will have verified building air leakage testing. User input of an ACH50 that is less than the default value becomes a special feature requiring HERSECC verification.

STANDARD DESIGN

The standard design shall have five ACH50 for single-family homes and seven for other buildings (ducted space-conditioning).

VERIFICATION AND REPORTING

When the user chooses verified building air leakage testing (any value less than the standard design), diagnostic testing for reduced infiltration, with details and target values modeled in the proposed design, is reported in the HERSECC-required verification listing on the CF1R.

Defining Air Net Leakage Distribution

The compliance software creates an air leakage network for the proposed and standard design using the building description. Air leakage is distributed by the compliance software across the envelope surfaces according to the factors in Table 3: Air Leakage Distribution (Percentage of Total Leakage by Surface)~~Table 2: Air Leakage Distribution (Percentage of Total Leakage by Surface)~~Table 2: Air Leakage Distribution (Percentage of Total Leakage by Surface). The air network is insensitive to wind direction. For buildings modeled with multiple conditioned zones, either a 20-square-foot open door or 30-square-foot open stairwell (in a multistory building) is assumed between any two conditioned zones.

**Table 32: Air Leakage Distribution
(Percentage of Total Leakage by Surface)**

Building Configuration	Ceilings	Floors	Exterior Walls	House to Garage
Slab on Grade	50	0	N/A	N/A
Raised Floor	40	10	N/A	N/A
No Garage	N/A	N/A	50	0
Attached Garage	N/A	N/A	40	10

Source: California Energy Commission

The only difference between the air network for the proposed and standard designs is the ACH50 if the user specifies a value lower than the default.

2.2.5 Quality Insulation Installation

The compliance software user may specify quality insulation installation (QII) for the proposed design as “yes” or “no.” The effective R-value of cavity insulation is reduced, as shown in Table 4: Modeling Rules for Unverified Insulation Installation Quality~~Table 3: Modeling Rules for Unverified Insulation Installation Quality~~Table 3 in buildings with no QII. When set to “no,” framed walls, ceilings, and floors are modeled with added winter heat flow between the conditioned zone and attic to represent construction cavities open to the attic. QII does not affect the performance of continuous sheathing in any construction.

PROPOSED DESIGN

The compliance software user may specify compliance with QII. The default is “no” for QII.

STANDARD DESIGN

The standard design is modeled with “yes” for verified QII for newly constructed single-family residential buildings and additions greater than 700 square feet in all climate zones.

VERIFICATION AND REPORTING

The presence of QII is reported in the HERSECC-required verification listings on the CF1R. Verified QII is certified by the installer and field verified to comply with RA3.5. Credit for verified QII applies to ceilings/attics, knee walls, exterior walls, and exterior floors.

For alterations to existing pre-1978 construction, if the existing wall construction is assumed to have no insulation, no wall degradation is assumed for the existing wall.

Table 43: Modeling Rules for Unverified Insulation Installation Quality

Component	Modification
Walls, Floors, Attic Roofs, Cathedral Ceilings	Multiply the cavity insulation R-value/inch by 0.7.
Ceilings Below Attic	Multiply the blown and batt insulation R-value/inch by $0.96 - 0.00347 * R$.
Ceilings Below Attic	Add a heat flow from the conditioned zone to the attic of 0.015 times the area of the ceiling below attic times (the conditioned zone temperature — attic temperature) whenever the attic is colder than the conditioned space.

Source: California Energy Commission

2.2.6 Number of Bedrooms

PROPOSED DESIGN

The number of bedrooms in a building is used to establish the IAQ mechanical ventilation requirements and determine if a building qualifies as a compact building for incentive programs. The number of bedrooms has a direct effect on water heating use.

~~For non-dwelling units, the number of bedrooms is zero. In this case, there is no water heating load.~~

STANDARD DESIGN

The standard design shall have the same number of bedrooms as the proposed design.

VERIFICATION AND REPORTING

The number of bedrooms is reported on the CF1R for use in field verification.

2.2.7 Front Orientation

The input for the building front orientation is the actual azimuth of the front of the building. This azimuth will generally be the side of the building facing the street or where the front door is located. The orientations of the other sides of a building viewed from the outside looking at the front door are called front, left, right, back, or a value relative to the front, and the compliance software calculates the actual azimuth from this input.

For homes that may be built in any orientation, such as a subdivision, multiple orientation compliance can be selected for newly constructed buildings only. When selected the software will model the building using the four cardinal directions (north, east, south, and west).

PROPOSED DESIGN

The user specifies whether compliance is for multiple orientations or a site-specific orientation. For site-specific orientation, the user inputs the actual azimuth of the front in degrees from true north.

STANDARD DESIGN

The compliance software constructs a standard design building that has 25 percent of the proposed model wall and window areas facing each cardinal orientation regardless of the proposed model distribution of wall and window area.

VERIFICATION AND REPORTING

A typical reported value would be "290 degrees." This value would indicate that the front of the building faces north 70° west in surveyors' terms. When compliance is shown for multiple orientations, "all orientations" or "cardinal" is reported as on the CF1R, and the energy use results are reported for four orientations including north, east, south, and west.

2.2.8 Fuel Type

For newly constructed single-family residential buildings, ~~the standard design fuel type is based on the proposed design fuel type.~~ The user specifies natural gas if available (see Energy Code, Section 100.1[b] for definition of Natural Gas Availability), or propane, if natural gas is not available. The user also identifies the fuel type for cooking appliances, clothes dryer, heating equipment, and water-heating equipment. This specification is to establish the LSCFDV values from Reference Appendices, Joint Appendix JA3 used by the compliance software to determine standard and proposed design energy use.

For projects with a run scope of "addition alone," natural gas is available if a gas service line can be connected to the site without a gas main extension. Natural gas is considered available for additions or alteration projects or both if a gas service line is connected to the existing building.

PROPOSED DESIGN

The user specifies either natural gas, or propane.

Standard Design

The standard design assumptions for space heating are as defined in 2.4.1 Heating Subsystems ~~Section 2.4.1 Heating Subsystems~~, and those for water heating are defined in 2.9 Domestic Hot Water (DHW) ~~Section 2.9 Domestic Hot Water (DHW)~~.

2.2.9 Attached Garage

The user specifies whether there is an attached garage. The garage zone is modeled as an unconditioned zone (~~2.8Section 2.8~~ Garage/Storage).

PROPOSED DESIGN

The user specifies whether there is an attached unconditioned space or garage.

STANDARD DESIGN

The standard design has the same assumption as the proposed design.

VERIFICATION AND REPORTING

Features of an attached unconditioned space that affect compliance are reported on the CF1R.

2.2.10 Lighting

The details of the calculation assumptions for lighting loads included in Appendix E are based on the Codes and Standards Enhancement (CASE) report on plug loads and lighting (Rubin 2016, see Appendix F).

PROPOSED DESIGN

Fraction of portable lighting, power adjustment multiplier, and the exterior lighting power adjustment multiplier (watts/ft² — watts per square foot) are fixed assumptions.

STANDARD DESIGN

The standard design lighting is set equal to the proposed design lighting.

VERIFICATION AND REPORTING

No lighting information is reported on the CF1R for compliance with ~~Title 24, Part 6~~ the Energy Code.

2.2.11 Appliances

The details of the calculation assumptions for appliances and plug loads contained in Appendix E are based on the Codes and Standards Enhancement (CASE) report on plug loads and lighting (Rubin 2016, see Appendix F).

PROPOSED DESIGN

All buildings with kitchens are assumed to have a refrigerator, dishwasher, and cooking appliance. Optionally, buildings can have a clothes washer and clothes dryer in the conditioned space. The user can select fuel type as gas or electric for the clothes dryer and cooking appliance.

STANDARD DESIGN

The standard design appliances are set equal to the proposed appliances.

VERIFICATION AND REPORTING

No information for the appliance types listed above is reported on the CF1R for compliance with Title 24, Part 6 the Energy Code.

2.3 Building Materials and Construction

2.3.1 Materials

Only materials approved by the CEC may be used in defining constructions. Additional materials may be added to the compliance manager through an exceptional method application, as outlined in Section 10-109(e) and Section 10-110.

~~Table 5: Materials List~~~~Table 4: Materials List~~ Table 4 shows a partial list of the materials available for construction assemblies.

MATERIAL NAME

The material name is used to select the material for a construction.

THICKNESS

Some materials, such as three-coat stucco, are defined with a specific thickness (not editable by the compliance user). The thickness of other materials, such as softwood used for framing, is selected by the compliance user based on the construction of the building.

CONDUCTIVITY

The conductivity of the material is the steady-state heat flow per square foot, per foot of thickness, or per degree Fahrenheit temperature difference. It is used in simulating the heat flow in the construction.

Table 54: Materials List

Material Name	Thickness (in.)	Conductivity (Btu/h-°F-ft)	Coefficient for Temperature Adjustment of Conductivity (°F (-1))	Specific Heat (Btu/lb-°F)	Density (lb/ft ³)	R-Value per Inch (°F-ft ² -h/Btu-in)
Gypsum Board	0.5	0.09167	0.00122	0.27	40	0.9091
Wood Layer	Varies	0.06127	0.0012	0.45	41	1.36
Synthetic Stucco	0.375	0.2	<u>N/A</u>	0.2	58	0.2
3 Coat Stucco	0.875	0.4167	<u>N/A</u>	0.2	116	0.2
All other siding	<u>N/A</u>	<u>N/A</u>	<u>N/A</u>	<u>N/A</u>	<u>N/A</u>	0.21
Carpet	0.5	0.02	<u>N/A</u>	0.34	12.3	4.1667
Light Roof	0.2	1	<u>N/A</u>	0.2	120	0.0833

Material Name	Thickness (in.)	Conductivity (Btu/h-°F-ft)	Coefficient for Temperature Adjustment of Conductivity (°F (-1))	Specific Heat (Btu/lb-°F)	Density (lb/ft ³)	R-Value per Inch (°F-ft ² -h/Btu-in)
5 PSF Roof	0.5	1	<u>N/A</u>	0.2	120	0.0833
10 PSF Roof	1	1	<u>N/A</u>	0.2	120	0.0833
15 PSF Roof	1.5	1	<u>N/A</u>	0.2	120	0.0833
25 PSF Roof	2.5	1	<u>N/A</u>	0.2	120	0.0833
TileGap	0.75	0.07353	<u>N/A</u>	0.24	0.075	1.1333
SlabOnGrade	3.5	1	<u>N/A</u>	0.2	144	0.0833
Earth	<u>N/A</u>	1	<u>N/A</u>	0.2	115	0.0833
SoftWood	<u>N/A</u>	0.08167	0.0012	0.39	35	1.0204
Concrete	<u>N/A</u>	1	<u>N/A</u>	0.2	144	0.0833
Foam Sheathing	varies	varies	0.00175	0.35	1.5	Varies
Ceiling Insulation	varies	varies	0.00418	0.2	1.5	Varies
Cavity Insulation	Varies	varies	0.00325	0.2	1.5	Varies
Vertical Wall Cavity	3.5	0.314	0.00397	0.24	0.075	<u>N/A</u>
GHR Tile	1.21	0.026	0.00175	0.2	38	<u>N/A</u>
ENSOPRO	0.66	0.03	0.00175	0.35	2	<u>N/A</u>
ENSOPRO Plus	1.36	0.025	0.00175	0.35	2	<u>N/A</u>
Door	<u>N/A</u>	<u>N/A</u>	<u>N/A</u>	<u>N/A</u>	<u>N/A</u>	5

Source: California Energy Commission

COEFFICIENT FOR TEMPERATURE ADJUSTMENT OF CONDUCTIVITY

The conductivity of some materials varies with temperature according to the coefficient listed. Materials that have a coefficient of zero (θ) do not vary with temperature.

SPECIFIC HEAT

The specific heat is the amount of heat in British thermal units (Btu) it takes to raise the temperature of 1 pound of the material 1 degree Fahrenheit (Btu/lb-°F).

DENSITY

The density of the material is the weight of the material in pounds per cubic foot (lb/ft³).

R-VALUE PER INCH

The R-value per inch is the resistance to heat flow for a 1-inch thick material.

2.3.2 Construction Assemblies

“Constructions” are defined by the compliance software user to characterize the envelope performance of the building. The user assembles a construction from one or more layers of materials, as shown in [Figure 4: Example Construction Data Screen](#)~~Figure 4: Example Construction Data Screen~~[Figure 5: Example Construction Data Screen](#). For framed constructions, there is a framing layer that has parallel paths for the framing and the cavity between the framing members. The layers that are allowed depend on the surface type. The compliance manager calculates a winter design U-factor that is compared to a construction that meets the prescriptive standard. The U-factor is displayed as an aid to the user. The calculations used in the energy simulation are based on each layer and framing rather than the U-factor.

Figure 445: Example Construction Data Screen

The screenshot shows a software interface for defining a construction assembly. A large 'Draft' watermark is visible across the center. The interface includes the following elements:

- Construction Data** (tab)
- Currently Active Construction:** R19 R5 Stucco Wall
- Construction Name:** R19 R5 Stucco Wall
- Can Assign To:** Exterior Walls
- Construction Type:** Wood Framed Wall
- Construction Layers (inside to outside):**

	Cavity Path	Frame Path
Inside Finish:	Gypsum Board	Gypsum Board
Sheathing / Insulation:	- no sheathing/insul.	- no sheathing/insul.
Cavity / Frame:	R 19 in 5-1/2 in. cavity (R-18)	2x6 @ 16 in. O.C.
Sheathing / Insulation:	R5 Sheathing	R5 Sheathing
Exterior Finish:	Synthetic Stucco	Synthetic Stucco
- Non-Standard Spray Foam in Cavity
- Winter Design U-value:** 0.051 Btu/h-ft²-°F (meets max code 0.051 U-value (0.051))

Source: California Energy Commission

ASSEMBLY TYPES

The types of assemblies are:

- Exterior wall.
- Interior wall.
- Underground wall.
- Attic roof.
- Cathedral roof.
- Ceiling below attic.
- Interior ceiling.cons
- Interior floor.
- Exterior floor (over unconditioned space or exterior).
- Floor over crawl space.

CONSTRUCTION TYPE

The types of construction are:

Ceiling below attic (the roof structure is not defined here, but is part of the attic), wood-framed. In a residence with a truss roof, the ceiling is where the insulation is located, while the structure above the ceiling is encompassed by the term "attic" or "roof." The attic or roof consists of (from inside to outside) the radiant barrier, below-deck insulation, framing, above-deck insulation, and the roofing product, such as asphalt or tile roofing. See more in 2.6.2Section 2.6.2 Ceiling Below Attic Ceiling Below Attic.

Cathedral ceiling (with the roof defined as part of the assembly), wood-framed. Since there is no attic, the roof structure is connected to the insulated assembly at this point.

Roof, structurally insulated panels (SIP).

Walls (interior, exterior, underground), wood- or metal-framed, or SIP.

Floors (over exterior, over crawl space, or interior).

Party surfaces separate conditioned space included in the analysis from conditioned space not included in the analysis. Party surfaces for spaces not included in the analysis include spaces joining an addition alone to the existing dwelling. Interior walls, ceilings, or floors can be party surfaces.

CONSTRUCTION LAYERS

All assemblies have a cavity path and a frame path.

As assemblies are completed, the screen displays whether the construction meets the prescriptive requirement for that component.

PROPOSED DESIGN

The user defines a construction for each surface type included in the proposed design. Any variation in insulation R-value, framing size or spacing, interior or exterior sheathing, or interior or exterior finish requires the user to define a different construction. Insulation R-values are based on manufacturer-rated properties rounded to the nearest whole R-value. Layers such as sheetrock, wood sheathing, stucco, and carpet whose properties are not compliance variables are included as generic layers with standard thickness and properties.

Walls separating the house from an attached unconditioned attic or garage are modeled as interior walls with unconditioned space as the adjacent zone, which the compliance manager recognizes as a "demising wall." Floors over a garage are modeled as an interior or demising floor. The exterior walls, floor, and ceiling/roof of the garage are modeled as part of the unconditioned garage zone.

STANDARD DESIGN

The compliance software assembles a construction that meets the prescriptive standards for each user-defined construction or assembly.

VERIFICATION AND REPORTING

All proposed constructions, including insulation, frame type, frame size, and exterior finish or exterior condition, are listed on the CF1R. Nonstandard framing (for example, 24" on center wall framing, advanced wall framing) is reported as a special feature.

2.3.3 Spray-Foam Insulation

The R-values for spray-applied polyurethane foam (SPF) insulation differ depending on whether the product is open cell or closed cell. Spray-foam insulation R-values are calculated based on the nominal thickness of the insulation multiplied by the default thermal resistivity per inch, or the total R-value may be calculated based on the thickness of the insulation multiplied by the tested R-value per inch as certified by the Department of Consumer Affairs, Bureau of Household Goods and Services. (See details 2.3.3 Section 2.3.3 Spray-Foam Insulation Spray-Foam Insulation Spray-Foam Insulation and Reference Appendices, Residential Appendix RA3.5.) Additional documentation and verification requirements for a value other than the default values shown in Table 6: Required Thickness Spray-Foam Insulation (in inches) Table 5: Required Thickness Spray-Foam Insulation (in inches) Table 5: Required Thickness Spray-Foam Insulation (in inches) are required. (See details in Reference Appendices, Residential Appendix RA3.5.6.)

Table 65: Required Thickness Spray-Foam Insulation (in inches)

1. Required Equivalent R-values for SPF Insulation	2.11 R-11	3.13 R-13	4.15 R-15	5.19 R-19	6.21 R-21	7.22 R-22	8.25 R-25	9.30 R-30	10.38 R-38
11. Required thickness closed cell @ R5.8/inch	12.2. 002.0 0	13.2. 252.2 5	14.2. 752.7 5	15.3. 503.5 0	16.3. 753.7 5	17.4. 004.0 0	18.4. 504.5 0	19.5. 255.2 5	20.6.756 .75
21. Required thickness open cell @ R3.6/inch	22.3. 03.0	23.3. 53.5	24.4. 24.2	25.5. 35.3	26.5. 85.8	27.6. 16.1	28.6. 96.9	29.8. 38.3	30.10.61 0.6

Source: California Energy Commission

Medium-Density Closed-Cell SPF Insulation

The default R-value for spray-foam insulation with a closed cellular structure is R-5.8 per inch, based on the installed nominal thickness of insulation. Closed-cell insulation has an installed nominal density of 1.5 to 2.5 pounds per cubic foot (pcf).

Low-Density Open-Cell SPF Insulation

The default R-value for spray-foam insulation with an open cellular structure is calculated as R-3.6 per inch, based on the nominal required thickness of insulation. Open-cell insulation has an installed nominal density of 0.4 to 1.5 pounds per cubic foot (pcf).

PROPOSED DESIGN

The user will select either typical values for open-cell or closed-cell spray-foam insulation or higher-than-typical values and enter the total R-value (rounded to the nearest whole value).

STANDARD DESIGN

The compliance software assembles a construction that meets the prescriptive standards for each assembly type (ceiling/roof, wall, and floor).

VERIFICATION AND REPORTING

When the user elects to use higher-than-typical R-values for open-cell or closed-cell spray-foam insulation, a special features note is included on the CF1R requiring documentation requirements specified in Reference Appendices, Joint Appendix JA4.1.7. Furthermore, a HERSECC verification requirement for the installation of spray-foam insulation using higher-than-default values is included on the CF1R.

2.4 Building Mechanical Systems

A space-conditioning system (also referred to as HVAC system) is made up of the heating subsystem (also referred to as "heating unit," "heating equipment," or "heating system");

cooling subsystem (also referred to as “cooling unit,” “cooling equipment,” or “cooling system”); the distribution subsystem details (if any); and fan subsystem (if any). Ventilation cooling systems and indoor air-quality-ventilation systems are defined at the building level for single-family residential buildings. (See also 2.4.10 Section 2.4.10 Indoor Air Quality Ventilation and 2.4.11 Ventilation Cooling System Section 2.4.11 Ventilation Cooling System.)

2.4.1 Heating Subsystems

The heating subsystem describes the equipment that supplies heat to a space-conditioning system. Heating subsystems are categorized according to the types shown in Table 7: HVAC Heating Equipment Types and Table 8: Heat Pump Equipment Types. A conversion factor is used to convert heating seasonal performance factor (HSPF₂) to HSPF₂ ratings for modeling. For split-system, small-duct high-velocity, and space-constrained equipment, the conversion factor is $\frac{1}{0.85}$ to convert HSPF₂ to HSPF₂. For single-package equipment, the conversion factor is $\frac{1}{0.84}$ to convert HSPF₂ to HSPF₂.

Furnace capacity is determined by the compliance software as 200 percent of the heating load at the heating design temperature. Heat pump compressor size is determined by the compliance software as the larger of the compressor size calculated for to meet 110 percent of the cooling load at the cooling design temperature, or the compressor size calculated to meet with a 47 °F rating that is 110 percent of the heating load (at the heating design temperature). If the maximum heat pump heating capacity is insufficient to meet the load during any timestep in the simulation, the unmet portion of the load would be met by backup supplemental heating. Backup supplemental heat is disabled for homes greater than 500 square feet located in Climate Zones 1-6, 8-14, and 16 when the outdoor air temperature is above 35 °F. The exception is that backup heat is disabled when the outdoor air temperature is above 35 °F for homes greater than 500 square feet in all climate zones except Climate Zones 7 and 15. Backup supplemental heat is provided by electric resistance in the standard design. In the proposed design, backup supplemental heat is provided by electric resistance except in the case of dual fuel heat pumps where backup supplemental heat is provided by gas. In the standard design case, the dual fuel heat pump will be disabled when the outside air temperature is below 45 °F, while the user will identify this temperature for the proposed design.

A parasitic load for the heat pump crankcase heater (CCH) is modeled and the capacity is calculated as 33 Watts for systems with a capacity under 3 tons and 11 Watts per ton for systems with a capacity 3 tons or larger. The CCH operates whenever the outdoor dry bulb temperature is below 50°F and the compressor is not operating.

Defrost for the heat pump occurs between 45°F and 17°F outdoor temperature with electric resistance auxiliary heat assumed used to compensate for heat lost during the defrost cycle.

PROPOSED DESIGN

The user selects the type of heating subsystem and supplies required inputs for the heating subsystem, including the appropriately-rated heating efficiency. Except for heat pumps, the rated heating capacity is not used as a compliance variable by the compliance software to size the standard design system.

When the proposed space-conditioning system is a heat pump, the user specifies the rated heating capacity at 47°F and 17°F for the heat-pump compressor. The capacity is used to determine the effect of backup electric resistance heat in the simulation. The specified capacities are listed on the CF1R for verification by a HERS Rater. Crankcase heater energy depends on option selected:

- ~~Occupant controlled smart thermostat (OCST) and disclosure — Model OCST and calculate crankcase heater energy use based on off mode power consumption.~~
- ~~OCST and no disclosure — Model OCST, and calculate crankcase heater energy use based on off mode power consumption assuming on whenever compressor is off.~~
- ~~No OCST and no disclosure — Do not model OCST, and calculate crankcase heater energy use based on off mode power consumption assuming on whenever the compressor is off.~~
- ~~No OCST and disclosure — Don't model OCST, and calculate crankcase heater energy use based on off mode power consumption.~~

STANDARD DESIGN

The standard design heating subsystem is a heat pump if the proposed water heating system is gas-fired in climate zones 3, 4, 13, and 14. Otherwise, the heating system is a gas heating system.

When the standard design is a heat pump, the equipment used in the standard design building is an electric split-system heat pump with default ducts in the attic and a heating seasonal performance factor (HSPF/HSPF2) meeting the current *Appliance Efficiency Regulations* minimum efficiency for heat pumps as defined in the *Appliance Efficiency Regulations*.

The standard design heat pump compressor size is determined by the software as the larger of the compressor size calculated for air conditioning load, or the compressor with a 47°F rating that is 75 percent of the heating load (at the heating design temperature). Crankcase heater energy is calculated as OCST and no disclosure.

When the standard design is a gas heating system, the equipment used in the standard design building is a gas furnace (or propane if natural gas is not available) with default ducts in the attic and an annual fuel utilization efficiency (AFUE) meeting the *Appliance Efficiency Regulations* minimum efficiency for central systems.

See Table 6: Standard Design Heating System for complete details on heating systems noted above.

Table 6: Standard Design Heating System

Proposed Design	Standard Design
Climate Zones 1-2, 5-12, and 15-16	80-percent AFUE central furnace, default duct
Climate Zones 3-4, and 13-14 (if the water heating system is not a gas-fired system)	80-percent AFUE central furnace, default duct
Climate Zones 3-4, and 13-14 (if the water heating system is a gas-fired system)	8.2 HSPF or 7.5 HSPF2 central heat pump, auto-size capacity, default duct

Source: California Energy Commission

VERIFICATION AND REPORTING

The proposed heating subsystem type and rated efficiency are reported in the compliance documentation on the CF1R. For heat pumps, which are supplemented by electric resistance backup heating, the HERS verified rated heating capacity of each proposed heat pump is reported on the CF1R. Installed capacities must be equal to or larger than the capacities reported for modeled at 47° and 17° (RA 3.4.4.2). Measures requiring verification are listed in (Table 10: Summary of Space Conditioning Measures Requiring Verification, and) are also listed in the ECC verification section of on the CF1R.

Table 767: HVAC Heating Equipment Types

Name	Heating Equipment Description
CntrlFurnace	Gas- or oil-fired central furnaces, propane furnaces, or heating equipment considered equivalent to a gas-fired central furnace, such as wood stoves that qualify for the wood heat exceptional method. Gas fan-type central furnaces have a minimum AFUE=80% <u>when manufactured before December 18, 2028</u> and 95% <u>when manufactured on or after December 18, 2028</u> . Distribution can be gravity flow or use any of the ducted systems.
PkgGasFurnace	The furnace side of a packaged air-conditioning system. Packaged gas or propane furnaces have a minimum AFUE=81%. Distribution can be any of the ducted systems.
WallFurnace Gravity	Noncentral gas- or oil-fired wall furnace, gravity flow. Equipment has varying efficiency requirements by capacity. Distribution is ductless.
WallFurnace Fan	Noncentral gas- or oil-fired wall furnace, fan-forced. Equipment has varying efficiency requirements by capacity. Distribution is ductless.
FloorFurnace	Noncentral gas- or oil-fired floor furnace. Equipment has varying efficiency requirements by capacity. Distribution is ductless.

Name	Heating Equipment Description
RoomHeater	Noncentral gas- or oil-fired room heaters. Noncentral gas- or oil-fired wall furnace, gravity flow. Equipment has varying efficiency requirements by capacity. Distribution is ductless.
WoodHeat	Wood-fired stove. In areas with no natural gas available, a wood-heating system with any backup <u>supplemental</u> heating system is allowed to be installed if exceptional method criteria described in the <i>Residential Compliance Manual</i> are met.
Boiler	Gas or oil boilers. Distribution systems can be radiant, baseboard, or any of the ducted systems. Boiler may be specified for dedicated hydronic systems. Systems in which the boiler provides space heating and fires an indirect gas water heater (IndGas) may be listed as Boiler/CombHydro Boiler and is listed under "Equipment Type" in the HVAC Systems listing.
Electric	All electric heating systems other than space-conditioning heat pumps. Included are electric resistance heaters, electric boilers, and storage water heat pumps (air-water) (StoHP). Distribution system can be radiant, baseboard, or any of the ducted systems.
CombHydro	Water-heating system can be any gas water heater. Distribution systems can be radiant, baseboard, or any of the ducted systems and can be used with any of the terminal units (FanCoil, RadiantFlr, Baseboard, and FanConv).
Single-zone dual-fuel heat pump	Single-zone system with constant volume fan, direct expansion heat pump cooling and heating, and gas supplemental heating.

Source: California Energy Commission

Table 878: Heat Pump Equipment Types

Name	Heat Pump Equipment Description
SplitHeatPump	Central split heat pump system. Distribution system is one of the ducted systems.
SDHV-SplitHeat-Pump	Small-duct, high-velocity, central split-system that produces at least 1.2 inches of external static pressure when operated at the certified air volume rate of 220–350 CFM per rated ton of cooling <u>capacity</u> and uses high-velocity room outlets generally greater than 1,000 <u>feet per minute</u> fpm that have less than 6.0 square inches of free area.
Ductless-MiniSplit HeatPump	A heat pump system that has an outdoor section and one or more ductless indoor sections. The indoor section(s) cycle on and off in unison in response to an indoor thermostat.

Name	Heat Pump Equipment Description
Ductless-MultiSplit HeatPump	A heat pump system that has an outdoor section and two or more ductless indoor sections. The indoor sections operate independently and can be used to condition multiple zones in response to multiple indoor thermostats.
DuctlessVRF HeatPump	A variable-refrigerant-flow-(VRF) heat pump system that has one or more outdoor sections and two or more ductless indoor sections. The indoor sections operate independently and can be used to condition multiple zones in response to multiple indoor thermostats.
PkgHeatPump	Central packaged heat pump systems. Central packaged heat pumps are heat pumps in which the blower, coils, and compressor are contained in a single package, powered by single-phase electric current, air-cooled, and rated below 65,000 Btu/h. The distribution system is one of the ducted systems.
<u>LrgPkgHeatPump</u>	<u>Large central packaged heat pump systems, rated above 65,000 Btu/h.</u>
RoomHeatPump	Noncentral room air-conditioning systems. These include packaged terminal (commonly called "through-the-wall") units and any other ductless heat pump systems.
SglPkgVertHeatPump	Single-package vertical heat pump. This is a package air-conditioner that uses reverse cycle refrigeration as the prime heat source and may include secondary supplemental heating by means of electrical resistance.
PkgTermHeatPump	Packaged terminal heat pump. This is a package terminal air-conditioner that uses reverse cycle refrigeration as the prime heat source; has a supplementary heating source available, with the choice of electric resistant heat; and is industrial equipment.
DuctedMiniSplitHeat Pump	Ducted mini-split heat pump is a system that has an outdoor section and one or more ducted indoor sections. The indoor section(s) cycle on and off in unison in response to an indoor thermostat.
DuctedMultiSplitHeat Pump	Ducted multi-split heat pump is a system that has a single outdoor section, and two or more ducted indoor sections. The indoor sections operate independently and can be used to condition multiple zones in response to multiple indoor thermostats.
Ducted+DuctlessMulti SplitHeatPump	Multi-split heat pump system with a combination of ducted and ductless indoor units.

Name	Heat Pump Equipment Description
AirToWater-HeatPump	An indoor conditioning coil, a compressor, and a refrigerant-to-water heat exchanger that provides heating and cooling functions. May also have the ability to heat domestic hot water.
Ground-Source HeatPump	An indoor conditioning coil with air-moving means, a compressor, and a refrigerant-to-ground heat exchanger that provides heating, cooling, or heating and cooling functions. May also have the ability to heat domestic hot water.
Variable-Capacity Heat-Pump	VCHP—Meets all the requirements of the <u>VCHP-Variable Capacity Heat Pump Compliance Option</u> or meets performance values specified in the Northeast Energy Efficiency Partnerships, Inc. (NEEP) database.
Single-zone-dual Fuel-Heat-pump	Single-zone <u>dual fuel heat pump system</u> with constant volume fan, direct expansion heat pump cooling and heating, and gas supplemental heating.
HeatPumpDHWCombo	<u>Combined space heating and domestic water heating system (harvest thermal).</u>

Source: California Energy Commission

-Variable-Capacity Heat Pump

The performance of variable capacity heat pumps (VCHP) depends on outdoor dry bulb temperature, compressor speed, entering air conditions, and equipment controls.

Detailed performance of VCHP equipment shall be based on statistical analysis of entries in the Northeast Energy Efficiency Partnerships, Inc. (NEEP) cold climate air source heat pump database, and AHRI 210/240-2023 certified rating data as described in Appendix H.

Heating performance shall remain constant for temperatures above 47 F. Cooling performance shall be linearly extrapolated for temperatures below 82 F and above 95 F.

All values shall be converted to gross capacities within the model. The operational capacity is defined by the combination of heating or cooling load in the space, heat loss or gain due to duct losses, and heat gain due to air handler fan energy. When the unit is cycled, a degradation coefficient of 0.25 shall be applied for both heating and cooling.

When the capacity required of the VCHP to meet the building load and overcome duct losses is greater than the minimum capacity, it is assumed the VCHP operates continuously using interpolated performance based on the required capacity. When the required capacity is less than the minimum capacity, it is assumed that the VCHP is operating at minimum capacity and cycling. Indoor airflow is assumed to modulate in proportion to the VCHP capacity. If VCHP maximum heating capacity is insufficient to meet the load, it is assumed that the unmet portion of the load will be met by electric resistance heat.

Normalized data from the NEEP database as described in Appendix H shall be used to translate from AHRI certified rating data to full performance at all combinations of compressor speed and outdoor dry bulb temperatures. Appendix H also includes eligibility criteria for modeled VCHPs.

~~The performance of variable capacity heat pumps (VCHP) varies widely depending on a number of factors.~~

~~A simplified compliance option is available. To use this compliance option, the VCHP must meet all the requirements of the VCHP Compliance Option.~~

~~For detailed analysis of VCHP, energy usage for VCHP systems shall be based on minimum and maximum cooling capacity and corresponding input power at hot ambient and mild ambient conditions. The minimum and maximum heating capacity and corresponding input power at cold and ambient conditions shall also be considered. These values are found in the Northeast Energy Efficiency Partnerships, Inc. (NEEP) database. The mandatory efficiencies of HSPF/HSPF2, SEER/SEER2, and EER/EER2 are also considered for verification purposes. These values shall be considered as follows, or through an approved method showing minimum energy equivalency.~~

~~VCHP performance at specific at a specific heating or cooling load is calculated by interpolating between the minimum and maximum performance indicated in the NEEP data. For outdoor conditions outside the range represented in the NEEP data, extrapolation, assuming a linear relationship, is used. To account for variations in indoor conditions, the algorithm applies the same variation as it does for single speed systems normalized to take out the effect of the outdoor temperature.~~

~~The operational capacity is defined by the combination of the heating or cooling load in the space, heat loss or gain due to duct losses, and heat gain due to air handler fan energy. When the capacity required of the VCHP to meet the building load and overcome duct losses is greater than the minimum capacity, it is assumed the VCHP operates continuously. When the required capacity is less than the minimum capacity, it is assumed that the VCHP is operating at minimum capacity and cycling. When the unit is cycled, a degradation coefficient of 0.25 shall be applied for both heating and cooling. Indoor airflow is assumed to modulate in proportion to the VCHP capacity.~~

~~If VCHP maximum heating capacity is insufficient to meet the load, it is assumed that the unmet portion of the load will be met by electric resistance heat. Defrost occurs between 35°F and 17°F outdoor temperature with electric resistance auxiliary heat assumed to compensate for heat lost during the defrost cycle. The crankcase heater is assumed to operate at 40 W whenever the temperature is below 50°F.~~

2.4.2 Combined Hydronic Space/Water Heating

Combined hydronic space/water heating is a system whereby a water heater is used to provide space heating and water heating. Dedicated hydronic space-heating systems are

also a modeling capability. Space-heating terminals may include fan coils, baseboards, and radiant floors.

For combined hydronic systems, the water-heating portion is modeled normally. For space heating, an effective AFUE is calculated for gas water heaters. For electric water heaters, an effective HSPF/HSPF2 is calculated. The procedures for calculating the effective AFUE or HSPF/HSPF2 are described below.

Combined hydronic space-conditioning cannot be combined with heat pump water heating or with zonal control credit.

PROPOSED DESIGN

When a fan coil is used to distribute heat, the fan energy and the heat contribution of the fan motor must be considered. The algorithms for fans used in combined hydronic systems are the same as those used for gas furnaces and are described in Appendix G.

If a large fan coil is used and air-distribution ducts are in the attic, crawl space, or other unconditioned space, the efficiency of the air-distribution system must be determined using methods consistent with those described in [2.4.7 Section 2.4.7 Distribution Systems Distribution Subsystems](#). Duct efficiency is accounted for when the distribution type is ducted.

Commercial or Consumer Storage Gas Water Heater

When storage gas water heaters are used in combined hydronic applications, the effective AFUE is given by the following equation:

$$AFUE_{eff} = RE - \frac{PL}{RI} \quad \text{Equation 1}$$

Where:

$AFUE_{eff}$ = The effective AFUE of the gas water heater in satisfying the space heating load.

RE = The recovery efficiency (or thermal efficiency) of the gas storage water heater. A default value of 0.70 may be assumed if the recovery efficiency is unknown. This value is generally available from the CEC appliance directory.

PL = Pipe losses (kBtu/h). This can be assumed to be zero when less than 10 feet of piping between the water heater storage tank and the fan coil or other heating elements are in unconditioned space.

RI = The rated input of the gas water heater (kBtu/h) available from the CEC appliance directory.

Instantaneous Gas Water Heater

When instantaneous gas water heaters are used in combined hydronic applications, the effective AFUE is given by the following equation:

$$AFUE_{eff} = UEF_{gas} \text{ Equation 2}$$

Where:

$AFUE_{eff}$ = The effective AFUE of the gas water heater in satisfying the space heating load.

UEF = The rated uniform energy factor of the instantaneous gas water heater.

Storage Electric Water Heater

The effective HSPF2 of the storage electric water heaters used for space heating in a combined hydronic system is given by the following equations.

$$HSPF2_{eff} = 3.413 \left(1 - \frac{PL}{3.413 \times kW_i} \right) \text{ Equation 3}$$

Where:

$HSPF2_{eff}$ = The effective HSPF2 of the storage electric water heater in satisfying the space-heating load.

PL = Pipe losses (kBtu/h). Assumed zero when less than 10 feet of piping between the water heater storage tank and the fan coil or other heating elements are in unconditioned space.

kW_i = The kilowatts of input to the water heater available from the CEC's appliance directory.

STANDARD DESIGN

When a hydronic system used for heating is proposed to use electricity, the heating equipment for the standard design is an electric split-system heat pump with an HSPF2 meeting the *Appliance Efficiency Regulations* requirements for split-systems. The standard design heat pump compressor size is determined by the compliance software based on the compressor size calculated for the air-conditioning system.

When electricity is not used for heating, the equipment used in the standard design building is a gas furnace (or propane if natural gas is not available) with default ducts in the attic and an AFUE meeting the *Appliance Efficiency Regulations* minimum efficiency for central systems. When a proposed design uses electric and non-electric heat, the standard design is a gas furnace.

2.4.3 Special Systems — Hydronic Distribution Systems and Terminals

Hydronic distribution systems in unconditioned spaces are included in the building model to account for heat loss to these unconditioned spaces. Heat loss is affected by the length of piping in unconditioned spaces, pipe size, pipe insulation thickness, and pipe insulation R-value.

PROPOSED DESIGN

This listing is completed for hydronic systems that have more than 10 feet of piping (plan view) in unconditioned space. As many rows as necessary may be used to describe the piping system.

STANDARD DESIGN

The standard design is established for a hydronic system in the same way as for a central system, as described in 2.4.1 Section 2.4.1 Heating Subsystems Heating Subsystems.

VERIFICATION AND REPORTING

A hydronic or combined hydronic system is reported on the CF1R.

Other information reported includes:

Piping Run Length (ft). The length (plan view) of distribution pipe in unconditioned space, in feet, between the primary heating/cooling source and the point of distribution.

Nominal Pipe Size (in.). The nominal (as opposed to true) pipe diameter in inches.

Insulation Thickness (in.). The thickness of the insulation in inches. Enter "none" if the pipe is uninsulated.

Insulation R-value (hr-ft²-°F/Btu). The installed R-value of the pipe insulation. Minimum pipe insulation for hydronic systems is as specified in Section 150.0(j).

2.4.4 Ground-Source Heat Pump

A ground-source heat pump system, which uses the earth as a source of energy for heating and as a heat sink for energy when cooling, is simulated as a minimum efficiency split-system equivalent to the standard design with default duct conditions in place of the proposed system. The mandatory efficiencies for ground-source heat pumps are a minimum coefficient of performance (COP) for heating and EER/EER2 for cooling. A conversion factor is used to convert EER2 to EER2 ratings for modeling. For all air-conditioners the conversion factor is $1/0.96$ to convert EER2 to EER2.

2.4.5 Air-to-Water Heat Pumps

Air-to-water heat pumps (AWHPs) must be listed in the Title 20 MAEDbS database. For the proposed design, fixed compressor speed AWHPs would be modeled equivalent to the prescriptive air source heat pump in heating and cooling operation. Variable-compressor-speed AWHPs would be treated with a 2 percent reduction in hourly heating energy use and an 8 percent reduction in hourly cooling energy use relative to the prescriptive air source heat pump.

2.4.6 Cooling Subsystems

The cooling subsystem describes the equipment that supplies cooling to a space-conditioning system.

Air-conditioner compressor size is determined by the compliance software as 110 percent of the cooling load at the cooling design temperature. For heat pumps the compressor size is the larger of 110 percent of the heating load or 110 percent of the cooling load, whichever is larger.

A parasitic load for the air-conditioner crankcase heater (CCH) is modeled and the capacity is calculated as 30 Watts for systems with a capacity under 3 tons and 10 Watts per ton for systems with a capacity 3 tons or larger. The CCH operates whenever the outdoor dry bulb temperature is below 50°F and the compressor is not operating.

PROPOSED DESIGN

Cooling subsystems are categorized according to the types shown in Table 9: HVAC Cooling Equipment Types (Other Than Heat Pumps) and in Table 9: HVAC Cooling Equipment Types (Other Than Heat Pumps) and in Table 8: Heat Pump Equipment Types Table 7: Heat Pump Equipment Types. The user selects the type of cooling equipment and supplies required inputs for the cooling subsystem, including the rated cooling efficiency enters basic information to model the energy use of the equipment. Enter t The cooling equipment type and additional information is based on the equipment type and zoning, such as the SEER/SEER2 and EER/EER2. A conversion factor is used to convert EER2 to EER2 ratings for modeling. For all air-conditioners the conversion factor is 1/0.96 to convert EER2 to EER2. A conversion factor is used to convert SEER2 to SEER2 ratings for modeling. For split-system equipment, the conversion factor is 1/0.95; for single-package equipment, the conversion factor is 1/0.96; for small-duct high-velocity equipment, the conversion factor is 1.00; and for space-constrained equipment, the conversion factor is 1/0.99 to convert SEER2 to SEER2. For some types of equipment, the user may also specify via-through checkboxes if the equipment has a multispeed compressor and if the system is zoned or not via checkboxes. For ducted cooling systems, the cooling airflow from the conditioned zone through the cooling coil is input as CFM per ton. The rated cooling capacity is not a compliance variable.

Until there is an approved compliance option for ductless heat pumps (ducted and ductless mini-split, multi-split, and variable refrigerant flow [VRF] systems), these systems are simulated as a minimum efficiency split system equivalent to the standard design with default duct conditions.

See sections below for the details of specific inputs.

STANDARD DESIGN

The cooling subsystem for the standard design building is a nonzonal control single zone system, ducted split heat pump system ducted for cooling system meeting the minimum requirements of the *Appliance Efficiency Regulations*.

For heat pumps less than 45,000 BTU the EER2 in the standard design is based on the EER2 of the equipment in the proposed design. When the EER2 of the equipment in the proposed design is below 11.7, then the EER2 in the standard design is equal to the EER2

of the equipment in the proposed design. When the EER2 of the equipment in the proposed design is 11.7 or greater, then the EER2 of the standard design is 11.7. Consequently, the maximum EER2 of heat pump equipment for cooling in the standard design is 11.7.

For heat pumps 45,000 BTU or larger, the EER2 in the standard design is based on the EER2 of the equipment in the proposed design. When the EER2 of the equipment in the proposed design is below 11.2, then the EER2 in the standard design is equal to the EER2 of the equipment in the proposed design. When the EER2 of the equipment in the proposed design is 11.2 or greater, then the EER2 of the standard design is 11.2. Consequently, the maximum EER2 of heat pump equipment for cooling in the standard design is 11.2.

~~The standard design system shall assume verified refrigerant charge in Climate Zones 2 and 8-15 for all systems. Mandatory fan efficacy meeting the 2025 Energy Code's mandatory requirements is assumed in all climate zones.~~

Table 989: HVAC Cooling Equipment Types (Other Than Heat Pumps)

Name	Cooling Equipment Description
NoCooling	Entered when the proposed building is not cooled or when cooling is optional (to be installed at some future date). Both the standard design equivalent building and the proposed design use the same default. (Refer to <u>2.4.9 No Cooling Section 2.4.9.3 No Cooling</u>)
SplitAirCond	Split air-conditioning systems. Distribution system is one of the ducted systems. (Efficiency metric: SEER/SEER2 and EER/EER2)
PkgAirCond	Central packaged air-conditioning systems less than 65,000 Btu/h cooling capacity. Distribution system is one of the ducted systems. (Efficiency metric: SEER/SEER2 and EER/EER2)
LrgPkgAirCond	Large, packaged air-conditioning systems rated at or above 65,000 Btu/h cooling capacity. Distribution system is one of the ducted systems.
SDHVSplitAirCond	Small-duct, high-velocity, split air-conditioning A/C system.
DuctlessMiniSplitAirCond	Ductless minisplit air-conditioning A/C system having an outdoor section and one or more indoor sections. The indoor sections cycle on and off in unison in response to an indoor thermostat.
DuctlessMultiSplitAirCond	Ductless multisplit air-conditioning A/C system having an outdoor section and two or more indoor sections. The indoor

Name	Cooling Equipment Description
	sections operate independently and can be used to condition multiple zones in response to multiple indoor thermostats.
DuctlessVRFairCond	Ductless variable refrigerant flow (VRF) <u>air-conditioning</u> A/C system.

Draft

Name	Cooling Equipment Description
SglPkgVertAirCond	Single-packaged vertical <u>air-conditioning</u> A/C is a self-contained cooling system that is factory-assembled, is arranged vertically, can be mounted on the exterior or interior of a space, and can be installed through the wall. These units can be ducted or ductless. They are rated using ANSI/AHRI 390(I-P)-2003.
PkgTermAirCond	Packaged terminal <u>air-conditioning</u> A/C (PTAC) is a self-contained cooling system that is installed through the wall. These systems do not use ducts. They are rated using AHRI 310/380-2017.
DuctedMiniSplitAirCond	Ducted minisplit <u>air-conditioning</u> A/C system having an outdoor section and one or more indoor sections. The indoor sections cycle on and off in unison in response to an indoor thermostat.
DuctedMultiSplitAirCond	Ducted multisplit <u>air-conditioning</u> A/C system having an outdoor section and two or more indoor sections. The indoor sections operate independently and can be used to condition multiple zones in response to multiple indoor thermostats.
Ducted+DuctlessMultiSplitAirCond	Combination of ducted and ductless multisplit <u>air-conditioning</u> A/C system have an outdoor section and two or more indoor sections. The indoor sections operate independently and can be used to condition multiple zones in response to multiple indoor thermostats.
RoomAirCond	Room <u>air-conditioner</u> is a self-contained cooling system <u>other than a packaged terminal air conditioner that is installed through the wall for the purpose of providing delivery of conditioned air to an enclosed space.</u> These systems do not use ducts. They are rated using ANSI/ASHRAE Standard 16-2016. Same as DuctlessSplitAirCond except that cooling is not supplied to each habitable space in the dwelling unit.
EvapCondenser	Evaporatively cooled condensers. A split mechanical system; with a water-cooled condenser coil. <u>This system must conform with RA4.3.2.</u>

Source: California Energy Commission

VERIFICATION AND REPORTING

Information shown on the CF1R includes cooling equipment type and cooling efficiency (SEER/SEER2 or EER/EER2 or both). Measures requiring verification (are listed in Table 10: Summary of Space Conditioning Measures Requiring Verification~~Table 9: Summary of Space Conditioning Measures Requiring Verification~~), and ~~are listed in the HERSECC verification section of~~ on the CF1R.

Verified Refrigerant Charge or Fault Indicator Display

Proper refrigerant charge is necessary for electrically driven compressor air-conditioning and heating systems to operate at full capacity and efficiency. For cooling, compliance software calculations set the cooling compressor efficiency multiplier to 0.90 to account for the effect of improper refrigerant charge or 0.96 for proper charge. For heating, compliance software calculations set the heating compressor efficiency multiplier to 0.92 to account for the effect of improper refrigerant charge or 0.96 for proper charge.

PROPOSED DESIGN

The compliance software allows the user to indicate if systems will have diagnostically tested refrigerant charge or a field-verified fault indicator display (FID). This allowance applies only to ducted split-systems, and packaged air-conditioners, and heat pumps. Refrigerant charge verification is required by Section 150.1(c) and Table 150.1-A for the proposed cooling system type.

STANDARD DESIGN

The standard design building is modeled with either a diagnostically tested refrigerant charge or a field-verified FID if the building is in Climate Zones 2 or 8–15 for air-conditioners in all homes and heat pumps in homes with 500 square feet of conditioned floor area or less. For heat pumps in all other homes diagnostically tested, refrigerant charge or a field-verified FID is modeled in all climate zones except for homes Climate Zones 1-5 and 8-16 less greater than 500 square feet of conditioned floor area.

VERIFICATION AND REPORTING

Refrigerant charge or FID require field verification or diagnostic testing and is reported in the HERSECC-required verification listings on the CF1R. Details on refrigerant charge measurement are discussed in Reference Appendices, Residential Appendix RA3.2. Information on the requirements for FIDs are is in Reference Appendices, Joint Appendix JA6.1.

Table 10910: Summary of Space Conditioning Measures Requiring Verification

Measure	Description	Procedures
Verified Refrigerant Charge	Air-cooled air-conditioners and air-source heat pumps must be tested diagnostically to verify that the system has the correct refrigerant charge. The system must also meet	RA1.2, RA3.2

Measure	Description	Procedures
	<u>conditioners, and air-source heat pumps must be tested diagnostically to verify that the system has the correct refrigerant charge and meets the system airflow requirement.</u>	
Verified Fault Indicator Display	Installation of A a fault indicator display can be installed <u>verified as an alternative to refrigerant charge testing.</u>	RA3.4.2
Verified System Airflow	When compliance requires <u>verified sSystem airflow must be verified to be greater than or equal to a specified criterion.</u>	RA3.3
Verified Air-Handling Unit Fan Efficacy	To verify that fFan efficacy (watt/CFM) <u>must be verified to be</u> equal to or less than a specified criterion.	RA3.3
Verified HSPF/HSPF2, SEER/SEER2 or EER/EER2	<u>Credit for increased eEfficiency of by installation of specific installed air-conditioner or heat-pump models modeled for compliance credit must be verified.</u>	RA3.4.4.1
Verified Heat Pump Capacity	Optional verification of heat-pump system capacity.	RA3.4.4.2
Evaporatively Cooled Condensers	<u>Must be combined with vVerification of duct leakage testing, refrigerant charge, and verified EER/EER2 is required for compliance credit.</u>	RA3.1.4.3, RA3.2, RA3.4.3, RA3.4.4.1
Whole-House Fan	When verification of the whole-house fan is selected or required, airflow, watt draw, and capacity are verified.	RA3.9
Central Fan Ventilation Cooling System	When compliance includes <u>this type of central fan ventilation cooling, airflow and fan efficacy are verified.</u>	RA3.3.4

Source: California Energy Commission

Verified System Airflow

Adequate airflow to the conditioned space is required ~~to allow for~~ ducted air-conditioning systems to operate at full efficiency and capacity. Air-distribution system Efficiency efficiency is achieved by the ~~air-distribution system design by improving~~ increasing the efficiency of motors or by designing and installing air distribution systems that ~~have with~~ less resistance to airflow. Compliance sSoftware calculations account for the effect of airflow on sensible heat ratio and compressor efficiency.

~~For systems other than small-duct, high-velocity types, a value less than 350 CFM/ton (minimum 150 CFM/ton) is a valid input only if zonally controlled equipment is selected and multispeed compressor is not selected. Inputs less than 350 CFM/ton for zonally controlled systems require verification using procedures in *Reference Appendices, Residential Appendix RA3.3*.~~

Section 150.0(m)13 requires verification that the central air-handling unit airflow rate is greater than or equal to 350 CFM/ton for systems other than small-duct, high-velocity types or 250 CFM/ton for small-duct, high-velocity systems. Compliance credit is calculated for values systems with airflow rates greater higher than the required CFM/ton may be input for compliance credit, and the airflow rates must be and verified by require diagnostic testing using procedures in Reference Appendices, Residential Appendix RA3.3.

For single-zone systems:

- As an alternative to verification of 350 CFM/ton for systems other than small-duct, high-velocity types or 250 CFM/ton for small-duct, high-velocity systems, HERSECC verification of a return duct design that conforms to the specification given in Table 150.0-B or C may be used to demonstrate compliance.
- The return duct design alternative is not an input to the compliance software but must be documented on the certificate of installation CF2R.
- If a valueairflow rates greater than 350 CFM/ton for systems other than small-duct, high-velocity types or greater than 250 CFM/ton for small-duct, high-velocity systems is modeled for compliance credit, the alternative return duct design method using Table 150.0-B or C is not allowed for demonstrating compliance.
- Variable-capacity systems, including multispeed and variable-speed compressor systems must verify airflow rate (CFM/ton) for system operation at the maximum compressor speed and the maximum air handler fan speed.

For zonally controlled systems:

- The alternative return duct design method using The-Table 150.0-B or C return-duct design alternative is not allowed for zonally controlled systems.
- Variable-capacity systems including multispeed, variable-speed, and single-speed compressor systems must all verify airflow rate (CFM/ton) by operating the system at maximum compressor capacity and maximum system fan speed in every zonal control mode with all zones calling for conditioning.
- ~~Single speed compressor systems must also verify airflow rate (CFM/ton) in every zonal control mode.~~
- ~~For systems that input less than 350 CFM/ton, HERS verification compliance cannot use group sampling.~~

PROPOSED DESIGN

~~The default cooling airflow is 150 CFM/ton for a system with "zonally controlled" selected and "multispeed compressor" not selected (single speed). Users may model airflow for~~

these systems greater than or equal to 150 CFM/ton, which must be verified using the procedures in *Reference Appendices, Residential Appendix RA3.3*. Inputs less than the rates required by Section 150.0(m)13 will be penalized in the compliance calculation.

The default cooling airflow rate is 350 CFM/ton for systems other than small duct, high-velocity types or 250 CFM/ton for small duct, high-velocity systems. Users may model a higher-than-default airflow for these systems and receive credit in the compliance calculation if greater-than-default system airflow is diagnostically tested using the procedures in *Reference Appendices, Residential Appendix RA3.3*.

STANDARD DESIGN

The standard design shall assume a system that complies with the mandatory (Section 150.0) and prescriptive (Section 150.1) requirements for the applicable climate zone.

VERIFICATION AND REPORTING

The airflow rate verification compliance target (CFM or CFM/ton) is reported in the HERSECC-required verification listings of the CF1R. When there is no cooling system, the verified airflow rate is reported on the CF1R as a special feature.

Verified Air-Handling Unit Fan Efficacy

The mandatory requirement in Section 150.0(m)13 is for minimum an air-handling unit fan efficacy is equal to or less than 0.45 watts/CFM for gas furnace air-handling units, 0.58 watts/CFM for air-handling units that are not gas furnaces, and 0.62 ~~W~~watts/CFM for small-duct, high-velocity systems as verified by an HERSECC Rater, see Section 150.0(m)13. Users may model a lower fan efficacy (~~W~~watts/CFM) and receive credit in the compliance calculation if the proposed fan efficacy value is diagnostically tested using the procedures in *Reference Appendices, Residential Appendix RA3.3*.

For single-zone systems:

- Installers may elect to use an alternative to HERSECC verification of the watts/CFM required by Section 150.0(m)13: HERSECC verification of a return duct design that conforms to the specification given in Table 150.0-B or C.
- The return duct design alternative is not an input to the compliance software but must be documented on the certificate of installation.
- If a value less than the watts/CFM required by Section 150.0(m)13 is modeled by the software user for compliance credit, the alternative return duct design method using Table 150.0-B or C is not allowed for use in demonstrating compliance.
- Multispeed or variable-speed compressor systems must verify fan efficacy (watts/CFM) for system operation at the maximum compressor speed and the maximum air handler fan speed.

For zonally controlled systems:

- ~~The alternative return duct design method using~~The Table 150.0-B or C ~~return-duct design alternative is~~ not allowed for zonally controlled systems.
- Variable-capacity systems including multispeed, variable-speed, and single-speed compressor systems must all verify fan efficacy (watts/CFM) by operating the system at maximum compressor capacity and maximum system fan speed with all zones calling for conditioning.
- Single-speed compressor systems must verify fan efficacy in every zonal control mode.

PROPOSED DESIGN

The compliance software shall allow the user to enter the fan efficacy. The default mandatory value is 0.45, 0.58, or 0.62 ~~W~~watts/CFM, depending on the applicable system type, as described above. However, users may specify a lower value and receive credit in the compliance calculation if verified and diagnostically tested using the procedures of Reference Appendices, Residential Appendix RA3.3.

If no cooling system is installed, a default value of 0.45 ~~W~~watts/CFM is assumed.

STANDARD DESIGN

The standard design shall assume a verified fan efficacy equal to or less than the following:

- 0.45 ~~W~~watts/CFM for gas furnace air-handling units, as well as air-handling units that are not gas furnaces and have a cooling capacity less than 54,000 BTU/h.
- 0.58 ~~W~~watts/CFM for air-handling units that are not gas furnaces and have a cooling capacity greater than or equal to 54,000 BTU/h.
- 0.62 ~~W~~watts/CFM for small duct high velocity forced air systems.

VERIFICATION AND REPORTING

For user inputs lower than the default mandatory requirement, fan efficacy is reported in the HERSECC-required verification listings of the CF1R.

For default mandatory 0.45, 0.58, or 0.62 watts/cfm, the choice of either fan efficacy or alternative return duct design according to Table 150.0-B or C is reported in the HERSECC-required verification listings of the CF1R.

No cooling system is reported as a special feature on the CF1R.

Verified Energy Efficiency Ratio (~~EER~~/EER2)

PROPOSED DESIGN

The compliance Software ~~software~~ shall allow the user the option to enter an ~~EER~~/EER2 rating for central cooling equipment. For equipment that is rated only with an ~~EER~~/EER2, the user will enter the ~~EER~~/EER2. ~~The Appliance Efficiency Regulations require a minimum SEER/SEER2 and EER/EER2 for central cooling equipment. Only if a value higher than a default minimum EER/EER2 is used is it reported as an~~ HERSECC-verified measure. A

conversion factor is used to convert EER₂ to EER₂ ratings for modeling. For all air-conditioners/cooling equipment, the conversion factor is $1/0.96$ to convert EER₂ to EER₂. A conversion factor is used to convert SEER₂ to SEER₂ ratings for modeling. For split-system equipment the conversion factor is $1/0.95$; for single-package equipment the conversion factor is $1/0.96$; for small-duct high-velocity equipment the conversion factor is 1.00; and for space-constrained equipment the conversion factor is $1/0.99$ to convert SEER₂ to SEER₂.

STANDARD DESIGN

The standard design is based on the default on minimum efficiency EER/EER₂ for the type of cooling equipment modeled in the proposed design, based on the applicable *Appliance Efficiency Regulations*. The efficiency of standard design for central air conditioning/cooling equipment in the standard design is 11.7 EER/11.2 EER₂ for applicable equipment.

For heat pumps less than 45,000 BTU the EER₂ in the standard design is based on the EER₂ of the equipment in the proposed design. When the EER₂ of the equipment in the proposed design is below 11.7, then the EER₂ in the standard design is equal to the EER₂ of the equipment in the proposed design. When the EER₂ of the equipment in the proposed design is 11.7 or greater, then the EER₂ of the standard design is 11.7. Consequently, the maximum EER₂ of heat pump equipment for cooling in the standard design is 11.7.

For heat pumps 45,000 BTU or larger, the EER₂ in the standard design is based on the EER₂ of the equipment in the proposed design. When the EER₂ of the equipment in the proposed design is below 11.2, then the EER₂ in the standard design is equal to the EER₂ of the equipment in the proposed design. When the EER₂ of the equipment in the proposed design is 11.2 or greater, then the EER₂ of the standard design is 11.2. Consequently, the maximum EER₂ of heat pump equipment for cooling in the standard design is 11.2.

VERIFICATION AND REPORTING

If an EER/EER₂ higher than the default minimum efficiency is modeled in the compliance software, the EER/EER₂ requires field verification. The EER/EER₂ rating is verified using rating data from the [AHRI Directory of Certified Product Performance](#) website or another directory of certified product performance ratings approved by the CEC for determining compliance. Verified EER/EER₂ is reported in the HERSECC-required verification listings on the CF1R.

Verified Seasonal Energy Efficiency Ratio (SEER/SEER₂)

PROPOSED DESIGN

The compliance software allows the user to specify the SEER/SEER₂ value. A conversion factor is used to convert SEER to SEER₂ ratings for modeling. For split-system equipment the conversion factor is 0.95; for single-package equipment the conversion factor is 0.96; for small-duct high-velocity equipment the conversion factor is 1.00; and for space-constrained equipment the conversion factor is 0.99 to convert SEER to SEER₂.

STANDARD DESIGN

The standard design is based on the default minimum efficiency SEER/SEER2 for the type of cooling equipment modeled in the proposed design, based on the applicable *Appliance Efficiency Regulations*. For central_cooling equipment, the minimum efficiency is 14 SEER/13.8 SEER2.

VERIFICATION AND REPORTING

If a SEER/SEER2 higher than the default minimum efficiency is modeled in the compliance software, the SEER/SEER2 requires field verification. The higher-than-minimum SEER/SEER2 rating is verified using rating data from [AHRI Directory of Certified Product Performance](#) website or another directory of certified product performance ratings approved by the CEC for determining compliance. Verified SEER/SEER2 is reported in the HERSECC-required verification listings on the CF1R.

Verified Evaporatively Cooled Condensers**PROPOSED DESIGN**

Compliance Software software shall allow users to specify an evaporatively cooled condensing unit. The installation must comply with the requirements of Reference Appendices, Residential Appendix RA4.3.2 to ensure the predicted energy savings are achieved. This credit must be combined with verified refrigerant charge testing, EER/EER2, and duct leakage testing.

STANDARD DESIGN

The standard design is based on a split-system air_conditioner meeting the requirements of Section_150.1(c) and Table 150.1-A.

VERIFICATION AND REPORTING

An evaporatively cooled condensing unit, verified EER/EER2, and duct leakage testing are reported in the HERSECC-required verification listings on the CF1R.

Evaporative Cooling

Evaporative cooling technology is best suited for dry climates where ~~direct, indirect, or indirect-direct~~ cooling of the supply air stream can occur without compromising indoor comfort. ~~Direct evaporative coolers are the most common system type available but provide less comfort and deliver more moisture to the indoor space. They are assumed equivalent to a minimum efficiency split system air conditioner.~~ The evaporative cooling modeling method addresses two performance issues. The first performance issue is the increase in indoor relative humidity levels during periods with extended cooler operation. Since modeling of indoor air moisture levels is beyond the capability of simulation models, a simplified algorithm is used to prohibit evaporative cooler operation during load hours when operation is expected to contribute to uncomfortable indoor conditions. The algorithm disallows evaporative cooler operation when outdoor wet bulb temperatures are 70°F or above. The second performance issue relates to evaporative cooler capacity limitations.

Since evaporative coolers are 100 percent outdoor air systems, the related capacity is limited by the outdoor wet bulb temperature. Each hour with calculated cooling load, the algorithm will verify that the cooling capacity is greater than the calculated cooling load and flag the system if the cooling capacity is less than the calculated cooling load. Evaporative coolers must comply with RA4.3.2:

- Be indirect or indirect-direct evaporative cooling; direct evaporative cooling is not allowed to be used for compliance
- Listed under Title 20 Appliance Standards
- Certified to the Commission that water use does not exceed 7.5 gallons per ton hour based on Title 20 Appliance Standards testing criteria
- Permanently installed
- Provide automatic relief of supply air from the house with maximum air velocity through relief dampers not exceeding 800 feet per minute
- Bleed systems not allowed
- A water quality management system is required

PROPOSED DESIGN

Compliance sSoftware shall allow users to specify one of three types of evaporative cooling: ~~(1) direct evaporative cooler, the most commonly available system type; (12) indirect; or (23) indirect-direct.~~ Product specifications and other modeling details are found in the CEC appliance directory for evaporative cooling. ~~Direct system types are assigned an efficiency of 14 SEER (or minimum appliance efficiency standard for split system cooling).~~ The default system type is evaporative direct. For indirect or indirect-direct, select the appropriate type from the CEC appliance directory and input a 13 EER as well as the airflow and media saturation effectiveness or cooling effectiveness from the CEC appliance directory.

STANDARD DESIGN

The standard design is based on a split-system air-conditioner meeting the requirements of Section_150.1(c) and Table 150.1-A.

VERIFICATION AND REPORTING

~~When a direct evaporative cooling system is modeled, the system type and minimum efficiency are shown in the appropriate section of the CF1R. When indirect or indirect-direct evaporative cooling is modeled, the EER/EER2 verification is shown in the HERSECC verification section on of the CF1R, along with the system type, airflow, and system effectiveness.~~

2.4.7 Distribution Subsystems

If multiple HVAC distribution systems serve a building, each system, and the conditioned space it serves, may be modeled in detail separately, or the systems may be aggregated and modeled as one large system. If the systems are aggregated, they must be the same type, and all meet the same minimum specifications.

For duct efficiency calculations, the supply duct begins at the exit from the furnace or air-handler cabinet.

Distribution Type

Fan-powered, ducted distribution systems can be used with most heating or cooling systems. When ducted systems are used with furnaces, boilers, or combined hydronic/water heating systems, the electricity used by the fan is calculated. R-value and duct location are specified when a ducted system is specified.

PROPOSED DESIGN

The compliance software shall allow the user to select from the basic types of HVAC distribution systems and locations listed in Table 11: HVAC Distribution Type and Location Descriptors~~Table 10: HVAC Distribution Type and Location Descriptors~~Table 11: HVAC Distribution Type and Location Descriptors. For ducted systems, the default location of the HVAC ducts and the air handler are in the attic.

Draft

Table 111011: HVAC Distribution Type and Location Descriptors

Name	HVAC Distribution Type and Location Description
Ducts located in attic (ventilated and unventilated)	Ducts located overhead in the attic space.
Ducts located in a crawl space	Ducts located under floor in the crawl space.
Ducts located in a garage	Ducts located in an unconditioned garage space.
Ducts located within the conditioned space (except < 12 linear ft)	Ducts located within the conditioned floor space except for less than 12 linear feet of duct, furnace cabinet, and plenums — typically an HVAC unit in the garage mounted on return box with all other ducts in conditioned space.
Ducts located entirely in conditioned space	HVAC unit or systems with all HVAC ducts (supply and return) within the conditioned floor space. Location of ducts in conditioned space eliminates conduction losses but does not change losses due to leakage. Leakage either from ducts that are not tested for leakage or from sealed ducts is modeled as leakage to outside the conditioned space.
Distribution system without ducts (none)	Air-distribution systems without ducts such as ductless split-system air-conditioners and heat pumps, window air-conditioners, through-the-wall heat pumps, wall furnaces, floor furnaces, radiant electric panels, combined hydronic heating equipment, electric baseboards, or hydronic baseboard finned-tube natural convection systems, etc.
Ducts located in outdoor locations	Ducts in exposed locations outdoors.
Verified low-leakage ducts located entirely in conditioned space	Duct systems for which air leakage to outside is equal to or less than 25 CFM when measured in accordance with Reference Appendices , Residential Appendix RA3.1.4.3.8.
Ducts located in multiple places	Ducts with different supply and return duct locations.

Source: California Energy Commission

Table 121112: Summary of Verified Distribution Systems

Measure	Description	Procedures
Verified Duct Sealing	Mandatory measures require that space-conditioning ducts be sealed. Field verification and diagnostic testing are required to verify that approved duct system materials are used, and that duct leakage meets the specified criteria.	RA3.1.4.3
Verified Duct Location, Reduced Surface Area and R-value	Compliance credit can be taken for improved supply duct location, reduced surface area, and R-value. Field verification is required to verify that the duct system was installed according to the duct design, including location, size and length of ducts, duct insulation R-value, and installation of buried ducts. ¹ For buried duct measures, verified QII is required, as well as duct sealing.	RA3.1.4.1, 3.1.4.1.1
Low-Leakage Ducts in Conditioned Space	When the standards specify use of the procedures in Reference Appendices, Residential Appendix RA3.1.4.3.8 to determine if the space-conditioning system ducts are entirely in directly conditioned space, the duct system location is verified by diagnostic testing. Compliance credit can be taken for verified duct systems with low air leakage to the outside when measured in accordance with Reference Appendices, Residential Appendix RA3.1.4.3.8. Field verification for ducts in conditioned space is required. Duct sealing is required.	RA3.1.4.3.8
Hydronic Delivery in Conditioned Space	Compliance credit can be taken for hydronic delivery systems with no ducting or piping in unconditioned space. For radiant ceiling panels, the verifications in Reference Appendices, Residential Appendix RA3.4.5 must be completed to qualify.	RA3.4.5
Low-Leakage Air-Handling Units	Compliance credit can be taken for installing a factory-sealed air-handling unit tested by the manufacturer and certified to the CEC to have met the requirements for a low-leakage air-handling unit. Field verification of the air handler model number is required. Duct sealing is required.	RA3.1.4.3.9

Measure	Description	Procedures
Verified Return Duct Design	Verification to confirm that the return duct design conforms to the criteria given in Table 150.0-B or Table 150.0-C. as an alternative to meeting 0.45 or 0.58 Wwatts/CFM fan efficacy of Section150.0(m)13.	RA3.1.4.4
Verified Bypass Duct Condition	Verification to determine if system is zonally controlled and confirm that bypass ducts condition modeled matches installation.	RA3.1.4

†. Compliance credit for increased duct insulation R-value (not buried ducts) may be taken without field verification if the R-value is the same throughout the building, and for supply ducts located in crawl spaces and garages where all supply registers are either in the floor or within 2 feet of the floor. If these conditions are met, HERSECC Rater verification is not required.

Source: California Energy Commission

The compliance software will allow users to select default assumptions or specify any of the verified or diagnostically tested HVAC distribution system conditions in the proposed design (~~Table 12: Summary of Verified Distribution Systems~~~~Table 11: Summary of Verified Distribution Systems~~~~Table 12: Summary of Verified Distribution Systems~~), including duct leakage target, R-value, supply and return duct area, diameter, and location.

STANDARD DESIGN

The standard heating and cooling system for central systems is modeled with nondesigned air-distribution ducts located as described in ~~Table 13: Summary of Standard Design Duct Location~~~~Table 12: Summary of Standard Design Duct Location~~~~Table 13: Summary of Standard Design Duct Location~~, with duct leakage as specified in ~~Table 21: Duct/Air Handler Leakage~~~~Table 20: Duct/Air Handler Leakage~~~~Table 21: Duct/Air Handler Leakage~~. The standard design duct insulation is determined by Table 150.1-A (assuming attic Option B) as R-6 in Climate Zones 3 and 5–7, and R-8 in Climate Zones 1, 2, 4, and 8–16. The standard design building is assumed to have the same number of stories as the proposed design for determining the duct efficiency.

Table 131213: Summary of Standard Design Duct Location

Configuration of the Proposed Design	Standard Design Duct Location	Detailed Specifications
Attic over the dwelling unit	Ducts and air handler located in the attic	Ducts sealed (mandatory requirement) No credit for verified R-value, location, or duct design
No attic but crawl space or basement	Ducts and air handler located in the crawl space or basement	Ducts sealed (mandatory requirement) No credit for verified R-value, location, or duct design
Buildings with no attic, crawl space or basement	Ducts and air handler located indoors	<u>Ducts tested to meet verified low leakage ducts in conditioned space requirements.</u> Ducts sealed (mandatory requirement) No credit for verified R-value, location or duct design

This table is applicable only when the standard design system has air-distribution ducts

Source: California Energy Commission

VERIFICATION AND REPORTING

Distribution type, location, R-value, and the determination of whether tested and sealed will be shown on the CF1R. If there are no ducts, the absence of ducts is shown as a special feature on the CF1R. Any duct location other than attic (for example, crawl space) is shown as a special feature on the CF1R. Ducts in crawl space or the basement shall include a special feature note if supply registers are within 2 feet of the floor. Measures that require HERSECC verification will be shown in the HERSECC-required verification section of the CF1R.

Duct Location

Duct location determines the external temperature for duct conduction losses, the temperature for return leaks, and the thermal regain of duct losses.

PROPOSED DESIGN

If any part of the supply or return duct system is in an unconditioned attic, that entire duct system is modeled with an attic location. If no part of the supply or return duct system is located in the attic, but the duct system is not entirely in conditioned space, it is modeled in

the unconditioned zone, which contains the largest fraction of the surface area. If the supply or return duct system is entirely in conditioned space, the duct system is modeled in conditioned space.

For ducted HVAC systems with some or all ducts in unconditioned space, the user specifies the R-value and surface area of supply and return ducts and the duct location.

Duct location and areas other than the defaults shown in Table 14: Location of Default Duct Surface Area may be used following the verification procedures in Reference Appendices, Residential Appendix RA3.1.4.1.

STANDARD DESIGN

The standard design duct location is determined from the building conditions (Table 13).

VERIFICATION AND REPORTING

Duct location is reported on the CF1R. Ducts entirely in conditioned space and verified low-leakage ducts entirely in conditioned space are reported in the HERSECC-required verification listing on the CF1R.

Default duct locations are shown in Table 14: Location of Default Duct Surface Area. The duct surface area for crawl space and basement applies only to buildings or zones with all ducts installed in the crawl space or basement. If the duct is installed in locations other than crawl space or basement, the default duct location is "Other." For houses with two or more stories, 35 percent of the default duct area may be assumed to be in conditioned space, as shown in Table 14: Location of Default Duct Surface Area.

The surface area of ducts in conditioned space is ignored in calculating conduction losses.

Table 14: Location of Default Duct Surface Area

Supply Duct Location	One story	Two or more stories
All in crawl space	100% crawl space	65% crawl space, 35% conditioned space
All in basement	100% basement	65% basement, 35% conditioned space
Other	100% attic	65% attic, 35% conditioned space

Source: California Energy Commission

Duct Surface Area

The supply-side and return-side duct surface areas are treated separately in distribution efficiency calculations. The duct surface area is determined using the following methods.

Default Return Duct Surface Area

Default return duct surface area is calculated using:

$$A_{r,out} = K_r \times A_{floor} \quad A_{r,out} = K_r \times A_{floor} \quad \text{Equation 4}$$

Where K_r (return duct surface area coefficient) is 0.05 for one-story buildings and 0.1 for two or more stories.

Default Supply Duct Surface Area**STANDARD DESIGN**

The standard design and default proposed design supply duct surface area is calculated using Equation 5.

$$A_{s,out} = 0.27 \times A_{floor} \times K_s \quad A_{s,out} = 0.27 \times A_{floor} \times K_s \quad \text{Equation 5}$$

Where K_s (supply duct surface area coefficient) is 1 for one-story buildings and 0.65 for two or more stories.

Supply Duct Surface Area for Less Than 12 feet of Duct in Unconditioned Space**PROPOSED DESIGN**

For proposed design HVAC systems with air handlers outside the conditioned space but with less than 12 linear feet of duct outside the conditioned space, including air handler and plenum, the supply duct surface area outside the conditioned space is calculated using Equation 6. The return duct area remains the default for this case.

$$A_{s,out} = 0.027 \times A_{floor} \quad A_{s,out} = 0.027 \times A_{floor} \quad \text{Equation 6}$$

Diagnostic Duct Surface Area

Proposed designs may claim credit for reduced surface area using the procedures in Reference Appendices, Residential Appendix RA3.1.4.1.

The surface area of each duct system segment shall be calculated based on the associated inside dimensions and length. The total supply surface area in each unconditioned location (attic, attic with radiant barrier, crawl space, basement, other) is the sum of the area of all duct segments in that location. The surface area of ducts completely inside conditioned space need not be input in the compliance software and is not included in the calculation of duct system efficiency. The area of ducts in floor cavities or vertical chases that are surrounded by conditioned space and separated from unconditioned space with draft stops are also not included. The software assumes the user input duct system area is 85 percent of the total duct system area. The other 15 percent is assumed to be air handler, plenum, and connectors. Because of this, the total duct system area used in the building simulation is:

Simulated Duct System Area = 1.1765 multiplied by the total user entered duct system area

Bypass Duct

Section 150.1(c)13 prohibits use of bypass ducts unless a bypass duct is otherwise specified on the certificate of compliance. A bypass duct may be needed for some single-speed outdoor condensing unit systems. The software allows users to specify a bypass duct for the system. Selection of a bypass duct does not trigger changes in the ACM modeling defaults, but verification by a HERSECC Rater is required to use the procedure in Reference Appendices, Residential Appendix RA3.1.4.6.

Specification of a zonally controlled system with a single-speed condensing unit will trigger a default airflow rate value of 150 CFM/ton for the calculations. User input less than 350 CFM/ton reduces the compliance margin compared to systems that model 350 CFM/ton as described in 2.4.6 Verified System Airflow Section 2.4.6.2 Verified System Airflow.

PROPOSED DESIGN

Software shall allow users to specify whether a bypass duct is used for a zonally controlled forced air system.

STANDARD DESIGN

The standard design is based on a split-system air-conditioner meeting the requirements of Section 150.1(c) and Table 150.1-A. The system is not a zonally controlled system.

VERIFICATION AND REPORTING

An HVAC system with zonal control, and the determination of whether the system is assumed to have a bypass duct or have no bypass duct, is reported in the HERSECC-required verification listings on the CF1R.

Duct System Insulation

For conduction calculations in the standard and proposed designs, 85 percent of the supply and return duct surface is assumed duct material at the related specified R-value, and 15 percent is assumed air handler, plenum, connectors, and other components at the mandatory minimum R-value.

The area weighted effective R-value is calculated by the compliance software using Equation 7, including each segment of the duct system that has a different R-value.

$$R_{eff} = \frac{(A_1 + A_2 \dots + A_N)}{\left(\frac{A_1}{R_1} + \frac{A_2}{R_2} \dots + \frac{A_N}{R_N}\right)} \quad \text{Equation 7}$$

Where:

R_{eff} = Area weighted effective R-value of duct system for use in calculating duct efficiency, (h-ft²-°F/Btu)

A_N = Area of duct segment n, square feet

R_N = R-value of duct segment n including film resistance (duct insulation rated R + 0.7) (h-ft²-°F/Btu)

PROPOSED DESIGN

The software user inputs the R-value of the proposed duct insulation and details. The default duct thermal resistance is based on Table 150.1-A, attic option B, which is R-6 in Climate Zones 3 and 5–7, R-8 in Zones 1, 2, 4, and 8–16.

Duct location and duct R-value are reported on the CF1R. Credits for systems with mixed insulation levels, nonstandard supply and return duct surface areas, or ducts buried in the attic require the compliance and diagnostic procedures in Reference Appendices, Residential Appendix RA3.1.4.1.

If verified duct design is selected, the user must enter the duct design into the software. For each duct segment entered, the user must specify Type (supply/return), Buried (yes/no, ~~per as specified by 2.4.7 Buried Attic Ducts~~ ~~Section 2.4.7.10 Buried Attic Ducts~~), Diameter (inside/nominal), Length, and Duct Insulation R-value. User-entered duct design must be verified by a ~~HERSECC~~ Rater according to the procedures in Reference Appendices, Residential Appendix RA3.1.4.1.1. User-entered duct design and duct location are reported on the CF1R when nonstandard values are specified.

STANDARD DESIGN

The required duct insulation R-value for attic Option B is from Table 150.1-A for the applicable climate zone used in the standard design.

VERIFICATION AND REPORTING

Duct type (supply/return), nominal diameter, length, R-value, and location, and supply and return areas are reported on the CF1R. Verified duct design is reported in the ~~HERSECC~~-required verification listing on the CF1R.

Buried Attic Ducts

Ducts partly, fully, or deeply buried in blown attic insulation in dwelling units meeting the requirements for verified QII may take credit for increased effective duct insulation. To qualify for buried duct credit, ducts must meet mandatory insulation levels (R-6) before burial, be directly or within 3.5 inches of ceiling gypsum board, and be surrounded by at least R-30 attic insulation. Moreover, credit is available only for duct runs where the ceiling is level, there is at least 6 inches of space between the duct outer jacket and the roof sheathing, and the attic insulation has uniform depth. Existing ducts are ~~exempt not required to meet~~ ~~from~~ mandatory minimum insulation levels, but to qualify for buried duct credit, they must have greater than R-4.2 insulation before burial.

In addition to the above requirements, deeply buried ducts must be buried by at least 3.5 inches of insulation above the top of the duct insulation jacket and located within a lowered area of the ceiling, a deeply buried containment system, or buried by at least 3.5 inches of uniformly level insulation. Mounding insulation to achieve the 3.5-inch burial level is not allowed.

Deeply buried duct containment systems must be installed such that the walls of the system are at least 7 inches wider than the duct diameter (3.5 inches on each side of duct), the walls extend at least 3.5 inches above the duct outer jacket, and the containment area surrounding the duct must be completely filled with blown insulation.

The duct design shall identify the segments of the duct that meet the requirements for being buried, and these are input into the software separately from nonburied ducts. For each buried duct, the user must enter the duct size, R-value, length, and determination of whether the duct qualifies as deeply buried. The user must also indicate if a duct uses a deeply buried containment system. The software calculates the weighted average effective duct system R-value based on the user-entered duct information, blown insulation type (cellulose or fiberglass), and R-value.

Duct-effective R-values are broken into three categories: partially, fully, and deeply, with each having different burial levels and requirements. Partially buried ducts have less than 3.5 inches of exposed duct depth, fully buried ducts have insulation depth at least level with the duct jacket, and deeply buried ducts have at least 3.5 inches of insulation above the duct jacket in addition to the above requirements. Effective duct R-values used by the software are listed in Table 15: Buried Duct Effective R-Values:

~~R-8 Ducts With Blown Fiberglass Attic Insulation~~ Table 14: Buried Duct Effective R-Values:

~~R-8 Ducts With Blown Fiberglass Attic Insulation~~ Table 15: Buried Duct Effective R-Values:

~~R-8 Ducts With Blown Fiberglass Attic Insulation~~ through Table 20: Buried Duct Effective R-Values:

~~R-4.2 Ducts with Blown Cellulose Attic Insulation~~ Table 19: Buried Duct Effective R-Values:

~~R-4.2 Ducts with Blown Cellulose Attic Insulation~~ Table 20: Buried Duct Effective R-Values:

~~R-4.2 Ducts with Blown Cellulose Attic Insulation.~~

PROPOSED DESIGN

The software calculates the effective R-value of buried ducts based on user-entered duct size, R-value, and length; attic insulation level and type; and determination of whether the duct meets the requirements of a deeply buried duct by using a lowered ceiling chase or a containment system. This feature must be combined with verified QII, verified duct location, reduced surface area and R-value, and verified minimum airflow. The software will allow any combination of duct runs and the associated buried condition, and the overall duct system effective R-value will be a weighted average of the combination. The default is no buried ducts.

STANDARD DESIGN

The standard design has no buried ducts.

VERIFICATION AND REPORTING

Buried duct credit is reported in the HERSECC-required verification listing on the CF1R.

**Table 151415: Buried Duct Effective R-Values:
R-8 Ducts With Blown Fiberglass Attic Insulation**

Duct Diameter	R-30 Ceiling	R-38 Ceiling	R-40 Ceiling	R-43 Ceiling	R-49 Ceiling	R-60 Ceiling
3"	R-18	R-26	R-26	R-26	R-26	R-26
4"	R-13	R-18	R-26	R-26	R-26	R-26
5"	R-13	R-18	R-18	R-26	R-26	R-26
6"	R-13	R-18	R-18	R-18	R-26	R-26
7"	R-13	R-13	R-18	R-18	R-26	R-26
8"	R-8	R-13	R-13	R-18	R-18	R-26
9"	R-8	R-13	R-13	R-13	R-18	R-26
10"	R-8	R-13	R-13	R-13	R-18	R-26
12"	R-8	R-8	R-8	R-13	R-13	R-26
14"	R-8	R-8	R-8	R-8	R-13	R-18
16"	R-8	R-8	R-8	R-8	R-8	R-13
18"	R-8	R-8	R-8	R-8	R-8	R-13
20"	R-8	R-8	R-8	R-8	R-8	R-8
22"	R-8	R-8	R-8	R-8	R-8	R-8
24"	R-8	R-8	R-8	R-8	R-8	R-8

Source: California Energy Commission

**Table 161516: Buried Duct Effective R-Values:
R-8 Ducts with Blown Cellulose Attic Insulation**

Duct Diameter	R-30 Ceiling	R-38 Ceiling	R-40 Ceiling	R-43 Ceiling	R-49 Ceiling	R-60 Ceiling
3"	R-14	R-20	R-20	R-20	R-32	R-32
4"	R-14	R-14	R-20	R-20	R-20	R-32
5"	R-8	R-14	R-14	R-20	R-20	R-32
6"	R-8	R-14	R-14	R-14	R-20	R-32
7"	R-8	R-14	R-14	R-14	R-20	R-20
8"	R-8	R-8	R-8	R-14	R-14	R-20
9"	R-8	R-8	R-8	R-8	R-14	R-20
10"	R-8	R-8	R-8	R-8	R-14	R-20
12"	R-8	R-8	R-8	R-8	R-8	R-14
14"	R-8	R-8	R-8	R-8	R-8	R-8

Duct Diameter	R-30 Ceiling	R-38 Ceiling	R-40 Ceiling	R-43 Ceiling	R-49 Ceiling	R-60 Ceiling
16"	R-8	R-8	R-8	R-8	R-8	R-8
18"	R-8	R-8	R-8	R-8	R-8	R-8
20"	R-8	R-8	R-8	R-8	R-8	R-8
22"	R-8	R-8	R-8	R-8	R-8	R-8
24"	R-8	R-8	R-8	R-8	R-8	R-8

Source: California Energy Commission

**Table 171617: Buried Duct Effective R-Values:
R-6 Ducts with Blown Fiberglass Attic Insulation**

Duct Diameter	R-30 Ceiling	R-38 Ceiling	R-40 Ceiling	R-43 Ceiling	R-49 Ceiling	R-60 Ceiling
3"	R-15	R-24	R-24	R-24	R-24	R-24
4"	R-15	R-24	R-24	R-24	R-24	R-24
5"	R-11	R-15	R-24	R-24	R-24	R-24
6"	R-11	R-15	R-15	R-24	R-24	R-24
7"	R-11	R-15	R-15	R-15	R-24	R-24
8"	R-11	R-15	R-15	R-15	R-24	R-24
9"	R-6	R-11	R-11	R-15	R-24	R-24
10"	R-6	R-11	R-11	R-15	R-15	R-24
12"	R-6	R-6	R-11	R-11	R-15	R-24
14"	R-6	R-6	R-6	R-6	R-11	R-15
16"	R-6	R-6	R-6	R-6	R-11	R-15
18"	R-6	R-6	R-6	R-6	R-6	R-11
20"	R-6	R-6	R-6	R-6	R-6	R-11
22"	R-6	R-6	R-6	R-6	R-6	R-6
24"	R-6	R-6	R-6	R-6	R-6	R-6

Source: California Energy Commission

**Table 181718: Buried Duct Effective R-Values:
R-6 Ducts with Blown Cellulose Attic Insulation**

Duct Diameter	R-30 Ceiling	R-38 Ceiling	R-40 Ceiling	R-43 Ceiling	R-49 Ceiling	R-60 Ceiling
3"	R-12	R-18	R-18	R-18	R-31	R-31
4"	R-12	R-18	R-18	R-18	R-31	R-31

Duct Diameter	R-30 Ceiling	R-38 Ceiling	R-40 Ceiling	R-43 Ceiling	R-49 Ceiling	R-60 Ceiling
5"	R-12	R-12	R-18	R-18	R-18	R-31
6"	R-6	R-12	R-12	R-18	R-18	R-31
7"	R-6	R-12	R-12	R-12	R-18	R-31
8"	R-6	R-12	R-12	R-12	R-18	R-31
9"	R-6	R-6	R-6	R-12	R-12	R-18
10"	R-6	R-6	R-6	R-6	R-12	R-18
12"	R-6	R-6	R-6	R-6	R-6	R-12
14"	R-6	R-6	R-6	R-6	R-6	R-12
16"	R-6	R-6	R-6	R-6	R-6	R-6
18"	R-6	R-6	R-6	R-6	R-6	R-6
20"	R-6	R-6	R-6	R-6	R-6	R-6
22"	R-6	R-6	R-6	R-6	R-6	R-6
24"	R-6	R-6	R-6	R-6	R-6	R-6

Source: California Energy Commission

**Table 1918-19: Buried Duct Effective R-Values:
R-4.2 Ducts With Blown Fiberglass Attic Insulation**

Duct Diameter	R-30 Ceiling	R-38 Ceiling	R-40 Ceiling	R-43 Ceiling	R-49 Ceiling	R-60 Ceiling
3"	R-13	R-22	R-22	R-22	R-22	R-22
4"	R-13	R-22	R-22	R-22	R-22	R-22
5"	R-13	R-22	R-22	R-22	R-22	R-22
6"	R-13	R-13	R-22	R-22	R-22	R-22
7"	R-9	R-13	R-13	R-22	R-22	R-22
8"	R-9	R-13	R-13	R-13	R-22	R-22
9"	R-9	R-13	R-13	R-13	R-22	R-22
10"	R-4.2	R-9	R-13	R-13	R-13	R-22
12"	R-4.2	R-9	R-9	R-9	R-9	R-22
14"	R-4.2	R-4.2	R-4.2	R-9	R-9	R-22
16"	R-4.2	R-4.2	R-4.2	R-4.2	R-9	R-13
18"	R-4.2	R-4.2	R-4.2	R-4.2	R-4.2	R-9
20"	R-4.2	R-4.2	R-4.2	R-4.2	R-4.2	R-9

Duct Diameter	R-30 Ceiling	R-38 Ceiling	R-40 Ceiling	R-43 Ceiling	R-49 Ceiling	R-60 Ceiling
22"	R-4.2	R-4.2	R-4.2	R-4.2	R-4.2	R-4.2
24"	R-4.2	R-4.2	R-4.2	R-4.2	R-4.2	R-4.2

Source: California Energy Commission

**Table 2019-20: Buried Duct Effective R-Values:
R-4.2 Ducts with Blown Cellulose Attic Insulation**

Duct Diameter	R-30 Ceiling	R-38 Ceiling	R-40 Ceiling	R-43 Ceiling	R-49 Ceiling	R-60 Ceiling
3"	R-15	R-15	R-29	R-29	R-29	R-29
4"	R-9	R-15	R-15	R-15	R-29	R-29
5"	R-9	R-15	R-15	R-15	R-29	R-29
6"	R-9	R-9	R-15	R-15	R-15	R-29
7"	R-4.2	R-9	R-9	R-15	R-15	R-29
8"	R-4.2	R-9	R-9	R-9	R-15	R-29
9"	R-4.2	R-9	R-9	R-9	R-15	R-15
10"	R-4.2	R-4.2	R-9	R-9	R-9	R-15
12"	R-4.2	R-4.2	R-4.2	R-4.2	R-9	R-15
14"	R-4.2	R-4.2	R-4.2	R-4.2	R-4.2	R-9
16"	R-4.2	R-4.2	R-4.2	R-4.2	R-4.2	R-9
18"	R-4.2	R-4.2	R-4.2	R-4.2	R-4.2	R-4.2
20"	R-4.2	R-4.2	R-4.2	R-4.2	R-4.2	R-4.2
22"	R-4.2	R-4.2	R-4.2	R-4.2	R-4.2	R-4.2
24"	R-4.2	R-4.2	R-4.2	R-4.2	R-4.2	R-4.2

Source: California Energy Commission

Duct/Air Handler Leakage

The total duct/air handler leakage shown in ~~Table 21: Duct/Air Handler Leakage~~~~Table 20: Duct/Air Handler Leakage~~~~Table 21: Duct/Air Handler Leakage~~ is used in simulating the duct system. The supply duct leakage for each case is the table value multiplied by 0.585. The return leakage is the table value multiplied by 0.415.

PROPOSED DESIGN

For each ducted system, the software user specifies one of the duct/air handler leakage cases shown in ~~Table 21: Duct/Air Handler Leakage~~~~Table 20: Duct/Air Handler Leakage~~~~Table 21: Duct/Air Handler Leakage~~.

STANDARD DESIGN

For ducted systems, the standard design is sealed and tested duct systems in existing dwelling units or new duct systems.

VERIFICATION AND REPORTING

Sealed and tested duct systems are listed in the HERSECC verification section of on the CF1R. Duct leakage is measured in accordance with procedures and values specified in Reference Appendices, Residential Appendix RA3.

Low-Leakage Air Handlers

A low-leakage air handler may be specified as well as a lower duct leakage value. (See 2.4.7 Duct/Air Handler Leakage~~Section 2.4.7.11 Duct/Air Handler Leakage.~~) Installation requires installing one of the list of approved low-leakage air handling units published by the CEC. The manufacturer certifies that the appliance complies with the requirements of Reference Appendices, Joint Appendices JA9.2.1, 9.2.2, 9.2.3, and 9.2.4.

Table 212021: Duct/Air Handler Leakage

Case	Duct Leakage	Air Handler Leakage	Total Duct/Air Handler Leakage
Duct systems in existing single-family houses	10%	Included in duct leakage	10%
Sealed and tested new or altered duct systems in unconditioned or conditioned space in a townhome or single-family home	5%	2%	7%
Verified low-leakage ducts in conditioned space	0%	0%	0%
Low-leakage air handlers in combination with sealed and tested new duct systems	5% or as measured	0%	5% or as measured

Source: California Energy Commission

PROPOSED DESIGN

Credit can be taken for installing a factory-sealed air-handling unit tested by the manufacturer and certified to the CEC to meet the requirements for a low-leakage air-handler. Field verification of the air handler model number is required.

STANDARD DESIGN

The standard design has a normal air handler.

VERIFICATION AND REPORTING

A low-leakage air handler is reported on the compliance report and field verified in accordance with the procedures specified in Reference Appendices, Residential Appendix RA3.1.4.3.9.

Verified Low-Leakage Ducts in Conditioned Space**PROPOSED DESIGN**

For ducted systems, the user may specify that all ducts are entirely in conditioned space, and the software will model the duct system with no leakage and no conduction losses.

STANDARD DESIGN

The standard design has ducts in the default location.

VERIFICATION AND REPORTING

Systems that have all ducts entirely in conditioned space are reported on the compliance documents and verified by measurements showing duct leakage to outside conditions is equal to or less than 25 CFM when measured in accordance with Reference Appendices, Residential Appendix RA3.

2.4.8 Space-Conditioning Fan Subsystems

Fan systems move air for air-conditioning, heating, and ventilation systems. The software allows the user to define the fans to be used for space-conditioning, IAQ, and ventilation cooling. IAQ and ventilation cooling are discussed in [2.4.10 Indoor Air Quality Ventilation](#) and [2.4.11 Ventilation Cooling System](#).

PROPOSED DESIGN

For the space-conditioning fan system, the user selects the type of equipment and enters basic information to model the energy use of the equipment. For ducted central air-conditioning cooling and heating systems, the fan efficacy default is the mandatory minimum verified efficacy of 0.45, 0.58, or 0.62 Wwatts/CFM , depending on applicable system type (also assumed when there is no cooling system).

STANDARD DESIGN

The standard design shall assume a verified fan efficacy complying with the mandatory requirement of equal to or less than the following:

- 0.45 Wwatts/CFM for gas furnace air-handling units, as well as air-handling unit that are not gas furnaces and have a capacity less than 54,000 BTU/h
- 0.58 Wwatts/CFM for air-handling units that are not gas furnaces and have a capacity greater than or equal to 54,000 BTU/h
- 0.62 Wwatts/CFM for small duct high velocity forced air systems

VERIFICATION AND REPORTING

Minimum verified fan efficacy is mandatory for all ducted cooling systems. Fan efficacy is reported in the HERSECC-required verification listings on the CF1R.

2.4.9 Space-Conditioning Systems

This section describes the general procedures for heating and cooling systems in single-family residential buildings. The system includes the cooling system, the heating system, distribution system, and mechanical fans.

If multiple systems serve a building, each system, and the conditioned space it serves may be modeled in detail separately, or the systems may be aggregated and modeled as one large system. If the systems are aggregated, they must be the same type, and all meet the same minimum specifications.

Multiple System Types Within a Building**PROPOSED DESIGN**

For proposed designs using more than one heating system type, equipment type, or fuel type, if the types do not serve the same floor area, then the user shall zone the building by system type.

STANDARD DESIGN

The standard design shall have the same zoning and heating system types as the proposed design.

VERIFICATION AND REPORTING

The heating system type of each zone is shown on the CF1R.

Multiple Systems Serving Same Area

If a space or a zone is served by more than one heating system, compliance is demonstrated with the most TDV-LSC energy-consuming system serving the space or zone. For spaces or zones that are served by electric resistance heat in addition to other heating systems, the electric resistance heat is deemed the most TDV-LSC energy-consuming system unless the supplemental heating meets the exception to Section 150.1(c)6. See eligibility criteria in Residential Compliance Manual Section 4.2.2 for conditions under which the supplemental heat may be ignored.

For floor areas served by more than one cooling system, equipment, or fuel type, the system, equipment, and fuel type that satisfy the cooling load are modeled.

No Cooling**PROPOSED DESIGN**

When the proposed design has no cooling system, the proposed design is required to model the standard design cooling system defined in Section 150.1(c) and Table 150.1-A. Since the

proposed design system is identical to the standard design system, there is no penalty or credit.

STANDARD DESIGN

The standard design system is the specified in Section 150.1(c) and Table 150.1-A for the applicable climate zone.

VERIFICATION AND REPORTING

No cooling is reported as a special feature on the CF1R.

Zonally Controlled Forced-Air Cooling Systems

Zonally controlled central forced-air cooling systems must be able to deliver, in every zonal control mode, an airflow to the dwelling of ≥ 350 CFM per ton of nominal cooling capacity and operating at an air-handling unit fan efficacy of ≤ 0.45 or 0.58 ~~W~~watts/CFM depending on the applicable system type. This is a HERSECC-verified measure, complying with Reference Appendices, Residential Appendix RA3.3.

An exception allows multispeed or variable-speed compressor systems or single-speed compressor systems to meet the mandatory airflow (CFM/ton) and fan efficacy (watt/CFM) requirements by operating the system at maximum compressor capacity, and system fan speed with all zones calling for conditioning, rather than in every zonal control mode.

PROPOSED DESIGN

The user selects zonally controlled as a cooling system input.

STANDARD DESIGN

The standard design building does not have a zonally controlled cooling system.

VERIFICATION AND REPORTING

Zonally controlled forced-air cooling systems are required to have the system bypass duct status verified by a HERSECC Rater according to the procedures in Reference Appendices, Residential Appendix RA3.1.4.6, and the fan efficacy and airflow rate are required to be verified according to the procedures in Reference Appendices, Residential Appendix RA3.3.

2.4.10 Indoor Air Quality Ventilation

For newly constructed buildings and additions greater than 1,000 ft², the Energy Code requires that all dwelling units meet the requirements of ASHRAE Standard 62.2 with California amendments as specified in Section 150.0(o). Providing acceptable IAQ by mechanical ventilation is one of the requirements of Standard 62.2. For single-family homes, the required mechanical ventilation rate is equal to the total required ventilation rate for the dwelling minus the calculated annually averaged infiltration rate.

The total required ventilation rate for the dwelling unit is calculated using Energy Code, Equation 150.0-B.

Equation 8 (Equation 150.0-B)

$$Q_{total} = 0.03 \times A_{floor} + 7.5 \times (N_{br} + 1) \quad Q_{total} = 0.03A_{floor} + 7.5(N_{br} + 1)$$

Where:

Q_{total} = Total required ventilation rate (CFM)

A_{floor} = Conditioned floor area in square feet (ft²)

N_{br} = Number of bedrooms (not fewer than one)

The effective infiltration rate of the dwelling is calculated using Equation 150.0-C or 150.0-D of the Energy Code.

Equation 9 (Equation 150.0-C & D)

$$Q_{50} = \frac{V_{du} \times ACH_{50}}{60 \text{ min}} \quad Q_{50} = V_{du} \times ACH_{50} / 60 \text{ min}$$

Where:

Q_{50} = Leakage rate at 50 Pa

V_{du} = Dwelling unit conditioned volume (ft³)

ACH_{50} = Air changes per hour at 50 Pa (0.2 inch water).

The software uses a default of 2 ACH_{50} . The user may input dwelling unit leakage less than 2 ACH_{50} , if the leakage rate is verified by the procedures specified in Reference Appendices, Residential Appendix RA 3.8.

The effective annual average infiltration rate is calculated using Energy Code, Equation 150.0-E.

Equation 10 (Equation 150.0-E)

$$Q_{inf} = 0.052 \times Q_{50} \times wsf \times \left(\frac{H}{H_r}\right)^Z \quad Q_{inf} = 0.052 \times Q_{50} \times wsf \times [H/H_r]^Z$$

Where:

Q_{inf} = Effective annual infiltration rate (CFM) (L/s)

Q_{50} = Leakage rate at 50 Pa (from equation 150.0-C or 150.0-D)

wsf = Weather and shielding factor from Table 150.0-D (based on a Climate Zone representative city)

H = Vertical distance between the lowest and highest above-grade points within the pressure boundary (ft)

H_r = Reference height, 8.2 ft

Z = 0.4 for calculating the effective annual average infiltration rate

For single-family and horizontally attached dwelling units, the required mechanical ventilation rate is calculated using Equation 150.0-F of the Energy Code.

Equation 11 (Equation 150.0-F)

$$Q_{fan} = Q_{total} - \phi \times (Q_{inf} \times A_{ext})$$

Where:

Q_{fan} = Fan flow rate in cubic feet per minute (CFM)

Q_{total} = Total required ventilation rate (CFM)

Q_{inf} = Effective annual average infiltration rate, CFM from Equation 150.0-E

A_{ext} = Reduction factor accounting for leaks from adjacent dwelling units; 1 for single-family detached homes, or the ratio of exterior envelope surface area that is not attached to garages or other dwelling units to the total envelope surface area for attached dwelling units not sharing ceilings or floor with other dwelling units, occupiable spaces, public garages, or commercial spaces

ϕ = 1 for balanced ventilation systems and Q_{inf}/Q_{total} otherwise

For estimating the energy impact of this requirement in compliance software, the minimum ventilation rate is met by either a stand-alone IAQ fan system or a central air handler fan system that can introduce outdoor air.

The simplest IAQ fan system is an exhaust fan/bathroom fan that meets the criteria in ASHRAE Standard 62.2 for air delivery and minimal noise. More advanced IAQ fan systems that have a supply or both supply and exhaust fans are possible. To calculate the energy use of stand-alone IAQ fan systems, the systems are assumed to be on continuously.

To calculate the energy use of central fan integrated ventilation, the systems are assumed to be on for at least 20 minutes each hour as described below. The fan flow rate and fan power ratio may be different from the values used when the system is on to provide for heating or cooling, depending on the design or controls on the IAQ ventilation portion of the system.

PROPOSED DESIGN

The proposed design shall incorporate a mechanical ventilation system meeting the above mandatory measures. The compliance software allows the user to specify the IAQ ventilation type (see ~~Table 22: IAQ Fans~~~~Table 21: IAQ Fans~~~~Table 23~~), CFM of outdoor ventilation air equal to or greater than what is required by the Energy Code, and ~~Wwatts~~/CFM. The user must also indicate whether the dwelling unit is attached or detached and the vertical distance between the lowest and highest above-grade points.

The default minimum IAQ fan is a stand-alone unbalanced exhaust system meeting the above airflow requirements.

For balanced systems, the software allows the user to specify the Sensible Recovery Efficiency (SRE) and Adjusted Sensible Recovery Efficiency (ASRE) if the system has energy or heat recovery. If SRE and ASRE are not available at the ventilation CFM that is input for the dwelling unit, the user can enter HVI-listed ratings for an airflow less than the ventilation CFM and greater than the ventilation CFM. The software will interpolate the values at the ventilation CFM. The $\frac{W}{\text{watts}}/\text{CFM}$ for balanced fan systems should be calculated based on the fan power for both fans and the outdoor ventilation rate.

Systems with supply ducts (balanced and supply-only) are simulated with increased fan wattage and reduced SRE and ASRE to account for maintenance and installation factors affecting system efficacy. For these systems, fan wattage is increased by a factor of 1.10 (10 percent increase in wattage), and SRE and ASRE are reduced by a factor of 0.90 (10 percent decrease in recovery efficiencies). For IAQ systems with fault indicator displays (FID) meeting the below specifications provided in Reference Appendices, Joint Appendix JA17, Qualification Requirements for Ventilation Indoor Air Quality Systems Fault Indication Displays, these factors don't apply.

IAQ System Fault Indicator Display Requirements

Installation factors affecting system efficacy do not apply if the following specifications are met:

1. Fault indication responding to the following categories:
 - a. Filter check or maintenance, either based on performance or a predetermined schedule.
 - b. Low supply airflow.
 - c. Low exhaust airflow.
 - d. Sensor failure for sensors that assist in monitoring or controlling for the following operations, where such operations are provided: airflow regulation, frost control, supply air tempering, and economizing.
2. Fault indication using one or more of the following means:
 - a. A visual display that is readily accessible to occupants of the dwelling unit and located on or within one foot of the IAQ system control.
 - b. An electronic application.
 - c. An audible alarm accompanied by a visual display.
3. Instrumentation and reporting of the following:
 - a. Airflow.
 - b. Fan power.
4. FID certified to CEC by the manufacturer as meeting the above requirements.

To receive compliance credit relative to the standard design, balanced and supply-only systems must have accessible supply air filters, outside air inlets, and heat/energy recovery cores (if applicable) as specified in Table 22: IAQ System Component Accessibility Criteria.

For systems not meeting these requirements, compliance credit will be neutralized. (See IAQ system standard design for details.)

Table 22: IAQ System Component Accessibility Criteria

Dwelling Unit Ventilation System Component	Location	Accessible Determination
Outdoor Air Intake	All locations	Intake louvers, grilles, or screens shall be >3/8 inches except where prohibited by local jurisdictions or other code requirements.
Outdoor Air Intake	Exterior wall, soffit, or gable end	A point on the perimeter of the outdoor air intake shall be located within 10 feet of a walking surface or grade or the system shall meet the IAQ System FID requirements in the ACM Reference Manual.
Outdoor Air Intake	Roof	Access shall be provided in accordance with California Mechanical Code Section 304.3.1 requirements for appliances.
Filters and Heat Exchangers	Serviceable from conditioned space, unconditioned basements, or mechanical closets. Heat exchangers may also be serviceable from unconditioned attics if the IAQ system meets the FID requirements in the RACM Reference Manual.	The H/ERV or supply ventilation system access panel shall be located within 10 feet of the walking surface.

Source: California Energy Commission

STANDARD DESIGN

For single-family residential buildings, the standard design mechanical ventilation system type (balanced, supply, or exhaust) is the same as the proposed. Fan efficacy is 0.35 ~~W~~watts/CFM for exhaust or supply systems and 0.70 ~~W~~watts/CFM for balanced systems. Airflow rate is equal to the proposed design value or 1.25 times the CFM required by the Energy Code, whichever is smaller.

If the proposed IAQ system uses the central air handler fan, the standard design IAQ fan efficacy is equal to:

- 0.45 ~~W~~watts/CFM for gas furnace air-handling units, as well as air-handling unit that are not gas furnaces and have a capacity less than 54,000 BTU/h.
- 0.58 ~~W~~watts/CFM for air-handling units that are not gas furnaces and have a capacity greater than or equal to 54,000 BTU/h.
- 0.62 ~~W~~watts/CFM for small-duct high-velocity forced air systems.

The standard design is assumed to meet the accessibility criteria in the Energy Code Section 150.0(o)1~~Civ-Table 22: IAQ System Component Accessibility Criteria~~ and incorporates an FID meeting the requirements in Reference Appendices, Joint Appendix JA17, Qualification Requirements for Indoor Air Quality Venitlation Systems Fault Indicationer Display~~sthis section.~~

~~If the proposed design is balanced or supply only and doesn't meet the accessible requirements listed in Table 22: IAQ System Component Accessibility Criteria, the standard design W/CFM equals the proposed or the default value whichever is lower. Furthermore if the proposed system has heat recovery the standard will have heat recovery with SRE and ASRE equal to the proposed system. Otherwise, the standard design does not have heat recovery.~~

VERIFICATION AND REPORTING

The required ventilation rate to comply with the Energy Code and the means to achieve compliance are indicated on the CF1R. The IAQ system characteristics are reported in the HERSECC-required verification listing on the CF1R. The diagnostic testing procedures are in Reference Appendices, Residential Appendix RA3.7.

Special features are reported on the CF1R when the proposed system has heat or energy recovery or when the proposed fan efficacy is less than (that is, more efficient than) 0.35 ~~W~~watts/CFM for single-family residential buildings.

Table ~~222123~~23: IAQ Fans

Type	Description	Inputs
Stand-alone IAQ Fan (exhaust, supply, or balanced)	Dedicated fan system that provides IAQ ventilation to meet or exceed the requirements of Energy Code Section 150.0(o).	CFM, W watts/CFM, and SRE and ASRE for balanced systems
Central Fan Integrated (CFI) (variable- or fixed-speed)	Automatic operation of the air handler for IAQ ventilation. Ventilation type uses a special damper to induce outdoor IAQ ventilation air and distribute it through the HVAC duct system. Mixing type distributes	CFM, W watts/CFM

Type	Description	Inputs
	and mixes IAQ ventilation air supplied by a separate stand-alone IAQ fan system.	

Source: California Energy Commission

2.4.11 Ventilation Cooling System

Ventilation cooling systems operate at the dwelling-unit level using fans to bring in outside air to cool the house when the air can reduce cooling loads and save cooling energy. System operation is limited to single-family dwellings and operate according to the schedule and set points shown in Table 24: Hourly Thermostat Set Points~~Table 23: Hourly Thermostat Set Points~~~~Table 25~~. Whole-house fans require either window operation and attic venting or ducting to exhaust hot air. Central fan ventilation cooling systems (fixed and variable-speed) use the HVAC duct system to distribute outside air and require attic venting. Whole-house fans, which exhaust air through the attic, require at least 1 ft² of free attic ventilation area per 750 CFM of rated capacity for relief or, if greater, the manufacturer specifications. (See Section 150.1[c]12 of the Energy Code.)

PROPOSED DESIGN

Software allows the user to specify whether a ventilation cooling system (*Table 24* for system types) is included in conditioned and living zones. The user can specify the airflow and ~~W~~watts/CFM (HERSECC verification required) or a default prescriptive whole-house fan with a capacity of 1.5 CFM/ft² of conditioned floor area. When the default capacity is selected, the user can select HERSECC verification of the airflow and watts to receive full credit for the system capacity. When HERSECC verification is not selected, the fan capacity is reduced by a factor of 0.67 (33 percent reduction). Ventilation cooling airflow is limited to 3.5 CFM/ft² of conditioned area.

STANDARD DESIGN

The standard design building for a newly constructed single-family residential building or for an addition greater than 1,000 ft² to a single-family residential building has a whole-house fan in Climate Zones 8–14, and no ventilation cooling in other climate zones. (See Section 150.1[c] and Table 150.1-A.) The whole-house fan has 1.5 CFM/ft² of conditioned floor area, 0.14 watts/CFM, with 1 ft² of attic vent free area for each 750 CFM of rated whole-house fan airflow CFM.

VERIFICATION AND REPORTING

A ventilation cooling system is either a special feature or a HERSECC verification requirement, the size and type of which are reported on the CF1R (Table 23: Ventilation Cooling Fans~~Table 22: Ventilation Cooling Fans~~~~Table 24: Ventilation Cooling Fans~~).

Table 232224: Ventilation Cooling Fans

Measure	Description	HERSECC Verification
Whole-House Fan	Traditional whole-house fan mounted in the ceiling to exhaust air from the house to the attic, inducing outside air in through open windows. Whole-house fans are assumed to operate between dawn and 11 p.m. only at 33 percent of rated CFM to reflect manual operation of fan and windows by occupant. Fans must be listed in the CEC's Whole House Fan directory. If multiple fans are used, enter the total CFM.	Optional RA3.9
Central Fan Ventilation Cooling Variable- or fixed-speed	Central fan ventilation cooling system. Ventilation type uses a special damper to induce outdoor air and distribute it through the HVAC duct system.	Required RA3.3.4

Source: California Energy Commission

2.5 Conditioned Zones

The software requires the user to enter the characteristics of one or more conditioned zones. Subdividing single-family dwelling units into conditioned zones for input convenience or increased accuracy is optional.

2.5.1 Zone Type

Proposed Design

The zone is defined as conditioned, living, or sleeping. Other zone types include garage, attic, and crawl space.

Standard Design

The standard design is conditioned.

VERIFICATION AND REPORTING

When the zone type is living or sleeping, this is reported as a special feature on the CF1R.

Heating Zonal Control Credit

With the heating zonal control credit, the sleeping and living areas are modeled separately for heating, each with its own separate thermostat schedule and internal gain assumptions. Zonal control cannot be modeled with heat pump heating. The total nonclosable opening area between zones cannot exceed 40 ft². Other eligibility criteria for this measure are presented in the Residential Compliance Manual, Chapter 4.

PROPOSED DESIGN

The user selects zonal control as a building level input with separate living and sleeping zones.

STANDARD DESIGN

The standard design building is not zoned for living and sleeping separately.

VERIFICATION AND REPORTING

Zonal control is reported as a special feature on the CF1R.

2.5.2 Conditioned Floor Area

The total conditioned floor area (CFA) is the raised floor as well as the slab-on-grade floor area of the conditioned spaces measured from the exterior surface of exterior walls. Stairs are included in conditioned floor area as the area beneath the stairs and the tread of the stairs.

PROPOSED DESIGN

The compliance software requires the user to enter the total conditioned floor area of each conditioned zone.

STANDARD DESIGN

The standard design building has the same conditioned floor area and same conditioned zones as the proposed design.

VERIFICATION AND REPORTING

The conditioned floor area of each conditioned zone is reported on the CF1R.

2.5.3 Number of Stories**Number of Stories of the Zone****PROPOSED DESIGN**

The number of stories of the zone.

STANDARD DESIGN

The standard design is the same as the proposed design.

Ceiling Height**PROPOSED DESIGN**

The average ceiling height of the proposed design is used to calculate the conditioned volume of the building envelope. The volume (in cubic feet) is determined from the total conditioned floor area and the average ceiling height.

STANDARD DESIGN

The volume of the standard design building is the same as the proposed design.

VERIFICATION AND REPORTING

The conditioned volume of each zone is reported on the CF1R.

Free Ventilation Area

Free ventilation area is the window area adjusted to account for bug screens, window framing and dividers, and other factors.

PROPOSED DESIGN

Free ventilation area for the proposed design is calculated as 5 percent of the fenestration area (rough opening), assuming all windows are operable.

STANDARD DESIGN

The standard design value for free ventilation area is the same as the proposed design.

VERIFICATION AND REPORTING

Free ventilation is not reported on the CF1R.

Ventilation Height Difference

Ventilation height difference is not a user input.

PROPOSED DESIGN

The default assumption for the proposed design is 2 feet for one-story buildings or one-story dwelling units and 8 feet for two or more stories (as derived from number of stories and other zone details).

STANDARD DESIGN

The standard design is the same as the proposed design.

Zone Elevations

The elevation of the top and bottom of each zone is required to set up the airflow network.

PROPOSED DESIGN

The user enters the height of the top surface the lowest floor of the zone relative to the ground outside as the "bottom" of the zone. The user also enters the ceiling height (the floor-to-floor height [ceiling height plus the thickness of the intermediate floor structure] is calculated by the software).

Underground zones are indicated with the number of feet below grade (for example, -8).

STANDARD DESIGN

The standard design has the same vertical zone dimensions as the proposed design.

Mechanical Systems

PROPOSED DESIGN

The software requires the user to specify a previously defined HVAC system to provide heating and cooling for the zone and an IAQ ventilation system. The user may also specify a ventilation cooling system that applies to this and other conditioned zones.

STANDARD DESIGN

The software assigns standard design HVAC, IAQ ventilation, and ventilation cooling systems based on Section 150.1(c) and Table 150.1-A for the applicable climate zone.

Natural Ventilation

Natural ventilation (from windows) is available during cooling mode when needed and available, as shown in Table 24: Hourly Thermostat Set Points~~Table 23: Hourly Thermostat Set Points~~~~Table 25: Hourly Thermostat Set Points~~. The amount of natural ventilation used by computer software for natural cooling is the lesser of the maximum potential amount available and the amount needed to drive the interior zone temperature down to the natural cooling set point. When natural cooling is not needed or is unavailable, no natural ventilation is used.

Computer software shall assume that natural cooling is needed when the building is in "cooling mode," when the outside temperature is below the estimated zone temperature, and when the estimated zone temperature is above the natural cooling set point temperature. Only the amount of ventilation required to reduce the zone temperature to the natural ventilation set point temperature is used, and the natural ventilation set point temperature is constrained by the compliance software to be greater than the heating setpoint temperature.

Table 242325: Hourly Thermostat Set Points

Hour	Cooling	Venting	Heat Pump Heating	Standard Gas Heating Single-Zone	Zonal Control Gas Heating Living	Zonal Control Gas Heating Sleeping
1	78	Off	68	65	65	65
2	78	Off	68	65	65	65
3	78	Off	68	65	65	65
4	78	Off	68	65	65	65
5	78	Off	68	65	65	65
6	78	68*	68	65	65	65
7	78	68	68	65	65	65
8	78	68	68	68	68	68
9	78	68	68	68	68	68
10	78	68	68	68	68	65
11	78	68	68	68	68	65
12	78	68	68	68	68	65
13	78	68	68	68	68	65
14	78	68	68	68	68	65
15	78	68	68	68	68	65
16	78	68	68	68	68	65
17	78	68	68	68	68	68
18	78	68	68	68	68	68
19	78	68	68	68	68	68
20	78	68	68	68	68	68
21	78	68	68	68	68	68
22	78	68	68	68	68	68
23	78	68	68	68	68	68
24	78	Off	68	65	65	65

**Venting starts in the hour the sun comes up.*

Source: California Energy Commission

2.5.4 Conditioned Zone Assumptions

Internal Thermal Mass

Internal mass objects are completely inside a zone so that they do not participate directly in heat flows to other zones or outside. They are connected to the zone radiantly and convectively and participate in the zone energy balance by passively storing and releasing heat as conditions change.

~~Table 25: Conditioned Zone Thermal Mass Objects~~~~Table 24: Conditioned Zone Thermal Mass Objects~~~~Table 26: Conditioned Zone Thermal Mass Objects~~ shows the standard interior conditioned zone thermal mass objects and the calculation of the simulation inputs that represent them.

Table ~~25~~~~24~~26: Conditioned Zone Thermal Mass Objects

Item	Description	Simulation Object
Interior walls	The area of one side of the walls completely inside the conditioned zone is calculated as the conditioned floor area of the zone minus 1/2 of the area of interior walls adjacent to other conditioned zones. The interior wall is modeled as a construction with 25 percent 2x4 wood framing and sheetrock on both sides.	Wall exposed to the zone on both sides
Interior floors	The area of floors completely inside the conditioned zone is calculated as the difference between the CFA of the zone and the sum of the areas of zone exterior floors and interior floors over other zones. Interior floors are modeled as a surface inside the zone with a construction of carpet, wood decking, 2x12 framing at 16 in. on-center with miscellaneous bridging, electrical, and plumbing, and a sheetrock ceiling below.	Floor/ceiling surface exposed to the zone on both sides
Furniture and heavy contents	Contents of the conditioned zone with significant heat storage capacity and delayed thermal response, for example heavy furniture, bottled drinks, canned goods, contents of dressers, enclosed cabinets. These are represented by a 2 in. thick slab of wood twice as large as the conditioned floor area, exposed to the room on both sides.	Horizontal wood slab exposed to the zone on both sides

Item	Description	Simulation Object
Light and thin contents	Contents of the conditioned zone that have a large surface area compared to weight, for example, clothing on hangers, curtains, pots, and pans. These are assumed to be 2 Btu per square foot of conditioned floor area.	Air heat capacity (C_{air}) = CFA * 2

Source: California Energy Commission

PROPOSED DESIGN

The proposed design has standard conditioned zone thermal mass objects (such as gypsum board in walls, cabinets, sinks, and tubs) that are not user-editable and are not a compliance variable. If the proposed design includes specific interior thermal mass elements that are significantly different from what is included in typical wood-frame production housing, such as masonry partition walls, the user may include them. See also [2.5.6 Exterior Thermal Mass](#).

STANDARD DESIGN

The standard design has standard conditioned zone thermal mass objects.

Thermostats and Schedules

Thermostat settings are shown in [Table 24: Hourly Thermostat Set Points](#). The values for cooling, venting, and standard heating apply to the standard design run and are the default for the proposed design run. See the explanation later in this section regarding the values for zonal control.

Heat pumps equipped with supplementary electric resistance heating are assumed to meet mandatory control requirements specified in Section 110.2(b) and (c).

Systems with no setback required by Section 110.2(c) (gravity gas wall heaters, gravity floor heaters, gravity room heaters, noncentral electric heaters, fireplaces or decorative gas appliances, wood stoves, room air-conditioners, and room-air-conditioner-heat pumps) are assumed to have a constant heating set point of 68 degrees Fahrenheit. The cooling set point from [Table 24: Hourly Thermostat Set Points](#) is assumed in both the proposed and standard designs.

PROPOSED DESIGN

The proposed design assumes a mandatory setback thermostat meeting the requirements of Section 110.2(c). Systems exempt from that are not required to have the requirement for a setback thermostat are assumed to have no setback capabilities.

STANDARD DESIGN

The standard design has setback thermostat conditions based on the mandatory requirement for a setback thermostat. For equipment that is not required to have exempt from the a setback thermostat requirement, the standard design has no setback thermostat capabilities.

Determining Heating Mode vs. Cooling Mode

When the building is in the heating mode, the heating set points for each hour are set to the "heating" values in Table 24: Hourly Thermostat Set Points~~Table 23: Hourly Thermostat Set Points~~Table 25: Hourly Thermostat Set Points, the cooling set point is a constant 78 degrees Fahrenheit (°F), and the ventilation set point is set to a constant 77°F. When the building is in the cooling mode, the heating set point is a constant 60°F, and the cooling and venting set points are set to the values in Table 24: Hourly Thermostat Set Points~~Table 23: Hourly Thermostat Set Points~~Table 25: Hourly Thermostat Set Points.

The mode depends upon the outdoor temperature averaged over hours 1 through 24 of eight days prior to the current day through two days prior to the current day. (For example, if the current day is June 21, the mode is based on the average temperature for June 13 through 20.) When this running average temperature is equal to or less than 60°F, the building is in a heating mode. When the running average is greater than 60°F, the building is in a cooling mode.

2.5.5 Internal Gains

Internal gains assumptions are included in Appendix E and consistent with the CASE report on plug loads and lighting (Rubin 2016, see Appendix F).

Proposed Design

Plug loads and lighting are fixed assumptions that vary based on the time of day, day of the week (for example, weekday vs. weekend), and season.

Standard Design

The standard design internal gains are the same as the proposed design.

2.5.6 Exterior Surfaces

The user enters exterior surfaces to define the envelope of the proposed design. The areas, construction assemblies, orientations, and tilts modeled are consistent with the actual building design and shall equal the overall roof/ceiling area with conditioned space on the inside and unconditioned space on the other side.

Ceilings Below Attics

Ceilings below attics are horizontal surfaces between conditioned zones and attics. The area of the attic floor is determined by the total area of ceilings below attics defined in conditioned zones.

PROPOSED DESIGN

The software allows the user to define ceilings below attic, enter the area, and select a construction assembly for each.

The compliance software will verify that the area-weighted average U-factor for ceiling and rafter roof assemblies meets the mandatory maximum U-factor of 0.043. The software will also verify that the area-weighted average U-factor for roof assemblies that are above conditioned space in Climate Zones 4, and 8-16 meets the mandatory maximum U-factor of 0.184, unless duct systems meet one of the following:

- Ducts located within the conditioned space (except < 12 linear ft)
- Ducts located entirely in conditioned space below the ceiling separating the occupiable space from the attic
- Verified low leakage ducts entirely in conditioned space
- Distribution system without ducts (none)
- Ducts buried within attic insulation that complies using Section 150.1(b) and verified according to RA3.1.4.1

If the mandatory requirements are not met, the user will receive an error message and the simulation will not proceed.

STANDARD DESIGN

The standard design for newly constructed buildings has the same ceiling-below-attic area as the proposed design. The standard design is a high-performance attic with a ceiling constructed with 2x4 framed trusses and insulated with the R-values specified in Section 150.1(c) and Table 150.1-A for the applicable climate zone, assuming Option B. The roof surface is a 10 lbs/ft² tile roof with an air space when the proposed roof is steep slope or a lightweight roof when the proposed roof is low slope.

Single-family dwelling units: Below-roof-deck insulation has R-0 in Climate Zones 1–3 and 5–7 and R-19 in Climate Zones 4 and 8–16. Insulation on the ceiling has R-38 in Climate Zones 1, 2, 4, and 8–16 and R-30 insulation in Climate Zones 3 and 5–7. Climate Zones 2, 3, and 5–7 have a radiant barrier, and Climate Zones 1, 4, and 8–16 have no radiant barrier.

VERIFICATION AND REPORTING

Ceiling below attic area and constructions are reported on the CF1R. SIP assemblies are reported as a special feature on the CF1R.

Non-Attic (Cathedral) Ceiling and Roof

Non-attic ceilings, also known as cathedral ceilings, are surfaces with roofing on the outside and finished ceiling on the inside but without an attic space.

PROPOSED DESIGN

The software allows the user to define cathedral ceilings, enter the area, and select a construction assembly for each. The user also enters the roof characteristics of the surface.

STANDARD DESIGN

The standard design has the same area as the proposed design cathedral ceiling modeled as a cathedral ceiling below attic with the features of Option CB from Section 150.1(e)(c) and Table 150.1-A or for the applicable climate zone. The total cathedral ceiling area is equally divided among the four main compass points – north, east, south, and west.

~~The standard design building has an area of ceiling below attic equal to the non-attic ceiling/roof areas of the proposed design. The standard design roof and ceiling surfaces are modeled with the same construction assembly and characteristics, aged solar reflectance, and thermal emittance characteristics as Section 150.1(c), Table 150.1-A for the applicable roof slope and climate zone.~~

VERIFICATION AND REPORTING

Non-attic ceiling/roof area and constructions are reported on the CF1R. SIP assemblies are reported as a special feature on the CF1R.

Exterior Walls**PROPOSED DESIGN**

The software allows the user to define walls, enter the gross area, and select a construction assembly for each. The user also enters the plan orientation (front, left, back, or right) or plan azimuth (value relative to the front, which is represented as zero degrees) and tilt of the wall.

The wall areas modeled are consistent with the actual building design, and the total wall area is equal to the gross wall area with conditioned space on the inside and unconditioned space or exterior conditions on the other side. Underground mass walls are defined with inside and outside insulation and the number of feet below grade. Walls adjacent to unconditioned spaces with no solar gains (such as knee walls or garage walls) are entered as an interior wall with the zone on the other side specified as attic, garage, or another zone, and the compliance manager treats that wall as a demising wall. An attached unconditioned space is modeled as an unconditioned zone.

The compliance software will check-verify that the wall assembly entered by the user meets the mandatory U-factor or insulation requirements. If it does not, the user will receive an error message, and the simulation will not proceed.

STANDARD DESIGN

The standard design building has high-performance walls modeled with the same area of framed walls as in the proposed design separating conditioned space and the exterior, with a U-factor equivalent to that as specified in Section 150.1(c)1.B and Table 150.1-A for the applicable climate zone.

Single-family dwellings: Above-grade framed walls in Climate Zones 1–5 and 8–16 have 2x6 16-in. on center wood framing with R-21 insulation between framing and R-5 continuous insulation (0.048 U-factor). Climate Zones 6 and 7 above-grade walls have 2x4

16-in. on center wood framing with R-15 insulation between framing and R-4 continuous insulation (0.065 U-factor). Walls adjacent to unconditioned space, such as garage walls, are treated the same as exterior walls, except there is no continuous insulation.

Above-grade mass walls are 6-inch concrete with R-13 interior insulation in 3.5-inch wood furring in Climate Zones 1–15 and R-17 in Climate Zone 16. Below-grade mass walls in Climate Zones 1–15 have R-13, and Climate Zone 16 has R-15 interior insulation in 3.5-inch wood furring. When the proposed design is a wall type such as SIP, straw bale, or other construction type not specifically mentioned above, the standard design wall is a wood-framed wall meeting the requirements of Section 150.1(c) Table 150.1-A.

The total gross exterior wall area in the standard design is equal to the total gross exterior wall area of the proposed design for each wall type. The gross exterior wall area of framed walls in the standard design (excluding demising walls) is equally divided among the four main compass points – north, east, south, and west. The gross exterior wall area of mass walls in the standard design (excluding demising walls and below-grade walls) is equally divided among these four main compass points. Window and door areas are subtracted from the gross wall area to determine the net wall area in each orientation.

VERIFICATION AND REPORTING

Exterior wall area and construction details are reported on the CF1R. Metal-framed and SIP assemblies are reported as a special feature on the CF1R.

Exterior Thermal Mass

Constructions for standard exterior mass are supported but not implemented beyond the assumptions for typical mass.

The performance approach assumes that both the proposed design and standard design building have a minimum mass as a function of the conditioned area of slab floor and non-slab floor. (See 2.5.4 Internal Thermal Mass ~~Section 2.5.4.1 Internal Thermal Mass.~~)

Mass such as concrete slab floors, masonry walls, double gypsum board, and other special mass elements can be modeled. When the proposed design has more than the typical assumptions for mass in a building, then each element of heavy mass is modeled in the proposed design, otherwise; the proposed design is modeled with the same thermal mass as the standard design.

PROPOSED DESIGN

The proposed design may be modeled with the default 20 percent exposed mass/80 percent covered mass or with actual mass areas modeled as separate covered and exposed mass surfaces. Exposed mass surfaces covered with flooring material that is in direct contact with the slab can be modeled as exposed mass. Examples of such materials are tile, stone, vinyl, linoleum, and hard-wood.

STANDARD DESIGN

The conditioned slab floor in the standard design is assumed to be 20 percent exposed slab and 80 percent slab covered by carpet or casework. Interior mass assumptions as described in [2.5.4 Internal Thermal Mass](#) ~~Section 2.5.4.1 Internal Thermal Mass~~ are also assumed. No other mass elements are modeled in the standard design. The standard design mass is modeled with the following characteristics:

- The conditioned slab floor area (slab area) shall have a thickness of 3.5 inches, a volumetric heat capacity of 28 Btu/ft³-° F, and a conductivity of 0.98 Btu-in/hr-ft²-° F. The exposed portion shall have a surface conductance of 1.3 Btu/h-ft²-° F (no thermal resistance on the surface), and the covered portion shall have a surface conductance of 0.50 Btu/h-ft²-° F, typical of a carpet and pad.
- The “exposed” portion of the conditioned nonslab floor area shall have a thickness of 2.0 inches, a volumetric heat capacity of 28 Btu/ft³-° F, a conductivity of 0.98 Btu-in/hr-ft²-° F; and a surface conductance of 1.3 Btu/h-ft²-° F (no added thermal resistance on the surface). These thermal mass properties apply to the “exposed” portion of nonslab floors for both the proposed design and standard design. The covered portion of nonslab floors is assumed to have no thermal mass.

VERIFICATION AND REPORTING

Exposed mass greater than 20 percent exposed slab on grade, and any other mass modeled by the user are reported as a special feature on the CF1R.

Doors

Doors are defined as an opening in a building envelope. If the rough opening of a door includes fenestration equal to 25 percent or more of glass or fenestration, it is fenestration. (See [2.5.6 Fenestration](#) ~~Section 2.5.6.6 Fenestration~~.) Doors with less than 25 percent fenestration are considered an opaque door.

PROPOSED DESIGN

The compliance software shall allow users to enter doors specifying the U-factor, area, and orientation. Doors to the exterior or to unconditioned zones are modeled as part of the conditioned zone. For doors with less than 25 percent glass area, the U-factor shall come from Reference Appendices, Joint Appendix JA4, Table 4.5.1 (default U-factor 0.20) or from ~~National Fenestration Rating Council (NFRC)~~ certification data for the entire door. For unrated doors, the glass area of the door, calculated as the sum of all glass surfaces plus 2 inches on all sides of the glass (to account for a frame), is modeled under the rules for fenestrations. The opaque area of the door is considered the total door area minus this calculated glass area. Doors with 25 percent or more glass area are modeled under the rules for fenestrations using the total area of the door.

When modeling a garage zone, large garage doors (metal roll-up or wood) are modeled with a 1.0 U-factor.

STANDARD DESIGN

The standard design has the same door area for each dwelling unit as the proposed design. The standard design door area is distributed equally among the four main compass points – north, east, south, and west. The U-factor for the standard design is taken from Section 150.1(c) and Table 150.1-A. All swinging opaque doors are assumed to have a U-factor of 0.20. The net opaque wall area is reduced by the door area in the standard design.

VERIFICATION AND REPORTING

Door area and U-factor are reported on the CF1R.

Fenestration

Fenestration is modeled with a U-factor and solar heat gain coefficient (SHGC). Acceptable sources of these values are National Fenestration Rating Council (NFRC), default tables from Section 110.6 of the Energy Code, and Reference Appendices, Nonresidential Appendix NA6.

In limited cases for certain site-built fenestration that is field fabricated, the performance factors (U-factor, SHGC) may come from Reference Appendices, Nonresidential Appendix NA6 as described in Exception 4 to Section 150.1(c)3A.

There is no detailed model of chromogenic fenestration available. As allowed by Exception 3 to Section 150.1(c)3A, the lower-rated labeled U-factor and SHGC may be used only when installed with automatic controls as noted in the exception. Chromogenic fenestration cannot be averaged with nonchromogenic fenestration.

PROPOSED DESIGN

The compliance software allows users to enter individual skylights and fenestration types, the U-factor, SHGC, area, orientation, and tilt.

Performance data (U-factors and SHGC) are from NFRC values or from the CEC default tables from Section 110.6 of the Energy Code. In spaces other than sunspaces, solar gains from windows or skylights use the California Simulation Engine (CSE) default solar gain targeting.

Skylights are a fenestration with a slope of 60 degrees or more. Skylights are modeled as part of a roof.

The compliance software will check that the area weighted window U-factor for all fenestration meets the mandatory U-factor for window requirements. If it does not, the user will receive an error message and the simulation will not proceed.

STANDARD DESIGN

If the proposed design fenestration area is less than 20 percent of the conditioned floor area, the standard design fenestration area is set equal to the proposed design fenestration area. Otherwise, the standard design fenestration area is set equal to 20 percent of the conditioned floor area. The standard design fenestration area is distributed equally among the four main compass points — north, east, south, and west.

The standard design has no skylights.

The net wall area on each orientation is reduced by the fenestration area and door area on each façade. The U-factor and SHGC performance factors for the standard design are taken from Section 150.1(c) and Table 150.1-A, which is 0.2730 U-factor except in the following instances in all climate zones. Homes with greater than 500 square feet of conditioned floor area in climate zone 6-10 and 157 have a U-factor of 0.3028 U-factor. Homes with 500 square feet or less of conditioned floor area in climate zones 5-10 and 15 have a 0.30 U-factor. SHGC is 0.23 in Climate Zones 2, 4, and 6-1415 and SHGC is 0.20 in climate zone 15. Where there is no prescriptive requirement (Climate Zones 1, 3, 5, and 16), the SHGC is set to 0.35.

VERIFICATION AND REPORTING


Fenestration area, U-factor, SHGC, orientation, and tilt are reported on the CF1R. SHGC is reported on the CF1R as an allowable maximum and minimum for each window calculated as the SHGC entered by the user plus or minus 0.01.

Overhangs and Sidesfins


PROPOSED DESIGN

Software users enter a set of basic parameters for a description of an overhang and sidesfin for each fenestration or window area entry. The basic parameters include fenestration height, overhang/sidesfin length, and overhang/sidesfin height. Compliance software user entries for overhangs may also include fenestration width, overhang left extension, and overhang right extension. Compliance software user entries for sidesfins may also include fin left extension and fin right extension for both left and right fins. Walls at right angles to windows may be modeled as sidesfins.

Figure 65: Overhang Dimensions

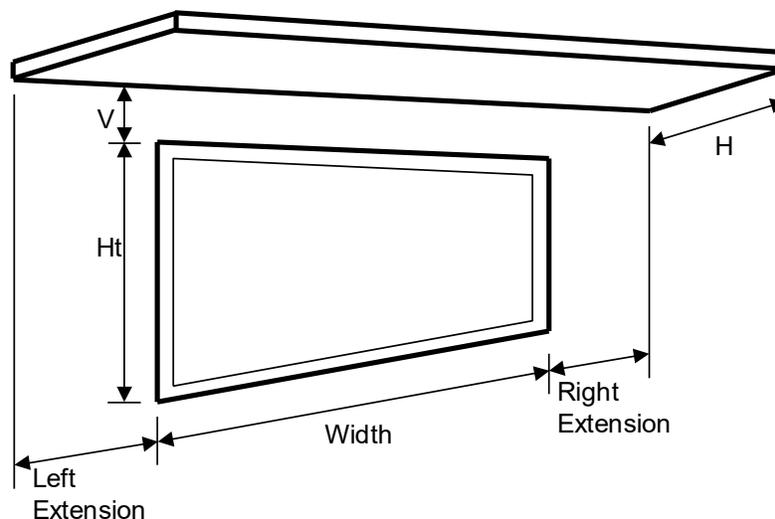

Source: California Energy Commission

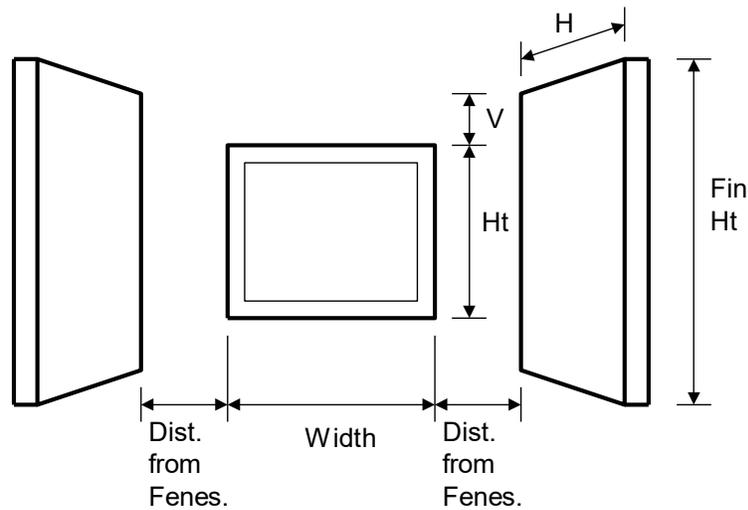Figure 76: Sidefin Dimensions

Source: California Energy Commission

STANDARD DESIGN

The standard design does not have overhangs or sidefins.

VERIFICATION AND REPORTING

Overhang and fin dimensions are reported on the CF1R.

Interior Shading Devices

For both the proposed and standard designs, all windows are assumed to have draperies, and skylights are assumed to have no interior shading. Window medium drapes are closed at night and half open in the daytime hours. Interior shading is not a compliance variable and is not user-editable.

Exterior Shading

For both the proposed and standard design, all windows are assumed to have bug screens, and skylights are assumed to have no exterior shading. Exterior shading is modeled as an additional glazing system layer using the ASHRAE Window Attachment (ASHWAT) calculation.

PROPOSED DESIGN

The compliance software shall require the user to accept the default exterior shading devices, which are bug screens for windows and none for skylights. Credit for shading devices that are allowable for prescriptive compliance are not allowable in performance compliance.

STANDARD DESIGN

The standard design shall assume bug screens. The standard design does not have skylights.

Slab on Grade Floors

PROPOSED DESIGN

The software allows users to enter areas and exterior perimeter of slabs that are heated or unheated, covered, or exposed, and with or without slab-edge insulation. Perimeter is the length of wall between conditioned space and the exterior, but it does not include edges that cannot be insulated, such as between the house and the garage. The default condition for the proposed design is that 80 percent of each slab area is carpeted or covered by walls and cabinets, and 20 percent is exposed. Inputs other than the default condition require that carpet and exposed slab conditions are documented on the construction plans.

When the proposed heating distribution is radiant floor heating (heated slab), the software user will identify that the slab is heated and model the proposed slab edge insulation. The mandatory minimum requirement is R-5 insulation in Climate Zones 1–15 and R-10 in Climate Zone 16 (Section 110.8[g], Table 110.8-A).

STANDARD DESIGN

The standard design perimeter lengths and slab on grade areas are the same as the proposed design. Eighty percent of standard design slab area is carpeted, and 20 percent is exposed. For the standard design, an unheated slab edge has no insulation with the exception of Climate Zone 16, which assumes R-7 to a depth of 16 inches. The standard design for a heated slab is a heated slab with the mandatory slab edge insulation of R-5 in Climate Zones 1–15 and R-10 in Climate Zone 16.

VERIFICATION AND REPORTING

Slab areas, perimeter lengths, and inputs of other than the default condition are reported on the CF1R.

Underground Floors

PROPOSED DESIGN

The software allows users to enter areas and depth below grade of slab floors occurring below grade. Unlike slab-on-grade floors, there is no perimeter length associated with underground floors.

STANDARD DESIGN

The standard design underground floor areas are the same as the proposed design.

Raised Floors

PROPOSED DESIGN

The software allows the user to input floor areas and constructions for raised floors over a crawl space, over exterior (garage or unconditioned), and concrete raised floors. The proposed floor area and constructions are consistent with the actual building design.

STANDARD DESIGN


The standard design has the same area and type of construction as the proposed design. The thermal characteristics meet Section 150.1(c) and Table 150.1-A. For floor areas that are framed construction, the standard design floor has R-19 in 2x6 wood framing, 16-in. on center (0.037 U-factor). For floor areas that are concrete raised floors, the standard design floor is 6 inches of normal-weight concrete with R-8 continuous insulation in $\text{Climate Zones 1, 2, 11, 13, 14, 16}$; $\text{Climate Zones 12 and 15}$ have R-4; $\text{Climate Zones 3–10}$ have R-0.

VERIFICATION AND REPORTING

Raised floor areas and constructions are reported on the CF1R.

2.6 Attics

The compliance software models attics as a separate thermal zone and includes the interaction with the air distribution ducts, infiltration exchange between the attic and the house, the solar gains on the roof deck, and other factors. These interactions are illustrated in [Figure 7: Attic Model Components](#)~~Figure 7: Attic Model Components~~~~Figure 8: Attic Model Components~~.

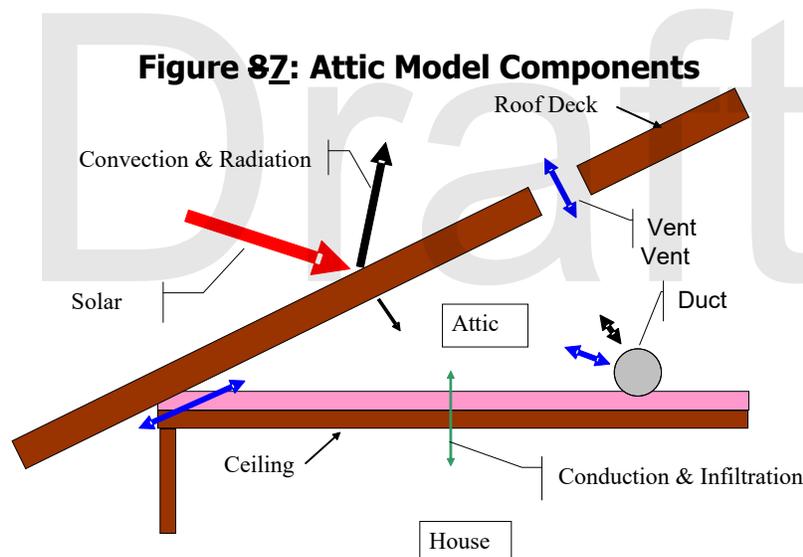

Source: California Energy Commission

2.6.1 Attic Components

Roof Rise

The roof rise is the ratio of rise to run (or pitch) and refers to the number of feet the roof rises vertically for every 12 feet horizontally. For roofs with multiple pitches, the roof rise that makes up the largest roof area is used.

Vent Area

This value is the vent area as a fraction of attic floor area. This value is not a compliance variable and is assumed set equal to attic floor area divided by 300.

Fraction High

This is the fraction of the vent area that is high due to the presence of ridge, roof, or gable end-mounted vents. Soffit vents are considered low ventilation. The default value is zero for attics with standard ventilation. Attics with radiant barriers are required to have a vent high fraction of at least 0.3.

Roof Deck/Surface Construction

Typical roof construction types are concrete or clay tile, metal tile, gravel, ballast, or other steep- or low-sloped roofing types.

Solar Reflectance

This input is a fraction that specifies the certified aged reflectance of the roofing material or 0.1 default value for uncertified materials. The installed value must be equal to or higher than the value specified on the certificate of compliance. Roof construction with a roof membrane mass of at least 25 lbs/ft², or a roof area that has integrated solar collectors, is assumed to meet the minimum solar reflectance.

Thermal Emittance

Thermal emittance is the certified aged thermal emittance (or emissivity) of the roofing material, or a default value. Unless a default value is modeled, the installed value must be equal to or greater than the value modeled. The default value is 0.85 if the certified aged thermal emittance value is not available from the [Cool Roof Rating Council \(CRRC.org\)](http://CoolRoofRatingCouncil.org). Roof construction with a roof membrane mass of at least 25 lbs/ft² or roof area incorporated integrated solar collectors is assumed to meet the default thermal emittance.

PROPOSED DESIGN

The conditioning is either ventilated or unventilated. Each characteristic of the roof is modeled to reflect the proposed construction. Values for solar reflectance and thermal emittance shall be default or from the CRRC.

Roofs with solar collectors or with thermal mass over the roof membrane with a weight of at least 25 lbs/ft² may model the prescriptive values for solar reflectance and thermal emittance.

STANDARD DESIGN

The standard design depends on the variables of the climate zone and roof slope. Low-sloped roofs (with a roof rise of less than 2 feet in 12) in ~~Climate~~ climate zones 13 and 15 will have a standard design of solar reflectance index (SRI) 75 modeled using an aged solar reflectance of 0.63 and a thermal emittance of 0.85.

Steep-sloped roofs in Climate Zones 10–15 will have a standard design roof of SRI 16 modeled using an aged solar reflectance of 0.20 and a minimum thermal emittance of 0.85.

Roofs with solar collectors or with thermal mass over the roof membrane with a weight of at least 25 lbs/ft² are assumed to meet the standard design values for solar reflectance and thermal emittance.

VERIFICATION AND REPORTING

A reflectance of 0.20 or higher is reported as a cool roof. A value higher than the default but less than 0.20 is reported as a nonstandard roof reflectance value.

2.6.2 Ceiling Below Attic

PROPOSED DESIGN

For each conditioned zone, the user enters the area and construction of each ceiling surface that is below an attic space. The compliance software shall allow a user to enter multiple ceiling constructions. Surfaces that tilt 60 degrees or more are treated as knee walls and are not included as ceilings. The sum of areas shall equal the overall ceiling area with conditioned space on the inside and unconditioned attic space on the other side.

The compliance software creates an attic zone with a floor area equal to the sum of the areas of all the user input ceilings below an attic in the building. The user specifies the framing and spacing, the materials of the frame path, and the R-value of the insulation path for each ceiling construction.

The user inputs the proposed insulation R-value rounded to the nearest whole R-value. For simulation, all ceiling below attic insulation is assumed to have nominal properties of R-2.6 per inch, a density of 0.5 lb/ft³, and a specific heat of 0.2 Btu/lb.

STANDARD DESIGN

The standard design shall have the same area of ceiling below attic as the proposed design. The ceiling/framing construction is based on the prescriptive requirement, and standard framing is assumed to be 2x4 wood trusses at 24 inches on center.

VERIFICATION AND REPORTING

The area, insulation R-value, and layer of each construction are reported on the CF1R.

2.6.3 Attic Roof Surface and Pitch

PROPOSED DESIGN

The roof pitch is the ratio of rise to run, (for example, 4:12 or 5:12). If the proposed design has more than one roof pitch, the pitch of the largest area is used.

The compliance software creates an attic zone roof. The roof area is calculated as the ceiling below attic area divided by the cosine of the roof slope where the roof slope is an angle in degrees from the horizontal. The roof area is then divided into four equal sections with each

section sloping in one of the cardinal directions (north, east, south, and west). Gable walls, dormers, or other exterior vertical surfaces that enclose the attic are ignored.

If the user specifies a roof with a pitch less than 2:12, the compliance software creates an attic with a flat roof that is 30 inches above the ceiling.

STANDARD DESIGN

The standard design shall have the same roof pitch, roof surface area, and orientations as the proposed design.

VERIFICATION AND REPORTING

The roof pitch is reported on the CF1R.

2.6.4 Attic Conditioning

Attics may be ventilated or unventilated. Insulation in a ventilated attic must be installed at the ceiling level. Unventilated attics usually have insulation at the roof deck and sometimes on the ceiling (Section 150.0[a]).

In an unventilated attic, the roof system becomes part of the insulated building enclosure. Local building jurisdictions may impose additional requirements.

PROPOSED DESIGN

A conventional attic is modeled as ventilated. When an attic will not be vented, attic conditioning is modeled as unventilated.

STANDARD DESIGN


Attic ventilation is set to ventilated for the standard design.

VERIFICATION AND REPORTING

The attic conditioning (ventilated or unventilated) is reported on the CF1R.


2.6.5 Attic Edge

With a standard roof truss (~~Figure 8: Section at Attic Edge with Standard Truss~~~~Figure 8: Section at Attic Edge with Standard Truss~~~~Figure 9: Section at Attic Edge with Standard Truss~~), the depth of the ceiling insulation is restricted to the space left between the roof deck and the wall top plate for the insulation path, and the space between the bottom and top chord of the truss in the framing path. If the modeled insulation completely fills this space, there is no attic air space at the edge of the roof. Heat flow through the ceiling in this attic edge area is directly to the outside both horizontally and vertically instead of to the attic space. Measures that depend on an attic air space, such as radiant barriers or ventilation, do not affect the heat flows in the attic edge area.

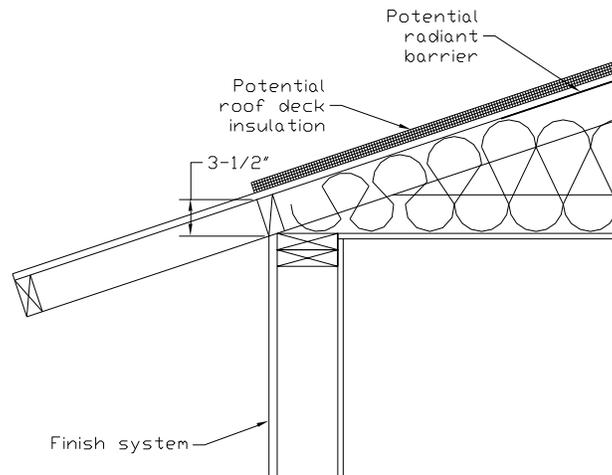Figure 98: Section at Attic Edge with Standard Truss

Source: California Energy Commission

A raised heel truss (Figure 9: Section at Attic Edge with a Raised Heel TrussFigure 9: Section at Attic Edge with a Raised Heel TrussFigure 10: Section at Attic Edge with a Raised Heel Truss) provides additional height at the attic edge that, depending on the height Y and the ceiling insulation R, can either reduce or eliminate the attic edge area and the associated thermal effect.

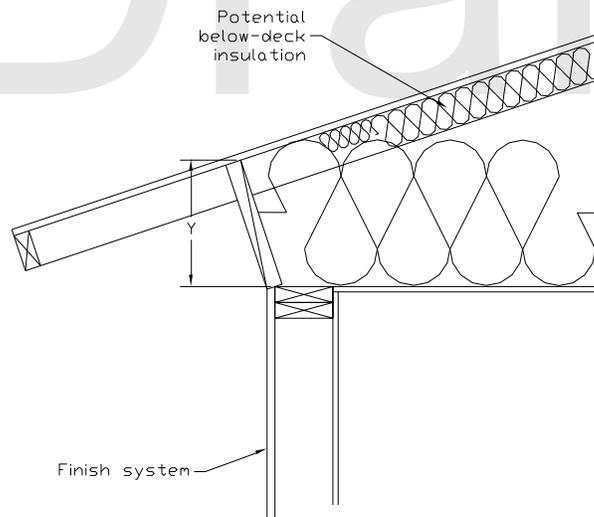Figure 109: Section at Attic Edge with a Raised Heel Truss

Source: California Energy Commission

For cases where the depth of insulation (including below-deck insulation depth) is greater than the available height at the attic edge, the compliance software automatically creates cathedral ceiling surfaces to represent the attic edge area and adjusts the dimensions of the attic air space using the algorithms contained in Appendix G. If above-deck insulation is

modeled, it is included in the attic edge cathedral ceiling constructions, but radiant barriers below the roof deck are not.

PROPOSED DESIGN

The compliance software shall allow the user to specify that a raised heel truss will be used (as supported by construction drawings), with the default being a standard truss, as shown in Figure 8: Section at Attic Edge with Standard Truss~~Figure 8: Section at Attic Edge with Standard Truss~~Figure 9: Section at Attic Edge with Standard Truss. If the user selects a raised heel truss, the compliance software will require the user to specify the vertical distance between the wall top plate and the bottom of the roof deck (Y in Figure 9: Section at Attic Edge with a Raised Heel Truss~~Figure 9: Section at Attic Edge with a Raised Heel Truss~~Figure 10: Section at Attic Edge with a Raised Heel Truss).

STANDARD DESIGN

The standard design shall have a standard truss with the default vertical distance of 3.5 inches between wall top plate and roof deck.


VERIFICATION AND REPORTING

A raised heel truss is a special feature, and the vertical height above the top plate will be included on the CF1R.

2.6.6 The Roof Deck

The roof deck is the construction at the top of the attic and includes the solar optic properties of the exterior surface, the roofing type, the framing, insulation, air gaps, and other features. These are illustrated in Figure 10: Components of the Attic Through Roof Deck~~Figure 10: Components of the Attic Through Roof Deck~~Figure 11: Components of the Attic Through Roof Deck, which shows a detailed section through the roof deck.

Figure 11-10: Components of the Attic Through Roof Deck

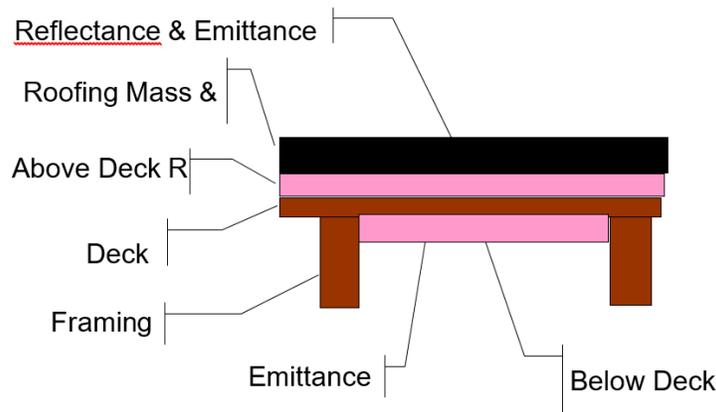

Source: California Energy Commission

Radiant Barrier

Radiant barriers are used to reduce heat flow at the bottom of the roof deck in the attic. A 0.05 emittance is modeled at the bottom surface of the roof deck if radiant barriers are used. If no radiant barrier is used, the value modeled is 0.9. If radiant barrier is installed over existing skip sheathing in a reroofing application, 0.5 is modeled.

PROPOSED DESIGN

The user shall specify whether the proposed design has:

A radiant Barrier.

No Radiant Barrier.

STANDARD DESIGN

The standard design shall have a radiant barrier if required by the prescriptive Energy Code (Section 150.1[c] and Table 150.1-A) for the applicable climate zone with Option B.

VERIFICATION AND REPORTING

Radiant barriers are reported as a special feature on the CF1R.

Below-Deck Insulation

Below-deck insulation is insulation that will be installed below the roof deck between the roof trusses or rafters.

PROPOSED DESIGN

The compliance software shall allow the user to specify the R-value of insulation that will be installed below the roof deck between the roof trusses or rafters. The default is an uninsulated roof deck.

The compliance software will verify that the wall assembly entered by the user meets the mandatory U-factor or insulation requirements. If it does not, the user will receive an error message and the simulation will not proceed.

STANDARD DESIGN

The standard design has below-deck insulation as specified in 2.5.6 Ceilings Below Attics Section 2.5.6.1 Ceilings Below Attics.

VERIFICATION AND REPORTING

The R-value of any below-deck insulation is reported as a special feature on the CF1R.

Roof Deck and Framing

The roof deck is the structural surface that supports the roofing. The compliance software assumes a standard wood deck, and this is not a compliance variable. The size, spacing, and material of the roof deck framing are compliance variables.

PROPOSED DESIGN

The roof deck is wood siding/sheathing/decking. The compliance software shall default the roof deck framing to 2x4 trusses at 24 in. on center. The compliance software shall allow the user to specify alternative framing size, material, and framing spacing.

STANDARD DESIGN

The standard design is 2x4 trusses at 24 in. on center.

VERIFICATION AND REPORTING

Nonstandard roof deck framing or spacing is reported as a special feature on the CF1R.

Above-Deck Insulation

Above-deck insulation represents the insulation value of the air gap in “concrete or clay tile” or “metal tile or wood shakes.” The R-value of any user-modeled insulation layers between the roof-deck and the roofing is added to the air gap value.

PROPOSED DESIGN

This input defaults to R-0.85 for “concrete or clay tile” or for “metal tile or wood shakes” to represent the benefit of the air gap but no additional insulation. The compliance software shall allow the user to specify the R-value of additional above-deck insulation in any roof-deck construction assembly.

STANDARD DESIGN

The standard design accounts for the air gap based on roofing type but has no additional above-deck insulation.

VERIFICATION AND REPORTING

Above-deck insulation R-value is reported as a special feature on the CF1R.

Roofing Type and Mass

PROPOSED DESIGN

The choice of roofing type determines the air gap characteristics between the roofing material and the deck and establishes whether other inputs are needed, as described below. The choices for roof type are shown below.

Concrete or clay tile. Both types have significant thermal mass and an air gap between the deck and the tiles.

Metal tile or wood shakes. These are lightweight with an air gap between the tiles or shakes and the deck. Tapered cedar shingles do not qualify and are treated as a conventional roof surface.

Other steep-sloped roofing types. These include asphalt and composite shingles and tapered cedar shingles. These products have no air gap between the shingles and the structural roof deck.

Low-sloped membranes. These are basically flat roofs with a slope of less than 2:12.

Above-deck mass. The above-deck mass depends on the roofing type. The mass is 10 lbs/ft² for concrete and clay tile and 5 lbs/ft² for metal tile, wood shakes, or other steep-slope roofing types. For low-slope roofs, the additional thermal mass is assumed to be gravel or stone, and the user chooses one of the following inputs that is equal to or less than the weight of the material being installed above the roof deck:

No mass (asphalt)

5 lbs/ft²

10 lbs/ft²

15 lbs/ft²

25 lbs/ft²

STANDARD DESIGN

The roof slope shall match the proposed design. The roof type for a steep slope roof is 10 lbs/ft² tile. The roof type for low-slope roof is lightweight roof.

VERIFICATION AND REPORTING

The roof type is reported on the CF1R.

Solar Reflectance and Thermal Emittance

PROPOSED DESIGN

The compliance software shall allow the user to default the solar reflectance and thermal emittance of the roofing. The solar reflectance product default is 0.10 for all roof types. The thermal emittance default is 0.85.

The compliance software shall allow the user to input aged solar reflectance and thermal emittance of roofing material that are rated by the CRRC. The installed value must be equal to or higher than the value specified in the software. Roof construction with a roof membrane mass of at least 25 lbs/ft² or roof area incorporated integrated solar collectors are assumed to meet the minimal solar reflectance.

STANDARD DESIGN

The solar reflectance and thermal emittance of the standard design roofing are as specified in the prescriptive standards.

VERIFICATION AND REPORTING

Thermal emittance and solar reflectance shall be reported on the CF1R. A reflectance of 0.20 or higher is reported as a cool roof. A value higher than the default but less than 0.20 is reported as a nonstandard roof reflectance value.

2.7 Crawl Spaces

PROPOSED DESIGN

The software user will model the crawl space as a separate unconditioned zone, selecting appropriate vented crawl space (with raised floor insulation), the perimeter of the crawl space (in linear feet) and the height of the crawl space.

STANDARD DESIGN

The standard design has a typical vented crawl space when a crawl space is modeled in the proposed design. Otherwise, the raised floor is assumed to be over exterior or unconditioned space.

VERIFICATION AND REPORTING

The crawl space zone type and characteristics shall be reported on the CF1R.

2.8 Garage/Storage

An attached, unconditioned space is modeled as a separate unconditioned zone. While the features of this space have no effect on compliance directly, it is modeled to accurately represent the building. The modeling of the garage/storage area will shade the walls adjacent to conditioned space and will have a lower air temperature (than the outside) adjacent to those walls. The walls and door that separate the conditioned zone from the garage/storage area are modeled as part of the conditioned zone.

PROPOSED DESIGN

The software user will model the area and type for the floor, exterior walls (ignore windows), large metal roll-up or wood doors (assume a 1.0 U-factor), and roof/ceiling (typically an attic or the same as the conditioned zone).

STANDARD DESIGN

The standard design building has the same features as the proposed design.

VERIFICATION AND REPORTING

The presence of an attached garage or unconditioned space is reported as general information on the CF1R. The general characteristics of the unconditioned zone are reported on the CF1R.

2.9 Domestic Hot Water (DHW)

Water heating energy use is based on the number of bedrooms, fuel type, distribution system, water heater type, and conditioned floor area. Detailed calculation information is included in Appendix B.

PROPOSED DESIGN

The water heating system is defined by the heater type (gas, electric resistance, or heat pump), tank type, dwelling-unit distribution type, efficiency (either uniform energy factor (UEF) or recovery efficiency with the standby loss), tank volume, exterior insulation R-value (only for indirect), rated input, and tank location (for electric resistance and heat pump water heater only).

Heat pump water heaters are defined by energy factor, volume, and tank location or, for Northwest Energy Efficiency Alliance (NEEA) rated heat pumps, by selecting the specific heater brand, model, and tank location.

Water heater and tank types include:

- Consumer storage: $\leq 75,000$ Btu/h gas/propane, ≤ 12 kW electric, or ≤ 24 amps heat pump, rated with UEF.
- Consumer instantaneous: $\leq 200,000$ Btu/h gas or propane or ≤ 12 kW electric. An instantaneous water heater is a water heater with an input rating of $\geq 4,000$ Btu/h/gallon of stored water, rated with a UEF.
- Residential-duty commercial storage: $> 75,000$ Btu/h, $\leq 105,000$ Btu/h gas/propane, ≤ 12 kW electric, ≤ 24 amps heat pump, and rated storage volume < 120 gallons, rated with a UEF.
- Residential-duty commercial instantaneous: $\leq 200,000$ Btu/h gas/propane, ≤ 58.6 kW electric, rated storage volume ≤ 2 gallons, rated with a UEF.
- Commercial storage: $> 75,000$ Btu/h gas/propane, $> 105,000$ Btu/h oil, or > 12 kW electric, rated with thermal efficiency and standby loss.
- Commercial instantaneous: $> 200,000$ Btu/h gas/propane, > 12 kW electric. Instantaneous water heater is a water heater with an input rating of $\geq 4,000$ Btu/h per gallon of stored water, rated with thermal efficiency.
- Heat pump water heater: ≤ 24 amps NEEA rating or rated with UEF.
- Mini-tank (modeled only in conjunction with an instantaneous gas water heater): a small electric storage buffering tank that may be installed downstream of an instantaneous gas water heater to mitigate delivered water temperatures (for example, cold water sandwich effect). If the standby loss of this aftermarket tank is not listed in the [CEC appliance database](#), a standby loss of 35 W must be assumed.
- Indirect: a tank with no heating element or combustion device used in combination with a boiler or other device serving as the heating element.
- Boiler: a water boiler that supplies hot water, rated with thermal efficiency or AFUE.

Heater element type includes:

- Electric resistance.
- Gas.

- Heat pump.

Dwelling unit distribution system types include:

- Standard (all distribution pipes insulated).
- Point of use.
- Central parallel piping.
- Recirculation with non-demand control (continuous pumping).
- Recirculation with demand control, push button.
- Recirculation with demand control, occupancy/motion sensor.
- HERSECC-required pipe insulation, all lines.
- HERSECC-required central parallel piping.
- HERSECC-required recirculation, demand control, push button.
- HERSECC-required recirculation with demand control, occupancy/motion sensor.

Some distribution systems have an option to increase the amount of credit received if the option for HERSECC verification is selected. See Appendix B for the amount of credit and Reference Appendices, Residential Appendix Table RA2-1 for a summary of inspection requirements.

2.9.1Distribution Compactness

Distribution compactness identifies the proximity between the water heater and use points. The distribution compactness of the water heating system must be specified. The choices include:

None.

Compact distribution basic credit.

Compact distribution expanded credit-(~~HERS~~).

Once basic credit or expanded credit is specified, either the plan view fixture distances (to master bathroom, kitchen, and furthest fixture) will need to be input for the DHW system or, if the distances are unknown, allow a user input compactness factor to be used.

If the fixture distances are specified, the software will determine if the distances qualify for the credit.

If the fixture distances are not specified, compliance with the user input compactness factor will be verified on the CF2R where the actual fixture distances for the design will need to be specified.

2.9.2 Drain Water Heat Recovery

Drain water heat recovery (DWHR) is a system where the waste heat from shower drains is used to preheat the cold inlet water. The preheat water can be routed to the served shower, water heater, or both.

The user specifies the DWHR device for the water heating system. The rated efficiency of the DWHR device, the number of shower(s) served, and the configuration must be specified. The configuration choices include:

Equal flow to shower and water heater: The potable-side heat exchanger output feeds both the fixture and the water heater inlet. Potable and drain flow rates are equal, assuming no other simultaneous hot water draws.

Unequal flow to shower: The potable-side heat exchanger output feeds the inlet(s) of the water heater(s) that are part of the parent DHW system. (The inlet temperature is adjusted to reflect recovered heat.)

Unequal flow to water heater: The potable-side heat exchanger output feeds only the associated fixture.

Multiple DWHR devices can be used for a water heater system.

Drain water heat recovery is a HERSECC-verified measure.

2.9.3 Domestic Water Heating Systems

~~The standard design for all climate zones is-uses a single heat pump water heater (HPWH) with a 2.0 UEF. If the proposed building has an attached garage, then the standard design HPWH location in the standard design is the garage. If the proposed building does not have an attached garage, then the standard design HPWH location in the standard design is in the conditioned space with the air inlet and outlet ducted to the outside. If the proposed design is a gas water heater the standard design is an instantaneous gas tankless water heater with an input of 200,000 Btu/h, a high draw pattern, and a 0.81 UEF.~~

~~If the proposed design in~~In climate zones 1 or 16 ~~uses a minimally compliant HPWH, the standard design will additionally include the a compact distribution basic credit system. If the proposed design in~~In climate zone 16 ~~uses a minimally compliant HPWH, the standard design will additionally include both a compact distribution system and a drain water heat recovery system.~~

~~-with compact distribution basic credit in Climate Zones 1 and 16, and a drain water heat recovery system in Climate Zone 16. In Climate Zone 16, the standard design DWHR has an exchanger efficiency of 0.65, serving 100 percent of showers, with an equal shower configuration.~~

~~If the proposed building has an attached garage, then the standard design HPWH location is the garage. If the proposed building does not have an attached garage, then the~~

~~standard design HPWH location is in the conditioned space with the air inlet and outlet ducted to the outside.~~

~~In Climate Zones 3, 4, 13, and 14, if the proposed design is gas, then the standard design is a single gas or propane consumer instantaneous water heater for each dwelling unit. The single consumer instantaneous water heater is modeled with an input of 200,000 Btu/h, a tank volume of zero gallons, a high draw pattern, and a UEF meeting the minimum federal standards. The current minimum federal standard for a high draw pattern instantaneous water heater is 0.81 UEF. For buildings that are 500 square feet or less, if the proposed design is an instantaneous electric water heater, or an electric consumer storage water heater that is less than or equal to 20 gallons with point of use distribution, the standard design is the same.~~

2.9.22.9.4 Solar Thermal Water Heating Credit

~~When a water heating system hasis provided by a solar thermal system to provide part of the water heating, the user enters information about the Solar Rating and Certification Corporation (SRCC) OG-100 approved collector (manufacturer, brand, model number), including details of the installation (azimuth, tilt).~~

~~Alternatively, the user can enter the OG-300 rated solar fraction for their specific climate zone.~~

2.10 Additions/Alterations

Addition and alteration compliance is based on Energy Code, Section 150.2. The energy budget for additions and alterations is based on ~~FDV~~ LSC energy. Alterations must model the entire dwelling unit. Additions may be modeled as addition alone, as “existing+addition+alteration,” or the entire building may be modeled to meet all of the requirements for a as an entirely newly constructed building (whole building, Section 150.2(c)).

Additions that are 1,000 ft² or less are ~~exempt from~~ are not required to meet the dwelling unit ventilation requirements of Section 150.0(o)1C, Section 150.0(o)1E, or Section 150.0(o)1F. When an addition to any building creates a new dwelling unit, this exception does not apply.

The standard design does not include:

- Cool roof when an addition is 300 ft² or less.
- Ventilation cooling for additions that are 1,000 ft² or less.
- Solar generation/PV requirements.

2.10.1 Accessory Dwelling Units

When an accessory dwelling unit (ADU) is detached and newly constructed, it must comply using the whole building approach as described in 2.10.2 Whole Building~~Section 2.10.2 Whole Building~~. When an ADU is created by conditioning an existing unconditioned space and is either attached or detached, it may comply using any of the compliance approaches allowed for additions as described in 2.10.3 Alteration-Along Approach or 2.10.4 Addition-Along Approach~~Section 2.10.3 Alteration-Along Approach or Section 2.10.4 Addition-Along Approach~~.

2.10.2 Whole Building

The entire proposed building, including all additions or alterations or both, is modeled the same as a newly constructed building. The building complies if the proposed design uses equal to or less energy than the standard design.

2.10.3 Alteration-Along Approach

The proposed alteration alone floor area is modeled. The alteration requirements of Section 150.2(b) are applied to any features that do not exist.

2.10.4 Addition-Along Approach

The proposed addition alone is modeled the same as a newly constructed building except that the internal gains are prorated based on the size of the dwelling. None of the exceptions included for prescriptive additions, which are implemented in the existing plus addition plus alteration compliance approach (2.10.5 Existing + Addition + Alteration Approach~~Section 2.10.5 Existing + Addition + Alteration Approach~~), are given to the addition-alone approach. (See Energy Code, Section 150.2[a]2.B.) The addition complies if the proposed design uses equal to or less space heating, space cooling, and water heating ~~TDV~~LSC energy than the standard design.

The addition-alone approach shall not be used when alterations to the existing building are proposed. Modifications to any surfaces between the existing building and the addition are part of the addition and are not considered alterations.

PROPOSED DESIGN

The user shall indicate that an addition alone is being modeled and enter the conditioned floor area of the addition. Any surfaces that are between the existing building and the addition are not modeled or are treated as adiabatic surfaces. All other features of the addition shall be modeled the same as a newly constructed building.

When an existing HVAC system is extended to serve the addition, the standard design shall assume the same efficiency for the HVAC equipment as the proposed design. (See 2.4.1 Heating Subsystems and 2.4.6 Cooling Subsystems~~Section 2.4.1 Heating Subsystems and Section 2.4.6 Cooling Subsystems~~.)

When a dual-glazed greenhouse or garden window is installed in an addition or alteration, the proposed design U-factor can be assumed to be 0.30.

STANDARD DESIGN

The addition alone is modeled the same as a newly constructed building, with the following exceptions:

When roofing requirements are included in Table 150.1-A, they are included in the standard design if the added conditioned floor area is greater than 300 ft².

When ventilation cooling (whole-house fan) is required by Table 150.1-A, it is included in the standard design when the added conditioned floor area is greater than 1,000 ft². The capacity shall be based on 1.5 CFM/ft² of conditioned floor area for the entire dwelling unit conditioned floor area.

When compliance with IAQ requirements of Section 150.0(o) apply to an addition with greater than 1,000 ft² added, the conditioned floor area of the entire dwelling unit shall be used to determine the required ventilation airflow. For additions with 1,000 ft² or less of added conditioned floor area, no IAQ requirements apply.

PV requirements are not included.

The standard design HVAC system is a ~~natural gas furnace (or propane if natural gas is not available)~~ if the proposed design has a gas heating system. The standard design HVAC system is a split heat pump if the proposed design has an electric heating system. See 2.4.1 Heating Subsystems ~~Section 2.4.1 Heating Subsystems~~ for equipment efficiencies and operating details for each type of system. The cooling system for the standard design building is a nonzonal control system, split-system ducted cooling system, meeting the minimum requirements of the *Appliance Efficiency Regulations*. See 2.4.6 Cooling Subsystems ~~Section 2.4.6 Cooling Subsystems~~ for equipment efficiencies and operating details for each type of system.

The domestic water heating system is a ~~natural gas tankless (or propane if natural gas is not available)~~ if the proposed design has a gas water heating system. The standard design water heating system is a heat pump water heater if the proposed design has an electric water heating system. For additions 500 square feet or less, the standard design is an instantaneous electric water heater if the proposed design is an instantaneous electric water heater, or the standard design is an electric consumer storage water heater less than or equal to 20 gallons if the proposed design is an electric consumer storage water heater less than or equal to 20 gallons.

2.10.5 Existing + Addition + Alteration Approach

Energy Code Section 150.2(a)2 contains the provisions for additions and Section 150.2(b)2 for alterations when the existing building is included in the calculations. These provisions are the "Existing + Addition + Alteration" (or "E+A+A") performance approach.

PROPOSED DESIGN

The proposed design is modeled by identifying each energy feature as part of the existing building (as existing, altered, or new), or as part of the addition. The compliance software

uses this information to create an E+A+A standard design using the rules in the standards that take into account whether altered components meet or exceed the threshold at which they receive a compliance credit and whether any related measures are triggered by altering a given component.

For building surfaces and systems designated below, all compliance software must provide an input field with labels for the proposed design, which define how the standard design requirements are established based on the option selected by the software user:

Existing: The surface or system remains unchanged within the proposed design. (Both standard design and proposed design have the same features and characteristics.)

Altered: the surface or system is altered in the proposed design. No verification of existing conditions is assumed with this designation.

Verified Altered: the surface or system is altered in the proposed design, and the original condition is verified by a HERSECC Rater (an optional selection).

New: a new surface or system is added in the proposed design (may be in the existing building or the addition).

Deleted features are not included in the proposed design.

Section 150.2, Table 150.2-GD specifies the details of the standard design for altered components based on whether verification of existing conditions is selected:

Altered with no third-party verification of existing conditions (the default selection). This compliance path does not require an on-site inspection of existing conditions prior to the start of construction. The attributes of the existing condition are undefined, with the standard design for altered components based on Section 150.2, Table 150.2-GD, and the climate zone. Energy compliance credit or penalty is a function of the difference between the value for that specific feature allowed in Table 150.2-GD and the modeled/installed efficiency of the feature.

Verified Altered existing conditions. This compliance path requires that a HERSECC Rater perform an on-site inspection of pre-alteration conditions prior to construction. If an altered component or system meets or exceeds the prescriptive alteration requirements, the compliance software uses the user-defined and verified existing condition as the standard design value. Energy compliance credit is then based on the difference between the verified existing condition for that altered feature and the modeled/installed efficiency of the proposed design.

QII

STANDARD DESIGN

The standard design includes QII for additions greater than 700 ft² in any single-family residential building in Climate Zones 1–16 (Section 150.2[a]1Bv).

The provisions of Section 150.2(a)1Aiv, as applied to converting an existing unconditioned space to conditioned space, are accommodations made by the HERSECC Rater in the field. No adjustments to the energy budget are made.

PV

STANDARD DESIGN

The standard design does not include PV for additions and alterations.

Roof/Ceilings

STANDARD DESIGN

The standard design roof/ceiling construction assembly is based on the proposed design assembly type as shown in Table 26: Standard Design for Roofs/Ceilings ~~Table 26: Standard Design for Roofs/Ceilings~~ Table 27: Standard Design for Roofs/Ceilings. For additions equal to or less than 700 ft², radiant barrier requirements follow Option C (Section 150.1[c]9B). The standard design for unaltered ceilings and roofs is the existing condition.

Table 26/27: Standard Design for Roofs/Ceilings

Proposed Design Roof/Ceiling Types	Addition ≤ 300 ft²	Addition > 300 ft² and ≤ 700 ft	Addition > 700 ft²	Altered	Verified Altered
Roof Deck Insulation (below-deck, where required) at vented attic	NR	NR	CZ 4, 8-16 = R-19	CZ 3, 5-7 = NR CZ 1, 2, 4, 8-16 = R-14/U-0.039 NR	Existing
Ceilings Below Attic	CZ 1, 2, 4, 8-16 = R-38 CZ 3, 5-7 = R-30	CZ 1, 2, 4, 8-16 = R-38 CZ 3, 5-7 = R-30	CZ 1, 2, 4, 8-16 = R-38 CZ 3, 5-7 = R-30	CZ 5, 7 = R-19 CZ 1-4, 6, 8-16 = R-49	Existing
Non-Attic (Cathedral) Ceilings and Roofs	R-22/U-0.043	R-22/U-0.043	Same as above R-38	R-19/U-0.054	Existing
Radiant Barrier	CZ 2-15 REQ	CZ 2-15 REQ CZ 1, 16 NR	CZ 2, 3, 5-7 REQ CZ 1, 4, 8-16 NR	NR	Existing

Proposed Design Roof/Ceiling Types	Addition ≤ 300 ft ²	Addition > 300 ft ² and ≤ 700 ft ²	Addition > 700 ft ²	Altered	Verified Altered
	CZ 1, 16 NR				
Roofing Surface (Cool Roof) Steep-Sloped	NR	CZ 10-15 =0.20 Reflectance, =0.75 Emittance	CZ 10-15 =0.20 Reflectance, =0.75 Emittance	CZ 4, 8-15 =0.20 Reflectance =0.75 Emittance	Existing
Roofing Surface (Cool Roof) Low-Sloped	NR	CZ 13, 15 = 0.63 Reflectance, =0.75 Emittance	CZ 13, 15 = 0.63 Reflectance, =0.75 Emittance	CZ 4, 6-15 =0.63 Reflectance =0.75 Emittance	Existing
Above Deck Insulation, Low-Sloped	NR	NR	NR	CZ 1, 2, 4, 8-16 R-14 continuous	Existing

Source: California Energy Commission

Exterior Walls and Doors

PROPOSED DESIGN

Existing structures with insulated wood-framed walls that are being converted to conditioned space using an E+A+A approach are allowed to show compliance using the existing wall framing, without having to upgrade to current prescriptive continuous insulation requirements. The walls are modeled as an assembly with the existing framing and either R-15 (in 2x4 framing) or R-21 (in 2x6 framing) insulation (Exception to Section 150.0[c]1 and Section 150.2[a]1).

STANDARD DESIGN

The areas, orientation, and tilt of existing, ~~new,~~ and altered net exterior wall areas (with windows and doors subtracted) in an existing zone are the same in the ~~existing and addition portions of~~ standard design as in the proposed design.

For new framed and unframed walls of an addition or an existing zone, ~~If the proposed wall area is framed,~~ the gross exterior wall area (excluding knee walls) is equally divided among the four building orientations: front, left, back and right. ~~The gross exterior wall area of any unframed walls is also equally divided among the four orientations in the standard design.~~

The standard design exterior wall construction assembly is based on the proposed design assembly type as shown in ~~Table 27: Standard Design for Walls and Doors~~Table 27: Standard Design for Walls and Doors~~Table 28: Standard Design for Walls and Doors~~. Framed walls are modeled as 16-in. on center wood framing. The standard design for unaltered walls is the existing condition.

The standard design for exterior opaque or swinging doors is 0.20 U-factor. Fire-rated doors (from the house to garage) use the proposed design door U-factor as the standard design U-factor.

Table ~~27~~28: Standard Design for Walls and Doors

Proposed Design Exterior Wall Assembly Type or Door	Addition	Altered	Verified Altered
Framed & Non-Mass Exterior Walls	CZ 1-5, 8-16 = R-21+R-5 in 2x6 (U0.048) CZ 6-7 = R-15+R-4 in 2x4 (U-0.065)	R-15 ₃ in 2x4 R-21 ₀ in 2x6	Existing
Wood framed existing walls where siding is not removed, or an extension of an existing wall	R-15 in 2x4 R-21 in 2x6	R-15 ₃ in 2x4 R-21 ₀ in 2x6	Existing
Framed Wall Adjacent to Unconditioned (e.g., Demising or Garage Wall)	R-15 in 2x4 R-21 in 2x6	R-15 ₃ in 2x4 R-21 ₀ in 2x6	Existing
Above Grade Mass Interior Insulated	CZ 1-15 = R-13 (0.077) CZ 16 = R-17 (0.059)	N/R Mandatory requirements have no insulation for mass walls	Existing
Below Grade Mass Interior Insulation	CZ 1-15 = R-13 (0.077) CZ 16 = R-15 (0.067)	N/R Mandatory requirements have no	Existing

Proposed Design Exterior Wall Assembly Type or Door	Addition	Altered	Verified Altered
		insulation for mass walls	
Swinging Doors	0.20	0.20	Existing

Source: California Energy Commission

Fenestration

PROPOSED DESIGN

Fenestration areas are modeled in the addition as new. In an existing building, they may be existing, altered, or new. Altered (replacement) fenestration is defined in Section 150.2(b)1.B as “existing fenestration area in an existing wall or roof [which is] replaced with a new manufactured fenestration product ... Up to the total fenestration area removed in the existing wall or roof ...” Altered also includes fenestration installed in the same existing wall, even if in a different location on that wall. Added fenestration area in an existing wall or roof is fenestration that did not previously exist and is modeled as new.

STANDARD DESIGN

Standard design fenestration U-factor and SHGC are based on the scope of the project (addition vs. alteration), and for additions, the square footage is taken into consideration as well, as shown in Table 28: Standard Design for Fenestration (in Walls and Roofs)~~Table 29: Standard Design for Fenestration (in Walls and Roofs)~~. Vertical glazing includes all fenestration in exterior walls such as windows, clerestories, and glazed doors. Skylights include all glazed openings in roofs and ceilings.

New fenestration in an alteration is modeled with the same U-factor and SHGC as required for an addition.

West-facing limitations are combined with the maximum fenestration allowed and are not an additional allowance.

The standard design is set for fenestration areas and orientations as shown in Table 28: Standard Design for Fenestration (in Walls and Roofs)~~Table 27: Standard Design for Fenestration (in Walls and Roofs)~~Table 29: Standard Design for Fenestration (in Walls and Roofs):

Proposed design \leq allowed percentage of total fenestration area:

In the existing building, the standard design uses the same area and orientation of each existing or altered fenestration area (in the respective existing or altered wall or roof.)

In the addition, new fenestration is divided equally among the four project compass points similar to new gross wall areas in the addition described above.

Proposed design > allowed percentage of total fenestration area:

The standard design first calculates the allowed total fenestration area as the total existing and altered fenestration area in existing or altered walls and roofs. Added to this is the percentage of fenestration allowed in the addition based on the conditioned floor area of the addition.

Table 282829: Standard Design for Fenestration (in Walls and Roofs)

Proposed Design Fenestration Type	Addition ≤ 400 ft²	Addition > 400 and ≤ 700 ft²	Addition > 700 ft²	Altered	Verified Altered
Vertical Glazing: Area and Orientation	75 ft ² or 30%	120 ft ² or 25%	175 ft ² or 20%	See full description below.	Existing
West-Facing Maximum Allowed	CZ 2, 4, 6 - 15=60 ft ²	CZ 2, 4, 6 - 15=60 ft ²	CZ 2, 4, 6 - 15=70 ft ² or 5%	NR	NR
Vertical Glazing: U-Factor	<u>CZ 1-54, 11-14, 16=0.2730</u> <u>CZ 65-10, 15=-0.30</u>	<u>0.30 CZ 1-54, 11-14, 16=-0.27</u> <u>CZ 65-10, 15=-0.30</u>	<u>0.30 CZ 1-5, 11-14, 16=0.2730</u> <u>CZ 6-10, 15=-0.3027</u>	0.2740	See below <u>Existing</u>
Vertical Glazing: SHGC	<u>CZ 2, 4, 6-145=0.23</u> <u>CZ 15=0.20</u> CZ 1,3, 5 & 16=0.35	<u>CZ 2, 4, 6-145=0.23</u> <u>CZ 15=0.20</u> -CZ 1,3, 5 & 16=0.35	<u>CZ 2, 4, 6-15=0.23</u> -CZ 1,3, 5 & 16=0.35	<u>CZ 2, 4, 6-15=0.350.23</u> -CZ 1,3, 5 & 16=0.35	Existing
Skylight: Area and Orientation	No skylight area in the standard design	No skylight area in the standard design	No skylight area in the standard design	NR	Existing
Skylight: U-Factor	0.30	0.30	0.30	0.55	Existing
Skylight: SHGC	<u>CZ 2, 4, 6 - 145=0.23</u> <u>CZ 15=0.20</u>	<u>CZ 2, 4, 6 - 145=0.23</u>	<u>CZ 2, 4, 6 - 145=0.23</u>	<u>CZ 2, 4, 6 - 15=0.30</u>	Existing

Proposed Design Fenestration Type	Addition ≤ 400 ft ²	Addition > 400 and ≤ 700 ft ²	Addition > 700 ft ²	Altered	Verified Altered
	CZ 1,3 5 & 16=0.35	<u>CZ 15=0.20</u> CZ 1,3 5 & 16=0.35	<u>CZ 15=0.20</u> CZ 1,3 5 & 16=0.35	CZ 1,3 5 & 16=0.35	

Source: California Energy Commission

Overhangs, Sidesfins, and Other Exterior Shading

STANDARD DESIGN

The standard design for a proposed building with overhangs, sidesfins, and exterior shades is shown in Table 29: Standard Design for Overhangs, Sidesfins, and Other Exterior Shading~~Table 29: Standard Design for Overhangs, Sidesfins, and Other Exterior Shading~~~~Table 30: Standard Design for Overhangs, Sidesfins, and Other Exterior Shading~~. Exterior shading (limited to bug screens) is treated differently than fixed overhangs and sidesfins, as explained in [Section 2.5.6.9 Exterior Shading](#).

Table ~~29~~30: Standard Design for Overhangs, Sidesfins, and Other Exterior Shading

Proposed Design Shading Type	Addition	Altered	Verified Altered
Overhangs and Sidesfins	No overhangs or sidesfins	Proposed altered condition	Same as altered
Exterior Shading	Standard (bug screens on fenestration, none on skylights)	Proposed altered condition	Existing exterior shading
Window Film	No window film	Proposed altered condition	Existing exterior shading

Source: California Energy Commission

Window Film

PROPOSED DESIGN

A window film must have at least a 15-year warranty and is treated as a window replacement. The values modeled are either the default values from Tables 110.6-A and 110.6-B or the NFRC Window Film Energy Performance Label.

Floors

STANDARD DESIGN

Table 150.2-C requires that the standard design be based on the mandatory requirements from Section 150.0(d). The standard design for floors is shown in Table 30: Standard Designs for Floors~~Table 30: Standard Designs for Floors~~Table 31: Standard Designs for Floors.

Table ~~30~~31: Standard Designs for Floors

Proposed Design Floor Type	Addition	Altered (mandatory)	Verified Altered
Raised Floor Over Crawl Space or Over Exterior	R-19 in 2x6 16" o.c. wood framing	R-19 in 2x6 16" o.c. wood framing	If proposed $U \leq 0.037$, standard design = existing raised; if proposed $U > 0.037$, standard design = 0.037
Slab-on-Grade: Unheated	CZ1-15: R-0 CZ16: R-7 16" vertical	R-0	Existing unheated slab-on-grade
Slab-on-Grade: Heated	CZ1-15: R-5 16" vertical CZ 16: R-10 16" vertical	CZ1-15: R-5 16" vertical CZ 16: R-10 16" vertical	Existing heated slab-on-grade
Raised Concrete Slab	CZ1,2,11,13,14,16: R-8 CZ3-10: R-0 CZ12,15: R-4	R-0	Existing raised concrete slab

Source: California Energy Commission

Thermal Mass

STANDARD DESIGN

The standard design for thermal mass in existing plus addition plus alteration calculations is the same as for all newly constructed buildings as explained in 2.5.4 Internal Thermal Mass~~Section 2.5.4.1 Internal Thermal Mass~~.

Air Leakage and Infiltration

STANDARD DESIGN

Standard design air leakage and infiltration are shown in Table 31: Standard Design for Air Leakage and Infiltration~~Table 31: Standard Design for Air Leakage and Infiltration~~
~~Table 32: Standard Design for Air Leakage and Infiltration.~~

Table ~~31~~~~32~~33: Standard Design for Air Leakage and Infiltration

Proposed Air Leakage and Infiltration	Addition	Altered	Verified Altered
Single-Family Residential Buildings	5 ACH50	5 ACH50	Diagnostic testing of existing ACH50 value by <u>HERSECC</u> Rater

Source: California Energy Commission

Space Conditioning System

STANDARD DESIGN

The standard design for space-conditioning systems is shown in Table 32: Standard Design for Space-Conditioning Systems~~Table 32: Standard Design for Space-Conditioning Systems~~
~~Table 33: Standard Design for Space-Conditioning Systems.~~

When cooling ventilation (whole-house fan) is required by Section150.1 and Section150.2, the capacity is 1.5 CFM/ft² of conditioned floor area for the entire dwelling unit.

When compliance with IAQ requirements of Section150.0(o) apply to an addition with greater than 1,000 ft² added, the conditioned floor area of the entire dwelling unit is used to determine the required ventilation airflow. For additions with 1,000 ft² or less of added conditioned floor area, no IAQ requirements shall apply.

Table ~~32~~~~33~~33: Standard Design for Space-Conditioning Systems

Proposed Design Space-Conditioning System Type	Addition	Altered	Verified Altered
Heating System Efficiency	See <u>2.10.4 Addition-Section Alone Approach</u> Section 2.10.4 Addition-Section Alone Approach and 2015 Federal Appliance Standards based on fuel source and equipment type	Existing-Proposed heating fuel type and equipment type/efficiency. If the existing equipment is electric resistance and none of the exceptions to Section150.2(b)1G are met, the	Same as altered.

Proposed Design Space-Conditioning System Type	Addition	Altered	Verified Altered
		Standard Design system shall be a heat pump meeting the requirements of <u>2.10.4 Addition- Alone Approach</u> Section 2.10.4 Addition- Alone Approach.	
Cooling System Efficiency	See <u>2.10.4 Addition- Alone Approach</u> Section 2.10.4 Addition- Alone Approach and 2015 Federal Appliance Standards based on fuel source and equipment type	Same as Addition	Existing cooling equipment type/efficiency
Refrigerant Charge	CZ 2, 8-15: Yes, unless the addition is 500 ft² or less CZ 1, 3-7: No	Same as Addition Yes	Existing
Whole-House Fan (WHF) applies only if addition > 1,000 ft ²	CZ 8-14; 1.5 CFM/ft ²	N/A	Existing condition. To count as Existing, the WHF must be ≥ 1.5 CFM/ft ² and be CEC-rated
Indoor Air Quality applies only if addition > 1,000 ft ² or if addition is a dwelling unit	Meet mandatory ventilation for entire dwelling	Same as Addition	Existing

Source: California Energy Commission

Duct System

PROPOSED DESIGN

Duct insulation shall be based on the new or replacement R-value input by the user. Duct leakage shall be based on the tested duct leakage rate entered by the user or a default rate of 30 percent.

STANDARD DESIGN

Table 33334: Standard Design for Duct Systems

Proposed Design Duct System Type	No Verification of Existing Conditions	Verified Existing Conditions
Altered or Extended Ducts >25 ft	CZ 1-2, 4, 8-16: Duct insulation R-8 and total leakage of 10% CZ 3, 5-7: Duct insulation R-6 and total leakage of 10%	Existing duct R-value and total leakage the lesser of 30% or the existing leakage rate
New Ducts	CZ 1-2, 4, 8-16: Duct insulation R-8 and total leakage of 7% CZ 3, 5-7: Duct insulation R-6 and total leakage of 7%	N/A

Based on Table 150.2-A

Note 1: Refer to Section 150.2(b)1Diia for definition of an "Entirely New or Complete Replacement Duct System."

Source: California Energy Commission

Water Heating System

STANDARD DESIGN

Table 343435: Standard Design for Water Heater Systems

Proposed Design Water Heating System Type	Addition (adding water heater)	Altered	Verified Altered
Single-Family Residential Buildings	Prescriptive water heating system per <u>as specified by 2.10.4 Section</u>	Proposed fuel type (<u>heat pump water heater if electric</u>), proposed tank type,	Existing water heater type(s), efficiency, distribution system.

Proposed Design Water Heating System Type	Addition (adding water heater)	Altered	Verified Altered
	<p><u>2.10.4 Addition- Alone</u> <u>Approach</u> <u>Addition- Alone Approach</u></p>	<p>mandatory requirements with no solar</p>	

Source: California Energy Commission

2.11 Documentation

The software shall be capable of displaying and printing an output of the energy use summary and a text file of the building features. These are the same features as shown on the CF1R when generated using the report manager.

See public domain software user guide or vendor software guide for detailed modeling guidelines.

Draft

~~3 Energy Design Rating Details~~

~~The EDR is an alternate way to express the energy performance of a home using a scoring system where 100 represents the energy performance of a reference design building meeting the envelope requirements of the 2006 IECC. The EDR is similar to the energy rating index in the 2015 IECC and the 2014 RESNET standard. Combining high levels of energy efficiency with generating renewable energy, a score of zero or less can be achieved.~~

~~Buildings complying with the current Energy Code are more efficient than the 2006 IECC, so most newly constructed buildings will have EDR scores below 100. Buildings with renewable generation like PV can achieve a negative score. If EDRs were calculated for an older, inefficient home, the score would likely be well over 100.~~

~~There are two EDRs used to evaluate single-family residential buildings. EDR1 is based on source energy, and the proposed design EDR1 must be equal to or less than the standard design EDR1. EDR2 is based on TDV energy and has two components that must be met for compliance. The EDR2 score of proposed efficiency must be equal to or less than the EDR2 score of the standard efficiency, and the total proposed EDR2 score must be equal to or less than the total standard design EDR2.~~

~~3.12.12~~ **CALGreen**

~~The software can calculate an EDR1 and EDR2 LSC and Source Energy results as required in the CALGreen energy provisions California Green Building Standards (CALGreen, Title 24, Part 11). The EDR1 and EDR2 LSC and Source implementation applies only to newly constructed single-family residential buildings.~~