




Carlsbad Energy Center LLC  
1817 Aston Avenue, Suite 104  
Carlsbad, CA 92008

Direct Phone: 760.710.2144

December 18, 2007

Dr. Steve Moore  
San Diego County Air Pollution Control District  
10124 Old Grove Road  
San Diego, CA 92131

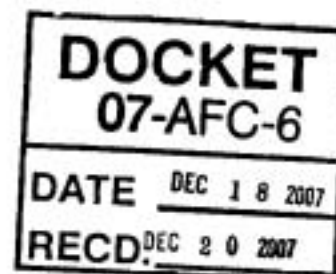

**Subject: Supplemental Information for the Carlsbad Energy Center Project (Application Numbers 905745 - 905748)**

Dear Dr. Moore:

We are pleased to provide the following additional information requested in the San Diego County Air Pollution Control District's (SDAPCD) October 17, 2007 letter regarding the proposed Carlsbad Energy Center Project.

**FACT**

*Request 1: Please provide an estimate of potential particulate emissions resulting from the use of reclaimed water in the evaporative cooler at the combustion turbine inlet.*

**Response:** As discussed in our October 10, 2007 letter to the SDAPCD, virtually all of the solids in the evaporative cooling water will be retained in the cooler blowdown and will not enter the turbine gas path. In addition, the gas turbine PM<sub>10</sub> emission rate of 9.5 lbs/hr used for the proposed project was provided by the gas turbine vendor Siemens. The Siemens PM<sub>10</sub> emission rate accounts for all project design features including the use of evaporative cooling. The Siemens PM<sub>10</sub> emission rate reflects the use of evaporative cooling with a maximum water circulation rate of 110 gallons per minute (total for both gas turbines) and a maximum cooling water total dissolved solids (TDS) level of 500 ppmw. Please note that while the reclaimed water composition summary table in the AFC (Table 5.15F-1) shows TDS levels as high as approximately 922 ppmw, the cooling water for the evaporative cooling system will be processed by the reverse osmosis system to reduce the TDS level to design levels. Therefore, we do not believe that the proposed PM emission rates for the gas turbine need to be modified to account for the evaporative cooler.

*Request 2: Provide the basis of the reclaimed water composition listed in Table 5.15F-1 in Appendix 5.15E.*

**Response:** The basis for the reclaimed water composition shown in Table 5.15F-1 of the

September 12, 2007 permit application package for the proposed project originated from an Encina Wastewater Authority technical report. A copy of this report is enclosed as Attachment 1.

## **OPERATIONS ON LNG-DERIVED GAS**

*Request 3: The latest fuel specification for the turbine model specified in the application.*

**Response:** The fuel specifications used by Siemens to perform the gas turbine performance runs for the proposed project were included in the September 12, 2007 permit application package submitted to the SDAPCD (see Table 5.1-18). There have been no changes to the fuel specification used for turbine performance runs since that submittal. In regards to the fuel specifications for LNG-derived gas for the proposed project, enclosed as Attachment 2 is a copy of a letter from San Diego Gas & Electric Company (SDG&E) regarding the expected specifications of LNG-derived gas entering their system. While the SDG&E letter also makes a general statement about the effect on NO<sub>x</sub> and CO emissions associated with the use of LNG-derived gas, SDG&E defers to the equipment vendor to provide the actual expected effect on emissions from the use of LNG-derived gas.

*Request 4: A guarantee that the combustion turbine in combination with the add-on emission control system will be able to meet the proposed exhaust stack emission limits in the application when operated over the expected Wobbe No. range of 1335-1385 and a description of any measures and ancillary equipment needed to achieve this guarantee.*

**Response:** Enclosed as Attachment 3 is a copy of a letter from Siemens concluding that the gas turbine emission levels proposed for the CECF will be achieved with a natural gas Wobbe Index ranging from 1335 to 1385 Btu/scf. Please note that the Siemens acceptable range of natural gas Wobbe Index is broader than that expected by SDG&E in their system with LNG derived natural gas (see Attachment 2). In addition, the CEC staff concluded recently in the final staff assessment for the Colusa Generating Station (06-AFC-9) that the use of LNG would not significantly impact the air pollution emissions for that power plant. A copy of the relevant pages from this document along with a copy of the supporting technical report are included as Attachment 4. Since both the Colusa Generating Station and the proposed project are gas turbine combined cycle designs, a similar conclusion can be reached for the proposed project with respect to the use of LNG.

*Request 5: The maximum allowable amount of ethane, propane, and/or higher hydrocarbons in the fuel that the combustion turbine in combination with the add-on emission control system can tolerate and still meet the proposed emission limits in application.*

**Response:** As discussed above, it is expected that emissions performance will account for the range of fuel properties expected for the proposed project, which will be any fuel

that can be legally delivered to the site under the SDG&E tariff. In addition, as discussed above, the gas turbine emission levels proposed for the project are expected to be achieved for a range in the Wobbe Index of 1335 to 1385 Btu/scf. This acceptable variation in Wobbe Index is broader than that expected by SDG&E for their system with LNG derived natural gas. Since Wobbe Index is an important indicator of the hydrocarbon composition of fuel gas, the information provided by Siemens (see Attachment 3) also means that the CECP will meet the proposed gas turbine emission levels for the expected range of natural gas hydrocarbon compositions for the project.

**Request 6:** *The maximum allowable rate of change in Wobbe No. that the combustion turbine in combination with the add-on emission control system can tolerate and still meet the proposed emission limits in application.*

**Response:** As discussed above, the information provided by SDG&E and Siemens indicates that the proposed emission levels for the gas turbines will be met over the Wobbe Index range expected for the project.

**Request 7:** *The maximum allowable rate of change in ethane, propane, and/or higher hydrocarbons fuel content that the combustion turbine in combination with the add-on emission control system can tolerate and still meet the proposed emission limits in application.*

**Response:** As discussed above, the information provided by SDG&E and Siemens indicates that the proposed emission levels for the gas turbines will be met over the Wobbe Index range expected for the project. Since Wobbe Index is an important indicator of fuel gas hydrocarbon composition, this information also shows that the emission levels for the gas turbines will be met over the expected range of natural gas hydrocarbon compositions expected for the project.

## **AQIA MODEL**

**Request 8:** *If the air impact modeling was done using AERMOD version 06341, please resubmit the air impact modeling using the latest version of AERMOD or provide a demonstration that, for purposes of this project, AERMOD version 06341 and AERMOD version 07026 give the same results.*

**Response:** The modeling included in the September 12, 2007 permit application package for the proposed project was inadvertently performed using a slightly older version of AERMOD (version 06341), rather the current version of AERMOD that was available near the end of January 2007 (version 07026). The modeling for the proposed project was re-run using AERMOD version 07026 and the results are summarized in Attachment 5. As shown in Attachment 5, there are only minor changes in the modeling results due to the use of the current version of AERMOD. The minor changes in ground-level concentrations in revised Table 5.1-28 can be

either increases or decreases because the change in AERMAP produced slightly higher and lower ground elevations in different locations where modeling maxima occurred for different pollutant-averaging time combinations. These slight up and down changes in ground elevations also explain the slight up and down changes in maximum potential health impacts shown in revised Table 5.9-6. The detailed modeling files are included in the attached modeling CD.

## **AQIA ANALYSIS**

**Request 9:** *In this case, the District requires an analysis considering the impacts on days when the background concentration does not exceed the standard. Please provide such an analysis for the impact of PM<sub>10</sub> with respect to the state 24-hour standard. The District meteorology staff should be contacted for details of the analysis procedure.*

**Response:** Based on recent discussions between Sierra Research and the SDAPCD modeling/meteorology group, the PM<sub>10</sub> analysis for the proposed project must include a review of the three years' worth of background ambient PM<sub>10</sub> data collected at the Escondido monitoring station to identify days when the ambient PM<sub>10</sub> levels are just below the state 24-hr standard of 50 µg/m<sup>3</sup>. For these days, the project's maximum modeled 24-hr PM<sub>10</sub> impact should be added to these ambient levels to determine if the proposed project will cause any additional exceedances of the state 24-hr average PM<sub>10</sub> standard. Included as Attachment 6 is a summary of the Escondido monitoring station ambient PM<sub>10</sub> levels for the three-year look-back period (2004 to 2006). As shown by these data, the PM<sub>10</sub> levels just under the state 24-hr standard during this period are 42 µg/m<sup>3</sup> (2<sup>nd</sup> maximum) during 2004 and 43 µg/m<sup>3</sup> (2<sup>nd</sup> maximum) during 2006. No 2<sup>nd</sup> maximum levels are listed for 2005 because the maximum monitored PM<sub>10</sub> level during that year is not above the state 24-hr standard. If the proposed project's maximum 24-hr PM<sub>10</sub> impact of 2.2 µg/m<sup>3</sup> (see Attachment 5 for revised modeling results) is added to these background levels, the totals remain below the state 24-hr standard of 50 µg/m<sup>3</sup>. Consequently, the proposed project will not cause any additional exceedances of the state 24-hr PM<sub>10</sub> standard.

**Request 10:** *Provide a key to identify all of the source groups used in the AERMOD calculations. In addition, provide a plain language summary of the electronic files submitted with the application so that they can be easily related to the information in the report. The summary should include a description of each source group being modeled.*

**Response:** An improved "read me" file for the revised air quality impact modeling is included in the enclosed modeling CD. This file includes the identification of all source groups and a "plain language" summary of the electronic modeling files. A hardcopy of this file is included as Attachment 7.

***Request 11: Confirm that air quality impact calculations were made without considering emissions decreases from the eventual retirement of the three existing boilers.***

**Response:** All ambient air quality impacts discussed in the September 12, 2007 permit application package for the proposed project and included in Attachment 5 of this letter are for the new equipment only and do not include any benefits associated with the shutdown of the three existing boilers at the Encina Power Station.

## **HRA ANALYSIS**

***Request 12: Explain why cancer risk is calculated using more than the Office of Environmental Health Hazard Assessment (OEHHA) Derived (Adjusted) Method. It makes the review process more cumbersome and makes it more difficult for the public to evaluate the analysis and report. Moreover, it results in much lengthier AERMOD model runs and reports than are needed.***

**Response:** Table 5.9-6 in the AFC Public Health Section 5.9 reports cancer risk using only the OEHHA's Derived (Adjusted) Method as requested by SDAPCD staff. The other methods of calculating cancer risk are also included in the air dispersion modeling for the following reasons:

- They are described in OEHHA guidance documents;
- They are available in the HARP software published by the ARB;
- They provide more complete information on the potential range of cancer risk; and
- They satisfy the CEQA requirement for public disclosure of the full range of potential environmental impacts. The additional risk methods were included in response to a request from the staff of the California Air Resources Board several years ago.

***Request 13: A key to identify all of the source groups used in the AERMOD calculations. In addition, provide a plain language summary of the electronic files submitted with the application specifically for the health risk assessment so that they can be easily related to the information in the report. The summary should include a description of each source group being modeled.***

**Response:** Enclosed as Attachment 7 is a "plain language" summary of the electronic files related to the health risk assessment (HRA) performed for the proposed project. This summary includes the identification of the source groups used in the AERMOD runs.

***Request 14: Information on whether health risk calculations were made with or without considering emissions decreases from the eventual retirement of the three existing boilers.***

**Response:** The HRA performed for the proposed project does not include emission decreases

from shutting down existing Encina Power Station Boiler Units 1-3.

**Request 15:** *A separate calculation of health risk for startup and commissioning activities and an explanation as to how this risk was analyzed and incorporated into the overall health risk estimates including a description of exactly which commissioning activities were analyzed. If estimates of health risk under these conditions are expected to be negligible, this needs to be clearly demonstrated.*

**Response:** Separate calculations of health risk for startup and commissioning are not needed because the conservative toxic air contaminant (TAC) emission rate calculation starts with the highest possible hourly heat input rate under any operating condition (i.e., commissioning, startup, and normal) as indicated in the September 12, 2007 permit application package for the proposed project (see Footnote 2 to Tables 5.9B-1 and 5.9B-2 "short-term commissioning containing the uncontrolled emission factors for acrolein, benzene, and formaldehyde"). Maximum possible hourly and annual fuel flows were also used for the HRA (see Tables 5.9B-1 and 5.9B-2, Footnotes 4 and 6). Therefore, no higher TAC emission rates can be generated by separate calculations for startup and commissioning. All commissioning activities are automatically considered by the above approach because the TAC emission factors are on a fuel basis (i.e., MMscf of natural gas), and the maximum possible hourly and annual fuel flows are used. The stack exhaust conditions of temperature and velocity are selected to be the combination determined by screening runs for 1-hour and annual averaging times and three ambient temperatures (i.e., extreme hot, annual average, and extreme cold). The worst-combination exhaust conditions for the annual averaging time give the maximum potential cancer risk and non-cancer chronic health hazards, while the worst-combination exhaust conditions for the 1-hour averaging time give the maximum potential non-cancer acute health hazard.

**Request 16:** *Identification of the computer file(s) that contain the maximum health risk impacts will be found [sic]. Health risk results should not just be stated, but should be clearly referenced.*

**Response:** The HRA performed for the proposed project is based on maximum potential gas turbine fuel flow rates, maximum TAC emission rates, and maximum possible ground-level concentrations. The maximum potential health impacts are contained in the computer files described in Attachment 7.

### **STARTUP, SHUTDOWN, AND COMMISSIONING**

**Request 17:** *Provide representative measured or calculated minute-by-minute exhaust stack temperature, fuel flow rate, oxygen content, and turbine load and controlled and uncontrolled carbon monoxide (CO) emissions, volatile organic compound (VOC) emissions, and oxides of nitrogen (NOx) emissions during a representative warm startup (overnight or shorter shutdown), cold startup (weekend shutdown) and supporting information. The data should extend until the steam turbine has reached*

*full load.*

**Response:** Minute-by-minute emissions and/or stack parameters during gas turbine startups, shutdowns, or commissioning tests are not available from Siemens. The modeling of gas turbine startups, shutdowns, and commissioning tests for the proposed project was performed using stack parameters associated with the gas turbine operating at 50% load for an entire hour. The hourly emission rates used for this modeling were provided by Siemens and are summarized in Tables 5.1B-7, 5.1B-8, and 5.1B-9 of the September 12, 2007 permit application package for the proposed project. As shown in these tables, Siemens provides the total mass emissions that would occur during the first 22 minutes of a gas turbine startup. Based on the footnotes for Table 5.1B-8, within the first 12 minutes of the startup the gas turbine achieves 100% load. The CO control during the first 12 minutes is 20%, with CO control achieving 90% following this period. Full NOx control is achieved after 22 minutes. For the remainder of the hour it is assumed the gas turbine is operating with normal emissions at a gas turbine load of 100%. It would be possible to break up a gas turbine startup hour into the following three parts:

- First 12 minutes: gas turbine load ranges from full speed no load to 100% load, 20% CO control, NOx control varies an unknown amount
- Next 10 minutes: gas turbine at 100% load, full control of CO, NOx control varies an unknown amount
- Final 38 minutes: gas turbine at 100% load, full control of NOx and CO

Since the gas turbine achieves 100% load within 12 minutes, the modeling analysis performed for the proposed project is conservative since it assumes the gas turbine is operating with dispersion parameters comparable to 50% load for the entire hour during a startup. While it would be possible to break up the startup hour into three parts and model each part separately, the results are not expected to be higher than those found using the conservative 50% gas turbine load approach.

**Request 18:** *Provide representative measured or calculated minute-by-minute exhaust stack temperature, fuel flow rate, oxygen content, and turbine load and controlled and uncontrolled NOx and CO emissions, VOC emissions, and NOx emissions during a representative shutdown and supporting information.*

**Response:** Please see the response to Request 17.

**Request 19:** *Provide the basis for assuming that CO emissions are reduced by 20% during the first 12 minutes of a startup and by 90% during the final 10 minutes of a startup during normal operations (Table 5.1 B-8).*

**Response:** The CO level control of 20% during the period from ignition to 100% gas turbine load (12 minute period) and a CO control level of 90% after the gas turbine achieves 100% load were provided by Siemens. Please see startup note number 5 in Table 5.1B-8 of the September 12, 2007 permit application package for the

proposed project.

**Request 20:** *The approximate minimum load at which the combustion turbine is able to achieve the proposed best available control technology emission limits for and CO.*

**Response:** The gas turbines will be able to meet their proposed best available control technology (BACT) CO emissions limit of 2.0 ppmv @ 15% O<sub>2</sub> during normal operation for gas turbine loads ranging from 60% to 100%.

**Request 21:** *During combustion turbine commissioning operations without add-on air pollution control equipment in place, provide exhaust stack temperature and oxygen content when the turbine is operating at full speed no load, 10% load, 25% load, and 40% load.*

**Response:** Enclosed as Attachment 8 are the stack parameters for a gas turbine operating at full speed no load (FSNL), 10% load, 25% load, and 40% load (see operating cases 16 to 20 and 27 to 31). Please note that the enclosed gas turbine performance runs were provided by Siemens for units proposed for the El Segundo Generating Station, which are identical to the units proposed for CECP. Consequently, the ambient site conditions (ambient temperature and humidity) shown in the enclosed performance runs are different than those for the CECP. However, these differences in ambient conditions between the two project sites will have minimal effects on the stack parameters at low gas turbine loads (40% load and less).

**Request 22:** *Details of combustion turbine commissioning activities indicating the approximate amount time in each operating mode during the activity.*

**Response:** The detailed gas turbine commissioning schedule, including the duration of each commissioning test, is shown in Table 5.1B-9 of the September 12, 2007 permit application package for the proposed project.

## **TOXIC AIR CONTAMINANT EMISSION FACTORS**

**Request 23:** *The footnotes to Table 5.9B-1 indicate that the emission factors for acrolein, benzene, and formaldehyde are based on Table 3.1-1 in EPA's AP-42 emission factor compilation. In addition, the footnotes indicate that no control factor for the oxidation catalyst has been applied to these emission factors to account for startups when the oxidation catalyst may have less or no effectiveness. However, a comparison of Table 5.9B-1 to Table 3.1-1 in AP-42 indicates that control factors of approximately 50%, 75%, and 50% have been applied to the AP-42 acrolein, formaldehyde, and benzene emission factors, respectively to generate the emission factors in Table 5.9B-1. At a minimum (see below), please revise the hourly emission rates in Table 5.9-1 and the health risk assessment to reflect no emission control factor for acrolein, formaldehyde, and benzene or provide a justification of the control factors used.*

**Response:** The commentor's observation about the reduced emission factors is correct, except that the approximate 75% reduction was applied to benzene, not formaldehyde; and the correct AP-42 table is Table 3.1-3, not Table 3.1-1. The footnote should have been worded differently to note that the emission factors in Table 5.9B-1 of the September 12, 2007 permit application package were purposefully reduced to reflect the ability of the oxidation catalyst to control emissions of these three toxic air contaminants during normal gas turbine operation.

The footnote would have been less confusing if it had been worded as follows: "All factors are from AP-42, Table 3.1-3, 4/00 except PAHs, hexane, propylene, and the following three that are reduced according to the control effectiveness of the oxidation catalyst: acrolein (42.4%), benzene (72.8%), and formaldehyde (49.3%). Individual PAHs, hexane and propylene are CATEF mean results because AP-42 does not include factors for these compounds. The substantial reduction in the emission factors for acrolein, benzene, and formaldehyde, which were taken from USEPA (2000),<sup>1</sup> are based on measurements taken with and without a CO oxidation catalyst over the full range of turbine loads."

**Request 24:** *The District also notes that the AP-42 emission factors or emission factors measured at high loads for toxic air contaminants may not be applicable to operations at low load operations that occur during startup, shutdown, and commissioning operations. The District may request the use of alternative emission factors for some air pollutants during low load operations. The District recommends providing any available test information for toxic air contaminant emissions for the model of combustion turbine proposed in the application, or a similar model, when operating at low load (i. e., not in the lean-premix combustion mode).*

**Response:** For early commissioning activities, when an oxidation catalyst is not installed, the uncontrolled emission factors for toxic air contaminants available in AP-42 Table 3.1-3, including those for acrolein, benzene, and formaldehyde, are used in emission calculations as presented in Table 5.1B-2 of the September 12, 2007 permit application package. For this table, the original Footnote 1 is accurate.

---

<sup>1</sup> USEPA. *Emission Factor Documentation for AP-42 Section 3.1 Stationary Gas Turbines*, Table 3.4-1, April 2000, <http://www.epa.gov/ttn/chieff/ap42/ch03/index.html>.

## **ANNUAL EMISSION RATES**

**Request 25:** *A comparison of Table 5.9B-1 to Table 3.1-1 in AP-42 indicates that control factors of approximately 50%, 75% and 50% have been applied to the AP-42 acrolein, formaldehyde, and benzene emission factors to generate the annual emission rates listed in Table 5.9B-1. Please revise the annual emission rates in Table 5.9-1 and the health risk assessment to reflect no emission control factor for acrolein, formaldehyde, and benzene or provide a justification of the control factors used.*

**Response:** As discussed in the response to Request 23, the commentator's observation about the reduced emission factors is correct, except that the approximate 75% reduction applied to benzene, not formaldehyde; and the AP-42 table is Table 3.1-3, not Table 3.1-1. The annual emission rates listed in Table 5.9B-1 of the September 12, 2007 permit application package (not Table 5.9-1) do not need to be revised to account for the higher uncontrolled emission factors of acrolein, benzene, and formaldehyde because the reduced emission factors are appropriate for normal operation. The higher uncontrolled emission factors of acrolein, benzene, and formaldehyde are properly used to calculate short-term emission rates for commissioning in Table 5.9B-2 of the September 12, 2007 permit application package because the oxidation catalyst is not installed for early commissioning activities.


If you have any questions regarding this application package, please contact me at (760) 710-2144 or Tom Andrews with Sierra Research at (916) 444-6666.

Sincerely,  
Carlsbad Energy Center LLC



Tim Hemig  
Vice President

## **Attachments**

cc: John McKinsey, Steel Rives  
  
Tom Andrews, Sierra Research

**ATTACHMENT 1**

**BASIS FOR RECLAIM WATER COMPOSITION**



## ENCINA WASTEWATER AUTHORITY

A Public Agency

6200 Avenida Encinas  
Carlsbad, CA 92011-1095  
Telephone (760) 438-3941  
FAX (760) 438-3861 (Plant)  
(760) 431-7493 (Admin)

January 29, 2007

Ref: EC. 07-0051

ATTN: POTW Compliance Unit  
California Regional Water Quality Control Board  
San Diego Region  
9174 Sky Park Court, Suite 100  
San Diego, CA 92123

Attention: Mr Eric Becker, POTW Compliance Unit

SUBJECT: Submittal of Technical Reports – Order No. 2001-352

Enclosed are the December 2006 monthly, October through December 2006 quarterly and the 2006 annual reports for the Carlsbad Water Recycling Facility.

Very truly yours,

  
Michael T. Hogan  
General Manager

DJC:MTH:dc



**SELF-MONITORING REPORT REVIEW**

**TO: POTW COMPLIANCE UNIT  
CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD  
SAN DIEGO REGION  
9174 SKY PARK COURT, SUITE 100  
SAN DIEGO, CALIFORNIA 92123**

**DISCHARGER: CARLSBAD WATER RECYCLING FACILITY  
ORDER NO. 2001-352**

**REPORT FOR: DECEMBER 2006**

**REPORT DUE: FEBRUARY 1, 2007**

---

**OUR REVIEW OF THE ATTACHED SELF-MONITORING REPORT REVEALS THE FOLLOWING VIOLATION (S):**

1. The annual limit for manganese was exceeded over the last 12 month period (page 4).
2. On December 2, at 11:00 a.m. it was discovered that the turbidity meter had failed. The meter reading had been 0.0 NTU since 6:00 a.m. We immediately stopped incoming flow to the plant. The meter was replaced and subsequent readings were in compliance.

**THE FOLLOWING REMEDIAL ACTION WILL BE TAKEN TO CORRECT THE MONITORING PROBLEMS LISTED ABOVE**

1. Currently performing a study to identify manganese levels in our service area.
2. Developing programming for a low level turbidity alarm in the SCADA system.

**CARLSBAD WATER RECYCLING FACILITY**

**ORDER NUMBER 2001-352**

I certify under penalty of law that I have personally examined and am familiar with the information submitted in this document and all attachments and that, based on my inquiry of those individuals immediately responsible for obtaining the information, I believe that the information is true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment.



John Jordin  
Operations Superintendent

# MONTHLY MONITORING REPORT

## CARLSBAD WATER RECYCLING FACILITY

REPORT FOR: DECEMBER 2006

REPORT DUE: FEBRUARY 1, 2007

REPORT FREQUENCY: MONTHLY

SAMPLING POINT: METERING STATIONS

SAMPLES COLLECTED BY: VARIOUS

SAMPLES ANALYZED BY: VARIOUS

### DAILY FLOW MONITORING

DATE	INFLUENT FLOW (MGD)	RECLAIMED TO DISTRIBUTION FLOW (MGD)	EWPCF RETURN FLOW (MGD)	BRINE OUTFALL FLOW (MGD)	CHLORINE CONTACT TANK FLOW (MGD)	IN STORAGE TANK
MAXIMUM PERMITTED	N/A	N/A	N/A	N/A	4.0	
1	No reclaim					
2	1.2000	0.1000	1.315	0.000	0.850	1.500
3	1.8000	1.6100	0.490	0.000	1.500	0.860
4	0.6850	0.6600	0.5000	0.010	0.207	1.380
5	0.3100	0.3100	0.3100	0.000	0.020	1.320
6	0.9550	0.6300	0.510	0.009	0.257	0.750
7	1.3220	0.7300	0.530	0.000	0.958	0.967
8	No reclaim					
9	0.6880	0.1400	0.520	0.000	0.425	2.063
10	1.2600	1.3000	0.510	0.002	1.400	1.720
11	1.3080	0.5000	0.510	0.000	1.065	2.360
12	1.2000	0.5300	0.440	0.000	0.833	2.620
13	No reclaim					
14	0.5900	0.7600	0.510	0.000	0.000	2.230
15	0.7440	0.4200	0.510	0.000	0.0000	1.830
16	1.0890	0.8600	0.5100	0.039	0.3600	0.899
17	1.2700	1.0400	0.490	0.000	0.900	0.501
18	1.1200	0.9000	0.520	0.000	0.813	0.620
19	No reclaim					
20	No reclaim					
21	No reclaim					
22	No reclaim					
23	0.6762	0.7000	0.510	0.000	0.412	1.580
24	0.6760	0.5300	0.430	0.000	0.429	1.400
25	No reclaim					
26	No reclaim					
27	0.8040	1.2600	0.520	0.010	0.436	1.598
28	No reclaim					
29	No reclaim					
30	No reclaim					
31						

No Water Distributed\*

# MONTHLY MONITORING REPORT

## CARLSBAD WATER RECYCLING FACILITY

REPORT FOR: DECEMBER 2006

REPORT DUE: FEBRUARY 1, 2007

REPORT FREQUENCY: MONTHLY

SAMPLING POINT: EFFLUENT STATION

SAMPLES COLLECTED BY: VARIOUS

SAMPLES ANALYZED BY: ENCINA LAB

## DAILY EFFLUENT MONITORING

DATE	SAMPLE TIME & SAMPLE BY:	7-DAY MEDIAN COLIFORM (cfu/100ML)	TOTAL COLIFORM (cfu/100ML)	MINIMUM CHLORINE RESIDUAL (MG/L)	MODAL CONTACT TIME (MG-MIN/L)	CHLORINE CONTACT TIME (MINUTES)
MAXIMUM PERMITTED		22	1 @ >23	N/A	MIN=450	MIN=90
1		NWD*				
2	IW/0810	<1	<1	4.6	1021	222.0
3		NWD*				
4		NWD*				
5		NWD*				
6		NWD*				
7	RW/0805	<1	<1	10.2	2499	245.0
8	JL/0810	<1	<1	14.3	3518	246.0
9	IW/0855	<1	<1	8.7	2192	252.0
10		NWD*				
11	TL/1300	<1	<1	3.7	947	256.0
12		NWD*				
13		NWD*				
14		NWD*				
15		NWD*				
16	IW/0915	<1	<1	6.3	1670	265.0
17		NWD*				
18	TL/0800	<1	<1	12.5	3288	263.0
19		NWD*				
20		NWD*				
21		NWD*				
22	JL/0805	<1	<1	4.8	1214	253.0
23		NWD*				
24		NWD*				
25		NWD*				
26		NWD*				
27		NWD*				
28		NWD*				
29		NWD*				
30		NWD*				
31		NWD*				

No Water Distributed\*

I certify that the above information is accurate to the best of my knowledge and that the samples were preserved, prepared, and analyzed according to EPA protocol.

Laboratory Supervisor Signature:

# MONTHLY MONITORING REPORT

## CARLSBAD WATER RECYCLING FACILITY

REPORT FOR: DECEMBER 2006

REPORT DUE: FEBRUARY 1, 2007

REPORT FREQUENCY: MONTHLY

SAMPLING POINT: EFFLUENT STATION

SAMPLES COLLECTED BY: VARIOUS

SAMPLES ANALYZED BY: ENCINA STAFF

DAILY EFFLUENT MONITORING			
DATE	24-HOUR AVERAGE TURBIDITY (NTU)	DAILY MAXIMUM TURBIDITY (NTU)	95 PERCENTILE EFFLUENT TURBIDITY (%/24 HOUR)
UNITS			
MAXIMUM PERMITTED	2.0	10	>5 NTU @ 5%
1	NWD*		
2	0.9	2.6	0.0
3	NWD*		
4	NWD*		
5	NWD*		
6	NWD*		
7	0.9	1.0	0.0
8	0.6	0.7	0.0
9	1.0	1.2	0.0
10	NWD*		
11	1.2	1.4	0.0
12	NWD*		
13	NWD*		
14	NWD*		
15	NWD*		
16	0.4	0.5	0.0
17	NWD*		
18	0.7	0.9	0.0
19	NWD*		
20	NWD*		
21	NWD*		
22	0.8	1.1	0.0
23	NWD*		
24	NWD*		
25	NWD*		
26	NWD*		
27	NWD*		
28	NWD*		
29	NWD*		
30	NWD*		
31	NWD*		

No Water Distributed\*

Please see spread sheet for continuous NTU data.

**QUARTERLY MONITORING REPORT**  
**CARLSBAD WATER RECYCLING FACILITY**

REPORT FOR: OCTOBER 2006

REPORT DUE: FEBRUARY 1, 2007

REPORT FREQUENCY: QUARTERLY

SAMPLING POINT: CCT EFFLUENT

SAMPLES COLLECTED BY: OFF LINE

SAMPLES ANALYZED BY: ENCINA LAB  
& DEL MAR ANALYTICAL

**MONTHLY EFFLUENT MONITORING**

ANALYSIS	UNITS	DAILY MAX	DAILY LIMIT	30 DAY AVERAGE	30-DAY AVERAGE LIMIT
BOD	MG/L	4.0	45	4.0	30
TSS	MG/L	1.4	45	1.4	30
VSS	MG/L	1.3		1.3	
pH*	UNITS	7.19	6 thru 9	7.19	
CHLORIDE	MG/L	263	400	263	350
SULFATE	MG/L	182	400	182	
MANGANESE	MG/L	0.087	0.06	0.063	
IRON	MG/L	0.12	0.4	0.12	0.3
BORON	MG/L	0.4	0.75	0.4	0.75
TDS	MG/L	922	1,200	922	

SAMPLE DATE/TIME:

10-10/11-06

0800-0800

10/11/2006

8:02 AM


SAMPLE TYPE:

Composit

GRAB\*

I certify that the above information is accurate to the best of my knowledge and that the samples were preserved, prepared, and analyzed according to EPA protocol.

Laboratory Supervisor Signature:



# **QUARTERLY MONITORING REPORT** **CARLSBAD WATER RECYCLING FACILITY**

REPORT FOR: NOVEMBER 2006

REPORT DUE: FEBRUARY 1, 2007

REPORT FREQUENCY: QUARTERLY

SAMPLING POINT: CCT EFFLUENT

SAMPLES COLLECTED BY: VARIOUS

SAMPLES ANALYZED BY: ENCINA LAB  
& DEL MAR ANALYTICAL

## **MONTHLY EFFLUENT MONITORING**

ANALYSIS	UNITS	DAILY MAX	DAILY LIMIT	30-DAY AVERAGE	30-DAY AVERAGE LIMIT
BOD	MG/L	3.0	45	3.0	30
TSS	MG/L	3.5	45	3.5	30
VSS	MG/L	2		2	
pH*	UNITS	7.19	6 thru 9	7.19	
CHLORIDE	MG/L	283	400	283	350
SULFATE	MG/L	186	400	186	
MANGANESE	MG/L	0.062	0.06	0.055	
IRON	MG/L	0.15	0.4	0.15	0.3
BORON	MG/L	0.40	0.75	0.40	0.75
TDS	MG/L	925	1,200	925	

SAMPLE DATE/TIME:

11/7-8/2006

0800-0800

11/8/2006

13:00PM


SAMPLE TYPE:

COMPOSITE

GRAB\*

I certify that the above information is accurate to the best of my knowledge and that the samples were preserved, prepared, and analyzed according to EPA protocol.

Laboratory Supervisor Signature:



**QUARTERLY MONITORING REPORT  
CARLSBAD WATER RECYCLING FACILITY**

REPORT FOR: DECEMBER 2006

REPORT DUE: FEBRUARY 1, 2007

REPORT FREQUENCY: QUARTERLY

SAMPLING POINT: CCT EFFLUENT

SAMPLES COLLECTED BY: VARIOUS


SAMPLES ANALYZED BY: ENCINA LAB  
& DEL MAR ANALYTICAL

**MONTHLY EFFLUENT MONITORING**

ANALYSIS	UNITS	DAILY MAX	DAILY LIMIT	30-DAY AVERAGE	30-DAY AVERAGE LIMIT
BOD	MG/L	2.8	45	2.8	30
TSS	MG/L	4.7	45	4.7	30
VSS	MG/L	0.4		0.4	
pH*	UNITS	7.09	6 thru 9	7.09	
CHLORIDE	MG/L	271	400	271	350
SULFATE	MG/L	189	400	189	
MANGANESE	MG/L	0.074	0.06	0.064	
IRON	MG/L	0.12	0.4	0.12	0.3
BORON	MG/L	0.42	0.75	0.42	0.75
TDS	MG/L	882	1,200	882	
SAMPLE DATE/TIME:		12/5-6/2006	0900-0900	12/6/2006	07:55AM
SAMPLE TYPE:		COMPOSITE		GRAB*	

I certify that the above information is accurate to the best of my knowledge and that the samples were preserved, prepared, and analyzed according to EPA protocol.

Laboratory Supervisor Signature:

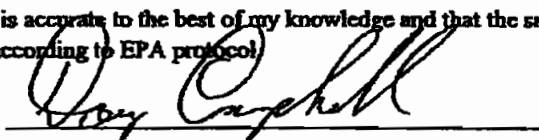

**MONTHLY MONITORING REPORT**  
**CARLSBAD WATER RECYCLING FACILITY**

REPORT FOR: DECEMBER 2006

REPORT DUE: FEBRUARY 1, 2007

REPORT FREQUENCY: MONTHLY

SAMPLING POINT: EFFLUENT STATION

SAMPLES COLLECTED BY: VARIOUS

SAMPLES ANALYZED BY: ENCINA LAB

**12 MONTH EFFLUENT MONITORING**

ANALYSIS	TOTAL COLIFORM HIGH VALUE CFU/100ML	SULFATE 12 MONTH AVERAGE (MG/L)	MANGANESE 12 MONTH AVERAGE (MG/L)	IRON 12 MONTH AVERAGE (MG/L)	BORON 12 MONTH AVERAGE (MG/L)	TDS 12 MONTH AVERAGE (MG/L)
MAXIMUM PERMITTED	240	350	0.05	0.3	0.75	1100
JANUARY	<1	239	0.04	0.1	0.37	894
FEBRUARY	<1	249	0.05	0.1	0.41	986
MARCH	NA	NA	NA	NA	NA	NA
APRIL	NA	NA	NA	NA	NA	NA
MAY	<1	189	0.08	0.1	0.45	842
JUNE	1	193	0.08	0.1	0.38	911
JULY	2	251	0.09	0.1	0.40	968
AUGUST	<1	229	0.07	0.1	0.39	987
SEPTEMBER	<1	201	0.07	0.2	0.44	927
OCTOBER	<1	182	0.07	0.1	0.42	922
NOVEMBER	<1	186	0.06	0.1	0.40	925
DECEMBER	<1	189	0.06	0.1	0.42	882
AVERAGE	<2	211	0.07	0.1	0.41	924

**QUARTERLY MONITORING REPORT  
CARLSBAD WATER RECYCLING FACILITY**

REPORT FOR: OCTOBER THROUGH DECEMBER 2006

REPORT DUE: FEBRUARY 1, 2007

REPORT FREQUENCY: QUARTERLY

SAMPLING POINT: CCT EFFLUENT

SAMPLES COLLECTED BY: JOEL CAMARILLO

SAMPLES ANALYZED BY: ENCINA LAB

**QUARTERLY EFFLUENT MONITORING**

ANALYSIS	UNITS	SAMPLE DATE TIME	SAMPLE TYPE	VALUE
% SODIUM	%	10/10-11/2006 8am-8am	COMPOSITE	0.02
ASAR		"	"	5.52
EC	mS/m	"	"	161.9

I certify that the above information is accurate to the best of my knowledge and that the samples were preserved, prepared, and analyzed according to EPA protocol.

Laboratory Supervisor Signature: 

# ANNUAL MONITORING REPORT

## CARLSBAD WATER RECYCLING FACILITY

REPORT FOR: JANUARY THROUGH DECEMBER 2006

REPORT DUE: FEBRUARY 1, 2007

REPORT FREQUENCY: ANNUAL

SAMPLING POINT: EFFLUENT STATION

SAMPLES COLLECTED BY: VARIOUS

SAMPLES ANALYZED BY: ENCINA LAB  
& TEST AMERICA

## ANNUAL EFFLUENT MONITORING

ANALYSIS	UNITS	SAMPLE DATE TIME	SAMPLE TYPE	VALUE	12 MONTH AVERAGE LIMIT
		7/11-12/2006.			
ALUMINUM	MG/L	0900 - 0900	COMPOSITE	0.043	
ARSENIC	"	"	"	<0.005	
BARIUM	"	"	"	0.033	
CADMIUM	"	"	"	<0.005	
CHROMIUM	"	"	"	<0.005	
COPPER	"	"	"	<0.010	
LEAD	"	"	"	<0.005	
MERCURY	"	"	"	<0.0002	
NICKEL	"	"	"	<0.010	
SELENIUM	"	"	"	<0.01	
SILVER	"	"	"	<0.010	
ZINC	"	"	"	<0.02	
FLUORIDE	"	"	"	0.50	1.0
MBAS	"	"	"	0.07	0.5

I certify that the above information is accurate to the best of my knowledge and that the samples were preserved, prepared, and analyzed according to EPA protocol.

Laboratory Supervisor Signature: 

# MONTHLY MONITORING REPORT

## CARLSBAD WATER RECYCLING FACILITY

REPORT FOR: DECEMBER 2006

REPORT DUE: FEBRUARY 1, 2007

REPORT FREQUENCY: MONTHLY

SAMPLING POINT: CCT EFFLUENT

SAMPLES COLLECTED BY: CONTINUOUS

SAMPLES ANALYZED BY: ENCINA STAFF

### MONTHLY CONTINUOUS NTU MONITORING

Date and Time Stamp	(NTU)
12/2/2006 00:22:32	1.30
12/2/2006 00:52:32	1.10
12/2/2006 01:22:32	1.20
12/2/2006 01:52:32	1.30
12/2/2006 02:22:32	0.00
12/2/2006 02:52:32	1.50
12/2/2006 03:22:32	1.30
12/2/2006 03:52:32	1.30
12/2/2006 04:22:32	1.20
12/2/2006 04:52:32	1.80
12/2/2006 05:22:32	1.80
12/2/2006 05:52:32	1.30
12/2/2006 06:22:32	0.00
12/2/2006 06:52:32	0.00
12/2/2006 07:22:32	0.00
12/2/2006 07:52:32	0.00
12/2/2006 08:22:32	0.00
12/2/2006 08:52:33	0.00
12/2/2006 09:22:33	0.00
12/2/2006 09:52:33	0.00
12/2/2006 10:22:33	0.00
12/2/2006 10:52:33	0.00
12/2/2006 11:22:33	0.00
12/2/2006 11:52:33	0.00
12/2/2006 12:22:33	0.00
12/2/2006 12:52:33	0.00
12/2/2006 13:22:33	0.00
12/2/2006 13:52:33	0.00
12/2/2006 14:22:34	0.00
12/2/2006 14:52:34	0.00
12/2/2006 15:22:34	0.00
12/2/2006 15:52:34	1.10
12/2/2006 16:22:34	1.70
12/2/2006 16:52:34	1.80
12/2/2006 17:22:34	2.00
12/2/2006 17:52:34	2.80
12/2/2006 18:22:34	1.90
12/2/2006 18:52:34	1.30
12/2/2006 19:22:34	1.80
12/2/2006 19:52:34	1.40
12/2/2006 20:22:34	2.30
12/2/2006 20:52:34	2.20
12/2/2006 21:22:34	2.30
12/2/2006 21:52:34	1.20
12/2/2006 22:22:34	2.10
12/2/2006 22:52:34	1.30
12/2/2006 23:22:34	1.40
12/2/2006 23:52:34	1.40

Date and Time Stamp	(NTU)
12/7/2006 00:22:32	1.00
12/7/2006 00:52:32	1.00
12/7/2006 01:22:32	1.00
12/7/2006 01:52:32	1.00
12/7/2006 02:22:32	1.00
12/7/2006 02:52:32	1.00
12/7/2006 03:22:32	1.00
12/7/2006 03:52:32	1.00
12/7/2006 04:22:33	1.00
12/7/2006 04:52:33	1.80
12/7/2006 05:22:33	1.00
12/7/2006 05:52:33	1.00
12/7/2006 06:22:33	1.00
12/7/2006 06:52:33	1.00
12/7/2006 07:22:33	1.00
12/7/2006 07:52:33	1.00
12/7/2006 08:22:33	1.00
12/7/2006 08:52:33	1.00
12/7/2006 09:22:33	1.00
12/7/2006 09:52:33	1.00
12/7/2006 10:22:33	1.00
12/7/2006 10:52:33	1.00
12/7/2006 11:22:33	1.00
12/7/2006 11:52:33	1.00
12/7/2006 12:22:33	1.00
12/7/2006 12:52:33	1.00
12/7/2006 13:22:33	1.00
12/7/2006 13:52:33	1.00
12/7/2006 14:22:34	0.90
12/7/2006 14:52:34	0.90
12/7/2006 15:22:34	0.90
12/7/2006 15:52:34	0.80
12/7/2006 16:24:00	0.80
12/7/2006 16:54:00	0.80
12/7/2006 17:24:00	0.80
12/7/2006 17:54:00	0.80
12/7/2006 18:24:00	0.80
12/7/2006 18:54:00	0.80
12/7/2006 19:24:00	0.80
12/7/2006 19:54:00	0.80
12/7/2006 20:24:00	0.80
12/7/2006 20:54:00	0.70
12/7/2006 21:24:00	0.70
12/7/2006 21:54:00	0.70
12/7/2006 22:24:00	0.70
12/7/2006 22:54:00	0.70
12/7/2006 23:24:00	0.70
12/7/2006 23:54:01	0.70

Date and Time Stamp	NTU
12/8/2008 00:24:01	0.70
12/8/2008 00:54:01	0.80
12/8/2008 01:24:01	0.60
12/8/2008 01:54:01	0.60
12/8/2008 02:24:01	0.60
12/8/2008 02:54:01	0.70
12/8/2008 03:24:01	0.70
12/8/2008 03:54:01	0.60
12/8/2008 04:24:01	0.70
12/8/2008 04:54:01	0.60
12/8/2008 05:24:01	0.70
12/8/2008 05:54:01	0.80
12/8/2008 06:24:01	0.80
12/8/2008 06:54:01	0.80
12/8/2008 07:24:01	0.50
12/8/2008 07:54:01	0.50
12/8/2008 08:24:01	0.50
12/8/2008 08:54:01	0.50
12/8/2008 09:24:01	0.50
12/8/2008 09:54:02	0.50
12/8/2008 10:24:02	0.50
12/8/2008 10:54:02	0.60
12/8/2008 11:24:02	0.50
12/8/2008 11:54:02	0.50
12/8/2008 12:24:02	0.60
12/8/2008 12:54:02	0.50
12/8/2008 13:24:02	0.50
12/8/2008 13:54:02	0.50
12/8/2008 14:24:02	0.50
12/8/2008 14:54:02	0.50
12/8/2008 15:24:02	0.50
12/8/2008 15:54:02	0.60
12/8/2008 16:24:02	0.60
12/8/2008 16:54:02	0.60
12/8/2008 17:24:02	0.80
12/8/2008 17:54:02	0.80
12/8/2008 18:24:02	0.60
12/8/2008 18:54:02	0.60
12/8/2008 19:24:02	0.60
12/8/2008 19:54:03	0.60
12/8/2008 20:24:03	0.60
12/8/2008 20:54:03	0.80
12/8/2008 21:24:03	0.60
12/8/2008 21:54:03	0.60
12/8/2008 22:24:03	0.60
12/8/2008 22:54:03	0.60
12/8/2008 23:24:03	0.60
12/8/2008 23:54:03	0.60

Date and Time Stamp	NTU
12/8/2008 00:24:03	0.60
12/8/2008 00:54:03	0.70
12/8/2008 01:24:03	0.70
12/8/2008 01:54:03	0.70
12/8/2008 02:24:03	0.80
12/8/2008 02:54:03	0.80
12/8/2008 03:24:03	0.80
12/8/2008 03:54:03	0.90
12/8/2008 04:24:03	0.90
12/8/2008 04:54:03	1.00
12/8/2008 05:24:03	1.00
12/8/2008 05:54:03	0.90
12/8/2008 06:24:03	0.90
12/8/2008 06:54:04	0.90
12/8/2008 07:24:04	0.90
12/8/2008 07:54:04	1.00
12/8/2008 08:21:57	1.00
12/8/2008 08:51:52	0.90
12/8/2008 09:21:52	1.00
12/8/2008 09:51:52	1.00
12/8/2008 10:21:52	1.00
12/8/2008 10:51:52	1.00
12/8/2008 11:21:53	1.00
12/8/2008 11:51:53	1.00
12/8/2008 12:21:53	1.00
12/8/2008 12:51:53	1.00
12/8/2008 13:21:54	1.00
12/8/2008 13:51:54	1.00
12/8/2008 14:21:54	1.00
12/8/2008 14:51:54	1.00
12/8/2008 15:21:54	1.00
12/8/2008 15:51:54	1.00
12/8/2008 16:21:54	1.00
12/8/2008 16:51:54	1.00
12/8/2008 17:21:54	1.00
12/8/2008 17:51:54	1.00
12/8/2008 18:21:54	1.00
12/8/2008 18:51:54	1.00
12/8/2008 19:21:54	1.00
12/8/2008 19:51:55	1.00
12/8/2008 20:21:55	1.00
12/8/2008 20:51:55	1.20
12/8/2008 21:21:55	1.10
12/8/2008 21:51:55	1.10
12/8/2008 22:21:55	1.10
12/8/2008 22:51:55	1.10
12/8/2008 23:21:55	1.10
12/8/2008 23:51:55	1.10

<u>Date and Time Stamp</u>	<u>(NTU)</u>
12/11/2006 00:21:59	1.30
12/11/2006 00:51:59	1.30
12/11/2006 01:21:59	1.30
12/11/2006 01:51:59	1.40
12/11/2006 02:21:59	1.35
12/11/2006 02:51:59	1.38
12/11/2006 03:21:59	1.38
12/11/2006 03:51:59	1.30
12/11/2006 04:21:59	1.30
12/11/2006 04:51:59	1.30
12/11/2006 05:21:59	1.30
12/11/2006 05:51:59	1.30
12/11/2006 06:21:59	1.30
12/11/2006 06:51:59	1.30
12/11/2006 07:21:59	1.30
12/11/2006 07:51:59	1.30
12/11/2006 08:21:59	1.30
12/11/2006 08:51:59	1.30
12/11/2006 09:21:59	1.30
12/11/2006 09:51:59	1.30
12/11/2006 10:21:59	1.30
12/11/2006 10:51:59	1.30
12/11/2006 11:21:59	1.30
12/11/2006 11:51:59	1.30
12/11/2006 12:22:00	1.30
12/11/2006 12:52:00	1.30
12/11/2006 13:22:00	1.38
12/11/2006 13:52:00	1.38
12/11/2006 14:22:00	1.30
12/11/2006 14:52:00	1.10
12/11/2006 15:22:00	1.00
12/11/2006 15:52:00	1.00
12/11/2006 16:22:00	1.00
12/11/2006 16:52:00	1.00
12/11/2006 17:22:00	1.00
12/11/2006 17:52:00	1.00
12/11/2006 18:22:00	1.00
12/11/2006 18:52:00	1.00
12/11/2006 19:22:00	1.00
12/11/2006 19:52:00	1.00
12/11/2006 20:22:00	1.00
12/11/2006 20:52:00	1.00
12/11/2006 21:22:00	1.00
12/11/2006 21:52:00	1.00
12/11/2006 22:22:01	0.90
12/11/2006 22:52:01	0.98
12/11/2006 23:22:01	0.90
12/11/2006 23:52:01	0.90

<u>Date and Time Stamp</u>	<u>(NTU)</u>
12/16/2006 00:22:12	0.40
12/16/2006 00:52:12	0.40
12/16/2006 01:22:12	0.40
12/16/2006 01:52:13	0.40
12/16/2006 02:22:13	0.40
12/16/2006 02:52:13	0.40
12/16/2006 03:22:13	0.40
12/16/2006 03:52:13	0.40
12/16/2006 04:22:13	0.40
12/16/2006 04:52:13	0.40
12/16/2006 05:22:13	0.40
12/16/2006 05:52:13	0.40
12/16/2006 06:22:13	0.40
12/16/2006 06:52:13	0.40
12/16/2006 07:22:13	0.40
12/16/2006 07:52:13	0.40
12/16/2006 08:22:13	0.40
12/16/2006 08:52:14	0.40
12/16/2006 09:22:14	0.40
12/16/2006 09:52:14	0.40
12/16/2006 10:22:14	0.40
12/16/2006 10:52:14	0.40
12/16/2006 11:22:14	0.40
12/16/2006 11:52:14	0.40
12/16/2006 12:22:14	0.48
12/16/2006 12:52:14	0.50
12/16/2006 13:22:14	0.50
12/16/2006 13:52:14	0.50
12/16/2006 14:22:14	0.50
12/16/2006 14:52:14	0.50
12/16/2006 15:22:14	0.50
12/16/2006 15:52:14	0.50
12/16/2006 16:22:14	0.50
12/16/2006 16:52:14	0.50
12/16/2006 17:22:15	0.50
12/16/2006 17:52:15	0.50
12/16/2006 18:22:15	0.50
12/16/2006 18:52:15	0.50
12/16/2006 19:22:15	0.50
12/16/2006 19:52:15	0.50
12/16/2006 20:22:15	0.50
12/16/2006 20:52:15	0.50
12/16/2006 21:22:15	0.50
12/16/2006 21:52:15	0.50
12/16/2006 22:22:15	0.50
12/16/2006 22:52:15	0.50
12/16/2006 23:22:15	0.50
12/16/2006 23:52:15	0.50

<u>Date and Time Stamp</u>	<u>(NTU)</u>
12/18/2008 00:22:19	0.50
12/18/2008 00:32:19	0.60
12/18/2008 01:22:19	0.50
12/18/2008 01:52:19	0.80
12/18/2008 02:22:19	0.60
12/18/2008 02:52:20	0.80
12/18/2008 03:22:20	0.60
12/18/2008 03:52:20	0.60
12/18/2008 04:22:20	0.60
12/18/2008 04:52:20	0.60
12/18/2008 05:22:20	0.60
12/18/2008 05:52:20	0.60
12/18/2008 06:22:20	0.60
12/18/2008 06:52:20	0.60
12/18/2008 07:22:20	0.60
12/18/2008 07:52:20	0.80
12/18/2008 08:22:20	0.60
12/18/2008 08:52:21	0.60
12/18/2008 09:22:21	0.60
12/18/2008 09:52:21	0.60
12/18/2008 10:22:21	0.70
12/18/2008 10:52:21	0.70
12/18/2008 11:22:21	0.70
12/18/2008 11:52:21	0.70
12/18/2008 12:22:21	0.70
12/18/2008 12:52:21	0.70
12/18/2008 13:22:21	0.70
12/18/2008 13:52:21	0.70
12/18/2008 14:22:21	0.90
12/18/2008 14:52:21	0.80
12/18/2008 15:22:21	0.70
12/18/2008 15:52:21	0.70
12/18/2008 16:22:21	0.70
12/18/2008 16:52:21	0.70
12/18/2008 17:22:21	0.70
12/18/2008 17:52:21	0.70
12/18/2008 18:22:21	0.70
12/18/2008 18:52:21	0.70
12/18/2008 19:22:21	0.80
12/18/2008 19:52:21	0.70
12/18/2008 20:22:22	0.70
12/18/2008 20:52:22	0.70
12/18/2008 21:22:22	0.70
12/18/2008 21:52:22	0.70
12/18/2008 22:22:22	0.70
12/18/2008 22:52:22	0.70
12/18/2008 23:22:22	0.70
12/18/2008 23:52:22	0.70

<u>Date and Time Stamp</u>	<u>(NTU)</u>
12/22/2008 00:07:26	0.70
12/22/2008 00:37:26	0.70
12/22/2008 01:07:26	0.70
12/22/2008 01:37:26	0.70
12/22/2008 02:07:26	0.70
12/22/2008 02:37:26	0.70
12/22/2008 03:07:26	0.70
12/22/2008 03:37:26	0.80
12/22/2008 04:07:26	0.60
12/22/2008 04:37:26	0.80
12/22/2008 05:07:26	0.40
12/22/2008 05:37:26	0.80
12/22/2008 06:07:26	0.80
12/22/2008 06:37:26	0.90
12/22/2008 07:07:26	0.90
12/22/2008 07:37:26	0.90
12/22/2008 08:07:27	0.90
12/22/2008 08:37:27	0.80
12/22/2008 09:07:27	0.90
12/22/2008 09:37:27	0.80
12/22/2008 10:07:27	0.70
12/22/2008 10:37:27	1.00
12/22/2008 11:07:27	0.90
12/22/2008 11:37:27	0.70
12/22/2008 12:07:27	0.80
12/22/2008 12:37:27	0.50
12/22/2008 13:07:27	0.60
12/22/2008 13:37:27	0.70
12/22/2008 14:07:27	0.70
12/22/2008 14:37:27	1.10
12/22/2008 15:07:27	0.80
12/22/2008 15:37:27	0.90
12/22/2008 16:07:27	0.70
12/22/2008 16:37:28	0.70
12/22/2008 17:07:28	0.70
12/22/2008 17:37:28	0.70
12/22/2008 18:07:28	0.70
12/22/2008 18:37:28	0.70
12/22/2008 19:07:28	0.70
12/22/2008 19:37:28	0.80
12/22/2008 20:07:28	0.70
12/22/2008 20:37:28	0.80
12/22/2008 21:07:28	0.90
12/22/2008 21:37:28	0.90
12/22/2008 22:07:28	0.90
12/22/2008 22:37:28	0.80
12/22/2008 23:07:28	0.80
12/22/2008 23:37:28	0.80

**ATTACHMENT 2**

**LNG DERIVED NATURAL GAS SPECIFICATIONS**



**Dinah Willier**  
Account Manager, Energy Markets  
San Diego Gas and Electric  
8308 Century Park Court  
Mail Location: CP-42K  
San Diego, CA 92123-1593  
Office: (858)854-1135  
Fax: (858)854-1117  
dwillier@semprautilities.com

December 12, 2007

Mr. Tim Hemig  
Vice President  
NRG Energy  
1817 Aston Avenue, Suite 104  
Carlsbad, Ca 92008

RE: Gas Specifications of Gas Derived LNG from Energia Costa Azul (ECA) and NOx Emissions Levels

Dear Mr. Hemig,

As follow up to our meeting last week, you requested Gas Specifications for the gas derived LNG entering SDG&E territory starting in the first quarter of 2008. Also, you requested effects of NOx emissions levels due to the higher Wobbe on turbines.

Attached please find a comparison chart of the ECA Send-Out Gas Specifications for ECA Start-Up Supply, Primary Supplies, Potential Spot Supply and Current Pipeline Supply. This information is provided by Sempra LNG.

Generally, the emissions level will depend on whether the proposed turbine units are being equipped with an active tuning system and how effectively that system performs. Without active tuning one can expect the NOx and CO to change with Wobbe number. If the oxidation catalyst and SCR are designed properly, these increases can be controlled. However, your turbine manufacturer will need to confirm emission guarantees over the stated Wobbe range provided.

If there are any questions, please do not hesitate to contact me.

Sincerely,

A handwritten signature in black ink, appearing to read "Dinah Willier", written over a horizontal line.

Dinah Willier



## ECA Send-Out Gas

	ECA Start-Up Supply	ECA Primary Supplies	Potential Spot Supply	Current Pipeline Supply
Wobbe Index, Btu/Scf	1371 - 1385	1368 - 1385	1371 - 1385	1342
Gross Heating Value, Btu/Scf	1031 - 1073	1034 - 1099	1031 - 1114	1027
Methane	92.6 - 97.9%	88.9 - 97.0%	84.4 - 97.9%	95.8%
Ethane	2.1 - 6.0%	2.0 - 5.9%	2.1 - 10.9%	2.0%
Propane	0.0 - 0.9%	0.4 - 1.8%	0.0 - 2.7%	0.4%
Butanes+	0.0%	0.2 - 1.4%	0.0 - 1.3%	0.2%
Total Inerts	0.0 - 0.3%	0.3 - 2.0%	0.0 - 2.7%	1.6%
Methane Number	92 - 103	80 - 100	76 - 103	99

Standard Conditions - 14.73 psi & 60° F

**ATTACHMENT 3**  
**SIEMENS LETTER**

# SIEMENS

December 17, 2007

Mr. Chris Doyle  
Regional Development Engineering Manager  
NRG West  
1817 Aston Avenue, Suite 104  
Carlsbad, CA 92008

Subject: Encina Plant Air Emissions


Dear Chris,

This letter is to confirm that the natural gas fired two unit Siemens 1x1 SCC6-5000F plant will be designed to meet the following air emissions limits between 60% and 100% gas turbine loads:

- Oxides of Nitrogen (NOx) = 2 ppmvd @ 15% O<sub>2</sub>
- Carbon Monoxide (CO) = 2 ppmvd @ 15% O<sub>2</sub>
- Volatile Organic Compounds (VOC) = 2 ppmvd @ 15% O<sub>2</sub>
- Ammonia Slip (NH<sub>3</sub> Slip) = 5 ppmvd @ 15% O<sub>2</sub>
- Particulate Matter less than 10 Microns Diameter (PM10) = 9.5 lbs/hr

Also, Siemens confirms that natural gas with a Woobe Index of 1335-1385 will not affect Siemens ability to comply with the above limits, assuming the fuel is in compliance with Siemens fuel specification ZDX555-DC01-MBP-2500-01.

Sincerely



James W. Heller  
New Generation Sales Manager


Cc: Kevin Hull, SPG

**ATTACHMENT 4**  
**CEC INFORMATION ON LNG**

Final Staff Assessment

# COLUSA GENERATING STATION

Application For Certification (06-AFC-9)  
Colusa County

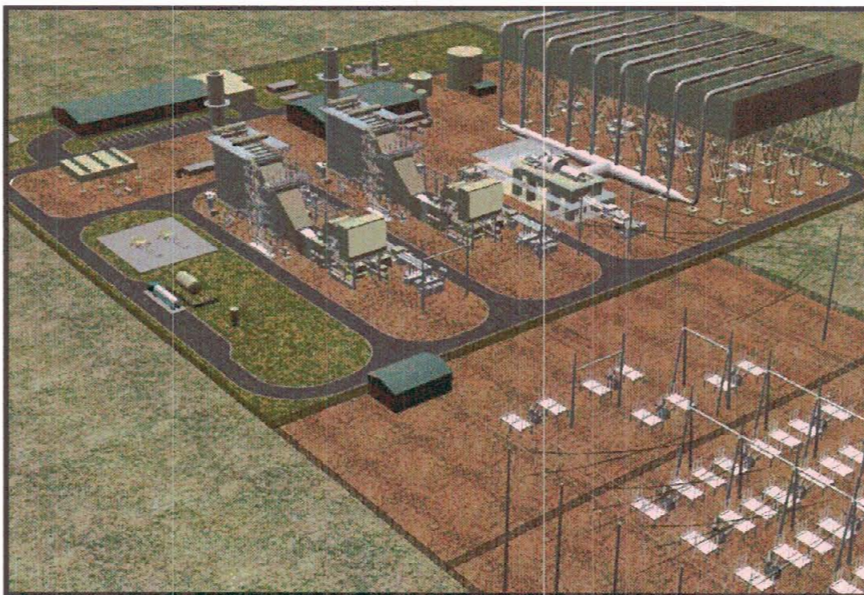

**CALIFORNIA  
ENERGY  
COMMISSION**

**DOCKET**  
**06-AFC-9**

DATE \_\_\_\_\_  
RECD. NOV 30 2007

**STAFF REPORT**

NOVEMBER 2007  
(06-AFC-9)  
CEC-700-2007-003-FSA



PROOF OF SERVICE (REVISED 8/22/07 ) FILED WITH  
ORIGINAL MAILED FROM SACRAMENTO ON 11/30/07  
MS

Final Staff Assessment

CALIFORNIA  
ENERGY  
COMMISSION

## COLUSA GENERATING STATION

Application For Certification (06-AFC-9)  
Colusa County



STAFF REPORT

NOVEMBER 2007  
(06-AFC-9)  
CIC-700-2007-003-45A



## CALIFORNIA ENERGY COMMISSION

### SITING OFFICE

Jack Caswell  
*Project Manager*

Roger E. Johnson  
*Siting Office Manager*

### SYSTEMS ASSESSMENT & FACILITIES SITING DIVISION

Terrence O'Brien  
*Deputy Director*

Therefore, staff's finding of no significant air quality impacts considers the fact that the project area is in attainment of the federal ambient air quality standards, the project will not cause any new exceedances of those standards, and that the ambient air quality standards are protective of human health and ecosystems.

The paragraph on page 4.1-36 was provided to answer a specific comment on sulfur dioxide impacts provided by Emerald Farms and referenced on that page. Sulfur dioxide emission concentrations in Colusa County are low in comparison with many other agricultural areas in California and much lower than in other parts of the United States that have concentrations more than an order of magnitude higher than experienced in the Sacramento Valley. The worst-case modeled 3-hour concentration from project operation is  $51.1 \mu\text{g}/\text{m}^3$  (project impact plus background from AIR QUALITY Table 23), which is well below the  $1300 \mu\text{g}/\text{m}^3$  ambient level required by the U.S.EPA secondary standard (3-hour standard of 0.5 ppm or  $1300 \mu\text{g}/\text{m}^3$ , 40 CFR Sec. 50.5). Staff stands behind the statement that these low concentrations of sulfur dioxide are not expected to cause significant crop damage.

**Comment: Emerald Farms 13.** The modeling analysis appears to be done improperly, an independent analyst should have been hired to review the modeling analysis, and ozone modeling should have been performed.

**Response:** The modeling analysis was reviewed by an independent analyst, Mr. William Walters who is a California Registered Professional Engineer, and through this review comments were made requiring significant revision to both the emission and modeling analyses. These revised modeling analyses meet all CCAPCD modeling requirements, U.S. EPA PSD modeling procedures, and were found to be completely proper by the Energy Commission's independent analyst.

Unlike other criteria pollutants, ozone will not be directly emitted by the project. Ozone is formed through a series of complex photochemical reactions involving NO<sub>x</sub> and VOC, which will be emitted by the project. Due to the complex formation mechanisms, ozone modeling is performed on a regional scale using three-dimensional photochemical grid models, whereas point source Gaussian plume models are generally used for the other directly emitted pollutants. California and federal permitting regulations do not require ozone impact analyses for stationary source permitting.

**Comment: Emerald Farms 14.** There is no discussion of the potential future use of LNG and its related impacts.

**Response:** The use of LNG should not significantly impact the air pollutant emissions from the power plant. First, any LNG that is added to the main PG&E pipeline providing natural gas to the CGS will be diluted by other natural gas sources. Second, the heat rate and other characteristics of received LNG will be regulated. Third, the PG&E pipeline gas will have to meet CPUC regulated composition standards. And fourth, LNG has a zero fuel sulfur content upon receipt (which is raised slightly by adding mercaptan odorants to meet federal pipeline regulation standards) so SO<sub>x</sub> emissions would be reduced. Finally, if the composition of the pipeline natural gas is impacted, within acceptable PG&E composition limitations, the project's CEMS will ensure compliance

with permit emission limits and the power plant can tune combustors to accommodate any long term changes to the natural gas heat content, if necessary. A study completed by the CEC on the impacts of LNG and heat rate variations to power plants operation and pollutant emissions can be downloaded from:

<http://www.energy.ca.gov/2006publications/CEC-700-2006-001/CEC-700-2006-001.PDF>

**Comment: Emerald Farms 15.** The CCAPCD, CEC and CARB had a meeting regarding the PDOC without allowing participation of Emerald Farms, an intervenor in the siting case.

**Response:** To perform its function effectively staff commonly meets or otherwise consults with other regulatory agencies. There is no requirement that Emerald Farms, the applicant, or other intervenors be included in such meetings, and they normally are not. CARB has not been part of any meetings with the CEC and CCAPCD.

**Comment: Emerald Farms 16.** The Delevan Compressor Station is not being adequately monitored for compliance by the CCAPCD.

**Response:** Staff cannot speak to the adequacy of the CCAPCD compliance monitoring for the Delevan Compressor Station; however, unlike the Delevan Compressor Station, the CGS project will also be monitored for ongoing compliance of the Conditions of Certification, which include the CCAPCD conditions, by the CEC.

**Comment: Emerald Farms 17.** The CCAPCD is not adequately responding to California Public Records Act requests, which indicates that the CGS will not be adequately monitored. Emerald Farms needs assurance that the power plant will not impact their organic certification.

**Response:** Public Records Acts requests to another regulatory agency are the responsibility of that agency, not the Energy Commission. As noted in above in response to Comment 16 the CGS will be monitored by both the CCAPCD and the CEC. As noted in the response to Comment 1 the power plant will not impact organic crop certification.

**Comment: Emerald Farms 18.** Regional air quality has not been adequately addressed, and additional mitigation should be required on a regional basis. A discussion of ozone formation being a regional issue was not provided.

**Response:** The project's emission mitigation, in the form of ERCs is a regional mitigation. Emission offsets for the ozone precursor emissions of NOx and VOC mitigate regional impacts of ozone formation. The potential for significant localized impacts are dealt with through Best Available Control Technology mitigation and remaining localized impacts are analyzed through air dispersion modeling. The dispersion modeling analysis found that the project's NOx emissions, prior to the use of offsets, did not cause significant localized air quality impacts.

# **NATURAL GAS QUALITY: POWER TURBINE PERFORMANCE DURING HEAT CONTENT SURGES**


## **CONSULTANT REPORT**

*Prepared For:*

**CALIFORNIA ENERGY COMMISSION**

*Prepared By:*

**Aspen Environmental Group**

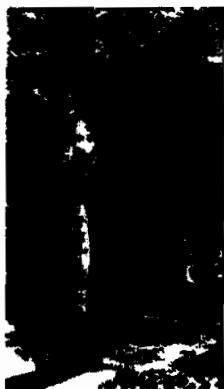

MAY 2006  
CEC-700-2006-001

***Prepared By:***

Aspen Environmental Group  
Will Walters  
Agoura Hills, California  
Contract No. 700-02-004

***Prepared For:***

**California Energy Commission**

Mary Dyas  
***Contract Manager***

Dave Maul  
***Project Manager***

Dave Maul  
***Manager***  
**Natural Gas & Special Projects Office**

Rosella Shapiro  
***Deputy Director***  
**Fuels and Transportation Division**

B. B. Blevins  
***Executive Director***

**DISCLAIMER**

This report was prepared as the result of work sponsored by the California Energy Commission. It does not necessarily represent the views of the Energy Commission, its employees or the State of California. The Energy Commission, the State of California, its employees, contractors and subcontractors make no warrant, express or implied, and assume no legal liability for the information in this report; nor does any party represent that the uses of this information will not infringe upon privately owned rights. This report has not been approved or disapproved by the California Energy Commission nor has the California Energy Commission passed upon the accuracy or adequacy of the information in this report.

## **Acknowledgements**

We would like to thank the following individuals who participated in preparing this report. The principal technical author is William Walters, P.E., of Aspen Environmental Group. The California Energy Commission staff members participating in the preparation of this report include Dave Maul, Chuck Najarian, Mike Purcell, and Joseph Merrill. Additional support in preparing the report was provided by Suzanne Phinney and Judy Spicer of Aspen Environmental Group and Jacque Gilbreath and Andy Churchill of the Energy Commission.

We are particularly indebted to Michael Kowalewski of the Pacific Gas and Electric Company for providing advanced notification of the natural gas high heating content event detailed in this report, and most particularly C. David Zeiger and Diane Tullos of Calpine Corporation, Russ Bennett of the City of Redding Electric Department, and Greg Jans of Midway Sunset Cogeneration Company for providing the natural gas composition and gas turbine operations data cited in this report.

# TABLE OF CONTENTS

<b>Executive Summary .....</b>	<b>ES-1</b>
<b>Chapter 1: Introduction .....</b>	<b>1</b>
Event Introduction .....	1
Collected Event Data.....	1
Study Goals.....	3
<b>Chapter 2: Natural Gas Event Data Summary .....</b>	<b>5</b>
Pipeline Natural Gas Data .....	5
Turbine Fuel Data.....	7
Sutter.....	7
Los Medanos.....	10
Natural Gas Composition Definitions and Regulations.....	11
<b>Chapter 3: Gas Turbine Data Summary .....</b>	<b>13</b>
Redding.....	13
Sutter.....	14
Los Medanos.....	15
Delta.....	16
<b>Chapter 4: Observed Event Effects .....</b>	<b>17</b>
Redding.....	17
Sutter.....	19
Los Medanos.....	26
Delta.....	29
<b>Chapter 5: Other Variable Heat Content Effects Data.....</b>	<b>33</b>
<b>Chapter 6: Other Study Findings/Other Considerations .....</b>	<b>37</b>
Other Study Findings.....	37
<b>Chapter 7: Data Limitations .....</b>	<b>39</b>
<b>Chapter 8: Conclusions.....</b>	<b>41</b>
<b>Bibliography .....</b>	<b>43</b>
<b>Appendix A – Data Summary</b>	

# LIST OF TABLES AND FIGURES

Figure ES-1: Pipeline Natural Gas Heat Content at Pittsburg .....	ES-1
Figure ES-2 – Sutter CT2 Pre-SCR NO <sub>x</sub> Levels versus Wobbe Index .....	ES-3
Figure ES-3: Sutter CT2 Ammonia Use versus Wobbe Index .....	ES-3
Figure ES-4: Sutter CT2 Post-SCR NO <sub>x</sub> versus Wobbe Index .....	ES-4
Table 1-1: Power Plant Collected Event Data .....	1
Figure 1-1: PG&E Pipeline Route and Power Plant Locations .....	2
Figure 2-1: Pipeline Natural Gas Heat Content and Wobbe Index .....	5
Figure 2-2: Pittsburg Natural Gas Major Component Composition Data .....	6
Figure 2-3: Pittsburg Natural Gas Minor Component Composition .....	7
Figure 2-4: Sutter Natural Gas Heat Content and Wobbe Index .....	8
Figure 2-5: Sutter Natural Gas Major Component Composition .....	9
Figure 2-6: Sutter Natural Gas Minor Component Composition .....	10
Figure 2-7: Los Medanos Natural Gas Heat Content Data .....	11
Table 3-1: Gas Turbine Description Summary .....	13
Figure 3-1: Redding Turbine Operating Heat Input Load Data .....	13
Figure 3-2: Sutter Turbines Operating Heat Input .....	14
Figure 3-3: LMEC Turbine Operating Heat Input .....	15
Figure 3-4: Delta Turbine Operating Heat Loading and MW Output .....	16
Figure 4-1: Redding Turbine Pre-SCONOX NO <sub>x</sub> Levels and Fuel Heat Content .....	17
Figure 4-2: Redding Turbine Pre-SCONOX NO <sub>x</sub> Emissions Trend with Increased Fuel Heat Content .....	18
Figure 4-3: Redding Turbine Controlled NO <sub>x</sub> Concentration versus Natural Gas Heat Content .....	19
Figure 4-4: Sutter Pre-SCR NO <sub>x</sub> Emissions and Wobbe Index .....	20
Figure 4-5: Sutter CT2 Pre-SCR NO <sub>x</sub> Levels versus Natural Gas Heat Content .....	21
Figure 4-6: Sutter CT2 Pre-SCR NO <sub>x</sub> Levels versus Wobbe Index .....	22
Figure 4-7: Sutter Turbines Ammonia Use versus Natural Gas Heat Content .....	23
Figure 4-8: Sutter Turbines Ammonia Use versus Wobbe Index .....	24
Figure 4-9: Sutter Turbines Controlled NO <sub>x</sub> Concentration versus Natural Gas Heat Content .....	25
Figure 4-10: Sutter Turbines Controlled NO <sub>x</sub> Concentration versus Wobbe Index .....	25
Figure 4-11: LMEC Gas Turbines Ammonia Injection Rates .....	26
Figure 4-12: LMEC Turbine Heat Load Adjusted Ammonia Injection Rate versus Fuel Heat Content .....	27
Figure 4-13: LMEC Gas Turbines Ammonia Injection Rates versus Heat Input .....	28
Figure 4-14: LMEC Turbines Controlled NO <sub>x</sub> Emissions and Natural Gas Heat Content .....	29
Figure 4-15: Delta Gas Turbines Ammonia Consumption .....	30

Figure 4-16: Delta Gas Turbines Ammonia Injection Rates versus Heat Input Rate	30
Figure 4-17: Delta Gas Turbines NOx Emissions .....	31
Figure 5-1: Midway Sunset CO Emissions versus Fuel Heat Content .....	33
Figure 5-1: Midway Sunset CO Emissions versus Wobbe Index .....	34
Table 6-1: Other Natural Gas Heat Content Study Finding Summary.....	37

# ACRONYMS AND TERMS

## Acronyms

Btu:	British thermal unit (a unit of heat)
CO:	Carbon Monoxide
CT:	Combustion Turbine
DLN:	Dry Lo-NOx (A turbine combustor design that controls NOx emissions)
HHV:	Higher heating value
Lbs/hr:	pounds per hour
LMEC:	Los Medanos Energy Center
MMBtu/hr:	Million Btus per hour
NOx:	Nitrogen Oxides
PG&E:	Pacific Gas & Electric Company
Ppm:	parts per million
SCAQMD:	South Coast Air Quality Management District
Scf:	standard cubic foot
SCR:	Selective Catalytic Reduction (a NOx control technology)
SoCalGas:	Southern California Gas Company
SRI:	Southern Research Institute

## **Terms**

- C6 +:** Hydrocarbons with six or more carbon molecules.
- Inerts:** Non combustible components of natural gas (e.g. nitrogen and carbon dioxide).
- Mole percent:** Composition in percent of the total number of molecules for that given component. For gases it is the same as volume percent composition.
- SCONox:** Trademarked name for a NOx/CO control technology. SCONox, unlike SCR, does not use ammonia and has no ammonia slip emissions.
- Wobbe index:** An index of fuel gas interchangeability. It is the higher heating value (Btu/scf) of the gas divided by the square root of the density of the gas (air density = 1)

## **EXECUTIVE SUMMARY**

This study reports the testing results on emissions and performance of various electrical generating facilities in commercial operation that burned higher than normal heating value natural gas. During the second week of June 2005, a natural gas liquids extraction plant in Canada failed, which resulted in higher than normal heating value gas to travel south through the Pacific Gas and Electric Company (PG&E) pipeline system. The flow of natural gas occurred for three days, which allowed for testing and data collection to document and analyze the emissions and performance impacts on large gas turbines at the Redding, Sutter, Los Medanos, and Delta facilities.

There is a great deal of interest in the heat content of natural gas, with many studies, tests, and papers completed over the past several years regarding the effects of higher and lower heat content natural gas. Much of this work has been conducted to support efforts to develop natural gas interchangeability regulations/specifications. These efforts have included testing many residential and commercial combustion sources; however, to date little direct data from on-line large gas turbines serving the power industry have been available. This study attempts to provide data to begin filling this gap in empirical knowledge.

### **Natural Gas Heat Content Excursion**

The natural gas in the PG&E pipeline excursion event showed an approximate 5 percent increase in heat content, from approximately 1,025 British thermal unit per standard cubic foot (Btu/scf) to 1,078 Btu/scf, and an approximate 2 percent increase in Wobbe index, from 1340 to 1369. Figure ES-1 shows the heat content data, as measured by PG&E from June 10 through June 13, 2005, in Pittsburg, California.

**Figure ES-1: Pipeline Natural Gas Heat Content at Pittsburgh**



The heat content excursion varied over time, decreasing from the peak that occurred early in the excursion. The excursion lasted approximately 3.5 days at Pittsburgh. The start and end time of the excursion varied based on location as the natural gas traveled from north to south through the pipeline.

A more complete description of the pipeline natural gas and as-used fuel natural gas is provided in Chapter 2.

## Gas Turbine Operational Effects

In general, the heat content excursion caused little or no noticeable effect in facility operations or exhaust emissions based on the available data. The only effects that could be shown statistically are minor increases in pre-control system nitrogen oxides (NO<sub>x</sub>) and NO<sub>x</sub> control system ammonia use. The post-control system NO<sub>x</sub> emissions did not show any trend versus fuel heat content or Wobbe index. Using the results from the Sutter Plant as an example, Figure ES-2 shows the Pre-Selective Catalytic Reduction (SCR) NO<sub>x</sub> (@ actual O<sub>2</sub> levels) versus fuel Wobbe index for Sutter Combustion Turbine 2 (CT2) during high load operation.

**Figure ES-2 – Sutter CT2 Pre-SCR NOx Levels versus Wobbe Index**


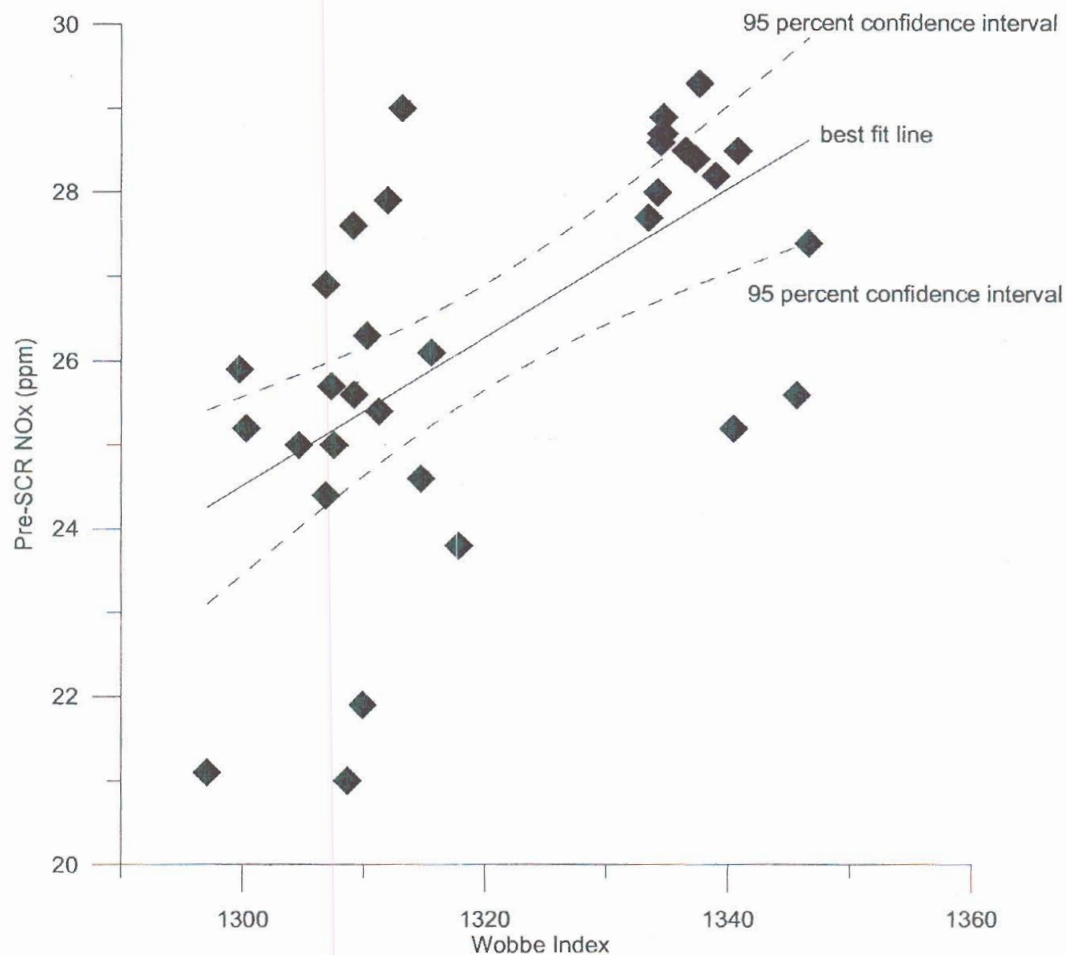


Figure ES-2 shows the best fit linear equation line with a 95 percent confidence interval for that fit. The high load interval presented in the figure is for high load hours that range in heat input from 1,700 and 1,800 million Btu per hour (MMBtu/hr). An approximate 15 percent increase in pre-SCR NOx concentration for a 3.5 percent increase in Wobbe index is predicted. Additional pre-control system NOx concentration data compared to heat content and Wobbe index are presented in Section 4.

Figure ES-3 shows the SCR system ammonia use versus natural gas heat content for the Sutter facility CT2.

**Figure ES-3: Sutter CT2 Ammonia Use versus Wobbe Index**

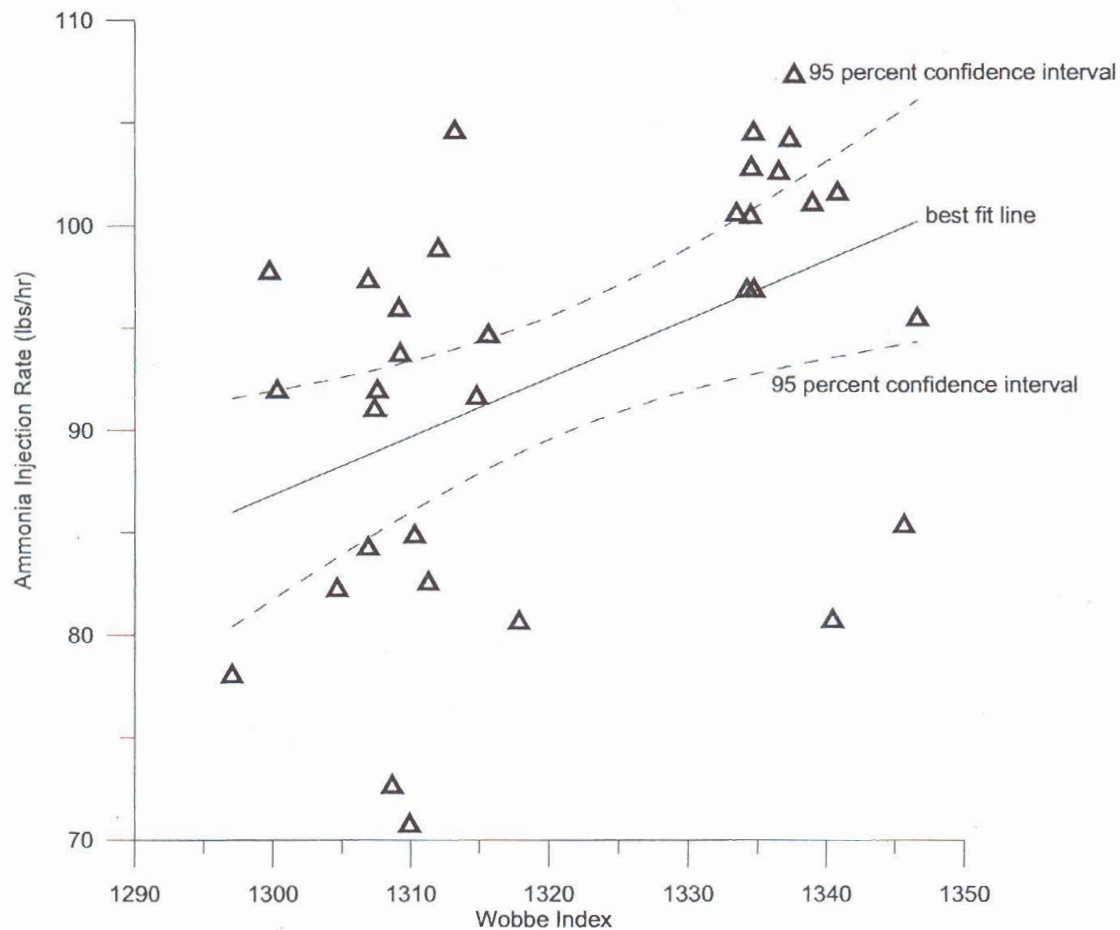

The ammonia consumption rates during the same high turbine load interval for Sutter CT2 are shown in Figure ES-3 with a best linear fit and 95 percent confidence interval for that fit. An approximate 10 percent increase in SCR ammonia use for a 3.5 percent increase in Wobbe index is predicted.

While the Sutter CT2 pre-SCR NO<sub>x</sub> emission concentrations and ammonia injection rates show a minor increase with increased Wobbe Index at high loads, the post-SCR NO<sub>x</sub> concentrations do not show any significant increase with Wobbe index. Figure ES-4 shows the post-SCR NO<sub>x</sub> levels (@15% O<sub>2</sub>) for the Sutter CT2 at the same high load interval shown in Figures ES-2 and ES-3.

**Figure ES-4: Sutter CT2 Post-SCR NO<sub>x</sub> versus Wobbe Index**

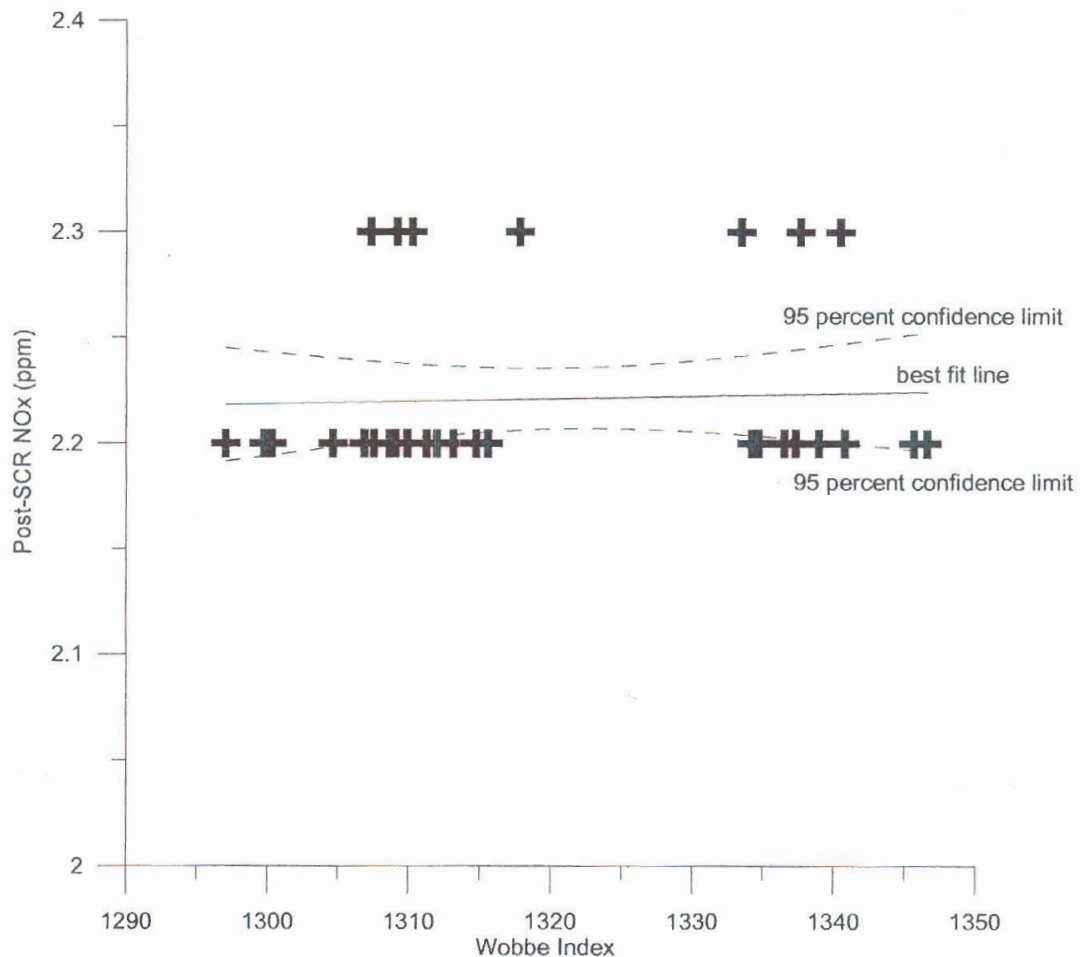


Figure ES-4 includes a best linear fit and a 95 percent confidence interval for that fit. No apparent trend in controlled NO<sub>x</sub> concentrations at the higher load interval is predicted. Additional data on controlled NO<sub>x</sub> concentrations for the other facilities are provided in Section 4.

## Summary

The increase in heat content/Wobbe index caused a small increase in pre-SCONOX and pre-SCR NO<sub>x</sub> emissions of the Redding and Sutter facilities, respectively, and an increase in ammonia use, indicating an increase in pre-SCR NO<sub>x</sub> emissions, at the Delta and Los Medanos facilities.

At no time during normal operations did any of the controlled NO<sub>x</sub> concentrations at any of the facilities included in this study exceed their air quality permit limits. The NO<sub>x</sub> control systems for these facilities were able to adjust to counteract the increased turbine NO<sub>x</sub> emissions.

# CHAPTER 1: INTRODUCTION

## Event Introduction

In June 2005, Pacific Gas and Electric Company (PG&E) notified the California Energy Commission (Energy Commission) that a slug of high heating value gas, resulting from an outage at a liquids extraction plant in Canada, would be moving through the PG&E system.

An increase in heating value of approximately 6 percent, from about 1,020 to about 1,080 Btu per cubic foot, lasted for approximately 3 days. Customers south of Stockton and San Jose had lower increases in the energy content of their gas.<sup>1</sup>

The Energy Commission requested both natural gas testing and gas turbine operating data, including emissions data, from several electric generating plants that used gas from the affected pipeline for several days surrounding this event. The electric generating plants that voluntarily participated include the City of Redding Generating Unit #5 (Redding),<sup>2</sup> the Sutter Power Plant (Sutter),<sup>3</sup> the Los Medanos Energy Center Los Medanos or LMEC,<sup>4</sup> and the Delta Energy Center (Delta).<sup>5</sup> The pipeline route and participating facilities are shown on Figure 1-1.

## Collected Event Data

The data that were available and collected from each of the power facilities varied due to facility design and data access. A summary of the natural gas and facility operating data provided from each plant is provided in Table 1-1. The collected data are presented in Appendix A.


**Table 1-1: Power Plant Collected Event Data**

	Natural Gas Data				Performance Data					Exhaust Data					
Facility	Btu Content (as-used)	Pipeline Gas Hydrocarbon Composition	Pipeline Gas Inert Composition	Pipeline Gas Specific Gravity	Heat or Fuel Input	MW Output (GT only)	Efficiency Estimate	Ammonia Flow	Process Status	Pre-SCONox/Pre-SCR NOx	Controlled NOx	Controlled CO	Oxygen Content	Turbine/Stack Exhaust Temperatures	SCR Catalyst Temperature
Redding	X	-	-	-	X	-	-	N/A	X	X	X	X	X	-/-	N/A
Sutter	X	- <sup>1</sup>	-	-	X	X	-	X	X	X	X	X	X	X/X	X
LMEC	X	X <sup>2</sup>	X <sup>2</sup>	-	X	X	X	X	-	-	X	X	X	X/-	-
Delta	-	X <sup>2</sup>	X <sup>2</sup>	x	X	X	X	X	-	-	X	X	X	X/-	-

1 – Data supplied were limited to the as-used blended gas composition data.

2 – Data supplied from PG&E pipeline adjacent to Delta gas blending facility, but blended gas composition data for Delta were not available.

**Figure 1-1: PG&E Pipeline Route and Power Plant Locations**

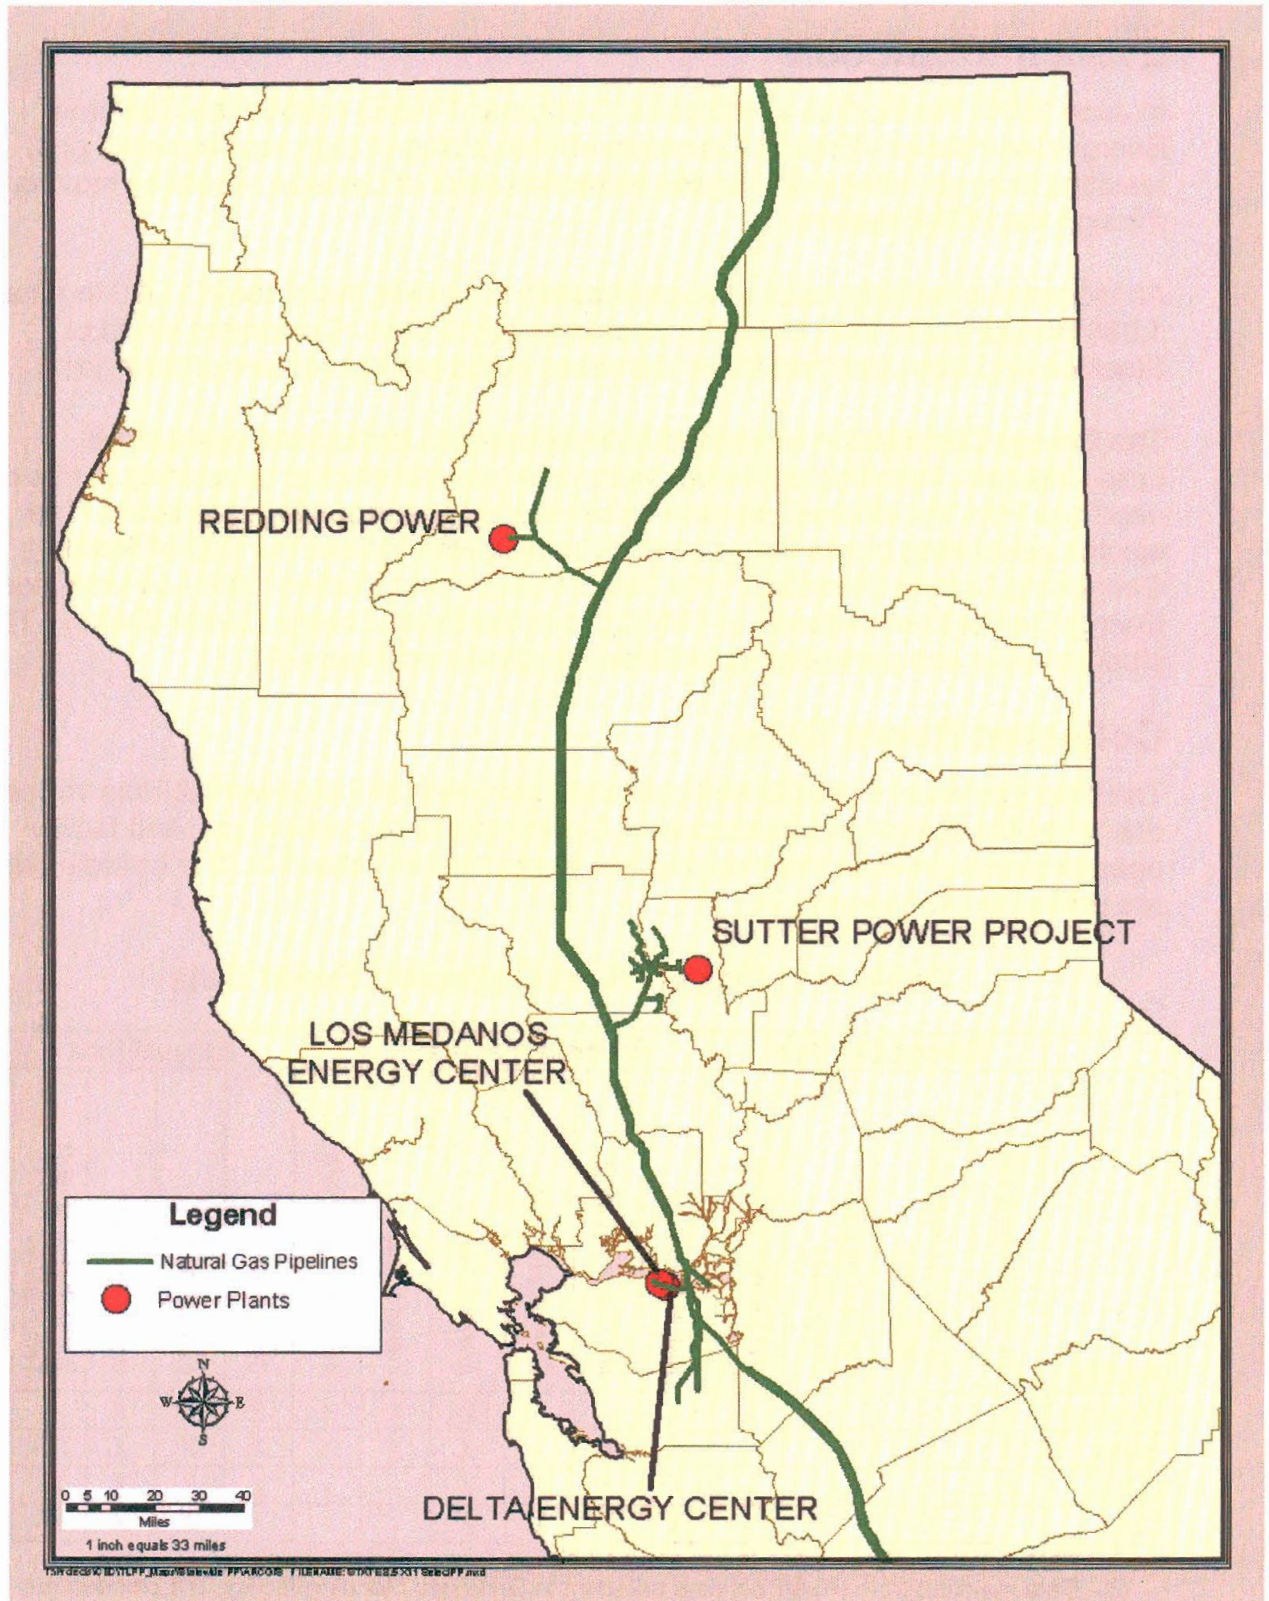

One limitation of this study is the fact that the three Calpine facilities (Sutter, LMEC, and Delta) all used blended gas fuels, either exclusively or partially, during the excursion event. The data available for these blended gas streams, excepting Sutter, did not include enough data to calculate Wobbe index, so most of the excursion event effect comparisons use gas heat content rather than Wobbe index.

## **Study Goals**

The goals of this study were to obtain quality data for the gas heat content excursion event and corresponding gas turbine operational data during the event as well as to determine any perceived effects to the gas turbine operations due to the increased natural gas heat content. To determine operational effects, the levels of NOx emissions (as measured leaving the turbine) and controlled NOx emissions (as measured following NOx control technology) were analyzed. Ammonia injection rates were also analyzed, since ammonia is used for NOx control at three of the four facilities.

This study will support the assessment of the potential impacts of natural gas variability and natural gas interchangeability rulemaking (CPUC R.04-01-25) on the operations of large natural gas-fired power production facilities. Comments on this study will be used to help define future work necessary to adequately assess this subject.

## CHAPTER 2: NATURAL GAS EVENT DATA SUMMARY

Natural gas data were obtained both at the pipeline and for gas mixtures used at various gas turbine sites, with the exception of the Delta facility where the as-used blended fuel gas heat content and composition data were not available.

### Pipeline Natural Gas Data

Pipeline specific data for the natural gas excursion were monitored at two locations, Redding and Pittsburg. The Redding natural gas data are from Redding Power Unit #5, which uses the pipeline gas without blending. The Redding natural gas data are limited to Btu content. The Pittsburg natural gas data are from the PG&E Los Medanos pipeline just upstream of a blending station used for the Delta and Los Medanos facilities. The Pittsburg natural gas data include Btu content, specific gravity, and other compositional data (hydrocarbon, inerts, etc.).

Figure 2-1 presents the Redding and Pittsburg pipeline natural gas heat content data, and Pittsburg pipeline natural gas Wobbe index for June 8 through June 13, 2005. The available Pittsburg natural gas data begin June 10.

**Figure 2-1: Pipeline Natural Gas Heat Content and Wobbe Index**


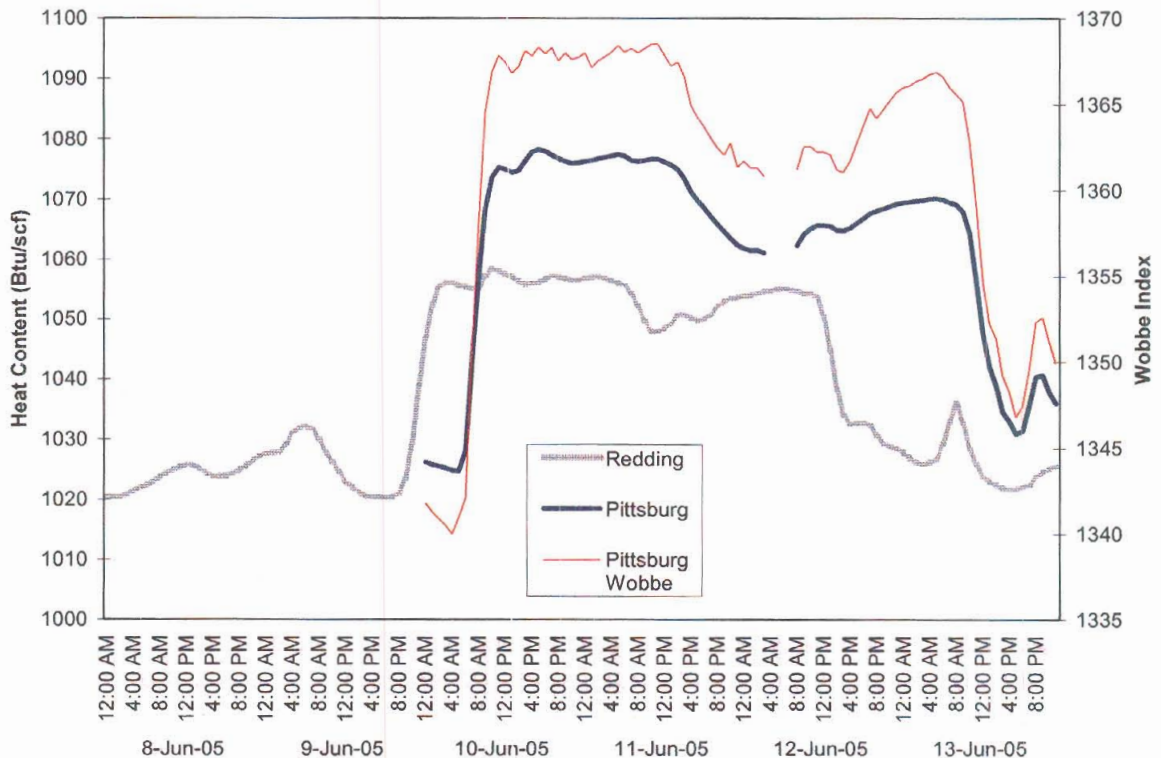


Figure 2-1 shows that the data for the excursion event at the two separate pipeline locations have a very similar shape with a time lag of several hours for the gas to

flow from Redding to Pittsburg. However, the total Btu contents and increases during the excursion event are different - both the heat content and duration of the excursion are greater at Pittsburg. The excursion event heat content and Wobbe index increase at Pittsburg was 5 percent and 2 percent, respectively, during the excursion event, while the heat content increase at Redding was a little less than 4 percent during the excursion event. There does not appear to be any reason why the duration and heat contents should be significantly different in these two locations.

Figures 2-2 and 2-3 present the Pittsburg natural gas compositional data from June 10 through June 13, 2005. For graphing purposes, the data are grouped by components with similar content levels.

**Figure 2-2: Pittsburg Natural Gas Major Component Composition Data**

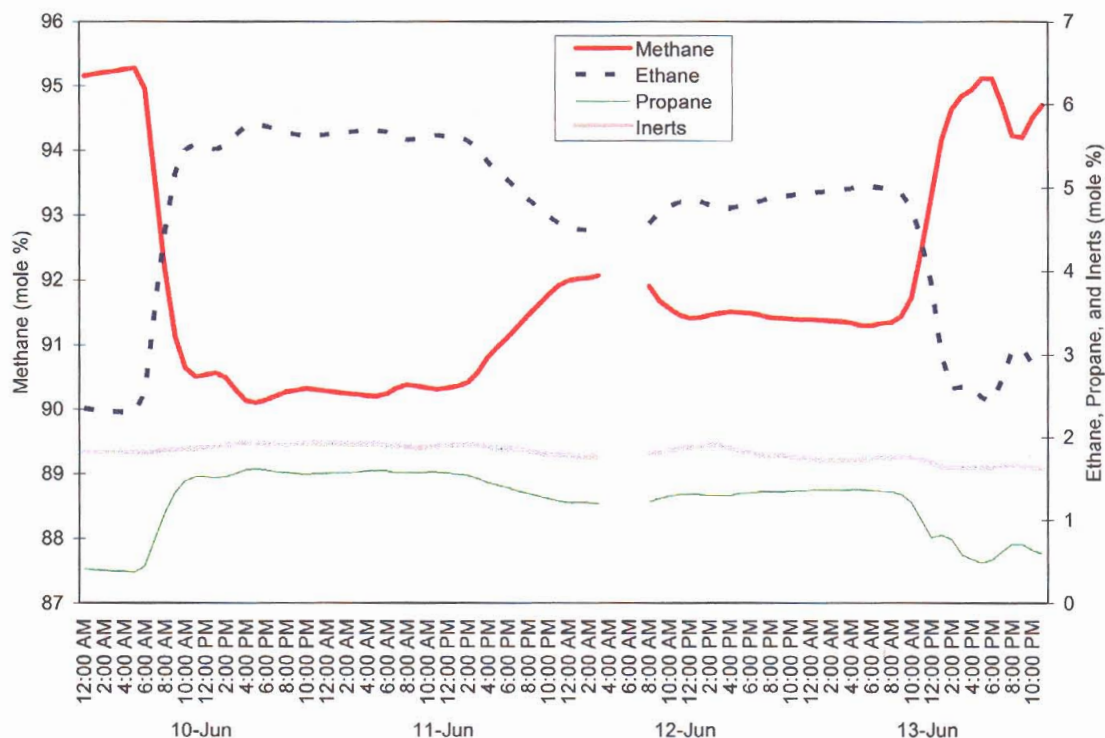

As would be predicted, Figure 2-2 shows that during the excursion the methane concentrations decreased by 4 to 5 percent while the ethane and propane concentrations essentially doubled. The higher heating value of the gas is the result of greater percentages of non-methane components such as ethane and propane. The inerts concentrations, which were shown to be entirely nitrogen and carbon dioxide, increased very slightly during the excursion event, with the nitrogen content decreasing and the carbon dioxide content increasing at a greater level to create the overall slight increase in total inerts.

**Figure 2-3: Pittsburgh Natural Gas Minor Component Composition**

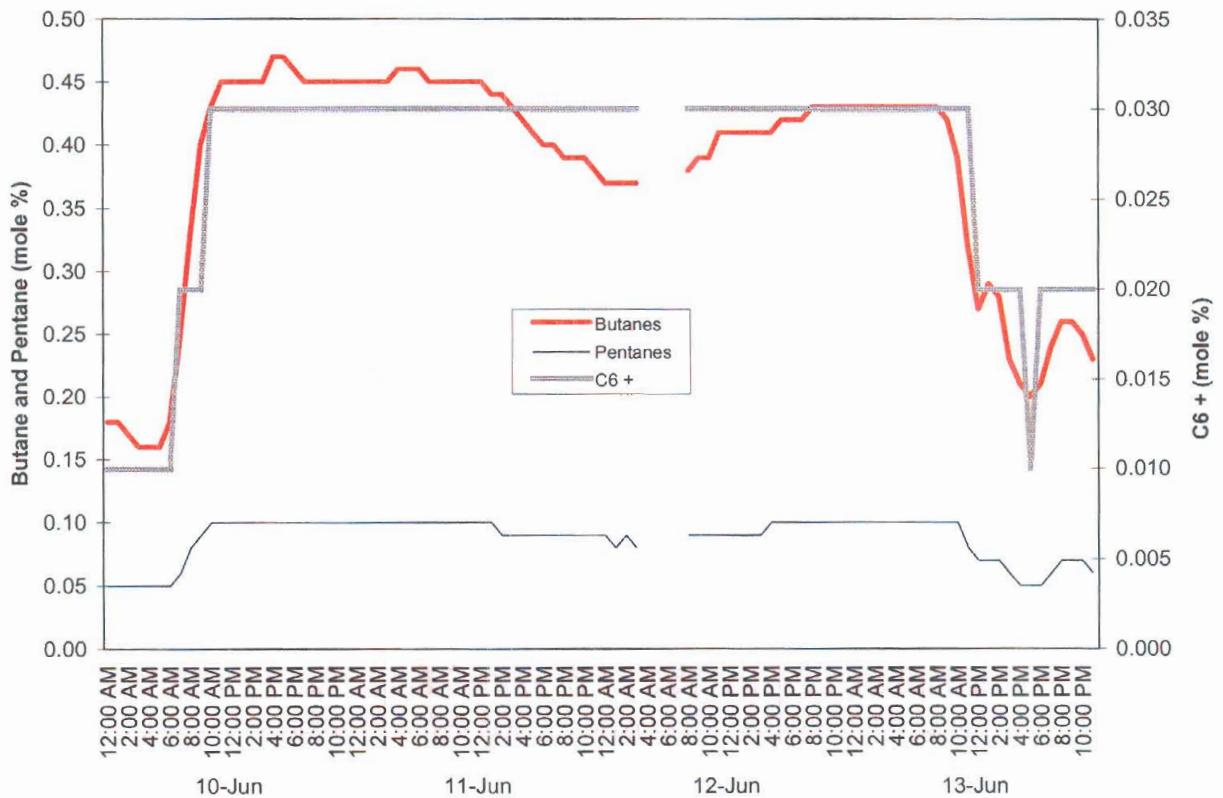


Figure 2-3, like Figure 2-2, shows an increase in the heavier hydrocarbon composition during the heat content excursion event. The total butane (i-butane and n-butane) and total C6 + hydrocarbon concentrations (hydrocarbons with six or more carbon molecules) essentially tripled during the excursion and the total pentane (i-pentane and n-pentane) concentration doubled during the excursion.

The natural gas specific gravity measured at Pittsburgh increased by a maximum of just over six percent during the excursion event.

## Turbine Fuel Data

The turbine fuel heat content and composition for the Sutter and Los Medanos facilities are not the same as the pipeline fuel since the as-used fuel for each is a blend of sources.

### Sutter

Figure 2-4 provides the heat content and Wobbe index data for the Sutter facility fuel during the excursion period.

**Figure 2-4: Sutter Natural Gas Heat Content and Wobbe Index**

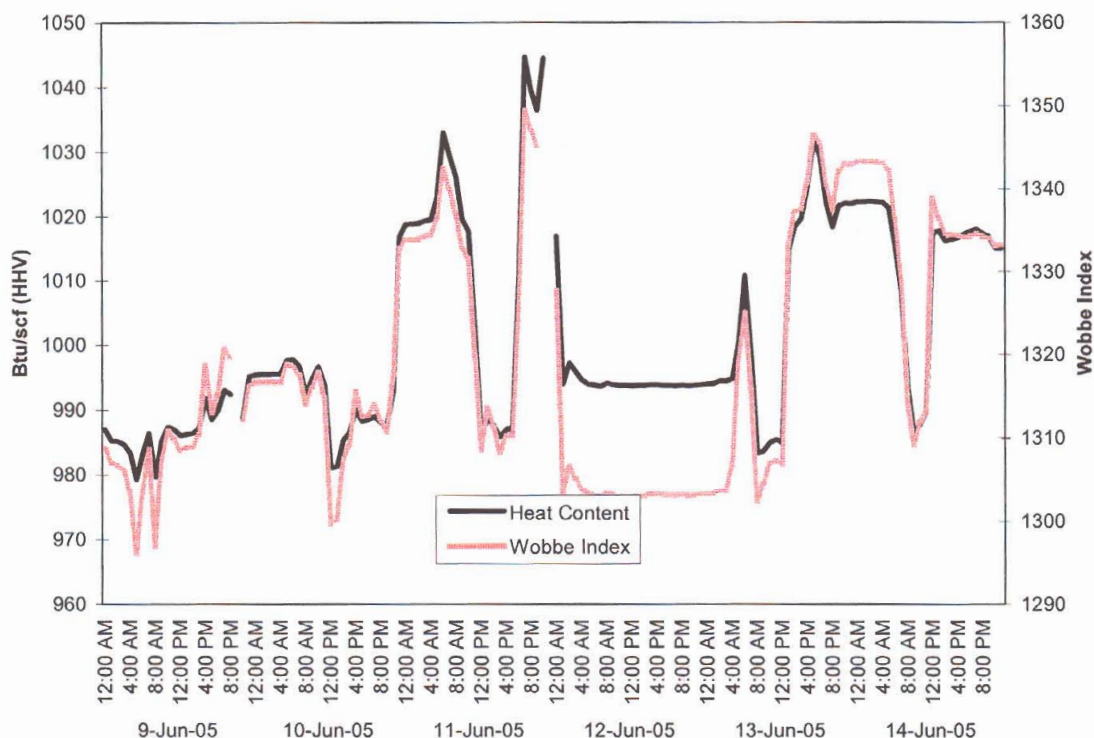


Figure 2-4 shows that the heat content and Wobbe index of the natural gas were variable during the excursion period and do not match the excursion event curve shown in Figure 2-1. The mixing of separate fuel sources allowed the Sutter facility to buffer the impact of the heat content excursion for most of the excursion period; however, the overall heat content and Wobbe index variations during short periods are as large as, or greater than, that shown for the Pittsburg pipeline gas in Figure 2-1.

Limited composition data were also available from the Sutter facility fuel gas. These are presented in Figures 2-5 and 2-6.

**Figure 2-5: Sutter Natural Gas Major Component Composition**

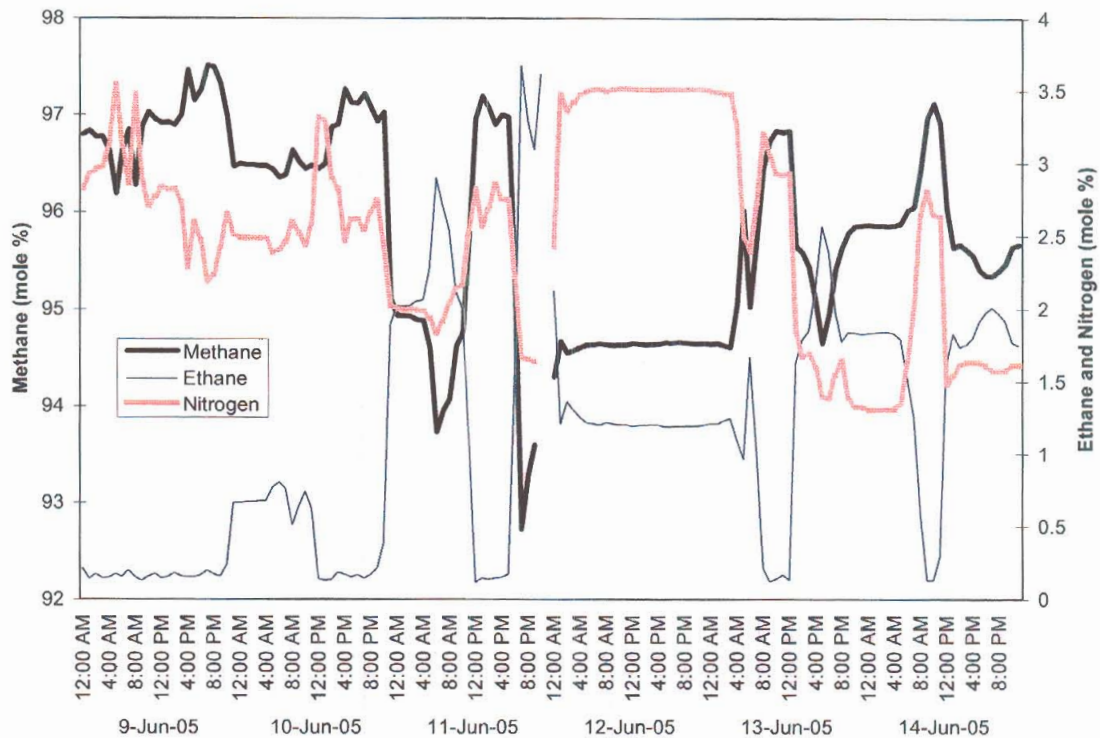


Figure 2-5 shows that the composition of the major components varied significantly during the excursion period. The variable mixture of different fuel sources created a highly variable fuel mix. The methane composition varies by almost 5 percent, the ethane composition varies from near 0 percent to over 3.5 percent, and the nitrogen content varies by nearly a factor of 3.


A critical review of the Sutter natural gas fuel data indicates that the non-pipeline fuel source being used in the blend contains an almost exclusive mixture of methane (~97 percent) and nitrogen (~3 percent) with very little ethane (~0.1 percent) and essentially no propane or butane. Using this composition assumption for the non-pipeline blend gas, Figure 2-6 shows clearly when pipeline gas with its higher propane and butane content is being used in the fuel gas blend.

Figure 1 is a dual-axis line graph showing the mole percentage of Propane (red line) and Butane (blue line) in the gas phase over time from June 9 to June 14, 2005. The left y-axis represents Propane (mole %) from 0 to 1.0. The right y-axis represents Butane (mole %) from 0 to 0.14. The x-axis shows time in 4-hour intervals. Propane levels show several peaks, with the highest reaching nearly 1.0 mole % on June 11. Butane levels also show peaks, with the highest reaching approximately 0.13 mole % on June 13.

## Los Medanos

10

**Figure 2-7: Los Medanos Natural Gas Heat Content Data**

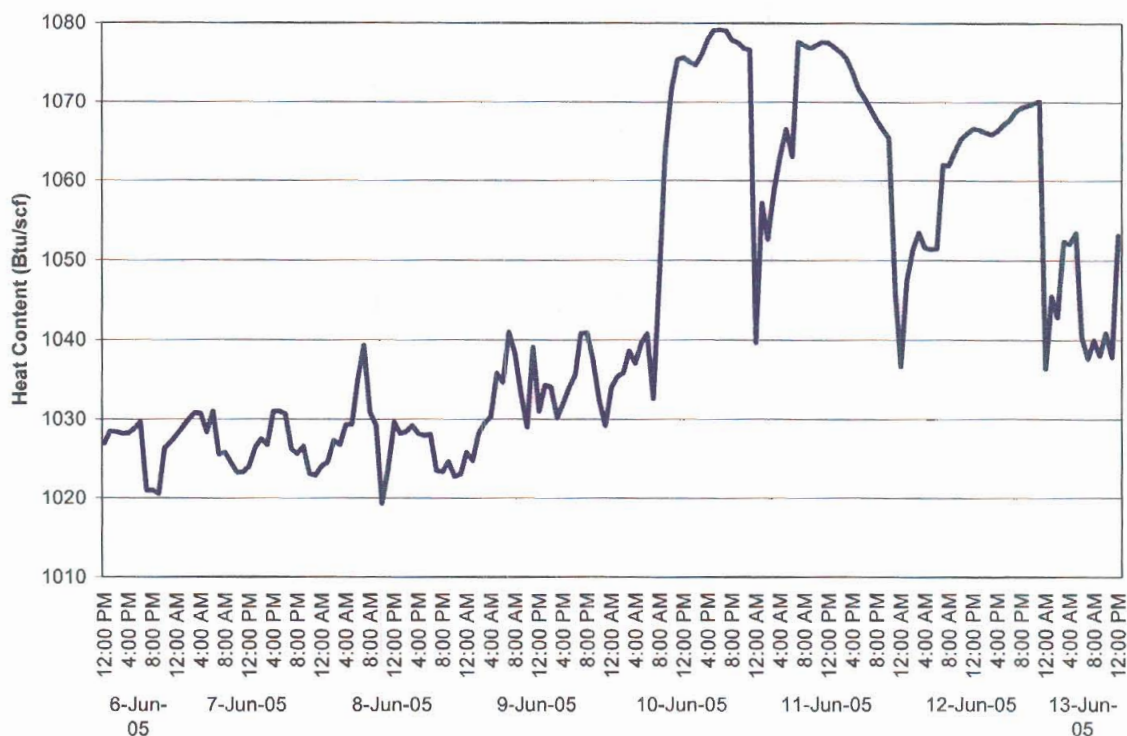

This figure matches much of the Pittsburg pipeline gas excursion curve, but due to the facility occasionally accepting the Calpine/PG&E mixed gas, as well as the unmixed pipeline gas, the curve is broken up with areas of lower Btu content. For periods of time during the excursion event, this facility consumed gas with a Btu content that was nearly 5 percent higher than the average heat content for the days prior to the excursion event.

## **Natural Gas Composition Definitions and Regulations**

The data presented above were compared to rules and regulations regarding the content of natural gas. Current relevant natural gas definitions and regulations are as follows:

1. PG&E Rule 21 requires pipeline natural gas to have a heating value that is consistent with the standards established by PG&E for each Receipt Point(s), and requires gas interchangeability in accordance with the methods and limits presented in American Gas Association (AGA) Bulletin 36.<sup>6</sup>
2. SoCalGas Rule 30 requires pipeline natural gas to meet lower and upper Btu limits of 970 and 1150 Btu/scf (HHV, Higher Heating Value), respectively, and to meet AGA Bulletin 36 interchangeability indices.<sup>7</sup>
3. The U.S. Environmental Protection Agency (EPA), for the purposes of its New Source Performance Standard regulation for gas turbines (40 CFR Part 60 Subpart GG), defines natural gas as containing at least 70 percent by volume methane or having a Btu content of 950 to 1100 Btu (HHV).<sup>8</sup>

It should be noted that PG&E Rule 21 does not include the Wobbe index in its natural gas definitions, limits, or specifications.

The natural gas in the pipeline during the excursion event remained within the higher end of the Btu limit of these definitions, and the methane content remained over 90 percent during the excursion. The Btu content of the gas stayed within the maximum allowable PG&E specification for that pipeline (1080 Btu/scf).

Additionally, the variability of the Wobbe index, as evidenced at Pittsburg, would have complied with SoCalGas Rule 30 specifications and remained well below 1400.

## CHAPTER 3: GAS TURBINE DATA SUMMARY

As noted previously, four facilities provided natural gas and turbine performance data. The gas turbine model and number and associated emission control technologies for each of those facilities are as follows:

**Table 3-1: Gas Turbine Description Summary**

Facility	Turbine Type (Number)	MW (Turbine/Plant)	Emission Control Technologies
Redding	Alstom GTX100 (1)	43/56 (Unit 5 only)	SCONox
Sutter	Westinghouse 501FD (2)	175/540	DLN, SCR, and Oxidation Catalyst
Delta	Westinghouse 501FD (3)	175/861	DLN, SCR
LMEC	General Electric 7FA (2)	172/555	DLN, SCR, and Oxidation Catalyst

All four facilities have NO<sub>x</sub> controls which will adjust to maintain preset NO<sub>x</sub> exhaust concentration limits. Three of the four facilities use ammonia to control NO<sub>x</sub> emissions; only the SCONox technology, used at the Redding facility, does not use ammonia.

### Redding

The Redding facility provided natural gas heat content data, and gas turbine fuel use and certain exhaust emission parameters. As noted above, this facility does not use ammonia. The operating heat input of the gas turbine during the excursion is provided in Figure 3-1.

**Figure 3-1: Redding Turbine Operating Heat Input Load Data**


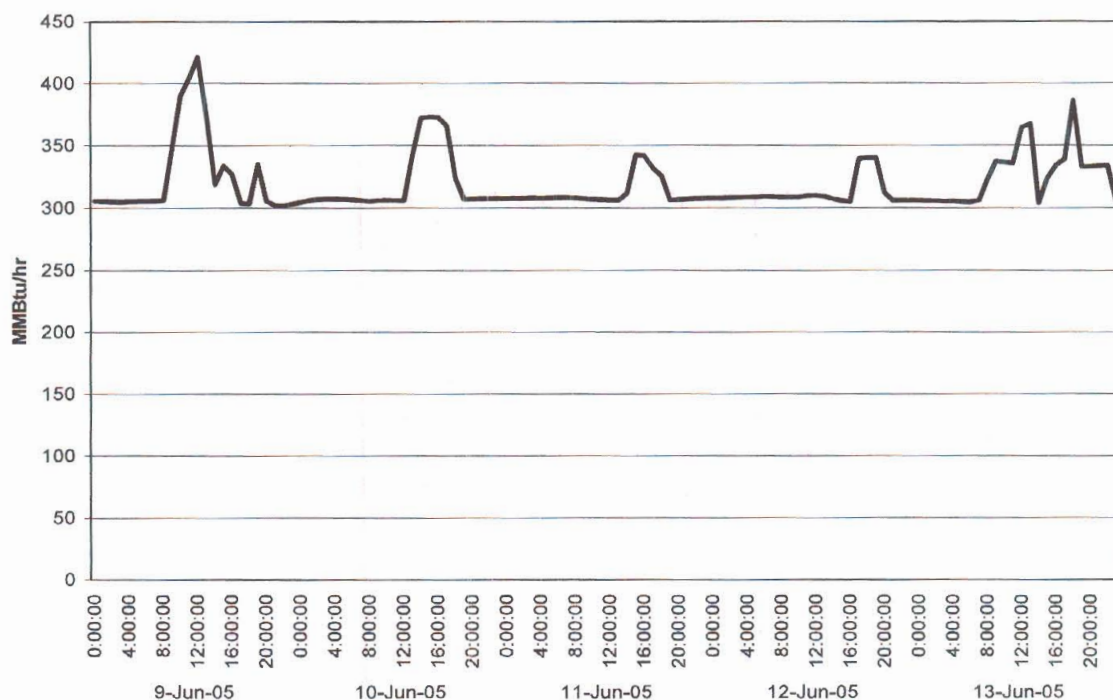


Figure 3-1 shows that the facility was running in a fairly consistent reduced load mode with daily increases in load during the afternoon. Less variable operating conditions are desired when determining the effect of the gas heat content increase on turbine operations. The more operating parameters that are static during the excursion event, the more likely that actual effects can be observed.

## Sutter

The Sutter facility provided natural gas Btu content and composition data, gas turbine fuel use, MW production, and certain exhaust emission parameters. Ammonia is used for NO<sub>x</sub> control at this facility. The operating heat input of the two gas turbines during the excursion event is provided in Figure 3-2.

**Figure 3-2: Sutter Turbines Operating Heat Input**

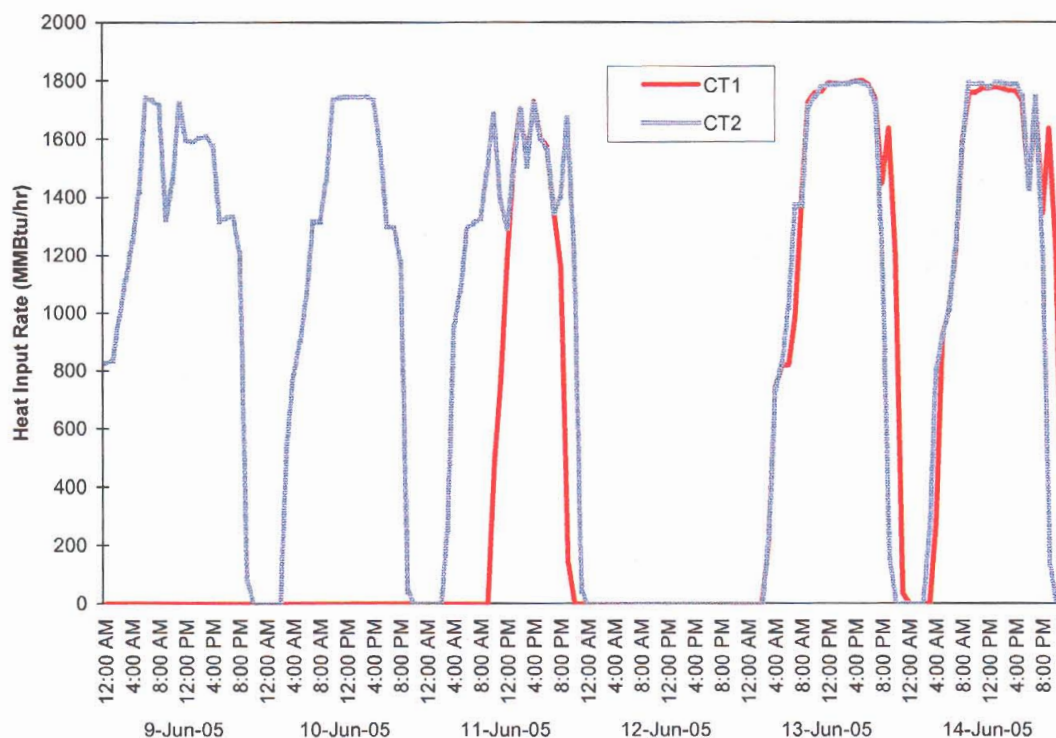


This figure shows that the Sutter facility operations were variable during the excursion period. However, there are three times when operations were consistent for a few hours at a time (on June 10, June 13, and June 14) that may provide some useful effects data. However, the rest of the period either represents down time, startup or shutdown periods, or is otherwise considered too variable for comparative purposes.

## Los Medanos

The LMEC facility provided natural gas heat content, gas turbine fuel use and MW output, and certain exhaust emission parameters. The facility uses ammonia for NO<sub>x</sub> control. The operating heat input of the two gas turbines during the excursion is provided in Figure 3-3.

**Figure 3-3: LMEC Turbine Operating Heat Input**

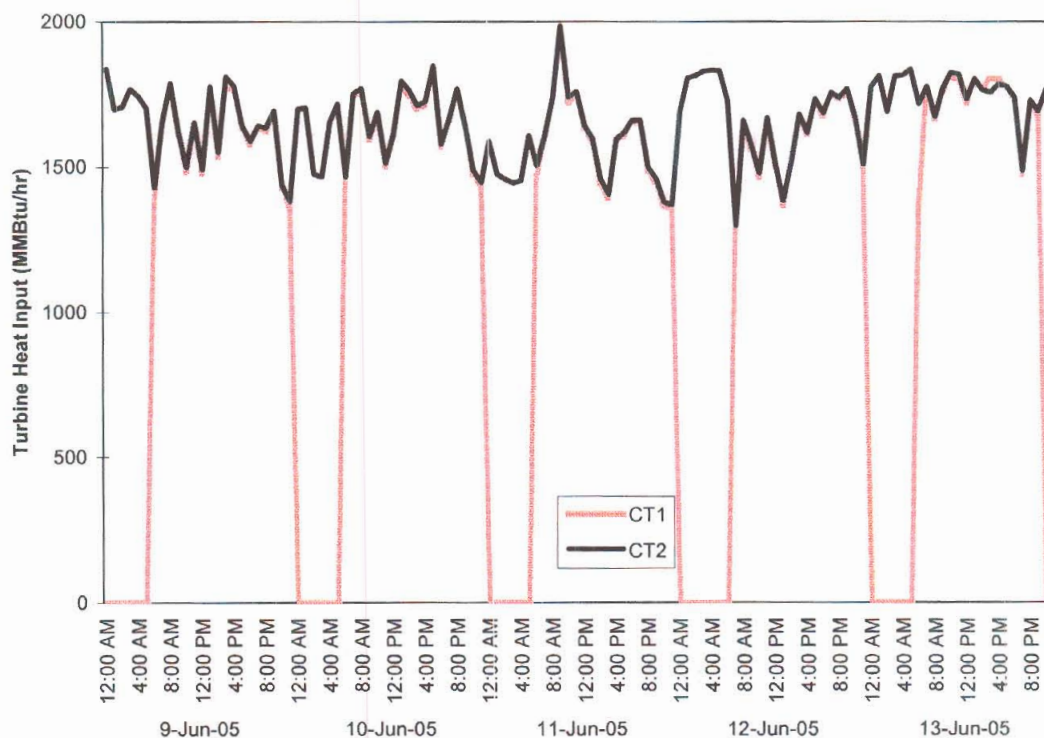


As shown in Figure 3-3, the load input of Turbine 2 (CT2), while somewhat variable, ranged between approximately 1300 and 2000 MM Btu/hr for the entire period of the heat content excursion, while Turbine 1 (CT1) underwent many startup/shutdown cycles during the period. The major limitation for using LMEC data to determine effects of the higher Btu gas is that only controlled emissions data were available. Therefore, the ammonia injection quantities will be the main variable assessed to determine if any effects were shown during the excursion event. However, due to the hourly load variability, the normal ammonia injection rate variability may be greater than what would occur due from an increase in gas heat content/Wobbe index.

## Delta

This facility was operating in load following mode during the period of the excursion. Similar to LMEC, the small quantity of highly variable operating data that was obtained has limited use in predicting effects from the natural gas heat content excursion. This is exacerbated by the fact that actual as-used natural gas heat content data are not available for the period of the excursion event. However, for information purposes, the operating heat input data for the three Delta turbines are presented in Figure 3-4.

**Figure 3-4: Delta Turbine Operating Heat Loading and MW Output**

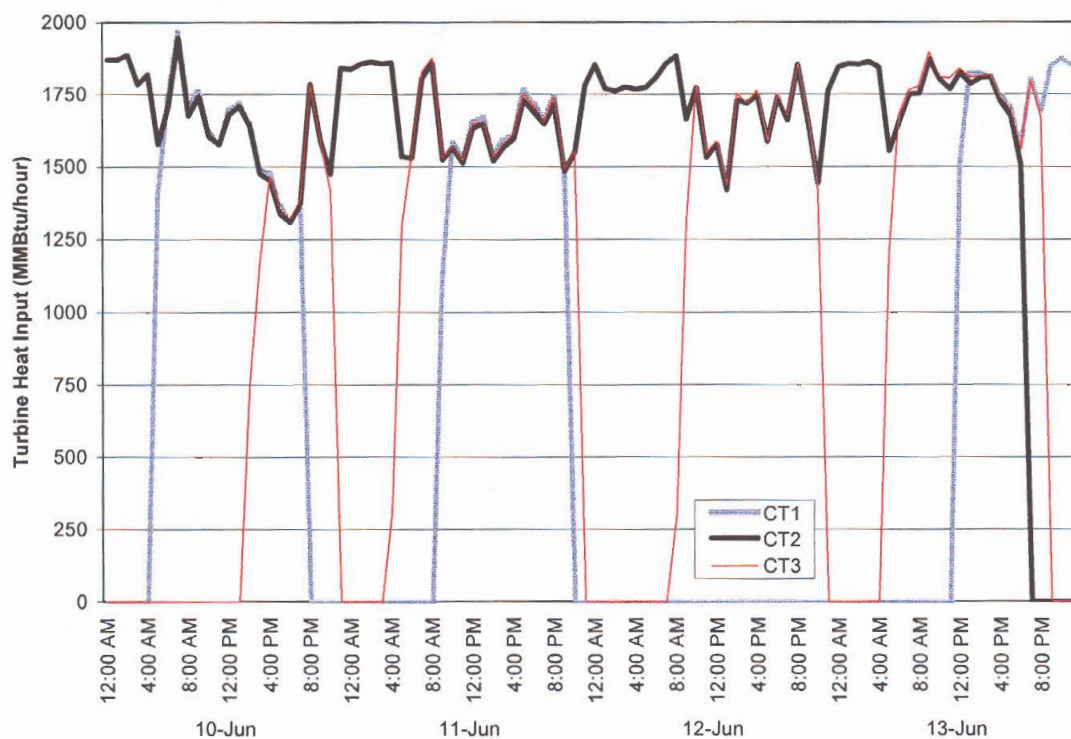

As shown in Figure 3-4, the load is highly variable and Turbines 1 (CT1) and 3 (CT3) went through numerous startup and shutdowns during the period. Turbine 2 (CT2) operated more consistently than the other two turbines.


## CHAPTER 4: OBSERVED EVENT EFFECTS

The observed effects are presented facility by facility and for each turbine, if multiple turbine data are available.

### Redding

The data obtained for the Redding gas turbine included pre- and post SCONox NOx levels. The Redding facility operated with some consistency during the excursion event period so determining the relationship between the heat content of the gas and NOx emissions is fairly straightforward. Figure 4-1 shows the pre-SCONox NOx emissions (@ actual O<sub>2</sub> levels), the gas turbine heat input, and the natural gas heat content for the data collection period.

**Figure 4-1: Redding Turbine Pre-SCONox NOx Levels and Fuel Heat Content**

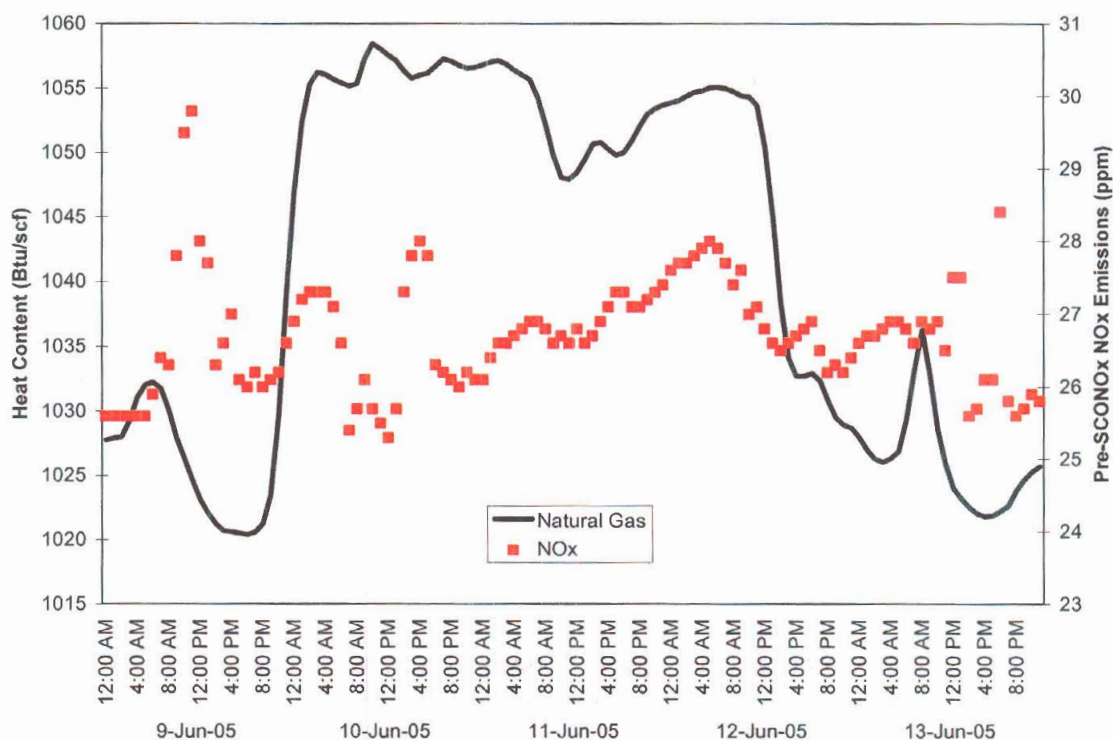

As noted previously, and shown in Figure 3-1, the load increased every afternoon to handle additional demand, so the increases in NOx concentrations seen in the afternoon are at least partially due to the increase in load. By removing these peaking load periods a more definitive relationship can be established. This relationship is shown in Figure 4-2.

**Figure 4-2: Redding Turbine Pre-SCONox NOx Emissions Trend with Increased Fuel Heat Content**


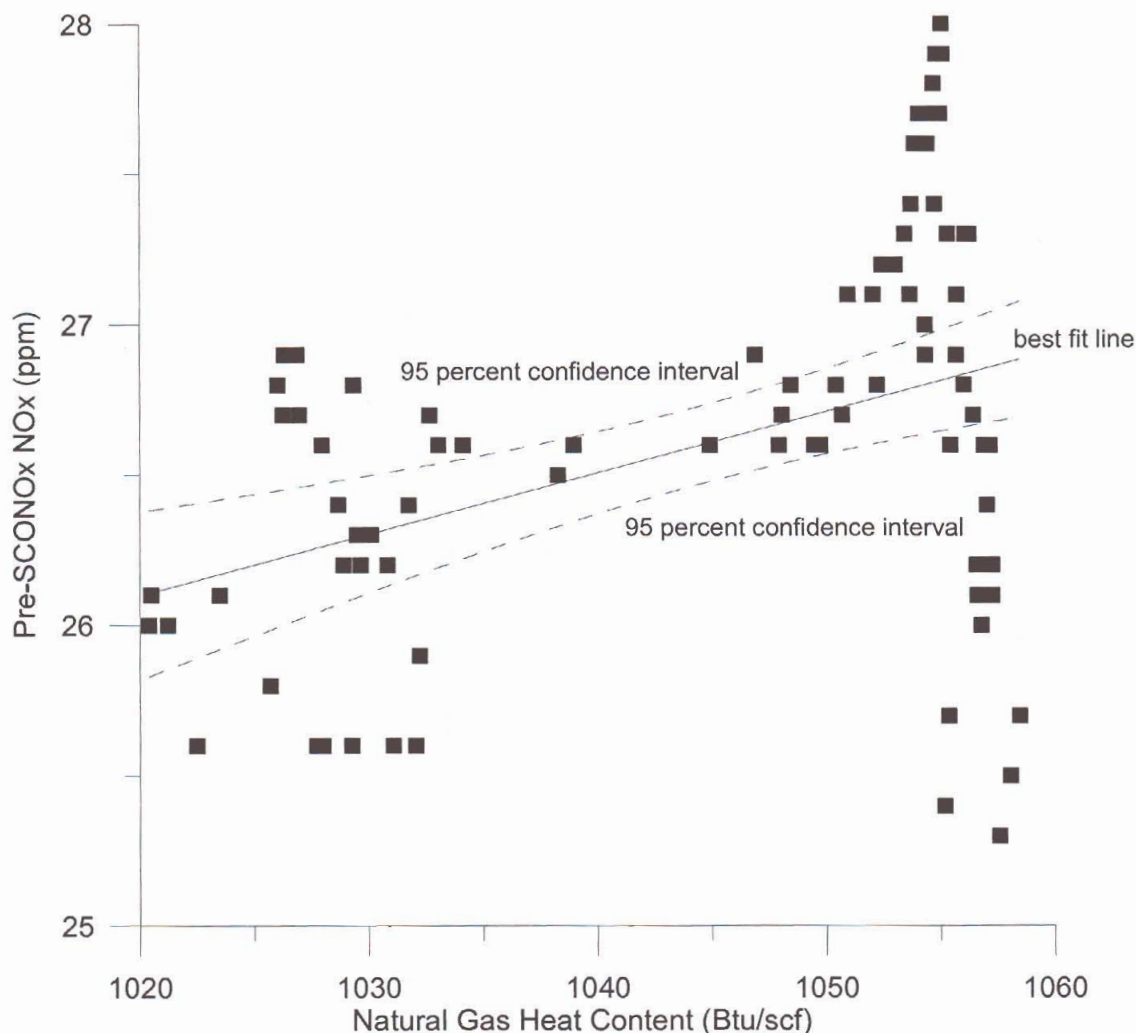


Figure 4-2 predicts that, for the range of natural gas heat contents observed, the pre-SCONox NOx emissions will increase approximately 4 percent for a heat content increase of 4 percent. The turbine load represented by this data was limited to approximate values between 300 and 310 MMBtu/hr heat input (see Figure 3-1), which is approximately 60 percent of full load. It is possible that the effects shown in Figure 4-2 would be more pronounced at full load. Figure 4-2 also presents a linear regression best fit line and a 95 percent confidence interval for that fit.

Figure 4-3, using the same load level range as in Figure 4-2, shows that there appears to be no such pattern for the controlled NOx emissions (@15% O<sub>2</sub>). The SCONox system appears to be able to compensate for the apparent increase in pre-SCONox NOx emissions caused by the increase in natural gas heat content/Wobbe index.

**Figure 4-3: Redding Turbine Controlled NOx Concentration versus Natural Gas Heat Content**

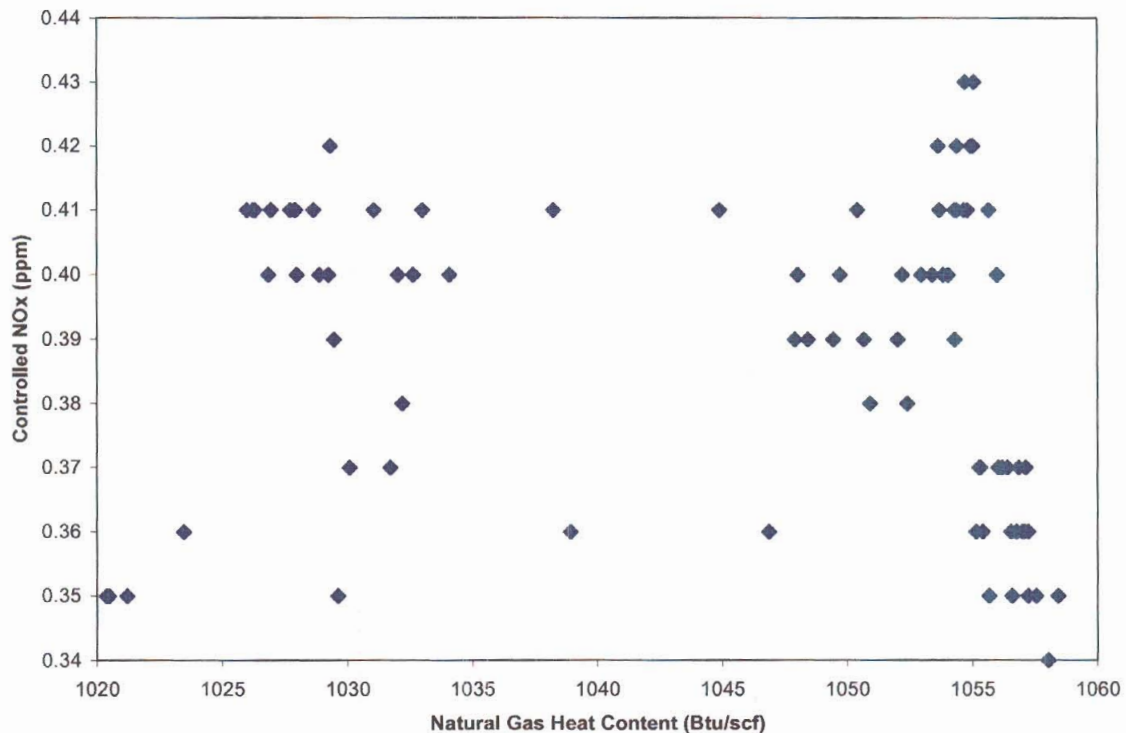


In conclusion, the increased heat content of the natural gas caused a slight increase in pre-SCONox NOx emissions; however, the SCONox control system was able to compensate so that the exhaust emissions did not increase by the same factor.

## Sutter


The data obtained for the Sutter gas turbines include pre- and post-SCR NOx levels and ammonia injection rates. The Sutter facility operated for two periods of stable load during the excursion event (see Figure 3-2); data from these periods are used in the analysis. Figure 4-4 shows the pre-SCR NOx emissions (@15% O<sub>2</sub>) for normal operating hours and fuel Wobbe index during the entire data collection period.

**Figure 4-4: Sutter Pre-SCR NOx Emissions and Wobbe Index**

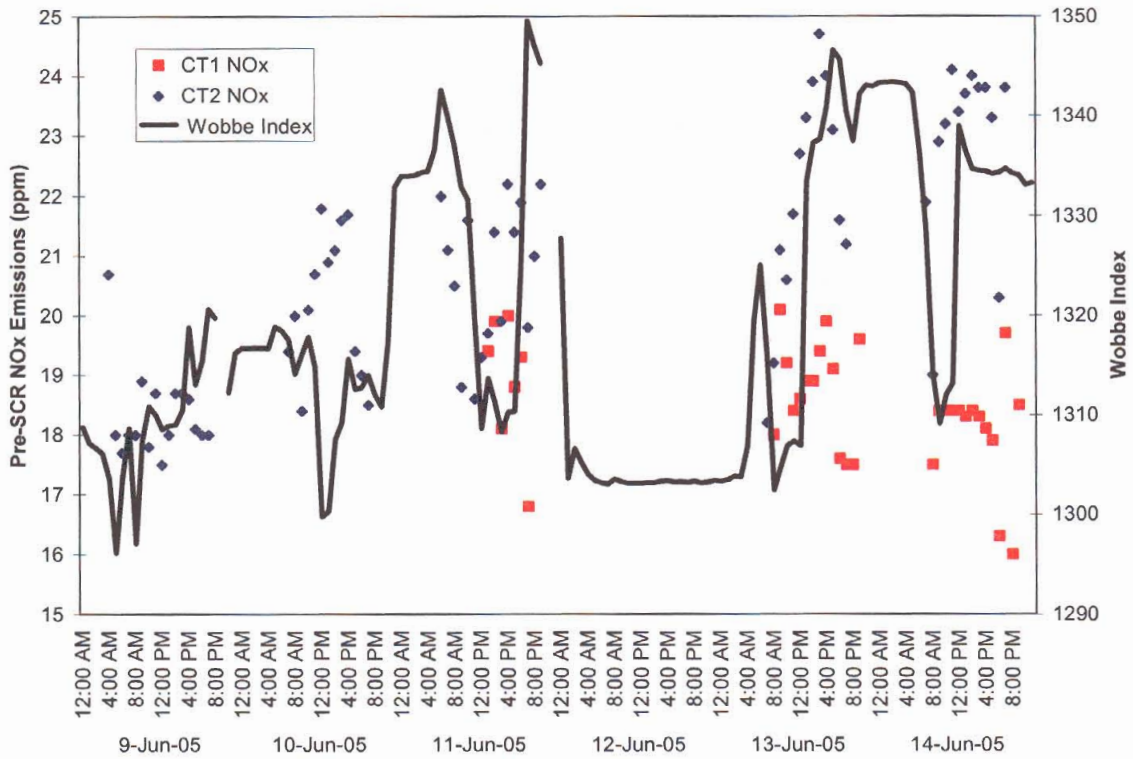

The data in Figure 4-4 can be somewhat misleading since the data cover all normal operating data regardless of turbine load, and turbine load will clearly affect NOx emissions. By focusing on Sutter CT2 and its periods with stable loads, a more definitive relationship between pre-SCR NOx levels and fuel heat content/Wobbe index can be established. This relationship is shown in Figures 4-5 and 4-6 (NOx levels not corrected to 15% O<sub>2</sub>).

**Figure 4-5: Sutter CT2 Pre-SCR NO<sub>x</sub> Levels versus Natural Gas Heat Content**

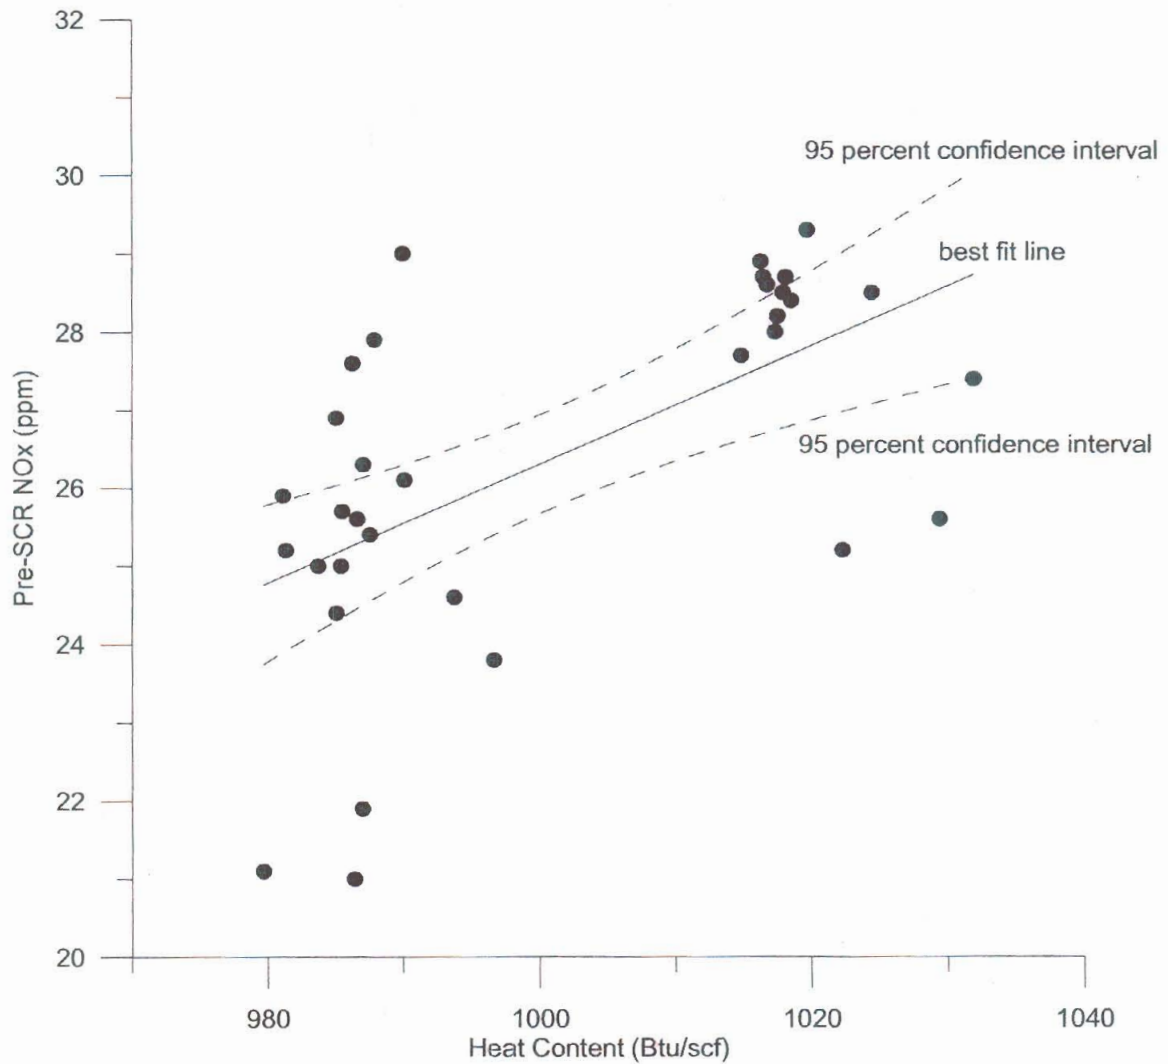

**Figure 4-6: Sutter CT2 Pre-SCR NOx Levels versus Wobbe Index**

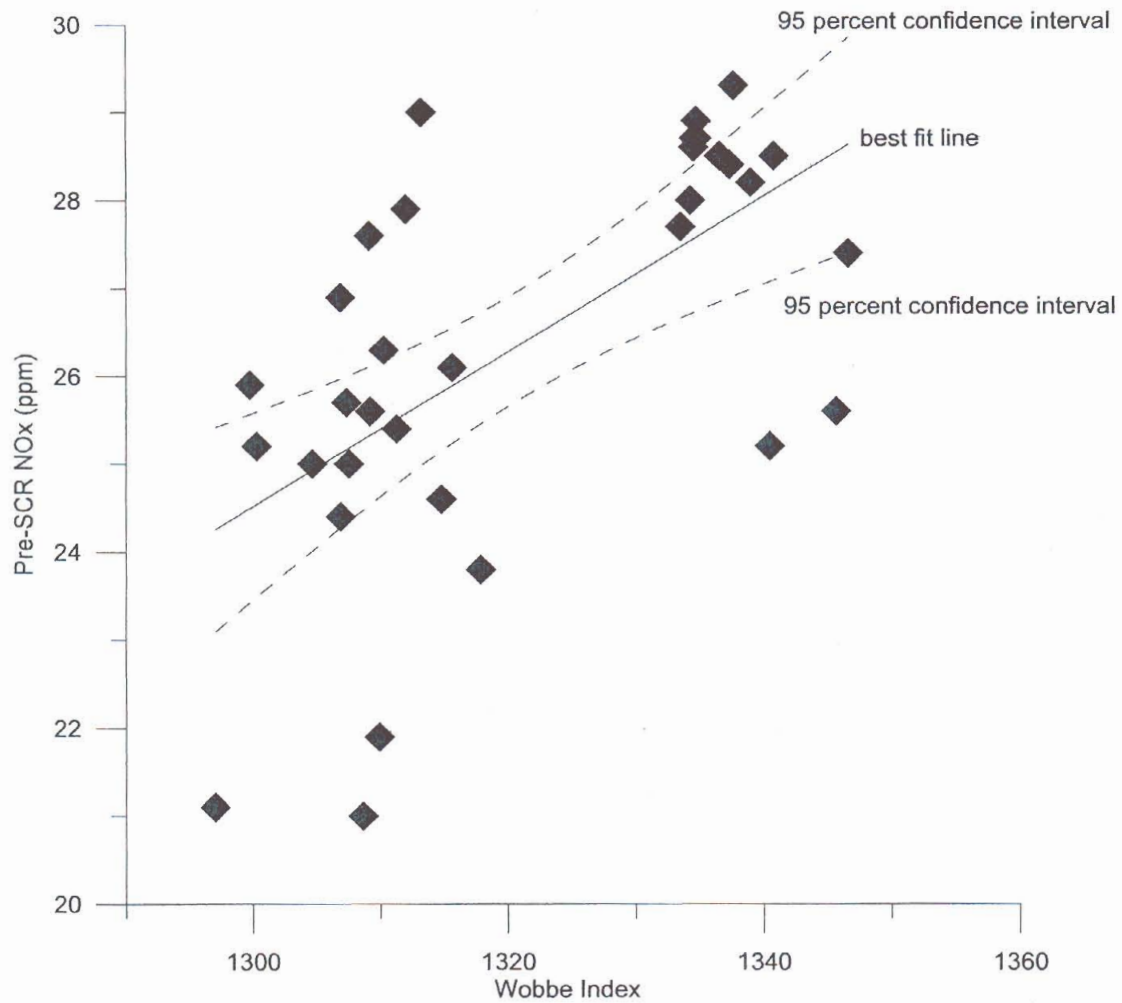


Figure 4-6 predicts that, for the range of Wobbe index observed, the pre-SCR NOx emissions will increase approximately 15 percent for a Wobbe index increase of 3.5 percent at high turbine loads (1700 to 1800 MMBtu/hr). Figure 4-6 also presents a linear regression best fit line and 95 percent confidence interval for that fit.

A similar relationship between ammonia injection and natural gas heat content/Wobbe index is shown in Figures 4-7 and 4-8.

**Figure 4-7: Sutter Turbines Ammonia Use versus Natural Gas Heat Content**

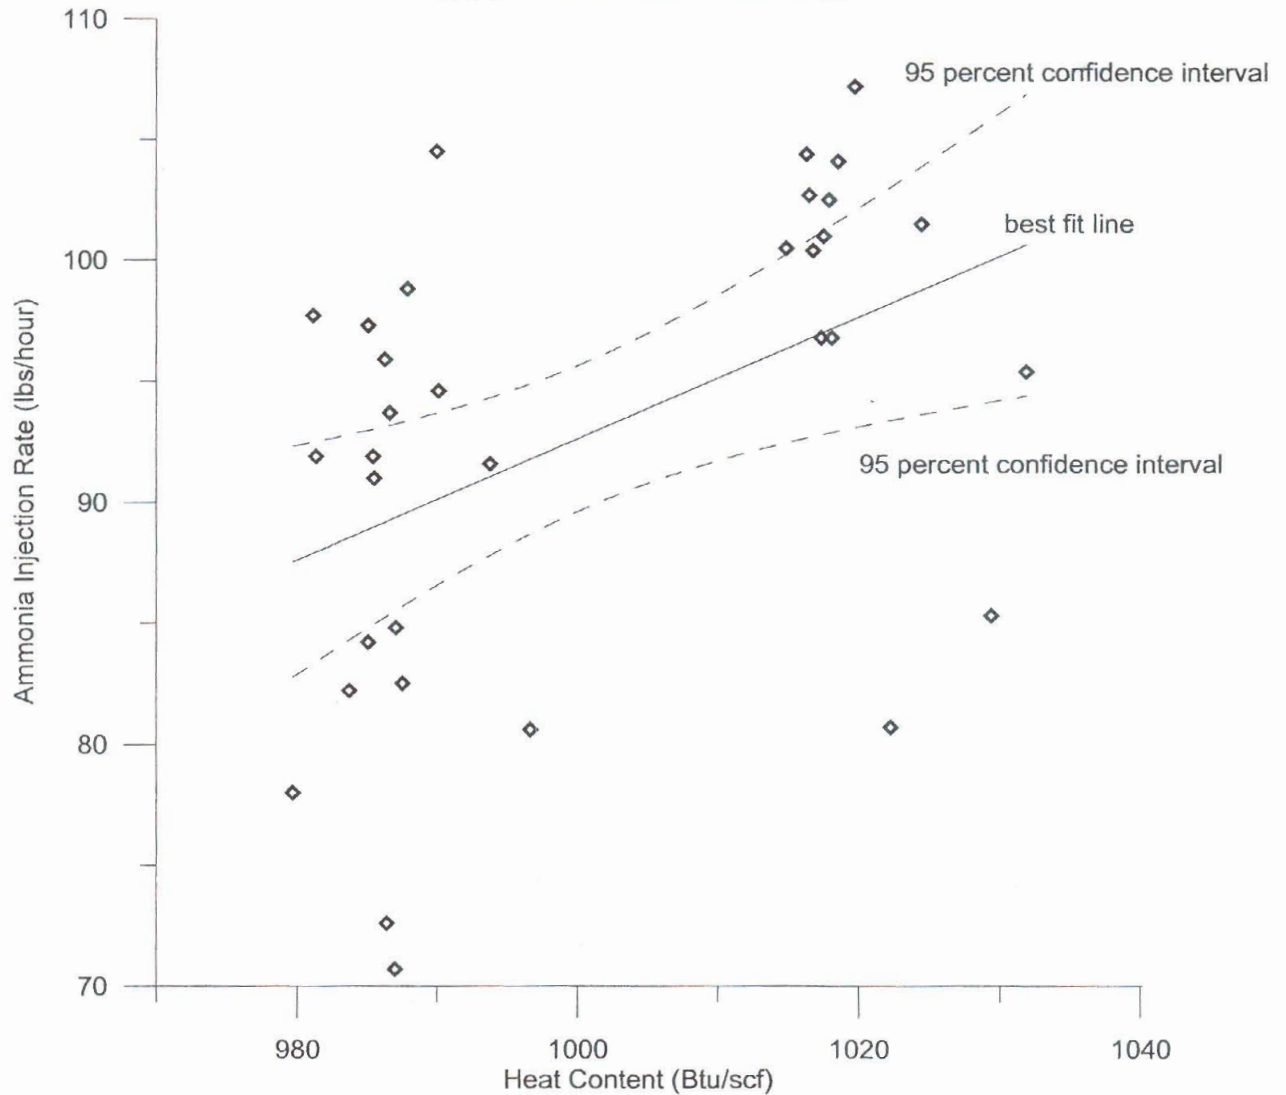


Figure 4-7 predicts that, for the range of natural gas heat contents observed, the ammonia consumption will increase approximately 10 percent for a heat content increase of 5 percent. Figure 4-7 also presents a linear regression best fit line and a 95 percent confidence interval for that fit.

**Figure 4-8: Sutter Turbines Ammonia Use versus Wobbe Index**


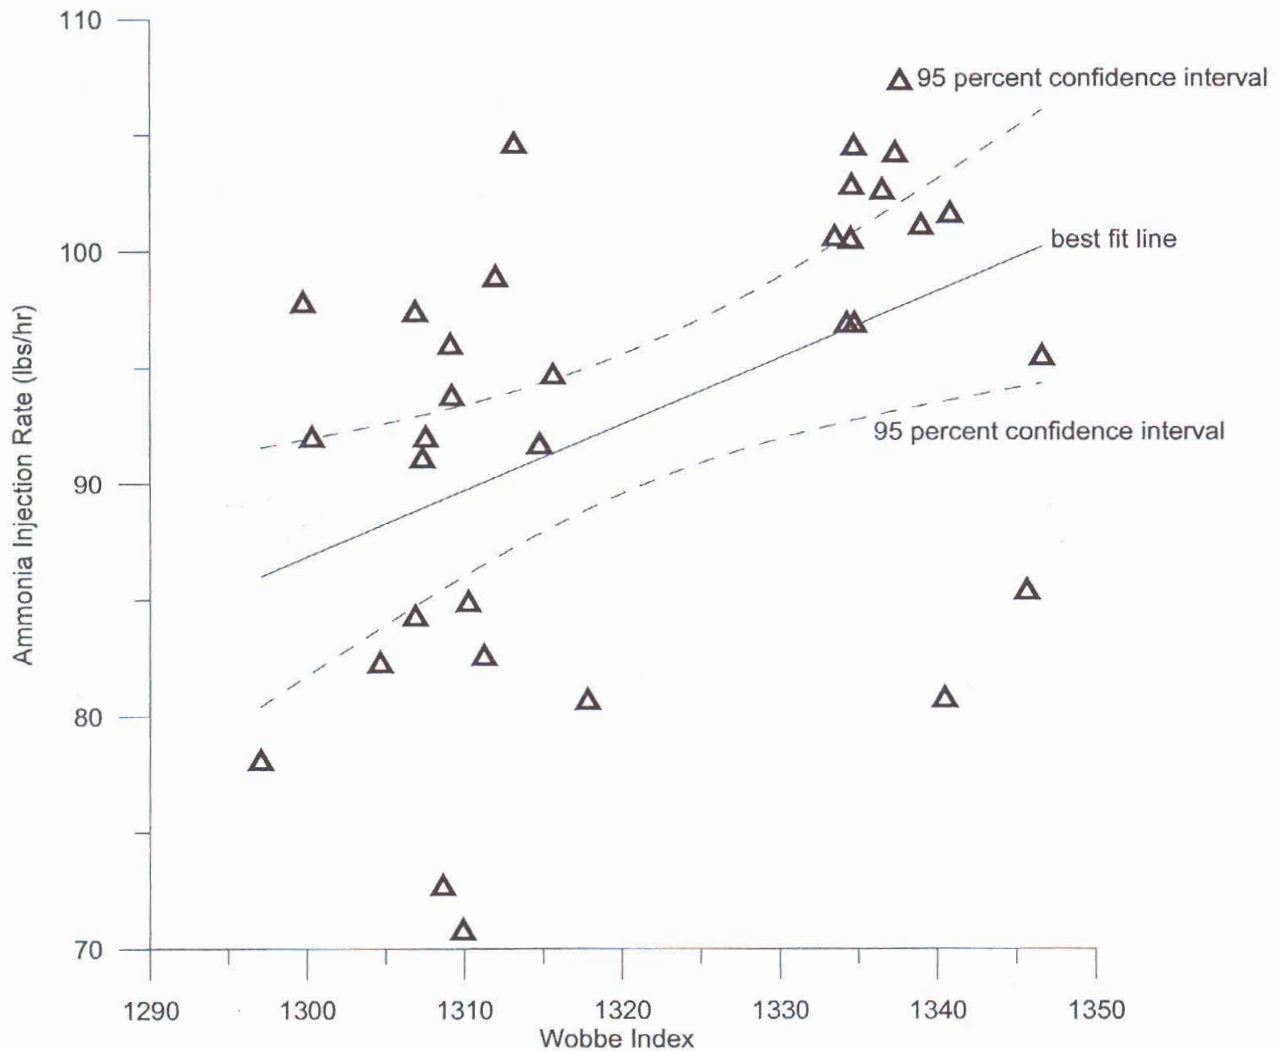



Figure 4-8 predicts that, for the range of natural gas heat contents observed, the ammonia consumption will increase approximately 10 percent for a 3.5 percent increase in Wobbe index. Figure 4-8 also presents a linear regression best fit line and a 95 percent confidence interval for that fit.

Figures 4-9 and 4-10 show that the controlled NO<sub>x</sub> emissions (@15% O<sub>2</sub>) do not appear to be affected by the increase in fuel heat content/Wobbe index. With the exception of one value for Turbine 1, the SCR system controlled the NO<sub>x</sub> emissions to 2.2 to 2.3 parts per million (referenced to 15 percent O<sub>2</sub>).

**Figure 4-9: Sutter Turbines Controlled NOx Concentration versus Natural Gas Heat Content**

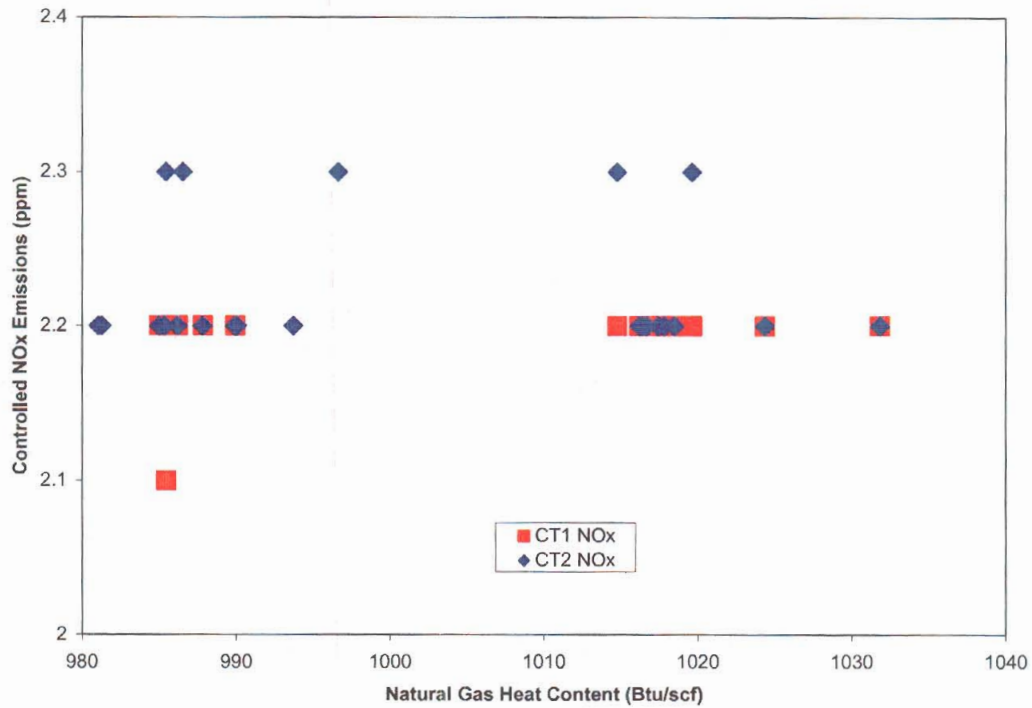

**Figure 4-10: Sutter Turbines Controlled NOx Concentration versus Wobbe Index**

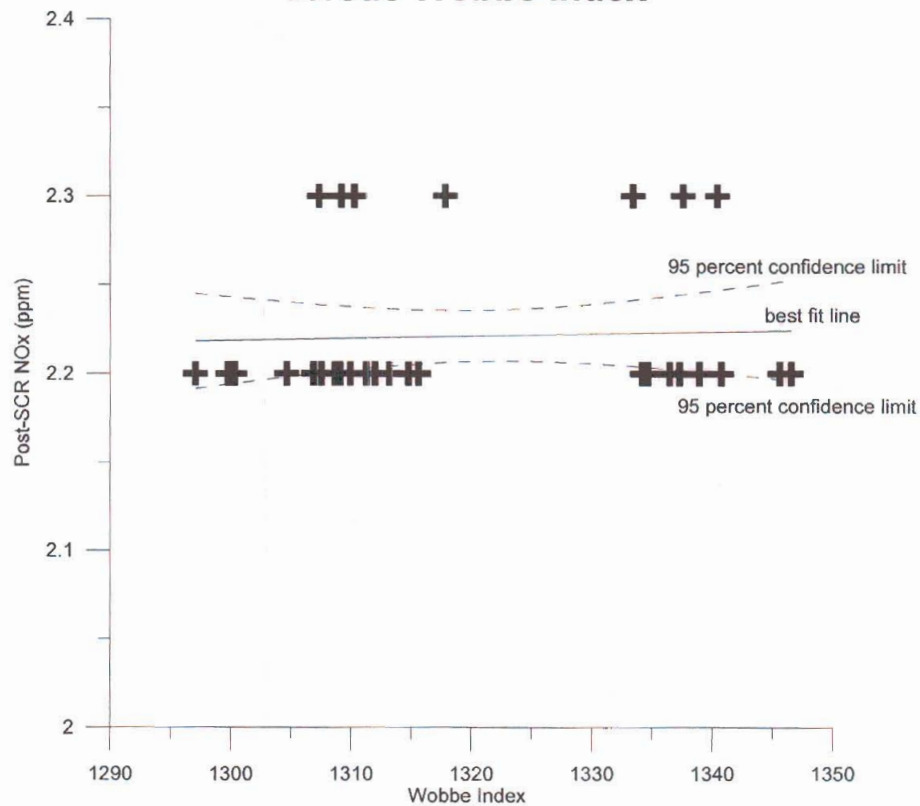

In conclusion, the increase in natural gas heat content/Wobbe index does not significantly affect the controlled NO<sub>x</sub> concentrations at the Sutter facility but does seem to cause a small increase in pre-SCR NO<sub>x</sub> emissions and a corresponding increase in the NO<sub>x</sub> control system's ammonia consumption.

## Los Medanos

The data obtained for LMEC did not include pre-SCR NO<sub>x</sub> emissions, so it will be more difficult to determine observable effects of the natural gas heat content excursion. This is exacerbated by the extreme load fluctuations that occurred during the period of the excursion event, and the fact that the natural gas fuel data provided for LMEC do not overlap well enough with the periods before and after the excursion event to be able to show the effects of increases in heat content/Wobbe index. Figures 4-11 through 4-13 show ammonia injection rate data and relationships and Figure 4-14 provides NO<sub>x</sub> emission concentrations during the period for both turbines. The corresponding as-fired natural gas heat content data are also shown on Figures 4-11 and 4-14. The turbine operating data shown are for normal operations excluding startup hours.

**Figure 4-11: LMEC Gas Turbines Ammonia Injection Rates**

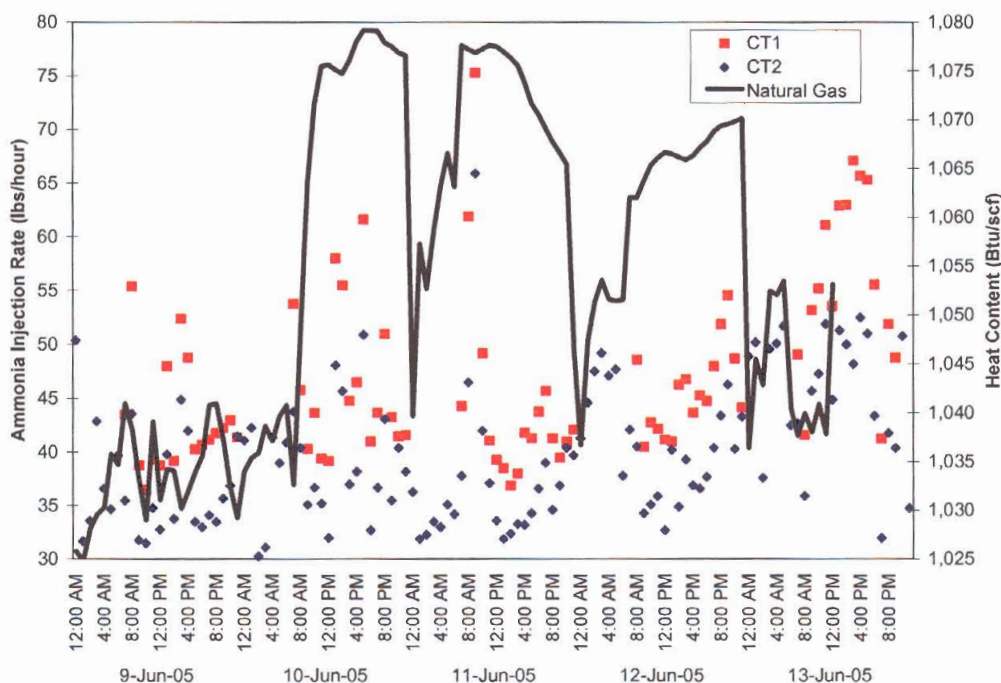


Figure 4-11 shows a potential minor increase in ammonia flow versus increased natural gas heat content. This relationship has been further compared in Figure 4-12 which plots ammonia injection rates per unit heat rate versus the natural gas heat content.

**Figure 4-12: LMEC Turbine Heat Load Adjusted Ammonia Injection Rate versus Fuel Heat Content**

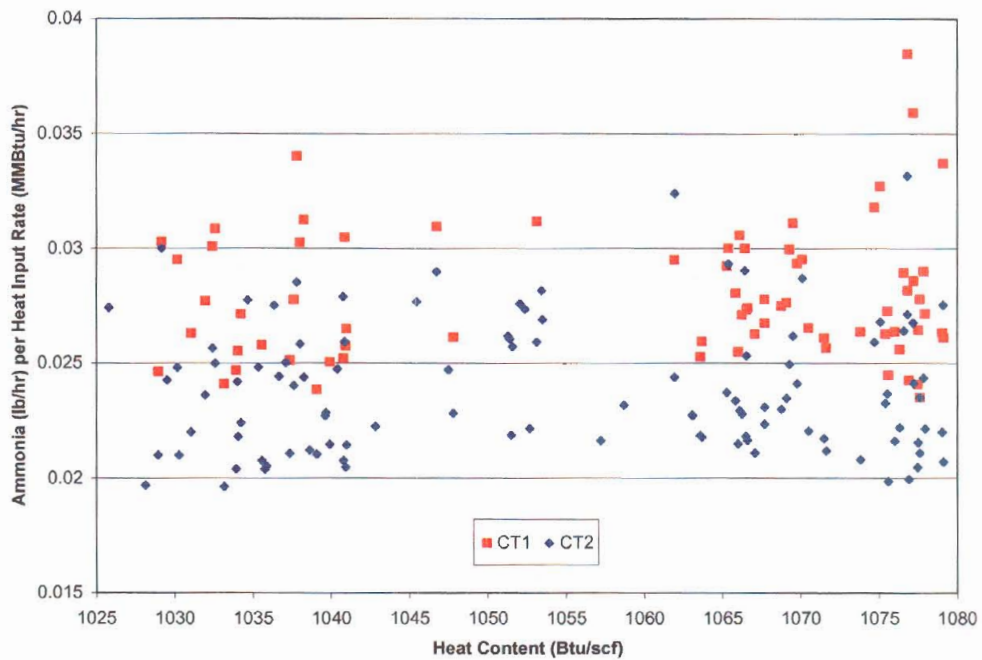


Figure 4-12 shows that there may be a small increase in the ammonia injection rate as the heat content of the natural gas increases. However, due to the operational variability, specific statistical relationships cannot be reliably determined.

In general, as shown in Figure 4-13 below, the ammonia injection rate increases with increased heat input rates. However, this relationship is much stronger for turbine heat input rates above 1700 MMBtu/hr.

**Figure 4-13: LMEC Gas Turbines Ammonia Injection Rates versus Heat Input**


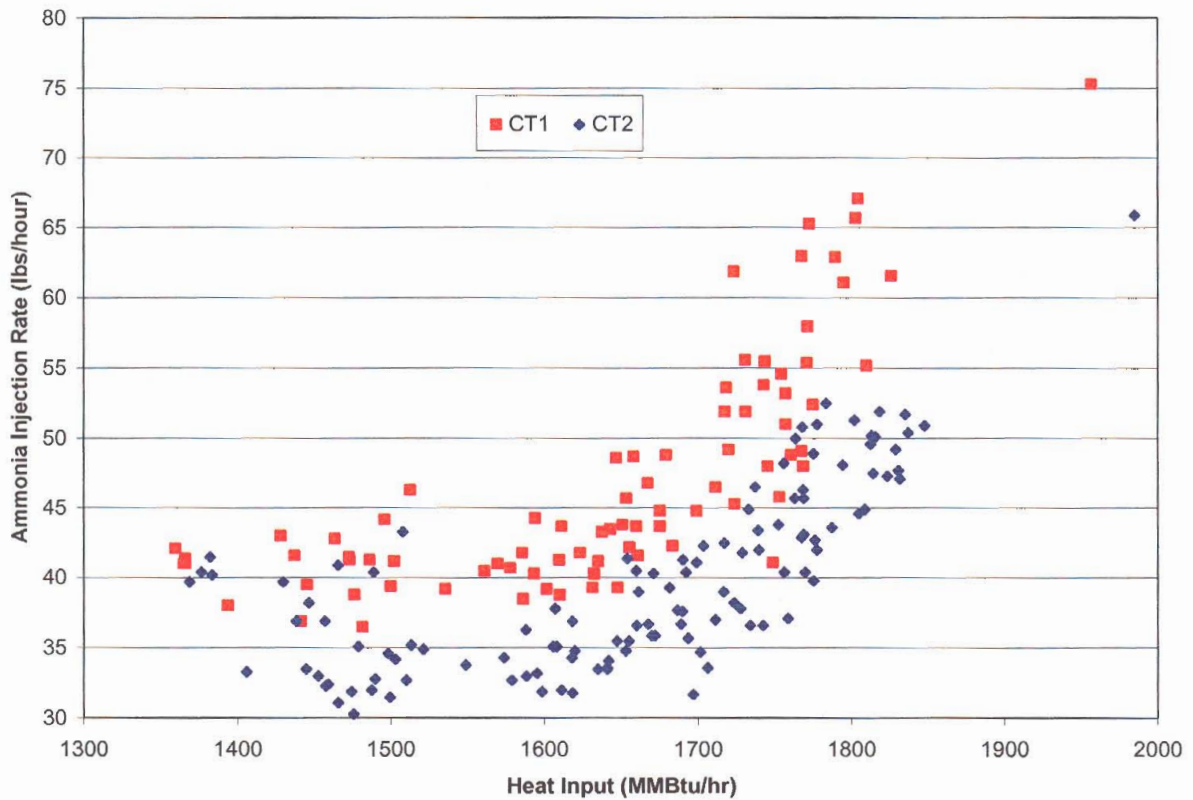


Figure 4-14, below (NO<sub>x</sub> shown @15% O<sub>2</sub>), shows that the NO<sub>x</sub> control system was able to compensate for probable increases in pre-SCR NO<sub>x</sub> due to the higher natural gas heat content. However, it also shows that the Turbine 2 system was slow in compensating for the three rapid decreases in heat content when Delta blended gas was fired and this caused unusually low NO<sub>x</sub> concentrations coincident with the rapid drop in natural gas heat content.

In summary, the increased heat content caused a small increase in the ammonia injection rate for the LMEC gas turbine NO<sub>x</sub> control systems, and this increase allowed controlled NO<sub>x</sub> levels to be maintained.

**Figure 4-14: LMEC Turbines Controlled NOx Emissions and Natural Gas Heat Content**

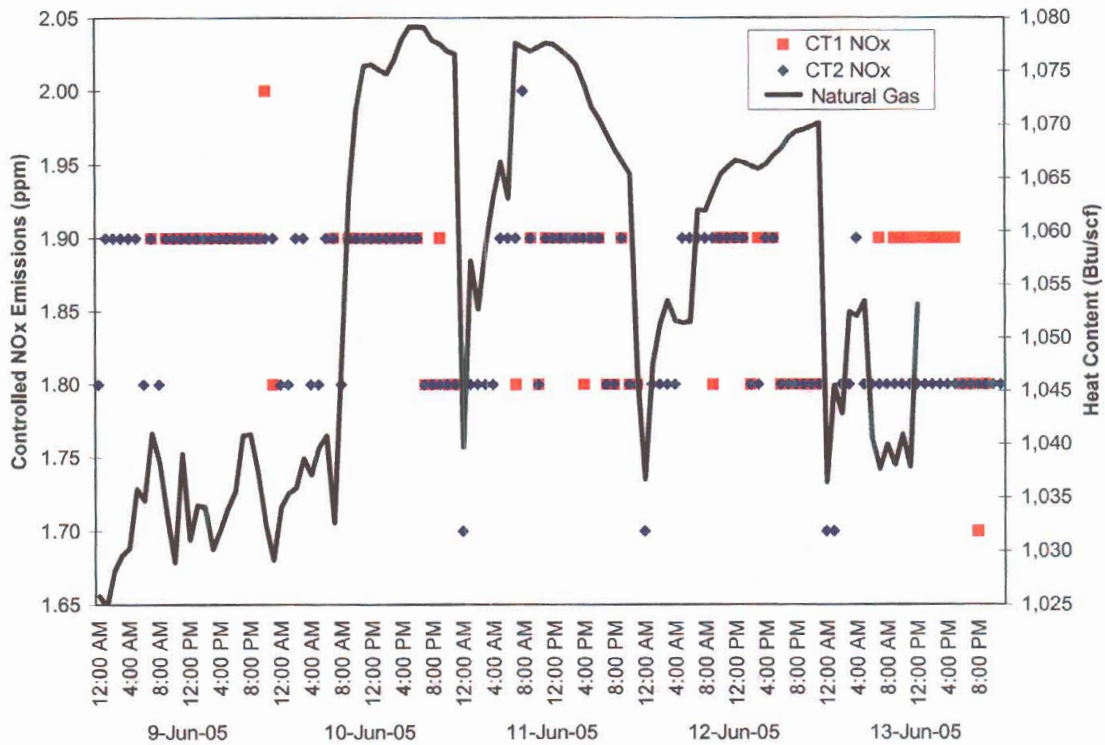


## Delta

Due to an equipment problem, the data obtained for Delta did not include as-fired natural gas heat content data. Delta uses a blended natural gas fuel, so the heat content cannot be readily predicted and therefore, the effects of the heat content excursion cannot be readily determined. Additionally, similar to LMEC, any effects on the Delta gas turbines would have been difficult to determine due to the extreme load fluctuations that occurred during the period of the excursion event, and the fact that pre-SCR NOx concentrations are not available. However, it can be reasonably assumed that the effects on the Delta gas turbines would have been minimized by the blended fuel source.


For information purposes, the ammonia injection rate over the period of the excursion event, the ammonia injection rate versus input heat rate data, and the NOx emission concentrations during the period for all three turbines are provided in Figures 4-15 through 4-17, respectively. The corresponding PG&E pipeline natural gas Wobbe index data are also shown on Figures 4-15 and 4-17 to provide an indicator when the blended fuel source would likely have experienced increases in heat content/Wobbe index. The turbine operating data shown are for normal operations excluding startup hours.

**Figure 4-15: Delta Gas Turbines Ammonia Consumption**

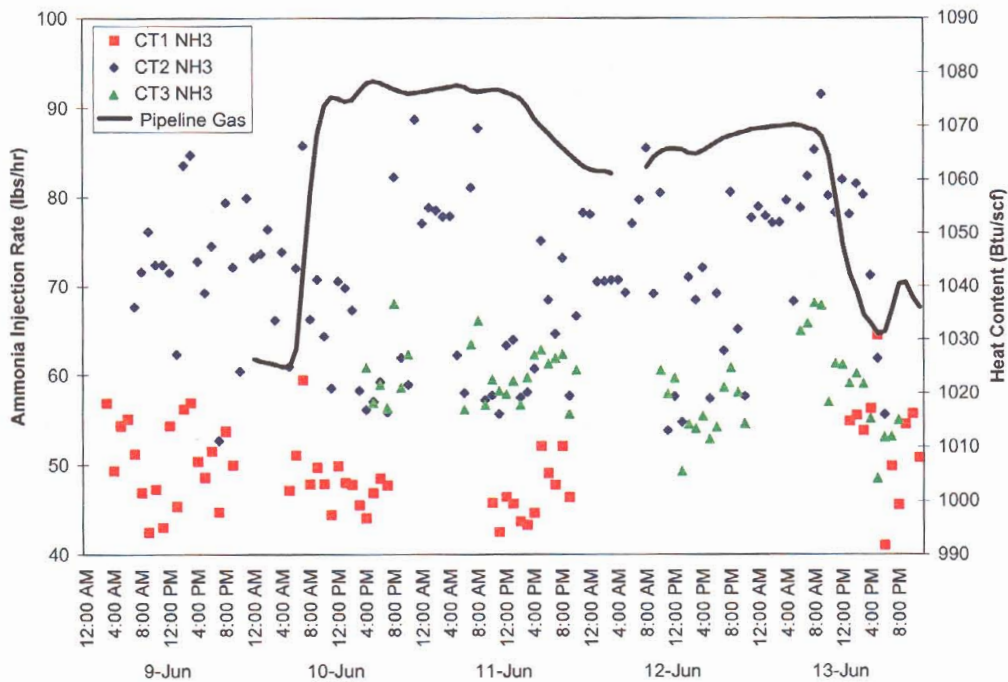

No significant pattern of increased ammonia injection rates can be reliably determined for the Delta turbines with the exception of ammonia injection versus heat input rate as shown in Figure 4-16. Figure 4-16 shows that, as expected, ammonia inject rates increase with increased turbine heat input load.


**Figure 4-16: Delta Gas Turbines Ammonia Injection Rates versus Heat Input Rate**

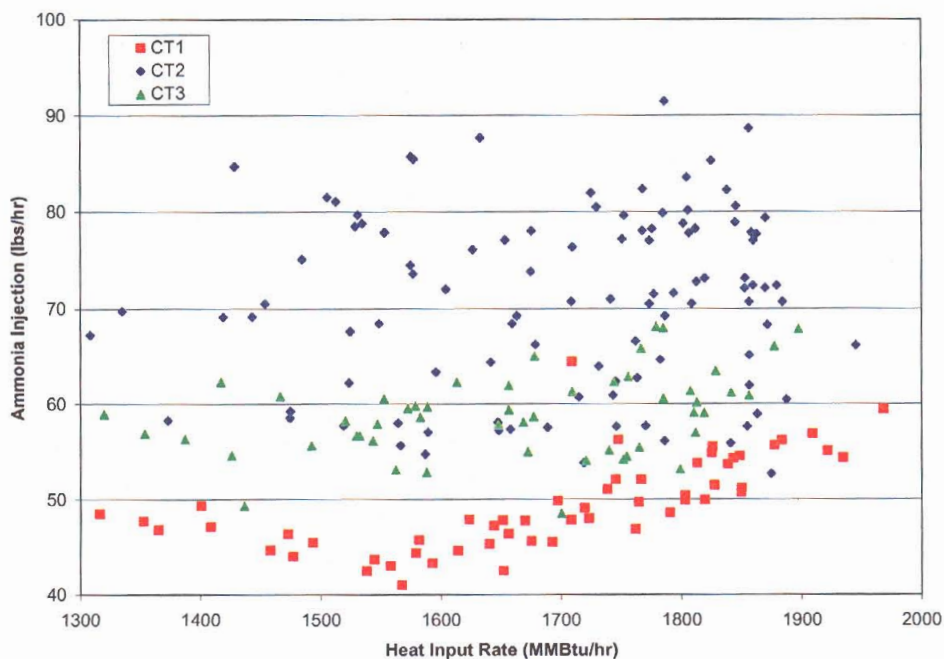

Figures 4-15 and 4-16 both show that the three Delta turbines have extremely different ammonia injection rates with Turbine 2 having rates that are on average more than 50 percent higher than Turbine 1, while Turbine 3 level ammonia injection rates fall between these two other turbines.

As can be seen in Figure 4-17, the NO<sub>x</sub> emissions (@15% O<sub>2</sub>) are very consistent during the excursion period and it appears that the NO<sub>x</sub> control system adjusted as necessary to compensate for any effects of the increased heat content/Wobbe index of the natural gas fuel.

**Figure 4-17: Delta Gas Turbines NO<sub>x</sub> Emissions**

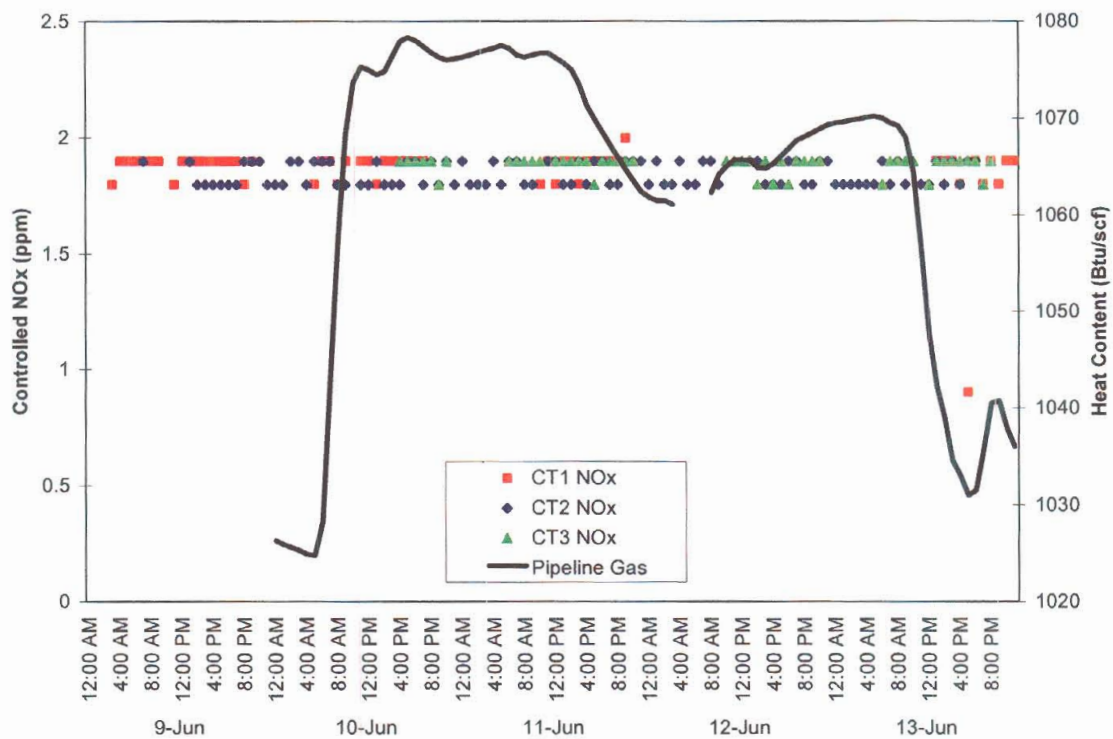


In summary, no pattern of any discernable effect of the natural gas excursion on the Delta gas turbines was discovered; however, that may be due to the amount and type of data that were available for the excursion event period.

## CHAPTER 5: OTHER VARIABLE HEAT CONTENT EFFECTS DATA


The Midway Sunset facility has provided data (not related to the above excursion event) showing the effects of a decrease in natural gas heat content on carbon monoxide emissions from GE 7001E Frame turbines.<sup>9</sup> The local fuel source for the Midway Sunset facility, the Elk Hills Naval Reserve, is normally a relatively high heat content natural gas (~1100 Btu/scf). The collected data are provided in Appendix A. Figures 5-1 and 5-2 show the carbon monoxide (CO) emissions for the Midway Sunset turbine as a function of natural gas heat content and Wobbe index, respectively, before and after an expensive burner modification to allow greater fuel input flexibility. These figures also provide data for a second gas turbine that underwent additional modifications after the initial burner modification to correct the CO response issue. These turbines do not have oxidation catalysts to control the exhaust CO emissions.

For this cogeneration facility, the CO emissions concentration limit was permitted at 25 ppm. It should be noted that current permitted carbon monoxide emission limits for natural gas fired 7E turbines in the Central Valley would be expected to be around 2 to 6 ppm, and that at this regulatory level CO catalysts are generally not needed to ensure compliance during normal operations.

**Figure 5-1: Midway Sunset CO Emissions versus Fuel Heat Content**

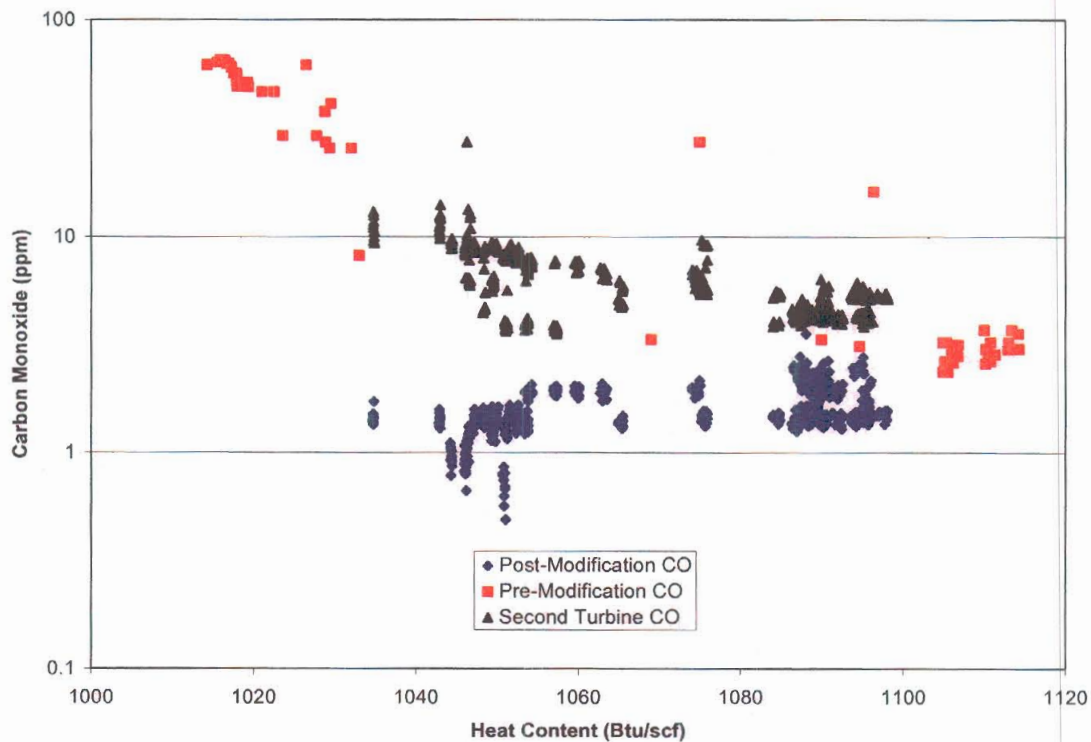

**Figure 5-1: Midway Sunset CO Emissions versus Wobbe Index**

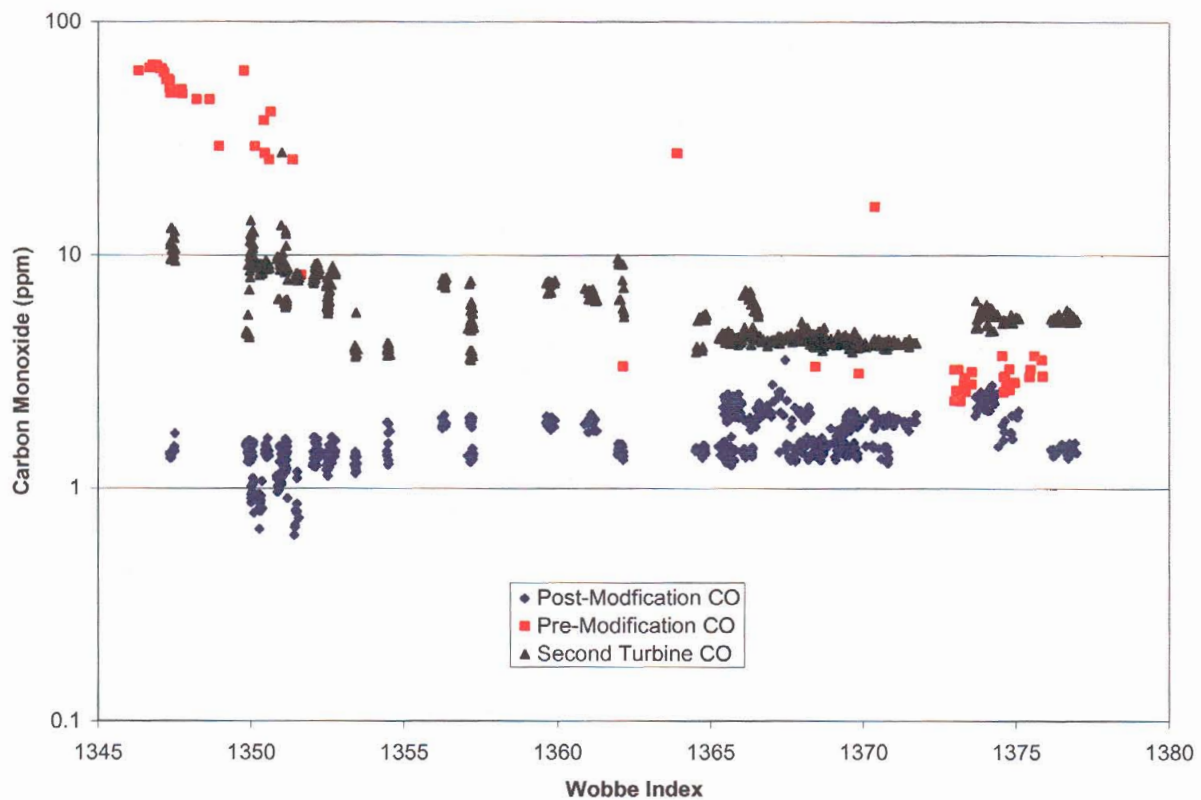

The pre-modification emissions/heat content data are from May 24, 2001, and the post-modification and second turbine emissions/heat content data are from May 9, 2005.

The carbon monoxide emissions prior to the burner modification dramatically increased as fuel heat content decreased, and the second turbine shows a similar though less dramatic response with reduced fuel heat content. The dramatic response is attributed to the specific Dry Lo-NO<sub>x</sub> (DLN) burner. The Unit A turbine originally had 15 ppm NO<sub>x</sub> combustor liners, and the unit operated at 10 to 12 ppm NO<sub>x</sub> and 0 to 1.5 ppm CO with little effect with fuel Btu changes. The Midway-Sunset operator suggests, based on his experience, that combustor liners with lower NO<sub>x</sub> guarantees (that is, 9 ppm liners) have a higher sensitivity to fuel variation. The problems with significant CO emission response with Btu changes occurred after replacing the 15 ppm NO<sub>x</sub> combustor liner with a 9 ppm NO<sub>x</sub> model. It was the 9 ppm NO<sub>x</sub> combustor liner that required the additional combustor modifications to reduce CO levels to levels that complied with their permit conditions. After Midway Sunset completed the costly additional combustor modifications, the 9 ppm NO<sub>x</sub> combustor liner is now able to adjust more effectively and maintain proper combustion when the fuel heat content decreases from the normally high levels.

While the CO emissions were significantly affected due to the reduction in fuel heat content, there was a negligible effect on the Midway Sunset controlled NO<sub>x</sub> emissions. However, the Midway Sunset operator noted that, while counterintuitive due to the complexities in burner design and operation, it is possible that the NO<sub>x</sub> emissions could actually increase in certain cases when fuel heat content is reduced.

Figures 5-1 and 5-2 show that burners designed to allow a greater range in fuel composition can ensure low emissions over a wide range of natural gas fuel compositions. In fact, the post-modification burner, excepting for a few outlier data points, now results in lower carbon monoxide emissions than the pre-modified burner under all fuel heat content conditions within the range of the natural gas data provided. However, additional hot gas path component modifications, as experienced by the second turbine, can cause the CO emission reductions gained by these burner emissions modifications to be partially negated.

# CHAPTER 6: OTHER STUDY FINDINGS/OTHER CONSIDERATIONS

## Other Study Findings

Other studies performed by Southern California Gas Company (SoCalGas) and the South Coast Air Quality Management District (SCAQMD), among others, have looked at the effects of increasing natural gas heat content. The principal focus of all of these studies was to determine the effect of increased heat content on NOx emissions. A short summary of the findings of these other studies is provided in Table 6-1.

**Table 6-1: Other Natural Gas Heat Content Study Finding Summary**

Study Source	Equipment	Summary of Findings
SCAQMD	Microturbine	NOx increases with heat content increase (20 percent increase when Btu increases from 1020 to 1140 Btu/scf)
SCAQMD	Commercial Boiler	NOx increases with heat content increase (Max increase 17 percent)
SRI	Lean Burn Engine	Significant NOx increase with heat content increase (more than doubled for engine without air-to-fuel ratio controller, and 35 percent increase with controller)
SoCalGas	Residential furnaces	Little or no increase in NOx concentration with increased heat content
SoCalGas	Residential water heaters	Little or no increase in NOx concentration with increased heat content
SoCalGas	Natural Draft Burners	Little or no increase in NOx concentration with increased heat content
SoCalGas	Charbroiler	NOx increases with heat content increase (Max increase 41 percent)
SoCalGas	Deep Fat Fryer	NOx increases with heat content increase (Max increase 38 percent)
SoCalGas	Instant Water Heater	NOx increases with heat content increase (Max increase 15 percent)
SoCalGas	Pool Heater	NOx increases with heat content increase (Max increase 61 percent)
SoCalGas	Condensing Hot Water Boiler	NOx increases with heat content increase (Max increase 143 percent)
SoCalGas	Lo-NOx Hot Water Boiler	NOx increases with heat content increase (Max increase 169 percent)
SoCalGas	Lo-NOx Steam Boiler	NOx increases with heat content increase (Max increase 134 percent)
SoCalGas	Ultra Lo-NOx Steam Boiler	NOx increases with heat content increase (Max increase 50 percent)

Source: SCAQMD<sup>10</sup>

SCAQMD – South Coast Air Quality Management District

SRI – Southern Research Institute

The increased NOx values observed in many of these other tests were higher than observed at the large gas turbines in this study; however, the range of natural gas heat content in the other studies was also greater. A general conclusion that can be made from these other studies is that smaller external combustion burners that do not have high flame or combustion zone temperatures are less affected by heat content or Wobbe index than those burners that do have higher flame or combustion zone temperatures. Also, it can be generally concluded, using the former tests and the information from this report, that turbine type internal combustion engines are less affected by heat content/Wobbe index than piston type internal combustion engines. Considering the time and temperature requirements for the formation of thermal NOx, this finding is not surprising, but it is interesting that significant increases in NOx formation were found for some small external fired sources (pool heaters, charbroilers, and deep fat fryers, see Table 6-1).

It is important to note that these other studies are based on controlled tests. It is unlikely that there would be a cost effective way to perform such controlled tests with actual real-world operating power turbines and other large gas-fired power production facilities, since the amount of fuel necessary to perform such an experiment would be problematic to handle and transport, and it would be difficult for power plant operators to control operations to meet the objectives of such a controlled test.

## **CHAPTER 7: DATA LIMITATIONS**

The analyses and conclusions presented in this report are limited by the available data and the context under which the data were gathered. This study is not purported to be a controlled experiment, nor is it meant to provide conclusive findings on the impacts of natural gas heat content on all large gas turbines for natural gas quality policy or regulatory determinations. Rather, this study is meant to provide initial data and findings regarding the effects of a single natural gas Btu content excursion event.

Since this was not a controlled experiment, both the gas Btu content and turbine operations were variable during the June 10 through June 13 excursion period. Additionally, not all desired data were available from all of the facilities included in this study. In the case of the Delta Energy Center, the heat content of the fuel used was not available so the operational/emissions data could not be meaningfully processed. In other cases, such as Sutter and Los Medanos, only short periods representing a few hours over the three-day period were considered to be useful or comparable for the determination of the effects of the heat content excursion. Therefore, the quality of the data are somewhat compromised based on the short-term nature of the event and the operational variability encountered at the facilities providing data.

No direct emission comparison can be made between separate facility gas turbines, both within the same facility or in another facility. The turbine and emission control technologies designs, including the combustor liner designs, are not all consistent between the facilities included in this study, the operations of each facility are variable from one another, and each gas turbine unit in each facility undergoes physically separate tuning events at different intervals. Therefore, the specific effects of the heat content excursion are analyzed separately for each turbine. However, observations of the general trends between comparable turbines have been provided.

## **CHAPTER 8: CONCLUSIONS**

The gas turbine data collected indicate that the 2 percent to 5 percent increase in natural gas heat content observed at the facilities studied during the excursion event caused a minor increase in pre-SCONox/SCR NOx emissions and ammonia consumption rates for facilities with SCR NOx controls. However, the controlled NOx emissions did not show such a trend, so it appears that the NOx controls (both SCR and SCONox) were able to compensate under the range of natural gas compositions encountered during the excursion event.

The amount of data, number of facilities, types of facilities, and emission controls covered by this study were extremely limited and only represent a small fraction of the total natural gas power production facilities within California. Currently, the majority of natural gas-fired power plant emissions in California come from cogeneration and boiler facilities. Therefore, it is recommended that data from additional facilities (boilers, simple cycle turbines, cogeneration facilities, etc.) be gathered to determine if the effects observed during this study are representative of the facility types included in the study, if similar effects would occur for other technologies and emission controls, and if these effects could cause cumulatively significant impacts in exhaust emission levels.

It is recommended that natural gas data collected have sufficient information (specific gravity or full composition data) to enable the calculation of the Wobbe index. It is desirable to establish relationships between fuel Wobbe index and emissions and other operation variables in order to help guide future natural gas policy decisions.

It is also recommended that effects on fuel efficiency and greenhouse gas emissions from higher heat content natural gases also be included as future study objectives.

# BIBLIOGRAPHY

- <sup>1</sup> Pacific Gas and Electric Company, Pipe Ranger, [http://www.pge.com/pipeline/news/20050608\\_620\\_news.shtml](http://www.pge.com/pipeline/news/20050608_620_news.shtml), News Article, June 8, 2005.
- <sup>2</sup> City of Redding, Redding Power, Natural Gas Heat Content (6/8 to 6/13) Unit #5 Performance Data (June 9 to June 15). Provided by Russ Bennett. June 2005.
- <sup>3</sup> Calpine Corporation. Natural Gas Composition Data and Sutter Facility Gas Turbine Performance Data (June 9 to June 14). Provided by Diane Tullos. June and August 2005.
- <sup>4</sup> Calpine Corporation. Natural Gas Composition Data and LMEC Facility Gas Turbine Performance Data (various dates from June 6 to June 13). Provided by David Zeiger. June 2005.
- <sup>5</sup> Calpine Corporation. Natural Gas Composition Data and Delta Facility Gas Turbine Performance Data (various dates from June 6 to June 13). Provided by David Zeiger. June 2005.
- <sup>6</sup> Pacific Gas & Electric Company. Rule No. 21 – Transportation of Natural Gas, last revised April 2005.
- <sup>7</sup> Southern California Gas Company. Rule No. 30 – Transportation of Customer-Owned Gas. Last revised March 30, 2003.
- <sup>8</sup> United States Environmental Protection Agency. Standards of Performance for Stationary Gas Turbines. 40 CFR Part 60 Subpart GG Section 60.331(u). Amended July 8, 2004.
- <sup>9</sup> Midway Sunset Cogeneration Company. Natural Gas Heat Content, Gas Turbine Carbon Monoxide Emissions Data and Additional Facility Description Information. Provided by Greg Jans. June, August, and September 2005.
- <sup>10</sup> South Coast Air Quality Management District. Natural Gas Quality and Air Quality. Presented by Chung S. Liu, Deputy Executive Director, at the California Public Utilities Commission/California Energy Commission Workshop on Natural Gas Quality. February 2005.

## Appendix A - Data Notes

### General Notes

1. The raw data shown are as provided in the Energy Commission. The only manipulation was conversion into spreadsheet format and hourly averages when other time frames were provided.
2. Calculated values, such as fuel Webbs index, are shown in red.
3. Data not provided or missing are left blank, while data provided as "NA" or in other similar formats, were left in those formats.

### Sutter Turbine Data Notes

1. Sutter has two turbines
2. Sutter steam augmentation data was provided; however, no steam augmentation was performed for either turbine during the data period so those data are not presented.
3. Sutter duct firing data is only provided for CT1. CT2 had no duct firing during the period.

### Sutter Fuel Data Notes

1. Sutter uses a mixed fuel source: the PG&E pipeline gas and Calpine-owned gas fuel has low Btu content.

### Redding Data Notes

1. Redding uses fuel directly from the PG&E pipeline.
2. The data provided for Redding spans on June 6th for the natural gas data, and June 9th for the turbine operation data.
3. The Redding fuel heat content data were converted into an hourly average value.

### Los Medanos Data Notes

1. Los Medanos has two turbines
2. Los Medanos can use a mixed fuel source: the PG&E pipeline gas and Calpine-owned gas that is mined at the Delta facility.
3. The data provided for Los Medanos start half way through June 6th for the natural gas data, and June 9th for the turbine operation data.
4. The Los Medanos turbine IMV, turbine exhaust temperature, and turbine heat rate data were converted into an hourly average values.

### Delta Data Notes

1. Delta has three turbines
2. Delta uses a mixed fuel source; however, the data for the as-used fuel were not available during the surge event.
3. The Delta CT2 turbine IMV, turbine exhaust temperature, and turbine heat rate data were converted into an hourly average values. Similar data for CT1 and CT3 were not provided.

### Delta PG&E Natural Gas Data Notes

1. These data are for the pipeline natural gas and do not correspond to the Delta turbine fuel.

### Midway Sunset Data Notes

1. The data presented are for two different time periods, and the second time period has data from two turbines. These data are not for the PG&E pipeline event covered by the other data.
2. The Webbs index values are calculated
3. Unit A combustor was modified between the first and second period, as was the Unit X combustor; however, the Unit X combustor had additional modifications performed as well.

**Table A-1 Sutter Fuel Data**

		Turbine Fuel Data							Wobbe
Day	Hour	Heat Content Btu/scf	Specific Gravity	Composition Data (%)					
				Methane	Ethane	Butane	Propane	Nitrogen	
9-Jun-05	0:00:00	987	0.570	96.8	0.22	0	0.01	2.82	1307
	1:00:00	985	0.569	96.8	0.14	0.00	0.01	2.92	1307
	2:00:00	985	0.569	96.8	0.18	0.00	0.01	2.96	1306
	3:00:00	985	0.569	96.8	0.15	0.00	0.01	2.98	1306
	4:00:00	983	0.569	96.6	0.15	0.00	0.01	3.13	1303
	5:00:00	979	0.571	96.2	0.18	0.00	0.01	3.54	1296
	6:00:00	983	0.569	96.6	0.16	0.00	0.01	3.12	1303
	7:00:00	986	0.569	96.8	0.20	0.00	0.01	2.86	1308
	8:00:00	980	0.571	96.3	0.16	0.00	0.01	3.48	1297
	9:00:00	985	0.568	96.9	0.13	0.00	0.00	2.89	1307
	10:00:00	987	0.568	97.0	0.16	0.00	0.00	2.71	1310
	11:00:00	987	0.568	97.0	0.18	0.00	0.00	2.77	1309
	12:00:00	986	0.568	96.9	0.15	0.00	0.01	2.84	1308
	13:00:00	986	0.568	96.9	0.16	0.00	0.00	2.82	1308
	14:00:00	986	0.568	96.9	0.18	0.00	0.01	2.82	1309
	15:00:00	987	0.568	97.0	0.16	0.00	0.01	2.74	1310
	16:00:00	992	0.566	97.5	0.15	0.00	0.01	2.28	1318
	17:00:00	989	0.567	97.2	0.15	0.00	0.01	2.60	1313
	18:00:00	990	0.567	97.3	0.17	0.00	0.01	2.47	1315
	19:00:00	993	0.566	97.5	0.20	0.00	0.00	2.19	1320
	20:00:00	992	0.566	97.5	0.17	0.00	0.01	2.24	1319
	21:00:00		0.567	97.3	0.16	0.00	0.01	2.42	
	22:00:00	989	0.568	97.0	0.24	0.00	0.02	2.66	1312
	23:00:00	995	0.572	96.5	0.66	0.02	0.12	2.52	1316
10-Jun-05	0:00:00	995	0.570	96.5	0.67	0.02	0.12	2.49	1318
	1:00:00	995	0.572	96.5	0.67	0.02	0.12	2.49	1316
	2:00:00	996	0.572	96.5	0.67	0.02	0.12	2.49	1316
	3:00:00	996	0.572	96.5	0.68	0.02	0.12	2.49	1316
	4:00:00	996	0.572	96.5	0.68	0.02	0.12	2.49	1316
	5:00:00	998	0.573	96.4	0.77	0.02	0.14	2.38	1318
	6:00:00	998	0.573	96.4	0.81	0.02	0.14	2.41	1318
	7:00:00	997	0.573	96.4	0.76	0.02		2.46	1317
	8:00:00	992	0.571	96.6	0.51	0.01	0.07	2.60	1313
	9:00:00	995	0.572	96.5	0.64	0.02	0.10	2.52	1315
	10:00:00	997	0.573	96.4	0.74	0.02	0.13	2.44	1317
	11:00:00	994	0.572	96.5	0.62	0.01	0.10	2.59	1314
	12:00:00	981	0.570	96.4	0.14	0.00	0.01	3.32	1299
	13:00:00	981	0.570	96.5	0.13	0.00	0.00	3.29	1300
	14:00:00	985	0.568	96.9	0.14	0.00	0.00	2.90	1307
	15:00:00	987	0.568	96.9	0.19	0.00	0.01	2.83	1309
	16:00:00	990	0.567	97.3	0.17	0.00	0.01	2.47	1315
	17:00:00	988	0.567	97.1	0.16	0.00	0.00	2.62	1312
	18:00:00	989	0.567	97.1	0.17	0.00	0.00	2.61	1312
	19:00:00	989	0.567	97.2	0.15	0.00	0.01	2.54	1314
	20:00:00	988	0.568	97.1	0.17	0.00	0.01	2.67	1311
	21:00:00	988	0.568	96.9	0.21	0.00	0.01	2.75	1310
	22:00:00	993	0.569	97.0	0.39	0.01	0.04	2.42	1317
	23:00:00	1017	0.583	95.1	1.89	0.06	0.50	2.03	1332

**Table A-1 Sutter Fuel Data**

		Turbine Fuel Data							
Day	Hour	Heat Content Btu/lb	Specific Gravity	Composition Data (%)					Wobbe
				Methane	Ethane	Butane	Propane	Nitrogen	
11-Jun-05	0:00:00	1019	0.580	94.9	2.02	0.06	0.54	2.00	1338
	1:00:00	1019	0.584	94.9	2.02	0.06	0.54	2.00	1333
	2:00:00	1019	0.584	94.9	2.03	0.06	0.54	2.00	1333
	3:00:00	1019	0.585	94.9	2.06	0.06	0.54	2.00	1333
	4:00:00	1020	0.585	94.9	2.06	0.06	0.55	1.99	1333
	5:00:00	1023	0.587	94.6	2.28	0.07	0.61	1.94	1335
	6:00:00	1033	0.593	93.7	2.90	0.09	0.80	1.84	1341
	7:00:00	1030	0.591	94.0	2.70	0.09	0.75	1.92	1339
	8:00:00	1026	0.590	94.1	2.54	0.08	0.70	2.04	1336
	9:00:00	1020	0.586	94.6	2.12	0.07	0.58	2.14	1332
	10:00:00	1018	0.585	94.8	2.01	0.06	0.55	2.18	1330
	11:00:00	1002	0.577	95.8	1.11	0.03	0.28	2.55	1319
	12:00:00	986	0.568	97.0	0.12	0.00	0.00	2.83	1308
	13:00:00	989	0.567	97.2	0.15	0.00	0.00	2.57	1313
	14:00:00	988	0.568	97.1	0.14	0.00	0.00	2.69	1311
	15:00:00	986	0.568	96.9	0.15	0.00	0.01	2.86	1308
	16:00:00	987	0.568	97.0	0.15	0.00	0.00	2.75	1310
	17:00:00	987	0.568	97.0	0.17	0.00	0.01	2.75	1310
	18:00:00	1010	0.580	95.3	1.54	0.05	0.41	2.22	1326
	19:00:00	1045	0.601	92.7	3.68	0.12	1.01	1.67	1348
	20:00:00	1040	0.597	93.3	3.29	0.11	0.89	1.66	1345
	21:00:00	1036	0.595	93.6	3.09	0.11	0.83	1.63	1343
	22:00:00	1045			3.62	0.13	0.98		
	23:00:00								
12-Jun-05	0:00:00	1017	0.590	94.3	2.13	0.07	0.57	2.43	1324
	1:00:00	994	0.582	94.7	1.21	0.04	0.31	3.48	1303
	2:00:00	997	0.583	94.5	1.36	0.04	0.36	3.36	1306
	3:00:00	996	0.583	94.6	1.31	0.04	0.34	3.42	1304
	4:00:00	995	0.583	94.6	1.25	0.04	0.33	3.47	1303
	5:00:00	994	0.582	94.6	1.22	0.04	0.32	3.50	1303
	6:00:00	994	0.582	94.6	1.21	0.04	0.32	3.51	1302
	7:00:00	994	0.582	94.6	1.20	0.04	0.31	3.51	1302
	8:00:00	994	0.582	94.6	1.22	0.04	0.32	3.50	1303
	9:00:00	994	0.582	94.6	1.21	0.04	0.32	3.51	1302
	10:00:00	994	0.582	94.6	1.20	0.04	0.32	3.52	1302
	11:00:00	994	0.582	94.6	1.20	0.04	0.32	3.52	1302
	12:00:00	994	0.582	94.6	1.19	0.04	0.31	3.51	1302
	13:00:00	994	0.582	94.6	1.20	0.04	0.31	3.51	1302
	14:00:00	994	0.582	94.6	1.20	0.04	0.31	3.51	1302
	15:00:00	994	0.582	94.6	1.21	0.04	0.31	3.51	1302
	16:00:00	994	0.582	94.6	1.20	0.04	0.31	3.51	1302
	17:00:00	994	0.582	94.7	1.19	0.04	0.31	3.51	1302
	18:00:00	994	0.582	94.7	1.19	0.04	0.31	3.51	1302
	19:00:00	994	0.582	94.7	1.19	0.04	0.31	3.51	1302
	20:00:00	994	0.582	94.7	1.19	0.04	0.31	3.51	1302
	21:00:00	994	0.582	94.6	1.19	0.04	0.31	3.51	1302
	22:00:00	994	0.582	94.6	1.20	0.04	0.31	3.51	1302
	23:00:00	994	0.582	94.6	1.20	0.04	0.31	3.51	1302

**Table A-1 Sutter Fuel Data**

		Turbine Fuel Data							Wobbe
Day	Hour	Heat Content Btu/scf	Specific Gravity	Composition Data (%)					
				Methane	Ethane	Butane	Propane	Nitrogen	
13-Jun-05	0:00:00	994	0.580	94.6	1.21	0.06	0.32	3.50	1305
	1:00:00	994	0.582	94.6	1.21	0.06	0.32	3.49	1303
	2:00:00	994	0.582	94.6	1.23	0.06	0.32	3.48	1303
	3:00:00	994	0.583	94.6	1.25	0.06	0.32	3.48	1303
	4:00:00	995	0.583	95.0	1.10	0.05	0.28	3.26	1303
	5:00:00	1000	0.580	96.0	0.97	0.04	0.24	2.49	1313
	6:00:00	1011	0.576	95.0	1.67	0.08	0.44	2.40	1332
	7:00:00	999	0.583	95.7	1.02	0.04	0.26	2.73	1308
	8:00:00	983	0.577	96.4	0.22	0.01	0.03	3.21	1294
	9:00:00	984	0.571	96.7	0.13	0.00	0.00	3.05	1302
	10:00:00	985	0.569	96.8	0.14	0.00	0.00	2.93	1306
	11:00:00	985	0.569	96.8	0.17	0.00	0.00	2.92	1307
	12:00:00	985	0.569	96.8	0.13	0.00	0.00	2.93	1306
	13:00:00	1015	0.569	95.6	1.63	0.08	0.36	1.84	1346
	14:00:00	1018	0.580	95.6	1.79	0.09	0.39	1.67	1337
	15:00:00	1020	0.581	95.4	1.85	0.10	0.43	1.70	1338
	16:00:00	1024	0.582	95.1	2.15	0.11	0.51	1.61	1343
	17:00:00	1032	0.585	94.6	2.57	0.13	0.62	1.40	1349
	18:00:00	1029	0.588	94.9	2.39	0.12	0.55	1.38	1342
	19:00:00	1022	0.586	95.4	1.99	0.10	0.44	1.55	1335
	20:00:00	1018	0.583	95.6	1.78	0.09	0.37	1.65	1334
	21:00:00	1022	0.581	95.8	1.84	0.10	0.38	1.39	1341
	22:00:00	1022	0.581	95.8	1.84	0.10	0.38	1.33	1341
	23:00:00	1022	0.580	95.9	1.83	0.10	0.37	1.33	1342
14-Jun-05	0:00:00	1022	0.580	95.9	1.83	0.10	0.38	1.31	1342
	1:00:00	1022	0.580	95.9	1.84	0.10	0.38	1.31	1342
	2:00:00	1022	0.580	95.9	1.84	0.10	0.38	1.31	1342
	3:00:00	1022	0.580	95.9	1.84	0.10	0.38	1.31	1342
	4:00:00	1022	0.580	95.9	1.83	0.10	0.38	1.32	1342
	5:00:00	1021	0.580	95.9	1.79	0.10	0.37	1.35	1341
	6:00:00	1015	0.580	96.0	1.53	0.08	0.31	1.63	1333
	7:00:00	1008	0.578	96.1	1.26	0.07	0.26	2.00	1326
	8:00:00	993	0.577	96.5	0.58	0.03	0.10	2.65	1308
	9:00:00	986	0.572	97.0	0.13	0.00	0.00	2.81	1304
	10:00:00	988	0.568	97.1	0.13	0.00	0.00	2.65	1311
	11:00:00	990	0.567	96.9	0.30	0.01	0.03	2.63	1314
	12:00:00	1017	0.569	96.0	1.61	0.08	0.32	1.48	1349
	13:00:00	1018	0.578	95.6	1.83	0.08	0.34	1.54	1338
	14:00:00	1016	0.581	95.7	1.74	0.08	0.33	1.61	1333
	15:00:00	1016	0.581	95.6	1.76	0.08	0.35	1.64	1334
	16:00:00	1017	0.581	95.6	1.80	0.09	0.35	1.64	1334
	17:00:00	1017	0.581	95.4	1.91	0.08	0.35	1.64	1334
	18:00:00	1018	0.582	95.3	1.98	0.08	0.35	1.61	1334
	19:00:00	1018	0.583	95.3	2.01	0.08	0.35	1.57	1334
	20:00:00	1017	0.583	95.4	1.97	0.08	0.34	1.58	1333
	21:00:00	1017	0.582	95.5	1.92	0.08	0.33	1.57	1333
	22:00:00	1015	0.582	95.6	1.77	0.07	0.31	1.62	1331
	23:00:00	1015	0.581	95.7	1.75	0.07	0.31	1.62	1332

Table A-2 Sutter Turbine Data

[illegible]

### Table A-2 Sutter Turbine Data

[illegible]

Table A-2 Sutter Turbine Data

[illegible]

### Table A-2 Sutter Turbine Data

[illegible]

Table A-3 Redding Data

		Heat Content Btu/scf	O2%	NOx ppm	NOx ppm @15% O2	NOx lb/mmBtu	NOx lbs	SCONox Inlet NOx ppm	Gas Flow kscf	Process Status	Turbine On-Time	Heat Input mmBtu/hr
8-Jun-05	0:00:00	1021										
	1:00:00	1020										
	2:00:00	1021										
	3:00:00	1021										
	4:00:00	1022										
	5:00:00	1022										
	6:00:00	1022										
	7:00:00	1023										
	8:00:00	1024										
	9:00:00	1025										
	10:00:00	1025										
	11:00:00	1025										
	12:00:00	1026										
	13:00:00	1026										
	14:00:00	1025										
	15:00:00	1024										
	16:00:00	1024										
	17:00:00	1024										
	18:00:00	1024										
	19:00:00	1024										
	20:00:00	1025										
	21:00:00	1026										
	22:00:00	1027										
	23:00:00	1027										
9-Jun-05	0:00:00	1028	14.3	0.41	0.4	0.001	0.3	25.6	297.4	Normal	1.00	308.7
	1:00:00	1028	14.3	0.41	0.4	0.001	0.3	25.6	297.2	Normal	1.00	308.5
	2:00:00	1028	14.3	0.40	0.4	0.001	0.3	25.6	298.9	Normal	1.00	308.2
	3:00:00	1029	14.3	0.40	0.4	0.001	0.3	25.6	298.4	Normal	1.00	307.7
	4:00:00	1031	14.3	0.41	0.4	0.001	0.3	25.6	298.2	Normal	1.00	307.5
	5:00:00	1032	14.3	0.40	0.4	0.001	0.3	25.6	296.1	Normal	1.00	307.4
	6:00:00	1032	14.3	0.38	0.3	0.001	0.3	25.9	296.2	Normal	1.00	307.5
	7:00:00	1032	14.4	0.37	0.3	0.001	0.3	26.4	296.4	Normal	1.00	307.7
	8:00:00	1030	14.4	0.37	0.3	0.001	0.3	26.3	297.4	Normal	1.00	308.7
	9:00:00	1028	14.4	0.43	0.4	0.001	0.4	27.8	338.5	Normal	1.00	351.4
	10:00:00	1026	14.5	0.55	0.5	0.002	0.8	29.5	380.1	Normal	1.00	394.5
	11:00:00	1025	14.5	0.57	0.5	0.002	0.8	29.8	394.2	Normal	1.00	409.2
	12:00:00	1023	14.5	0.60	0.6	0.002	0.9	28.0	411.8	Normal	1.00	427.4
	13:00:00	1022	14.4	0.48	0.4	0.002	0.8	27.7	386.0	Normal	1.00	379.9
	14:00:00	1021	14.3	0.39	0.3	0.001	0.3	26.3	312.3	Normal	1.00	324.2
	15:00:00	1021	14.3	0.39	0.3	0.001	0.3	26.6	327.0	Normal	1.00	339.4
	16:00:00	1021	14.3	0.38	0.3	0.001	0.3	27.0	320.6	Normal	1.00	332.8
	17:00:00	1020	14.4	0.35	0.3	0.001	0.3	26.1	297.6	Normal	1.00	308.9
	18:00:00	1020	14.3	0.35	0.3	0.001	0.3	26.0	297.5	Normal	1.00	308.8
	19:00:00	1021	14.3	0.38	0.3	0.001	0.3	26.2	328.6	Normal	1.00	341.1
	20:00:00	1021	14.3	0.35	0.3	0.001	0.3	26.0	298.5	Normal	1.00	310.9
	21:00:00	1023	14.3	0.36	0.3	0.001	0.3	26.1	295.2	Normal	1.00	306.4
	22:00:00	1030	14.3	0.35	0.3	0.001	0.3	26.2	293.3	Normal	1.00	304.4
	23:00:00	1039	14.3	0.36	0.3	0.001	0.3	26.6	291.9	Normal	1.00	303.0
10-Jun-05	0:00:00	1047	14.3	0.36	0.3	0.001	0.3	26.9	291.1	Normal	1.00	302.2
	1:00:00	1052	14.3	0.38	0.3	0.001	0.3	27.2	290.9	Normal	1.00	302.0
	2:00:00	1055	14.3	0.37	0.3	0.001	0.3	27.3	290.9	Normal	1.00	302.0
	3:00:00	1056	14.3	0.37	0.3	0.001	0.3	27.3	291.0	Normal	1.00	302.1
	4:00:00	1056	14.3	0.37	0.3	0.001	0.3	27.3	291.1	Normal	1.00	302.2
	5:00:00	1056	14.3	0.35	0.3	0.001	0.3	27.1	291.0	Normal	1.00	302.1
	6:00:00	1055	14.4	0.36	0.3	0.001	0.3	26.6	290.7	Normal	1.00	301.7
	7:00:00	1055	14.4	0.36	0.3	0.001	0.3	25.4	290.2	Normal	1.00	301.2
	8:00:00	1055	14.4	0.37	0.3	0.001	0.3	25.7	289.5	Normal	1.00	300.5
	9:00:00	1057	14.4	0.35	0.3	0.001	0.3	26.1	289.5	Normal	1.00	300.5
	10:00:00	1058	14.4	0.35	0.3	0.001	0.3	25.7	289.4	Normal	1.00	300.4
	11:00:00	1058	14.4	0.34	0.3	0.001	0.3	25.5	289.4	Normal	1.00	300.4
	12:00:00	1058	14.4	0.35	0.3	0.001	0.3	25.3	289.4	Normal	1.00	300.4
	13:00:00	1057	14.4	0.39	0.4	0.001	0.3	25.7	323.7	Normal	1.00	336.0
	14:00:00	1056	14.5	0.44	0.4	0.001	0.4	27.3	352.2	Normal	1.00	365.6
	15:00:00	1056	14.4	0.45	0.4	0.002	0.7	27.8	353.2	Normal	1.00	365.6
	16:00:00	1056	14.4	0.45	0.4	0.002	0.7	28.0	352.9	Normal	1.00	366.3
	17:00:00	1056	14.4	0.46	0.4	0.002	0.7	27.8	346.1	Normal	1.00	359.3
	18:00:00	1057	14.3	0.38	0.3	0.001	0.3	26.3	306.6	Normal	1.00	318.3
	19:00:00	1057	14.3	0.36	0.3	0.001	0.3	26.2	290.4	Normal	1.00	301.4
	20:00:00	1057	14.3	0.36	0.3	0.001	0.3	26.1	290.8	Normal	1.00	301.9
	21:00:00	1057	14.3	0.36	0.3	0.001	0.3	26.0	291.0	Normal	1.00	302.1
	22:00:00	1057	14.3	0.36	0.3	0.001	0.3	26.2	291.2	Normal	1.00	302.3
	23:00:00	1057	14.3	0.35	0.3	0.001	0.3	26.1	291.2	Normal	1.00	302.3

Table A-3 Redding Data

		Heat Content Btu/scf	O2%	NOx ppm	NOx ppm @15% O2	NOx lb/mmBtu	NOx lbs	SCONox Inlet NOx ppm	Gas Flow kscf	Process Status	Turbine On-Time	Heat Input mmBtu/hr
11-Jun-05	0:00:00	1057	14.3	0.36	0.3	0.001	0.3	26.1	291.2	Normal	1.00	302.3
	1:00:00	1057	14.3	0.36	0.3	0.001	0.3	26.4	291.2	Normal	1.00	302.3
	2:00:00	1057	14.3	0.37	0.3	0.001	0.3	26.6	291.2	Normal	1.00	302.3
	3:00:00	1057	14.3	0.37	0.3	0.001	0.3	26.6	291.5	Normal	1.00	302.6
	4:00:00	1056	14.3	0.37	0.3	0.001	0.3	26.7	291.5	Normal	1.00	302.6
	5:00:00	1056	14.3	0.40	0.4	0.001	0.3	26.8	291.8	Normal	1.00	302.9
	6:00:00	1056	14.3	0.41	0.4	0.001	0.3	26.9	292.1	Normal	1.00	303.2
	7:00:00	1054	14.4	0.39	0.4	0.001	0.3	26.9	292.6	Normal	1.00	303.7
	8:00:00	1052	14.4	0.40	0.4	0.001	0.3	26.8	292.9	Normal	1.00	304.0
	9:00:00	1050	14.4	0.40	0.4	0.001	0.3	26.6	293.0	Normal	1.00	304.1
	10:00:00	1048	14.4	0.40	0.4	0.001	0.3	26.7	293.0	Normal	1.00	304.1
	11:00:00	1048	14.4	0.39	0.4	0.001	0.3	26.6	292.7	Normal	1.00	303.8
	12:00:00	1048	14.4	0.39	0.4	0.001	0.3	26.8	292.3	Normal	1.00	303.4
	13:00:00	1049	14.4	0.39	0.4	0.001	0.3	26.6	291.9	Normal	1.00	303.0
	14:00:00	1051	14.4	0.39	0.4	0.001	0.3	26.7	296.8	Normal	1.00	308.1
	15:00:00	1051	14.4	0.42	0.4	0.001	0.3	26.9	325.6	Normal	1.00	338.0
	16:00:00	1050	14.4	0.44	0.4	0.001	0.3	27.1	325.4	Normal	1.00	337.8
	17:00:00	1050	14.3	0.42	0.4	0.001	0.3	27.3	316.1	Normal	1.00	328.1
	18:00:00	1050	14.3	0.42	0.4	0.001	0.3	27.3	310.1	Normal	1.00	321.9
	19:00:00	1051	14.3	0.38	0.3	0.001	0.3	27.1	291.4	Normal	1.00	302.5
	20:00:00	1052	14.3	0.39	0.3	0.001	0.3	27.1	291.6	Normal	1.00	302.7
	21:00:00	1053	14.3	0.40	0.4	0.001	0.3	27.2	291.8	Normal	1.00	302.9
	22:00:00	1053	14.3	0.40	0.4	0.001	0.3	27.3	292.0	Normal	1.00	303.1
	23:00:00	1054	14.3	0.41	0.4	0.001	0.3	27.4	292.1	Normal	1.00	303.2
12-Jun-05	0:00:00	1054	14.3	0.40	0.4	0.001	0.3	27.6	292.2	Normal	1.00	303.3
	1:00:00	1054	14.3	0.40	0.4	0.001	0.3	27.7	292.2	Normal	1.00	303.3
	2:00:00	1054	14.3	0.41	0.4	0.001	0.3	27.7	292.4	Normal	1.00	303.5
	3:00:00	1055	14.3	0.41	0.4	0.001	0.3	27.8	292.5	Normal	1.00	303.6
	4:00:00	1055	14.3	0.41	0.4	0.001	0.3	27.9	292.7	Normal	1.00	303.8
	5:00:00	1055	14.3	0.42	0.4	0.001	0.3	28.0	292.8	Normal	1.00	303.9
	6:00:00	1055	14.4	0.43	0.4	0.001	0.3	27.9	293.0	Normal	1.00	304.1
	7:00:00	1055	14.4	0.42	0.4	0.001	0.3	27.7	292.9	Normal	1.00	304.0
	8:00:00	1055	14.4	0.43	0.4	0.001	0.3	27.4	292.8	Normal	1.00	303.9
	9:00:00	1054	14.4	0.42	0.4	0.001	0.3	27.6	292.8	Normal	1.00	303.9
	10:00:00	1054	14.4	0.41	0.4	0.001	0.3	27.0	292.9	Normal	1.00	304.0
	11:00:00	1054	14.4	0.42	0.4	0.001	0.3	27.1	294.0	Normal	1.00	305.2
	12:00:00	1050	14.4	0.41	0.4	0.001	0.3	26.8	295.1	Normal	1.00	306.3
	13:00:00	1045	14.4	0.41	0.4	0.001	0.3	26.6	295.9	Normal	1.00	307.1
	14:00:00	1038	14.4	0.41	0.4	0.001	0.3	26.5	296.0	Normal	1.00	307.2
	15:00:00	1034	14.4	0.40	0.4	0.001	0.3	26.6	295.7	Normal	1.00	306.9
	16:00:00	1033	14.4	0.40	0.4	0.001	0.3	26.7	295.4	Normal	1.00	306.6
	17:00:00	1033	14.4	0.44	0.4	0.001	0.7	26.8	328.7	Normal	1.00	341.2
	18:00:00	1033	14.4	0.45	0.4	0.002	0.3	26.9	329.3	Normal	1.00	341.8
	19:00:00	1032	14.3	0.44	0.4	0.001	0.3	26.5	329.6	Normal	1.00	342.1
	20:00:00	1031	14.3	0.40	0.4	0.001	0.3	26.2	302.6	Normal	1.00	314.1
	21:00:00	1029	14.3	0.39	0.3	0.001	0.3	26.3	297.2	Normal	1.00	308.5
	22:00:00	1029	14.3	0.40	0.4	0.001	0.3	26.2	297.5	Normal	1.00	308.8
	23:00:00	1029	14.3	0.41	0.4	0.001	0.3	26.4	297.4	Normal	1.00	308.7
13-Jun-05	0:00:00	1028	14.3	0.41	0.4	0.001	0.3	26.6	297.6	Normal	1.00	308.9
	1:00:00	1027	14.3	0.41	0.4	0.001	0.3	26.7	297.8	Normal	1.00	309.1
	2:00:00	1026	14.3	0.41	0.4	0.001	0.3	26.7	297.8	Normal	1.00	309.1
	3:00:00	1026	14.3	0.41	0.4	0.001	0.3	26.8	297.7	Normal	1.00	309.0
	4:00:00	1026	14.3	0.41	0.4	0.001	0.3	26.9	297.7	Normal	1.00	309.0
	5:00:00	1027	14.3	0.40	0.4	0.001	0.3	26.9	297.1	Normal	1.00	308.4
	6:00:00	1029	14.4	0.42	0.4	0.001	0.3	26.8	296.1	Normal	1.00	307.4
	7:00:00	1033	14.4	0.41	0.4	0.001	0.3	26.6	296.3	Normal	1.00	307.6
	8:00:00	1036	14.4	0.42	0.4	0.001	0.3	26.9	311.7	Normal	1.00	323.5
	9:00:00	1033	14.4	0.44	0.4	0.001	0.3	26.8	326.6	Normal	1.00	339.0
	10:00:00	1029	14.4	0.44	0.4	0.001	0.3	26.9	327.3	Normal	1.00	339.7
	11:00:00	1026	14.4	0.44	0.4	0.001	0.3	26.5	327.3	Normal	1.00	339.7
	12:00:00	1024	14.5	0.48	0.4	0.002	0.7	27.5	355.7	Normal	1.00	369.2
	13:00:00	1023	14.5	0.48	0.4	0.002	0.7	27.5	359.1	Normal	1.00	372.7
	14:00:00	1022	14.4	0.40	0.4	0.001	0.3	25.6	297.3	Normal	1.00	308.6
	15:00:00	1022	14.4	0.41	0.4	0.001	0.3	25.7	316.8	Normal	1.00	328.8
	16:00:00	1022	14.4	0.42	0.4	0.001	0.3	26.1	327.1	Normal	1.00	339.5
	17:00:00	1022	14.4	0.44	0.4	0.001	0.3	26.1	331.8	Normal	1.00	344.4
	18:00:00	1022	14.5	0.54	0.5	0.002	0.8	28.4	377.7	Normal	1.00	392.1
	19:00:00	1023	14.3	0.43	0.4	0.001	0.3	25.8	325.7	Normal	1.00	338.1
	20:00:00	1024	14.3	0.41	0.4	0.001	0.3	25.6	325.4	Normal	1.00	337.8
	21:00:00	1025	14.3	0.41	0.4	0.001	0.3	25.7	325.7	Normal	1.00	338.1
	22:00:00	1025	14.3	0.41	0.4	0.001	0.3	25.9	325.7	Normal	1.00	338.1
	23:00:00	1026	14.3	0.39	0.3	0.001	0.3	25.8	296.9	Normal	1.00	330.3

Table A-4 Los Medanos Data

		Heat Content		CT1 Heat Input MMBTU	CT1 NOx ppm	CT1 CO ppm	CT1 O <sub>2</sub> %	CT1 NH <sub>3</sub> lb/hr	CT1 MW	CT1 Temp	CT1 BlowKWh	CT2 Heat Input MMBTU	CT2 NOx ppm	CT2 CO ppm	CT2 O <sub>2</sub> %	CT2 NH <sub>3</sub> lb/hr	CT2 MW	CT2 Temp	CT2
		Blow	Subst																
6-Jun-05	12:00 PM	1,026.97																	
	1:00 PM	1,028.50																	
	2:00 PM	1,028.44																	
	3:00 PM	1,028.22																	
	4:00 PM	1,028.26																	
	5:00 PM	1,028.86																	
	6:00 PM	1,029.56																	
	7:00 PM	1,021.03																	
	8:00 PM	1,021.05																	
	9:00 PM	1,020.58																	
7-Jun-05	10:00 PM	1,028.36																	
	11:00 PM	1,027.16																	
	12:00 AM	1,028.05																	
	1:00 AM	1,028.03																	
	2:00 AM	1,030.03																	
	3:00 AM	1,030.86																	
	4:00 AM	1,030.75																	
	5:00 AM	1,028.40																	
	6:00 AM	1,031.03																	
	7:00 AM	1,028.60																	
	8:00 AM	1,028.83																	
	9:00 AM	1,024.53																	
	10:00 AM	1,023.27																	
	11:00 AM	1,023.36																	
	12:00 PM	1,024.08																	
	1:00 PM	1,026.47																	
	2:00 PM	1,027.56																	
	3:00 PM	1,026.79																	
	4:00 PM	1,030.97																	
	5:00 PM	1,031.03																	
	6:00 PM	1,030.69																	
	7:00 PM	1,028.25																	
	8:00 PM	1,025.69																	
	9:00 PM	1,028.57																	
	10:00 PM	1,023.07																	
	11:00 PM	1,022.95																	
8-Jun-05	12:00 AM	1,024.12																	
	1:00 AM	1,024.57																	
	2:00 AM	1,027.37																	
	3:00 AM	1,028.78																	
	4:00 AM	1,029.26																	
	5:00 AM	1,029.38																	
	6:00 AM	1,035.17																	
	7:00 AM	1,039.38																	
	8:00 AM	1,030.86																	
	9:00 AM	1,029.24																	
	10:00 AM	1,019.36																	
	11:00 AM	1,023.73																	
	12:00 PM	1,029.63																	
	1:00 PM	1,029.24																	
	2:00 PM	1,028.42																	
	3:00 PM	1,029.17																	
	4:00 PM	1,028.19																	
	5:00 PM	1,027.97																	
	6:00 PM	1,028.13																	
	7:00 PM	1,023.52																	
	8:00 PM	1,023.34																	
	9:00 PM	1,024.63																	
	10:00 PM	1,022.75																	
	11:00 PM	1,023.06																	

Table A-4 Los Medianos Data

Heat Coolant/ Steam		CT1	Heat Input MMBTU	CT1	NOx ppm	CT1	CO ppm	CT1	O2 %	CT1	NH3 lb/hr	CT1	MW	CT1	Temp	CT1	StackWtH	CT1	Heat Input MMBTU	CT2	NOx ppm	CT2	CO ppm	CT2	O2 %	CT2	NH3 lb/hr	CT2	MW	CT2	Temp	CT2	StackWtH	
		N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
9-Jun-05	12:00 AM	1,025.81	N/A		N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	1837.4	1.8	0.2	13.1	30.4											
	1:00 AM	1,024.78	N/A		N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	1897.1	1.8	0.1	13.5	31.7											
	2:00 AM	1,026.16	N/A		N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	1768.5	1.9	0.1	13.5	33.8											
	3:00 AM	1,029.55	N/A		N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	1768.0	1.9	0.2	13.3	42.9											
	4:00 AM	1,030.30	N/A		N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	1742.8	1.9	0.1	13.5	36.8											
	5:00 AM	1,036.78	N/A		N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	1701.8	1.9	0.1	13.5	34.7											
	6:00 AM	1,034.89	1377.9	6.1	0.2	13.8	44.3											1450.0	1.8	0.1	13.5	38.7												
	7:00 AM	1,041.00	1843.0	1.9	0.0	13.7	43.5											1653.3	1.9	0.1	13.5	38.5												
	8:00 AM	1,038.28	1771.3	N/A	N/A	N/A	36.4											1787.7	1.8	0.2	13.4	43.9												
	9:00 AM	1,033.19	1610.1	1.9	0.0	13.7	38.8											1618.6	1.9	0.1	13.5	31.9												
	10:00 AM	1,028.97	1481.8	1.9	0.0	13.7	38.5											1489.8	1.9	0.1	13.5	31.5												
10-Jun-05	11:00 AM	1,039.09	1847.9	1.9	0.0	13.7	39.3											1853.2	1.9	0.1	13.5	34.8												
	12:00 PM	1,031.06	1478.3	1.9	0.0	13.8	38.3											1480.0	1.8	0.1	13.5	32.8												
	1:00 PM	1,024.28	1788.0	1.9	0.1	13.6	48.0	183.0	1119.8	10403.9	1775.7	1.9	0.2	13.5	38.8	183.8	1128.1	10402.1	1776.7	1.9	0.1	13.5	38.8	183.8	1128.1	10402.1	1776.7	1.9	0.2	13.5	38.8	183.8	1128.1	
	2:00 PM	1,034.07	1835.7	1.9	0.0	13.8	39.2	183.8	1136.9	10455.6	1549.3	1.9	0.1	13.5	33.9	194.5	1154.3	10458.7	1840.3	1.9	0.1	13.5	33.9	194.5	1154.3	10458.7	1840.3	1.9	0.1	13.5	33.9	194.5	1154.3	
	3:00 PM	1,030.19	1776.3	1.9	0.1	13.5	82.4	183.8	1122.5	10455.6	1609.3	1.9	0.3	13.2	44.9	194.5	1154.3	10458.7	1776.3	1.9	0.1	13.5	33.9	194.5	1154.3	10458.7	1776.3	1.9	0.1	13.5	33.9	194.5	1154.3	
	4:00 PM	1,031.96	1781.0	1.9	0.1	13.6	48.8	183.2	1118.3	10442.1	1778.0	1.9	0.2	13.4	42.0	194.0	1154.3	10458.7	1832.5	1.9	0.2	13.4	42.0	194.0	1154.3	10458.7	1832.5	1.9	0.2	13.4	42.0	194.0	1154.3	
	5:00 PM	1,033.94	1832.5	1.9	0.0	13.8	40.3	190.1	1123.7	10810.3	1841.2	1.9	0.1	13.5	33.5	190.5	1141.1	10811.3	1832.5	1.9	0.1	13.5	33.5	190.5	1141.1	10811.3	1832.5	1.9	0.1	13.5	33.5	190.5	1141.1	
	6:00 PM	1,035.58	1878.0	1.9	0.0	13.8	40.7	144.8	1131.0	10831.2	1988.7	1.9	0.1	13.6	33.0	148.4	1147.8	10840.9	1878.0	1.9	0.1	13.6	33.0	148.4	1147.8	10840.9	1878.0	1.9	0.1	13.6	33.0	148.4	1147.8	
	7:00 PM	1,040.80	1835.1	1.9	0.0	13.9	41.2	191.1	1122.5	10511.3	1842.1	1.9	0.1	13.6	34.1	191.5	1138.4	10507.8	1835.1	1.9	0.1	13.6	34.1	191.5	1138.4	10507.8	1835.1	1.9	0.1	13.6	34.1	191.5	1138.4	
	8:00 PM	1,040.94	1823.4	1.9	0.0	13.8	41.8	190.5	1122.3	10510.9	1855.1	1.9	0.1	13.6	33.5	181.0	1135.3	10548.0	1823.4	1.9	0.1	13.6	33.5	181.0	1135.3	10548.0	1823.4	1.9	0.1	13.6	33.5	181.0	1135.3	
	9:00 PM	1,037.38	1883.6	1.9	0.0	13.8	42.3	198.8	1113.6	10482.7	1863.7	1.9	0.1	13.5	36.7	187.2	1128.8	10482.7	1883.6	1.9	0.1	13.5	36.7	187.2	1128.8	10482.7	1883.6	1.9	0.1	13.5	36.7	187.2	1128.8	
11-Jun-05	10:00 PM	1,032.45	1428.3	2.0	0.0	13.8	43.0	123.2	1148.6	11481.8	1438.8	1.9	0.1	13.5	36.8	123.7	1188.4	11481.8	1428.3	2.0	0.1	13.5	36.8	123.7	1188.4	11481.8	1428.3	2.0	0.1	13.5	36.8	123.7	1188.4	
	11:00 PM	1,028.16	1386.2	1.8	0.0	13.8	41.4	118.4	1158.0	11570.5	1382.5	1.8	0.1	13.4	41.1	154.9	1138.8	10821.5	1386.2	1.8	0.1	13.4	41.1	154.9	1138.8	10821.5	1386.2	1.8	0.1	13.4	41.1	154.9	1138.8	
	12:00 AM	1,034.03	N/A	N/A	N/A	N/A	N/A	5.3	678.5	2767.9	1889.3	1.8	0.1	13.3	42.3	182.7	1140.7	10846.1	1034.03	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
	1:00 AM	1,035.38	N/A	N/A	N/A	N/A	N/A	0.0	681.8	0.0	1783.7	1.8	0.1	13.3	42.3	182.7	1140.7	10846.1	1035.38	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
	2:00 AM	1,038.89	N/A	N/A	N/A	N/A	N/A	0.0	507.4	0.0	1478.0	1.8	0.1	13.5	30.3	128.8	1181.3	10867.7	1038.89	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
	3:00 AM	1,038.84	N/A	N/A	N/A	N/A	N/A	0.0	451.1	0.0	1488.0	1.9	0.1	13.5	31.1	129.5	1182.3	10882.9	1038.84	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	4:00 AM	1,037.12	N/A	N/A	N/A	N/A	N/A	0.0	412.1	0.0	1654.3	1.8	0.1	13.4	41.4	180.1	1143.7	10895.9	1037.12	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	5:00 AM	1,039.64	N/A	N/A	N/A	N/A	N/A	13.1	600.9	5846.1	1717.1	1.8	0.2	13.4	38.0	158.0	1131.8	10445.1	1039.64	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	6:00 AM	1,040.78	1451.2	3.5	0.0	13.7	47.4	128.0	1145.5	11088.4	1483.8	1.9	0.1	13.5	40.9	128.5	1181.0	11115.2	1040.78	1451.2	3.5	0.0	13.7	47.4	128.0	1145.5	11088.4	1483.8	1.9	0.1	13.5	40.9	128.5	1181.0
	7:00 AM	1,032.82	1743.1	1.9	0.0	13.8	33.8	161.9	1123.1	10887.3	1752.8	1.9	0.2	13.4	43.8	182.3	1152.3	10408.6	1032.82	1743.1	1.9	0.0	13.8	33.8	161.9	1123.1	10887.3	1752.8	1.9	0.2	13.4	43.8	182.3	1152.3
	8:00 AM	1,047.81	1783.4	1.9	0.0	13.8	45.8	182.2	1114.7	10448.0	1770.3	1.8	0.2	13.5	40.4	183.0	1128.3	10470.0	1047.81	1783.4	1.9	0.0	13.8	45.8	182.2	1114.7	10448.0	1770.3	1.8	0.2	13.5	40.4	183.0	1128.3
9:00 AM	1,083.63	1883.8	1.9	0.0	13.7	40.3	144.1	1128.9	10827.7	1888.0	1.9	0.1	13.5	38.1	144.5	1148.8	10882.3	1083.63	1883.8	1.9	0.0	13.7	40.3	144.1	1128.9	10827.7	1888.0	1.9	0.1	13.5	38.1	144.5	1148.8	
10:00 AM	1,071.82	1873.3	1.9	0.0	13.7	43.7	151.8	1134.0	10720.8	1886.1	1.9	0.1	13.5	38.7	182.4	1138.2	10748.5	1071.82	1873.3	1.9	0.0	13.7	43.7	151.8	1134.0	10720.8	1886.1	1.9	0.1	13.5	38.7	182.4	1138.2	
11:00 AM	1,075.44	1500.1	1.9	0.0	13.7	36.4	131.1	1144.7	11218.3	1813.6	1.9	0.1	13.6	36.2	131.8	1163.9	11261.0	1075.44	1500.1	1.9	0.0	13.7	36.4	131.1	1144.7	11218.3	1813.6	1.9	0.1	13.6	36.2	131.8	1163.9	
11-Jun-09	12:00 PM	1,075.43	1601.5	1.9	0.0	13.8	39.2	143.8	1132.3	10882.4	1811.9	1.9	0.1	13.8	32.0	144.3	1190.4	10879.4	1075.43	1601.5	1.9	0.0	13.8	39.2	143.8	1132.3	10882.4	1811.9	1.9	0.1	13.8	32.0	144.3	1190.4
	1:00 PM	1,075.10	1771.7	1.9	0.0	13.2	39.0	183.3	1133.9	10769.0	1794.9	1.9	0.1	13.8	48.1	183.9	1142.9	10891.8	1075.10	1771.7	1.9	0.0	13.2	39.0	183.3	1133.9	10769.0	1794.9	1.9	0.1	13.8	48.1	183.9	1142.9
	2:00 PM	1,074.72	1743.9	1.9	0.0	13.5	34.5	158.4	1132.8	10449.3	1783.3	1.9	0.2	13.3	48.7	158.2	1138.0	10818.8	1074.72	1743.9	1.9	0.0	13.5	34.5	158.4	1132.8	10449.3	1783.3	1.9	0.2	13.3	48.7	158.2	1138.0
	3:00 PM	1,078.03	1699.1	1.9	0.0	13.7	44.8	154.0	1124.4	10719.3	1711.5	1.9	0.1	13.5	37.9	154.5	1137.5	10726.1	1078.03	1699.1	1.9	0.0	13.7	44.8	154.									



Table A-5 Delta Turbine Data

	CT1 Heat Input MMBTU	CT1 NOx ppm	CT1 O2 %	CT1 CO ppm	CT1 NH3 B/hr	CT2 Heat Input MMBTU	CT2 NOx ppm	CT2 O2 %	CT2 CO ppm	CT2 NH3 B/hr	CT2 MW	CT2 Temp	CT2 Btu/KWh	CT3 Heat Input MMBTU	CT3 NOx ppm	CT3 CO ppm	CT3 O2 %	CT3 Btu/hr
10-Jun-2005																		
12:00 AM	N/A	N/A	N/A	N/A	N/A	1870.2	1.8	33.969	178.0	73.22	178.0	1013.9	1061.0	0.2	N/A	N/A	N/A	N/A
1:00 AM	N/A	N/A	N/A	N/A	N/A	1870.1	1.8	33.962	178.0	73.66	178.0	1013.9	1061.0	0.2	N/A	N/A	N/A	N/A
2:00 AM	N/A	N/A	N/A	N/A	N/A	1870.7	1.9	33.938	178.3	76.42	178.3	1033.5	1087.9	0.2	N/A	N/A	N/A	N/A
3:00 AM	N/A	N/A	N/A	N/A	N/A	1784.9	1.9	33.867	177.6	66.20	177.6	1042.0	1130.1	0.2	N/A	N/A	N/A	N/A
4:00 AM	N/A	N/A	N/A	N/A	N/A	1819.7	1.8	33.874	168.6	73.89	168.6	1037.0	1124.2	0.2	N/A	N/A	N/A	N/A
5:00 AM	1406.6	1.8	33.913	147.20	51.09	1709.7	1.9	33.870	162.1	72.07	162.1	1036.0	1123.5	0.2	N/A	N/A	N/A	N/A
6:00 AM	1736.6	1.9	33.756	59.45	59.45	1945.6	1.9	33.866	162.1	85.78	162.1	1036.0	1123.5	0.2	N/A	N/A	N/A	N/A
7:00 AM	1968.6	1.9	33.768	47.90	1706.3	1706.3	1.8	33.866	162.1	85.78	162.1	1036.0	1123.5	0.2	N/A	N/A	N/A	N/A
8:00 AM	1704.3	1.9	33.812	49.74	47.90	1704.3	1.8	33.903	160.1	70.79	160.1	1068.7	1063.6	0.2	N/A	N/A	N/A	N/A
9:00 AM	1622.6	1.9	33.720	44.44	47.92	1604.4	1.8	33.819	167.4	64.41	167.4	1045.3	10925.1	N/A	N/A	N/A	N/A	N/A
10:00 AM	1579.2	1.9	33.718	49.89	47.92	1604.4	1.8	33.819	167.4	64.41	167.4	1045.3	10925.1	N/A	N/A	N/A	N/A	N/A
11:00 AM	1697.3	1.9	33.760	48.04	47.92	1604.4	1.8	33.819	167.4	64.41	167.4	1045.3	10925.1	N/A	N/A	N/A	N/A	N/A
12:00 PM	1725.1	1.9	33.760	48.04	47.92	1604.4	1.8	33.819	167.4	64.41	167.4	1045.3	10925.1	N/A	N/A	N/A	N/A	N/A
1:00 PM	1851.6	1.9	33.781	45.53	44.07	1454.0	1.8	33.844	163.7	63.32	163.7	1063.4	10914.1	747.8	32.6	841.13	15.932	0.23
2:00 PM	1483.4	1.9	33.781	45.53	44.07	1454.0	1.8	33.844	163.7	63.32	163.7	1063.4	10914.1	747.8	32.6	841.13	15.932	0.23
3:00 PM	1365.0	1.9	33.781	45.53	44.07	1454.0	1.8	33.844	163.7	63.32	163.7	1063.4	10914.1	747.8	32.6	841.13	15.932	0.23
4:00 PM	1471.1	1.9	33.781	45.53	44.07	1454.0	1.8	33.844	163.7	63.32	163.7	1063.4	10914.1	747.8	32.6	841.13	15.932	0.23
5:00 PM	1365.0	1.9	33.781	45.53	44.07	1454.0	1.8	33.844	163.7	63.32	163.7	1063.4	10914.1	747.8	32.6	841.13	15.932	0.23
6:00 PM	1316.2	1.9	33.781	45.53	44.07	1454.0	1.8	33.844	163.7	63.32	163.7	1063.4	10914.1	747.8	32.6	841.13	15.932	0.23
7:00 PM	1352.7	1.9	33.781	45.53	44.07	1454.0	1.8	33.844	163.7	63.32	163.7	1063.4	10914.1	747.8	32.6	841.13	15.932	0.23
8:00 PM	N/A	N/A	N/A	N/A	N/A	1786.2	1.9	33.788	177.3	82.29	177.3	1068.6	10942.4	304.3	N/A	N/A	N/A	N/A
9:00 PM	N/A	N/A	N/A	N/A	N/A	1589.4	1.8	33.857	171.7	61.97	171.7	1071.6	1175.7	1417.4	1.9	0.90	13.941	62.34
10:00 PM	N/A	N/A	N/A	N/A	N/A	1474.9	1.9	33.858	149.9	58.95	149.9	1064.2	1175.7	1417.4	1.9	0.90	13.941	62.34
11:00 PM	N/A	N/A	N/A	N/A	N/A	1840.8	1.8	33.791	137.3	88.69	137.3	1065.8	1233.7	N/A	N/A	N/A	N/A	N/A
12:00 AM	N/A	N/A	N/A	N/A	N/A	1838.2	1.9	33.837	177.0	77.08	177.0	1082.9	1081.1	0.2	N/A	N/A	N/A	N/A
1:00 AM	N/A	N/A	N/A	N/A	N/A	1856.7	1.8	33.845	178.4	78.54	178.4	1084.4	1021.1	0.2	N/A	N/A	N/A	N/A
2:00 AM	N/A	N/A	N/A	N/A	N/A	1863.2	1.8	33.845	178.4	78.54	178.4	1084.4	1021.1	0.2	N/A	N/A	N/A	N/A
3:00 AM	N/A	N/A	N/A	N/A	N/A	1860.0	1.9	33.855	177.3	82.29	177.3	1077.3	1082.7	0.2	N/A	N/A	N/A	N/A
4:00 AM	N/A	N/A	N/A	N/A	N/A	1860.0	1.9	33.855	177.3	82.29	177.3	1077.3	1082.7	0.2	N/A	N/A	N/A	N/A
5:00 AM	N/A	N/A	N/A	N/A	N/A	1860.0	1.9	33.855	177.3	82.29	177.3	1077.3	1082.7	0.2	N/A	N/A	N/A	N/A
6:00 AM	N/A	N/A	N/A	N/A	N/A	1860.0	1.9	33.855	177.3	82.29	177.3	1077.3	1082.7	0.2	N/A	N/A	N/A	N/A
7:00 AM	N/A	N/A	N/A	N/A	N/A	1860.0	1.9	33.855	177.3	82.29	177.3	1077.3	1082.7	0.2	N/A	N/A	N/A	N/A
8:00 AM	N/A	N/A	N/A	N/A	N/A	1860.0	1.9	33.855	177.3	82.29	177.3	1077.3	1082.7	0.2	N/A	N/A	N/A	N/A
9:00 AM	1735.7	1.8	33.860	45.81	45.81	1923.6	1.8	33.860	177.3	82.29	177.3	1077.3	1082.7	0.2	N/A	N/A	N/A	N/A
10:00 AM	1581.7	1.8	33.860	45.81	45.81	1923.6	1.8	33.860	177.3	82.29	177.3	1077.3	1082.7	0.2	N/A	N/A	N/A	N/A
11:00 AM	1538.2	1.9	33.724	42.55	42.55	1513.1	1.9	33.789	144.9	55.69	144.9	1097.2	1144.4	1520.5	N/A	N/A	N/A	N/A
12:00 PM	1658.4	1.8	33.676	46.45	46.45	1633.3	1.9	33.789	144.9	55.69	144.9	1097.2	1144.4	1520.5	N/A	N/A	N/A	N/A
1:00 PM	1675.4	1.9	33.652	45.70	45.70	1648.4	1.8	33.752	141.6	64.00	141.6	1097.2	1144.4	1520.5	N/A	N/A	N/A	N/A
2:00 PM	1541.6	1.9	33.707	43.74	43.74	1519.3	1.8	33.802	157.7	57.56	157.7	1093.5	11017.6	1532.6	1.9	0.05	13.812	56.71
3:00 PM	1583.0	1.8	33.659	43.35	43.35	1566.6	1.9	33.763	142.2	58.12	142.2	1091.8	11254.4	1579.0	1.9	0.01	13.762	59.80
4:00 PM	1614.4	1.9	33.644	44.66	44.66	1596.0	1.8	33.734	146.9	60.75	146.9	1095.7	11184.1	1613.5	1.9	0.00	13.759	62.32
5:00 PM	1766.5	1.9	33.635	52.12	52.12	1731.5	1.9	33.732	151.7	75.16	151.7	1019.6	11064.7	1755.8	1.8	0.00	13.707	62.89
6:00 PM	1719.8	1.9	33.649	49.10	49.10	1688.9	1.9	33.735	166.5	68.49	166.5	1057.1	10758.6	1709.4	1.9	0.00	13.751	61.32
7:00 PM	1670.0	1.9	33.656	47.82	47.82	1647.7	1.8	33.738	163.8	64.69	163.8	1027.2	10916.2	1666.9	1.9	0.00	13.707	61.96
8:00 PM	1745.4	1.9	33.642	52.13	52.13	1714.9	1.8	33.773	156.6	73.19	156.6	1100.5	11016.3	1744.3	1.9	0.01	13.704	62.37
9:00 PM	1472.7	2.0	33.811	46.45	46.45	1484.7	1.9	33.867	166.3	57.72	166.3	1094.8	10853.9	1492.6	1.9	0.12	13.854	55.70
10:00 PM	N/A	N/A	N/A	N/A	N/A	1484.8	1.9	33.864	138.4	66.68	138.4	1110.8	11310.6	1552.7	1.9	0.17	13.868	60.59
11:00 PM	N/A	N/A	N/A	N/A	N/A	1782.6	1.9	33.841	148.5	78.29	148.5	1066.5	10977.7	N/A	N/A	N/A	N/A	N/A

### Table A-5 Delta Turbine Data

[illegible]

Table A-6 Delta PG&E Natural Gas Data

		Composition (%)											Sp. Gr.	Wobbe
		Methane	Ethane	Propane	nButane	iButane	nPentane	iPentane	C6Plus	N2	CO2	Bluscf		
10-Jun-2005	12:00 AM	95.16	2.35	0.420	0.110	0.070	0.020	0.030	0.010	1.21	0.62	1026.3	0.585	1342
	1:00 AM	95.19	2.33	0.410	0.110	0.070	0.020	0.030	0.010	1.20	0.62	1025.9	0.585	1341
	2:00 AM	95.21	2.32	0.400	0.100	0.070	0.020	0.030	0.010	1.21	0.62	1025.6	0.585	1341
	3:00 AM	95.23	2.31	0.390	0.100	0.060	0.020	0.030	0.010	1.21	0.62	1025.3	0.585	1341
	4:00 AM	95.26	2.30	0.390	0.100	0.060	0.020	0.030	0.010	1.21	0.62	1024.9	0.585	1340
	5:00 AM	95.28	2.30	0.380	0.100	0.060	0.020	0.030	0.010	1.20	0.62	1024.8	0.584	1341
	6:00 AM	94.95	2.54	0.450	0.110	0.070	0.020	0.030	0.010	1.17	0.64	1028.3	0.587	1342
	7:00 AM	93.94	3.54	0.770	0.150	0.100	0.020	0.040	0.020	1.11	0.71	1043.0	0.596	1351
	8:00 AM	92.17	4.48	1.080	0.200	0.130	0.030	0.050	0.020	1.07	0.77	1067.3	0.606	1358
	9:00 AM	91.13	5.17	1.330	0.240	0.160	0.040	0.060	0.020	1.04	0.81	1088.4	0.613	1365
11-Jun-2005	10:00 AM	90.65	5.46	1.470	0.260	0.170	0.040	0.060	0.030	1.03	0.83	1073.7	0.617	1367
	11:00 AM	90.51	5.52	1.520	0.270	0.180	0.040	0.060	0.030	1.03	0.83	1075.3	0.618	1368
	12:00 PM	90.54	5.49	1.520	0.270	0.180	0.040	0.060	0.030	1.05	0.83	1075.0	0.618	1367
	1:00 PM	90.57	5.46	1.510	0.270	0.180	0.040	0.060	0.030	1.06	0.83	1074.5	0.618	1367
	2:00 PM	90.50	5.50	1.520	0.270	0.180	0.040	0.060	0.030	1.07	0.83	1074.8	0.618	1367
	3:00 PM	90.30	5.63	1.560	0.270	0.180	0.040	0.060	0.030	1.09	0.83	1076.4	0.619	1368
	4:00 PM	90.14	5.74	1.600	0.280	0.190	0.040	0.060	0.030	1.09	0.84	1077.9	0.621	1368
	5:00 PM	90.11	5.76	1.610	0.280	0.190	0.040	0.060	0.030	1.08	0.84	1078.3	0.621	1368
	6:00 PM	90.15	5.74	1.600	0.270	0.190	0.040	0.060	0.030	1.08	0.84	1078.0	0.621	1368
	7:00 PM	90.22	5.70	1.580	0.270	0.180	0.040	0.060	0.030	1.08	0.84	1077.4	0.620	1368
	8:00 PM	90.28	5.66	1.570	0.270	0.180	0.040	0.060	0.030	1.08	0.83	1076.8	0.620	1368
	9:00 PM	90.30	5.64	1.560	0.270	0.180	0.040	0.060	0.030	1.09	0.83	1076.3	0.619	1368
	10:00 PM	90.33	5.62	1.550	0.270	0.180	0.040	0.060	0.030	1.10	0.83	1076.0	0.619	1368
	11:00 PM	90.31	5.63	1.560	0.270	0.180	0.040	0.060	0.030	1.10	0.83	1076.1	0.619	1368
	12:00 AM	90.29	5.64	1.560	0.270	0.180	0.040	0.060	0.030	1.10	0.83	1076.3	0.619	1368
	1:00 AM	90.27	5.65	1.570	0.270	0.180	0.040	0.060	0.030	1.10	0.83	1076.5	0.620	1367
	2:00 AM	90.25	5.67	1.570	0.270	0.180	0.040	0.060	0.030	1.09	0.83	1076.8	0.620	1368
	3:00 AM	90.24	5.68	1.580	0.270	0.180	0.040	0.060	0.030	1.09	0.83	1077.0	0.620	1368
	4:00 AM	90.22	5.69	1.590	0.270	0.190	0.040	0.060	0.030	1.09	0.83	1077.2	0.620	1368
	5:00 AM	90.21	5.69	1.590	0.270	0.190	0.040	0.060	0.030	1.08	0.84	1077.5	0.620	1368
	6:00 AM	90.25	5.67	1.590	0.270	0.190	0.040	0.060	0.030	1.07	0.83	1077.2	0.620	1368
	7:00 AM	90.34	5.61	1.570	0.270	0.180	0.040	0.060	0.030	1.07	0.83	1076.5	0.619	1368
	8:00 AM	90.39	5.58	1.570	0.270	0.180	0.040	0.060	0.030	1.06	0.83	1076.3	0.619	1368
	9:00 AM	90.37	5.59	1.570	0.270	0.180	0.040	0.060	0.030	1.06	0.82	1076.5	0.619	1368
	10:00 AM	90.34	5.62	1.580	0.270	0.180	0.040	0.060	0.030	1.06	0.82	1076.7	0.619	1368
	11:00 AM	90.32	5.63	1.580	0.270	0.180	0.040	0.060	0.030	1.07	0.83	1076.7	0.619	1369
	12:00 PM	90.34	5.62	1.570	0.270	0.180	0.040	0.060	0.030	1.07	0.83	1076.2	0.619	1368
	1:00 PM	90.37	5.61	1.550	0.260	0.180	0.040	0.060	0.030	1.08	0.83	1075.7	0.619	1367
	2:00 PM	90.42	5.57	1.540	0.260	0.180	0.040	0.060	0.030	1.09	0.83	1075.0	0.618	1367
	3:00 PM	90.58	5.47	1.500	0.260	0.170	0.040	0.050	0.030	1.09	0.82	1073.5	0.617	1367
	4:00 PM	90.82	5.31	1.450	0.250	0.170	0.040	0.050	0.030	1.08	0.80	1071.3	0.616	1365
	5:00 PM	90.98	5.20	1.420	0.240	0.170	0.040	0.050	0.030	1.08	0.79	1069.9	0.615	1364
	6:00 PM	91.13	5.09	1.390	0.240	0.160	0.040	0.050	0.030	1.08	0.79	1068.6	0.614	1364
	7:00 PM	91.30	4.98	1.350	0.240	0.160	0.040	0.050	0.030	1.08	0.78	1067.2	0.613	1363
	8:00 PM	91.47	4.86	1.320	0.230	0.160	0.040	0.050	0.030	1.07	0.77	1065.9	0.612	1363
	9:00 PM	91.62	4.77	1.290	0.230	0.160	0.040	0.050	0.030	1.05	0.76	1064.7	0.611	1362
	10:00 PM	91.78	4.66	1.260	0.230	0.160	0.040	0.050	0.030	1.05	0.75	1063.5	0.609	1363
	11:00 PM	91.92	4.58	1.230	0.220	0.160	0.040	0.050	0.030	1.04	0.75	1062.4	0.609	1361

Table A-6 Delta PG&E Natural Gas Data

		Composition (%)										
		Methane	Ethane	Propane	n-Butane	i-Butane	n-Pentane	i-Pentane	CRPlus	N2	CO2	Wobbe
12-Jun-2005	12:00 AM	92.00	4.52	1.210	0.220	0.150	0.040	0.050	0.030	1.04	0.74	1352
	1:00 AM	92.03	4.50	1.210	0.220	0.150	0.030	0.050	0.030	1.03	0.74	1351
	2:00 AM	92.04	4.49	1.210	0.220	0.150	0.040	0.050	0.030	1.03	0.74	1351
	3:00 AM	92.06	4.47	1.200	0.220	0.150	0.030	0.050	0.030	1.03	0.74	1351
	4:00 AM											
	5:00 AM											
	6:00 AM											
	7:00 AM											
	8:00 AM	91.91	4.57	1.220	0.220	0.160	0.040	0.050	0.030	1.04	0.76	1351
	9:00 AM	91.89	4.71	1.260	0.230	0.160	0.040	0.050	0.030	1.05	0.77	1353
	10:00 AM	91.57	4.78	1.290	0.230	0.160	0.040	0.050	0.030	1.06	0.78	1353
	11:00 AM	91.47	4.83	1.310	0.240	0.170	0.040	0.050	0.030	1.06	0.78	1352
13-Jun-2005	12:00 PM	91.42	4.84	1.310	0.240	0.170	0.040	0.050	0.030	1.12	0.77	1352
	1:00 PM	91.43	4.84	1.310	0.240	0.170	0.040	0.050	0.030	1.12	0.77	1352
	2:00 PM	91.47	4.79	1.300	0.240	0.170	0.040	0.050	0.030	1.15	0.76	1351
	3:00 PM	91.50	4.76	1.300	0.240	0.170	0.040	0.050	0.030	1.14	0.76	1351
	4:00 PM	91.52	4.76	1.300	0.240	0.170	0.040	0.050	0.030	1.11	0.76	1352
	5:00 PM	91.51	4.78	1.320	0.250	0.170	0.040	0.050	0.030	1.08	0.76	1353
	6:00 PM	91.50	4.81	1.330	0.250	0.170	0.040	0.050	0.030	1.05	0.77	1354
	7:00 PM	91.47	4.84	1.340	0.250	0.170	0.040	0.050	0.030	1.02	0.77	1355
	8:00 PM	91.43	4.88	1.340	0.250	0.180	0.040	0.050	0.030	1.01	0.77	1354
	9:00 PM	91.42	4.90	1.340	0.250	0.180	0.040	0.050	0.030	1.00	0.78	1355
	10:00 PM	91.41	4.91	1.350	0.250	0.180	0.040	0.050	0.030	0.98	0.78	1355
	11:00 PM	91.40	4.93	1.350	0.250	0.180	0.040	0.050	0.030	0.96	0.79	1356
	12:00 AM	91.40	4.94	1.360	0.250	0.180	0.040	0.050	0.030	0.95	0.79	1356
	1:00 AM	91.39	4.95	1.360	0.250	0.180	0.040	0.050	0.030	0.94	0.79	1356
	2:00 AM	91.38	4.97	1.360	0.250	0.180	0.040	0.050	0.030	0.93	0.80	1356
	3:00 AM	91.37	4.98	1.360	0.250	0.180	0.040	0.050	0.030	0.93	0.80	1357
	4:00 AM	91.35	4.99	1.370	0.250	0.180	0.040	0.050	0.030	0.93	0.80	1357
	5:00 AM	91.31	5.03	1.370	0.250	0.180	0.040	0.050	0.030	0.92	0.82	1357
	6:00 AM	91.31	5.02	1.360	0.250	0.180	0.040	0.050	0.030	0.92	0.82	1357
	7:00 AM	91.34	5.00	1.360	0.250	0.180	0.040	0.050	0.030	0.93	0.83	1356
	8:00 AM	91.36	4.96	1.340	0.250	0.180	0.040	0.050	0.030	0.93	0.83	1356
	9:00 AM	91.45	4.93	1.310	0.250	0.170	0.040	0.050	0.030	0.95	0.82	1355
	10:00 AM	91.74	4.77	1.210	0.230	0.160	0.040	0.050	0.030	0.96	0.80	1353
	11:00 AM	92.47	4.36	1.000	0.190	0.130	0.030	0.050	0.030	0.98	0.75	1359
	12:00 PM	93.31	3.84	0.790	0.160	0.110	0.030	0.040	0.020	1.00	0.70	1355
	1:00 PM	94.17	2.99	0.820	0.170	0.120	0.030	0.040	0.020	1.04	0.60	1352
	2:00 PM	94.64	2.59	0.770	0.170	0.110	0.030	0.040	0.020	1.06	0.55	1351
	3:00 PM	94.85	2.61	0.990	0.140	0.090	0.020	0.040	0.020	1.10	0.54	1349
	4:00 PM	94.94	2.61	0.530	0.130	0.080	0.020	0.050	0.020	1.11	0.53	1348
	5:00 PM	95.12	2.48	0.490	0.120	0.080	0.020	0.030	0.010	1.13	0.51	1347
	6:00 PM	95.12	2.43	0.520	0.130	0.090	0.020	0.030	0.020	1.14	0.50	1347
	7:00 PM	94.72	2.70	0.620	0.150	0.090	0.020	0.040	0.020	1.11	0.54	1350
	8:00 PM	94.23	3.05	0.710	0.160	0.100	0.030	0.040	0.020	1.08	0.58	1352
	9:00 PM	94.21	3.08	0.710	0.160	0.100	0.030	0.040	0.020	1.07	0.58	1353
	10:00 PM	94.51	2.89	0.640	0.150	0.100	0.030	0.040	0.020	1.08	0.56	1351
	11:00 PM	94.71	2.76	0.600	0.140	0.090	0.020	0.040	0.020	1.06	0.54	1350

Table A-7 Midway Sunset Data

Date/Time	Unit A CO ppm	Unit X CO ppm	Bluel	Wobbe
5/24/01 16:30	2.68	1111	1375	1375
5/24/01 16:35	2.66	1110	1375	1375
5/24/01 16:40	2.82	1111	1375	1375
5/24/01 16:45	3.04	1110	1375	1375
5/24/01 16:50	3.02	1110	1375	1375
5/24/01 16:55	2.65	1105	1373	1373
5/24/01 17:00	2.38	1105	1373	1373
5/24/01 17:05	2.38	1106	1373	1373
5/24/01 17:10	2.61	1106	1373	1373
5/24/01 17:15	2.81	1107	1374	1374
5/24/01 17:20	2.81	1107	1374	1374
5/24/01 17:25	3.00	1106	1373	1373
5/24/01 17:30	3.25	1105	1373	1373
5/24/01 17:35	3.25	1105	1373	1373
5/24/01 17:40	16.27	1095	1370	1370
5/24/01 17:45	27.55	1075	1364	1364
5/24/01 17:50	27.53	1075	1364	1364
5/24/01 17:55	41.31	1030	1351	1351
5/24/01 18:00	46.72	1023	1349	1349
5/24/01 18:05	46.74	1021	1348	1348
5/24/01 18:10	49.41	1019	1348	1348
5/24/01 18:15	51.49	1019	1348	1348
5/24/01 18:20	50.60	1019	1348	1348
5/24/01 18:25	49.59	1018	1347	1347
5/24/01 18:30	52.21	1018	1347	1347
5/24/01 18:35	54.62	1018	1347	1347
5/24/01 18:40	54.62	1018	1347	1347
5/24/01 18:45	56.23	1018	1347	1347
5/24/01 18:50	56.92	1018	1347	1347
5/24/01 18:55	60.76	1017	1347	1347
5/24/01 19:00	63.01	1017	1347	1347
5/24/01 19:05	65.06	1017	1347	1347
5/24/01 19:10	65.06	1016	1347	1347
5/24/01 19:15	65.58	1016	1347	1347
5/24/01 19:20	63.78	1016	1347	1347
5/24/01 19:25	62.01	1014	1346	1346
5/24/01 19:30	37.94	1029	1350	1350
5/24/01 19:35	28.42	1024	1349	1349
5/24/01 19:40	27.49	1029	1350	1350
5/24/01 19:45	25.76	1029	1351	1351
5/24/01 19:50	25.76	1027	1350	1350
5/24/01 19:55	3.34	1069	1362	1362
5/24/01 20:00	3.34	1060	1368	1368
5/24/01 20:05	3.12	1095	1370	1370
5/24/01 20:10	3.02	1113	1375	1375
5/24/01 20:15	3.04	1114	1376	1376
5/24/01 20:20	3.57	1114	1376	1376
5/24/01 20:25	3.71	1110	1375	1375
5/24/01 20:30	3.71	1107	1374	1374
5/24/01 20:35	2.86	1106	1373	1373
5/24/01 20:40	2.86	1111	1375	1375
5/24/01 20:45	3.25	1111	1375	1375
5/24/01 20:50	3.25	1113	1375	1375

Date/Time	Unit A CO ppm	Unit X CO ppm	Bluel	Wobbe
5/24/01 18:30	1.38	4.11	1095	1370
5/24/01 18:35	1.38	3.99	1095	1370
5/24/01 18:40	1.53	4.06	1095	1370
5/24/01 18:45	1.49	3.97	1095	1370
5/24/01 18:50	1.50	3.87	1095	1370
5/24/01 18:55	1.48	4.02	1095	1370
5/24/01 19:00	1.42	4.14	1095	1370
5/24/01 19:05	1.41	4.47	1095	1370
5/24/01 19:10	1.51	4.29	1095	1370
5/24/01 19:15	1.47	4.40	1095	1369
5/24/01 19:20	1.47	4.45	1095	1369
5/24/01 19:25	1.58	4.71	1095	1370
5/24/01 19:30	1.50	4.36	1095	1370
5/24/01 19:35	1.40	4.32	1095	1370
5/24/01 19:40	1.45	4.41	1095	1369
5/24/01 19:45	1.46	4.33	1095	1369
5/24/01 19:50	1.55	4.25	1094	1369
5/24/01 19:55	1.53	4.45	1095	1369
5/24/01 20:00	1.39	4.46	1095	1369
5/24/01 20:05	1.60	4.48	1095	1369
5/24/01 20:10	1.41	4.22	1094	1369
5/24/01 20:15	1.46	4.35	1094	1369
5/24/01 20:20	1.41	4.14	1095	1369
5/24/01 20:25	1.55	4.30	1095	1369
5/24/01 20:30	1.50	4.35	1095	1370
5/24/01 20:35	1.54	4.19	1094	1369
5/24/01 20:40	1.33	4.27	1094	1369
5/24/01 20:45	1.44	4.13	1091	1366
5/24/01 20:50	1.49	4.35	1091	1366
5/24/01 20:55	1.42	4.42	1091	1366
5/24/01 21:00	1.43	4.46	1090	1366
5/24/01 21:05	1.45	4.91	1090	1366
5/24/01 21:10	1.45	4.77	1091	1366
5/24/01 21:15	1.38	4.91	1091	1366
5/24/01 21:20	1.51	4.59	1091	1366
5/24/01 21:25	1.41	4.51	1090	1366
5/24/01 21:30	1.37	4.58	1090	1366
5/24/01 21:35	1.42	4.58	1090	1366
5/24/01 21:40	1.53	4.63	1049	1350
5/24/01 21:45	1.55	4.71	1049	1350
5/24/01 21:50	1.35	4.56	1048	1350
5/24/01 21:55	1.38	4.43	1048	1350
5/24/01 22:00	1.58	4.50	1048	1350
5/24/01 22:05	1.46	4.63	1049	1350
5/24/01 22:10	1.42	5.52	1049	1350
5/24/01 22:15	1.39	7.06	1049	1350
5/24/01 22:20	1.51	7.99	1048	1350
5/24/01 22:25	1.61	9.02	1048	1350
5/24/01 22:30	1.46	9.16	1049	1350
5/24/01 22:35	1.53	8.99	1049	1351
5/24/01 22:40	1.40	8.89	1049	1351
5/24/01 22:45	1.51	9.08	1049	1351
5/24/01 22:50	1.55	8.92	1049	1350
5/24/01 22:55	1.41	8.97	1049	1350
5/24/01 23:00	1.38	8.69	1049	1351
5/24/01 23:05	1.64	8.97	1049	1351
5/24/01 23:10	1.45	9.04	1049	1351

Date/Time	Unit A CO ppm	Unit X CO ppm	Bluel	Wobbe
5/24/01 19:00	1.35	7.97	1053	1352
5/24/01 19:05	1.28	7.96	1052	1352
5/24/01 19:10	0.03	7.90	1052	1352
5/24/01 19:15	0.04	8.18	1052	1352
5/24/01 19:20	-0.03	8.35	1051	1351
5/24/01 19:25	1.18	8.07	1051	1352
5/24/01 19:30	1.11	8.02	1051	1352
5/24/01 19:35	-0.01	7.85	1051	1352
5/24/01 19:40	-0.22	8.06	1051	1352
5/24/01 19:45	-0.27	7.74	1051	1352
5/24/01 19:50	10.15	7.96	1051	1352
5/24/01 19:55	40.41	8.09	1051	1351
5/24/01 20:00	40.54	7.86	1051	1351
5/24/01 20:05	40.44	8.13	1051	1352
5/24/01 20:10	40.29	7.75	1051	1352
5/24/01 20:15	2.48	7.96	1051	1352
5/24/01 20:20	-0.72	7.95	1051	1352
5/24/01 20:25	-0.83	8.10	1051	1352
5/24/01 20:30	0.57	8.22	1051	1352
5/24/01 20:35	0.75	8.02	1051	1352
5/24/01 20:40	0.86	8.35	1051	1352
5/24/01 20:45	0.88	8.08	1051	1351
5/24/01 20:50	0.70	8.13	1051	1351
5/24/01 20:55	0.81	7.98	1051	1351
5/24/01 21:00	0.79	8.18	1051	1351
5/24/01 21:05	0.80	7.99	1051	1352
5/24/01 21:10	0.87	8.19	1046	1350
5/24/01 21:15	0.82	8.34	1046	1350
5/24/01 21:20	0.81	8.19	1046	1350
5/24/01 21:25	0.83	8.34	1046	1350
5/24/01 21:30	0.95	8.84	1046	1350
5/24/01 21:35	0.93	8.57	1046	1350
5/24/01 21:40	0.82	8.89	1046	1350
5/24/01 21:45	0.89	9.16	1046	1350
5/24/01 21:50	0.87	9.17	1046	1350
5/24/01 21:55	0.92	8.85	1045	1350
5/24/01 22:00	0.97	8.88	1044	1350
5/24/01 22:05	0.79	8.80	1044	1350
5/24/01 22:10	1.07	9.76	1044	1350
5/24/01 22:15	0.97	9.22	1044	1350
5/24/01 22:20	0.95	9.82	1044	1350
5/24/01 22:25	0.91	9.68	1044	1350
5/24/01 22:30	1.04	9.27	1044	1350
5/24/01 22:35	0.93	9.25	1044	1350
5/24/01 22:40	1.11	9.60	1044	1350
5/24/01 22:45	1.02	9.51	1044	1351
5/24/01 22:50	1.14	9.60	1046	1351
5/24/01 22:55	0.97	9.71	1046	1351
5/24/01 23:00	1.03	6.46	1046	1351
5/24/01 23:05	1.01	6.44	1046	1351
5/24/01 23:10	0.99	6.46	1046	1351
5/24/01 23:15	1.10	9.88	1046	1351
5/24/01 23:20	1.11	9.38	1046	1351
5/24/01 23:25	1.12	9.10	1046	1351
5/24/01 23:30	1.05	9.28	1046	1351

Date/Time	Unit A CO ppm	Unit X CO ppm	Blair	Wobbe
5/6/05 10:01	1.36	8.78	1046	1351
5/6/05 10:02	1.47	9.21	1048	1351
5/6/05 10:03	1.36	8.90	1046	1351
5/6/05 10:04	1.31	8.33	1040	1351
5/6/05 10:05	1.50	9.05	1050	1351
5/6/05 10:06	1.41	9.22	1050	1351
5/6/05 10:07	1.47	8.82	1050	1351
5/6/05 10:08	1.13	8.07	1040	1351
5/6/05 10:09	1.53	8.65	1050	1351
5/6/05 10:10	1.63	8.72	1050	1351
5/6/05 10:11	1.43	8.46	1050	1351
5/6/05 10:12	1.60	8.91	1050	1351
5/6/05 10:13	1.52	8.35	1050	1351
5/6/05 10:14	1.59	8.71	1050	1351
5/6/05 10:15	1.41	8.73	1050	1351
5/6/05 10:16	1.42	8.19	1052	1352
5/6/05 10:17	1.06	8.79	1052	1352
5/6/05 10:18	1.49	8.67	1051	1352
5/6/05 10:19	1.26	8.90	1051	1352
5/6/05 10:20	1.56	8.58	1051	1352
5/6/05 10:21	1.59	8.93	1052	1352
5/6/05 10:22	1.63	9.22	1052	1352
5/6/05 10:23	1.54	8.46	1052	1352
5/6/05 10:24	1.36	8.25	1052	1352
5/6/05 10:25	1.46	8.69	1051	1352
5/6/05 10:26	1.39	8.95	1052	1352
5/6/05 10:27	1.43	8.82	1052	1352
5/6/05 10:28	1.44	8.63	1053	1353
5/6/05 10:29	1.67	8.66	1053	1353
5/6/05 10:30	1.48	8.66	1053	1353
5/6/05 10:31	1.57	8.70	1052	1353
5/6/05 10:32	1.45	8.40	1052	1353
5/6/05 10:33	1.29	8.44	1053	1353
5/6/05 10:34	1.38	8.52	1053	1353
5/6/05 10:35	1.38	8.26	1053	1353
5/6/05 10:36	1.61	8.44	1053	1353
5/6/05 10:37	1.43	8.26	1053	1353
5/6/05 10:38	1.46	8.23	1053	1353
5/6/05 10:39	1.59	8.41	1053	1353
5/6/05 10:40	1.56	8.44	1047	1351
5/6/05 10:41	1.50	8.66	1047	1351
5/6/05 10:42	1.59	8.68	1047	1351
5/6/05 10:43	1.44	8.75	1047	1351
5/6/05 10:44	1.40	8.71	1047	1351
5/6/05 10:45	1.41	8.66	1047	1351
5/6/05 10:46	1.50	9.04	1047	1351
5/6/05 10:47	1.36	9.43	1047	1351
5/6/05 10:48	1.30	9.17	1047	1351
5/6/05 10:49	1.34	9.16	1047	1351
5/6/05 10:50	1.24	9.33	1047	1351
5/6/05 10:51	1.34	9.16	1047	1351
5/6/05 10:52	1.36	9.69	1056	1347
5/6/05 10:53	1.39	9.68	1056	1347
5/6/05 10:54	1.46	10.03	1056	1347
5/6/05 10:55	1.45	9.40	1056	1348
5/6/05 10:56	1.72	10.61	1056	1348
5/6/05 10:57	1.36	10.55	1055	1347
5/6/05 10:58	1.43	11.66	1055	1347
5/6/05 10:59	1.41	11.40	1055	1347
5/6/05 11:00	1.50	11.79	1055	1347
5/6/05 11:01	1.52	12.59	1055	1348
5/6/05 11:02	1.40	13.09	1055	1347
5/6/05 11:03	1.40	13.01	1055	1347

Date/Time	Unit A CO ppm	Unit X CO ppm	Blair	Wobbe
5/6/05 14:01	1.06	27.56	1046	1351
5/6/05 14:02	1.13	10.34	1046	1351
5/6/05 14:03	1.17	13.42	1046	1351
5/6/05 14:04	1.21	12.72	1047	1351
5/6/05 14:05	1.22	10.84	1047	1351
5/6/05 14:06	1.26	12.28	1047	1351
5/6/05 14:07	0.91	7.82	1047	1351
5/6/05 14:08	1.33	8.94	1047	1351
5/6/05 14:09	1.34	8.97	1047	1351
5/6/05 14:10	1.26	8.19	1047	1351
5/6/05 14:11	1.18	8.34	1047	1351
5/6/05 14:12	1.21	8.29	1047	1351
5/6/05 14:13	1.21	8.10	1047	1351
5/6/05 14:14	1.18	8.23	1047	1351
5/6/05 14:15	1.23	8.45	1047	1351
5/6/05 14:16	1.25	8.32	1050	1353
5/6/05 14:17	1.38	8.57	1050	1352
5/6/05 14:18	1.14	8.15	1050	1352
5/6/05 14:19	1.24	8.34	1050	1353
5/6/05 14:20	1.22	8.32	1046	1353
5/6/05 14:21	1.14	8.43	1046	1353
5/6/05 14:22	1.28	8.66	1050	1353
5/6/05 14:23	1.20	8.99	1050	1352
5/6/05 14:24	1.26	8.94	1050	1352
5/6/05 14:25	1.25	5.85	1050	1353
5/6/05 14:26	1.20	5.75	1049	1353
5/6/05 14:27	1.27	5.89	1049	1353
5/6/05 14:28	1.23	5.65	1051	1353
5/6/05 14:29	1.17	3.91	1051	1353
5/6/05 14:30	1.18	3.78	1051	1353
5/6/05 14:31	1.44	3.66	1051	1353
5/6/05 14:32	1.21	3.74	1051	1353
5/6/05 14:33	1.28	3.94	1051	1353
5/6/05 14:34	1.38	3.91	1051	1353
5/6/05 14:35	1.27	4.02	1051	1353
5/6/05 14:36	1.37	3.89	1051	1353
5/6/05 14:37	1.26	3.99	1051	1353
5/6/05 14:38	1.42	4.03	1051	1353
5/6/05 14:39	1.36	4.06	1051	1353
5/6/05 14:40	1.40	4.18	1054	1354
5/6/05 14:41	1.33	4.17	1054	1354
5/6/05 14:42	1.28	3.96	1054	1355
5/6/05 14:43	1.27	4.00	1054	1354
5/6/05 14:44	1.33	4.05	1054	1354
5/6/05 14:45	1.39	3.91	1053	1354
5/6/05 14:46	1.45	3.97	1054	1354
5/6/05 14:47	1.56	4.07	1054	1354
5/6/05 14:48	1.74	4.07	1054	1354
5/6/05 14:49	1.76	3.74	1054	1355
5/6/05 14:50	1.93	3.70	1053	1354
5/6/05 14:51	1.90	3.97	1054	1354
5/6/05 14:52	1.91	3.79	1057	1357
5/6/05 14:53	1.91	3.61	1057	1357
5/6/05 14:54	1.94	3.78	1057	1357
5/6/05 14:55	1.94	3.69	1057	1357
5/6/05 14:56	1.86	3.66	1057	1357
5/6/05 14:57	1.96	3.89	1057	1357
5/6/05 14:58	1.93	3.75	1057	1357
5/6/05 14:59	2.02	3.70	1057	1357
5/6/05 15:00	1.96	3.79	1057	1357
5/6/05 15:01	2.04	3.65	1057	1357
5/6/05 15:02	1.94	7.75	1057	1357
5/6/05 15:03	2.01	7.51	1057	1357

Date/Time	Unit A CO ppm	Unit X CO ppm	Blair	Wobbe
5/6/05 18:01	2.01	4.23	1052	1371
5/6/05 18:02	1.88	3.96	1052	1371
5/6/05 18:03	2.01	4.28	1052	1371
5/6/05 18:04	1.86	4.33	1052	1371
5/6/05 18:05	1.88	4.12	1051	1371
5/6/05 18:06	1.93	4.32	1051	1371
5/6/05 18:07	2.02	4.23	1052	1371
5/6/05 18:08	2.03	4.22	1052	1371
5/6/05 18:09	1.97	4.16	1052	1371
5/6/05 18:10	1.97	4.22	1052	1371
5/6/05 18:11	1.94	4.22	1051	1371
5/6/05 18:12	1.93	4.36	1051	1371
5/6/05 18:13	2.81	4.39	1051	1370
5/6/05 18:14	1.95	4.31	1052	1371
5/6/05 18:15	2.06	4.10	1052	1371
5/6/05 18:16	2.09	4.20	1053	1372
5/6/05 18:17	1.78	4.37	1052	1372
5/6/05 18:18	1.91	4.25	1052	1371
5/6/05 18:19	1.95	4.18	1052	1371
5/6/05 18:20	1.95	4.20	1052	1372
5/6/05 18:21	1.94	4.21	1053	1372
5/6/05 18:22	1.95	4.27	1052	1372
5/6/05 18:23	1.86	4.25	1052	1371
5/6/05 18:24	2.00	4.23	1051	1371
5/6/05 18:25	1.99	4.12	1051	1371
5/6/05 18:26	1.93	4.22	1052	1371
5/6/05 18:27	1.92	4.05	1052	1371
5/6/05 18:28	2.05	4.23	1050	1366
5/6/05 18:29	2.01	4.40	1050	1366
5/6/05 18:30	1.94	4.46	1050	1366
5/6/05 18:31	1.94	4.56	1050	1366
5/6/05 18:32	2.24	4.50	1050	1366
5/6/05 18:33	2.04	4.35	1050	1366
5/6/05 18:34	2.14	4.42	1050	1366
5/6/05 18:35	2.30	4.41	1050	1366
5/6/05 18:36	2.00	4.36	1050	1366
5/6/05 18:37	1.99	4.47	1050	1366
5/6/05 18:38	2.09	4.42	1050	1366
5/6/05 18:39	2.06	4.12	1050	1366
5/6/05 18:40	2.10	4.19	1050	1366
5/6/05 18:41	2.12	4.38	1050	1366
5/6/05 18:42	2.06	4.21	1050	1366
5/6/05 18:43	2.01	4.31	1050	1366
5/6/05 18:44	2.17	4.23	1050	1366
5/6/05 18:45	2.17	4.24	1050	1366
5/6/05 18:46	2.31	4.33	1050	1366
5/6/05 18:47	2.36	4.36	1050	1366
5/6/05 18:48	2.17	4.35	1050	1366
5/6/05 18:49	1.99	4.33	1050	1366
5/6/05 18:50	2.43	4.30	1050	1366
5/6/05 18:51	2.09	4.34	1050	1366
5/6/05 18:52	2.29	4.28	1050	1366
5/6/05 18:53	2.25	4.34	1050	1366
5/6/05 18:54	2.39	4.19	1050	1366
5/6/05 18:55	2.34	4.31	1050	1366
5/6/05 18:56	2.18	4.30	1050	1366
5/6/05 18:57	2.06	4.39	1050	1366
5/6/05 18:58	2.31	4.26	1050	1366
5/6/05 18:59	2.09	4.35	1050	1366
5/6/05 19:00	2.19	4.22	1050	1366
5/6/05 19:01	2.02	4.33	1050	1366
5/6/05 19:02	2.26	4.43	1050	1366
5/6/05 19:03	2.16	4.32	1050	1366

Date/Time	Unit A CO ppm	Unit X CO ppm	Btu/lcf	Wobbe
59/05 11:04	1.48	14.07	1043	1350
59/05 11:05	1.43	12.70	1043	1350
59/05 11:06	1.54	12.57	1043	1350
59/05 11:07	1.59	12.51	1043	1350
59/05 11:08	1.45	12.14	1043	1350
59/05 11:09	1.30	12.29	1043	1350
59/05 11:10	1.35	11.48	1043	1350
59/05 11:11	1.33	11.26	1043	1350
59/05 11:12	1.37	11.13	1043	1350
59/05 11:13	1.37	10.67	1043	1350
59/05 11:14	1.46	10.25	1043	1350
59/05 11:15	1.38	9.84	1043	1350
59/05 11:16	1.51	9.16	1076	1362
59/05 11:17	1.55	9.16	1076	1362
59/05 11:18	1.40	9.68	1075	1362
59/05 11:19	1.46	9.31	1076	1362
59/05 11:20	1.55	9.12	1076	1362
59/05 11:21	1.52	7.81	1076	1362
59/05 11:22	1.33	7.22	1076	1362
59/05 11:23	1.44	6.47	1075	1362
59/05 11:24	1.50	6.42	1075	1362
59/05 11:25	1.52	5.88	1076	1362
59/05 11:26	1.44	5.87	1076	1362
59/05 11:27	1.38	5.42	1076	1362
59/05 11:28	1.67	4.89	1088	1368
59/05 11:29	1.53	5.16	1088	1368
59/05 11:30	1.59	4.69	1087	1368
59/05 11:31	1.41	4.80	1088	1368
59/05 11:32	1.38	4.70	1088	1368
59/05 11:33	1.33	4.61	1088	1368
59/05 11:34	1.41	4.80	1088	1368
59/05 11:35	1.46	4.55	1087	1368
59/05 11:36	1.50	4.62	1087	1368
59/05 11:37	1.42	4.71	1088	1368
59/05 11:38	1.55	4.58	1088	1368
59/05 11:39	1.59	4.58	1088	1368
59/05 11:40	1.49	4.59	1090	1368
59/05 11:41	1.63	4.59	1090	1368
59/05 11:42	1.43	4.50	1090	1368
59/05 11:43	1.51	4.90	1090	1368
59/05 11:44	1.42	4.63	1090	1369
59/05 11:45	1.40	4.59	1090	1369
59/05 11:46	1.65	4.61	1089	1368
59/05 11:47	1.58	4.47	1089	1368
59/05 11:48	1.52	4.73	1090	1369
59/05 11:49	1.37	4.36	1090	1369
59/05 11:50	1.32	4.59	1090	1369
59/05 11:51	1.37	4.55	1089	1368
59/05 11:52	1.55	4.51	1089	1368
59/05 11:53	1.48	4.40	1089	1367
59/05 11:54	1.38	4.25	1090	1368
59/05 11:55	1.33	4.34	1090	1368
59/05 11:56	1.32	4.49	1090	1368
59/05 11:57	1.46	4.40	1090	1367
59/05 11:58	1.44	4.17	1089	1367
59/05 11:59	1.47	4.43	1089	1367
59/05 12:00	1.33	4.64	1090	1368
59/05 12:01	1.37	4.40	1090	1368
59/05 12:02	1.49	4.43	1090	1368
59/05 12:03	1.53	4.37	1090	1368
59/05 12:04	1.52	4.40	1088	1365
59/05 12:05	1.60	4.42	1088	1365
59/05 12:06	1.52	4.53	1089	1366

Date/Time	Unit A CO ppm	Unit X CO ppm	Btu/lcf	Wobbe
59/05 15:04	1.82	7.41	1054	1356
59/05 15:05	1.86	7.49	1054	1356
59/05 15:06	1.92	7.55	1054	1356
59/05 15:07	1.91	7.41	1054	1356
59/05 15:08	1.86	7.95	1054	1356
59/05 15:09	2.01	7.48	1054	1356
59/05 15:10	1.89	7.76	1054	1356
59/05 15:11	1.85	8.03	1054	1356
59/05 15:12	1.92	7.82	1054	1356
59/05 15:13	2.07	7.53	1054	1356
59/05 15:14	1.88	7.25	1054	1356
59/05 15:15	1.91	7.98	1054	1356
59/05 15:16	2.01	7.72	1060	1360
59/05 15:17	1.94	7.54	1060	1360
59/05 15:18	1.84	7.55	1060	1360
59/05 15:19	1.97	7.77	1060	1360
59/05 15:20	2.02	7.65	1060	1360
59/05 15:21	1.91	7.42	1060	1360
59/05 15:22	2.04	7.68	1060	1360
59/05 15:23	1.92	7.57	1060	1360
59/05 15:24	1.90	7.61	1060	1360
59/05 15:25	1.95	7.04	1060	1360
59/05 15:26	1.79	6.93	1060	1360
59/05 15:27	1.86	6.84	1060	1360
59/05 15:28	1.99	7.06	1063	1361
59/05 15:29	1.90	7.18	1063	1361
59/05 15:30	1.97	7.02	1063	1361
59/05 15:31	1.78	6.81	1063	1361
59/05 15:32	1.89	6.65	1063	1361
59/05 15:33	1.92	6.87	1063	1361
59/05 15:34	1.97	7.14	1063	1361
59/05 15:35	2.09	6.43	1063	1361
59/05 15:36	1.74	6.46	1063	1361
59/05 15:37	1.97	6.78	1063	1361
59/05 15:38	1.99	6.33	1064	1361
59/05 15:39	1.77	6.38	1064	1361
59/05 15:40	1.93	6.46	1074	1366
59/05 15:41	2.02	6.71	1074	1366
59/05 15:42	1.96	7.05	1074	1366
59/05 15:43	2.02	7.01	1075	1366
59/05 15:44	1.89	6.48	1075	1366
59/05 15:45	1.84	6.07	1075	1366
59/05 15:46	1.98	5.72	1075	1367
59/05 15:47	1.93	5.78	1074	1366
59/05 15:48	1.90	6.14	1074	1366
59/05 15:49	1.90	5.72	1075	1366
59/05 15:50	2.17	5.50	1075	1367
59/05 15:51	2.05	5.44	1075	1367
59/05 15:52	2.19	5.58	1091	1374
59/05 15:53	2.23	5.31	1090	1374
59/05 15:54	2.07	4.88	1090	1374
59/05 15:55	2.17	4.87	1090	1374
59/05 15:56	2.16	5.05	1091	1374
59/05 15:57	2.17	4.72	1091	1374
59/05 15:58	2.38	4.74	1091	1374
59/05 15:59	2.36	4.99	1091	1374
59/05 16:00	2.43	5.74	1090	1374
59/05 16:01	2.49	6.37	1090	1374
59/05 16:02	2.61	5.94	1090	1374
59/05 16:03	2.68	5.92	1091	1374
59/05 16:04	2.57	5.92	1085	1374
59/05 16:05	2.78	5.85	1085	1374
59/05 16:06	2.51	6.13	1094	1374

Date/Time	Unit A CO ppm	Unit X CO ppm	Btu/lcf	Wobbe
59/05 19:04	2.28	4.31	1088	1367
59/05 19:05	2.12	4.24	1088	1367
59/05 19:06	2.04	4.32	1088	1367
59/05 19:07	2.17	4.36	1087	1367
59/05 19:08	2.16	4.26	1087	1367
59/05 19:09	2.24	4.52	1087	1367
59/05 19:10	2.12	4.27	1088	1367
59/05 19:11	2.12	4.28	1088	1367
59/05 19:12	2.23	4.08	1088	1367
59/05 19:13	2.07	4.29	1087	1367
59/05 19:14	2.33	4.36	1087	1367
59/05 19:15	2.22	4.46	1087	1367
59/05 19:16	2.13	4.33	1089	1368
59/05 19:17	2.25	4.28	1088	1368
59/05 19:18	2.06	4.41	1089	1368
59/05 19:19	2.11	4.26	1088	1368
59/05 19:20	2.24	4.28	1088	1368
59/05 19:21	2.13	4.30	1088	1368
59/05 19:22	1.98	4.39	1089	1368
59/05 19:23	2.08	4.27	1089	1368
59/05 19:24	2.04	4.37	1089	1368
59/05 19:25	2.06	4.48	1089	1368
59/05 19:26	2.12	4.52	1089	1368
59/05 19:27	2.17	4.35	1088	1368
59/05 19:28	1.91	4.40	1089	1369
59/05 19:29	1.84	4.21	1090	1370
59/05 19:30	2.00	4.22	1090	1370
59/05 19:31	1.88	4.36	1090	1370
59/05 19:32	2.13	4.37	1090	1370
59/05 19:33	1.97	4.31	1089	1369
59/05 19:34	2.05	4.43	1089	1370
59/05 19:35	1.87	4.26	1090	1370
59/05 19:36	1.93	4.36	1090	1370
59/05 19:37	2.04	4.35	1090	1370
59/05 19:38	2.15	4.23	1090	1370
59/05 19:39	2.05	4.42	1089	1369
59/05 19:40	2.13	4.48	1088	1367
59/05 19:41	2.07	4.37	1088	1367
59/05 19:42	1.85	4.55	1089	1368
59/05 19:43	1.98	4.51	1089	1368
59/05 19:44	3.57	4.40	1088	1367
59/05 19:45	2.60	4.37	1088	1367
59/05 19:46	2.90	4.34	1087	1367
59/05 19:47	2.50	4.40	1088	1367
59/05 19:48	2.61	4.29	1088	1367
59/05 19:49	2.36	4.35	1088	1367
59/05 19:50	2.40	4.40	1088	1368
59/05 19:51	2.46	4.50	1088	1367
59/05 19:52	2.55	4.44	1087	1366
59/05 19:53	2.40	4.33	1087	1366
59/05 19:54	2.45	4.22	1087	1366
59/05 19:55	2.50	4.23	1087	1366
59/05 19:56	2.55	4.46	1088	1366
59/05 19:57	2.48	4.59	1087	1366
59/05 19:58	2.49	4.51	1087	1365
59/05 19:59	2.45	4.36	1087	1366
59/05 20:00	2.29	4.16	1087	1366

Date/Time	Unit A CO ppm	Unit X CO ppm	Bluelief Wobbe
5/9/05 12:07	1.36	4.62	1069 1366
5/9/05 12:08	1.41	4.61	1069 1366
5/9/05 12:09	1.49	4.43	1068 1365
5/9/05 12:10	1.40	4.50	1068 1365
5/9/05 12:11	1.42	4.60	1068 1365
5/9/05 12:12	1.43	4.48	1069 1366
5/9/05 12:13	1.67	4.50	1069 1366
5/9/05 12:14	1.41	4.34	1069 1366
5/9/05 12:15	1.50	4.38	1068 1365
5/9/05 12:16	1.30	4.48	1067 1366
5/9/05 12:17	1.37	4.71	1067 1366
5/9/05 12:18	1.35	4.39	1067 1366
5/9/05 12:19	1.33	4.19	1067 1366
5/9/05 12:20	1.47	4.43	1067 1366
5/9/05 12:21	1.38	4.22	1066 1365
5/9/05 12:22	1.38	4.63	1066 1365
5/9/05 12:23	1.45	4.37	1067 1366
5/9/05 12:24	1.31	4.51	1067 1366
5/9/05 12:25	1.50	4.35	1067 1366
5/9/05 12:26	1.26	4.29	1067 1366
5/9/05 12:27	1.36	4.54	1066 1365
5/9/05 12:28	1.39	4.83	1065 1357
5/9/05 12:29	1.36	4.74	1065 1357
5/9/05 12:30	1.41	4.68	1066 1357
5/9/05 12:31	1.49	4.86	1066 1357
5/9/05 12:32	1.38	4.87	1065 1357
5/9/05 12:33	1.37	5.20	1065 1357
5/9/05 12:34	1.40	5.12	1065 1357
5/9/05 12:35	1.30	5.78	1065 1357
5/9/05 12:36	1.35	5.62	1065 1357
5/9/05 12:37	1.33	5.91	1066 1357
5/9/05 12:38	1.42	6.15	1065 1357
5/9/05 12:39	1.37	6.26	1065 1357
5/9/05 12:40	1.36	6.24	1064 1353
5/9/05 12:41	1.44	6.68	1064 1353
5/9/05 12:42	1.25	7.07	1064 1353
5/9/05 12:43	1.34	6.90	1064 1353
5/9/05 12:44	1.34	7.41	1064 1353
5/9/05 12:45	1.54	7.02	1064 1353
5/9/05 12:46	1.43	7.34	1064 1352
5/9/05 12:47	1.43	7.49	1064 1352
5/9/05 12:48	1.40	8.00	1064 1352
5/9/05 12:49	1.42	7.79	1064 1353
5/9/05 12:50	1.40	7.71	1064 1353
5/9/05 12:51	1.23	7.77	1063 1353
5/9/05 12:52	1.25	7.78	1063 1352
5/9/05 12:53	1.28	8.00	1063 1352
5/9/05 12:54	1.44	8.22	1063 1352
5/9/05 12:55	1.66	7.80	1063 1352
5/9/05 12:56	1.24	7.93	1062 1352
5/9/05 12:57	1.35	7.58	1062 1352
5/9/05 12:58	1.35	7.97	1063 1352
5/9/05 12:59	1.40	8.12	1063 1352

Date/Time	Unit A CO ppm	Unit X CO ppm	Bluelief Wobbe
5/9/05 16:07	2.40	5.81	1094 1374
5/9/05 16:08	2.49	5.63	1094 1374
5/9/05 16:09	2.64	5.48	1095 1374
5/9/05 16:10	2.55	5.55	1095 1374
5/9/05 16:11	2.32	5.45	1095 1374
5/9/05 16:12	2.41	5.63	1095 1374
5/9/05 16:13	2.34	5.51	1094 1374
5/9/05 16:14	2.28	5.41	1094 1374
5/9/05 16:15	2.30	5.63	1094 1374
5/9/05 16:16	2.07	5.31	1096 1375
5/9/05 16:17	2.09	5.43	1096 1375
5/9/05 16:18	2.16	5.34	1096 1375
5/9/05 16:19	2.03	5.36	1096 1375
5/9/05 16:20	1.96	5.25	1095 1375
5/9/05 16:21	1.76	5.23	1095 1375
5/9/05 16:22	1.88	5.09	1095 1375
5/9/05 16:23	1.76	5.55	1096 1375
5/9/05 16:24	1.73	5.27	1096 1375
5/9/05 16:25	1.64	5.12	1096 1375
5/9/05 16:26	1.62	5.29	1095 1375
5/9/05 16:27	1.52	5.44	1095 1374
5/9/05 16:28	1.48	5.49	1097 1376
5/9/05 16:29	1.51	5.24	1098 1377
5/9/05 16:30	1.37	5.28	1098 1377
5/9/05 16:31	1.57	5.16	1098 1377
5/9/05 16:32	1.53	5.28	1098 1377
5/9/05 16:33	1.96	5.28	1097 1376
5/9/05 16:34	1.48	5.21	1097 1376
5/9/05 16:35	1.50	5.27	1097 1376
5/9/05 16:36	1.44	5.27	1096 1377
5/9/05 16:37	1.57	5.17	1098 1377
5/9/05 16:38	1.43	5.31	1098 1377
5/9/05 16:39	1.49	5.48	1098 1377
5/9/05 16:40	1.38	5.18	1094 1376
5/9/05 16:41	1.41	5.38	1094 1376
5/9/05 16:42	1.55	5.17	1094 1377
5/9/05 16:43	1.41	5.52	1095 1377
5/9/05 16:44	1.50	5.81	1095 1377
5/9/05 16:45	1.48	5.68	1095 1377
5/9/05 16:46	1.48	5.59	1094 1376
5/9/05 16:47	1.48	5.31	1094 1376
5/9/05 16:48	1.48	5.39	1094 1376
5/9/05 16:49	1.41	5.30	1094 1377
5/9/05 16:50	1.48	5.34	1095 1377
5/9/05 16:51	1.36	5.24	1095 1377
5/9/05 16:52	1.52	5.29	1095 1365
5/9/05 16:53	1.46	5.40	1094 1365
5/9/05 16:54	1.48	5.21	1094 1365
5/9/05 16:55	1.44	5.41	1095 1365
5/9/05 16:56	1.36	5.50	1095 1365
5/9/05 16:57	1.54	5.37	1095 1365
5/9/05 16:58	1.42	5.48	1095 1365
5/9/05 16:59	1.47	5.60	1094 1365

**ATTACHMENT 5**

**REVISED MODELING RESULTS**

TABLE 5.1-27 (REVISED 12/06/07)

## NORMAL OPERATION AIR QUALITY MODELING RESULTS FOR NEW EQUIPMENT

Pollutant	Averaging Time	Modeled Maximum Concentrations (µg/m³)			
		Normal Operations AERMOD	Startup/Shutdown AERMOD	Fumigation SCREEN3	Shoreline Fumigation SCREEN3
Combined Impacts Both CTGs					
NO <sub>2</sub>	1-hour	13.8	87.4	2.8	19.4
	Annual	0.2	a	c	c
SO <sub>2</sub>	1-hour	4.5	b	0.8	5.6
	3-hour	2.5	b	0.7	2.8
	24-hour	0.7	b	0.3	0.4
	Annual	0.0	b	c	c
CO	1-hour	9.4	<del>1127.2</del> 1129.5	1.7	11.8
	8-hour	3.7	<del>470.5</del> 470.4	1.0	2.3
PM <sub>2.5</sub> /PM <sub>10</sub>	24-hour	2.2	b	0.6	0.9
	Annual	0.1	b	c	c
Firepump Engine					
NO <sub>2</sub>	1-hour	83.8	d	e	E
	Annual	0.0	d	e	e
SO <sub>2</sub>	1-hour	0.2	d	e	E
	3-hour	0.0	d	e	e
	24-hour	0.0	d	e	e
	Annual	0.0	d	e	e
CO	1-hour	17.5	d	e	E
	8-hour	4.6	d	e	e
PM <sub>2.5</sub> /PM <sub>10</sub>	24-hour	0.0	d	e	e
	Annual	0.0	d	e	e
Combined Impacts New Equipment					
NO <sub>2</sub>	1-hour	83.8	f	f	f
	Annual	0.2	f	f	f
SO <sub>2</sub>	1-hour	4.5	f	f	f
	3-hour	2.5	f	f	f
	24-hour	0.7	f	f	f
	Annual	0.0	f	f	f
CO	1-hour	17.5	f	f	f
	8-hour	4.6	f	f	f
PM <sub>2.5</sub> /PM <sub>10</sub>	24-hour	2.2	f	f	f
	Annual	0.1	f	f	f

a. Not applicable, because startup/shutdown emissions are included in the modeling for annual average.

b. Not applicable, because emissions are not elevated above normal operation levels during startups/shutdowns.

c. Not applicable, because inversion breakup is a short-term phenomenon and as such is evaluated only for short-term averaging periods.

d. Not applicable, because engine will not operate during CTG startups/shutdowns.

e. Not applicable, this type of modeling is not performed for small combustion sources with relatively short stacks.

f. Impacts are the same as shown for CTGs.

TABLE 5.1-28 (REVISED 12/06/07)

MODELED IMPACTS DURING COMMISSIONING (COMBINED IMPACTS BOTH CTGS)

Pollutant/Averaging Period	Modeled Concentration, $\mu\text{g}/\text{m}^3$
NO <sub>2</sub> - 1-hour	<del>429.2</del> <u>127.3</u>
CO - 1-hour	<del>3324.7</del> <u>3323.8</u>
CO - 8-hour	1363.6

TABLE 5.9-6 (REVISED 12/06/07)

Summary of Potential Health Risks

RECEPTOR	CARCINOGENIC RISK <sup>a</sup> (PER MILLION)	CANCER BURDEN	ACUTE HEALTH HAZARD INDEX	CHRONIC HEALTH HAZARD INDEX
Maximum Incremental Cancer Risk (MICR) at PMI	<del>0.16</del> <u>0.15</u>		<del>0.10</del> <u>0.09</u>	<del>0.005</del> <u>0.004</u>
MEIR	<del>0.075</del> <u>0.079</u>	0	<del>0.057</del> <u>0.056</u>	<del>0.0021</del> <u>0.0022</u>
Maximally Exposed Individual Worker <sup>b</sup> (MEIW)	<del>0.080</del> <u>0.079</u>		0.030	Not applicable
Significance Level	10	1.0	1.0	1.0

Notes:

<sup>a</sup> Derived (Adjusted) Method used by San Diego Air Pollution Control District to determine compliance with Regulation 1200.

<sup>b</sup> The worker is assumed to be exposed at the work location 8 hours per day, instead of 24, 245 days per year, instead of 365, and for 40 years, instead of 70. Hence, a 70 year-based chronic HHI is not applicable to a worker.

**ATTACHMENT 6**  
**PM<sub>10</sub> MONITORING DATA**

Summary of 24-hr Avg. PM <sub>10</sub> levels – Escondido Monitoring Station		
Year	1 <sup>st</sup> Max (µg/m <sup>3</sup> )	2 <sup>nd</sup> Max (µg/m <sup>3</sup> )
2004	57	42
2005	42	38
2006	51	43

# Monitor Values Report - Criteria Air Pollutants

**Geographic Area:** San Diego Co, CA

**Pollutant:** Particulate (size < 10 micrometers)

**Year:** 2004

## EPA Air Quality Standards:

Particulate (diameter < 10 micrometers): 150 µg/m3 (24-hour average), 50 µg/m3 (annual mean)

µg/m3 = micrograms per cubic meter

6 Rows

See Disclaimer

PM10 (µg/m3)												
24-Hour Values												
Row #	# Obs	1st Max	2nd Max	3rd Max	4th Max	5th Max	6th Max	7th Max	8th Max	9th Max	10th Max	Mean
1	61	44	43	41	41	0	0.0	26	0	2	060730001	2
2	61	55	49	48	45	0	0.0	30	0	2	060730003	2
3	62	44	43	42	40	0	0.0	25	0	2	060730006	2
4	59	57	42	42	41	0	0.0	27	0	1	060731002	1
5	59	68	65	53	53	0	0.0	33	0	1	060731007	1
6	63	137	109	104	99	0	0.0	51	1	1	060732007	1
Location												
Site ID	Site Address	City	County	State	EPA Region							
80 E. "J" St., Chula Vista	Chula Vista	San Diego Co	CA	09								
1155 Redwood Ave., El Cajon	El Cajon	San Diego Co	CA	09								
5555 Overland Ave., San Diego	San Diego	San Diego Co	CA	09								
600 E. Valley Pkwy., Escondido	Escondido	San Diego Co	CA	09								
330a 12th Ave., San Diego, Ca. 92112	San Diego	San Diego Co	CA	09								
1100 Paseo International, Otay Mesa, Ca	Otay Mesa	San Diego Co	CA	09								

## Monitor Values Report - Criteria Air Pollutants

**Geographic Area:** San Diego Co, CA

**Pollutant:** Particulate (size < 10 micrometers)

**Year: 2005**

### EPA Air Quality Standards:

Particulate (diameter < 10 micrometers): 150 µg/m<sup>3</sup> (24-hour average), 50 µg/m<sup>3</sup> (annual mean)

**µg/m<sup>3</sup> = micrograms per cubic meter**

7 Rows

**See Disclaimer**

[illegible]

# Monitor Values Report - Criteria Air Pollutants

**Geographic Area:** San Diego Co, CA

**Pollutant:** Particulate (size < 10 micrometers)

**Year:** 2006

## EPA Air Quality Standards:

Particulate (diameter < 10 micrometers): 150 µg/m<sup>3</sup> (24-hour average), 50 µg/m<sup>3</sup> (annual mean)

µg/m<sup>3</sup> = micrograms per cubic meter

6 Rows

See [Disclaimer](#)

Monitoring Station												County											
Row	Station ID	Station Name	Latitude	Longitude	Altitude (ft)	Particulate (µg/m <sup>3</sup> )	Particulate (µg/m <sup>3</sup> )	Particulate (µg/m <sup>3</sup> )	Particulate (µg/m <sup>3</sup> )	Particulate (µg/m <sup>3</sup> )	Particulate (µg/m <sup>3</sup> )	Station ID	Station Name	Latitude	Longitude	Altitude (ft)	Particulate (µg/m <sup>3</sup> )	Particulate (µg/m <sup>3</sup> )	Particulate (µg/m <sup>3</sup> )	Particulate (µg/m <sup>3</sup> )	Particulate (µg/m <sup>3</sup> )	Particulate (µg/m <sup>3</sup> )	Station ID
1	61	51	49	42	42	0	0.0	26	0	2	060730001	80 E. "J" St., Chula Vista	Chula Vista	San Diego Co	CA	09							
2	58	47	46	42	39	0	0.0	27	0	2	060730003	1155 Redwood Ave., El Cajon	El Cajon	San Diego Co	CA	09							
3	61	42	34	32	32	0	0.0	22	0	2	060730006	5555 Overland Ave., San Diego	San Diego	San Diego Co	CA	09							
4	61	51	43	42	41	0	0.0	24	0	1	060731002	600 E. Valley Pkwy., Escondido	Escondido	San Diego Co	CA	09							
5	62	71	69	61	57	0	0.0	34	0	1	060731010	1110 Beardsley Street, San Diego, Ca 921	San Diego	San Diego Co	CA	09							
6	61	133	117	114	101	0	0.0	54	1	1	060732007	1100 Paseo International, Otay Mesa, Ca	Otay Mesa	San Diego Co	CA	09							

**ATTACHMENT 7**  
**REVISED MODELING README FILE**

Carlsbad Energy Center Project (Encina) Modeling Files  
Sierra Research - Marc P. Valdez - December 13, 2007.

Six zipped files, enclosing modeling using three years of Camp Pendleton, CA meteorological data (2003 - 2005), together with corresponding hourly ozone concentration data for Oceanside. The original data was provided by the SDAPCD.

Template files originally developed within Lakes Environmental software, using standard Lakes naming conventions. Changes were subsequently made to these files in standard text editors. For example, for multiple pollutants, the input information for the first pollutant would be copied in a text editor to facilitate inputting the information needed for the other pollutants.

AERMET Output Met Data (6 files) to be used as AERMOD input files.

CMP_03.SFC	AERMOD 2003 Surface File
CMP_03.PFL	AERMOD 2003 Profile File
CMP_04.SFC	AERMOD 2004 Surface File
CMP_04.PFL	AERMOD 2004 Profile File
CMP_05.SFC	AERMOD 2005 Surface File
CMP_05.PFL	AERMOD 2005 Profile File

ISCST3 Input Met Data (3 Files)

CMP_03.MET	ISCST3 2003 Met File
CMP_04.MET	ISCST3 2004 Met File
CMP_05.MET	ISCST3 2005 Met File

Ozone Data (3 Files) formatted for AERMOD input.

O3FIL03.PRN	Hourly 2003 Ozone Data for Oceanside
O3FIL04.PRN	Hourly 2004 Ozone Data for Oceanside
O3FIL05.PRN	Hourly 2005 Ozone Data for Oceanside

Ozone Data (3 Files) formatted for ISCST3 input.

O3FIL03.ASC	Hourly 2003 Ozone Data for Oceanside
O3FIL04.ASC	Hourly 2004 Ozone Data for Oceanside
O3FIL05.ASC	Hourly 2005 Ozone Data for Oceanside

FUMIGATION Files (2 files)

ENCNS01.OUT	SCREEN3 Output for Turbines 1 & 2
FUMIGATION1.XLS	Fumigation Calculation Spreadsheet for results presented in AFC Air Quality Section 5.1 text and appendix.

Three zipped folders for 2003, 2004 and 2005, respectively, each containing a set of 36 modeling files equivalent to the 2003 set listed here.

Standard Lakes naming convention

*.ADI	- AERMOD input file
*.OUT	- AERMOD output file
*.ROU	- various receptor grids

AERMOD Files (36 files)

<u>File Name</u>	<u>Description</u>
ENCN0301.ADI	Turbine SCREENING, AERMOD Input File, unit impacts For different operating MODE

ENCN0301.OUT

## Turbine SCREENING, AERMOD Output File

## Source

<u>Group</u>	<u>Sources</u>	<u>Description (operating mode)</u>
S01	STCK011 STCK012	Avg. Peak
S02	STCK021 STCK022	Avg. Base (cooler)
S03	STCK031 STCK032	Avg. Base
S04	STCK041 STCK042	Avg. Mid.
S05	STCK051 STCK052	Avg. Low (60%)
S06	STCK061 STCK062	Hot Peak
S07	STCK071 STCK072	Hot Base (cooler)
S08	STCK081 STCK082	Hot Base
S09	STCK091 STCK092	Hot Mid.
S10	STCK101 STCK102	Hot Low (60%)
S11	STCK111 STCK112	Mild Base (cooler)
S12	STCK121 STCK122	Mild Base
S13	STCK131 STCK132	Mild Mid.
S14	STCK141 STCK142	Mild Low (60%)
S15	STCK151 STCK152	Cold Base
S16	STCK161 STCK162	Cold Mid.
S17	STCK171 STCK172	Cold Low (60%)
S18	STCK181 STCK182	Startup/Shutdown
S19	STCK191 STCK192	Commissioning
F01	FIRE01	Firepump

File NameDescription

ENCN0302.ADI

Startup & Commissioning, NOx & CO, 1- & 8-hr,  
Uncorrected, AERMOD Input File

ENCN0302.OUT

Startup & Commissioning, NOx & CO, 1- & 8-hr,  
Uncorrected, AERMOD Output File

## Source

<u>Group</u>	<u>Sources</u>	<u>Description</u>
SNOX1	NSTCK181	Startup NOx, Turbine 1
SNOX2	NSTCK182	Startup NOx, Turbine 2
SNOXA	NSTCK181 NSTCK182	Startup NOx, Both Turbines
CNOX1	NSTCK191	Commissioning NOx, Turbine 1
CNOX2	NSTCK192	Commissioning NOx, Turbine 2
CNOXA1	NSTCK191 NSTCK182	Commissioning NOx, Turbine 1 in Commissioning Mode
CNOXA2	NSTCK192 NSTCK181	Commissioning NOx, Turbine 2 in Commissioning Mode
S_CO1	CSTCK181	Startup CO, Turbine 1
S_CO2	CSTCK182	Startup CO, Turbine 2
S_COA	CSTCK181 CSTCK182	Startup CO, Both Turbines
C_CO1	CSTCK191	Commissioning CO, Turbine 1
C_CO2	CSTCK192	Commissioning CO, Turbine 2
C_COA1	CSTCK191 CSTCK182	Commissioning CO, Turbine 1 in Commissioning Mode
C_COA2	CSTCK192 CSTCK181	Commissioning CO, Turbine 2 in Commissioning Mode

File NameDescription

ENCN0303.ADI

Startup NOx, 1-hr, Corrected, AERMOD Input File

ENCN0303.OUT

Startup NOx, 1-hr, Corrected, AERMOD Output File

Source		
<u>Group</u>	<u>Sources</u>	<u>Description</u>
SNOX1	NSTCK181	Startup NOx, Turbine 1
SNOX2	NSTCK182	Startup NOx, Turbine 2
SNOXA	NSTCK181 NSTCK182	Startup NOx, Both Turbines

---

<u>File Name</u>	<u>Description</u>
ENCN0304.ADI	Commissioning NOx, 1-hr, Corrected, AERMOD Input File, Turbine 1 in Commissioning Mode
ENCN0304.OUT	Commissioning NOx, 1-hr, Corrected, AERMOD Output File , Turbine 1 in Commissioning Mode

Source		
<u>Group</u>	<u>Sources</u>	<u>Description</u>
SNOX2	NSTCK182	Commissioning NOx, Turbine 2
CNOX1	NSTCK191	Commissioning NOx, Turbine 1, Turbine 1 in Commissioning Mode
CNOXA1	NSTCK191 NSTCK182	Both Turbines

---

<u>File Name</u>	<u>Description</u>
ENCN0305.ADI	Commissioning NOx, 1-hr, Corrected, AERMOD Input File, Turbine 2 in Commissioning Mode
ENCN0305.OUT	Commissioning NOx, 1-hr, Corrected, AERMOD Output File , Turbine 2 in Commissioning Mode

Source		
<u>Group</u>	<u>Sources</u>	<u>Description</u>
SNOX1	NSTCK181	Commissioning NOx, Turbine 1
CNOX2	NSTCK192	Commissioning NOx, Turbine 2, Turbine 2 in Commissioning Mode
CNOXA2	NSTCK192 NSTCK181	Both Turbines

---

<u>File Name</u>	<u>Description</u>
ENCN0331.ADI	Refined Run, NOx, 1-hr, Uncorrected, AERMOD Input File
ENCN0331.OUT	Refined Run, NOx, 1-hr, Uncorrected, AERMOD Output File

Source		
<u>Group</u>	<u>Sources</u>	<u>Description</u>
S01	STCK011	Turbine 1
S02	STCK012	Turbine 2
S03	STCK011 STCK012	Both Turbines
F01	FIRE01	Fire Pump
C01	STCK011 STCK012 FIRE01	All Sources

---

<u>File Name</u>	<u>Description</u>
ENCN0332.ADI	Refined Run, SO2, 1-, 3-, & 24-hr, AERMOD Input File

ENCN0332.OUT      Refined Run, SO2, 1-, 3-, & 24-hr, AERMOD Output File

<u>Source Group</u>	<u>Sources</u>	<u>Description</u>
S01	STCK011	Turbine 1
S02	STCK012	Turbine 2
S03	STCK011 STCK012	Both Turbines
F01	FIRE01	Fire Pump - 1-hr avg.
F02	FIRE02	Fire Pump - 3-hr avg.
F03	FIRE03	Fire Pump - 24-hr avg.
C01	STCK011 STCK012 FIRE01	All Sources - 1-hr avg.
C08	STCK011 STCK012 FIRE02	All Sources - 3-hr avg.
C11	STCK011 STCK012 FIRE03	All Sources - 24-hr avg.

<u>File Name</u>	<u>Description</u>
ENCN0333.ADI	Refined Run, CO, 1- & 8-hr, AERMOD Input File
ENCN0333.OUT	Refined Run, CO, 1- & 8-hr, AERMOD Output File

<u>Source Group</u>	<u>Sources</u>	<u>Description</u>
S01	STCK011	Turbine 1 - 1-hr avg.
S02	STCK012	Turbine 2 - 1-hr avg.
S03	STCK011 STCK012	Both Turbines - 1-hr avg.
S04	STCK041	Turbine 1 - 8-hr avg.
S05	STCK042	Turbine 2 - 8-hr avg.
S06	STCK041 STCK042	Both Turbines - 8-hr avg.
F01	FIRE01	Fire Pump
C01	STCK011 STCK012 FIRE01	All Sources - 1-hr avg.
C08	STCK041 STCK042 FIRE01	All Sources - 8-hr avg.

<u>File Name</u>	<u>Description</u>
ENCN0334.ADI	Refined Run, PM10, 24-hr, AERMOD Input File
ENCN0334.OUT	Refined Run, PM10, 24-hr, AERMOD Output File

<u>Source Group</u>	<u>Sources</u>	<u>Description</u>
S01	STCK101	Turbine 1
S02	STCK102	Turbine 2
S03	STCK101 STCK102	Both Turbines
F01	FIRE01	Fire Pump
C01	STCK101 STCK102 FIRE01	All Sources

<u>File Name</u>	<u>Description</u>
ENCN0335.ADI	Refined Run, NOx, Annual, Uncorrected, AERMOD Input File
ENCN0335.OUT	Refined Run, NOx, Annual, Uncorrected, AERMOD Output File

<u>Source Group</u>	<u>Sources</u>	<u>Description</u>
S01	STCK031	Turbine 1
S02	STCK032	Turbine 2
S03	STCK031 STCK032	Both Turbines
F01	FIRE01	Fire Pump

C01            STCK031 STCK032 FIRE01   All Sources

-----  

<u>File Name</u>	<u>Description</u>
ENCN0336.ADI	Refined Run, SO2, Annual, AERMOD Input File
ENCN0336.OUT	Refined Run, SO2, Annual, AERMOD Output File

Source  

<u>Group</u>	<u>Sources</u>	<u>Description</u>
S01	STCK031	Turbine 1
S02	STCK032	Turbine 2
S03	STCK031 STCK032	Both Turbines
F01	FIRE01	Fire Pump
C01	STCK031 STCK032 FIRE01	All Sources

-----  

<u>File Name</u>	<u>Description</u>
ENCN0337.ADI	Refined Run, PM10, Annual, AERMOD Input File
ENCN0337.OUT	Refined Run, PM10, Annual, AERMOD Output File

Source  

<u>Group</u>	<u>Sources</u>	<u>Description</u>
S01	STCK101	Turbine 1
S02	STCK102	Turbine 2
S03	STCK101 STCK102	Both Turbines
F01	FIRE01	Fire Pump
C01	STCK101 STCK102 FIRE01	All Sources

-----  

<u>File Name</u>	<u>Description</u>
ENCN0338.ADI	Refined Run, NOx, 1-hr, PVMRM, AERMOD Input File
ENCN0338.OUT	Refined Run, NOx, 1-hr, PVMRM, AERMOD Output File

Source  

<u>Group</u>	<u>Sources</u>	<u>Description</u>
S01	STCK011	Turbine 1
S02	STCK012	Turbine 2
S03	STCK011 STCK012	Both Turbines
F01	FIRE01	Fire Pump
C01	STCK011 STCK012 FIRE01	All Sources

-----  

<u>File Name</u>	<u>Description</u>
ENCN0339.ADI	HRA, AERMOD Input File
ENCN0339.OUT	HRA, AERMOD Output File
ENCN0339.PLT	HRA, AERMOD Output Plotting File

Source  

<u>Group</u>	<u>Sources</u>	<u>Description</u>
DADT	DAD031 DAD032	Derived (Adjusted) Cancer Risk (Res. - Turbines)
DADF	DADF01	Derived (Adjusted) Cancer Risk (Res. - Fire Pump)
DADA	DAD031 DAD032 DADF01	Derived (Adjusted) Cancer Risk (Res. - All Sources)
DEWT	DEW031 DEW032	Derived (Adjusted) Cancer Risk

DEWF	DEWF01	(Worker - Turbines) Derived (Adjusted) Cancer Risk (Worker - Fire Pump)
DEWA	DEW031 DEW032 DEWF01	Derived (Adjusted) Cancer Risk (Worker - All Sources)
CHRT	CHR031 CHR032	Chronic Risk - Turbines
CHRF	CHRF01	Chronic Risk - Fire Pump
CHRA	CHR031 CHR032 CHRF01	Chronic Risk - All Sources
ACNT	ACNX11 ACNX12	Acute Risk - Turbines, No Catalyst
ACNA	ACNX11 ACNX12 ACUF01	Acute Risk - All Sources, No Catalyst
ACUT	ACU011 ACU012	Acute Risk - Turbines, With Catalyst
ACUA	ACU011 ACU012 ACUF01	Acute Risk - All Sources, With Catalyst
ACUF	ACUF01	Acute Risk - Fire Pump

<u>File Name</u>	<u>Description</u>
ENCN0344.ADI	HRA, worst-hit residences, AERMOD Input File
ENCN0344.OUT	HRA, worst-hit residences, AERMOD Output File
ENCN0344.PLT	HRA, worst-hit residences, AERMOD Output Plotting File

<u>Source Group</u>	<u>Sources</u>	<u>Description</u>
DADT	DAD031 DAD032	Derived (Adjusted) Cancer Risk (Res. - Turbines)
DADF	DADF01	Derived (Adjusted) Cancer Risk (Res. - Fire Pump)
DADA	DAD031 DAD032 DADF01	Derived (Adjusted) Cancer Risk (Res. - All Sources)
DEWT	DEW031 DEW032	Derived (Adjusted) Cancer Risk (Worker - Turbines)
DEWF	DEWF01	Derived (Adjusted) Cancer Risk (Worker - Fire Pump)
DEWA	DEW031 DEW032 DEWF01	Derived (Adjusted) Cancer Risk (Worker - All Sources)
CHRT	CHR031 CHR032	Chronic Risk - Turbines
CHRF	CHRF01	Chronic Risk - Fire Pump
CHRA	CHR031 CHR032 CHRF01	Chronic Risk - All Sources
ACNT	ACNX11 ACNX12	Acute Risk - Turbines, No Catalyst
ACNA	ACNX11 ACNX12 ACUF01	Acute Risk - All Sources, No Catalyst
ACUT	ACU011 ACU012	Acute Risk - Turbines, With Catalyst
ACUA	ACU011 ACU012 ACUF01	Acute Risk - All Sources, With Catalyst
ACUF	ACUF01	Acute Risk - Fire Pump

<u>File Name</u>	<u>Description</u>
ENCN339B.ADI	Risk, AERMOD Input File (emissions x 1E+03)
ENCN339B.OUT	Risk, AERMOD Output File (emissions x 1E+03)
ENCN339B.PLT	Risk, AERMOD Output Plotting File (emissions x 1E+03)

<u>Source Group</u>	<u>Sources</u>	<u>Description</u>
---------------------	----------------	--------------------

CHRT	CHR031 CHR032	Chronic Risk - Turbines
CHRF	CHRF01	Chronic Risk - Fire Pump
CHRA	CHR031 CHR032 CHRF01	Chronic Risk - All Sources
ACNT	ACNX11 ACNX12	Acute Risk - Turbines, No Catalyst
ACNA	ACNX11 ACNX12 ACUF01	Acute Risk - All Sources, No Catalyst
ACUT	ACU011 ACU012	Acute Risk - Turbines, With Catalyst
ACUA	ACU011 ACU012 ACUF01	Acute Risk - All Sources, With Catalyst
ACUF	ACUF01	Acute Risk - Fire Pump

---

<u>File Name</u>	<u>Description</u>
ENCN0347.ADI	Startup & Commissioning, AERMOD Input File
ENCN0347.OUT	Startup & Commissioning, AERMOD Output File

#### Source

<u>Group</u>	<u>Sources</u>	<u>Description</u>
SNOX1	NSTCK181	Startup NO2, Turbine 1
SNOX2	NSTCK182	Startup NO2, Turbine 2
SNOXA	NSTCK181 NSTCK182	Startup NO2, Both Turbines
CNOX1	NSTCK191	Commissioning NO2, Turbine 1
CNOX2	NSTCK192	Commissioning NO2, Turbine 2
CNOXA1	NSTCK191 NSTCK182	Commissioning NO2, Both Turbines, Case A
CNOXA2	NSTCK192 NSTCK181	Commissioning NO2, Both Turbines, Case B
S_CO1	CSTCK181	Startup CO, Turbine 1
S_CO2	CSTCK182	Startup CO, Turbine 2
S_COA	CSTCK181 CSTCK182	Startup CO, Both Turbines
C_CO1	CSTCK191	Commissioning CO, Turbine 1
C_CO2	CSTCK192	Commissioning CO, Turbine 2
C_COA1	CSTCK191 CSTCK182	Commissioning CO, Both Turbines, Case A
C_COA2	CSTCK192 CSTCK181	Commissioning CO, Both Turbines, Case B
NEXIST	NPKG TG NBOILG	Existing Sources NO2 (Turbine, Boilers)
SENX1	NSTCK181 NPKG TG NBOILG	Startup NO2, Turbine 1, Existing Srcs.
SENX2	NSTCK182 NPKG TG NBOILG	Startup NO2, Turbine 2, Existing Srcs.
SENXA	NSTCK181 NSTCK182 NPKG TG NBOILG	Startup NO2, Both Turbines, Existing Srcs.
CENX1	NSTCK191 NPKG TG NBOILG	Commissioning NO2, Turbine 1, Existing Srcs.
CENX2	NSTCK192 NPKG TG NBOILG	Commissioning NO2, Turbine 2, Existing Srcs.
CENXA1	NSTCK191 NSTCK182 NPKG TG NBOILG	Commissioning NO2, Both Turbines, Case A, Existing Srcs.
CENXA2	NSTCK192 NSTCK181 NPKG TG NBOILG	Commissioning NO2, Both Turbines, Case B, Existing Srcs.
CEXIST	CPKG TG CBOILG	Existing Sources CO (Turbine, Boilers)
SECO1	CSTCK181 CPKG TG CBOILG	Startup CO, Turbine 1, Existing Srcs.
SECO2	CSTCK182 CPKG TG CBOILG	Startup CO, Turbine 2, Existing Srcs.
SECOA	CSTCK181 CSTCK182 CPKG TG CBOILG	Startup CO, Both Turbines, Existing Srcs.

CECO1	CSTCK191 CPKGTG CBOILG	Commissioning CO, Turbine 1, Existing Srcs.
CECO2	CSTCK192 CPKGTG CBOILG	Commissioning CO, Turbine 2, Existing Srcs.
CECOA1	CSTCK191 CSTCK182 CPKGTG CBOILG	Commissioning CO, Both Turbines, Case A, Existing Srcs.
CECOA2	CSTCK192 CSTCK181 CPKGTG CBOILG	Commissioning CO, Both Turbines, Case B, Existing Srcs.

-----

Receptor Data - 3 Files

ENC1.ROU	Coarse receptor grid
ENC2.ROU	Coarse & fine receptor grids
ENC3.ROU	Nearby and maximum impact residences and workplaces

ISCST3 Files - Construction - Combustion w. 4 volume sources - 3 years  
x 12 files = 36 files

12 files for 2003

-----

<u>File Name</u>	<u>Description</u>
ENCN0326.ADI	Construction, Case 1, ISCST3 Input File
ENCN0326.OUT	Construction, Case 1, ISCST3 Output File
ENCN0326.PLT	Construction, Case 1, ISCST3 Output Plotting File

Source

<u>Group</u>	<u>Sources</u>	<u>Description</u>
NXSC	NV01 NV11 NV21 NV31	NOx, Short-Term
COSC	CV01 CV11 CV21 CV31	CO, Short-Term
SXSC	SV01 SV11 SV21 SV31	SO2, Short-Term
NXLC	NV04 NV14 NV24 NV34	NOx, Long-Term
SXLC	SV04 SV14 SV24 SV34	SO2, Long-Term
PM10S	PV01-PV02 PA03 PV11-PV12 PV21-PV22 PV31-PV32	PM10, Short-Term
PM10L	PV04-PV05 PA06 PV14-PV15 PV24-PV25 PV34-PV35	PM10, Long-Term
PM25S	FV01-FV02 FA03 FV11-FV12 FV21-FV22 FV31-FV32	PM2.5, Short-Term
PM25L	FV04-FV05 FA06 FV14-FV15 FV24-FV25 FV34-FV35	PM2.5, Long-Term
PM25CS	FV01 FV11 FV21 FV31	PM2.5, Combustion, Short-Term
PM25CL	FV04 FV14 FV24 FV34	PM2.5, Combustion, Long-Term

-----

<u>File Name</u>	<u>Description</u>
------------------	--------------------

ENCN0327.ADI	Construction, Case 2, ISCST3 Input File
ENCN0327.OUT	Construction, Case 2, ISCST3 Output File
ENCN0327.PLT	Construction, Case 2, ISCST3 Output Plotting File

Source

<u>Group</u>	<u>Sources</u>	<u>Description</u>
NXSC	NV01 NV11 NV21 NV31	NOx, Short-Term
COSC	CV01 CV11 CV21 CV31	CO, Short-Term
SXSC	SV01 SV11 SV21 SV31	SO2, Short-Term
NXLC	NV04 NV14 NV24 NV34	NOx, Long-Term
SXLC	SV04 SV14 SV24 SV34	SO2, Long-Term
PM10S	PV01-PV02 PA03 FV11-FV12 FV21-FV22 FV31-FV32	PM10, Short-Term
PM10L	PV04-PV05 PA06 FV14-FV15 FV24-FV25 FV34-FV35	PM10, Long-Term
PM25S	FV01-FV02 FA03 FV11-FV12 FV21-FV22 FV31-FV32	PM2.5, Short-Term
PM25L	FV04-FV05 FA06 FV14-FV15 FV24-FV25 FV34-FV35	PM2.5, Long-Term
PM25CS	FV01 FV11 FV21 FV31	PM2.5, Combustion, Short-Term
PM25CL	FV04 FV14 FV24 FV34	PM2.5, Combustion, Long-Term

---

<u>File Name</u>	<u>Description</u>
ENCN0328.ADI File	Construction, Case 1, NOx, 1-hr, OLM, ISCST3 Input
ENCN0328.OUT File	Construction, Case 1, NOx, 1-hr, OLM, ISCST3 Output
ENCN0328.PLT Plotting File	Construction, Case 1, NOx, 1-hr, OLM, ISCST3 Output

Source

<u>Group</u>	<u>Sources</u>	<u>Description</u>
NXSC	NV01 NV11 NV21 NV31	NOx, Short-Term

---

<u>File Name</u>	<u>Description</u>
ENCN0329.ADI File	Construction, Case 2, NOx, 1-hr, OLM, ISCST3 Input
ENCN0329.OUT File	Construction, Case 2, NOx, 1-hr, OLM, ISCST3 Output
ENCN0329.PLT Plotting File	Construction, Case 2, NOx, 1-hr, OLM, ISCST3 Output

Source

<u>Group</u>	<u>Sources</u>	<u>Description</u>
NXSC	NV01 NV11 NV21 NV31	NOx, Short-Term

---

BPIP FILES AND DEM DATA (NAD27 DATUM)

Eight DEM files (DEM.ZIP) for the following quadrangles:

SNMARCOS.DEM  
SLUISREY.DEM  
BONSALL.DEM  
ENCINITAS.DEM  
LAPULGS.DEM  
MORROHIL.DEM  
OCEANSIDE.DEM  
RSANTAFE.DEM

---

Three BPIP Files

ENC1_WTIER5.SUP	Summary Output File
ENC1_WTIER5.PRO	Output File
ENC1_WTIER5.BPI	BPIP Input File

**ATTACHMENT 8**

**SIEMENS GAS TURBINE PERFORMANCE RUNS AT LOW LOADS**



# OVERSIZE DOCUMENT

- Too Large to Scan
- No Digital Version Available
- The complete document can be found in the Dockets Unit.