


Smart Grid Applications To Water Agencies



Lon W. House, Ph.D. 530.676.8956 www.waterandenergyconsulting.com

CEC Docket 08-DR-01 Load Management Standards-Smart Grid

April 29, 2007 Workshop

Same Operational

Benefits

- Electricity and Water



- reduced meter reading costs
- reduced costs associated with field visits and customer calls
- improved billing accuracy and improved cash flow
- improved outage information and response
- more efficient asset management and distribution engineering design.


The Use of Water Smart Meters

 Improve the understanding of water consumption and flow patterns




- Track and predict changes in trends and demands
- Highlight anomalies
- Warn of high or low flows
- Identify leaks or other waste minimization opportunities
- Shift water consumption to other parts of the day

Finding Leaks





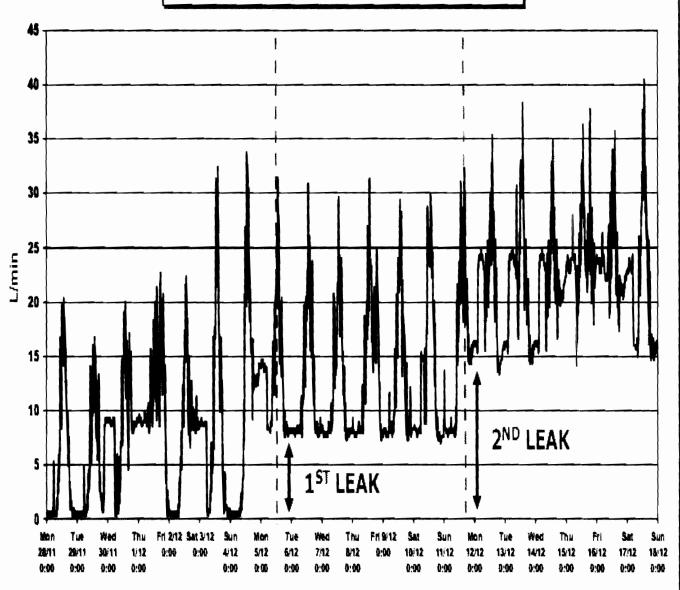


Date and Time Logged

Better Water Use Prediction



Water Consumption of Cooling Towers from Saturday 05/11/05 to Saturday 12/11/05

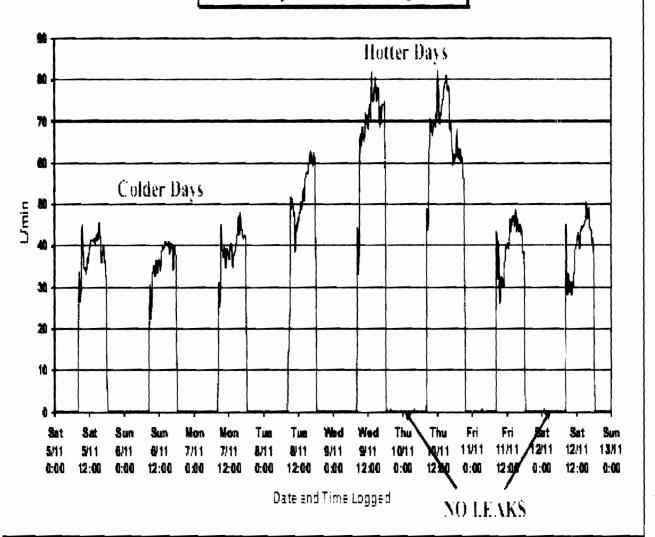


Smart Grid Applications To Water Systems



- Detect size and location of leaks in mains
- Remotely identify location and extent of water main breaks
- Control water loss during breaks
- Restore service after outage
- Reduce electricity use and cost
 - leak detection
 - off peak use
- · Reduce chemical use
- Monitor compliance with watering restrictions
- Increase theft detection

CEC 500-07-022 ACWA Smartmeter Case Study



- Signed by the Commission on April 4th and currently at DGS for final approval.
- ACWA (Association of California Water Agencies),
 Water & Energy Consulting, Coachella Valley Water
 District
- Emphasis upon peak electrical demand reductions
- Case Study
- Installation of TOU (smart) customer water meters in City of Palm Desert
- Catalog of water smart meters, capabilities, characteristics, costs, and installation
- Integration of smart meters into water agency operations
 - Development of TOU water rates
- Assessment of water use shift out of summer afternoon period
 - Impact of water use shift on agency operations
 - Peak electrical demand reduction impact