



California Energy Commission

Estimating Fuel Displacement for California Electricity Reductions

Staff Workshop on Combined Heat and Power
Energy Commission, Hearing Room A

July 14, 2014

Bryan Neff

Electricity Analysis Office

Electricity Supply Analysis Division

bneff@energy.ca.gov

California Energy Commission

DOCKETED

14-CHP-01

TN 73470

JUL 22 2014



Outline

- Purpose
- Scope & Limits
- Characterizing Grid Resources
- Data Source & Assumptions
- Historic & Estimated Heat Rates
- Application & Examples
- Questions



Purpose

- Estimate fuel displacement from avoided use of grid electricity
- Be an apples-to-apples way to compare programs
 - Be policy-neutral
 - Use a common set of assumptions
 - Displace similar resources
- Starting point for discussion



Scope of Method

- Uses grid heat rates to calculate fuel displacement
- Two resource categories
 - Peaking
 - Load Following (off-peak)
- Uses annual average (not seasonal)
- Single state-wide projection




Limits of Method

- Not a life-cycle analysis
- Not meant for short term evaluations
- Not a dispatch model
- Uses simplifying assumptions
- Only valid as long as assumptions hold



Characterizing Grid Resources

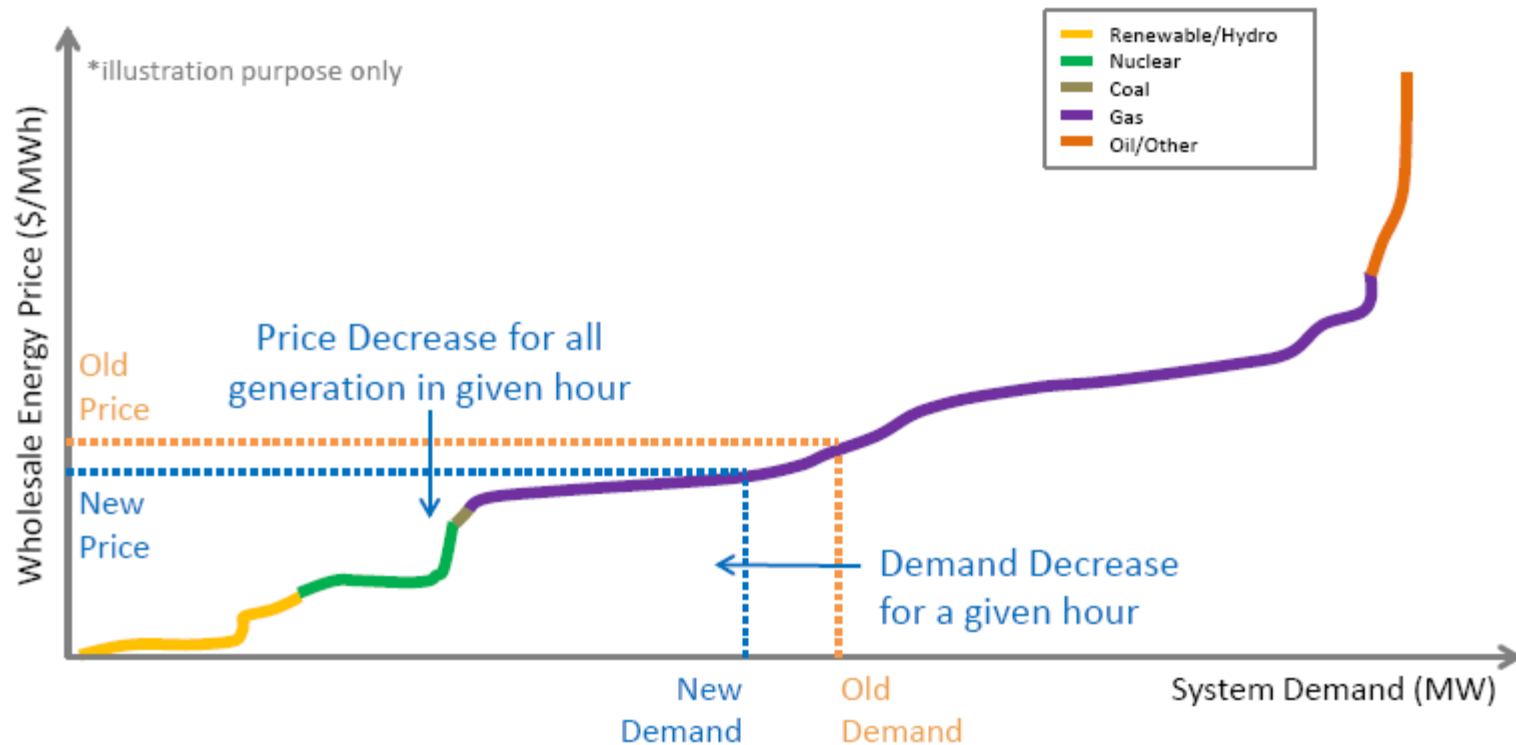




Data Assumptions

- QFER data
- Heat rates aggregated annually
- Single state-wide group
- System stability resources removed




Decreasing Heat Rate Trends

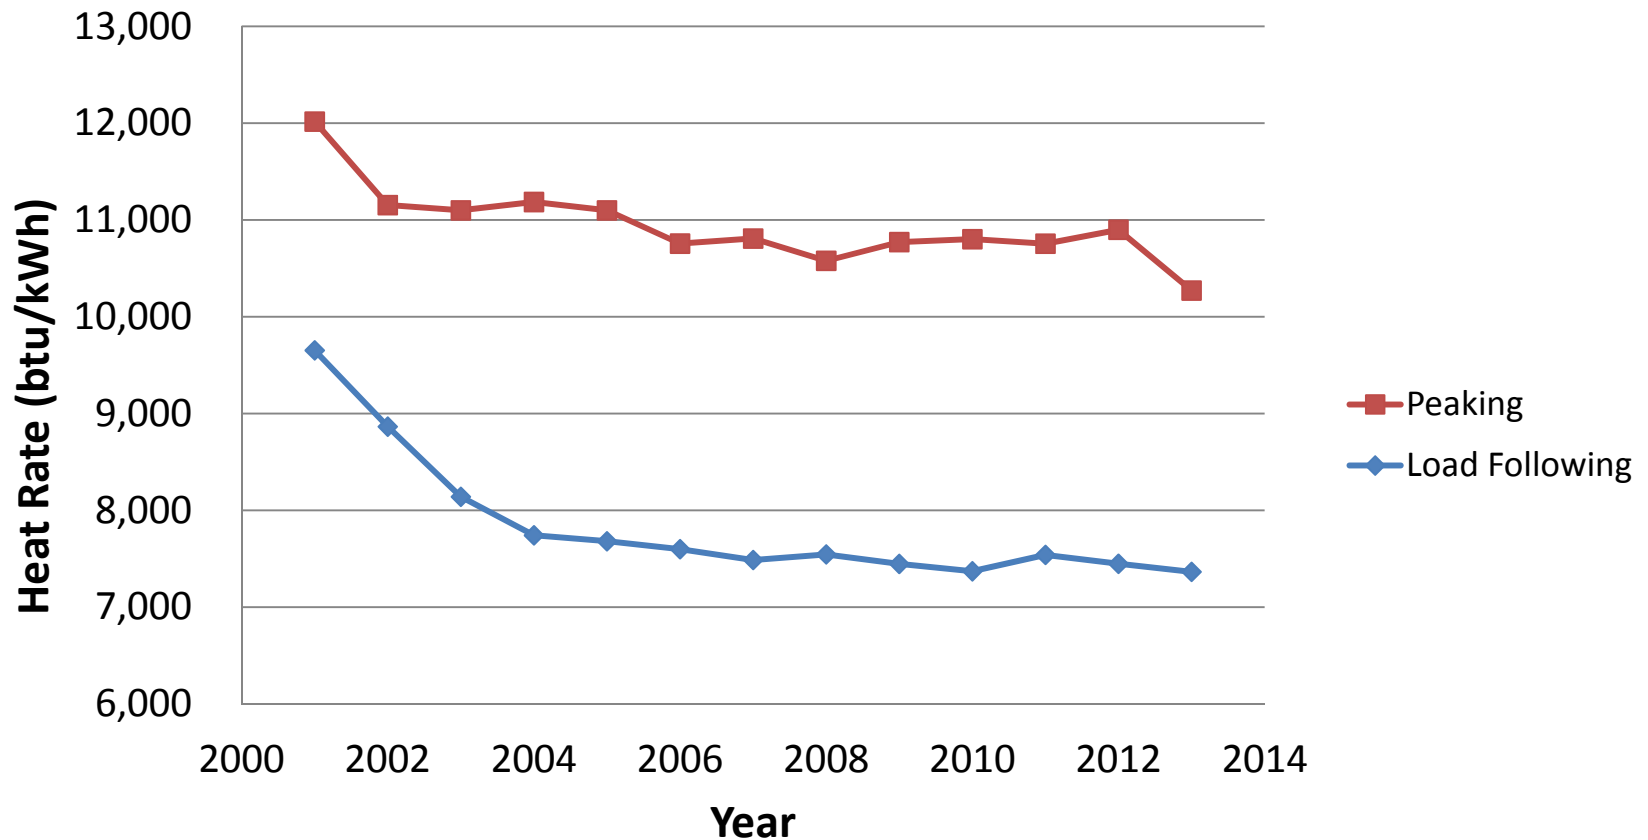



Heat Rate Projection Using Linear Regression

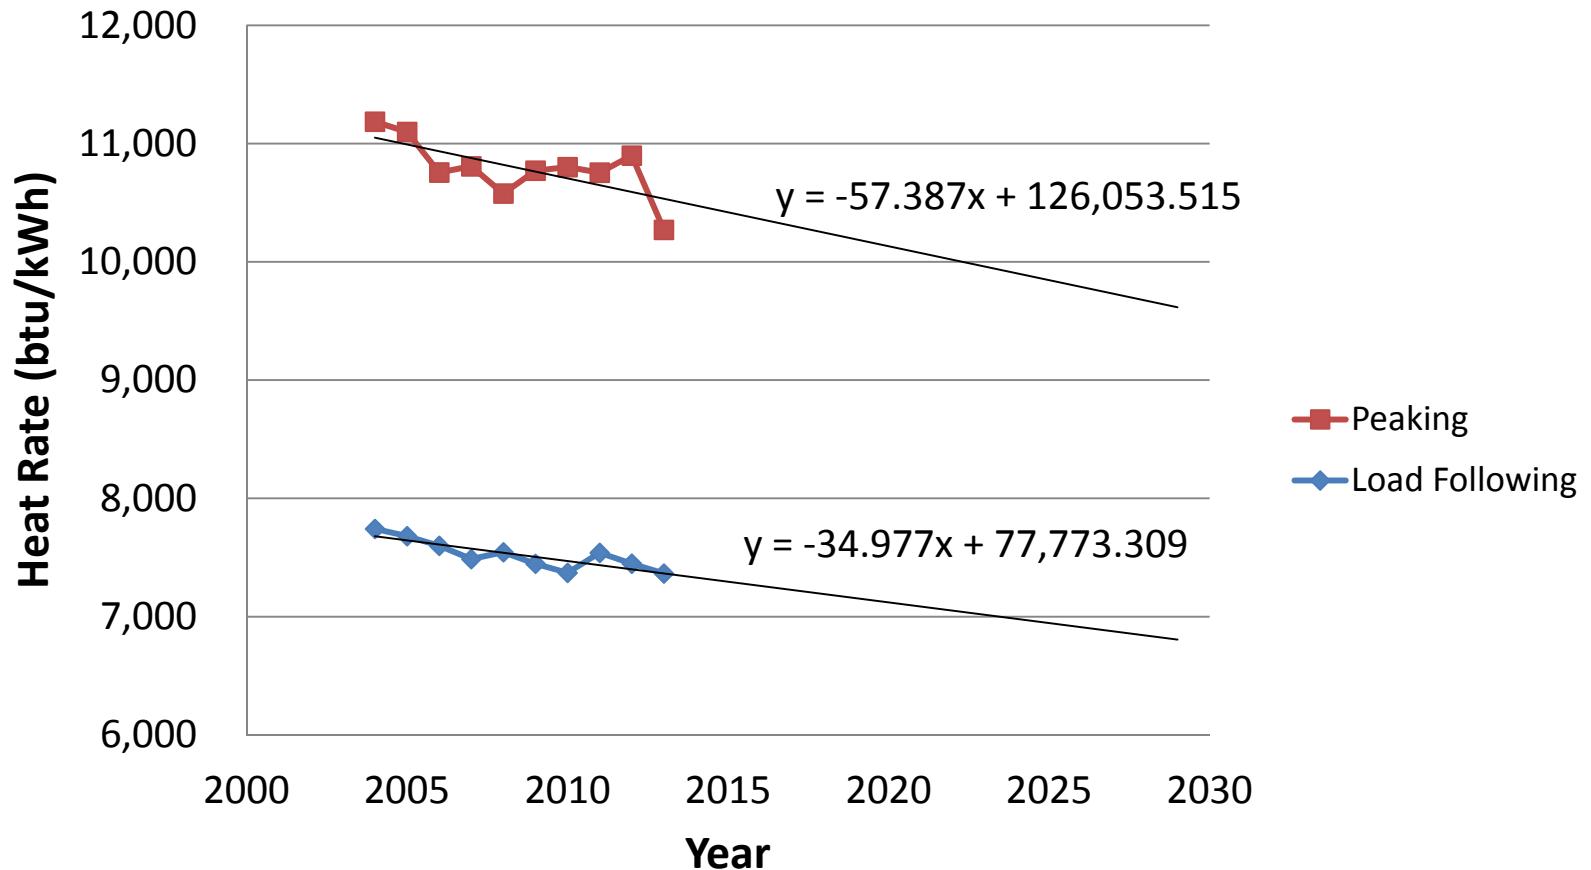



Heat Rate Floor & Loss Factor


Technology	Mid	High	Low
Conventional CT	10,585	11,890	9,980
Advanced CT	9,880	10,200	9,600
Conventional CC	7,250	7,480	7,030
Conventional CC With Duct Firing	7,250	7,480	7,030

Source: See Energy Commission, CEC-200-2014-003-SD.

Avoided Line Loss = $X / (1 - 0.078)$, where X is the reduced grid demand




Applicable Heat Rate Estimates

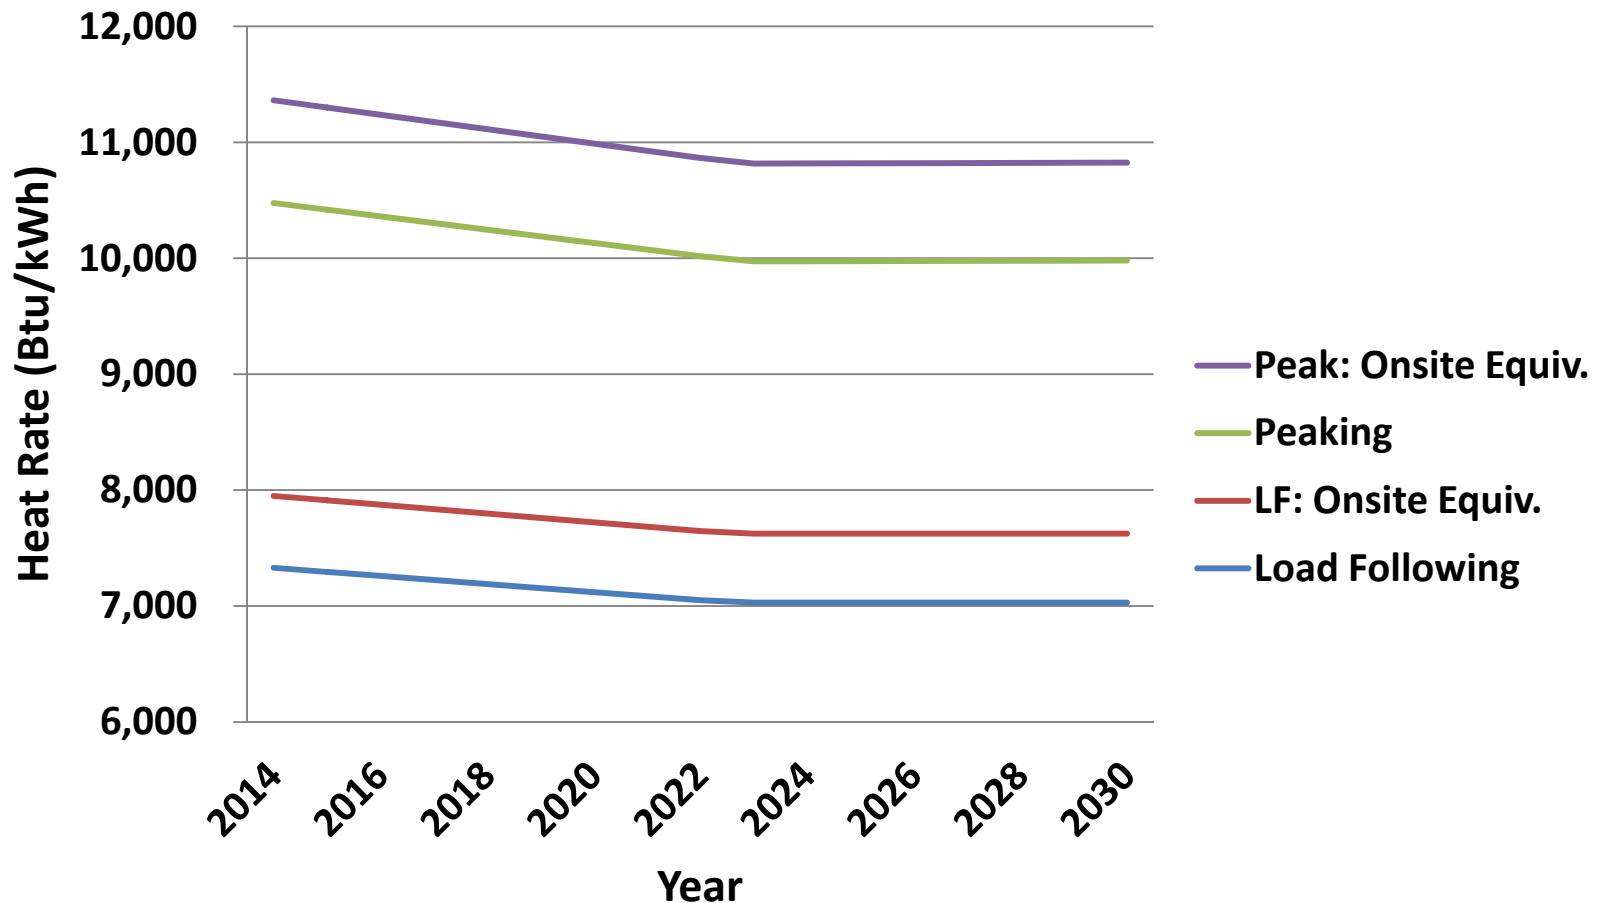



Limited Peak Energy Displacement

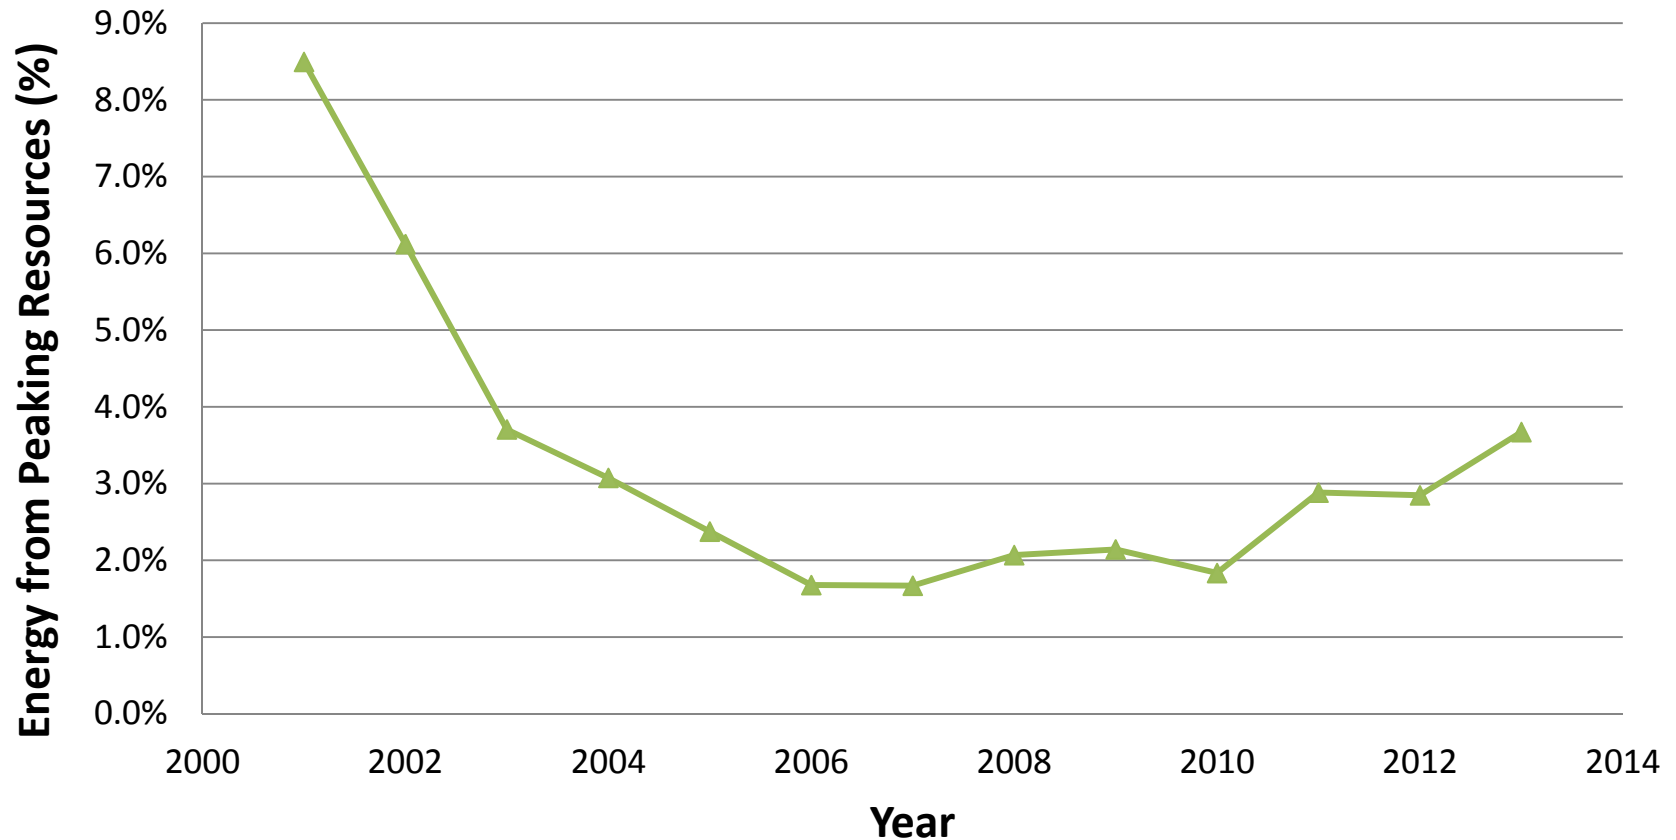



Using the Estimates

- General formula:
(Peak Energy) x (Applicable Peak Heat Rate)
+ (LF Energy) x (Applicable LF Heat Rate)
= Displaced Electric Grid Fuel Equivalent
- Peaking resources limited to 2.5% energy annually
- CO₂ conversion factor of 117 lbs/MMBtu
 - Same as 0.05305 MT



CHP Example

Assumptions:

- 5 MW facility
- 80% capacity factor
- Down time during off-peak hours
- 43,800 MWh potential energy
 - 1,095 MWh on-peak (2.5% x annual potential)
 - 33,945 MWh off-peak (77.5% x annual potential)



Combined Heat and Power (50/50)

Displaced fuel estimate for 2014:

$$\begin{aligned} & (547.5 \text{ MWh} \times 11,362 \text{ Btu/kWh}) \\ & + (16,972.5 \text{ MWh} \times 7,950 \text{ Btu/kWh}) + \\ & (547.5 \text{ MWh} \times 10,476 \text{ Btu/kWh}) \\ & + (16,972.5 \text{ MWh} \times 7,330 \text{ Btu/kWh}) \\ & = 271.3 \text{ billion Btus} \end{aligned}$$

Applying the CO₂ conversion factor yields:

$$\# \text{ BTUs} \times 117 \text{ lbsCO}_2 / \text{million Btus} = 31.7 \text{ million lbsCO}_2$$



CHP Displaced Carbon Intensities

Reduction Type	Total Avoided Grid Energy (MWh)	CO₂ Conversion (million lbsCO₂)	Displaced Carbon Intensity (lbsCO₂/MWh)
All Onsite	35,040	33.0	942
All Export	35,040	30.4	868
50/50 mix	35,040	31.7	905
50/50 mix, sans peaking energy	35,040	31.3	893



Conclusion

- Provides a common approach
- Program life-time estimates
- Standard for comparing relative value
 - Not a substitute for physical measurements
- Variation in displaced carbon intensities
 - Peak power and line losses
- Heat rates can be updated



Appendix



Historic Average Heat Rates

Year	Load Following Plants	Peaker Plants	Percentage of Load Balancing Energy from Peaking Resources
2001	9,653	12,017	8.5%
2002	8,865	11,154	6.1%
2003	8,140	11,100	3.7%
2004	7,742	11,186	3.1%
2005	7,681	11,099	2.4%
2006	7,599	10,756	1.7%
2007	7,487	10,808	1.7%
2008	7,545	10,578	2.1%
2009	7,447	10,771	2.1%
2010	7,371	10,802	1.8%
2011	7,540	10,755	2.9%
2012	7,448	10,899	2.8%
2013	7,365	10,271	3.7%



Applicable Heat Rate Estimates

Year	Load Following	LF: Onsite Equivalent	Peaking	Peaking: Onsite Equivalent
2014	7,330	7,950	10,476	11,362
2015	7,295	7,912	10,419	11,300
2016	7,260	7,874	10,361	11,238
2017	7,225	7,836	10,304	11,176
2018	7,190	7,798	10,247	11,113
2019	7,155	7,760	10,189	11,051
2020	7,120	7,722	10,132	10,989
2021	7,085	7,684	10,074	10,927
2022	7,050	7,646	10,017	10,864
2023 to 2030	7,030	7,625	9,980	10,824

Source: Energy Commission, Electricity Analysis Office, Electricity Supply Analysis Division.



Combined Heat and Power (onsite)

Displaced fuel estimate for 2014:

(1,095 MWh x 11,362 Btu/kWh)

+ (33,945 MWh x 7,950 BTU/kWh)

= 282.3 billion Btus

Applying the CO₂ conversion factor yields:

Btus x 117 lbsCO₂ / million Btus = 33.0 million lbsCO₂



Combined Heat and Power (export)

Displaced fuel estimate for 2014:

$$\begin{aligned} & (1,095 \text{ MWh} \times 10,476 \text{ Btu/kWh}) \\ & + (33,945 \text{ MWh} \times 7,330 \text{ Btu/kWh}) \\ & = 260.3 \text{ billion Btus} \end{aligned}$$

Applying the CO₂ conversion factor yields:

$$\# \text{ Btus} \times 117 \text{ lbsCO}_2 / \text{million Btus} = 30.4 \text{ million lbsCO}_2$$



Combined Heat and Power (50/50, sans peaking energy)

Displaced fuel estimate for 2014:

$(17,520 \text{ MWh} \times 7,950 \text{ Btu/kWh})$

$+ (17,520 \text{ MWh} \times 7,330 \text{ Btu/kWh})$

$= 267.7 \text{ billion Btus}$

Applying the CO₂ conversion factor yields:

$\# \text{ BTUs} \times 117 \text{ lbsCO}_2 / \text{million Btus} = 31.3 \text{ million lbsCO}_2$